


1st Floor Truss Layout Scale: 3/16" = 1'

RELEASE FOR CONSTRUCTION AS NOTED ON PLANS REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI 09/16/2021

								((
Triangle denotes the of the Truss as it appeted the Engineered Draw provided.	A HTS20	TJC57	TJC37	LTHJA26	▲ HGUS28-3	▲ HGUS26-2	▲ HHUS26-2	HUS26	LUS26	LUS24	HANGER SCHEDULE
pears on	0	0	7	0	0	0	0	9	0	0	Quantity
omer	Sı	ımı	Summit Homes	Hom	es						
Name	Ľ	ot 7	Lot 71 The Reserve at Stoney Creek	le R	esei	rve	at Sı	tone	y C	reek	
Site Address	1.5	1525	SW	SW Georgetown	orge	tow	'n D	ı.			
State	Ľ	Cee's	Sun	Summit				MO			
gner	ū	han(Chance Lickteig	ickt	eig		(785) 746-4240	746	5-42	40	
/2021	Jo	# q	Job # 210529)529							



Unless otherwise specified by Engineer Of Record, Wheeler Lumber, LLC recommends an uplift connection at each bearing point per the following:

of Uplift Connector 0 - 495: (1) H2.5A 495 - 990: (2) H2.5A 990 - 1245: (1) HTS20

Installation per Simpson Strong-Tie guidelines.

For Reactions greater than 1245#, refer to EOR.

Job N Job S City, Desig

HIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

Wheeler Lumber 1959 Old Hwy 50 NE Waverly, KS 66871



SUBMITTAL WAS REVIEWED FOR DESIGN CONFORMITY AND GENERAL CONFORMANCE TO CONTRACT DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSIBLE FOR CONFIRMING AND CORRELATING DIMENSIONS AT JOBSITE FOR TOLERANCE, CLEARANCE, QUANTITIES, FABRICATION, COORDINATION OF HIS OR HER WORK WITH OTHER TRADES, AND FULL COMPLIANCE WITH CONTRACT DOCUMENTS.

Wall Heights: 1st Floor = 9-1-2 U.N.O.

2nd Floor = 8-1-2 U.N.O.

Wall Heights

10-01-02


STATUS:

APPROVED

09/13/2021

REVIEWED BY: BH

ENGINEER, EVERSTEAD

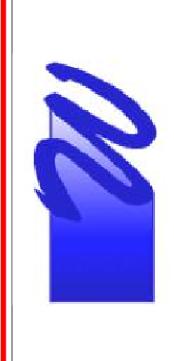

EVERSTEAD SHOP DRAWINGS/SUBMITTAL REVIEW

SUBMITTAL WAS REVIEWED FOR DESIGN CONFORMITY AND GENERAL CONFORMANCE TO CONTRACT DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSIBLE FOR CONFIRMING AND CORRELATING DIMENSIONS AT JOBSITE FOR TOLERANCE, CLEARANCE, QUANTITIES, FABRICATION, COORDINATION OF HIS OR HER WORK WITH OTHER TRADES, AND FULL COMPLIANCE WITH CONTRACT DOCUMENTS.

STATUS:


APPROVED

09/13/2021

REVIEWED BY:

BH

ENGINEER, EVERSTEAD

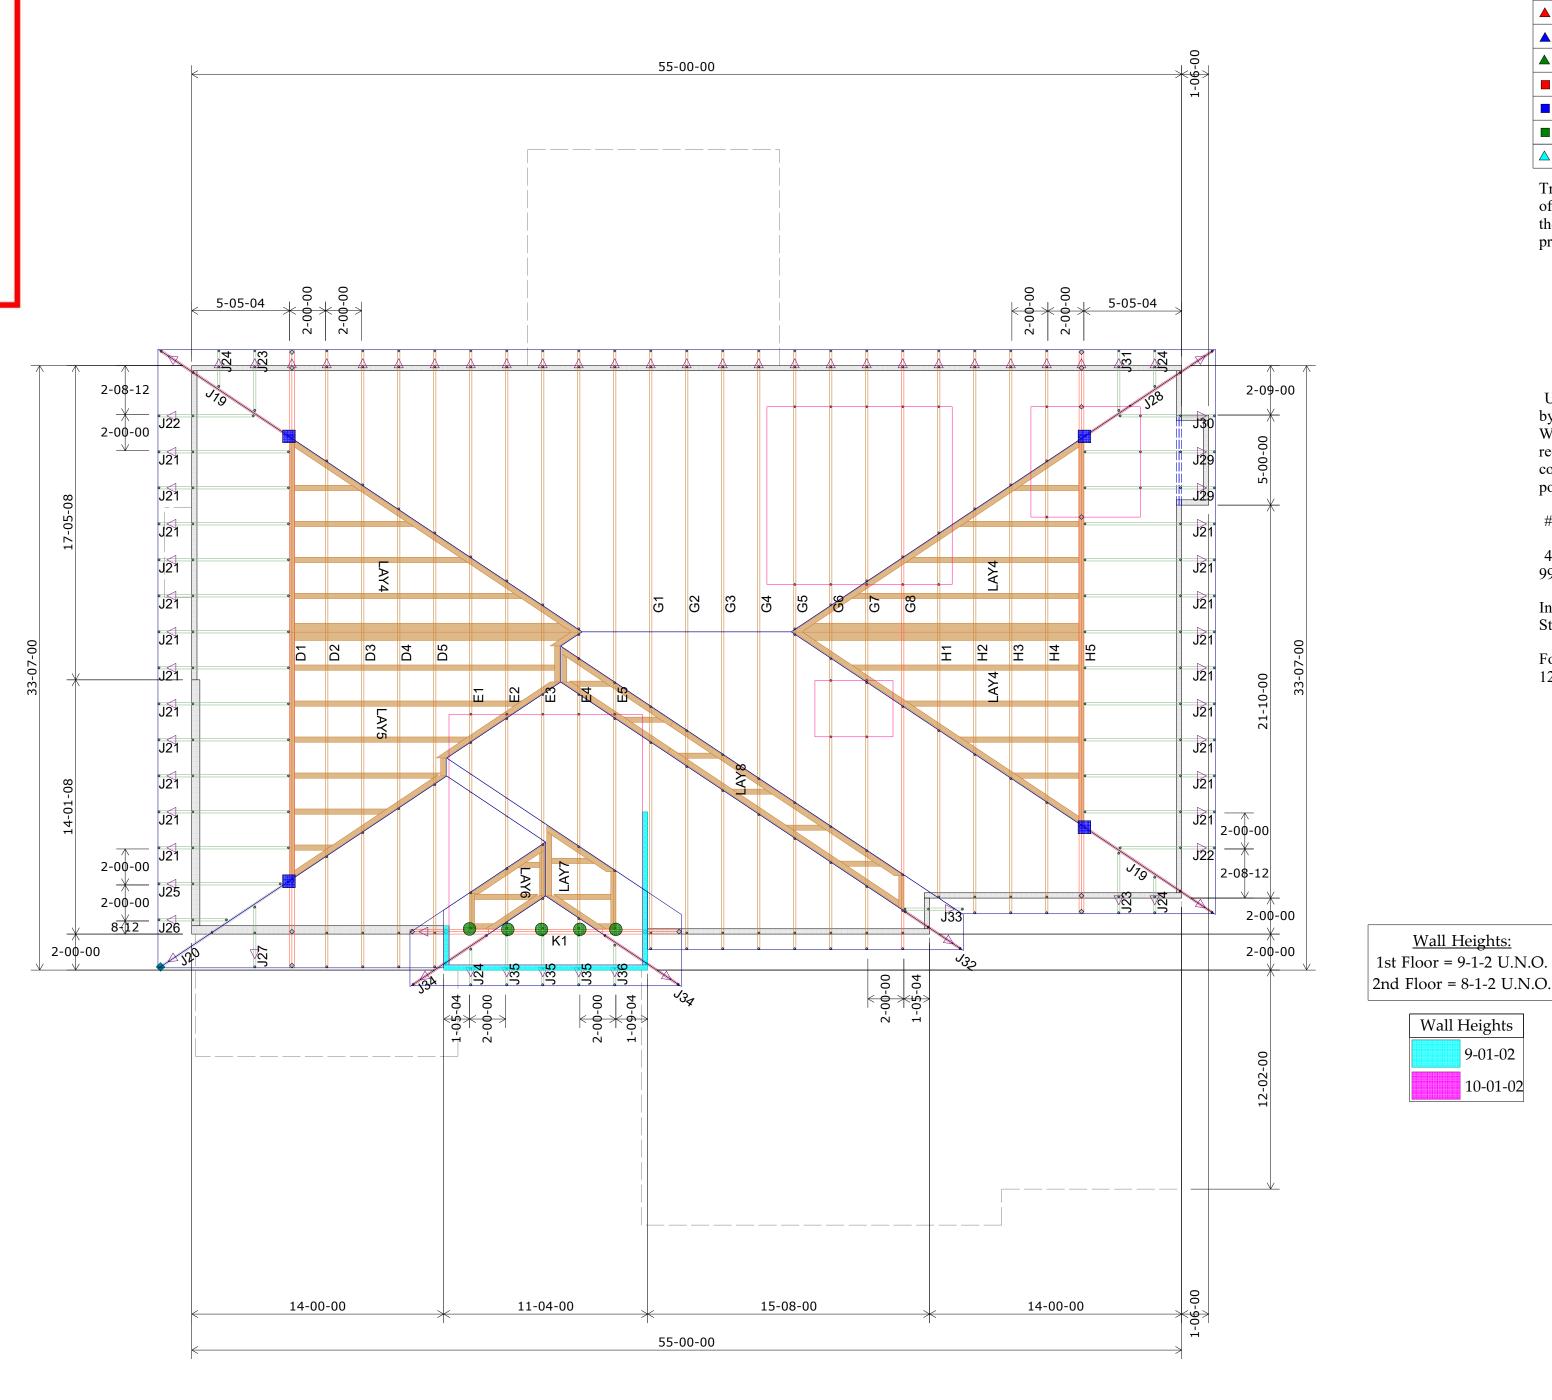

HANGER Quantity **SCHEDULE** Lot 71 The Reserve at Stoney Creek LUS24 0 LUS26 0 HUS26 9 ▲ HHUS26-2 0 ▲ HGUS26-2 0 ▲ HGUS28-3 0 LTHJA26 0 TJC37 TJC57 0 △ HTS20 0 Triangle denotes the left end State of the Truss as it appears on the Engineered Drawings Job Name provided.

Unless otherwise specified by Engineer Of Record, Wheeler Lumber, LLC recommends an uplift connection at each bearing point per the following:

of Uplift Connector 0 - 495: (1) H2.5A 495 - 990: (2) H2.5A 990 - 1245: (1) HTS20

Installation per Simpson Strong-Tie guidelines.

For Reactions greater than 1245#, refer to EOR.


Wall Heights:

Wall Heights

10-01-02

HIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

Wheeler Lumber 1959 Old Hwy 50 NE Waverly, KS 66871

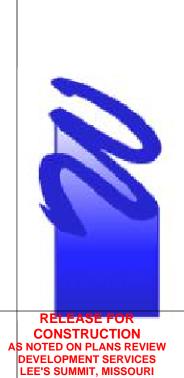

2nd Floor Truss Layout Scale: 3/16'' = 1'