



RELEASE FOR CONSTRUCTION
 AS NOTED FOR PLAN REVIEW
 DEVELOPMENT SERVICES
 LEE'S SUMMIT, MISSOURI
11/30/2021

RE: RR115
 Lot 115 RR

MiTek USA, Inc.
 16023 Swingley Ridge Rd
 Chesterfield, MO 63017
 314-434-1200

Site Information:

Customer: Project Name: RR115
 Lot/Block: Model:
 Address: Subdivision:
 City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2018/TPI2014 Design Program: MiTek 20/20 8.4
 Wind Code: ASCE 7 - 16[Low Rise] Wind Speed: 115 mph
 Roof Load: 45.0 psf Floor Load: N/A psf

This package includes 83 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	I48789097	A1	11/15/2021	21	I48789117	D5	11/15/2021
2	I48789098	A2A	11/15/2021	22	I48789118	D6	11/15/2021
3	I48789099	A3A	11/15/2021	23	I48789119	E1	11/15/2021
4	I48789100	A4	11/15/2021	24	I48789120	E2	11/15/2021
5	I48789101	A5	11/15/2021	25	I48789121	E3	11/15/2021
6	I48789102	B1	11/15/2021	26	I48789122	E4	11/15/2021
7	I48789103	B2	11/15/2021	27	I48789123	G1	11/15/2021
8	I48789104	B3	11/15/2021	28	I48789124	G2	11/15/2021
9	I48789105	B4	11/15/2021	29	I48789125	H1	11/15/2021
10	I48789106	C1	11/15/2021	30	I48789126	H2	11/15/2021
11	I48789107	C2	11/15/2021	31	I48789127	H3	11/15/2021
12	I48789108	C3	11/15/2021	32	I48789128	H4	11/15/2021
13	I48789109	C4	11/15/2021	33	I48789129	H5	11/15/2021
14	I48789110	C5	11/15/2021	34	I48789130	H6	11/15/2021
15	I48789111	C6	11/15/2021	35	I48789131	J1	11/15/2021
16	I48789112	C7	11/15/2021	36	I48789132	J2	11/15/2021
17	I48789113	D1	11/15/2021	37	I48789133	J3	11/15/2021
18	I48789114	D2	11/15/2021	38	I48789134	J4	11/15/2021
19	I48789115	D3	11/15/2021	39	I48789135	J5	11/15/2021
20	I48789116	D4	11/15/2021	40	I48789136	J6	11/15/2021

The truss drawing(s) referenced above have been prepared by MiTek USA, Inc under my direct supervision based on the parameters provided by Wheeler - Waverly.
 Truss Design Engineer's Name: Garcia, Juan
 My license renewal date for the state of Kansas is April 30, 2022.
 Kansas COA: E-943

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek. Any project specific information included is for MiTek customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.





RELEASE FOR CONSTRUCTION
 AS NOTED FOR PLAN REVIEW
 DEVELOPMENT SERVICES
 LEE'S SUMMIT, MISSOURI
11/30/2021

RE: RR115
 Lot 115 RR

MiTek USA, Inc.
 16023 Swingley Ridge Rd
 Chesterfield, MO 63017
 314-434-1200

Site Information:

Customer: Project Name: RR115
 Lot/Block: Model:
 Address: Subdivision:
 City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):


Design Code: IRC2018/TPI2014 Design Program: MiTek 20/20 8.4
 Wind Code: ASCE 7 - 16[Low Rise] Wind Speed: 115 mph
 Roof Load: 45.0 psf Floor Load: N/A psf

This package includes 83 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	I48789097	A1	11/15/2021	21	I48789117	D5	11/15/2021
2	I48789098	A2A	11/15/2021	22	I48789118	D6	11/15/2021
3	I48789099	A3A	11/15/2021	23	I48789119	E1	11/15/2021
4	I48789100	A4	11/15/2021	24	I48789120	E2	11/15/2021
5	I48789101	A5	11/15/2021	25	I48789121	E3	11/15/2021
6	I48789102	B1	11/15/2021	26	I48789122	E4	11/15/2021
7	I48789103	B2	11/15/2021	27	I48789123	G1	11/15/2021
8	I48789104	B3	11/15/2021	28	I48789124	G2	11/15/2021
9	I48789105	B4	11/15/2021	29	I48789125	H1	11/15/2021
10	I48789106	C1	11/15/2021	30	I48789126	H2	11/15/2021
11	I48789107	C2	11/15/2021	31	I48789127	H3	11/15/2021
12	I48789108	C3	11/15/2021	32	I48789128	H4	11/15/2021
13	I48789109	C4	11/15/2021	33	I48789129	H5	11/15/2021
14	I48789110	C5	11/15/2021	34	I48789130	H6	11/15/2021
15	I48789111	C6	11/15/2021	35	I48789131	J1	11/15/2021
16	I48789112	C7	11/15/2021	36	I48789132	J2	11/15/2021
17	I48789113	D1	11/15/2021	37	I48789133	J3	11/15/2021
18	I48789114	D2	11/15/2021	38	I48789134	J4	11/15/2021
19	I48789115	D3	11/15/2021	39	I48789135	J5	11/15/2021
20	I48789116	D4	11/15/2021	40	I48789136	J6	11/15/2021

The truss drawing(s) referenced above have been prepared by MiTek USA, Inc under my direct supervision based on the parameters provided by Wheeler - Waverly.
 Truss Design Engineer's Name: Garcia, Juan
 My license renewal date for the state of Missouri is December 31, 2022.
 Missouri COA: 001193

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek. Any project specific information included is for MiTek customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

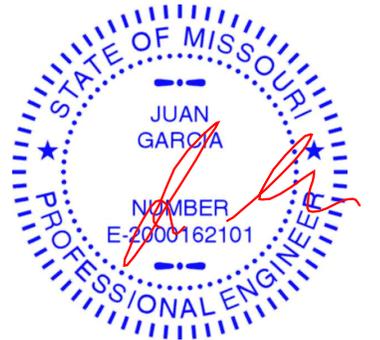



11/30/2021

RE: RR115 - Lot 115 RR

MiTek USA, Inc.
16023 Swingley Ridge Rd
Chesterfield, MO 63017
314-434-1200

Site Information:

Project Customer: Project Name: RR115

Lot/Block:

Subdivision:

Address:

City, County:

State:

No.	Seal#	Truss Name	Date
41	I48789137	J7	11/15/2021
42	I48789138	J8	11/15/2021
43	I48789139	J9	11/15/2021
44	I48789140	J10	11/15/2021
45	I48789141	J11	11/15/2021
46	I48789142	J12	11/15/2021
47	I48789143	J13	11/15/2021
48	I48789144	J14	11/15/2021
49	I48789145	J15	11/15/2021
50	I48789146	J16	11/15/2021
51	I48789147	J17	11/15/2021
52	I48789148	J18	11/15/2021
53	I48789149	J19	11/15/2021
54	I48789150	J20	11/15/2021
55	I48789151	J21	11/15/2021
56	I48789152	J22	11/15/2021
57	I48789153	J23	11/15/2021
58	I48789154	J24	11/15/2021
59	I48789155	J25	11/15/2021
60	I48789156	J26	11/15/2021
61	I48789157	J27	11/15/2021
62	I48789158	K1	11/15/2021
63	I48789159	K2	11/15/2021
64	I48789160	K3	11/15/2021
65	I48789161	K4	11/15/2021
66	I48789162	LAY1	11/15/2021
67	I48789163	LAY2	11/15/2021
68	I48789164	LAY3	11/15/2021
69	I48789165	LAY4	11/15/2021
70	I48789166	LAY5	11/15/2021
71	I48789167	LAY6	11/15/2021
72	I48789168	LAY7	11/15/2021
73	I48789169	LAY8	11/15/2021
74	I48789170	V1	11/15/2021
75	I48789171	V2	11/15/2021
76	I48789172	V3	11/15/2021
77	I48789173	V4	11/15/2021
78	I48789174	V5	11/15/2021
79	I48789175	V6	11/15/2021
80	I48789176	V7	11/15/2021
81	I48789177	V8	11/15/2021
82	I48789178	V9	11/15/2021
83	I48789179	V10	11/15/2021

Job RR115	Truss A1	Truss Type Hip Girder	Qty 1	Ply 2	Lot 115 RR Job Reference (optional)
--------------	-------------	--------------------------	----------	-----------------	--

RELEASE FOR CONSTRUCTION

AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789097
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 E Aug 16 2021 Print: 8.430 E Aug 16 2021 MiTek Industries, Inc. Mon Nov 15 10:46:21 AM 2021 Page: 2

ID:bWuMdB0tjF5cDvSpwhpH1zCzbQ-cM2kle?j2ALO?vSHXqykHvjdr4NDyKqsGA?zjlyls

11/30/2021

Vert: 4=-41 (F), 6=-41 (F), 13=-107 (F), 12=-32 (F),
5=-17 (F), 11=-107 (F), 15=-17 (F), 16=-17 (F),
17=-17 (F), 18=-17 (F), 19=-32 (F), 20=-32 (F)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job RR115	Truss A2A	Truss Type Hip	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	--------------	-------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 E Aug 16 2021 Print: 8.430 E Aug 16 2021 MiTek Industries, Inc. Mon Nov 15 10:46:41 AM Page: 1
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-zbN3v9HWtw7GeH8WqRLuAYdKTxs6V95JcktlUyysC

11/30/2021

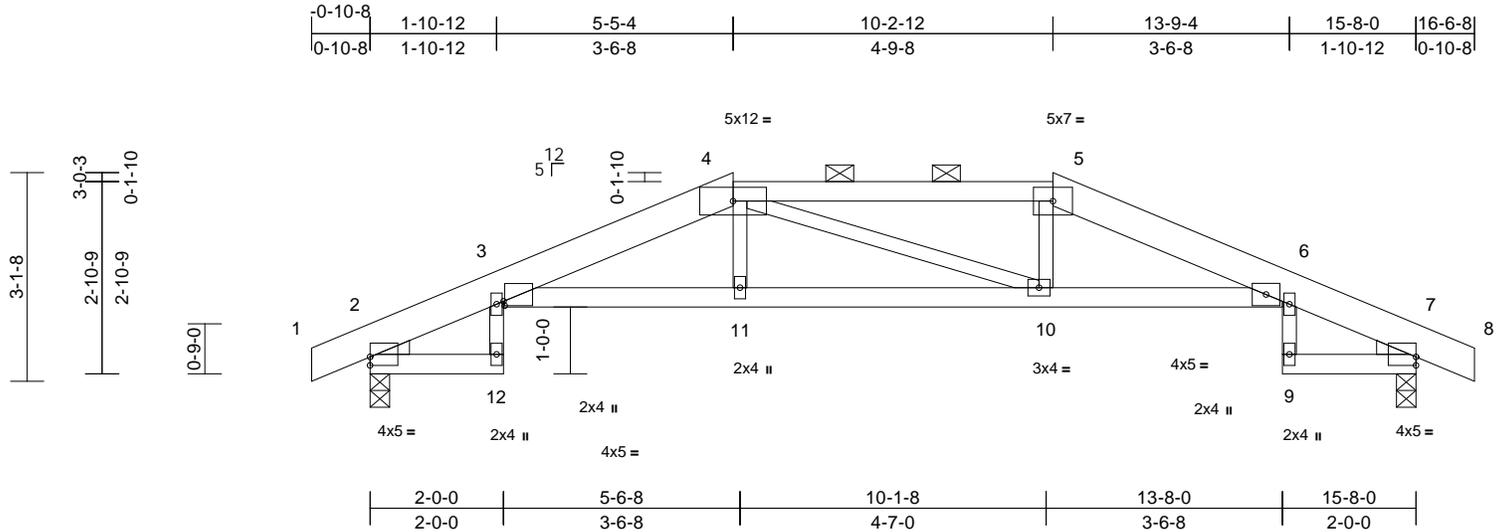

Scale = 1:34.3

Plate Offsets (X, Y): [2:Edge,0-1-8], [3:0-0-3,0-0-13], [6:0-0-7,0-0-12], [7:Edge,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.84	Vert(LL)	-0.16	6-10	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.65	Vert(CT)	-0.30	10-11	>622	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.09	Horz(CT)	0.32	7	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.10	3-11	>999	240	Weight: 56 lb	FT = 10%

LUMBER
 TOP CHORD 2x6 SPF No.2 *Except* 4-5:2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x3 SPF No.2
 WEDGE Left: 2x3 SPF No.2
 Right: 2x3 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 3-1-9 oc purlins, except 2-0-0 oc purlins (4-4-12 max.): 4-5.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 2=763/0-3-8, 7=763/0-3-8
 Max Horiz 2=-46 (LC 13)
 Max Uplift 2=-98 (LC 4), 7=-98 (LC 5)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-392/63, 3-4=-1626/184, 4-5=-1564/185, 5-6=-1626/179, 6-7=-392/57
 BOT CHORD 3-11=-124/1560, 10-11=-119/1564, 6-10=-117/1560

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 98 lb uplift at joint 2 and 98 lb uplift at joint 7.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job RR115	Truss A3A	Truss Type Hip	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	--------------	-------------------	----------	----------	--

RELEASE FOR CONSTRUCTION


AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789099
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 E Aug 16 2021 Print: 8.430 E Aug 16 2021 MiTek Industries, Inc. Mon Nov 15 10:47:21 Page: 1

ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-oloAJqmcSD9bRRCCAr3Gn_HAK3YTbs_Wqo789ylra

11/30/2021

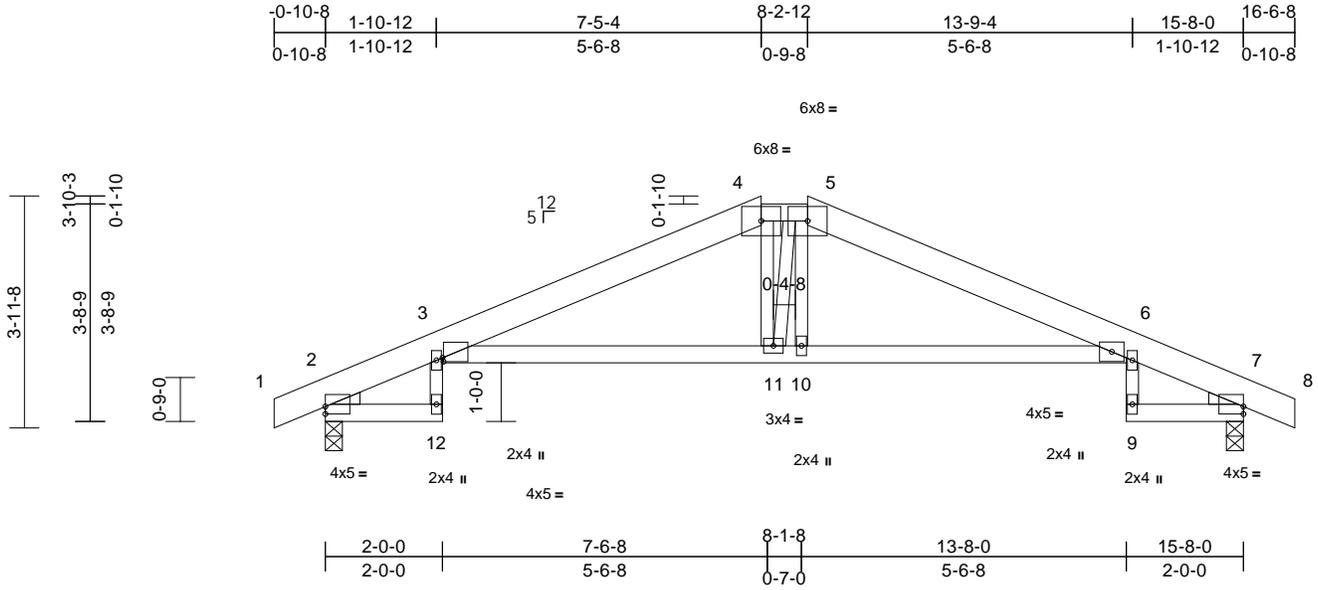

Scale = 1:39.1

Plate Offsets (X, Y): [2:Edge,0-1-8], [3:0-0-3,0-0-13], [6:0-0-7,0-0-12], [7:Edge,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.89	Vert(LL)	-0.22	3-11	>855	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.63	Vert(CT)	-0.41	3-11	>454	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.10	Horz(CT)	0.42	7	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.16	3-11	>999	240	Weight: 59 lb	FT = 10%

LUMBER
TOP CHORD 2x6 SPF No.2 *Except* 4-5:2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2
WEDGE Left: 2x3 SPF No.2
Right: 2x3 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except 2-0-0 oc purlins (4-6-12 max.): 4-5.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 2=763/0-3-8, 7=763/0-3-8
Max Horiz 2=61 (LC 12)
Max Uplift 2=-109 (LC 8), 7=-109 (LC 9)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-392/85, 3-4=-1307/115, 4-5=-1219/141, 5-6=-1313/113, 6-7=-392/67
BOT CHORD 3-11=-73/1211, 10-11=-40/1219, 6-10=-43/1217
WEBS 4-11=-113/287

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 109 lb uplift at joint 2 and 109 lb uplift at joint 7.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job RR115	Truss A4	Truss Type Common	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	----------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789100
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:21
ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7? Page: 1

11/30/2021

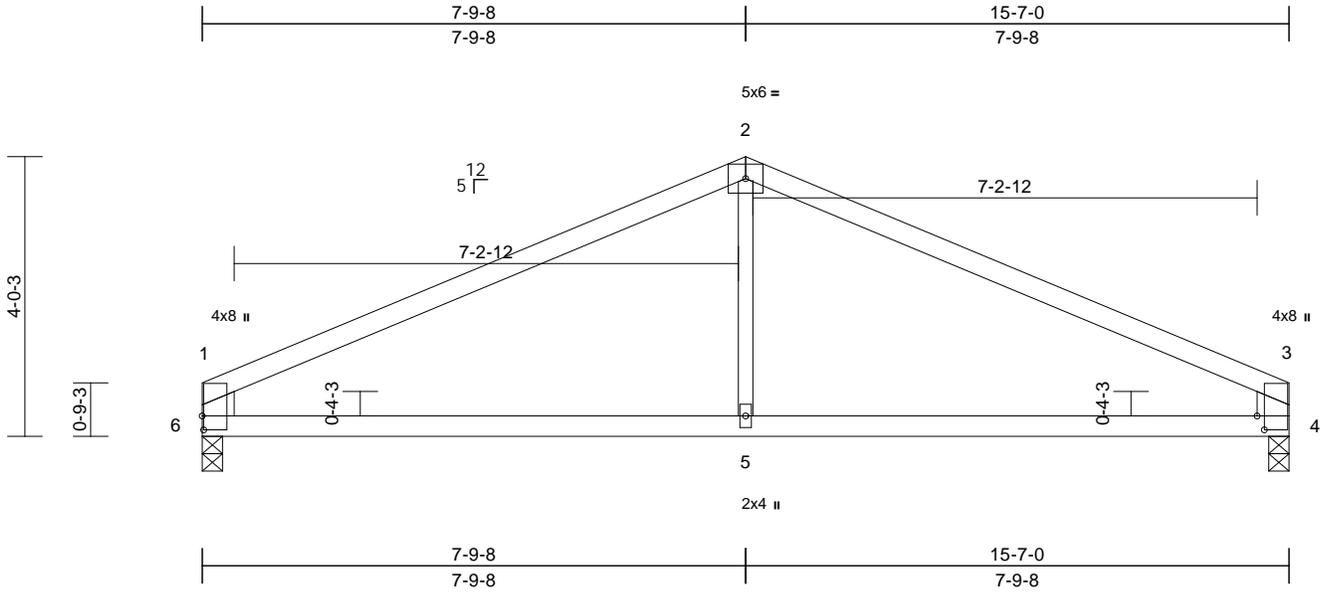

Scale = 1:32.9

Plate Offsets (X, Y): [1:0-2-6,0-0-4], [3:0-2-6,0-1-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.86	Vert(LL)	-0.07	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.42	Vert(CT)	-0.16	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.10	Horz(CT)	0.02	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.03	5-6	>999	240	Weight: 41 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x6 SPF No.2 *Except* 5-2:2x3 SPF No.2

6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING
 TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 4=681/0-3-8, 6=681/0-3-8
 Max Horiz 6=37 (LC 9)
 Max Uplift 4=-86 (LC 9), 6=-86 (LC 8)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-928/114, 2-3=-928/114, 1-6=-594/134, 3-4=-594/134
 BOT CHORD 5-6=-44/758, 4-5=-44/758
 WEBS 2-5=0/306

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 86 lb uplift at joint 6 and 86 lb uplift at joint 4.



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job RR115	Truss A5	Truss Type Roof Special	Qty 2	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	----------------------------	----------	----------	--


AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 148789101 LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 E Aug 16 2021 Print: 8.430 E Aug 16 2021 MiTek Industries, Inc. Mon Nov 15 10:47:37 AM Page: 1

ID:pjTys0MXGnbCzMzz2z1MpEyJwkK-KNmEgJyfh7AJMuQG6CL0RLxvdW2LDqxKCJurjEyYrK

11/30/2021

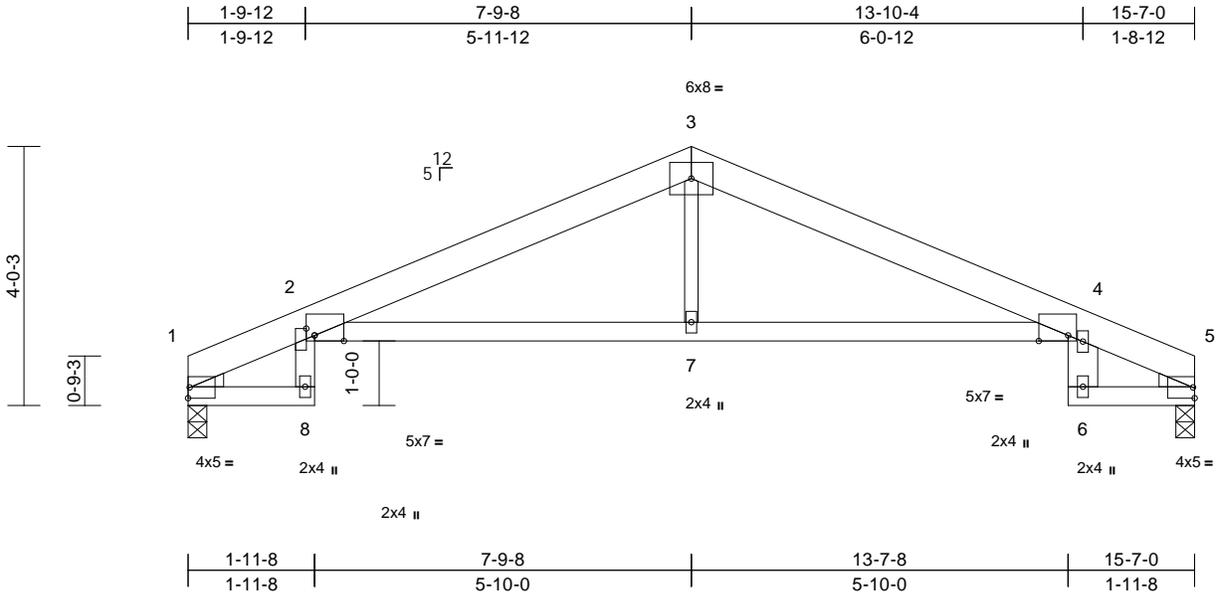

Scale = 1:35.5

Plate Offsets (X, Y): [2:0-5-7,Edge], [2:0-1-4,0-1-9], [4:0-5-7,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.89	Vert(LL)	-0.21	2-7	>882	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.62	Vert(CT)	-0.39	2-7	>472	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.09	Horz(CT)	0.40	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.16	2-7	>999	240	Weight: 54 lb	FT = 10%

LUMBER
 TOP CHORD 2x6 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2 *Except* 4-6:2x6 SPF No.2, 7-3:2x3 SPF No.2
 WEDGE Left: 2x3 SPF No.2
 Right: 2x3 SPF No.2

- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 87 lb uplift at joint 1 and 87 lb uplift at joint 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


LOAD CASE(S) Standard

BRACING
 TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 1=688/0-3-8, 5=688/0-3-8
 Max Horiz 1=-64 (LC 9)
 Max Uplift 1=-87 (LC 8), 5=-87 (LC 9)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-399/90, 2-3=-1309/115, 3-4=-1310/144, 4-5=-406/69
 BOT CHORD 2-7=-72/1210, 4-7=-72/1210
 WEBS 3-7=0/290

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.




November 15, 2021

Job RR115	Truss B1	Truss Type Half Hip Girder	Qty 1	Ply 2	Lot 115 RR Job Reference (optional)
--------------	-------------	-------------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. File Nov 12 12:30:23 Page: 1
 ID: bWuMDBN0jF5cDvSpwhP1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrCDofJ4zJC7f

11/30/2021

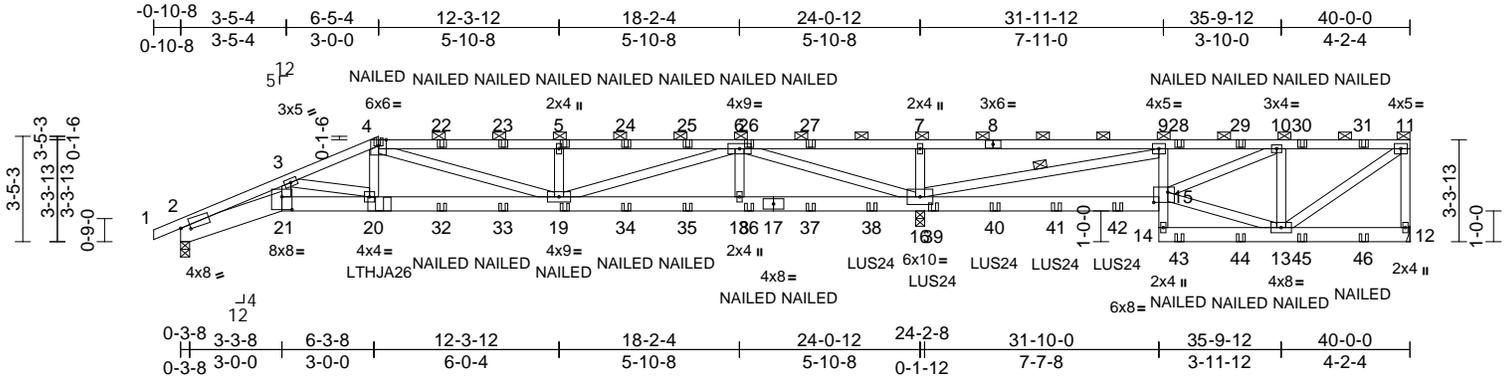

Scale = 1:74.6
 Plate Offsets (X, Y): [2:0-3-8,0-2-1], [15:0-5-8,0-4-0], [21:0-4-0,0-5-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.85	Vert(LL)	-0.20	19-20	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.45	Vert(CT)	-0.36	19-20	>803	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.83	Horz(CT)	0.13	12	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.11	19-20	>999	240	Weight: 413 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x6 SP 2400F 2.0E *Except* 2-21:2x8 SP DSS, 9-14:2x4 SPF No.2
 WEBS 2x4 SPF No.2
BRACING
 TOP CHORD Structural wood sheathing directly applied or 4-6-11 oc purlins, except end verticals, and 2-0-0 oc purlins (4-8-15 max.): 4-11.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 9-16
REACTIONS (lb/size) 2=1803/0-3-8, 12=965/ Mechanical, 16=4776/0-3-8, (req. 0-3-12)
 Max Horiz 2=99 (LC 7)
 Max Uplift 2=-102 (LC 4), 12=-86 (LC 4), 16=-313 (LC 5)
 Max Grav 2=1803 (LC 1), 12=981 (LC 20), 16=4776 (LC 1)

WEBS 3-21=-92/1271, 3-20=-673/108, 4-20=-52/1257, 4-19=0/549, 5-19=-785/174, 6-19=-191/3052, 6-18=0/271, 6-16=-5551/184, 7-16=-593/128, 9-16=-4698/388, 13-15=-89/889, 10-15=-135/527, 10-13=-774/211, 11-13=-103/1138

- NOTES**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
 Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
 Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - WARNING: Required bearing size at joint(s) 16 greater than input bearing size.
 - Refer to girder(s) for truss to truss connections.

- Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 86 lb uplift at joint 12, 102 lb uplift at joint 2 and 343 lb uplift at joint 16.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use Simpson Strong-Tie LTHJA26 (LTHJA26 on 2 ply, Left Hand Hip) or equivalent at 6-5-10 from the left end to connect truss(es) to front face of bottom chord.
- Use Simpson Strong-Tie LUS24 (LUS24 on 10d Girder, 2-10d Truss) or equivalent spaced at 2-0-0 oc max. starting at 22-6-0 from the left end to 30-6-0 to connect truss(es) to front face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.



November 15, 2021

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSITPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

Job RR115	Truss B1	Truss Type Half Hip Girder	Qty 1	Ply 2	Lot 115 RR Job Reference (optional)
--------------	-------------	-------------------------------	----------	----------	--

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
 148789102
LEE'S SUMMIT, MISSOURI

11/30/2021

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. File Nov 12 12:30:23 Page: 2
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDofJ4zJC?

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15,
Plate Increase=1.15
- Uniform Loads (lb/ft)
Vert: 1-4=-70, 4-11=-70, 2-21=-20, 15-21=-20,
12-14=-20
- Concentrated Loads (lb)
Vert: 4=-97 (F), 20=-510 (F), 19=-87 (F), 5=-97 (F),
22=-97 (F), 23=-97 (F), 24=-97 (F), 25=-97 (F),
26=-97 (F), 27=-97 (F), 28=-126 (F), 29=-126 (F),
30=-126 (F), 31=-126 (F), 32=-87 (F), 33=-87 (F),
34=-87 (F), 35=-87 (F), 36=-87 (F), 37=-87 (F),
38=-253 (F), 39=-253 (F), 40=-253 (F), 41=-253 (F),
42=-253 (F), 43=-58 (F), 44=-58 (F), 45=-58 (F),
46=-58 (F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job RR115	Truss B2	Truss Type Hip	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	-------------------	----------	----------	--


RELEASE FOR CONSTRUCTION

AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789103
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:24
ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITxb6KWrCDo7J4zJC7f

11/30/2021

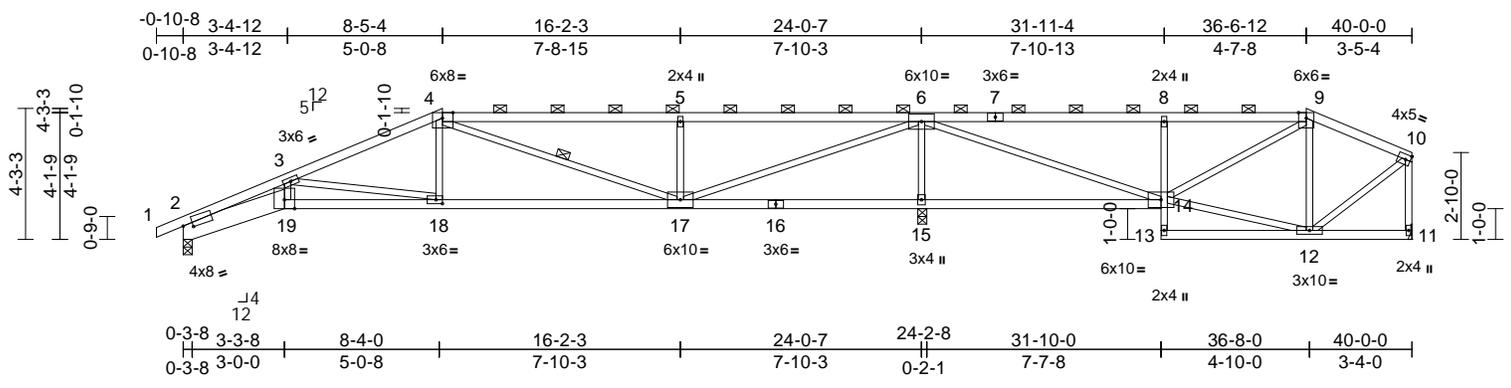

Scale = 1:74.6
Plate Offsets (X, Y): [2:0-3-8,0-2-1], [4:0-4-2,Edge], [18:0-2-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.83	Vert(LL)	-0.20	18-19	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.95	Vert(CT)	-0.38	17-18	>759	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.87	Horz(CT)	0.13	15	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.11	18-19	>999	240	Weight: 150 lb	FT = 10%


- LUMBER**
- TOP CHORD 2x4 SPF No.2
 - BOT CHORD 2x4 SPF No.2 *Except* 2-19:2x8 SP DSS, 8-13:2x3 SPF No.2
 - WEBS 2x3 SPF No.2
- BRACING**
- TOP CHORD Structural wood sheathing directly applied or 2-10-4 oc purlins, except end verticals, and 2-0-0 oc purlins (3-4-5 max.): 4-9.
 - BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
 - WEBS 1 Row at midpt 4-17
- REACTIONS** (lb/size)
- 2=984/0-3-8, 11=466/ Mechanical, 15=2199/0-3-8
 - Max Horiz 2=86 (LC 7)
 - Max Uplift 2=-21 (LC 4), 11=-11 (LC 4), 15=-100 (LC 5)
 - Max Grav 2=984 (LC 19), 11=509 (LC 20), 15=2199 (LC 1)
- FORCES** (lb) - Maximum Compression/Maximum Tension
- TOP CHORD 1-2=0/3, 2-3=-3580/80, 3-4=-1804/44, 4-5=-1218/95, 5-6=-1216/93, 6-8=-525/74, 8-9=-505/76, 9-10=-385/43, 10-11=-484/25
 - BOT CHORD 2-19=-140/3239, 18-19=-129/2963, 17-18=-59/1624, 15-17=-1176/52, 14-15=-1176/52, 13-14=0/84, 8-14=-471/113, 12-13=-20/25, 11-12=-29/22
 - WEBS 3-19=0/1012, 3-18=-1345/128, 4-18=0/422, 4-17=-438/34, 5-17=-581/137, 6-17=-113/2539, 6-15=-2008/199, 6-14=-88/1679, 12-14=0/308, 9-14=-32/208, 9-12=-221/60, 10-12=0/398

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 21 lb uplift at joint 2, 11 lb uplift at joint 11 and 100 lb uplift at joint 15.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

NOTES

- Unbalanced roof live loads have been considered for this design.



November 15, 2021


Job RR115	Truss B3	Truss Type Hip	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	-------------------	----------	----------	--

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
 148789104
LEE'S SUMMIT, MISSOURI

11/30/2021

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:24
 ID: bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITxb6KWrCDofJ4zJC7r

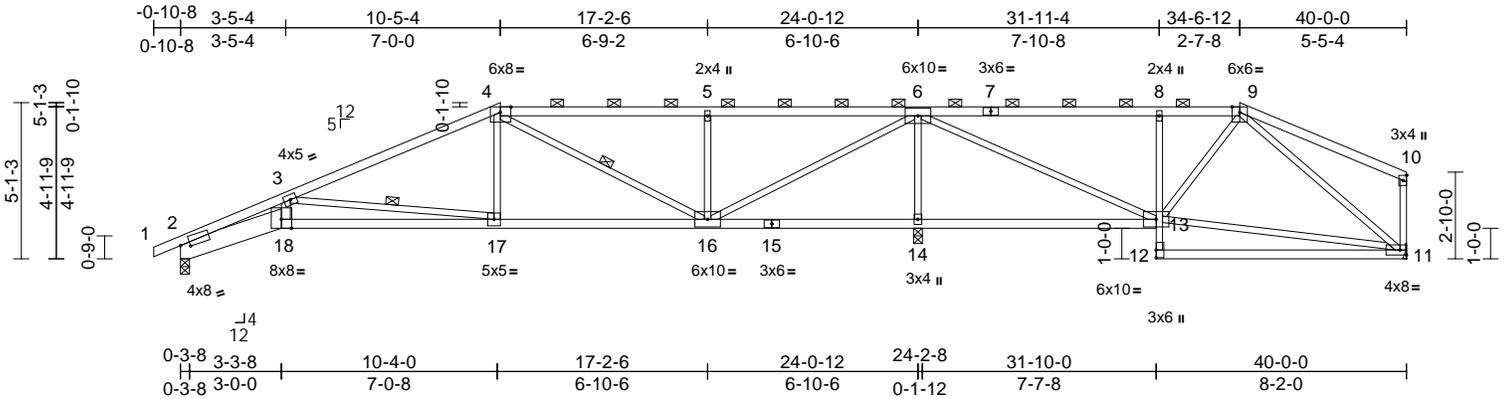

Scale = 1:74.8

Plate Offsets (X, Y): [2:0-3-8,0-2-1], [4:0-4-2,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.88	Vert(LL)	-0.23	17-18	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.96	Vert(CT)	-0.45	17-18	>632	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.83	Horz(CT)	0.15	14	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.12	17-18	>999	240	Weight: 156 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2 *Except* 2-18:2x8 SP DSS, 8-12:2x3 SPF No.2
 WEBS 2x3 SPF No.2 *Except* 18-3:2x4 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-9.
 BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
 WEBS 1 Row at midpt 3-17, 4-16

REACTIONS (lb/size)
 2=929/0-3-8, 11=379/ Mechanical, 14=2341/0-3-8, (req. 0-3-11)
 Max Horiz 2=87 (LC 7)
 Max Uplift 2=-19 (LC 8), 11=-13 (LC 9), 14=-92 (LC 5)
 Max Grav 2=931 (LC 19), 11=473 (LC 20), 14=2341 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/3, 2-3=-3575/100, 3-4=-1357/42, 4-5=-580/88, 5-6=-577/87, 6-8=-331/75, 8-9=-314/76, 9-10=-116/55, 10-11=-202/48
 BOT CHORD 2-18=-124/3261, 17-18=-125/2932, 16-17=-26/1164, 14-16=-1293/49, 13-14=-1293/49, 12-13=0/163, 8-13=-442/105, 11-12=0/69
 WEBS 3-18=0/1042, 3-17=-1771/188, 4-17=0/438, 4-16=-767/36, 5-16=-493/115, 6-16=-76/2018, 6-14=-2161/188, 6-13=-65/1565, 11-13=-39/227, 9-13=-110/49, 9-11=-333/25

NOTES
 1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 6) WARNING: Required bearing size at joint(s) 14 greater than input bearing size.
- 7) Refer to girder(s) for truss to truss connections.
- 8) Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 19 lb uplift at joint 2, 92 lb uplift at joint 14 and 13 lb uplift at joint 11.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601


MiTek
 16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job RR115	Truss B4	Truss Type Hip	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	-------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:25 Page: 1
 ID: bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITxb6KWrcDofrJ4zJC7?

11/30/2021

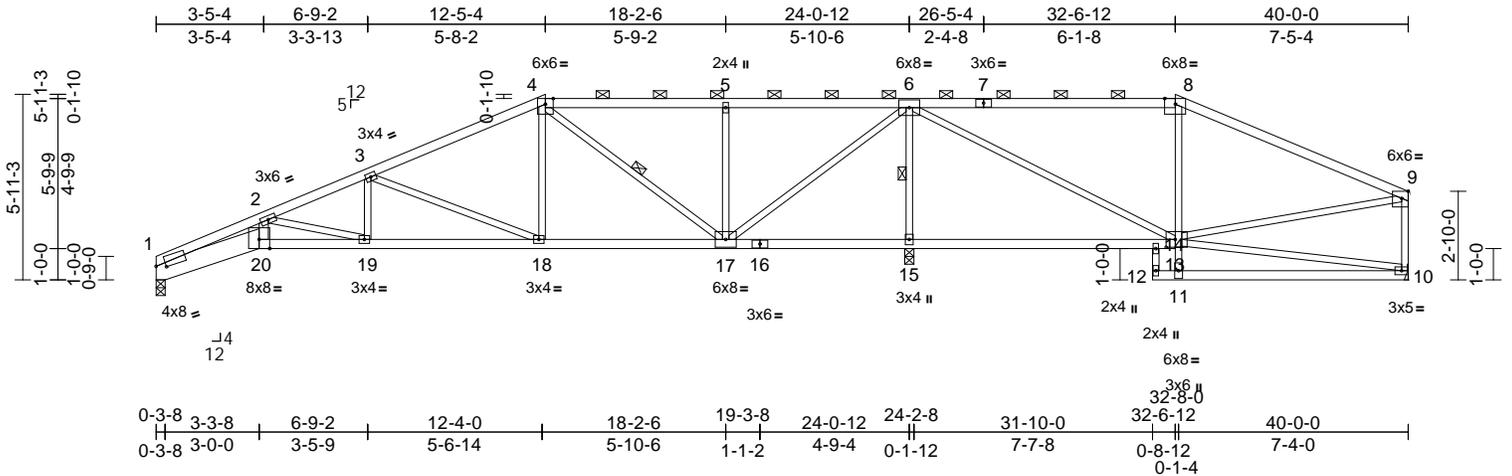

Scale = 1:73.2

Plate Offsets (X, Y): [1:0-3-8,0-2-1], [8:0-4-2,Edge], [9:0-2-8,Edge], [13:0-3-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.91	Vert(LL)	-0.15	19-20	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.87	Vert(CT)	-0.27	19-20	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.84	Horz(CT)	0.11	15	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.08	19-20	>999	240	Weight: 159 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2 *Except* 1-20:2x8 SP DSS, 14-12:2x3 SPF No.2
 WEBS 2x3 SPF No.2 *Except* 20-2:2x4 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 2-10-11 oc purlins, except end verticals, and 2-0-0 oc purlins (3-2-14 max.): 4-8.
 BOT CHORD Rigid ceiling directly applied or 5-4-12 oc bracing.

REACTIONS (lb/size) 1=849/0-3-8, 10=369/ Mechanical, 15=2360/0-3-8, (req. 0-3-11)
 Max Horiz 1=86 (LC 7)
 Max Uplift 1=-16 (LC 8), 10=-29 (LC 9), 15=-72 (LC 5)
 Max Grav 1=849 (LC 19), 10=485 (LC 20), 15=2360 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-3259/106, 2-3=-1857/57, 3-4=-989/55, 4-5=-294/87, 5-6=-292/85, 6-8=-325/67, 8-9=-441/72, 9-10=-429/64
 BOT CHORD 1-20=-133/2940, 19-20=-121/2643, 18-19=-42/1708, 17-18=-12/833, 15-17=-1087/59, 14-15=-1087/59, 13-14=-1062/88, 12-14=-343/0, 11-12=-84/0, 10-11=-26/1
 WEBS 2-20=-7/934, 2-19=-966/81, 3-18=-933/100, 4-18=0/472, 4-17=-823/35, 5-17=-384/89, 6-17=-35/1607, 6-15=-2198/157, 6-13=-6/1387, 11-13=0/544, 8-13=-492/105, 10-13=-9/60, 3-19=0/339, 9-13=-54/271

NOTES
 1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 6) WARNING: Required bearing size at joint(s) 15 greater than input bearing size.
- 7) Refer to girder(s) for truss to truss connections.
- 8) Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 16 lb uplift at joint 1, 29 lb uplift at joint 10 and 72 lb uplift at joint 15.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSITPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job RR115	Truss C1	Truss Type Hip	Qty 1	Ply 1	Lot 115 RR
--------------	-------------	-------------------	----------	----------	------------

RELEASE FOR CONSTRUCTION


AS NOTED FOR PLAN REVIEW

DEVELOPMENT SERVICES
148789106
LEE'S SUMMIT, MISSOURI

11/30/2021

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:25 Page: 1
ID: bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

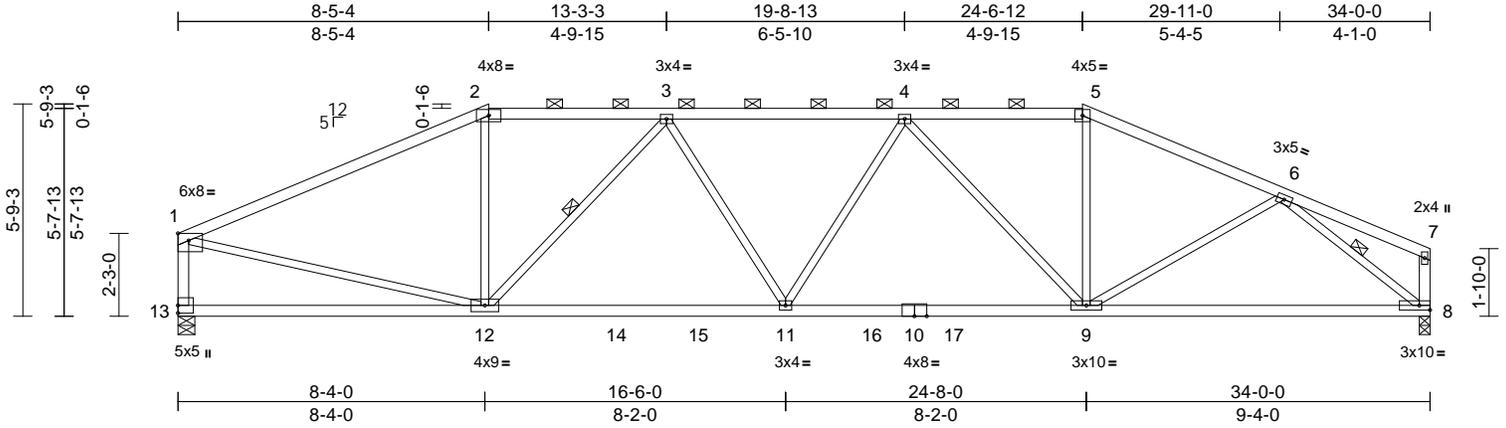


Scale = 1:62.3
Plate Offsets (X, Y): [1:Edge,0-2-5]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.89	Vert(LL)	-0.21	11-12	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.96	Vert(CT)	-0.37	11-12	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.97	Horz(CT)	0.08	8	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.11	11	>999	240	Weight: 128 lb	FT = 10%

- LUMBER**
- TOP CHORD 2x4 SPF No.2 *Except* 1-2:2x4 SPF 2100F 1.8E
 - BOT CHORD 2x4 SPF No.2 *Except* 10-8:2x4 SPF 2100F 1.8E
 - WEBS 2x3 SPF No.2 *Except* 13-1,8-7:2x4 SPF No.2
- BRACING**
- TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (3-1-15 max.): 2-5.
 - BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
 - WEBS 1 Row at midpt 3-12, 6-8
- REACTIONS**
- (lb/size) 8=1517/0-3-8, 13=1517/0-5-8
 - Max Horiz 13=71 (LC 4)
 - Max Uplift 8=178 (LC 5), 13=184 (LC 4)
 - Max Grav 8=1591 (LC 2), 13=1593 (LC 2)
- FORCES**
- (lb) - Maximum Compression/Maximum Tension
 - TOP CHORD 1-2=-2167/297, 2-3=-1911/304, 3-4=-2545/401, 4-5=-2046/318, 5-6=-2283/322, 6-7=-154/26, 1-13=-1465/226, 7-8=-138/32
 - BOT CHORD 12-13=-51/159, 11-12=-339/2418, 9-11=-349/2482, 8-9=-246/1672
 - WEBS 1-12=-202/1815, 2-12=0/529, 3-12=-837/180, 3-11=0/285, 4-11=-22/176, 4-9=-740/178, 5-9=-23/598, 6-9=0/538, 6-8=-2039/327

- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 184 lb uplift at joint 13 and 178 lb uplift at joint 8.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- LOAD CASE(S)** Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601


MiTek
16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job RR115	Truss C2	Truss Type Hip	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	-------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:26
 ID: BwUMDBN0tjF5cDvSpwhP1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uTXb6KWrcDofJ4zJC7? Page: 1

11/30/2021

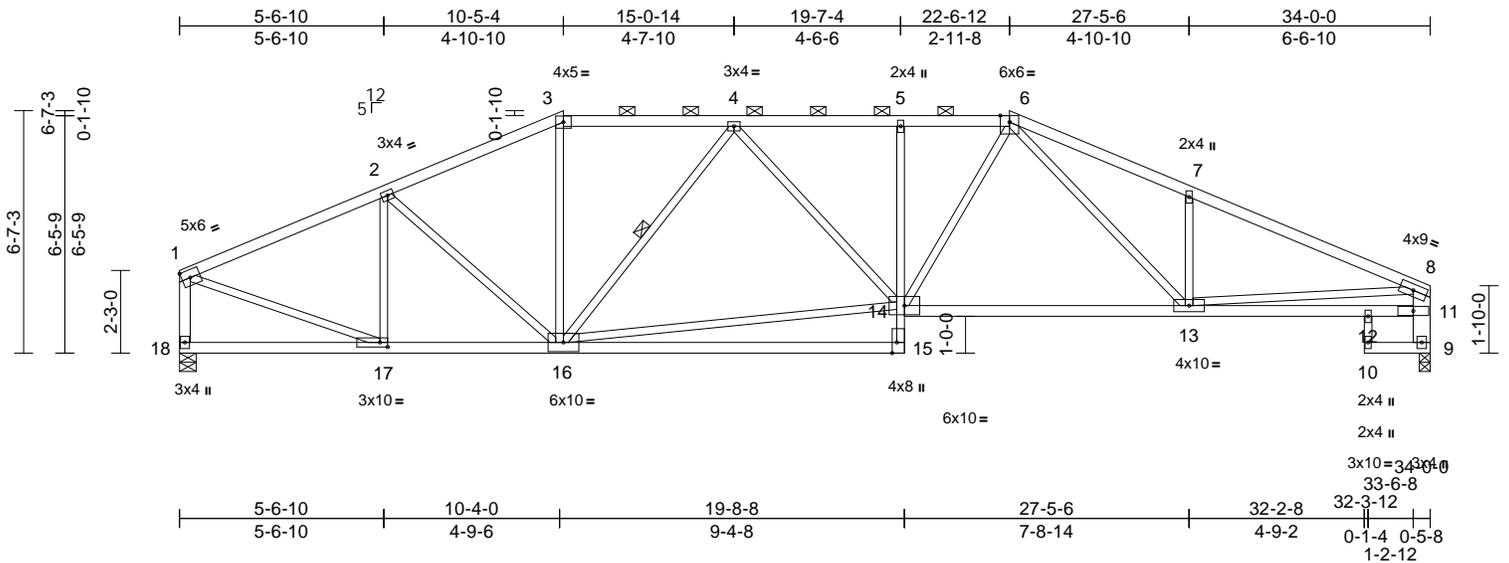

Scale = 1:62.3

Plate Offsets (X, Y): [15:0-3-8,Edge], [17:0-2-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.68	Vert(LL)	-0.25	15-16	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.76	Vert(CT)	-0.55	15-16	>738	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.72	Horz(CT)	0.10	9	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.13	13-14	>999	240	Weight: 145 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2 *Except* 15-5:2x3 SPF No.2
 WEBS 2x3 SPF No.2 *Except* 18-1:2x4 SPF No.2, 9-8:2x6 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 2-6-9 oc purlins, except end verticals, and 2-0-0 oc purlins (3-7-1 max.): 3-6.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 4-16

REACTIONS (lb/size) 9=1513/0-3-8, 18=1513/0-5-8
 Max Horiz 18=69 (LC 4)
 Max Uplift 9=154 (LC 5), 18=158 (LC 4)


FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-1860/228, 2-3=-1974/288, 3-4=-1764/282, 4-5=-2403/384, 5-6=-2418/385, 6-7=-2731/387, 7-8=-2752/313, 1-18=-1452/189, 9-11=-1448/168, 8-11=-1437/184
 BOT CHORD 17-18=-31/77, 16-17=-177/1656, 15-16=0/138, 14-15=0/172, 5-14=-309/116, 13-14=-245/2149, 12-13=-98/527, 11-12=-98/527, 9-10=0/0
 WEBS 10-12=-36/6, 2-17=-516/117, 2-16=0/295, 3-16=-16/439, 4-16=-812/183, 14-16=-286/2085, 4-14=-24/358, 8-13=-186/1945, 1-17=-190/1696, 7-13=-396/226, 6-14=-75/650, 6-13=-166/484

- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 158 lb uplift at joint 18 and 154 lb uplift at joint 9.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

NOTES

- 1) Unbalanced roof live loads have been considered for this design.



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job RR115	Truss C4	Truss Type Hip	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	-------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:27 Page: 1
 ID:BuWuMdBNOtjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

11/30/2021

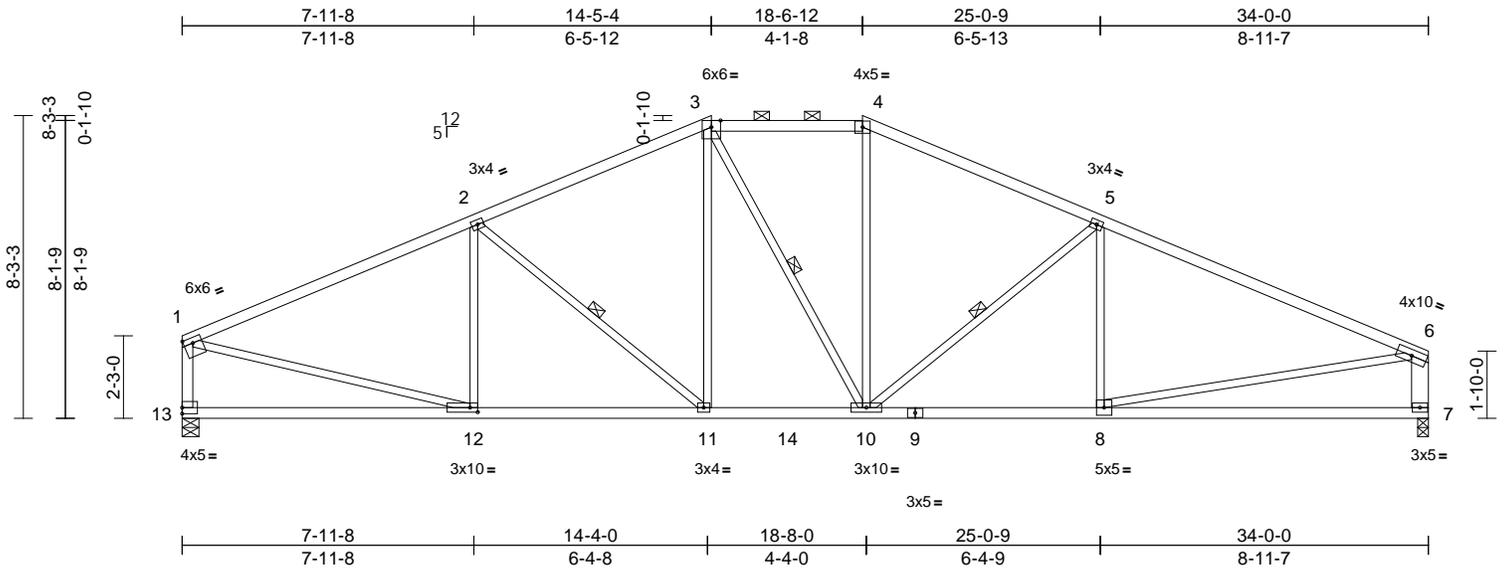

Scale = 1:62.6

Plate Offsets (X, Y): [1:0-3-0,0-1-12], [12:0-2-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.99	Vert(LL)	-0.16	7-8	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.81	Vert(CT)	-0.33	7-8	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.63	Horz(CT)	0.06	7	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.07	11-12	>999	240	Weight: 139 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2 *Except* 4-6:2x4 SPF 2100F 1.8E
 BOT CHORD 2x4 SPF No.2
 WEBS 2x3 SPF No.2 *Except* 13-1:2x4 SPF No.2, 7-6:2x6 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (4-4-15 max.): 3-4.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 3-10, 5-10, 2-11

REACTIONS (lb/size) 7=1513/0-3-8, 13=1513/0-5-8
 Max Horiz 13=65 (LC 4)
 Max Uplift 7=-179 (LC 9), 13=-171 (LC 8)
 Max Grav 7=1570 (LC 2), 13=1573 (LC 2)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-2124/231, 2-3=-1890/228, 3-4=-1685/253, 4-5=-1912/242, 5-6=-2298/258, 1-13=-1444/212, 6-7=-1426/227
 BOT CHORD 12-13=-78/161, 11-12=-199/1888, 10-11=-71/1668, 8-10=-173/2037, 7-8=-63/230
 WEBS 3-11=-53/412, 3-10=-161/229, 4-10=-30/428, 5-10=-499/199, 5-8=-162/125, 1-12=-125/1819, 6-8=-112/1838, 2-11=-357/174, 2-12=-283/129

NOTES
 1) Unbalanced roof live loads have been considered for this design.
 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60

- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 171 lb uplift at joint 13 and 179 lb uplift at joint 7.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job RR115	Truss C5	Truss Type Hip	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	-------------------	----------	----------	--

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
 148789110
LEE'S SUMMIT, MISSOURI

11/30/2021

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:27
 ID:bWuMDBN0tF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uTXb6KWrcDofJ4zJC7?

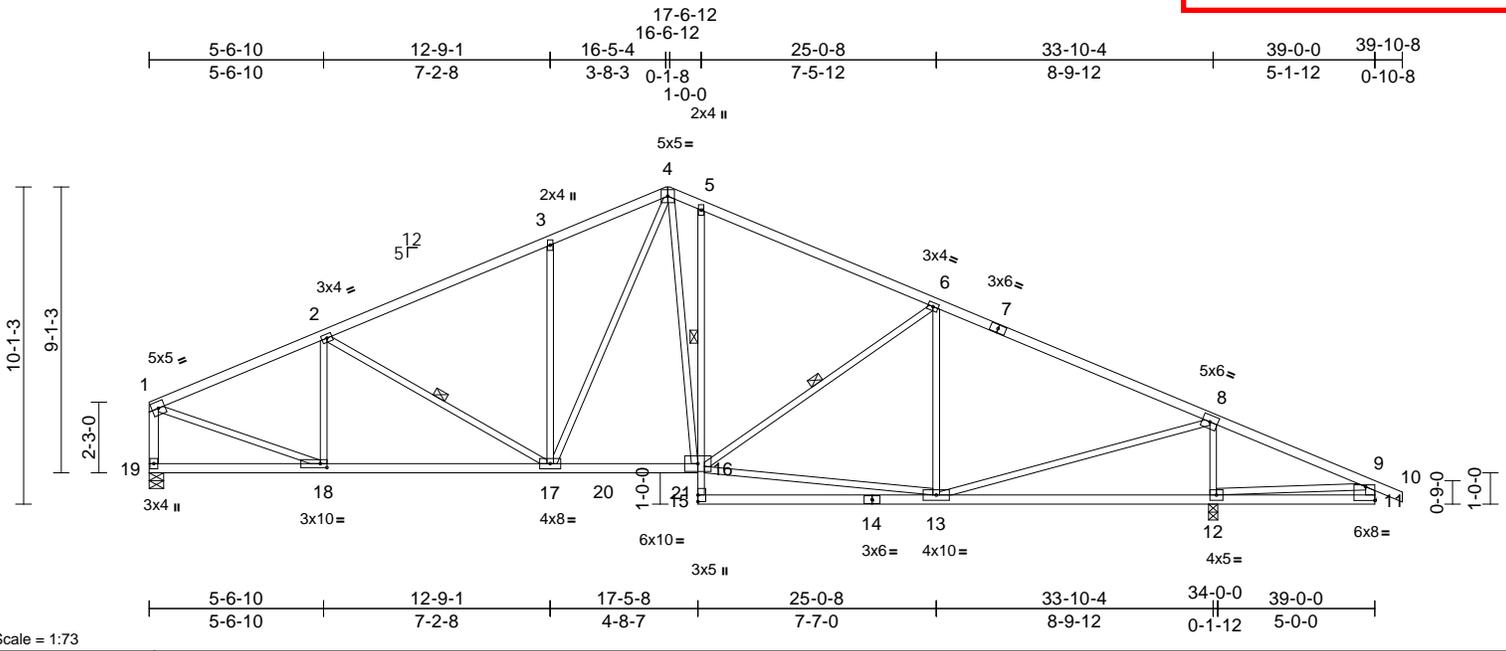


Plate Offsets (X, Y): [11:Edge,0-5-4], [18:0-2-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.82	Vert(LL)	-0.15	13-15	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.66	Vert(CT)	-0.29	13-15	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.69	Horz(CT)	0.06	12	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.07	16-17	>999	240	Weight: 169 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2 *Except* 5-15:2x3 SPF No.2
 WEBS 2x3 SPF No.2 *Except* 11-9,19-1:2x4 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 12-13,11-12.


1 Row at midpt 5-16
 WEBS 1 Row at midpt 2-17, 6-16
REACTIONS (lb/size) 12=2083/0-3-8, 19=1472/0-5-8
 Max Horiz 19=-190 (LC 9)
 Max Uplift 12=-310 (LC 9), 19=-186 (LC 8)
 Max Grav 12=2141 (LC 2), 19=1535 (LC 2)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-1901/238, 2-3=-1922/258, 3-4=-1898/361, 4-5=-1708/336, 5-6=-1744/257, 6-8=-1785/238, 8-9=-177/513, 9-10=0/27, 9-11=-29/55, 1-19=-1454/210
 BOT CHORD 18-19=-49/207, 17-18=-215/1711, 16-17=-27/1436, 15-16=0/126, 5-16=-423/222, 13-15=0/108, 12-13=-385/187, 11-12=-64/16
 WEBS 2-18=-463/150, 2-17=-137/118, 3-17=-434/224, 4-17=-221/718, 4-16=-268/778, 13-16=-49/1464, 9-12=-326/189, 1-18=-186/1771, 6-13=-568/162, 6-16=-171/164, 8-12=-1879/389, 8-13=-161/2003

NOTES
 1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 186 lb uplift at joint 19 and 310 lb uplift at joint 12.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 15, 2021

Job RR115	Truss C6	Truss Type Hip	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	-------------------	----------	----------	--


RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789111
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:28 PM Page: 1

ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

11/30/2021

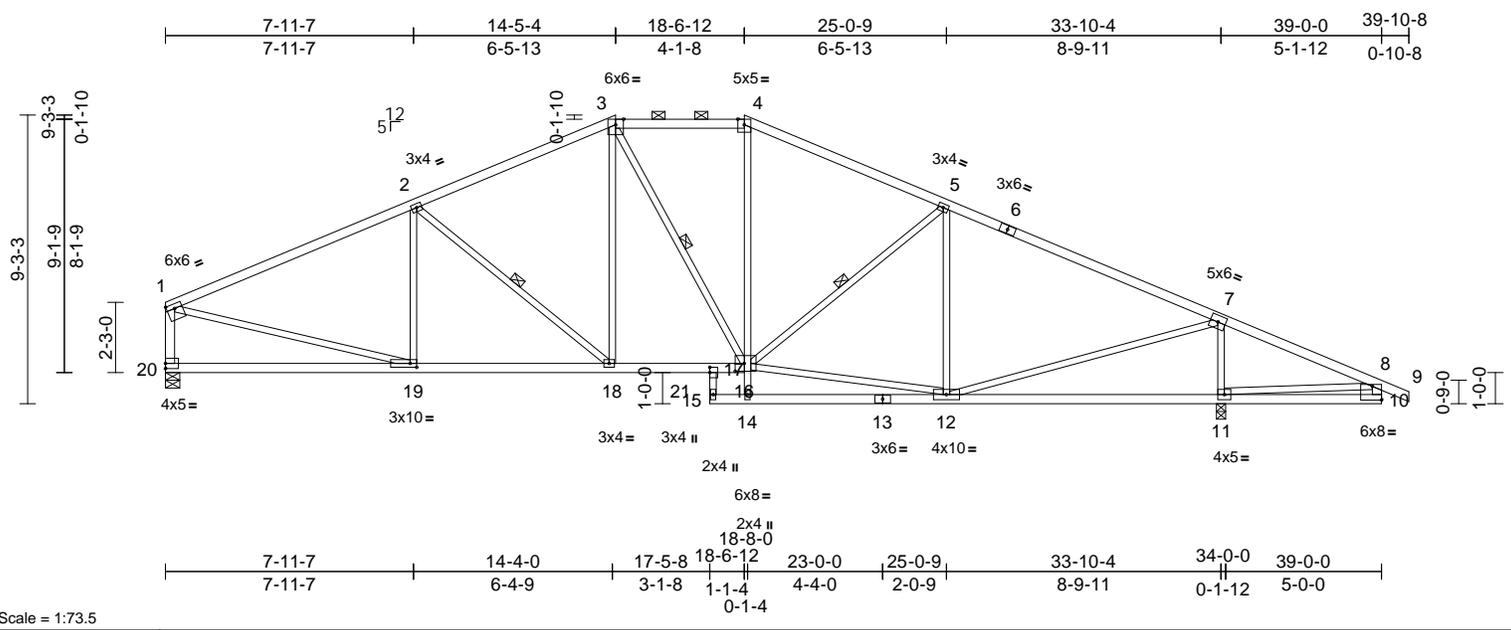

Scale = 1:73.5
Plate Offsets (X, Y): [1:0-3-0,0-1-12], [10:Edge,0-5-4], [16:0-3-8,0-3-0], [17:0-2-0,Edge], [19:0-2-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.96	Vert(LL)	-0.13	11-12	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.70	Vert(CT)	-0.28	11-12	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.69	Horz(CT)	0.05	11	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.07	17-18	>999	240	Weight: 164 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2 *Except* 17-15:2x3 SPF No.2
WEBS 2x3 SPF No.2 *Except* 10-8,20-1:2x4 SPF No.2


BRACING
TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (4-6-7 max.): 3-4.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 1 Row at midpt 3-16, 5-16, 2-18

REACTIONS (lb/size) 11=2083/0-3-8, 20=1472/0-5-8
Max Horiz 20=174 (LC 9)
Max Uplift 11=296 (LC 9), 20=171 (LC 8)
Max Grav 11=2147 (LC 2), 20=1540 (LC 2)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=2071/230, 2-3=1827/226, 3-4=1600/234, 4-5=1810/220, 5-7=1785/217, 7-8=177/507, 8-9=0/27, 8-10=30/52, 1-20=1411/211
BOT CHORD 19-20=43/240, 18-19=163/1839, 17-18=28/1609, 16-17=25/1526, 15-17=51/0, 14-15=6/94, 12-14=0/116, 11-12=379/187, 10-11=71/17
WEBS 3-18=54/430, 3-16=194/162, 14-16=0/207, 4-16=27/386, 8-11=312/188, 1-19=124/1768, 5-12=604/150, 5-16=67/187, 7-11=1877/378, 7-12=172/1994, 2-18=361/174, 2-19=271/129, 12-16=15/1461

- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 171 lb uplift at joint 20 and 296 lb uplift at joint 11.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



November 15, 2021

Job RR115	Truss C7	Truss Type Hip	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	-------------------	----------	----------	--

RELEASE FOR CONSTRUCTION


AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789112
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66671,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:29 Page: 1

ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITxb6KWrcDofJ4zJC?

11/30/2021

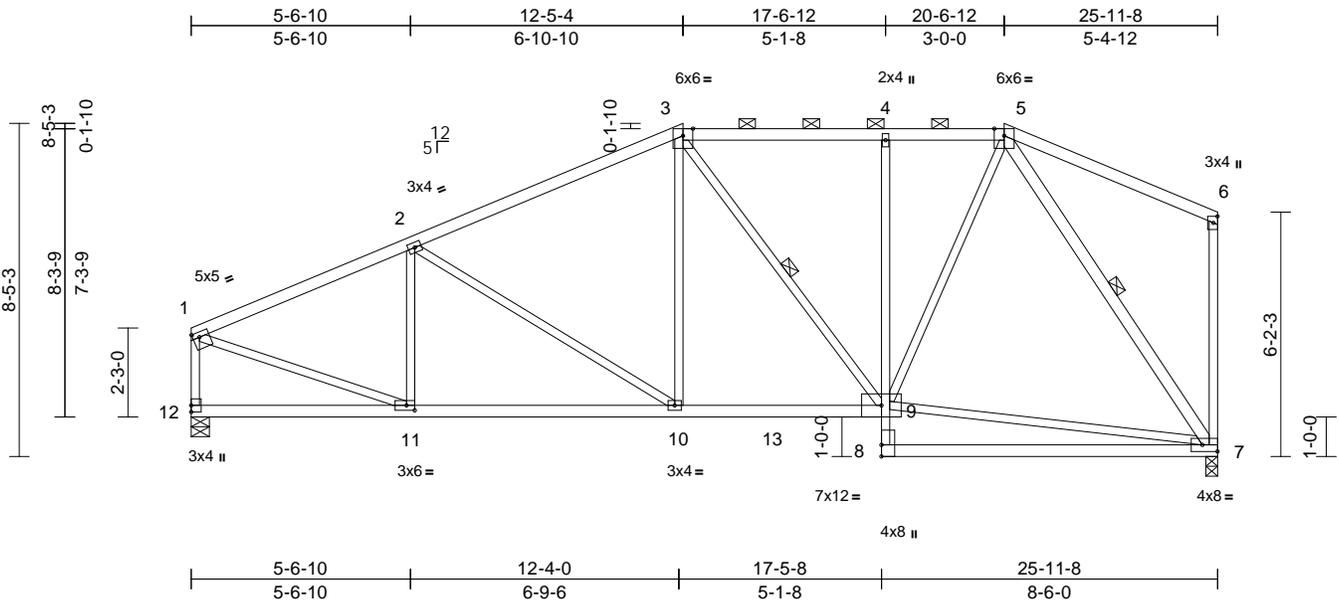

Scale = 1:58

Plate Offsets (X, Y): [1:0-2-0,0-1-8], [7:Edge,0-2-0], [11:0-2-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.55	Vert(LL)	-0.20	7-8	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.59	Vert(CT)	-0.40	7-8	>776	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.52	Horz(CT)	0.04	7	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.04	9-10	>999	240	Weight: 123 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2 *Except* 4-8:2x3 SPF No.2
WEBS 2x3 SPF No.2 *Except* 7-5:2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 4-1-3 oc purlins, except end verticals, and 2-0-0 oc purlins (5-7-3 max.): 3-5.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 3-9, 5-7


REACTIONS (lb/size) 7=1159/0-3-8, 12=1159/0-5-8
Max Horiz 12=228 (LC 7)
Max Uplift 7=140 (LC 5), 12=140 (LC 8)
Max Grav 7=1210 (LC 2), 12=1208 (LC 2)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-1458/177, 2-3=-1324/198, 3-4=-993/208, 4-5=-988/208, 5-6=-127/112, 6-7=-181/80, 1-12=-1127/164
BOT CHORD 11-12=-208/53, 10-11=-244/1303, 9-10=-206/1145, 8-9=0/175, 4-9=-336/134, 7-8=0/145
WEBS 3-10=-2/368, 3-9=-286/81, 7-9=-198/550, 5-9=-87/865, 5-7=-1177/215, 1-11=-130/1348, 2-10=-209/151, 2-11=-318/127

NOTES
1) Unbalanced roof live loads have been considered for this design.
2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
3) Provide adequate drainage to prevent water ponding.
4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 140 lb uplift at joint 12 and 140 lb uplift at joint 7.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard




November 15, 2021

Job RR115	Truss D1	Truss Type Hip	Qty 1	Ply 1	Lot 115 RR
--------------	-------------	-------------------	----------	----------	------------

RELEASE FOR CONSTRUCTION
 AS NOTED FOR PLAN REVIEW
 DEVELOPMENT SERVICES
 148789113
 LEE'S SUMMIT, MISSOURI
11/30/2021

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:29 Page: 1
 ID:bWuMDBN0tJf5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC?

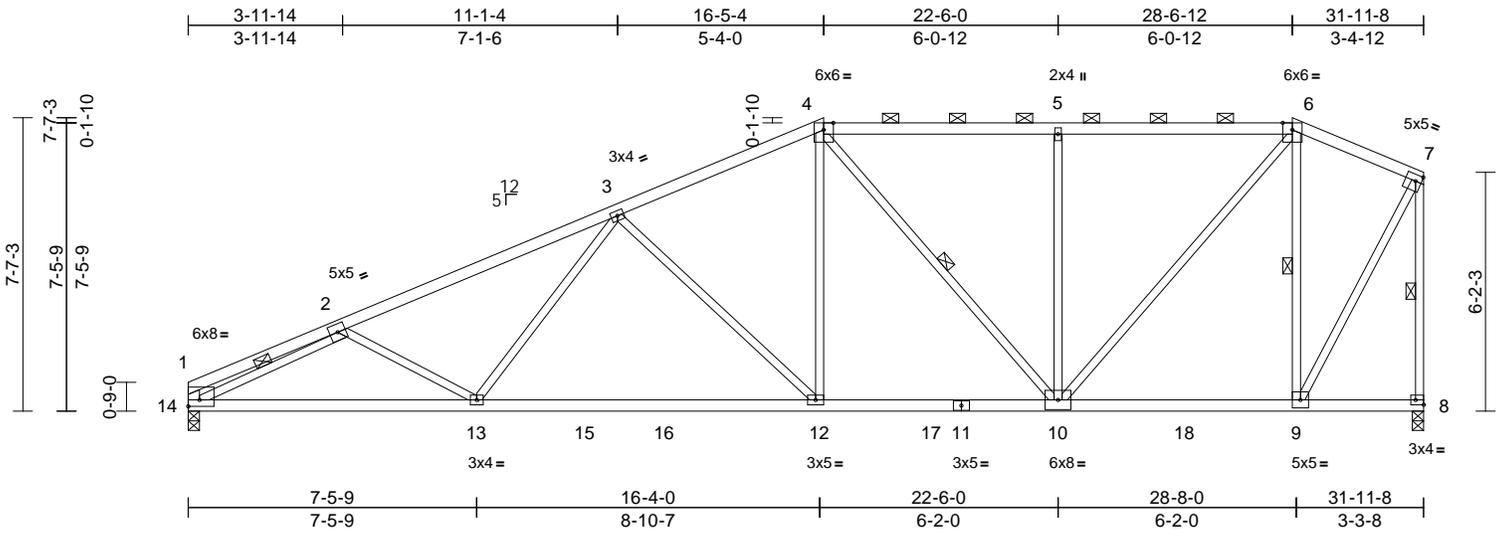

Scale = 1:59.3


Plate Offsets (X, Y): [1:Edge,0-2-0], [7:0-1-12,0-2-0], [8:Edge,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.73	Vert(LL)	-0.28	12-13	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.96	Vert(CT)	-0.49	12-13	>772	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.84	Horz(CT)	0.08	8	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.10	12-13	>999	240	Weight: 134 lb	FT = 10%

- LUMBER**
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x3 SPF No.2 *Except* 14-1:2x4 SPF No.2
- BRACING**
 TOP CHORD Structural wood sheathing directly applied or 2-4-4 oc purlins, except end verticals, and 2-0-0 oc purlins (4-5-5 max.): 4-6.
 BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
 WEBS 1 Row at midpt 4-10, 6-9, 2-14, 7-8
- REACTIONS**
 (lb/size) 8=1427/0-3-8, 14=1427/0-3-8
 Max Horiz 14=253 (LC 5)
 Max Uplift 8=197 (LC 5), 14=184 (LC 8)
 Max Grav 8=1539 (LC 2), 14=1512 (LC 2)
- FORCES**
 (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-438/23, 2-3=-2701/308, 3-4=-1941/279, 4-5=-1461/277, 5-6=-1461/277, 6-7=-710/165, 1-14=-243/34, 7-8=-1514/203
 BOT CHORD 13-14=-452/2458, 12-13=-335/2182, 10-12=-266/1724, 9-10=-141/653, 8-9=-84/63
 WEBS 2-13=-148/206, 3-13=0/414, 3-12=-640/246, 4-12=-80/763, 4-10=-422/103, 5-10=-516/208, 6-10=-186/1265, 6-9=-975/239, 7-9=-184/1343, 2-14=-2384/381

- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 184 lb uplift at joint 14 and 197 lb uplift at joint 8.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



November 15, 2021

Job RR115	Truss D2	Truss Type Hip	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	-------------------	----------	----------	--


AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789114
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:30 Page: 1

ID:bWuMDBN0tF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

11/30/2021

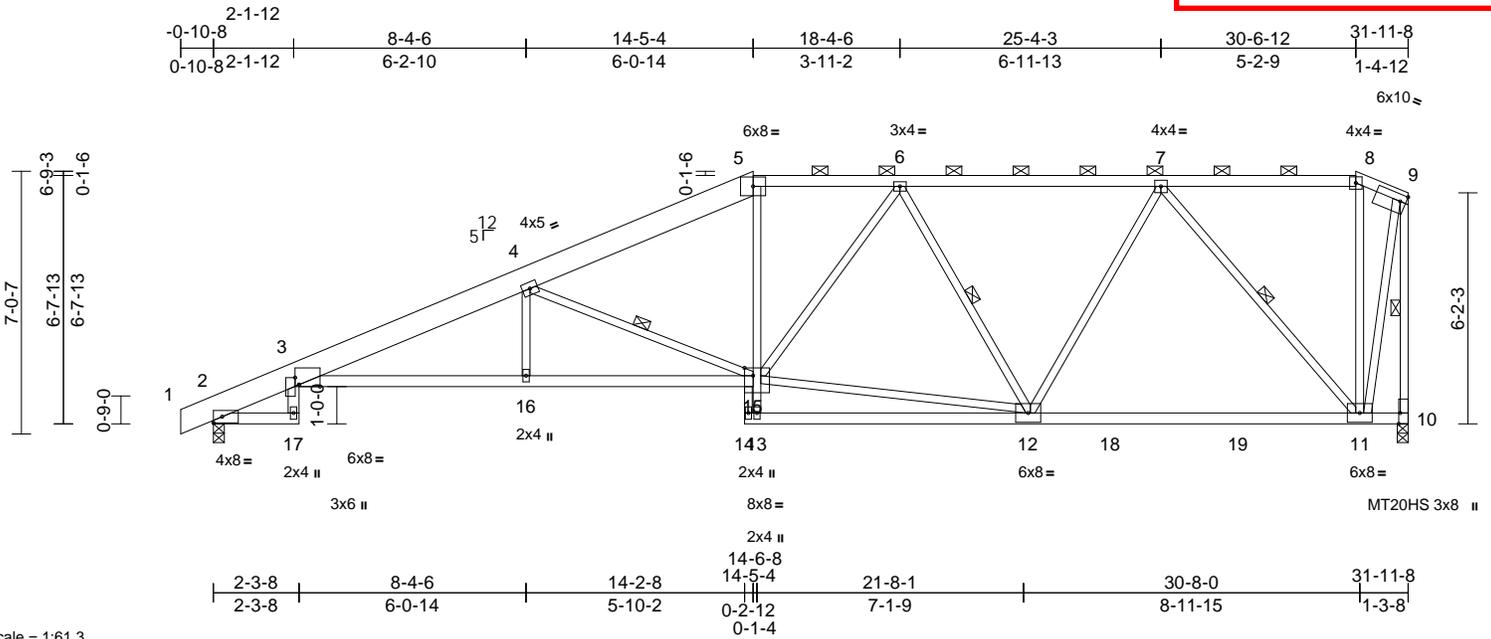

Scale = 1:61.3

Plate Offsets (X, Y): [3:0-6-12,Edge], [3:0-2-4,0-1-4], [9:Edge,0-2-4], [10:0-3-8,Edge], [15:0-2-12,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.76	Vert(LL)	-0.30	3-16	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.81	Vert(CT)	-0.54	3-16	>705	240	MT20HS	148/108
BCLL	0.0*	Rep Stress Incr	YES	WB	0.94	Horz(CT)	0.32	10	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.21	3-16	>999	240	Weight: 166 lb	FT = 10%

- LUMBER**
- TOP CHORD 2x4 SPF No.2 *Except* 1-5:2x8 SP DSS
 - BOT CHORD 2x4 SPF No.2 *Except* 3-15:2x4 SPF 2100F 1.8E
 - WEBS 2x3 SPF No.2 *Except* 17-3:2x4 SPF No.2
- BRACING**
- TOP CHORD Structural wood sheathing directly applied or 3-0-7 oc purlins, except end verticals, and 2-0-0 oc purlins (3-7-11 max.): 5-8.
 - BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 - WEBS 1 Row at midpt 4-15, 6-12, 7-11, 9-10
- REACTIONS** (lb/size)
- 2=1502/0-3-8, 10=1428/0-3-8
 - Max Horiz 2=261 (LC 5)
 - Max Uplift 2=-191 (LC 8), 10=-230 (LC 5)
 - Max Grav 2=1541 (LC 2), 10=1511 (LC 2)
- FORCES** (lb) - Maximum Compression/Maximum Tension
- TOP CHORD 1-2=0/6, 2-3=-813/47, 3-4=-3677/401, 4-5=-2488/346, 5-6=-2195/339, 6-7=-1641/279, 7-8=-325/103, 8-9=-370/112, 9-10=-1655/194
 - BOT CHORD 2-17=0/0, 3-16=-540/3513, 15-16=-538/3511, 13-14=0/0, 12-13=-2/41, 11-12=-268/1240, 10-11=-84/63
 - WEBS 3-17=0/65, 4-16=0/247, 4-15=-1439/318, 12-15=-379/1954, 6-15=-80/367, 6-12=-776/206, 7-12=-25/822, 7-11=-1453/283, 8-11=-112/115, 9-11=-177/1545, 13-15=0/124, 5-15=-55/745

- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are MT20 plates unless otherwise indicated.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 191 lb uplift at joint 2 and 230 lb uplift at joint 10.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



November 15, 2021

Job RR115	Truss D3	Truss Type Half Hip	Qty 1	Ply 1	Lot 115 RR
--------------	-------------	------------------------	----------	----------	------------


RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789115
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. File Nov 12 12:30:30 Page: 1

ID: bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

11/30/2021

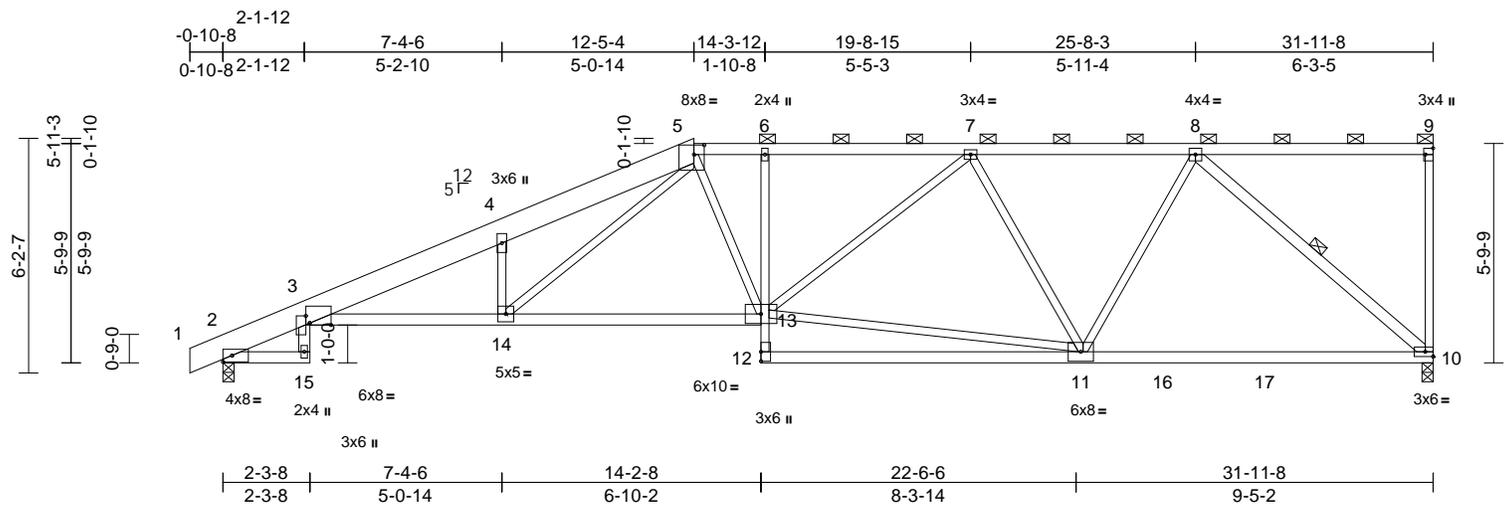

Scale = 1:60.5

Plate Offsets (X, Y): [3:0-6-12,Edge], [3:0-2-4,0-1-4], [5:0-3-4,0-3-0], [9:Edge,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.73	Vert(LL)	-0.31	13-14	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.59	Vert(CT)	-0.56	13-14	>681	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.81	Horz(CT)	0.31	10	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.20	13-14	>999	240		


LUMBER
TOP CHORD 2x8 SP DSS *Except* 5-9:2x4 SPF No.2
BOT CHORD 2x4 SPF 2100F 1.8E *Except* 2-15:2x4 SPF No.2, 6-12:2x3 SPF No.2
WEBS 2x3 SPF No.2 *Except* 15-3,10-8:2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 3-2-6 oc purlins, except end verticals, and 2-0-0 oc purlins (3-4-11 max.): 5-9.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 8-10

REACTIONS (lb/size) 2=1499/0-3-8, 10=1426/0-3-8
Max Horiz 2=243 (LC 5)
Max Uplift 2=-182 (LC 4), 10=-254 (LC 5)
Max Grav 2=1533 (LC 2), 10=1499 (LC 2)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/6, 2-3=-805/59, 3-4=-3846/444, 4-5=-4080/542, 5-6=-2592/420, 6-7=-2578/422, 7-8=-1814/310, 8-9=-83/60, 9-10=-181/79
BOT CHORD 2-15=0/0, 3-14=-603/3696, 13-14=-456/2457, 12-13=0/136, 6-13=-259/122, 11-12=-22/137, 10-11=-300/1365
WEBS 3-15=0/65, 4-14=-975/295, 5-14=-305/1644, 5-13=-63/371, 11-13=-404/2044, 7-13=-75/535, 7-11=-824/232, 8-11=-28/930, 8-10=-1805/341

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 254 lb uplift at joint 10 and 182 lb uplift at joint 2.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- LOAD CASE(S)** Standard



November 15, 2021

Job RR115	Truss D4	Truss Type Half Hip	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	------------------------	----------	----------	--


RELEASE FOR CONSTRUCTION

AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789116
LEE'S SUMMIT, MISSOURI

11/30/2021

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:31
ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITxb6KWrcDofJ4zJC7?

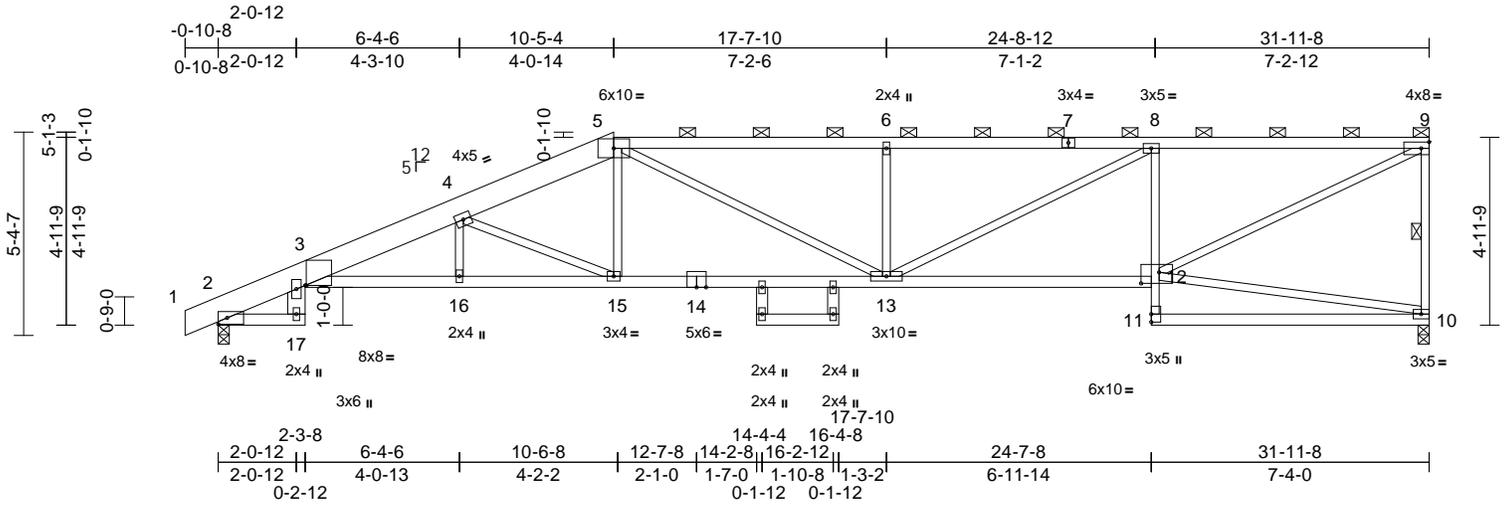

Scale = 1:60.5

Plate Offsets (X, Y): [3:0-0-5,0-0-0], [12:0-5-12,0-3-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.76	Vert(LL)	-0.30	13-15	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.77	Vert(CT)	-0.58	13-15	>659	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.88	Horz(CT)	0.35	10	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.24	13-15	>999	240	Weight: 147 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF 2100F 1.8E *Except* 1-5:2x8 SP DSS
BOT CHORD 2x4 SPF No.2 *Except* 3-14:2x4 SPF 2100F 1.8E, 8-11:2x3 SPF No.2
WEBS 2x3 SPF No.2 *Except* 17-3:2x6 SPF No.2, 18-20,19-21:2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 3-0-12 oc purlins, except end verticals, and 2-0-0 oc purlins (3-9-1 max.): 5-9.
BOT CHORD Rigid ceiling directly applied or 8-1-13 oc bracing.
WEBS 1 Row at midpt 9-10


REACTIONS (lb/size) 2=1492/0-3-8, 10=1425/0-3-8
Max Horiz 2=206 (LC 5)
Max Uplift 2=-202 (LC 4), 10=-259 (LC 5)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/6, 2-3=-719/73, 3-4=-3846/519, 4-5=-3049/472, 5-6=-3145/559, 6-8=-3145/559, 8-9=-2330/454, 9-10=-1351/305
BOT CHORD 2-17=0/20, 3-16=-672/3789, 15-16=-668/3777, 13-15=-518/2773, 12-13=-489/2341, 11-12=0/148, 8-12=-956/288, 10-11=0/62
WEBS 3-17=0/68, 4-16=-184/87, 4-15=-1123/240, 5-15=-30/595, 5-13=-117/417, 6-13=-505/212, 8-13=-133/908, 10-12=-92/40, 9-12=-504/2575

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 259 lb uplift at joint 10 and 202 lb uplift at joint 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- NOTES**
- Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job RR115	Truss D6	Truss Type Half Hip Girder	Qty 1	Ply 3	Lot 115 RR Job Reference (optional)
--------------	-------------	-------------------------------	----------	----------	--


RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789118
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 E Aug 16 2021 Print: 8.430 E Aug 16 2021 MiTek Industries, Inc. Mon Nov 15 10:48:24 Page: 1

ID: bWuMDBN0tjF5cDvSpwhP1zCzbQ-SP6?XNW7ca5eV6WIMah2rGOWS3Kk_sF?7hqs0ylyqg

11/30/2021

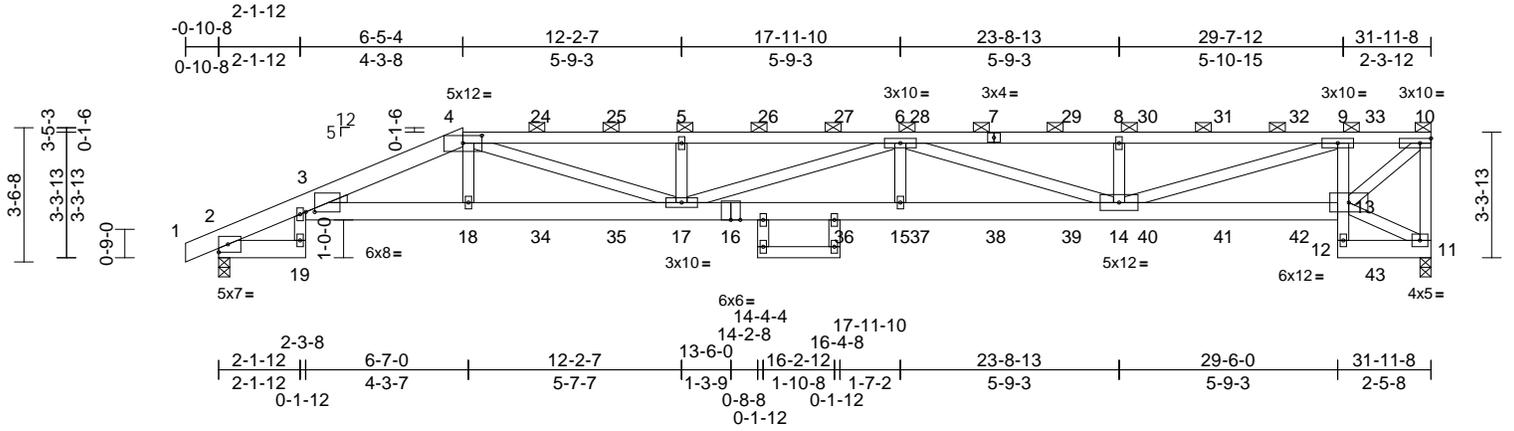

Scale = 1:60.4

Plate Offsets (X, Y): [3:0-2-13,0-0-0], [4:0-6-0,0-2-6]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.95	Vert(LL)	-0.44	15-17	>864	360
TCDL	10.0	Lumber DOL	1.15	BC	0.56	Vert(CT)	-0.79	15-17	>480	240
BCLL	0.0*	Rep Stress Incr	NO	WB	0.46	Horz(CT)	0.36	11	n/a	n/a
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.27	15-17	>999	240

Weight: 509 lb FT = 10%

- LUMBER**
- TOP CHORD 2x4 SPF No.2 *Except* 1-4:2x6 SP DSS
- BOT CHORD 2x6 SP 2400F 2.0E *Except* 9-12,20-21:2x4 SPF No.2
- WEBS 2x4 SPF No.2
- WEDGE Left: 2x3 SPF No.2
- BRACING**
- TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (5-10-15 max.): 4-10.
- BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 11-12.
- REACTIONS** (lb/size) 2=2835/0-3-8, 11=2877/0-3-8
Max Horiz 2=100 (LC 5)
Max Uplift 2=208 (LC 4), 11=175 (LC 5)
- FORCES** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
- TOP CHORD 2-3=-1819/133, 3-4=-8839/707, 4-24=-11145/735, 24-25=-11145/735, 5-25=-11146/735, 5-26=-11145/735, 26-27=-11145/735, 6-27=-11145/735, 6-28=-8912/468, 7-28=-8912/468, 7-29=-8912/468, 8-29=-8912/468, 8-30=-8912/468, 30-31=-8912/468, 31-32=-8912/468, 9-32=-8912/468, 9-33=-3319/220, 10-33=-3319/220, 10-11=-2820/200
- BOT CHORD 3-16=-732/8443, 18-34=-736/8551, 34-35=-736/8551, 17-35=-736/8551, 16-17=-699/11907, 16-36=-699/11907, 15-36=-699/11907, 15-37=-699/11907, 37-38=-699/11907, 38-39=-699/11907, 14-39=-699/11907, 14-40=-269/3614, 40-41=-268/3614, 41-42=-268/3620, 13-42=-267/3623, 9-13=-2314/211

- WEBS** 3-19=-52/712, 4-18=-51/1063, 4-17=-58/2859, 5-17=-718/192, 6-17=-868/0, 6-15=0/547, 6-14=-3161/207, 8-14=-645/153, 9-14=-249/5575, 10-13=-292/4297

- NOTES**
- 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCCL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 175 lb uplift at joint 11 and 208 lb uplift at joint 2.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 139 lb down and 43 lb up at 6-5-4, 130 lb down and 42 lb up at 8-6-0, 130 lb down and 42 lb up at 10-6-0, 130 lb down and 42 lb up at 12-6-0, 130 lb down and 42 lb up at 14-6-0, 114 lb down and 34 lb up at 16-6-0, 114 lb down and 34 lb up at 18-6-0, 114 lb down and 34 lb up at 20-6-0, 114 lb down and 34 lb up at 22-6-0, 114 lb down and 34 lb up at 24-6-0, 107 lb down and 30 lb up at 26-6-0, and 107 lb down and 30 lb up at 28-6-0, and 140 lb down and 51 lb up at 30-6-0 on top chord, and 524 lb down and 124 lb up at 6-5-4, 78 lb down at 8-6-0, 78 lb down at 10-6-0, 78 lb down at 12-6-0, 87 lb down at 16-6-0, 87 lb down at 18-6-0, 87 lb down at 20-6-0, 87 lb down at 22-6-0, 87 lb down at 24-6-0, 94 lb down and 15 lb up at 26-6-0, and 94 lb down and 15 lb up at 28-6-0, and 78 lb down at 30-6-0 on bottom chord. The design/selection of such connection device (s) is the responsibility of others.
- Filler applied to ply: 1(Front)



November 15, 2021

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job RR115	Truss D6	Truss Type Half Hip Girder	Qty 1	Ply 3	Lot 115 RR Job Reference (optional)
--------------	-------------	-------------------------------	----------	-----------------	--

RELEASE FOR CONSTRUCTION

AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789118
LEE'S SUMMIT, MISSOURI

11/30/2021

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 E Aug 16 2021 Print: 8.430 E Aug 16 2021 MiTek Industries, Inc. Mon Nov 15 10:48:24 AM
ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-SP6?XNW7ca5eV6WIMah2rGOwvS3Kk_sF?7hqs0ylyqb Page: 2

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15,
Plate Increase=1.15

Uniform Loads (lb/ft)

Vert: 1-4=-70, 4-10=-70, 2-19=-20, 3-13=-20,
11-12=-20

Concentrated Loads (lb)

Vert: 4=-116 (B), 7=-97 (B), 18=-524 (B), 17=-73 (B),
5=-116 (B), 24=-116 (B), 25=-116 (B), 26=-116 (B),
27=-97 (B), 28=-97 (B), 29=-97 (B), 30=-97 (B),
31=-91 (B), 32=-91 (B), 33=-126 (B), 34=-73 (B),
35=-73 (B), 36=-87 (B), 37=-87 (B), 38=-87 (B),
39=-87 (B), 40=-87 (B), 41=-94 (B), 42=-94 (B),
43=-58 (B)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job RR115	Truss E1	Truss Type Hip Girder	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	--------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:33
 ID: bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITxb6KWrcDofJ4zJC7f

11/30/2021

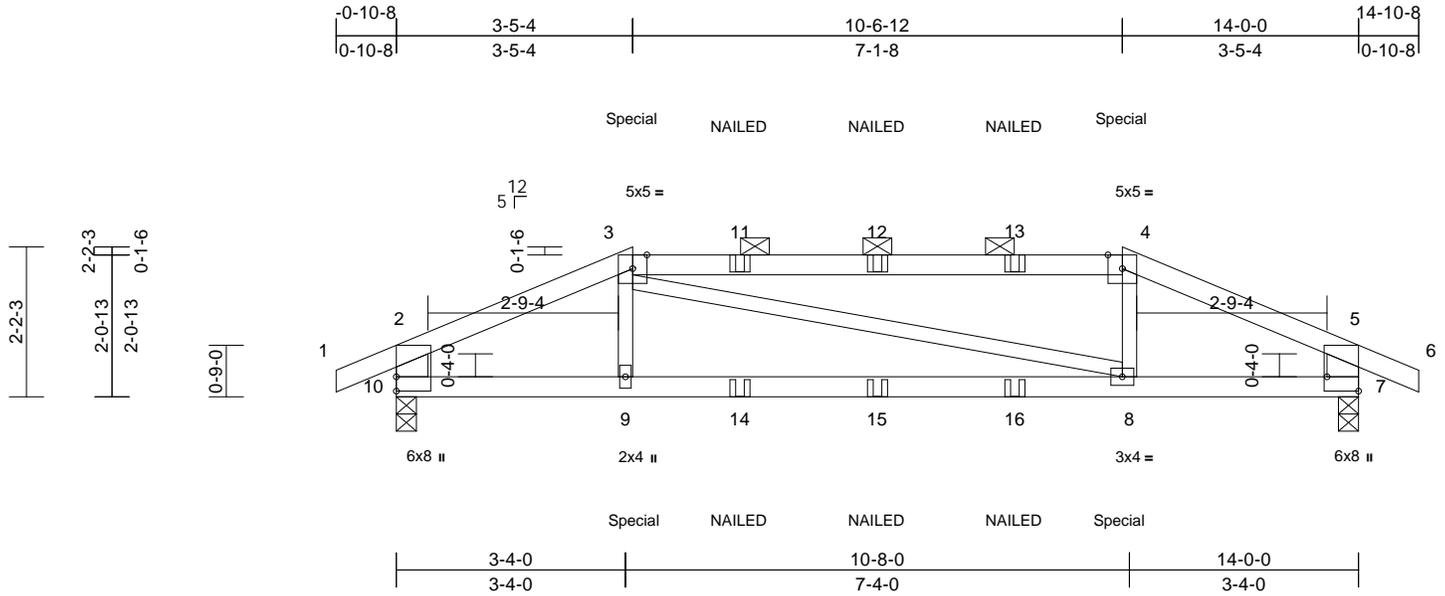

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.90	Vert(LL)	-0.15	8-9	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.90	Vert(CT)	-0.35	8-9	>471	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.09	Horz(CT)	0.03	7	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.12	8-9	>999	240	Weight: 45 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2 *Except* 3-4:2x4 SPF 2100F 1.8E
 BOT CHORD 2x4 SPF No.2
 WEBS 2x3 SPF No.2 *Except* 10-2,7-5:2x6 SP 2400F 2.0E

BRACING
 TOP CHORD Structural wood sheathing directly applied or 3-0-7 oc purlins, except end verticals, and 2-0-0 oc purlins (4-7-5 max.): 3-4.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 7=850/0-3-8, 10=850/0-3-8
 Max Horiz 10=17 (LC 7)
 Max Uplift 7=179 (LC 5), 10=178 (LC 4)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/30, 2-3=-1341/265, 3-4=-1152/260, 4-5=-1322/261, 5-6=0/30, 2-10=-743/157, 5-7=-748/158
 BOT CHORD 9-10=-212/1181, 8-9=-220/1176, 7-8=-202/1156
 WEBS 3-9=0/269, 3-8=-46/21, 4-8=0/279

- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 178 lb uplift at joint 10 and 179 lb uplift at joint 7.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 9) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 10) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 163 lb down and 122 lb up at 3-5-4, and 163 lb down and 122 lb up at 10-6-12 on top chord, and 55 lb down at 3-5-4, and 55 lb down at 10-6-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - 11) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 1-2=-70, 2-3=-70, 3-4=-70, 4-5=-70, 5-6=-70, 7-10=-20
 Concentrated Loads (lb)
 Vert: 3=-61 (F), 4=-61 (F), 9=-36 (F), 8=-36 (F), 11=-28 (F), 12=-28 (F), 13=-28 (F), 14=-16 (F), 15=-16 (F), 16=-16 (F)



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSITPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job RR115	Truss E2	Truss Type Hip	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	-------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789120
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:34
ID:bWuMDBN0tjF5cDvSpwh1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDofJ4zJC7? Page: 1

11/30/2021

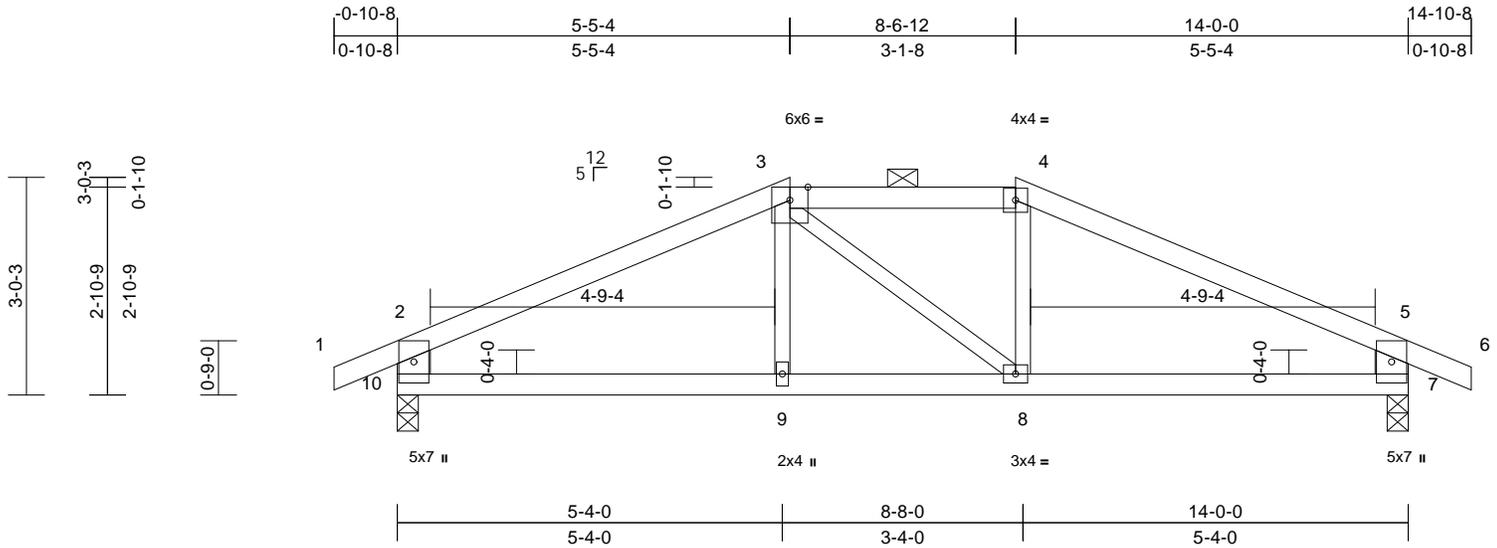

Scale = 1:31.8

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.58	Vert(LL)	-0.05	8-9	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.37	Vert(CT)	-0.10	8-9	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.05	Horz(CT)	0.02	7	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.03	8-9	>999	240	Weight: 44 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except* 10-2,7-5:2x6 SPF No.2

- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

BRACING
TOP CHORD Structural wood sheathing directly applied or 5-4-12 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

LOAD CASE(S) Standard

REACTIONS (lb/size) 7=687/0-3-8, 10=687/0-3-8
Max Horiz 10=27 (LC 8)
Max Uplift 7=-90 (LC 9), 10=-90 (LC 8)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/30, 2-3=-877/96, 3-4=-727/108, 4-5=-877/96, 5-6=0/30, 2-10=-612/128, 5-7=-612/128
BOT CHORD 9-10=-32/729, 8-9=-34/727, 7-8=-34/729
WEBS 3-9=0/152, 3-8=-107/107, 4-8=0/152

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 90 lb uplift at joint 10 and 90 lb uplift at joint 7.



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job RR115	Truss E3	Truss Type Common	Qty 3	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	----------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:34
 ID:bWuMDBN0tjF5cDvSpwhP1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDofJ4zJC7? Page: 1

11/30/2021

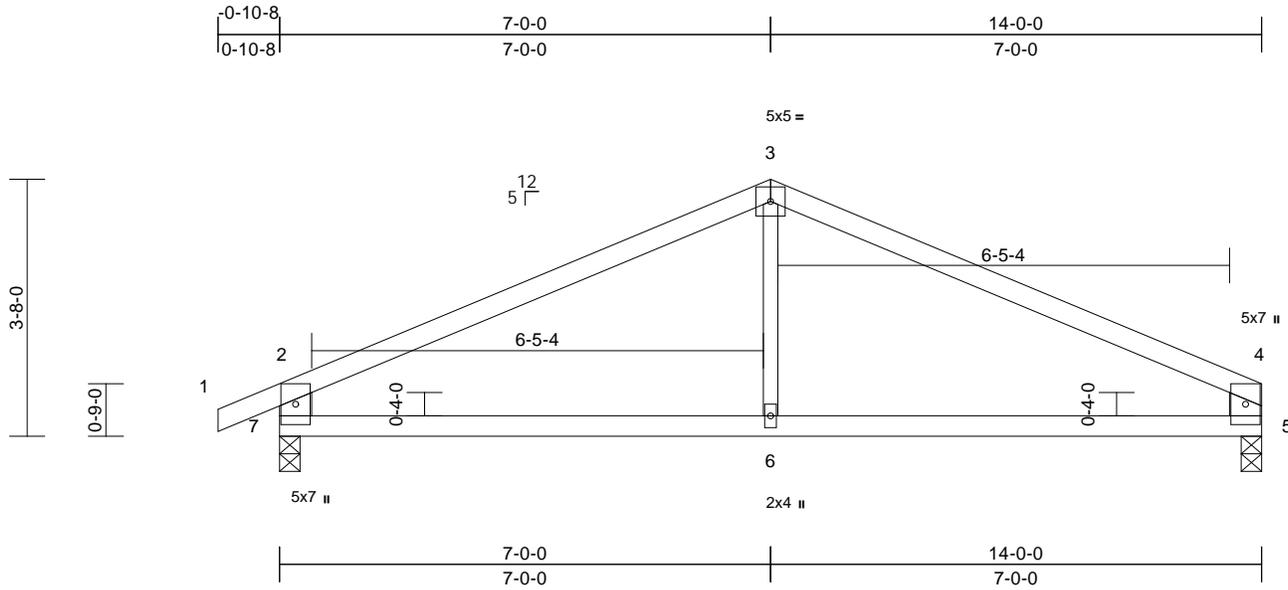

Scale = 1:32.7

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.65	Vert(LL)	-0.05	6-7	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.36	Vert(CT)	-0.11	6-7	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.09	Horz(CT)	0.01	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.03	6-7	>999	240	Weight: 38 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x6 SPF No.2 *Except* 6-3:2x3 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-0-8 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(lb/size) 5=606/0-3-8, 7=690/0-3-8
 Max Horiz 7=47 (LC 8)
 Max Uplift 5=-77 (LC 9), 7=-103 (LC 8)


FORCES

(lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/30, 2-3=-820/104, 3-4=-815/102, 2-7=-620/149, 4-5=-529/120
 BOT CHORD 6-7=-38/662, 5-6=-38/662
 WEBS 3-6=0/276

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 103 lb uplift at joint 7 and 77 lb uplift at joint 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job RR115	Truss E4	Truss Type Common Girder	Qty 1	Ply 2	Lot 115 RR Job Reference (optional)
--------------	-------------	-----------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:35
 ID: bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7? Page: 1

11/30/2021

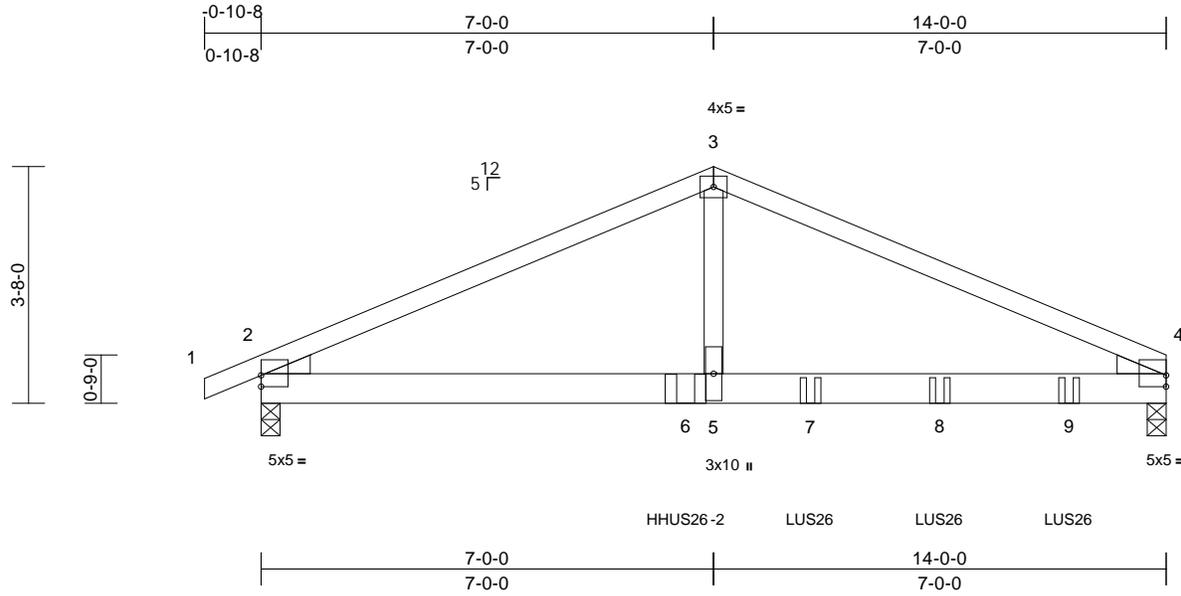

Scale = 1:35.5

Plate Offsets (X, Y): [2:Edge,0-2-2], [4:Edge,0-2-2]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.68	Vert(LL)	-0.08	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.39	Vert(CT)	-0.13	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.25	Horz(CT)	0.01	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.04	4-5	>999	240	Weight: 113 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x6 SP 2400F 2.0E
 WEBS 2x4 SPF No.2
 WEDGE Left: 2x4 SP No.3
 Right: 2x4 SP No.3

BRACING
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 2=1549/0-3-8, 4=2123/0-3-8
 Max Horiz 2=58 (LC 12)
 Max Uplift 2=-173 (LC 8), 4=-193 (LC 9)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/0, 2-3=-3025/274, 3-4=-3013/272
 BOT CHORD 2-5=-193/2630, 4-5=-193/2630
 WEBS 3-5=-79/2037

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 193 lb uplift at joint 4 and 173 lb uplift at joint 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Use Simpson Strong-Tie HHUS26-2 (14-10d Girder, 4-10d Truss) or equivalent at 6-6-13 from the left end to connect truss(es) to back face of bottom chord.
- Use Simpson Strong-Tie LUS26 (4-10d Girder, 3-10d Truss) or equivalent spaced at 2-0-0 oc max. starting at 8-6-0 from the left end to 12-6-0 to connect truss(es) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 1-3=-70, 3-4=-70, 2-4=-20
 Concentrated Loads (lb)
 Vert: 6=-961 (B), 7=-489 (B), 8=-453 (B), 9=-465 (B)

- NOTES**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601





Job RR115	Truss G1	Truss Type Hip Girder	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	--------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:35
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uTXb6KWrcDofJ4zJC7? Page: 1

11/30/2021

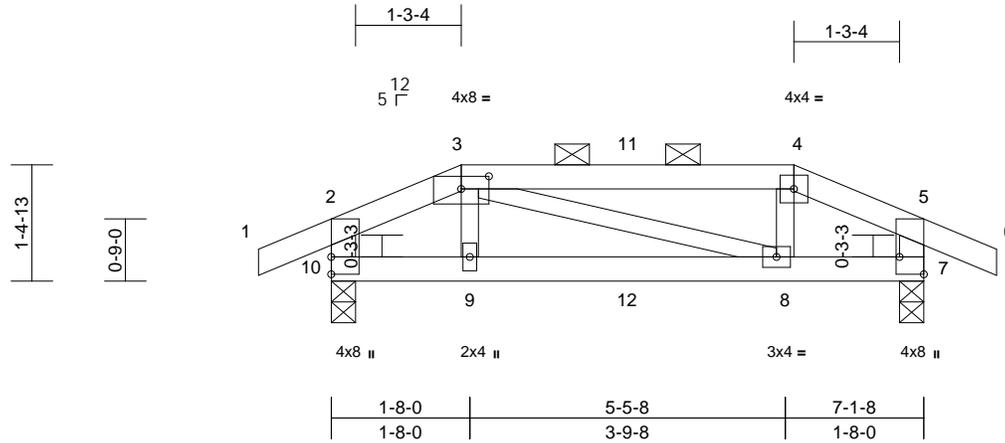

Scale = 1:27.6

Plate Offsets (X, Y): [3:0-4-0,0-1-13], [7:Edge,0-3-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.27	Vert(LL)	-0.02	8-9	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.22	Vert(CT)	-0.03	8-9	>999	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.03	Horz(CT)	0.00	7	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.01	8-9	>999	240	Weight: 24 lb	FT = 10%

- LUMBER**
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x3 SPF No.2 *Except* 10-2,7-5:2x4 SPF No.2
- BRACING**
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
- REACTIONS** (lb/size) 7=375/0-3-8, 10=375/0-3-8
 Max Horiz 10=17 (LC 7)
 Max Uplift 7=100 (LC 5), 10=100 (LC 4)
- FORCES** (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/27, 2-3=-367/95, 3-4=-298/88, 4-5=-367/94, 5-6=0/27, 2-10=-307/86, 5-7=-307/85
 BOT CHORD 9-10=-64/299, 8-9=-62/298, 7-8=-57/299
 WEBS 3-9=-30/89, 3-8=-8/8, 4-8=-32/89


- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint 10 and 100 lb uplift at joint 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 57 lb down and 62 lb up at 1-6-12, and 49 lb down and 22 lb up at 3-6-12, and 57 lb down and 62 lb up at 5-6-12 on top chord, and 6 lb down and 37 lb up at 1-6-12, and 3 lb down and 3 lb up at 3-6-12, and 6 lb down and 37 lb up at 5-6-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 1-2=-70, 2-3=-70, 3-4=-70, 4-5=-70, 5-6=-70, 7-10=-20
 Concentrated Loads (lb)
 Vert: 9=3 (F), 8=3 (F), 12=3 (F)

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job RR115	Truss G2	Truss Type Common	Qty 2	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	----------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:36
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uTXb6KWrcDofJ4zJC7? Page: 1

11/30/2021

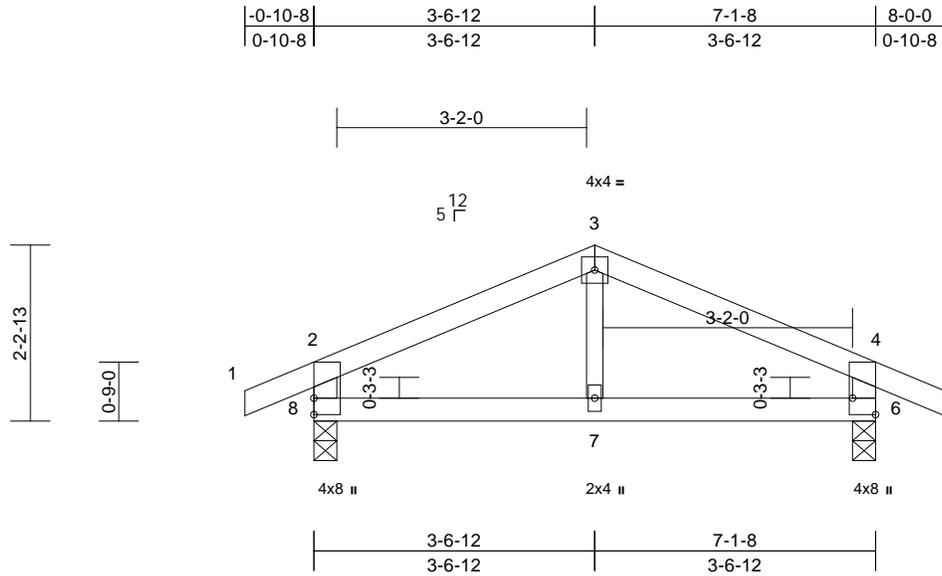

Scale = 1:29.1

Plate Offsets (X, Y): [6:Edge,0-3-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.21	Vert(LL)	-0.01	7	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.14	Vert(CT)	-0.02	7	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.04	Horz(CT)	0.00	6	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	7-8	>999	240	Weight: 21 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2 *Except* 7-3:2x3 SPF No.2

6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


LOAD CASE(S) Standard

BRACING
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 6=379/0-3-8, 8=379/0-3-8
 Max Horiz 8=-15 (LC 13)
 Max Uplift 6=-63 (LC 9), 8=-63 (LC 8)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/27, 2-3=-333/49, 3-4=-333/48, 4-5=0/27, 2-8=-328/85, 4-6=-328/85
 BOT CHORD 7-8=-4/254, 6-7=-4/254
 WEBS 3-7=0/123

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 63 lb uplift at joint 8 and 63 lb uplift at joint 6.



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job RR115	Truss H1	Truss Type Hip Girder	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	--------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:36 PM
 ID: bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITxb6KWrcDofJ4zJC7f

11/30/2021

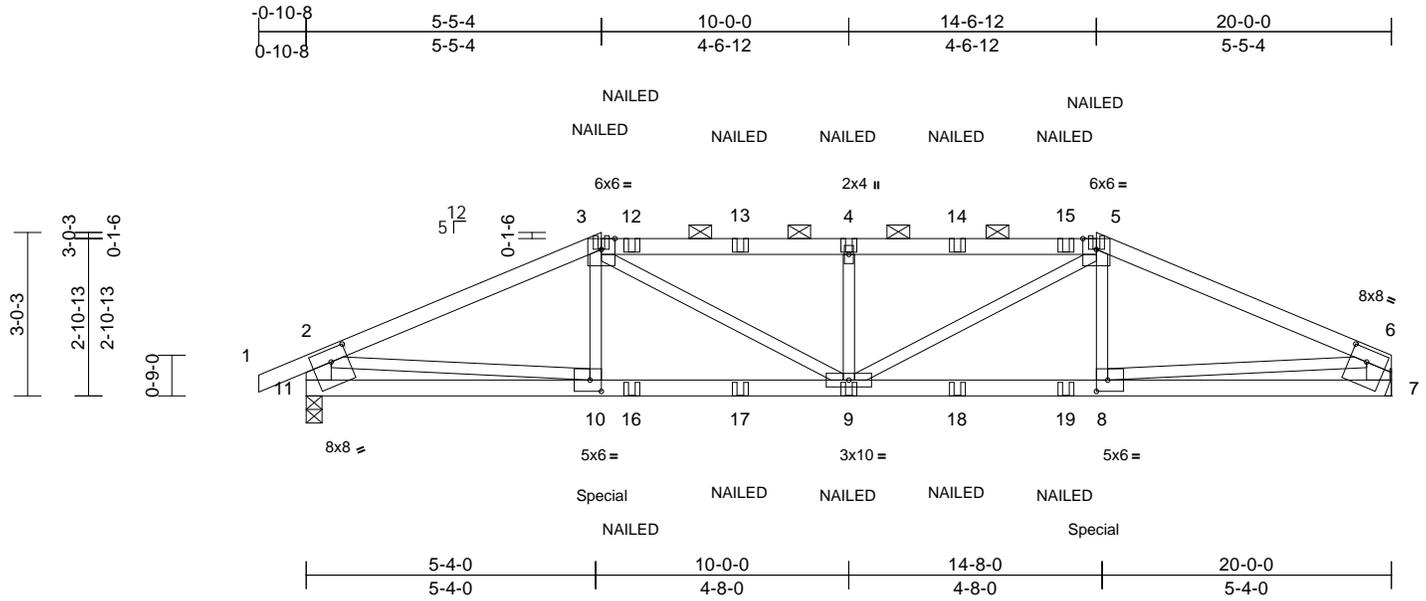

Scale = 1:42.3

Plate Offsets (X, Y): [6:0-3-12,0-2-12], [8:0-2-8,0-2-8], [10:0-2-8,0-2-8], [11:0-3-12,0-2-12]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.87	Vert(LL)	-0.15	8-9	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.88	Vert(CT)	-0.28	8-9	>831	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.81	Horz(CT)	0.05	7	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.10	9	>999	240	Weight: 71 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x3 SPF No.2 *Except* 11-2,7-6:2x6 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 2-7-4 oc purlins, except end verticals, and 2-0-0 oc purlins (2-4-8 max.): 3-5.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS (lb/size) 7=1661/ Mechanical, 11=1743/0-3-8
 Max Horiz 11=24 (LC 7)
 Max Uplift 7=-160 (LC 9), 11=-176 (LC 4)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/30, 2-3=-3117/345, 3-4=-3582/397, 4-5=-3582/397, 5-6=-3121/343, 2-11=-1678/199, 6-7=-1594/184
 BOT CHORD 10-11=-107/602, 9-10=-294/2800, 8-9=-292/2813, 7-8=-61/478
 WEBS 3-10=0/333, 3-9=-81/968, 4-9=-695/180, 5-9=-79/960, 5-8=0/325, 2-10=-233/2271, 6-8=-252/2357

NOTES
 1) Unbalanced roof live loads have been considered for this design.
 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCCL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 3) Provide adequate drainage to prevent water ponding.
 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 176 lb uplift at joint 11 and 160 lb uplift at joint 7.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 10) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 11) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 344 lb down and 77 lb up at 5-5-4, and 344 lb down and 77 lb up at 14-6-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 12) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 1-2=-70, 2-3=-70, 3-5=-70, 5-6=-70, 7-11=-20
 Concentrated Loads (lb)
 Vert: 3=-94 (F), 5=-94 (F), 10=-344 (F), 9=-44 (F), 4=-94 (F), 8=-344 (F), 12=-94 (F), 13=-94 (F), 14=-94 (F), 15=-94 (F), 16=-44 (F), 17=-44 (F), 18=-44 (F), 19=-44 (F)



November 15, 2021


Job RR115	Truss H2	Truss Type Hip	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	-------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789126
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:37
ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

11/30/2021

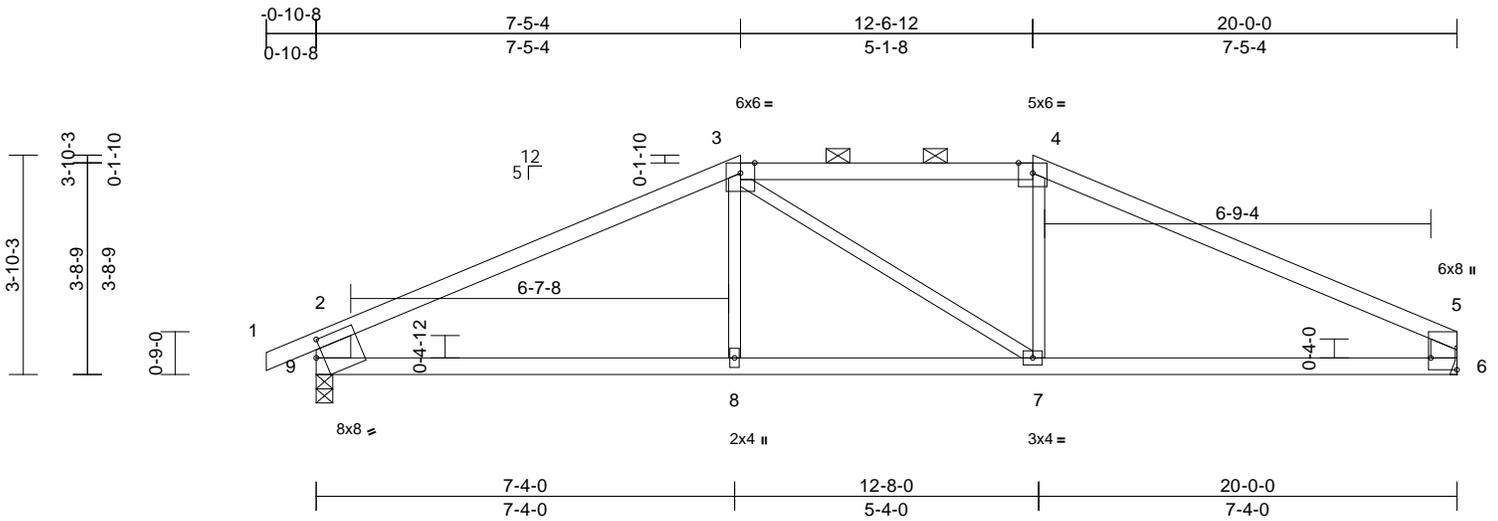

Scale = 1:40.2

Plate Offsets (X, Y): [5:Edge,0-5-8], [9:0-1-8,0-3-9]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.99	Vert(LL)	-0.15	7-8	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.71	Vert(CT)	-0.28	7-8	>848	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.15	Horz(CT)	0.04	6	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.06	7-8	>999	240	Weight: 61 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except* 9-2:2x8 SP DSS, 6-5:2x6 SP 2400F 2.0E

BRACING
TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (4-10-5 max.): 3-4.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS (lb/size) 6=874/ Mechanical, 9=961/0-3-8
Max Horiz 9=28 (LC 10)
Max Uplift 9=-16 (LC 4)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/32, 2-3=-1374/21, 3-4=-1163/35, 4-5=-1368/18, 2-9=-872/61, 5-6=-765/48
BOT CHORD 8-9=0/1162, 7-8=0/1158, 6-7=0/1166
WEBS 3-8=0/237, 3-7=-158/165, 4-7=0/221

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 6) Refer to girder(s) for truss to truss connections.

- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 16 lb uplift at joint 9.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard




November 15, 2021

Job RR115	Truss H3	Truss Type Hip	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	-------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:37
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC?7

11/30/2021

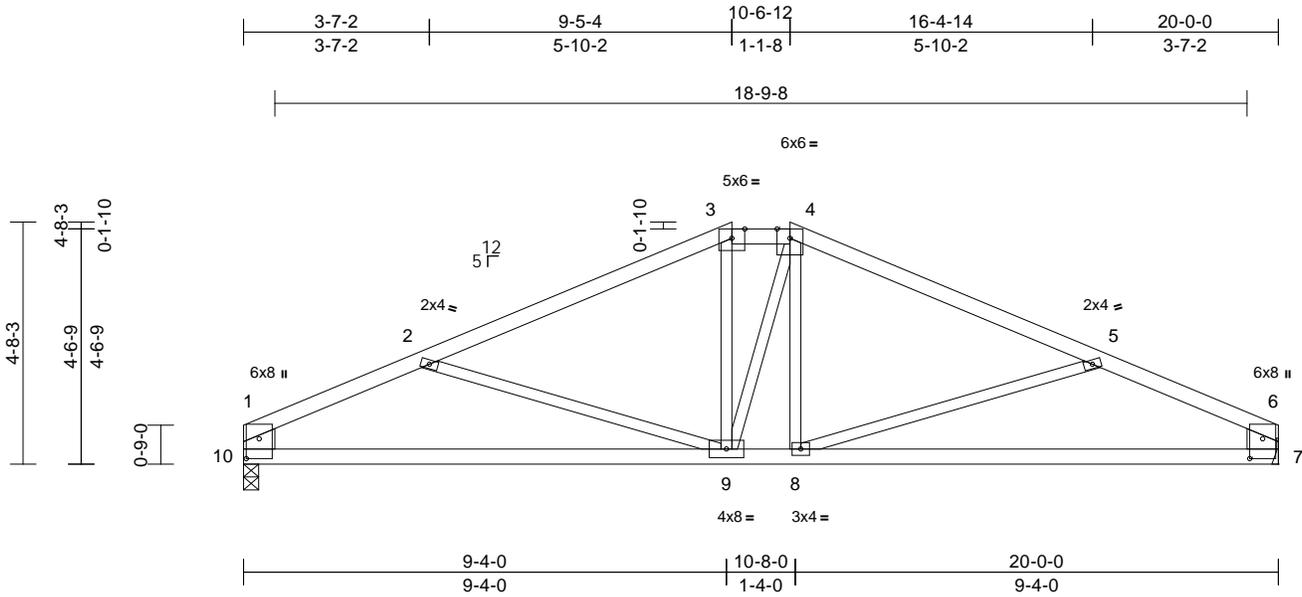

Scale = 1:44.3

Plate Offsets (X, Y): [1:0-4-10,0-3-0], [6:0-4-10,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.98	Vert(LL)	-0.17	8-9	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.68	Vert(CT)	-0.34	7-8	>680	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.24	Horz(CT)	0.04	7	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.08	8-9	>999	240	Weight: 70 lb	FT = 10%

- LUMBER**
- TOP CHORD 2x4 SPF No.2
 - BOT CHORD 2x4 SPF No.2
 - WEBS 2x3 SPF No.2 *Except* 10-1,7-6:2x8 SP DSS

- BRACING**
- TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (5-4-1 max.): 3-4.
 - BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


- REACTIONS** (lb/size) 7=873/ Mechanical, 10=873/0-3-8
 Max Horiz 10=26 (LC 10)
 Max Uplift 7=-10 (LC 9), 10=-10 (LC 8)

- FORCES** (lb) - Maximum Compression/Maximum Tension
- TOP CHORD 1-2=-1414/77, 2-3=-1161/4, 3-4=-1021/26, 4-5=-1160/4, 5-6=-1414/77, 1-10=-763/57, 6-7=-762/57
 - BOT CHORD 9-10=-75/1214, 8-9=0/1020, 7-8=-49/1214
 - WEBS 2-9=-258/133, 3-9=-25/269, 4-9=-163/171, 4-8=0/206, 5-8=-259/133

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Refer to girder(s) for truss to truss connections.

- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 10 lb uplift at joint 10 and 10 lb uplift at joint 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

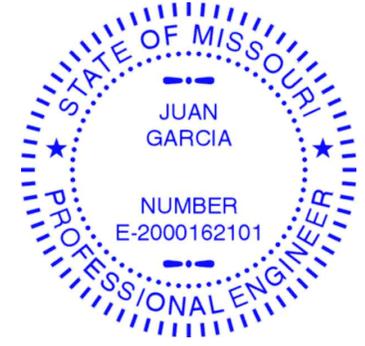

November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job RR115	Truss H4	Truss Type Common	Qty 4	Ply 1	Lot 115 RR
--------------	-------------	----------------------	----------	----------	------------

RELEASE FOR CONSTRUCTION

AS NOTED FOR PLAN REVIEW

DEVELOPMENT SERVICES


148789128

LEE'S SUMMIT, MISSOURI

11/30/2021

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:37
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7?

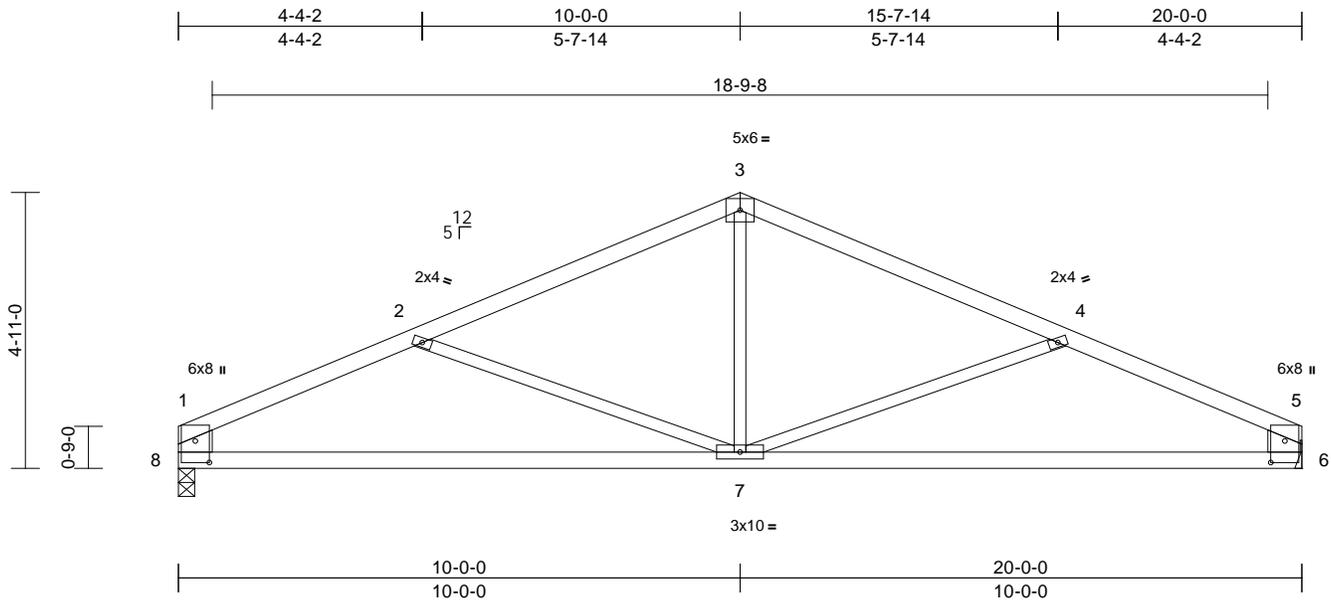

Scale = 1:40.8

Plate Offsets (X, Y): [1:0-4-10,0-3-0], [5:0-4-10,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.81	Vert(LL)	-0.19	7	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.74	Vert(CT)	-0.37	6-7	>628	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.31	Horz(CT)	0.04	6	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.08	7	>999	240	Weight: 64 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x3 SPF No.2 *Except* 8-1,6-5:2x8 SP DSS

7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


LOAD CASE(S) Standard

BRACING
 TOP CHORD Structural wood sheathing directly applied or 3-3-5 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 6=873/ Mechanical, 8=873/0-3-8
 Max Horiz 8=29 (LC 8)
 Max Uplift 6=-12 (LC 9), 8=-12 (LC 8)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-1414/76, 2-3=-1103/14, 3-4=-1103/14, 4-5=-1414/77, 1-8=-758/60, 5-6=-758/60
 BOT CHORD 7-8=-72/1216, 6-7=-43/1216
 WEBS 3-7=0/434, 4-7=-331/139, 2-7=-331/139

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 12 lb uplift at joint 8 and 12 lb uplift at joint 6.



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

MiTek
 16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job RR115	Truss H5	Truss Type Half Hip	Qty 1	Ply 1	Lot 115 RR
--------------	-------------	------------------------	----------	----------	------------

RELEASE FOR CONSTRUCTION


AS NOTED FOR PLAN REVIEW

DEVELOPMENT SERVICES
148789129
LEE'S SUMMIT, MISSOURI

11/30/2021

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:38
ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITxb6KWrcDofJ4zJC7?

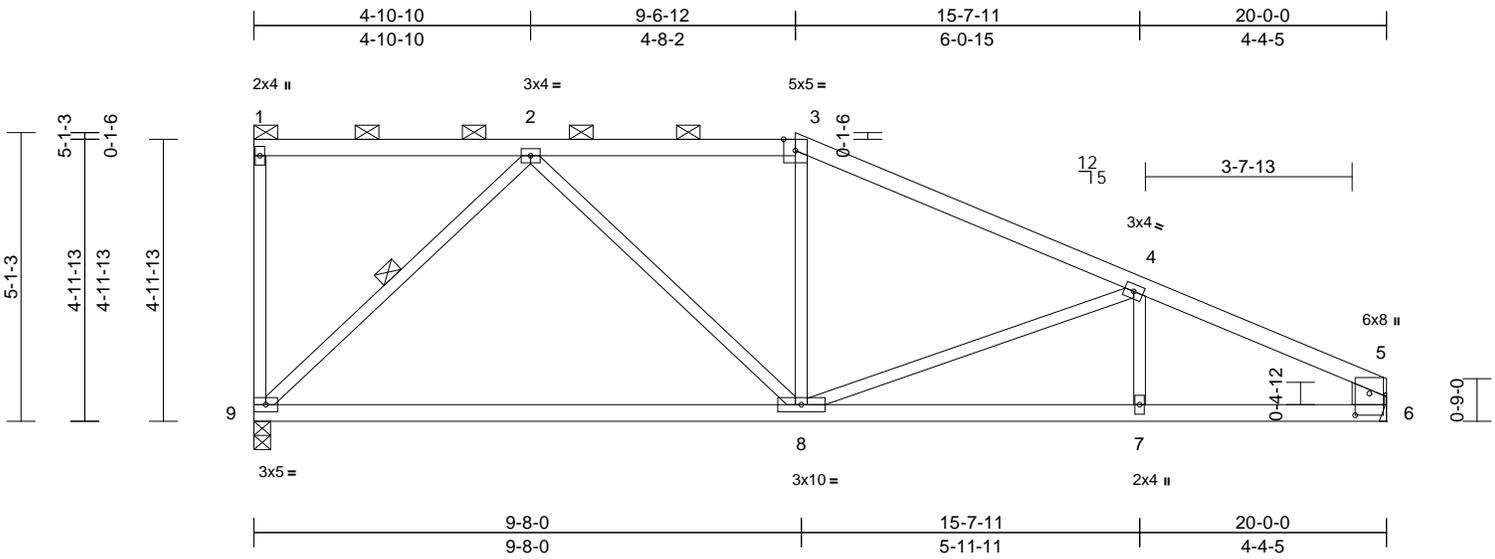

Scale = 1:40.5
Plate Offsets (X, Y): [5:0-4-10,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.60	Vert(LL)	-0.20	8-9	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.67	Vert(CT)	-0.41	8-9	>569	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.41	Horz(CT)	0.02	6	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.06	7-8	>999	240	Weight: 72 lb	FT = 10%

- LUMBER**
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF 2100F 1.8E
 WEBS 2x3 SPF No.2 *Except* 6-5:2x8 SP DSS
- BRACING**
 TOP CHORD Structural wood sheathing directly applied or 4-0-12 oc purlins, except end verticals, and 2-0-0 oc purlins (5-8-9 max.): 1-3.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 2-9
- REACTIONS** (lb/size) 6=882/ Mechanical, 9=882/0-3-8
 Max Horiz 9=155 (LC 4)
 Max Uplift 6=-12 (LC 9), 9=-43 (LC 4)
- FORCES** (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-9=-141/35, 1-2=-66/39, 2-3=-979/34,
 3-4=-1135/23, 4-5=-1406/40, 5-6=-704/33
 BOT CHORD 8-9=-2/687, 7-8=-13/1230, 6-7=-13/1230
 WEBS 2-9=-944/90, 2-8=0/406, 3-8=0/173,
 4-8=-270/104, 4-7=-93/50

- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 43 lb uplift at joint 9 and 12 lb uplift at joint 6.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



November 15, 2021


- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 6) Refer to girder(s) for truss to truss connections.

Job RR115	Truss H6	Truss Type Half Hip	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:38 PM 2021 Page: 1
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

11/30/2021

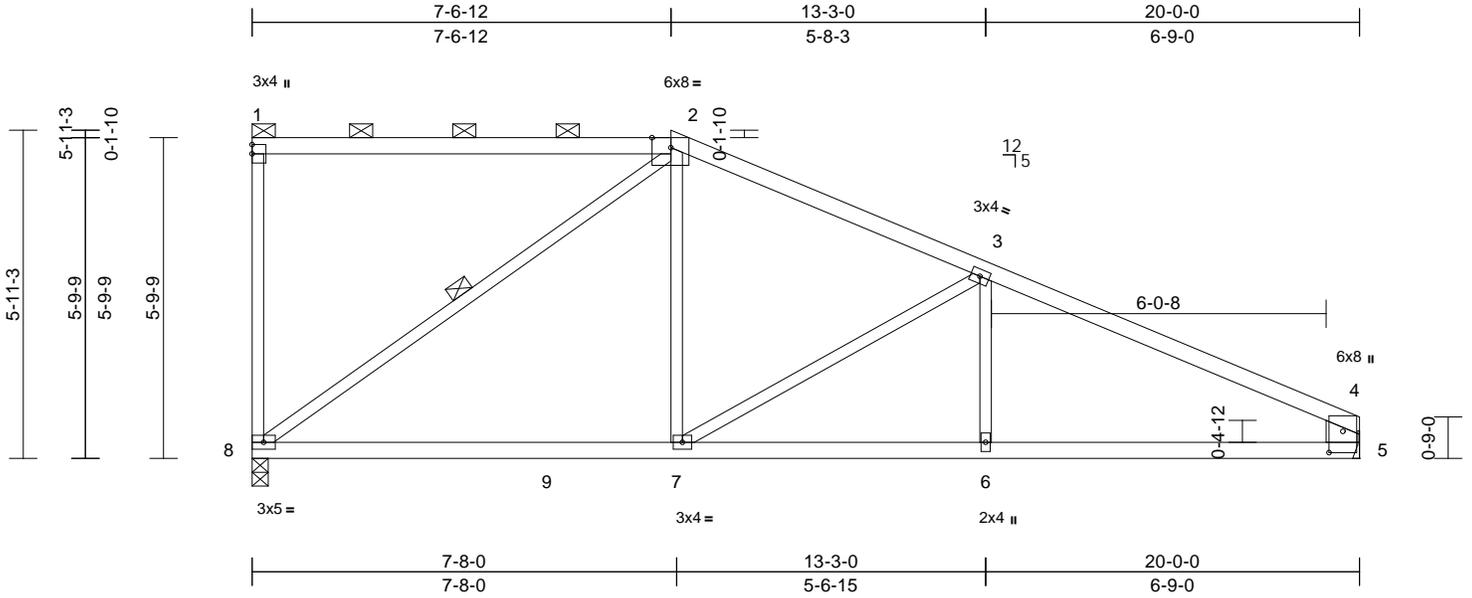

Scale = 1:41.4

Plate Offsets (X, Y): [2:0-4-2,Edge], [4:0-4-10,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.90	Vert(LL)	-0.15	6-7	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.91	Vert(CT)	-0.26	7-8	>888	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.82	Horz(CT)	0.03	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.06	6-7	>999	240	Weight: 72 lb	FT = 10%

- LUMBER**
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x3 SPF No.2 *Except* 5-4:2x8 SP DSS
- BRACING**
 TOP CHORD Structural wood sheathing directly applied or 3-11-0 oc purlins, except end verticals, and 2-0-0 oc purlins (3-9-12 max.): 1-2.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 2-8
- REACTIONS** (lb/size) 5=882/ Mechanical, 8=882/0-3-8
 Max Horiz 8=182 (LC 4)
 Max Uplift 5=-18 (LC 9), 8=-41 (LC 4)
 Max Grav 5=918 (LC 2), 8=930 (LC 2)
- FORCES** (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-8=-251/62, 1-2=-71/52, 2-3=-973/40, 3-4=-1431/45, 4-5=-759/57
 BOT CHORD 7-8=0/843, 6-7=0/1240, 5-6=0/1240
 WEBS 2-8=-1020/36, 2-7=0/552, 3-7=-460/93, 3-6=0/175

- 6) Refer to girder(s) for truss to truss connections.
 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 41 lb uplift at joint 8 and 18 lb uplift at joint 5.
 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job RR115	Truss J1	Truss Type Diagonal Hip Girder	Qty 2	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	-----------------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:38
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

11/30/2021

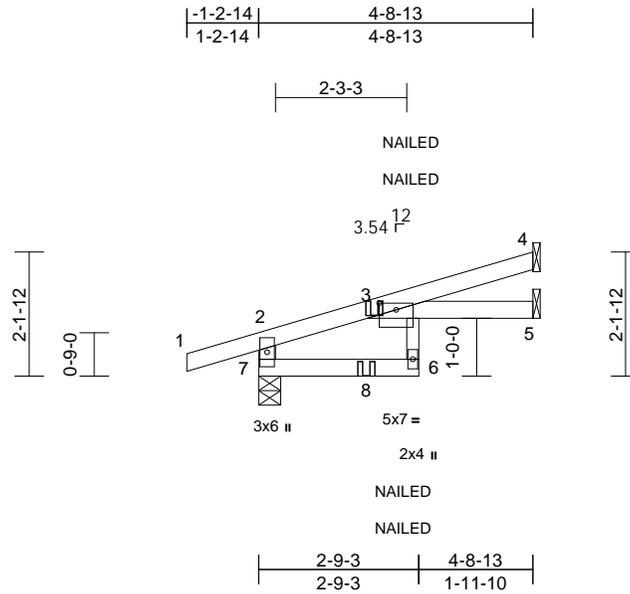

Scale = 1:39.6

Plate Offsets (X, Y): [3:0-3-8,0-1-6]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.40	Vert(LL)	-0.04	6	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.28	Vert(CT)	-0.09	6	>615	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.00	Horz(CT)	0.04	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.05	6	>999	240	Weight: 14 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2 *Except* 6-3:2x3 SPF No.2
 WEBS 2x4 SPF No.2


BRACING
 TOP CHORD Structural wood sheathing directly applied or 4-8-13 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (lb/size) 4=122/ Mechanical, 5=72/ Mechanical, 7=319/0-4-9
 Max Horiz 7=68 (LC 4)
 Max Uplift 4=-45 (LC 8), 7=-85 (LC 4)
 Max Grav 4=122 (LC 1), 5=85 (LC 3), 7=319 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 2-7=-307/105, 1-2=0/27, 2-3=-66/9, 3-4=-22/29
 BOT CHORD 6-7=-30/0, 3-6=0/71, 3-5=0/0

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 85 lb uplift at joint 7 and 45 lb uplift at joint 4.

- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 1-2=-70, 2-3=-70, 3-4=-70, 6-7=-20, 3-5=-20
 Concentrated Loads (lb)
 Vert: 8=7 (F=4, B=4)



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job RR115	Truss J2	Truss Type Jack-Open	Qty 7	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	-------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:39 PM 2021 Page: 1
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDofJ4zJC7?

11/30/2021

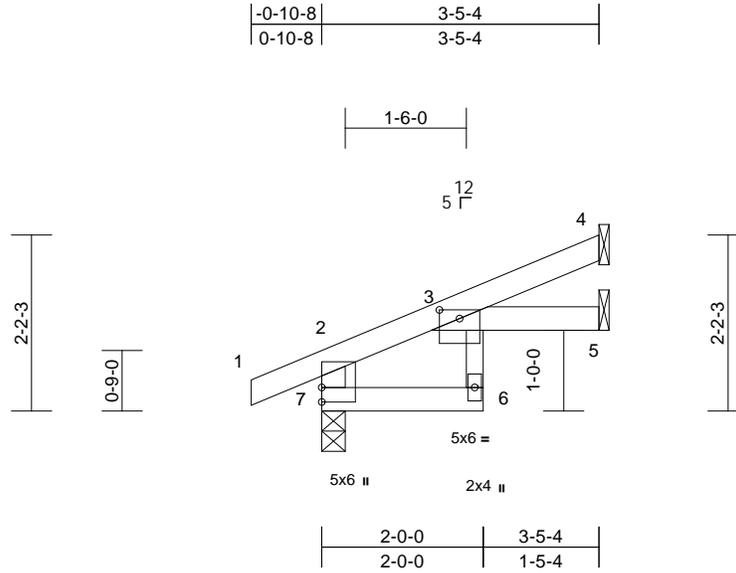

Scale = 1:28.4

Plate Offsets (X, Y): [3:0-3-0,0-1-5]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.17	Vert(LL)	-0.01	6	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.13	Vert(CT)	-0.02	6	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.01	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.02	6	>999	240	Weight: 11 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2 *Except* 6-3:2x3 SPF No.2
 WEBS 2x4 SPF No.2

6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING
 TOP CHORD Structural wood sheathing directly applied or 3-5-4 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (lb/size) 4=87/ Mechanical, 5=52/ Mechanical, 7=234/0-3-8
 Max Horiz 7=63 (LC 8)
 Max Uplift 4=-38 (LC 8), 5=-3 (LC 8), 7=-30 (LC 8)
 Max Grav 4=87 (LC 1), 5=61 (LC 3), 7=234 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 2-7=-223/53, 1-2=0/27, 2-3=-56/0, 3-4=-24/28
 BOT CHORD 6-7=-16/0, 3-6=0/47, 3-5=0/0

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 30 lb uplift at joint 7, 38 lb uplift at joint 4 and 3 lb uplift at joint 5.



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job	Truss	Truss Type	Qty	Ply	Lot 115 RR
RR115	J3	Jack-Open	12	1	Job Reference (optional)

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:39 PM Page: 1
 ID:bWuMDBN0tjF5cDvSpwhP1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDofJ4zJC7f

11/30/2021

-0-10-8	1-4-3
0-10-8	1-4-3

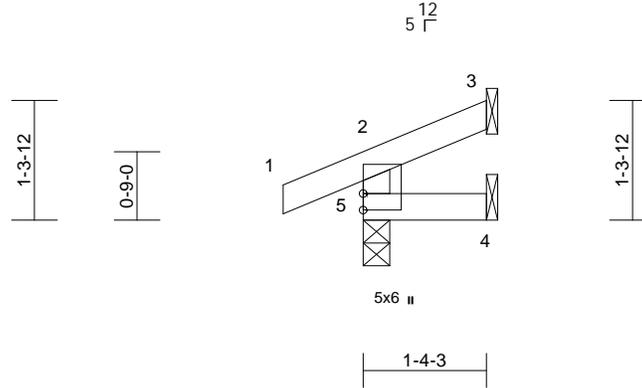

Scale = 1:25.1

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	0.00	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(CT)	0.00	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	4-5	>999	240	Weight: 5 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 1-4-3 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(lb/size) 3=19/ Mechanical, 4=4/ Mechanical, 5=156/0-3-8
 Max Horiz 5=33 (LC 5)
 Max Uplift 3=-17 (LC 8), 5=-36 (LC 4)
 Max Grav 3=19 (LC 1), 4=20 (LC 3), 5=156 (LC 1)

FORCES


(lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-5=-136/46, 1-2=0/27, 2-3=-25/4
 BOT CHORD 4-5=0/0

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCCL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 36 lb uplift at joint 5 and 17 lb uplift at joint 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

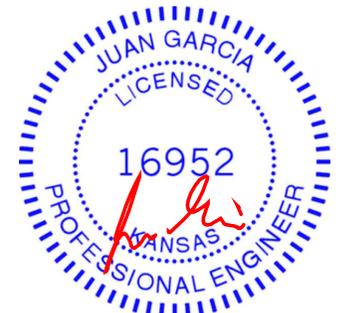

November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job RR115	Truss J5	Truss Type Jack-Open	Qty 13	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	-------------------------	-----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:39 Page: 1
 ID: bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITxb6KWrcDofJ4zJC7f

11/30/2021

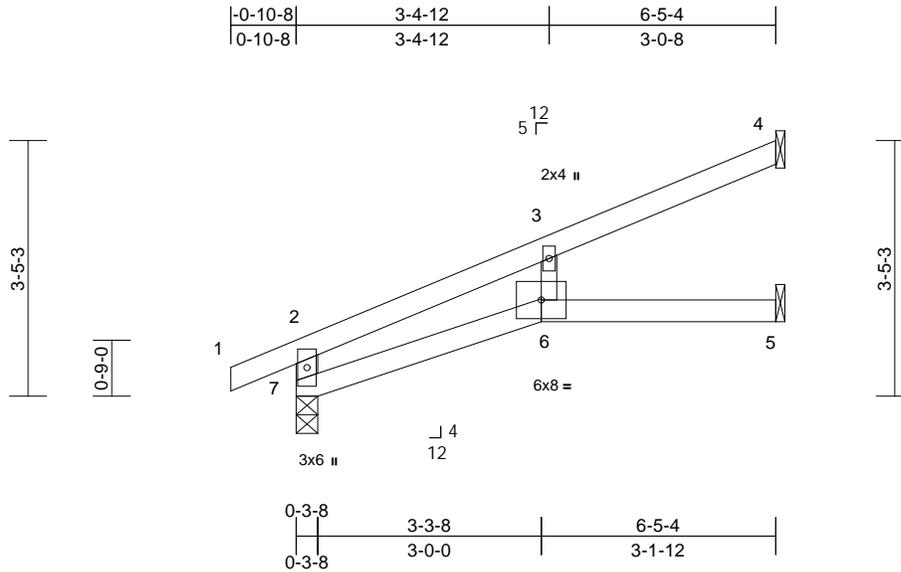

Scale = 1:30.8

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.41	Vert(LL)	-0.11	6	>672	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.50	Vert(CT)	-0.20	6-7	>371	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.02	Horz(CT)	0.07	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P		Wind(LL)	0.09	6-7	>851	240	Weight: 18 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2 *Except* 6-3:2x3 SPF No.2

7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
LOAD CASE(S) Standard

BRACING
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (lb/size) 4=167/ Mechanical, 5=107/ Mechanical, 7=358/0-3-8
 Max Horiz 7=79 (LC 8)
 Max Uplift 4=-37 (LC 8), 7=-3 (LC 8)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 2-7=-251/16, 1-2=0/27, 2-3=-76/20, 3-4=-27/56
 BOT CHORD 6-7=-42/15, 5-6=0/0
 WEBS 3-6=-90/62

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 3 lb uplift at joint 7 and 37 lb uplift at joint 4.



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job RR115	Truss J6	Truss Type Jack-Open	Qty 2	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	-------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:40 Page: 1
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uTXb6KWrcDofJ4zJC7f

11/30/2021

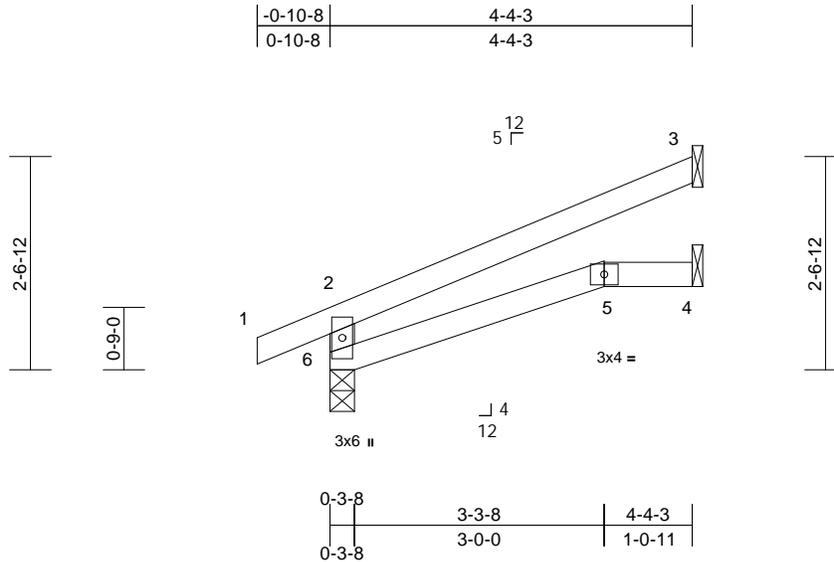

Scale = 1:27.5

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.25	Vert(LL)	-0.01	5-6	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.15	Vert(CT)	-0.03	5-6	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.01	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.02	5-6	>999	240	Weight: 12 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING
 TOP CHORD Structural wood sheathing directly applied or 4-4-3 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (lb/size) 3=129/ Mechanical, 4=49/ Mechanical, 6=267/0-3-8
 Max Horiz 6=78 (LC 8)
 Max Uplift 3=67 (LC 8), 6=36 (LC 8)
 Max Grav 3=129 (LC 1), 4=78 (LC 3), 6=267 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 2-6=-233/76, 1-2=0/27, 2-3=-69/38
 BOT CHORD 5-6=-28/8, 4-5=0/0

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCCL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Bearing at joint(s) 6 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 36 lb uplift at joint 6 and 67 lb uplift at joint 3.



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job RR115	Truss J8	Truss Type Jack-Open	Qty 5	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	-------------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789138
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:40 Page: 1
ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDofJ4zJC7f

11/30/2021

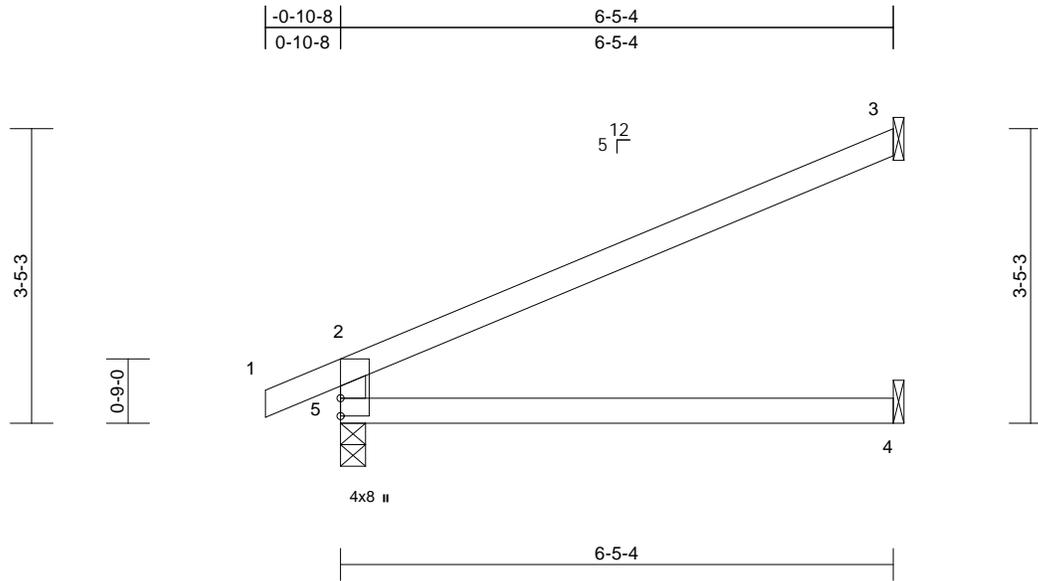

Scale = 1:26.7

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.63	Vert(LL)	-0.07	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.37	Vert(CT)	-0.16	4-5	>477	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.05	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.05	4-5	>999	240	Weight: 17 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(lb/size) 3=196/ Mechanical, 4=78/ Mechanical, 5=358/0-3-8
Max Horiz 5=80 (LC 8)
Max Uplift 3=57 (LC 8), 5=-4 (LC 8)
Max Grav 3=196 (LC 1), 4=118 (LC 3), 5=358 (LC 1)

FORCES


(lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-5=-311/56, 1-2=0/27, 2-3=-92/59
BOT CHORD 4-5=0/0

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 4 lb uplift at joint 5 and 57 lb uplift at joint 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job RR115	Truss J9	Truss Type Jack-Closed	Qty 5	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	---------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:41 Page: 1
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDofJ4zJC7f

11/30/2021

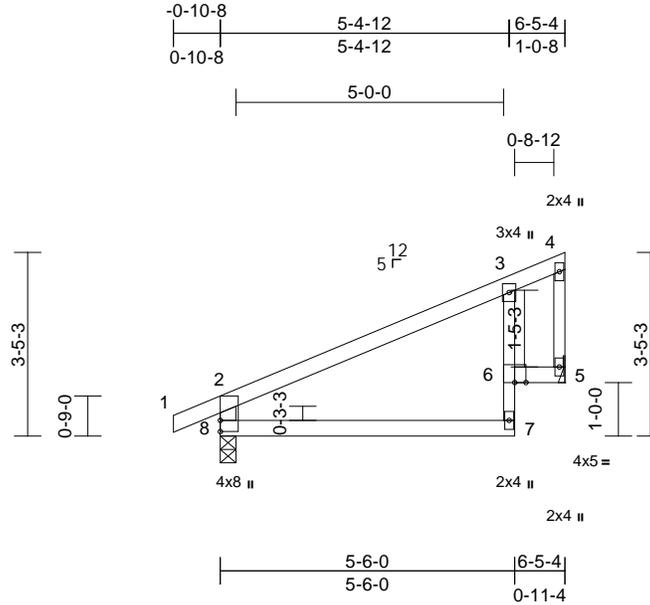

Scale = 1:42.8

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.29	Vert(LL)	-0.03	7-8	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.36	Vert(CT)	-0.06	7-8	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.01	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.01	7-8	>999	240	Weight: 20 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2 *Except* 7-3:2x3 SPF No.2
 WEBS 2x4 SPF No.2 *Except* 4-5:2x3 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 5=273/ Mechanical, 8=356/0-3-8
 Max Horiz 8=96 (LC 5)
 Max Uplift 5=-24 (LC 8), 8=-14 (LC 8)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-8=-313/51, 1-2=0/27, 2-3=-218/14,
 3-4=-55/27, 4-5=-43/0
 BOT CHORD 7-8=-23/136, 6-7=0/107, 3-6=-162/75,
 5-6=-16/42

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust)
 Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 14 lb uplift at joint 8 and 24 lb uplift at joint 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job RR115	Truss J10	Truss Type Diagonal Hip Girder	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	--------------	-----------------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 E Aug 16 2021 Print: 8.430 E Aug 16 2021 MiTek Industries, Inc. Mon Nov 15 10:49:13 Page: 1
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-WrZWp76s4dGhtemjkm4XKbwixDn;JDuTGF8w4gylypq

11/30/2021

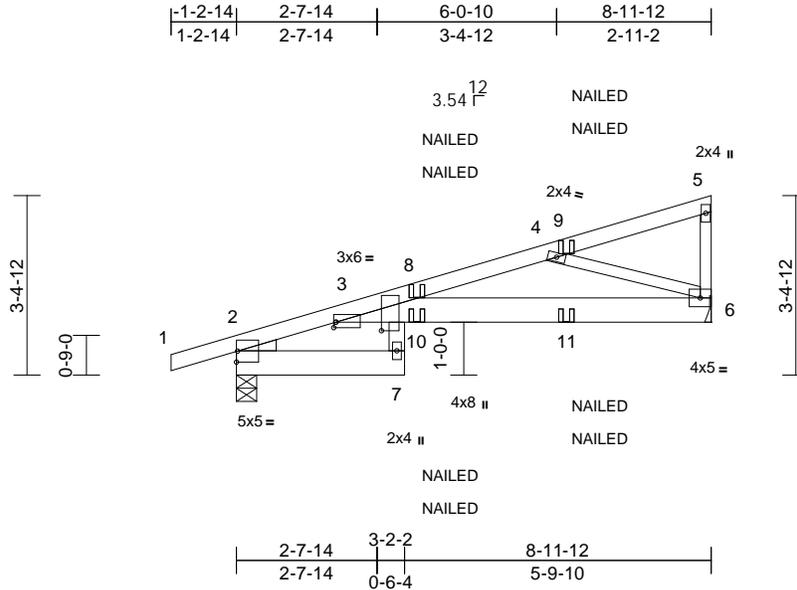

Scale = 1:43.4

Plate Offsets (X, Y): [3:0-1-15,0-10-5], [3:0-0-8,0-1-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.92	Vert(LL)	-0.20	7	>531	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.58	Vert(CT)	-0.39	7	>268	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.21	Horz(CT)	0.14	6	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.23	7	>462	240	Weight: 36 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF 2100F 1.8E
 BOT CHORD 2x6 SPF No.2
 WEBS 2x3 SPF No.2 *Except* 7-3:2x4 SPF No.2
 WEDGE Left: 2x3 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (lb/size) 2=567/0-4-9, 6=479/ Mechanical
 Max Horiz 2=114 (LC 5)
 Max Uplift 2=-162 (LC 4), 6=-134 (LC 8)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-8=-769/241, 4-8=-743/251
 BOT CHORD 3-10=-265/743, 10-11=-265/743,
 6-11=-265/743
 WEBS 4-6=-753/296

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 134 lb uplift at joint 6 and 162 lb uplift at joint 2.

- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 1-5=-70, 2-7=-20, 3-6=-20
 Concentrated Loads (lb)
 Vert: 9=-26 (F=-13, B=-13), 10=-32 (F=-16, B=-16), 11=-87 (F=-44, B=-44)



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSITPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job RR115	Truss J11	Truss Type Jack-Open	Qty 5	Ply 1	Lot 115 RR Job Reference (optional)
--------------	--------------	-------------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
 148789141
LEE'S SUMMIT, MISSOURI

11/30/2021

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:41 Page: 1
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

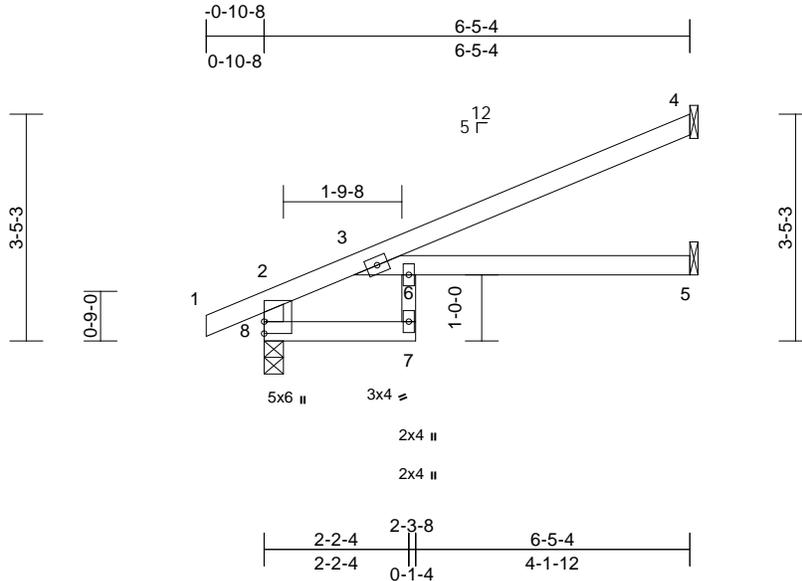

Scale = 1:34.7

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.54	Vert(LL)	-0.10	5-6	>765	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.47	Vert(CT)	-0.20	5-6	>380	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.02	Horz(CT)	0.11	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.08	5-6	>948	240	Weight: 18 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2 *Except* 7-6:2x3 SPF No.2

6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
LOAD CASE(S) Standard

BRACING
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 4=186/ Mechanical, 5=93/ Mechanical, 8=370/0-3-8
 Max Horiz 8=80 (LC 8)
 Max Uplift 4=48 (LC 8)
 Max Grav 4=186 (LC 1), 5=118 (LC 3), 8=370 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 2-8=-373/23, 1-2=0/27, 2-3=-114/0, 3-4=-55/58
 BOT CHORD 7-8=0/0, 3-6=0/0, 5-6=0/0
 WEBS 6-7=-2/54

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 48 lb uplift at joint 4.



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job RR115	Truss J12	Truss Type Jack-Open	Qty 2	Ply 1	Lot 115 RR Job Reference (optional)
--------------	--------------	-------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:42
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDofJ4zJC7? Page: 1

11/30/2021

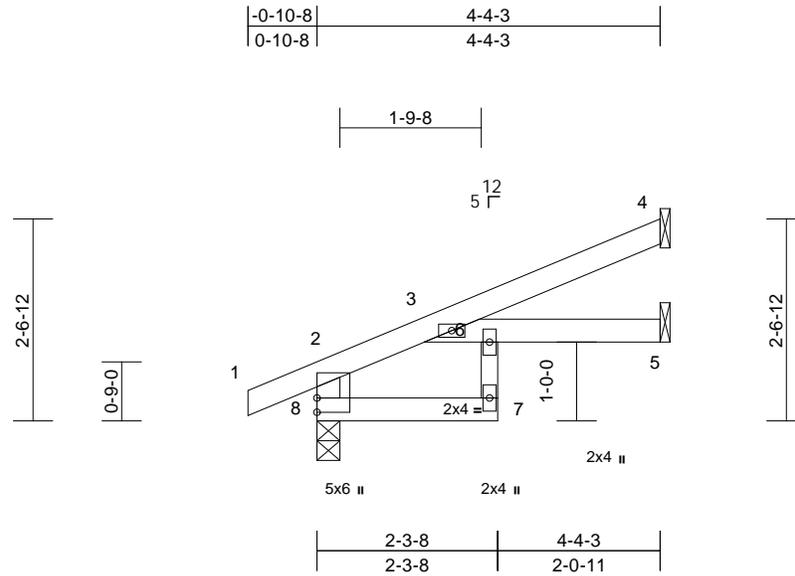

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.18	Vert(LL)	-0.02	7	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.21	Vert(CT)	-0.03	5-6	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.02	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.02	7	>999	240	Weight: 13 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2 *Except* 7-6:2x3 SPF No.2
 WEBS 2x4 SPF No.2

6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
LOAD CASE(S) Standard

BRACING
 TOP CHORD Structural wood sheathing directly applied or 4-4-3 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 4=112/ Mechanical, 5=72/ Mechanical, 8=277/0-3-8
 Max Horiz 8=78 (LC 8)
 Max Uplift 4=-50 (LC 8), 5=-2 (LC 8), 8=-31 (LC 8)
 Max Grav 4=112 (LC 1), 5=86 (LC 3), 8=277 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 2-8=-264/56, 1-2=0/27, 2-3=-132/0, 3-4=-37/36
 BOT CHORD 7-8=-34/64, 6-7=0/47, 3-6=-64/34, 5-6=0/0

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 31 lb uplift at joint 8, 50 lb uplift at joint 4 and 2 lb uplift at joint 5.



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job	Truss	Truss Type	Qty	Ply	Lot 115 RR
RR115	J14	Jack-Open	2	1	Job Reference (optional)

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:42 Page: 1
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

11/30/2021

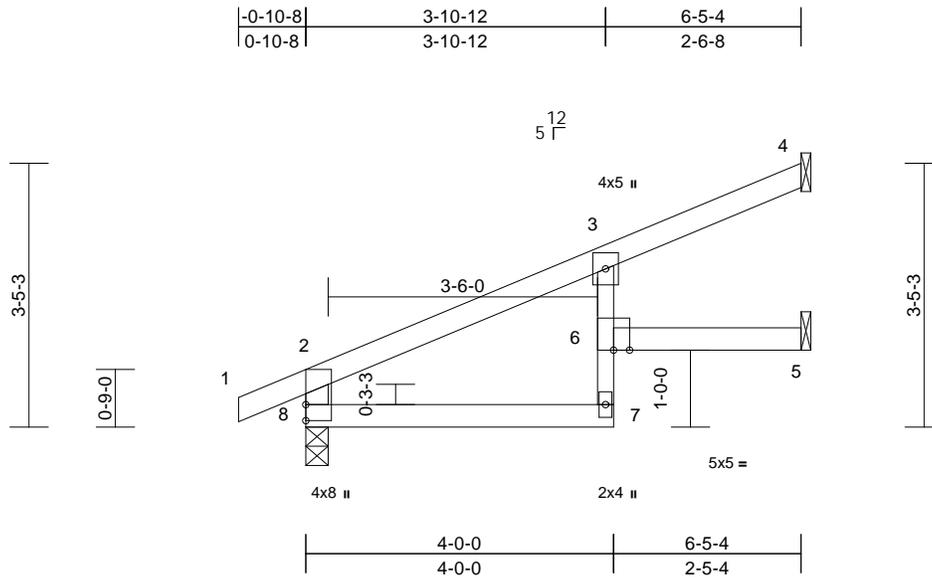

Scale = 1:29.8

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.36	Vert(LL)	-0.08	3	>961	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.51	Vert(CT)	-0.14	7	>546	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.05	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.06	6	>999	240	Weight: 18 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2 *Except* 7-3:2x3 SPF No.2
 WEBS 2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(lb/size) 4=161/ Mechanical, 5=114/ Mechanical, 8=358/0-3-8
 Max Horiz 8=80 (LC 8)
 Max Uplift 4=-32 (LC 8), 5=-3 (LC 8), 8=-4 (LC 8)


FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-8=-330/34, 1-2=0/27, 2-3=-263/0, 3-4=-23/55
 BOT CHORD 7-8=-34/178, 6-7=0/79, 3-6=-17/75, 5-6=0/0

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 4 lb uplift at joint 8, 32 lb uplift at joint 4 and 3 lb uplift at joint 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job RR115	Truss J15	Truss Type Diagonal Hip Girder	Qty 2	Ply 1	Lot 115 RR Job Reference (optional)
--------------	--------------	-----------------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:43 PM
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

11/30/2021

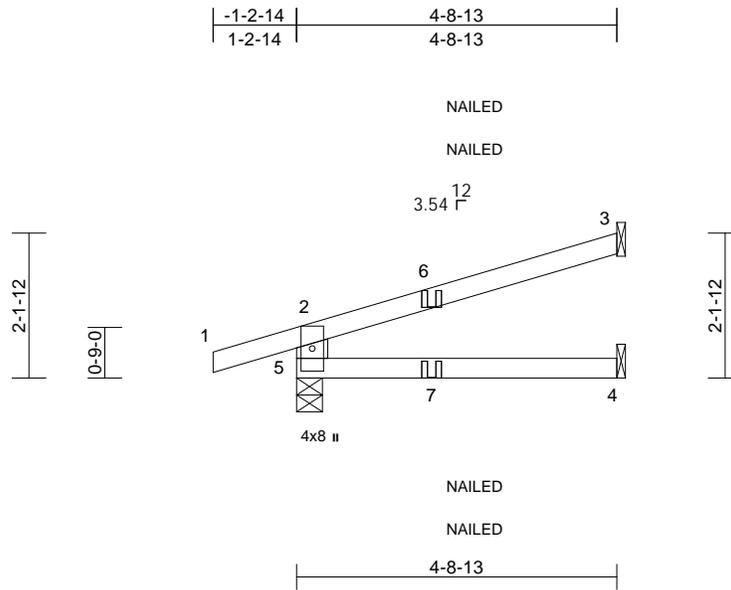

Scale = 1:33.9

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.31	Vert(LL)	-0.02	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.19	Vert(CT)	-0.04	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.00	Horz(CT)	0.01	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.01	4-5	>999	240	Weight: 13 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x6 SPF No.2


BRACING
 TOP CHORD Structural wood sheathing directly applied or 4-8-13 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 3=132/ Mechanical, 4=48/ Mechanical, 5=315/0-4-9
 Max Horiz 5=68 (LC 4)
 Max Uplift 3=-60 (LC 8), 5=-94 (LC 4)
 Max Grav 3=132 (LC 1), 4=82 (LC 3), 5=315 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 2-5=-281/132, 1-2=0/29, 2-3=-69/29
 BOT CHORD 4-5=0/0

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 94 lb uplift at joint 5 and 60 lb uplift at joint 3.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

- 7) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 1-2=-70, 2-3=-70, 4-5=-20
 Concentrated Loads (lb)
 Vert: 7=7 (F=4, B=4)



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job	Truss	Truss Type	Qty	Ply	Lot 115 RR
RR115	J16	Jack-Open	5	1	Job Reference (optional)


AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789146
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:44 Page: 1

ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

11/30/2021

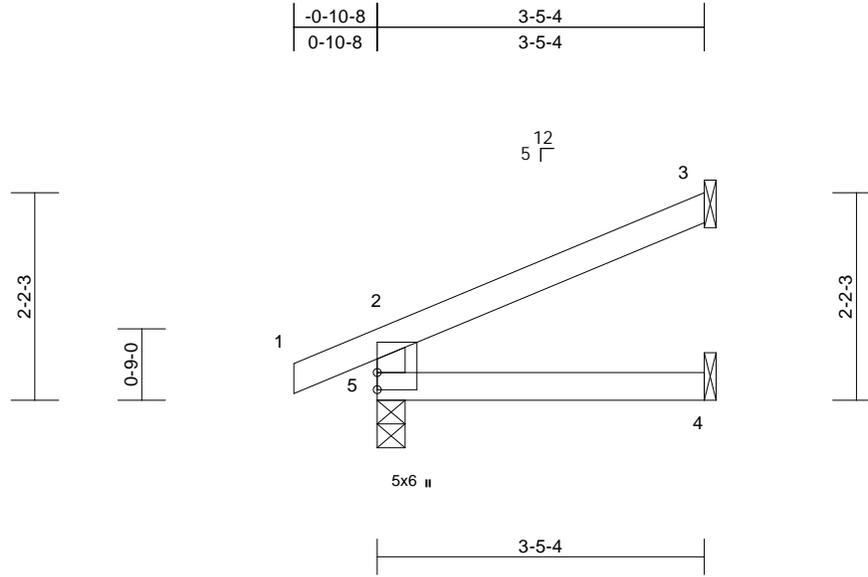

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.14	Vert(LL)	-0.01	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.09	Vert(CT)	-0.01	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.01	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.01	4-5	>999	240	Weight: 10 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 3-5-4 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 3=98/ Mechanical, 4=36/ Mechanical, 5=228/0-3-8
Max Horiz 5=63 (LC 8)
Max Uplift 3=-52 (LC 8), 5=-33 (LC 8)
Max Grav 3=98 (LC 1), 4=60 (LC 3), 5=228 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 2-5=-200/64, 1-2=0/27, 2-3=-54/29
BOT CHORD 4-5=0/0

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 33 lb uplift at joint 5 and 52 lb uplift at joint 3.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job RR115	Truss J17	Truss Type Diagonal Hip Girder	Qty 2	Ply 1	Lot 115 RR Job Reference (optional)
--------------	--------------	-----------------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:44 Page: 1
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uTXb6KWrcDofJ4zJC7f

11/30/2021

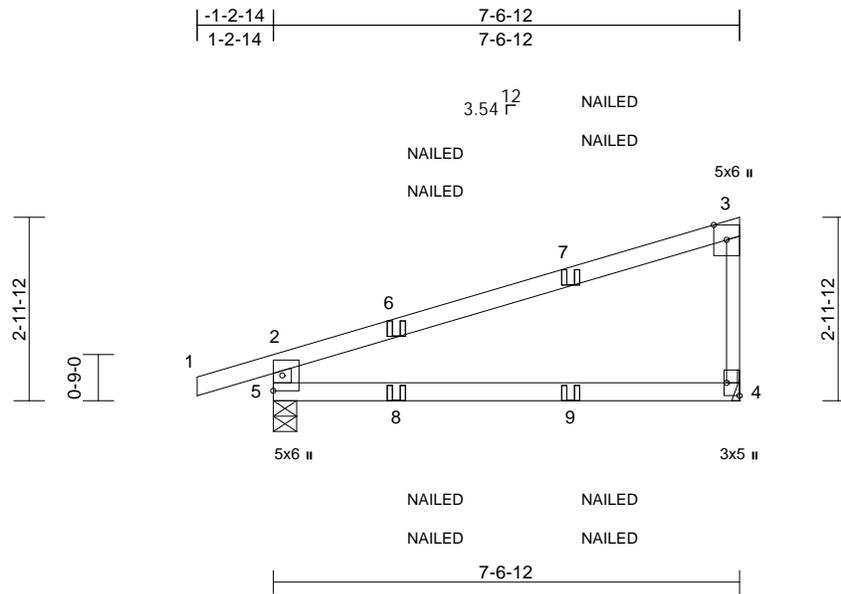

Scale = 1:37.2

Plate Offsets (X, Y): [4:Edge,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.86	Vert(LL)	-0.11	4-5	>780	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.51	Vert(CT)	-0.24	4-5	>361	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.05	4-5	>999	240	Weight: 21 lb	FT = 10%

LUMBER

- TOP CHORD 2x4 SPF No.2
- BOT CHORD 2x4 SPF No.2
- WEBS 2x4 SPF No.2 *Except* 3-4:2x3 SPF No.2

BRACING

- TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
- BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

- (lb/size) 4=328/ Mechanical, 5=435/0-4-9
- Max Horiz 5=122 (LC 22)
- Max Uplift 4=80 (LC 8), 5=123 (LC 4)

FORCES

- (lb) - Maximum Compression/Maximum Tension
- TOP CHORD 2-5=-383/180, 1-2=0/27, 2-3=-199/21, 3-4=-228/112
- BOT CHORD 4-5=-43/87

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust)
 Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 123 lb uplift at joint 5 and 80 lb uplift at joint 4.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.

8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 1-2=-70, 2-3=-70, 4-5=-20
 Concentrated Loads (lb)
 Vert: 7=-2 (F=-1, B=1), 8=7 (F=4, B=4), 9=-13 (F=-7, B=-7)



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job	Truss	Truss Type	Qty	Ply	Lot 115 RR
RR115	J18	Jack-Open	7	1	Job Reference (optional)

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:45 Page: 1
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

11/30/2021

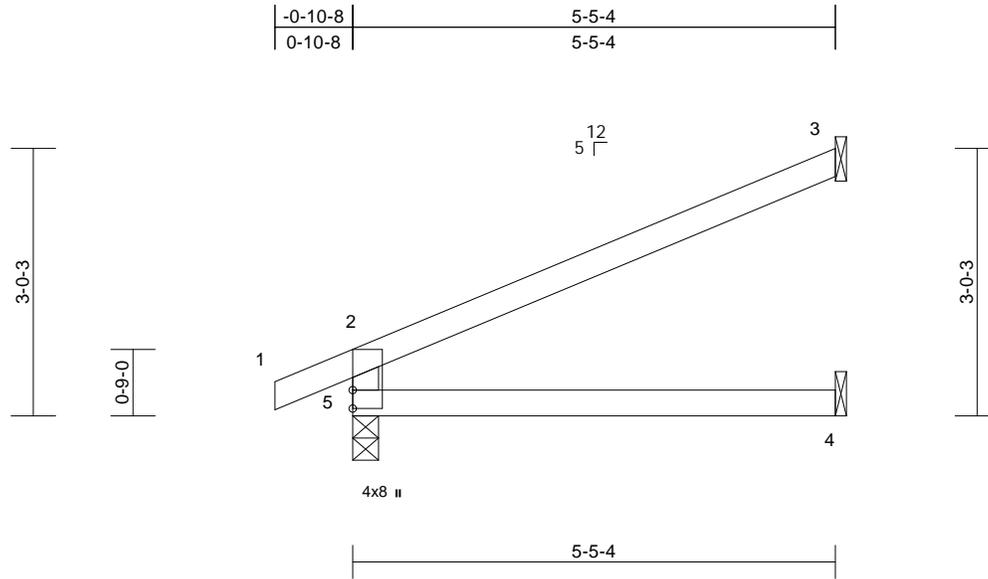

Scale = 1:25.8

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.43	Vert(LL)	-0.03	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.26	Vert(CT)	-0.08	4-5	>810	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.03	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.03	4-5	>999	240	Weight: 14 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-5-4 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(lb/size) 3=164/ Mechanical, 4=64/ Mechanical, 5=314/0-3-8
 Max Horiz 5=68 (LC 8)
 Max Uplift 3=-49 (LC 8), 5=-4 (LC 8)
 Max Grav 3=164 (LC 1), 4=99 (LC 3), 5=314 (LC 1)

FORCES


(lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-5=-274/48, 1-2=0/27, 2-3=-78/49
 BOT CHORD 4-5=0/0

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 4 lb uplift at joint 5 and 49 lb uplift at joint 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job RR115	Truss J19	Truss Type Jack-Open	Qty 3	Ply 1	Lot 115 RR Job Reference (optional)
--------------	--------------	-------------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789149
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:45
ID:bWuMDBN0tjF5cDvSpwhH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7? Page: 1

11/30/2021

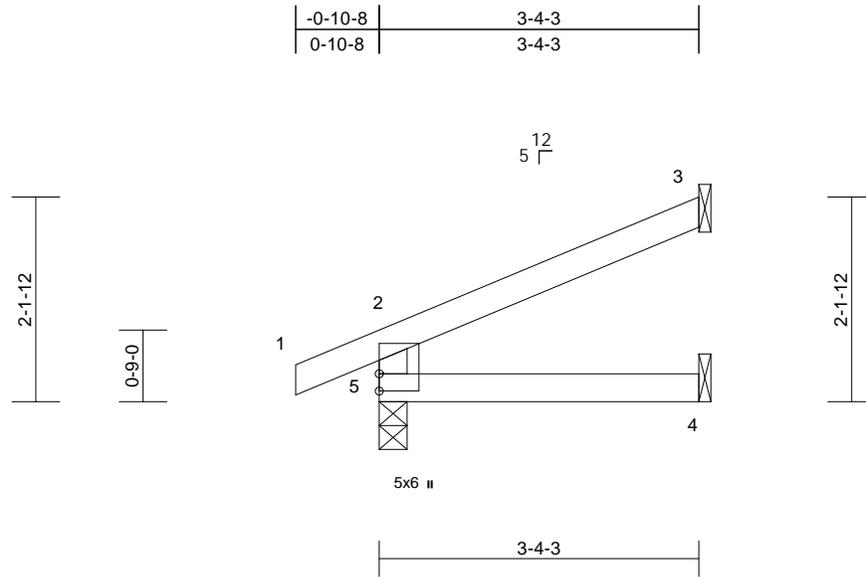

Scale = 1:24

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.13	Vert(LL)	0.00	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.08	Vert(CT)	-0.01	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	4-5	>999	240	Weight: 9 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-4-3 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(lb/size) 3=95/ Mechanical, 4=35/ Mechanical, 5=224/0-3-8
Max Horiz 5=61 (LC 8)
Max Uplift 3=-51 (LC 8), 5=-33 (LC 8)
Max Grav 3=95 (LC 1), 4=59 (LC 3), 5=224 (LC 1)

FORCES


(lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-5=-197/63, 1-2=0/27, 2-3=-53/28
BOT CHORD 4-5=0/0

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 33 lb uplift at joint 5 and 51 lb uplift at joint 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Lot 115 RR
RR115	J20	Jack-Open	1	1	Job Reference (optional)

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:45 Page: 1

ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

11/30/2021

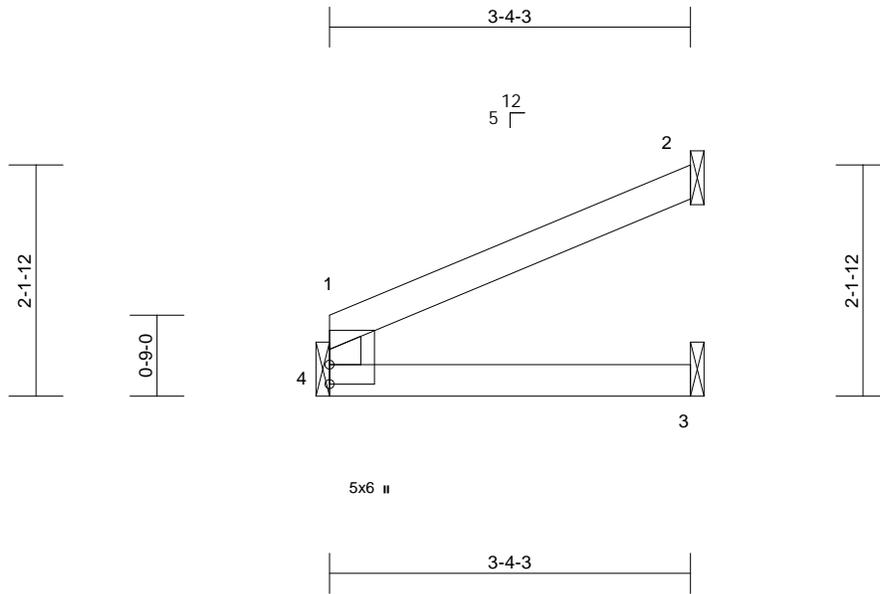

Scale = 1:21.3

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.15	Vert(LL)	0.00	3-4	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.09	Vert(CT)	-0.01	3-4	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.01	2	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.01	3-4	>999	240	Weight: 8 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-4-3 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(lb/size) 2=101/ Mechanical, 3=40/ Mechanical, 4=141/ Mechanical
Max Horiz 4=46 (LC 5)
Max Uplift 2=-52 (LC 8), 4=-7 (LC 8)
Max Grav 2=101 (LC 1), 3=60 (LC 3), 4=141 (LC 1)

FORCES


(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-4=-118/38, 1-2=-52/31
BOT CHORD 3-4=0/0

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 7 lb uplift at joint 4 and 52 lb uplift at joint 2.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job RR115	Truss J21	Truss Type Diagonal Hip Girder	Qty 2	Ply 1	Lot 115 RR Job Reference (optional)
--------------	--------------	-----------------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:45 Page: 1
 ID:BuWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDofJ4zJC7f

11/30/2021

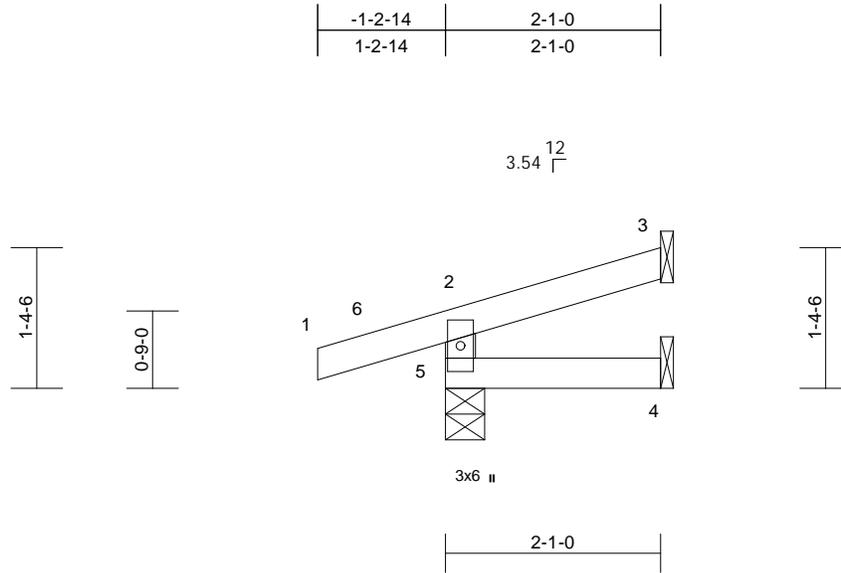

Scale = 1:22.2

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	0.00	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(CT)	0.00	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	4-5	>999	240	Weight: 7 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-1-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(lb/size) 3=21/ Mechanical, 4=-3/
 Mechanical, 5=71/0-4-9
 Max Horiz 5=43 (LC 7)
 Max Uplift 3=-24 (LC 12), 4=-6 (LC 19),
 5=-113 (LC 6)
 Max Grav 3=21 (LC 1), 4=17 (LC 3), 5=71
 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-5=-73/108, 1-2=-3/10, 2-3=-15/3
 BOT CHORD 4-5=0/0

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust)
 Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 113 lb uplift at joint 5, 24 lb uplift at joint 3 and 6 lb uplift at joint 4.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

- 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 14 lb down and 5 lb up at -1-2-14, and 14 lb down and 5 lb up at -1-2-14 on top chord. The design/selection of such connection device(s) is the responsibility of others.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Concentrated Loads (lb)
 Vert: 1=-21 (F=-11, B=-11)
 Trapezoidal Loads (lb/ft)
 Vert: 1=0 (F=35, B=35)-to-6=-18 (F=26, B=26), 6=0 (F=35, B=35)-to-2=-16 (F=27, B=27), 2=-16 (F=27, B=27)-to-3=-49 (F=10, B=10), 5=15 (F=18, B=18)-to-4=-10 (F=5, B=5)



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job RR115	Truss J22	Truss Type Jack-Open	Qty 3	Ply 1	Lot 115 RR Job Reference (optional)
--------------	--------------	-------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:46 Page: 1
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

11/30/2021

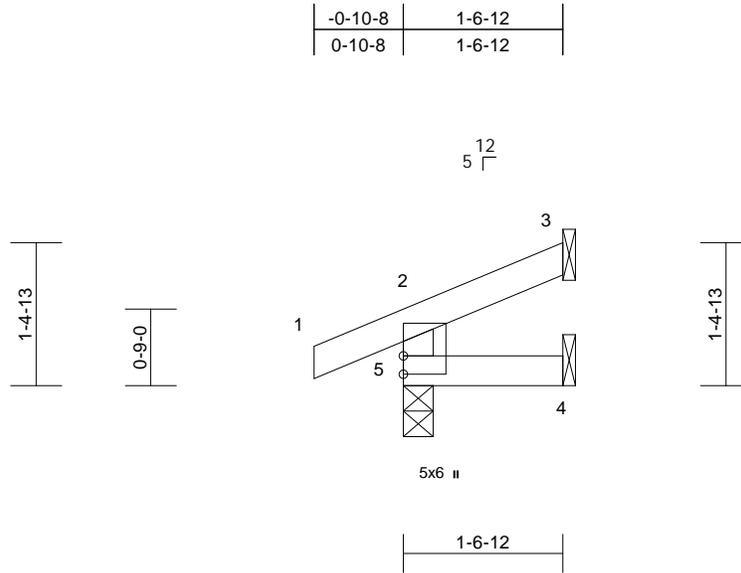

Scale = 1:22.5

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	0.00	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(CT)	0.00	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	4-5	>999	240	Weight: 5 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 1-6-12 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(lb/size) 3=29/ Mechanical, 4=8/ Mechanical, 5=161/0-3-8
 Max Horiz 5=36 (LC 5)
 Max Uplift 3=22 (LC 8), 5=35 (LC 4)
 Max Grav 3=29 (LC 1), 4=24 (LC 3), 5=161 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-5=-141/46, 1-2=0/27, 2-3=-27/7
 BOT CHORD 4-5=0/0

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 35 lb uplift at joint 5 and 22 lb uplift at joint 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job RR115	Truss J23	Truss Type Diagonal Hip Girder	Qty 2	Ply 1	Lot 115 RR Job Reference (optional)
--------------	--------------	-----------------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:46 Page: 1
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uLTxBGKWrcDofJ4zJC7f

11/30/2021

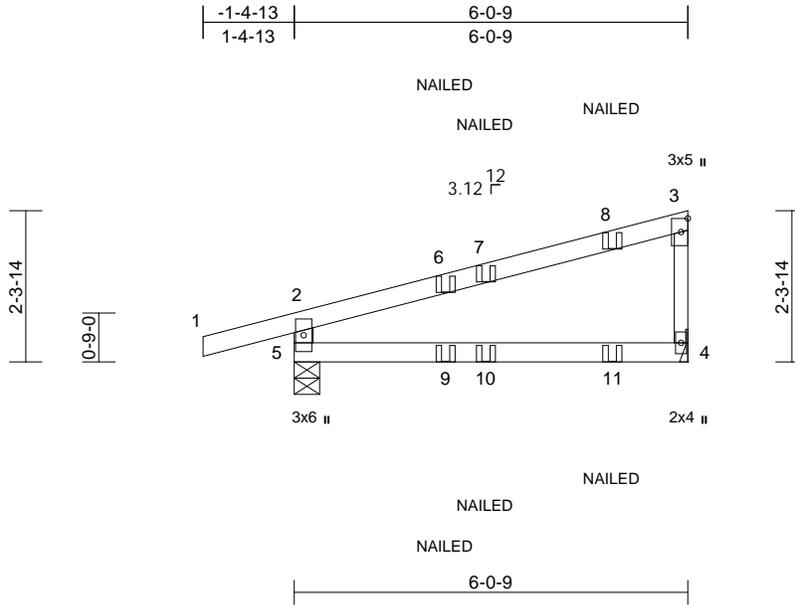

Scale = 1:35.2

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.48	Vert(LL)	-0.04	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.30	Vert(CT)	-0.09	4-5	>750	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.01	4-5	>999	240	Weight: 17 lb	FT = 10%

- LUMBER**
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2 *Except* 3-4:2x3 SPF No.2
- BRACING**
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
- REACTIONS** (lb/size) 4=253/ Mechanical, 5=384/0-4-11
 Max Horiz 5=92 (LC 7)
 Max Uplift 4=-59 (LC 8), 5=-118 (LC 4)
- FORCES** (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 2-5=-338/160, 1-2=0/27, 2-3=-145/15, 3-4=-178/87
 BOT CHORD 4-5=-29/69

- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 1-2=-70, 2-3=-70, 4-5=-20
 Concentrated Loads (lb)
 Vert: 8=-2 (B), 9=3 (B), 10=-1 (F), 11=-7 (B)

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 118 lb uplift at joint 5 and 59 lb uplift at joint 4.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) "NAILED" indicates 2-12d (0.148"x3.25") toe-nails per NDS guidelines.



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job RR115	Truss J24	Truss Type Jack-Open	Qty 2	Ply 1	Lot 115 RR Job Reference (optional)
--------------	--------------	-------------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
 148789154
LEE'S SUMMIT, MISSOURI

11/30/2021

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:48 Page: 1
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

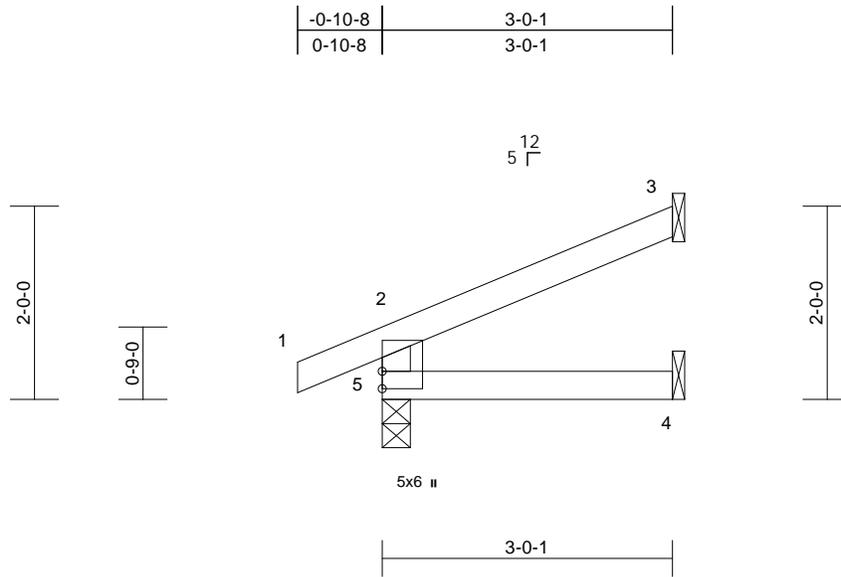

Scale = 1:23.7

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.10	Vert(LL)	0.00	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.06	Vert(CT)	-0.01	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	4-5	>999	240	Weight: 9 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-0-1 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(lb/size) 3=83/ Mechanical, 4=30/ Mechanical, 5=210/0-3-8
 Max Horiz 5=55 (LC 8)
 Max Uplift 3=-45 (LC 8), 5=-32 (LC 8)
 Max Grav 3=83 (LC 1), 4=52 (LC 3), 5=210 (LC 1)

FORCES


(lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-5=-184/59, 1-2=0/27, 2-3=-48/24
 BOT CHORD 4-5=0/0

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 32 lb uplift at joint 5 and 45 lb uplift at joint 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

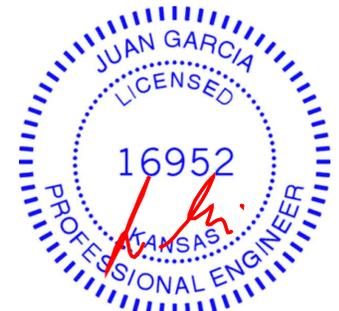

November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 115 RR
RR115	J25	Jack-Open	5	1	Job Reference (optional)

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:48
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7? Page: 1

11/30/2021

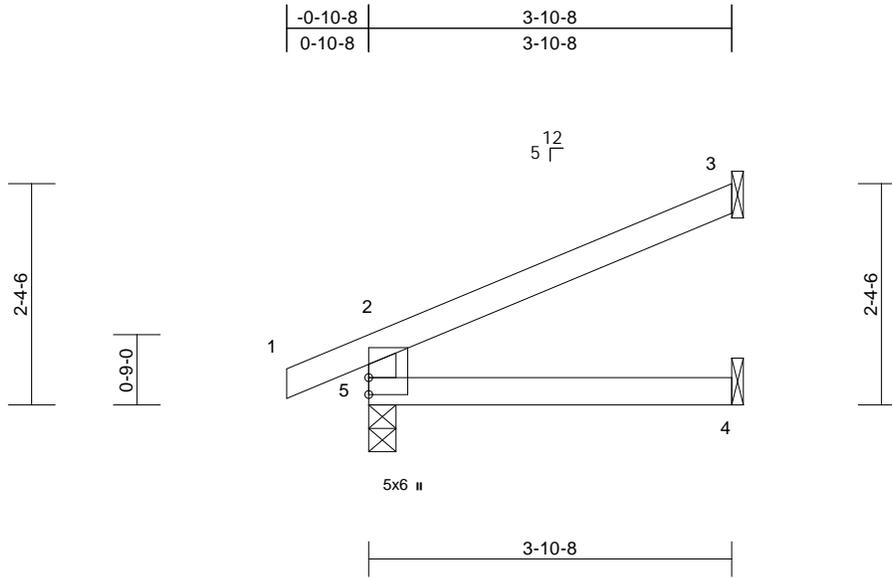

Scale = 1:24.5

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.19	Vert(LL)	-0.01	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.12	Vert(CT)	-0.02	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.01	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.01	4-5	>999	240	Weight: 11 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-10-8 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(lb/size) 3=112/ Mechanical, 4=43/ Mechanical, 5=246/0-3-8
 Max Horiz 5=70 (LC 8)
 Max Uplift 3=-59 (LC 8), 5=-35 (LC 8)
 Max Grav 3=112 (LC 1), 4=69 (LC 3), 5=246 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension
 TOP CHORD 2-5=-216/70, 1-2=0/27, 2-3=-61/33
 BOT CHORD 4-5=0/0

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 35 lb uplift at joint 5 and 59 lb uplift at joint 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 115 RR
RR115	J26	Jack-Open	2	1	Job Reference (optional)

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:48 Page: 1
 ID:bWuMdBNOtjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

11/30/2021

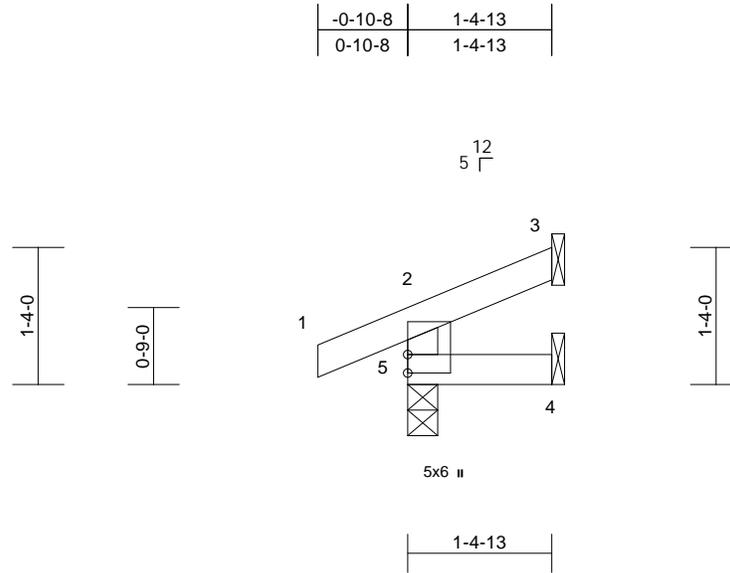

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	0.00	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(CT)	0.00	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	4-5	>999	240	Weight: 5 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 1-4-13 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 3=21/ Mechanical, 4=5/ Mechanical, 5=157/0-3-8
 Max Horiz 5=34 (LC 5)
 Max Uplift 3=-18 (LC 8), 5=-36 (LC 4)
 Max Grav 3=21 (LC 1), 4=21 (LC 3), 5=157 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 2-5=-137/46, 1-2=0/27, 2-3=-25/5
 BOT CHORD 4-5=0/0

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 36 lb uplift at joint 5 and 18 lb uplift at joint 3.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job RR115	Truss J27	Truss Type Jack-Open	Qty 2	Ply 1	Lot 115 RR Job Reference (optional)
--------------	--------------	-------------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789157
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:49 Page: 1
ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDofJ4zJC7f

11/30/2021

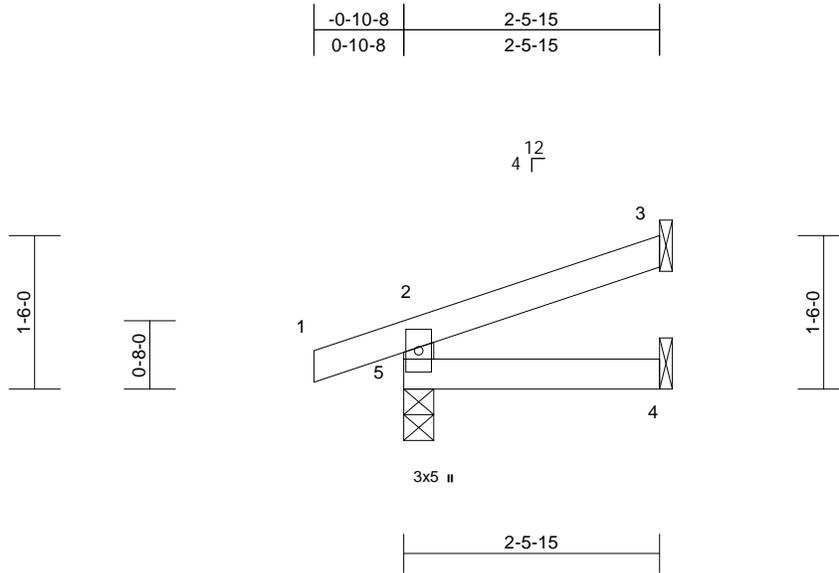

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	0.00	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(CT)	0.00	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	4-5	>999	240	Weight: 7 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2


BRACING
TOP CHORD Structural wood sheathing directly applied or 2-5-15 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 3=65/ Mechanical, 4=22/ Mechanical, 5=190/0-3-8
Max Horiz 5=43 (LC 4)
Max Uplift 3=-33 (LC 8), 5=-60 (LC 4)
Max Grav 3=65 (LC 1), 4=42 (LC 3), 5=190 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 2-5=-167/79, 1-2=0/23, 2-3=-32/15
BOT CHORD 4-5=0/0

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 60 lb uplift at joint 5 and 33 lb uplift at joint 3.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job RR115	Truss K1	Truss Type Hip Girder	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	--------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:49 Page: 1
 ID: bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrcDofJ4zJC7f

11/30/2021

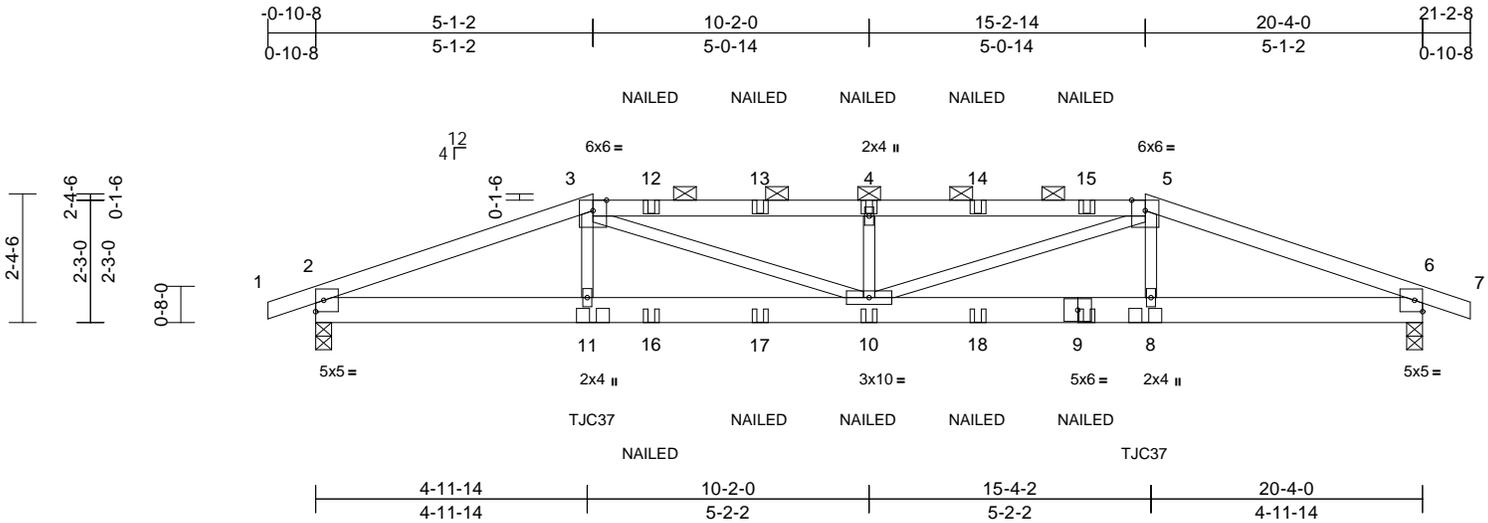

Scale = 1:42.1

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.93	Vert(LL)	-0.19	10	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	1.00	Vert(CT)	-0.34	10	>702	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.37	Horz(CT)	0.06	6	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.17	10	>999	240	Weight: 75 lb	FT = 10%

- LUMBER**
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x6 SPF No.2
 WEBS 2x3 SPF No.2
- BRACING**
 TOP CHORD Structural wood sheathing directly applied or 2-11-2 oc purlins, except 2-0-0 oc purlins (2-3-5 max.): 3-5.
 BOT CHORD Rigid ceiling directly applied or 9-4-6 oc bracing.
- REACTIONS** (lb/size) 2=1357/0-3-8, 6=1357/0-3-8
 Max Horiz 2=-34 (LC 13)
 Max Uplift 2=-333 (LC 4), 6=-333 (LC 5)
- FORCES** (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/1, 2-3=-3034/686, 3-4=-3658/855, 4-5=-3658/855, 5-6=-3033/686, 6-7=0/1
 BOT CHORD 2-11=-612/2766, 10-11=-611/2745, 8-10=-587/2744, 6-8=-588/2765
 WEBS 3-11=-19/396, 3-10=-253/1078, 4-10=-589/269, 5-10=-254/1078, 5-8=-19/395

- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use Simpson Strong-Tie TJC37 (4 nail 90-150) or equivalent at 5-1-2 from the left end to connect truss(es) to back face of bottom chord, skewed 51.3 deg.to the right, sloping 0.0 deg. down.
- Use Simpson Strong-Tie TJC37 (4 nail, 30-90) or equivalent at 15-2-14 from the left end to connect truss (es) to back face of bottom chord, skewed 51.3 deg.to the left, sloping 0.0 deg. down.
- Fill all nail holes where hanger is in contact with lumber.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 1-3=-70, 3-5=-70, 5-7=-70, 2-6=-20
 Concentrated Loads (lb)
 Vert: 9=-23 (B), 11=-221 (B), 10=-23 (B), 4=-42 (B), 8=-221 (B), 12=-42 (B), 13=-42 (B), 14=-42 (B), 15=-42 (B), 16=-23 (B), 17=-23 (B), 18=-23 (B)



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job RR115	Truss K2	Truss Type Hip	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	-------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:50 Page: 1
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

11/30/2021

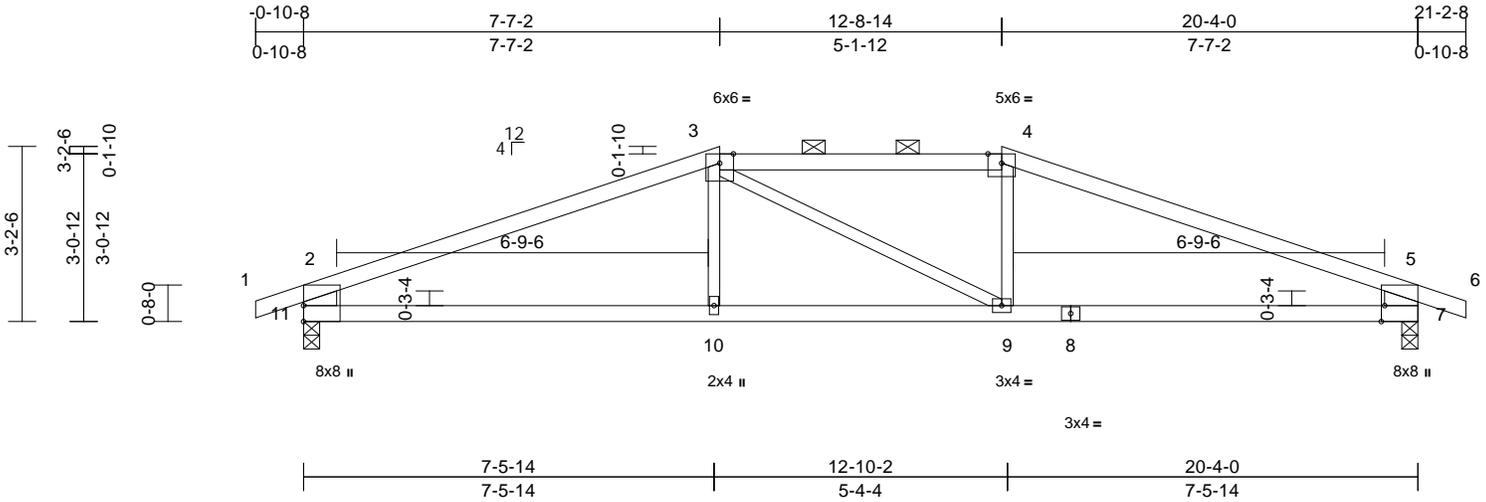

Scale = 1:41.8
 Plate Offsets (X, Y): [7:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.65	Vert(LL)	-0.12	9-10	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.59	Vert(CT)	-0.24	9-10	>990	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.17	Horz(CT)	0.05	7	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.08	9-10	>999	240	Weight: 60 lb	FT = 10%

- LUMBER**
- TOP CHORD 2x4 SPF 2100F 1.8E *Except* 3-4:2x4 SPF No.2
 - BOT CHORD 2x4 SPF No.2
 - WEBS 2x3 SPF No.2 *Except* 11-2,7-5:2x8 SP DSS
- BRACING**
- TOP CHORD Structural wood sheathing directly applied or 4-11-7 oc purlins, except end verticals, and 2-0-0 oc purlins (4-2-9 max.): 3-4.
 - BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
- REACTIONS** (lb/size)
- 7=970/0-3-8, 11=970/0-3-8
 - Max Horiz 11=33 (LC 12)
 - Max Uplift 7=-197 (LC 5), 11=-197 (LC 4)
- FORCES** (lb) - Maximum Compression/Maximum Tension
- TOP CHORD 1-2=0/26, 2-3=-1639/256, 3-4=-1460/278, 4-5=-1639/255, 5-6=0/26, 2-11=-881/241, 5-7=-882/241
 - BOT CHORD 10-11=-190/1464, 9-10=-193/1460, 7-9=-164/1464
 - WEBS 3-10=0/239, 3-9=-186/187, 4-9=0/239

- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 197 lb uplift at joint 11 and 197 lb uplift at joint 7.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard




November 15, 2021

Job RR115	Truss K3	Truss Type Common	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	----------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:50 Page: 1
 ID: bWuMdbN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDofJ4zJC7f

11/30/2021

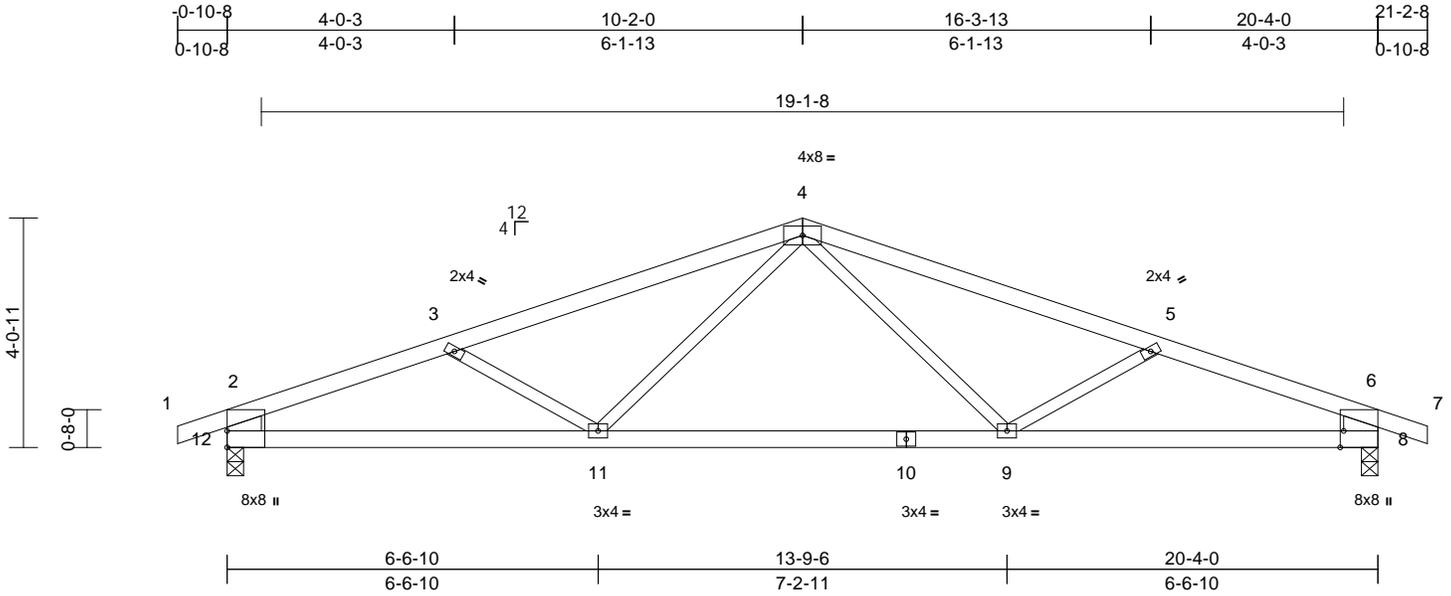

Scale = 1:40.5

Plate Offsets (X, Y): [8:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.81	Vert(LL)	-0.17	9-11	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.63	Vert(CT)	-0.32	9-11	>730	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.12	Horz(CT)	0.05	8	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.12	9-11	>999	240	Weight: 65 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF 2100F 1.8E
 BOT CHORD 2x4 SPF No.2
 WEBS 2x3 SPF No.2 *Except* 12-2,8-6:2x8 SP 2400F 2.0E

BRACING
 TOP CHORD Structural wood sheathing directly applied or 3-9-12 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 8=970/0-3-8, 12=970/0-3-8
 Max Horiz 12=49 (LC 9)
 Max Uplift 8=180 (LC 5), 12=180 (LC 4)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/26, 2-3=-1713/290, 3-4=-1502/196, 4-5=-1502/196, 5-6=-1713/290, 6-7=0/26, 2-12=-888/206, 6-8=-888/206
 BOT CHORD 11-12=-263/1537, 9-11=-105/1179, 8-9=-226/1537
 WEBS 4-9=-12/348, 5-9=-255/195, 4-11=-11/348, 3-11=-255/194

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 180 lb uplift at joint 12 and 180 lb uplift at joint 8.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job RR115	Truss K4	Truss Type COMMON GIRDER	Qty 1	Ply 3	Lot 115 RR Job Reference (optional)
--------------	-------------	-----------------------------	----------	----------	--

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
 148789161
LEE'S SUMMIT, MISSOURI

11/30/2021

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:51
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7?

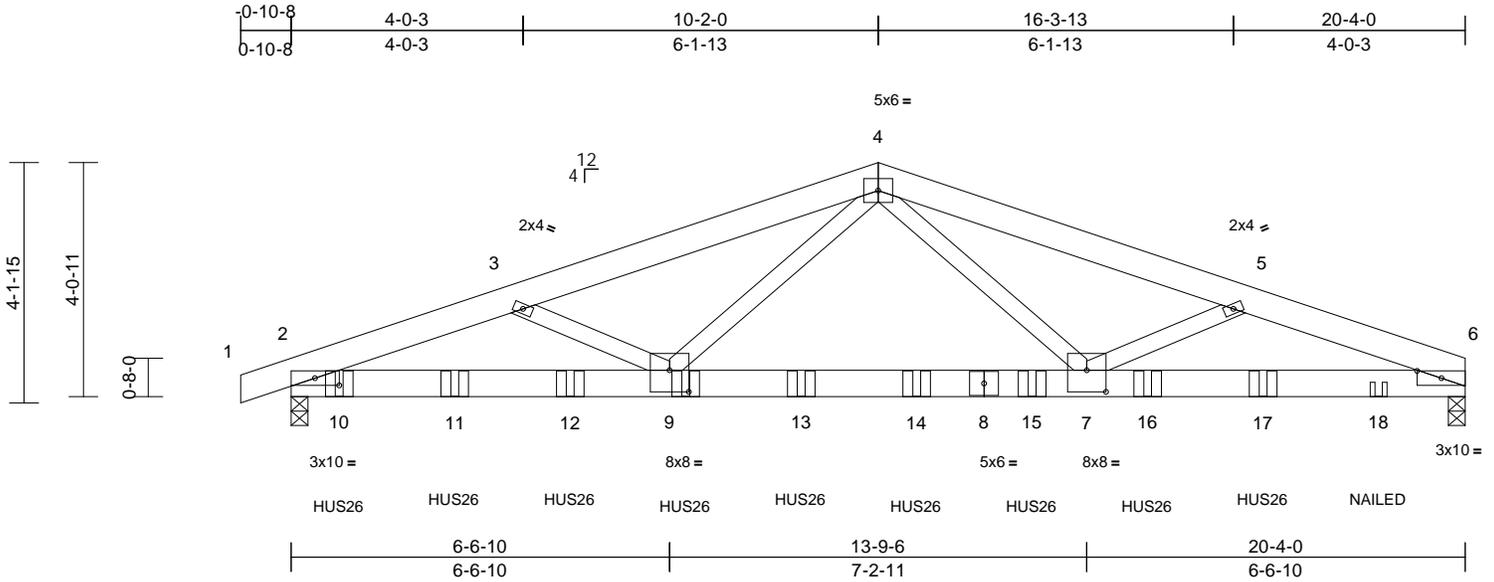

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.31	Vert(LL)	-0.13	7-9	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.56	Vert(CT)	-0.23	7-9	>999	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.39	Horz(CT)	0.04	6	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.07	7-9	>999	240	Weight: 317 lb	FT = 10%

LUMBER
 TOP CHORD 2x6 SPF No.2
 BOT CHORD 2x6 SP 2400F 2.0E
 WEBS 2x4 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 2=5495/0-3-8, 6=4987/0-3-8
 Max Horiz 2=67 (LC 8)
 Max Uplift 2=-263 (LC 4), 6=-185 (LC 5)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/7, 2-3=-10644/473, 3-4=-10818/350,
 4-5=-11173/223, 5-6=-10953/365
 BOT CHORD 2-9=-455/9870, 7-9=-166/7189,
 6-7=-313/10147
 WEBS 4-7=0/4786, 5-7=-4/796, 4-9=-142/4309,
 3-9=-24/719


NOTES

- 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-4-0 oc.
 Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 185 lb uplift at joint 6 and 263 lb uplift at joint 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Use Simpson Strong-Tie HUS26 (14-10d Girder, 4-10d Truss) or equivalent spaced at 2-0-0 oc max. starting at 0-10-0 from the left end to 14-10-0 to connect truss(es) to front face of bottom chord.
- Use Simpson Strong-Tie HUS26 (14-10d Girder, 6-10d Truss, Single Ply Girder) or equivalent at 16-10-0 from the left end to connect truss(es) to front face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 1-4=-70, 4-6=-70, 2-6=-20
 Concentrated Loads (lb)
 Vert: 9=-853 (F), 10=-865 (F), 11=-862 (F), 12=-853 (F), 13=-853 (F), 14=-853 (F), 15=-853 (F), 16=-854 (F), 17=-1641 (F), 18=-121 (F)



November 15, 2021


Job RR115	Truss LAY1	Truss Type GABLE	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	---------------	---------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789162
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:51
ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

11/30/2021

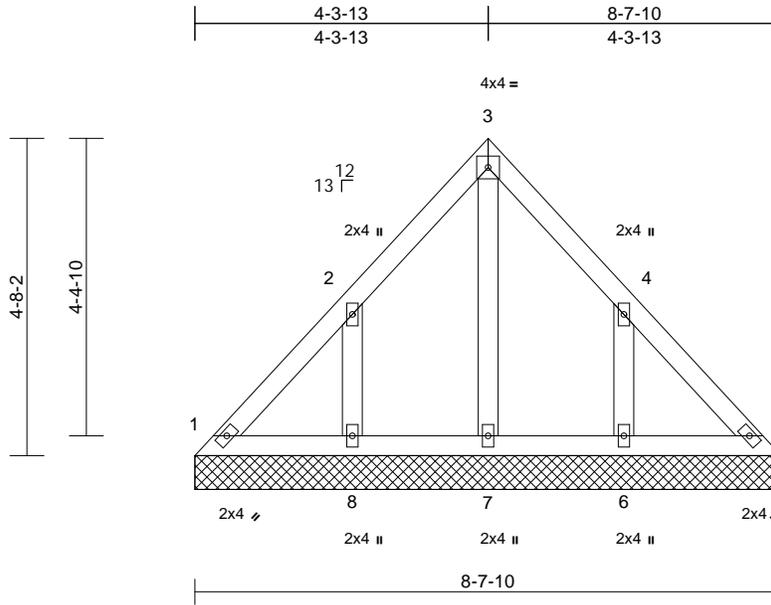

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.06	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 32 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size)
1=88/8-7-10, 5=88/8-7-10, 6=219/8-7-10, 7=103/8-7-10, 8=219/8-7-10
Max Horiz 1=115 (LC 5)
Max Uplift 1=-22 (LC 4), 5=-4 (LC 5), 6=-161 (LC 9), 8=-161 (LC 8)
Max Grav 1=112 (LC 16), 5=100 (LC 18), 6=250 (LC 16), 7=124 (LC 18), 8=250 (LC 15)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-122/96, 2-3=-100/86, 3-4=-91/69, 4-5=-106/75
BOT CHORD 1-8=-48/102, 7-8=-48/102, 6-7=-48/102, 5-6=-48/102
WEBS 3-7=-87/3, 2-8=-204/189, 4-6=-204/188

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) Gable studs spaced at 0-0-0 oc.

- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 22 lb uplift at joint 1, 4 lb uplift at joint 5, 161 lb uplift at joint 8 and 161 lb uplift at joint 6.
 - 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job RR115	Truss LAY2	Truss Type GABLE	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	---------------	---------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:52 Page: 1
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

11/30/2021

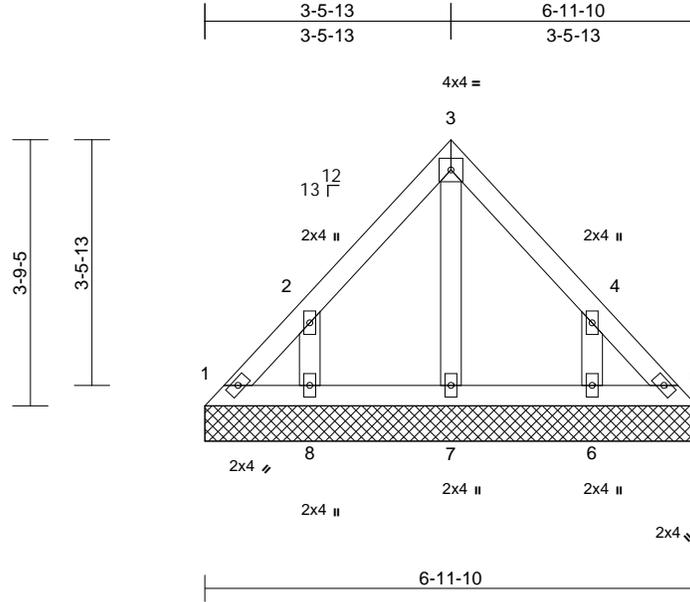

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.05	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 25 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 OTHERS 2x4 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 1=46/6-11-10, 5=46/6-11-10, 6=180/6-11-10, 7=113/6-11-10, 8=180/6-11-10
 Max Horiz 1=-91 (LC 4)
 Max Uplift 1=-33 (LC 6), 5=-18 (LC 7), 6=-137 (LC 9), 8=-137 (LC 8)
 Max Grav 1=79 (LC 17), 5=72 (LC 18), 6=206 (LC 16), 7=117 (LC 18), 8=206 (LC 15)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-109/80, 2-3=-97/68, 3-4=-90/55, 4-5=-96/60
 BOT CHORD 1-8=-36/76, 7-8=-36/76, 6-7=-36/76, 5-6=-36/76
 WEBS 3-7=-75/0, 2-8=-171/158, 4-6=-171/157

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCCL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) Gable studs spaced at 0-0-0 oc.

- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 33 lb uplift at joint 1, 18 lb uplift at joint 5, 137 lb uplift at joint 8 and 137 lb uplift at joint 6.
 - 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job RR115	Truss LAY3	Truss Type GABLE	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	---------------	---------------------	----------	----------	--


AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789164
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:53 Page: 1

ID:bWuMDBN0tF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uTXb6KWrcDofJ4zJC7f

11/30/2021

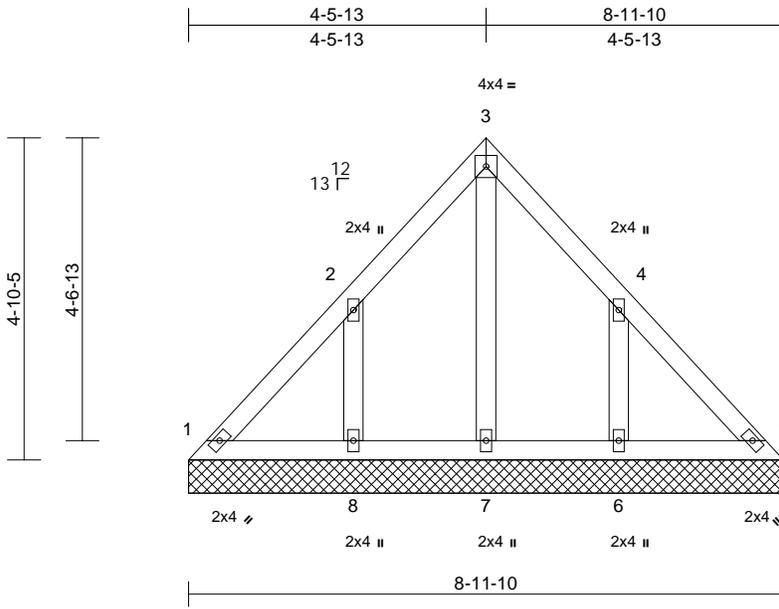

Scale = 1:34.6

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 34 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS (lb/size)
1=95/8-11-10, 5=95/8-11-10, 6=229/8-11-10, 7=100/8-11-10, 8=229/8-11-10
Max Horiz 1=120 (LC 5)
Max Uplift 1=-22 (LC 4), 5=-2 (LC 5), 6=-168 (LC 9), 8=-168 (LC 8)
Max Grav 1=118 (LC 16), 5=105 (LC 18), 6=261 (LC 16), 7=124 (LC 18), 8=261 (LC 15)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-126/100, 2-3=-100/90, 3-4=-91/72, 4-5=-109/80
BOT CHORD 1-8=-50/107, 7-8=-50/107, 6-7=-50/107, 5-6=-50/107
WEBS 3-7=-89/4, 2-8=-213/197, 4-6=-213/197

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) Gable studs spaced at 0-0-0 oc.

- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 22 lb uplift at joint 1, 2 lb uplift at joint 5, 168 lb uplift at joint 8 and 168 lb uplift at joint 6.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job RR115	Truss LAY4	Truss Type GABLE	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	---------------	---------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:53 Page: 1
 ID: bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITxb6KWrCDoTj4zJC7f

11/30/2021

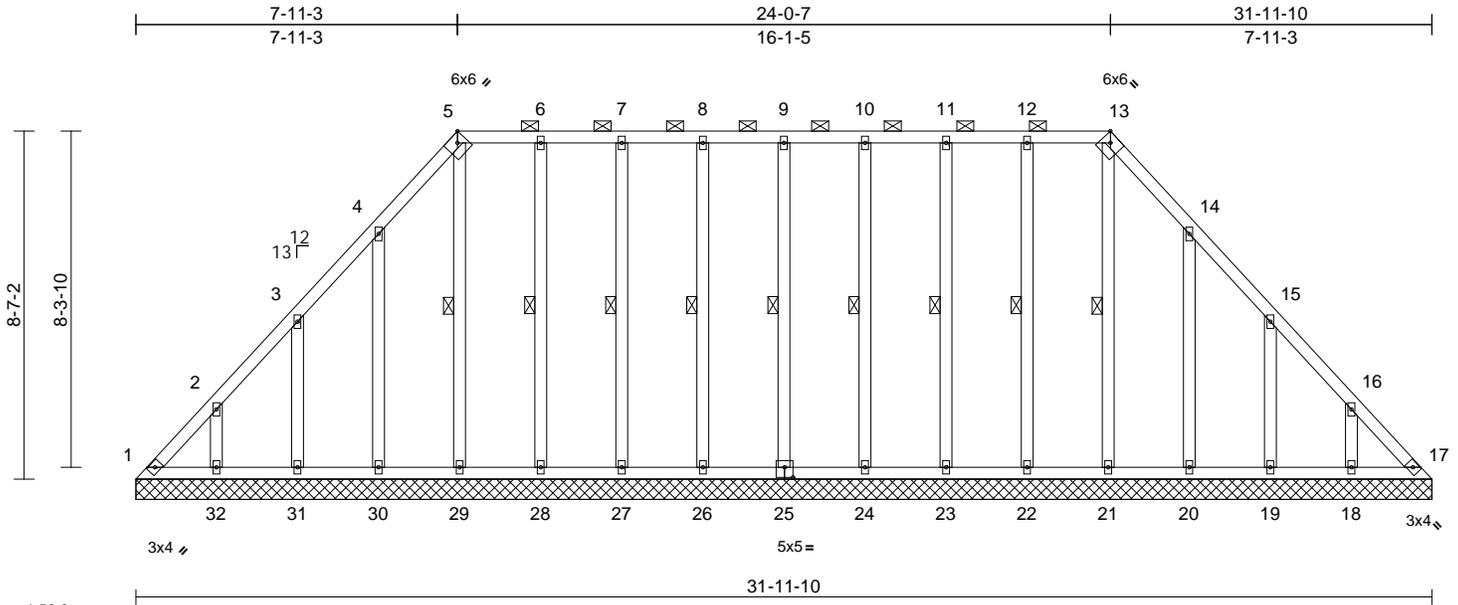

Scale = 1:56.6

Plate Offsets (X, Y): [5:0-2-9,Edge], [13:0-2-9,Edge], [25:0-2-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.06	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.11	Horiz(TL)	0.01	17	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S								
											Weight: 188 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 OTHERS 2x4 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 5-13.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

WEBS
 1 Row at midpt 9-25, 8-26, 7-27, 6-28, 5-29, 10-24, 11-23, 12-22, 13-21

REACTIONS (lb/size)
 1=78/31-11-10, 17=78/31-11-10, 18=183/31-11-10, 19=179/31-11-10, 20=185/31-11-10, 21=146/31-11-10, 22=189/31-11-10, 23=178/31-11-10, 24=180/31-11-10, 25=180/31-11-10, 26=180/31-11-10, 27=178/31-11-10, 28=189/31-11-10, 29=146/31-11-10, 30=185/31-11-10, 31=179/31-11-10, 32=183/31-11-10
 Max Horiz 1=221 (LC 5)
 Max Uplift 1=-113 (LC 6), 17=-48 (LC 7), 18=-131 (LC 9), 19=-130 (LC 9), 20=-134 (LC 9), 22=-39 (LC 5), 23=-34 (LC 4), 24=-34 (LC 5), 25=-34 (LC 5), 26=-34 (LC 5), 27=-34 (LC 4), 28=-36 (LC 5), 29=-23 (LC 5), 30=-135 (LC 8), 31=-130 (LC 8), 32=-131 (LC 8)

FORCES
 (lb) - Maximum Compression/Maximum Tension

TOP CHORD
 1-2=-284/215, 2-3=-172/166, 3-4=-146/137, 4-5=-120/206, 5-6=-43/159, 6-7=-42/159, 7-8=-42/159, 8-9=-42/159, 9-10=-41/159, 10-11=-41/159, 11-12=-41/159, 12-13=-43/159, 13-14=-93/182, 14-15=-81/73, 15-16=-120/78, 16-17=-226/126

BOT CHORD
 1-32=-87/180, 31-32=-87/180, 30-31=-87/180, 29-30=-87/180, 28-29=-87/179, 27-28=-87/179, 26-27=-87/179, 24-26=-87/179, 23-24=-87/179, 22-23=-87/179, 21-22=-87/179, 20-21=-87/179, 19-20=-87/179, 18-19=-87/179, 17-18=-87/179

WEBS
 9-25=-140/58, 8-26=-140/58, 7-27=-138/58, 6-28=-152/60, 5-29=-146/54, 4-30=-174/159, 3-31=-164/155, 2-32=-163/149, 10-24=-140/58, 11-23=-138/58, 12-22=-152/63, 13-21=-120/2, 14-20=-172/158, 15-19=-165/156, 16-18=-163/149

NOTES
 1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face); see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI-1.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 0-8-0-6-0-162101
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.



November 15, 2021

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI-1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 115 RR
RR115	LAY4	GABLE	1	1	Job Reference (optional)

RELEASE FOR CONSTRUCTION

AS NOTED FOR PLAN REVIEW

DEVELOPMENT SERVICES

148789165

LEE'S SUMMIT, MISSOURI

11/30/2021

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. File Nov 12 12:30:53 Page: 2
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDofJ4zJC?

- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 113 lb uplift at joint 1, 48 lb uplift at joint 17, 34 lb uplift at joint 25, 34 lb uplift at joint 26, 34 lb uplift at joint 27, 36 lb uplift at joint 28, 23 lb uplift at joint 29, 135 lb uplift at joint 30, 130 lb uplift at joint 31, 131 lb uplift at joint 32, 34 lb uplift at joint 24, 34 lb uplift at joint 23, 39 lb uplift at joint 22, 134 lb uplift at joint 20, 130 lb uplift at joint 19 and 131 lb uplift at joint 18.
- 11) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job RR115	Truss LAY5	Truss Type Lay-In Gable	Qty 2	Ply 1	Lot 115 RR Job Reference (optional)
--------------	---------------	----------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:53
 ID: bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDofJ4zJC7f

11/30/2021

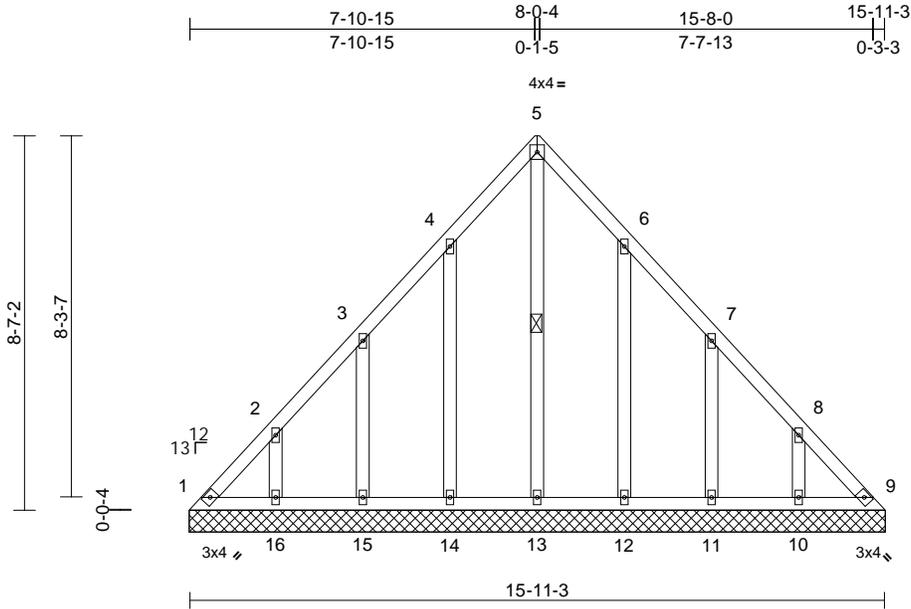

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.06	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.11	Horiz(TL)	0.01	9	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 79 lb	FT = 10%

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
OTHERS	2x4 SPF No.2

WEBS

5-13	=173/21, 4-14	=176/155,
3-15	=164/156, 2-16	=163/149,
6-12	=174/154, 7-11	=165/157,
8-10	=163/149	

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	1 Row at midpt 5-13

REACTIONS (lb/size)

1=81/15-11-10, 9=81/15-11-10,	
10=183/15-11-10,	
11=179/15-11-10,	
12=187/15-11-10,	
13=120/15-11-10,	
14=187/15-11-10,	
15=179/15-11-10, 16=183/15-11-10	
Max Horiz	1=-222 (LC 4)
Max Uplift	1=-95 (LC 6), 9=-59 (LC 7),
	10=-131 (LC 9), 11=-132 (LC 9),
	12=-130 (LC 9), 14=-132 (LC 8),
	15=-131 (LC 8), 16=-131 (LC 8)
Max Grav	1=205 (LC 8), 9=181 (LC 9),
	10=209 (LC 16), 11=204 (LC 16),
	12=214 (LC 16), 13=197 (LC 9),
	14=216 (LC 15), 15=203 (LC 15),
	16=209 (LC 15)

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 95 lb uplift at joint 1, 59 lb uplift at joint 9, 132 lb uplift at joint 14, 131 lb uplift at joint 15, 131 lb uplift at joint 16, 130 lb uplift at joint 12, 132 lb uplift at joint 11 and 131 lb uplift at joint 10.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD	1-2=-295/189, 2-3=-171/141, 3-4=-138/103,
	4-5=-111/166, 5-6=-89/143, 6-7=-101/64,
	7-8=-143/92, 8-9=-262/140
BOT CHORD	1-16=-96/204, 15-16=-96/204,
	14-15=-96/204, 13-14=-96/204,
	12-13=-96/204, 11-12=-96/204,
	10-11=-96/204, 9-10=-96/204

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job RR115	Truss LAY6	Truss Type Lay-In Gable	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	---------------	----------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:54
 ID: bWuMDBN0jF5cDvSpwhP1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXbKwRcDofrJ4zJC7f

11/30/2021

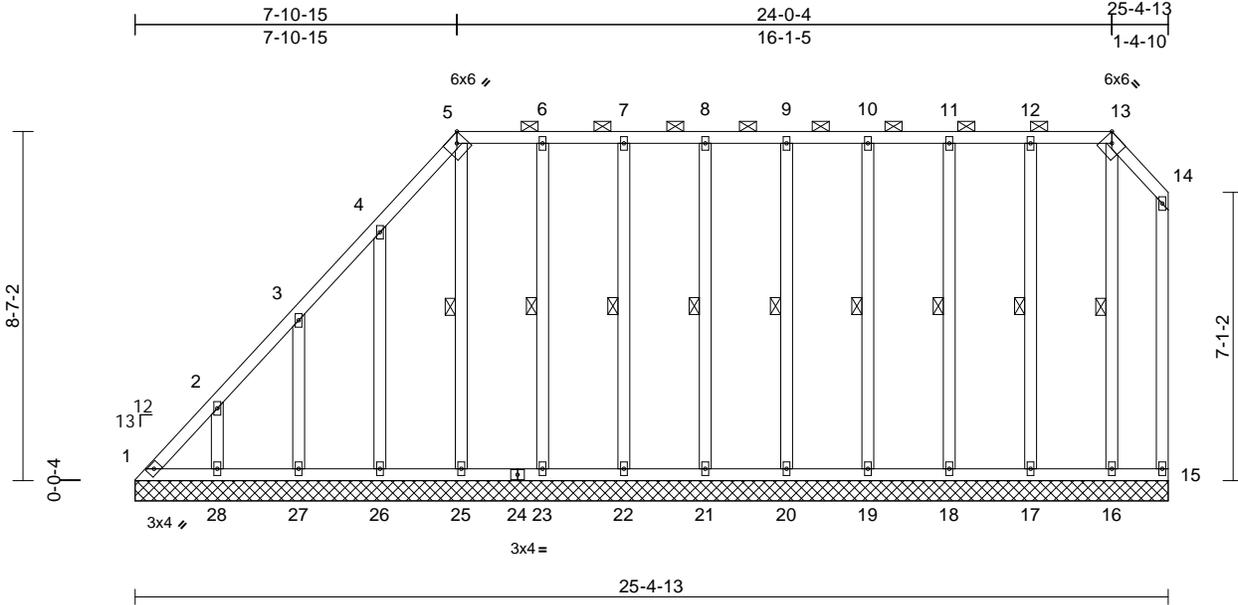

Scale = 1:56.4

Plate Offsets (X, Y): [5:0-2-9,Edge], [13:0-2-9,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.25	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.09	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.11	Horiz(TL)	0.00	15	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 166 lb	FT = 10%

LUMBER	
TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x4 SPF No.2
OTHERS	2x4 SPF No.2

BRACING	
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-13.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	1 Row at midpt 13-16, 12-17, 11-18, 10-19, 9-20, 8-21, 7-22, 6-23, 5-25

REACTIONS	(lb/size)
Max Horiz	1=311 (LC 5)
Max Uplift	1=141 (LC 6), 15=78 (LC 4), 16=36 (LC 5), 17=48 (LC 5), 18=38 (LC 4), 19=34 (LC 5), 20=34 (LC 4), 21=34 (LC 5), 22=34 (LC 4), 23=42 (LC 5), 25=98 (LC 5), 26=133 (LC 8), 27=130 (LC 8), 28=133 (LC 8)
Max Grav	1=254 (LC 5), 15=123 (LC 7), 16=144 (LC 22), 17=192 (LC 21), 18=178 (LC 21), 19=180 (LC 1), 20=180 (LC 21), 21=180 (LC 1), 22=177 (LC 1), 23=195 (LC 22), 25=180 (LC 15), 26=212 (LC 15), 27=203 (LC 15), 28=212 (LC 15)

FORCES	(lb) - Maximum Compression/Maximum Tension
--------	--

TOP CHORD	
1-2=	348/255, 2-3=278/205, 3-4=239/179, 4-5=201/161, 5-6=117/105, 6-7=116/106, 7-8=116/106, 8-9=116/106, 9-10=116/106, 10-11=116/106, 11-12=116/106, 12-13=117/105, 13-14=200/159, 14-15=183/135
BOT CHORD	
1-28=	102/77, 27-28=102/77, 26-27=102/77, 25-26=102/77, 23-25=100/76, 22-23=100/76, 21-22=100/76, 20-21=100/76, 19-20=100/76, 18-19=100/76, 17-18=100/76, 16-17=100/76, 15-16=100/76
WEBS	
13-16=	114/142, 12-17=151/66, 11-18=139/59, 10-19=140/58, 9-20=140/58, 8-21=140/58, 7-22=137/58, 6-23=155/66, 5-25=141/132, 4-26=171/157, 3-27=164/155, 2-28=166/151

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCdL=6.0psf; BCdL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Provide adequate drainage to prevent water ponding.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 141 lb uplift at joint 1, 78 lb uplift at joint 15, 36 lb uplift at joint 16, 48 lb uplift at joint 17, 38 lb uplift at joint 18, 34 lb uplift at joint 19, 34 lb uplift at joint 20, 34 lb uplift at joint 21, 34 lb uplift at joint 22, 42 lb uplift at joint 23, 98 lb uplift at joint 25, 133 lb uplift at joint 26, 130 lb uplift at joint 27 and 133 lb uplift at joint 28.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.4.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSITPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

Job RR115	Truss LAY7	Truss Type Lay-In Gable	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	---------------	----------------------------	----------	----------	--


RELEASE FOR CONSTRUCTION

AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789168
LEE'S SUMMIT, MISSOURI

11/30/2021

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:54
ID: bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RFC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDofJ4zJC7f

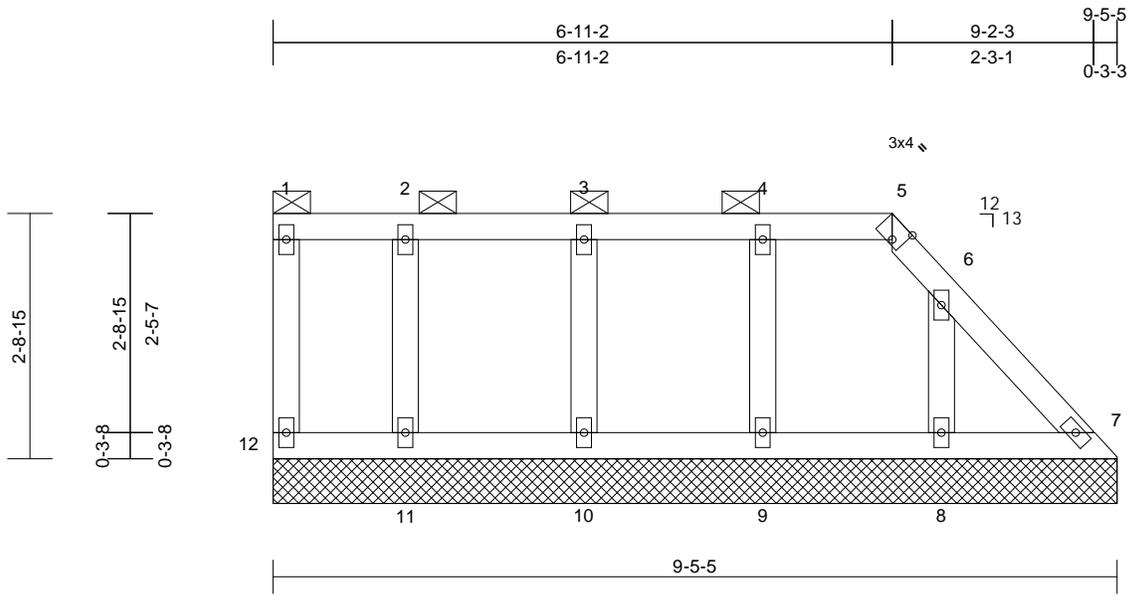

Scale = 1:25.7

Plate Offsets (X, Y): [5:0-1-7,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.05	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.02	Horiz(TL)	0.00	7	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 34 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-5.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS (lb/size)
7=59/9-5-5, 8=180/9-5-5,
9=179/9-5-5, 10=185/9-5-5,
11=160/9-5-5, 12=46/9-5-5
Max Horiz 12=-98 (LC 4)
Max Uplift 7=-17 (LC 5), 8=-78 (LC 9), 9=-40 (LC 4), 10=-36 (LC 5), 11=-33 (LC 5), 12=-14 (LC 4)
Max Grav 7=91 (LC 15), 8=192 (LC 16), 9=179 (LC 1), 10=185 (LC 1), 11=160 (LC 1), 12=46 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-12=-35/17, 1-2=-32/26, 2-3=-32/26, 3-4=-32/26, 4-5=-32/26, 5-6=-61/31, 6-7=-92/79
BOT CHORD 11-12=-49/75, 10-11=-49/75, 9-10=-49/75, 8-9=-49/75, 7-8=-49/75
WEBS 2-11=-125/53, 3-10=-143/62, 4-9=-140/65, 6-8=-146/94

NOTES
1) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 14 lb uplift at joint 12, 17 lb uplift at joint 7, 33 lb uplift at joint 11, 36 lb uplift at joint 10, 40 lb uplift at joint 9 and 78 lb uplift at joint 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job RR115	Truss LAY8	Truss Type GABLE	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	---------------	---------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:55
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITxb6KWrcDofJ4zJC7f

11/30/2021

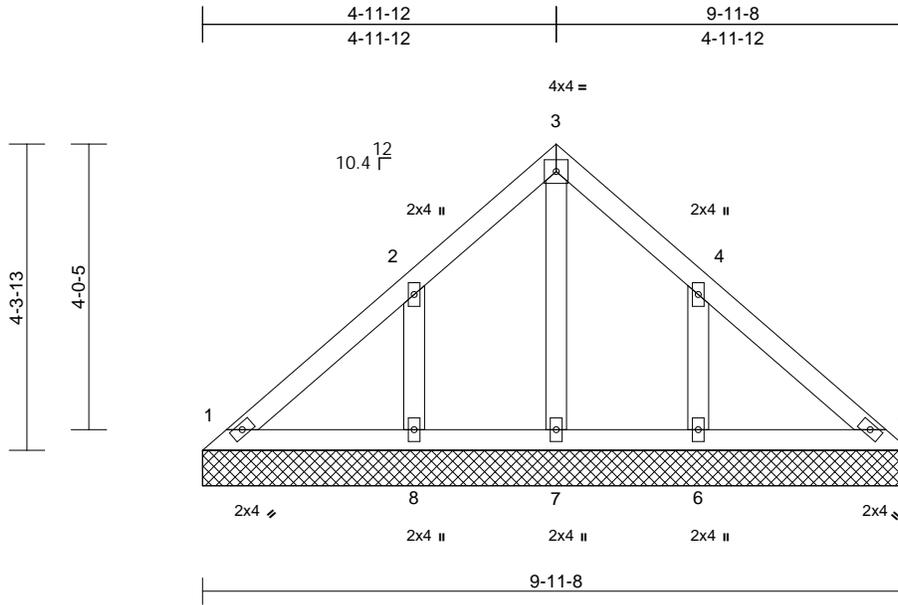

Scale = 1:32.3

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.08	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 34 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 OTHERS 2x4 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size)
 1=108/9-11-8, 5=108/9-11-8,
 6=254/9-11-8, 7=101/9-11-8,
 8=254/9-11-8
 Max Horiz 1=-104 (LC 4)
 Max Uplift 1=-8 (LC 4), 6=-134 (LC 9), 8=-134 (LC 8)
 Max Grav 1=117 (LC 16), 5=108 (LC 1),
 6=274 (LC 16), 7=120 (LC 18),
 8=274 (LC 15)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-100/88, 2-3=-87/88, 3-4=-80/74,
 4-5=-83/66
 BOT CHORD 1-8=-38/84, 7-8=-38/84, 6-7=-38/84,
 5-6=-38/84
 WEBS 3-7=-91/0, 2-8=-210/158, 4-6=-210/158

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) Gable studs spaced at 0-0-0 oc.

- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 8 lb uplift at joint 1, 134 lb uplift at joint 8 and 134 lb uplift at joint 6.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job RR115	Truss V1	Truss Type Valley	Qty 2	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	----------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. File Nov 12 12:30:55 Page: 1
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

11/30/2021

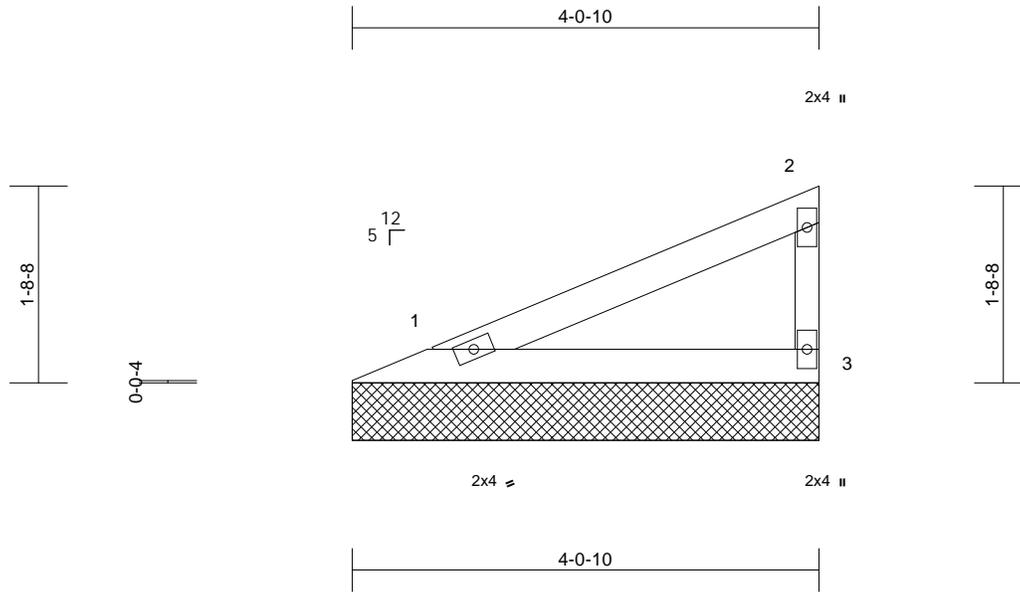

Scale = 1:19.9

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.19	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.10	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 10 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x3 SPF No.2

8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING
 TOP CHORD Structural wood sheathing directly applied or 4-1-4 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 1=146/4-0-10, 3=146/4-0-10
 Max Horiz 1=60 (LC 5)
 Max Uplift 1=-21 (LC 8), 3=-33 (LC 8)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-53/35, 2-3=-114/53
 BOT CHORD 1-3=-19/15

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) Gable requires continuous bottom chord bearing.
 - 4) Gable studs spaced at 4-0-0 oc.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 21 lb uplift at joint 1 and 33 lb uplift at joint 3.



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job RR115	Truss V2	Truss Type Valley	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	----------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:56
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f Page: 1

11/30/2021

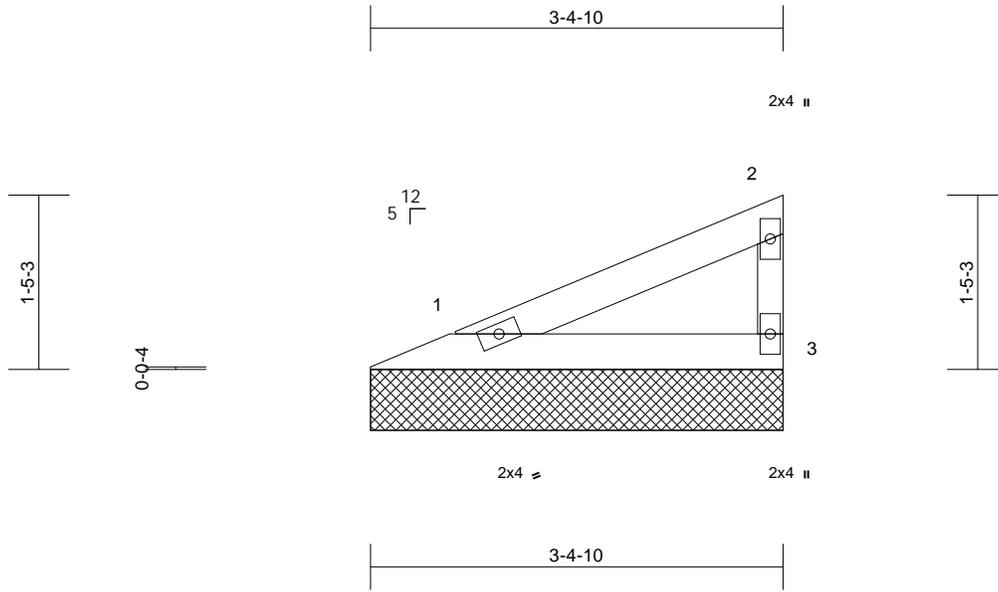

Scale = 1:18.8

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.11	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.06	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 8 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x3 SPF No.2

8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING
 TOP CHORD Structural wood sheathing directly applied or 3-5-4 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 1=116/3-4-10, 3=116/3-4-10
 Max Horiz 1=47 (LC 5)
 Max Uplift 1=-17 (LC 8), 3=-26 (LC 8)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-42/28, 2-3=-90/42
 BOT CHORD 1-3=-15/12

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) Gable requires continuous bottom chord bearing.
 - 4) Gable studs spaced at 4-0-0 oc.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 17 lb uplift at joint 1 and 26 lb uplift at joint 3.



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job RR115	Truss V3	Truss Type Valley	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	----------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:56
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

11/30/2021

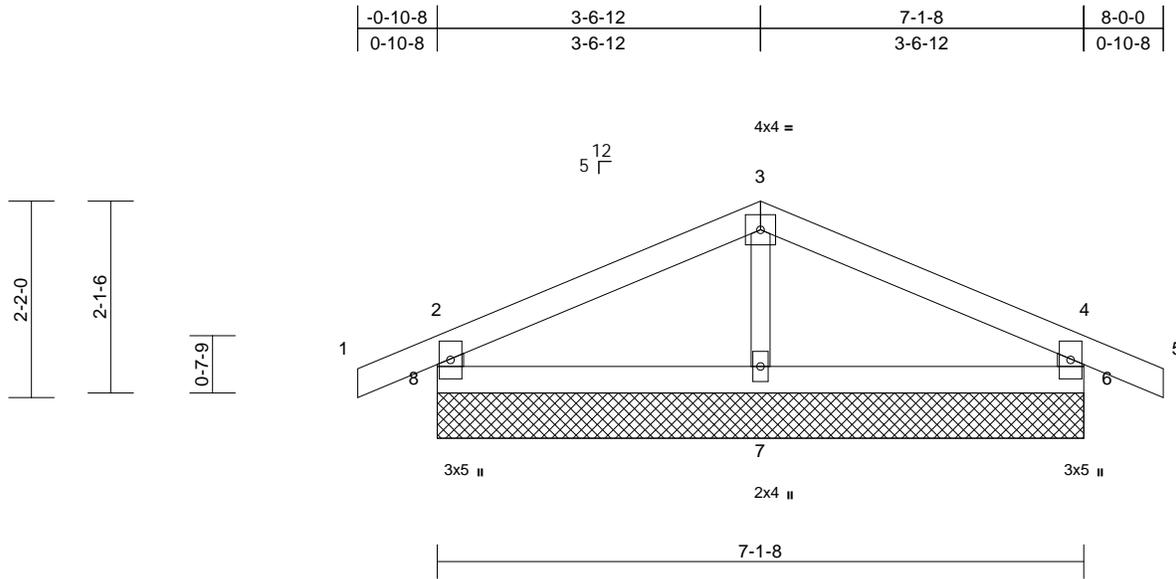

Scale = 1:25.3

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.12	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.10	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00	6	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R							Weight: 21 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2
 OTHERS 2x3 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 6=265/7-1-8, 7=227/7-1-8, 8=265/7-1-8
 Max Horiz 8=-19 (LC 13)
 Max Uplift 6=-76 (LC 9), 8=-74 (LC 8)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 2-8=-238/94, 1-2=0/27, 2-3=-149/71, 3-4=-149/68, 4-5=0/27, 4-6=-238/96
 BOT CHORD 7-8=-24/92, 6-7=-24/92
 WEBS 3-7=-145/23

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 6) Gable studs spaced at 4-0-0 oc.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 74 lb uplift at joint 8 and 76 lb uplift at joint 6.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

MiTek
 16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job RR115	Truss V4	Truss Type Valley	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	----------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789173
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:57
ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrcDofJ4zJC7? Page: 1

11/30/2021

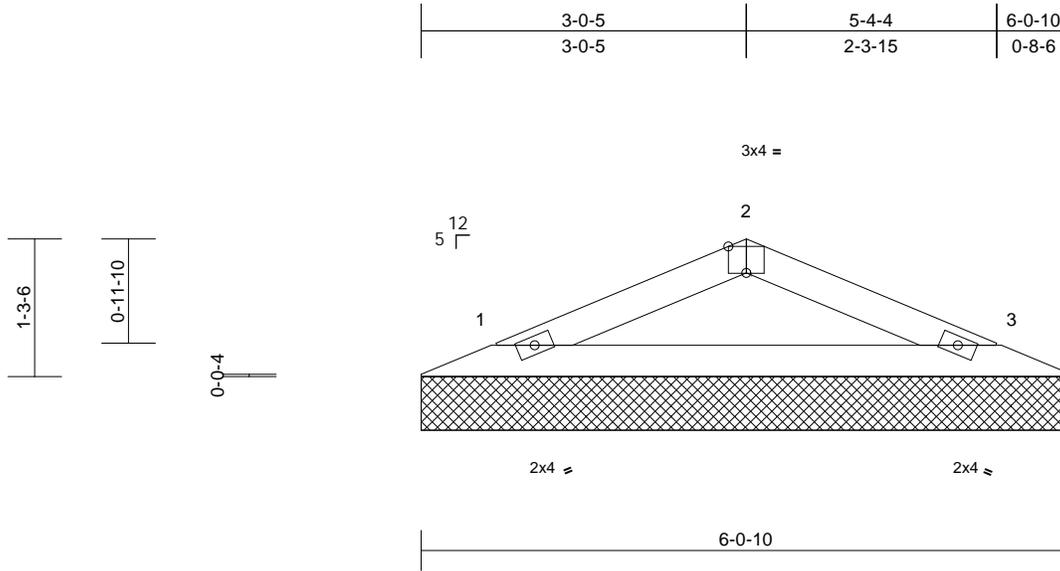

Scale = 1:21.3

Plate Offsets (X, Y): [2:0-2-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.09	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.23	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 13 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 1=209/6-0-10, 3=209/6-0-10
Max Horiz 1=-17 (LC 13)
Max Uplift 1=-27 (LC 8), 3=-27 (LC 9)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-235/69, 2-3=-235/69
BOT CHORD 1-3=-48/193

9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
LOAD CASE(S) Standard

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) Gable studs spaced at 4-0-0 oc.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 27 lb uplift at joint 1 and 27 lb uplift at joint 3.



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSITPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job RR115	Truss V5	Truss Type Valley	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	----------------------	----------	----------	--


AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 148789174 LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:57 Page: 1

ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

11/30/2021

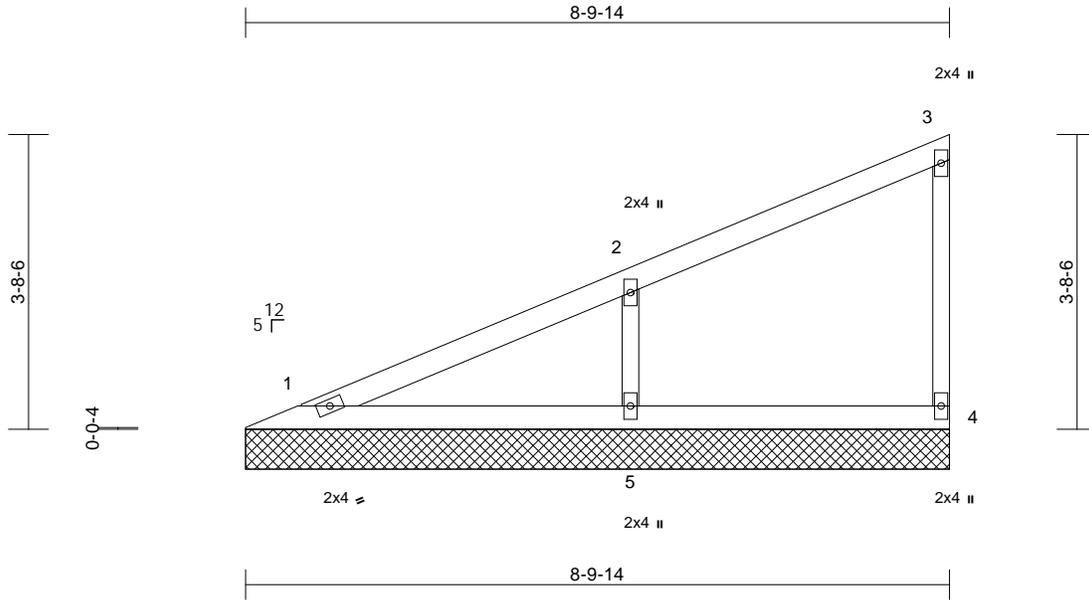

Scale = 1:28.7

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.26	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.13	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.07	Horiz(TL)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 24 lb	FT = 10%

- LUMBER**
- TOP CHORD 2x4 SPF No.2
 - BOT CHORD 2x4 SPF No.2
 - WEBS 2x3 SPF No.2
 - OTHERS 2x3 SPF No.2

- BRACING**
- TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 - BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


- REACTIONS** (lb/size)
- 1=142/8-9-14, 4=129/8-9-14, 5=451/8-9-14
 - Max Horiz 1=146 (LC 5)
 - Max Uplift 4=-23 (LC 5), 5=-120 (LC 8)

- FORCES** (lb) - Maximum Compression/Maximum Tension
- TOP CHORD 1-2=-115/69, 2-3=-101/28, 3-4=-100/40
 - BOT CHORD 1-5=-48/36, 4-5=-48/36
 - WEBS 2-5=-351/180

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) Gable requires continuous bottom chord bearing.
 - 4) Gable studs spaced at 4-0-0 oc.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 23 lb uplift at joint 4 and 120 lb uplift at joint 5.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job RR115	Truss V6	Truss Type Valley	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	----------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:58
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7? Page: 1

11/30/2021

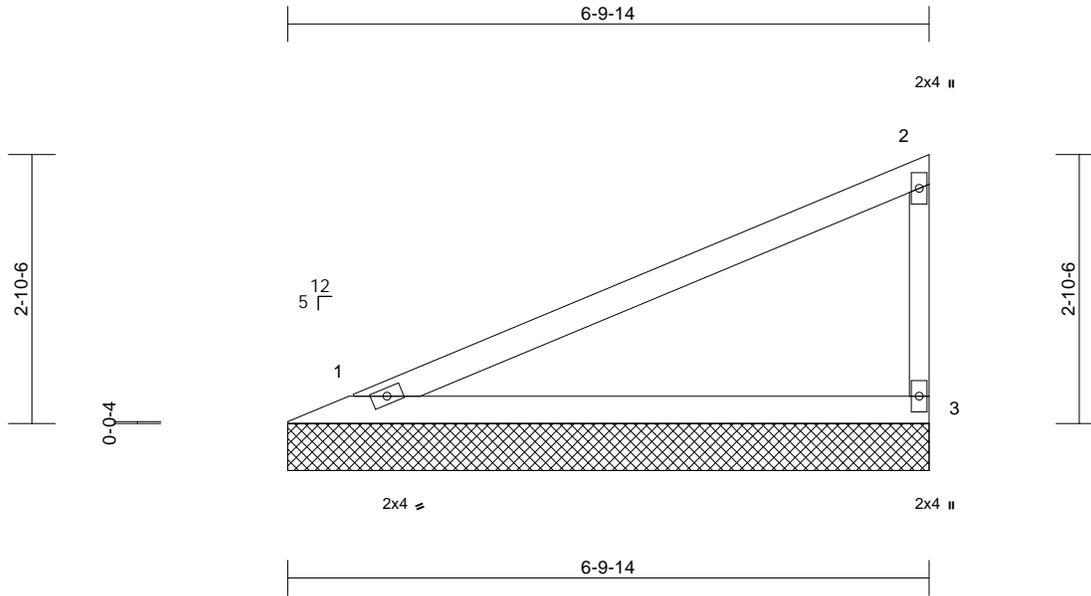

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.72	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.39	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 17 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x3 SPF No.2

8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


LOAD CASE(S) Standard

BRACING
 TOP CHORD Structural wood sheathing directly applied or 6-10-8 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 1=271/6-9-14, 3=271/6-9-14
 Max Horiz 1=110 (LC 5)
 Max Uplift 1=-40 (LC 8), 3=-62 (LC 8)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-98/65, 2-3=-211/98
 BOT CHORD 1-3=-36/27

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) Gable requires continuous bottom chord bearing.
 - 4) Gable studs spaced at 4-0-0 oc.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 40 lb uplift at joint 1 and 62 lb uplift at joint 3.

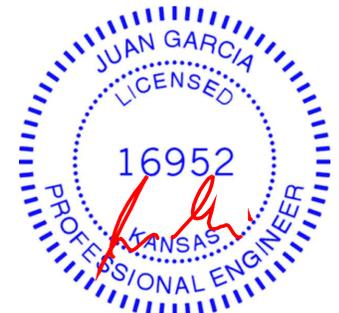

November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job RR115	Truss V8	Truss Type Valley	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	----------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:58
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

11/30/2021

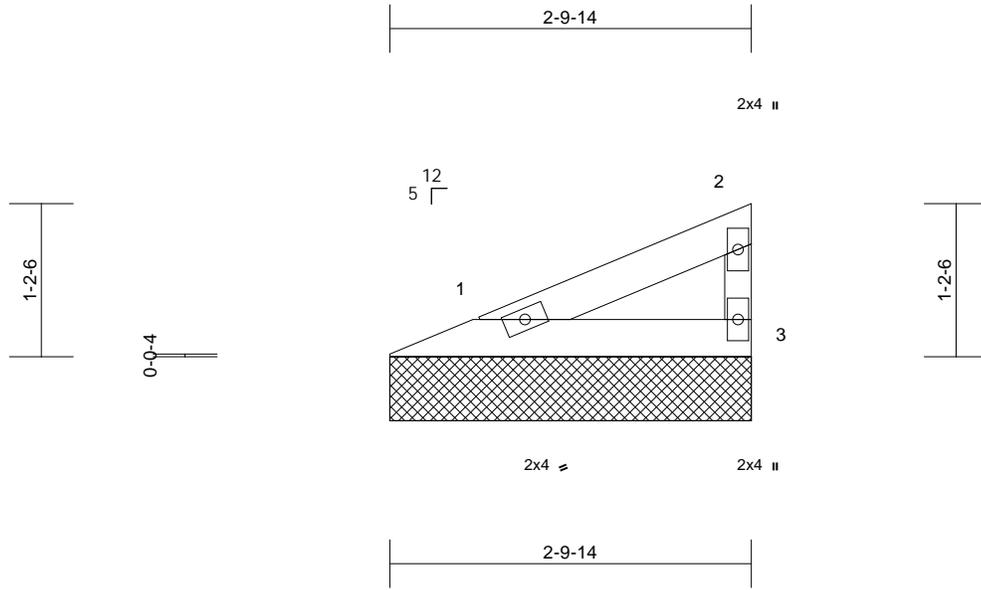

Scale = 1:17.9

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 6 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x3 SPF No.2

8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING
 TOP CHORD Structural wood sheathing directly applied or 2-10-8 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 1=91/2-9-14, 3=91/2-9-14
 Max Horiz 1=37 (LC 5)
 Max Uplift 1=-13 (LC 8), 3=-21 (LC 8)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-33/22, 2-3=-71/33
 BOT CHORD 1-3=-12/9

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) Gable requires continuous bottom chord bearing.
 - 4) Gable studs spaced at 4-0-0 oc.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 13 lb uplift at joint 1 and 21 lb uplift at joint 3.



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job RR115	Truss V9	Truss Type Valley	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	-------------	----------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
148789178
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:58
ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7? Page: 1

11/30/2021

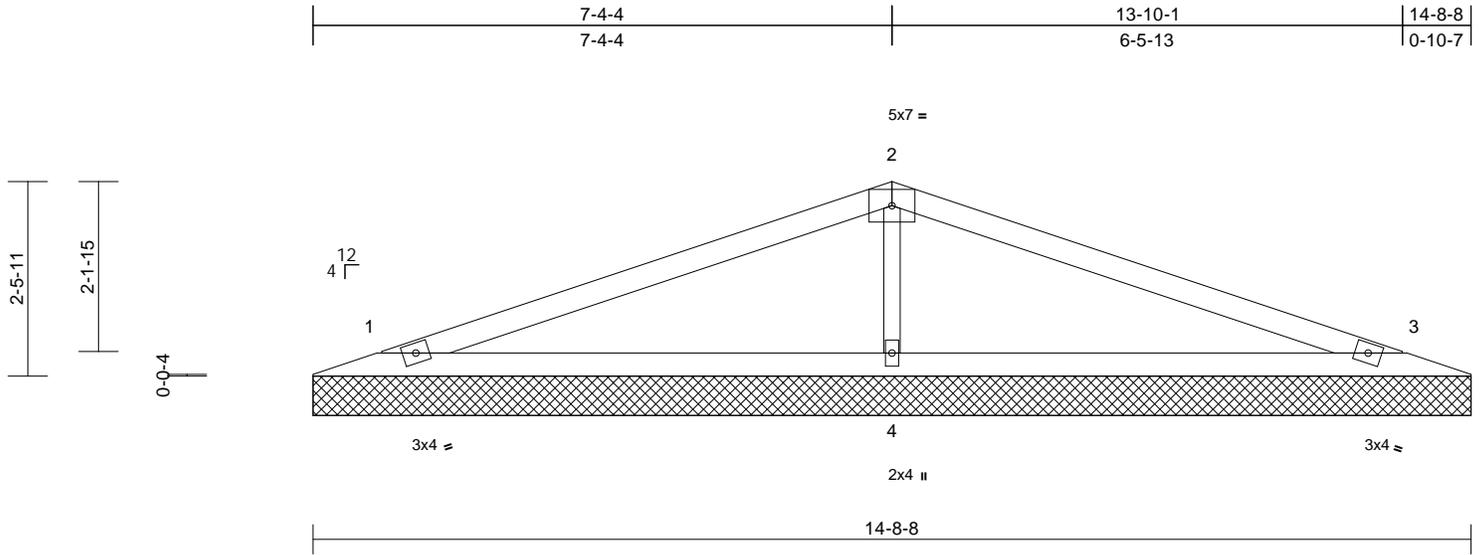

Scale = 1:29.1

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.61	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.35	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.09	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 34 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x3 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 1=253/14-8-8, 3=253/14-8-8, 4=660/14-8-8
Max Horiz 1=38 (LC 8)
Max Uplift 1=-55 (LC 4), 3=-60 (LC 9), 4=-60 (LC 4)
Max Grav 1=261 (LC 21), 3=261 (LC 22), 4=660 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-105/61, 2-3=-105/49
BOT CHORD 1-4=-1/40, 3-4=-1/40
WEBS 2-4=-465/138

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) Gable studs spaced at 4-0-0 oc.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 55 lb uplift at joint 1, 60 lb uplift at joint 3 and 60 lb uplift at joint 4.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job RR115	Truss V10	Truss Type Valley	Qty 1	Ply 1	Lot 115 RR Job Reference (optional)
--------------	--------------	----------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
 148789179
LEE'S SUMMIT, MISSOURI

11/30/2021

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Nov 12 12:30:59 PM 2021 Page: 1
 ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcDofJ4zJC7f

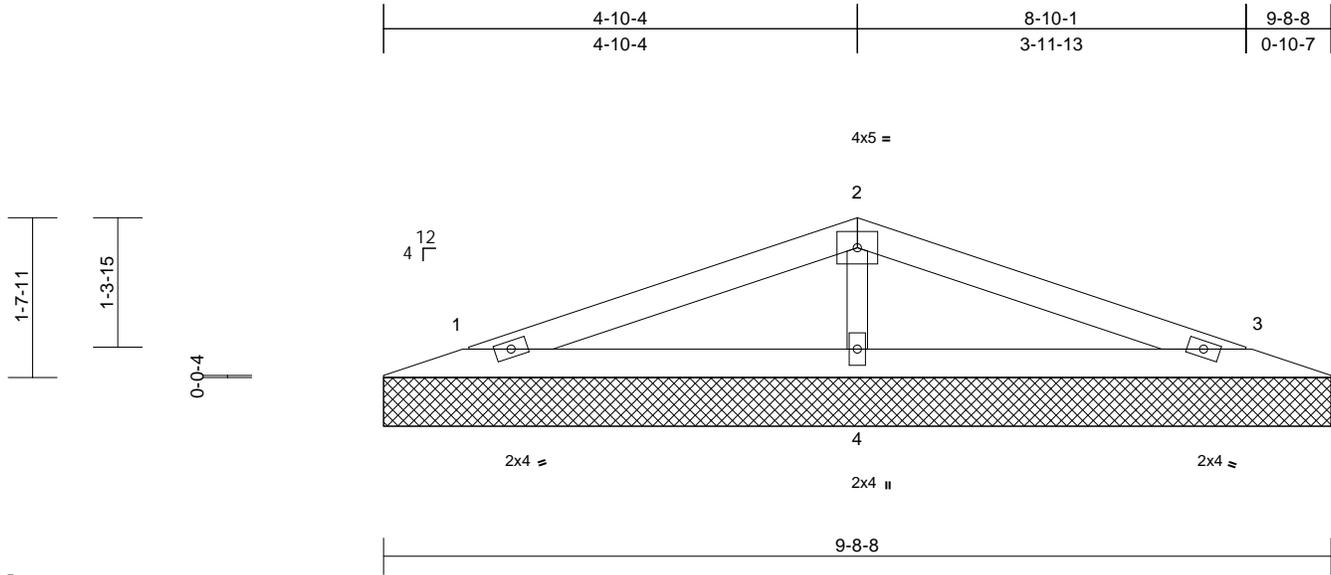

Scale = 1:23.5

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.21	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.13	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.05	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 21 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 OTHERS 2x3 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size)
 1=155/9-8-8, 3=155/9-8-8,
 4=405/9-8-8
 Max Horiz 1=-24 (LC 9)
 Max Uplift 1=-34 (LC 4), 3=-37 (LC 9), 4=-37 (LC 4)
 Max Grav 1=160 (LC 21), 3=160 (LC 22), 4=405 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-65/37, 2-3=-65/30
 BOT CHORD 1-4=-1/25, 3-4=-1/25
 WEBS 2-4=-285/84

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 4-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 34 lb uplift at joint 1, 37 lb uplift at joint 3 and 37 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 15, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

11/30/2021

Symbols

PLATE LOCATION AND ORIENTATION

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

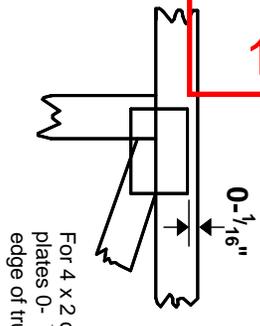

This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MITek 20/20 software or upon request.**

PLATE SIZE


4 X 4
 The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

- ANSI/TPI 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
- DSB-89: Design Standard for Bracing.
- BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

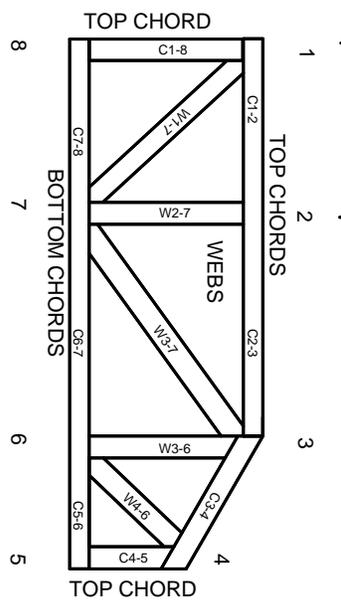

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

- ICC-ES Reports:
- ESR-1311, ESR-1352, ESR1988
- ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TPI 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability/bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T or I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

