


SUBMITTAL WAS REVIEWED FOR DESIGN CONFORMITY AND GENERAL CONFORMANCE TO CONTRACT DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSIBLE FOR CONFIRMING AND CORRELATING DIMENSIONS AT JOBSITE FOR TOLERANCE, CLEARANCE, QUANTITIES, FABRICATION, COORDINATION OF HIS OR HER WORK WITH OTHER TRADES, AND FULL COMPLIANCE WITH CONTRACT DOCUMENTS.

APPROVED

12/09/2021

BH


ENGINEER, EVERSTEAD

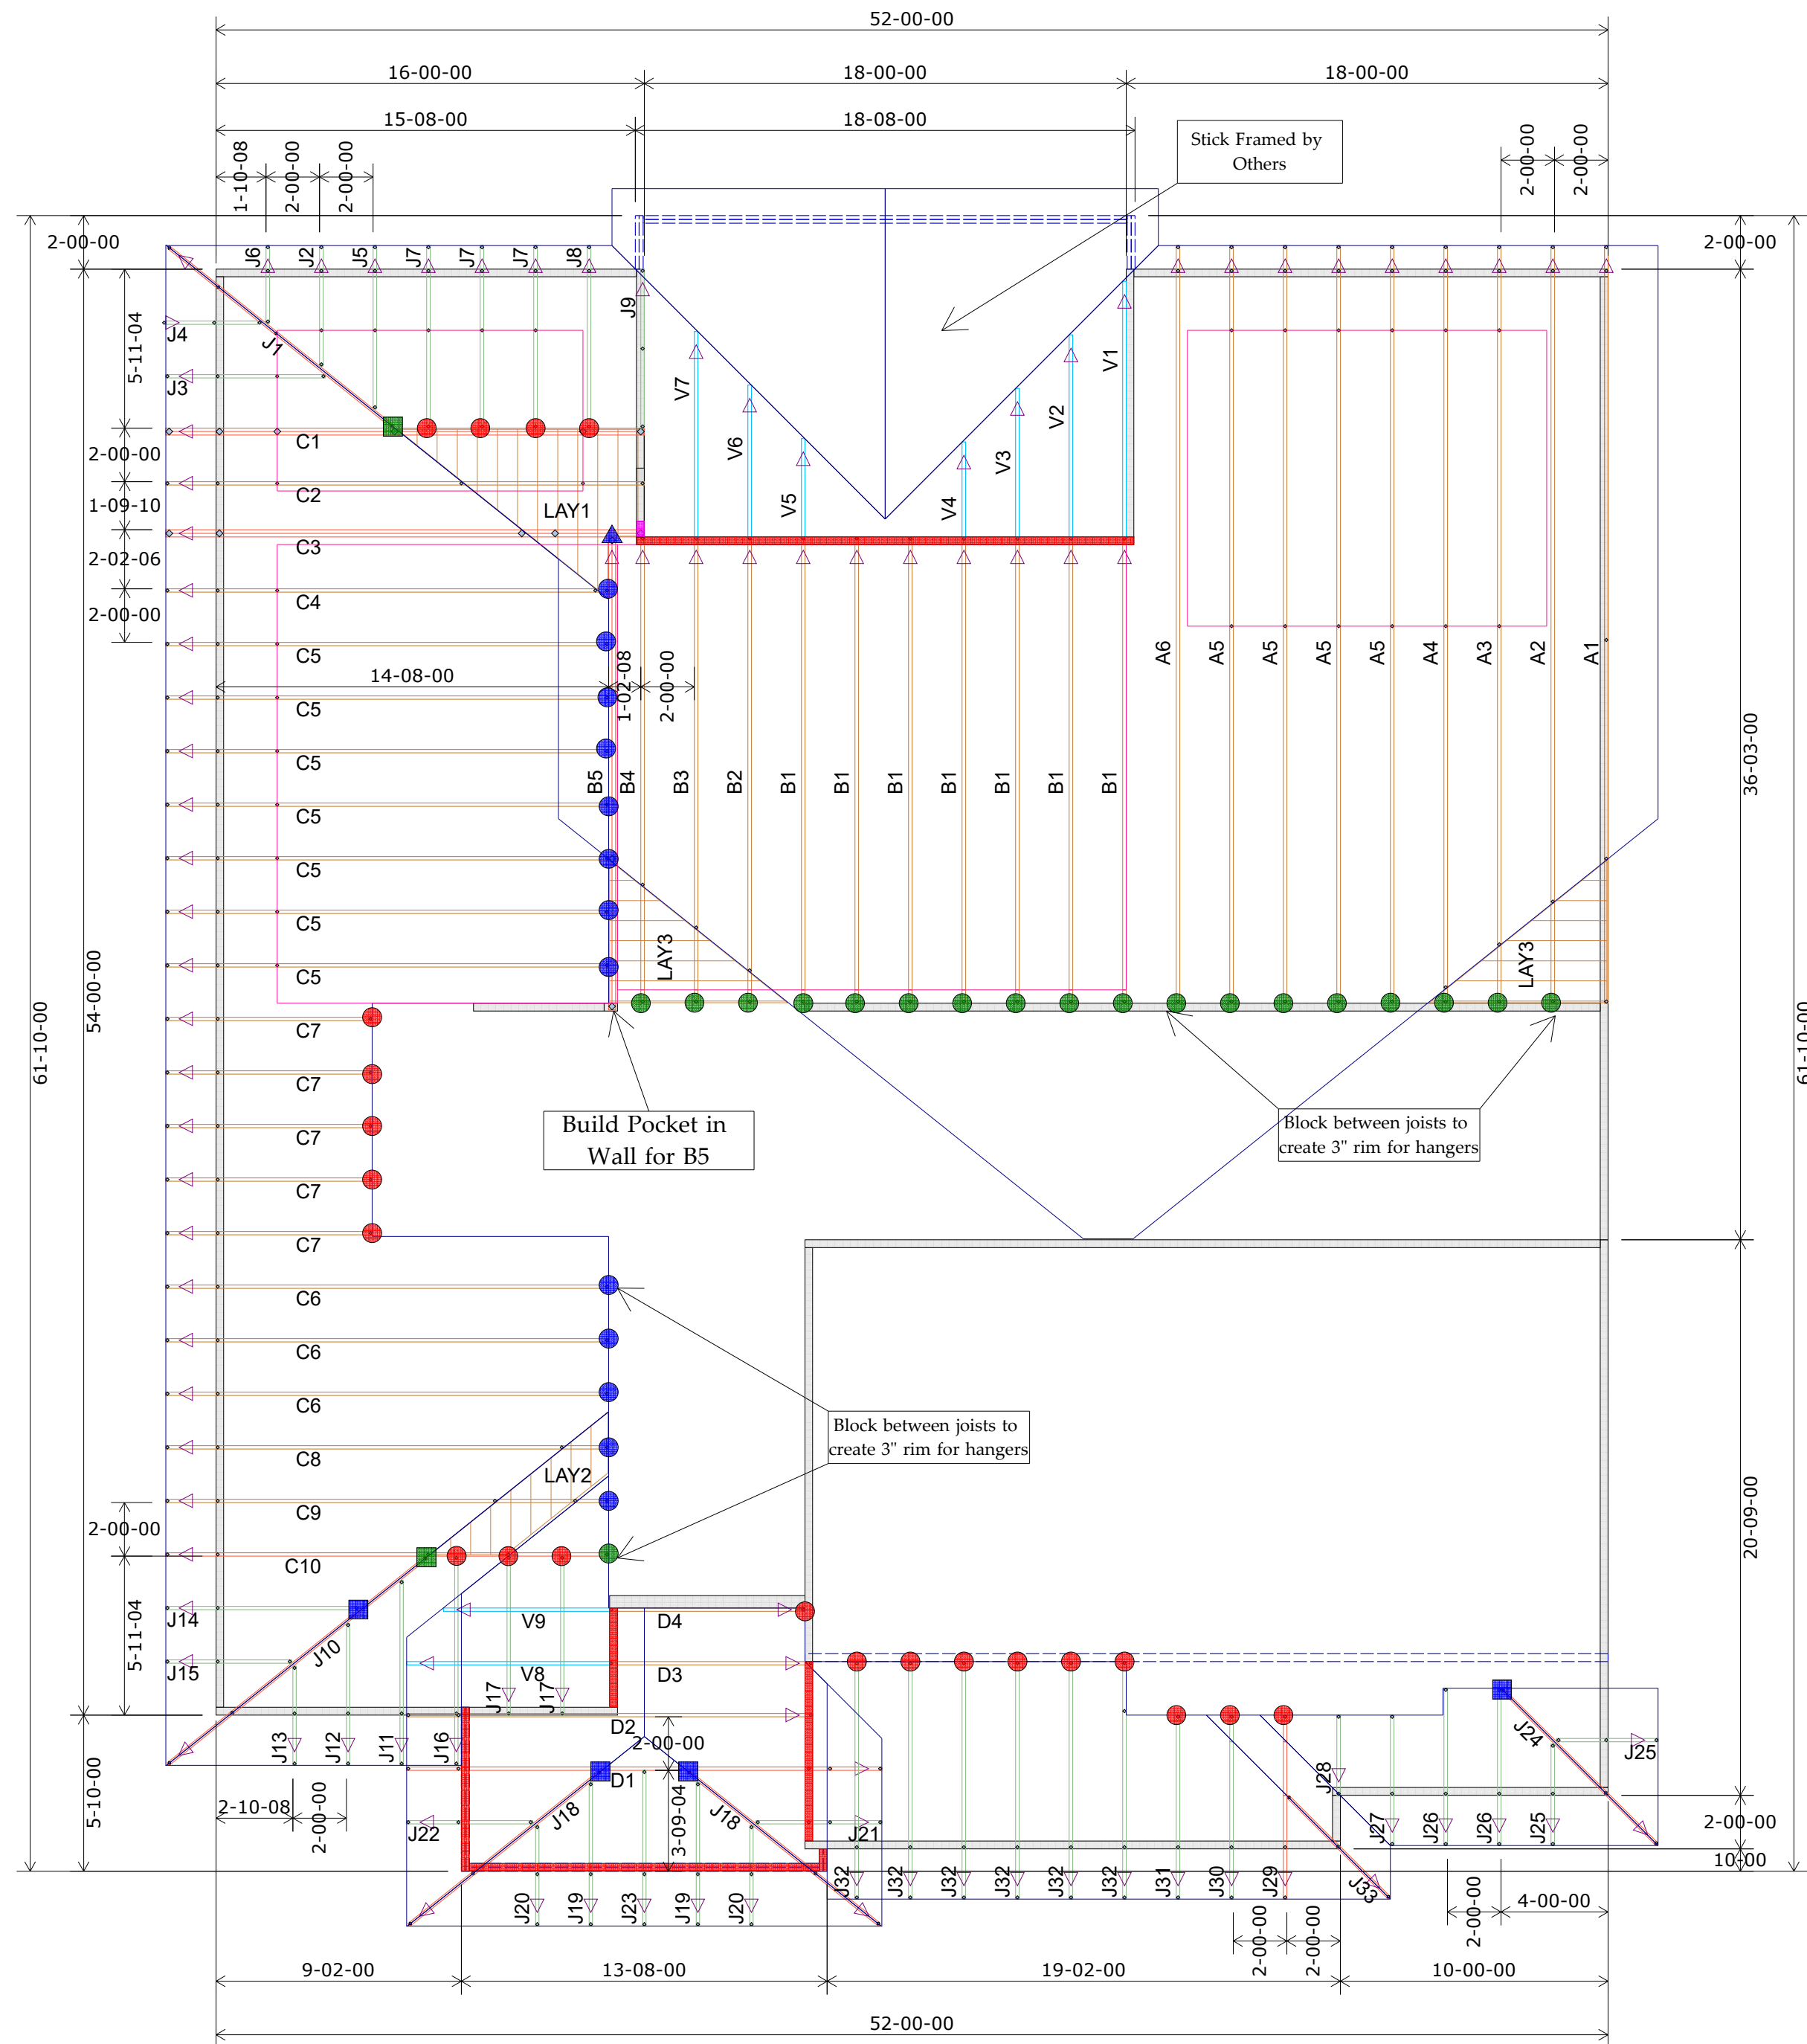

1st Floor Truss Layout
Scale: 3/16" = 1'

	HANGER SCHEDULE	Quantity
●	LUS24	25
●	LUS26	13
●	HUS26	28
▲	HHUS26-2	0
▲	HGUS26-2	1
▲	HGUS28-3	0
■	LTHJA26	0
■	TJC37	5
■	TJC57	8
▲	HTS20	0

Triangle denotes the left end of the Truss as it appears on the Engineered Drawings provided.



Unless otherwise specified
by Engineer Of Record,
Wheeler Lumber, LLC
recommends an uplift
connection at each bearing
point per the following:

# of Uplift	Connector
0 - 495:	(1) H2.5A
495 - 990:	(2) H2.5A
990 - 1245:	(1) HTS20

Installation per Simpson
Strong-Tie guidelines.

For Reactions greater than 1245#, refer to EOR.

Wall Heights:
1st Floor = 9-1-2 U.N.O.
2nd Floor = 8-1-2 U.N.O.

Wall Heights	
9-01-02	
10-01-02	
11-01-02	

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult "Bracing of wood trusses" available from the Truss Plate Institute, 585 D'Oroville Drive, Madison, WI 53179.

THIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS, REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST WHAT WILL RESULT IN EXTRA CHARGES TO YOU.

Approved By: _____ Date: _____


*Wheeler Lumber
1959 Old Hwy 50 NE
Waverly, KS 66871*



**RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
Development Services
LEE'S SUMMIT, MISSOURI**

SUBMITTAL WAS REVIEWED FOR DESIGN CONFORMITY AND GENERAL CONFORMANCE TO CONTRACT DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSIBLE FOR CONFIRMING AND CORRELATING DIMENSIONS AT JOBSITE FOR TOLERANCE, CLEARANCE, QUANTITIES, FABRICATION, COORDINATION OF HIS OR HER WORK WITH OTHER TRADES, AND FULL COMPLIANCE WITH CONTRACT DOCUMENTS.

ENGINEER, EVERSTEAD

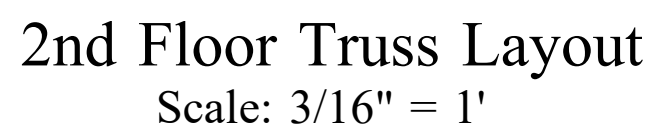

A diagram of a triangular truss structure. The truss is supported by a roller support at the bottom left and a pin support at the bottom right. A vertical load is applied at the top joint. The truss is composed of three members: two inclined members and one horizontal member at the base.

For Reactions greater than
1245#, refer to EOR.

Wall Heights	
9-01-02	
10-01-02	
11-01-02	

Shop Drawing Approval

THIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND YOURS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS ARE TO BE DISCARDED. NO CHANGES WILL BE ALLOWED TO THIS LAYOUT WITHOUT THE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

*Wheeler Lumber
1959 Old Hwy 50 NE
Waverly, KS 66871*

**RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
Development Services
LEE'S SUMMIT, MISSOURI**