Unless otherwise specified by Engineer Of Record, Wheeler Lumber, LLC recommends an uplift connection at each bearing point per the following:

| # of Uplift | Connector |
|---|---|
| 0 - 495: | (1) H2.5A |
| 495 - 990: | (2) H2.5A |
| 990 - 1245: | (1) HTS20 |

Installation per Simpson Strong-Tie guidelines.

For Reactions greater than 1245#, refer to EOR.

Triangle denotes the left end of the Truss as it appears on the Engineered Drawings provided.



| HANGER SCHEDULE | Quantity |
|---|---|
| LUS24 | 0 |
| LUS26 | 0 |
| HUS26 | 15 |
| HHUS26-2 | 0 |
| HGUS26-2 | 0 |
| HGUS28-3 | 0 |
| LTHJA26 | 0 |
| TJC37 | 1 |
| TJC57 | 0 |
| HTS20 | 0 |

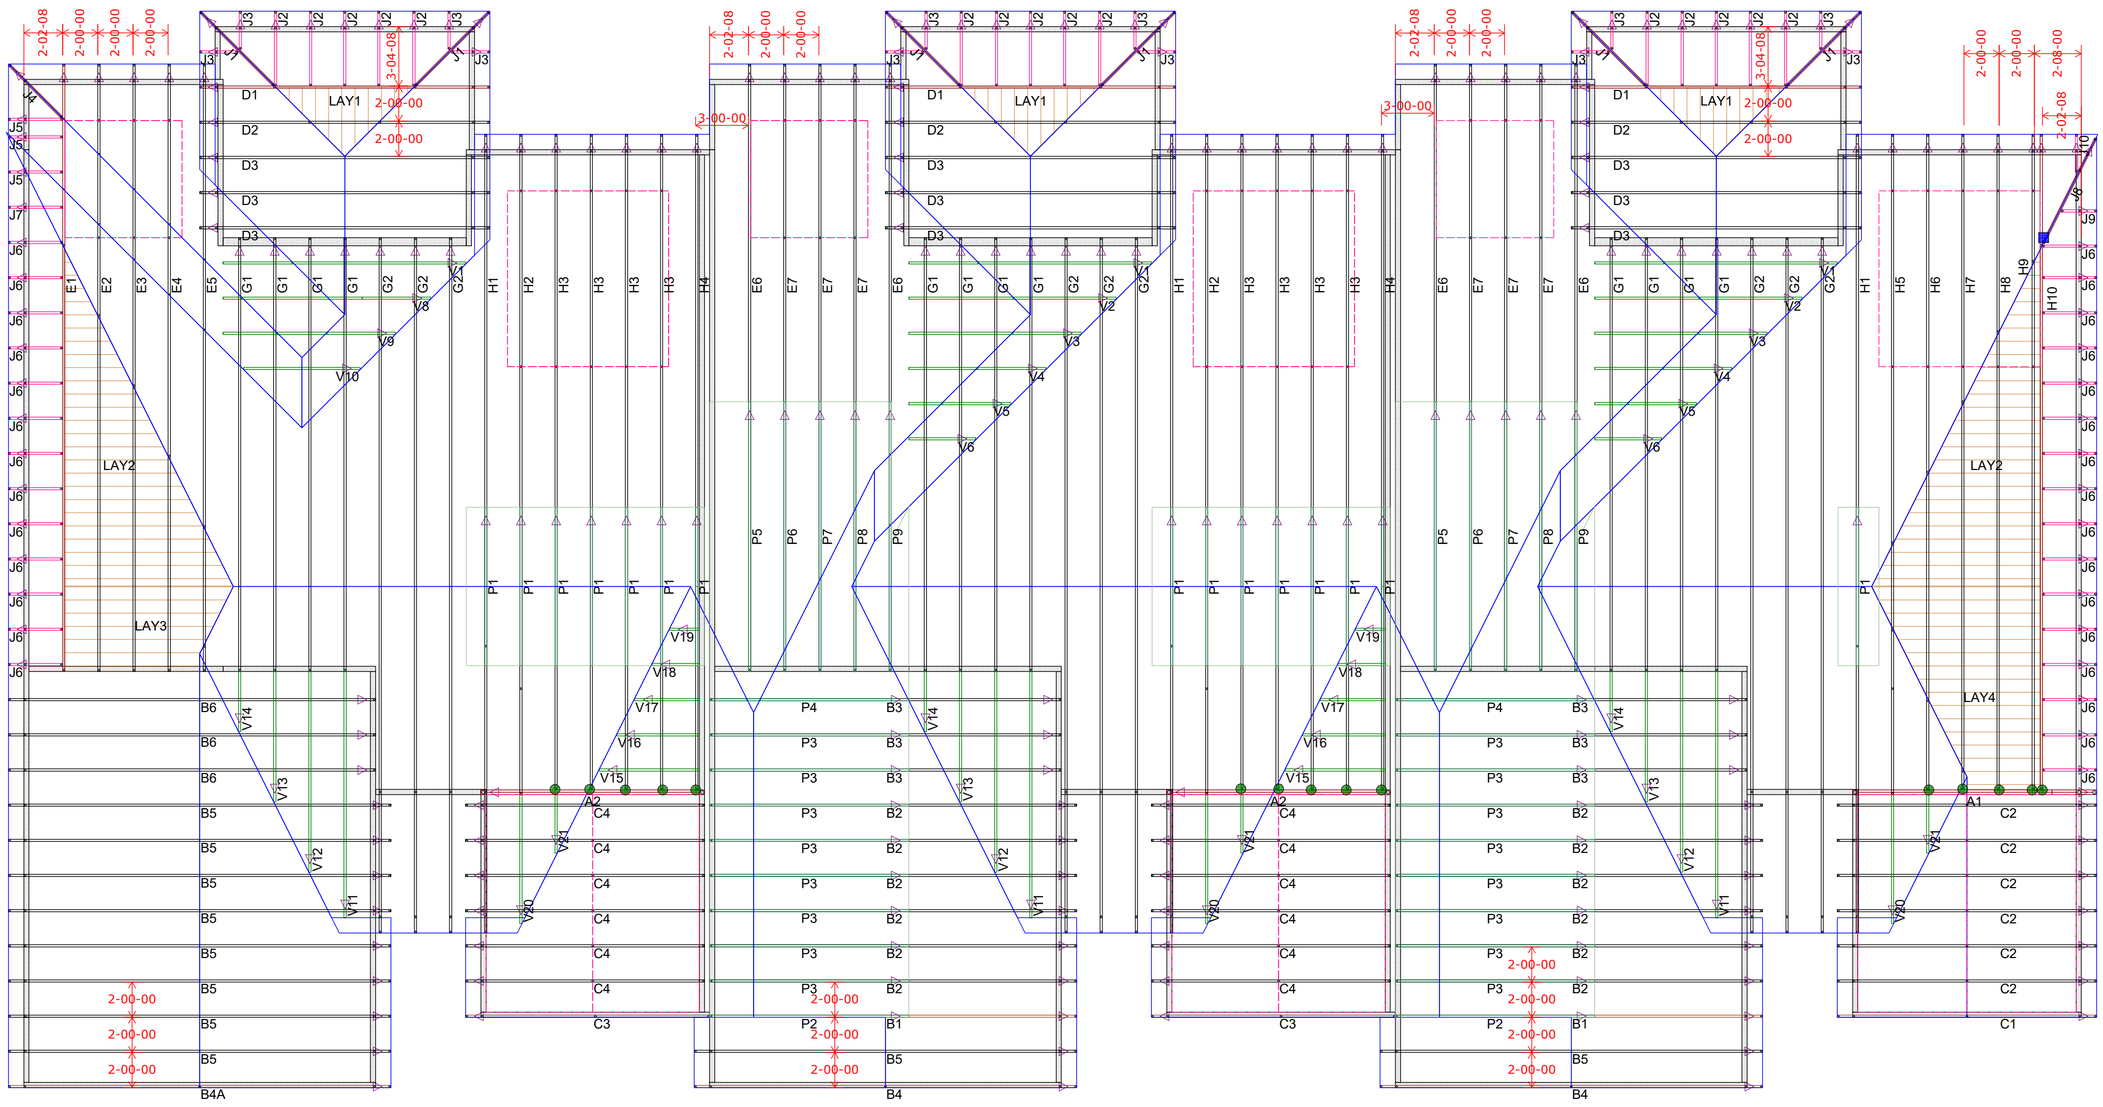


Roof Truss Layout

| | |
|---|---|
| Customer | Lumber One |
| Job Name | Triplex |
| Job Site Address | |
| City, State | Lee's Summit MO |
| Designer | Kevin McMillen (785) 746-4119 |
| 12/2/2021 | Job # 211238 |

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the trusses to insure stability during construction. The bracing shown on these drawings is for illustration only. Knee walls, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult "Bracing of wood trusses" available from the Truss Plate Institute, 583 D'Onofrio Drive; Madison, WI 53179.

**Shop Drawing Approval**

THIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

Approved By: _____ Date: _____

*Wheeler Lumber*
*1959 Old Hwy 50 NE*
*Waverly, KS 66871*