


RAFTERS 2 X 6 DF NO 2 @ 16" OC TYP.
HIPS AND RIDGERS 2 X 8 DF NO 2 TYP.


ROOF PLAN
1/8 = 1-0
SIDE TO SIDE 8/12
FRONT TO BACK 7/12



FRONT EL.
STUCCO & STONE

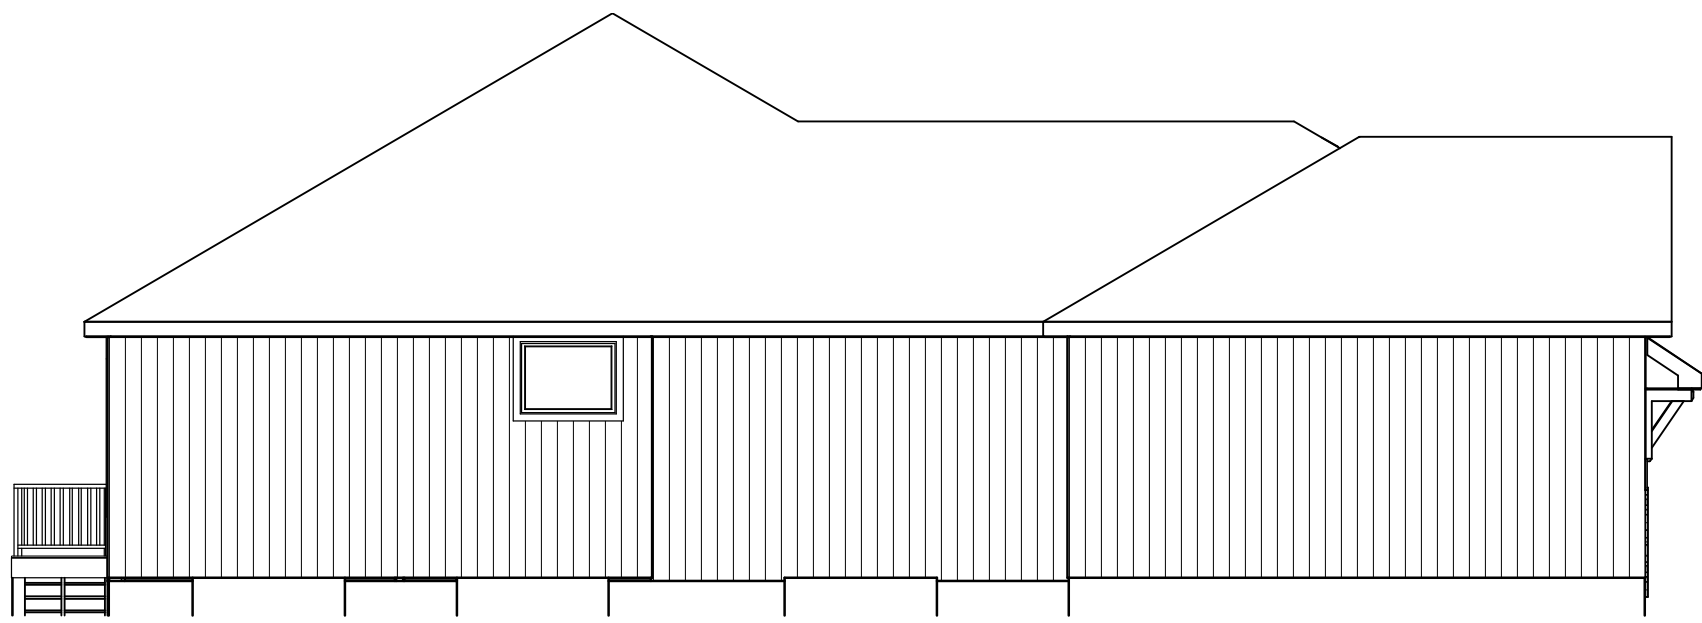

LEFT EL.
1/8 = 1-0

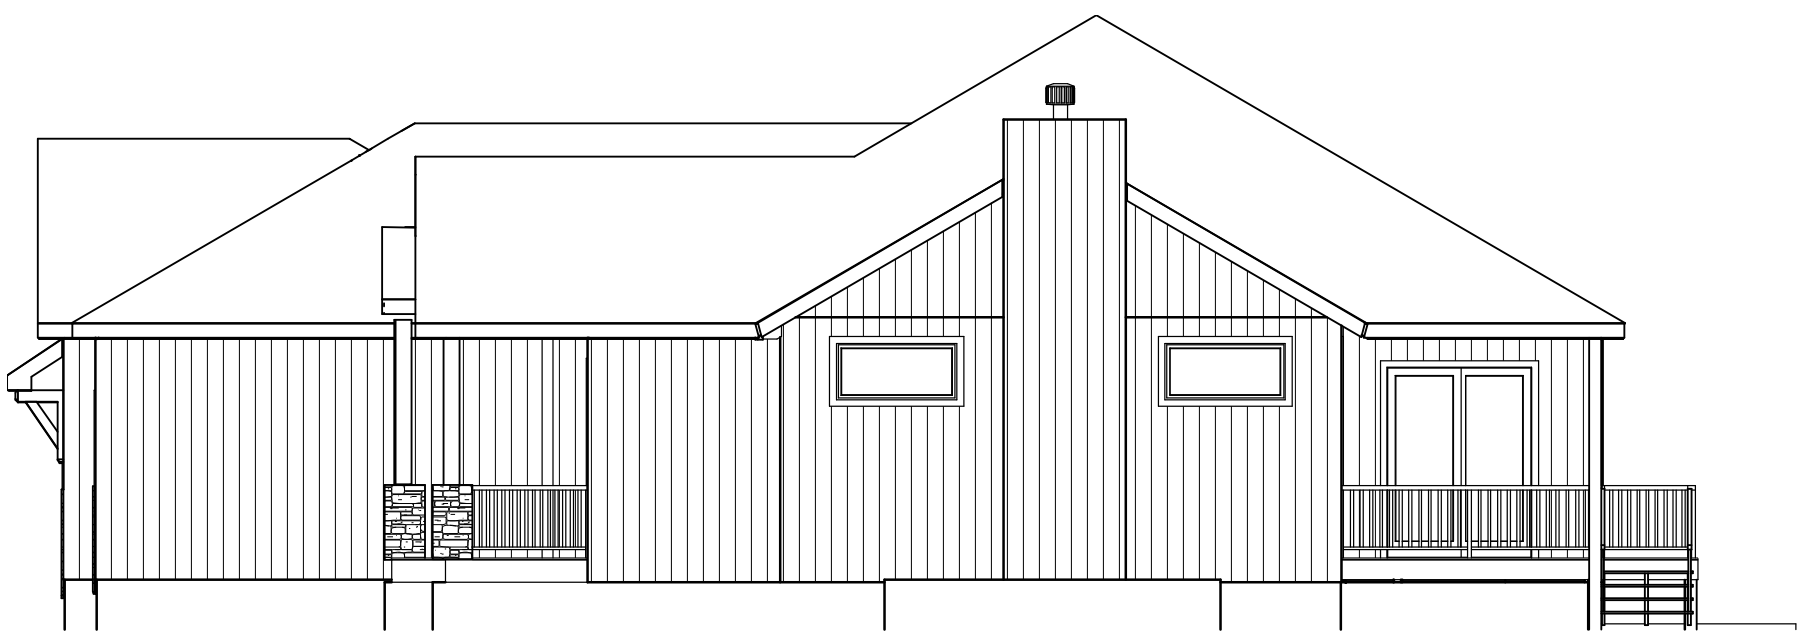

RIGHT EL.
1/8 = 1-0



REAR EL.
1/8 = 1-0



BUILD IN ACCORDANCE WITH
2018 INTERNATIONAL
RESIDENTIAL CODE AND
LOCAL CODES.

LOT 107 WOODSIDE
101 AMBERSHAM
LEE SUMMIT MO



TRUMARK HOMES
KYLE II

SCALE
1/4" = 1-0

DATE
12-20-21

PLAN NO.
3709

SHEET NO.
1 of 6

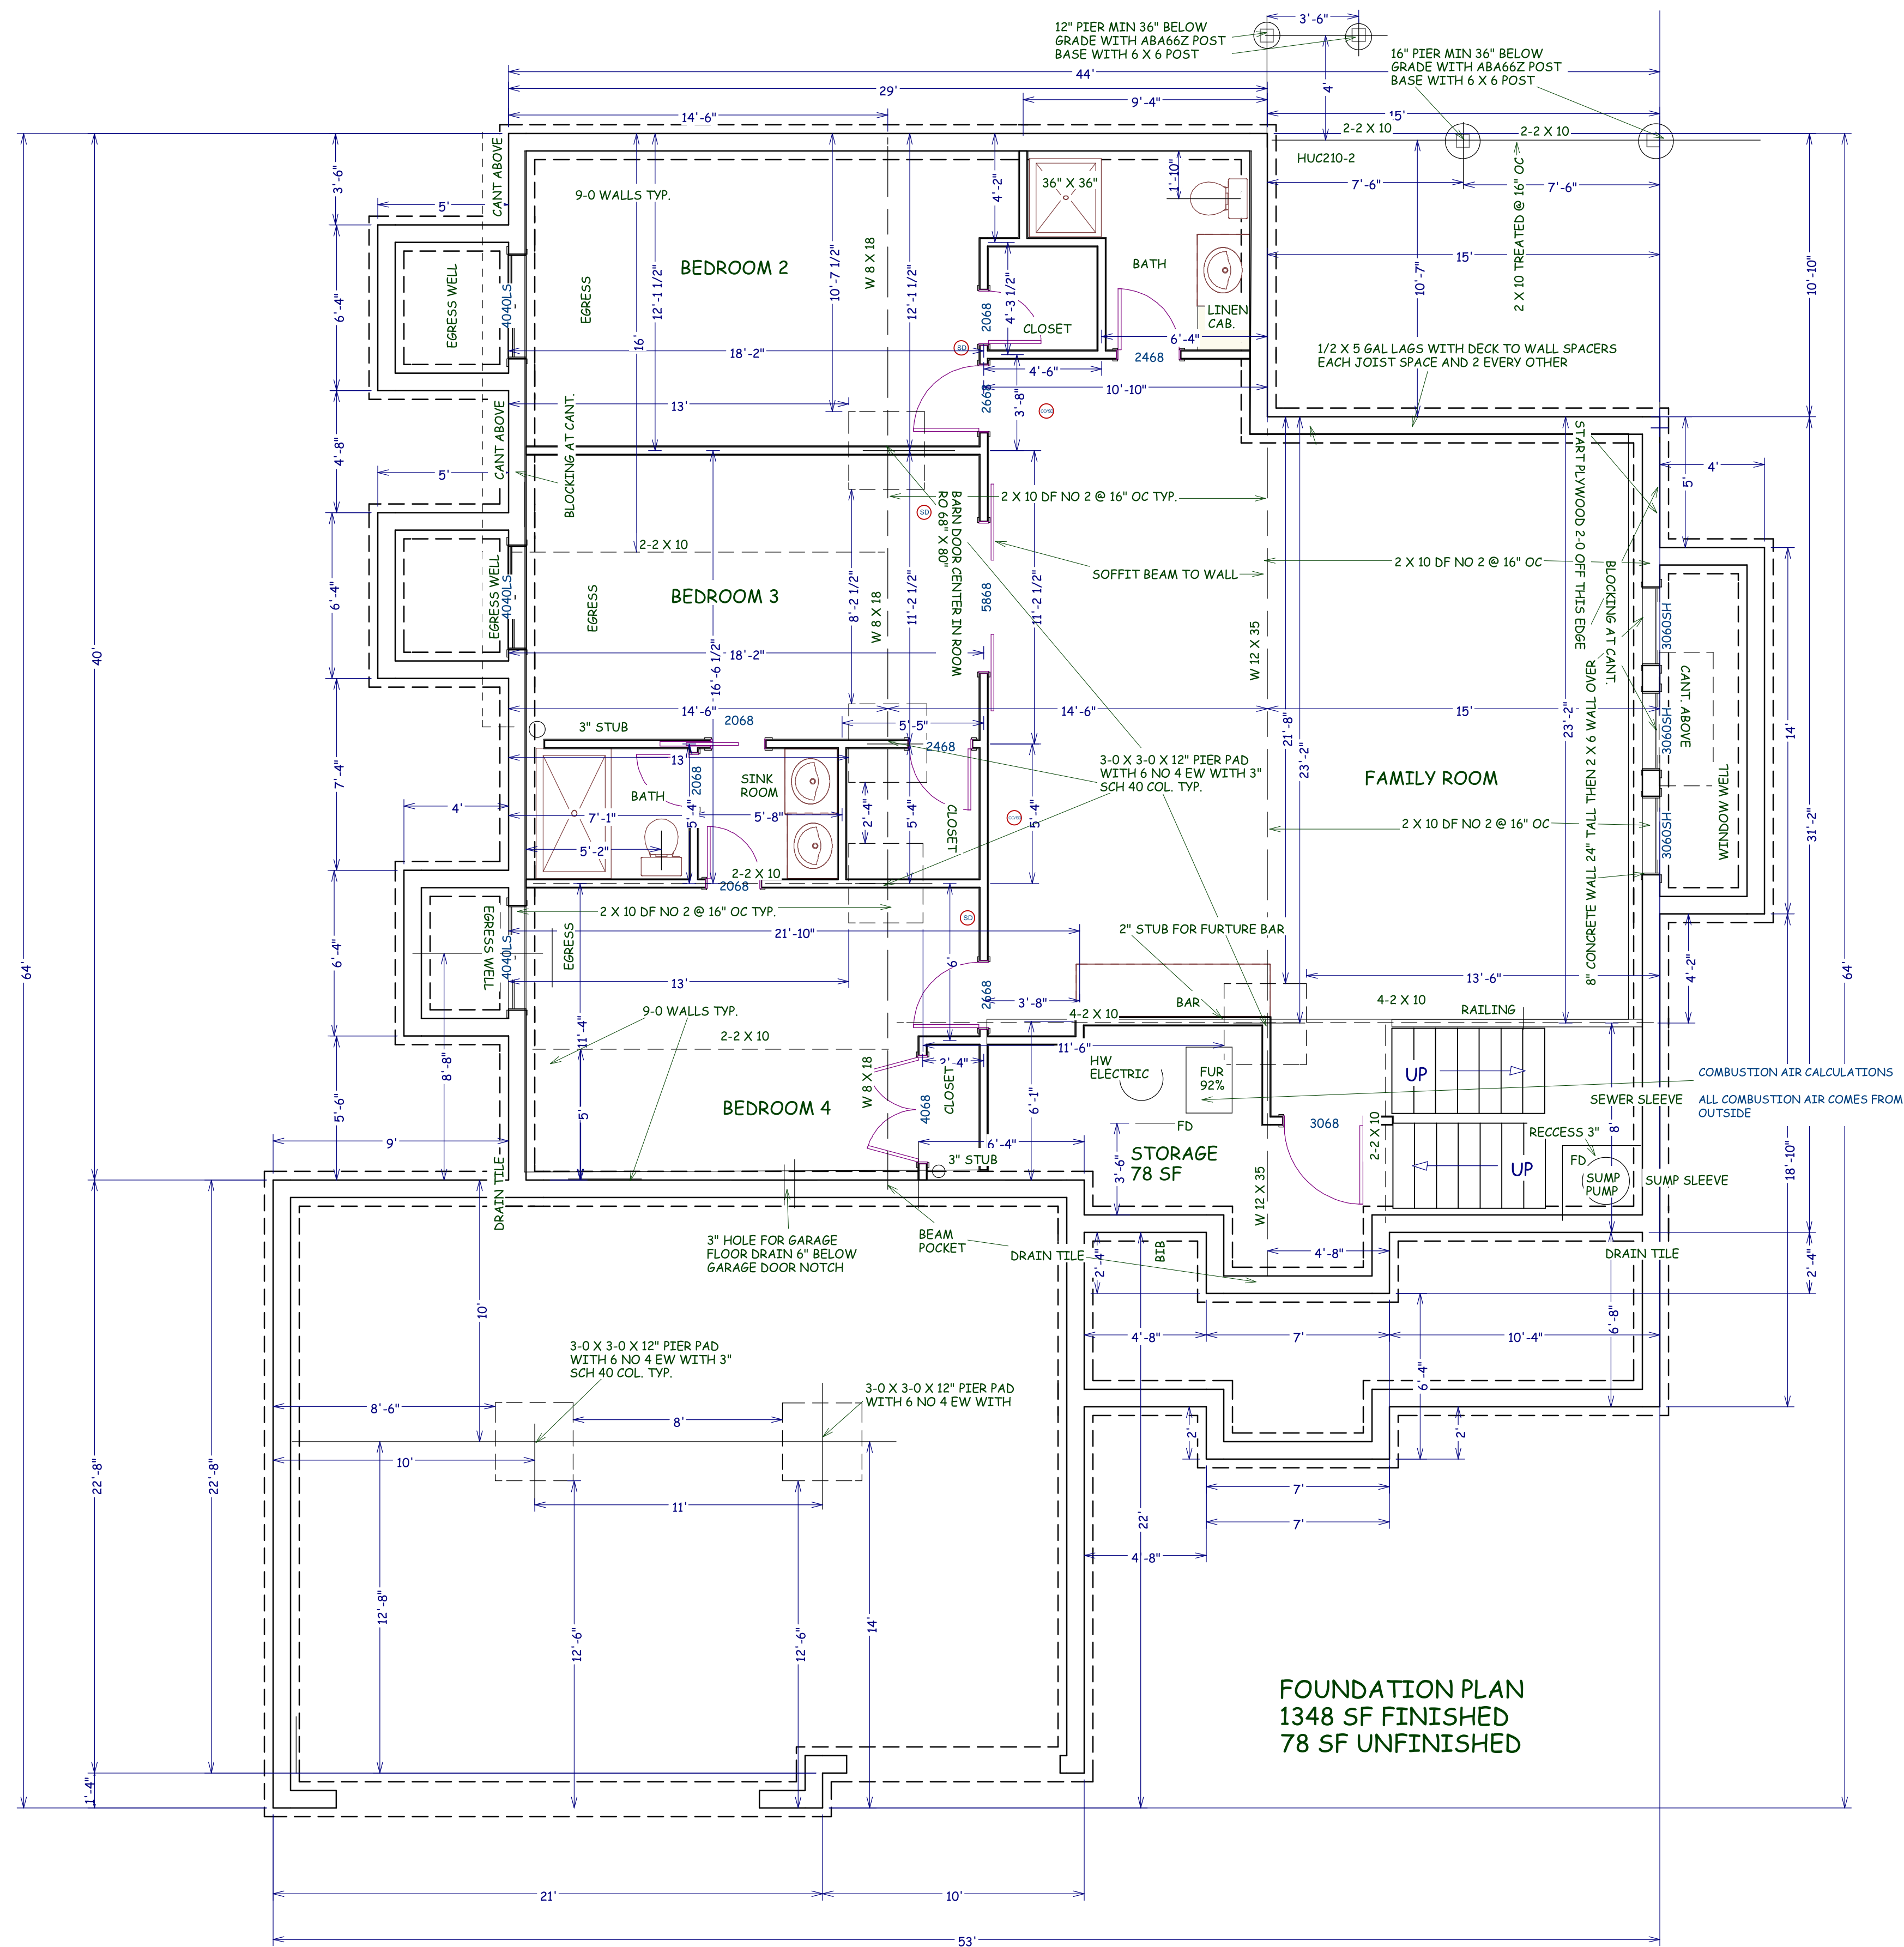

BUILD IN ACCORDANCE WITH
2018 INTERNATIONAL
RESIDENTIAL CODE AND
LOCAL CODES.

LOT 107 WOODSIDE
101 AMBERSHAM
LEE SUMMIT MO



TRUMARK HOMES
KYLE II

SCALE
1/4" = 1-0


DATE
12-20-21

PLAN NO.
3709

SHEET NO.
2 of 6




- DETAIL NOTES:
1. FLOORWALL FRAMING AND ANCHORAGE ABOVE PER STRUCTURAL PLAN.
 2. MIN. 3/4" COVER FOR FOUNDATION WALL REINFORCEMENT.
 3. FOOTING TO BEAR ON UNEXCAVATED EARTH OR WELL COMPACTED FILL PER STRUCTURAL PLAN.
 4. EXPANSION JOINT(S) PER TYPICAL PRACTICE.

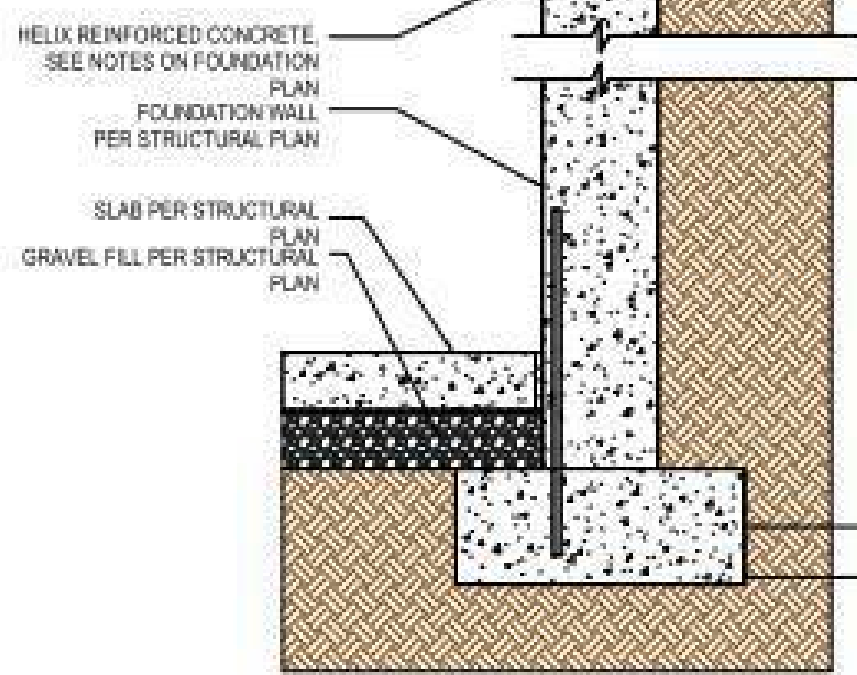


1 TYPICAL FOUNDATION WALL

- DETAIL NOTES:
1. FLOORWALL FRAMING AND ANCHORAGE ABOVE PER STRUCTURAL PLAN.
 2. MIN. 3/4" COVER FOR FOUNDATION WALL REINFORCEMENT.
 3. FOOTING TO BEAR ON UNEXCAVATED EARTH OR WELL COMPACTED FILL PER STRUCTURAL PLAN.
 4. EXPANSION JOINT(S) PER TYPICAL PRACTICE.

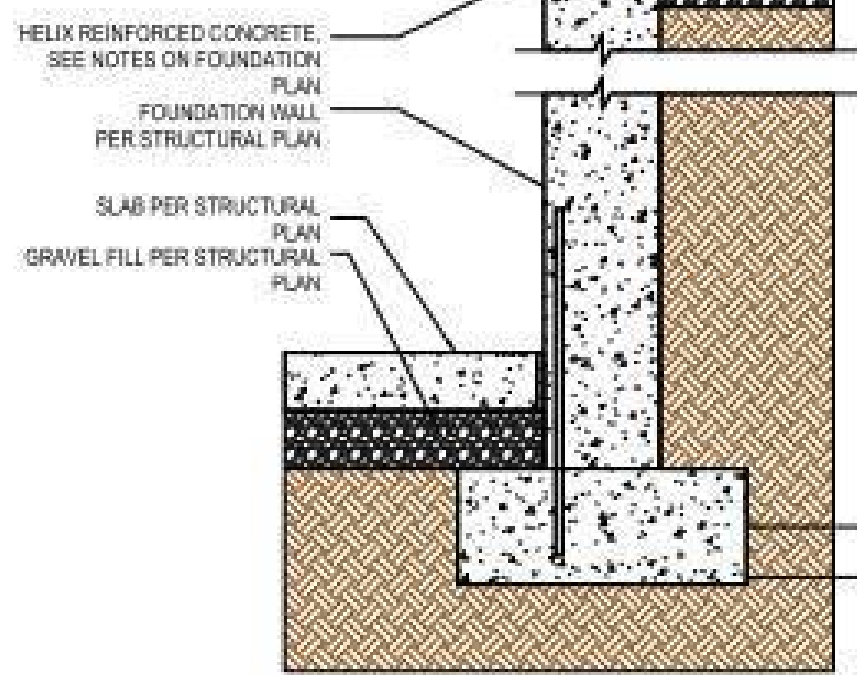


2 TYPICAL FOUNDATION WALL w/ STRUCTURAL SLAB ADJACENT

- DETAIL NOTES:
1. FLOORWALL FRAMING AND ANCHORAGE ABOVE PER STRUCTURAL PLAN.
 2. MIN. 3/4" COVER FOR FOUNDATION WALL REINFORCEMENT.
 3. FOOTING TO BEAR ON UNEXCAVATED EARTH OR WELL COMPACTED FILL PER STRUCTURAL PLAN.
 4. EXPANSION JOINT(S) PER TYPICAL PRACTICE.

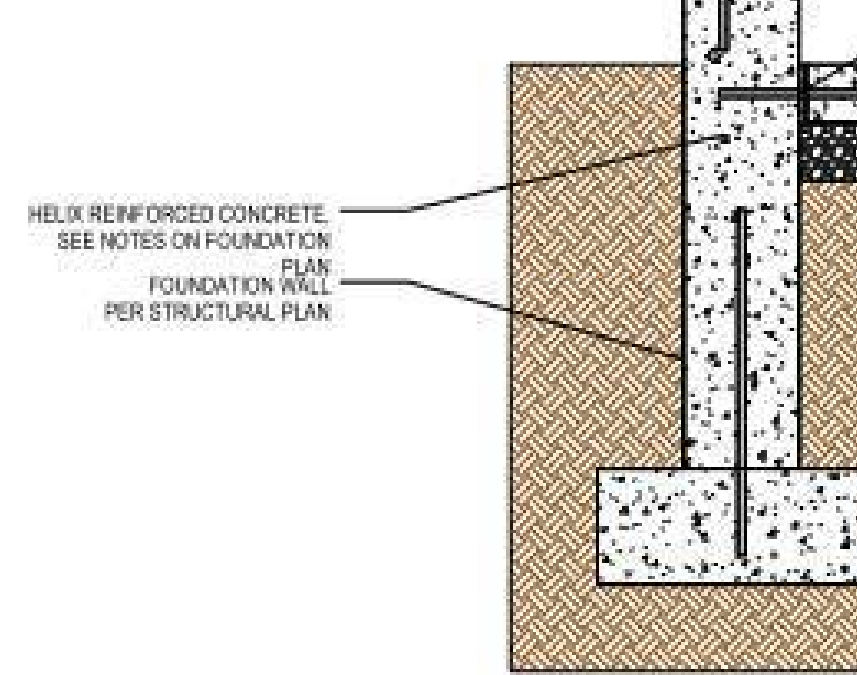


3 TYPICAL STEM WALL w/ STRUCTURAL SLAB ADJACENT

- DETAIL NOTES:
1. FLOORWALL FRAMING AND ANCHORAGE ABOVE PER STRUCTURAL PLAN.
 2. MIN. 3/4" COVER FOR FOUNDATION WALL REINFORCEMENT.
 3. FOOTING TO BEAR ON UNEXCAVATED EARTH OR WELL COMPACTED FILL PER STRUCTURAL PLAN.
 4. EXPANSION JOINT(S) PER TYPICAL PRACTICE.

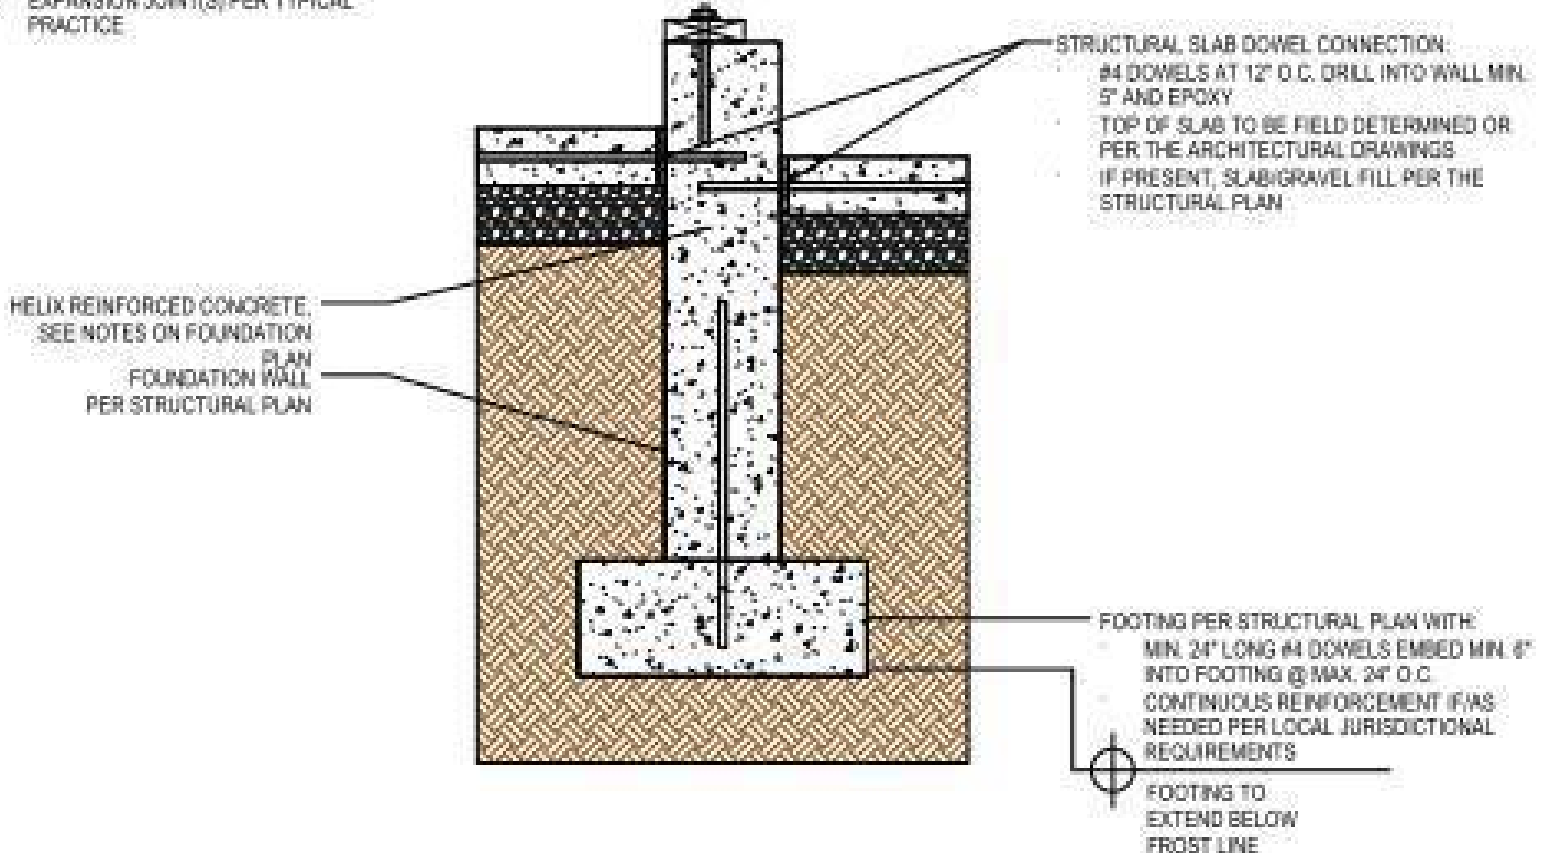


4 TYPICAL STEM WALL w/ MULTIPLE STRUCTURAL LEDGES

- DETAIL NOTES:
1. FLOORWALL FRAMING AND ANCHORAGE ABOVE PER STRUCTURAL PLAN.
 2. MIN. 3/4" COVER FOR FOUNDATION WALL REINFORCEMENT.
 3. FOOTING TO BEAR ON UNEXCAVATED EARTH OR WELL COMPACTED FILL PER STRUCTURAL PLAN.
 4. EXPANSION JOINT(S) PER TYPICAL PRACTICE.

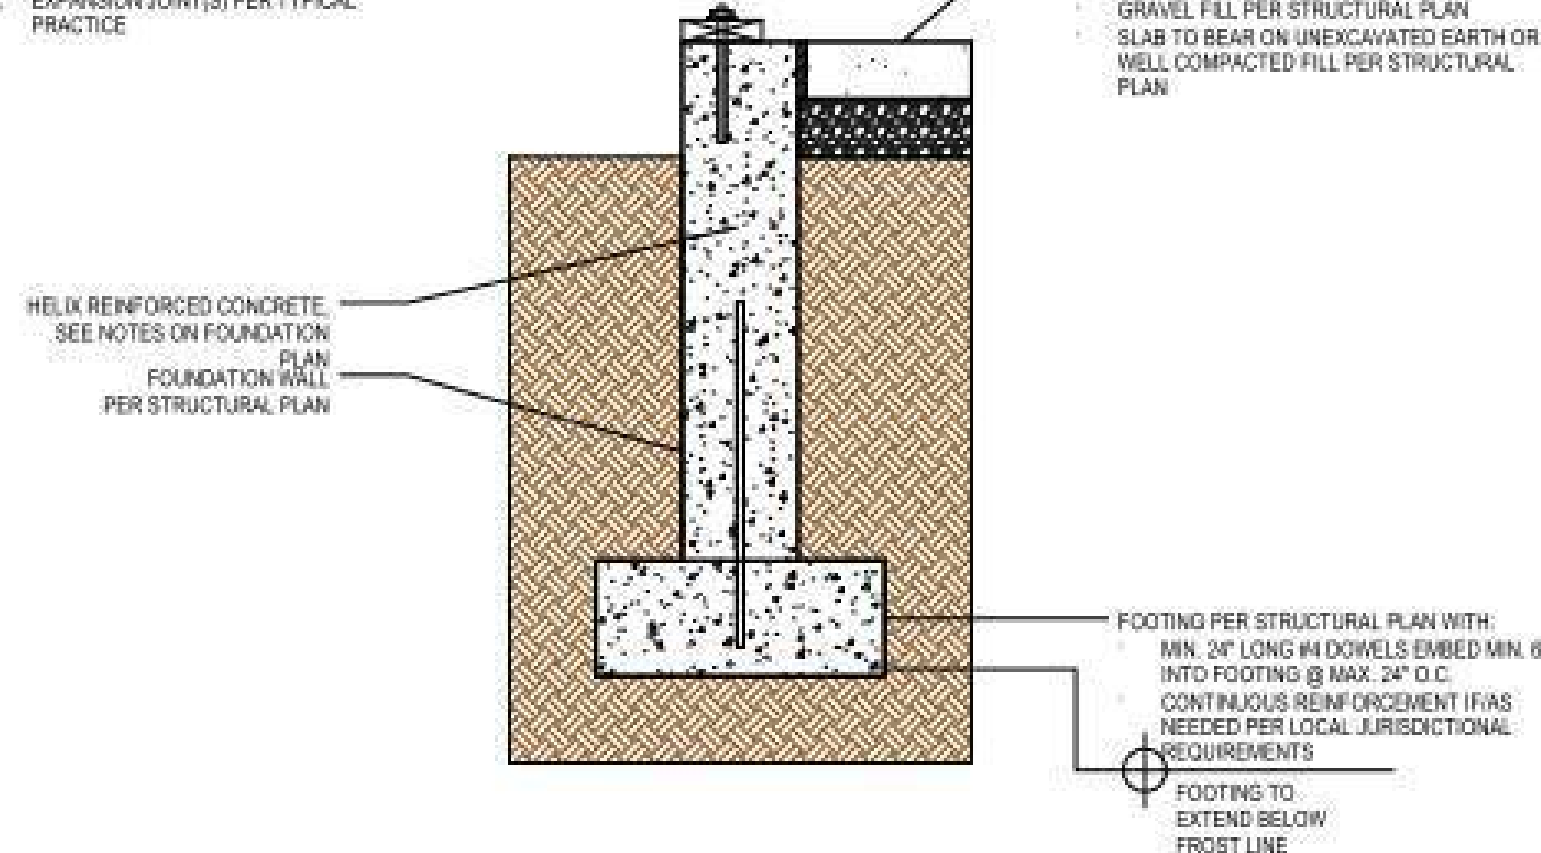


5 TYPICAL STEM WALL w/ SLAB-ON-GRADE ADJACENT

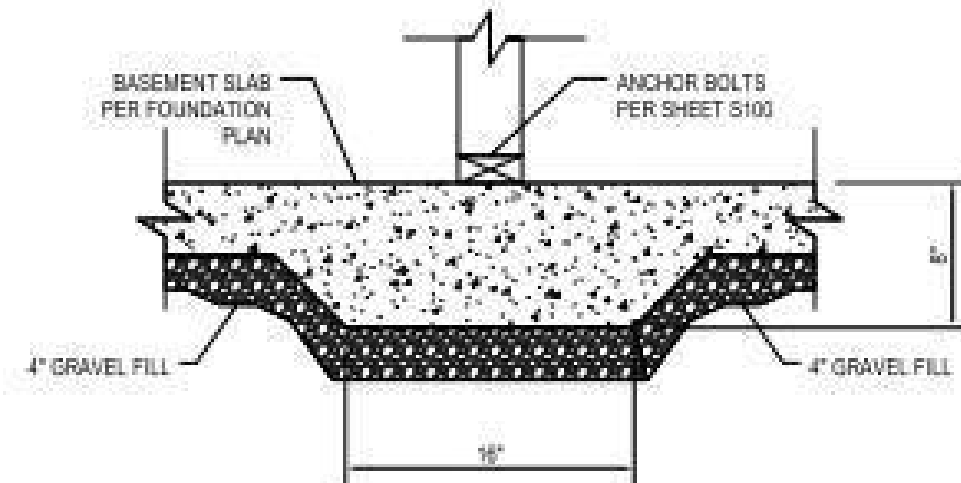

6 TYPICAL THICKENED SLAB

- DETAIL NOTES:
1. FLOORWALL FRAMING AND ANCHORAGE ABOVE PER STRUCTURAL PLAN.
 2. MIN. 3/4" COVER FOR FOUNDATION WALL REINFORCEMENT.
 3. FOOTING TO BEAR ON UNEXCAVATED EARTH OR WELL COMPACTED FILL PER STRUCTURAL PLAN.
 4. EXPANSION JOINT(S) PER TYPICAL PRACTICE.

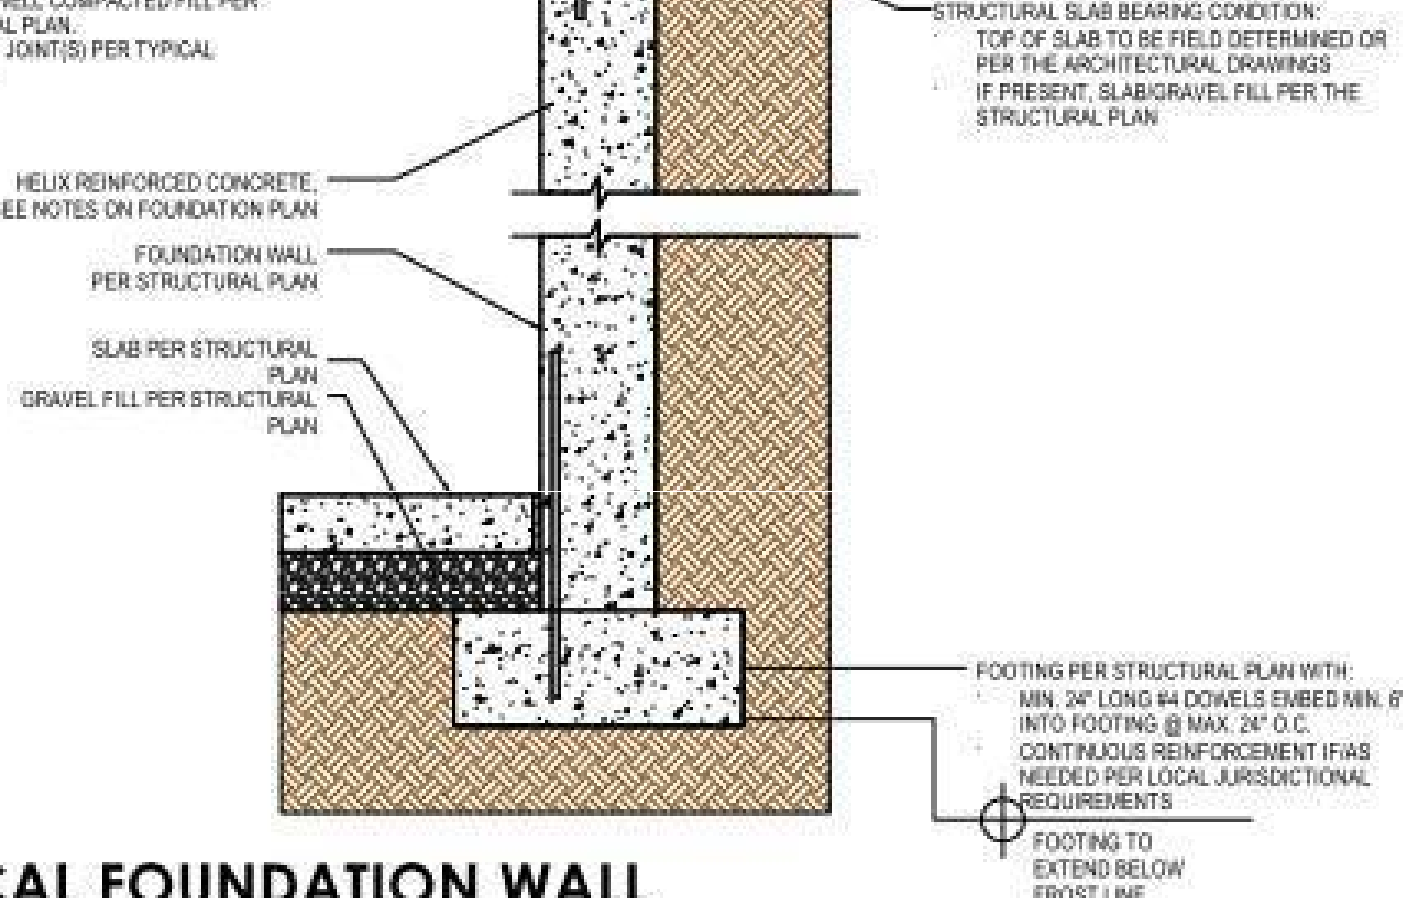

7 TYPICAL FOUNDATION WALL w/ STRUCTURAL SLAB BEARING ALTERNATIVE

BUILD IN ACCORDANCE WITH
2018 INTERNATIONAL
RESIDENTIAL CODE AND
LOCAL CODES.

LOT 107 WOODSTDE
101 AMBERSHAM
LEE SUMMIT MO

TRUMARK HOMES
KYLE II


SCALE
1/4" = 1'-0

DATE
12-20-21



PLAN NO.
3683

SHEET NO.
3 OF 6





TYPICAL EXTERIOR CORNER FILE CORNER WITH STUDS

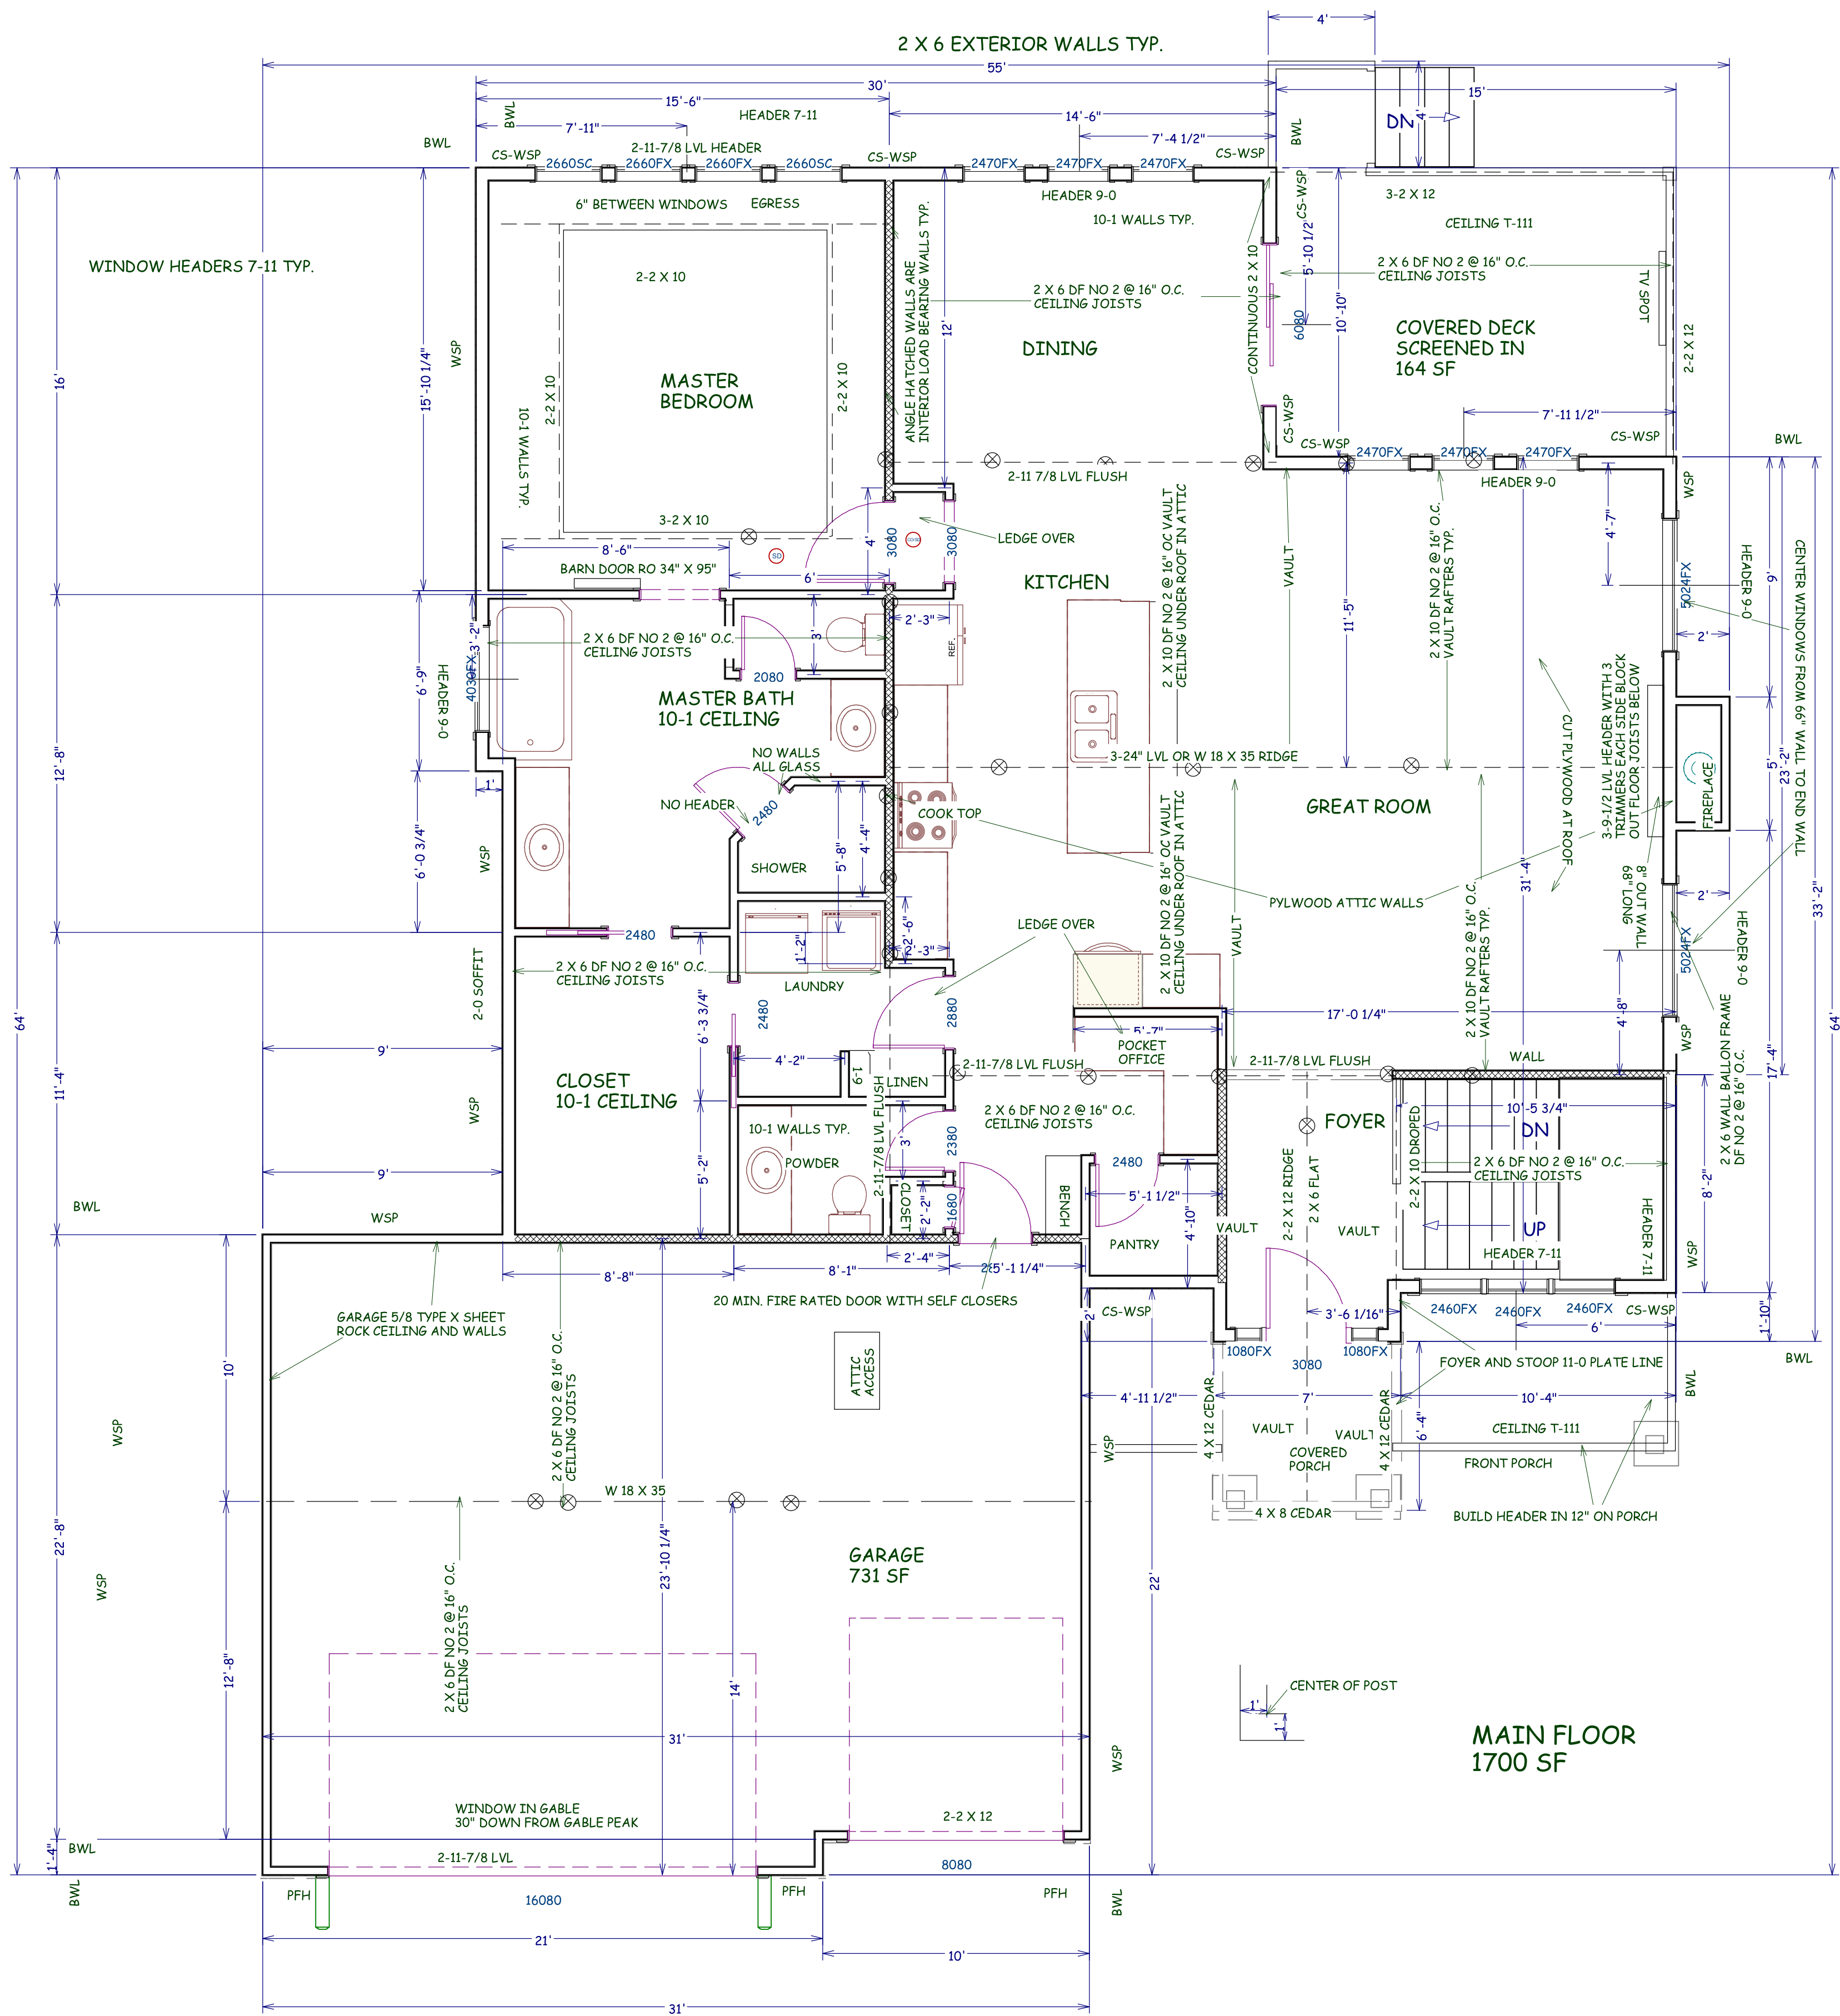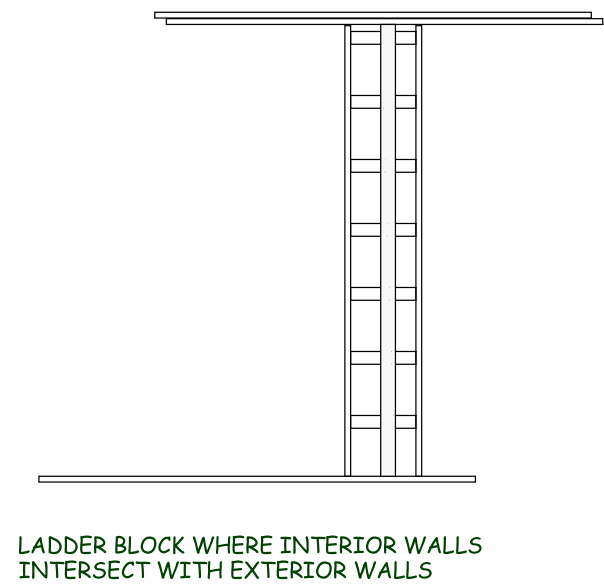

BUILD IN ACCORDANCE WITH
2018 INTERNATIONAL
RESIDENTIAL CODE AND
LOCAL CODES.

LOT 107 WOODSIDE
101 AMBERSHAM
LEE SUMMIT MO


TRUMARK HOMES
KYLE II

SCALE
1/4" = 1-0

DATE
12-20-21

PLAN NO.
3709

SHEET NO.
4 of 6

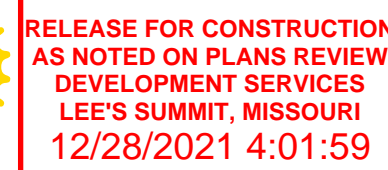

LOT 107 WOODSIDE
101 AMBERSHAM
LEE SUMMIT MO


TRUMARK HOMES
KYLE F II

SCALE
1/4" = 1'-0"

DATE
12-20-21

PLAN NO.
3709

5 of 6

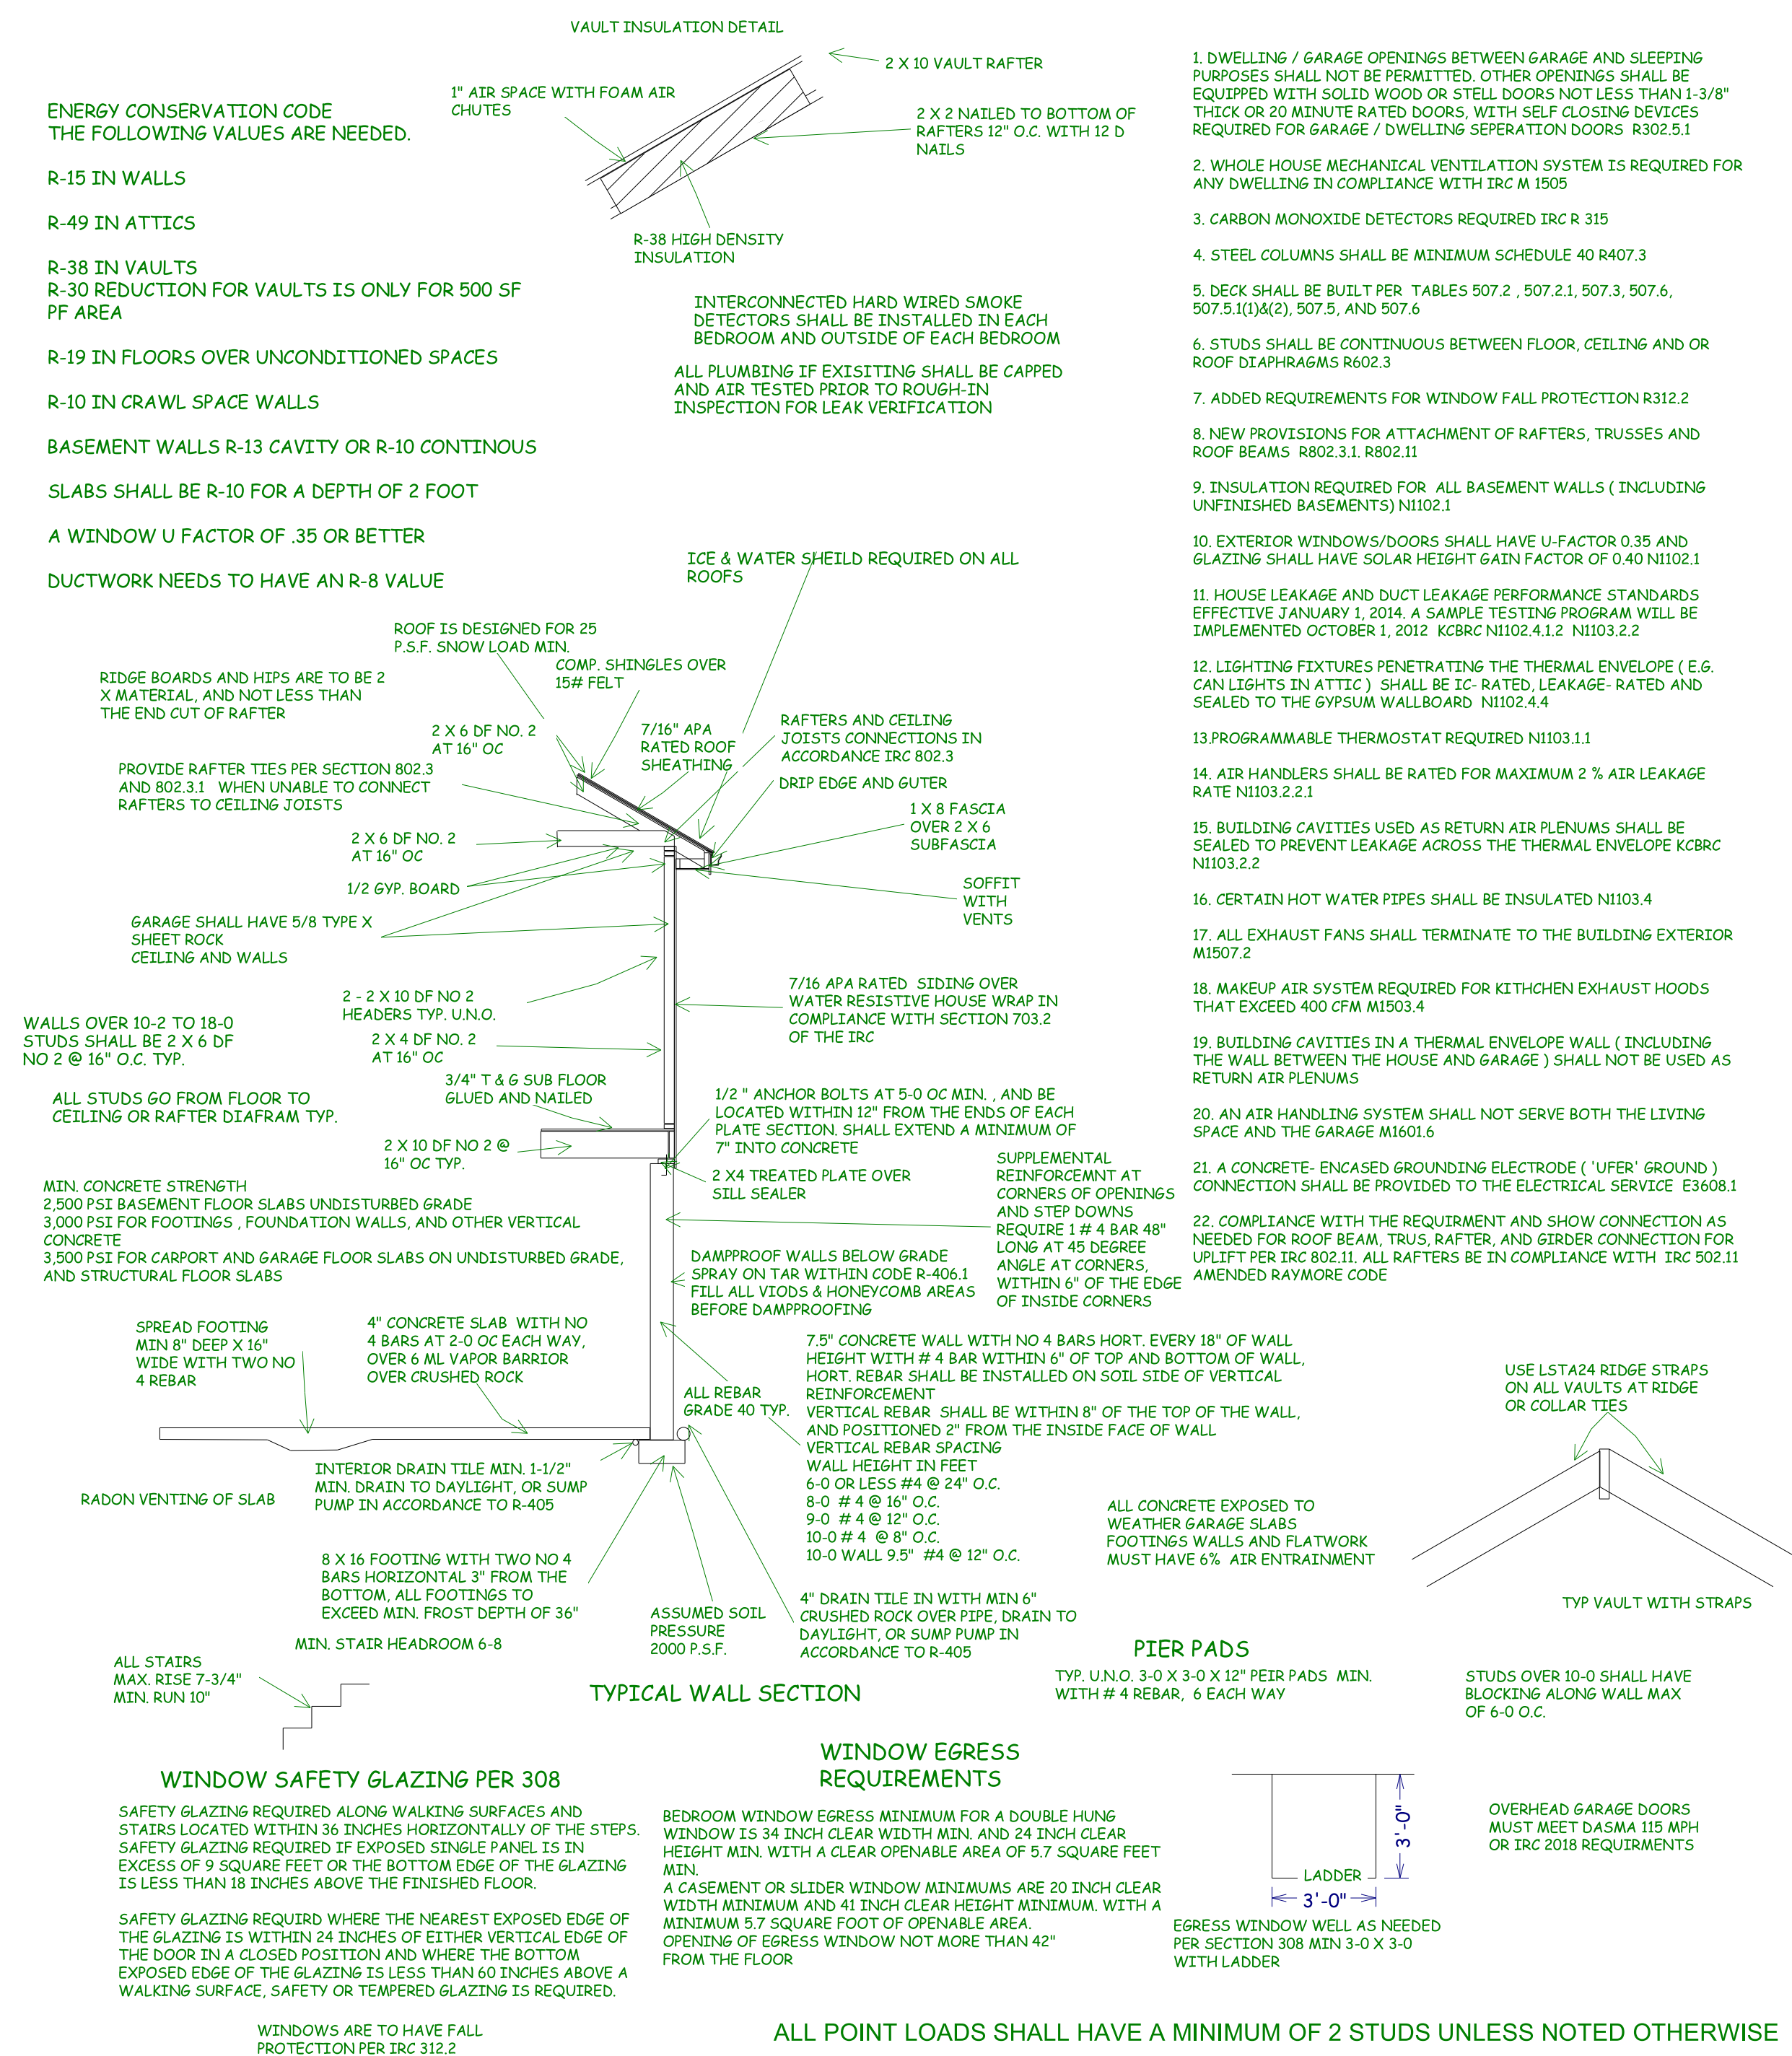

PURLIN SUPPORT PLAN







TABLE R602.10.3(1) BRACING REQUIREMENTS BASED ON WIND SPEED						
EXPOSURE CATEGORY B 30-FOOT MEAN ROOF HEIGHT 10-FOOT WALL HEIGHT 2 BRACED WALL LINES		MINIMUM TOTAL LENGTH (FEET) OF BRACED WALL PANELS REQUIRED ALONG EACH BRACED WALL LINE*				
Ultimate Design Wind Speed (mph)	Story Location	Braced Wall Line Spacing* (feet)	Method LIB*	Method GB	Methods DWB, WSP, SFB, PBS, PCP, HPS, BV-WSP, ABW, PFG, PFC, CS-SFB	Methods CS-WSP, CS-G, CS-PF
≤ 115		10	3.5	3.5	2.0	2.0
		20	6.5	6.5	3.5	3.5
		30	9.5	9.5	5.5	4.5
		40	12.5	12.5	7.0	6.0
		50	15.0	15.0	9.0	7.5
		60	18.0	18.0	10.5	9.0
		10	7.0	7.0	4.0	3.5
		20	12.5	12.5	7.5	6.5
		30	18.0	18.0	10.5	9.0
		40	23.5	23.5	13.5	11.5
		50	29.0	29.0	16.5	14.0
		60	34.5	34.5	20.0	17.0
		10	NP	10.0	6.0	5.0
		20	NP	18.5	11.0	9.0
		30	NP	27.0	15.5	13.0
		40	NP	35.0	20.0	17.0
		50	NP	43.0	24.5	21.0
		60	NP	51.0	29.0	25.0

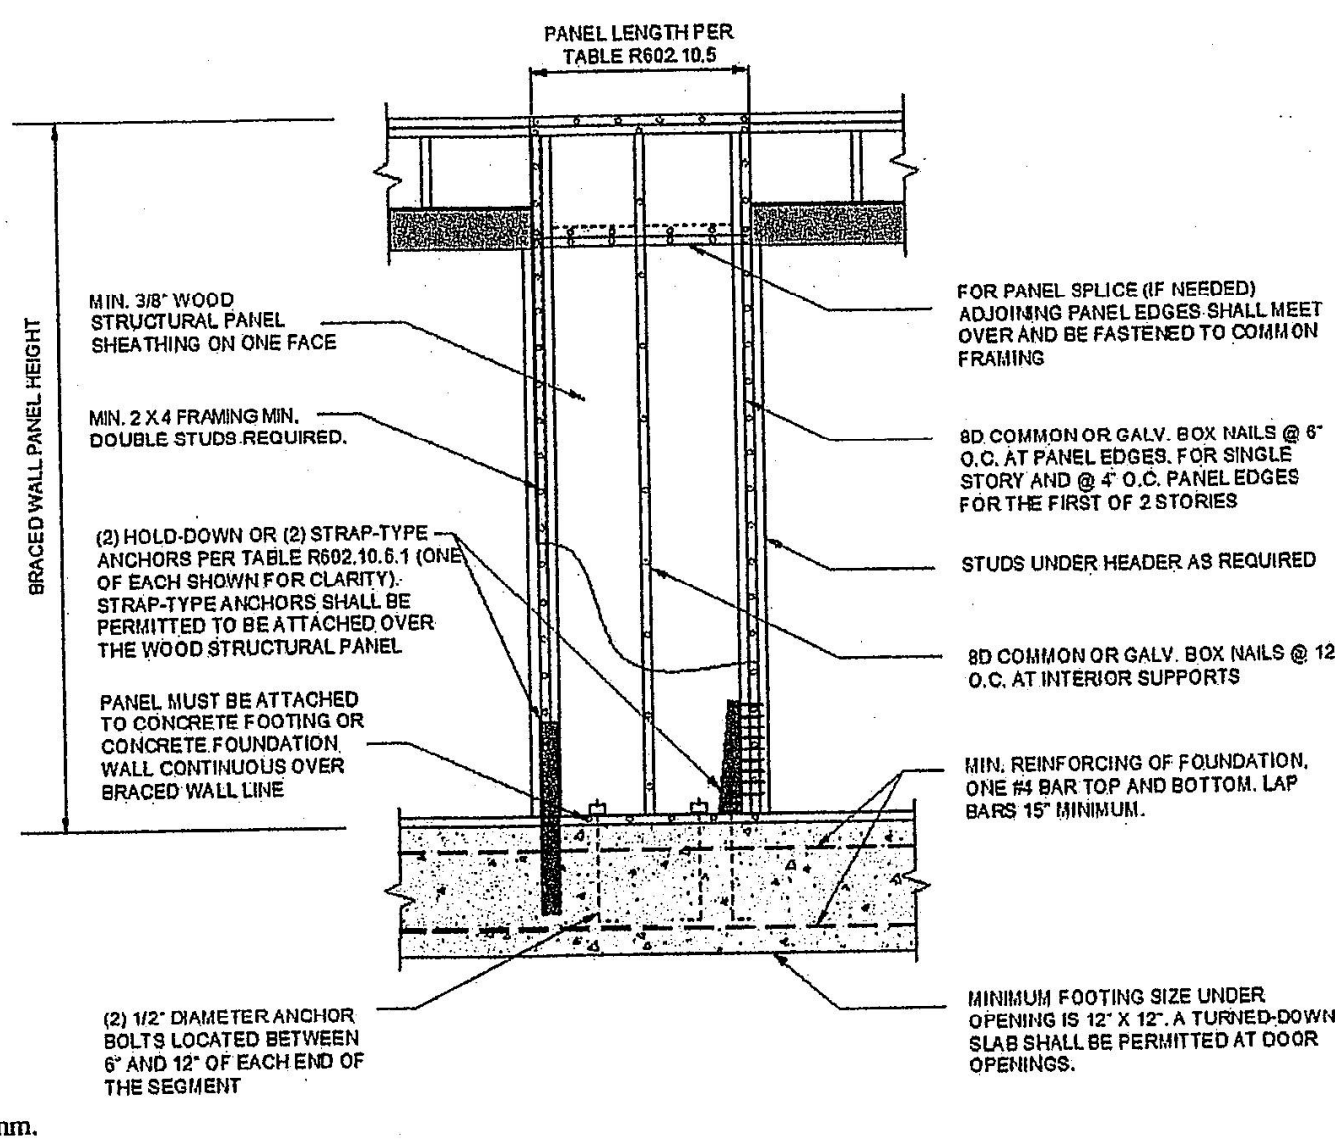


FIGURE R602.10.6.1
METHOD ABW—ALTERNATE BRACED WALL PANEL

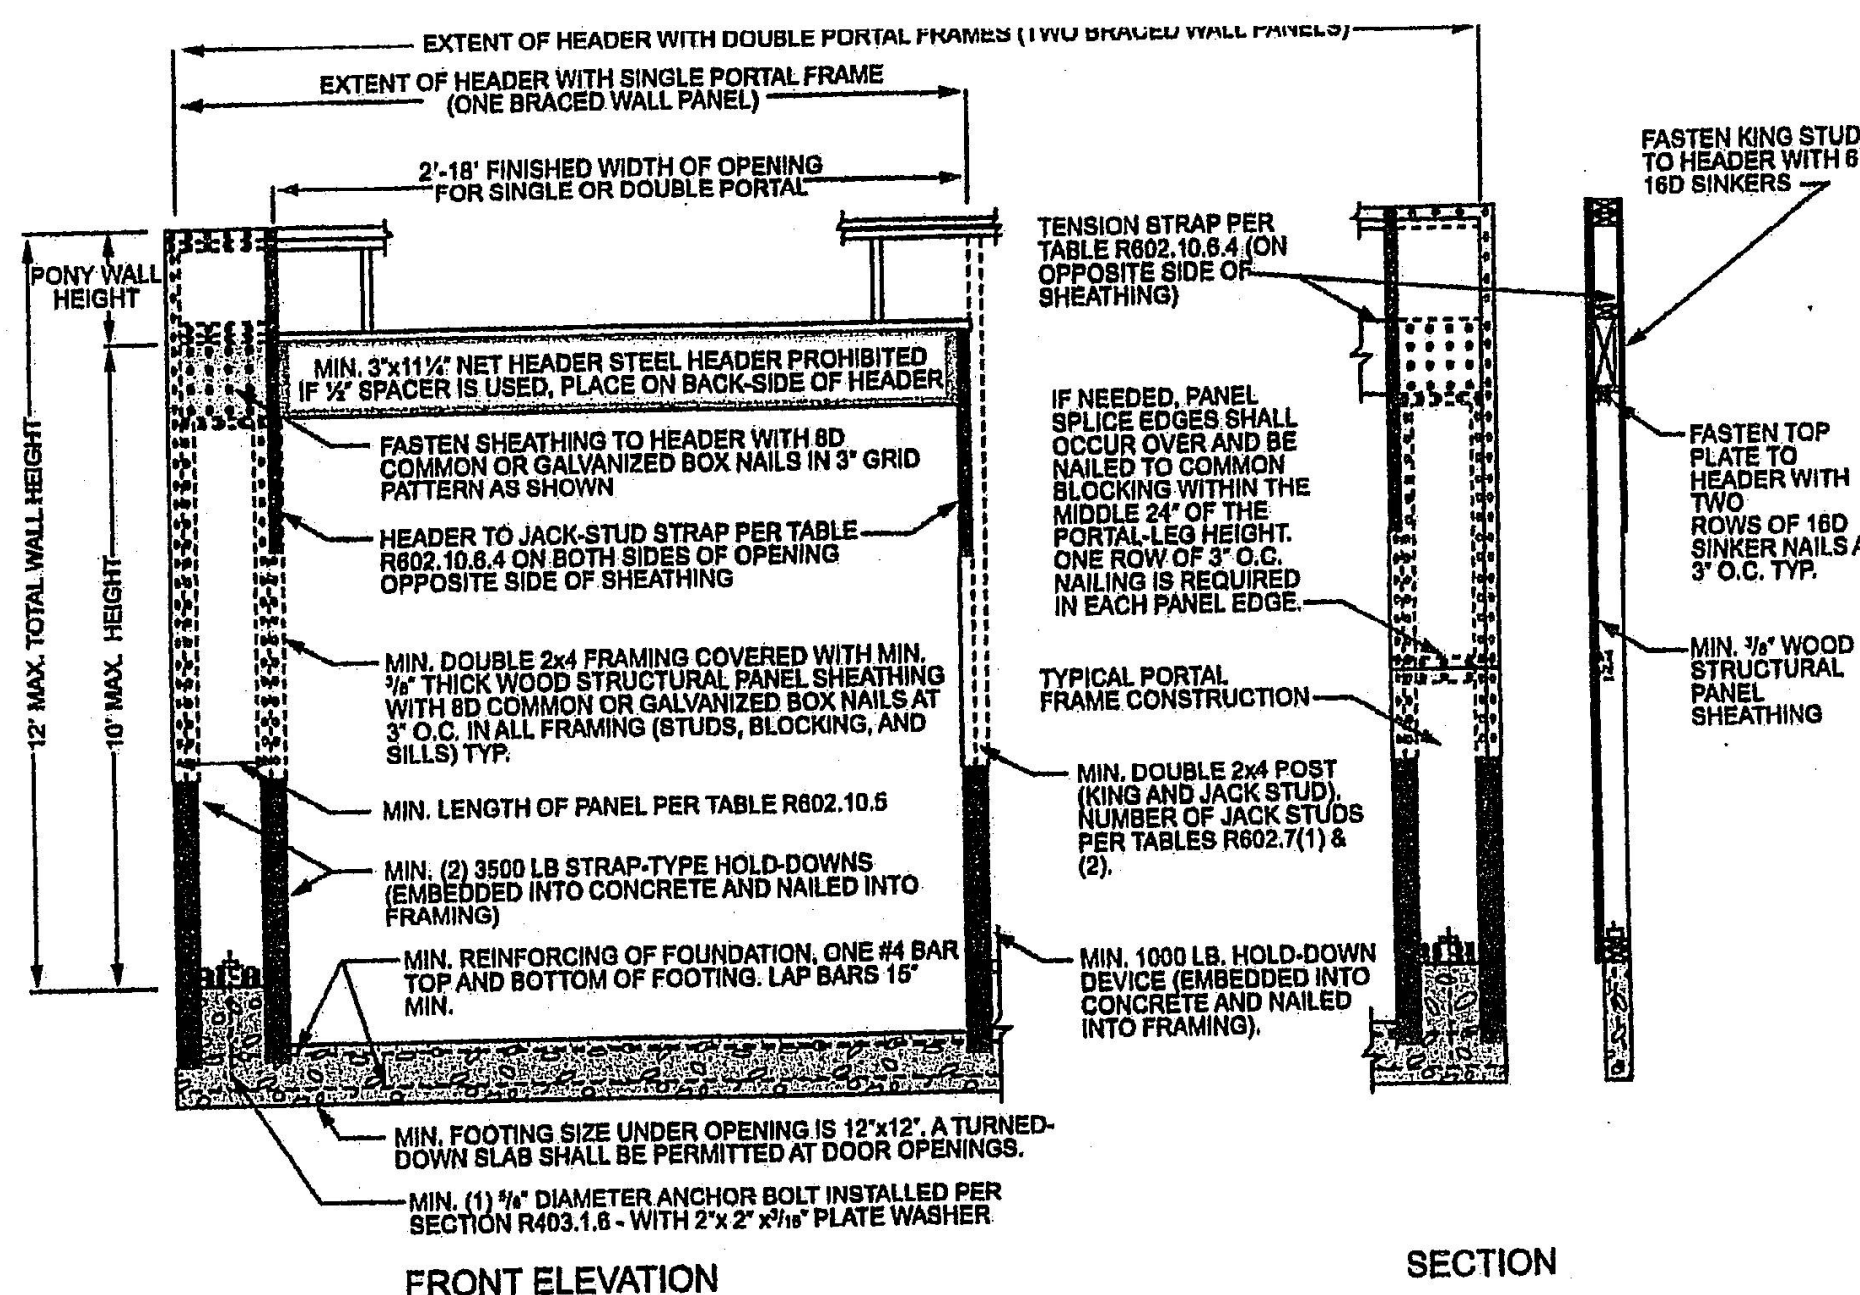


FIGURE R602.10.6.2
METHOD PFH—PORTAL FRAME WITH HOLD-DOWNS

4 mm, 1 foot = 304.8 mm.

TABLE R602.10.4 BRACING METHODS				
METHODS, MATERIAL	MINIMUM THICKNESS	FIGURE	CONNECTION CRITERIA*	
			Fasteners	Spacing
LIB Let-in-bracing	1 x 4 wood or approved metal straps at 45° to 60° angles for maximum 16" stud spacing		Wood: 2-8d common nails or 3-8d (2 1/4" long x 0.113" dia.) nails Metal strap: per manufacturer	Wood: per stud and top and bottom plates Metal: per manufacturer
DWB Diagonal wood boards	1/4" (1" nominal) for maximum 24" stud spacing		2-8d (2 1/4" long x 0.113" dia.) nails or 2 - 1 1/4" long staples	Per stud
WSP Wood structural panel (See Section R604)	3/8"		Exterior sheathing per Table R602.3(3) Interior sheathing per Table R602.3(1) or R602.3(2)	6" edges 12" field Varies by fastener
BV-WSP Wood structural panels with stone or masonry veneer (See Section R602.10.6.5)	7/16"	See Figure R602.10.6.5	8d common (2 1/2" x 0.131") nails	4" at panel edges 12" at intermediate supports 4" at braced wall panel end posts
SFB Structural fiberboard sheathing	1/2" or 5/8" for maximum 16" stud spacing		1 1/2" long x 0.12" dia. (for 1/2" thick sheathing) 1 1/4" long x 0.12" dia. (for 5/8" thick sheathing) galvanized roofing nails	3" edges 6" field
GB Gypsum board	1/2"		Nails or screws per Table R602.3(1) for exterior locations Nails or screws per Table R702.3.5 for interior locations	For all braced wall panel locations: 7" edges (including top and bottom plates) 7" field
PBS Particleboard sheathing (See Section R605)	3/8" or 1/2" for maximum 16" stud spacing		For 3/8", 6d common (2" long x 0.113" dia.) nails For 1/2", 8d common (2 1/2" long x 0.131" dia.) nails	3" edges 6" field
PCP Portland cement plaster	See Section R703.7 for maximum 16" stud spacing		1 1/2" long, 11 gage, 7/16" dia. head nails or 7/16" long, 16 gage staples	6" o.c. on all framing members
HPS Hardboard panel siding	7/16" for maximum 16" stud spacing		0.092" dia., 0.225" dia. head nails with length to accommodate 1 1/2" penetration into studs	4" edges 8" field
ABW Alternate braced wall	3/8"		See Section R602.10.6.1	See Section R602.10.6.1

TABLE R602.10.5 MINIMUM LENGTH OF BRACED WALL PANELS						
METHOD (See Table R602.10.4)	MINIMUM LENGTH* (inches)					CONTRIBUTING LENGTH (inches)
	Wall Height					
	8 feet	9 feet	10 feet	11 feet	12 feet	
DWB, WSP, SFB, PBS, PCP, HPS, BV-WSP	48	48	48	53	58	Actual ^b
GB	48	48	48	53	58	Double sided = Actual Single sided = 0.5 × Actual
LIB	55	62	69	NP	NP	Actual ^b
ABW	SDC A, B and C, ultimate design wind speed < 140 mph	28	32	34	38	48
	SDC D ₁ , D ₂ and D ₃ , ultimate design wind speed < 140 mph	32	32	34	NP	
	CS-G	24	27	30	33	36
CS-WSP, CS-SFB	Adjacent clear opening height (inches)					
	≤ 64	24	27	30	33	36
	68	26	27	30	33	36
	72	27	27	30	33	36
	76	30	29	30	33	36
	80	32	30	30	33	36
	84	35	32	32	33	36
	88	38	35	33	33	36
	92	43	37	35	35	36
	96	48	41	38	36	36
	100	—	44	40	38	38
	104	—	49	43	40	39
	108	—	54	46	43	41
	112	—	—	50	45	43
	116	—	—	55	48	45
	120	—	—	60	52	48
	124	—	—	—	56	51
	128	—	—	—	61	54
	132	—	—	—	66	58
	136	—	—	—	—	62
	140	—	—	—	—	66
144	—	—	—	—	72	
METHOD (See Table R602.10.4)		Portal header height				
		8 feet	9 feet	10 feet	11 feet	12 feet
PFH	Supporting roof only	16	16	16	Note c	Note c
	Supporting one story and roof	24	24	24	Note c	Note c
PFG		24	27	30	Note d	Note d
CS-PF	SDC A, B and C	16	18	20	Note e	Note e
	SDC D ₁ , D ₂ and D ₃	16	18	20	Note e	Note e

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 mile per hour = 0.447 m/s.
NP = Not Permitted.
a. Linear interpolation shall be permitted.
b. Use the actual length where it is greater than or equal to the minimum length.
c. Maximum header height for PFH is 10 feet in accordance with Figure R602.10.6.2, but wall height shall be permitted to be increased to 12 feet with pony wall.
d. Maximum header height for PFG is 10 feet in accordance with Figure R602.10.6.3, but wall height shall be permitted to be increased to 12 feet with pony wall.
e. Maximum header height for CS-PF is 10 feet in accordance with Figure R602.10.6.4, but wall height shall be permitted to be increased to 12 feet with pony wall.

TABLE R602.10.4—continued BRACING METHODS				
METHODS, MATERIAL	MINIMUM THICKNESS	FIGURE	CONNECTION CRITERIA*	
			Fasteners	Spacing
PFH Portal frame with hold-downs	3/4"		See Section R602.10.6.2	See Section R602.10.6.2
PFG Portal frame at garage	7/16"		See Section R602.10.6.3	See Section R602.10.6.3
CS-WSP Continuously sheathed wood structural panel	3/8"		Exterior sheathing per Table R602.3(3) Interior sheathing per Table R602.3(1) or R602.3(2)	6" edges 12" field Varies by fastener
CS-G ^a Continuously sheathed wood structural panel adjacent to garage openings	3/8"		See Method CS-WSP	See Method CS-WSP
CS-PF Continuously sheathed portal frame	7/16"		See Section R602.10.6.4	See Section R602.10.6.4
CS-SFB ^b Continuously sheathed structural fiberboard	1/2" or 5/8" for maximum 16" stud spacing		1 1/2" long x 0.12" dia. (for 1/2" thick sheathing) 1 1/4" long x 0.12" dia. (for 5/8" thick sheathing) galvanized roofing nails	3" edges 6" field

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 degree = 0.0175 rad, 1 pound per square foot = 47.8 N/m², 1 mile per hour = 0.447 m/s.
a. Adhesive attachment of wall sheathing, including Method GB, shall not be permitted in Seismic Design Categories C, D₁, D₂ and D₃.
b. Applies to panels next to garage door opening where supporting gable end wall or roof load only. Shall only be used on one wall of the garage. In Seismic Design Categories D₁, D₂ and D₃, roof covering dead load shall not exceed 3 psf.
c. Garage openings adjacent to a Method CS-G panel shall be provided with a header in accordance with Table R602.7(1). A full-height clear opening shall not be permitted adjacent to a Method CS-G panel.
d. Method CS-SFB does not apply in Seismic Design Categories D₁, D₂ and D₃.
e. Method applies to detached one- and two-family dwellings in Seismic Design Categories D₁ through D₃ only.

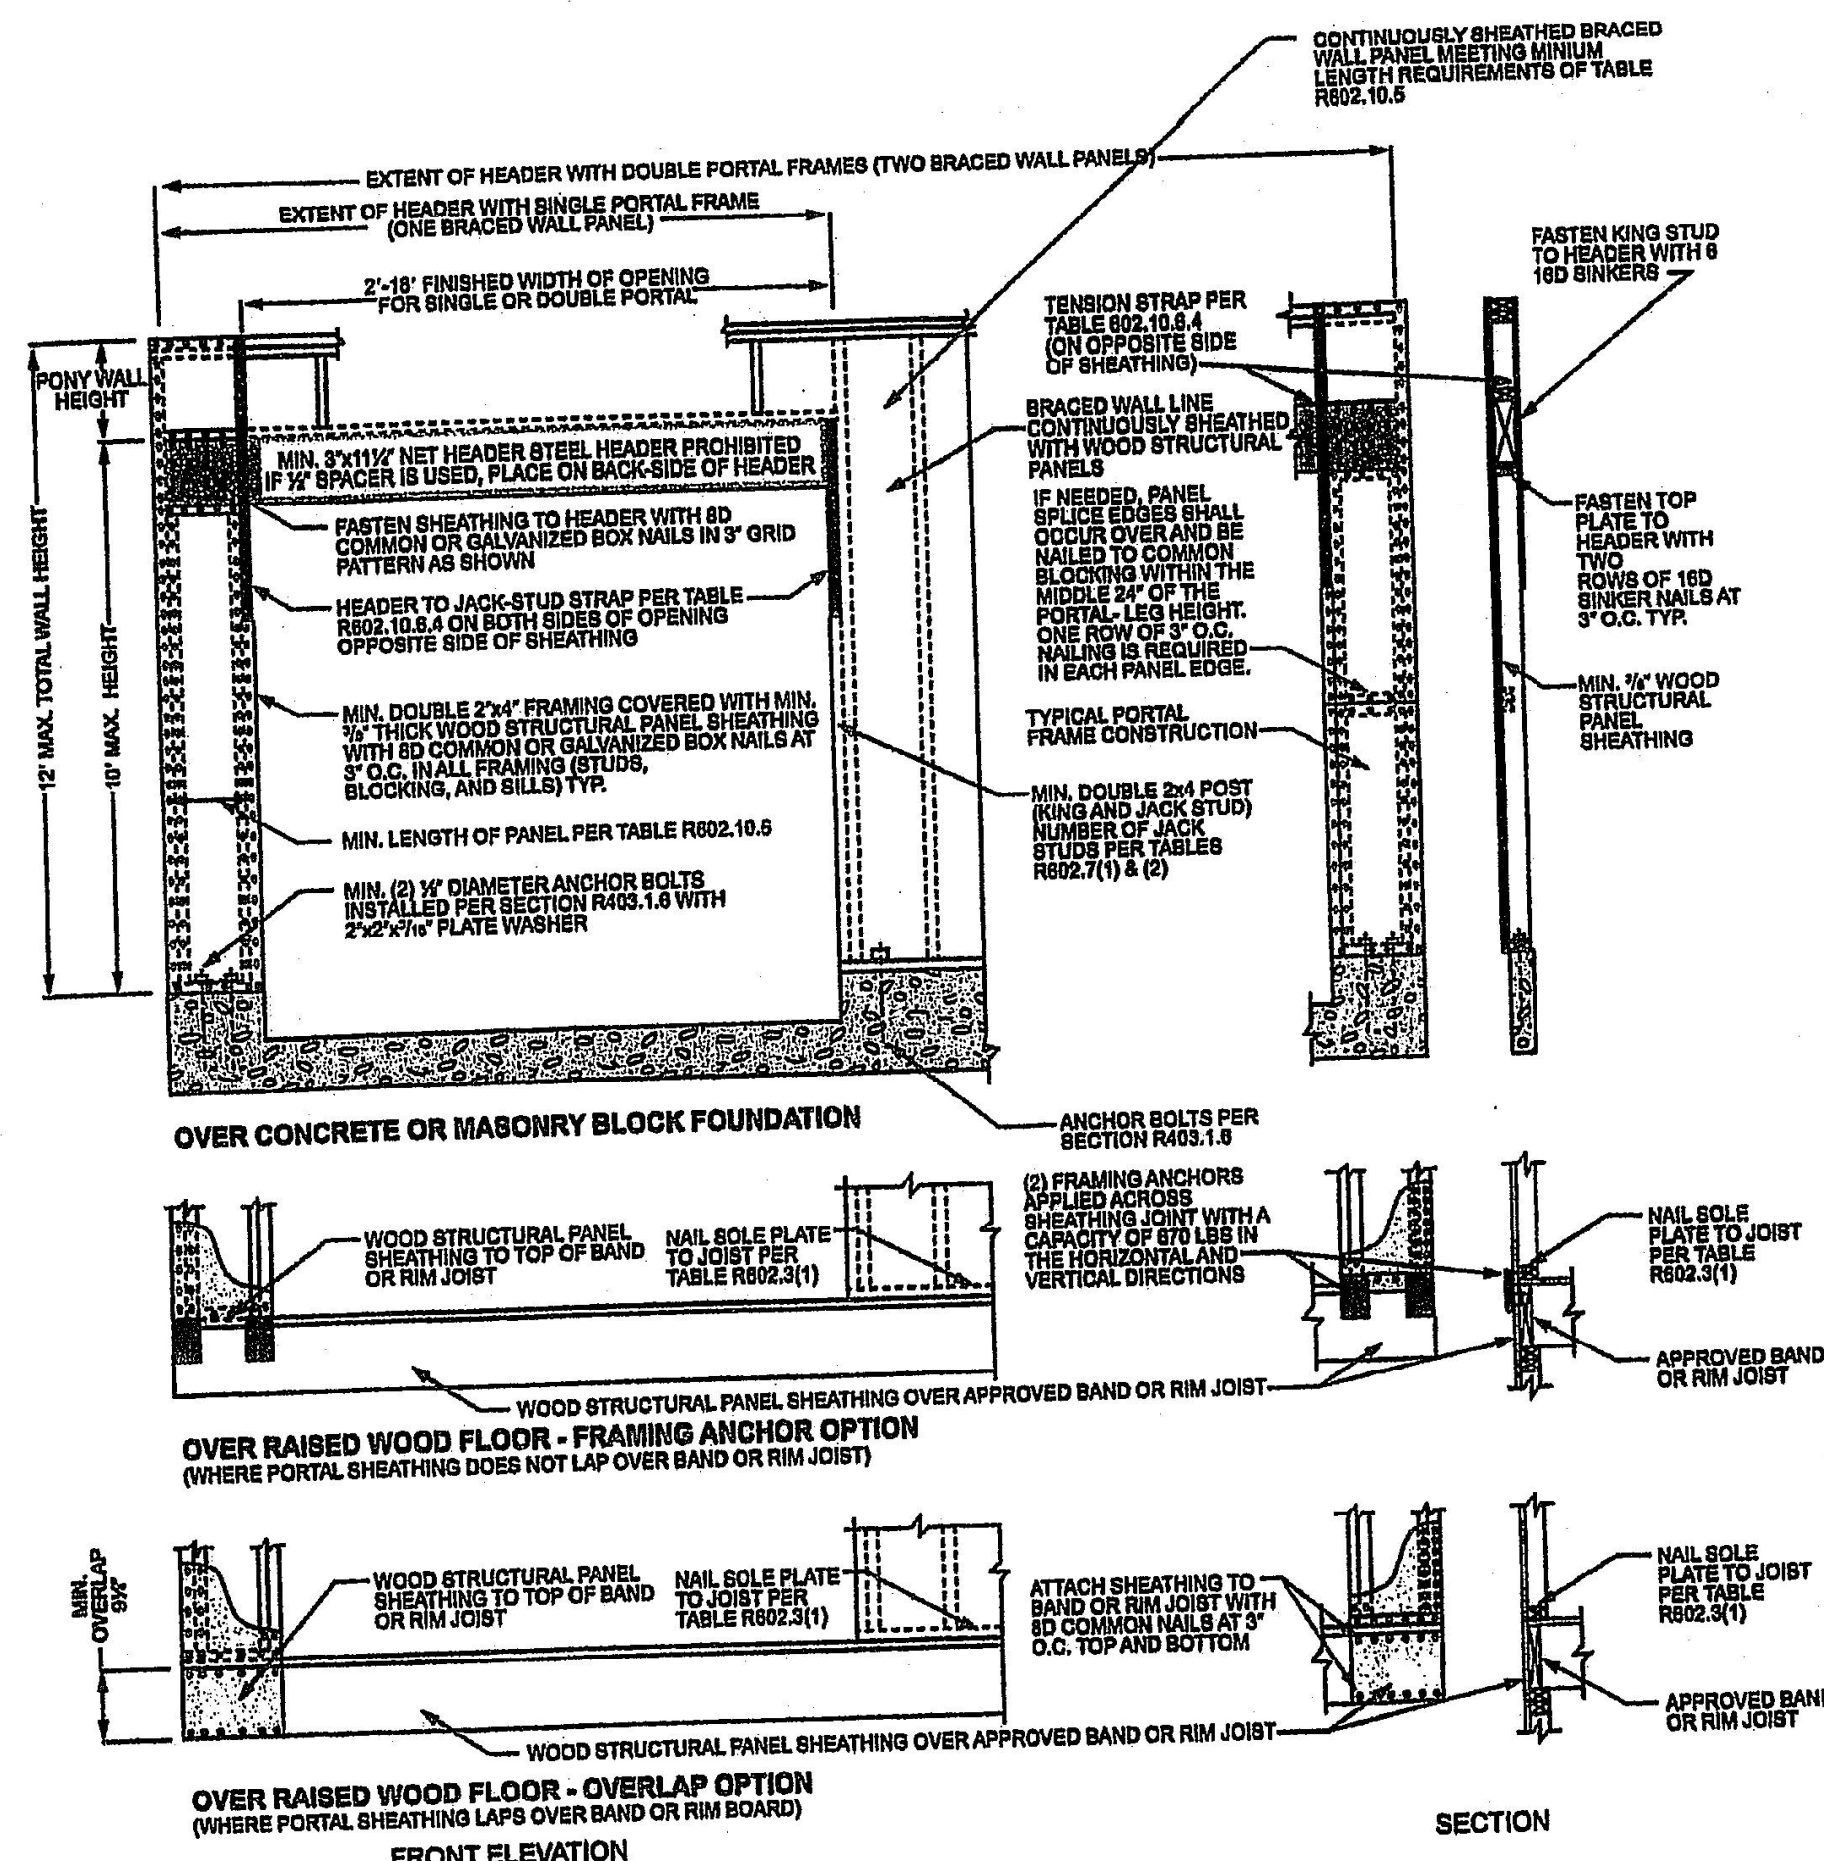


FIGURE R602.10.6.4
METHOD CS-PF—CONTINUOUSLY SHEATHED PORTAL FRAME PANEL CONSTRUCTION

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm.



BUILD IN ACCORDANCE WITH
2018 INTERNATIONAL
RESIDENTIAL CODE AND
LOCAL CODES.

LOT 107 WOODSIDE
101 AMBERSHAM
LEE SUMMIT MO

TRUMARK HOMES
KYLE II

SCALE
1/4" = 1-0

DATE
12-20-21

PLAN NO.
3709

SHEET NO.

6 of 6

BRACE WALL DETAILS
WIND SPEED 115 MPH
WIND EXPOSURE A
SEISMIC DESIGN CATEGORY A