

1. This Truss Placement Diagram is intended to serve as a guide for truss installation. This Diagram has been prepared by a Truss Technician and is not an engineered drawing.
2. The responsibilities of the Owner, Building Designer, Contractor, Truss Designer, and Truss Manufacturer shall be as defined by the TPI 1 National Standard.
3. The wood components shown on this diagram are to be used in dry service (moisture content<19%) and non-toxic environmental applications. The metal plates and hangers are galvanized to the G60 Standard unless noted otherwise.

4. Refer to the Truss Design Drawings for specific information about each individual truss design.
5. The Truss Technician shall provide Truss-to-Truss Connection Requirements. Any special or other connection shall be the responsibility of the Building Designer.
6. The Truss Placement Diagram and Truss Design Drawings are the property of Builders FirstSource and may not be reused or reproduced in part or in total under any circumstances without prior written authorization.

**7. In some cases, field framing may be required to achieve the final appearance shown on the Construction Documents.**

8. Field framing, including valley rafters, installed over roof trusses shall have a knee brace from the rafter to the truss top chord at intervals of 48" on center (O.C.) or less. Stagger knee braces from adjacent rafters such that the load is distributed uniformly over multiple truss locations and not concentrated at one location on along one truss.

9. Truss Top Chords shall be fully sheathed or have lateral bracing (purlins) spaced at 24" O.C. or less. Truss Bottom Chord Bracing shall not exceed the maximum shown on the Truss Design Drawing. Field framed bottom chord floor or ceiling attachments shall be spaced at 24" O.C. or less. Proper Bracing prevents buckling of individual truss members due to design loads.

10. This Placement Diagram is based upon the supporting structure being structurally adequate, dimensionally correct, square, plumb, and level to adequately support the trusses. The foundation design, structural member sizing, load transfer, bearing conditions, and the structure's compliance with the applicable building code are the responsibility of the Owner, Building Designer, and Contractor.

11. If Piggyback Trusses are included in this project, refer to the Mitek Piggyback Connection Detail applicable for the project details and wind load category.

**12. The Contractor shall follow the SBCA TTB Partition Separation Prevention and Solutions for truss attachment to non-load bearing walls and carefully complete these details to avoid gypsum wall board related issues.**

**WARNING:**  
TRUSSES MUST BE BRACED DURING  
INSTALLATION. FAILURE TO DO SO MAY  
RESULT IN INJURY OR DEATH. *Español -*  
(TRUSSES (CERCHAS) DEBERAN TENER UN  
SOPORTE DURANTE LA INSTALACION. NO  
HACERLO PODRIA RESULTAR EN LESIONES O  
MUERTE.)

1. Trusses shall be installed in a safe manner meeting all code, local, OSHA, TPI, and BCSI Specifications. Failure to follow these specifications may result in injury or death.

2. Buildings under construction are vulnerable to high winds and present a possible safety hazard. The Contractor is responsible for recognizing adverse weather conditions and shall take appropriate action to prevent injury or death.

3. **BCSI INSTRUCTIONS SHALL BE FOLLOWED:**  
**BCSI-B1 = Safe Truss Handling and Installation**  
**BCSI-B2 = Installation and Temporary Restraint**  
**BCSI-B3 = Permanent Restraint**  
**BCSI-B4 = Safe Construction Loading**  
**BCSI-B5 = Truss Damage and Modification**  
**Guidelines**

BCSI-B7 = Floor Truss Installation  
BCSI-B8 = Toe-Nailed Connections  
BCSI-B9 = Multi-Ply Girders

**BCSI-B10 = Post Frame Truss Installation**  
**BCSI-B11 = Fall Protection**

**4. Follow TPI Requirements for Long Span Trusses (>60').**

REVISIONS TO THE CONTRACT DOCUMENTS SHALL BE REVIEWED FOR DESIGN CONFORMANCE AND GENERAL CONFORMANCE TO CONTRACT DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSIBLE FOR CONFIRMING AND CORRELATING DIMENSIONS AT JOBSITE FOR TOLERANCE, CLEARANCE, QUANTITIES, FABRICATION, COORDINATION OF HIS OR HER WORK WITH OTHER TRADES, AND FULL COMPLIANCE WITH CONTRACT DOCUMENTS.

## STATUS

APPROVED

12/29/2021

REVIEWED BY

CPD







**ENGINEER, EVERSTEAD**

ROOF AREA: 3130.89  
HORIZONTAL OVERHANG: 331.5  
RIDGE LINES: 27.19  
VALLEY LINES: 72.79  
HIP LINES: 276.63  
RAKED OVERHANGS: 15.1

TYP WALL HEIGHT  
9'-1-1/8"

10'-1-1/8"

ROOF TRUSSES ARE 2' O.C.  
HEELS VARY BY 12" & 24" O/H

HANGER	QTY	CONNECTION
H2.5A	20	TRUSS TO BEAM/WALL TIE DOWN
SDWC15600	150	TRUSS TO WALL TIE DOWN
LUS24	30	
HUS26	7	
TJC37	 6	
LTHJA26	3	
LUS26	1	

TRUSS SITS ATOP  
FLOOR FRAMING

$$\vec{U}_T$$

ADDITIONAL  
4" ADDED TO HEEL  
- PER PLAN

**RELEASE FOR CONSTRUCTION  
AS NOTED FOR PLAN REVIEW  
DEVELOPMENT SERVICES**

## LEE'S SUMMIT, MISSOURI

12/30/2021

**DESIGN LOADS:**

25 PSF TCLL  
10 PSF TCDL  
10 PSF BCDL

PROPER HANDLING OF TRUSSES SHALL BE THE RESPONSIBILITY OF THE INSTALLATION CREW AT THE JOBSITE. TEMPORARY AND PERMANENT BRACING FOR HOLDING TRUSSES PLUMB AND FOR RESISTING LATERAL FORCES SHALL BE DESIGNED AND INSTALLED BY OTHERS. NO LOADS OTHER THAN THE INTALLERS ARE TO BE APPLIED TO TRUSSES UNTIL AFTER ALL BRACING AND FASTENING IS COMPLETED. AT NO TIME SHALL CONCENTRATED LOADS GREATER THAN DESIGN LOADS BE APPLIED TO THE TRUSSES. ALL TRUSS TO FRAMING CONNECTIONS ARE RECOMMENDATIONS ONLY AND NEED TO BE SPECIFIED BY THE BUILDING DESIGNER. TRUSSES ARE CAPABLE OF BEING MOVED  $4+1/4$  in. EITHER DIRECTION.

[WWW.BLDR.COM](http://WWW.BLDR.COM)

**Builders**  
**FirstSource**



3012161  
SUMMIT HOMES - STONEY CREEK #100 - 1ST LVL  
1812 SW HIGHTOWN DR  
LEE'S SUMMIT, MO  
TODD W MOORE  
12/13/2021

DESCRIPTION	ADDRESS	CITY	DESIGNER
-------------	---------	------	----------

## ROOF TRUSS LAYOUT

**PAGE**


**1 of 1**







1. This Truss Placement Diagram is intended to serve as a guide for truss installation. This Diagram has been prepared by a Truss Technician and is not an engineered drawing.
2. The responsibilities of the Owner, Building Designer, Contractor, Truss Designer, and Truss Manufacturer shall be as defined by the TPI 1 National Standard.
3. The wood components shown on this diagram are to be used in dry service (moisture content<19%) and non-toxic environmental applications. The metal plates and hangers are galvanized to the G60 Standard unless noted otherwise.

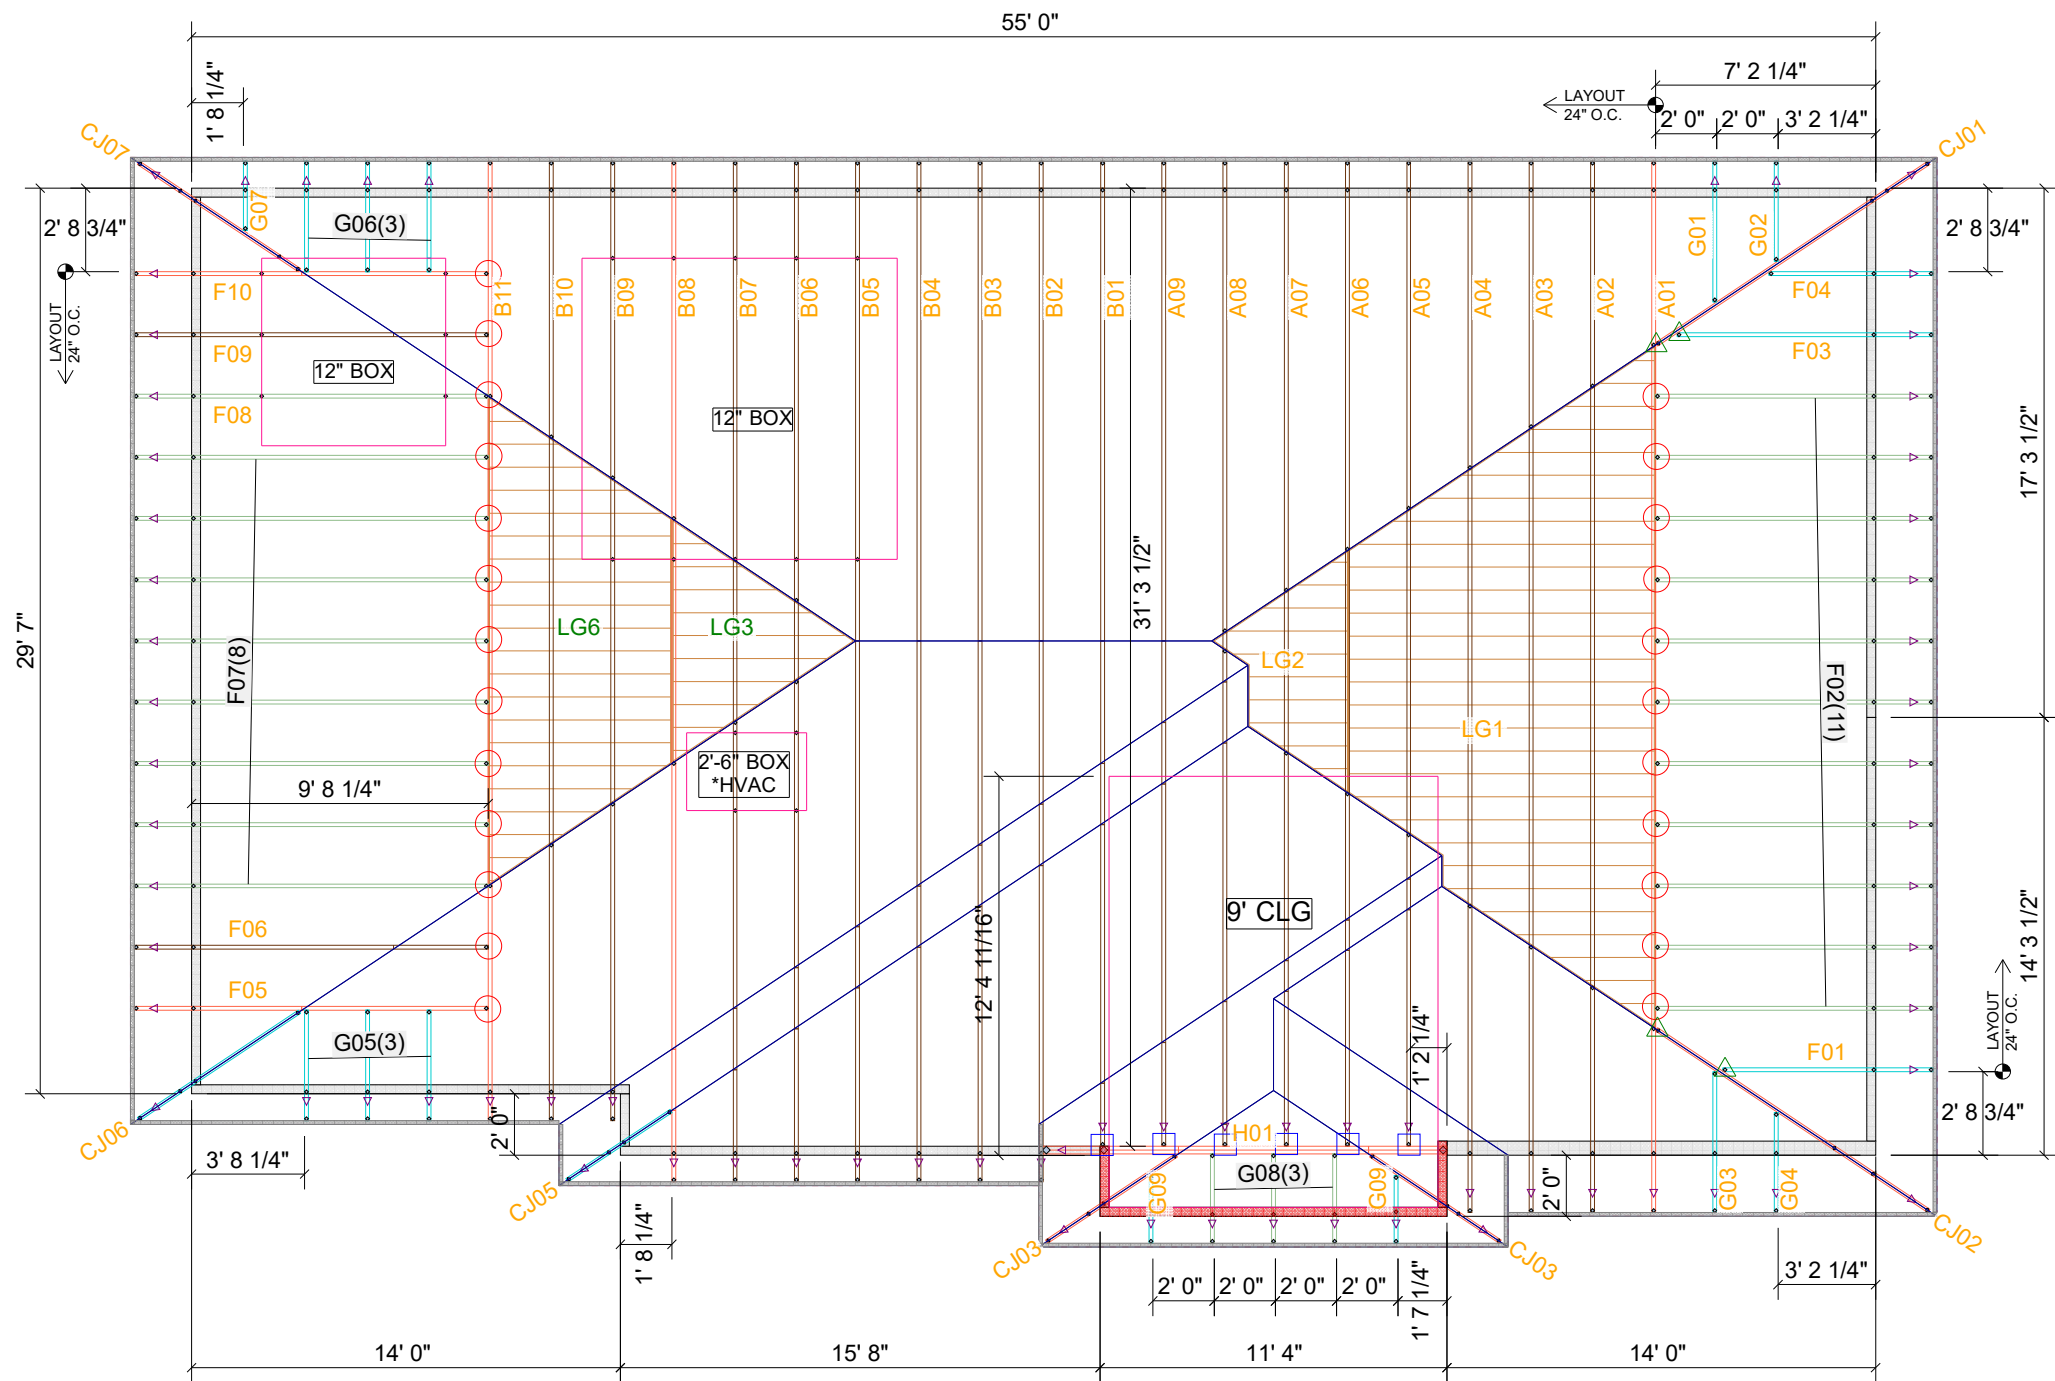1. This Truss Placement Diagram is intended to serve as a guide for truss installation. This Diagram has been prepared by a Truss Technician and is not an engineered drawing.
2. The responsibilities of the Owner, Building Designer, Contractor, Truss Designer, and Truss Manufacturer shall be as defined by the TPI 1 National Standard.
3. The wood components shown on this diagram are to be used in dry service (moisture content<19%) and non-toxic environmental applications. The metal plates and hangers are galvanized to the G60 Standard unless noted otherwise.
4. Refer to the Truss Design Drawings for specific information about each individual truss design.
5. The Truss Technician shall provide Truss-to-Truss Connection Requirements. Any special or other connection shall be the responsibility of the Building Designer.
6. The Truss Placement Diagram and Truss Design Drawings are the property of Builders FirstSource and may not be reused or reproduced in part or in total under any circumstances without prior written authorization.
7. In some cases, field framing may be required to achieve the final appearance shown on the Construction Documents.
8. Field framing, including valley rafters, installed over roof trusses shall have a knee brace from the rafter to the truss top chord at intervals of 48" on center (O.C.) or less. Stagger knee braces from adjacent rafters such that the load is distributed uniformly over multiple truss locations and not concentrated at one location or along one truss.
9. Truss Top Chords shall be fully sheathed or have lateral bracing (purlins) spaced at 24" O.C. or less. Truss Bottom Chord Bracing shall not exceed the maximum shown on the Truss Design Drawing. Field framed bottom chord floor or ceiling attachments shall be spaced at 24" O.C. or less. Proper Bracing prevents buckling of individual truss members due to design loads.
10. This Placement Diagram is based upon the supporting structure being structurally adequate, dimensionally correct, square, plumb, and level to adequately support the trusses. The foundation design, structural member sizing, load transfer, bearing conditions, and the structure's compliance with the applicable building code are the responsibility of the Owner, Building Designer, and Contractor.
11. If Piggyback Trusses are included in this project, refer to the Mitek Piggyback Connection Detail applicable for the project details and wind load category.
12. The Contractor shall follow the SBCA TTB Partition Separation Prevention and Solutions for truss attachment to non-load bearing walls and carefully complete these details to avoid gypsum wall board related issues.

**WARNING:**  
**TRUSSES MUST BE BRACED DURING**  
**INSTALLATION. FAILURE TO DO SO MAY**  
**RESULT IN INJURY OR DEATH. Español -**  
**(TRUSSES (CERCHAS) DEBERAN TENER UN**  
**SOPORTE DURANTE LA INSTALACION. NO**  
**HACERLO PODRIA RESULTAR EN LESIONES O**  
**MUERTE.)**

1. Trusses shall be installed in a safe manner meeting all code, local, OSHA, TPI, and BCSI Specifications. Failure to follow these specifications may result in injury or death.
2. Buildings under construction are vulnerable to high winds and present a possible safety hazard. The Contractor is responsible for recognizing adverse weather conditions and shall take appropriate action to prevent injury or death.
3. **BCSI INSTRUCTIONS SHALL BE FOLLOWED:**
  - BCSI-B1 = Safe Truss Handling and Installation
  - BCSI-B2 = Installation and Temporary Restraint
  - BCSI-B3 = Permanent Restraint
  - BCSI-B4 = Safe Construction Loading
  - BCSI-B5 = Truss Damage and Modification Guidelines
  - BCSI-B7 = Floor Truss Installation
  - BCSI-B8 = Toe-Nailed Connections
  - BCSI-B9 = Multi-Ply Girders
  - BCSI-B10 = Post Frame Truss Installation
  - BCSI-B11 = Fall Protection
4. Follow TPI Requirements for Long Span Trusses (>60').



HANGER	QTY	CONNECTION
H2.5A	20	TRUSS TO BEAM/WALL TIE DOWN
SDWC15600	150	TRUSS TO WALL TIE DOWN
LUS24	30	
HUS26	7	
TJC37	 6	
LTHJA26	3	
LUS26	1	

TYP WALL HEIGHT  
8'-1-1/8"

9'-1-1/8"

EVERSTEAD  
SHOP DRAWINGS/SUBMITTAL REVIEW

SUBMITTAL WAS REVIEWED FOR DESIGN CONFORMITY  
AND GENERAL CONFORMANCE TO CONTRACT  
DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSIBLE  
FOR CONFIRMING AND CORRELATING DIMENSIONS AT  
JOBSITE FOR TOLERANCE, CLEARANCE, QUANTITIES,  
FABRICATION, COORDINATION OF HIS OR HER WORK  
WITH OTHER TRADES, AND FULL COMPLIANCE WITH  
CONTRACT DOCUMENTS.

STATUS:

APPROVED

12/29/2021

REVIEWED BY:  
CPD

ENGINEER, EVERSTEAD

RELEASE FOR CONSTRUCTION  
TRUSS LAYOUT  
PAGE  
1 of 1  
LEE'S SUMMIT, MISSOURI

12/30/2021


**DESIGN LOADS:**

25 PSF TCLL  
10 PSF TCDL  
10 PSF BCDL

PROPER HANDLING OF TRUSSES SHALL BE THE RESPONSIBILITY OF THE INSTALLATION CREW AT THE JOBSITE. TEMPORARY AND PERMANENT BRACING FOR HOLDING TRUSSES PLUMB AND FOR RESISTING LATERAL FORCES SHALL BE DESIGNED AND INSTALLED BY OTHERS. NO LOADS OTHER THAN THE INSTALLERS ARE TO BE APPLIED TO TRUSSES UNTIL AFTER ALL BRACING AND FASTENING IS COMPLETED. AT NO TIME SHALL CONCENTRATED LOADS GREATER THAN DESIGN LOADS BE APPLIED TO TRUSSES. ALL TRUSS TO FRAMING CONNECTIONS ARE RECOMMENDATIONS ONLY AND NEED TO BE SPECIFIED BY THE BUILDING DESIGNER. TRUSSES ARE CAPABLE OF BEING MOVED (4'-3" 4in. EITHER DIRECTION

[WWW.BLDR.COM](http://WWW.BLDR.COM)

**Builders  
FirstSource**



JOB No.	3012161
DESCRIPTION	SUMMIT HOMES - STONEY CREEK #100 - 2ND LVL
JOB ADDRESS	1812 SW HIGHTOWN DR
CITY	LEE'S SUMMIT, MO
DESIGNER	TODD W MOORE
DATE	12/13/2021

DO NOT CUT, DRILL, NOTCH, OR OTHERWISE DAMAGE TRUSSES. Contact your BFS Representative for assistance PRIOR TO modifying any truss. Español - (NO CORTE, PERFORE, HAGA MUESCAS O DANE DE CUALQUIER OTRA MANERA LAS TRUSSES (CERCHAS DE MADERA). Contacte a su representante de BFS para asistencia ANTES de realizar cualquier modificación.)

1. This Truss Placement Diagram is intended to serve as a guide for truss installation. This Diagram has been prepared by a Truss Technician and is not an engineered drawing. 2. The responsibilities of the Owner, Building Designer, Contractor, Truss Designer, and Truss Manufacturer shall be as defined by the TPI 1 National Standard.

3. The wood components shown on this diagram are to be used in dry service (moisture content <19%) and non-toxic environmental applications. The metal plates and hangers are galvanized to the G60 Standard unless noted otherwise.

4. Refer to the Truss Design Drawings for specific information about each individual truss design.

5. The Truss Technician shall provide Truss-to-Truss Connection Requirements. Any special or other connection shall be the responsibility of the Building Designer.

6. The Truss Placement Diagram and Truss Design Drawings are the property of Builders FirstSource and may not be reused or reproduced in part or in total under any circumstances without prior written authorization.

7. In some cases, field framing may be required to achieve the final appearance shown on the Construction Documents.

8. Field framing, including valley rafters, installed over roof trusses shall have a knee brace from the rafter to the truss top chord at intervals of 48" on center (O.C.) or less. Stagger knee braces from adjacent rafters such that the load is distributed uniformly over multiple truss locations and not concentrated at one location or along one truss.

9. Truss Top Chords shall be fully sheathed or have lateral bracing (purlins) spaced at 24" O.C. or less. Truss Bottom Chord Bracing shall not exceed the maximum shown on the Truss Design Drawing. Field framed bottom chord floor or ceiling attachments shall be spaced at 24" O.C. or less. Proper Bracing prevents buckling of individual truss members due to design loads.


10. This Placement Diagram is based upon the supporting structure being structurally adequate, dimensionally correct, square, plumb, and level to adequately support the trusses. The foundation design, structural member sizing, load transfer, bearing conditions, and the structure's compliance with the applicable building code are the responsibility of the Owner, Building Designer, and Contractor.

11. If Piggyback Trusses are included in this project, refer to the Mitek Piggyback Connection Detail applicable for the project details and wind load category.

12. The Contractor shall follow the SBCE TTB Partition Separation Prevention and Solutions for truss attachment to non-load bearing walls and carefully complete these details to avoid gypsum wall board related issues.

WARNING: TRUSSES MUST BE BRACED DURING INSTALLATION. FAILURE TO DO SO MAY RESULT IN INJURY OR DEATH. Español - (TRUSSES (CERCHAS) DEBERAN TENER UN SOPORTE DURANTE LA INSTALACION. NO HACERLO PODRIA RESULTAR EN LESIONES O MUERTE.)

1. Trusses shall be installed in a safe manner meeting all code, local, OSHA, TPI, and BCSI Specifications. Failure to follow these specifications may result in injury or death. 2. Buildings under construction are vulnerable to high winds and present a possible safety hazard. The Contractor is responsible for recognizing adverse weather conditions and shall take appropriate action to prevent injury or death. 3. BCSI INSTRUCTIONS SHALL BE FOLLOWED: BCSI-B1 = Safe Truss Handling and Installation BCSI-B2 = Installation and Temporary Restraint BCSI-B3 = Permanent Restraint BCSI-B4 = Safe Construction Loading BCSI-B5 = Truss Damage and Modification Guidelines BCSI-B7 = Floor Truss Installation BCSI-B8 = Toe-Nailed Connections BCSI-B9 = Multi-Ply Girders BCSI-B10 = Post Frame Truss Installation BCSI-B11 = Fall Protection 4. Follow TPI Requirements for Long Span Trusses (>60').

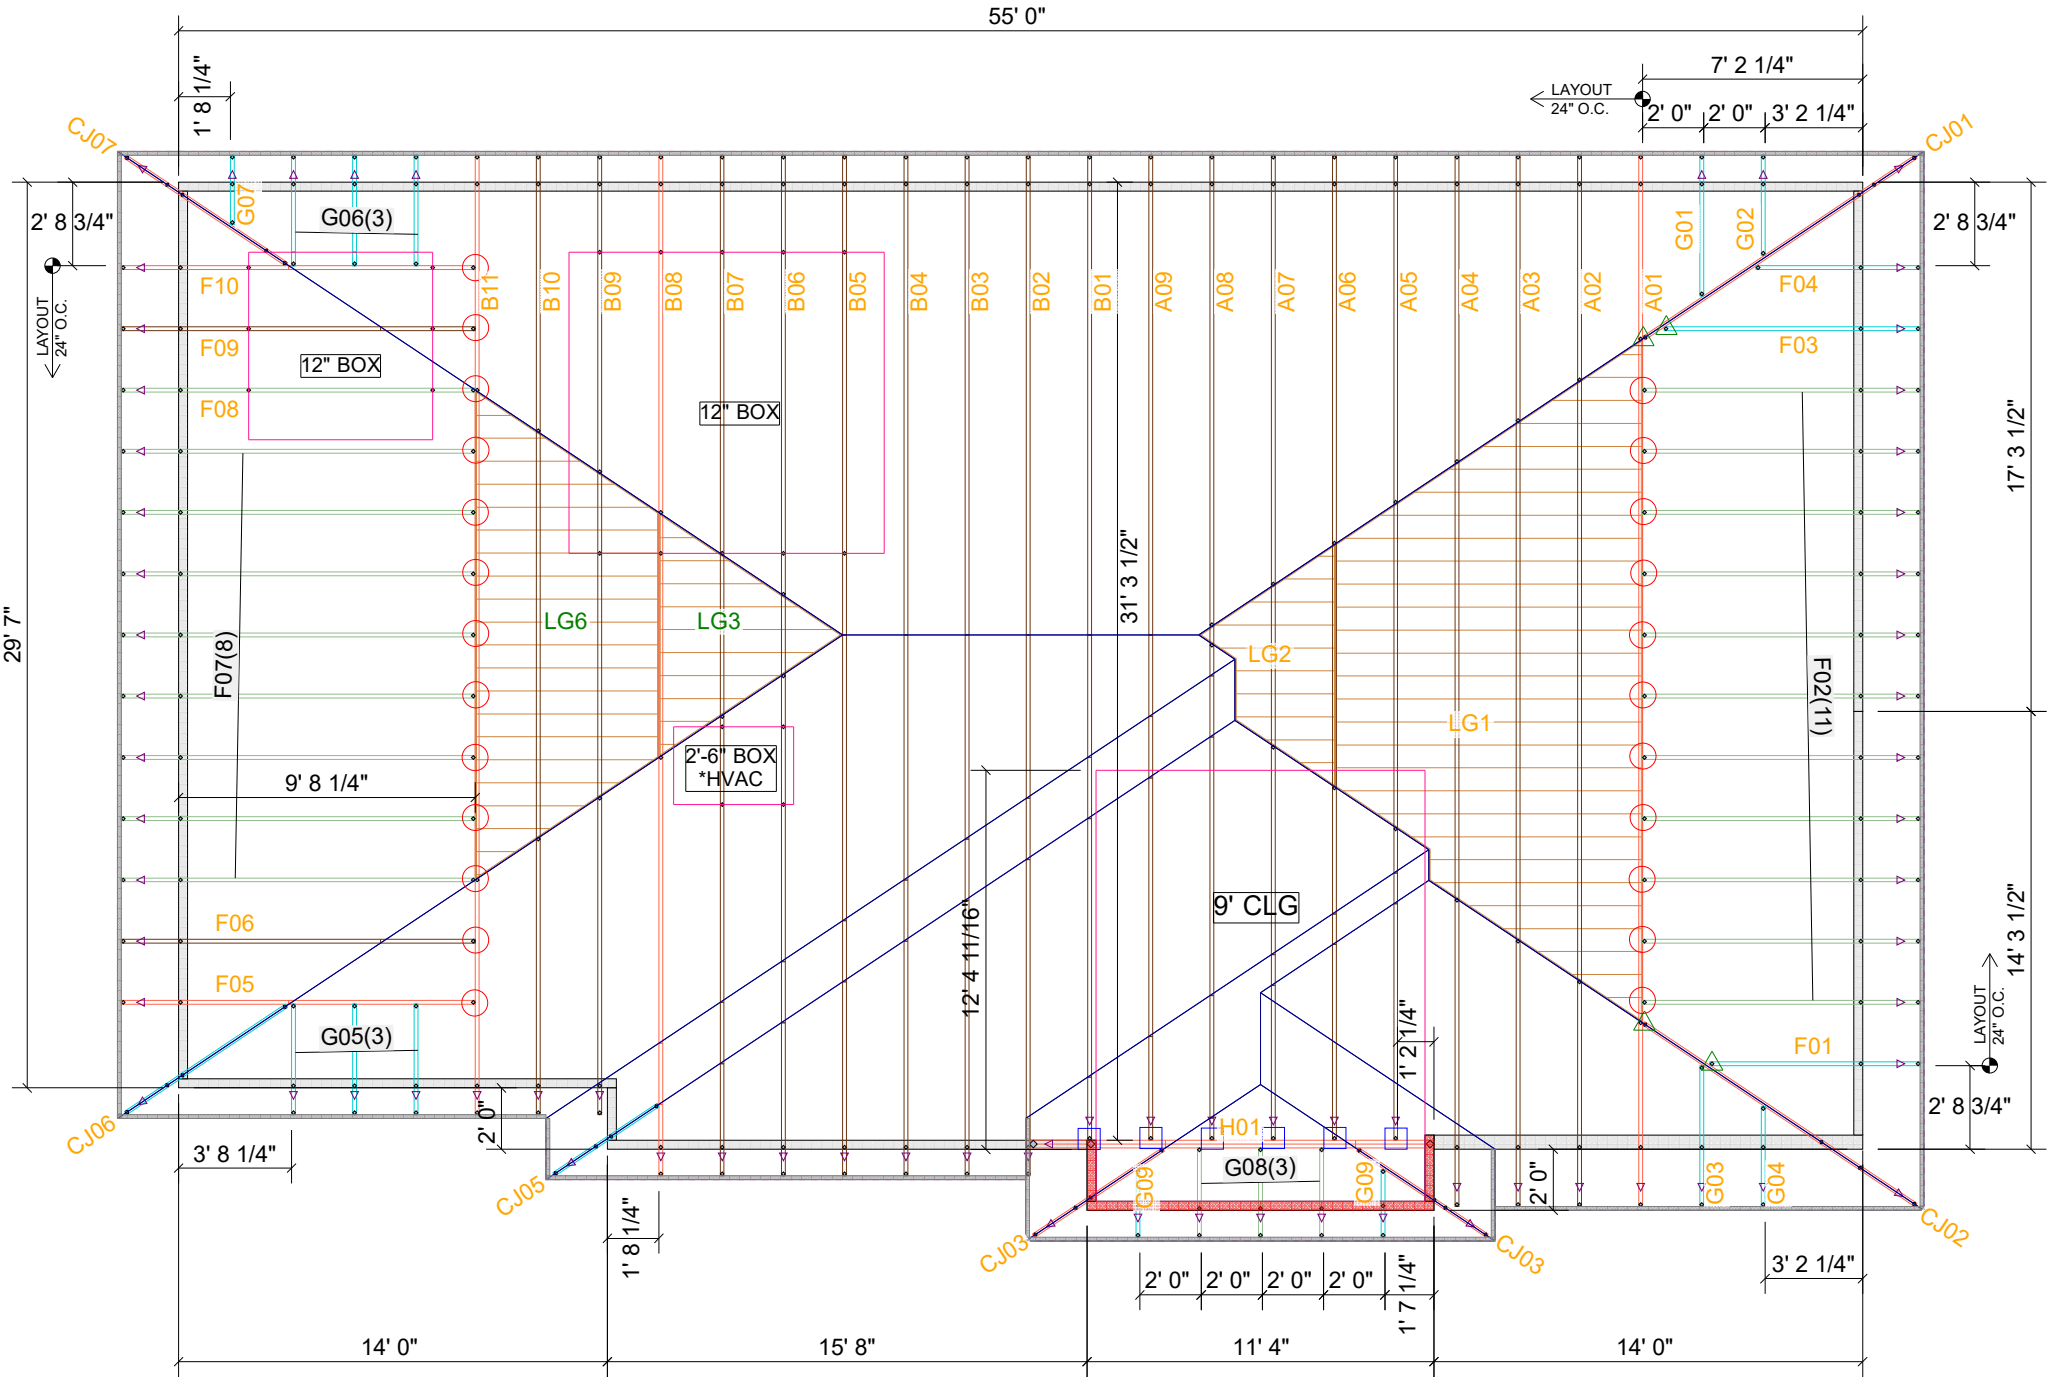

HANGER	QTY	CONNECTION
H2.5A	20	TRUSS TO BEAM/WALL TIE DOWN
SDWC15600	150	TRUSS TO WALL TIE DOWN
LUS24	30	
HUS26	7	
TJC37	6	
LTHJA26	3	
LUS26	1	

TYP WALL HEIGHT
8'-1-1/8"
9'-1-1/8"

DESIGN LOADS:

25 PSF TCLL  
10 PSF TC DL  
10 PSF BC DL

PROPER HANDLING OF TRUSSES SHALL BE THE RESPONSIBILITY OF THE INSTALLATION CREW AT THE JOBSITE. TEMPORARY AND PERMANENT BRACING FOR HOLDING TRUSSES PLUMB AND FOR RESISTING LATERAL FORCES SHALL BE DESIGNED AND INSTALLED BY OTHERS. NO LOADS OTHER THAN THE INSTALLERS ARE TO BE APPLIED TO TRUSSES UNTIL AFTER ALL BRACING AND FASTENING IS COMPLETED. AT NO TIME SHALL CONCENTRATED LOADS GREATER THAN DESIGN LOADS BE APPLIED TO THE TRUSSES. ALL TRUSS TO FRAMING CONNECTIONS ARE RECOMMENDATIONS ONLY AND NEED TO BE SPECIFIED BY THE BUILDING DESIGNER. TRUSSES ARE CAPABLE OF BEING MOVED (+/-) 4in. EITHER DIRECTION

WWW.BLDG.COM

Builders  
FirstSource



JOB No.	3012161
DESCRIPTION	SUMMIT HOMES - STONEY CREEK #100 - 2ND LVL
JOB ADDRESS	1812 SW HIGHTOWN DR
CITY	LEE'S SUMMIT, MO
DESIGNER	TODD W MOORE
DATE	12/13/2021

RELEASE FOR CONSTRUCTION  
AS NOTED FOR THE PROJECT  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI

12/30/2021