



MiTek USA, Inc.  
16023 Swingley Ridge Rd  
Chesterfield, MO 63017  
314-434-1200

Re: 3016791  
SUMMIT/STONE CREEK #95/MO

The truss drawing(s) referenced below have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Builders FirstSource (Valley Center).

Pages or sheets covered by this seal: I49249756 thru I49249811

My license renewal date for the state of Missouri is December 31, 2021.

Missouri COA: Engineering 001193



December 15, 2021

Sevier, Scott ,Engineer

**IMPORTANT NOTE:** The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	A1	Piggyback Base Supported Gable	1	1	149249756

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:10 2021 Page 1  
ID:pEl2ISnelCAFSbWVgXHdMlzCDRM-PXWdmJc3kkIYDdaa8qix206RgQ0qSbQeAc1iZpy94Wh

Job Reference (optional)

7-9-8 19-8-8 39-9-0 40-7-8 0-10-8  
7-9-8 11-11-0 20-0-8

Scale = 1:72.6

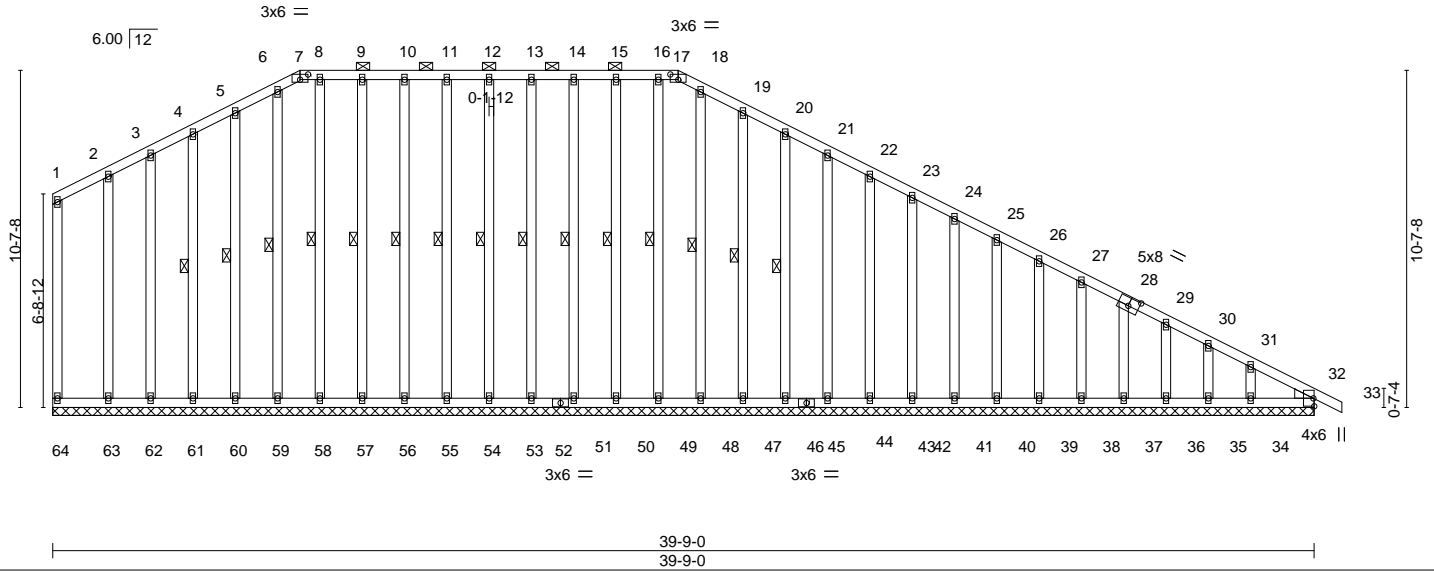


Plate Offsets (X,Y)-- [7:0-3-0,0-2-0], [17:0-3-0,0-2-0], [28:0-4-0,0-3-0]

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.22	Vert(LL) -0.00	32	n/r	120	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.12	Vert(CT) -0.00	32	n/r	120		
BCLL 0.0	Rep Stress Incr YES	WB 0.10	Horz(CT) 0.02	32	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-S						
							Weight: 341 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2  
WEDGE  
Right: 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 7-17.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 18-48, 16-49, 15-50, 14-51, 13-53, 12-54, 11-55, 10-56, 9-57, 8-58, 6-59, 5-60, 4-61, 19-47, 20-46

#### REACTIONS.

All bearings 39-9-0.  
(lb) - Max Horz 64=-322(LC 8)  
Max Uplift All uplift 100 lb or less at joint(s) 64, 48, 49, 50, 51, 53, 54, 55, 56, 57, 58, 59, 60, 61, 62, 63, 47, 46, 44, 43, 42, 41, 40, 39, 38, 37, 36, 35, 34, 32  
Max Grav All reactions 250 lb or less at joint(s) 64, 48, 49, 50, 51, 53, 54, 55, 56, 57, 58, 59, 60, 61, 62, 63, 47, 46, 44, 43, 42, 41, 40, 39, 38, 37, 36, 35, 34, 32

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 5-6=-167/282, 6-7=-160/279, 7-8=-153/277, 8-9=-153/277, 9-10=-153/277, 10-11=-153/277, 11-12=-153/277, 12-13=-153/277, 13-14=-153/277, 14-15=-153/277, 15-16=-153/277, 16-17=-153/277, 17-18=-160/279, 18-19=-167/282, 30-31=-255/157, 31-32=-328/192  
BOT CHORD 63-64=-167/310, 62-63=-167/310, 61-62=-167/310, 60-61=-167/310, 59-60=-167/310, 58-59=-167/310, 57-58=-167/310, 56-57=-167/310, 55-56=-167/310, 54-55=-167/310, 53-54=-167/310, 51-53=-167/310, 50-51=-167/310, 49-50=-167/310, 48-49=-167/310, 47-48=-167/310, 46-47=-167/310, 44-46=-167/310, 43-44=-167/310, 42-43=-167/310, 41-42=-167/310, 40-41=-167/310, 39-40=-167/310, 38-39=-167/310, 37-38=-167/310, 36-37=-164/305, 35-36=-164/305, 34-35=-164/305, 32-34=-164/305

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-1-12 to 4-5-0, Exterior(2N) 4-5-0 to 7-9-8, Corner(3R) 7-9-8 to 11-9-3, Exterior(2N) 11-9-3 to 19-8-8, Corner(3R) 19-8-8 to 23-8-3, Exterior(2N) 23-8-3 to 40-7-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1-4-0 oc.

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the design designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



December 15, 2021



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	A1	Piggyback Base Supported Gable	1	1	I49249756

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:11 2021 Page 2  
ID:pEI2tSnelCAFSbWVgXHdMizCDRM-tk4?zfchV2tPrn8niXDAaEfcQqM2B2goPGmG6Fy94Wg

- NOTES-**
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 64, 48, 49, 50, 51, 53, 54, 55, 56, 57, 58, 59, 60, 61, 62, 63, 47, 46, 44, 43, 42, 41, 40, 39, 38, 37, 36, 35, 34, 32.
  - 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO	149249757
3016791	A2	Piggyback Base	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:21 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMizCDRM-afhn33ky878\_1JviHeOW\_L49OsaDXObGigBoSgy94WW



Scale = 1:72.1

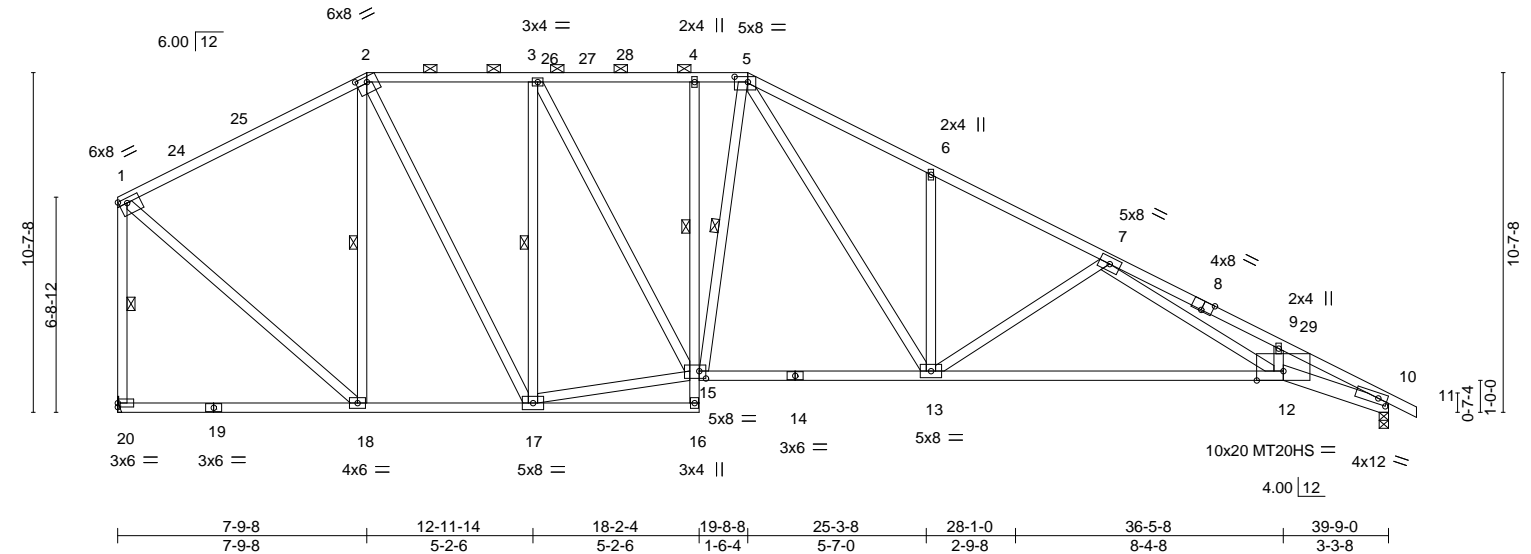


Plate Offsets (X,Y)-- [1:Edge,0-1-12], [2:0-4-0,0-1-15], [5:0-5-0,0-2-0], [8:0-4-0,Edge], [10:0-3-7,0-2-0], [15:0-2-8,0-2-12]

LOADING (psf)	SPACING-	CSL.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.96	Vert(LL) -0.47	12-13	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.90	Vert(CT) -1.10	12-13	>431	180	MT20HS	148/108
BCLL 0.0	Rep Stress Incr YES	WB 0.78	Horz(CT) 0.26	10	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS						
							Weight: 226 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2 \*Except\*  
5-8,8-11: 2x4 SPF 1650F 1.5E  
BOT CHORD 2x4 SPF No.2 \*Except\*  
10-12: 2x6 SPF 2100F 1.8E, 12-14: 2x4 SPF 1650F 1.5E  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (4-0-3 max.): 2-5.  
BOT CHORD Rigid ceiling directly applied. Except:  
1 Row at midpt 4-15  
WEBS 1 Row at midpt 2-18, 3-17, 5-15, 1-20

#### REACTIONS.

(size) 20=Mechanical, 10=0-3-8  
Max Horz 20=-324(LC 10)  
Max Uplift 20=-259(LC 12), 10=-358(LC 13)  
Max Grav 20=1782(LC 1), 10=1844(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1327/332, 2-3=-1506/408, 3-4=-1879/461, 4-5=-1880/459, 5-6=-2984/708,  
6-7=-2984/575, 7-9=-6052/1149, 9-10=-6171/1044, 1-20=-1708/346  
BOT CHORD 18-20=-145/269, 17-18=-79/1093, 4-15=-255/109, 13-15=-87/1897, 12-13=-506/3320,  
10-12=-882/5551  
WEBS 2-18=-767/227, 2-17=-226/1006, 3-17=-1075/237, 15-17=-103/1456, 3-15=-171/777,  
1-18=-238/1384, 6-13=-386/227, 5-13=-370/1311, 7-13=-885/309, 7-12=-454/2498

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 4-1-7, Interior(1) 4-1-7 to 7-9-8, Exterior(2R) 7-9-8 to 13-4-15, Interior(1) 13-4-15 to 19-8-8, Exterior(2R) 19-8-8 to 25-5-4, Interior(1) 25-5-4 to 40-7-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 20=259, 10=358.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO	I49249758
3016791	A3	Piggyback Base	4	1	Job Reference (optional)	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:22 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-2rF9HPlavQGfTUuLviXyCkMgXSGv4PxUxL?6y94WV

7-9-8	13-9-0	19-8-8	25-3-8	30-10-8	36-5-8	39-9-0	40-7-8
7-9-8	5-11-8	5-11-8	5-7-0	5-7-0	5-7-0	3-3-8	0-10-8

Scale = 1:73.6

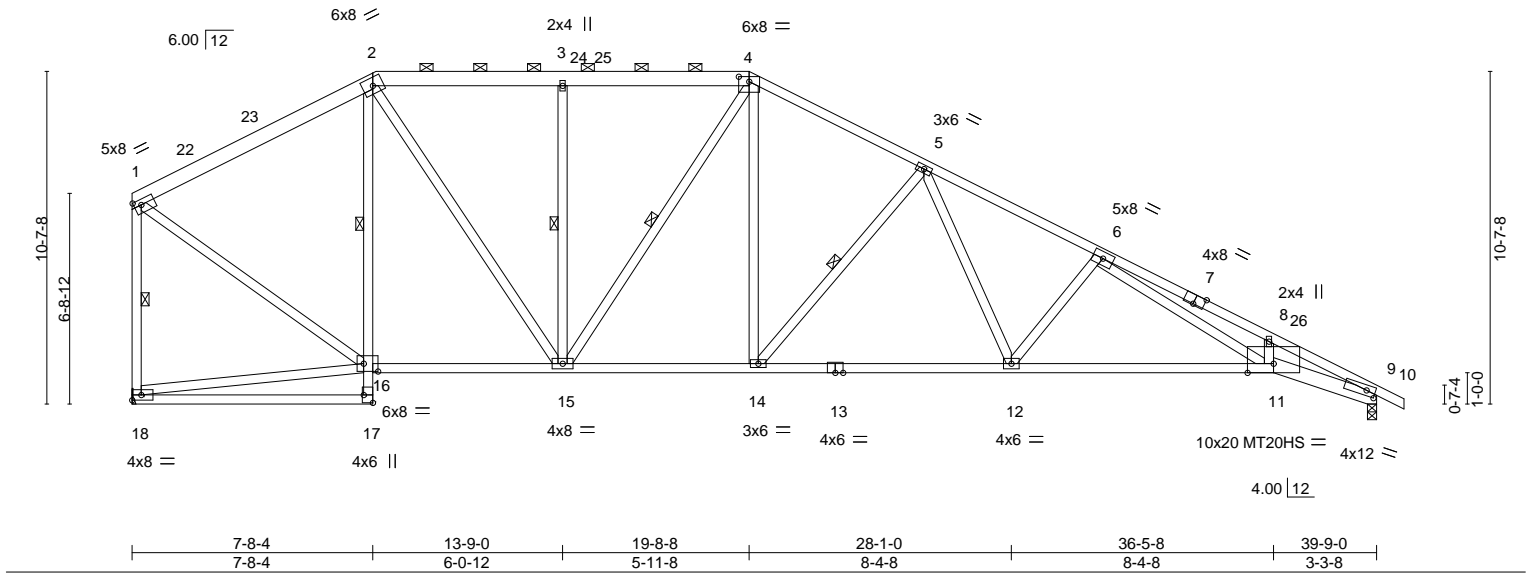

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.92	Vert(LL)	-0.40 11-12 >999 240	MT20		197/144	
TCDL	10.0	Lumber DOL	1.15	BC	0.84	Vert(CT)	-0.80 11-12 >596 180	MT20HS		148/108	
BCLL	0.0	Rep Stress Incr	YES	WB	0.57	Horz(CT)	0.27 9 n/a n/a				
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 223 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x6 SPF No.2 *Except* 4-7,7-10: 2x4 SPF 1650F 1.5E	TOP CHORD	Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (5-4-14 max.): 2-4.
BOT CHORD	2x4 SPF No.2 *Except* 9-11: 2x6 SPF 2100F 1.8E, 11-13: 2x4 SPF 1650F 1.5E	BOT CHORD	Rigid ceiling directly applied. Except:
WEBS	2x4 SPF No.2	WEBS	1 Row at midpt 2-16 1 Row at midpt 3-15, 4-15, 5-14, 1-18

REACTIONS.	
(size)	18=Mechanical, 9=0-3-8
Max Horz	18=-318(LC 10)
Max Uplift	18=-180(LC 12), 9=-314(LC 13)
Max Grav	18=1782(LC 1), 9=1844(LC 1)

FORCES.	
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	1-2=-1454/332, 2-3=-1748/424, 3-4=-1749/426, 4-5=-2243/464, 5-6=-3316/556, 6-8=-5937/1014, 8-9=-6046/908, 1-18=-1706/316
BOT CHORD	2-16=-725/231, 15-16=-94/1213, 14-15=-85/1915, 12-14=-220/2527, 11-12=-394/3352, 9-11=-761/5432
WEBS	3-15=-454/193, 4-15=-349/150, 4-14=-180/848, 5-14=-936/314, 5-12=-160/892, 6-12=-765/274, 6-11=-444/2334, 1-16=-234/1458, 2-15=-195/1044

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 4-1-7, Interior(1) 4-1-7 to 7-8-4, Exterior(2R) 7-8-4 to 13-3-11, Interior(1) 13-3-11 to 19-8-8, Exterior(2R) 19-8-8 to 25-3-8, Interior(1) 25-3-8 to 40-7-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Provide adequate drainage to prevent water ponding.
  - All plates are MT20 plates unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Refer to girder(s) for truss to truss connections.
  - Bearing at joint(s) 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 18=180, 9=314.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	A5	Piggyback Base	2	1	149249759

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:23 2021 Page 1

ID: pEl2tSneICAFSbWVgXHdMlzCDRM-W1pXUlmCgkOiHd34P2R\_4m9acgJk?PhZ98gvXZy94WU

Job Reference (optional)

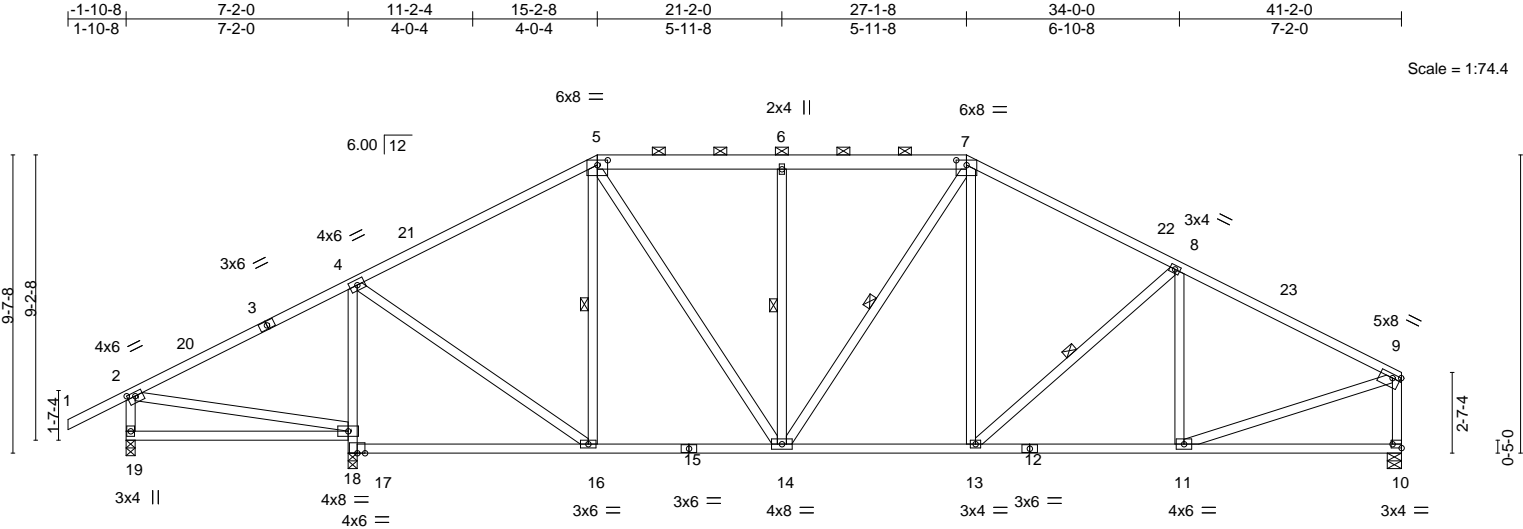


Plate Offsets (X,Y)--	[2:0-3-0,0-1-8],	[5:0-4-0,0-1-15],	[7:0-4-0,0-1-15],	[9:0-3-0,0-1-8],	[10:Edge,0-1-8]
-----------------------	------------------	-------------------	-------------------	------------------	-----------------

LOADING (psf)	SPACING-	CSL	DEFL.	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.59	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.64	Vert(LL) -0.08 16-17 >999 240		
BCLL 0.0	Rep Stress Incr YES	WB 0.36	Vert(CT) -0.18 16-17 >999 180		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS	Horz(CT) 0.04 10 n/a n/a		
				Weight: 215 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2 *Except* 5-7: 2x6 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-7.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	WEBS 1 Row at midpt 5-16, 6-14, 7-14, 8-13

**REACTIONS.** (size) 19=0-3-8, 10=0-5-8, 17=0-3-8  
Max Horz 19=197(LC 11)  
Max Uplift 19=-66(LC 12), 10=-279(LC 13), 17=-361(LC 12)  
Max Grav 19=398(LC 25), 10=1494(LC 1), 17=1951(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 4-5=-1191/314, 5-6=-1316/380, 6-7=-1316/380, 7-8=-1599/379, 8-9=-1748/341,  
2-19=-330/209, 9-10=-1424/303  
BOT CHORD 17-18=-1876/391, 4-18=-1768/394, 14-16=-124/954, 13-14=-152/1321, 11-13=-256/1475  
WEBS 4-16=-134/1218, 5-16=-545/139, 5-14=-165/749, 6-14=-473/200, 7-13=-53/338,  
8-11=-327/137, 9-11=-223/1455

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 2-2-14, Interior(1) 2-2-14 to 15-2-8, Exterior(2R) 15-2-8 to 21-2-0, Interior(1) 21-2-0 to 27-1-8, Exterior(2R) 27-1-8 to 32-11-6, Interior(1) 32-11-6 to 41-0-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Bearing at joint(s) 17 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 19 except (jt=lb) 10=279, 17=361.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 15, 2021




Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	A6	Piggyback Base	2	1	149249760

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:25 2021 Page 1

ID:pEl2tSneICAFSbWVgXHdMlzCDRM-TQwlvRnTCLQWxDTWTT9BEvuT?TTJGrdS9?bRy94WS

Job Reference (optional)



Scale = 1:78.3

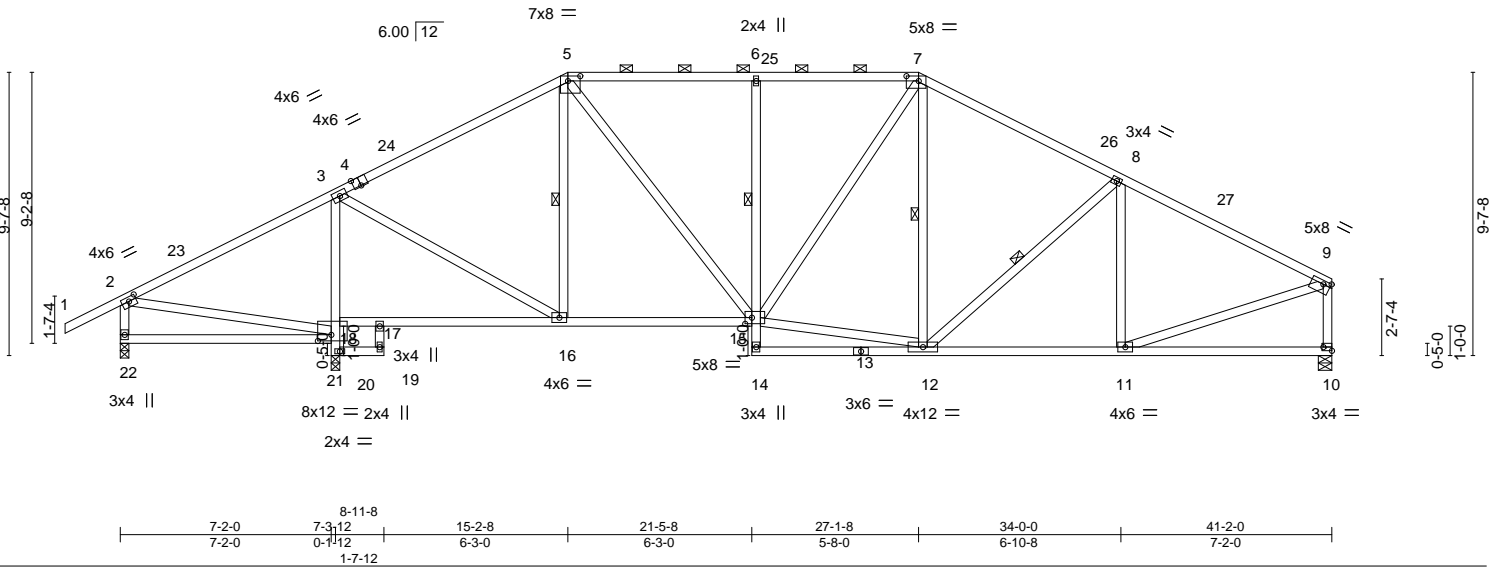


Plate Offsets (X,Y)-- [2:0-3-0,0-1-12], [4:0-3-0,Edge], [5:0-5-0,0-2-0], [7:0-5-0,0-2-0], [9:0-3-0,0-1-8], [10:Edge,0-1-8], [15:0-2-12,0-2-8], [21:0-5-8,0-2-8]

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.60	Vert(LL) -0.08	6	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.69	Vert(CT) -0.16	15-16	>999	180		
BCLL 0.0	Rep Stress Incr YES	WB 0.35	Horz(CT) 0.04	10	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS					Weight: 213 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (4-5-3 max.): 5-7.  
BOT CHORD Rigid ceiling directly applied. Except:  
WEBS 1 Row at midpt 6-15  
1 Row at midpt 5-16, 7-12, 8-12

#### REACTIONS.

(size) 22=0-3-8, 10=0-5-8, 20=0-3-8  
Max Horz 22=197(LC 11)  
Max Uplift 22=-84(LC 12), 10=-281(LC 13), 20=-337(LC 12)  
Max Grav 22=323(LC 25), 10=1476(LC 1), 20=2054(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-69/338, 3-5=-1251/319, 5-6=-1432/394, 6-7=-1425/392, 7-8=-1569/382, 8-9=-1724/344, 2-22=-256/213, 9-10=-1406/305  
BOT CHORD 20-21=-1995/354, 18-21=-1866/362, 3-18=-1834/378, 15-16=-152/1007, 6-15=-450/191, 11-12=-259/1454  
WEBS 3-16=-121/1353, 5-16=-527/122, 5-15=-173/775, 12-15=-151/1249, 7-15=-133/377, 8-11=-321/137, 9-11=-227/1435, 2-21=-315/126

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 2-2-14, Interior(1) 2-2-14 to 15-2-8, Exterior(2R) 15-2-8 to 21-0-6, Interior(1) 21-0-6 to 27-1-8, Exterior(2R) 27-1-8 to 32-11-6, Interior(1) 32-11-6 to 41-0-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 20 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 22 except (jt=lb) 10=281, 20=337.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	A7	Piggyback Base	2	1	149249761

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:26 2021 Page 1

ID:pEl2tSnelCAFSbWVgXHdMzCDRM-xcUg7no5ZfmH85of4B\_hhOn5EtJaCIE?s6vZ8uy94WR



Scale = 1:76.6

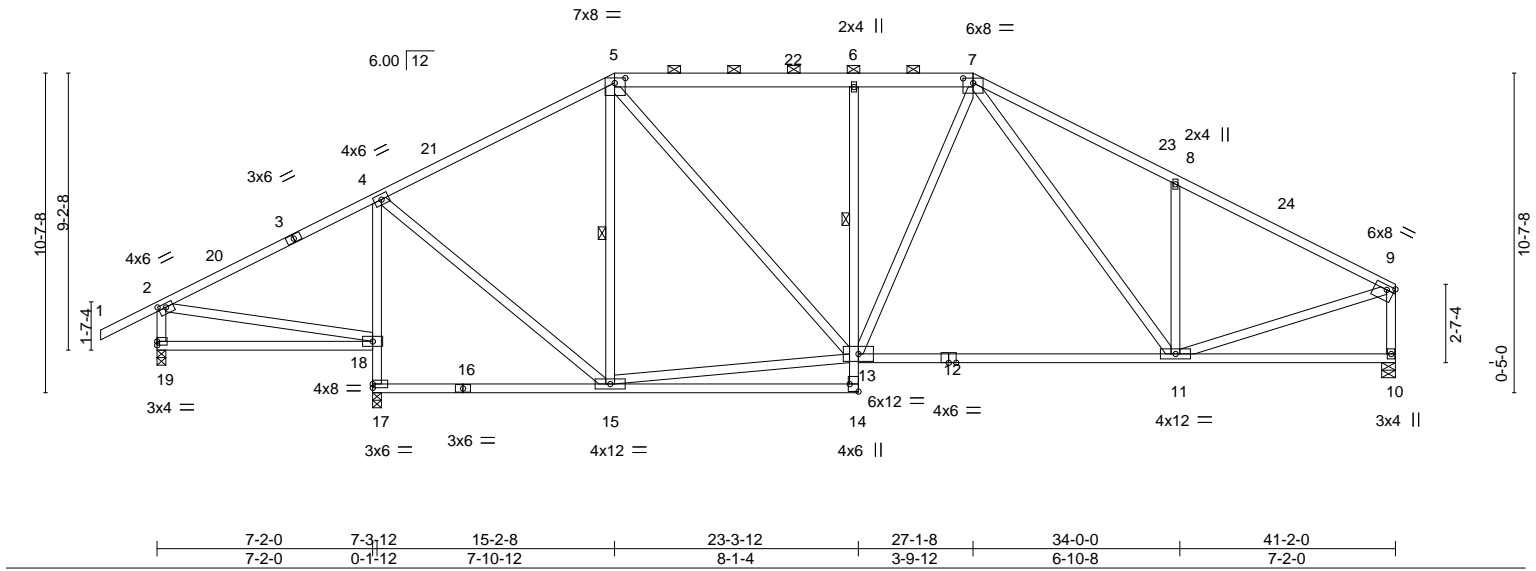


Plate Offsets (X,Y)-- [2:0-3-0,0-1-8], [5:0-4-4,0-2-0], [7:0-4-0,0-1-15], [9:Edge,0-1-12], [14:Edge,0-3-8]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.57	Vert(LL)	-0.30	11-13	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.83	Vert(CT)	-0.63	11-13	>640	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.43	Horz(CT)	0.03	10	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 222 lb	FT = 20%

<b>LUMBER-</b>			<b>BRACING-</b>	
TOP CHORD	2x4 SPF No.2 *Except*		TOP CHORD	Structural wood sheathing directly applied, except end verticals, and
	5-7: 2x6 SPF No.2			2-0-0 oc purlins (5-6-13 max.): 5-7.
BOT CHORD	2x4 SPF No.2		BOT CHORD	Rigid ceiling directly applied. Except:
WEBS	2x4 SPF No.2			1 Row at midpt 6-13
			WEBS	1 Row at midpt 5-15

**REACTIONS.** (size) 19=0-3-8, 17=0-3-8, 10=0-5-8  
Max Horz 19=197(LC 11)  
Max Uplift 19=-91(LC 8), 17=-361(LC 12), 10=-287(LC 13)  
Max Grav 19=423(LC 25), 17=1900(LC 1), 10=1503(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 4-5=-1109/334, 5-6=-1391/403, 6-7=-1395/400, 7-8=-1799/517, 8-9=-1783/346,  
2-19=-354/246, 9-10=-1447/306  
BOT CHORD 17-18=-1832/388, 4-18=-1735/390, 6-13=-513/216, 11-13=-161/1312  
WEBS 5-15=-671/163, 8-11=-536/302, 9-11=-218/1490, 4-15=-121/1145, 7-11=-178/348,  
7-13=-100/390, 13-15=-81/907, 5-13=-166/828

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 2-2-14, Interior(1) 2-2-14 to 15-2-8, Exterior(2R) 15-2-8 to 21-0-6, Interior(1) 21-0-6 to 27-1-8, Exterior(2R) 27-1-8 to 32-11-6, Interior(1) 32-11-6 to 41-0-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 19 except (jt=lb) 17=361, 10=287.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	A8	Piggyback Base	1	1	I49249762

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:27 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-Pp22K7pjku8lENreuVwEcKH?HjHxCl84me6gKy94WQ

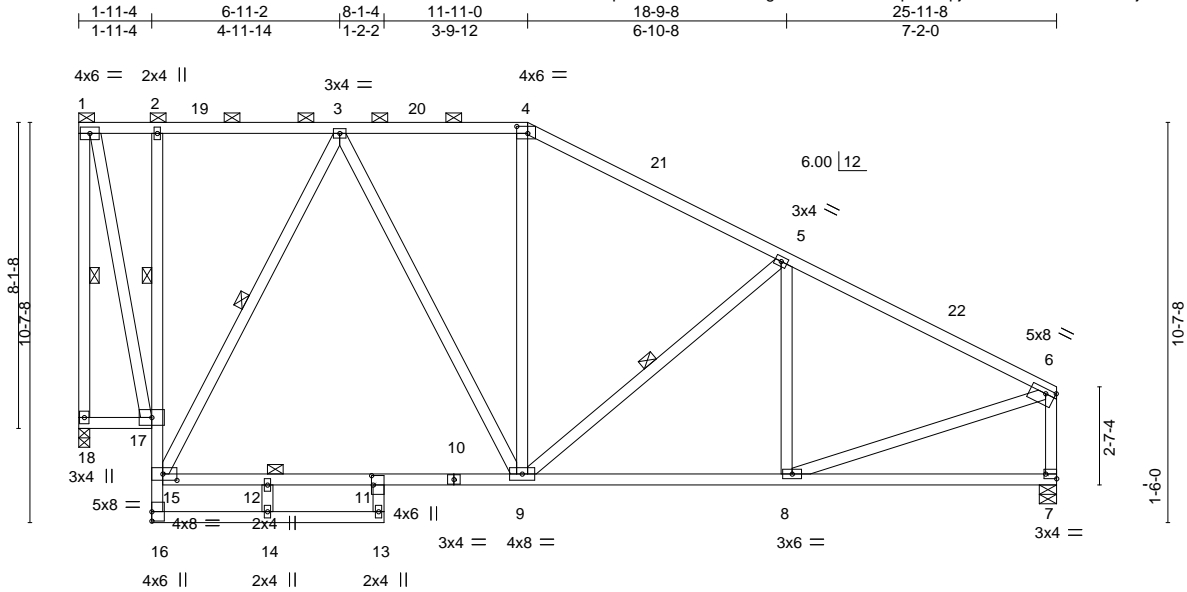

Scale = 1:61.2

Plate Offsets (X,Y)-- [4:0-3-8,0-2-4], [6:0-3-0,0-1-8], [7:Edge,0-1-8], [11:0-3-0,0-0-8], [15:0-4-8,0-2-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.50	Vert(LL) -0.13	13	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.54	Vert(CT) -0.26	13	>999	180		
BCLL 0.0	Rep Stress Incr YES	WB 0.42	Horz(CT) 0.06	7	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS					Weight: 159 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-4.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied. Except:
WEBS 2x4 SPF No.2	1 Row at midpt 2-17
	WEBS 1 Row at midpt 1-18, 5-9, 3-15
	JOINTS 1 Brace at Jt(s): 1, 12

**REACTIONS.** (size) 18=0-3-8, 7=0-5-8  
Max Horz 18=-355(LC 8)  
Max Uplift 18=-251(LC 8), 7=-189(LC 13)  
Max Grav 18=1155(LC 1), 7=1155(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-18=-1033/326, 1-2=-268/181, 2-3=-264/182, 3-4=-811/288, 4-5=-1028/281,  
5-6=-1296/248, 6-7=-1085/229  
BOT CHORD 17-18=-266/411, 15-17=-173/826, 12-15=-173/620, 11-12=-173/620, 9-11=-104/624,  
8-9=-190/1072  
WEBS 1-17=-364/1022, 3-9=-157/405, 5-9=-341/206, 6-8=-154/1035, 3-15=-812/265

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 11-11-0, Exterior(2R) 11-11-0 to 14-11-0, Interior(1) 14-11-0 to 25-9-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) Provide adequate drainage to prevent water ponding.
  - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 18=251, 7=189.
  - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
  - 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	A9	Piggyback Base	1	1	149249763

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:28 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-t?cQXTpLVGO\_NOy2Bc09npsSph5Egc9IJQOfCmy94WP

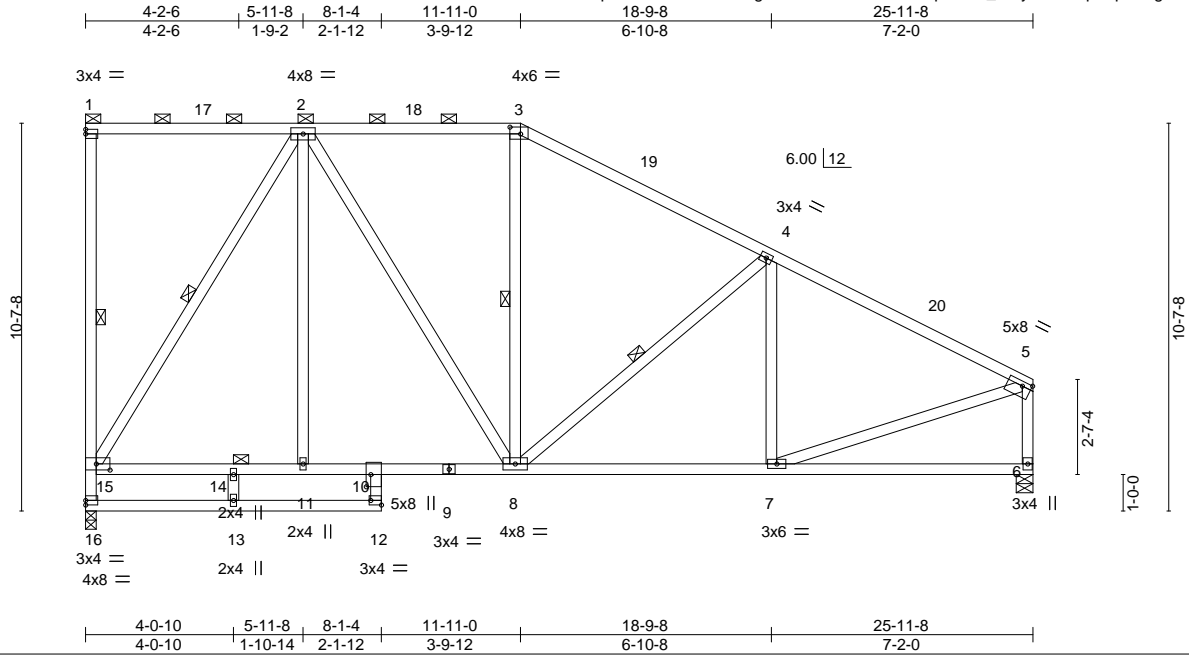


Plate Offsets (X,Y)-- [3:0-3-8,0-2-4], [5:0-3-0,0-1-8], [10:0-4-0,0-1-8], [12:Edge,0-1-8], [15:0-4-8,0-2-0]

LOADING (psf)	SPACING-	CSL	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.50	Vert(LL)	-0.06	6-7	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.43	Vert(CT)	-0.12	6-7	>999	180		
BCLL 0.0	Rep Stress Incr YES	WB 0.60	Horz(CT)	0.07	6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS						Weight: 155 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### REACTIONS.

(size) 16=0-3-8, 6=0-5-8  
Max Horz 16=-409(LC 10)  
Max Uplift 16=-288(LC 8), 6=-183(LC 13)  
Max Grav 16=1155(LC 1), 6=1155(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 15-16=-1112/314, 2-3=-809/309, 3-4=-1025/304, 4-5=-1297/259, 5-6=-1086/237  
BOT CHORD 13-16=-282/381, 12-13=-282/381, 14-15=-127/549, 11-14=-127/549, 10-11=-127/549,  
8-10=-111/584, 7-8=-200/1073  
WEBS 2-8=-150/427, 4-8=-344/204, 5-7=-162/1037, 2-15=-1085/279

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 11-11-0, Exterior(2R) 11-11-0 to 14-11-0, Interior(1) 14-11-0 to 25-9-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Provide adequate drainage to prevent water ponding.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 16=288, 6=183.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-3.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 1-16, 3-8, 4-8, 2-15  
JOINTS 1 Brace at Jt(s): 1, 14



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	A10	Piggyback Base	1	1	149249764

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:12 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMizCDRM-LweNA?dJGM?GSxjzFFkP7RCiFEZnWljxdwWpehy94Wf

Job Reference (optional)

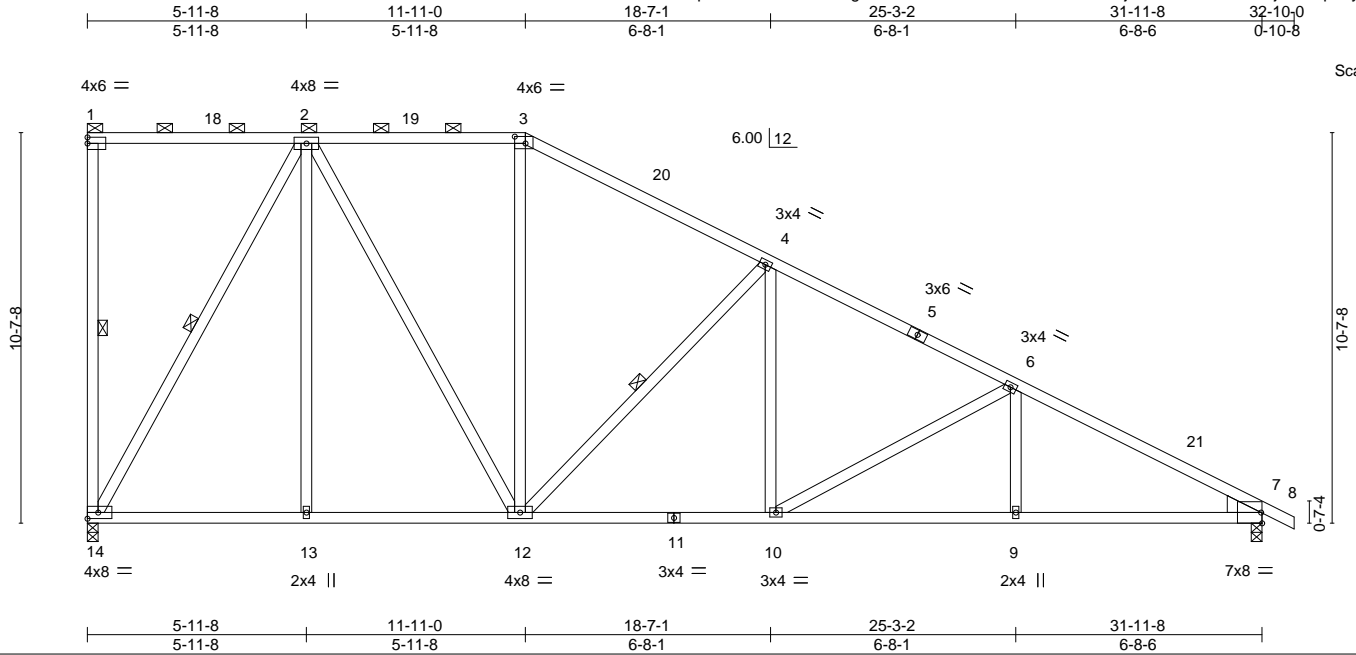


Plate Offsets (X,Y)-- [3:0-3-8,0-2-4]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.53	Vert(LL)	-0.12	9-10	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.69	Vert(CT)	-0.24	9-10	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.89	Horz(CT)	0.08	7	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS							
									Weight: 170 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
WEDGE  
Right: 2x6 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (5-4-2 max.): 1-3.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 1-14, 2-14, 4-12

#### REACTIONS.

(size) 14=0-3-8, 7=0-3-8  
Max Horz 14=-435(LC 10)  
Max Uplift 14=-294(LC 8), 7=-271(LC 13)  
Max Grav 14=1431(LC 1), 7=1494(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1040/328, 3-4=-1276/328, 4-6=-1932/365, 6-7=-2479/433  
BOT CHORD 13-14=-25/691, 12-13=-25/691, 10-12=-107/1642, 9-10=-286/2124, 7-9=-286/2124  
WEBS 2-14=-1383/314, 2-12=-224/720, 4-12=-865/309, 4-10=-48/461, 6-10=-549/221

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-4-2, Interior(1) 3-4-2 to 11-11-0, Exterior(2R) 11-11-0 to 15-1-6, Interior(1) 15-1-6 to 32-10-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Provide adequate drainage to prevent water ponding.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 14=294, 7=271.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601





16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	A11	Piggyback Base	1	1	I49249765

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:13 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMizCDRM-p6CfOKex1f7745l9pyFegfKpZespfkV4saFNA8y94We

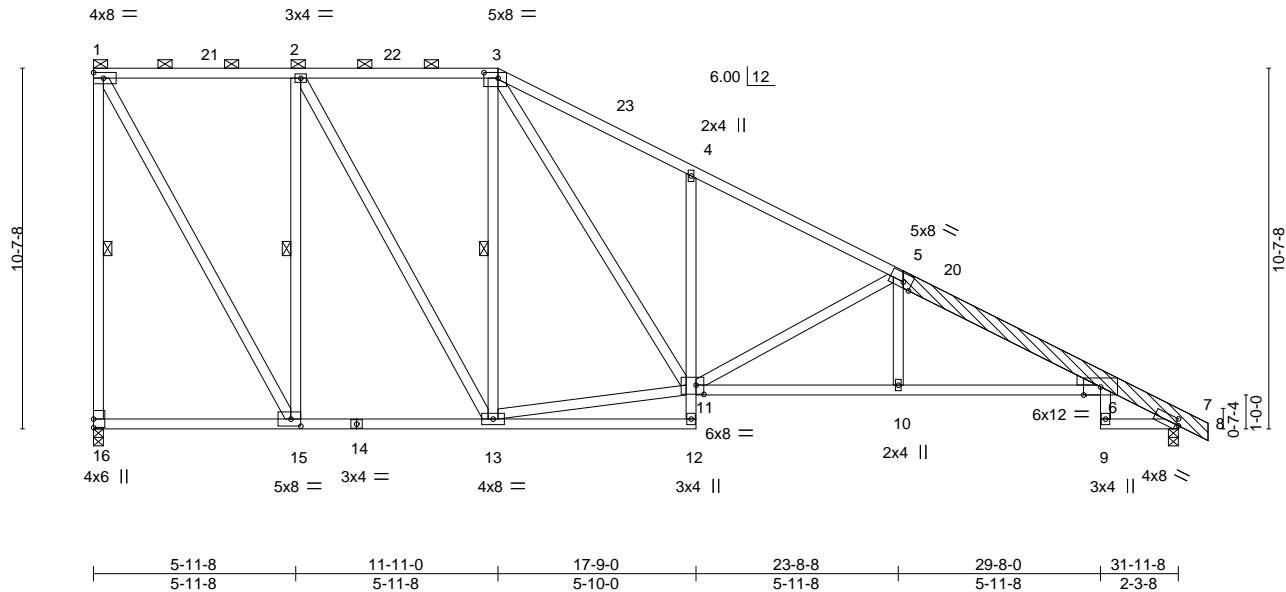

Scale = 1:67.9

Plate Offsets (X,Y)-- [3:0-5-0,0-2-0], [5:0-3-0,Edge], [7:0-1-2,0-2-3], [11:0-2-12,0-3-4], [15:0-3-8,0-2-8]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15		TC 0.82	Vert(LL) -0.33	6-10	>999	240		MT20	197/144
TCDL 10.0	Lumber DOL 1.15		BC 0.87	Vert(CT) -0.61	6-10	>621	180			
BCLL 0.0	Rep Stress Incr YES		WB 0.92	Horz(CT) 0.29	7	n/a	n/a			
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS							
									Weight: 203 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2 \*Except\*  
5-8: 2x6 SPF 2100F 1.8E  
BOT CHORD 2x4 SPF No.2 \*Except\*  
6-11: 2x4 SPF 1650F 1.5E  
WEBS 2x4 SPF No.2  
OTHERS 2x6 SPF 2100F 1.8E  
LBR SCAB 5-8 2x6 SPF 2100F 1.8E one side  
WEDGE  
Right: 2x4 SP No.3

#### REACTIONS.

(size) 16=0-3-8, 7=0-3-8  
Max Horz 16=-436(LC 10)  
Max Uplift 16=-294(LC 8), 7=-271(LC 13)  
Max Grav 16=1431(LC 1), 7=1494(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-16=-1376/317, 1-2=-687/275, 2-3=-1033/327, 3-4=-2057/503, 4-5=-2084/368,  
5-6=-2930/474, 6-7=-731/161  
BOT CHORD 15-16=-267/447, 13-15=-24/692, 4-11=-397/242, 10-11=-317/2721, 6-10=-321/2720  
WEBS 1-15=-314/1382, 2-15=-1086/355, 2-13=-221/715, 3-13=-666/206, 11-13=0/949,  
3-11=-359/1359, 5-11=-1082/288

#### NOTES-

- Attached 10-3-3 scab 5 to 8, front face(s) 2x6 SPF 2100F 1.8E with 2 row(s) of 10d (0.131"x3") nails spaced 9" o.c. except : starting at 0-0-8 from end at joint 5, nail 2 row(s) at 7" o.c. for 2-0-0; starting at 5-7-15 from end at joint 5, nail 2 row(s) at 4" o.c. for 4-4-13.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-4-2, Interior(1) 3-4-2 to 11-11-0, Exterior(2R) 11-11-0 to 15-1-6, Interior(1) 15-1-6 to 32-10-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 16=294, 7=271.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	A12	Piggyback Base	2	1	149249766

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:14 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMzCDRM-Hlm8bgfZozF\_iFtLNfMtCsH0E2CaODEE5E?wjay94Wd

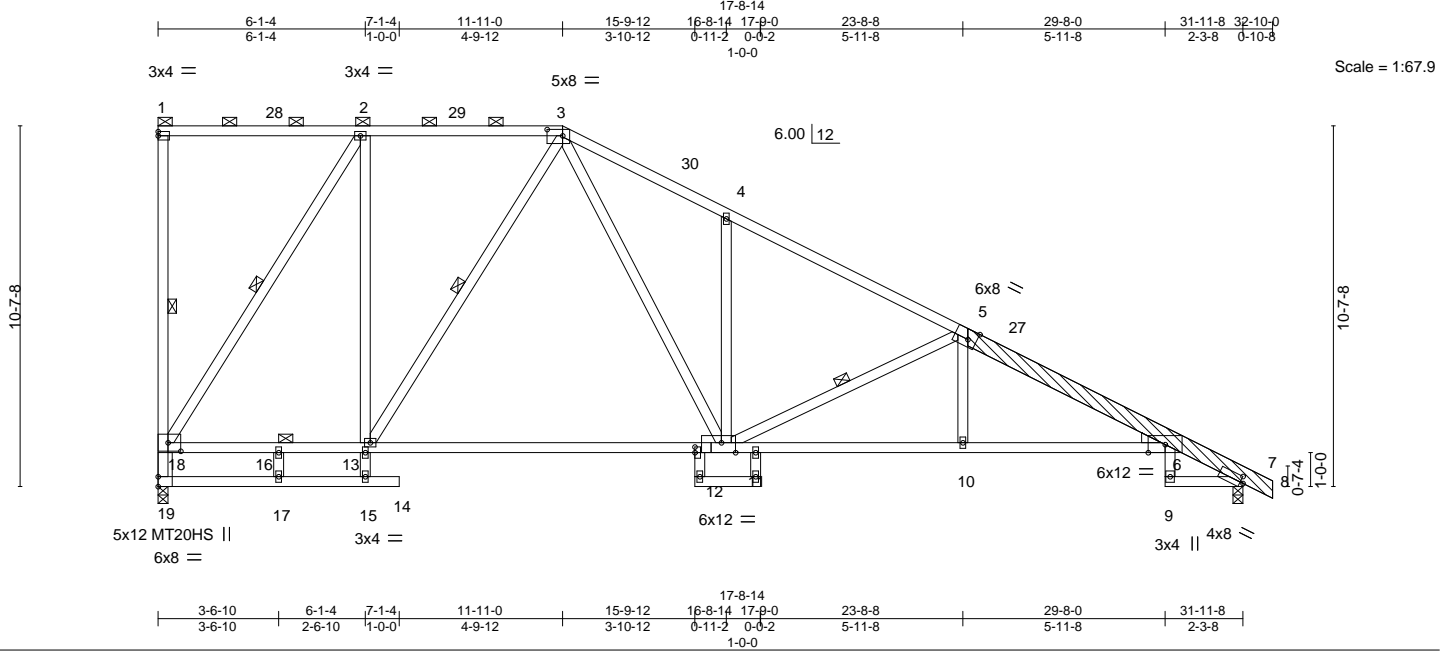


Plate Offsets (X,Y)-- [3:0-5-8,0-2-4], [5:0-3-0,Edge], [7:0-1-2,0-2-3], [12:0-5-0,Edge], [18:0-4-8,0-3-0], [20:0-2-0,0-0-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.70	Vert(LL) -0.33	6-10	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.84	Vert(CT) -0.71	11-13	>540	180	MT20HS	148/108
BCLL 0.0	Rep Stress Incr YES	WB 0.82	Horz(CT) 0.31	7	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS						
							Weight: 195 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2 \*Except\*  
5-8: 2x6 SPF 2100F 1.8E  
BOT CHORD 2x4 SPF No.2 \*Except\*  
6-12: 2x4 SPF 1650F 1.5E  
WEBS 2x4 SPF No.2  
OTHERS 2x6 SPF 2100F 1.8E  
LBR SCAB 5-8 2x6 SPF 2100F 1.8E one side  
WEDGE  
Right: 2x4 SP No.3

#### REACTIONS.

(size) 19=0-3-8, 7=0-3-8  
Max Horz 19=-436(LC 10)  
Max Uplift 19=-288(LC 8), 7=-270(LC 13)  
Max Grav 19=1447(LC 1), 7=1498(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 18-19=-1420/273, 2-3=-798/259, 3-4=-1987/470, 4-5=-2027/345, 5-6=-2949/484,  
6-7=-733/160  
BOT CHORD 16-18=-17/801, 13-16=-17/801, 11-13=0/1143, 10-11=-329/2744, 6-10=-332/2745  
WEBS 2-13=-91/764, 2-18=-1465/221, 5-11=-1154/340, 3-13=-652/249, 3-11=-345/1214,  
4-11=-406/244

#### NOTES-

- 1) Attached 10-3-3 scab 5 to 8, front face(s) 2x6 SPF 2100F 1.8E with 2 row(s) of 10d (0.131"x3") nails spaced 9" o.c. except : starting at 0-0-8 from end at joint 5, nail 2 row(s) at 7" o.c. for 2-0-0; starting at 5-7-15 from end at joint 5, nail 2 row(s) at 4" o.c. for 4-4-13.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-4-2, Interior(1) 3-4-2 to 11-11-0, Exterior(2R) 11-11-0 to 15-1-6, Interior(1) 15-1-6 to 32-10-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are MT20 plates unless otherwise indicated.
- 5) All plates are 2x4 MT20 unless otherwise indicated.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 19=288, 7=270.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO	I49249767
3016791	A13	Piggyback Base	3	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:15 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-IVKWp0fBZHNrJOSYxNH6l4qB0RYu7ijNKukTF0y94Wc

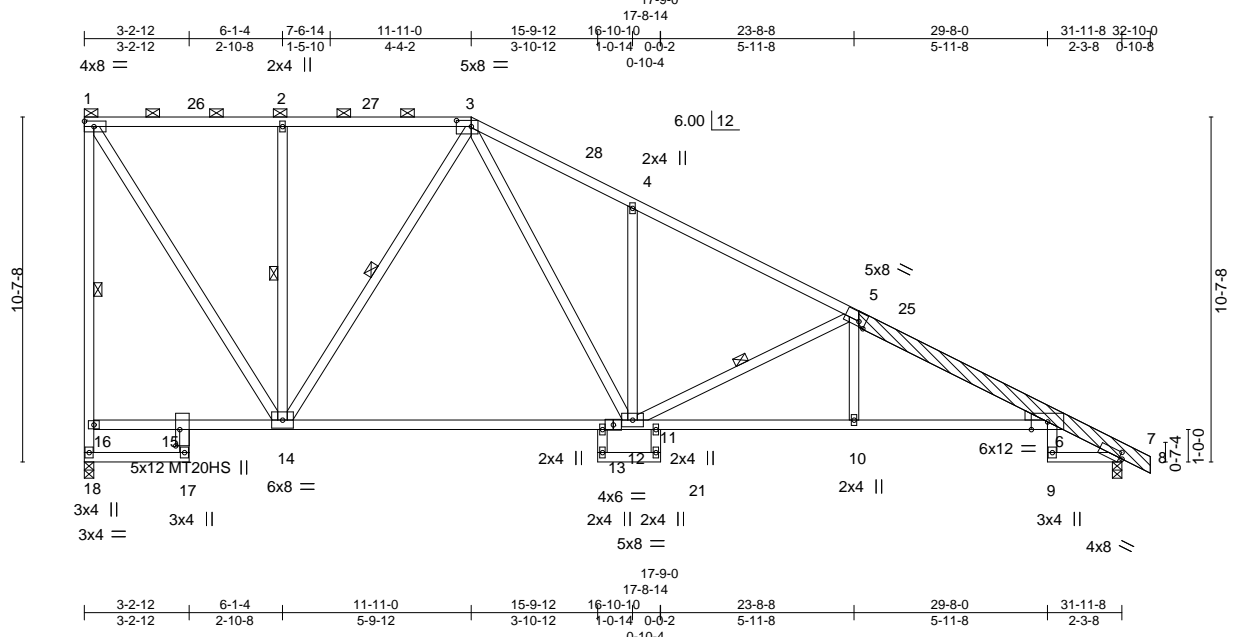


Plate Offsets (X,Y)-- [3:0-5-8,0-2-4], [5:0-2-8,0-1-12], [7:0-1-2,0-2-3], [15:0-6-0,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.69	Vert(LL) -0.33	12-14	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.83	Vert(CT) -0.74	12-14	>513	180	MT20HS	148/108
BCLL 0.0	Rep Stress Incr YES	WB 0.68	Horz(CT) 0.30	7	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS						
							Weight: 189 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2 \*Except\*  
5-8: 2x6 SPF 2100F 1.8E  
BOT CHORD 2x4 SPF No.2 \*Except\*  
6-13: 2x4 SPF 1650F 1.5E  
WEBS 2x4 SPF No.2  
OTHERS 2x6 SPF 2100F 1.8E  
LBR SCAB 5-8 2x6 SPF 2100F 1.8E one side  
WEDGE  
Right: 2x4 SP No.3

#### REACTIONS.

(size) 18=0-3-8, 7=0-3-8  
Max Horz 18=-436(LC 10)  
Max Uplift 18=-294(LC 8), 7=-271(LC 13)  
Max Grav 18=1431(LC 1), 7=1494(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 16-18=-1398/260, 1-16=-1393/264, 1-2=-786/264, 2-3=-786/264, 3-4=-1996/478,  
4-5=-2033/351, 5-6=-2934/487, 6-7=-731/161  
BOT CHORD 17-18=-328/433, 15-16=-256/341, 14-15=-253/436, 12-14=0/1134, 11-12=-332/2730,  
10-11=-332/2730, 6-10=-335/2730  
WEBS 2-14=-466/213, 1-14=-227/1441, 5-12=-1133/335, 3-14=-659/252, 3-12=-345/1221,  
4-12=-404/243

#### NOTES-

- Attached 10-3-3 scab 5 to 8, front face(s) 2x6 SPF 2100F 1.8E with 2 row(s) of 10d (0.131"x3") nails spaced 9" o.c. except : starting at 0-0-8 from end at joint 5, nail 2 row(s) at 7" o.c. for 2-0-0; starting at 5-7-15 from end at joint 5, nail 2 row(s) at 4" o.c. for 4-4-13.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-4-2, Interior(1) 3-4-2 to 11-11-0, Exterior(2R) 11-11-0 to 15-1-6, Interior(1) 15-1-6 to 32-10-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 18=294, 7=271.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017





Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	A15	Piggyback Base Supported Gable	1	1	149249769

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:19 2021 Page 1  
ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-eGZ1fOjicVuGo0mJADM2vw\_um32D3fhzFWihOoy94WY

Job Reference (optional)

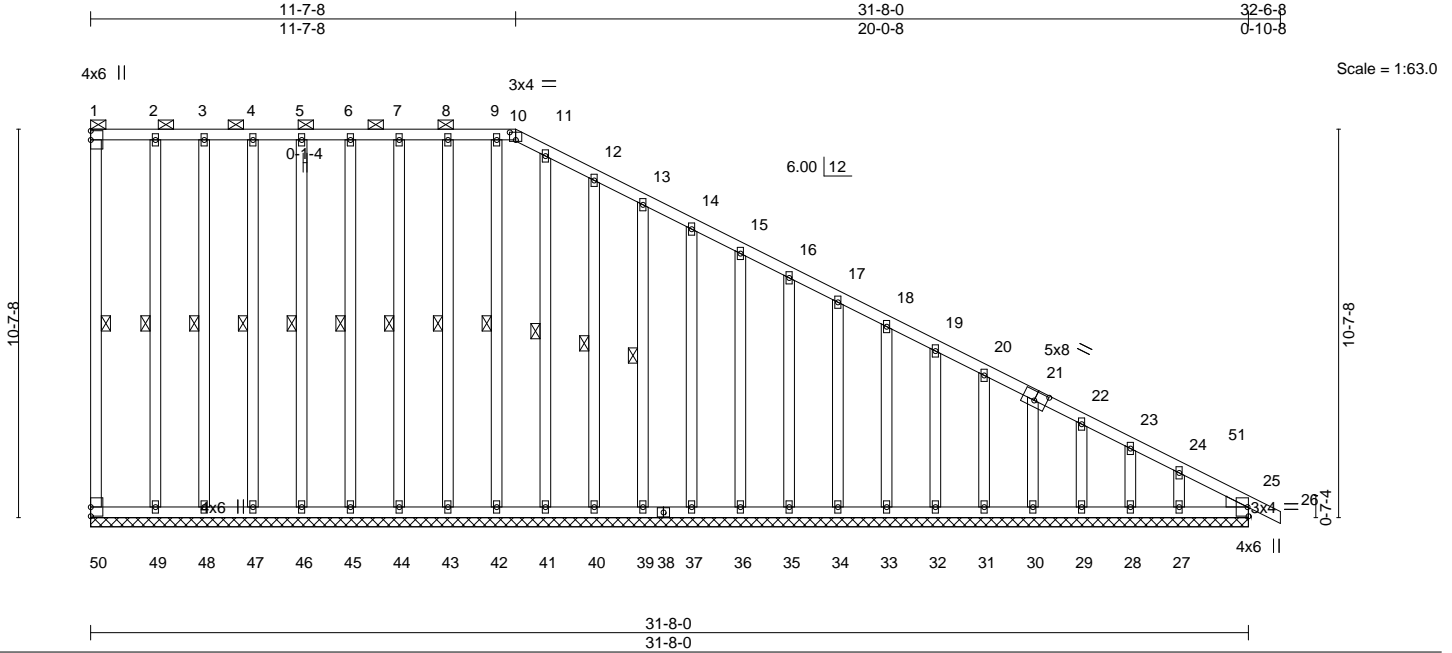


Plate Offsets (X,Y)-- [10:0-2-0,0-2-8], [21:0-4-0,0-3-0]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15		TC 0.58	Vert(LL) 0.00	25	n/r	120		MT20	197/144
TCDL 10.0	Lumber DOL 1.15		BC 0.30	Vert(CT) 0.00	25	n/r	120			
BCLL 0.0	Rep Stress Incr YES		WB 0.10	Horz(CT) 0.02	25	n/a	n/a			
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S							
									Weight: 265 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2  
WEDGE  
Right: 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-10.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 1-50, 2-49, 3-48, 4-47, 5-46, 6-45, 7-44, 8-43, 9-42, 11-41, 12-40, 13-39

#### REACTIONS.

All bearings 31-8-0.  
(lb) - Max Horz 50=-433(LC 8)  
Max Uplift All uplift 100 lb or less at joint(s) 50, 49, 48, 47, 46, 45, 44, 43, 42, 41, 40, 39, 37, 36, 35, 34, 33, 32, 31, 30, 29, 28, 25 except 27=-100(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 50, 49, 48, 47, 46, 45, 44, 43, 42, 41, 40, 39, 37, 36, 35, 34, 33, 32, 31, 30, 29, 28, 27, 25

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 15-16=-279/194, 16-17=-312/205, 17-18=-346/217, 18-19=-379/229, 19-20=-413/240, 20-21=-447/252, 21-22=-481/263, 22-23=-510/273, 23-24=-544/284, 24-25=-635/326  
BOT CHORD 49-50=-277/563, 48-49=-277/563, 47-48=-277/563, 46-47=-277/563, 45-46=-277/563, 44-45=-277/563, 43-44=-277/563, 42-43=-277/563, 41-42=-277/563, 40-41=-277/563, 39-40=-277/563, 37-39=-277/563, 36-37=-277/563, 35-36=-277/563, 34-35=-277/563, 33-34=-277/563, 32-33=-277/563, 31-32=-277/563, 30-31=-277/563, 29-30=-276/561, 28-29=-276/561, 27-28=-276/561, 25-27=-276/561

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-1-12 to 3-1-4, Exterior(2N) 3-1-4 to 11-7-8, Corner(3R) 11-7-8 to 14-9-8, Exterior(2N) 14-9-8 to 32-6-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are 2x4 MT20 unless otherwise indicated.
- 5) Gable requires continuous bottom chord bearing.
- 6) Gable studs spaced at 1-4-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 50, 49, 48, 47, 46, 45, 44, 43, 42, 41, 40, 39, 37, 36, 35, 34, 33, 32, 31, 30, 29, 28, 25 except (jt=lb) 27=100.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	B1	Common Supported Gable	1	1	149249770

Builders FirstSource (Valley Center), Valley Center, KS - 67147,


8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:29 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-LBAplpqzGa8r?YXEIJXOJ1PkZ5WoPCyRY47DkCy94WO

Job Reference (optional)

0-10-8 10-2-0 20-4-0 21-2-8  
0-10-8 10-2-0 10-2-0 0-10-8

Scale = 1:39.2

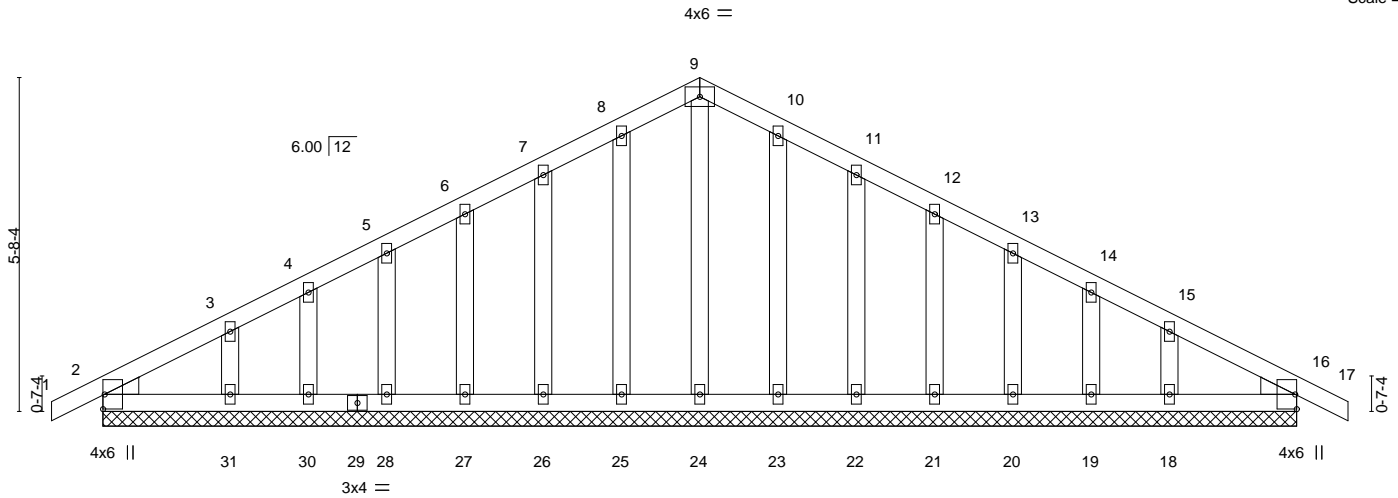

LOADING (psf)		SPACING-		CSI.		DEFL.				PLATES		GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.05	Vert(LL)	-0.00	in (loc)	16	l/defl	n/r	L/d	120
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(CT)	-0.00		16		n/r		120
BCLL	0.0	Rep Stress Incr	YES	WB	0.05	Horz(CT)	0.00		16		n/a		n/a
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S									
												Weight: 97 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2

BOT CHORD 2x4 SPF No.2

OTHERS 2x4 SPF No.2

WEDGE

Left: 2x4 SPF No.2 , Right: 2x4 SPF No.2

#### BRACING-

TOP CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.

BOT CHORD

Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 20-4-0.

(lb) - Max Horz 2=-97(LC 17)

Max Uplift All uplift 100 lb or less at joint(s) 2, 25, 26, 27, 28, 30, 31, 23, 22, 21, 20, 19, 18, 16

Max Grav All reactions 250 lb or less at joint(s) 2, 24, 25, 26, 27, 28, 30, 31, 23, 22, 21, 20, 19, 18, 16

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

1) Unbalanced roof live loads have been considered for this design.

2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-10-8 to 2-2-0, Exterior(2N) 2-2-0 to 10-2-0, Corner(3R) 10-2-0 to 13-2-0, Exterior(2N) 13-2-0 to 21-2-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.

4) All plates are 2x4 MT20 unless otherwise indicated.

5) Gable requires continuous bottom chord bearing.

6) Gable studs spaced at 1-4-0 oc.

7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 25, 26, 27, 28, 30, 31, 23, 22, 21, 20, 19, 18, 16.

9) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 16.

10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	B2	Common	4	1	149249771

Builders FirstSource (Valley Center), Valley Center, KS - 67147,


8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:30 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMizCDRM-pNkBy8rb1uGici5QJ03dsExr0Umz8dEbmktmHfy94WN

Job Reference (optional)

0-10-8 5-1-3 10-2-0 15-2-13 20-4-0 21-2-8  
0-10-8 5-1-3 5-0-13 5-0-13 5-1-3 0-10-8

Scale = 1:37.0

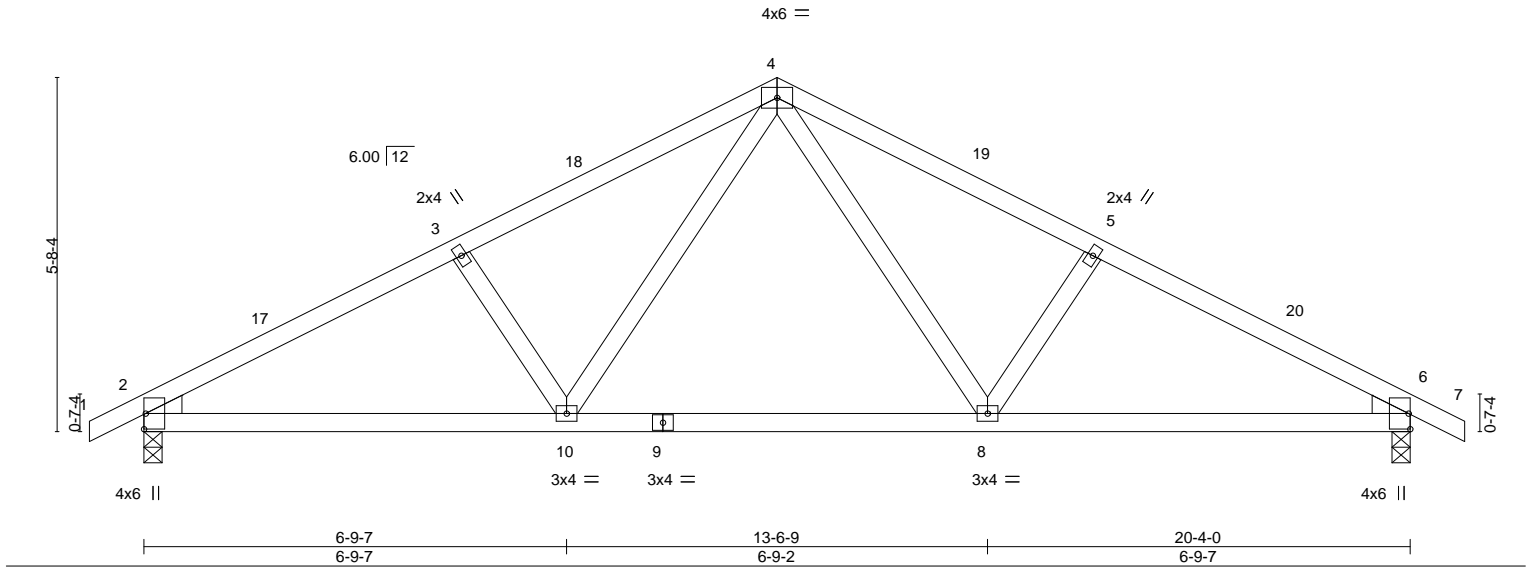

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.26	Vert(LL) -0.07	8-10	>999	240		MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.41	Vert(CT) -0.14	8-10	>999	180			
BCLL 0.0	Rep Stress Incr YES	WB 0.11	Horz(CT) 0.03	6	n/a	n/a			
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS							
								Weight: 74 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
WEDGE

Left: 2x4 SPF No.2 , Right: 2x4 SPF No.2

#### REACTIONS.

(size) 2=0-3-8, 6=0-3-8  
Max Horz 2=-97(LC 13)  
Max Uplift 2=-170(LC 12), 6=-170(LC 13)  
Max Grav 2=976(LC 1), 6=976(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1480/352, 3-4=-1313/364, 4-5=-1313/364, 5-6=-1480/352  
BOT CHORD 2-10=-243/1258, 8-10=-94/873, 6-8=-237/1258  
WEBS 4-8=-118/463, 5-8=-314/183, 4-10=-118/463, 3-10=-314/182

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 10-2-0, Exterior(2R) 10-2-0 to 13-2-0, Interior(1) 13-2-0 to 21-2-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=170, 6=170.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	B3	Monopitch Girder	1	2	149249772

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:31 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMizCDRM-laHZAUsEnBOZEsgdtkasOSUtuWu4ktuyk?Ockp5y94WM

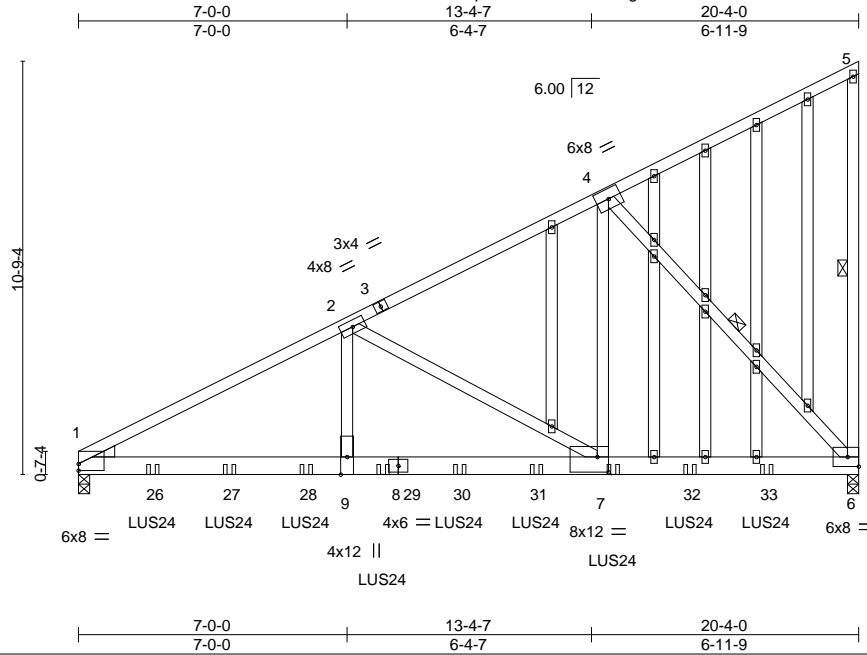


Plate Offsets (X,Y)-- [1:0-0-0,0-2-1], [7:0-3-8,0-4-12]

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.85	Vert(LL) -0.12	7-9	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.57	Vert(CT) -0.22	7-9	>999	180		
BCLL 0.0	Rep Stress Incr NO	WB 0.85	Horz(CT) 0.04	6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-MS					Weight: 275 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x6 SP 2400F 2.0E  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2  
WEDGE  
Left: 2x4 SP No.3

#### REACTIONS.

(size) 1=0-3-8, 6=0-3-8  
Max Horz 1=412(LC 25)  
Max Uplift 1=754(LC 8), 6=945(LC 8)  
Max Grav 1=4888(LC 1), 6=4745(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-7893/1185, 2-4=-4117/577  
BOT CHORD 1-9=-1383/6972, 7-9=-1383/6972, 6-7=-703/3593  
WEBS 2-9=-458/3104, 2-7=-3868/778, 4-7=-821/5145, 4-6=-5264/1027

#### NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-7-0 oc.  
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=754, 6=945.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Use Simpson Strong-Tie LUS24 (4-SD9112 Girder, 2-SD9212 Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 1-11-4 from the left end to 17-11-4 to connect truss(es) to front face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.
- Studding applied to ply: 1(Front)

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



December 15, 2021

**MiTek**  
16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	B3	Monopitch Girder	1	2	I49249772

Builders FirstSource (Valley Center),
Valley Center, KS - 67147,
8.430 s Aug 16 2021 MiTek Industries, Inc.
Tue Dec 14 10:14:32 2021
Page 2

ID:pEI2tSneiCAFSbWVGXHdMzCDRM-mmrXNqtsYVWQs0FpQR55xf12FIQzcLCtE1MtLXy94WL

**LOAD CASE(S)** Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-5=-70, 6-23=-20
Concentrated Loads (lb)
Vert: 7=-869(F) 26=-867(F) 27=-867(F) 28=-869(F) 29=-869(F) 30=-869(F) 31=-869(F) 32=-869(F) 33=-869(F)



Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	C1	Common Supported Gable	1	1	I49249773

Builders FirstSource (Valley Center), Valley Center, KS - 67147,


8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:33 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMzCDRM-EyPJbAtUJpeHTAq?\_9cKTtZQOieLzV1Th5Qu\_y94WK

0-10-8 10-0-0 20-0-0 20-10-8 0-10-8

4x6 ==

Scale = 1:45.9

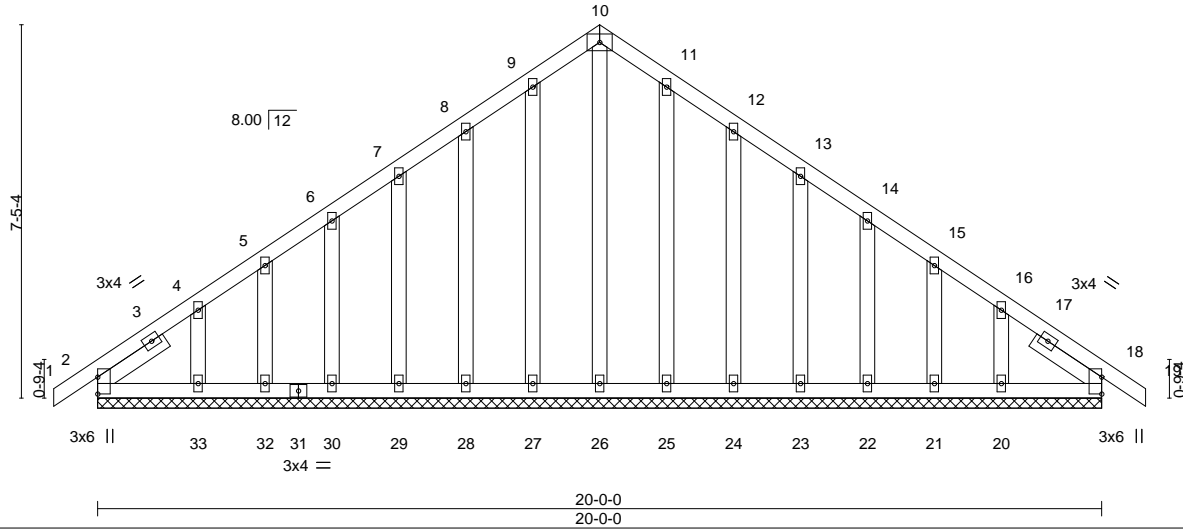

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.06	Vert(LL)	-0.00	18	n/r	120	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	-0.00	18	n/r	120		
BCLL 0.0	Rep Stress Incr	YES	WB 0.14	Horz(CT)	0.00	18	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						Weight: 116 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 OTHERS 2x4 SPF No.2  
 SLIDER Left 2x4 SPF No.2 1-7-7, Right 2x4 SPF No.2 1-7-7

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 20-0-0.  
 (lb) - Max Horz 2=189(LC 11)  
 Max Uplift All uplift 100 lb or less at joint(s) 2, 27, 28, 29, 30, 32, 25, 24, 23, 22, 21, 18 except  
 33=118(LC 12), 20=106(LC 13)  
 Max Grav All reactions 250 lb or less at joint(s) 2, 26, 27, 28, 29, 30, 32, 33, 25, 24, 23, 22, 21, 20, 18

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-10-8 to 2-0-0, Exterior(2N) 2-0-0 to 10-0-0, Corner(3R) 10-0-0 to 13-0-0, Exterior(2N) 13-0-0 to 20-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 27, 28, 29, 30, 32, 25, 24, 23, 22, 21, 18 except (jt=lb) 33=118, 20=106.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	C2	Common	1	1	I49249774

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:34 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-i9zioWu646m85JPBYs7Z046YN64a4PeAhLr\_QQy94WJ

0-10-8 5-1-12 10-0-0 14-10-4 20-0-0 20-10-8  
0-10-8 5-1-12 4-10-4 4-10-4 5-1-12 0-10-8

4x6 ==

Scale = 1:45.6

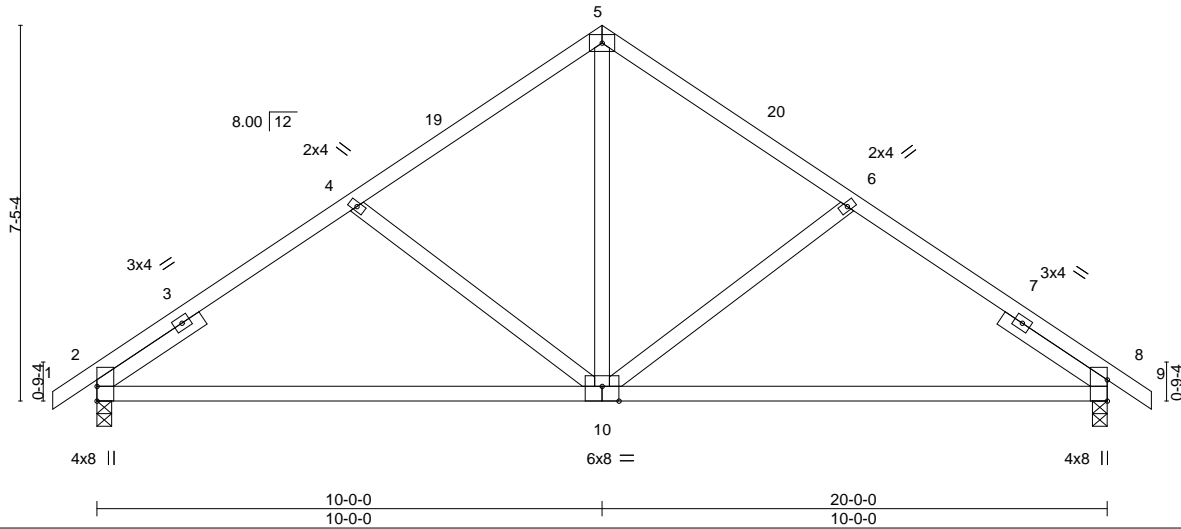


Plate Offsets (X,Y)-- [2:Edge,0-0-0], [8:Edge,0-0-0], [10:0-4-0,Edge]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.24	Vert(LL)	-0.13	10-17	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.69	Vert(CT)	-0.27	10-17	>892	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.22	Horz(CT)	0.02	8	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 80 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-6-0, Right 2x4 SPF No.2 2-6-0

#### REACTIONS.

(size) 2=0-3-8, 8=0-3-8  
Max Horz 2=189(LC 11)  
Max Uplift 2=158(LC 12), 8=158(LC 13)  
Max Grav 2=961(LC 1), 8=961(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-1010/216, 4-5=-899/205, 5-6=-899/205, 6-8=-1010/216  
BOT CHORD 2-10=-195/911, 8-10=-88/895  
WEBS 5-10=-91/547, 6-10=-323/211, 4-10=-322/210

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 10-0-0, Exterior(2R) 10-0-0 to 13-0-0, Interior(1) 13-0-0 to 20-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (it=lb) 2=158, 8=158.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	C2A	Common	2	1	I49249775

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:35 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMizCDRM-ALX4?svkrQv?jT\_O6aeoZlfj7VPApssKw?aXysy94WI



Scale = 1:45.2

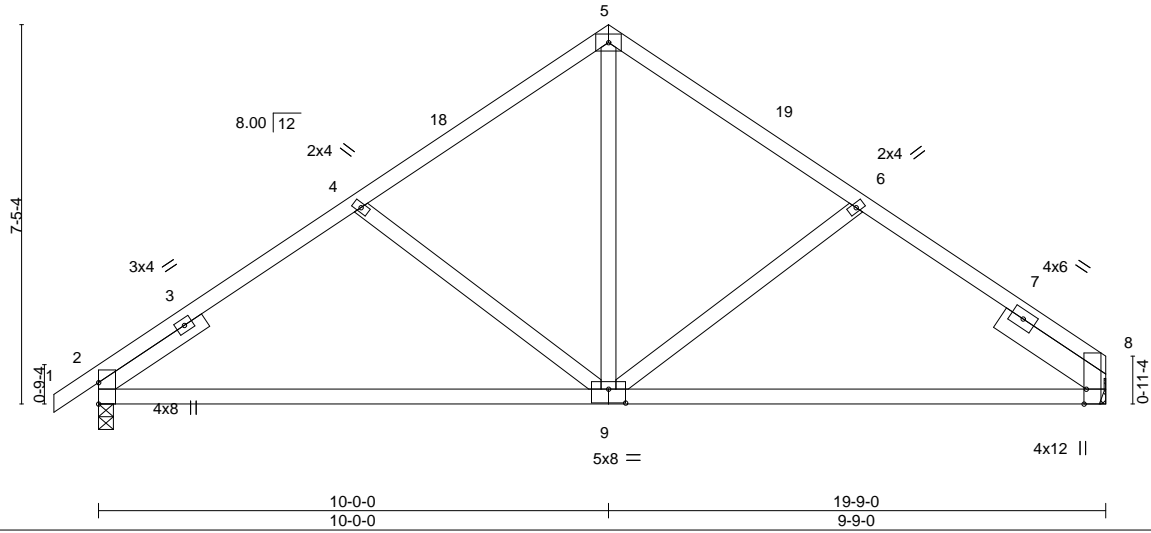


Plate Offsets (X,Y)-- [2:Edge,0-0-0], [8:0-3-8,Edge], [9:0-4-0,0-3-4]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.24	Vert(LL)	-0.14	9-16	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.67	Vert(CT)	-0.28	9-16	>839	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.22	Horz(CT)	0.03	8	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 80 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 SLIDER Left 2x4 SPF No.2 2-6-0, Right 2x6 SPF No.2 2-6-0

#### REACTIONS.

(size) 8=Mechanical, 2=0-3-8  
 Max Horz 2=184(LC 9)  
 Max Uplift 8=135(LC 13), 2=157(LC 12)  
 Max Grav 8=887(LC 1), 2=951(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-992/214, 4-5=-881/202, 5-6=-877/202, 6-8=-1076/212  
 BOT CHORD 2-9=-207/890, 8-9=-105/851  
 WEBS 4-9=-323/210, 5-9=-88/526, 6-9=-290/202

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 10-0-0, Exterior(2R) 10-0-0 to 13-0-0, Interior(1) 13-0-0 to 19-9-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=135, 2=157.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	C3	Common	7	1	I49249776

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:36 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMizCDRM-eX5SDCwMck1sKdZafH915VBumvINYJ3T9fK5Uly94WH

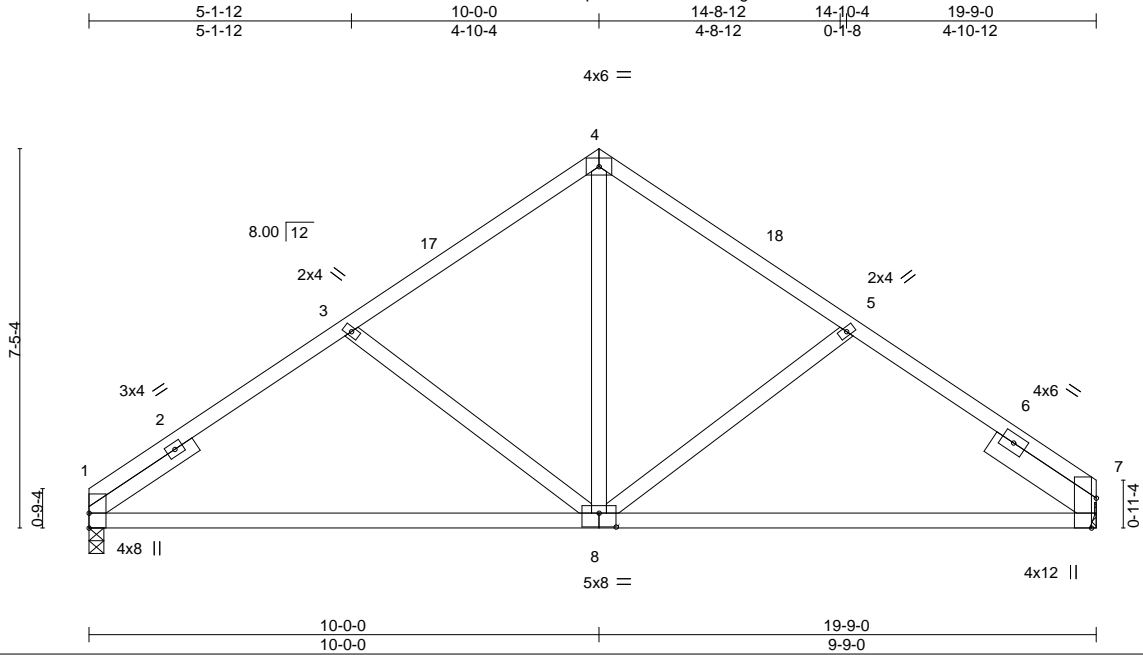


Plate Offsets (X,Y)-- [1:Edge,0-0-0], [7:0-7-1,Edge], [8:0-4-0,0-3-4]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15		TC 0.24	Vert(LL)	-0.14	8-11	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15		BC 0.67	Vert(CT)	-0.28	8-11	>835	180		
BCLL 0.0	Rep Stress Incr YES		WB 0.22	Horz(CT)	0.03	7	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 79 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 SLIDER Left 2x4 SPF No.2 2-6-0, Right 2x6 SPF No.2 2-6-0

#### REACTIONS.

(size) 1=0-3-8, 7=Mechanical  
 Max Horz 1=174(LC 9)  
 Max Uplift 1=136(LC 12), 7=135(LC 13)  
 Max Grav 1=889(LC 1), 7=889(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-3=-997/216, 3-4=-884/204, 4-5=-879/203, 5-7=-1079/212  
 BOT CHORD 1-8=-209/896, 7-8=-105/853  
 WEBS 3-8=-328/211, 4-8=-88/527, 5-8=-290/202

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 10-0-0, Exterior(2R) 10-0-0 to 13-0-0, Interior(1) 13-0-0 to 19-9-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=136, 7=135.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	CJ1	Diagonal Hip Girder	2	1	149249777

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:37 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-6kfQYw\_N19jyn8mD?hGejkyuJDGHpkcNJ3e1y94WG

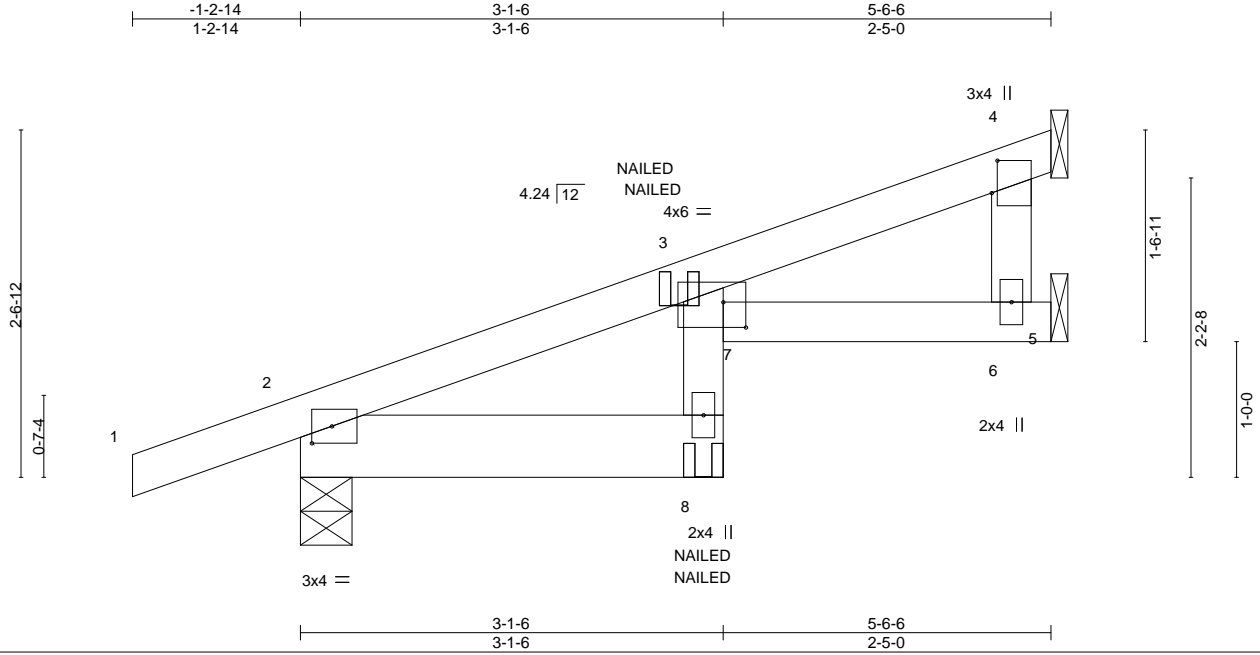

Scale = 1:17.0

Plate Offsets (X,Y)-- [2:0-1-12,0-1-8], [3:0-2-0,0-2-4], [4:0-2-14,0-0-8]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15		TC 0.67	Vert(LL) 0.10	8	>622	240		MT20	197/144
TCDL 10.0	Lumber DOL 1.15		BC 0.18	Vert(CT) -0.16	8	>386	180			
BCLL 0.0	Rep Stress Incr NO		WB 0.00	Horz(CT) 0.05	6	n/a	n/a			
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP						Weight: 19 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2 \*Except\*  
2-8: 2x6 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-6-6 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:  
6-0-0 oc bracing: 2-8.

#### REACTIONS.

(size) 2=0-4-9, 6=Mechanical, 4=Mechanical  
Max Horz 2=99(LC 4)  
Max Uplift 2=106(LC 4), 4=90(LC 8)  
Max Grav 2=338(LC 1), 6=58(LC 3), 4=209(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 2=106.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.
- 7) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-4=-70, 8-9=-20, 5-7=-20  
Concentrated Loads (lb)  
Vert: 8=-12(F=-6, B=-6)



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO	I49249778
3016791	D1	Common	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:38 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-awDCeuxd8LHaaxjznicVAwH8WjTC0FpmcZpBZBy94WF

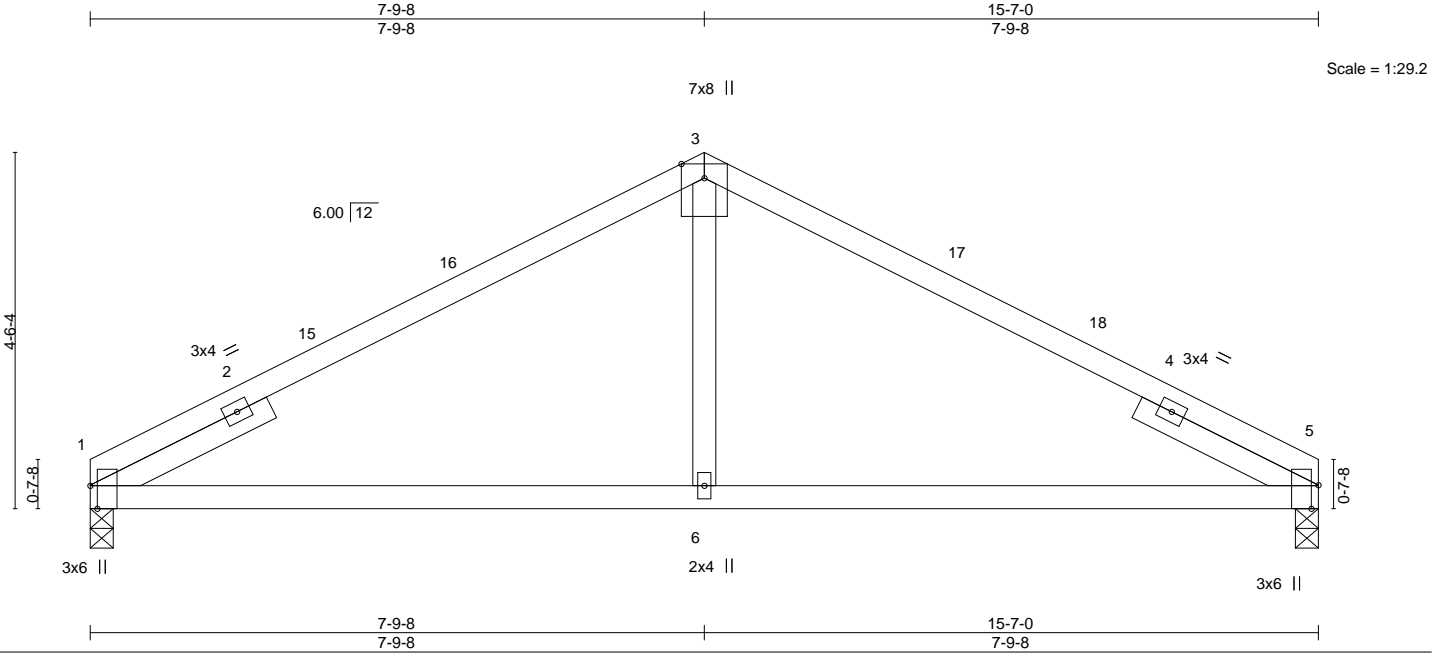


Plate Offsets (X,Y)-- [1:0-3-8,Edge], [5:0-3-9,Edge]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.61	Vert(LL)	-0.12	6-13	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.52	Vert(CT)	-0.19	6-13	>966	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.08	Horz(CT)	0.03	1	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 48 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 SLIDER Left 2x4 SPF No.2 2-6-0, Right 2x4 SPF No.2 2-6-0

#### REACTIONS.

(size) 1=0-3-8, 5=0-3-8  
 Max Horz 1=69(LC 12)  
 Max Uplift 1=115(LC 12), 5=115(LC 13)  
 Max Grav 1=701(LC 1), 5=701(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-3=-880/306, 3-5=-880/306  
 BOT CHORD 1-6=-162/759, 5-6=-162/759  
 WEBS 3-6=0/336

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 7-9-8, Exterior(2R) 7-9-8 to 10-9-8, Interior(1) 10-9-8 to 15-7-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=115, 5=115.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
 BOT CHORD Rigid ceiling directly applied.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO	149249779
3016791	D2	Hip	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:39 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-36marDyFvPRCSH9LPjk8pDa7jNljcvrdYI5dy94WE

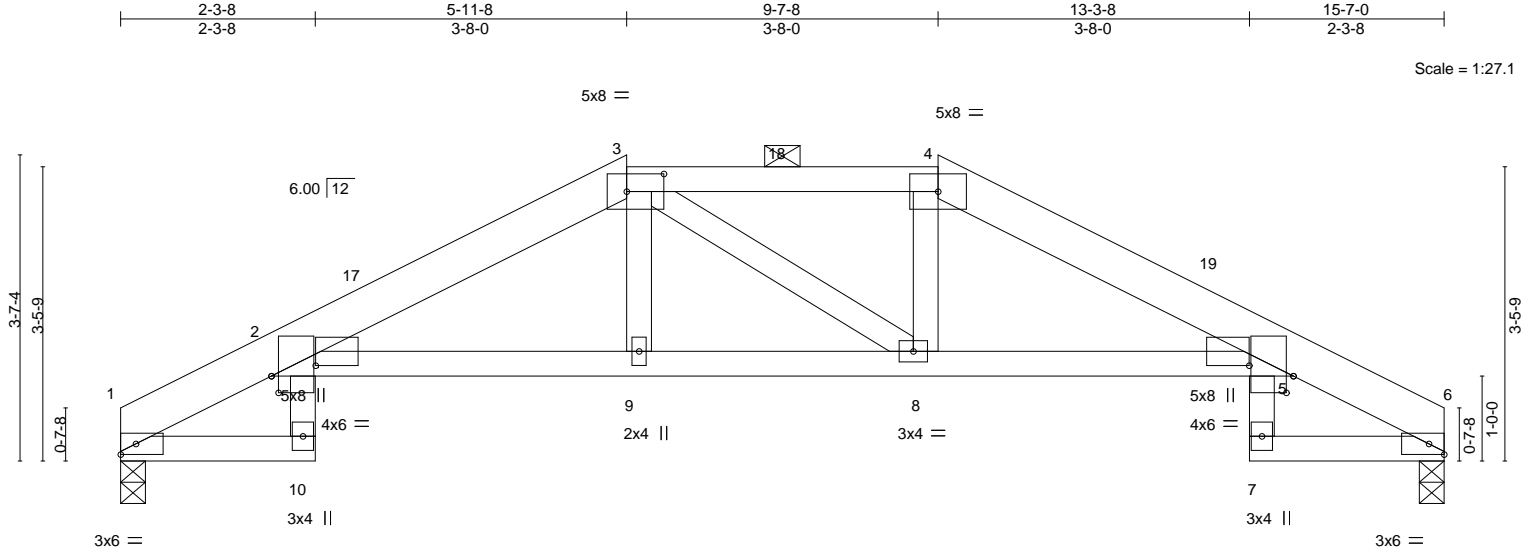


Plate Offsets (X,Y)--	[2:0-6-4,0-1-8], [2:0-2-6,0-1-0], [3:0-5-4,0-2-8], [5:0-2-6,0-1-0], [5:0-6-4,0-1-8]
-----------------------	---

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.97	Vert(LL) -0.20	2-9	>935	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.91	Vert(CT) -0.37	2-9	>510	180		
BCLL 0.0	Rep Stress Incr YES	WB 0.04	Horz(CT) 0.34	6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS					Weight: 58 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x6 SPF No.2 *Except* 3-4: 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except 2-0-0 oc purlins (5-0-4 max.): 3-4.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	

**REACTIONS.** (size) 1=0-3-8, 6=0-3-8  
Max Horz 1=52(LC 12)  
Max Uplift 1=117(LC 12), 6=117(LC 13)  
Max Grav 1=705(LC 1), 6=705(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-12=374/126, 2-3=1365/370, 3-4=1282/390, 4-5=1366/366, 5-6=374/121  
BOT CHORD 2-9=275/1275, 8-9=274/1282, 5-8=264/1276

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 5-11-8, Exterior(2E) 5-11-8 to 9-7-8, Exterior(2R) 9-7-8 to 13-7-7, Interior(1) 13-7-7 to 15-7-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- The Fabrication Tolerance at joint 2 = 4%, joint 5 = 4%, joint 2 = 0%, joint 5 = 0%
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=117, 6=117.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	D3	Hip Girder	1	1	149249780


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:40 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-XJKz3ZztgyXHpEsLu7EzGLMPuW6UU8M34HlId4y94WD



Scale = 1:26.9

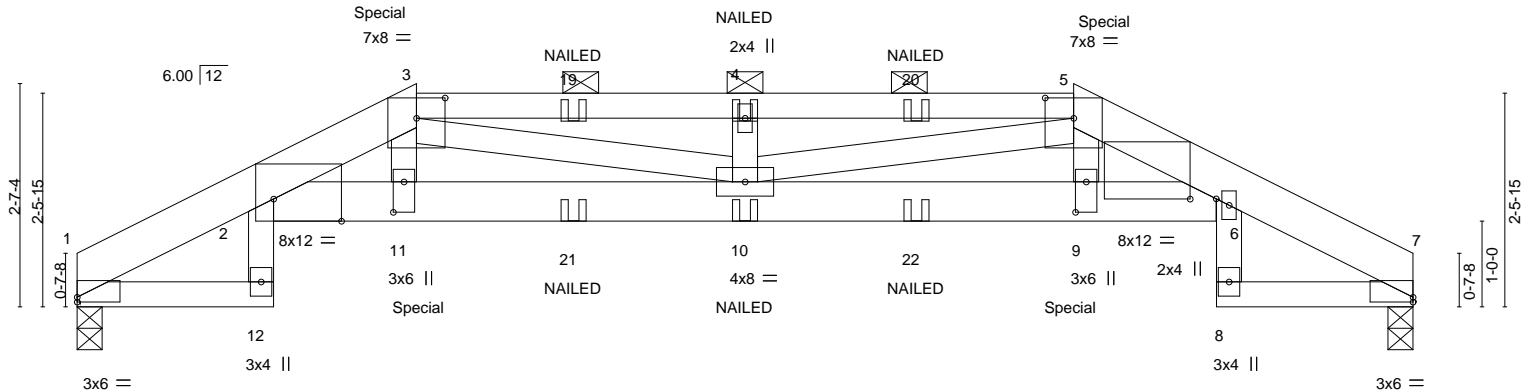

2-3-8	3-11-8	7-9-8	11-7-8	13-3-8	15-7-0
2-3-8	1-8-0	3-10-0	3-10-0	1-8-0	2-3-8

Plate Offsets (X,Y)--					
[1:0-0-0,0-0-11], [2:0-9-8,Edge], [3:0-4-0,0-2-13], [5:0-4-0,0-2-13], [6:0-3-10,0-0-0], [7:Edge,0-0-11], [9:0-4-4,0-1-8], [11:0-4-4,0-1-8]					
LOADING (psf)	SPACING-		CSI.	DEFL.	
TCLL 25.0	Plate Grip DOL 1.15		TC 0.87	in (loc) l/defl L/d	PLATES GRIP
TCDL 10.0	Lumber DOL 1.15		BC 0.72	Vert(LL) -0.23 10 >807 240	MT20 197/144
BCLL 0.0	Rep Stress Incr NO		WB 0.14	Vert(CT) -0.42 10 >443 180	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS	Horz(CT) 0.31 7 n/a n/a	Weight: 68 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP 2400F 2.0E *Except* 3-5: 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins, except 2-0-0 oc purlins (2-8-14 max.): 3-5.
BOT CHORD 2x4 SPF No.2 *Except* 2-6: 2x6 SPF 2100F 1.8E, 7-8: 2x4 SPF 1650F 1.5E	BOT CHORD Rigid ceiling directly applied or 9-8-14 oc bracing.
WEBS 2x4 SPF No.2	

**REACTIONS.** (size) 1=0-3-8, 7=0-3-8  
Max Horz 1=-35(LC 9)  
Max Uplift 1=-296(LC 8), 7=-296(LC 9)  
Max Grav 1=1016(LC 1), 7=1016(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-14=-540/189, 2-3=-3360/1037, 3-4=-3539/1092, 4-5=-3539/1092, 5-6=-3360/1003,  
6-7=-544/182  
BOT CHORD 2-11=-951/3147, 10-11=-951/3135, 9-10=-919/3135, 6-9=-919/3147  
WEBS 3-11=-136/557, 3-10=-158/470, 4-10=-314/147, 5-10=-156/470, 5-9=-130/557

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=296, 7=296.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
  - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 200 lb down and 157 lb up at 3-11-8, and 200 lb down and 157 lb up at 11-7-8 on top chord, and 51 lb down and 34 lb up at 3-11-8, and 51 lb down and 34 lb up at 11-6-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
  - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard  
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-2=-70, 2-3=-70, 3-5=-70, 5-6=-70, 6-7=-70, 12-13=-20, 2-6=-20, 8-16=-20



December 15, 2021

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	D3	Hip Girder	1	1	I49249780

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:40 2021 Page 2  
ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-XJKz3ZztgyXHpEsLu7EzGLMPuW6UU8M34HlId4y94WD

**LOAD CASE(S)** Standard  
Concentrated Loads (lb)  
Vert: 3=-141(F) 5=-141(F) 11=-51(F) 10=-51(F) 4=-31(F) 9=-51(F) 19=-31(F) 20=-31(F) 21=-51(F) 22=-51(F)

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	E1	Common Supported Gable	1	1	I49249781

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:41 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-?VuLGv\_VRGf8RORYSqlCoZvnXwdeDdvCix1rAWy94WC

0-10-8 7-0-0 14-0-0 14-10-8  
0-10-8 7-0-0 7-0-0 0-10-8

4x6 ==

Scale = 1:33.0

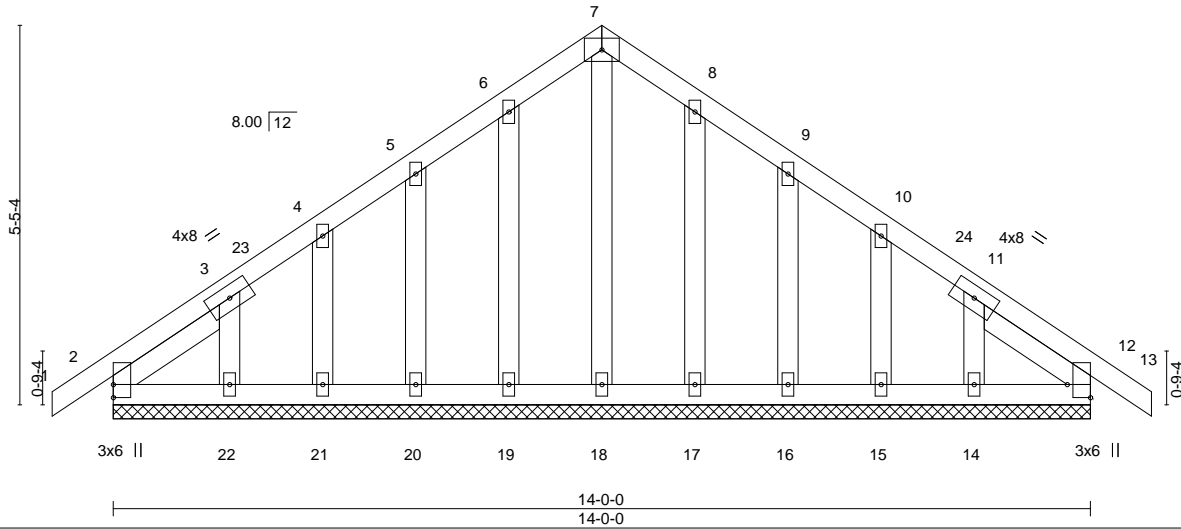


Plate Offsets (X,Y)-- [12:Edge,0-4-0]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.05	Vert(LL)	-0.00	12	n/r	120	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.02	Vert(CT)	-0.00	13	n/r	120		
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.00	12	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						Weight: 72 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 1-10-13, Right 2x4 SPF No.2 1-10-13

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 14-0-0.  
(lb) - Max Horz 2=-137(LC 10)  
Max Uplift All uplift 100 lb or less at joint(s) 2, 12, 19, 20, 21, 22, 17, 16, 15, 14  
Max Grav All reactions 250 lb or less at joint(s) 2, 12, 18, 19, 20, 21, 22, 17, 16, 15, 14

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-10-8 to 2-1-8, Exterior(2N) 2-1-8 to 7-0-0, Corner(3R) 7-0-0 to 10-0-0, Exterior(2N) 10-0-0 to 14-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 12, 19, 20, 21, 22, 17, 16, 15, 14.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	E2	Common	5	1	I49249782

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:42 2021 Page 1

ID:pEl2tSnelCAFSbWVgXHdMlzCDRM-ThSjTF\_7Can?3Y0k0YGRLmRreKtLy3vMXbnPiyy94WB

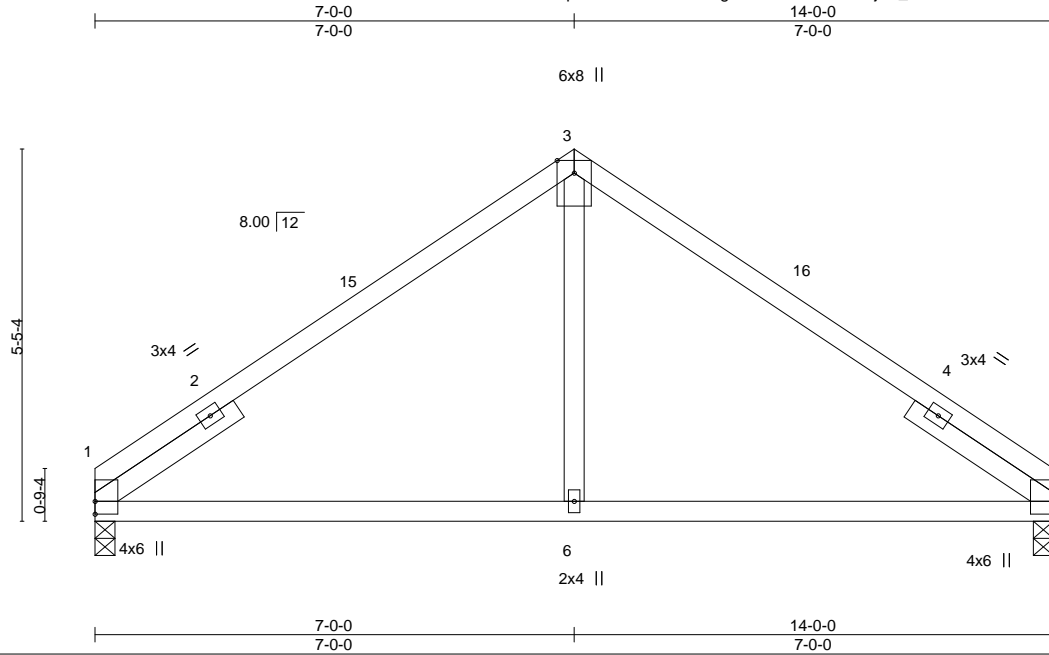

Scale = 1:33.7

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.47	Vert(LL)	-0.07	6-13	>999	240	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.38	Vert(CT)	-0.12	6-13	>999	180		
BCLL 0.0	Lumber DOL 1.15	WB 0.07	Horz(CT)	0.03	1	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS						Weight: 47 lb	FT = 20%
	Code IRC2018/TPI2014								

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 SLIDER Left 2x4 SPF No.2 2-6-0, Right 2x4 SPF No.2 2-6-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
 BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 1=0-3-8, 5=0-3-8  
 Max Horz 1=-122(LC 8)  
 Max Uplift 1=-96(LC 12), 5=-96(LC 13)  
 Max Grav 1=630(LC 1), 5=630(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-3=-603/186, 3-5=-603/186  
 BOT CHORD 1-6=-52/502, 5-6=-52/502  
 WEBS 3-6=0/302

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 7-0-0, Exterior(2R) 7-0-0 to 10-0-0, Interior(1) 10-0-0 to 14-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	E3	Flat Girder	1	<b>2</b>	I49249783

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:44 2021 Page 1

ID:pEI2ISneICAFSbWVgXHdMlzCDRM-P4aTux0Nk81jlsA67zJvQBx668aeQple\_vGWmry94W9

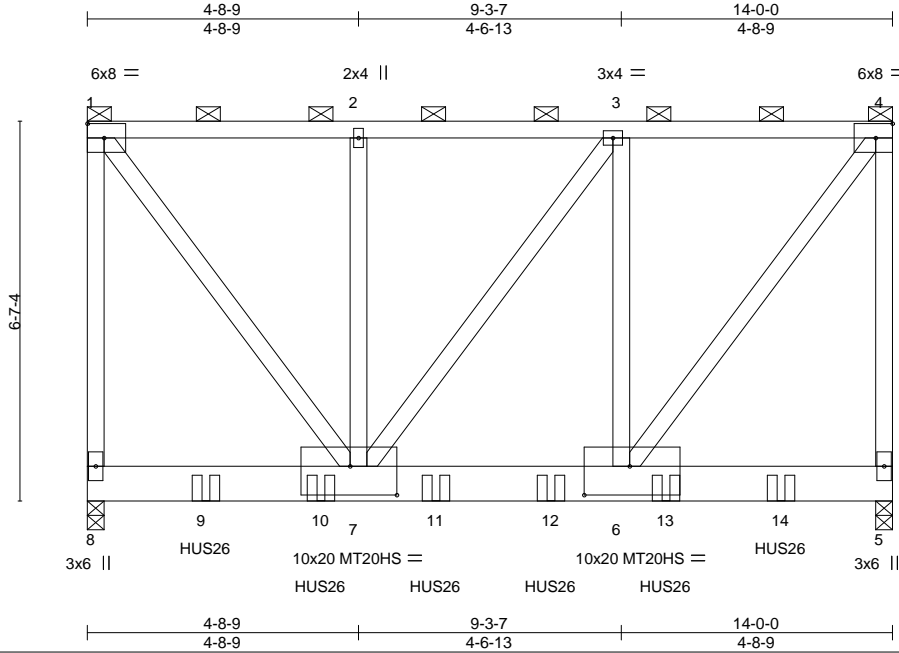

Scale = 1:40.1

Plate Offsets (X,Y)-- [6:0-9-8,0-6-0], [7:0-9-12,0-6-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.80	Vert(LL)	-0.06	6-7	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.26	Vert(CT)	-0.10	6-7	>999	180	MT20HS	148/108
BCLL 0.0	Rep Stress Incr	NO	WB 0.72	Horz(CT)	0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS						Weight: 219 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x8 SP 2400F 2.0E  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD 2-0-0 oc purlins (6-0-0 max.): 1-4, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 8=0-3-8, 5=0-3-8  
Max Horz 8=-235(LC 4)  
Max Uplift 8=-878(LC 4), 5=-798(LC 5)  
Max Grav 8=5853(LC 1), 5=5950(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-8=-4800/720, 1-2=-3476/493, 2-3=-3476/493, 3-4=-3501/466, 4-5=-4832/683  
BOT CHORD 6-7=-528/3501  
WEBS 1-7=-832/5789, 2-7=-326/155, 3-6=-297/241, 4-6=-787/5831

#### NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-5-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=878, 5=798.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use Simpson Strong-Tie HUS26 (14-10d Girder, 6-10d Truss) or equivalent spaced at 2-0-0 oc max. starting at 2-0-12 from the left end to 12-0-12 to connect truss(es) to front face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.

#### LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15



December 15, 2021

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	E3	Flat Girder	1	2	I49249783

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:44 2021 Page 2  
ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-P4aTux0NkB1jlsA67zJvQBx668aeQple\_vGWmry94W9

**LOAD CASE(S)** Standard  
Uniform Loads (plf)  
Vert: 1-4=-70, 5-8=-20  
Concentrated Loads (lb)  
Vert: 9=-1762(F) 10=-1762(F) 11=-1762(F) 12=-1762(F) 13=-1762(F) 14=-1762(F)

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	J1	Jack-Open	5	1	I49249784

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:44 2021 Page 1

ID:pEI2ISnelCAFSbWVgXHdMlzCDRM-P4aTux0Nk1jlsA67zJvQBxEq8clQ\_Te\_vGWmry94W9

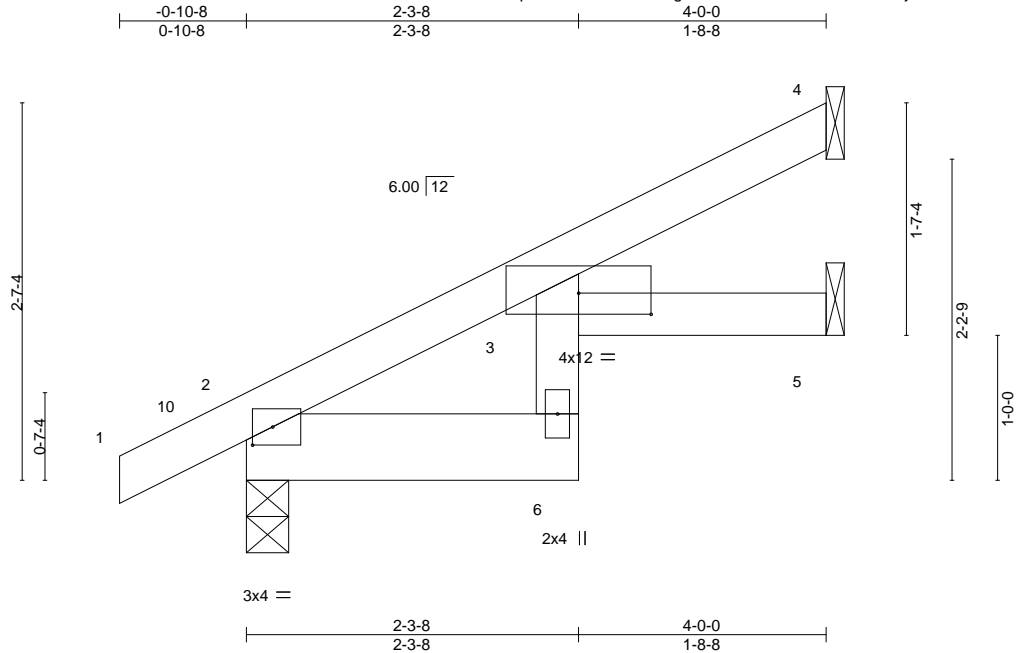


Plate Offsets (X,Y)-- [2:0-1-11,0-1-8], [3:0-6-0,0-1-12]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.30	Vert(LL)	0.03	6	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.19	Vert(CT)	-0.04	6	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.03	5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR						Weight: 14 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2 \*Except\*  
2-6: 2x6 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

#### REACTIONS.

(size) 4=Mechanical, 2=0-3-8, 5=Mechanical  
Max Horz 2=96(LC 12)  
Max Uplift 4=47(LC 12), 2=38(LC 12), 5=15(LC 12)  
Max Grav 4=101(LC 1), 2=246(LC 1), 5=71(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-0-5, Interior(1) 2-0-5 to 3-11-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2, 5.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	J2	Jack-Open	4	1	149249785


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:45 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-tG8s6H10UV9aw0Jhgq8zO3TSX\_f9RjoDZ?3JHy94W8

-0-10-8 1-10-15  
0-10-8 1-10-15

Scale = 1:10.7

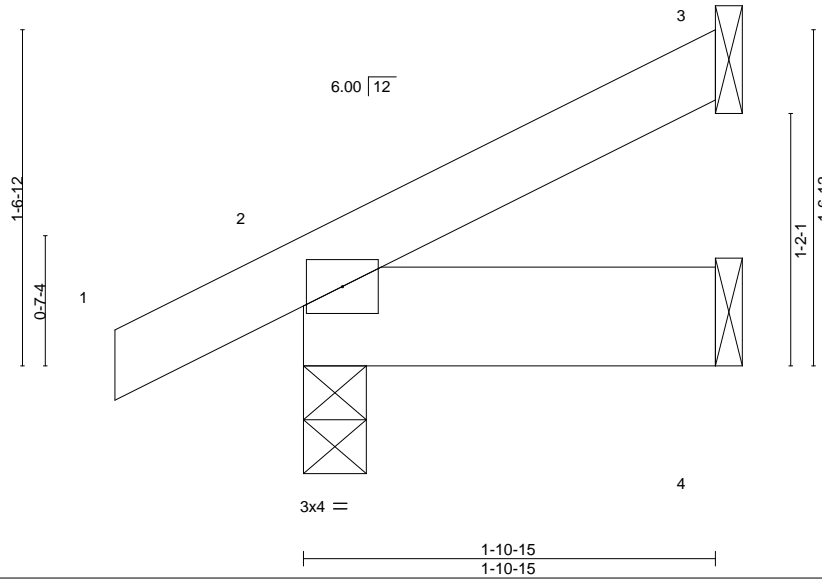

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.05	Vert(LL)	-0.00	7	>999	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.02	Vert(CT)	-0.00	7	>999		
BCLL 0.0	Lumber DOL 1.15	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MP						
	Code IRC2018/TPI2014						Weight: 7 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x6 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-10-15 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical  
Max Horz 2=54(LC 12)  
Max Uplift 3=-26(LC 12), 2=-30(LC 12), 4=-3(LC 12)  
Max Grav 3=45(LC 1), 2=161(LC 1), 4=38(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2, 4.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	L1	GABLE	1	1	149249786

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:45 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMizCDRM-tG8s6H10UV9aw0lJhgq8zO3TLX\_Z9RGoDZ?3JHy94W8



Scale = 1:28.2

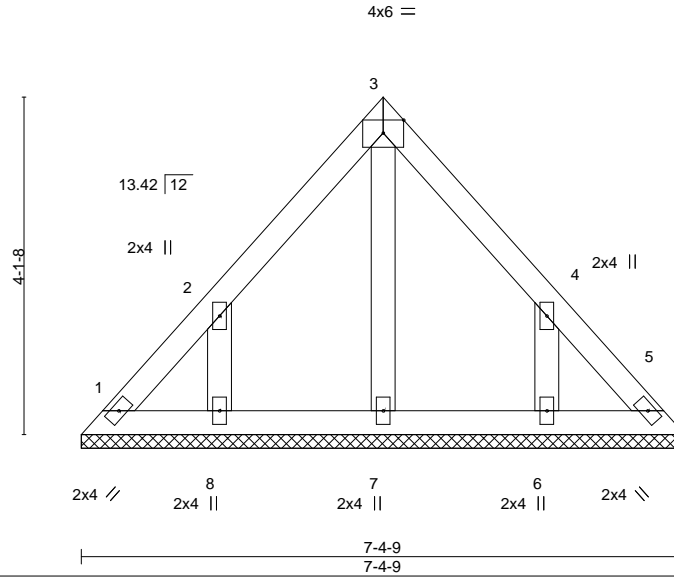


Plate Offsets (X,Y)-- [3:Edge,0-1-14]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	2-0-0	TC 0.06	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 27 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 7-4-9.  
(lb) - Max Horz 1=101(LC 10)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 8=154(LC 12), 6=154(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7, 8, 6

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-3-15 to 3-3-15, Interior(1) 3-3-15 to 3-8-4, Exterior(2R) 3-8-4 to 6-8-4, Interior(1) 6-8-4 to 7-0-10 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=154, 6=154.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	PB1	Piggyback	1	1	149249787

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:47 2021 Page 1  
ID:pEl2tSnelCAFSbWVgXHdMlzCDRM-qfFcXy2G06PI9Jvhp5sc2p9psLgzdLu5htUANAy94W6

Job Reference (optional)

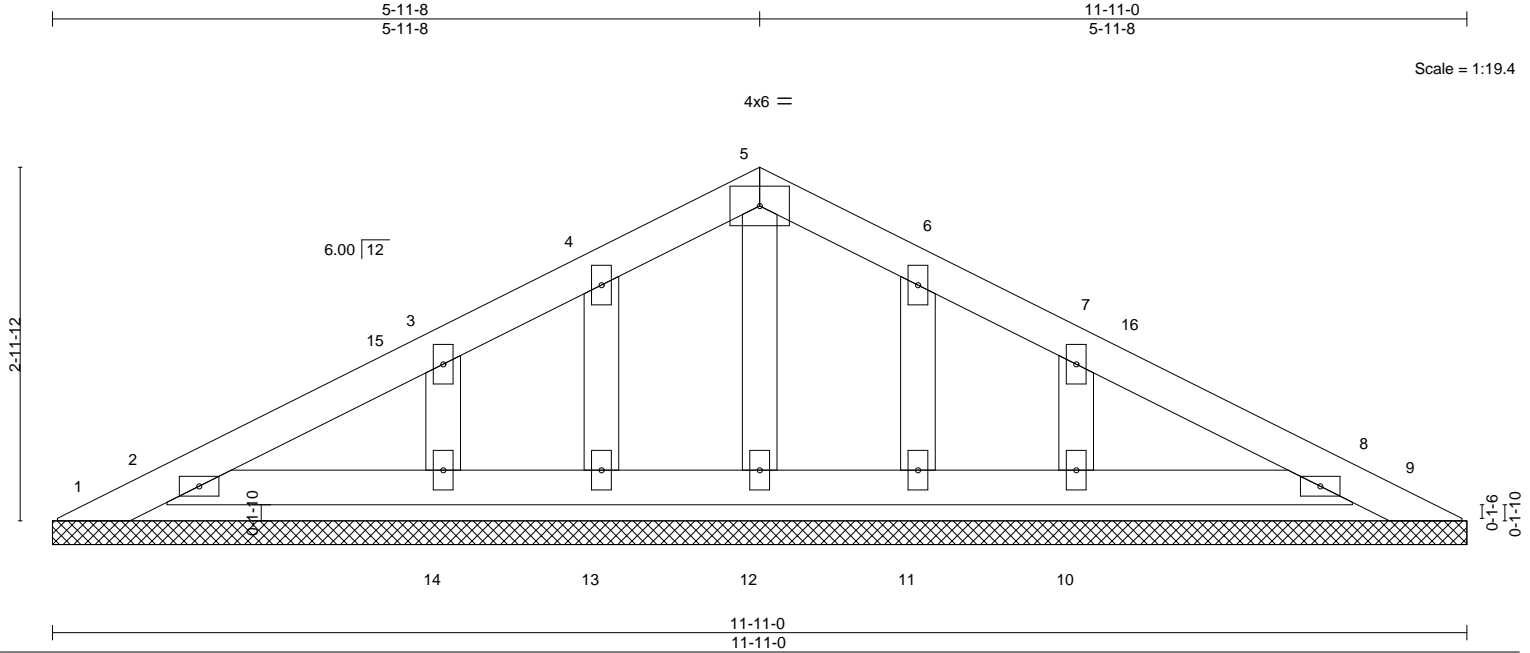

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.06	Vert(LL) n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.03	Vert(CT) n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr YES	WB 0.02	Horz(CT) 0.00	8	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-S					Weight: 35 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 11-11-0.  
(lb) - Max Horz 1=49(LC 16)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 9, 2, 8, 13, 14, 11, 10  
Max Grav All reactions 250 lb or less at joint(s) 1, 9, 2, 8, 12, 13, 14, 11, 10

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-3 to 3-3-8, Interior(1) 3-3-8 to 5-11-8, Exterior(2R) 5-11-8 to 8-11-8, Interior(1) 8-11-8 to 11-6-13 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 9, 2, 8, 13, 14, 11, 10.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	PB1A	Piggyback	1	1	I49249788

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:48 2021 Page 1  
ID:pEl2tSnelCAFSbWVGXHdMlzCDRM-lrp\_kl3unQX9nTUuMoNra1h\_YI?BMo7EvXEjvcy94W5

Job Reference (optional)

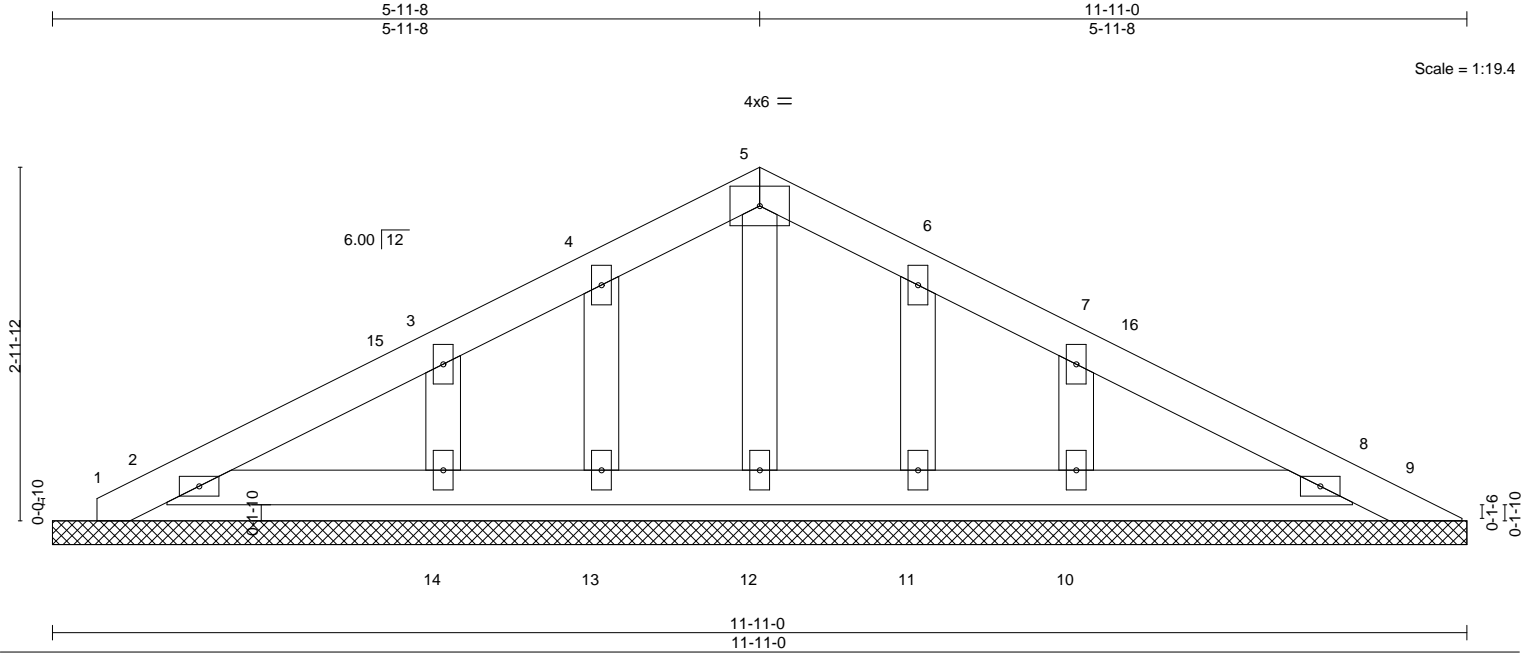

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.06	Vert(LL) n/a	-	n/a	999		MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.03	Vert(CT) n/a	-	n/a	999			
BCLL 0.0	Rep Stress Incr YES	WB 0.02	Horz(CT) 0.00	8	n/a	n/a			
BCDL 10.0	Code IRC2018/TPI2014	Matrix-S						Weight: 35 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 11-11-0.  
(lb) - Max Horz 1=51(LC 13)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 9, 2, 8, 13, 14, 11, 10  
Max Grav All reactions 250 lb or less at joint(s) 1, 9, 2, 8, 12, 13, 14, 11, 10

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-6-3 to 3-3-8, Interior(1) 3-3-8 to 5-11-8, Exterior(2R) 5-11-8 to 8-11-8, Interior(1) 8-11-8 to 11-6-13 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 9, 2, 8, 13, 14, 11, 10.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO	I49249789
3016791	PB2	Piggyback	22	1	Job Reference (optional)	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:49 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-m1NMxe4WYjf0Od24wWu47EE4?9J35E\_N8BzHS2y94W4

11-11-0

5-11-8

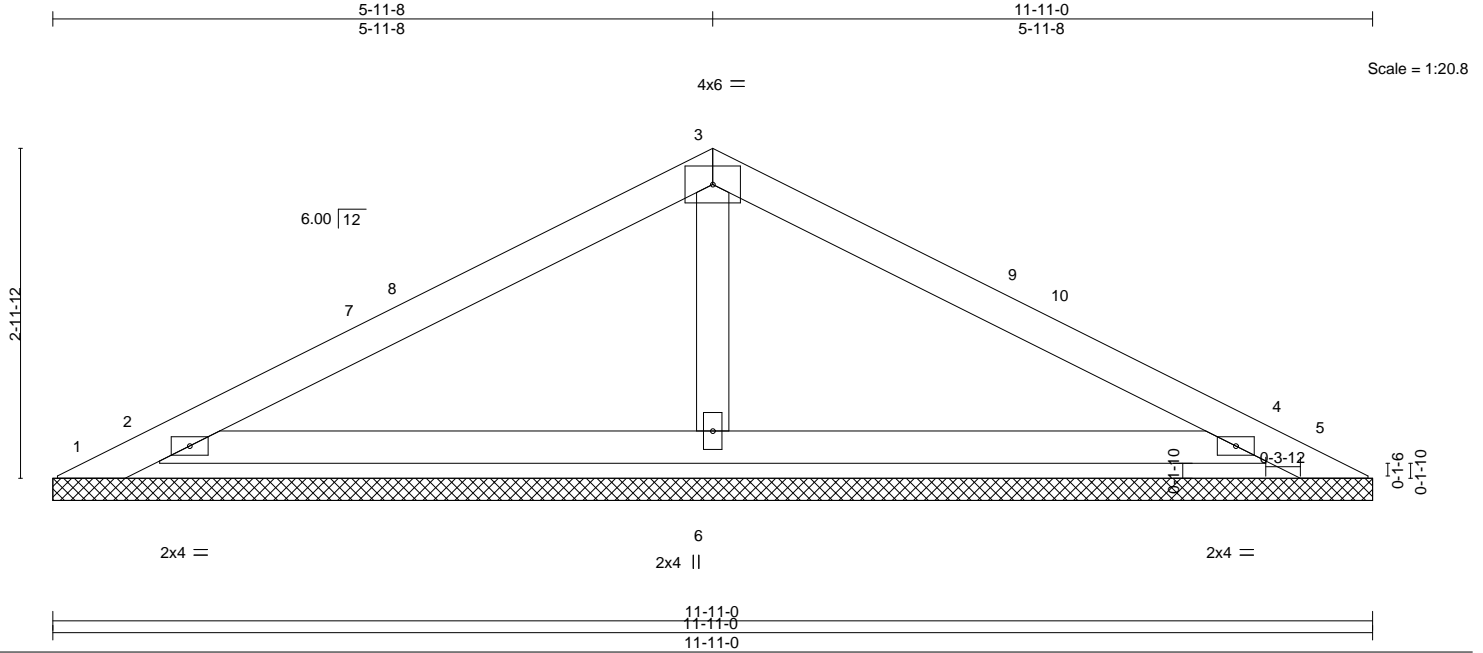

Scale = 1:20.8

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.34	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.18	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						Weight: 29 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 11-11-0.

(lb) - Max Horz 1=-49(LC 17)

Max Uplift All uplift 100 lb or less at joint(s) 6 except 1=-259(LC 25), 5=-259(LC 26), 2=-225(LC 12), 4=-212(LC 13)

Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 2=564(LC 25), 4=564(LC 26), 6=411(LC 1)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 3-6=-290/159

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-3 to 3-4-3, Interior(1) 3-4-3 to 5-11-8, Exterior(2R) 5-11-8 to 8-11-8, Interior(1) 8-11-8 to 11-6-13 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6 except (jt=lb) 1=259, 5=259, 2=225, 4=212.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	V1	Valley	1	1	149249790

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:50 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-EEExl9\_58J1ot0ndGUDQJgSmDxYeqqe\_XNrq\_Vy94W3

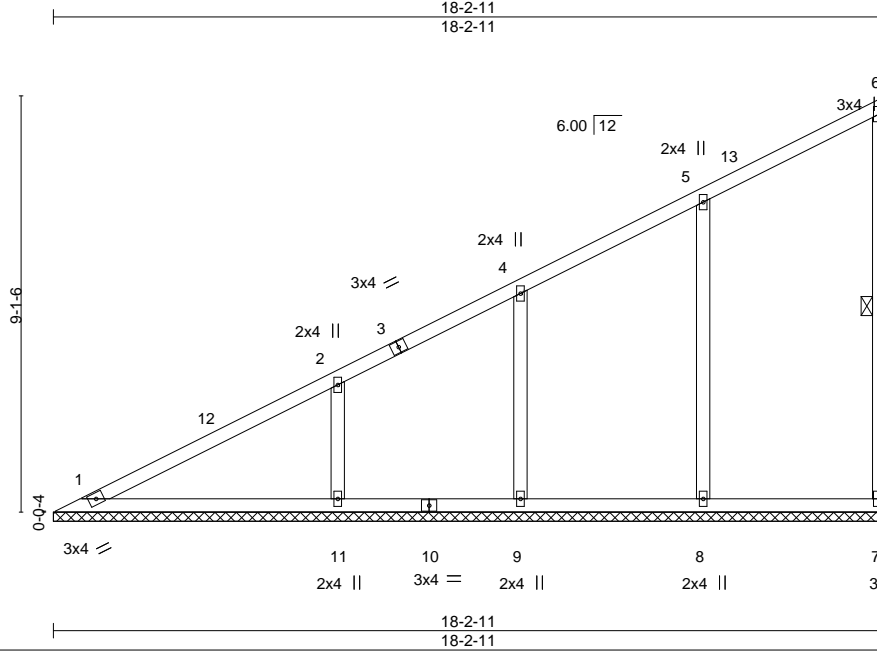

Scale = 1:50.4

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.45	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.21	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Lumber DOL 1.15	WB 0.25	Horz(CT)	-0.00	7	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S					Weight: 68 lb	FT = 20%
	Code IRC2018/TPI2014							

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 6-7

#### REACTIONS.

All bearings 18-2-11.  
(lb) - Max Horz 1=363(LC 9)  
Max Uplift All uplift 100 lb or less at joint(s) 7 except 8=137(LC 12), 9=101(LC 12), 11=179(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 7, 1 except 8=403(LC 1), 9=296(LC 1), 11=525(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=459/276, 2-4=333/210, 4-5=256/190  
WEBS 5-8=313/207, 2-11=394/217

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 18-0-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7 except (jt=lb) 8=137, 9=101, 11=179.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	V2	Valley	1	1	I49249791

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:57 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMzCDRM-XasOdNAXgBgtMsgcOB2ySwZRuN2SzqDZ\_Qvijby94Vy

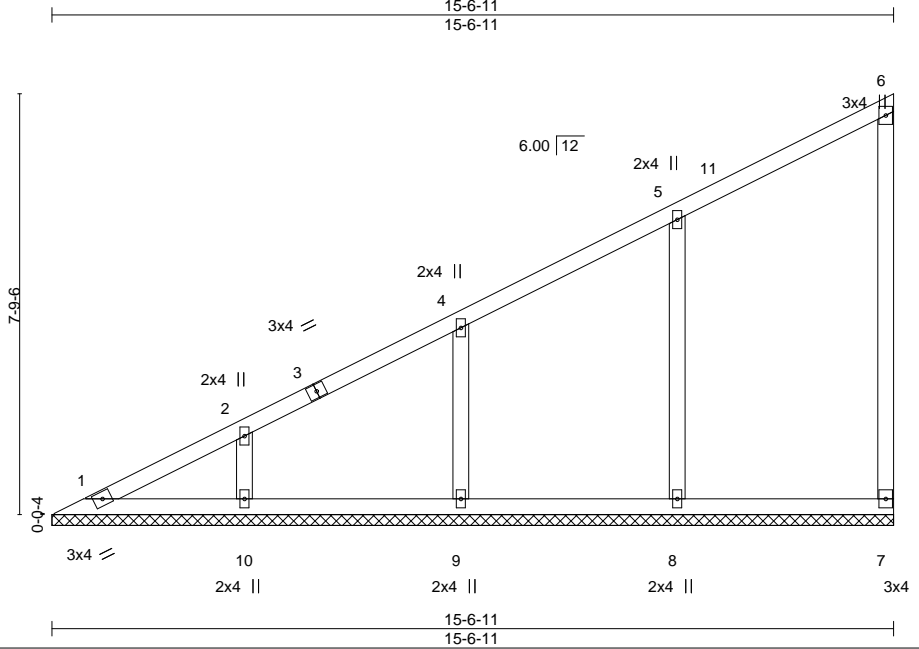

Scale = 1:42.6

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.34	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.15	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.16	Horz(CT)	-0.00	7	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						Weight: 56 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 15-6-11.  
(lb) - Max Horz 1=308(LC 9)  
Max Uplift All uplift 100 lb or less at joint(s) 7 except 8=132(LC 12), 9=122(LC 12), 10=119(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 7, 1 except 8=387(LC 1), 9=357(LC 1), 10=348(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-432/246, 2-4=-344/211, 4-5=-251/176  
WEBS 5-8=-301/209, 4-9=-279/174, 2-10=-266/167

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-6-11, Interior(1) 3-6-11 to 15-4-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7 except (jt=lb) 8=132, 9=122, 10=119.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	V3	Valley	1	1	I49249792

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:59 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMizCDRM-Tz\_823BoBowbb9p?Wc4QXLePDBINRlosRkOonTy94Vw

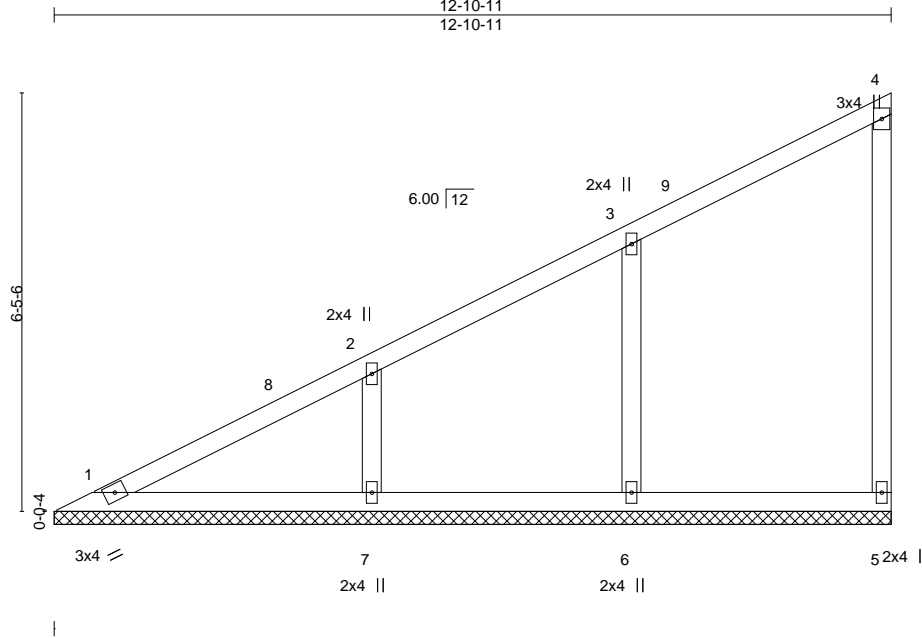

Scale = 1:35.5

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.23	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.12	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.09	Horz(CT)	-0.00	5	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S					Weight: 44 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 12-10-11.  
(lb) - Max Horz 1=252(LC 9)  
Max Uplift All uplift 100 lb or less at joint(s) 5 except 6=125(LC 12), 7=143(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 6=368(LC 1), 7=419(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-359/215  
WEBS 3-6=-290/215, 2-7=-317/221

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 12-8-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5 except (jt=lb) 6=125, 7=143.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO	149249794
3016791	V5	Valley	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:15:00 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-x9YXFPCQy62SDJOB3Kbg4ZB\_Fa5rADi?gO8MKvy94Vv

7-6-11  
7-6-11

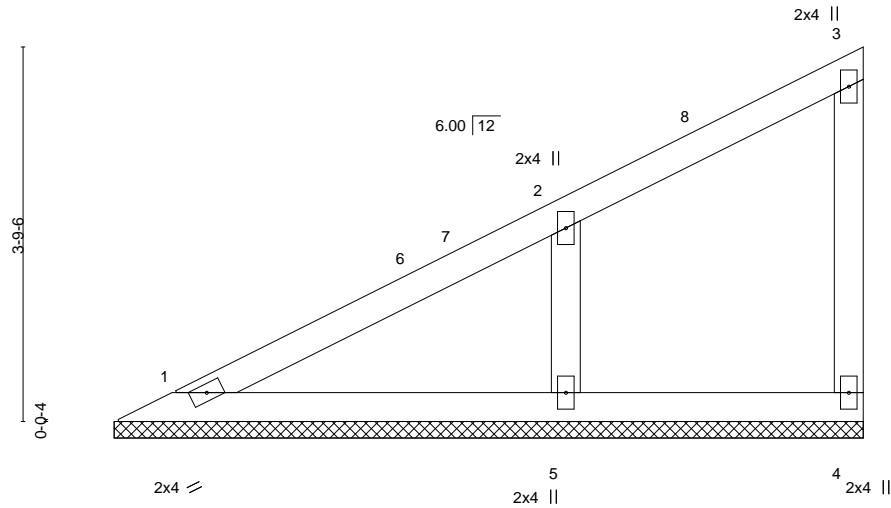

Scale = 1:23.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.21	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.10	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	-0.00	4	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 23 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=7-6-11, 4=7-6-11, 5=7-6-11  
Max Horz 1=141(LC 9)  
Max Uplift 4=24(LC 9), 5=125(LC 12)  
Max Grav 1=142(LC 1), 4=80(LC 1), 5=389(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
WEBS 2-5=-302/267

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 7-4-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 5=125.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	V6	Valley	1	1	149249795

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:15:01 2021 Page 1

ID:pEI2tSneICAFsbWVgXHdMzCDRM-PL5vTID2jPAJqTzOd16vcmk58\_OUvdy9v2tvsMy94Vu

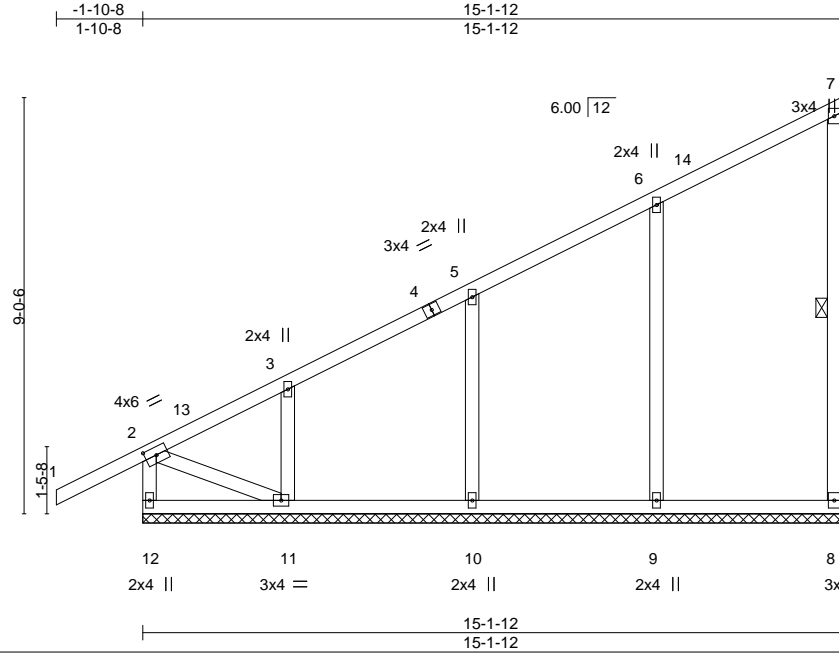


Plate Offsets (X,Y)-- [2:0-2-15,0-2-0]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.45	Vert(LL)	0.01	1	n/r	120	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.21	Vert(CT)	-0.01	1	n/r	120		
BCLL 0.0	Rep Stress Incr	YES	WB 0.24	Horz(CT)	-0.00	8	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						Weight: 68 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### REACTIONS.

All bearings 15-1-12.  
(lb) - Max Horz 12=375(LC 9)  
Max Uplift All uplift 100 lb or less at joint(s) 12, 8 except 9=132(LC 12), 10=124(LC 12), 11=192(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 8 except 12=349(LC 20), 9=386(LC 1), 10=364(LC 1), 11=290(LC 1)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-12=-325/89, 2-3=-447/261, 3-5=-363/231, 5-6=-269/196  
BOT CHORD 11-12=-536/346  
WEBS 6-9=-300/220, 5-10=-285/186, 2-11=-254/476

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 15-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12, 8 except (jt=lb) 9=132, 10=124, 11=192.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing, Except:  
6'-0-0 oc bracing: 11-12.  
WEBS 1 Row at midpt 7-8



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	V7	Valley	1	1	I49249796

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:15:02 2021 Page 1  
ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-tXfHg5EgUjIASdYaBld89\_GlmOlge5XI7idTOoy94Vt

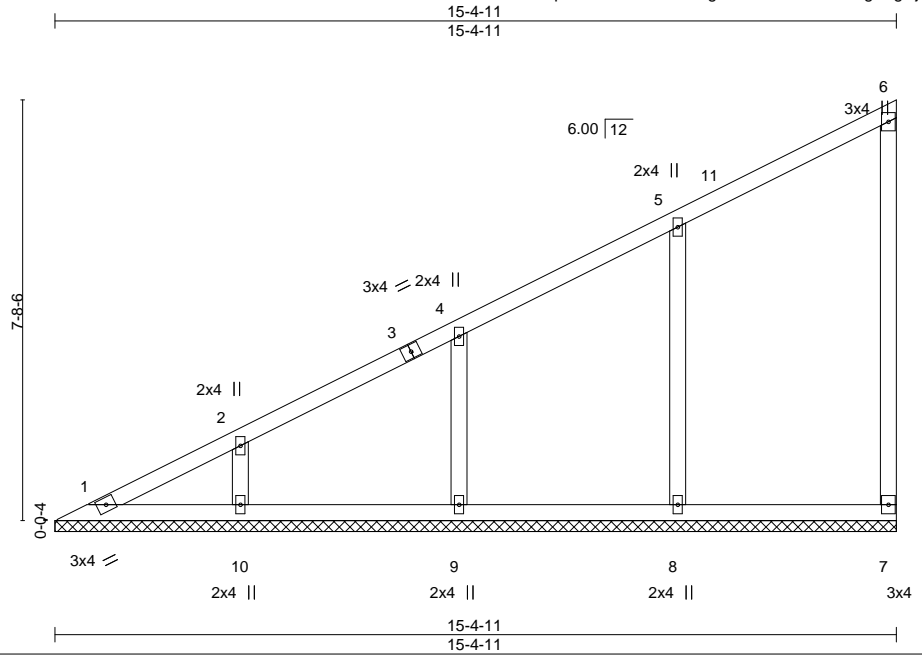

Scale = 1:42.1

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.33	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.14	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.15	Horz(CT)	-0.00	7	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						Weight: 55 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 15-4-11.  
(lb) - Max Horz 1=304(LC 9)  
Max Uplift All uplift 100 lb or less at joint(s) 7 except 8=131(LC 12), 9=122(LC 12), 10=116(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 7, 1 except 8=386(LC 1), 9=359(LC 1), 10=339(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-430/245, 2-4=-344/211, 4-5=-251/175  
WEBS 5-8=-301/210, 4-9=-280/176, 2-10=-261/164

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-4-11, Interior(1) 3-4-11 to 15-2-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7 except (jt=lb) 8=131, 9=122, 10=116.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	V8	Valley	1	1	I49249797

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:15:02 2021 Page 1  
ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-tXfHg5EgUjIAStYaBld89\_GKdOmBe6Zl7idTOoy94Vt

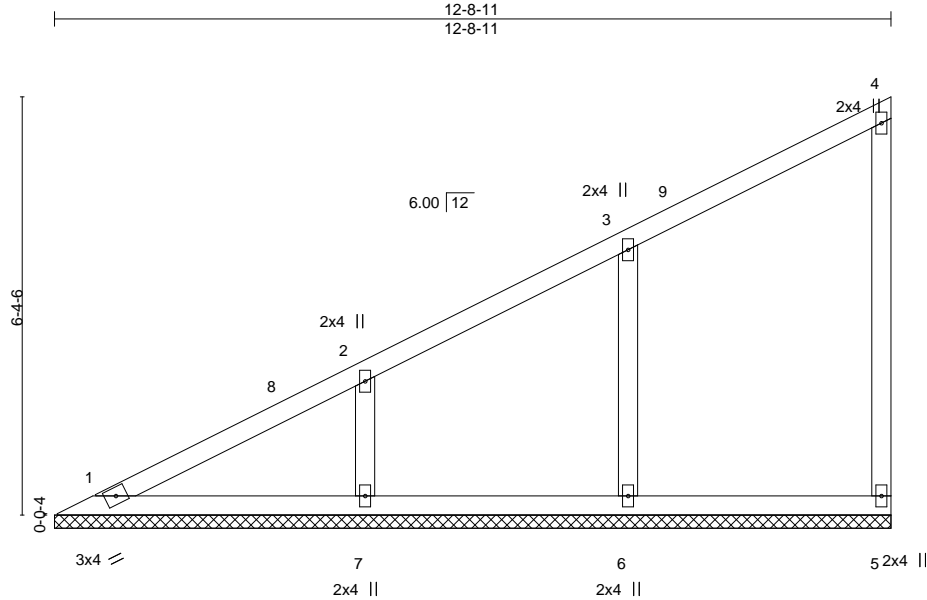

Scale = 1:35.1

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.22	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.11	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.09	Horz(CT)	-0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						Weight: 43 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 12-8-11.  
(lb) - Max Horz 1=249(LC 9)  
Max Uplift All uplift 100 lb or less at joint(s) 5 except 6=126(LC 12), 7=139(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 6=372(LC 1), 7=408(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-356/213  
WEBS 3-6=-292/218, 2-7=-309/217

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 12-6-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5 except (jt=lb) 6=126, 7=139.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601  
**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	V9	Valley	1	1	I49249798

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:15:03 2021 Page 1

ID:pEI2tSneICAfSbWVgXHdMzCDRM-MkDfuRFIF1Q14n7mIS8NhBpTho5SNaERMMMOwEy94Vs

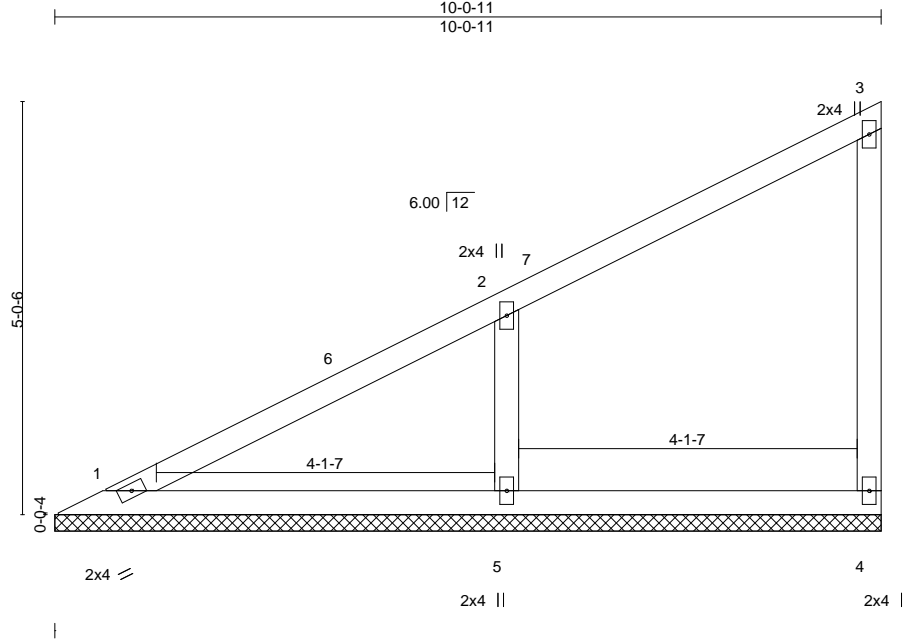

Scale = 1:28.0

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.32	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.17	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.06	Horz(CT)	-0.00	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						Weight: 31 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=10-0-11, 4=10-0-11, 5=10-0-11  
Max Horz 1=193(LC 9)  
Max Uplift 4=38(LC 9), 5=144(LC 12)  
Max Grav 1=175(LC 1), 4=149(LC 1), 5=511(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-277/179  
WEBS 2-5=-389/277

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 9-10-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 5=144.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	V10	Valley	1	1	I49249799


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:51 2021 Page 1

ID:pEl2tSneICAFsbWVgXHdMlzCDRM-iQV7MK5m4LwkeXCT2xxYCFJTzy0wZ8VgbVSNWxy94W2

7-4-11  
7-4-11

Scale = 1:22.8

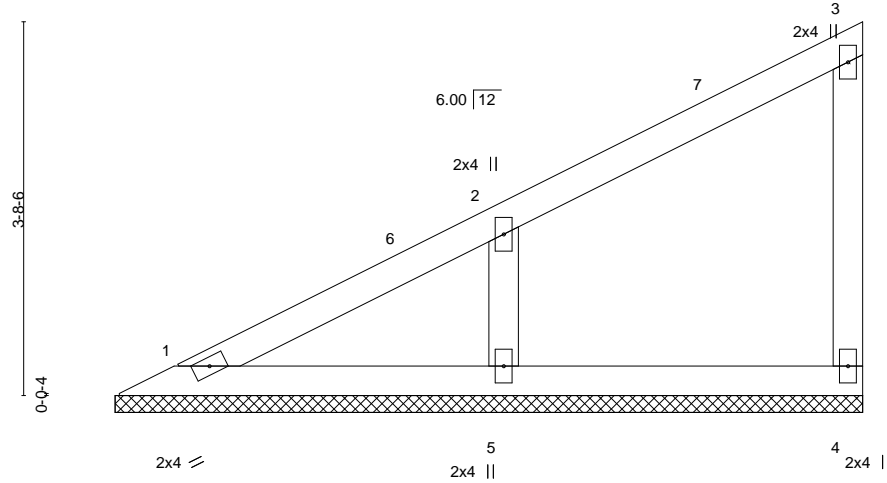

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.18	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.09	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	-0.00	4	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 22 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=7-4-11, 4=7-4-11, 5=7-4-11  
Max Horz 1=138(LC 9)  
Max Uplift 4=28(LC 9), 5=122(LC 12)  
Max Grav 1=111(LC 20), 4=117(LC 1), 5=372(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
WEBS 2-5=-289/259

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-10-2, Interior(1) 3-10-2 to 7-2-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 5=122.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	V11	Valley	1	1	I49249800

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:52 2021 Page 1

ID:pEl2tSnelCAFSbWVgXHdMlzCDRM-Ac3Vag6Pre2bF4nfbEsnltsegMM4lbpqq9Cx2Ny94W1

Job Reference (optional)

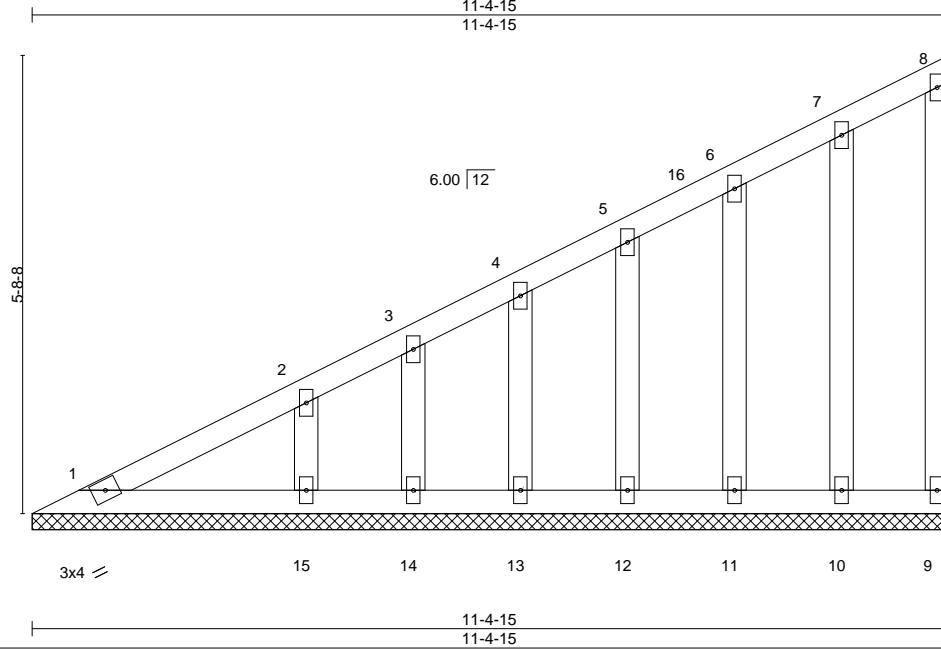

Scale = 1:28.7

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.18	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.10	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr YES	WB 0.04	Horz(CT)	0.00	9	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-S						Weight: 52 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 11-4-15.  
(lb) - Max Horz 1=222(LC 9)  
Max Uplift All uplift 100 lb or less at joint(s) 9, 10, 11, 12, 13, 14, 15  
Max Grav All reactions 250 lb or less at joint(s) 1, 9, 10, 11, 12, 13, 14 except 15=256(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-419/218, 2-3=-323/174, 3-4=-291/170

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-7-7 to 3-4-15, Exterior(2N) 3-4-15 to 11-3-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) All plates are 2x4 MT20 unless otherwise indicated.
- 4) Gable studs spaced at 1-4-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9, 10, 11, 12, 13, 14, 15.
- 7) Non Standard bearing condition. Review required.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	V12	Valley	1	1	I49249801

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:53 2021 Page 1

ID:pEl2tSneICAFSbWVgXHdMlzCDRM-epdtn071cyARtEMr9Mz0H4OnDmhk12xz3pxUbp94W0

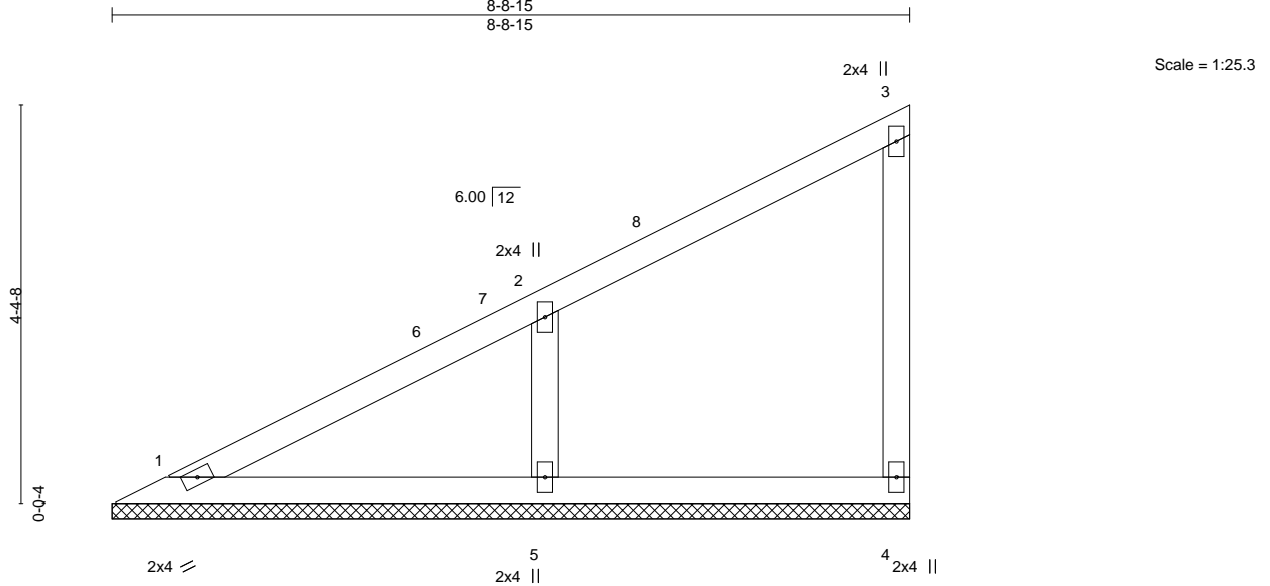

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.26	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.13	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Lumber DOL 1.15	WB 0.05	Horz(CT)	-0.00	4	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P					Weight: 27 lb	FT = 20%
	Code IRC2018/TPI2014							

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=8-8-15, 4=8-8-15, 5=8-8-15  
Max Horz 1=166(LC 9)  
Max Uplift 4=-32(LC 9), 5=-135(LC 12)  
Max Grav 1=144(LC 20), 4=127(LC 1), 5=448(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-261/169  
WEBS 2-5=-349/273

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 8-7-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 5=135.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	V14	Valley	1	1	I49249803


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:54 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMizCDRM-6?AF?M8fNGIIVOX1j3UFqlx?7A21mVx7ITh17Gy94W?

3-4-15  
3-4-15

Scale = 1:11.3

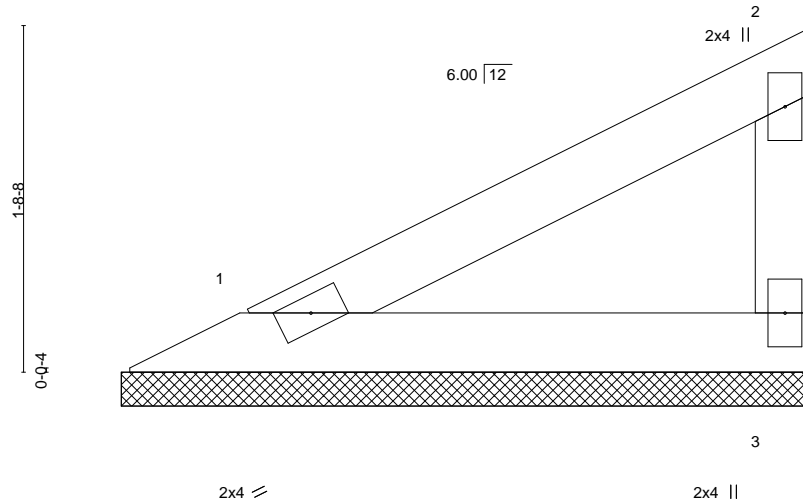

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.12	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.07	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Lumber DOL 1.15	WB 0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P						Weight: 9 lb	FT = 20%
	Code IRC2018/TPI2014								

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-4-15 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=3-4-15, 3=3-4-15  
Max Horz 1=55(LC 9)  
Max Uplift 1=-20(LC 12), 3=-34(LC 12)  
Max Grav 1=119(LC 1), 3=119(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	V15	Valley	1	1	149249804

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:54 2021 Page 1

ID:pEI2tSnelCAFSbWVGxHdMlzCDRM-6?AF?M8fNGIIVox1j3UFqlx\_rA2umVx7ITh17Gy94W?

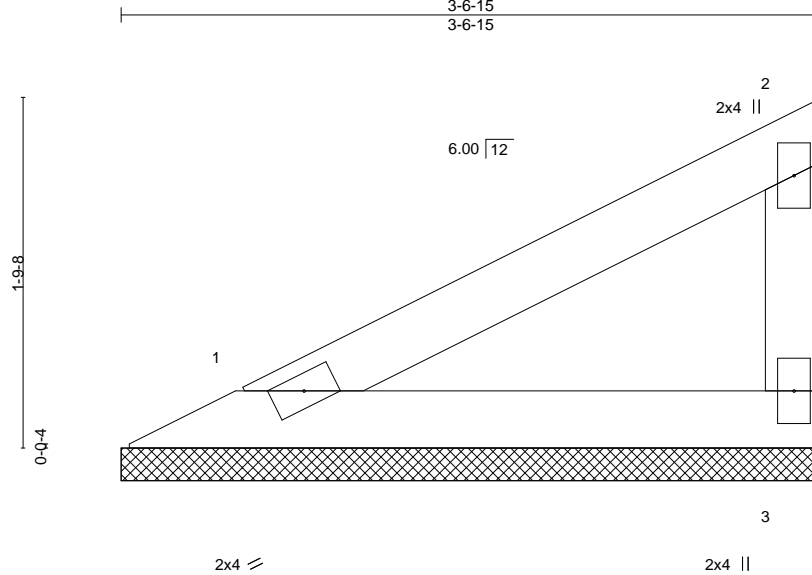

Scale = 1:11.8

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.14	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.07	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Lumber DOL 1.15	WB 0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P						Weight: 9 lb	FT = 20%
	Code IRC2018/TPI2014								

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-6-15 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=3-6-15, 3=3-6-15  
Max Horz 1=59(LC 9)  
Max Uplift 1=-21(LC 12), 3=-36(LC 12)  
Max Grav 1=126(LC 1), 3=126(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	V16	Valley	1	1	I49249805

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:55 2021 Page 1

ID:pEI2tSneICAFSbWVgXHdMlzCDRM-bBkeCi8H8ZQ96YWEHn?UNVU2aZKKVyBGW6Qbfy94W\_

6-2-15  
6-2-15

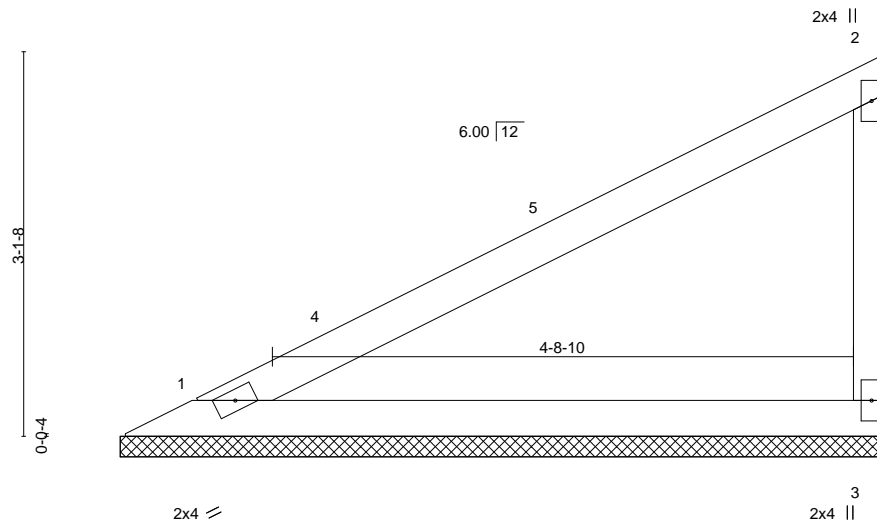

Scale = 1:18.7

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.59	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.32	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 17 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=6-2-15, 3=6-2-15  
Max Horz 1=114(LC 9)  
Max Uplift 1=-38(LC 12), 3=-73(LC 12)  
Max Grav 1=246(LC 1), 3=246(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 6-1-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	V17	Valley	1	1	I49249806

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:55 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMzCDRM-bBkeCi8H8ZQ96YWEHn?UNVU7XZM6VyOGW6Qbfy94W\_

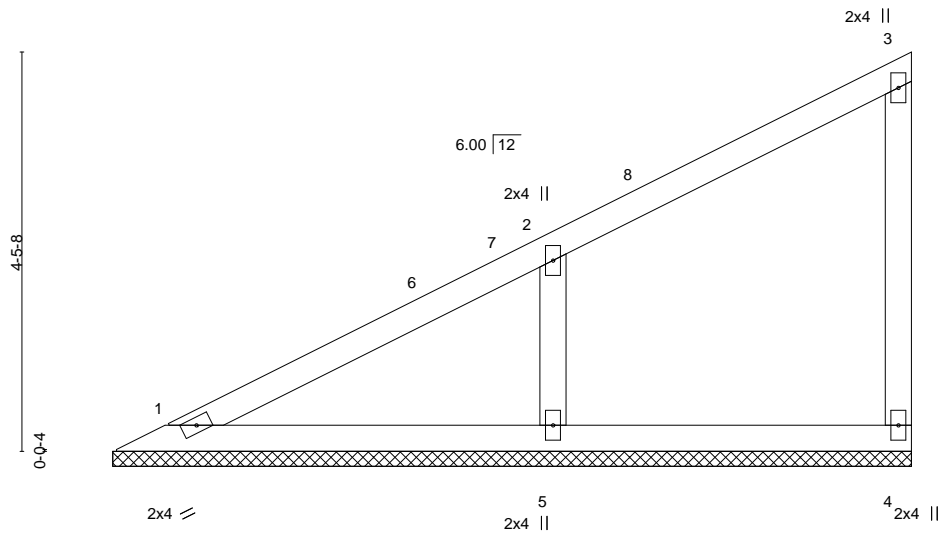

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.27	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.14	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Lumber DOL 1.15	WB 0.05	Horz(CT)	-0.00	4	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P					Weight: 27 lb	FT = 20%
	Code IRC2018/TPI2014							

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=8-10-15, 4=8-10-15, 5=8-10-15  
Max Horz 1=170(LC 9)  
Max Uplift 4=32(LC 9), 5=136(LC 12)  
Max Grav 1=150(LC 20), 4=125(LC 1), 5=458(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-262/171  
WEBS 2-5=-356/275

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 8-9-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 5=136.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017






Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	V19	Valley	1	1	149249808

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:56 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-3OIOP19vvtY0ki5QqUWvjv0JPzjOEPRPlmA8B8y94Vz

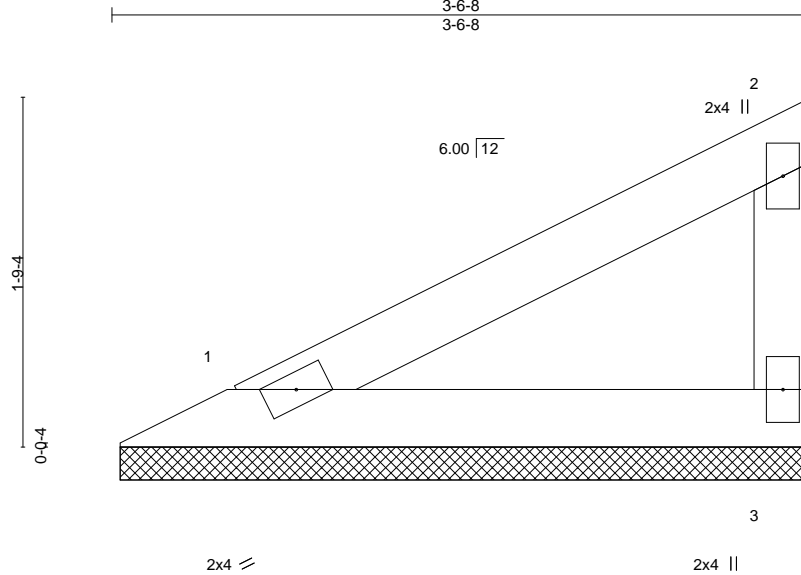

Scale = 1:11.7

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.13	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 9 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-6-8 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=3-6-0, 3=3-6-0  
Max Horz 1=58(LC 11)  
Max Uplift 1=-21(LC 12), 3=-36(LC 12)  
Max Grav 1=125(LC 1), 3=125(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	V20	Valley	1	1	149249809

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:57 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMizCDRM-XasOdNAXgBgtMsgcOB2ySwZTSN2izshZ\_Qvijby94Vy

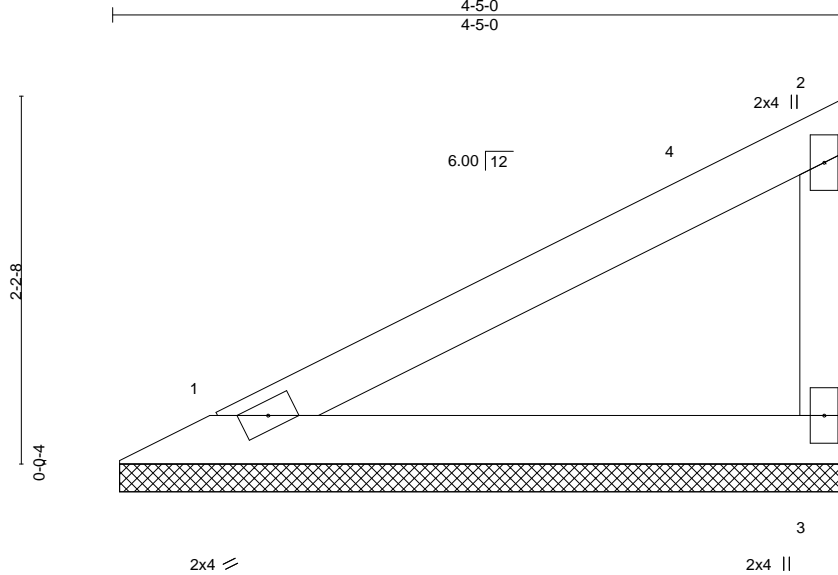

Scale = 1:13.8

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.24	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.13	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 12 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-5-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=4-4-8, 3=4-4-8  
Max Horz 1=76(LC 9)  
Max Uplift 1=-28(LC 12), 3=-47(LC 12)  
Max Grav 1=164(LC 1), 3=164(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 4-3-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	V21	Valley	1	1	149249810

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:58 2021 Page 1

ID:pEI2tSneICAFSbWVgXHdMizCDRM-?mQmqjBAQUokz?EpyvZB\_86hJnQdiJxiC4fFF1y94Vx

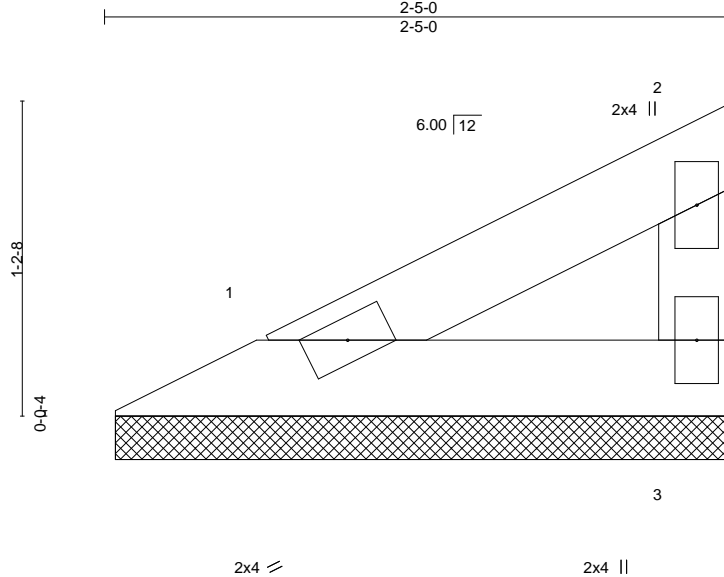

Scale = 1:8.8

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.04	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.02	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 6 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-5-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=2-4-8, 3=2-4-8  
Max Horz 1=34(LC 9)  
Max Uplift 1=12(LC 12), 3=-21(LC 12)  
Max Grav 1=74(LC 1), 3=74(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/STONE CREEK #95/MO
3016791	V22	Valley	1	1	I49249811

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Dec 14 10:14:59 2021 Page 1

ID:pEI2tSnelCAFSbWVgXHdMlzCDRM-Tz\_823BoBowbb9p?Wc4QXLesKBmcRmBsRkOonTy94Vw

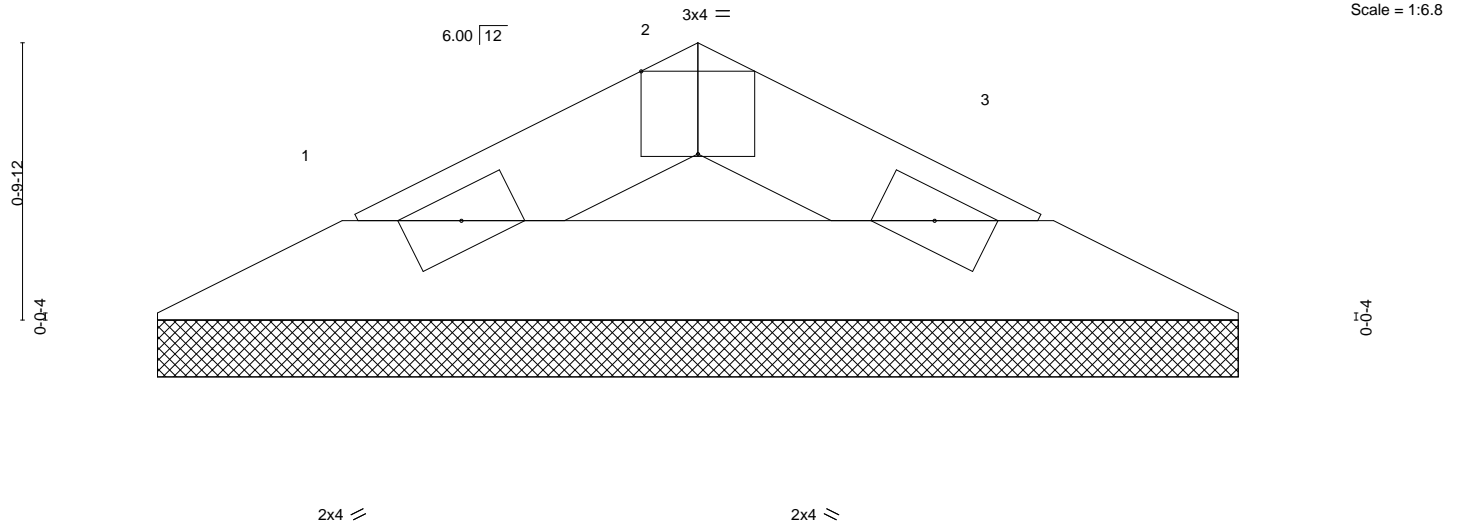


Plate Offsets (X,Y)-- [2:0-2:0,Edge]		3-2-9		3-3-1	
		3-2-9		0-0-8	
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	<b>PLATES GRIP</b>
TCLL 25.0	Plate Grip DOL	1.15	TC 0.03	in (loc) l/defl L/d	MT20 197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(LL) n/a - n/a 999	
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Vert(CT) n/a - n/a 999	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P	Horz(CT) 0.00 3 n/a n/a	
				Weight: 6 lb FT = 20%	

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-3-1 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=3-2-1, 3=3-2-1  
Max Horz 1=9(LC 12)  
Max Uplift 1=-15(LC 12), 3=-15(LC 13)  
Max Grav 1=90(LC 1), 3=90(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 15, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component


**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

# Symbols

## PLATE LOCATION AND ORIENTATION

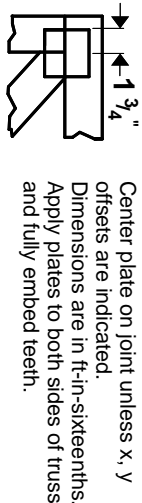

0-<sup>1</sup>/<sub>16</sub>"

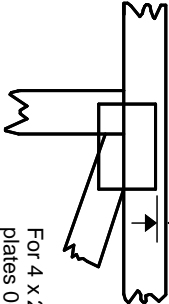

For 4 x 2 orientation, locate plates 0- <sup>1</sup>/<sub>16</sub>" from outside edge of truss.

—  
—  
This symbol indicates the required direction of slots in connector plates.

\* Plate location details available in **MiTek 20/20** software or upon request.

## PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

## BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

## Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-89: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

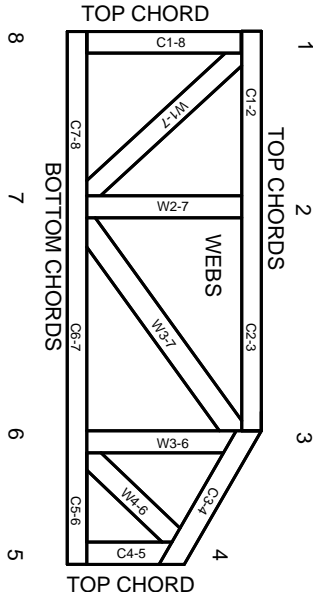

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

## PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988  
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MiTek® All Rights Reserved



MiTek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



# General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.