



RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
Development Services
LEE'S SUMMIT, MISSOURI

RE: 3008830
C&H/155 Cobey

MiTek USA, Inc.
16023 Swingley Ridge Rd
Chesterfield, MO 63017
314-434-1200

Site Information:

Customer: Project Name: 3008830
Lot/Block:
Address:
City:

Model:
Subdivision:
State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2018/TPI2014
Wind Code: ASCE 7-16
Roof Load: 45.0 psf

Design Program: MiTek 20/20 8.4
Wind Speed: 115 mph
Floor Load: N/A psf

This package includes 26 individual, dated Truss Design Drawings and 0 Additional Drawings.

| No. | Seal# | Truss Name | Date | No. | Seal# | Truss Name | Date |
|-----|-----------|------------|------------|-----|-----------|------------|------------|
| 1 | I49195018 | A1 | 12/10/2021 | 21 | I49195038 | E2 | 12/10/2021 |
| 2 | I49195019 | A2 | 12/10/2021 | 22 | I49195039 | V1 | 12/10/2021 |
| 3 | I49195020 | A2A | 12/10/2021 | 23 | I49195040 | V2 | 12/10/2021 |
| 4 | I49195021 | A3 | 12/10/2021 | 24 | I49195041 | V3 | 12/10/2021 |
| 5 | I49195022 | A3A | 12/10/2021 | 25 | I49195042 | V4 | 12/10/2021 |
| 6 | I49195023 | A3B | 12/10/2021 | 26 | I49195043 | V5 | 12/10/2021 |
| 7 | I49195024 | A4 | 12/10/2021 | | | | |
| 8 | I49195025 | A5 | 12/10/2021 | | | | |
| 9 | I49195026 | A6 | 12/10/2021 | | | | |
| 10 | I49195027 | B1 | 12/10/2021 | | | | |
| 11 | I49195028 | B2 | 12/10/2021 | | | | |
| 12 | I49195029 | B3 | 12/10/2021 | | | | |
| 13 | I49195030 | C1 | 12/10/2021 | | | | |
| 14 | I49195031 | D1 | 12/10/2021 | | | | |
| 15 | I49195032 | D2 | 12/10/2021 | | | | |
| 16 | I49195033 | D3 | 12/10/2021 | | | | |
| 17 | I49195034 | D4 | 12/10/2021 | | | | |
| 18 | I49195035 | D5 | 12/10/2021 | | | | |
| 19 | I49195036 | D6 | 12/10/2021 | | | | |
| 20 | I49195037 | E1 | 12/10/2021 | | | | |

The truss drawing(s) referenced above have been prepared by
MiTek USA, Inc. under my direct supervision
based on the parameters provided by Builders FirstSource (Valley Center).
Truss Design Engineer's Name: Johnson, Andrew
My license renewal date for the state of Missouri is December 31, 2021.
Missouri COA: 001193

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek. Any project specific information included is for MiTek customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



December 10, 2021

| | | | | | | |
|---------|-------|------------|-----|-----|---------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | |
| 3008830 | A1 | GABLE | 1 | 1 | | I49195018 |

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:17 2021 Page 1

ID:xKFGJ7evN?7xhJE66FFHnCzvA57-mNGRiGmgqTR0CEgiQ3IkMXErBngb4?9rviBzvDyAZBe

0-10-8 13-6-0 27-0-0 27-10-8
0-10-8 13-6-0 13-6-0 0-10-8

Scale = 1:47.1

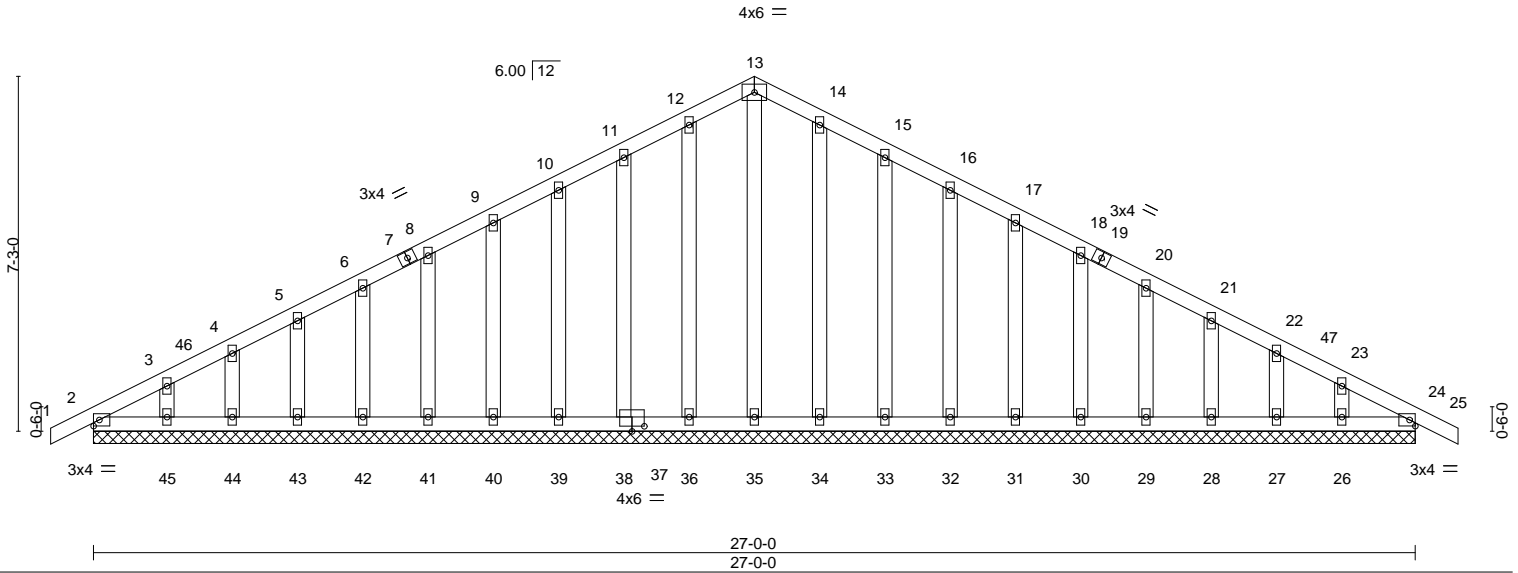


Plate Offsets (X,Y)-- [37:0-3-0,0-1-4]

| LOADING (psf) | SPACING- | | CSI. | DEFL. | in | (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-------|----------|----------|-------|-------|--------|-----|----------------|----------|
| TCLL 25.0 | Plate Grip DOL | 2-0-0 | TC 0.05 | Vert(LL) | -0.00 | 25 | n/r | 120 | MT20 | 197/144 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.02 | Vert(CT) | -0.00 | 25 | n/r | 120 | | |
| BCLL 0.0 | Rep Stress Incr | YES | WB 0.11 | Horz(CT) | 0.00 | 24 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2018/TPI2014 | | Matrix-S | | | | | | Weight: 145 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 27-0-0.

(lb) - Max Horz 2=114(LC 17)


Max Uplift All uplift 100 lb or less at joint(s) 2, 36, 38, 39, 40, 41, 42, 43, 44, 45, 34, 33, 24, 32, 31, 30, 29, 28, 27, 26

Max Grav All reactions 250 lb or less at joint(s) 2, 35, 36, 38, 39, 40, 41, 42, 43, 44, 45, 34, 33, 24, 32, 31, 30, 29, 28, 27, 26

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-10-8 to 2-1-8, Exterior(2N) 2-1-8 to 13-6-0, Corner(3R) 13-6-0 to 16-6-0, Exterior(2N) 16-6-0 to 27-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 36, 38, 39, 40, 41, 42, 43, 44, 45, 34, 33, 24, 32, 31, 30, 29, 28, 27, 26.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

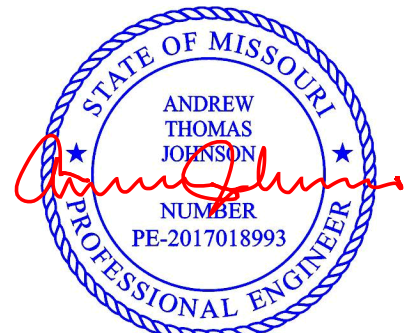

December 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

| | | | | | | |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | 149195019 |
| 3008830 | A2 | Common | 2 | 1 | Job Reference (optional) | |


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:19 2021 Page 1

ID:xKFGJ7evN?7xhJE66FFHnCzvA57-imOB7yowL5hkRXq5YUKCRyJ4EaCpYuj8Nbg4_6yAZBc

0-10-8 6-10-7 13-6-0 20-1-9 27-0-0 27-10-8
0-10-8 6-10-7 6-7-9 6-7-9 6-10-7 0-10-8

Scale = 1:47.4

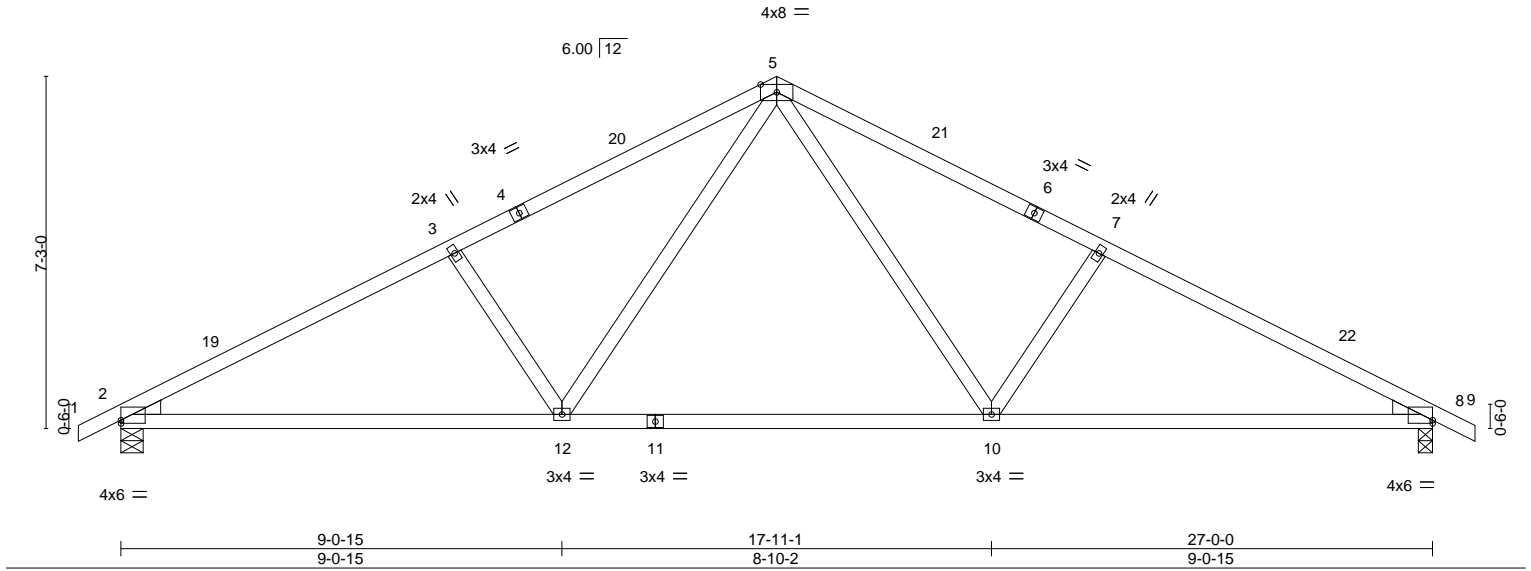

| LOADING (psf) | | SPACING- | | CSL | | DEFL. | | PLATES | | GRIP | |
|---------------|------|----------------------|------|-----------|------|----------|----------------------|---------------|--|----------|--|
| TCLL | 25.0 | Plate Grip DOL | 1.15 | TC | 0.46 | Vert(LL) | -0.12 12-15 >999 240 | MT20 | | 197/144 | |
| TCDL | 10.0 | Lumber DOL | 1.15 | BC | 0.68 | Vert(CT) | -0.27 12-15 >999 180 | | | | |
| BCLL | 0.0 | Rep Stress Incr | YES | WB | 0.17 | Horz(CT) | 0.06 8 n/a n/a | | | | |
| BCDL | 10.0 | Code IRC2018/TPI2014 | | Matrix-AS | | | | Weight: 97 lb | | FT = 20% | |

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
WEDGE
Left: 2x4 SP No.3 , Right: 2x4 SP No.3

REACTIONS.


(size) 2=0-5-8, 8=0-3-8
Max Horz 2=-114(LC 13)
Max Uplift 2=-169(LC 12), 8=-169(LC 13)
Max Grav 2=1276(LC 1), 8=1276(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2089/301, 3-5=-1838/321, 5-7=-1838/321, 7-8=-2089/301
BOT CHORD 2-12=-265/1781, 10-12=-74/1194, 8-10=-187/1781
WEBS 5-10=-135/679, 7-10=-462/220, 5-12=-135/679, 3-12=-462/220

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 13-6-0, Exterior(2R) 13-6-0 to 16-6-0, Interior(1) 16-6-0 to 27-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=169, 8=169.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

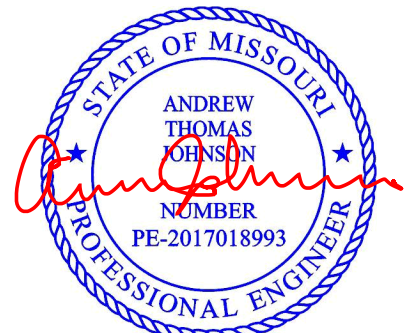

December 10,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

| | | | | | | |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | 149195021 |
| 3008830 | A3 | Common | 2 | 1 | Job Reference (optional) | |


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:21 2021 Page 1

ID:xKFGJ7evN?7xhJE66FFHnCzvA57-e8VxYepAtixShr_UfvMgWNOQnOtY0o3Rqv9B2_yAZBa

6-8-0 13-0-8 19-8-1 26-6-8 27-5-0
6-8-0 6-4-8 6-7-9 6-10-7 0-10-8

Scale = 1:46.4

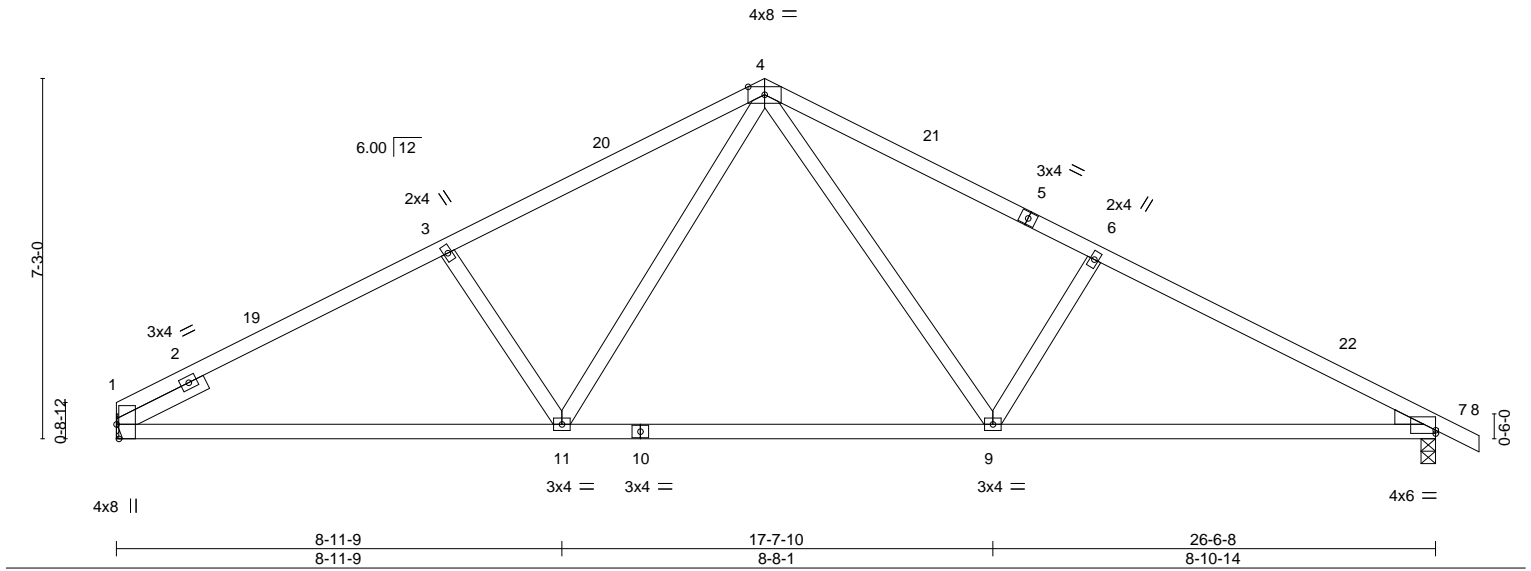

| LOADING (psf) | SPACING- | CSL | DEFL. | PLATES | GRIP |
|---------------|----------------------|-----------|------------------------------|---------------|----------|
| TCLL 25.0 | 2-0-0 | TC 0.46 | in (loc) l/defl L/d | MT20 | 197/144 |
| TCDL 10.0 | Plate Grip DOL 1.15 | BC 0.66 | Vert(LL) -0.11 9-18 >999 240 | | |
| BCLL 0.0 | Lumber DOL 1.15 | WB 0.18 | Vert(CT) -0.25 9-11 >999 180 | | |
| BCDL 10.0 | Rep Stress Incr YES | Matrix-AS | Horz(CT) 0.06 7 n/a n/a | | |
| | Code IRC2018/TPI2014 | | | Weight: 96 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
WEDGE
Right: 2x4 SP No.3
SLIDER Left 2x4 SPF No.2 2-0-0

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.

(size) 1=Mechanical, 7=0-3-8
Max Horz 1=-125(LC 13)
Max Uplift 1=-147(LC 12), 7=-168(LC 13)
Max Grav 1=1193(LC 1), 7=1257(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-3=-1901/296, 3-4=-1704/315, 4-6=-1814/325, 6-7=-2050/300
BOT CHORD 1-11=-241/1633, 9-11=-69/1156, 7-9=-188/1746
WEBS 3-11=-403/206, 4-11=-120/590, 4-9=-143/693, 6-9=-458/220

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 13-0-8, Exterior(2R) 13-0-8 to 16-0-8, Interior(1) 16-0-8 to 27-5-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=147, 7=168.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



December 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**
Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


| | | | | | | |
|---------|-------|--------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | 149195022 |
| 3008830 | A3A | Roof Special | 1 | 1 | Job Reference (optional) | |

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:22 2021 Page 1
ID:xKFGJ7evN?77xhJE66FFHnCzvA57-6L3KlZqoe03JI?ZgDctv3axb4oACI66a3ZvkbRyAZBZ

| | | | | | | | |
|-------|-------|--------|--------|--------|---------|--------|--------|
| 4-5-8 | 8-7-8 | 11-1-0 | 13-0-8 | 18-8-5 | 19-8-1 | 26-6-8 | 27-5-0 |
| 4-5-8 | 4-2-0 | 2-5-8 | 1-11-8 | 5-7-13 | 0-11-12 | 6-10-7 | 0-10-8 |

Scale = 1:47.5

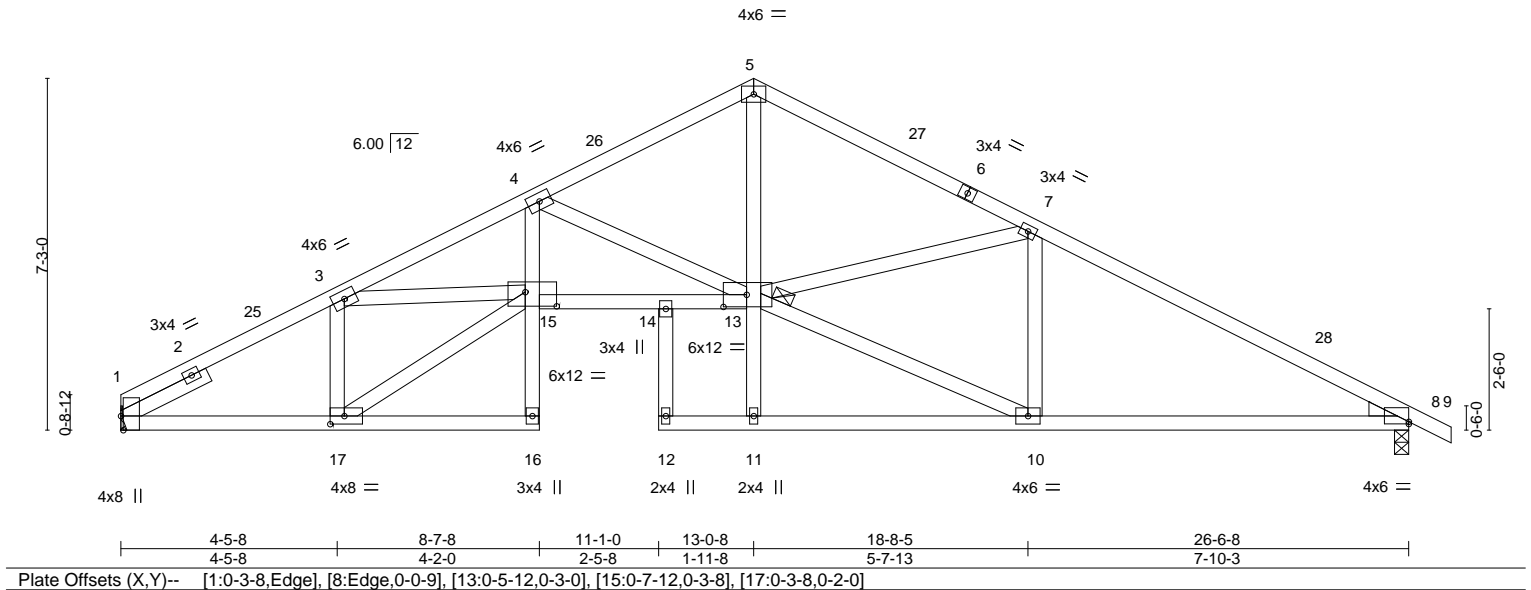

| LOADING (psf) | SPACING- | CSI. | DEFL. | PLATES | GRIP |
|---------------|----------------------|-----------|-------------------------------|----------------|----------|
| TCLL 25.0 | 2-0-0 | TC 0.49 | in (loc) l/defl L/d | MT20 | 197/144 |
| TCDL 10.0 | Plate Grip DOL 1.15 | BC 0.89 | Vert(LL) -0.21 14-15 >999 240 | | |
| BCLL 0.0 | Lumber DOL 1.15 | WB 0.76 | Vert(CT) -0.37 14-15 >858 180 | | |
| BCDL 10.0 | Rep Stress Incr YES | Matrix-AS | Horz(CT) 0.21 8 n/a n/a | | |
| | Code IRC2018/TPI2014 | | | Weight: 121 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
WEDGE
Right: 2x4 SP No.3
SLIDER Left 2x4 SPF No.2 2-0-0

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.
JOINTS 1 Brace at Jt(s): 13

REACTIONS.

(size) 1=Mechanical, 8=0-3-8
Max Horz 1=125(LC 13)
Max Uplift 1=147(LC 12), 8=168(LC 13)
Max Grav 1=1193(LC 1), 8=1257(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-3=-1919/279, 3-4=-3780/471, 4-5=-2088/299, 5-7=-2065/286, 7-8=-2020/286
BOT CHORD 1-17=-253/1653, 4-15=-141/1219, 14-15=-390/3369, 13-14=-382/3322, 8-10=-165/1705
WEBS 4-13=-1735/332, 5-13=-138/1442, 7-10=-538/118, 10-13=-172/1787, 3-17=-1024/197,
15-17=-292/1884, 3-15=-133/1691

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 13-0-8, Exterior(2R) 13-0-8 to 16-0-8, Interior(1) 16-0-8 to 27-5-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=147, 8=168.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



December 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

| | | | | | | |
|---------|-------|--------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | 149195023 |
| 3008830 | A3B | Roof Special | 2 | 1 | Job Reference (optional) | |


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:23 2021 Page 1

ID:xKFGJ7evN?7xhJE66FFHnCzvA57-bXdzJrQPJBaW98snKP8coUknBWkUaFkHDeI7tyAZBY

| | | | | | | |
|-------|--------|--------|--------|--------|--------|--------|
| 6-8-0 | 13-0-8 | 15-0-8 | 17-1-8 | 21-8-9 | 26-6-8 | 27-5-0 |
| 6-8-0 | 6-4-8 | 2-0-0 | 2-1-0 | 4-7-1 | 4-9-15 | 0-10-8 |

Scale = 1:47.5

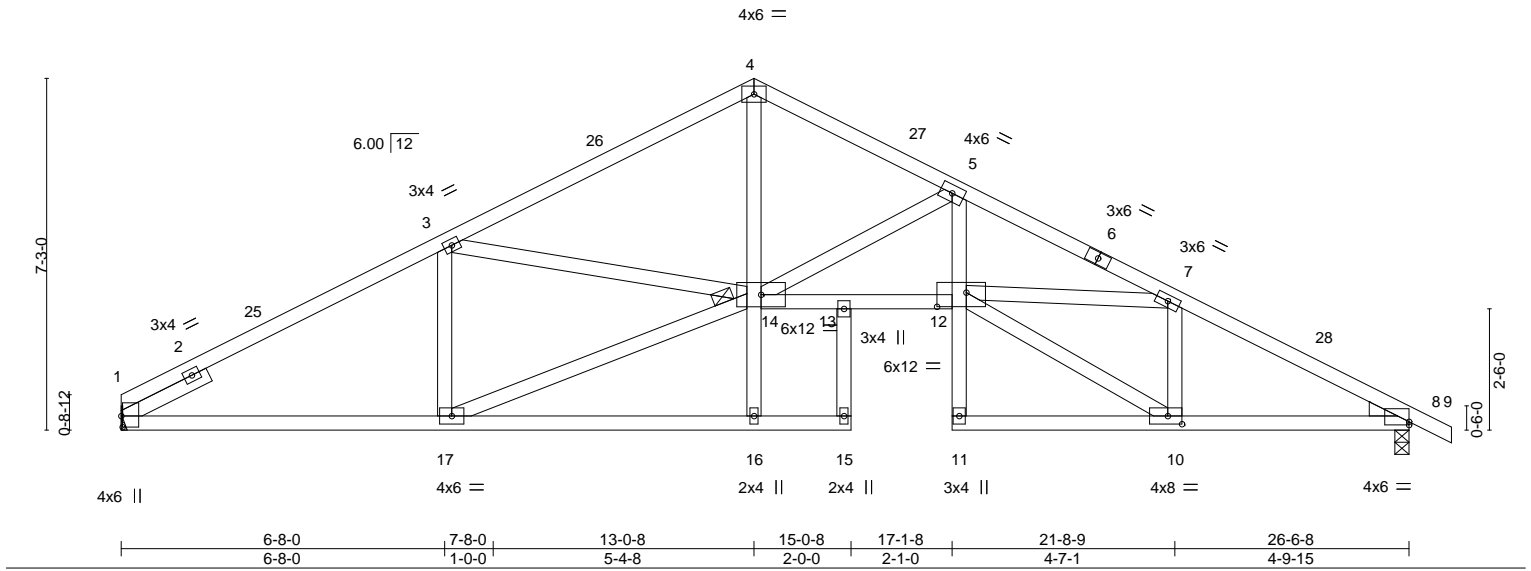

| LOADING (psf) | | SPACING- | | CSI. | | DEFL. | | PLATES | | GRIP | |
|---------------|------|----------------------|------|-----------|------|----------|----------------------|----------------|--|----------|--|
| TCLL | 25.0 | Plate Grip DOL | 1.15 | TC | 0.56 | Vert(LL) | -0.20 12 >999 240 | MT20 | | 197/144 | |
| TCDL | 10.0 | Lumber DOL | 1.15 | BC | 0.87 | Vert(CT) | -0.37 12-13 >867 180 | | | | |
| BCLL | 0.0 | Rep Stress Incr | YES | WB | 0.64 | Horz(CT) | 0.21 8 n/a n/a | | | | |
| BCDL | 10.0 | Code IRC2018/TPI2014 | | Matrix-AS | | | | | | | |
| | | | | | | | | Weight: 123 lb | | FT = 20% | |

LUMBER-

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2
 WEDGE
 Right: 2x4 SP No.3
 SLIDER Left 2x4 SPF No.2 2-0-0

REACTIONS.


(size) 1=Mechanical, 8=0-3-8
 Max Horz 1=125(LC 13)
 Max Uplift 1=147(LC 12), 8=168(LC 13)
 Max Grav 1=1193(LC 1), 8=1257(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-3=-1918/286, 3-4=-2082/289, 4-5=-2094/296, 5-7=-3653/438, 7-8=-2125/287
 BOT CHORD 1-17=-232/1645, 13-14=-257/3163, 12-13=-265/3211, 5-12=-91/1205, 8-10=-191/1826
 WEBS 5-14=-1595/235, 4-14=-133/1409, 7-10=-984/153, 10-12=-216/2032, 7-12=-74/1377,
 3-17=-500/134, 14-17=-242/1695, 3-14=-82/270

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 13-0-8, Exterior(2R) 13-0-8 to 16-0-8, Interior(1) 16-0-8 to 27-5-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=147, 8=168.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

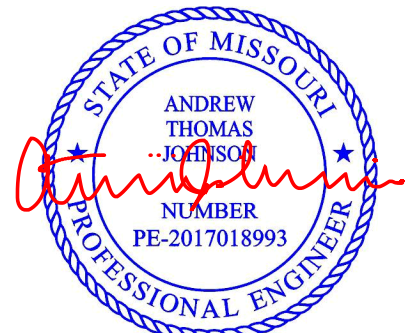

December 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

| | | | | | | |
|---------|-------|--------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | 149195024 |
| 3008830 | A4 | Roof Special | 4 | 1 | Job Reference (optional) | |


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:24 2021 Page 1

ID:xKFGJ7evN?77xhJE66FFHnCzvA57-3jB4Afs3AdJOYJj3K1wN8?0vvbsiD4MtWtOrfJyAZBX

0-10-8 6-10-7 7-11-15 13-6-0 15-9-0 20-2-12 23-4-5 24-8-8 27-0-0 27-10-8
0-10-8 6-10-7 1-1-8 5-6-1 2-3-0 4-5-12 3-1-9 1-4-3 2-3-8 0-10-8

Scale = 1:53.6

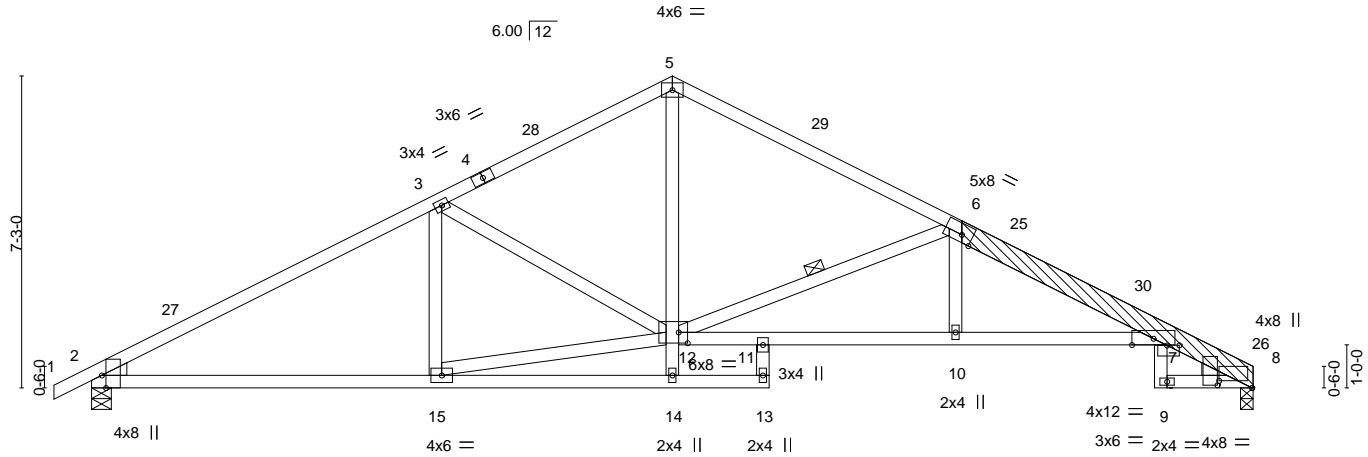

| | |
|-----------------------|---|
| Plate Offsets (X,Y)-- | [2:0-3-8,Edge], [6:0-3-0,Edge], [7:0-3-7,0-0-1], [8:0-9-3-0,2-0], [8:0-0-12,0-9-11], [12:0-2-8,0-3-0] |
|-----------------------|---|

| LOADING (psf) | SPACING- | CSL | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-----------|----------------|----------|--------|-----|----------------|----------|
| TCLL 25.0 | Plate Grip DOL 1.15 | TC 0.53 | Vert(LL) -0.19 | 10-21 | >999 | 240 | MT20 | 197/144 |
| TCDL 10.0 | Lumber DOL 1.15 | BC 0.89 | Vert(CT) -0.36 | 10-11 | >907 | 180 | | |
| BCLL 0.0 | Rep Stress Incr YES | WB 0.40 | Horz(CT) 0.20 | 8 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2018/TPI2014 | Matrix-AS | | | | | Weight: 135 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SPF No.2 *Except*
6-8: 2x6 SP 2400F 2.0E
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x6 SP 2400F 2.0E
LBR SCAB 6-8 2x6 SP 2400F 2.0E one side
WEDGE
Left: 2x4 SPF No.2, Right: 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 6-12

REACTIONS.

(size) 2=0-5-8, 8=0-3-8
Max Horz 2=120(LC 16)
Max Uplift 2=169(LC 12), 8=152(LC 13)
Max Grav 2=1276(LC 1), 8=1212(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2025/287, 3-5=-1634/277, 5-6=-1687/277, 6-7=-2714/374, 7-8=-485/91
BOT CHORD 2-15=-234/1719, 11-12=-229/2467, 10-11=-272/2551, 7-10=-274/2540
WEBS 5-12=-110/1018, 12-15=-199/1615, 3-12=-483/189, 6-10=0/268, 6-12=-1233/287

NOTES-

- Attached 7-9-8 scab 6 to 8, front face(s) 2x6 SP 2400F 2.0E with 2 row(s) of 10d (0.131"x3") nails spaced 9" o.c. except : starting at 0-0-8 from end at joint 6, nail 2 row(s) at 7" o.c. for 2-0-0; starting at 3-2-3 from end at joint 6, nail 2 row(s) at 4" o.c. for 4-4-5.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 13-6-0, Exterior(2R) 13-6-0 to 16-6-0, Interior(1) 16-6-0 to 26-11-11 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (it=lb) 2=169, 8=152.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



December 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


| | | | | | | |
|---------|-------|--------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | 149195025 |
| 3008830 | A5 | Roof Special | 5 | 1 | Job Reference (optional) | |

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:25 2021 Page 1
ID:xKFGJ7evN?7xhJE66FFHnCzvA57-XwiSO?shxxSt9SIFulRchDZzQ?DlyT11X7OBmyAZBW

| | | | | | |
|--------|---------|--------|--------|--------|--------|
| 3-2-10 | 5-2-8 | 13-0-8 | 19-8-1 | 26-6-8 | 27-5-0 |
| 3-2-10 | 1-11-14 | 7-10-0 | 6-7-9 | 6-10-7 | 0-10-8 |

Scale = 1:48.7

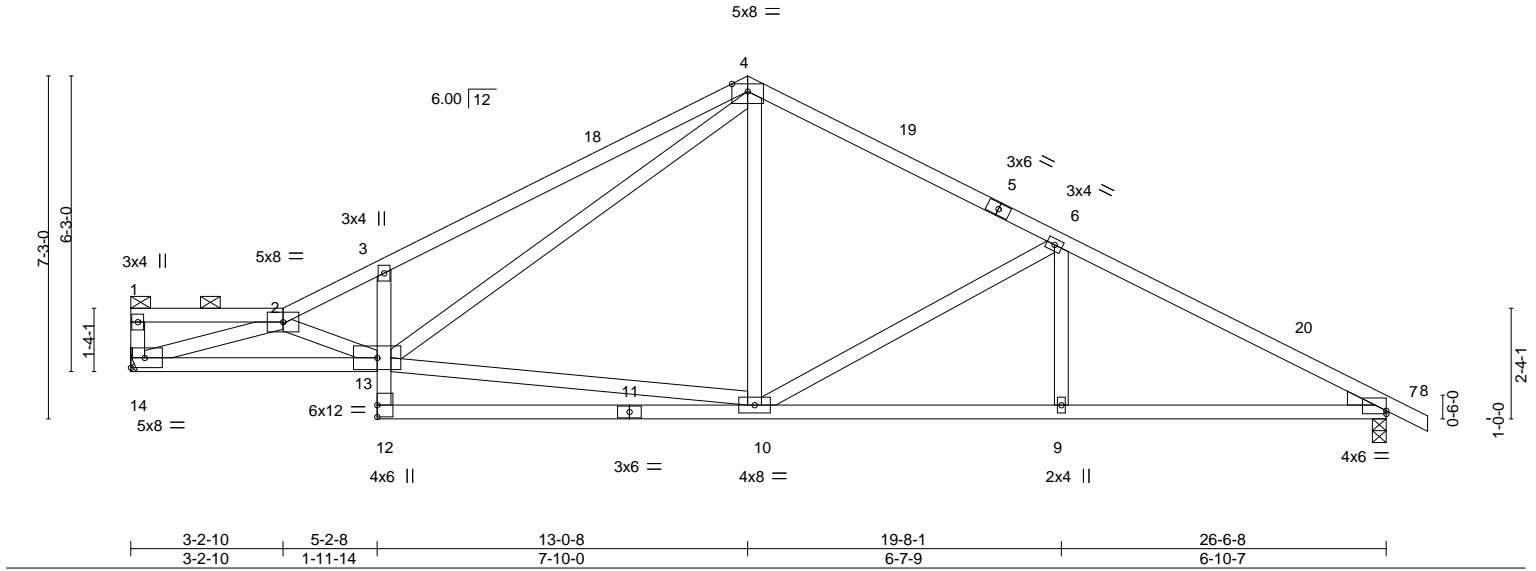

| LOADING (psf) | | SPACING- | | CSI. | | DEFL. | | PLATES | | GRIP | |
|---------------|------|----------------------|------|-----------|------|----------|----------------------|----------------|--|----------|--|
| TCLL | 25.0 | Plate Grip DOL | 1.15 | TC | 0.99 | Vert(LL) | -0.16 13 >999 240 | MT20 | | 197/144 | |
| TCDL | 10.0 | Lumber DOL | 1.15 | BC | 0.80 | Vert(CT) | -0.33 10-12 >960 180 | | | | |
| BCLL | 0.0 | Rep Stress Incr | YES | WB | 0.64 | Horz(CT) | 0.07 7 n/a n/a | | | | |
| BCDL | 10.0 | Code IRC2018/TPI2014 | | Matrix-AS | | | | | | | |
| | | | | | | | | Weight: 115 lb | | FT = 20% | |

| | | | |
|--------------------|--------------|-----------------|---|
| LUMBER- | | BRACING- | |
| TOP CHORD | 2x4 SPF No.2 | TOP CHORD | Structural wood sheathing directly applied, except end verticals, and |
| BOT CHORD | 2x4 SPF No.2 | | 2-0-0 oc purlins (6-0-0 max.): 1-2. |
| WEBS | 2x4 SPF No.2 | BOT CHORD | Rigid ceiling directly applied. |
| WEDGE | | | |
| Right: 2x4 SP No.3 | | | |

REACTIONS. (size) 14=Mechanical, 7=0-3-8
Max Horz 14=-140(LC 13)
Max Uplift 14=-150(LC 12), 7=-172(LC 13)
Max Grav 14=1187(LC 1), 7=1250(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2681/367, 3-4=-2788/515, 4-6=-1436/270, 6-7=-2048/290
BOT CHORD 13-14=-384/2912, 3-13=-511/247, 10-12=-2/317, 9-10=-177/1741, 7-9=-177/1741
WEBS 2-14=-2889/416, 10-13=-53/865, 4-13=-370/1525, 4-10=-45/445, 6-10=-673/216, 2-13=-530/85

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-2-10, Interior(1) 3-2-10 to 13-0-8, Exterior(2R) 13-0-8 to 16-0-8, Interior(1) 16-0-8 to 27-5-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 14=150, 7=172.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

| | | | | | | |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | 149195026 |
| 3008830 | A6 | GABLE | 1 | 1 | Job Reference (optional) | |

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:27 2021 Page 1

ID:xKFGJ7evN?7xhJE66FFHnCzvA57-TltdPhuxTYibPmRe0AT4meeYep4eQWXXKCrcVgeyAZBU

13-0-8 13-0-8 26-6-8 27-5-0 6-10-8 13-6-0 6-10-8

Scale: 1/4"=1'

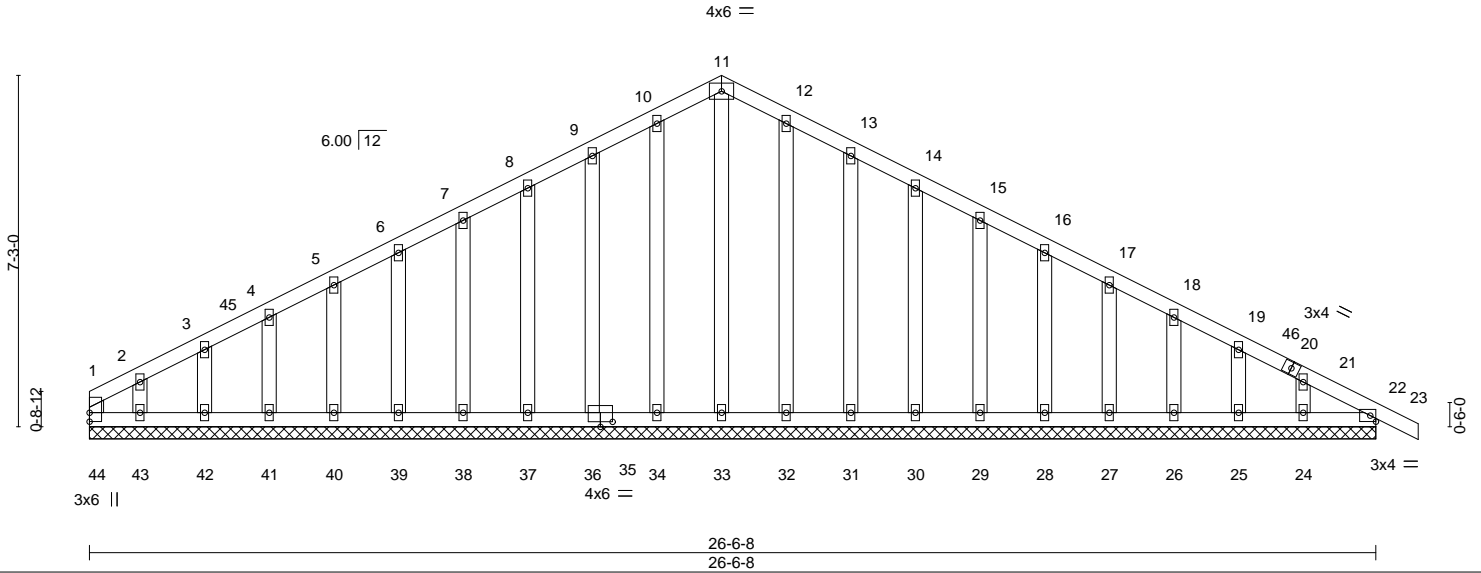


Plate Offsets (X,Y)-- [35:0-3-0,0-1-4]

| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in | (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-------|----------|----------|-------|-------|--------|-----|----------------|----------|
| TCLL 25.0 | Plate Grip DOL | 1.15 | TC 0.05 | Vert(LL) | -0.00 | 23 | n/r | 120 | MT20 | 197/144 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.04 | Vert(CT) | -0.00 | 23 | n/r | 120 | | |
| BCLL 0.0 | Rep Stress Incr | YES | WB 0.11 | Horz(CT) | 0.00 | 22 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2018/TPI2014 | | Matrix-S | | | | | | Weight: 143 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 26-6-8.
(lb) - Max Horz 44=-119(LC 13)
Max Uplift All uplift 100 lb or less at joint(s) 44, 34, 36, 37, 38, 39, 40, 41, 42, 32, 31, 22, 30, 29, 28, 27, 26, 25, 24 except 43=-109(LC 12)
Max Grav All reactions 250 lb or less at joint(s) 44, 33, 34, 36, 37, 38, 39, 40, 41, 42, 43, 32, 31, 22, 30, 29, 28, 27, 26, 25, 24

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-1-12 to 3-1-12, Exterior(2N) 3-1-12 to 13-0-8, Corner(3R) 13-0-8 to 16-0-8, Exterior(2N) 16-0-8 to 27-5-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 44, 34, 36, 37, 38, 39, 40, 41, 42, 32, 31, 22, 30, 29, 28, 27, 26, 25, 24 except (jt=lb) 43=109.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

| | | | | | | |
|---------|-------|---------------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | I49195027 |
| 3008830 | B1 | ROOF SPECIAL GIRDER | 1 | 2 | Job Reference (optional) | |

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:29 2021 Page 1

ID:xKFGJ7evN?7xhJE66FFHnCzvA57-Ph_zENwB?9yJe4b07aVYr3koxceYuEKcg95cKXyAZBS



Scale = 1:61.0

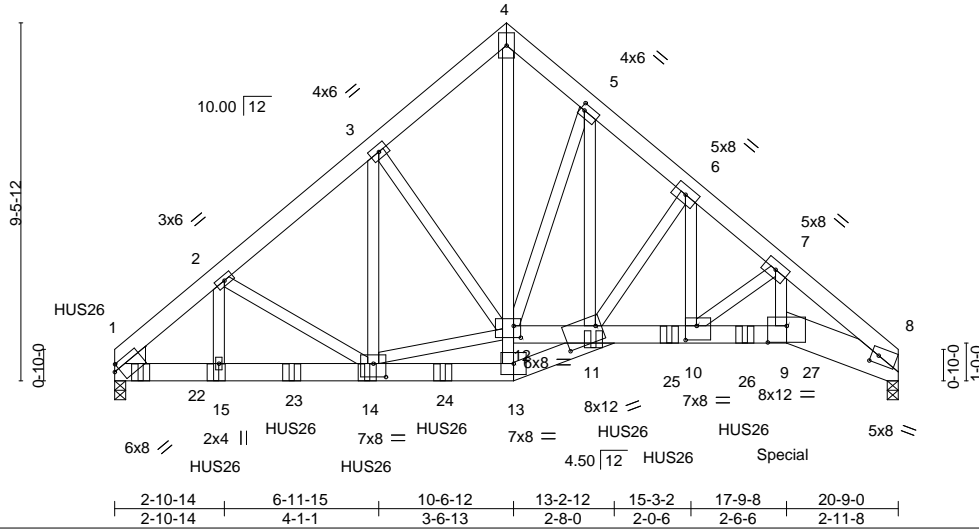


Plate Offsets (X,Y)-- [1:0-1-10,0-1-14], [5:0-1-4,0-2-0], [8:0-2-4,0-2-8], [9:0-6-0,0-5-4], [10:0-3-8,0-4-8], [11:0-10-4,0-4-12], [12:0-2-4,0-3-12], [14:0-4-0,0-4-4]

| LOADING (psf) | SPACING- | CSL | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-----------|----------|-------------|--------|-----|----------------|----------|
| TCLL 25.0 | Plate Grip DOL 1.15 | TC 0.38 | Vert(LL) | -0.10 10-11 | >999 | 240 | MT20 | 197/144 |
| TCDL 10.0 | Lumber DOL 1.15 | BC 0.53 | Vert(CT) | -0.20 10-11 | >999 | 180 | | |
| BCLL 0.0 | Rep Stress Incr NO | WB 0.86 | Horz(CT) | -0.10 1 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2018/TPI2014 | Matrix-MS | | | | | Weight: 354 lb | FT = 20% |

LUMBER-

TOP CHORD 2x6 SPF No.2 *Except*
4-8: 2x6 SP 2400F 2.0E
BOT CHORD 2x6 SP 2400F 2.0E *Except*
9-12: 2x6 SPF 2100F 1.8E, 8-9: 2x10 SP 2400F 2.0E
WEBS 2x4 SPF No.2
WEDGE
Left: 2x6 SP No.2

REACTIONS. (size) 1=0-3-8, 8=0-3-8
Max Horz 8=203(LC 5)
Max Uplift 1=262(LC 8), 8=140(LC 9)
Max Grav 1=7207(LC 1), 8=6397(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-8586/217, 2-3=-7287/14, 3-4=-5689/0, 4-5=-5687/0, 5-6=-7390/0, 6-7=-9443/25,
7-8=-12280/243
BOT CHORD 1-15=-127/6411, 14-15=-127/6411, 13-14=0/2044, 11-13=0/2114, 11-12=-220/3524,
10-11=-217/356, 9-10=-238/8965, 8-9=-303/9692
WEBS 3-14=-394/2374, 12-13=-328/0, 4-12=0/6672, 5-11=-228/4312, 12-14=-335/3570,
3-12=-1918/467, 5-12=-3179/314, 2-14=-1041/329, 2-15=-263/1403, 6-10=-375/3475,
6-11=-3204/382, 7-9=-260/3336, 7-10=-2054/278

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-2-0 oc, 2x10 - 2 rows staggered at 0-8-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=262, 8=140.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 10, 2021

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

| | | | | | | |
|---------|-------|---------------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | I49195027 |
| 3008830 | B1 | ROOF SPECIAL GIRDER | 1 | 2 | Job Reference (optional) | |

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:29 2021 Page 2
ID: xKFGJ7evN?7xhJE66FFHnCzvA57-Ph_zENwB?9yJe4b07aVYr3koxceYuEKcg95cKXyAZBS

NOTES-

- 9) Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- 10) Use Simpson Strong-Tie HUS26 (14-10d Girder, 4-10d Truss) or equivalent spaced at 2-0-0 oc max. starting at 0-8-4 from the left end to 8-8-4 to connect truss(es) to front face of bottom chord.
- 11) Use Simpson Strong-Tie HUS26 (14-10d Girder, 4-10d Truss) or equivalent spaced at 2-0-0 oc max. starting at 12-8-4 from the left end to 16-8-4 to connect truss(es) to front face of bottom chord.
- 12) Fill all nail holes where hanger is in contact with lumber.
- 13) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1167 lb down and 170 lb up at 18-8-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-70, 4-8=-70, 13-16=-20, 11-13=-20, 9-11=-20, 9-19=-20
Concentrated Loads (lb)
Vert: 12=-1200(F) 14=-1173(F) 11=-1167(F) 15=-1173(F) 22=-1176(F) 23=-1173(F) 24=-1173(F) 25=-1167(F) 26=-1167(F) 27=-1167(F)
- 2) Dead + 0.75 Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-58, 4-8=-58, 13-16=-20, 11-13=-20, 9-11=-20, 9-19=-20
Concentrated Loads (lb)
Vert: 12=-1200(F) 14=-1008(F) 11=-1002(F) 15=-1008(F) 22=-1011(F) 23=-1008(F) 24=-1008(F) 25=-1002(F) 26=-1002(F) 27=-1002(F)
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-20, 4-8=-20, 13-16=-40, 11-13=-40, 9-11=-40, 9-19=-40
Concentrated Loads (lb)
Vert: 12=-1200(F) 14=-756(F) 11=-752(F) 15=-756(F) 22=-762(F) 23=-756(F) 24=-756(F) 25=-752(F) 26=-752(F) 27=-752(F)
- 4) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-4=-15, 4-8=9, 13-16=-8, 11-13=-8, 9-11=-8, 9-19=-8
Horz: 1-4=3, 4-8=21
Concentrated Loads (lb)
Vert: 12=-1200(F) 14=155(F) 11=158(F) 15=155(F) 22=154(F) 23=155(F) 24=155(F) 25=158(F) 26=158(F) 27=158(F)
- 5) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-4=9, 4-8=-15, 13-16=-8, 11-13=-8, 9-11=-8, 9-19=-8
Horz: 1-4=-21, 4-8=-3
Concentrated Loads (lb)
Vert: 12=-1200(F) 14=155(F) 11=158(F) 15=155(F) 22=154(F) 23=155(F) 24=155(F) 25=158(F) 26=158(F) 27=158(F)
- 6) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-4=-33, 4-8=-10, 13-16=-20, 11-13=-20, 9-11=-20, 9-19=-20
Horz: 1-4=13, 4-8=10
Concentrated Loads (lb)
Vert: 12=-1200(F) 14=167(F) 11=170(F) 15=167(F) 22=164(F) 23=167(F) 24=167(F) 25=170(F) 26=170(F) 27=170(F)
- 7) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-4=-10, 4-8=-33, 13-16=-20, 11-13=-20, 9-11=-20, 9-19=-20
Horz: 1-4=-10, 4-8=-13
Concentrated Loads (lb)
Vert: 12=-1200(F) 14=167(F) 11=170(F) 15=167(F) 22=164(F) 23=167(F) 24=167(F) 25=170(F) 26=170(F) 27=170(F)
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-4=25, 4-8=9, 13-16=-8, 11-13=-8, 9-11=-8, 9-19=-8
Horz: 1-4=-37, 4-8=21
Concentrated Loads (lb)
Vert: 12=-1200(F) 14=155(F) 11=158(F) 15=155(F) 22=154(F) 23=155(F) 24=155(F) 25=158(F) 26=158(F) 27=158(F)
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-4=9, 4-8=25, 13-16=-8, 11-13=-8, 9-11=-8, 9-19=-8
Horz: 1-4=-21, 4-8=37
Concentrated Loads (lb)
Vert: 12=-1200(F) 14=155(F) 11=158(F) 15=155(F) 22=154(F) 23=155(F) 24=155(F) 25=158(F) 26=158(F) 27=158(F)
- 10) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-4=14, 4-8=4, 13-16=-8, 11-13=-8, 9-11=-8, 9-19=-8
Horz: 1-4=-26, 4-8=16
Concentrated Loads (lb)
Vert: 12=-1200(F) 14=155(F) 11=158(F) 15=155(F) 22=154(F) 23=155(F) 24=155(F) 25=158(F) 26=158(F) 27=158(F)
- 11) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-4=4, 4-8=14, 13-16=-8, 11-13=-8, 9-11=-8, 9-19=-8
Horz: 1-4=-16, 4-8=26
Concentrated Loads (lb)
Vert: 12=-1200(F) 14=155(F) 11=158(F) 15=155(F) 22=154(F) 23=155(F) 24=155(F) 25=158(F) 26=158(F) 27=158(F)
- 12) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60

Continued on page 3

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

| | | | | | | |
|---------|-------|---------------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | I49195027 |
| 3008830 | B1 | ROOF SPECIAL GIRDER | 1 | 2 | Job Reference (optional) | |

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:29 2021 Page 3
ID:xKFGJ7evN?7xhJE66FFHnCzvA57-Ph_zENwB?9yJe4b07aVYr3koxceYuEKcg95cKXyAZBS

LOAD CASE(S) Standard

- Uniform Loads (plf)
Vert: 1-4=6, 4-8=-10, 13-16=-20, 11-13=-20, 9-11=-20, 9-19=-20
Horz: 1-4=-26, 4-8=10
- Concentrated Loads (lb)
Vert: 12=-1200(F) 14=167(F) 11=170(F) 15=167(F) 22=164(F) 23=167(F) 24=167(F) 25=170(F) 26=170(F) 27=170(F)
- 13) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-4=-10, 4-8=6, 13-16=-20, 11-13=-20, 9-11=-20, 9-19=-20
Horz: 1-4=-10, 4-8=26
- Concentrated Loads (lb)
Vert: 12=-1200(F) 14=167(F) 11=170(F) 15=167(F) 22=164(F) 23=167(F) 24=167(F) 25=170(F) 26=170(F) 27=170(F)
- 14) Dead: Lumber Increase=0.90, Plate Increase=0.90 Plt. metal=0.90
Uniform Loads (plf)
Vert: 1-4=-20, 4-8=-20, 13-16=-20, 11-13=-20, 9-11=-20, 9-19=-20
- Concentrated Loads (lb)
Vert: 12=-1200(F) 14=-511(F) 11=-508(F) 15=-511(F) 22=-514(F) 23=-511(F) 24=-511(F) 25=-508(F) 26=-508(F) 27=-508(F)
- 15) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-4=-67, 4-8=-50, 13-16=-20, 11-13=-20, 9-11=-20, 9-19=-20
Horz: 1-4=10, 4-8=8
- Concentrated Loads (lb)
Vert: 12=-1200(F) 14=63(F) 11=65(F) 15=63(F) 22=59(F) 23=63(F) 24=63(F) 25=65(F) 26=65(F) 27=65(F)
- 16) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-4=-50, 4-8=-67, 13-16=-20, 11-13=-20, 9-11=-20, 9-19=-20
Horz: 1-4=-8, 4-8=-10
- Concentrated Loads (lb)
Vert: 12=-1200(F) 14=63(F) 11=65(F) 15=63(F) 22=59(F) 23=63(F) 24=63(F) 25=65(F) 26=65(F) 27=65(F)
- 17) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-4=-38, 4-8=-50, 13-16=-20, 11-13=-20, 9-11=-20, 9-19=-20
Horz: 1-4=-20, 4-8=8
- Concentrated Loads (lb)
Vert: 12=-1200(F) 14=63(F) 11=65(F) 15=63(F) 22=59(F) 23=63(F) 24=63(F) 25=65(F) 26=65(F) 27=65(F)
- 18) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-4=-50, 4-8=-38, 13-16=-20, 11-13=-20, 9-11=-20, 9-19=-20
Horz: 1-4=-8, 4-8=20
- Concentrated Loads (lb)
Vert: 12=-1200(F) 14=63(F) 11=65(F) 15=63(F) 22=59(F) 23=63(F) 24=63(F) 25=65(F) 26=65(F) 27=65(F)
- 19) Dead + 0.6 MWFRS Wind Min. Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-4=-17, 4-8=-12, 13-16=-8, 11-13=-8, 9-11=-8, 9-19=-8
Horz: 1-4=5
- Concentrated Loads (lb)
Vert: 12=-1200(F) 14=85(F) 11=88(F) 15=85(F) 22=84(F) 23=85(F) 24=85(F) 25=88(F) 26=88(F) 27=88(F)
- 20) Dead + 0.6 MWFRS Wind Min. Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-4=-12, 4-8=-17, 13-16=-8, 11-13=-8, 9-11=-8, 9-19=-8
Horz: 4-8=-5
- Concentrated Loads (lb)
Vert: 12=-1200(F) 14=85(F) 11=88(F) 15=85(F) 22=84(F) 23=85(F) 24=85(F) 25=88(F) 26=88(F) 27=88(F)
- 21) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-70, 4-8=-20, 13-16=-20, 11-13=-20, 9-11=-20, 9-19=-20
- Concentrated Loads (lb)
Vert: 12=-1200(F) 14=-1173(F) 11=-1167(F) 15=-1173(F) 22=-1176(F) 23=-1173(F) 24=-1173(F) 25=-1167(F) 26=-1167(F) 27=-1167(F)
- 22) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-20, 4-8=-70, 13-16=-20, 11-13=-20, 9-11=-20, 9-19=-20
- Concentrated Loads (lb)
Vert: 12=-1200(F) 14=-1173(F) 11=-1167(F) 15=-1173(F) 22=-1176(F) 23=-1173(F) 24=-1173(F) 25=-1167(F) 26=-1167(F) 27=-1167(F)
- 23) 3rd Dead + 0.75 Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-58, 4-8=-20, 13-16=-20, 11-13=-20, 9-11=-20, 9-19=-20
- Concentrated Loads (lb)
Vert: 12=-1200(F) 14=-1008(F) 11=-1002(F) 15=-1008(F) 22=-1011(F) 23=-1008(F) 24=-1008(F) 25=-1002(F) 26=-1002(F) 27=-1002(F)
- 24) 4th Dead + 0.75 Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-20, 4-8=-58, 13-16=-20, 11-13=-20, 9-11=-20, 9-19=-20

Continued on page 4

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

| | | | | | |
|---------|-------|---------------------|-----|-----|---------------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey |
| 3008830 | B1 | ROOF SPECIAL GIRDER | 1 | 2 | I49195027 |

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:29 2021 Page 4
ID:xKFGJ7evN?7xhJE66FFHnCzvA57-Ph_zENwB?9yJe4b07aVYr3koxceYuEKcg95cKXyAZBS

LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 12=-1200(F) 14=-1008(F) 11=-1002(F) 15=-1008(F) 22=-1011(F) 23=-1008(F) 24=-1008(F) 25=-1002(F) 26=-1002(F) 27=-1002(F)

| | | | | | | |
|---------|-------|--------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | 149195028 |
| 3008830 | B2 | ROOF SPECIAL | 3 | 1 | Job Reference (optional) | |

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:30 2021 Page 1

ID:xKFGJ7evN?7xhJE66FFHnCzvA57-ttYLRiwpMT4AGEADh1nOGGvM0v3dqJmupr9tzyAZBR

0-10-8 5-4-0 10-4-8 13-2-12 17-9-8 20-9-0 21-7-8
0-10-8 5-4-0 5-0-8 2-10-4 4-6-12 2-11-8 0-10-8

4x8

Scale = 1:58.6

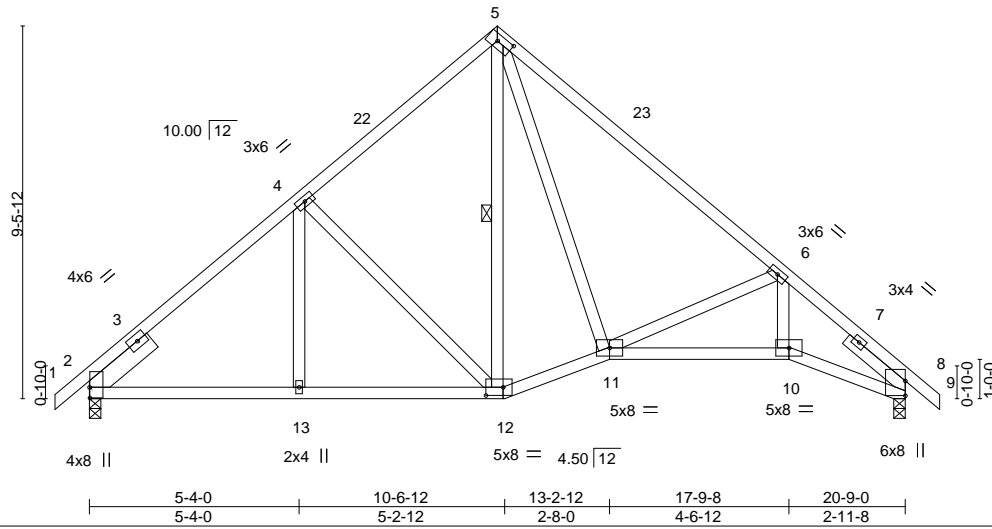


Plate Offsets (X,Y)-- [2:0-3-4,0-0-2], [5:0-4-13,0-2-0], [12:0-5-4,0-2-8]

| LOADING (psf) | SPACING- | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-----------|----------------|----------|--------|-----|----------------|----------|
| TCLL 25.0 | Plate Grip DOL 1.15 | TC 0.66 | Vert(LL) -0.07 | 10-11 | >999 | 240 | MT20 | 197/144 |
| TCDL 10.0 | Lumber DOL 1.15 | BC 0.89 | Vert(CT) -0.14 | 10-11 | >999 | 180 | | |
| BCLL 0.0 | Rep Stress Incr YES | WB 0.30 | Horz(CT) 0.09 | 8 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2018/TPI2014 | Matrix-AS | | | | | | |
| | | | | | | | Weight: 104 lb | FT = 20% |

LUMBER-
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
SLIDER Left 2x6 SPF No.2 2-0-0, Right 2x4 SPF No.2 2-0-0

BRACING-
TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 5-12

REACTIONS. (size) 2=0-3-8, 8=0-3-8
Max Horz 2=220(LC 10)
Max Uplift 2=113(LC 12), 8=113(LC 13)
Max Grav 2=995(LC 1), 8=995(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=1093/155, 4-5=813/202, 5-6=1114/196, 6-8=1672/185
BOT CHORD 2-13=133/812, 12-13=133/812, 11-12=0/604, 10-11=101/1208, 8-10=100/1276
WEBS 4-12=354/193, 6-11=543/252, 6-10=0/365, 5-11=32/557

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 10-4-8, Exterior(2R) 10-4-8 to 13-4-8, Interior(1) 13-4-8 to 21-7-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=113, 8=113.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



December 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

| | | | | | | |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | 149195029 |
| 3008830 | B3 | GABLE | 1 | 1 | Job Reference (optional) | |

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:31 2021 Page 1

ID: xKFGJ7evN?7xhJE66FFHnCzvA57-M46je2xSXnC1tNIPF?Y0wUp6MQNvMGev7TajPPyAZBQ

0-10-8 5-4-0 10-4-8 13-2-12 17-9-8 20-9-0 21-7-8
0-10-8 5-4-0 5-0-8 2-10-4 4-6-12 2-11-8 0-10-8

4x8

Scale = 1:58.7

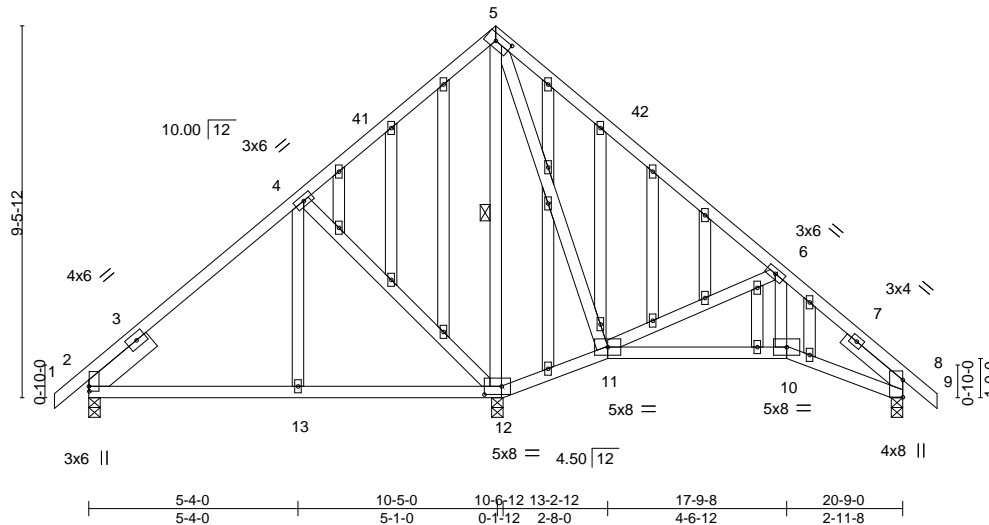


Plate Offsets (X,Y)-- [2:0-1-8,0-0-2], [5:0-4-13,0-2-0], [12:0-5-4,0-2-8]

| LOADING (psf) | SPACING- | CSL | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-----------|----------------|----------|--------|-----|----------------|----------|
| TCLL 25.0 | Plate Grip DOL 1.15 | TC 0.52 | Vert(LL) 0.03 | 13-35 | >999 | 240 | MT20 | 197/144 |
| TCDL 10.0 | Lumber DOL 1.15 | BC 0.34 | Vert(CT) -0.05 | 10-11 | >999 | 180 | | |
| BCLL 0.0 | Rep Stress Incr YES | WB 0.36 | Horz(CT) 0.03 | 8 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2018/TPI2014 | Matrix-AS | | | | | | |
| | | | | | | | Weight: 144 lb | FT = 20% |

LUMBER-
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2
SLIDER Left 2x6 SPF No.2 2-0-0, Right 2x4 SPF No.2 2-0-0

BRACING-
TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 5-12

REACTIONS. (size) 2=0-3-8, 12=0-3-8, 8=0-3-8
Max Horz 2=-220(LC 10)
Max Uplift 2=-66(LC 12), 12=-121(LC 13), 8=-52(LC 13)
Max Grav 2=481(LC 25), 12=1221(LC 1), 8=376(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 4-5=-60/296, 5-6=-97/264, 6-8=-386/89
BOT CHORD 2-13=-149/269, 12-13=-149/269, 10-11=-25/354, 8-10=-23/379
WEBS 4-12=-423/199, 5-12=-827/39, 6-11=-496/247

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 10-4-8, Exterior(2R) 10-4-8 to 13-4-8, Interior(1) 13-4-8 to 21-7-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 12, 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8 except (jt=lb) 12=121.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



December 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

| | | | | | | |
|---------|-------|------------|-----|-----|---------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | |
| 3008830 | C1 | GABLE | 1 | 1 | | I49195030 |


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:32 2021 Page 1

ID:xKFGJ7evN?7xhJE66FFHnCzvA57-qGg5sOy4H4KuVXKb0j3FTtMOvqnq5n13M7KGxsyAZBP



Scale = 1:32.4

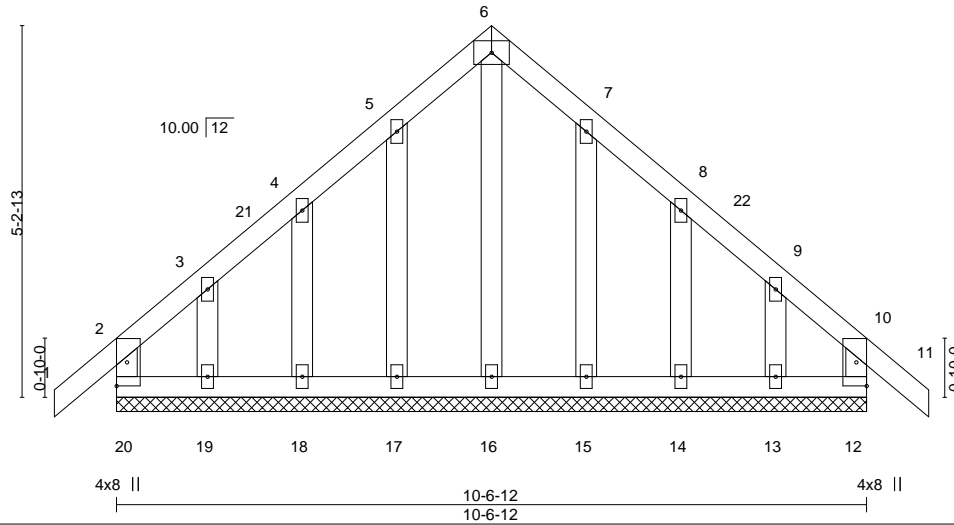

| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in | (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-------|----------|----------|-------|-------|--------|-----|---------------|----------|
| TCLL 25.0 | Plate Grip DOL | 1.15 | TC 0.08 | Vert(LL) | -0.00 | 11 | n/r | 120 | MT20 | 197/144 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.04 | Vert(CT) | -0.00 | 11 | n/r | 120 | | |
| BCLL 0.0 | Rep Stress Incr | YES | WB 0.08 | Horz(CT) | 0.00 | 12 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2018/TPI2014 | | Matrix-R | | | | | | Weight: 54 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

All bearings 10-6-12.
(lb) - Max Horz 20=-142(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 20, 12, 17, 18, 19, 15, 14, 13
Max Grav All reactions 250 lb or less at joint(s) 20, 12, 16, 17, 18, 19, 15, 14, 13

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-10-8 to 2-1-8, Exterior(2N) 2-1-8 to 5-3-6, Corner(3R) 5-3-6 to 8-3-6, Exterior(2N) 8-3-6 to 11-5-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 20, 12, 17, 18, 19, 15, 14, 13.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

| | | | | | | |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | I49195031 |
| 3008830 | D1 | GABLE | 1 | 1 | Job Reference (optional) | |

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:33 2021 Page 1
ID:xKFGJ7evN?7xhJE66FFHnCzvA57-ISEU3kzi2OSI7hvnMQaU0vuZ_D4cqF5Cbn3pTlyAZBO

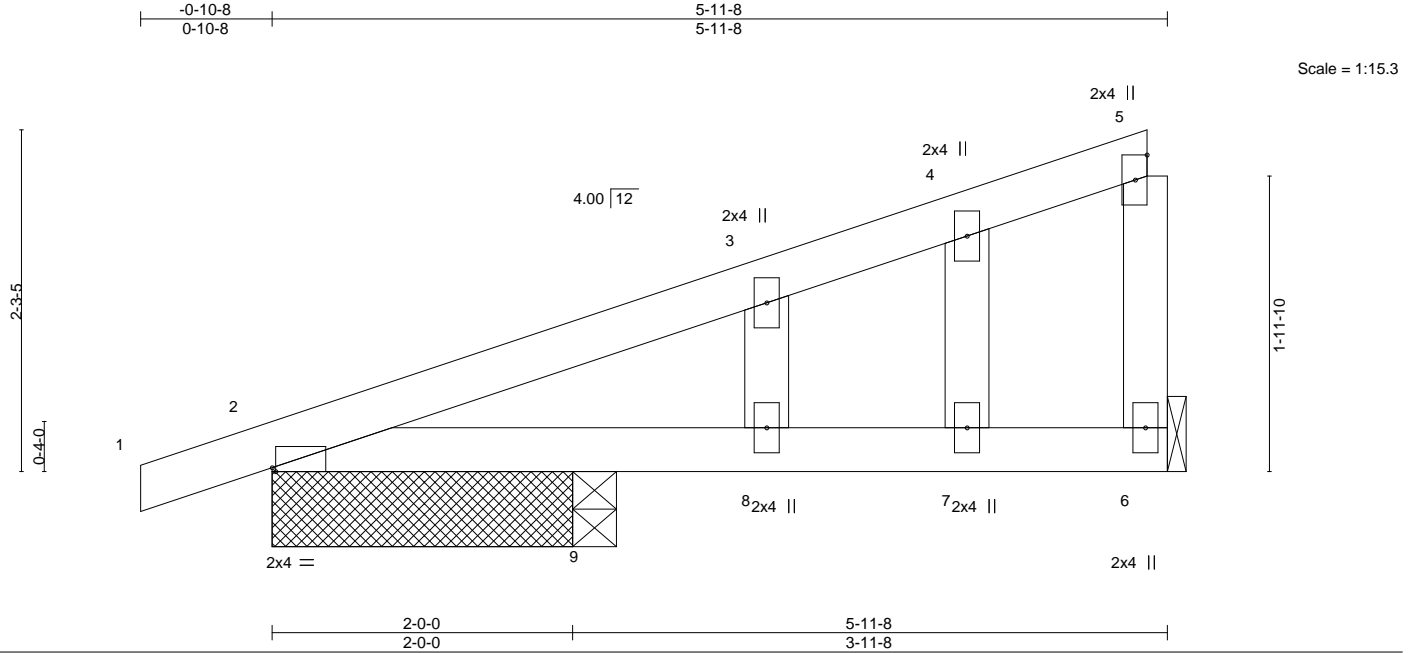

| Plate Offsets (X,Y)-- [2:0-0-5,Edge] | | | | | | | | | | | |
|--------------------------------------|--|----------------------|-------|-------------|--|--------------|-----------|--------|-----|---------------|-------------|
| LOADING (psf) | | SPACING- | 2-0-0 | CSI. | | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
| TCLL 25.0 | | Plate Grip DOL | 1.15 | TC 0.12 | | Vert(LL) | 0.02 7-8 | >999 | 240 | MT20 | 197/144 |
| TCDL 10.0 | | Lumber DOL | 1.15 | BC 0.20 | | Vert(CT) | -0.02 7-8 | >999 | 180 | | |
| BCLL 0.0 | | Rep Stress Incr | YES | WB 0.04 | | Horz(CT) | 0.00 6 | n/a | n/a | | |
| BCDL 10.0 | | Code IRC2018/TPI2014 | | Matrix-S | | | | | | Weight: 19 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-11-8 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=2-0-0, 9=0-3-8, 6=Mechanical
Max Horz 2=83(LC 9)
Max Uplift 2=-44(LC 8), 9=-56(LC 12), 6=-31(LC 12)
Max Grav 2=158(LC 1), 9=269(LC 1), 6=155(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 3-8=-205/250

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-10-8 to 2-1-8, Exterior(2N) 2-1-8 to 5-9-5 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable studs spaced at 1-4-0 oc.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 9, 6.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

| | | | | | | |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | I49195032 |
| 3008830 | D2 | Monopitch | 5 | 1 | Job Reference (optional) | |

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:33 2021 Page 1

ID:xKFGJ7evN?7xhJE66FFHnCzvA57-ISEU3kzi2OSI7hvnMQaU0vuU0D2DqFnCbn3pTlyAZBO

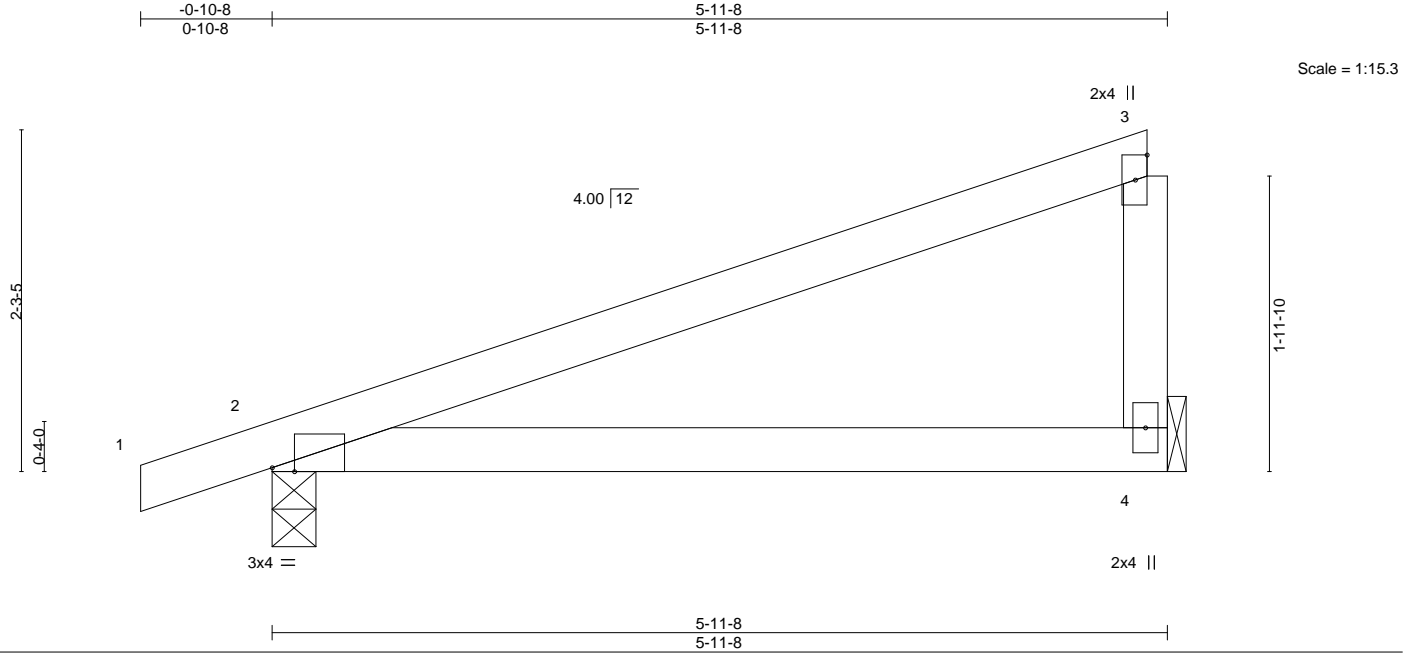

| Plate Offsets (X,Y)-- [2:0-1-13,Edge] | | | | | | | | | | | |
|---------------------------------------|------|-----------------|-----------------|-------------|------|--------------|-----------|--------|-----|---------------|-------------|
| LOADING (psf) | | SPACING- | 2-0-0 | CSI. | | DEFL. | in (loc) | I/defl | L/d | PLATES | GRIP |
| TCLL | 25.0 | Plate Grip DOL | 1.15 | TC | 0.44 | Vert(LL) | -0.06 4-7 | >999 | 240 | MT20 | 197/144 |
| TCDL | 10.0 | Lumber DOL | 1.15 | BC | 0.35 | Vert(CT) | -0.12 4-7 | >569 | 180 | | |
| BCLL | 0.0 | Rep Stress Incr | YES | WB | 0.00 | Horz(CT) | 0.00 2 | n/a | n/a | | |
| BCDL | 10.0 | Code | IRC2018/TPI2014 | Matrix-AS | | | | | | Weight: 17 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.

(size) 4=Mechanical, 2=0-3-8
Max Horz 2=84(LC 11)
Max Uplift 4=-52(LC 12), 2=-76(LC 8)
Max Grav 4=257(LC 1), 2=327(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 5-9-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



December 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

| | | | | | | |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | I49195033 |
| 3008830 | D3 | Monopitch | 5 | 1 | Job Reference (optional) | |

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:34 2021 Page 1
ID:xKFGJ7evN?77xhJE66FFHnCzvA57-mfosh4zKpiackrU_w85jY6RjydRXZi0MpRpN0kyAZBN

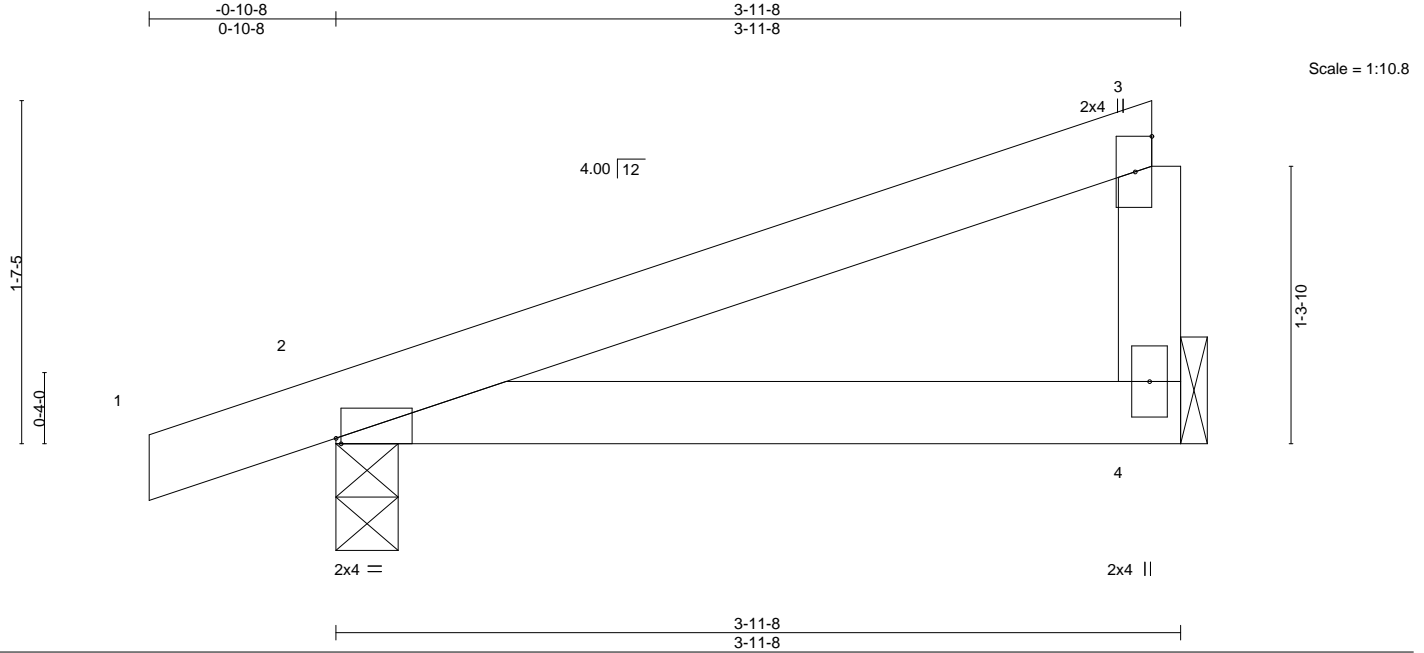

| Plate Offsets (X,Y)-- [2:0-0-5,Edge] | | | | | | | | | | | |
|--------------------------------------|--|----------------------|-------|-------------|--|--------------|-----------|--------|-----|---------------|-------------|
| LOADING (psf) | | SPACING- | 2-0-0 | CSI. | | DEFL. | in (loc) | I/defl | L/d | PLATES | GRIP |
| TCLL 25.0 | | Plate Grip DOL | 1.15 | TC 0.17 | | Vert(LL) | -0.01 4-7 | >999 | 240 | MT20 | 197/144 |
| TCDL 10.0 | | Lumber DOL | 1.15 | BC 0.15 | | Vert(CT) | -0.02 4-7 | >999 | 180 | | |
| BCLL 0.0 | | Rep Stress Incr | YES | WB 0.00 | | Horz(CT) | 0.00 2 | n/a | n/a | | |
| BCDL 10.0 | | Code IRC2018/TPI2014 | | Matrix-MP | | | | | | Weight: 11 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-11-8 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 4=Mechanical, 2=0-3-8
Max Horz 2=57(LC 11)
Max Uplift 4=-33(LC 12), 2=-63(LC 8)
Max Grav 4=165(LC 1), 2=240(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 3-9-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

| | | | | | | |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | I49195034 |
| 3008830 | D4 | GABLE | 1 | 1 | Job Reference (optional) | |

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:34 2021 Page 1
ID:xKFGJ7evN?7xhJE66FFHnCzvA57-mfosH4zKpiackrU_w85jY6Ri1dRfZi0MpRpN0kyAZBN

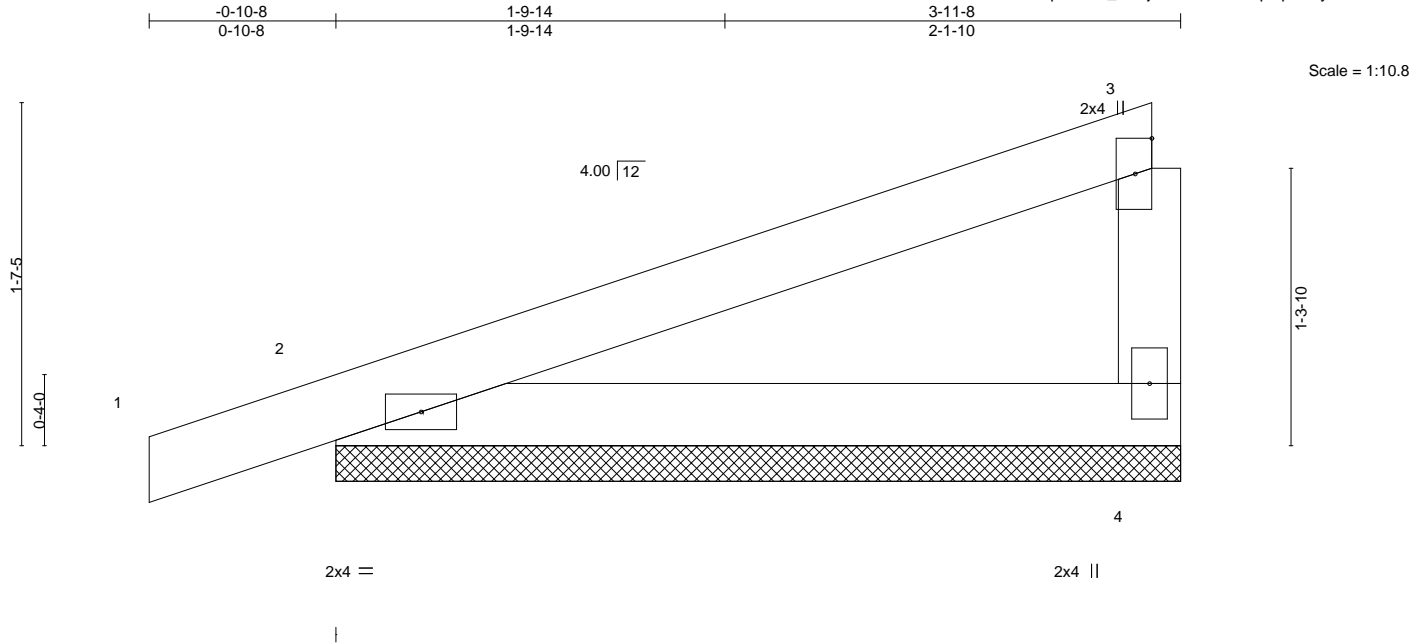

| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-------|----------|----------|----------|--------|-----|---------------|----------|
| TCLL 25.0 | Plate Grip DOL | 1.15 | TC 0.23 | Vert(LL) | -0.00 | 1 | n/r | MT20 | 197/144 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.15 | Vert(CT) | 0.00 | 1 | n/r | | |
| BCLL 0.0 | Rep Stress Incr | YES | WB 0.00 | Horz(CT) | 0.00 | 4 | n/a | | |
| BCDL 10.0 | Code IRC2018/TPI2014 | | Matrix-P | | | | | Weight: 11 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-11-8 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 4=3-11-8, 2=3-11-8
Max Horz 2=57(LC 9)
Max Uplift 4=-33(LC 12), 2=-64(LC 8)
Max Grav 4=162(LC 1), 2=240(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-10-8 to 2-1-8, Exterior(2N) 2-1-8 to 3-9-5 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 1-4-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

| | | | | | | |
|---------|-------|----------------------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | I49195035 |
| 3008830 | D5 | Monopitch Structural Gable | 7 | 1 | Job Reference (optional) | |

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:35 2021 Page 1
ID:xKFGJ7evN?7xhJE66FFHnCzvA57-ErLEUQ_ya?iTM?2AUrcy5K_s41mZI9GV25YwYyAZBM

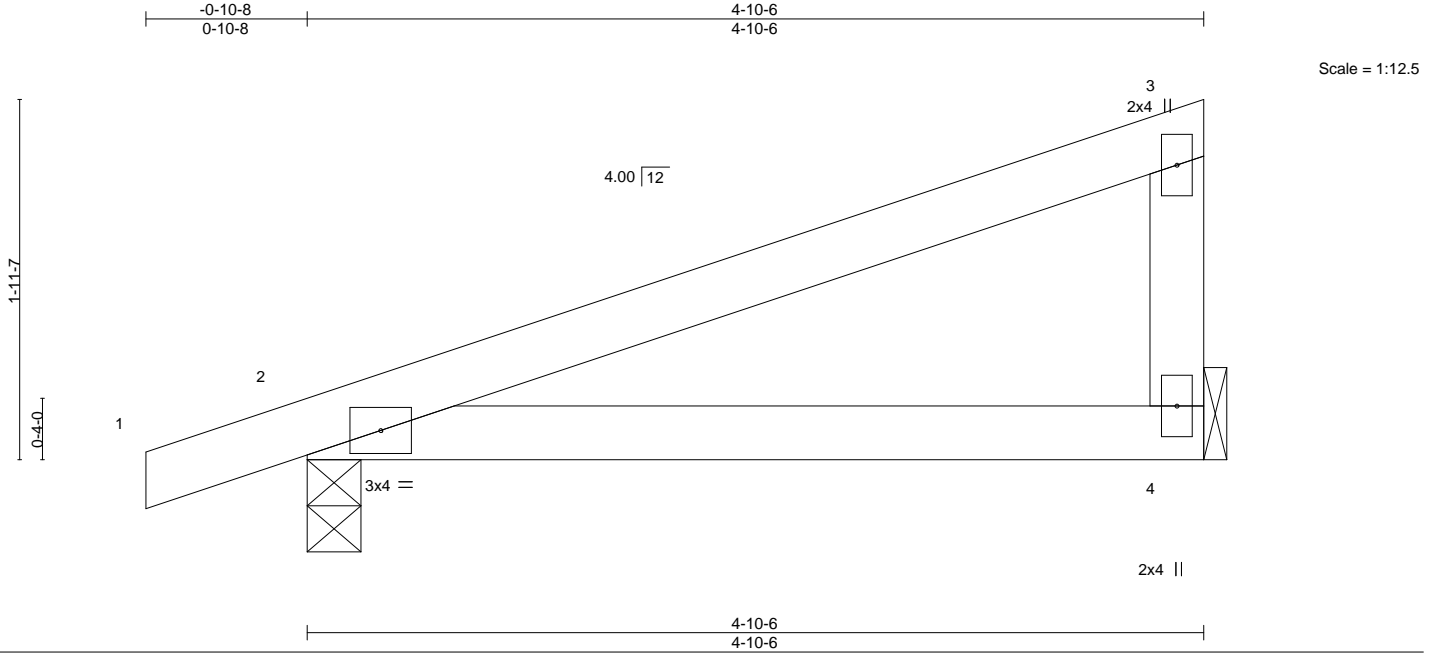

| LOADING (psf) | SPACING- | CSI. | DEFL. | in | (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-----------|----------|-------|-------|--------|-----|---------------|----------|
| TCLL 25.0 | 2-0-0 | TC 0.28 | Vert(LL) | -0.03 | 4-7 | >999 | 240 | MT20 | 197/144 |
| TCDL 10.0 | Plate Grip DOL 1.15 | BC 0.23 | Vert(CT) | -0.05 | 4-7 | >999 | 180 | | |
| BCLL 0.0 | Lumber DOL 1.15 | WB 0.00 | Horz(CT) | 0.00 | 2 | n/a | n/a | | |
| BCDL 10.0 | Rep Stress Incr YES | Matrix-AS | | | | | | Weight: 14 lb | FT = 20% |
| | Code IRC2018/TPI2014 | | | | | | | | |

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.

(size) 4=Mechanical, 2=0-3-8
Max Horz 2=69(LC 11)
Max Uplift 4=-42(LC 12), 2=-69(LC 8)
Max Grav 4=207(LC 1), 2=279(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 4-8-10 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable studs spaced at 2-0-0 oc.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



December 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

| | | | | | | |
|---------|-------|---------------------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | I49195036 |
| 3008830 | D6 | Monopitch Supported Gable | 1 | 1 | Job Reference (optional) | |

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:36 2021 Page 1
ID: xKFGJ7evN?7xhJE66FFHnCzvA57-i1vcim?aLJqK_9dM1Y8BdXW30R871ceeHIIU4dyAZBL

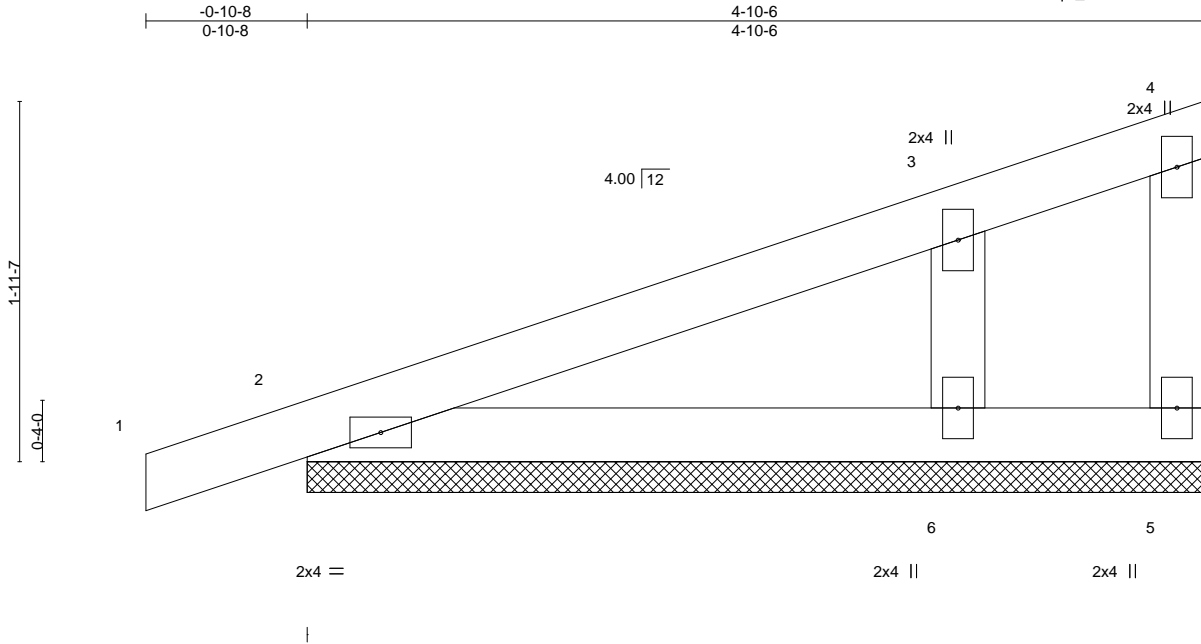

Scale = 1:12.5

| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-------|----------|----------|----------|--------|-----|---------------|----------|
| TCLL 25.0 | Plate Grip DOL | 1.15 | TC 0.14 | Vert(LL) | -0.00 | 1 | n/r | MT20 | 197/144 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.08 | Vert(CT) | 0.00 | 1 | n/r | | |
| BCLL 0.0 | Rep Stress Incr | YES | WB 0.06 | Horz(CT) | 0.00 | 5 | n/a | | |
| BCDL 10.0 | Code IRC2018/TPI2014 | | Matrix-P | | | | | Weight: 15 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-10-6 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 5=4-10-6, 2=4-10-6, 6=4-10-6
Max Horz 2=69(LC 11)
Max Uplift 5=-29(LC 1), 2=-53(LC 8), 6=-70(LC 12)
Max Grav 5=10(LC 12), 2=200(LC 1), 6=314(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 3-6=-240/318

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-10-8 to 2-1-8, Exterior(2N) 2-1-8 to 4-8-10 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 1-4-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 2, 6.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

| | | | | | | |
|---------|-------|------------------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | I49195037 |
| 3008830 | E1 | Common Supported Gable | 1 | 1 | Job Reference (optional) | |


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:37 2021 Page 1

ID:xKFGJ7evN?7xhJE66FFHnCzvA57-ADT_v60C6dyAcJCZbGfQAI3DjrUom39oVP11c3yAZBK

0-10-8 11-0-0 22-0-0 22-10-8
0-10-8 11-0-0 11-0-0 0-10-8

Scale = 1:38.1

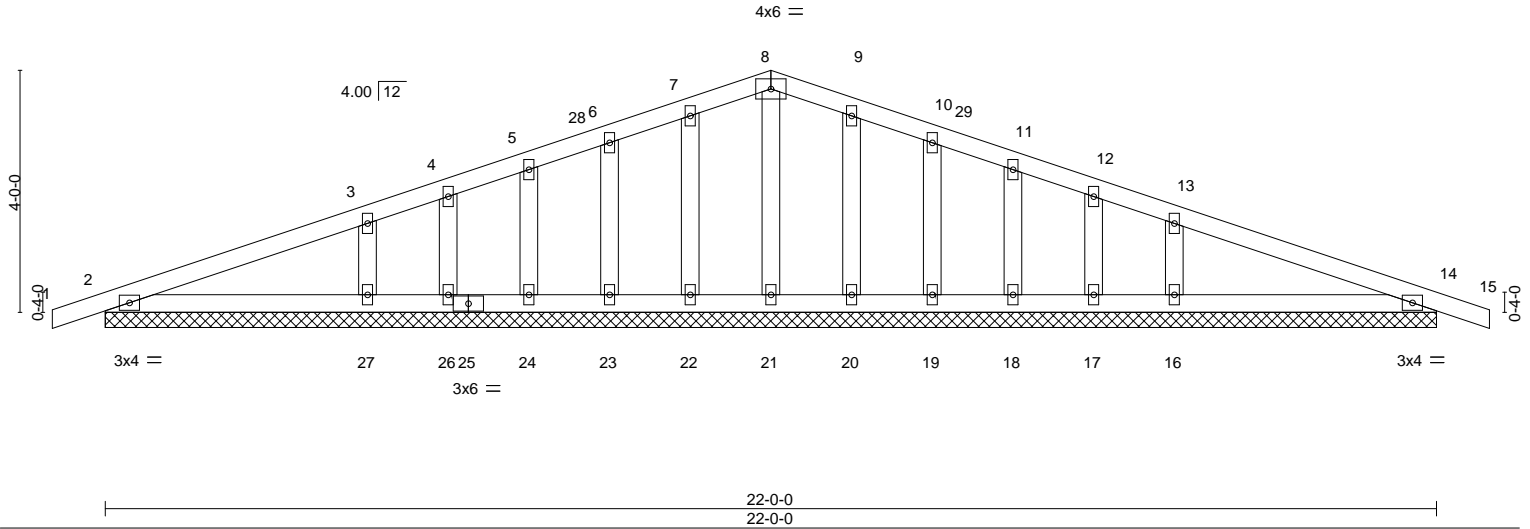

| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-------|----------|----------|----------|--------|-----|---------------|----------|
| TCLL 25.0 | Plate Grip DOL | 1.15 | TC 0.21 | Vert(LL) | 0.01 | 15 | n/r | MT20 | 197/144 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.12 | Vert(CT) | 0.01 | 15 | n/r | | |
| BCLL 0.0 | Rep Stress Incr | YES | WB 0.04 | Horz(CT) | 0.00 | 14 | n/a | | |
| BCDL 10.0 | Code IRC2018/TPI2014 | | Matrix-S | | | | | Weight: 82 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.

REACTIONS.

All bearings 22-0-0.
(lb) - Max Horz 2=63(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 2, 22, 23, 24, 26, 27, 20, 19, 18, 17, 16, 14
Max Grav All reactions 250 lb or less at joint(s) 2, 21, 22, 23, 24, 26, 20, 19, 18, 17, 14 except 27=417(LC 25), 16=417(LC 26)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 3-27=303/147, 13-16=303/147

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-10-8 to 2-1-8, Exterior(2N) 2-1-8 to 11-0-0, Corner(3R) 11-0-0 to 14-0-0, Exterior(2N) 14-0-0 to 22-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1'-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 22, 23, 24, 26, 27, 20, 19, 18, 17, 16, 14.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


| | | | | | | |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | 149195038 |
| 3008830 | E2 | Common | 4 | 1 | Job Reference (optional) | |

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:38 2021 Page 1
ID:xKFGJ7evN?77xhJE66FFHnCzvA57-eQ1N6S1rtw41DSnI9zAfjycMoEh9VUVxk3na9VyAZBJ

0-10-8 5-10-13 11-0-0 16-1-3 22-0-0 22-10-8
0-10-8 5-10-13 5-1-3 5-1-3 5-10-13 0-10-8

Scale = 1:38.1

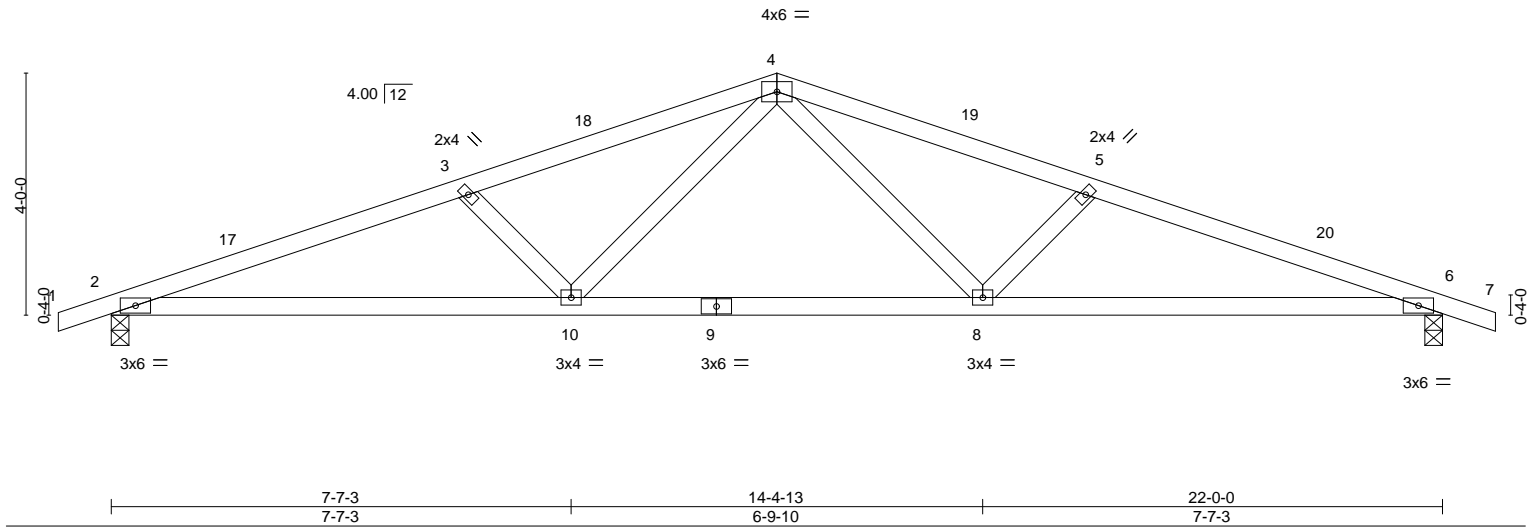

| | | | | | |
|----------------------|-----------------------|-------------------|-----------------------|------------------------|---------------------|
| 7-7-3 7-7-3 | | 14-4-13 6-9-10 | | 22-0-0 7-7-3 | |
| LOADING (psf) | SPACING- 2-0-0 | CSI. | DEFL. in (loc) | L/defl | L/d |
| TCLL 25.0 | Plate Grip DOL 1.15 | TC 0.38 | Vert(LL) -0.12 10 | >999 | 240 |
| TCDL 10.0 | Lumber DOL 1.15 | BC 0.69 | Vert(CT) -0.25 10-13 | >999 | 180 |
| BCLL 0.0 | Rep Stress Incr YES | WB 0.16 | Horz(CT) 0.06 6 | n/a | n/a |
| BCDL 10.0 | Code IRC2018/TPI2014 | Matrix-AS | | | |
| | | | | PLATES MT20 | GRIP 197/144 |
| | | | | Weight: 70 lb FT = 20% | |

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.

(size) 2=0-3-8, 6=0-3-8
Max Horz 2=63(LC 12)
Max Uplift 2=176(LC 8), 6=176(LC 9)
Max Grav 2=1051(LC 1), 6=1051(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2359/458, 3-4=-2082/411, 4-5=-2082/411, 5-6=-2359/458
BOT CHORD 2-10=-380/2208, 8-10=-213/1483, 6-8=-381/2208
WEBS 4-8=-96/659, 5-8=-448/170, 4-10=-95/659, 3-10=-448/169

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 11-0-0, Exterior(2R) 11-0-0 to 14-0-0, Interior(1) 14-0-0 to 22-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=176, 6=176.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



December 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:39 2021 Page 1
 ID:xKFGJ7evN?7xhJE66FFHnCzvA57-7cbIKn1TeECurcMxjhjhuFA8XYe8bEyZ5zjW8hyryAZBI
 9-3-0 17-9-5
 9-3-0 8-6-5

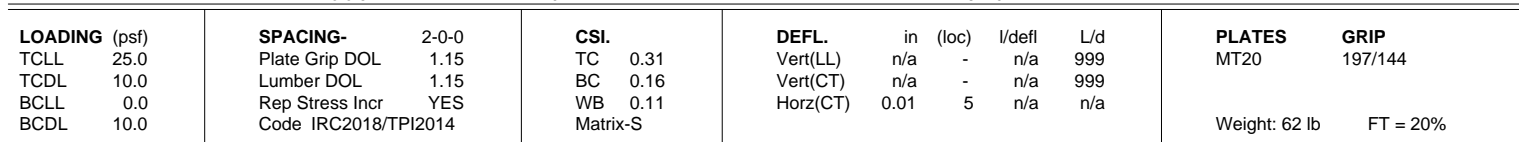

| | |
|-----------|---|
| TOP CHORD | Structural wood sheathing directly applied or 6-0-0 oc purlins. |
| BOT CHORD | Rigid ceiling directly applied or 10-0-0 oc bracing. |

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiteK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria, DSB-89 and BCSI Building Components**.


Safety Information: available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601.



| | | | | | | |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | 149195040 |
| 3008830 | V2 | Valley | 1 | 1 | Job Reference (optional) | |

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:39 2021 Page 1
ID:xKFGJ7evN?7xhJE66FFHnCzvA57-7cbIKn1TeECurcMxjhhuFA8YFe9WEyH5zjW8hyhAZBI

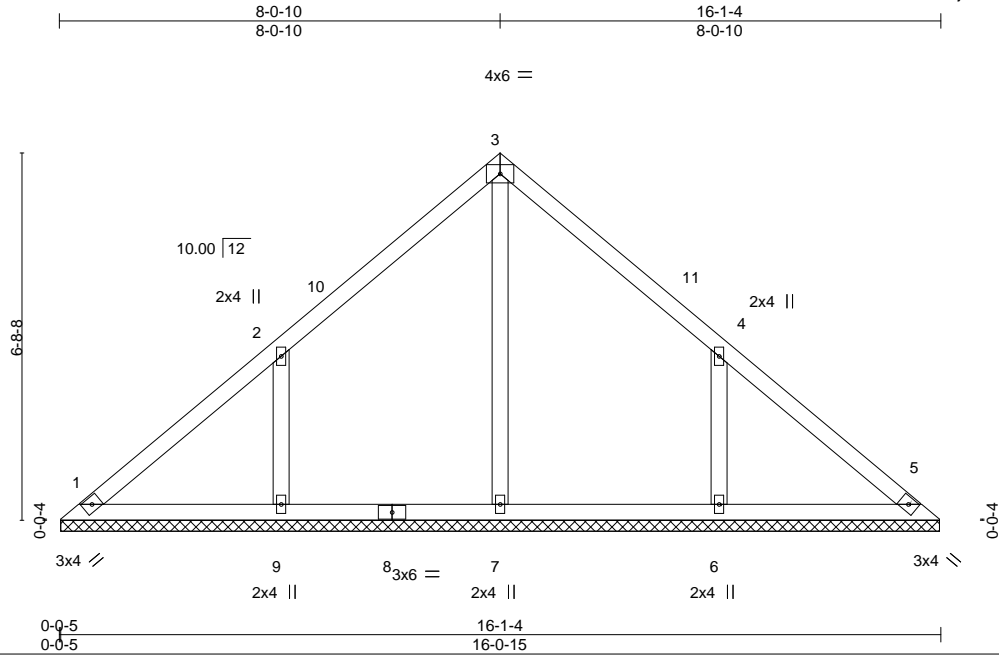

Scale = 1:42.1

| LOADING (psf) | SPACING- | CSI. | DEFL. | in | (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|----------|----------|------|-------|--------|-----|---------------|----------|
| TCLL 25.0 | 2-0-0 | TC 0.20 | Vert(LL) | n/a | - | n/a | 999 | MT20 | 197/144 |
| TCDL 10.0 | Plate Grip DOL 1.15 | BC 0.10 | Vert(CT) | n/a | - | n/a | 999 | | |
| BCLL 0.0 | Lumber DOL 1.15 | WB 0.13 | Horz(CT) | 0.00 | 5 | n/a | n/a | | |
| BCDL 10.0 | Rep Stress Incr YES | Matrix-S | | | | | | Weight: 54 lb | FT = 20% |
| | Code IRC2018/TPI2014 | | | | | | | | |

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 16-0-10.
(lb) - Max Horz 1=149(LC 9)
Max Uplift All uplift 100 lb or less at joint(s) 1 except 9=194(LC 12), 6=193(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 7=255(LC 1), 9=426(LC 19), 6=426(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-9=333/222, 4-6=333/222

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-13 to 3-4-13, Interior(1) 3-4-13 to 8-0-10, Exterior(2R) 8-0-10 to 11-0-10, Interior(1) 11-0-10 to 15-8-6 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 9=194, 6=193.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

| | | | | | | |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | 149195041 |
| 3008830 | V3 | Valley | 1 | 1 | Job Reference (optional) | |

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:40 2021 Page 1
ID:xKFGJ7evN?7xhJE66FFHnCzvA57-bo97X725PYKITmx8GOC7oNhkR2VmzP1ECNGhDOyAZBH

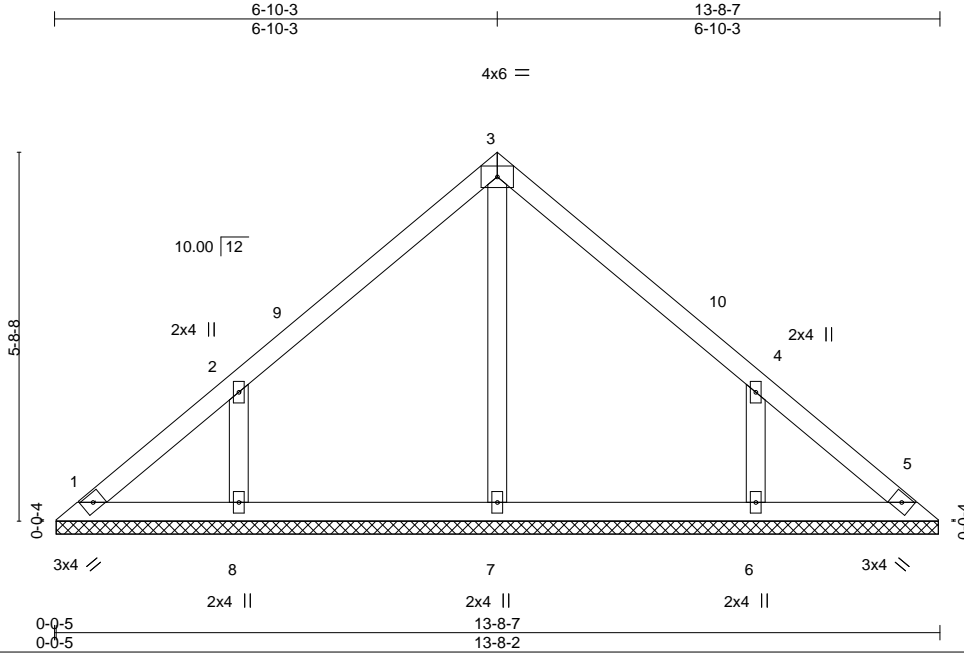

| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in | (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-------|----------|----------|------|-------|--------|-----|---------------|----------|
| TCLL 25.0 | Plate Grip DOL | 1.15 | TC 0.17 | Vert(LL) | n/a | - | n/a | 999 | MT20 | 197/144 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.10 | Vert(CT) | n/a | - | n/a | 999 | | |
| BCLL 0.0 | Rep Stress Incr | YES | WB 0.10 | Horz(CT) | 0.00 | 5 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2018/TPI2014 | | Matrix-S | | | | | | Weight: 45 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 13-7-13.

(lb) - Max Horz 1=126(LC 8)

Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 8=168(LC 12), 6=168(LC 13)

Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 7=273(LC 1), 8=364(LC 19), 6=364(LC 20)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-8=292/197, 4-6=292/196

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-13 to 3-4-13, Interior(1) 3-4-13 to 6-10-3, Exterior(2R) 6-10-3 to 9-10-3, Interior(1) 9-10-3 to 13-3-9 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=168, 6=168.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

| | | | | | | |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | 149195042 |
| 3008830 | V4 | GABLE | 1 | 1 | Job Reference (optional) | |

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:41 2021 Page 1
ID:xKFGJ7evN?7xhJE66FFHnCzvA57-3?jVIT3jArTc4wWKq6jMKbDwMSjitt0NQ0?FmqyAZBG

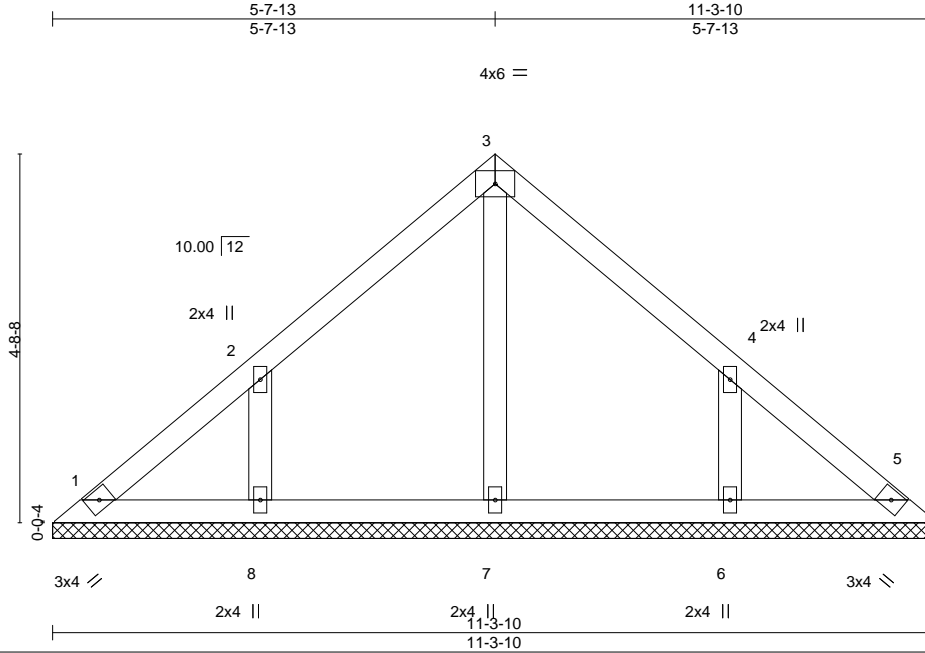

| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in | (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-------|----------|----------|------|-------|--------|-----|---------------|----------|
| TCLL 25.0 | Plate Grip DOL | 1.15 | TC 0.10 | Vert(LL) | n/a | - | n/a | 999 | MT20 | 197/144 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.05 | Vert(CT) | n/a | - | n/a | 999 | | |
| BCLL 0.0 | Rep Stress Incr | YES | WB 0.05 | Horz(CT) | 0.00 | 5 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2018/TPI2014 | | Matrix-S | | | | | | Weight: 37 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 11-3-10.

(lb) - Max Horz 1=103(LC 9)

Max Uplift All uplift 100 lb or less at joint(s) 1 except 8=133(LC 12), 6=133(LC 13)

Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7 except 8=292(LC 19), 6=291(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-13 to 3-4-13, Interior(1) 3-4-13 to 5-7-13, Exterior(2R) 5-7-13 to 8-7-13, Interior(1) 8-7-13 to 10-10-13 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 8=133, 6=133.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 10, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

| | | | | | | |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | C&H/155 Cobey | 149195043 |
| 3008830 | V5 | GABLE | 1 | 1 | Job Reference (optional) | |

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Aug 16 2021 MiTek Industries, Inc. Thu Dec 9 22:31:42 2021 Page 1

ID:xKFGJ7evN?7xhJE66FFHnCzvA57-XBhtyp4Lx9bTi45WOpeBtom43sAaRJXfgloGyAZBF

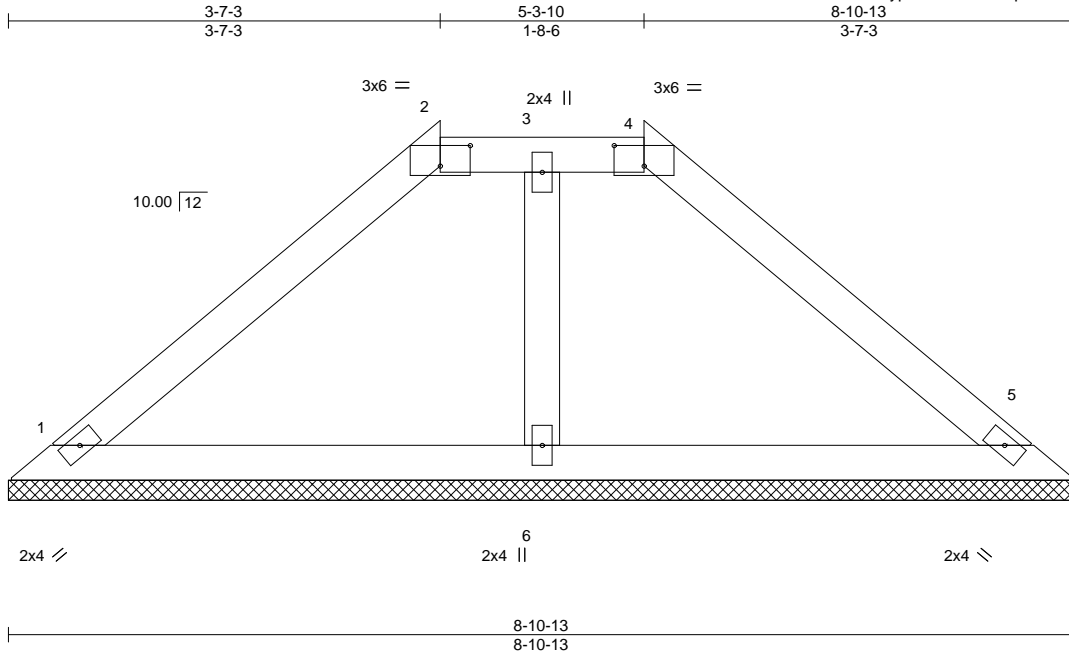

Scale = 1:19.2

| Plate Offsets (X,Y)-- [2:0-3-0,0-2-1], [4:0-3-0,0-2-1] | | | | | | | | | |
|--|----------------------|------|----------|----------|------|-------|--------|-----|---------------|
| LOADING (psf) | SPACING- | | CSI. | DEFL. | in | (loc) | l/defl | L/d | PLATES |
| TCLL 25.0 | Plate Grip DOL | 1.15 | TC 0.17 | Vert(LL) | n/a | - | n/a | 999 | MT20 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.14 | Vert(CT) | n/a | - | n/a | 999 | GRIP |
| BCLL 0.0 | Rep Stress Incr | YES | WB 0.02 | Horz(CT) | 0.00 | 5 | n/a | n/a | 197/144 |
| BCDL 10.0 | Code IRC2018/TPI2014 | | Matrix-S | | | | | | Weight: 24 lb |
| | | | | | | | | | FT = 20% |

| LUMBER- | | BRACING- | |
|-----------|--------------|-----------|--|
| TOP CHORD | 2x4 SPF No.2 | TOP CHORD | Structural wood sheathing directly applied or 6'-0" oc purlins, except |
| BOT CHORD | 2x4 SPF No.2 | | 2'-0" oc purlins (6'-0" max.); 2'-4." |
| OTHERS | 2x4 SPF No.2 | BOT CHORD | Rigid ceiling directly applied or 10'-0" oc bracing. |

REACTIONS. (size) 1=8-10-13, 5=8-10-13, 6=8-10-13
Max Horz 1=61(LC 9)
Max Uplift 1=-55(LC 12), 5=-60(LC 13)
Max Grav 1=255(LC 1), 5=255(LC 1), 6=226(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-263/134, 4-5=-263/143

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 10,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Symbols

PLATE LOCATION AND ORIENTATION

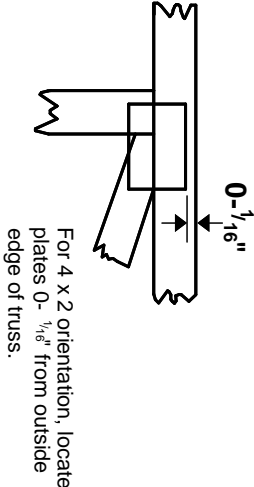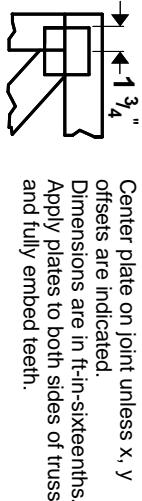

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.


This symbol indicates the required direction of slots in connector plates.

PLATE SIZE


4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION




BEARING

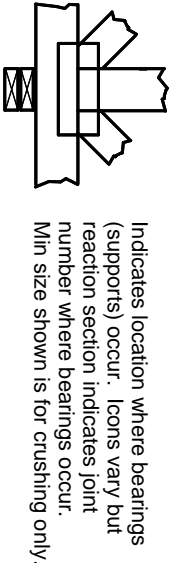

Industry Standards:
ANSI/TPI 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

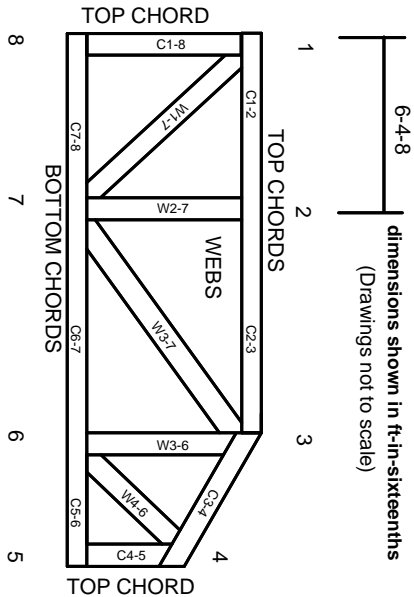

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:
ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TPI 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved



Mitek Engineering Reference Sheet: MII-7473 rev. 5/19/2020

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.