



**GENERAL NOTES:\***

**PROPER ACCESS AND WORKING CLEARANCE** AROUND EXISTING AND PROPOSED ELECTRICAL EQUIPMENT WILL BE PROVIDED AS PER SECTION *NEC 110.26*.

**PV SYSTEM COMPONENTS;** INCLUDING BUT NOT LIMITED TO, MODULES, INVERTERS AND SOURCE CIRCUIT COMBINERS ARE IDENTIFIED AND LISTED FOR USE IN PV SYSTEMS IN COMPLIANCE WITH *NEC 690.4 AND 690.6* AND *ALL UL, IEC, IEEE* CLASSIFICATIONS AS REQUIREMENTS.

**RAPID SHUTDOWN NOTES:\***

PV SYSTEM CIRCUITS INSTALLED ON OR IN BUILDIDNG SHALL INCLUDE A **RAPID SHUTDOWN FUNCTION** THAT CONTROLS SPECIFIC PV CONDUCTORS IN ACCORDANCE WITH *2017 NEC 690.12(A)-(D)*

**EQUIPMENT LOCATIONS & ELECTRICAL NOTES:\***

**JUNCTION AND PULL BOXES** ARE PERMITTED TO BE INSTALLED UNDER PV MODULES IN COMPLIANCE WITH *NEC 690.34*.

**ADDITIONAL AC DISCONNECT(S)** SHALL BE PROVIDED WHERE THE INVERTER IS NOT WITHIN SIGHT OF THE AC SERVICING DISCONNECT. *2017 NEC 690.15(A)*

ALL EQUIPMENT SHALL BE INSTALLED **ACCESSIBLE TO QUALIFIED PERSONNEL** IN COMPLIANCE WITH *NEC* APPLICABLE CODES.

ALL COMPONENTS ARE **LISTED FOR THEIR INTENDED PURPOSE AND RATED FOR OUTDOOR USAGE** WHEN APPLICABLE.

**STRUCTURAL AND INSTALLATION NOTES:\***

**RACKING SYSTEM & PV PANELS MOUNTED ON A ROOFTOP** SHALL BE LISTED AND LABELED IN ACCORDANCE WITH *UL 1703* AND SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER INSTALLATION INSTRUCTIONS.

ALL PV RACKING ATTACHMENT POINTS SHALL NOT EXCEED THE PRE-ENGINEERED **MAX SPANS** OUTLINED BY THE RACKING MANUFACTURES ENGINEER OF RECORD.

**GROUNDING NOTES:\***

**IN UNGROUNDED SYSTEMS** ONLY THE DC CONDUCTORS ARE UNGROUNDED AND REQUIRE AN EQUIPMENT GROUNDING CONDUCTOR. ALL METAL ELECTRICAL EQUIPMENT AND STRUCTURAL COMPONENTS BONDED TO

GROUND, IN COMPLIANCE WITH *NEC 250.134* AND *NEC 250.136(A)*.

PV EQUIPMENT INCLUDING **MODULE FRAMES AND OTHER METAL PARTS SHALL BE GROUNDED** IN COMPLIANCE WITH *NEC 690.43* AND MINIMUM GROUND CONDUCTORS SIZED IN ACCORDANCE WITH *NEC TABLE 250.122*.

CONDUCTIVE PARTS OF MODULE FRAMES, MODULE RACKING, AND ENCLOSURES SHALL BE GROUNDED IN COMPLIANCE WITH *NEC 250.134 AND NEC 250.136(A)*.

**UL2703 APPROVED MODULE AND RACK GROUNDING** SHALL BE USED AND INSTALLED PER MANUFACTURER'S INSTALLATION MANUAL. IF *UL2703* APPROVED GROUNDING IS NOT USED, MODULE GROUNDING LUGS MUST BE INSTALLED AT THE SPECIFIED GROUNDING LUG HOLES PER THE MANUFACTURER'S INSTALLATION REQUIREMENTS.

**THE GROUNDING CONNECTION TO A MODULE** SHALL BE ARRANGED SUCH THAT THE REMOVAL OF A MODULE DOES NOT INTERRUPT A GROUNDING CONDUCTOR TO ANOTHER MODULE.

**THE GROUNDING ELECTRODE SYSTEM** COMPLIES WITH *NEC 690.47* AND *NEC 250.50* THROUGH *NEC 250.106*. IF EXISTING SYSTEM IS INACCESSIBLE OR INADEQUATE, A GROUNDING ELECTRODE SYSTEM WILL BE PROVIDED IN COMPLIANCE WITH *NEC 250, NEC 690.47* AND *AHJ*.

PV SYSTEMS SHALL BE PROVIDED WITH **DC GROUND-FAULT PROTECTION** *2017 NEC 690.41(B)*

**INTERCONNECTION / POC NOTES:\***

**ALL LOAD-SIDE INTERCONNECTIONS** ARE IN COMPLIANCE WITH *2017 NEC 705.12(B)*

**THE TOTAL RATING OF ALL OCPD IN SOLAR LOAD CENTERS** SHALL NOT EXCEED THE RATED AMPACITY OF THE BUSBAR EXCLUDING THE OCPD PROTECTING THE BUSBAR IN COMPLIANCE WITH *NEC 705.12(B)(2)(3)(c)*

**ALL FEEDER TAP (LOAD SIDE) INTERCONNECTIONS** ARE IN COMPLIANCE WITH *2017 NEC 705.12(B)(2)(1)*

THE PV SYSTEM BACK-FEED BREAKER SHALL BE INSTALLED ON THE OPPOSITE END OF THE BUS BAR AND IT SHALL ALSO BE SIZED APPROPRIATELY AS PER *2017 NEC 705.12(B)(2)(3)(b)*

**SUPPLY SIDE TAP INTERCONNECTIONS** ARE IN COMPLIANCE WITH *NEC 705.12(A)* WITH SERVICE ENTRANCE CONDUCTORS IN COMPLIANCE WITH *NEC 230.42*

**BACKFEEDING BREAKER** FOR INVERTER OUTPUT IS EXEMPT FROM ADDITIONAL FASTENING *2017 NEC 705.12(B)(5)*

**MICROINVERTER BRANCH CIRCUITS** SHALL BE CONNECTED TO A SINGLE OCPD IN ACCORDANCE WITH THEIR INSTALLATION INSTRUCTIONS AND *NEC 690.9*

**DISCONNECTS AND OCPD NOTES:\***

**ALL DISCONNECTING SWITCHES** WILL BE CONFIGURED SO THAT ALL ENERGIZED CONDUCTORS WHEN DISCONNECT IS OPEN SHALL BE ON THE TERMINALS MARKED, "LINE SIDE" (TYPICALLY THE UPPER TERMINALS)

**ALL AC DISCONNECTS** SHALL BE LABELED, LOCKABLE, OF VISIBLE BREAK TYPE SWITCH WITH EXTERNAL HANDLE AND ACCESSIBLE TO QUALIFIED UTILITY PERSONNEL.

**AC DISCONNECTS** SHALL BE A "KNIFE BLADE" TYPE DISCONNECT. IF EXTERIOR, RATED TO NEMA 3R OR BETTER PER *NEC 110.28*

**ADDITIONAL AC DISCONNECTS** SHALL BE PROVIDED WHERE THE INVERTER IS NOT ADJACENT TO THE UTILITY AC DISCONNECT, OR NOT WIHTIN SIGHT OF THE UTILITY AC DISCONNECT. *2017 NEC 690.15(A)*

**BOTH POSITIVE AND NEGATIVE PV CONDUCTORS** REMAIN UNGROUNDED. THEREFORE, BOTH SHALL REMAIN OPEN WHERE A DISCONNECT IS REQUIRED IN COMPLIANCE WITH *2017 NEC 690.15(D)*

**ALL OCPD RATINGS AND TYPES SPECIFIED** SHALL BE IN COMPLIANCE WITH *NEC 690.8, 690.9, 705.12* AND *240*.

**BOTH POSITIVE AND NEGATIVE DC PV CONDUCTORS ARE UNGROUNDED;** BOTH REQUIRE OVERCURRENT PROTECTION IN COMPLIANCE WITH *NEC 690.9*

**ARC FAULT (AFCI) DC CIRCUIT PROTECTION** IS REQUIRED FOR ALL PV SYSTEMS ON OR PENETRATING A BUILDING WITH A MAXIMUM SYSTEM VOLTAGE OF 80 VOLTS OR GREATER. ALL DC PV CIRCUITS INSTALLED IN OR ON BUILDINGS WILL BE ARC-FAULT CIRCUIT PROTECTED IN COMPLIANCE WITH *NEC 690.11, UL1699B* AND SHALL BE LISTED AND LABELED IN ACCORDANCE WITH *UL 1699 (B)*.

**WIRING & CONDUIT NOTES:\***

**ALL CONDUIT AND CONDUCTORS SHALL BE APPROVED** FOR THEIR INTENDED PURPOSE INCLUDING WET LOCATIONS AND EXPOSED TO SUNLIGHT. CONDUIT AND CONDUCTOR SIZE SPECIFICATIONS ARE BASED ON THE MINIMUM CODE REQUIREMENTS AND ARE NOT LIMITED TO UP SIZING.

**ALL CONDUCTORS SHALL BE SIZED** IN COMPLIANCE WITH *NEC 690.8, NEC 690.7*.

**ALL CONDUCTORS SHALL BE DERATED** AS APPLICABLE TO THEIR RESPECTIVE ENVIRONMENT INCLUDING DIRECT

SUNLIGHT IN ACCORDANCE WITH *2017 NEC 310.15(B)(3)(4)(c)*

**EXPOSED UNGROUNDED DC PV SOURCE AND OUTPUT CIRCUITS** SHALL USE CONDUCTORS LISTED AND IDENTIFIED AS PHOTOVOLTAIC (PV) WIRE IN COMPLIANCE *2017 NEC 690.31(C)(1)*. PV MODULES WIRE LEADS SHALL BE LISTED FOR USE WITH UNGROUNDED SYSTEMS IN COMPLIANCE WITH *2017 NEC 690.4(B)*

**PV WIRE BLACK WIRE** MAY BE FIELD-MARKED WHITE IN COMPLIANCE WITH *NEC 200.6 (A)(6)*.

**PV MODULE CONDUCTORS LOCATED UNDER ARRAYS** WILL BE SECURED IN A WORKMANLIKE MANNER IN COMPLIANCE WITH *NEC 110.12*.

**WATERPROOFING:\***

ALL NEW **ROOFTOP PENETRATIONS** SHALL BE SEALED AND MADE WEATHER TIGHT WITH APPROVED CHEMICAL SEALANT AND FLASHINGS WHERE REQUIRED PER CODE AND GENERAL BUILDING AND ROOFING WORKMANSHIP STANDARDS BY A LICENSED CONTRACTOR.

ALL **EXTERIOR ELECTRICAL EQUIPMENT, SHALL BE NEMA 3R** OR BETTER RATED. ALL EXTERIOR CONDUIT AND CONNECTORS SHALL BE RATED FOR WET LOCATIONS.

\*ALL NOTES ARE AS APPLICABLE TO THIS PROJECT. DISREGARD ANY NOTES THAT DO NOT APPLY TO THIS PROJECT.




sealed 06jan2022 mike@h2dc.com  
H2DC PLLC MO CoA#: 2017002700  
ELECTRICAL ONLY  
-NOT AN AS BUILT DRAWING SET-

Sun Smart Technologies	00002021-00077	00002021-00077	RELEASE	GENERAL NOTES
	701 NE 76th Street Gladstone, MO 64118 (816) 509-0943	12/29/2021	SUBMIT FOR PERMIT	
27.625 kW PHOTOVOLTAIC PLANS		N-001		GENERAL NOTES
NAME LSCV455-MO ADDRESS 455 SW Ward Rd ADDRESS Lee's Summit, MO 64081 APN				

PV AC DISCONNECT LOCATED ON ACCESSIBLE EXTERIOR WALL WITH EXTERNAL HANDLE VISIBLE, LOCKABLE & LABELED WITHIN 10 FEET OF THE METER

NOTE: ALL ELECTRICAL LAYOUT DETAILS ON SHEET E-100

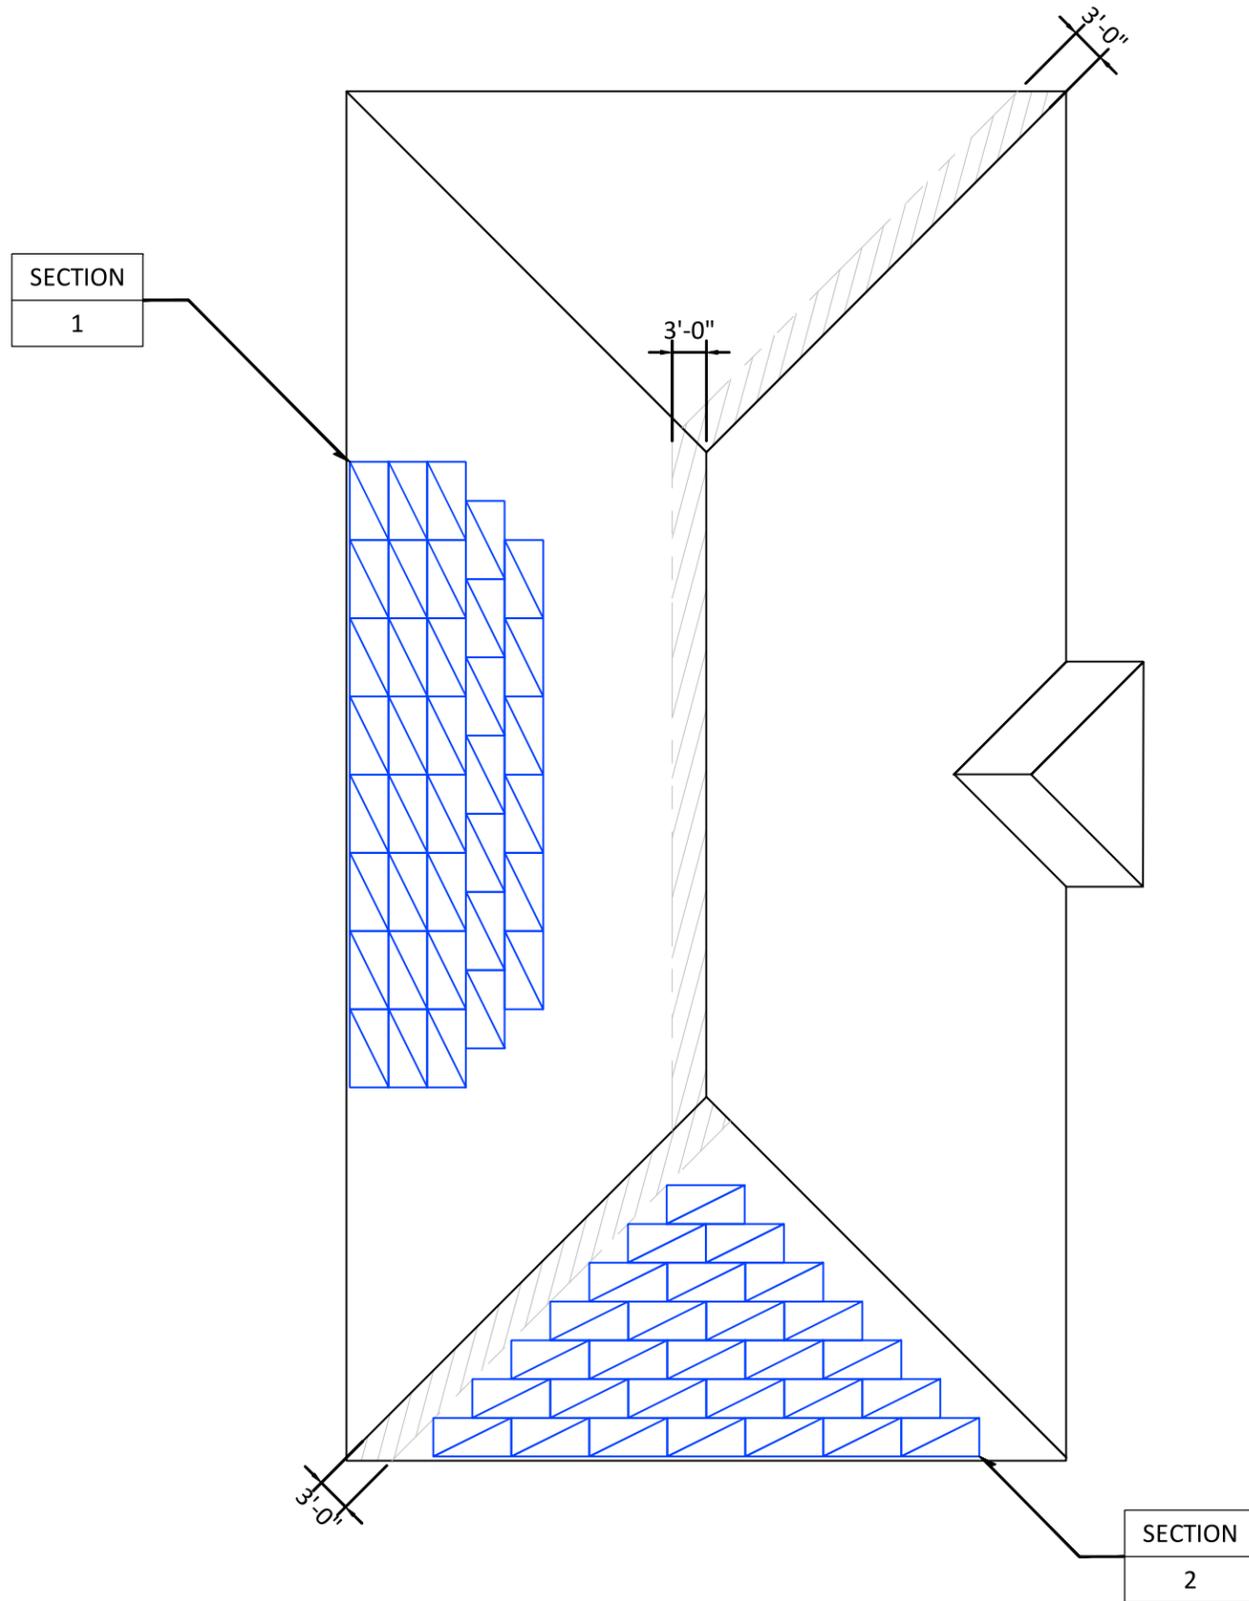

sealed 06jan2022 mike@h2dc.com  
H2DC PLLC MO CoA#: 2017002700  
ELECTRICAL ONLY  
-NOT AN AS BUILT DRAWING SET-

**2018 IFC ROOF ACCESS REQUIREMENTS**

THE FOLLOWING INFORMATION INDICATES THE REQUIRED ROOF TOP CLEARANCES FOR PANELS/ARRAYS INSTALLED ON RESIDENTIAL BUILDINGS WITH SLOPES GREATER 2:12:

**ROOF ACCESS POINTS** – ROOF ACCESS POINTS SHALL BE LOCATED IN AREAS THAT DO NOT REQUIRE THE PLACEMENT OF GROUND LADDERS OVER OPENINGS SUCH AS WINDOWS OR DOORS, AND LOCATED AT THE STRONG POINTS OF BUILDING CONSTRUCTION IN LOCATIONS WHERE THE ACCESS POINT DOES NOT CONFLICT WITH OVERHEAD OBSTRUCTIONS SUCH AS TREE LIMBS, WIRE, OR SIGNS.

**PRIMARY FIRECODE PATHWAY AND SECONDARY PATHWAYS** – THERE SHALL BE NO LESS THAN TWO MINIMUM 36" PATHWAYS ON SEPARATE ROOF SECTION TO THE RIDGE OF THE HOME. ONE OF THOSE PATHWAYS WILL BE ACCESSIBLE FROM STREET SIDE OF THE HOME OR ON THE DRIVEWAY WITH MINIMAL OBSTRUCTIONS. FOR EACH ROOF PLANE WITH PANELS/MODULES A MINIMUM 36-INCH-WIDE PATHWAY FROM THE LOWEST ROOF EDGE TO RIDGE SHALL BE PROVIDED ON THE SAME ROOF PLANE AS THE ARRAY, ON AN ADJACENT ROOF PLANE, OR STRADDLING THE SAME AND ADJACENT ROOF PLANES.

**SET-BACKS AT RIDGE** – PANELS/MODULES OCCUPYING 33 PERCENT OR LESS OF THE PLAN VIEW TOTAL ROOF AREA, A MINIMUM 18 INCHES SETBACK IS REQUIRED ON BOTH SIDES [HM1] [DR2] OF A HORIZONTAL RIDGE. FOR PANELS/MODULES OCCUPYING MORE THAN 33 PERCENT OF THE PLAN VIEW TOTAL ROOF AREA, A MINIMUM OF 36 INCHES WIDE SETBACK IS REQUIRED ON BOTH SIDES.

**EMERGENCY ESCAPE AND RESCUE OPENING** – PANELS/MODULES INSTALLED ON DWELLINGS SHALL NOT BE PLACED ON THE PORTION OF A ROOF THAT IS BELOW AN EMERGENCY ESCAPE AND RESCUE OPENING. A 36-INCH-WIDE PATHWAY SHALL BE PROVIDED TO THE EMERGENCY RESCUE AND ESCAPE OPENING.

-SEE HATCH DEFINITION BELOW.



**NOTE:** DESIGNATION OF RIDGE, HIP, AND VALLEY DOES NOT APPLY TO ROOFS WITH 2:12 OR LESS PITCH. DETACHED, NONHABITABLE GROUP U STRUCTURES INCLUDING, BUT NOT LIMITED TO, PARKING SHADE STRUCTURES, CARPORTS, SOLAR TRELLISES AND SIMILAR STRUCTURES SHALL NOT BE SUBJECT TO THE REQUIREMENTS OR WHERE THE FIRE CODE OFFICIAL HAS DETERMINED ROOFTOP OPERATIONS WILL NOT BE EMPLOYED.

**PV SITE LAYOUT LEGEND**

SECTION	PV ARRAY TAG	RA	ROOF ACCESS POINT
1	SECTION #	SA	SITE ACCESS
	MODULE GROUP	GA	GATE ACCESS

**AZIMUTH AND TILT TABLE**

SECTION #	AZIMUTH	ROOF PITCH / TILT
SECTION-1	165	22.6°
SECTION-2	255	22.6°

**SQUARE FOOTAGE CALCULATIONS**

ROOF REFERENCE	SQUARE FOOTAGE
EXISTING ROOF	7660
SECTION-1	647
SECTION-2	854
<b>TOTAL PERCENTAGE</b>	<b>19.6%</b>

\* EXISTING DIMENSIONS ARE APPROX. CONFIRM ALL DIMENSIONS SHOWN

SCALE:1/16"=1'-0" @ SHEET SIZE A3


27.625 kW PHOTOVOLTAIC PLANS

000002021-00077  
701 NE 76th Street  
Gladstone, MO 64118  
(816) 509-0943

NAME LSCV455-MO  
ADDRESS 455 SW Ward Rd  
ADDRESS Lee's Summit, MO 64081  
APN

REV 12/29/2021  
DATE 12/29/2021  
RELEASE SUBMIT FOR PERMIT

PV-100R  
PV ARRAY LAYOUT

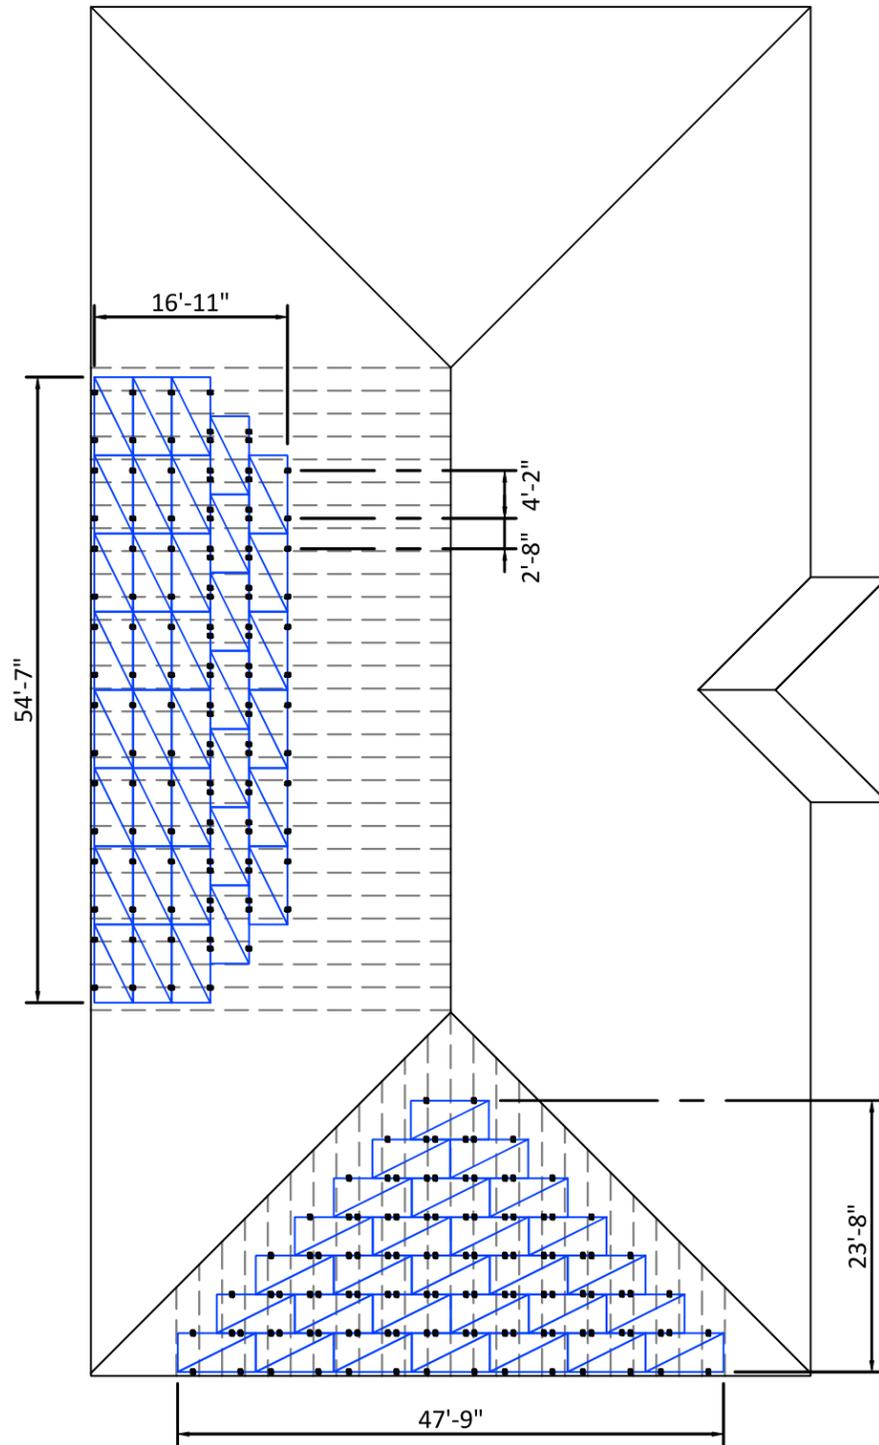


QTY 65 Q-Cell Q.PEAK DUO L-G6.2 425 MODULES, QTY 65 Enphase IQ7A-72-2-US (240V) MICRO INVERTER



**SHEET NOTES**

- A. FOR MANUFACTURED PLATED WOOD TRUSSES AT SLOPES OF FLAT TO 6:12, THE HORIZONTAL ANCHOR SPACING SHALL NOT EXCEED n/a AND ANCHORS IN ADJACENT ROWS SHALL BE STAGGERED. UNLESS NOTED OTHERWISE PER RACKING MANUFACTURER CERTIFIED ENGINEERED PRODUCT AND LOCAL REQUIREMENTS.
- B. ANCHORS ARE ALSO KNOWN AS "STAND-OFFS," "MOUNTS," OR "STANCHIONS." HORIZONTAL ANCHOR SPACING IS ALSO KNOWN AS "CROSS-SLOPE" OR "EAST-WEST" ANCHOR SPACING. MAXIMUM HORIZONTAL ANCHOR SPACING SHOWN IN DETAIL. UNLESS NOTED OTHERWISE PER RACKING MANUFACTURER CERTIFIED ENGINEERED PRODUCT AND LOCAL REQUIREMENTS. SEE "TABLE OF DIMENSIONS" EACH SECTION DETAILED FOR HORIZONTAL ANCHOR SPACING.
- C. SEE SHEET S-200 FOR SPECIFIC RACKING COMPONENT MANUFACTURERS.

**PV RACKING LEGEND**

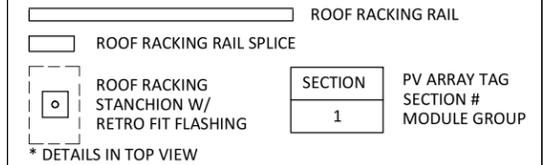

**EXISTING ROOF CONSTRUCTION**

COMPONENT	TYPE
ROOF STRUCTURAL CONSTRUCTION	Rafter - Cathedral Ceiling 24" O.C.
FRAMING INFO	2"x6" @ 24" MAX OC
ROOFING COVERING	Comp Shingle
RACKING MAX PSF	2.99 PSF

**RACKING BILL OF MATERIALS (BOM)**

COMPONENT	QTY	MODEL	LENGTH
PV RAIL 1			
PV RAIL SPLICE 1			
PV RAIL 2			
PV RAIL SPLICE 2			
RAIL TO ROOF ATTACHMENT			

27.625 kW PHOTOVOLTAIC PLANS

NAME LSCV455-MO

ADDRESS 455 SW Ward Rd

ADDRESS Lee's Summit, MO 64081

APN

Sun Smart Technologies 000002021-00077  
701 NE 76th Street  
Gladstone, MO 64118  
(816) 509-0943

REV DATE RELEASE  
12/29/2021 SUBMIT FOR PERMIT


S-100

RACKING LAYOUT

\* EXISTING ROOF DIMENSIONS ARE APPROX. CONFIRM ALL DIMENSIONS SHOWN

SCALE:1/16"=1'-0" @ SHEET SIZE A3

**1 CATHEDRAL CEILING / RAFTER - PORTRAIT SCALE: NTS**

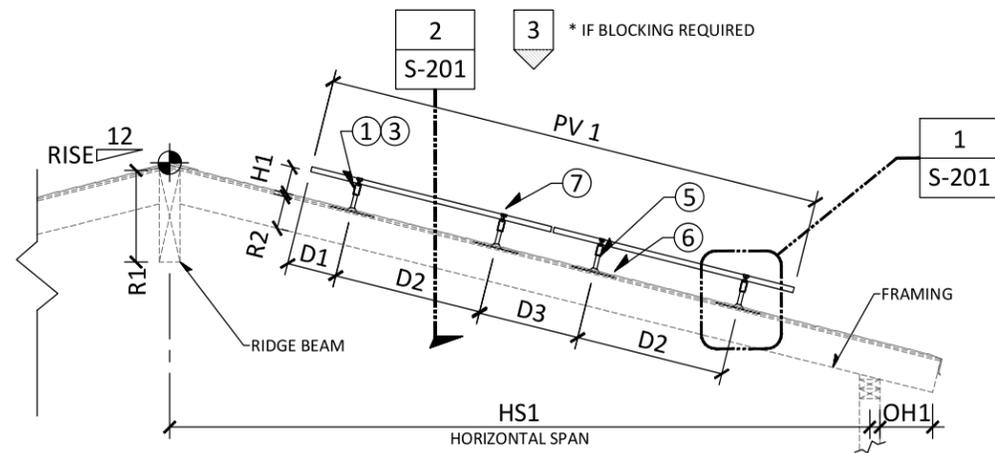


\*\* COMP SHINGLE ROOF IN EXAMPLE. SAME ATTACHMENT FOR STANDING SEAM METAL ROOF APPLIES.

**TABLE OF DIMENSIONS**

DIM	COMPONENT	DIMENSIONS	DIM	COMPONENT	DIMENSIONS
OH1	OVERHANG IN THIS AREA		R1	RIDGE BEAM DEPTH	5 1/2"
RISE	ROOF PITCH	22.6°	R2	RAFTER DEPTH THIS AREA	6"
H1	PV MODULE HGT. ABOVE ROOF	3" - 6" TYP	HS1	HORIZONTAL SPAN	
	MAX RAFTER SPAN	11'-9" MAX	HS2	HORIZONTAL SPAN	
UPSLOPE ANCHOR SPACING					
D1	RAIL OVERHANG	20.48"	D3	STANCHION O.C.	41.2"
D2	STANCHION O.C.	40.95"	D4	MIN./MAX. STANCHION O.C.	

**2 CATHEDRAL CEILING / RAFTER - LANDSCAPE SCALE: NTS**

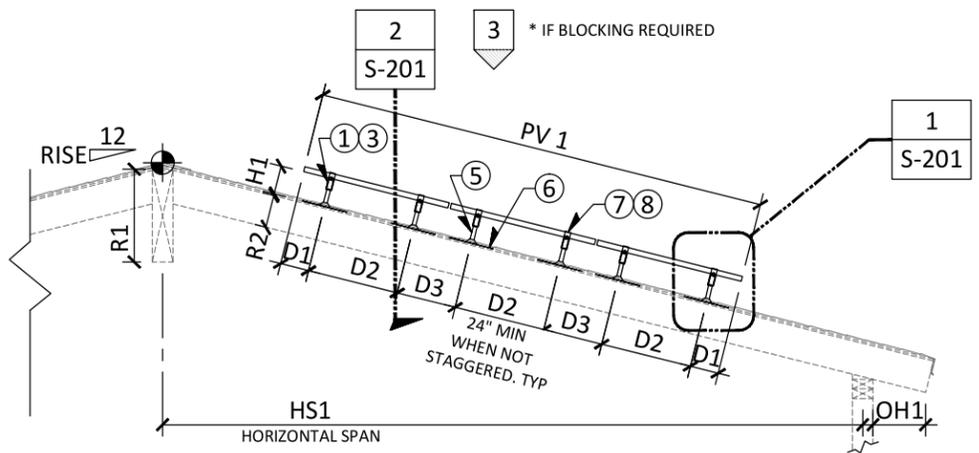

\*\* COMP SHINGLE ROOF IN EXAMPLE. SAME ATTACHMENT FOR STANDING SEAM METAL ROOF APPLIES.

**TABLE OF DIMENSIONS**


DIM	COMPONENT	DIMENSIONS	DIM	COMPONENT	DIMENSIONS
OH1	OVERHANG IN THIS AREA		R1	RIDGE BEAM DEPTH	5 1/2"
RISE	ROOF PITCH	22.6°	R2	RAFTER DEPTH THIS AREA	6"
H1	PV MODULE HGT. ABOVE ROOF	3" - 6" TYP	HS1	HORIZONTAL SPAN	
	MAX RAFTER SPAN	11'-9" MAX	HS2	HORIZONTAL SPAN	
UPSLOPE ANCHOR SPACING					
D1	RAIL OVERHANG	10.15"	D3	STANCHION O.C.	20.55"
D2	STANCHION O.C.	20.3"	D4	MIN./MAX. STANCHION O.C.	

**SHEET NOTES**

- A. THESE NOTES APPLY TO RAFTER ROOF CONSTRUCTION.
- B. THE ROOF STRUCTURE CONFORMED TO BUILDING CODE REQUIREMENTS AT THE TIME IT WAS BUILT.
- C. THE ROOF SHEATHING IS AT LEAST 7/16" THICK ORIENTED STRAND BOARD OR PLYWOOD. 1X SKIP SHEATHING IS ACCEPTABLE.
- D. THE SOLAR ARRAY DISPLACES ROOF LIVE LOADS (TEMPORARY CONSTRUCTION LOADS) THAT THE ROOF WAS ORIGINALLY DESIGNED TO CARRY.
- E. IF THE ROOF COVERING IS SHINGLES; IT SHALL BE NO MORE THAN TWO LAYERS. (SHOWN)
- F. IF ROOF COVERING IS TILE; ITS A SINGLE LAYER. ALL TILES ON PLANE OF PV COMPONENTS ARE SECURE. (NOT SHOWN IN DETAIL)
- G. THE ROOF STRUCTURE IS STRUCTURALLY SOUND, WITHOUT SIGNS OF ALTERATIONS OR SIGNIFICANT STRUCTURAL DETERIORATION OR SAGGING.
- H. THE PV MODULES ARE PARALLEL WITH THE ROOF SURFACE.
- I. THERE IS A 2" TO 10" GAP BETWEEN UNDERSIDE OF MODULE AND THE ROOF SURFACE. (SEE TABLE OF DIMENSIONS "H1")
- J. UPSLOPE ANCHOR SPACING MAY VARY FROM LISTED TABLES. STANCHIONS CAN BE PLACED NO CLOSER THAN 24" O.C.
- K. DETAILS SHOWN ARE A REPRESENTATION OF EXISTING ROOF CONDITIONS. ACTUAL FIELD CONDITIONS MAY VARY. DETAILS ARE SHOWN FOR DIAGRAM USE ONLY. REFER TO TABLES FOR DESIGN CRITERIA.
- L. ALL PLUMBING AND ROOF VENTS SHALL NOT BE OBSTRUCTED BY PV MODULES AND EQUIPMENT.
- M.

**3 RAFTER HOLE AND CONSTRUCTION DETAIL SCALE: NTS**


NOTE: WHERE FRAMING IS VISIBLE FROM ATTIC &/OR UNDERSIDE OF ROOF, VISUALLY REVIEW FRAMING TO VERIFY THAT NO SIGNIFICANT STRUCTURAL DECAY OR UN-REPAIRED FIRE DAMAGE EXISTS.

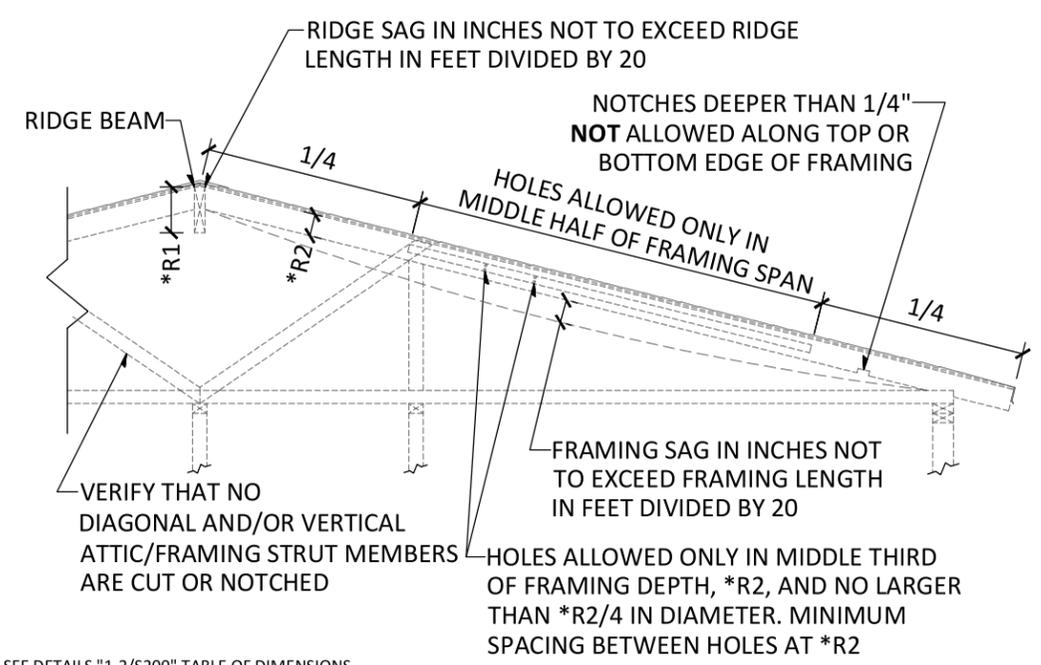

\* SEE DETAILS "1-2/S200" TABLE OF DIMENSIONS

**4 ATTACHMENT SPACING DETAILS SCALE: NTS**

NOTE: ATTACHEMENT WILL BE INSTALLED ON THE ROOF DECKING NOT ON THE RAFTERS

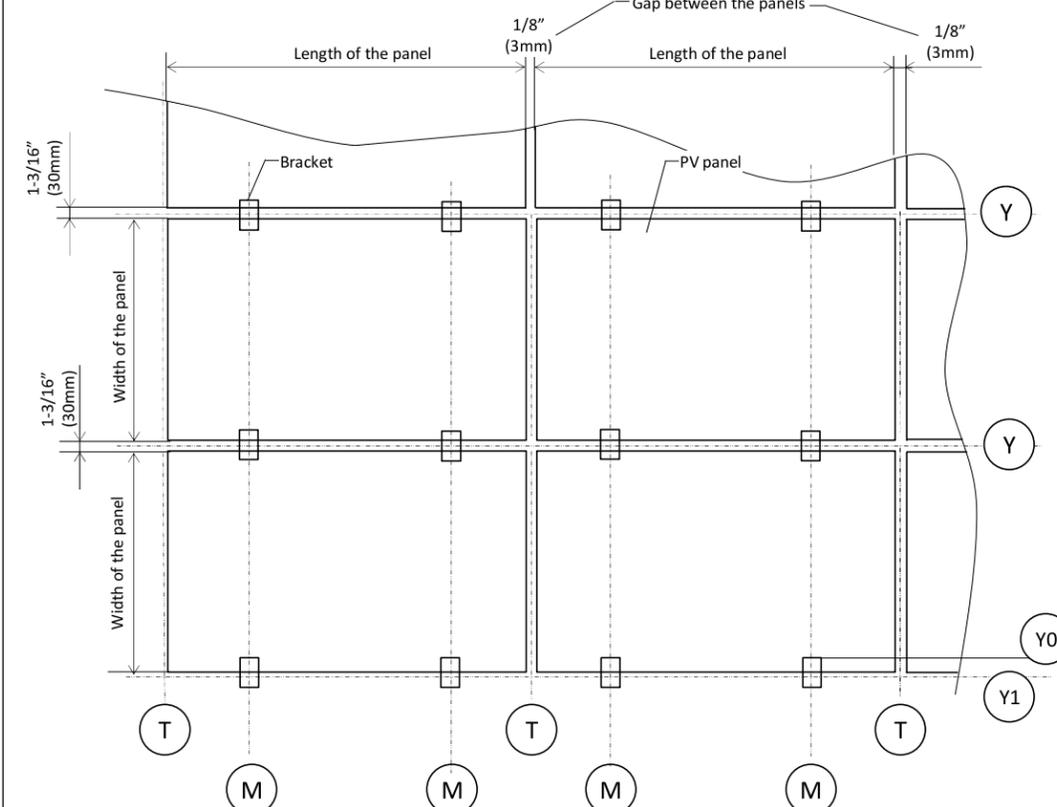

**PV RACKING LEGEND**

- ROOF RACKING RAIL
- ROOF RACKING RAIL SPLICE
- ROOF RACKING STANCHION W/ RETRO FIT FLASHING
- SECTION 1
- PV ARRAY TAG SECTION #
- MODULE GROUP

\* DETAILS IN SECTION OR SIDE VIEW

**EXISTING ROOF CONSTRUCTION**

COMPONENT	TYPE
MEAN ROOF HGT MAX	15'
ROOFING COVERING	Comp Shingle

**TABLE OF COMPONENTS**


#	COMPONENT	MODEL
1	PV RAIL TYPE 1	E Mount Air
2	PV RAIL SPLICE TYPE 1	PER RAIL MANUFACTURER
3	PV RAIL TYPE 2	NOT USED
4	PV RAIL SPLICE TYPE 2	PER RAIL MANUFACTURER
5	STANCHION	E Mount Air
6	FLASHING	Integrated
7	MID CLAMP	PER RAIL MANUFACTURER
8	END CLAMP	PER RAIL MANUFACTURER

**27.625 kW PHOTOVOLTAIC PLANS**  
 Sun Smart Technologies  
 00002021-00077  
 701 NE 76th Street  
 Gladstone, MO 64118  
 (816) 509-0943

RELEASE DATE: 12/29/2021  
 SUBMIT FOR PERMIT

NAME: LSCV455-MO  
 ADDRESS: 455 SW Ward Rd  
 ADDRESS: Lee's Summit, MO 64081  
 APN:

**S-200**  
**SECTION ELEVATIONS**

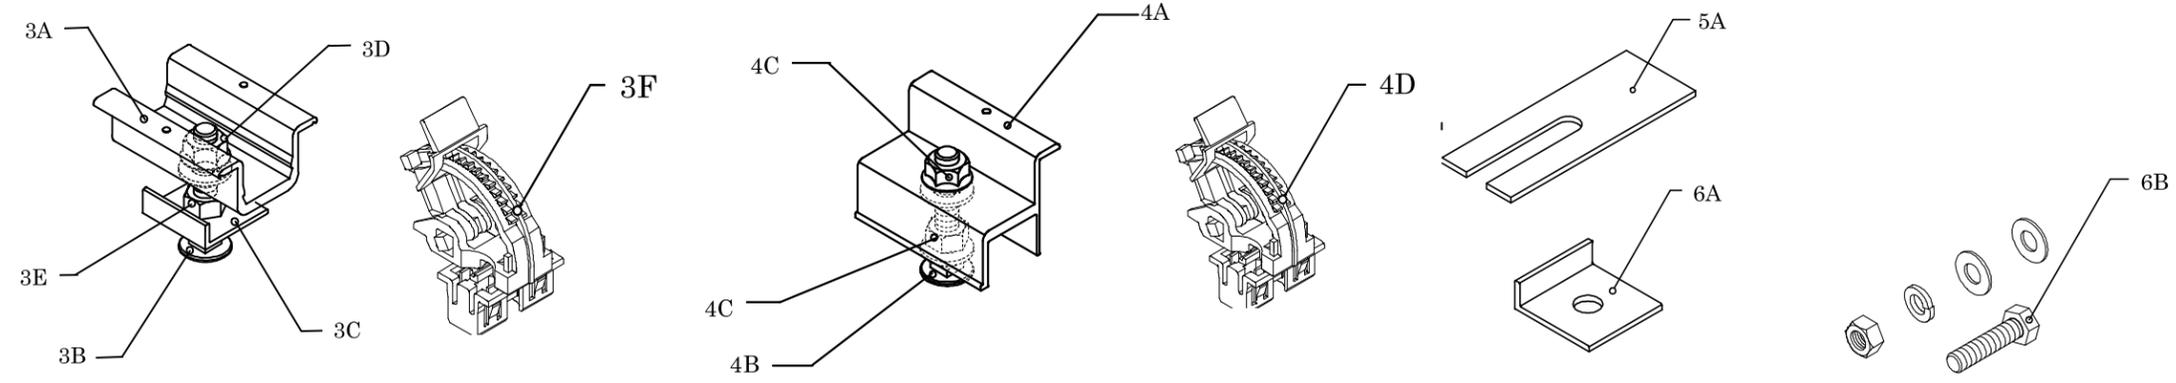

③ Middle Clamp Kit

Item	Item
3A	Middle Clamp
3B	Carriage Bolt set M8**
3C	Panel Spacer
3D	Flange Nut
3E	Hex Nut
3F	Cable Holder

④ End Clamp Kit

Item	Item
4A	End Clamp
4B	Carriage Bolt set M8**
4C	Flange Nut
4D	Cable Holder

※ The nuts in RTM-MCB45BK-B-00 are silver and black.  
The nuts in RTM-MCB50 and 55BK-B-00 are black.

⑤ Shims

Item	Item
5A	Shim


⑥ Stopper Set (Portrait only)

Item	Item
6A	Stopper
6B	M6-25 Bolt Set


SHEET NOTES

- A MINIMUM OF (1) 5/16" DIAMETER LAG SCREWS WITH 2.5" EMBEDMENT INTO THE RAFTER USED, OR THE ANCHOR FASTENER MUST MEET THE MANUFACTURER'S ENGINEERING.
- ADHERE TO RACKING MANUFACTURERS INSTALLATION INSTRUCTIONS PERTAINING TO CANTILEVER.

PV RACKING LEGEND

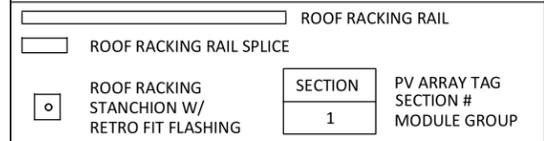

\* DETAILS IN SECTION OR SIDE VIEW

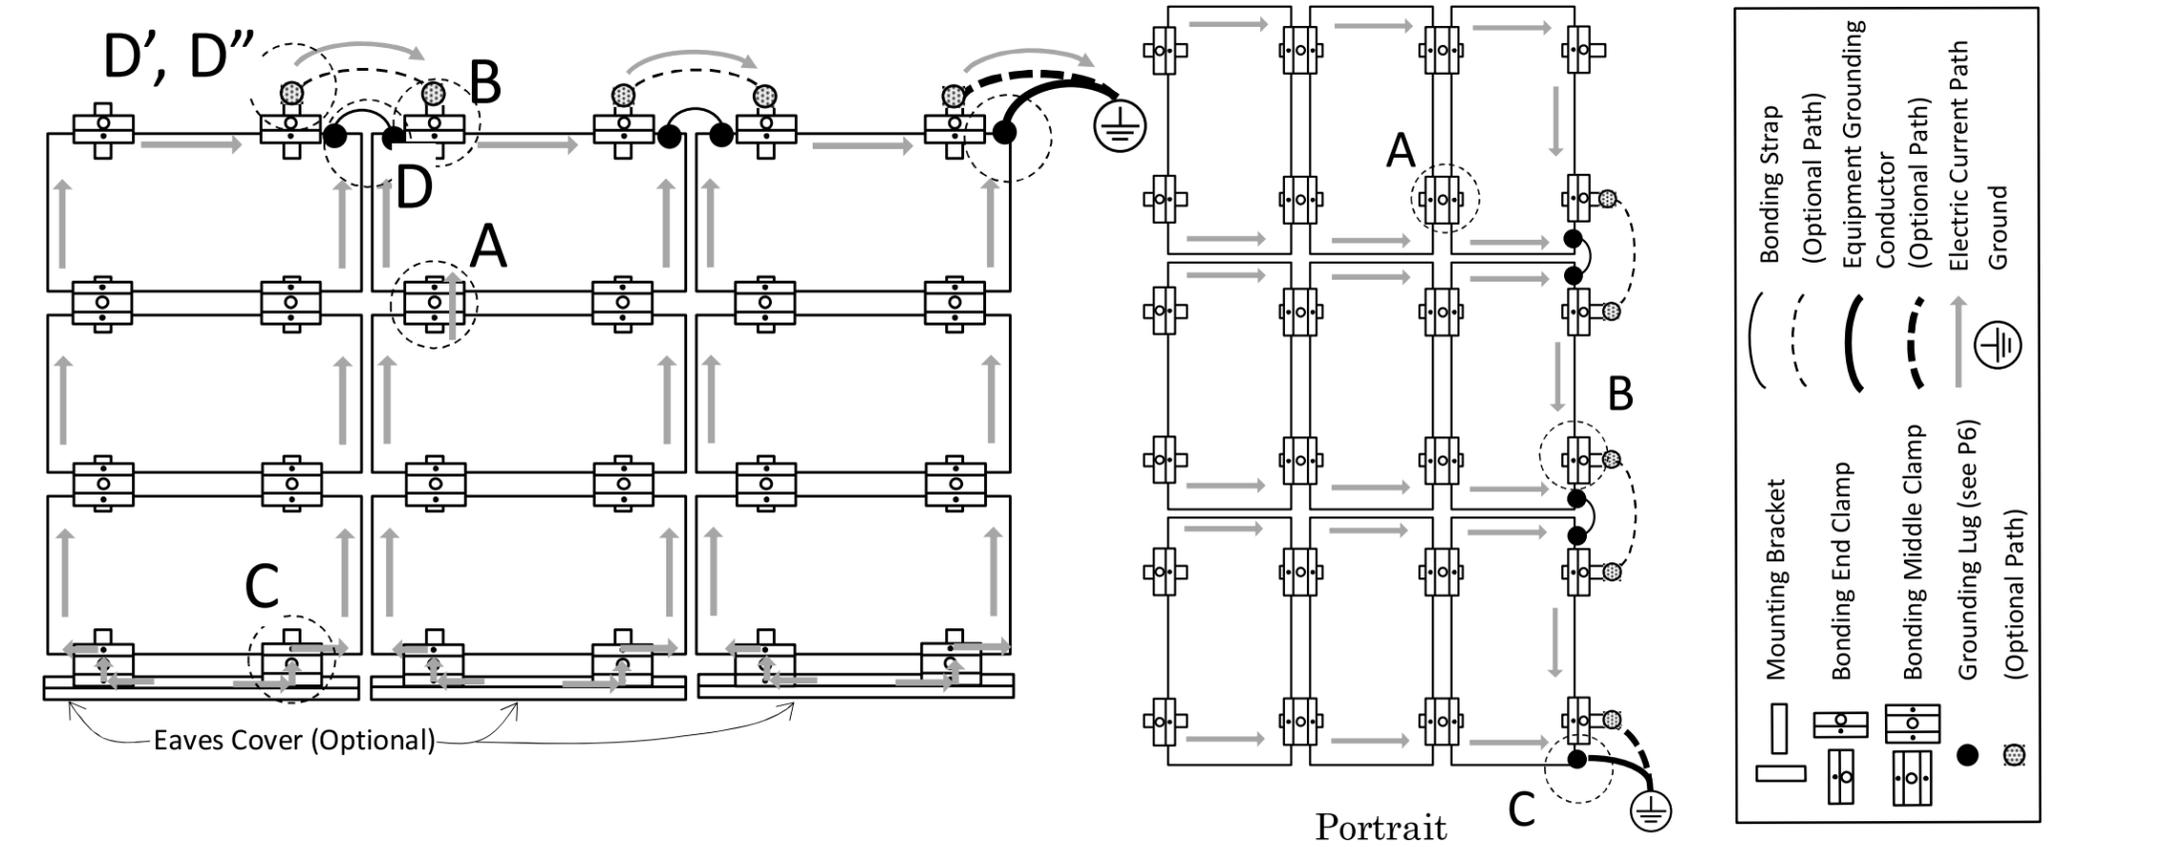

Sun Smart Technologies 000002021-00077 701 NE 76th Street Gladstone, MO 64118 (816) 509-0943	27.625 kW PHOTOVOLTAIC PLANS		RELEASE	ATTACHMENT DETAILS
	NAME	LSCV455-MO	DATE	
	ADDRESS	455 SW Ward Rd	REV	S-201
	ADDRESS	Lee's Summit, MO 64081		
	APN			

PV MODULE #1 SPECIFICATIONS		
MANUFACTURER	Q-Cell	
MODEL NUMBER	Q.PEAK DUO L-G6.2 425	
WEIGHT	55.1	lbs
DIMENSIONS	81.9 x 40.6 x 1.38	L" x W" x D"/THICK
PEAK POWER @ STC (Pmax)	425	WATTS
Voc (OPEN-CIRCUIT VOLTAGE)	49.13	VOLTS DC
Vmp (MAX-POWER VOLTAGE)	41.20	VOLTS DC
isc (SHORT-CIRCUIT CURRENT)	10.83	AMPS
imp (SHORT-CIRCUIT POWER)	10.32	AMPS
MFR. Voc TEMP COEFFICIENT	-0.27	%/K
MAX SERIES FUSE RATING	20.0	AMPS
TEMP. CORRECTED Voc	55.03	VOLTS DC

MICRO INVERTER #1 SPECIFICATIONS		
MANUFACTURER	Enphase	
MODEL NUMBER	IQ7A-72-2-US (240V)	
NOMINAL POWER RATING	349	WATT AC
WEIGHT	2.38	lbs.
DC INPUT		
Max PV POWER @ MODULE STC	349	WATTS
Max INPUT DC VOLTAGE	58	VOLTS DC
Max INPUT CURRENT	15.0	AMPS
MODULES PER MICRO INVERTER	1	QTY
AC OUTPUT		
NOMINAL VOLTAGE OUTPUT	240	VOLTS AC
MAX OVERCURRENT PROTECTION (OCPD)	20	AMPS
MAX. OUTPUT CURRENT	1.45	AMPS - MAX

AC COMBINER (SOLAR LOAD CENTER)		
MANUFACTURER	Enphase	
MODEL NUMBER	X-IQ-AM1-240-3	
RATED OPERATIONAL VOLTAGE	240	VOLTS
RATED CURRENT	125	AMPS
NUMBER OF POLES	2	P
NEMA RATING	3R	
MAIN BREAKER SIZE	N/A	AMPS
TOTAL INPUT CURRENT	14.5, 13.05, 11.6, 8.7, 37.7	AMPS
NUMBER OF BRANCH CIRCUITS	1, 3	CIRCUITS
QUANTITY	6	AC COMBINER(S)

AC SUB-PANEL #1 (IF APPL.)		
NEW OR EXISTING	EXISTING	
MAKE / MODEL	100A BUS / Main Lug Only	
TYPE OF PANEL		
NUMBER OF POLES	2	P
NEMA RATING	3R	
BUSS BAR RATING	100	AMPS
SUB-PANEL MAIN BREAKER	100	AMPS
MAIN SERVICE PANEL P.O.C. BREAKER	N/A	AMPS
SUM OF EXISTING CIRCUIT BREAKERS		AMPS
MAX ALLOWABLE SOLAR CURRENT	20, 50	AMPS
PV BACKFEED BREAKER #1		AMPS (Imax)
PV BACKFEED BREAKER #2		AMPS (Imax)

AC DISCONNECT #1 (IF APPL.)		
MANUFACTURER	Generic	
MODEL NUMBER	60A Fused Exterior	
QUANTITY	1	AC DISCO.(S)
DISCONNECT DEVICE TYPE	Fusible	
RATED OPERATIONAL VOLTAGE	240	VOLTS
RATED CURRENT	60	AMPS
NUMBER OF POLES	2	P
NEMA RATING	3R	
FUSE RATING	50	AMPS
TOTAL INPUT CURRENT	37.7	AMPS

AC SUB-PANEL #2 (IF APPL.)		
NEW OR EXISTING		
MAKE / MODEL		
TYPE OF PANEL		
NUMBER OF POLES		P
NEMA RATING		
BUSS BAR RATING	AMPS	
SUB-PANEL MAIN BREAKER	AMPS	
MAIN SERVICE PANEL P.O.C. BREAKER	AMPS	
SUM OF EXISTING CIRCUIT BREAKERS	AMPS	
MAX ALLOWABLE SOLAR CURRENT	AMPS	
PV BACKFEED BREAKER #1	AMPS (Imax)	
PV BACKFEED BREAKER #2	AMPS (Imax)	

AC DISCONNECT #2 (IF APPL.)		
MANUFACTURER	Generic	
MODEL NUMBER	30A Fused Exterior	
QUANTITY	5	AC DISCO.(S)
DISCONNECT DEVICE TYPE	Fusible	
RATED OPERATIONAL VOLTAGE	240	VOLTS
RATED CURRENT	30	AMPS
NUMBER OF POLES	2	P
NEMA RATING	3	
FUSE RATING	20	AMPS
TOTAL INPUT CURRENT	14.5, 13.05, 11.6, 8.7	AMPS

MAIN SERVICE PANEL (METER/MAIN ONLY)		
NEW OR EXISTING	EXISTING	
ELECTRICAL SERVICE	120/240V Single Phase	
BUSS BAR RATED CURRENT	N/A	AMPS
MAIN BREAKER RATED CURRENT	100, 70	AMPS
SUM OF EXISTING CIRCUIT BREAKERS		AMPS
MAX ALLOWABLE SOLAR CURRENT 100%	N/A	AMPS
MAX ALLOWABLE SOLAR CURRENT 120%	N/A	AMPS (Imax)
PV BACKFEED BREAKER #1		AMPS (Imax)
PV BACKFEED BREAKER #2		AMPS (Imax)
QUANTITY	6	



sealed 06jan2022 mike@h2dc.com  
H2DC PLLC MO CoA#: 2017002700  
ELECTRICAL ONLY  
-NOT AN AS BUILT DRAWING SET-

NOTES APPENDIX (AS APPLICABLE): (A) TOTAL AC VOLTAGE DROP NOT TO EXCEED 2% TO INTERCONNECTION, < 3% FROM INVERTER(S) TO UTILITY TRANSFORMER. (B) ALL CONNECTORS 75C RATED. (C) ALL CONDUCTORS COPPER, UNLESS OTHERWISE NOTED. DUE TO HIGHER COEFFICIENT OF EXPANSION, ALUMINUM CONDUCTORS REQUIRE MORE MAINTENANCE/INSPECTION THAN COPPER CONDUCTORS. ANNUAL RETORQUEING AS WELL AS INFRARED INSPECTION, MINIMALLY. BE CAREFUL NOT TO CONNECT ALUMINUM WITH COPPER RATED CONDUCTORS OR FITTINGS DURING CONSTRUCTION, TERMINALS SHOULD BE DUAL RATED. (D) OUTDOOR EQUIPMENT NEMA3R. (E) ALL CONDUCTORS FOR PV SYSTEMS MUST BE PROTECTED FROM ACCESS BY A FENCE OR SUITABLE COVER, OR OUT OF REACH. (F) PROPERTY LINES, BOUNDARIES AND ALL OTHER EXTERIOR MEASUREMENTS ARE FOR REFERENCE ONLY, AND MUST BE VERIFIED BY A LICENSED SURVEYOR OR CIVIL ENGINEER. (G) ENERGY STORAGE SYSTEMS ARE REQUIRED TO BE INSTALLED IN LOCATIONS IN COMPLIANCE WITH THEIR LISTING REQUIREMENTS. (H) IF TRAVEL ACROSS A ROOF IS LIMITED TO FIRE SETBACK AREAS, FALL RESTRAINT SYSTEMS MAY BE REQUIRED. (I) NO PVC ALLOWED ON ROOF OR IN ATTIC. (J) MC4 CONNECTORS MAY NOT BE JOINED WITH 'MC4 COMPATIBLE' CONNECTORS. (K) FOR COMMERCIAL SYSTEMS - UNDER MODULE WIRE MANAGEMENT SYSTEMS ARE REQUIRED, RACEWAY FILL MUST NOT EXCEED 40% REFER TO LOCAL REGULATIONS FOR EXCEPTIONS. (L) FOR LINE SIDE TAPS, CONNECTION IN PANEL MUST NOT VIOLATE CONDITIONS OF ACCEPTABILITY FROM PANEL MANUFACTURER'S NRTL LISTING, OR FIELD LABEL REQUIRED. (M) PV WIRES MAY NOT BE LAID DIRECTLY ON ROOF, WIRE MANAGEMENT SUCH AS SNAKE TRAY, ETC. MUST BE USED 40% FILL MAX. (N) TY WRAPS FOR WIRE MANAGEMENT MUST BE STRUCTURAL (S21) UL APPROVED, OR SUN BUNDLER OR EQUAL. (O) DRAWINGS ARE DIAGRAMMATIC AND INDICATE GENERAL ARRANGEMENT OF SYSTEMS AND WORK. CONDUIT ROUTING, WHEN INDICATED, IS SHOWN DIAGRAMMATICALLY AND DOES NOT SHOW ALL OFFSETS, DROPS, AND RISES OF RUNS. THE CONTRACTOR SHALL ALLOW IN HIS PRICE FOR ROUTING OF CONDUIT TO AVOID OBSTRUCTIONS.

PV SYSTEM MAXIMUM VOLTAGE (MODULE Voc <sub>MAX</sub> )											
DATA SOURCE		SOLARBCS.ORG/ABOUT/PUBLICATIONS/REPORTS/ EXPEDITED-PERMIT/MAP/									
EXTREME MIN. TEMP. [°C]	STC TEMPERATURE [°C]	CORRECTED TEMPERATURE	MFR. P <sub>MAX</sub> TEMP COEFFICIENT [-0.0%/C] * 100	FORMULA	CORRECTED TEMP. COEFFICIENT	MODULE Voc [VDC]	TEMPERATURE CORRECTED OPEN CIRCUIT VOLTAGE				
-20	-	25	=	-45 * -0.27%	=	0.12 + 1	1.12 * 49.13 =	55.03			

Sun Smart Technologies 00002021-00077 701 NE 76th Street Gladstone, MO 64118 (816) 509-0943	27.625 kW PHOTOVOLTAIC PLANS	DATE	12/29/2021	RELEASE	SUBMIT FOR PERMIT	EQUIP. CALCULATIONS
	NAME	LSCV455-MO	ADDRESS	455 SW Ward Rd	ADDRESS	
	APN					E-001

**WIRE AND CONDUCTOR NOTES**

1. ANY CONDUCTOR LENGTH UNDER 50' DOESN'T REQUIRE VOLTAGE DROP CALCULATIONS
2. BECAUSE WE ARE UNABLE TO DETERMINE THE EXACT PATH THE INSTALLER WILL RUN CONDUCTORS; WORST CASE SCENARIOS, ROUNDING UP SIZES OF CONDUCTORS THAT ARE DEEMED QUESTIONABLE TO PREVENT ISSUES RELATED TO USING CONDUCTORS THAT ARE IMPROPERLY SIZED.
3. WIRING METHODS IN THESE CALCULATIONS DON'T EXCEED 1000 VOLTS
4. CEC/NEC 310.15(A)(2) (AS APPLICABLE) WHERE TWO DIFFERENT AMPACITIES APPLY TO ADJACENT PORTIONS OF A CIRCUIT, THE HIGHER AMPACITY SHALL BE PERMITTED TO BE USED BEYOND THE POINT OF TRANSITION, A DISTANCE EQUAL TO 10'-0" (3 METERS) OR 10% OF THE CIRCUIT LENGTH FIGURED AT THE HIGHER AMPACITY, WHICHEVER IS LESS. WHEN LESS THAN 10'-0" OR 10% OF THE CIRCUIT LENGTH; THE LESSER AMPACITY MAY BE USED.

**WIRE COLOR CODING (2017) NEC SECTIONS 250.119 & 200.6**

PV DC WIRING		AC WIRING	
EQUIPMENT GROUND	GREEN OR BARE, OR GREEN/YELLOW	EQUIPMENT GROUND	GREEN OR BARE, OR GREEN/YELLOW
GROUNDING CONDUCTOR, TYPICALLY NEGATIVE	WHITE OR GRAY	GROUNDING CONDUCTOR (NEUTRAL)	WHITE OR GRAY
UNGROUNDING CONDUCTOR(S), TYPICALLY POSITIVE	ANY COLOR OTHER THAN GREEN OR WHITE/GRAY	UNGROUNDING CONDUCTOR(S) HOT: L1 AND L2	ANY COLOR OTHER THAN GREEN OR WHITE/GRAY ALLOWED.
	CONVENTION IS RED FOR GROUNDING SYSTEMS		CONVENTION IS L1 BLACK
	RED (+) AND BLACK (-) FOR UNGROUNDING SYSTEMS		CONVENTION IS L2 RED

**DC WIRE AND CONDUIT SIZING CHART [SEE SHEET E-003 FOR THREE LINE DIAGRAM]**

TAG	CIRCUIT ORIGIN	CIRCUIT DESTINATION	CONDUCTOR SPECIFICATIONS				REQUIRED CONDUCTOR AMPACITY					CONDUCTOR TEMPERATURE DERATING					CONDUIT FILL DERATING		CORRECTED AMPACITY CALCULATION					AMPACITY CHECK									
			QTY IN PARALLEL & MATERIAL	TEMP RATING (°C)	TRADE SIZE	AMPACITY @ 30°C PER 310.16	Isc (AMPS) OR COMPONENT (AMPS)	X	#OF COMBINED PARALLEL CIRCUITS	X	MAX CURRENT 690.8 (A)(1)	X	CONT. OPERATION 690.8 (B)(1)	=	REQUIRED AMPACITY	CIRCUIT ENVIRONMENT	AMBIENT TEMP. (°C)	HGT. ABOVE ROOF (in)	TEMP. ADDER PER 310.15 (B)(2)(c)	OPERAT. TEMP. (°C)	AMPACITY CORRECTION 310.15 (B)(2)(a)	# OF UNGRND. COND.	AMPACITY CORRECTION 310.15 (B)(3)(a)	COND. AMPACITY	X	TEMP. DERATING	X	CONDUIT FILL DERATING	=	CORRECTED AMPACITY	REQUIRED AMPACITY	≤	CORRECTED AMPACITY
DC1	PV MODULE	INVERTER	(1) CU	90	#12 AWG	30	10.83	X	1	X	1.25	X	1.25	=	16.9	ROOFTOP	37	>7/8"	0	37	0.91	2	N/A	30	X	0.71	X	1.0	=	21.3	16.9	≤	21.3



sealed 06jan2022 mike@h2dc.com  
H2DC PLLC MO CoA#: 2017002700  
ELECTRICAL ONLY  
-NOT AN AS BUILT DRAWING SET-

RELEASE DATE 12/29/2021 SUBMIT FOR PERMIT

REV

27.625 kW PHOTOVOLTAIC PLANS

NAME LSCV455-MO

ADDRESS 455 SW Ward Rd

ADDRESS Lee's Summit, MO 64081

APN

E-002A

WIRE AND COND. CALCS.

**AC WIRE AND CONDUIT FILL DERATE CHART [SEE SHEET E-003 FOR THREE LINE DIAGRAM]**

TAG	CIRCUIT ORIGIN	CIRCUIT DESTINATION	CONDUCTOR SPECIFICATIONS				REQUIRED CONDUCTOR AMPACITY				CONDUCTOR TEMPERATURE DERATING					CONDUIT FILL DERATING		CORRECTED AMPACITY CALCULATION					AMPACITY CHECK						
			QTY IN PARALLEL & MATERIAL	TEMP RATING (°C)	TRADE SIZE	AMPACITY @ 30°C PER 310.16	CONT. OPERATION 690.8 (B)(1)	X	MAX INV. OUTPUT CURRENT (AMPS) OR COMPONENT (AMPS)	=	REQUIRED AMPACITY	CIRCUIT ENVIRONMENT	AMBIENT TEMP. (°C)	HGT. ABOVE ROOF (in)	TEMP. ADDER PER 310.15 (B)(2)(c)	OPERAT. TEMP. (°C)	AMPACITY CORRECTION 310.15 (B)(2)(a)	# OF UNGRND. COND.	AMPACITY CORRECTION 310.15 (B)(3)(a)	COND. AMPACITY	X	TEMP. DERATING	X	CONDUIT FILL DERATING	=	CORRECTED AMPACITY	REQUIRED AMPACITY	≤	CORRECTED AMPACITY
AC1	INVERTER	JUNCTION BOX	(1) CU	75	#12 AWG	25	1.25	X	14.5	=	18.1	ROOFTOP	37	>7/8"	0	37	0.88	2	N/A	25	X	0.88	X	1.0	=	22	18.1	≤	22
AC2	JUNCTION BOX	AC COMBINER	(1) CU	75	#10 AWG	35	1.25	X	14.5	=	18.1	ROOFTOP	37	>7/8"	0	37	0.88	2	1.0	35	X	0.88	X	1.0	=	30.8	18.1	≤	30.8
AC3	AC COMBINER	AC DISCONNECT	(1) CU	75	#10 AWG	35	1.25	X	14.5	=	18.1	EXT WALL	37	N/A	0	37	0.88	3	1.0	35	X	0.88	X	1.0	=	30.8	18.1	≤	30.8
AC4	AC DISCONNECT	EXISTING SERVICE PANEL	(1) CU	75	#10 AWG	35	1.25	X	14.5	=	18.1	EXT WALL	37	N/A	0	37	0.88	3	1.0	35	X	0.88	X	1.0	=	30.8	18.1	≤	30.8
AC5								X		=										X		X		=			≤		
AC6								X		=										X		X		=			≤		
AC7								X		=										X		X		=			≤		
AC8								X		=										X		X		=			≤		
AC9								X		=										X		X		=			≤		
AC10								X		=										X		X		=			≤		

00002021-00077

Sun Smart Technologies

701 NE 76th Street  
Gladstone, MO 64118  
(816) 509-0943



**WIRE AND CONDUCTOR NOTES**

1. ANY CONDUCTOR LENGTH UNDER 50' DOESN'T REQUIRE VOLTAGE DROP CALCULATIONS
2. BECAUSE WE ARE UNABLE TO DETERMINE THE EXACT PATH THE INSTALLER WILL RUN CONDUCTORS; WORST CASE SCENARIOS, ROUNDING UP SIZES OF CONDUCTORS THAT ARE DEEMED QUESTIONABLE TO PREVENT ISSUES RELATED TO USING CONDUCTORS THAT ARE IMPROPERLY SIZED.
3. WIRING METHODS IN THESE CALCULATIONS DON'T EXCEED 1000 VOLTS
4. CEC/NEC 310.15(A)(2) (AS APPLICABLE) WHERE TWO DIFFERENT AMPACITIES APPLY TO ADJACENT PORTIONS OF A CIRCUIT, THE HIGHER AMPACITY SHALL BE PERMITTED TO BE USED BEYOND THE POINT OF TRANSITION, A DISTANCE EQUAL TO 10'-0" (3 METERS) OR 10% OF THE CIRCUIT LENGTH FIGURED AT THE HIGHER AMPACITY, WHICHEVER IS LESS. WHEN LESS THAN 10'-0" OR 10% OF THE CIRCUIT LENGTH; THE LESSER AMPACITY MAY BE USED.

**WIRE COLOR CODING (2017) NEC SECTIONS 250.119 & 200.6**

PV DC WIRING		AC WIRING	
EQUIPMENT GROUND	GREEN OR BARE, OR GREEN/YELLOW	EQUIPMENT GROUND	GREEN OR BARE, OR GREEN/YELLOW
GROUNDING CONDUCTOR, TYPICALLY NEGATIVE	WHITE OR GRAY	GROUNDING CONDUCTOR (NEUTRAL)	WHITE OR GRAY
UNGROUNDING CONDUCTOR(S), TYPICALLY POSITIVE	ANY COLOR OTHER THAN GREEN OR WHITE/GRAY	UNGROUNDING CONDUCTOR(S) HOT: L1 AND L2	ANY COLOR OTHER THAN GREEN OR WHITE/GRAY ALLOWED.
	CONVENTION IS RED FOR GROUNDING SYSTEMS		CONVENTION IS L1 BLACK
	RED (+) AND BLACK (-) FOR UNGROUNDING SYSTEMS		CONVENTION IS L2 RED

**DC WIRE AND CONDUIT SIZING CHART [SEE SHEET E-003 FOR THREE LINE DIAGRAM]**

TAG	CIRCUIT ORIGIN	CIRCUIT DESTINATION	CONDUCTOR SPECIFICATIONS				REQUIRED CONDUCTOR AMPACITY					CONDUCTOR TEMPERATURE DERATING					CONDUIT FILL DERATING		CORRECTED AMPACITY CALCULATION					AMPACITY CHECK									
			QTY IN PARALLEL & MATERIAL	TEMP RATING (°C)	TRADE SIZE	AMPACITY @ 30°C PER 310.16	Isc (AMPS) OR COMPONENT (AMPS)	X	#OF COMBINED PARALLEL CIRCUITS	X	MAX CURRENT 690.8 (A)(1)	X	CONT. OPERATION 690.8 (B)(1)	=	REQUIRED AMPACITY	CIRCUIT ENVIRONMENT	AMBIENT TEMP. (°C)	HGT. ABOVE ROOF (in)	TEMP. ADDER PER 310.15 (B)(2)(c)	OPERAT. TEMP. (°C)	AMPACITY CORRECTION 310.15 (B)(2)(a)	# OF UNGRND. COND.	AMPACITY CORRECTION 310.15 (B)(3)(a)	COND. AMPACITY	X	TEMP. DERATING	X	CONDUIT FILL DERATING	=	CORRECTED AMPACITY	REQUIRED AMPACITY	≤	CORRECTED AMPACITY
DC1	PV MODULE	INVERTER	(1) CU	90	#12 AWG	30	10.83	X	1	X	1.25	X	1.25	=	16.9	ROOFTOP	37	>7/8"	0	37	0.91	2	N/A	30	X	0.71	X	1.0	=	21.3	16.9	≤	21.3



sealed 06jan2022 mike@h2dc.com  
 H2DC PLLC MO CoA#: 2017002700  
 ELECTRICAL ONLY  
 -NOT AN AS BUILT DRAWING SET-

RELEASE DATE 12/29/2021 SUBMIT FOR PERMIT

REV

27.625 kW PHOTOVOLTAIC PLANS

NAME LSCV455-MO

ADDRESS 455 SW Ward Rd

ADDRESS Lee's Summit, MO 64081

APN

E-002B

WIRE AND COND. CALCS.

**AC WIRE AND CONDUIT FILL DERATE CHART [SEE SHEET E-003 FOR THREE LINE DIAGRAM]**

TAG	CIRCUIT ORIGIN	CIRCUIT DESTINATION	CONDUCTOR SPECIFICATIONS				REQUIRED CONDUCTOR AMPACITY			CONDUCTOR TEMPERATURE DERATING					CONDUIT FILL DERATING		CORRECTED AMPACITY CALCULATION					AMPACITY CHECK							
			QTY IN PARALLEL & MATERIAL	TEMP RATING (°C)	TRADE SIZE	AMPACITY @ 30°C PER 310.16	CONT. OPERATION 690.8 (B)(1)	X	MAX INV. OUTPUT CURRENT (AMPS) OR COMPONENT (AMPS)	=	REQUIRED AMPACITY	CIRCUIT ENVIRONMENT	AMBIENT TEMP. (°C)	HGT. ABOVE ROOF (in)	TEMP. ADDER PER 310.15 (B)(2)(c)	OPERAT. TEMP. (°C)	AMPACITY CORRECTION 310.15 (B)(2)(a)	# OF UNGRND. COND.	AMPACITY CORRECTION 310.15 (B)(3)(a)	COND. AMPACITY	X	TEMP. DERATING	X	CONDUIT FILL DERATING	=	CORRECTED AMPACITY	REQUIRED AMPACITY	≤	CORRECTED AMPACITY
AC1	INVERTER	JUNCTION BOX	(1) CU	75	#12 AWG	25	1.25	X	13.05	=	16.3	ROOFTOP	37	>7/8"	0	37	0.88	2	N/A	25	X	0.88	X	1.0	=	22	16.3	≤	22
AC2	JUNCTION BOX	AC COMBINER	(1) CU	75	#10 AWG	35	1.25	X	13.05	=	16.3	ROOFTOP	37	>7/8"	0	37	0.88	2	1.0	35	X	0.88	X	1.0	=	30.8	16.3	≤	30.8
AC3	AC COMBINER	AC DISCONNECT	(1) CU	75	#10 AWG	35	1.25	X	13.05	=	16.3	EXT WALL	37	N/A	0	37	0.88	3	1.0	35	X	0.88	X	1.0	=	30.8	16.3	≤	30.8
AC4	AC DISCONNECT	EXISTING SERVICE PANEL	(1) CU	75	#10 AWG	35	1.25	X	13.05	=	16.3	EXT WALL	37	N/A	0	37	0.88	3	1.0	35	X	0.88	X	1.0	=	30.8	16.3	≤	30.8
AC5								X		=										X		X		=			≤		
AC6								X		=										X		X		=			≤		
AC7								X		=										X		X		=			≤		
AC8								X		=										X		X		=			≤		
AC9								X		=										X		X		=			≤		
AC10								X		=										X		X		=			≤		


00002021-00077

701 NE 76th Street

Gladstone, MO 64118

(816) 509-0943

Sun Smart Technologies

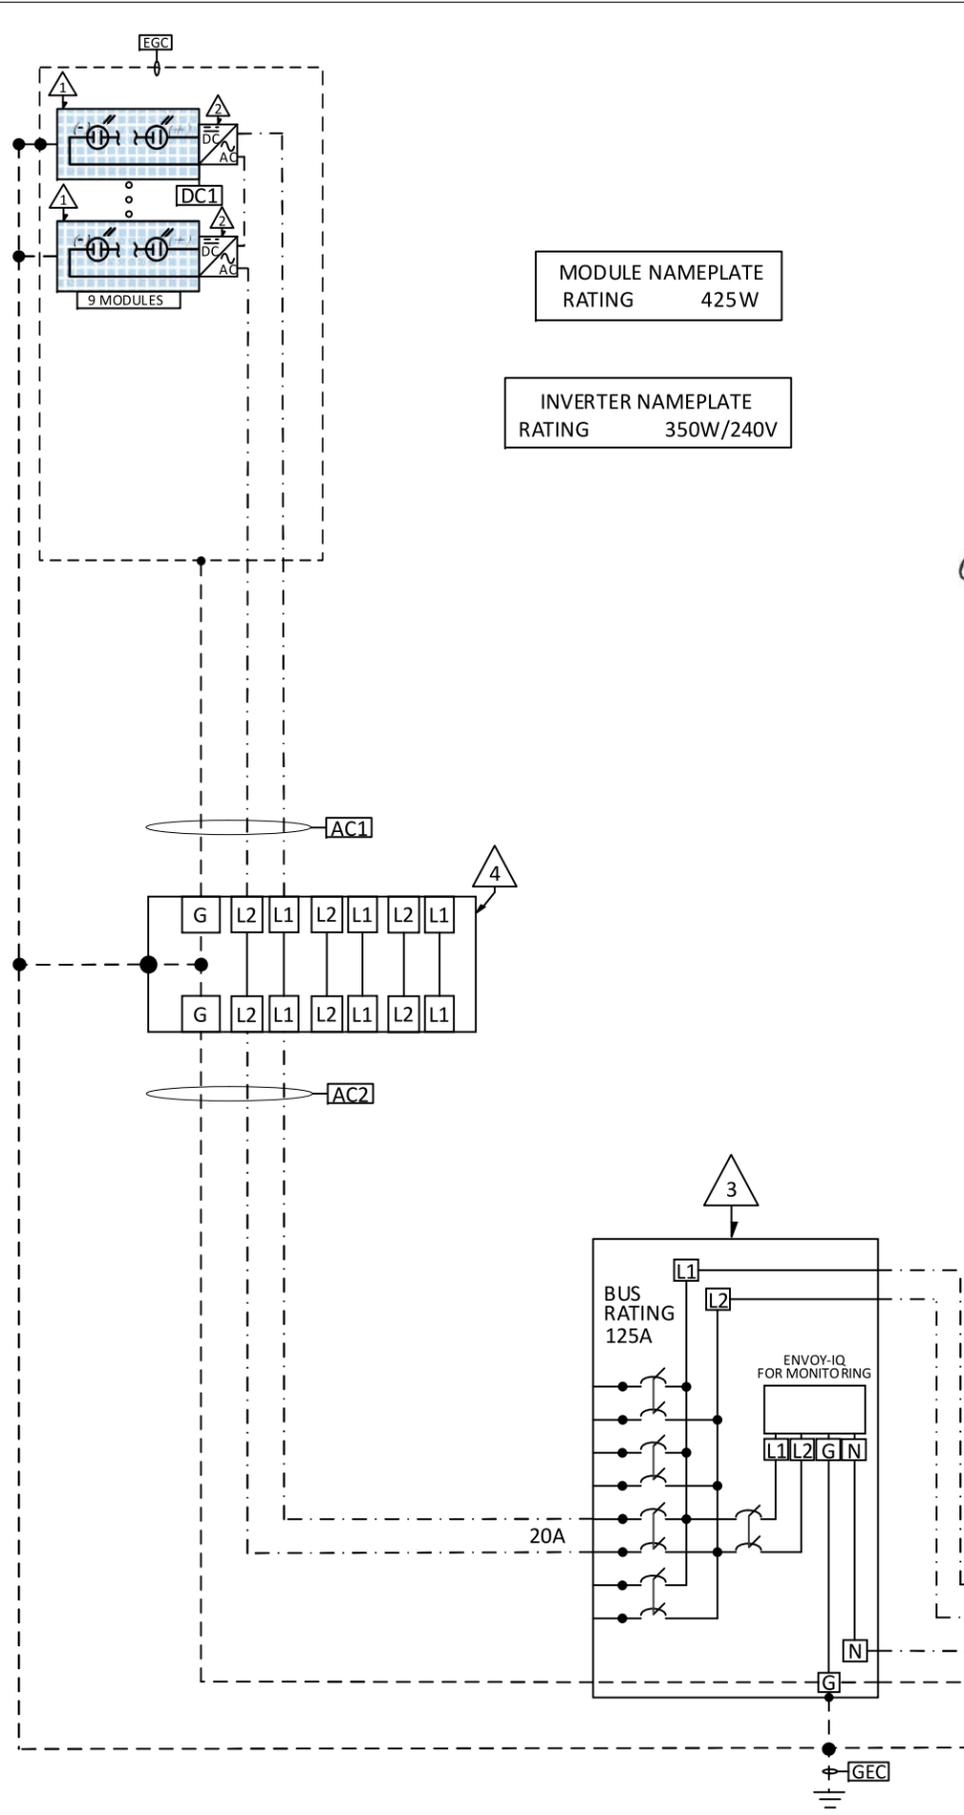

MODULE NAMEPLATE  
RATING 425W

INVERTER NAMEPLATE  
RATING 350W/240V

BRANCH	MODULE QTY	OCPD
1	9	20A

BACK-FEED SOLAR BREAKER: N/A



sealed 06jan2022 mike@h2dc.com  
H2DC PLLC MO CoA#: 2017002700  
ELECTRICAL ONLY  
-NOT AN AS BUILT DRAWING SET-

EQUIPMENT TABLE		
TAG	QTY	COMPONENT
1	9	PV MODULES Q-Cell Q.PEAK DUO L-G6.2 425
2	9	MICRO INVERTER Enphase IQ7A-72-2-US (240V)
3	1	AC COMBINER BOX 2 Enphase X-IQ-AM1-240-3
4	1	JUNCTION BOX Generic
5	0	NEW SOLAR LOAD CENTER
6	0	AC DISCONNECT AT GROUND LEVEL
7	0	PROD/GENERATION METER
8	1	EXISTING SUB PANEL #1 100A BUS / Main Lug Only
9	1	AC DISCONNECT 2 (FUSIBLE) Generic 30A Fused Exterior
10		
11	1	EXISTING MAIN SERVICE 100A MB - METER/MAIN ONLY
12	1	EXISTING UTILITY METER 120/240V - 1Φ
13	0	BATTERY
14		

NOTE: EQUIP TAGS MAY NOT BE IN SEQUENTIAL ORDER, N/A USED

CONDUCTOR TABLE			CONDUIT TABLE			
TAG	QTY*	SIZE	TYPE	GROUND	SIZE	TYPE
DC1	2	#12 AWG	PV Wire	#6 AWG	N/A	Open Air
AC1	3	#12 AWG	TRUNK CBL	#6 AWG	N/A	Open Air
AC2	3	#10 AWG	THWN-2	#8 AWG	3/4 inch	EMT
AC3	4	#10 AWG	THWN-2	#6 AWG	3/4 inch	EMT
AC4	4	#10 AWG	THWN-2	#6 AWG	3/4 inch	EMT
AC5						
AC6						
AC7						
AC8						
AC9						
AC10						

**LEGEND**

DC# DC CONDUCTOR TAG  
AC# AC CONDUCTOR TAG  
EQUIPMENT TAG  
GND GROUND CONDUCTOR TAG

SEE SHEET E-001 FOR ADDITIONAL ELECTRICAL SPECIFICATIONS

**ELECTRICAL NOTES**


- INTEGRATED MICRO INVERTERS (AC MODULES) MUST BE CERTIFIED UL1742 AND UL1703 COMPLIANT. AS EITHER INDIVIDUAL COMPONENTS OR AC MODULE ASSEMBLY. THEY MUST ALSO BE LABELED "UTILITY INTERACTIVE" CONFORMING TO IEEE1547 TESTING.
- PV MODULES THAT HAVE INVERTERS ATTACHED WITHOUT AN AC MODULE EVALUATION BY A NRTL MAY VIOLATE THE ORIGINAL LISTING OF THE PV MODULE AND VOID THE WARRANTY OF THE MODULE.
- VERIFY MODULE IS COMPATIBLE WITH MICRO INVERTER MANUFACTURER AND MODEL.
- ARTICLE CEC/NEC 690 STILL APPLIES. THE INSTALLER WILL NEED TO CONSIDER REQUIREMENTS SUCH AS: DC GROUND FAULT DETECTION AND INTERRUPT, DC CABLE MANAGEMENT, DC DISCONNECTING MEANS AND DC GROUNDING AS WELL AS THE AC EQUIPMENT GROUNDING CONDUCTOR TO THE INVERTER.
- ALL OVERCURRENT PROTECTION DEVICES (OCPDs) MUST BE RATED FOR 600 VOLTS ON THE DC / PV POWER SIDE OF THE INVERTER.
- ALL CONDUIT AND CONDUIT CONNECTIONS SHALL BE RATED FOR WET AND DAMP LOCATIONS WHEN APPLICABLE.

**INTERCONNECTION NOTES:**

- 705.12(B)(4) CIRCUIT BREAKERS MUST BE SUITABLE FOR BACKFEEDING. NEC INFORMATIONAL NOTE: FUSED DISCONNECTS, UNLESS OTHERWISE MARKED, ARE SUITABLE FOR BACKFEEDING.
- 690.13(F)(2) DEVICES MARKED WITH "LINE" AND "LOAD" SHALL NOT BE PERMITTED FOR BACKFEED OR REVERSE CURRENT
- 705.12(B)(5) CIRCUIT BREAKERS BACK FEED FROM UTILITY INTERACTIVE INVERTERS (ANTI-ISLANDING, UL 1741 CERTIFIED)

**NO CENTER-FED MAIN BREAKER. PANEL CONFIGURED PER NEC 705.12(B)(1)**

\* INCLUDES GROUND & CURRENT CARRYING CONDUCTORS

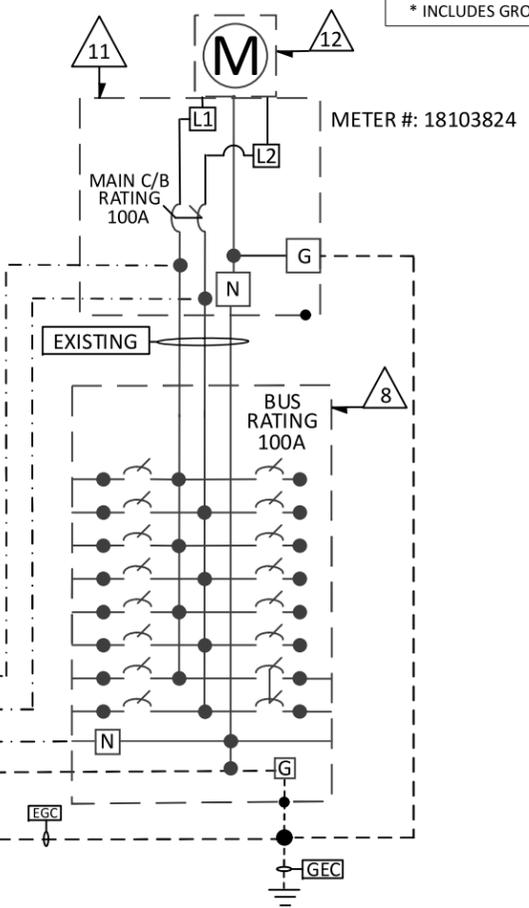

Sun Smart Technologies 000002021-00077 701 NE 76th Street Gladstone, MO 64118 (816) 509-0943	27.625 kW PHOTOVOLTAIC PLANS		DATE	12/29/2021	RELEASE	SUBMIT FOR PERMIT
	NAME	LSCV455-MO	REV			
	ADDRESS	455 SW Ward Rd				
	ADDRESS	Lee's Summit, MO 64081				
	APN					

THREE LINE DIAGRAM

E-003B

**WIRE AND CONDUCTOR NOTES**

1. ANY CONDUCTOR LENGTH UNDER 50' DOESN'T REQUIRE VOLTAGE DROP CALCULATIONS
2. BECAUSE WE ARE UNABLE TO DETERMINE THE EXACT PATH THE INSTALLER WILL RUN CONDUCTORS; WORST CASE SCENARIOS, ROUNDING UP SIZES OF CONDUCTORS THAT ARE DEEMED QUESTIONABLE TO PREVENT ISSUES RELATED TO USING CONDUCTORS THAT ARE IMPROPERLY SIZED.
3. WIRING METHODS IN THESE CALCULATIONS DON'T EXCEED 1000 VOLTS
4. CEC/NEC 310.15(A)(2) (AS APPLICABLE) WHERE TWO DIFFERENT AMPACITIES APPLY TO ADJACENT PORTIONS OF A CIRCUIT, THE HIGHER AMPACITY SHALL BE PERMITTED TO BE USED BEYOND THE POINT OF TRANSITION, A DISTANCE EQUAL TO 10'-0" (3 METERS) OR 10% OF THE CIRCUIT LENGTH FIGURED AT THE HIGHER AMPACITY, WHICHEVER IS LESS. WHEN LESS THAN 10'-0" OR 10% OF THE CIRCUIT LENGTH; THE LESSER AMPACITY MAY BE USED.

**WIRE COLOR CODING (2017) NEC SECTIONS 250.119 & 200.6**

PV DC WIRING		AC WIRING	
EQUIPMENT GROUND	GREEN OR BARE, OR GREEN/YELLOW	EQUIPMENT GROUND	GREEN OR BARE, OR GREEN/YELLOW
GROUNDING CONDUCTOR, TYPICALLY NEGATIVE	WHITE OR GRAY	GROUNDING CONDUCTOR (NEUTRAL)	WHITE OR GRAY
UNGROUNDING CONDUCTOR(S), TYPICALLY POSITIVE	ANY COLOR OTHER THAN GREEN OR WHITE/GRAY	UNGROUNDING CONDUCTOR(S) HOT: L1 AND L2	ANY COLOR OTHER THAN GREEN OR WHITE/GRAY ALLOWED.
	CONVENTION IS RED FOR GROUNDING SYSTEMS		CONVENTION IS L1 BLACK
	RED (+) AND BLACK (-) FOR UNGROUNDING SYSTEMS		CONVENTION IS L2 RED

**DC WIRE AND CONDUIT SIZING CHART [SEE SHEET E-003 FOR THREE LINE DIAGRAM]**

TAG	CIRCUIT ORIGIN	CIRCUIT DESTINATION	CONDUCTOR SPECIFICATIONS				REQUIRED CONDUCTOR AMPACITY					CONDUCTOR TEMPERATURE DERATING					CONDUIT FILL DERATING		CORRECTED AMPACITY CALCULATION					AMPACITY CHECK									
			QTY IN PARALLEL & MATERIAL	TEMP RATING (°C)	TRADE SIZE	AMPACITY @ 30°C PER 310.16	Isc (AMPS) OR COMPONENT (AMPS)	X	#OF COMBINED PARALLEL CIRCUITS	X	MAX CURRENT 690.8 (A)(1)	X	CONT. OPERATION 690.8 (B)(1)	=	REQUIRED AMPACITY	CIRCUIT ENVIRONMENT	AMBIENT TEMP. (°C)	HGT. ABOVE ROOF (in)	TEMP. ADDER PER 310.15 (B)(2)(c)	OPERAT. TEMP. (°C)	AMPACITY CORRECTION 310.15 (B)(2)(a)	# OF UNGRND. COND.	AMPACITY CORRECTION 310.15 (B)(3)(a)	COND. AMPACITY	X	TEMP. DERATING	X	CONDUIT FILL DERATING	=	CORRECTED AMPACITY	REQUIRED AMPACITY	≤	CORRECTED AMPACITY
DC1	PV MODULE	INVERTER	(1) CU	90	#12 AWG	30	10.83	X	1	X	1.25	X	1.25	=	16.9	ROOFTOP	37	>7/8"	0	37	0.91	2	N/A	30	X	0.71	X	1.0	=	21.3	16.9	≤	21.3




sealed 06jan2022 mike@h2dc.com  
 H2DC PLLC MO CoA#: 2017002700  
 ELECTRICAL ONLY  
 -NOT AN AS BUILT DRAWING SET-

RELEASE DATE 12/29/2021 SUBMIT FOR PERMIT  
 REV  
 27.625 kW PHOTOVOLTAIC PLANS  
 NAME LSCV455-MO  
 ADDRESS 455 SW Ward Rd  
 ADDRESS Lee's Summit, MO 64081  
 APN  
 E-002C  
 WIRE AND COND. CALCS.

**AC WIRE AND CONDUIT FILL DERATE CHART [SEE SHEET E-003 FOR THREE LINE DIAGRAM]**



TAG	CIRCUIT ORIGIN	CIRCUIT DESTINATION	CONDUCTOR SPECIFICATIONS				REQUIRED CONDUCTOR AMPACITY			CONDUCTOR TEMPERATURE DERATING					CONDUIT FILL DERATING		CORRECTED AMPACITY CALCULATION					AMPACITY CHECK							
			QTY IN PARALLEL & MATERIAL	TEMP RATING (°C)	TRADE SIZE	AMPACITY @ 30°C PER 310.16	CONT. OPERATION 690.8 (B)(1)	X	MAX INV. OUTPUT CURRENT (AMPS) OR COMPONENT (AMPS)	=	REQUIRED AMPACITY	CIRCUIT ENVIRONMENT	AMBIENT TEMP. (°C)	HGT. ABOVE ROOF (in)	TEMP. ADDER PER 310.15 (B)(2)(c)	OPERAT. TEMP. (°C)	AMPACITY CORRECTION 310.15 (B)(2)(a)	# OF UNGRND. COND.	AMPACITY CORRECTION 310.15 (B)(3)(a)	COND. AMPACITY	X	TEMP. DERATING	X	CONDUIT FILL DERATING	=	CORRECTED AMPACITY	REQUIRED AMPACITY	≤	CORRECTED AMPACITY
AC1	INVERTER	JUNCTION BOX	(1) CU	75	#12 AWG	25	1.25	X	11.6	=	14.5	ROOFTOP	37	>7/8"	0	37	0.88	2	N/A	25	X	0.88	X	1.0	=	22	14.5	≤	22
AC2	JUNCTION BOX	AC COMBINER	(1) CU	75	#10 AWG	35	1.25	X	11.6	=	14.5	ROOFTOP	37	>7/8"	0	37	0.88	2	1.0	35	X	0.88	X	1.0	=	30.8	14.5	≤	30.8
AC3	AC COMBINER	AC DISCONNECT	(1) CU	75	#10 AWG	35	1.25	X	11.6	=	14.5	EXT WALL	37	N/A	0	37	0.88	3	1.0	35	X	0.88	X	1.0	=	30.8	14.5	≤	30.8
AC4	AC DISCONNECT	EXISTING SERVICE PANEL	(1) CU	75	#10 AWG	35	1.25	X	11.6	=	14.5	EXT WALL	37	N/A	0	37	0.88	3	1.0	35	X	0.88	X	1.0	=	30.8	14.5	≤	30.8
AC5								X		=										X		X		=			≤		
AC6								X		=										X		X		=			≤		
AC7								X		=										X		X		=			≤		
AC8								X		=										X		X		=			≤		
AC9								X		=										X		X		=			≤		
AC10								X		=										X		X		=			≤		

00002021-00077  
 Sun Smart Technologies  
 701 NE 76th Street  
 Gladstone, MO 64118  
 (816) 509-0943


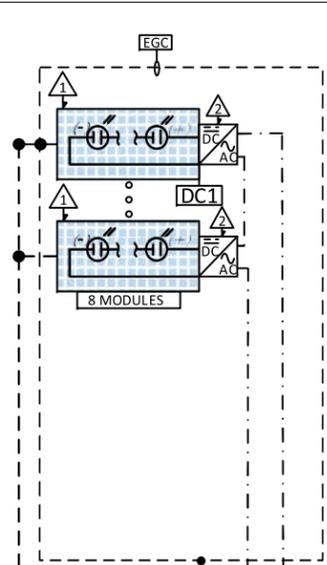


MODULE NAMEPLATE  
RATING 425W

INVERTER NAMEPLATE  
RATING 350W/240V

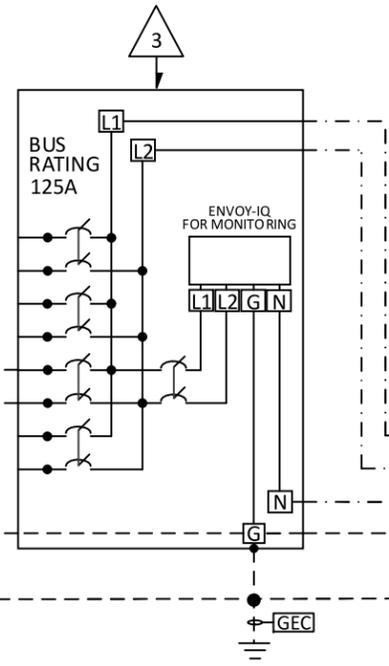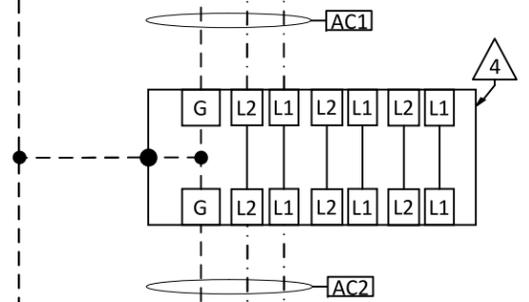

AC DISCONNECT 3 NAMEPLATE  
RATING 30A/240V  
FUSE RATING 20A

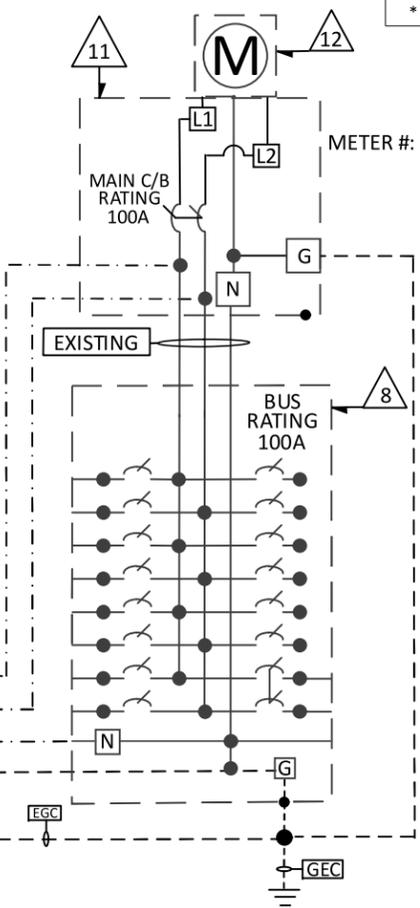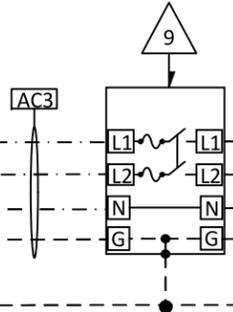

sealed 06jan2022 mike@h2dc.com  
H2DC PLLC MO CoA#: 2017002700  
ELECTRICAL ONLY  
-NOT AN AS BUILT DRAWING SET-

BRANCH	MODULE QTY	OCPD
1	8	20A

BACK-FEED SOLAR BREAKER: N/A

EQUIPMENT TABLE		
TAG	QTY	COMPONENT
1	10	PV MODULES Q-Cell Q.PEAK DUO L-G6.2 425
2	10	MICRO INVERTER Enphase IQ7A-72-2-US (240V)
3	1	AC COMBINER BOX 3 Enphase X-IQ-AM1-240-3
4	1	JUNCTION BOX Generic
5	0	NEW SOLAR LOAD CENTER
6	0	AC DISCONNECT AT GROUND LEVEL
7	0	PROD/GENERATION METER
8	1	EXISTING SUB PANEL #1 100A BUS / Main Lug Only
9	1	AC DISCONNECT 3 (FUSIBLE) Generic 30A Fused Exterior
10		
11	1	EXISTING MAIN SERVICE 100A MB - METER/MAIN ONLY
12	1	EXISTING UTILITY METER 120/240V - 1Φ
13	0	BATTERY
14		

NOTE: EQUIP TAGS MAY NOT BE IN SEQUENTIAL ORDER, N/A USED

CONDUCTOR TABLE			CONDUIT TABLE			
TAG	QTY*	SIZE	TYPE	GROUND	SIZE	TYPE
DC1	2	#12 AWG	PV Wire	#6 AWG	N/A	Open Air
AC1	3	#12 AWG	TRUNK CBL	#6 AWG	N/A	Open Air
AC2	3	#10 AWG	THWN-2	#8 AWG	3/4 inch	EMT
AC3	4	#10 AWG	THWN-2	#6 AWG	3/4 inch	EMT
AC4	4	#10 AWG	THWN-2	#6 AWG	3/4 inch	EMT
AC5						
AC6						
AC7						
AC8						
AC9						
AC10						

**LEGEND**

DC# DC CONDUCTOR TAG  
AC# AC CONDUCTOR TAG  
EQUIP TAG  
GND GROUND CONDUCTOR TAG

SEE SHEET E-001 FOR ADDITIONAL ELECTRICAL SPECIFICATIONS

**ELECTRICAL NOTES**

- INTEGRATED MICRO INVERTERS (AC MODULES) MUST BE CERTIFIED UL1742 AND UL1703 COMPLIANT. AS EITHER INDIVIDUAL COMPONENTS OR AC MODULE ASSEMBLY. THEY MUST ALSO BE LABELED "UTILITY INTERACTIVE" CONFORMING TO IEEE1547 TESTING.
- PV MODULES THAT HAVE INVERTERS ATTACHED WITHOUT AN AC MODULE EVALUATION BY A NRTL MAY VIOLATE THE ORIGINAL LISTING OF THE PV MODULE AND VOID THE WARRANTY OF THE MODULE.
- VERIFY MODULE IS COMPATIBLE WITH MICRO INVERTER MANUFACTURER AND MODEL.
- ARTICLE CEC/NEC 690 STILL APPLIES. THE INSTALLER WILL NEED TO CONSIDER REQUIREMENTS SUCH AS: DC GROUND FAULT DETECTION AND INTERRUPT, DC CABLE MANAGEMENT, DC DISCONNECTING MEANS AND DC GROUNDING AS WELL AS THE AC EQUIPMENT GROUNDING CONDUCTOR TO THE INVERTER.
- ALL OVERCURRENT PROTECTION DEVICES (OCPDs) MUST BE RATED FOR 600 VOLTS ON THE DC / PV POWER SIDE OF THE INVERTER.
- ALL CONDUIT AND CONDUIT CONNECTIONS SHALL BE RATED FOR WET AND DAMP LOCATIONS WHEN APPLICABLE.

**INTERCONNECTION NOTES:**

- 705.12(B)(4) CIRCUIT BREAKERS MUST BE SUITABLE FOR BACKFEEDING. NEC INFORMATIONAL NOTE: FUSED DISCONNECTS, UNLESS OTHERWISE MARKED, ARE SUITABLE FOR BACKFEEDING.
- 690.13(F)(2) DEVICES MARKED WITH "LINE" AND "LOAD" SHALL NOT BE PERMITTED FOR BACKFEED OR REVERSE CURRENT
- 705.12(B)(5) CIRCUIT BREAKERS BACK FEED FROM UTILITY INTERACTIVE INVERTERS (ANTI-ISLANDING, UL 1741 CERTIFIED)

**NO CENTER-FED MAIN BREAKER. PANEL CONFIGURED PER NEC 705.12(B)(1)**

\* INCLUDES GROUND & CURRENT CARRYING CONDUCTORS

Sun Smart Technologies 000002021-00077 701 NE 76th Street Gladstone, MO 64118 (816) 509-0943	27.625 kW PHOTOVOLTAIC PLANS	RELEASE	12/29/2021	SUBMIT FOR PERMIT	THREE LINE DIAGRAM
	NAME LSCV455-MO ADDRESS 455 SW Ward Rd ADDRESS Lee's Summit, MO 64081 APN				

**WIRE AND CONDUCTOR NOTES**

1. ANY CONDUCTOR LENGTH UNDER 50' DOESN'T REQUIRE VOLTAGE DROP CALCULATIONS
2. BECAUSE WE ARE UNABLE TO DETERMINE THE EXACT PATH THE INSTALLER WILL RUN CONDUCTORS; WORST CASE SCENARIOS, ROUNDING UP SIZES OF CONDUCTORS THAT ARE DEEMED QUESTIONABLE TO PREVENT ISSUES RELATED TO USING CONDUCTORS THAT ARE IMPROPERLY SIZED.
3. WIRING METHODS IN THESE CALCULATIONS DON'T EXCEED 1000 VOLTS
4. CEC/NEC 310.15(A)(2) (AS APPLICABLE) WHERE TWO DIFFERENT AMPACITIES APPLY TO ADJACENT PORTIONS OF A CIRCUIT, THE HIGHER AMPACITY SHALL BE PERMITTED TO BE USED BEYOND THE POINT OF TRANSITION, A DISTANCE EQUAL TO 10'-0" (3 METERS) OR 10% OF THE CIRCUIT LENGTH FIGURED AT THE HIGHER AMPACITY, WHICHEVER IS LESS. WHEN LESS THAN 10'-0" OR 10% OF THE CIRCUIT LENGTH; THE LESSER AMPACITY MAY BE USED.

**WIRE COLOR CODING (2017) NEC SECTIONS 250.119 & 200.6**

PV DC WIRING		AC WIRING	
EQUIPMENT GROUND	GREEN OR BARE, OR GREEN/YELLOW	EQUIPMENT GROUND	GREEN OR BARE, OR GREEN/YELLOW
GROUNDING CONDUCTOR, TYPICALLY NEGATIVE	WHITE OR GRAY	GROUNDING CONDUCTOR (NEUTRAL)	WHITE OR GRAY
UNGROUNDING CONDUCTOR(S), TYPICALLY POSITIVE	ANY COLOR OTHER THAN GREEN OR WHITE/GRAY	UNGROUNDING CONDUCTOR(S) HOT: L1 AND L2	ANY COLOR OTHER THAN GREEN OR WHITE/GRAY ALLOWED.
	CONVENTION IS RED FOR GROUNDING SYSTEMS		CONVENTION IS L1 BLACK
	RED (+) AND BLACK (-) FOR UNGROUNDING SYSTEMS		CONVENTION IS L2 RED

**DC WIRE AND CONDUIT SIZING CHART [SEE SHEET E-003 FOR THREE LINE DIAGRAM]**

TAG	CIRCUIT ORIGIN	CIRCUIT DESTINATION	CONDUCTOR SPECIFICATIONS				REQUIRED CONDUCTOR AMPACITY					CONDUCTOR TEMPERATURE DERATING					CONDUIT FILL DERATING		CORRECTED AMPACITY CALCULATION					AMPACITY CHECK									
			QTY IN PARALLEL & MATERIAL	TEMP RATING (°C)	TRADE SIZE	AMPACITY @ 30°C PER 310.16	Isc (AMPS) OR COMPONENT (AMPS)	X	#OF COMBINED PARALLEL CIRCUITS	X	MAX CURRENT 690.8 (A)(1)	X	CONT. OPERATION 690.8 (B)(1)	=	REQUIRED AMPACITY	CIRCUIT ENVIRONMENT	AMBIENT TEMP. (°C)	HGT. ABOVE ROOF (in)	TEMP. ADDER PER 310.15 (B)(2)(c)	OPERAT. TEMP. (°C)	AMPACITY CORRECTION 310.15 (B)(2)(a)	# OF UNGRND. COND.	AMPACITY CORRECTION 310.15 (B)(3)(a)	COND. AMPACITY	X	TEMP. DERATING	X	CONDUIT FILL DERATING	=	CORRECTED AMPACITY	REQUIRED AMPACITY	≤	CORRECTED AMPACITY
DC1	PV MODULE	INVERTER	(1) CU	90	#12 AWG	30	10.83	X	1	X	1.25	X	1.25	=	16.9	ROOFTOP	37	>7/8"	0	37	0.91	2	N/A	30	X	0.71	X	1.0	=	21.3	16.9	≤	21.3




sealed 06jan2022 mike@h2dc.com  
 H2DC PLLC MO CoA#: 2017002700  
 ELECTRICAL ONLY  
 -NOT AN AS BUILT DRAWING SET-

RELEASE DATE 12/29/2021 SUBMIT FOR PERMIT  
 REV  
 27.625 kW PHOTOVOLTAIC PLANS  
 NAME LSCV455-MO  
 ADDRESS 455 SW Ward Rd  
 ADDRESS Lee's Summit, MO 64081  
 APN  
 E-002D  
 WIRE AND COND. CALCS.

**AC WIRE AND CONDUIT FILL DERATE CHART [SEE SHEET E-003 FOR THREE LINE DIAGRAM]**

TAG	CIRCUIT ORIGIN	CIRCUIT DESTINATION	CONDUCTOR SPECIFICATIONS				REQUIRED CONDUCTOR AMPACITY			CONDUCTOR TEMPERATURE DERATING					CONDUIT FILL DERATING		CORRECTED AMPACITY CALCULATION					AMPACITY CHECK							
			QTY IN PARALLEL & MATERIAL	TEMP RATING (°C)	TRADE SIZE	AMPACITY @ 30°C PER 310.16	CONT. OPERATION 690.8 (B)(1)	X	MAX INV. OUTPUT CURRENT (AMPS) OR COMPONENT (AMPS)	=	REQUIRED AMPACITY	CIRCUIT ENVIRONMENT	AMBIENT TEMP. (°C)	HGT. ABOVE ROOF (in)	TEMP. ADDER PER 310.15 (B)(2)(c)	OPERAT. TEMP. (°C)	AMPACITY CORRECTION 310.15 (B)(2)(a)	# OF UNGRND. COND.	AMPACITY CORRECTION 310.15 (B)(3)(a)	COND. AMPACITY	X	TEMP. DERATING	X	CONDUIT FILL DERATING	=	CORRECTED AMPACITY	REQUIRED AMPACITY	≤	CORRECTED AMPACITY
AC1	INVERTER	JUNCTION BOX	(1) CU	75	#12 AWG	25	1.25	X	8.7	=	10.9	ROOFTOP	37	>7/8"	0	37	0.88	2	N/A	25	X	0.88	X	1.0	=	22	10.9	≤	22
AC2	JUNCTION BOX	AC COMBINER	(1) CU	75	#10 AWG	35	1.25	X	8.7	=	10.9	ROOFTOP	37	>7/8"	0	37	0.88	2	1.0	35	X	0.88	X	1.0	=	30.8	10.9	≤	30.8
AC3	AC COMBINER	AC DISCONNECT	(1) CU	75	#10 AWG	35	1.25	X	8.7	=	10.9	EXT WALL	37	N/A	0	37	0.88	3	1.0	35	X	0.88	X	1.0	=	30.8	10.9	≤	30.8
AC4	AC DISCONNECT	EXISTING SERVICE PANEL	(1) CU	75	#10 AWG	35	1.25	X	8.7	=	10.9	EXT WALL	37	N/A	0	37	0.88	3	1.0	35	X	0.88	X	1.0	=	30.8	10.9	≤	30.8
AC5								X		=										X		X		=			≤		
AC6								X		=										X		X		=			≤		
AC7								X		=										X		X		=			≤		
AC8								X		=										X		X		=			≤		
AC9								X		=										X		X		=			≤		
AC10								X		=										X		X		=			≤		

00002021-00077  
 Sun Smart Technologies  
 701 NE 76th Street  
 Gladstone, MO 64118  
 (816) 509-0943

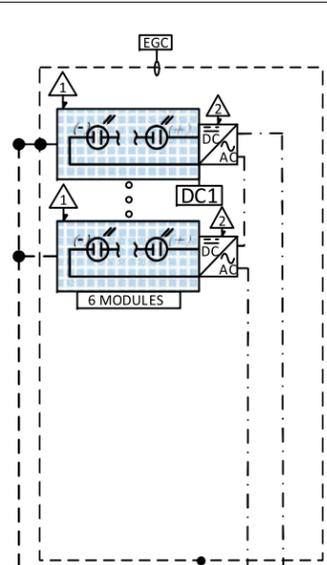

MODULE NAMEPLATE  
RATING 425W

INVERTER NAMEPLATE  
RATING 350W/240V

BRANCH	MODULE QTY	OCPD
1	6	20A

BACK-FEED SOLAR BREAKER: N/A



sealed 06jan2022 mike@h2dc.com  
H2DC PLLC MO CoA#: 2017002700  
ELECTRICAL ONLY  
-NOT AN AS BUILT DRAWING SET-

EQUIPMENT TABLE		
TAG	QTY	COMPONENT
1	10	PV MODULES Q-Cell Q.PEAK DUO L-G6.2 425
2	10	MICRO INVERTER Enphase IQ7A-72-2-US (240V)
3	1	AC COMBINER BOX 4 Enphase X-IQ-AM1-240-3
4	1	JUNCTION BOX Generic Generic
5	0	NEW SOLAR LOAD CENTER
6	0	AC DISCONNECT AT GROUND LEVEL
7	0	PROD/GENERATION METER
8	1	EXISTING SUB PANEL #1 100A BUS / Main Lug Only
9	1	AC DISCONNECT 4 (FUSIBLE) Generic 30A Fused Exterior
10		
11	1	EXISTING MAIN SERVICE 100A MB - METER/MAIN ONLY
12	1	EXISTING UTILITY METER 120/240V - 1Φ
13	0	BATTERY
14		

NOTE: EQUIP TAGS MAY NOT BE IN SEQUENTIAL ORDER, N/A USED



CONDUCTOR TABLE			CONDUIT TABLE			
TAG	QTY*	SIZE	TYPE	GROUND	SIZE	TYPE
DC1	2	#12 AWG	PV Wire	#6 AWG	N/A	Open Air
AC1	3	#12 AWG	TRUNK CBL	#6 AWG	N/A	Open Air
AC2	3	#10 AWG	THWN-2	#8 AWG	3/4 inch	EMT
AC3	4	#10 AWG	THWN-2	#6 AWG	3/4 inch	EMT
AC4	4	#10 AWG	THWN-2	#6 AWG	3/4 inch	EMT
AC5						
AC6						
AC7						
AC8						
AC9						
AC10						

LEGEND	
DC#	DC CONDUCTOR TAG
AC#	AC CONDUCTOR TAG
	EQUIPMENT TAG
GND	GROUND CONDUCTOR TAG



SEE SHEET E-001 FOR ADDITIONAL ELECTRICAL SPECIFICATIONS

- ELECTRICAL NOTES**
- INTEGRATED MICRO INVERTERS (AC MODULES) MUST BE CERTIFIED UL1742 AND UL1703 COMPLIANT. AS EITHER INDIVIDUAL COMPONENTS OR AC MODULE ASSEMBLY. THEY MUST ALSO BE LABELED "UTILITY INTERACTIVE" CONFORMING TO IEEE1547 TESTING.
  - PV MODULES THAT HAVE INVERTERS ATTACHED WITHOUT AN AC MODULE EVALUATION BY A NRTL MAY VIOLATE THE ORIGINAL LISTING OF THE PV MODULE AND VOID THE WARRANTY OF THE MODULE.
  - VERIFY MODULE IS COMPATIBLE WITH MICRO INVERTER MANUFACTURER AND MODEL.
  - ARTICLE CEC/NEC 690 STILL APPLIES. THE INSTALLER WILL NEED TO CONSIDER REQUIREMENTS SUCH AS: DC GROUND FAULT DETECTION AND INTERRUPT, DC CABLE MANAGEMENT, DC DISCONNECTING MEANS AND DC GROUNDING AS WELL AS THE AC EQUIPMENT GROUNDING CONDUCTOR TO THE INVERTER.
  - ALL OVERCURRENT PROTECTION DEVICES (OCPDs) MUST BE RATED FOR 600 VOLTS ON THE DC / PV POWER SIDE OF THE INVERTER.
  - ALL CONDUIT AND CONDUIT CONNECTIONS SHALL BE RATED FOR WET AND DAMP LOCATIONS WHEN APPLICABLE.
- INTERCONNECTION NOTES:**
- 705.12(B)(4) CIRCUIT BREAKERS MUST BE SUITABLE FOR BACKFEEDING. NEC INFORMATIONAL NOTE: FUSED DISCONNECTS, UNLESS OTHERWISE MARKED, ARE SUITABLE FOR BACKFEEDING.
  - 690.13(F)(2) DEVICES MARKED WITH "LINE" AND "LOAD" SHALL NOT BE PERMITTED FOR BACKFEED OR REVERSE CURRENT
  - 705.12(B)(5) CIRCUIT BREAKERS BACK FEED FROM UTILITY INTERACTIVE INVERTERS (ANTI-ISLANDING, UL 1741 CERTIFIED)
- NO CENTER-FED MAIN BREAKER. PANEL CONFIGURED PER NEC 705.12(B)(1)**
- \* INCLUDES GROUND & CURRENT CARRYING CONDUCTORS

**NOTE: THIS LINE DIAGRAM APPLIES TO 2 OF THE 6 SYSTEMS**

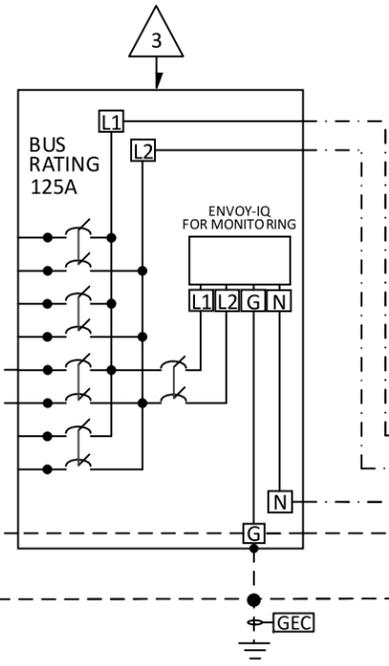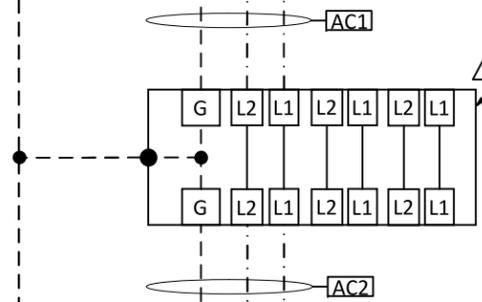

AC DISCONNECT 4 NAMEPLATE  
RATING 30A/240V  
FUSE RATING 20A

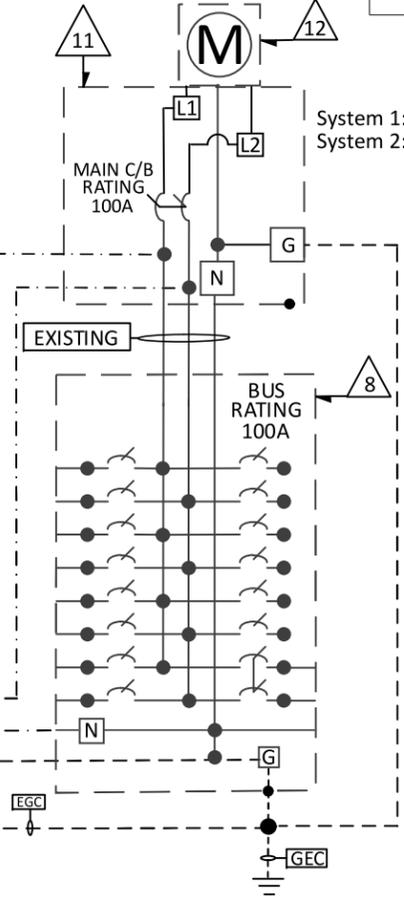

REV	DATE	RELEASE	THREE LINE DIAGRAM	
	12/29/2021	SUBMIT FOR PERMIT	E-003D	
27.625 kW PHOTOVOLTAIC PLANS			APN	
Sun Smart Technologies 000002021-00077			701 NE 76th Street Gladstone, MO 64118 (816) 509-0943	
NAME LSCV455-MO			ADDRESS 455 SW Ward Rd Lee's Summit, MO 64081	

**WIRE AND CONDUCTOR NOTES**

1. ANY CONDUCTOR LENGTH UNDER 50' DOESN'T REQUIRE VOLTAGE DROP CALCULATIONS
2. BECAUSE WE ARE UNABLE TO DETERMINE THE EXACT PATH THE INSTALLER WILL RUN CONDUCTORS; WORST CASE SCENARIOS, ROUNDING UP SIZES OF CONDUCTORS THAT ARE DEEMED QUESTIONABLE TO PREVENT ISSUES RELATED TO USING CONDUCTORS THAT ARE IMPROPERLY SIZED.
3. WIRING METHODS IN THESE CALCULATIONS DON'T EXCEED 1000 VOLTS
4. CEC/NEC 310.15(A)(2) (AS APPLICABLE) WHERE TWO DIFFERENT AMPACITIES APPLY TO ADJACENT PORTIONS OF A CIRCUIT, THE HIGHER AMPACITY SHALL BE PERMITTED TO BE USED BEYOND THE POINT OF TRANSITION, A DISTANCE EQUAL TO 10'-0" (3 METERS) OR 10% OF THE CIRCUIT LENGTH FIGURED AT THE HIGHER AMPACITY, WHICHEVER IS LESS. WHEN LESS THAN 10'-0" OR 10% OF THE CIRCUIT LENGTH; THE LESSER AMPACITY MAY BE USED.

**WIRE COLOR CODING (2017) NEC SECTIONS 250.119 & 200.6**

PV DC WIRING		AC WIRING	
EQUIPMENT GROUND	GREEN OR BARE, OR GREEN/YELLOW	EQUIPMENT GROUND	GREEN OR BARE, OR GREEN/YELLOW
GROUNDING CONDUCTOR, TYPICALLY NEGATIVE	WHITE OR GRAY	GROUNDING CONDUCTOR (NEUTRAL)	WHITE OR GRAY
UNGROUNDING CONDUCTOR(S), TYPICALLY POSITIVE	ANY COLOR OTHER THAN GREEN OR WHITE/GRAY	UNGROUNDING CONDUCTOR(S) HOT: L1 AND L2	ANY COLOR OTHER THAN GREEN OR WHITE/GRAY ALLOWED.
	CONVENTION IS RED FOR GROUNDING SYSTEMS		CONVENTION IS L1 BLACK
	RED (+) AND BLACK (-) FOR UNGROUNDING SYSTEMS		CONVENTION IS L2 RED

**DC WIRE AND CONDUIT SIZING CHART [SEE SHEET E-003 FOR THREE LINE DIAGRAM]**

TAG	CIRCUIT ORIGIN	CIRCUIT DESTINATION	CONDUCTOR SPECIFICATIONS				REQUIRED CONDUCTOR AMPACITY					CONDUCTOR TEMPERATURE DERATING					CONDUIT FILL DERATING		CORRECTED AMPACITY CALCULATION					AMPACITY CHECK									
			QTY IN PARALLEL & MATERIAL	TEMP RATING (°C)	TRADE SIZE	AMPACITY @ 30°C PER 310.16	Isc (AMPS) OR COMPONENT (AMPS)	X	#OF COMBINED PARALLEL CIRCUITS	X	MAX CURRENT 690.8 (A)(1)	X	CONT. OPERATION 690.8 (B)(1)	=	REQUIRED AMPACITY	CIRCUIT ENVIRONMENT	AMBIENT TEMP. (°C)	HGT. ABOVE ROOF (in)	TEMP. ADDER PER 310.15 (B)(2)(c)	OPERAT. TEMP. (°C)	AMPACITY CORRECTION 310.15 (B)(2)(a)	# OF UNGRND. COND.	AMPACITY CORRECTION 310.15 (B)(3)(a)	COND. AMPACITY	X	TEMP. DERATING	X	CONDUIT FILL DERATING	=	CORRECTED AMPACITY	REQUIRED AMPACITY	≤	CORRECTED AMPACITY
DC1	PV MODULE	INVERTER	(1) CU	90	#12 AWG	30	10.83	X	1	X	1.25	X	1.25	=	16.9	ROOFTOP	37	>7/8"	0	37	0.91	2	N/A	30	X	0.71	X	1.0	=	21.3	16.9	≤	21.3




sealed 06jan2022 mike@h2dc.com  
H2DC PLLC MO CoA#: 2017002700  
ELECTRICAL ONLY  
-NOT AN AS BUILT DRAWING SET-

**WIRE AND COND. CALCS.**  
**E-002E**  
 RELEASE DATE 12/29/2021 SUBMIT FOR PERMIT  
 REV  
 27.625 kW PHOTOVOLTAIC PLANS  
 NAME LSCV455-MO  
 ADDRESS 455 SW Ward Rd  
 ADDRESS Lee's Summit, MO 64081  
 APN

**AC WIRE AND CONDUIT FILL DERATE CHART [SEE SHEET E-003 FOR THREE LINE DIAGRAM]**

TAG	CIRCUIT ORIGIN	CIRCUIT DESTINATION	CONDUCTOR SPECIFICATIONS				REQUIRED CONDUCTOR AMPACITY			CONDUCTOR TEMPERATURE DERATING					CONDUIT FILL DERATING		CORRECTED AMPACITY CALCULATION					AMPACITY CHECK							
			QTY IN PARALLEL & MATERIAL	TEMP RATING (°C)	TRADE SIZE	AMPACITY @ 30°C PER 310.16	CONT. OPERATION 690.8 (B)(1)	X	MAX INV. OUTPUT CURRENT (AMPS) OR COMPONENT (AMPS)	=	REQUIRED AMPACITY	CIRCUIT ENVIRONMENT	AMBIENT TEMP. (°C)	HGT. ABOVE ROOF (in)	TEMP. ADDER PER 310.15 (B)(2)(c)	OPERAT. TEMP. (°C)	AMPACITY CORRECTION 310.15 (B)(2)(a)	# OF UNGRND. COND.	AMPACITY CORRECTION 310.15 (B)(3)(a)	COND. AMPACITY	X	TEMP. DERATING	X	CONDUIT FILL DERATING	=	CORRECTED AMPACITY	REQUIRED AMPACITY	≤	CORRECTED AMPACITY
AC1	INVERTER	JUNCTION BOX	(1) CU	75	#12 AWG	25	1.25	X	14.5	=	18.1	ROOFTOP	37	>7/8"	0	37	0.88	2	N/A	25	X	0.88	X	1.0	=	22	15.1	≤	22
AC2	JUNCTION BOX	AC COMBINER	(1) CU	75	#10 AWG	35	1.25	X	14.5	=	18.1	ROOFTOP	37	>7/8"	0	37	0.88	6	0.8	35	X	0.88	X	0.8	=	24.64	18.1	≤	24.64
AC3	AC COMBINER	AC DISCONNECT	(1) CU	75	#6 AWG	65	1.25	X	37.7	=	47.1	EXT WALL	37	N/A	0	37	0.88	3	1.0	65	X	0.88	X	1.0	=	57.2	47.1	≤	57.2
AC4	AC DISCONNECT	EXISTING SERVICE PANEL	(1) CU	75	#6 AWG	65	1.25	X	37.7	=	47.1	EXT WALL	37	N/A	0	37	0.88	3	1.0	65	X	0.88	X	1.0	=	57.2	47.1	≤	57.2
AC5								X		=										X		X		=			≤		
AC6								X		=										X		X		=			≤		
AC7								X		=										X		X		=			≤		
AC8								X		=										X		X		=			≤		
AC9								X		=										X		X		=			≤		
AC10								X		=										X		X		=			≤		

000002021-00077  
 Sun Smart Technologies  
 701 NE 76th Street  
 Gladstone, MO 64118  
 (816) 509-0943

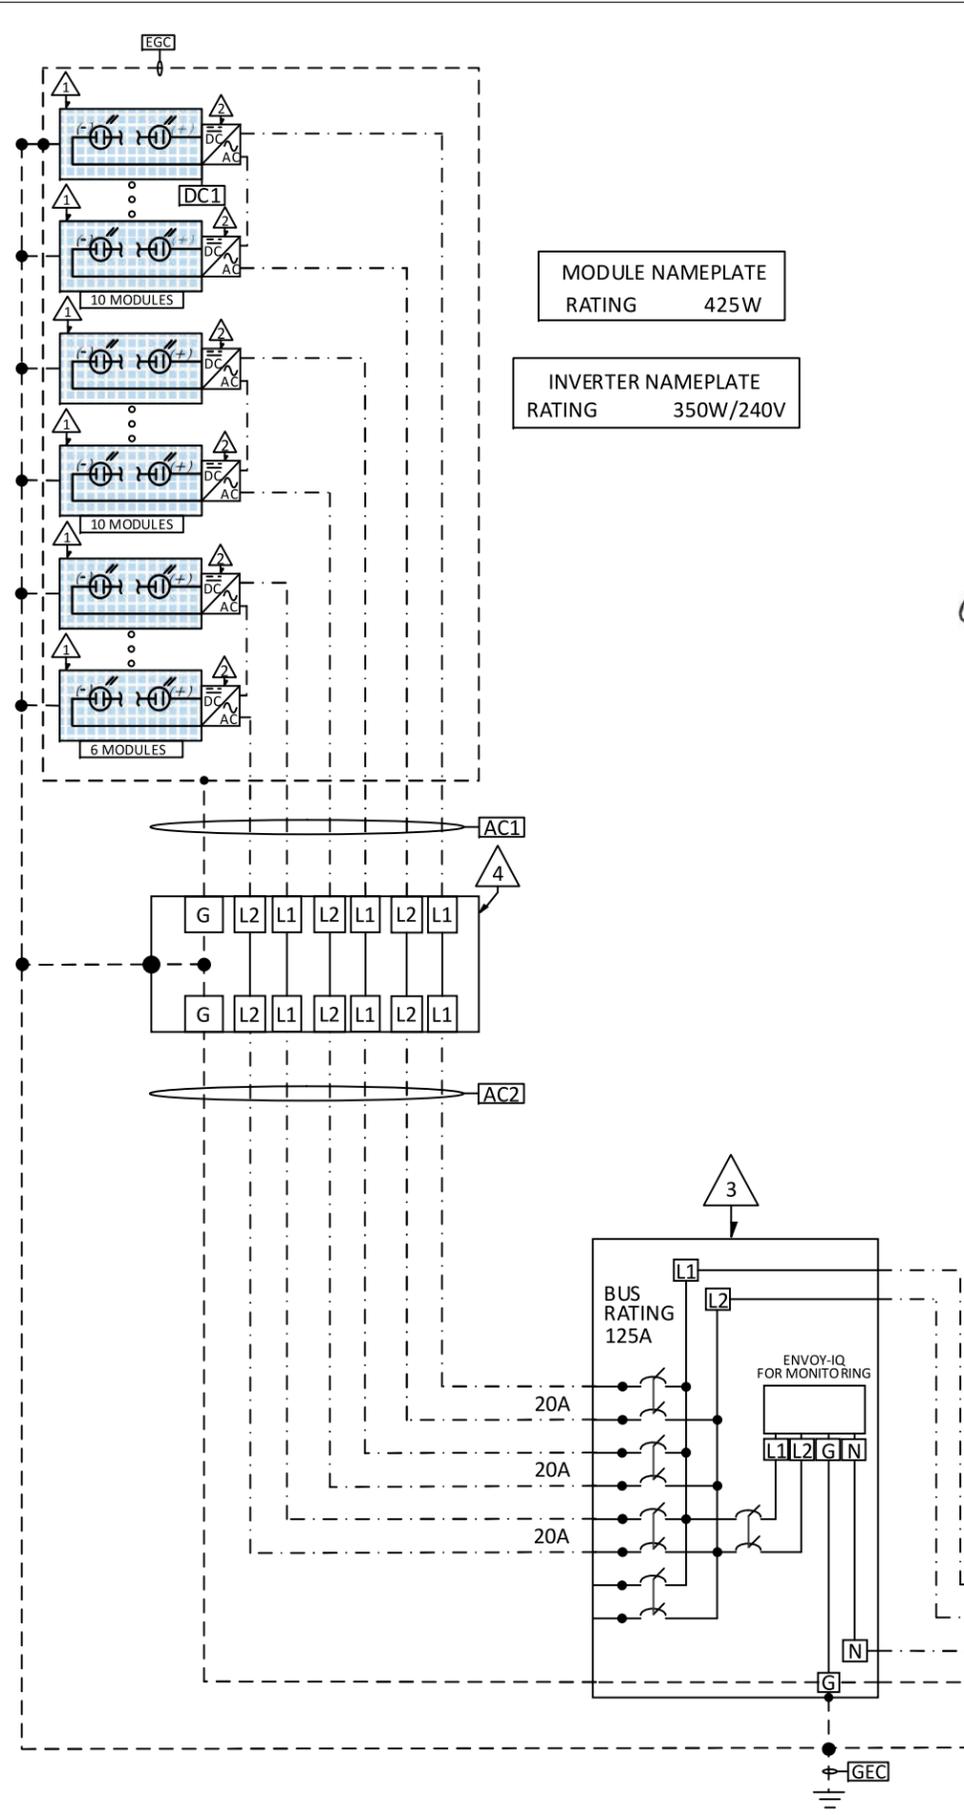

MODULE NAMEPLATE  
RATING 425W

INVERTER NAMEPLATE  
RATING 350W/240V

BRANCH	MODULE QTY	OCPD
1	10	20A
1	10	20A
1	6	20A

BACK-FEED SOLAR BREAKER: N/A



sealed 06jan2022 mike@h2dc.com  
H2DC PLLC MO CoA#: 2017002700  
ELECTRICAL ONLY  
-NOT AN AS BUILT DRAWING SET-

EQUIPMENT TABLE		
TAG	QTY	COMPONENT
1	26	PV MODULES Q-Cell Q.PEAK DUO L-G6.2 425
2	26	MICRO INVERTER Enphase IQ7A-72-2-US (240V)
3	1	AC COMBINER BOX 5 Enphase X-IQ-AM1-240-3
4	1	JUNCTION BOX Generic
5	0	NEW SOLAR LOAD CENTER
6	0	AC DISCONNECT AT GROUND LEVEL
7	0	PROD/GENERATION METER
8	1	EXISTING SUB PANEL #1 100A BUS / Main Lug Only
9	1	AC DISCONNECT 5 (FUSIBLE) Generic 60A Fused Exterior
10		
11	1	EXISTING MAIN SERVICE 70A MB - METER/MAIN ONLY
12	1	EXISTING UTILITY METER 120/240V - 1Φ
13	0	BATTERY
14		

NOTE: EQUIP TAGS MAY NOT BE IN SEQUENTIAL ORDER, N/A USED

CONDUCTOR TABLE			CONDUIT TABLE			
TAG	QTY*	SIZE	TYPE	GROUND	SIZE	TYPE
DC1	2	#12 AWG	PV Wire	#6 AWG	N/A	Open Air
AC1	3	#12 AWG	TRUNK CBL	#6 AWG	N/A	Open Air
AC2	7	#10 AWG	THWN-2	#8 AWG	3/4 inch	EMT
AC3	4	#6 AWG	THWN-2	#6 AWG	3/4 inch	EMT
AC4	4	#6 AWG	THWN-2	#6 AWG	3/4 inch	EMT
AC5						
AC6						
AC7						
AC8						
AC9						
AC10						

**LEGEND**

DC# DC CONDUCTOR TAG  
AC# AC CONDUCTOR TAG  
EQUIPMENT TAG  
GND GROUND CONDUCTOR TAG

SEE SHEET E-001 FOR ADDITIONAL ELECTRICAL SPECIFICATIONS

**ELECTRICAL NOTES**

- INTEGRATED MICRO INVERTERS (AC MODULES) MUST BE CERTIFIED UL1742 AND UL1703 COMPLIANT. AS EITHER INDIVIDUAL COMPONENTS OR AC MODULE ASSEMBLY. THEY MUST ALSO BE LABELED "UTILITY INTERACTIVE" CONFORMING TO IEEE1547 TESTING.
- PV MODULES THAT HAVE INVERTERS ATTACHED WITHOUT AN AC MODULE EVALUATION BY A NRTL MAY VIOLATE THE ORIGINAL LISTING OF THE PV MODULE AND VOID THE WARRANTY OF THE MODULE.
- VERIFY MODULE IS COMPATIBLE WITH MICRO INVERTER MANUFACTURER AND MODEL.
- ARTICLE CEC/NEC 690 STILL APPLIES. THE INSTALLER WILL NEED TO CONSIDER REQUIREMENTS SUCH AS: DC GROUND FAULT DETECTION AND INTERRUPT, DC CABLE MANAGEMENT, DC DISCONNECTING MEANS AND DC GROUNDING AS WELL AS THE AC EQUIPMENT GROUNDING CONDUCTOR TO THE INVERTER.
- ALL OVERCURRENT PROTECTION DEVICES (OCPDs) MUST BE RATED FOR 600 VOLTS ON THE DC / PV POWER SIDE OF THE INVERTER.
- ALL CONDUIT AND CONDUIT CONNECTIONS SHALL BE RATED FOR WET AND DAMP LOCATIONS WHEN APPLICABLE.


**INTERCONNECTION NOTES:**

- 705.12(B)(4) CIRCUIT BREAKERS MUST BE SUITABLE FOR BACKFEEDING. NEC INFORMATIONAL NOTE: FUSED DISCONNECTS, UNLESS OTHERWISE MARKED, ARE SUITABLE FOR BACKFEEDING.
- 690.13(F)(2) DEVICES MARKED WITH "LINE" AND "LOAD" SHALL NOT BE PERMITTED FOR BACKFEED OR REVERSE CURRENT
- 705.12(B)(5) CIRCUIT BREAKERS BACK FEED FROM UTILITY INTERACTIVE INVERTERS (ANTI-ISLANDING, UL 1741 CERTIFIED)

**NO CENTER-FED MAIN BREAKER. PANEL CONFIGURED PER NEC 705.12(B)(1)**


\* INCLUDES GROUND & CURRENT CARRYING CONDUCTORS

AC DISCONNECT 5 NAMEPLATE  
RATING 60A/240V  
FUSE RATING 50A

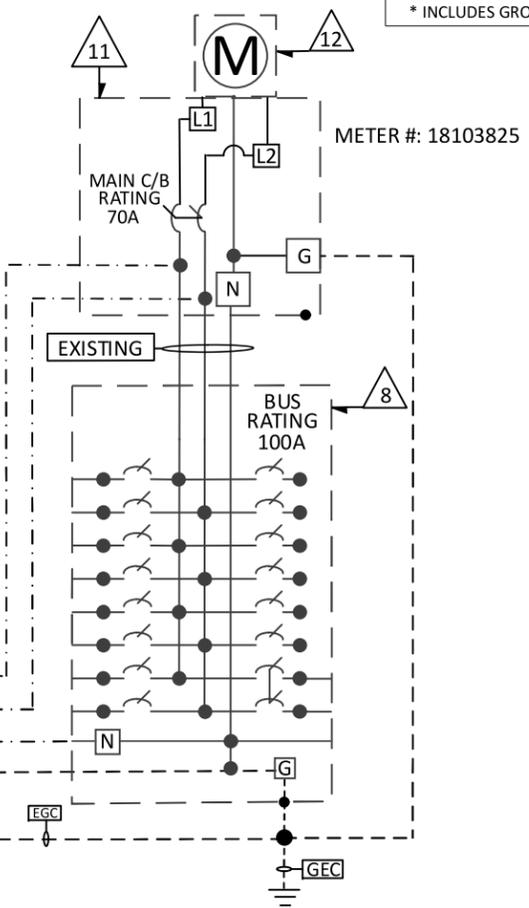

Sun Smart Technologies 000002021-00077 701 NE 76th Street Gladstone, MO 64118 (816) 509-0943	27.625 kW PHOTOVOLTAIC PLANS	DATE 12/29/2021	RELEASE SUBMIT FOR PERMIT	THREE LINE DIAGRAM
	NAME LSCV455-MO	ADDRESS 455 SW Ward Rd	ADDRESS Lee's Summit, MO 64081	



<p><b>1 CONDUIT, RACEWAY, J-BOX, AND PULL BOXES</b> SCALE: 1/2" = 1'-0"</p> <div style="border: 1px solid black; padding: 5px; text-align: center;"> <p><b>WARNING: PHOTOVOLTAIC POWER SOURCE</b></p> </div> <ol style="list-style-type: none"> <li>PLACE ON CONDUIT AND/OR RACEWAYS EVERY 10' (60"), 12" FROM BENDS, 12" ABOVE AND BELOW PENETRATIONS.</li> <li>CODE REFERENCE: NEC 690.31(G)(3)</li> <li>MINIMUM OF 1 1/8" x 5 3/4"</li> <li>FONT: 3/8" AND .8 WIDTH FACTOR.</li> <li>REFLECTIVE WHITE LETTERS ON A RED BACKGROUND.</li> </ol>	<p><b>2 DC DISCONNECTS</b> SCALE: 1/4" = 1'-0"</p> <div style="border: 1px solid black; padding: 5px; text-align: center;"> <p><b>WARNING</b></p> <p><b>ELECTRICAL SHOCK HAZARD</b></p> <p>TERMINALS ON THE LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION</p> </div> <ol style="list-style-type: none"> <li>PLACED ON DC DISCONNECT(S) AND ON ANY EQUIPMENT THAT STAYS ENERGIZED IN THE OFF POSITION FROM THE PV SUPPLY.</li> <li>CODE REFERENCE: NEC 690.13(B)</li> <li>MINIMUM OF 3 1/2" x 10"</li> <li>FONT: 3/8"</li> <li>WARNING LABEL IS WHITE AND ORANGE</li> </ol>	<p><b>3 INVERTER(S)</b> SCALE: 1/4" = 1'-0"</p> <div style="border: 1px solid black; padding: 5px; text-align: center;"> <p><b>WARNING</b></p> <p>THE DISCONNECTION OF THE GROUNDED CONDUCTOR(S) MAY RESULT IN OVERVOLTAGE ON THE EQUIPMENT</p> </div> <ol style="list-style-type: none"> <li>MINIMUM OF 3 1/2" x 10 1/2"</li> <li>FONT: 3/8"</li> <li>WARNING LABEL IS WHITE AND ORANGE</li> </ol>	<p><b>SHEET NOTES</b></p> <p>CODE ABBREVIATIONS:          NATIONAL ELECTRICAL CODE (NEC)          INTERNATIONAL BUILDING CODE (IBC)          INTERNATIONAL RESIDENTIAL CODE (IRC)          INTERNATIONAL FIRE CODE (IFC)          UNDERWRITERS LABORATORY (UL)</p> <ol style="list-style-type: none"> <li>COMBINATION PLACARDS MAY BE USED IN PLACE OF MULTIPLE PLACARDS FOR THE SAME DEVICE. ALL INFORMATION FROM THE MULTIPLE PLACARDS MUST BE PRESENT.</li> <li>BLACK LETTERS WITH YELLOW BACKGROUND MAY BE USED IN PLACE OF THE STANDARD WHITE LETTERS WITH RED BACKGROUND WITH AHJ APPROVAL.</li> <li>ALL INTERIOR AND EXTERIOR DC CONDUIT, ENCLOSURES, RACEWAYS, CABLE ASSEMBLIES, JUNCTION BOXES, COMBINER BOXES AND DISCONNECTS ARE MARKED. (NEC 690.31[G], NEC 690.13 &amp; 690.53)</li> <li>THE MARKINGS ON THE CONDUITS, RACEWAYS AND CABLE ASSEMBLIES ARE EVERY 10 FEET, WITHIN ONE FOOT OF ALL TURNS OR BENDS AND WITHIN ONE FOOT ABOVE AND BELOW ALL PENETRATIONS OF ROOF/CEILING ASSEMBLIES, WALLS AND BARRIERS. (IFC 605.11.1.4, NEC 690.31[G][3])</li> <li>WHERE PV CIRCUITS ARE EMBEDDED IN BUILT-UP, LAMINATE OR MEMBRANE ROOFING MATERIALS IN ROOF AREAS NOT COVERED BY PV MODULES AND ASSOCIATED EQUIPMENT, THE LOCATION OF CIRCUITS SHALL BE CLEARLY MARKED.</li> <li>REQUIRED LABELS SHALL BE PERMANENT AND SUITABLE FOR THE ENVIRONMENT. MATERIALS USED FOR MARKING MUST BE WEATHER RESISTANT. UL STANDARD IS RECOMMENDED TO DETERMINE WEATHER RATING. UL LISTING OF MARKINGS IS NOT REQUIRED. SEE UL LABELING SYSTEM 969 (UL 969)</li> <li>MARKING CONTENT AND FORMAT:             <ol style="list-style-type: none"> <li>ARIAL OR SIMILAR FONT, NON-BOLD.</li> <li>MINIMUM 3/8" LETTER HEIGHT FOR HEADERS.</li> <li>MINIMUM 1/16" LETTER HEIGHT FOR DATA</li> <li>CONTRASTING BACKGROUND AND LETTERING.</li> <li>ALL CAPITAL LETTERS.</li> <li>CONTRASTING SPACE BETWEEN ROWS OF TEXT</li> <li>DIMENSIONS OF PLACARDS ARE APPROXIMATE. MAY BE REDUCED AND / OR INCREASED TO UL APPROVED MANUFACTURED PRODUCT</li> </ol> </li> </ol>								
<p><b>4 NON-LOAD BREAK DC COMBINER / J-BOX</b> SCALE: 1/2" = 1'-0"</p> <div style="border: 1px solid black; padding: 5px; text-align: center;"> <p><b>DO NOT OPEN UNDER LOAD</b></p> </div> <ol style="list-style-type: none"> <li>CODE REFERENCE: NEC 690.13(C)</li> <li>USE ON NON-LOAD BREAK RATED DISCONNECTION.</li> <li>MINIMUM OF 1" x 6"</li> <li>FONT: 3/8" AND .8 WIDTH FACTOR</li> <li>WHITE LETTERS ON A RED BACKGROUND.</li> </ol> <div style="border: 1px solid black; padding: 5px; text-align: center;"> <p><b>DO NOT DISCONNECT UNDER LOAD</b></p> </div>	<p><b>5 DC COMBINER BOX</b> SCALE: 1/2" = 1'-0"</p> <div style="border: 1px solid black; padding: 5px; text-align: center;"> <p><b>DC COMBINER BOX</b></p> <div style="border: 1px solid black; padding: 5px; text-align: center; margin: 5px;"> <p><b>COMBINER # 1</b></p> </div> </div> <ol style="list-style-type: none"> <li>USE PLACARD "COMBINER # 1" WHEN MORE THAN 1 DC COMBINER IS USED. NUMBER ACCORDING TO THREE LINE DIAGRAM AND CALCULATIONS.</li> <li>MINIMUM OF 1" x 4"</li> <li>FONT: 3/8" AND .75 TO .8 WIDTH FACTOR</li> <li>WHITE LETTERS ON A RED BACKGROUND.</li> </ol>	<p><b>6 SWITCHBOARDS</b> SCALE: 1/2" = 1'-0"</p> <div style="border: 1px solid black; padding: 5px; text-align: center;"> <p><b>WARNING</b></p> <p><b>ARC FLASH HAZARD</b></p> <p>APPROPRIATE PPE REQUIRED</p> <p>FAILURE TO COMPLY CAN RESULT IN DEATH OR INJURY</p> <p>REFER TO NFPA 70E</p> </div> <ol style="list-style-type: none"> <li>VERIFY WHICH PLACARD IS REQUIRED WITH AHJ.</li> <li>MINIMUM OF 1" x 4"</li> <li>FONT: 3/8" AND .8 WIDTH FACTOR</li> <li>WARNING LABEL IS WHITE AND ORANGE</li> <li>DATA COLLECTED FROM AS-BUILT INFO, PRIOR TO PTO, BY OTHERS.</li> </ol>	<p><b>ENGINEERING STAMP (if appl.)</b></p> <div style="text-align: center;">  <p>sealed 06jan2022 mike@h2dc.com              H2DC PLLC MO CoA#: 2017002700              ELECTRICAL ONLY              -NOT AN AS BUILT DRAWING SET-</p> </div>								
<p><b>7 MAIN SERVICE PANEL</b> SCALE: 1/4" = 1'-0"</p> <ol style="list-style-type: none"> <li>LOCATE NO MORE THAN 1 m FROM THE SERVICE DISCONNT MEANS TO WHICH THE PV SYSTEMS ARE CONNECTED AND SHALL INDICATE THE LOCATION OF ALL IDENTIFIED RAPID SHUTDOWN SWITCHES IF NOT AT THE SAME LOCATION.</li> </ol> <div style="border: 1px solid black; padding: 5px;"> <p style="text-align: center;"><b>SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN</b></p> <div style="display: flex; justify-content: space-between;"> <div style="width: 45%;"> <p>TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN THE ARRAY.</p> </div> <div style="width: 45%; text-align: center;">  </div> </div> </div> <ol style="list-style-type: none"> <li>CODE REFERENCE: NEC 690.56(C)(1)(a)</li> <li>TITLE: MIN. 3/8" BLACK CHARACTERS ON YELLOW BACKGROUND, REMAINING CHARACTERS MIN. 3/16" IN BLACK ON WHITE BACKGROUND.</li> </ol>	<p><b>8 AC AND DC DISCONNECTS</b> SCALE: 1/4" = 1'-0"</p> <div style="text-align: center;"> <div style="border: 1px solid black; padding: 2px; margin: 5px;">AC DISCONNECT # 1</div> <div style="border: 1px solid black; padding: 2px; margin: 5px;">DC DISCONNECT # 1</div> <p>USE PLACARD "[AC][DC] DISCONNECT # 1" WHEN MORE THAN ONE DISCONNECT IS USED. NUMBER ACCORDING TO THREE LINE DIAGRAM AND CALCULATIONS.</p> <div style="display: flex; justify-content: space-around;"> <div style="border: 1px solid black; padding: 2px;">PHOTOVOLTAIC</div> <div style="border: 1px solid black; padding: 2px;">PHOTOVOLTAIC</div> </div> <div style="display: flex; justify-content: space-around;"> <div style="border: 1px solid black; padding: 2px;">DC DISCONNECT</div> <div style="border: 1px solid black; padding: 2px;">AC DISCONNECT</div> </div> </div> <ol style="list-style-type: none"> <li>PLACE ON ALL AC AND DC DISCONNECTS</li> <li>CODE REFERENCE: NEC 690.13(B)</li> <li>MINIMUM OF 1" x 10 1/2"</li> <li>FONT: 3/8"</li> <li>WHITE LETTERS ON A RED BACKGROUND.</li> </ol>	<p><b>9 J-BOX, DC COMBINER, AND DC DISCONNECT</b> SCALE: 1/4" = 1'-0"</p> <div style="border: 1px solid black; padding: 5px; text-align: center;"> <p><b>WARNING</b></p> <p><b>ELECTRICAL SHOCK HAZARD</b></p> <p>TERMINALS ON THE LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION</p> <p>DC VOLTAGE IS ALWAYS PRESENT WHEN SOLAR MODULES ARE EXPOSED TO SUNLIGHT</p> </div> <ol style="list-style-type: none"> <li>ONLY FOR UNGROUNDED SYSTEMS.</li> <li>PLACED ON ALL ENCLOSURES WITH UNGROUNDED CIRCUITS OR DEVICES WHICH ARE ENERGIZED AND MAY BE EXPOSED DURING SERVICE.</li> <li>MINIMUM OF 3" x 10 1/2"</li> <li>FONT: 3/8"</li> <li>WARNING LABEL IS WHITE AND ORANGE</li> </ol>	<p>27.625 kW PHOTOVOLTAIC PLANS</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 20%;">NAME</td> <td>LSCV455-MO</td> </tr> <tr> <td>ADDRESS</td> <td>455 SW Ward Rd</td> </tr> <tr> <td>ADDRESS</td> <td>Lee's Summit, MO 64081</td> </tr> <tr> <td>APN</td> <td></td> </tr> </table>	NAME	LSCV455-MO	ADDRESS	455 SW Ward Rd	ADDRESS	Lee's Summit, MO 64081	APN	
NAME	LSCV455-MO										
ADDRESS	455 SW Ward Rd										
ADDRESS	Lee's Summit, MO 64081										
APN											
<p><b>10 INVERTER(S)</b> SCALE: 1/2" = 1'-0"</p> <div style="border: 1px solid black; padding: 5px; text-align: center;"> <p><b>INVERTER # 1</b></p> </div> <ol style="list-style-type: none"> <li>USE PLACARD "INVERTER # 1" WHEN MORE THAN 1 INVERTER IS USED. NUMBER ACCORDING TO THREE LINE DIAGRAM AND CALCULATIONS.</li> <li>MINIMUM OF 1" x 4"</li> <li>FONT: 3/8"</li> <li>WHITE LETTERS ON A RED BACKGROUND.</li> </ol>	<p><b>11 RAPID SHUTDOWN SWITCH</b> SCALE: 1/4" = 1'-0"</p> <ol style="list-style-type: none"> <li>A RAPID SHUTDOWN SWITCH SHALL HAVE A LABEL LOCATED ON OR NO MORE THAN 1M (3 FT) FROM THE SWITCH THAT INCLUDES THE FOLLOWING:</li> </ol> <div style="border: 1px solid black; padding: 5px; text-align: center; margin: 5px;"> <p><b>RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM</b></p> </div> <ol style="list-style-type: none"> <li>THE LABEL SHALL BE REFLECTIVE WITH ALL LETTERS CAPITALIZED AND HAVING A MINIMUM HEIGHT OF 9.5 MM (3/8 IN.), IN WHITE ON RED BACKGROUND.</li> </ol>		<p>00002021-00077          701 NE 76th Street          Gladstone, MO 64118          (816) 509-0943</p> <p style="text-align: right;"><b>Sun Smart Technologies</b></p>								

2	<b>AC DISCONNECT, AC SUB-PANEL</b> SCALE: 1/4" = 1'-0"	<b>UTILITY METER, SERVICE PANEL, SUB-PANEL</b> SCALE: 1/4" = 1'-0"	<b>SHEET NOTES</b>																								
	<table border="1"> <tr> <td data-bbox="139 137 512 231"> <b>PV SYSTEM AC DISCONNECT 1</b>            RATED AC OUTPUT CURRENT 14.5 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> <td data-bbox="512 137 823 231"> <b>PHOTOVOLTAIC SYSTEM AC DISCONNECT 1</b>            RATED AC OUTPUT CURRENT 14.5 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> <td data-bbox="823 137 1227 231"> <b>PV SYSTEM AC DISCONNECT 5</b>            RATED AC OUTPUT CURRENT 37.7 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> <td data-bbox="1227 137 1554 231"> <b>PHOTOVOLTAIC SYSTEM AC DISCONNECT 5</b>            RATED AC OUTPUT CURRENT 37.7 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> </tr> <tr> <td data-bbox="139 231 512 322"> <b>PV SYSTEM AC DISCONNECT 2</b>            RATED AC OUTPUT CURRENT 13.05 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> <td data-bbox="512 231 823 322"> <b>PHOTOVOLTAIC SYSTEM AC DISCONNECT 2</b>            RATED AC OUTPUT CURRENT 13.05 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> <td data-bbox="823 231 1227 322"> <b>PV SYSTEM AC COMBINER 1</b>            RATED AC OUTPUT CURRENT 14.5 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> <td data-bbox="1227 231 1554 322"> <b>PHOTOVOLTAIC SYSTEM AC COMBINER 1</b>            RATED AC OUTPUT CURRENT 14.5 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> </tr> <tr> <td data-bbox="139 322 512 413"> <b>PV SYSTEM AC DISCONNECT 3</b>            RATED AC OUTPUT CURRENT 11.6 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> <td data-bbox="512 322 823 413"> <b>PHOTOVOLTAIC SYSTEM AC DISCONNECT 3</b>            RATED AC OUTPUT CURRENT 11.6 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> <td data-bbox="823 322 1227 413"> <b>PV SYSTEM AC COMBINER 2</b>            RATED AC OUTPUT CURRENT 13.05 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> <td data-bbox="1227 322 1554 413"> <b>PHOTOVOLTAIC SYSTEM AC COMBINER 2</b>            RATED AC OUTPUT CURRENT 13.05 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> </tr> <tr> <td data-bbox="139 413 512 504"> <b>PV SYSTEM AC DISCONNECT 4</b>            RATED AC OUTPUT CURRENT 8.7 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> <td data-bbox="512 413 823 504"> <b>PHOTOVOLTAIC SYSTEM AC DISCONNECT 4</b>            RATED AC OUTPUT CURRENT 8.7 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> <td data-bbox="823 413 1227 504"> <b>PV SYSTEM AC COMBINER 3</b>            RATED AC OUTPUT CURRENT 11.6 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> <td data-bbox="1227 413 1554 504"> <b>PHOTOVOLTAIC SYSTEM AC COMBINER 3</b>            RATED AC OUTPUT CURRENT 11.6 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> </tr> </table>	<b>PV SYSTEM AC DISCONNECT 1</b> RATED AC OUTPUT CURRENT 14.5 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PHOTOVOLTAIC SYSTEM AC DISCONNECT 1</b> RATED AC OUTPUT CURRENT 14.5 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PV SYSTEM AC DISCONNECT 5</b> RATED AC OUTPUT CURRENT 37.7 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PHOTOVOLTAIC SYSTEM AC DISCONNECT 5</b> RATED AC OUTPUT CURRENT 37.7 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PV SYSTEM AC DISCONNECT 2</b> RATED AC OUTPUT CURRENT 13.05 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PHOTOVOLTAIC SYSTEM AC DISCONNECT 2</b> RATED AC OUTPUT CURRENT 13.05 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PV SYSTEM AC COMBINER 1</b> RATED AC OUTPUT CURRENT 14.5 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PHOTOVOLTAIC SYSTEM AC COMBINER 1</b> RATED AC OUTPUT CURRENT 14.5 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PV SYSTEM AC DISCONNECT 3</b> RATED AC OUTPUT CURRENT 11.6 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PHOTOVOLTAIC SYSTEM AC DISCONNECT 3</b> RATED AC OUTPUT CURRENT 11.6 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PV SYSTEM AC COMBINER 2</b> RATED AC OUTPUT CURRENT 13.05 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PHOTOVOLTAIC SYSTEM AC COMBINER 2</b> RATED AC OUTPUT CURRENT 13.05 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PV SYSTEM AC DISCONNECT 4</b> RATED AC OUTPUT CURRENT 8.7 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PHOTOVOLTAIC SYSTEM AC DISCONNECT 4</b> RATED AC OUTPUT CURRENT 8.7 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PV SYSTEM AC COMBINER 3</b> RATED AC OUTPUT CURRENT 11.6 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PHOTOVOLTAIC SYSTEM AC COMBINER 3</b> RATED AC OUTPUT CURRENT 11.6 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<table border="1"> <tr> <td data-bbox="1554 137 1911 252"> <b>WARNING DUAL POWER SOURCES #1</b>            RATED AC OUTPUT CURRENT 14.5 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> <td data-bbox="1911 137 2284 252"> <b>WARNING DUAL POWER SOURCES #2</b>            RATED AC OUTPUT CURRENT 13.05 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> </tr> <tr> <td data-bbox="1554 252 1911 362"> <b>WARNING DUAL POWER SOURCES #3</b>            RATED AC OUTPUT CURRENT 11.6 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> <td data-bbox="1911 252 2284 362"> <b>WARNING DUAL POWER SOURCES #4</b>            RATED AC OUTPUT CURRENT 8.7 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> </tr> <tr> <td data-bbox="1554 362 1911 473"> <b>WARNING DUAL POWER SOURCES #5</b>            RATED AC OUTPUT CURRENT 8.7 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> <td data-bbox="1911 362 2284 473"> <b>WARNING DUAL POWER SOURCES #6</b>            RATED AC OUTPUT CURRENT 37.7 AMPS            AC NORMAL OPERATING VOLTAGE 240 VOLTS         </td> </tr> <tr> <td data-bbox="1554 473 1911 604"> <b>BUILDING CONTAINS TWO SOURCES OF POWER: UTILITY, SOLAR PV UTILITY SERVICE DISCONNECT LOCATED BELOW. SOLAR PV SYSTEM DISCONNECT LOCATED [N/E/S/W] WALL OF BUILDING #7</b> </td> <td data-bbox="1911 473 2284 604"> <b>BUILDING CONTAINS TWO SOURCES OF POWER: UTILITY, SOLAR PV UTILITY SERVICE DISCONNECT LOCATED BELOW. SOLAR PV SYSTEM DISCONNECT LOCATED [N/E/S/W] WALL OF BUILDING #8</b> </td> </tr> </table>	<b>WARNING DUAL POWER SOURCES #1</b> RATED AC OUTPUT CURRENT 14.5 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>WARNING DUAL POWER SOURCES #2</b> RATED AC OUTPUT CURRENT 13.05 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>WARNING DUAL POWER SOURCES #3</b> RATED AC OUTPUT CURRENT 11.6 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>WARNING DUAL POWER SOURCES #4</b> RATED AC OUTPUT CURRENT 8.7 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>WARNING DUAL POWER SOURCES #5</b> RATED AC OUTPUT CURRENT 8.7 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>WARNING DUAL POWER SOURCES #6</b> RATED AC OUTPUT CURRENT 37.7 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>BUILDING CONTAINS TWO SOURCES OF POWER: UTILITY, SOLAR PV UTILITY SERVICE DISCONNECT LOCATED BELOW. SOLAR PV SYSTEM DISCONNECT LOCATED [N/E/S/W] WALL OF BUILDING #7</b>	<b>BUILDING CONTAINS TWO SOURCES OF POWER: UTILITY, SOLAR PV UTILITY SERVICE DISCONNECT LOCATED BELOW. SOLAR PV SYSTEM DISCONNECT LOCATED [N/E/S/W] WALL OF BUILDING #8</b>	<p>CODE ABBREVIATIONS:          NATIONAL ELECTRICAL CODE (NEC)          INTERNATIONAL BUILDING CODE (IBC)          INTERNATIONAL RESIDENTIAL CODE (IRC)          INTERNATIONAL FIRE CODE (IFC)          UNDERWRITERS LABORATORY (UL)</p> <ol style="list-style-type: none"> <li>COMBINATION PLACARDS MAY BE USED IN PLACE OF MULTIPLE PLACARDS FOR THE SAME DEVICE. ALL INFORMATION FROM THE MULTIPLE PLACARDS MUST BE PRESENT.</li> <li>BLACK LETTERS WITH YELLOW BACKGROUND MAY BE USED IN PLACE OF THE STANDARD WHITE LETTERS WITH RED BACKGROUND WITH AHJ APPROVAL.</li> <li>ALL INTERIOR AND EXTERIOR DC CONDUIT, ENCLOSURES, RACEWAYS, CABLE ASSEMBLIES, JUNCTION BOXES, COMBINER BOXES AND DISCONNECTS ARE MARKED. (NEC 690.31[G], NEC 690.53)</li> <li>REQUIRED LABELS SHALL BE PERMANENT AND SUITABLE FOR THE ENVIRONMENT. MATERIALS USED FOR MARKING MUST BE WEATHER RESISTANT. UL STANDARD IS RECOMMENDED TO DETERMINE WEATHER RATING. UL LISTING OF MARKINGS IS NOT REQUIRED. SEE UL LABELING SYSTEM 969 (UL 969)</li> <li>MARKING CONTENT AND FORMAT:             <ol style="list-style-type: none"> <li>ARIAL OR SIMILAR FONT, NON-BOLD.</li> <li>MINIMUM 3/8" LETTER HEIGHT FOR HEADERS.</li> <li>MINIMUM 1/16" LETTER HEIGHT FOR DATA</li> <li>CONTRASTING BACKGROUND AND LETTERING.</li> <li>ALL CAPITAL LETTERS.</li> <li>CONTRASTING SPACE BETWEEN ROWS OF TEXT</li> <li>DIMENSIONS OF PLACARDS ARE APPROXIMATE. MAY BE REDUCED AND / OR INCREASED TO UL APPROVED MANUFACTURED PRODUCT</li> </ol> </li> <li>ANSI Z535.4 PRODUCT SAFETY SIGNS AND LABELS: THIS INFORMATIONAL NOTE AND ITS REQUIREMENTS FOR PLACARDS MAY BE USED WITH PRIOR APPROVAL OF THE AHJ. MOST NOTABLE DIFFERENCES IS COLOR OF PLACARDS AND USE OF HAND WRITTEN VALUES WITH INDUSTRIAL MARKERS ON STANDARD PLACARDS WHERE THE VALUE MAY CHANGE AT A FUTURE DATE. I.E. ADDING MODULES AT A FUTURE DATE, OR STANDARD PLACARD MANUFACTURER INSTALLED ON ELECTRICAL COMPONENT. AHJ APPROVAL REQUIRED. (SEE NOTE #1 FOR INDIVIDUAL PLACARDS)</li> </ol>
<b>PV SYSTEM AC DISCONNECT 1</b> RATED AC OUTPUT CURRENT 14.5 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PHOTOVOLTAIC SYSTEM AC DISCONNECT 1</b> RATED AC OUTPUT CURRENT 14.5 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PV SYSTEM AC DISCONNECT 5</b> RATED AC OUTPUT CURRENT 37.7 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PHOTOVOLTAIC SYSTEM AC DISCONNECT 5</b> RATED AC OUTPUT CURRENT 37.7 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS																								
<b>PV SYSTEM AC DISCONNECT 2</b> RATED AC OUTPUT CURRENT 13.05 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PHOTOVOLTAIC SYSTEM AC DISCONNECT 2</b> RATED AC OUTPUT CURRENT 13.05 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PV SYSTEM AC COMBINER 1</b> RATED AC OUTPUT CURRENT 14.5 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PHOTOVOLTAIC SYSTEM AC COMBINER 1</b> RATED AC OUTPUT CURRENT 14.5 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS																								
<b>PV SYSTEM AC DISCONNECT 3</b> RATED AC OUTPUT CURRENT 11.6 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PHOTOVOLTAIC SYSTEM AC DISCONNECT 3</b> RATED AC OUTPUT CURRENT 11.6 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PV SYSTEM AC COMBINER 2</b> RATED AC OUTPUT CURRENT 13.05 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PHOTOVOLTAIC SYSTEM AC COMBINER 2</b> RATED AC OUTPUT CURRENT 13.05 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS																								
<b>PV SYSTEM AC DISCONNECT 4</b> RATED AC OUTPUT CURRENT 8.7 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PHOTOVOLTAIC SYSTEM AC DISCONNECT 4</b> RATED AC OUTPUT CURRENT 8.7 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PV SYSTEM AC COMBINER 3</b> RATED AC OUTPUT CURRENT 11.6 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>PHOTOVOLTAIC SYSTEM AC COMBINER 3</b> RATED AC OUTPUT CURRENT 11.6 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS																								
<b>WARNING DUAL POWER SOURCES #1</b> RATED AC OUTPUT CURRENT 14.5 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>WARNING DUAL POWER SOURCES #2</b> RATED AC OUTPUT CURRENT 13.05 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS																										
<b>WARNING DUAL POWER SOURCES #3</b> RATED AC OUTPUT CURRENT 11.6 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>WARNING DUAL POWER SOURCES #4</b> RATED AC OUTPUT CURRENT 8.7 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS																										
<b>WARNING DUAL POWER SOURCES #5</b> RATED AC OUTPUT CURRENT 8.7 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS	<b>WARNING DUAL POWER SOURCES #6</b> RATED AC OUTPUT CURRENT 37.7 AMPS AC NORMAL OPERATING VOLTAGE 240 VOLTS																										
<b>BUILDING CONTAINS TWO SOURCES OF POWER: UTILITY, SOLAR PV UTILITY SERVICE DISCONNECT LOCATED BELOW. SOLAR PV SYSTEM DISCONNECT LOCATED [N/E/S/W] WALL OF BUILDING #7</b>	<b>BUILDING CONTAINS TWO SOURCES OF POWER: UTILITY, SOLAR PV UTILITY SERVICE DISCONNECT LOCATED BELOW. SOLAR PV SYSTEM DISCONNECT LOCATED [N/E/S/W] WALL OF BUILDING #8</b>																										
1	<b>AC COMBINER</b> SCALE: 1/2" = 1'-0" <div style="border: 1px solid black; padding: 10px; margin: 10px 0;"> <b>AC COMBINER BOX</b> </div> <div style="border: 1px solid black; padding: 10px; margin: 10px 0;"> <b>COMBINER # 1</b> </div> <ol style="list-style-type: none"> <li>USE PLACARD "COMBINER # 1" WHEN MORE THAN 1 AC COMBINER IS USED. NUMBER ACCORDING TO THREE LINE DIAGRAM AND CALCULATIONS.</li> <li>MINIMUM OF 1" x 4"</li> <li>FONT: 3/8" AND .75 TO .8 WIDTH FACTOR MINIMUM.</li> <li>WHITE LETTERS ON A RED BACKGROUND.</li> <li>PLACARDS MAY BE COMBINED TOGETHER. I.E. "AC COMBINER BOX #1". MINIMUM REQUIREMENTS LISTED ABOVE.</li> </ol>	<ol style="list-style-type: none"> <li>PLACARD PLACED ON EACH SOLAR SYSTEM DISCONNECTING COMPONENT.</li> <li>VALUES MUST MATCH EQUIPMENT CALCULATIONS. SEE SHEET "E-001 / AC DISCONNECT [#]"</li> <li>CODE REFERENCE: NEC 690.54</li> <li>MINIMUM OF 1 1/2" x 8 1/2" (TOP), 1 3/4" x 6 1/2" (BOT)</li> <li>FONT: 3/8" HEADER, 3/16" DATA</li> <li>WHITE LETTERS ON A RED BACKGROUND.</li> </ol>	<p>27.625 kW PHOTOVOLTAIC PLANS</p> <p>000002021-00077</p> <p>701 NE 76th Street          Gladstone, MO 64118          (816) 509-0943</p> <p>27.625 kW PHOTOVOLTAIC PLANS</p> <p>NAME LSCV455-MO</p> <p>ADDRESS 455 SW Ward Rd</p> <p>ADDRESS Lee's Summit, MO 64081</p> <p>APN</p> <p>27.625 kW PHOTOVOLTAIC PLANS</p> <p>000002021-00077</p> <p>701 NE 76th Street          Gladstone, MO 64118          (816) 509-0943</p> <p>27.625 kW PHOTOVOLTAIC PLANS</p> <p>NAME LSCV455-MO</p> <p>ADDRESS 455 SW Ward Rd</p> <p>ADDRESS Lee's Summit, MO 64081</p> <p>APN</p>																								
4	<b>MAP PLACARD: MAIN SERVICE PANEL AND PV INVERTER (IF NOT SAME LOCATION)</b> SCALE: 1/2" = 1'-0" <div style="border: 1px solid black; padding: 10px; margin: 10px 0;"> <h1>CAUTION</h1> <p>POWER TO THIS BUILDING IS SUPPLIED FROM THE FOLLOWING SOURCES WITH DISCONNECTS LOCATED AS SHOWN:</p> <p>QTY 6 AC DISCO</p> <p>QTY 6 AC COMBINER</p> <p>QTY 6 UTILITY METER BANK &amp; SUB PANEL</p> <p>SOLAR ARRAY</p> <p><b>WARNING</b></p> <p>ELECTRIC SHOCK HAZARD - DO NOT TOUCH TERMINALS</p> <p>TERMINALS ON BOTH THE LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION</p> </div> <ol style="list-style-type: none"> <li>PLACARD PLACED AT ELECTRICAL SERVICE AND AT THE PV INVERTER AND PV DISCONNECTS IF NOT AT THE SAME LOCATION.</li> <li>MAP PLACARD PROVIDES A DIRECTORY OF THE SERVICE DISCONNECTING MEANS AND PHOTOVOLTAIC SYSTEM DISCONNECTION MEANS.</li> <li>CODE REFERENCE: NEC 690.56(A)(B), 705.10</li> <li>WHITE LETTERS ON A RED BACKGROUND.</li> <li>MINIMUM OF 7 3/4" x 5"</li> <li>FONT: 3/4" "CAUTION", 1/4" "WARNING", 3/16" HEADER, 1/8" DATA AND NOTES</li> <li>PLACARD WILL BE PLACED ADJACENT TO THE MAIN SERVICE DISCONNECT IN A LOCATION CLEARLY VISIBLE FROM WHERE THE DISCONNECT IS OPERATED. (CFC 605.11.1.3 &amp; CRC R331.2.3)</li> </ol> <div style="border: 1px solid black; padding: 5px; margin: 10px 0;"> <p><b>WARNING</b></p> <p><b>ELECTRIC SHOCK HAZARD</b></p> <p>DO NOT TOUCH TERMINALS          TERMINALS ON BOTH LINE &amp; LOAD SIDES          MAY BE ENERGIZED IN OPEN POSITION</p> <p>DO NOT DISCONNECT FUSES UNDER LOAD</p> <p>THE DC CONDUCTORS OF THIS          PHOTOVOLTAIC SYSTEM ARE          UNGROUNDED AND MAY BE ENERGIZED</p> <p>PHOTOVOLTAIC SYSTEM          DC DISCONNECT</p> <p><b>AUTHORIZED PERSONNEL ONLY</b></p> </div> <p>Note: WARNING labels must resemble format in example above with over-sized WARNING, exclamation point in triangle, colors, etc.</p>	<b>MAP PLACARD: MAIN SERVICE PANEL AND PV INVERTER (IF NOT SAME LOCATION)</b> SCALE: 1/2" = 1'-0" <div style="border: 1px solid black; padding: 10px; margin: 10px 0;"> <h1>CAUTION</h1> <p>POWER TO THIS BUILDING IS SUPPLIED FROM THE FOLLOWING SOURCES WITH DISCONNECTS LOCATED AS SHOWN:</p> <p>QTY 6 AC DISCO</p> <p>QTY 6 AC COMBINER</p> <p>QTY 6 UTILITY METER BANK &amp; SUB PANEL</p> <p>SOLAR ARRAY</p> <p><b>WARNING</b></p> <p>ELECTRIC SHOCK HAZARD - DO NOT TOUCH TERMINALS</p> <p>TERMINALS ON BOTH THE LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION</p> </div> <ol style="list-style-type: none"> <li>PLACARD PLACED AT ELECTRICAL SERVICE AND AT THE PV INVERTER AND PV DISCONNECTS IF NOT AT THE SAME LOCATION.</li> <li>MAP PLACARD PROVIDES A DIRECTORY OF THE SERVICE DISCONNECTING MEANS AND PHOTOVOLTAIC SYSTEM DISCONNECTION MEANS.</li> <li>CODE REFERENCE: NEC 690.56(A)(B), 705.10</li> <li>WHITE LETTERS ON A RED BACKGROUND.</li> <li>MINIMUM OF 6 1/2" x 6 1/2"</li> <li>FONT: 3/4" "CAUTION", 1/4" HEADER, 1/8" DATA AND NOTES</li> <li>PLACARD WILL BE PLACED ADJACENT TO THE MAIN SERVICE DISCONNECT IN A LOCATION CLEARLY VISIBLE FROM WHERE THE DISCONNECT IS OPERATED. (CFC 605.11.1.3 &amp; CRC R331.2.3)</li> </ol>	<div style="text-align: center;"> <p>sealed 06jan2022 mike@h2dc.com          H2DC PLLC MO CoA#: 2017002700          ELECTRICAL ONLY          -NOT AN AS BUILT DRAWING SET-</p> </div> <p><b>RESPONSIBILITY NOTES</b></p> <ol style="list-style-type: none"> <li>PRIME CONTRACTOR / PERMIT APPLICANT SIGNER IS RESPONSIBLE FOR THE DESIGN AND SPECIFICATIONS OF THE PHOTOVOLTAIC SYSTEM INSTALLATION. PRIME CONTRACTOR / PERMIT APPLICANT SIGNER WILL BE RESPONSIBLE FOR COLLECTION OF EXISTING ONSITE INFORMATION REQUIREMENTS TO DESIGN, SPECIFY, AND INSTALL THE EXTERIOR MOUNTED PORTION OF THE PHOTOVOLTAIC SYSTEM DETAILED IN THIS DOCUMENT.</li> <li>ADVANCED SOLAR SOLUTIONS, INC IS RESPONSIBLE FOR APPLYING SUPPLIED INFORMATION INTO A SET OF PERMIT DRAWINGS. ANY CHANGES TO DRAWINGS ARE SUBJECT TO CONTRACT CONDITIONS BETWEEN THE CLIENT AND ADVANCED SOLAR SOLUTIONS, INC. IN ACCORDANCE WITH THE REQUIREMENTS OF THE AHJ.</li> </ol>																								
			<p>RELEASE 12/29/2021</p> <p>DATE 12/29/2021</p> <p>SUBMIT FOR PERMIT</p> <p>DYNAMIC PLACARDS</p> <p>P-002</p>																								

PV MODULE CUT SHEET



**Q.PEAK DUO L-G6.2**

**415-435**

ENDURING HIGH PERFORMANCE



**Q.ANTUM TECHNOLOGY: LOW LEVELISED COST OF ELECTRICITY**

Higher yield per surface area, lower BOS costs, higher power classes, and an efficiency rate of up to 20.5%.



**INNOVATIVE ALL-WEATHER TECHNOLOGY**

Optimal yields, whatever the weather with excellent low-light and temperature behaviour.



**ENDURING HIGH PERFORMANCE**

Long-term yield security with Anti LID Technology, Anti PID Technology<sup>1</sup>, Hot-Spot Protect and Traceable Quality Tra.Q™.



**EXTREME WEATHER RATING**

High-tech aluminium alloy frame, certified for high snow (5400 Pa) and wind loads (2400 Pa).



**A RELIABLE INVESTMENT**

Inclusive 12-year product warranty and 25-year linear performance warranty<sup>2</sup>.



**STATE OF THE ART MODULE TECHNOLOGY**

Q.ANTUM DUO combines cutting edge cell separation and innovative wiring with Q.ANTUM Technology.

<sup>1</sup> APT test conditions according to IEC/TS 62804-1:2015, method B (-1500 V, 168h)  
<sup>2</sup> See data sheet on rear for further information.

**THE IDEAL SOLUTION FOR:**




Engineered in Germany



**MECHANICAL SPECIFICATION**

Format	81.9 in × 40.6 in × 1.38 in (including frame) (2080 mm × 1030 mm × 35 mm)
Weight	55.1 lbs (25 kg)
Front Cover	0.13 in (3.2 mm) thermally pre-stressed glass with anti-reflection technology
Back Cover	Composite film
Frame	Anodized aluminum
Cell	6 × 24 monocrystalline Q.ANTUM solar half cells
Junction Box	2.09-3.98 × 1.26-2.36 × 0.59-0.71 in (53-101 × 32-60 × 15-18 mm), Protection class IP67, with bypass diodes
Cable	4 mm <sup>2</sup> Solar cable, (+) ≥ 55.1 in (1400 mm), (-) ≥ 55.1 in (1400 mm)
Connector	Stäubli MC4-Evo2, Hanwha Q CELLS HQC4, Amphenol UTX, Renhe 05-8, JMTHY JM601A, Tongling Cable01S-F, IP68 or Friends PV2e, IP67

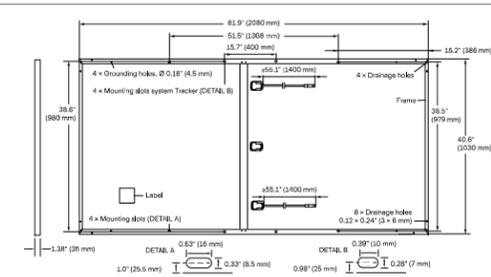


**ELECTRICAL CHARACTERISTICS**

POWER CLASS		415	420	425	430	435	
MINIMUM PERFORMANCE AT STANDARD TEST CONDITIONS, STC <sup>1</sup> (POWER TOLERANCE +5 W / -0 W)							
Minimum	Power at MPP <sup>1</sup>	P <sub>MPP</sub> [W]	415	420	425	430	435
	Short Circuit Current <sup>1</sup>	I <sub>SC</sub> [A]	10.74	10.79	10.83	10.88	10.92
	Open Circuit Voltage <sup>1</sup>	V <sub>OC</sub> [V]	48.63	48.88	49.13	49.38	49.62
	Current at MPP	I <sub>MPP</sub> [A]	10.23	10.27	10.32	10.36	10.41
	Voltage at MPP	V <sub>MPP</sub> [V]	40.58	40.89	41.20	41.50	41.81
	Efficiency <sup>1</sup>	η [%]	≥ 19.4	≥ 19.6	≥ 19.8	≥ 20.1	≥ 20.3
MINIMUM PERFORMANCE AT NORMAL OPERATING CONDITIONS, NMOT <sup>2</sup>							
Minimum	Power at MPP	P <sub>MPP</sub> [W]	310.6	314.4	318.1	321.8	325.6
	Short Circuit Current	I <sub>SC</sub> [A]	8.65	8.69	8.73	8.76	8.80
	Open Circuit Voltage	V <sub>OC</sub> [V]	45.86	46.09	46.33	46.56	46.80
	Current at MPP	I <sub>MPP</sub> [A]	8.05	8.09	8.12	8.16	8.19
	Voltage at MPP	V <sub>MPP</sub> [V]	38.59	38.88	39.17	39.46	39.75


<sup>1</sup> Measurement tolerances P<sub>MPP</sub> ± 3%, I<sub>SC</sub>, V<sub>OC</sub> ± 5% at STC; 1000 W/m<sup>2</sup>, 25 ± 2°C, AM 1.5 according to IEC 60904-3 • 2800 W/m<sup>2</sup>, NMOT, spectrum AM 1.5

**Q CELLS PERFORMANCE WARRANTY**

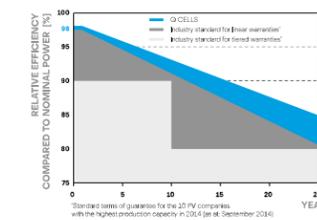

At least 98% of nominal power during first year. Thereafter max. 0.54% degradation per year. At least 93.1% of nominal power up to 10 years. At least 85% of nominal power up to 25 years.

**PERFORMANCE AT LOW IRRADIANCE**

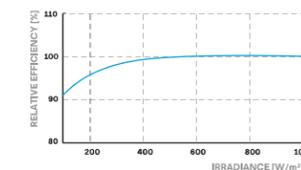

Typical module performance under low irradiance conditions in comparison to STC conditions (25°C, 1000 W/m<sup>2</sup>)

**TEMPERATURE COEFFICIENTS**

Temperature Coefficient of I <sub>SC</sub>	α [%/K]	+0.04	Temperature Coefficient of V <sub>OC</sub>	β [%/K]	-0.27
Temperature Coefficient of P <sub>MPP</sub>	γ [%/K]	-0.36	Nominal Module Operating Temperature	NMOT [°F]	109 ± 5.4 (43 ± 3°C)

**PROPERTIES FOR SYSTEM DESIGN**

Maximum System Voltage V <sub>sys</sub>	[V]	1500 (IEC) / 1500 (UL)	PV module classification	Class II
Maximum Series Fuse Rating	[A DC]	20	Fire Rating based on ANSI / UL 61730	C (IEC) / TYPE 1 (UL)
Max. Design Load, Push / Pull <sup>3</sup>	[lbs / ft <sup>2</sup> ]	75 (3600 Pa) / 33 (1600 Pa)	Permitted Module Temperature on Continuous Duty	-40°F up to +185°F (-40°C up to +85°C)
Max. Test Load, Push / Pull <sup>3</sup>	[lbs / ft <sup>2</sup> ]	113 (5400 Pa) / 50 (2400 Pa)		

<sup>3</sup> See Installation Manual

**QUALIFICATIONS AND CERTIFICATES**

UL 61730, CE-compliant, IEC 61215-2016, IEC 61730-2016, U.S. Patent No. 9,893,215 (solar cells)

**PACKAGING INFORMATION**

Horizontal packaging	83.9 in / 2130 mm	42.5 in / 1080 mm	47.1 in / 1196 mm	1687 lbs / 765 kg	24 pallets	22 pallets	29 modules
Vertical packaging	84.6 in / 2150 mm	45.3 in / 1150 mm	48.0 in / 1220 mm	1717 lbs / 779 kg	26 pallets	22 pallets	29 modules

**Note:** Installation instructions must be followed. See the installation and operating manual or contact our technical service department for further information on approved installation and use of this product. Q CELLS supplies solar modules in two different stacking methods, depending on the location of manufacture (modules are packed horizontally or vertically). You can find more detailed information in the document "Packaging and Transport Information", available from Q CELLS.

Hanwha Q CELLS America Inc.  
 400 Spectrum Center Drive, Suite 1400, Irvine, CA 92618, USA | TEL +1 949 748 59 96 | EMAIL inquiry@us.q-cells.com | WEB www.q-cells.us

Sun Smart Technologies	00002021-00077	27.625 kW PHOTOVOLTAIC PLANS	REV	DATE	RELEASE
	701 NE 76th Street Gladstone, MO 64118 (816) 509-0943	NAME LSCV455-MO ADDRESS 455 SW Ward Rd ADDRESS Lee's Summit, MO 64081 APN	12/29/2021	SUBMIT FOR PERMIT	
					R-100
					EQUIP. CUT SHEETS

Specifications subject to technical changes. © Q CELLS Q.PEAK DUO L-G6.2\_DA\_415-435\_2020-06\_Rev01\_NA







E Mount AIR® / RT - MINI




Available for 32,33,35,40,46 and 50 mm PV frame thickness

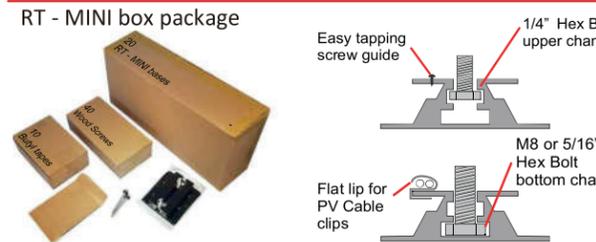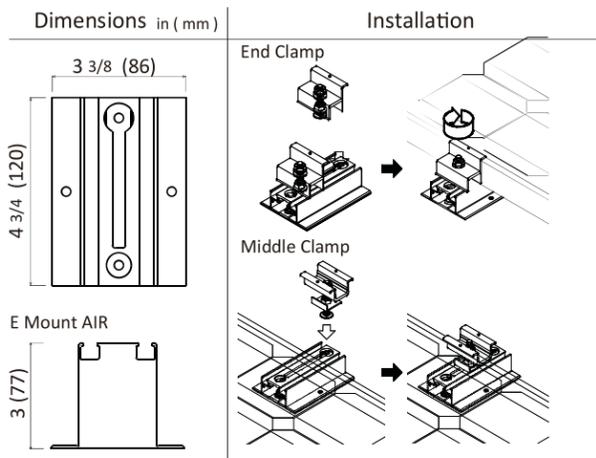

Material Description	
E Mount AIR / RT - MINI	Anodized aluminum
Clamps	
Microinverter bracket Cable holder bracket	
Hardware	Stainless steel
Flexible Flashing	RT Butyl (ICC ESR 3575)
Cable clamp	PBT

20 Year Limited Warranty  
\* Please download and review the engineering report.  
PAT US8647009

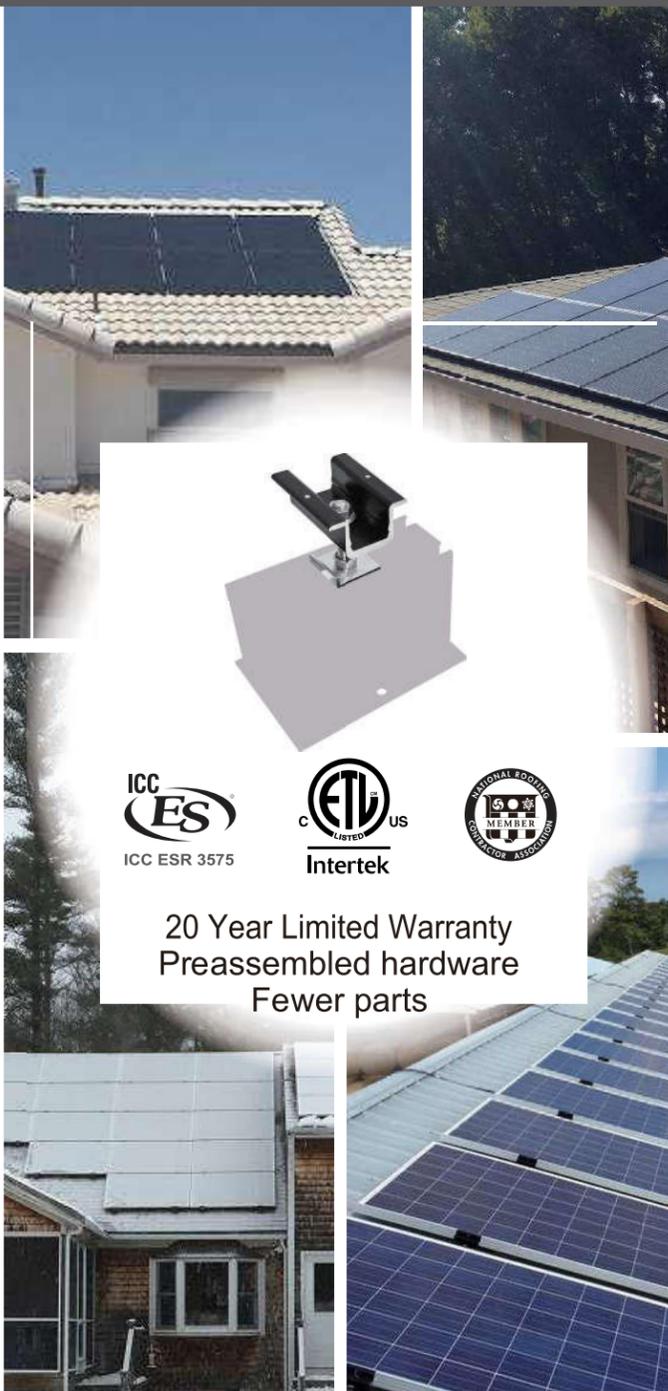


ICC ESR 3575


ETL LISTED Intertek

20 Year Limited Warranty  
Preassembled hardware  
Fewer parts

E Mount AIR is the only rail-less PV mounting system with integrated flexible flashing certified by the ICC.

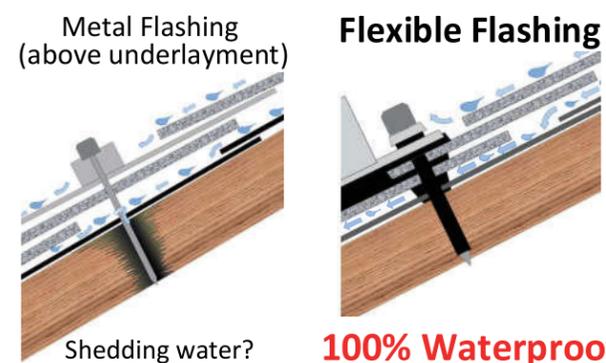

Design Guide ; E Mount AIR

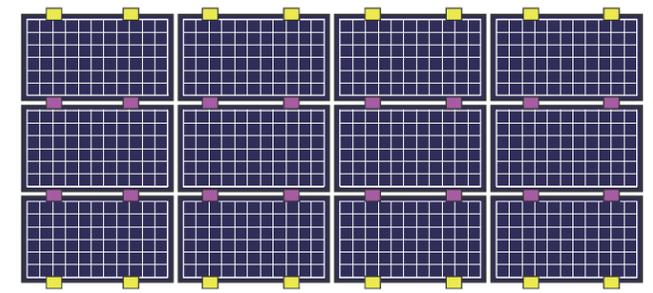

- Sample B.O.M.
- 16 End Clamps
  - 16 Middle Clamps
  - 32 E Mount AIR Bases
  - 12 Microinverter brackets
  - 12 Cable Holder brackets
  - 4 Skirts: (Eave cover)
- Option Items
- # of panels
  - # of panels
  - # of rows

RT - MINI      E Mount series Options



Roof Tech Inc.  
www.roof-tech.us info@roof-tech.us  
10620 Trenea Street, Suite 230, San Diego, CA 92131  
858.935.6064

GEN II / RT - MINI  
Product Brochure

Sun Smart Technologies	00002021-00077	RELEASE	EQUIP. CUT SHEETS
	701 NE 76th Street Gladstone, MO 64118 (816) 509-0943	DATE 12/29/2021	
27.625 kW PHOTOVOLTAIC PLANS	REV	SUBMIT FOR PERMIT	R-103
NAME LSCV455-MO	ADDRESS 455 SW Ward Rd		APN
ADDRESS Lee's Summit, MO 64081	ADDRESS		