



LEE'S SUMMIT  
GRID: 0901

94°24'12"W 38°55'16"N NAD83  
Maximo WO #: 23477364

THE ROUTE OF THE GAS SERVICE  
MUST BE BROUGHT TO GRADE AND  
CLEARED OF BUILDING MATERIAL  
BY THE CUSTOMER PRIOR TO  
INSTALLATION.




GRANULAR BACKFILL, IF REQUIRED,  
IS TO BE PROVIDED BY THE  
CUSTOMER. IN WHICH CASE, SPIRE  
WILL NOT BE RESPONSIBLE FOR  
THE DISPOSAL OF EXCESS SPOIL  
FROM THE DITCH.

SPIRE TO ONLY PATCH THAT  
PAVEMENT REMOVED FOR THE  
INSTALLATION OF THE GAS  
SERVICE.

PIPE SYSTEM  
PRESSURE SYS - C-004  
MINOP -  
MOP - 15 PSIG  
MAOP - 15 PSIG  
DESIGNED MAOP - 60 PSIG  
TEST PRESSURE - 100 PSIG

CUSTOMER APPROVAL SIGNATURE:

GAS METER MUST COMPLY WITH  
REQUIREMENTS SHOWN BELOW

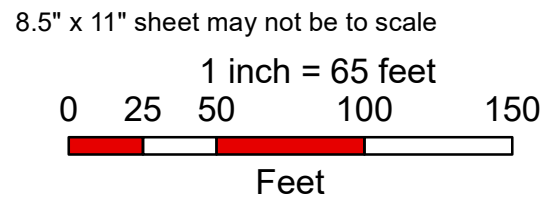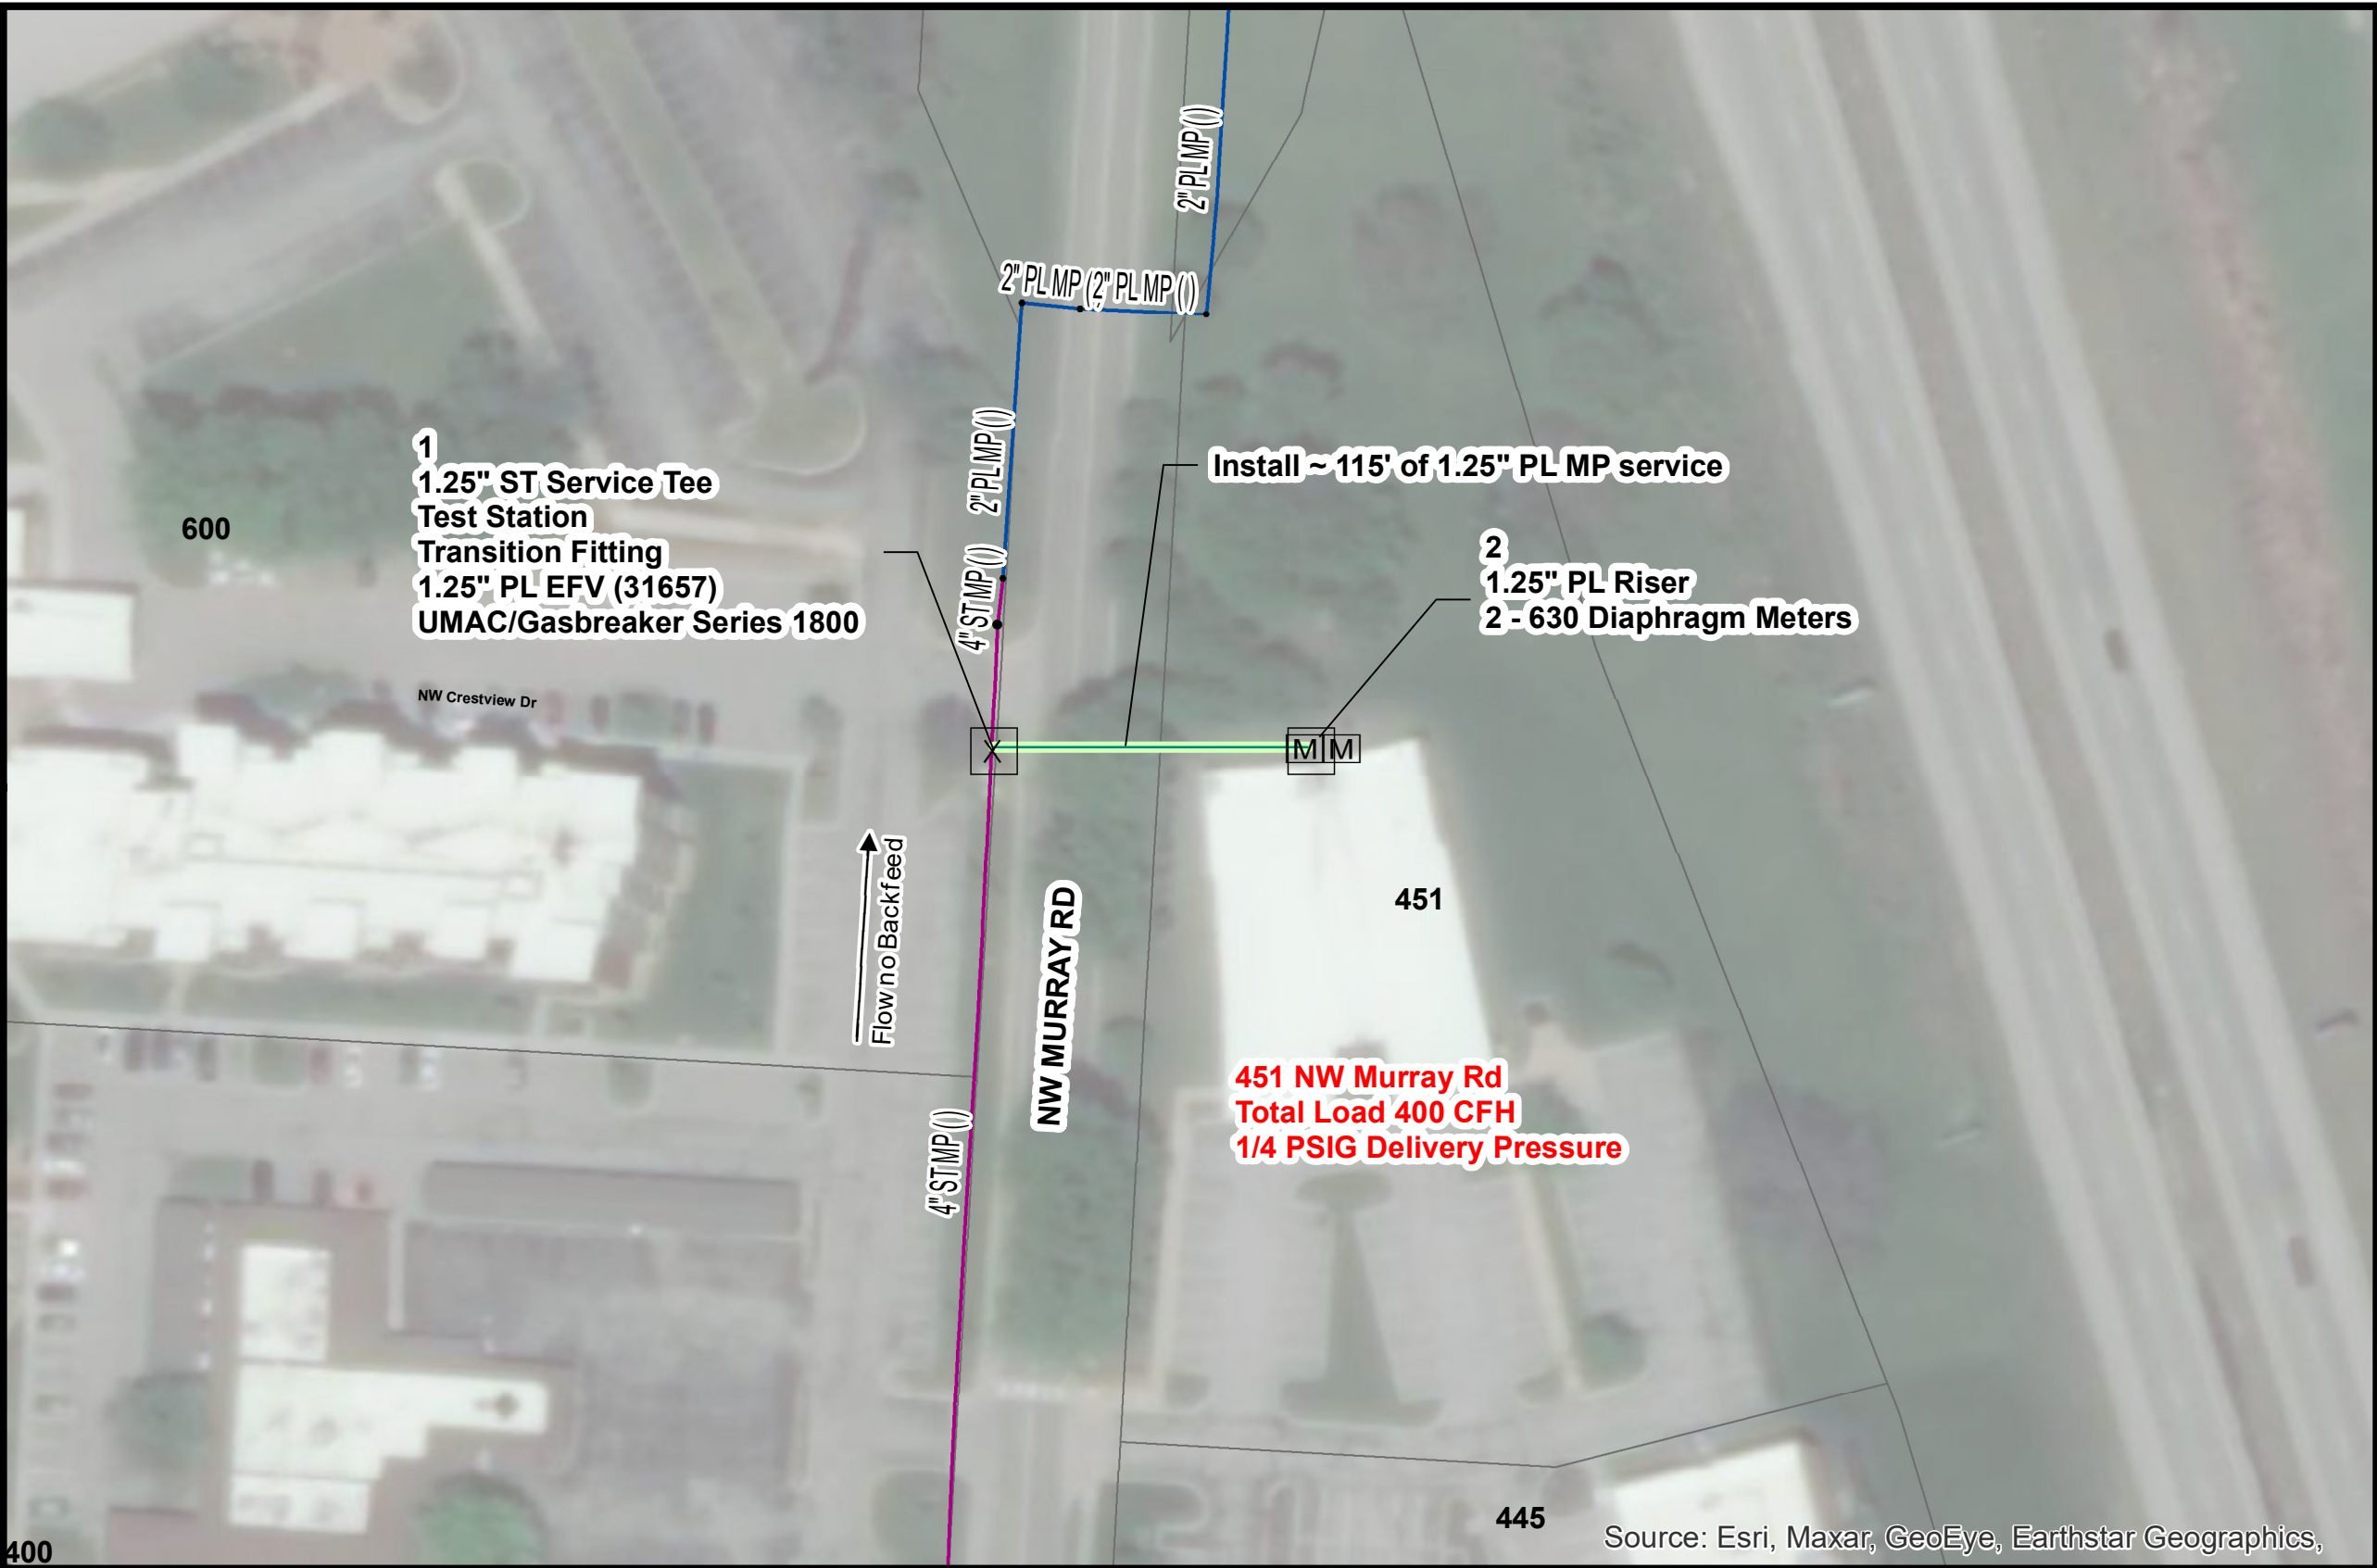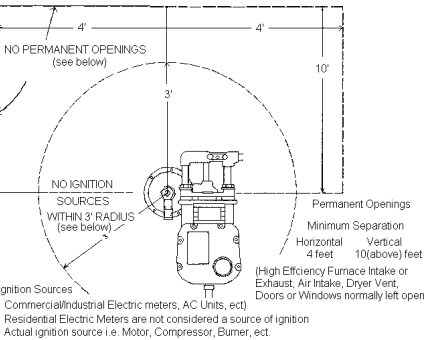

DESIGNER: BKW	REVISION DATE(S):
DATE: 12-28-21	

spire  
Missouri West

KCUC  
LEE'S SUMMIT  
451 NW MURRAY RD