— 1 1/2" DIA. HOLE F\_ 1/4 X 1−1/2 X 4" WELD TO INSIDE OF 10" PIPE (TYP. 4 LOCATIONS) — — 1-10"DIA. STD PIPE X 1-6 3/4" DRILL & CTSK HOLES FOR 5/16" DIA. FHMS X 1" LONG / (TYP. 4 LOCATIONS). TACK WELD 5/16" DIA. HEX / NUT TO BACK OF BAR. 1-10"DIA. STD NOTE: ALL WELDS TO BE-- PIPE X 6'-1" CONTINUOUS & GROUND SMOOTH

KEYPAD BOLLARD DETAIL

————— BUFFERS/ EASEMENTS — · — PROPERTY LINES 6'-0" HIGH, ORNAMENTAL IRON FENCE LARGE STONE BORDER -REF. CIVIL DRAWINGS CONCRETE PAVING -REF. CIVIL DWGS. LANDSCAPE AREA -REF. LANDSCAPE DRAWINGS 6" STEEL PIPE BOLLARD -REF. 2/A1.1 4" STRIPES PAINTED ON PAVING AT 2'-0" O.C. KNOX BOX — MODEL #3261 PER CITY REQUIREMENTS SITE PLAN NOTES . REFER CIVIL DRAWINGS FOR RECORDED PLAT/SURVEY FOR PROPERTY

SITE PLAN LEGEND


BOUNDARIES, EASEMENTS, SETBACKS, ETC. REPORT ANY DISCREPANCIES TO ARCHITECT PRIOR TO CONSTRUCTION.

2. REFER CIVIL DRAWINGS FOR ALL DRIVE, PARKING, AND CURB LOCATIONS, DETAILS, AND DIMENSIONAL INFORMATION.

4. PROVIDE CONCRETE FILLED STEEL TUBE BOLLARD AT BUILDING CORNERS AND BUILDING ENTRIES AT DRIVE AREAS (REF. DETAIL 2/A1.1 FOR LOCATIONS, CIVIL

5. REFER LANDSCAPE DRAWINGS FOR EXTENTS OF REQUIRED LANDSCAPING. 6. SECURITY CONTRACTOR TO PROVIDE MANUAL FAIL SAFE OPERATION, KEY BOX, AND 20'-0" GATE OPENING FOR ELECTRICAL GATE PER FIRE MARSHALL REQUIREMENTS.

NOTE: PROVIDE KEY LOCK ON OUTSIDE OF GATE & FREE EXIT ON INSIDE OF MAN GATE AT MAIN ENTRY. 1'-6" RADIUS OF EXPANDED METAL W/ SAME FINISH AS GATE TO BE PROVIDED AT LATCH. PROVIDE 5"-7" WELDED. HINGES.

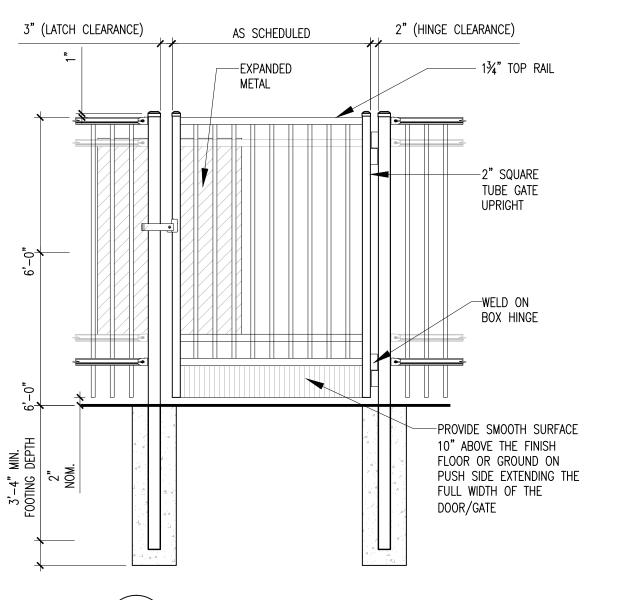

IRON MAN GATE ELEVATIONS SCALE: 1/2" = 1'-0"


PROJECT NO. 2035 DATE: 12.16.2021

DRAWN:

REVISIONS: A CITY COMMENTS 01.20.2022

> SITE PLAN

SHEET NO.

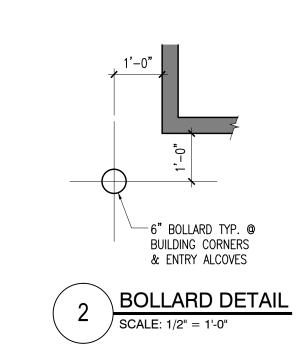

20' BUILDING

15' UTILITY EASEMENT

TRUE PLAN NORTH NORTH

DRAWN:


REVISIONS: ⚠ CITY COMMENTS 01.20.2022

> ROOF PLAN

SHEET NO.

4. MECHANICAL CONDENSING UNITS TO BE BUILT UP SO THAT RACK DOES NOT

IMPEDE WATER FLOW.

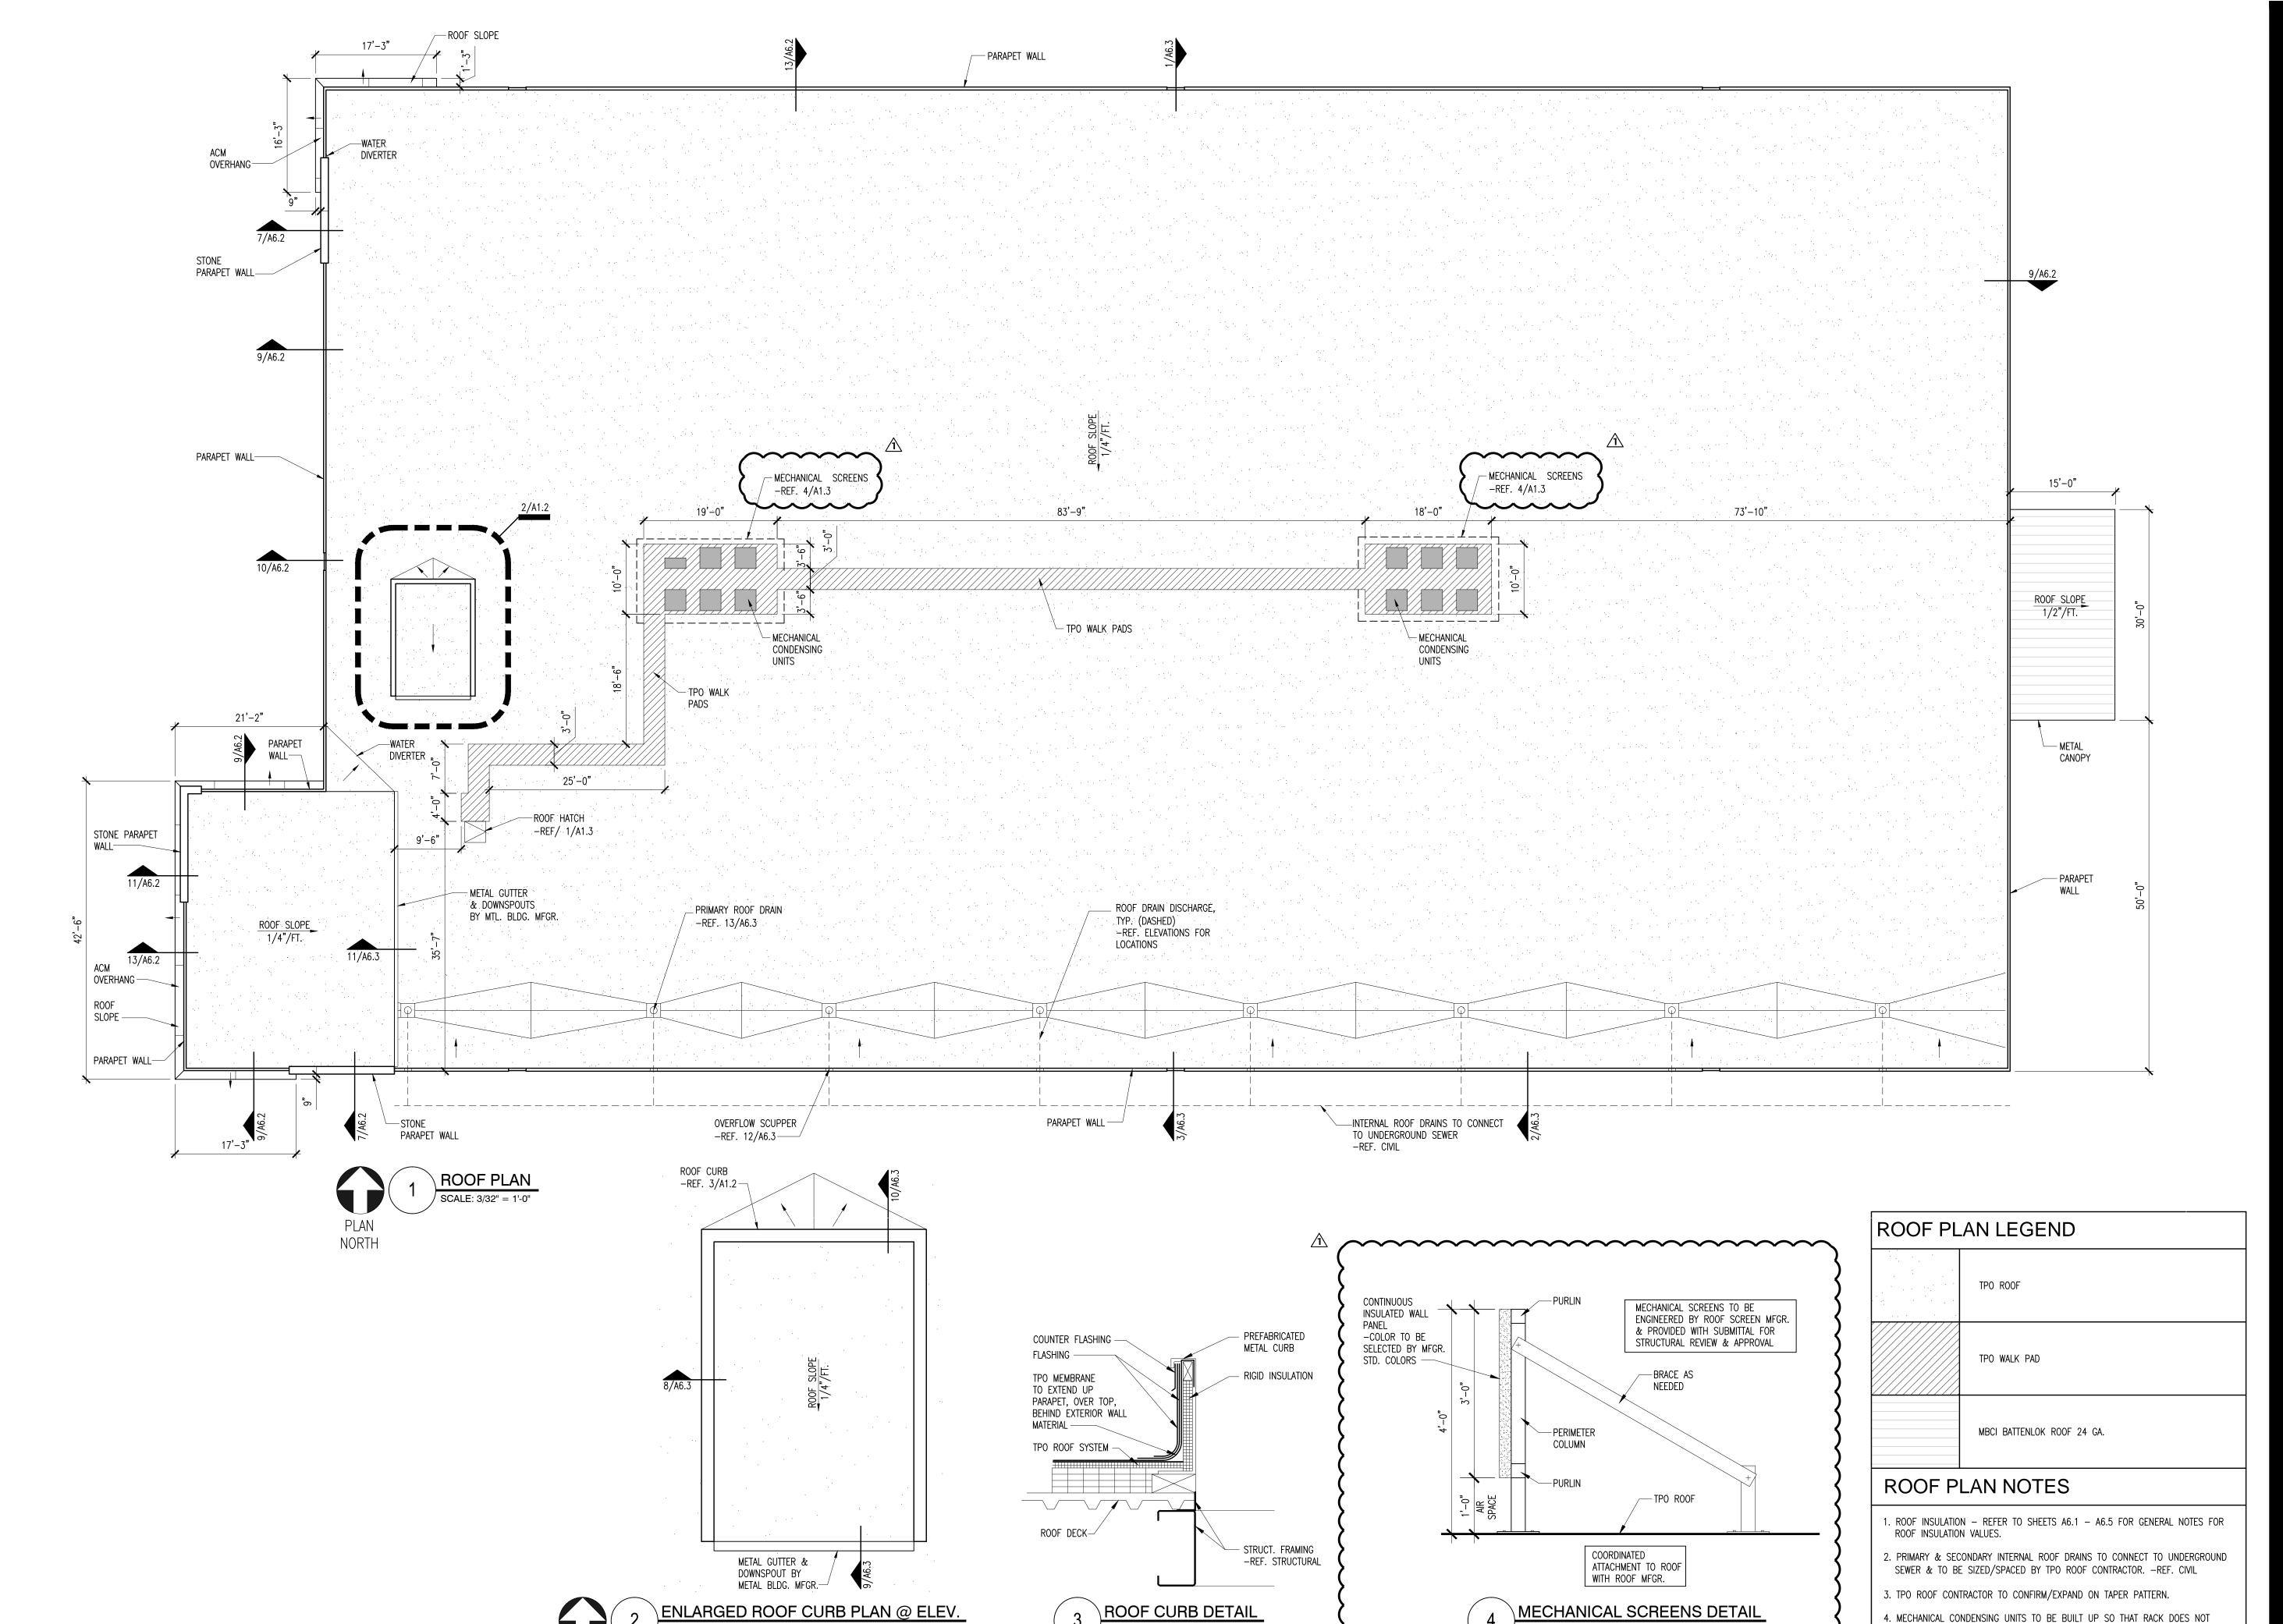


DRAWN:

REVISIONS: CITY COMMENTS

01.20.2022

ROOF DETAILS

SHEET NO.

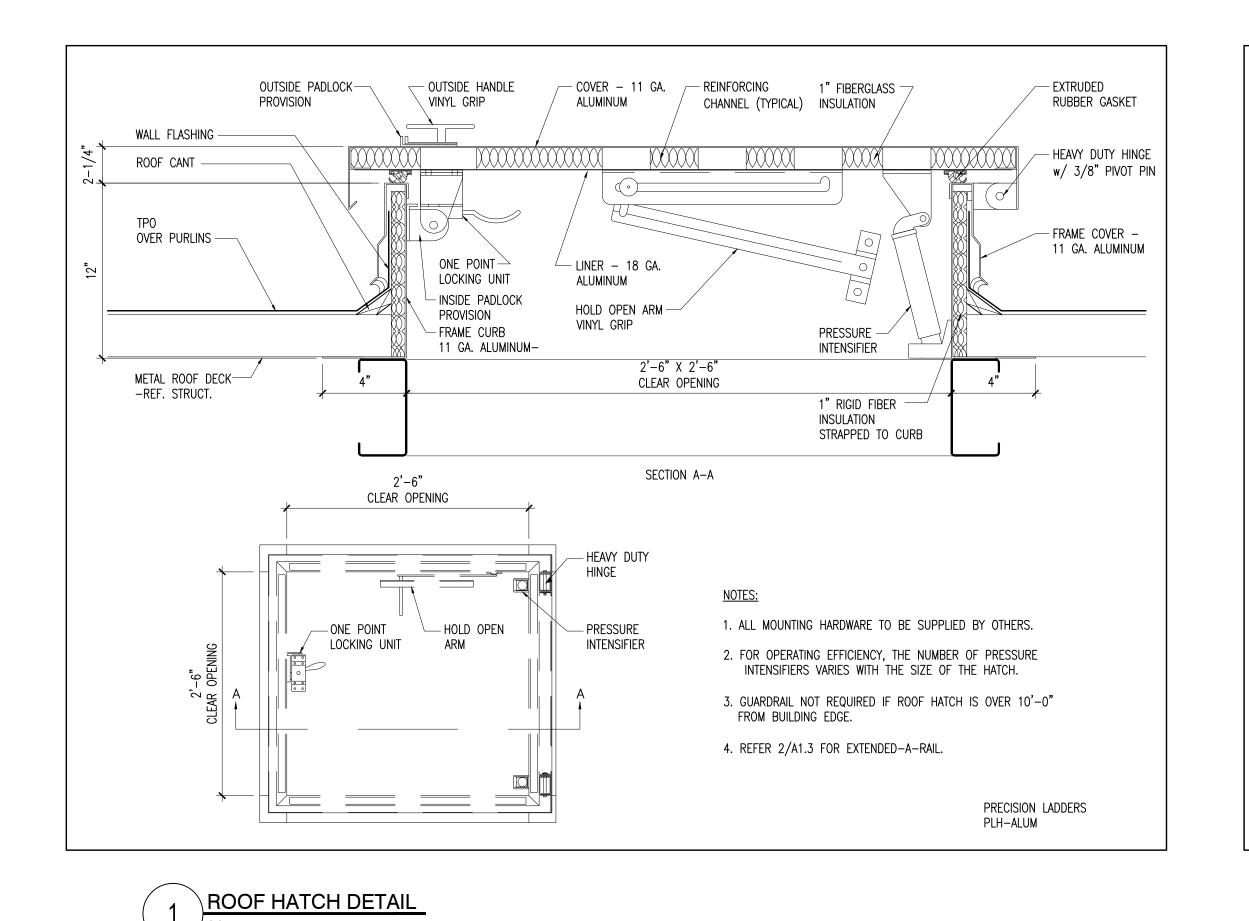

13'-4"

\_\_\_\_\_\_

NOTE: CONTRACTOR

TO VERIFY DUMPSTER

12'-0"

DUMPSTER ENCLOSURE

 $^{igsel}$  concrete PAD  $_{iggr}$ 

 $\perp$ SWING DOORS W/

-REF. A7.1

SCALE: 1/4"=1'-0"


STRUCTURAL FRÁME


SIZE W/ OWNER PRIOR TO CONSTRUCTING

6" STEEL PIPE BOLLARD

FILLED W/ CONCRETE

-REF. CIVIL----

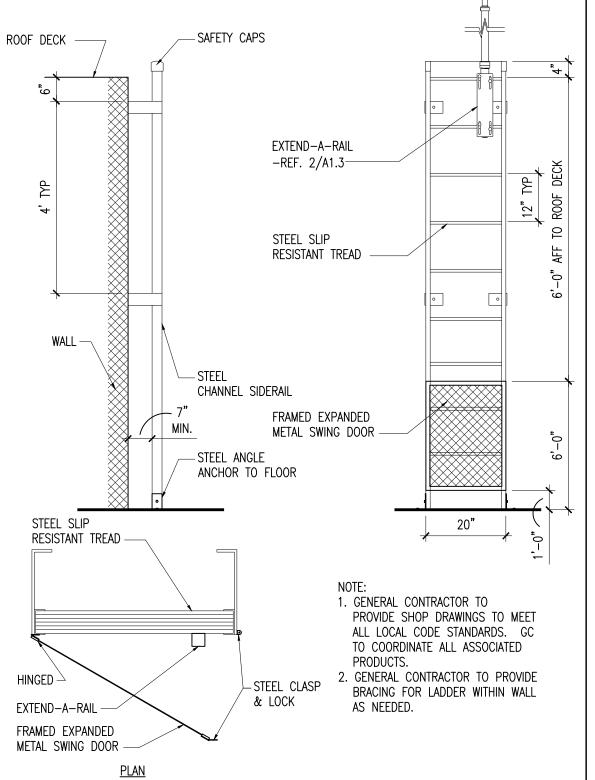

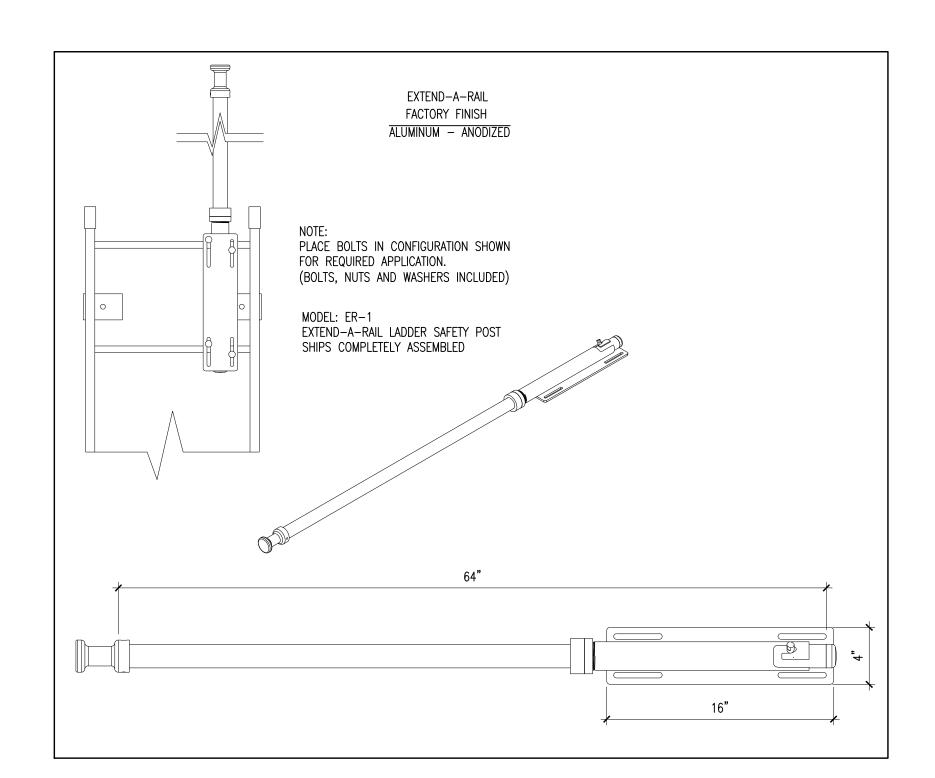

UL# U419

METAL STUD UL FIRE DETAIL (FIRE RISER RM)

FLOOR AND CEILING RUNNERS

LATERAL SUPPORT MEMBERS

JOINT TAPE AND COMPOUND

NOTE: FASTENERS / SCREW PATTERNS:

5D: GYPSUM BOARD - 5/8" IN. THICK, 48 IN. WIDE,

6: FASTENERS - FOR USE WITH ITEMS 2 AND 2F -

TYPE S OR S-12 STEEL SCREWS USED TO ATTACH PANELS

SINGLE LAYER SYSTEM: 1 IN. LONG FOR 1/2 AND 5/8 IN.

DESCRIBED IN ITEM 6. FOR USE WITH ITEMS 1 AND 2 ONLY.

APPLIED VERTICALLY OR HORIZONTALLY. SECURED AS

TO STUDS (ITEM 2) OR FURRING CHANNELS (ITEM 7).

THICK PANELS OR 1-1/4 IN. LONG FOR 3/4 IN. THICK

PANELS, SPACES 8 IN. OC WHEN PANELS ARE APPLIED

HORIZONTALLY, 8 IN. OC ALONG VERTICAL AND BOTTOM EDGES AND 12 IN. OC IN THE FIELD WHEN PANELS ARE

STEEL STUDS

GYPSUM BOARD

APPLIED VERTICALLY.


BATTS AND BLANKETS

7. CAULKING AND SEALANTS

1-HOUR FIRE RATING REQUIRED

SAFTEY HANDRAIL DETAIL

ROOF LADDER DETAIL
SCALE: 1/2"=1'-0"

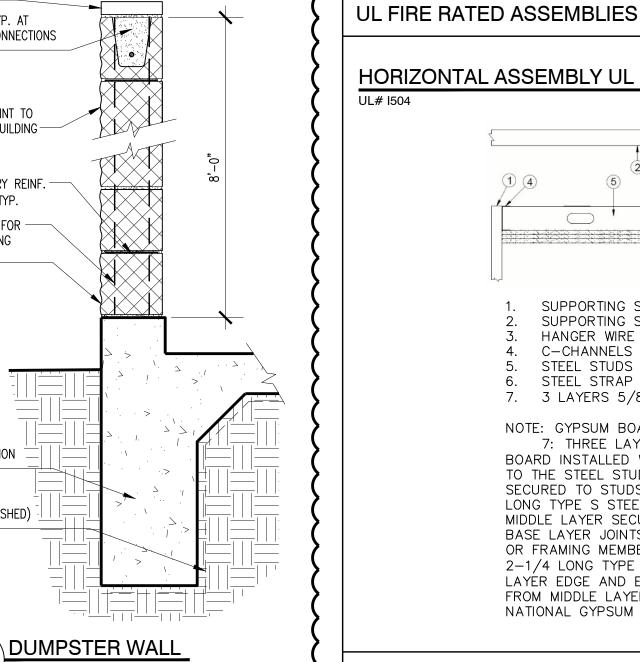

SCALE: 1"=1'-0"

CMU BOND BEAM TYP. AT ALL STRUCTURAL CONNECTIONS -REF. STRUCT.-SPLIT FACE CMU PAINT TO MATCH STONE ON BUILDING -HORIZONTAL MASONRY REINF. -@ 16" O.C. VERT., TYP. REFER STRUCTURAL FOR -VERTICAL REINFORCING 8" CMU -—SPLIT FACE CMU, PAINT CONCRETE FOUNDATION -REF. STRUCT.-VAPOR BARRIER (DASHED) -REF. STRUCT.-

HORIZONTAL ASSEMBLY UL FIRE DETAIL (ELEV. MACH. RM & FIRE RISER RM) 1-HOUR FIRE RATING REQUIRED


SUPPORTING STRUCTURE 1

SUPPORTING STRUCTURE 2 HANGER WIRE C-CHANNELS 5. STEEL STUDS 6. STEEL STRAP

7. 3 LAYERS 5/8" TYPE 'X' GYPSUM BOARD

NOTE: GYPSUM BOARD: 7: THREE LAYERS OF NOM. 5/8 IN. THICK GYPSUM BOARD INSTALLED WITH LONG DIMENSION PERPENDICULAR TO THE STEEL STUDS OR FRAMING MEMBERS. BASE SECURED TO STUDS AND PERIMETER CHANNELS WITH 1 IN. LONG TYPE S STEEL SCREWS SPACED MAX 16 IN. OC. MIDDLE LAYER SECURED TO THE STUDS OR FRAMING FROM BASE LAYER JOINTS. FACE LAYER SECURED TO THE STUDS OR FRAMING MEMBERS AND PERIMETER SUPPORTS WITH 2-1/4 LONG TYPE S STEEL SPACED MAX. 12 IN. OC. FACE LAYER EDGE AND END JOINTS STAGGERED A MIN. 16 IN. FROM MIDDLE LAYER JOINTS. NATIONAL GYPSUM CO - TYPE FSW

CMU WALL UL FIRE DETAIL (STAIR, ELEV., & MACH. RM.) UL# U905 1-HOUR FIRE RATING REQUIRED



CONCRETE BLOCKS MORTAR

PORTLAND CEMENT STUCCO OR GYPSUM PLASTER

4. LOOSÉ MASONRY FILL

5. FOAMED PLASTIC (OPTIONAL)

-VERTICAL PANEL FILLER REF. A7.1— HOLD DOWN PINS TO KEEP GATES CLOSED -

6'-0"

6**'**-0"

DUMPSTER GATE ELEVATION

WALL

SCHLUTER

HEIGHT

19" CL

48" MAX.

34" CL

40" 34" CL

N/A

48" MAX.

44" MAX.

40" CL

∠ SYSTEM

—

**TOILET ACCESSORIES** 

TA-1 TOILET TISSUE DISPENSER

TA-3 | 42" HORIZONTAL GRAB BAR

TA-5 | 36" HORIZONTAL GRAB BAR

TA-6 | LAVATORY PIPING INSULATION

TA-7 | FEMININE NAPKIN DISPOSAL

TA-9 | 18" VERTICAL GRAB BAR

. FOR CONTROLS OR REACH, HEIGHT IS MAX.

2. FOR MIRRORS, HEIGHT IS TO BOTTOM OF REFLECTIVE EDGE.

5. BLOCKING FOR ACCESSORIES BY GENERAL CONTRACTOR

6. SOAP DISPENSER TO BE INSTALLED OVER COUNTERTOP

3. FOR GRAB BARS, HEIGHT IS TO CENTER OF HORIZONTAL BAR.

4. ALL DESIGN MUST COMPLY W/ LOCAL AMERICAN'S W/DISABILITIES ACT

TA-8 | SOAP DISPENSER

REF. SHEET A2.6

TA-2 HAND DRYERS

TA-4 MIRROR

NOTES


DRAWN:


REVISIONS: / CITY COMMENTS


01.20.2022

ADA & INT. ELEV

SHEET NO.

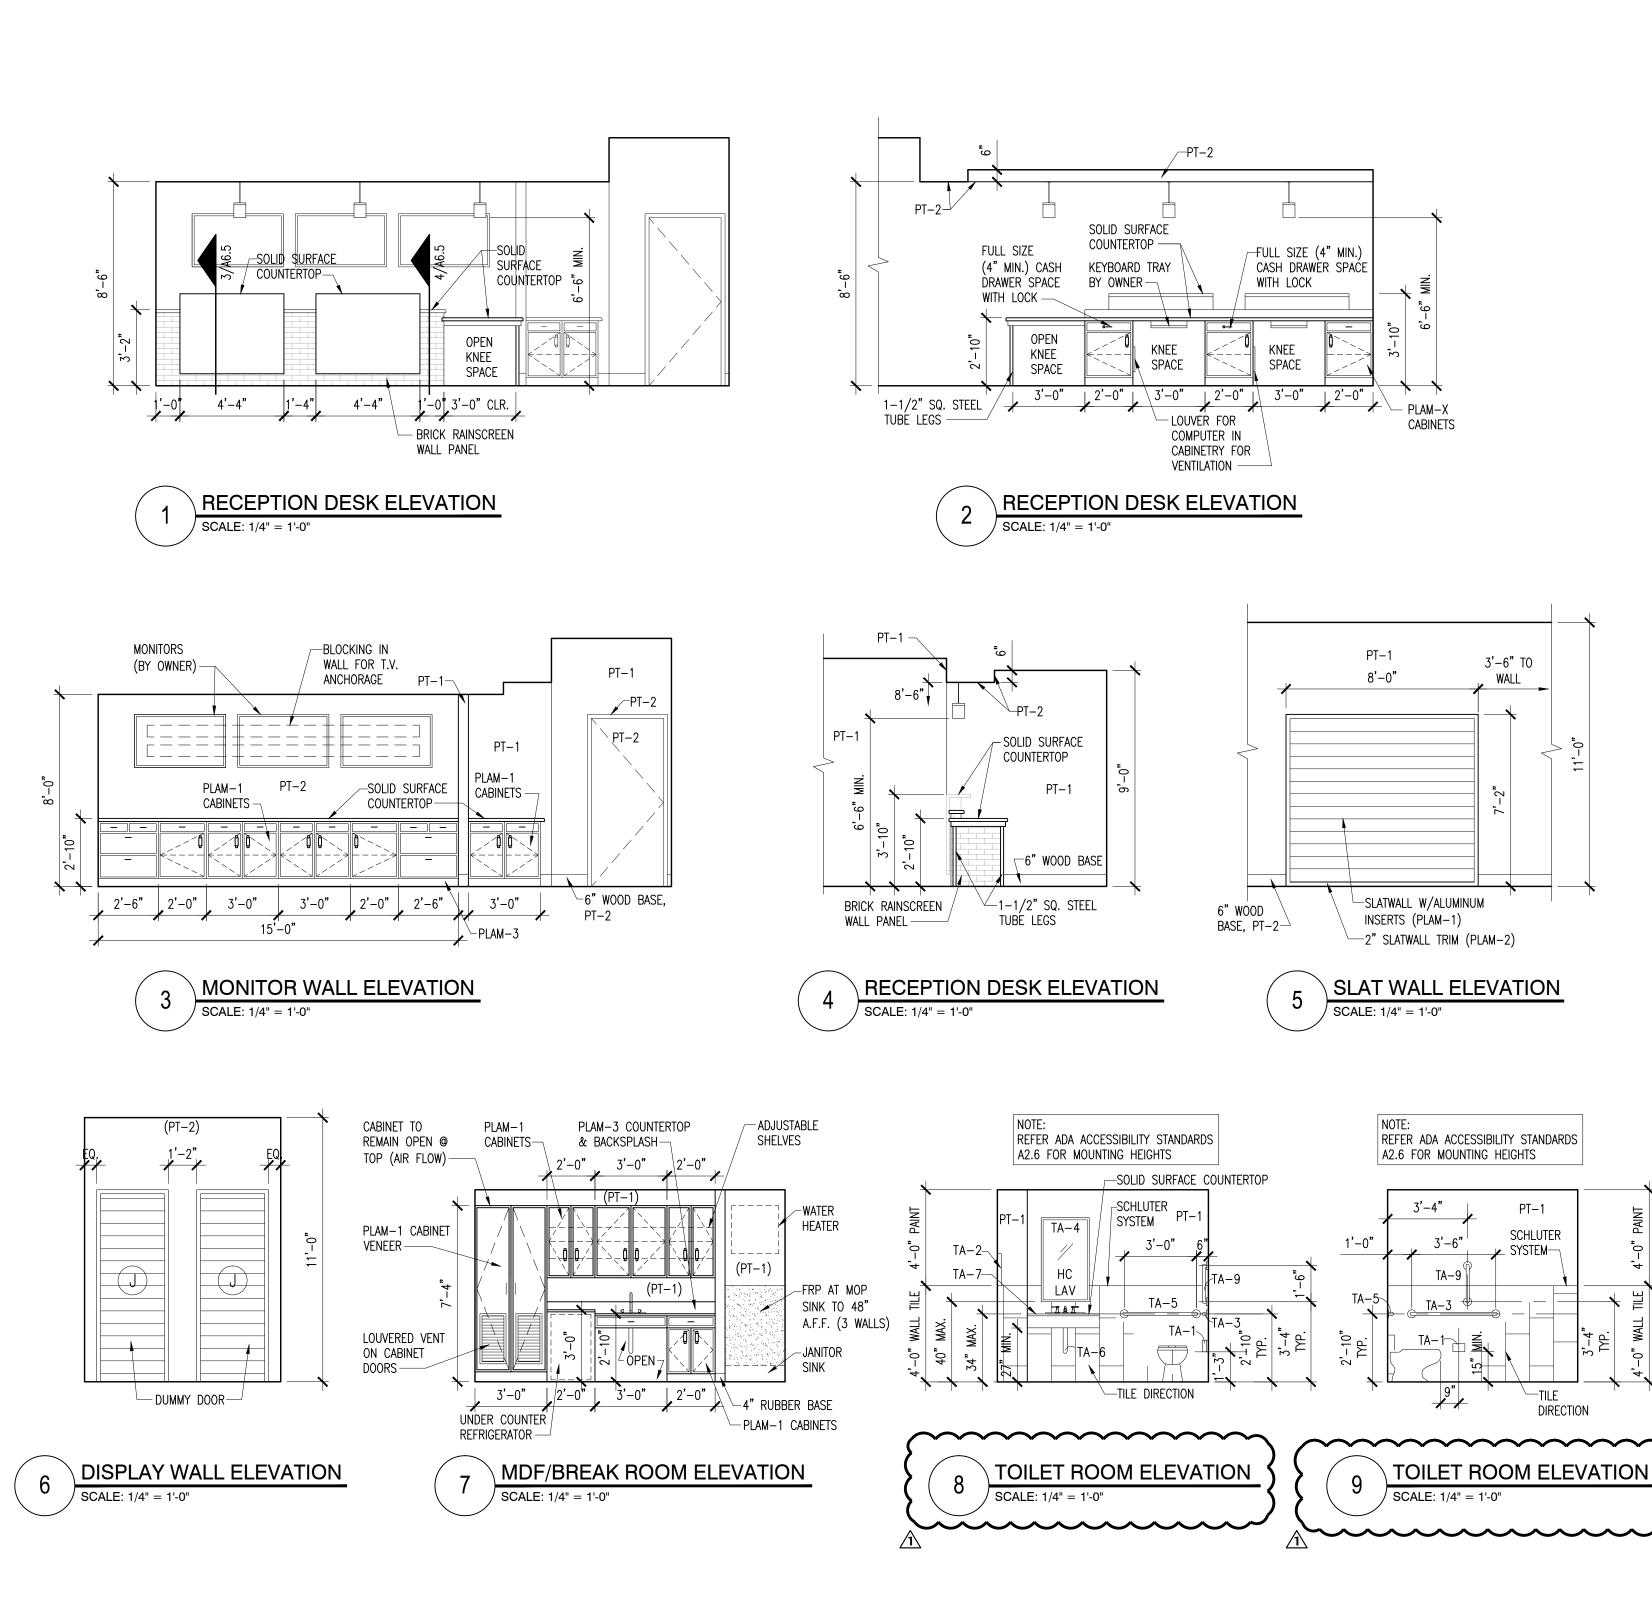

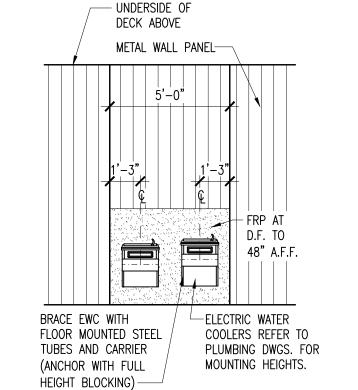

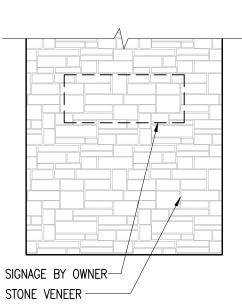

BRICK WALL ELEVATION SCALE: 1/4" = 1'-0"

SIGNAGE BY OWNER— STONE VENEER ———

WALKING PARALLEL TO A WALL 12"∣ MIN. IF LATCH/CLOSER FRONT APPROACH, PULL SIDE FRONT APPROACH, PUSH SIDE LATCH APPROACH PULL SIDE LATCH APPROACH PUSH SIDE - CONTINUOUS HANDRAILS PROVIDED ON BOTH SIDES OF RAMPS AT SURFACES > 6" GROUND SURFACE OF RAMP 2" EDGE PROTECTION TO EXTEND 36" MIN. IF 60" TO END OF REQUIRED LANDING 42" MIN. IF 54' LEVEL LEVEL LANDING LANDING 36" MIN. 36" MIN. -ABOVE WALKING SURFACES HINGE APPROACH PUSH SIDE EDGE PROTECTION & HANDRAIL EXTENSIONS HINGE APPROACH PULL SIDE

2010 - ADA STANDARDS FOR ACCESSIBLE DESIGN

60" MIN. DIA. -

TURNING RADIUS

TOILET PARTITION TO HAVE 9" TOE

CLEARANCE AFF.

DOOR OPEN

& LATCH

TOWEL DISPENSER/

RECEPTACLE

( |= |LOBBY

NAPKIN DISPOSAL

NAPKIN DISPENSER

CLEAR WIDTH

WHEELCHAIR

— CLEAR FLOOR SPACE AT FIXTURES CAN OVERLAP. FIXTURES CAN NOT OVERLAP INTO

CLEAR FLOOR SPACE OF ANOTHER FIXTURE.

-30" X 48" WHEELCHAIR

- DOOR SWING CAN SWING

FLOOR SPACE FOR FIXTURES.

— GRAB BARS HEIGHT

-FLUSH VALVE SHALL

BE INSTALLED ON WIDE SIDE OF T/R OR STALL

✓ ✓ 33"-36" AFF, TYP.

INTO REQUIRED TURN SPACE BUT NOT CLEAR

CLEAR FLOOR SPACE

TOILET PAPER DISPENSERS SHALL

BE 7" MIN. & 9" MAX. IN FRONT

OF THE WATER CLOSET. MEASURE

KNEE CLEAR

54 MIN.

39"-41"

TO THE CENTERLINE OF THE DISPENSER

- MAINTAIN 1

CLEARANCE A

GRAB BARS

MIN. & 48" MAX. AFF. & SHALL NOT BE LOCATED BEHIND GRAB BARS. DISPENSERS SHALL NOT BE

OF A TYPE THAT CONTROLS DELIVERY OR THAT

DOES NOT ALLOW CONTINUOUS PAPER FLOW.

TOE CLEAR

 $\Diamond$ 

60" MIN.

T-SHAPED TURNING SPACE

5" MAX.

(TO SPOUT)

CENTERED
ON TACTILE
CHARACTERS

15" MIN.

FAUCETS SHALL BE OPERABLE W/ 1 HAND

AND SHALL NOT BE REQUIRE TIGHT GRASPING,

PARTS SHALL BE 5 POUNDS MAX.

CLEAR FLOOR SPACE AT LAVATORIES

PINCHING, OR TWISTING OF THE WRIST. THE

FORCE REQUIRED TO ACTIVATE OPERABLE

- PROVIDE PIPE INSULATION

TO HOT WATER & DRAIN LINES

- FLUSH VALVE SHALL

BE INSTALLED ON WIDE SIDE OF T/R OR STALL

DOORS IN SERIES AND GATES IN SERIES

<u>HEIGHT:</u>

SOAP DISPENSER

48" MAX. 20" MAX.

44" MAX. 20"-25" MAX.


REACH DEPTH:


HAND DRYER


\*NOTE: SIGNS SHALL COMPLY WITH 2010 ADA STANDARDS FOR ACCESSIBLE DESIGN


AREA OF\_ REFUGE\_

> DRINKING FOUNTAIN ELEVATION SCALE: 1/4" = 1'-0"

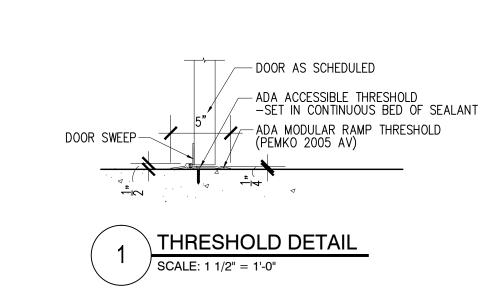

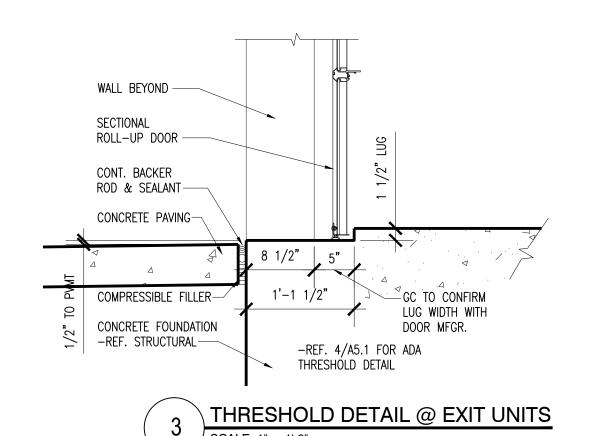

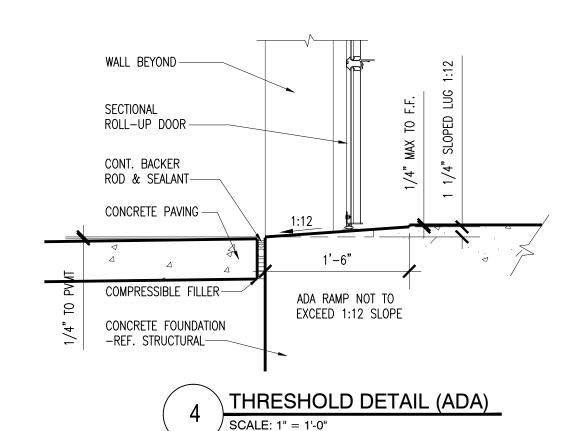

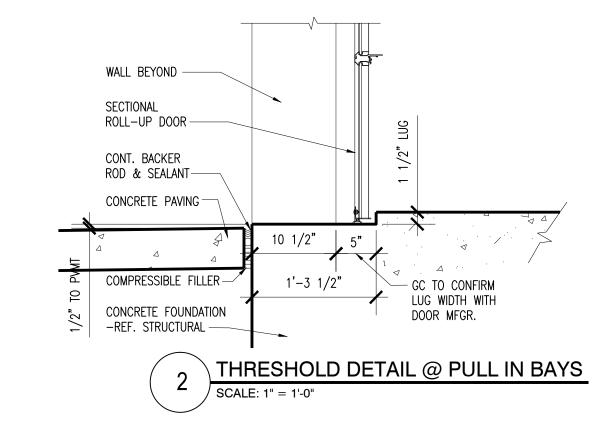

FI	NIS	SH SCHEDULE									
			FLOOR		WALLS				CEILING		KEYED
FIRST FLOOR		MATERIAL	BASE	NORTH	SOUTH	EAST	WEST	HEIGHT	TYPE	NOTES	
OFFICE	101	SALES AREA	PC	WD	PT-1	PT-1	-	PT-1	-	ES	-
	102	RECEPTION DESK	PC	WD	PT-1	PT-1	PT-1/PT-2	-	VARIES	GYP.	-
	103	MDF / BREAK ROOM	PC	RUBBER	PT-1	PT-1	PT-1	PT-1	8'-0"	LAY-IN	2
	104	AHU ROOM	PC	-	PT-1	PT-1	PT-1	PT-1	-	ES	-
	105	DISPLAY AREA	PC	WD	PT-1	PT-1	PT-1	PT-1	-	ES	3
	106	MENS T.R.	PFT	-	PT-1/PWT	PT-1/PWT	PT-1/PWT	PT-1/PWT	8'-0"	GYP.	1,2
	107	WOMENS T.R.	PFT	-	PT-1/PWT	PT-1/PWT	PT-1/PWT	PT-1/PWT	8'-0"	GYP.	1,2
	108	DRINKING FOUNTAIN	PC	-	JANUS	JANUS	JANUS	JANUS	-	ES	-
	109	LOADING AREA	SLT	-	JANUS	JANUS	JANUS	JANUS	-	ES	-
KEYED NOTES:  1. PORCELAIN TILE WAINSCOT TO 4'-0" A.F.F.  2. ACOUSTICAL BATT INSULATION ABOVE CEILING.  3. DUMMY DOORS PER FLOOR PLANS.				LEGEND: ES GRID GYP	EXPOSED STRUCTURE 2X2 CEILING GRID ONLY 5/8" TYPE 'X' GYPSUM BOARD						

A. GENERAL CONTRACTOR TO SUBMIT ALL FINISH SELECTIONS TO OWNER AND ARCHITECT FOR APPROVAL PRIOR TO ORDERING B. REF. SHEET A7.1 FOR SPECIFICATIONS. C. GENERAL CONTRACTOR TO PROVIDE ALLOWANCE FOR CERAMIC TILE IN ROOMS 101-105 AS AN ALTERNATE

**GENERAL NOTES:** 

JANUS JANUS WALL SYSTEM LAY-IN 2x2 LAY-IN ACOUSTICAL CEILING POLISHED CONCRETE PORCELAIN FLOOR TILE INTERIOR OFFICE PAINT INTERIOR OFFICE PAINT - ACCENT PT-2 PORCELAIN WALL TILE RUBBER RUBBER WALL BASE WD PAINTED WOOD BASE SEALANT WITH TRAFFIC COATING

1" INSULATED ALUM. STOREFRONT  1" A"  CONT. BACKER ROD & SEALANT  F.F.
CONC. PAV.
STOREFRONT DETAIL  SCALE: 1 1/2" = 1'-0"

## DOOR NOTES

- 1: DOOR HARDWARE TO BE APPROVED BY OWNER BASED ON SUBCONTRACTOR SUBMITTAL.
- 2: CONTRACTOR TO COORDINATE DOOR HARDWARE AND FRAMES WITH SECURITY EQUIPMENT AND MAGNETIC HOLD OPEN DEVICES.
- 3: PROVIDE MIN. INTERIOR & EXTERIOR ACCESSIBLE HARDWARE, THRESHOLDS, SIGNAGE, ETC. TO COMPLY W/ ADA ACCESSIBILITY STANDARDS. REFERENCE FLOOR PLANS FOR LOCATIONS.
- 4: NOT USED
- 5: NOT USED
- 6: STORAGE ROLL-UP DOORS-PROVIDE ALUM. HANDLES W/ SLIDE BAR LATCH TO FRAME, CONTINUOUS ALUM. BOTTOM PULL BAR, WEATHER SEALS (EXTERIOR) AND REMOVABLE CYLINDER LOCK W/ EMERGENCY OVERRIDE LATCH OPERATOR TO OPERATOR.
- 7: GLAZING IN ALL EXTERIOR DOORS TO BE INSULATED LOW-E GLAZING W/ 1/4" DOUBLE PANES W/ 1/2" AIR SPACE (1" TOTAL) (TEMPERED).
- 8. THRESHOLDS  $1\frac{1}{2}$  LUGS NOT REQUIRED AT ALCOVE ENTRIES.
- 9. READILY VISIBLE DURABLE SIGN POSTED ON THE EGRESS SIDE ON OR ADJACENT TO THE DOOR STATING: "THIS DOOR TO REMAIN UNLOCKED WHEN BUILDING IS OCCUPIED" -REF. SHEET A2.6 FOR INSTALLATION INSTRUCTIONS.
- 10. FIRE RATED DOORS TO BE SELF CLOSING OR AUTOMATIC CLOSING.
- 1. READILY VISIBLE DURABLE SIGN POSTED ON EGRESS SIDE ADJACENT TO DOOR STATING: "EXIT" IN TACTILE LETTERS & BRAILLE -REF SHEET A2.6 FOR INSTALLATION INSTRUCTIONS.
- 12. READILY VISIBLE DURABLE SIGN POSTED ON ENTRY SIDE OF DOOR STATING "ROOM NAME" IN TACTILE LETTERS AND BRAILLE - REF. SHEET A2.6 FOR INSTALLATION INSTRUCTIONS.
- 13. ROLL UP DOORS TO MEET LOCAL WIND LOAD REQUIREMENTS.
- 14. CONSTRUCTION CORES TO REMAIN REKEYING/MASTER KEYING BY OWNER
- 15. 3'-0" CLEAR MAN GATE ORNAMENTAL IRON APPLIED METAL SECURITY MESH AT GATE AND ADJACENT FENCE PANEL EXTEND FULL LENGTH OF EITHER SIDE OF LOCKSET. LEVER HARDWARE PER ADA REQUIREMENTS.
- 16. SLIDING DOOR OPENING TO BE ON SAME SIDE AS MAN DOOR ADJACENT.
- 17. DOORS TO COMPLY WITH ENERGY CODES SHOWN ON SHEET A7.1.
- 18. DOORS TO COMPLY WITH LOCAL WIND LOAD CAPACITY.

	A	11'-0"	14'-0"	EXT. SECT.
	B	8'-8"	8'-0"	EXT. SECT.
	©			NOT USED
	0	8'-4"	7'-0"	INT. ROLL-UP
	E	8'-0"	8'-0"	EXT. SECT.
	F			NOT USED
	G	7'-4"	7'-0"	INT. ROLL-UP
	$\bigcirc$	3'-4"	7'-0"	INT. ROLL-UP
	J	3'-0"	7'-0"	DUMMY DOOF
	K	3'-0"	7'-0"	INT. ROLL-UP
	(L)			NOT USED
	M	3'-0"	7'-0"	JANUS SWING
	N	3'-0"	7'-0"	JANUS SWING
	DO	OR SO	CHED	JLE
LOCATION	MARK	WIDTH	HEIGHT	DOOR TYPE
OFFICE ENTRY	1	3'-0"	7'-0"	2
MDF ROOM	2	3'-0"	7'-0"	3
AHU ROOM	3	3'-0"	7'-0"	3
OFFICE / LOADING	4	3'-0"	7'-0"	1
OFFICE / STORAGE	5	3'-0"	7'-0"	3
TOILET ROOM	6	3'-0"	7'-0"	3
TOILET ROOM	7	3'-0"	7'-0"	3
SLIDING DOOR	8	9'-0"	7'-8"	5L
LOADING EXIT	9	3'-0"	7'-0"	1
STAIR B - 1ST FLR	10	3'-0"	7'-0"	4
STAIR B - EXIT	11)	3'-0"	7'-0"	3
ELEV. MACHINE RM	12	3'-6"	7'-0"	3
ELECTRICAL ROOM	13	3'-0"	7'-0"	3
FIRE RISER ROOM	14)	6'-0" PR	7'-0"	3
SLIDING DOOR	15)	9'-0"	7'-8"	5R
STAIR A - 1ST FLR	16	3'-0"	7'-0"	4
STAIR A - EXIT	17	3'-0"	7'-0"	3
ALCOVE ENTRY	18)	4'-0"	7'-0"	1
SLIDING DOOR	19	9'-0"	7'-8"	5R
STAIR B - 2ND FLR	20	3'-0"	7'-0"	4
STAIR A - 3RD FLR	21	3'-0"	7'-0"	4
STAIR B - 3RD FLR	22	3'-0"	7'-0"	4
MAN GATE	23	3'-0"	6'-0"	7
	1: P/	_	RDWARE	
		OOR CL	OSER STRIPP	ING

	$\oplus$	3'-4"	7'-0"	INT. ROLL-UP	-	17				
	$\bigcirc$	3'-0"	7'-0"	DUMMY DOOR	-	9,17				
	ĸ	3'-0"	7'-0"	INT. ROLL-UP	-	17				
				NOT USED						
	M	3'-0"	7'-0"	JANUS SWING	-	17				
	N	3'-0"	7'-0"	JANUS SWING	-	17,29				
	DO	DOOR SCHEDULE								
LOCATION	MARK	WIDTH	HEIGHT	DOOR TYPE	FRAME TYPE	REMARKS				
OFFICE ENTRY	1	3'-0"	7'-0"	2	STFT	1,2,3,5,8,9,11,15,16,17,18,23				
MDF ROOM	2	3'-0"	7'-0"	3	1	11,15,20				
AHU ROOM	3	3'-0"	7'-0"	3	1	7,10,11,20				
OFFICE / LOADING	4	3'-0"	7'-0"	1	1	11,15,20				
OFFICE / STORAGE	(5)	3'-0"	7'-0"	3	1	11,15,20				
TOILET ROOM	6	3'-0"	7'-0"	3	1	11,14,20,24				
TOILET ROOM	7	3'-0"	7'-0"	3	1	11,14,20,24				
SLIDING DOOR	8	9'-0"	7'-8"	5L	-	3,13,19,21,22,30				
LOADING EXIT	9	3'-0"	7'-0"	1	1	1,2,3,8,10,11,12,16,19,24				
STAIR B - 1ST FLR	10	3'-0"	7'-0"	4	1	1,2,6,10,11,19,24				
STAIR B - EXIT	11)	3'-0"	7'-0"	3	1	1,2,3,8,10,11,12,16,19,24				
ELEV. MACHINE RM	12	3'-6"	7'-0"	3	1	2,6,10,11,20				
ELECTRICAL ROOM	13	3'-0"	7'-0"	3	1	2,3,8,10,11,12,16,20				
FIRE RISER ROOM	14)	6'-0" PR	7'-0"	3	1	2,3,8,10,11,12,16,20				
SLIDING DOOR	(15)	9'-0"	7'-8"	5R	-	3,13,19,21,22,27				
STAIR A - 1ST FLR	16	3'-0"	7'-0"	4	2	1,2,6,10,11,19,24				
STAIR A - EXIT	17)	3'-0"	7'-0"	3	2	1,2,3,8,10,11,12,16,19,24				
ALCOVE ENTRY	18	4'-0"	7'-0"	1	1	1,2,3,4,10,11,12,13,16,19,24				
SLIDING DOOR	19	9'-0"	7'-8"	5R	-	3,13,19,21,22,27				
STAIR B - 2ND FLR	20	3'-0"	7'-0"	4	2	1,2,6,10,11,19,24				
STAIR A - 3RD FLR	21)	3'-0"	7'-0"	4	2	1,2,6,10,11,19,24				
STAIR B - 3RD FLR	22	3'-0"	7'-0"	4	2	1,2,6,10,11,19,24				
MAN GATE	23	3'-0"	6'-0"	7	-	1,2,24,25				
		ARKS:: ANIC HA	RDWARE		16: DOOR	SWEEP				

STORAGE DOOR SCHEDULE

MARK | WIDTH | HEIGHT | DOOR TYPE | FRAME TYPE | REMARKS

17,28

17,28

17

17,28

17

- 3: WEATHER STRIPPING / THRESHOLD
- -REF. DETAIL 1/A5.1 4: MAGNETIC HOLD OPEN
- DOORS W/ 15 MINUTE TIMER
  - 8: DRIP FLASHING 9: FIXED "DUMMY DOORS
  - 10: STORAGE LOCKSET 11: DOOR STOP
  - 13: KEY PAD 14: TR LOCKSET
- - 12: INSULATED 15: OFFICE LOCKSET
- 17: COLOR: REF. SHEET A7.1 18: DOOR SIGNAGE @ ENTRY
- (REF. NOTE 9) 19: DOOR SIGNAGE @ EXITS (REF. NOTE 11) 20: DOOR SIGNAGE @
- IDENTIFYING ROOMS (REF. NOTE 12) 21: STANLEY ACCESS CONTROL (PANIC BAR & ELECTRIC LOCK)
- 22: STANLEY TIMER 23: MAIL-SLOT 24: KICKPLATE ON PUSH SIDE 25: MAN GATE KEYSET 26: NOT USED
- 27: RIGHT HAND OPENING 28: INSULATED SECTIONAL ROLL-UP DOOR 29: CLASP ON LATCH PUSH SIDE 30: LEFT HAND OPENING

SCHEDULES SHEET NO.

WDW/DOOR

PROJECT NO.

DRAWN:

**REVISIONS:** 

1 CITY COMMENTS

01.20.2022

DATE: 12.16.2021

2035

