



MiTek USA, Inc.
16023 Swingley Ridge Rd
Chesterfield, MO 63017
314-434-1200

RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
Development Services
LEE'S SUMMIT, MISSOURI

Re: B220005A

The truss drawing(s) referenced below have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Wheeler - Waverly.

Pages or sheets covered by this seal: I49722353 thru I49722375

My license renewal date for the state of Missouri is December 31, 2022.

Missouri COA: Engineering 001193



January 17, 2022

Garcia, Juan ,Engineer

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.


Job	Truss	Truss Type	Qty	Ply	Job Reference (optional)
B220005A	A1	Common Supported Gable	1	1	I49722353

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Jan 14 14:58:55

Page: 1

ID:AVXTMfOv7HTJem99pvFdZvy1L-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f

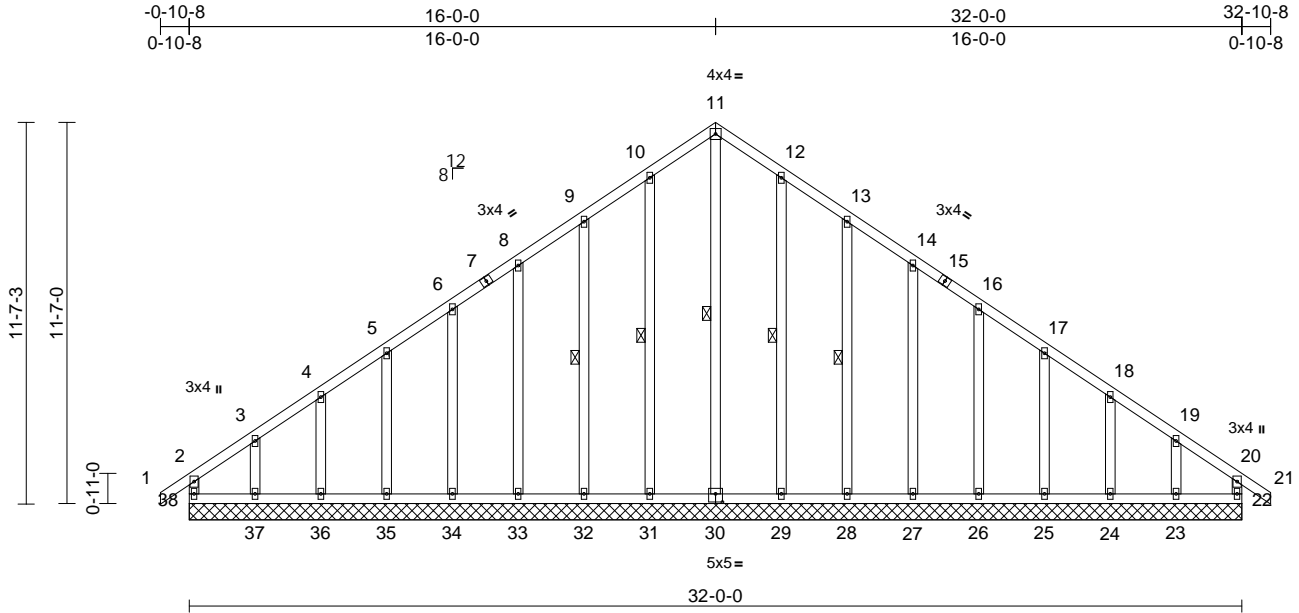

Scale = 1:70

Plate Offsets (X, Y): [30:0-2-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.11	Vert(LL)	n/a	-	n/a	999	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.10	Vert(TL)	n/a	-	n/a	999	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.17	Horiz(TL)	0.01	22	n/a	n/a	
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-R							
Weight: 188 lb FT = 10%											

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x4 SPF No.2
OTHERS	2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

WEBS 1 Row at midpt 11-30, 10-31, 9-32, 12-29, 13-28

REACTIONS (lb/size)	22=166/32-0-0, 23=162/32-0-0, 24=184/32-0-0, 25=179/32-0-0, 26=180/32-0-0, 27=180/32-0-0, 28=179/32-0-0, 29=187/32-0-0, 30=162/32-0-0, 31=187/32-0-0, 32=179/32-0-0, 33=180/32-0-0, 34=180/32-0-0, 35=179/32-0-0, 36=184/32-0-0, 37=162/32-0-0, 38=166/32-0-0
Max Horiz	38=320 (LC 7)
Max Uplift	22=79 (LC 5), 23=156 (LC 9), 24=50 (LC 9), 25=75 (LC 9), 26=69 (LC 9), 27=69 (LC 9), 28=77 (LC 9), 29=56 (LC 9), 31=58 (LC 8), 32=76 (LC 8), 33=69 (LC 8), 34=69 (LC 8), 35=76 (LC 8), 36=46 (LC 8), 37=173 (LC 8), 38=140 (LC 4)

FORCES

TOP CHORD	(lb) - Maximum Compression/Maximum Tension 2-38=-210/118, 1-2=0/40, 2-3=-244/223, 3-4=-180/171, 4-5=-168/167, 5-6=-148/178, 6-8=-130/215, 8-9=-112/251, 9-10=-96/292, 10-11=-83/320, 11-12=-70/308, 12-13=-49/255, 13-14=-60/215, 14-16=-74/179, 16-17=-87/141, 17-18=-102/104, 18-19=-114/106, 19-20=-178/148, 20-21=0/40, 20-22=-172/69
BOT CHORD	37-38=-135/164, 36-37=-135/164, 35-36=-135/164, 34-35=-135/164, 33-34=-135/164, 32-33=-135/164, 31-32=-135/164, 29-31=-135/164, 28-29=-135/164, 27-28=-135/164, 26-27=-135/164, 25-26=-135/164, 24-25=-135/164, 23-24=-135/164, 22-23=-135/164
WEBS	11-30=-287/16, 10-31=-156/82, 9-32=-145/100, 8-33=-147/93, 6-34=-146/93, 5-35=-148/97, 4-36=-144/82, 3-37=-176/149, 12-29=-153/80, 13-28=-147/101, 14-27=-147/93, 16-26=-147/94, 17-25=-148/96, 18-24=-144/84, 19-23=-162/139

NOTES

- Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.



January 17, 2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
B220005A	A1	Common Supported Gable	1	1	I49722353
					Job Reference (optional)

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Jan 14 14:58:55
ID:AVXTMfOv7HTdJem99pvFdZzvy1L-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Page: 2

10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 140 lb uplift at joint 38, 79 lb uplift at joint 22, 58 lb uplift at joint 31, 76 lb uplift at joint 32, 69 lb uplift at joint 33, 69 lb uplift at joint 34, 76 lb uplift at joint 35, 46 lb uplift at joint 36, 173 lb uplift at joint 37, 56 lb uplift at joint 29, 77 lb uplift at joint 28, 69 lb uplift at joint 27, 69 lb uplift at joint 26, 75 lb uplift at joint 25, 50 lb uplift at joint 24 and 156 lb uplift at joint 23.

LOAD CASE(S) Standard


Job	Truss	Truss Type	Qty	Ply	Job Reference (optional)
B220005A	A2	Common	6	1	I49722354

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Jan 14 14:58:57

Page: 1

ID:AVXTMfOv7HTdJem99pvFdZvy1L-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrcDoi7J4zJC?f

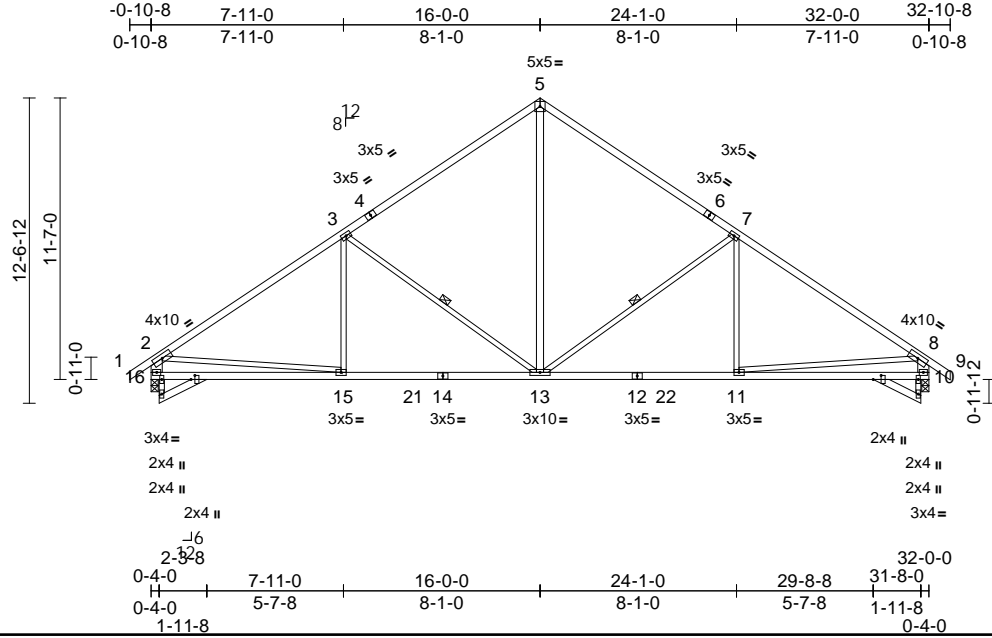

Scale = 1:94.8

Plate Offsets (X, Y): [18:0-2-0,0-1-15], [19:0-2-0,0-3-15]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.90	Vert(LL)	-0.11	13-15	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.60	Vert(TL)	-0.28	13-15	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.61	Horiz(TL)	0.06	10	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S		Wind(LL)	0.05	13-15	>999	240	Weight: 141 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x3 SPF No.2 *Except* 13-5:2x4 SPF No.2,
 16-2,10-8:2x6 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied, except end verticals.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

WEBS 1 Row at midpt 7-13, 3-13

REACTIONS (lb/size) 10=1497/0-3-8, 16=1497/0-3-8
 Max Horiz 16=-322 (LC 6)
 Max Uplift 10=-186 (LC 9), 16=-186 (LC 8)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/43, 2-3=-1925/229, 3-5=-1394/279,
 5-7=-1394/279, 7-8=-1925/229, 8-9=0/43,
 2-16=-1423/228, 8-10=-1423/227

BOT CHORD 15-16=-341/694, 13-15=-229/1630,
 11-13=-56/1482, 10-11=-176/477

WEBS 5-13=-110/857, 7-13=-682/283, 7-11=0/260,
 3-13=-682/284, 3-15=0/260, 2-15=0/1058,
 8-11=0/1070

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) All plates are 3x5 MT20 unless otherwise indicated.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 186 lb uplift at joint 16 and 186 lb uplift at joint 10.

LOAD CASE(S) Standard



January 17, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Page: 1

Job	Truss	Truss Type	Qty	Ply	
B220005A	A4	Monopitch Structural Gable	1	1	Job Reference (optional)
					I49722356

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Jan 14 14:58:58
ID:fh5rZ_PXubbUwnLLjXQU9mzvy1K-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

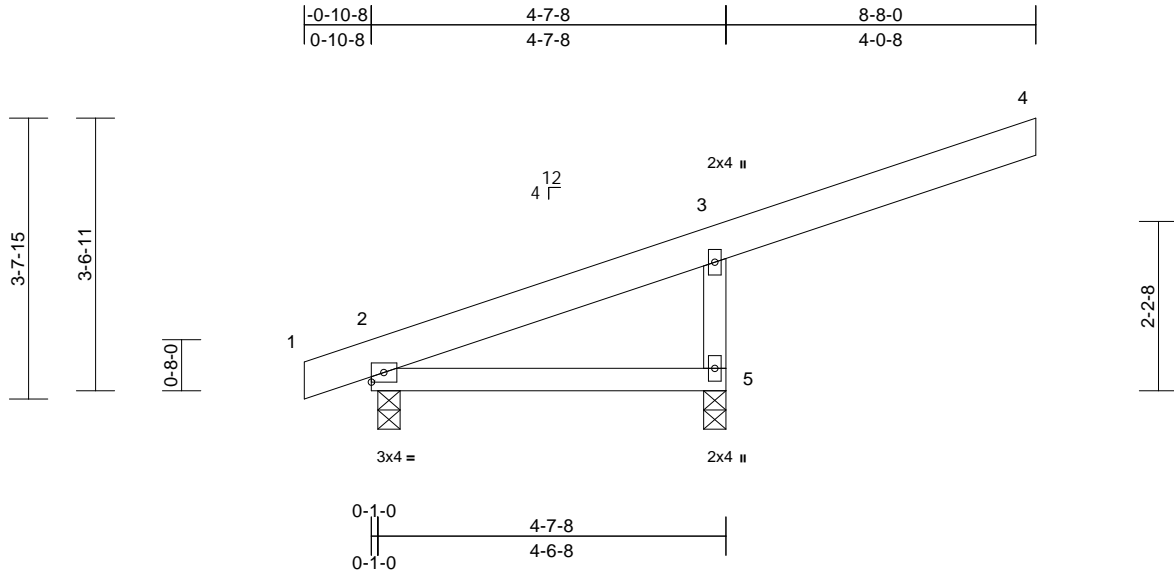

Scale = 1:30

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.57	Vert(LL)	-0.02	2-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.19	Vert(TL)	-0.05	2-5	>984	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-P							Weight: 25 lb	FT = 10%

LUMBER

TOP CHORD 2x6 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-7-8 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 2=133/0-3-8, 5=621/0-3-8
Max Horiz 2=137 (LC 5)
Max Uplift 2=-4 (LC 4), 5=-239 (LC 5)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/1, 2-3=-139/108, 3-4=-93/0,
3-5=-578/265

BOT CHORD 2-5=-25/19

NOTES

- 1) Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable studs spaced at 2-0-0 oc.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 239 lb uplift at joint 5 and 4 lb uplift at joint 2.

LOAD CASE(S) Standard



January 17, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Page: 1


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

Job B220005A	Truss B2	Truss Type Common	Qty 6	Ply 1	Job Reference (optional) I49722358
-----------------	-------------	----------------------	----------	----------	---------------------------------------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Jan 14 14:58:58
ID:fh5rZ_PXubbUwnLLjXQU9mzvy1K-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

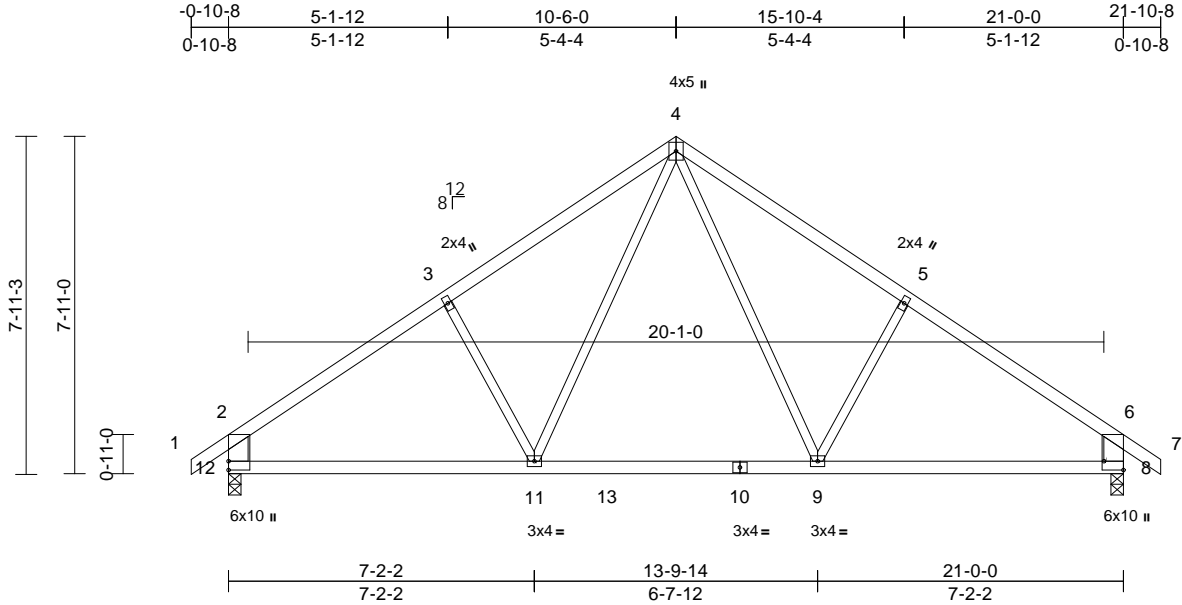

Scale = 1:54.1									
Plate Offsets (X, Y): [8:Edge,0-5-8]									
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in (loc)	l/defl	L/d
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.85	Vert(LL)	-0.20	9-11	>999
TCDL	10.0	Lumber DOL	1.15	BC	0.56	Vert(TL)	-0.37	9-11	>669
BCLL	0.0*	Rep Stress Incr	YES	WB	0.20	Horiz(TL)	0.03	8	n/a
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S		Wind(LL)	0.08	9-11	>999
							Weight: 78 lb		FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except* 12-2,8-6:2x6 SPF No.2

5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 129 lb uplift at joint 12 and 129 lb uplift at joint 8.

LOAD CASE(S) Standard

BRACING
TOP CHORD Structural wood sheathing directly applied or 2-2-1 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 8=1002/0-3-8, 12=1002/0-3-8
Max Horiz 12=227 (LC 6)
Max Uplift 8=129 (LC 9), 12=129 (LC 8)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/43, 2-3=1173/157, 3-4=1006/216, 4-5=1006/216, 5-6=1173/158, 6-7=0/43, 2-12=908/167, 6-8=908/167
BOT CHORD 11-12=149/955, 9-11=0/675, 8-9=41/856
WEBS 4-9=121/416, 5-9=245/221, 4-11=121/418, 3-11=245/221

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.



January 17, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Job Reference (optional)
B220005A	B3	Common	4	1	I49722359

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Jan 14 14:58:59
ID:fh5rZ_PXubbUwnLLjXQU9mzvY1K-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

Page: 1

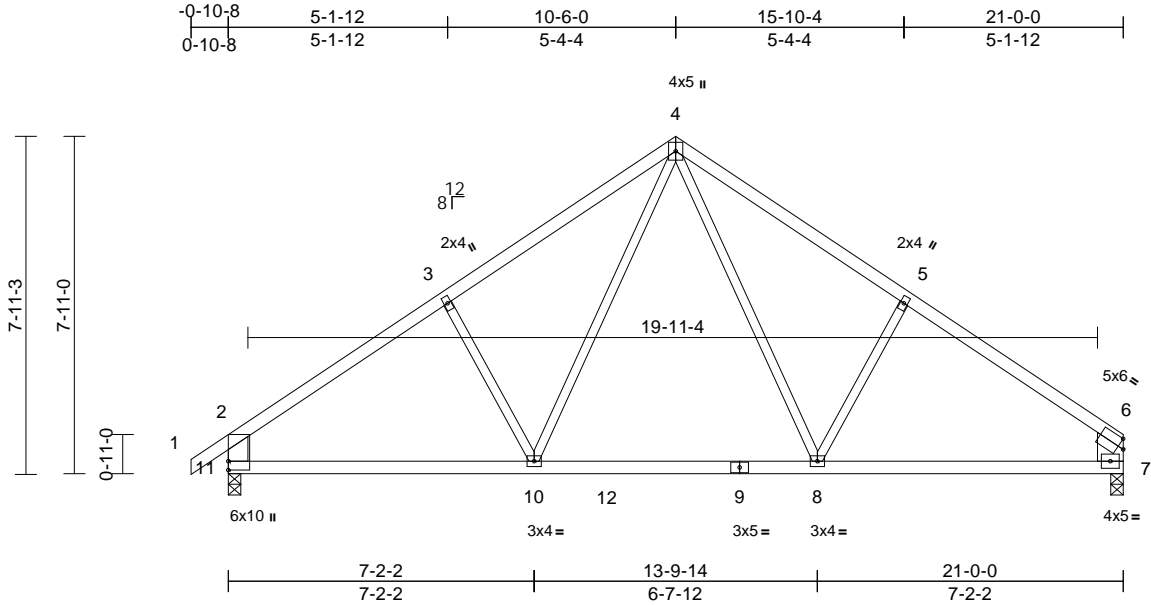

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.86	Vert(LL)	-0.23	8-10	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.72	Vert(TL)	-0.44	8-10	>562	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.21	Horiz(TL)	0.03	7	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S		Wind(LL)	0.10	8-10	>999	240	Weight: 77 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except* 11-2:2x6 SPF No.2,
7-6:2x8 SP DSS

BRACING

TOP CHORD Structural wood sheathing directly applied or
2-2-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc
bracing.

REACTIONS (lb/size) 7=919/0-3-8, 11=1000/0-3-8
Max Horiz 11=221 (LC 7)
Max Uplift 7=-103 (LC 9), 11=-129 (LC 8)

FORCES (lb) - Maximum Compression/Maximum
Tension
TOP CHORD 1-2=0/43, 2-3=-1173/157, 3-4=-1006/216,
4-5=-994/214, 5-6=-1157/155,
2-11=-908/167, 6-7=-807/137
BOT CHORD 10-11=-162/945, 8-10=-10/661, 7-8=-68/853
WEBS 4-8=-118/400, 5-8=-257/222, 4-10=-122/427,
3-10=-244/221

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 129 lb uplift at joint 11 and 103 lb uplift at joint 7.



January 17, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job B220005A	Truss B4	Truss Type Common	Qty 3	Ply 1	Job Reference (optional) I49722360
-----------------	-------------	----------------------	----------	----------	---------------------------------------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Jan 14 14:58:59
ID:b4Dc_gRoQCrCA5UkqxTyFBzvy11-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

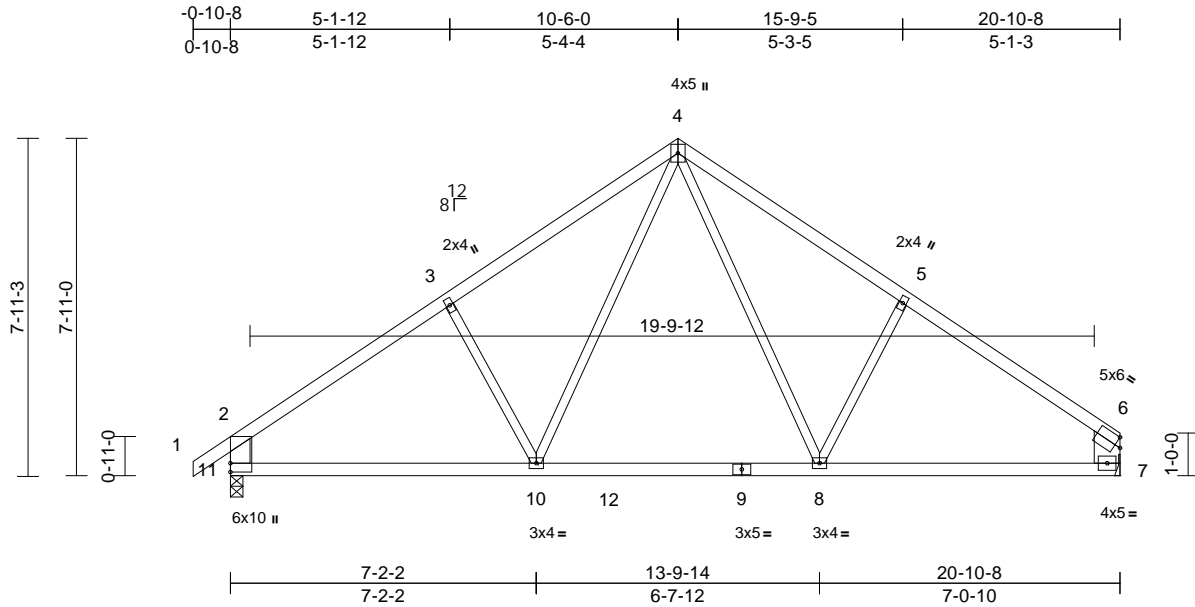

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.85	Vert(LL)	-0.24	8-10	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.75	Vert(TL)	-0.46	8-10	>529	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.21	Horiz(TL)	0.03	7	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S		Wind(LL)	0.11	8-10	>999	240	Weight: 77 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except* 11-2:2x6 SPF No.2,
7-6:2x8 SP DSS

6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 128 lb uplift at joint 11 and 101 lb uplift at joint 7.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-4-4 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 7=913/ Mechanical, 11=995/0-3-8
Max Horiz 11=222 (LC 5)
Max Uplift 7=-101 (LC 9), 11=-128 (LC 8)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/43, 2-3=-1165/157, 3-4=-999/215,
4-5=-949/213, 5-6=-1128/151,
2-11=-903/166, 6-7=-797/135
BOT CHORD 10-11=-162/939, 8-10=-10/654, 7-8=-66/824
WEBS 4-8=-118/379, 5-8=-244/219, 4-10=-122/430,
3-10=-244/221

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.



January 17, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
B220005A	B5	Roof Special	1	1	Job Reference (optional)


I49722361

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Jan 14 14:58:59

Page: 1

ID:b4Dc_gRoQCrCA5UkqxTyFBzy11-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

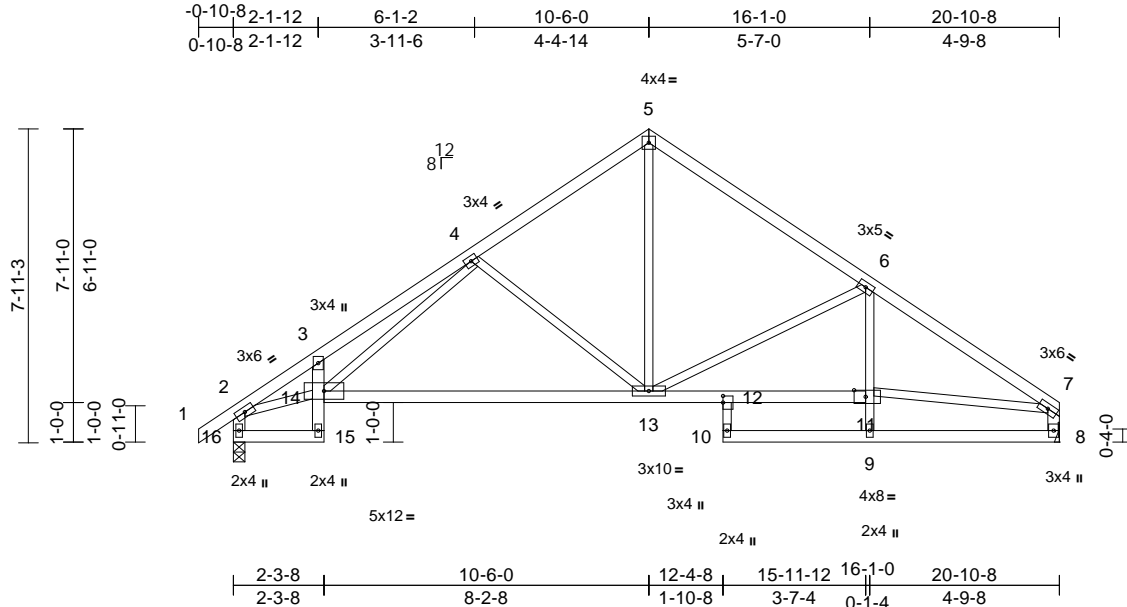

Scale = 1:58.2

Plate Offsets (X, Y): [11:0-3-8,0-2-0], [12:0-2-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.36	Vert(LL)	-0.15	13-14	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.57	Vert(TL)	-0.41	13-14	>605	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.48	Horiz(TL)	0.11	8	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S		Wind(LL)	0.06	13-14	>999	240	Weight: 89 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2 *Except* 12-10:2x3 SPF No.2
 WEBS 2x3 SPF No.2 *Except* 16-2,8-7:2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-11-14 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 8=924/ Mechanical, 16=999/0-3-8
 Max Horiz 16=220 (LC 5)
 Max Uplift 8=103 (LC 9), 16=128 (LC 8)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/40, 2-3=-1811/259, 3-4=-1963/380,
 4-5=-997/163, 5-6=-1021/176,
 6-7=-1478/164, 2-16=-970/155, 7-8=-867/129
 BOT CHORD 15-16=-95/165, 14-15=-21/52,
 3-14=-243/140, 13-14=-178/1100,
 12-13=-83/1175, 11-12=-67/1058,
 10-12=0/74, 9-10=-16/117, 8-9=-16/137
 WEBS 4-14=-187/819, 4-13=-462/229,
 5-13=-79/675, 6-13=-498/215, 9-11=0/160,
 6-11=0/181, 2-14=-218/1360, 7-11=-67/1031

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 128 lb uplift at joint 16 and 103 lb uplift at joint 8.

LOAD CASE(S) Standard

January 17, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
B220005A	B6	Hip	1	1	Job Reference (optional)


I49722362

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Jan 14 14:58:59

Page: 1

ID:b4Dc_gRoQCrCA5UkqxTyFBzy11-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

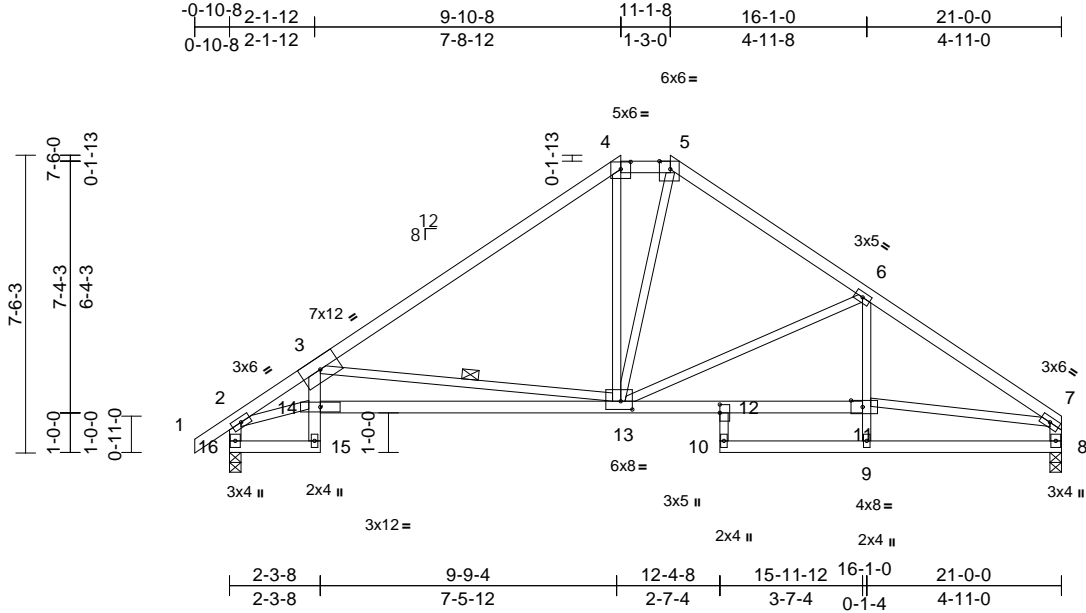

Scale = 1:58.2	Plate Offsets (X, Y): [4:0-3-0,0-2-3], [5:0-3-5,Edge], [11:0-3-8,0-2-0], [12:0-2-8,Edge], [13:0-3-8,0-2-8]
----------------	--

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.75	Vert(LL)	-0.12	13-14	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.68	Vert(TL)	-0.33	13-14	>748	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.67	Horiz(TL)	0.14	8	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S		Wind(LL)	0.07	13-14	>999	240	Weight: 91 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2 *Except* 12-10:2x3 SPF No.2
WEBS 2x3 SPF No.2 *Except* 16-2,8-7:2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals, and 2-0-0 oc purlins (5-10-11 max.): 4-5.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
6-0-0 oc bracing: 14-15
8-1-12 oc bracing: 13-14.
WEBS 1 Row at midpt 3-13

REACTIONS (lb/size) 8=930/0-3-8, 16=1005/0-3-8
Max Horiz 16=206 (LC 5)
Max Uplift 8=102 (LC 9), 16=125 (LC 8)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/40, 2-3=1919/314, 3-4=1152/132, 4-5=831/179, 5-6=1009/161, 6-7=1508/153, 2-16=954/139, 7-8=874/129
BOT CHORD 15-16=93/174, 14-15=26/38, 3-14=0/317, 13-14=513/2009, 12-13=68/1197, 11-12=49/1066, 10-12=0/67, 9-10=19/131, 8-9=20/156
WEBS 3-13=1228/499, 4-13=22/286, 5-13=129/428, 6-13=504/195, 9-11=0/174, 6-11=0/217, 2-14=280/1470, 7-11=48/1031

NOTES
1) Unbalanced roof live loads have been considered for this design.
2) Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60

- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 125 lb uplift at joint 16 and 102 lb uplift at joint 8.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



January 17, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Job Reference (optional)
B220005A	B7	Hip	1	1	I49722363

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Jan 14 14:59:00
ID:3Gn_C0RQBW_3nF3wOf_BnPzvy1H-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?i

Page: 1

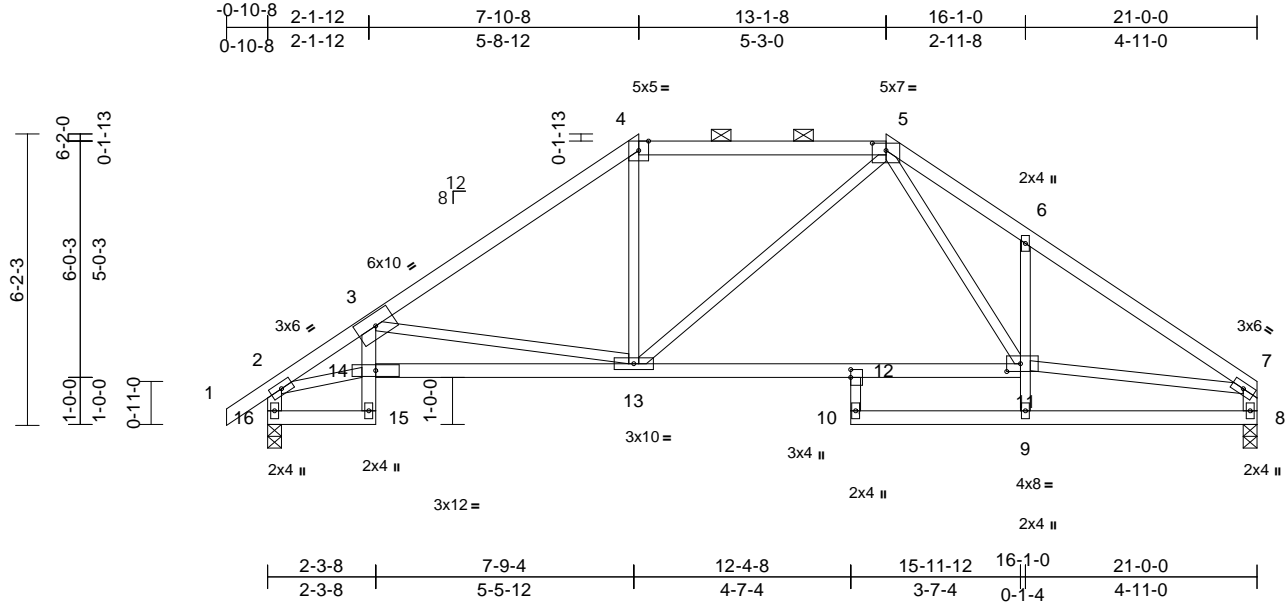

Scale = 1:48.9

Plate Offsets (X, Y): [5:0-3-8,0-1-14], [11:0-3-8,0-2-0], [12:0-2-0,Edge]												
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.46	Vert(LL)	-0.12	12-13	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.62	Vert(TL)	-0.33	12-13	>750	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.66	Horiz(TL)	0.13	8	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S		Wind(LL)	0.05	13-14	>999	240	Weight: 87 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2 *Except* 12-10:2x3 SPF No.2
WEBS 2x3 SPF No.2 *Except* 16-2,8-7:2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 4-2-9 oc purlins, except end verticals, and 2-0-0 oc purlins (5-2-5 max.): 4-5.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
6-0-0 oc bracing: 14-15
9-9-0 oc bracing: 13-14.

REACTIONS (lb/size) 8=930/0-3-8, 16=1005/0-3-8
Max Horiz 16=171 (LC 5)
Max Uplift 8=-89 (LC 9), 16=-112 (LC 8)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/40, 2-3=-1856/243, 3-4=-1303/114, 4-5=-990/150, 5-6=-1506/232, 6-7=-1537/95, 2-16=-961/130, 7-8=-894/109
BOT CHORD 15-16=-78/161, 14-15=-17/34, 3-14=-5/242, 13-14=-359/1725, 12-13=-32/930, 11-12=-25/852, 10-12=0/23, 9-10=-44/78, 8-9=-47/109
WEBS 3-13=-825/348, 4-13=0/335, 5-13=-67/179, 2-14=-207/1389, 7-11=0/1097, 9-11=0/250, 6-11=-302/211, 5-11=-138/573

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 112 lb uplift at joint 16 and 89 lb uplift at joint 8.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



January 17, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017



Page: 1

Plate Offsets (X, Y): [11:0-3-8.0-2-0]


- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.


- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 94 lb uplift at joint 16 and 70 lb uplift at joint 8.
- 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard




Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Page: 1

16023 Swingley Ridge Rd
Chesterfield, MO 63017

Page: 1

January 17, 2022

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.

 WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITER REFERENCE PAGE MM-7473 Rev. 3/19/2020 BEFORE USE. Design valid for use only with MiTEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building C**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job B220005A	Truss C1	Truss Type Common Supported Gable	Qty 1	Ply 1	Job Reference (optional) I49722367
-----------------	-------------	--------------------------------------	----------	----------	---------------------------------------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Jan 14 14:59:01
ID:7ufEnKQ9fujLYxwXHEyji_zvy1J-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?f

Page: 1

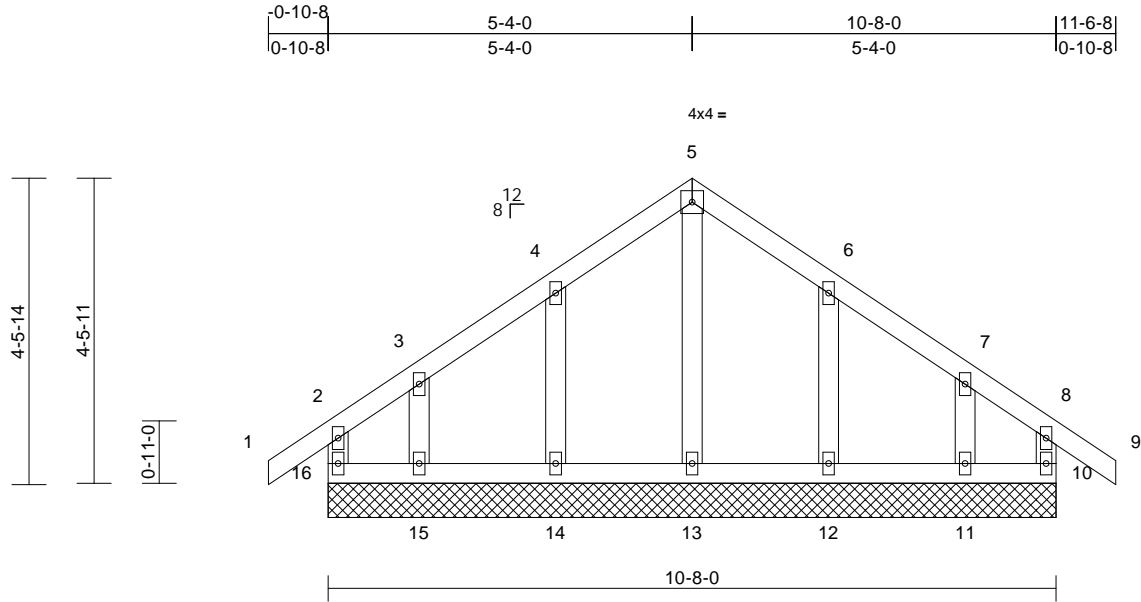

Scale = 1:33.8

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.03	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.04	Horiz(TL)	0.00	10	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-R						Weight: 44 lb	FT = 10%

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x4 SPF No.2
OTHERS	2x4 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 10-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (lb/size)	10=128/10-8-0, 11=125/10-8-0, 12=198/10-8-0, 13=176/10-8-0, 14=198/10-8-0, 15=125/10-8-0, 16=128/10-8-0
Max Horiz	16=-135 (LC 6)
Max Uplift	10=-40 (LC 5), 11=-82 (LC 9), 12=-73 (LC 9), 14=-72 (LC 8), 15=-86 (LC 8), 16=-58 (LC 4)
Max Grav	10=133 (LC 20), 11=161 (LC 16), 12=202 (LC 16), 13=176 (LC 1), 14=202 (LC 15), 15=170 (LC 15), 16=142 (LC 16)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD	2-16=-121/46, 1-2=0/40, 2-3=-75/77, 3-4=-53/82, 4-5=-45/114, 5-6=-37/108, 6-7=-39/77, 7-8=-54/59, 8-9=0/40, 8-10=-121/32
BOT CHORD	15-16=-64/66, 14-15=-64/66, 13-14=-64/66, 12-13=-64/66, 11-12=-64/66, 10-11=-64/66
WEBS	5-13=-137/0, 4-14=-162/99, 3-15=-120/90, 6-12=-163/100, 7-11=-116/88

NOTES

- 1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) All plates are 2x4 MT20 unless otherwise indicated.
- 5) Gable requires continuous bottom chord bearing.
- 6) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 7) Gable studs spaced at 2-0-0 oc.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 58 lb uplift at joint 16, 40 lb uplift at joint 10, 72 lb uplift at joint 14, 86 lb uplift at joint 15, 73 lb uplift at joint 12 and 82 lb uplift at joint 11.

LOAD CASE(S) Standard



January 17, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
B220005A	G1	Flat Girder	1	1	Job Reference (optional)
					I49722368

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Jan 14 14:59:02
ID:3Gn_C0RQBW_3nF3wOf_BnPzvy1H-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWRCDoi7J4zJC?i

Page: 1

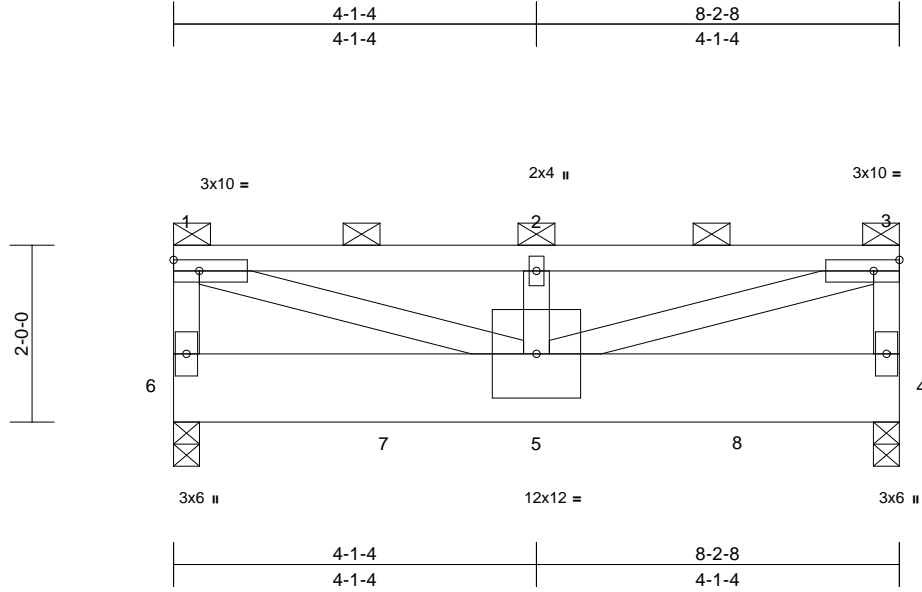

Scale = 1:26.1

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.42	Vert(LL)	-0.05	5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.30	Vert(TL)	-0.10	5	>908	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.57	Horiz(TL)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-P		Wind(LL)	0.03	5	>999	240	Weight: 53 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x10 SP DSS
WEBS 2x4 SPF No.2

BRACING

TOP CHORD 2-0-0 oc purlins (3-7-13 max.): 1-3, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 4=1758/0-3-8, 6=2547/0-3-8
Max Horiz 6=56 (LC 5)
Max Uplift 4=249 (LC 5), 6=344 (LC 4)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-6=-927/161, 1-2=-2171/299,
2-3=-2171/299, 3-4=-927/161

BOT CHORD 5-6=-49/44, 4-5=-21/16
WEBS 1-5=-332/2316, 2-5=-311/156, 3-5=-332/2316

NOTES

- 1) Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Provide adequate drainage to prevent water ponding.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 344 lb uplift at joint 6 and 249 lb uplift at joint 4.
- 6) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

- 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 912 lb down and 111 lb up at 0-1-12, 893 lb down and 113 lb up at 2-4-8, and 893 lb down and 113 lb up at 4-4-8, and 893 lb down and 113 lb up at 6-4-8 on bottom chord. The design/selection of such connection device (s) is the responsibility of others.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-3=-70, 4-6=-20
Concentrated Loads (lb)
Vert: 6=-912 (F), 5=-893 (F), 7=-893 (F), 8=-893 (F)



January 17, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Job Reference (optional)
B220005A	J1	Diagonal Hip Girder	2	1	I49722369

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Jan 14 14:59:02
ID:7ufEnKQ9fujLYxwXHEyji_zvy1J-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Page: 1

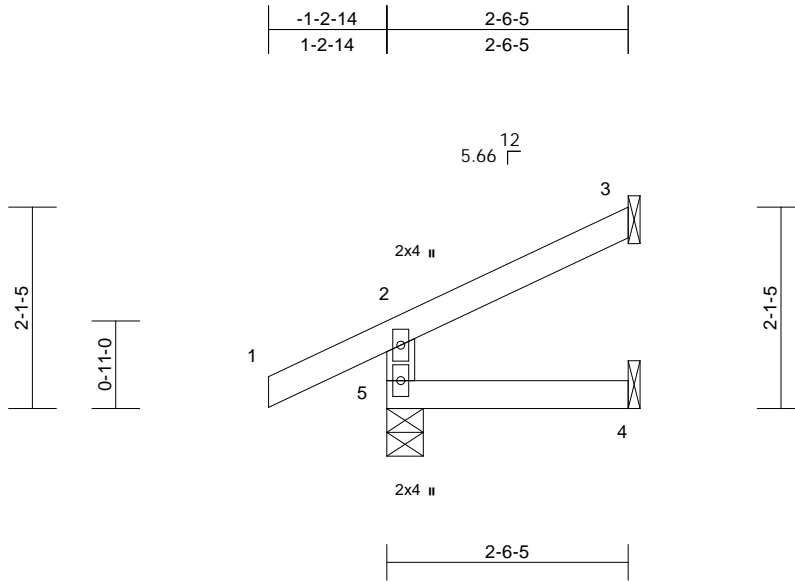

Scale = 1:24.1

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.15	Vert(LL)	0.00	4-5	>999	360	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(TL)	0.00	4-5	>999	240	197/144
BCLL	0.0*	Rep Stress Incr	NO	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a	
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-R		Wind(LL)	0.00	4-5	>999	240	Weight: 8 lb FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or
2-6-5 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc
bracing.

REACTIONS (lb/size) 3=57/ Mechanical, 4=18/
Mechanical, 5=230/0-4-9
Max Horiz 5=58 (LC 8)
Max Uplift 3=-40 (LC 8), 5=-35 (LC 8)
Max Grav 3=57 (LC 1), 4=42 (LC 3), 5=230
(LC 1)

FORCES (lb) - Maximum Compression/Maximum
Tension

TOP CHORD 2-5=-202/59, 1-2=0/41, 2-3=-47/18
BOT CHORD 4-5=0/0

NOTES

- 1) Wind: ASCE 7-10; Vult=115mph (3-second gust) V
(IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft;
Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior
zone; cantilever left and right exposed; end vertical left
and right exposed; Lumber DOL=1.60 plate grip
DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to
bearing plate capable of withstanding 35 lb uplift at joint
5 and 40 lb uplift at joint 3.

LOAD CASE(S) Standard



January 17, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Job Reference (optional)
B220005A	J2	Jack-Open	10	1	I49722370

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Jan 14 14:59:02
ID:7ufEnKQ9fujLYxwXHEyji_zvy1J-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?r

Page: 1

-0-10-8	1-10-8
0-10-8	1-10-8

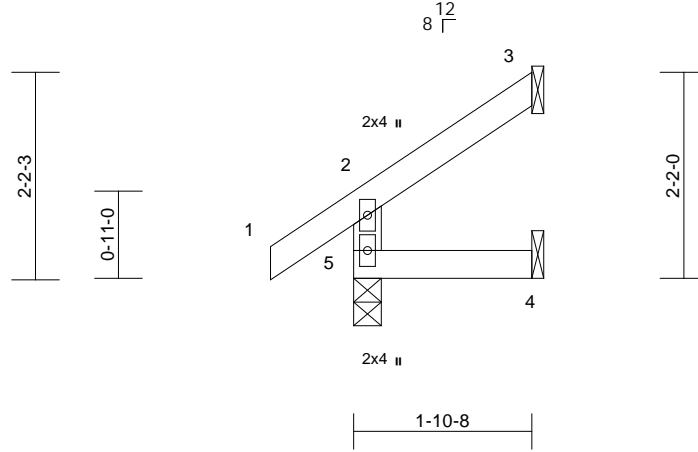

Scale = 1:24.2

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	0.00	4-5	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(TL)	0.00	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-R							Weight: 7 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or
1-10-8 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc
bracing.

REACTIONS (lb/size) 3=42/ Mechanical, 4=14/
Mechanical, 5=170/0-3-8
Max Horiz 5=61 (LC 8)
Max Uplift 3=-41 (LC 8), 4=-4 (LC 8), 5=-7 (LC
8)
Max Grav 3=50 (LC 15), 4=31 (LC 3), 5=170
(LC 1)

FORCES (lb) - Maximum Compression/Maximum
Tension

TOP CHORD 2-5=-149/32, 1-2=0/40, 2-3=-49/22
BOT CHORD 4-5=0/0

NOTES

- 1) Wind: ASCE 7-10; Vult=115mph (3-second gust) V
(IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft;
Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior
zone; cantilever left and right exposed; end vertical left
and right exposed; Lumber DOL=1.60 plate grip
DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to
bearing plate capable of withstanding 7 lb uplift at joint
5, 4 lb uplift at joint 4 and 41 lb uplift at joint 3.

LOAD CASE(S) Standard



January 17, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job B220005A	Truss LAY1	Truss Type Lay-In Gable	Qty 1	Ply 1	Job Reference (optional) I49722371
-----------------	---------------	----------------------------	----------	----------	---------------------------------------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Jan 14 14:59:02
ID:7ufEnK9fujLYxwXHEyji_zvy1J-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

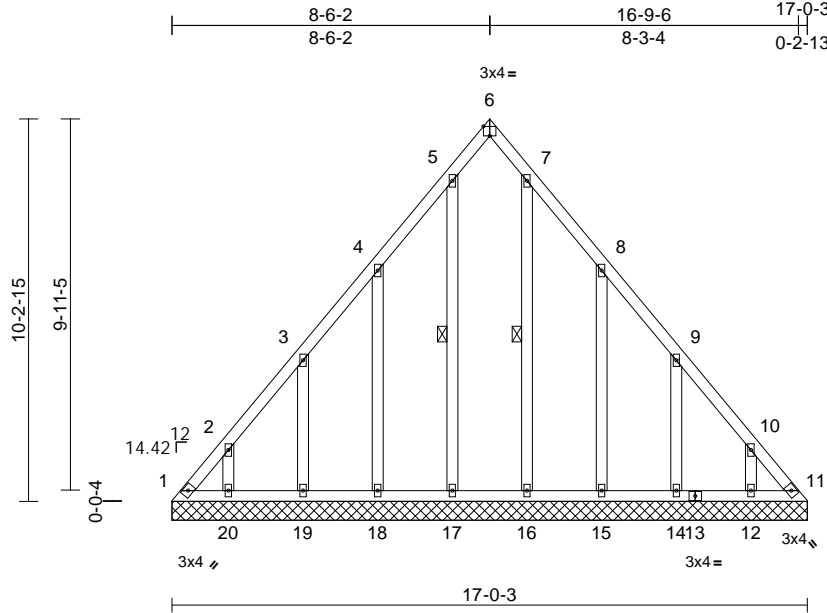

Scale = 1:61.7

Plate Offsets (X, Y): [6:Edge,0-3-1]												
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.06	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.12	Horiz(TL)	0.01	11	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S							Weight: 93 lb	FT = 10%

LUMBER		
TOP CHORD	2x4 SPF No.2	
BOT CHORD	2x4 SPF No.2	
OTHERS	2x4 SPF No.2	
BRACING		
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.	
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.	
WEBS	1 Row at midpt	5-17, 7-16
REACTIONS (lb/size)		
	1=57/17-0-3, 11=57/17-0-3, 12=162/17-0-3, 14=183/17-0-3, 15=184/17-0-3, 16=153/17-0-3, 17=153/17-0-3, 18=184/17-0-3, 19=183/17-0-3, 20=162/17-0-3	
Max Horiz	1=-272 (LC 4)	
Max Uplift	1=-158 (LC 6), 11=-140 (LC 7), 12=-137 (LC 9), 14=-150 (LC 9), 15=-177 (LC 9), 16=-33 (LC 9), 17=-48 (LC 8), 18=-174 (LC 8), 19=-150 (LC 8), 20=-137 (LC 8)	
Max Grav	1=377 (LC 8), 11=366 (LC 9), 12=193 (LC 16), 14=218 (LC 16), 15=224 (LC 16), 16=167 (LC 16), 17=184 (LC 15), 18=220 (LC 15), 19=218 (LC 15), 20=193 (LC 15)	
FORCES (lb) - Maximum Compression/Maximum Tension		
TOP CHORD	1-2=-499/245, 2-3=-370/195, 3-4=-217/132, 4-5=-119/69, 5-6=-67/53, 6-7=-66/47, 7-8=-99/43, 8-9=-202/109, 9-10=-355/171, 10-11=-484/221	
BOT CHORD	1-20=-142/328, 19-20=-142/328, 18-19=-142/328, 17-18=-142/328, 16-17=-142/328, 15-16=-142/328, 14-15=-142/328, 12-14=-142/328, 11-12=-142/328	

WEBS 2-20=-154/153, 3-19=-178/176, 4-18=-180/197, 5-17=-144/72, 7-16=-127/57, 8-15=-184/201, 9-14=-177/175, 10-12=-154/153

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- N/A
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 158 lb uplift at joint 1, 140 lb uplift at joint 11, 137 lb uplift at joint 20, 150 lb uplift at joint 19, 174 lb uplift at joint 18, 48 lb uplift at joint 17, 33 lb uplift at joint 16, 177 lb uplift at joint 15, 150 lb uplift at joint 14 and 137 lb uplift at joint 12.

LOAD CASE(S) Standard



January 17, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
B220005A	V1	Valley	1	1	149722372
Job Reference (optional)					

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Jan 14 14:59:02
ID:7ufEnKQ9fujLYxwXHEyji_zvy1J-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

Page: 1

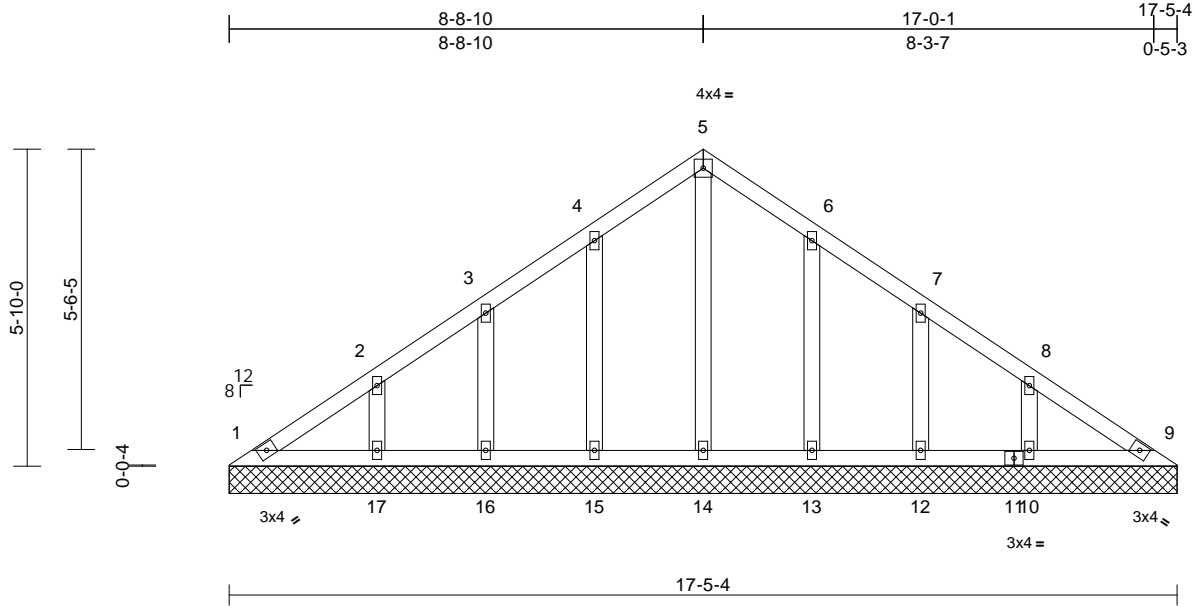

Scale = 1:42.4

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.06	Vert(LL)	n/a	-	n/a	999	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(TL)	n/a	-	n/a	999	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.07	Horiz(TL)	0.00	9	n/a	n/a	
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S							
Weight: 66 lb FT = 10%											

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(lb/size) 1=93/17-5-4, 9=93/17-5-4,
10=222/17-5-4, 12=166/17-5-4,
13=191/17-5-4, 14=143/17-5-4,
15=191/17-5-4, 16=166/17-5-4,
17=222/17-5-4
Max Horiz 1=-144 (LC 4)
Max Uplift 1=-21 (LC 4), 10=-86 (LC 9),
12=-66 (LC 9), 13=-73 (LC 9),
15=-74 (LC 8), 16=-66 (LC 8),
17=-86 (LC 8)
Max Grav 1=114 (LC 16), 9=93 (LC 1),
10=231 (LC 16), 12=173 (LC 16),
13=199 (LC 16), 14=167 (LC 18),
15=200 (LC 15), 16=172 (LC 15),
17=231 (LC 15)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-132/114, 2-3=-110/82, 3-4=-93/99,
4-5=-82/134, 5-6=-69/123, 6-7=-58/63,
7-8=-71/31, 8-9=-97/64
BOT CHORD 1-17=-49/102, 16-17=-49/102,
15-16=-49/102, 14-15=-49/102,
13-14=-49/102, 12-13=-49/102,
10-12=-49/102, 9-10=-49/102
WEBS 5-14=-128/1, 4-15=-159/98, 3-16=-137/90,
2-17=-175/110, 6-13=-158/97, 7-12=-137/90,
8-10=-175/109

NOTES

1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 21 lb uplift at joint 1, 74 lb uplift at joint 15, 66 lb uplift at joint 16, 86 lb uplift at joint 17, 73 lb uplift at joint 13, 66 lb uplift at joint 12 and 86 lb uplift at joint 10.

LOAD CASE(S) Standard



January 17, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
B220005A	V2	Valley	1	1	Job Reference (optional)
					I49722373

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Jan 14 14:59:03
ID:7ufEnKQ9fujLYxwXHEyji_zvy1J-RfC?PsB70Hq3NSgPqnL8w3uITxbGKwRCDoi7J4zJC?f

Page: 1

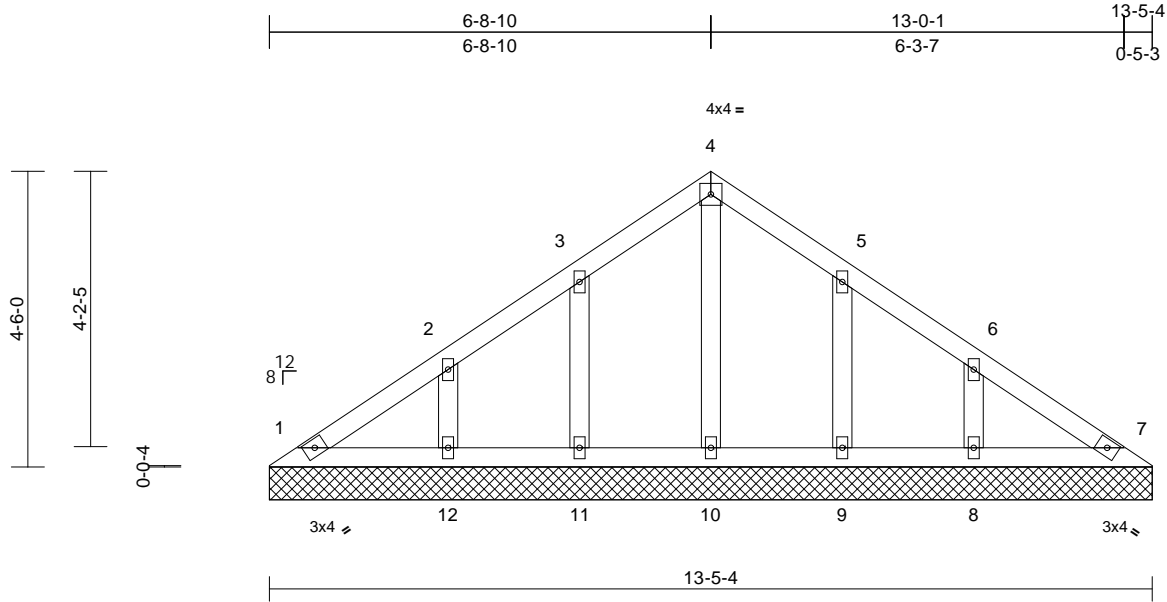

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.06	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	7	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S							Weight: 46 lb	FT = 10%

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
OTHERS	2x4 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(lb/size)	1=94/13-5-4, 7=94/13-5-4, 8=220/13-5-4, 9=175/13-5-4, 10=149/13-5-4, 11=175/13-5-4, 12=220/13-5-4
Max Horiz	1=109 (LC 5)
Max Uplift	1=-10 (LC 4), 8=-86 (LC 9), 9=-70 (LC 9), 11=-70 (LC 8), 12=-85 (LC 8)
Max Grav	1=103 (LC 16), 7=94 (LC 1), 8=228 (LC 16), 9=184 (LC 16), 10=153 (LC 18), 11=184 (LC 15), 12=228 (LC 15)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD	1-2=-96/85, 2-3=-91/67, 3-4=-76/102, 4-5=-63/90, 5-6=-63/40, 6-7=-74/52
BOT CHORD	1-12=-35/75, 11-12=-35/75, 10-11=-35/75, 9-10=-35/75, 8-9=-35/75, 7-8=-35/75
WEBS	4-10=-111/0, 3-11=-149/94, 2-12=-173/109, 5-9=-148/94, 6-8=-173/109

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 10 lb uplift at joint 1, 70 lb uplift at joint 11, 85 lb uplift at joint 12, 70 lb uplift at joint 9 and 86 lb uplift at joint 8.

LOAD CASE(S) Standard



January 17, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Job Reference (optional)
B220005A	V3	Valley	1	1	149722374

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Jan 14 14:59:03
ID:7ufEnKQ9fujLYxwXHEyji_zvy1J-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC7f

Page: 1

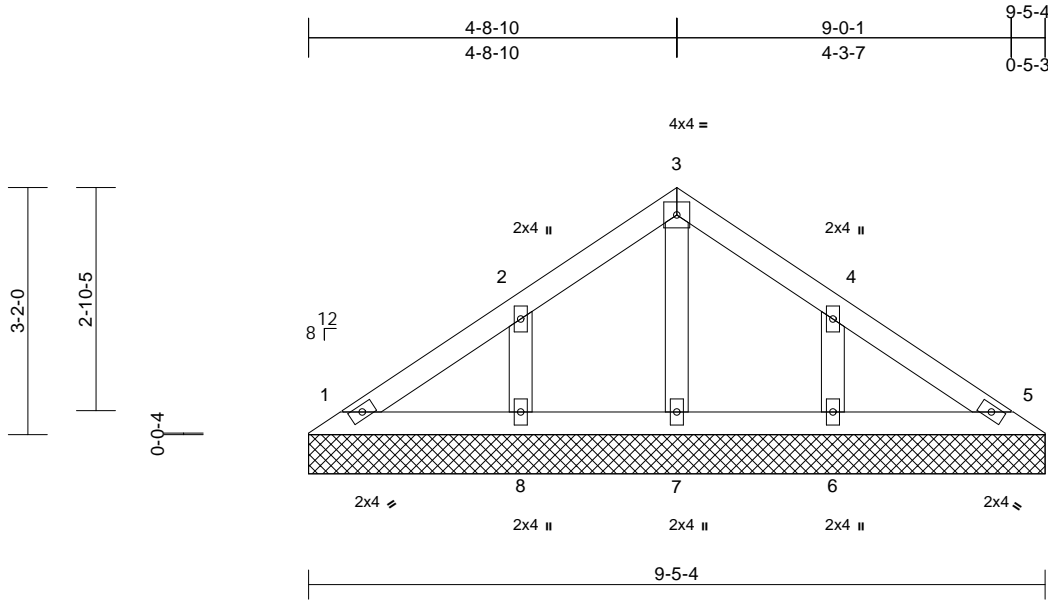

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.06	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.03	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.02	Horiz(TL)	0.00	5	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S						Weight: 28 lb	FT = 10%

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
OTHERS	2x4 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(lb/size)	1=91/9-5-4, 5=91/9-5-4, 6=231/9-5-4, 7=125/9-5-4, 8=231/9-5-4
	Max Horiz	1=-74 (LC 4)
	Max Uplift	1=-9 (LC 9), 6=-91 (LC 9), 8=-91 (LC 8)
	Max Grav	1=91 (LC 1), 5=91 (LC 1), 6=240 (LC 16), 7=125 (LC 1), 8=241 (LC 15)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD	1-2=-74/63, 2-3=-71/69, 3-4=-64/58, 4-5=-56/43
BOT CHORD	1-8=-23/50, 7-8=-23/50, 6-7=-23/50, 5-6=-23/50
WEBS	3-7=-94/0, 2-8=-185/115, 4-6=-184/115

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.

- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 9 lb uplift at joint 1, 91 lb uplift at joint 8 and 91 lb uplift at joint 6.

LOAD CASE(S)

Standard



January 17, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Job Reference (optional)
B220005A	V4	Valley	1	1	I49722375

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Fri Jan 14 14:59:03
ID:7ufEnKQ9fujLYxwXHEyji_zvy1J-RfC?PsB70Hq3NSgPqnL8w3uITxbGKwRCDoi7J4zJC?f

Page: 1

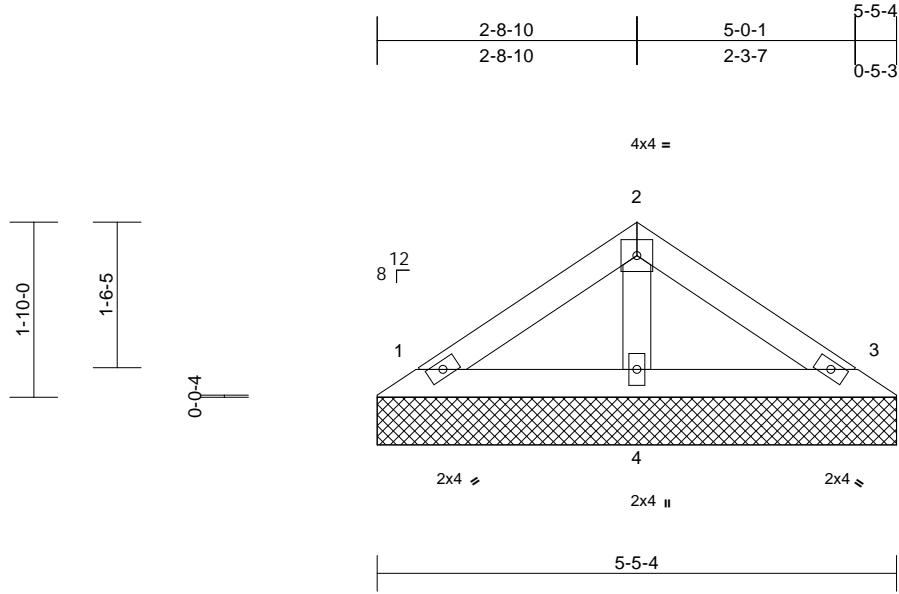

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.09	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.02	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-P							Weight: 14 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 24 lb uplift at joint 1 and 30 lb uplift at joint 3.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-6-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 1=111/5-5-4, 3=111/5-5-4, 4=187/5-5-4
Max Horiz 1=-39 (LC 4)
Max Uplift 1=-24 (LC 8), 3=-30 (LC 9)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-65/35, 2-3=-61/25
BOT CHORD 1-4=-8/28, 3-4=-8/28
WEBS 2-4=-131/33

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.



January 17, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.


For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.

PLATE SIZE


4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION




BEARING

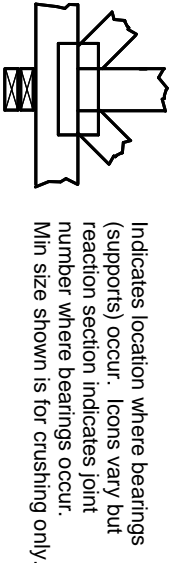

Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:
ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

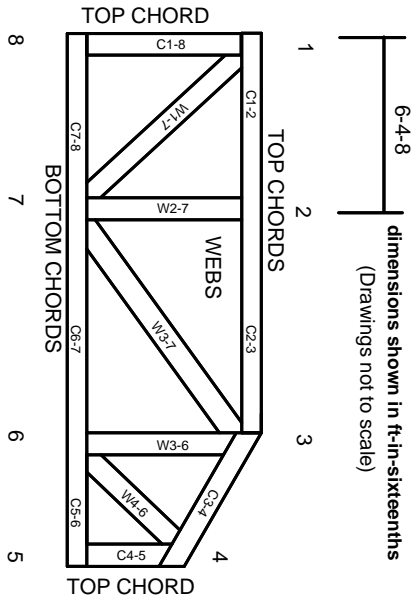

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:
ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved



Mitek Engineering Reference Sheet: MII-7473 rev. 5/19/2020

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.