



FRONT ELEVATION
SCALE: 1/4" = 1'-0"

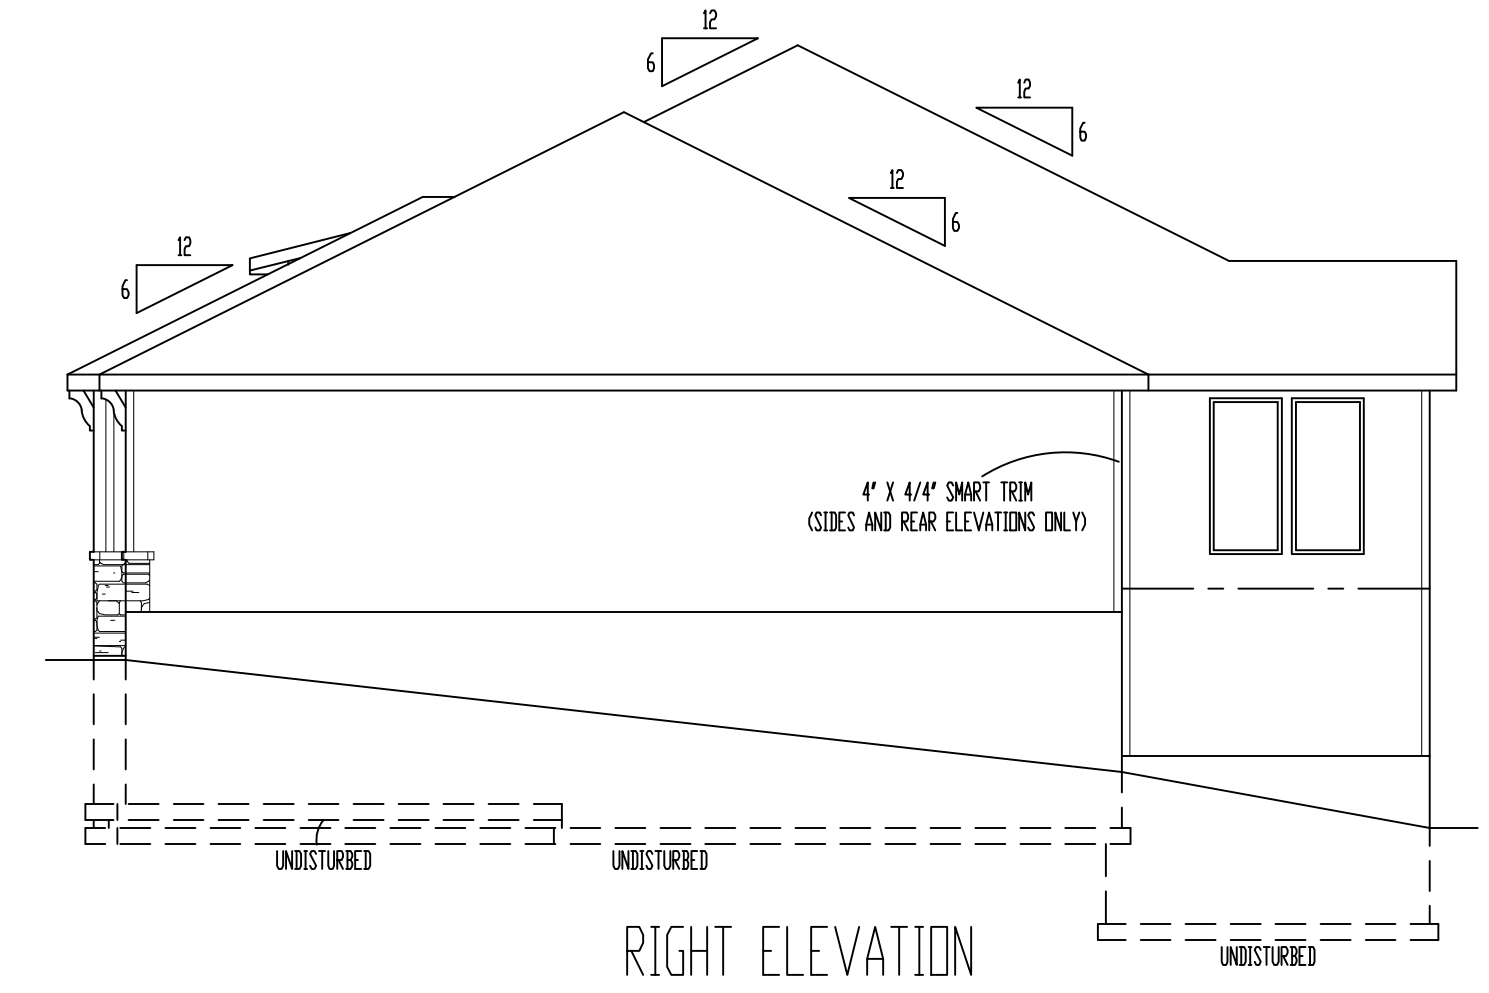

RIGHT ELEVATION
SCALE: 1/8" = 1'-0"

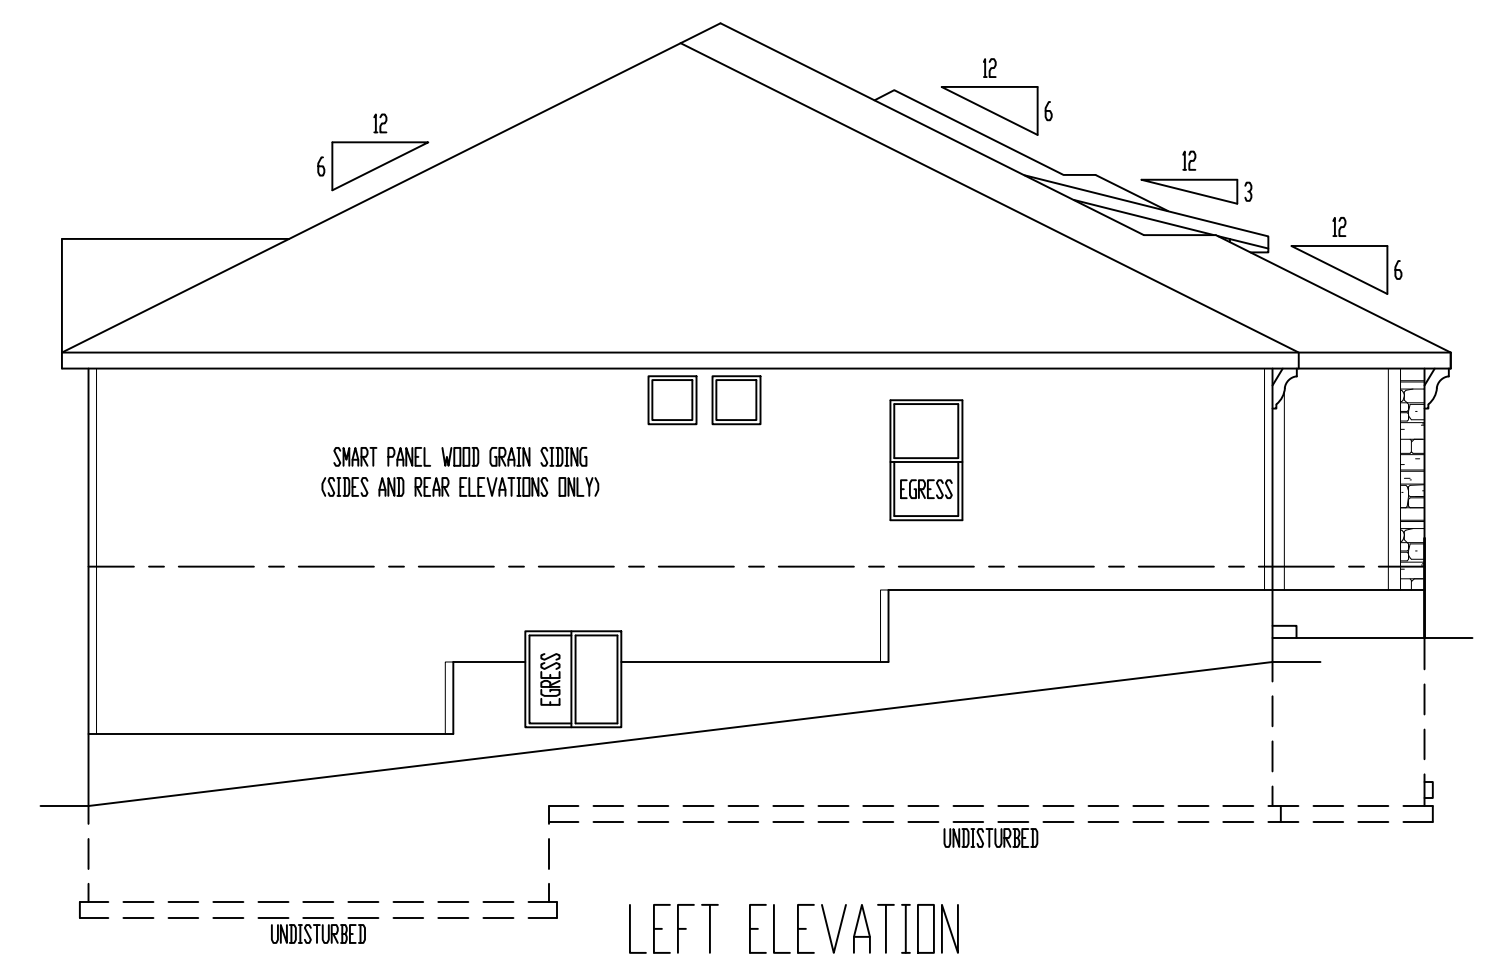

LEFT ELEVATION
SCALE: 1/8" = 1'-0"



REAR ELEVATION
SCALE: 1/8" = 1'-0"

- ELEVATIONS:
 SMART PANEL WOOD GRAIN SIDING ON SIDE AND REAR ELEVATIONS
 COMPOSITION ROOF SHINGLES
 LOCATE ROOF AND SIFFIT VENTS PER CODE
 ADJUST FOUNDATION TO GRADE
- OPTIONAL IDEAS:
 DECK CONSTRUCTION TO COMPLY WITH MUNICIPALITY'S RESIDENTIAL DECK STANDARDS
 2" X 10" @ 16" TYP. @ 16" O.C. FLOOR JOISTS OVER SPAN 14'-0"
 2" X 6" CEDAR OR COMP. BECKING
 6" X 6" CEDAR/PTB. POSTS
 2" X 2" CEDAR SPINDLES
 2" X 6" CEDAR TOP RAIL
 DETERMINE OPTIONAL STAIRS ON SITE

These plans and specifications are protected under federal copyright laws. Copyright © 2022 Viewpoint Residential Design, LLC. Care and effort have gone into the creation and design of this plan. However, the user of these plans is responsible for obtaining all necessary permits and for ensuring that the construction complies with all applicable codes and regulations. Because of the impossibility of any on-site consultation and supervision, Viewpoint Residential Design, LLC, and Designer assume no responsibility for any damage, injury, or loss, in whole or in part, that may result from the use of these plans or blueprints. Also, site conditions may vary from those illustrated on this plan. Designer does not warrant the suitability of these plans for use on your specific site. Consult your architect to determine the suitability of these plans for your specific site and application.


"For God so loved the world, that he gave his only begotten Son, that whosoever believeth in him should not perish, but have everlasting life." (John 3:16)

VIEWPOINT
RESIDENTIAL DESIGN LLC

Office: (816) 354-0400 Email: admin@viewpointdesign.net

Site Description:
Lot 68,
The Retreat at Hook Farms
 Street Address:
2026 SW Red Barn Ln.,
Lee's Summit, Missouri

Drawing Title:
The ADDISON
 General Contractor:
IQ Home Builders

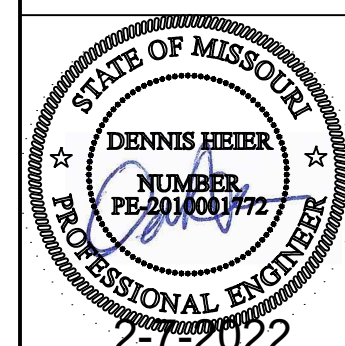


Date: 2-2-AD 2022
 Rev. 1:
 Rev. 2:
 Rev. 3:

Sheet Title:
ELEVATIONS

Sheet No.:
A-1 of 4

RELEASE FOR
 CONSTRUCTION
 AS NOTED ON PLANS REVIEW
 Development Services
 LEE'S SUMMIT, MISSOURI

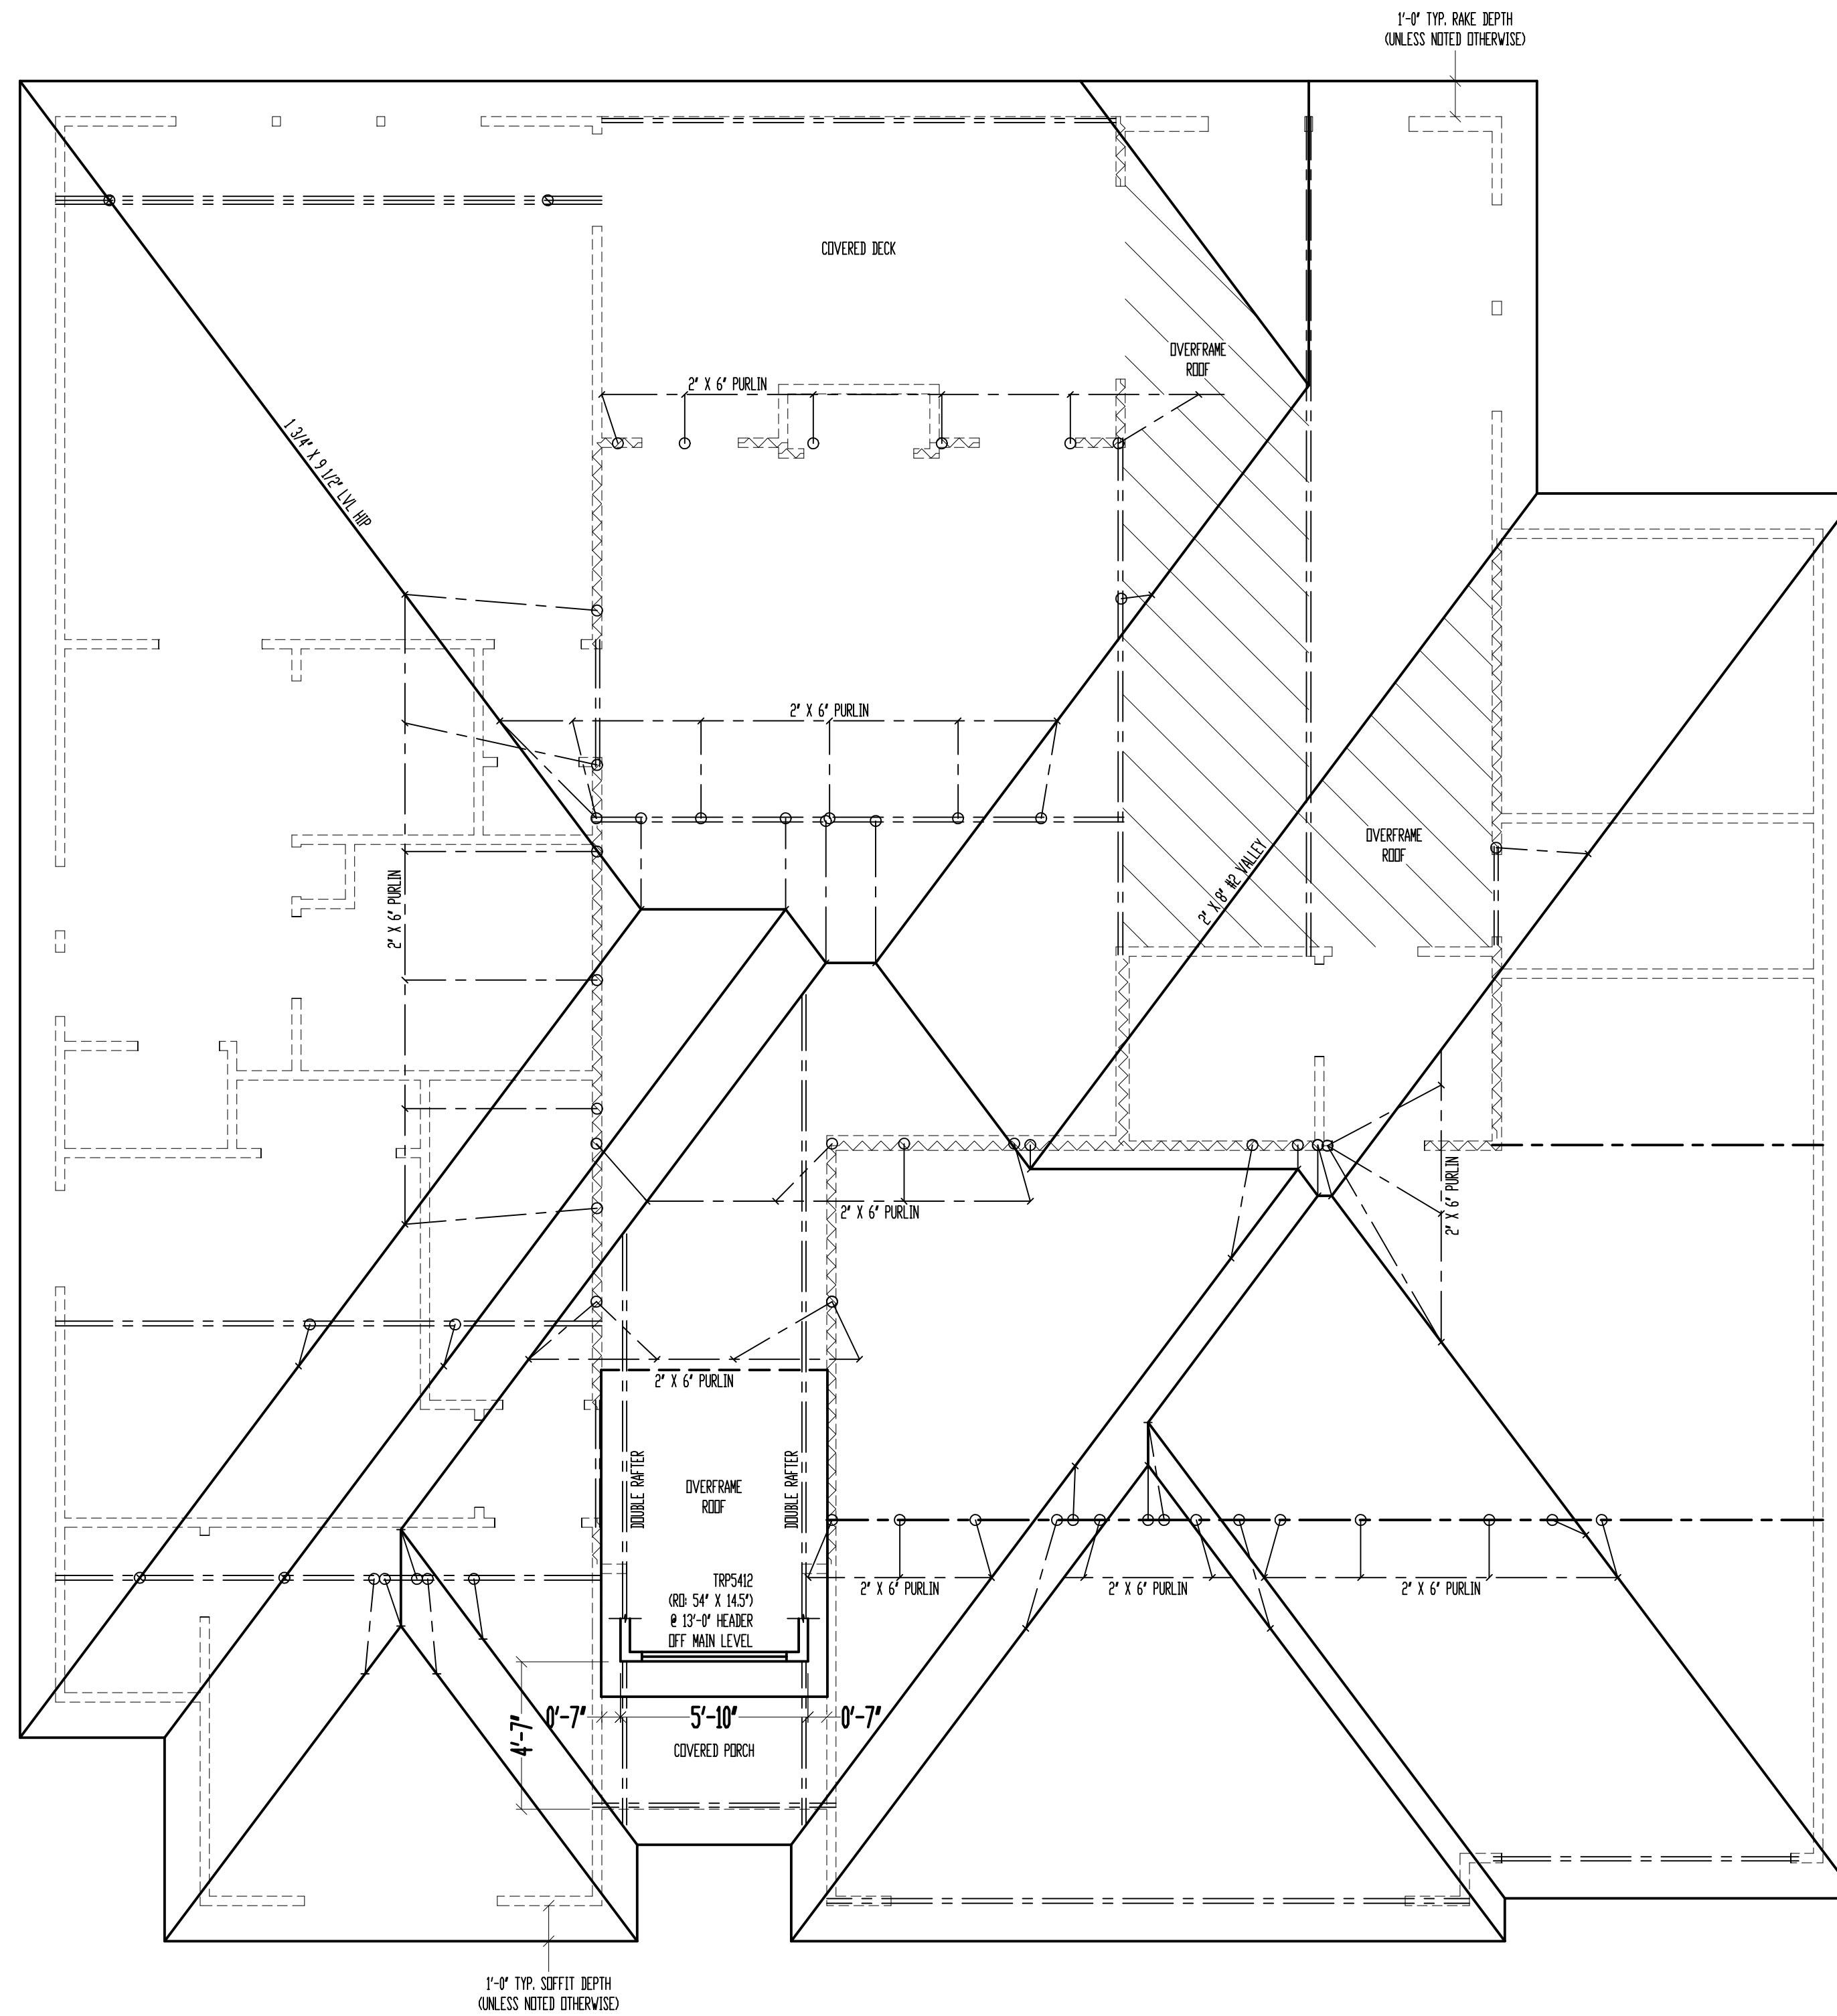

ROOF

SCALE: 1/4" = 1'-0"

WALL RAFTERS SHALL BE 2" X 6" @ 16" O.C., UNLESS NOTED OTHERWISE.

SEE DETAIL 7/532 FOR ALTERNATE RAFTER BEARING DETAIL WHEN RAFTERS ARE REQUIRED TO BEAR HIGHER THAN THE WALL DOUBLE TOP PLATE.

FLASHING NOTES:
DRIP EDGE, VALLEYS AND FLASHINGS TO BE METAL CLAD.

ROOF NOTES:
ROOF DESIGNED FOR LIGHT ROOF COVERING
30psf TOTAL LOAD (10psf DL, 20psf LL G01)

* RAFTERS (GEM-FIR, DOUG-FIR, OR EQUIV.)
SEE SPAN CHARTS BELOW

CODE	MINIMUM	SPACING	MAX. HORIZONTAL CLEARSPAN
R2-246	R24" O.C.	11'-7"	11'-7"
R2-246	R16" O.C.	14'-2"	14'-2"
R2-246	R24" O.C.	14'-0"	14'-0"
R2-246	R16" O.C.	17'-11"	17'-11"
R2-240	R24" O.C.	17'-10"	17'-10"
R2-240	R16" O.C.	21'-11"	21'-11"

NOTE: CODE MINIMUM ALLOWS FOR A RAFTER DEFLECTION OF L/180 TOTAL LOAD

HIGHER PERFORMANCE (RECOMMENDED)	SPACING	MAX. HORIZONTAL CLEARSPAN
R2-246	R24" O.C.	8'-0"
R2-246	R16" O.C.	9'-9"
R2-246	R24" O.C.	11'-2"
R2-240	R16" O.C.	12'-9"
R2-240	R24" O.C.	14'-3"
R2-240	R16" O.C.	16'-3"

REFLECTION = L/360 LIVE LOAD, L/240 TOTAL LOAD

- * VAULTS TO BE 2x10 DEPTH
- * RIDGE BOARDS ARE UNLESS OTHERWISE NOTED:
 - R2-2x8 UP TO 10/12 PITCH
 - R2-2x10 OVER 10/12 PITCH
- * ALL HIPS & VALLEYS ARE UNLESS OTHERWISE NOTED:
 - R2-2x8 UP TO 10/12 PITCH
 - R2-2x10 OVER 10/12 PITCH
- * PURLINS ARE 2x6 MIN.
 - PURLIN STRUTS ARE AT 4'-0" O.C.
 - PURLIN STRUTS SHALL BE INSTALLED AT NOT LESS THAN A 45 DEGREE ANGLE WITH THE HORIZONTAL
 - ALL PURLIN STRUTS SHALL HAVE A MAXIMUM UNBRACED LENGTH OF 8'-0"
 - PURLIN STRUTS SHALL BE CONSTRUCTED IN A "Y" CONFIGURATION AND PER THE FOLLOWING CHART:

PURLIN STRUT	MAX PURLIN STRUT LENGTH
(2) 2x4	8'-0"
(1) 2x4 & (1) 2x6	12'-0"
(1) 2x6 & (1) 2x8	20'-0"
(2) 2x6 & (1) 2x8	30'-0"
CONSULT ARCH/ENGR.	30'-0"

- * RIDGE BRACES ARE SAME AS PURLIN BRACES- SPACING, SIZE, CONFIGURATION, & INSTALLATION (SEE PURLIN BRACE NOTES ABOVE)
- * HIP & VALLEY BRACES ARE SAME AS PURLIN SIZE, CONFIGURATION, & INSTALLATION (SEE PURLIN BRACE NOTES ABOVE)

- * VERTICAL BRACE IF NOT IS UNDER HIP OR VALLEY
- * SLASH IS TOP END OF BRACE (/)
- * DOT IS BOTTOM OF BRACE (.)
- * --- DENOTES BEARING WALL
- * --- DENOTES ROOF BRACE
- * --- DENOTES PURLIN
- * --- DENOTES BEARING STRUCTURE

These plans and specifications are protected under federal copyright laws. Copyright © 2022 Viewpoint Residential Design, LLC. Care and effort have gone into the creation and design of this plan. However, the user of these plans is responsible for their own interpretation and use. The user must be undertaken without the assistance of a construction professional, architect or engineer. Because of the impossibility of any on site consultation and supervision, Viewpoint Residential Design, LLC, and Designer assume no responsibility for any damage, injury, or loss, or for any conditions that may arise from the use of these plans, or blueprints. Also, site conditions may vary from those illustrated on this plan. Designer does not warrant the suitability of these plans for use on your specific site. Consult your architect to determine the suitability of these plans for your specific site and application.


"For God so loved the world, that he gave his only begotten Son, that whosoever believeth in him should not perish, but have everlasting life." (John 3:16)

VIEWPOINT
RESIDENTIAL DESIGN LLC

Office: (816) 354-0400 Email: admin@viewpointdesign.net

Site Description:
Lot 68,
The Retreat at Hook Farms
Street Address:
2026 SW Red Barn Ln.,
Lee's Summit, Missouri


Drawing Title:
The ADDISON
General Contractor:
IQ Home Builders

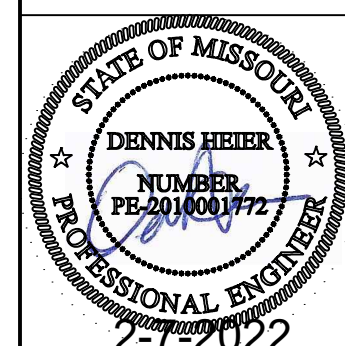

Date: 2-2-AD 2022
Rev. 1:
Rev. 2:
Rev. 3:

Sheet Title:
ROOF PLAN

Sheet No.:
A-2 of 4

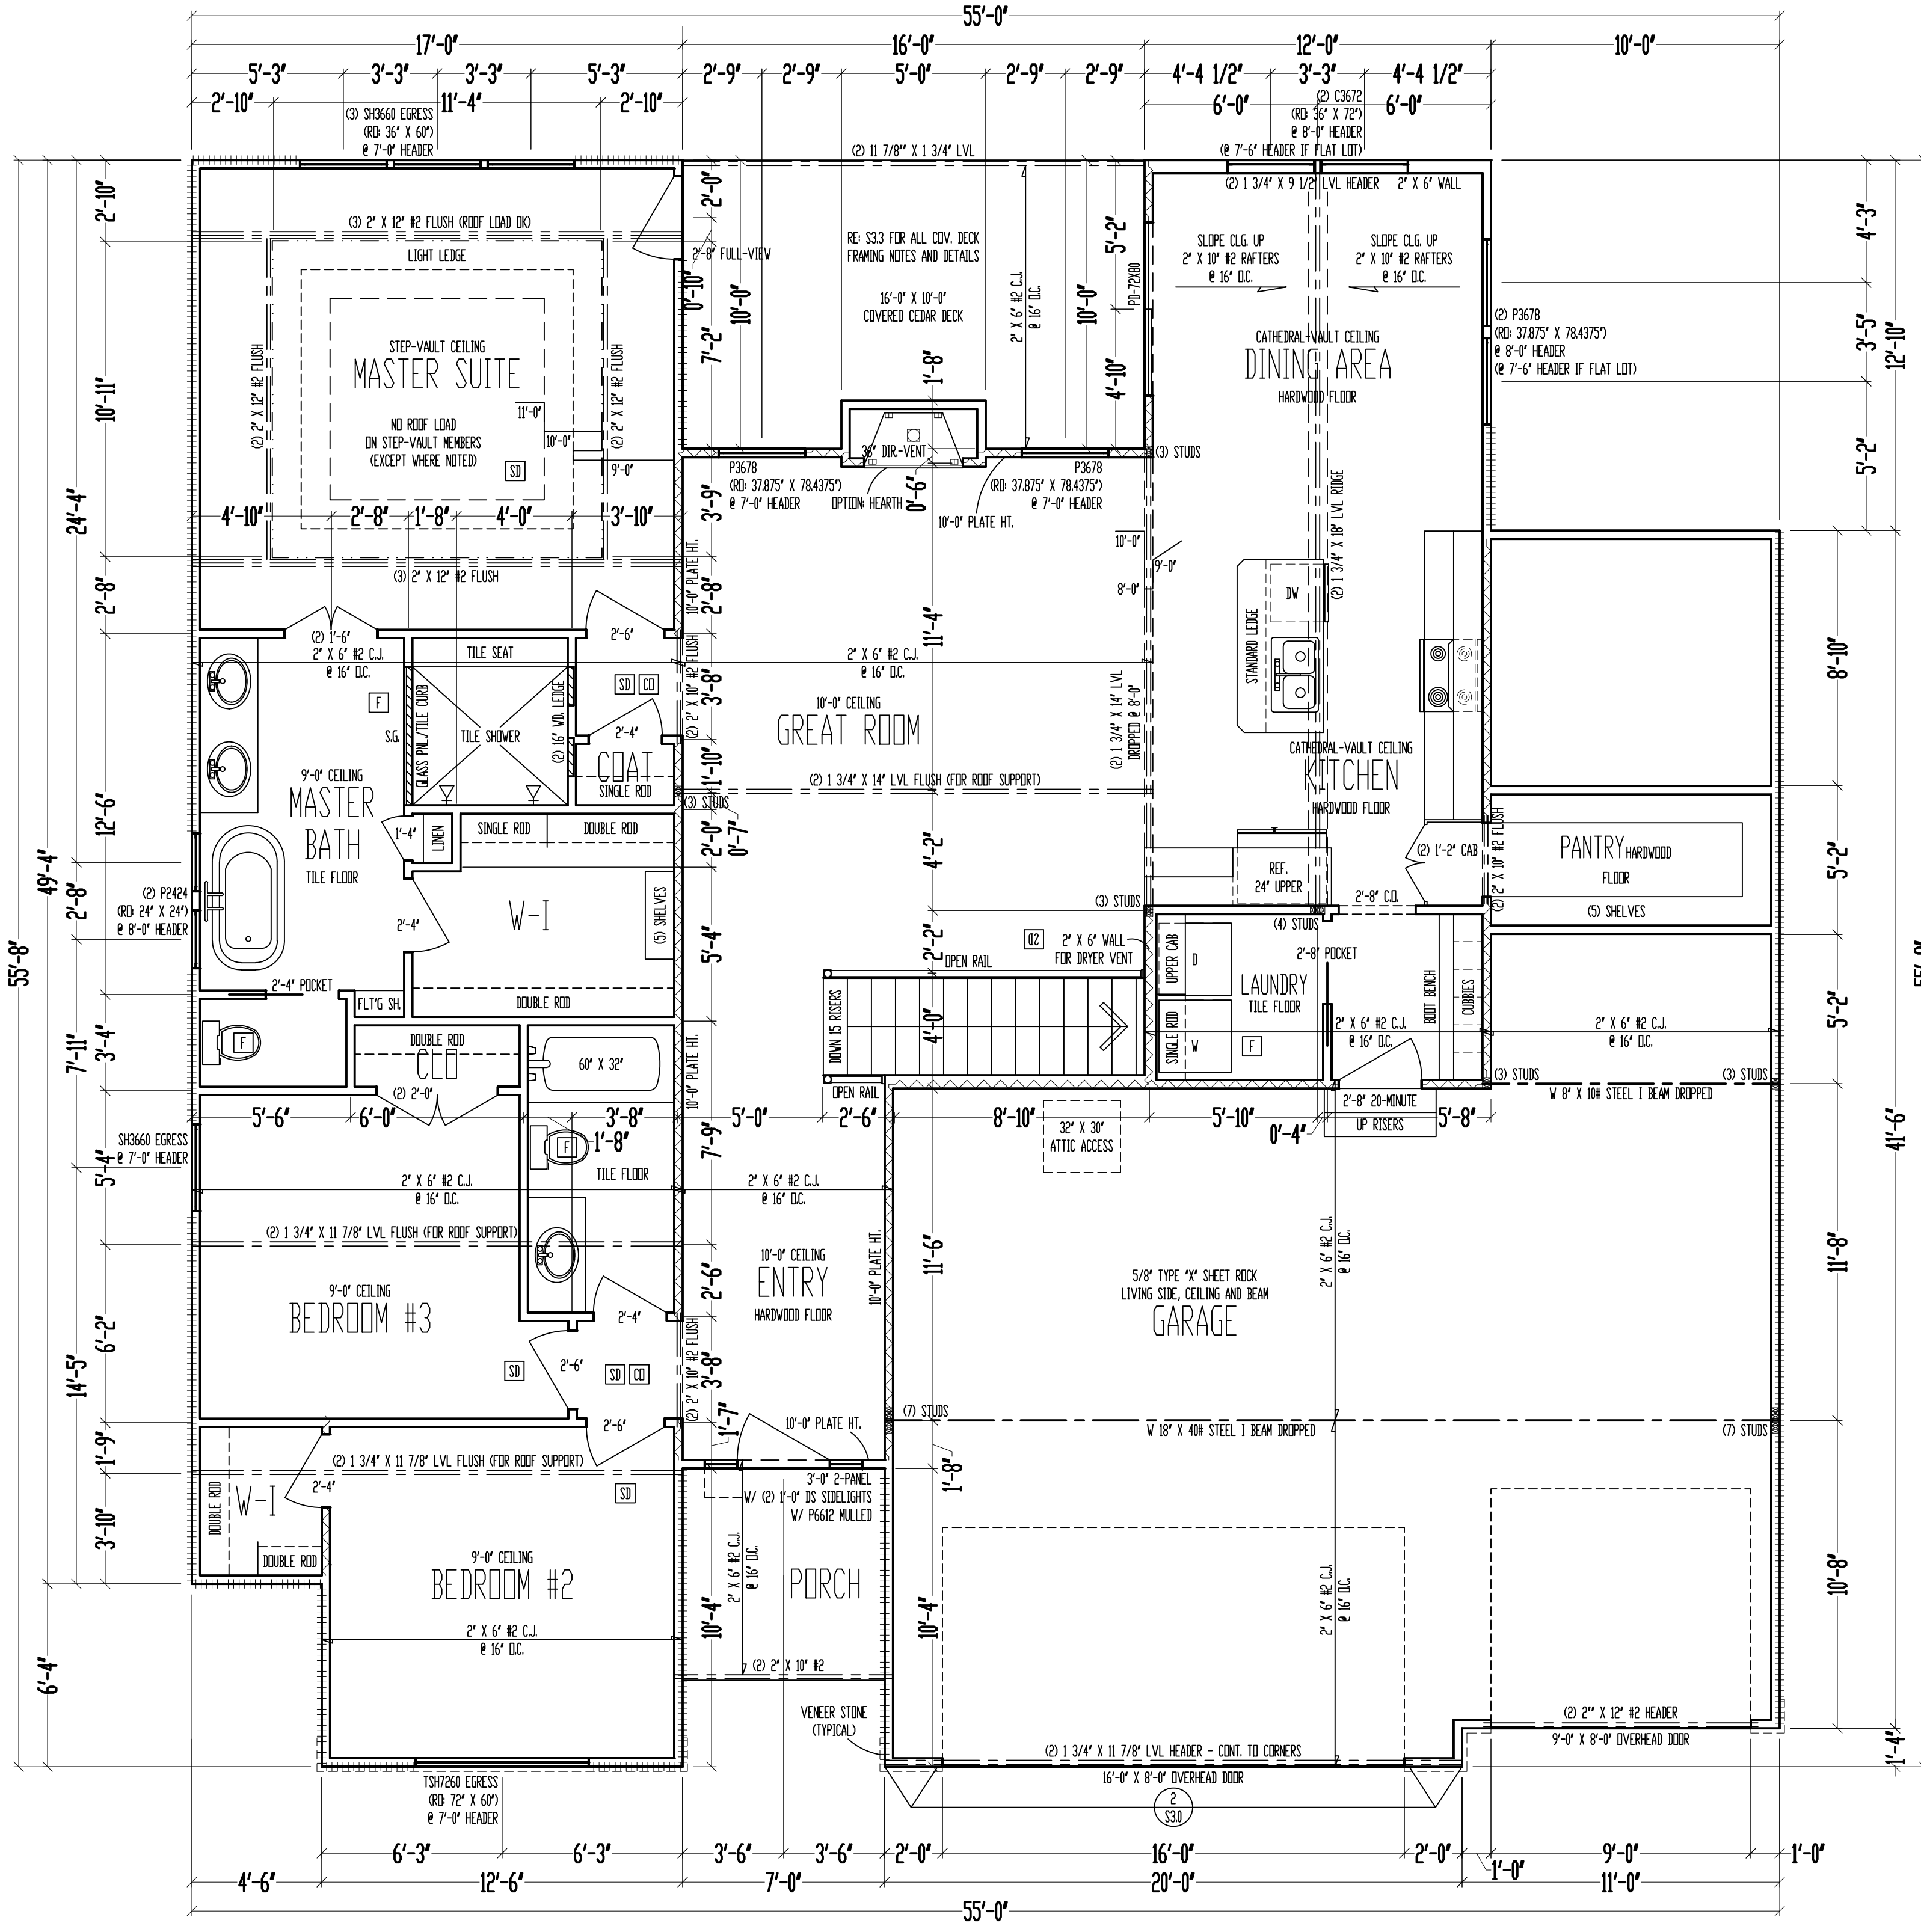

9'-0" CEILING
MAIN LEVEL
 SCALE: 1/4" = 1'-0"
 MAIN LEVEL: 1824 SQ. FT.
 LOWER LEVEL: 884 SQ. FT.
 TOTAL: 2708 SQ. FT.

GARAGE: 764 SQ. FT.
 COV. OUT/LIV: 160 SQ. FT.
 UNFINISHED: 741 SQ. FT.

- ***** = WALL BRACING PER FRAMING NOTE #1 AND PER CALCULATIONS ON SHEET S11.
- FRAMING NOTES:
- MAIN LEVEL EXTERIOR WALLS SHALL BE SHEATHED W/ 7/16" OSB APA PANELS W/ 16' COMMON WALLS @ 6" OC AT EDGES & @ 12" OC IN THE FIELD SHIRT PANEL, OR EQUAL, INSTALLED PER MANUFACTURER'S SPECIFICATIONS.
 - ***** = 6B, 1/2" MIN. OPSUM BOARD OVER STUDS SPACED 24" MAX FASTENED W/ NO. 6 - 1 1/4" TYPE V DR S BRIVALL SCREWS @ 7" OC. EDGES & FIELD: MIN. 8'-0" SECTIONS ONE SIDE OF WALL OR MIN. 4'-0" SECTION FOR BOTH SIDES.
 - ***** = LEAD BEARING INTERIOR WALL.
 - 2" x 10" 1/2" HEADER AT ALL EXTERIOR AND LEAD BEARING WALLS, UNLESS NOTED OTHERWISE.
 - LOW TIES @ 4'-0" (TYPICAL)
 - RUN STUDS THE FULL HEIGHT OF RAISED PLATE WALLS.
 - BLOCK JOISTS ABOVE BEAMS, CANTILEVERS AND LEAD BEARING WALLS WITH JOIST MATERIAL (NOT REQUIRED WITH I-JOISTS).
 - PROVIDE MULTIPLE STUDS FOR SHILD BEARING BELOW ALL BEAMS.
 - ALL DIMENSIONED 2" X 6" WALLS SHALL HAVE DOUBLE KING STUDS AT DOOR AND WINDOW OPENINGS.
 - ALL UNSQUARE WALLS SHALL BE 45°, UNLESS NOTED OTHERWISE.
 - ALL WALLS TO BE FRAMED W/ MIN. STUD GRADE 2" X 4" S @ 16" OC, UNLESS NOTED OTHERWISE.
 - EXTERIOR WALL BOTTOM PLATES SHALL BE NAILED TO FRAMING BELOW WITH 16d COMMON NAILS @ 8" OC MAX. (WHERE APPLICABLE.)
 - CONTRACTOR SHALL NOTIFY ENGINEER OF RECORD BEFORE CONSTRUCTION OF ANY DEFLECTION LIMITATIONS MORE STRINGENT THAN CODE MINIMUMS ABOVE ANY OPENINGS.

These plans and specifications are protected under federal copyright laws. Copyright © 2022 Viewpoint Residential Design, L.L.C. Care and effort have gone into the creation and design of this plan. However, the Designer assumes no liability for any errors, omissions, or other defects that may appear hereon. The Designer shall not be held responsible for any changes or modifications made to this plan without the written consent of the Designer. Because of the impossibility of any on site consultation and supervision, Viewpoint Residential Design, L.L.C. and Designer assume no responsibility for any damages, injuries, or loss of life or property that may occur as a result of the use of these plans or blueprints. Also, site conditions may vary from those illustrated on this plan. Designer does not warrant the suitability of these plans for use on your specific site. Consult your architect to determine the suitability of these plans for your specific site and applicable laws.


"For God so loved the world, that he gave his only begotten Son, that whosoever believeth in him should not perish, but have everlasting life." (John 3:16)

VIEWPOINT
 RESIDENTIAL DESIGN LLC

Office: (816) 354-0400 Email: admin@viewpointdesign.net

Site Description:
Lot 68,
The Retreat at Hook Farms
 Street Address:
2026 SW Red Barn Ln.,
Lee's Summit, Missouri


Drawing Title:
The ADDISON
 General Contractor:
IQ Home Builders

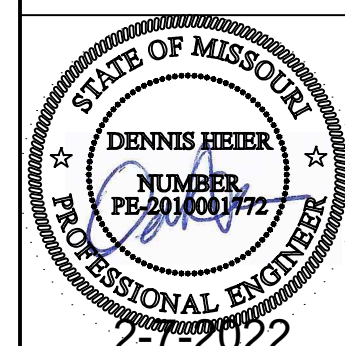

Date: 2-2-AD 2022
 Rev. 1:
 Rev. 2:
 Rev. 3:

Sheet Title:
MAIN LEVEL PLAN

Sheet No.:
A-3 of 4

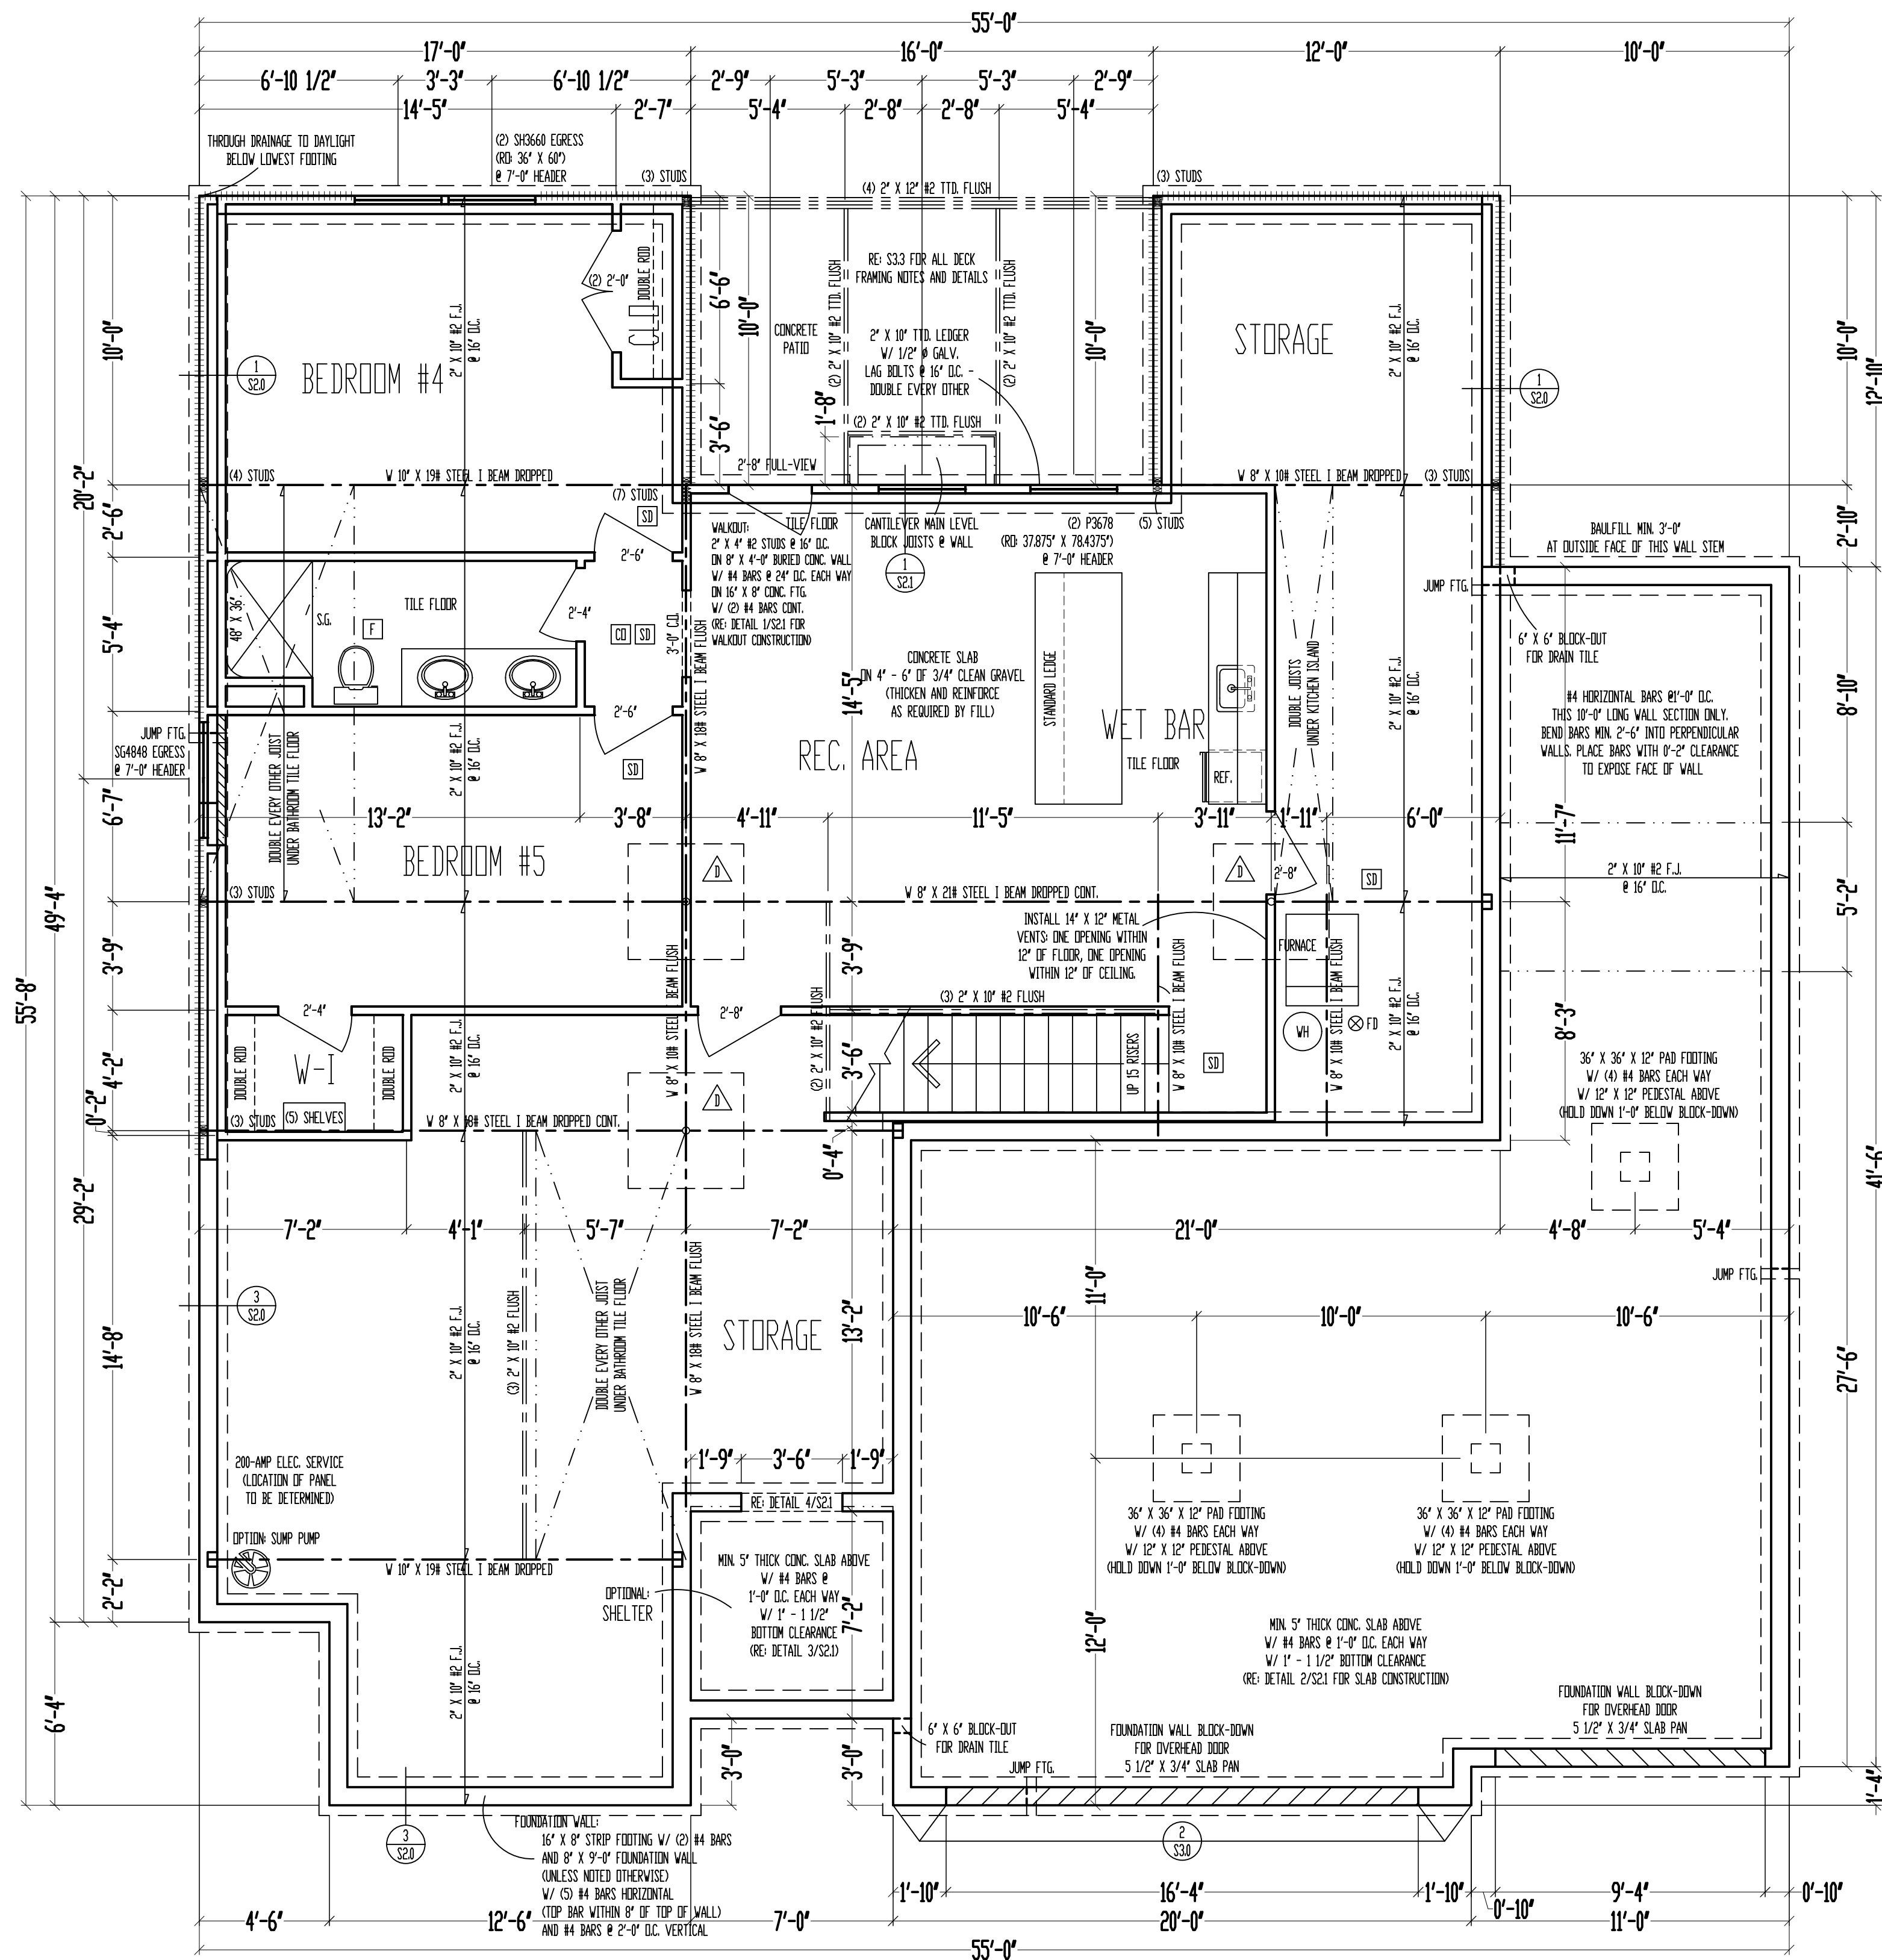

9'-0" FOUNDATION WALLS
(UNLESS NOTED OTHERWISE)
ON 16" X 8" STRIP FOOTINGS
(STEP WHERE GRADE REQUIRES)

2" X 10" FLOOR SYSTEM ABOVE
FOUNDATION
SCALE: 1/4" = 1'-0"

***** = WALL BRACING PER FRAMING NOTE #1 AND PER CALCULATIONS ON SHEET S11.

- FRAMING NOTES:
- BASEMENT EXTERIOR WOOD-FRAMED WALLS SHALL BE SHEATHED W/ 7/16" OSB. APA PANELS W/ 84 COMMON NAILS @ 6" O.C. AT EDGES & @ 12" O.C. IN THE FIELD. SMART PANEL, OR EQUAL, INSTALLED PER MANUFACTURER'S SPECIFICATIONS.
 - MIN. OPSPM BOARD OVER STUDS SPACED 24" MAX FASTENED W/ MIN. 6 - 1 1/4" TYPE W OR S 30" WALL SCREWS @ 7" O.C. EDGES & FIELD. ON 8'-0" SECTIONS ONE SIDE OF WALL. ON MIN. 4'-0" SECTION FOR BOTH SIDES.
 - LEAD BEARING INTERIOR WALL.
 - LEAD BEARING AT ALL EXTERIOR AND LEAD BEARING WALLS, UNLESS NOTED OTHERWISE.
 - LEAD TIES @ 4'-0" O.C. (TYPICAL).
 - RUN STUDS THE FULL HEIGHT OF RAISED PLATE WALLS.
 - BLOCK JOISTS ABOVE BEAMS, CANTILEVERS AND LEAD BEARING WALLS WITH JOIST MATERIAL (NOT REQUIRED WITH I-JOISTS).
 - PROVIDE MULTIPLE STUDS FOR SOLID BEARING BELOW ALL BEAMS.
 - ALL UNDESIGNED 2" X 6" WALLS SHALL HAVE DOUBLE KING STUDS AT DOOR AND WINDOW OPENINGS.
 - ALL UNSQUARE WALLS SHALL BE 45°, UNLESS NOTED OTHERWISE.
 - ALL WALLS TO BE FRAMED W/ MIN. STUD GRADE 2" X 4" @ 16" O.C., UNLESS NOTED OTHERWISE.
 - 1/2" x 1/2" ANCHOR BOLTS W/ MIN. 7" EMBEDMENT @ 48" O.C. MAX. & WITHIN 6" - 12" OF END OF EACH PLATE LENGTH.
 - NEW FOUNDATION SHALL BEAR ON ORIGINAL SOIL WITH MINIMUM BEARING CAPACITY OF 1500 PSF. A GEOTECHNICAL ENGINEER IS RECOMMENDED FOR VERIFICATION OF THESE CONDITIONS DURING THE EXCAVATION PHASE. ENGINEER OF RECORD ASSUMES NO RESPONSIBILITY FOR CONSTRUCTION NOT VERIFIED TO BE FOUND ON ANYTHING SHORTER OF THE AFOREMENTIONED REQUIREMENTS.
 - CONTRACTOR SHALL NOTIFY ENGINEER OF RECORD BEFORE CONSTRUCTION OF ANY REFLECTION LIMITATIONS MORE STRINGENT THAN CODES MINIMUMS ABOVE ANY OPENINGS.

STEEL COLUMN & PAD FOOTING SCHEDULE	
A	3" x 11 GA. STEEL COLUMN ON 36" x 36" x 10" PAD FOOTING W/ (4) #4 BARS EACH WAY (2454)
B	3 1/2" x 11 GA. STEEL COLUMN ON 36" x 36" x 10" PAD FOOTING W/ (4) #4 BARS EACH WAY (2510)
C	3" SCH. 40 STEEL COLUMN ON 42" x 42" x 12" PAD FOOTING W/ (5) #4 BARS EACH WAY (2454)
D	3 1/2" SCH. 40 STEEL COLUMN ON 48" x 48" x 12" PAD FOOTING W/ (5) #4 BARS EACH WAY (2510)
E	3 1/2" SCH. 40 STEEL COLUMN ON 36" x 36" x 10" PAD FOOTING W/ (7) #4 BARS EACH WAY (4150)
F	3 1/2" SCH. 40 STEEL COLUMN ON 60" x 60" x 14" PAD FOOTING W/ (9) #4 BARS EACH WAY (5100)

PIER FOOTING SCHEDULE	
A	12" # PIER FTG.
B	16" # PIER FTG.
C	18" # PIER FTG.
D	24" # PIER FTG.


These plans and specifications are protected under federal copyright laws. Copyright © 2022 Viewpoint Residential Design, LLC. Care and effort have gone into the creation and design of this plan. However, the user of these plans and specifications is advised that they are not to be used for any other project without the written consent of Viewpoint Residential Design, LLC. Because of the impossibility of any on-site consultation and supervision, Viewpoint Residential Design, LLC and Designer assume no responsibility for any changes, omissions, or errors in these plans and specifications. Also, site conditions may vary from those illustrated on this plan. Designer does not warrant the suitability of these plans for use on your specific site. Consult your architect to determine the suitability of these plans for your specific site and application.

"For God so loved the world, that he gave his only begotten Son, that whosoever believeth in him should not perish, but have everlasting life." (John 3:16)

VIEWPOINT
RESIDENTIAL DESIGN LLC
Office: (816) 354-0400
Email: admin@viewpointdesign.net

Site Description:
Lot 68,
The Retreat at Hook Farms
Street Address:
2026 SW Red Barn Ln.,
Lee's Summit, Missouri

Drawing Title:
The ADDISON
General Contractor:
IQ Home Builders

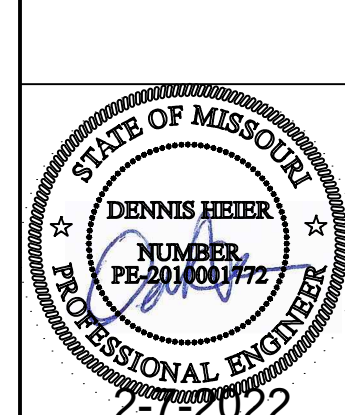

Date: 2-2-AD 2022
Rev. 1:
Rev. 2:
Rev. 3:

Sheet Title:
FOUNDATION PLAN

Sheet No.:
A-4 of 4

RESIDENTIAL SEISMIC & WIND ANALYSIS							INPUT	
DETERMINE WEIGHT OF HOUSE:							CALCULATED VALUE	
LOCATION	DEAD LOAD (psf)	AREA (ft ²)					WEIGHT (lbs.)	
ROOF	10	2837					28370	
CEILING	10	2837					28370	
FIRST FLOOR	10	2837					28370	
FIRST FLOOR EXT. WALL DL	WALL LENGTH (ft)	WALL HEIGHT (ft)	WALL UNIT WT. (psf)					WEIGHT (lbs.)
	221.34	9	9					17928.54
FIRST FLOOR INT. PARTITION WALL DL	DEAD LOAD (psf)	AREA (ft ²)					WEIGHT (lbs.)	
	9	2837					17022	
PROJECTED AREAS (WIND DESIGN PER 115 MPH 3-SECOND GUST, EXPOSURE C AND MEAN ROOF HEIGHT <= 30 FT ASSUMED)								
FRONT-TO-BACK				SIDE-TO-SIDE				
SLOPED ROOF	AREA	LOAD		SLOPED ROOF	AREA	LOAD		
	444	3778			429	3646		
VERT. ROOF	0	0	CUMULATIVE	VERT. ROOF	0	0	CUMULATIVE	
TST	550	6638		TST	556.7	6913		10634
BSMT	0	0		BSMT	190	2690		8007
PRESSURE (PSF) - PER ASCE CH. 6								
SLOPED ROOF	ZONE B	9.7		ZONE C	11.3			2a (FIG. 28.6-1, ASCE7)
WALL/VERT. ROOF	ZONE A	14.2		ZONE D	7.7			11
MEAN ROOF HT., ft	21							

a) If there is a walkout wall to be sheathed, determine tributary wind area and enter here. If no walkout, enter 0 for area.
 $q_{10} = 0.00256 K_d K_{e1} K_{z1} V^2$ (ASCE7-10 Velocity Pressure) $q_{10, ASD} = 0.8 q_{10}$ (Design Velocity Pressure for ASD analysis under ASCE7-10 and IRC/IBC 2012)

1ST FLOOR TRIBUTARY WEIGHT	65704.27
BASEMENT TRIBUTARY WEIGHT	65704.27
S _s (SITE GROUND MOTION - %g - FROM ASCE7 SEISMIC MAP)	12.0%
F _s (from ASCE7 Table 11.4-1)	1.6
S _{0.5} (= 2/3 * S _s * F _s)	0.128
R (from ASCE7 Table 12.2-1)	6.5

SEISMIC SHEAR		
LOCATION	From ASCE7 (Eq. 12.8-1):	V (= 1.2 * S _{0.5} * W / R) (lbs.)
1ST FLOOR		1553
BASEMENT		1553

Sheathing Location	Min. Sheathing Schedule	Fastening Schedule	Allowable Shear (#/LF)	Code Reference
Exterior (Option #1)	7/16" APA Rated Plywood/OSB	1-1/2" Rips, Staples w/ 1" penetration @ 3" O.C. Edges, 6" O.C. Field For 24" stud spacing, 12" O.C. Field For 19" stud spacing	155	per IBC, Table 2306.3(1)
Exterior (Option #2)	7/16" APA Rated Plywood/OSB	1-1/2" Rips, Staples w/ 1" penetration @ 3" O.C. Edges, 6" O.C. Field For 24" stud spacing, 12" O.C. Field For 19" stud spacing	230	per IBC, Table 2306.3(1)
Exterior (Option #3)	7/16" APA Rated Plywood/OSB	1-1/2" Rips, Staples w/ 1" penetration @ 3" O.C. Edges, 6" O.C. Field For 24" stud spacing, 12" O.C. Field For 19" stud spacing	310	per IBC, Table 2306.3(1)
Exterior (Option #4)	7/16" APA Rated Plywood/OSB or shiplap panel sheathing, or 3/8" shiplap panel sheathing with tighter nail spacing	8d Common Nails w/ 1-3/8" penetration @ 3" O.C. Edges, 12" O.C. Field for 7/16" APA-rated plywood/OSB or shiplap panel sheathing OR @ 4" O.C. Edges, 12" O.C. Field for 3/8" shiplap panel sheathing	220	AF&PA SDPWS Table 4.3A
Exterior (Option #5)	7/16" APA Rated Plywood/OSB or shiplap panel sheathing, or 3/8" shiplap panel sheathing with tighter nail spacing	8d Common Nails w/ 1-3/8" penetration @ 4" O.C. Edges, 12" O.C. Field for 7/16" APA-rated plywood/OSB or shiplap panel sheathing OR @ 3" O.C. Edges, 12" O.C. Field for 3/8" shiplap panel sheathing	320	AF&PA SDPWS Table 4.3A
Exterior (Option #6)	7/16" APA Rated Plywood/OSB or shiplap panel sheathing, or 3/8" shiplap panel sheathing with tighter nail spacing and double studs at each panel edge	8d Common Nails w/ 1-3/8" penetration @ 3" O.C. Edges, 12" O.C. Field	410	AF&PA SDPWS Table 4.3A
Interior	1/2" Gypsum Board	No. 6-1 1/4" Type W or S Screws @ 8" O.C. Edges, 12" O.C. Field	60	per IBC, Table 2306.4.4
Interior	16 Ga. Simpson/USP Type WB Steel X-Brace (or (3) 16d @ end studs & (1) 8d @ intermediate studs (per manufacturer specifications - see detail on sheet S3))		325	

EXTERIOR SHEATHING OPTION FOR FIRST FLOOR	4	WIDTH OF 1ST STORY (FT.)	55	WIDTH OF 2ND STORY (FT.)	1
EXTERIOR SHEATHING OPTION FOR BASEMENT WALLS	4	DEPTH OF 1ST STORY (FT.)	55.67	DEPTH OF 2ND STORY (FT.)	1
		BACK WALL OF GARAGE (FT.)	0		
		GAR. WALL: 1=F-B, 2=S-S	2		

EXTERIOR STRUCTURAL WALL LENGTHS (ft.) & RESISTANCES								
	SEISMIC				WIND			
	FRONT-TO-BACK	RESISTANCE (lbs.)	SIDE-TO-SIDE	RESISTANCE (lbs.)	FRONT-TO-BACK	RESISTANCE (lbs.)	SIDE-TO-SIDE	RESISTANCE (lbs.)
1ST FLOOR	77	21560	27.5	7700	77	30184	27.5	10780
BASEMENT	0	0	22	6160	0	0	22	8624

	ADDITIONAL RESISTANCE REQUIRED		Anchor Bolt Spacing (in)		16d Nail Spacing req'd at bottom plate (in)	
	SEISMIC	WIND	diameter (in)	per NDS	1st Floor F-B	1st Floor S-S
1ST FLOOR FRONT-TO-BACK	0	0	0.5	844	28	28
1ST FLOOR SIDE-TO-SIDE	0	0	188.8			
BASEMENT FRONT-TO-BACK	0	0	187.5			
BASEMENT SIDE-TO-SIDE	0	0				

RESISTANCE REQUIRED IN ADDITION TO RESISTANCE PROVIDED BY EXTERIOR WALLS**							
	ADDITIONAL RESISTANCE REQUIRED (POUNDS)	PORTAL FRAMES OR PERF. SHEAR WALL RESISTANCE	INTERIOR X-BRACES (2S/WBRACE)	INTERIOR WALL LENGTH W/ 1/2" GYPSUM BOARD PER TABLE (FT.)	INT. WALL LENGTH SHEATHED W/ OSB (TOTAL LENGTH, ONE SIDE, FT.)	RESISTANCE PROVIDED BY ADDITIONAL METHODS (POUNDS)	OK?
1ST FLOOR FRONT-TO-BACK	0					0	YES
1ST FLOOR SIDE-TO-SIDE	0					0	YES
BASEMENT FRONT-TO-BACK	0					0	YES
BASEMENT SIDE-TO-SIDE	0					0	YES


**NOTES: 1) SEE ATTACHED CALCULATIONS FOR PORTAL FRAME OR PERFORATED SHEAR WALL RESISTANCE CAPACITIES (IF APPLICABLE).
 2) SEE SHEET S1 FOR INTERIOR STEEL X-BRACE INSTALLATION, 3) INTERIOR WALLS SHEATHED WITH OSB SHALL BE ATTACHED WITH SAME STAPLE/NAILING PATTERN AS EXTERIOR OSB ON SAME FLOOR (SEE TABLE ABOVE) AND ARE ONLY APPLICABLE FOR FULL-HEIGHT SECTIONS OF 2'-0" OR LONGER
 ALL LATERAL BRACING ACHIEVED AT EXTERIOR WALLS AND WALLS DIRECTLY ON FOUNDATIONS; THEREFORE, NO INTERIOR BRACING PER 2012 IRC SECTION R502.2.1 IS REQUIRED

WIND UPLIFT ANALYSIS										
ROOF PITCH (MAX)	X/12	DEGREES	PITCH OF 6 OR LESS: EOH-13.3, E-7.2, G-5.2							
ASCE 7										
OVERHANG	LENGTH (FT.)	PRESSURE (PSF)	LINEAL FT. OF OH	UPLIFT PER FT. (LBS)						
	1	-1.08	223.34	-1.08						
TOTAL AREA (FT ²)		3061.85	ZONE O AREA (FT ²)	3501.85	PRESSURE ZN. E (PSF)	-1.08	PRESSURE ZN. G (PSF)	-0.36	TOTAL FORCE (LBS)	-785
MAIN ROOF**									FORCE PER LINEAL FT @ PERIMETER (LBS)	-3.5
*ALONG PERIMETER					TOTAL UPLIFT PER LINEAL FOOT ALONG EXTERIOR (POUNDS)	-4.6	UPLIFT OK			
**INSIDE EXTERIOR WALLS					RESISTANCE DUE TO DEAD WEIGHT & (3) 16d TOENAILS	251.6				

NOTE FOR CONSTRUCTION:
 THE CONTINUOUS STRUCTURAL PANEL SHEATHING BRACING METHOD REQUIRES USE OF THE ABOVE TABLE FOR SHEATHING OF THE ENTIRE STRUCTURE. IN ADDITION, FRAMING MEMBERS SHALL BE @ 16" O.C. MAX., UNBLOCKED, AND W/ SHEATHING APPLIED DIRECTLY TO FRAMING MEMBERS

NOTE FOR DESIGN:
 ALL WALLS USED IN THE CALCULATION OF THE RESISTANCE FOR THIS STRUCTURE SHALL HAVE A MINIMUM UNINTERRUPTED HEIGHT OF 8'-0" AND LENGTH OF 2'-8". ALLOWABLE RESISTANCES HAVE BEEN #/FT AND INCREASED BY 40% FOR WIND LOADS, PER VALUES IN 2012 IBC SECTION 2306 AND AF&PA SDPWS TABLE 4.3A. FOR EXAMPLE, 7/16" APA-RATED SHEATHING WITH 8d @ 6" & 12" HAS A SEISMIC SHEAR VALUE OF 240 A WIND SHEAR VALUE OF 335#/FT - 40% GREATER THAN THAT OF SEISMIC)

NOTE: SOIL SITE CLASS ASSUMED TO BE CLASS D. IF SITE CONDITIONS ARE DETERMINED TO BE CLASS E OR F, CONSULT ENGINEER BEFORE PROCEEDING WITH CONSTRUCTION

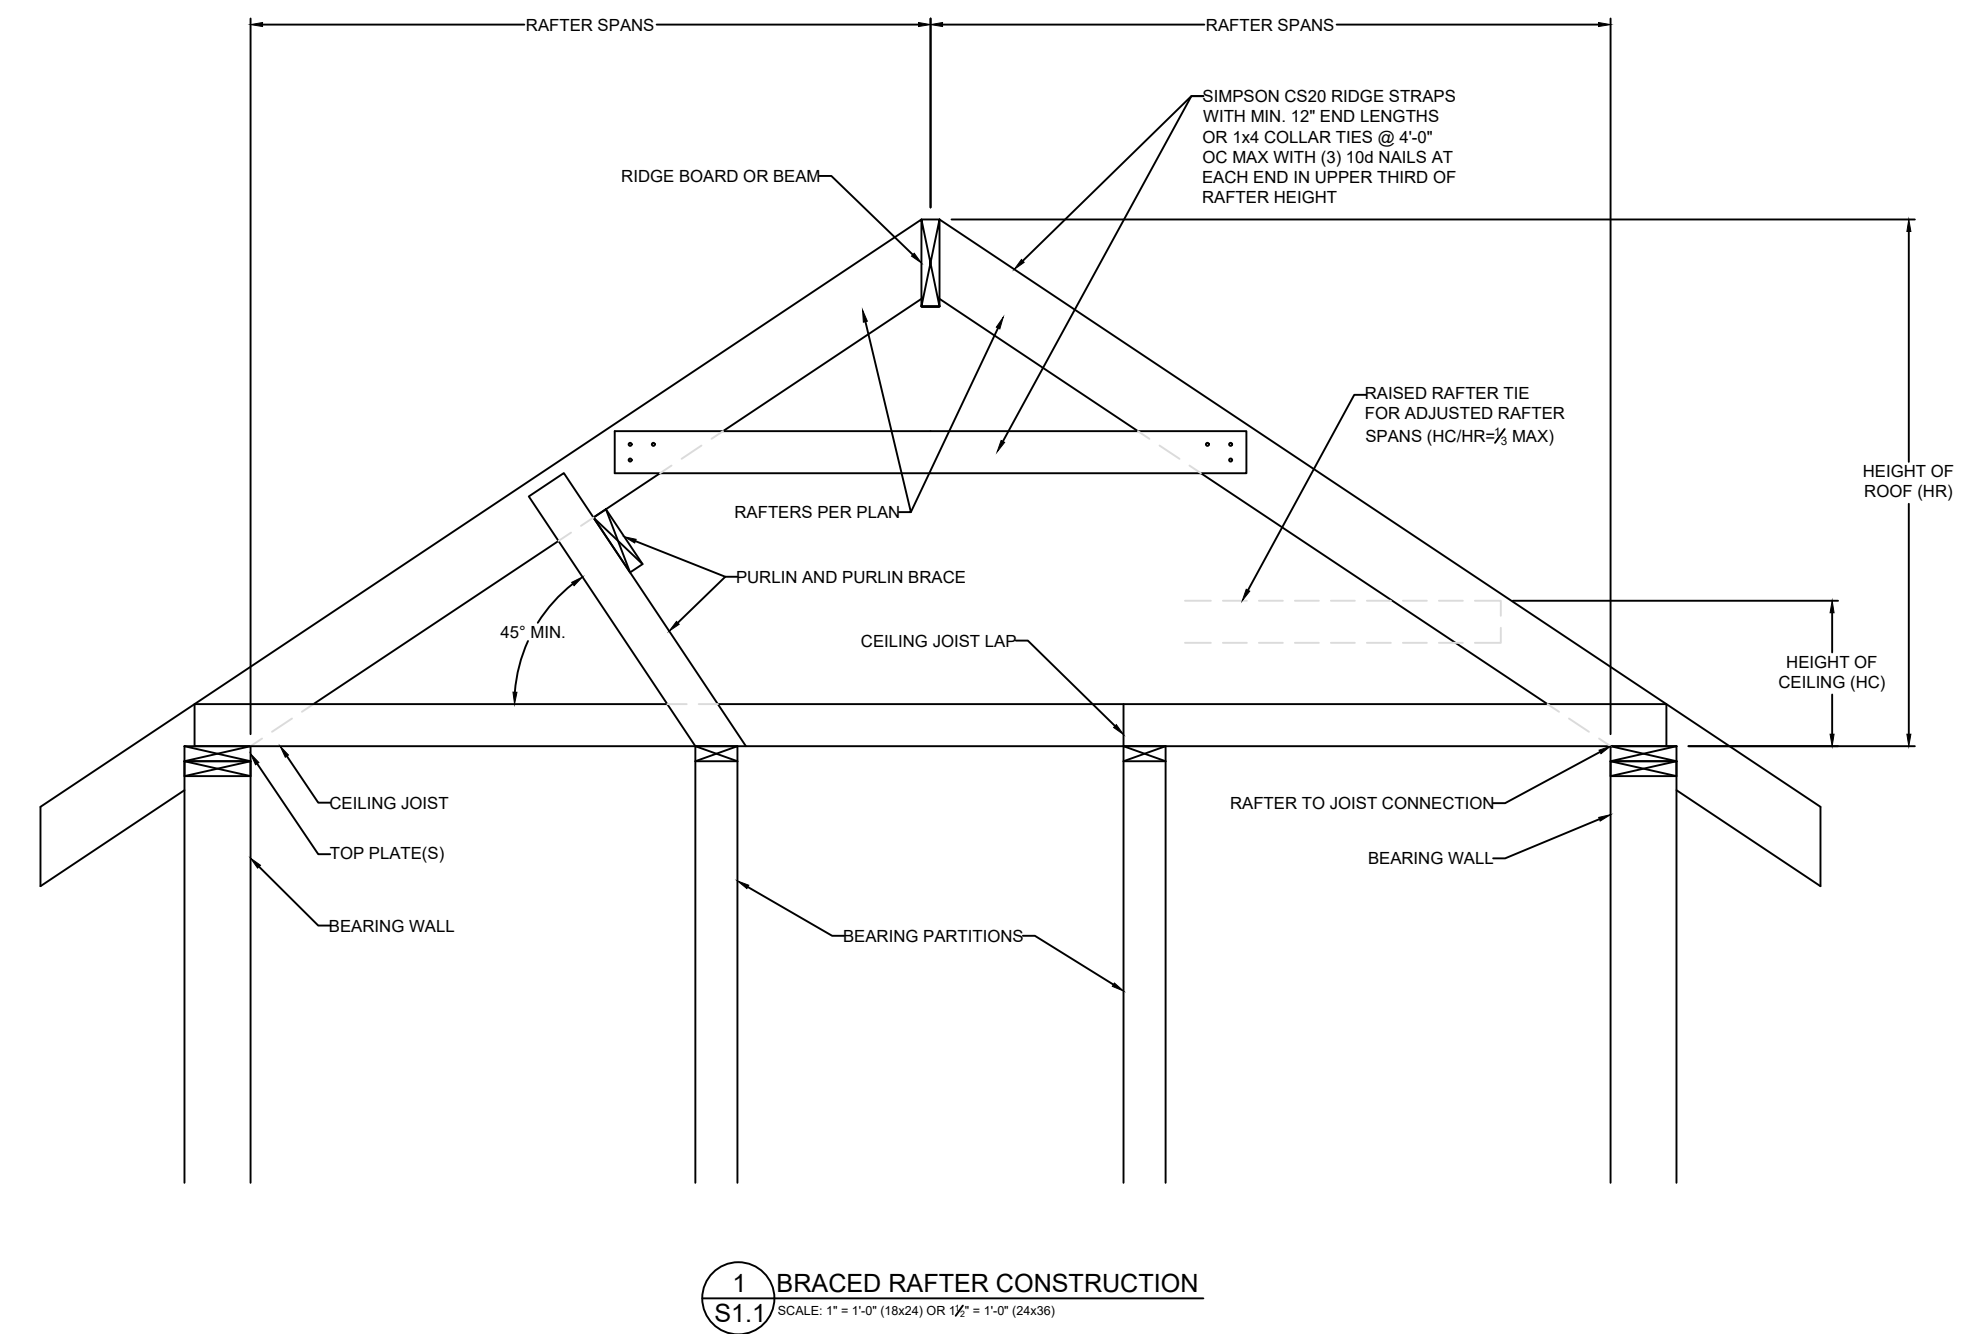

1 BRACED RAFTER CONSTRUCTION
 SCALE: 1" = 1'-0" (1/8" = 1'-0" OR 1/4" = 1'-0")

Combustion Air Calculation

Per 2012 IRC Section G2407.5

Appliance #1	Furnace	100000	BTU/h
Appliance #2			BTU/h
Appliance #3	Water Heater	50000	BTU/h
Total BTU/hr		150000	BTU/h

Area of Combined Space (floor where appliances are located)	677	ft ²
Ceiling Height in Usable Space	8.5	ft

Note: Per 2012 IRC Section G2407.5.3.2, The volumes of spaces in different stories shall be considered as communicating spaces where such spaces are connected by one or more openings in doors or floors having a total minimum free area of 2 square inches per 1,000 BTU/h of total input rating of all appliances

Is floor where appliances are located open to adjacent level?	Yes
If Yes, what is the area of open space adjacent to appliance area?	390

Per 2012 IRC Section G2407.5.1 (Standard Method), the minimum required volume shall be 50 cubic feet per 1,000 BTU/hr (Total BTU/hr / 1,000 BTU/hr x 50 ft³)

Required air space in combined areas:	7500	ft ³
---------------------------------------	------	-----------------

Required combined area:	882	ft ²
-------------------------	-----	-----------------

Area of Combined Space > Required combined area?	OK
--	----

Per Section G2407.5.3.1, each opening shall have a minimum free area of 1 square inch per 1,000 BTU/hr of the total input rating of all appliances in the space, but not less than 100 square inches. One opening shall commence within 12 inches of the top and one opening shall commence within 12 inches of the bottom of the enclosure. The minimum dimension of air openings shall be not less than 3 inches.

Minimum required opening area:	150	in ²
Minimum grill size:	14 x 11	(inches)
Note: two grills required - one within 12" of floor, one within 12" of clg.		

VISTA
 ENGINEERING, LLC
 14718 NW DELIA STREET * PORTLAND, OREGON 97129
 OFFICE: 971.255.6099 * MOBILE: 971.255.6099 *
 * DENNIS@VISTASTRUCTURAL.COM * VISTASTRUCTURAL.COM

CLIENT: IQ HOME BUILDERS
 JOB TITLE: RHF068 SPEC
 LOT 68, THE RETREAT AT HOOK FARMS
 LOCATION: 2026 SW RED BARN LN.
 LEE'S SUMMIT, MISSOURI


STATE OF MISSOURI
 DENNIS HEIER
 NUMBER: PE-201001772
 PROFESSIONAL ENGINEER
 2-7-2022

NO.	DATE	REVISION	BY

DRAWING TITLE
STRUCTURAL CALCULATIONS


ENGINEER: DMH CHECKED BY: DMH
 JOB NO: 4276 DRAWN BY: DMH
 DATE: 02-07-22
 SHEET NUMBER
S1.1

RELEASE FOR CONSTRUCTION AS NOTED ON PLANS Development Services/LEE'S SUMMIT, MISSOURI

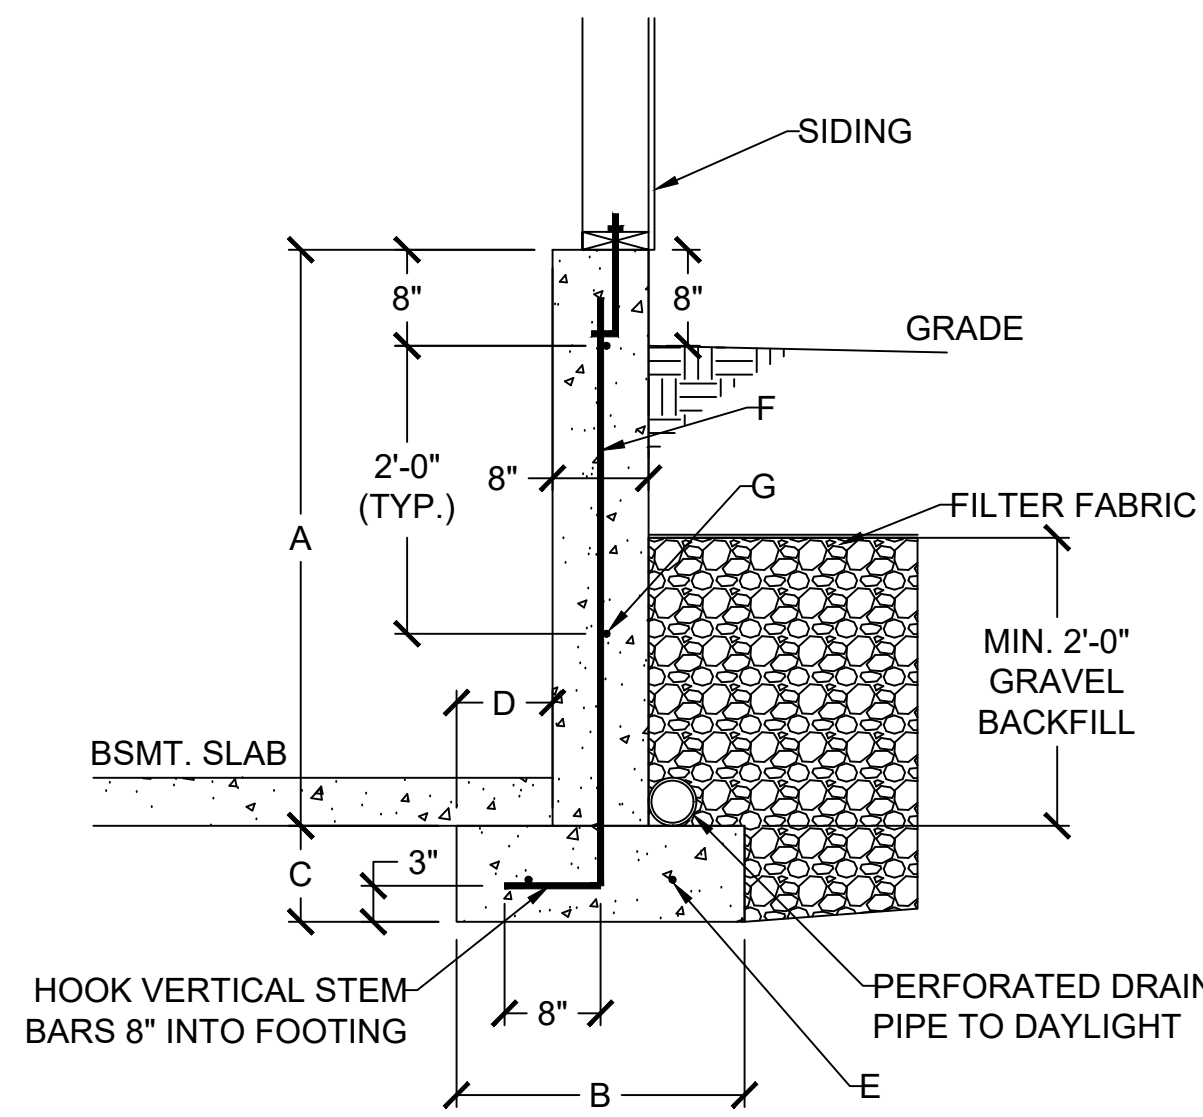


DAYLIGHT BASEMENT WALL SCHEDULE						
A	B	C	D	E	F	G
4'-0"	1'-6"	0'-8"	0'-5"	(2) #4	#4 VERT. @ 12" O.C.	(2) #4 HORIZ.
5'-0"	2'-0"	0'-8"	0'-7"	(2) #4	#4 VERT. @ 12" O.C.	(3) #4 HORIZ.
6'-0"	2'-6"	0'-8"	0'-10"	(3) #4	#4 VERT. @ 12" O.C.	(3) #4 HORIZ.


1 DAYLIGHT WALL CONSTRUCTION
S2.0 SCALE: 1/2" = 1'-0" (18x24) OR 3/4" = 1'-0" (24x36)

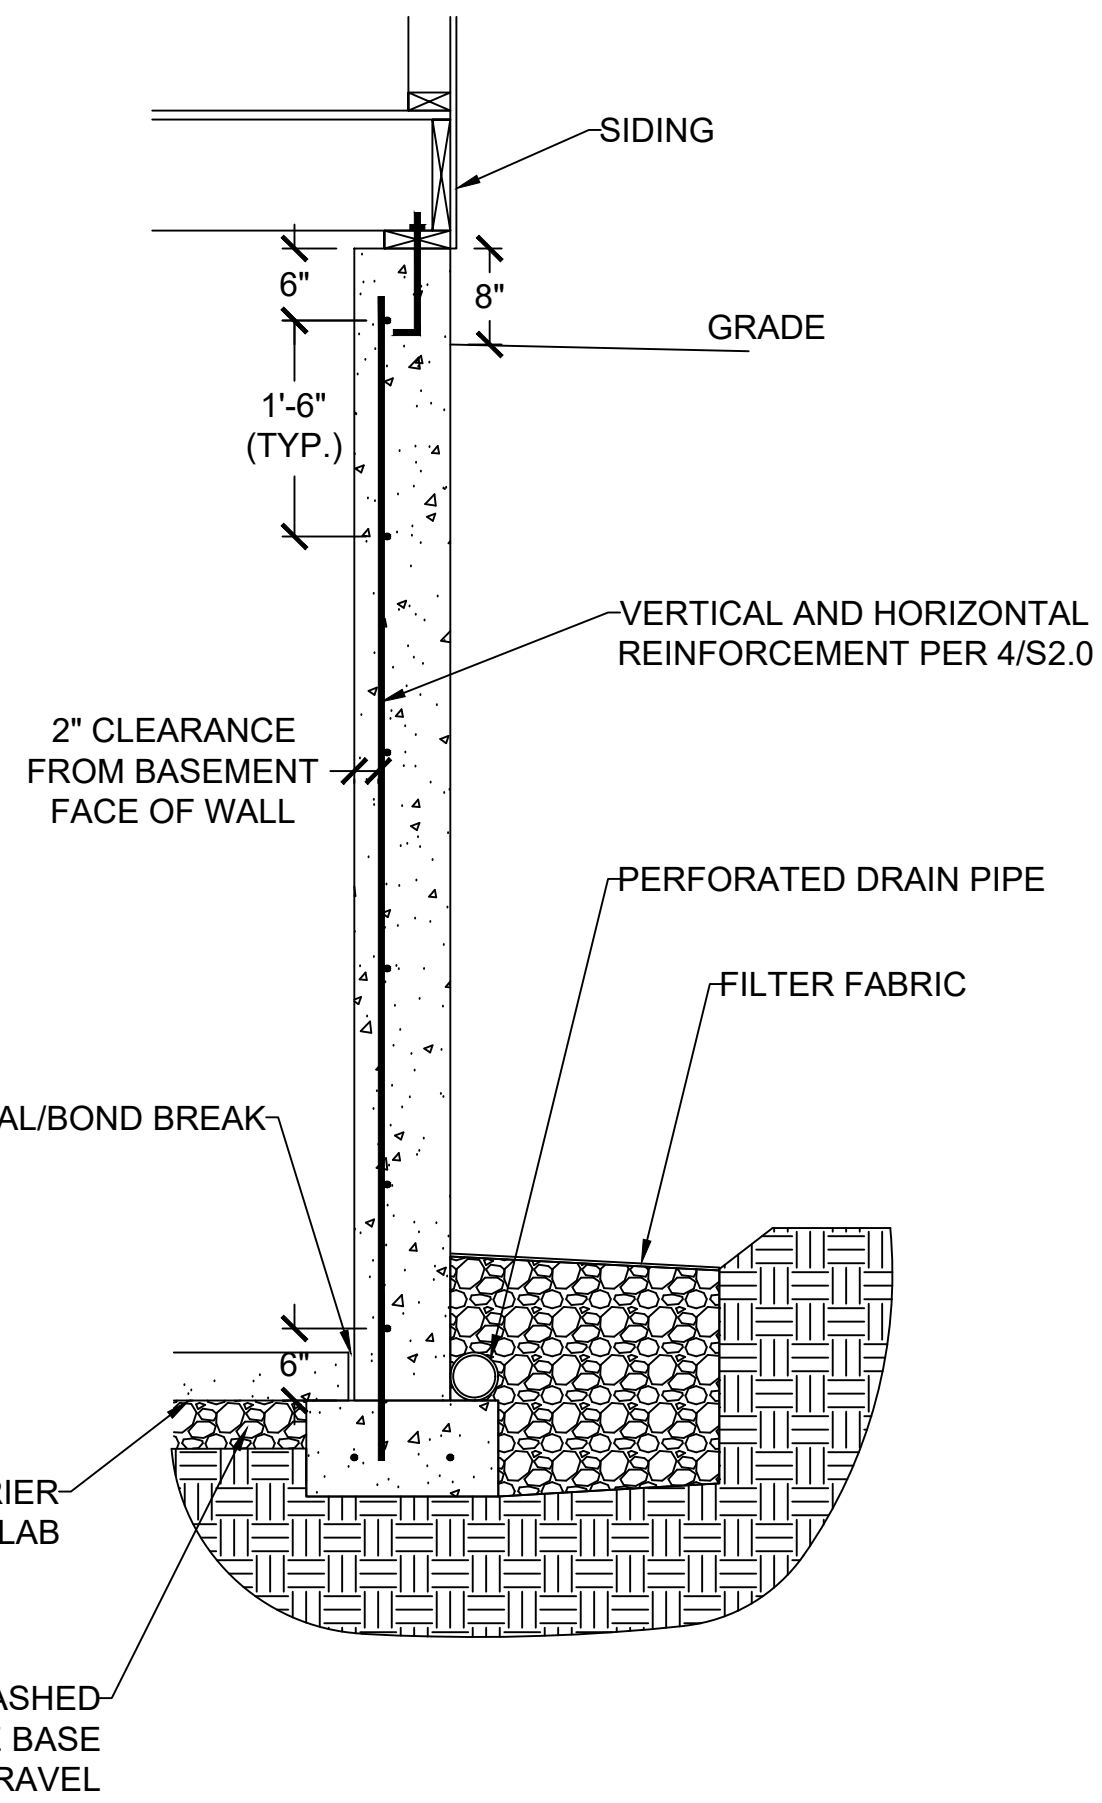


3 CONCRETE WALL SECTION
S2.0 SCALE: 1/2" = 1'-0" (18x24) OR 3/4" = 1'-0" (24x36)

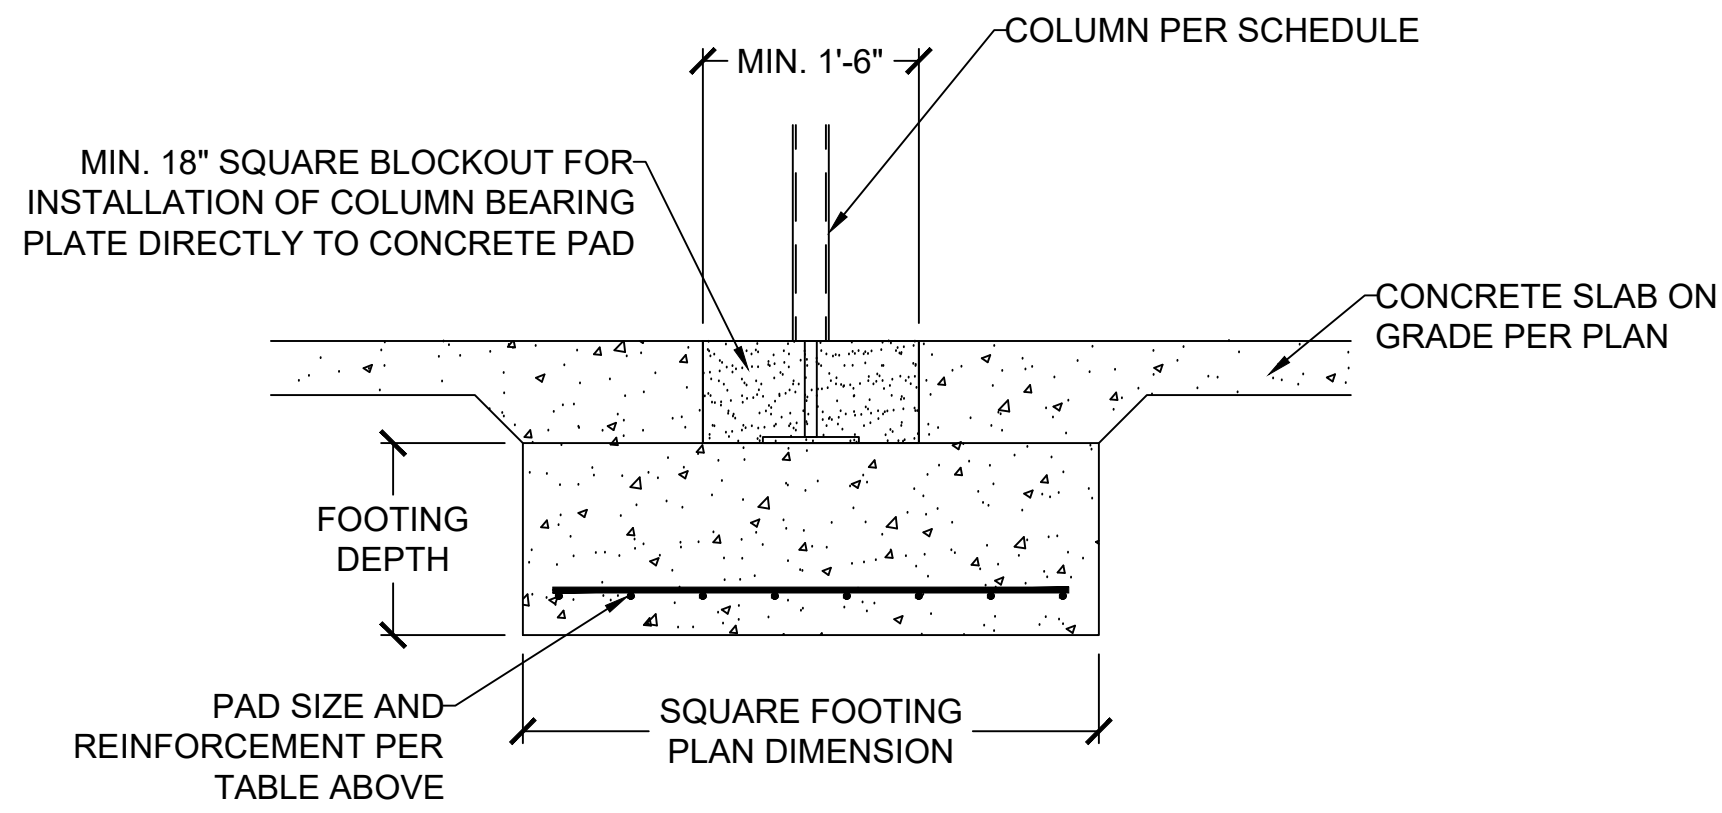

2 COLUMN AND BEARING PAD SCHEDULE
S2.0 SCALE: 1/2" = 1'-0" (18x24) OR 3/4" = 1'-0" (24x36)

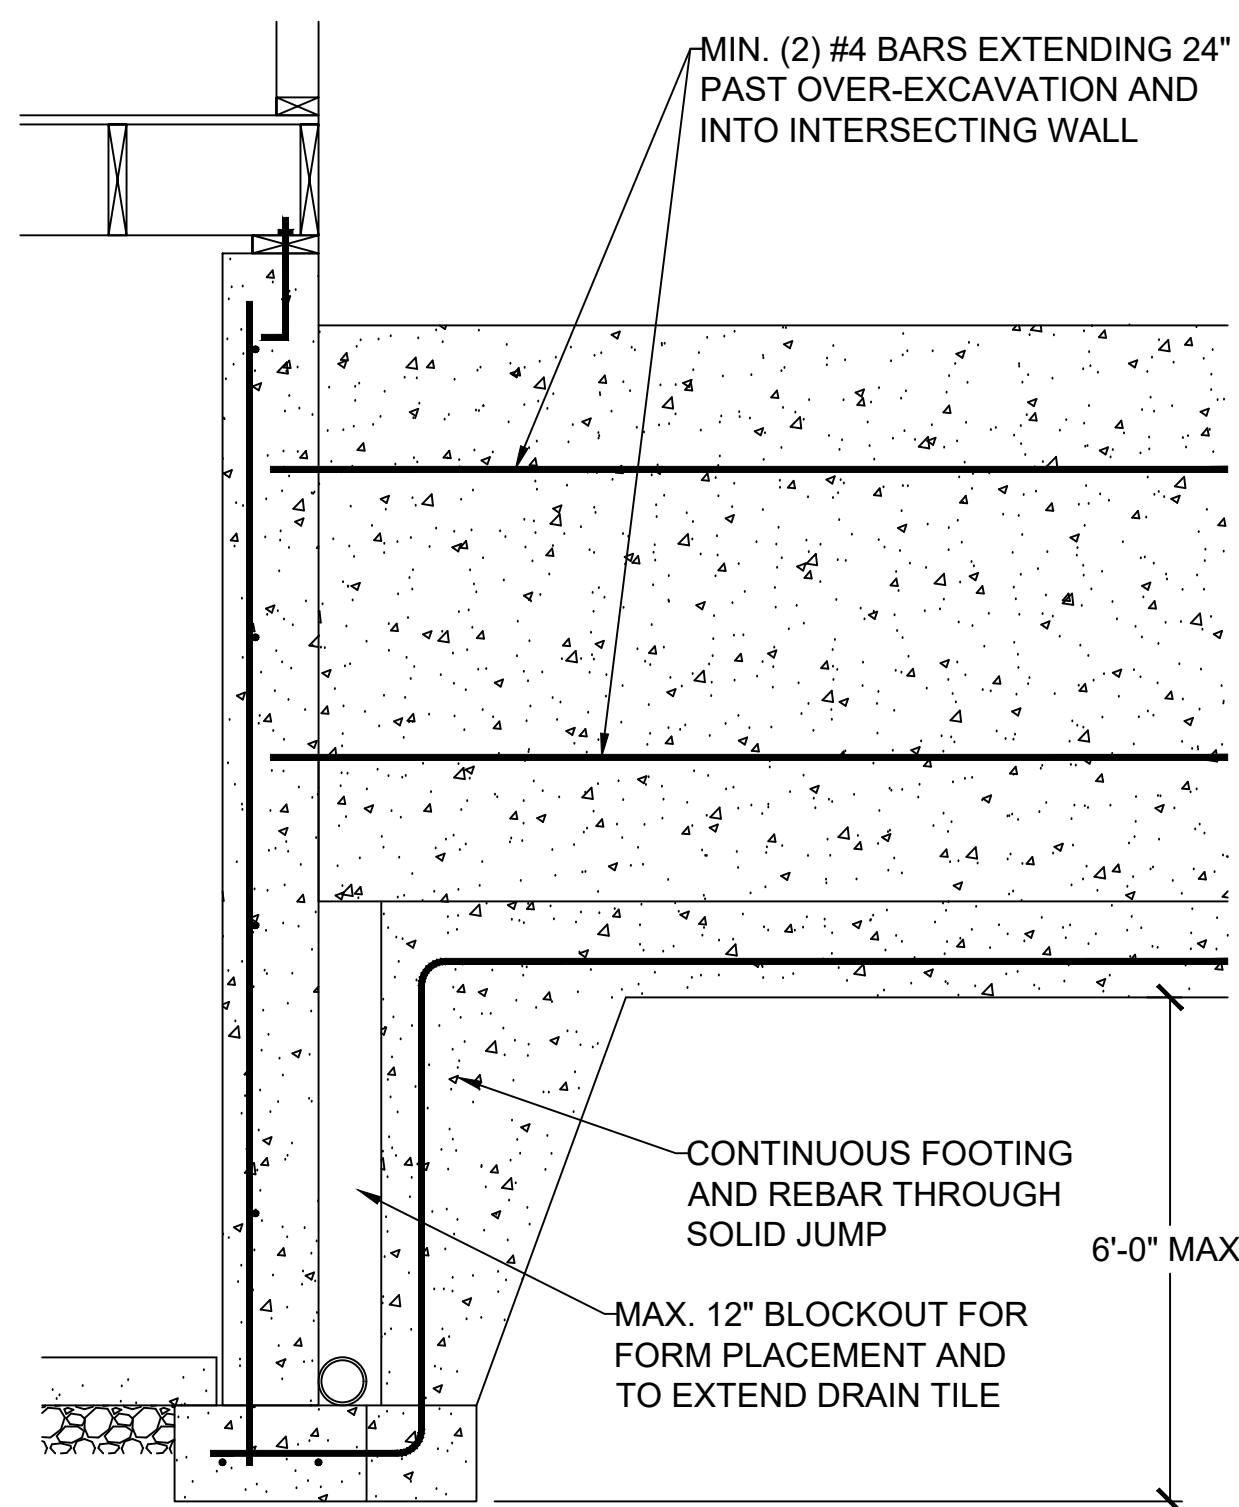


5 SOLID JUMP
S2.0 SCALE: 1/2" = 1'-0" (18x24) OR 3/4" = 1'-0" (24x36)

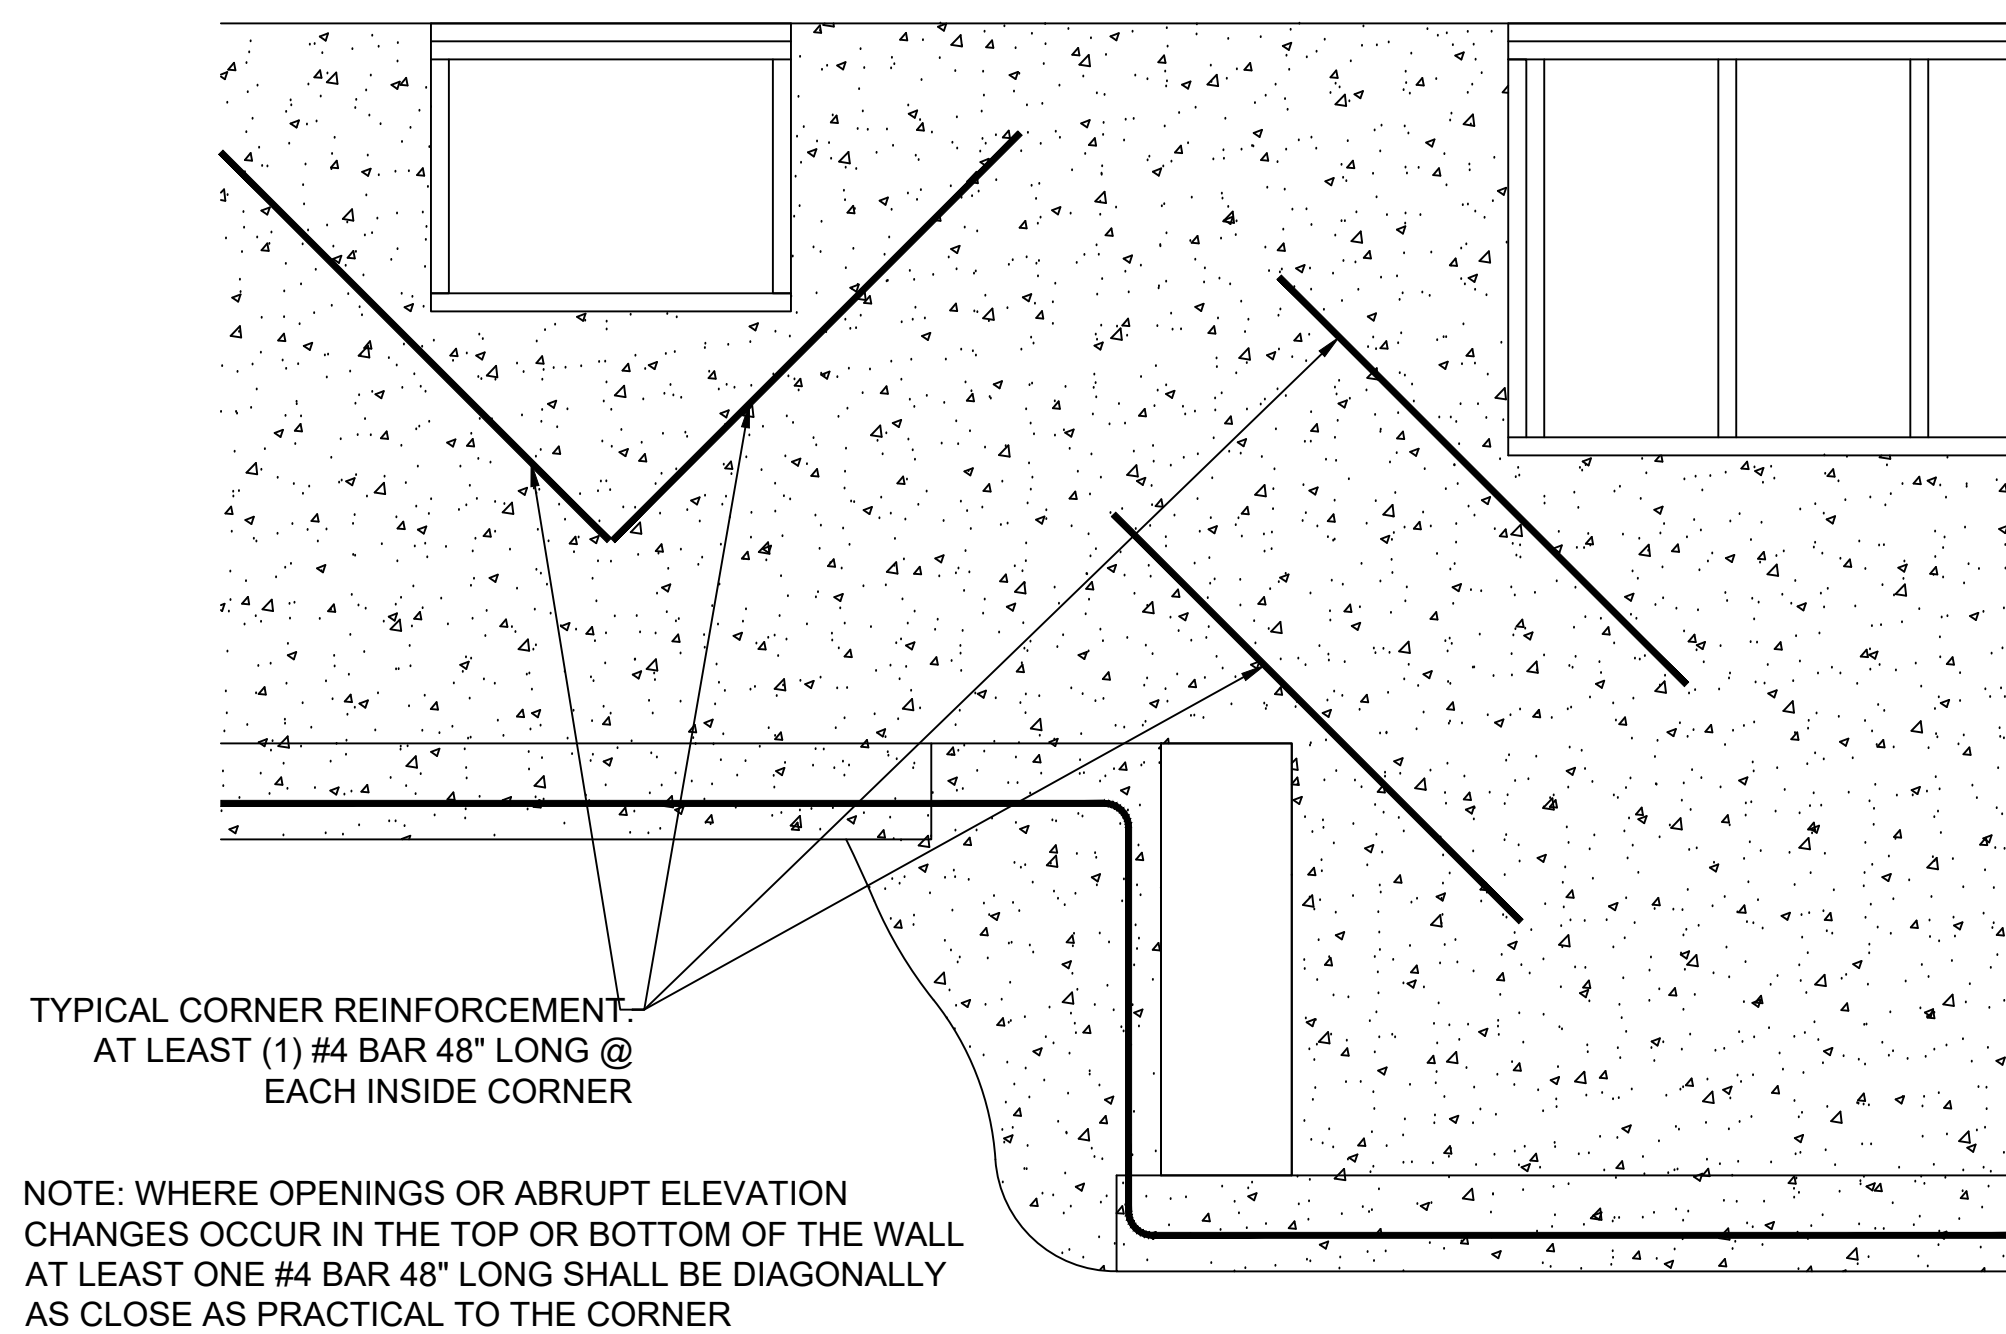

6 REINFORCEMENT AT OPENING CORNERS AND STEP CORNERS @ INSIDE CORNERS
S2.0 SCALE: 1/2" = 1'-0" (18x24) OR 3/4" = 1'-0" (24x36)

NOTE: WHERE FLOOR JOIST RUNS PARALLEL TO FDN WALL, SOLID BLOCK OUTSIDE 3 JOIST SPACES @ 36" OC ALIGNING BLOCKING WITH THE ANCHOR BOLT

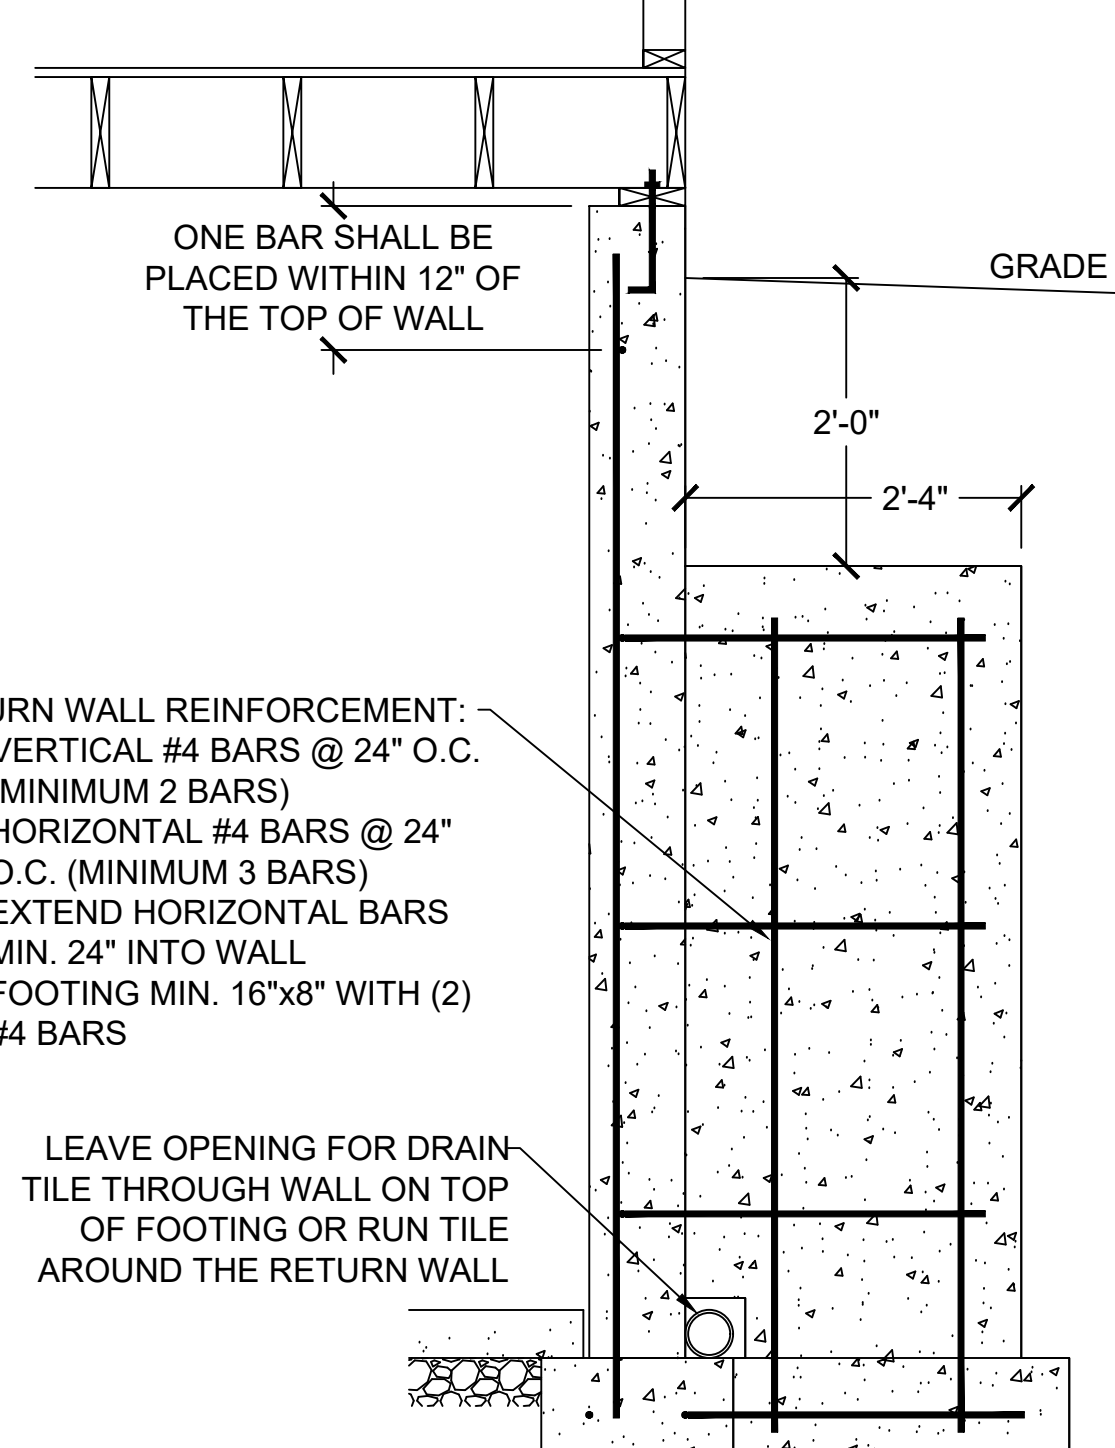

- RETURN WALL REINFORCEMENT:
- VERTICAL #4 BARS @ 24" O.C. (MINIMUM 2 BARS)
 - HORIZONTAL #4 BARS @ 24" O.C. (MINIMUM 3 BARS)
 - EXTEND HORIZONTAL BARS MIN. 24" INTO WALL
 - FOOTING MIN. 16"x8" WITH (2) #4 BARS

LEAVE OPENING FOR DRAIN TILE THROUGH WALL ON TOP OF FOOTING OR RUN TILE AROUND THE RETURN WALL


7 RETURN WALL DETAIL
S2.0 SCALE: 1/2" = 1'-0" (18x24) OR 3/4" = 1'-0" (24x36)

CONCRETE STRENGTH/GRADE REINFORCEMENT (#4 BARS)	8" THICK WALL			10" THICK WALL		
	8'	9'	10'	8'	9'	10'
3,000 PSI/ GRADE 40	24	24	16	24	24	18
3,500 PSI/ GRADE 40	24	24	16	24	24	18
3,000 PSI/ GRADE 60	24	24	16	24	24	18
3,500 PSI/ GRADE 60	24	24	16	24	24	18

HORIZONTAL REINFORCEMENT - MINIMUM GRADE 40 STEEL						
ONE BAR 12" FROM TOP OF WALL; MAX. SPACING 24" OC	6-#4	7-#4	7-#4	6-#4	7-#4	7-#4

- FOOTNOTES:
- 1) WALL HEIGHT IS MEASURED FROM THE TOP OF THE WALL TO THE TOP OF THE FLOOR SLAB
 - 2) VERTICAL REINFORCEMENT FOR CONCRETE WALLS THAT ARE NOT FULL HEIGHT, AND FOR REINFORCEMENT SPACING 24" OC, REINFORCEMENT MAY BE PLACED IN THE MIDDLE OF THE WALL. OTHER WALLS SHALL HAVE VERTICAL REINFORCEMENT AS FOLLOWS:
 - A) 8" WALL - MINIMUM 5" FROM THE OUTSIDE FACE
 - B) 10" WALL - MINIMUM 6 1/2" FROM THE OUTSIDE FACE
 - C) EXTEND BARS TO WITHIN 8" OF THE TOP OF THE WALL
 - 3) REINFORCEMENT CLEARANCES:
 - A) CONCRETE EXPOSED TO EARTH - MINIMUM 1 1/2"
 - B) NOT EXPOSED TO WEATHER (INTERIOR SIDE OF WALLS) - 3/4"
 - C) CONCRETE EXPOSED TO WEATHER (TOP CLEARANCE IN GARAGE AND DRIVEWAY SLABS) - 1 1/2"
 - 4) HORIZONTAL REINFORCEMENT:
 - A) ONE BAR SHALL BE PLACED WITHIN 12" OF THE TOP OF THE WALL
 - B) OTHER BARS SHALL BE EQUALLY SPACED WITH SPACING NOT TO EXCEED 24" OC
 - C) HORIZONTAL BARS SHOULD BE AS CLOSE TO THE TENSION FACE AS POSSIBLE (INTERIOR) AND BEHIND THE VERTICAL REINFORCEMENT (I.E. 2" TOWARD THE INSIDE)
 - D) SUPPLEMENTAL REINFORCEMENT AT CORNERS - PLACE (1) #4 BAR 48" LONG AT 45 DEGREE ANGLE AT CORNERS OF OPENINGS. PLACE REINFORCEMENT WITHIN 6" OF THE EDGE OF INSIDE CORNERS.
 - 5) REINFORCEMENT SHALL BE LAPPED A MINIMUM 24" AT ENDS, SPLICES, AND AROUND CORNERS.
 - 6) AT MASONRY LEDGES THE MINIMUM WALL THICKNESS SHALL BE 3 1/2". LEDGES SHALL NOT EXCEED A DEPTH OF MORE THAN 24" BELOW THE TOP OF THE WALL. FOR WALL THICKNESSES LESS THAN 4" PROVIDE #4 BARS AT MAX. 24" OC TO WITHIN 8" OF THE TOP OF THE WALL.
 - 7) STRAIGHT WALLS MORE THAN 5' TALL AND MORE THAN 16 FEET LONG SHALL BE PROVIDED WITH EXTERIOR BRACED RETURN WALLS. WALL LENGTH SHALL BE MEASURED USING INSIDE THE SHORTEST DIMENSION BETWEEN INTERSECTING WALLS
 - 8) WALL SHALL NOT BE BACKFILLED UNTIL FLOOR SYSTEM AND DIAPHRAGM ARE IN PLACE

4 FOUNDATION WALL REINFORCEMENT TABLE
S2.0 NO SCALE

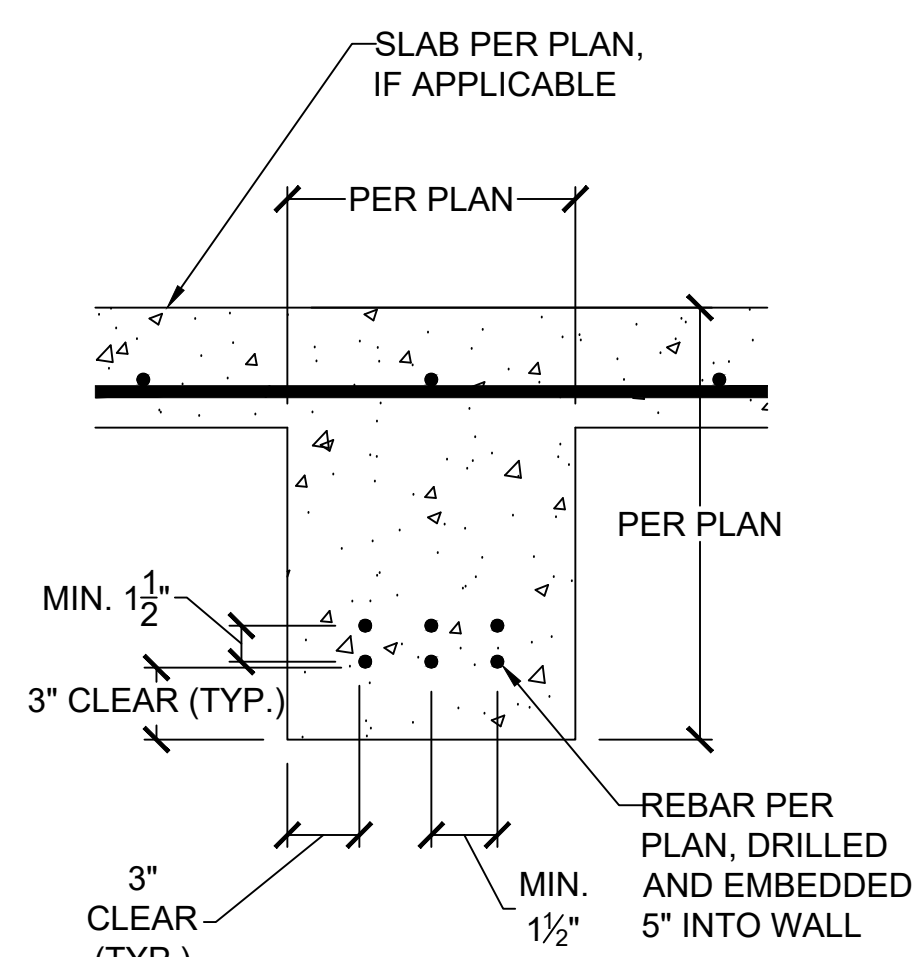

8 CONCRETE GRADE BEAM
S2.0 SCALE: 1" = 1'-0" (18x24) OR 1 1/2" = 1'-0" (24x36)

VISTA
STRUCTURAL ENGINEERING, LLC

14718 NW DELIA STREET * PORTLAND, OREGON 97229
OFFICE: 971.255.6099 * MOBILE: 971.255.6099 *
DENNIS@VISTASTRUCTURAL.COM * VISTASTRUCTURAL.COM

CLIENT: IQ HOME BUILDERS
JOB TITLE: RHF068 SPEC
LOT 68, THE RETREAT AT HOOK FARMS
LOCATION: 2026 SW RED BARN LN.
LEE'S SUMMIT, MISSOURI

STATE OF MISSOURI
DENNIS HEIER
NUMBER: PE-2018001772
PROFESSIONAL ENGINEER
2-7-2022









NO.	DATE	REVISION	BY

DRAWING TITLE
FOUNDATION DETAILS

ENGINEER: DMH CHECKED BY: DMH
JOB NO: 4276 DRAWN BY: DMH
DATE: 02-07-22
SHEET NUMBER

S2.0

RELEASE FOR CONSTRUCTION AS SHOWN ON PLANS. DOCUMENT SETS ONLY. MISSOURI

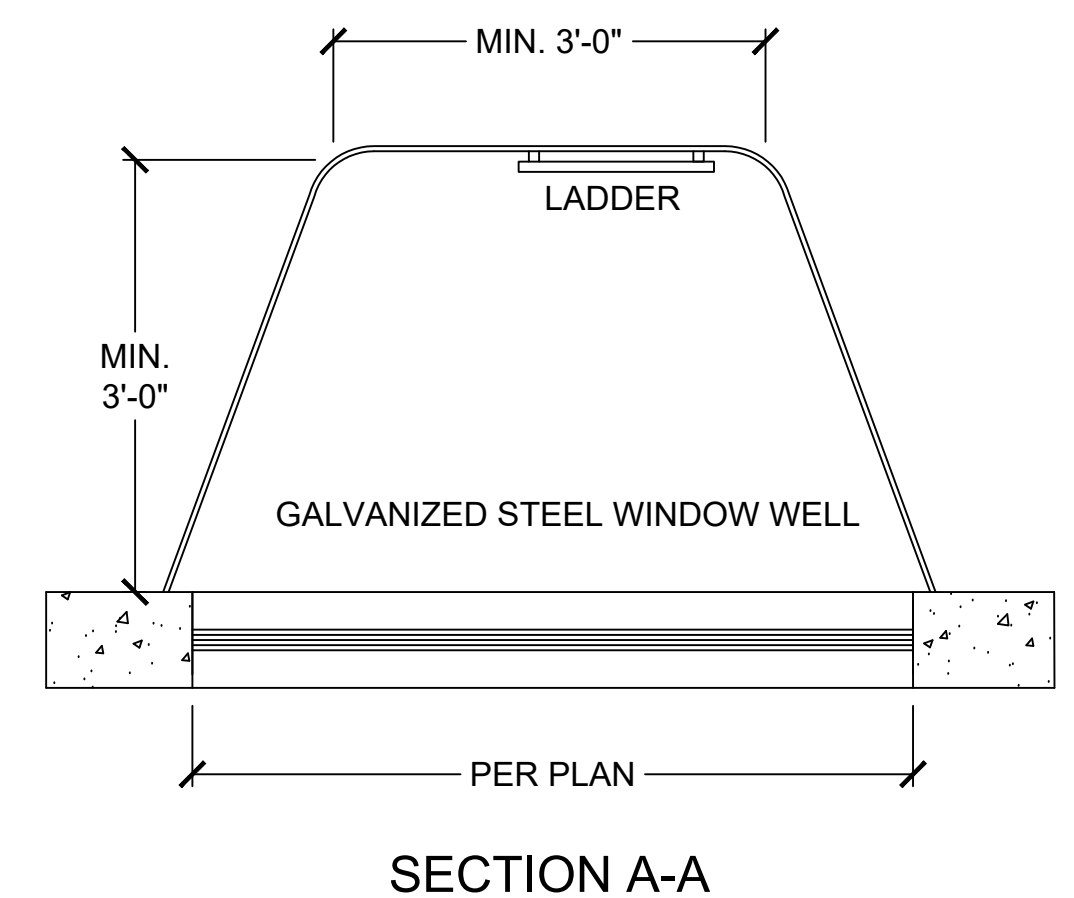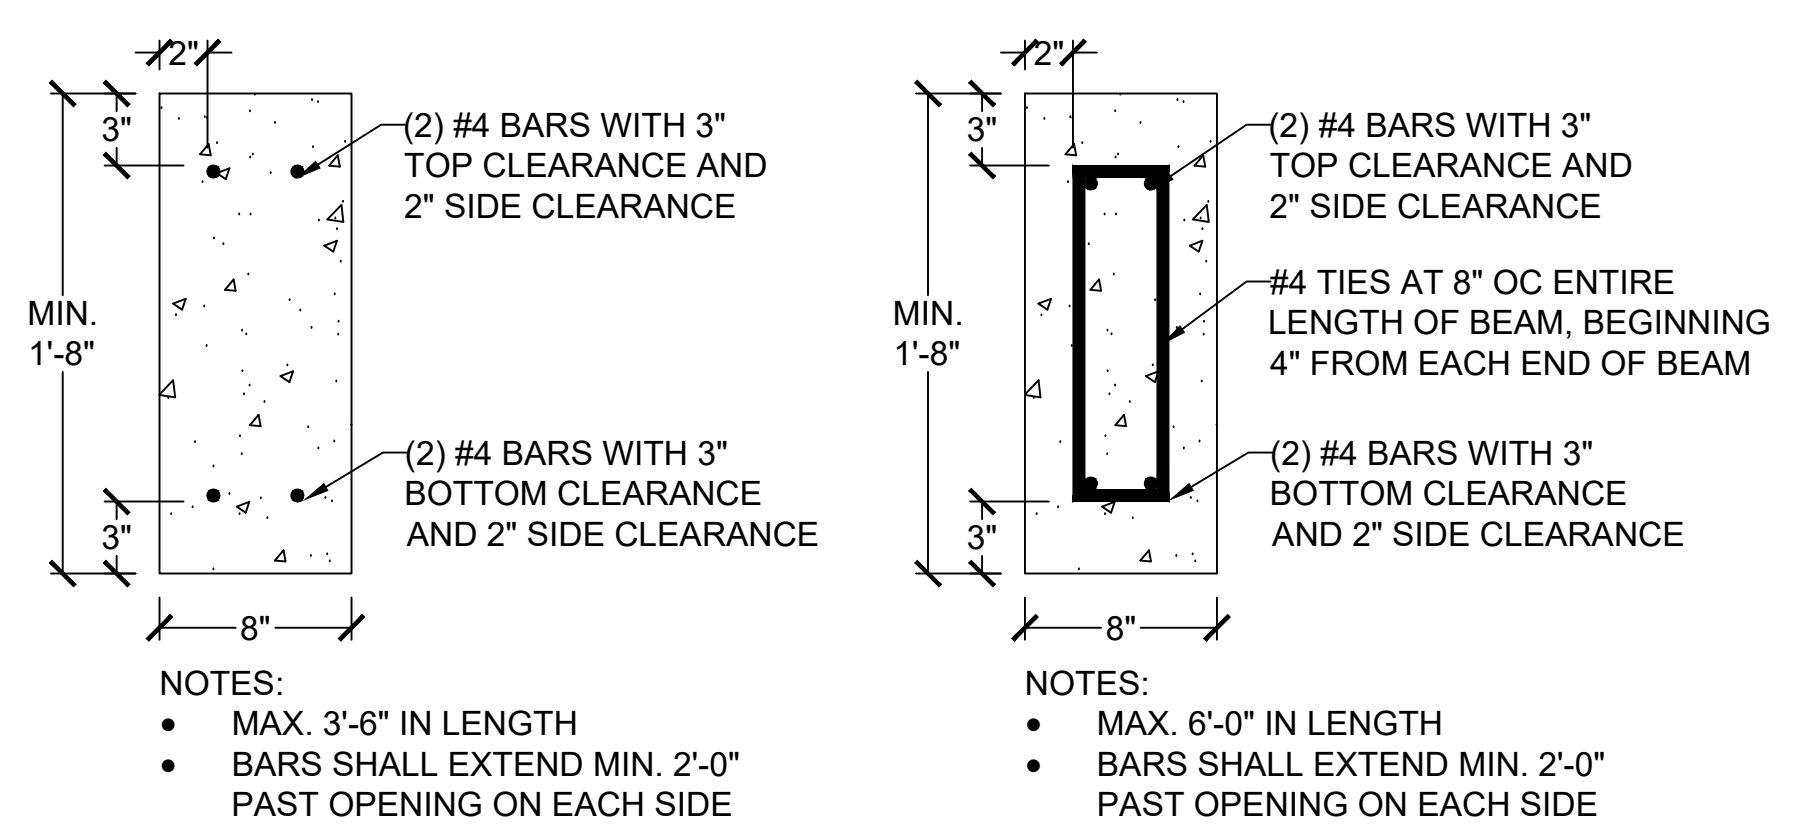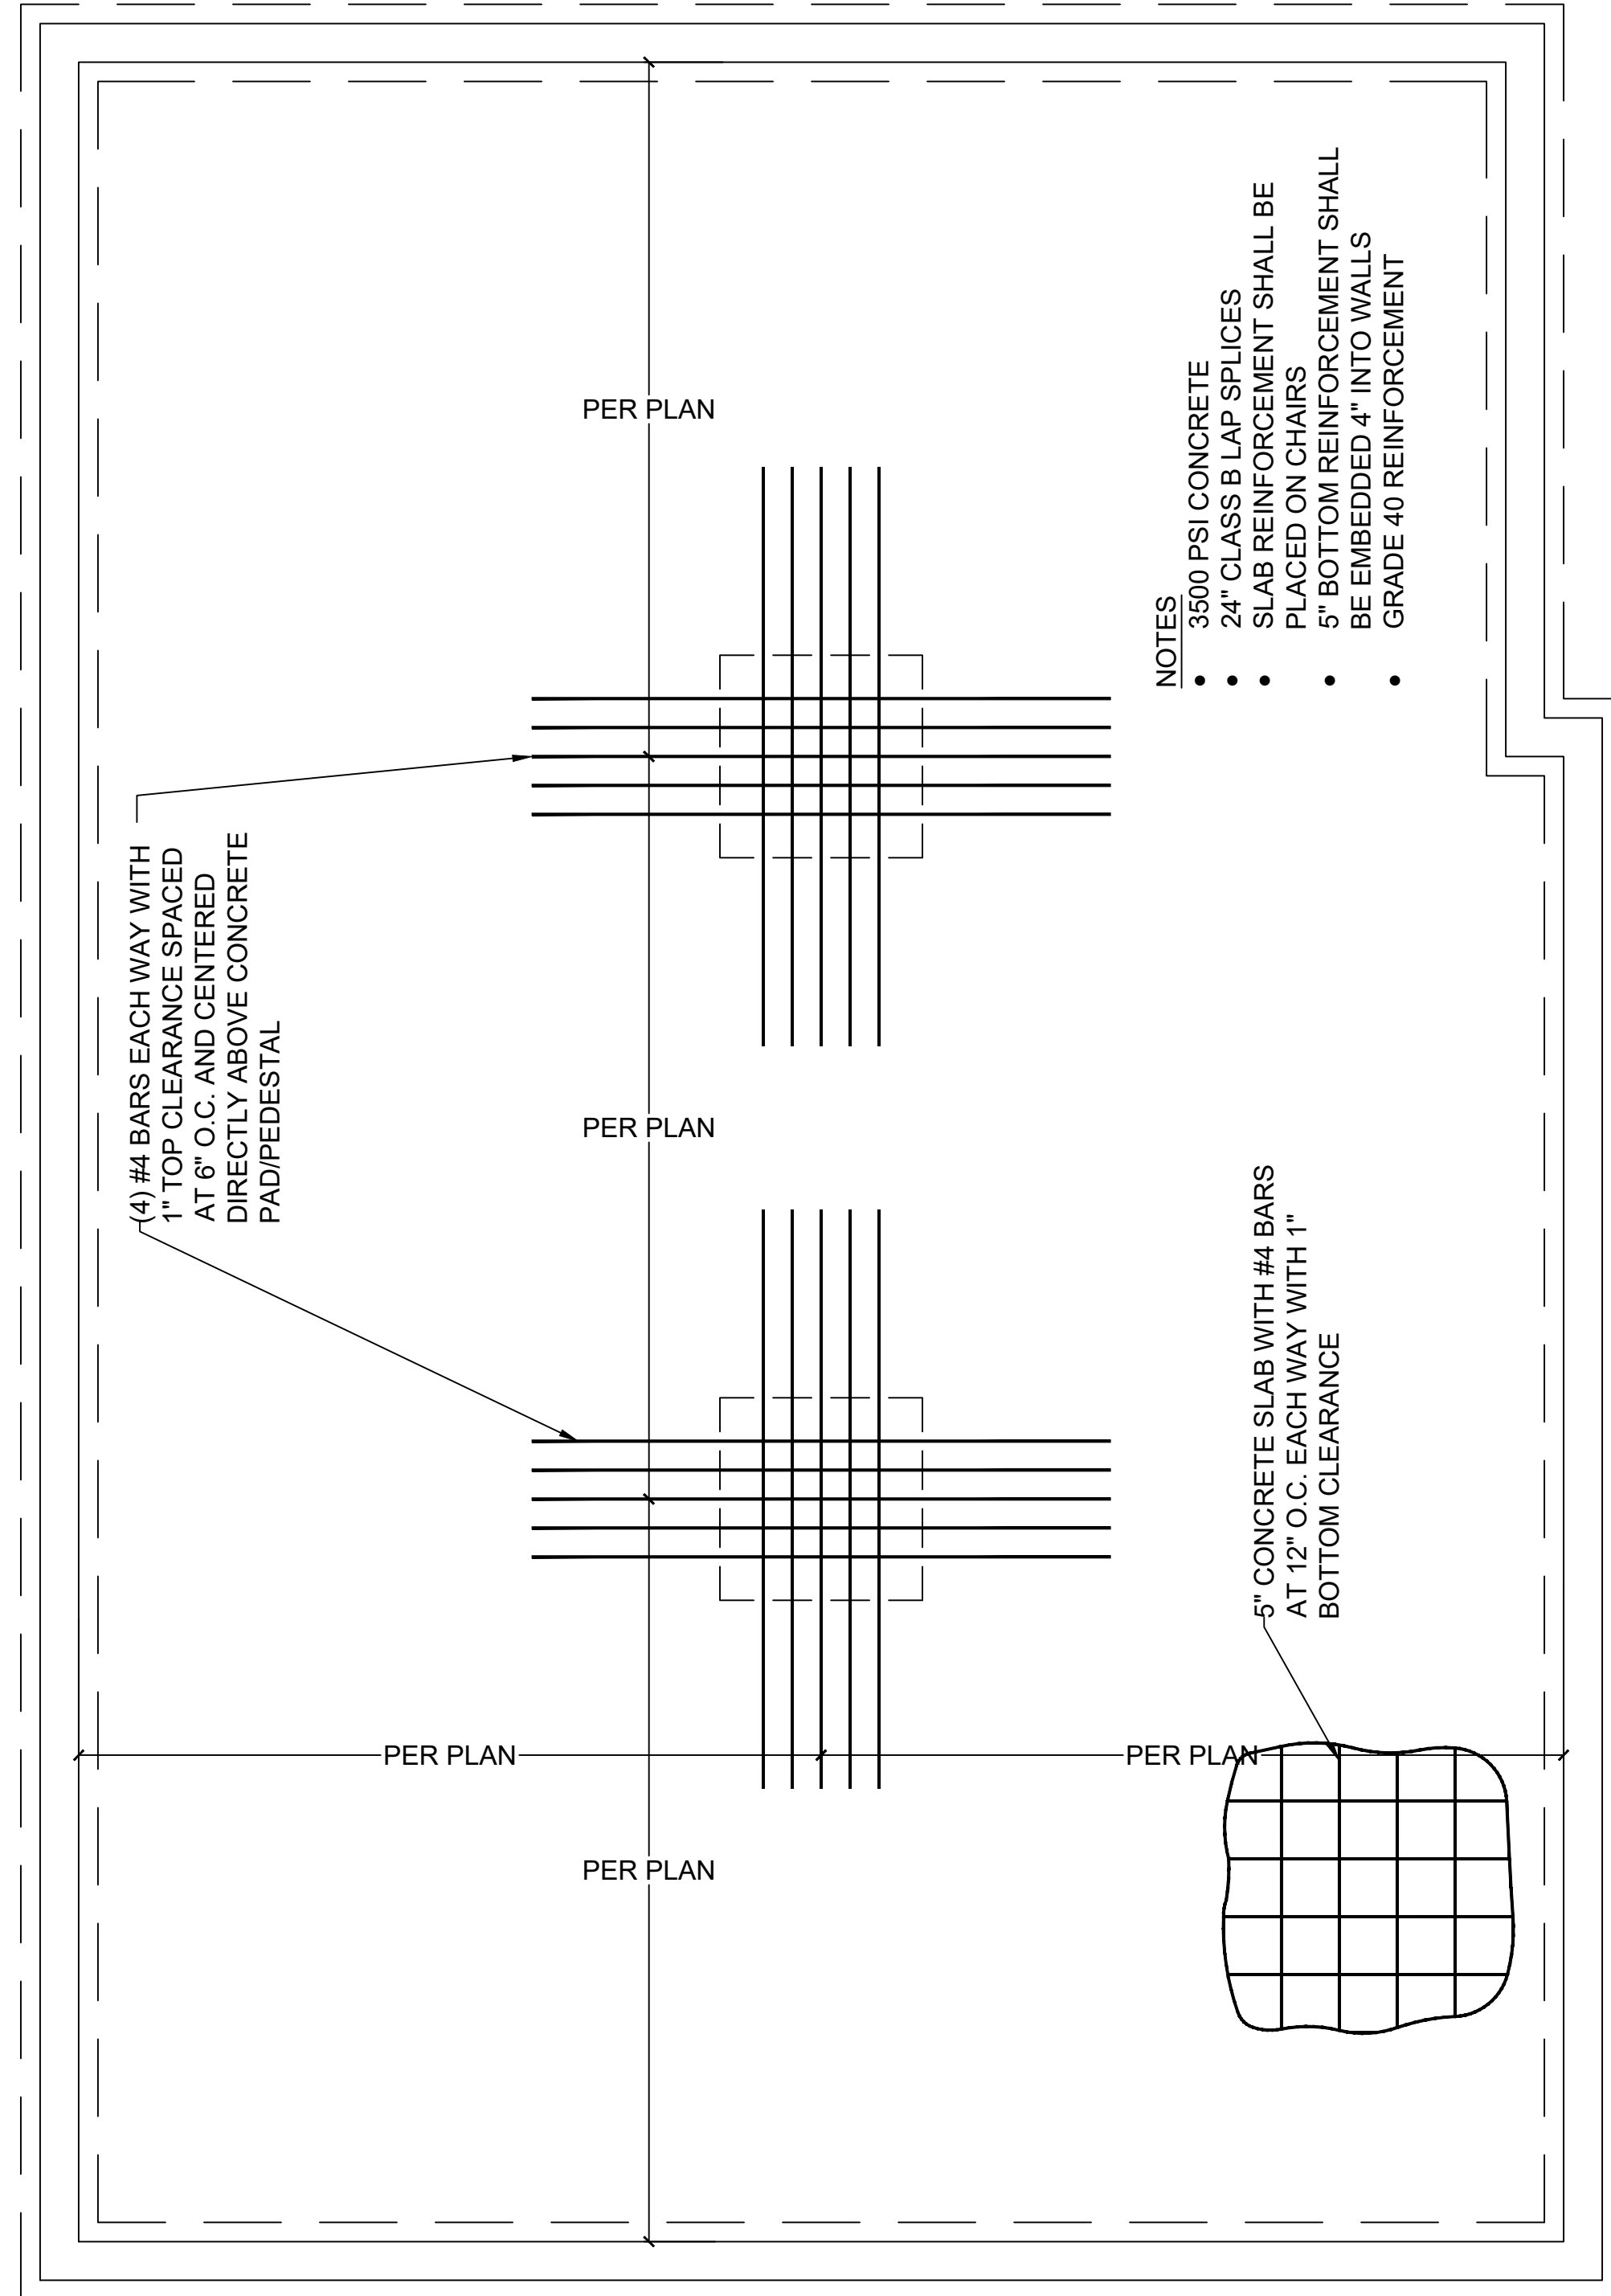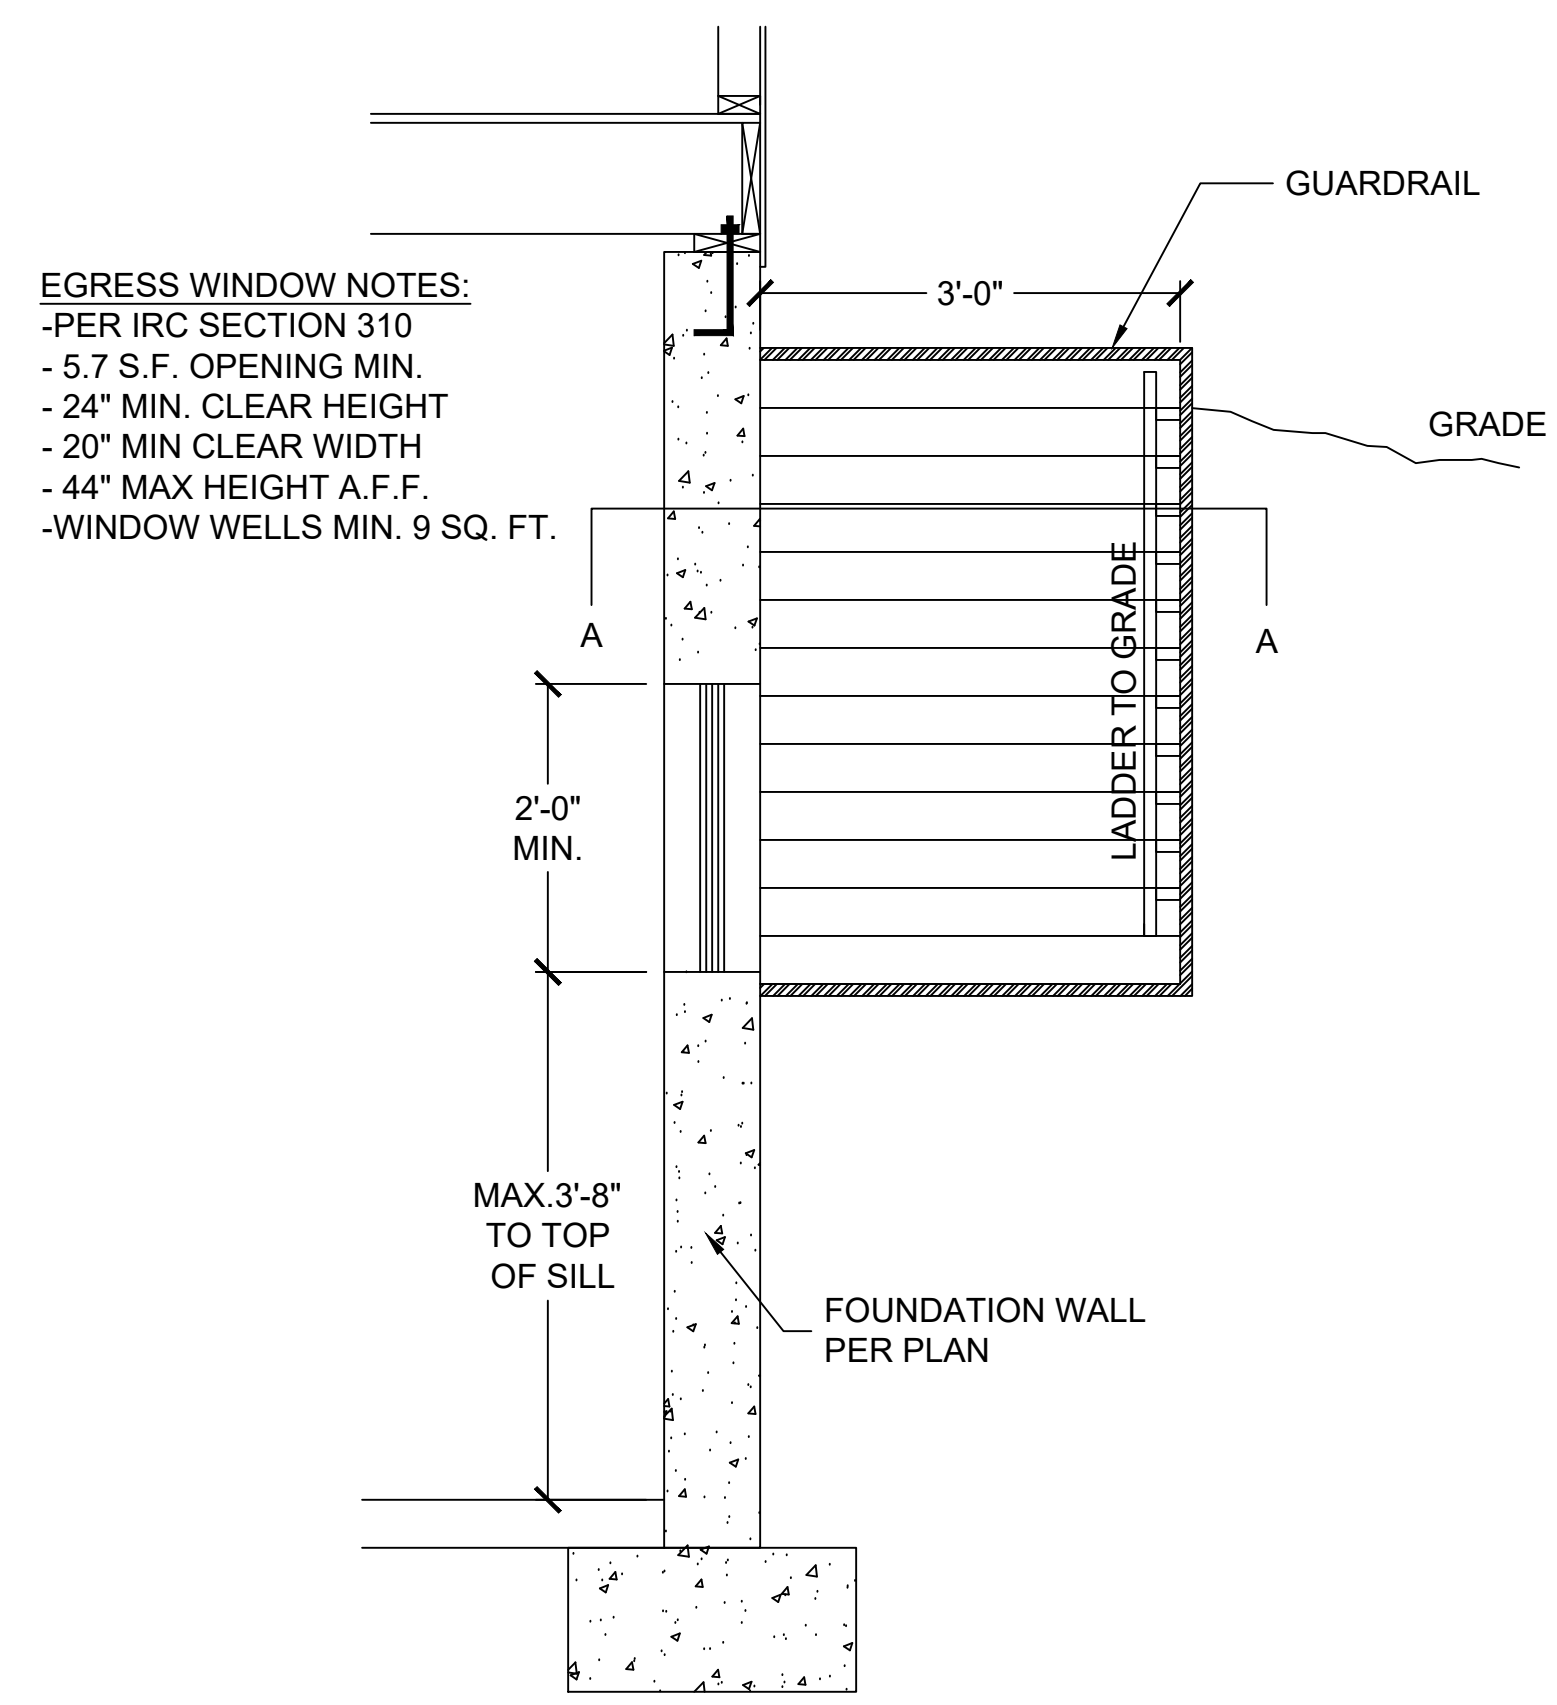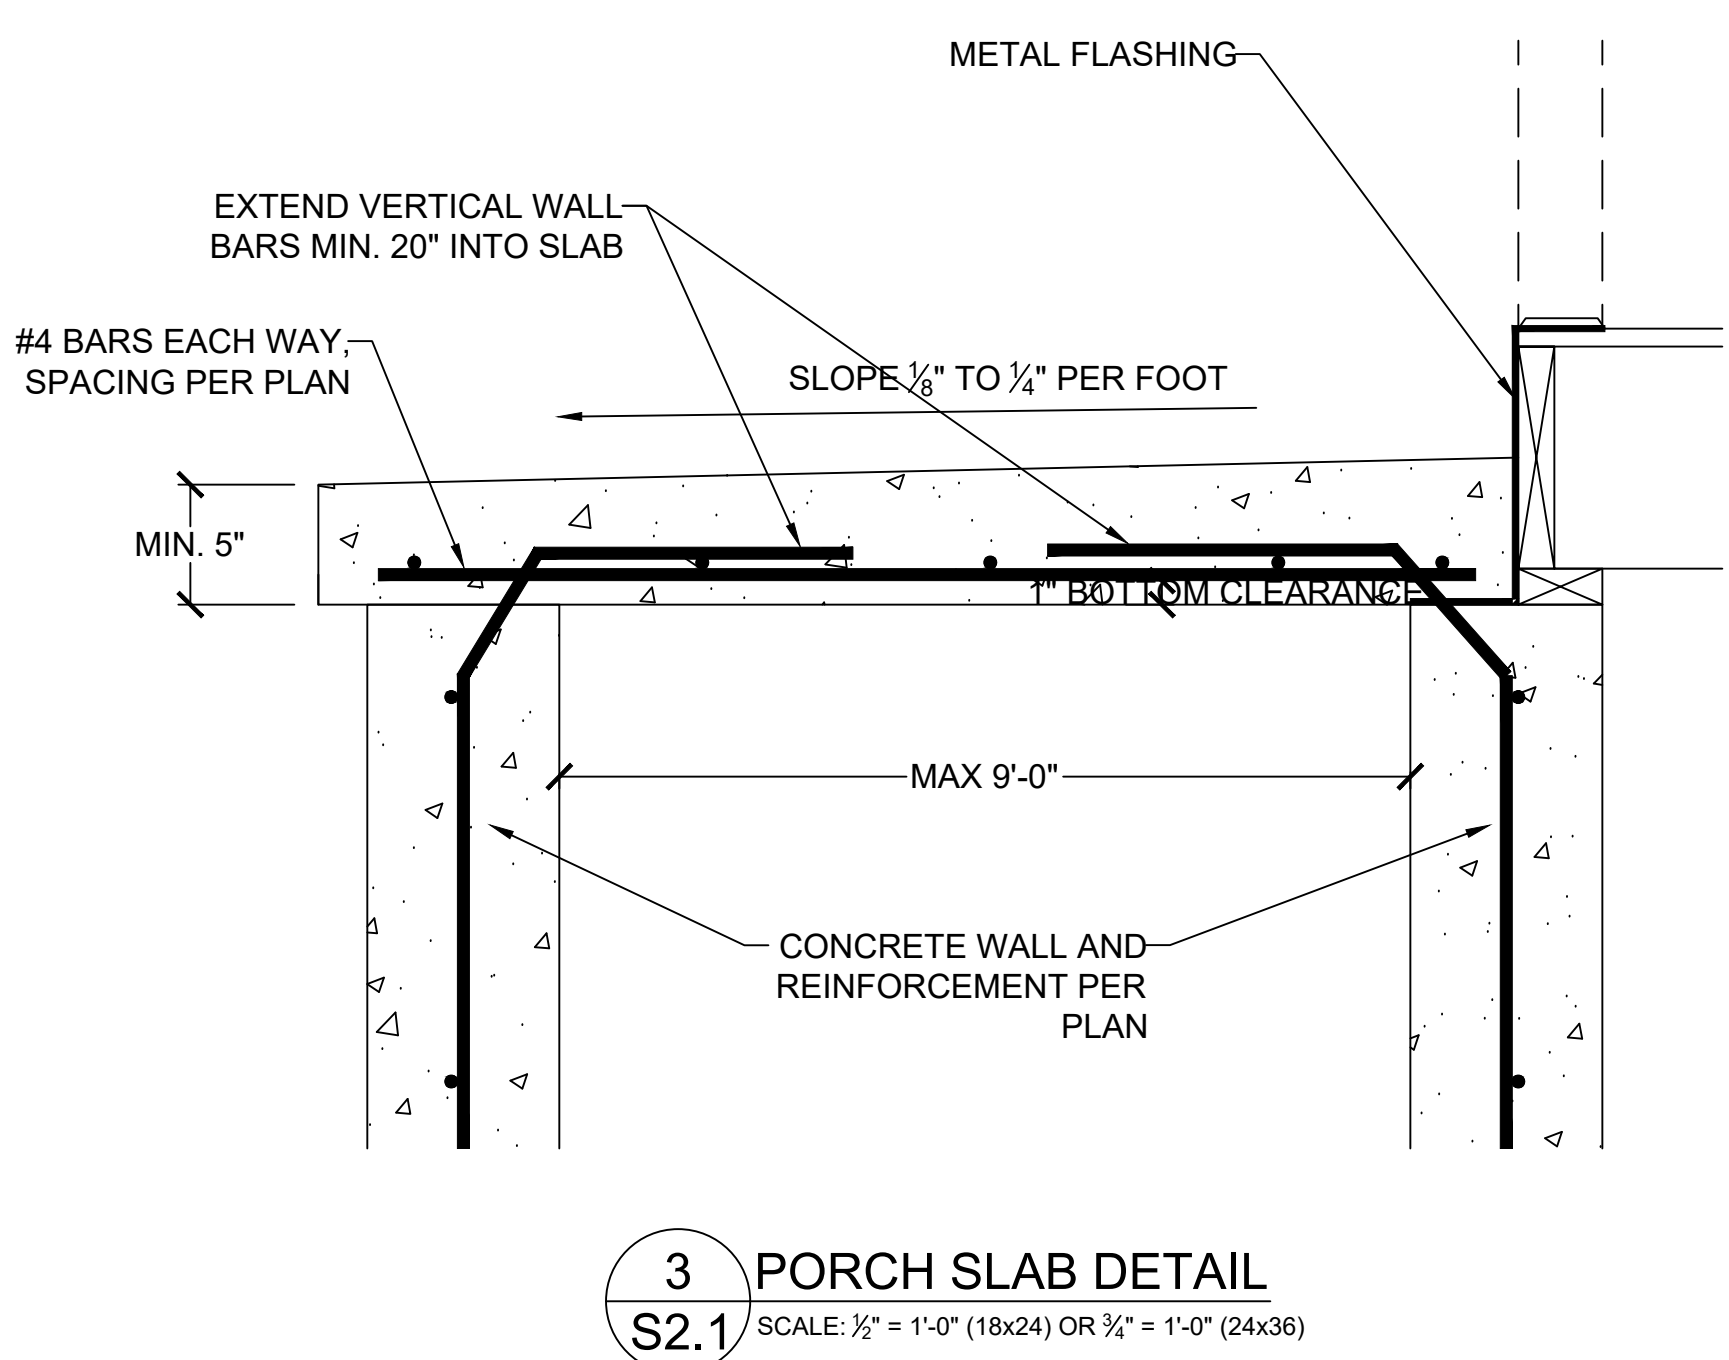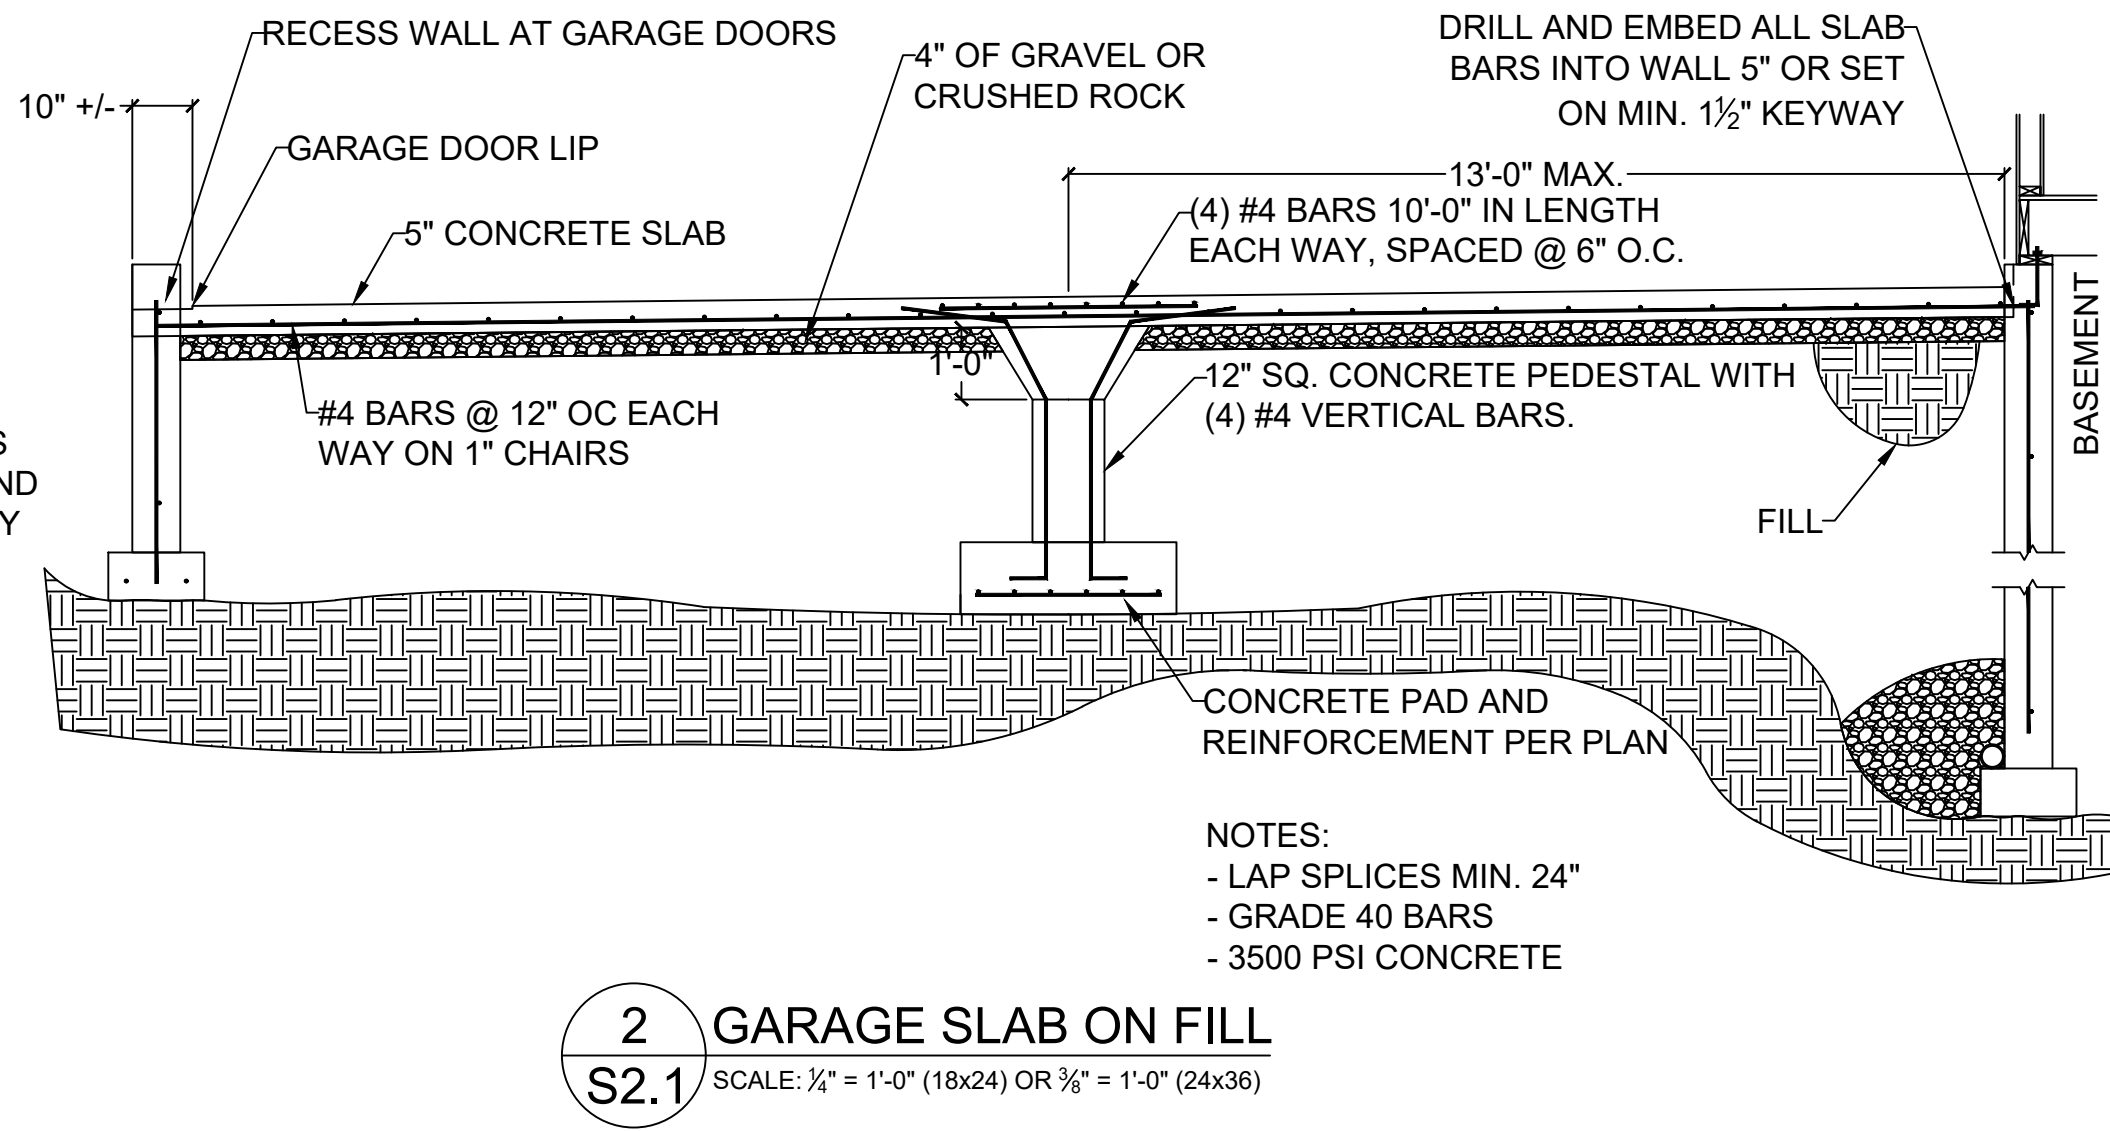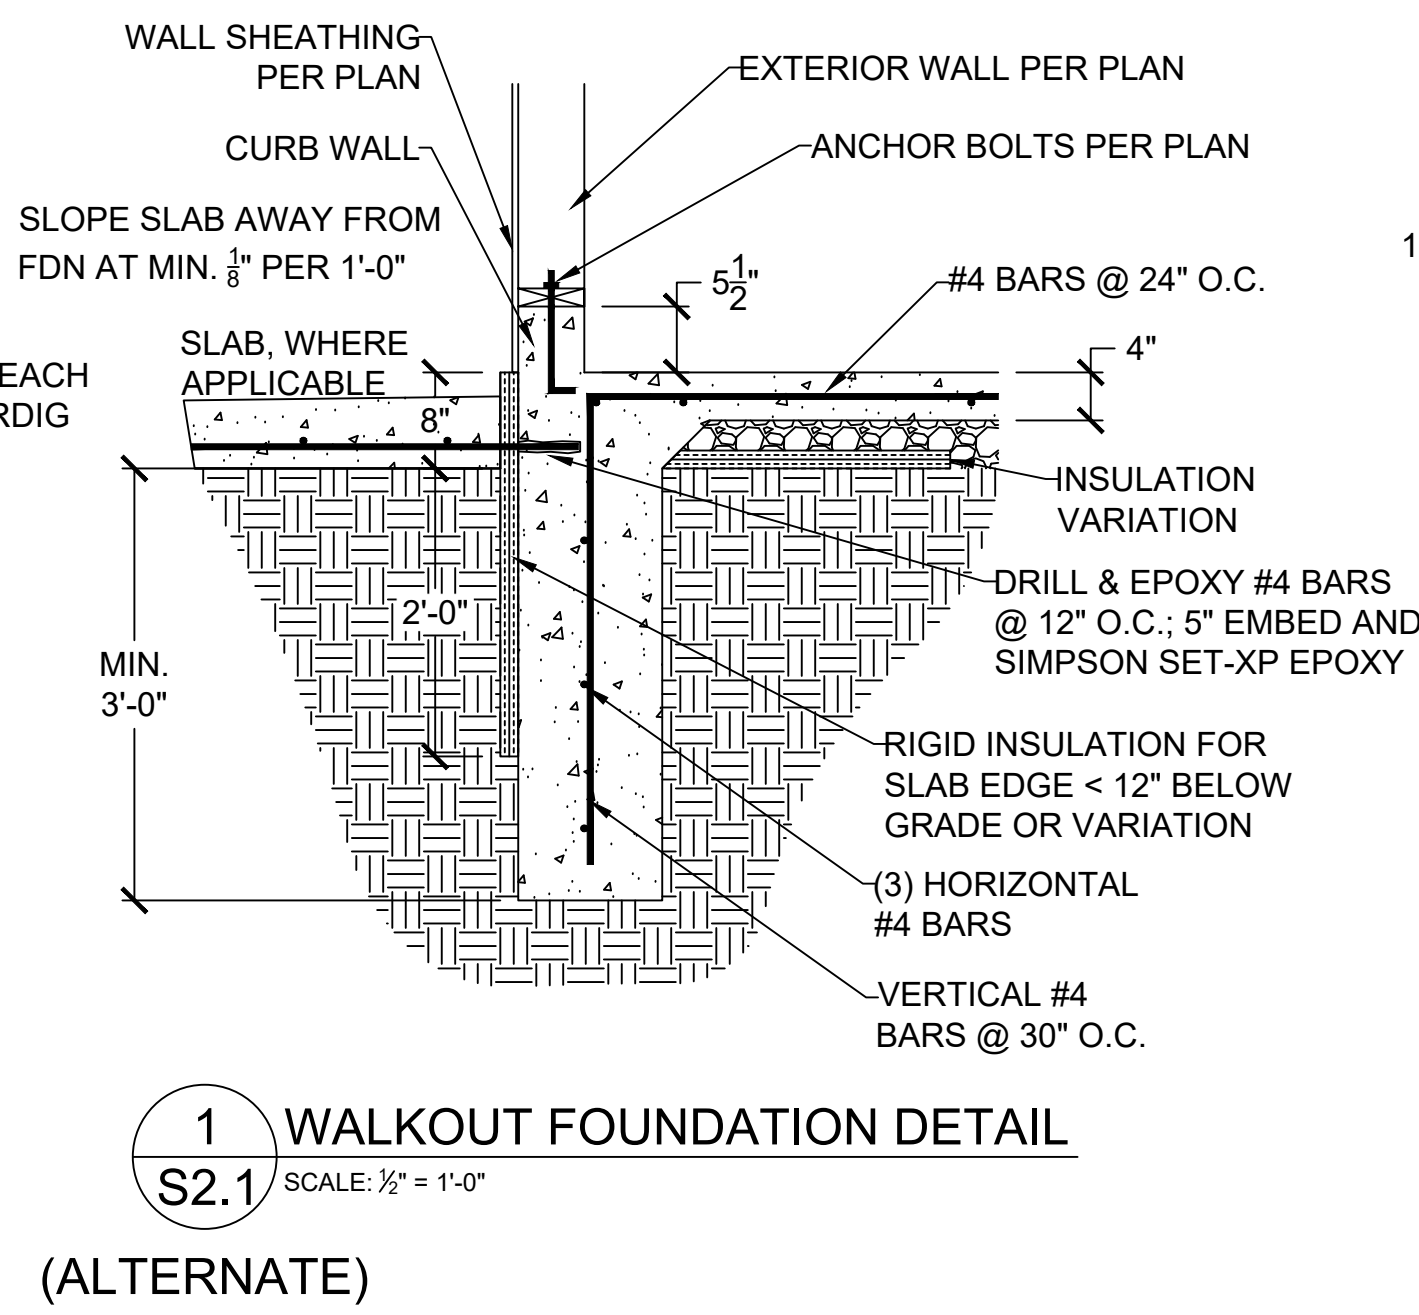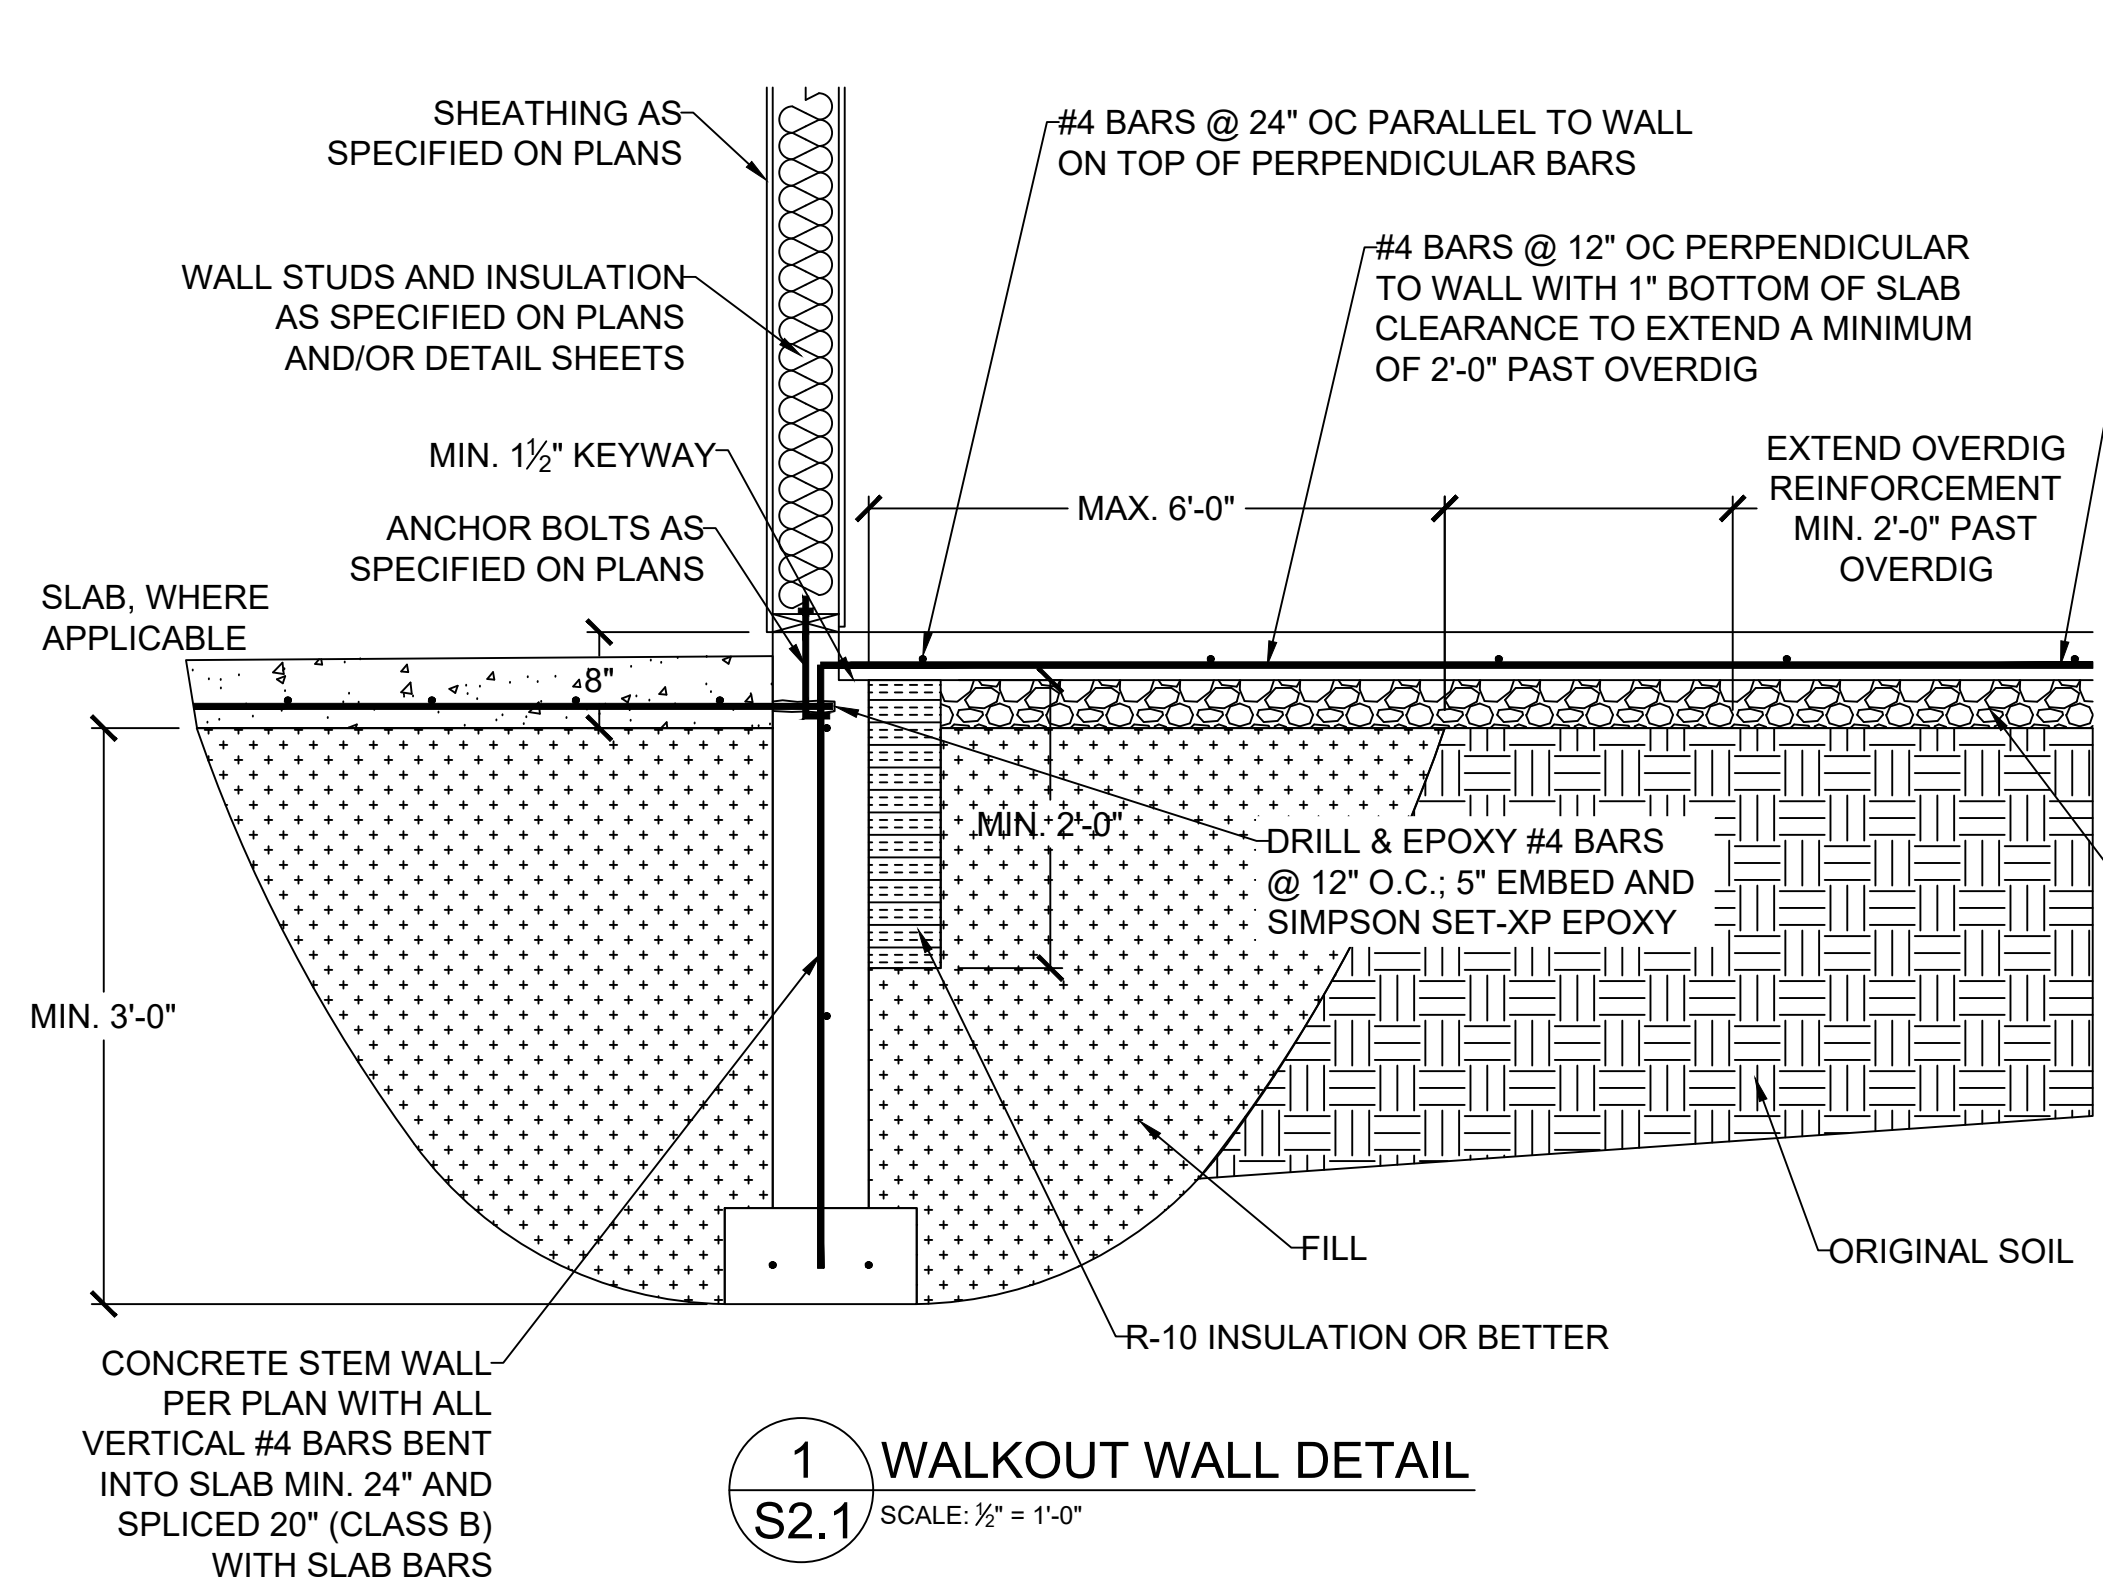

VISTA STRUCTURAL ENGINEERING, LLC
1478 NW DELIA STREET * PORTLAND, OREGON 97229
OFFICE: 971.255.6099 * MOBILE: 971.255.6099 *
DENNIS@VISTASTRUCTURAL.COM * VISTASTRUCTURAL.COM

CLIENT: IQ HOME BUILDERS
JOB TITLE: RHF068 SPEC
LOT 68, THE RETREAT AT HOOK FARMS
LOCATION: 2026 SW RED BARN LN.
LEE'S SUMMIT, MISSOURI

STATE OF MISSOURI
DENNIS HEIER
NUMBER: PE-201801172
PROFESSIONAL ENGINEER
2-7-2022


NO.	DATE	REVISION	BY

DRAWING TITLE
FOUNDATION DETAILS

ENGINEER: DMH CHECKED BY: DMH
JOB NO.: 4276 DRAWN BY: DMH
DATE: 02-07-22
SHEET NUMBER

S2.1

RELEASE FOR CONSTRUCTION AS NOTED ON PLANS Development Services, LLC MISSOURI

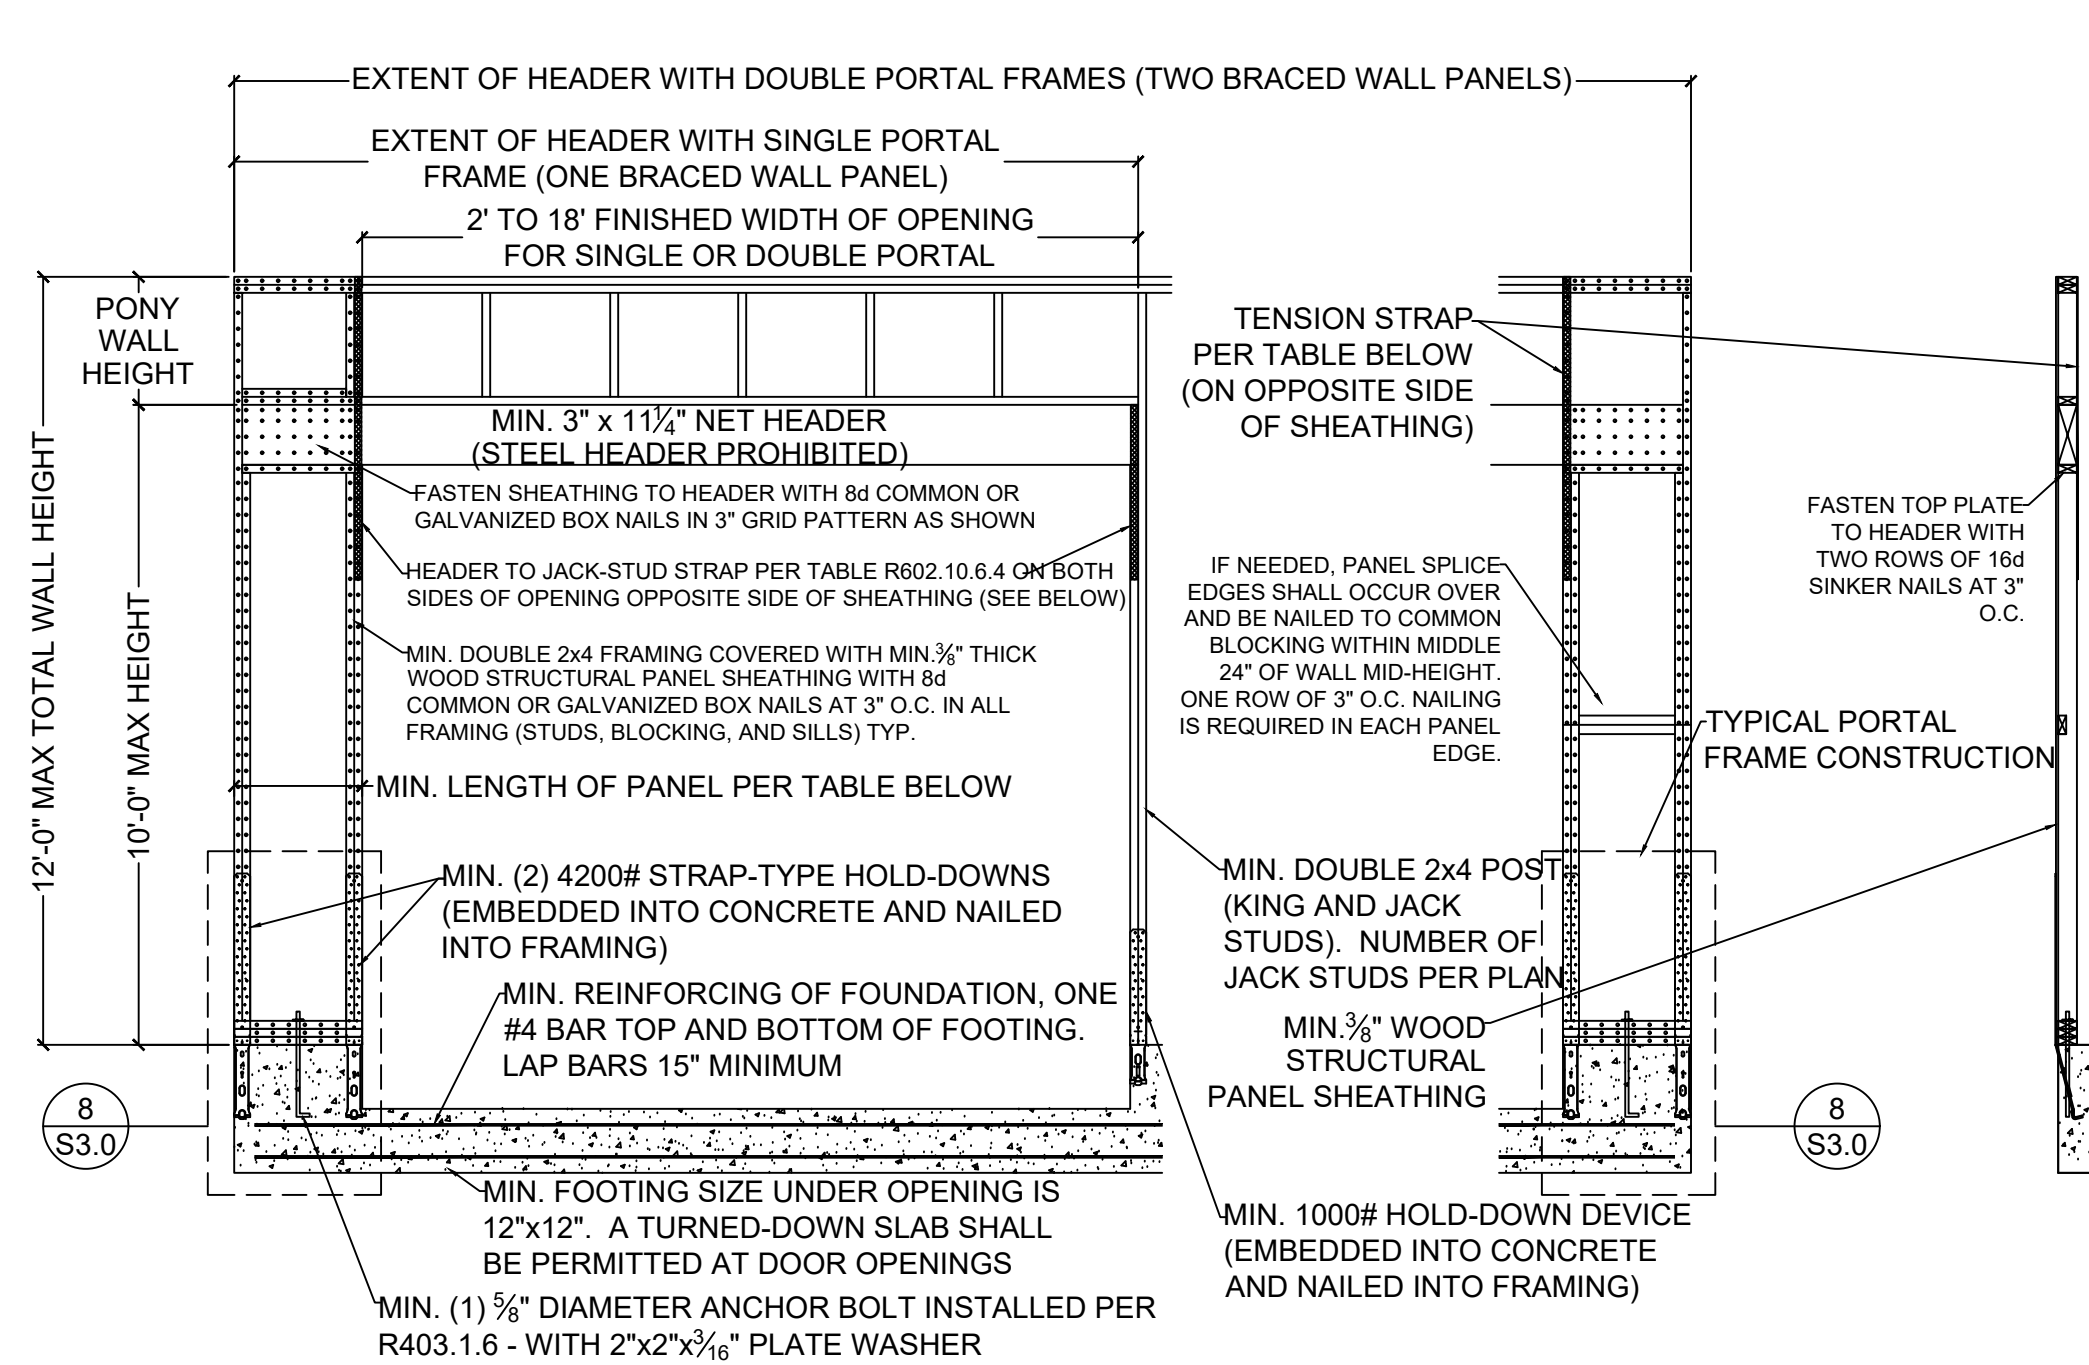


1 METHOD PFH (PORTAL FRAME WITH S3.0 HOLD-DOWNS) - PER FIGURE IRC R602.10.6.2

SCALE: 1/2" = 1'-0" (18x24) OR 3/4" = 1'-0" (24x36)

	MINIMUM PANEL LENGTH FOR DETAIL 1/S3.0 (INCHES)				
	WALL HEIGHT				
	8 FEET	9 FEET	10 FEET	11 FEET	12 FEET
SUPPORTING ROOF ONLY	16	16	16	18	20
SUPPORTING ONE STORY AND ROOF	24	24	24	27	29

TENSION STRAP REQUIRED FOR HEADER TO JACK STUD FOR DETAILS 1/S3.0 AND 2/S3.0 (FROM TABLE R602.10.6.4)					
MAX GARAGE OPENING (FT.)	PONY WALL WALL HT. (FT.)	REQUIRED SIMPSON STRAP	MIN. STRAP END LENGTH	NAILS REQUIRED IN EACH STRAP END LENGTH	
18'-0"	0'-0"	CS20	0'-9"	(7) 8d	
9'-0"	1'-0"	CS20	0'-9"	(7) 8d	
18'-0"	1'-0"	CS14	1'-4"	(15) 8d	
9'-0"	2'-0"	CS18	0'-11"	(9) 8d	
18'-0"	2'-0"	CMSTC16	1'-8"	(25) 16d SINKER	
9'-0"	4'-0"	CMSTC16	1'-8"	(25) 16d SINKER	
16'-0"	4'-0"	CMST14	2'-6"	(33) 10d	

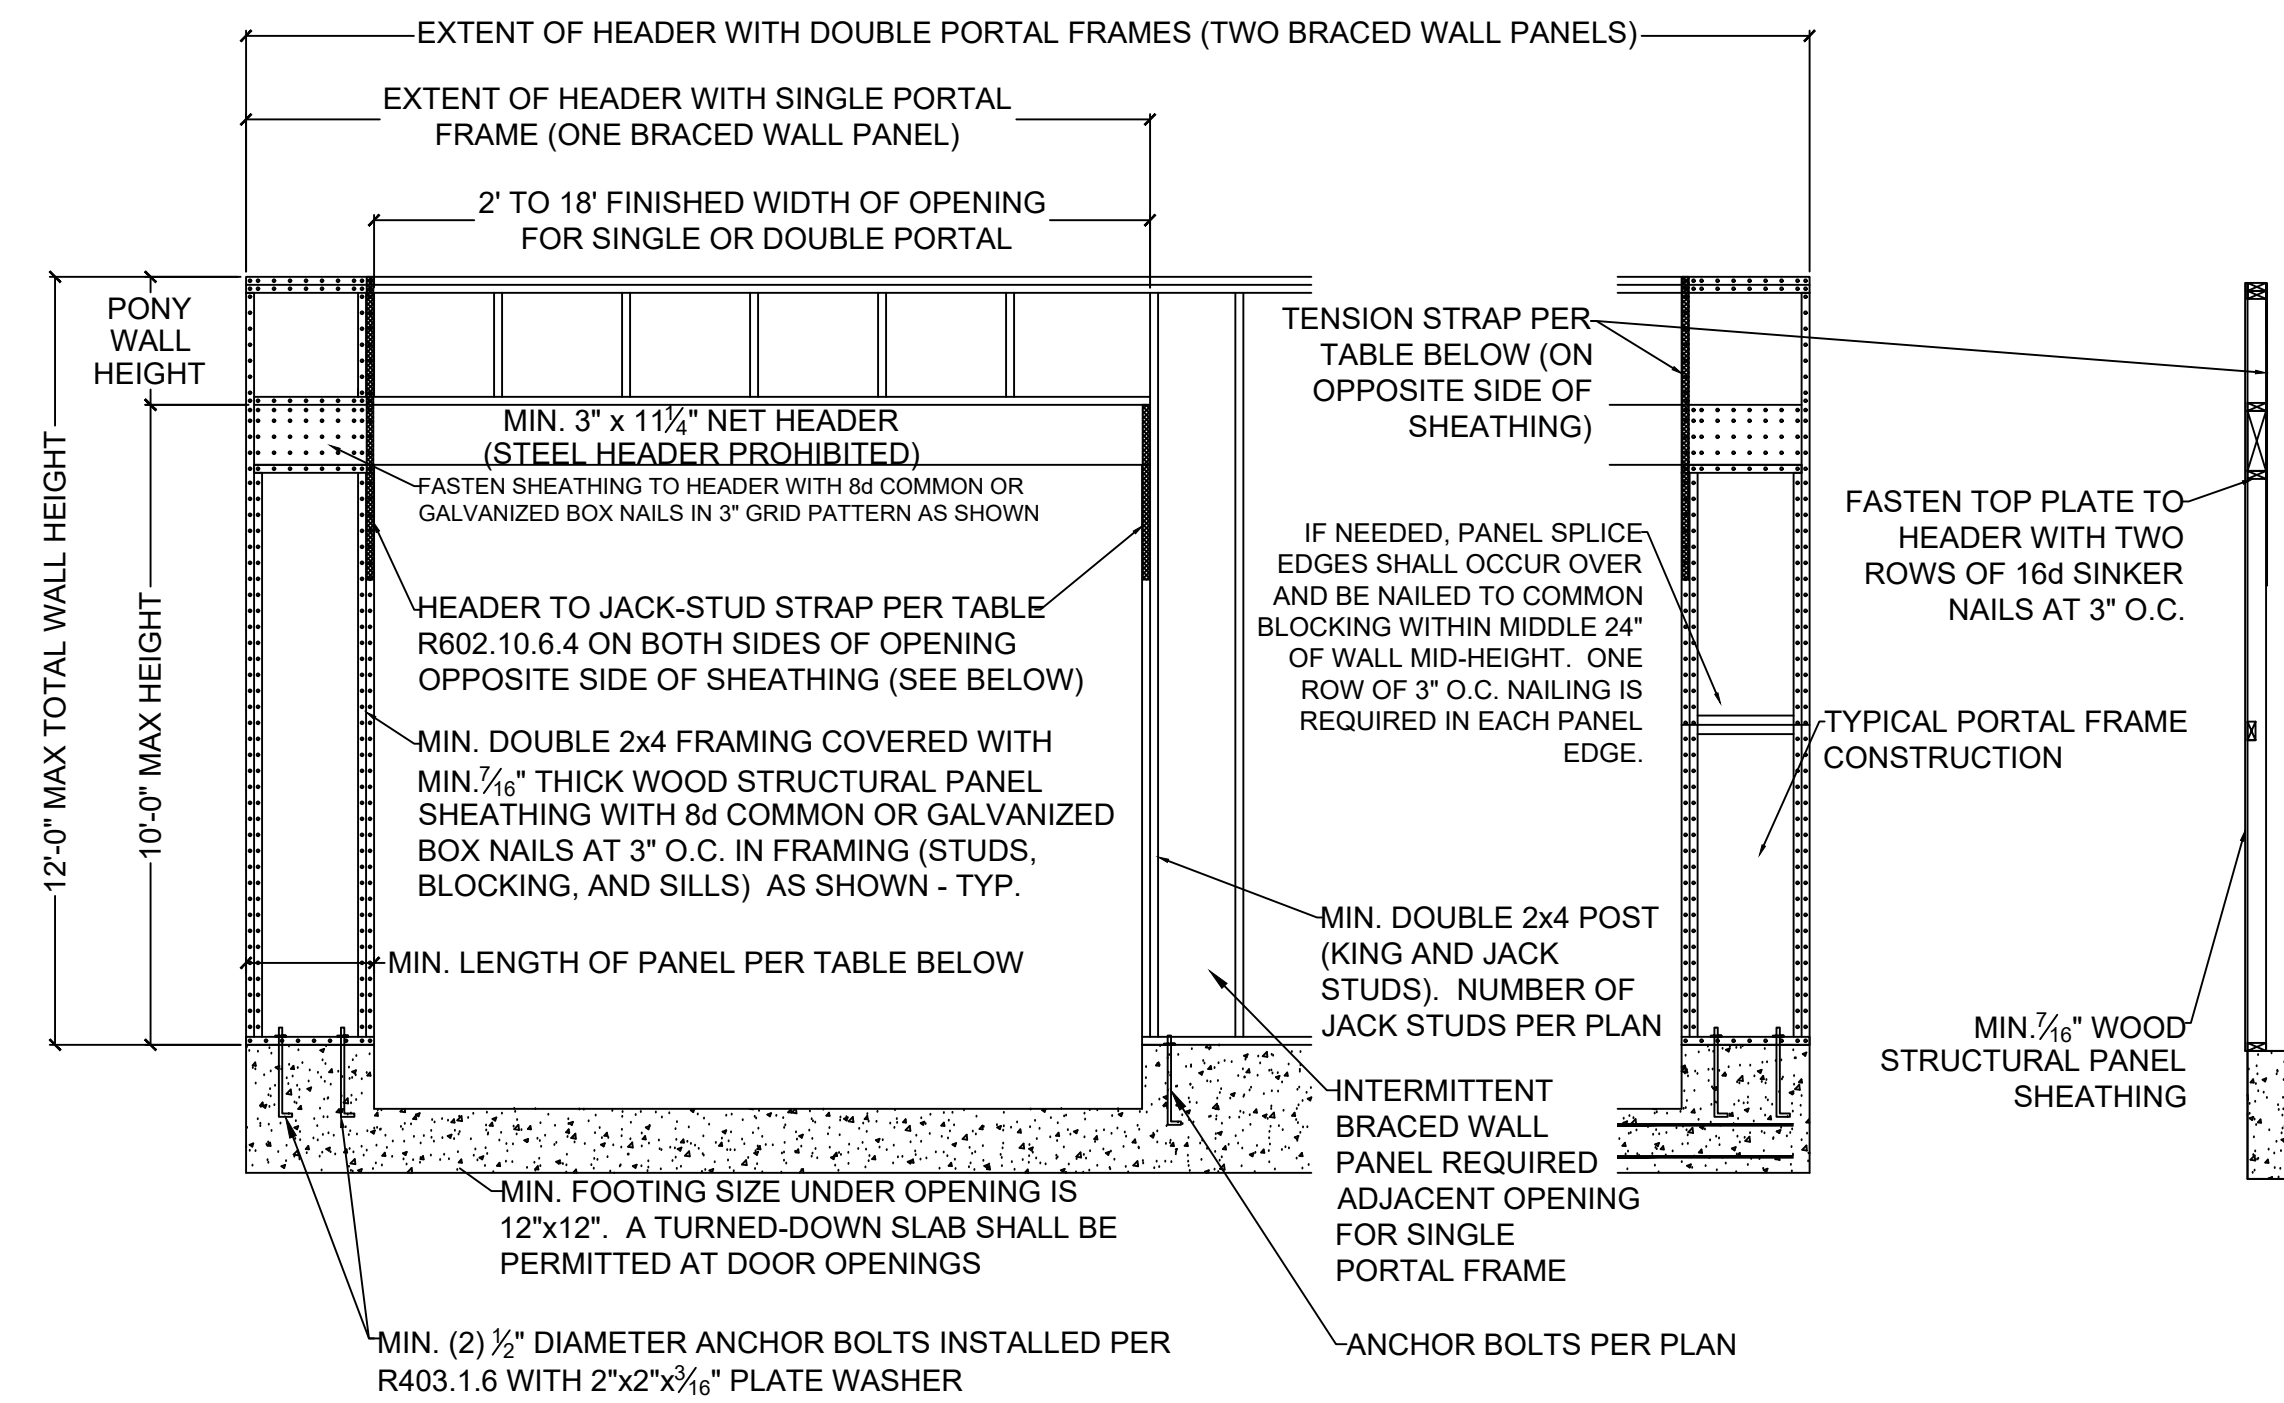


2 METHOD PFG (PORTAL FRAME AT GARAGE S3.0 DOOR) - PER FIGURE IRC R602.10.6.3

SCALE: 1/2" = 1'-0" (18x24) OR 3/4" = 1'-0" (24x36)


MINIMUM PANEL LENGTH FOR DETAIL 2/S3.0 (INCHES)				
WALL HEIGHT				
8 FEET	9 FEET	10 FEET	11 FEET	12 FEET
24	27	30	33 ^a	36 ^a

a. Maximum opening height for PFG is 10 feet in accordance with Figure R602.10.6.3, but wall height may be increased to 12 feet with pony wall

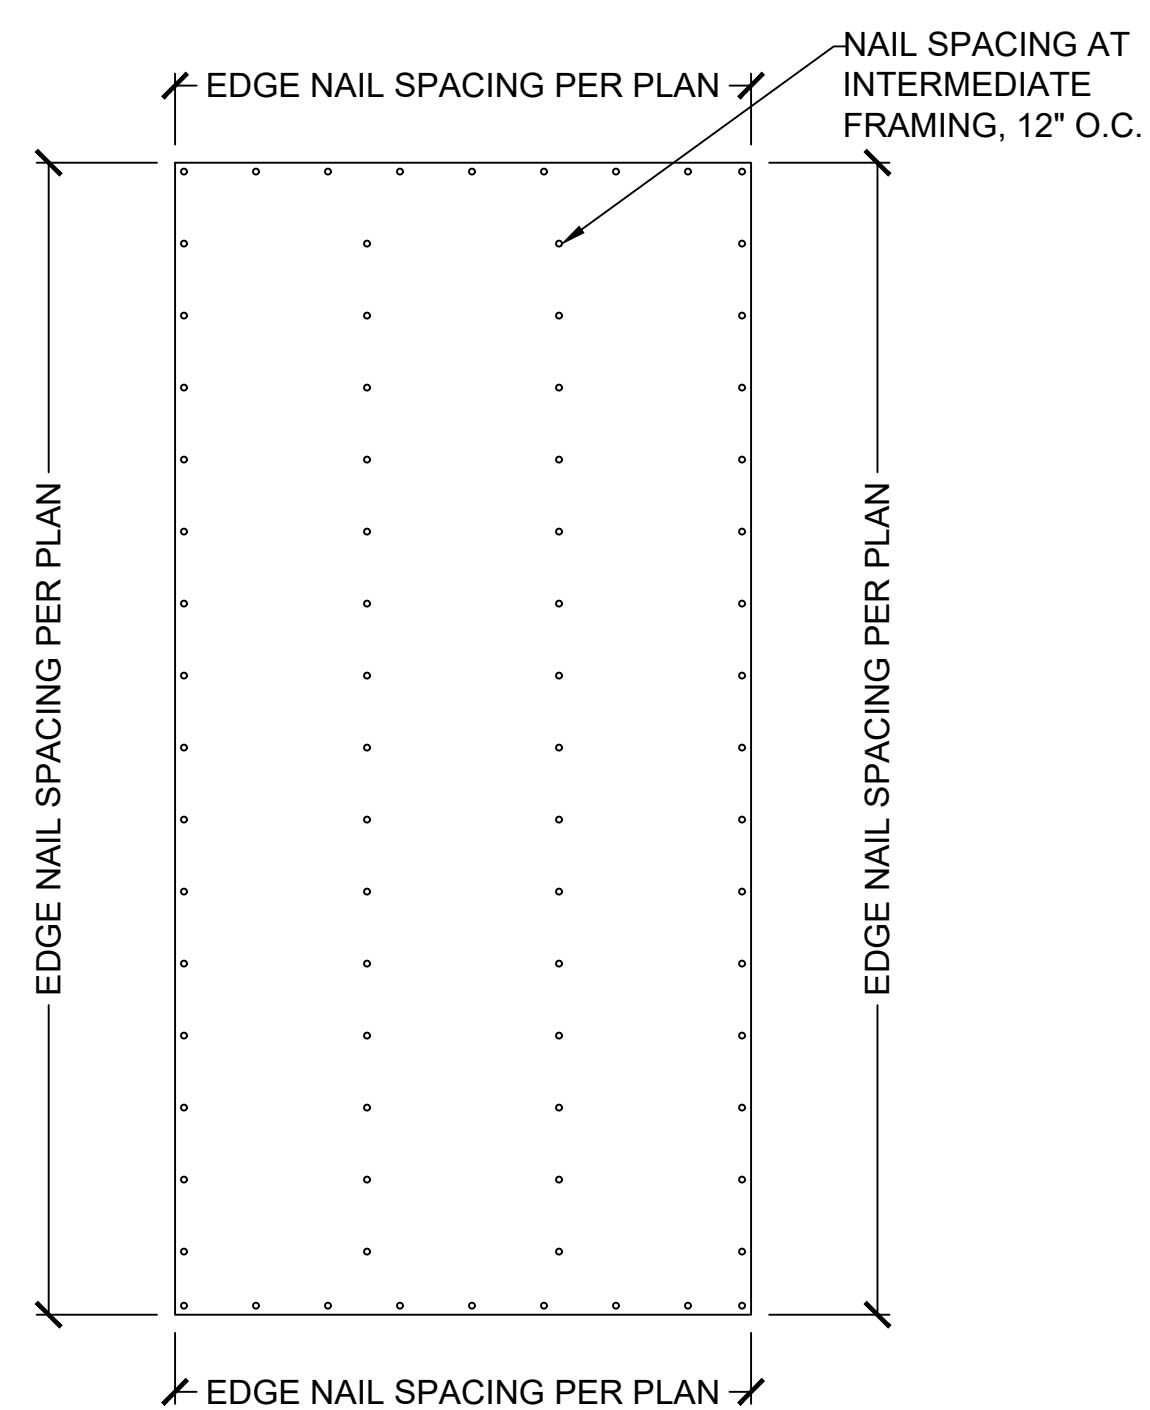


3 EXTERIOR WALL SHEATHING S3.0 PANEL ATTACHMENT

SCALE: 1/2" = 1'-0" (18x24) OR 3/4" = 1'-0" (24x36)

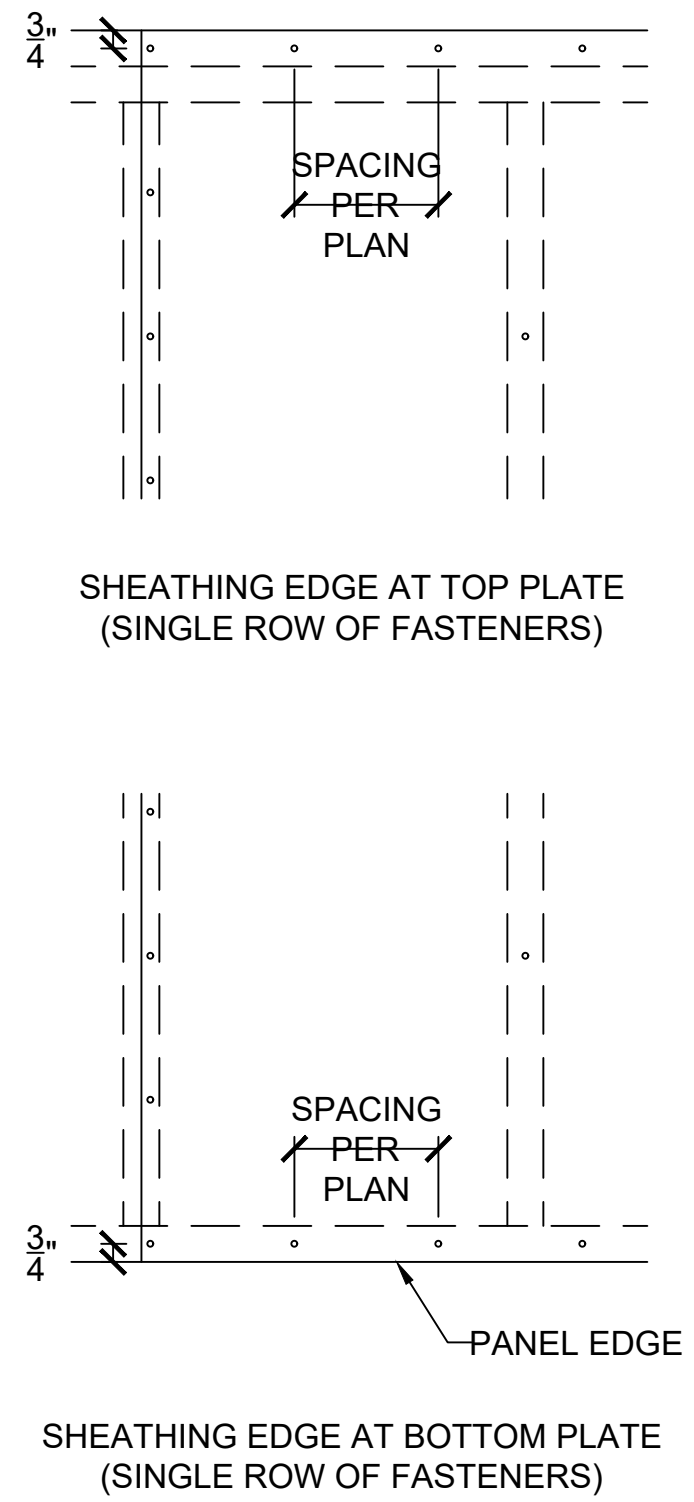


4 SHEATHING EDGE AT TOP AND BOTTOM PLATES S3.0

SCALE: 1" = 1'-0" (18x24) OR 1 1/2" = 1'-0" (24x36)

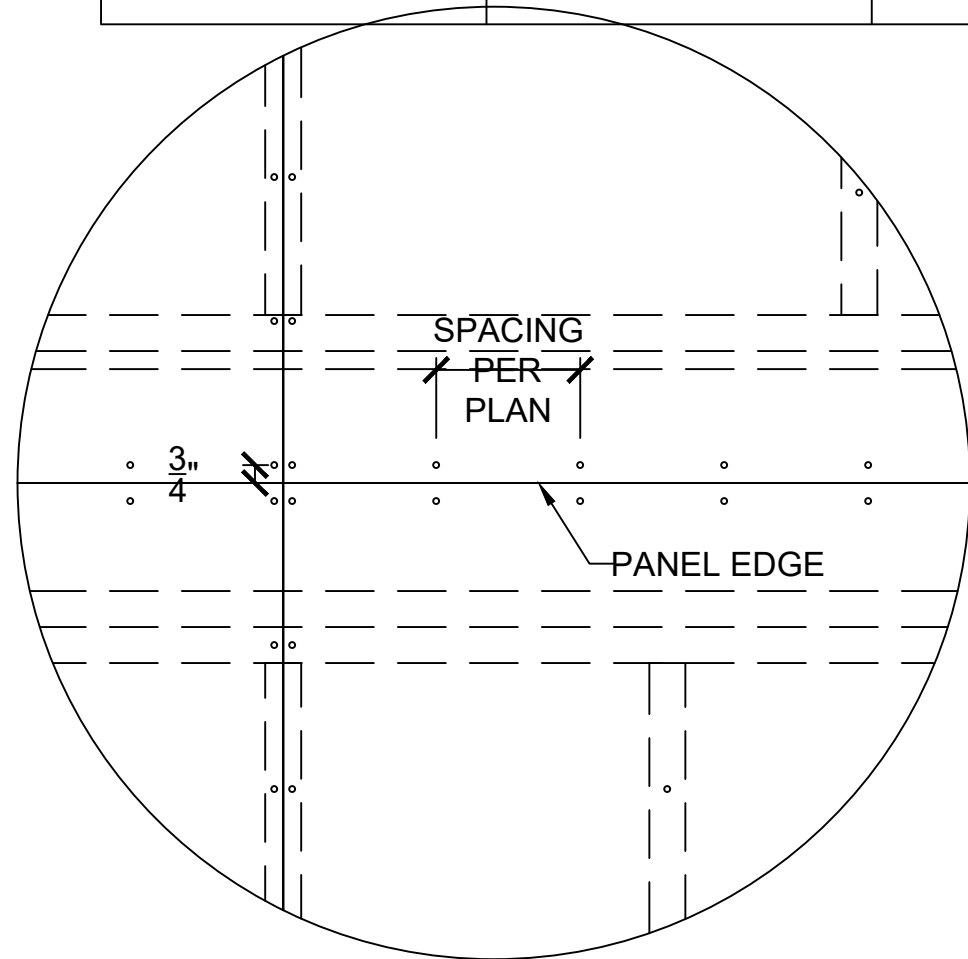


5 SHEATHING EDGE AT HORIZONTAL S3.0 FRAMING MEMBER

SCALE: 1" = 1'-0" (18x24) OR 1 1/2" = 1'-0" (24x36)

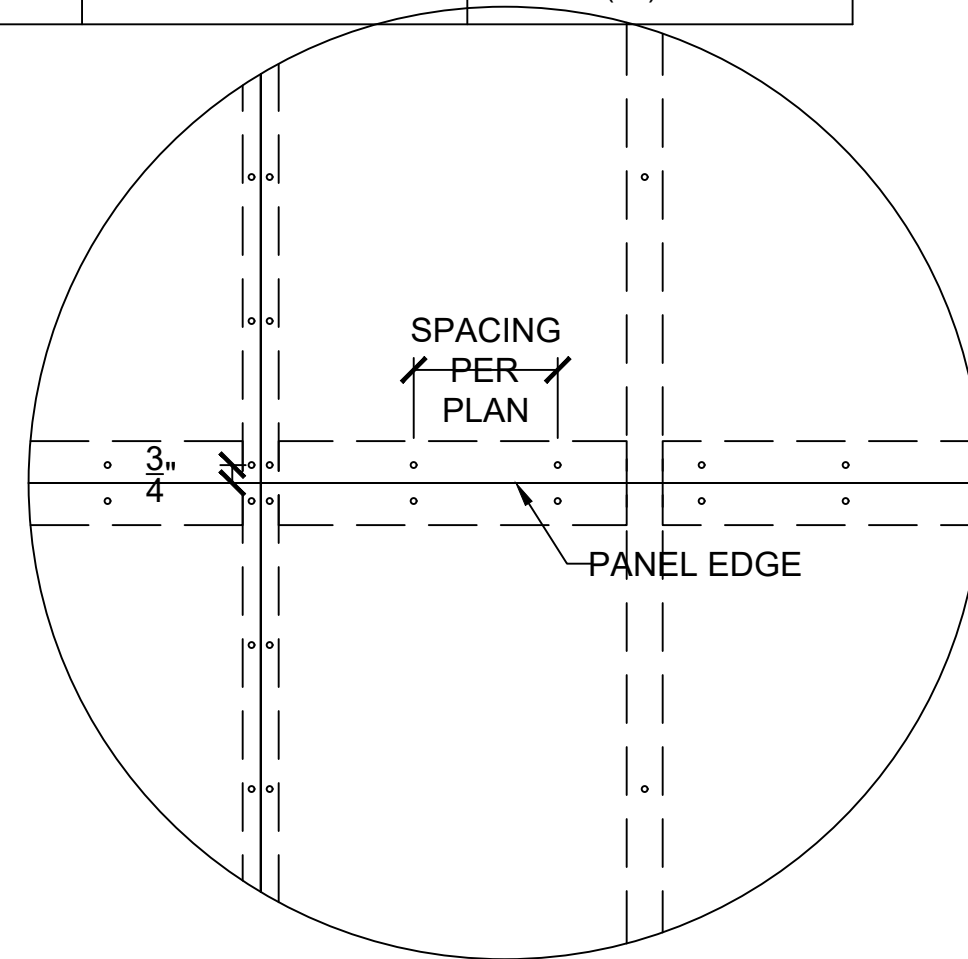


6 SHEATHING EDGE AT PANEL S3.0 SPLICE ACROSS STUDS

SCALE: 1" = 1'-0" (18x24) OR 1 1/2" = 1'-0" (24x36)

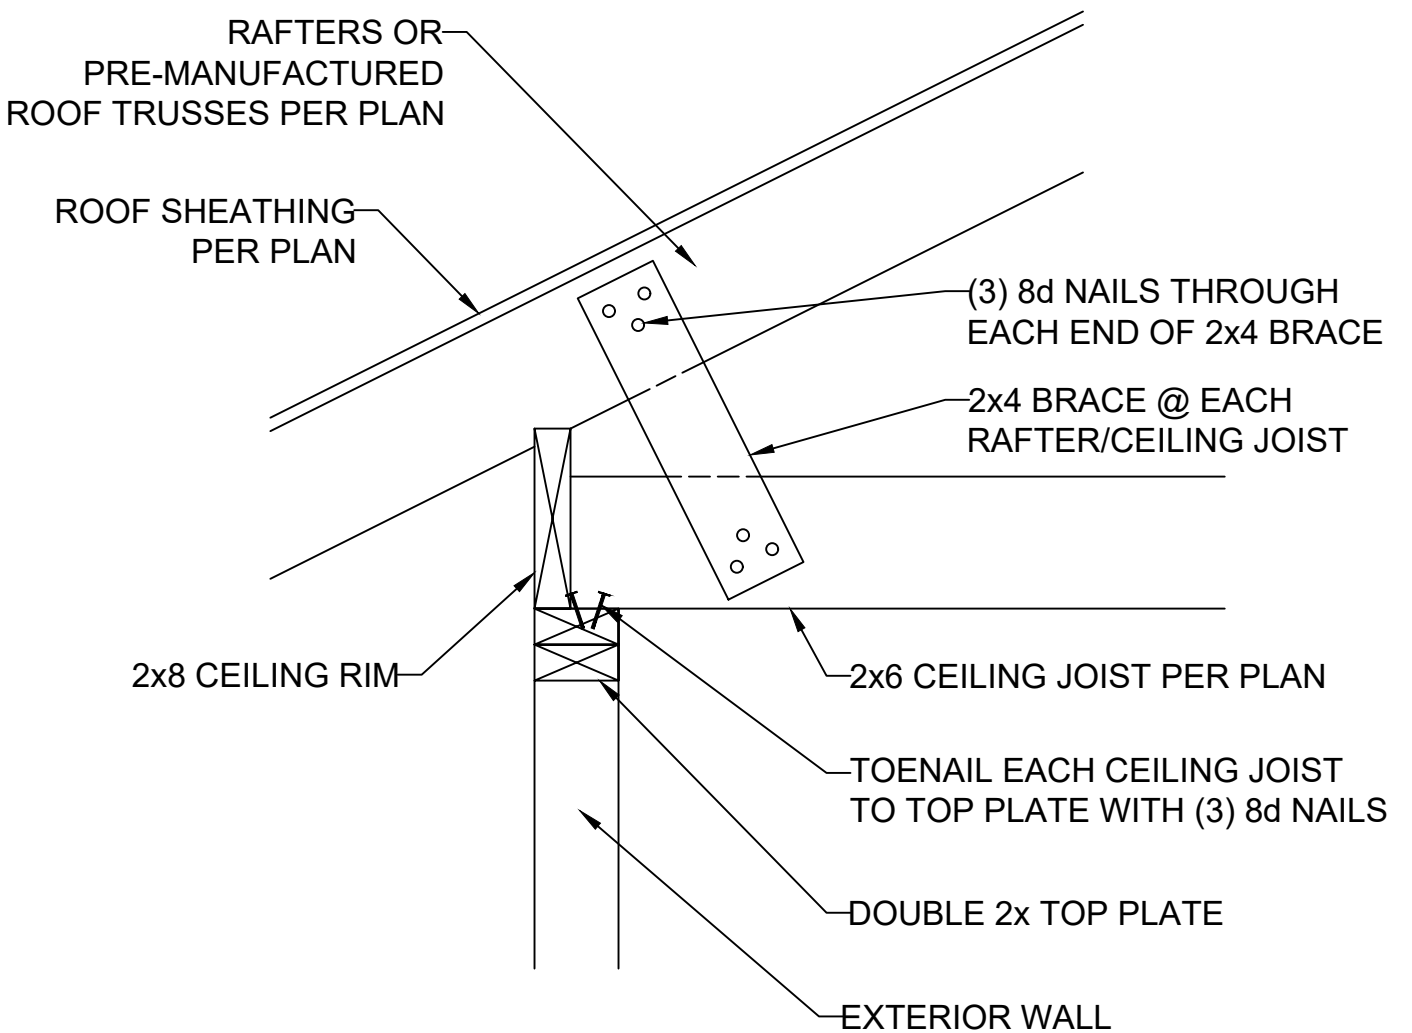

7 RAFTER BEARING OPTION DETAIL S3.0


SCALE: 1" = 1'-0" (18x24) OR 1 1/2" = 1'-0" (24x36)

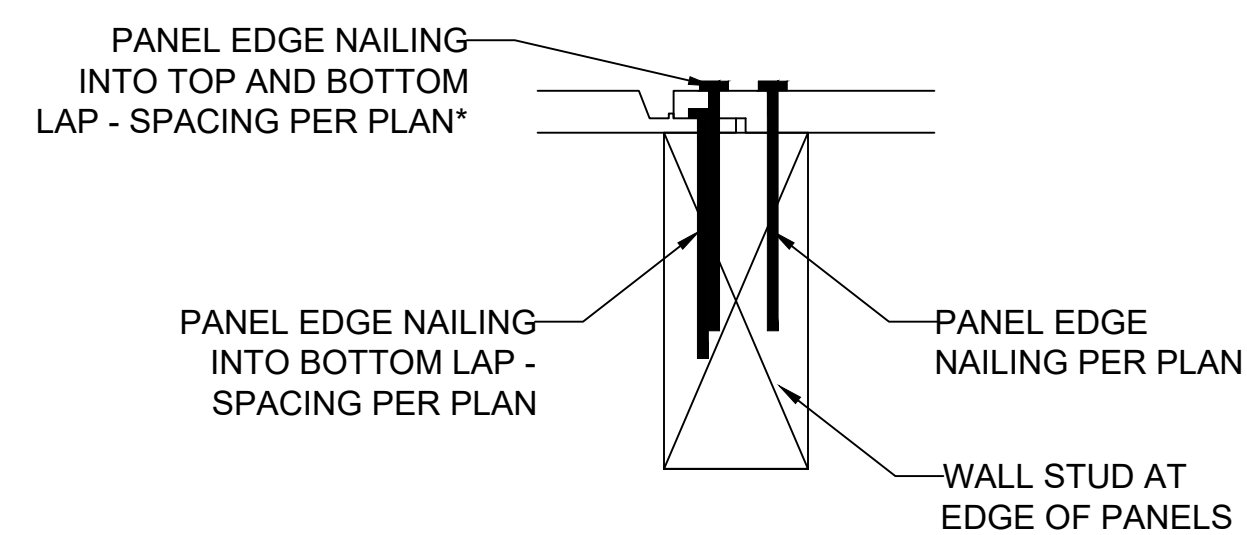

8 FASTENING INSTRUCTIONS FOR S3.0 SHIPLAP PANEL SHEATHING

SCALE: 4" = 1'-0" (18x24) OR 6" = 1'-0" (24x36)

*NOTE: NAILING INTO TOP AND BOTTOM LAP IS IN ADDITION TO NAILING REQUIRED INTO BOTTOM LAP. FOR EXAMPLE, IF PLAN CALLS FOR NAILS @ 6" O.C. AT EDGES, BOTTOM LAP SHALL BE FASTENED AT 6" O.C. AND, IN ADDITION, NAILING SHALL ALSO BE INSTALLED THROUGH TOP AND BOTTOM LAP @ 6" O.C. STAGGERED 3" FROM BOTTOM LAP NAILING

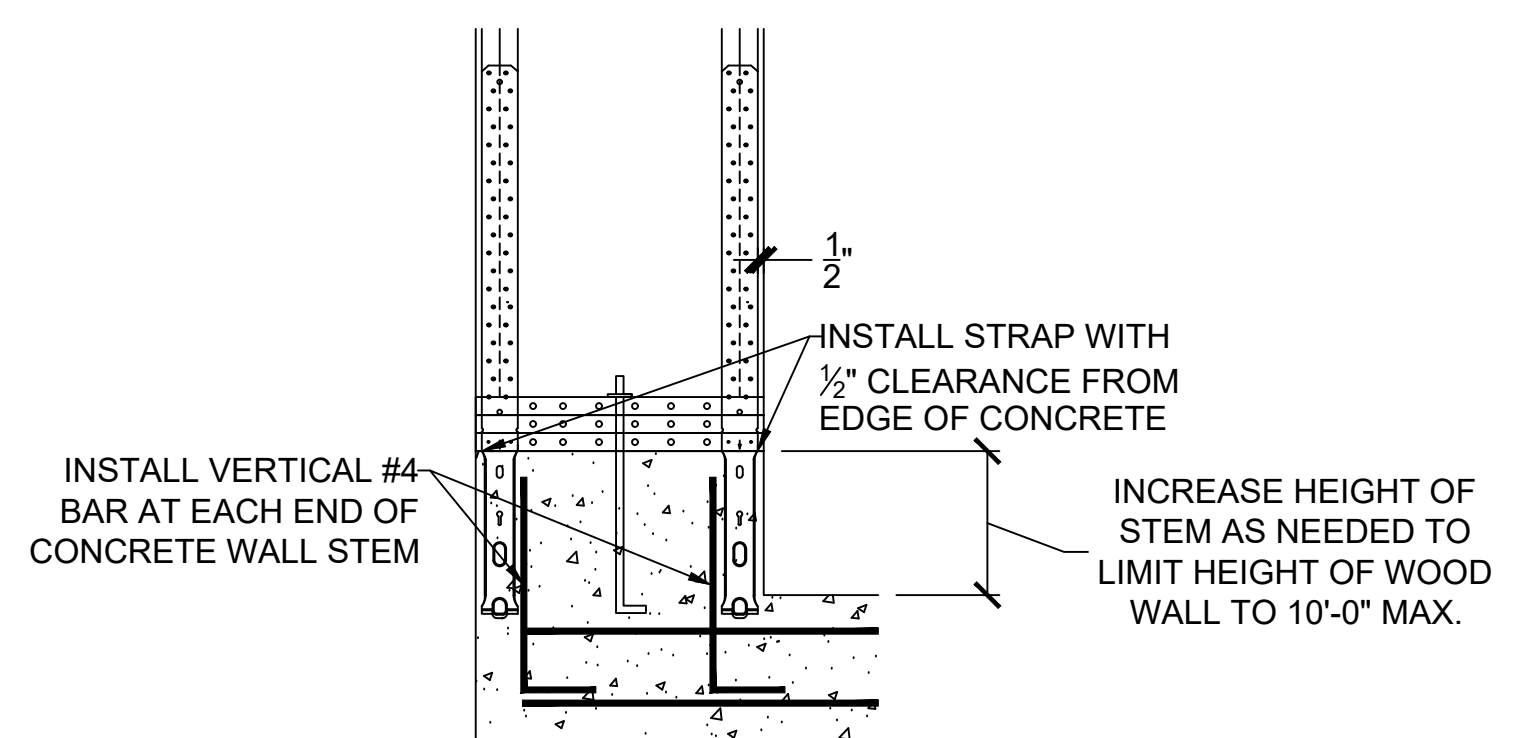

9 GARAGE HOLD-DOWN S3.0 STRAP INSTALLATION

SCALE: 1/2" = 1'-0" (18x24) OR 3/4" = 1'-0" (24x36)

VISTA ENGINEERING, LLC
 14718 NW DELIA STREET * PORTLAND, OREGON 97129
 OFFICE: 971.255.6099 * MOBILE: 971.255.6099 *
 DENNIS@VISTASTRUCTURAL.COM * VISTASTRUCTURAL.COM

CLIENT: IQ HOME BUILDERS
 JOB TITLE: RHF068 SPEC
 LOT 68, THE RETREAT AT HOOK FARMS
 LOCATION: 2026 SW RED BARN LN
 LEE'S SUMMIT, MISSOURI


STATE OF MISSOURI
 DENNIS HEIER
 NUMBER: PE-2018001772
 PROFESSIONAL ENGINEER
 2-7-2022

NO.	DATE	REVISION	BY

DRAWING TITLE
FRAMING DETAILS


ENGINEER: DMH CHECKED BY: DMH
 JOB NO: 4276 DRAWN BY: DMH
 DATE: 02-07-22
 SHEET NUMBER

S3.0

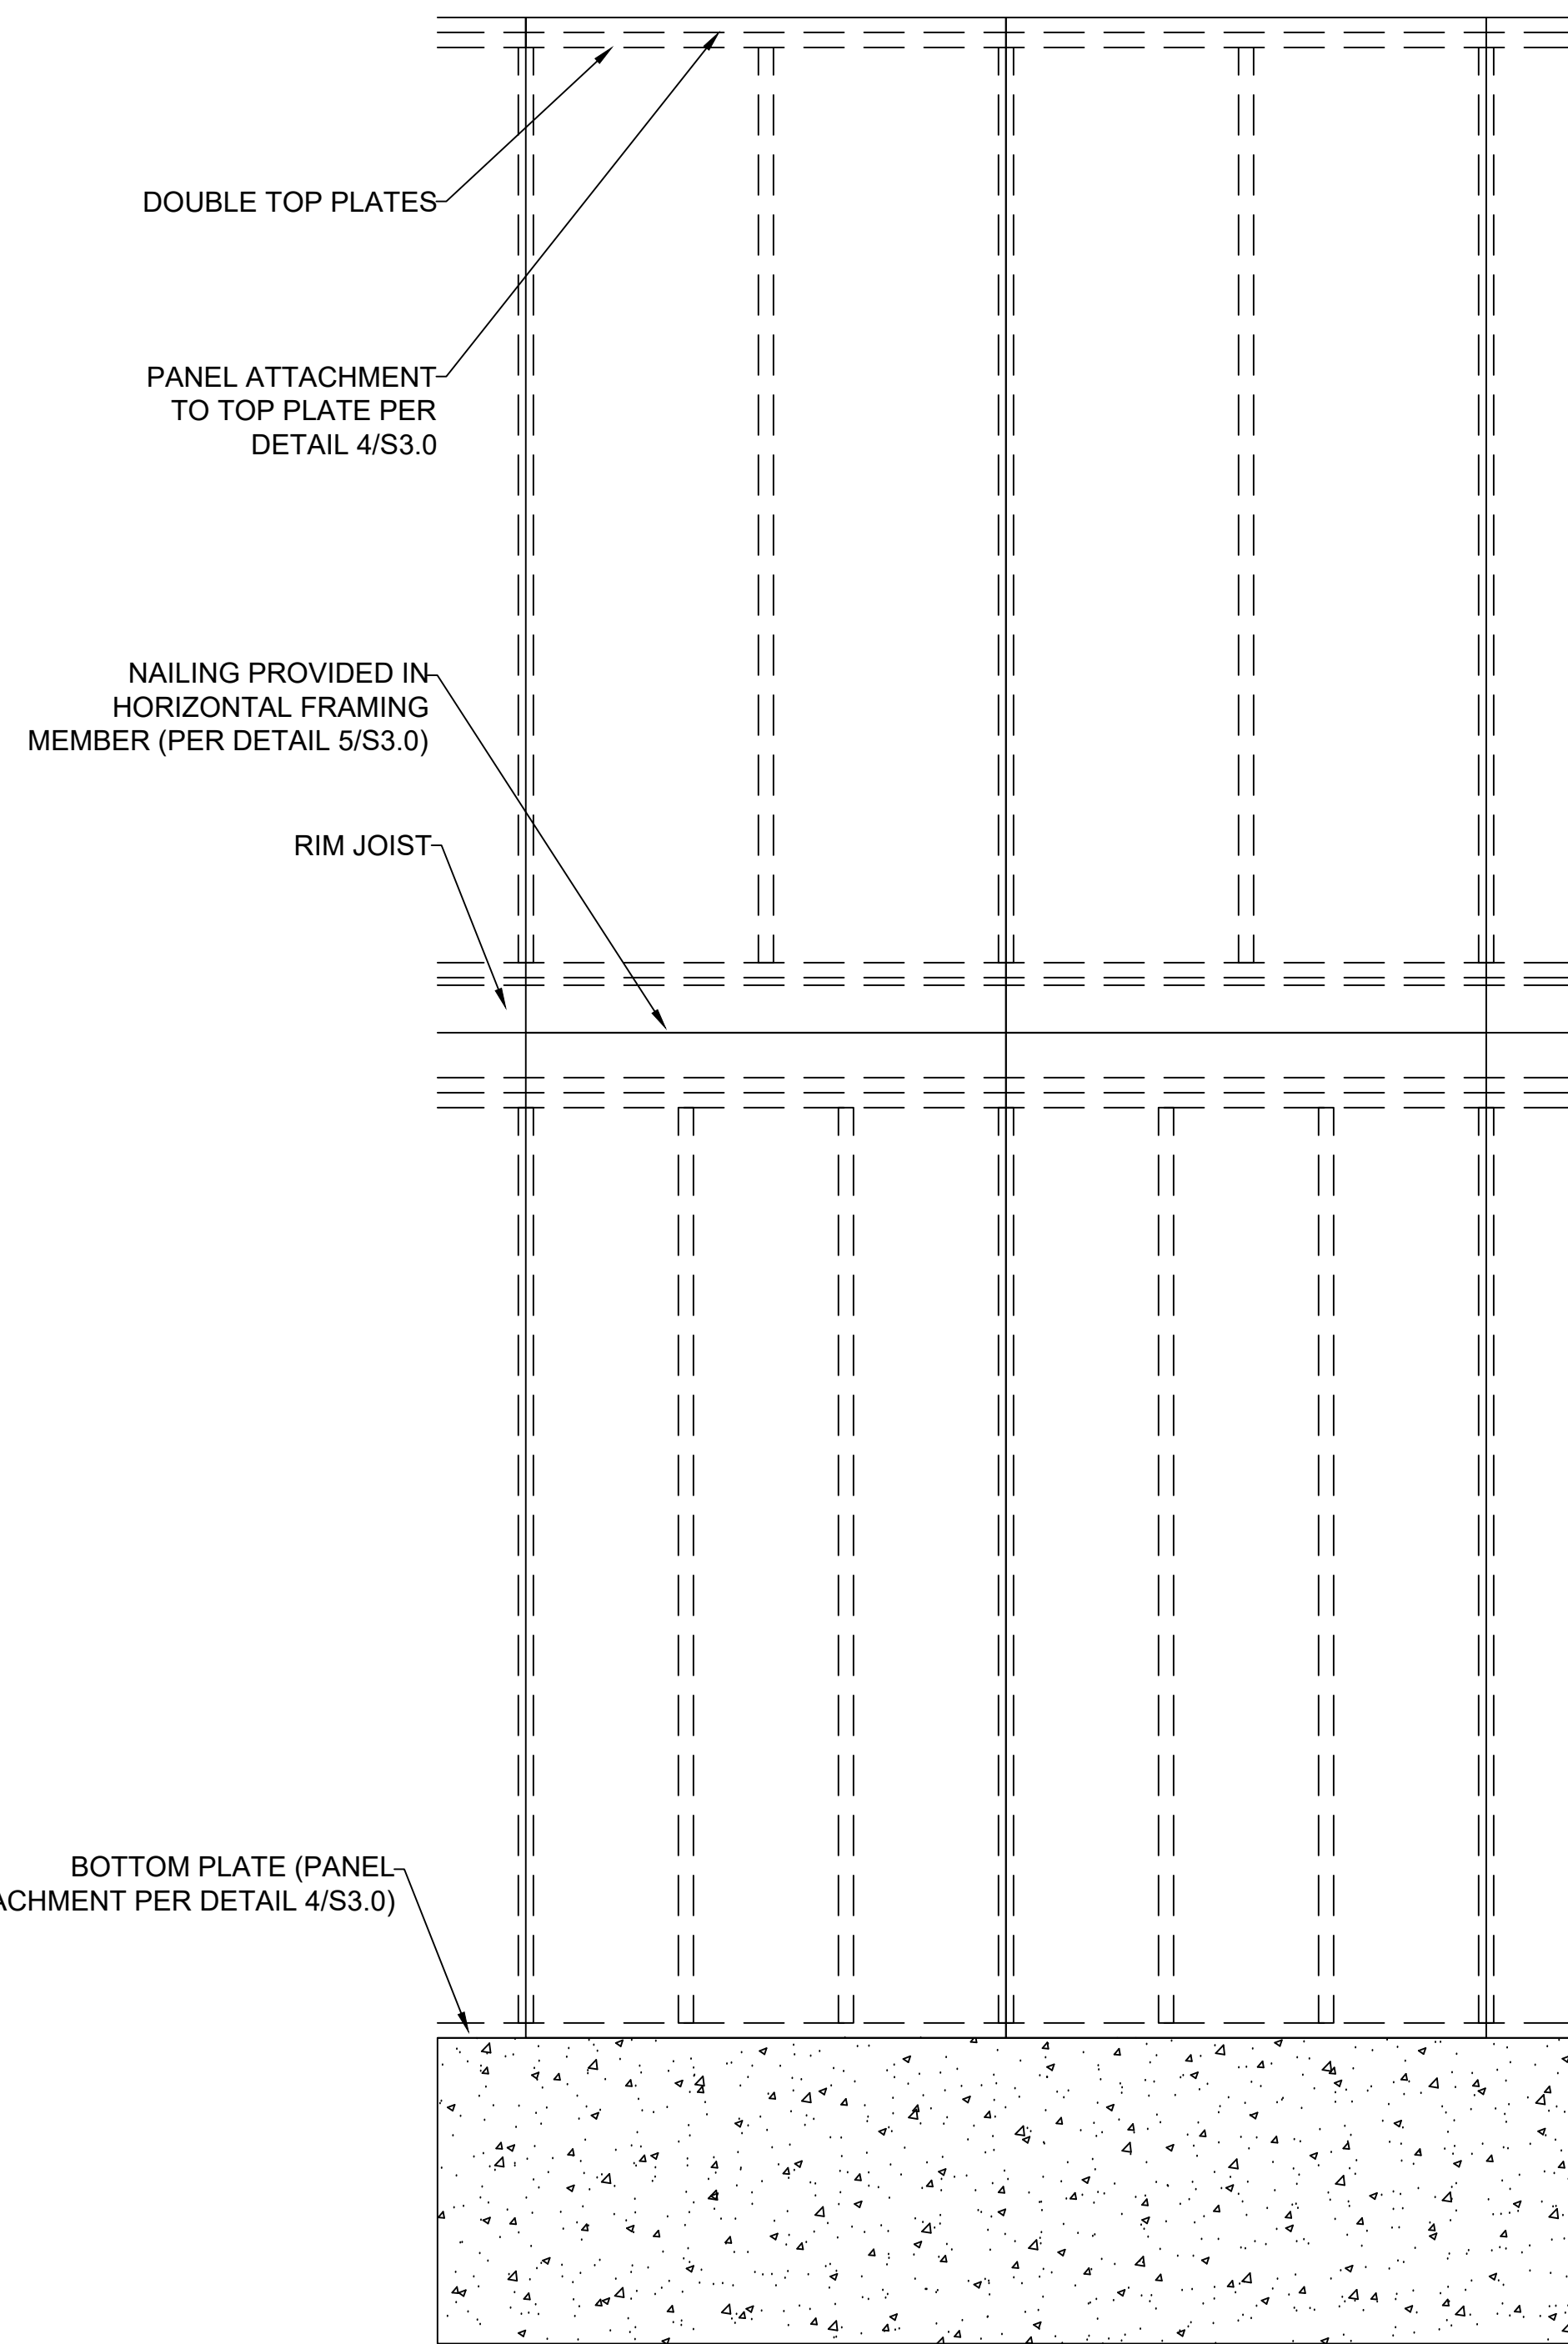


1 EXTERIOR WALL SHEATHING PANEL ATTACHMENT
S3.1 PANEL SPLICE OVER HORIZONTAL FRAMING MEMBER

SCALE: 1/2" = 1'-0" (18x24) OR 3/4" = 1'-0" (24x36)

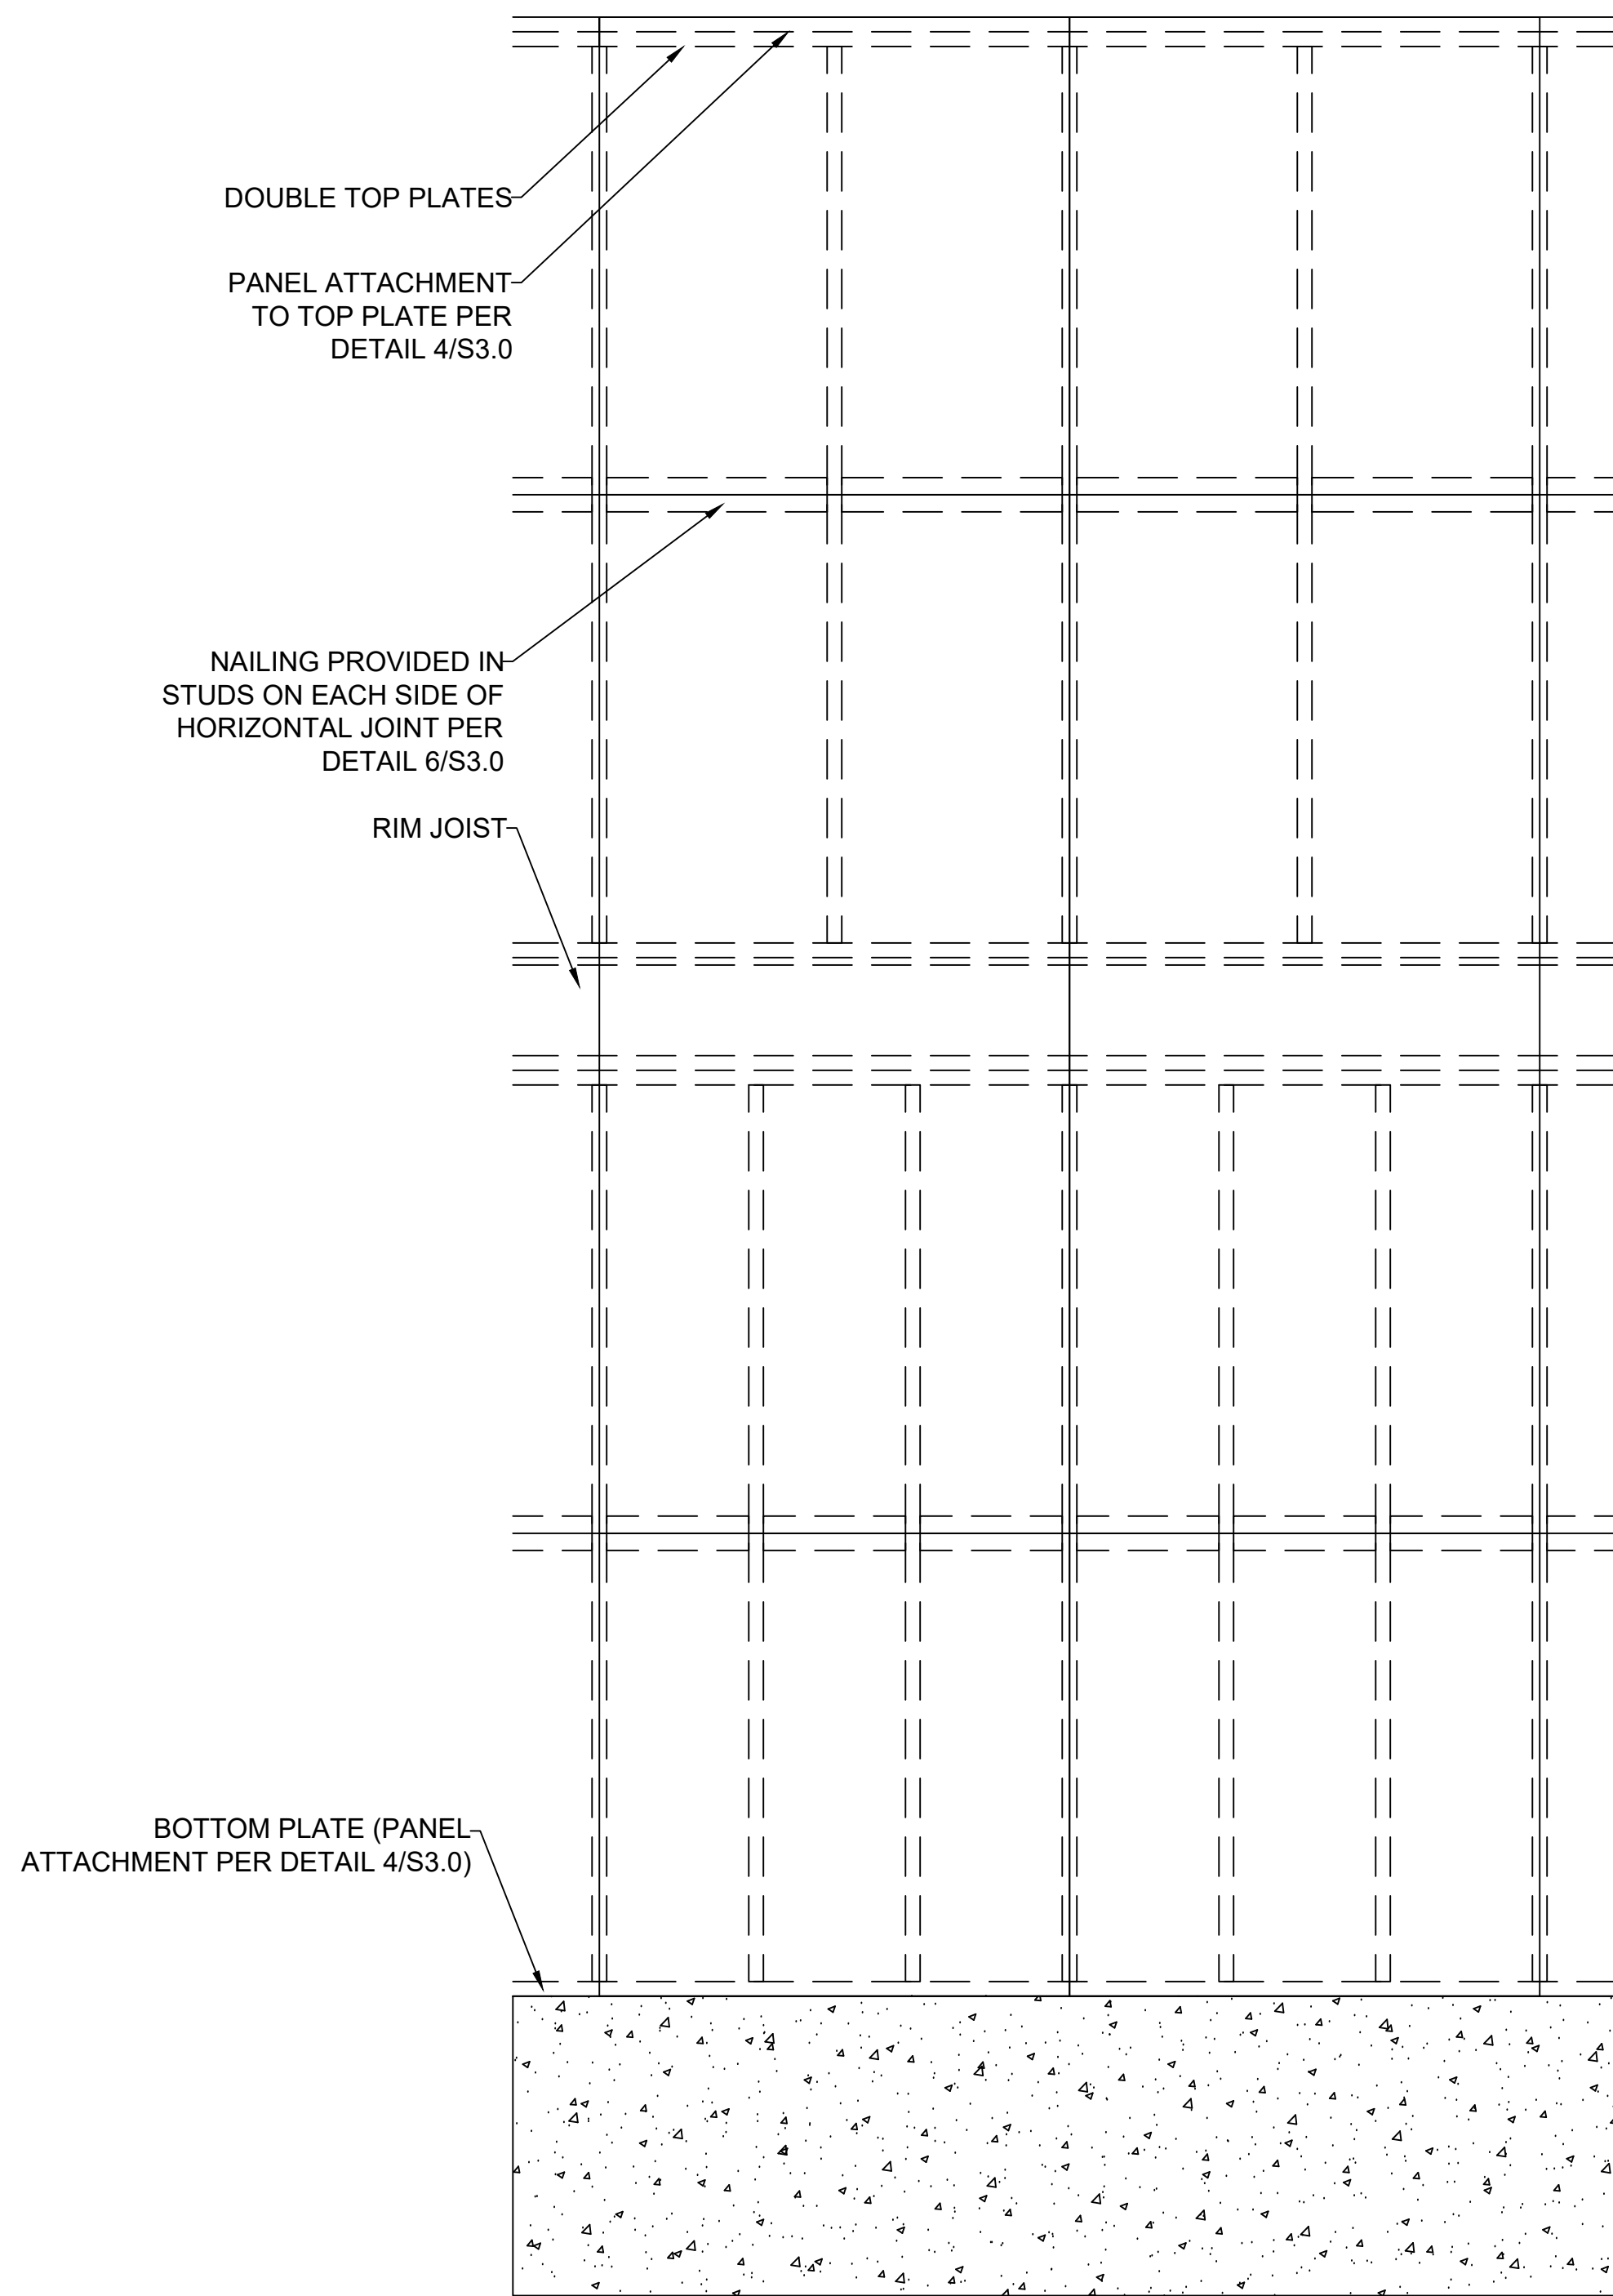


2 EXTERIOR WALL SHEATHING PANEL ATTACHMENT
S3.1 PANEL SPLICE OCCURRING ACROSS STUDS

SCALE: 1/2" = 1'-0" (18x24) OR 3/4" = 1'-0" (24x36)


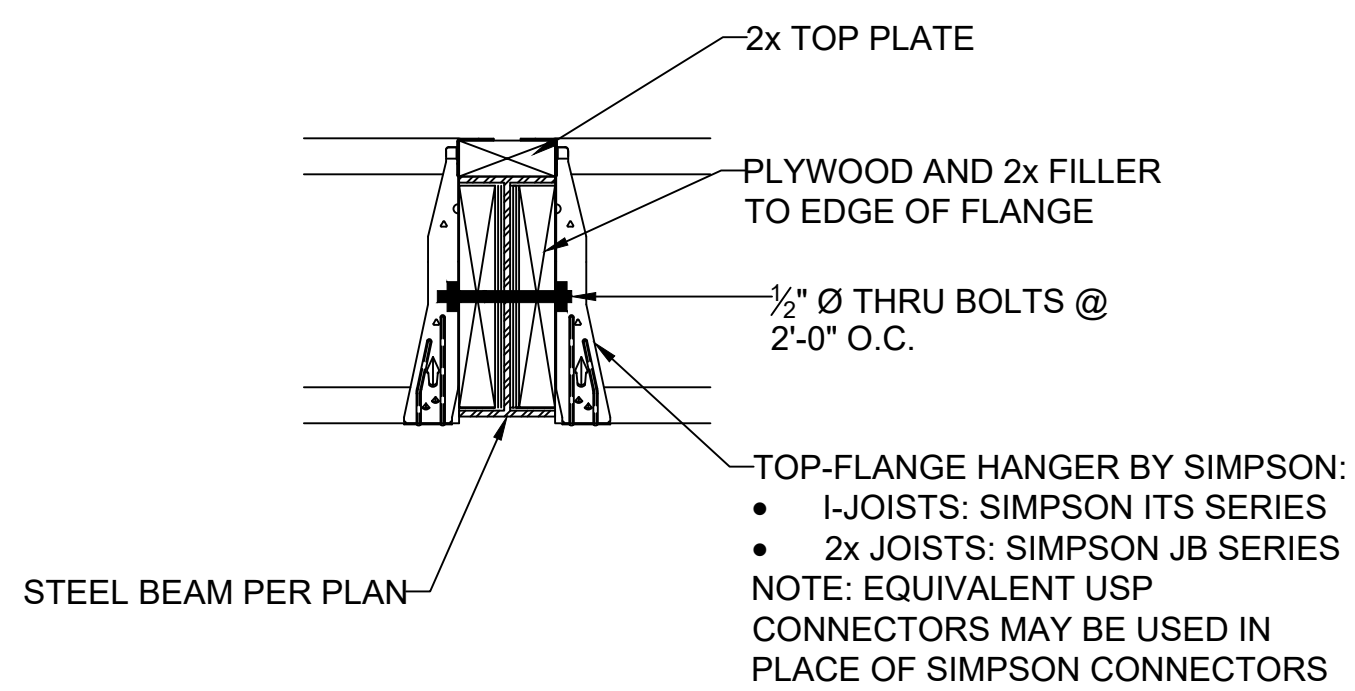


4 FLOOR JOIST TO FLUSH STEEL BEAM DETAIL
S3.1 SCALE: 1" = 1'-0" (18x24) OR 1 1/2" = 1'-0" (24x36)

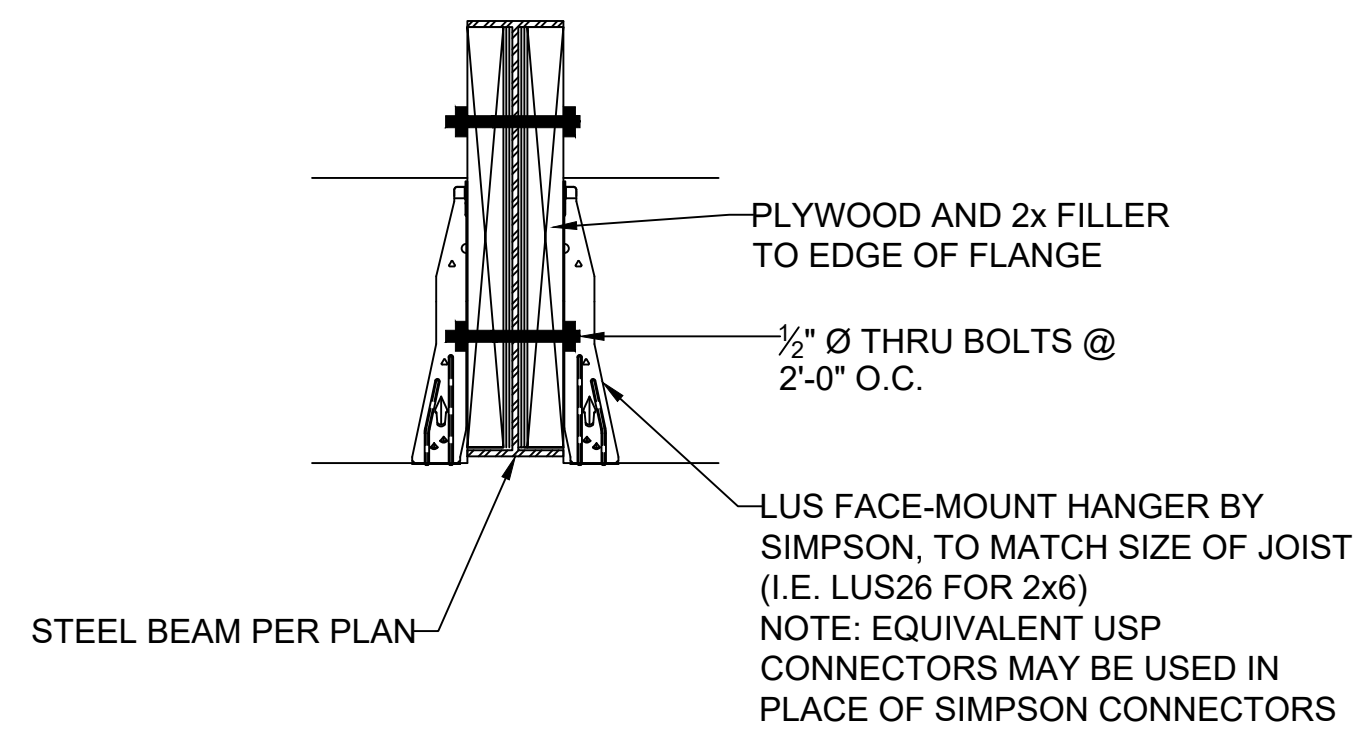

5 CEILING JOIST TO FLUSH STEEL BEAM DETAIL
S3.1 SCALE: 1" = 1'-0" (18x24) OR 1 1/2" = 1'-0" (24x36)

3 EXTERIOR WALL SECTION
S3.1 SCALE: 3/4" = 1'-0"

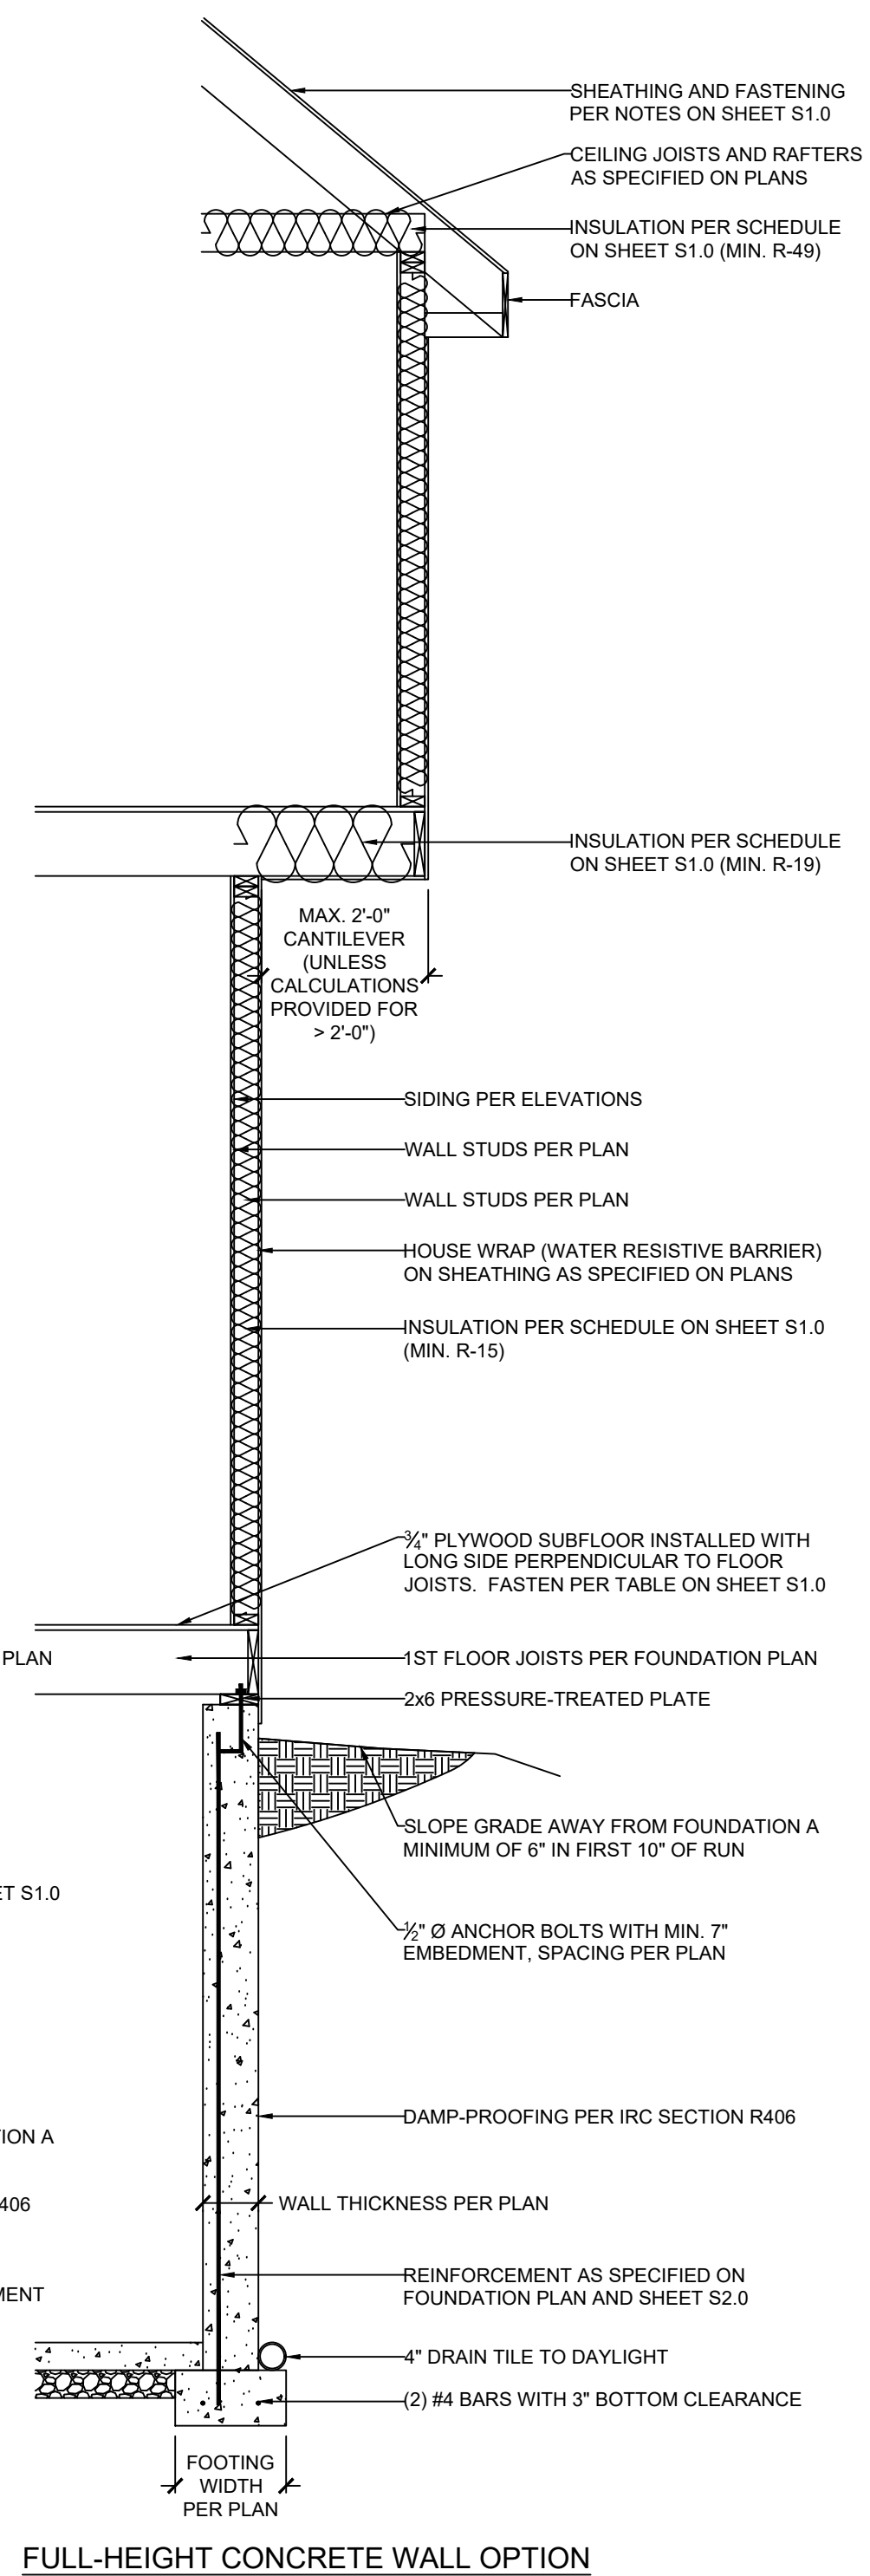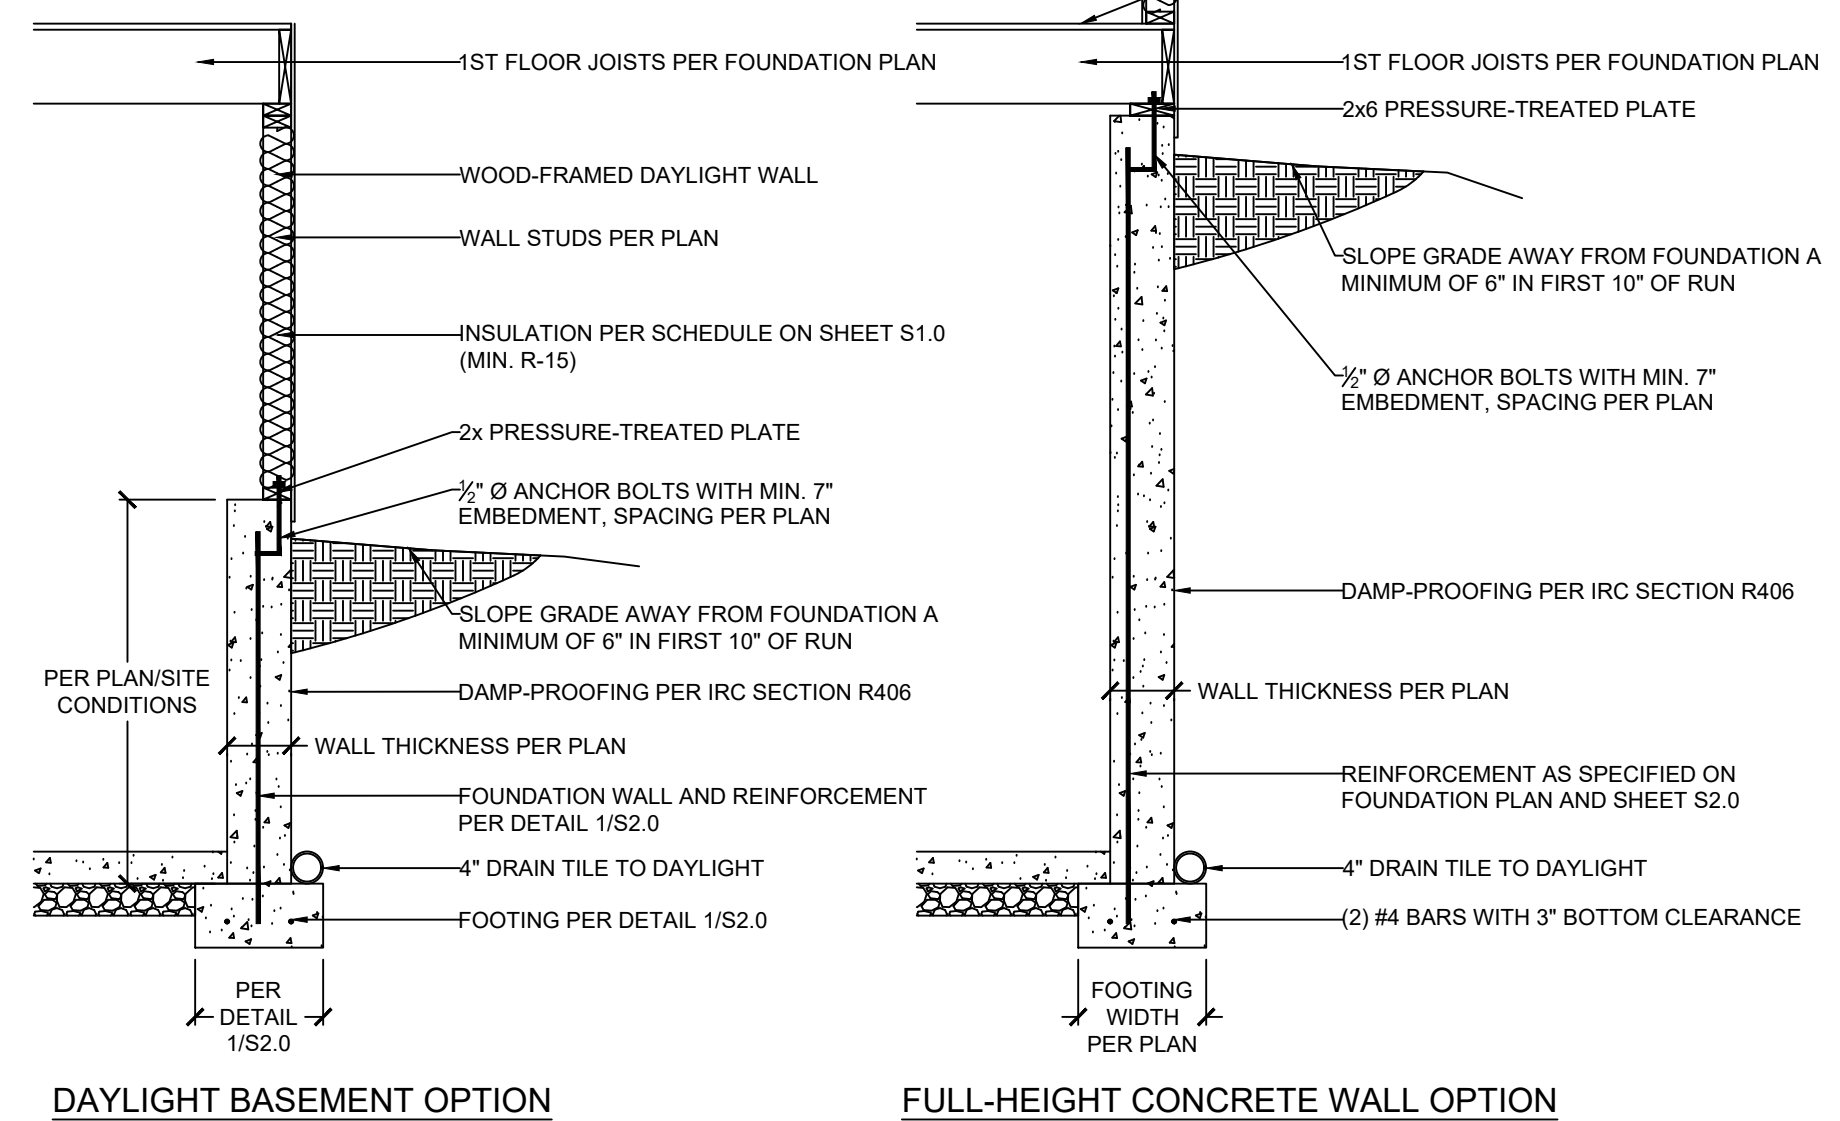

VISTA
STRUCTURAL-ENGINEERING, LLC

14718 NW DELIA STREET * PORTLAND, OREGON 97129
OFFICE: 971.255.6099 * MOBILE: 971.255.6099 *
* DENNIS@VISTASTRUCTURAL.COM * VISTASTRUCTURAL.COM

CLIENT: IQ HOME BUILDERS
JOB TITLE: RHF068 SPEC
LOT 68, THE RETREAT AT HOOK FARMS
LOCATION: 2026 SW RED BARN LN
LEE'S SUMMIT, MISSOURI

STATE OF MISSOURI
DENNIS HEIER
NUMBER: PE-201801772
PROFESSIONAL ENGINEER
2-7-2022


NO.	DATE	REVISION	BY

DRAWING TITLE
FRAMING DETAILS


ENGINEER: DMH CHECKED BY: DMH
JOB NO.: 4276 DRAWN BY: DMH
DATE: 02-07-22
SHEET NUMBER

S3.1


RELEASE FOR CONSTRUCTION AS NOTED ON PLANS Development Services/LEE'S SUMMIT, MISSOURI

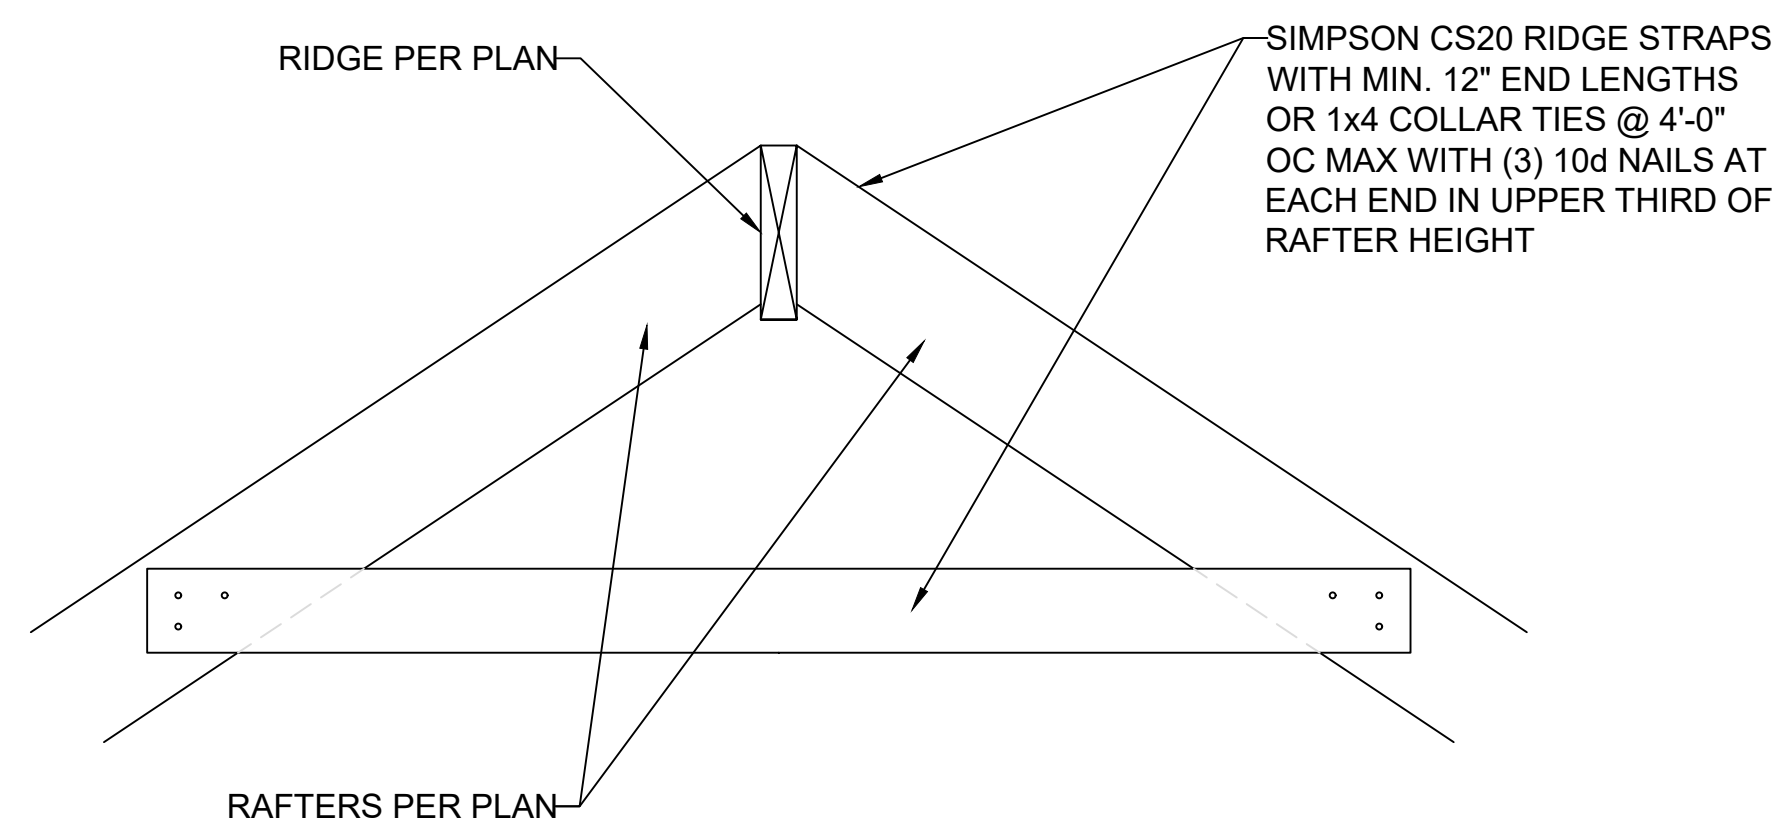


1 RIDGE FRAMING DETAIL
S3.2 SCALE: 1" = 1'-0" (18x24) OR 1/2" = 1'-0" (24x36)

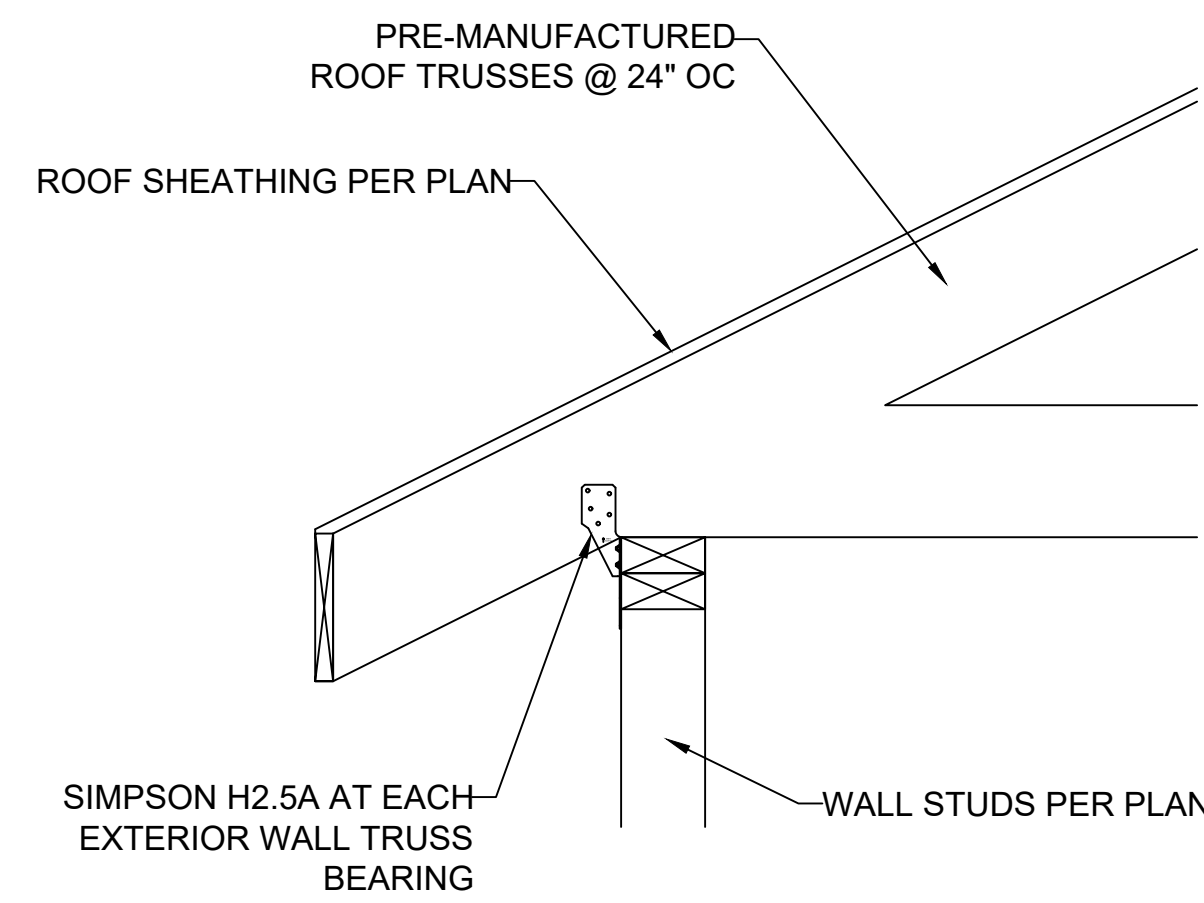


2 TRUSS CONNECTION TO EXT. WALL BEARING
S3.2 SCALE: 1" = 1'-0" (18x24) OR 1/2" = 1'-0" (24x36)

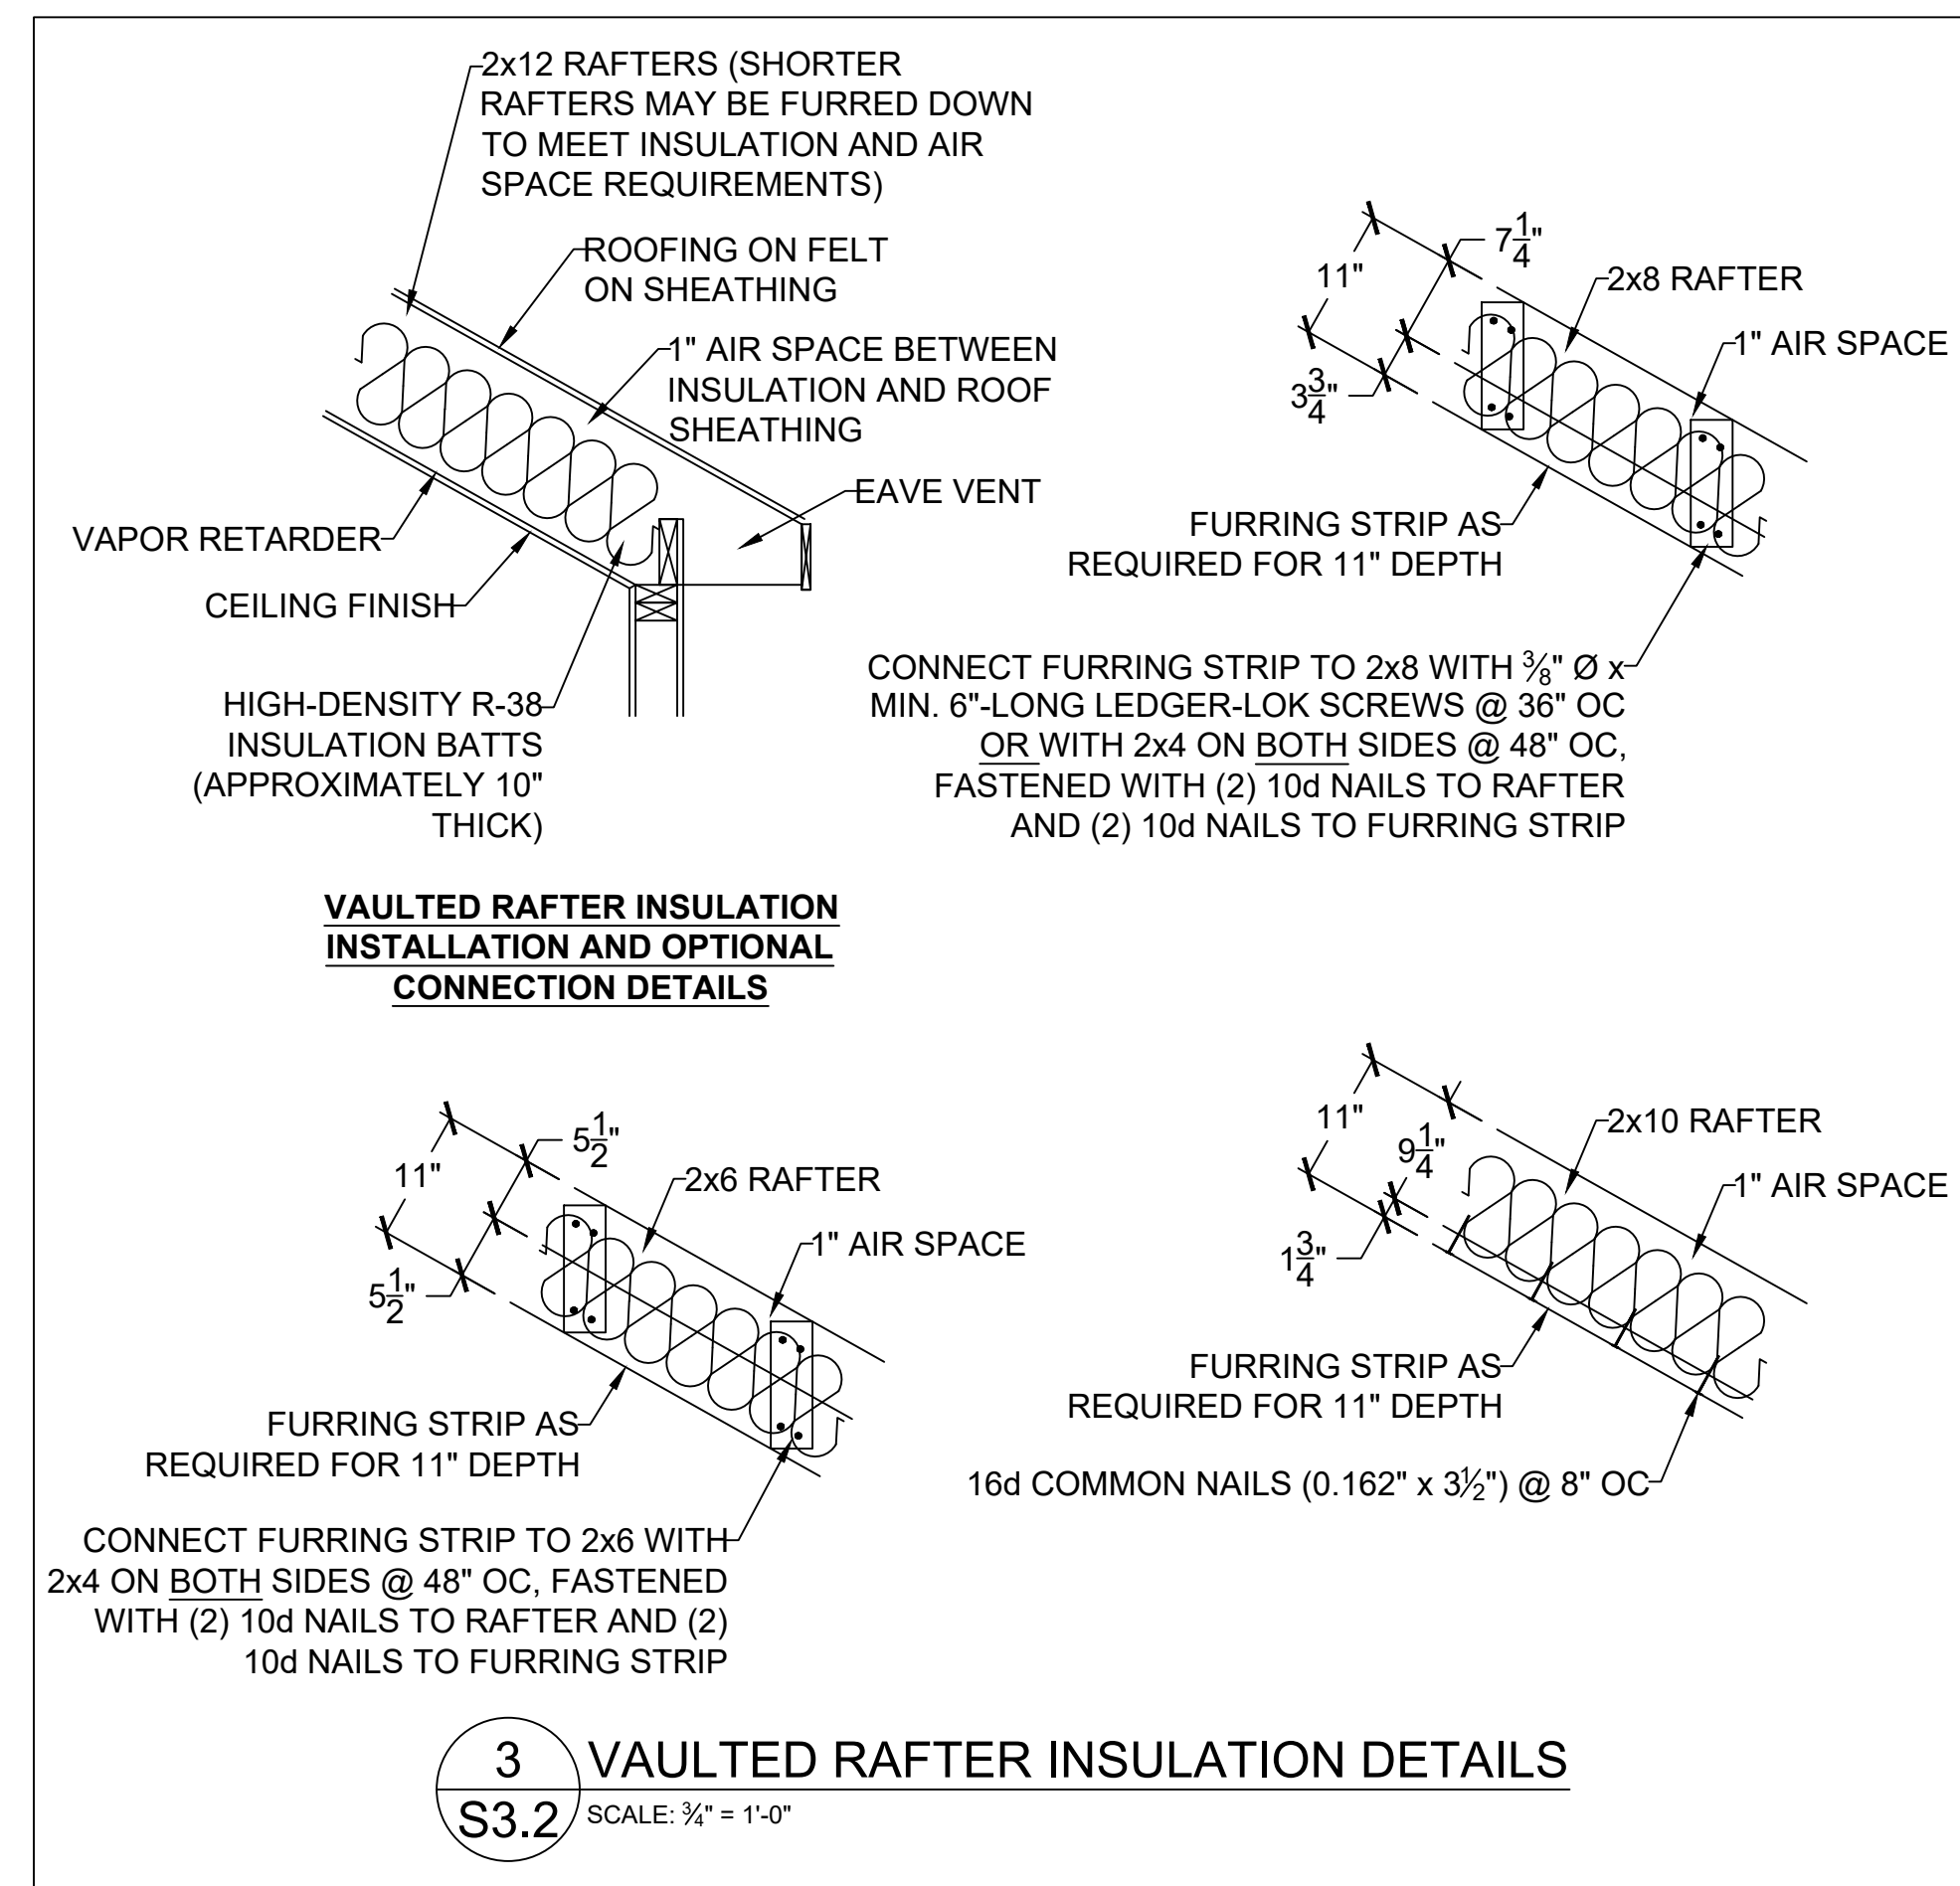


3 VAULTED RAFTER INSULATION DETAILS
S3.2 SCALE: 3/4" = 1'-0"

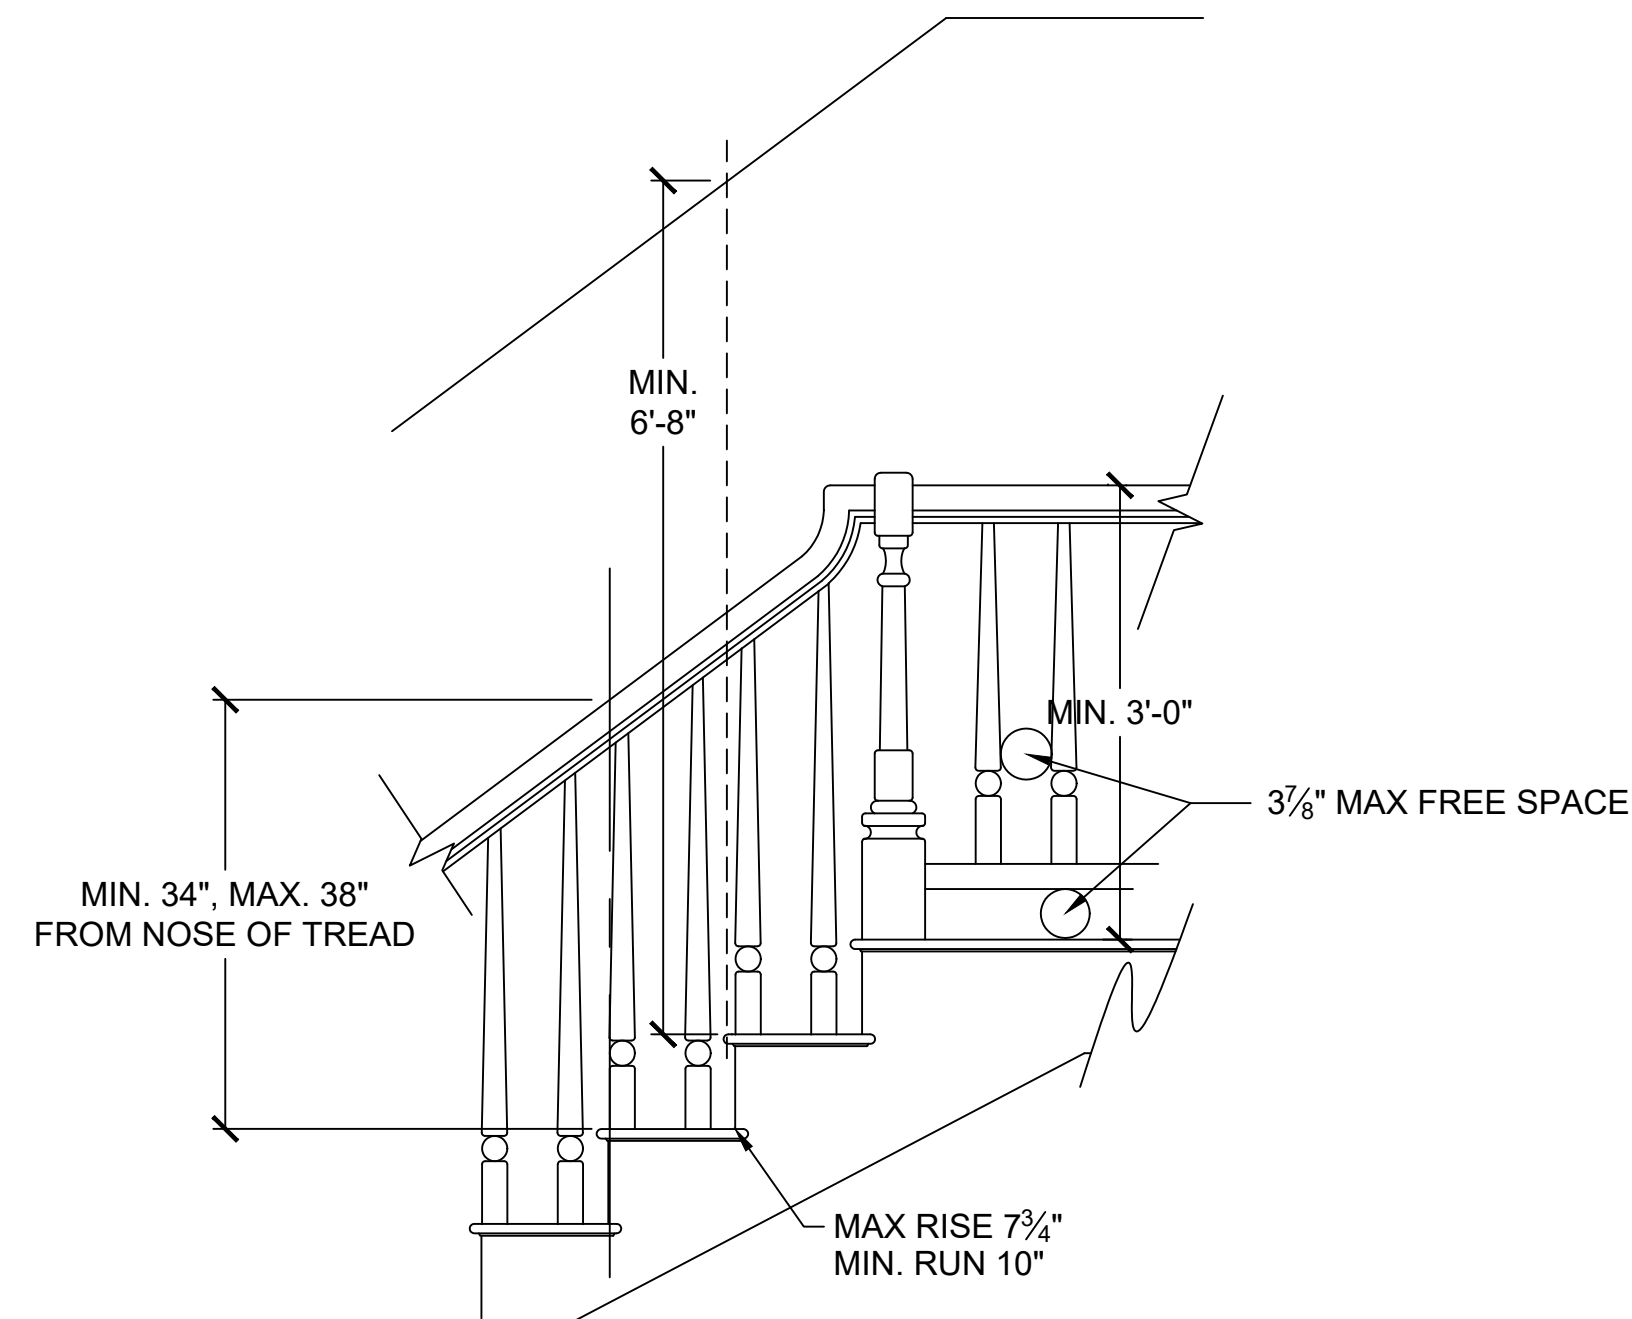


4 STAIR AND HANDRAIL/GUARDRAIL DETAIL
S3.2 SCALE: 1/2" = 1'-0" (18x24) OR 3/4" = 1'-0" (24x36)

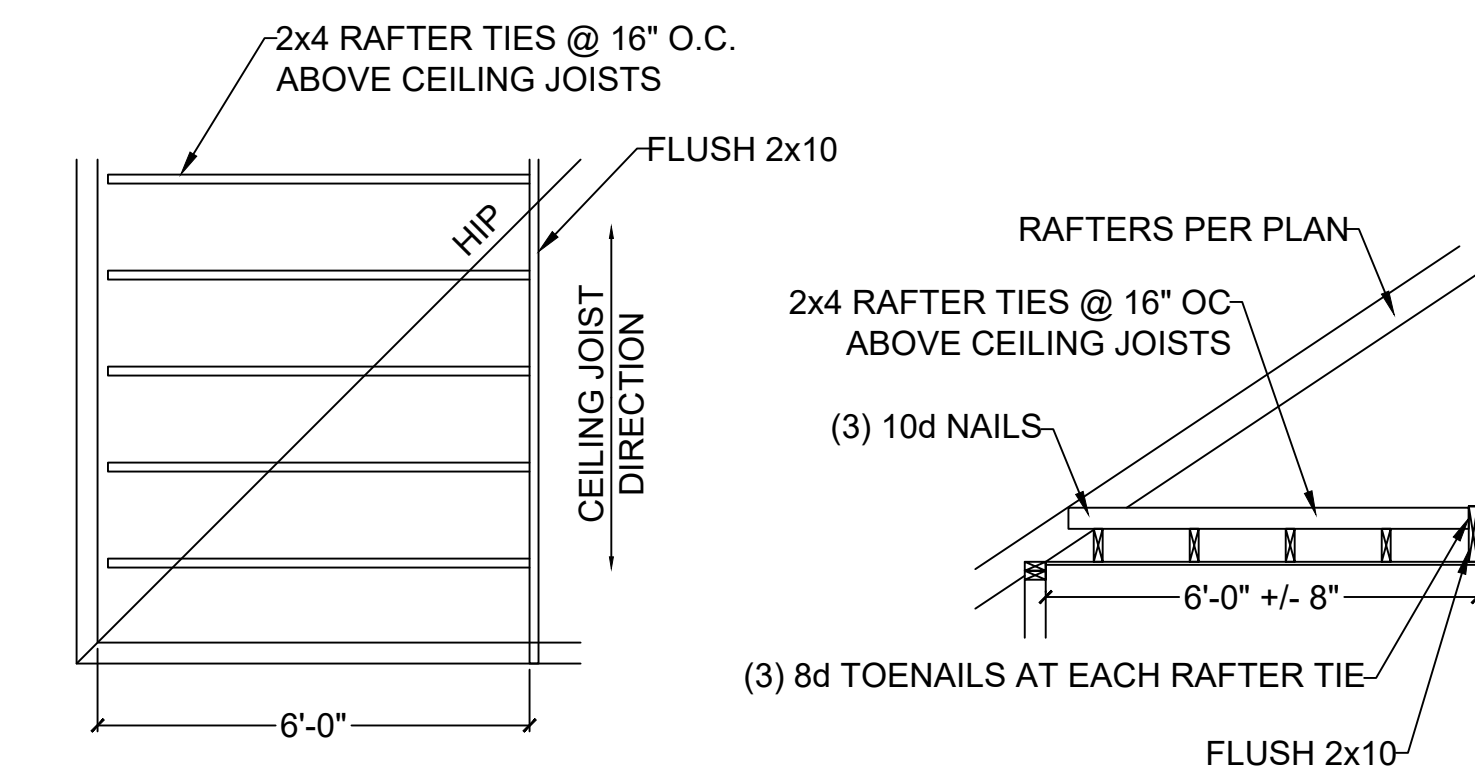


5 RAFTER TIES AT CEILING JOISTS PERP. TO RAFTERS
S3.2 SCALE: 1/2" = 1'-0" (18x24) OR 3/4" = 1'-0" (24x36)

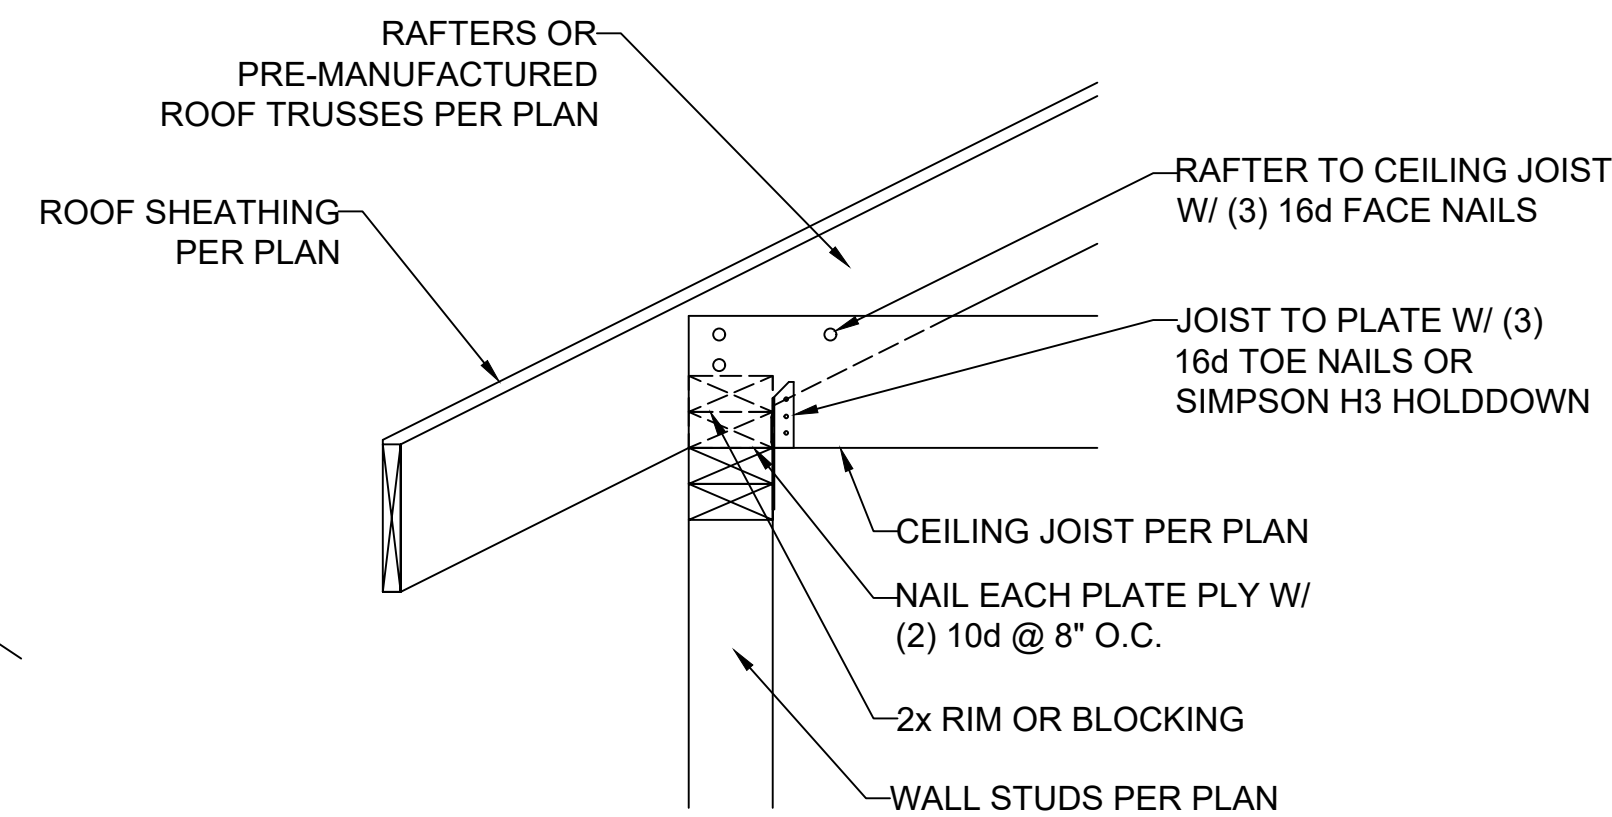

7 RAFTER BEARING OPTION DETAIL
S3.2 SCALE: 1" = 1'-0" (18x24) OR 1/2" = 1'-0" (24x36)

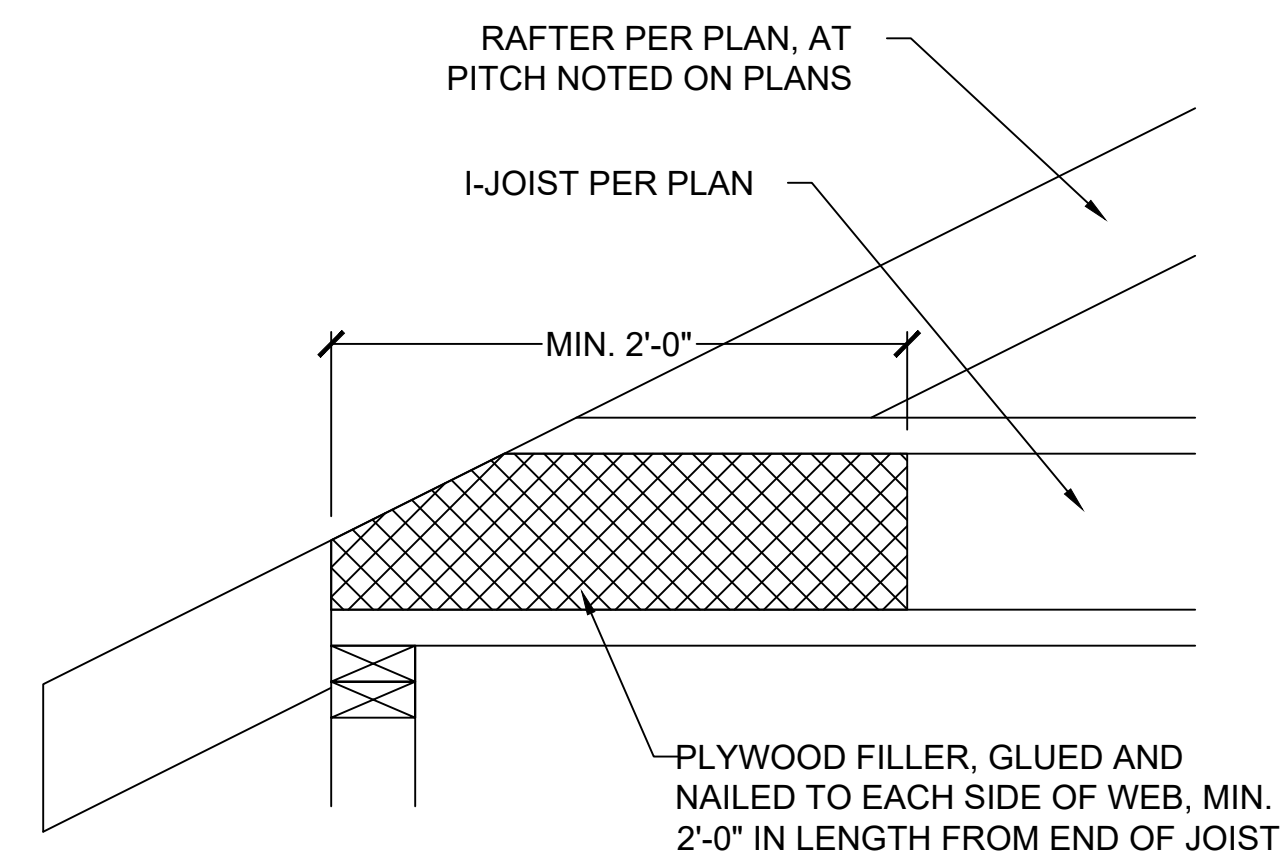

9 COPED I-JOIST REINFORCEMENT
S3.2 SCALE: 1" = 1'-0" (18x24) OR 1/2" = 1'-0" (24x36)

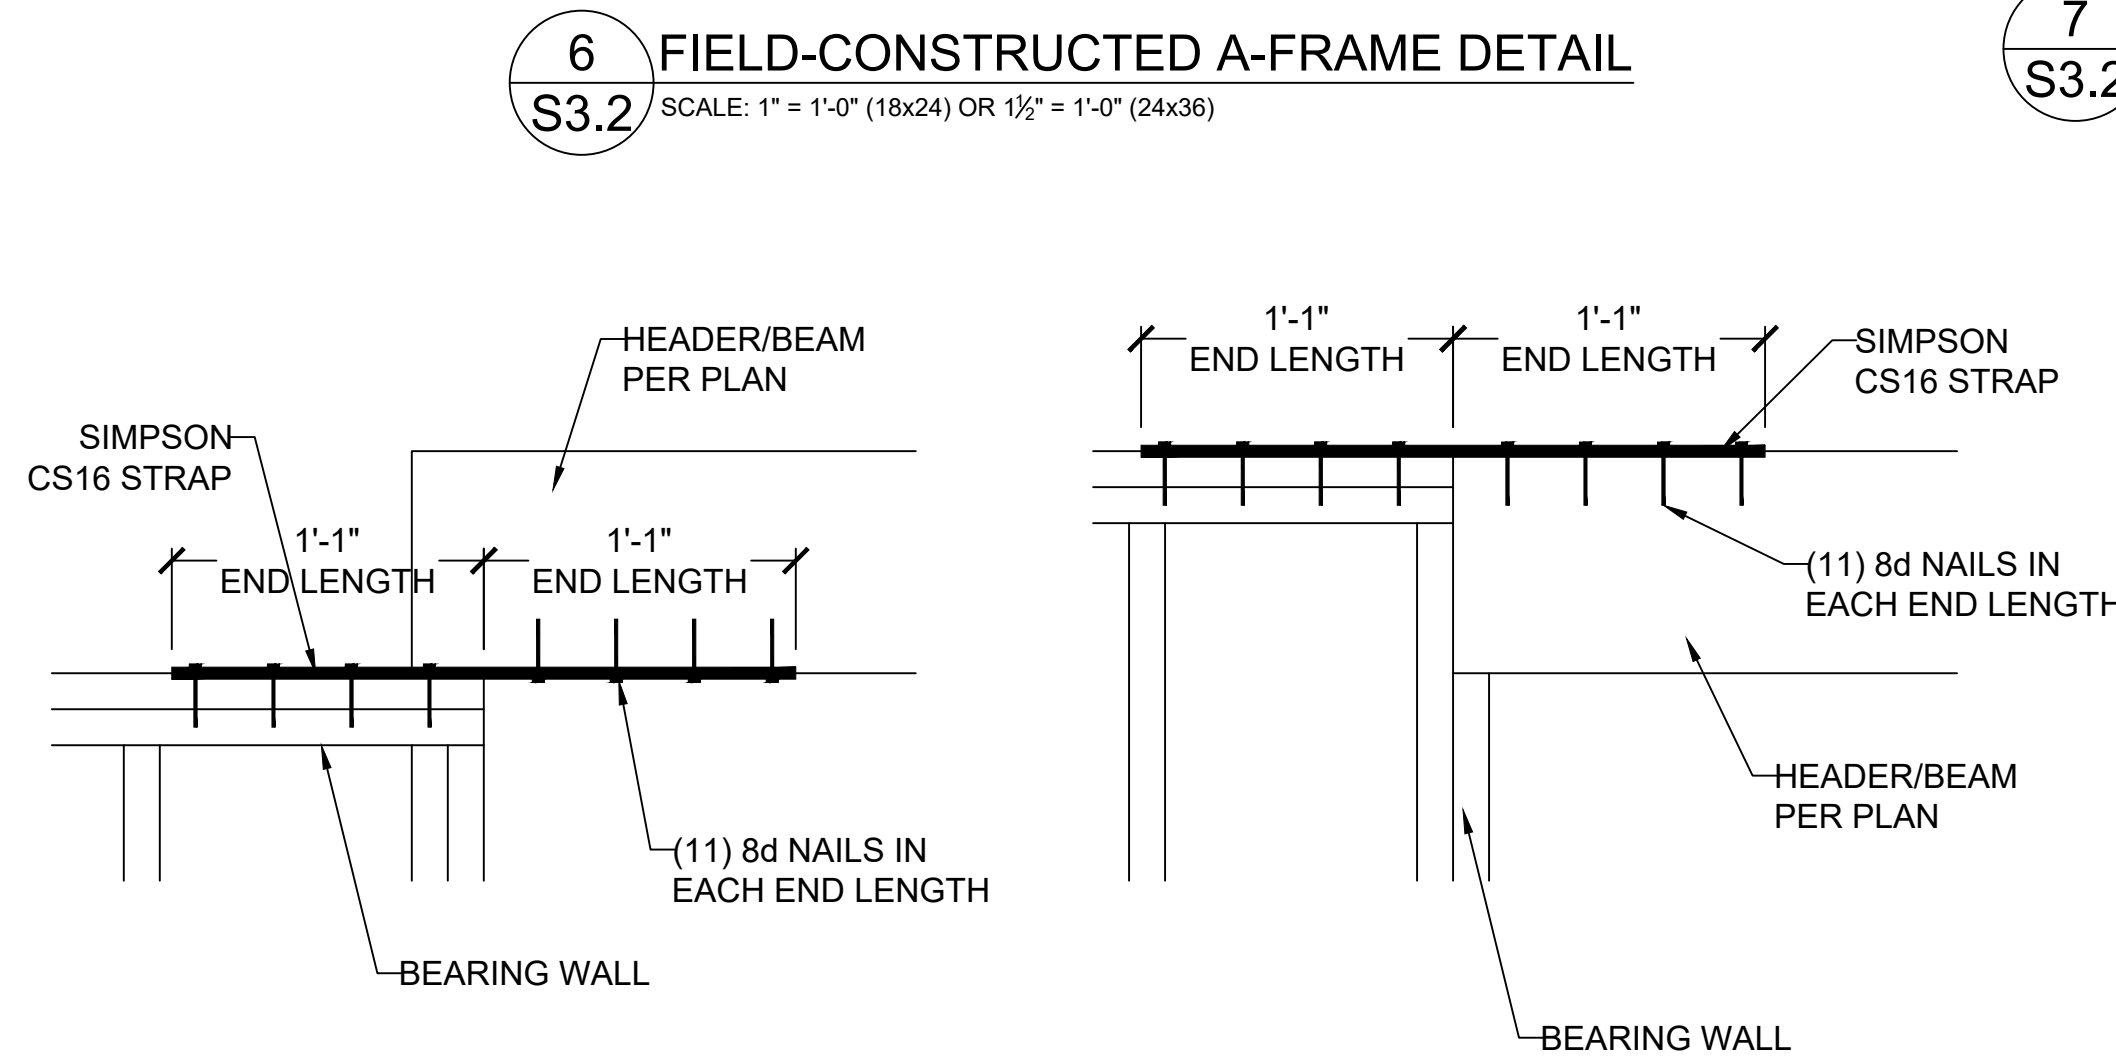

10 HEADER/BEAM CONNECTION OPTIONS AT OUTDOOR/OPEN SPACE
S3.2 SCALE: 1" = 1'-0" (18x24) OR 1/2" = 1'-0" (24x36)

HEIGHT (FT.)	SPACING (INCHES O.C.)			
	24	16	12	8
SUPPORTING A ROOF ONLY				
10 OR LESS	2x4	2x4	2x4	2x4
12	2x6	2x4	2x4	2x4
14	2x6	2x6	2x6	2x4
16	2x6	2x6	2x6	2x4
18	DR	2x6	2x6	2x6
20	DR	DR	2x6	2x6
SUPPORTING ONE FLOOR AND A ROOF				
10 OR LESS	2x6	2x4	2x4	2x4
12	2x6	2x6	2x6	2x4
14	2x6	2x6	2x6	2x6
16	DR	2x6	2x6	2x6
18	DR	2x6	2x6	2x6
20	DR	DR	2x6	2x6
SUPPORTING TWO FLOORS AND A ROOF				
10 OR LESS	2x6	2x6	2x4	2x4
12	2x6	2x6	2x6	2x6
14	2x6	2x6	2x6	2x6
16	DR	2x6	2x6	2x6
18	DR	DR	2x6	2x6
20	DR	DR	DR	2x6

NOTES:
1) DR = DESIGN REQUIRED
2) UTILITY, STANDARD, STUD AND #3 GRADE LUMBER OF ANY SPECIES ARE NOT PERMITTED
3) THIS TABLE DOES NOT APPLY FOR STUDS SUPPORTING MEMBERS WITH A TRIB. LENGTH GREATER THAN 6'-0"

8 MAXIMUM ALLOWABLE LENGTH OF WOOD WALL STUDS (IRC TABLE 602.3.1)
S3.2

VISTA
ENGINEERING, LLC

14718 NW DELIA STREET * PORTLAND, OREGON 97129
OFFICE: 971.255.6099 * MOBILE: 971.255.6099 *
DENNIS@VISTASTRUCTURAL.COM * VISTASTRUCTURAL.COM

CLIENT: IQ HOME BUILDERS
JOB TITLE: RHF068 SPEC
LOT 68, THE RETREAT AT HOOK FARMS
LOCATION: 2026 SW RED BARN LN
LEE'S SUMMIT, MISSOURI

STATE OF MISSOURI
DENNIS HEIER
NUMBER: PE-2018001772
PROFESSIONAL ENGINEER
2-7-2022


NO.	DATE	REVISION	BY

DRAWING TITLE
FRAMING DETAILS

ENGINEER: DMH CHECKED BY: DMH
JOB NO.: 4276 DRAWN BY: DMH
DATE: 02-07-22
SHEET NUMBER

S3.2


RELEASE FOR CONSTRUCTION
FOR REVIEW ONLY
NO PERMANENT RECORDS
LEE'S SUMMIT, MISSOURI

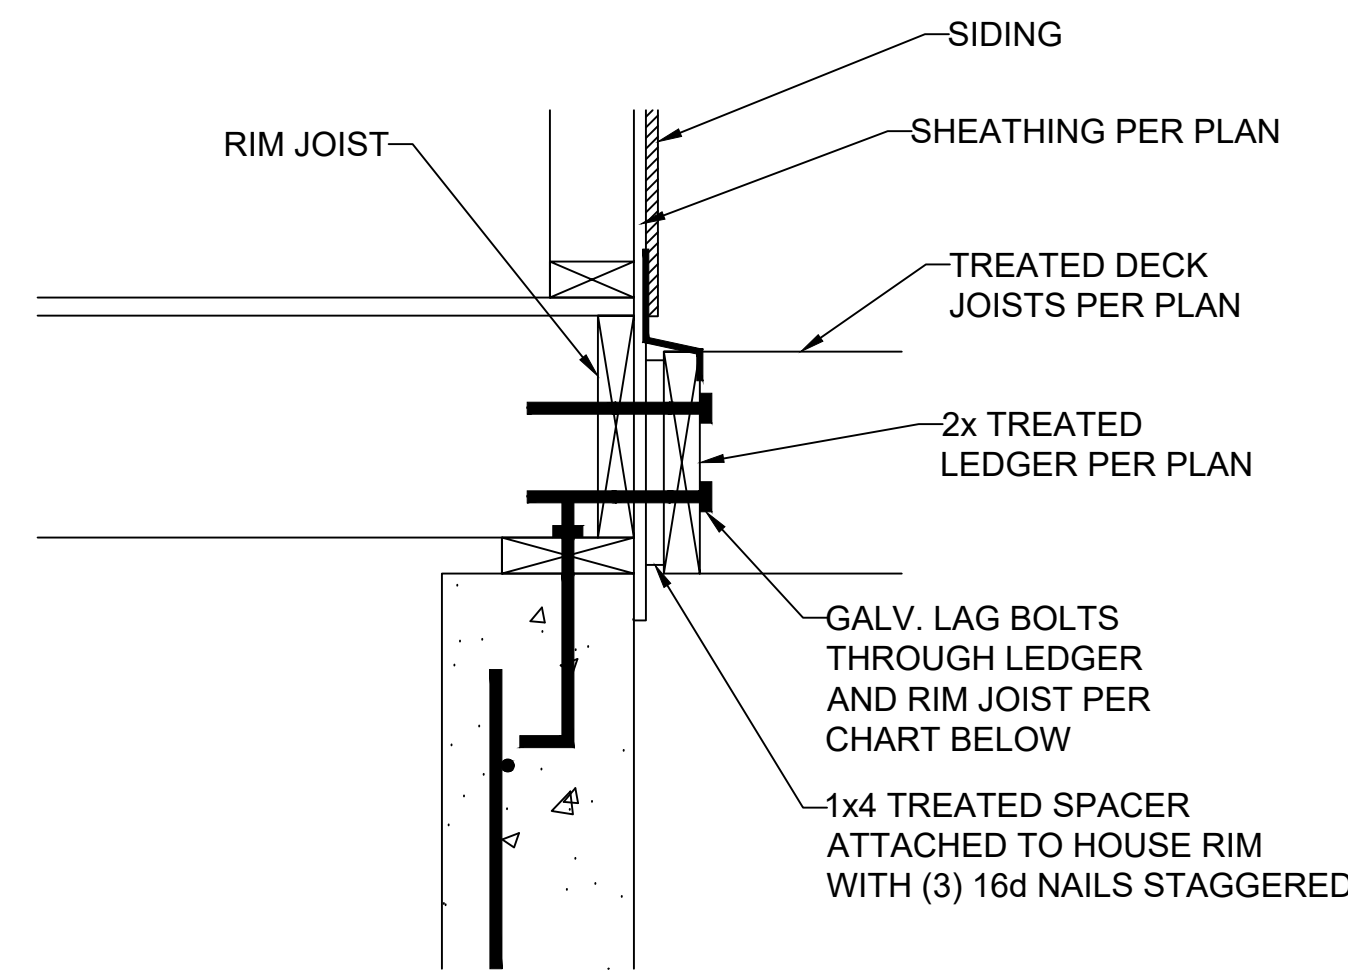


DECK LEDGER ATTACHMENT GUIDE

DECK JOIST SPAN	1/2" Ø GALV. LAG OR 3/8" Ø LEDGER-LOK SPACING
10'-0" OR LESS	16" OC
10'-0" - 13'-11"	12" OC OR @ 16" OC DOUBLED EVERY OTHER
14'-0" - 18'-0"	8" OC OR @ 16" OC DOUBLED


1 LEDGER ATTACHMENT
S3.3 SCALE: 1" = 1'-0" (18x24) OR 1/2" = 1'-0" (24x36)

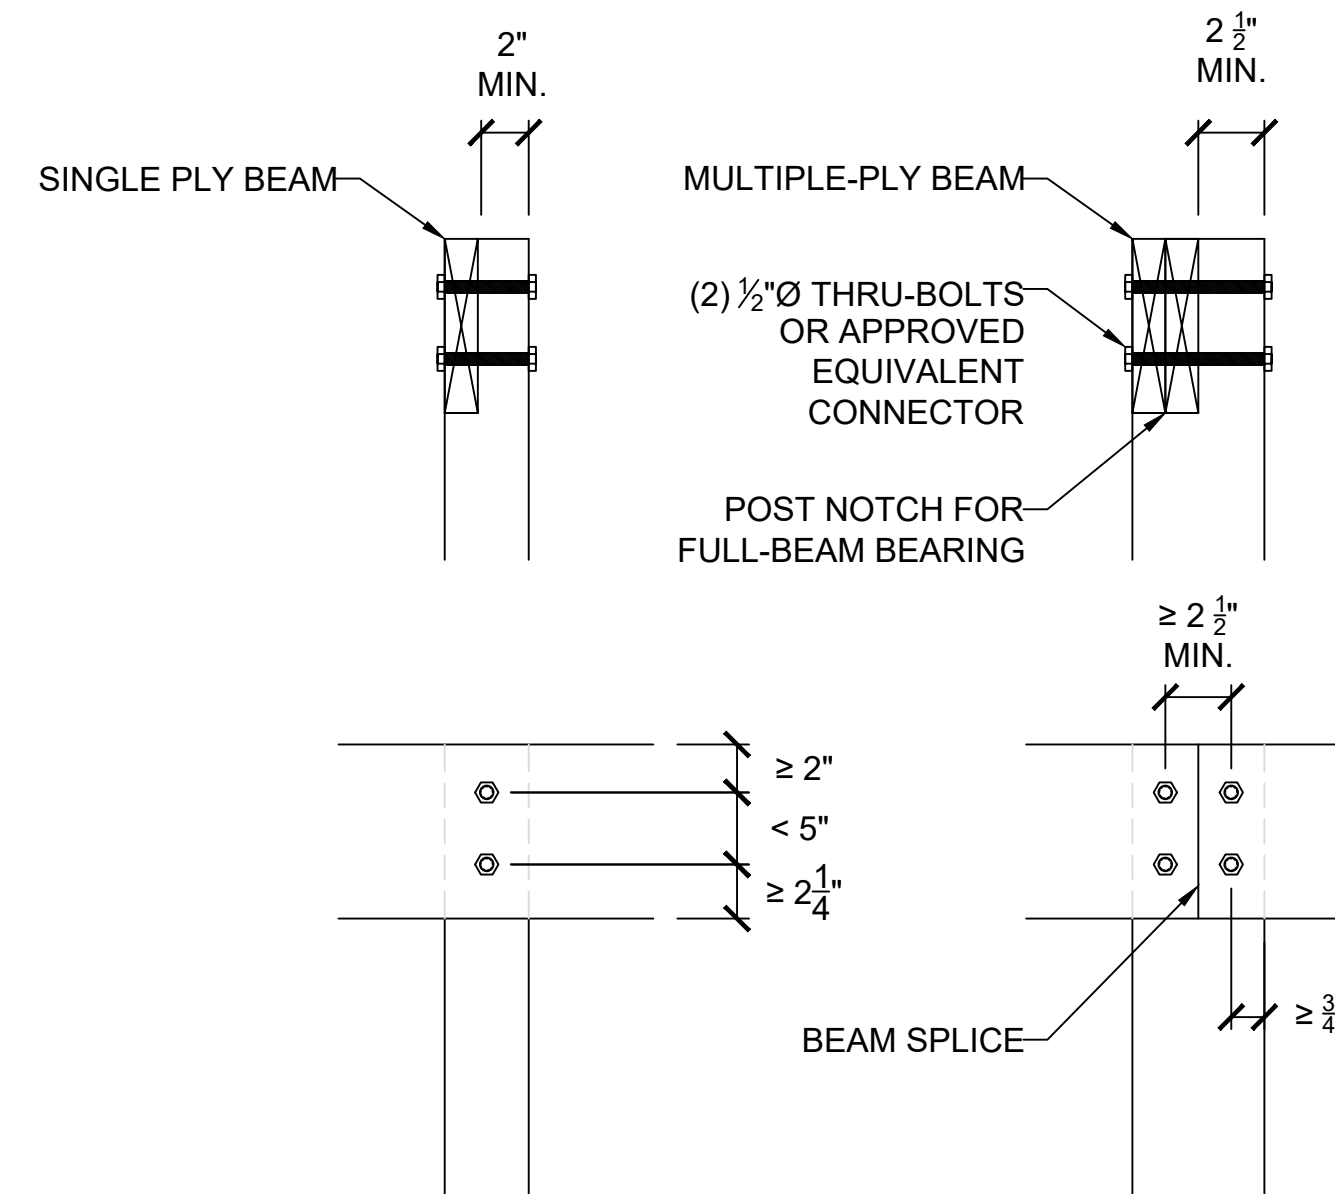


5 LET-IN (COVERED) DECK BEAM CONNECTION
S3.3 SCALE: 1" = 1'-0" (18x24) OR 1/2" = 1'-0" (24x36)

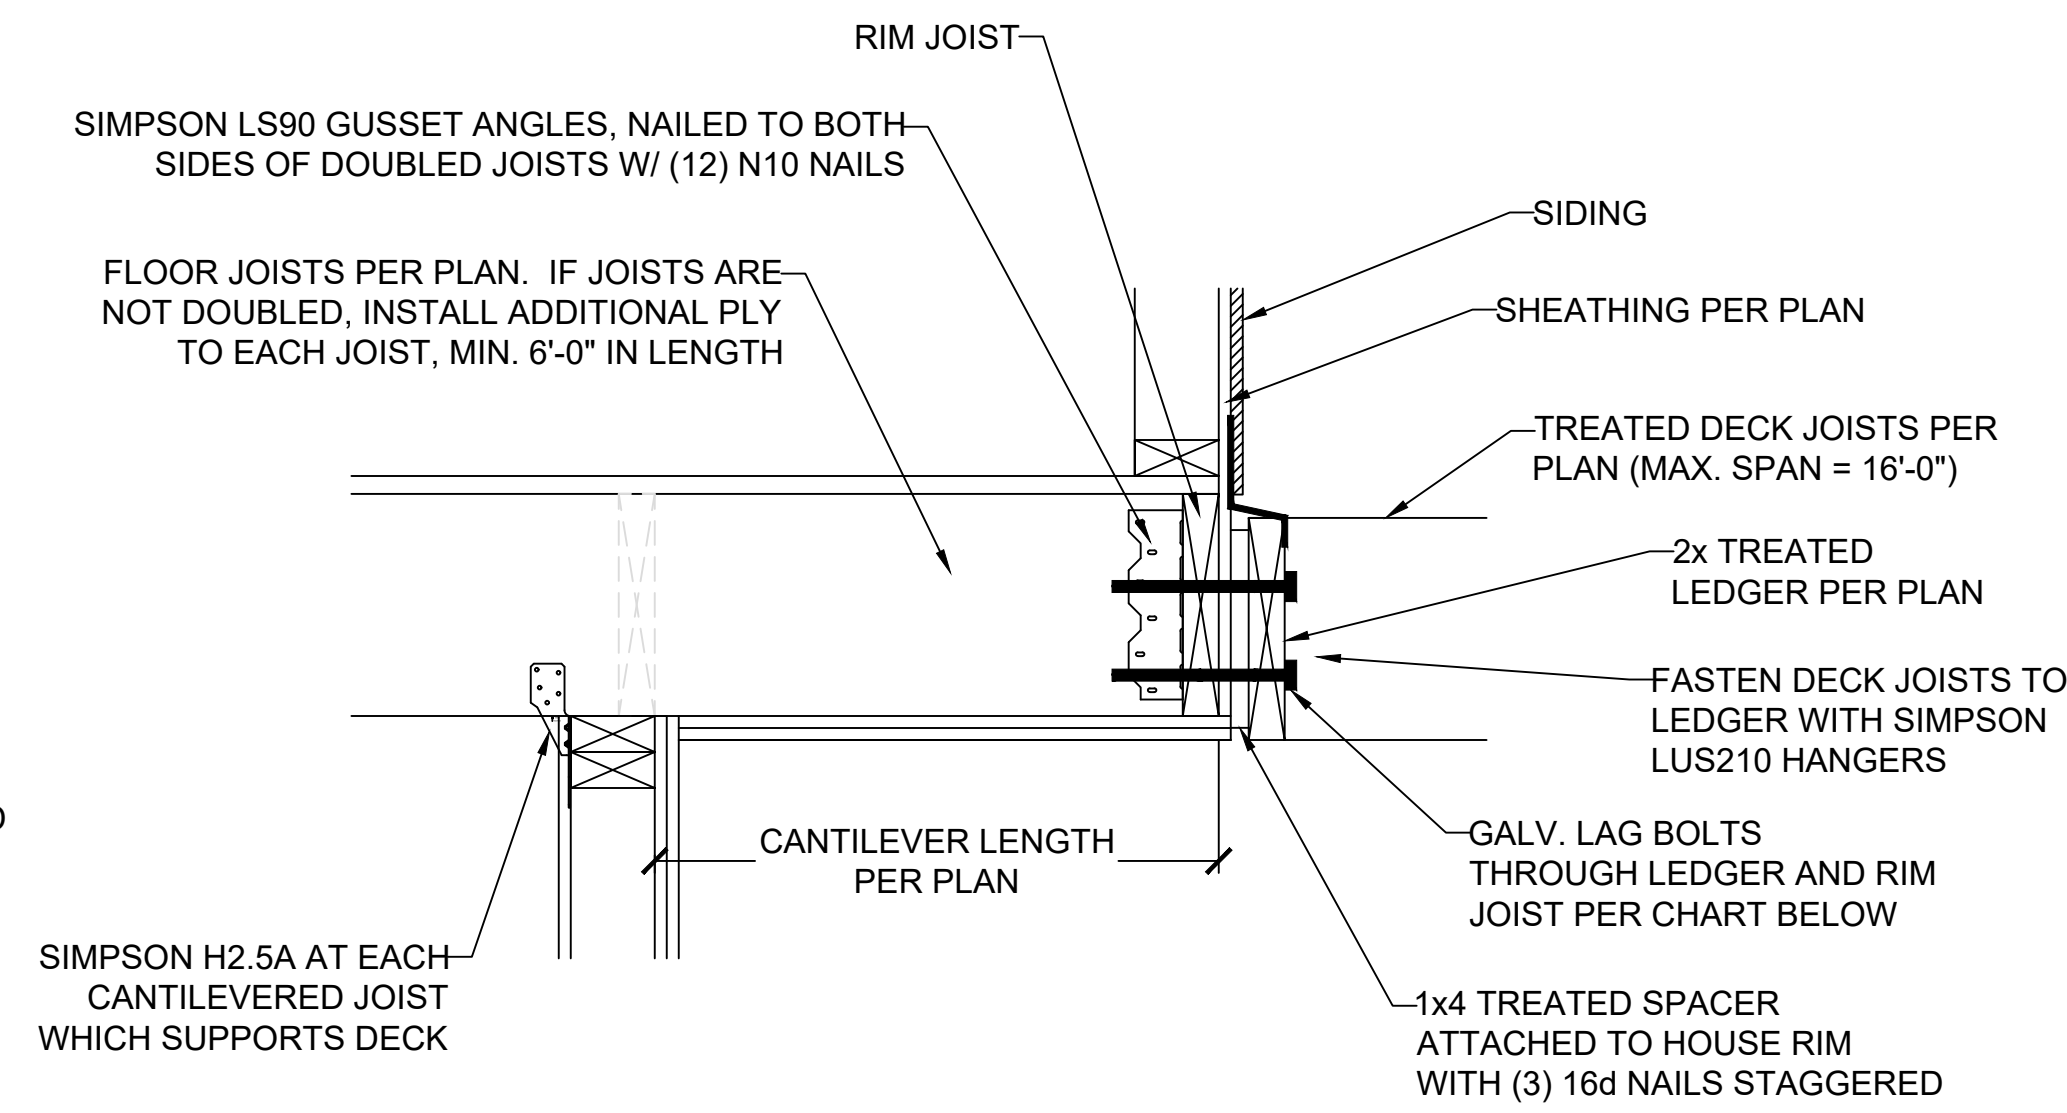


2 CANTILEVER WITH DECK ATTACHMENT
S3.3 SCALE: 1" = 1'-0" (18x24) OR 1/2" = 1'-0" (24x36)

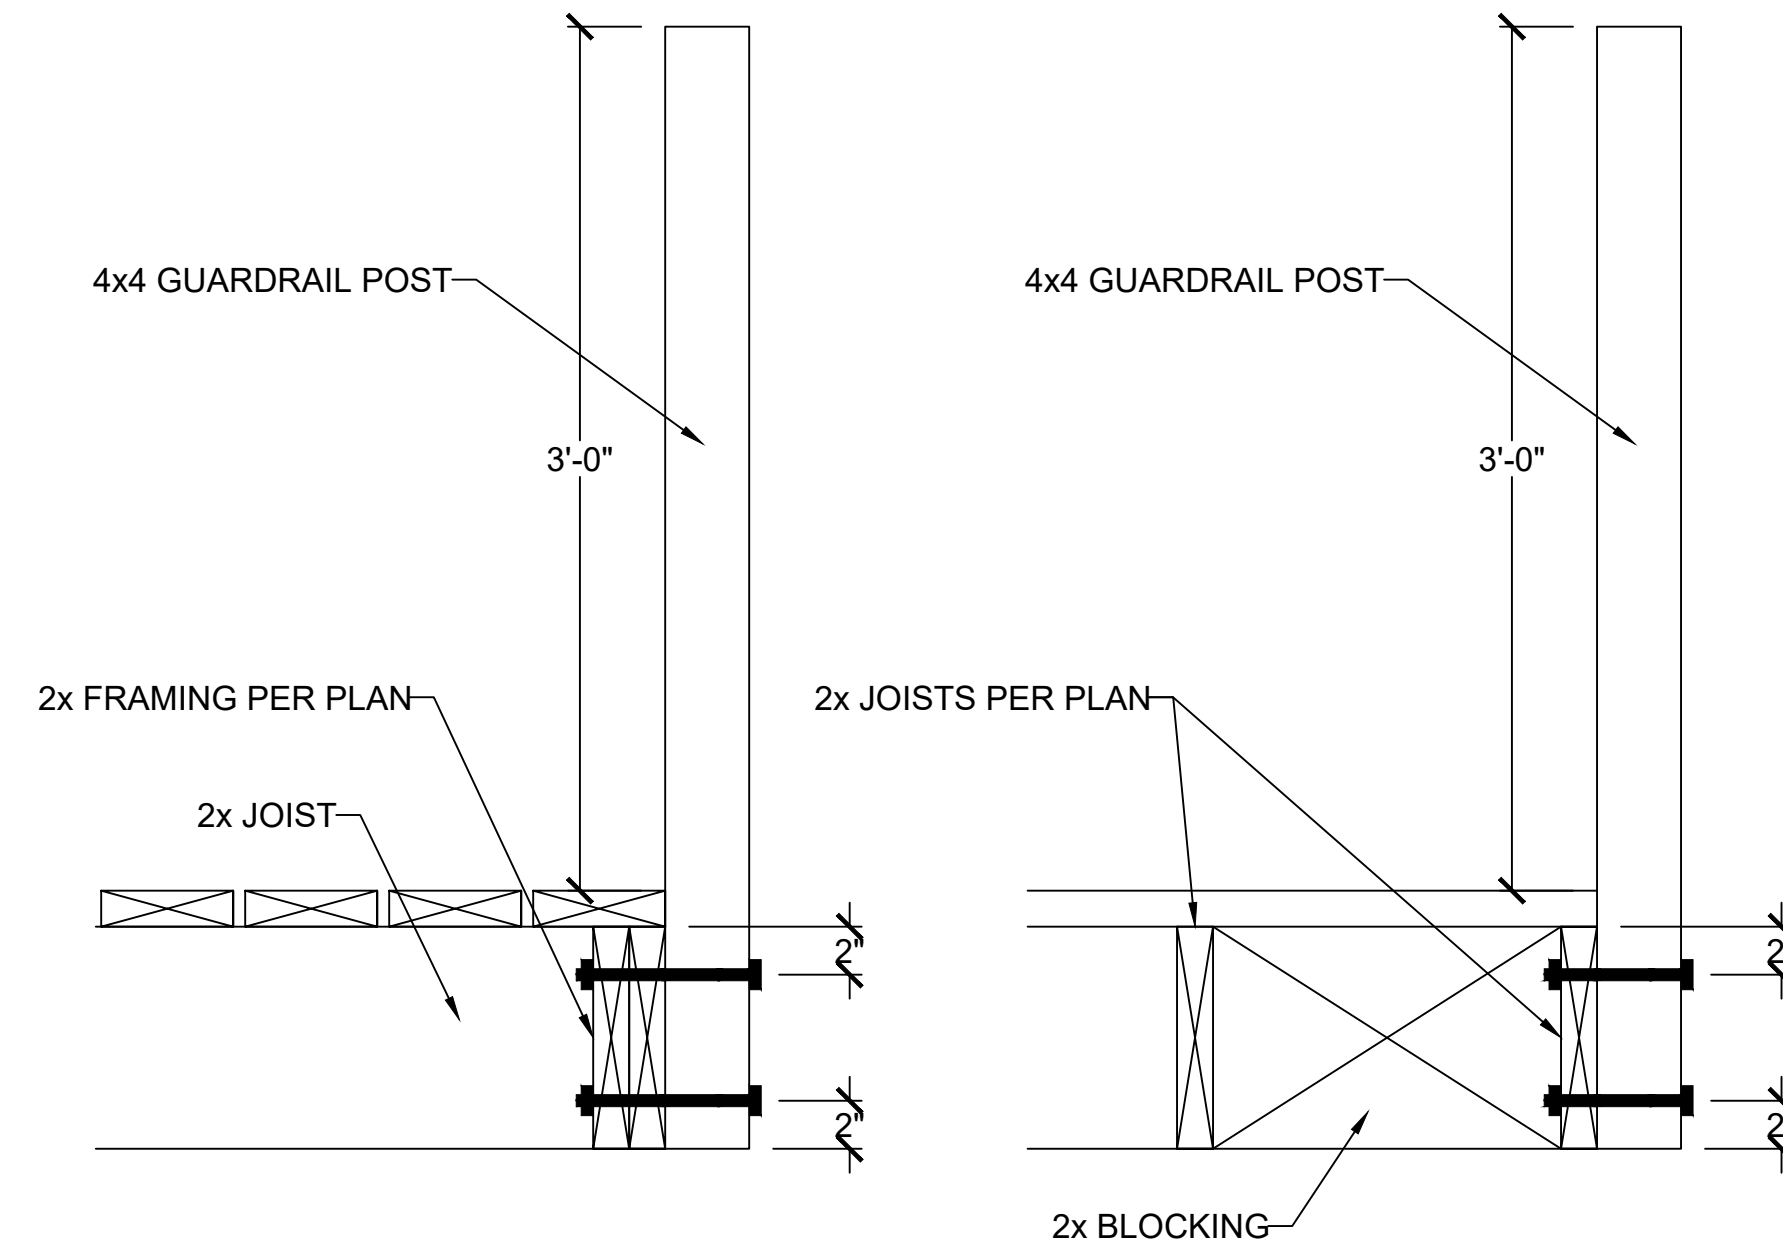


6 GUARDRAIL CONNECTION
S3.3 SCALE: 1" = 1'-0" (18x24) OR 1/2" = 1'-0" (24x36)

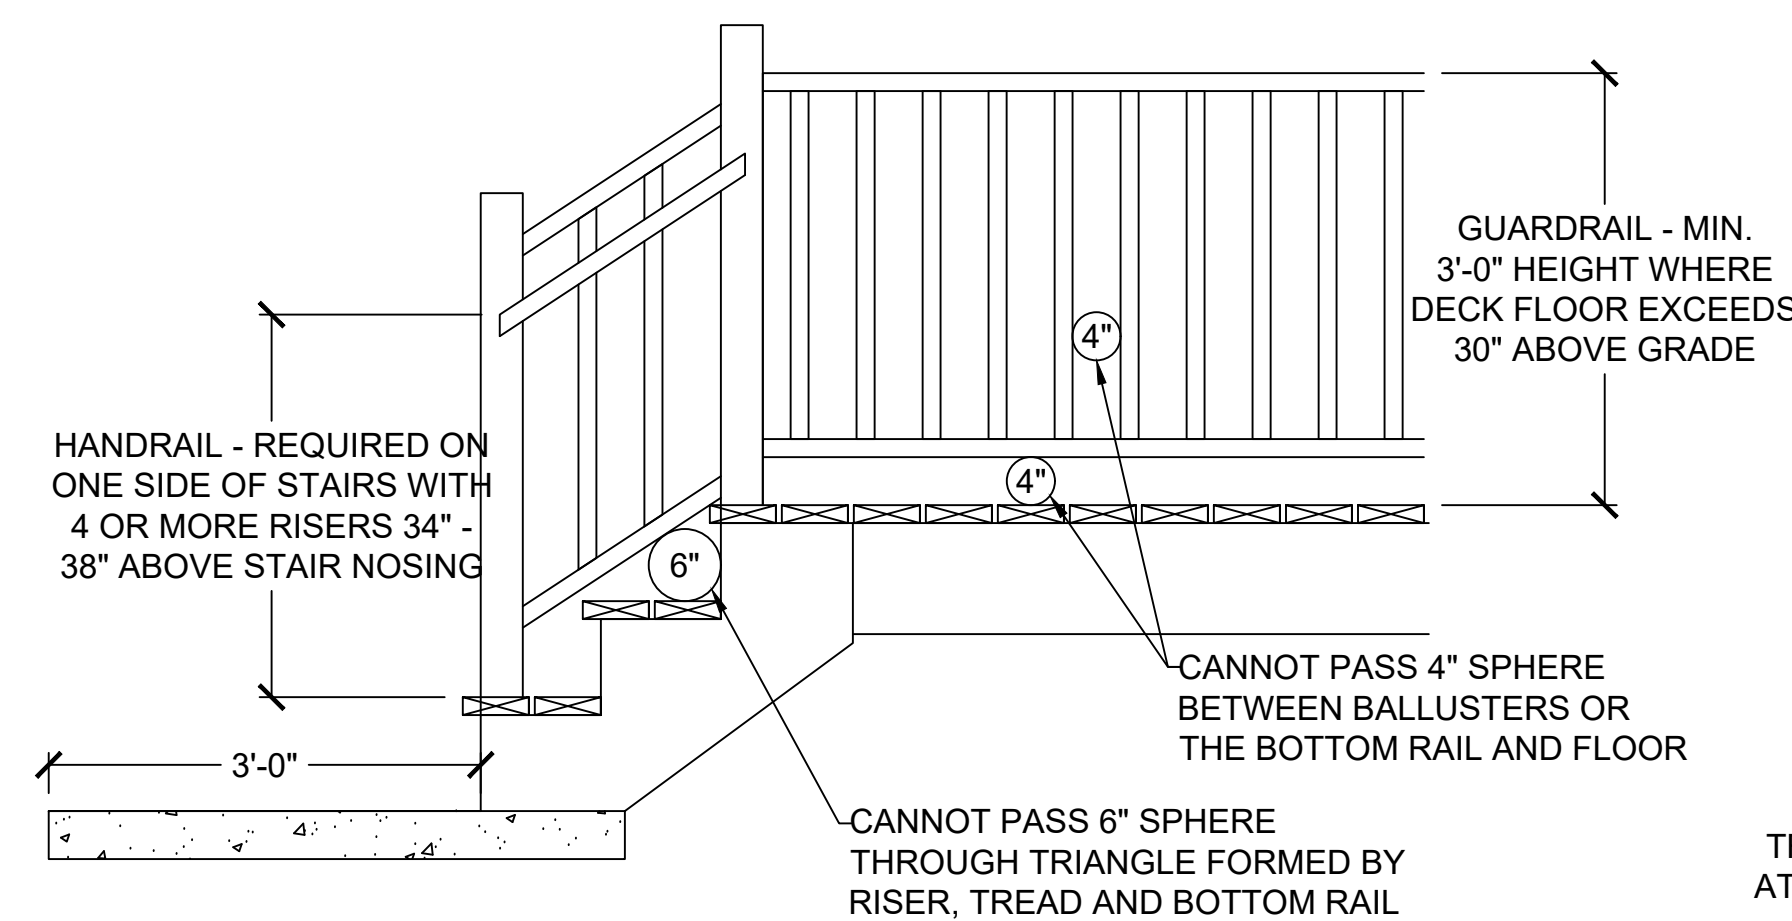


8 GUARDRAIL DETAIL
S3.3 SCALE: 1/2" = 1'-0" (18x24) OR 3/4" = 1'-0" (24x36)

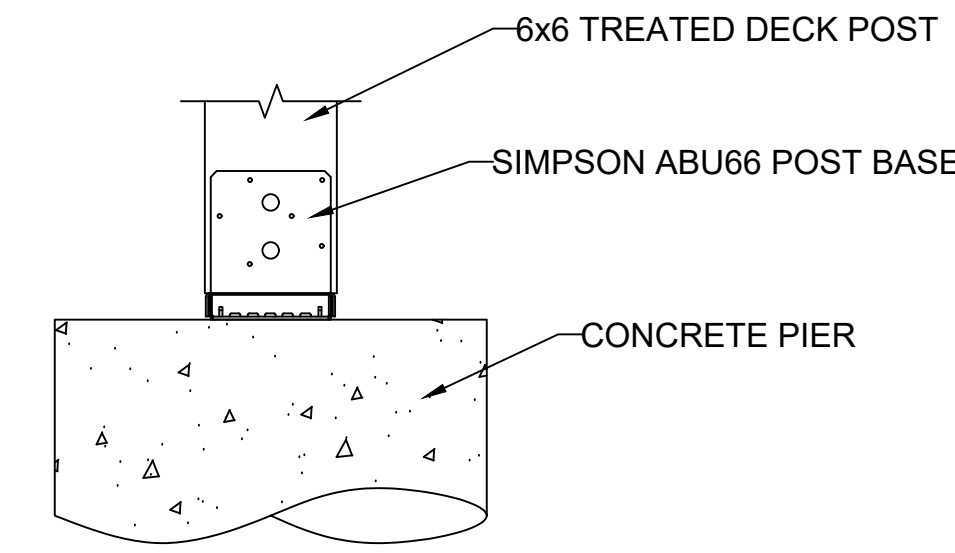


3 DECK POST BASE
S3.3 SCALE: 1" = 1'-0" (18x24) OR 1/2" = 1'-0" (24x36)

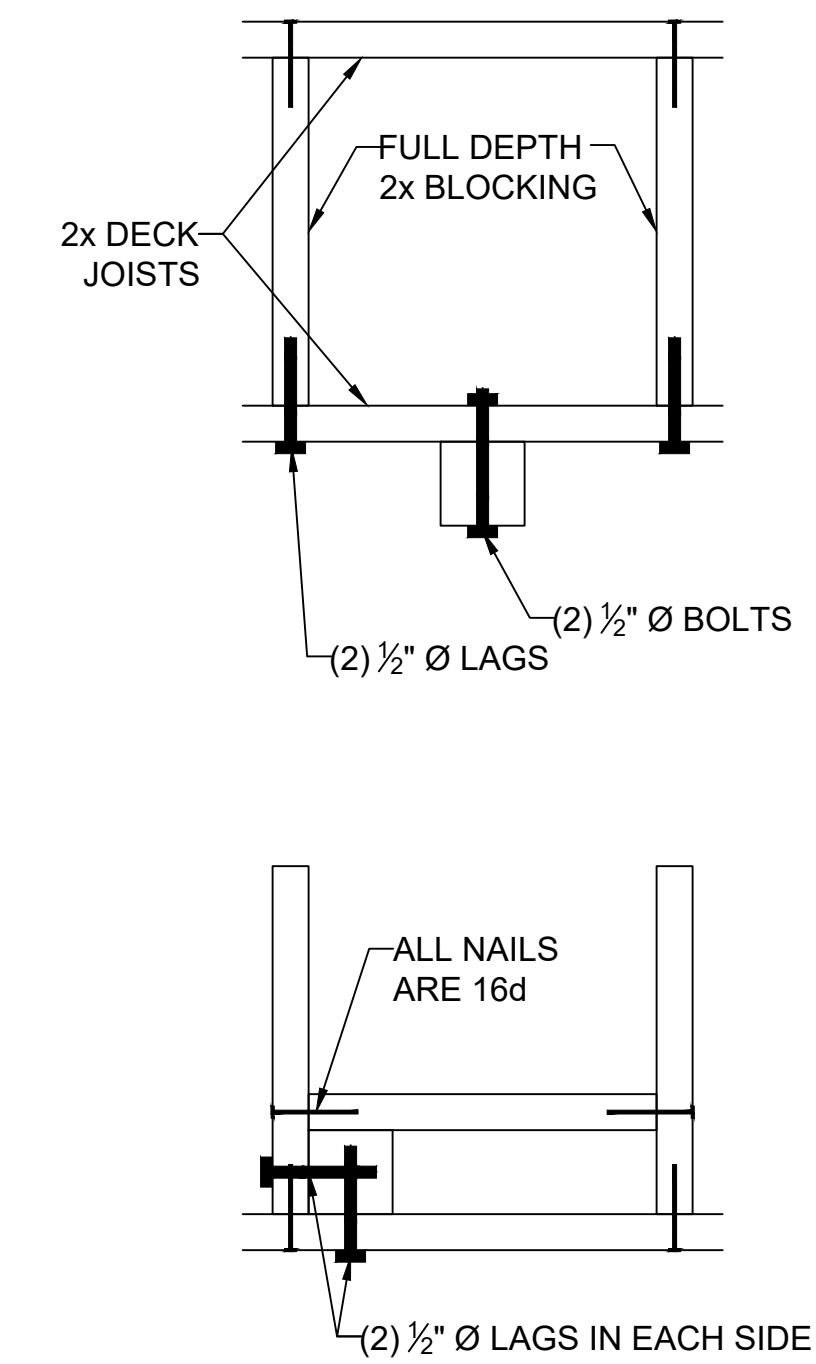

4 REINF. POST CONNECTIONS
S3.3 SCALE: 1" = 1'-0" (18x24) OR 1/2" = 1'-0" (24x36)

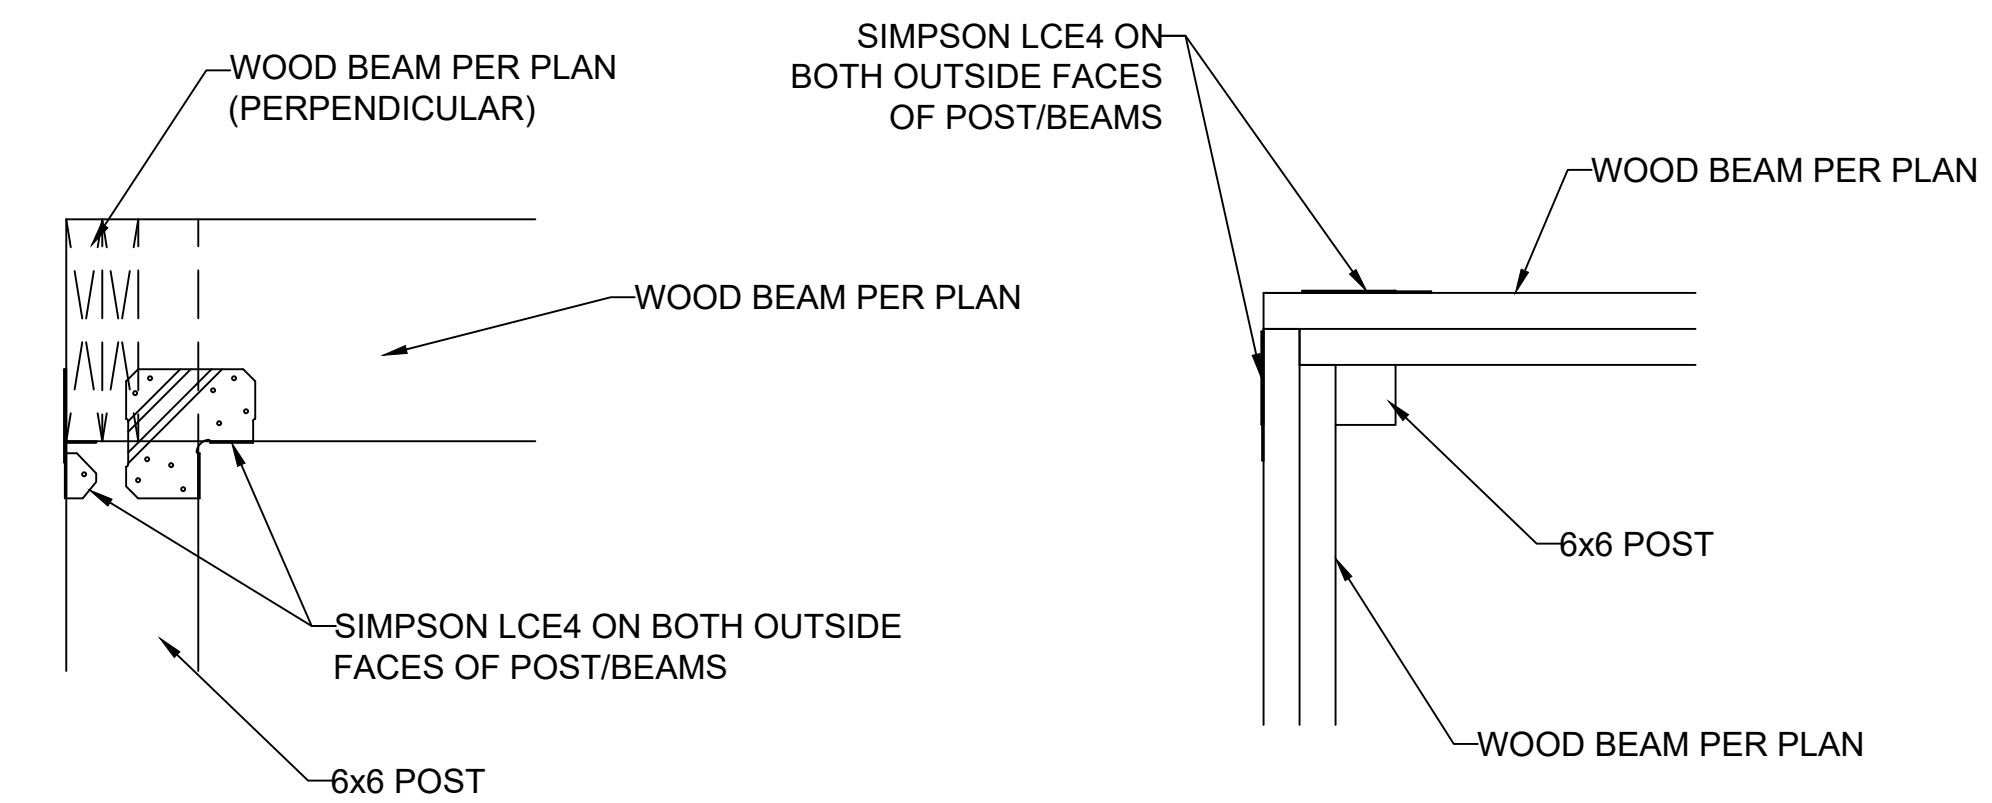

7 ALTERNATE COVERED DECK/PORCH INTERSECTION
S3.3 SCALE: 1" = 1'-0" (18x24) OR 1/2" = 1'-0" (24x36)

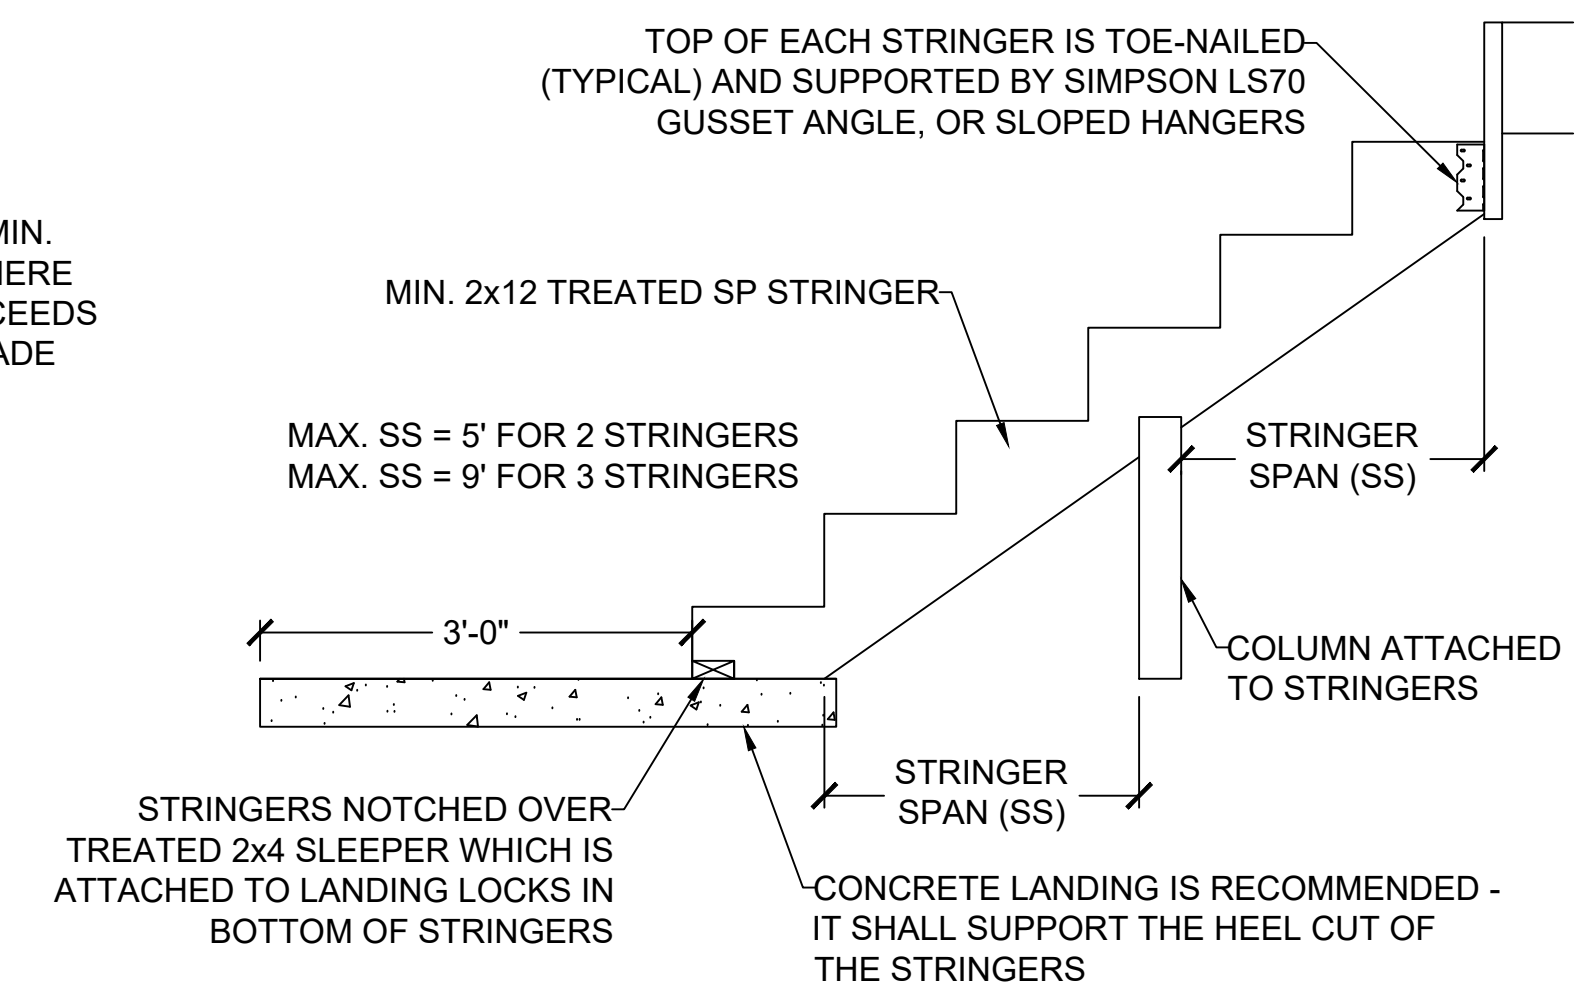

9 STAIR STRINGER DETAIL (MAX. 5' STAIR WIDTH)
S3.3 SCALE: 1/2" = 1'-0" (18x24) OR 3/4" = 1'-0" (24x36)

VISTA
ENGINEERING, LLC

14718 NW DELIA STREET * PORTLAND, OREGON 97129
OFFICE: 971.255.6099 * MOBILE: 971.255.6099 *
DENNIS@VISTASTRUCTURAL.COM * VISTASTRUCTURAL.COM

CLIENT: IQ HOME BUILDERS
JOB TITLE: RHF068 SPEC
LOT 68, THE RETREAT AT HOOK FARMS
LOCATION: 2026 SW RED BARN LN.
LEE'S SUMMIT, MISSOURI


STATE OF MISSOURI
DENNIS HEIER
NUMBER: PE-2018001772
PROFESSIONAL ENGINEER
2-7-2022

NO.	DATE	REVISION	BY


DRAWING TITLE
FRAMING DETAILS

ENGINEER: DMH CHECKED BY: DMH
JOB NO.: 4276 DRAWN BY: DMH
DATE: 02-07-22
SHEET NUMBER


S3.3

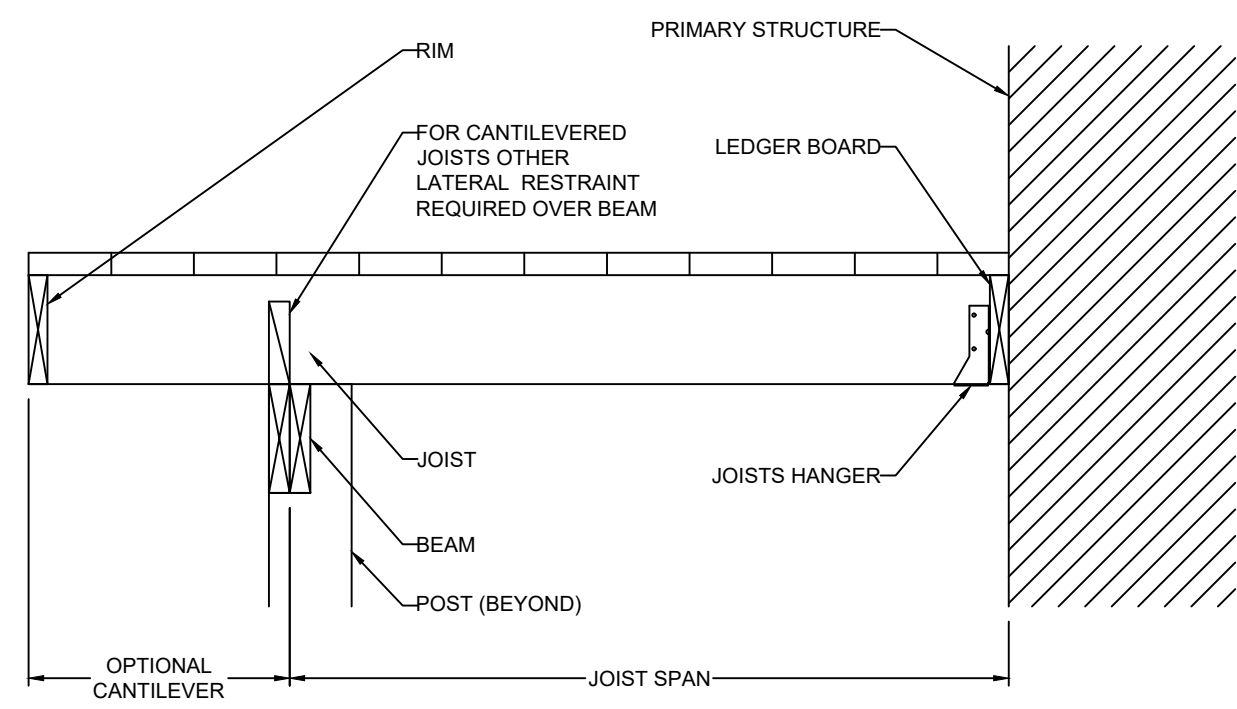


CANTILEVERED JOISTS WITH DROPPED BEAM

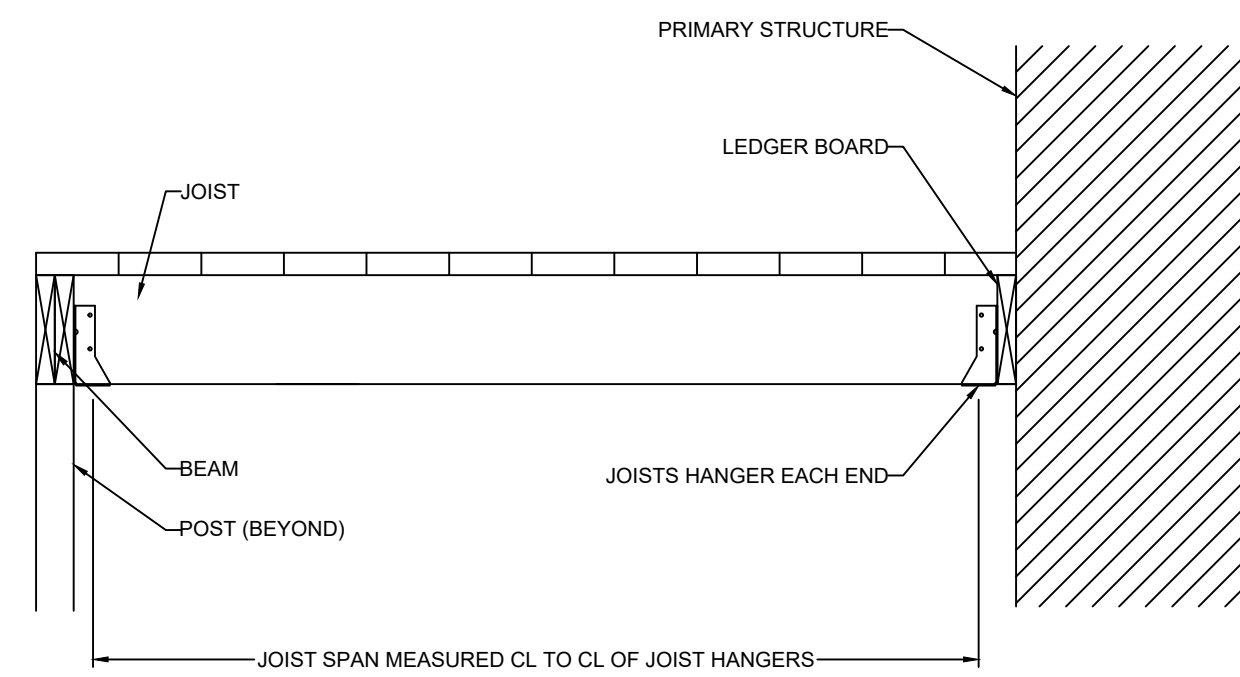

JOISTS WITH FLUSH BEAM

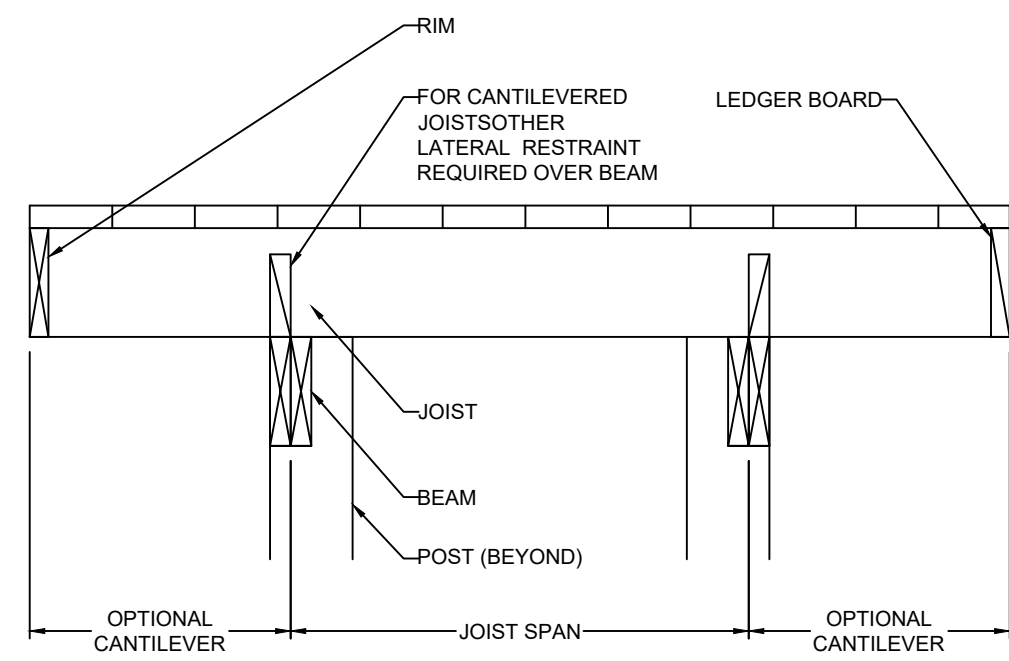


JOISTS ON FREE-STANDING DECK WITH DROPPED BEAM

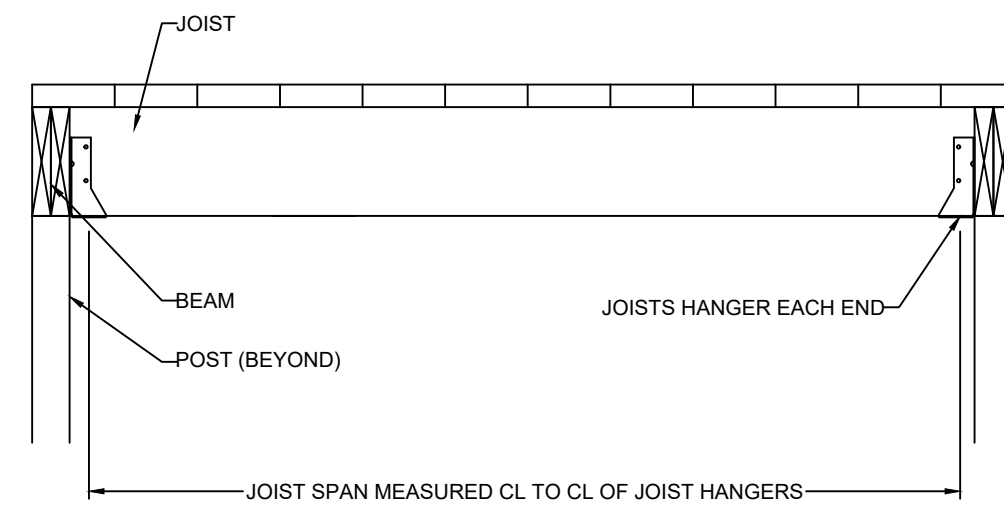


JOISTS WITH FLUSH BEAM

10 TYP. DECK JOIST SPANS
S3.3 SCALE: 1" = 1'-0" (18x24) OR 1/2" = 1'-0" (24x36)

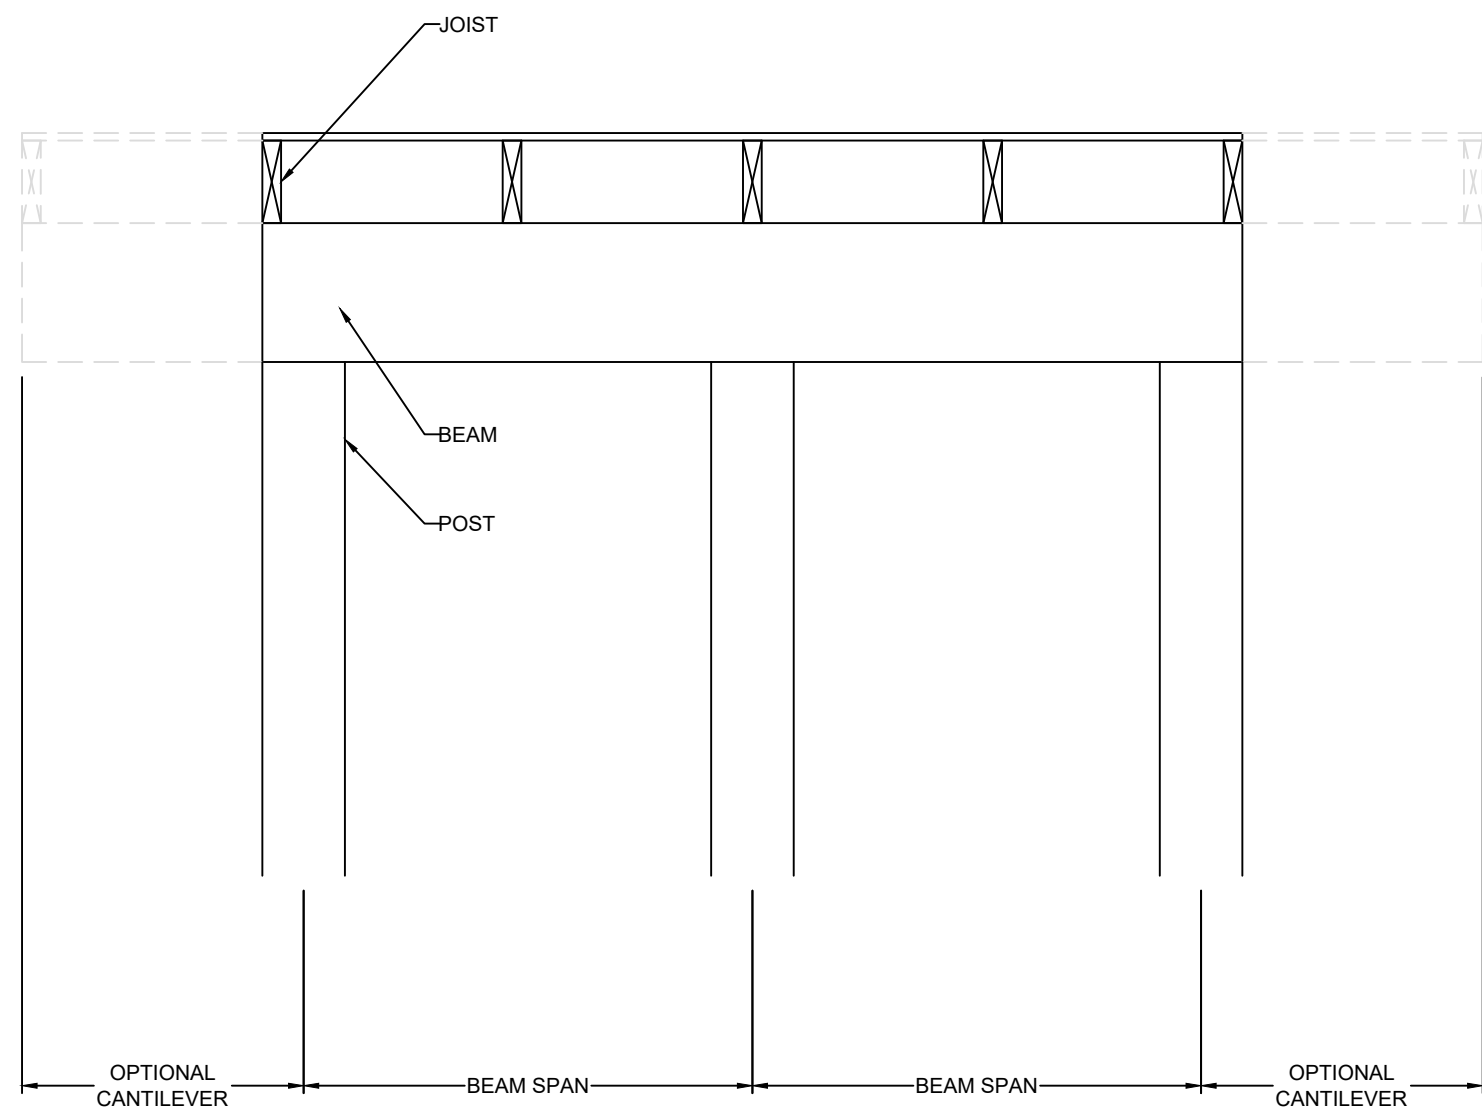

DROPPED BEAM

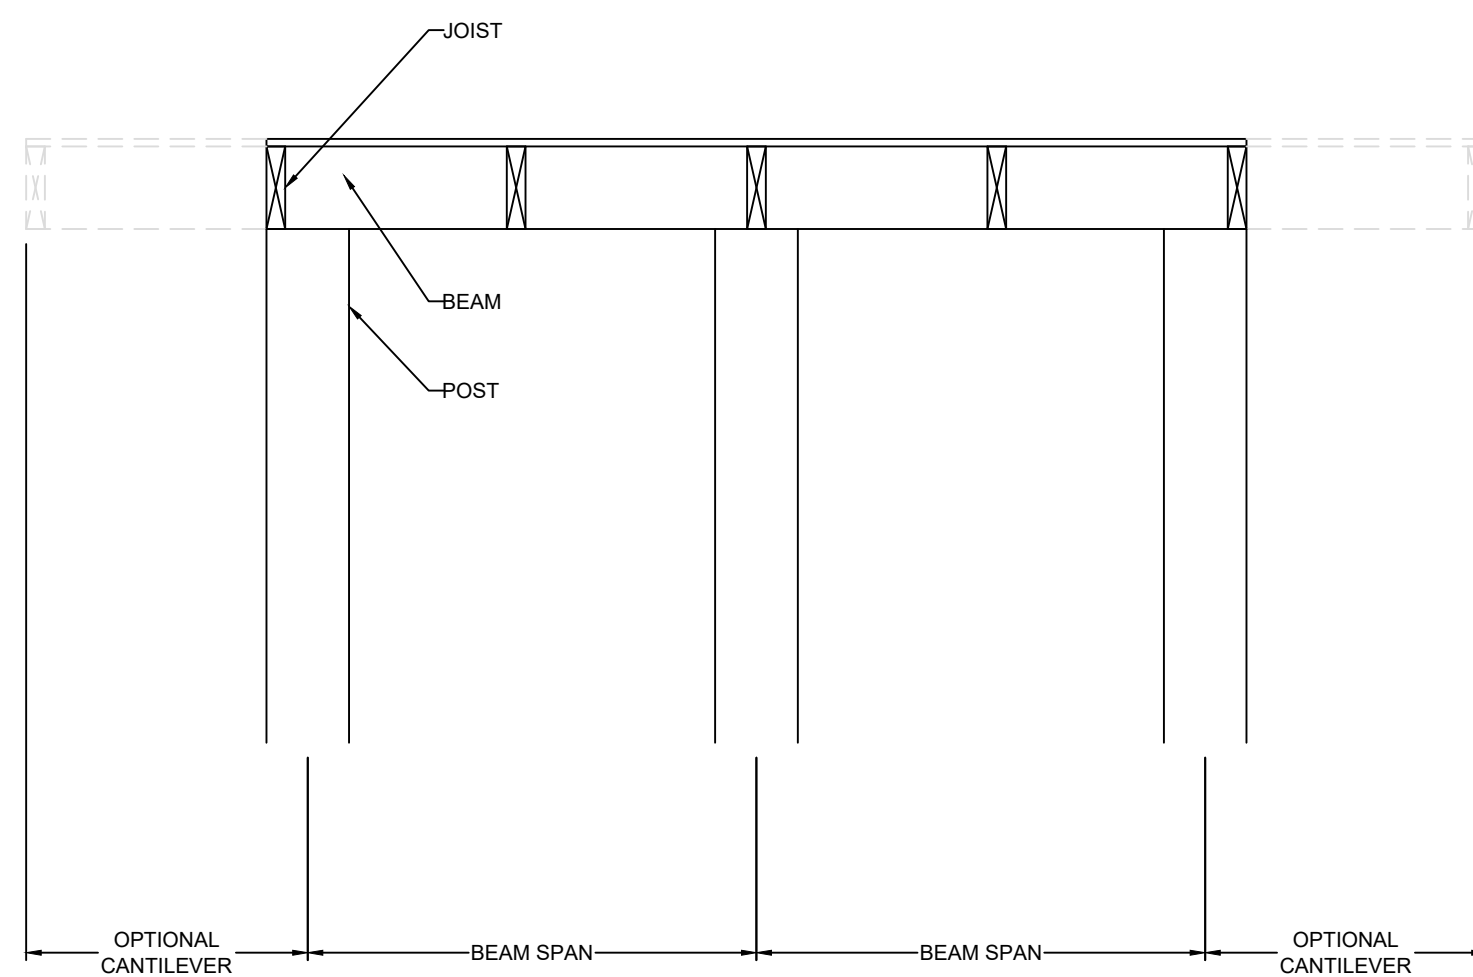

FLUSH BEAM

11 TYP. DECK JOIST SPANS
S3.3 SCALE: 1" = 1'-0" (18x24) OR 1/2" = 1'-0" (24x36)

VISTA
STRUCTURAL ENGINEERING, LLC

14718 NW DELIA STREET * PORTLAND, OREGON 97229
OFFICE: 971.255.6099 * MOBILE: 971.255.6099 *
* DENNIS@VISTASTRUCTURAL.COM * VISTASTRUCTURAL.COM

CLIENT: IQ HOME BUILDERS
JOB TITLE: RHF068 SPEC
LOT 68, THE RETREAT AT HOOK FARMS
LOCATION: 2026 SW RED BARN LN.
LEE'S SUMMIT, MISSOURI

NO.	DATE	REVISION	BY

DRAWING TITLE
FRAMING DETAILS

ENGINEER: DMH CHECKED BY: DMH
JOB NO: 4276 DRAWN BY: DMH
DATE: 02-07-22
SHEET NUMBER

S3.3