


ELEVATION NOTES


1. FINAL GRADE LINE MAY VARY PER EXISTING SITE CONDITIONS. REFER TO PLOT PLAN FOR SPECIFIC SITE GRADE CONDITIONS.
2. ALL ROOFING TO BE ASPHALT COMPOSITION UNLESS NOTED OTHERWISE.
3. ROOF AND SOFFIT VENTS PER LOCAL CODES. WHERE POSSIBLE, PROVIDE ROOF VENTING ON BACK SIDE OF ROOF.
4. GUTTER AND DOWNSPOUT LOCATIONS TO BE DETERMINED BY GUTTER INSTALLER.
5. SMART PANEL SIDING ON SIDE AND REAR ELEVATIONS UNLESS NOTED OTHERWISE.

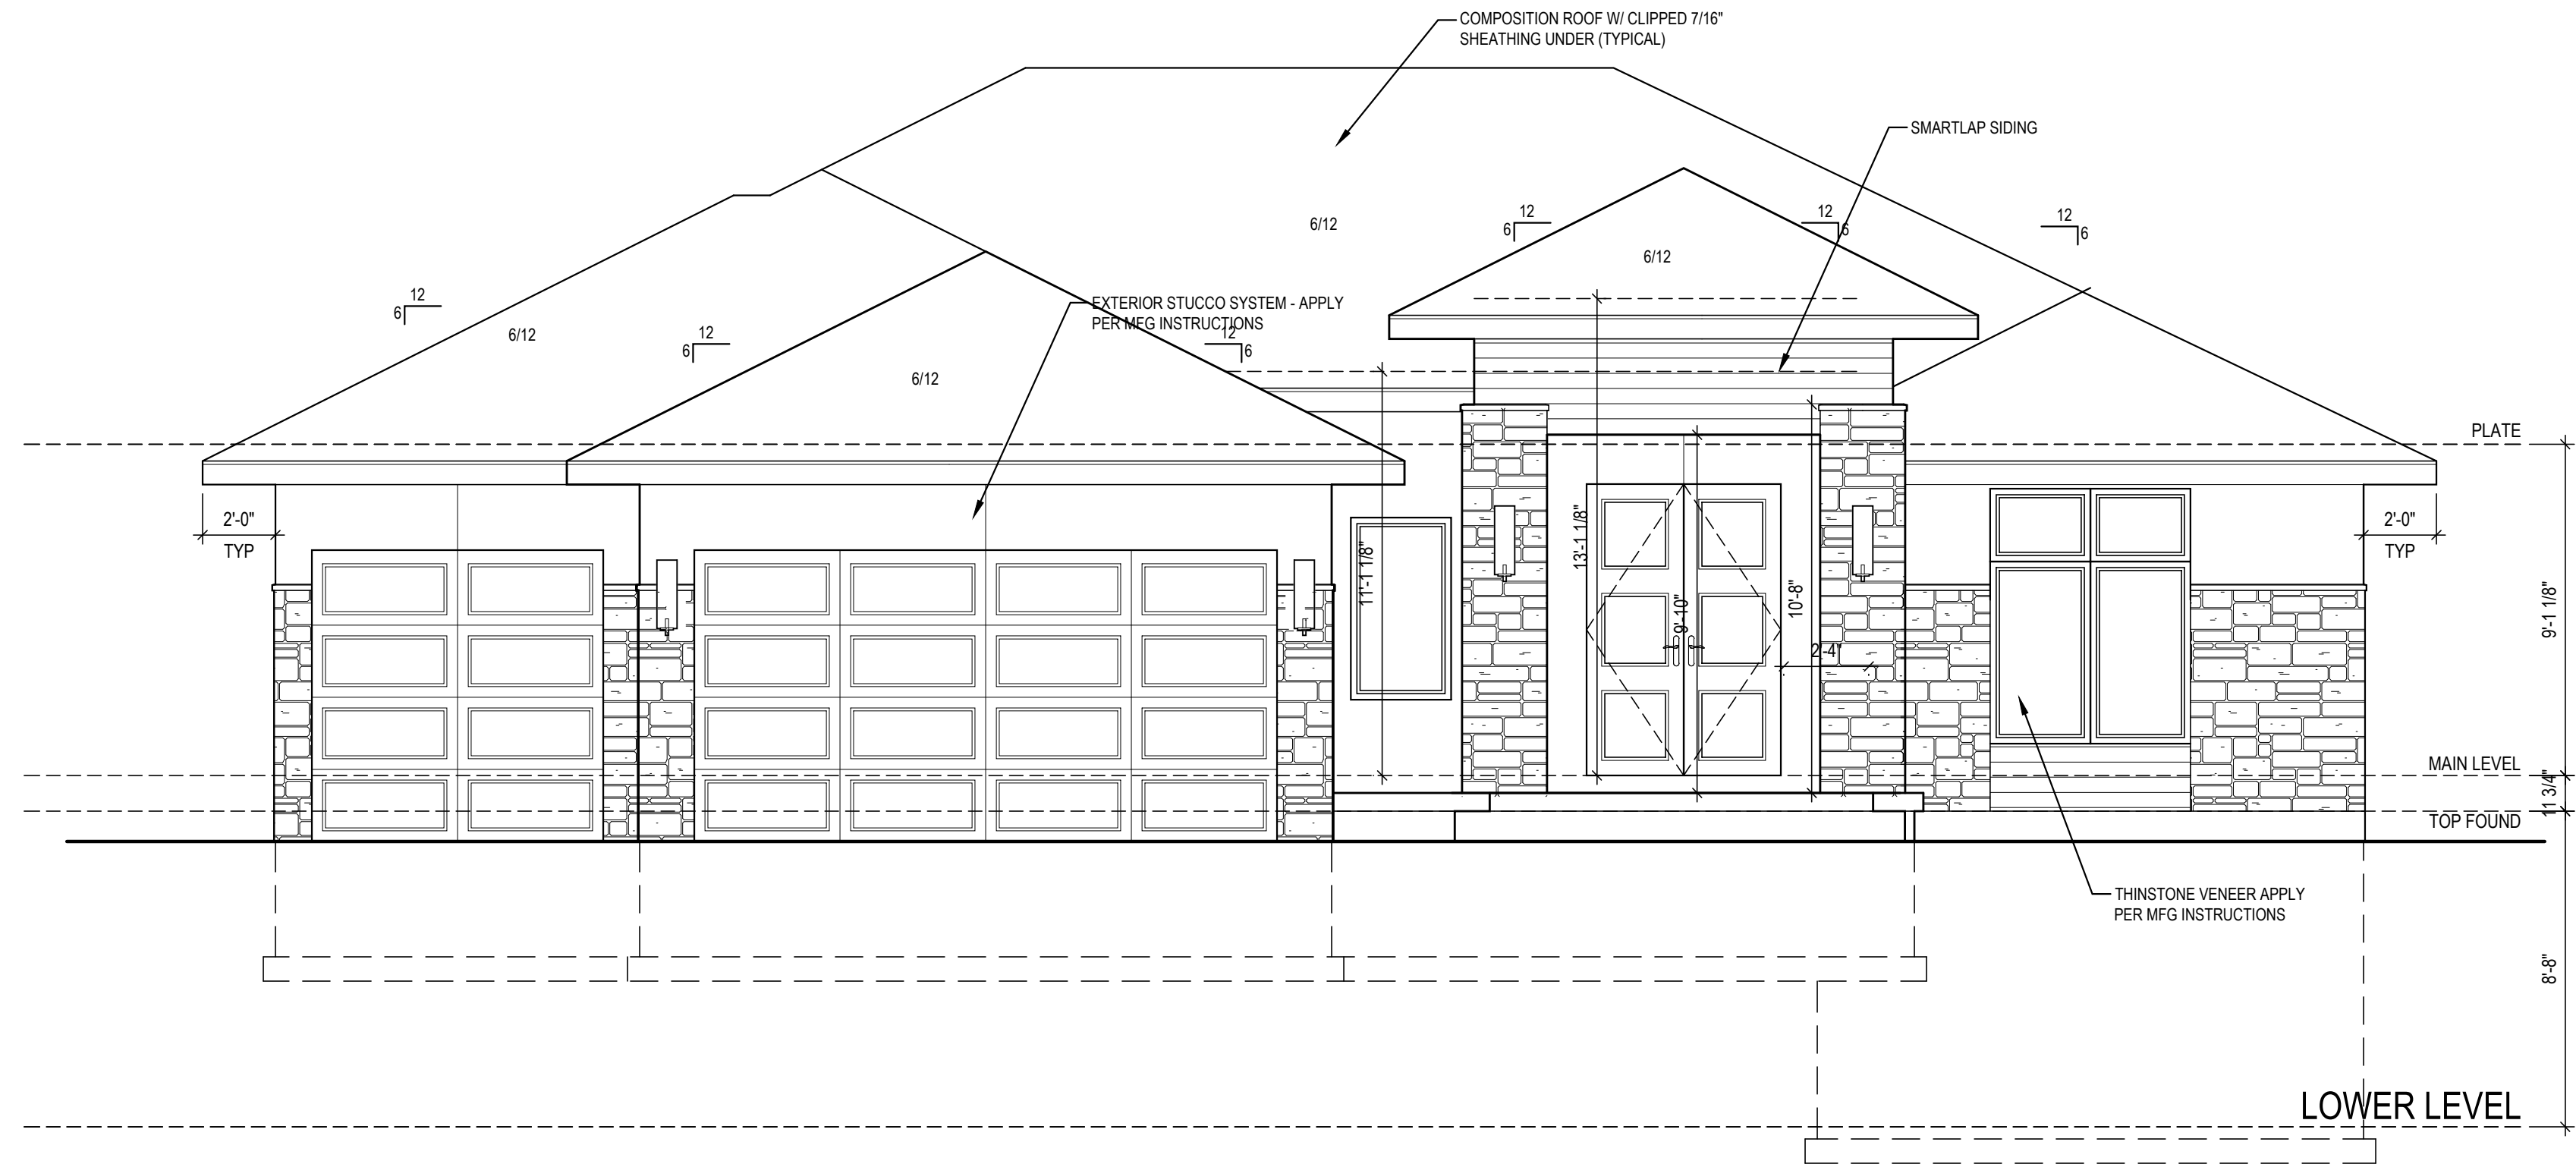

Front Elevation

1/4" = 1'-0"

1

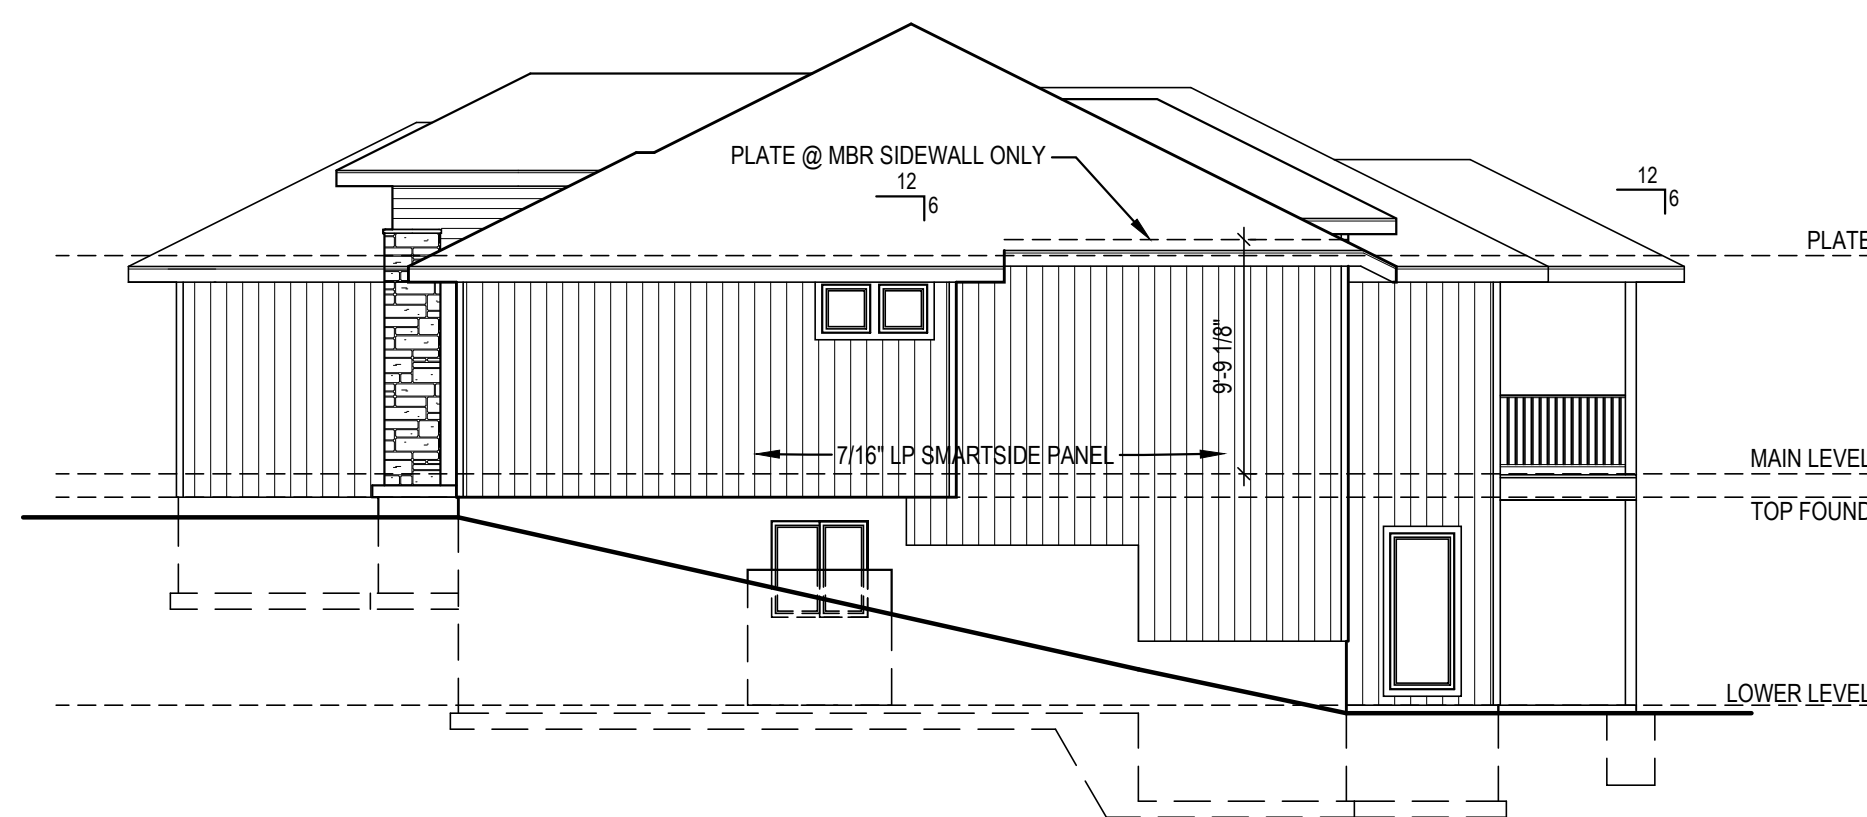

Side Right Elevation

1/8" = 1'-0"


2



Rear Elevation

1/8" = 1'-0"

3

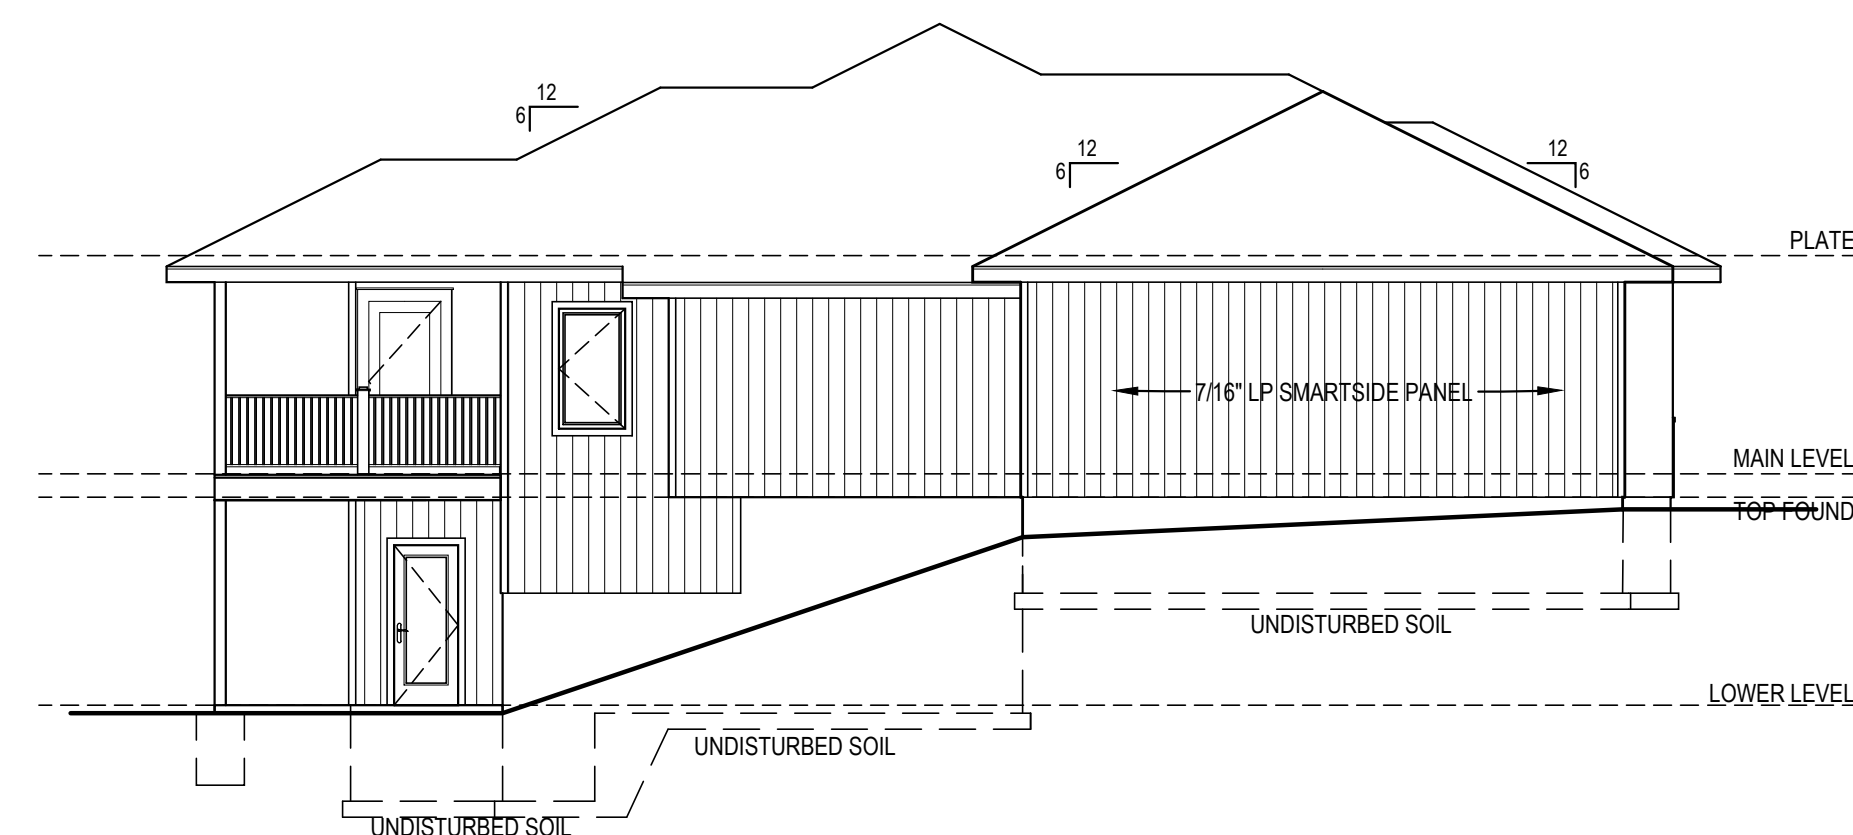

Side Left Elevation

1/8" = 1'-0"

4

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
03/04/2022




© COPYRIGHT 2021

JFE CONSTRUCTION INC.
1314 SW Market Street
Lee's Summit, MO 64081
v: 816.786.4008
jfeconstruction.com



Van Deurzen and Associates, P.A. © 2021

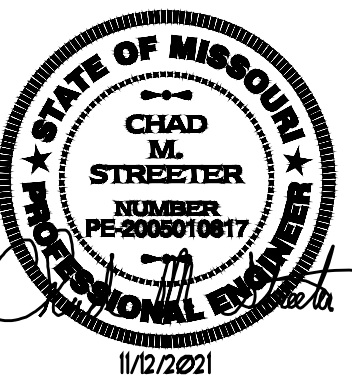

THE GUNNISON MODERN

Spec Residence
1601 SW 27th Street, Lee's Summit, MO
Whispering Woods - Lot 41

Project #: 8083-XXXX

DATE:

Permit: 11/12/2021

Exterior
Elevations

A100

GENERAL NOTES

- BUILDING PERMIT WILL BE REQUIRED FOR THE PROJECT. THIS SET OF DOCUMENTS TO BE SUBMITTED AS A PERMIT SET OF DRAWINGS.
- ALL CONTRACTORS SHALL VISIT THE JOB SITE AND SHALL REVIEW THE PERMIT DRAWINGS TO FAMILIARIZE HIMSELF WITH THE REQUIREMENTS AND INTENT OF THE SCOPE OF WORK. ANY DEFICIENCIES OR DISCREPANCIES DISCOVERED SHALL BE REPORTED FOR REVIEW AND CLARIFICATION PRIOR TO COMMENCING ANY WORK.
- ALL NEW CONSTRUCTION SHALL MEET LATEST EDITIONS OF ALL APPLICABLE NATIONAL, STATE, AND LOCAL BUILDING CODES -- INTERNATIONAL RESIDENTIAL CODE.
- WORKMANSHIP SHALL BE OF THE HIGHEST QUALITY. QUALITY MATERIALS SHALL BE USED THROUGHOUT. ALL WORK SHALL BE DONE IN A MANNER SO AS TO MATCH ADJACENT WORK AND FINISHES AND APPROVED BY OWNER.
- CONTRACTORS SHALL REMOVE ALL CONSTRUCTION DEBRIS. ALL CONSTRUCTION DEBRIS SHALL BE CONTAINED PER CITY REQUIREMENTS. AREAS FOR MATERIAL STORAGE, TRASH DISPOSAL, WORKMENS PARKING, ETC., SHALL BE COORDINATED WITH THE CITY.
- ALL DIMENSIONS TO BE VERIFIED BY CONTRACTOR.
- IT IS THE RESPONSIBILITY OF THE CONTRACTORS TO COORDINATE WITH THE OWNER THE QUANTITY AND LOCATION FOR ALL LIGHTING, ELECTRICAL OUTLETS, TELEPHONE OUTLETS, AND MECHANICAL AND PLUMBING SYSTEMS AS REQUIRED.
- THE CONTRACTORS SHALL ADHERE TO THE STATE OF KANSAS ONE CALL SYSTEM, 1-800-344-7233 (MISSOURI ONE CALL SYSTEM, 1-800-344-7483). THE PERSON OR FIRM DOING EXCAVATION ON PUBLIC RIGHT OF WAY MUST GIVE NOTICE TO, AND OBTAIN INFORMATION FROM, UTILITY COMPANIES. THE CONTRACTORS SHALL NOTIFY THOSE COMPANIES WHICH HAVE FACILITIES IN THE NEAR VICINITY OF THE CONSTRUCTION TO BE PERFORMED WHEN WORK COMMENCES.

GENERAL FOUNDATION REQUIREMENTS

- ALL FOOTINGS ARE TO BE EXTENDED TO MIN 36" BELOW FINISHED GRADE.
- ALL INTERIOR FOOTINGS FOR LOAD BEARING WALLS AND COLUMNS SHALL BE ISOLATED FROM THE BASEMENT FLOOR SLAB.
- FOR ALL CONC WALL OPENINGS, FOOTING & WALL STEPS, PROVIDE ONE #4 BAR, 48" LONG DIAGONALLY AS CLOSE AS PRACTICAL TO CORNER. ALL REINFORCEMENT SHALL BE LAPPED A MIN OF 24" AT ENDS SPLICES AND AROUND CORNERS.
- ANCHOR BOLTS ARE TO BE SPACED @ 36" WITH 7" MIN EMBED. A BOLT SHALL BE PLACED WITHIN 12" OF THE END OF EACH PLATE SECTION.
- FASTEN JOISTS TO SILL PLATES WITH (3) #4 COM NAILS.
- WHERE JOIST IS PARALLEL TO FOUNDATION, PROVIDE SOLID BLOCKING @ 32" FOR (3) JST SPACES. FASTEN TO SILL PLATE PER NOTE 6.
- VAPOR BARRIER: 6 MIL PE VAPOR RETARDER WITH JOINTS LAPPED A MIN OF 6" BETWEEN SLAB & BASE.
- DAMP PROOFING: ONE COAT (MIN) OF DAMP PROOFING OR EQUIVALENT FOUNDATION MEMBRANE SHALL BE APPLIED TO EXTERIOR WALL SURFACES BELOW GRADE. SEAL TIE HOLES, VOIDS BEFORE APPLICATION.
- FOUNDATION DRAIN: INSTALL CONT 4" PERFORATED PVC DRAIN TILE. DRAIN TILE TO BE EXTENDED TO SQUARE SUMP PIT WHICH EXTENDS A MIN 24" BELOW BASEMENT FLOOR.
- ALL FRAMING MEMBERS IN CONTACT WITH CONCRETE SHALL BE ACQ TREATED LUMBER.
- ALL STEEL FASTENERS (INCLUDING FOUND. ANCHOR BOLTS) ON ACQ TO BE (DOUBLE HOT-DIPPED) GALVANIZED.
- PROVIDE A "UFER" GROUND PER IRC 3608.1.
- EGRESS WELL REQUIREMENTS:
 - IF THE VERTICAL DISTANCE FROM THE WINDOW SILL TO ADJACENT GRADE IS GREATER THAN 44", PROVIDE A LADDER.
 - ADD DRAIN TO DAYLIGHT OR SUMP PUMP.

COLUMN & PIER PAD SCHEDULE			
COLUMN MARK	PAD SIZE	REINFORCEMENT	COLUMN SIZE
A	36"x36"x12"	(6) #4 BAR E.W.	3'0" SCHED 40
A	42"x42"x14"	(7) #4 BAR E.W.	3'0" SCHED 40
A	48"x48"x16"	(8) #4 BAR E.W.	3'0" SCHED 40
A	54"x54"x16"	(9) #4 BAR E.W.	3'1/2" SCHED 40
A	60"x60"x18"	(10) #4 BAR E.W.	3'1/2" SCHED 40

- COLUMN & PIER PAD SIZES SHOWN ARE BASED ON AN ASSUMED MINIMUM ALLOWABLE SOIL BEARING CAPACITY OF 1,500 psf.
- GARAGE FOOTINGS PER DETAIL, COLUMN NOT REQUIRED UNLESS NOTED ON PLANS.


I JOIST AND TRUSS NOTES

- FLOOR TRUSS OR I-JOIST LOADING SHALL BE PER THE GENERAL NOTES.
- I-JOISTS MAY BE SHOWN AS SIMPLE SPAN TO DEFINE SPANS AND BEARING POINTS. TRUSS MFG TO RUN CONTINUOUS WHERE POSSIBLE.
- COORDINATE I-JOISTS LOCATIONS WITH PLUMBING DRAIN LINES AT ALL TOILET LOCATIONS.
- JOIST BLOCKING WHERE NOTED ON PLANS MAY BE OMITTED AT HVAC AND PLUMBING LOCATIONS AS REQUIRED.
- EXACT I-JOIST OR FLOOR TRUSS LAYOUT TO BE PROVIDED BY TRUSS MANUFACTURER. DESIGN AND LAYOUT TO BE SUBMITTED TO VAN DEURZEN AND ASSOCIATES TO REVIEW FOR GENERAL CONFORMANCE TO THE DESIGN OF THE BUILDING PRIOR TO SUBMITTAL TO THE CODES ADMINISTRATION FOR PERMITTING.
- IF A CONFLICT EXISTS BETWEEN SHOP DRAWINGS AND CONTRACT SET, THE CONTRACT SET SUPERCEDES THE JOIST/TRUSS LAYOUT.

I JOIST FIRE PROTECTION

ALL I-JOIST AND OPEN WEB TRUSSES OVER UNFINISHED SPACE EXCEEDING 80 SQUARE FEET IN AGGREGATE AREA TO BE PROTECTED BY THE FOLLOWING METHOD:

- 3" MINERAL ROCK WOOL COVERING 8TM CHORD AND NETTING PER APA FORM R425 METHOD 4

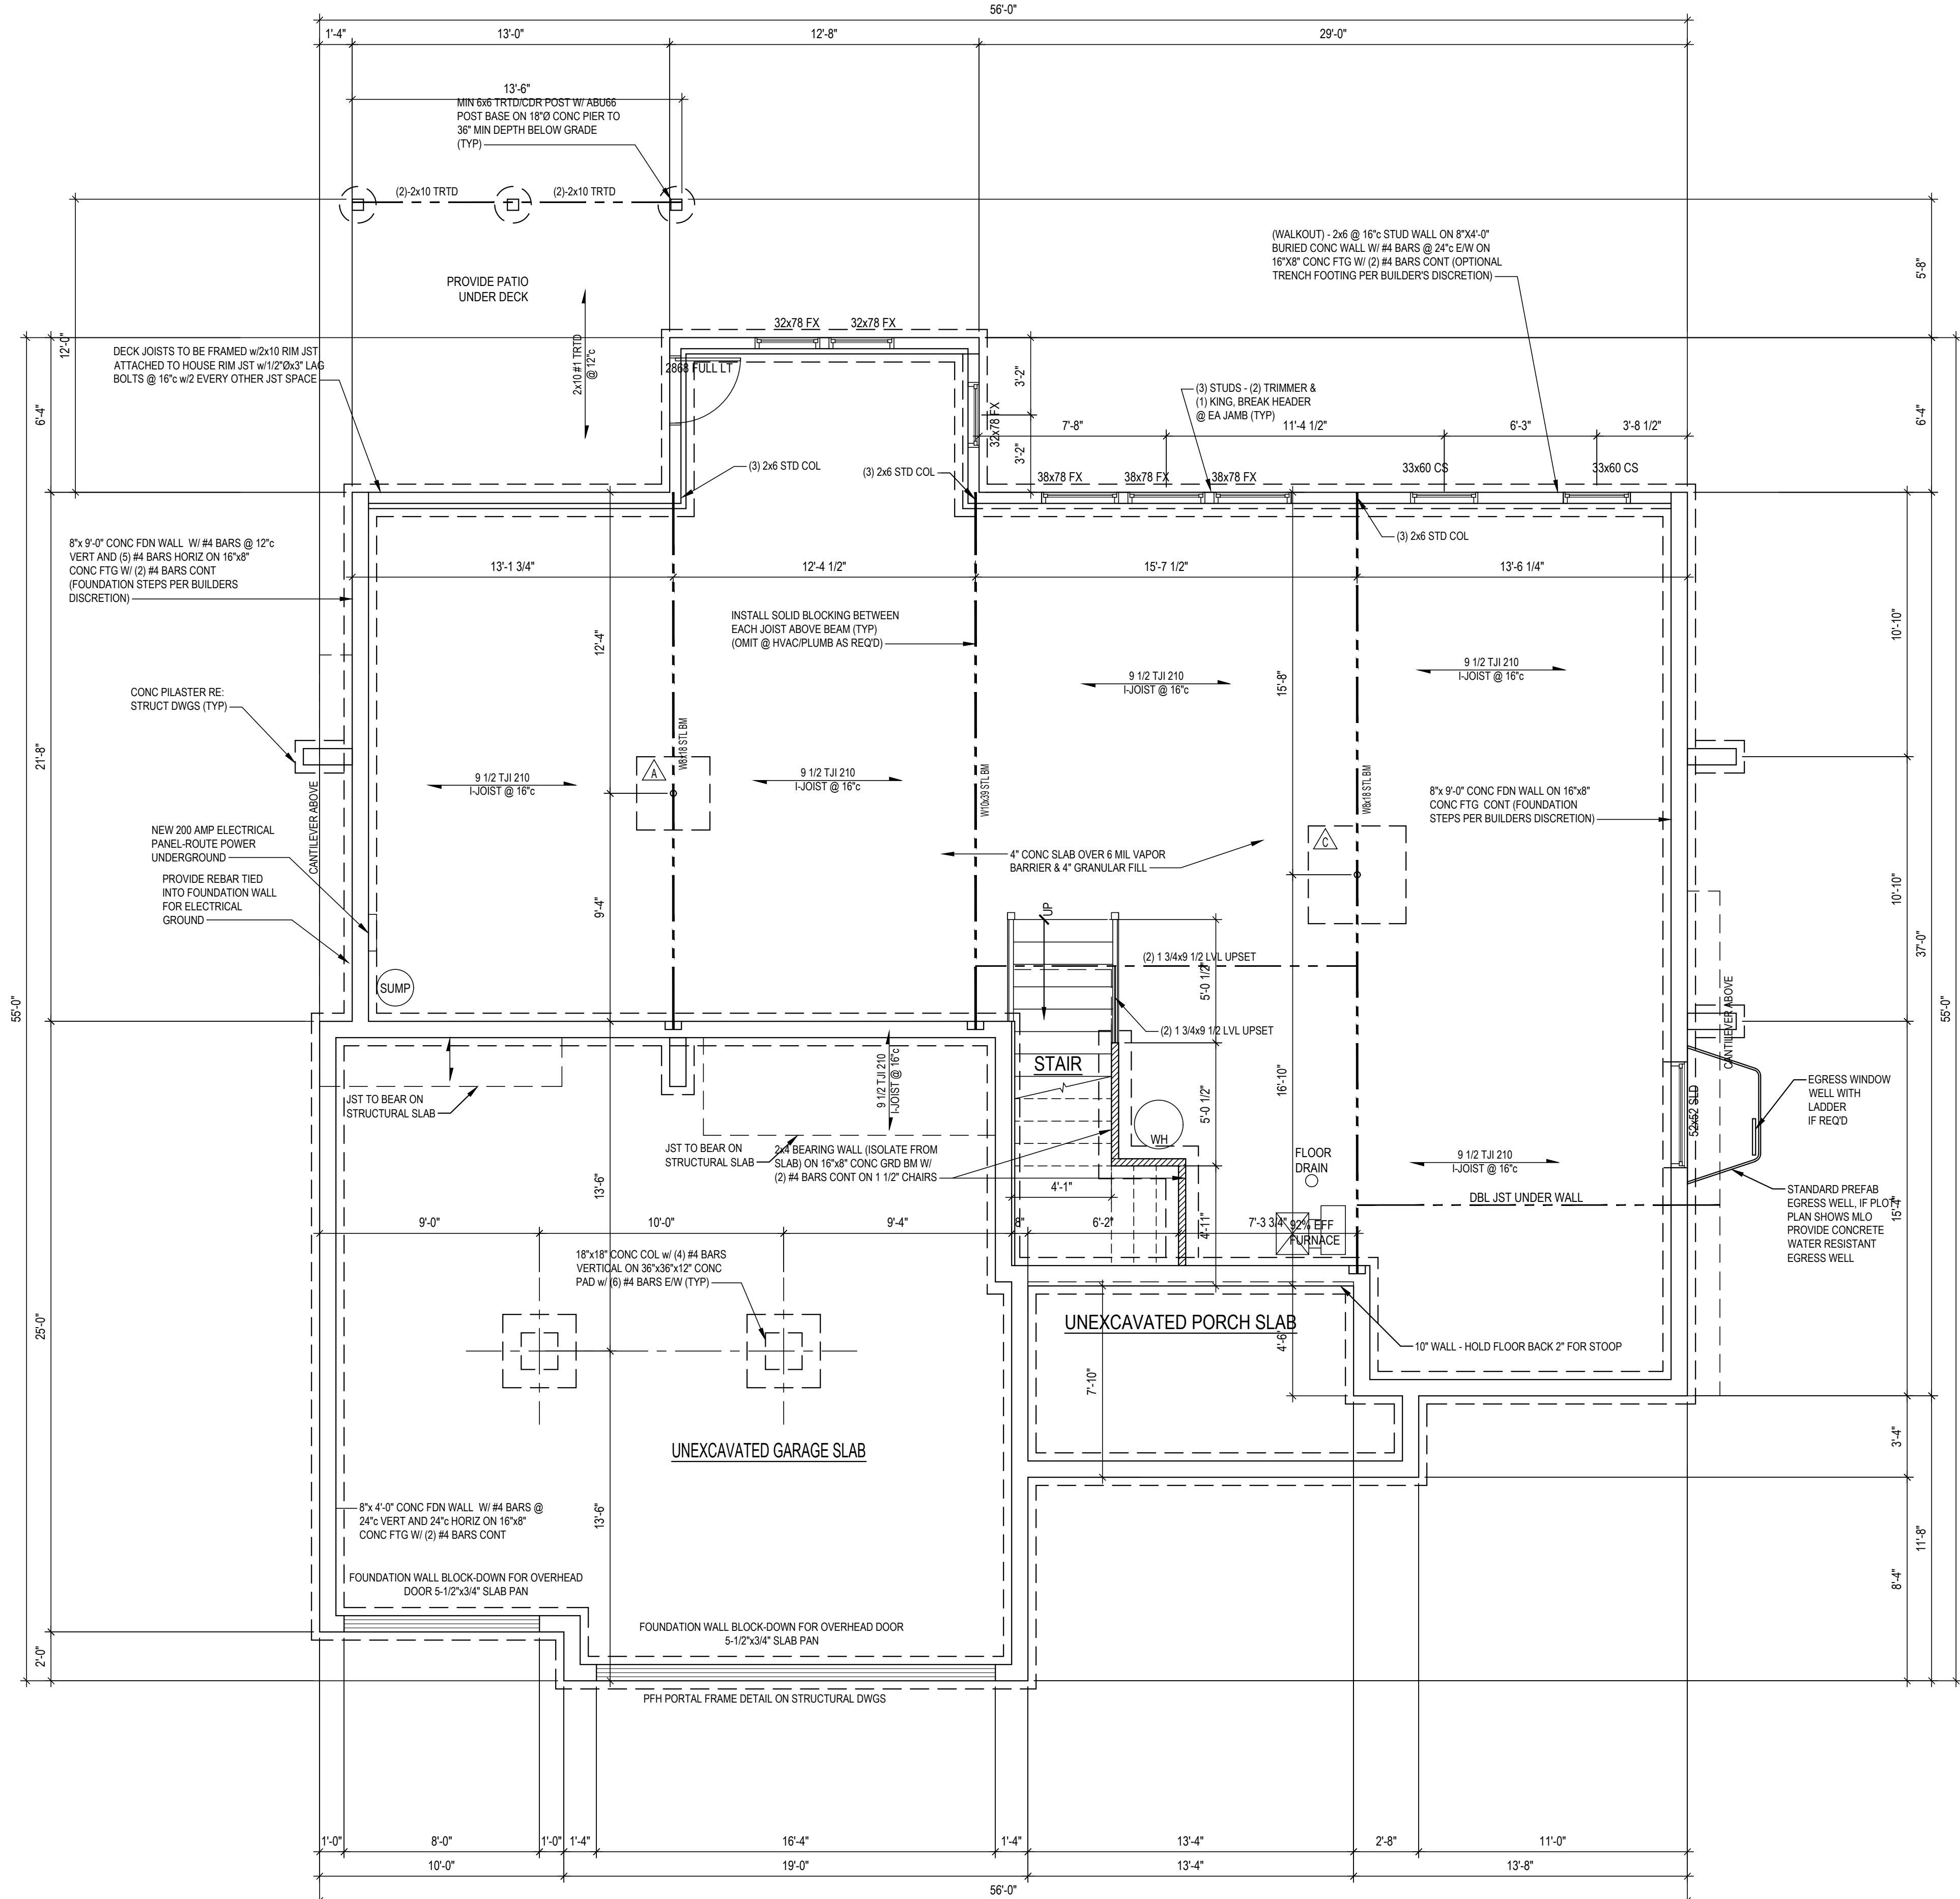

/// LOAD BEARING WALL
--- LOAD BEARING BEAM

Foundation Plan
1/4" = 1'-0"

1



© COPYRIGHT 2021

JFE CONSTRUCTION INC.
1314 SW Market Street
Lee's Summit, MO 64081
v: 816.786.4008
jfeconstruction.com

VAN DEURZEN & ASSOCIATES, P.A.
11011 KING STREET SUITE 130
OVERLAND PARK, KS 66210
(913) 451-6305 FAX (913) 451-0201
WEB PAGE WWW.VANDEURZENANDASSOCIATES.COM
E-MAIL: V2@VANDEURZENANDASSOCIATES.COM

Van Deurzen and Associates, P.A. © 2021



THE GUNNISON MODERN

Spec Residence
1601 SW 27th Street, Lee's Summit, MO
Whispering Woods - Lot 41

Project #: 8083-XXXX

DATE:

Permit: 11/12/2021

Foundation
Plan

A101
RELEASE FOR CONSTRUCTION
NO OTHER PLAN VIEW
OR DIMENSION SERVICES
LEE'S SUMMIT, MISSOURI
03/04/2022

1. ALL STUD WALL FRAMING SHALL BE CONTINUOUS FROM THE FLOOR TO ROOF OR CEILING DIAPHRAGM, U.N.O. ALL WALLS OVER 10'0" ARE TO BE 2X12 STUD WALLS.
2. PROVIDE WATER-RESISTANT EXTERIOR WALL COVERING ON ALL FRAMED WALLS TO COMPLY WITH IRC SECTION 703.2.
3. PROVIDE GFI ELECTRICAL OUTLETS ON COUNTERS, IN UNFINISHED BATHS AND KITCHENS AND NEAR SINKS AND KITCHEN COUNTERS, IN GARAGE AND WITHIN 6'-0" OF ANY SINK.
4. ALL EXTERIOR DOORS SERVED BY HANDICAP.
5. INSTALL CARBON MONOXIDE DETECTORS PER IRC SECTION 315 OUTSIDE OF EACH EXTERIOR DOOR.
6. INSTALL SMOKE DETECTORS IN EACH SLEEPING ROOM, OUTSIDE OF EACH SLEEPING AREA, WITH A MINIMUM OF ONE ON EACH FLOOR PER IRC SECTION 314.
7. PROVIDE A "TYPED" GROUND PER IRC 3608.1.
8. REFER TO SHEET #3 FOR ALL WALL BRACING DETAILS AND/OR CALCULATIONS.
9. PROVIDE BRACING FOR TP HOLDERS, TOWEL BARS, AND TRIM BARS.
10. GARAGE DOOR H-FRAME: THE H-FRAME FOR ATTACHMENT OF THE TRACK AND COUNTER BALANCE SHALL CONSIST OF THE FOLLOWING: 2x6 TRACK, LAMBS RUNNING FROM FLOOR TO CEILING ATTACHED WITH 3x6 BRACES TO 2x6 STUD WALLS. 2x6 STUD WALLS SHALL NAIL THREE INCH INTO HEADER, MINIMUM 2x6 HEADER FOR ATTACHMENT OF COUNTER BALANCE SYSTEM.
11. CLOSET DOORS TO MEET 115 MPH WIND LOAD RESISTANCE REQUIREMENTS OF DASHA 108-17 AND ASTM E 3302-99 PER IRC R 609.4.
12. MAXIMUM RISER HEIGHT OF STAIRWAYS SHALL NOT EXCEED 7 3/4" AND MAXIMUM RUN SHALL PROVIDE A MINIMUM TREAD DEPTH OF 10".
13. ALL EXTERIOR AND LOAD BEARING WINDOW AND DOOR HEADERS TO BE 2(2) 4x10 F IR #2 UNLESS NOTED OTHERWISE ON PLANS
14. ALL EXTERIOR HEADERS (OTHER THAN WINDOWS) TO BE 2(2) 4x10 STUDS NOTED OTHERWISE ON PLANS. ALL INTERIOR HEADERS BEARING TO BE 1(1) 2x4 EA END UNLESS NOTED OTHERWISE.
15. ALL EXTERIOR PLATE HGTS TO BE 6'-0" UNLESS OTHERWISE NOTED.
16. INTERIOR PLATE HGTS AS NOTED IN ROOM C.G.HGHTS NOTATION.
17. ALL LUMBER IN DIRECT CONTACT WITH CONCRETE TO BE TREATED.

CONTRACTOR TO PROVIDE ENERGY AUDIT USING THE HERS ENERGY RATING SYSTEM. IN LIEU OF AN ENERGY AUDIT, THE FOLLOWING PRESCRIPTIVE REQUIREMENTS MAY BE FOLLOWED:

- A. ALL DUCTS, AIR HANDLERS, FILTER BOXES, AND BUILDING CAVITIES TO BE SEALED PER IRC SECTION N1103.2
- B. THE BUILDING THERMAL ENVELOPE IS REQUIRED TO BE SEALED PER IRC SECTION N1102.4
- C. CONTRACTOR TO SUBMIT "MANUAL J" AND "MANUAL D" CALCULATIONS FOR THE HVAC SYSTEM
- D. INSULATION TO COMPLY WITH IECC AS FOLLOWS:
- | | |
|-------------------|---|
| WALLS | R-13 |
| CEILING (FLAT) | R-49 |
| CEILING (VAULTED) | R-38 (NOTE: VAULTED AREA NOT TO EXCEED 500sq ft OR 20% OF ROOF AREA, WHICHEVER IS LESS) |


FLOORS OVER	
UNCONDITIONED SPACE	R-19
CRAWL SPACE WALLS	R-13 (or R-10)
BASEMENT WALLS	R-13 (or R-10)
SLABS	N/R
DUCTWORK	R-8
WINDOWS	
U-FACTOR	U 0.35 (MAX)
SHGC	0.40 (MAX)
SKYLIGHTS	
U-FACTOR	U 0.55 (MAX)
SHGC	0.40 (MAX)

1. VERIFY WINDOW AND DOOR SIZE WITH SUPPLIER AND CUT SHEET PRIOR TO FRAMING.
2. WINDOW SUPPLIER TO CONFIRM EXACT SIZES AND EGRESS WINDOW LOCATIONS FOR LOCAL CODES.
3. ALL WINDOWS TO BE LOW-E GLASS TO MEET ALL LOCAL ENERGY CODE REQUIREMENTS.
4. ALL WINDOWS TO BE FRAMED TIGHT TO HEADERS UNLESS NOTED OTHERWISE ON ELEVATIONS.
5. PROVIDE EGRESS WINDOW IN ALL SLEEPING ROOMS. WINDOWS SHALL COMPLY WITH THE FOLLOWING:
 - a. MINIMUM OPEN AREA 5.7 SF
 - b. MINIMUM OPENING HEIGHT 24 INCHES
 - c. MINIMUM OPENING WIDTH 20 INCHES
 - d. SILL HEIGHT 4" ABOVE THE FLOOR
6. WINDOW SILLS ARE TO BE 2" MIN FIN FLOOR, OR SHALL BE FIXED / INOPERABLE.
7. ALL WINDOWS AND GLAZED DOORS SHALL COMPLY WITH 2018 IRC CHAPTER 6, SECTION R308.4 GLAZING IN HAZARDOUS LOCATIONS SHALL BE OF PROTECTED SAFETY GLAZING MATERIALS, GLASS IN STORM DOORS, INDIVIDUAL FIXED OR OPERABLE PANELS ADJACENT TO A DOOR OR WINDOW, AND STORM DOORS SHALL BE OF PROTECTED SAFETY GLAZING MATERIALS EXCEPT WHERE THE BOTTOM EDGE IS WITHIN 60" OF THE FLOOR, WITH ENCLOSING STAIRWAYS AND LANDINGS WHERE THE GLAZING IS WITHIN 60" OF THE TOP OR BOTTOM OF STAIR ENCLOSURES AND STAIRWAYS. OPERABLE GLAZING SHALL BE OF PROTECTED SAFETY PANELS EXCEEDING 9 SF AND WHOSE BOTTOM EDGE IS LESS THAN 18" ABOVE THE FLOOR OR WALKING SURFACE WITHIN 36"
8. ALL WINDOWS SHALL HAVE A FALL PROTECTION LABEL PER RC132.
9. ALL GLAZING WINDOW AND DOORS SHALL COMPLY WITH THE TEST CRITERIA FOR CATEGORY III IN ACCORDANCE WITH CPSC 16 CFR 1021.

SHEATHING METHOD CS-WSP, WSP, PFH, GB (or LIB), CS-PF

1. ALL EXTERIOR WALLS ARE TYPE "CS-WSP" AND ARE CONTINUOUSLY SHEATHED UNLESS NOTED OTHERWISE. THE BRACED WALL NOTATIONS (IF SHOWN) REFLECT THE MINIMUM SHEATHING REQUIREMENTS PER CODE.
2. IF NO NOTATIONS ARE SHOWN FOR WALLS TYPE "CS-WSP" ON PLAN, WALL IS FULLY SHEATHED AND MEETS ALL REQUIREMENTS WITH END CONDITION #1, #3, OR #4.
3. EC - END CONDITION PER IBC FIGURE 602.10.7, (FOR CONDITIONS #1, #3, & #4 NO HOLDDOWN REQUIRED)
4. INTERIOR WALL BRACING NOT REQUIRED FOR BRACED WALL SPACING 60FT OR LESS

 DENOTES EXTERIOR BRACED WALL WOOD
 STRUCTURAL PANEL (WSP or CS-WSP)
 ATTACHED PER DETAILS AND GENERAL NOTES

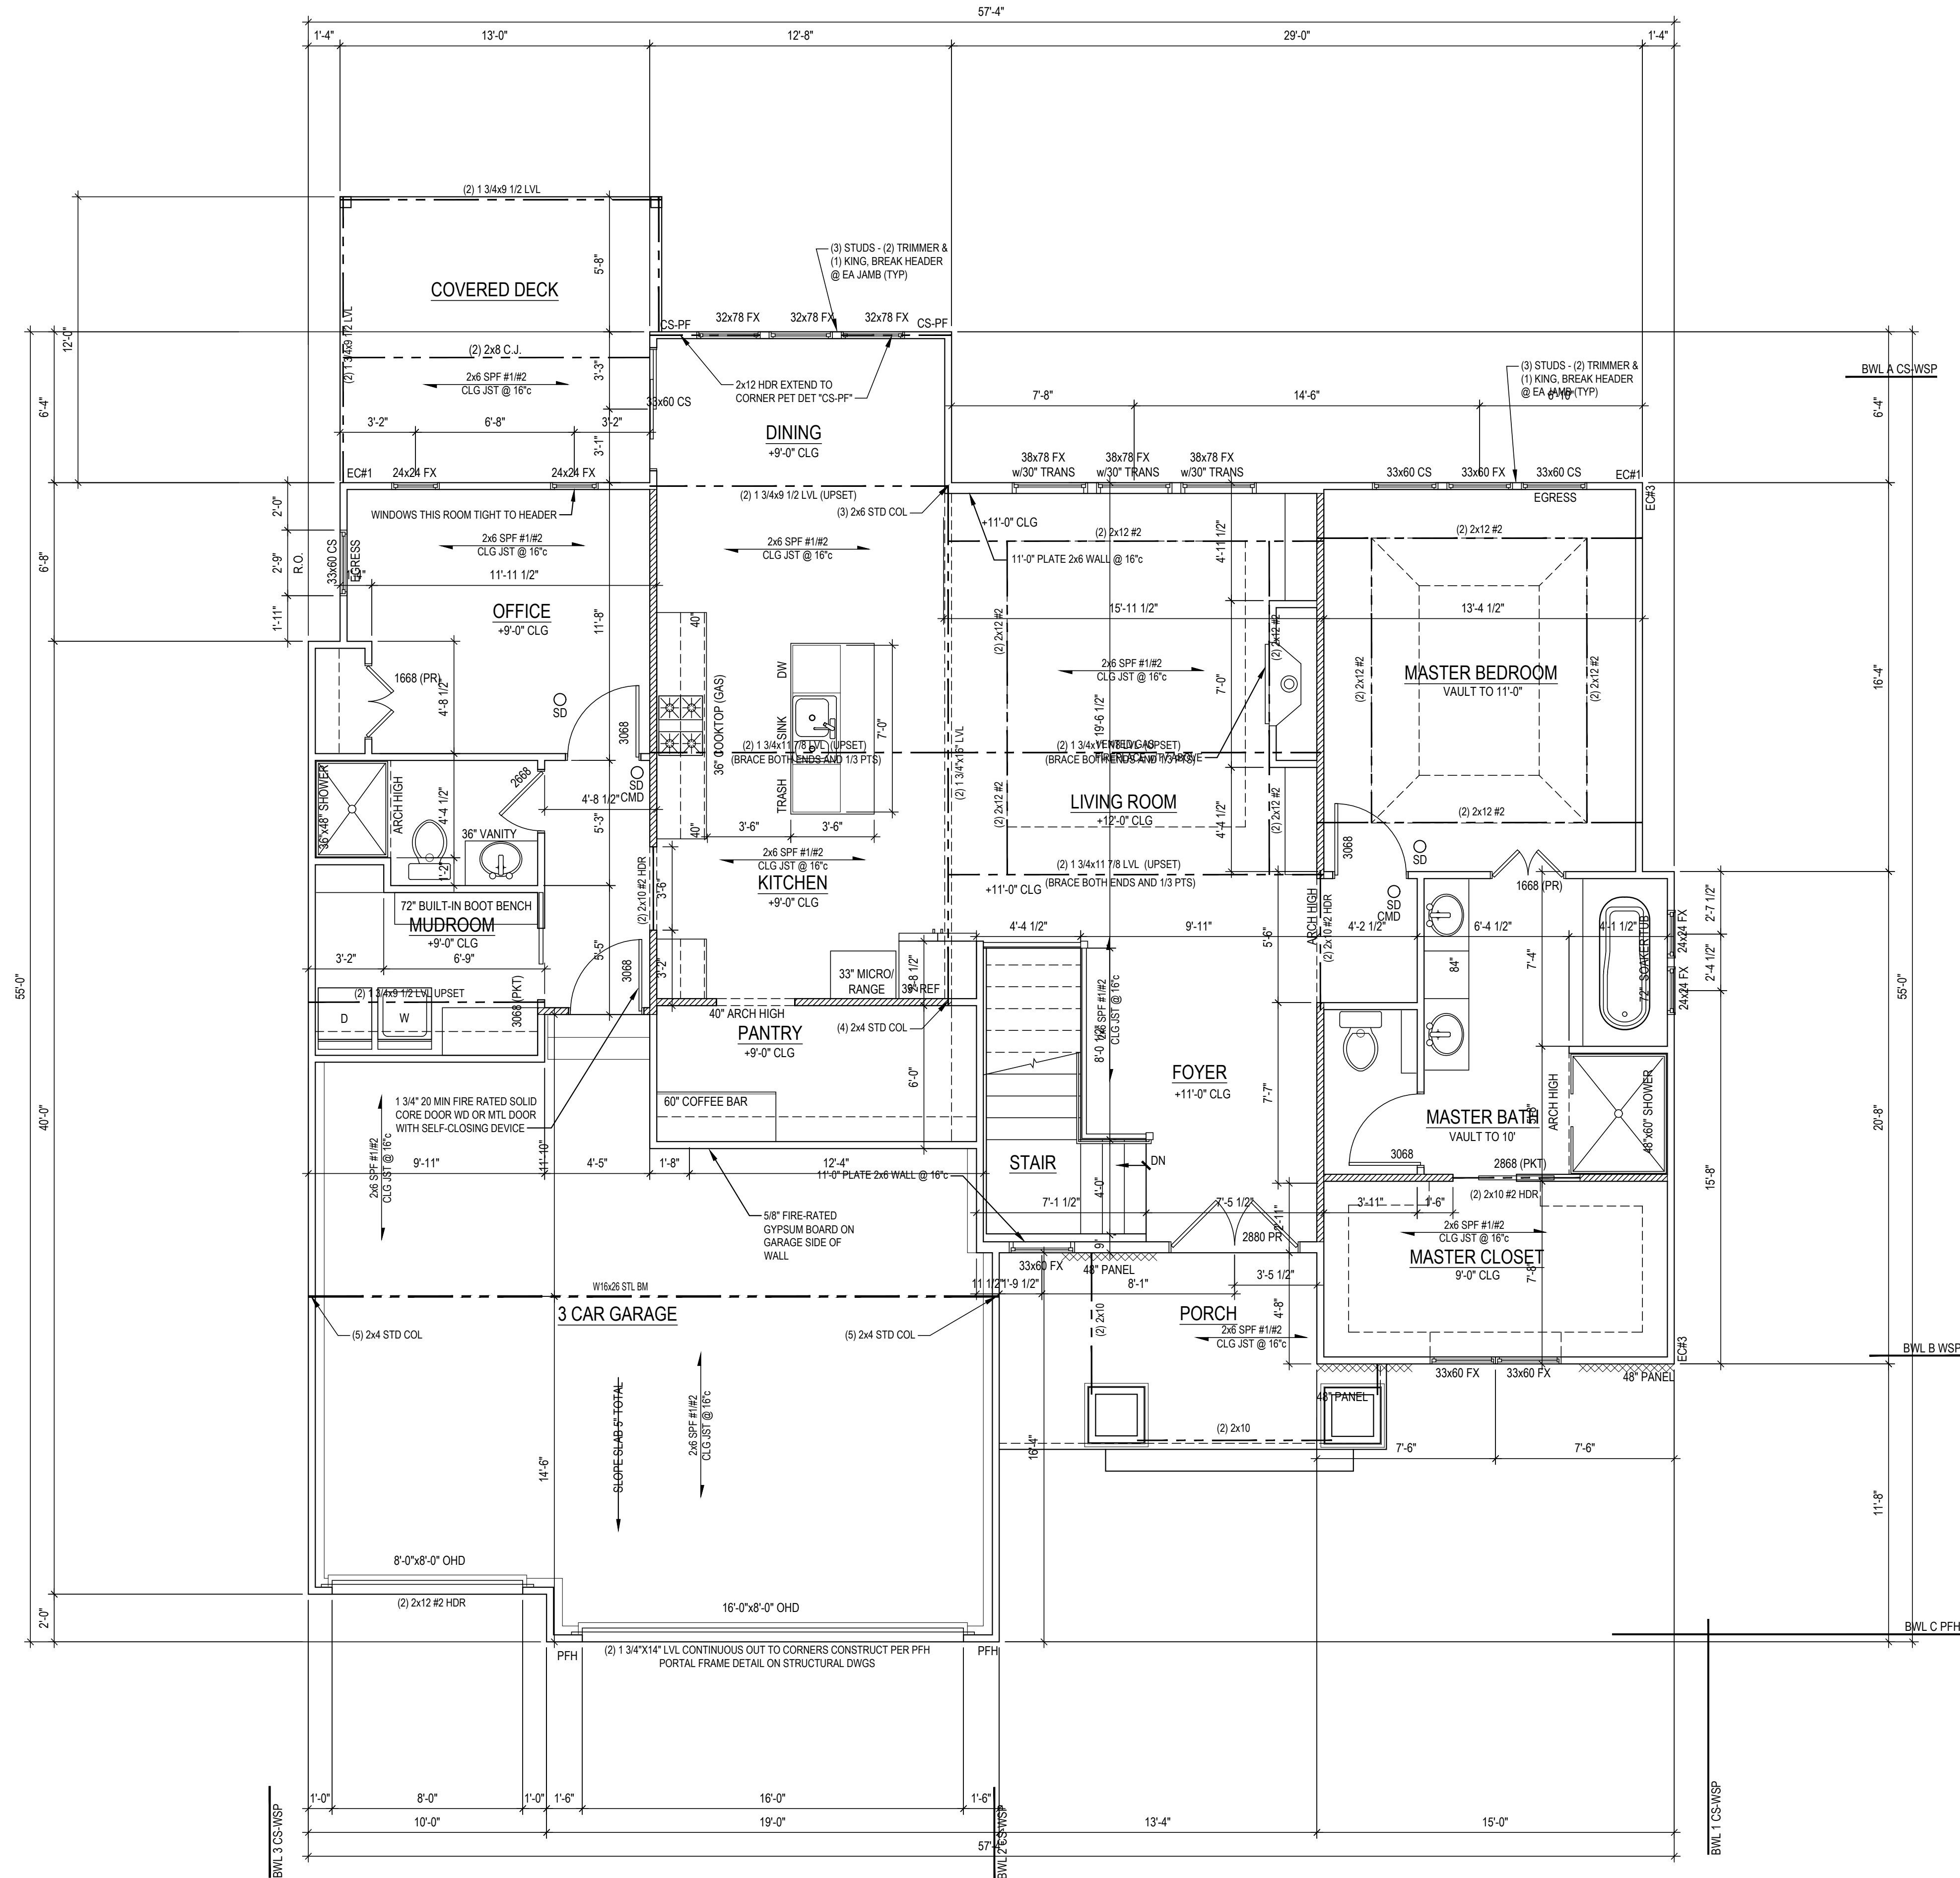

MAIN LEVEL	
FINISH	1794 SF
GARAGE	637 SF
COVERED DECK	156 SF
FRONT PORCH	104 SF

 LOAD BEARING WALL
 LOAD BEARING BEAM

JFE CONSTRUCTION INC.
1314 SW Market Street
Lee's Summit, MO 64081
v: 816.786.4008
jfeconstruction.com

VAN DEURZEN & ASSOCIATES, P.A.
11011 KING STREET, SUITE 130
OVERLAND PARK, KS 66210
(913) 451-6305 FAX (913) 451-1021
WEB PAGE WWW.VANDEURZENASSOC.COM

Van Deuren and Associates, P.A. © 2021



THE GUNNISON MODERN

Spec Residence
1601 SW 27th Street, Lee's Summit, MO
Whispering Woods - Lot 41

Project #: 8083-XXXX

DATE: _____

Permit: 11/12/2021

First Floor Plan

A102

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES



© COPYRIGHT 2021

JFE CONSTRUCTION INC.
1314 SW Market Street
Lee's Summit, MO 64081
v: 816.786.4008
jfeconstruction.com


VAN DEURZEN & ASSOCIATES, P.A.
11011 KING STREET SUITE 130
OVERLAND PARK, KS 66210
(913) 451-6305 FAX (913) 451-1021
WEB PAGE WWW.VANDEURZENASSOC.COM
E-MAIL V2@VANDEURZENASSOC.COM

Van Deurzen and Associates, P.A. © 2021



THE GUNNISON MODERN

Spec Residence
1601 SW 27th Street, Lee's Summit, MO
Whispering Woods - Lot 41

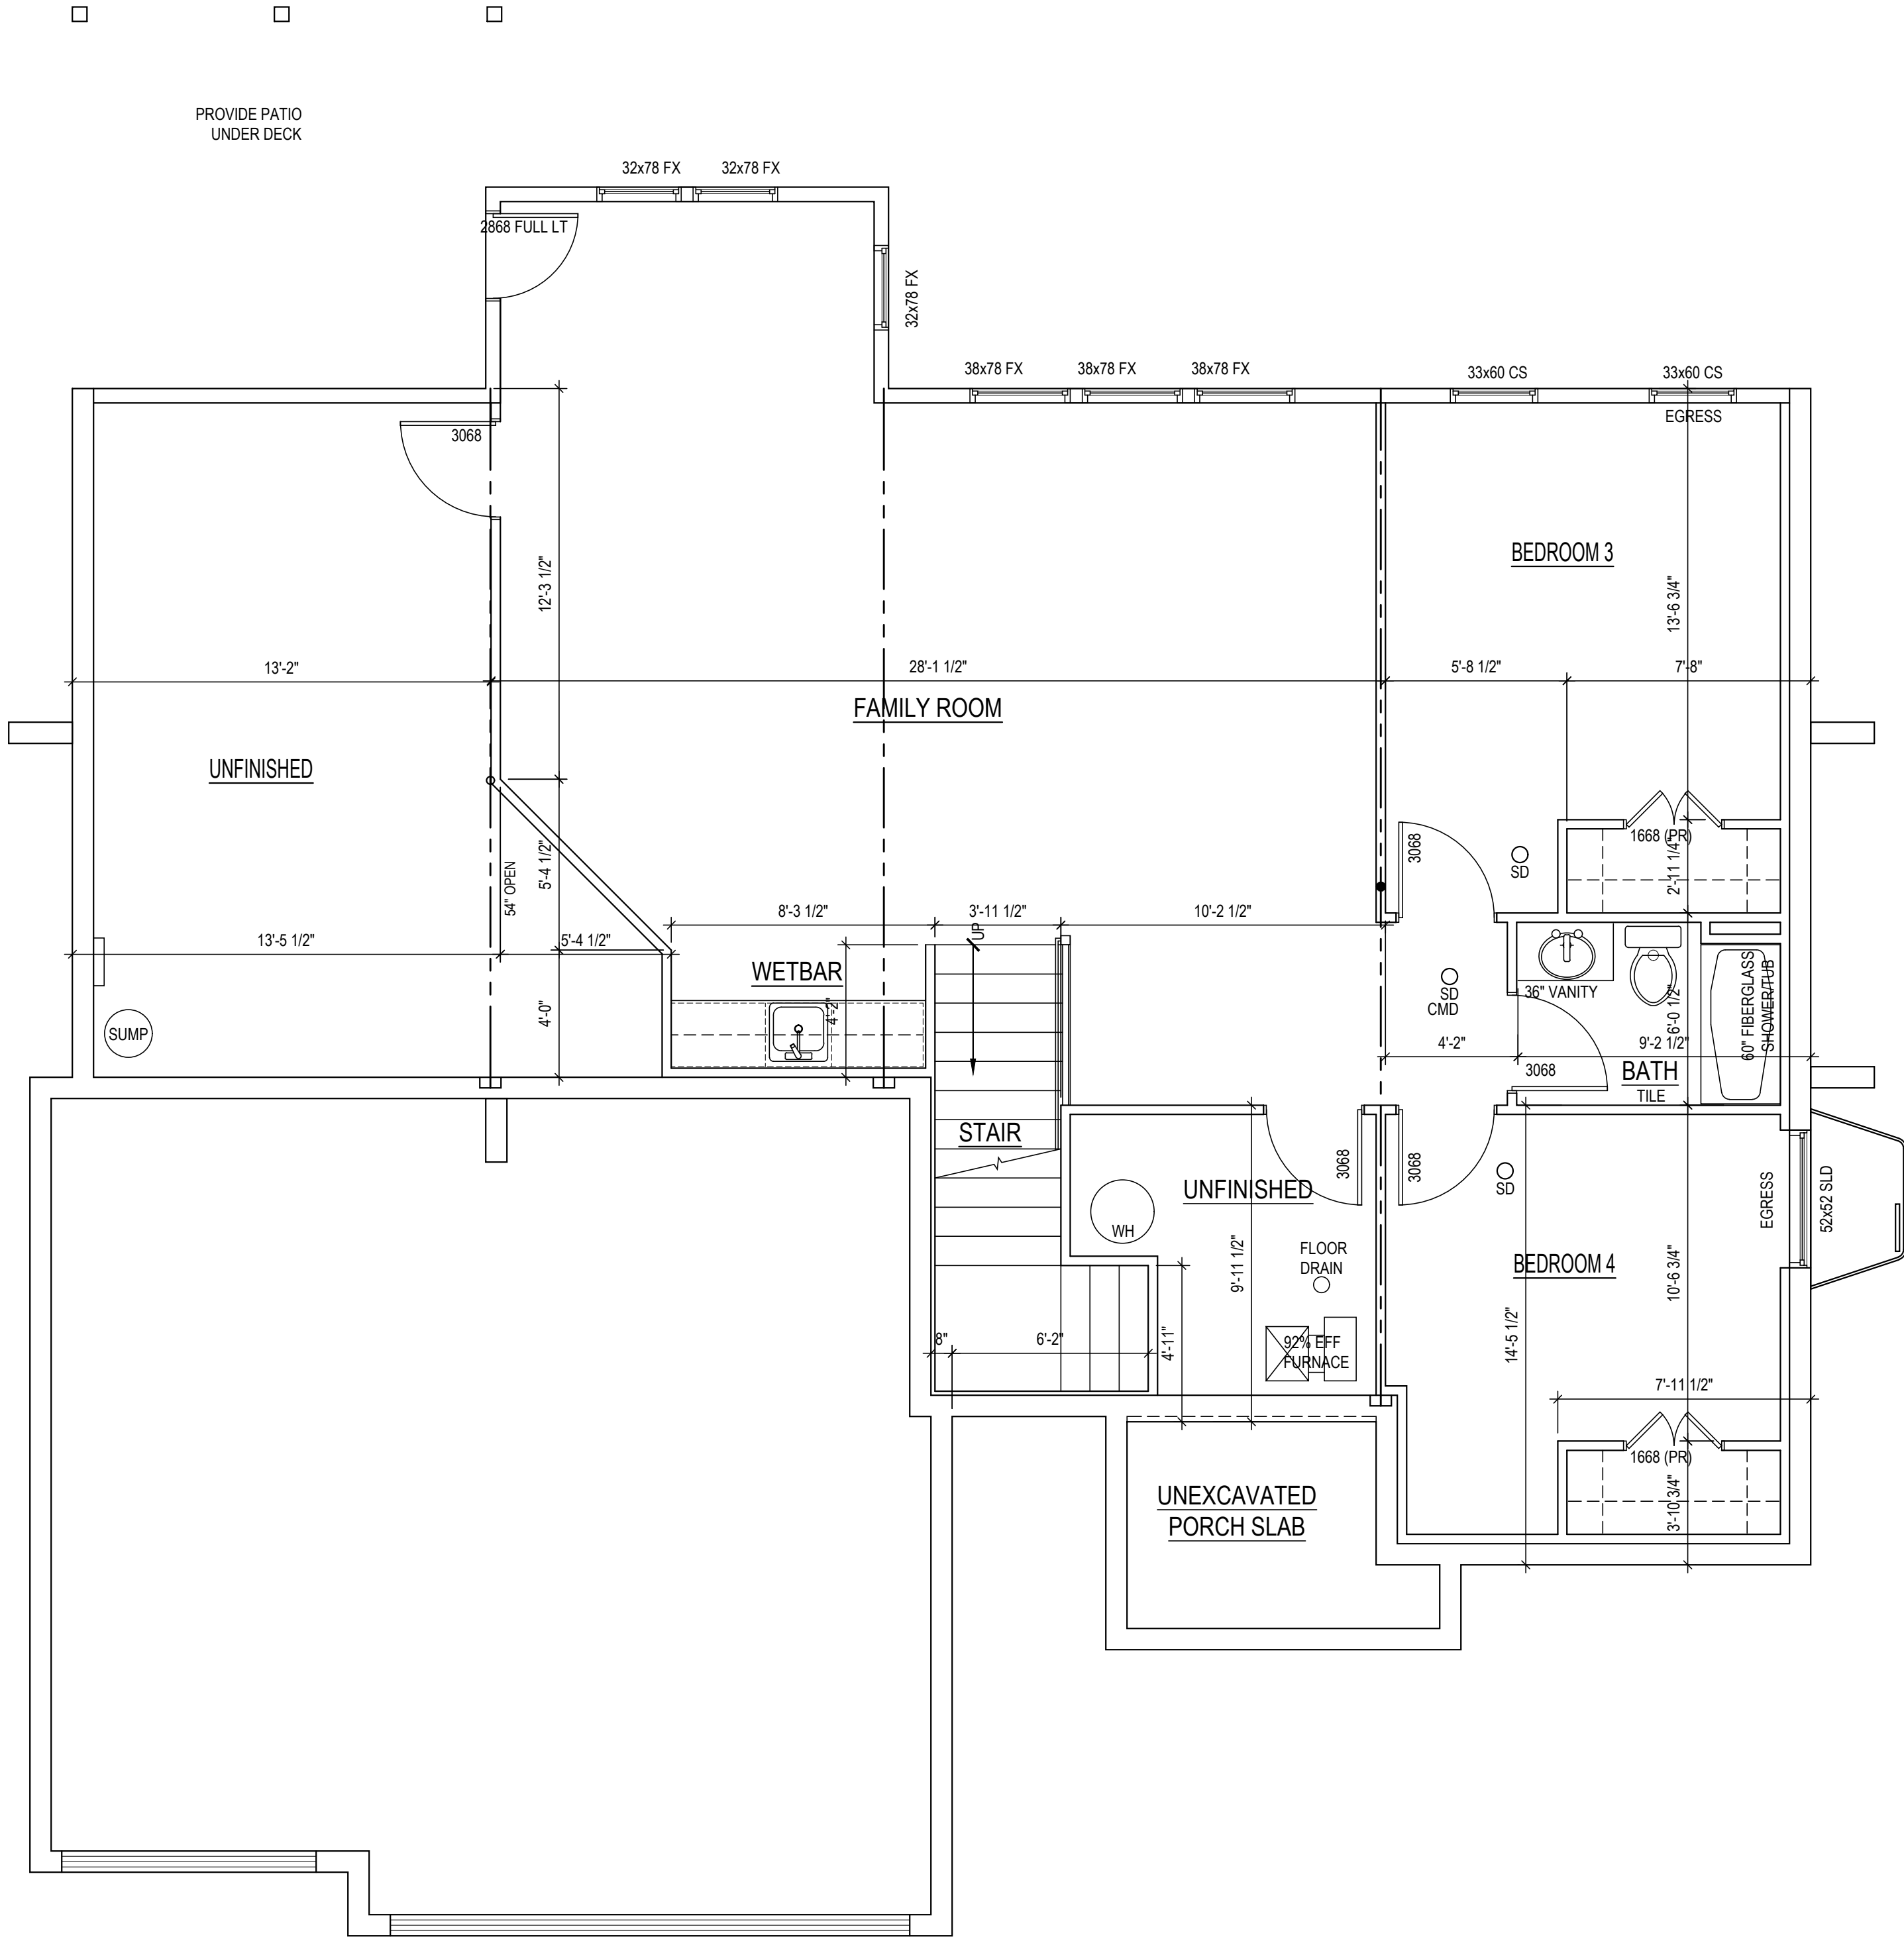

LOWER LEVEL
FINISH: 1086 SF
UNFINISHED: 470 SF

Basement Finish Plan
1/4" = 1'-0"

1

Project #: 8083-XXXX

DATE:

Permit: 11/12/2021

Basement Finish Plan

A103

RELEASE FOR CONSTRUCTION
NO MODIFICATIONS ALLOWED
WITHOUT WRITTEN REVIEW
PROVIDENT SERVICES
LEE'S SUMMIT, MISSOURI
03/04/2022


ROOF PLAN NOTES

- ALL ROOF RAFTERS NOT CALLED OUT ARE TO BE 2x6 SPF #1#2 @ 16"
- ALL CEILING JOISTS NOT CALLED OUT ARE TO BE 2x6 SPF #1#2 @ 16"
- ALL VAULTS TO BE FURRED DOWN w/2x MATERIAL TO PROVIDE FOR R-38 INSULATION
- ALL EXTERIOR AND LOAD BEARING WINDOW AND DOOR HEADERS TO BE (2) 2x10 D.FIR #2 UNLESS NOTED OTHERWISE ON PLANS
- ALL RIDGES, HIPs, AND VALLEYS NOT MARKED SHALL BE (1) NOMINAL SIZE LARGER THAN THE INTERSECTING RAFTERS
- CEILING JOISTS AND RAFTERS SHALL BE NAILED TO EACH OTHER WITH (3) 16d COM (3 1/2"x0.162") NAILS AND THE RAFTER SHALL BE NAILED TO THE TOP WALL PLATE WITH (3) 8d COM (2 1/2"x0.131") NAILS. CEILING JOISTS SHALL BE CONTINUOUS OR SECURELY JOINED WITH (3) 16d COM (3 1/2"x0.162") NAILS WHERE THEY MEET OVER INTERIOR PARTITIONS AND ARE NAILED TO ADJACENT RAFTERS TO PROVIDE A CONTINUOUS TIE ACROSS THE BUILDING WHEN SUCH JOISTS ARE PARALLEL TO THE RAFTERS.
- WHERE CEILING JOISTS ARE NOT CONNECTED TO THE RAFTERS AT THE TOP WALL PLATE (or AT LOCATIONS WHERE C.J. ARE PERPENDICULAR TO RAFTERS), INSTALL 2x4 RAFTER TIES @ 16" WITH (3) 16d COM (3 1/2"x0.162") NAILS EA END.
- RAFTER CONNECTIONS DESIGNED TO RESIST UPLIFT FORCES PER IRC TABLE 802.11. ROOF HEADERS DO NOT HAVE NOTABLE UPLIFT TO REQUIRE HOLD DOWNS. REFER TO STRUCTURAL DETAIL SHEET S1 CONNECTION TABLE FOR FASTENERS
- INSTALL 2x4 COLLAR TIES @ 48" IN UPPER 1/3rd OF ROOF RAFTER. PROVIDE METAL FLASHING AT ALL ROOF VALLEYS.
- ROOF AND SOFFIT VENTS PER LOCAL CODES. WHERE POSSIBLE, PROVIDE ROOF VENTING ON BACK SIDE OF ROOF. BATH VENTS TO VENT DIRECTLY TO THE OUTSIDE.
- EXACT GUTTER AND DOWNSPOUT LOCATION BY GUTTER INSTALLER.
- PER IRC SECTION R802.3 - FOR ROOF PITCHES 3/12 OR GREATER, STRUCTURAL MEMBERS THAT SUPPORT RAFTERS AND CEILING JOISTS SUCH AS RIDGE BEAMS, HIPs AND VALLEYS THAT ARE SUPPORTED BY BRACES AND/OR PURLINS AT THE ENDS ARE NOT REQUIRED TO BE DESIGNED AS BEAMS AND ARE TO BE FRAMED USING LUMBER THAT IS NOMINALLY 2" WIDE BY ONE SIZE GREATER THAN ATTACHING FRAMING MEMBER (NOTE #9). THERE IS NO STRUCTURAL LINE LOADING ON THE MEMBER

ROOF BRACING

- ROOF PURLINS TO BE PLACED APPROXIMATELY WHERE SHOWN ON PLANS. USE 2x6 STUD GRADE PURLIN PLACED PERPENDICULAR TO RAFTERS (UNLESS NOTED OTHERWISE ON PLANS)
- RIDGE, HIP, VALLEY, AND PURLIN BRACE STRUTS TO BE PLACED AS SHOWN ON PLANS. STRUTS TO BE 2x4 STUD GRADE w/ MAXIMUM UNBRACED LENGTH OF 8'-0" AND AT A 45° ANGLE w/ HORIZONTAL OR GREATER (VERTICAL WHERE POSSIBLE)
- BRACES LONGER THAN 8'-0" SHALL BE 2x4 STRONG BACK BRACES

- /// LOAD BEARING INTERIOR WALL BELOW
- LOAD BEARING BEAM BELOW
- - - 2x6 ROOF PURLIN (UNLESS NOTED OTHERWISE ON PLANS)
- - - 2x4 PURLIN/RIDGE BRACING (STRONG BACK IF OVER 8'-0" LONG)
- ⊗ 2x4 STRONG BACK POST

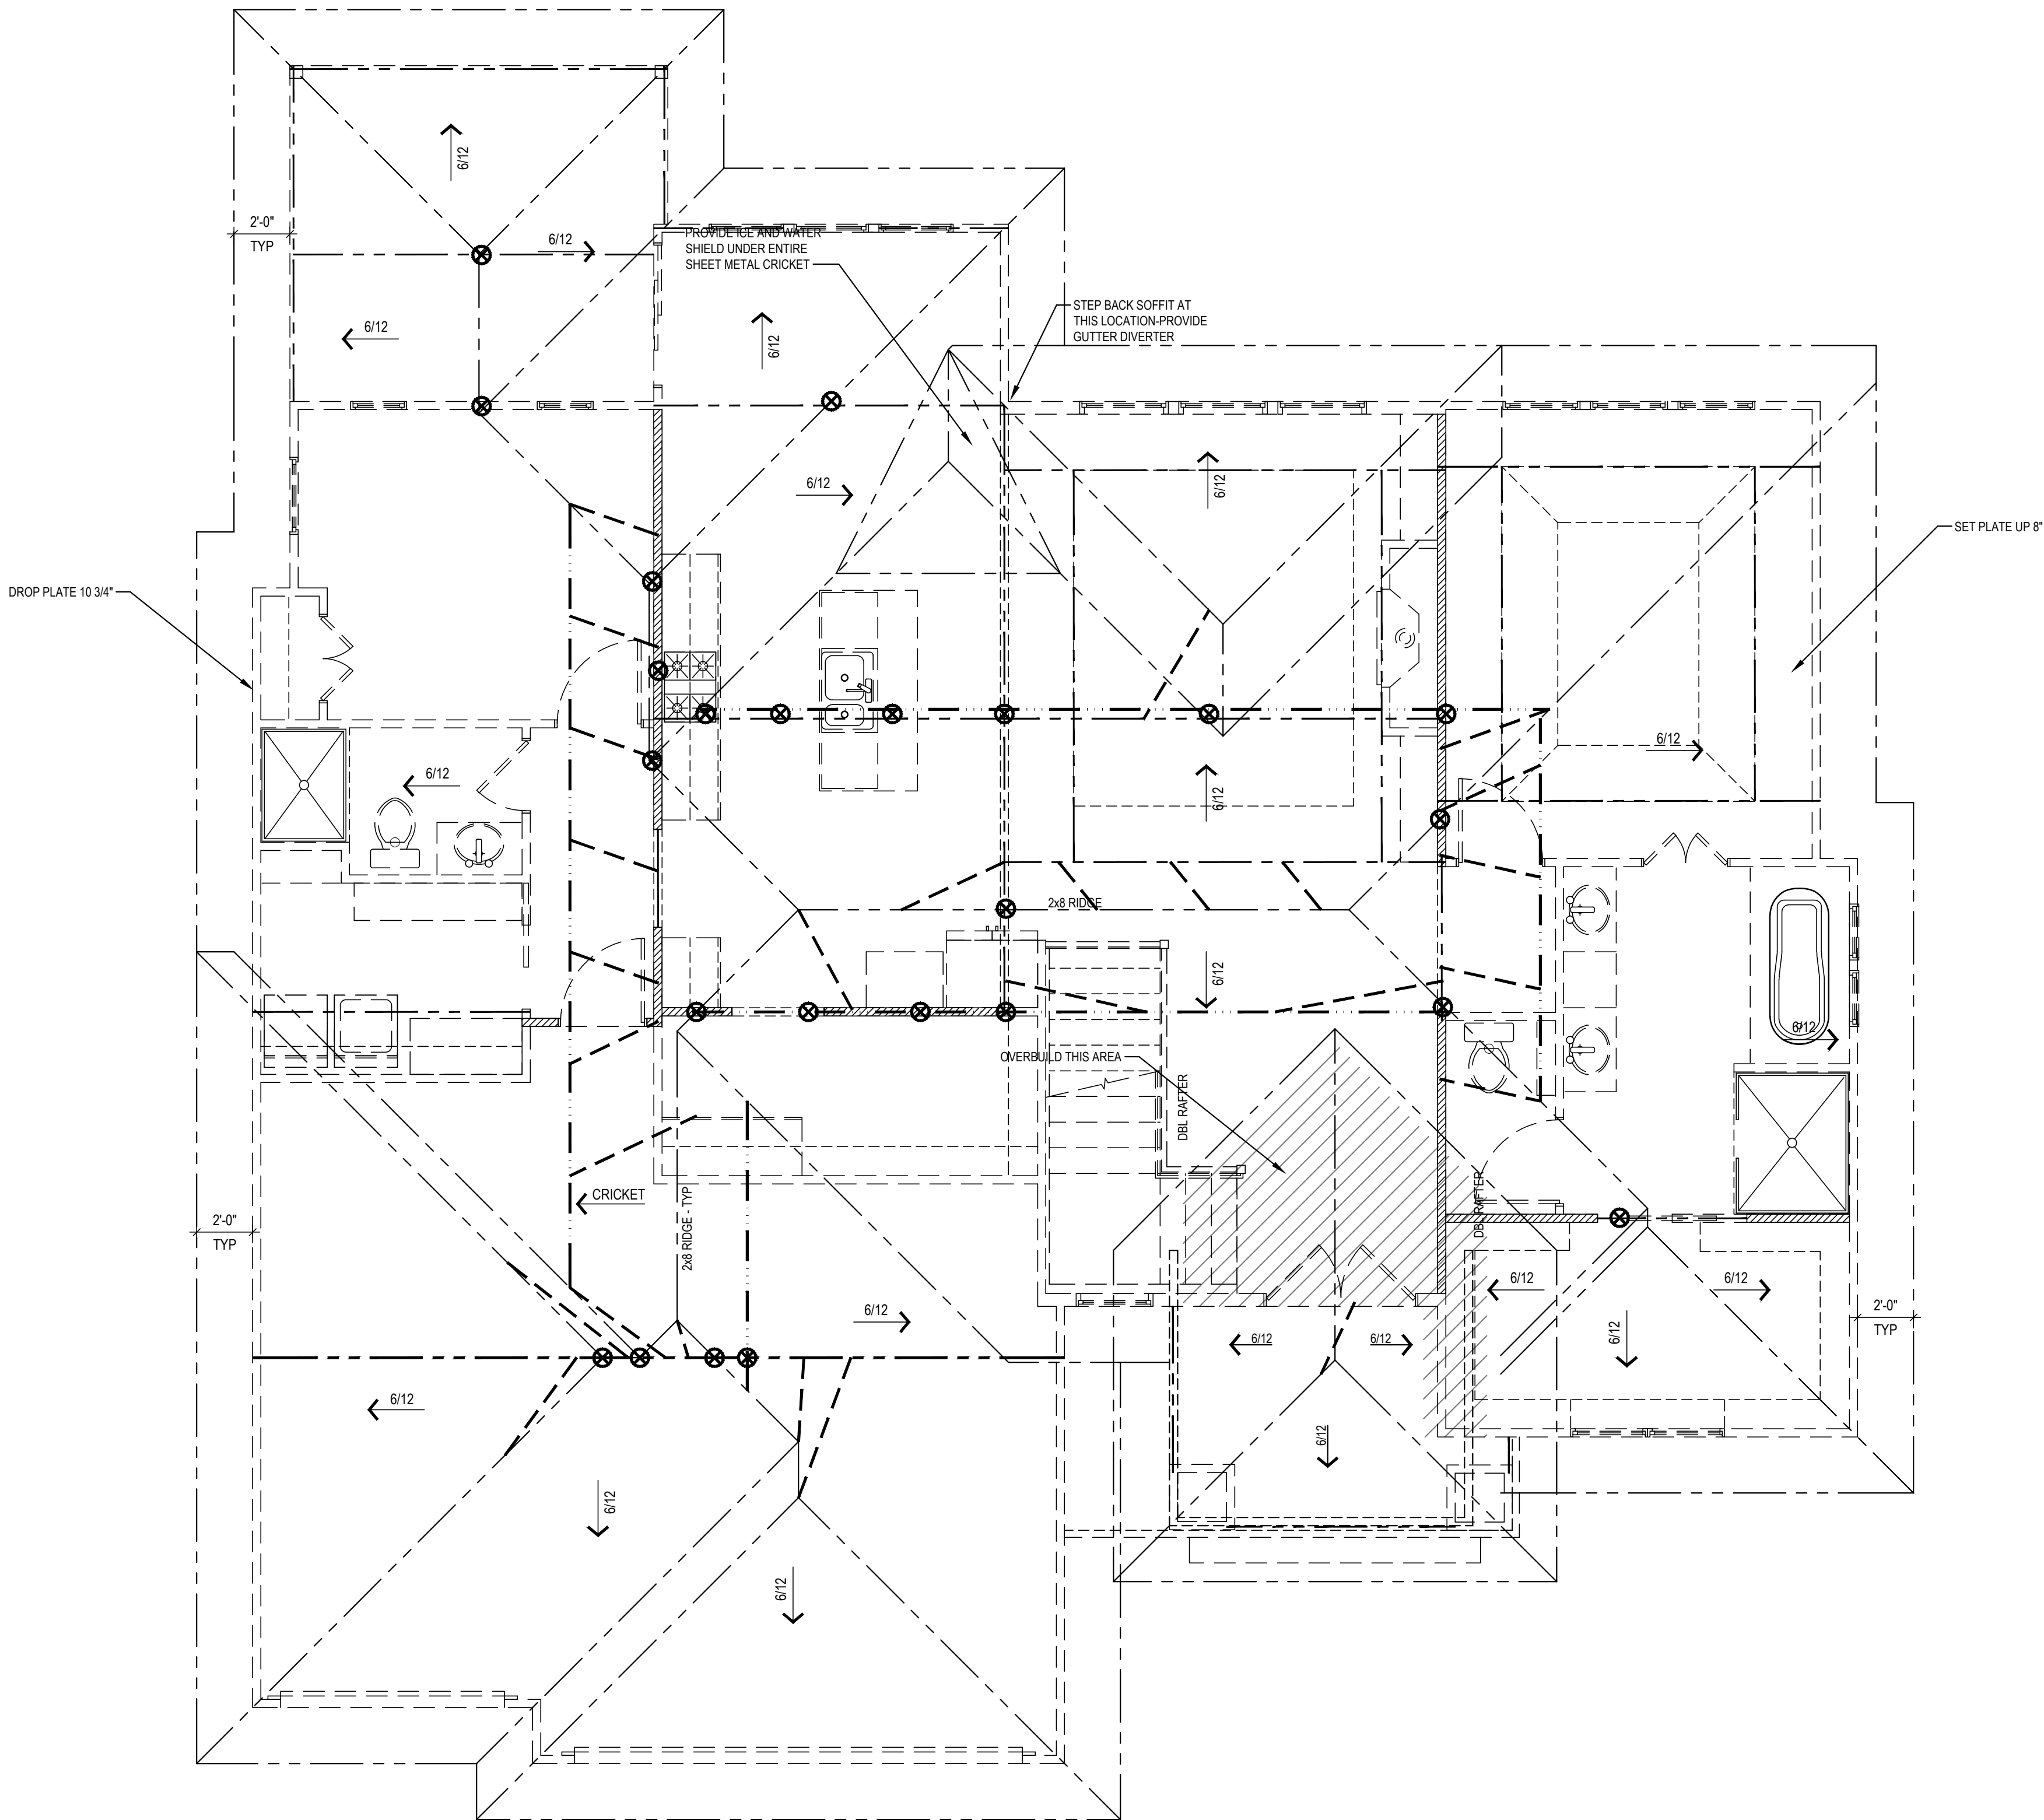

© COPYRIGHT 2021

JFE CONSTRUCTION INC.
1314 SW Market Street
Lee's Summit, MO 64081
v: 816.786.4008
jfeconstruction.com

VAN DEURZEN & ASSOCIATES, P.A.
11011 KING STREET SUITE 130
OVERLAND PARK, KS 66210
(913) 451-6305 FAX (913) 451-0021
WEB PAGE WWW.VANDEURZENANDASSOCIATES.COM
E-MAIL V2@VANDEURZENANDASSOCIATES.COM

Van Deurzen and Associates, P.A. © 2021



THE GUNNISON MODERN

Spec Residence
1601 SW 27th Street, Lee's Summit, MO
Whispering Woods - Lot 41

Project #: 8083-XXXX


DATE:

Permit: 11/12/2021


Roof
Plan

A104


RELEASE FOR CONSTRUCTION
NO MODIFICATION OR REVISION
OR DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
03/04/2022

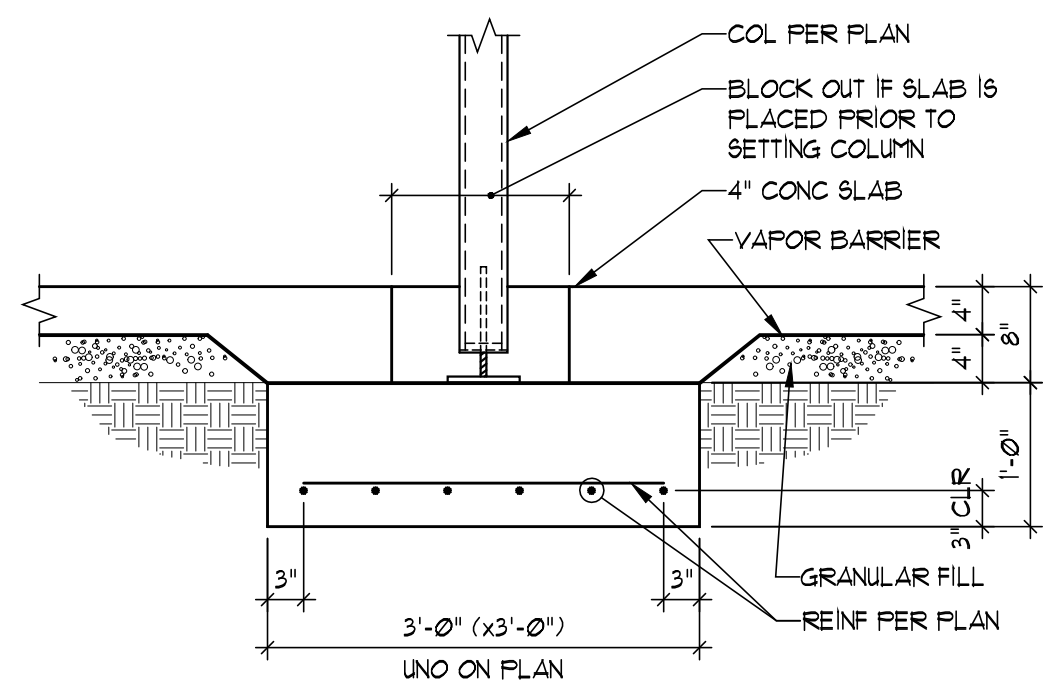


TYPICAL INTERIOR COLUMN
SCALE: 3/4" = 1'-0"

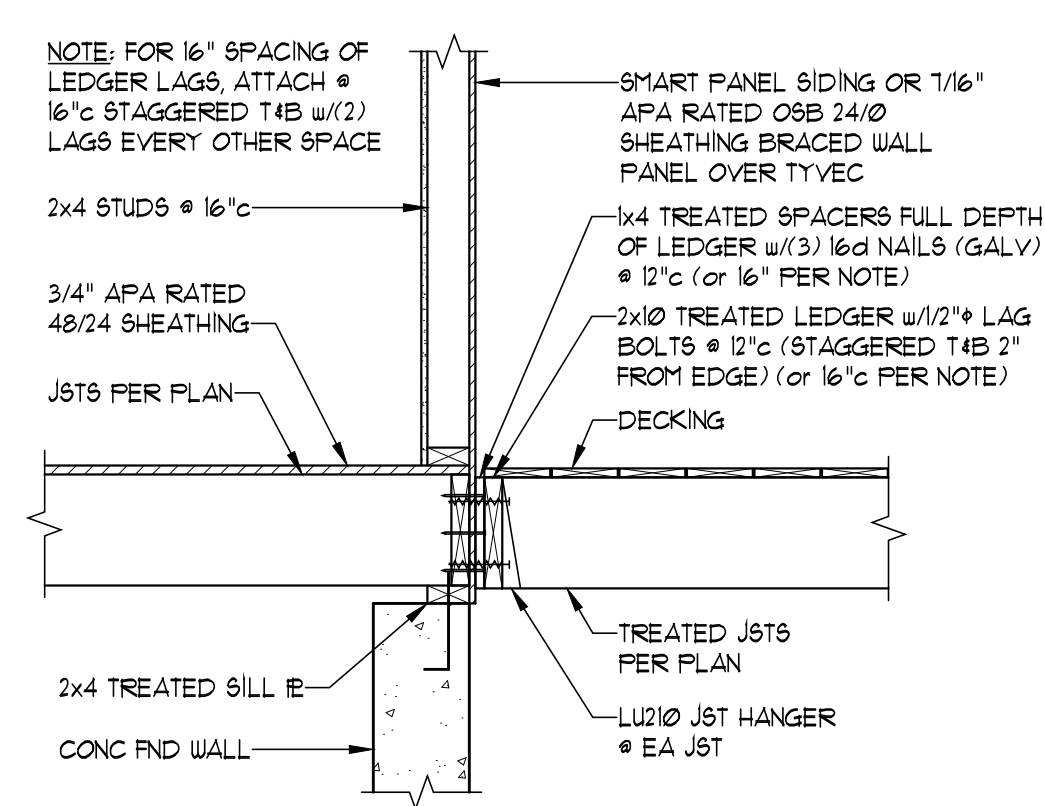


DECK ATTACHMENT
SCALE: 3/4" = 1'-0"

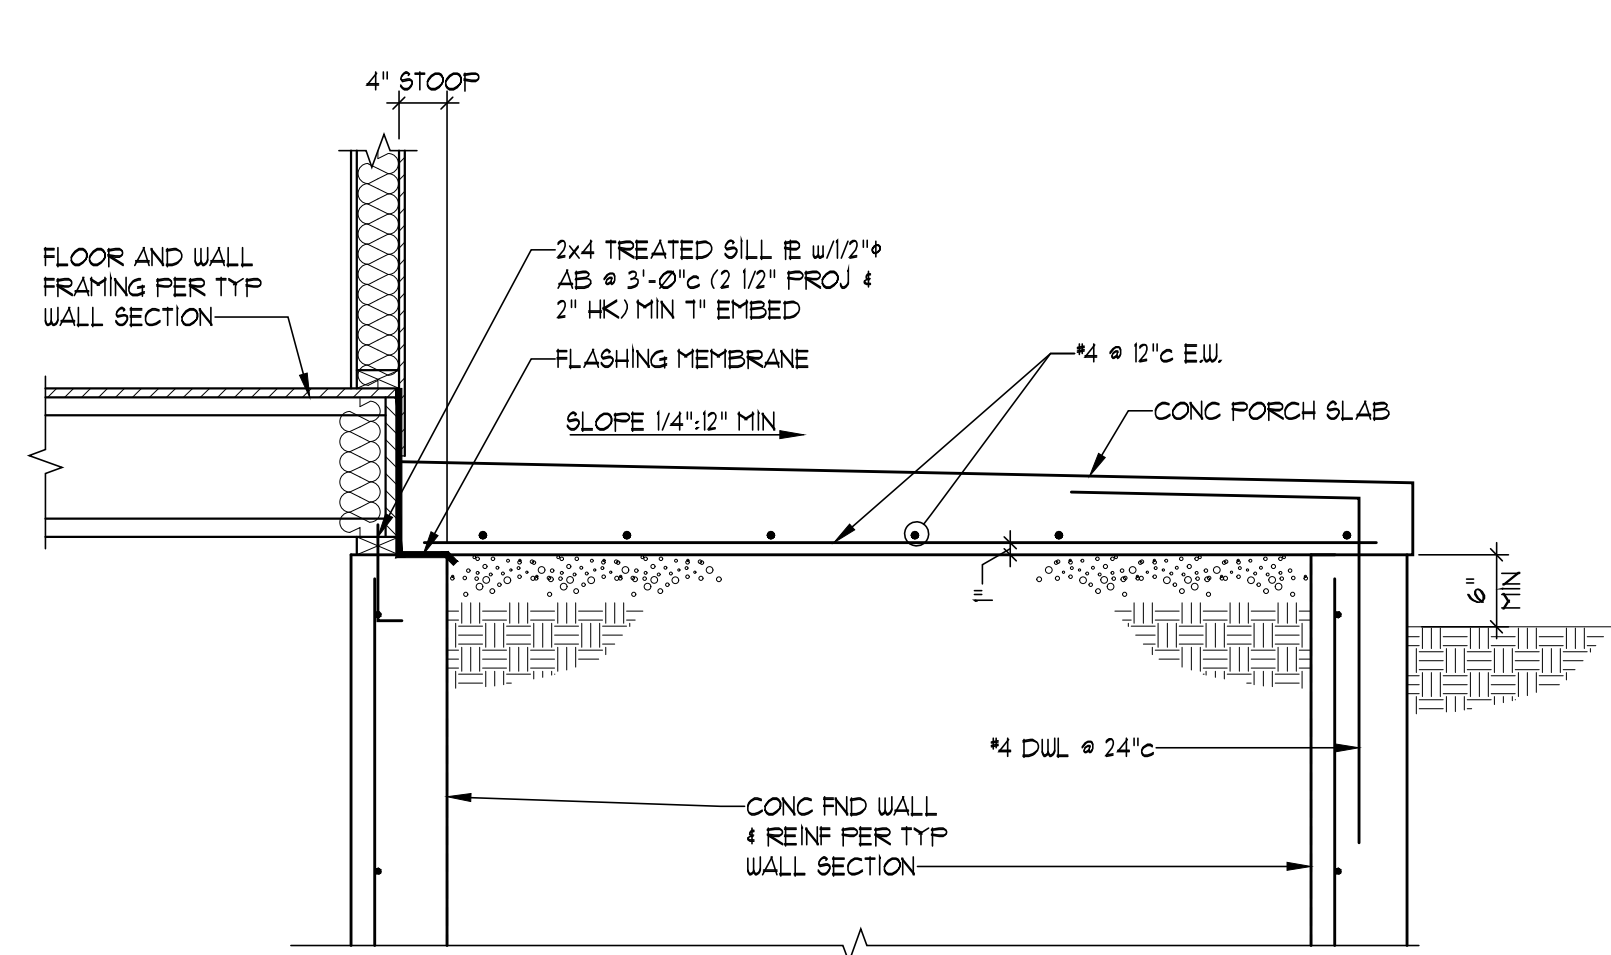


TYPICAL SECTION THRU PORCH
SCALE: 3/4" = 1'-0"

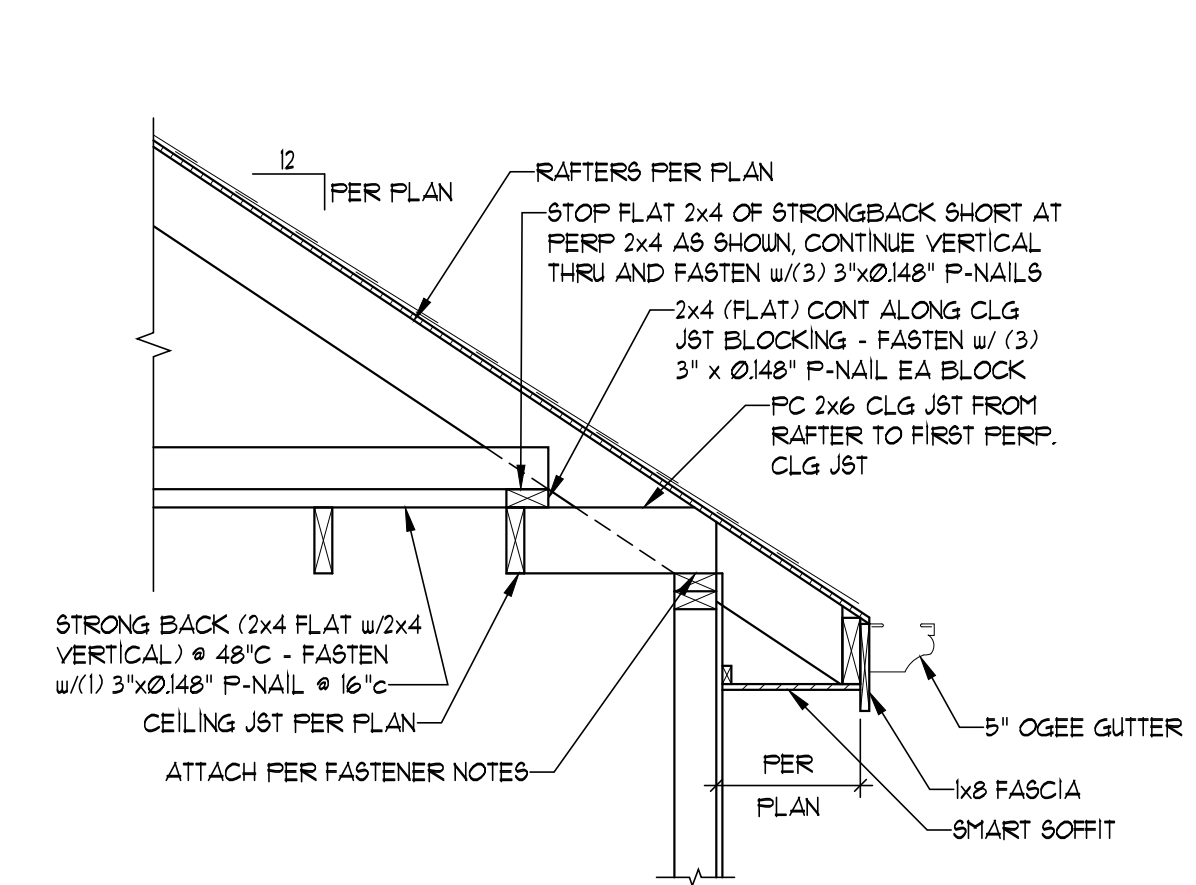


RAFTER ATTACHMENT AT PERPENDICULAR CONDITIONS
SCALE: 3/4" = 1'-0"

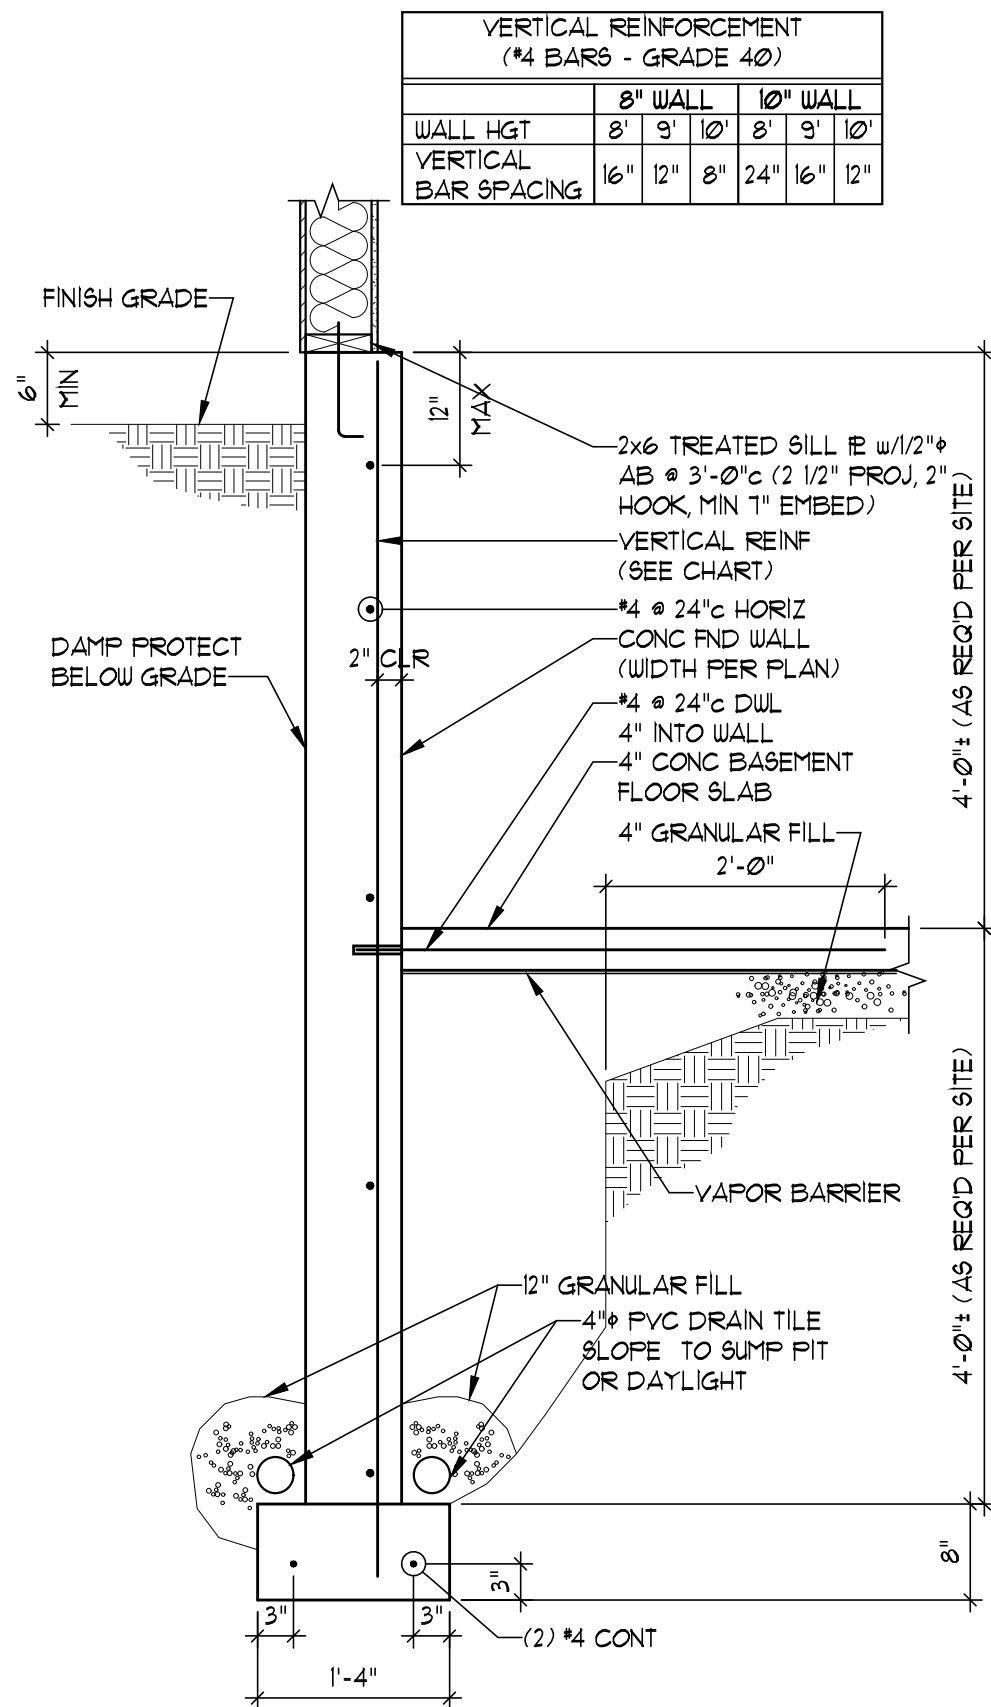


TYPICAL DAYLIGHT SECTION
SCALE: 3/4" = 1'-0"

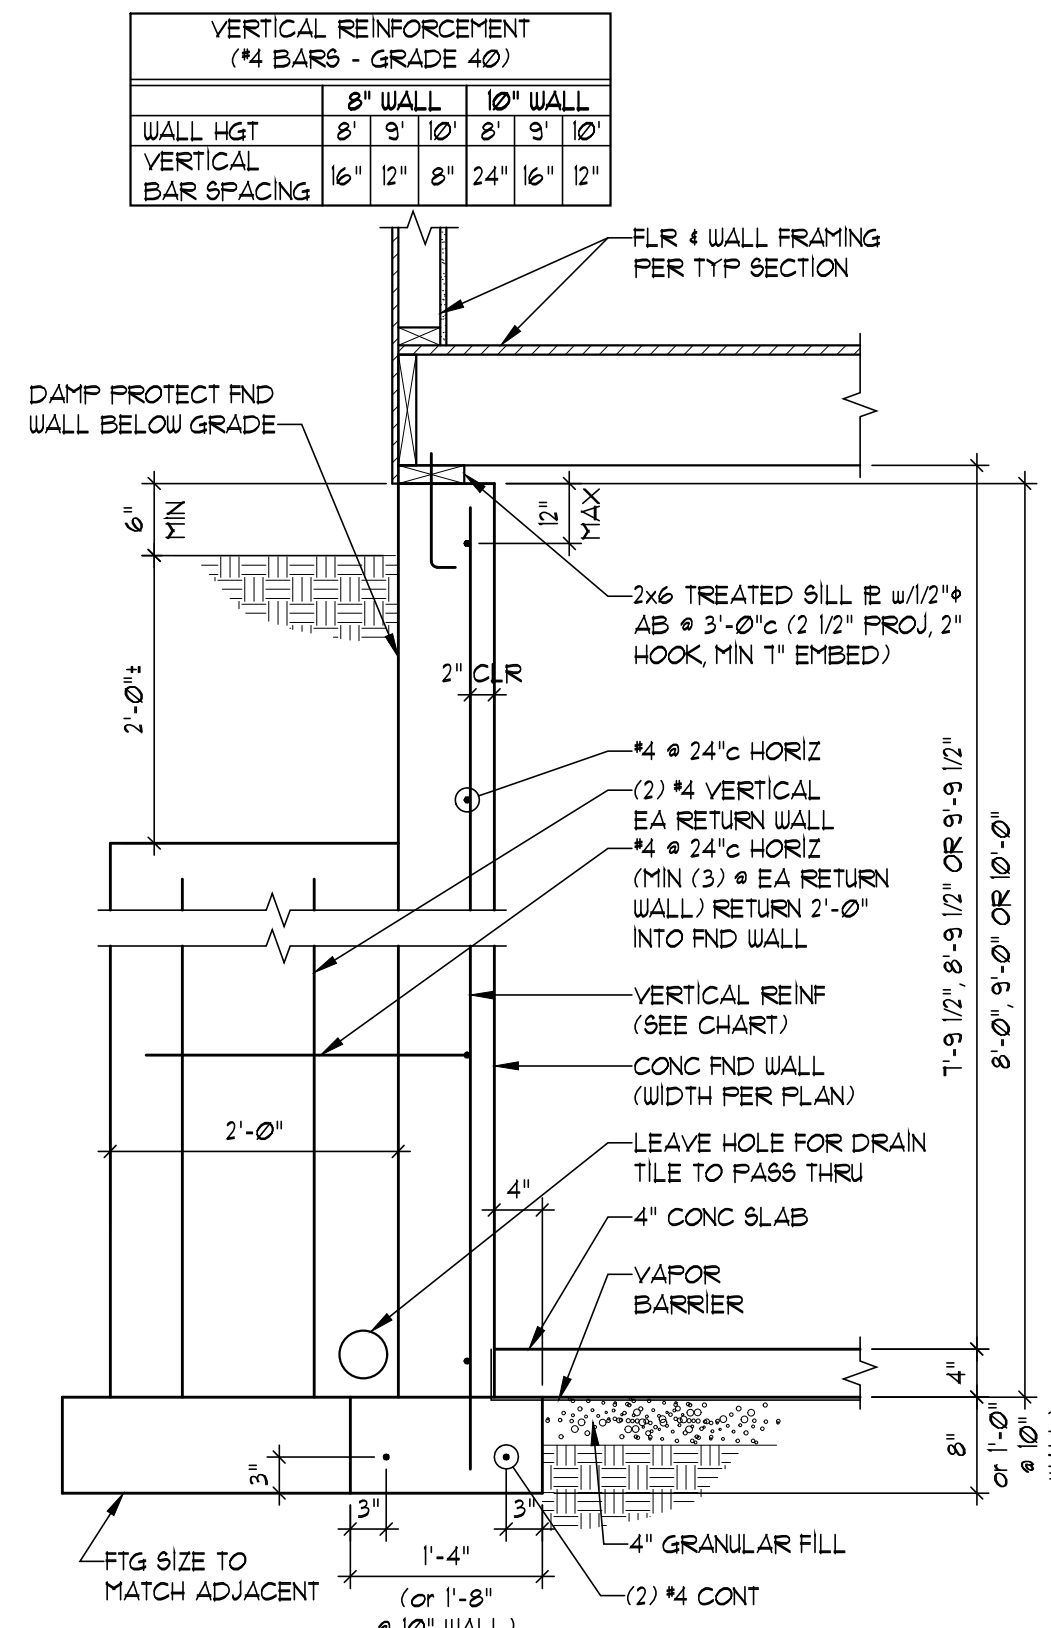


TYPICAL PILASTER SECTION
SCALE: 3/4" = 1'-0"

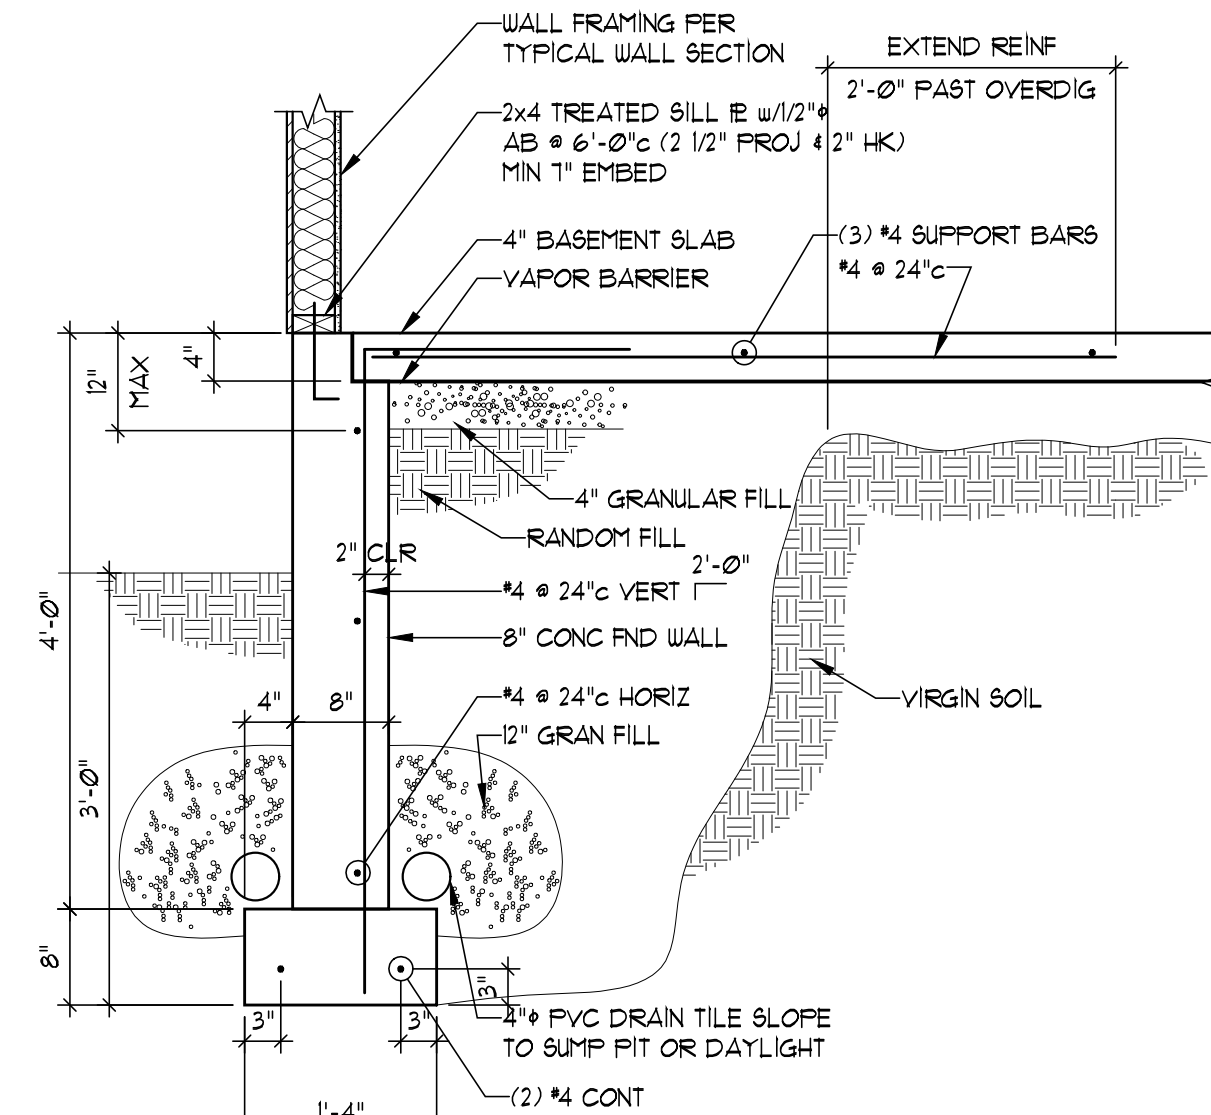


TYPICAL WALKOUT SECTION
SCALE: 3/4" = 1'-0"

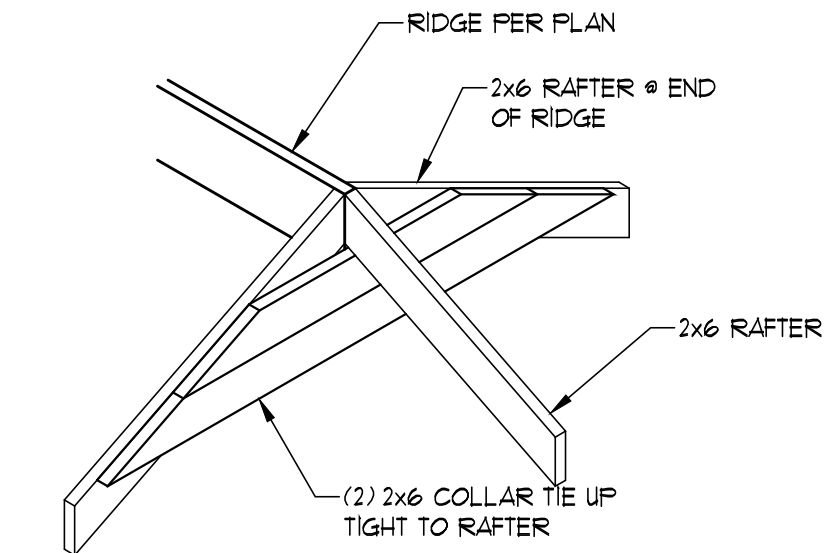


HIP RIDGE SUPPORT
SCALE: 1/2" = 1'-0"

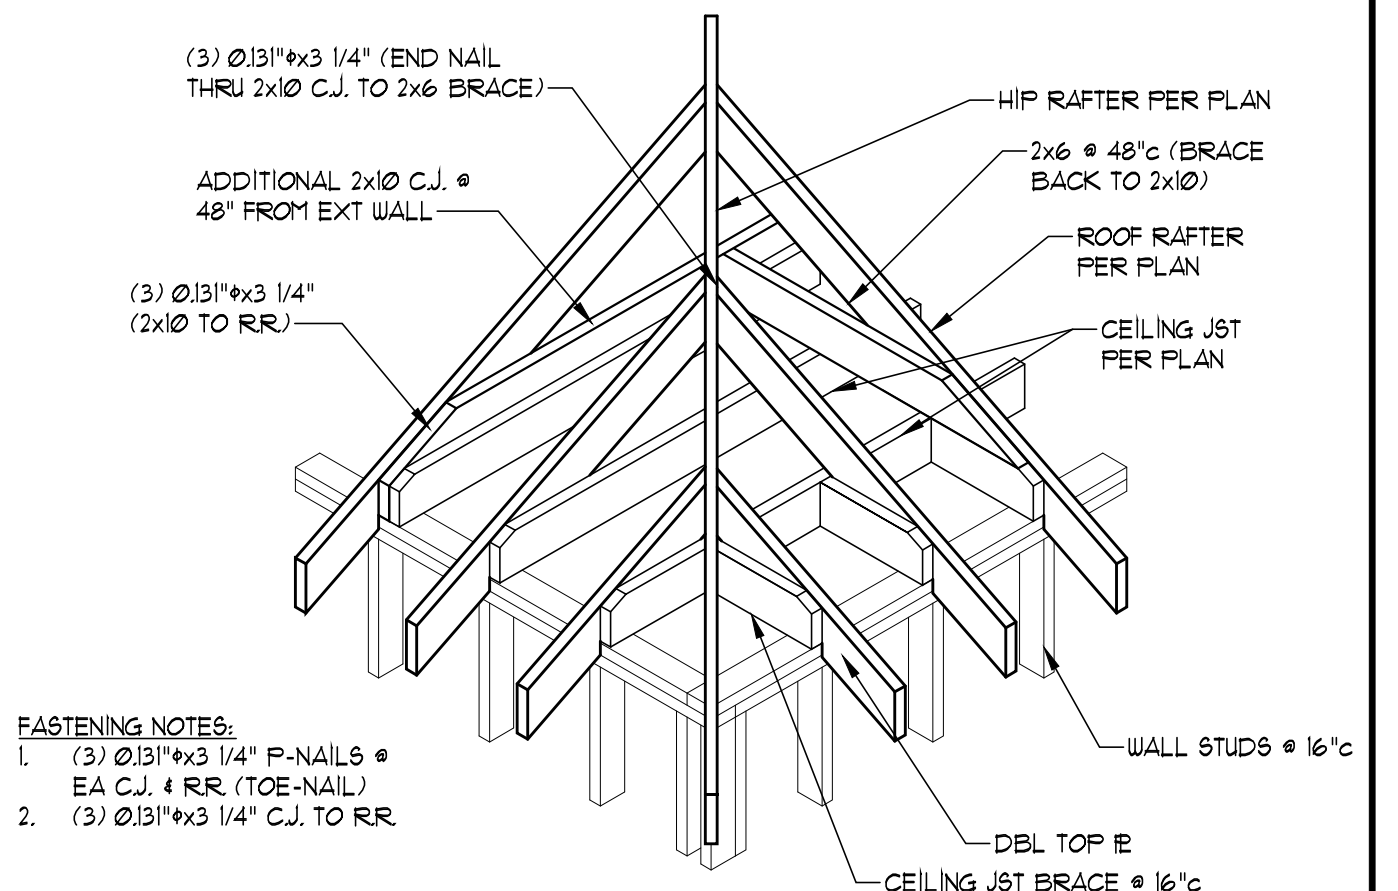


CEILING JOIST AND ROOF RAFTER CONNECTION @ HIP
SCALE: 1/2" = 1'-0"

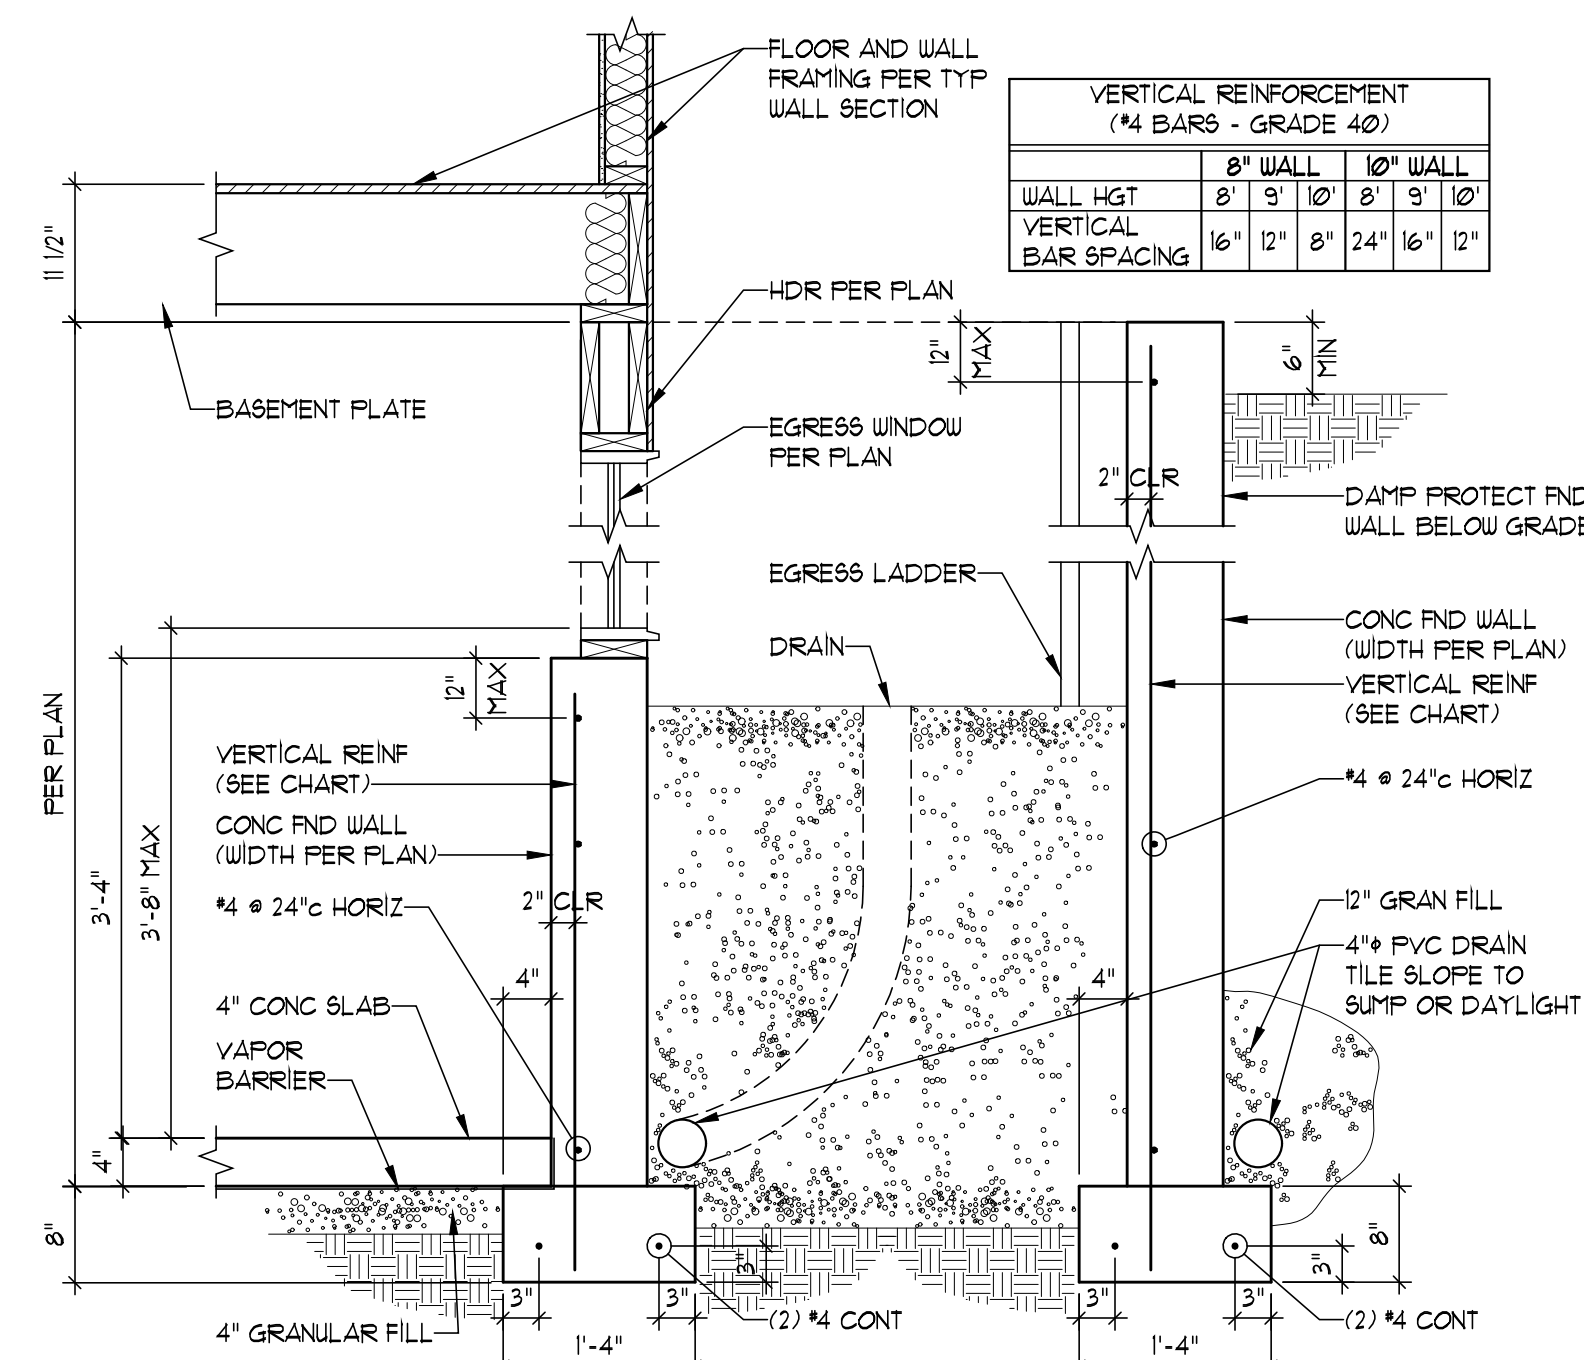

TYPICAL WINDOW WELL
SCALE: 3/4" = 1'-0"

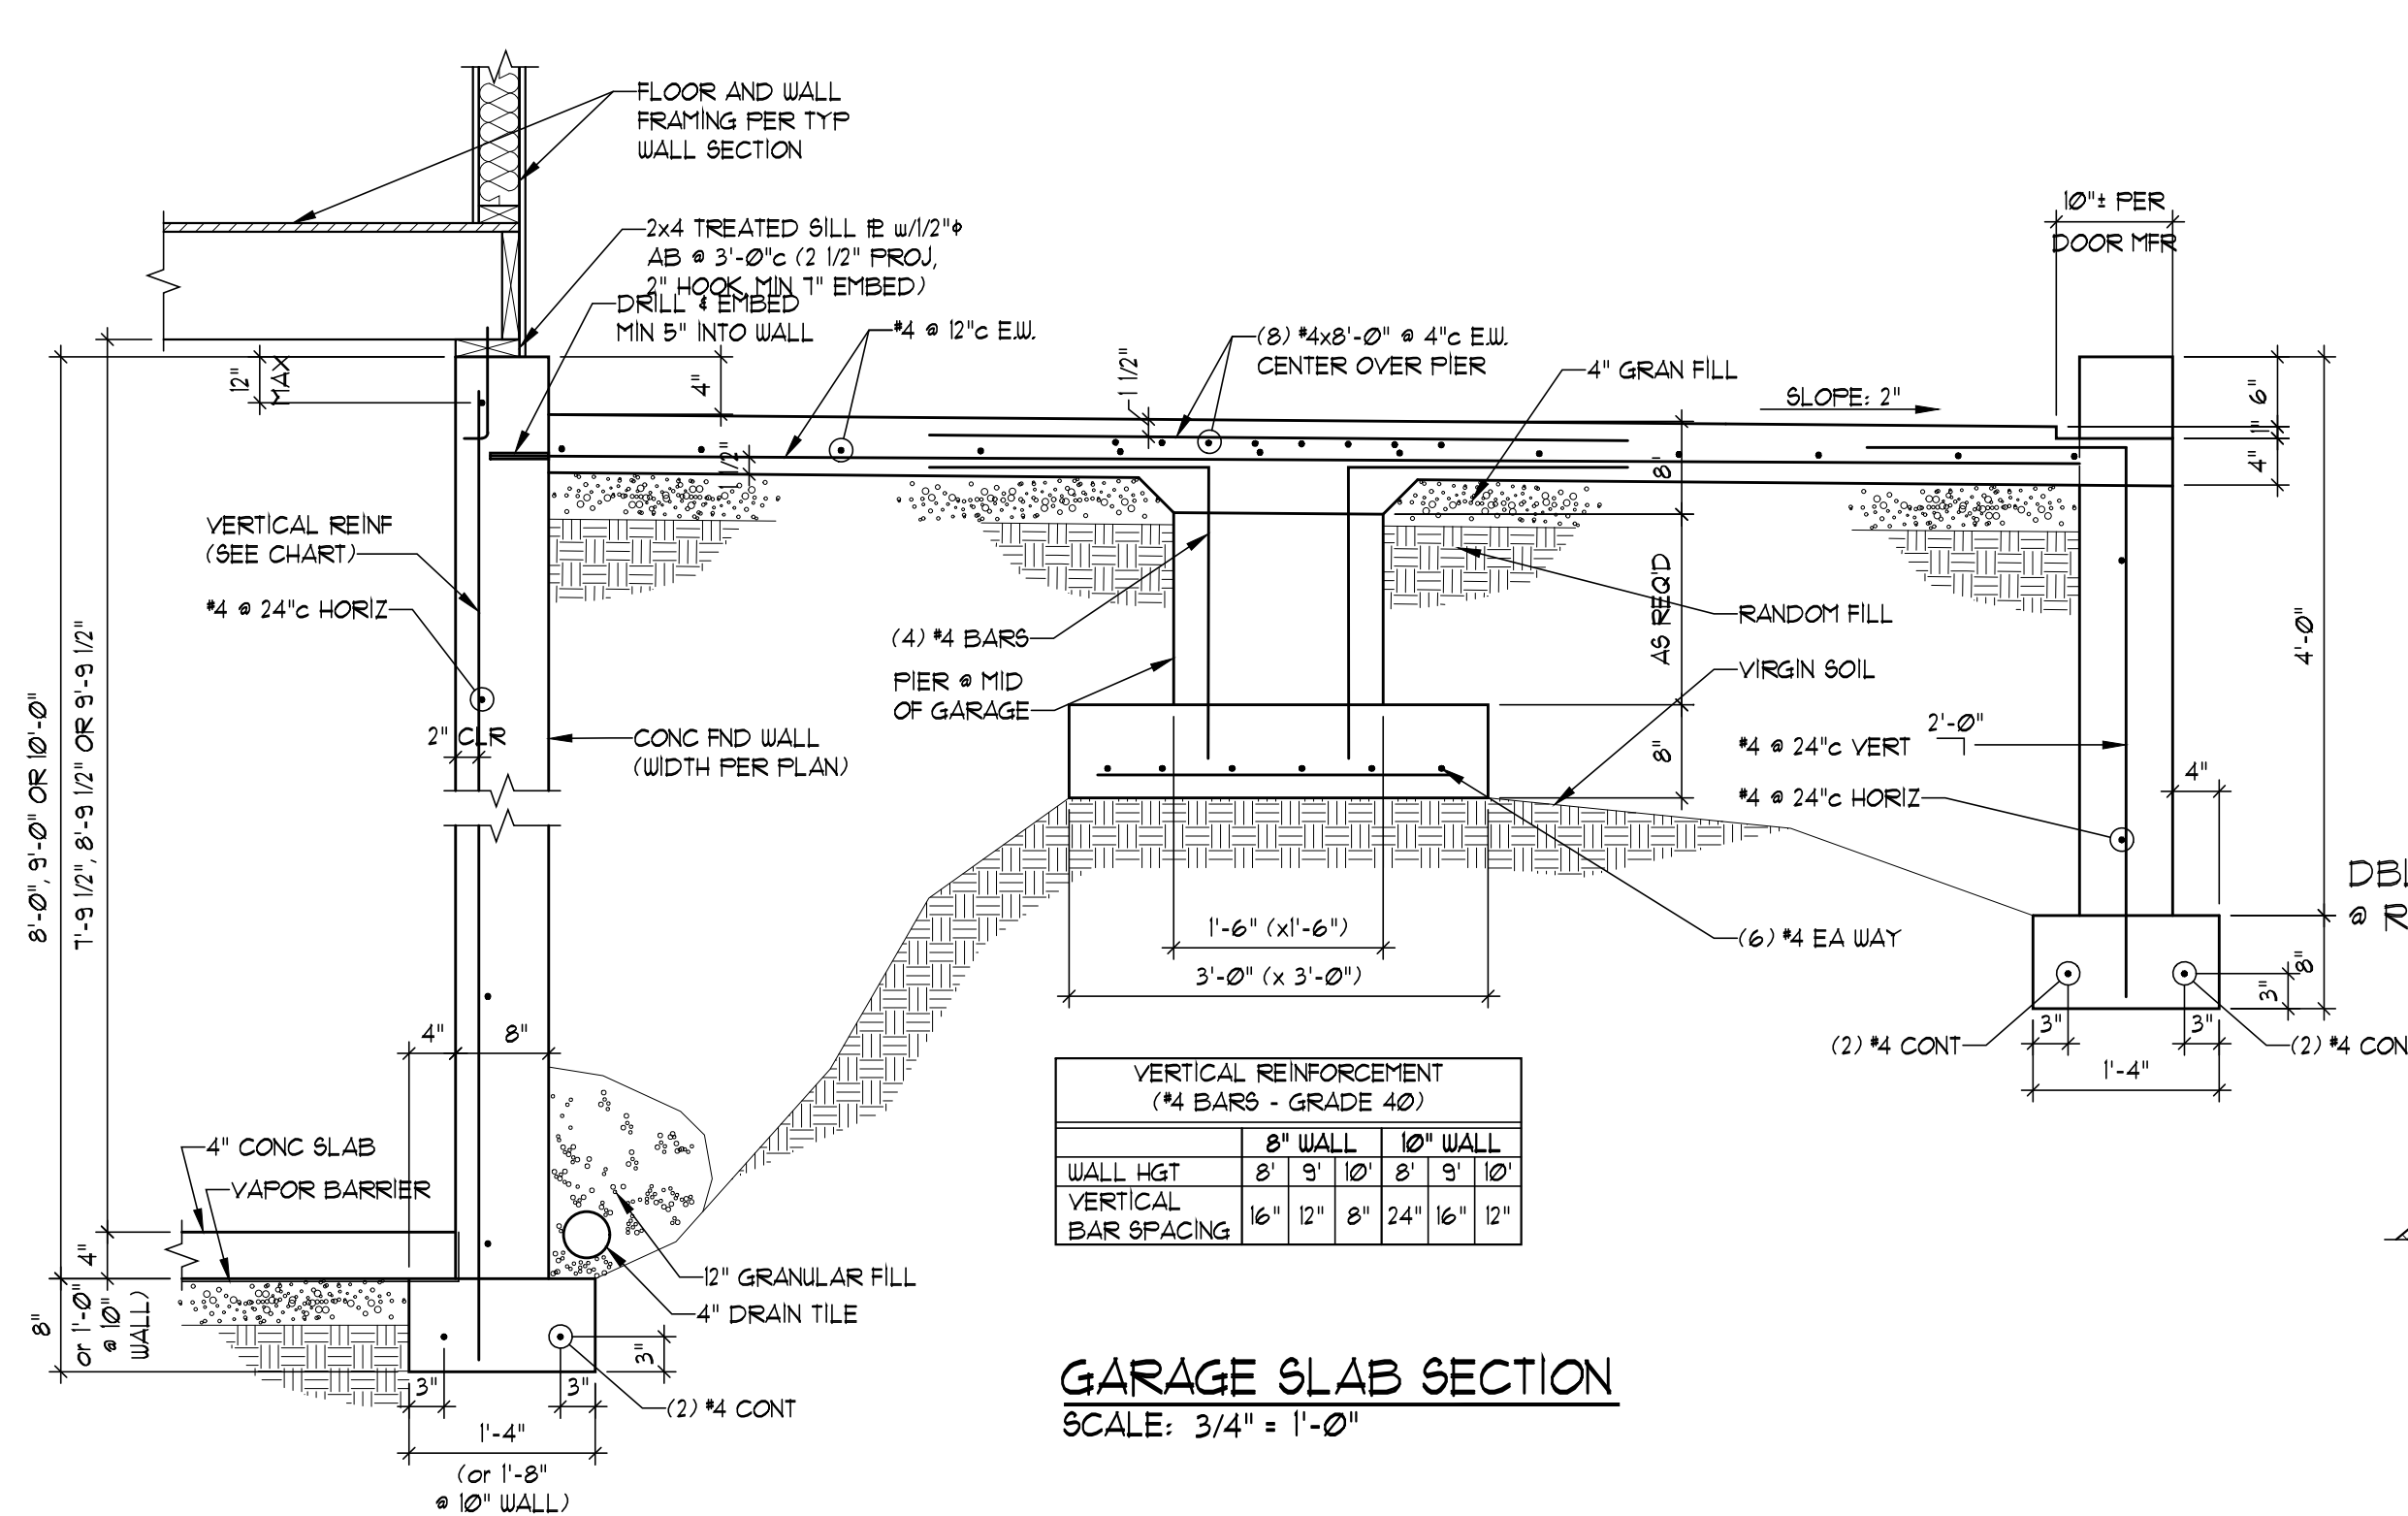

GARAGE SLAB SECTION
SCALE: 3/4" = 1'-0"

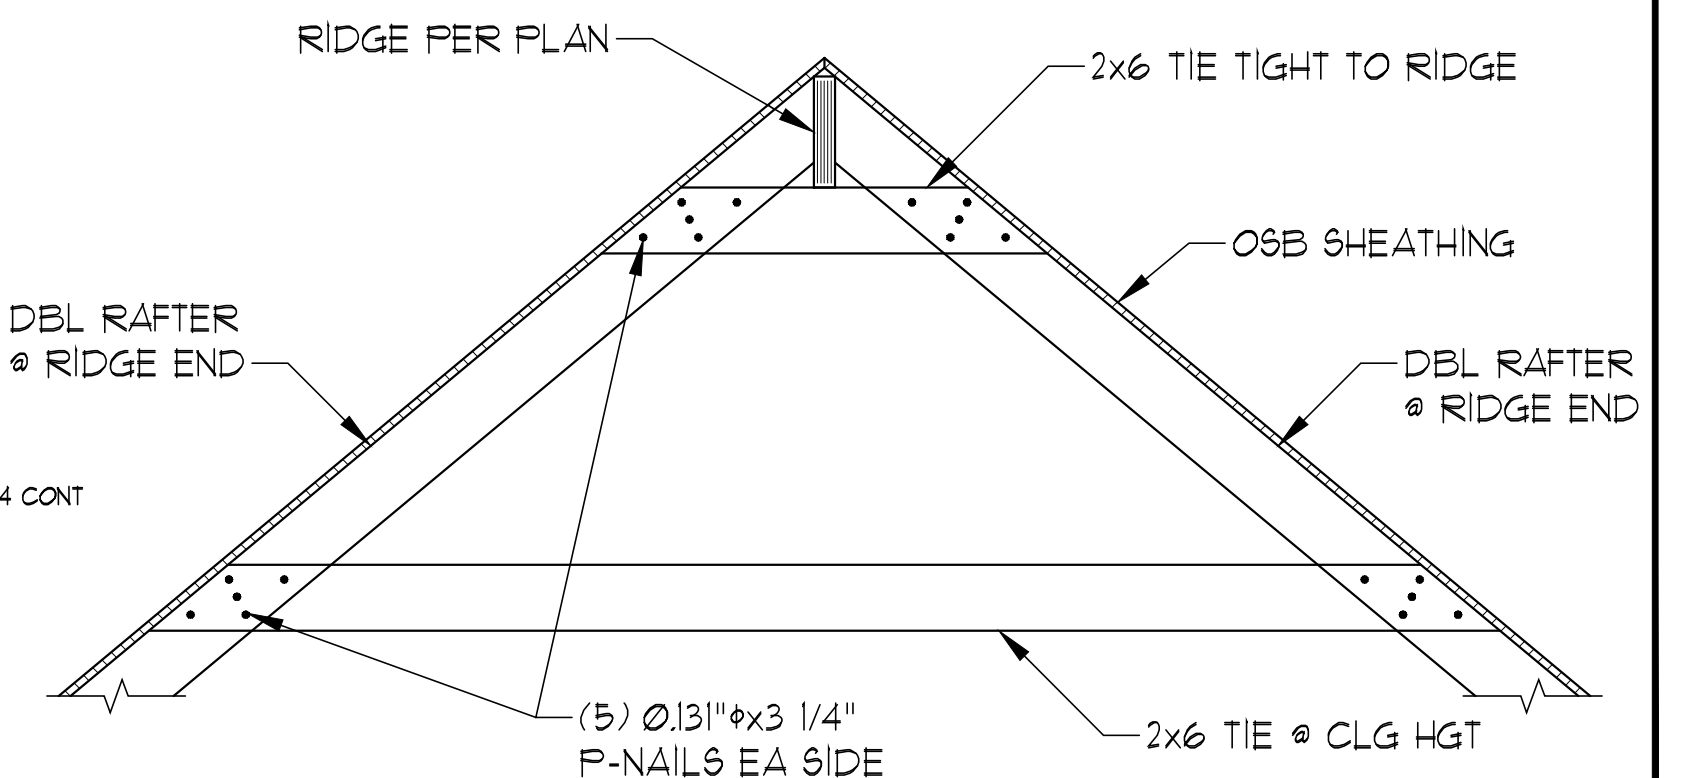

RIDGE SUPPORT DETAIL
SCALE: 1/2" = 1'-0"




© COPYRIGHT 2021

JFE CONSTRUCTION INC.
1314 SW Market Street
Lee's Summit, MO 64081
v: 816.786.4008
jfeconstruction.com



Van Deuren and Associates, P.A. © 2021

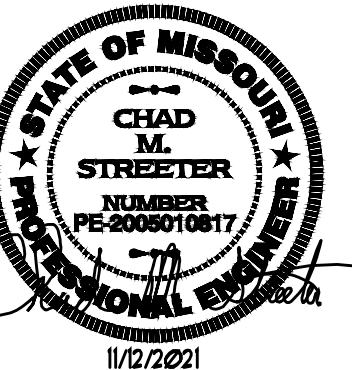

THE GUNNISON MODERN

Spec Residence
1601 SW 27th Street, Lee's Summit, MO
Whispering Woods - Lot 41

Project #: 8083-XXXX
DATE:
Permit: 11/12/2021

Framing Notes and Details

S101

RELEASED FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
03/04/2022



© COPYRIGHT 2021

JFE CONSTRUCTION INC.
1314 SW Market Street
Lee's Summit, MO 64081
v: 816.786.4008
jfeconstruction.com



Van Deuren and Associates, P.A. © 2021



THE GUNNISON MODERN


Spec Residence
1601 SW 27th Street, Lee's Summit, MO
Whispering Woods - Lot 41

Project #: 8083-XXXX
DATE:
Permit: 11/12/2021


Framing Notes
and Details

S102


RELEASER FOR CONSTRUCTION
NO REVISIONS
PRIVATE CLIENT SERVICES
LEE'S SUMMIT, MISSOURI
03/04/2022

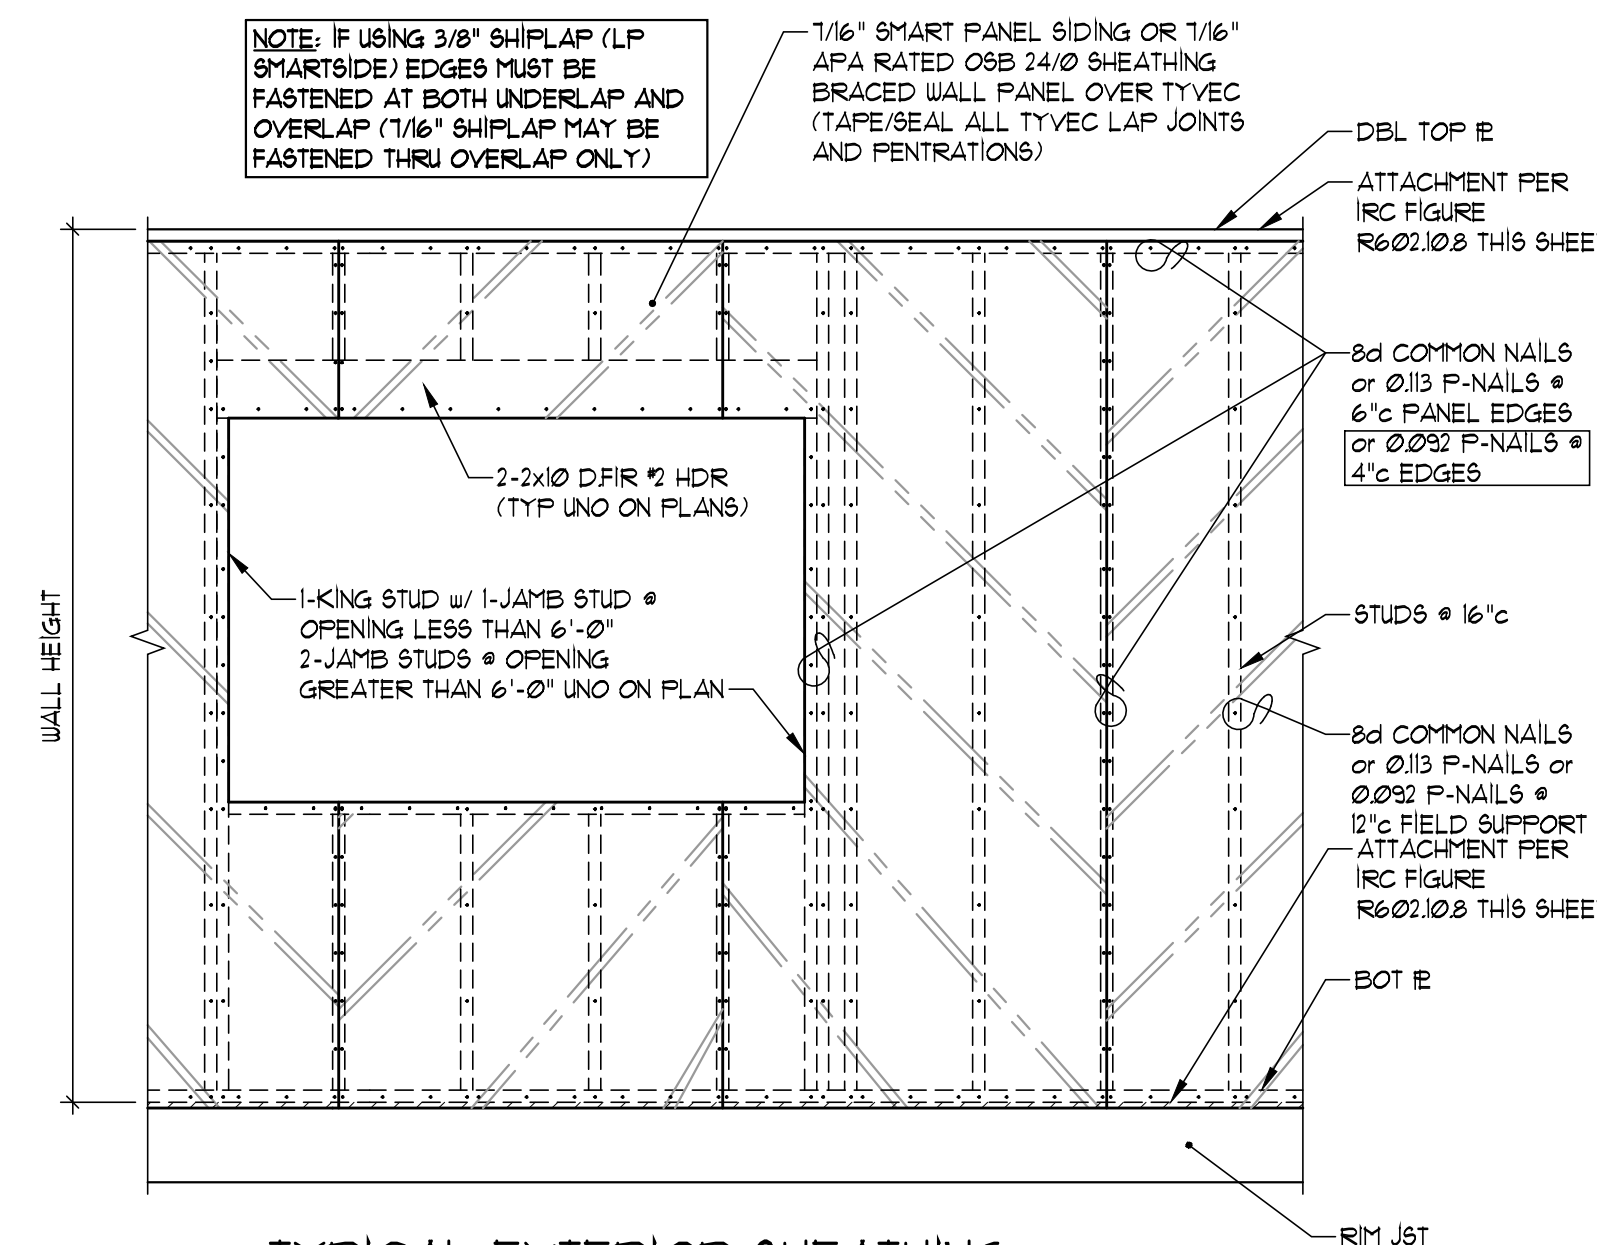

TYPICAL EXTERIOR SHEATHING
INSTALLATION (METHOD WSP & CS-WSP)
SCALE: 1/2" = 1'-0"

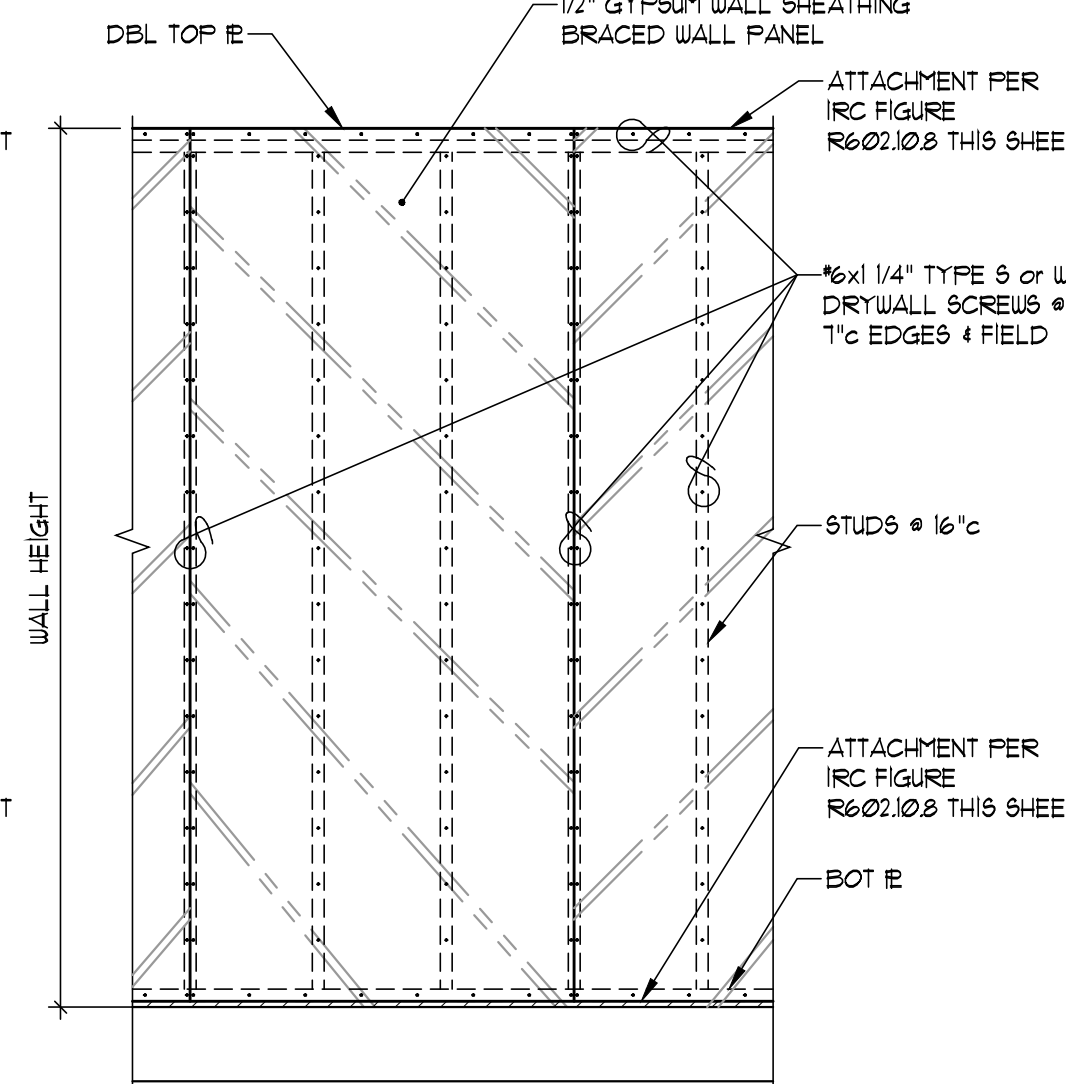


TYPICAL INTERIOR SHEATHING
INSTALLATION (METHOD GB)
SCALE: 1/2" = 1'-0"

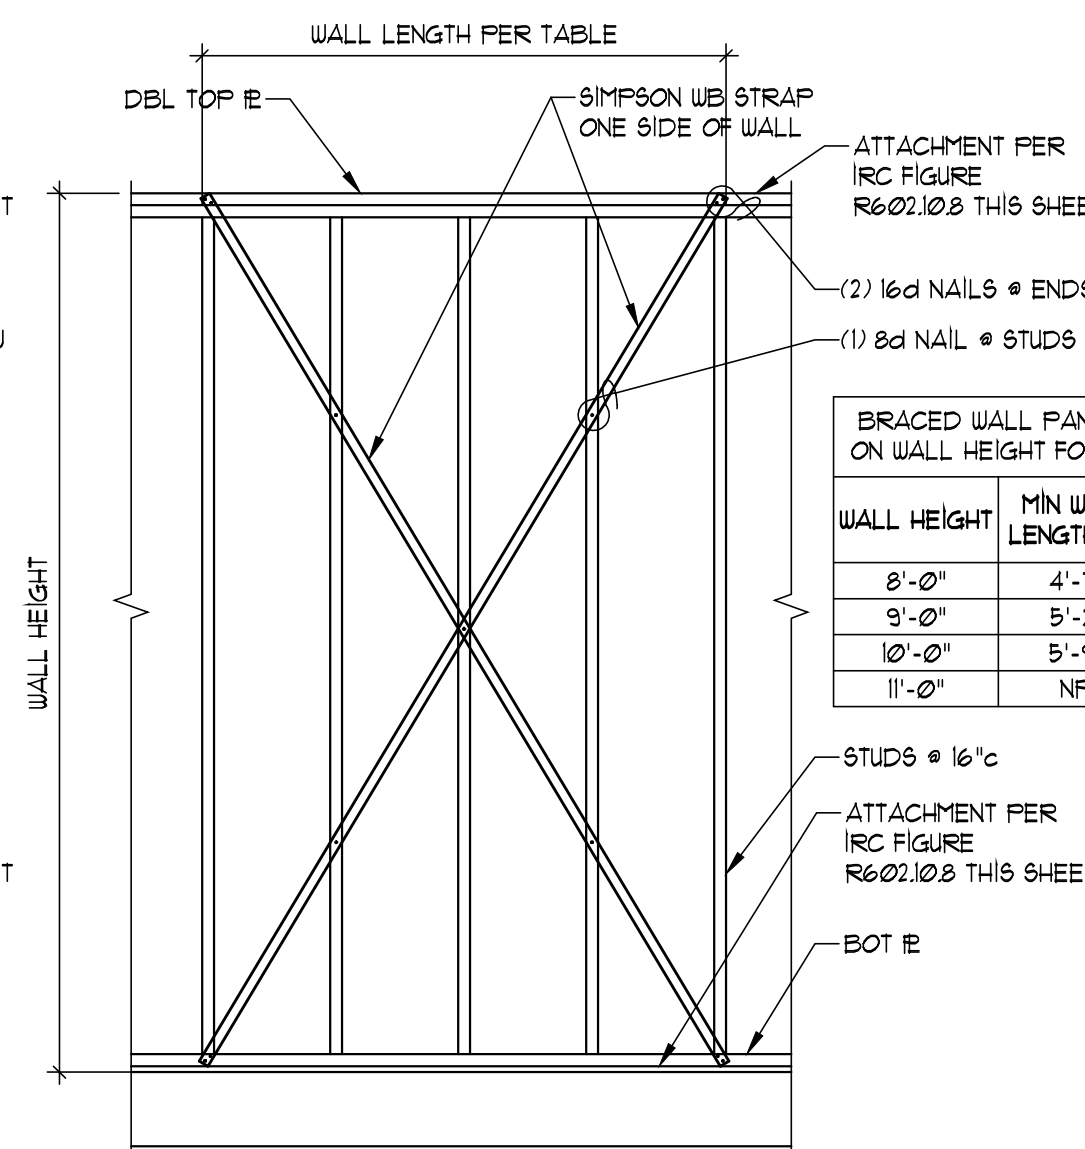


INTERIOR SHEATHING
INSTALLATION (METHOD LIB)
SCALE: 1/2" = 1'-0"

BRACED WALL PANEL LENGTHS BASED ON WALL HEIGHT FOR 2012 IRC, TYPE LIB		
WALL HEIGHT	MIN WALL LENGTH (X)	MAX WALL LENGTH (X)
8'-0"	4'-1"	8'-0"
9'-0"	5'-2"	9'-0"
10'-0"	5'-3"	10'-0"
11'-0"	NP	NP

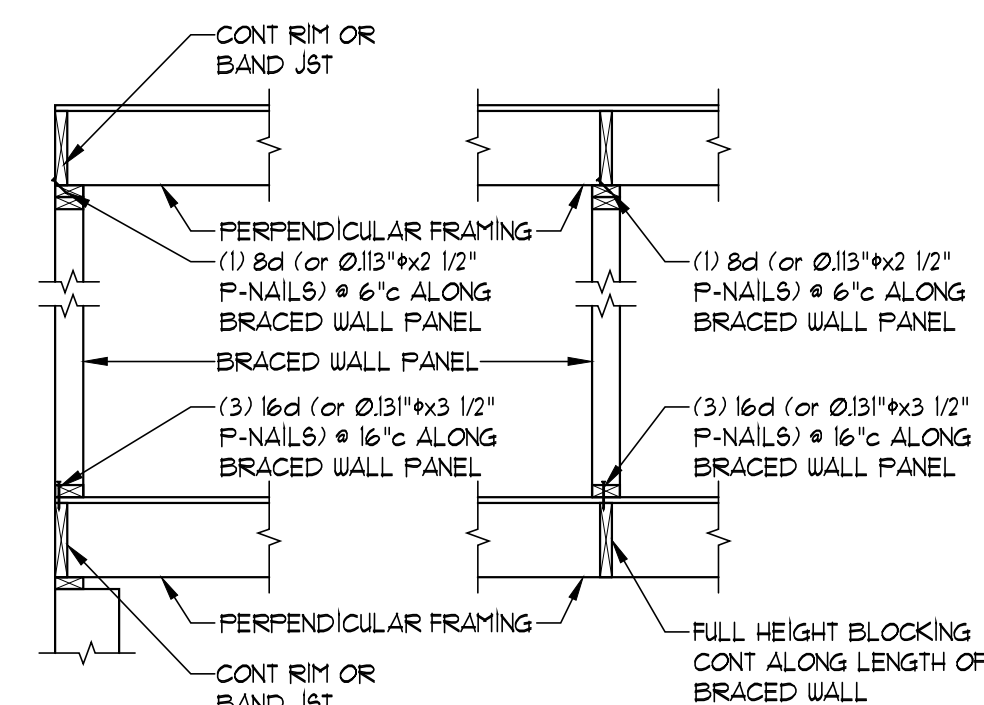

IRC FIGURE R602.10.2(1)
BRACED WALL PANEL CONNECTION WHEN
PERPENDICULAR TO FLOOR/CEILING FRAMING

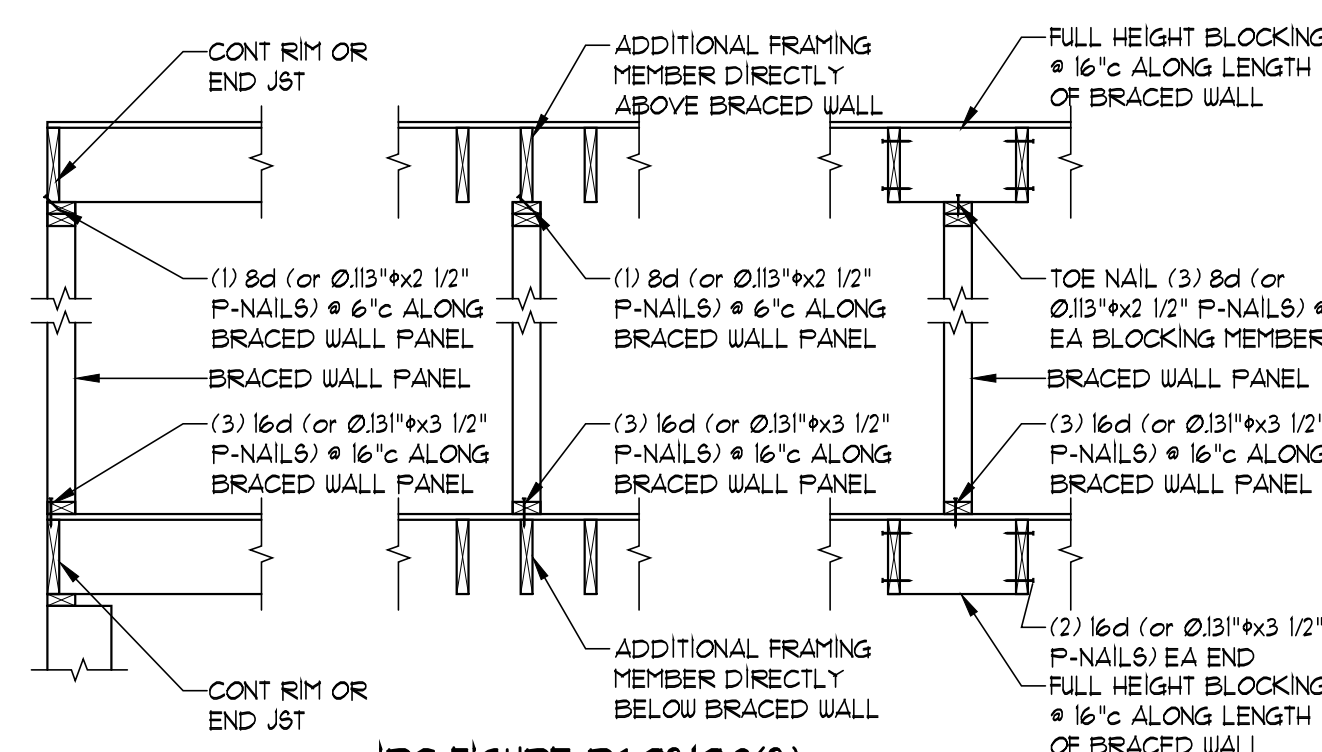

IRC FIGURE R602.10.2(2)
BRACED WALL PANEL CONNECTION WHEN
PARALLEL TO FLOOR/CEILING FRAMING



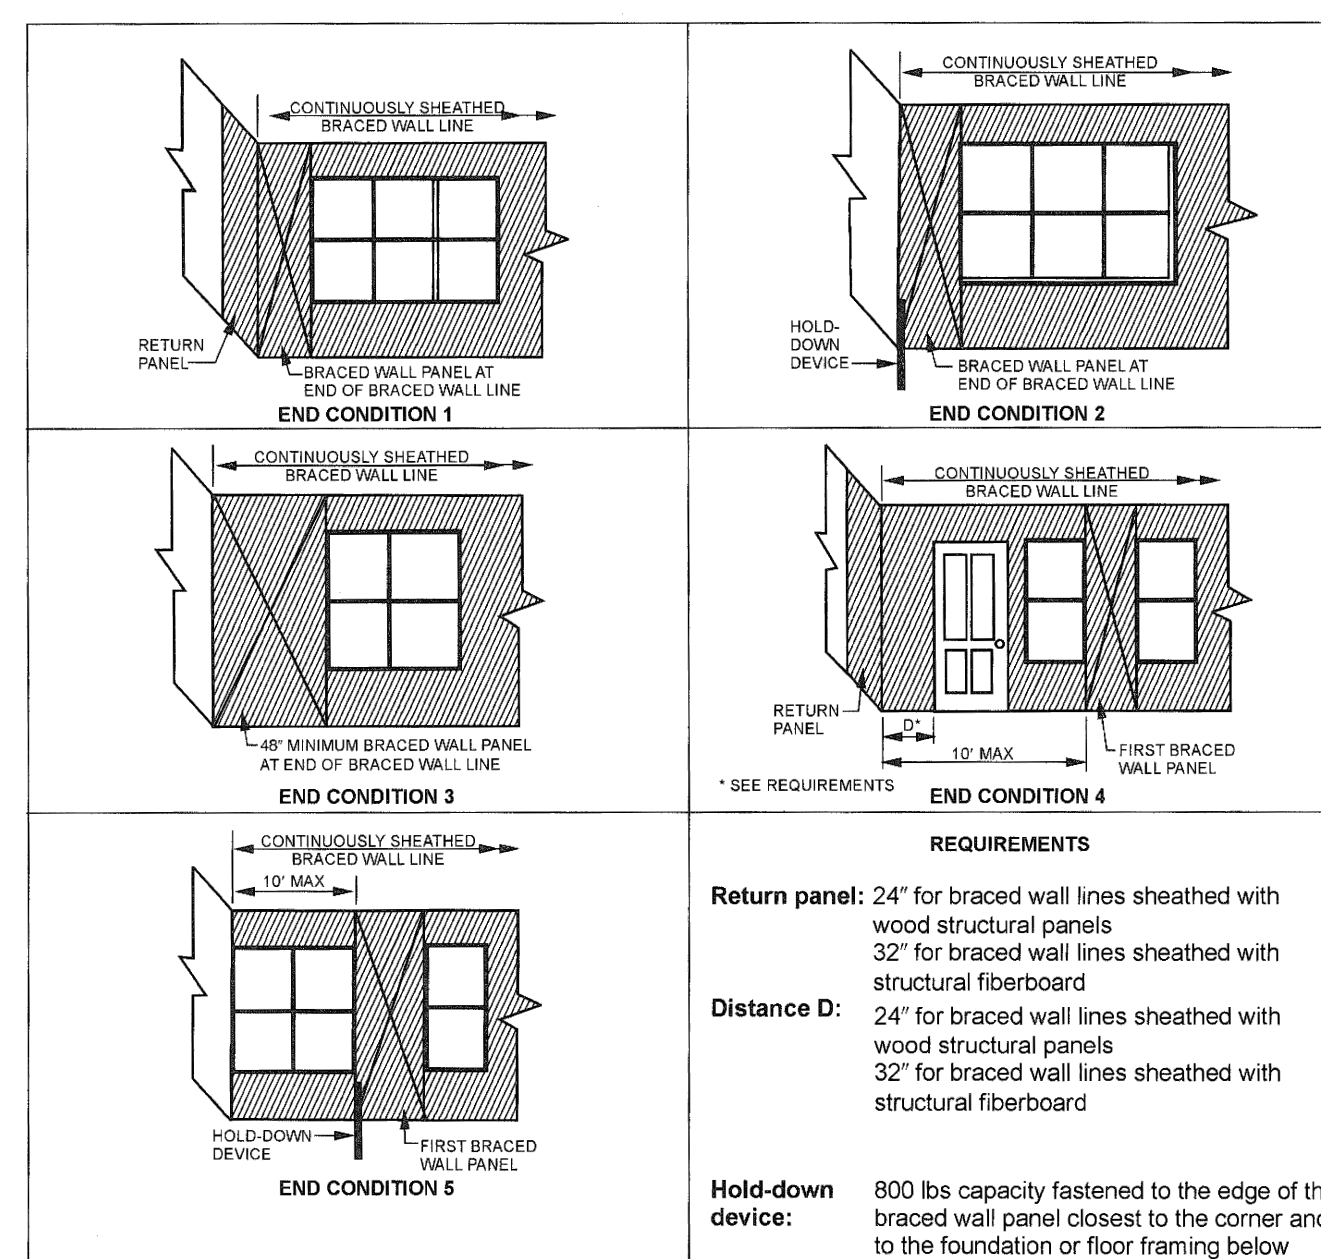


FIGURE R602.10.7
END CONDITIONS FOR BRACED WALL LINES WITH CONTINUOUS SHEATHING

TABLE 602.10.6.4 TENSION STRAP CAPACITY REQUIRE FOR RESISTING WIND PRESSURES PERPENDICULAR TO METHOD PFH, PFH, AND CS-PF BRACED WALL PANELS					
MINIMUM WALL STUD FRAMING NOMINAL SIZE AND GAGE	MAXIMUM PONY WALL HEIGHT (FEET)	MAXIMUM TOTAL WALL HEIGHT (FEET)	MAXIMUM OPENING WIDTH (FEET)	TENSION STRAP CAPACITY REQUIRED (LBS) FOR V _{ult} = 150mph	
2x4 #2 GRADE	0	10	10	1000	1000
			9	1000	1000
			16	1075	2500
	2	10	12	1215	2850
			9	1000	1875
			16	2175	4125
	2	12	10	2500	DESIGN
			9	1500	3175
			16	3375	DESIGN
	4	12	10	3975	DESIGN
			9	2150	DESIGN
			12	3175	DESIGN
2x6 STUD GRADE	2	12	9	1000	2075
			16	2150	3675
			9	2500	DESIGN
	4	12	11	1150	DESIGN
			16	2400	DESIGN
			10	3800	DESIGN

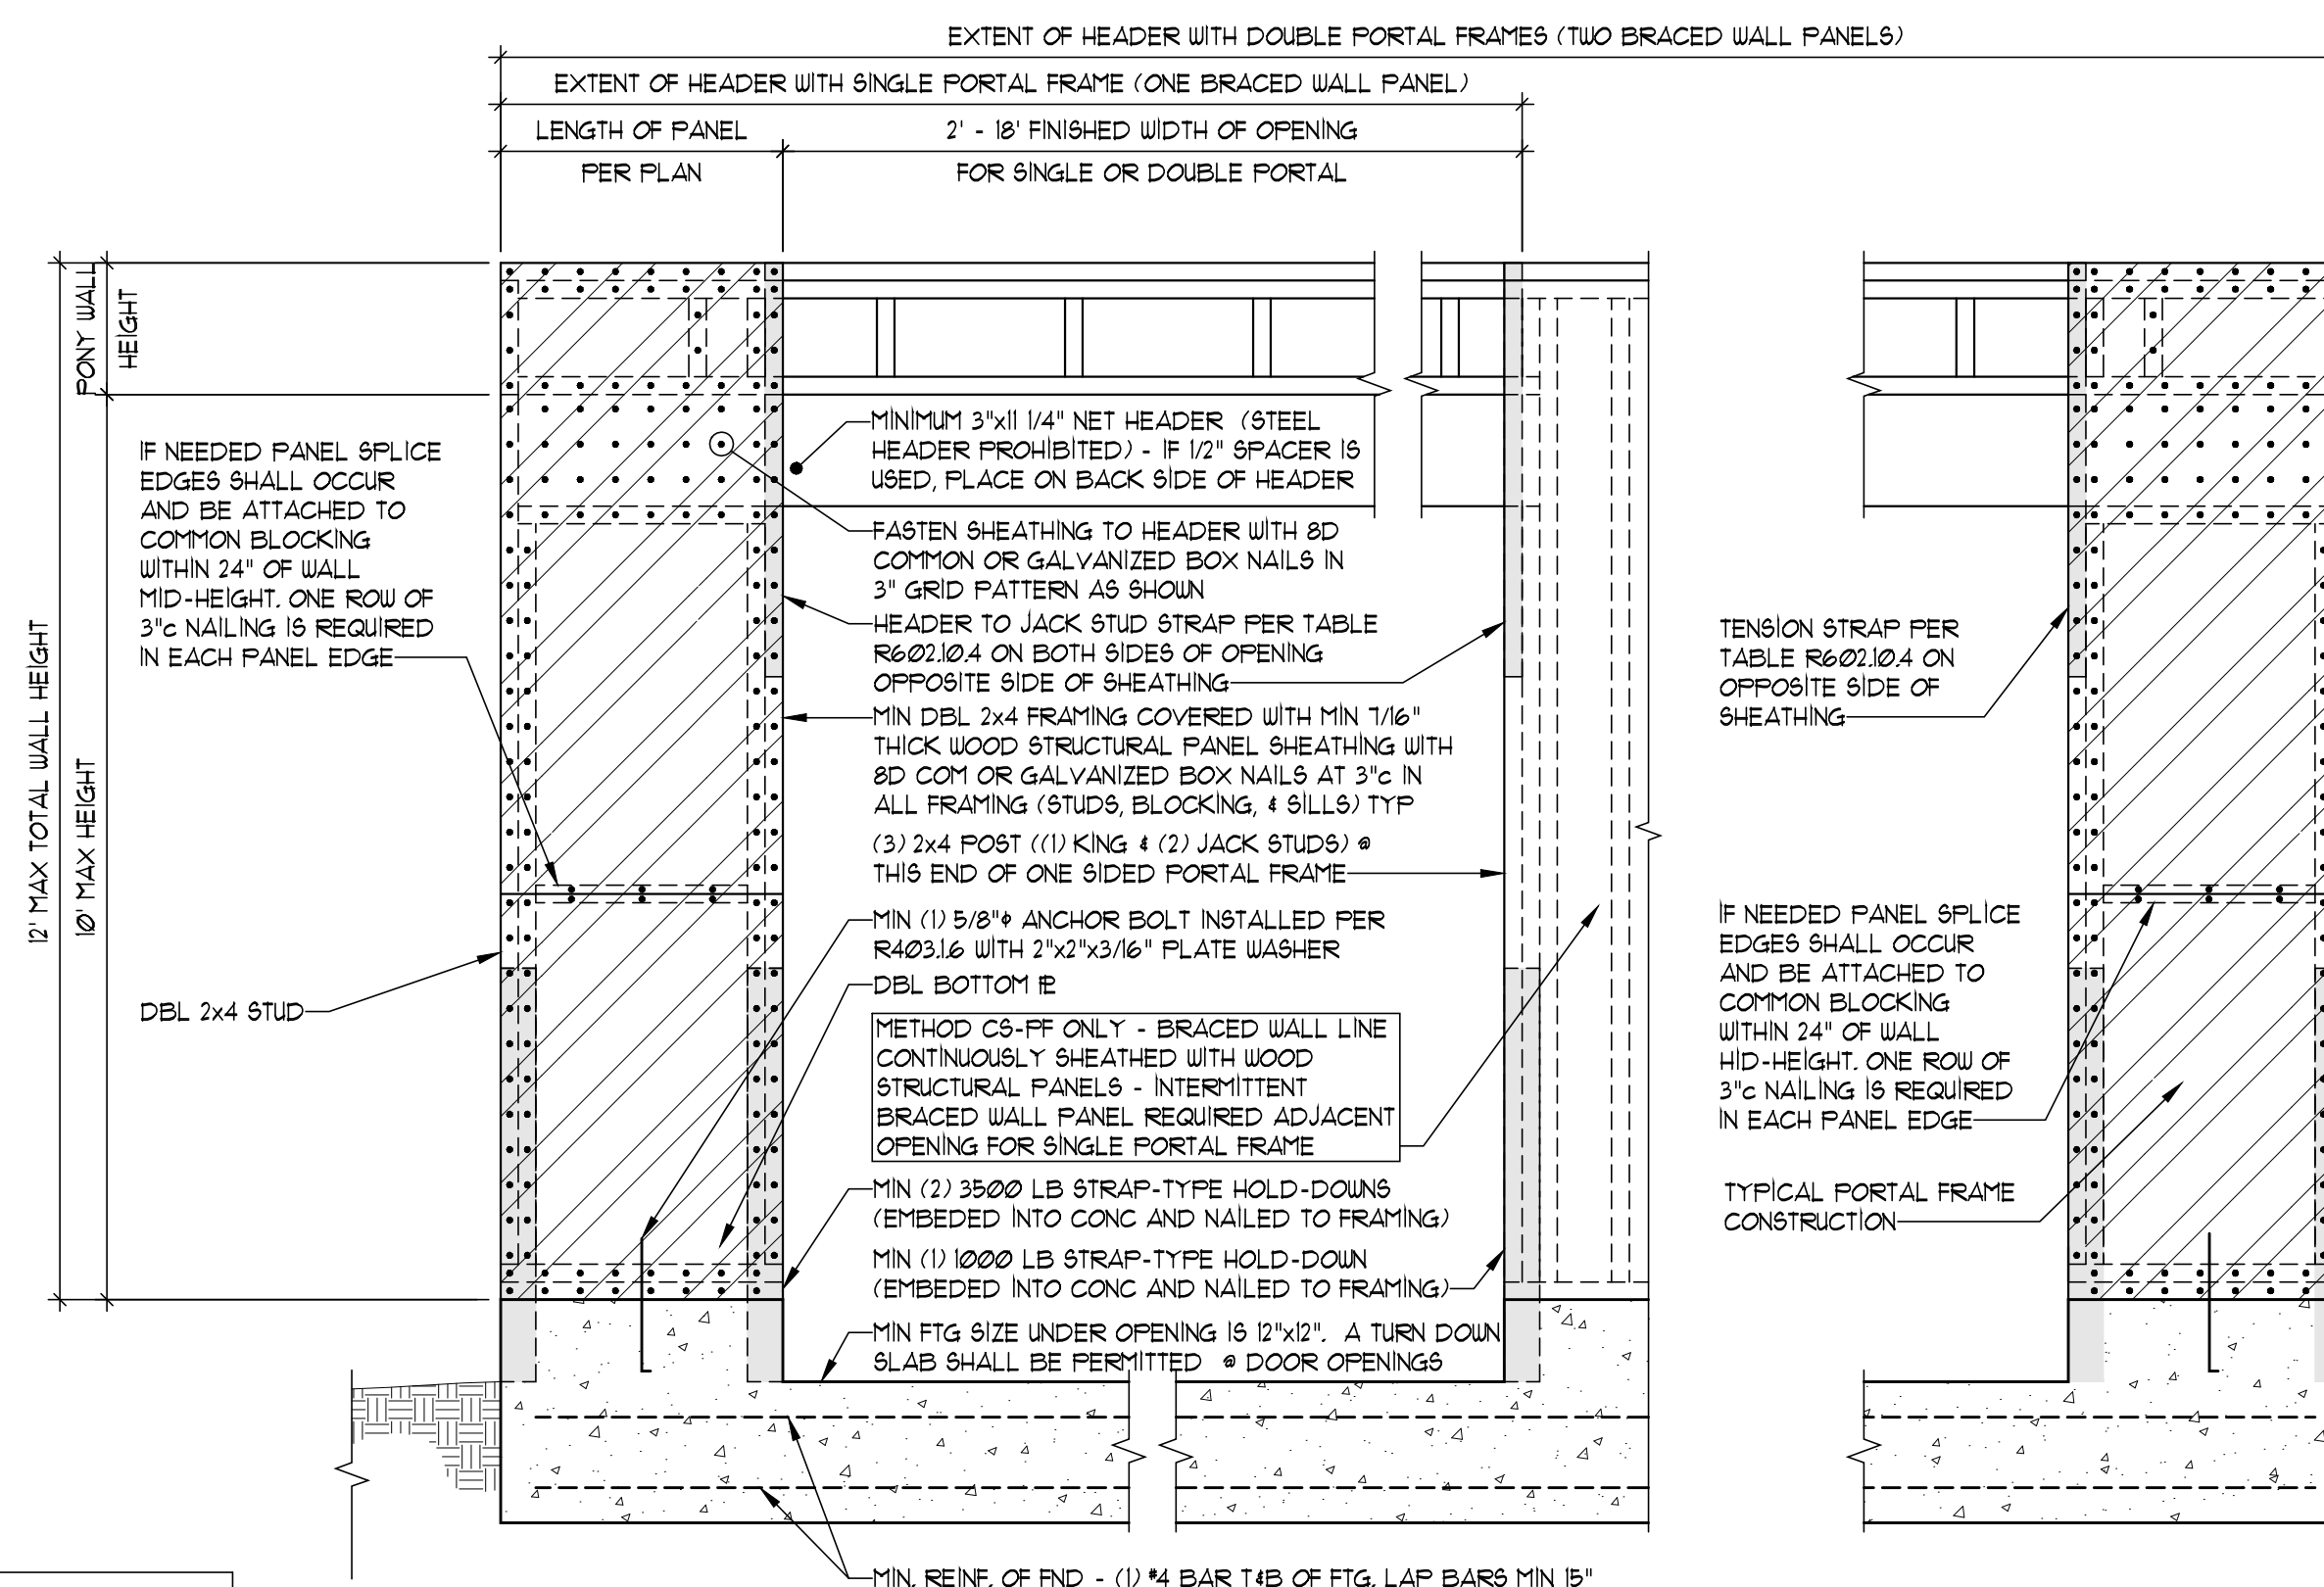


BRACED WALL METHOD "PFH" (also HEADER ATTACHMENT FOR CS-PF)
SCALE: 3/4"=1'-0"

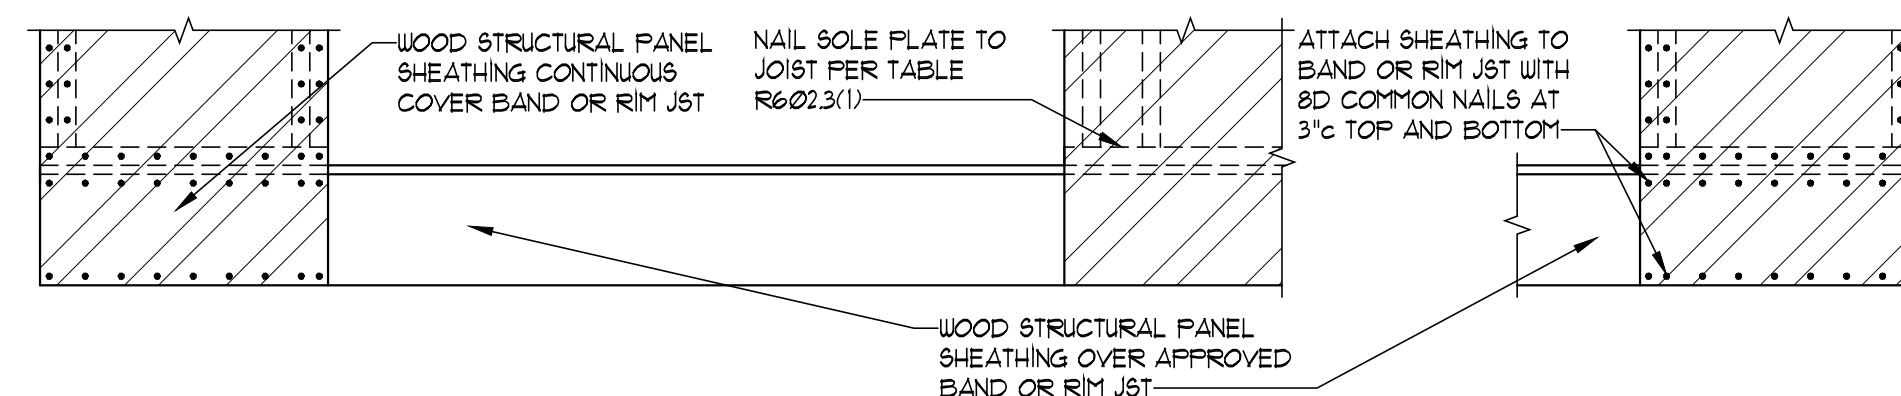

BRACED WALL METHOD "CS-PF" (ATTACHMENT TO WOOD FLOOR)
(REFER TO BRACED WALL METHOD "PFH" FOR HEADER ATTACH)
SCALE: 3/4"=1'-0"

SECTION

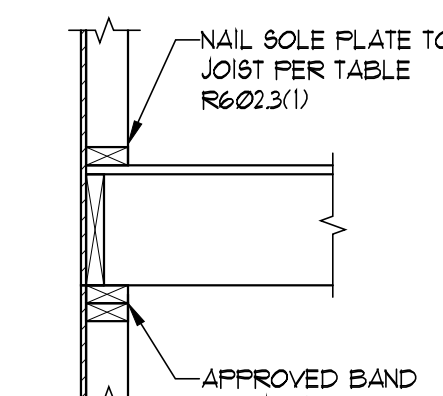

SECTION