SHOP DRAWINGS/SUBMITTAL REVIEW

SUBMITTAL WAS REVIEWED FOR DESIGN CONFORMITY AND GENERAL CONFORMANCE TO CONTRACT DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSIBLE FOR CONFIRMING AND CORRELATING DIMENSIONS AT JOBSITE FOR TOLERANCE, CLEARANCE, QUANTITIES, FABRICATION, COORDINATION OF HIS OR HER WORK WITH OTHER TRADES, AND FULL COMPLIANCE WITH CONTRACT DOCUMENTS.

STATUS:

APPROVED


02/23/2022

REVIEWED BY:

BH


ENGINEER, EVERSTEAD

RELEASE FOR CONSTRUCTION AS NOTED ON PLANS REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI 03/15/2022 10:57:31

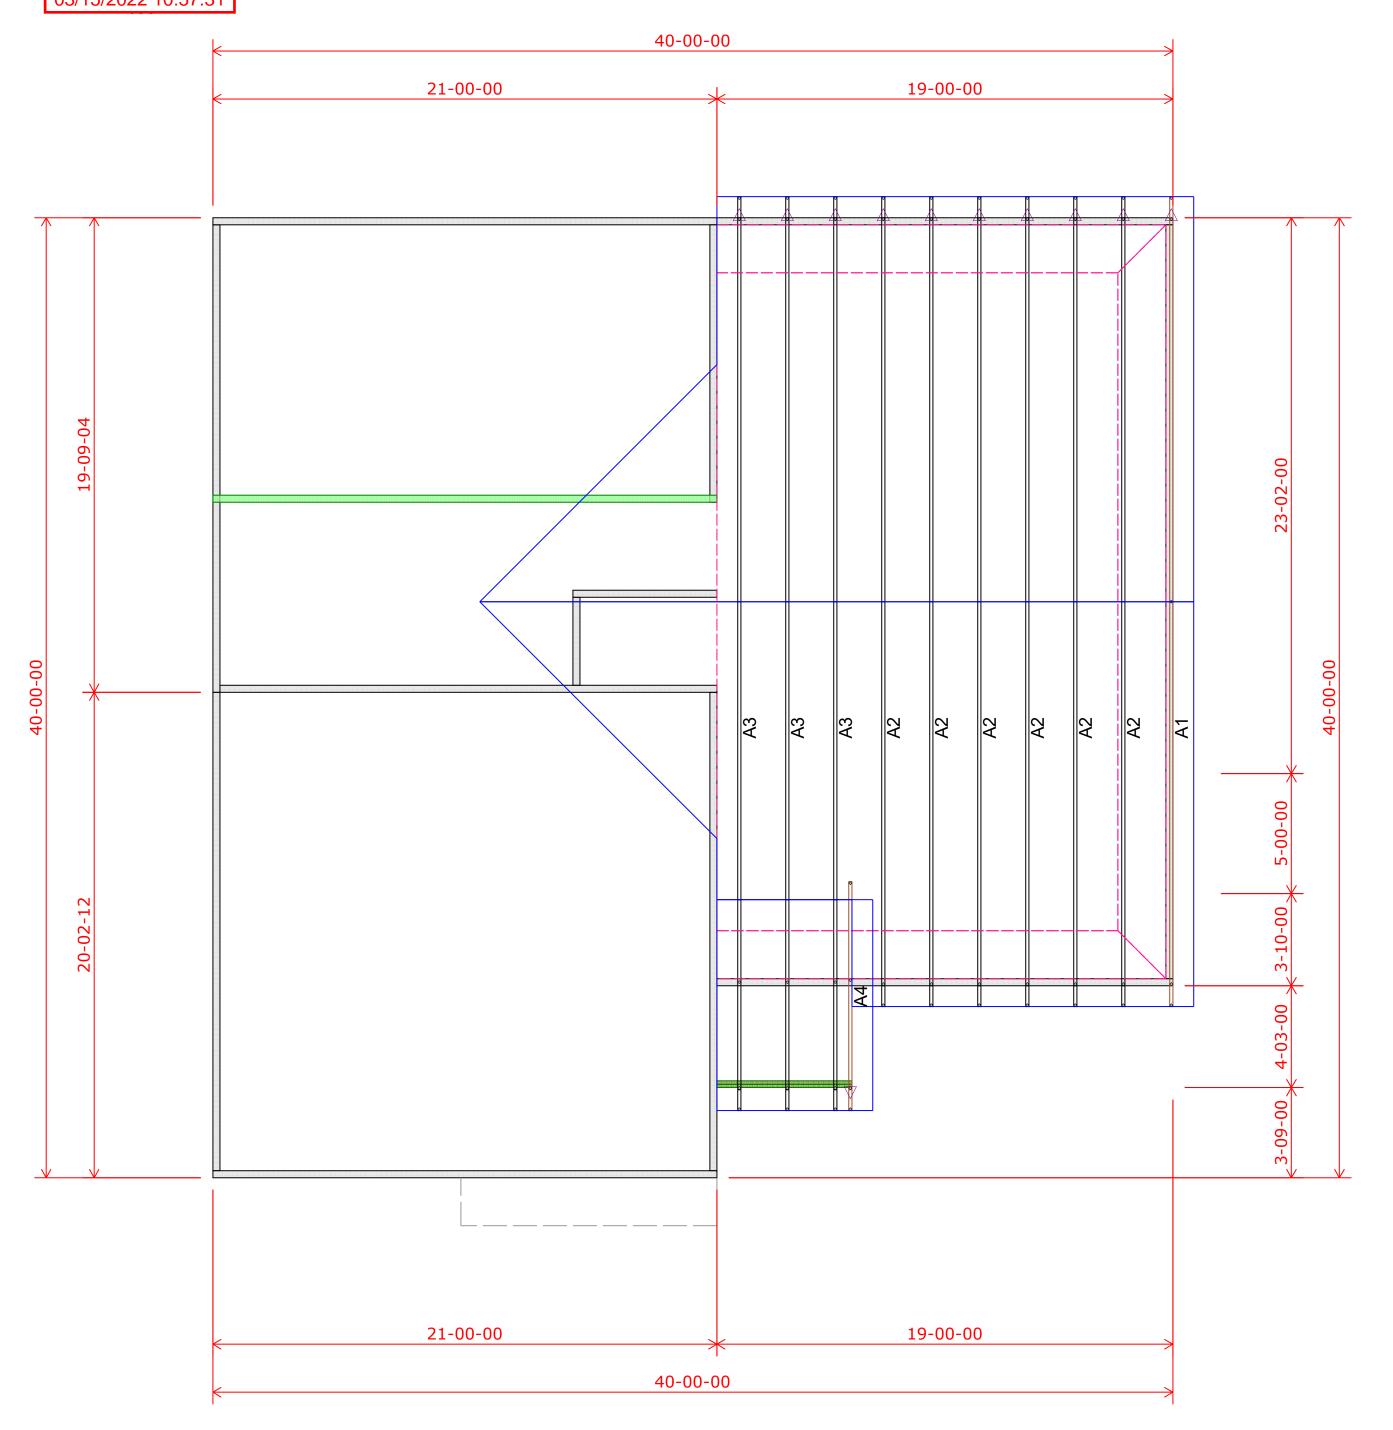

1st Floor	Truss	Layout
Scale:	1/4" = 1	1'

	HANGER SCHEDULE	Quantity						
	LUS24	0						
	LUS26	0						
	HUS26	4				MO		
_	HHUS26-2	0	Clover & Hive Lot 144 Cobey Creek			-		
_	HGUS26-2	0						
	HGUS28-3	0	ve	ey (bin	٠,	SIS	35
	LTHJA26	0	H	Cob	SE Corbin	nmi	asbe	200
	TJC37	0	r &	4	SE	Sun	ξ H	Job # B220035
	TJC57	0	Clover & Hive	ot 1.	3533	Lee's Summit	Chuck Haspels	# q
	HTS20	0		Ľ	35	Ľ	ט	Jo
of the	iangle denotes the the Truss as it appeared Draw ovided.	ears on	Customer	Job Name	Job Site Address	City, State	Designer	2/17/2022



Unless otherwise specified by Engineer Of Record, Wheeler Lumber, LLC recommends an uplift connection at each bearing point per the following:

of Uplift Connector 0 - 495: (1) H2.5A 495 - 990: (2) H2.5A 990 - 1245: (1) HTS20

Installation per Simpson Strong-Tie guidelines.

For Reactions greater than 1245#, refer to EOR.

HIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

eeler Lumber 9 Old Hwy 50 Waverly, KS 66871 Whe 1959 NE V

EVERSTEAD SHOP DRAWINGS/SUBMITTAL REVIEW

SUBMITTAL WAS REVIEWED FOR DESIGN CONFORMITY AND GENERAL CONFORMANCE TO CONTRACT DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSIBLE FOR CONFIRMING AND CORRELATING DIMENSIONS AT JOBSITE FOR TOLERANCE, CLEARANCE, QUANTITIES, FABRICATION, COORDINATION OF HIS OR HER WORK WITH OTHER TRADES, AND FULL COMPLIANCE WITH CONTRACT DOCUMENTS.

STATUS:

APPROVED


02/23/2022

REVIEWED BY:


BH

ENGINEER, EVERSTEAD

RELEASE FOR CONSTRUCTION AS NOTED ON PLANS REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI 03/15/2022 10:57:33

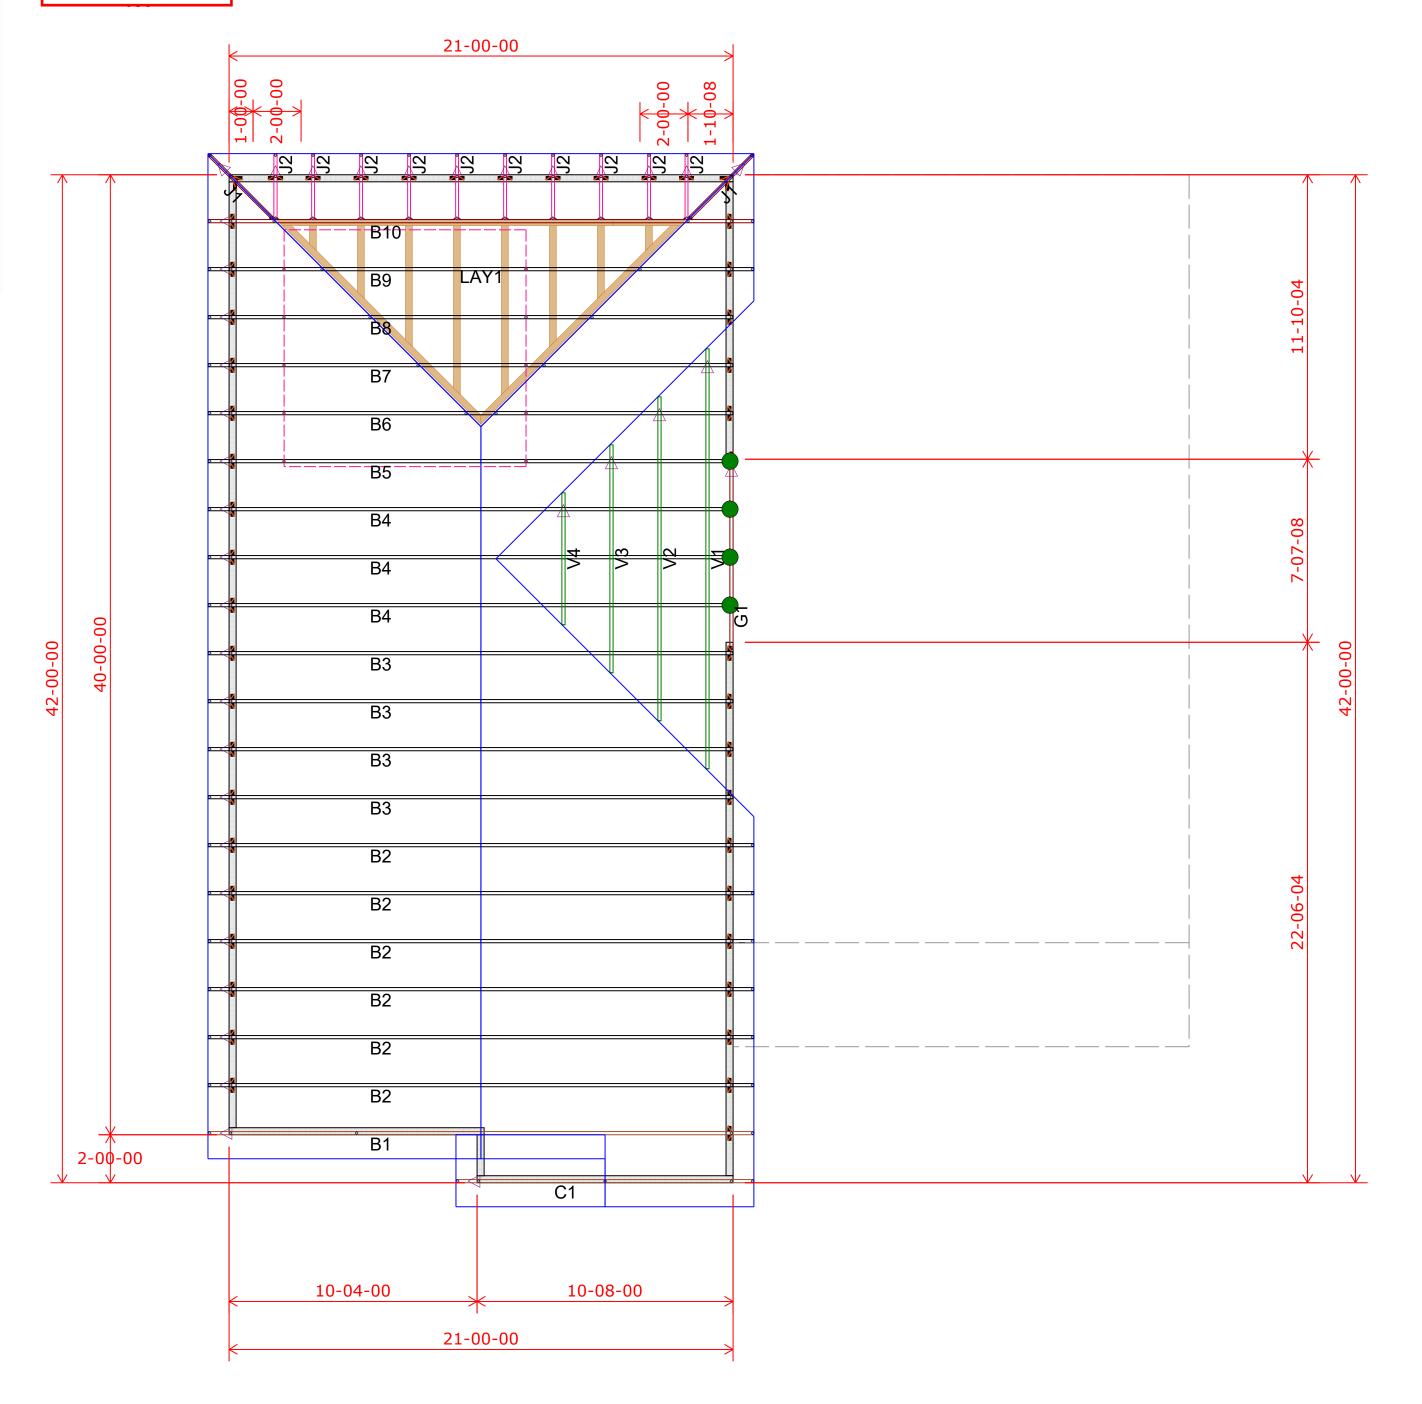

	HANGER SCHEDULE	Quantity	Clover & Hive			МО		
	LUS24	0						
	LUS26	0						
	HUS26	4						
A	HHUS26-2	0		 \X	3533 SE Corbin Dr			
^	HGUS26-2	0		ree		Summit	Chuck Haspels	Job # B220035
	HGUS28-3	0		Lot 144 Cobey Creek				
	LTHJA26	0		_ob.				
	TJC37	0		44				
	TJC57	0		ot 1,		[ree's	nucl	
	HTS20	0		L		Ľ	\\ \operatorname{1}{\op	
of the	iangle denotes the the Truss as it appeared Draw ovided.	pears on	Customer	Job Name	Job Site Address	City, State	Designer	2/17/2022



Unless otherwise specified by Engineer Of Record, Wheeler Lumber, LLC recommends an uplift connection at each bearing point per the following:

of Uplift Connector 0 - 495: (1) H2.5A 495 - 990: (2) H2.5A 990 - 1245: (1) HTS20

Installation per Simpson Strong-Tie guidelines.

For Reactions greater than 1245#, refer to EOR.

HIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

eeler Lumber 9 Old Hwy 50 Waverly, KS 66871 Whe(1959 NE V

2nd Floor Truss Layout Scale: 1/4" = 1'