

GENERAL NOTES & DESIGN CRITERIA

This plan was designed and drafted to meet average conditions and codes in the State of Missouri at the time it was designed. This plan was also designed for seismic zone B. Consult your local building official to determine the suitability of these plans for your specific site and application. This plan can be adapted to your local building codes and requirements, but also, it is the responsibility of the purchaser and/or builder of this plan to see that the structure is built in strict compliance with all governing municipal codes (city, county, state and federal). The purchaser and/or builder of this plan releases the designer from any claims or lawsuits that may arise during the construction of this structure or anytime thereafter.

DESIGN LOADS:

- Floor: 40 psf. live Roof: 20 psf. live Ceiling: 10 psf. live
- 10 psf. dead 10 psf. dead 5 psf. dead
- Soil bearing Capacity - 2000 PSF
- Live loads, dead loads, wind loads, snow loads, lateral loads, seismic zoning and any specialty loading conditions will need to be confirmed before construction and adjustments to plans made accordingly. See your local building officials for verification of your specific load data, zoning restrictions and site conditions.

CONCRETE AND FOUNDATIONS:

- All foundation walls and slabs on grade shall be 3000 PSI (28-day compressive strength concrete), unless noted otherwise.
- All interior slabs on grade shall bear on 4" compacted granular fill with 6 mil. polyethylene vapor barrier underneath.
- Provide proper expansion and control joints as per local requirements.
- Foundation walls are not to be backfilled until properly braced.
- Verify depth of frost footings with your local codes.
- Provide termite protection as required by HUD minimum property standards.

STEEL:

- All structural steel for beams and plates shall comply with ASTM specification A-36.
- All structural steel for steel columns shall comply with ASTM specification A-53 Grade B or A-501.
- All reinforcing steel for concrete shall comply with ASTM specification A-615 Grade 40.
- Provide steel shimms in all beam pockets.

FRAMING MEMBERS:

- Unless noted otherwise, all framing lumber shall have the following characteristics:
Fb = 1,000 psi Fv = 75 psi E = 1,400,000 psi
- Contractor to confirm the size, spacing and stress characteristics of all framing and structural members to meet your local code requirements.
- Hole sizes and locations in GluLam or Laminated Veneered Lumber members are to be confirmed by a professional engineer.
- Any structural or framing members not indicated on the plan are to be sized by contractor.
- Double floor joists under all partition walls, unless noted otherwise.
- All subflooring is assumed to be 3/4" thick - Glued & Nailed
- All exterior walls are dimensioned to outside of 1/2" rigid insulation.
- All exterior walls are 4" (3 1/2" stud plus 1/2" rigid insulation). All interior walls are 3 1/2" unless otherwise shown.
- Calculated dimensions take precedence over scaled dimensions.
- All Main level walls are 9'-1 1/8" high unless otherwise noted or implied.
- All angled walls on floor plans are at 45 degree angle, unless otherwise noted.

ALL CONSTRUCTION WILL MEET THE REQUIREMENTS OF THE 2018 IRC AND 2017 NEC

WALK THROUGH DOOR @ GARAGE TO HOUSE WILL HAVE SELF CLOSING HARDWARE

ALL EGRESS WINDOW WELLS WILL HAVE DRAINS TO DRAIN TILE SYSTEM

FRAMING MEMBERS (continued):

- Any wall 12'-0" high or higher shall be 2x6 and balloon framed.
- Unless noted otherwise, above all openings that are:
 - Non-load bearing and less than or equal to 6 ft.use 4x6.
 - Non-load bearing and more than 6 ft.use (2) 2x12 w/1/2" Plywood between.
- All trusses to be engineered by truss manufacturer according to the loading indicated on this plan.
- All exterior corners shall be braced in each direction with let-in diagonal bracing or plywood.
- Place (1) row of 1" x 3" cross-bridging on all spans over 8'-0" and (2) rows of 1" x 3" cross-bridging on all spans over 16'-0".
- Collar ties are to be spaced 4'-0" o.c.
- All purlins and kickers are to be 2x6's, unless noted otherwise.
- Any hip or valley rafters over a 28'-0" span are to be Laminated Veneer Lumber (L.V.L.).

MISC. NOTES:

- Prefabricated fireplaces and flues are to be U.L. approved and installed as per manufacturer's specifications.
- All materials, supplies and equipment to be installed as per manufacturer's specifications and as per local codes and requirements.
- Note: Provide proper insulation for all plumbing.
- 1/2" water-resistant drywall around showers, tubs and whirlpools.
- 1/2" drywall on interior walls and ceilings.
- 5/8" type "X" fire code drywall on garage walls and ceilings.
- Windows are called out by glass size only.
- Windows, if not noted, are assumed to be casements.
- Header heights are labeled to bottom of arched transoms
- Confirm window openings for your local egress requirements and minimum light and ventilation requirements.
- Headroom at stairs shall have a minimum clearance of 6'-8" high.
- Provide proper handrails at stairs as per local code.
- The mechanical and electrical layouts are suggested only. Consult your mechanical and electrical contractors for exact specifications, locations and sizes.
- Jog flue to rear of ridge as necessary.
- Note: Provide proper wiring for all electrical appliances, mechanical equipment and whirlpools as per manufacturer's specifications.
- All air conditioner locations may vary depending on restrictive covenants and codes.
- Typical overhang sizes unless noted otherwise on drawing are as follows:

On pitches of 4/12 - 5/12 - 6/12 = 24" overhang
7/12 = 20" overhang
8/12 = 16" overhang
9/12 = 16" overhang
10/12 - 11/12 - 12/12 = 12" overhang



- Note: Adjust overhangs to provide clearance for windows to open. Adjust overhangs to maintain a consistent level when the plans call for (2) different pitches at a hip.
- Minor alterations to this plan can be made by builder. Please contact our drafting department for information and price quotes if major changes are required.
- Plan Pros, Inc. determines finished square footage by measuring to the outside of all walls. We include: interior fireplaces and every location in which the floor joists project from the foundation. We do not include: window boxes where the floor joists do not project from the foundation; 2-story entries; exterior fireplaces; garage; decks; patios; porches; unfinished storage areas; basements or any other unfinished areas.

ABBREVIATIONS


A/C	Air Conditioner	DISH	Dishwasher	INSUL	Insulation	PROJ	Projection	TRAP	Trap
ADJ	Adjustable	DN	Down	INT	Interior	RAD	Radius	U.L.	Underlayment
AWN	Awning	DRY	Dryer	JST	Joist	RAFTS	Rafters	UNEX	Unexcavated
BLDG	Building	EA	Each	LVL	Laminated Veneer Lumber	REFRIG	Refrigerator	WASH	Washer
BSMT	Basement	ENT	Entertainment	LN	Linen	RM	Room	WD	Wood
BTM	Bottom	EXP	Exposure	MAX	Maximum	SEC	Second	WH	Water Heater
BTW	Between	EXT	Exterior	MBR	Master Bedroom	SHWR	Shower	W.W.M.	Welded Wire Mesh
CANT	Cantilever	FIN	Finished	MICRO	Microwave	S.L	Side Lobe		
C.J.	Ceiling Joist	F.J.	Floor Joist	MIN	Minimum	SPP	Sump Pump Pit	@	At
CLG	Ceiling	FLOR	Fluorescent	MISC	Miscellaneous	STA	Stationary	2W	Two Wide
CMU	Concrete Masonry Unit	FTG	Footing	O.C.	On Center	STD	Standard	3W	Three Wide
C.O.	Cased Opening	GALV	Galvanized	O.H.D.	Overhead Door	STL	Steel	4W	Four Wide
C.ONC	Concrete	GARB	Garbage Disposal	OPNG	Opening	STRUC	Structural	W	With
DBL	Double	G & N	Glued & Nailed	PC	Pull Chord	T.C	Tongue & Groove		Diameter
DH	Double Hung	G.L	GluLam Header	PICT	Picture	TRANS	Transom		
		HDR	Header	POLY	Polyethylene				

ARTIST CONCEPTION ONLY


ARTWORK NOT TO SCALE

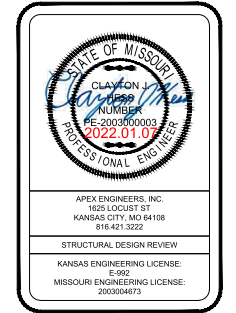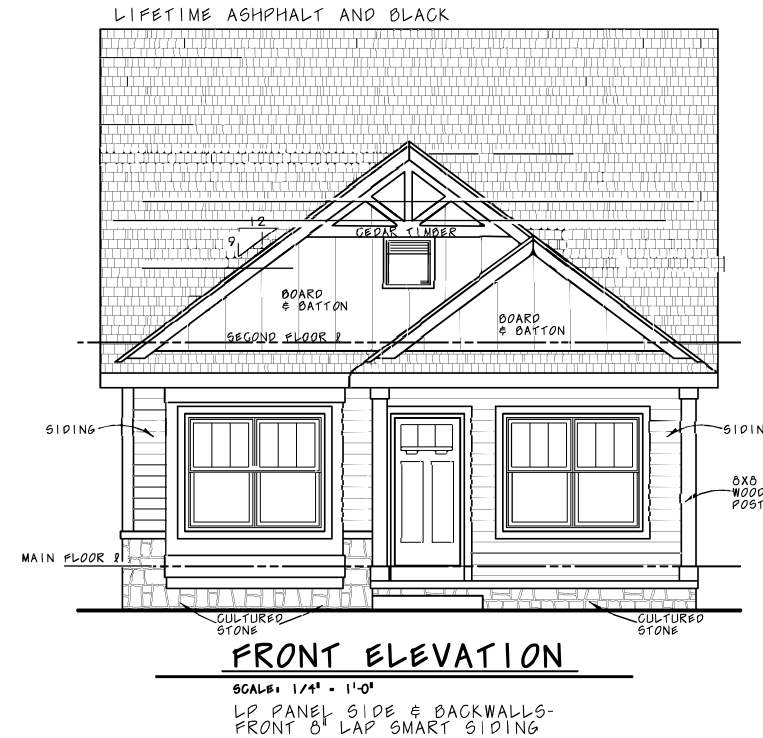

SYMBOLS

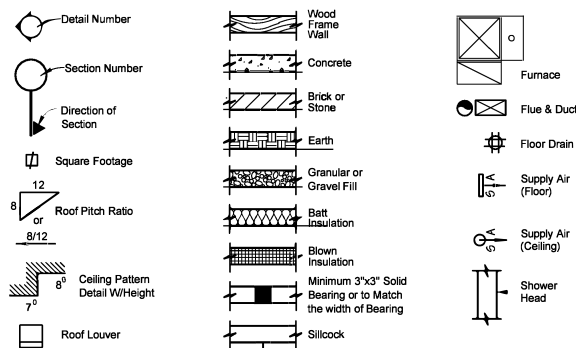

ELECTRICAL LEGEND

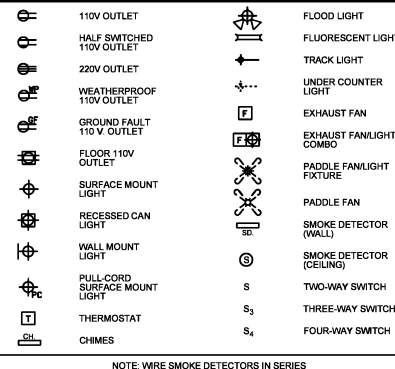

The purchaser of these plans is given a limited license to reproduce these plans for construction purposes only and further distribution is prohibited. Because site conditions may vary, the designer cannot warrant the suitability of these plans for use on your specific site. Construction from these plans should not be undertaken without the assistance of a construction professional.

Carl Cuzzo Designs
7504 S 95th Street
La Vista, NE 68128
402-210-4369
planpro1@cox.net

© 2017

508 NW Main St
Lee's Summit

Omaha, Nebraska
1-402-210-4369

Sideloar garage
1626 Plan
Revised: 6-3-21

Plan No.

Sheet No.

RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
Development Services
LEE'S SUMMIT, MISSOURI

The purchaser of these plans is given a limited license to reproduce these plans for construction purposes only and further distribution is strictly prohibited. Because site conditions may vary, the designer cannot warrant the suitability of these plans for use on your specific site. Construction from these plans should not be undertaken without the assistance of a construction professional.

Carl Cuzzo Designs
7504 S 95th Street
La Vista, NE 68128
402-210-4369
planpro1@cox.net

© 2017

508 NW Main St
Lee's Summit


Omaha, Nebraska
1-402-210-4369

Sideload garage
1626 Plan
Revised: 6-3-21


Plan No.

Sheet No.

2

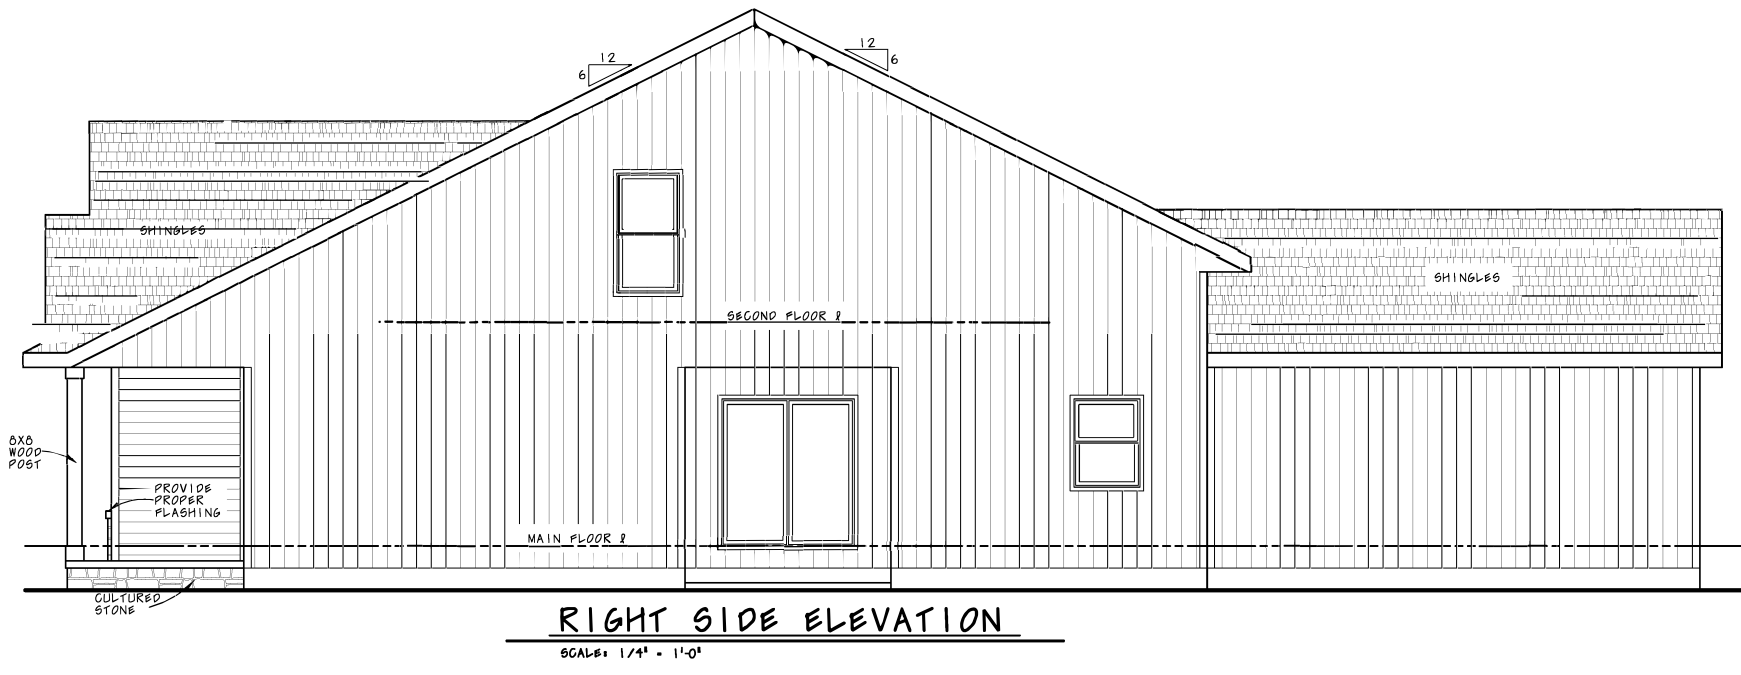


RIGHT SIDE ELEVATION
SCALE: 1/4" = 1'-0"

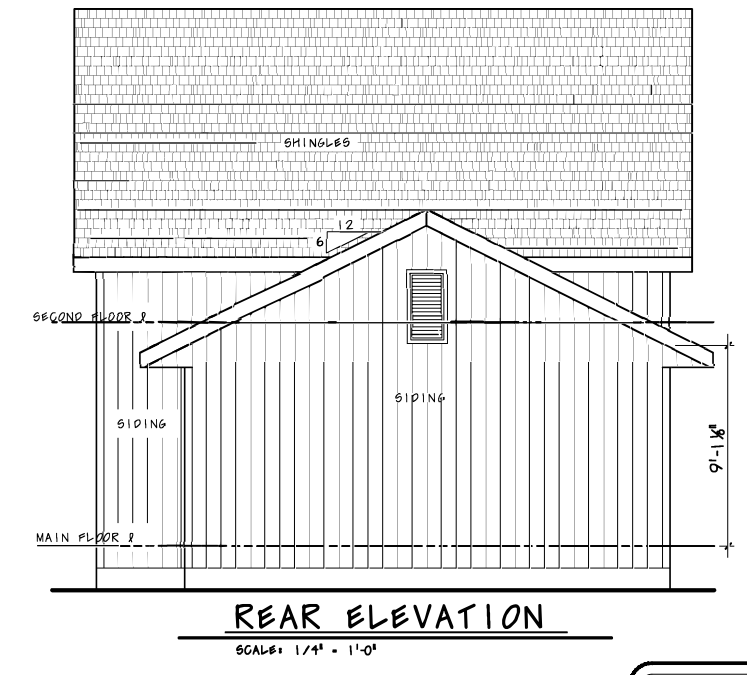


REAR ELEVATION
SCALE: 1/4" = 1'-0"



1/3/2022 - UPDATED PLANS PER TRUSS LAYOUT

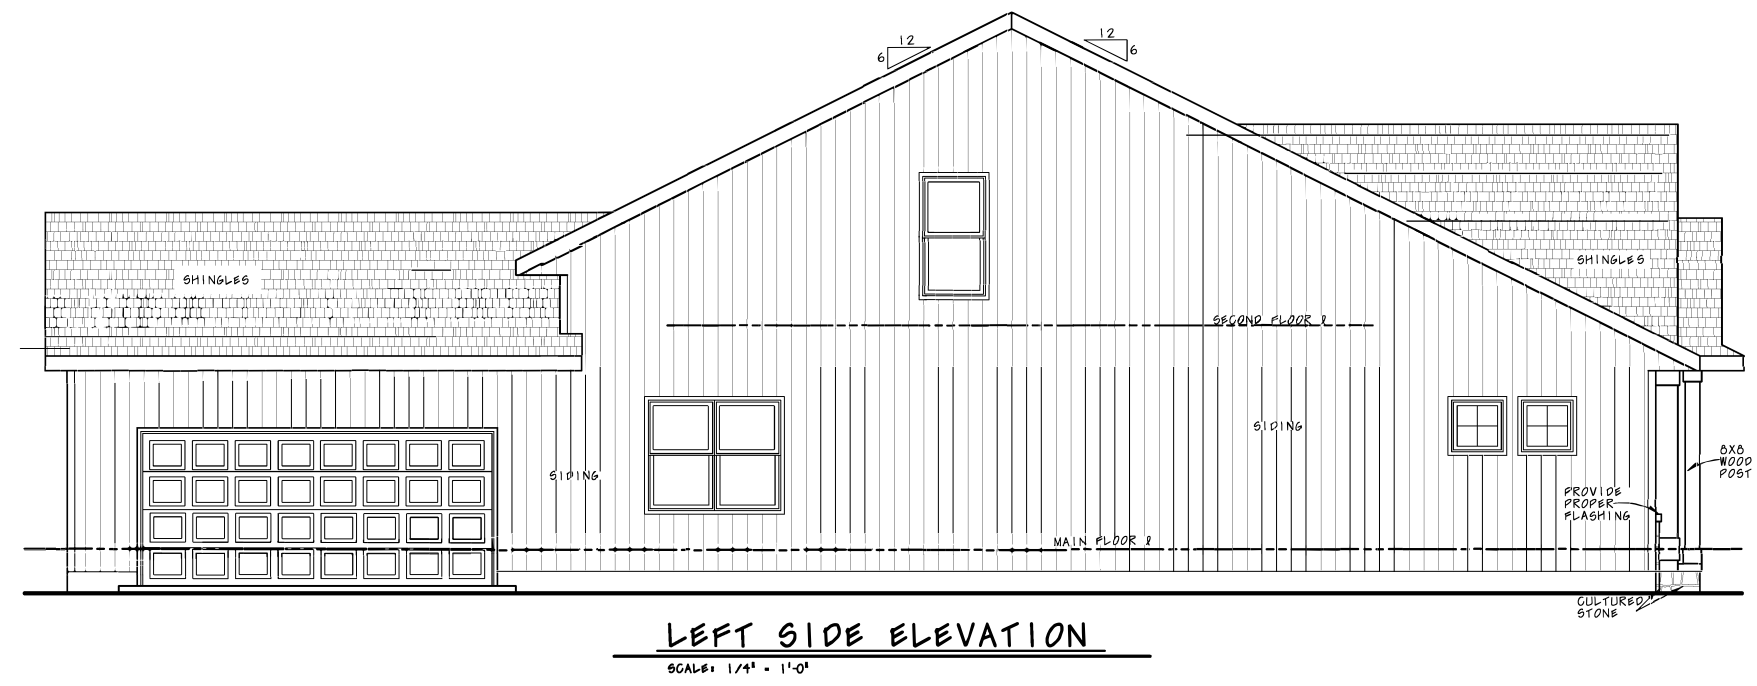

LEFT SIDE ELEVATION
SCALE: 1/4" = 1'-0"

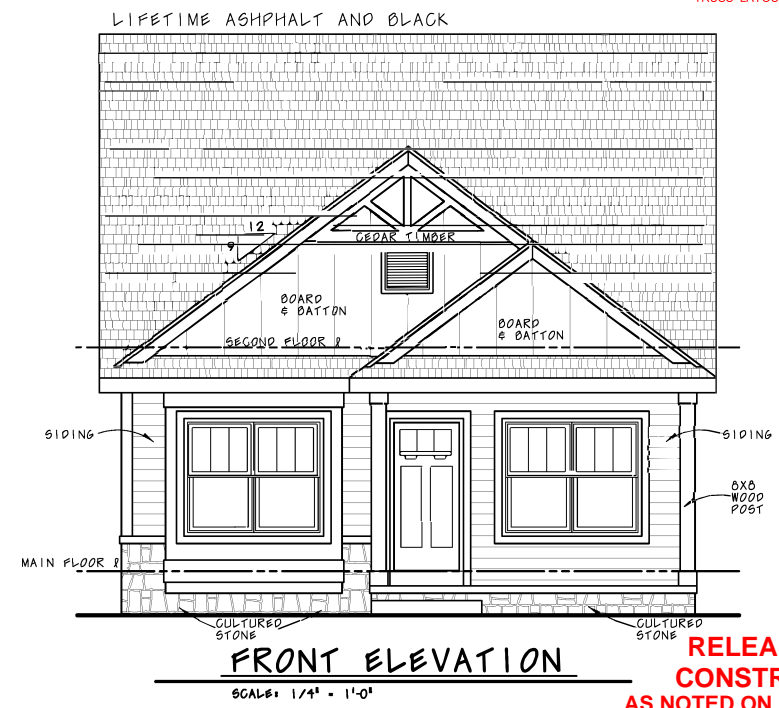

FRONT ELEVATION
SCALE: 1/4" = 1'-0"

LP PANEL SIDE & BACKWALLS-
FRONT & LAP SMART SIDING

RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
Development Services
LEE'S SUMMIT, MISSOURI

EXPANSIVE SOILS DISCLAIMER:

THESE PLANS HAVE BEEN PREPARED BASED ON A PRESUMPTIVE ALLOWABLE BEARING CAPACITY AS ALLOWED BY IRC CODE AND THE LOCAL ENFORCING JURISDICTION.

APEX ENGINEERS, INC. (APEX) RECOMMENDS THAT ALL FOOTING EXCAVATIONS BE EVALUATED BY A LICENSED GEOTECHNICAL ENGINEER PRIOR TO THE PLACEMENT OF ANY FOUNDATION ELEMENTS. GEOTECHNICAL INVESTIGATION AND/OR TESTING IS NOT A SERVICE PROVIDED OR OFFERED BY APEX.

APEX HAS NOT BEEN RETAINED TO DETERMINE THE EXPANSIVE SOIL CHARACTERISTICS OF THE SUBGRADE SOIL AND THEREFORE CANNOT BE HELD RESPONSIBLE FOR THE VOLUMETRIC CHANGES OF THE SOIL (INCLUDING BELOW THE BASEMENT SLAB). BY USE OF THESE PLANS WITHOUT AN ACCOMPANYING GEOTECHNICAL ENGINEERING REPORT, APEX SHALL NOT BE HELD LIABLE FOR ANY FUTURE MOVEMENT AND/OR DIFFERENTIAL MOVEMENT OF THE PROPOSED STRUCTURE AND THE POSSIBLE DAMAGE THAT MAY BE CAUSED AS A RESULT OF SUCH MOVEMENT. DAMAGE FROM EXPANSIVE SOILS AND/OR SETTLEMENT CAN RESULT IN AMONGST OTHER THINGS, THE FOLLOWING: BASEMENT SLAB HEAVE, SHEETROCK CRACKS, WINDOWS AND DOOR BECOMING OUT OF PLUMB AND STICKING AND/OR NOT OPENING, DAMAGE TO TILE, MOULDING, AND OTHER COSMETIC FINISHES.

COLUMN MARK	PAD SIZE	REINFORCEMENT	COLUMN SIZE	COLUMN TYPE
A	30" x 30" x 12"	(4) #4 BAR E.W.	3" NOMINAL	SCHEDULE 40 STEEL PIPE (F _y = 46 ksi MIN.)
B	36" x 36" x 12"	(4) #4 BAR E.W.	3" NOMINAL	
C	42" x 42" x 12"	(5) #4 BAR E.W.	3" NOMINAL	
D	48" x 48" x 12"	(6) #4 BAR E.W.	3" NOMINAL	
E	54" x 54" x 16"	(8) #4 BAR E.W.	3 1/2" NOMINAL (4" OD)	
F	60" x 60" x 16"	(10) #4 BAR E.W.	3 1/2" NOMINAL (4" OD)	

- COLUMN & PAD SIZES SHOWN ARE FOR MAXIMUM COLUMN HEIGHT OF 10'-0", REQUIRES SEPARATE ENGR'D DESIGN IF GREATER THAN 10'-0" TALL.
- COLUMN & PIER PAD SIZES SHOWN ARE BASED ON AN ASSUMED MINIMUM ALLOWABLE SOIL BEARING CAPACITY OF 2,000psf.

MARK	COLUMN SIZE	PIER DIA.
A	6x6	12"
B	6x6	16"
C	6x6	18"
D	6x6	24"
E	6x6	28"

- ALL PIERS TO BEAR ON ORIGINAL UNDISTURBED SOIL OF 2,000psf BEARING CAPACITY OR FILL COMPACTED AND TESTED TO CONFORM TO THE RECOMMENDATIONS OF A GEOTECHNICAL ENGINEER.
- PIERS SHALL EXTEND BELOW THE FROST LINE: MIN. DEPTH OF 36" BELOW GRADE.
- POST SHALL BE TREATED OR CEDAR WITH SIMPSON ABU66 POST BASE

DETAIL REFERENCES

- 1 S2.0 TYPICAL FOUNDATION WALL DETAIL
- 2 S2.0 TYPICAL "UNRESTRAINED" FOUNDATION WALL DETAIL
- 3 S2.0 TYPICAL DEAD MAN DETAIL
- 4 S2.0 FOUNDATION WALL JUMP DETAIL
- 5 S2.0 COLUMN PAD DETAIL
- 1 S2.1 TYPICAL STRUCTURAL GARAGE SLAB PLAN
- 2 S2.1 STRUCTURAL GARAGE SLAB PIER PAD DETAIL
- 3 S2.1 STRUCTURAL GARAGE SLAB / WALL SECTION
- 6 S2.1 TYPICAL OVERDIG DETAIL AT BASEMENT SLAB
- 1 S4.0 ALTERNATE BRACED WALL PANEL DETAIL
- 1 S4.0 APA NARROW WALL BRACING METHOD WITHOUT HOLD-DOWNS ALT.
- X COLUMN AND PIER PAD SCHEDULE (SHEET S2.0)

STRUCTURAL NOTES:

- ALL UNMARKED HEADERS MIN (2)#2-2x10
- ALL HEADERS AND BEAMS MIN #2 GRADE DFIL (OR EQ.)
- BEARING WALL

ROOF FRAMING NOTES

ROOF DESIGNED FOR LIGHT ROOF COVERING
30psf TOTAL LOAD (10psf DL, 20psf LL (SL))

ROOF SYSTEM IS DESIGNED TO MEET REQUIREMENTS OF IRC 802

*RAFTERS (HEM-FIR, DOUG-FIR, OR EQUAL):
SEE SPAN CHARTS BELOW

CODE MINIMUM

RAFTERS	SPACING	MAX HORIZONTAL CLEARSPAN
#2-2x6	AT 24" OC	11'-7"
#2-2x6	AT 16" OC	14'-2"
#2-2x8	AT 24" OC	14'-8"
#2-2x8	AT 16" OC	17'-11"
#2-2x10	AT 24" OC	17'-10"
#2-2x10	AT 16" OC	21'-11"

NOTE: CODE MINIMUM ALLOWS FOR A RAFTER DEFLECTION OF L/180 TOTAL LOAD

HIGHER PERFORMANCE

RAFTERS	SPACING	MAX HORIZONTAL CLEARSPAN
#2-2x6	AT 24" OC	8'-6"
#2-2x6	AT 16" OC	9'-9"
#2-2x8	AT 24" OC	11'-3"
#2-2x8	AT 16" OC	12'-9"
#2-2x10	AT 24" OC	14'-3"
#2-2x10	AT 16" OC	18'-3"

APEX ENGINEERS, INC. RECOMMENDED DEFLECTION = L/360 LIVE LOAD, L/240 TOTAL LOAD

*RIDGE BOARDS ARE (UNLESS OTHERWISE NOTED)

#2-2x10 UP TO 9:12 PITCH

#2-2x12 OVER 9:12 PITCH

*ALL HIPS AND VALLEYS ARE (UNLESS OTHERWISE NOTED)

#2-2x10 UP TO 9:12 PITCH

#2-2x12 OVER 9:12 PITCH

*PURLINS ARE 2x6 MIN

- PURLIN STRUTS ARE AT 4'-0" OC

- PURLIN STRUTS SHALL BE INSTALLED AT NOT LESS THAN A 45 DEGREE ANGLE WITH THE HORIZONTAL

- ALL PURLIN STRUTS SHALL HAVE A MAX UNBRACED LENGTH OF 8'-0"

- PURLIN STRUTS SHALL BE CONSTRUCTED IN A "T" CONFIGURATION AND PER THE FOLLOWING CHART:

PURLIN STRUT	MAX PURLIN STRUT LENGTH
(2)2x4	8'-0"
(1)2x4 AND (1)2x6	12'-0"
(1)2x6 AND (1)2x8	20'-0"
(2)2x6 AND (1)2x8	30'-0"
CONSULT ARCH ENGR	>30'-0"

*EACH END OF STRUT SHALL BE FASTENED WITH MIN (3)#d OR (2)16d NAILS

*RIDGE BRACERS ARE SAME AS PURLIN BRACES-SPACING, SIZE, CONFIGURATION, AND INSTALLATION (SEE PURLIN BRACE NOTES ABOVE)

*HIP AND VALLEY BRACES ARE THE SAME AS PURLINS SIZE, CONFIGURATION, AND INSTALLATION (SEE PURLIN BRACE NOTES ABOVE)

= ROOF BRACE/STRUT (PER CHART)

- SLASH IS TOP END OF BRACE

○ CIRCLE IS BOTTOM END OF BRACE

= PURLIN STRUTS AT 48" OC (PER CHART) U.N.O.

- SLASH IS TOP END OF BRACE

- ARROW IS BEARING LOCATION

--- DENOTES BEARING WALL

- - - - - DENOTES PURLIN

===== DENOTES BEARING STRUCTURE


- THIS IS AN ENGINEERED ROOF STRUCTURE DESIGNED FOR COMPLIANCE WITH IRC 802.3, BUILD AS SHOWN WITH NO DEVIATIONS.
- ALL HIPS ARE DESIGNED TO BE CONTROLLED BY BENDING.
- SHEAR AT BEARING WITH MIN 5 1/2" DEPTH DOES NOT CONTROL DESIGN. FOR VALLEYS REF 4/S3.2

TRUSS ROOF NOTES: (BY OTHERS)


- DESIGNED FOR LIGHT ROOF COVERING
TOP CHORD:
LIVE LOAD/SNOW LOAD (PSF): 20
DEAD LOAD (PSF): 10
BOTTOM CHORD:
DEAD LOAD(PSF): 10
 - ALL EXTERIOR HEADERS SHALL BE MIN. (2) #2-2x10 UNLESS OTHERWISE NOTED.
 - CONSULT ENGINEER IF TRUSSES BEAR ON INTERIOR WALLS SHOWN AS NON-LOAD BEARING ON APPROVED PRINTS.
 - MIN. (4) 2x4 BELOW EACH BEARING POINT OF EACH GIRDER TRUSS, UNLESS OTHERWISE NOTED.
 - PROVIDE 2x SOLID BLOCKING SUPPORT BELOW ALL POINT LOADS CONTINUOUS TO BEARING STRUCTURE AND/OR FOUNDATION BELOW.
 - ROOF IS ENGINEERED TO COMPLY WITH IRC 802.
 - AT EACH TRUSS BEARING POINT USE UPLIFT CONNECTORS PER TABLE BELOW UNLESS NOTED OTHERWISE, INSTALL PER MANUFACTURER'S SPECIFICATIONS.
LBS OF UPLIFT CONNECTOR
000-495 (1) H2.5A
495-990 (2) H2.5A
990-1245 (1) HTS20
- ← = ASSUMED ROOF TRUSS FRAMING DIRECTION
"G.T." = ASSUMED GIRDER TRUSS LOCATION
--- = ASSUMED INTERIOR LOAD BEARING WALLS.

STRUCTURAL NOTES:

- ALL UNMARKED HEADERS MIN (2)#2-2x10
- ALL HEADERS AND BEAMS MIN #2 GRADE DFIL (OR EQ.)
- = BEARING WALL

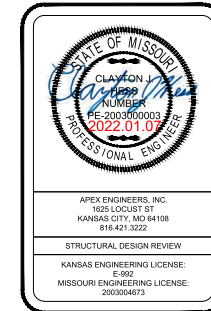

1/13/2022 - UPDATED PLANS PER TRUSS LAYOUT

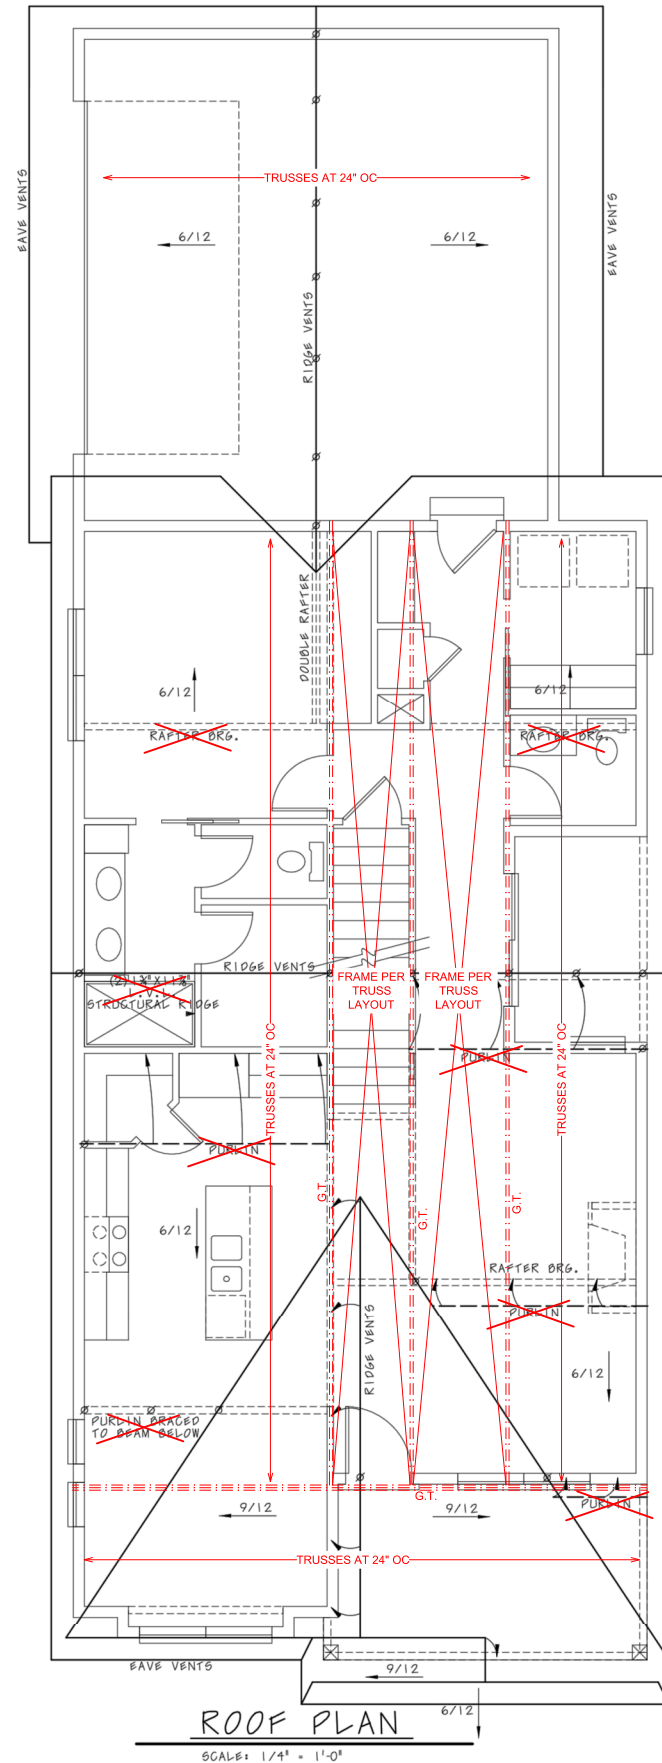

ROOF PLAN
SCALE: 1/4" = 1'-0"

The purchaser of these plans is given a limited license to reproduce these plans for construction purposes only and further distribution is strictly prohibited. Because site conditions may vary, the designer cannot warrant the suitability of these plans for use on your specific site. Construction from these plans should not be undertaken without the assistance of a construction professional.

Carl Cuzzo Designs
7504 S 96th Street
La Vista, NE 68128
402-270-4369
planpro1@cox.net

© 2017

508 NW Main St
Lee's Summit

Omaha, Nebraska
1-402-210-4369


Sidload garage
1626 Plan
Revised: 6-3-21

Plan No.

Sheet No.

RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
Development Services
LEE'S SUMMIT, MISSOURI

3

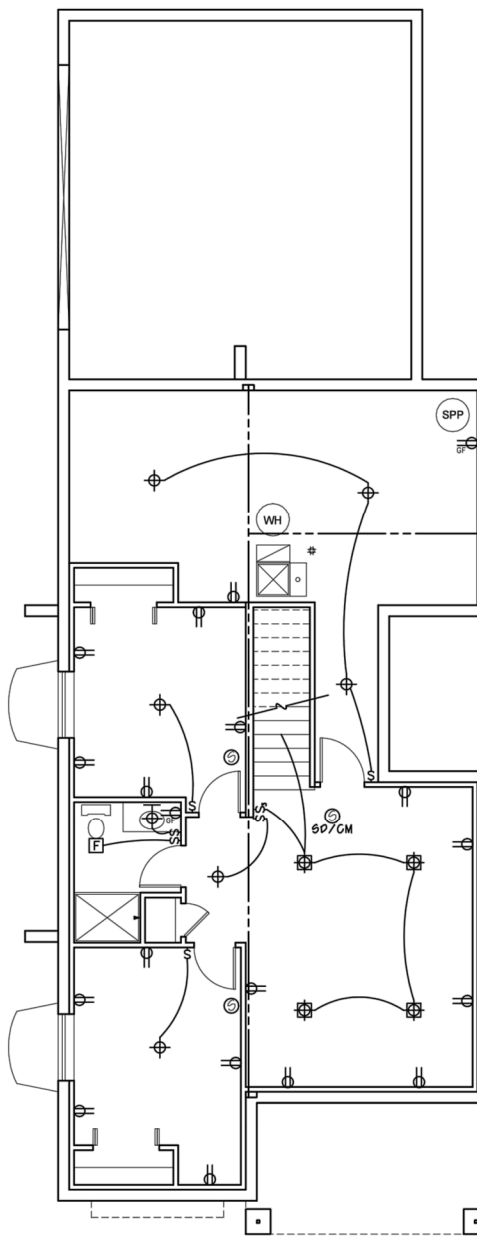


FOUNDATION ELECTRICAL

SCALE: 3/16" = 1'-0"



1/3/2022 - UPDATED PLANS PER TRUSS LAYOUT

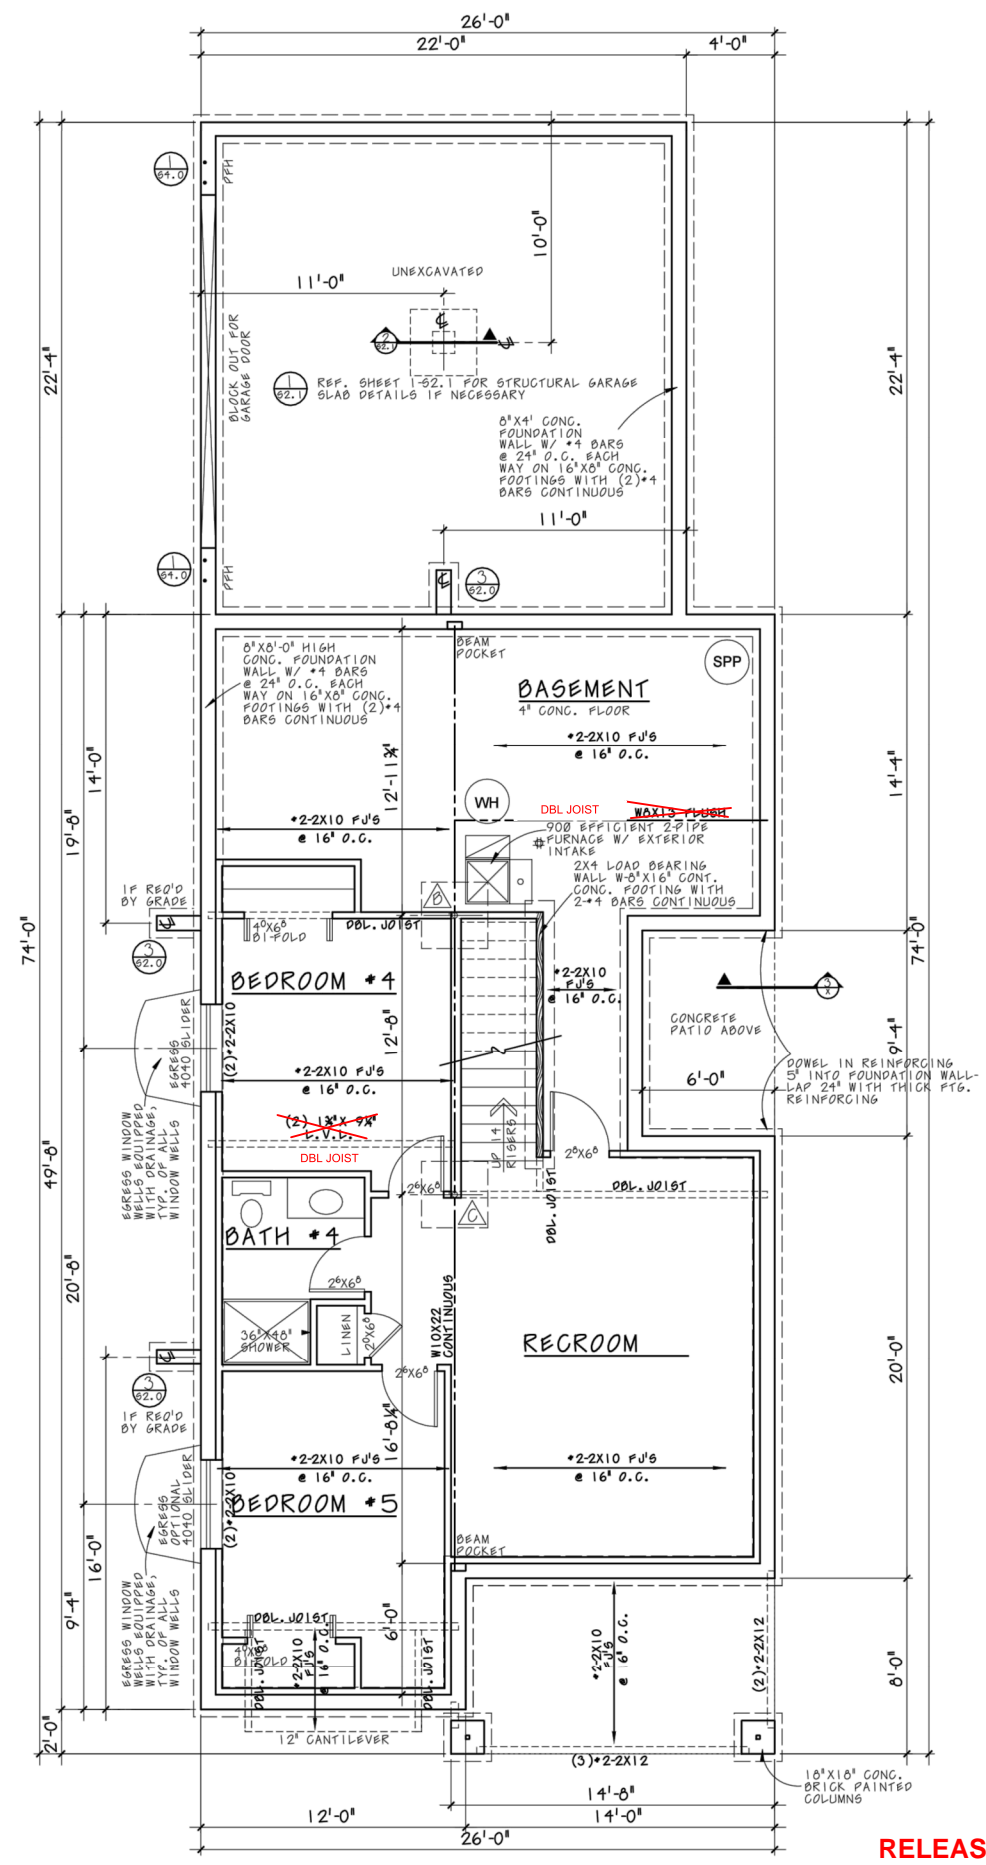

FOUNDATION PLAN

SCALE: 1/4" = 1'-0" OPT. 656 FINISHED 50 FT 343 UNFINISHED 50 FT

RELEASE FOR CONSTRUCTION AS NOTED ON PLANS REVIEW Development Services LEE'S SUMMIT, MISSOURI

The purchaser of these plans is given a limited license to reproduce these plans for construction purposes only and further distribution is strictly prohibited. Because site conditions may vary, the designer cannot warrant the reliability of these plans for use on your specific site. Construction from these plans should not be undertaken without the assistance of a construction professional.

Carl Cuzzo Designs
7504 S 96th Street
La Vista, NE 68128
402-210-4369
planpro1@cox.net

© 2017


Omaha, Nebraska
1-402-210-4369

Sideload garage
1626 Plan
Revised: 6-3-21

Plan No.

Sheet No.

4

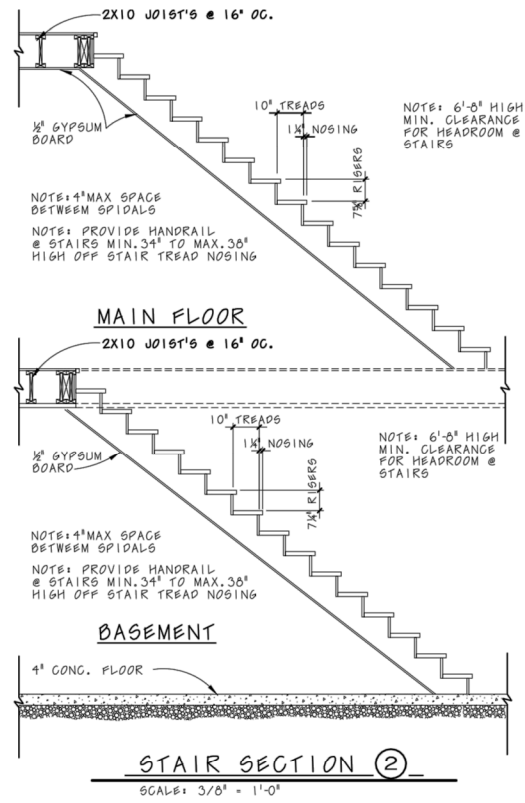

BRACED WALL METHODOLOGY

XXXX EXTERIOR BRACED WALLS:
 WSP METHOD: WOOD STRUCTURAL PANEL SHEATHING WITH A THICKNESS NOT LESS THAN 3/8\"/>

//// INTERIOR BRACED WALLS (REF 2/S4.0):
 GB METHOD: 1/2\"/>




LIB METHOD: 1x4 WOOD FASTENED WITH (3) 8d COMMON NAILS OR SIMPSON / USP 16 GA. TYPE WB (OR EQUAL) STL. X-BRACE(S) AT 45° TO 60° ANGLES, MAXIMUM 16\"/>

STRUCTURAL NOTES:


ALL UNMARKED HEADERS MIN (2) #2-2x10

ALL HEADERS AND BEAMS MIN #2 GRADE DF/L (OR EQ.)

BEARING WALL

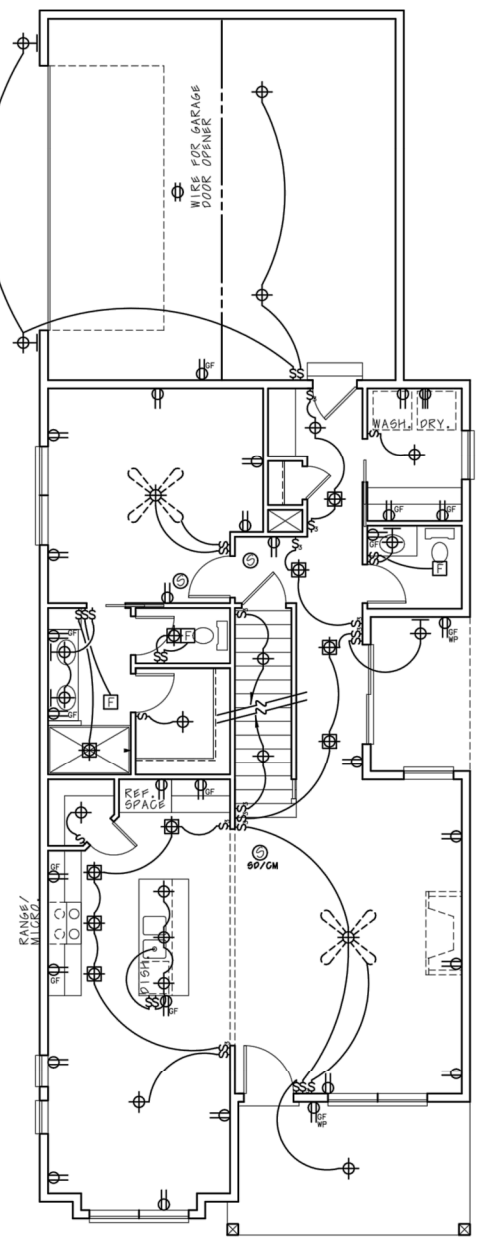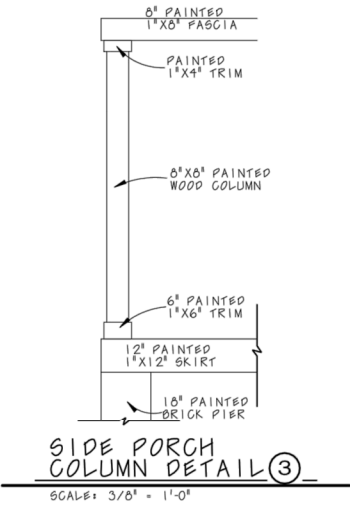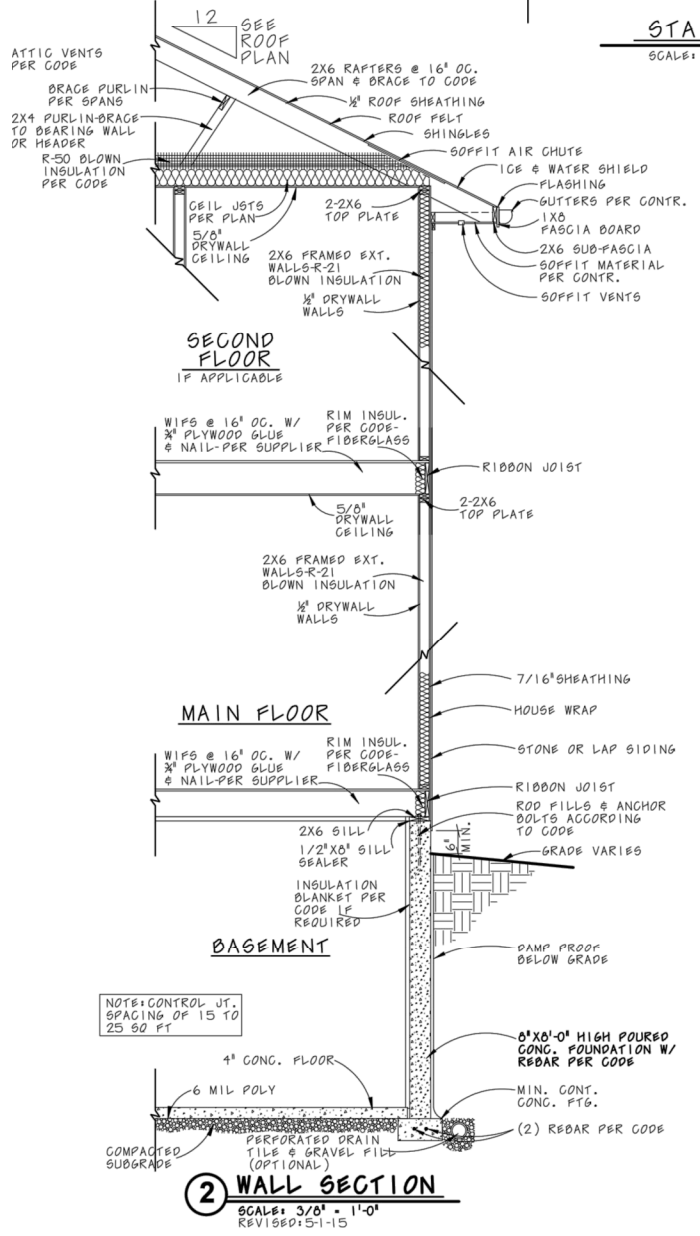

MAIN LEVEL ELECTRICAL
 SCALE: 3/16\"/>

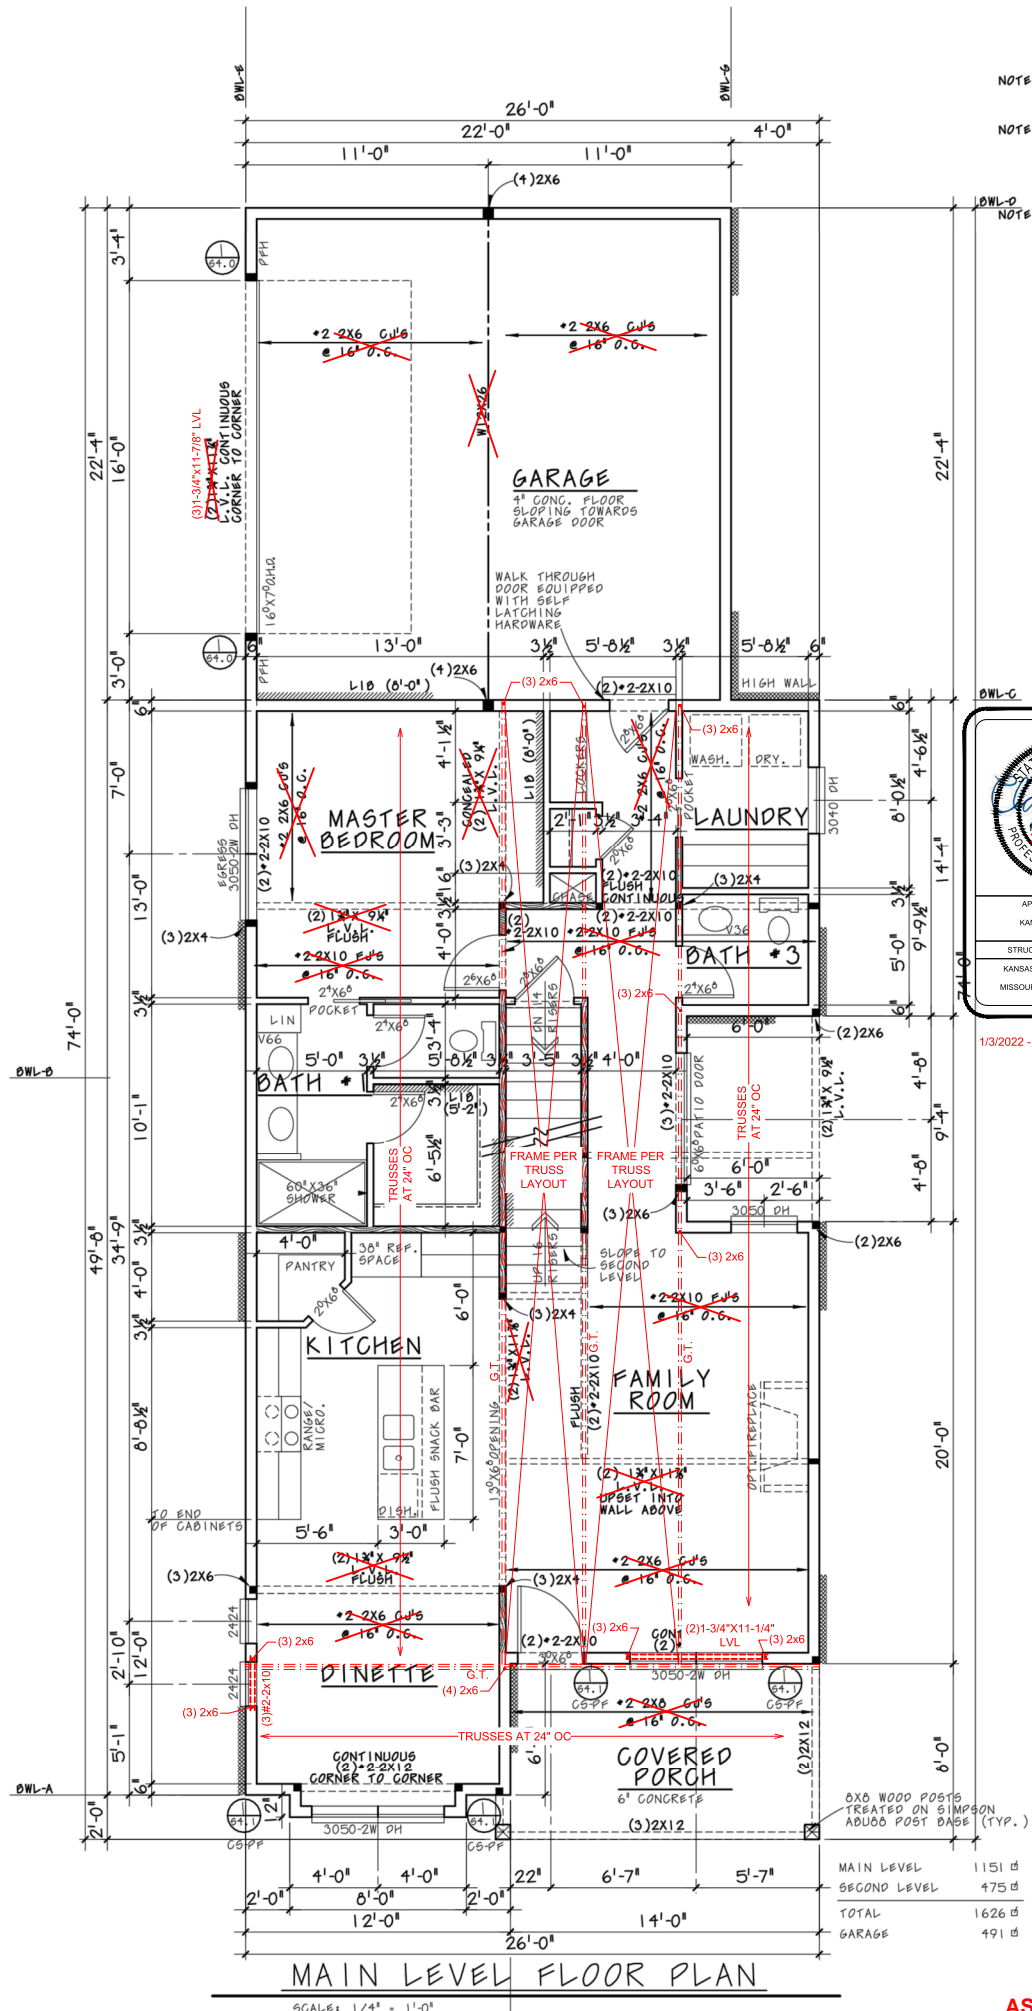


MAIN LEVEL FLOOR PLAN
 SCALE: 1/4\"/>

NOTE: ALL MAIN FLOOR WALLS ARE 9'-1/2\"/>

NOTE: ALL EXTERIOR WALLS ARE 6\"/>

NOTE: ALL INTERIOR WALLS ARE 3\"/>

NOTE: ALL ANGLED WALLS ARE @ 45°

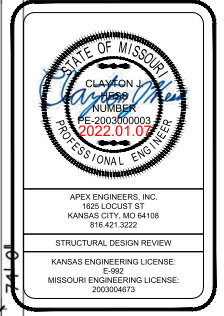

1/3/2022 - UPDATED PLANS PER TRUSS LAYOUT

MAIN LEVEL	1151 sq
SECOND LEVEL	175 sq
TOTAL	1626 sq
GARAGE	491 sq

The purchaser of these plans is given a limited license to reproduce these plans for construction purposes only and further distribution is strictly prohibited. Because site conditions may vary, the designer cannot warrant the reliability of these plans for use on your specific site. Construction from these plans should not be undertaken without the assistance of a construction professional.

Carl Cuzzo Designs
 7504 S 96th Street
 La Vista, NE 68128
 402-210-4369
 planpro1@cox.net

© 2017

508 NW Main St
 Lee's Summit


Omaha, Nebraska
 1-402-210-4369

Sidload garage
1626 Plan
 Revised: 6-3-21

Plan No.
 Sheet No.

RELEASE FOR CONSTRUCTION
 AS NOTED ON PLANS REVIEW
 Development Services
 LEE'S SUMMIT, MISSOURI

5

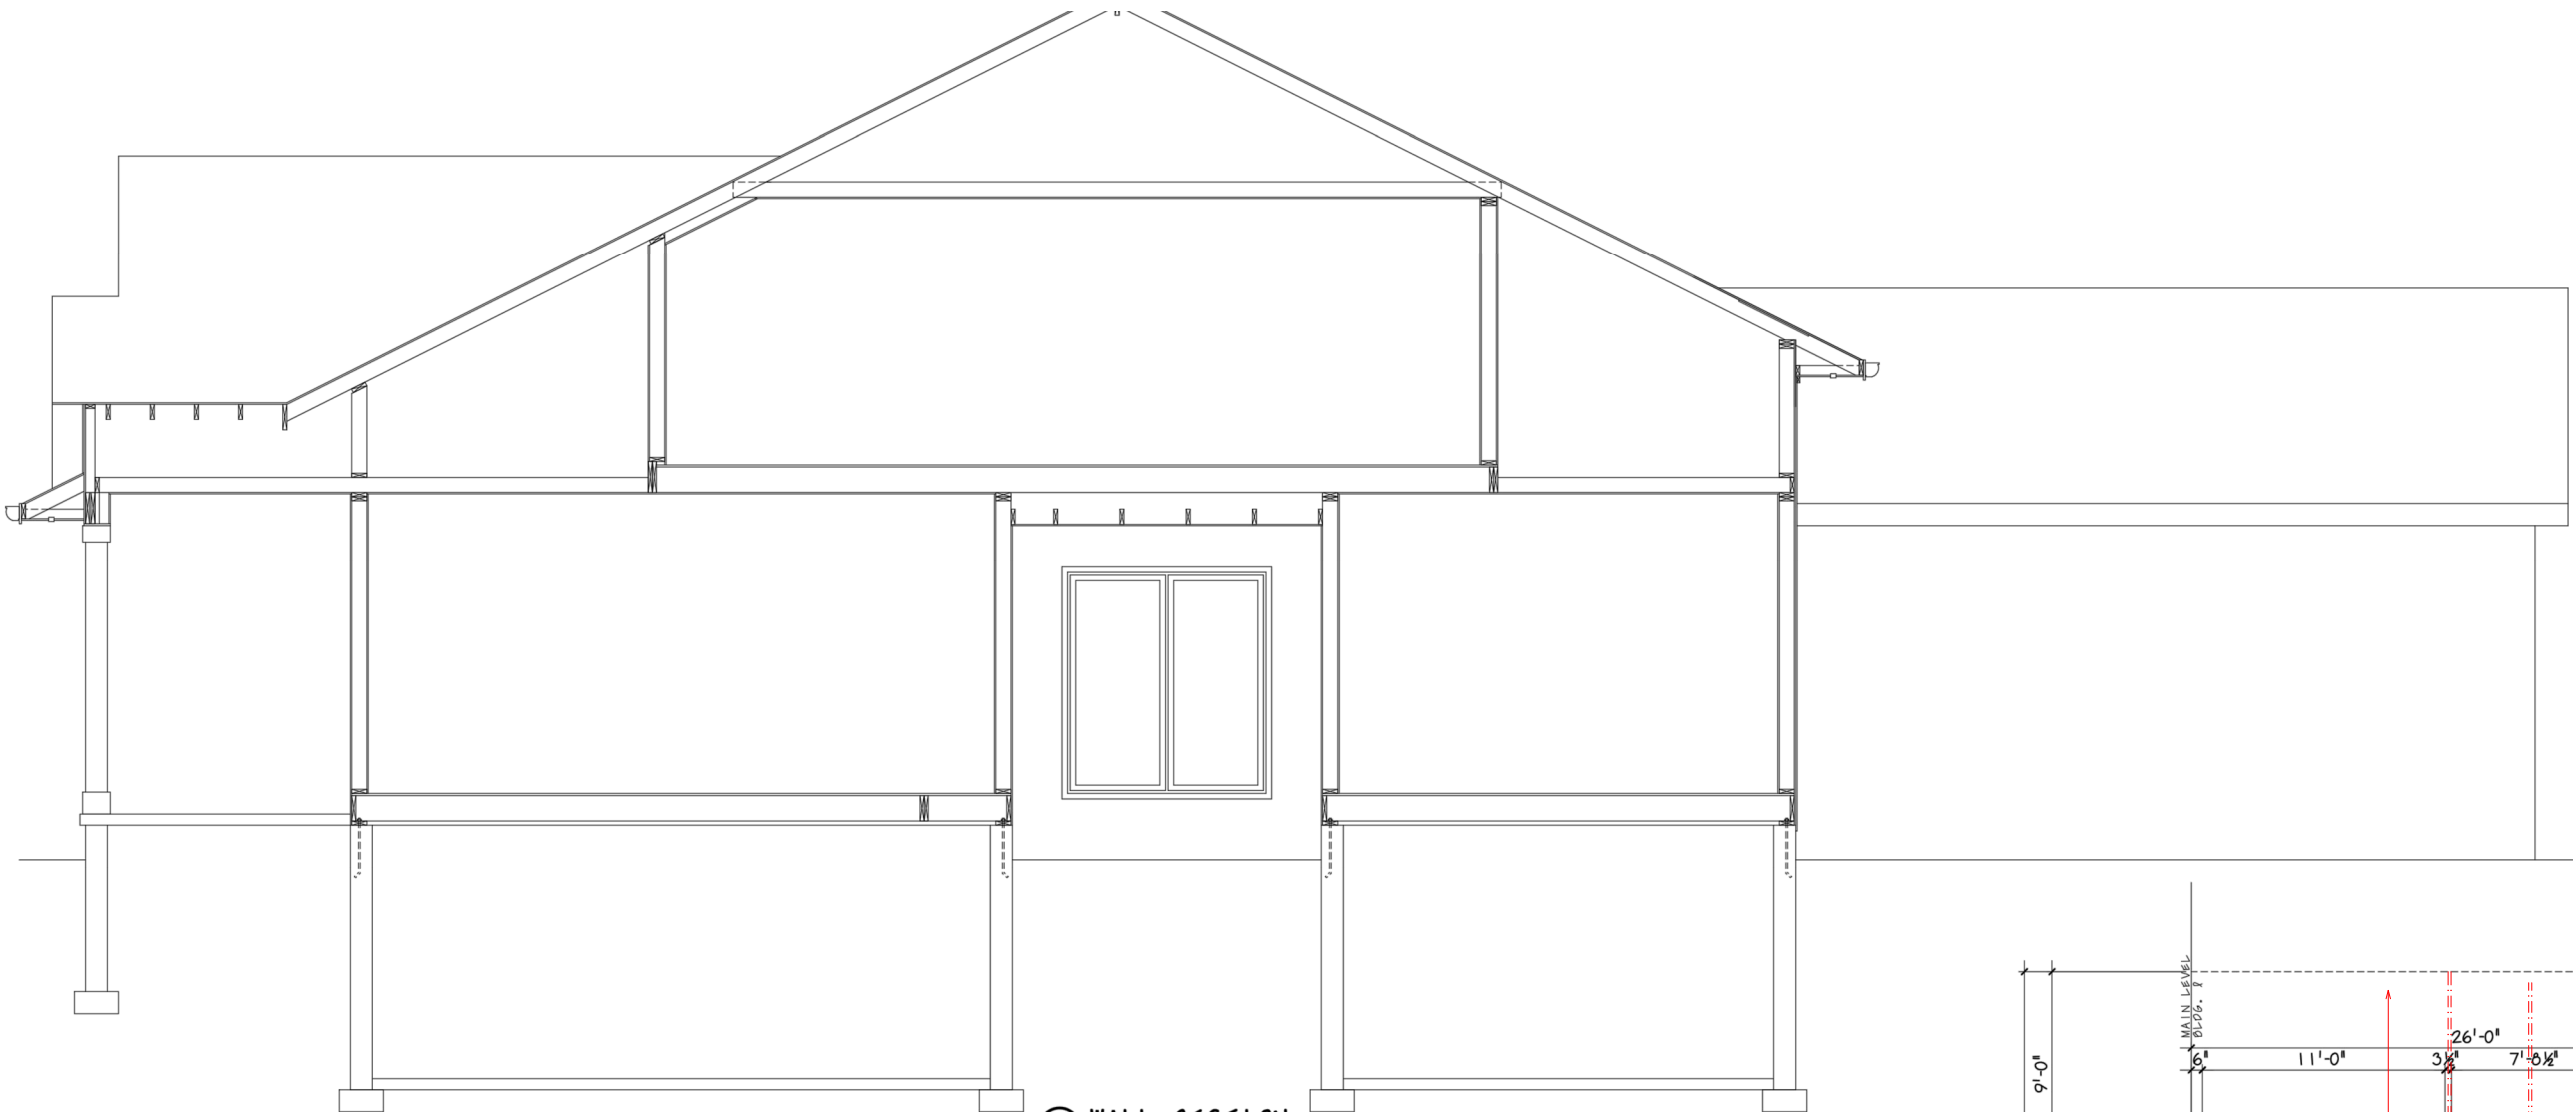

3 WALL SECTION
SCALE: 3/8" = 1'-0"


NOTE: ALL SECOND FLOOR WALLS ARE 0'-1 1/2" HIGH UNLESS NOTED OTHERWISE

NOTE: ALL EXTERIOR WALLS ARE 6" (5" STUD + 1" SHEATHING) ALL INTERIOR WALLS ARE 3/4" UNLESS OTHERWISE SHOWN

NOTE: ALL ANGLED WALLS ARE @ 45°



1/3/2022 - UPDATED PLANS PER TRUSS LAYOUT

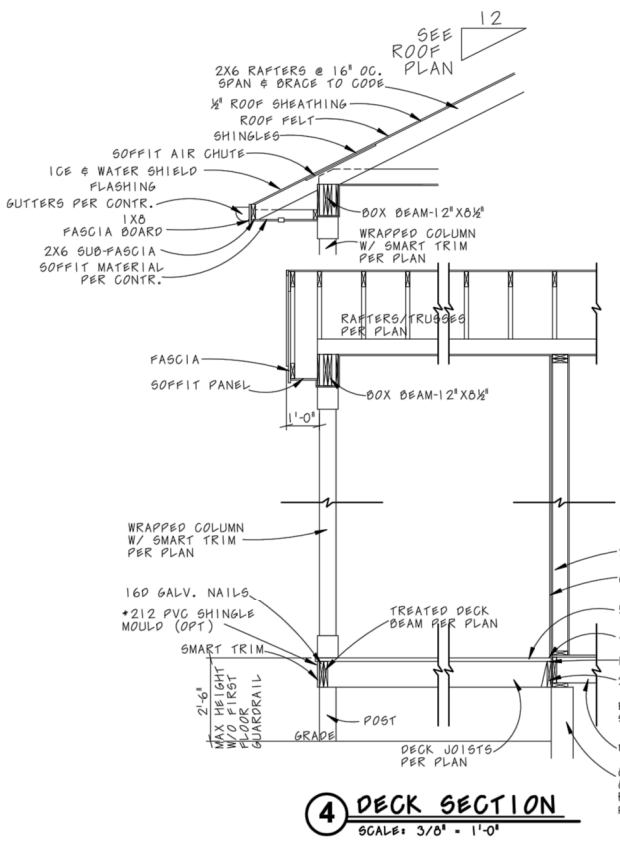

4 DECK SECTION
SCALE: 3/8" = 1'-0"

BRACED WALL METHODOLOGY

XXXX EXTERIOR BRACED WALLS:

WSP METHOD: WOOD STRUCTURAL PANEL SHEATHING WITH A THICKNESS NOT LESS THAN 5/8" WITH MINIMUM SPAN RATING OF 240 FOR 16" O.C. STUD SPACING WITH 8d COMMON NAILS AT 6" O.C. EDGES AND 12" O.C. FIELD OR SHEATHING THICKNESS NOT LESS THAN 7/8" WITH MINIMUM SPAN RATING OF 240 FOR 24" O.C. SPACING WITH 8d COMMON NAILS AT 6" O.C. EDGES AND 12" O.C. IN FIELD.
(NOTE: FRAMING MEMBERS 16" O.C. MAX UNLOCKED, AND W/ SHEATHING APPLIED DIRECTLY TO FRAMING MEMBERS)

IIII INTERIOR BRACED WALLS (REF 2/S4.0):


GB METHOD: 5/8" MIN. GYPSUM BOARD OVER STUDS SPACED 24" MAX. FASTENED WITH No 6 - 1 1/2" TYPE 'W' OR 'S' DRYWALL SCREWS AT 7" O.C. EDGES AND FIELD (MIN. 4'-0" SECTION FOR BOTH SIDES.)

OR


LIB METHOD: 1x4 WOOD FASTENED WITH (3) 8d COMMON NAILS OR SIMPSON / USP 16 GA. TYPE WB (OR EQUAL) STL. X-BRACE(S) AT 45° TO 60° ANGLES, MAXIMUM 16" O.C. STUD FASTENED PER MANUFACTURER'S SPECIFICATIONS.

STRUCTURAL NOTES:

- ALL UNMARKED HEADERS MIN (2)#2-2x10
- ALL HEADERS AND BEAMS MIN #2 GRADE DF/L (OR EQ.)
- BEARING WALL

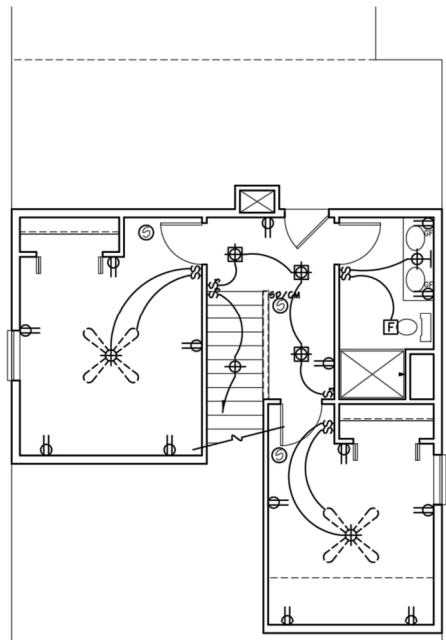

SECOND FLOOR ELECTRICAL
SCALE: 3/16" = 1'-0"

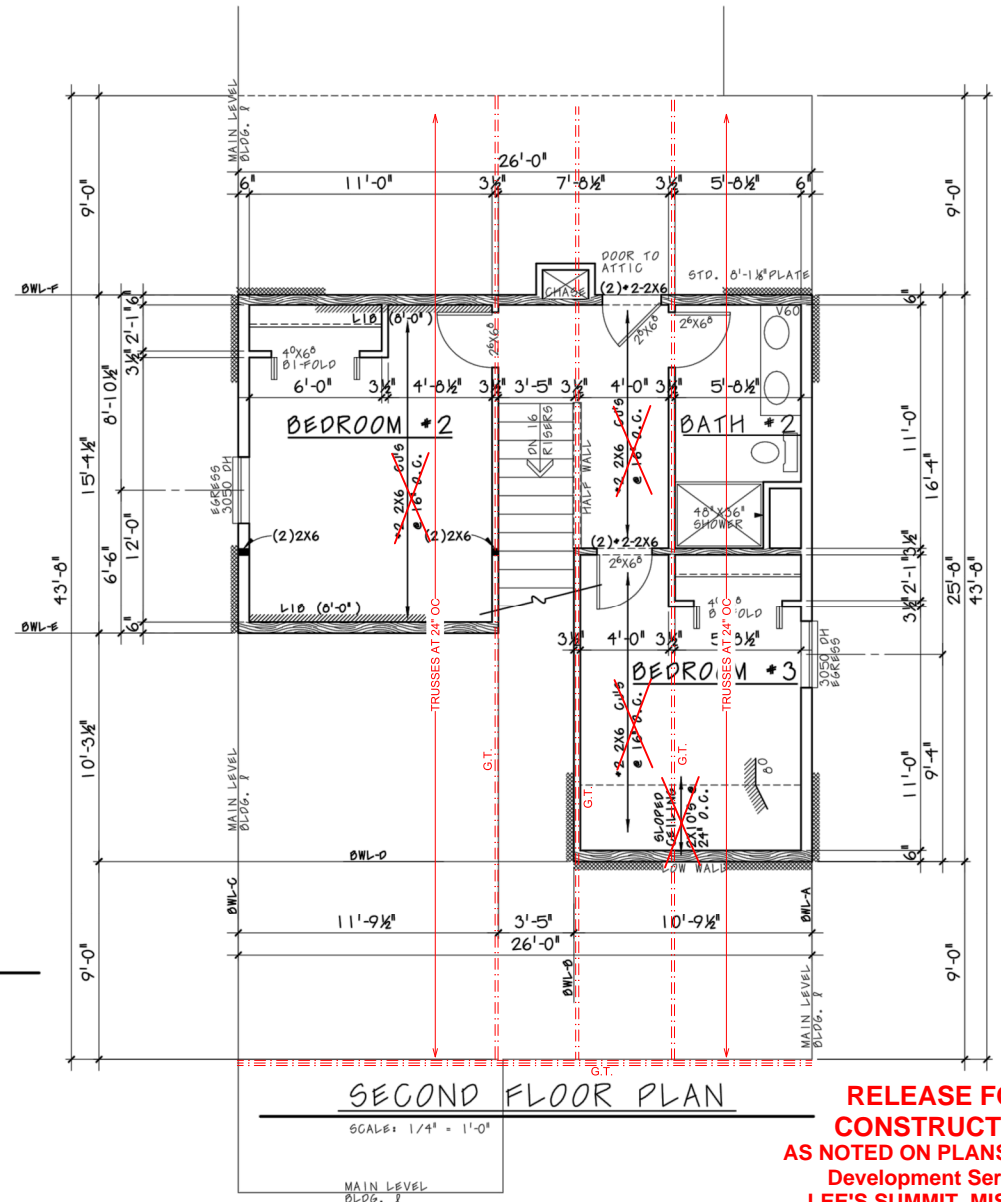

SECOND FLOOR PLAN
SCALE: 1/4" = 1'-0"

RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
Development Services
LEE'S SUMMIT, MISSOURI

The purchaser of these plans is given a limited license to reproduce these plans for construction purposes only and further distribution is strictly prohibited. Because site conditions may vary, the designer cannot warrant the reliability of these plans for use on your specific site. Construction from these plans should not be undertaken without the assistance of a construction professional.

Carl Cuzzo Designs
7504 S 96th Street
La Vista, NE 68128
402-210-4369
planpro1@cox.net

© 2017


508 NW Main St
Lee's Summit

Omaha, Nebraska
1-402-210-4369

Sidload garage
1626 Plan
Revised: 6-3-21

Plan No.

Sheet No. **6**

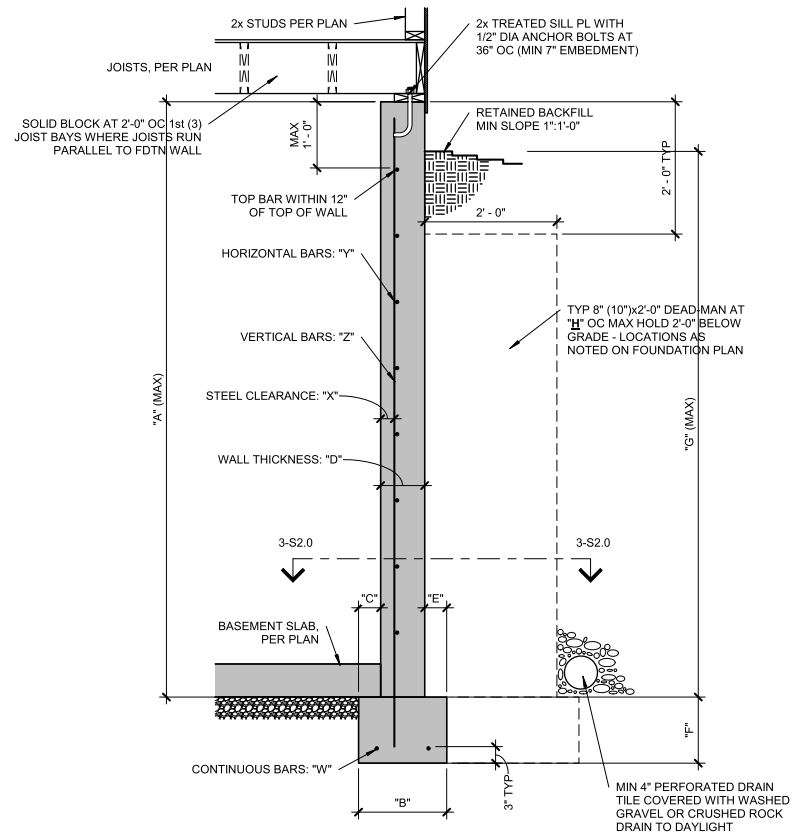

CONCRETE DIMENSIONS


"A"	"B"	"C"	"D"	"E"	"F"	"G"	"H"
8'-0"	1'-4"	4"	8"	4"	8"	7'-6"	20'-0"
9'-0"	1'-4"	4"	8"	4"	8"	8'-6"	20'-0"
10'-0"	1'-8"	5"	10"	5"	10"	9'-6"	20'-0"

REINFORCING BARS (GRADE 40 BARS)

"W"	"X"	"Y"	"Z"
(2) #4	2 1/2"	#4 BARS AT 24" OC	#4 BARS AT 24" OC
(2) #4	2 1/2"	#4 BARS AT 24" OC	#4 BARS AT 24" OC
(2) #4	2 1/2"	#4 BARS AT 18" OC	#4 BARS AT 18" OC


- NOTES:
- DIMENSION SHOWN IS FOR MAXIMUM UNINTERRUPTED WALL PANEL LENGTH BEFORE A DEAD-MAN SHALL BE INSTALLED. NOTE, A MINIMUM 2'-0" RETURN OR OFFSET IN THE FOUNDATION WALL SHALL SUBSTITUTE AS A DEAD-MAN AND/OR BREAK IN THE WALL PANEL LENGTH.
 - VERTICAL REINFORCING STEEL TO EXTEND TO WITHIN 8" OF TOP WALL. MINIMUM (1) #4 HORIZONTAL BAR WITHIN 12" OF TOP AND BOTTOM OF WALL.
 - BURIED CONCRETE FOUNDATION WALLS UP TO 9'-0" TALL MAY BE 8" NOMINAL THICKNESS WITH #4 BARS AT 24" OC BOTH WAYS OVER 16"x8" CONCRETE FOOTINGS WITH (2) #4 BARS CONTINUOUS, UNLESS OTHERWISE REQUIRED BY ENGINEERING REPORT BASED ON ACTUAL SITE CONDITIONS.
 - WALL WILL NOT ACHIEVE FULL STRENGTH UNTIL FIRST FLOOR DECK AND BASEMENT SLAB HAVE BEEN PLACED.

1 TYPICAL FOUNDATION WALL DETAIL
S2.0 | 3/4" = 1'-0"

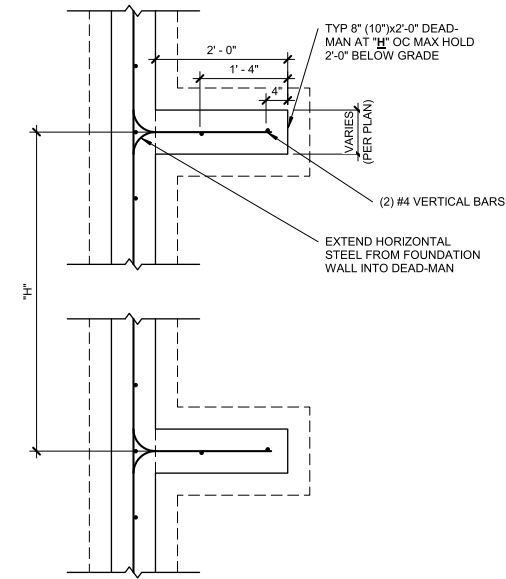

- NOTES:
- MIN 3000 PSI FOOTING COMPRESSIVE CONCRETE STRENGTH.
 - MIN 3000 PSI WALL COMPRESSIVE CONCRETE STRENGTH.
 - AIR ENTRAINED BETWEEN 5% & 7% OF CONCRETE VOLUME.
 - GRADE 40 REINFORCING STEEL UNLESS OTHERWISE NOTED.
 - LAP SPICES 24" MIN.
 - WALL SHALL BE BACK-FILLED WITH CLEAN, LEAN CLAY (OR BETTER) LOW VOLUME CHANGE MATERIAL. ON-SITE MATERIAL MAY BE USED IF DEEMED ACCEPTABLE BY THE GEOTECHNICAL ENGINEER.
 - ASSUMED 2,000 PSF BEARING (TO BE VERIFIED BY GEOTECHNICAL ENGINEER).

3 TYPICAL DEAD-MAN SECTION
S2.0 | 3/4" = 1'-0"

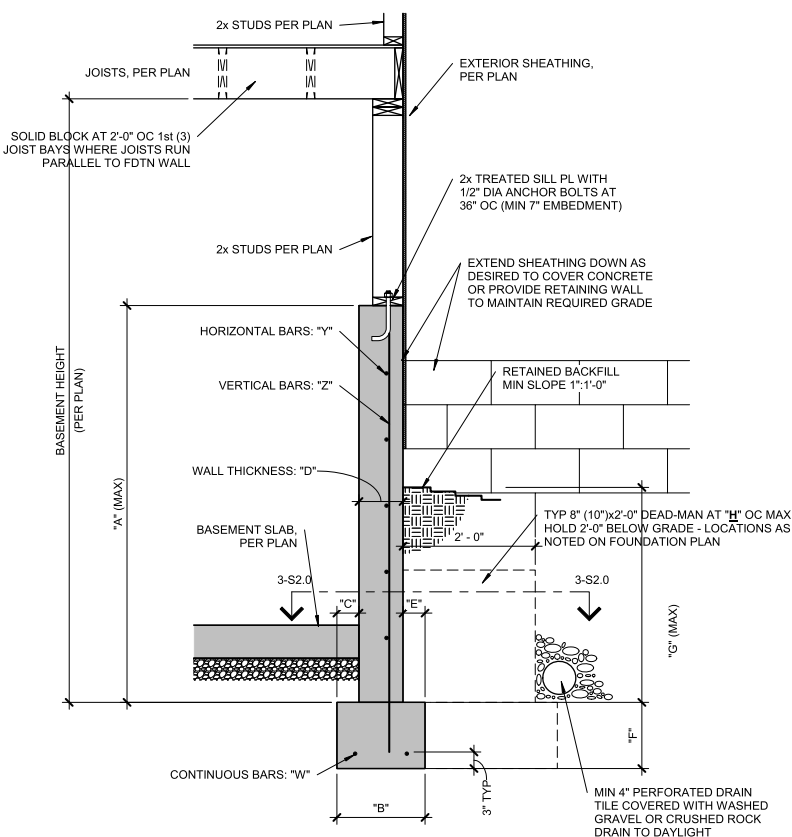

CONCRETE DIMENSIONS

"A"	"B"	"C"	"D"	"E"	"F"	"G"	"H"
4'-0"	1'-4"	4"	8"	4"	8"	3'-4"	20'-0"
6'-0"	1'-4"	4"	8"	4"	8"	4'-4"	20'-0"
9'-0"	1'-8"	5"	8"	4"	8"	4'-4"	20'-0"

REINFORCING BARS (GRADE 40 BARS)

"W"	"X"	"Y"	"Z"
(2) #4	N/A	#4 BARS AT 24" OC	#4 BARS AT 24" OC
(2) #4	N/A	#4 BARS AT 24" OC	#4 BARS AT 24" OC
(2) #4	N/A	#4 BARS AT 24" OC	#4 BARS AT 24" OC


- NOTES:
- DIMENSION SHOWN IS FOR MAXIMUM UNINTERRUPTED WALL PANEL LENGTH BEFORE A DEAD-MAN SHALL BE INSTALLED. NOTE, A MINIMUM 2'-0" RETURN OR OFFSET IN THE FOUNDATION WALL SHALL SUBSTITUTE AS A DEAD-MAN AND/OR BREAK IN THE WALL PANEL LENGTH.
 - VERTICAL REINFORCING STEEL TO EXTEND TO WITHIN 8" OF TOP WALL. MINIMUM (1) #4 HORIZONTAL BAR WITHIN 12" OF TOP AND BOTTOM OF WALL.
 - THE BASEMENT SLAB IS AN INTEGRAL PART OF THE 'UNRESTRAINED' FOUNDATION WALL DESIGN THEREFORE, IF THE WALL IS BACKFILLED PRIOR TO PLACEMENT OF THE BASEMENT SLAB, THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROPERLY BRACING THE WALL UNTIL THE BASEMENT SLAB HAS BEEN PLACED.

2 TYPICAL 'UNRESTRAINED' FOUNDATION WALL DETAIL
S2.0 | 3/4" = 1'-0"

COLUMN AND PIER PAD SCHEDULE

COLUMN MARK	PAD SIZE	REINFORCING	COL SIZE	COL TYPE
▲	30"x30"x12"	(4) #4 BARS E-W	3" NOMINAL	STEEL COLUMN (FY = 36,000 MIN)
▲	36"x36"x12"	(4) #4 BARS E-W	3" NOMINAL	STEEL COLUMN (FY = 36,000 MIN)
▲	42"x42"x12"	(5) #4 BARS E-W	3" NOMINAL	STEEL COLUMN (FY = 36,000 MIN)
▲	48"x48"x12"	(6) #4 BARS E-W	3" NOMINAL	STEEL COLUMN (FY = 36,000 MIN)
▲	54"x54"x16"	(8) #4 BARS E-W	3 1/2" NOMINAL (F.O.D.)	STEEL COLUMN (FY = 36,000 MIN)
▲	60"x60"x16"	(10) #4 BARS E-W	3 1/2" NOMINAL (F.O.D.)	STEEL COLUMN (FY = 36,000 MIN)

- NOTES:
- COLUMN AND PIER PAD SIZES SHOWN ARE FOR MAXIMUM COLUMN HEIGHT OF 10'-0". REQUIRES SEPERATE ENGINEERED DESIGN IF GREATER THAN 10'-0"
 - COLUMN AND PIER PAD SIZES SHOWN ARE BASED ON AN ASSUMED MINIMUM ALLOWABLE SOIL BEARING CAPACITY OF 2,000 PSF.

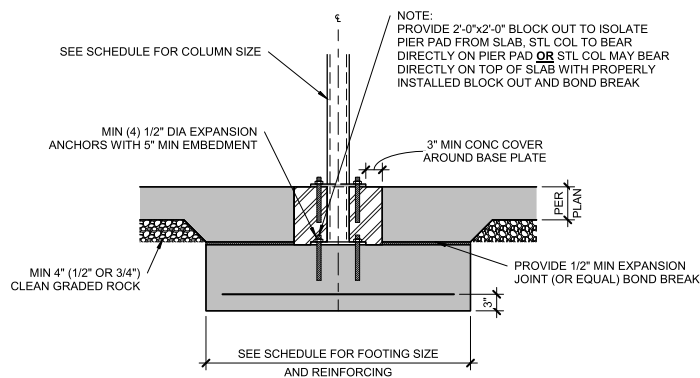


5 COLUMN PAD DETAIL
S2.0 | 3/4" = 1'-0"

EXPANSIVE SOILS DISCLAIMER:


THESE PLANS HAVE BEEN PREPARED BASED ON A PRESUMPTIVE ALLOWABLE BEARING CAPACITY AS ALLOWED BY IRC CODE AND THE LOCAL ENFORCING JURISDICTION.

APEX ENGINEERS, INC. (APEX) RECOMMENDS THAT ALL FOOTING EXCAVATIONS BE EVALUATED BY A LICENSED GEOTECHNICAL ENGINEER PRIOR TO THE PLACEMENT OF ANY FOUNDATION ELEMENTS. GEOTECHNICAL INVESTIGATION AND/OR TESTING IS NOT A SERVICE PROVIDED OR OFFERED BY APEX.

APEX HAS NOT BEEN RETAINED TO DETERMINE THE EXPANSIVE SOIL CHARACTERISTICS OF THE SUBGRADE SOIL AND THEREFORE CANNOT BE HELD RESPONSIBLE FOR THE VOLUMETRIC CHANGES OF THE SOIL (INCLUDING BELOW THE BASEMENT SLAB). BY USE OF THESE PLANS WITHOUT AN ACCOMPANYING GEOTECHNICAL ENGINEERING REPORT, APEX SHALL NOT BE HELD LIABLE FOR ANY FUTURE MOVEMENT AND/OR DIFFERENTIAL MOVEMENT OF THE PROPOSED STRUCTURE AND THE POSSIBLE DAMAGE THAT MAY BE CAUSED AS A RESULT OF SUCH MOVEMENT. DAMAGE FROM EXPANSIVE SOILS AND/OR SETTLEMENT CAN RESULT IN AMONGST OTHER THINGS, THE FOLLOWING: BASEMENT SLAB HEAVE, SHEETROCK CRACKS, WINDOWS AND DOOR BECOMING OUT OF PLUMB AND STICKING AND/OR NOT OPENING, DAMAGE TO TILE, MOULDING, AND OTHER COSMETIC FINISHES.

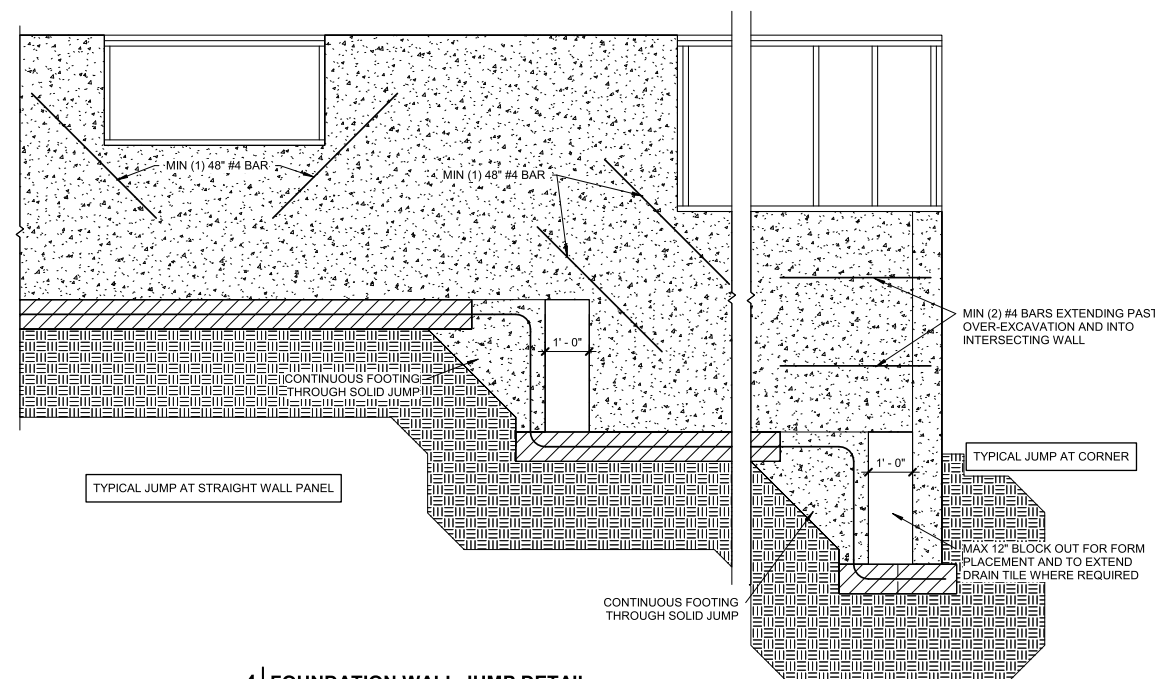

4 FOUNDATION WALL JUMP DETAIL
S2.0 | 1/2" = 1'-0"



STRUCTURAL DESIGN REVIEW
KANSAS ENGINEERING LICENSE: E-992
MISSOURI ENGINEERING LICENSE: 2003004673


PROJECT: 508 NW MAIN STREET, LEES SUMMIT
CLIENT: HOUSE AND RENNER

PROJECT #: 43633
DRAWN BY: jae
CHECKED BY: BDC
SUBMITTAL DATE: 2022.01.06







DATE	REVISIONS

RELEASE FOR CONSTRUCTION AS NOTED ON PLANS. REVIEWED BY DEVELOPMENT SERVICES. LEE'S SUMMIT, MISSOURI

DATE	COMMENTS

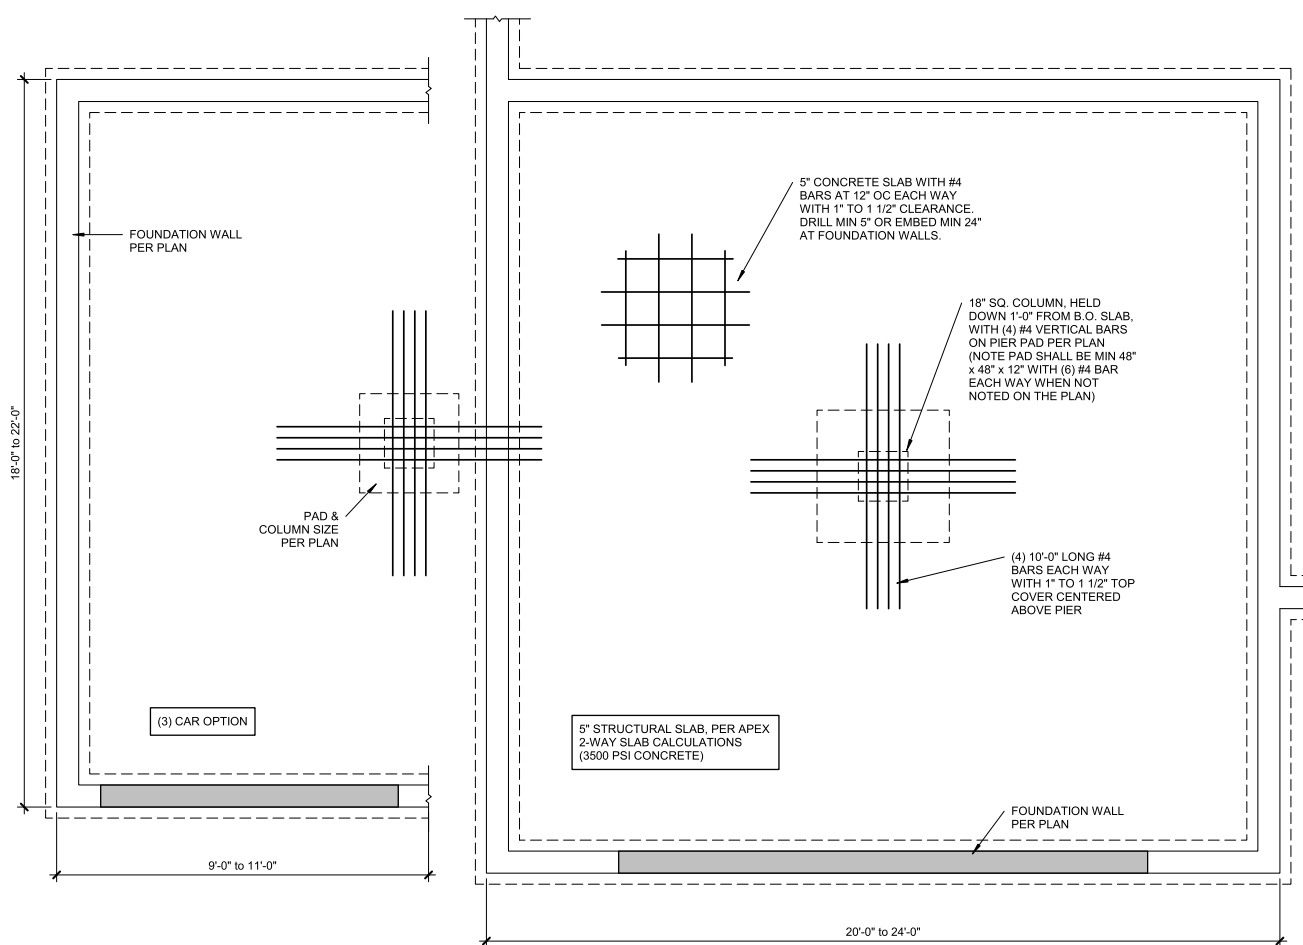

EGRESS WINDOW NOTES:
PER IRC SECTION 310
1. 5.7 S.F. OPENING MIN.
2. 24" MIN. CLEAR HEIGHT
3. 20" MIN. CLEAR WIDTH
4. 44" MAX HEIGHT A.F.F.

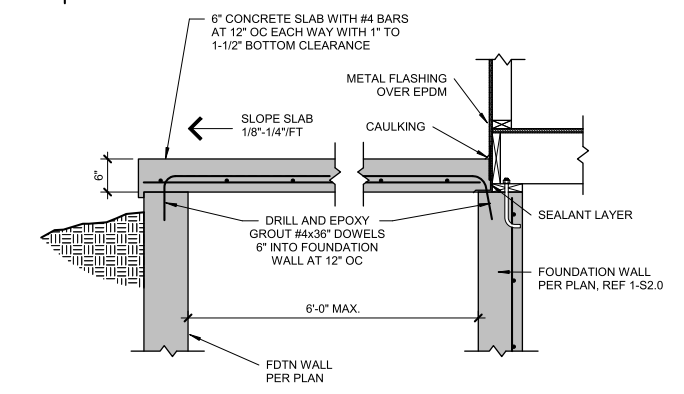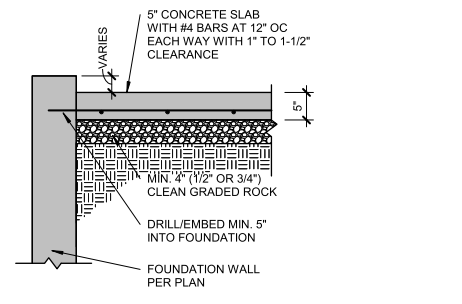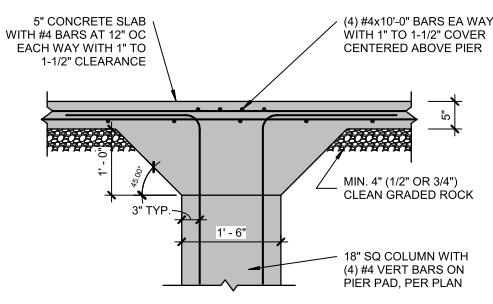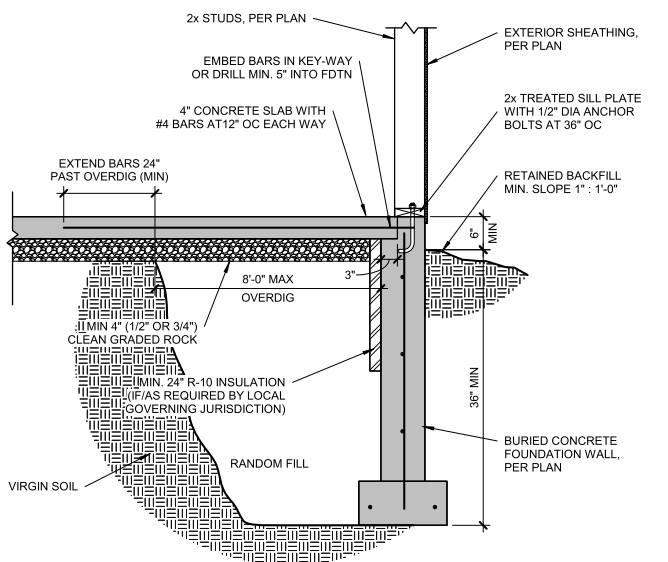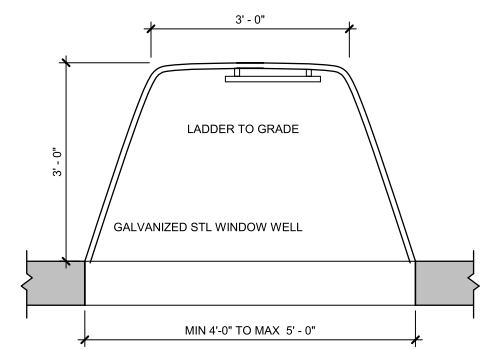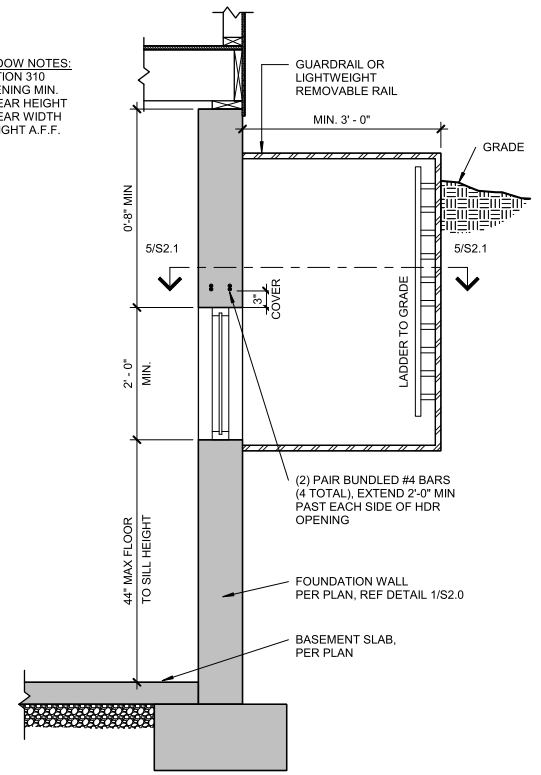

PIER SCHEDULE










COLUMN MARK	COL SIZE	PIER DIAMETER
△	PER PLAN	12"
△	PER PLAN	16"
△	PER PLAN	18"
△	PER PLAN	24"
△	PER PLAN	28"

POST PER PLAN

SIMPSON AB POST BASE:
4x4 - ABU44
6x6 - ABU66
8x8 - ABU88

CONC PIER PER PLAN

NOTE: ALL CONC. PIERS SHALL BE DRILLED MIN 36" DEEP TO COMPETENT ORIGINAL SOIL WITH MIN 2,000 PSF BEARING CAPACITY (TYP UNO)

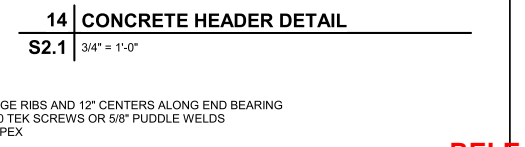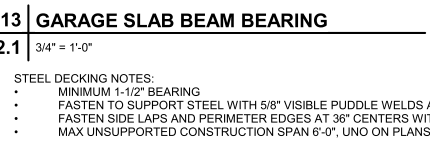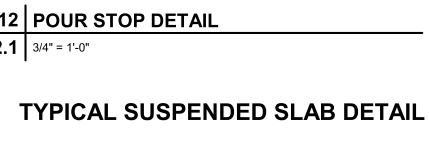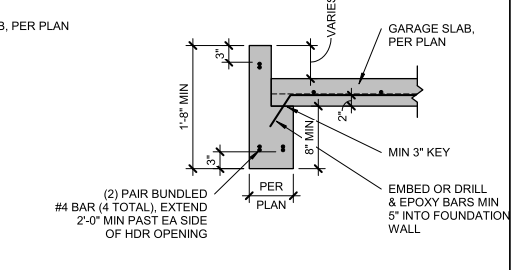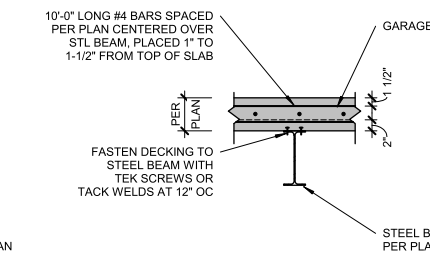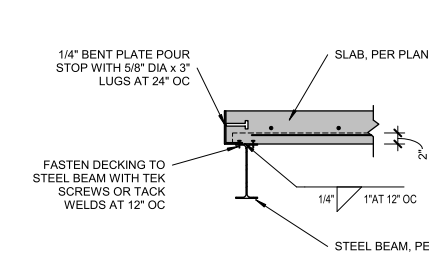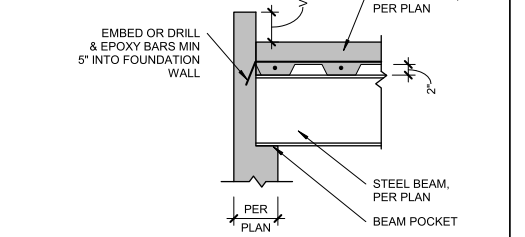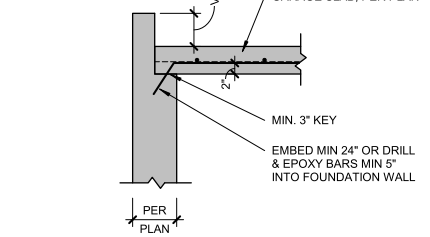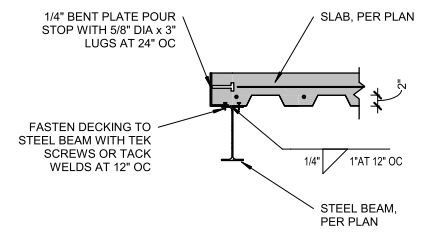

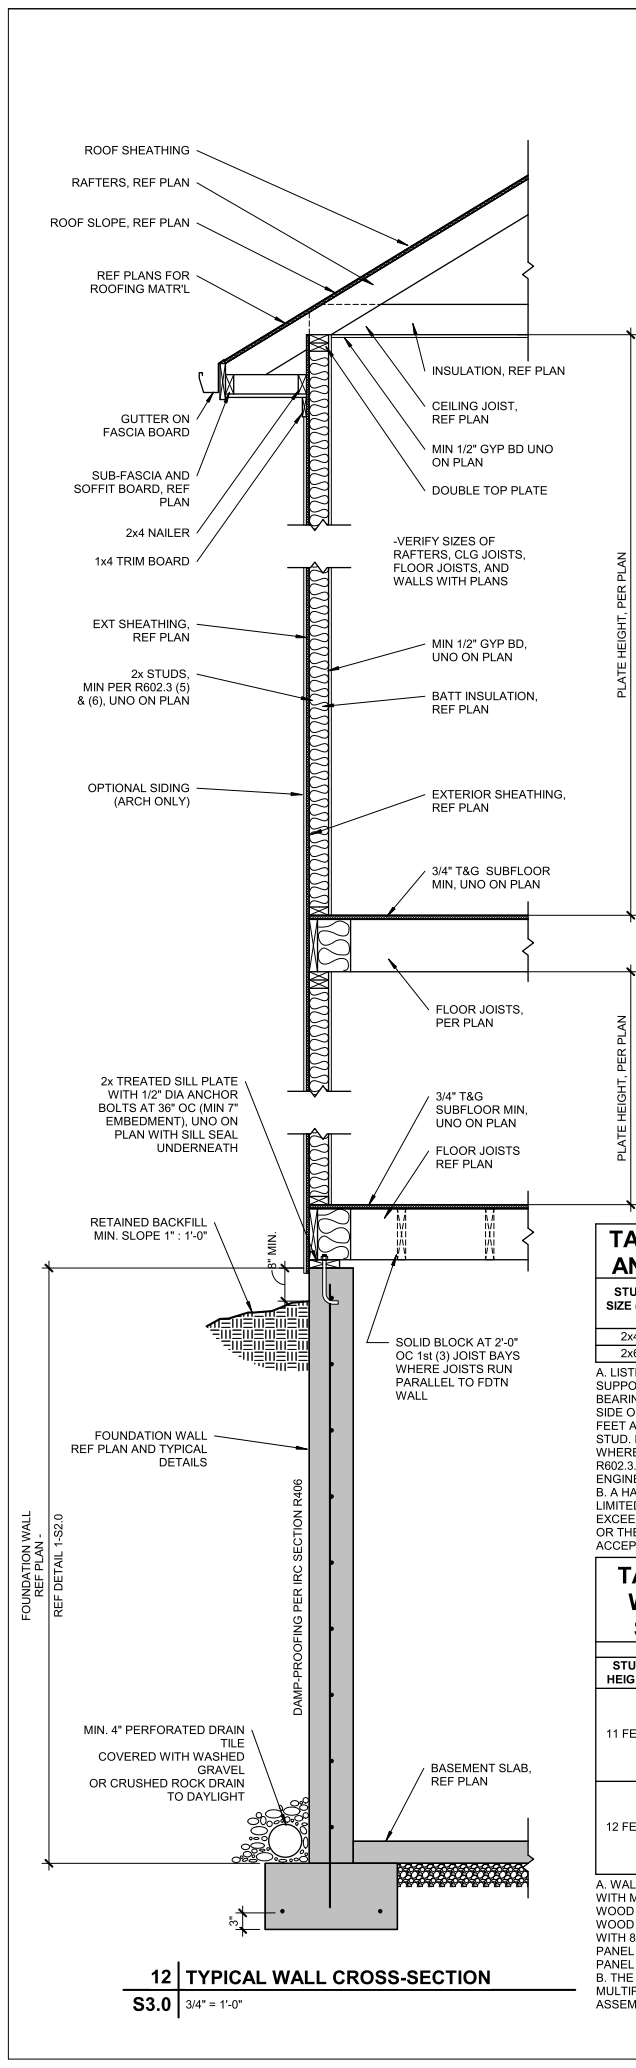


TABLE R602.3 (5) - SIZE, HEIGHT, AND SPACING OF WOOD STUDS






STUD SIZE (IN)	LATERALLY UNSUPPORTED STUD HEIGHT*	STRUCTURE SUPPORTED		
		ROOF ONLY	ROOF AND (1) FLOOR	ROOF AND (2) FLOORS
2x4	10 FEET	24" OC ¹	16" OC ²	N/A
2x6	10 FEET	24" OC	24" OC	16" OC

A. LISTED HEIGHTS ARE DISTANCES BETWEEN POINTS OF LATERAL SUPPORT PLACED PERPENDICULAR TO THE PLANE OF THE WALL. BEARING WALLS SHALL BE SHEATHED ON NOT LESS THAN ONE SIDE OR BRIDGING SHALL BE INSTALLED NOT GREATER THAN 4 FEET APART MEASURED VERTICALLY FROM EITHER END OF THE STUD. INCREASES IN UNSUPPORTED HEIGHT ARE PERMITTED WHERE IN THE COMPLIANCE WITH EXCEPTION 2 OF SECTION R602.3.1 OR DESIGNED IN ACCORDANCE WITH ACCEPTED ENGINEERING PRACTICE.
B. A HABITABLE ATTIC ASSEMBLY SUPPORTED BY 2x4 STUDS IS LIMITED TO A ROOF SPAN OF 32 FEET. WHERE THE ROOF SPAN EXCEEDS 32 FEET, THE WALL STUDS SHALL BE INCREASED TO 2x6 OR THE STUDS SHALL BE DESIGNED IN ACCORDANCE WITH ACCEPTED ENGINEERING PRACTICE.

TABLE R602.3 (6) - ALTERNATE WOOD BEARING WALL STUD SIZE, HEIGHT AND SPACING

STUD HEIGHT	SUPPORTING	ULTIMATE DESIGN WIND SPEED = 115 MPH		
		STUD SPACING	12 FEET	24 FEET
11 FEET	ROOF ONLY	12 IN	2x4	2x4
		16 IN	2x4	2x4
	ROOF AND ONE FLOOR	12 IN	2x4	2x6
		16 IN	2x6	2x6
12 FEET	ROOF ONLY	12 IN	2x4	2x4
		16 IN	2x4	2x6
	ROOF AND ONE FLOOR	12 IN	2x4	2x6
		16 IN	2x6	2x6


A. WALL STUDS NOT EXCEEDING 16" OC SHALL BE SHEATHED WITH MINIMUM 1/2" GYPSUM BOARD ON THE INTERIOR AND 3/8" WOOD STRUCTURAL PANEL SHEATHING ON THE EXTERIOR. WOOD STRUCTURAL PANEL SHEATHING SHALL BE ATTACHED WITH 8d (2.5" x 0.131") NAILS NOT GREATER THAN 6" OC ALONG PANEL EDGES AND 12" OC AT INTERMEDIATE SUPPORTS, AND ALL PANEL JOINTS SHALL OCCUR OVER STUDS OR BLOCKING.
B. THE MAXIMUM SPAN IS APPLICABLE TO BOTH SINGLE AND MULTIPLE SPAN ROOF AND FLOOR CONDITIONS. THE ROOF ASSEMBLY SHALL NOT CONTAIN A HABITABLE ATTIC.

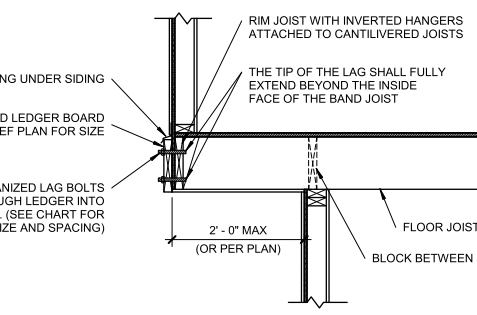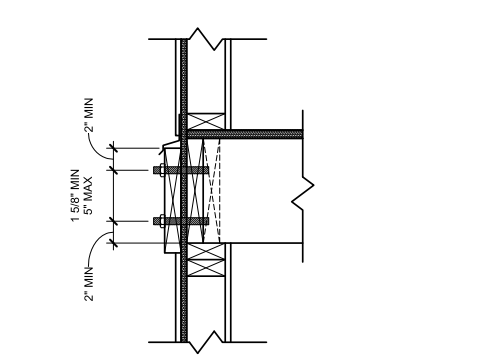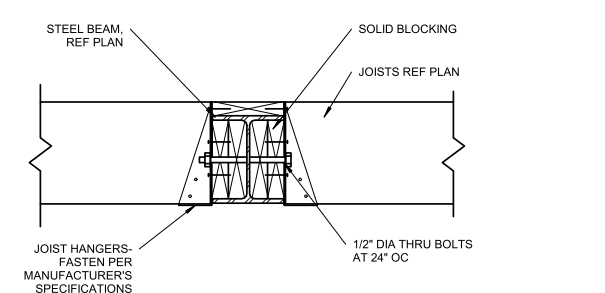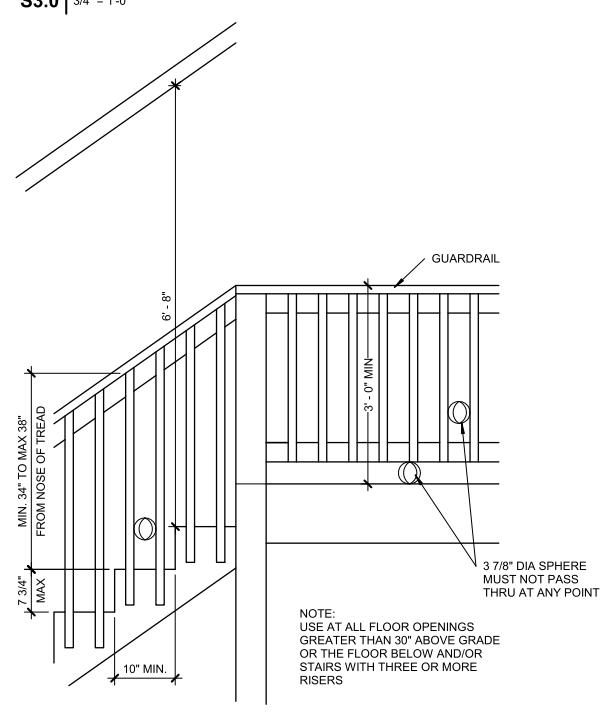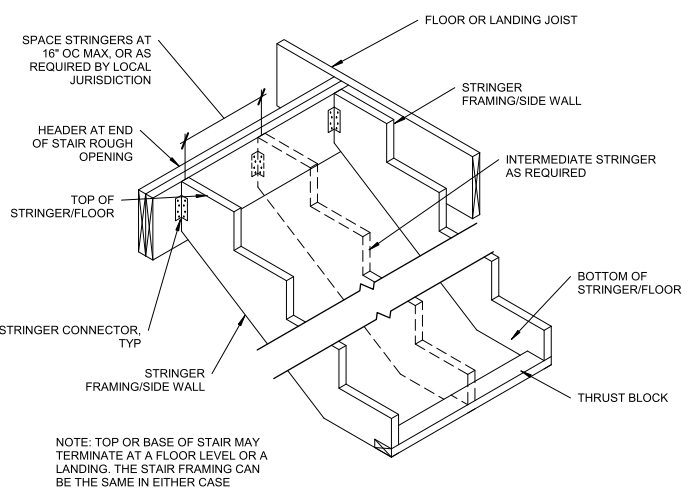

DECK LEDGER ATTACHMENT CHART

DECK JOIST SPAN	1/2" DIA LAG SPACING	EQUIVALENT SPACING FOR 16" OC JOIST BAYS
UP TO 10'-0"	16" OC	N/A
10'-1" TO 12'-0"	15" OC	16" OC DBL EVERY OTHER
12'-1" TO 14'-0"	13" OC	16" OC DBL EVERY OTHER
14'-1" TO 16'-0"	11" OC	16" OC DBL EVERY JOIST BAY
16'-1" TO 18'-0"	10" OC	16" OC DBL EVERY JOIST BAY

NOTE: CHART IS APPLICABLE ONLY WHEN DECK IS SHOWN ON APPROVED PLAN.





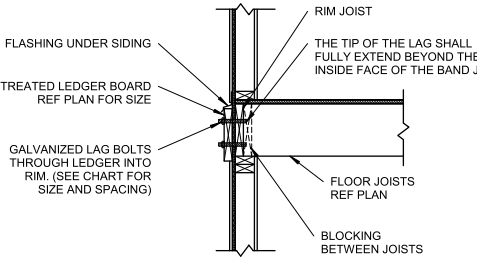


5 TYPICAL LEDGER BOLT SPACING


5 TYPICAL LEDGER BOLT SPACING
S3.0 3/4" = 1'-0"

Labels include: LAG SCREW OR BOLT, 5" MAX, 2" MIN, 3/4" MIN, LEDGER, REF PLAN FOR SIZE.

BEAM SIZE	"X"	STUD
2x8"	5 1/2" MIN	"DISTANCE SHALL BE PERMITTED TO BE REDUCED TO 4 1/2" IF LAG SCREWS ARE USED OR BOLT SPACING IS REDUCED TO THAT OF LAG SCREWS TO ATTACH 2x8 LEDGERS TO 2x8 BAND JOISTS"
2x10	6 1/2" MIN	
2x12	7 1/2" MIN	

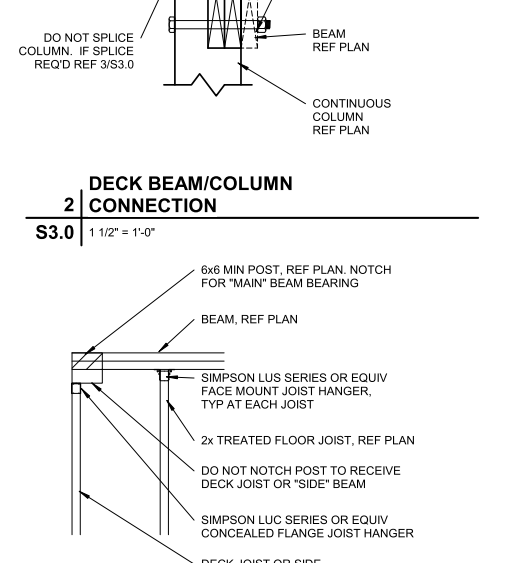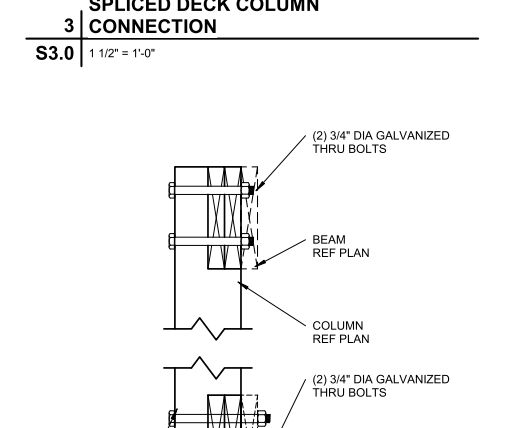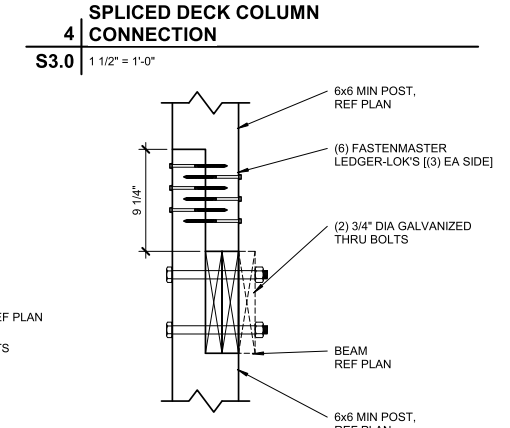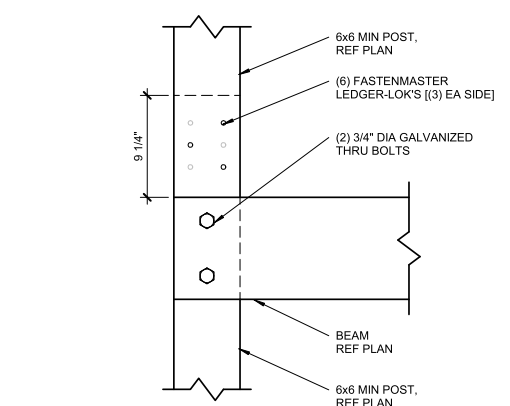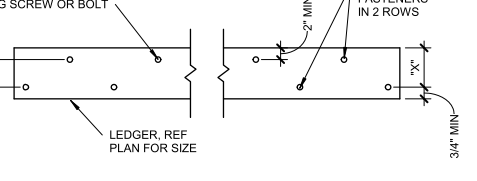


DATE	REVISION	COMMENTS

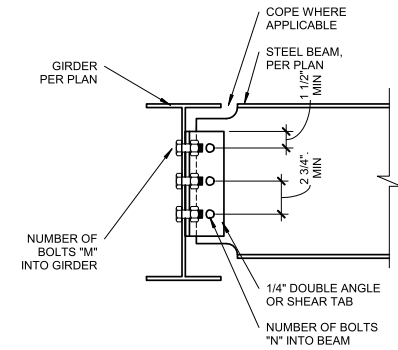


3 BEAM TO GIRDER CONNECTION
S3.1 1 1/2" = 1'-0"

BEAM CONNECTION SCHEDULE		
BEAM SIZE	# OF BOLTS "N"	# OF BOLTS "M"
W8, W10	2	4
W12, W14	3	6
W16, W18	4	8

NOTES:
1. THESE CONNECTIONS ARE TYPICAL, UNO.
2. NUMBER OF BOLTS IN UPSET BEAM CONNECTIONS DETERMINED BY SMALLER OF TWO BEAMS AT CONNECTION.
3. ALL AROUND 1/4" FILLET WELD MAY BE SUBSTITUTED FOR EITHER BOLTED CONNECTION.
4. ALL BOLTS, 3/4" DIAMETER, A325-N, UNO.

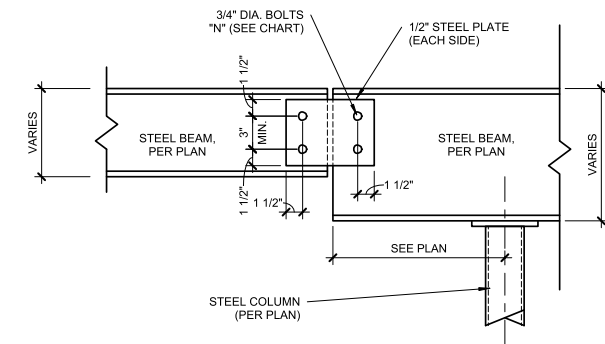


2 BEAM SPLICE DETAIL
S3.1 1 1/2" = 1'-0"

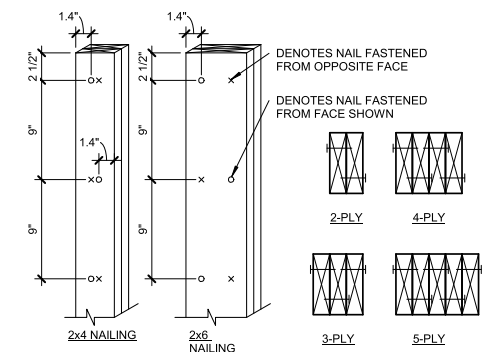


- NOTES:
1. EACH 2x PLY SHALL BE FASTENED WITH (1) ROW OF 10d NAILS AT 9" OC, ALTERNATING SIDE TO SIDE.
2. 1.4" MIN EDGE DISTANCE, AND STARTING 2 1/2" FROM EACH END.
3. EXTEND FULL AREA OF COLUMN AS SOLID BLOCKING THROUGH JOIST BAYS AND WALLS TO LOAD-BEARING BEAM/WALL BELOW


1 BUILT-UP STUD COLUMN
S3.1 1 1/2" = 1'-0"

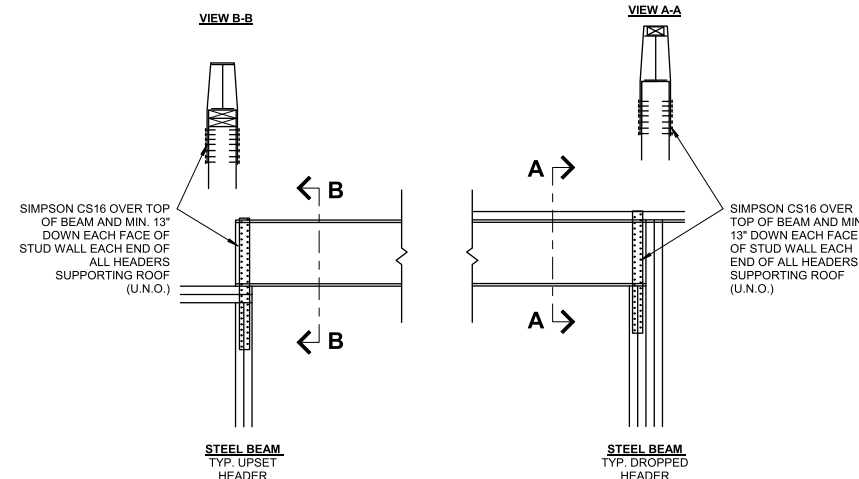

9 FLUSH STEEL BEAM TO STEEL BEAM
S3.1 1 1/2" = 1'-0"

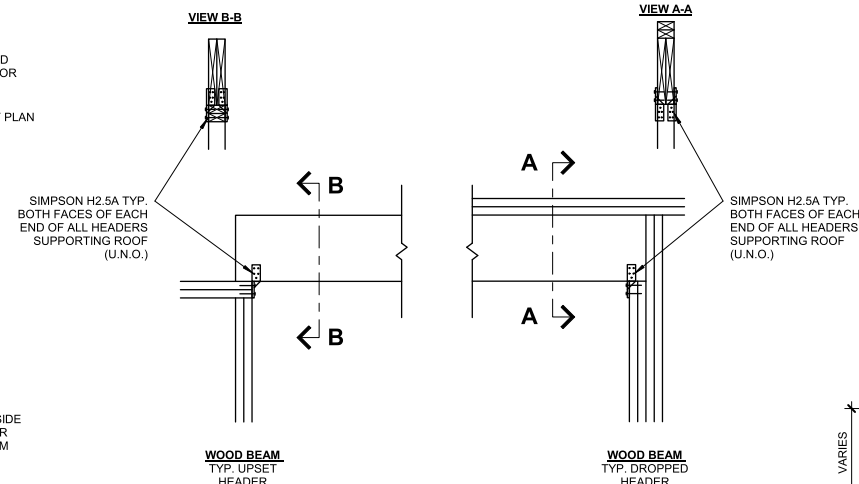

5 ROOF SUPPORTING BEAM HOLD DOWN
S3.1 3/4" = 1'-0" (COMPLIANCE WITH IRC R802.11)

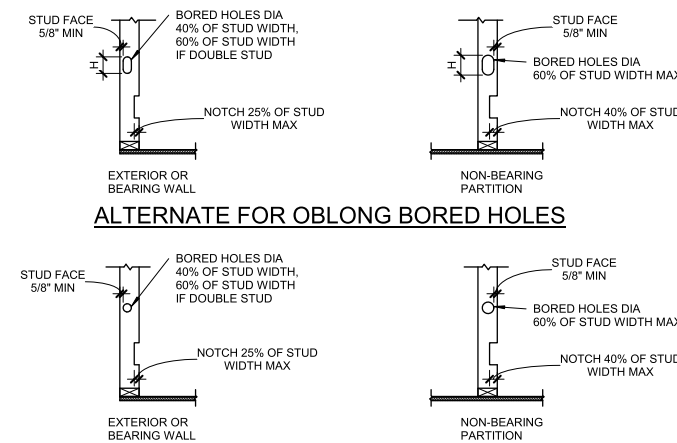


WALL SIZE	BORED HOLE SIZE		WALL NOTCH	
	STUDS LOAD BEARING OR EXTERIOR WALL	NON LOAD BEARING WALL	LOAD BEARING WALL	NON LOAD BEARING WALL
2x4	40%	60%	25%	40%
(2) 2x4	1 3/8"	2 1/8"	7/8"	1 3/8"
2x6	2 1/4"	2 1/8"	3 15/16"	1 3/8"
(2) 2x6	-	3 5/16"	1 3/8"	2 1/4"
2x8	2 7/8"	-	4 3/8"	2 7/8"
(2) 2x8	-	4 3/8"	1 13/16"	2 7/8"

PLATES:
TOP AND BOTTOM PLATE HOLE, CUT OR NOTCH THAT IS 50% MORE OF WIDTH MUST BE REPAIRED USING 16 GA (MIN) METAL TIE THAT IS AT LEAST 1-1/2" WIDE IF WALL IS A SHEAR WALL IT MUST BE REPAIRED USING HARDY FRAME SADDLE (HFS).


NOTE:
SEE SECTION R602.6 AND FIGURES R602.6.1 AND R602.6.2

WALL SIZE	HOLE SIZE	VERTICAL HOLE SIZE (H)
2x4	1 3/4"	D+1/2" AT Lvl 1&2
2x6	2 3/4"	D+1" AT Lvl 3
2x8	3 5/8"	D+1 1/4" AT Lvl 4
		D+1 1/2" AT Lvl 5


4 DRILLING & NOTCHING DETAIL
S3.1 3/4" = 1'-0"

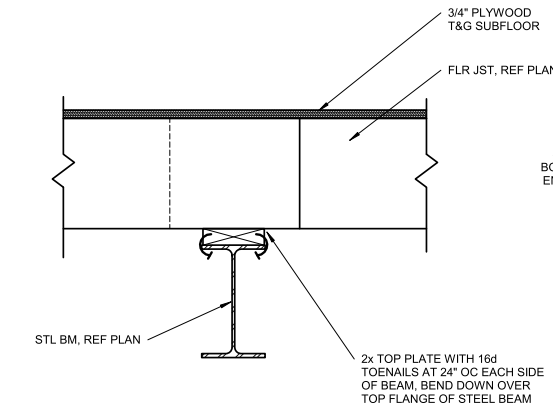


8 WOOD PLATE TO STEEL BEAM CONNECTION
S3.1 1 1/2" = 1'-0"

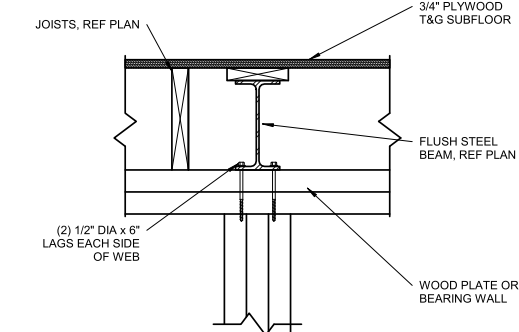


7 FLUSH STEEL BEAM CONNECTION
S3.1 1 1/2" = 1'-0"

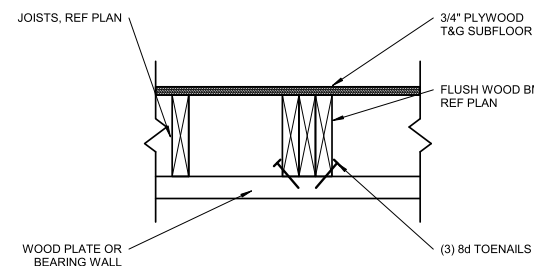

6 FLUSH WOOD BEAM CONNECTION
S3.1 1 1/2" = 1'-0"

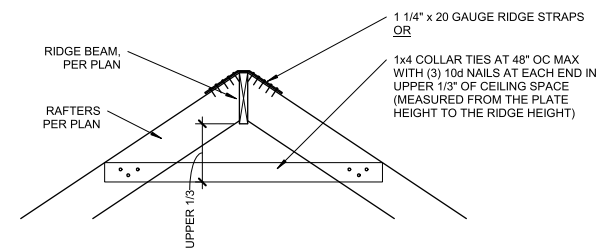

12 RIDGE BEAM DETAIL
S3.1 3/4" = 1'-0"

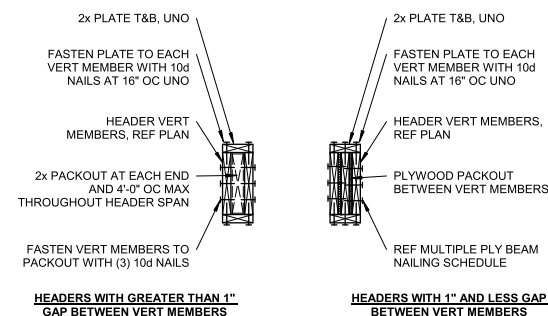

11 TYPICAL WOOD HEADER DETAIL
S3.1 NOT TO SCALE

2 - PLY	3 - PLY	4 - PLY
(3) ROWS OF 16d x 3-1/2" NAILS AT 6" OC	(3) ROWS OF 16d x 3-1/2" NAILS AT 4" OC	(2) ROWS OF 1/2" DIA. A307 THRU-BOLTS AT 12" OC STAGGERED

NOTES:
1. NAILING SHOWN APPLIES UNLESS SPECIFICALLY NOTED IN DETAILS.
2. SPACE NAILS EVENLY THROUGHOUT DEPTH OF BEAM.

10 MULTIPLE PLY BEAM NAILING SCHEDULE
S3.1 NOT TO SCALE



9 FLUSH STEEL BEAM TO STEEL BEAM
S3.1 1 1/2" = 1'-0"


DATE	#	COMMENTS

UPLIFT CONNECTION SCHEDULE


OVERHANG SPAN: 1'-1" TO 1'-9"			
RAFTER SPACING	UPLIFT CONNECTOR	EXPOSURE B	EXPOSURE C
12" OC	SIMPSON H2.5A	(1) AT 24" OC	(1) AT 24" OC
16" OC	SIMPSON H2.5A	(1) AT 32" OC	(1) AT 16" OC
24" OC	SIMPSON H2.5A	(1) AT 24" OC	(1) AT 24" OC
OVERHANG SPAN: 1'-10" TO 2'-6"			
RAFTER SPACING	UPLIFT CONNECTOR	EXPOSURE B	EXPOSURE C
12" OC	SIMPSON H2.5A	(1) AT 12" OC	(1) AT 12" OC
16" OC	SIMPSON H2.5A	(1) AT 16" OC	(2) AT 16" OC
24" OC	SIMPSON H2.5A	(2) AT 24" OC	(2) AT 24" OC
OVERHANG SPAN: 2'-7" TO 3'-9"			
RAFTER SPACING	UPLIFT CONNECTOR	EXPOSURE B	EXPOSURE C
12" OC	SIMPSON H2.5A	(2) AT 12" OC	(2) AT 12" OC
16" OC	SIMPSON H2.5A	(2) AT 16" OC	(2) AT 16" OC
24" OC	SIMPSON H2.5A	(2) AT 24" OC	N/A

OVERHANG SPAN	MIN BACKSPAN LENGTH
≤1'-0"	1'-0"
1'-1" to 2'-0"	EQUALS OVERHANG SPAN
≥2'-1"	OVERHANG SPAN X2


NOTES:
-CHART IS ONLY APPLICABLE IF NO RAFTER BEAM SHOWN ON PLAN.
-CONTACT EOR IF OVERHANG LENGTH EXCEEDS CHART OPTIONS.
-ALTERNATE, REF BARGE RAFTER DETAIL FOR OVERHANGS 1'-0" OR LESS.

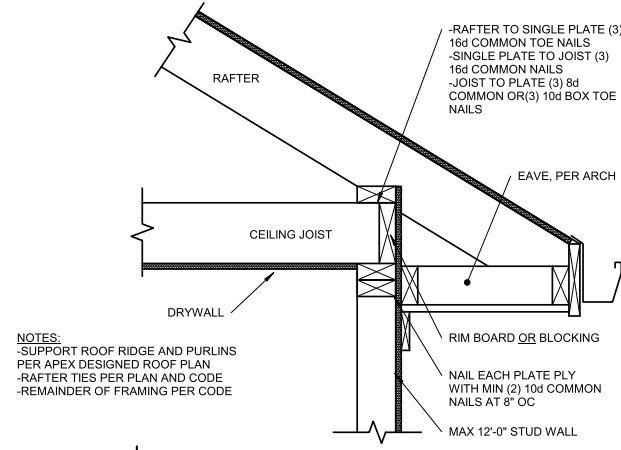


9 OPTIONAL RAFTER BEARING
S3.2 | 1/2" = 1'-0"

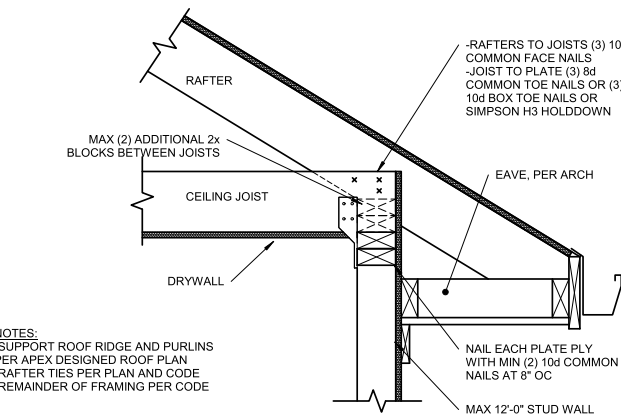



8 OPTIONAL RAFTER BEARING
S3.2 | 1/2" = 1'-0"

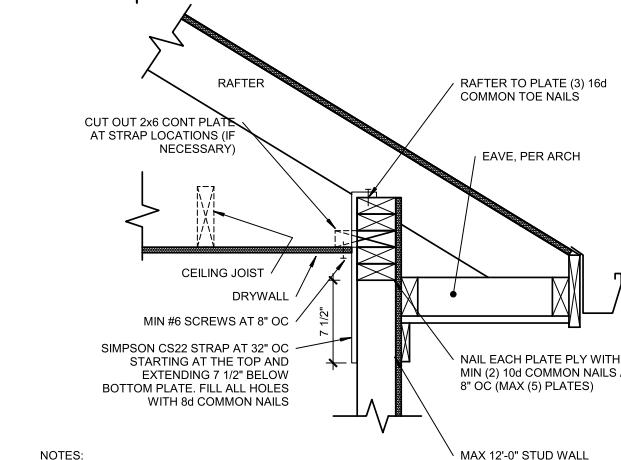

7 OPTIONAL RAFTER BEARING
S3.2 | 1/2" = 1'-0"

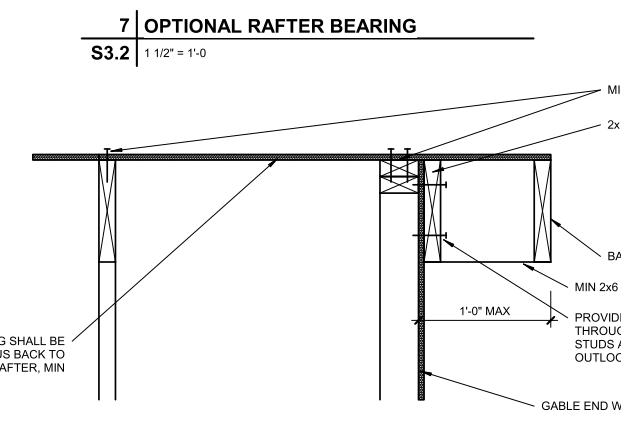

6 OPTIONAL OVERHANG 1'-0" OR LESS
S3.2 | 1/2" = 1'-0"

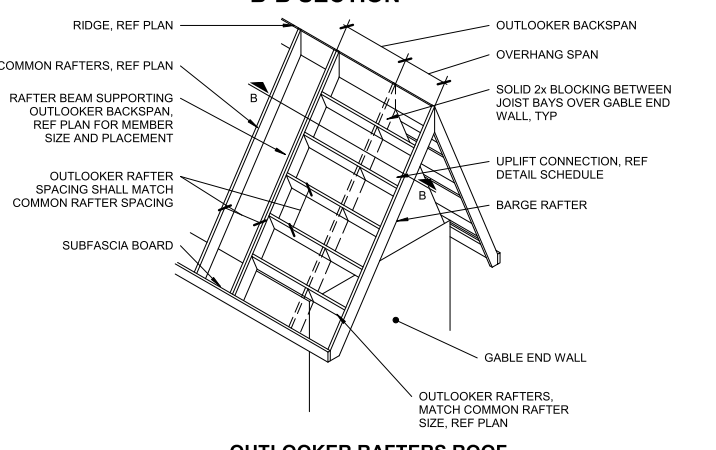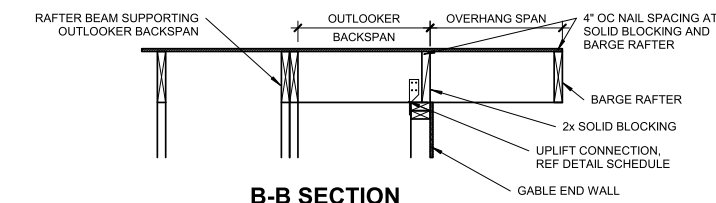


5 OUTLOOKER RAFTERS ROOF FRAMING
S3.2 | NOT TO SCALE

REQUIRED NUMBER OF SISTER PLIES


LIGHT ROOF						
# OF SISTER PLIES	2x VALLEY			LVL VALLEY		
	2x6	2x8	2x10	2x6	2x8	2x10
0	4'-8"	6'-2"	7'-11"	0	8'-8"	11'-5"
1	9'-5"	-	-	1	-	-
2	-	N/A	N/A	2	N/A	N/A

HEAVY ROOF						
# OF SISTER PLIES	2x VALLEY			LVL VALLEY		
	2x6	2x8	2x10	2x6	2x8	2x10
0	3'-6"	4'-7"	5'-11"	0	6'-6"	8'-7"
1	7'-1"	9'-3"	-	1	13'-1"	-
2	-	-	N/A	2	-	N/A


*VALLEYS OF A LENGTH GREATER THAN THAT FOUND IN THE CELL ABOVE ARE CONTROLLED BY BENDING. APPLY THE NUMBER OF SISTER PLIES CORRESPONDING TO THIS ROW.
1. THIS TABLE IS INTENDED TO BE USED IN CONJUNCTION WITH THE STAMPED ENGINEERED PLANS AS THEY ARE DRAWN BY APEX. BRACING LOCATIONS SHALL DETERMINE HORIZONTAL, UNSUPPORTED SPAN FROM VALLEY BEARING AND BE USED TO DETERMINE THE NUMBER OF SISTERS REQUIRED. BRACING LOCATIONS ARE NOT TO BE INFERRED USING THIS TABLE.
2. TABLE VALUES ARE BASED ON A DEPTH OF MEMBER REMAINING, d, EQUAL TO THE DEPTH OF THE RAFTERS. IF d IS OBSERVED TO BE LESS THAN THE DEPTH OF THE RAFTER, THE VALLEY WILL NEED TO BE EITHER REPLACED OR ANALYZED BY APEX.
3. TABLE VALUES ARE VALID FOR TAPERED CUTS ONLY. REF DETAIL 4/S3.2.
4. IF MULTIPLY VALLEY IS SPECIFIED ON PLAN TREAT EACH ADDITIONAL PLY AS A SISTER PLY WHEN LOOKING UP MAX SPAN.
5. MAX 14'-0" HORIZONTAL RAFTER SPAN IN BOTH DIRECTIONS FROM VALLEY.
6. ALL HIPS ARE DESIGNED TO BE CONTROLLED BY BENDING. SHEAR AT BEARING WITH MIN 5 1/2" DEPTH DOES NOT CONTROL DESIGN.

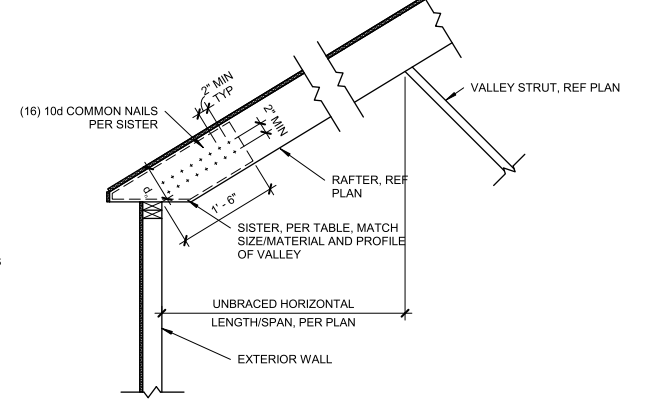


4 TAPERED VALLEY
S3.2 | 3/4" = 1'-0"

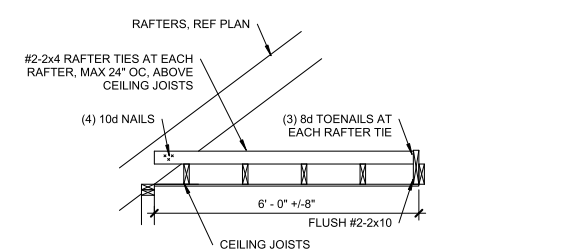


A-A SECTION

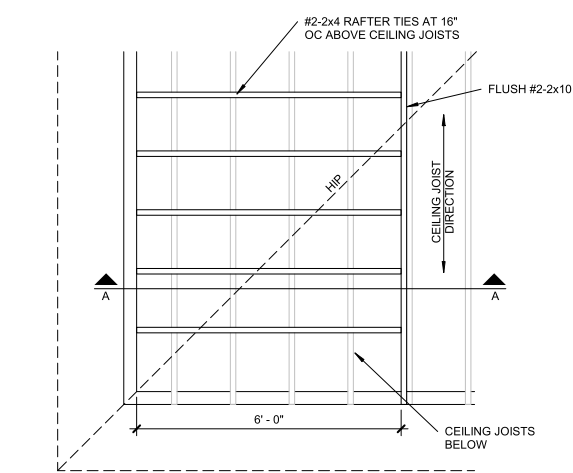

3 ROOF WITH PERP CEILING JOISTS
S3.2 | 1/2" = 1'-0"

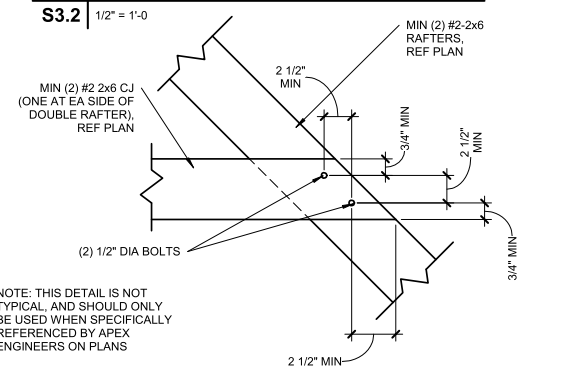

2 BOLTED RAFTER HIP CONNECTION
S3.2 | 1/2" = 1'-0"

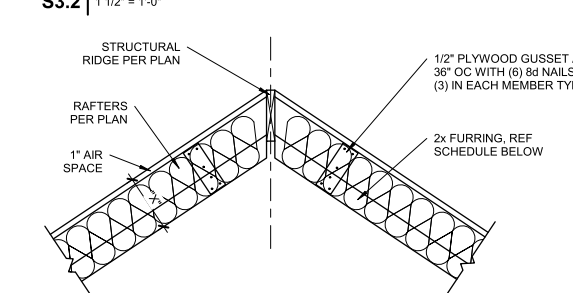



FURR OUT SCHEDULE

RAFTER SIZE	R-30C INSULATION (X=9 1/4")	R-38C INSULATION (X=11 1/4")
2x6	2x6	2x8
2x8	2x4	2x6
2x10	NOT REQUIRED	2x4
2x12	NOT REQUIRED	REQUIRED


NOTES:
1. ALL VAULTED RAFTERS SHALL BE #2-2x6 DF-L, MINIMUM, AT 16" OC, PER SPAN CHART, UNLESS NOTED OTHERWISE.
2. ALL VAULTS SHALL BE FURRED DOWN WITH 2x FRAMING TO THE REQUIRED DEPTH OF INSULATION, PLUS 1" AIR SPACE.
3. R-30C INSULATION = 8 1/4" THICK
4. R-38C INSULATION = 10 1/4" THICK
5. INSULATION REQUIREMENTS MAY BE REDUCED TO R30 IF ROOF/CEILING ASSEMBLY DOES NOT ALLOW SUFFICIENT SPACE BUT IS LIMITED TO VAULTED CEILING AREAS THAT ARE LESS THAN 500 SQUARE FEET OR 20 PERCENT OF THE TOTAL INSULATED CEILING AREA, WHICHEVER IS LESS. (PER N1102.2.2)

1 VAULTED RAFTER INSULATION FURR OUT
S3.2 | 3/4" = 1'-0"


RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
Development Solutions
LEE'S SUMMIT, MISSOURI

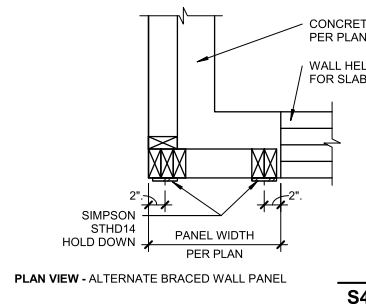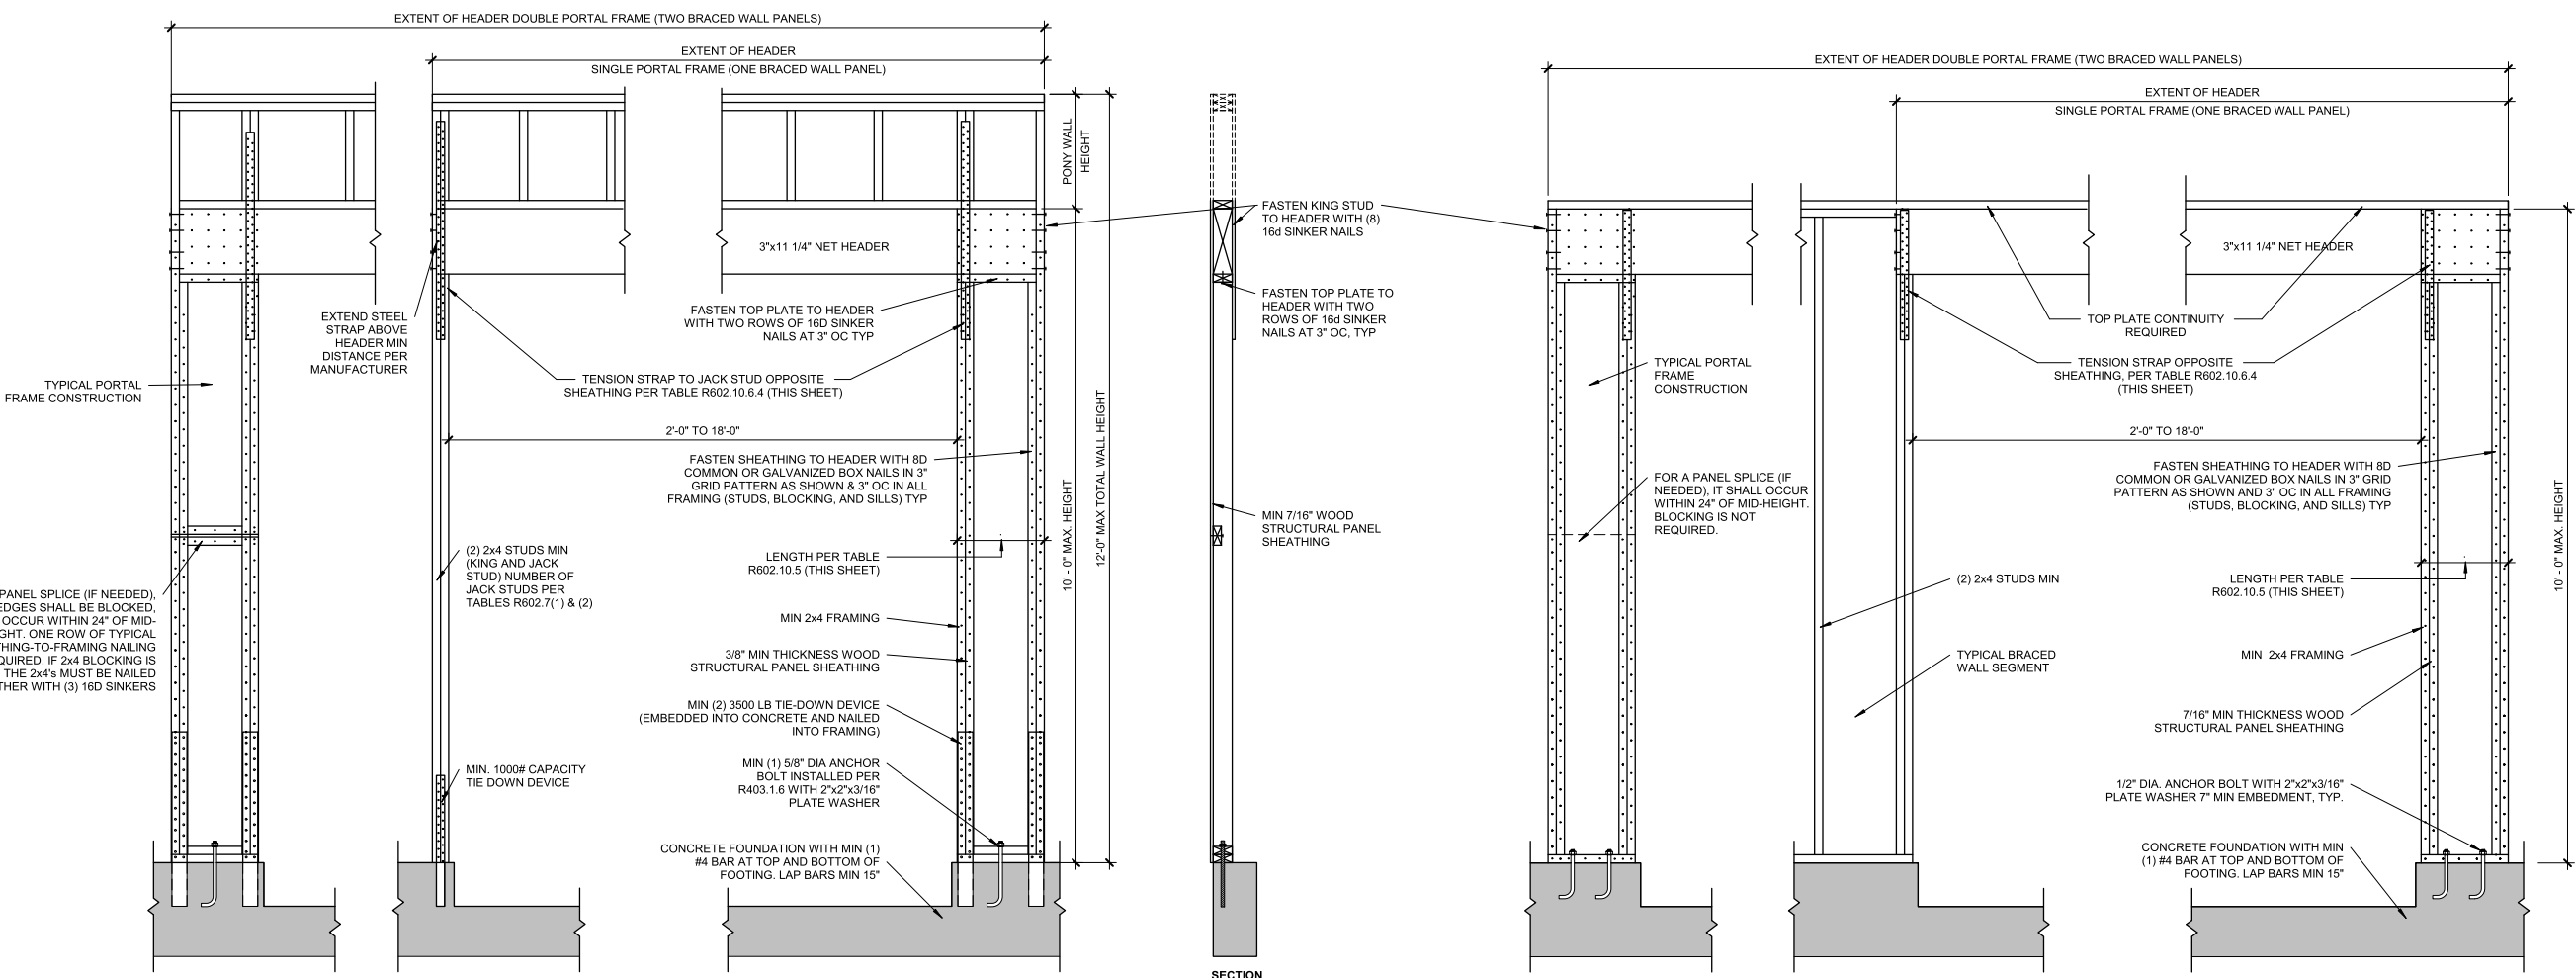

1 PORTAL FRAME WITH HOLD DOWNS (METHOD PFH)
S4.0 3/4" = 1'-0" (PER IRC R602.10.6.2)

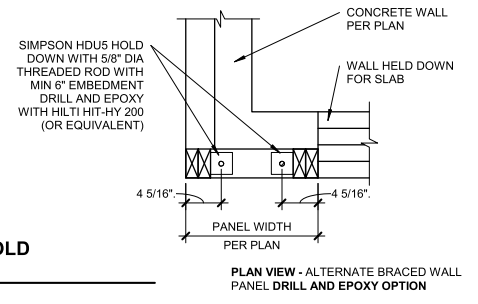

PLAN VIEW - ALTERNATE BRACED WALL PANEL DRILL AND EPOXY OPTION

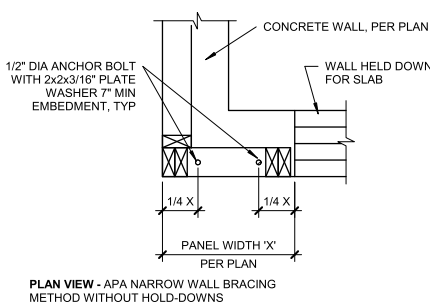

PLAN VIEW - APA NARROW WALL BRACING METHOD WITHOUT HOLD-DOWNS

1 PORTAL FRAME AT GARAGE DOOR WITHOUT HOLD DOWNS (METHOD PFG)
S4.0 3/4" = 1'-0" (ALT ALLOWED AT GARAGE DOOR ONLY) (PER IRC R602.10.6.3)
ALT

TABLE R602.10.5 (PARTIAL)

METHOD	MIN LENGTH (INCHES)			
	8 FEET	9 FEET	10 FEET	12 FEET
SUPPORTING ROOF ONLY	16	16	16	16
ONE STORY AND ROOF	24	24	24	24
PFG	24	27	30	30

NOTE: MAX HEADER HEIGHT IS 10'-0", BUT WALL HEIGHT SHALL BE PERMITTED TO BE INCREASED TO 12'-0" WITH PONY WALL

TABLE R602.10.6.4

MIN WALL STUD FRAMING NOMINAL SIZE AND GRADE	MAX PONY WALL HEIGHT (FEET)	MAX TOTAL WALL HEIGHT (FEET)	TENSION CAPACITY STRAP TABLE	
			MAX OPENING WIDTH (FEET)	TENSION STRAP CAPACITY REQ (LBS)
2x4 #2 GRADE	0	10	18	1,000
			9	1,000
	1	10	18	1,025
			18	1,275
	2	10	9	1,000
			18	2,175
			16	2,500
			9	1,500
2	12	16	3,375	
		18	3,975	
		9	2,750	
		16	3,775	
2x6 STUD GRADE	2	12	16	1,000
			18	2,150
	4	12	9	1,750
			16	2,400
		18	3,800	

BRACED WALL METHODOLOGY
CONTINUOUS EXTERIOR SHEATHING (CS-WSP) PER WSP METHOD (BELOW) UNLESS OTHERWISE NOTED ON THE PLAN


XXXX EXTERIOR BRACED WALLS:
WSP METHOD:
WOOD STRUCTURAL PANEL SHEATHING WITH A THICKNESS NOT LESS THAN 3/8" WITH MINIMUM SPAN RATING OF 24/0 FOR 16" OC STUD SPACING WITH 8d COMMON NAILS AT 6" OC EDGES AND 12" OC FIELD OR SHEATHING THICKNESS NOT LESS THAN 7/16" WITH MINIMUM SPAN RATING OF 24/16 FOR 24" OC SPACING WITH 8d COMMON NAILS AT 6" OC EDGES AND 12" OC IN FIELD.
(NOTE: FRAMING MEMBERS 16" OC MAX, UNBLOCKED, AND WITH SHEATHING APPLIED DIRECTLY TO FRAMING MEMBERS)

///// INTERIOR BRACED WALLS (REF 2/S4.0):
GB METHOD:
1/2" MIN GYPSUM BOARD OVER STUDS SPACED 24" MAX FASTENED WITH #6 - 1 1/4" TYPE 'W' OR 'S' DRYWALL SCREWS AT 7" OC EDGES AND FIELD (MIN. 4'-0" SECTION FOR BOTH SIDES.)
OR
LIB METHOD:
1x4 WOOD FASTENED WITH (3) 8d COMMON NAILS OR SIMPSON / USP 16 GA TYPE WB (OR EQUAL) STL X-BRACES AT 45° TO 60° ANGLES, MAXIMUM 16" OC STUD FASTENED PER MANUFACTURER'S SPECIFICATIONS

BRACED WALL PANEL SCHEDULE

WALL HEIGHT	MIN WALL LENGTH (X)	MAX WALL LENGTH (X)
8'-0"	4'-7"	8'-0"
9'-0"	5'-2"	9'-0"
10'-0"	5'-9"	10'-0"
11'-0"	NP	-
12'-0"	NP	-

NOTE: BRACED WALL PANEL LENGTHS BASED ON WALL HEIGHT FOR IRC, LIB

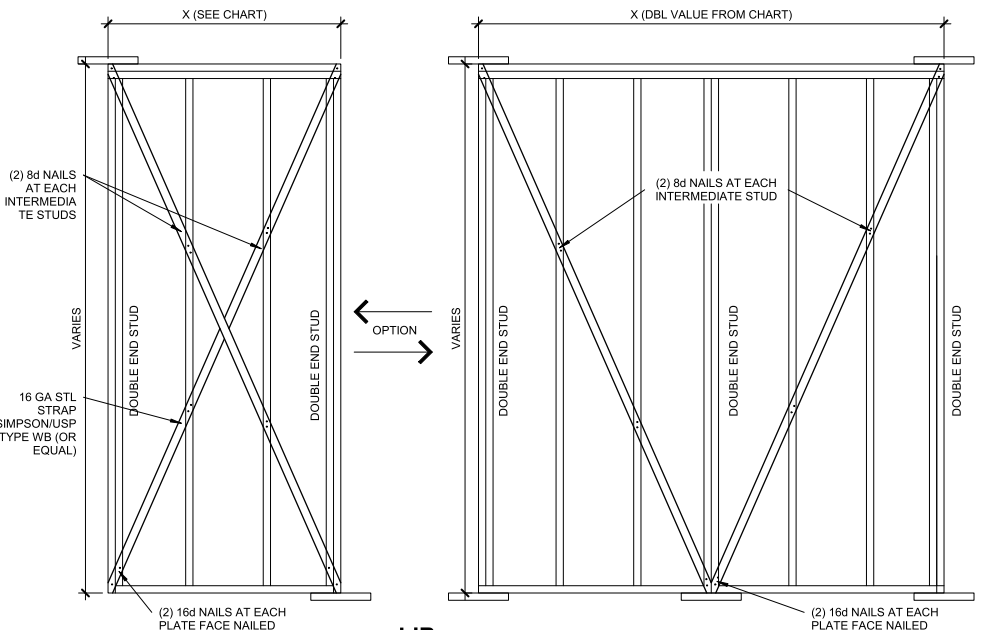


BRACED WALL PANEL-IRC 2 METHODS LIB AND GB


S4.0 3/4" = 1'-0"

RELEASE FOR CONSTRUCTION AS NOTED ON PLANS
Development Solutions
LEE'S SUMMIT, MISSOURI

DATE	REVISION

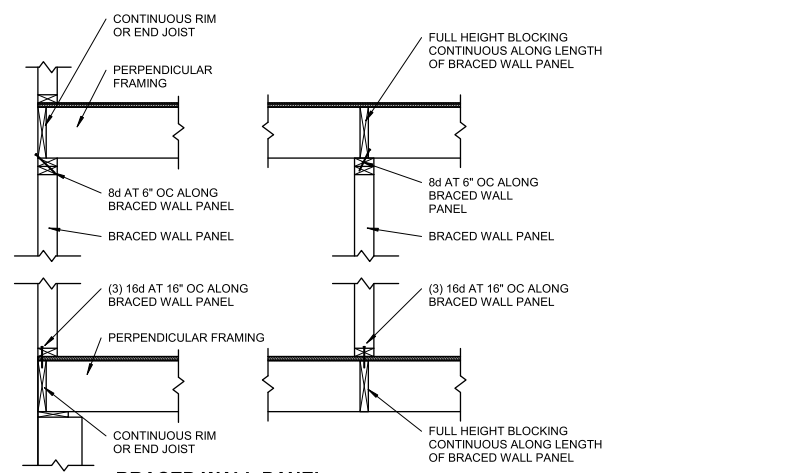


BRACED WALL PANEL CONNECTION WHEN PERPENDICULAR TO FLOOR/CEILING FRAMING
S4.1 3/4" = 1'-0"

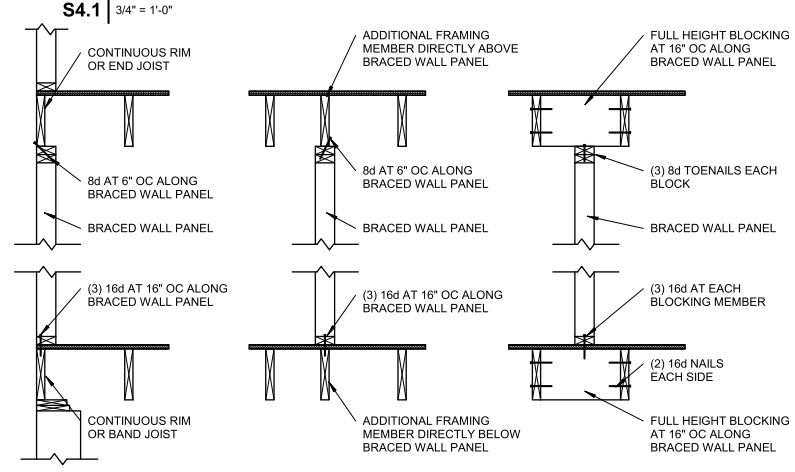


BRACED WALL PANEL CONNECTION WHEN PARALLEL TO FLOOR/CEILING FRAMING
S4.1 3/4" = 1'-0"


CONT. SHEATHED BRACED WALL END CONDITIONS

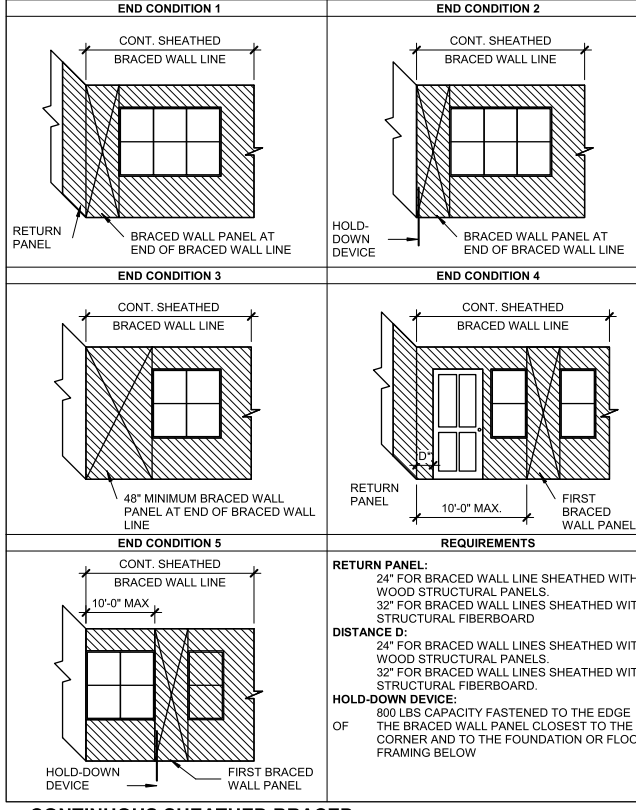


CONTINUOUS SHEATHED BRACED WALL END CONDITIONS
S4.1 NOT TO SCALE (COMPLIANCE WITH IRC R602.10.7)

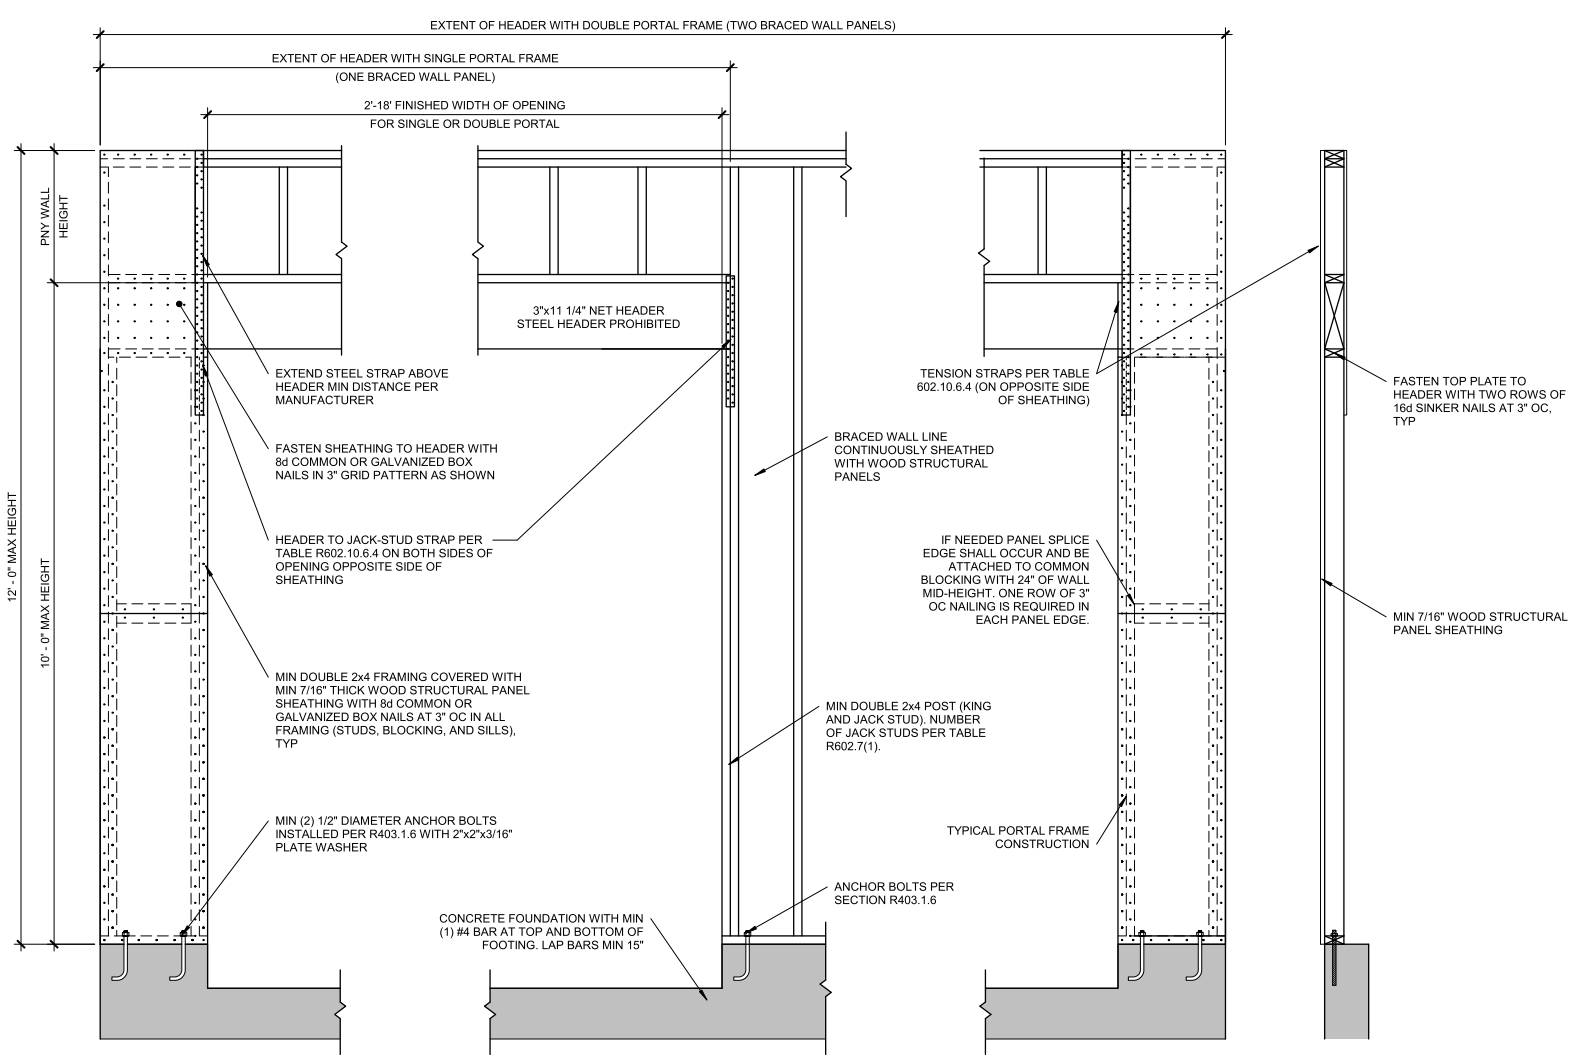

OVER CONCRETE OR MASONRY BLOCK FOUNDATION

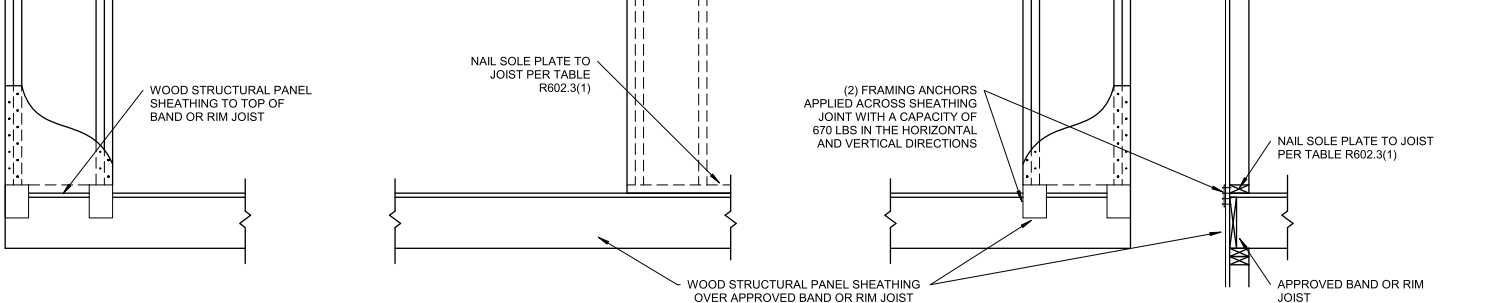

OVER RAISE WOOD FLOOR - FRAMING ANCHOR OPTION
(WHEN PORTAL SHEATHING DOES NOT LAP OVER BAND OR RIM JOIST)

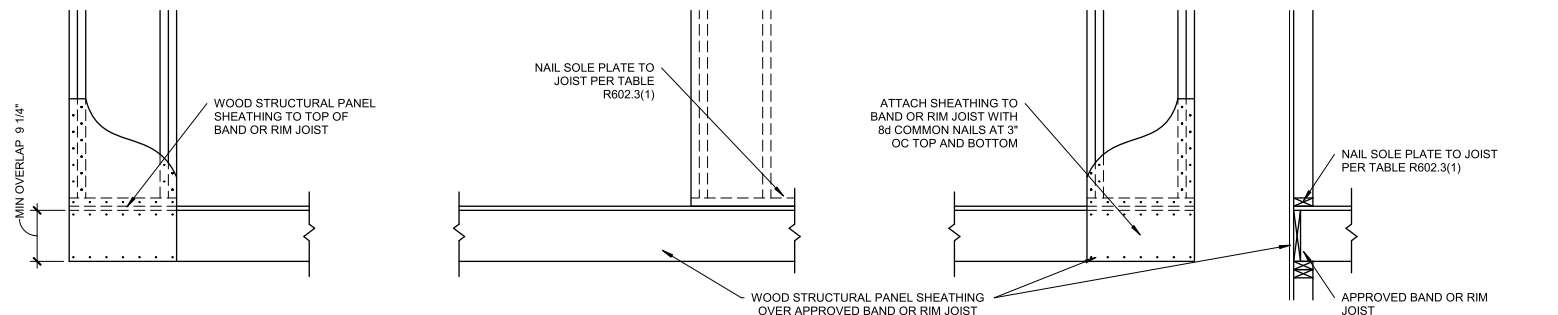

OVER RAISE WOOD FLOOR - OVERLAP OPTION
(WHEN PORTAL SHEATHING LAPS OVER BAND OR RIMBOARD)

BRACED WALL PANEL-IRC METHOD CS-PF CONTINUOUSLY SHEATHED PORTAL FRAME PANEL CONSTRUCTION
S4.1 3/4" = 1'-0" (PER IRC R602.10.6.4)