

1.

ALL WORK SHALL CONFORM TO 2018 INTERNATIONAL BUILDING CODE AS ADOPTED AND AMENDED BY THE CITY OF LEES SUMMIT, MISSOURI.
2.

DESIGN LOADS

A.

ROOF LOAD (18 PSF NET UPLIFT)

1.

DEAD LOAD

20 PSF

2.

SNOW LOAD

20 PSF

B.

WIND LOADS

1.

BASIC WIND SPEED (3 SECOND GUST)

115 MPH

2.

WIND IMPORTANCE FACTOR, I

1.0

3.

BUILDING CATEGORY

II

4.

WIND EXPOSURE

B

5.

COMPONENTS AND CLADDING DESIGN VALUE (U.N.O.)

25 PSF

C.

SEISMIC LOADS

1.

CATEGORY

II

2.

S_s=

0.128

3.

S_i=

0.06

4.

SEISMIC IMPORTANCE FACTOR, I

1.0

5.

SITE CLASS

D

6.

SEISMIC DESIGN CATEGORY

B

7.

DESIGN BASE SHEAR

0.05

3.

CONCRETE

A.

CAST-IN-PLACE CONCRETE CONSTRUCTION SHALL CONFORM TO LATEST APPLICABLE AMERICAN CONCRETE INSTITUTE DOCUMENTS, ACI-301, 305, 306, 315, 318, AND 347 UNLESS NOTED OTHERWISE IN THESE CONTRACT DOCUMENTS.

B.

ALL CONCRETE, UNLESS NOTED OTHERWISE, SHALL DEVELOP A 28 DAY COMPRESSIVE STRENGTH AND HAVE MAXIMUM WATER/CEMENT RATIOS AS FOLLOWS:

1.

FOOTINGS, GRADE BEAMS, WALLS, BEAMS, COLUMNS:

4000 PSI (w/c MAX 0.45)

2.

SLAB ON GRADE:

4000 PSI (w/c MAX 0.42)

C.

IT IS THE INTENT OF THESE CONCRETE NOTES THAT THE CONTRACTOR SUPPLY CONCRETE MIXES WITH A MINIMUM AMOUNT OF WATER IN ORDER TO LIMIT PLASTIC SHRINKAGE CRACKING IN FRESHLY PLACED CONCRETE. IT IS EXPECTED THAT PRODUCING WORKABILITY FOR CONCRETE MIXES WILL REQUIRE THE ADDITION OF WATER-REDUCING CHEMICAL ADMIXTURES.

D.

CONCRETE MIX DESIGNS SHALL INCLUDE ALL APPLICABLE ADMIXTURES.

E.

CONCRETE SLUMP SHALL BE A MAXIMUM OF 4" +/- 1" (ASTM C-145) AS DELIVERED IN THE FIELD. CONTRACTOR MAY USE CHEMICAL ADMIXTURES TO ATTAIN A MAXIMUM SLUMP OF 8" FOR WORKABILITY IF ADMIXTURE IS TO BE ADDED IN THE FIELD IS SHALL BE ADDED THROUGH THE USE OF AN EXTERNAL MEASURING DEVICE (I.E. 5 GALLON BUCKET).

F.

CONCRETE EXPOSED TO WEATHER, PARKED VEHICLES, AND/OR DEICING CHEMICAL SHALL CONTAIN 6% (+/- 1%) ENTRAINED AIR BY VOLUME.

G.

CHAMFER ALL EXPOSED CORNERS OF CONCRETE WALLS, 3/4" UNLESS NOTED OTHERWISE.

H.

ALL CONTROL JOINTS IN CONCRETE SLABS-ON-GRADE SHALL BE CUT TO 1/3 OF DEPTH WHEN USING WET-CUTTING PROCESS AND 1/4 OF DEPTH WHEN USING EARLY-ENTRY DRY-CUT PROCESS. CUT JOINTS AS SOON AS APPLICABLE PER PROCESS USED AFTER CONCRETE HAS BEEN PLACED WITHOUT DISLODGING AGGREGATE, OR USE A KEYED COLD JOINT.

I.

CUT SLABS-ON-GRADE INTO AREAS OF APPROXIMATELY 225 SQUARE FEET MAINTAINING AS CLOSE TO SQUARE AREAS AS POSSIBLE. LENGTH TO WIDTH RATIOS OF JOINTED PANELS SHALL NOT EXCEED 1.5:1. COORDINATE LOCATIONS OF CONTROL JOINTS WITH ARCHITECT.

J.

CONTROL JOINTS IN WALLS SHALL BE PLACED AT 20'-0" O.C. MAXIMUM UNLESS NOTED OTHERWISE. LOCATE JOINTS BESIDE PIERS INTEGRAL WITH WALLS, NEAR CORNERS, AND IN CONCEALED LOCATIONS WHERE POSSIBLE. CONSTRUCTION JOINTS MAY BE PLACED IN LIEU OF CONTROL JOINTS AT CONTRACTOR'S DISCRETION. COORDINATE LOCATION OF CONTROL JOINTS WITH ARCHITECT.

K.

PRIOR TO PLACING CONCRETE IN ANY LOCATION, IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO HAVE THOROUGHLY CHECKED AND COORDINATED ALL DIMENSIONS, ELEVATIONS, OPENINGS, RECESS, AND BLOCKOUTS AS SHOWN ON ANY CONTRACT DRAWINGS. IN THE EVENT ERRORS, CONFLICTS, OR OMISSIONS EXIST, IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO CONTACT THE ARCHITECT OR ENGINEER FOR NECESSARY CORRECTIVE ACTION.

L.

EMBEDDED ITEMS ARE TO BE FURNISHED AND INSTALLED BY THE CONTRACTOR PRIOR TO PLACING CONCRETE.

M.

ANCHOR RODS AND ANCHOR BOLTS SHALL BE HELD IN PLACE WITH A RIGID TEMPLATE

4.

ROUGH CARPENTRY

A.

HEADERS, JOISTS, AND RAFTERS SHALL MEET OR EXCEED THE FOLLOWING MINIMUM REQUIREMENTS. (EXAMPLE SPECIES: #2 WESTERN RED CEDAR)

1.

F_B

700 PSI

2.

F_V

155 PSI

3.

F_C

650 PSI

4.

E

1000 KSI

B.

TIMBER FRAMING MEMBERS SHALL MEET OR EXCEED THE FOLLOWING MINIMUM REQUIREMENTS. (EXAMPLE SPECIES: #2 DOUGLAS FIR-LARCH NORTH)

1.

F_B

700 PSI

2.

F_V

155 PSI

3.

F_C

650 PSI

4.

E

1000 KSI

C.

ALL WOOD FRAMING MEMBERS INDICATED ARE NOMINAL SIZES. PROVIDE ACTUAL DRESSED SIZES, KILN-DRIED, WITH MAXIMUM IN-PLACE MOISTURE CONTENT OF 19%.

D.

ALL BOLTS ARE A36 OR A307, GRAD 1, AND ALL NAILS ARE COMMON WIRE NAILS UNLESS NOTED OTHERWISE.

E.

FASTENER QUALITY, QUANTITY, SIZE, AND SPACING SHALL COMPLY WITH IBC FASTENING SCHEDULE (TABLE 2304.9) UNLESS NOTED OTHERWISE.

F.

ALL WOOD IN CONTACT WITH CONCRETE OR EXPOSED TO WEATHER SHALL BE PRESERVATIVE TREATED.

A circular professional engineer seal for the State of Missouri. The outer ring contains the text "STATE OF MISSOURI" at the top and "PROFESSIONAL ENGINEER" at the bottom. Inside the ring, the name "AMANDA RENEE BUSH" is printed. Below the name, the word "NUMBER" is printed, followed by the license number "PE-2008019529". A handwritten signature "Amanda R Bush" in blue ink is written across the seal. At the bottom, the date "06-21-2021" is handwritten in blue ink.

AMERICAN FIRE BBQ - PERGOLA

342 SW BLUE PKWY, LEE'S SUMMIT, MO 64063

COLLINS & WEBB ARCHITECTS

SCALE

12" = 1'-0"

DATE

06/21/21

DRAWN BY


ACO

REF. DWG.

S100

SHEET No.

S100

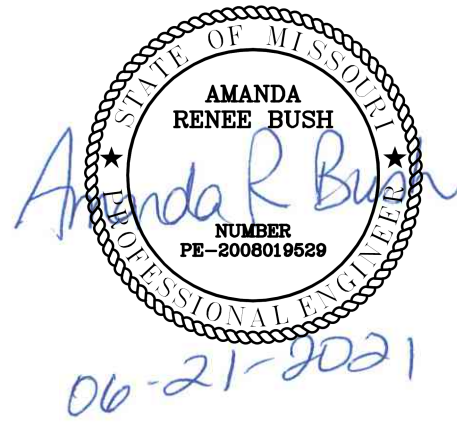

AMERICAN FIRE BBQ - PERGOLA

342 SW BLUE PKWY, LEE'S SUMMIT, MO 64063

COLLINS & WEBB ARCHITECTS

SCALE
As indicated


DATE
06/21/21

DRAWN BY
ACO


REF. DWG.
S101

SHEET No.


S101

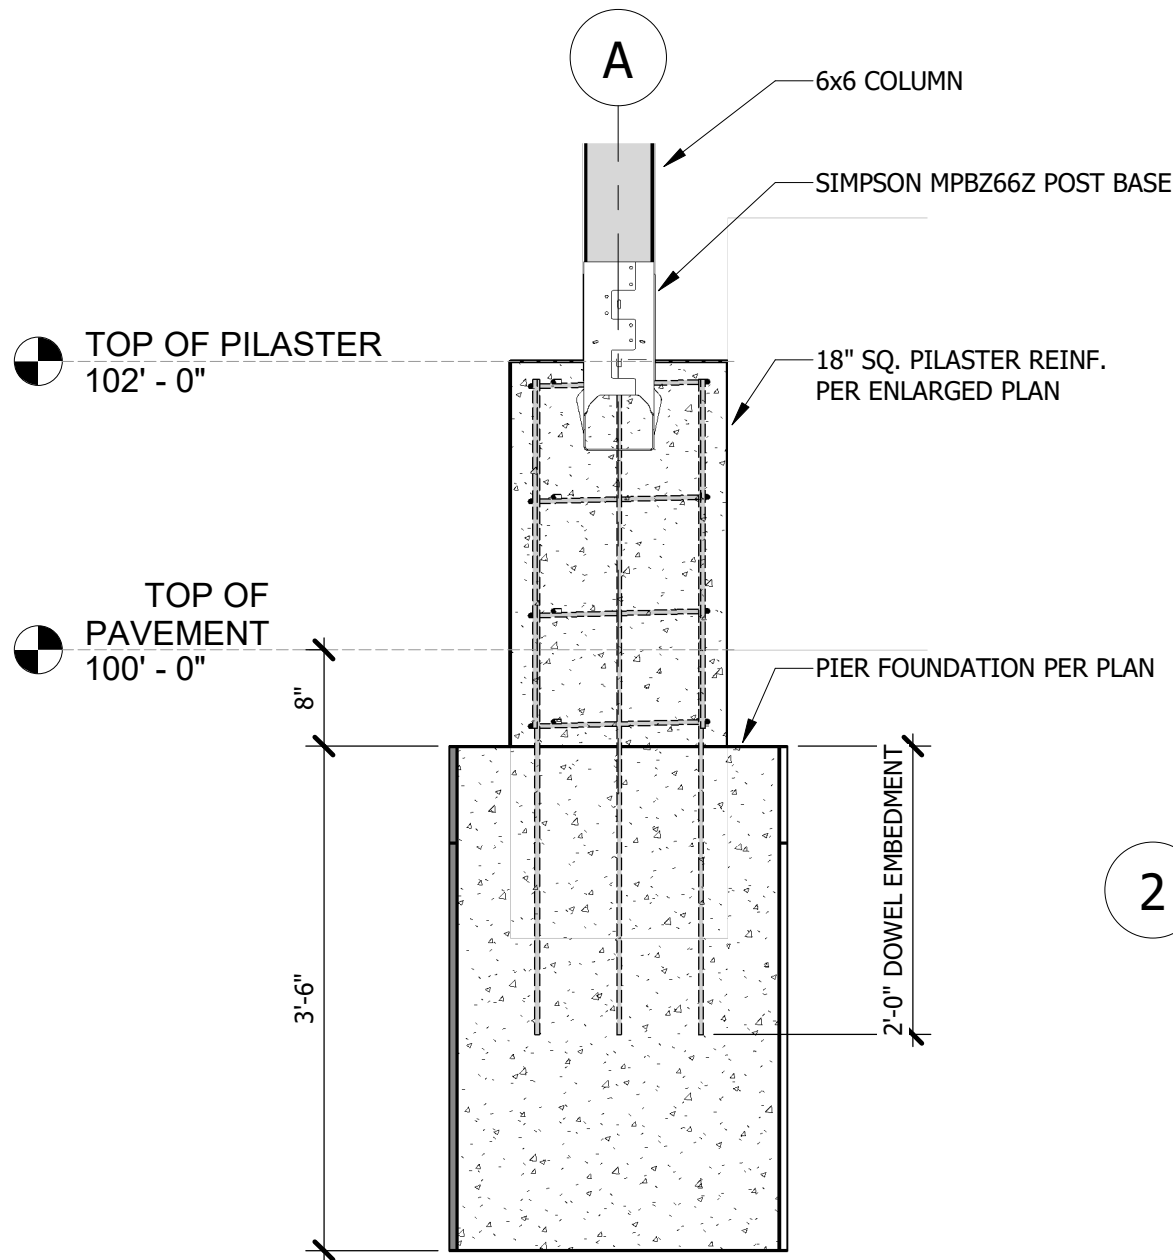

3 FOUNDATION SECTION
3/4" = 1'-0"

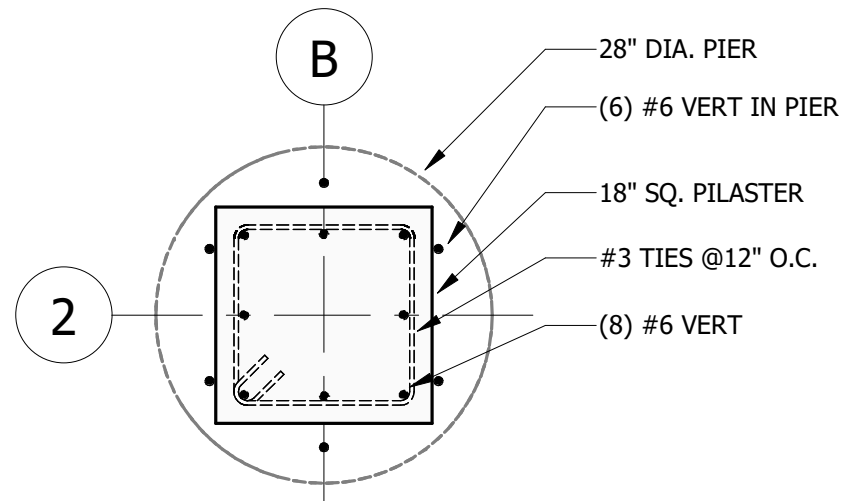

2 PERGOLA COLUMN BASE
3/4" = 1'-0"

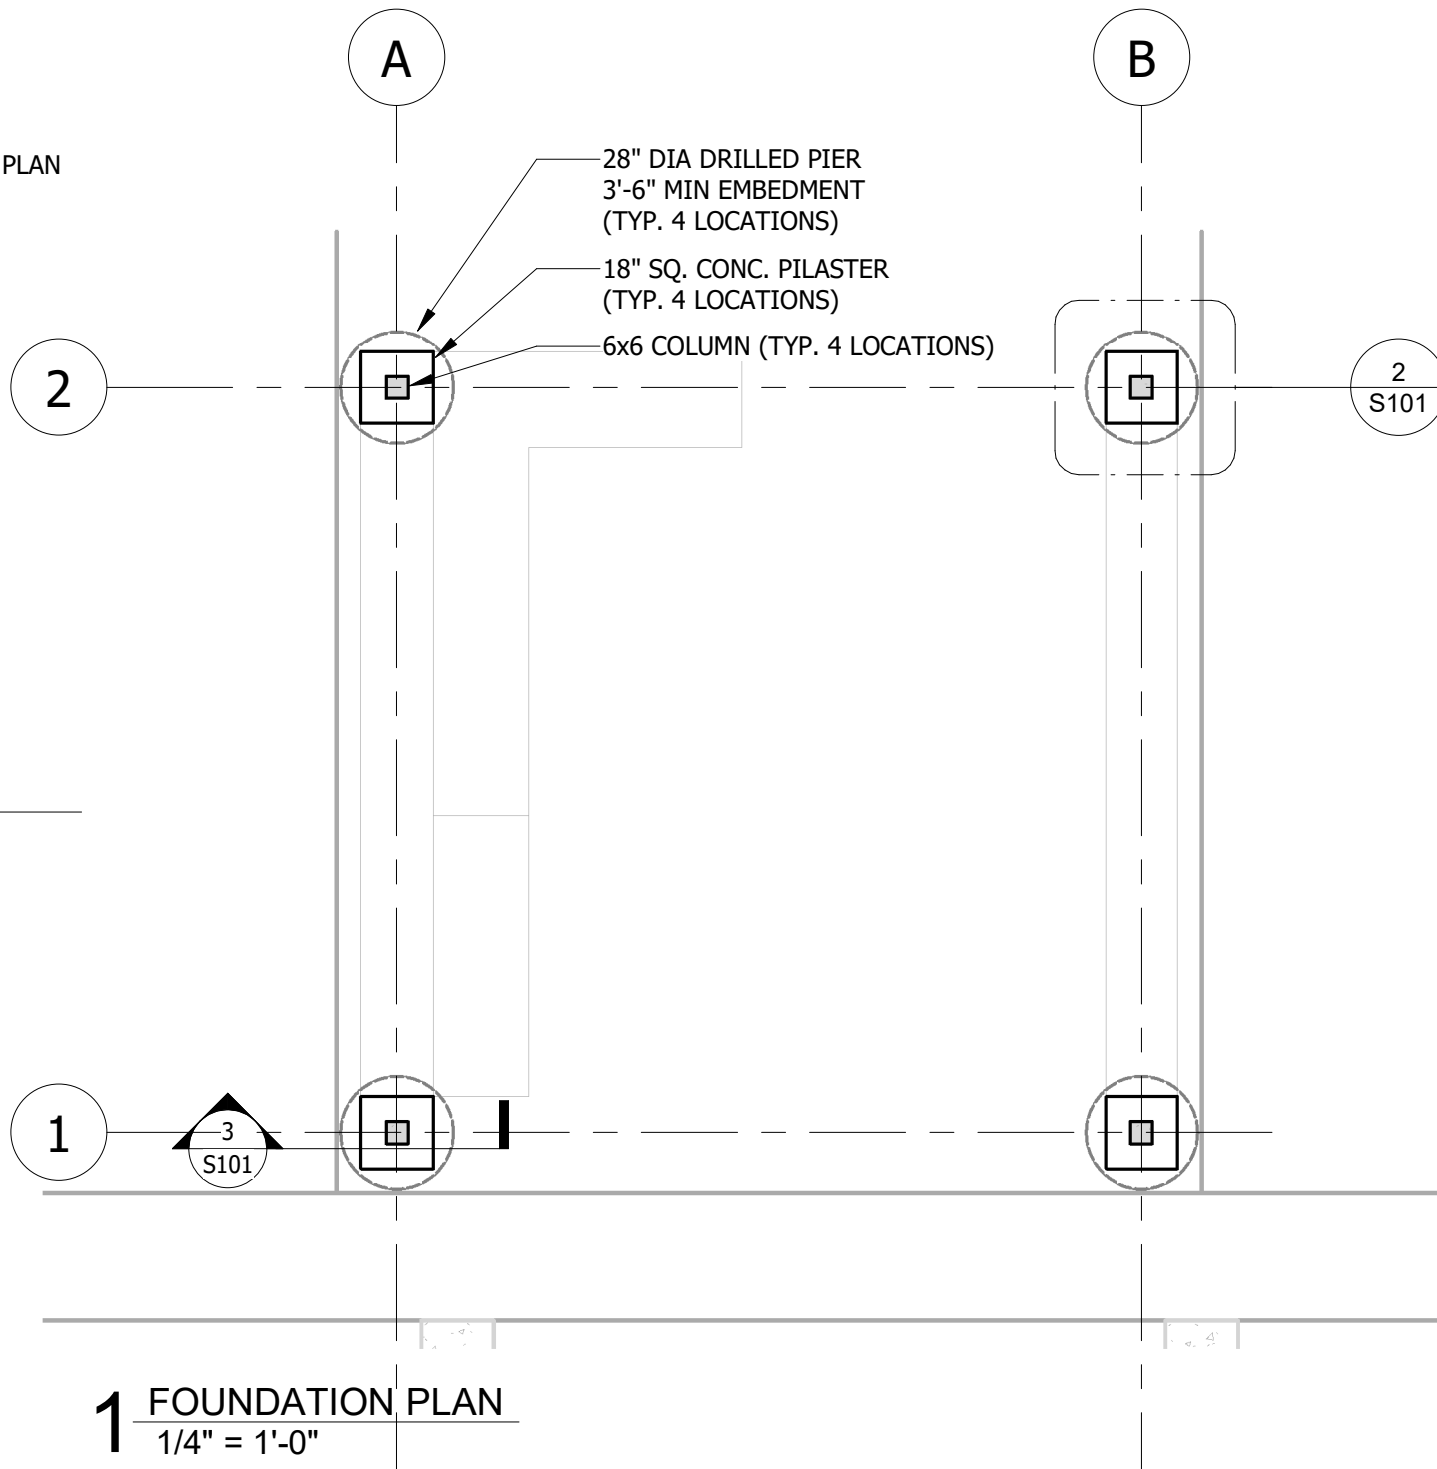


1 FOUNDATION PLAN
1/4" = 1'-0"


STATE OF MISSOURI
AMANDA
RENEE BUSH
PROFESSIONAL ENGINEER
NUMBER
PE-2008019529
06-21-2021

AMERICAN FIRE BBQ - PERGOLA
342 SW BLUE PKWY, LEE'S SUMMIT, MO 64063
COLLINS & WEBB ARCHITECTS

SCALE	As indicated
DATE	06/21/21
DRAWN BY	ACO
REF. DWG.	S102
SHEET No.	S102

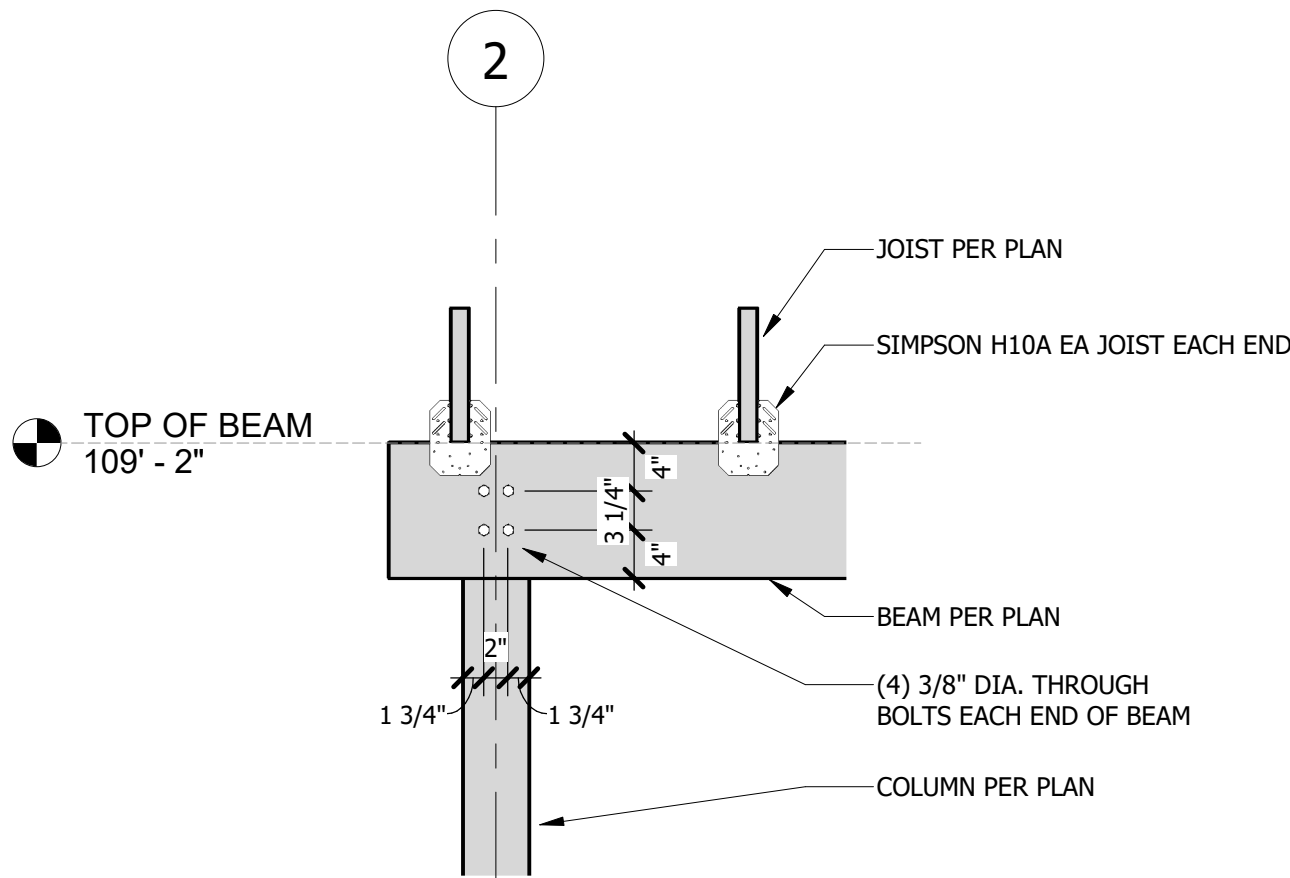

2 ROOF FRAMING SECTION
3/4" = 1'-0"

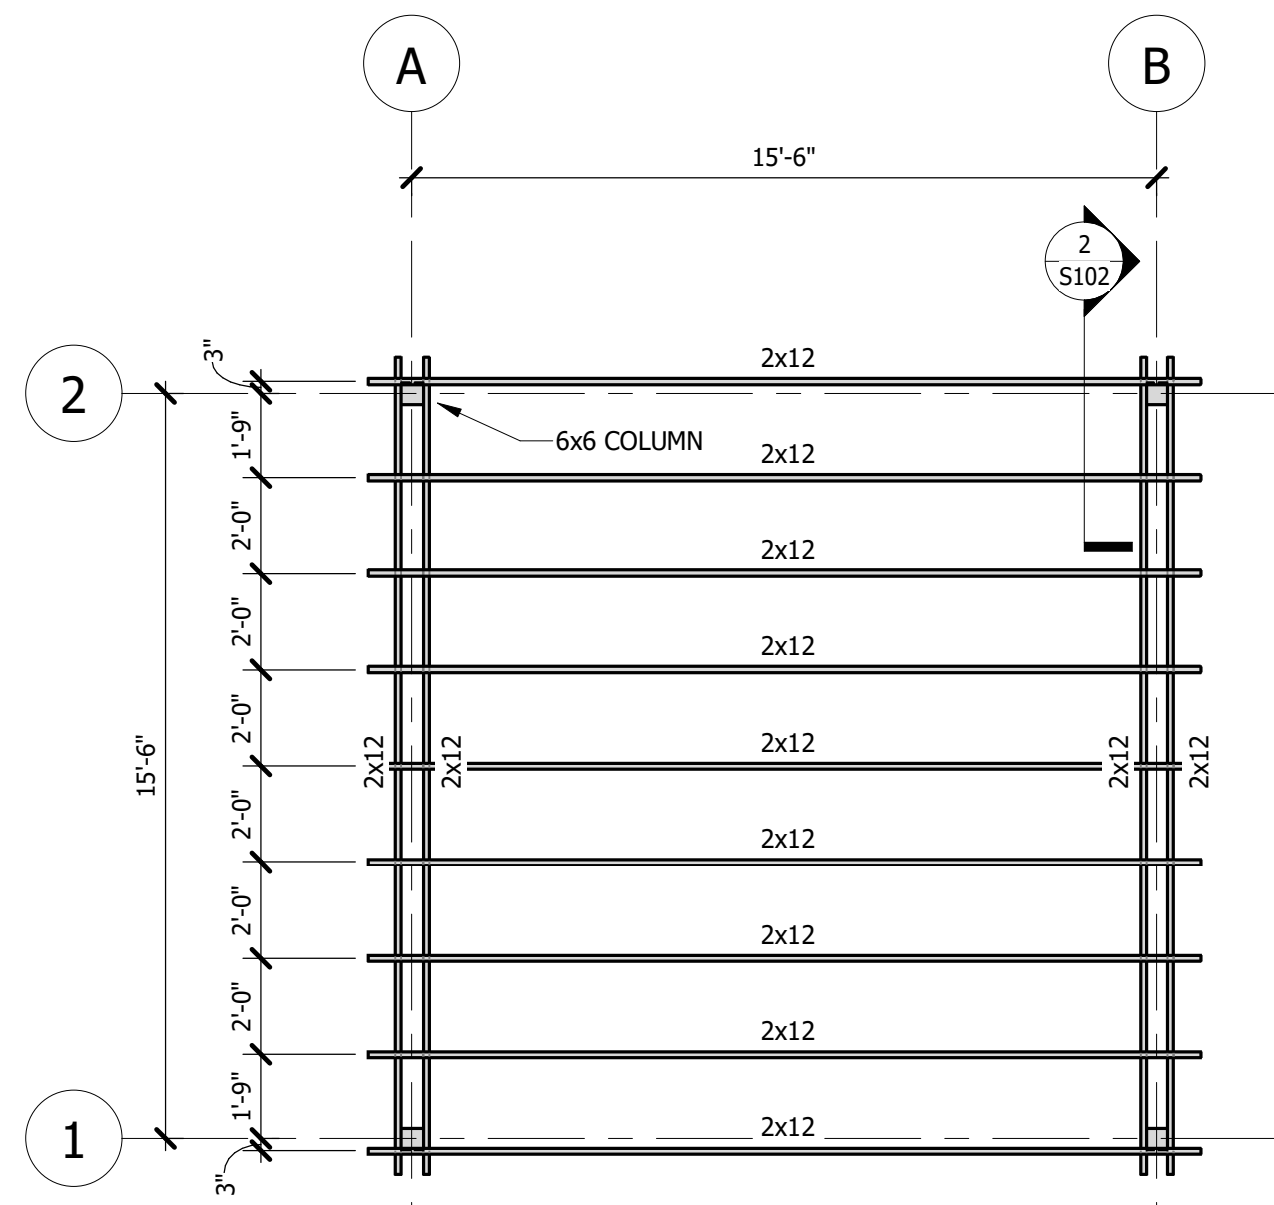

1 ROOF FRAMING PLAN
1/4" = 1'-0"