


- ELEVATION NOTES
1. FINAL GRADE LINE MAY VARY PER EXISTING SITE CONDITIONS. REFER TO PLOT PLAN FOR SPECIFIC SITE GRADE CONDITIONS.
 2. ALL ROOFING TO BE ASPHALT COMPOSITION UNLESS NOTED OTHERWISE.
 3. ROOF AND SOFFIT VENTS PER LOCAL CODES. WHERE POSSIBLE, PROVIDE ROOF VENTING ON BACK SIDE OF ROOF.
 4. GUTTER AND DOWNSPOUT LOCATIONS TO BE DETERMINED BY GUTTER INSTALLER.
 5. SMART PANEL SIDING ON SIDE AND REAR ELEVATIONS UNLESS NOTED OTHERWISE.




Front Elevation 1
1/4" = 1'-0"

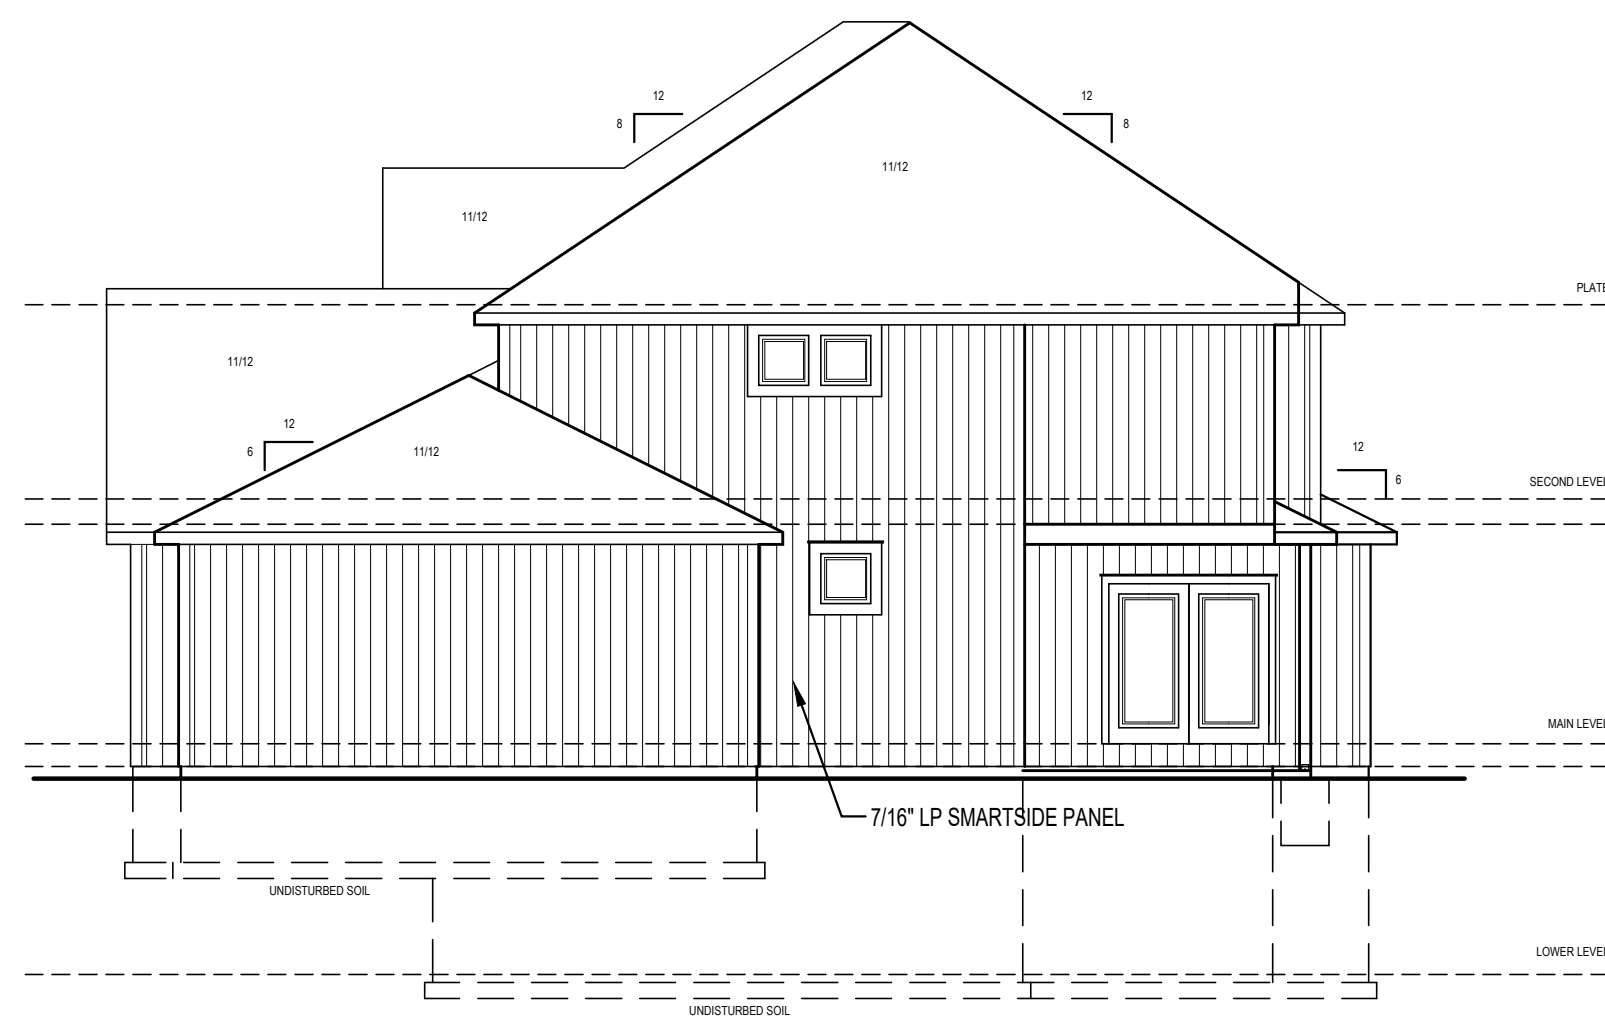

Side Right Elevation 2
1/8" = 1'-0"



Rear Elevation 3
1/8" = 1'-0"

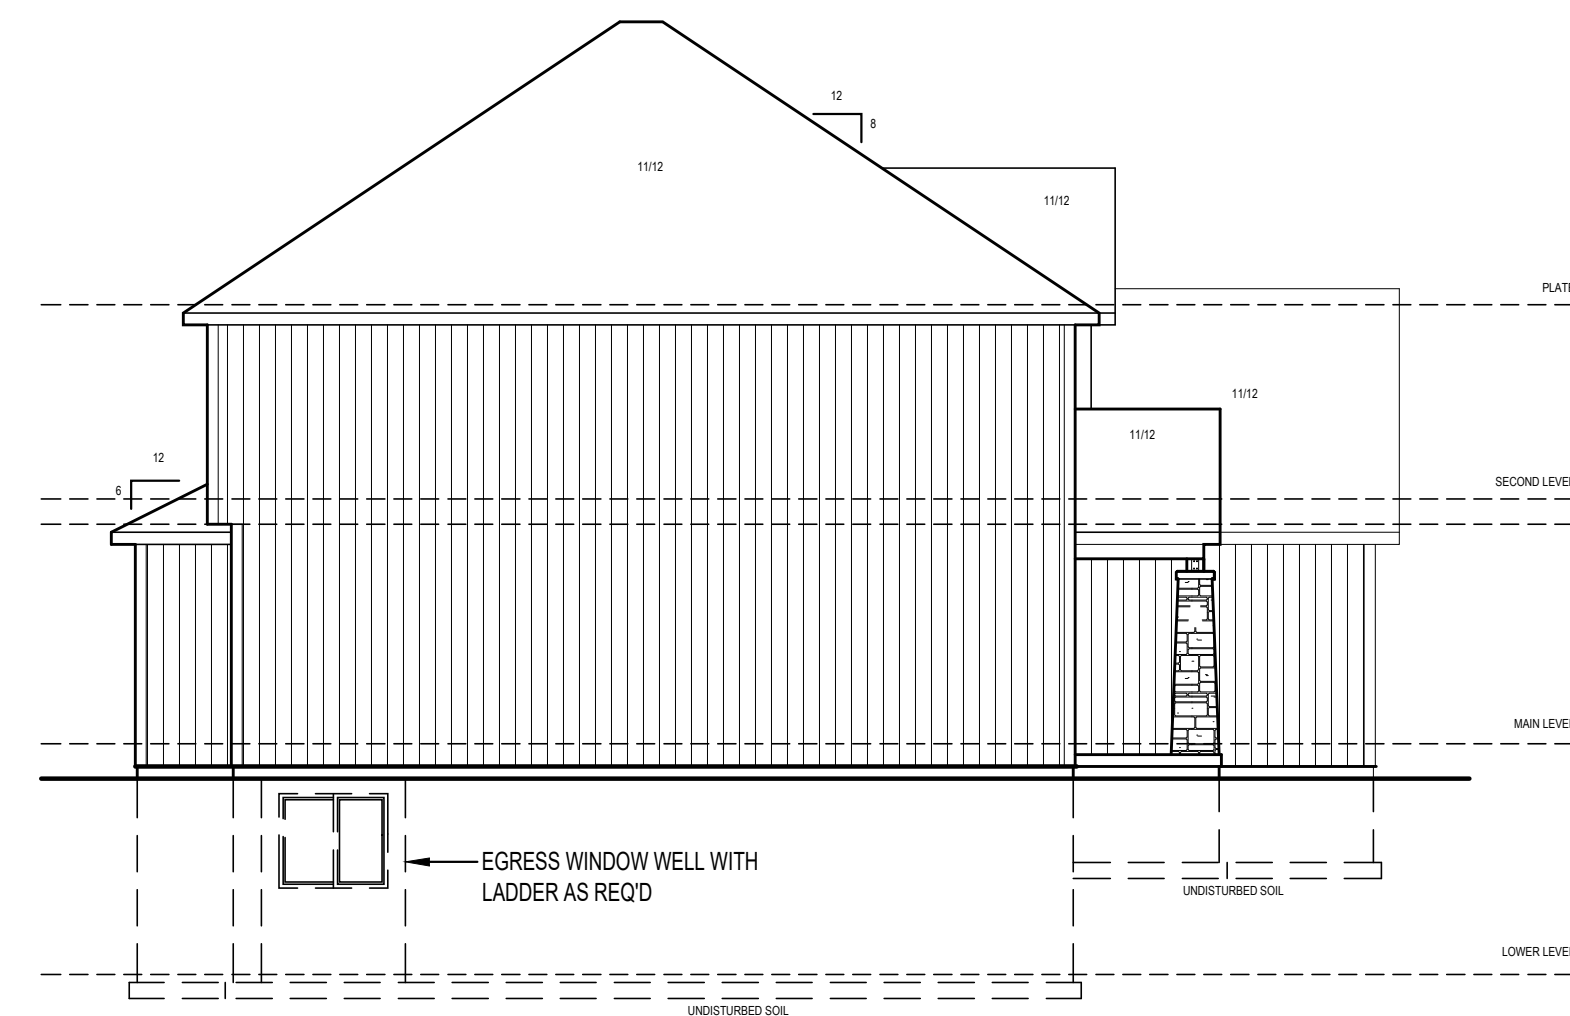

Side Left Elevation 4
1/8" = 1'-0"

RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
Development Services
LEE'S SUMMIT, MISSOURI




© COPYRIGHT 2021

JFE CONSTRUCTION INC.
1314 SW Market Street
Lee's Summit, MO 64081
v: 816.786.4008
jfeconstruction.com



Van Deurzen and Associates, P.A. © 2021

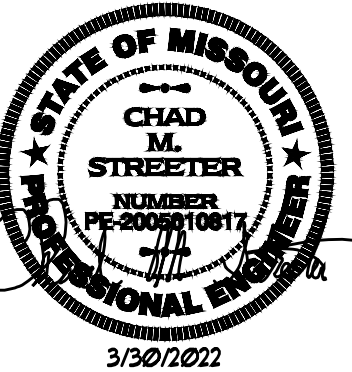

THE SLIVERTON III

Spec Residence
2027 SW Farmfield Court, Lee's Summit, MO
Lot 10 - Hook Farms 1st Plat

Project #: 8083-XXXX

DATE:

For Permit: 3/30/2022

Exterior
Elevations

A100

GENERAL NOTES

- BUILDING PERMIT WILL BE REQUIRED FOR THE PROJECT. THIS SET OF DOCUMENTS TO BE SUBMITTED AS A PERMIT SET OF DRAWINGS.
- ALL CONTRACTORS SHALL VISIT THE JOB SITE AND SHALL REVIEW THE PERMIT DRAWINGS TO FAMILIARIZE HIMSELF WITH THE REQUIREMENTS AND INTENT OF THE SCOPE OF WORK. ANY DEFICIENCIES OR DISCREPANCIES DISCOVERED SHALL BE REPORTED FOR REVIEW AND CLARIFICATION PRIOR TO COMMENCING ANY WORK.
- ALL NEW CONSTRUCTION SHALL MEET LATEST EDITIONS OF ALL APPLICABLE NATIONAL, STATE, AND LOCAL BUILDING CODES - INTERNATIONAL RESIDENTIAL CODE.
- WORKMANSHIP SHALL BE OF THE HIGHEST QUALITY. QUALITY MATERIALS SHALL BE USED THROUGHOUT. ALL WORK SHALL BE DONE IN A MANNER SO AS TO MATCH ADJACENT WORK AND FINISHES AND APPROVED BY OWNER.
- CONTRACTORS SHALL REMOVE ALL CONSTRUCTION DEBRIS. ALL CONSTRUCTION DEBRIS SHALL BE CONTAINED PER CITY REQUIREMENTS. AREAS FOR MATERIAL STORAGE, TRASH DISPOSAL, WORKMEN'S PARKING, ETC., SHALL BE COORDINATED WITH THE CITY.
- ALL DIMENSIONS TO BE VERIFIED BY CONTRACTOR.
- IT IS THE RESPONSIBILITY OF THE CONTRACTORS TO COORDINATE WITH THE OWNER THE QUANTITY AND LOCATION FOR ALL LIGHTING, ELECTRICAL OUTLETS, TELEPHONE OUTLETS, AND MECHANICAL AND PLUMBING SYSTEMS AS REQUIRED.
- THE CONTRACTORS SHALL ADHERE TO THE STATE OF KANSAS ONE CALL SYSTEM, 1-800-344-7233 (MISSOURI ONE CALL SYSTEM, 1-800-344-7483). THE PERSON OR FIRM DOING EXCAVATION ON PUBLIC RIGHT OF WAY MUST GIVE NOTICE TO, AND OBTAIN INFORMATION FROM, UTILITY COMPANIES. THE CONTRACTORS SHALL NOTIFY THOSE COMPANIES WHICH HAVE FACILITIES IN THE NEAR VICINITY OF THE CONSTRUCTION TO BE PERFORMED WHEN WORK COMMENCES.

GENERAL FOUNDATION REQUIREMENTS

- ALL FOOTINGS ARE TO BE EXTENDED TO MIN 30" BELOW FINISHED GRADE.
- ALL INTERIOR FOOTINGS FOR LOAD BEARING WALLS AND COLUMNS SHALL BE ISOLATED FROM THE BASEMENT FLOOR SLAB.
- FOR ALL CONC WALL OPENINGS, FOOTING & WALL STEPS, PROVIDE ONE #4 BAR, 48" LONG DIAGONALLY AS CLOSE AS PRACTICAL TO CORNER.
- ALL REINFORCEMENT SHALL BE LAPPED A MIN OF 24" AT ENDS SPICES AND AROUND CORNERS.
- ANCHOR BOLTS ARE TO BE SPACED @ 36" WITH 7" MIN EMBED. A BOLT SHALL BE PLACED WITHIN 12" OF THE END OF EACH PLATE SECTION.
- FASTEN JOISTS TO SILL PLATES WITH (3) #6 COM NAILS.
- WHERE JOIST IS PARALLEL TO FOUNDATION, PROVIDE SOLID BLOCKING @ 32" c FOR (3) IST SPACES. FASTEN TO SILL PLATE PER NOTE 8.
- VAPOR BARRIER, 6 MIL PE VAPOR RETARDER WITH JOINTS LAPPED A MIN OF 8" BETWEEN SLAB & BASE.
- DAMP PROOFING: ONE COAT (MIN) OF DAMP PROOFING OR EQUIVALENT FOUNDATION MEMBRANE SHALL BE APPLIED TO EXTERIOR WALL SURFACES BELOW GRADE. SEAL THE HOLES, VOIDS BEFORE APPLICATION.
- FOUNDATION DRAIN: INSTALL CONT'G 4" PERFORATED PVC DRAIN TILE DRAIN TILE TO BE EXTENDED TO SQUARE SUMP PIT WHICH EXTENDS A MIN 24" BELOW BASEMENT FLOOR.
- ALL FRAMING MEMBERS IN CONTACT WITH CONCRETE SHALL BE ACQ TREATED LUMBER.
- ALL STEEL FASTENERS (INCLUDING FOUND. ANCHOR BOLTS) ON ACQ TO BE (DOUBLE HOT-DIPPED) GALVANIZED.
- PROVIDE A "UPPER" GROUND PER IRC 3608.1.
- EGRESS WELL REQUIREMENTS:
 - IF THE VERTICAL DISTANCE FROM THE WINDOW SILL TO ADJACENT GRADE IS GREATER THAN 44", PROVIDE A LADDER.
 - ADD DRAIN TO DAYLIGHT OR SUMP PUMP.

COLUMN & PIER PAD SCHEDULE			
COLUMN MARK	PAD SIZE	REINFORCEMENT	COLUMN SIZE
A	36"x36"x12"	(6) #4 BAR E.W.	3'0" SCHED 40
B	42"x42"x14"	(7) #4 BAR E.W.	3'0" SCHED 40
C	48"x48"x16"	(8) #4 BAR E.W.	3'0" SCHED 40
D	54"x54"x16"	(9) #4 BAR E.W.	3 1/2'0" SCHED 40
E	60"x60"x18"	(10) #4 BAR E.W.	3 1/2'0" SCHED 40

- COLUMN & PIER PAD SIZES SHOWN ARE BASED ON AN ASSUMED MINIMUM ALLOWABLE SOIL BEARING CAPACITY OF 1,500 psf.
- GARAGE FOOTINGS PER DETAIL, COLUMN NOT REQUIRED UNLESS NOTED ON PLANS.


I JOIST AND TRUSS NOTES

- FLOOR TRUSS OR I-JOIST LOADING SHALL BE PER THE GENERAL NOTES.
- I-JOISTS MAY BE SHOWN AS SIMPLE SPAN TO DEFINE SPANS AND BEARING POINTS, TRUSS MFG TO RUN CONTINUOUS WHERE POSSIBLE.
- COORDINATE I-JOISTS LOCATIONS WITH PLUMBING DRAIN LINES AT ALL TOILET LOCATIONS.
- JOIST BLOCKING WHERE NOTED ON PLANS MAY BE OMITTED AT HVAC AND PLUMBING LOCATIONS AS REQUIRED.
- EXACT I-JOIST OR FLOOR TRUSS LAYOUT TO BE PROVIDED BY TRUSS MANUFACTURER. DESIGN AND LAYOUT TO BE SUBMITTED TO VAN DEURZEN AND ASSOCIATES TO REVIEW FOR GENERAL CONFORMANCE TO THE DESIGN OF THE BUILDING PRIOR TO SUBMITTAL TO THE CODES ADMINISTRATION FOR PERMITTING.
- IF A CONFLICT EXISTS BETWEEN SHOP DRAWINGS AND CONTRACT SET, THE CONTRACT SET SUPERCEDES THE JOIST/TRUSS LAYOUT.

I JOIST FIRE PROTECTION

ALL I-JOIST AND OPEN WEB TRUSSES OVER UNFINISHED SPACE EXCEEDING 80 SQUARE FEET IN AGGREGATE AREA TO BE PROTECTED BY THE FOLLOWING METHOD:

- 3" MINERAL/ROCK WOOL COVERING BTM CHORD AND NETTING PER APA FORM R423 METHOD 4

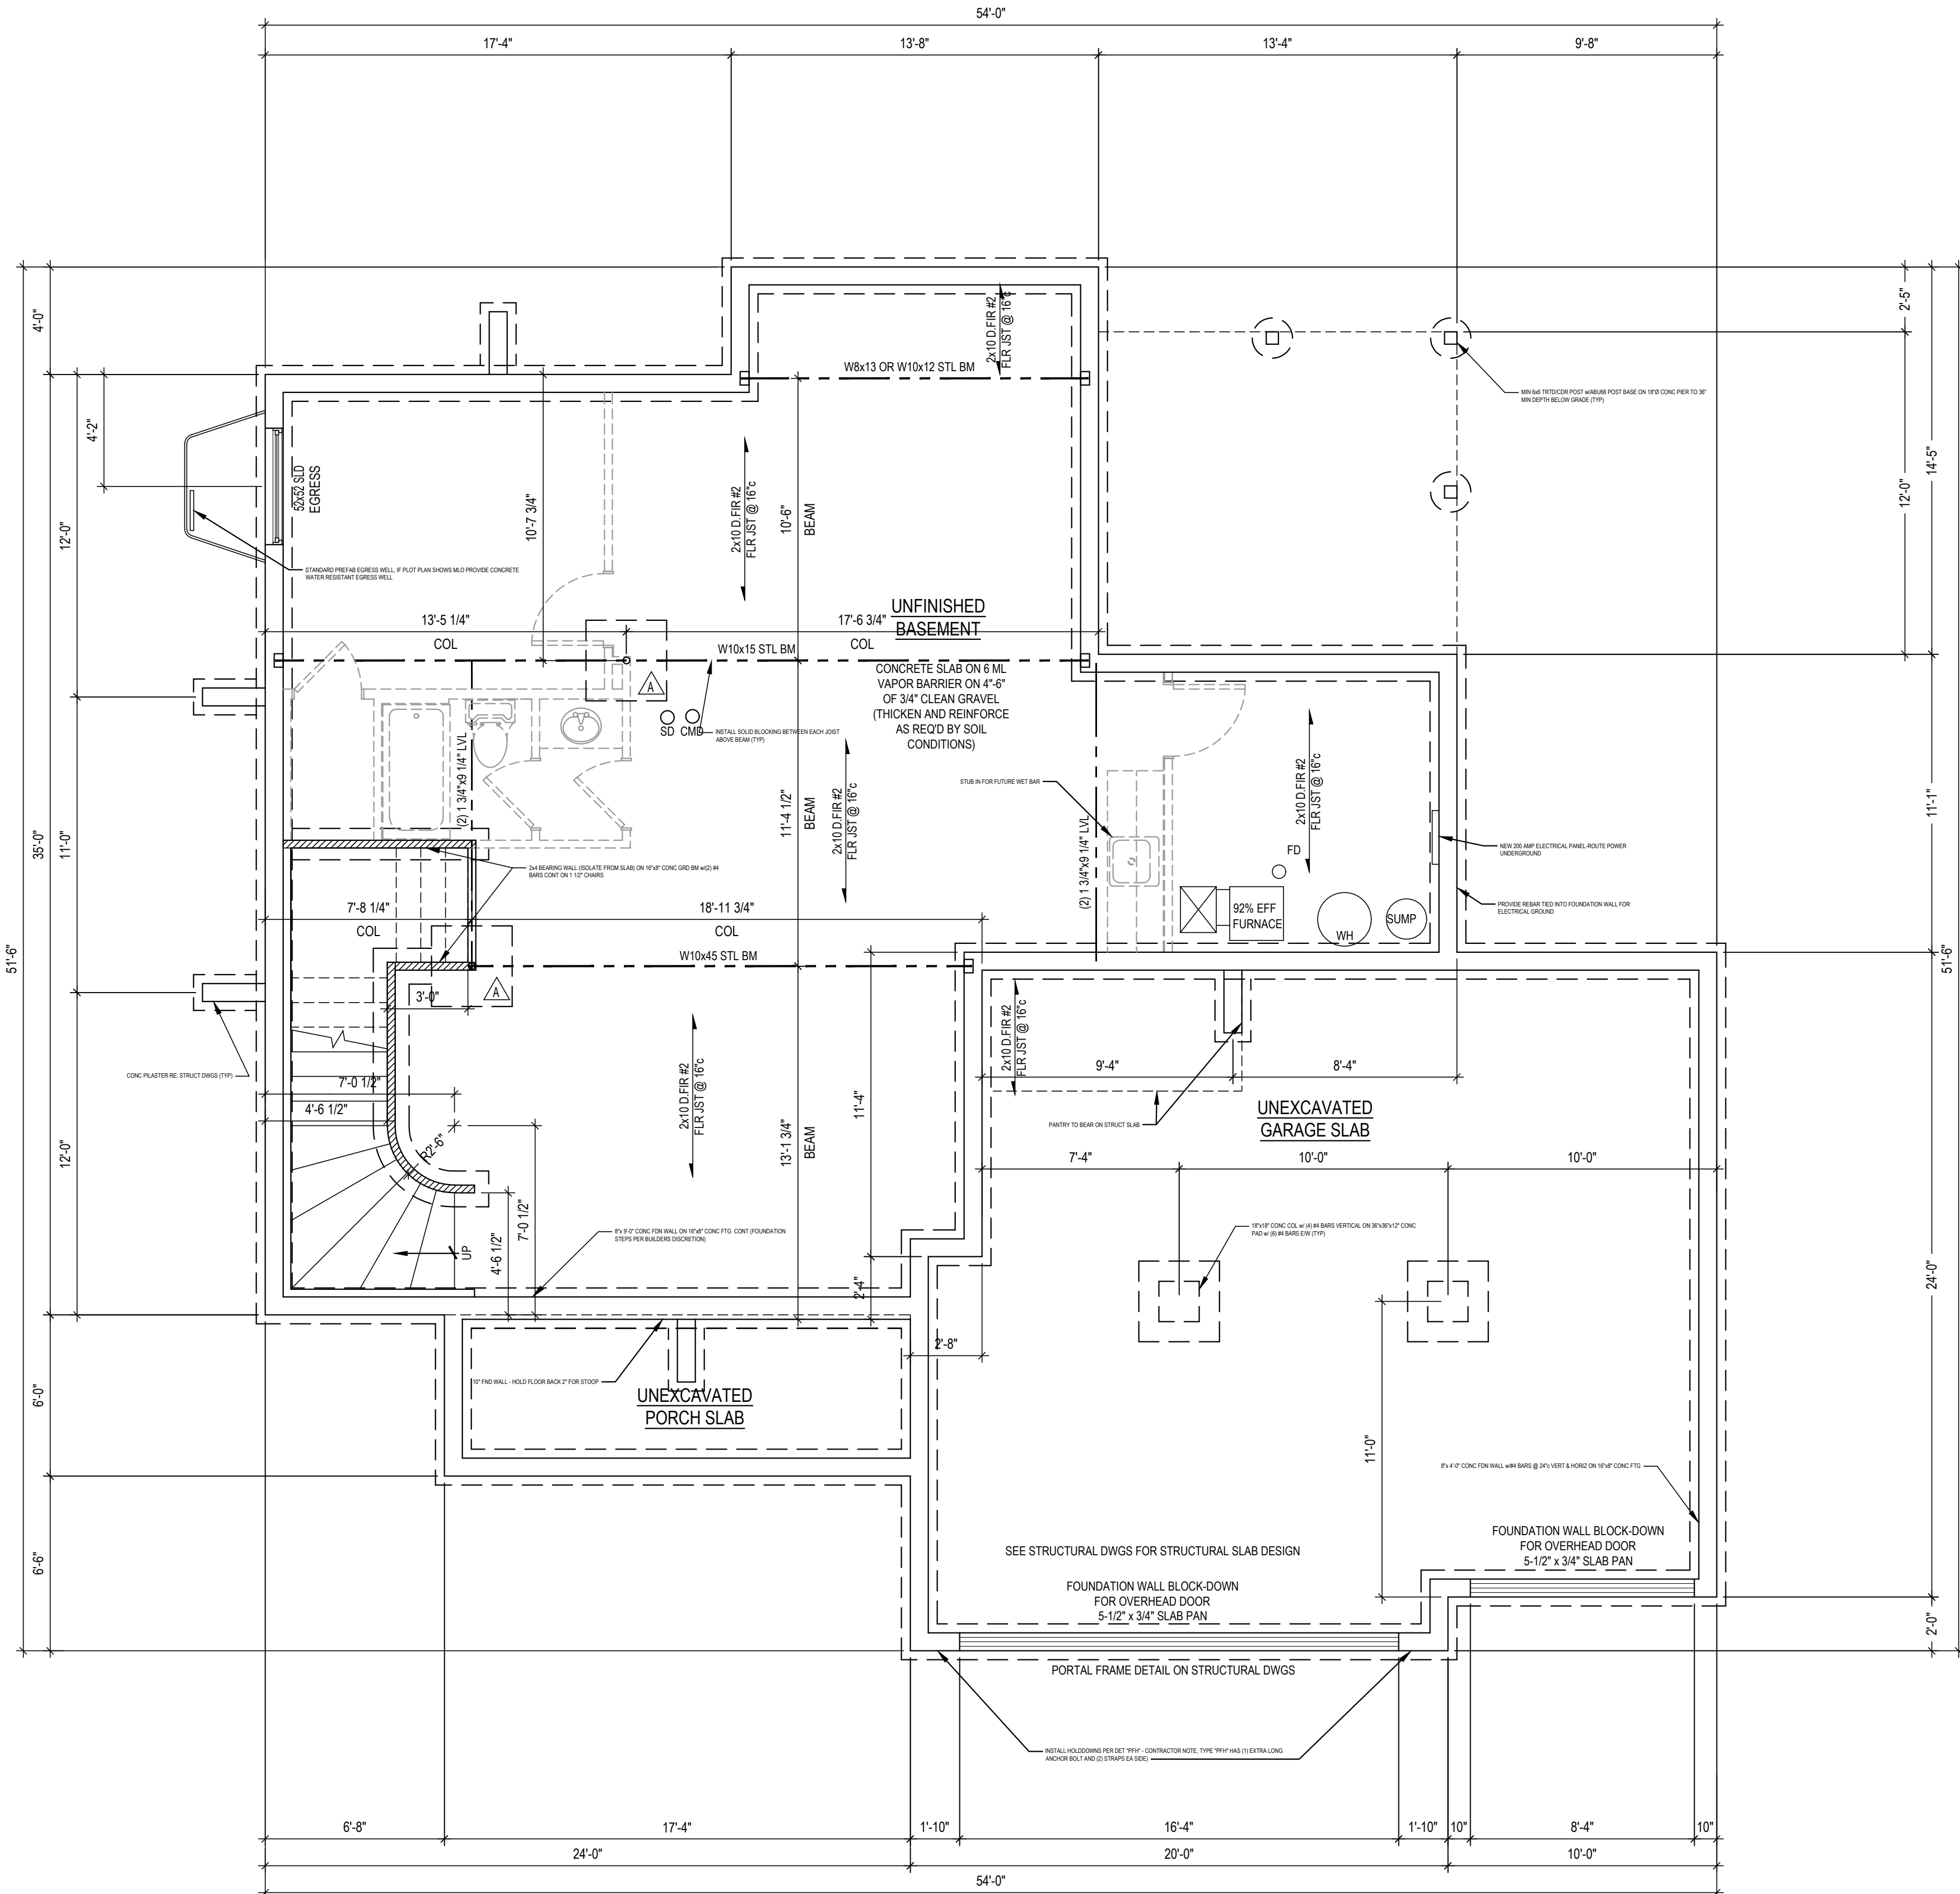

LOWER LEVEL
FINISHED AREA: 0 SF
UNFINISHED: 1127 SF

LOAD BEARING WALL
LOAD BEARING BEAM

Foundation Plan

1/4" = 1'-0"

1



© COPYRIGHT 2021

JFE CONSTRUCTION INC.
1314 SW Market Street
Lee's Summit, MO 64081
v: 816.786.4008
jfeconstruction.com

VAN DEURZEN & ASSOCIATES, P.A.
1011 KING STREET SUITE 130
OVERLAND PARK, KS 66210
(913) 451-6305 FAX (913) 451-0021
WEB PAGE WWW.VANDEURZENANDASSOCIATES.COM
E-MAIL: V2@VANDEURZENANDASSOCIATES.COM

Van Deurzen and Associates, P.A. © 2021



THE SLIVERTON III

Spec Residence
2027 SW Farmfield Court, Lee's Summit, MO
Lot 10 - Hook Farms 1st Plat

Project #: 8083-XXXX

DATE:

For Permit: 3/30/2022

Foundation
Plan

A101
RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
Development Services
LEE'S SUMMIT, MISSOURI

GENERAL PLAN REQUIREMENTS:

- ALL STUD WALL FRAMING SHALL BE CONTINUOUS FROM THE FLOOR TO ROOF OR CEILING DIAPHRAGM, U.N.O. ALL WALLS OVER 10'-0" ARE TO BE 2x6 @ 16" U.N.O.
- PROVIDE WATER-RESISTANT EXTERIOR WALL COVERING ON ALL FRAMED WALLS TO COMPLY WITH IRC SECTION 703.2.
- PROVIDE GFCI ELECTRICAL OUTLETS ON EXTERIOR, IN UNFINISHED BASEMENT, IN BATHROOMS, ABOVE KITCHEN COUNTERS, IN GARAGE, AND WITHIN 6'-0" OF ANY SINK.
- ALL EXTERIOR DOORS SERVED BY LANDING.
- INSTALL CARBON MONOXIDE DETECTORS PER IRC SECTION 315 OUTSIDE OF EACH SLEEPING AREA.
- INSTALL SMOKE DETECTORS IN EACH SLEEPING ROOM, OUTSIDE OF EACH SLEEPING AREA, WITH A MINIMUM OF ONE ON EACH FLOOR PER IRC SECTION 314.
- PROVIDE A "JERF" GROUND PER IRC 3608.1.
- REFER TO SHEET 93 FOR ALL WALL BRACING DETAILS AND/OR CALCULATIONS.
- INSTALL BLOCKING FOR TP HOLDERS, TOWEL BARS, AND TRIM BEAMS.
- GARAGE DOOR H-FRAME: THE H-FRAME FOR ATTACHMENT OF THE TRACK AND COUNTER BALANCE SHALL CONSIST OF THE FOLLOWING: 2x6 VERTICAL JAMBS RUNNING FROM FLOOR TO CEILING ATTACHED WITH 3 1/4"x120 NAILS @ 7" STAGGERED WITH (7) 3 1/4"x120 NAILS THRU JAMB INTO HEADER. MINIMUM 2x6 HEADER FOR ATTACHMENT OF COUNTER BALANCE SYSTEM.
- OVERHEAD GARAGE DOORS TO MEET 115 MPH WIND LOAD RESISTANCE REQUIREMENTS OF DASHA 108-17 AND ASTM E 330-02 PER IRC SECTION R 608.4.
- MAXIMUM RISER HEIGHT OF STAIRWAYS SHALL NOT EXCEED 7 3/4" AND THE TREADS SHALL PROVIDE A MINIMUM TREAD DEPTH OF 10".
- ALL EXTERIOR AND LOAD BEARING WINDOW AND DOOR HEADERS TO BE (2) 2x10 D.FIR #2 UNLESS NOTED OTHERWISE ON PLANS.
- ALL HEADER BEARINGS (OTHER THAN WINDOWS) TO BE (2) 2x4 STUDS UNLESS NOTED OTHERWISE. WINDOW HEADER BEARING TO BE (1) 2x4 EA END UNLESS NOTED OTHERWISE.
- ALL EXTERIOR PLATE HGTS TO BE 9'-0" UNLESS OTHERWISE NOTED. INTERIOR PLATE HGTS AS INDICATED IN ROOM CLG HEIGHTS NOTATION. NO HANDRAIL IS REQUIRED FOR STEPS HAVING LESS 3 RISERS OR LESS. ANY LUMBER IN DIRECT CONTACT WITH CONCRETE TO BE TREATED.

ENERGY REQUIREMENTS

- CONTRACTOR TO PROVIDE ENERGY AUDIT USING THE HERS ENERGY RATING SYSTEM. IN LIEU OF AN ENERGY AUDIT, THE FOLLOWING PRESCRIPTIVE REQUIREMENTS MAY BE FOLLOWED:
- ALL DUCTS, AIR HANDLERS, FILTER BOXES, AND BUILDING CAVITIES TO BE SEALED PER IRC SECTION N1102.2.
 - THE BUILDING THERMAL ENVELOPE IS REQUIRED TO BE SEALED PER IRC SECTION N1102.4.
 - CONTRACTOR TO SUBMIT "MANUAL 7" AND "MANUAL D" CALCULATIONS FOR THE HVAC SYSTEM.
 - INSULATION TO COMPLY WITH IECC AS FOLLOWS:

WALLS	R-13
CEILING (FLAT)	R-49
CEILING (VAULTED)	R-38 (NOTE: VAULTED AREA NOT TO EXCEED 500sq ft OR 20% OF ROOF AREA, WHICHEVER IS LESS)
FLOORS OVER UNCONDITIONED SPACE	R-19
CRAWL SPACE WALLS	R-13 (or R-10 CONTINUOUS)
BASEMENT WALLS	R-13 (or R-10 CONTINUOUS)
SLABS	N/R
DUCTWORK	R-8
WINDOWS	U-FACTOR 0.35 (MAX) SHGC 0.40 (MAX)
SKYLIGHTS	U-FACTOR 0.55 (MAX) SHGC 0.40 (MAX)

WINDOW AND DOOR NOTES


- VERIFY WINDOW AND DOOR SIZE WITH SUPPLIER PROVIDED CUT SHEET PRIOR TO FRAMING.
- WINDOW SUPPLIER TO CONFIRM EXACT SAFETY AND EGRESS WINDOW LOCATIONS PER LOCAL CODES.
- ALL WINDOWS TO BE LOW-E GLASS TO MEET ALL LOCAL ENERGY CODE REQUIREMENTS.
- ALL WINDOWS TO BE FRAMED TIGHT TO HEADERS UNLESS NOTED OTHERWISE ON ELEVATIONS.
- PROVIDE EGRESS WINDOW IN ALL SLEEPING ROOMS. WINDOWS SHALL COMPLY WITH THE FOLLOWING:

A. MINIMUM OPEN AREA	57 SF
B. MINIMUM OPENING HEIGHT	24 INCHES
C. MINIMUM OPENING WIDTH	20 INCHES
D. SILL HEIGHT 44" MAX ABOVE FLOOR	
- WINDOW SILLS ARE TO BE 24" MIN FIN FLOOR, OR SHALL BE FIXED / INOPERABLE.
- ALL WINDOWS AND GLAZED DOORS SHALL COMPLY WITH 2018 IRC SECTION R308. IRC SECTION R308.4: GLAZING IN HAZARDOUS LOCATIONS SHALL BE OF APPROVED SAFETY GLAZING MATERIALS. GLASS IN STORM DOORS, INDIVIDUAL FIXED OR OPERABLE PANELS ADJACENT TO A DOOR WHERE THE NEAREST VERTICAL EDGE IS WITHIN A 24" ARC OF THE DOOR IN A CLOSED POSITION AND WHOSE BOTTOM EDGE IS WITHIN 60" OF THE FLOOR. WALLS ENCLOSING STAIRWAYS AND LANDINGS WHERE THE GLAZING IS WITHIN 60" OF THE TOP OR BOTTOM OF STAIR ENCLOSURES FOR TUBS, SHOWERS AND WHIRLPOOLS, GLAZING IN FIXED OR OPERABLE PANELS EXCEEDING 9 SF AND WHOSE BOTTOM EDGE IS LESS THAN 18" ABOVE THE FLOOR OR WALKING SURFACE WITHIN 36".
- ALL OPERABLE WINDOWS SHALL HAVE FALL PROTECTION PER IRC R312.
- ALL GLAZING IN WINDOWS AND DOORS SHALL COMPLY WITH THE TEST CRITERIA FOR CATEGORY II IN ACCORDANCE WITH CPSC 16 CFR 1201.

WALL BRACING NOTES:

- SHEATHING METHOD CS-WSP, WSP, PFH, GB (or LIB), CS-PF
- ALL EXTERIOR WALLS ARE TYPE "CS-WSP" AND ARE CONTINUOUSLY SHEATHED UNLESS NOTED OTHERWISE. THE BRACED WALL NOTATIONS (IF SHOWN) REFLECT THE MINIMUM SHEATHING REQUIREMENTS PER CODE.
 - IF NO NOTATIONS ARE SHOWN FOR WALLS TYPE "CS-WSP" ON PLAN, WALL IS FULLY SHEATHED AND MEETS ALL REQUIREMENTS WITH END CONDITION #1, #3, OR #4.
 - EC # - END CONDITION PER IRC FIGURE R602.10.7, (FOR CONDITIONS #1, #3, & #4 NO HOLDDOWN REQUIRED).
 - INTERIOR WALL BRACING NOT REQUIRED FOR BRACED WALL SPACING 60FT OR LESS.
 - SECOND FLOOR BRACED USING CS-WSP, MEETS ALL REQUIREMENTS, ALL WALL LINES ARE EC #1 OR EC #3.

- XXXXXXXXXXXX DENOTES EXTERIOR BRACED WALL WOOD STRUCTURAL PANEL (WSP or CS-WSP) ATTACHED PER DETAILS AND GENERAL NOTES
- XX" PANEL

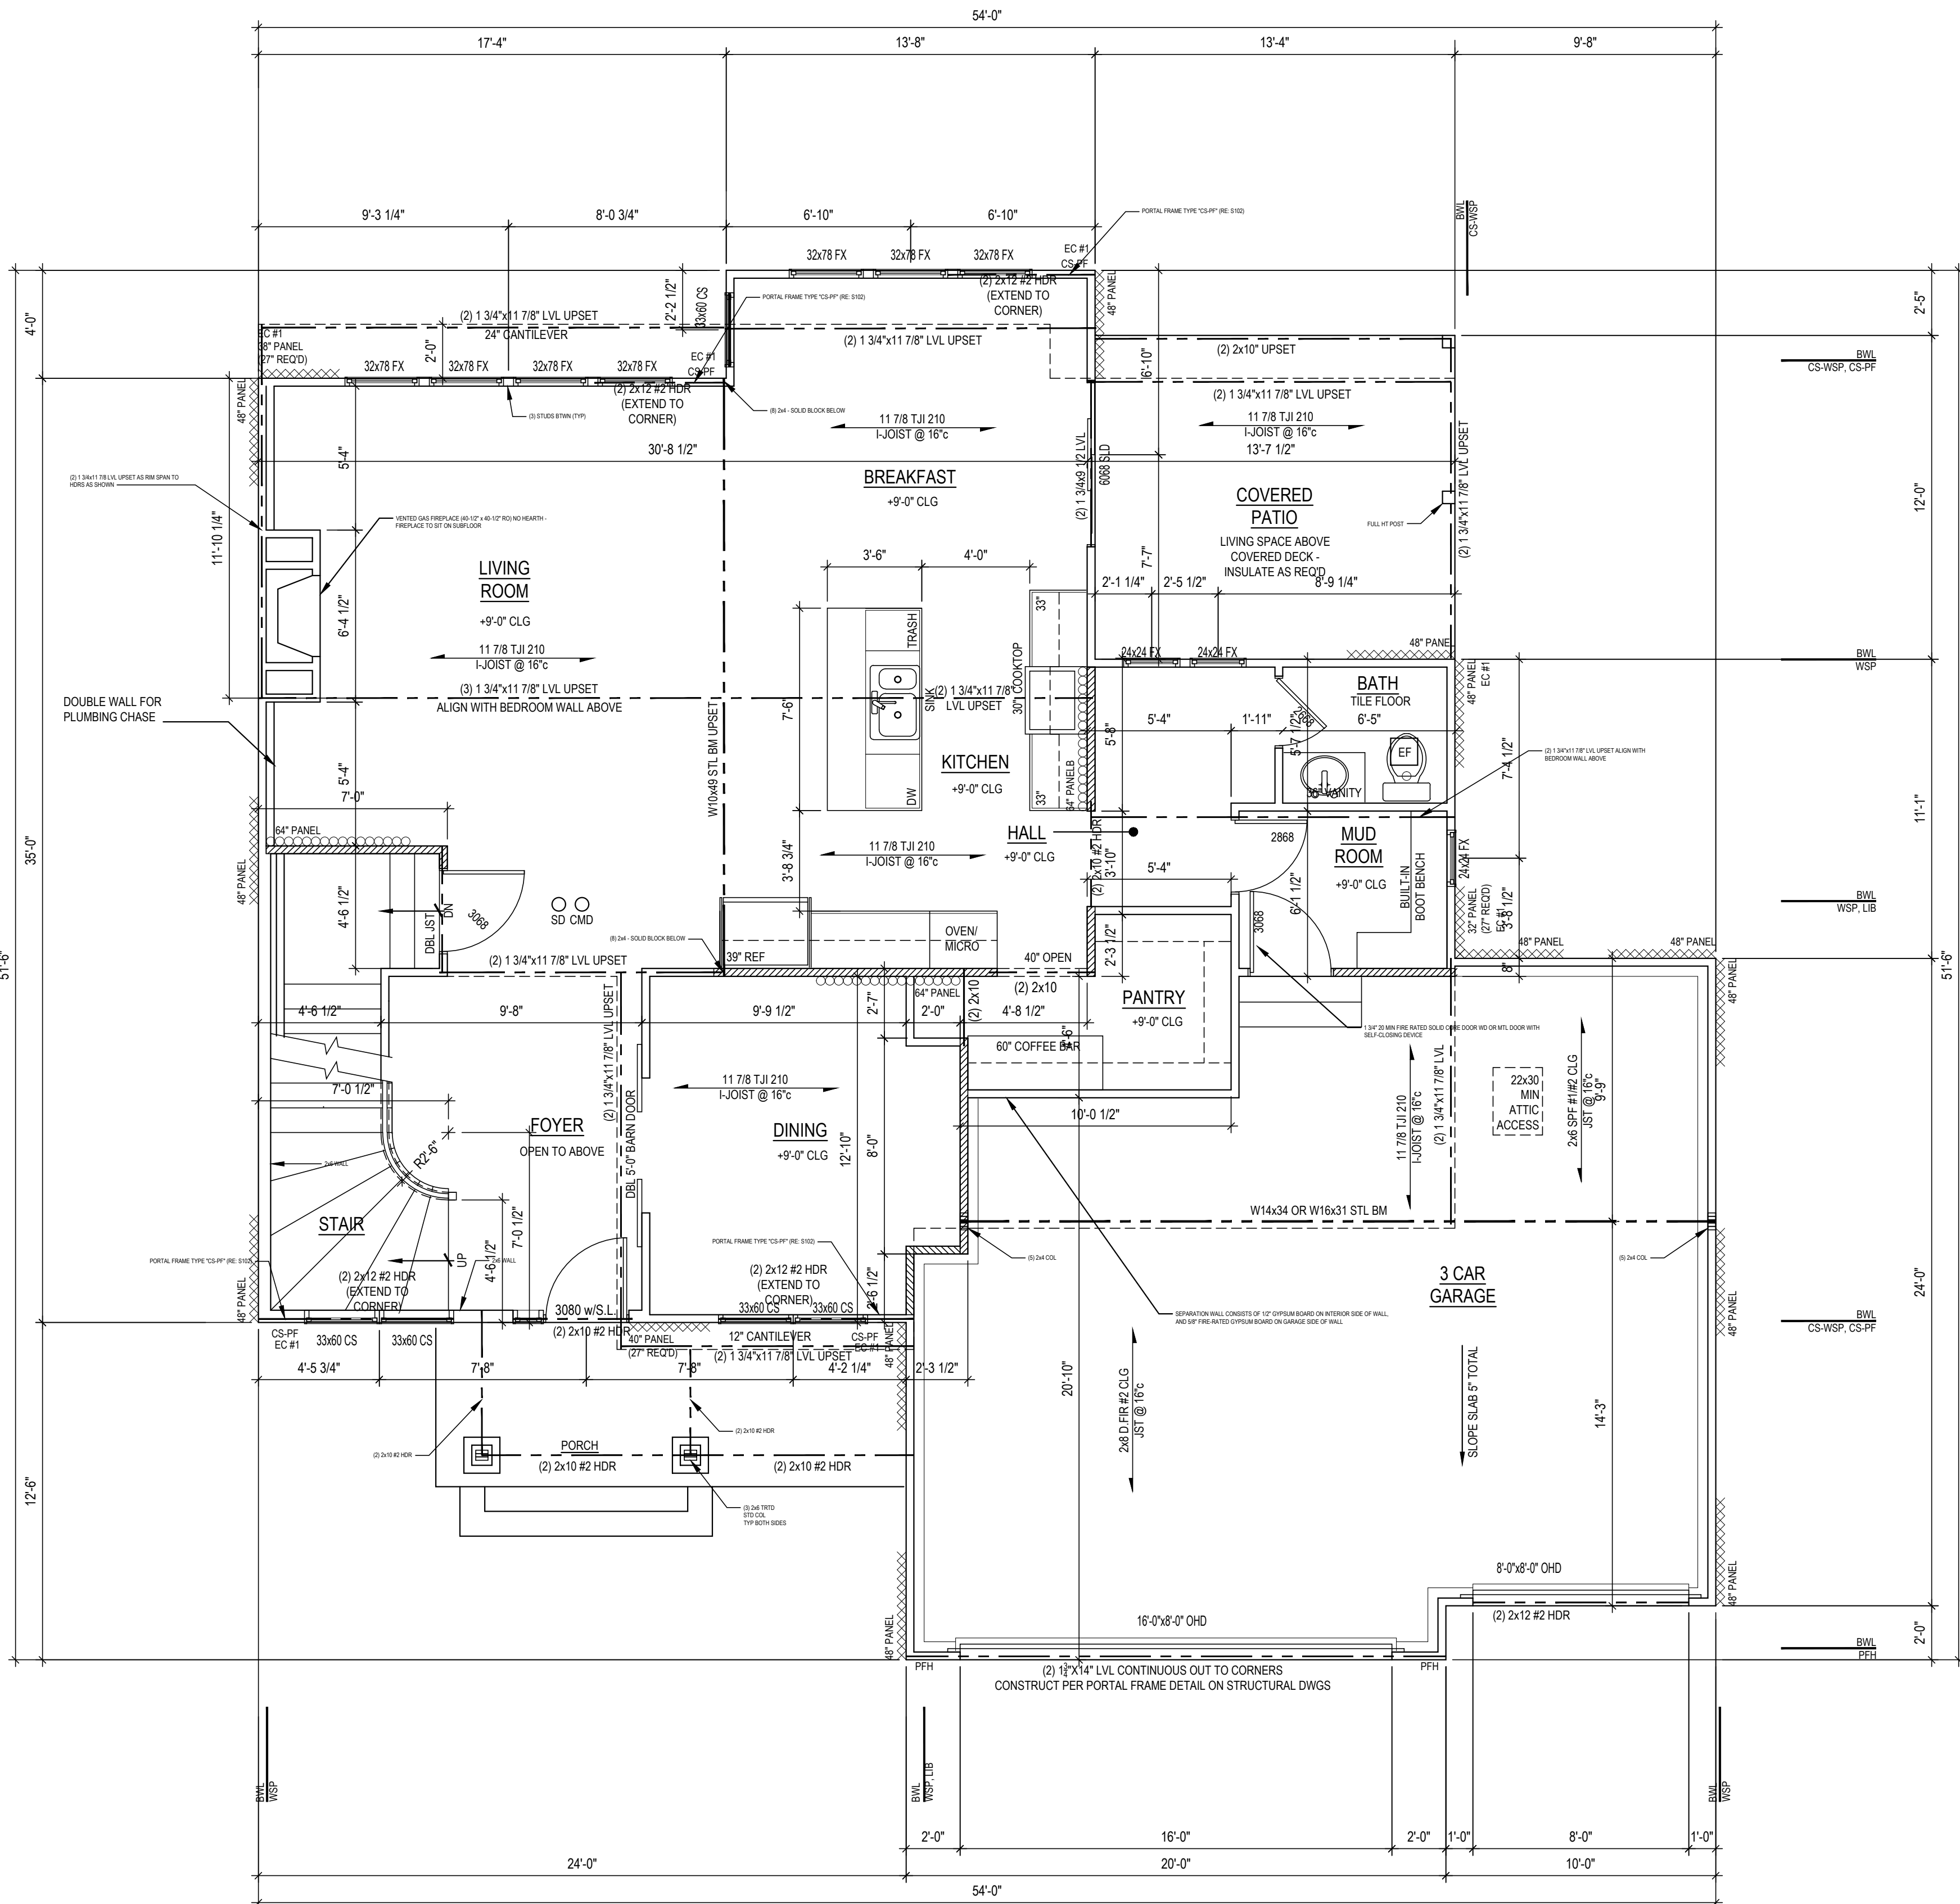

MAIN LEVEL	1276 SF
FINISH	160 SF
COVERED PATIO	160 SF
GARAGE	676 SF

- LOAD BEARING WALL
- LOAD BEARING BEAM

First Floor Plan

1/4" = 1'-0"

1



© COPYRIGHT 2021

JFE CONSTRUCTION INC.
1314 SW Market Street
Lee's Summit, MO 64081
v: 816.786.4008
jfeconstruction.com



Van Deurzen and Associates, P.A. © 2021



THE SLIVERTON III

Spec Residence
2027 SW Farmfield Court, Lee's Summit, MO
Lot 10 - Hook Farms 1st Plat

Project #: 8083-XXXX

DATE:

For Permit: 3/30/2022

First Floor
Plan

A102
RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS
Development Services
LEE'S SUMMIT, MISSOURI

GENERAL PLAN REQUIREMENTS:

- ALL STUD WALL FRAMING SHALL BE CONTINUOUS FROM THE FLOOR TO ROOF OR CEILING DIAPHRAGM, U.N.O. ALL WALLS OVER 10'-0" ARE TO BE 2x6 @ 16" U.N.O.
- PROVIDE WATER-RESISTANT EXTERIOR WALL COVERING ON ALL FRAMED WALLS TO COMPLY WITH IRC SECTION 703.2.
- PROVIDE GFCI ELECTRICAL OUTLETS ON EXTERIOR, IN UNFINISHED BASEMENT, IN BATHROOMS, ABOVE KITCHEN COUNTERS, IN GARAGE, AND WITHIN 6'-0" OF ANY SINK.
- ALL EXTERIOR DOORS SERVED BY LANDING.
- INSTALL CARBON MONOXIDE DETECTORS PER IRC SECTION 315 OUTSIDE OF EACH SLEEPING AREA.
- INSTALL SMOKE DETECTORS IN EACH SLEEPING ROOM, OUTSIDE OF EACH SLEEPING AREA, WITH A MINIMUM OF ONE ON EACH FLOOR PER IRC SECTION 314.
- PROVIDE A "UFER" GROUND PER IRC 3608.1.
- REFER TO SHEET #3 FOR ALL WALL BRACING DETAILS AND/OR CALCULATIONS.
- INSTALL BLOCKING FOR TP HOLDERS, TOWEL BARS, AND TRIM BEAMS.
- GARAGE DOOR H-FRAME: THE H-FRAME FOR ATTACHMENT OF THE TRACK AND COUNTER BALANCE SHALL CONSIST OF THE FOLLOWING: 2x6 VERTICAL JAMBS RUNNING FROM FLOOR TO CEILING ATTACHED WITH 3 1/4"x120 NAILS @ 7" STAGGERED WITH (7) 3 1/4"x120 NAILS THRU JAMB INTO HEADER. MINIMUM 2x8 HEADER FOR ATTACHMENT OF COUNTER BALANCE SYSTEM.
- OVERHEAD GARAGE DOORS TO MEET 115 MPH WIND LOAD RESISTANCE REQUIREMENTS OF DASHA 108-17 AND ASTM E 330-02 PER IRC SECTION R 608.4.
- MAXIMUM RISER HEIGHT OF STAIRWAYS SHALL NOT EXCEED 7 3/4" AND THE TREADS SHALL PROVIDE A MINIMUM TREAD DEPTH OF 10".
- ALL EXTERIOR AND LOAD BEARING WINDOW AND DOOR HEADERS TO BE (2) 2x10 D.FIR #2 UNLESS NOTED OTHERWISE ON PLANS.
- ALL HEADER BEARINGS (OTHER THAN WINDOWS) TO BE (2) 2x4 STUDS UNLESS NOTED OTHERWISE. WINDOW HEADER BEARING TO BE (1) 2x4 EA END UNLESS NOTED OTHERWISE.
- ALL EXTERIOR PLATE HGTS TO BE 9'-0" UNLESS OTHERWISE NOTED. INTERIOR PLATE HGTS AS INDICATED IN ROOM CLG HEIGHTS NOTATION. NO HANDRAIL IS REQ'D FOR STEPS HAVING LESS 3 RISERS OR LESS.
- ANY LUMBER IN DIRECT CONTACT WITH CONCRETE TO BE TREATED.

ENERGY REQUIREMENTS

CONTRACTOR TO PROVIDE ENERGY AUDIT USING THE HERS ENERGY RATING SYSTEM. IN LIEU OF AN ENERGY AUDIT, THE FOLLOWING PRESCRIPTIVE REQUIREMENTS MAY BE FOLLOWED:

- ALL DUCTS, AIR HANDLERS, FILTER BOXES, AND BUILDING CAVITIES TO BE SEALED PER IRC SECTION N1102.2.
- THE BUILDING THERMAL ENVELOPE IS REQUIRED TO BE SEALED PER IRC SECTION N1102.4.
- CONTRACTOR TO SUBMIT "MANUAL 7" AND "MANUAL D" CALCULATIONS FOR THE HVAC SYSTEM.
- INSULATION TO COMPLY WITH IECC AS FOLLOWS:
WALLS R-13
CEILING (FLAT) R-49
CEILING (VAULTED) R-38 (NOTE: VAULTED AREA NOT TO EXCEED 500sq ft OR 20% OF ROOF AREA, WHICHEVER IS LESS)


- FLOORS OVER UNCONDITIONED SPACE
CRAWL SPACE WALLS
BASEMENT WALLS
SLABS
DUCTWORK
WINDOWS
U-FACTOR
SHGC
SKYLIGHTS
U-FACTOR
SHGC
- R-19
R-13 (or R-10 CONTINUOUS)
R-13 (or R-10 CONTINUOUS)
N/R
R-8
U 0.35 (MAX)
0.40 (MAX)
U 0.55 (MAX)
0.40 (MAX)

WINDOW AND DOOR NOTES

- VERIFY WINDOW AND DOOR SIZE WITH SUPPLIER PROVIDED CUT SHEET PRIOR TO FRAMING.
- WINDOW SUPPLIER TO CONFIRM EXACT SAFETY AND EGRESS WINDOW LOCATIONS PER LOCAL CODES.
- ALL WINDOWS TO BE LOW-E GLASS TO MEET ALL LOCAL ENERGY CODE REQUIREMENTS.
- ALL WINDOWS TO BE FRAMED TIGHT TO HEADERS UNLESS NOTED OTHERWISE ON ELEVATIONS.
- PROVIDE EGRESS WINDOW IN ALL SLEEPING ROOMS. WINDOWS SHALL COMPLY WITH THE FOLLOWING:
A. MINIMUM OPEN AREA 57 SF
B. MINIMUM OPENING HEIGHT 24 INCHES
C. MINIMUM OPENING WIDTH 20 INCHES
D. SILL HEIGHT 44" MAX ABOVE FLOOR
- WINDOW SILLS ARE TO BE 24" MIN FIN FLOOR, OR SHALL BE FIXED / INOPERABLE.
- ALL WINDOWS AND GLAZED DOORS SHALL COMPLY WITH 2018 IRC SECTION R308, IRC SECTION R308.4: GLAZING IN HAZARDOUS LOCATIONS SHALL BE OF APPROVED SAFETY GLAZING MATERIALS: GLASS IN STORM DOORS, INDIVIDUAL FIXED OR OPERABLE PANELS ADJACENT TO A DOOR WHERE THE NEAREST VERTICAL EDGE IS WITHIN A 24" ARC OF THE DOOR IN A CLOSED POSITION AND WHOSE BOTTOM EDGE IS WITHIN 60" OF THE FLOOR, WALLS ENCLOSING STAIRWAYS AND LANDINGS WHERE THE GLAZING IS WITHIN 60" OF THE TOP OR BOTTOM OF STAIR ENCLOSURES FOR TUBS, SHOWERS AND WHIRLPOOLS, GLAZING IN FIXED OR OPERABLE PANELS EXCEEDING 9 SF AND WHOSE BOTTOM EDGE IS LESS THAN 18" ABOVE THE FLOOR OR WALKING SURFACE WITHIN 36".
- ALL OPERABLE WINDOWS SHALL HAVE FALL PROTECTION PER IRC R312.
- ALL GLAZING IN WINDOWS AND DOORS SHALL COMPLY WITH THE TEST CRITERIA FOR CATEGORY #1 IN ACCORDANCE WITH CPSC 16 CFR 1201.

WALL BRACING NOTES:

- SHEATHING METHOD CS-WSP, WSP, PFF, GB (or LIB), CS-PF
- ALL EXTERIOR WALLS ARE TYPE "CS-WSP" AND ARE CONTINUOUSLY SHEATHED UNLESS NOTED OTHERWISE. THE BRACED WALL NOTATIONS (IF SHOWN) REFLECT THE MINIMUM SHEATHING REQUIREMENTS PER CODE.
 - IF NO NOTATIONS ARE SHOWN FOR WALLS TYPE "CS-WSP" ON PLAN, WALL IS FULLY SHEATHED AND MEETS ALL REQUIREMENTS WITH END CONDITION #1, #3, OR #4.
 - EC # - END CONDITION PER IRC FIGURE R602.10.7, (FOR CONDITIONS #1, #3, & #4 NO HOLDDOWN REQUIRED)
 - INTERIOR WALL BRACING NOT REQUIRED FOR BRACED WALL SPACING 60FT OR LESS
 - SECOND FLOOR BRACED USING CS-WSP, MEETS ALL REQUIREMENTS, ALL WALL LINES ARE EC #1 OR EC #3
- XXXXXXXXXXXXX DENOTES EXTERIOR BRACED WALL WOOD
XX" PANEL STRUCTURAL PANEL (WSP or CS-WSP)
ATTACHED PER DETAILS AND GENERAL NOTES

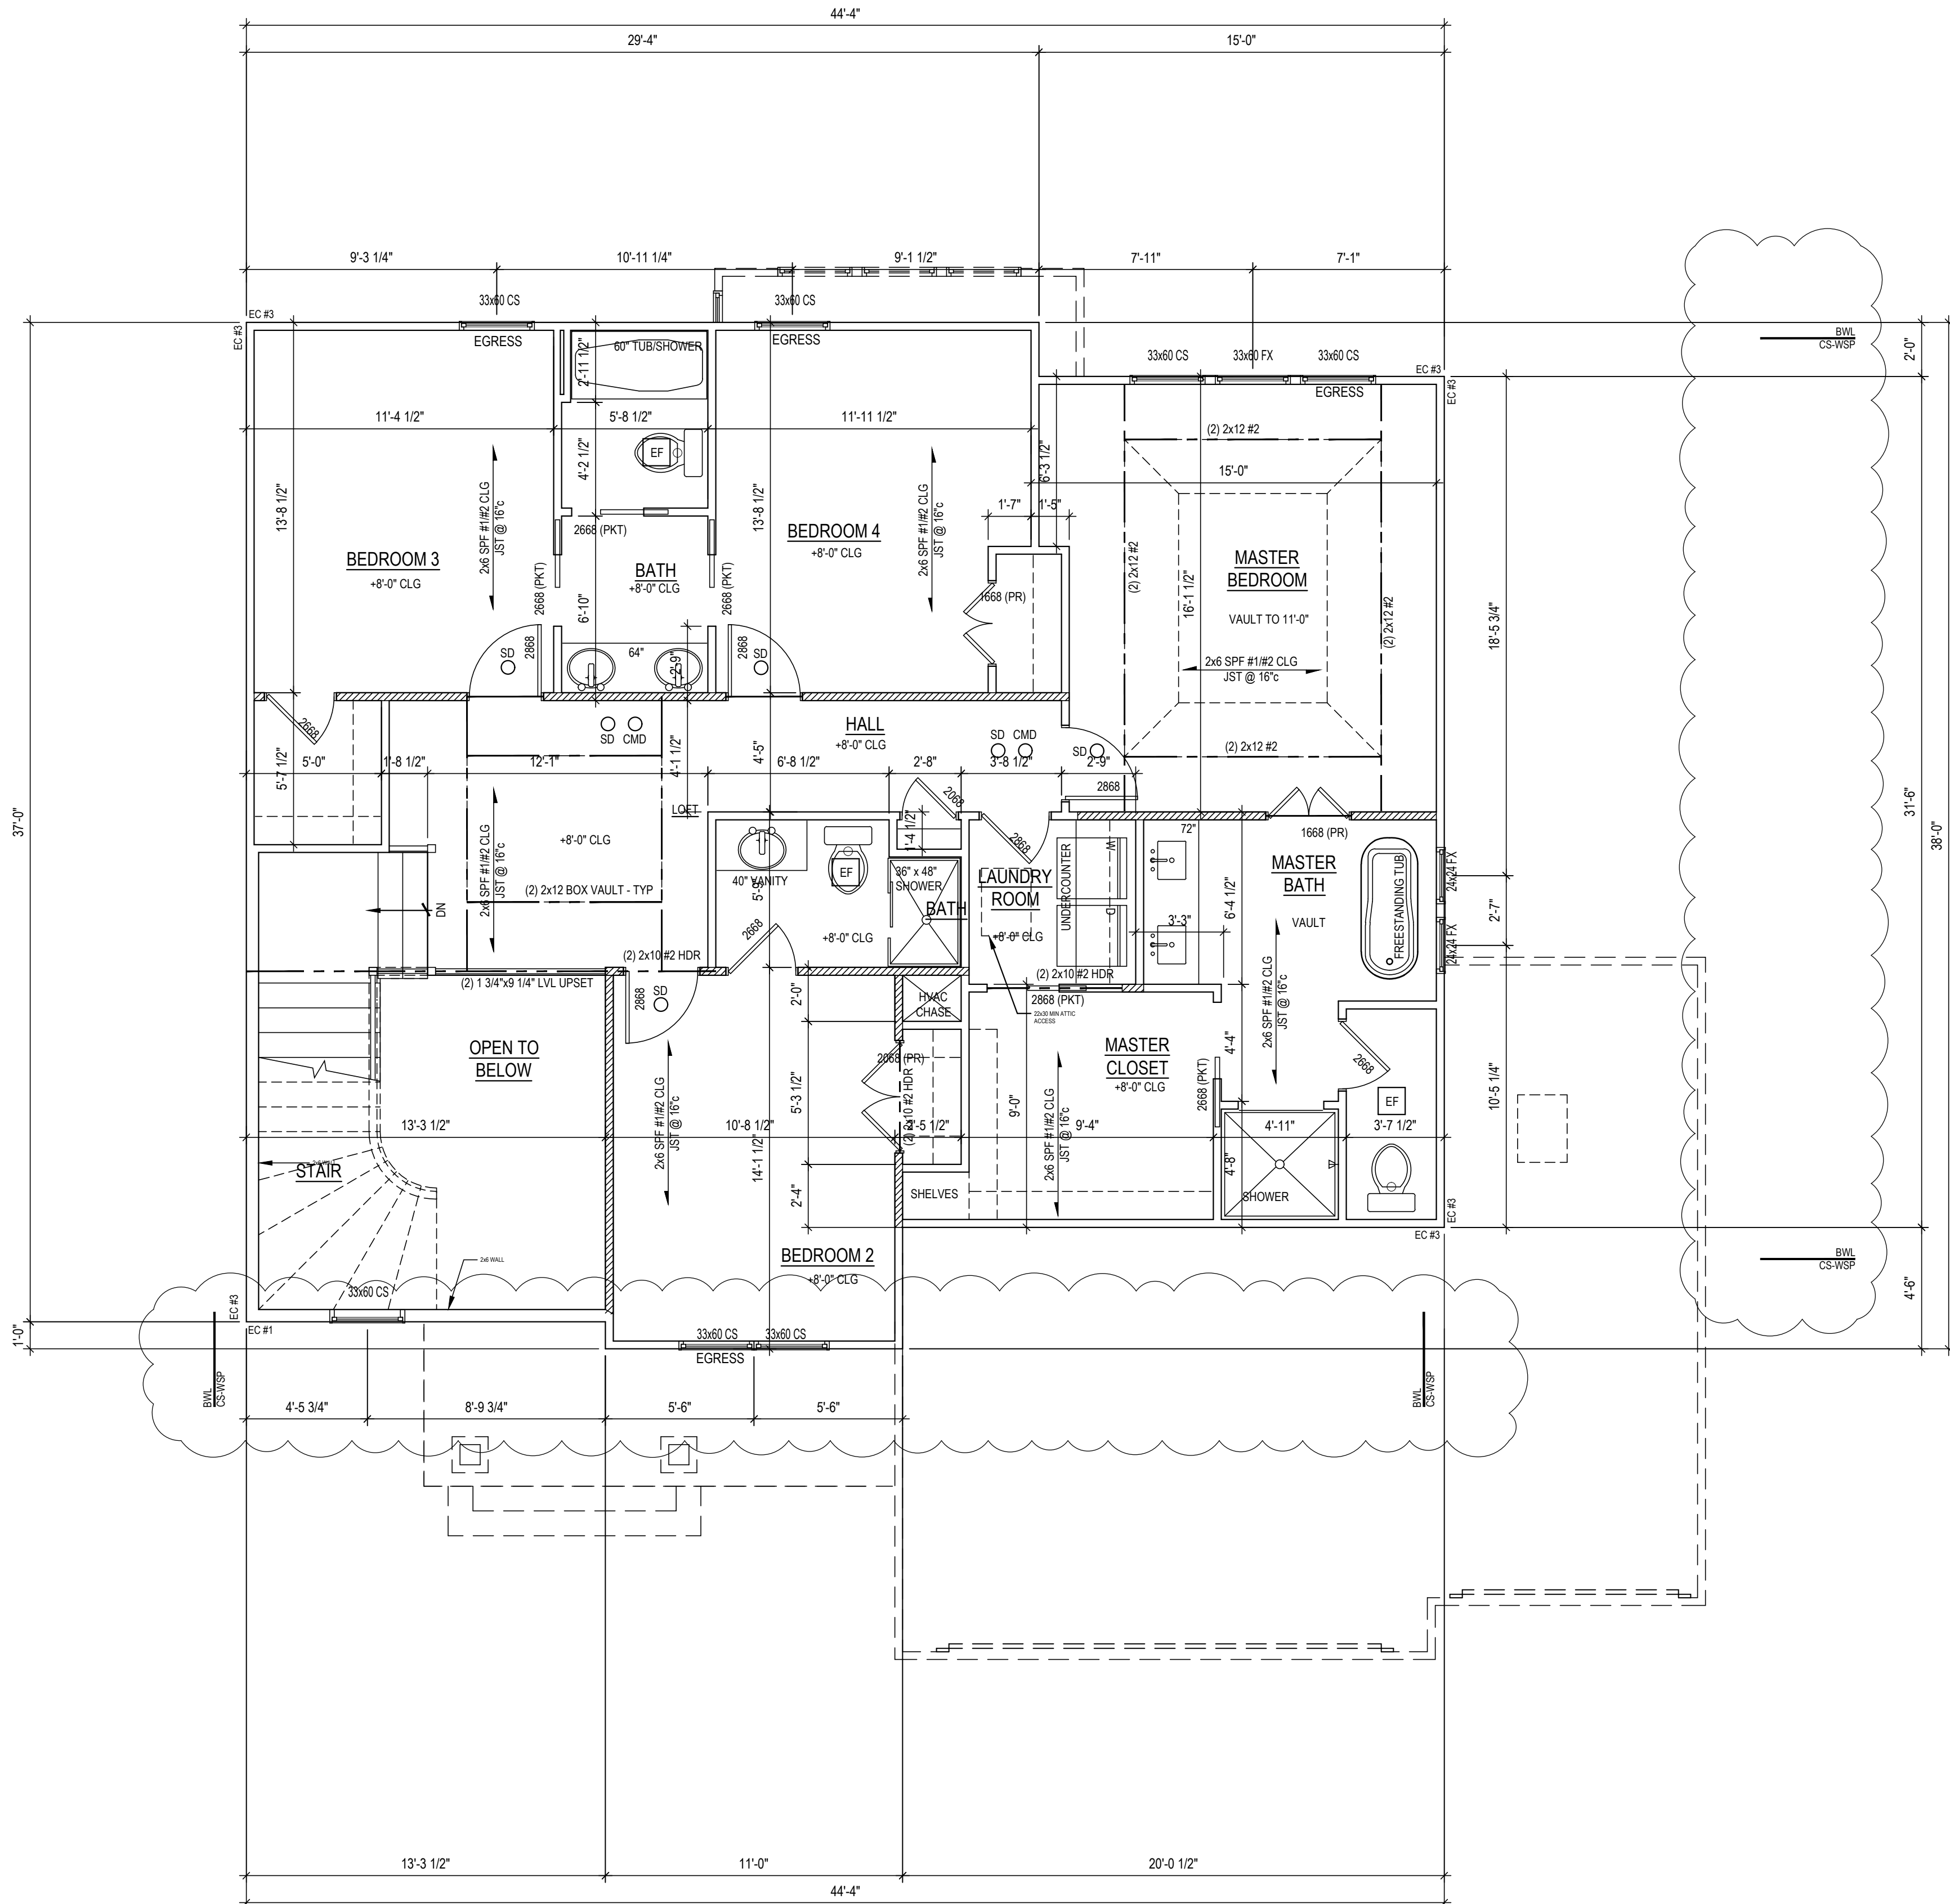

UPPER LEVEL
FINISH: 1345 SF

LOAD BEARING WALL
LOAD BEARING BEAM

Second Floor Plan

1/4" = 1'-0"

1



© COPYRIGHT 2021

JFE CONSTRUCTION INC.
1314 SW Market Street
Lee's Summit, MO 64081
v: 816.786.4008
jfeconstruction.com



Van Deuren and Associates, P.A. © 2021



THE SLIVERTON III

Spec Residence
2027 SW Farmfield Court, Lee's Summit, MO
Lot 10 - Hook Farms 1st Plat

Project #: 8083-XXXX

DATE:

For Permit: 3/30/2022

Second Floor
Plan

A103
RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS
Development Services
LEE'S SUMMIT, MISSOURI


ROOF PLAN NOTES

- ALL ROOF RAFTERS NOT CALLED OUT ARE TO BE 2x6 SPF #1#2 @ 16"
- ALL CEILING JOISTS NOT CALLED OUT ARE TO BE 2x6 SPF #1#2 @ 16"
- ALL VAULTS TO BE FURRED DOWN w/2x MATERIAL TO PROVIDE FOR R-38 INSULATION
- ALL EXTERIOR AND LOAD BEARING WINDOW AND DOOR HEADERS TO BE (2) 2x10 D.FIR #2 UNLESS NOTED OTHERWISE ON PLANS
- ALL RIDGES, HIPs, AND VALLEYS NOT MARKED SHALL BE (1) NOMINAL SIZE LARGER THAN THE INTERSECTING RAFTERS
- CEILING JOISTS AND RAFTERS SHALL BE NAILED TO EACH OTHER WITH (3) 16d COM (3 1/2"x0.162") NAILS AND THE RAFTER SHALL BE NAILED TO THE TOP WALL PLATE WITH (3) 8d COM (2 1/2"x0.131") NAILS. CEILING JOISTS SHALL BE CONTINUOUS OR SECURELY JOINED WITH (3) 16d COM (3 1/2"x0.162") NAILS WHERE THEY MEET OVER INTERIOR PARTITIONS AND ARE NAILED TO ADJACENT RAFTERS TO PROVIDE A CONTINUOUS TIE ACROSS THE BUILDING WHEN SUCH JOISTS ARE PARALLEL TO THE RAFTERS.
- WHERE CEILING JOISTS ARE NOT CONNECTED TO THE RAFTERS AT THE TOP WALL PLATE (or AT LOCATIONS WHERE C.J. ARE PERPENDICULAR TO RAFTERS), INSTALL 2x4 RAFTER TIES @ 16" WITH (3) 16d COM (3 1/2"x0.162") NAILS EA END.
- RAFTER CONNECTIONS DESIGNED TO RESIST UPLIFT FORCES PER IRC TABLE 802.11. ROOF HEADERS DO NOT HAVE NOTABLE UPLIFT TO REQUIRE HOLD DOWNS. REFER TO STRUCTURAL DETAIL SHEET S1 CONNECTION TABLE FOR FASTENERS
- INSTALL 2x4 COLLAR TIES @ 48" IN UPPER 1/3rd OF ROOF RAFTER. PROVIDE METAL FLASHING AT ALL ROOF VALLEYS
- ROOF AND SOFFIT VENTS PER LOCAL CODES. WHERE POSSIBLE, PROVIDE ROOF VENTING ON BACK SIDE OF ROOF. BATH VENTS TO VENT DIRECTLY TO THE OUTSIDE
- EXACT GUTTER AND DOWNSPOUT LOCATION BY GUTTER INSTALLER.
- PER IRC SECTION R802.3 - FOR ROOF PITCHES 3/12 OR GREATER, STRUCTURAL MEMBERS THAT SUPPORT RAFTERS AND CEILING JOISTS SUCH AS RIDGE BEAMS, HIPs AND VALLEYS THAT ARE SUPPORTED BY BRACES AND/OR PURLINS AT THE ENDS ARE NOT REQUIRED TO BE DESIGNED AS BEAMS AND ARE TO BE FRAMED USING LUMBER THAT IS NOMINALLY 2" WIDE BY ONE SIZE GREATER THAN ATTACHING FRAMING MEMBER (NOTE #5). THERE IS NO STRUCTURAL LINE LOADING ON THE MEMBER

ROOF BRACING

- ROOF PURLINS TO BE PLACED APPROXIMATELY WHERE SHOWN ON PLANS. USE 2x6 STUD GRADE PURLIN PLACED PERPENDICULAR TO RAFTERS (UNLESS NOTED OTHERWISE ON PLANS)
- RIDGE, HIP, VALLEY, AND PURLIN BRACE STRUTS TO BE PLACED AS SHOWN ON PLANS. STRUTS TO BE 2x4 STUD GRADE w/ MAXIMUM UNBRACED LENGTH OF 8'-0" AND AT A 45° ANGLE w/ HORIZONTAL OR GREATER (VERTICAL WHERE POSSIBLE)
- BRACES LONGER THAN 8'-0" SHALL BE 2x4 STRONG BACK BRACES

- /// LOAD BEARING INTERIOR WALL BELOW
- LOAD BEARING BEAM BELOW
- - - 2x6 ROOF PURLIN (UNLESS NOTED OTHERWISE ON PLANS)
- - - 2x4 PURLIN/RIDGE BRACING (STRONG BACK IF OVER 8'-0" LONG)
- ⊗ 2x4 STRONG BACK POST

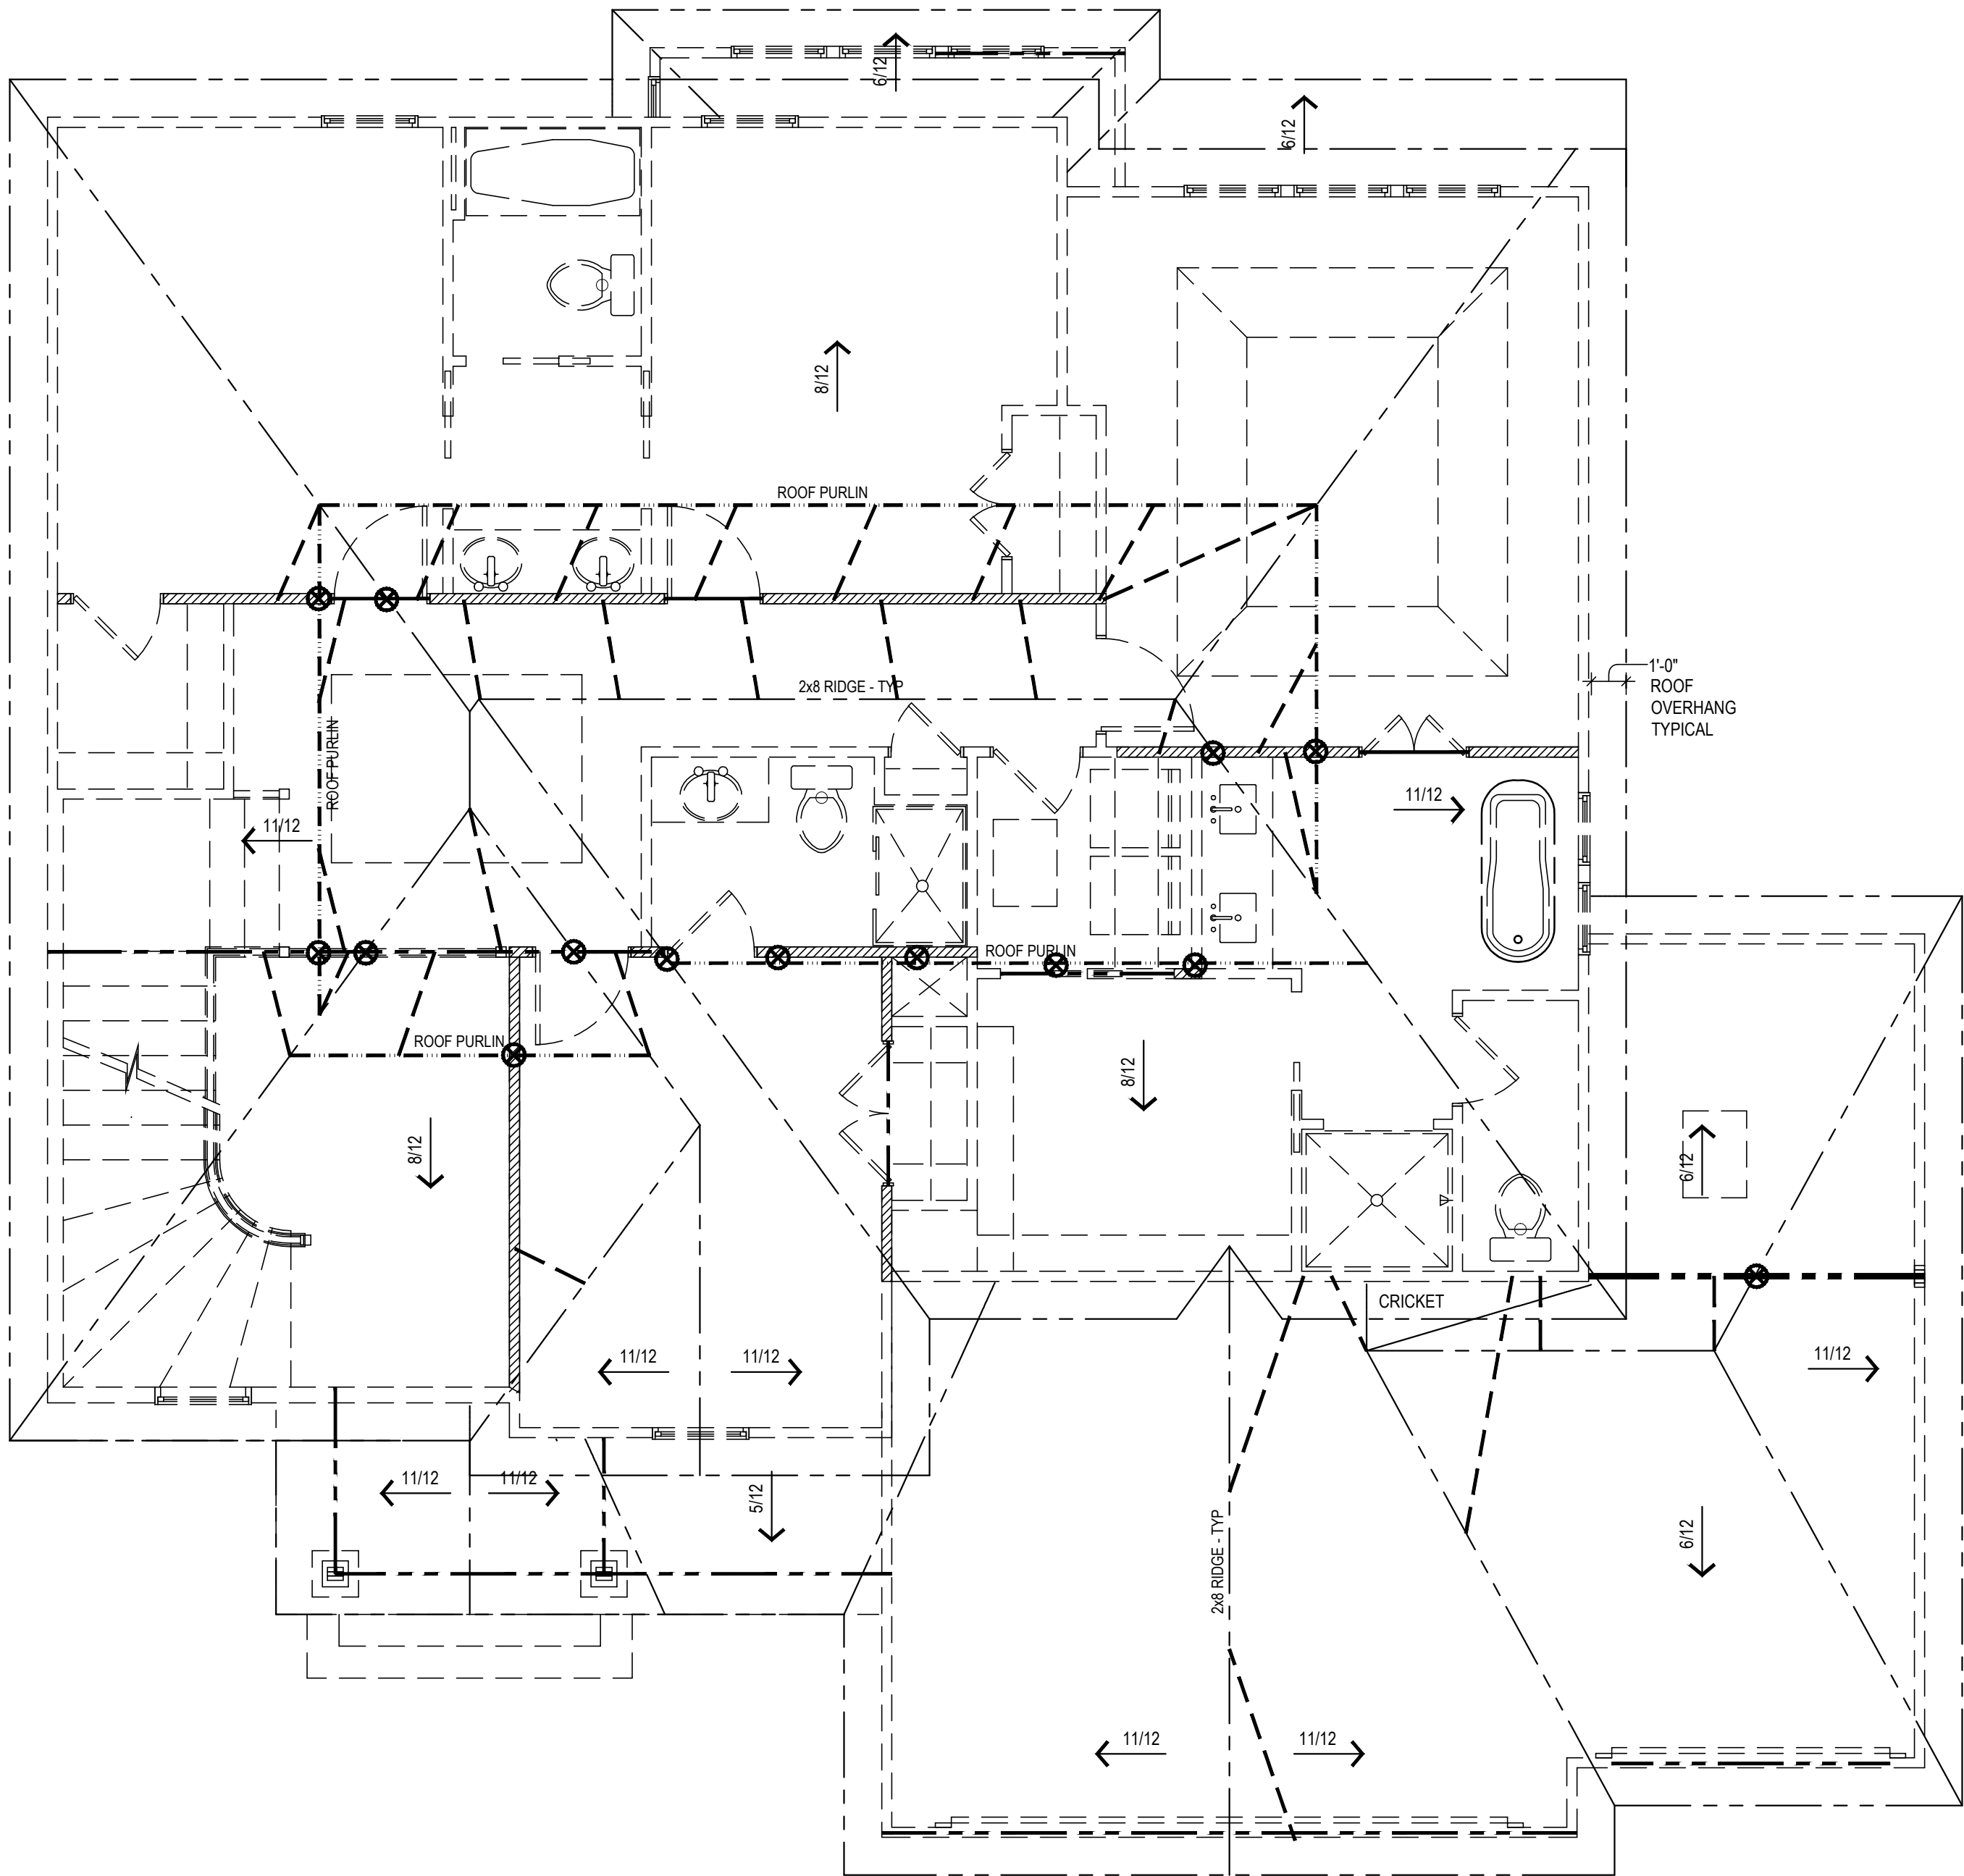

© COPYRIGHT 2021

JFE CONSTRUCTION INC.
1314 SW Market Street
Lee's Summit, MO 64081
v: 816.786.4008
jfeconstruction.com



Van Deurzen and Associates, P.A. © 2021



THE SLIVERTON III

Spec Residence
2027 SW Farmfield Court, Lee's Summit, MO
Lot 10 - Hook Farms 1st Plat

Project #: 8083-XXXX

DATE:

For Permit: 3/30/2022

Roof
Plan

A104
RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
Development Services
LEE'S SUMMIT, MISSOURI

DIVISION 1 - GENERAL REQUIREMENTS

1. Design and construction work for this project

- | | |
|------------------------------------|--------|
| Floor Dead Load | 15 PSF |
| Floor Joists Deflection (Total) | L/240 |
| Floor Joist Deflection (Live) | L/360 |
| Attic Storage (Live Loads) | 10 PSF |
| Ceiling Dead Load | 5 PSF |
| Ceiling Joists Deflection | L/240 |
| B. Roof Live Load | 20 PSF |
| C. Roof Snow Load | |
| Ground Snow Load, p_g | 20 PSF |
| Flat Roof Snow Load, p_f | 20 PSF |
| Snow Exposure Factor, C_e | 1.0 |
| Snow Load Importance Factor, I_s | 1.0 |
| Thermal Envelope, C_t | 1.0 |

1 The contractor shall employ the services of a geotechnical engineer to observe, test and approve.


ITEM	DESCRIPTION OF BUILDING ELEMENTS	NUMBER AND TYPE OF FASTENERS ^{1,2,3,4,5,6}		SPACING AND LOCATION
		COMMON NAIL	PNEUMATIC NAIL	
ROOF				
1	Blocking between ceiling joists or rafter to top plate	(4) 8d box (3) 8d common (3) 10d box	(4) 2 1/2" x 0.113" (3) 2 1/2" x 0.131" (3) 3" x 0.128" (3) 3" x 0.131"	Toe nail
2	Ceiling joists to top plate	(4) 8d box (3) 8d common (3) 10d box	(4) 2 1/2" x 0.113" (3) 2 1/2" x 0.131" (3) 3" x 0.128" (3) 3" x 0.131"	Per joist, toe nail
3	Ceiling joist not attached to parallel rafter, laps over partitions	(4) 10d box (3) 16d common	(4) 3" x 0.128" (3) 3 1/2" x 0.162" (3) 3" x 0.131"	Face nail
4	Ceiling joist attached to parallel rafter (heel joint) Note: Fasteners listed IRC Table R602.5.2 assuming 16" C Joists & spans less than 12'-0"	(3) 16d common @ slopes greater than 4:12 (5) 16d common @ slopes 4:12 or less	(3) 3 1/2" x 0.162" @ slope > 4:12 (3) 3 1/2" x 0.162" @ slope 4:12 or less	Face nail
5	Collar tie to rafter, face nail or 11/4" x 20ga. ridge strap to rafter	(4) 10d box (3) 10d common	(4) 3" x 0.128" (3) 3" x 0.146" (4) 3" x 0.128" (4) 3" x 0.131"	Face nail each rafter
6	Rafter or roof truss to plate	(3) 16d box (3) 10d common (4) 10d box	(4) 3" x 0.135" (3) 3" x 0.146" (4) 3" x 0.128" (4) 3" x 0.131"	2 toe nails on one side and 1 toe nail on opposite side of each rafter or truss
7	Rafter to ridge, valley or hip rafter or roof rafter to rafters 2" ridge, valley or roof rafters 2" ridge beam	(4) 16d (3) 10d common (4) 10d box	(4) 3 1/2" x 0.135" (3) 3 1/2" x 0.146" (4) 3" x 0.128" (4) 3" x 0.131"	Toe nail
		(3) 16d box (2) 16d common (3) 10d box	(3) 3 1/2" x 0.135" (2) 3 1/2" x 0.162" (3) 3" x 0.128" (3) 3" x 0.131"	End nail
WALL				
8	Stud to stud (not at braced wall panels)	16d common 10d box	3 1/2" x 0.162" 3" x 0.128" 3" x 0.131"	24" face nail 16" face nail
9	Stud to stud and abutting studs at intersecting wall corners (at braced wall panels)	16d box 16d common	3 1/2" x 0.135" 3" x 0.131"	16" face nail
10	Build-up header (2" to 2" header with 1/2" spacer)	16d common 16d box	3 1/2" x 0.162" 3 1/2" x 0.135"	16" each edge face nail 12" each edge face nail
11	Continuous header to stud	(5) 8d box (4) 8d common (4) 10d box	(5) 2 1/2" x 0.113" (4) 2 1/2" x 0.131" (4) 3" x 0.128"	Toe nail
12	Top plate to top plate	16d common 10d box	3 1/2" x 0.162" 3" x 0.128" 3" x 0.131"	16" face nail 12" face nail
	Double top plate splice for SDCs A-D2 with seismic braced wall line spacing < 25'	(8) 16d common (12) 16d box	(8) 3 1/2" x 0.162" (12) 3 1/2" x 0.135" (12) 3" x 0.128"	Face nail on each side of end joint (minimum 24" lap splice length each side of end joint)
	Double top plate splice SDCs D0, D1, or D2; and braced wallline spacing ≥ 25'	(12) 16d	(12) 3 1/2" x 0.135"	
14	Bottom plate to joist, rim joist, band joist or blocking (not at braced wall panels)	16d common 16d box	3 1/2" x 0.162" 3 1/2" x 0.135" 3" x 0.131"	16" face nail 12" face nail
15	Bottom plate to joist, rim joist, band joist or blocking (at braced wall panel)	(3) 16d box (2) 16d common	(3) 3 1/2" x 0.162" (2) 3 1/2" x 0.135" (3) 3" x 0.131"	3 each 16" face nail 2 each 16" face nail 4 each 16" face nail
16	Top or bottom plate to stud	(4) 8d box (3) 16d box (4) 8d common (4) 10d box	(4) 2 1/2" x 0.113" (3) 3 1/2" x 0.135" (4) 2 1/2" x 0.131" (4) 3" x 0.128"	Toe nail
		(3) 16d box (2) 16d common (3) 10d box	(3) 3" x 0.131" (2) 3 1/2" x 0.162" (3) 3" x 0.128" (3) 3" x 0.131"	End nail
17	Top plates, laps at corners and intersections	(3) 10d box (2) 16d common	(3) 3" x 0.128" (2) 3 1/2" x 0.162" (3) 3" x 0.131"	Face nail
18	1" brace to each stud and plate	(3) 8d box (2) 8d common (2) 10d box (2) Staples	(3) 2 1/2" x 0.113" (2) 2 1/2" x 0.131" (3) 3" x 0.128"	Face nail
19	1" x 6" sheathing to each bearing	(3) 8d box (2) 8d common (2) 10d box (2) Staples	(3) 2 1/2" x 0.113" (2) 2 1/2" x 0.131" (2) 3" x 0.128"	Face nail
20	1" x 8" and wider sheathing to each bearing	(3) 8d box (3) 8d common (3) 10d box (3) Staples	(3) 2 1/2" x 0.113" (3) 2 1/2" x 0.131" (3) 3" x 0.128"	Face nail
	Wider than 1" x 8"	(4) 8d box (3) 8d common (3) 10d box (4) Staples	(4) 2 1/2" x 0.113" (3) 2 1/2" x 0.131" (3) 3" x 0.128"	

[illegible]

1. All miscellaneous structural steel work shall conform to the requirements of AISC "Specifications for Structural Steel Buildings."

- of Wood Construction"; TPI "Design Specifications for Light Metal Plate Connected Wood Trusses"

Building Code.

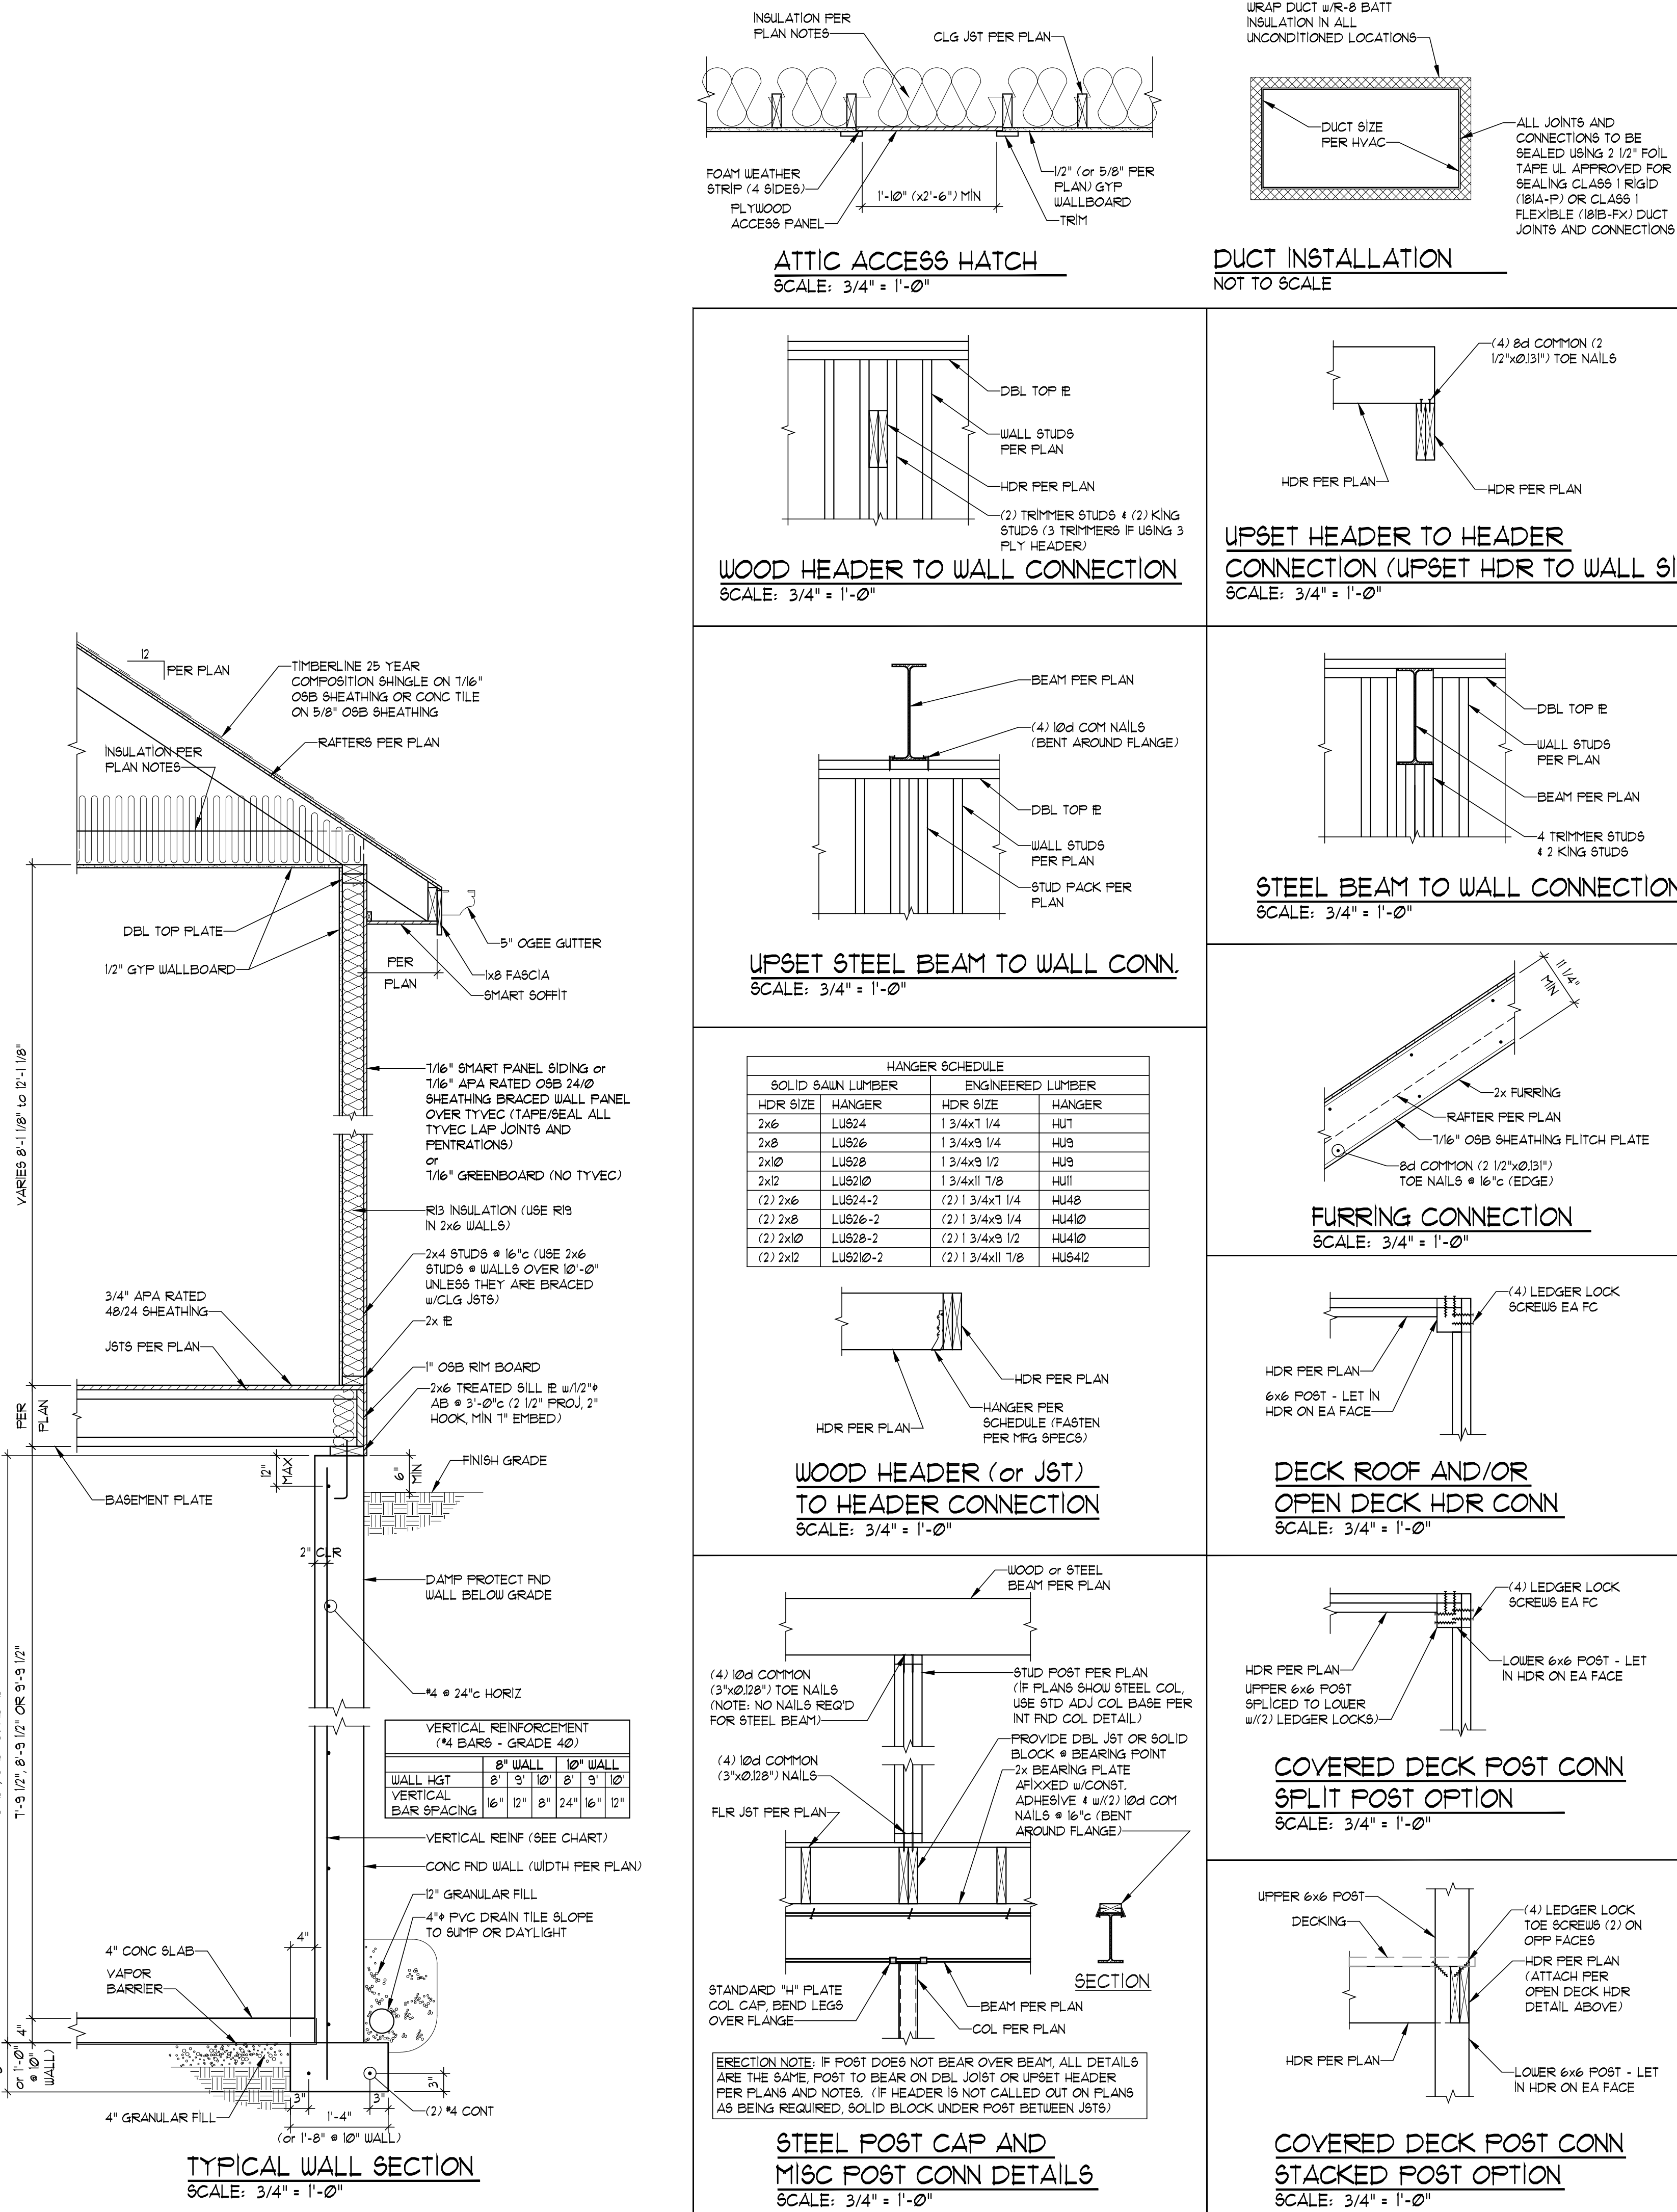



THE SLIVERTON III

Spec Residence
2027 SW Farmfield Court, Lee's Summit
Lot 10 - Hook Farms 1st Plat

DATE _____

Grooming Notes

and Details

RELEASE FOR
CONSTRUCTION

LEE'S SUMMIT, MISSOURI



THE SLIVERTON III

Spec Residence
2027 SW Farmfield Court, Lee's Summit, MO
Lot 10 - Hook Farms 1st Plat

Project #: 8083-XXXX

DATE: _____

For Permit: 3/30/2022

References


Framing Notes

and Details


0100

RELEASE FOR
CONSTRUCTION

Development Services
LEE'S SUMMIT, MISSOURI

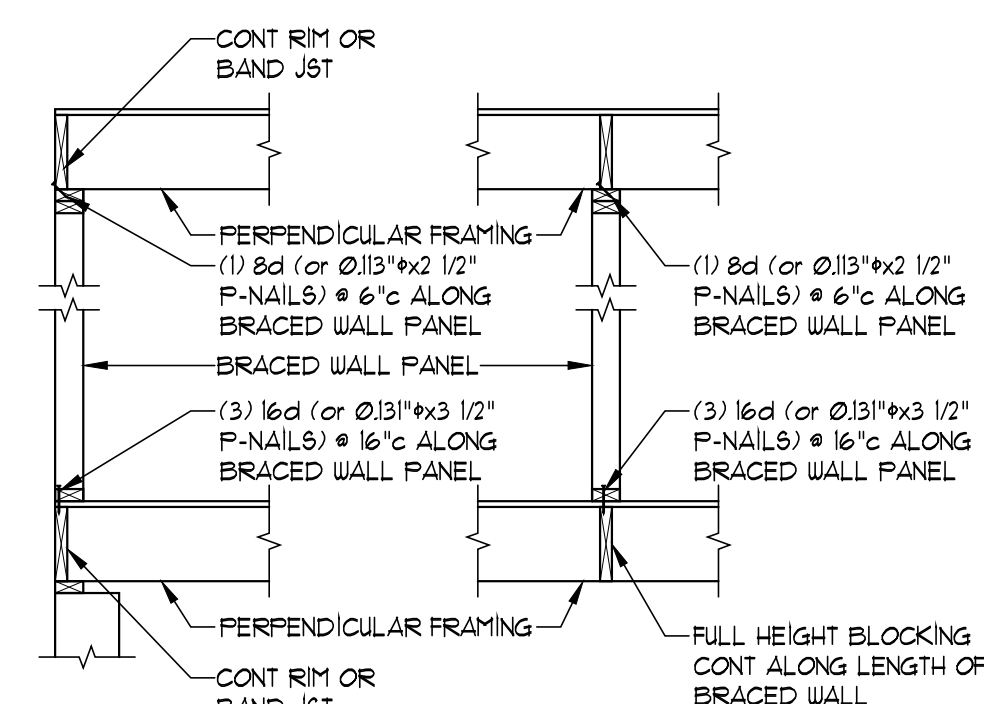

IRC FIGURE R602.10.8(1)
BRACED WALL PANEL CONNECTION WHEN
PERPENDICULAR TO FLOOR/CEILING FRAMING

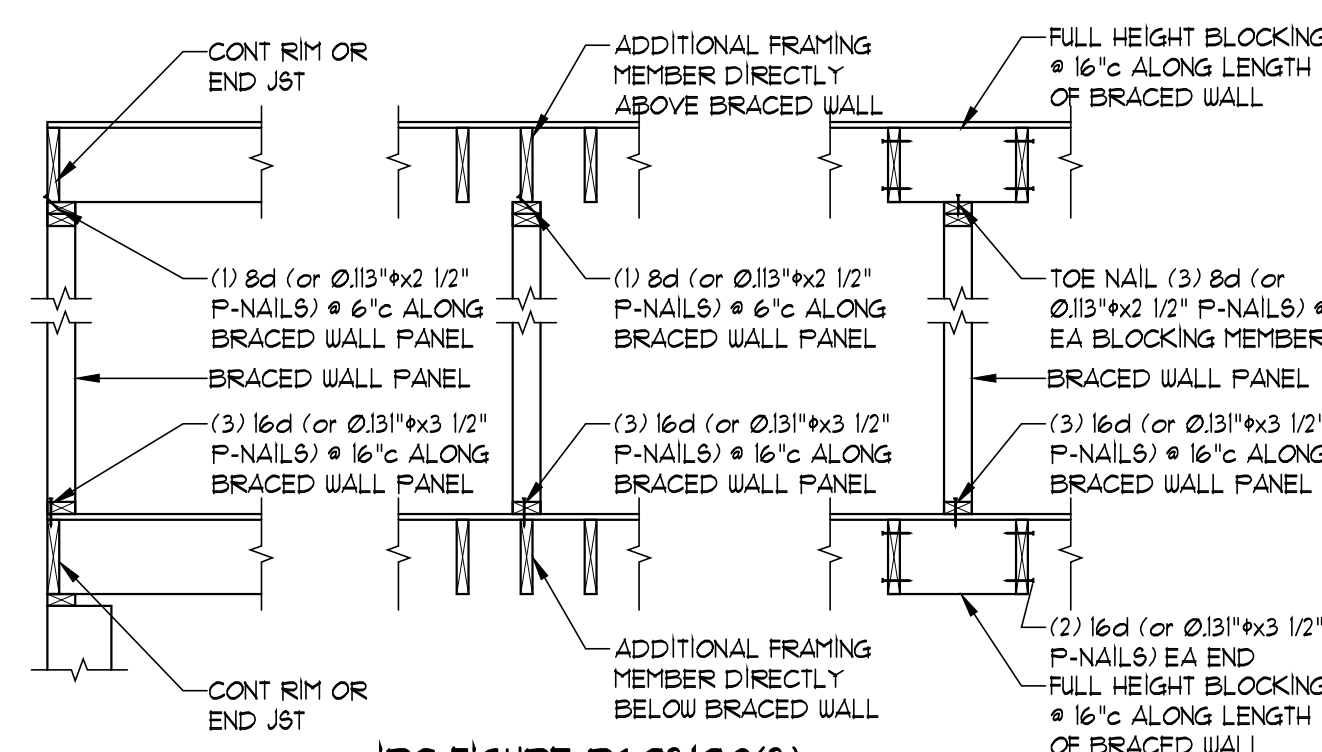

IRC FIGURE R602.10.8(2)
BRACED WALL PANEL CONNECTION WHEN
PARALLEL TO FLOOR/CEILING FRAMING:



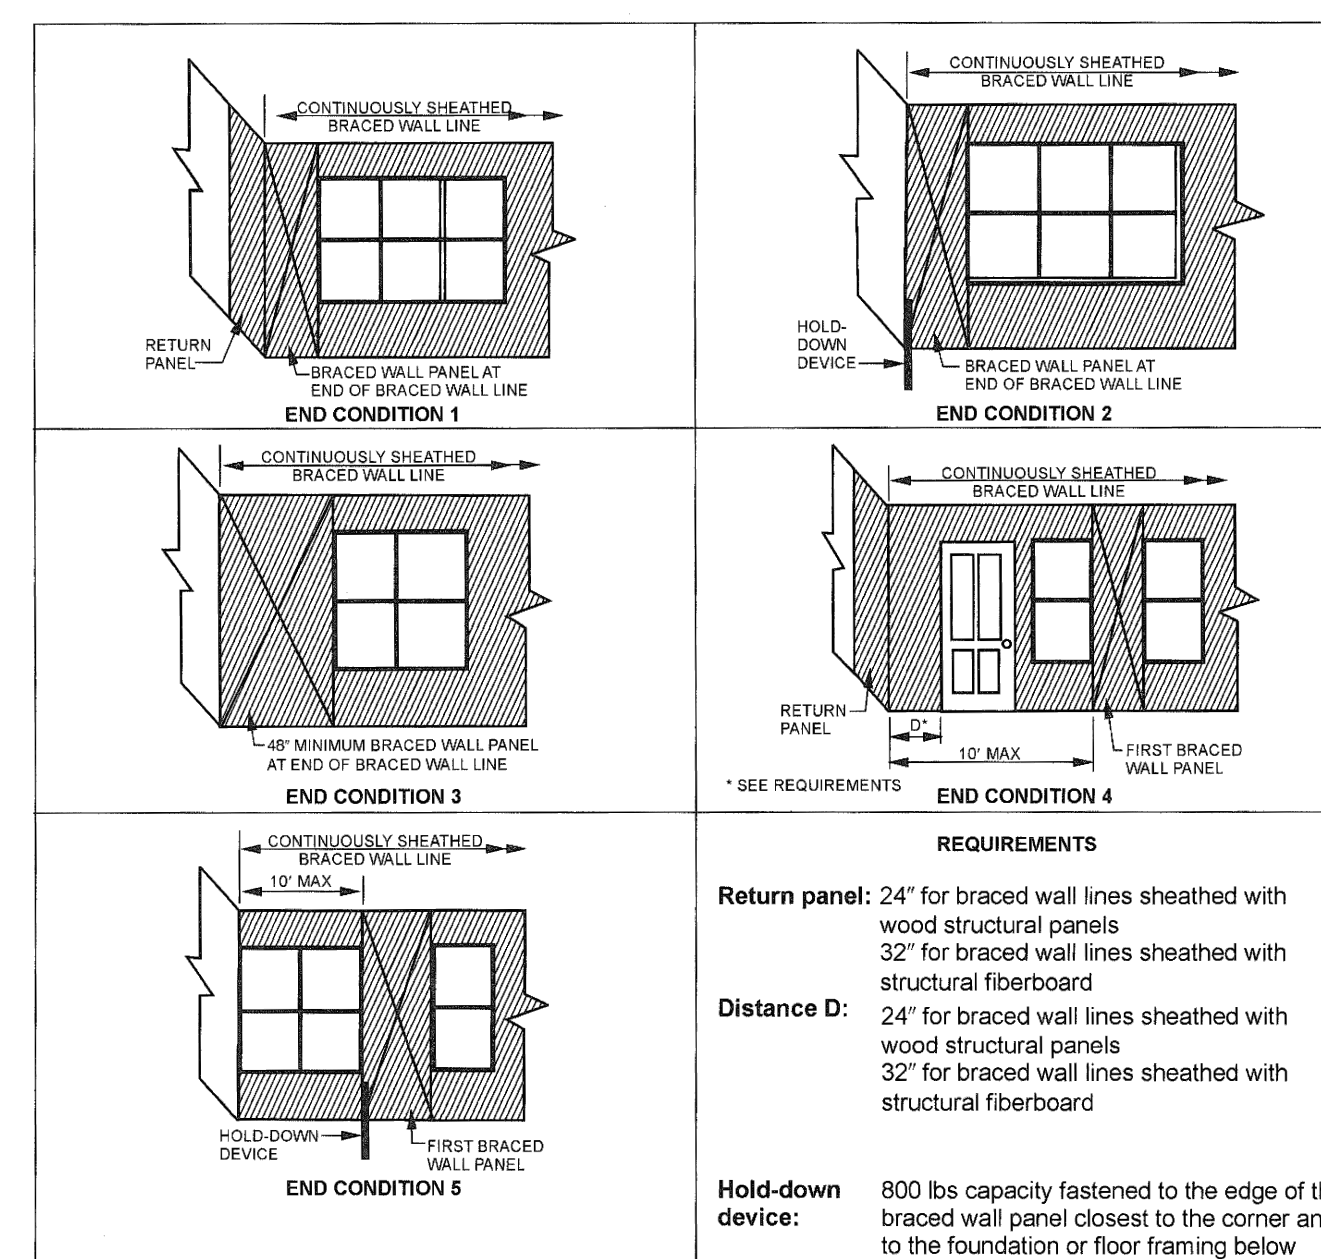



FIGURE R602.10.7
END CONDITIONS FOR BRACED WALL LINES WITH CONTINUOUS SHEATHING

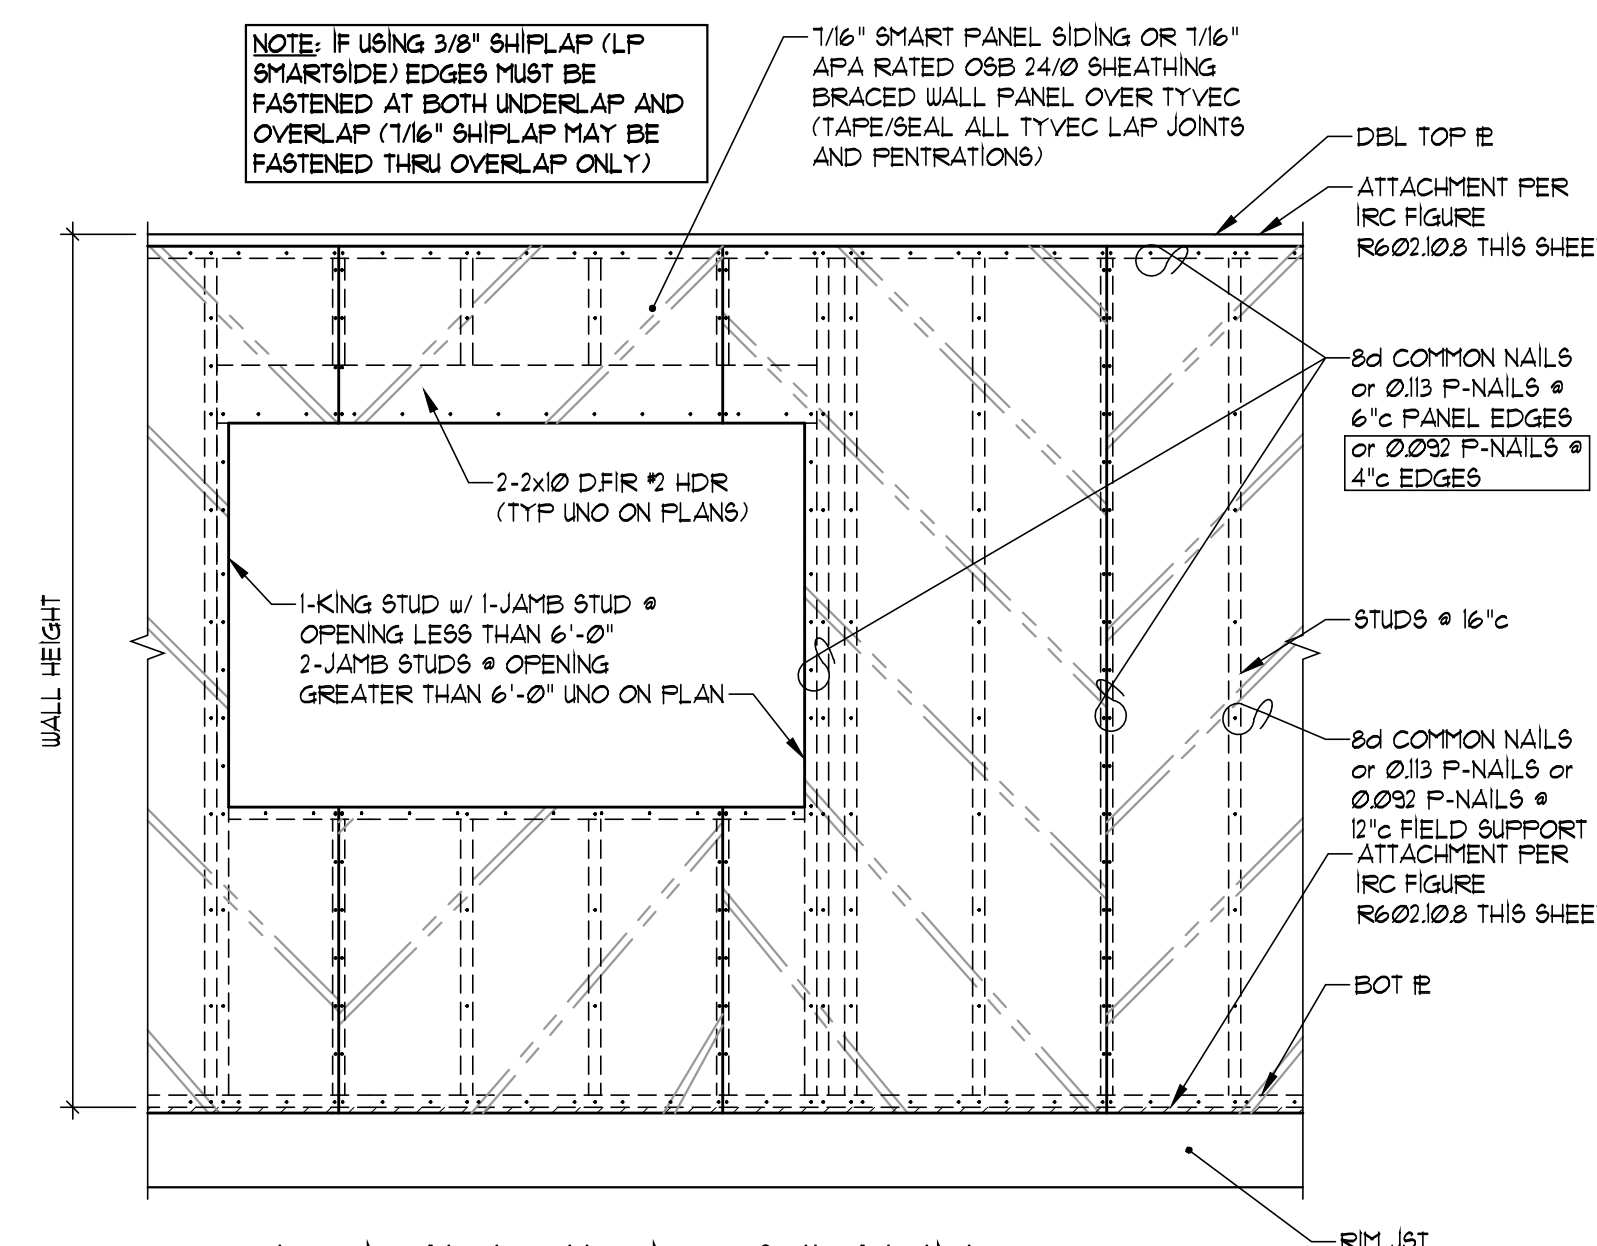

TYPICAL EXTERIOR SHEATHING
INSTALLATION (METHOD WSP & CS-WSP)
SCALE: 1/2" = 1'-0"

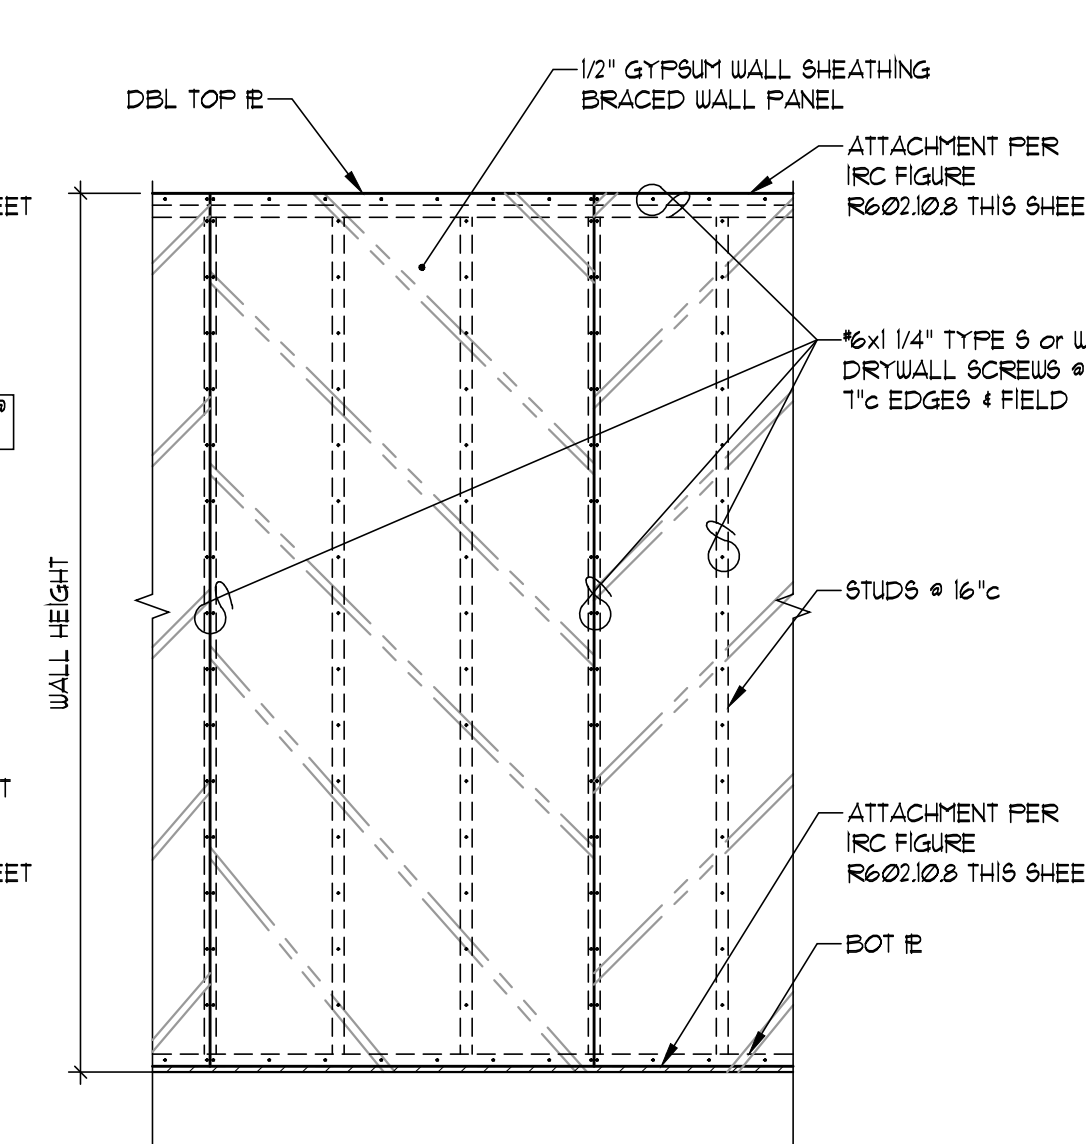


TYPICAL INTERIOR SHEATHING
INSTALLATION (METHOD GB)
SCALE: 1/2" = 1'-0"

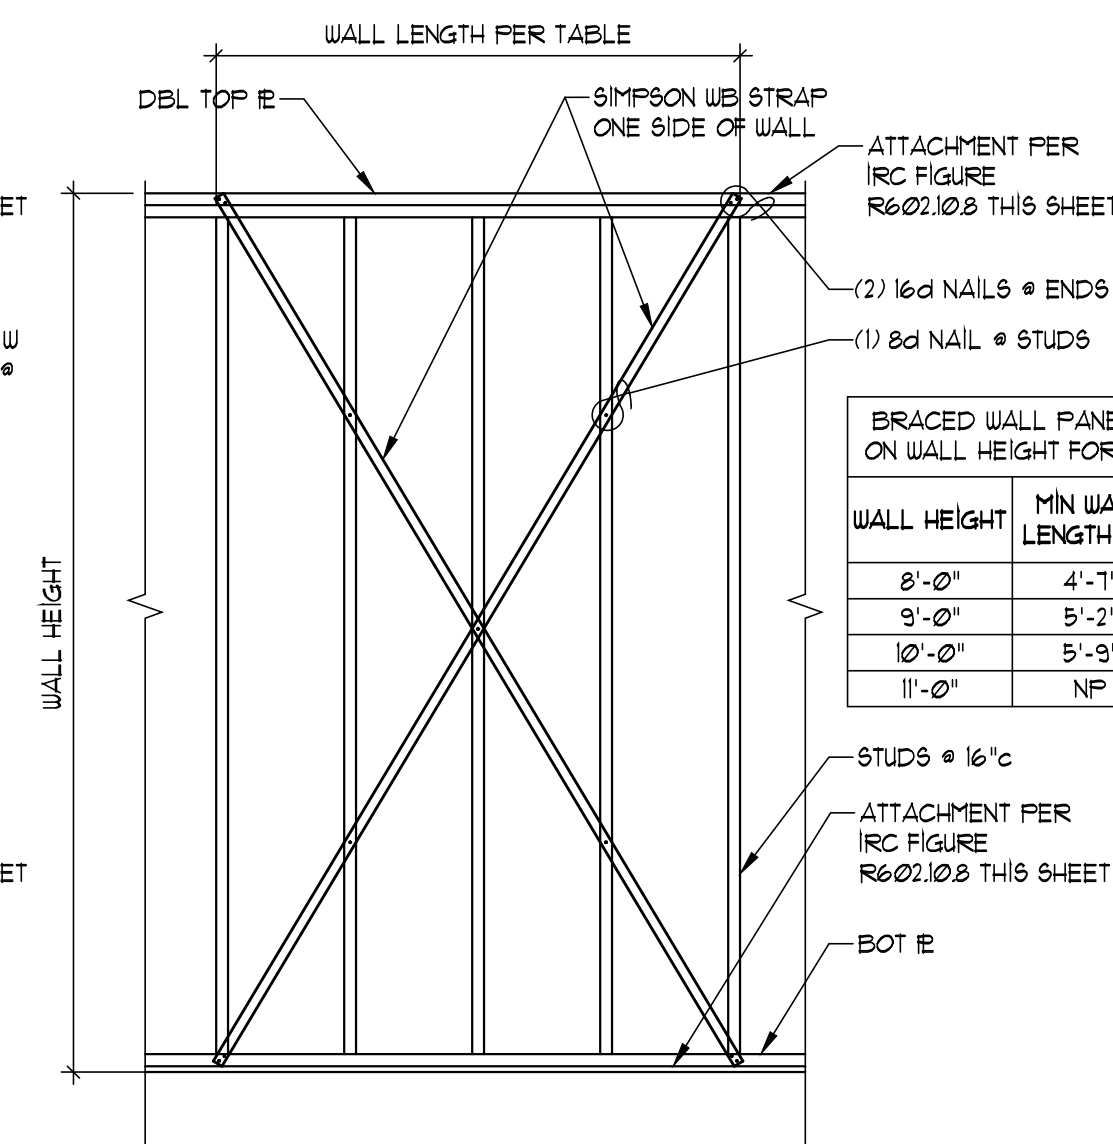


INTERIOR SHEATHING
INSTALLATION (METHOD LIB)
SCALE: 1/2" = 1'-0"


WALL HEIGHT	MIN WALL LENGTH (X)	MAX WALL LENGTH (X)
8'-0"	4'-1"	8'-0"
9'-0"	5'-2"	9'-0"
10'-0"	5'-9"	10'-0"
11'-0"	NP	NP

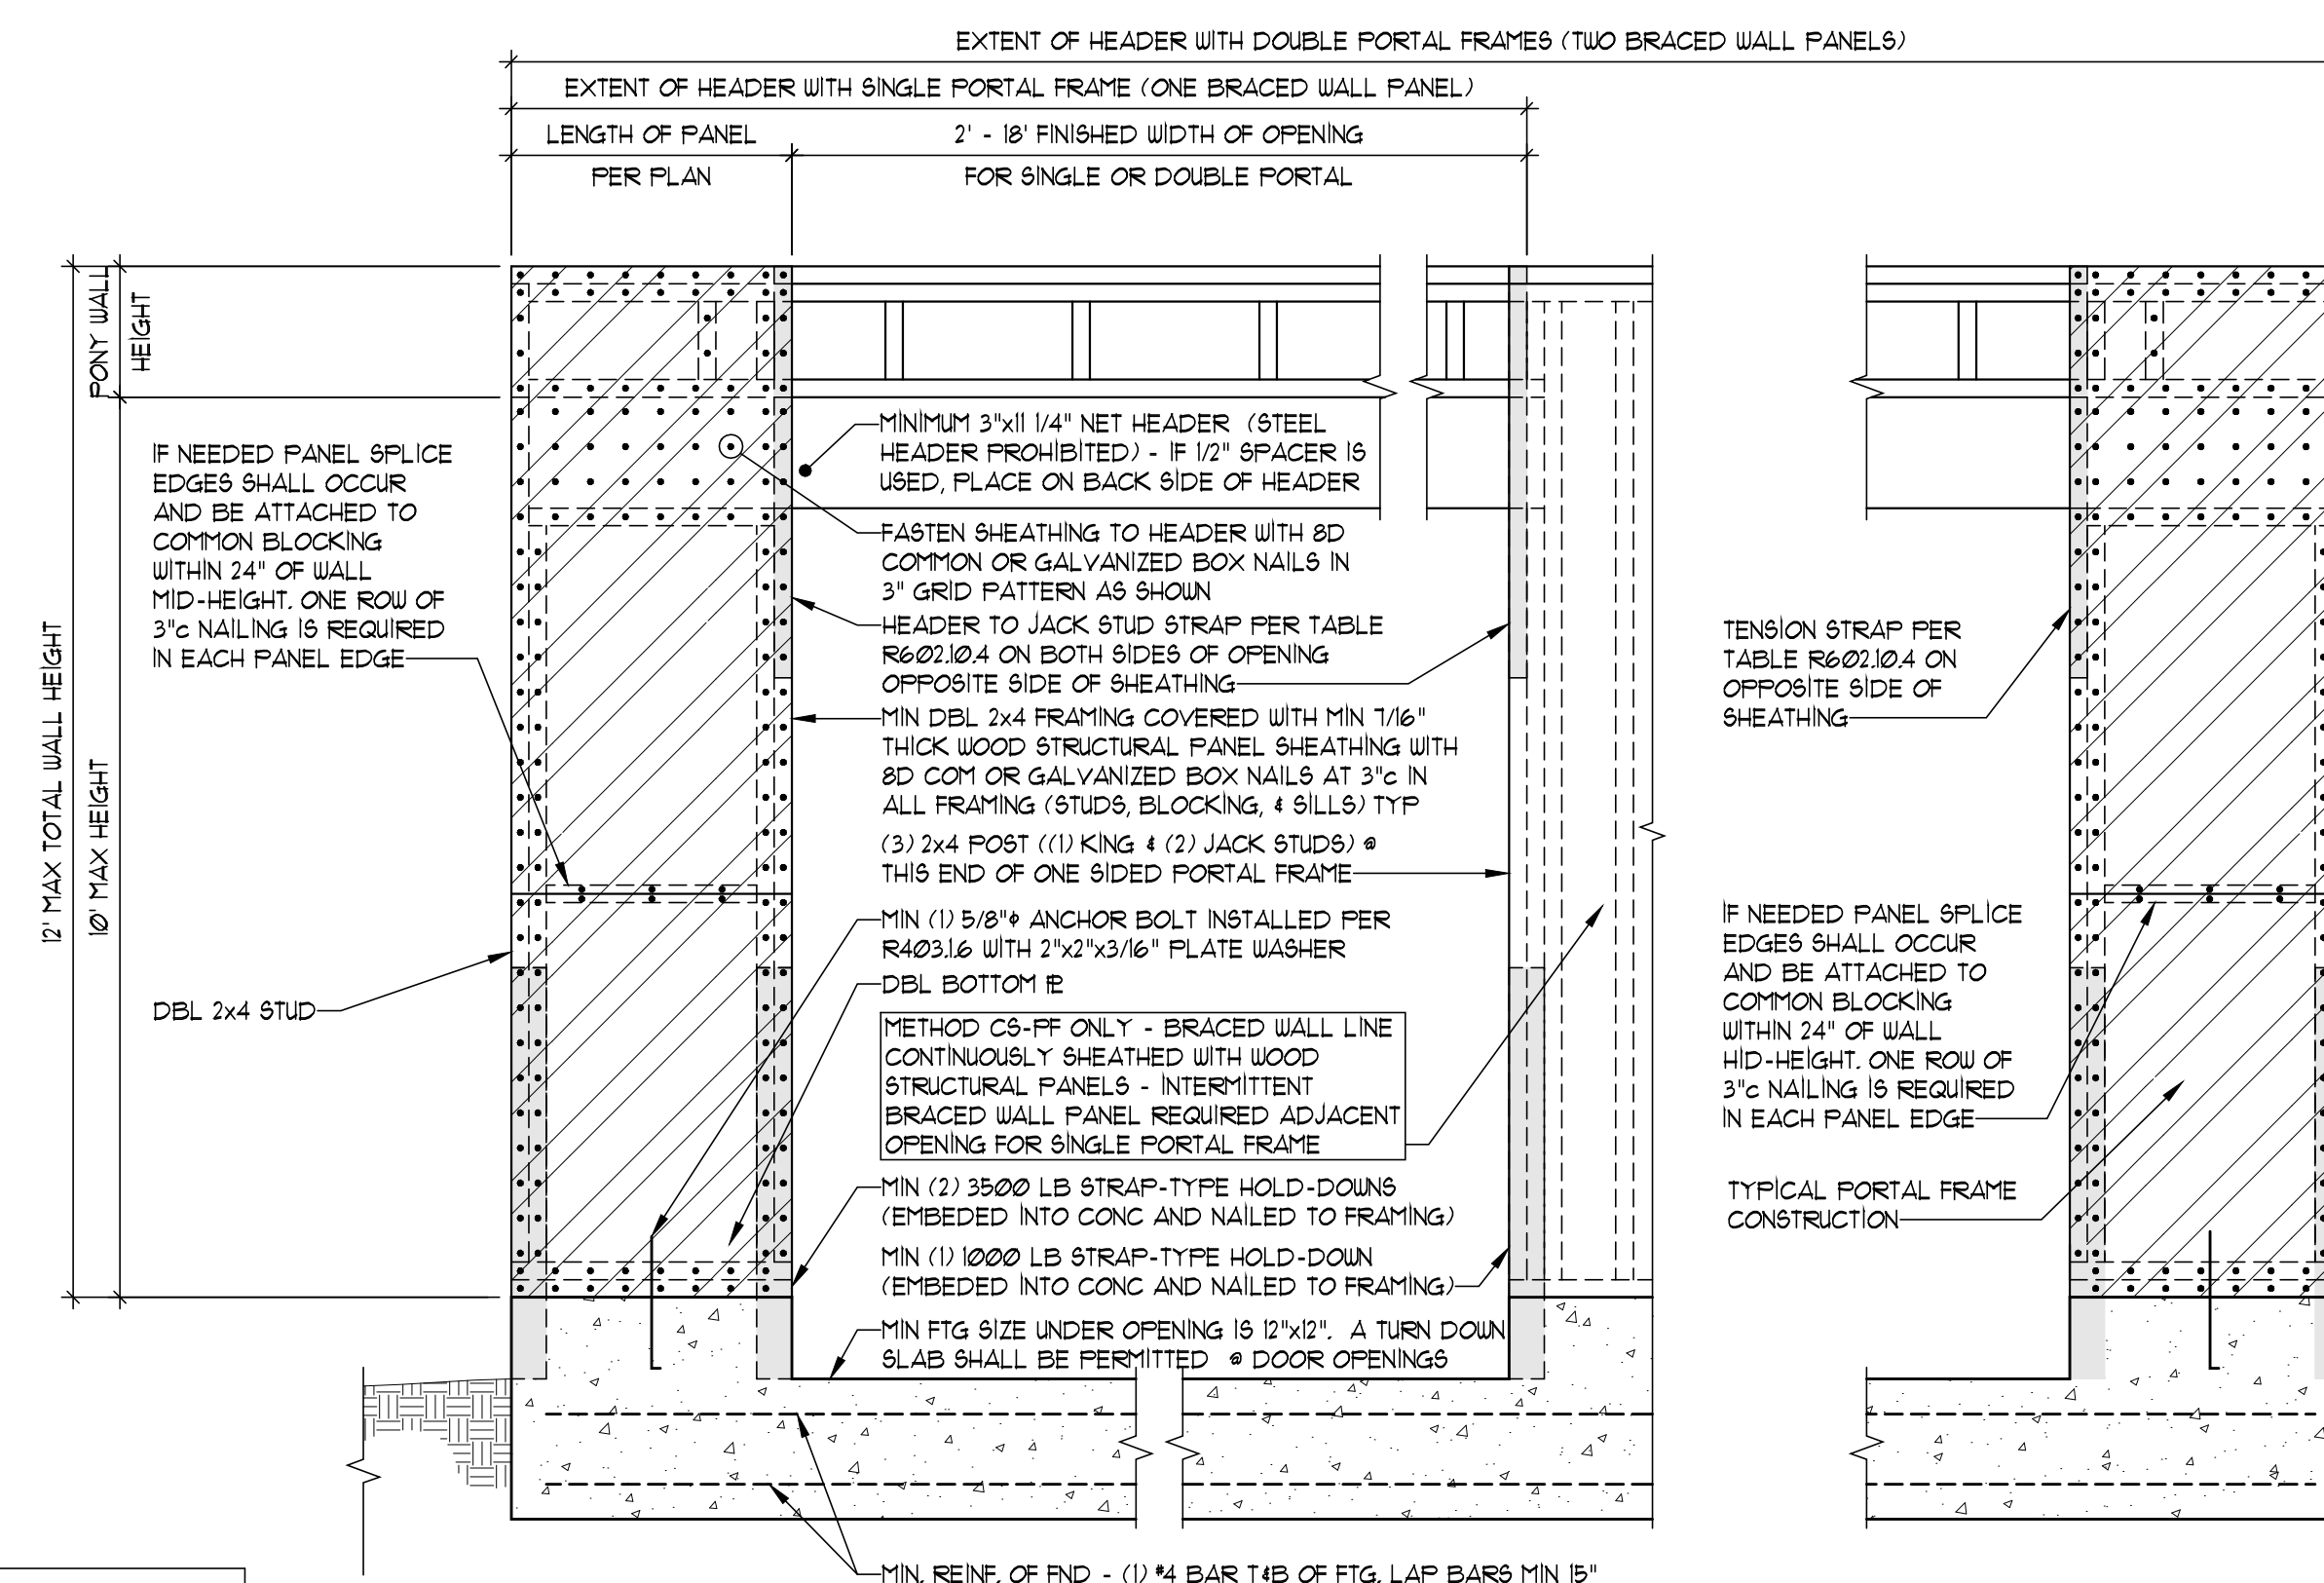


BRACED WALL METHOD "PFH" (also HEADER ATTACHMENT FOR CS-PF)

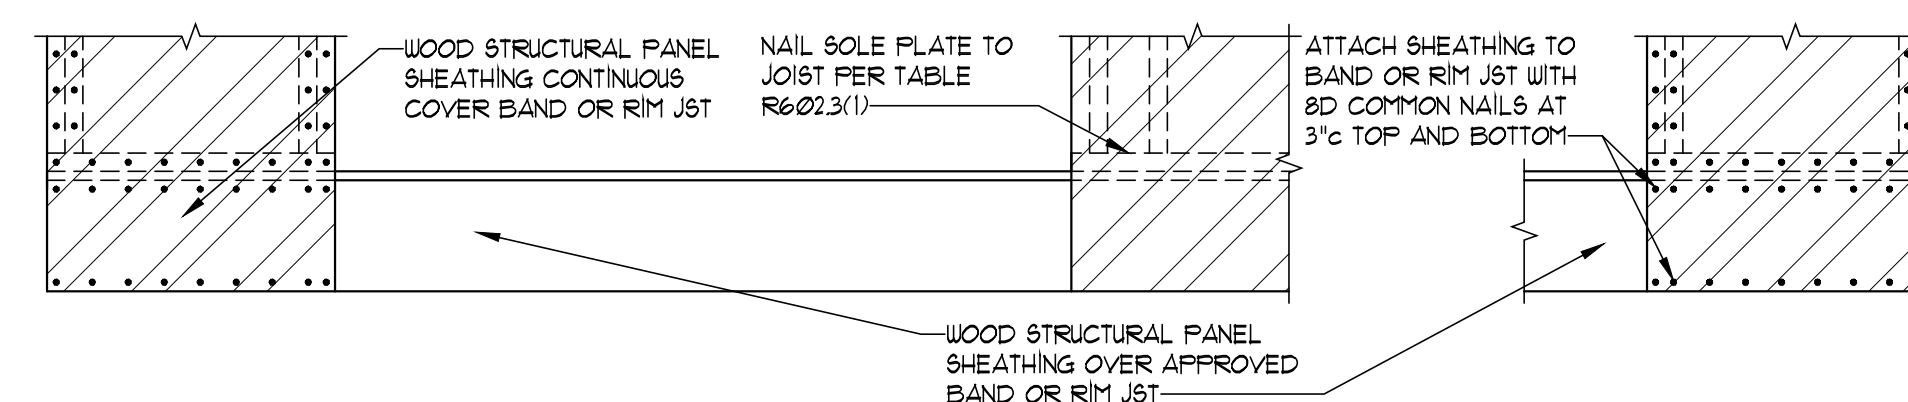

BRACED WALL METHOD "CS-PF" (ATTACHMENT TO WOOD FLOOR.
(REFER TO BRACED WALL METHOD "PFH" FOR HEADER ATTACH)
 SCALE: 3/4"=1'-0"

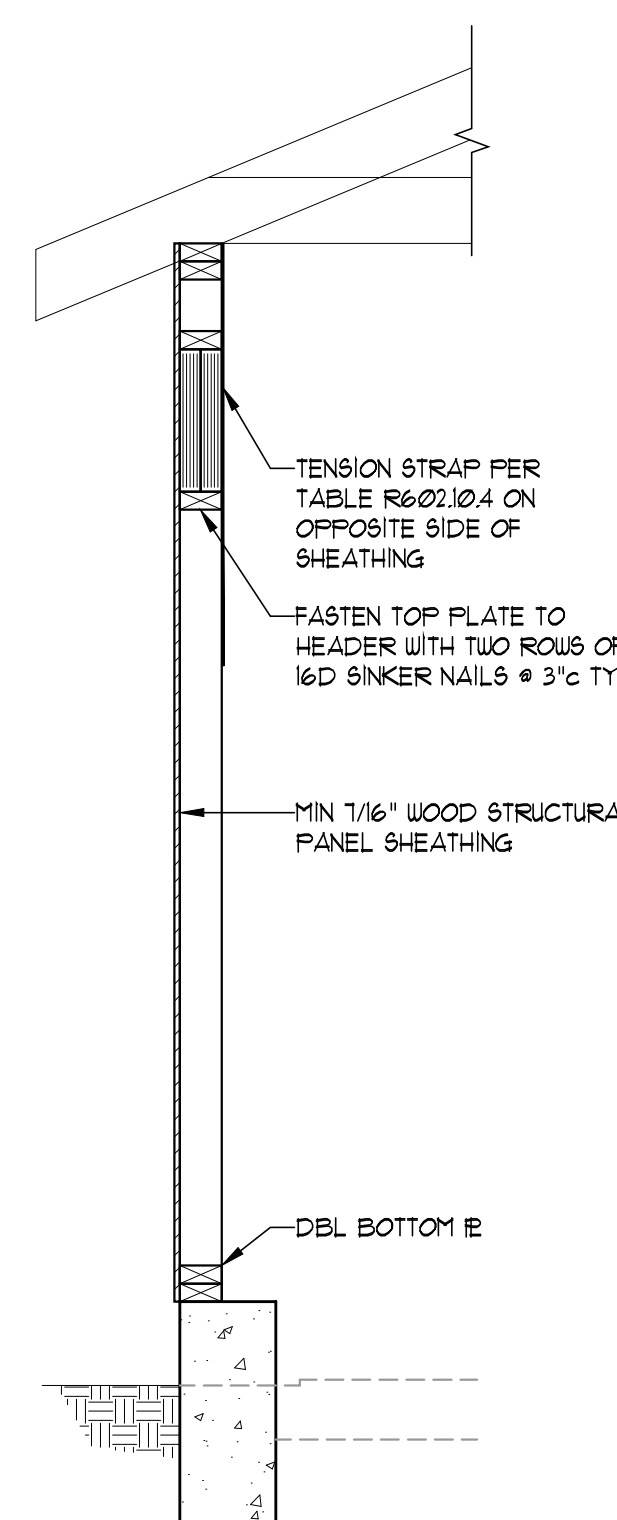

SECTION

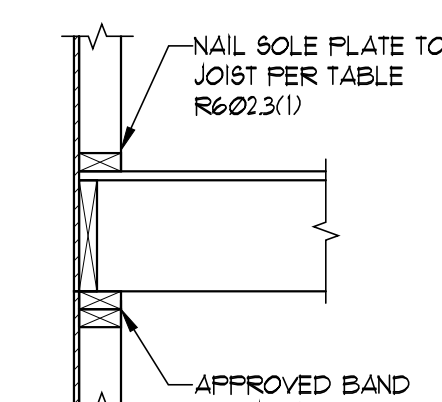

SECTION

MINIMUM WALL STUD FRAMING NOMINAL SIZE AND GAGE	MAXIMUM PONY WALL HEIGHT (FEET)	MAXIMUM TOTAL WALL HEIGHT (FEET)	MAXIMUM OPENING WIDTH (FEET)	TENSION STRAP CAPACITY REQUIRED (LBS) FOR $V_{sk} = 15$ mph	
				EXPOSURE B	EXPOSURE C
2x4 #2 GRADE	0	10	18	1,000	1,000
			9	1,000	1,000
			16	1,025	2,500
	1	10	18	1,215	2,850
			9	1,000	1,815
			16	2,115	4,125
	2	12	18	2,500	DESIGN
			9	1,500	3,115
			16	3,315	DESIGN
	4	12	18	3,915	DESIGN
			9	2,150	DESIGN
			16	3,115	DESIGN
2x6 STUD GRADE	2	12	9	1,000	2,025
			16	2,150	3,615
			18	2,550	DESIGN
	4	12	9	1,150	3,125
			16	2,400	DESIGN
			18	3,800	DESIGN