



DRAWING INDEX	
A0	COVER SHEET
A1	FOUNDATION PLAN
A2	1st FLOOR PLAN
A3	ROOF PLAN
A4	ELEVATIONS
A5	ELEVATIONS
G1	GENERAL NOTES
G2	GENERAL DETAILS
G3	GENERAL DETAILS
G4	BRACED WALL DETAILS

RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
Development Services
LEE'S SUMMIT, MISSOURI

COPYRIGHT 2013
A PLACE CALLED HOME
CONSTRUCTION CO, INC.

26555 W. VALLEY PARKWAY
SUITE 110
CLATHE, KS 66061-8429
PHONE: 913-390-4663
FAX: 913-390-4664
www.WebsterArchitects.com

Webster
architects

PARK RIDGE, 6TH PLAT
1900 NE PARK RIDGE DRIVE
LEE'S SUMMIT, MO. 64064

A PLACE CALLED HOME CONSTRUCTION CO. INC.
804 SE WILLOW PLACE • 816-365-4663
BLUE SPRINGS, MO. 64014

STATE OF MISSOURI
DANIEL J. WEBSTER
REGISTERED ARCHITECT
A-5400
3/30/2022

DRAWN BY: GV
DATE: 3-29-22
PROJECT NO: 11-2021-16

SHEET NO.
A0

FLOOR PLAN - SYMBOL LEGEND	
DESCRIPTION	SYMBOL
INTERIOR LOAD BEARING WALL	
STONE OR BRICK VENEER	
JOIST SIZE AND DIRECTION	
HEADER/ BEAM	
SIZE OF MEMBER PER HEADER/ BEAM SCHEDULE	
NUMBER OF FLYS	
"U" IF UPSET	
CENTERLINE	
POINT LOAD	
APPROX. WINDOW FRAME SIZE IN FEET & INCHES (SEE GENERAL NOTES BELOW)	
SMOKE ALARM	
SMOKE & CARBON MONOXIDE ALARM	

HEADER / BEAM SCHEDULE			
MARK	LUMBER SIZE	CRIPPLE STUDS	TRIMMERS
(A)	2 x 6	1	1
(B)	2 x 8	1	1
(C)	2 x 10	1	1
(D)	2 x 12	2	1
(E)	3/4" x 1 1/4" L.V.L.	2	1
(F)	3/4" x 3 1/2" L.V.L.	2	1
(G)	3/4" x 11 3/8" L.V.L.	2	1
(H)	3/4" x 14" L.V.L.	2	1
(J)	3/4" x 16" L.V.L.	3	1
(K)	3/4" x 18" L.V.L.	3	1
(L)	3/4" x 9 1/2" L.S.L.	1	1
(M)	3/4" x 11 3/8" L.S.L.	2	1

1. BEAMS SHALL HAVE TOTAL NUMBER OF CRIPPLES AND TRIMMERS UNDER EACH END. SOLID BLOCK BELOW.

2. FOR L.V.L. BEAMS IN 2x10 FLOORS, USE 3/4" L.V.L.

FLOOR JOIST SCHEDULE					
MARK	TYPE	SUB-TYPE	SIZE	SPACING	MAX. SPAN
FJ-1	"I" JOIST (SEE NOTE)		9/12"	PER MANUFACTURER	
FJ-2	"I" JOIST (SEE NOTE)		11/10"	PER MANUFACTURER	
FJ-3	"I" JOIST (SEE NOTE)		14"	PER MANUFACTURER	
FJ-4	OPEN WEB TRUSSES		14"	PER MANUFACTURER	
FJ-5	OPEN WEB TRUSSES		16"	PER MANUFACTURER	
FJ-20	LUMBER	ACQ. TREATED	2x10	12" O.C.	16'-2"
FJ-21	LUMBER	ACQ. TREATED	2x10	16" O.C.	14'
FJ-22	LUMBER		2x8	12" O.C.	14'-2"
FJ-23	LUMBER		2x8	16" O.C.	12'-1"
FJ-24	LUMBER		2x10	12" O.C.	17'-9"
FJ-25	LUMBER		2x10	16" O.C.	15'-5"
FJ-26	LUMBER		2-2x10	16" O.C.	

NOTE: DESIGN I-JOISTS (LOADED W/ TOTAL LIVE AND DEAD LOAD) WITH A MAX. DEFLECTION OF L/360, EXCEPT BELOW BATHROOMS AND TILED AREAS WHERE THE DEFLECTION SHALL BE L/480 MAX.

CONCRETE WALL SCHEDULE				
MARK	CONCRETE WALL THICKNESS	HEIGHT	REINFORCING VERTICAL	GRADE 40 HORIZONTAL
(A)	8"	4' OR LESS	#4 @ 36" O.C.	2 - #4's
(B)	8"	4' TO 6'	#4 @ 36" O.C.	4 - #4's
(C)	8"	6' TO 8'	#4 @ 16" O.C.	4 - #4's
(D)	8"	8'	#4 @ 16" O.C.	4 - #4's
(E)	8"	9'	#4 @ 12" O.C.	5 - #4's
(F)	10"	4'	#4 @ 36" O.C.	2 - #4's
(G)	10"	8'	#4 @ 36" O.C.	4 - #4's
(H)	10"	9'	#4 @ 16" O.C.	5 - #4's
(I)	10"	10'	#4 @ 12" O.C.	6 - #4's

COLUMN & PAD SCHEDULE				
MARK	PAD SIZE	#4 BARS REQ'D EACH WAY	COLUMN SIZE (SCHEDULE 40)	MAX. LOAD
(A)	36"x36"x12"	6	3"	13.5 K
(B)	48"x48"x16"	8	3"	24.0 K
(C)	60"x60"x18"	10	3.5"	37.5 K
(D)	72"x72"x18"	12	5"	54.0 K

PIER SCHEDULE			
MARK	PIER DIAMETER	POST (ACQ OR CEDAR UNO.)	MAX. LOAD
(F)	12"	6x6 UNO.	11 K
(G)	18"	6x6 UNO.	2.6 K
(H)	24"	6x6 UNO.	4.1 K

1. PAD AND PIER SIZES ASSUME 1500 P.S.F. SOIL BEARING CAPACITY.

2. 10' MAX. STEEL COLUMN HEIGHT FROM BASE PLATE TO TOP OF COLUMN. CONSULT ARCHITECT IF SITE CONDITIONS REQUIRE TALLER COLUMNS.

GENERAL NOTES:

A. EXTERIOR FRAMED WALLS ARE 2x4 STUDS AT 16" O.C. UNLESS NOTED OTHERWISE.

B. FURNACE IS DIRECT VENT AND USES OUTSIDE AIR FOR COMBUSTION

C. FOR COVERED PATIO/PATIO FRAMING - SEE DETAIL 1/G3

D. SEE G4 SHEET FOR LOCATION OF HOLD-DOWN TIES FOR BRACED WALL PANELS

FOUNDATION PLAN NOTES

- SEE DETAIL 3/G2 FOR GARAGE SLAB CONSTRUCTION.
- SILL PLATE SET BACK - SEE DETAILs 4/5/G2
- CONCRETE PIER AND PAD - SEE DETAIL 3/G2
- RETURN WALL - SEE DETAIL 8/G2
- 16" WIDE X 8" DEEP CONCRETE FOOTING W/2-#4 BARS CONTINUOUS
- 2x4 STUDS @ 16" O.C. WITH TREATED SILL PLATE.


1. 2x6 STUDS @ 16" O.C. WITH TREATED SILL PLATE.

8. 8" LEDGE OVER 4" EXPOSED CONCRETE AND 4" FINISH WALL

9. 4" FINISHED WALL IN STAIRWELL

10. PROVIDE THERMAL EXPANSION CONTROL DEVICE.

11. SUMP PIT & PUMP. PROVIDE ELECTRICAL RECEPTACLE WITH GFCI PROTECTION. PROVIDE SLEEVE THROUGH FOOTING

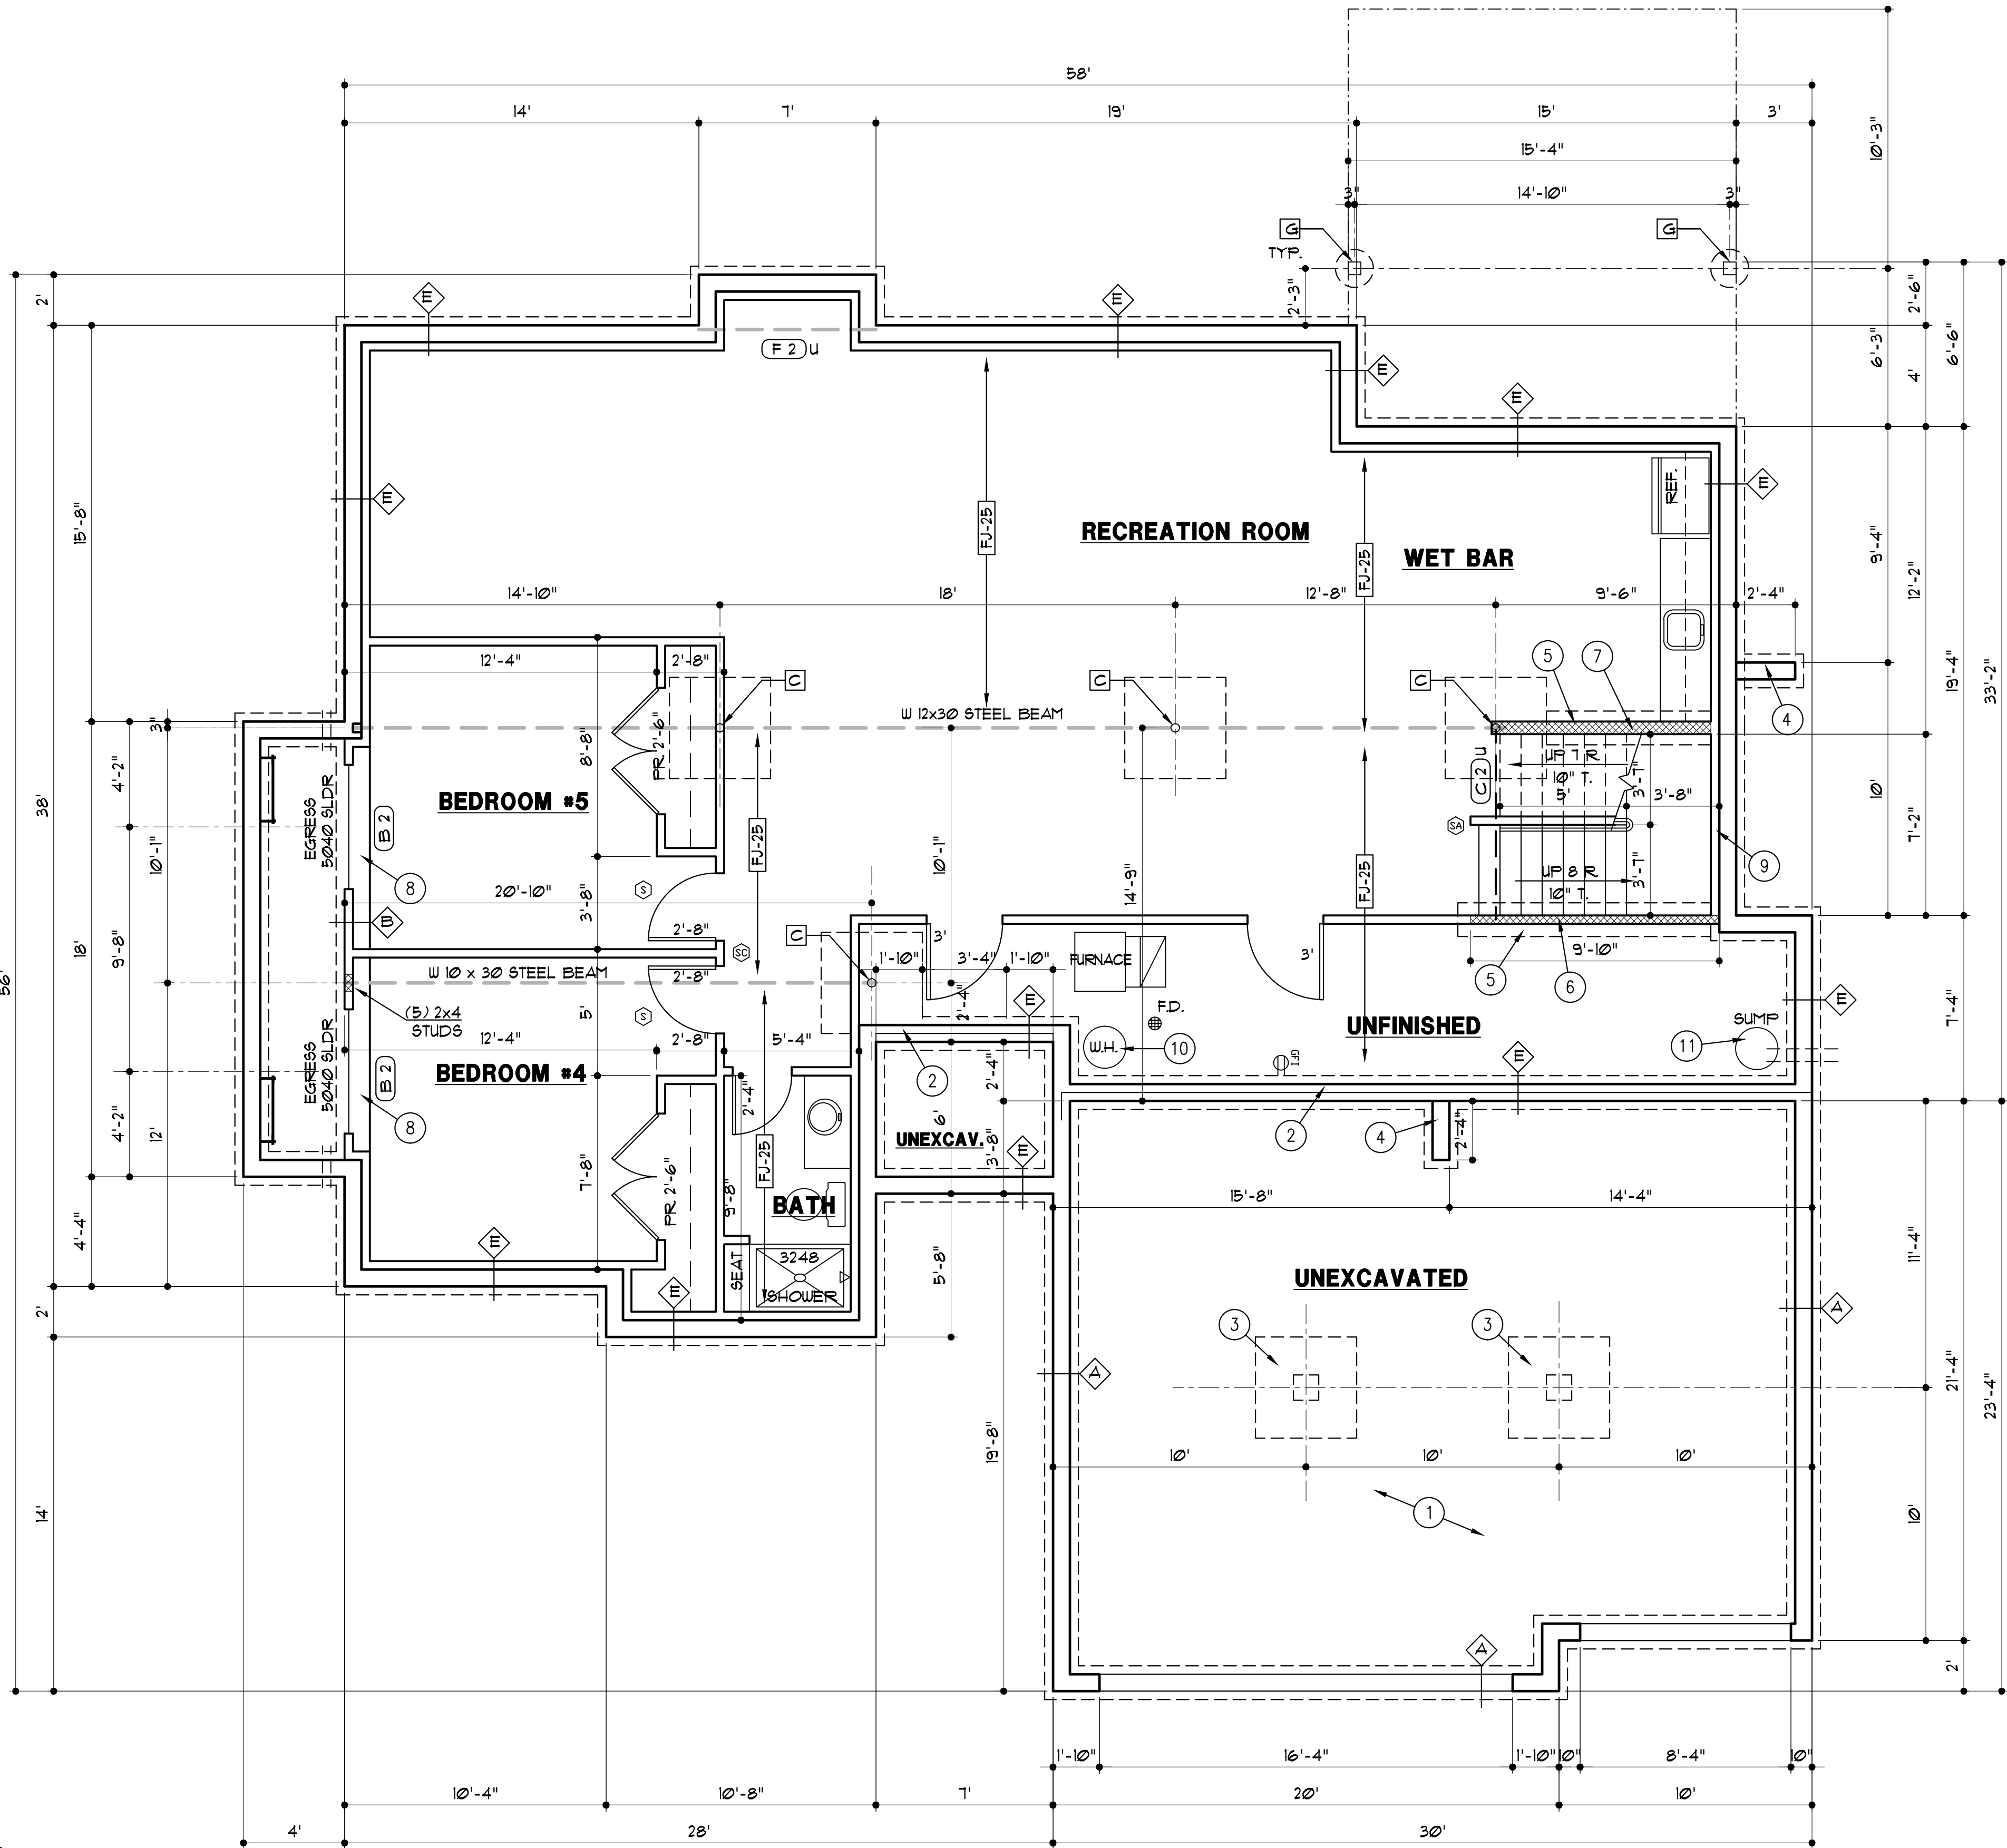

FOUNDATION PLAN
1/4" = 1'-0"

COPYRIGHT 2013
A PLACE CALLED HOME
CONSTRUCTION CO., INC.

25055 W. VALLEY PARKWAY
SUITE 110
CLATHE, KS 66061-8429
PHONE: 913-390-4663
FAX: 913-390-4664
www.websterarchitects.com

Webster
architects

PARK RIDGE, 6TH PLAT
1900 NE PARK RIDGE DRIVE
LEE'S SUMMIT, MO. 64064

A PLACE CALLED HOME CONSTRUCTION CO. INC.
804 SE WILLOW PLACE • 816-365-4663
BLUE SPRINGS, MO. 64014



DRAWN BY: GV
DATE: 3-29-22
PROJECT NO: 11-0071-16

SHEET NO. 1
RELEASER FOR
CONSTRUCTION
AS NOTED FOR PLANS REVIEW
Development Services
Missouri, MISSOURI

FLOOR PLAN - SYMBOL LEGEND	
DESCRIPTION	SYMBOL
INTERIOR LOAD BEARING WALL	
STONE OR BRICK VENEER	
JOIST SIZE AND DIRECTION	
HEADER/ BEAM	
SIZE OF MEMBER PER SCHEDULE	
NUMBER OF FLYS	
"U" IF UPSET	
CENTERLINE	
POINT LOAD	
APPROX. WINDOW FRAME SIZE IN FEET & INCHES (SEE GENERAL NOTES BELOW)	
SMOKE ALARM	
SMOKE & CARBON MONOXIDE ALARM	

HEADER / BEAM SCHEDULE			
MARK	LUMBER SIZE	CRIPPLE STUDS	TRIMMERS
(A)	2 x 6	1	
(B)	2 x 6	1	
(C)	2 x 6	1	
(D)	2 x 10	2	
(E)	3/4" x 1 1/4" L.V.L.	2	
(F)	3/4" x 3/4" L.V.L.	2	
(G)	3/4" x 1 1/8" L.V.L.	2	
(H)	3/4" x 1 1/2" L.V.L.	2	
(I)	3/4" x 1 3/4" L.V.L.	3	
(J)	3/4" x 1 3/4" L.V.L.	3	
(K)	3/4" x 3/4" L.S.L.	1	
(L)	3/4" x 1 1/2" L.S.L.	2	

1. BEAMS SHALL HAVE TOTAL NUMBER OF CRIPPLES AND TRIMMERS UNDER EACH END. SOLID BLOCK BELOW.

2. FOR L.V.L. BEAMS IN 2x10 FLOORS, USE 3/4" L.V.L.

CEILING JOISTS SCHEDULE - LIVE LOAD 10 P.S.F.			
MARK	SIZE	SPACING	MAXIMUM SPAN - DOUGLAS FIR #2
CJ-1	2x6	12"	19'-6"
CJ-2	2x6	16"	11'-8"
CJ-3	2x8	12"	25'-8"
CJ-4	2x8	16"	23'-0"
CJ-5	2x10	12"	NA
CJ-6	2x10	16"	NA
CJ-7	2x4	24"	9'-10"
CJ-8	2x6	24"	14'-10"
CJ-9	2x8	24"	18'-9"
CJ-10	2x10	24"	22'-11"


SQUARE FOOTAGE TABLE	
LOCATION	AREA (S.F.)
FIRST FLOOR	1744
BASEMENT (FINISHED STAIRS)	1515
TOTAL	3319
GARAGE	690
BASEMENT (UNFINISHED)	241
COVERED PATIO	98

GENERAL NOTES:

- EXTERIOR WALLS ARE 2x4 STUDS AT 16" O.C. UNLESS OTHERWISE NOTED.
- SOLID BLOCKING BELOW STUDS SUPPORTING BEAMS AND HEADERS.
- FOR COVERED PATIO FRAMING - SEE DETAIL 1/G3
- SEE G4 SHEET FOR LOCATION OF HOLD-DOWN TIES FOR BRACED WALL CONSTRUCTION

FLOOR PLAN NOTES

- 36" DIRECT VENT FIREPLACE
- RAISED PLATFORM FOR WASHER & DRYER
- 3 STUDS BETWEEN WINDOWS
- DOUBLE 2x4 STUD WALL
- 5' WIDE x 14" TALL TRANSOM WITH VERTICAL GRILLS 1' O.C.
- 2'-8" WIDE x 4' TALL ART NICHE. TOP OF NICHE AT 6'-10" AFF. PROVIDE FICK LIGHT
- CHANGE IN PLATE HEIGHT (SEE ELEVATION)
- BOX DOWN CEILING TO 8'-6"
- BOX DOWN CEILING TO 10'-6"
- 1'-10"x3' ATTIC ACCESS WITH 3/4" BACKER BOARD AND 2 LATCHES
- EXPOSED TOP OF FOUNDATION WALL
- 6x6 CEDAR POST
- 2x6 STUDS AT 16" O.C.
- 3" SCHEDULE 40 PIPE COLUMN WITH SOLID BLOCKING BELOW
- FUR OUT FOR 6" WALL.

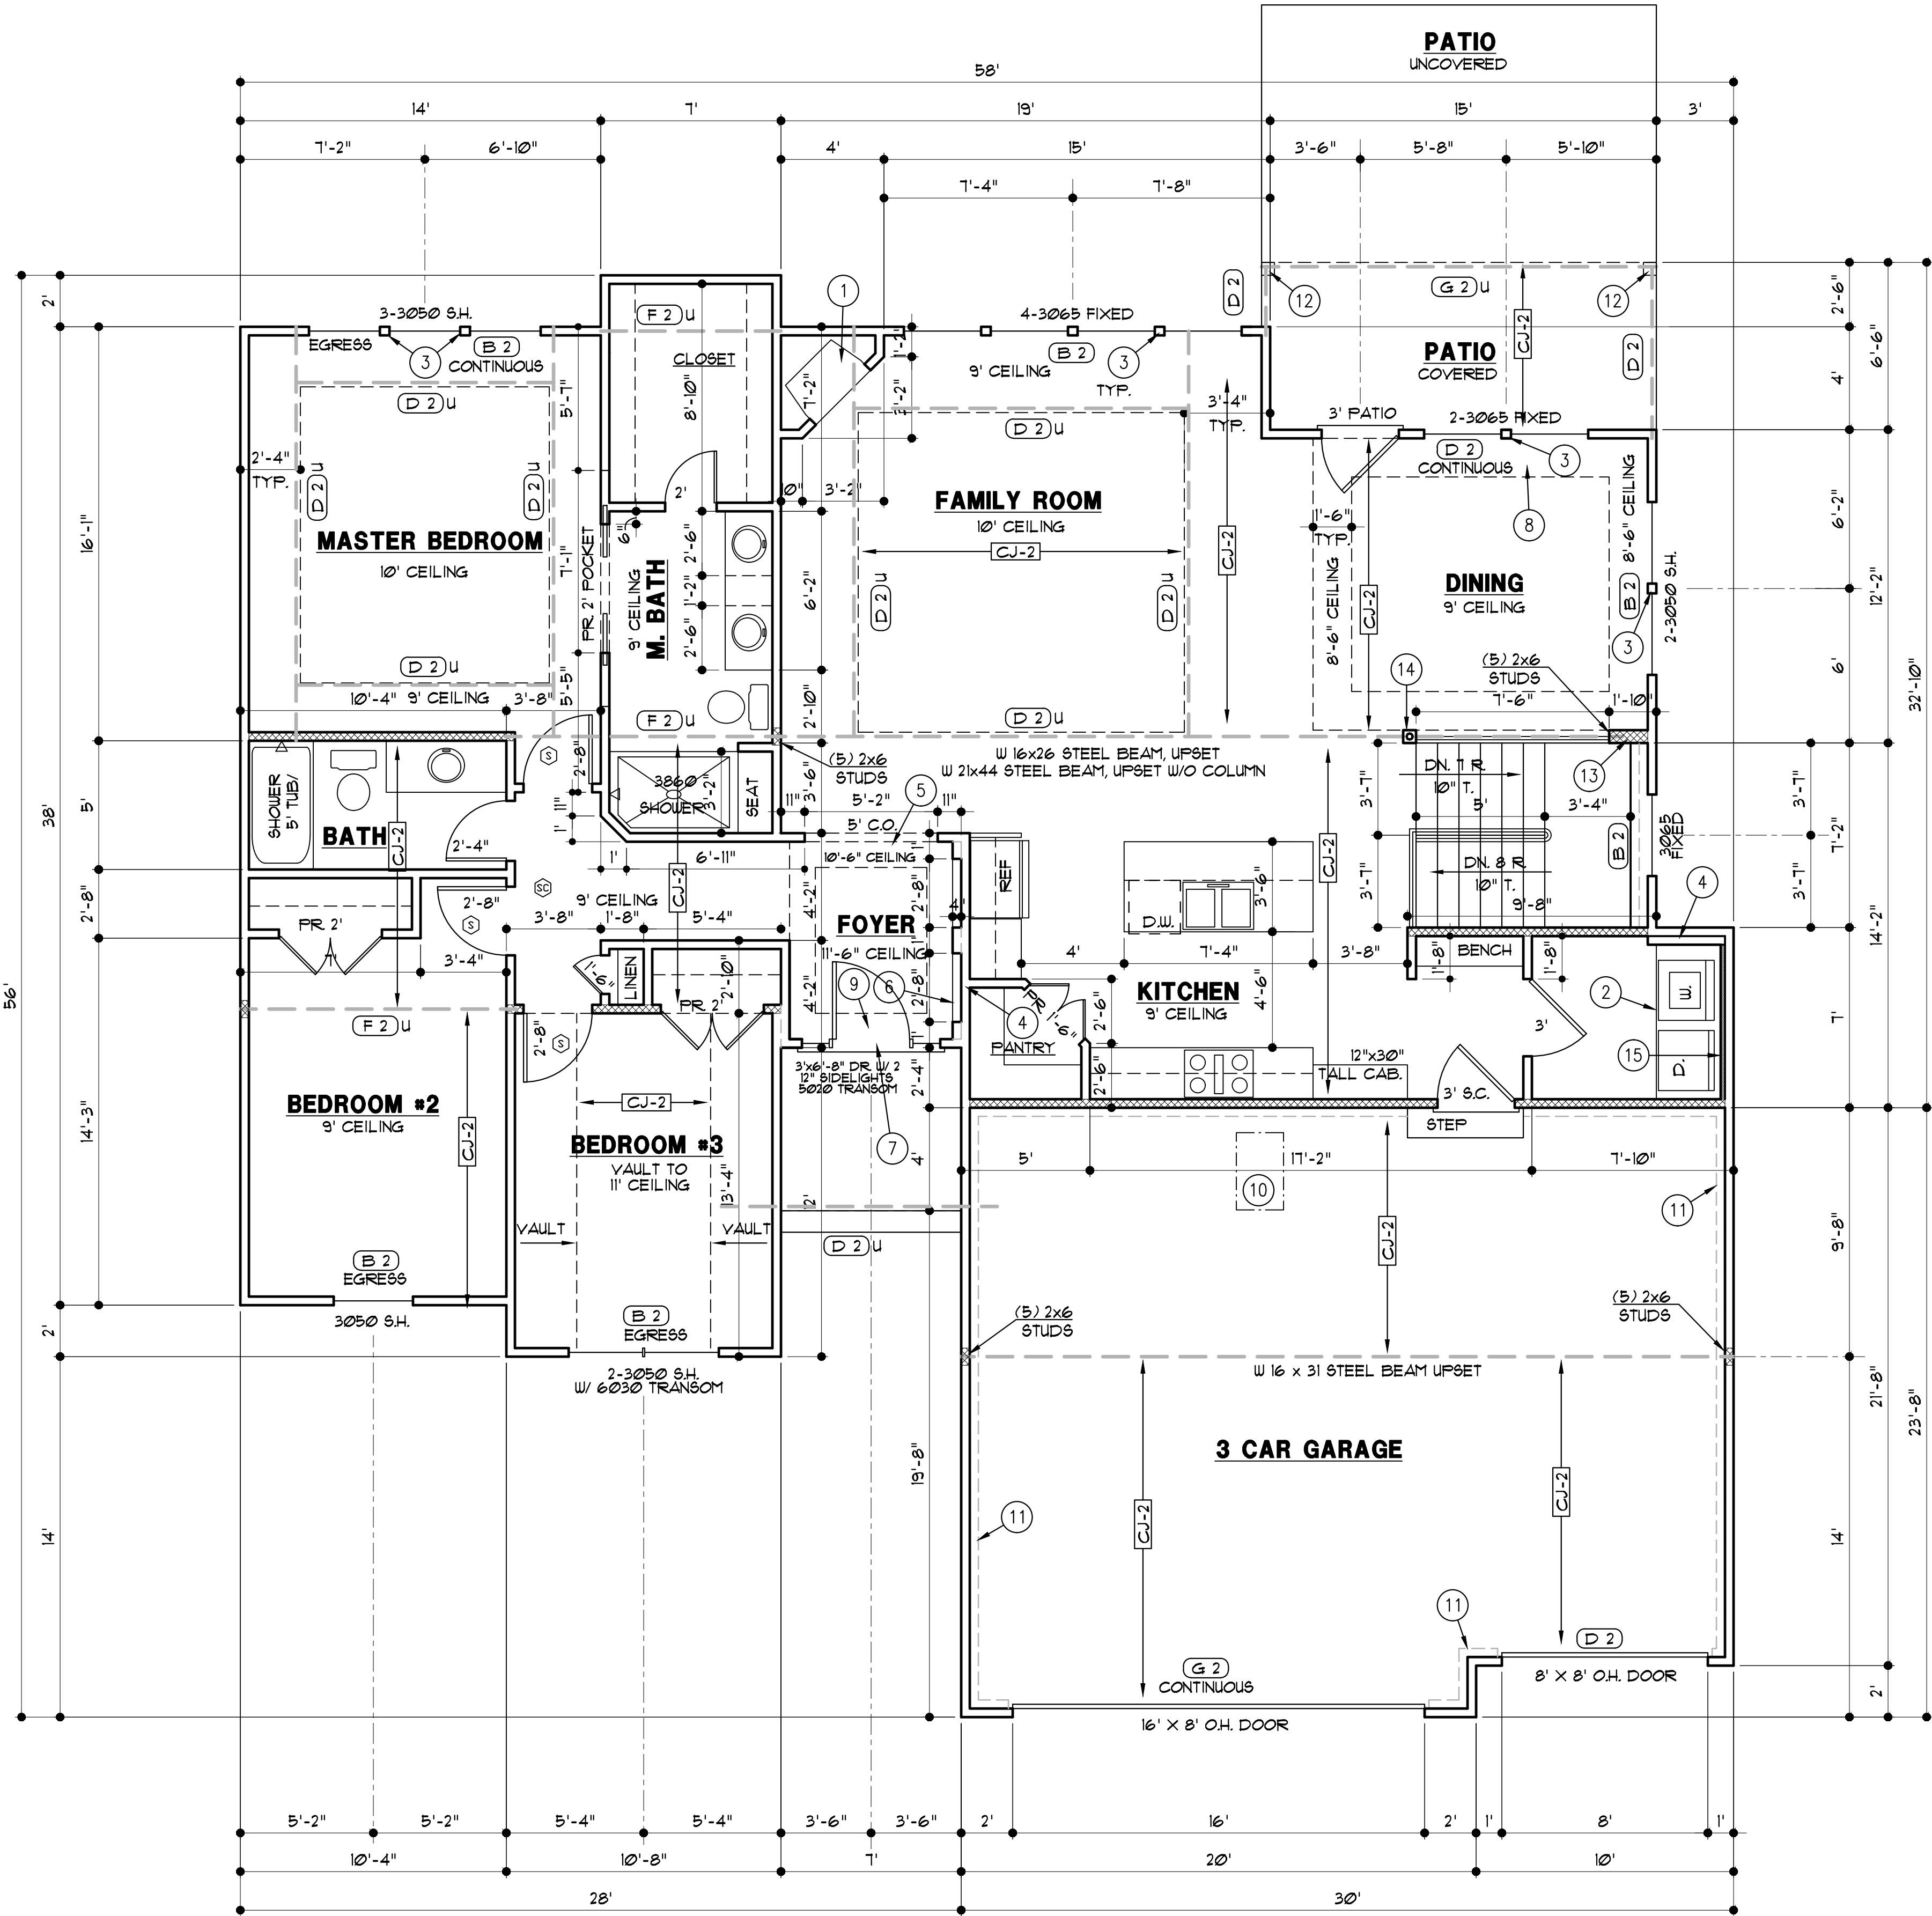

FIRST FLOOR PLAN

1/4" = 1'-0"


COPYRIGHT 2013
A PLACE CALLED HOME
CONSTRUCTION CO., INC.

2655 W. VALLEY PARKWAY
SUITE 110
OLATHE, KS 66061-8429
PHONE: 913-390-4663
FAX: 913-390-4664
www.websterarchitects.com

Webster
architects

PARK RIDGE, 6TH PLAT
1900 NE PARK RIDGE DRIVE
LEE'S SUMMIT, MO. 64064

A PLACE CALLED HOME CONSTRUCTION CO. INC.
804 SE WILLOW PLACE • 816-365-4663
BLUE SPRINGS, MO. 64014

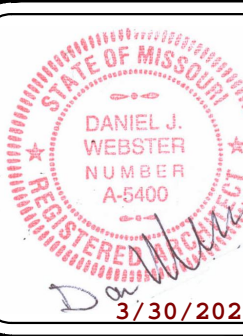

DRAWN BY: GV
DATE: 3-29-22
PROJECT NO: 11-0071-16

SHEET NO. 1
RELEASED FOR
CONSTRUCTION OF
AS NOTED FOR PERMITS
Development Services
Missouri Department of
Transportation

ROOF PLAN LEGEND	
DESCRIPTION	SYMBOL
RIDGES AND HIP	
VALLEYS	
EAVES, RAKE + GABLE	
HOUSE WALLS	
FURLIN	
TOP OF FURLIN STRUT OR RIDGE POLE	O
BOT. OF FURLIN STRUT OR RIDGE POLE	
JOIST SIZE AND SPACING	RJ-X
UPLIFT VALUE	000"


ROOF RAFTER SCHEDULE				
MARK	SIZE	SPACING	MAXIMUM SPAN	
			FLAT CEILING	VAULTED CEILING
RJ-1	2x6	12"	16'-11"	14'-9"
RJ-2	2x6	16"	14'-4"	12'-9"
RJ-3	2x6	24"	11'-9"	10'-5"
RJ-4	2x8	12"	21'-0"	18'-8"
RJ-5	2x8	16"	18'-2"	16'-2"
RJ-6	2x8	24"	14'-10"	13'-2"
RJ-7	2x10	12"	25'-8"	22'-9"
RJ-8	2x10	16"	22'-3"	19'-9"
RJ-9	2x10	24"	18'-2"	16'-11"
RJ-10	2x12	16"	25'-9"	22'-11"
RJ-11	2x12	24"	18'-2"	17'-11"

GENERAL NOTES:

- A. WHERE POSSIBLE, BRACE ALL RIDGES WITH 2x6 "T" BRACES TO BEARING WALLS OR BEAMS BELOW, AT 4' O.C.
- B. STRUTS TO BEAR ON WALLS AS INDICATED. CONTACT ARCHITECT WITH ANY PROPOSED CHANGE TO STRUT BEARING LOCATIONS. ARCHITECT MAY NEED TO VERIFY THAT BEAMS BELOW NEW STRUT LOCATION CAN SUPPORT ADDED LOADS.
- C. SEE SHEET G1 FOR LOAD AND DEFLECTION LIMITATIONS
- D. SEE SHEET G3 FOR ROOF FRAMING DETAILS 344/G3
- E. ROOFING TO BE COMPOSITION-40 YR. ON 30# FELT ON 7/16" O.S.B. SHEATHING

ROOF PLAN NOTES

1. BEARING WALL OR BEAM BELOW
2. 2x8 FURLIN WITH 2x6 "T" BRACES AT 4' O.C. TO BEARING WALL/ BEAM BELOW
3. 2x6 "T" BRACE TO BEARING WALL OR BEAM BELOW. BRACE SHALL BE CONNECTED TO STRUCTURE AT ROOF AND CEILING WITH MINIMUM (5) 16d NAILS.
4. OVER FRAME THIS AREA
5. CORNICE RETURN
6. TIGHT BARGE SOFFIT

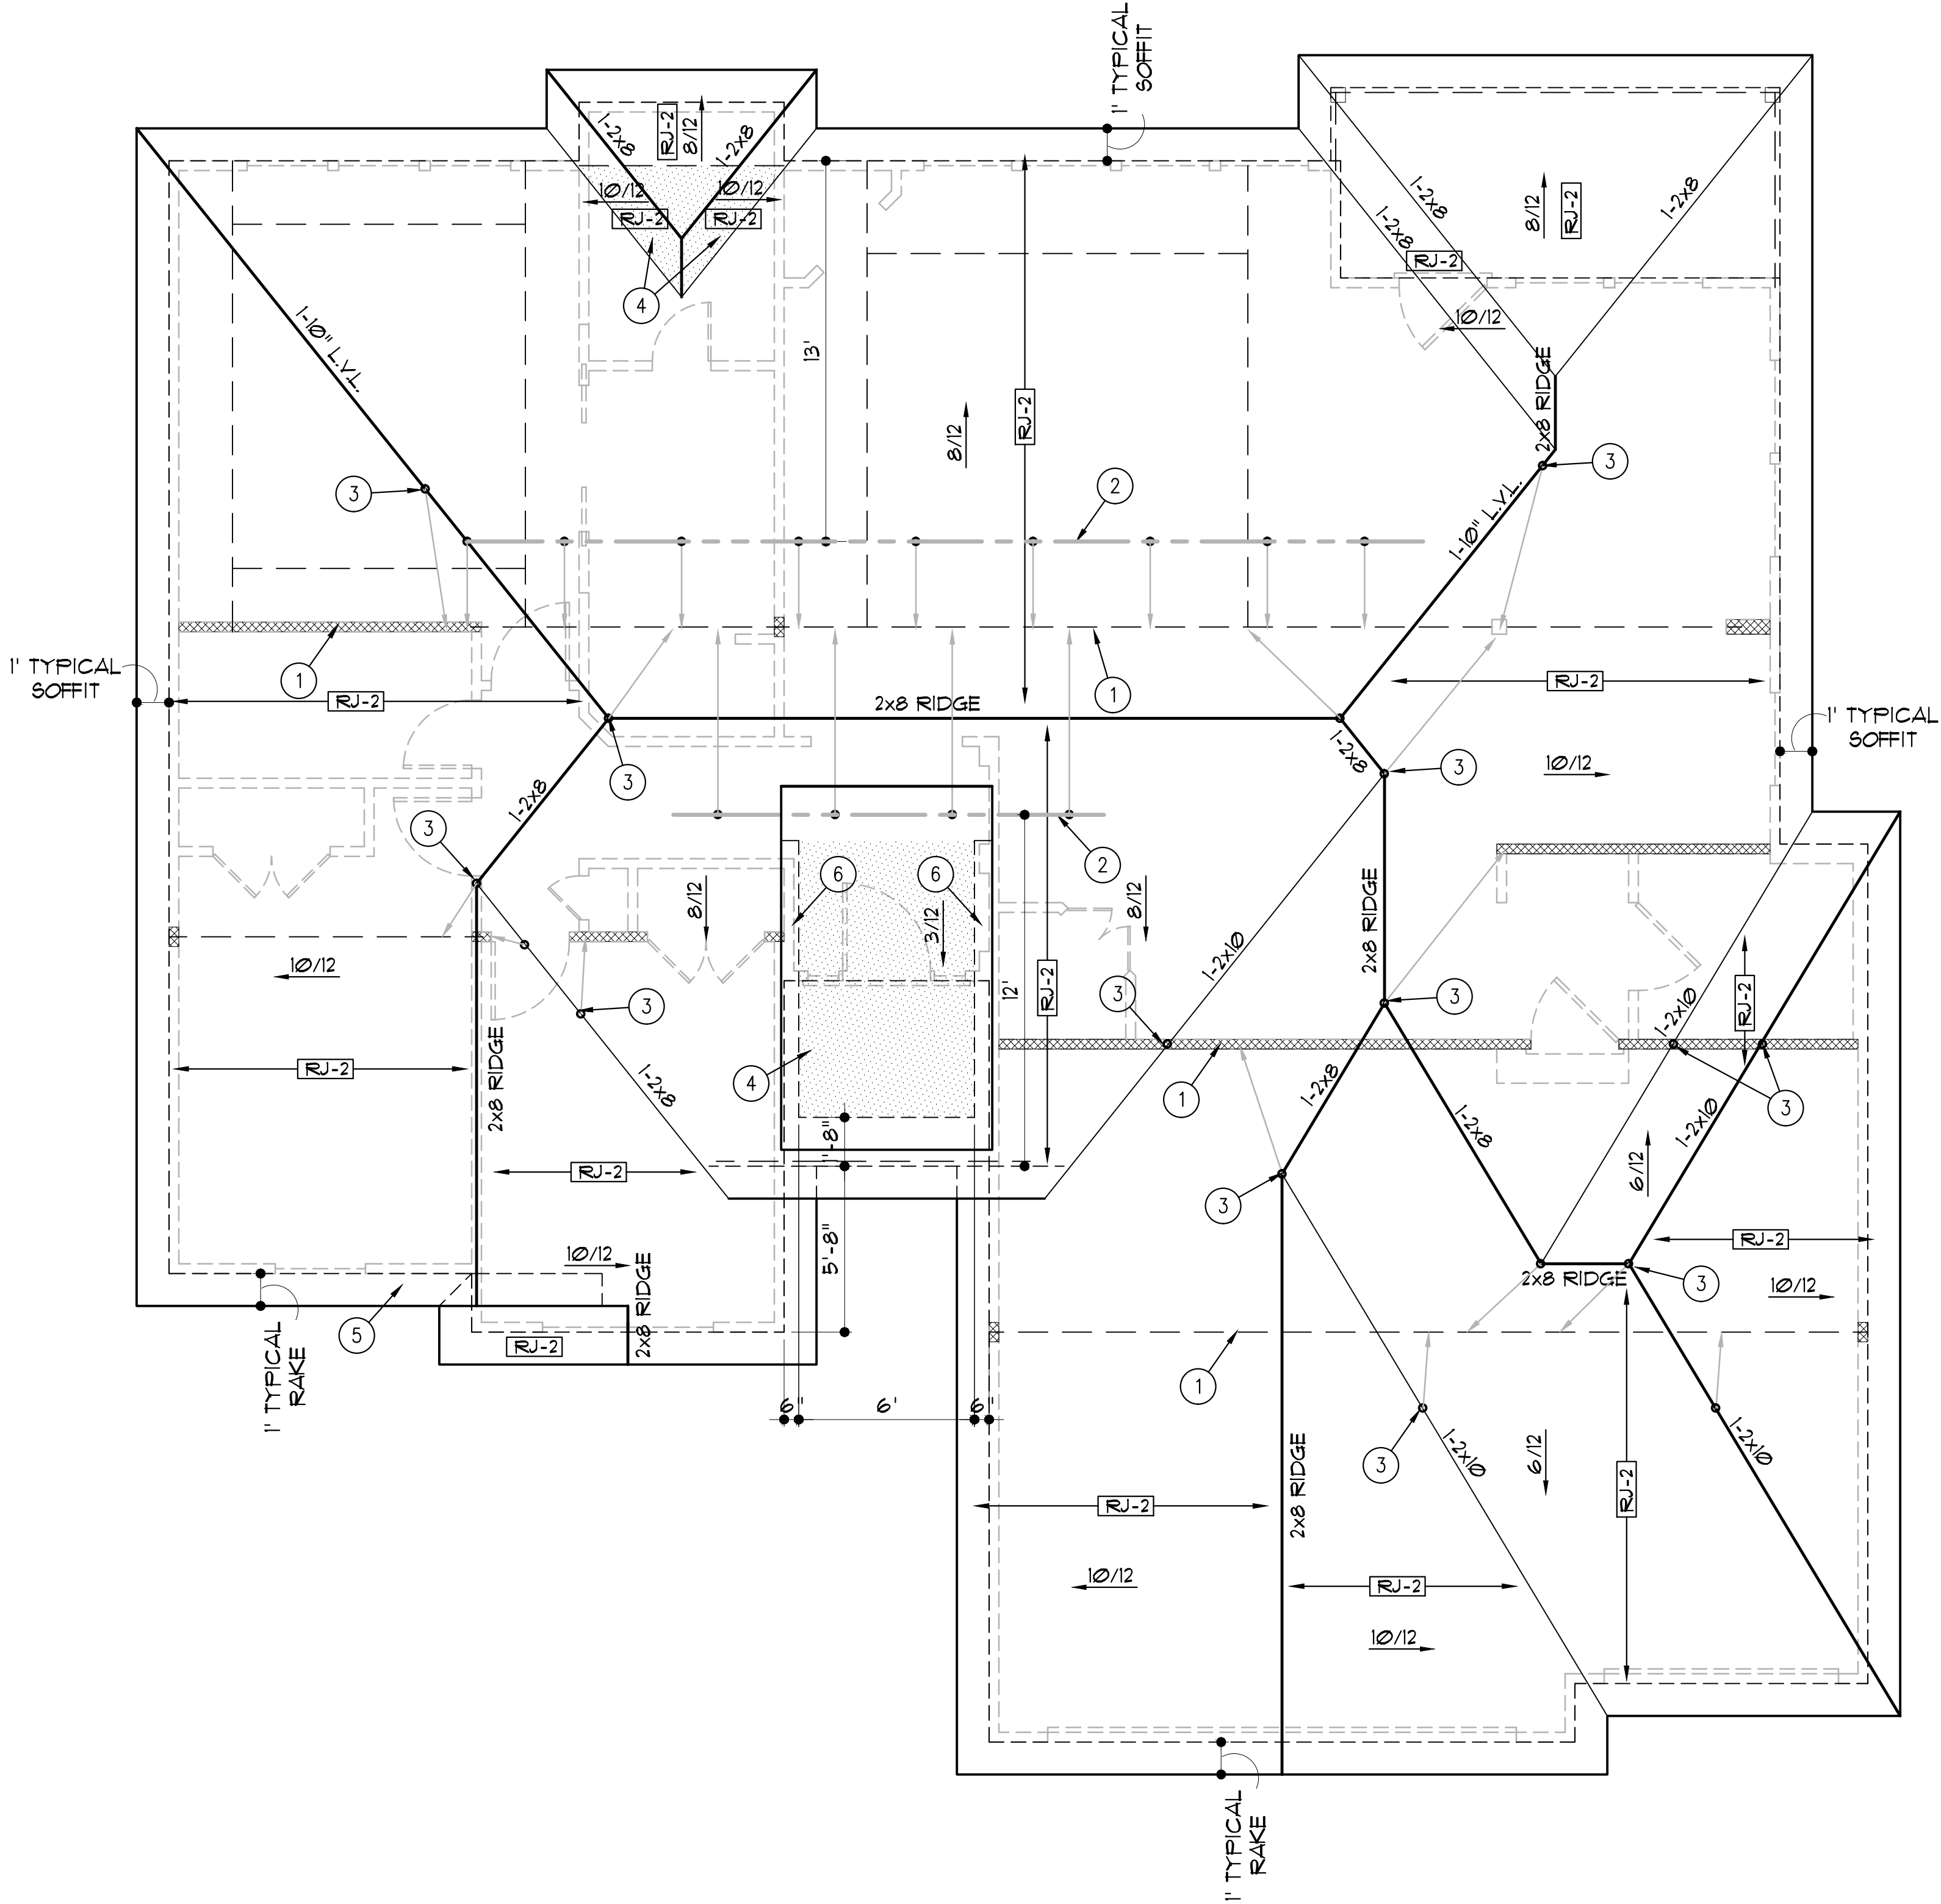

ROOF PLAN
1/4" = 1'-0"

COPYRIGHT 2013
A PLACE CALLED HOME
CONSTRUCTION CO., INC.

2655 W. VALLEY PARKWAY
SUITE 110
CLATHE, KS 66061-8429
PHONE: 913-390-4663
FAX: 913-390-4664
www.WebsterArchitects.com

architects
Webster

PARK RIDGE, 6TH PLAT
1900 NE PARK RIDGE DRIVE
LEE'S SUMMIT, MO. 64064

A PLACE CALLED HOME CONSTRUCTION CO., INC.
804 SE WILLOW PLACE • 816-365-4663
BLUE SPRINGS, MO. 64014

STATE OF MISSOURI
DANIEL J. WEBSTER
NUMBER A-6400
REGISTERED ARCHITECT
3/30/2022

DRAWN BY: GV
DATE: 3-29-22
PROJECT NO: 11-0071-16


SHEET NO. 11-0071-16
REVISIONS FOR
CONSTRUCTION
AS NOTED AND REVIEWED
Development Services
LEE'S SUMMIT, MISSOURI

GENERAL NOTES


- A. ROOFING TO BE COMPOSITION-40 YR. ON 30" FELT ON 1/16" O.S.B. SHEATHING
- B. PROVIDE WINDOW OPENING LIMITING DEVICE

ELEVATION NOTES


1. SIDING TO BE "SMART PANEL" TREATED ENGINEERED WOOD PANEL INSTALLED PER MANUFACTURER'S INSTRUCTIONS. PROVIDE 1/2" FLASHING BETWEEN VERTICAL PANELS. 1x4 SMART TRIM AT ALL CORNERS AND AROUND WINDOWS.
2. STUCCO SIDING, SEE DETAIL 1/44. EXTEND STUCCO TO WITHIN 8" OF FINISHED GRADE. 2x6 SMART TRIM AROUND WINDOWS AND DOORS UNLESS NOTED OTHERWISE.
3. SHAKE SHINGLES
4. MANUFACTURED STONE WITH CAST STONE CAP AS NEEDED
5. CORNICE RETURN
6. PANEL SHUTTERS
7. GABLE VENT
8. CONCRETE EGRESS WINDOW WELL. WINDOW SET AT MAX. 44" FROM FINISH FLOOR TO SILL
10. (2) 2020 FIXED WINDOWS
11. 2x6 CEDAR GABLE TRIM

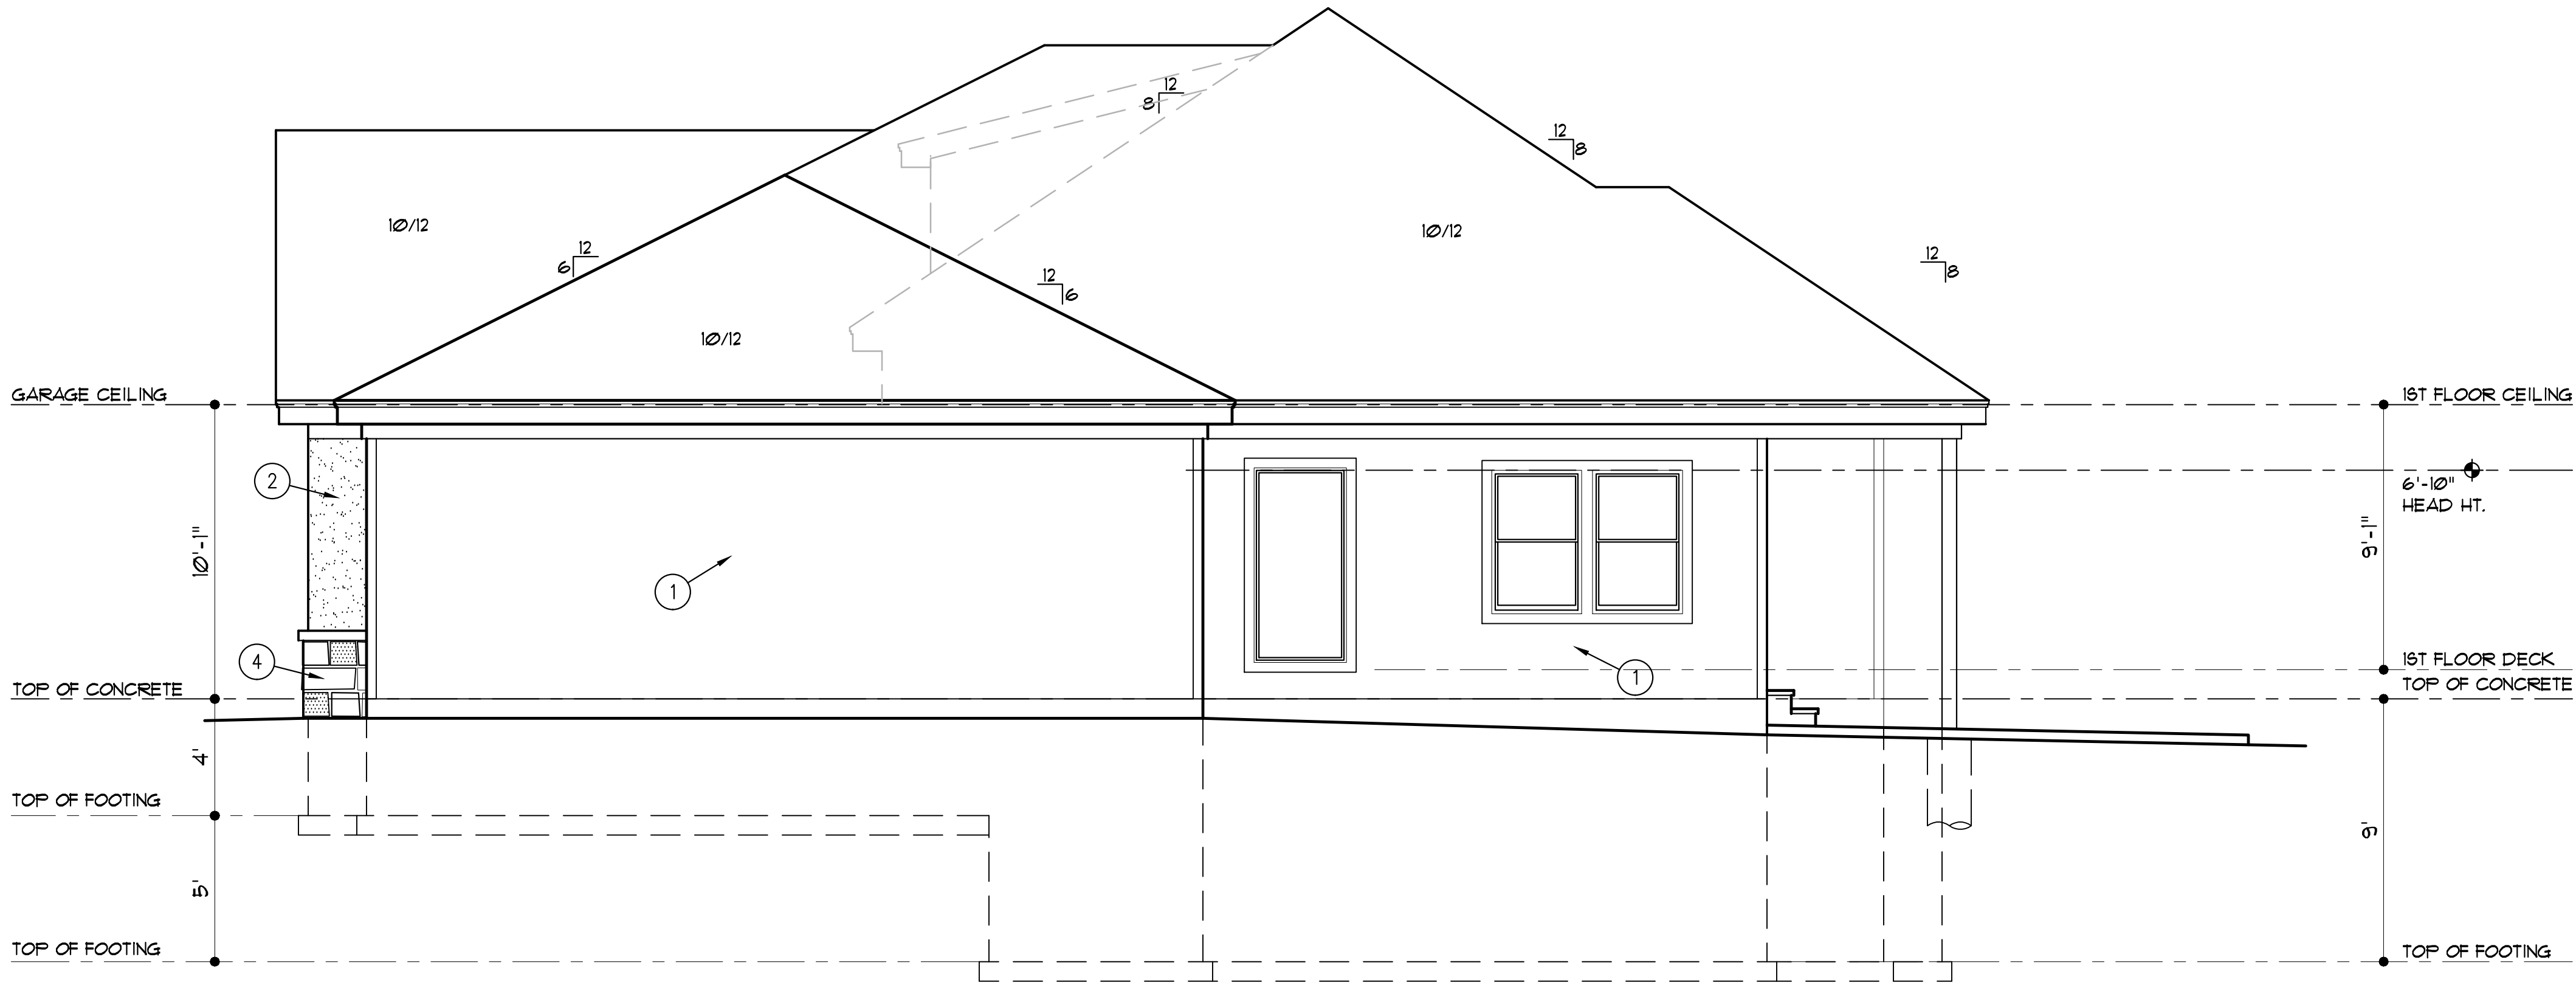

RIGHT SIDE ELEVATION
1/4" = 1'-0"

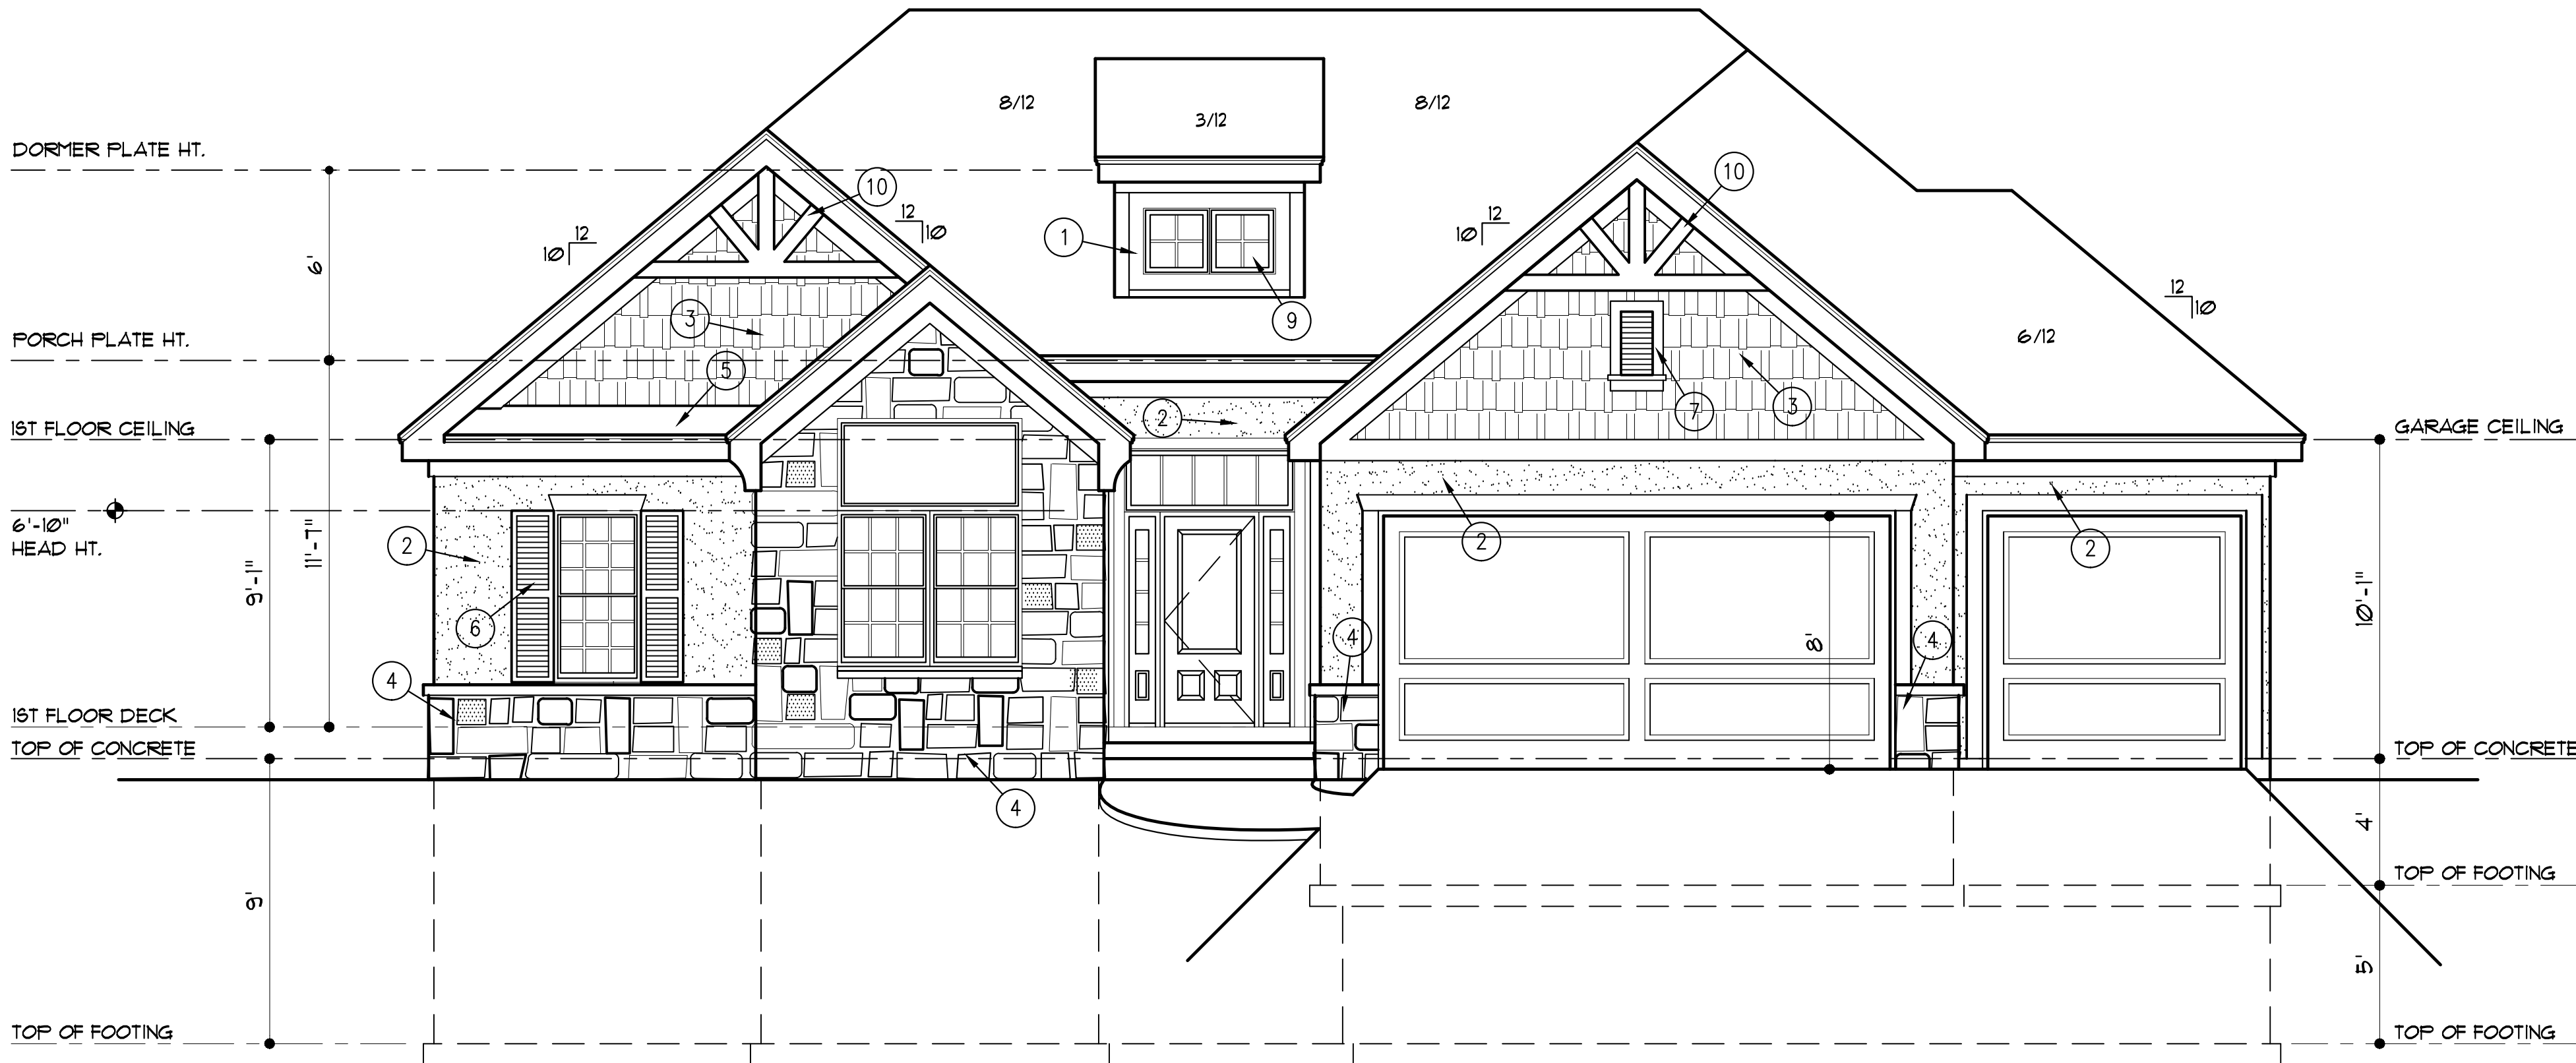

FRONT ELEVATION
1/4" = 1'-0"

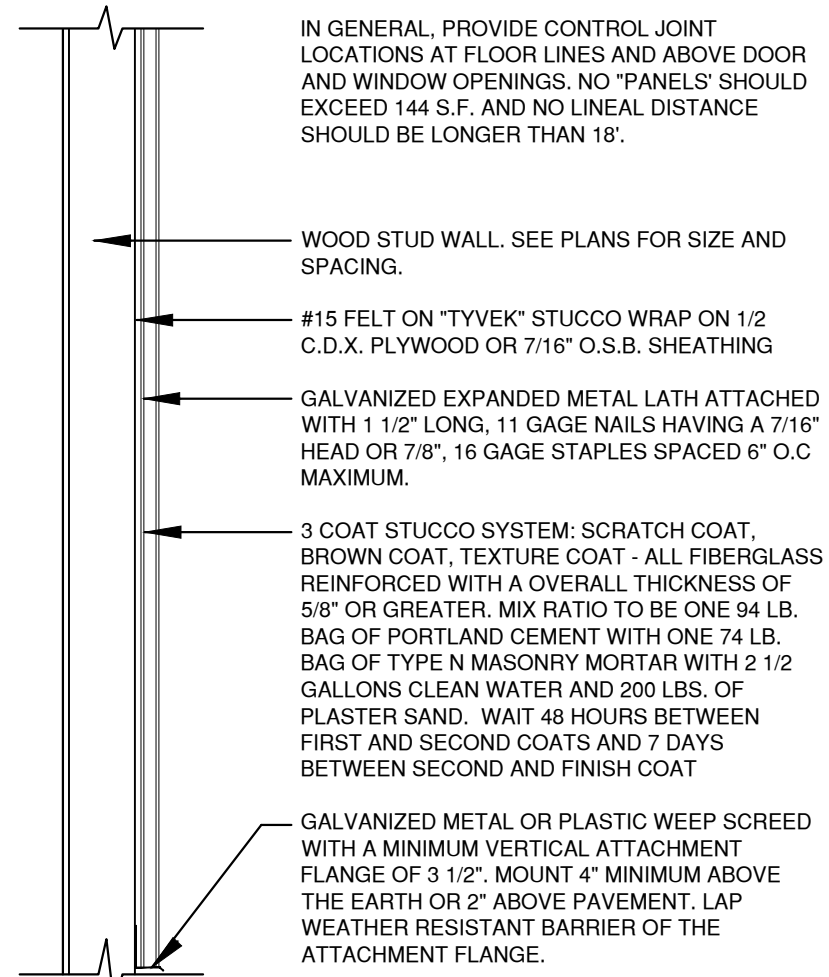

1 STUCCO DETAIL
3/4"=1'-0" A-DTV-09206-01

COPYRIGHT 2013
A PLACE CALLED HOME
CONSTRUCTION CO., INC.

25055 W. VALLEY PARKWAY
SUITE 110
CLATHE, KS 66061-8429
PHONE: 913-390-4663
FAX: 913-390-4664
www.WebsterArchitects.com

Webster
architects

PARK RIDGE, 6TH PLAT
1900 NE PARK RIDGE DRIVE
LEE'S SUMMIT, MO. 64064

A PLACE CALLED HOME CONSTRUCTION CO., INC.
804 SE WILLOW PLACE • 816-365-4663
BLUE SPRINGS, MO. 64014

STATE OF MISSOURI
DANIEL J. WEBSTER
REGISTERED ARCHITECT
A-5400
3/30/2022

DRAWN BY: GV
DATE: 3-29-22
PROJECT NO: 11-0071-16


SHEET NO. 1
FOR REVISION
AS NOTED AND PER
Development Services
www.summit-missouri.com

GENERAL NOTES


- A. ROOFING TO BE COMPOSITION-40 YR. ON 30" FELT ON 1/16" O.S.B. SHEATHING
- B. PROVIDE WINDOW OPENING LIMITING DEVICE

ELEVATION NOTES

1. SIDING TO BE "SMART PANEL" TREATED ENGINEERED WOOD PANEL INSTALLED PER MANUFACTURER'S INSTRUCTIONS. PROVIDE "Z" FLASHING BETWEEN VERTICAL PANELS. 1x4 SMART TRIM AT ALL CORNERS AND AROUND WINDOWS.
2. STUCCO SIDING, SEE DETAIL 1/A4. EXTEND STUCCO TO WITHIN 8" OF FINISHED GRADE. 2x6 SMART TRIM AROUND WINDOWS AND DOORS UNLESS NOTED OTHERWISE.
3. SHAKE SHINGLES
4. MANUFACTURED STONE WITH CAST STONE CAP AS NEEDED
5. CORNICE RETURN
6. PANEL SHUTTERS
7. GABLE VENT
8. CONCRETE EGRESS WINDOW WELL. WINDOW SET AT MAX. 44" FROM FINISH FLOOR TO SILL
10. (2) 2020 FIXED WINDOWS
11. 2x6 CEDAR GABLE TRIM

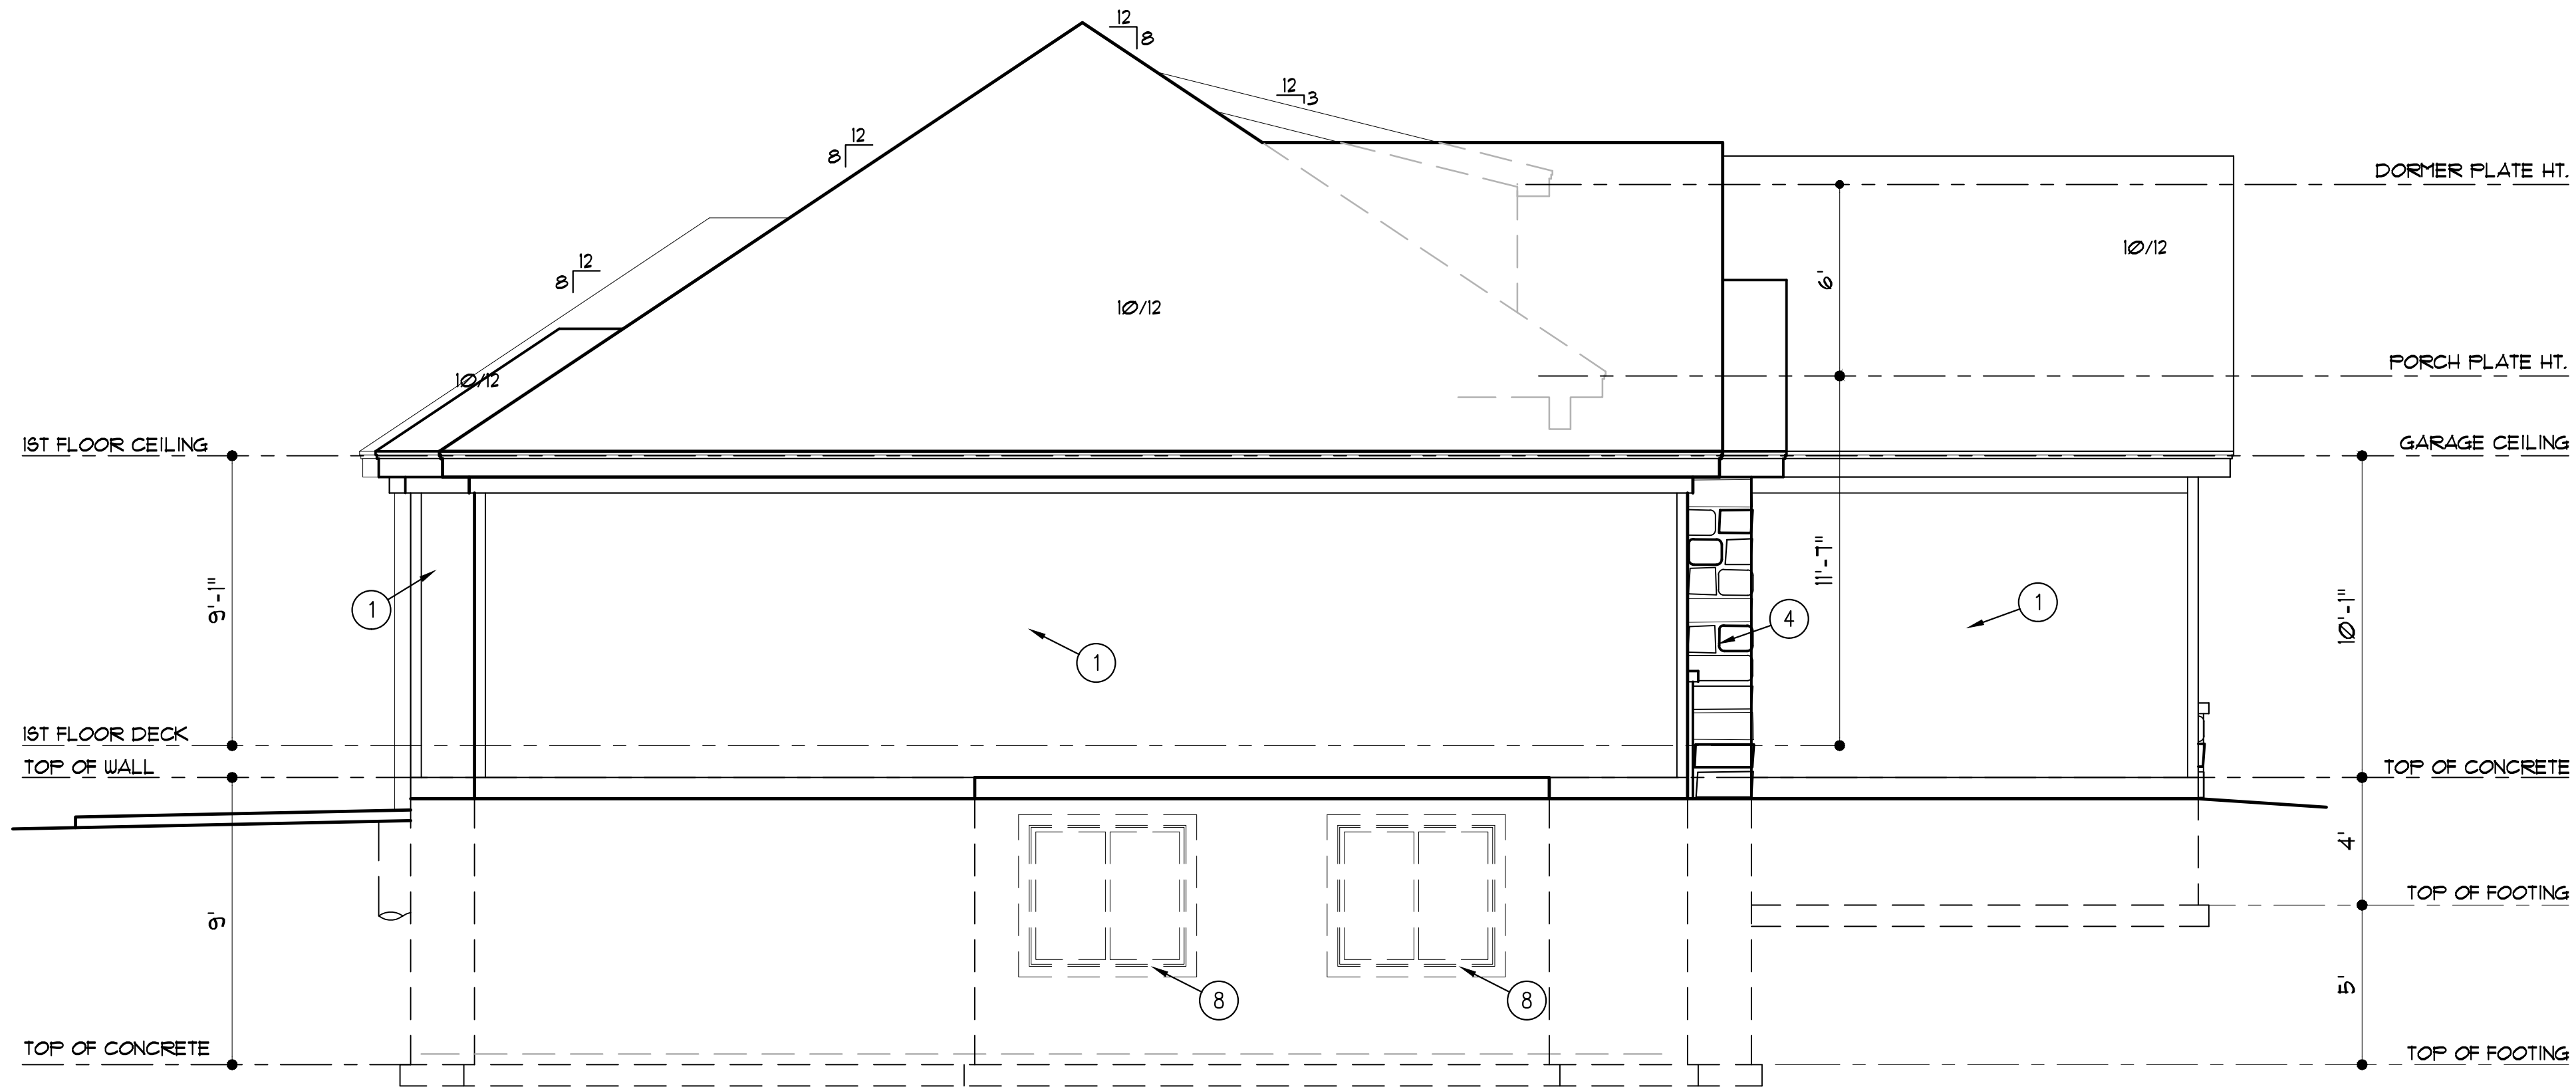

LEFT SIDE ELEVATION
1/4" = 1'-0"

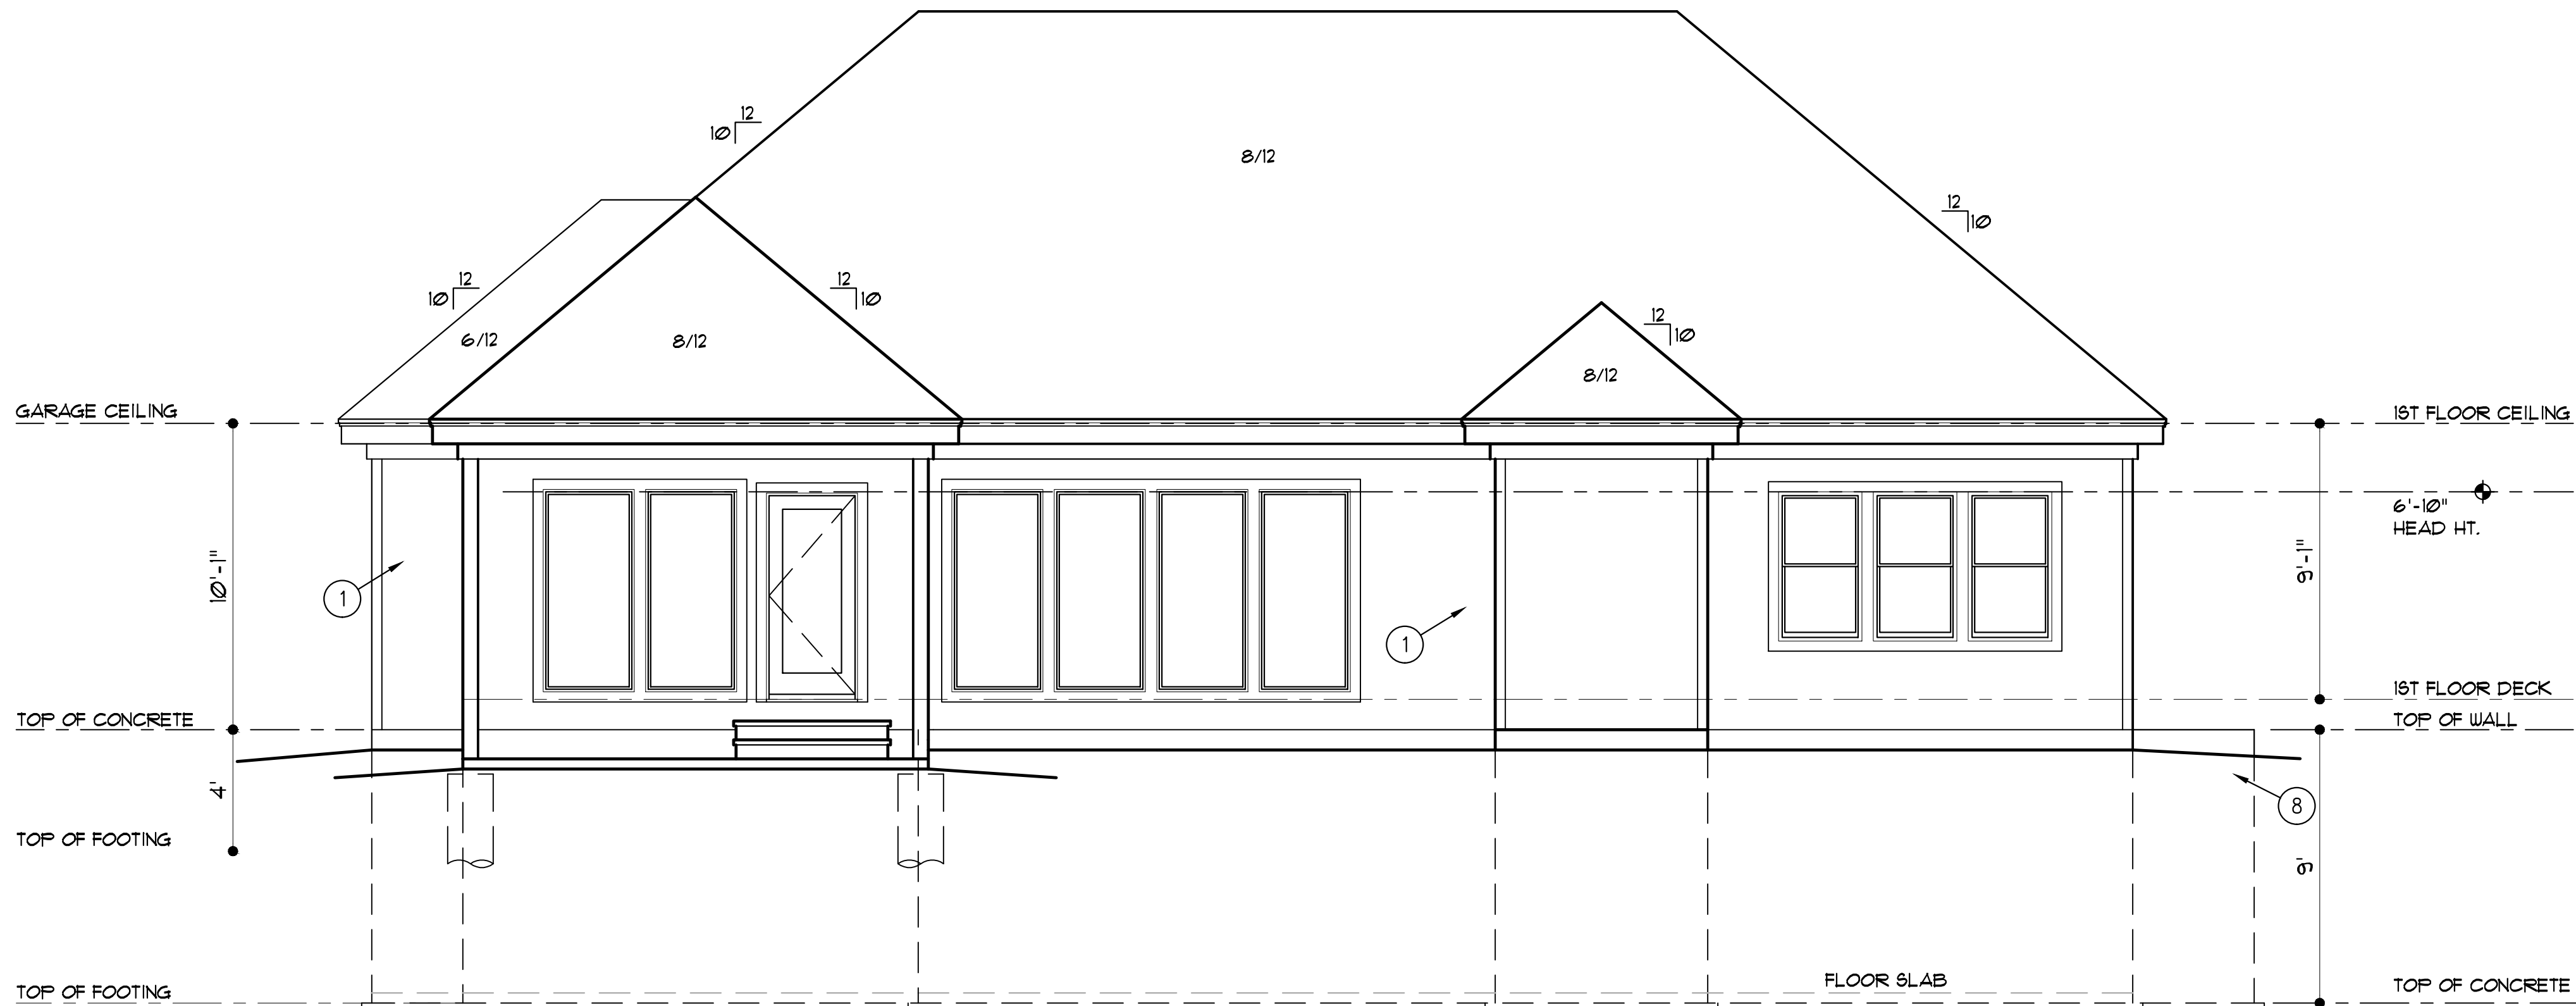

REAR ELEVATION
1/4" = 1'-0"


COPYRIGHT 2013
A PLACE CALLED HOME
CONSTRUCTION CO., INC.

2655 W. VALLEY PARKWAY
SUITE 110
CLATHE, KS 66061-8429
PHONE: 913-390-4663
FAX: 913-390-4664
www.websterarchitects.com

architects
Webster

PARK RIDGE, 6TH PLAT
1900 NE PARK RIDGE DRIVE
LEE'S SUMMIT, MO. 64064

A PLACE CALLED HOME CONSTRUCTION CO., INC.
804 SE WILLOW PLACE • 816-365-4663
BLUE SPRINGS, MO. 64014

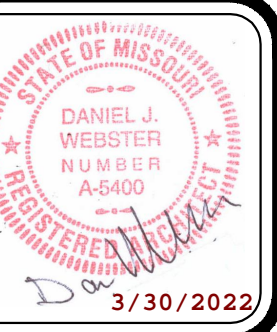

DRAWN BY: GV
DATE: 3-29-22
PROJECT NO: 11-0071-16

SHEET NO. 15
REPLACES FOR
CONSTRUCTION
AS NOTED FOR REVIEW
Development Services
Missouri

DISCLAIMER

THESE DRAWINGS ARE CONSIDERED A "BUILDER'S SET" AND BY BEGINNING CONSTRUCTION THE CONTRACTOR WARRANTS TO THE ARCHITECT, THAT HE HAS THE COMPETENCE AND SKILL IN CONSTRUCTION NECESSARY TO BUILD THE PROJECT WITHOUT FULL ENGINEERING AND DESIGN SERVICES. THE CONTRACTOR WILL BE REQUIRED TO ADAPT THE DRAWINGS TO ACTUAL FIELD CONDITIONS AND MAKE LOGICAL ADJUSTMENTS IN FIT, FORM, DIMENSION AND QUANTITY. IN THE EVENT, ADDITIONAL DETAIL OR GUIDANCE IS NEEDED, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY WEBSTER ARCHITECTS. FAILURE TO GIVE NOTICE SHALL RELIEVE WEBSTER ARCHITECTS OF THE ALL RESPONSIBILITY FOR THE CONSEQUENCES. ALTHOUGH WEBSTER ARCHITECTS HAVE PERFORMED THEIR SERVICES WITH DUE CARE AND DILIGENCE, PERFECTION CAN'T BE GUARANTEED. IT IS UNDERSTOOD AND AGREED THAT IF WEBSTER ARCHITECTS IS NOT HIRED TO DO PROJECT OBSERVATION OR ANY OTHER CONSTRUCTION PHASE SERVICES, THAT THE CLIENT WILL PERFORM SUCH SERVICES. THE CLIENT ASSUMES ALL RESPONSIBILITY FOR INTERPRETATION OF THE CONTRACT DOCUMENTS AND FOR CONSTRUCTION OBSERVATION, AND THE CLIENT WAIVES ANY CLAIMS AGAINST WEBSTER ARCHITECTS THAT MAY BE IN ANY WAY CONNECTED THERETO. THESE DRAWINGS ARE NOT TO BE SCALED. IF A CRITICAL DIMENSION IS MISSING THE ARCHITECT SHOULD BE CONSULTED.

ABBREVIATIONS

AFF.	ABOVE FINISH FLOOR
C.C.A.	CHROMATED COPPER ARSENATE
C.J.	CONTROL JOINT
CLG.	CEILING
C.O.	CASED OPENING
D.	DRYER
D.H.	DOUBLE HUNG
DIA.	DIAMETER
DN.	DOWN
D.W.	DISHWASHER
E.J.	EXPANSION JOINT
EQ.	EQUAL
F.D.	FLOOR DRAIN
G.	GAUGE OR GAGE
GA.	GROUND FAULT CIRCUIT INTERRUPTER
H.B.	HOSE BIB
HT.	HEIGHT
K.S.	KNEE SPACE
LB. (*)	POUND
L.V.L.	LAMINATED VENEER LUMBER
MAX.	MAXIMUM
MIN.	MINIMUM
MICRO.	MICROWAVE OVEN
O.C.	ON CENTER
O.H.	OVERHEAD/ OVERHANG
FR.	PAIR
R.	RISER
REF.	REFRIGERATOR
RY.	ROUGH OPENING
S.F.	SQUARE FEET
SIM.	SIMILAR
SQ.	SQUARE
T.	TREAD
T.C.	TRASH COMPACTOR
T.V.	TELEVISION
TYP.	TYPICAL
W.	WASHER
W/	WITH
W.C.	WALK IN CLOSET
W.H.	WATER HEATER
WJF.	WELDED WIRE FABRIC

LOAD AND DEFLECTION LIMITATIONS

AREA	CONDITION	MIN. LOADS (P&F)	
		LIVE	DEAD
DECKS	-	40	10
CEILING JOISTS	NO STORAGE	10	10
CEILING JOISTS	STORAGE ALLOWED	20	10
FLOORS	NON-SLEEPING SLEEPING AREAS	40 30	10 (20 FOR TILED FLRS *) 10 (20 FOR TILED FLRS *)
ROOFS	WOOD OR COMPOSIT. TILE OR CONCRETE	20 20	10 (20 IN LEAVOOD) 20
STAIRS	-	40	10
HANDRAIL/ GUARDRAIL		200*	IN ANY DIRECTION

NOTE:
- WIND SPEED 115 MPH (CATEGORY AS DEFINED BY R3012.1.4)
* TILE FLOOR LOAD BASED ON THINSET METHOD.

BUILDING INSULATION SCHEDULE

OPENING MAXIMUM U-VALUE	
WINDOWS	.32
OPAQUE DOORS	.20
GLASS DOORS	.35
SKYLIGHT	.55
GLAZED PENESTRATION SKGC	.40
BUILDING COMPONENT MINIMUM R-VALUE	
CEILING	
WITH ATTIC	49
CATHEDRAL	30
WALL	
EXTERIOR (CAVITY or CAVITY / CONTINUOUS)	20 or 13 + 5
BASEMENT (CAVITY or EXTERIOR)	13 or 10
CRAWL SPACE	10 / 13
FLOORS	
SLABS FOR 2" DEPTH ON FOUNDATION/	10
TRENCH FOOTINGS - HEATED SLAB	15
TRENCH FOOTINGS	10
OVER UNHEATED SPACES	19
OVER OUTSIDE AIR	30
DUCTS IN UNHEATED SPACES - SUPPLY AND RETURN	8
DUCTS IN UNHEATED SPACES - IN FLOOR AND CEILING ASSEMBLY	6
HOT WATER SYSTEM PIPING	3
FURNACE (AFUE)	80% MINIMUM
AIR CONDITIONING (SEER)	13 MINIMUM

CODE COMPLIANCE

A. BUILDING CONSTRUCTION: REGARDLESS OF WHAT IS SHOWN ON THE PLANS, THE BUILDING SHALL COMPLY WITH THE 2018 INTERNATIONAL RESIDENTIAL CODE AND ANY OTHER CITY REQUIREMENTS.

B. FOUNDATION WALLS ARE DESIGNED TO COMPLY WITH THE JOHNSON COUNTY FOUNDATION GUIDELINES.

C. BUILDING DESIGNED FOR SEVERE CLIMATIC AND GEOGRAPHIC DESIGN CRITERIA OF WEATHERING CONDITIONS, MODERATE TO SEVERE TERMITHE CONDITIONS, MODERATE DECAY CONDITIONS, 6 DEGREES FAHRENHEIT AND 5333 HEATING DEGREE DAYS WINTER DESIGN TEMPERATURE CONDITIONS, 36 INCHES FROST LINE DEPTH CONDITIONS AND FLOOD HAZARDS BASED UPON THE LATEST ADOPTED FIRJM. AND F.B.F.M. DOCUMENTS IN ACCORDANCE WITH L.B.C. ARTICLE 4-905.

GENERAL NOTES

A. GLASS: PROVIDE SAFETY GLAZING WHERE REQUIRED BY IRC E3902 AND IN THE FOLLOWING LOCATIONS: 1. STORY DOORS, 2. INDIVIDUAL FIXED OR OPERABLE PANELS ADJACENT TO A DOOR WHERE THE NEAREST VERTICAL EDGE IS WITHIN A 24" ARC OF THE DOOR IN A CLOSED POSITION AND WHOSE BOTTOM EDGE IS WITHIN 60" OF THE FLOOR, 3. WALLS ENCLOSEING STAIRWAYS AND LANDINGS WHERE THE GLAZING IS WITHIN 60" OF THE TOP OR BOTTOM OF THE STAIR, 4. ENCLOSURES FOR HOT TUBS, SAUNAS, STEAM ROOMS, SPAS, BATH TUBS, SHOWERS AND WHIRLPOOLS, 5. FIXED OR OPERABLE PANELS EXCEEDING 9 SQUARE FOOT AND WHOSE BOTTOM EDGE IS LESS THAN 18" ABOVE THE FLOOR AND WALKING SURFACE WITHIN 36"

B. EXTERIOR WINDOWS AND DOORS SHALL BE DESIGNED TO RESIST WIND LOADS SPECIFIED IN IRC TABLE R3012.4(A). EXTERIOR OVERHEAD DOORS SHALL MEET D.A.S.M.A. 115 MPH REQUIREMENTS.

C. BEDROOM EGRESS: AT LEAST ONE WINDOW FROM EACH BEDROOM AND FROM THE BASEMENT SHALL HAVE AN OPERABLE AREA OF 5.7 SQUARE FEET WITH A MINIMUM OPERABLE HEIGHT OF 24" AND A WIDTH OF 21" AND WITH THE BOTTOM OF THE OPERABLE PORTION NO MORE THAN 44" AFF. WINDOWS WHOSE SILL IS 12" OR MORE ABOVE FINISHED GRADE AND WHOSE SILL IS LESS THAN 24" ABOVE FINISHED FLOOR SHALL HAVE WINDOW GUARDS OR OPENING CONTROL DEVICES WHICH RESTRICT A 4" SPHERE FROM PASSING THRU.

D. STAIRWAYS: MAXIMUM RISE 7 1/4", MINIMUM RUN 10", MINIMUM HEADROOM 6' 8". MINIMUM WIDTH 36". HANDRAILS ARE REQUIRED WHEN STAIRS HAVE 4 OR MORE RISERS. HANDRAIL TO HAVE ENDS RETURNED END OR TERMINATED IN A NEUEL POST OR SAFETY TERMINAL AND PLACED MINIMUM 34" MAXIMUM 38" ABOVE TREAD NOSING. THE HAND GRIP PORTION OF HANDRAIL SHALL BE NOT LESS THAN 1-1/4" NOR MORE THAN 2 5/8" IN CROSS SECTION DIMENSION. HANDRAILS PROJECTING FROM A WALL SHALL HAVE A SPACE OF NOT LESS THAN 1-1/2" BETWEEN THE WALL AND THE HANDRAIL. INSTALL FIRE BLOCKING AT TOP AND BOTTOM OF STAIR RUN. THE CEILING AND WALLS OF USEABLE SPACE UNDER STAIRS SHALL BE SURFACED WITH 1/2" GYPSUM BOARD, TAPED AND FINISHED.

E. GUARDRAILS: ALL UNENCLOSED FLOOR AREAS, STAIRS AND EXTERIOR DECKS OVER 30" ABOVE GRADE SHALL HAVE 36" HIGH GUARDRAILS WITH A MAXIMUM OPENING OF 4" BETWEEN BALLUSTERS. BALLUSTERS SHALL NOT CREATE A LADDER.

F. DOOR BETWEEN THE GARAGE AND DUELLING SHALL BE 1 3/8" THICK SOLID WOOD, 1 3/8" THICK MINIMUM SOLID CORE OR HONEY COMBED STEEL DOOR OR 20-MINUTE FIRE RATED, EQUIPPED WITH AUTOMATIC OR SELF-CLOSING DEVICE.

G. ATTACHED GARAGE: WALLS AND CEILING TO BE NOT LESS THAN 1/2" GYPSUM BOARD. CEILINGS AND BEAMS WITHIN THE GARAGE WILL BE COVERED WITH 5/8" TYPE "X" GYPSUM BOARD, IF SPACE ABOVE GARAGE IS LIVING SPACE.

H. BUILDER TO PROVIDE DECK OR LANDING PRIOR TO OWNER OCCUPANCY.

J. CRAWL SPACE: THE MINIMUM NET AREA OF VENTILATION OPENINGS WILL NOT BE LESS THAN 1 SQUARE FOOT FOR EACH 150 SQUARE FEET OF UNDER-FLOOR AREA. ONE SUCH VENTILATING OPENING WILL BE WITHIN 3 FEET OF EACH CORNER. AN 18"x24" MINIMUM ACCESS OPENING SHALL BE PROVIDED TO CRAWL SPACE.

K. ALL EXTERIOR DOORS, INCLUDING THE DOOR BETWEEN THE GARAGE AND THE HOUSE, SHALL INCORPORATE THE PHYSICAL SECURITY PROVISIONS OF SECTION MUNICIPAL CODE OF THE CITY IN WHICH THIS PROJECT IS LOCATED.

MECHANICAL ELECTRICAL NOTES

A. SMOKE DETECTORS: INSTALL ONE IN EACH BEDROOM, OUTSIDE OF EACH BEDROOM AREA, AT LEAST ONE ON EACH STORY INCLUDING THE BASEMENT. ALL ALARMS ARE TO BE INTERCONNECTED SO THAT ACTIVATING ONE ALARM ACTIVATES THEM ALL.

B. CARBON MONOXIDE ALARMS: IN DUELLING UNITS USING FUEL-FIRED APPLIANCES OR IN DUELLING UNITS WITH ATTACHED GARAGES, INSTALL CARBON MONOXIDE ALARMS OUTSIDE EACH SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS.

C. GROUND FAULT CIRCUIT INTERRUPTER PROTECTION (GFCI) SHALL BE INSTALLED IN RECEPACLES IN BATHROOMS, KITCHENS, GARAGES, UNFINISHED BASEMENTS, OUTDOORS, CRAWL SPACES, AND WITHIN 6' OF ANY SINK. BATHROOM RECEPACLES REQUIRE SEPARATE 20-AMP CIRCUIT. PROVIDE ARC-FAULT CIRCUIT INTERRUPTERS AS REQUIRED BY IRC E3902.12 OR AS REQUIRED BY MUNICIPALITY.

D. FIREPLACE: FACTORY-BUILT FIREPLACE WILL BE EQUIPPED WITH LISTED COMPONENT FOR OUTSIDE COMBUSTION AIR PER IRC 1005 AND SHALL BE INSTALLED ACCORDING TO THE MANUFACTURER'S INSTRUCTIONS

E. ALL BATHROOMS TO RECEIVE EXHAUST FANS -- 50 CFM DIRECTLY TO OUTSIDE. POINT OF DISCHARGE MIN. 3' FROM ANY OPENING.

MECHANICAL, ELECTRICAL NOTES CONT.

F. HEAT PUMP THERMOSTATS MUST PREVENT BACK-UP ELECTRIC RESISTANCE HEAT WHEN THE HEAT PUMP CAN MEET THE LOAD.

G. DUCT SEALING MUST MEET THE REQUIREMENTS OF M 16013.1

H. ELECTRICAL CONDUCTORS SHALL BE COPPER AND THE PANEL BOX SHOULD BE 200 AMP

I. ANY DUCT PENETRATIONS OF THE WALLS OR CEILING SEPERATING THE DUELLING FROM THE GARAGE SHALL BE CONSTRUCTED OF 26 GAUGE SHEET METAL WITH NO OPENINGS IN THE GARAGE.

CONCRETE NOTES

A. CONCRETE: ALL CONCRETE SHALL BE 5-T% AIR-ENTRAINED AND HAVE A MINIMUM COMPRESSIVE STRENGTH AS LISTED BELOW AT 28 DAYS:
1. BASEMENT AND INTERIOR FLOOR SLABS: 3,000 PSI (2,500 IN LENEXA)
2. BASEMENT AND FOUNDATION WALLS: 3,000 PSI
3. PORCHES, CARPORT AND GARAGE FLOOR SLABS: 3,500 PSI

B. REINFORCING SHALL BE GRADE 40. SPLICES SHALL LAP 24" MIN. UNLESS NOTED OTHERWISE.

C. FOOTINGS: FOOTINGS SHALL BEAR ON UNDISTURBED SOIL AND EXTEND A MINIMUM OF 36" BELOW FINISHED GRADE. FOOTINGS UNDER FOUNDATION WALLS SHALL HAVE A MINIMUM WIDTH OF 16" AND A MINIMUM DEPTH OF 8" AND SHALL HAVE 2 #4 BARS CONTINUOUS. TRENCH FOOTINGS SUPPORTING MORE THAN ONE FLOOR SHALL BE A MINIMUM OF 16" WIDE. FOOTINGS SHALL BE CONTINUOUS AROUND THE STRUCTURE AND FROM ONE LEVEL TO THE NEXT. MAXIMUM HORIZONTAL JUMPS FOR FOOTINGS SHALL BE 1'.

D. WALLS: HORIZONTAL BARS SHALL BE PLACED WITH THE TOP BAR WITHIN 8 INCHES OF THE TOP OF THE WALL AND OTHER BARS EQUALLY SPACED. BARS SHALL LAP A MINIMUM 18 INCHES AT ENDS, SPLICES AND AROUND CORNERS. REINFORCEMENT SHALL BE CONTINUOUS AROUND WINDOWS, DOORS AND OTHER OPENINGS WITH SPLICES AS NOTED ABOVE TO MINIMIZE CRACKING AT CORNERS OF THE OPENINGS. BARS SHALL BE PLACED 2" FROM THE INSIDE FACE OF THE WALL.

E. DAMPPROOFING: DAMPPROOFING REQUIRED FOR WALLS ENCLOSEING BASEMENTS OR OTHER HABITABLE SPACE. A MINIMUM OF ONE COAT OF DAMPPROOFING SHALL BE APPLIED TO EXTERIOR WALL SURFACES BELOW GRADE. SEAL TIE HOLES, VOIDS AND HONEYCOMBED AREAS WITH SEALANT BEFORE DAMPPROOFING.

F. WATERPROOFING: WATERPROOFING REQUIRED IN LIEU OF DAMPROOFING WHERE A HIGH WATER TABLE OR OTHER SEVERE WATER CONDITIONS EXIST.

G. DRAIN TILE: INSTALL CONTINUOUS 4" DRAIN TILE AROUND THE PERIMETER OF ALL FOUNDATIONS ENCLOSEING HABITABLE SPACES LOCATED BELOW GRADE. INSTALL VERTICAL DRAINS TO THE PERIMETER DRAIN TILE AT ALL WINDOW WELLS. SET DRAIN TILE ON A 2" DEEP BY 12" WIDE GRAVEL BED AND COVER TILE WITH AT LEAST 6" OF COARSE, CLEAN ROCK AND A FILTER MEMBRANE MATERIAL. CONNECT THE DRAINS TO A 20-GALLON SUMP FIT OR DRAIN BY GRAVITY TO AN OUTLET WELL AWAY FROM THE HOUSE.

H. FOUNDATION ANCHORAGE: BASEMENT FOUNDATION SILL PLATES SHALL BE BOLTED TO THE FOUNDATION WITH 1/2" ANCHOR BOLTS EMBEDDED AT LEAST 1 INCHES INTO THE CONCRETE AND SPACED NOT MORE THAN 3 FEET ON CENTER AND WITHIN 12 INCHES OF THE END OF EACH PIECE.

I. BEAM POCKETS: RECESSED 4" INTO THE WALL. THE DEPTH AND WIDTH SHALL BE SIZED TO ACCOMMODATE THE DESIGNATED BEAM.

J. FLOOR SLABS: BASEMENT FLOOR SLABS SHALL BE A MINIMUM 4 INCHES THICK AND PLACED ON A 4-INCH GRAVEL BASE. THE BASEMENT FLOOR SHALL BE ISOLATED FROM COLUMN PADS, INTERIOR COLUMNS AND INTERIOR BEARING WALLS. INTERIOR COLUMNS AND BEARING WALLS SHALL BE SUPPORTED ON A SEPARATE INTERIOR FOOTING (NOT ON TOP OF THE FLOOR SLAB). THE GARAGE FLOOR SHALL SLOPE TOWARDS THE GARAGE DOORWAYS OR SLOPE TO A TRENCH OR UN-TRAPPED DRAIN THAT DISCHARGES DIRECTLY TO THE EXTERIOR ABOVE GRADE. OPTIONAL (EXCEPT IN LEAVOOD) 16 MIL. POLY VAPOR BARRIER SHOULD BE INSTALLED UNDER THE FLOOR SLAB.

GENERAL FRAMING NOTES

A. LUMBER: LUMBER IS #2 OR BETTER DOUGLAS FIR LARCH, EXCEPT FOR DECAY RESISTANT LUMBER WHICH IS SOUTHERN YELLOW PINE #2.

B. ALL EXTERIOR FRAMING LUMBER OR LUMBER IN CONTACT WITH CONCRETE OR MASONRY SHALL BE DECAY RESISTANT

C. L.V.L. HEADERS 4 BEAMS ARE TO HAVE A MIN. MODULUS OF ELASTICITY OF 13 x 10⁶ PSI.

D. FLOOR, CEILING AND ROOF OPENINGS: TRIMMER JOISTS SHALL BE DOUBLED WHEN THE HEADER IS SUPPORTED MORE THAN 3 FEET FROM THE TRIMMER JOIST BEARING. TRIMMER AND HEADER JOISTS SHALL BE DOUBLED WHEN THE SPAN OF THE HEADER EXCEEDS 4 FEET. THE ENDS OF HEADER RAFTERS MORE THAN 6 FEET LONG SHALL BE SUPPORTED BY FRAMING ANCHORS OR RAFTER HANGERS UNLESS BEARING ON A BEAM, PARTITION OR WALL.

E. FRAMING AROUND OPENINGS: TRIMMER AND HEADER JOISTS SHALL BE DOUBLED WHEN THE SPAN OF THE HEADER EXCEEDS 4' THE ENDS OF HEADER JOISTS MORE THAN 6 FEET LONG SHALL BE SUPPORTED BY FRAMING ANCHORS OR JOIST HANGERS UNLESS BEARING ON A BEAM, PARTITION, OR WALL.

FRAMING NOTES- FLOORS

A. BEARING: THE ENDS OF EACH JOIST SHALL NOT HAVE LESS THAN 1-1/2 INCHES OF BEARING ON WOOD OR METAL. JOISTS FRAMING INTO BEAMS SHALL BE SUPPORTED BY METAL JOIST HANGERS. JOIST FRAMING FROM OPPOSITE SIDES OF A BEAM, GIRDER OR PARTITION SHALL BE LAPPED AT LEAST 3 INCHES OR STRAPPED TOGETHER. JOISTS UNDER AND PARALLEL TO BEARING PARTITIONS SHALL BE DOUBLED.

B. LATERAL SUPPORT: JOISTS AT SUPPORTS SHALL BE SUPPORTED LATERALLY AT THE ENDS BY FULL-DEPTH SOLID BLOCKING NOT LESS THAN 2" NOMINAL THICKNESS OR BY ATTACHMENT TO A HEADER, BAND OR RIM JOIST OR TO AN ADJOINING STUD OR OTHERWISE PROVIDED WITH LATERAL SUPPORT TO PREVENT ROTATION. WHERE JOISTS ARE PERPENDICULAR TO BRACED WALL LINES, PROVIDE BLOCKING UNDER AND IN-LINE WITH THE BRACED WALL PANEL.

C. DECKING TO BE 3/4" (MIN) PLYWOOD OR ORIENTED STRAND BOARD INSTALLED PERPENDICULAR TO JOISTS.

D. TOP OF WALL SUPPORT CONNECTIONS: WHERE JOISTS RUN PARALLEL TO FOUNDATION WALLS, SOLID BLOCKING FOR A MINIMUM OF 2 JOIST SPACES SHALL BE PROVIDED AT A MAXIMUM OF 4 FEET CENTERS, AND SHALL BE SECURELY NAILED TO THE JOISTS AND FLOORING. IF DUCTS ARE INSTALLED IN THE FIRST JOIST SPACE(S), NAIL 2 BY 4S FLAT AT 4-FOOT CENTERS WITHIN THE JOIST SPACE(S) AND THEN PROVIDE THE SOLID BLOCKING. SECURE EACH 2 BY 4 TO THE SILL PLATE WITH FOUR 10D NAILS.

E. 1" JOISTS (IF USED) SHALL BE INSTALLED PER MANUFACTURER'S REQUIREMENTS.

F. PROVIDE BLOCKING OR BRIDGING AT CANTILEVERS.

G. PROVIDE 1/2" DRYWALL ON CEILING OF UNFINISHED SPACES FOR FLOOR FRAMING USING 1" JOISTS OR TRUSSES.

FRAMING NOTES - WALLS

A. SIZE, HEIGHT AND SPACING: UNLESS OTHERWISE NOTED, STUDS SHALL BE 2x4 DPM's SPACED AT 16" O.C.

FOR EXTERIOR WALLS SUPPORTING A ROOF ONLY, 2 x 6 STUDS SPACED 16" O.C. SHOULD BE USED FOR ALL WALLS 14' TO 18' TALL AND 2 x 6 STUDS SPACED 12" O.C. SHOULD BE USED FOR WALLS 18' TO 20' TALL.

FOR WALLS SUPPORTING A ROOF AND A FLOOR 2 x 6 STUDS SPACED 16" O.C. SHOULD BE USED FOR WALLS 12' TO 18' TALL.

STUDS SHALL BE CONTINUOUS FROM SOLE PLATE TO TOP FLATE OR CEILING DIAPHRAGM, EXCEPT FOR JACK STUDS, TRIMMER OR CRIPPLE STUDS.

B. ANGLES: ANGLED WALLS ARE ASSUMED TO BE 45° UNLESS OTHERWISE NOTED.

C. FRAMING DETAILS: BEARING AND EXTERIOR WALL STUDS SHALL BE CAPPPED WITH DOUBLE TOP PLATES. INSTALL TO PROVIDE OVER-LAPPING AT CORNERS AND AT INTERSECTIONS WITH OTHER PARTITIONS. END JOINTS IN DOUBLE TOP PLATES SHALL BE OFFSET AT LEAST 48 INCHES.

D. OPENINGS: UNLESS OTHERWISE NOTED, ALL HEADERS ARE TO BE TYPE "A" PER THE HEADER SCHEDULE. EACH END OF A HEADER SHALL HAVE A BEARING LENGTH OF NOT LESS THAN 1-1/2 INCHES FOR THE FULL WIDTH OF THE LINTEL. PROVIDE SOLID BLOCKING BELOW ALL STUDS SUPPORTING HEADERS AND BEAMS.

- UNLESS OTHERWISE DIMENSIONED, INTERIOR DOORS AND CASED OPENINGS ARE TO BE CENTERED IN THE WALL OR 3" FROM CORNERS AS INDICATED ON THE DRAWINGS.

E. FIRE BLOCKING OF NON-COMBUSTIBLE MATERIAL SHALL BE PROVIDED IN OPENINGS AROUND VENTS, PIPES, DUCTS, CHIMNEYS, FIREPLACES, AND LAUNDRY CHUTES AT CEILING AND FLOOR LEVEL.

F. CRIPPLE WALLS: FOUNDATION CRIPPLE WALLS SHALL BE FRAMED WITH 2 x 4 STUDS WITH A MINIMUM LENGTH OF 14" OR SHALL BE FRAMED OF SOLID BLOCKING. WHEN EXCEEDING 4' IN HEIGHT ON 2 STORY STRUCTURES, WALLS SHALL BE 2 x 6 STUDS AT 16" O.C.

G. BASEMENT NONBEARING WALLS: NON-LOAD BEARING STUD WALLS EXTENDING FROM THE FLOOR SLAB TO THE STRUCTURE ABOVE SHALL BE PROVIDED WITH A MINIMUM 1-INCH EXPANSION JOINT.

H. GARAGE DOORS AND FRAMES SHALL BE DESIGNED AND INSTALLED TO MEET A 115 mph WIND LOAD. THE H-FRAME FOR ATTACHMENT OF TRACK AND COUNTER BALANCE SHALL CONSIST OF THE FOLLOWING: 2x6 VERTICAL JAMBS RUNNING FROM FLOOR TO CEILING ATTACHES WITH 3-1/4"x12 NAILS @ 1" O.C. STAGGERED WITH 1) 3-1/4"x12 NAILS THRU JAMB INTO HEADER, MINIMUM 2x8 HEADER FOR ATTACHMENT OF COUNTER BALANCE SYSTEM.

FRAMING NOTES- DECKS

A. FOR DECK LEDGER ATTACHMENT AND DECK CONSTRUCTION REFER TO IRC SECTION 501.

FRAMING NOTES- CEILING

A. BLOCKING: ROOF RAFTERS AND CEILING JOISTS SHALL BE SUPPORTED LATERALLY TO PREVENT ROTATION AND LATERAL DISPLACEMENT.

B. JOISTS FRAMING INTO BEAMS SHALL BE SUPPORTED BY METAL JOIST HANGERS.

FRAMING NOTES- ROOF

A. FRAMING: RAFTERS SHALL BE FRAMED DIRECTLY OPPOSITE EACH OTHER AT THE RIDGE. THERE SHALL BE A RIDGE BOARD AT LEAST 1-INCH NOMINAL THICKNESS AT ALL RIDGES AND NOT LESS IN DEPTH THAN THE CUT END OF THE RAFTER. AT ALL VALLEYS AND HIPS THERE SHALL BE A SINGLE VALLEY OR HIP RAFTER NOT LESS THAN 2-INCH NOMINAL THICKNESS AND NOT LESS IN DEPTH THAN THE CUT END OF THE RAFTER.

B. BRACING: ALL FURLIN AND HIPs, RIDGES, AND VALLEYS SHOUN TO BE SUPPORTED SHALL BE BRACED WITH A STRUT DOWN TO A BEARING WALL (WALLS LOCATED DIRECTLY ABOVE A BEAM LINE OR CONTINUOUS FOOTING). THE MINIMUM SLOPE OF THE STRUTS SHALL NOT BE LESS THAN 45° FROM THE HORIZONTAL.

C. RAFTER TIES: RAFTERS SHALL BE NAILED TO ADJACENT CEILING JOISTS TO FORM A CONTINUOUS TIE BETWEEN EXTERIOR WALLS WHEN SUCH JOISTS ARE PARALLEL TO THE RAFTERS. WHERE NOT PARALLEL, RAFTERS SHALL BE TIED TO 2"x4" MINIMUM CROSSTIES AT EACH RAFTER AND LOCATED AS CLOSE TO THE CEILING JOISTS AS POSSIBLE (RE: DETAIL 3 4 4/G3).

D. RAFTER COLLAR TIES: PROVIDE 1x4 MIN. COLLAR TIES AT 48" O.C. (RE: DETAIL 3 4 4/G3). AT CATHEDRAL CEILINGS PROVIDE RIDGE STRAPS.

E. VAULTED CEILINGS: FOR RAFTERS SMALLER THAN A 2 x 10, FURRING MUST BE ADDED TO THE BOTTOM OF THE RAFTER TO OBTAIN A 9 1/4" MINIMUM DEPTH.

F. FLASH AND COUNTERFLASH ROOF RIDGES AND VALLEYS, ROOF PENETRATIONS, CHANGES IN ROOF FITCHES, RAKES, CHIMNEY BASES, WINDOW AND DOOR HEADS, ETC. TO PROVIDE WATER TIGHT CLOSURES. ALL EXPOSED FLASHING TO BE 26 GAUGE ALUMINUM. COUNTERFLASHING SHALL BE FABRICATED FROM 40# TERNE METAL.

G. ATTIC VENTILATION: THE NET FREE VENTILATION AREA SHALL BE NOT LESS THAN 1/50 OF THE AREA OF THE SPACE VENTILATED, EXCEPT THAT THE AREA MAY BE 1/300, PROVIDED AT LEAST 50 PERCENT OF THE REQUIRED VENTILATING AREA IS PROVIDED BY VENTILATOR LOCATED IN THE UPPER PORTION OF THE SPACE TO BE VENTILATED, AT LEAST 3 FEET ABOVE EAVES OR CORNICE VENTS, WITH THE BALANCE OF THE REQUIRED VENTILATION PROVIDED BY EAVE OR CORNICE VENTS. RAFTERS SPACES ENCLOSED BY CEILINGS DIRECTLY APPLIED TO UNDERSIDE OF RAFTERS SHALL BE SIZED TO ALLOW A MINIMUM 1 INCH CLEAR VENTED AIR SPACE ABOVE THE INSULATION AND EACH SPACE BETWEEN JOISTS SHALL BE VENTED.

H. ROOF SHEATHING: SHALL BE INSTALLED PERPENDICULAR TO THE ROOF JOISTS AND THE ENDS SHALL BE STAGGERED.

PREFABRICATED WOOD TRUSSES (IF USED)

A. ROOF AND FLOOR TRUSSES SHALL BE DESIGNED IN ACCORDANCE WITH TRUSS PLATE INSTITUTE (TFI) DESIGN SPECIFICATION FOR METAL PLATE CONNECTED WOOD TRUSSES AND THE NATIONAL DESIGN SPECIFICATION FOR ANSIFORMA WOOD CONSTRUCTION. PROVIDE TEMPORARY AND PERMANENT BRACING ON ALL TRUSSES, AS REQUIRED TO PROVIDE MEMBER AND TRUSS STABILITY.

B. ROOF TRUSSES SHALL BE DESIGNED AND CONSTRUCTED FOR A MAXIMUM TOTAL LOAD DEFLECTION OF L/240, AND TO SAFELY SUPPORT THE FOLLOWING LOADS:

1. TOP CHORD:
 - a. LIVE LOAD SEE GENERAL NOTES
 - b. DEAD LOAD 15 PSF
2. BOTTOM CHORD:
 - a. LIVE LOAD 10 PSF
 - b. DEAD LOAD 10 PSF
3. WIND LOADS IN ACCORDANCE WITH THE APPROPRIATE BUILDING CODE. GABLED END TRUSSES SHALL HAVE VERTICAL MEMBERS SPACED AT 16" ON CENTER MAXIMUM.
4. TRUSSES SHALL ALSO BE DESIGNED TO SUPPORT ADDITIONAL OVERBUILD FRAMING TO FORM VALLEYS AND HIPS ON ROOFS.
5. TRUSSES SHALL BE DESIGNED TO SUPPORT DRIFTED SNOW LOADS IN ACCORDANCE WITH THE APPROPRIATE BUILDING CODE.
6. TRUSSES SHALL BE ATTACHED TO WALL ASSEMBLIES BY CONNECTIONS CAPABLE OF RESISTING UPLIFT FORCES AS SPECIFIED ON THE TRUSS DESIGN DRAWINGS PER IRC TABLE R802.11.

ENERGY REQUIREMENTS

A. THE BUILDING THERMAL ENEVELOPE IS REQUIRED TO BE SEALED (IRC N102.4.1)

B. RECESSED LIGHTING SHALL BE SEALED TO PREVENT LEAKAGE BETWEEN CONDITIONED AND UNCONDITIONED SPACES

C. DUCTS, AIR HANDLERS, FILTER BOXES AND BUILDING CAVITIES USED AS DUCTS SHALL BE SEALED (IRC SECTION N103.2)

D. PENETRATIONS IN AIR BARRIERS (HOUSE WRAP) SHALL BE TAPED AND SEALED AS REQUIRED BY AIR BARRIER MANUFACTURER, WINDOW DOOR MANUFACTURER AND ENERGY CODE.

COPYRIGHT 2013
A PLACE CALLED HOME
CONSTRUCTION CO., INC.

2505 W. VALLEY PARKWAY
SUITE 10
CLAYTON, KS 66061-8429
PHONE: 913-390-4663
FAX: 913-390-4664
www.websterarchitects.com

Webster
architects


PARK RIDGE, 6TH PLAT
1900 NE PARK RIDGE DRIVE
LEE'S SUMMIT, MO. 64064

A PLACE CALLED HOME CONSTRUCTION CO. INC.
804 SE WILLOW PLACE • 816-365-4663
BLUE SPRINGS, MO. 64014


STATE OF MISSOURI
DANIEL J. WEBSTER
REGISTERED ARCHITECT
NO. 000000000
A-5400
3/30/2022

DRAWN BY: GV
DATE: 3-29-22
PROJECT NO: 11-0071-16


SHEET NO. 1
NOT FOR CONSTRUCTION
AS NOTED CHANGES
Development Services
www.websterarchitects.com

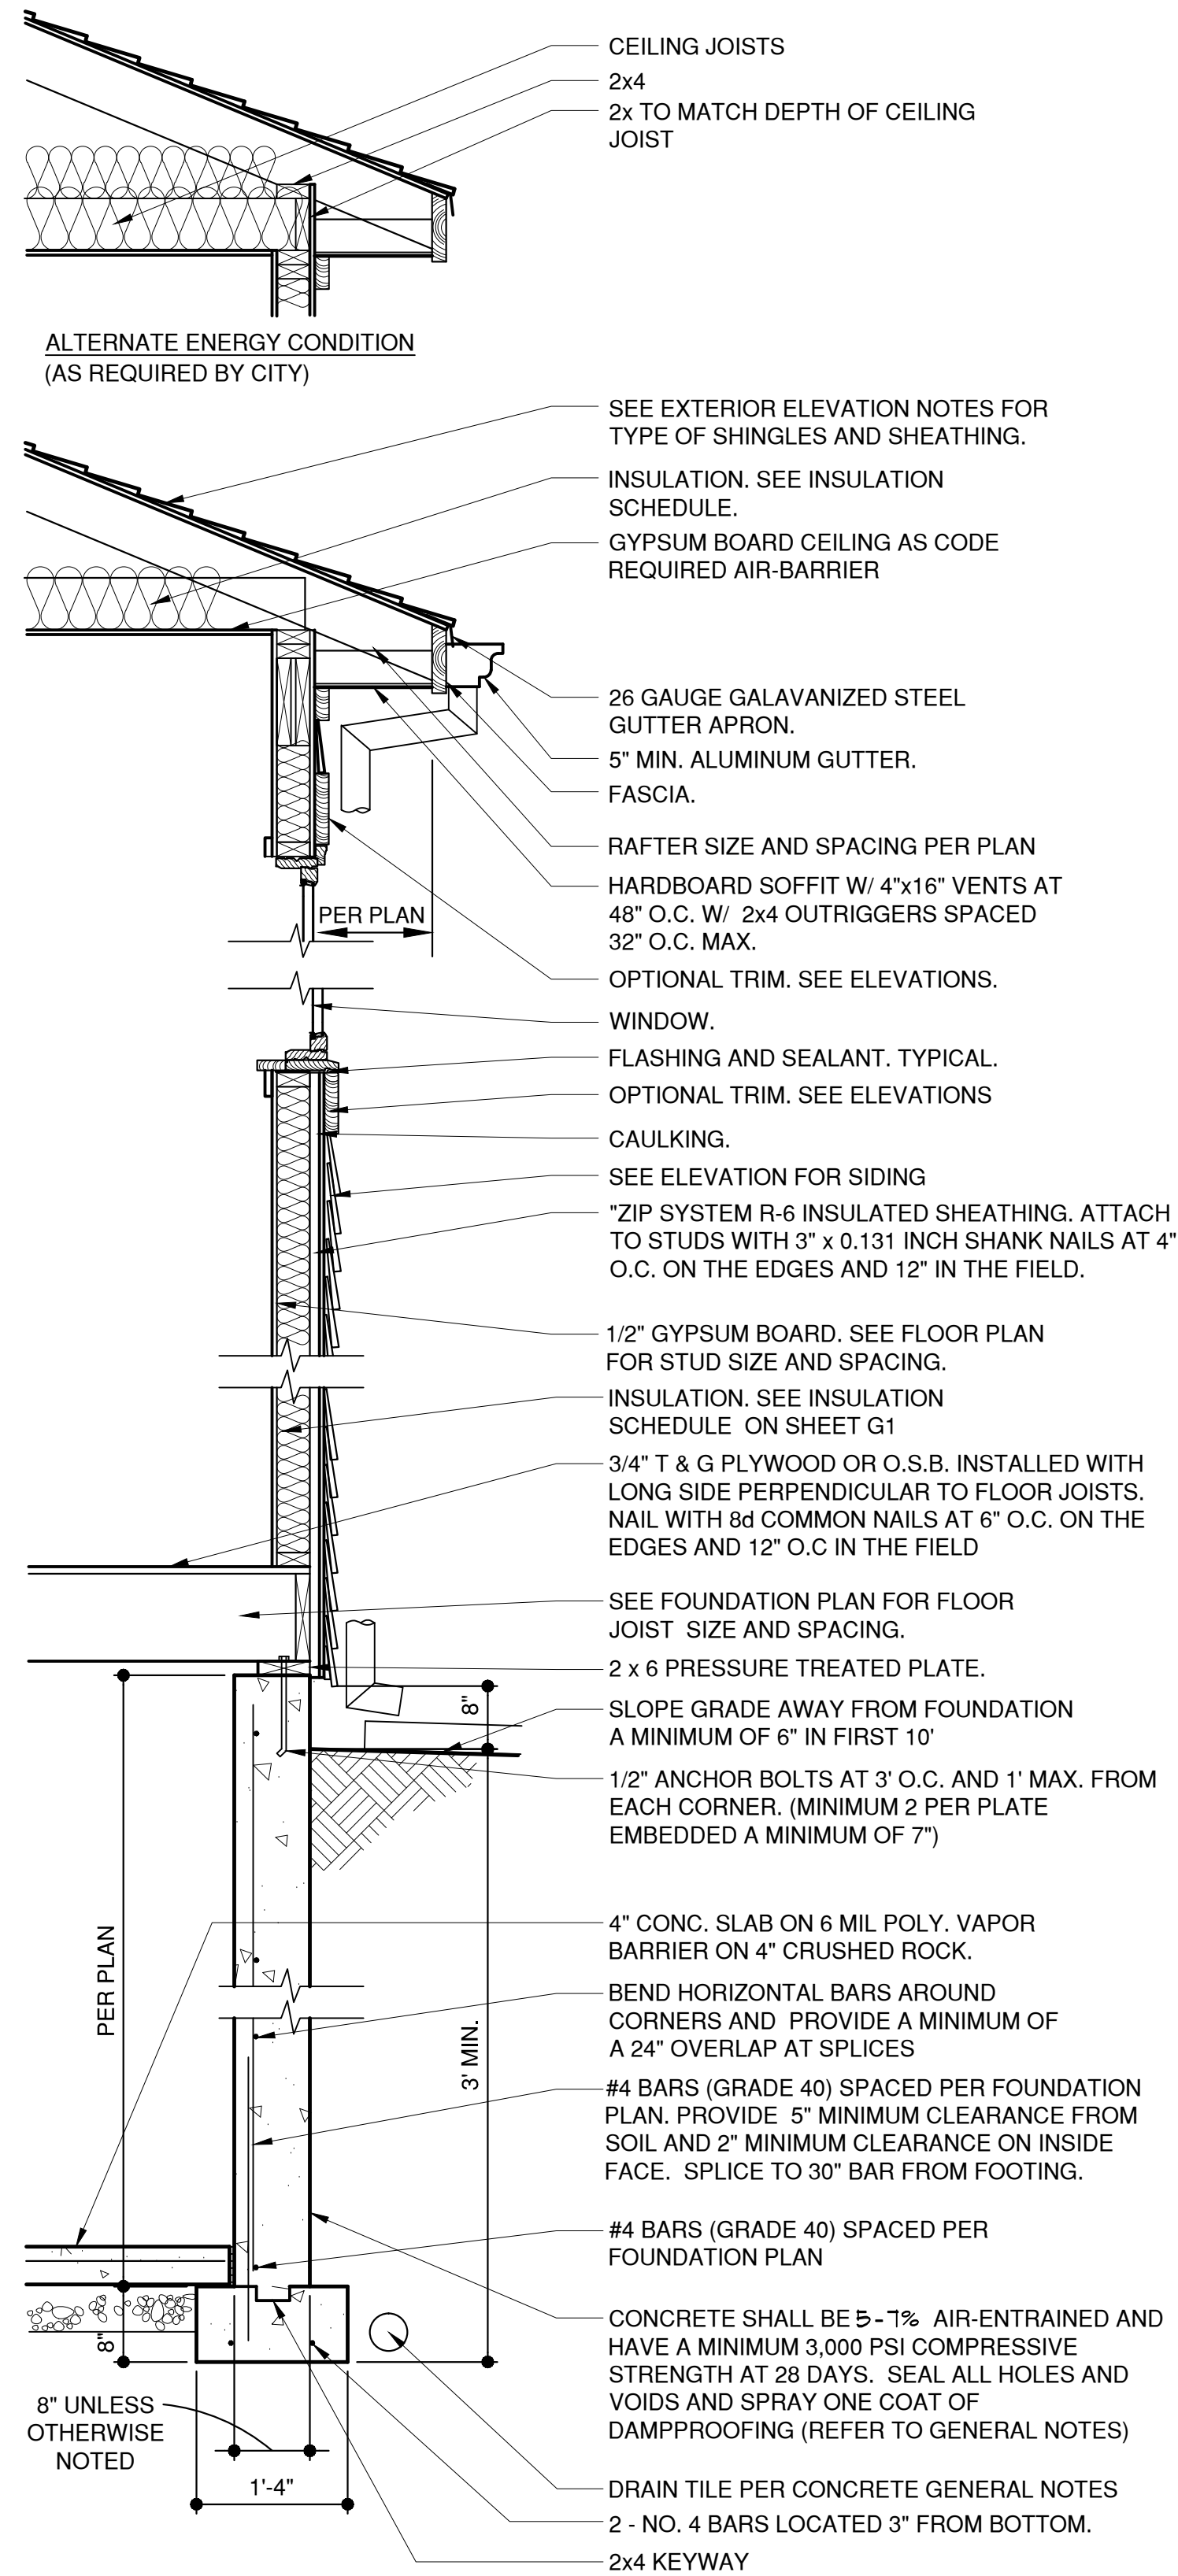


1 WALL SECTION
3/4"=1'-0"
A-DTW-06062-19 E

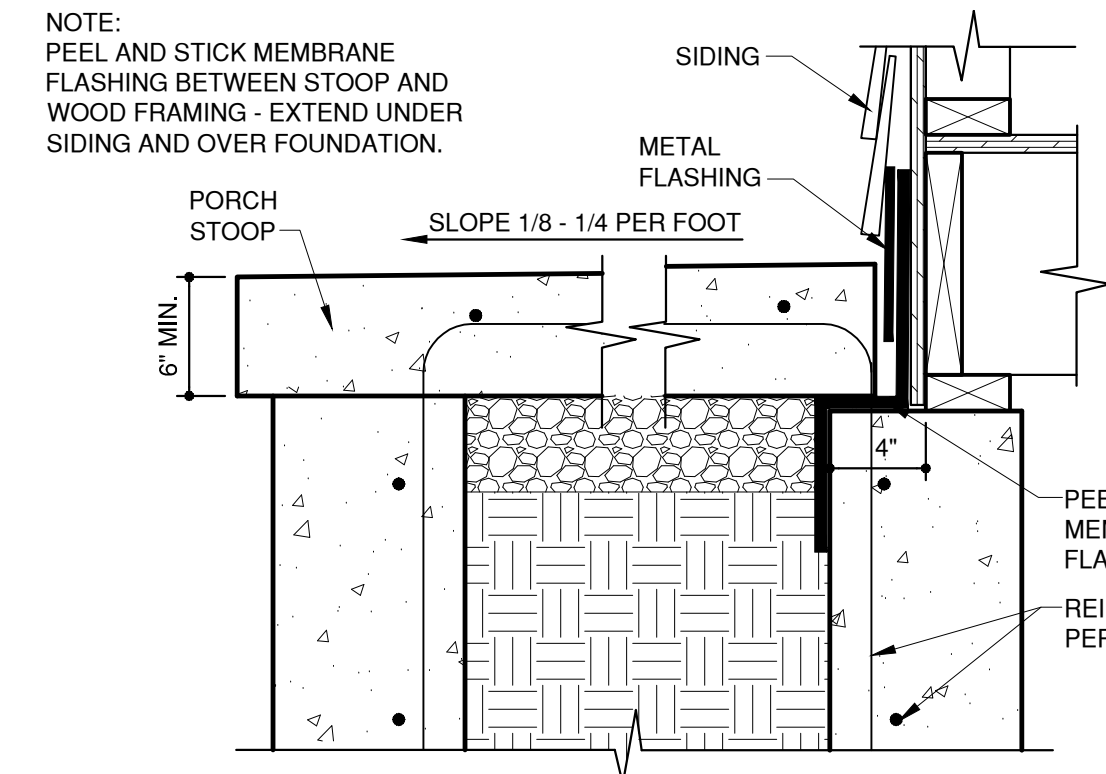


4 STOOP DETAIL
1 1/2"=1'-0"
A-DTV-03300-35B

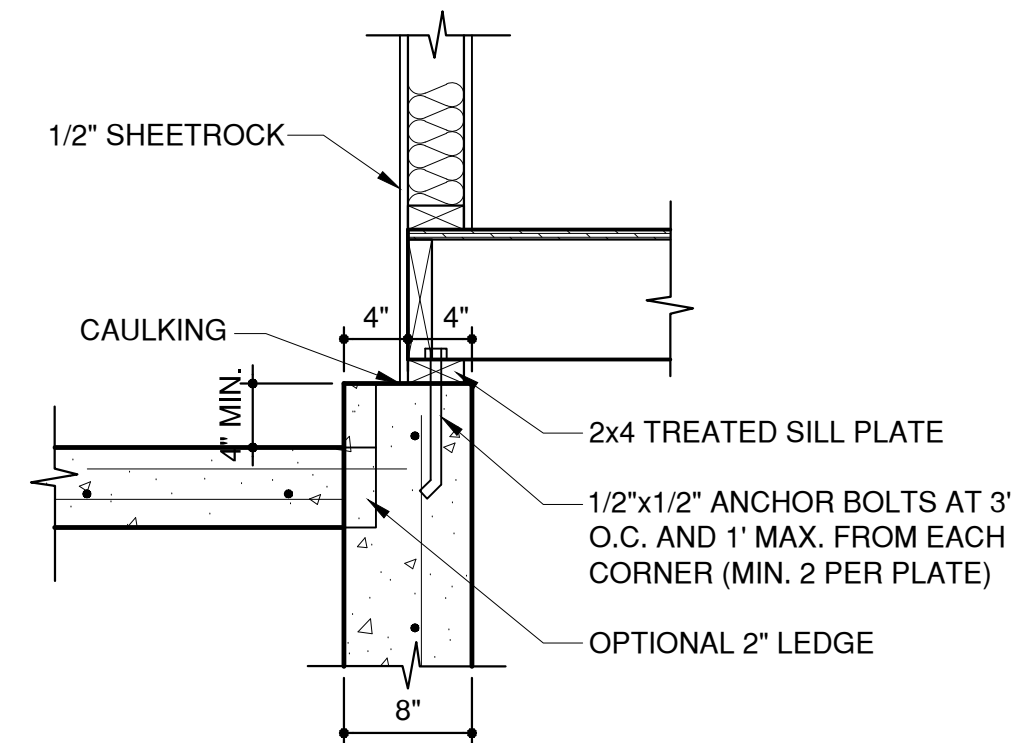


5 HOUSE GARAGE WALL SETBACK
1"=1'-0"
A-DTV-03300-39B

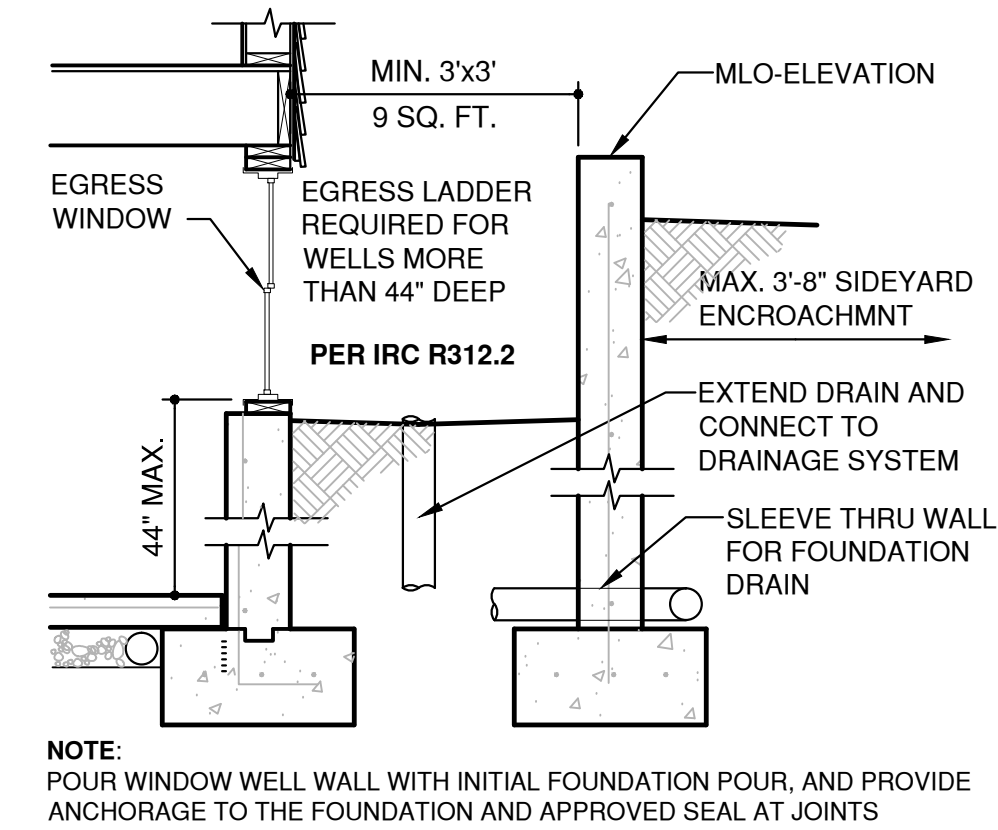


9 WINDOW WELL SECTION
1/2"=1'-0"
A-DTW-06062-26

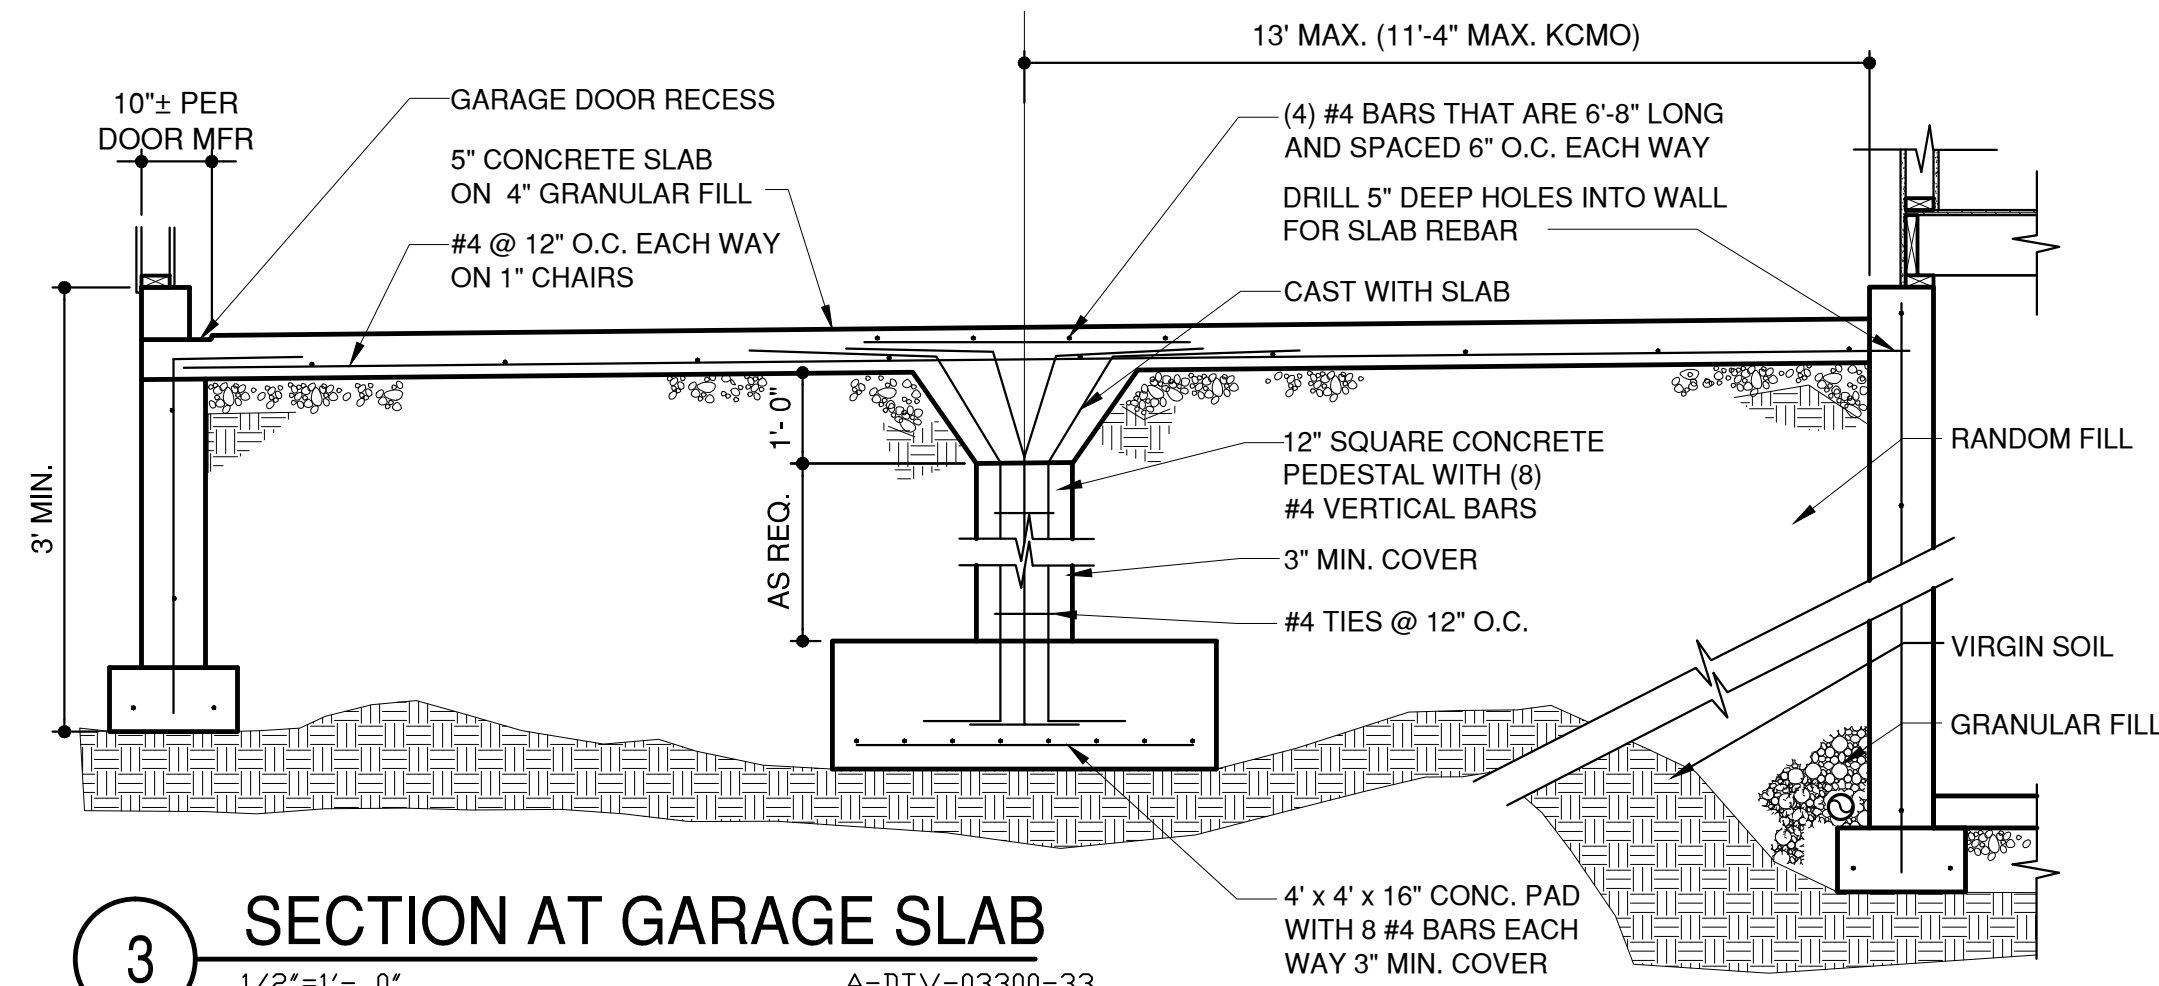








3 SECTION AT GARAGE SLAB
1/2"=1'-0"
A-DTV-03300-33

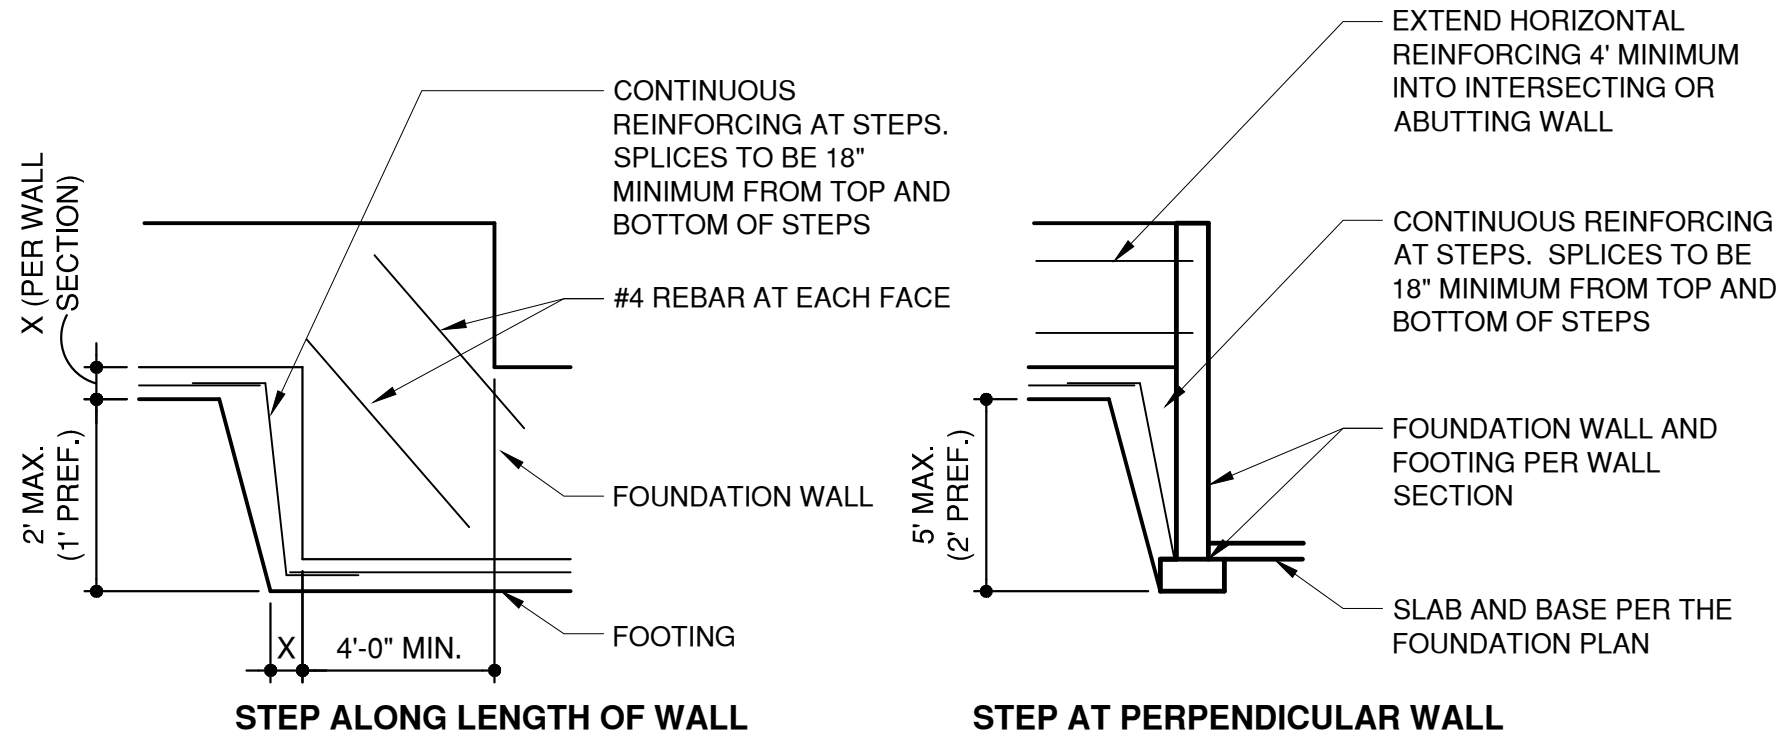

2 ELEVATION AT FOUNDATION STEP
1/4"=1'-0"
A-DTE-03300-01

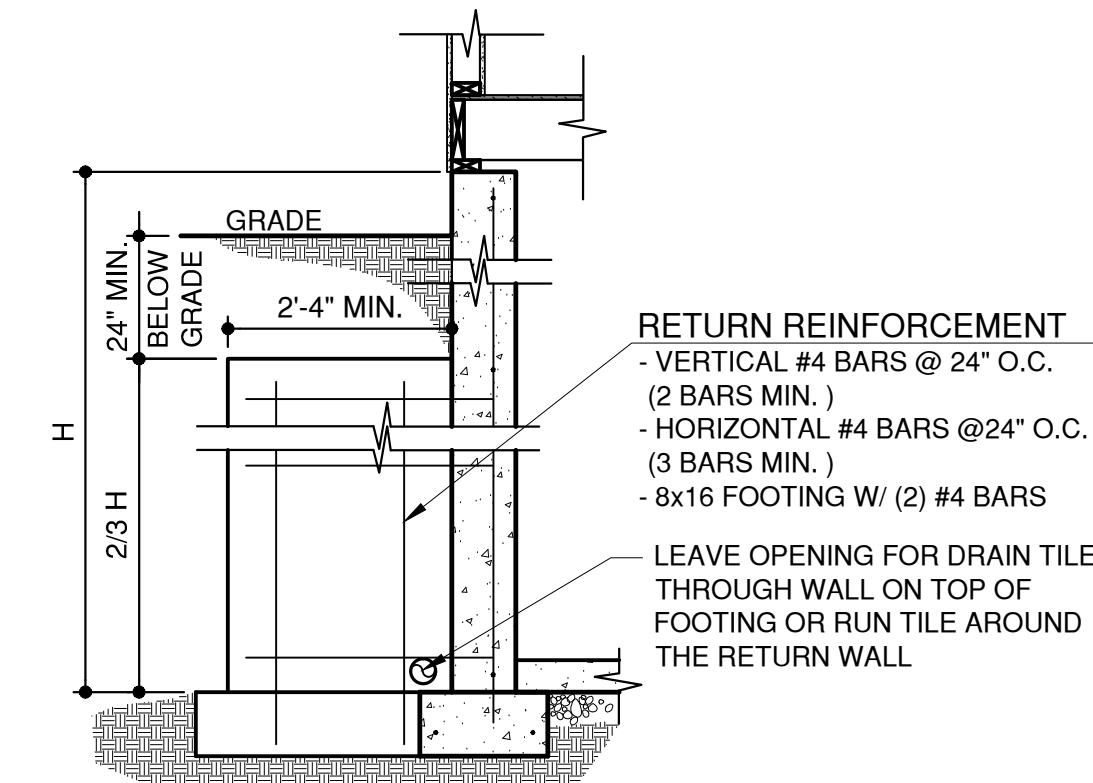

8 RETURN WALL DETAIL
1/2"=1'-0"
A-DTV-03300-34

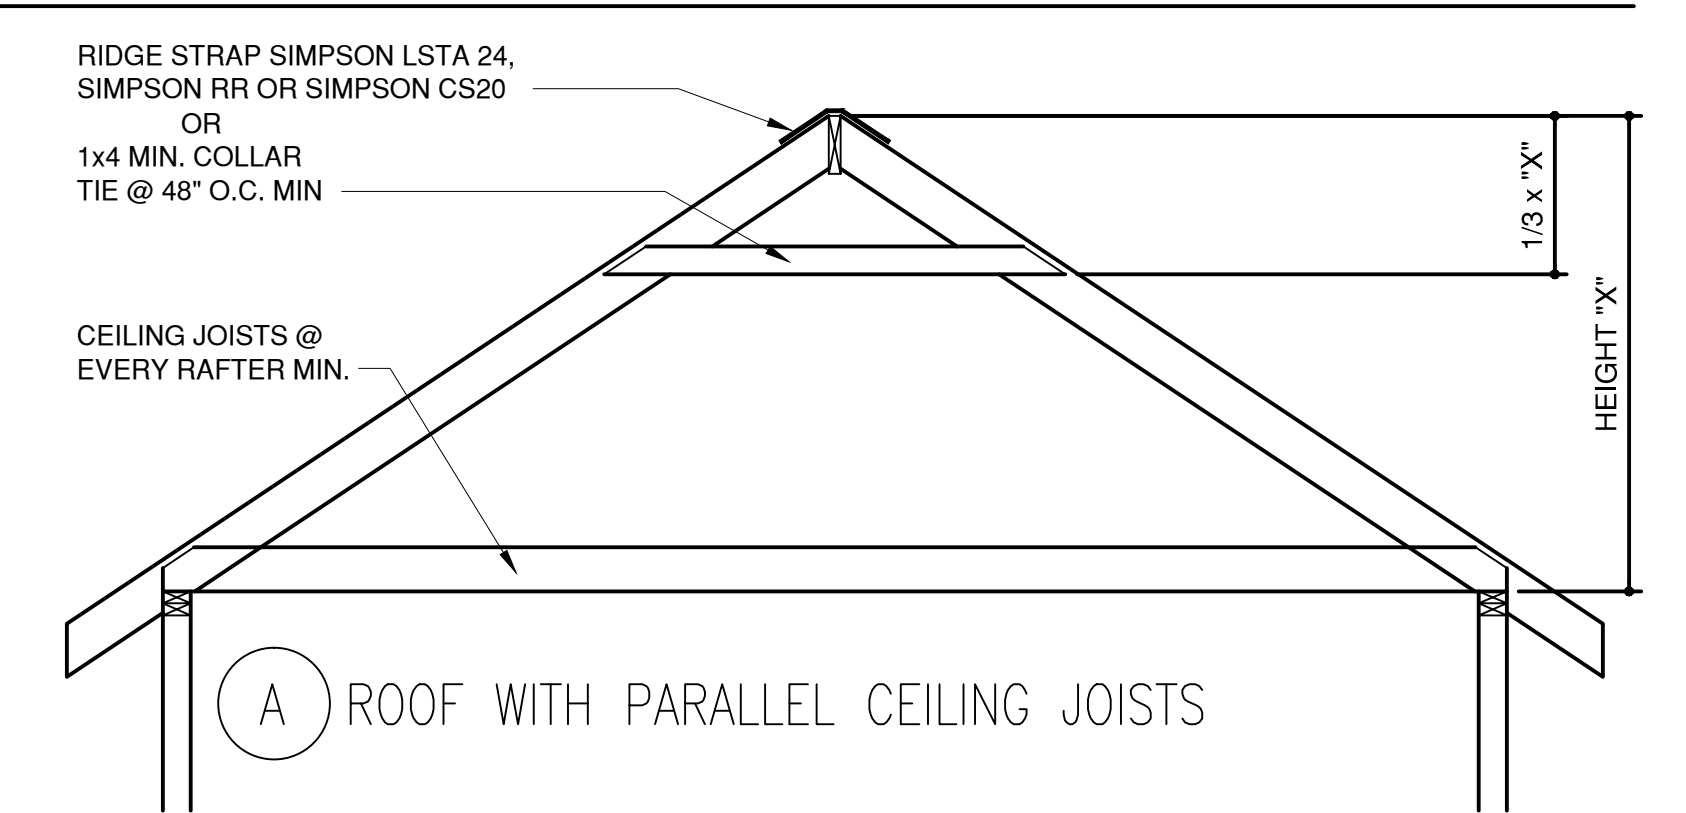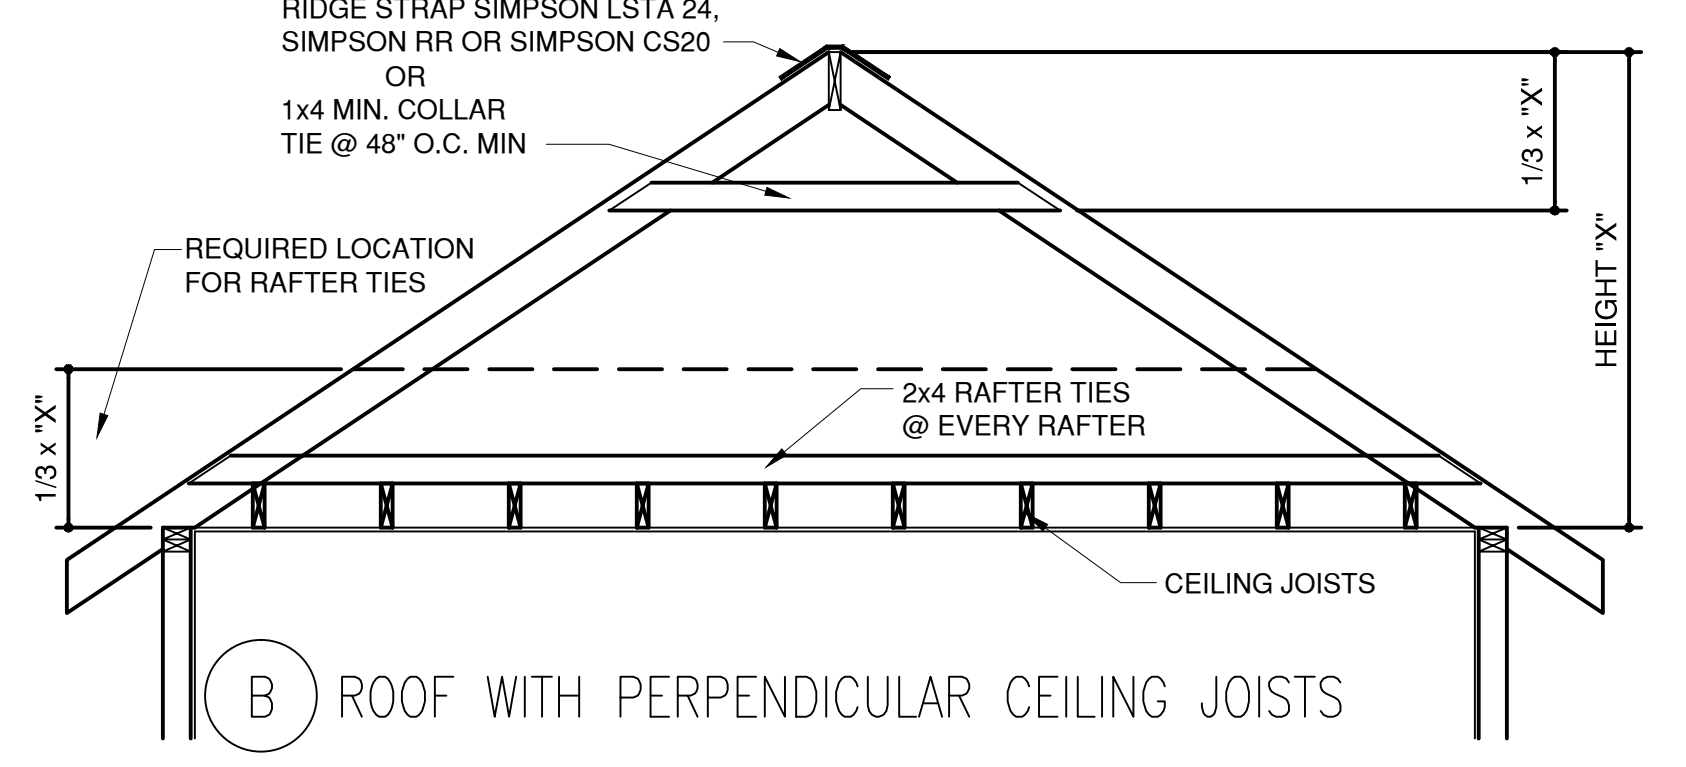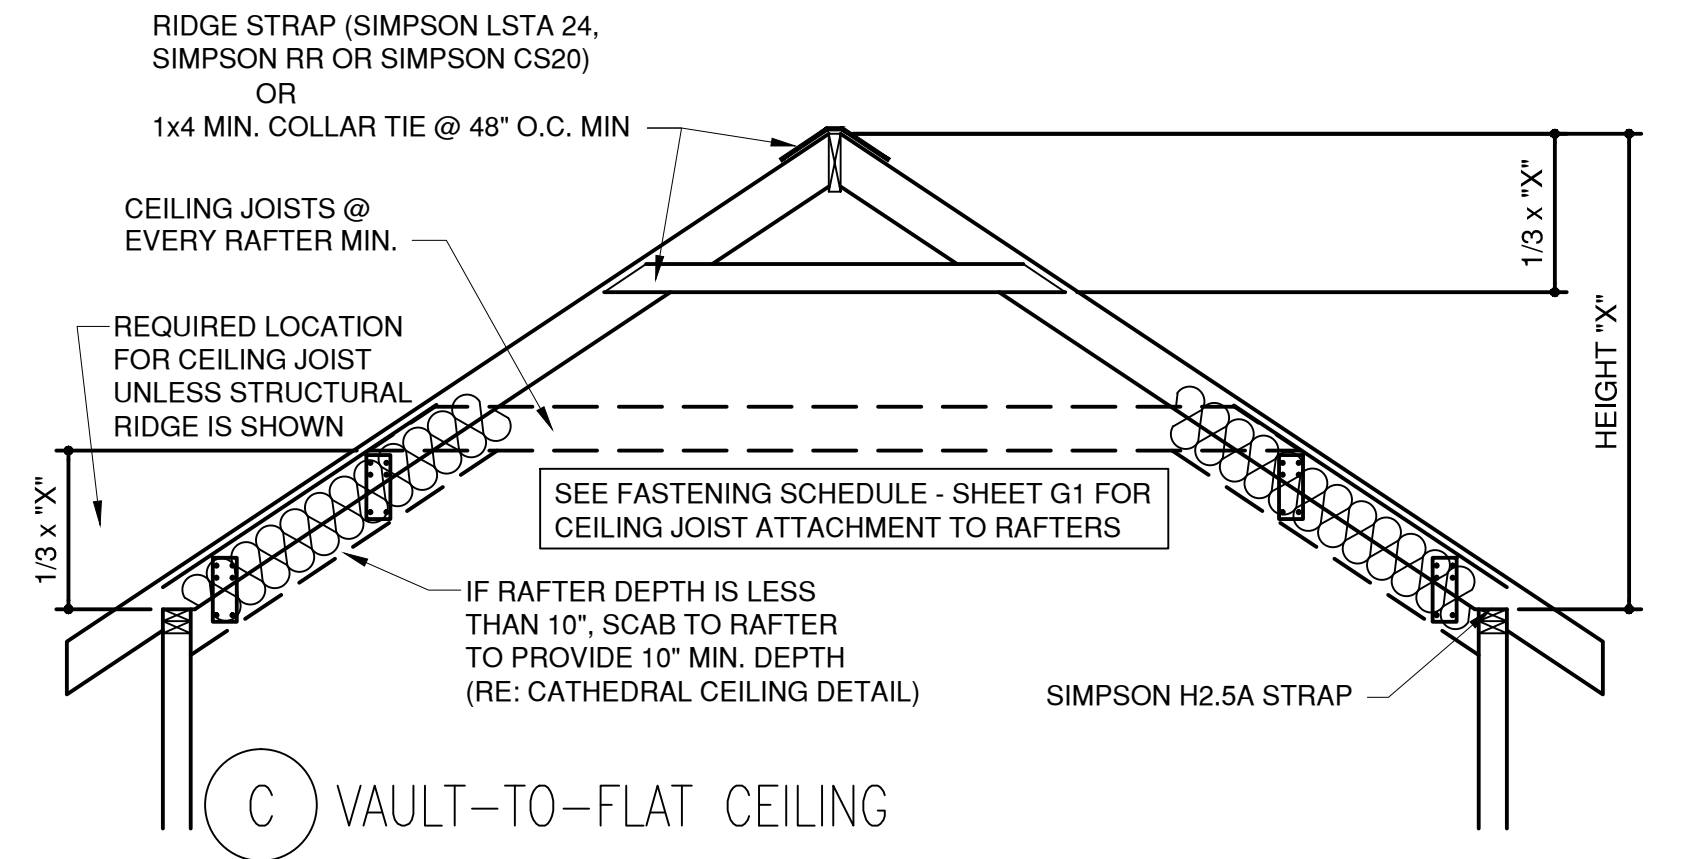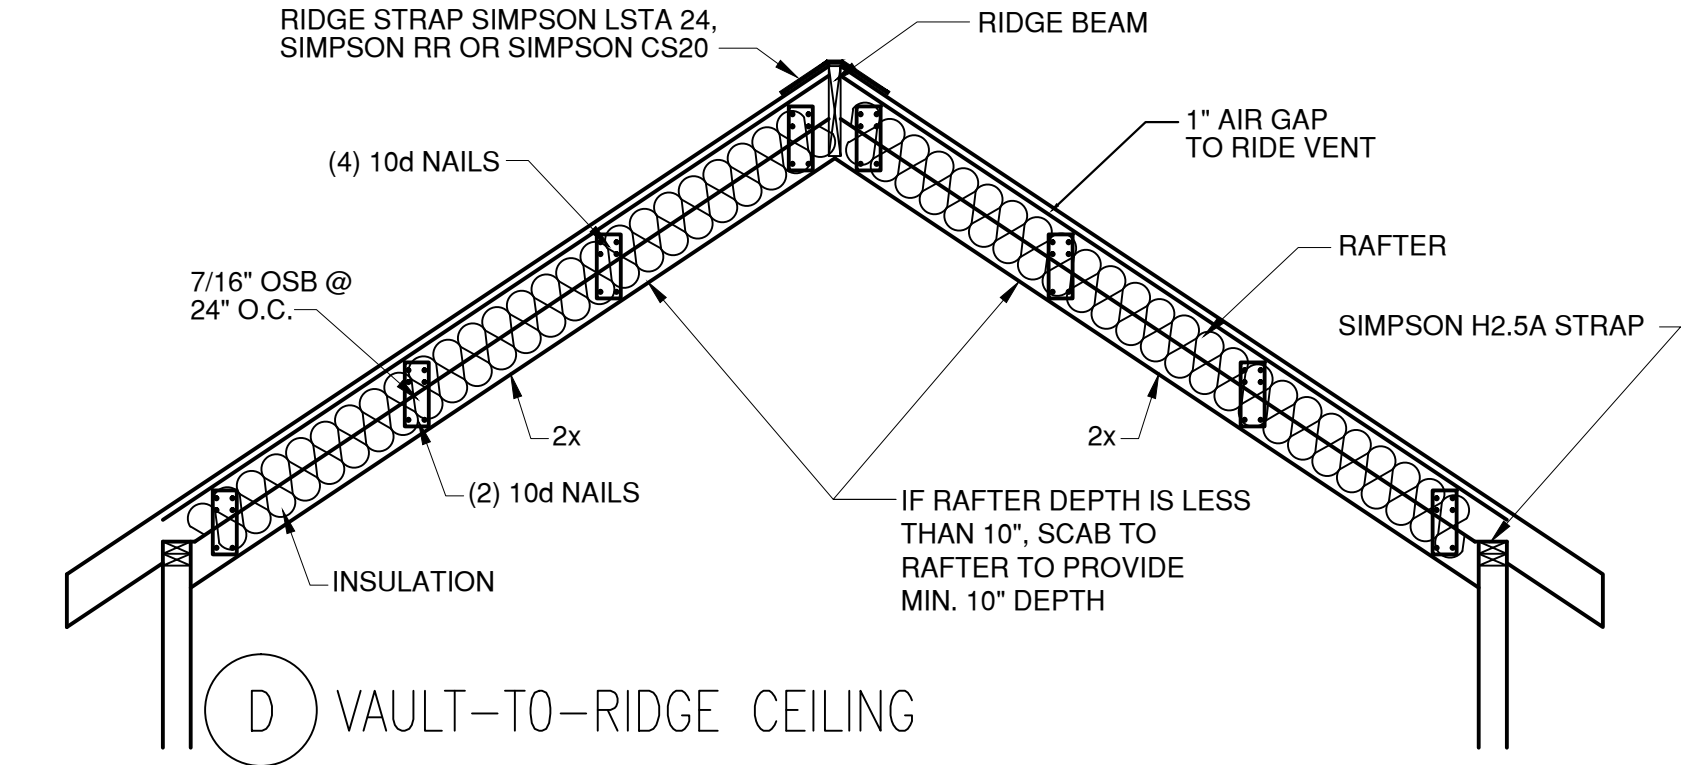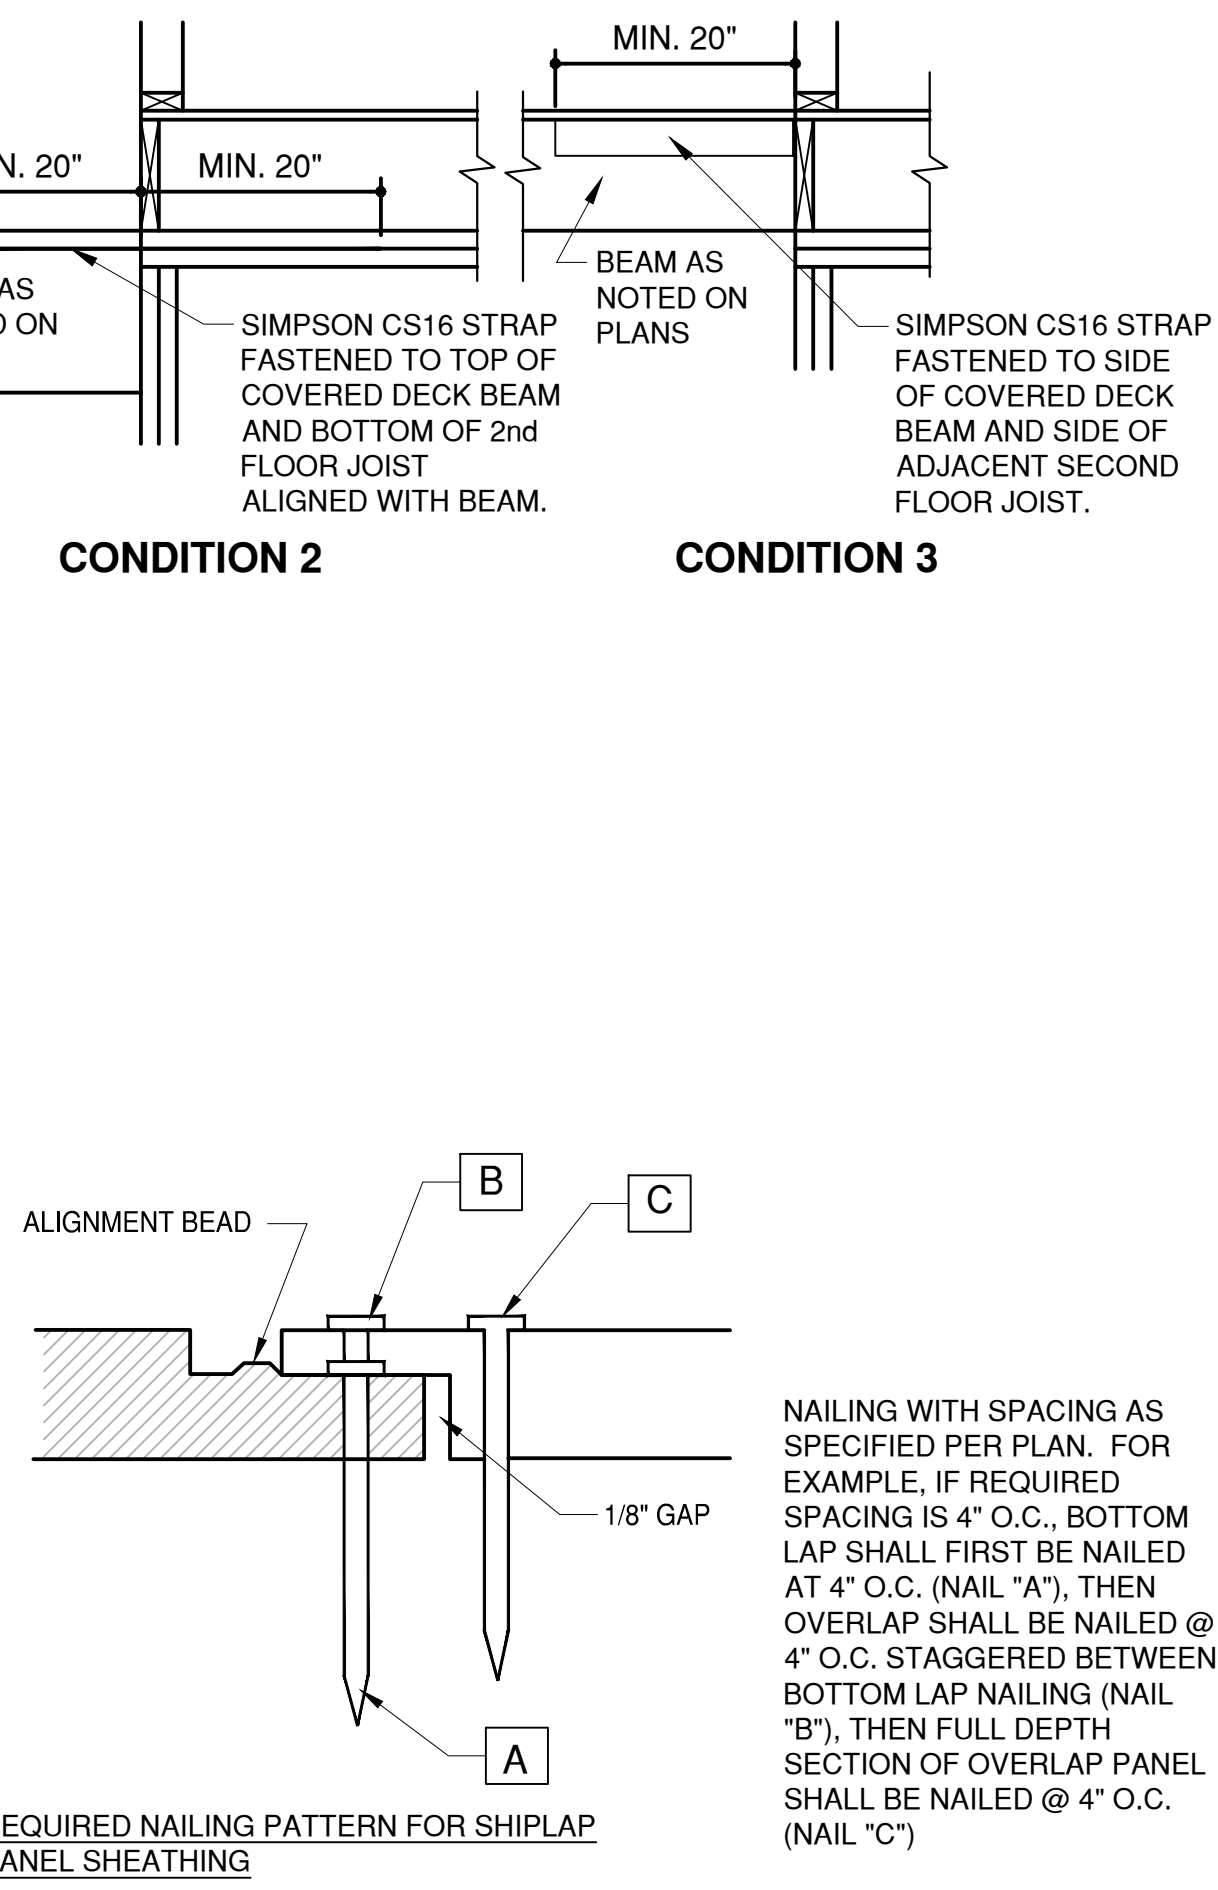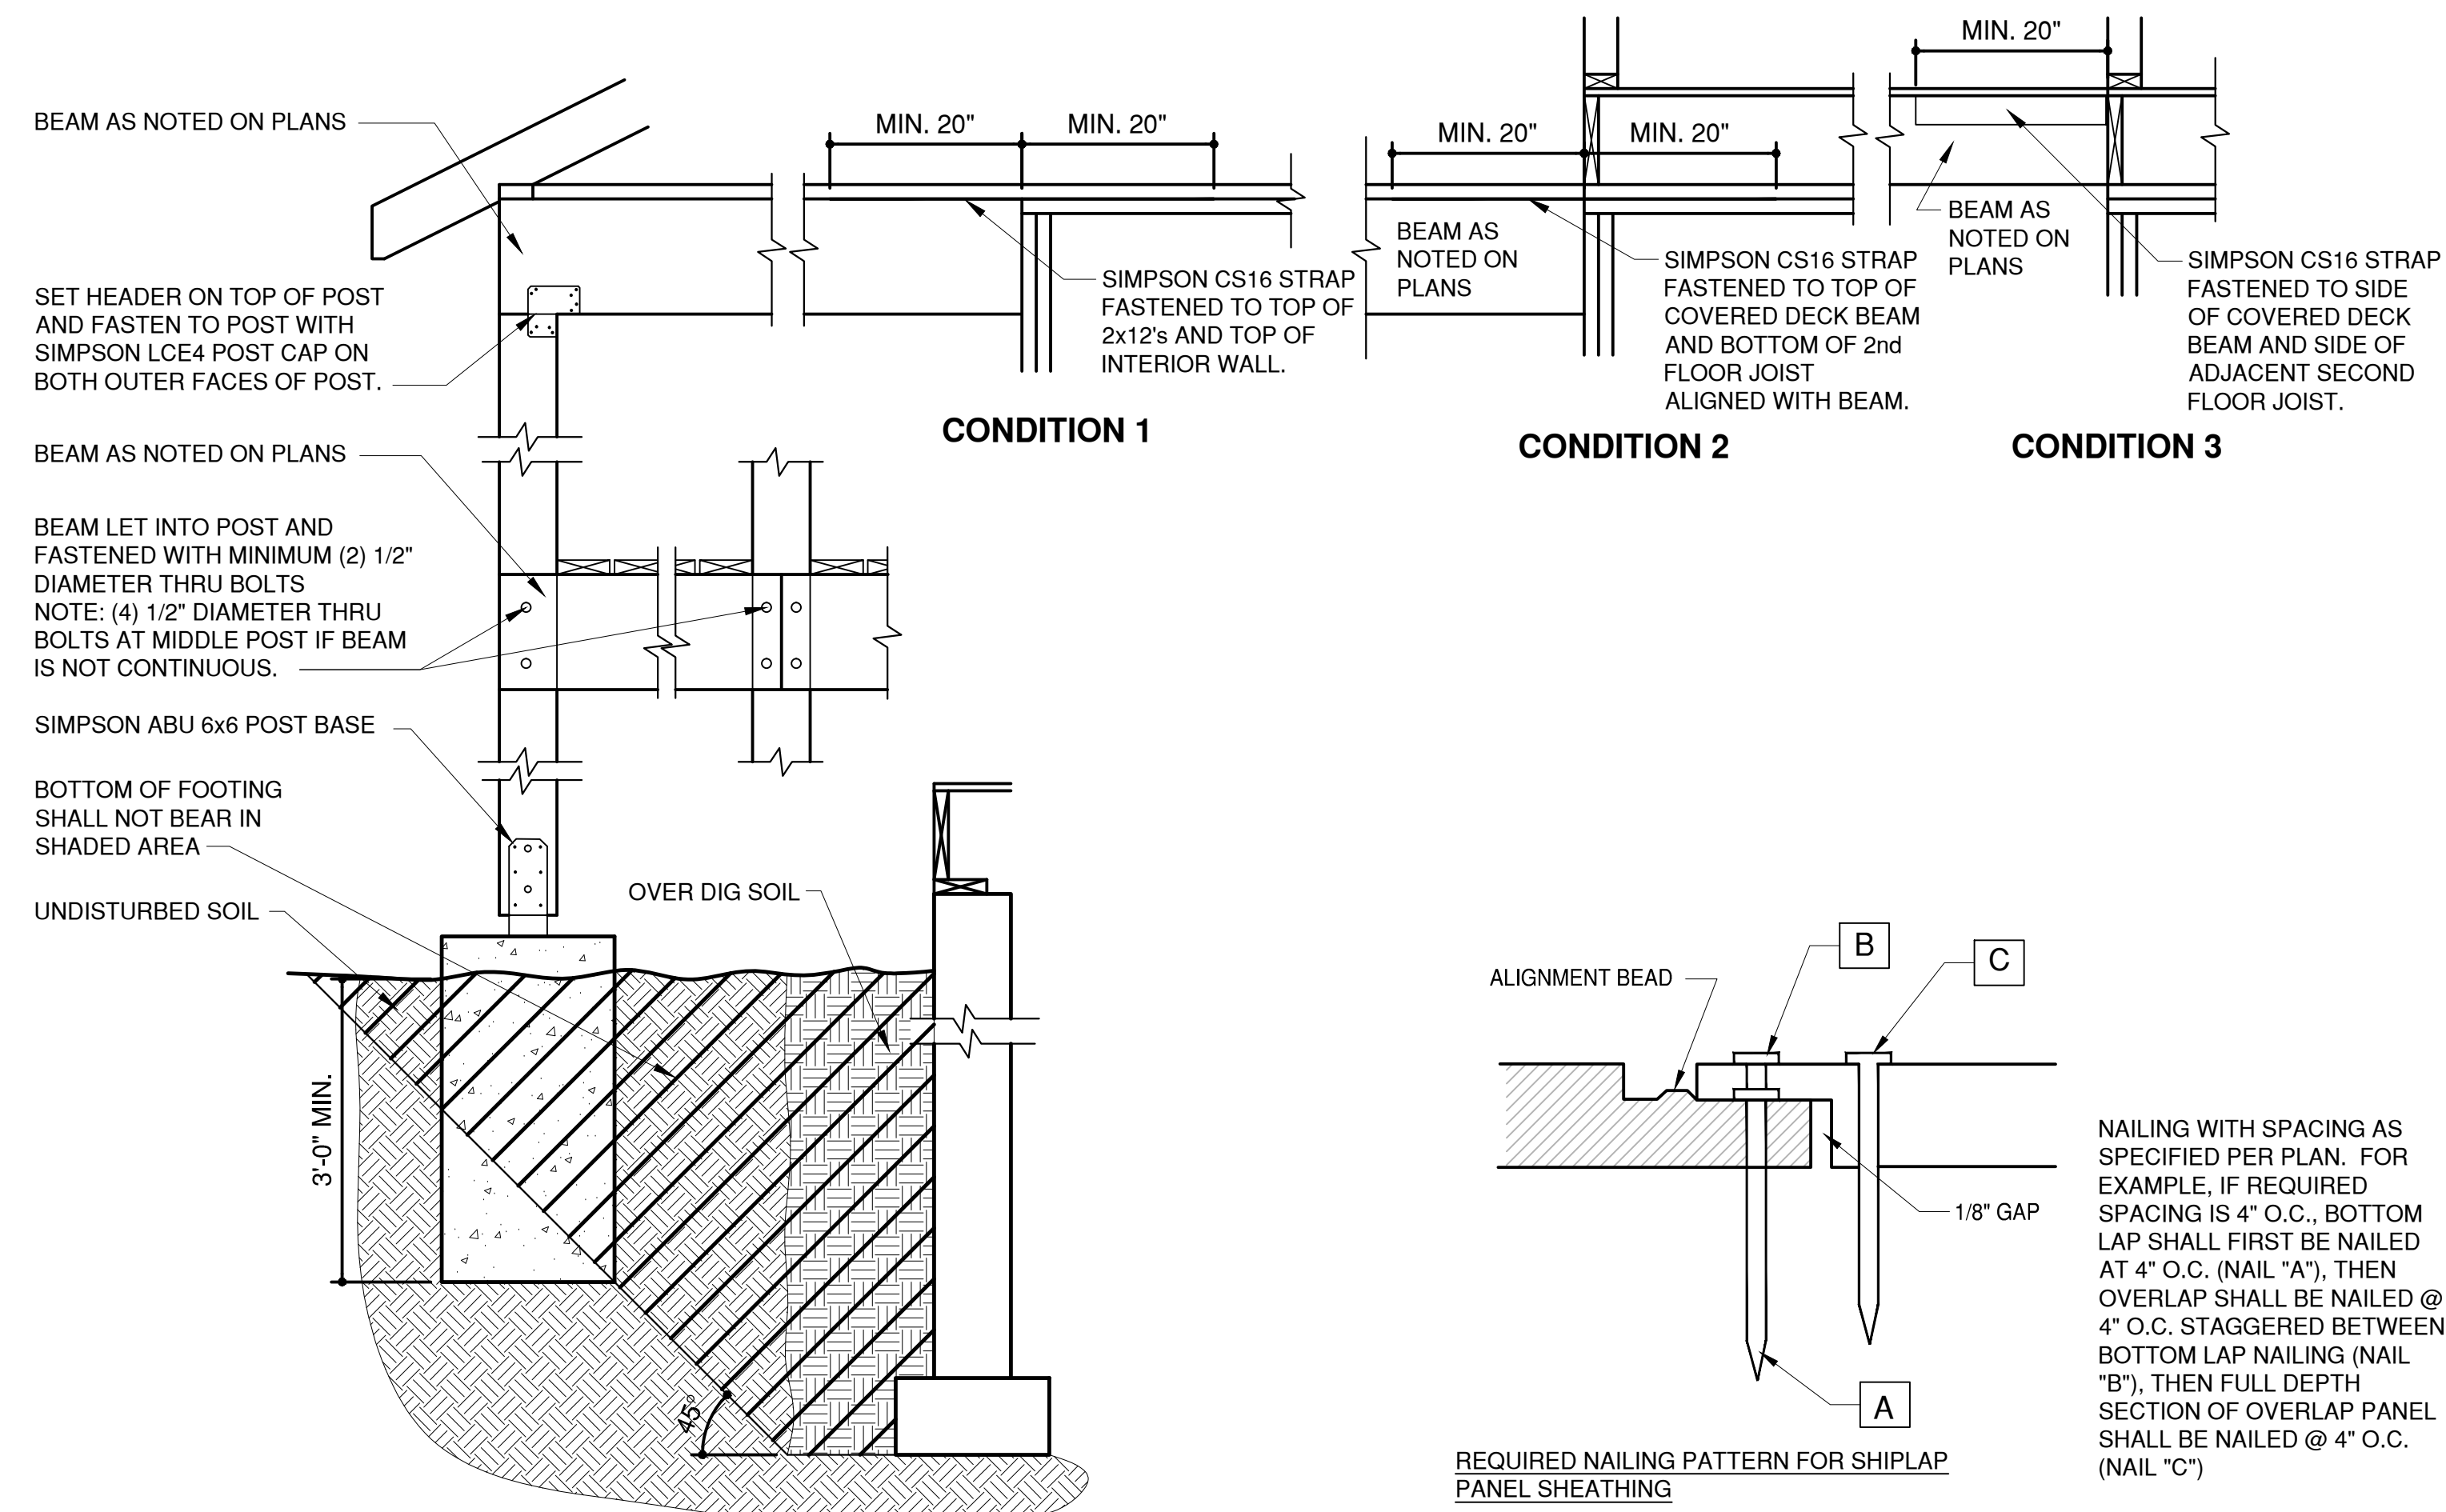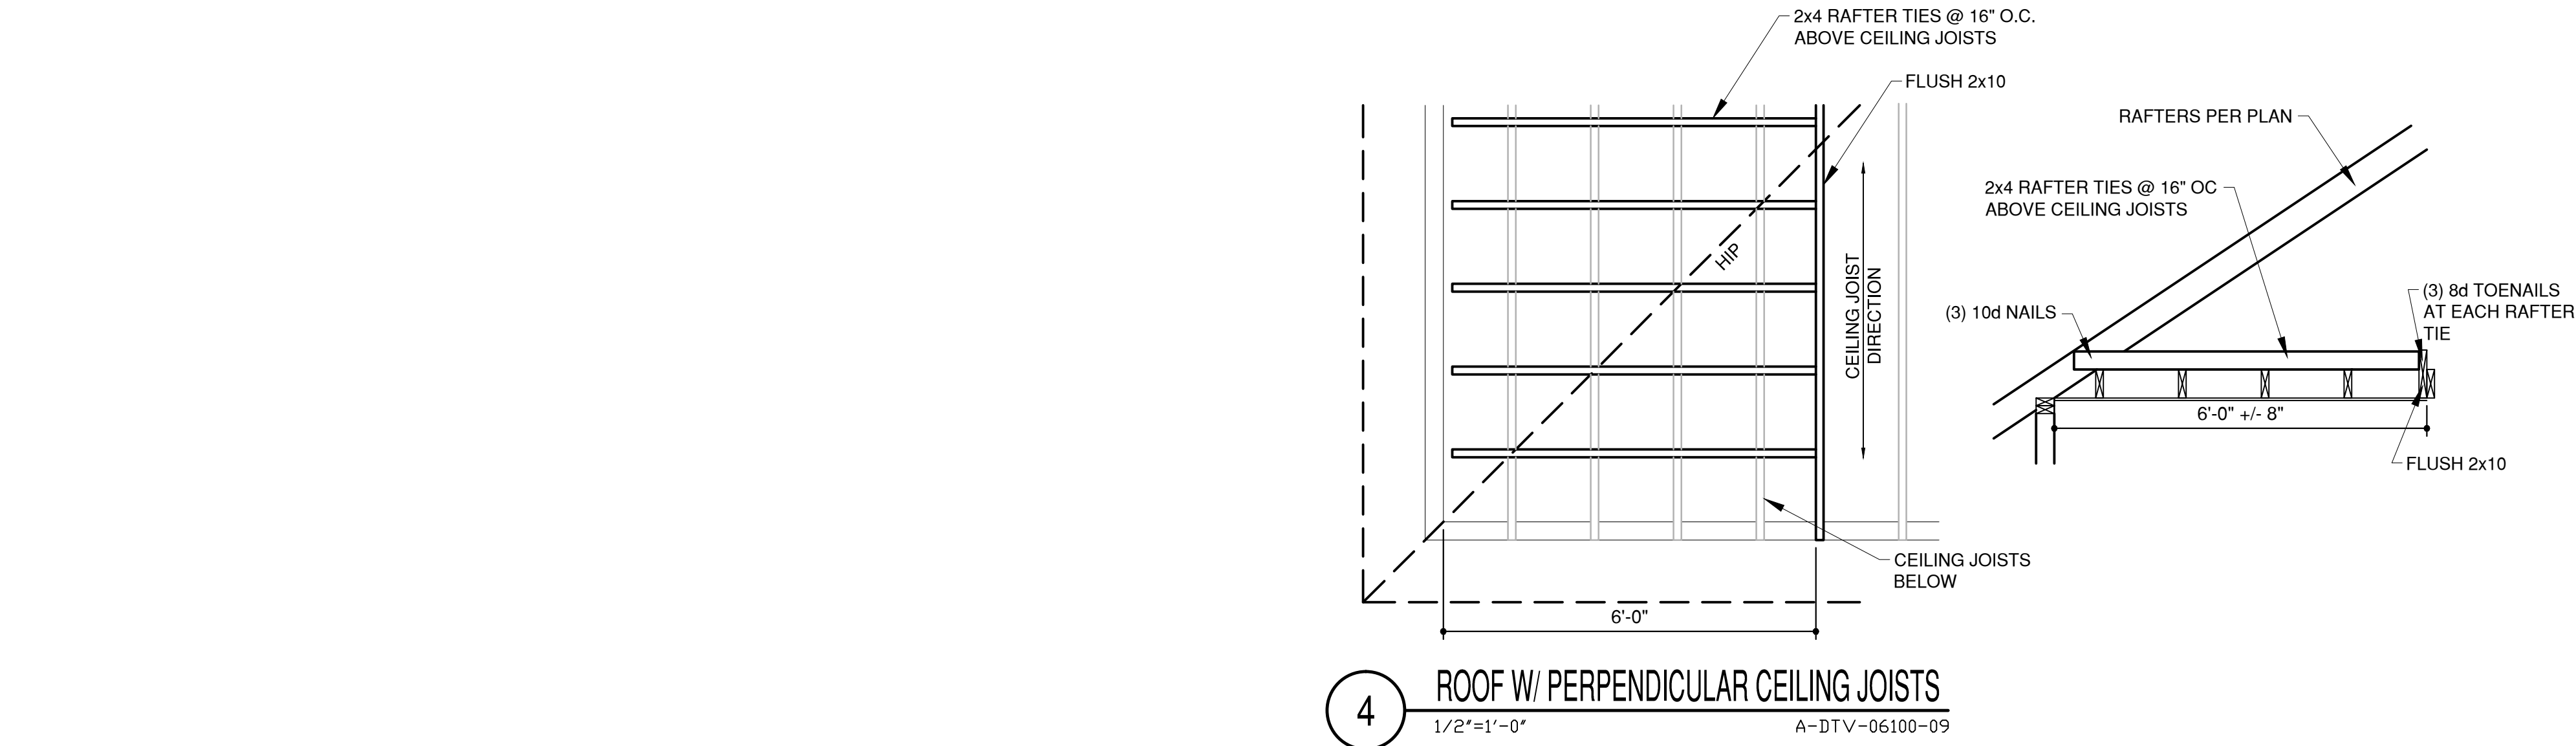

NOTE:
ROOF FRAMING TO COMPLY WITH SECTIONS
R802, R802.3, R802.3.1 AND R802.11

1-5-2022

COPYRIGHT 2013
A PLACE CALLED HOME
CONSTRUCTION CO., INC.

2655 W. VALLEY PARKWAY
SUITE 110
CLATHE, KS 66061-8429
PHONE: 913-390-4663
FAX: 913-390-4664
www.WebsterArchitects.com

PARK RIDGE, 6TH PLAT
1900 NE PARK RIDGE DRIVE
LEE'S SUMMIT, MO. 64064

A PLACE CALLED HOME CONSTRUCTION CO., INC.
804 SE WILLOW PLACE • 816-365-4663
BLUE SPRINGS, MO. 64014


STATE OF MISSOURI
DANIEL J. WEBSTER
REGISTERED ARCHITECT
A-5400
3/30/2022

DRAWN BY: GV
DATE: 3-29-22
PROJECT NO: 11-0201-16

SHEET NO. 33
PLEASE FOR
DESIGNATION
AS NOTED
Development Services
LEE'S SUMMIT, MISSOURI

2-9-21

a. DR = DESIGN REQUIRED
b. STRAP SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.

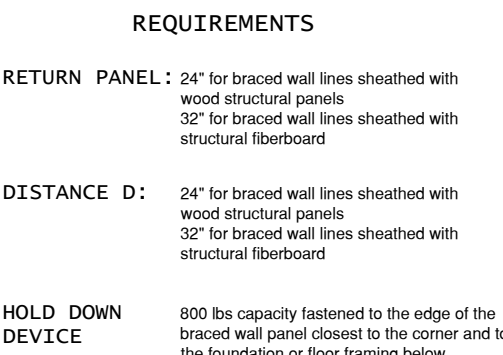

NOTES:
A. SEE XXX ON BRACED WALL PLAN FOR BRACED WALL METHOD.


$$1/2^{\circ} = 1'-0''$$

A-DTE-06100-25 PF


$$3/16'' = 1'-0''$$

SUITE 110
OLATHE, KS 66061-8429
PHONE: 913-390-4663
FAX: 913-390-4664
www.WebsterArchitects.com

The logo for Webster architects features the word "Webster" in a large, stylized, blue, hand-drawn font. Below it, the word "architects" is written in a smaller, blue, sans-serif font. The entire logo is set against a background of a blue and white architectural drawing, possibly a floor plan or a technical drawing of a building structure.

A PLACE CALLED HOME CONSTRUCTION CO., INC.
804 SE WILLOW PLACE • 816-365-4663
BLUE SPRINGS, MO 64014

STATE OF MISSOURI
DANIEL J. WEBSTER
NUMBER
A-5400
REGISTERED ARCHITECT
Do 3/30/2016

DRAWN BY: GV
DATE: 3-29-22
PROJECT NO: 11-007-16

RELEASE FOR
CONSTRUCTION
AS NOTED ON PLAN
Development Section
LEE'S SUMMIT, MISSOURI