



RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
04/04/2022 3:35:36

RE: B220054
Lot 145 CB

MiTek USA, Inc.
16023 Swingley Ridge Rd
Chesterfield, MO 63017
314-434-1200

Site Information:

Customer: Project Name: B220054
Lot/Block:
Address:
City:

Model:
Subdivision:
State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2012/TPI2007
Wind Code:
Roof Load: 45.0 psf

Design Program: MiTek 20/20 8.4
Wind Speed: 115 mph
Floor Load: N/A psf

This package includes 29 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	I50049365	A1	2/4/2022	21	I50049385	J1	2/4/2022
2	I50049366	A2	2/4/2022	22	I50049386	J2	2/4/2022
3	I50049367	A3	2/4/2022	23	I50049387	V1	2/4/2022
4	I50049368	A4	2/4/2022	24	I50049388	V2	2/4/2022
5	I50049369	A5	2/4/2022	25	I50049389	V3	2/4/2022
6	I50049370	A6	2/4/2022	26	I50049390	V4	2/4/2022
7	I50049371	A7	2/4/2022	27	I50049391	V5	2/4/2022
8	I50049372	A8	2/4/2022	28	I50049392	V6	2/4/2022
9	I50049373	A9	2/4/2022	29	I50049393	V7	2/4/2022
10	I50049374	A10	2/4/2022				
11	I50049375	A11	2/4/2022				
12	I50049376	A12	2/4/2022				
13	I50049377	A13	2/4/2022				
14	I50049378	A14	2/4/2022				
15	I50049379	B1	2/4/2022				
16	I50049380	C1	2/4/2022				
17	I50049381	D1	2/4/2022				
18	I50049382	D2	2/4/2022				
19	I50049383	E1	2/4/2022				
20	I50049384	E2	2/4/2022				

The truss drawing(s) referenced above have been prepared by
MiTek USA, Inc. under my direct supervision
based on the parameters provided by Wheeler - Waverly.

Truss Design Engineer's Name: Sevier, Scott

My license renewal date for the state of Missouri is December 31, 2023.

Missouri COA: 001193

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek. Any project specific information included is for MiTek customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



February 04, 2022


Job	Truss	Truss Type	Qty	Ply	Lot 145 CB	
B220054	A1	Common Supported Gable	1	1	Job Reference (optional)	I50049365

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:03

Page: 1

ID:ndaavQMNG9iZBi8tqa2fznuPP9-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

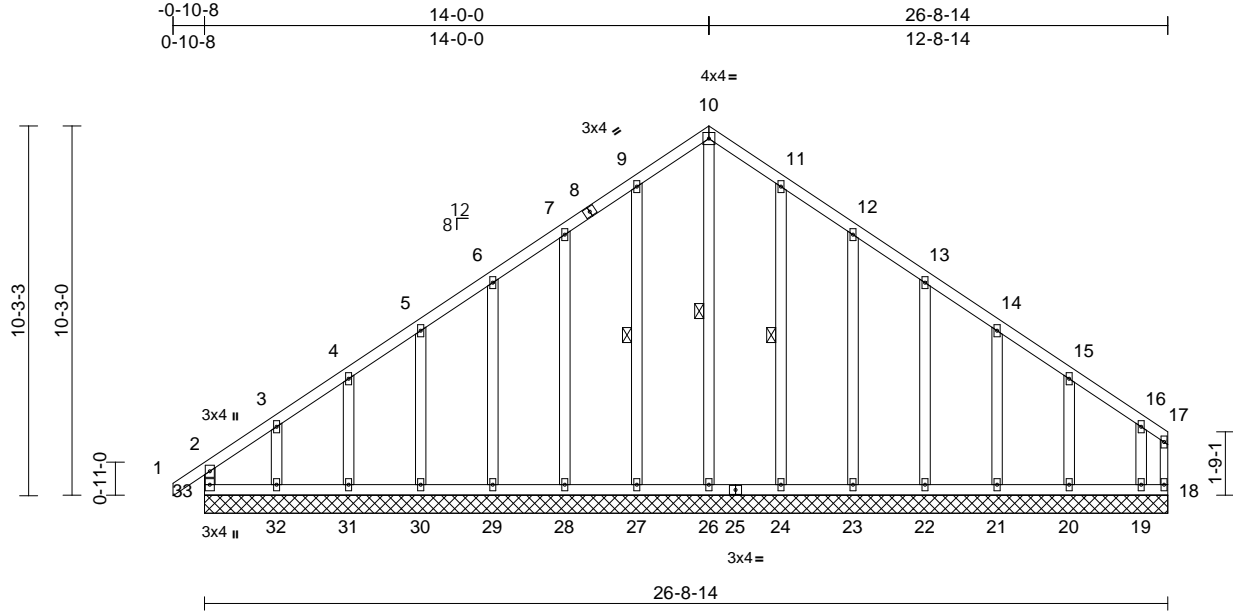

Scale = 1:64

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.14	Vert(LL)	n/a	-	n/a	999	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.10	Vert(TL)	n/a	-	n/a	999	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.14	Horiz(TL)	0.00	18	n/a	n/a	
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-R							
Weight: 150 lb FT = 10%											

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x4 SPF No.2 *Except* 17-18:2x3 SPF No.2
OTHERS	2x4 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	1 Row at midpt 10-26, 9-27, 11-24

REACTIONS (lb/size)	18=3/26-8-14, 19=140/26-8-14, 20=187/26-8-14, 21=178/26-8-14, 22=181/26-8-14, 23=179/26-8-14, 24=187/26-8-14, 26=164/26-8-14, 27=187/26-8-14, 28=179/26-8-14, 29=180/26-8-14, 30=179/26-8-14, 31=184/26-8-14, 32=163/26-8-14, 33=164/26-8-14
Max Horiz	33=291 (LC 5)
Max Uplift	18=111 (LC 7), 19=153 (LC 9), 20=70 (LC 9), 21=70 (LC 9), 22=68 (LC 9), 23=77 (LC 9), 24=57 (LC 9), 26=54 (LC 7), 27=62 (LC 8), 28=75 (LC 8), 29=68 (LC 8), 30=75 (LC 8), 31=48 (LC 8), 32=164 (LC 8), 33=201 (LC 4)
Max Grav	18=127 (LC 9), 19=223 (LC 16), 20=191 (LC 16), 21=186 (LC 16), 22=187 (LC 16), 23=188 (LC 16), 24=191 (LC 16), 26=332 (LC 9), 27=199 (LC 15), 28=184 (LC 15), 29=186 (LC 15), 30=191 (LC 15), 31=184 (LC 1), 32=267 (LC 15), 33=294 (LC 16)

FORCES (lb) - Maximum Compression/Maximum Tension	
---	--

TOP CHORD	2-33=-242/168, 1-2=0/40, 2-3=-289/275, 3-4=-234/229, 4-5=-224/232, 5-6=-202/232, 6-7=-186/269, 7-9=-169/309, 9-10=-146/338, 10-11=-129/326, 11-12=-106/268, 12-13=-87/198, 13-14=-69/134, 14-15=-52/96, 15-16=-49/58, 16-17=-84/50, 17-18=-79/52
BOT CHORD	32-33=-59/59, 31-32=-59/59, 30-31=-59/59, 29-30=-59/59, 28-29=-59/59, 27-28=-59/59, 26-27=-59/59, 24-26=-59/59, 23-24=-59/59, 22-23=-59/59, 21-22=-59/59, 20-21=-59/59, 19-20=-59/59, 18-19=-59/59
WEBS	10-26=-308/94, 9-27=-159/86, 7-28=-144/99, 6-29=-147/92, 5-30=-149/97, 4-31=-144/83, 3-32=-185/144, 11-24=-151/81, 12-23=-147/101, 13-22=-147/93, 14-21=-146/93, 15-20=-152/97, 16-19=-147/122

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 201 lb uplift at joint 33, 111 lb uplift at joint 18, 54 lb uplift at joint 26, 62 lb uplift at joint 27, 75 lb uplift at joint 28, 68 lb uplift at joint 29, 75 lb uplift at joint 30, 48 lb uplift at joint 31, 164 lb uplift at joint 32, 57 lb uplift at joint 24, 77 lb uplift at joint 23, 68 lb uplift at joint 22, 70 lb uplift at joint 21, 70 lb uplift at joint 20 and 153 lb uplift at joint 19.

LOAD CASE(S) Standard



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job B220054	Truss A2	Truss Type Common	Qty 2	Ply 1	Lot 145 CB Job Reference (optional)	I50049366
----------------	-------------	----------------------	----------	----------	--	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:05
ID:4zVDNqSmclaaXnBDioChSFzuPP2-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

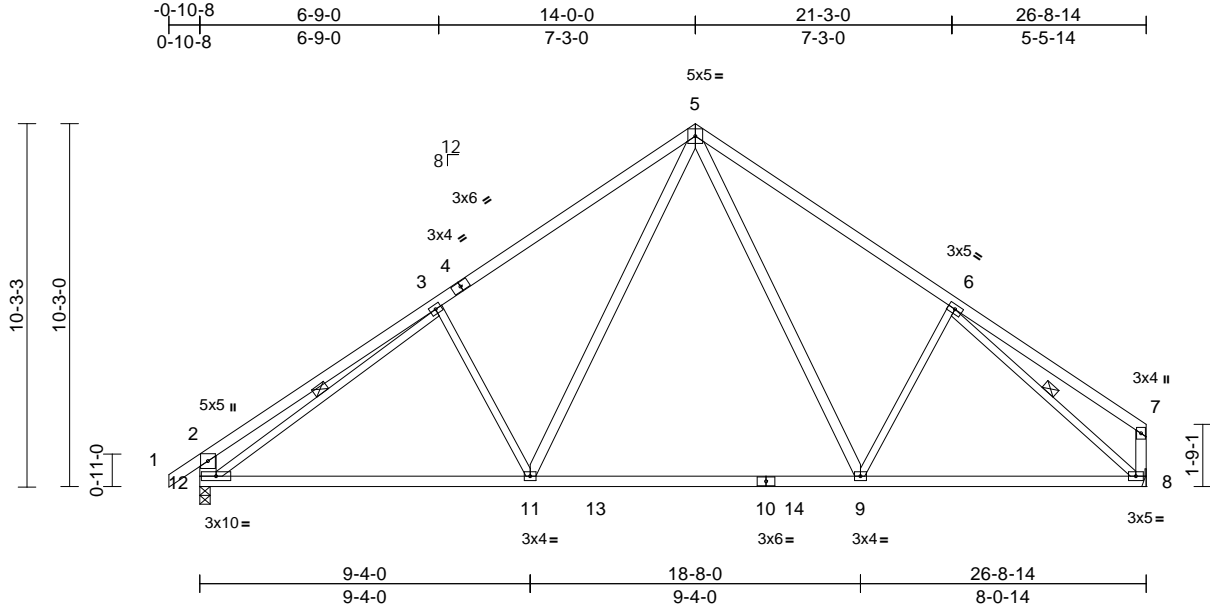

Scale = 1:65.1

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.71	Vert(LL)	-0.30	9-11	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.46	Vert(TL)	-0.47	9-11	>676	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.66	Horiz(TL)	0.04	8	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S		Wind(LL)	0.04	9-11	>999	240	Weight: 117 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF 2100F 1.8E
WEBS 2x3 SPF No.2 *Except* 11-5,9-5,8-7:2x4 SPF No.2, 12-2:2x6 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

WEBS 1 Row at midpt 3-12, 6-8

REACTIONS (lb/size) 8=1185/ Mechanical, 12=1265/0-3-8
Max Horiz 12=292 (LC 5)
Max Uplift 8=128 (LC 9), 12=161 (LC 8)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/43, 2-3=-593/218, 3-5=-1394/291, 5-6=-1306/272, 6-7=-178/73, 2-12=-556/215, 7-8=-198/81
BOT CHORD 11-12=-227/1338, 9-11=-17/868, 8-9=-103/1041
WEBS 3-11=-378/302, 5-11=-165/691, 5-9=-143/526, 6-9=-242/271, 3-12=-1085/52, 6-8=-1329/124

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 161 lb uplift at joint 12 and 128 lb uplift at joint 8.

LOAD CASE(S) Standard



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 145 CB	
B220054	A3	Roof Special	4	1	Job Reference (optional)	I50049367

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:06
ID:Y93ca9TONciR9xlQGwJw_TzuPP1-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?i

Page: 1

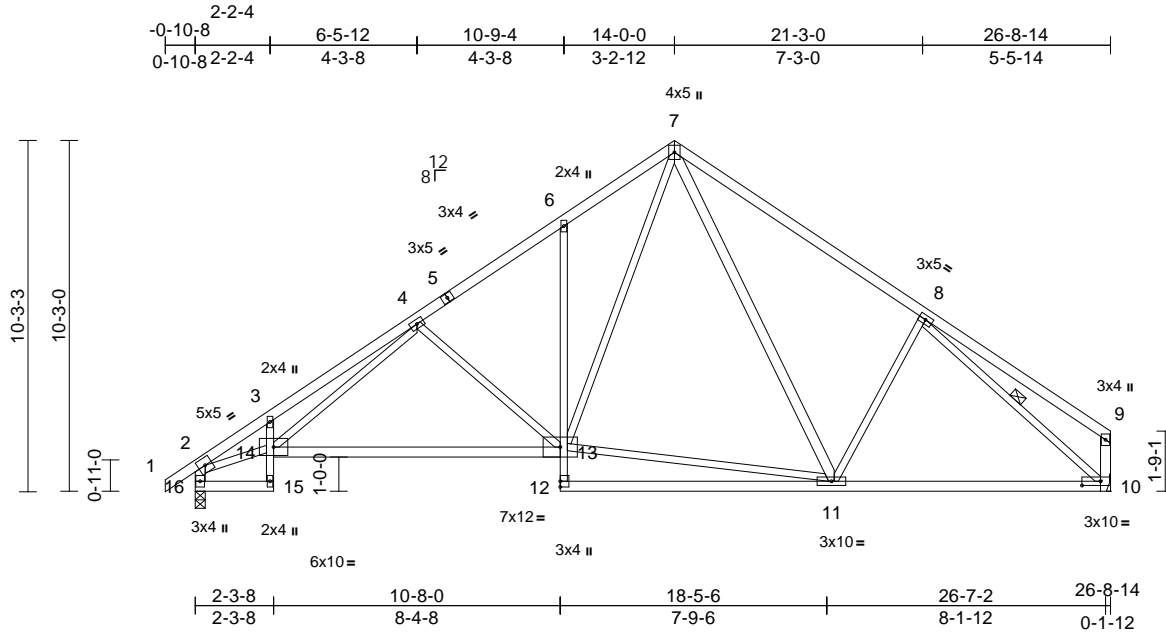

Scale = 1:67.3

Plate Offsets (X, Y): [10:0-6-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.73	Vert(LL)	-0.18	13-14	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.58	Vert(TL)	-0.51	13-14	>619	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.67	Horiz(TL)	0.15	10	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S		Wind(LL)	0.09	13-14	>999	240	Weight: 125 lb	FT = 10%

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2 *Except* 15-3,6-12:2x3 SPF No.2, 14-13:2x4 SPF 2100F 1.8E
WEBS	2x3 SPF No.2 *Except* 11-7,16-2,10-9:2x4 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 11-12.
WEBS	1 Row at midpt 8-10
REACTIONS	(lb/size) 10=1189/ Mechanical, 16=1263/0-3-8
	Max Horiz 16=291 (LC 5)
	Max Uplift 10=128 (LC 9), 16=160 (LC 8)

FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=0/40, 2-3=-2454/393, 3-4=-2554/512, 4-6=-1454/233, 6-7=-1392/347, 7-8=-1303/270, 8-9=-193/71, 2-16=-1242/197, 9-10=-206/80
BOT CHORD	15-16=-97/130, 14-15=-33/68, 3-14=-242/158, 13-14=-269/1493, 12-13=0/132, 6-13=-240/167, 11-12=-20/18, 10-11=-103/1047
WEBS	4-13=-483/232, 4-14=-255/998, 11-13=0/834, 7-13=-251/873, 7-11=-154/353, 8-11=-251/270, 2-14=-377/1990, 8-10=-1336/128

NOTES

- 1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 160 lb uplift at joint 16 and 128 lb uplift at joint 10.

LOAD CASE(S) Standard



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job B220054	Truss A4	Truss Type Common	Qty 1	Ply 1	Lot 145 CB Job Reference (optional)	I50049368
----------------	-------------	----------------------	----------	----------	--	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:06
ID:0Ld_oVT18wqlm4KcqDE9XgzuPP0-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRcDoi7J4zJC?f

Page: 1

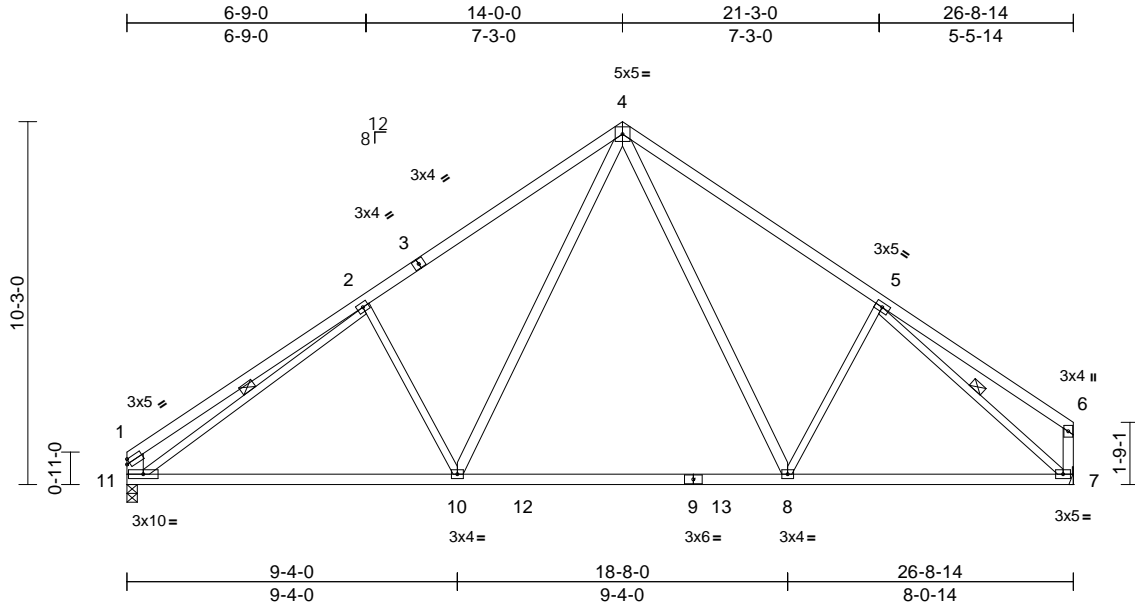

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.70	Vert(LL)	-0.30	8-10	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.46	Vert(TL)	-0.47	8-10	>674	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.70	Horiz(TL)	0.04	7	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S		Wind(LL)	0.04	8-10	>999	240	Weight: 115 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF 2100F 1.8E
WEBS 2x3 SPF No.2 *Except* 10-4,8-4,7-6:2x4 SPF No.2, 11-1:2x6 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 2-11, 5-7

REACTIONS

(lb/size) 7=1186/ Mechanical, 11=1186/0-3-8
Max Horiz 11=279 (LC 5)
Max Uplift 7=128 (LC 9), 11=136 (LC 8)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-493/147, 2-4=-1402/293, 4-5=-1308/272, 5-6=-178/73, 1-11=-409/144, 6-7=-197/81
BOT CHORD 10-11=-230/1348, 8-10=-17/869, 7-8=-103/1043
WEBS 2-10=-389/306, 4-10=-168/701, 4-8=-144/526, 5-8=-243/271, 2-11=-1171/96, 5-7=-1332/125

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 136 lb uplift at joint 11 and 128 lb uplift at joint 7.

LOAD CASE(S) Standard



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Page: 1

16023 Swingley Ridge Rd
Chesterfield, MO 63017

Page: 1


16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 145 CB	
B220054	A7	Roof Special	1	1	Job Reference (optional)	I50049371

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:07
ID:Rwl6QXWvRrCsdY3BV/Mos9JzuPOz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

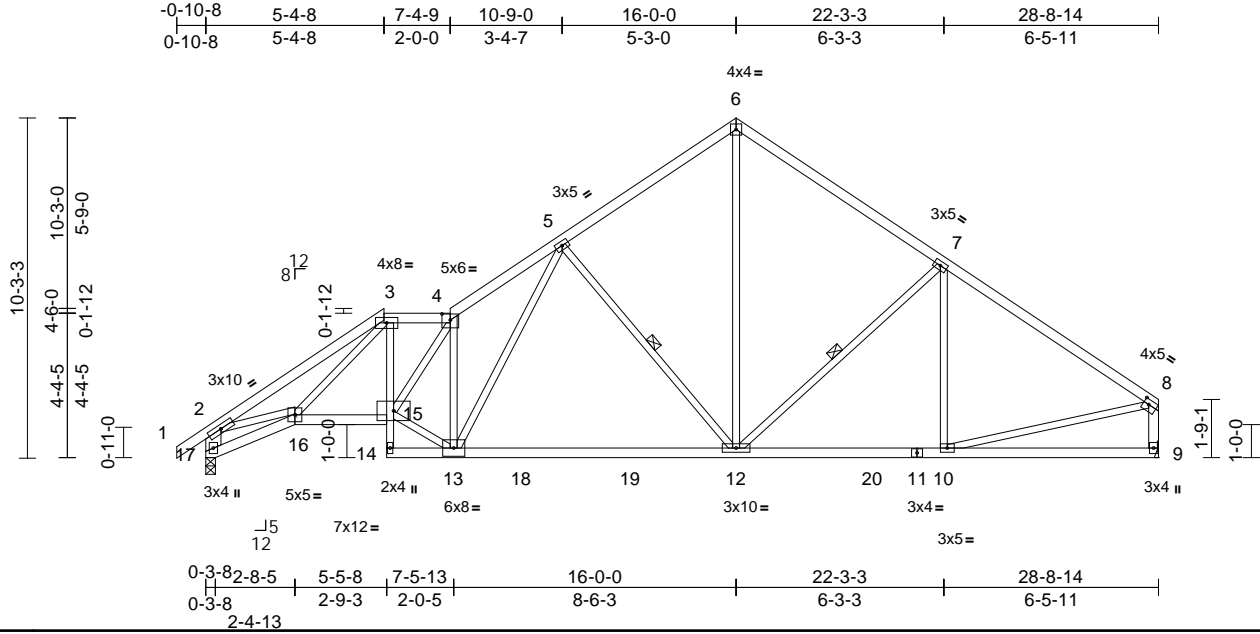

Scale = 1:69.5

Plate Offsets (X, Y): [4:0-3-0,0-2-3], [8:Edge,0-1-12]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.52	Vert(LL)	-0.19	12-13	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.69	Vert(TL)	-0.47	12-13	>730	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.69	Horiz(TL)	0.12	9	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S		Wind(LL)	0.09	12-13	>999	240	Weight: 128 lb	FT = 10%

LUMBER		
TOP CHORD	2x4 SPF No.2	
BOT CHORD	2x4 SPF No.2 *Except* 3-14:2x3 SPF No.2	
WEBS	2x3 SPF No.2 *Except* 17-2:2x6 SPF No.2, 9-8:2x4 SPF No.2	
BRACING		
TOP CHORD	Structural wood sheathing directly applied or 3-3-12 oc purlins, except end verticals, and 2-0-0 oc purlins (4-4-3 max.): 3-4.	
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 9-9-9 oc bracing: 16-17 6-0-0 oc bracing: 14-15.	
WEBS	1 Row at midpt 5-12, 7-12	
REACTIONS	(lb/size)	9=1275/ Mechanical, 17=1355/0-3-8
	Max Horiz	17=292 (LC 5)
	Max Uplift	9=133 (LC 9), 17=184 (LC 8)
FORCES		
TOP CHORD	1-2=0/43, 2-3=2439/409, 3-4=1787/319, 4-5=2021/329, 5-6=1212/243, 6-7=1242/256, 7-8=1486/176, 2-17=1405/321, 8-9=1212/166	
BOT CHORD	16-17=366/503, 15-16=334/1912, 14-15=107/0, 3-15=61/1029, 13-14=22/47, 12-13=185/1394, 10-12=71/1147, 9-10=43/104	
WEBS	3-16=110/318, 13-15=271/2051, 4-15=199/228, 4-13=1532/362, 5-13=127/754, 5-12=676/266, 6-12=149/873, 7-12=389/220, 7-10=136/91, 2-16=92/1683, 8-10=61/1073	

NOTES

- Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 17 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 184 lb uplift at joint 17 and 133 lb uplift at joint 9.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 145 CB	150049372
B220054	A8	Roof Special	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:07
ID:v7sUetWXC8KjFieN33J5hWzuPOy-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwRCDoi7J4zJC?i

Page: 1

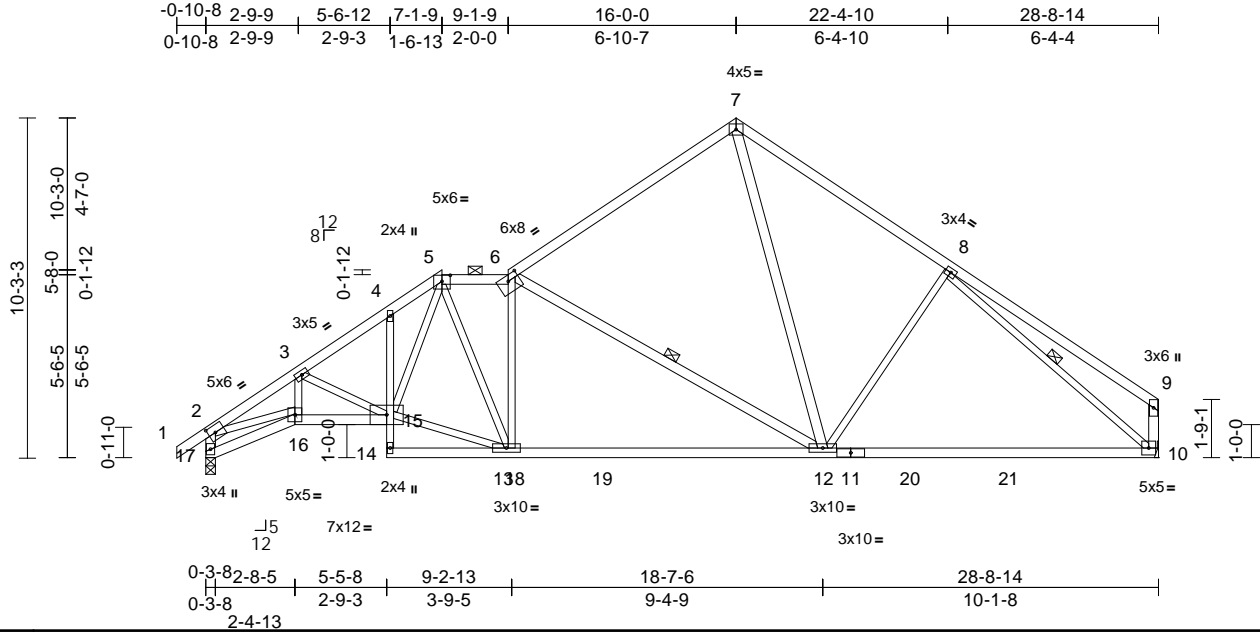

Scale = 1:69.5

Plate Offsets (X, Y): [2:0-2-9,0-2-8], [5:0-3-0,0-2-3], [6:0-4-0,0-2-1]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.80	Vert(LL)	-0.20	10-12	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.55	Vert(TL)	-0.48	10-12	>716	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.86	Horiz(TL)	0.12	10	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S		Wind(LL)	0.07	12-13	>999	240	Weight: 135 lb	FT = 10%

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2 *Except* 4-14:2x3 SPF No.2, 14-11,11-10:2x4 SPF 2100F 1.8E
WEBS	2x3 SPF No.2 *Except* 12-6,12-7,17-2,10-9:2x4 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals, and 2-0-0 oc purlins (4-5-14 max.): 5-6.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	1 Row at midpt 6-12, 8-10
REACTIONS	(lb/size) 10=1279/ Mechanical, 17=1353/0-3-8 Max Horiz 17=292 (LC 5) Max Uplift 10=133 (LC 9), 17=183 (LC 8)

FORCES

TOP CHORD	(lb) - Maximum Compression/Maximum Tension 1-2=0/40, 2-3=-2562/440, 3-4=-2069/329, 4-5=-2016/390, 5-6=-1514/255, 6-7=-1112/234, 7-8=-1357/249, 8-9=-327/107, 2-17=-1354/268, 9-10=-318/120
BOT CHORD	16-17=-296/364, 15-16=-468/2204, 14-15=-10/9, 4-15=-113/100, 13-14=-22/57, 12-13=-222/1574, 10-12=-91/1126
WEBS	3-16=-72/384, 3-15=-479/181, 13-15=-208/1486, 5-15=-244/836, 5-13=-91/386, 6-13=-523/156, 6-12=-843/261, 7-12=-123/853, 8-12=-258/267, 2-16=-292/1941, 8-10=-1344/126

NOTES

- Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- The Fabrication Tolerance at joint 6 = 6%
- The solid section of the plate is required to be placed over the splice line at joint(s) 11.
- Plate(s) at joint(s) 11 checked for a plus or minus 5 degree rotation about its center.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 17 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 183 lb uplift at joint 17 and 133 lb uplift at joint 10.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Wheeler Lumber, Waverly, KS - 66871, Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:08 Page: 1
ID:Fp8y6mN?1\$Qqsi3MY5HC zuPP8-RfC?PsB70Hg3NSqPqnL8w3ulTXbGKwRCDoi7J4zJC?f



LUMBER		3) Unbalanced roof live loads have been considered for this design. 2) Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60 3) Provide adequate drainage to prevent water ponding. 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads. 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members. 6) Bearing at joint(s) 22, 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface. 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 188 lb uplift at joint 22 and 149 lb uplift at joint 10. 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
TOP CHORD	2x4 SPF No.2 *Except* 7-8:2x4 SPF 2100F 1.8E, 8-10:2x4 SPF 2400F 2.0E	
BOT CHORD	2x4 SPF No.2 *Except* 20-4,18-16,14-12:2x3 SPF No.2, 19-17,13-10:2x4 SPF 2100F 1.8E	
WEBS	2x3 SPF No.2 *Except* 22-2,13-7:2x4 SPF No.2	
BRACING		LOAD CASE(S) Standard
TOP CHORD	Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (3-6-5 max.): 4-5.	
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.	
WEBS	1 Row at midpt 5-17, 9-13	
JOINTS	1 Brace at Jt(s): 17, 13	REACTIONS (lb/size) 10=1349/0-3-8, 22=1423/0-3-8 Max Horiz 22=-273 (LC 6) Max Uplift 10=-149 (LC 9), 22=-188 (LC 8) FORCES (lb) - Maximum Compression/Maximum Tension TOP CHORD 1-2=0/40, 2-3=-2696/449, 3-4=-3313/527, 4-5=-2691/451, 5-6=-2347/315, 6-7=-3441/333, 7-9=-3361/331, 9-10=-4728/339, 2-22=-1427/274 BOT CHORD 21-22=-271/374, 20-21=-42/103, 19-20=0/68, 4-19=-227/1592, 18-19=-557/3440, 17-18=-549/3418, 16-18=0/46, 15-16=-8/22, 14-15=-5/28, 12-14=0/73, 12-13=-204/4148, 11-12=-243/4125, 10-11=-237/4143 WEBS 3-21=-543/110, 19-21=-479/2285, 3-19=0/556, 5-19=-1053/158, 5-17=-1719/391, 9-13=-1238/546, 9-11=0/339, 2-21=-294/2024, 6-13=0/911, 15-17=0/226, 6-17=-1121/123, 13-17=-294/2752, 7-13=-266/3284, 14-17=-31/3
REACTIONS (lb/size) 10=1349/0-3-8, 22=1423/0-3-8 Max Horiz 22=-273 (LC 6) Max Uplift 10=-149 (LC 9), 22=-188 (LC 8)		
FORCES (lb) - Maximum Compression/Maximum Tension		
TOP CHORD	1-2=0/40, 2-3=-2696/449, 3-4=-3313/527, 4-5=-2691/451, 5-6=-2347/315, 6-7=-3441/333, 7-9=-3361/331, 9-10=-4728/339, 2-22=-1427/274	
BOT CHORD	21-22=-271/374, 20-21=-42/103, 19-20=0/68, 4-19=-227/1592, 18-19=-557/3440, 17-18=-549/3418, 16-18=0/46, 15-16=-8/22, 14-15=-5/28, 12-14=0/73, 12-13=-204/4148, 11-12=-243/4125, 10-11=-237/4143	
WEBS	3-21=-543/110, 19-21=-479/2285, 3-19=0/556, 5-19=-1053/158, 5-17=-1719/391, 9-13=-1238/546, 9-11=0/339, 2-21=-294/2024, 6-13=0/911, 15-17=0/226, 6-17=-1121/123, 13-17=-294/2752, 7-13=-266/3284, 14-17=-31/3	

NOTES



February 4, 2022

 WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE

WARNING: - verify design parameters and READ NOTES ON THIS AND INCLUDED MITER REFERENCE PAGE MMF/473 Rev. 3/19/2020 BEFORE USE.

Design valid for use only with MITek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 145 CB	150049374
B220054	A10	Roof Special	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:08
ID:Fp8y6mN?1SqQpsj3MY5HC_zuPP8-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCD0i7J4zJC?f

Page: 1

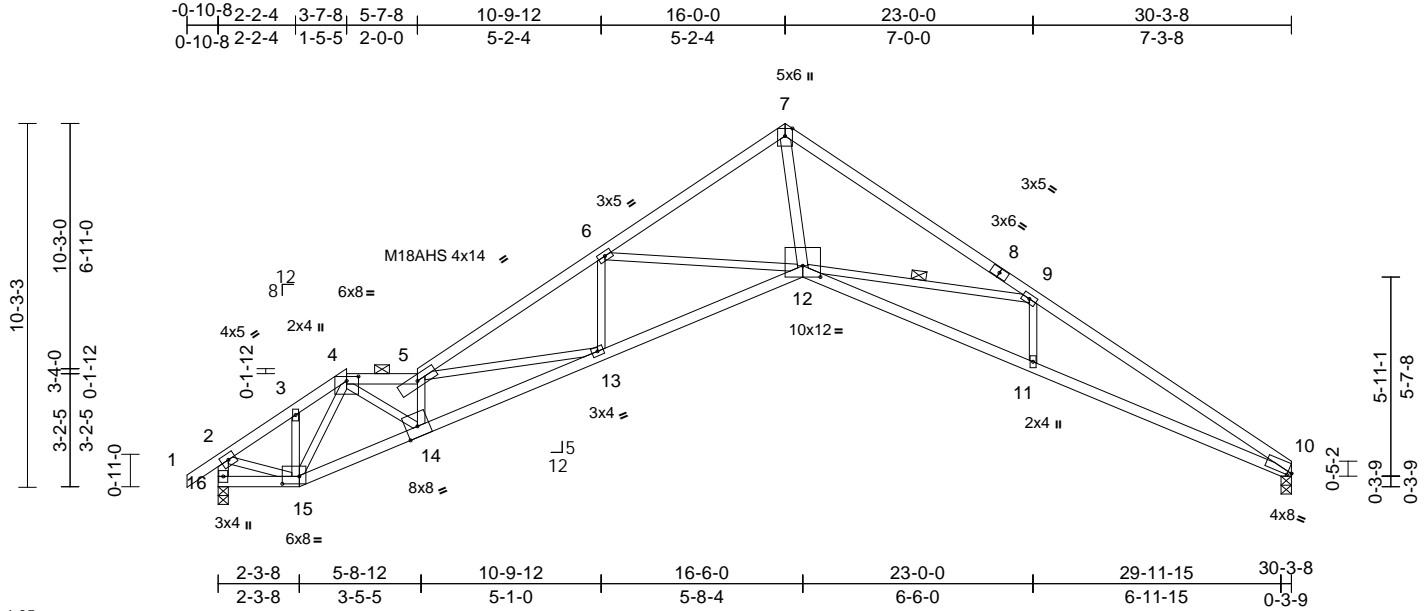

Scale = 1:65

Plate Offsets (X, Y): [4:0-4-0,0-1-9], [10:0-1-5,0-0-15], [12:0-6-0,0-3-13], [15:0-5-12,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.99	Vert(LL)	-0.40	11-12	>911	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.60	Vert(TL)	-0.91	11-12	>397	240	M18AHS	142/136
BCLL	0.0*	Rep Stress Incr	YES	WB	0.97	Horiz(TL)	0.82	10	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S		Wind(LL)	0.26	12-13	>999	240	Weight: 111 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2 *Except* 7-8:2x4 SPF 2100F 1.8E, 8-10:2x4 SPF 2400F 2.0E
BOT CHORD 2x4 SPF 2100F 1.8E *Except* 16-15:2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except* 12-7,16-2:2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (2-9-9 max.): 4-5.
BOT CHORD Rigid ceiling directly applied or 9-5-5 oc bracing.
WEBS 1 Row at midpt 9-12

REACTIONS (lb/size) 10=1349/0-3-8, 16=1423/0-3-8
Max Horiz 16=272 (LC 6)
Max Uplift 10=149 (LC 9), 16=188 (LC 8)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/40, 2-3=-1551/198, 3-4=-1492/248, 4-5=-4024/602, 5-6=-3995/518, 6-7=-2955/274, 7-9=-3455/328, 9-10=-4706/343, 2-16=-1396/200
BOT CHORD 15-16=-237/289, 14-15=-377/1873, 13-14=-698/4199, 12-13=-461/3546, 11-12=-242/4114, 10-11=-240/4122
WEBS 3-15=-63/76, 4-15=-1110/143, 4-14=-391/2822, 5-14=-2500/413, 5-13=-628/224, 6-13=0/365, 6-12=-927/361, 7-12=-217/3049, 9-12=-1132/528, 9-11=0/306, 2-15=-121/1230

NOTES

1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are MT20 plates unless otherwise indicated.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 7) Bearing at joint(s) 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 188 lb uplift at joint 16 and 149 lb uplift at joint 10.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 145 CB	I50049375
B220054	A11	Roof Special Girder	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:09
ID:cmxrAUR8s?Sjvdc195hSv2zuPP3-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?f

Page: 1

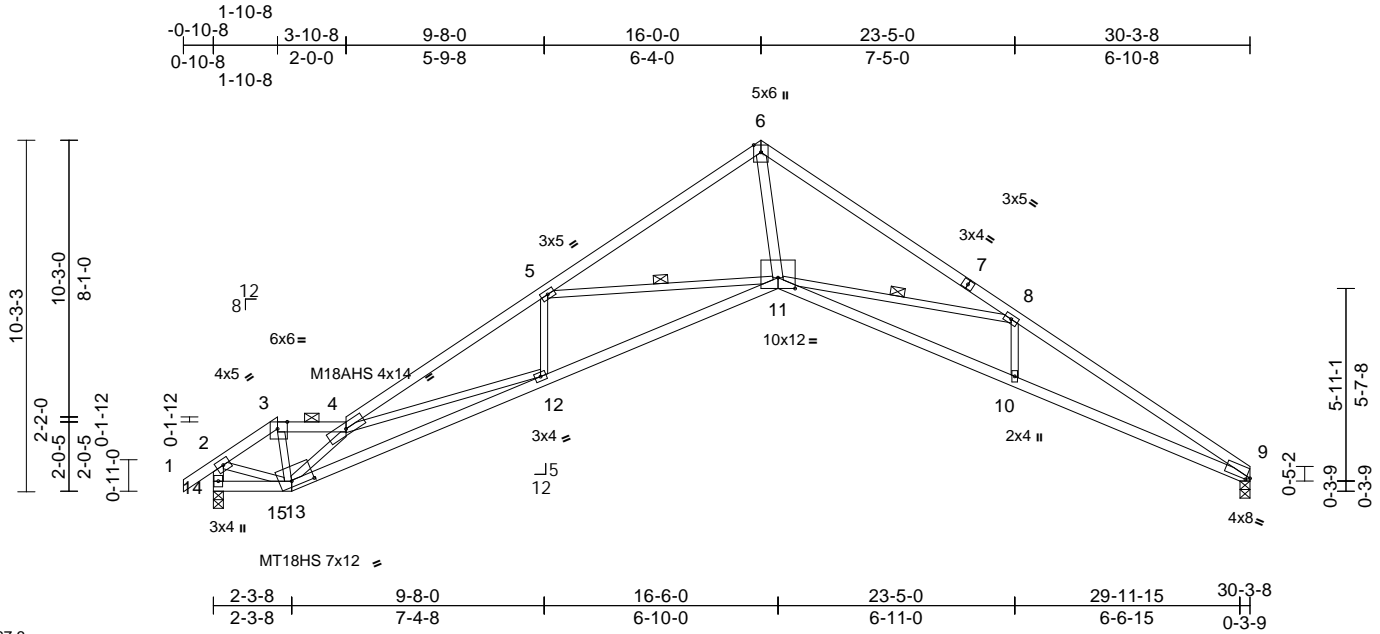

Scale = 1:67.3

Plate Offsets (X, Y): [3:0-3-6,Edge], [9:0-1-5,0-0-15], [11:0-6-0,0-3-13], [13:0-7-12,0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.96	Vert(LL)	-0.39	11-12	>934	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.64	Vert(TL)	-0.90	10-11	>398	240	M18AHS	142/136
BCLL	0.0*	Rep Stress Incr	NO	WB	0.77	Horiz(TL)	0.79	9	n/a	n/a	MT18HS	197/144
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S		Wind(LL)	0.27	11-12	>999	240	Weight: 109 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2 *Except* 4-6:2x4 SPF 2100F 1.8E, 6-7,7-9:2x4 SPF 2400F 2.0E
BOT CHORD 2x4 SPF 2100F 1.8E *Except* 14-13:2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except* 11-6,14-2:2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (4-9-13 max.): 3-4.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 8-9-8 oc bracing: 12-13.
WEBS 1 Row at midpt 5-11, 8-11

REACTIONS

(lb/size) 9=1349/0-3-8, 14=1423/0-3-8
Max Horiz 14=272 (LC 6)
Max Uplift 9=151 (LC 9), 14=205 (LC 8)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/40, 2-3=1602/204, 3-4=1481/203, 4-5=4235/566, 5-6=3000/272, 6-8=3473/332, 8-9=4742/361, 2-14=1386/199
BOT CHORD 13-14=243/286, 12-13=798/4174, 11-12=553/3764, 10-11=251/4152, 9-10=246/4154
WEBS 3-13=71/735, 4-13=3529/620, 4-12=431/238, 5-12=0/354, 5-11=1117/431, 6-11=195/3007, 8-11=1167/555, 8-10=0/301, 2-13=128/1297

NOTES

1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are MT20 plates unless otherwise indicated.
- 5) The Fabrication Tolerance at joint 13 = 2%
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 8) Bearing at joint(s) 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 205 lb uplift at joint 14 and 151 lb uplift at joint 9.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 11) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 41 lb down and 18 lb up at 1-10-8 on top chord, and 7 lb down and 16 lb up at 1-10-8 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 12) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S)

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-2=-70, 2-3=-70, 3-4=-70, 4-6=-70, 6-9=-70, 13-14=-20, 11-13=-20, 9-11=-20



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 145 CB	
B220054	A12	Scissor	1	1	Job Reference (optional)	I50049376

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:09
ID:j?IKK6OeomyHR0IGwFcWICzuPP7-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

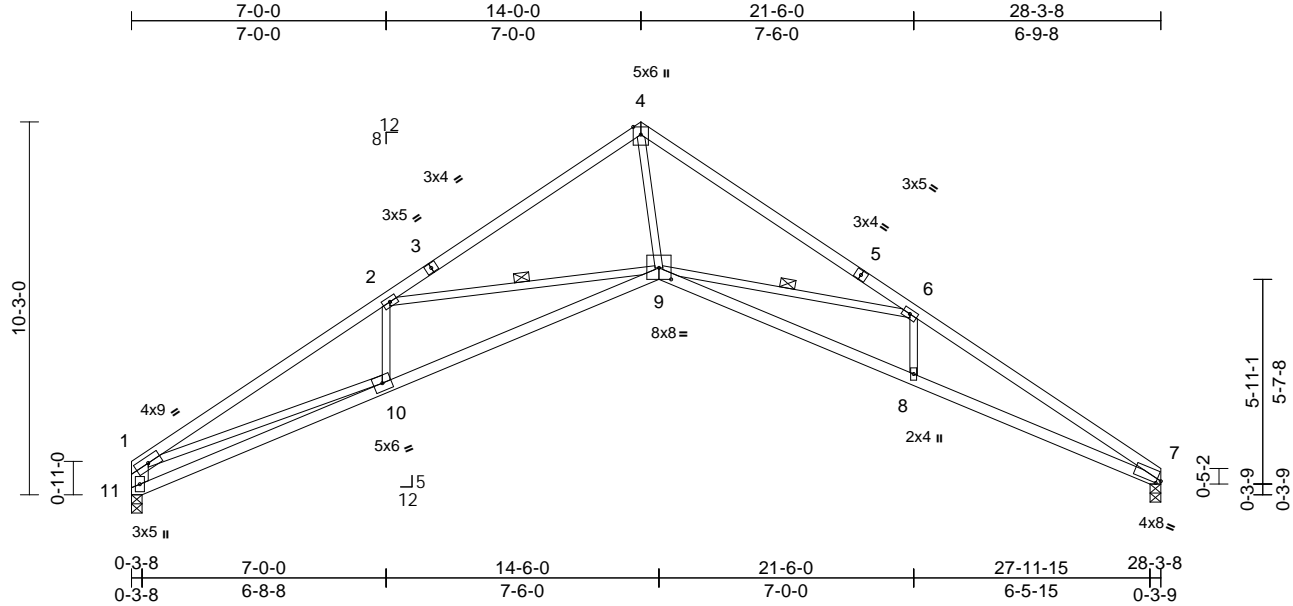

Scale = 1:63.3									
Plate Offsets (X, Y): [7:0-1-5,0-1-3], [9:0-4-0,0-3-13]									
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.79	Vert(LL)	-0.33	8-9	>999
TCDL	10.0	Lumber DOL	1.15	BC	0.89	Vert(TL)	-0.82	9-10	>411
BCLL	0.0*	Rep Stress Incr	YES	WB	0.88	Horiz(TL)	0.75	7	n/a
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S		Wind(LL)	0.21	9-10	>999
									L/d
									360
									240
									n/a
									240
									Weight: 99 lb
									FT = 10%

LUMBER
TOP CHORD 2x4 SPF 2100F 1.8E
BOT CHORD 2x4 SPF No.2 *Except* 9-7:2x4 SPF 2100F 1.8E
WEBS 2x3 SPF No.2 *Except* 11-1:2x6 SPF No.2
BRACING
TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 8-2-15 oc bracing: 9-10.
WEBS 1 Row at midpt 2-9, 6-9
REACTIONS (lb/size) 7=1256/0-3-8, 11=1256/0-3-8
Max Horiz 11=-267 (LC 6)
Max Uplift 7=-143 (LC 9), 11=-141 (LC 8)
FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-3431/477, 2-4=-2674/223, 4-6=-3069/279, 6-7=-4363/335, 1-11=-1345/271
BOT CHORD 10-11=-276/641, 9-10=-502/3044, 8-9=-207/3818, 7-8=-204/3818
WEBS 2-10=-131/127, 2-9=-778/420, 4-9=-128/2562, 6-9=-1195/563, 6-8=0/299, 1-10=-219/2462

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 11, 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 141 lb uplift at joint 11 and 143 lb uplift at joint 7.

LOAD CASE(S) Standard

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 145 CB	
B220054	A13	Scissor	7	1	Job Reference (optional)	150049377

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:09
ID:cmxrAUR8s?Sjvdc195hSv2zuPP3-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

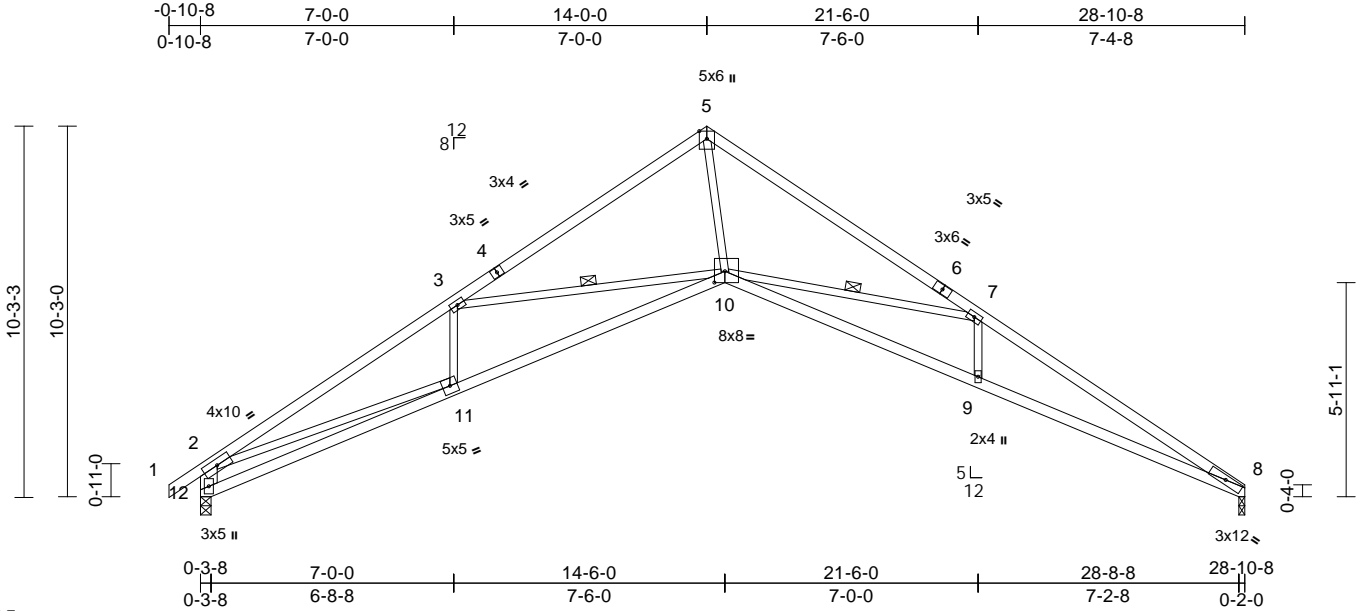

Scale = 1:63.7

Plate Offsets (X, Y): [10:0-3-8,0-3-12]												
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.94	Vert(LL)	-0.38	9-10	>892	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.91	Vert(TL)	-0.91	10-11	>378	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.93	Horiz(TL)	0.85	8	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S		Wind(LL)	0.23	9-10	>999	240	Weight: 102 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF 2100F 1.8E *Except* 6-8:2x4 SPF 2400F 2.0E, 1-4:2x4 SPF No.2
BOT CHORD 2x4 SPF No.2 *Except* 10-8:2x4 SPF 2100F 1.8E
WEBS 2x3 SPF No.2 *Except* 12-2:2x6 SPF No.2
BRACING
TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied or 8-5-2 oc bracing.
WEBS 1 Row at midpt 3-10, 7-10
REACTIONS (lb/size) 8=1284/0-2-0, 12=1364/0-3-8
Max Horiz 12=-277 (LC 6)
Max Uplift 8=-151 (LC 9), 12=-168 (LC 8)
FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/43, 2-3=-3504/468, 3-5=-2781/219, 5-7=-3201/276, 7-8=-4728/365, 2-12=-1505/331
BOT CHORD 11-12=-352/788, 10-11=-481/3089, 9-10=-229/4183, 8-9=-227/4187, 3-11=-123/128, 3-10=-739/408, 5-10=-121/2693, 7-10=-1409/598, 7-9=0/314, 2-11=-118/2379
NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 5) Bearing at joint(s) 8, 12 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 6) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 8.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 151 lb uplift at joint 8 and 168 lb uplift at joint 12.
- LOAD CASE(S)** Standard



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 145 CB	150049378
B220054	A14	Common Supported Gable	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:10
ID:j?IKK6OeomyHR0IGwFcWICzuPP7-RFC?PsB70Hq3NSgPqnL8w3uITXbGKWRcD0i7J4zJC?f

Page: 1

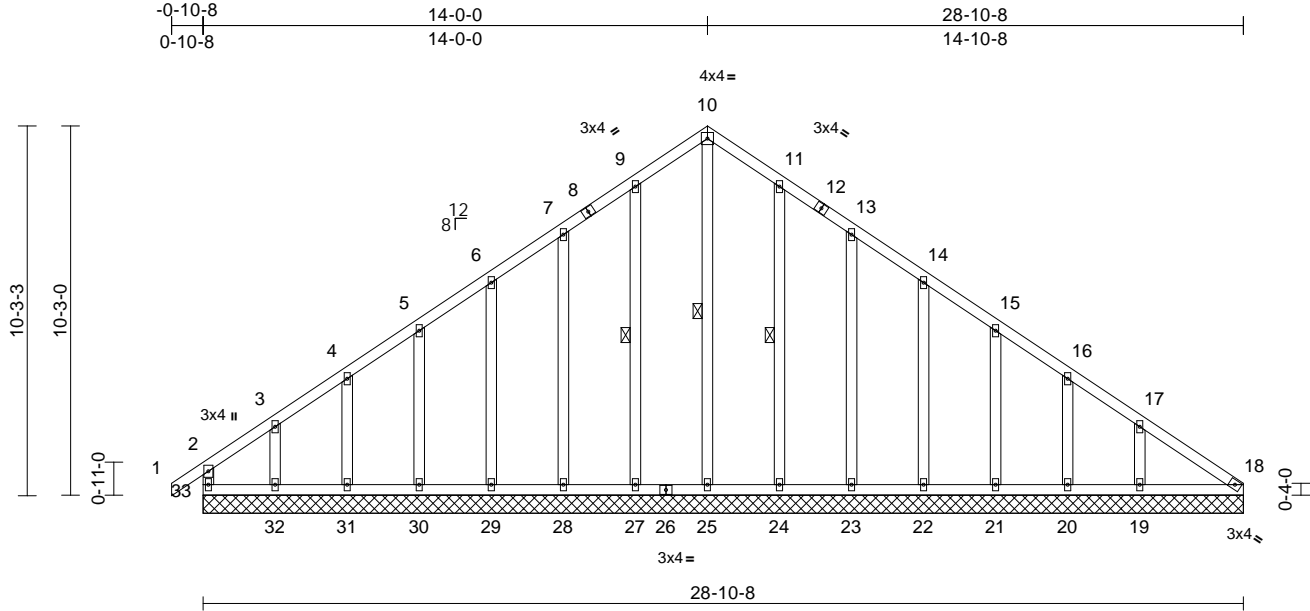

Scale = 1:64

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.09	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.07	Vert(TL)	n/a	-	n/a	999	197/144
BCLL	0.0*	Rep Stress Incr	YES	WB	0.13	Horiz(TL)	0.01	18	n/a	n/a	
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S							
Weight: 154 lb FT = 10%											

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x4 SPF No.2
OTHERS	2x4 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

WEBS 1 Row at midpt 10-25, 9-27, 11-24

REACTIONS (lb/size)	18=106/28-10-8, 19=256/28-10-8, 20=155/28-10-8, 21=186/28-10-8, 22=179/28-10-8, 23=179/28-10-8, 24=187/28-10-8, 25=156/28-10-8, 27=187/28-10-8, 28=179/28-10-8, 29=180/28-10-8, 30=179/28-10-8, 31=185/28-10-8, 32=160/28-10-8, 33=171/28-10-8
---------------------	--

Max Horiz 33=275 (LC 6)

Max Uplift 18=43 (LC 5), 19=108 (LC 9), 20=59 (LC 9), 21=72 (LC 9), 22=68 (LC 9), 23=75 (LC 9), 24=62 (LC 9), 27=62 (LC 8), 28=75 (LC 8), 29=68 (LC 8), 30=75 (LC 8), 31=49 (LC 8), 32=158 (LC 8), 33=77 (LC 4)

Max Grav 18=148 (LC 15), 19=270 (LC 16), 20=160 (LC 16), 21=193 (LC 16), 22=186 (LC 16), 23=186 (LC 16), 24=195 (LC 16), 25=241 (LC 8), 27=195 (LC 15), 28=186 (LC 15), 29=186 (LC 15), 30=189 (LC 15), 31=185 (LC 1), 32=225 (LC 15), 33=213 (LC 16)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD	2-33=-175/67, 1-2=0/40, 2-3=-184/151, 3-4=-117/108, 4-5=-107/101, 5-6=-92/138, 6-7=-79/175, 7-9=-65/214, 9-10=-54/245, 10-11=-67/251, 11-13=-80/220, 13-14=-94/181, 14-15=-108/145, 15-16=-122/121, 16-17=-141/127, 17-18=-194/173
BOT CHORD	32-33=-139/187, 31-32=-139/187, 30-31=-139/187, 29-30=-139/187, 28-29=-139/187, 27-28=-139/187, 25-27=-139/187, 24-25=-139/187, 23-24=-139/187, 22-23=-139/187, 21-22=-139/187, 20-21=-139/187, 19-20=-139/187, 18-19=-139/187
WEBS	10-25=-217/0, 9-27=-155/86, 7-28=-146/99, 6-29=-147/92, 5-30=-148/96, 4-31=-144/83, 3-32=-162/141, 11-24=-155/86, 13-23=-146/99, 14-22=-146/92, 15-21=-151/97, 16-20=-129/83, 17-19=-205/134

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 77 lb uplift at joint 33, 43 lb uplift at joint 18, 62 lb uplift at joint 27, 75 lb uplift at joint 28, 68 lb uplift at joint 29, 75 lb uplift at joint 30, 49 lb uplift at joint 31, 158 lb uplift at joint 32, 62 lb uplift at joint 24, 75 lb uplift at joint 23, 68 lb uplift at joint 22, 72 lb uplift at joint 21, 59 lb uplift at joint 20 and 108 lb uplift at joint 19.

LOAD CASE(S) Standard



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job B220054	Truss B1	Truss Type Common Supported Gable	Qty 1	Ply 1	Lot 145 CB Job Reference (optional)	I50049379
----------------	-------------	--------------------------------------	----------	----------	--	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:10
ID:j?IKK6OeomyHR0IGwFcWICzuPP7-RFC?PsB70Hq3NSgPqnL8w3uITXbGKWrcD0i7J4zJC?f

Page: 1

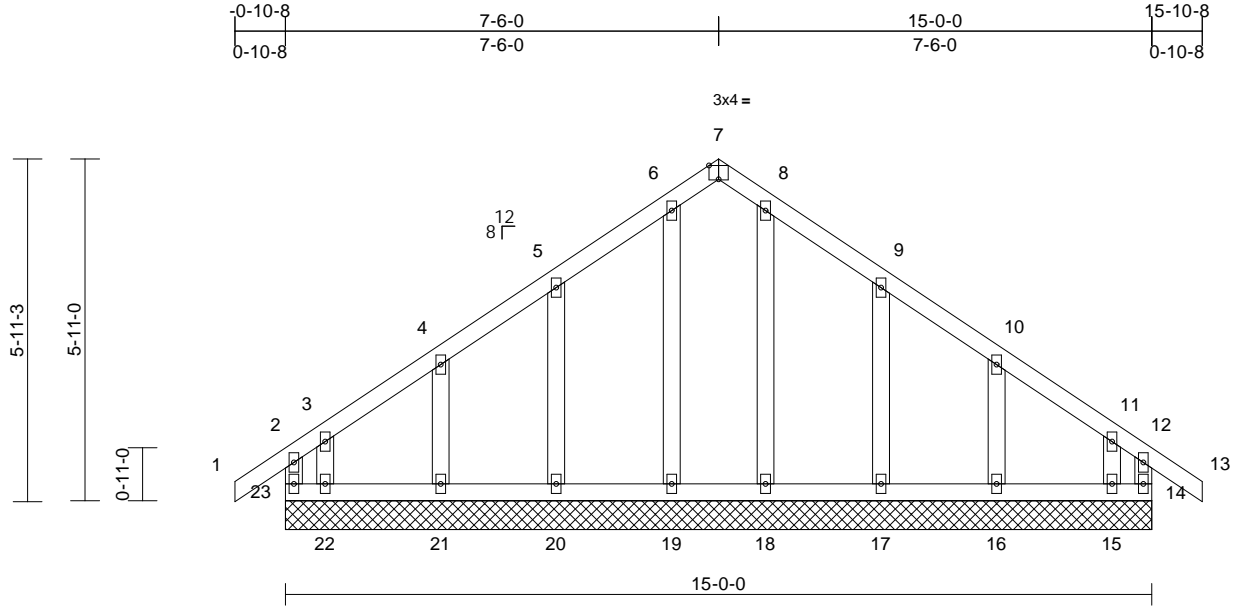

Scale = 1:39.9

Plate Offsets (X, Y): [7:0-2-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	n/a	-	n/a	999	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.06	Vert(TL)	n/a	-	n/a	999	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.06	Horiz(TL)	0.00	14	n/a	n/a	
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-R							
										Weight: 67 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (lb/size)
14=121/15-0-0, 15=83/15-0-0,
16=186/15-0-0, 17=182/15-0-0,
18=161/15-0-0, 19=161/15-0-0,
20=182/15-0-0, 21=186/15-0-0,
22=83/15-0-0, 23=121/15-0-0
Max Horiz 23=172 (LC 7)
Max Uplift 14=86 (LC 5), 15=170 (LC 9),
16=65 (LC 9), 17=88 (LC 9),
20=87 (LC 8), 21=65 (LC 8),
22=184 (LC 8), 23=130 (LC 6)
Max Grav 14=164 (LC 18), 15=170 (LC 7),
16=190 (LC 16), 17=193 (LC 16),
18=161 (LC 1), 19=166 (LC 15),
20=190 (LC 15), 21=190 (LC 15),
22=202 (LC 6), 23=198 (LC 16)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 2-23=-149/83, 1-2=0/40, 2-3=-148/122,
3-4=-85/91, 4-5=-73/71, 5-6=-60/114,
6-7=-38/95, 7-8=-35/92, 8-9=-39/102,
9-10=-53/62, 10-11=-66/71, 11-12=-132/86,
12-13=0/40, 12-14=-127/55
BOT CHORD 22-23=-80/102, 21-22=-80/102,
20-21=-80/102, 19-20=-80/102,
18-19=-80/102, 17-18=-80/102,
16-17=-80/102, 15-16=-80/102,
14-15=-80/102

WEBS 6-19=-131/14, 8-18=-126/0, 5-20=-149/110,
4-21=-151/93, 3-22=-114/127,
9-17=-151/112, 10-16=-151/92,
11-15=-102/120

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 130 lb uplift at joint 23, 86 lb uplift at joint 14, 87 lb uplift at joint 20, 65 lb uplift at joint 21, 184 lb uplift at joint 22, 88 lb uplift at joint 17, 65 lb uplift at joint 16 and 170 lb uplift at joint 15.

LOAD CASE(S) Standard



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Page: 1

February 4, 2022




Job	Truss	Truss Type	Qty	Ply	Lot 145 CB	150049381
B220054	D1	Common Structural Gable	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:10
ID:q9kCOXjSxcmi9uxlOXx81zouEZ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

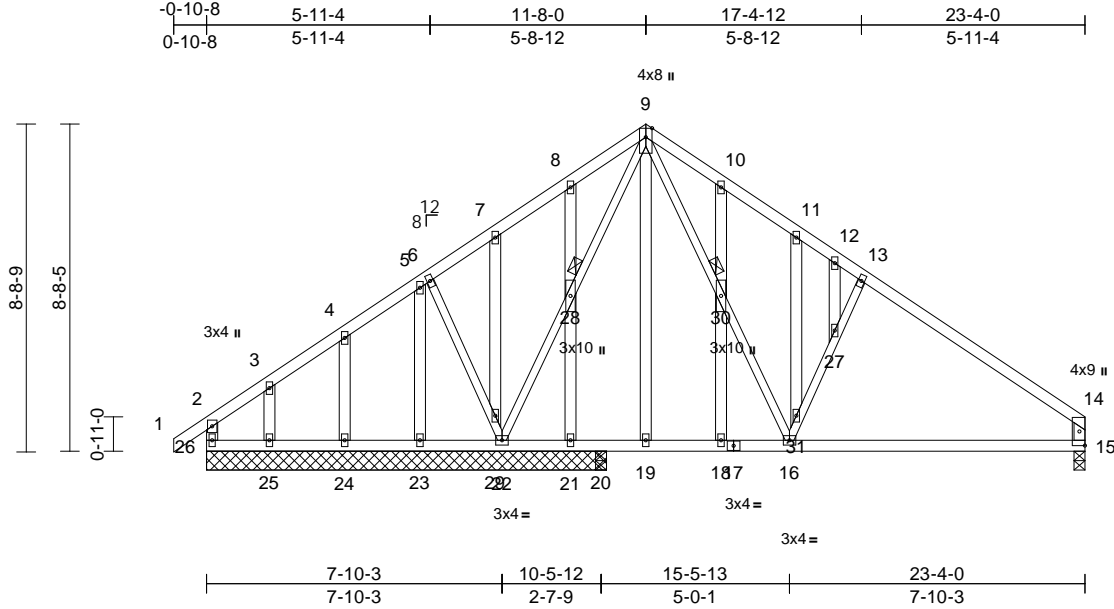

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.32	Vert(LL)	-0.09	15-16	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.39	Vert(TL)	-0.21	15-16	>719	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.26	Horiz(TL)	0.01	15	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S		Wind(LL)	0.03	16-18	>999	240	Weight: 132 lb	FT = 10%

LUMBER	
TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x3 SPF No.2 *Except* 26-2,15-14:2x4 SPF No.2
OTHERS	2x4 SPF No.2

WEBS	9-30=-180/582, 16-30=-186/610, 16-31=-383/250, 27-31=-281/200, 13-27=-313/220, 22-28=-574/35, 9-28=-604/37, 6-29=-224/124, 22-29=-309/193, 12-27=-23/34, 9-19=-68/14, 8-28=-189/94, 21-28=-215/90, 7-29=-103/74, 5-23=-40/128, 4-24=-151/95, 3-25=-173/112, 10-30=-71/42, 18-30=-101/49, 11-31=-118/54
-------------	--

BRACING	
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
JOINTS	1 Brace at Jt(s): 28, 30

REACTIONS	(lb/size)	15=551/0-3-8, 20=358/0-3-8, 21=15/10-7-8, 22=849/10-7-8, 23=35/10-7-8, 24=182/10-7-8, 25=216/10-7-8, 26=10/10-7-8
	Max Horiz	26=237 (LC 5)
	Max Uplift	15=103 (LC 9), 21=93 (LC 20), 22=80 (LC 9), 23=88 (LC 20), 24=66 (LC 8), 25=117 (LC 8), 26=95 (LC 20)
	Max Grav	15=551 (LC 1), 20=358 (LC 1), 21=114 (LC 19), 22=849 (LC 1), 23=64 (LC 8), 24=185 (LC 19), 25=255 (LC 15), 26=107 (LC 19)

FORCES	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=0/40, 2-3=-96/221, 3-4=-40/190, 4-5=-9/179, 5-6=-9/229, 6-7=0/260, 7-8=0/291, 8-9=0/278, 9-10=-390/270, 10-11=-422/233, 11-12=-394/190, 12-13=-438/196, 13-14=-593/150, 2-26=-100/77, 14-15=-471/148
BOT CHORD	25-26=-205/136, 24-25=-205/136, 23-24=-205/136, 22-23=-205/136, 21-22=-51/119, 20-21=-51/119, 19-20=-51/119, 18-19=-51/118, 16-18=-51/118, 15-16=-45/399

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) All plates are 2x4 MT20 unless otherwise indicated.
- 5) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 6) Gable studs spaced at 2-0-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 95 lb uplift at joint 26, 80 lb uplift at joint 22, 103 lb uplift at joint 15, 93 lb uplift at joint 21, 88 lb uplift at joint 23, 66 lb uplift at joint 24 and 117 lb uplift at joint 25.

LOAD CASE(S) Standard



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 145 CB	
B220054	D2	Common Girder	1	2	Job Reference (optional)	I50049382

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:11
ID:v7sUetWXC8KjFieN33J5hWzuPOy-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWRCDoi7J4zJC?i

Page: 1

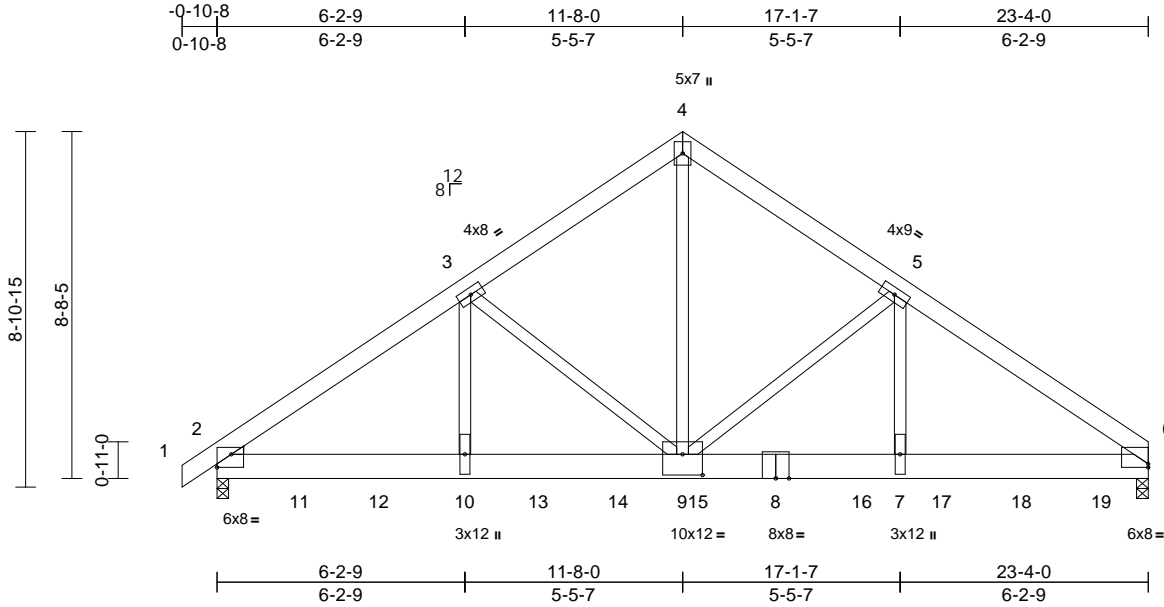

Scale = 1:57.7

Plate Offsets (X, Y): [2:Edge,0-3-15], [6:Edge,0-1-1], [9:0-6-0,0-6-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.96	Vert(LL)	-0.11	9-10	>999	360	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.58	Vert(TL)	-0.24	9-10	>999	240	
BCLL	0.0*	Rep Stress Incr	NO	WB	0.89	Horiz(TL)	0.06	6	n/a	n/a	
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S		Wind(LL)	0.08	9-10	>999	240	
										Weight: 316 lb	FT = 10%

LUMBER

TOP CHORD 2x6 SPF No.2
BOT CHORD 2x8 SP 2400F 2.0E
WEBS 2x4 SPF No.2
WEDGE Left: 2x3 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-4-3 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 2=7347/0-3-8, 6=7997/0-3-8
Max Horiz 2=216 (LC 7)
Max Uplift 2=-885 (LC 8), 6=-933 (LC 9)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/17, 2-3=-10151/1201, 3-4=-7037/920, 4-5=-7037/920, 5-6=-10352/1212
BOT CHORD 2-10=-1005/8106, 9-10=-1005/8106, 7-9=-895/8266, 6-7=-895/8266
WEBS 4-9=-890/7284, 5-9=-3248/536, 5-7=-371/3877, 3-9=-3041/520, 3-10=-362/3625

NOTES

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-8-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 933 lb uplift at joint 6 and 885 lb uplift at joint 2.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1165 lb down and 140 lb up at 2-0-12, 1169 lb down and 140 lb up at 4-0-12, 1169 lb down and 140 lb up at 6-0-12, 1169 lb down and 140 lb up at 8-0-12, 1169 lb down and 140 lb up at 10-0-12, 1165 lb down and 140 lb up at 12-0-12, 1166 lb down and 140 lb up at 14-0-12, 1259 lb down and 147 lb up at 16-2-0, 1255 lb down and 145 lb up at 18-2-0, and 1255 lb down and 145 lb up at 20-2-0, and 1259 lb down and 145 lb up at 22-2-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-4=-70, 4-6=-70, 2-6=-20
Concentrated Loads (lb)
Vert: 8=-1166 (B), 10=-1169 (B), 11=-1165 (B), 12=-1169 (B), 13=-1169 (B), 14=-1169 (B), 15=-1165 (B), 16=-1259 (B), 17=-1255 (B), 18=-1255 (B), 19=-1259 (B)



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 145 CB	I50049383
B220054	E1	Common Supported Gable	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:11
ID:CCGjXSPGZ44829tStz7IHPzuPP6-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f

Page: 1

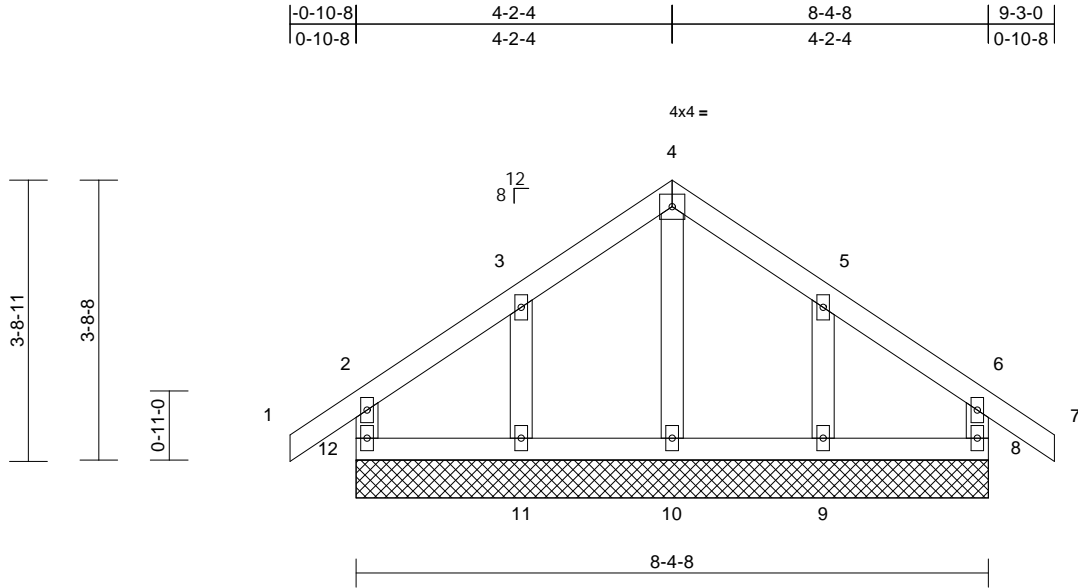

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	8	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-R							Weight: 33 lb	FT = 10%

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x4 SPF No.2
OTHERS	2x4 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS

(lb/size)	8=163/8-4-8, 9=187/8-4-8, 10=169/8-4-8, 11=187/8-4-8, 12=163/8-4-8
Max Horiz	12=-115 (LC 6)
Max Uplift	8=-39 (LC 8), 9=-88 (LC 9), 11=-90 (LC 8), 12=-42 (LC 9)
Max Grav	8=165 (LC 20), 9=214 (LC 16), 10=169 (LC 1), 11=218 (LC 15), 12=165 (LC 19)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD	1-2=0/40, 2-3=-69/65, 3-4=-48/98, 4-5=-43/95, 5-6=-60/62, 6-7=0/40, 2-12=-146/51, 6-8=-146/53
BOT CHORD	11-12=-52/57, 10-11=-52/57, 9-10=-52/57, 8-9=-52/57
WEBS	4-10=-131/0, 3-11=-166/108, 5-9=-163/107

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 42 lb uplift at joint 12, 39 lb uplift at joint 8, 90 lb uplift at joint 11 and 88 lb uplift at joint 9.

LOAD CASE(S) Standard



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 145 CB	
B220054	E2	Common	2	1	Job Reference (optional)	I50049384

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:11
ID:gOp5loPuKNC?gJSe1gf_qdzuPP5-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f

Page: 1

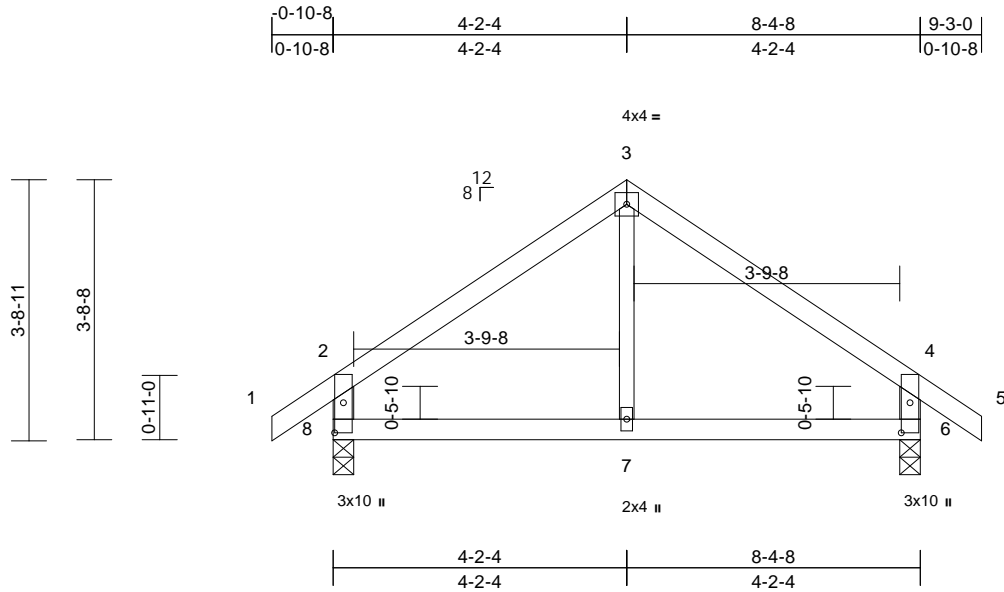

Scale = 1:32.9

Plate Offsets (X, Y): [6:0-5-2,0-1-8], [8:0-5-2,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.25	Vert(LL)	-0.01	7	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.13	Vert(TL)	-0.02	6-7	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.05	Horiz(TL)	0.00	6	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-R		Wind(LL)	-0.01	7-8	>999	240	Weight: 27 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2 *Except* 7-3:2x3 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 6=435/0-3-8, 8=435/0-3-8
Max Horiz 8=-115 (LC 6)
Max Uplift 6=-63 (LC 9), 8=-63 (LC 8)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/40, 2-3=-355/70, 3-4=-355/70,
4-5=0/40, 2-8=-384/96, 4-6=-384/96
BOT CHORD 7-8=0/232, 6-7=0/232
WEBS 3-7=0/157

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06"-00 tall by 2'-00"-00 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 63 lb uplift at joint 8 and 63 lb uplift at joint 6.

LOAD CASE(S) Standard



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 145 CB	I50049385
B220054	J1	Jack-Open Girder	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:12
ID:gOp5loPuKNC?gJSe1gf_qdzuPP5-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f

Page: 1

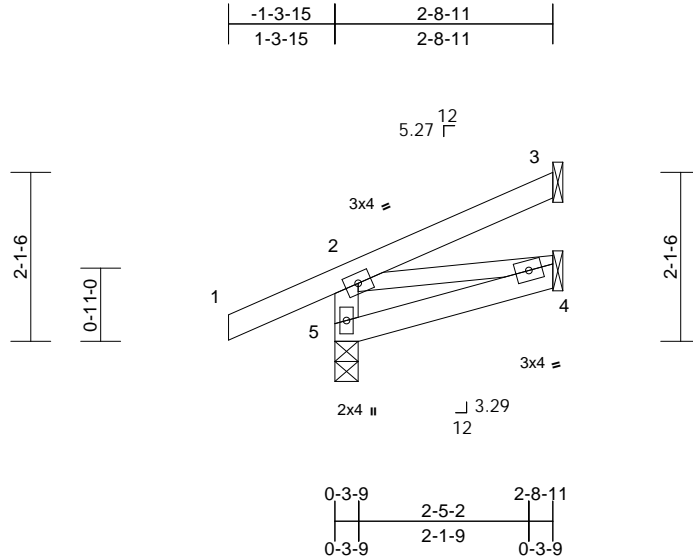

Scale = 1:28.8

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.17	Vert(LL)	0.00	4-5	>999	360	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.07	Vert(TL)	-0.01	4-5	>999	240	197/144
BCLL	0.0*	Rep Stress Incr	NO	WB	0.02	Horiz(TL)	0.00	3	n/a	n/a	
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-P		Wind(LL)	0.00	5	>999	240	Weight: 11 lb FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2 *Except* 4-2:2x3 SPF No.2

- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 40 lb uplift at joint 5, 33 lb uplift at joint 3 and 1 lb uplift at joint 4.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-0-13 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(lb/size) 3=58/ Mechanical, 4=26/
Mechanical, 5=248/0-3-8
Max Horiz 5=58 (LC 5)
Max Uplift 3=-33 (LC 8), 4=-1 (LC 8), 5=-40 (LC 8)
Max Grav 3=58 (LC 1), 4=52 (LC 3), 5=248 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-5=-222/73, 1-2=0/41, 2-3=-48/16
BOT CHORD 4-5=-68/11
WEBS 2-4=0/63

NOTES

- 1) Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 145 CB	
B220054	J2	Jack-Open Girder	1	1	Job Reference (optional)	I50049386

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:12
ID:gOp5loPuKNC?gJSe1gf_qdzuPP5-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f

Page: 1

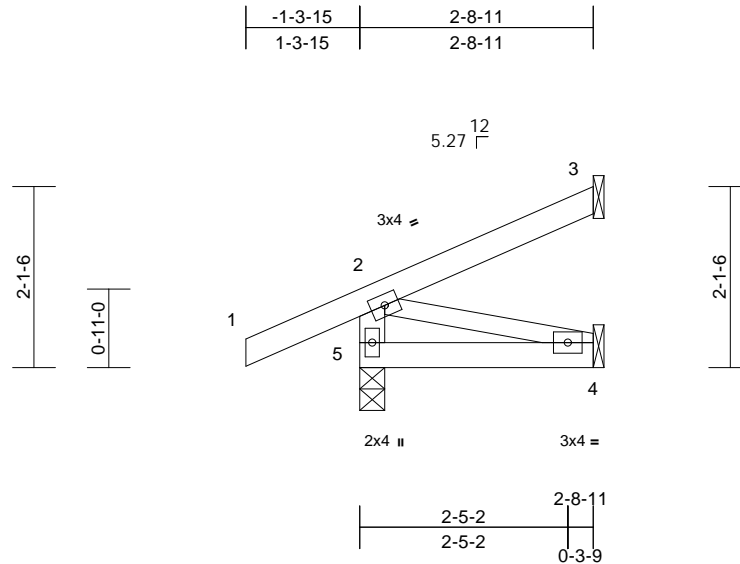

Scale = 1:26.9

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.17	Vert(LL)	0.00	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.07	Vert(TL)	-0.01	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.02	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-P							Weight: 11 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2 *Except* 4-2:2x3 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or
2-10-14 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc
bracing.

REACTIONS (lb/size) 3=58/ Mechanical, 4=26/
Mechanical, 5=247/0-3-8
Max Horiz 5=58 (LC 8)
Max Uplift 3=-33 (LC 8), 4=-1 (LC 8), 5=-41
(LC 8)
Max Grav 3=58 (LC 1), 4=52 (LC 3), 5=247
(LC 1)

FORCES (lb) - Maximum Compression/Maximum
Tension

TOP CHORD 2-5=-222/56, 1-2=0/41, 2-3=-48/16
BOT CHORD 4-5=-63/0
WEBS 2-4=0/65

NOTES

- 1) Wind: ASCE 7-10; Vult=115mph (3-second gust) V
(IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft;
Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior
zone; cantilever left and right exposed; end vertical left
and right exposed; Lumber DOL=1.60 plate grip
DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to
bearing plate capable of withstanding 41 lb uplift at joint
5, 33 lb uplift at joint 3 and 1 lb uplift at joint 4.

LOAD CASE(S) Standard



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job B220054	Truss V1	Truss Type Valley	Qty 1	Ply 1	Lot 145 CB Job Reference (optional)	I50049387
----------------	-------------	----------------------	----------	----------	--	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:12
ID: gOp5loPuKNC?gJSe1gf_qdzuPP5-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

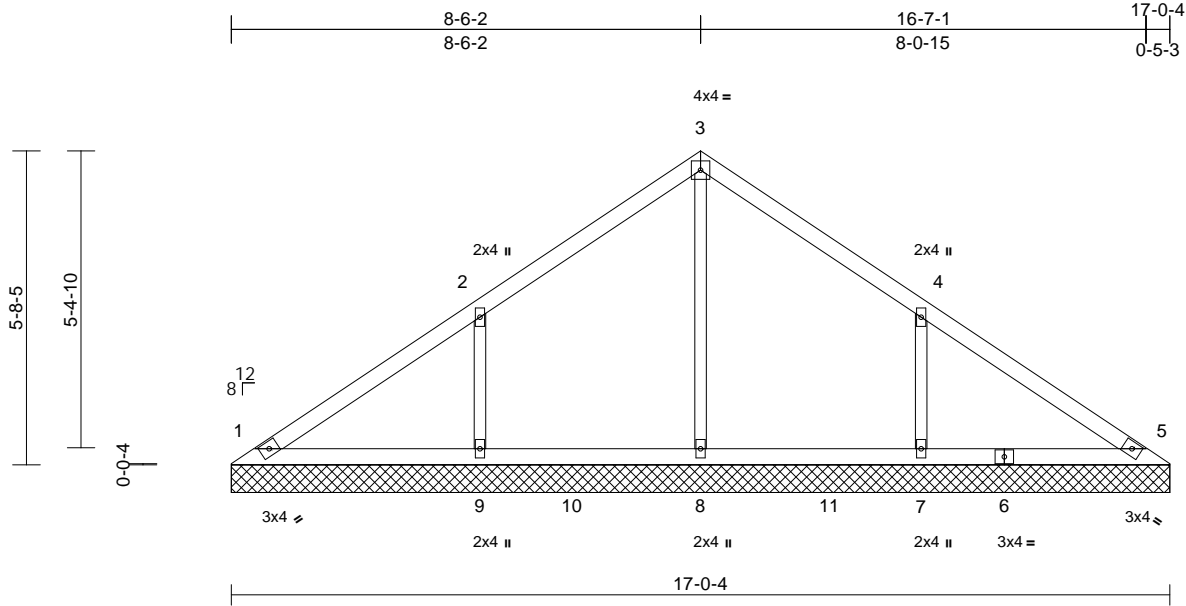

Scale = 1:41.8

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.22	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.12	Vert(TL)	n/a	-	n/a	999	197/144
BCLL	0.0*	Rep Stress Incr	YES	WB	0.13	Horiz(TL)	0.00	5	n/a	n/a	
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S							Weight: 50 lb FT = 10%

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
OTHERS	2x3 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(lb/size)	1=170/17-0-4, 5=170/17-0-4, 7=429/17-0-4, 8=252/17-0-4, 9=429/17-0-4
	Max Horiz	1=140 (LC 4)
	Max Uplift	1=15 (LC 9), 7=173 (LC 9), 9=173 (LC 8)
	Max Grav	1=170 (LC 1), 5=170 (LC 1), 7=463 (LC 16), 8=354 (LC 15), 9=464 (LC 15)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD	1-2=-149/105, 2-3=-148/127, 3-4=-140/106, 4-5=-114/68
BOT CHORD	1-9=-41/95, 8-9=-41/95, 7-8=-41/95, 5-7=-41/95
WEBS	3-8=-183/0, 2-9=-347/219, 4-7=-347/219

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.

- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 15 lb uplift at joint 1, 173 lb uplift at joint 9 and 173 lb uplift at joint 7.

LOAD CASE(S) Standard



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job B220054	Truss V2	Truss Type Valley	Qty 1	Ply 1	Lot 145 CB Job Reference (optional)	I50049388
----------------	-------------	----------------------	----------	----------	--	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:12
ID:8aNTy8QW5hKsIT1rbNADMqzuPP4-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

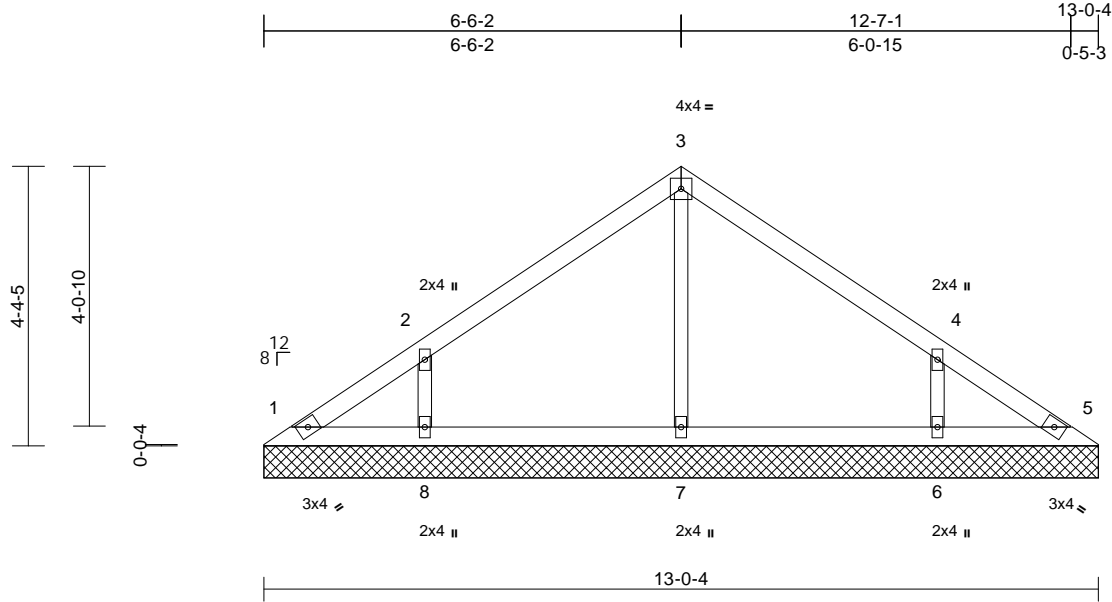

Scale = 1:36

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.17	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.10	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.08	Horiz(TL)	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S							Weight: 36 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x3 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(lb/size) 1=73/13-0-4, 5=73/13-0-4,
6=330/13-0-4, 7=285/13-0-4,
8=330/13-0-4
Max Horiz 1=-106 (LC 4)
Max Uplift 1=-22 (LC 4), 5=-2 (LC 5), 6=-139
(LC 9), 8=-139 (LC 8)
Max Grav 1=91 (LC 16), 5=76 (LC 15), 6=348
(LC 16), 7=285 (LC 1), 8=348 (LC 15)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-112/81, 2-3=-144/97, 3-4=-140/74,
4-5=-88/46

BOT CHORD 1-8=-26/73, 7-8=-26/73, 6-7=-26/73,
5-6=-26/73

WEBS 3-7=-200/21, 2-8=-281/181, 4-6=-281/180

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.

- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 22 lb uplift at joint 1, 2 lb uplift at joint 5, 139 lb uplift at joint 8 and 139 lb uplift at joint 6.

LOAD CASE(S) Standard



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 145 CB	I50049389
B220054	V3	Valley	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:12
ID:8aNTy8QW5hKsIT1rbNADMqzuPP4-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?f

Page: 1

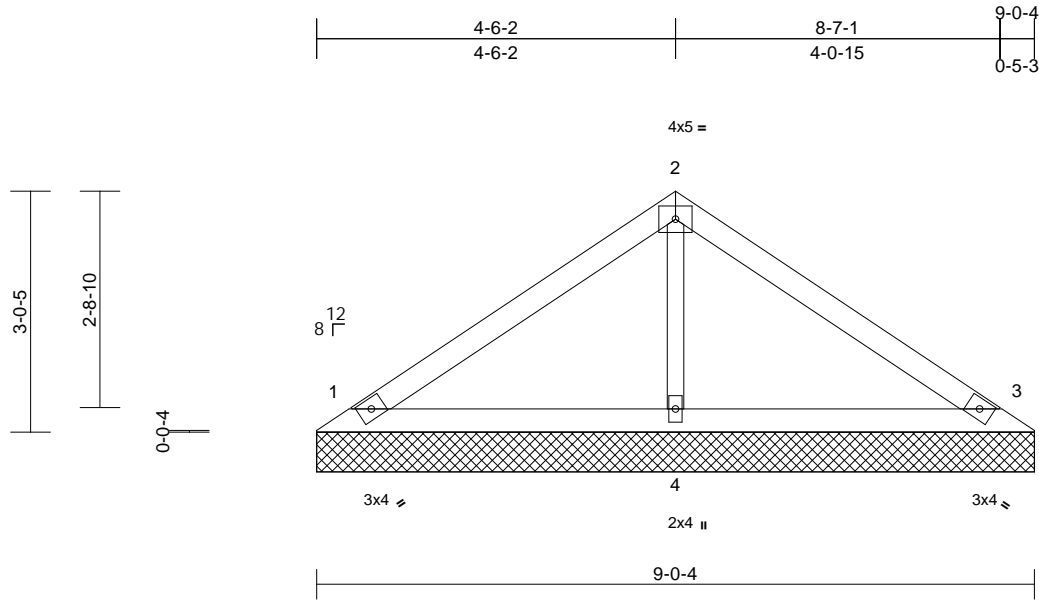

Scale = 1:29

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.22	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.14	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.05	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S							Weight: 23 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x3 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(lb/size) 1=188/9-0-4, 3=188/9-0-4,
4=355/9-0-4
Max Horiz 1=-71 (LC 4)
Max Uplift 1=-36 (LC 8), 3=-44 (LC 9), 4=-14 (LC 8)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-140/67, 2-3=-140/51
BOT CHORD 1-4=-14/65, 3-4=-14/65
WEBS 2-4=-231/59

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 36 lb uplift at joint 1, 44 lb uplift at joint 3 and 14 lb uplift at joint 4.

LOAD CASE(S) Standard



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 145 CB	I50049390
B220054	V4	Valley	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:12
ID:8aNTy8QW5hKsIT1rbNADMqzuPP4-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?f

Page: 1

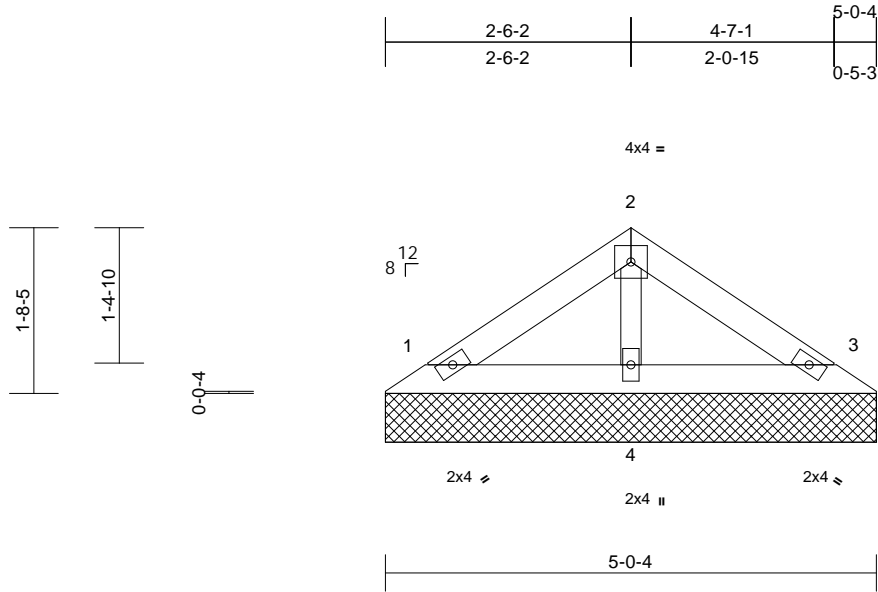

Scale = 1:23.6

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.02	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-P							Weight: 12 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x3 SPF No.2

- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 23 lb uplift at joint 1 and 28 lb uplift at joint 3.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-1-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 1=104/5-0-4, 3=104/5-0-4, 4=162/5-0-4
Max Horiz 1=36 (LC 5)
Max Uplift 1=-23 (LC 8), 3=-28 (LC 9)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-65/33, 2-3=-62/25
BOT CHORD 1-4=-7/30, 3-4=-7/30
WEBS 2-4=-111/28

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 145 CB	I50049391
B220054	V5	Valley	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:13
ID:8aNTy8QW5hKsIT1rbNADMqzuPP4-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Page: 1

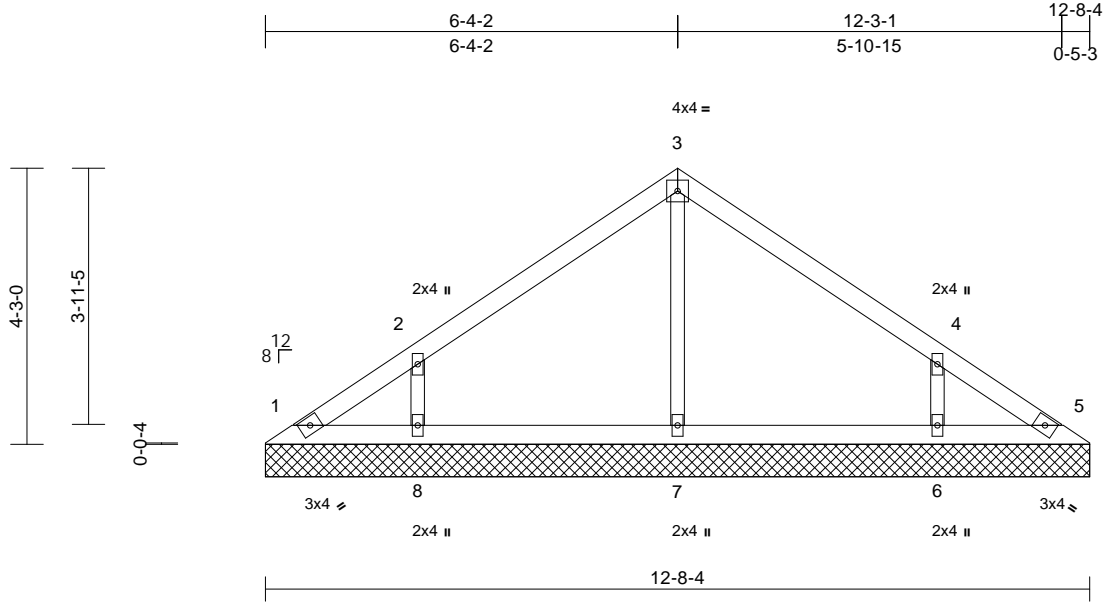

Scale = 1:35.5

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.17	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.10	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.08	Horiz(TL)	0.00	5	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-S						Weight: 35 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x3 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(lb/size) 1=61/12-8-4, 5=61/12-8-4, 6=326/12-8-4, 7=285/12-8-4, 8=326/12-8-4
Max Horiz 1=-103 (LC 4)
Max Uplift 1=-25 (LC 4), 5=-6 (LC 5), 6=-138 (LC 9), 8=-138 (LC 8)
Max Grav 1=82 (LC 16), 5=68 (LC 15), 6=344 (LC 16), 7=285 (LC 1), 8=345 (LC 15)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-108/80, 2-3=-143/95, 3-4=-140/72, 4-5=-85/46

BOT CHORD 1-8=-25/72, 7-8=-25/72, 6-7=-25/72, 5-6=-25/72

WEBS 3-7=-200/23, 2-8=-280/180, 4-6=-280/180

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.

- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 25 lb uplift at joint 1, 6 lb uplift at joint 5, 138 lb uplift at joint 8 and 138 lb uplift at joint 6.

LOAD CASE(S) Standard



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see


ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Wheeler Lumber, Waverly, KS - 66871, Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:13 Page: 1
ID:8aNTy8QW5hKsIT1rbNADMazuPP4-RfC?PsB70Hg3NSaPqnL8w3ulTXbGKWkCDoi7J4zJC?f



LUMBER		8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 43 lb uplift at joint 1 and 52 lb uplift at joint 3.
TOP CHORD	2x4 SPF No.2	
BOT CHORD	2x4 SPF No.2	
OTHERS	2x3 SPF No.2	LOAD CASE(S) Standard

BRACING	
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
REACTIONS	(lb/size) 1=197/8-8-4, 3=197/8-8-4, 4=306/8-8-4
	Max Horiz 1=-68 (LC 4)
	Max Uplift 1=-43 (LC 8), 3=-52 (LC 9)
FORCES	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-122/62, 2-3=-118/47
BOT CHORD	1-4=-14/57, 3-4=-14/57
WFRS	2-4=-209/53

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 4-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.




Job	Truss	Truss Type	Qty	Ply	Lot 145 CB	I50049393
B220054	V7	Valley	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Oct 11 2021 Print: 8.430 S Oct 11 2021 MiTek Industries, Inc. Thu Feb 03 10:04:13
ID:8aNTy8QW5hKsIT1rbNADMqzuPP4-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?f

Page: 1

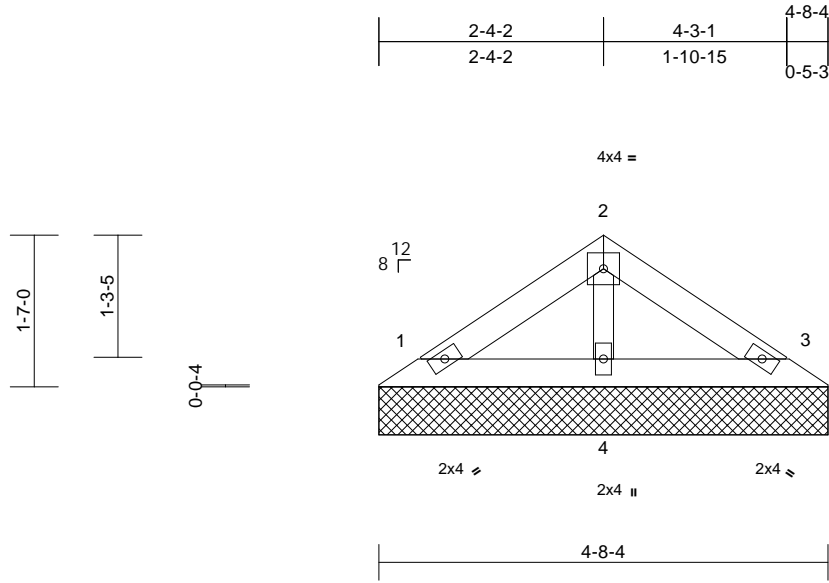

Scale = 1:24

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.06	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.02	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2012/TPI2007	Matrix-P							Weight: 11 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x3 SPF No.2

- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 21 lb uplift at joint 1 and 25 lb uplift at joint 3.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-9-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 1=96/4-8-4, 3=96/4-8-4, 4=149/4-8-4

Max Horiz 1=-33 (LC 4)
Max Uplift 1=-21 (LC 8), 3=-25 (LC 9)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-59/30, 2-3=-57/23
BOT CHORD 1-4=-7/28, 3-4=-7/28
WEBS 2-4=-102/26

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph (3-second gust) V (IRC2012)=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.



February 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MiTek 20/20** software or upon request.

PLATE SIZE

4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

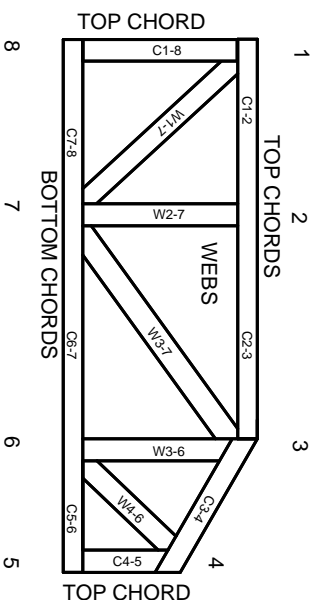

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MiTek® All Rights Reserved



MiTek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.