



MiTek USA, Inc.
16023 Swingley Ridge Rd
Chesterfield, MO 63017
314-434-1200

RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
Development Services
LEE'S SUMMIT, MISSOURI

Re: 3008832
C&H/156 Cobey

The truss drawing(s) referenced below have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Builders FirstSource (Valley Center).

Pages or sheets covered by this seal: I51285899 thru I51285900

My license renewal date for the state of Missouri is December 31, 2023.

Missouri COA: Engineering 001193



April 12, 2022

Sevier, Scott ,Engineer

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	C&H/156 Cobey	151285899
3008832	C2	HIP	1	1	Job Reference (optional)	

Builders First Source, Valley Center, KS 67147


8.530 e Dec 6 2021 MiTek Industries, Inc. Tue Apr 12 09:04:45 2022 Page 1
ID: cHShbP3Ybgcv?UC2L7?eKUz02xT-OfiqnaMwmrIERSzW7Qnq1hO_c4fApLiFGbdL9zRVs0

0-10-8 4-9-15 9-4-6 10-8-0 16-0-0 21-5-9 26-7-11 31-2-1 35-8-8
0-10-8 4-9-15 4-6-7 1-3-11 5-4-0 5-5-9 5-2-1 4-6-7 4-6-7

REPAIR: TRIM 0-1-0 FROM MEMBER 15-16

LUMBER AND CONNECTOR PLATES MUST BE CUT CLEANLY AND ACCURATELY
AND THE REMAINING PLATE MUST BE FULLY EMBEDDED AND UNDISTURBED.

Scale: 3/16"=1'

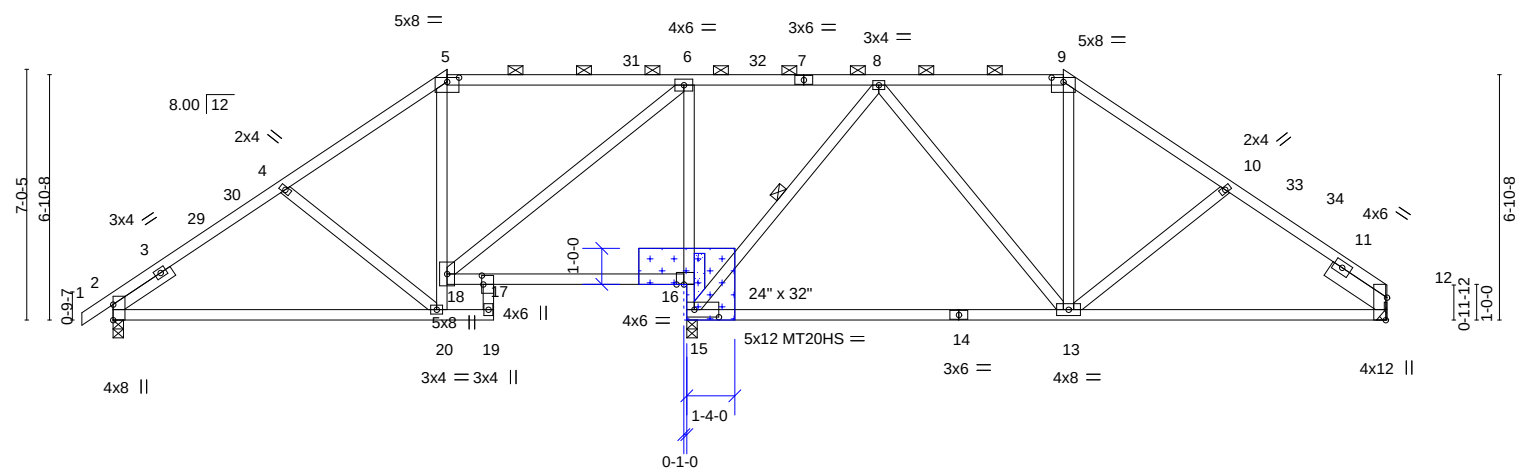

ATTACH 1/2" PLYWOOD OR OSB GUSSET (15/32" RATED SHEATHING 32/16 EXP 1)
TO EACH FACE OF TRUSS WITH (0.131" X 2.5" MIN.) NAILS PER THE FOLLOWING NAIL SCHEDULE:
2 X 3'S - 2 ROWS, 2 X 4'S - 3 ROWS, 2 X 6'S AND LARGER - 4 ROWS: SPACED @ 4" O.C.
NAILS TO BE DRIVEN FROM BOTH FACES. STAGGER SPACING FROM FRONT TO BACK FACE
FOR A NET 2" O.C. SPACING IN EACH COVERED TRUSS MEMBER. USE 2" MEMBER END DISTANCE.

INSTALL 2 X 4 X 16" SPF/DF/SP NO.2
CUT TO FIT TIGHT.

9-4-6 10-8-0 16-0-0 16-1-0 21-5-9 26-7-11 35-8-8
9-4-6 1-3-11 5-4-0 0-1-0 5-4-9 5-2-1 9-0-13

Plate Offsets (X,Y)-- [5:0-4-0,0-1-7], [9:0-4-0,0-1-7], [12:0-7-9,Edge], [15:0-8-4,0-2-8], [16:0-2-8,0-0-0], [17:0-3-0,0-0-8]

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.56	Vert(LL) -0.30	13-15	>788	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.78	Vert(CT) -0.61	13-15	>381	180	MT20HS	148/108
BCLL 0.0	Rep Stress Incr YES	WB 0.31	Horz(CT) 0.04	12	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS						
							Weight: 159 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except [PSA]
BOT CHORD 2x4 SPF No.2	2-0-0 oc purlins (6-0-0 max.): 5-9.
WEBS 2x4 SPF No.2	Rigid ceiling directly applied.
SLIDER Left 2x4 SPF No.2 2-0-0, Right 2x6 SP 2400F 2.0E 2-0-0	1 Row at midpt 8-15

REACTIONS. (lb/size) 12=810/Mechanical, 2=709/0-3-8, 15=1755/0-3-8
Max Horz 2=171(LC 9)
Max Uplift 12=219(LC 13), 2=154(LC 12), 15=311(LC 9)
Max Grav 12=832(LC 26), 2=716(LC 25), 15=1755(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-617/0, 3-29=-700/185, 29-30=-692/196, 4-30=-615/199, 4-5=-534/173,
5-31=-401/197, 6-31=-402/196, 8-9=-630/303, 9-10=-833/305, 10-33=-909/325,
33-34=-910/322, 11-34=-1013/304, 11-12=-288/0
BOT CHORD 2-20=-197/594, 19-20=-48/262, 17-18=-406/121, 15-16=-1016/266, 6-16=-902/278,
14-15=-72/412, 13-14=-72/412, 12-13=-188/781
WEBS 4-20=-309/182, 18-20=-23/452, 8-15=-831/182, 8-13=-5/374, 6-18=-169/693

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-10-8 to 2-8-11, Interior(1) 2-8-11 to 9-4-6, Exterior(2R) 9-4-6 to 14-5-7, Interior(1) 14-5-7 to 26-7-11, Exterior(2R) 26-7-11 to 31-8-12, Interior(1) 31-8-12 to 35-8-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 219 lb uplift at joint 12, 154 lb uplift at joint 2 and 311 lb uplift at joint 15.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S)

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15



April 12, 2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**
Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	C&H/156 Cobey	IS1285899
3008832	C2	HIP	1	1	Job Reference (optional)	

Builders First Source, Valley Center, KS 67147

8.530 e Dec 6 2021 MiTek Industries, Inc. Tue Apr 12 09:04:45 2022 Page 2
ID:CHSbhP3Ybgcv?UC2L7?eKUz02xT-OfIqnaMwmrIERSzW7Qnq1hO_c4fFAPLiFGbdL9zRVs0

LOAD CASE(S)

- Uniform Loads (plf)
Vert: 1-5=-70, 5-9=-70, 9-12=-70, 19-25=-20, 16-17=-20, 15-21=-20
- 2) Dead + 0.75 Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-5=-58, 5-9=-58, 9-12=-58, 19-25=-20, 16-17=-20, 15-21=-20
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-5=-20, 5-9=-20, 9-12=-20, 19-25=-40, 16-17=-40, 15-21=-40
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=40, 2-29=20, 5-29=12, 5-31=27, 9-31=12, 9-33=27, 12-33=12, 19-25=-8, 16-17=-8, 15-21=-8
Horz: 1-2=-52, 2-29=-32, 5-29=-24, 9-33=39, 12-33=24
Drag: 5-31=0, 6-31=0, 8-9=-0
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=6, 2-30=12, 5-30=27, 5-8=12, 8-9=27, 9-34=12, 12-34=20, 19-25=-8, 16-17=-8, 15-21=-8
Horz: 1-2=-18, 2-30=-24, 5-30=-39, 9-34=24, 12-34=32
Drag: 5-6=0, 8-9=-0
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-10, 2-5=-36, 5-9=-36, 9-12=-36, 19-25=-20, 16-17=-20, 15-21=-20
Horz: 1-2=-10, 2-5=16, 9-12=-16
Drag: 5-6=-0, 8-9=0
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-30, 2-5=-36, 5-9=-36, 9-12=-36, 19-25=-20, 16-17=-20, 15-21=-20
Horz: 1-2=10, 2-5=16, 9-12=-16
Drag: 5-6=-0, 8-9=0
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-1, 2-5=-15, 5-9=29, 9-12=11, 19-25=-8, 16-17=-8, 15-21=-8
Horz: 1-2=-11, 2-5=3, 9-12=23
Drag: 5-6=0, 8-9=-0
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=5, 2-5=11, 5-9=29, 9-12=-15, 19-25=-8, 16-17=-8, 15-21=-8
Horz: 1-2=-17, 2-5=-23, 9-12=-3
Drag: 5-6=0, 8-9=-0
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-29, 2-5=-35, 5-9=9, 9-12=-9, 19-25=-20, 16-17=-20, 15-21=-20
Horz: 1-2=9, 2-5=15, 9-12=11
Drag: 5-6=0, 8-9=-0
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-3, 2-5=-9, 5-9=9, 9-12=-35, 19-25=-20, 16-17=-20, 15-21=-20
Horz: 1-2=-17, 2-5=-11, 9-12=-15
Drag: 5-6=0, 8-9=-0
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=23, 2-5=29, 5-32=29, 9-32=11, 9-12=11, 19-25=-8, 16-17=-8, 15-21=-8
Horz: 1-2=-35, 2-5=-41, 9-12=23
Drag: 5-6=0, 8-9=-0
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=5, 2-5=11, 5-32=11, 9-32=29, 9-12=29, 19-25=-8, 16-17=-8, 15-21=-8
Horz: 1-2=-17, 2-5=-23, 9-12=41
Drag: 5-6=0, 8-9=-0
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=11, 2-5=16, 5-32=16, 9-32=6, 9-12=6, 19-25=-8, 16-17=-8, 15-21=-8
Horz: 1-2=-23, 2-5=-28, 9-12=18
Drag: 5-6=0, 8-9=-0
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=0, 2-5=6, 5-32=6, 9-32=16, 9-12=16, 19-25=-8, 16-17=-8, 15-21=-8
Horz: 1-2=-12, 2-5=-18, 9-12=28
Drag: 5-6=0, 8-9=-0
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=15, 2-5=9, 5-32=9, 9-32=-9, 9-12=-9, 19-25=-20, 16-17=-20, 15-21=-20
Horz: 1-2=-35, 2-5=-29, 9-12=11
Drag: 5-6=0, 8-9=-0
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	C&H/156 Cobey	IS1285899
3008832	C2	HIP	1	1	Job Reference (optional)	

Builders First Source, Valley Center, KS 67147

8.530 e Dec 6 2021 MiTek Industries, Inc. Tue Apr 12 09:04:45 2022 Page 3
ID:cHSbhP3Ybgcv?UC2L7?eKUz02xT-OfliqnaMwmrIERSzW7Qnq1hO_c4fFAPLiFGbdL9zRVs0

LOAD CASE(S)

- Uniform Loads (plf)
 - Vert: 1-2=-3, 2-5=-9, 5-32=-9, 9-32=9, 9-12=9, 19-25=-20, 16-17=-20, 15-21=-20
 - Horz: 1-2=-17, 2-5=-11, 9-12=29
 - Drag: 5-6=0, 8-9=0
- 18) Dead: Lumber Increase=0.90, Plate Increase=0.90 Plt. metal=0.90
 - Uniform Loads (plf)
 - Vert: 1-5=-20, 5-9=-20, 9-12=-20, 19-25=-20, 16-17=-20, 15-21=-20
- 19) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
 - Uniform Loads (plf)
 - Vert: 1-2=-64, 2-5=-69, 5-9=-36, 9-12=-49, 19-25=-20, 16-17=-20, 15-21=-20
 - Horz: 1-2=7, 2-5=11, 9-12=9
 - Drag: 5-6=0, 8-9=0
- 20) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
 - Uniform Loads (plf)
 - Vert: 1-2=-45, 2-5=-49, 5-9=-36, 9-12=-69, 19-25=-20, 16-17=-20, 15-21=-20
 - Horz: 1-2=-13, 2-5=-9, 9-12=-11
 - Drag: 5-6=0, 8-9=0
- 21) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
 - Uniform Loads (plf)
 - Vert: 1-2=-31, 2-5=-36, 5-32=-36, 9-32=-49, 9-12=-49, 19-25=-20, 16-17=-20, 15-21=-20
 - Horz: 1-2=-26, 2-5=-22, 9-12=9
 - Drag: 5-6=0, 8-9=0
- 22) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
 - Uniform Loads (plf)
 - Vert: 1-2=-45, 2-5=-49, 5-32=-49, 9-32=-36, 9-12=-36, 19-25=-20, 16-17=-20, 15-21=-20
 - Horz: 1-2=-13, 2-5=-9, 9-12=22
 - Drag: 5-6=0, 8-9=0
- 23) Dead + 0.6 C-C Wind Min. Down: Lumber Increase=1.60, Plate Increase=1.60
 - Uniform Loads (plf)
 - Vert: 1-2=4, 2-5=-28, 5-9=-28, 9-12=-28, 19-25=-8, 16-17=-8, 15-21=-8
 - Horz: 1-2=-16, 2-5=16, 9-12=-16
 - Drag: 5-6=-0, 8-9=0
- 24) Dead + 0.6 C-C Wind Min. Upward: Lumber Increase=1.60, Plate Increase=1.60
 - Uniform Loads (plf)
 - Vert: 1-5=4, 5-9=4, 9-12=4, 19-25=-8, 16-17=-8, 15-21=-8
 - Horz: 1-5=-16, 9-12=16
 - Drag: 5-6=0, 8-9=0
- 25) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-5=-70, 5-9=-70, 9-12=-20, 19-25=-20, 16-17=-20, 15-21=-20
- 26) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-5=-20, 5-9=-70, 9-12=-70, 19-25=-20, 16-17=-20, 15-21=-20
- 27) 3rd Dead + 0.75 Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-5=-58, 5-9=-58, 9-12=-20, 19-25=-20, 16-17=-20, 15-21=-20
- 28) 4th Dead + 0.75 Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-5=-20, 5-9=-58, 9-12=-58, 19-25=-20, 16-17=-20, 15-21=-20

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	C&H/156 Cobey	IS1285900
3008832	C3	ROOF SPECIAL	1	1		

Builders First Source, Valley Center, KS 67147


ID: cHSbhP3Ybgcv?UC2L7?eKUz02xT-XKF92X9NgdW5pMs9MDymZ63OJ8ZFa68dVxA?30zRVph
8.530 e Dec 6 2021 MiTek Industries, Inc. Tue Apr 12 09:07:14 2022 Page 1

0-10-8	4-2-7	8-1-6	10-8-0	16-0-0	20-2-7	24-1-6	26-0-0	30-10-4	35-8-8
0-10-8	4-2-7	3-10-15	2-6-10	5-4-0	4-2-7	3-10-15	1-10-10	4-10-4	4-10-4

REPAIR: TRIM 0-1-0 FROM MEMBER 15-16

LUMBER AND CONNECTOR PLATES MUST BE CUT CLEANLY AND ACCURATELY AND THE REMAINING PLATE MUST BE FULLY EMBEDDED AND UNDISTURBED.

Scale = 1:63.2

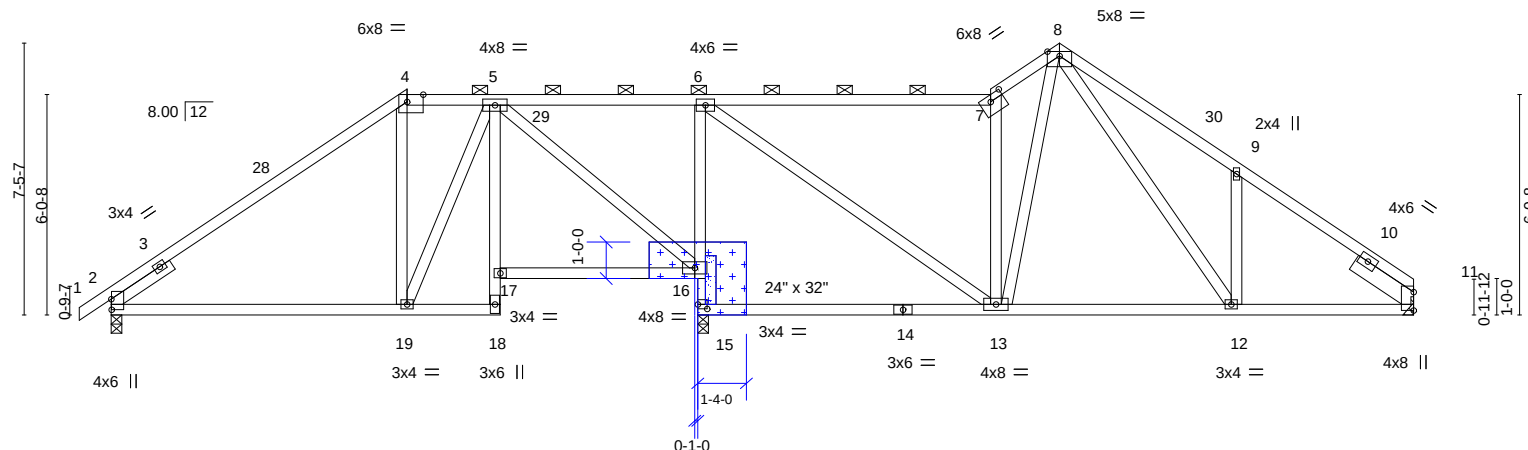

ATTACH 1/2" PLYWOOD OR OSB GUSSET (15/32" RATED SHEATHING 32/16 EXP 1) TO EACH FACE OF TRUSS WITH (0.131" X 2.5" MIN.) NAILS PER THE FOLLOWING NAIL SCHEDULE: 2 X 3'S - 2 ROWS, 2 X 4'S - 3 ROWS, 2 X 6'S AND LARGER - 4 ROWS: SPACED @ 4" O.C. NAILS TO BE DRIVEN FROM BOTH FACES. STAGGER SPACING FROM FRONT TO BACK FACE FOR A NET 2" O.C. SPACING IN EACH COVERED TRUSS MEMBER. USE 2" MEMBER END DISTANCE.



INSTALL 2 X 4 X 16" SPF/DF/SP NO.2 CUT TO FIT TIGHT.

8-1-6	10-8-0	16-0-0	16-1-0	20-2-7	24-1-6	26-0-0	30-10-4	35-8-8
8-1-6	2-6-10	5-4-0	0-1-0	4-1-7	3-10-15	1-10-10	4-10-4	4-10-4

Plate Offsets (X,Y)-- [2:0-3-8,0-0-2], [4:0-5-5,Edge], [7:0-4-8,0-2-0], [8:0-4-0,0-1-7], [15:0-3-1,0-1-8]

LOADING (psf)	SPACING-	CSL.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.80	Vert(LL) 0.12	19-26	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.58	Vert(CT) -0.23	13-15	>998	180		
BCLL 0.0	Rep Stress Incr YES	WB 0.70	Horz(CT) 0.05	11	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS						
							Weight: 166 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
SLIDER Left 2x4 SPF No.2 2-0-0, Right 2x6 SPF No.2 2-0-0

BRACING-
TOP CHORD Structural wood sheathing directly applied, except [PSA]
BOT CHORD 2-0-0 oc purlins (5-10-6 max.): 4-7.
Rigid ceiling directly applied.

REACTIONS. (lb/size) 11=804/Mechanical, 2=702/0-3-8, 15=1768/0-3-8
Max Horz 2=184(LC 9)
Max Uplift 11=-178(LC 13), 2=-160(LC 12), 15=-346(LC 12)
Max Grav 11=804(LC 1), 2=708(LC 25), 15=1768(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-387/15, 3-28=-547/158, 4-28=-536/183, 4-5=-461/229, 5-29=-43/280, 6-29=-43/280,
6-7=-632/264, 7-8=-818/335, 8-30=-906/408, 9-30=-1001/379, 9-10=-982/247
BOT CHORD 2-19=-132/459, 18-19=-83/329, 16-17=-98/383, 15-16=-1703/376, 6-16=-1128/287,
12-13=-14/513, 11-12=-124/754
WEBS 5-16=-762/172, 6-13=-105/994, 7-13=-801/288, 8-13=-162/461, 8-12=-232/466,
9-12=-307/233, 5-19=-127/404

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-8-11, Interior(1) 2-8-11 to 8-1-6, Exterior(2R) 8-1-6 to 11-8-9, Interior(1) 11-8-9 to 26-0-0, Exterior(2R) 26-0-0 to 29-7-3, Interior(1) 29-7-3 to 35-8-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - The Fabrication Tolerance at joint 7 = 10%
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 178 lb uplift at joint 11, 160 lb uplift at joint 2 and 346 lb uplift at joint 15.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S)

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15



April 12, 2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	C&H/156 Cobey	IS1285900
3008832	C3	ROOF SPECIAL	1	1	Job Reference (optional)	

Builders First Source, Valley Center, KS 67147

8.530 e Dec 6 2021 MiTek Industries, Inc. Tue Apr 12 09:07:14 2022 Page 2
ID:CHSbhp3Ybgcv?UC2L7?eKUZ02xT-XKF92X9NgdW5pMs9MDymZ63OJ8ZFaf68dVxA?30zRVph

LOAD CASE(S)

- Uniform Loads (plf)
Vert: 1-4=-70, 4-7=-70, 7-8=-70, 8-11=-70, 18-24=-20, 16-17=-20, 15-20=-20
- 2) Dead + 0.75 Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-58, 4-7=-58, 7-8=-58, 8-11=-58, 18-24=-20, 16-17=-20, 15-20=-20
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-20, 4-7=-20, 7-8=-20, 8-11=-20, 18-24=-40, 16-17=-40, 15-20=-40
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=40, 2-4=20, 4-29=27, 7-29=20, 7-8=20, 8-30=27, 11-30=20, 18-24=-8, 16-17=-8, 15-20=-8
Horz: 1-2=-52, 2-4=-32, 4-5=39, 7-8=32, 8-30=39, 11-30=32
Drag: 6-7=0
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=14, 2-28=20, 4-28=27, 4-7=20, 7-8=27, 8-11=20, 18-24=-8, 16-17=-8, 15-20=-8
Horz: 1-2=-26, 2-28=-32, 4-28=-39, 4-5=32, 7-8=-39, 8-11=32
Drag: 6-7=0
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-4, 2-4=-42, 4-7=-42, 7-8=-42, 8-11=-42, 18-24=-20, 16-17=-20, 15-20=-20
Horz: 1-2=-16, 2-4=22, 4-5=-22, 7-8=22, 8-11=-22
Drag: 6-7=0
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-36, 2-4=-42, 4-7=-42, 7-8=-42, 8-11=-42, 18-24=-20, 16-17=-20, 15-20=-20
Horz: 1-2=16, 2-4=22, 4-5=-22, 7-8=22, 8-11=-22
Drag: 6-7=0
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-1, 2-4=-15, 4-7=29, 7-8=-15, 8-11=11, 18-24=-8, 16-17=-8, 15-20=-8
Horz: 1-2=-11, 2-4=3, 4-5=41, 7-8=3, 8-11=23
Drag: 6-7=0
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=5, 2-4=11, 4-7=11, 7-8=11, 8-11=-15, 18-24=-8, 16-17=-8, 15-20=-8
Horz: 1-2=-17, 2-4=-23, 4-5=23, 7-8=-23, 8-11=-3
Drag: 6-7=0
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-29, 2-4=-35, 4-7=9, 7-8=-35, 8-11=-9, 18-24=-20, 16-17=-20, 15-20=-20
Horz: 1-2=9, 2-4=15, 4-5=29, 7-8=15, 8-11=11
Drag: 6-7=0
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-3, 2-4=-9, 4-7=-9, 7-8=-9, 8-11=-35, 18-24=-20, 16-17=-20, 15-20=-20
Horz: 1-2=-17, 2-4=-11, 4-5=11, 7-8=-11, 8-11=-15
Drag: 6-7=0
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=23, 2-4=29, 4-7=29, 7-8=29, 8-11=11, 18-24=-8, 16-17=-8, 15-20=-8
Horz: 1-2=-35, 2-4=-41, 4-5=41, 7-8=-41, 8-11=23
Drag: 6-7=0
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=5, 2-4=11, 4-7=11, 7-8=11, 8-11=29, 18-24=-8, 16-17=-8, 15-20=-8
Horz: 1-2=-17, 2-4=-23, 4-5=23, 7-8=-23, 8-11=41
Drag: 6-7=0
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=11, 2-4=16, 4-7=16, 7-8=16, 8-11=6, 18-24=-8, 16-17=-8, 15-20=-8
Horz: 1-2=-23, 2-4=-28, 4-5=28, 7-8=-28, 8-11=18
Drag: 6-7=0
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=0, 2-4=6, 4-7=6, 7-8=6, 8-11=16, 18-24=-8, 16-17=-8, 15-20=-8
Horz: 1-2=-12, 2-4=-18, 4-5=18, 7-8=-18, 8-11=28
Drag: 6-7=0
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=15, 2-4=9, 4-7=9, 7-8=9, 8-11=-9, 18-24=-20, 16-17=-20, 15-20=-20
Horz: 1-2=-35, 2-4=-29, 4-5=29, 7-8=-29, 8-11=11
Drag: 6-7=0
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	C&H/156 Cobey	IS1285900
3008832	C3	ROOF SPECIAL	1	1	Job Reference (optional)	

Builders First Source, Valley Center, KS 67147

8.530 e Dec 6 2021 MiTek Industries, Inc. Tue Apr 12 09:07:14 2022 Page 3
ID:cHSbhP3Ybgcv?UC2L7?eKUz02xT-XKF92X9NgdW5pMs9MDymZ63OJ8ZFa68dVxA?30zRVph

LOAD CASE(S)

- Uniform Loads (plf)
Vert: 1-2=-3, 2-4=-9, 4-7=-9, 7-8=-9, 8-11=9, 18-24=-20, 16-17=-20, 15-20=-20
Horz: 1-2=-17, 2-4=-11, 4-5=11, 7-8=-11, 8-11=29
Drag: 6-7=-0
- 18) Dead: Lumber Increase=0.90, Plate Increase=0.90 Plt. metal=0.90
Uniform Loads (plf)
Vert: 1-4=-20, 4-7=-20, 7-8=-20, 8-11=-20, 18-24=-20, 16-17=-20, 15-20=-20
- 19) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-64, 2-4=-69, 4-7=-36, 7-8=-69, 8-11=-49, 18-24=-20, 16-17=-20, 15-20=-20
Horz: 1-2=7, 2-4=11, 4-5=22, 7-8=11, 8-11=9
Drag: 6-7=-0
- 20) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-45, 2-4=-49, 4-7=-49, 7-8=-49, 8-11=-69, 18-24=-20, 16-17=-20, 15-20=-20
Horz: 1-2=-13, 2-4=-9, 4-5=9, 7-8=-9, 8-11=-11
Drag: 6-7=-0
- 21) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-31, 2-4=-36, 4-7=-36, 7-8=-36, 8-11=-49, 18-24=-20, 16-17=-20, 15-20=-20
Horz: 1-2=-26, 2-4=-22, 4-5=22, 7-8=-22, 8-11=9
Drag: 6-7=-0
- 22) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-45, 2-4=-49, 4-7=-49, 7-8=-49, 8-11=-36, 18-24=-20, 16-17=-20, 15-20=-20
Horz: 1-2=-13, 2-4=-9, 4-5=9, 7-8=-9, 8-11=22
Drag: 6-7=-0
- 23) Dead + 0.6 C-C Wind Min. Down: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=4, 2-4=-28, 4-7=-28, 7-8=-28, 8-11=-28, 18-24=-8, 16-17=-8, 15-20=-8
Horz: 1-2=-16, 2-4=16, 4-5=-16, 7-8=16, 8-11=-16
Drag: 6-7=0
- 24) Dead + 0.6 C-C Wind Min. Upward: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-4=4, 4-7=4, 7-8=4, 8-11=4, 18-24=-8, 16-17=-8, 15-20=-8
Horz: 1-4=-16, 4-5=16, 7-8=-16, 8-11=16
Drag: 6-7=-0
- 25) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-70, 4-7=-70, 7-8=-70, 8-11=-20, 18-24=-20, 16-17=-20, 15-20=-20
- 26) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-20, 4-7=-20, 7-8=-20, 8-11=-70, 18-24=-20, 16-17=-20, 15-20=-20
- 27) 3rd Dead + 0.75 Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-58, 4-7=-58, 7-8=-58, 8-11=-20, 18-24=-20, 16-17=-20, 15-20=-20
- 28) 4th Dead + 0.75 Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-20, 4-7=-20, 7-8=-20, 8-11=-58, 18-24=-20, 16-17=-20, 15-20=-20

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless X, Y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

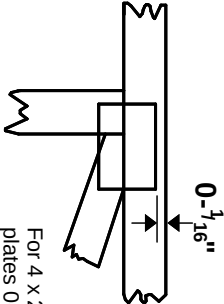

For 4 x 2 orientation, locate plates 0- $\frac{3}{16}$ " from outside edge of truss.

— This symbol indicates the required direction of slots in connector plates.


*** Plate location details available in MITek 20120 software or upon request.**

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1.1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

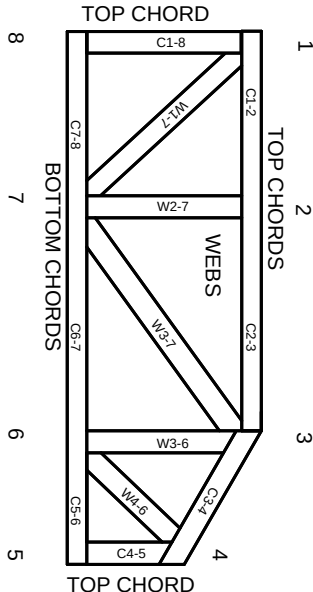

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved



MITek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T or I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.