

# **GEOTECHNICAL ENGINEERING REPORT**

## **PHASE 1 LEE'S SUMMIT LOGISTICS CENTER BUILDING A AND NW MAIN STREET RELOCATION**

**Prepared for:**  
Scannell Properties  
Indianapolis, Indiana

February 2022  
Olsson Project No. A21-04157





Scannell Properties  
Attn: Mr. Shaun Cofer  
8801 River Crossing Boulevard, Suite 300  
Indianapolis, Indiana 46240

Re: Geotechnical Engineering Report  
Lee's Summit Logistics Building A and NW Main Street Relocation  
Lee's Summit, Missouri  
Olsson Project No. A21-04157

Dear Mr. Cofer,

Olsson has completed the geotechnical engineering report for the new warehouse (Building A) and public roadway reconfiguration (NW Main Street) for the Lee's Summit Logistics project in Lee's Summit, Missouri. The enclosed report summarizes our understanding of the project, presents the findings of the borings and laboratory tests, discusses the observed subsurface conditions, and based on those conditions, provides geotechnical engineering recommendations for the new warehouse and roadway.

We appreciate the opportunity to provide our geotechnical engineering services for this project. If you have any questions or need further assistance, please contact us at your convenience.

Respectfully submitted,  
**Olsson, Inc.**

A handwritten signature in blue ink, appearing to read "JD Putnam".

JD Putnam, E.I.  
Assistant Engineer



Ian A. Dillon, PE  
Senior Geotechnical Engineer

# TABLE OF CONTENTS

<b>1. Project Understanding</b>	<b>1</b>
1.1 Project Scope	1
1.2 Project Site	1
1.3 Project Information	2
<b>2. Field Exploration and Laboratory Testing</b>	<b>4</b>
2.1 Field Exploration	4
2.2 Laboratory Testing	4
<b>3. Subsurface Conditions</b>	<b>5</b>
3.1 Area Geology	5
3.2 Subsurface Stratification	5
3.3 Water Level Observations	6
<b>4. Geotechnical Considerations</b>	<b>7</b>
<b>5. Site Preparation</b>	<b>8</b>
5.1 General Site Preparation	8
5.2 Structural Fill	8
5.3 Drainage and Groundwater Considerations	10
5.4 Deep Fills	10
<b>6. Structures</b>	<b>11</b>
6.1 Shallow Foundations	11
6.2 Floor Slab Subgrade Preparation	11
6.3 Lateral Earth Pressures	12
6.4 Modular Block Retaining Walls	14
6.5 Site Seismic Classification	15
<b>7. Pavements</b>	<b>16</b>
7.1 Warehouse Pavement Subgrade Preparation	16
7.2 NW Main Street Subgrade Preparation	16
7.3 General Subgrade Preparation	16
7.4 Pavement Section Thicknesses	17

<b>8. Conclusions and Limitations .....</b>	<b>20</b>
8.1 Construction Observation and Testing.....	20
8.2 Limitations .....	20
<b>Appendix A Boring Location Map.....</b>	<b>21</b>
<b>Appendix B Borehole Symbols and Nomenclature .....</b>	<b>23</b>
<b>Appendix C Laboratory Test Results .....</b>	<b>25</b>
<b>Appendix D 2021 Previous Olsson Borings .....</b>	<b>27</b>

## LIST OF FIGURES

Figure 1. Project Site Location .....	2
Figure 2. Proposed Site Layout.....	3
Figure 3. Generalized Linn Subgroup Bedrock Formation.....	5

## LIST OF TABLES

Table 1. Auger Refusal on Limestone .....	6
Table 2. Fill Placement Guidelines .....	9
Table 3. Lateral Earth Pressure .....	13
Table 4. Warehouse Pavement Section Thicknesses.....	17
Table 5. Lee's Summit, Missouri Commercial Industrial Collector Pavement Section.....	18

## APPENDICES

Appendix A Boring Location Map
Appendix B Borehole Symbols and Nomenclature
Appendix C Laboratory Test Results
Appendix D 2021 Previous Olsson Borings

# 1. PROJECT UNDERSTANDING

## 1.1 Project Scope

This Geotechnical Engineering Report presents the results of the subsurface conditions for Building A and the proposed roadway realignment of NW Main Street for the Lee's Summit Logistics Center in Lee's Summit, Missouri. We drilled 21 borings within the proposed building pad and associated pavement areas. We drilled an additional 4 borings along the new alignment of NW Main Street. The approximate locations of the borings are presented on the Boring Location Map in Appendix A and the associated Borehole Reports are presented in Appendix B. Laboratory test results are presented in Appendix C. The purpose of this report is to analyze the subsurface conditions encountered at the borings, and based on those conditions, provide geotechnical engineering recommendations for the preparation of the site, foundation recommendations, support of the floor slabs and pavements, and minimum pavement thicknesses for the proposed building pavements and NW Main Street.

Olsson, Inc. (**Olsson**) previously submitted a Preliminary Geotechnical Engineering Report (**Olsson** project number 021-04157, dated June 22, 2021) providing preliminary geotechnical recommendations for the site. As part of the preliminary report, six of the subsurface exploratory borings (B-7 through B-12) are located within or near the work planned as part of this phase. We have appended these respective borehole reports in Appendix D.

## 1.2 Project Site

The project site is located north of the intersection of NE Tudor Road and NW Main Street in Lee's Summit, Missouri (Figure 1). NW Main Street is generally orientated North to South through the center of the site. At the time of our exploration, the surface conditions within the proposed building pad and new pavement areas consisted of shallow rooted grass vegetation to the east of Main Street and grass and trees to the west of Main Street. The site generally slopes down to the west and north from the east. Elevations within the proposed building pad and warehouse associated pavements ranged from 945 feet to 1010 feet.



**Figure 1. Project Site Location**

Based on readily available historical aerial imagery provided by Google Earth®, the site has been used for agricultural purposes dating back to at least 1990. NW Main Street has also been in its current location since at least 1990.

### **1.3 Project Information**

We understand that Building A will consist of a warehouse structure with an approximate footprint area of 431,460 square feet. The slab-on-grade, dock high structure will utilize precast tilt up panel walls. Based on our experience with similar sized projects, we anticipate that the warehouse will have column loads of less than 150 kips and wall loads less than 8 kips per linear foot (klf). The finished floor elevation of the structure is planned at 991.5 feet. Loading docks, truck parking and truck drive lanes are planned on the north and south sides of the structure. Personal vehicle parking and drive areas are planned to the east and west of the warehouse. Entrance drives to the parking and drive areas are planned at the southeast, northeast and northwest of the structure.

We understand that four detention basins are planned for the site. The basins will be located to the northwest, northeast, east and southwest of the proposed structure. The basins will have depths ranging from 10 feet to 15 feet.



Final grades for the site are planned to range from 946 feet to 1012 feet. Cuts and fills on the order of 15 feet and 40 feet, respectively, are planned for the site. In addition, several reinforced modular block retaining walls are planned to provide grade separation.

We understand that NW Main Street will be realigned around the east side of the new structure. NW Main Street is classified as an *Industrial Commercial Collector* and will continue to be classified as such after reconstruction.

Figure 2 shows the proposed site layout, along with the proposed grades, detention basins and the new alignment of NW Main Street.

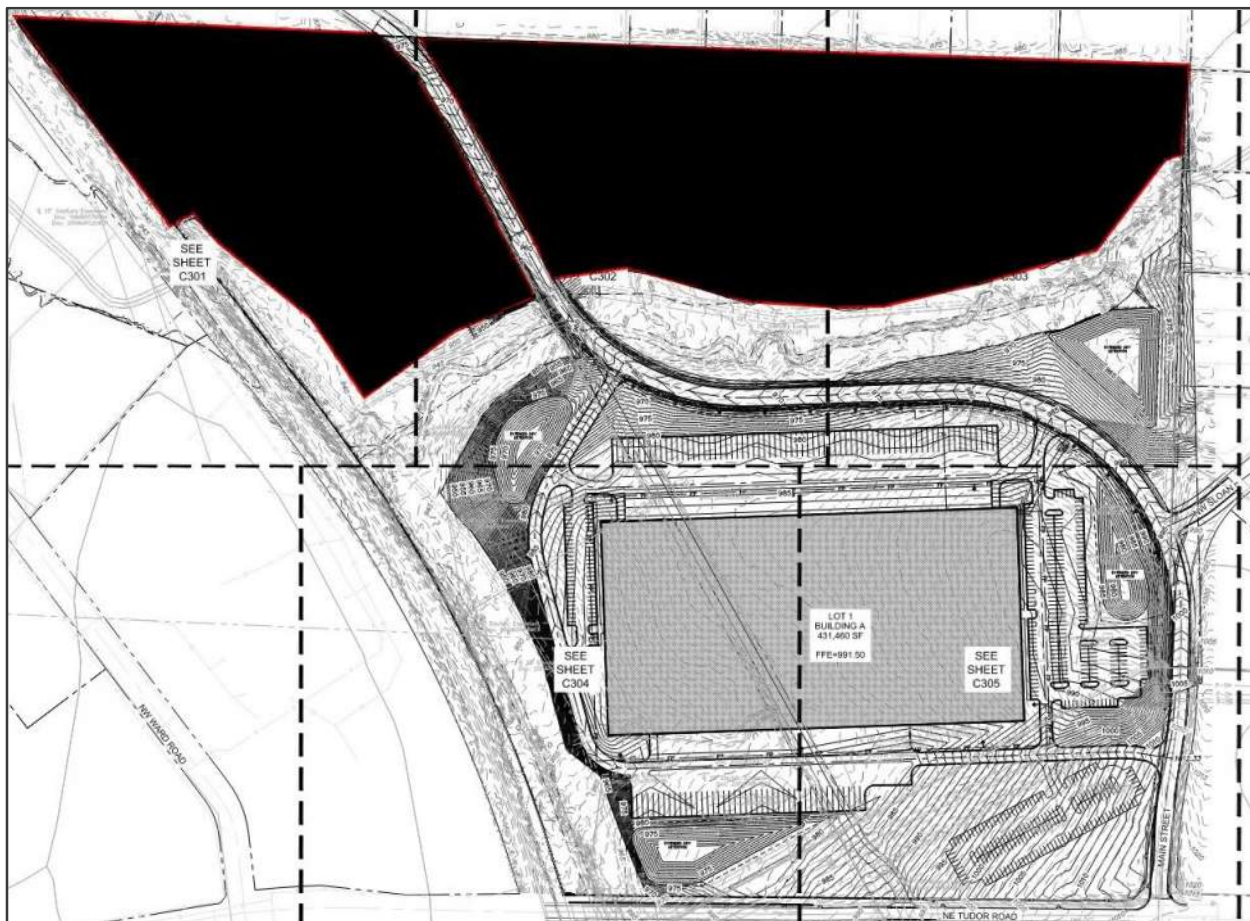


Figure 2. Proposed Site Layout

## 2. FIELD EXPLORATION AND LABORATORY TESTING

### 2.1 Field Exploration

The drill crew used an All-terrain vehicle mounted CME-550 drill rig, equipped with continuous flight augers to advance the 25 borings at the site. We drilled 21 borings within the Building A footprint, drive/parking areas and detention ponds. Four additional borings were drilled along the proposed new alignment for NW Main Street. The depths of the borings ranged from approximately 1 foot to 28 feet below the existing surface. The boring locations were staked in the field and elevations were determined by an **Olsson** survey crew. Surface elevations of the borings are shown on the appended Borehole Reports. These elevations have been rounded to nearest tenth of a foot.

We obtained soil samples with thin-walled sampling tubes hydraulically pushed into the soil and split-barreled sampling tubes during the performance of the Standard Penetration Test (SPT). Sampling depths and SPT blow counts (N-values) are shown on the appended Borehole Reports in Appendix B. Water level observations were made in the borings at the times and conditions noted on the Borehole Reports.

The drill crew prepared a field log for each boring. These field logs include visual classifications of the materials encountered during the drilling process as well as the drillers' interpretation of the subsurface conditions between the samples. The appended Borehole Reports represent the engineer's interpretation of the field logs and includes modifications based on the laboratory observations and test results.

### 2.2 Laboratory Testing

At our laboratory, we classified the soil samples in general accordance with the Unified Soil Classification System (USCS). We measured the moisture content of each sample. Dry density and unconfined compressive strength tests were performed on selected tube samples. We measured the Atterberg Limits of four selected samples. A one-dimensional consolidation test was performed on a sample within the proposed building pad. Results of the laboratory tests are shown on the appended Borehole Reports and in Appendix C.



## 3. SUBSURFACE CONDITIONS

### 3.1 Area Geology

According to the United States Department of Agriculture, the project site lies within the Sharpsburg silt loam, Sharpsburg-Urban land and, the Snead-Rock outcrop complexes in Jackson County, Missouri. The primary soil type consists of silty clay loam derived from windblown sediment (loess), over residuum from shale and limestone bedrock. According to the Missouri Department of Natural Resources, the site's bedrock profile belongs to the Linn Subgroup of the Kansas City Group. The late Pennsylvanian-Missouri aged bedrock consists of alternating layers of limestone and shale with the occasional sandstone seam. Figure 3 presents a generalized section of the bedrock at the site.

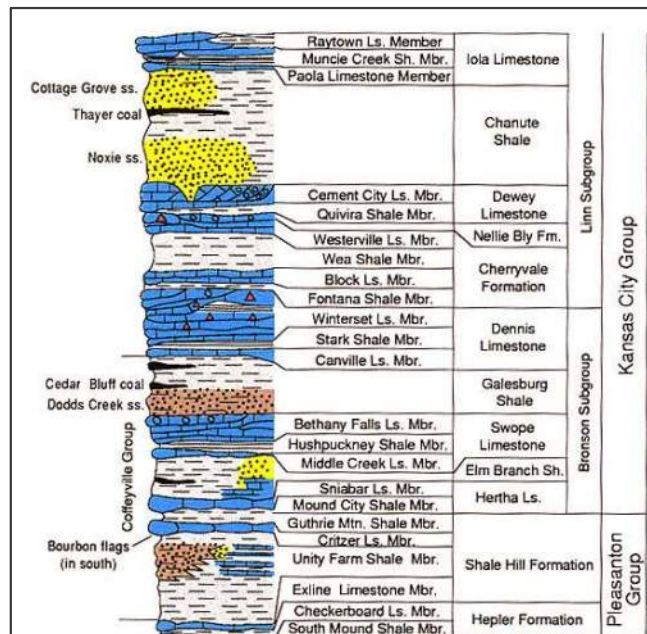


Figure 3. Generalized Linn Subgroup Bedrock Formation

### 3.2 Subsurface Stratification

The subsurface conditions shown on the borehole reports represent conditions at the specific boring locations at the times they were drilled. Variations may occur between and beyond the borings. The stratification lines shown on the appended Borehole Reports represent the approximate locations of changes in soil and bedrock types. The actual transitions between materials is usually gradual. Based on the borings and laboratory test results, the subsurface conditions at this project site can be generalized as follows.

Below the rootzone layer, we encountered native lean-to-fat clay soils extending to depths of around 1 foot to 11 feet below the existing surface. The native clay soils were generally firm to

very stiff, dark brown transitioning to brown to reddish brown and gray with increasing depth, moist and contained variable amounts of silt. As the clay soils increased in depth, they became shaley and contained weathered limestone seams. Borings B-18A through B-21A, B-3R and B-4R terminated in the native clays at a depth of 5 feet. Borings B-10A, B-15A and B-1R terminated in the native clays at a depth of 10 feet.

In the remaining borings, we encountered shale and limestone bedrock beneath the clay soils. The borings indicate that the bedrock encountered on the east side of NW Main Street generally consisted of shale over limestone. The shallower portions of the shale were clayey and brown. The shale transitioned to a gray more competent bedrock with depth. Borings B-4A, B-7A and B-12A terminated in the shale at 10 feet, 8.8 feet and 19 feet below the existing surface, respectively. Limestone was encountered below the shale in borings B-2A, B-5A, B-6A, B-11A, B-13A and B-14A, at depths ranging from 8.3 feet (B-2A) and 27.5 feet (B-5A), 27.5 feet. Practical auger refusal on the limestone bedrock was encountered at borings and depths listed in Table 1 below.

Boring ID	Limestone Refusal Depth
B-1A	3.3 feet
B-2A	8.5 feet
B-2R	2.3 feet
B-3A	10 feet
B-5A	28 feet
B-6A	18.6 feet
B-9A	5.4 feet
B-11A	7.2 feet
B-13A	23.1 feet
B-14A	11.2 feet
B-16A	6.5 feet
B-17A	1 foot

**Table 1. Auger Refusal on Limestone**

### 3.3 Water Level Observations

Each boring was monitored for groundwater during and immediately after the completion of drilling operations. Groundwater was encountered during drilling operations at borings B-5A and B-13A at 23.5 feet and 9 feet, respectively. The presence and lack of groundwater should not be construed to represent a permanent or stable condition. Variations and uncertainties exist with relatively short-term water level observations in boreholes. Water levels can and should be anticipated to vary between boring locations, as well as time within specific borings. Water typically collects near the interface between different materials, such as soil and bedrock. Groundwater levels can fluctuate with variations in precipitation, site grading, drainage, and adjacent land use. Long term monitoring with piezometers generally provides a more representative reflection of the potential range of groundwater conditions.

## 4. GEOTECHNICAL CONSIDERATIONS

Our previous experience with former agricultural sites, has shown that is common practice to push miscellaneous debris/trash directly into old excavations or washouts around the farm or into drainage areas to help control erosion. Fill materials were not encountered during our subsurface exploration, but the earthwork contractor should be aware that these materials may be encountered during grading operations. We recommend that a representative of **Olsson** be on-site to monitor the earthwork and excavation operations and to document the presence of suspicious fill, buried debris, or otherwise unsuitable material that may be encountered across the project site. If encountered, these unsuitable materials should be removed and replaced with structural fill.

Laboratory test data indicate that the on-site clay soils exhibit a moist to very moist moisture profile in the near surface clay soils. Depending on the time of year that construction begins, the subgrade soils may likely require significant moisture conditioning in order to provide a stable subgrade. Drying can be accomplished by discing a minimum of 9 inches of material, allowing the material to air-dry, and recompacting the material to the specifications provided in this report. Supplemental drying techniques, including the use of Class "C" fly ash may be required to adequately dry the soil.

We encountered shale and limestone bedrock at the site. We anticipate rock removal techniques will be required towards the east of the site and may be required in other areas. In relatively tight excavations and below auger refusal depths, bedrock may be difficult to excavate and may require the use of pneumatic breakers or other hard rock removal techniques. We recommend that a contingency fund be made available in the event that hard rock removal techniques are required.

Based on the provided grading plan, up to 40 feet of fill is planned within the building pad, with most of the fill planned in the western  $\frac{3}{4}$  of the building pad. In our experience, the weight of the new fill will cause the underlying clay soils and the newly placed fill to consolidate and settle. Our analysis indicates that a significant amount of settlement could occur. While we anticipate most of this settlement will occur during placement of the controlled fill, construction of settlement sensitive elements, such as utility lines and floor slabs for the new structure and pavements outside of the new structure should be delayed until the settlement is substantially complete. We anticipate delays of up to 90 days following completion of fill placement in the deepest sections, but settlement monitoring plates should be used to determine when settlement is complete. To help limit the settlement, fill placed 10 feet or more below the structure should be compacted to 98 percent of the material's standard Proctor maximum dry density (ASTM D-698).

## 5. SITE PREPARATION

### 5.1 General Site Preparation

Site preparation should commence with stripping of any organic, loose, soft, frozen or otherwise unsuitable materials from the entire construction area. These materials should be carefully separated to avoid incorporation of organic materials into new fill sections in the building or pavement areas. Site clearing, grubbing and stripping operations should be performed during dry weather conditions. Operation of heavy equipment on the site during wet conditions could result in excessive rutting and mixing of construction debris with the underlying soils. Any required tree removal should be accomplished at this time as well. Care should be taken to thoroughly remove all root systems, as a zone of desiccated soils may exist in the vicinity of the trees. Materials that are disturbed during tree removal as well as the zone of desiccated soils should be moisture conditioned, undercut and replaced with structural fill outlined in Table 2 of this report.

Areas of NW Main Street planned to be realigned should also be removed during site clearing and stripping operations. All associated asphaltic concrete surface and base materials, potential baserock or cohesive fill should be removed. Any unsuitable material located below the pavement and bases should also be removed at this time.

Upon completion of stripping and removal operations, but prior to any new fill being placed on site, we recommend that the exposed ground surface be proofrolled with a loaded tandem axle dump truck weighing at least 20 tons, or similar equipment. Proofrolling operations should be observed by an **Olsson** representative. Unstable or unsuitable soils revealed by proofrolling should be removed and replaced with structural fill.

Once proofrolling is complete, the upper 9 inches of exposed subgrade should be scarified, moisture conditioned, and recompacted to a minimum of 95 percent of the material's Standard Proctor maximum dry density (ASTM D-698) at moisture content between optimum and 4 percent above optimum. Once the subgrade has been compacted, the excavated areas should be filled in accordance with recommendations presented in this report.

### 5.2 Structural Fill

All structural fill and backfill should consist of approved materials, free of organic matter (organic content less than 5 percent), and debris. Also, the soils should not contain particle sizes larger than three inches. Imported fill soils should generally exhibit a liquid limit less than 60 and a plasticity index less than 30. Samples of all proposed fill materials should be submitted to **Olsson** for compaction and classification tests. Laboratory Proctor compaction and classification tests should be performed on any fill material placed during mass grading

operations. The native on-site soils appear to be suitable for use as structural fill but would not be acceptable for use as Low Volume Change fill placed directly below the slabs.

We recommend that all structural fill and backfill be compacted in accordance with the criteria provided in Table 2. An **Olsson** representative should observe fill placement operations and perform field density tests, as required.

Area of Fill Placement	Material	ASTM D-698 Compaction Recommendation	Moisture Content (Percent of Optimum)
<b>Granular Leveling Course –</b> 6" beneath floor slabs	ASTM C-33 No.57 Aggregate	65% of Relative Density	As necessary to obtain density
<b>Low Volume Change (LVC) –</b> 18" below base of granular leveling course	LL < 50 PI < 25	95%	-1 to +3 percent
	MoDOT Type 5 Baserock*		As necessary to obtain density
<b>Structural Fill -</b> On-site	Recompacted On-site Soils	95%	0 to +4 percent
<b>Structural Fill -</b> Imported	LL < 60 PI < 30	95%	0 to +4 percent
<b>Structural Fill -</b> On-site or Imported placed at depths greater than 10 feet below grade	Recompacted On-site Soils LL < 60 PI < 30	98%	-1 to +3 percent
<b>Pavement Subgrade –</b> Cohesive Soils	Recompacted On-site Soils	95%	0 to +4 percent
<b>Pavement Subgrade -</b> Aggregate Base	MoDOT Type 5 Baserock*	95%	As necessary to obtain density
<b>Pavement Subgrade –</b> Chemically Stabilized Cohesive Soils	Fly Ash (15%)/ Lime (5%)/ Cement (5%)**	95%	-1 to +3 percent

\*Or equivalent

\*\*Percentages based on dry unit weights

**Table 2. Fill Placement Guidelines**

Suitable fill materials should be placed in thin loose lifts of 8 inches or less. Within small excavations, such as in utility trenches, around manholes, or behind retaining walls, the use of vibrating plat compactors, jumping jack compactors or walk behind sheepsfoot compactors may be used to facilitate compaction in these areas. Loose lifts thicknesses of 4 inches or less are recommended where small compaction equipment is used.

The moisture content for suitable borrow soils at the time of compaction should generally be maintained between the ranges specified above. More stringent moisture limits may be necessary with certain soils and some adjustments to moistures contents may be necessary to achieve compaction in accordance with project specifications.

### 5.3 Drainage and Groundwater Considerations

The area surrounding the site should be sloped to promote surface drainage away from the foundation. Water should not be allowed to collect at the ground surfaces near foundations, floor slabs, or areas of new pavement, either during or after construction. Provisions should be made to quickly remove accumulating seepage water or storm water runoff from excavations.

Undercut or excavated areas should be sloped toward one corner to allow rainwater or surface runoff to be quickly collected and gravity drained or pumped from construction areas. Subgrade soils that are exposed to precipitation or runoff should be evaluated by **Olsson** prior to the placement of new fill, reinforcing steel, or concrete, to determine if corrective action is required.

To minimize concerns related to improper or inadequate drainage away from foundation bearing subgrades or from cohesive backfill materials used in utility or foundation trenches, we recommend the following:

- Site grading should provide for efficient drainage of rainfall or surface runoff away from new structures and pavement.
- Roof run-off should be collected and transferred directly to the storm sewer system or directed to a location with positive and rapid drainage away from new structures and pavements.
- External hose connections in unpaved areas should incorporate splash blocks to prevent accidental flooding of foundation bearing or backfill soils. External hose connections should have cut-off valves inside the building to prevent accidental or unauthorized use.
- Maintenance personnel should be informed of the potential problems associated with watering near the building.

### 5.4 Deep Fills

As previously discussed in the *Geotechnical Considerations* section of this report, the provided grading plan indicates that up to 40 feet of fill is planned at the site. In areas where new fill placement exceeds 10 feet, settlement of the existing soils and newly placed fill will occur. For fill depths ranging from 10 to 40 feet, delay periods ranging from 30 days to 90 days should be anticipated. Settlement monitoring plates should be used to determine when settlement is complete. To help limit the settlement, fill placed 10 feet or more below the structure should be compacted to 98 percent of the material's standard Proctor maximum dry density (ASTM D-698).



## 6. STRUCTURES

### 6.1 Shallow Foundations

Based on the subsurface conditions observed at the borings, the results from the laboratory tests, and the provided grading plan, we anticipate that the foundations for the new warehouse will bear on a combination of properly compacted cohesive fill and stiff native clay soils. For shallow foundations supported on properly compacted cohesive fill soils and stiff native clay soils, a maximum net allowable soil bearing pressure of 2,500 pounds per square foot (psf) can be used for design. The net allowable soil bearing pressure refers to the bearing pressure at foundation level in excess of surrounding overburden pressure.

For frost protection, all exterior footings should bear at a minimum depth of 3 feet below the finalized adjacent grade. Footings should have a minimum foundation width of 18 inches for continuous footings and 30 inches for isolated column footings. Earth formed trench footings should have a minimum width of 12 inches.

Lightly loaded interior partition walls (applying less than 0.75 kips per lineal foot (klf)) may be supported directly on the slab-on-grade floor. Depending on the floor slab design and the specific wall loads, it may be necessary to increase the floor slab reinforcement or provide a thickened slab cross-section below interior walls. For interior walls with loads greater than 0.75 klf, we recommend a footing be installed, independent of the floor slab, to properly distribute the wall loads to the underlying soils and reduce the potential for floor slab damage.

After foundation subgrades have been observed and evaluated by an **Olsson** representative, concrete should be placed as soon as possible to avoid subjecting the exposed soil to drying, wetting, or freezing conditions. If the foundation subgrade soils are subjected to such conditions, **Olsson** should be contacted to reevaluate the foundation bearing materials.

For foundations constructed based on the recommendations provided above, post-construction settlements on the order of 1 inch total and ½ inch differential settlement between similarly loaded adjacent foundation elements can be expected. This settlement prediction is predicated on the completion of consolidation settlement of the clay soils in the deep fill areas.

### 6.2 Floor Slab Subgrade Preparation

For the purposes of this report and based on our experience with similar projects, a uniform load distribution of 500 psf for the floor slab was assumed. If the floor loading is significantly different, **Olsson** should be contacted to reevaluate the applicability of the recommendations contained herein.

Based on the provided grading plan, we understand that the floor slabs will bear on on-site and/or imported cohesive soils. Based on results from the borings and laboratory tests, and our

experience, these cohesive soils have a moderate risk to shrink and swell with varying moisture contents. In order to mitigate this risk, we recommend a 22-inch thick Low Volume Change (LVC) Zone be installed below each floor slab.

The upper 6 inches of the LVC zone should consist of a well graded, free draining granular (i.e. ASTM C-33 No. 57 aggregate) leveling course. The granular leveling course should be placed directly below the floor slabs. If moisture vapor transmission through the concrete slab is a concern (e.g. if moisture sensitive floor coverings are to be used) a vapor barrier should be used. Underlying the leveling course, 18 inches of additional LVC material should be placed. Acceptable LVC materials consist of cohesive soils exhibiting a liquid limit less than 50 and a plasticity index less than 25, or a well graded granular material having at least 15 percent fines passing through the No. 200 sieve, such as MoDOT Type 5 baserock. The LVC zone materials should be compacted and moisture conditioned to the levels outlined in Table 2 of this report.

Upon completion of grading operations in the building area, care should be taken to maintain the recommended subgrade moisture content and density prior to construction of the floor slab. If the subgrade should become saturated, desiccated, frozen, disturbed, or altered by construction activity, the subgrade should be restored to the conditions recommended in Table 2 of this report.

The procedures recommended above may not eliminate all future subgrade volume change and resultant floor slab movement. However, the procedures outlined should significantly reduce the potential for future subgrade volume change. Common construction practice is to tie the slab-on-grade into the foundation elements to limit the impact of differential movement at doorways and windows. Depending on the location of construction joints in the slab, the rigidity of the slab and foundation connection, and the magnitude of actual movement that occurs, some minor cracking within the floor slab could occur and should be expected.

## 6.3 Lateral Earth Pressures

The following soil parameters are provided for use in designing below grade cast-in-place concrete retaining walls, such as loading dock walls, subject to lateral earth pressures. The parameters are based on the understanding that the retained soils used during construction will be similar in composition to the on-site soils encountered during this exploration. To ensure similarity, we recommend confirmation testing be performed during construction by **Olsson**.

The "at-rest" condition assumes no wall rotation and would be applicable for loading dock walls. Walls that are unrestrained at the top and are free to rotate slightly, such as Cast-in-Place concrete cantilever walls, may be designed for "active" earth pressure conditions. The "passive" earth pressure condition should be used to evaluate the resistance of soil to lateral loads.

Table 3 presents recommended values of earth pressure coefficients based on our experience

with soils in the area. Equivalent fluid densities are frequently used for the calculation of lateral earth pressures for the “at-rest” and “active” conditions and are therefore provided in Table 3.

Legend of Symbols		
Z	Wall Height (ft)	
H	Depth Below Surface (ft)	
D	Wall Displacement (ft)	
S	Surcharge Load (psf)	
P <sub>1</sub>	Surcharge Pressure (psf)	
P <sub>2</sub>	Earth Load (psf)	
K	Earth Pressure Coefficient	
G	Equivalent Fluid Density (pcf)	
Pressure Calculations		
Surcharge Pressure	$P_1 \text{ (psf)} = K * S$	
Earth Load	$P_2 \text{ (psf)} = G \text{ (pcf)} * H \text{ (ft)}$	

FINISH GRADE

S

FOR AT REST PRESSURE  
d=0  
FOR ACTIVE PRESSURES  
d=(0.002Z TO 0.004Z)

H (ft)

P<sub>2</sub>

P<sub>1</sub>

Z

FINISH GRADE

			Equivalent Fluid Density (G)	
			Drained, pcf	Undrained, pcf
Active (K <sub>a</sub> )	Cohesive	0.41	50	85
	Granular*	0.31	35	-
At-Rest (K <sub>o</sub> )	Cohesive	0.58	70	95
	Granular*	0.47	55	-
Passive (K <sub>p</sub> )	Cohesive	2.46	295	205
	Granular*	3.25	390	-

\*Granular backfill should be permanently drained

**Table 3. Lateral Earth Pressure**

The following assumptions were made:

- For active earth pressure, the wall must rotate about its' base, with top lateral movements of  $0.002*Z$  to  $0.004*Z$ , where “Z” is the wall height.
- The equivalent fluid densities in Table 3 do not include the effects of surcharge loading.
- The equivalent fluid densities in Table assume a level backslope. If a backslope is included, **Olsson** should be contacted to update the earth pressure coefficient and associated equivalent fluid density.
- The wall must move horizontally to mobilize passive resistance.
- Surcharges are uniform, where “S” is surcharge pressure, in psf.
- In-situ backfill has a maximum weight of 120 pcf.
- Horizontal backfill is compacted to 95% of standard Proctor maximum dry density.
- Heavy equipment and other concentrated load components are not included.
- No hydrostatic pressure acting on wall. Assumes a drained condition.
- No safety factor is included.
- Passive pressure in the frost zone or moisture fluctuation zone should be ignored.

Backfill placed against structures should consist of granular soils or low plasticity cohesive soils. For the granular values to be valid, the granular backfill must extend out from the base of the wall at an angle of at least 45 and 60 degrees from vertical for the active and passive cases, respectively. To calculate the resistance to sliding, an ultimate coefficient of friction value of 0.30 should be used where the footing bears on soil and shale bedrock and 0.65 where the footing bears on limestone bedrock.

To intercept infiltrating surface water behind the wall, we recommend a perimeter drain be installed at the foundation level and/or weep holes be placed at regular intervals along the wall. The drain line invert should be below the finished subgrade elevation for the interior floor. The drain line should be sloped to provide positive gravity drainage and should be surrounded by free-draining granular material graded to prevent the intrusion of fines, or an alternative free-draining granular material encapsulated with suitable filter fabric. A minimum 1-foot-wide section of free-draining granular fill should be used for backfilling above the drain line and adjacent to the wall and should extend to within 2 feet of final grade. The granular backfill should be capped with compacted cohesive fill to minimize infiltration of surface water into the drain system.

## 6.4 Modular Block Retaining Walls

We understand that Mechanically Stabilized Earth (MSE) Walls or large gravity modular blocks may be used to provide grade separation at this site. Our experience and that of our profession indicates that the risks of costly design, construction, and maintenance problems can be significantly lowered by retaining the geotechnical engineer of record to provide additional services during design and construction. Therefore, we recommend **Olsson** be contracted to design and observe the construction of these walls once details are made available.

Regardless of the design firm, we recommend the following general and specific considerations be included in the project specifications for the wall design: Walls should be designed to provide adequate structural and functional performance for a service life of at least 75 years. Internal stability analyses should conform to the latest design methodology accepted for use by the Federal Highway Administration (FHWA), AASHTO or the National Concrete Masonry Association (NCMA). The analysis should be based on the use of drained strength parameters, requiring the backfill used in the geogrid reinforced backfill section to be a drainable, granular material. Cohesive soil or granular material containing high amounts of fines (typically greater than 15 percent) are not considered drainable and should not be allowed in the geogrid reinforced backfill zone. The designer should state the backfill material description and design strength parameters in the construction specifications so that unsuitable materials are not allowed in the backfill zone during construction.

Global stability of the wall system should be analyzed using both drained and undrained strength parameters. The wall contractor/designer should be required to provide the global

stability analyses based on the planned final cross section, including the topography above and below the wall, using the generalized subsurface stratigraphy discussed in this report.

## **6.5 Site Seismic Classification**

For this project site, the soil conditions encountered are consistent with the definition of Site Class “C” (Very Dense Soil and Soft Rock profile) as defined in ASCE 07-16.

## 7. PAVEMENTS

### 7.1 Warehouse Pavement Subgrade Preparation

We understand that personal vehicle parking and drive paths are planned at the east and west perimeter of the proposed structure. Loading dock parking and drive areas are planned to the north and south of the warehouse. Entrance drives from the public streets are planned to be located northwest, northeast and southeast of the warehouse.

The new pavements for the warehouse structure should be supported on 8 to 12 inches (See Table 4) of properly placed and compacted well-graded granular material such as MoDOT Type 5 baserock (or equivalent) over 9 inches of recompacted on-site cohesive soil. The on-site cohesive soil should be compacted to 95 percent of the material's Standard Proctor maximum dry density (ASTM D-698) and moisture conditioned between optimum and 4 percent above optimum.

### 7.2 NW Main Street Subgrade Preparation

We understand that NW Main Street will be classified as a Commercial Industrial Collector by the City of Lee's Summit, Missouri. According to Lee's Summit specifications, the minimum subgrade for a Commercial Industrial Collector should consist of either 9 inches of chemically stabilized cohesive soils or, on-site cohesive soils with a Geogrid/Geotextile placed atop. We anticipate that 15 percent Class "C" fly ash, 5 percent lime or soil cement (percentages based on dry unit weights) would be sufficient for the site. The chemically stabilized subgrade should be compacted 95 percent of the material's Standard Proctor maximum dry density and moisture conditioned between 1 percent below optimum and 3 percent above optimum. Overlaying the chemically stabilized subgrade soils or the Geogrid/Geotextile, baserock material should be properly placed and compacted. The thickness of baserock varies depending on the application and pavement type used. The sections are shown in Table 5.

### 7.3 General Subgrade Preparation

We recommend that the prepared subgrade extend a minimum of 2-feet outside the pavements, where feasible. **Olsson** should be present during subgrade preparation to observe, document, and test compaction of the materials at the time of placement. As recommended for all prepared soil subgrades, heavy, repetitive construction traffic should be controlled, especially during periods of wet weather, to minimize disturbance. The final prepared subgrade should be proof rolled with a loaded dump truck or similar rubber-tired equipment with a total weight of at least 20-tons, immediately prior to placement of new pavements. Proofrolling operations should be observed and documented by **Olsson**. Unstable or unsuitable soils revealed by proofrolling should be reworked to provide a stable subgrade or removed and replaced with structural fill.



Construction scheduling often involves grading and paving by separate contractors and can involve a time lapse between the end of grading operations and the commencement of paving operations. Disturbance, desiccation, or wetting of the subgrade soils between grading and paving operations can result in the deterioration of the previously completed subgrade. If soft and/or wet areas are identified during subgrade preparation or if the subgrade soils have been exposed to adverse weather conditions, frost, excessive construction traffic, standing water, or similar conditions, **Olsson** should be consulted to determine if corrective action is necessary.

It is important that the pavement subgrade support be relatively uniform, with no abrupt changes in the degree of support. Non-uniform pavement support can occur as a result of varying soil moisture contents or soil types, or where improperly placed utility backfill has been placed across or through areas to be paved. Improper subgrade preparation such as inadequate vegetation removal, failure to identify soft or unstable areas by proofrolling, and inadequate or improper compaction can also produce non-uniform subgrade support.

## 7.4 Pavement Section Thicknesses

Table 4 summarizes typical pavement section for the Warehouse Pavements. The sections represent typical minimum thicknesses. Routine maintenance of the pavement will be required, consisting of periodic seal coats and possible one intermediate mill, in addition to regular crack maintenance.

	AC w/ Granular Base*	Full Depth PCC
<b>Personal Vehicle Traffic</b>	2" AC Surface 4" AC Base 8" Compacted MoDOT Type 5 Baserock**	6" PCC 4" Clean Rock Base
<b>60 Trucks per Day</b>	2" AC Surface 5" AC Base 12" Compacted MoDOT Type 5 Baserock**	8" PCC 4" Clean Rock Base
<b>300 Trucks per Day</b>	2" AC Surface 7" AC Base 12" Compacted MoDOT Type 5 Baserock**	9" PCC 4" Clean Rock Base

\*Supported on 9" of recompacted on-site soils

\*\*Or equivalent

**Table 4. Warehouse Pavement Section Thicknesses**

As previously mentioned, the proposed public road will be classified as a *Commercial Industrial Collector* by the City of Lee's Summit, Missouri. Table 4 summarizes the required pavement

section thicknesses for AC and PCC pavements. Routine maintenance of the pavement will be required, consisting of periodic seal coats and possible one intermediate mill, in addition to regular crack maintenance.

AC Option A	AC Option B	PCC Option
2" AC Surface + 7.5" AC Base + 6" Compacted MoDOT Type 5 Baserock** + 9" Chemically Stabilized Cohesive Soil*	2" AC Surface + 7.5" AC Base + 12" Compacted MoDOT Type 5 Baserock** + Approved Geogrid Material	8" PCC + 4" Clean Rock Base + 9" Chemically Stabilized Cohesive Soil*

\*Cohesive chemically stabilized with 15% Fly Ash, 5% lime or cement

\*\*Or equivalent

**Table 5. Lee's Summit, Missouri Commercial Industrial Collector Pavement Section**

PCC pavements are recommended for trash receptacle pads, loading dock areas and where heavy wheel loads will be concentrated within Building A. Concrete pavements in these areas should have a minimum thickness as defined in Table 4. For NW Main Street, concrete pavements should have a minimum thickness as defined in Table 5. It is also recommended that a 4-inch leveling, and drainage course of clean, crushed rock be placed below all PCC pavements. The clean rock base for PCC pavements should be uniform and pavement subgrade should be graded to provide positive drainage of the granular base section. The granular section should be graded to adjacent storm sewer inlets and provisions should be made to provide drainage from the granular section into the storm sewers. Drainage of the granular base is particular important where two different sections of pavements (such as AC and PCC) abut, so that water does not pond beneath the pavements and saturate the subgrade soils. We further recommend that the length of concrete sections be such that no heavy truck wheels are allowed to rest on asphaltic concrete sections during loading/unloading operations.

The performance of the pavements will be dependent upon a number of factors, including subgrade conditions at the time of paving, rainwater runoff, and traffic. Rainwater runoff should not be allowed to seep below pavements from adjacent areas. Pavements should be sloped approximately ¼ inch per foot to provide for rapid surface drainage.

Proper drainage below the pavement section helps prevent softening of the subgrade and has a significant impact on pavement performance and pavement life. Therefore, we recommend that a granular blanket drain be constructed at all storm sewer inlets within the pavement areas. The blanket drain should consist of clean, crushed rock extending a minimum of 6 inches below pavement subgrade level. The blanket drains should extend radially a minimum of 8 feet from each of the storm sewer inlets. The grade within the blanket drain should be sloped toward the

storm sewer inlet, and weep holes should be drilled through the inlet to provide drainage of the granular section into the inlet. Placement of a geotextile filter fabric across the weepholes could be considered to prevent loss of aggregate through the weep holes.

Construction traffic on the pavements has not been considered in the above noted typical sections. If construction scheduling dictates that the pavements will be subjected to traffic by construction equipment, increasing the pavement thickness should be considered to include the effects of additional traffic loading. Construction traffic should not be allowed on partially completed pavements as the pavements will not have adequate structural capacity and could be damaged.

## 8. CONCLUSIONS AND LIMITATIONS

### 8.1 Construction Observation and Testing

We recommend that all earthwork during construction be monitored by a representative of **Olsson**, including site preparation, placement of all structural fill and trench backfill, and pavement subgrades. The purpose of these services would be to provide **Olsson** the opportunity to observe the soil conditions encountered during construction, evaluate the applicability of the recommendations presented in this report to the soil conditions encountered, and recommend appropriate changes in design or construction procedures if conditions differ from those described herein.

### 8.2 Limitations

The conclusions and recommendations presented in this report are based on the information available regarding the proposed construction, the results obtained from our borings, laboratory testing program, and our experience with similar projects. The borings represent a very small statistical sampling of subsurface soils and it is possible that conditions may be encountered during construction that are substantially different from those indicated by the borings. In these instances, adjustments to design and construction may be necessary.


This geotechnical report is based on the site plan and our understanding of the project's information as provided to **Olsson**. Changes in the location or design of new structures could significantly affect the conclusions and recommendations presented in this geotechnical report. **Olsson** should be contacted in the event of such changes to determine if the recommendations of this report remain appropriate for the revised site design.

This report was prepared under the direction and supervision of a Professional Engineer registered in the State of Missouri with the firm of **Olsson, Inc.** The conclusions and recommendations contained herein are based on generally accepted, professional, geotechnical engineering practices at the time of this report, within this geographic area. No warranty, express or implied, is intended or made. This report has been prepared for the exclusive use of **Scannell Properties** and their authorized representatives for the specific application to the proposed project described herein.

## **APPENDIX A**

### Boring Location Map



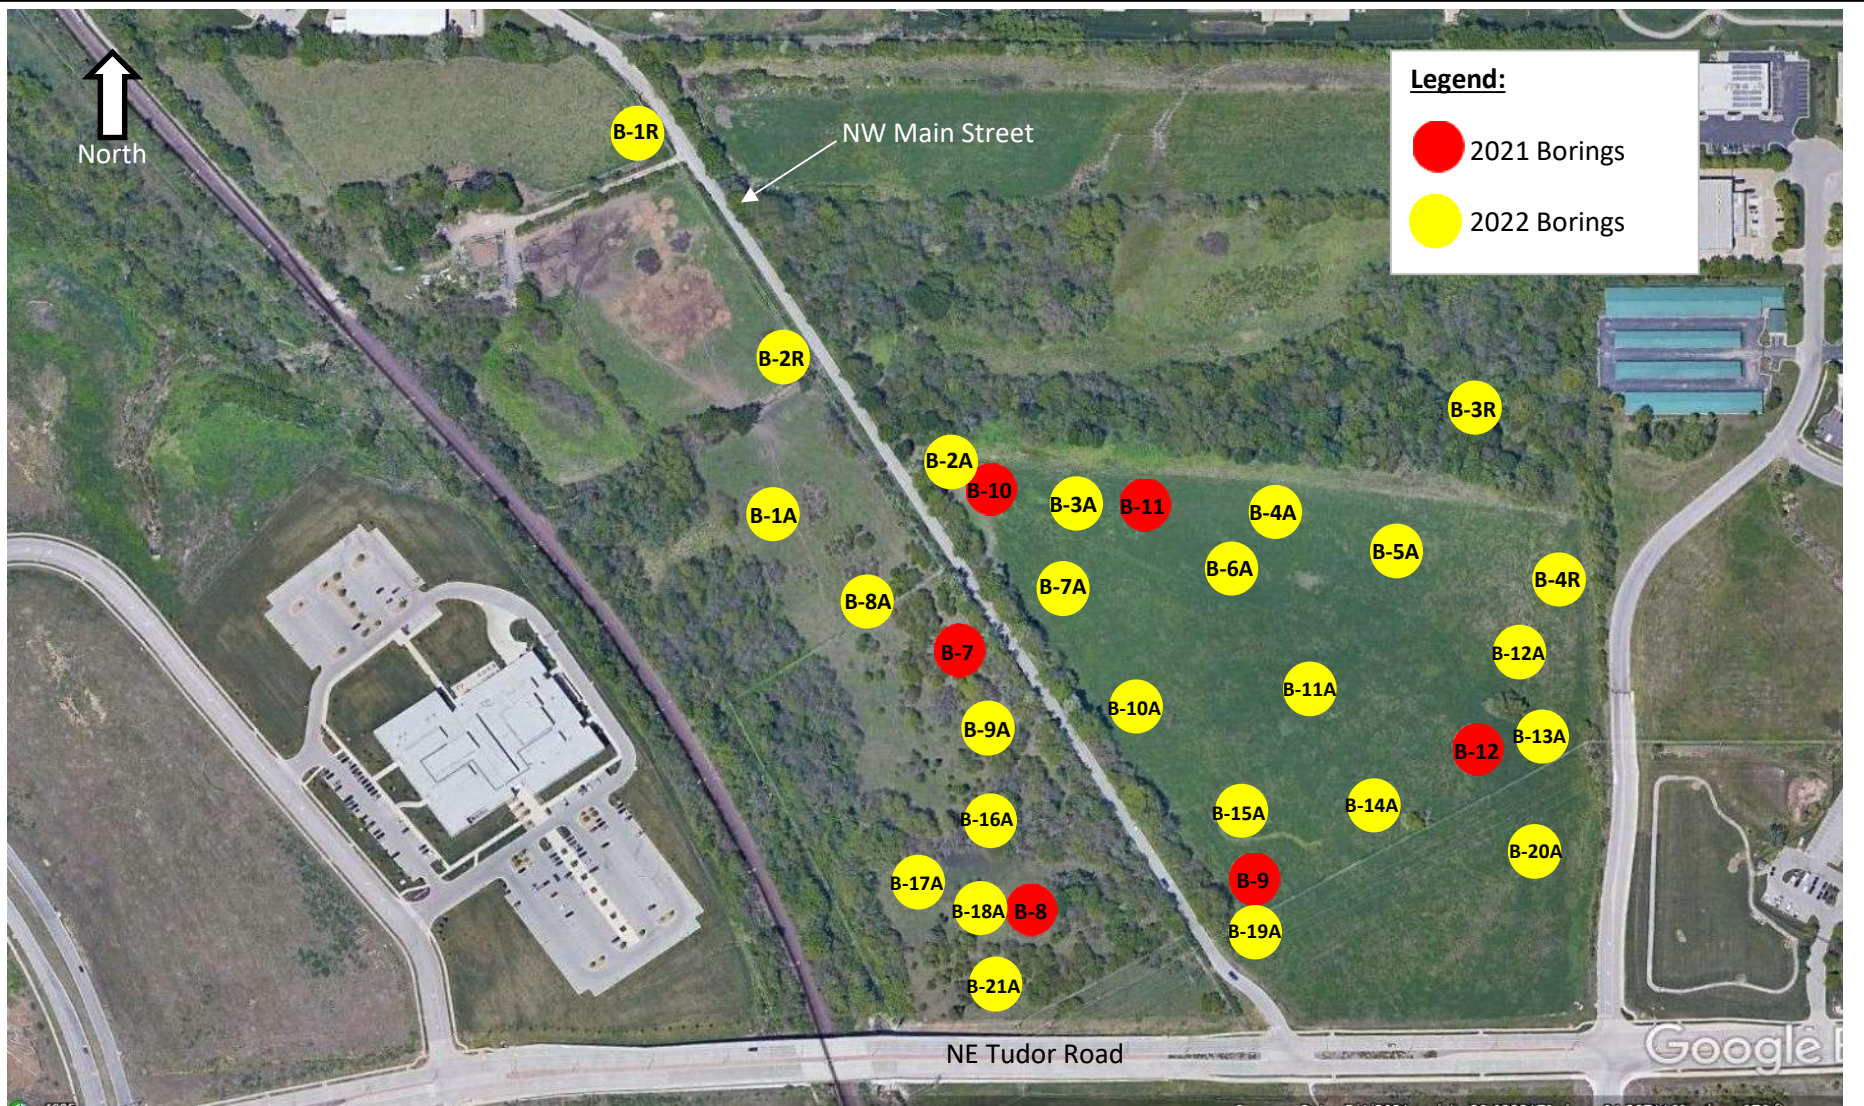

**olsson**

Scale: n.t.s.
Project No. A21-04157
Approved by: JDP
Date: 2/11/2022

Boring Location Plan
<b>Lee's Summit Logistics Building A &amp; Road</b> <b>Lee's Summit, Missouri</b>



## **APPENDIX B**

### Borehole Symbols and Nomenclature

## SYMBOLS AND NOMENCLATURE

### DRILLING NOTES

#### DRILLING AND SAMPLING SYMBOLS

SS: Split-Spoon Sample (1.375" ID, 2.0" OD)	HSA: Hollow Stem Auger	NE: Not Encountered
U: Thin-Walled Tube Sample (3.0" OD)	CFA: Continuous Flight Auger	NP: Not Performed
CS: Continuous Sample	HA: Hand Auger	NA: Not Applicable
BS: Bulk Sample	CPT: Cone Penetration Test	% Rec: Percent of Recovery
MC: Modified California Sampler	WB: Wash Bore	WD: While Drilling
GB: Grab Sample	FT: Fish Tail Bit	IAD: Immediately After Drilling
SPT: Standard Penetration Test Blows per 6.0"	RB: Rock Bit	AD: After Drilling
	PP: Pocket Penetrometer	CI: Cave In

#### DRILLING PROCEDURES

Soil samples designated as "U" samples on the boring logs were obtained in using Thin-Walled Tube Sampling techniques. Soil samples designated as "SS" samples were obtained during Penetration Test using a Split-Spoon Barrel sampler. The standard penetration resistance 'N' value is the number of blows of a 140 pound hammer falling 30 inches to drive the Split-Spoon sampler one foot. Soil samples designated as "MC" were obtained in using Thick-Walled, Ring-Lined, Split-Barrel Drive sampling techniques. Recovered samples were sealed in containers, labeled, and protected for transportation to the laboratory for testing.

#### WATER LEVEL MEASUREMENTS

Water levels indicated on the boring logs are levels measured in the borings at the times indicated. In relatively high permeable materials, the indicated levels may reflect the location of groundwater. In low permeability soils, the accurate determination of groundwater levels is not possible with only short-term observations.

### SOIL PROPERTIES & DESCRIPTIONS


Descriptions of the soils encountered in the soil test borings were prepared using Visual-Manual Procedures for Descriptions and Identification of Soils.

#### PARTICLE SIZE

Boulders	12 in. +	Coarse Sand	4.75mm-2.0mm	Silt	0.075mm-0.005mm
Cobbles	12 in.-3 in.	Medium Sand	2.0mm-0.425mm	Clay	<0.005mm
Gravel	3 in.-4.75mm	Fine Sand	0.425mm-0.075mm		

COHESIVE SOILS		COHESIONLESS SOILS		COMPONENT %	
Consistency	Unconfined Compressive Strength (Qu) (tsf)	Relative Density	'N' Value	Description	Percent (%)
Very Soft	<0.25	Very Loose	0 - 3	Trace	<5
Soft	0.25 - 0.5	Loose	4 - 9	Few	5 - 10
Firm	0.5 - 1.0	Medium Dense	10 - 29	Little	15 - 25
Stiff	1.0 - 2.0	Dense	30 - 49	Some	30 - 45
Very Stiff	2.0 - 4.0	Very Dense	≥ 50	Mostly	50 - 100
Hard	> 4.0				

#### PLASTICITY CHART

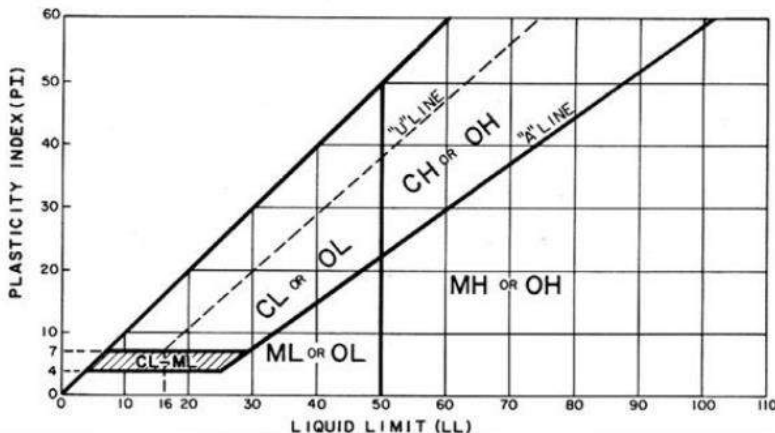

#### ROCK QUALITY DESIGNATION (RQD)





Description	RQD (%)
Very Poor	0 - 25
Poor	25 - 50
Fair	50 - 75
Good	75 - 90
Excellent	90 - 100

olsson






## BOREHOLE REPORT NO. B-1A

Sheet 1 of 1

PROJECT NAME <b>Lee's Summit Logistics</b>			CLIENT <b>Scannell Properties</b>								
PROJECT NUMBER <b>A21-04157</b>			LOCATION <b>Lee's Summit, Missouri</b>								
ELEVATION (ft)	 Shelby Tube	GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
	MATERIAL DESCRIPTION										
	APPROX. SURFACE ELEV. (ft): 959.0										
	0										
	<b>ROOT ZONE</b>	0.5'									
	<b>FAT CLAY</b>			U 1							
	<i>Stiff, brown with reddish brown, sandy, moist</i>								29.0	87.8	P.P. = 2.0
		3.1'									
	<b>LIMESTONE</b>	3.3'									
<b>REFUSAL AT 3.3 FEET</b>											

## WATER LEVEL OBSERVATIONS

WD  Not PerformedIAD  Not PerformedAD  Not Performed

**OLSSON, INC.**  
**1700 E. 123RD STREET**  
**OLATHE, KANSAS 66061**

STARTED: 1/18/22 FINISHED: 1/18/22

DRILL CO.: RC DRILLING DRILL RIG: CME 550X

DRILLER: LUKE LOGGED BY: LUKE

METHOD: CONTINUOUS FLIGHT AUGER



## BOREHOLE REPORT NO. B-1R

Sheet 1 of 1

PROJECT NAME Lee's Summit Logistics				CLIENT Scannell Properties							
PROJECT NUMBER A21-04157				LOCATION Lee's Summit, Missouri							
ELEVATION (ft)	MATERIAL DESCRIPTION	GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
	APPROX. SURFACE ELEV. (ft): 974.5		0								
	ROOT ZONE	0.5'									
	FAT CLAY										
	Stiff, brown with reddish brown and trace dark brown, moist			U 1				27.5	95.1		P.P. = 3.5
		3.0'									
	Stiff, brown with reddish brown, moist			U 2				27.1	95.3		P.P. = 2.0
970			5								
		7.0'									
	Stiff, brown, moist										
965											
				U 3			1.7	28.9	92.1		
		10.0'	10								
BASE OF BORING AT 10.0 FEET											

## WATER LEVEL OBSERVATIONS

WD ☐ Not EncounteredIAD ☐ Not EncounteredAD ☐ Not Encountered

OLSSON, INC.  
1700 E. 123RD STREET  
OLATHE, KANSAS 66061

STARTED: 1/31/22 FINISHED: 1/31/22

DRILL CO.: RC DRILLING DRILL RIG: CME 550X

DRILLER: LUKE LOGGED BY: ARIANNA

METHOD: CONTINUOUS FLIGHT AUGER





## BOREHOLE REPORT NO. B-2R

Sheet 1 of 1

PROJECT NAME <b>Lee's Summit Logistics</b>					CLIENT <b>Scannell Properties</b>						
PROJECT NUMBER <b>A21-04157</b>					LOCATION <b>Lee's Summit, Missouri</b>						
ELEVATION (ft)	MATERIAL DESCRIPTION	GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
	APPROX. SURFACE ELEV. (ft): 949.2		0								
	ROOT ZONE	0.5'									
	LEAN TO FAT CLAY										
	Dark brown										
		2.0'									
	LIMESTONE	2.3'									
	Gray										
	REFUSAL AT 2.3 FEET										

## WATER LEVEL OBSERVATIONS

WD	☒ Not Performed
IAD	☒ Not Performed
AD	☒ Not Performed

**OLSSON, INC.**  
**1700 E. 123RD STREET**  
**OLATHE, KANSAS 66061**

STARTED:	1/31/22	FINISHED:	1/31/22
DRILL CO.:	RC DRILLING	DRILL RIG:	CME 550X
DRILLER:	LUKE	LOGGED BY:	ARIANNA
METHOD: CONTINUOUS FLIGHT AUGER			







## BOREHOLE REPORT NO. B-3R

Sheet 1 of 1

PROJECT NAME					CLIENT									
Lee's Summit Logistics					Scannell Properties									
PROJECT NUMBER					LOCATION									
A21-04157					Lee's Summit, Missouri									
ELEVATION (ft)	MATERIAL DESCRIPTION				GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
975	APPROX. SURFACE ELEV. (ft): 975.0					0								
	ROOT ZONE				0.5'									
	FAT CLAY													
	Very stiff, brown with reddish brown, shaley						U 1				16.2	86.2		P.P. = 4.5+
					3.0'									
	Firm, dark brown, silty, very moist						U 2			0.9	30.5	84.9		
970					5.0'	5								

BASE OF BORING AT 5.0 FEET

## WATER LEVEL OBSERVATIONS

WD	▽ Not Performed
IAD	▽ Not Performed
AD	▽ Not Performed

**OLSSON, INC.**  
**1700 E. 123RD STREET**  
**OLATHE, KANSAS 66061**

STARTED:	1/31/22	FINISHED:	1/31/22
DRILL CO.:	RC DRILLING	DRILL RIG:	CME 550X
DRILLER:	LUKE	LOGGED BY:	ARIANNA
METHOD: CONTINUOUS FLIGHT AUGER			



## BOREHOLE REPORT NO. B-4A

Sheet 1 of 1

PROJECT NAME					CLIENT									
Lee's Summit Logistics					Scannell Properties									
PROJECT NUMBER					LOCATION									
A21-04157					Lee's Summit, Missouri									
ELEVATION (ft)	MATERIAL DESCRIPTION				GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
	APPROX. SURFACE ELEV. (ft): 986.8					0								
	ROOT ZONE				0.5'									
	FAT CLAY													
985	Stiff, dark brown with reddish brown, moist, trace organics				2.0'		U 1				27.5	94.7		P.P. = 3.0
	LEAN CLAY													
	Stiff, dark brown with reddish brown, moist						U 2				21.0	105.7		P.P. = 3.5
						5								
980														
					8.0'									
	Very stiff, brown with reddish brown, shaley						U 3				17.1	111.3		P.P. = 4.5+
					10.0'	10								
BASE OF BORING AT 10.0 FEET														

## WATER LEVEL OBSERVATIONS

WD ☐ Not EncounteredIAD ☐ Not EncounteredAD ☐ Not Encountered

OLSSON, INC.  
1700 E. 123RD STREET  
OLATHE, KANSAS 66061

STARTED: 1/31/22 FINISHED: 1/31/22

DRILL CO.: RC DRILLING DRILL RIG: CME 550X

DRILLER: LUKE LOGGED BY: ARIANNA

METHOD: CONTINUOUS FLIGHT AUGER






## BOREHOLE REPORT NO. B-4R

Sheet 1 of 1

PROJECT NAME					CLIENT									
Lee's Summit Logistics					Scannell Properties									
PROJECT NUMBER					LOCATION									
A21-04157					Lee's Summit, Missouri									
ELEVATION (ft)	<div>Shelby Tube</div>  <div>MATERIAL DESCRIPTION</div>  <div>APPROX. SURFACE ELEV. (ft): 983.8</div>				GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
	0													
	ROOT ZONE				0.5'									
	FAT CLAY													
	Very stiff, dark brown, moist, trace organics													
					2.0'		U 1			2.0	26.5	95.4		
	Very stiff, brown with dark brown, moist													
980														
							U 2				17.9	98.1		P.P. = 4.5+
					5.0'	5								

## WATER LEVEL OBSERVATIONS

WD	 Not Encountered
IAD	 Not Encountered
AD	 Not Encountered

**OLSSON, INC.**  
**1700 E. 123RD STREET**  
**OLATHE, KANSAS 66061**

STARTED:	1/29/22	FINISHED:	1/29/22
DRILL CO.:	RC DRILLING	DRILL RIG:	CME 550X
DRILLER:	RON	LOGGED BY:	RON
METHOD: CONTINUOUS FLIGHT AUGER			

PROJECT NAME					CLIENT									
Lee's Summit Logistics					Scannell Properties									
PROJECT NUMBER					LOCATION									
A21-04157					Lee's Summit, Missouri									
ELEVATION (ft)	MATERIAL DESCRIPTION			GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS	
995	APPROX. SURFACE ELEV. (ft): 995.2				0									
	ROOT ZONE			0.5'										
	FAT CLAY					U 1				25.8	96.4		P.P. = 2.8	
	Stiff, brown with reddish brown and gray, silty, shaley, moist					U 2	CH			20.4	109.1	59/32	P.P. = 4.5+	
				5.0'	5									
990	LEAN CLAY													
	Very stiff, reddish brown with olive brown and gray, shaley, moist													
				8.0'										
	WEATHERED SHALE													
	Brown with olive brown and reddish brown, clayey					SS 3		18-34-47 N=81		15.3				
					10									
	SHALE			11.5'										
	Olive brown with reddish brown													
						SS 4		26-50/6"		13.6				
					15									
980														
						SS 5		24-39-50/5"		13.3				
				19.0'	20									
	Olive gray with olive brown													
	CONTINUED NEXT PAGE													

## WATER LEVEL OBSERVATIONS

WD	▽ 23.5 ft
IAD	▼ Not Encountered
AD	▼ Not Encountered



**OLSSON, INC.**  
1700 E. 123RD STREET  
OLATHE, KANSAS 66061

STARTED:	1/30/22	FINISHED:	1/30/22
DRILL CO.:	RC DRILLING	DRILL RIG:	CME 550X
DRILLER:	RON	LOGGED BY:	ZACH
METHOD: CONTINUOUS FLIGHT AUGER			



## BOREHOLE REPORT NO. B-5A

Sheet 2 of 2

PROJECT NAME <b>Lee's Summit Logistics</b>				CLIENT <b>Scannell Properties</b>									
PROJECT NUMBER <b>A21-04157</b>				LOCATION <b>Lee's Summit, Missouri</b>									
ELEVATION (ft)	 Shelby Tube  Split Spoon			GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
	MATERIAL DESCRIPTION												
	975												
	22.0'												
	970												
27.5'													
28.0'													
LIMESTONE													
Gray													
REFUSAL AT 28.0 FEET													

## WATER LEVEL OBSERVATIONS

WD	▽ 23.5 ft
IAD	▽ Not Encountered
AD	▽ Not Encountered

**OLSSON, INC.**  
**1700 E. 123RD STREET**  
**OLATHE, KANSAS 66061**

STARTED:	1/30/22	FINISHED:	1/30/22
DRILL CO.:	RC DRILLING	DRILL RIG:	CME 550X
DRILLER:	RON	LOGGED BY:	ZACH
METHOD: CONTINUOUS FLIGHT AUGER			







## BOREHOLE REPORT NO. B-7A

Sheet 1 of 1

PROJECT NAME Lee's Summit Logistics				CLIENT Scannell Properties							
PROJECT NUMBER A21-04157				LOCATION Lee's Summit, Missouri							
ELEVATION (ft)	MATERIAL DESCRIPTION	GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
	APPROX. SURFACE ELEV. (ft): 979.1		0								
	ROOT ZONE	0.5'									
	FAT CLAY										
	Very stiff, brown with trace dark brown, silty, moist			U 1				24.4	98.1		P.P. = 4.5+
		3.0'									
975	Stiff, brown to reddish brown and gray, silty			U 2				18.0	92.8		P.P. = 4.3
			5								
		6.5'									
	Reddish brown, silty, shaley										
		8.0'									
	WEATHERED SHALE	8.7'		U 3				23.8	102.4		P.P. = 4.5+
	Reddish brown, silty, clayey										
	REFUSAL AT 8.8 FEET										

## WATER LEVEL OBSERVATIONS

WD	▽ Not Encountered
IAD	▽ Not Encountered
AD	▽ Not Encountered


OLSSON, INC.  
1700 E. 123RD STREET  
OLATHE, KANSAS 66061

STARTED:	1/31/22	FINISHED:	1/31/22
DRILL CO.:	RC DRILLING	DRILL RIG:	CME 550X
DRILLER:	RON	LOGGED BY:	ZACH
METHOD: CONTINUOUS FLIGHT AUGER			






## BOREHOLE REPORT NO. B-8A

Sheet 1 of 1

PROJECT NAME		Lee's Summit Logistics		CLIENT		Scannell Properties						
PROJECT NUMBER		A21-04157		LOCATION		Lee's Summit, Missouri						
ELEVATION (ft)	 Shelby Tube	MATERIAL DESCRIPTION	GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
		APPROX. SURFACE ELEV. (ft): 967.9		0								
		ROOT ZONE	0.5'									
		FAT CLAY										
		Firm, reddish brown			U 1			13.5	18.1	108.0		P.P. = 1.5
965					U 2				23.6	93.2		P.P. = 4.5+
			4.5'									
		Stiff, reddish brown, sandy, moist	5.0'	5								
		LIMESTONE	5.4'									
		Gray										
		REFUSAL AT 5.4 FEET										

## WATER LEVEL OBSERVATIONS

WD  Not EncounteredIAD  Not EncounteredAD  Not Encountered

OLSSON, INC.  
1700 E. 123RD STREET  
OLATHE, KANSAS 66061

STARTED: 1/18/22 FINISHED: 1/18/22

DRILL CO.: RC DRILLING DRILL RIG: CME 550X

DRILLER: LUKE LOGGED BY: LUKE

METHOD: CONTINUOUS FLIGHT AUGER



## BOREHOLE REPORT NO. B-9A

Sheet 1 of 1

PROJECT NAME Lee's Summit Logistics				CLIENT Scannell Properties							
PROJECT NUMBER A21-04157				LOCATION Lee's Summit, Missouri							
ELEVATION (ft)	MATERIAL DESCRIPTION	GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
	APPROX. SURFACE ELEV. (ft): 971.5		0								
	ROOT ZONE	0.5'									
970	FAT CLAY Stiff, dark brown with reddish brown, moist	2.0'		U 1			1.9	26.1	95.4		
	LEAN CLAY Very stiff, reddish brown, shaley, moist			U 2				21.5	105.0		P.P. = 4.5+
			5								
965	LIMESTONE	6.0'									
	Gray	7.2'									

REFUSAL AT 7.2 FEET

## WATER LEVEL OBSERVATIONS

WD ☐ Not EncounteredIAD ☐ Not EncounteredAD ☐ Not Encountered

OLSSON, INC.  
1700 E. 123RD STREET  
OLATHE, KANSAS 66061

STARTED: 1/25/22 FINISHED: 1/25/22

DRILL CO.: RC DRILLING DRILL RIG: CME 550X

DRILLER: LUKE LOGGED BY: ARIANNA

METHOD: CONTINUOUS FLIGHT AUGER



## BOREHOLE REPORT NO. B-10A

Sheet 1 of 1

PROJECT NAME Lee's Summit Logistics				CLIENT Scannell Properties							
PROJECT NUMBER A21-04157				LOCATION Lee's Summit, Missouri							
ELEVATION (ft)	MATERIAL DESCRIPTION	GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
	APPROX. SURFACE ELEV. (ft): 977.8		0								
	ROOT ZONE	0.5'									
	FAT CLAY										
	Very stiff, dark brown with brown, silty, moist			U 1							P.P. = 4.5+
975											
		3.0'									
	Stiff, brown with reddish brown, silty, moist			U 2				22.8	91.4		P.P. = 4.3
			5								
		7.0'									
970	Reddish brown with trace grayish brown, silty										
		8.0'									
	LEAN CLAY										
	Stiff, brown with reddish brown, silty, moist			U 3				22.7	103.2		P.P. = 2.8
		10.0'	10								
BASE OF BORING AT 10.0 FEET											

## WATER LEVEL OBSERVATIONS

WD ☐ Not EncounteredIAD ☐ Not EncounteredAD ☐ Not Encountered

OLSSON, INC.  
1700 E. 123RD STREET  
OLATHE, KANSAS 66061

STARTED: 1/31/22 FINISHED: 1/31/22


DRILL CO.: RC DRILLING DRILL RIG: CME 550X


DRILLER: RON LOGGED BY: ZACH


METHOD: CONTINUOUS FLIGHT AUGER

PROJECT NAME					CLIENT								
Lee's Summit Logistics					Scannell Properties								
PROJECT NUMBER					LOCATION								
A21-04157					Lee's Summit, Missouri								
ELEVATION (ft)	MATERIAL DESCRIPTION			GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
	APPROX. SURFACE ELEV. (ft): 993.2				0								
	ROOT ZONE			0.5'									
	FAT CLAY												
	Very stiff, brown with reddish brown trace dark brown, silty, moist					U 1				28.4	90.4		P.P. = 4.5+
990	LEAN CLAY			3.0'									
	Very stiff, brown with grayish brown and reddish brown, silty, moist					U 2				21.8	99.0	46/37	P.P. = 4.5+
					5								
	Brown with trace reddish brown			6.0'									
985	Reddish brown with olive brown, shaley, silty			8.0'									
						U 3				28.2	100.8		P.P. = 4.3
					10								
	WEATHERED SHALE			11.0'									
	Olive brown with reddish brown, clayey												
980													
	SHALE			14.0'									
	Olive brown with reddish brown					SS 4		15-27-40 N=67		16.9			
					15								
975													

## WATER LEVEL OBSERVATIONS

WD  Not Encountered

IAD  Not Encountered

AD  Not Encountered

**OLSSON, INC.**  
1700 E. 123RD STREET  
OLATHE, KANSAS 66061

STARTED: 1/30/22 FINISHED: 1/30/22

DRILL CO.: RC DRILLING DRILL RIG: CME 550X

DRILLER: RON LOGGED BY: ZACH

METHOD: CONTINUOUS FLIGHT AUGER





## BOREHOLE REPORT NO. B-11A

Sheet 2 of 2

PROJECT NAME		Lee's Summit Logistics		CLIENT		Scannell Properties						
PROJECT NUMBER		A21-04157		LOCATION		Lee's Summit, Missouri						
ELEVATION (ft.)	<div><div></div> Shelby Tube</div> <div><div></div> Split Spoon</div>	MATERIAL DESCRIPTION	GRAPHIC LOG	DEPTH (ft.)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
		Gray (continued)		20								

LIMESTONE

Gray

REFUSAL AT 23.1 FEET

## WATER LEVEL OBSERVATIONS

WD ☐ Not EncounteredIAD ☐ Not EncounteredAD ☐ Not Encountered

OLSSON, INC.  
1700 E. 123RD STREET  
OLATHE, KANSAS 66061

STARTED: 1/30/22 FINISHED: 1/30/22

DRILL CO.: RC DRILLING DRILL RIG: CME 550X

DRILLER: RON LOGGED BY: ZACH

METHOD: CONTINUOUS FLIGHT AUGER

PROJECT NAME					CLIENT									
Lee's Summit Logistics					Scannell Properties									
PROJECT NUMBER					LOCATION									
A21-04157					Lee's Summit, Missouri									
ELEVATION (ft)	MATERIAL DESCRIPTION				GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
	APPROX. SURFACE ELEV. (ft): 996.2													
995	ROOT ZONE				0.5'	0	U 1				26.6	95.8		P.P. = 2.0
	FAT CLAY													
	Stiff, brown with trace reddish brown, moist													
	3.0'													
	Stiff, brown with trace reddish brown and gray, shaley, moist													
	6.0'													
990	WEATHERED SHALE													
	Olive brown, clayey													
	9.5'													
	SHALE													
	Olive brown													
985	14.3'													
	Gray													
980	19.0'													
BASE OF BORING AT 19.0 FEET														

## WATER LEVEL OBSERVATIONS

WD	☒ Not Encountered
IAD	☒ Not Encountered
AD	☒ Not Encountered

**OLSSON, INC.**  
1700 E. 123RD STREET  
OLATHE, KANSAS 66061

STARTED:	1/29/22	FINISHED:	1/29/22
DRILL CO.:	RC DRILLING	DRILL RIG:	CME 550X
DRILLER:	RON	LOGGED BY:	RON
METHOD: CONTINUOUS FLIGHT AUGER			



## BOREHOLE REPORT NO. B-13A

Sheet 1 of 1


PROJECT NAME Lee's Summit Logistics				CLIENT Scannell Properties							
PROJECT NUMBER A21-04157				LOCATION Lee's Summit, Missouri							
ELEVATION (ft)	MATERIAL DESCRIPTION	GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
	APPROX. SURFACE ELEV. (ft): 1007.1		0								
	ROOT ZONE	0.5'									
	FAT CLAY										
1005	Stiff, brown with dark brown, moist, trace organics	2.0'		U 1				28.7	92.6		P.P. = 4.0
	LEAN CLAY										
	Stiff, brown with reddish brown, moist		5	U 2				21.7	101.8		P.P. = 4.0
1000		7.0'									
	Brown, silty	8.0'									
	WEATHERED SHALE										
	▽ Olive brown, clayey			U 3				12.9	120.1		P.P. = 4.5+
		9.8'									
	SHALE		10								
	Olive brown with reddish brown	11.0'									
	LIMESTONE	11.2'									
	Gray										
	REFUSAL AT 11.2 FEET										

## WATER LEVEL OBSERVATIONS


WD	▽ 9.0 ft
IAD	▽ Not Performed
AD	▽ Not Encountered


OLSSON, INC.  
1700 E. 123RD STREET  
OLATHE, KANSAS 66061


STARTED:	1/29/22	FINISHED:	1/29/22
DRILL CO.:	RC DRILLING	DRILL RIG:	CME 550X
DRILLER:	RON	LOGGED BY:	RON
METHOD: CONTINUOUS FLIGHT AUGER			

PROJECT NAME					CLIENT									
Lee's Summit Logistics					Scannell Properties									
PROJECT NUMBER					LOCATION									
A21-04157					Lee's Summit, Missouri									
ELEVATION (ft)	MATERIAL DESCRIPTION			GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS	
	APPROX. SURFACE ELEV. (ft): 991.8				0									
	ROOT ZONE			0.5'										
990	FAT CLAY					U 1	CH			26.4	99.4	59/40	P.P. = 4.5+	
	Stiff, brown with dark brown, trace organics													
	LEAN CLAY			3.0'		U 2			5.1	22.5	103.7		P.P. = 4.5	
	Very stiff, brown with reddish brown, moist				5									
985	WEATHERED SHALE			7.0'										
	Olive brown, clayey													
	SHALE			9.0'	10	SS 3		10-21-33 N=54		18.8				
980	Olive brown													
											</			

**WATER LEVEL OBSERVATIONS**

WD  Not Encountered

IAD  Not Encountered

AD  Not Encountered

**OLSSON, INC.**  
**1700 E. 123RD STREET**  
**OLATHE, KANSAS 66061**

STARTED: 1/29/22 FINISHED: 1/29/22

DRILL CO.: RC DRILLING DRILL RIG: CME 550X



DRILLER: RON LOGGED BY: RON

METHOD: CONTINUOUS FLIGHT AUGER






## BOREHOLE REPORT NO. B-14A

Sheet 2 of 2

PROJECT NAME <b>Lee's Summit Logistics</b>				CLIENT <b>Scannell Properties</b>								
PROJECT NUMBER <b>A21-04157</b>				LOCATION <b>Lee's Summit, Missouri</b>								
ELEVATION (ft)	 Shelby Tube	 Split Spoon	GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
	MATERIAL DESCRIPTION											
	Gray (continued)		21.0'									
	<b>LIMESTONE</b>											
970	Gray		22.0'									
REFUSAL AT 22.0 FEET												

## WATER LEVEL OBSERVATIONS

WD  Not EncounteredIAD  Not EncounteredAD  Not Encountered

**OLSSON, INC.**  
**1700 E. 123RD STREET**  
**OLATHE, KANSAS 66061**

STARTED: 1/29/22 FINISHED: 1/29/22

DRILL CO.: RC DRILLING DRILL RIG: CME 550X

DRILLER: RON LOGGED BY: RON

METHOD: CONTINUOUS FLIGHT AUGER



## BOREHOLE REPORT NO. B-15A

Sheet 1 of 1

PROJECT NAME Lee's Summit Logistics				CLIENT Scannell Properties							
PROJECT NUMBER A21-04157				LOCATION Lee's Summit, Missouri							
ELEVATION (ft)	MATERIAL DESCRIPTION	GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
	APPROX. SURFACE ELEV. (ft): 978.5		0								
	ROOT ZONE	0.5'									
	FAT CLAY										
	Stiff, dark brown with brown, silty, very moist			U 1			1.6	32.1	91.5		
975		3.0'									
	Firm, brown with reddish brown, silty, moist			U 2			1.1	29.4	91.1		
			5								
		6.5'									
	Brown with reddish brown trace brownish gray, silty										
		8.0'									
970	LEAN TO FAT CLAY										
	Stiff, reddish brown, shaley, silty			U 3			1.7	26.6	99.4		
		10.0'	10								
BASE OF BORING AT 10.0 FEET											

## WATER LEVEL OBSERVATIONS

WD ☐ Not EncounteredIAD ☐ Not PerformedAD ☐ Not Encountered

OLSSON, INC.  
1700 E. 123RD STREET  
OLATHE, KANSAS 66061

STARTED: 1/30/22 FINISHED: 1/30/22

DRILL CO.: RC DRILLING DRILL RIG: CME 550X

DRILLER: RON LOGGED BY: ZACH

METHOD: CONTINUOUS FLIGHT AUGER





## BOREHOLE REPORT NO. B-16A

Sheet 1 of 1

PROJECT NAME Lee's Summit Logistics				CLIENT Scannell Properties							
PROJECT NUMBER A21-04157				LOCATION Lee's Summit, Missouri							
ELEVATION (ft)	MATERIAL DESCRIPTION	GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
	APPROX. SURFACE ELEV. (ft): 966.5		0								
	ROOT ZONE	0.5'									
965	FAT CLAY Very stiff, dark brown with reddish brown, moist			U 1			3.0	28.0	95.7		
				U 2				25.3	98.8		P.P. = 3.0
	WEATHERED LIMESTONE	5.0'	5								
	Reddish brown clay seams	6.0'									
960	LIMESTONE	6.5'									
	Gray										
	REFUSAL AT 6.5 FEET										

## WATER LEVEL OBSERVATIONS

WD ☐ Not EncounteredIAD ☐ Not EncounteredAD ☐ Not Encountered

OLSSON, INC.  
1700 E. 123RD STREET  
OLATHE, KANSAS 66061

STARTED: 1/25/22 FINISHED: 1/25/22

DRILL CO.: RC DRILLING DRILL RIG: CME 550X

DRILLER: LUKE LOGGED BY: ARIANNA

METHOD: CONTINUOUS FLIGHT AUGER



## BOREHOLE REPORT NO. B-17A

Sheet 1 of 1

PROJECT NAME <b>Lee's Summit Logistics</b>			CLIENT <b>Scannell Properties</b>								
PROJECT NUMBER <b>A21-04157</b>			LOCATION <b>Lee's Summit, Missouri</b>								
ELEVATION (ft)	MATERIAL DESCRIPTION	GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
	APPROX. SURFACE ELEV. (ft): 954.4		0								
	ROOT ZONE	0.4'									
	LEAN TO FAT CLAY	0.8'									
	Dark brown with reddish brown, sandy	1.0'									
	LIMESTONE										
	Gray										
	REFUSAL AT 1.0 FEET										

## WATER LEVEL OBSERVATIONS

WD ☐ Not PerformedIAD ☐ Not PerformedAD ☐ Not Performed

**OLSSON, INC.**  
**1700 E. 123RD STREET**  
**OLATHE, KANSAS 66061**

STARTED: 1/18/22 FINISHED: 1/18/22

DRILL CO.: RC DRILLING DRILL RIG: CME 550X

DRILLER: LUKE LOGGED BY: LUKE

METHOD: CONTINUOUS FLIGHT AUGER



## BOREHOLE REPORT NO. B-18A

Sheet 1 of 1

PROJECT NAME					CLIENT									
Lee's Summit Logistics					Scannell Properties									
PROJECT NUMBER					LOCATION									
A21-04157					Lee's Summit, Missouri									
ELEVATION (ft)	MATERIAL DESCRIPTION				GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
	APPROX. SURFACE ELEV. (ft): 966.2					0								
965	ROOT ZONE				0.5'									
	FAT CLAY													
	Firm, brown with reddish brown, silty, moist						U 1			0.9	27.4	93.9		P.P. = 1.5

## WATER LEVEL OBSERVATIONS

WD	▽ Not Encountered
IAD	▽ Not Encountered
AD	▽ Not Encountered




**OLSSON, INC.**  
**1700 E. 123RD STREET**  
**OLATHE, KANSAS 66061**

STARTED:	1/18/22	FINISHED:	1/18/22
DRILL CO.:	RC DRILLING	DRILL RIG:	CME 550X
DRILLER:	LUKE	LOGGED BY:	LUKE
METHOD: CONTINUOUS FLIGHT AUGER			






## BOREHOLE REPORT NO. B-19A

Sheet 1 of 1

PROJECT NAME					CLIENT									
Lee's Summit Logistics					Scannell Properties									
PROJECT NUMBER					LOCATION									
A21-04157					Lee's Summit, Missouri									
ELEVATION (ft)	<div><div></div>Shelby Tube</div>  <div>MATERIAL DESCRIPTION</div>  <div>APPROX. SURFACE ELEV. (ft): 981.1</div>				GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
	ROOT ZONE				0.5'									
980	FAT CLAY													
	Very stiff, brown with trace dark brown and reddish brown, silty, moist													P.P. = 4.5+
	LEAN CLAY				3.0'									
	Stiff, dark brownish gray with trace reddish brown, silty, moist													P.P. = N/A
					5.0'		5							

## WATER LEVEL OBSERVATIONS

WD  Not EncounteredIAD  Not EncounteredAD  Not Encountered

**OLSSON, INC.**  
**1700 E. 123RD STREET**  
**OLATHE, KANSAS 66061**

STARTED: 1/18/22 FINISHED: 1/18/22

DRILL CO.: RC DRILLING DRILL RIG: CME 550X

DRILLER: LUKE LOGGED BY: LUKE

METHOD: CONTINUOUS FLIGHT AUGER



## BOREHOLE REPORT NO. B-20A

Sheet 1 of 1

PROJECT NAME <b>Lee's Summit Logistics</b>					CLIENT <b>Scannell Properties</b>						
PROJECT NUMBER <b>A21-04157</b>					LOCATION <b>Lee's Summit, Missouri</b>						
ELEVATION (ft)	MATERIAL DESCRIPTION	GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
	Shelby Tube										
	APPROX. SURFACE ELEV. (ft): 1011.0		0								
	ROOT ZONE	0.5'									
1010	FAT CLAY										
	Stiff, brown with reddish brown, moist			U 1				26.8	93.8		P.P. = 3.3
		3.0'									
	Very stiff, brown with trace reddish brown and gray, moist			U 2			2.8	26.8	94.9		
		5.0'	5								

BASE OF BORING AT 5.0 FEET

## WATER LEVEL OBSERVATIONS

WD	☐ Not Encountered
IAD	☐ Not Encountered
AD	☐ Not Encountered

**OLSSON, INC.**  
**1700 E. 123RD STREET**  
**OLATHE, KANSAS 66061**

STARTED:	1/29/22	FINISHED:	1/29/22
DRILL CO.:	RC DRILLING	DRILL RIG:	CME 550X
DRILLER:	RON	LOGGED BY:	RON
METHOD: CONTINUOUS FLIGHT AUGER			



## BOREHOLE REPORT NO. B-21A

Sheet 1 of 1

PROJECT NAME <b>Lee's Summit Logistics</b>					CLIENT <b>Scannell Properties</b>						
PROJECT NUMBER <b>A21-04157</b>					LOCATION <b>Lee's Summit, Missouri</b>						
ELEVATION (ft)	MATERIAL DESCRIPTION	GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
	Shelby Tube										
	APPROX. SURFACE ELEV. (ft): 966.8		0								
	ROOT ZONE	0.5'									
965	FAT CLAY										
	Stiff, reddish brown with dark brown, moist			U 1				25.7	97.9		P.P. = 3.0
				U 2				37.9	77.2		P.P. = 4.5
		4.5'									
	Stiff, reddish brown, sandy, very moist	5.0'	5								
	BASE OF BORING AT 5.0 FEET										

## WATER LEVEL OBSERVATIONS

WD ☐ Not EncounteredIAD ☐ Not EncounteredAD ☐ Not Encountered

**OLSSON, INC.**  
**1700 E. 123RD STREET**  
**OLATHE, KANSAS 66061**

STARTED: 1/18/22 FINISHED: 1/18/22

DRILL CO.: RC DRILLING DRILL RIG: CME 550X

DRILLER: LUKE LOGGED BY: LUKE

METHOD: CONTINUOUS FLIGHT AUGER

## **APPENDIX C**

### Laboratory Test Results



PROJECT NAME: Lee's Summit Logistics

CLIENT: Scannell Properties

PROJECT NUMBER: A21-04157

PROJECT LOCATION: Lee's Summit, Missouri

BORING NUMBER	SAMPLE I.D.	SAMPLE DEPTH (ft)	MOISTURE CONTENT (%)	DRY DENSITY (pcf)	VOID RATIO	SATURATION (%)	UNCONFINED STRENGTH (tsf)	STRAIN (%)	ATTERBERG LIMITS			P-200	USCS CLASS.
									LIQUID LIMIT	PLASTIC LIMIT	PLASTIC INDEX		
B-1A	U-1	1.0 - 3.0'	29.0	87.8	0.919	85.1							
B-1R	U-1	1.0 - 3.0'	27.5	95.1	0.772	96.1							
B-1R	U-2	3.0 - 5.0'	27.1	95.3	0.768	95.2							
B-1R	U-3	8.0 - 10.0'	28.9	92.1	0.830	94.0	1.7	5.0					
B-2A	U-1	1.0 - 3.0'	26.0	95.4	0.767	91.3							
B-2A	U-2	3.0 - 5.0'	23.5	101.5	0.660	96.2							
B-3A	U-1	1.0 - 3.0'	25.0	95.0	0.773	87.2	4.2	8.6					
B-3A	U-2	3.0 - 5.0'	20.2	106.4	0.585	93.3							
B-3A	SS-3	8.5 - 8.7'	5.0										
B-3R	U-1	1.0 - 3.0'	16.2	86.2	0.956	45.8							
B-3R	U-2	3.0 - 5.0'	30.5	84.9	0.984	83.6	0.9	4.9					
B-4A	U-1	1.0 - 3.0'	27.5	94.7	0.780	95.4							
B-4A	U-2	3.0 - 5.0'	21.0	105.7	0.594	95.6							
B-4A	U-3	8.0 - 10.0'	17.1	111.3	0.514	89.8							
B-4R	U-1	1.0 - 3.0'	26.5	95.4	0.766	93.2	2.0	9.8					
B-4R	U-2	3.0 - 5.0'	17.9	98.1	0.718	67.3							
B-5A	U-1	1.0 - 3.0'	25.8	96.4	0.749	93.1							
B-5A	U-2	3.0 - 5.0'	20.4	109.1	0.546	100.0			59	27	32		CH
B-5A	SS-3	8.5 - 10.0'	15.3										
B-5A	SS-4	13.5 - 14.5'	13.6										
B-5A	SS-5	18.5 - 19.9'	13.3										
B-5A	SS-6	23.5 - 24.2'	14.1										
B-6A	U-1	1.0 - 3.0'	27.1	92.2	0.827	88.4	2.0	6.9	58	25	33		CH
B-6A	U-2	3.0 - 5.0'	24.2	100.3	0.680	96.1	5.1	7.9					
B-6A	U-3	8.0 - 10.0'	28.8	95.4	0.767	100.0							
B-6A	SS-4	13.5 - 15.0'	17.7										
B-7A	U-1	1.0 - 3.0'	24.4	98.1	0.718	91.6							
B-7A	U-2	3.0 - 5.0'	18.0	92.8	0.816	59.4							
B-7A	U-3	8.0 - 8.7'	23.8	102.4	0.646	99.4							
B-8A	U-1	1.0 - 3.0'	18.1	108.0	0.561	87.2	13.5	1.9					

PROJECT NAME: Lee's Summit Logistics

CLIENT: Scannell Properties

PROJECT NUMBER: A21-04157

PROJECT LOCATION: Lee's Summit, Missouri

BORING NUMBER	SAMPLE I.D.	SAMPLE DEPTH (ft)	MOISTURE CONTENT (%)	DRY DENSITY (pcf)	VOID RATIO	SATURATION (%)	UNCONFINED STRENGTH (tsf)	STRAIN (%)	ATTERBERG LIMITS			P-200	USCS CLASS.
									LIQUID LIMIT	PLASTIC LIMIT	PLASTIC INDEX		
B-8A	U-2	3.0 - 5.0'	23.6	93.2	0.808	78.8							
B-9A	U-1	1.0 - 3.0'	26.1	95.4	0.767	92.1	1.9	8.0					
B-9A	U-2	3.0 - 5.0'	21.5	105.0	0.605	96.0							
B-10A	U-2	3.0 - 5.0'	22.8	91.4	0.843	72.9							
B-10A	U-3	8.0 - 10.0'	22.7	103.2	0.634	96.7							
B-11A	U-1	1.0 - 3.0'	28.4	90.4	0.865	88.7							
B-11A	U-2	3.0 - 5.0'	21.8	99.0	0.703	83.7			46	9	37		
B-11A	U-3	8.0 - 10.0'	28.2	100.8	0.672	100.0							
B-11A	SS-4	13.5 - 15.0'	16.9										
B-11A	SS-5	18.5 - 20.0'	16.3										
B-12A	U-1	1.0 - 3.0'	26.6	95.8	0.759	94.8							
B-12A	U-2	3.0 - 5.0'	27.8	97.7	0.725	100.0							
B-12A	SS-3	8.5 - 10.0'	18.0										
B-12A	SS-4	13.5 - 14.7'	15.1										
B-12A	SS-5	18.5 - 18.9'	9.5										
B-13A	U-1	1.0 - 3.0'	28.7	92.6	0.820	94.4							
B-13A	U-2	3.0 - 5.0'	21.7	101.8	0.656	89.1							
B-13A	U-3	8.0 - 9.8'	12.9	120.1	0.403	86.1							
B-14A	U-1	1.0 - 3.0'	26.4	99.4	0.695	100.0			59	19	40		CH
B-14A	U-2	3.0 - 5.0'	22.5	103.7	0.625	97.5	5.1	4.2					
B-14A	SS-3	8.5 - 10.0'	18.8										
B-14A	SS-4	13.5 - 14.8'	16.4										
B-14A	SS-5	18.5 - 19.3'	10.0										
B-15A	U-1	1.0 - 3.0'	32.1	91.5	0.841	100.0	1.6	10.6					
B-15A	U-2	3.0 - 5.0'	29.4	91.1	0.850	93.4	1.1	8.5					
B-15A	U-3	8.0 - 10.0'	26.6	99.4	0.696	100.0	1.7	8.8					
B-16A	U-1	1.0 - 3.0'	28.0	95.7	0.762	99.4	3.0	12.9					
B-16A	U-2	3.0 - 5.0'	25.3	98.8	0.706	96.6							
B-18A	U-1	1.0 - 3.0'	27.4	93.9	0.794	93.1	0.9	4.4					
B-18A	U-2	3.0 - 5.0'	33.6	83.2	1.027	88.4							

OLSSON, INC.  
1700 E. 123RD STREET  
OLATHE, KANSAS 66061



## SUMMARY OF LABORATORY RESULTS

PAGE 3 OF 3

PROJECT NAME: Lee's Summit Logistics

CLIENT: Scannell Properties

PROJECT NUMBER: A21-04157

PROJECT LOCATION: Lee's Summit, Missouri


BORING NUMBER	SAMPLE I.D.	SAMPLE DEPTH (ft)	MOISTURE CONTENT (%)	DRY DENSITY (pcf)	VOID RATIO	SATURATION (%)	UNCONFINED STRENGTH (tsf)	STRAIN (%)	ATTERBERG LIMITS			P-200	USCS CLASS.
									LIQUID LIMIT	PLASTIC LIMIT	PLASTIC INDEX		
B-19A	U-1	1.0 - 3.0'	24.2	98.3	0.715	91.3							
B-19A	U-2	3.0 - 5.0'	22.2	100.8	0.672	89.2							
B-20A	U-1	1.0 - 3.0'	26.8	93.8	0.797	90.9							
B-20A	U-2	3.0 - 5.0'	26.8	94.9	0.777	93.1	2.8	6.3					
B-21A	U-1	1.0 - 3.0'	25.7	97.9	0.721	96.4							
B-21A	U-2	3.0 - 5.0'	37.9	77.2	1.185	86.4							

PROJECT NAME: Lee's Summit Logistics

CLIENT: Scannell Properties

PROJECT NUMBER: A21-04157

PROJECT LOCATION: Lee's Summit, Missouri

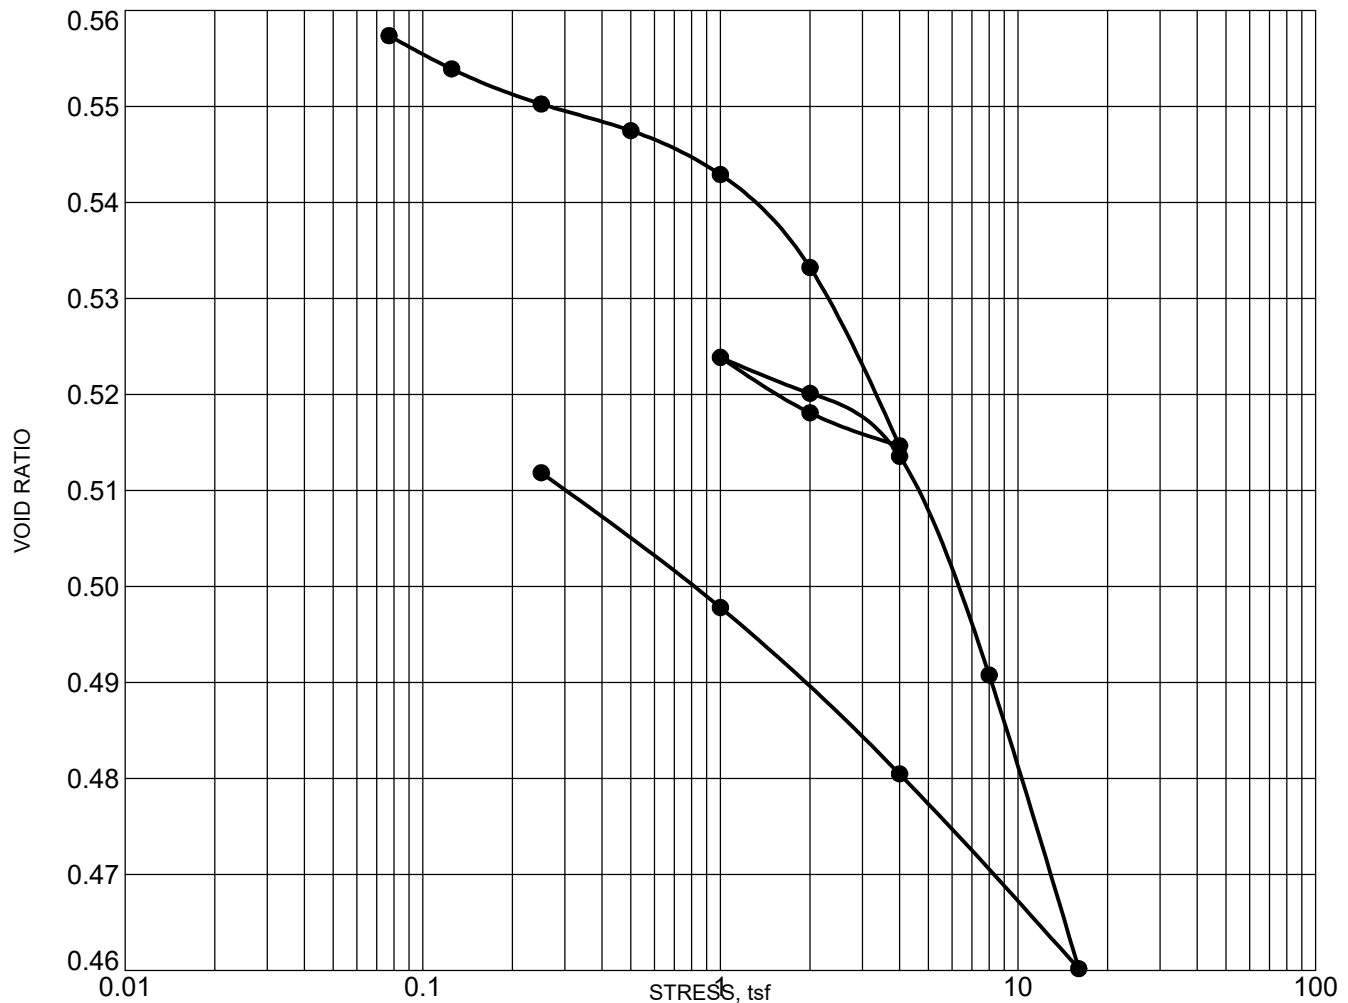

Boring No: B-8A Initial Water Content (%): 18.1 Est. Preconsolidation Stress (tsf): 2.2

Sample ID: U-1 Final Water Content (%): 22.2 Laboratory Water Type: Distilled Water

Sample Depth: 1.0 - 3.0' Initial Dry Density (pcf): 108.0 Test Procedure Method: B

Start Date: 2/10/22 Initial Void Ratio: 0.560 Interpretation Procedure: 1

Technician: J.CAULFIELD Final Void Ratio: 0.510 Stress at Inundation (psf): 0.8

Apparatus: ShearTrac Initial Degree of Saturation (%): 87.2 Specimen Trimming Method: Cutting Shoe

Specific Gravity: 2.7 Final Degree of Saturation (%): 100.0

**ATTERBERG LIMITS**

LL PL PI Classification

Sample Description: \_\_\_\_\_ Notes: \_\_\_\_\_  
\_\_\_\_\_







## **APPENDIX D**

### 2021 Previous Olsson Borings



## BOREHOLE REPORT NO. B-7

Sheet 1 of 1

PROJECT NAME					CLIENT										
Scannell Lee's Summit Tudor Road					Scannell Properties, LLC										
PROJECT NUMBER					LOCATION										
021-04157					Lee's Summit, Missouri										
ELEVATION (ft)	MATERIAL DESCRIPTION				GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS	
	APPROX. SURFACE ELEV. (ft): 982					0									
980	ROOT ZONE FAT CLAY  Stiff, dark brown, moist, trace orgaincs					0.2'		U 1				25.5	94.8	53/33	P.P. = 4.5
	LEAN CLAY  Stiff, reddish brown, moist					3.0'									
975						5		SS 2	3-5-6 N=11		21.8				
	Olive brown, shaley LIMESTONE							SS 3	50/3"		0.7				
						9.5'									

REFUSAL AT 9.5 FEET

## WATER LEVEL OBSERVATIONS

WD	▽ Not Encountered
IAD	▼ Not Encountered
AD	▼ Not Encountered

OLSSON, INC.  
1700 E. 123RD STREET  
OLATHE, KANSAS 66061

STARTED:	6/1/21	FINISHED:	6/1/21
DRILL COALPHA OMEGA		DRILL RIG:	CME 55
DRILLER: K. KEMPTON		LOGGED BY:	D. MARTIN
METHOD: CONTINUOUS FLIGHT AUGER			





PROJECT NAME					CLIENT									
Scannell Lee's Summit Tudor Road					Scannell Properties, LLC									
PROJECT NUMBER					LOCATION									
021-04157					Lee's Summit, Missouri									
ELEVATION (ft)	MATERIAL DESCRIPTION			GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS	
	APPROX. SURFACE ELEV. (ft): 987				0									
	ROOT ZONE													
	FAT CLAY													
985	Stif, dark brown, moist, trace orgaincs					U 1				30.5	90.7		P.P. = 4.0	
	2.5'													
	Stiff, reddish brown, moist													
	4.5'													
	LEAN CLAY				5	SS 2		3-3-3 N=6		22.6				
	Stiff, light brown with reddish brown, moist													
980														
	9.0'													
	Very stiff, yellow brown, shaley, moist				10	U 3				23.3	109.3		P.P. = 4.5	
975														
	15.8'													
	16.2'				15	SS 4		4-6-9 N=15		21.4				
	LIMESTONE													
REFUSAL AT 16.2 FEET														

## WATER LEVEL OBSERVATIONS

WD	▽ Not Encountered
IAD	▼ Not Encountered
AD	▼ Not Encountered



**OLSSON, INC.**  
1700 E. 123RD STREET  
OLATHE, KANSAS 66061

STARTED:	6/2/21	FINISHED:	6/2/21
DRILL COALPHA OMEGA		DRILL RIG:	CME 55
DRILLER: K. KEMPTON		LOGGED BY:	D. MARTIN
METHOD: CONTINUOUS FLIGHT AUGER			






## BOREHOLE REPORT NO. B-10

Sheet 1 of 1

PROJECT NAME				CLIENT									
Scannell Lee's Summit Tudor Road				Scannell Properties, LLC									
PROJECT NUMBER				LOCATION									
021-04157				Lee's Summit, Missouri									
ELEVATION (ft)	MATERIAL DESCRIPTION			GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
	APPROX. SURFACE ELEV. (ft): 972				0								
	ROOT ZONE												
	FAT CLAY												
970	Firm, reddish brown, moist, trace orgaicns					 SS 1		3-4-3 N=7		24.4			
	Stiff, reddish brown, very moist					 U 2				35.8	86.4		P.P. = 4.0
					5								
	LIMESTONE												

REFUSAL AT 6.5 FEET









## WATER LEVEL OBSERVATIONS

WD	 Not Encountered
IAD	 Not Encountered
AD	 Not Encountered

OLSSON, INC.  
1700 E. 123RD STREET  
OLATHE, KANSAS 66061

STARTED:	6/2/21	FINISHED:	6/2/21
DRILL COALPHA OMEGA		DRILL RIG:	CME 55
DRILLER: K. KEMPTON		LOGGED BY:	D. MARTIN
METHOD: CONTINUOUS FLIGHT AUGER			



PROJECT NAME Scannell Lee's Summit Tudor Road				CLIENT Scannell Properties, LLC								
PROJECT NUMBER 021-04157				LOCATION Lee's Summit, Missouri								
ELEVATION (ft)	MATERIAL DESCRIPTION		GRAPHIC LOG	DEPTH (ft)	SAMPLE TYPE NUMBER	CLASSIFICATION (USCS)	BLOWS/6" N-VALUE	UNC. STR. (tsf)	MOISTURE (%)	DRY DENSITY (pcf)	LL/PI (%)	ADDITIONAL DATA/ REMARKS
1010	APPROX. SURFACE ELEV. (ft): 1010			0								
	ROOT ZONE FAT CLAY  Firm, dark brown, moist, trace orgaincs			0.2'	 SS 1		4-3-4 N=7		28.7			
				4.0'	 U 2			1.5	25.1	99.5	40/24	
1005	Stiff, reddish brown, moist			5								
				7.0'								
	LEAN CLAY  Stiff, olive brown, shaley											
				8.5'								
	SHALE  Yellow brown				 SS 3		50/6"		21.7			
				9.4'								
				9.8'								
1000	LIMESTONE CLAY FILLED JOINT			10								
	LIMESTONE  REFUSAL AT 10.4 FEET			10.4'								

## WATER LEVEL OBSERVATIONS

WD	☒ Not Encountered
IAD	☒ Not Encountered
AD	☒ Not Encountered

**OLSSON, INC.**  
1700 E. 123RD STREET  
OLATHE, KANSAS 66061

STARTED: 6/2/21	FINISHED: 6/2/21
DRILL COALPHA OMEGA	DRILL RIG: CME 55
DRILLER: K. KEMPTON	LOGGED BY: D. MARTIN
METHOD: CONTINUOUS FLIGHT AUGER	

# **LEE'S SUMMIT LOGISTICS – BUILDING A AND ROAD**

Lee's Summit, Missouri - 2022

February, 2022

Olsson Project No. A21-05147