

LEE'S SUMMIT GRID: 09-01-1808

94°21'41"W 38°57'32"N NAD83

Maximo WO #: 23503010

THE ROUTE OF THE GAS SERVICE MUST BE BROUGHT TO GRADE AND CLEARED OF BUILDING MATERIAL BY THE CUSTOMER PRIOR TO INSTALLATION.


GRANULAR BACKFILL, IF REQUIRED, IS TO BE PROVIDED BY THE CUSTOMER. IN WHICH CASE, SPIRE WILL NOT BE RESPONSIBLE FOR THE DISPOSAL OF EXCESS SPOIL FROM THE DITCH.

SPIRE TO ONLY PATCH THAT PAVEMENT REMOVED FOR THE INSTALLATION OF THE GAS SERVICE.

<u>PIPE SYSTEM</u> PRESSURE SYS - C-013 MP MINOP -MOP - 25 PSIG MAOP - 25 PSIG DESIGNED MAOP - 58 PSIG TEST PRESSURE - 100 PSIG

CUSTOMER APPROVAL SIGNATURE:

GAS METER MUST COMPLY WITH REQUIREMENTS SHOWN BELOW




120

Feet

DATE:

1/5/2022

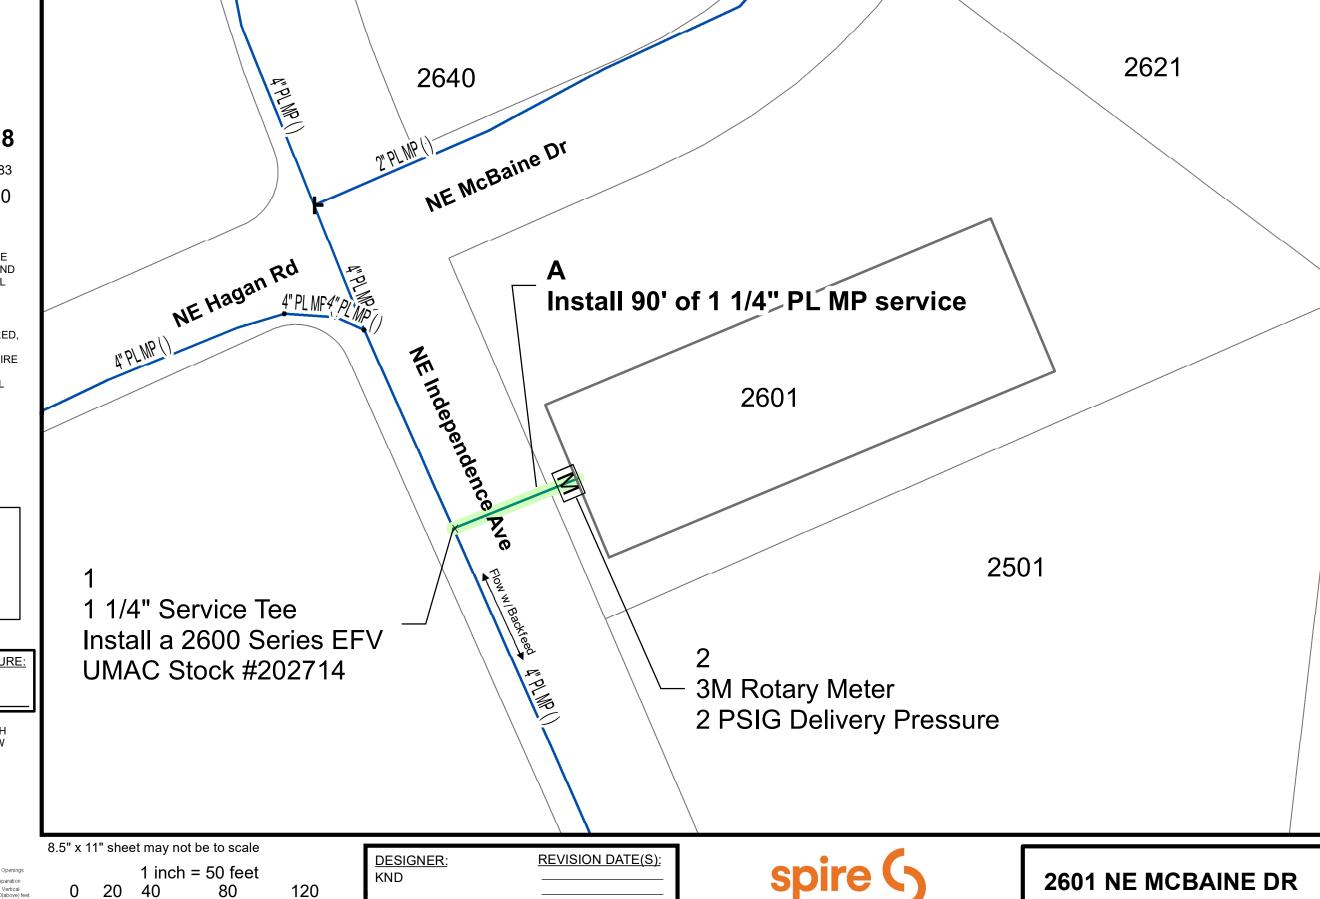

Missouri West

TOTAL LOAD: 1594 CHF