


1. GAS SUPPLY REQUIRED (BY OTHERS) TO GAS CONNECTION POINT (G).  
MINIMUM GAS PRESSURE IS REQUIRED AT MAXIMUM VOLUME CONSUMED.  
MINIMUM CIRCUIT CAPACITY IS REQUIRED (BY OTHERS) TO CONNECTION POINT (E).  
LIGHTING CIRCUIT IS REQUIRED (BY OTHERS) TO CONNECTION POINT (L).
2. THE EQUIPMENT DEPICTED IN THIS DRAWING HAS NOT BEEN APPROVED FOR OUTDOOR APPLICATIONS. IN THE EVENT THAT SUCH APPLICATIONS AND/OR USES ARE CONTEMPLATED, THE PURCHASER OF THE EQUIPMENT IS RESPONSIBLE FOR NOTIFYING GFS SO THAT ADDITIONAL STRUCTURAL ANALYSIS CAN BE PERFORMED AND THE NECESSARY MODIFICATIONS CAN BE DETERMINED.
3. DUCT SUPPORT NOT SUPPLIED OR DESIGNED BY GFS. EQUIPMENT IS NOT DESIGNED TO SUPPORT DUCT. DUCT SUPPORTS SHALL BE DESIGNED TO RELIEVE THE EQUIPMENT OF ALL DUCT LOAD.

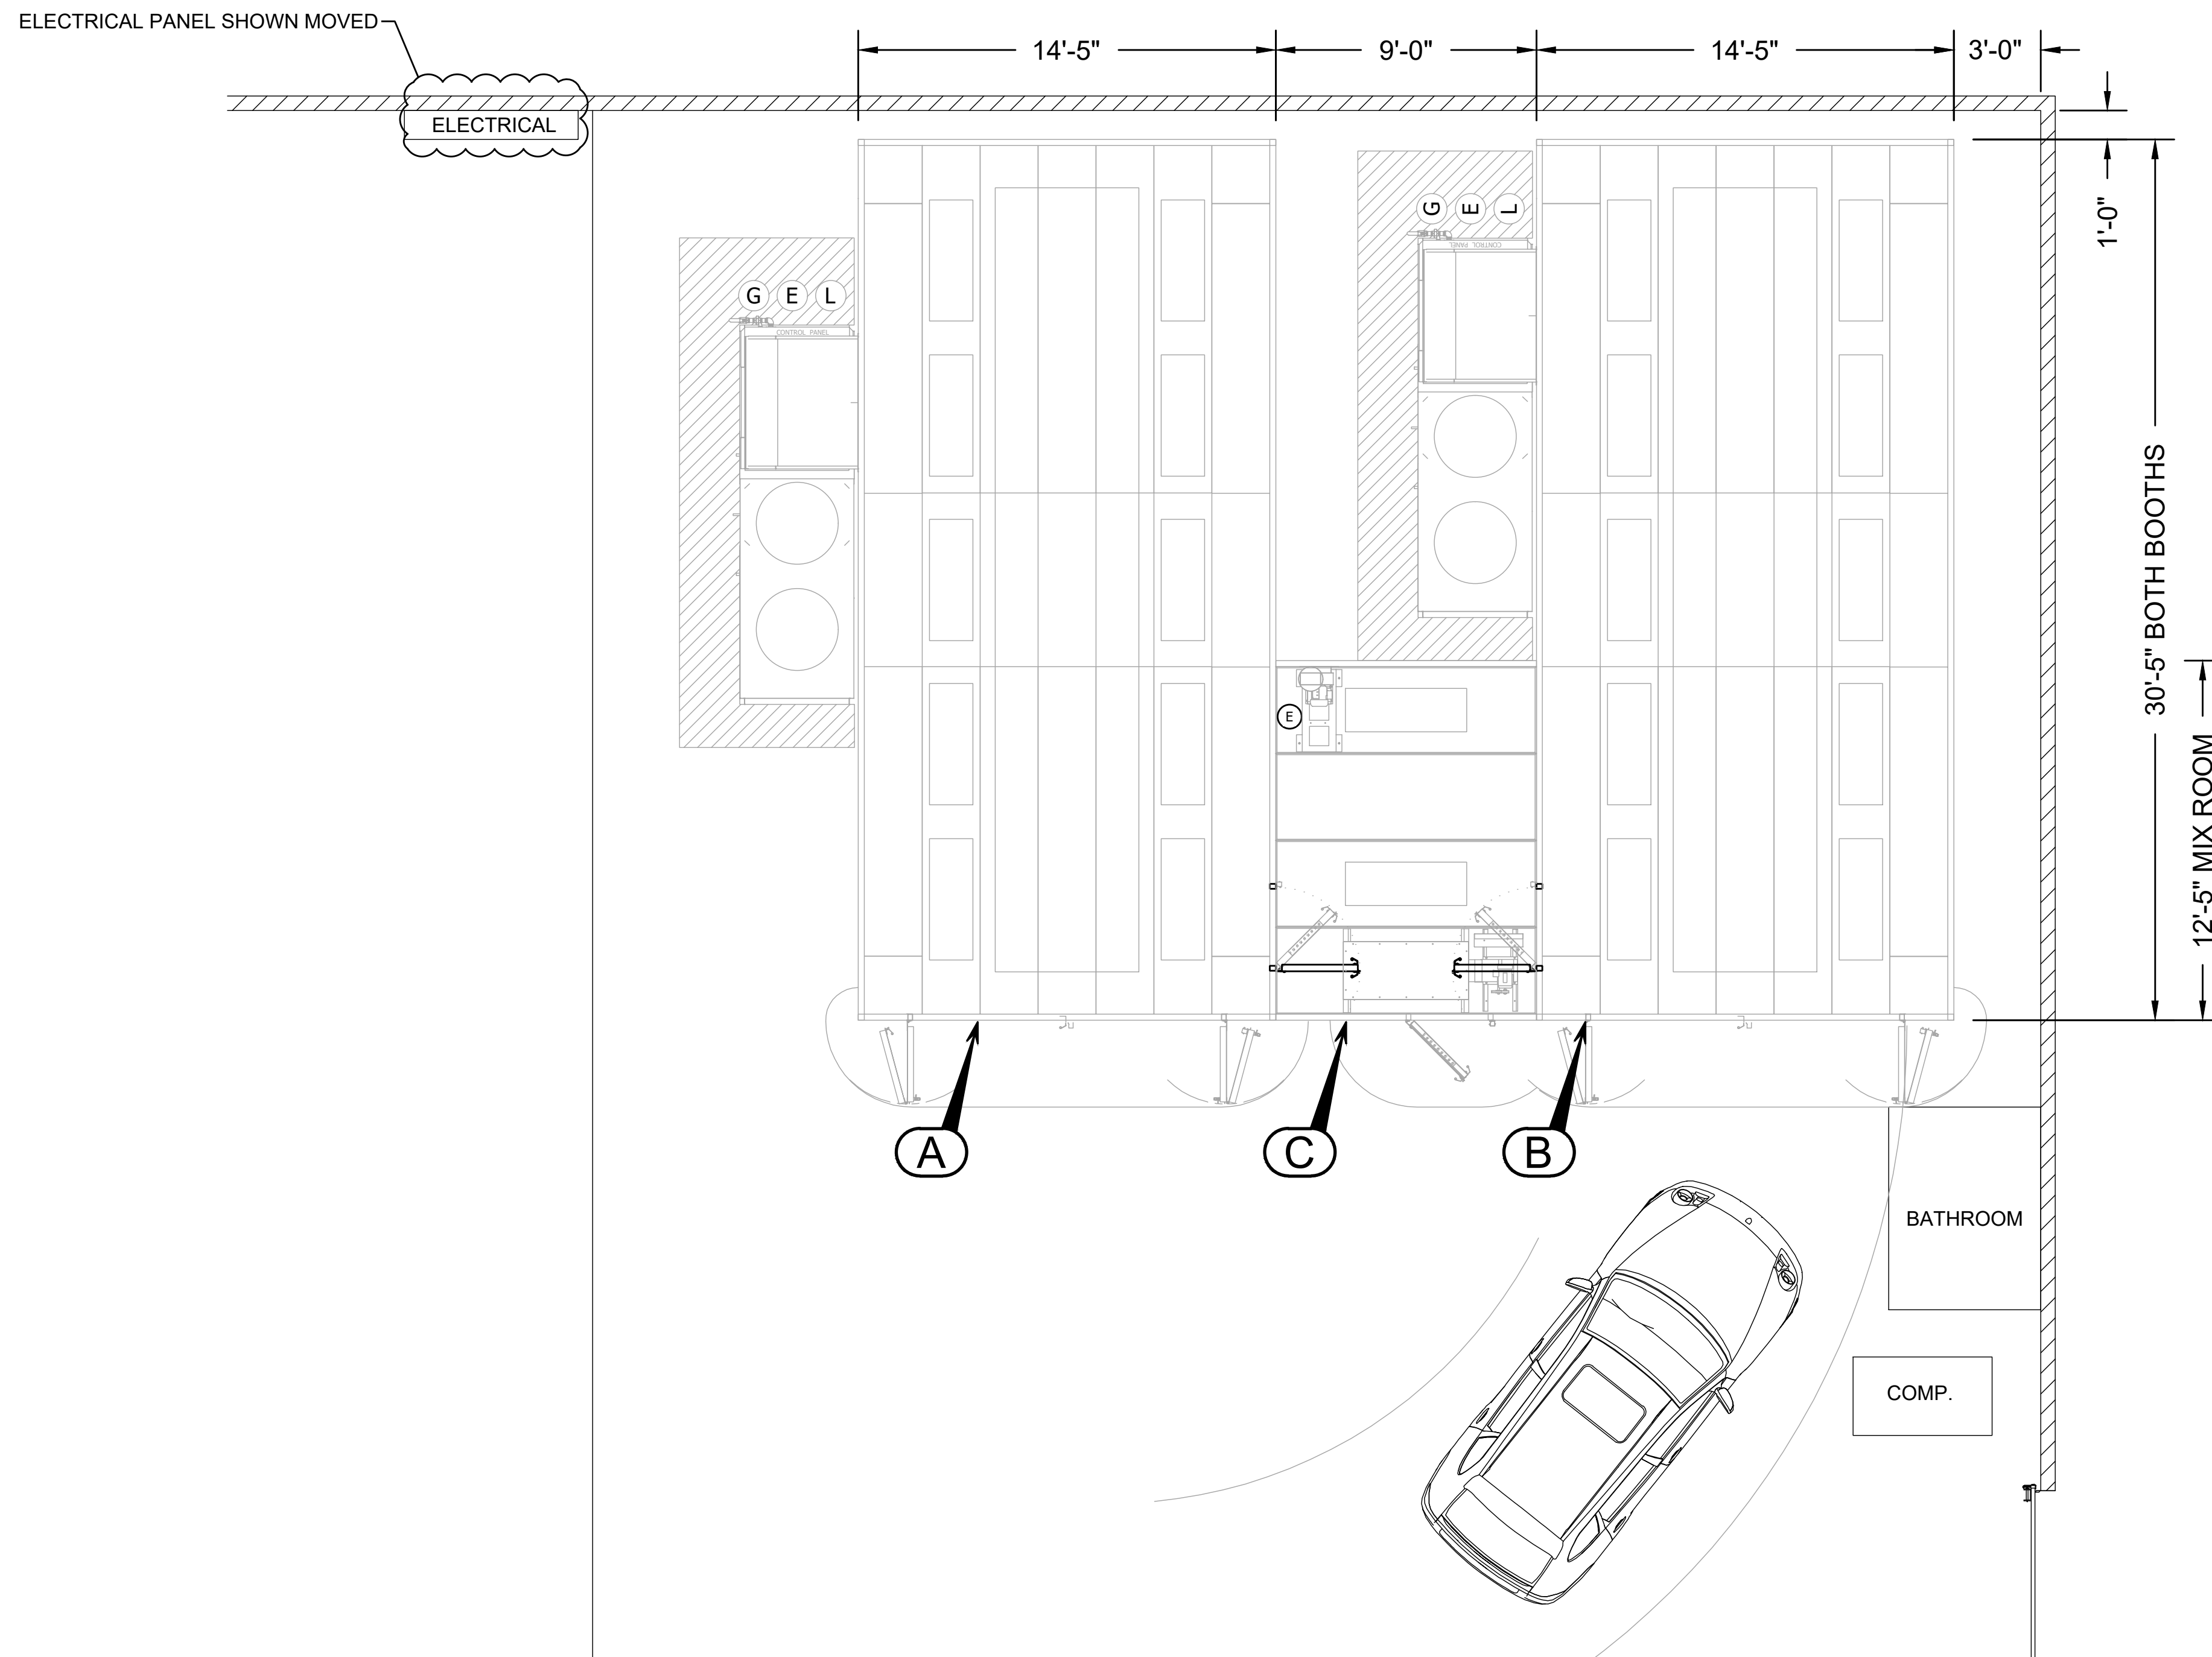


<div><div>A</div><div>ULTRA XL DOWNDRAFT BOOTH 30'L x 14'W x 12'H INSIDE</div></div>	AIR HEATER							MOTOR MINIMUM CIRCUIT CAPACITY						LIGHTING CIRCUIT			<div><div>C</div><div>ULTRA XD MIX ROOM 12'L x 9'W x 9'H INSIDE</div></div>	ELECTRICAL REQUIREMENTS						
	MAX AIR FLOW RATE (CFM)	INTAKE / EXHAUST MOTOR (HP)	FUEL	MAX FIRING RATE (BTU/HR)	MIN INLET PRESS. AT MAX FIRING RATE (INWC)	MAX INLET PRESS. (PSI)	TEMP. RISE (°F)	INLET PIPE SIZE NPT (IN)	MOTOR SPECIFICATIONS		FULL LOAD AMP DRAW /MINIMUM CIRCUIT CAPACITY				QUANTITY OF LIGHT FIXTURES (4-TUBE, 6-TUBE, STD OR LED)	SINGLE PHASE MINIMUM CIRCUIT CAPACITY (AMPS)			ELECTRICAL DEVICE	MOTOR	FULL LOAD AMP DRAW	MINIMUM CIRCUIT CAPACITY		
									15HP INTAKE, 15HP EXHAUST		230V 1PH	208V 3PH	230V 3PH	480V 3PH		575V 3PH								
									NO ADVANCE CURE							44.0 / 55.0								
15205	15 / 15	NATURAL GAS	1512605	13.0	5.0	91	1 1/4							16	30	20	EXHAUST FAN & INTAKE FAN	FAN MOTOR (EACH)	1/2HP, 120V, 1PH	9.8	30 AMP			
		PROPANE	1323529	5.0		80										LIGHT FIXTURES		120V / 277V	1.0 / 0.5 (EACH)					
<div><div>B</div><div>ULTRA XD DOWNDRAFT BOOTH 30'L x 14'W x 9'H INSIDE</div></div>	AIR HEATER							MOTOR MINIMUM CIRCUIT CAPACITY						LIGHTING CIRCUIT										
	MAX AIR FLOW RATE (CFM)	INTAKE / EXHAUST MOTOR (HP)	FUEL	MAX FIRING RATE (BTU/HR)	MIN INLET PRESS. AT MAX FIRING RATE (INWC)	MAX INLET PRESS. (PSI)	TEMP. RISE (°F)	INLET PIPE SIZE NPT (IN)	MOTOR SPECIFICATIONS		FULL LOAD AMP DRAW /MINIMUM CIRCUIT CAPACITY				QUANTITY OF LIGHT FIXTURES (4-TUBE, 6-TUBE, STD OR LED)	SINGLE PHASE MINIMUM CIRCUIT CAPACITY (AMPS)								
									15HP INTAKE, 15HP EXHAUST		230V 1PH	208V 3PH	230V 3PH	480V 3PH		575V 3PH								
									NO ADVANCE CURE							44.0 / 55.0								
15205	15 / 15	NATURAL GAS	1512605	13.0	5.0	91	1 1/4							16	30	20								
		PROPANE	1323529	5.0		80																		

**CASE**  
**Engineering Inc.**

796 Main Court  
St. Louis, MO 63026  
T 636.549.1600  
F 636.549.1730  
CERTIFICATE OF AUTHORITY NO. 001498

**544 MAE COURT  
FENTON, MO 63026**

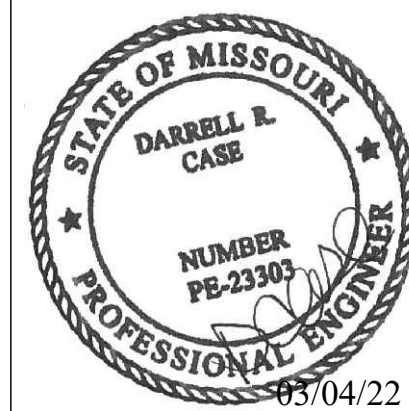

**CRASH CHAMPIONS -LEE SUMMIT**  
**PAINT BOOTH**  
**451 SE OLDHAM PKWY**  
**LEE SUMMIT, MO 64081**

[illegible]

## PAINT BOOTH SPECIFICATIONS

Project #
Issue Date
Drawn by
Checked by
<b>M5</b>
Scale