




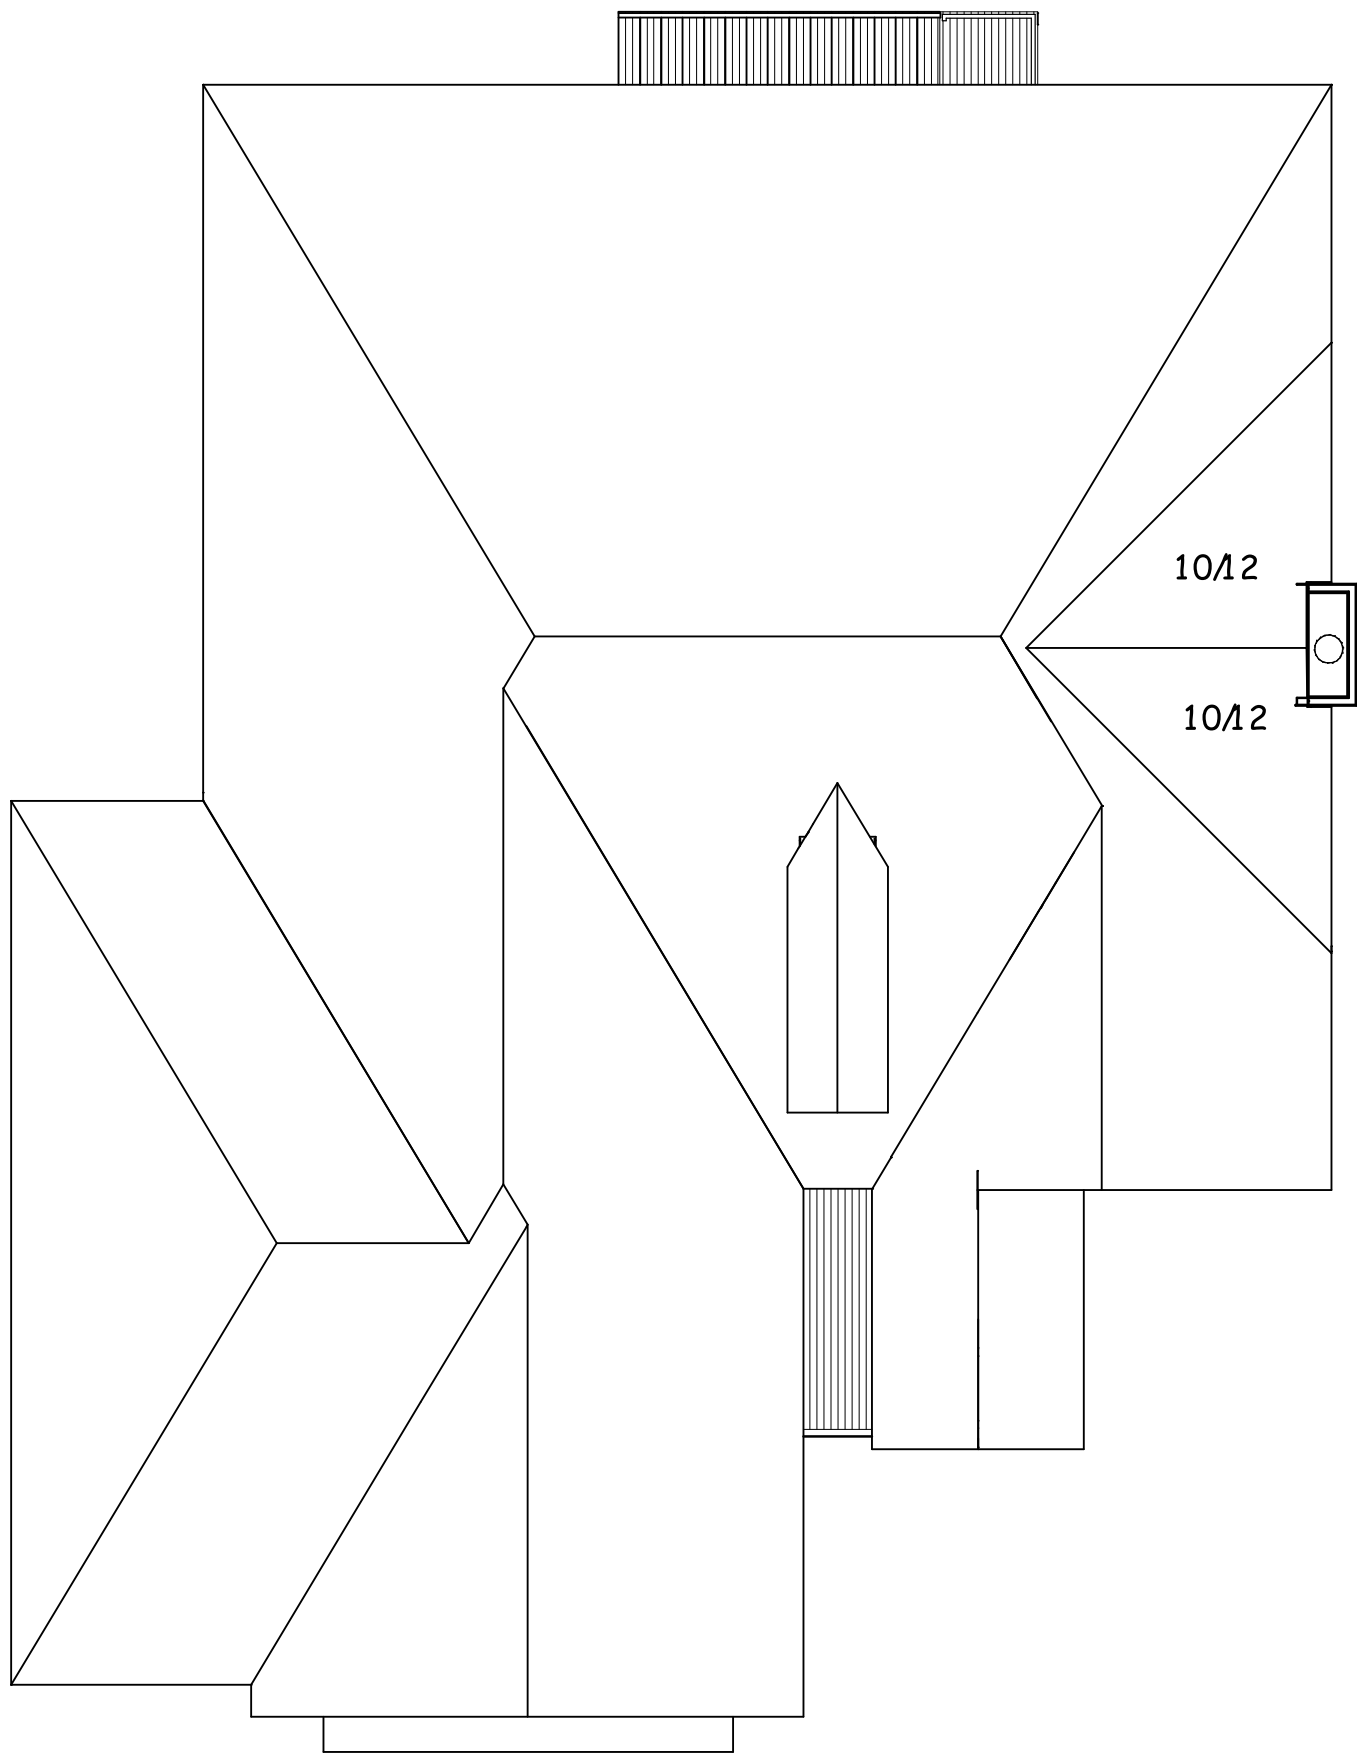

ROOF PLAN
1/8 = 1-0
ROOF PITCHES FRONT TO BACK 6/12 TYP. U.N.O.
ROOF PITCHES SIDE TO SIDE 10/12 TYP. U.N.O
RAFTERS 2 X 6 DF NO 2 @ 16" OC TYP.
HIPS AND RIDGES 2 X 8 DF NO 2 TYP.

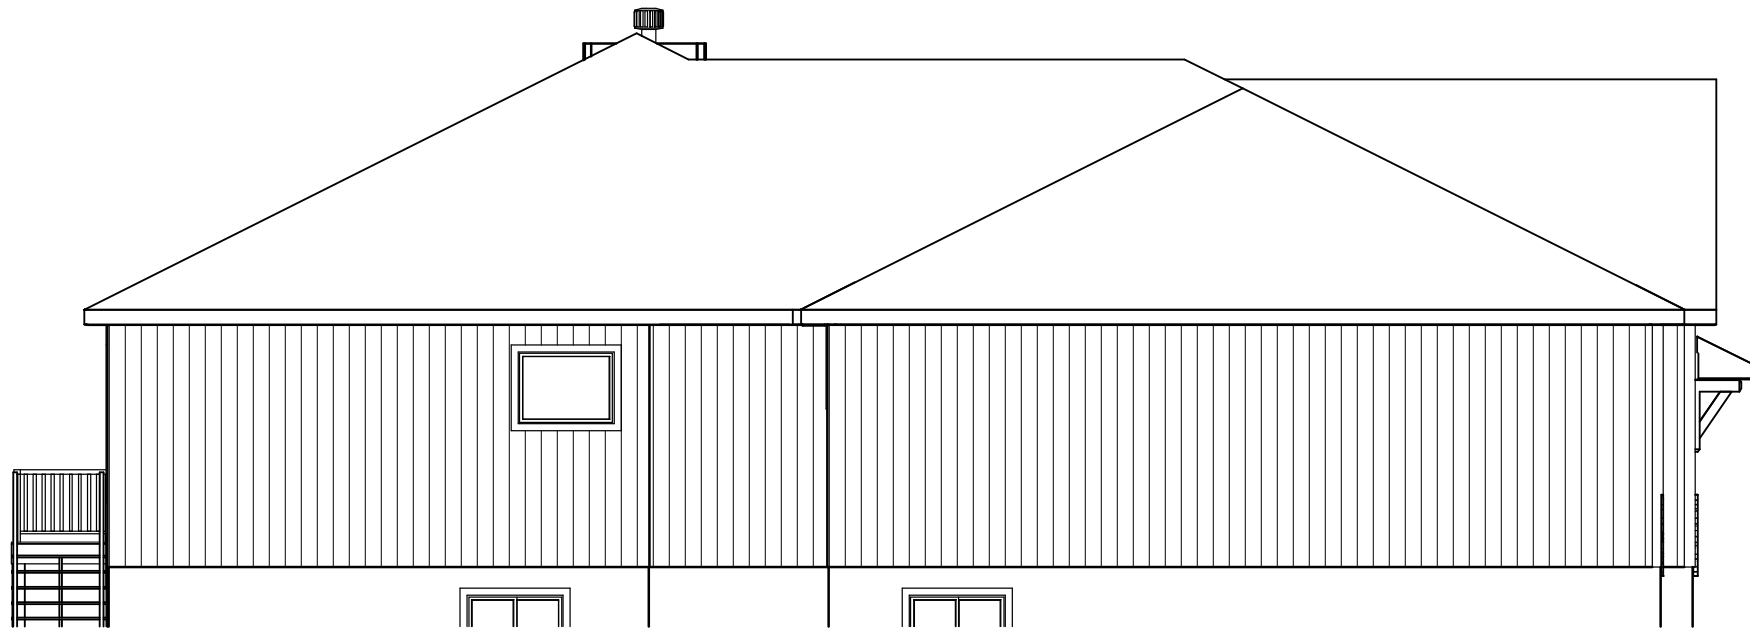


LEFT ELEVATION
1/8 = 1-0

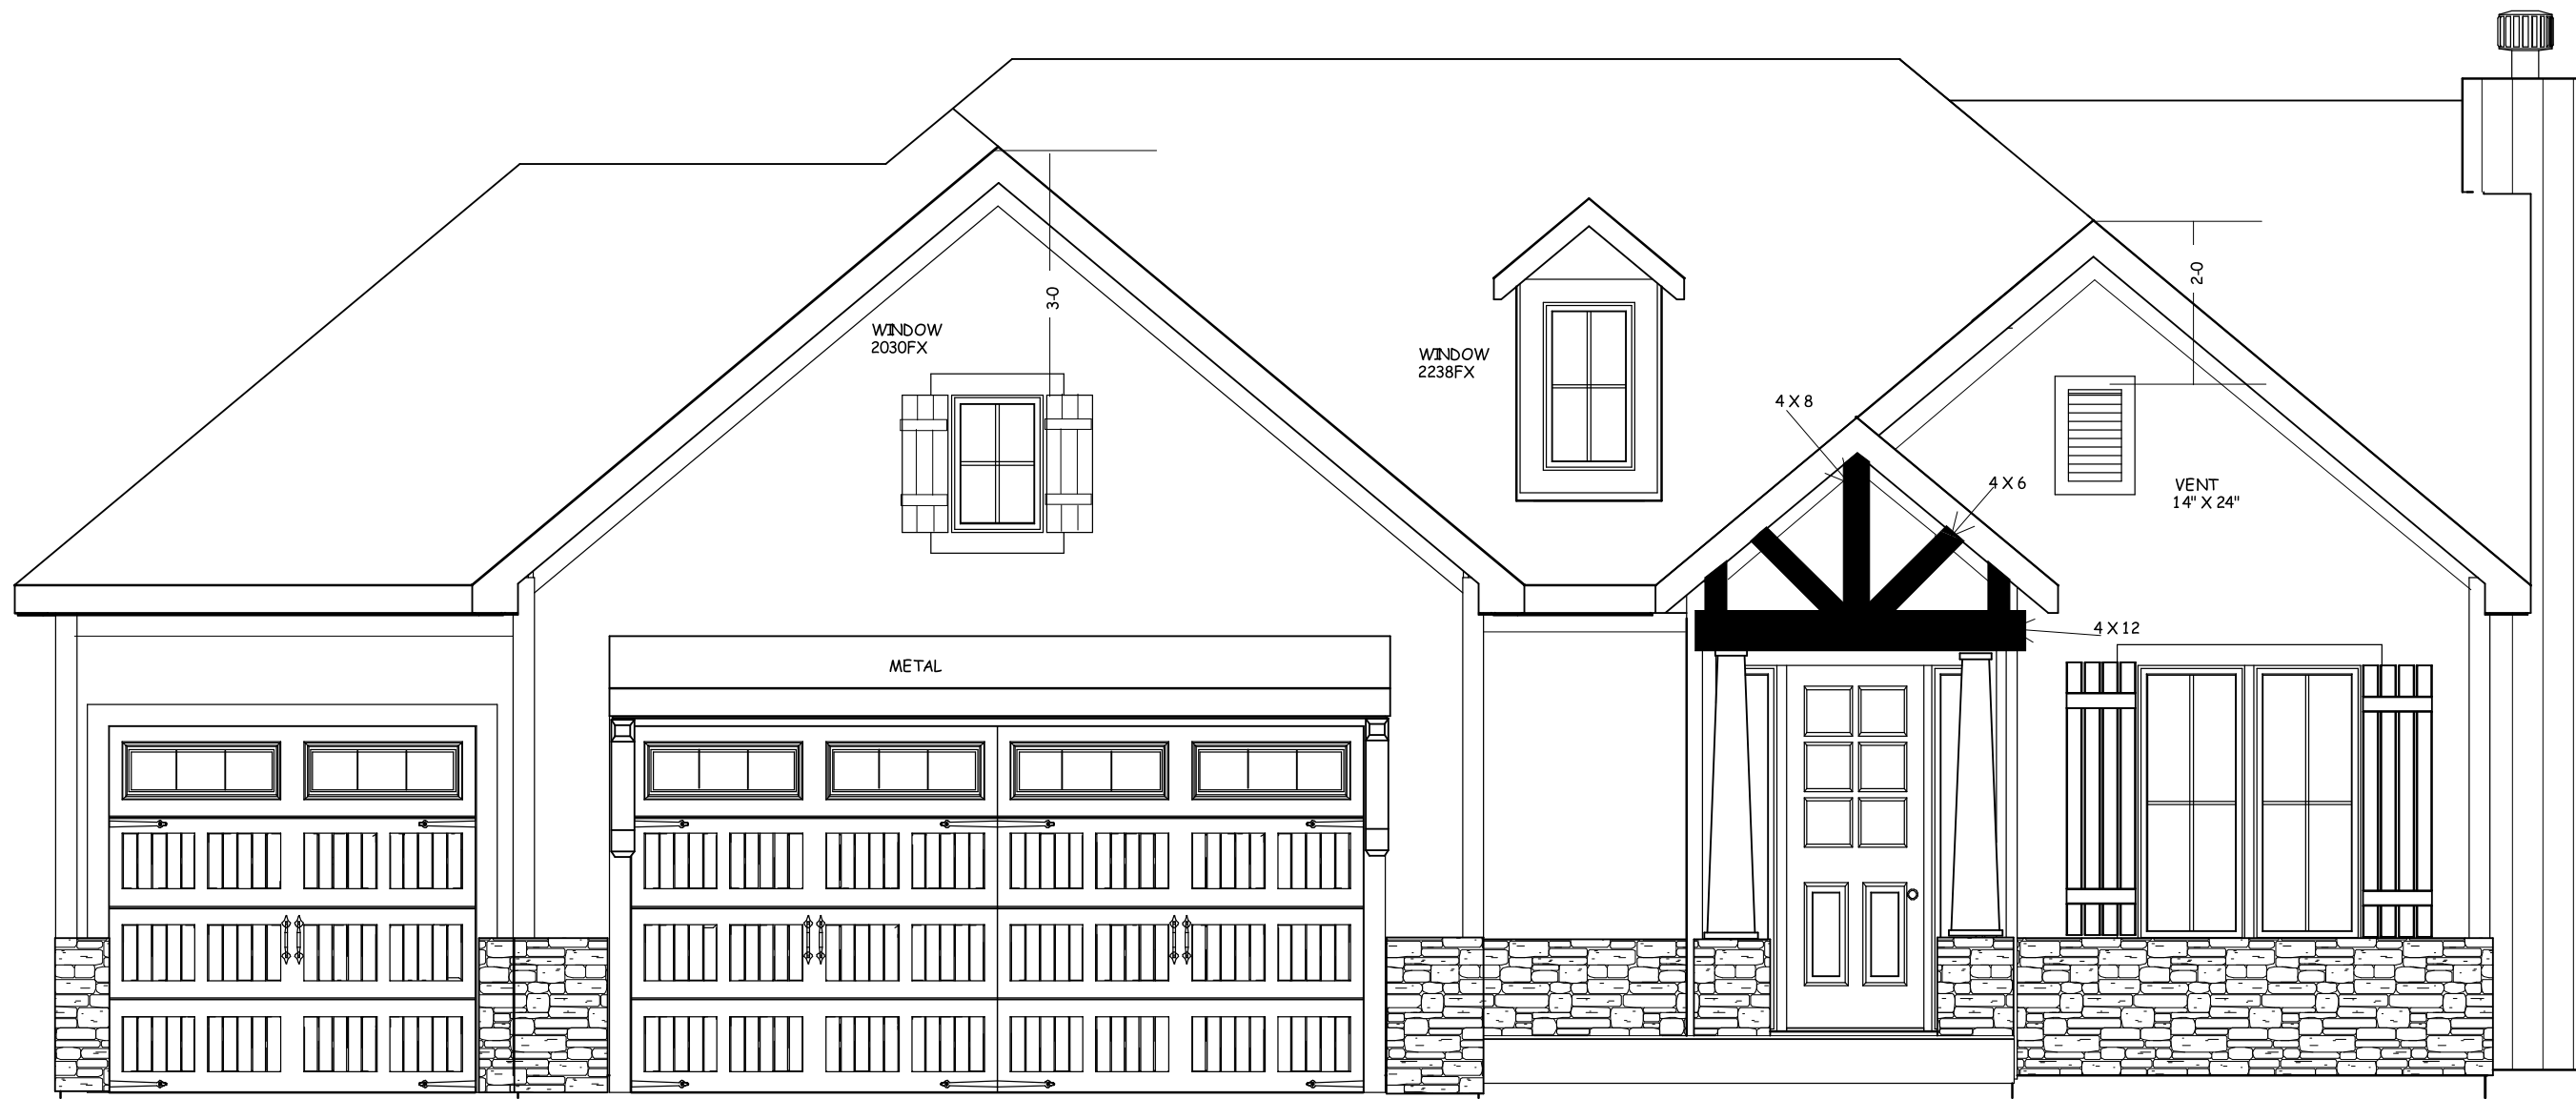

FRONT ELEVATION " A "
STUCCO AND STONE




REAR ELEVATION
1/8 = 1-0

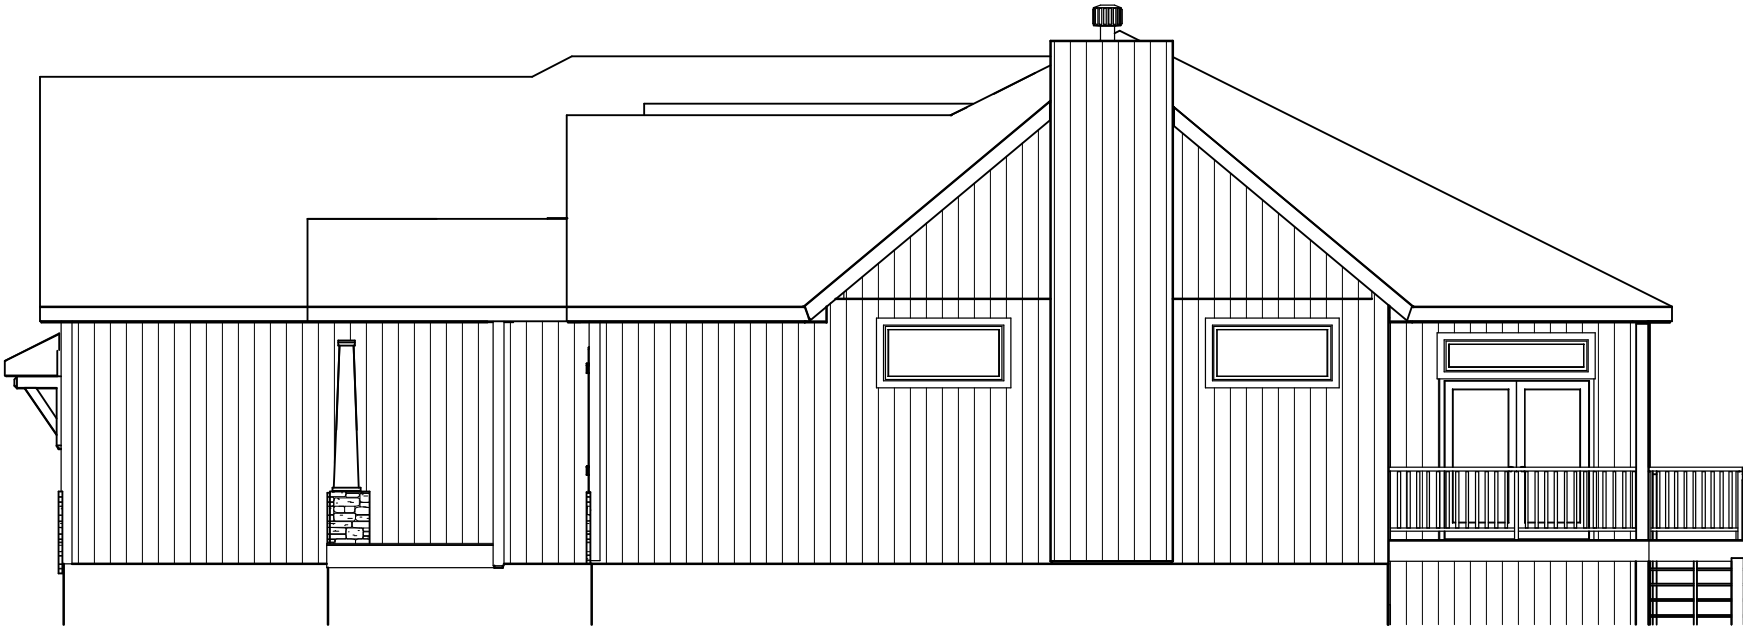

RIGHT ELEVATION
1/8 = 1-0

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
06/14/2022

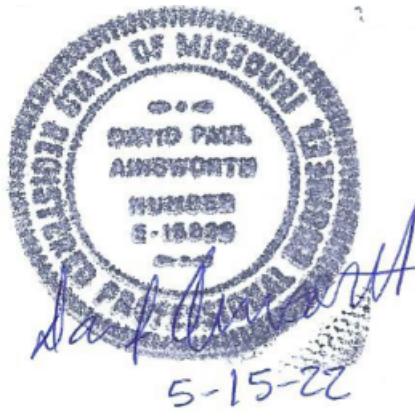

BUILD IN ACCORDANCE WITH
2018 INTERNATIONAL
RESIDENTIAL CODE AND
LOCAL CODES.



TRUMARK HOMES
KYLE III
ELEVATION A
LOT 195 WINTER SIDE RIDGE
2225 KILLARNEY LN
LEE SUMMIT MO

SCALE
1/4" = 1-0

DATE
5-12-22

PLAN NO.
3821

SHEET NO.
1 OF 5

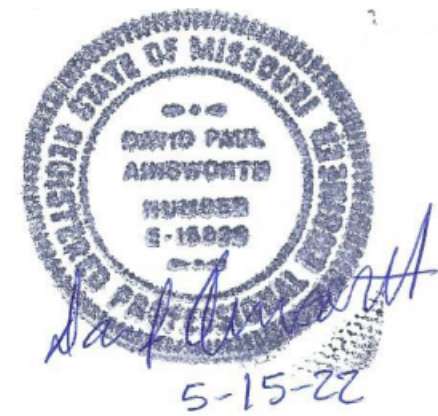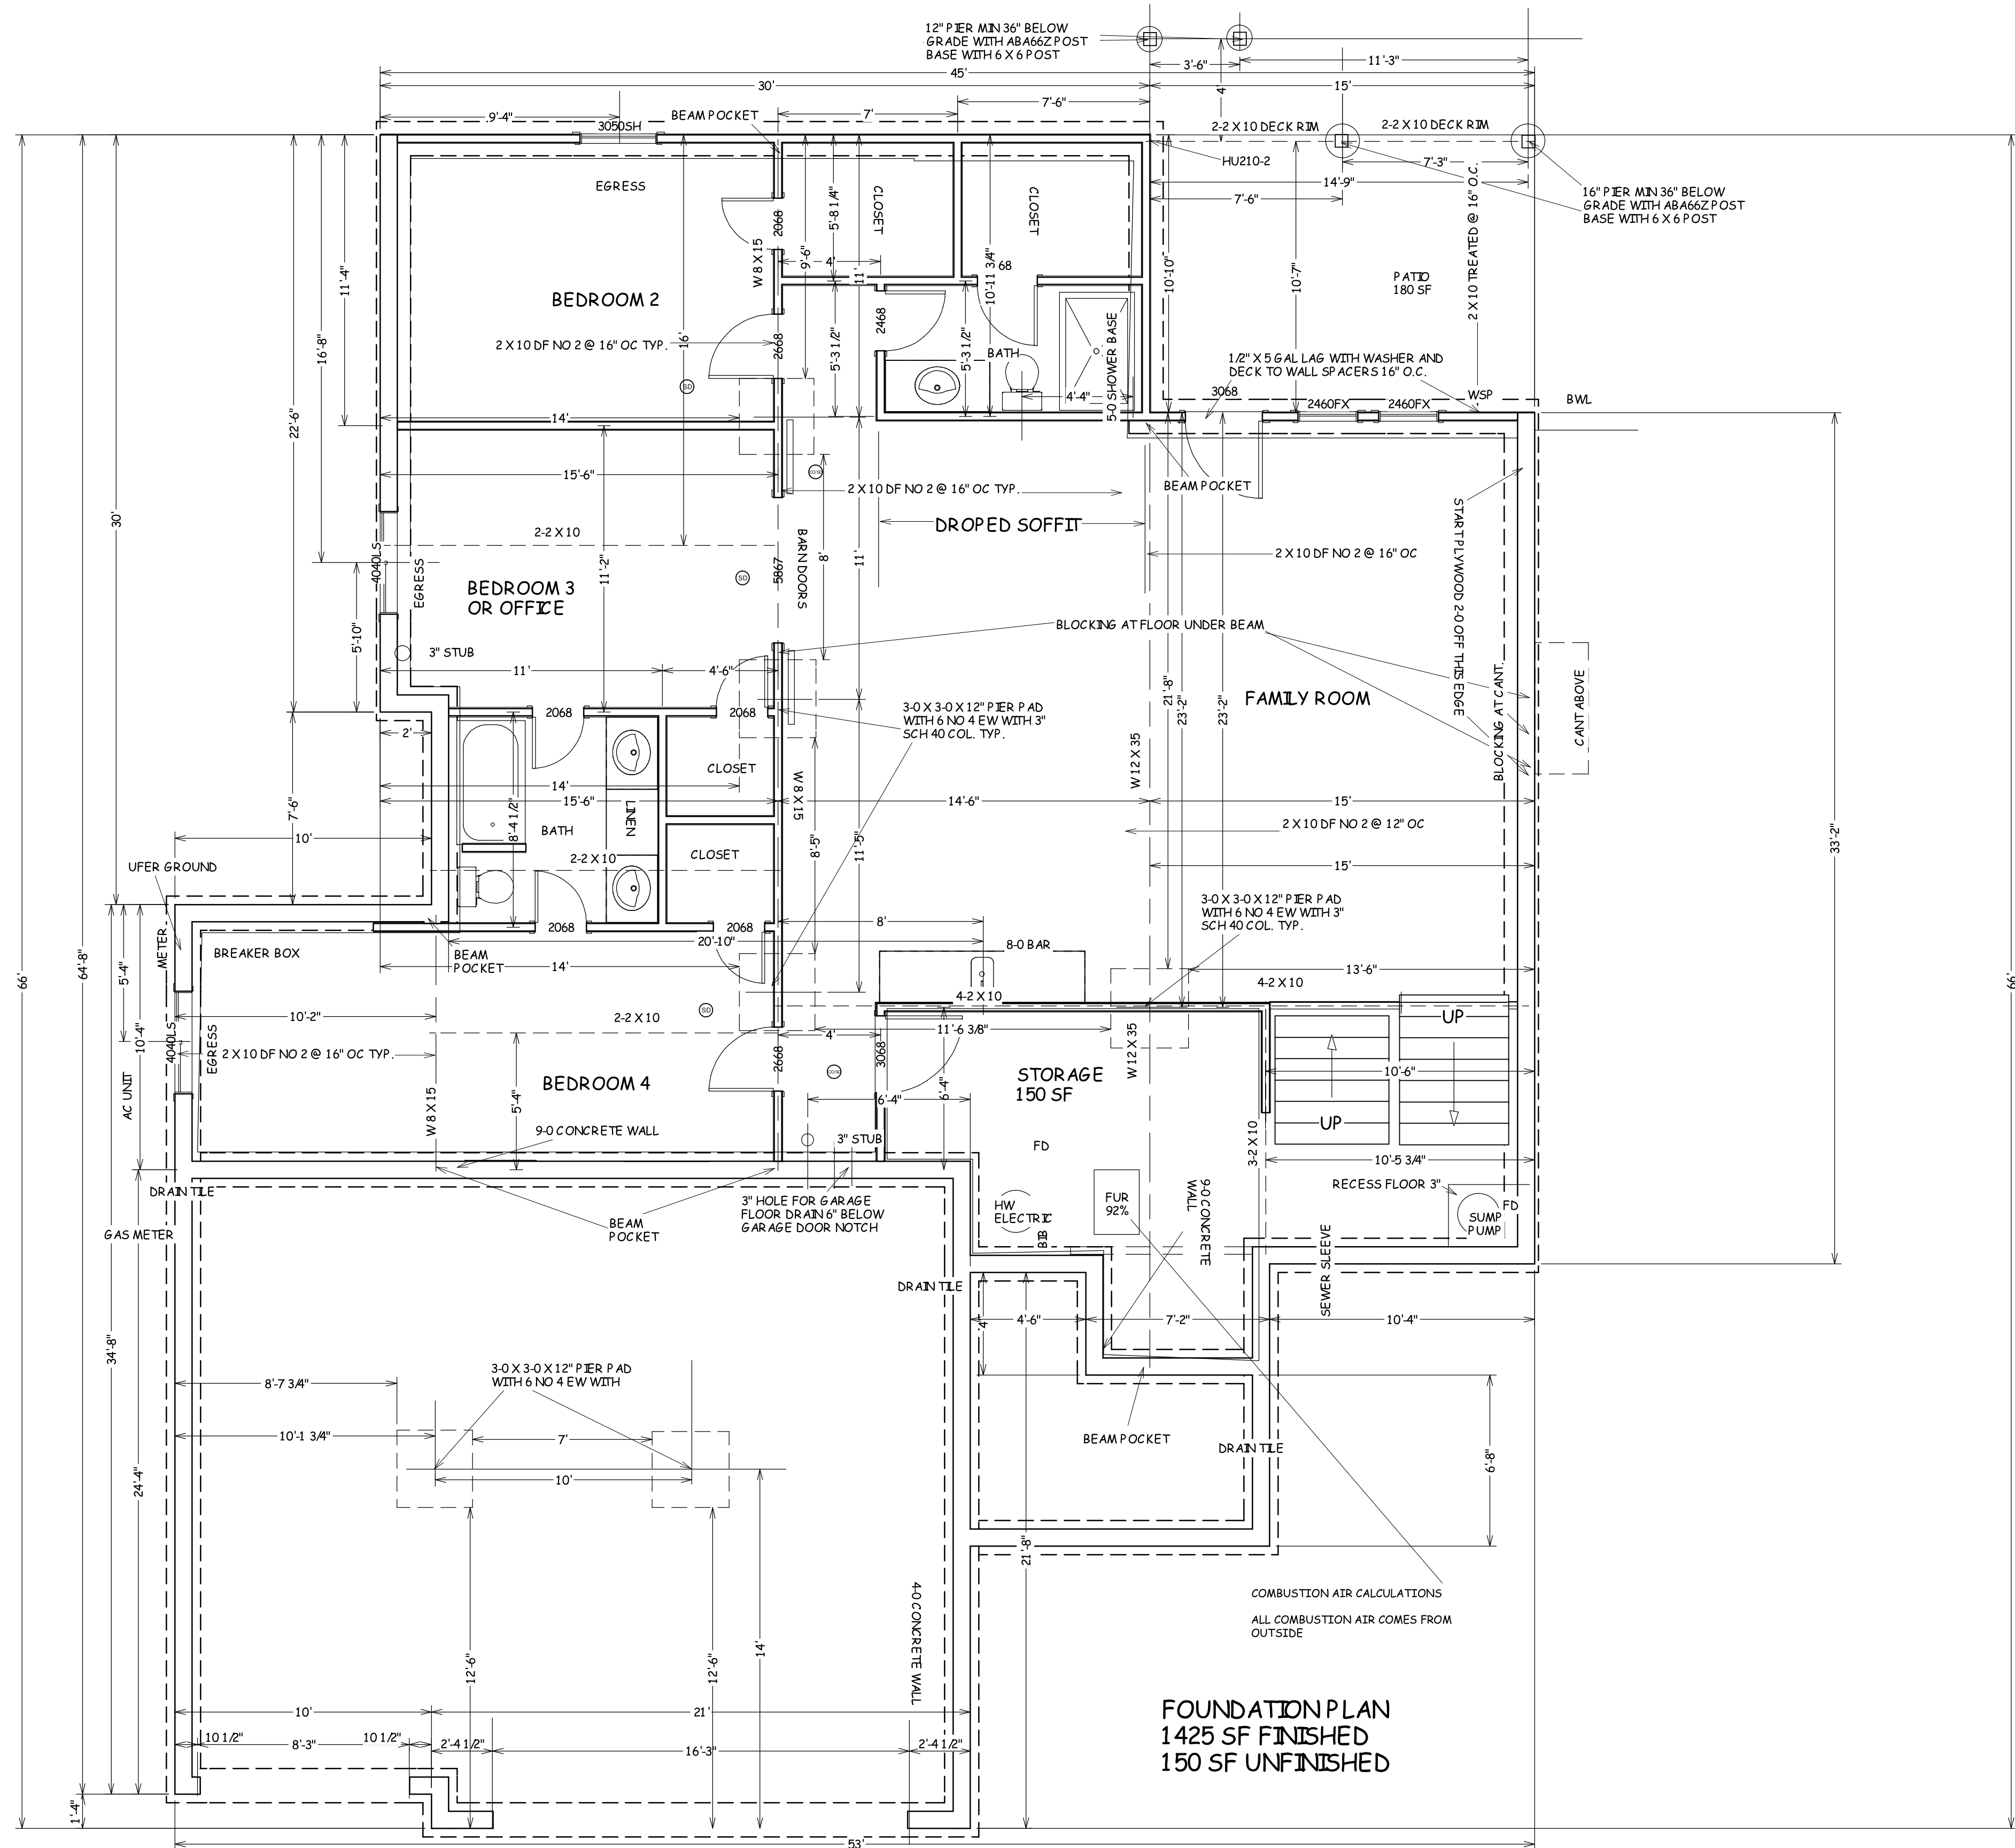

BUILD IN ACCORDANCE WITH
2018 INTERNATIONAL
RESIDENTIAL CODE AND
LOCAL CODES.

TRUMARK HOMES
KYLE III
ELEVATION A
LOT 195 WINTERSIDE RIDGE
2225 KILLARNEY LN
LEE SUMMIT MO

SCALE
1/4" = 1'-0"

DATE
5-12-22


PLAN NO.
3821

SHEET NO.



2 OF 5

RELEASE FOR CONSTRUCTION
NOT TO BE USED FOR PLAN REVIEW
OR FOR ANY OTHER PURPOSES
LEE'S SUMMIT, MISSOURI
06/14/2022

TYPICAL EXTERIOR CORNER FILE CORNER WITH STUDS

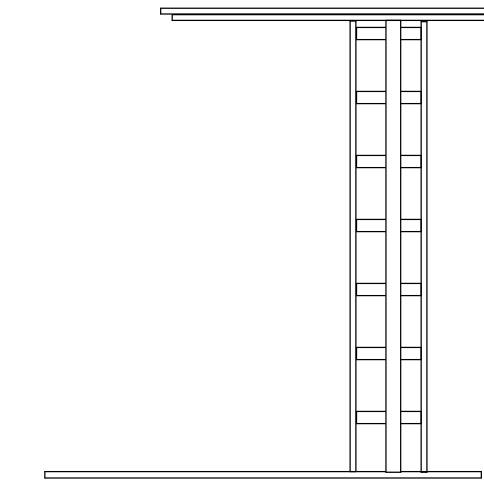

LADDER BLOCK WHERE INTERIOR WALLS INTERSECT WITH EXTERIOR WALLS

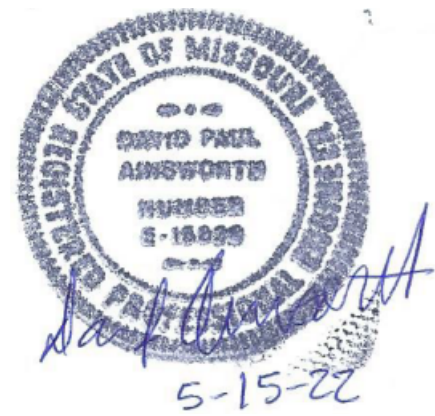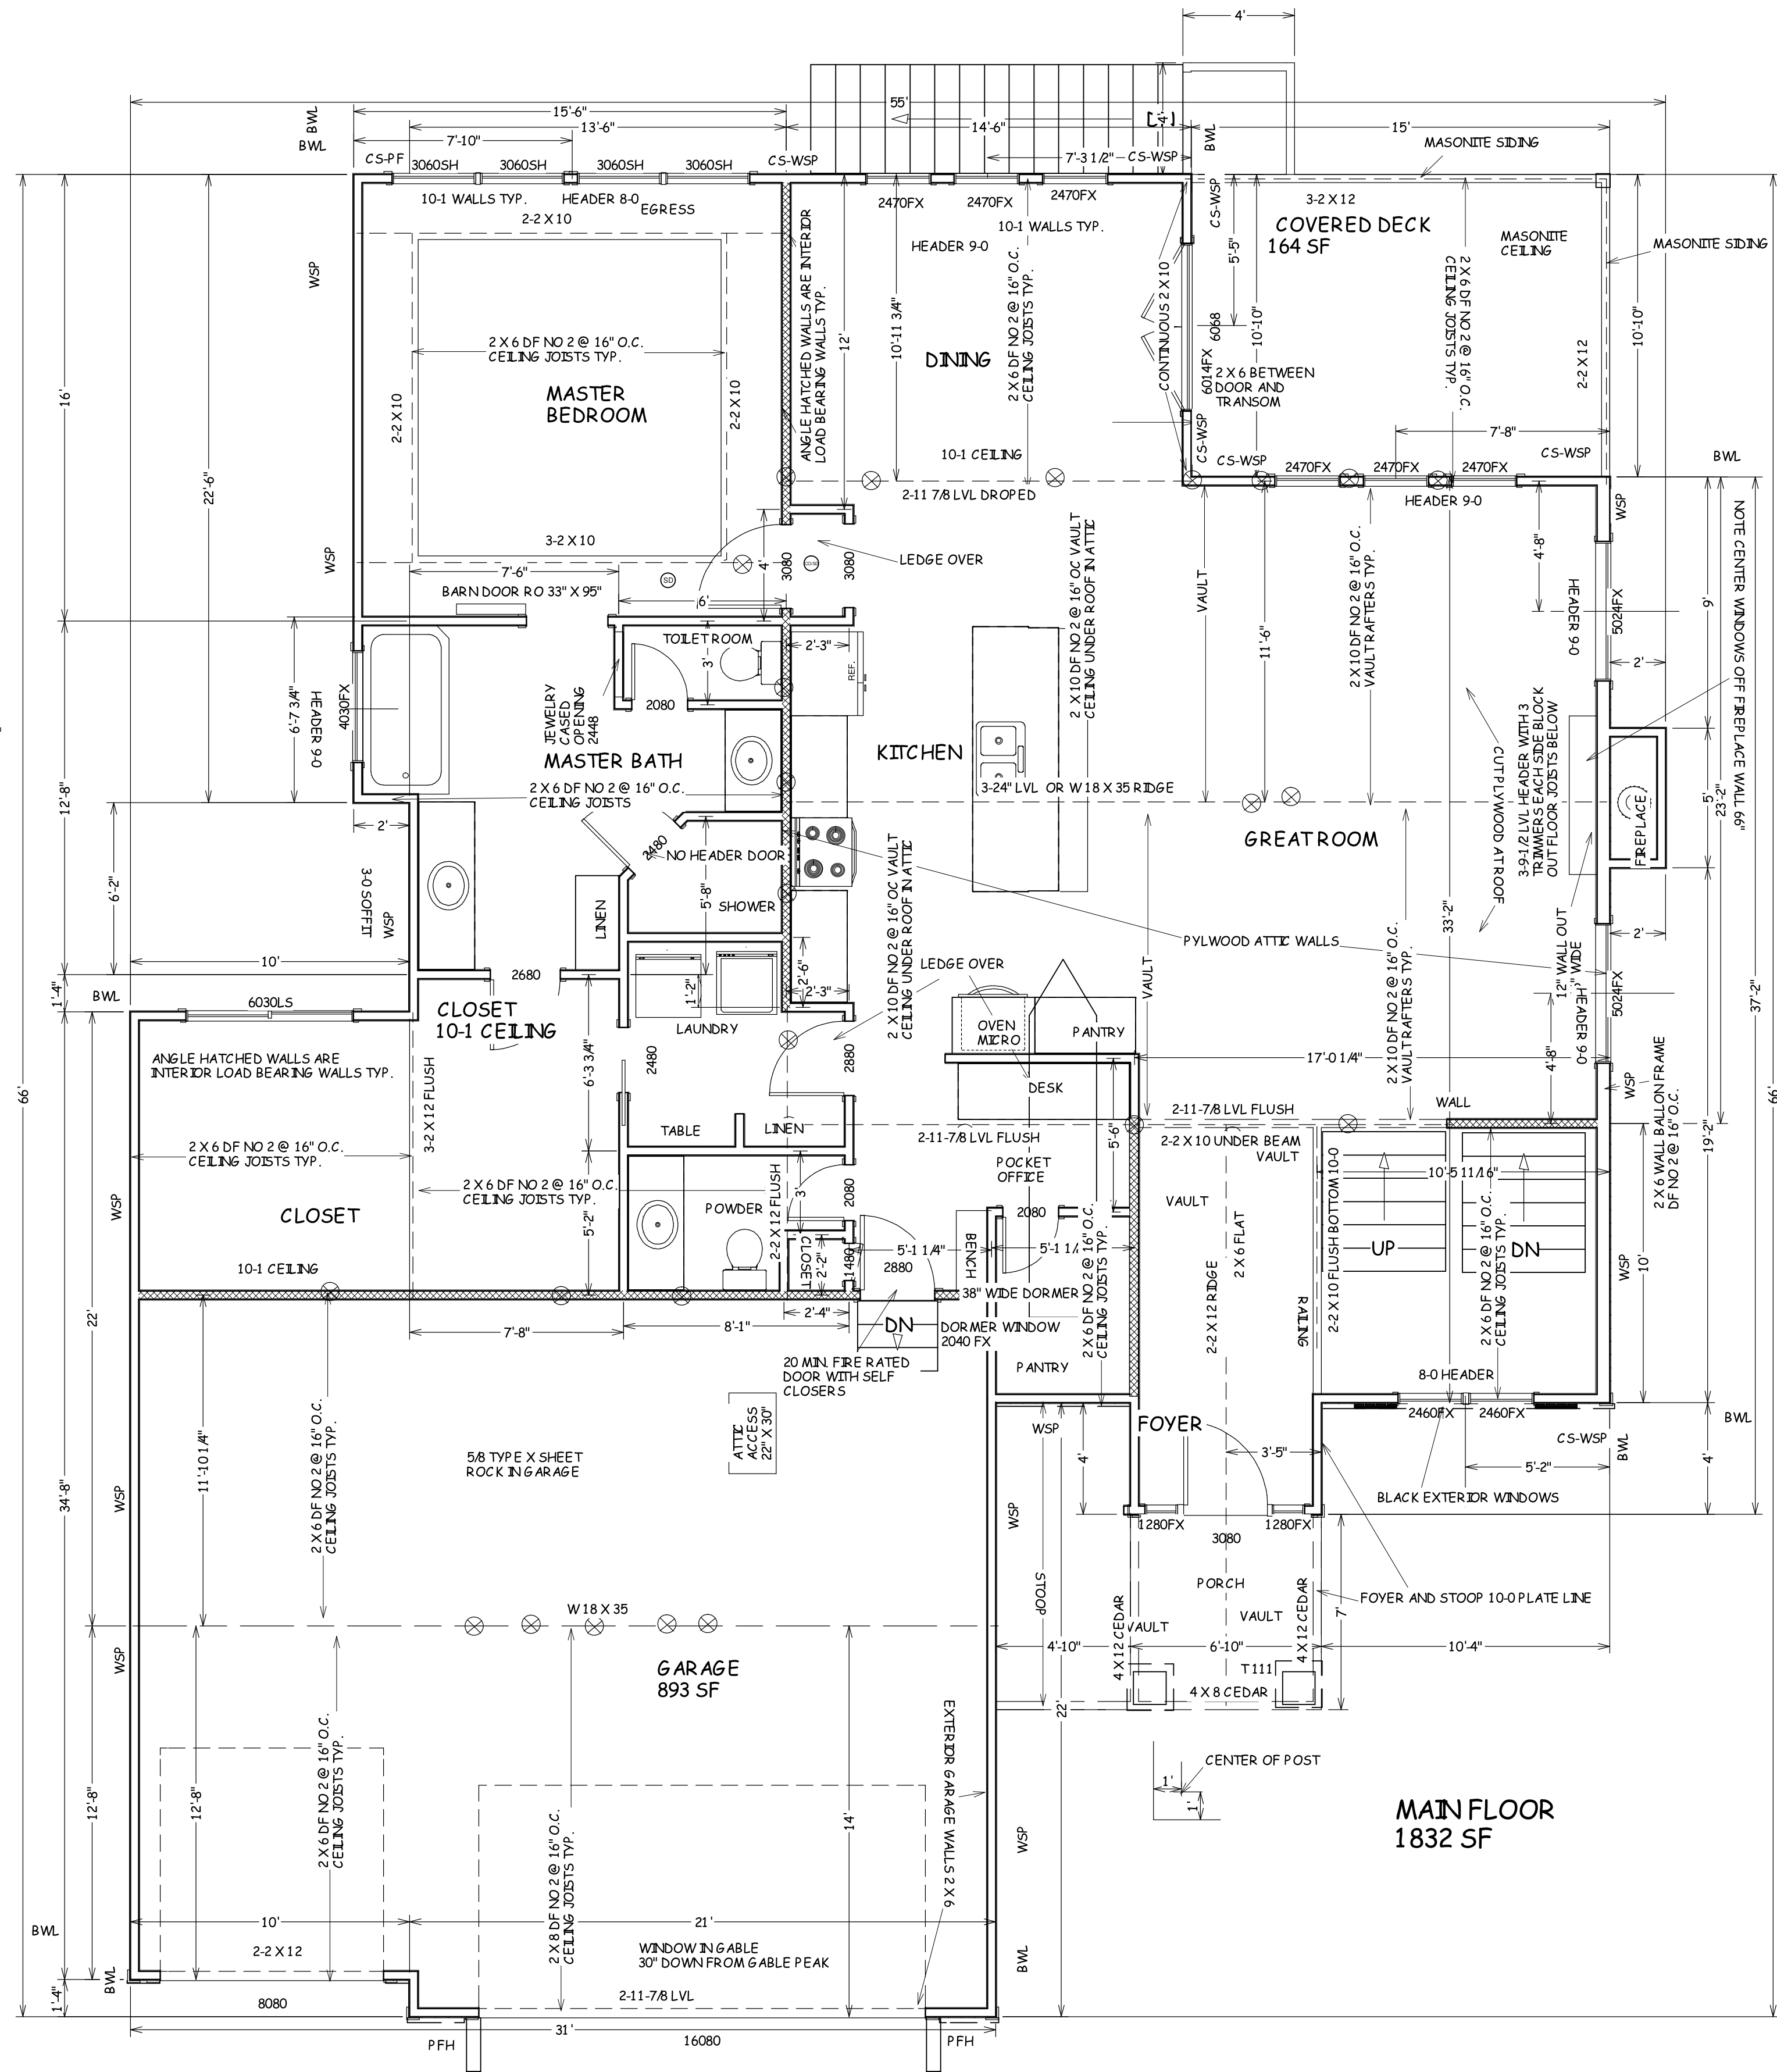

TRUMARK HOMES
KYLE III
ELEVATION A
LOT 195 WATERSIDE RIDGE
2225 KILLARNEY LN
LEE SUMMIT MO

BUILD IN ACCORDANCE WITH
2018 INTERNATIONAL
RESIDENTIAL CODE AND
LOCAL CODES.

SCALE
1/4" = 1-0

DATE
5-12-22

PLAN NO.
3821

SHEET NO.
3 OF 5

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI

06/14/2022

ENERGY CONSERVATION CODE
THE FOLLOWING VALUES ARE NEEDED.

R-15 IN WALLS

R-49 IN ATTICS

R-38 IN VAULTS
R-30 REDUCTION FOR VAULTS IS ONLY FOR 500 SF
PF AREA

R-19 IN FLOORS OVER UNCONDITIONED SPACES



R-10 IN CRAWL SPACE WALLS

BASEMENT WALLS R-13 CAVITY OR R-10 CONTINUOUS


SLABS SHALL BE R-10 FOR A DEPTH OF 2 FOOT

A WINDOW U FACTOR OF .35 OR BETTER

DUCTWORK NEEDS TO HAVE AN R-8 VALUE

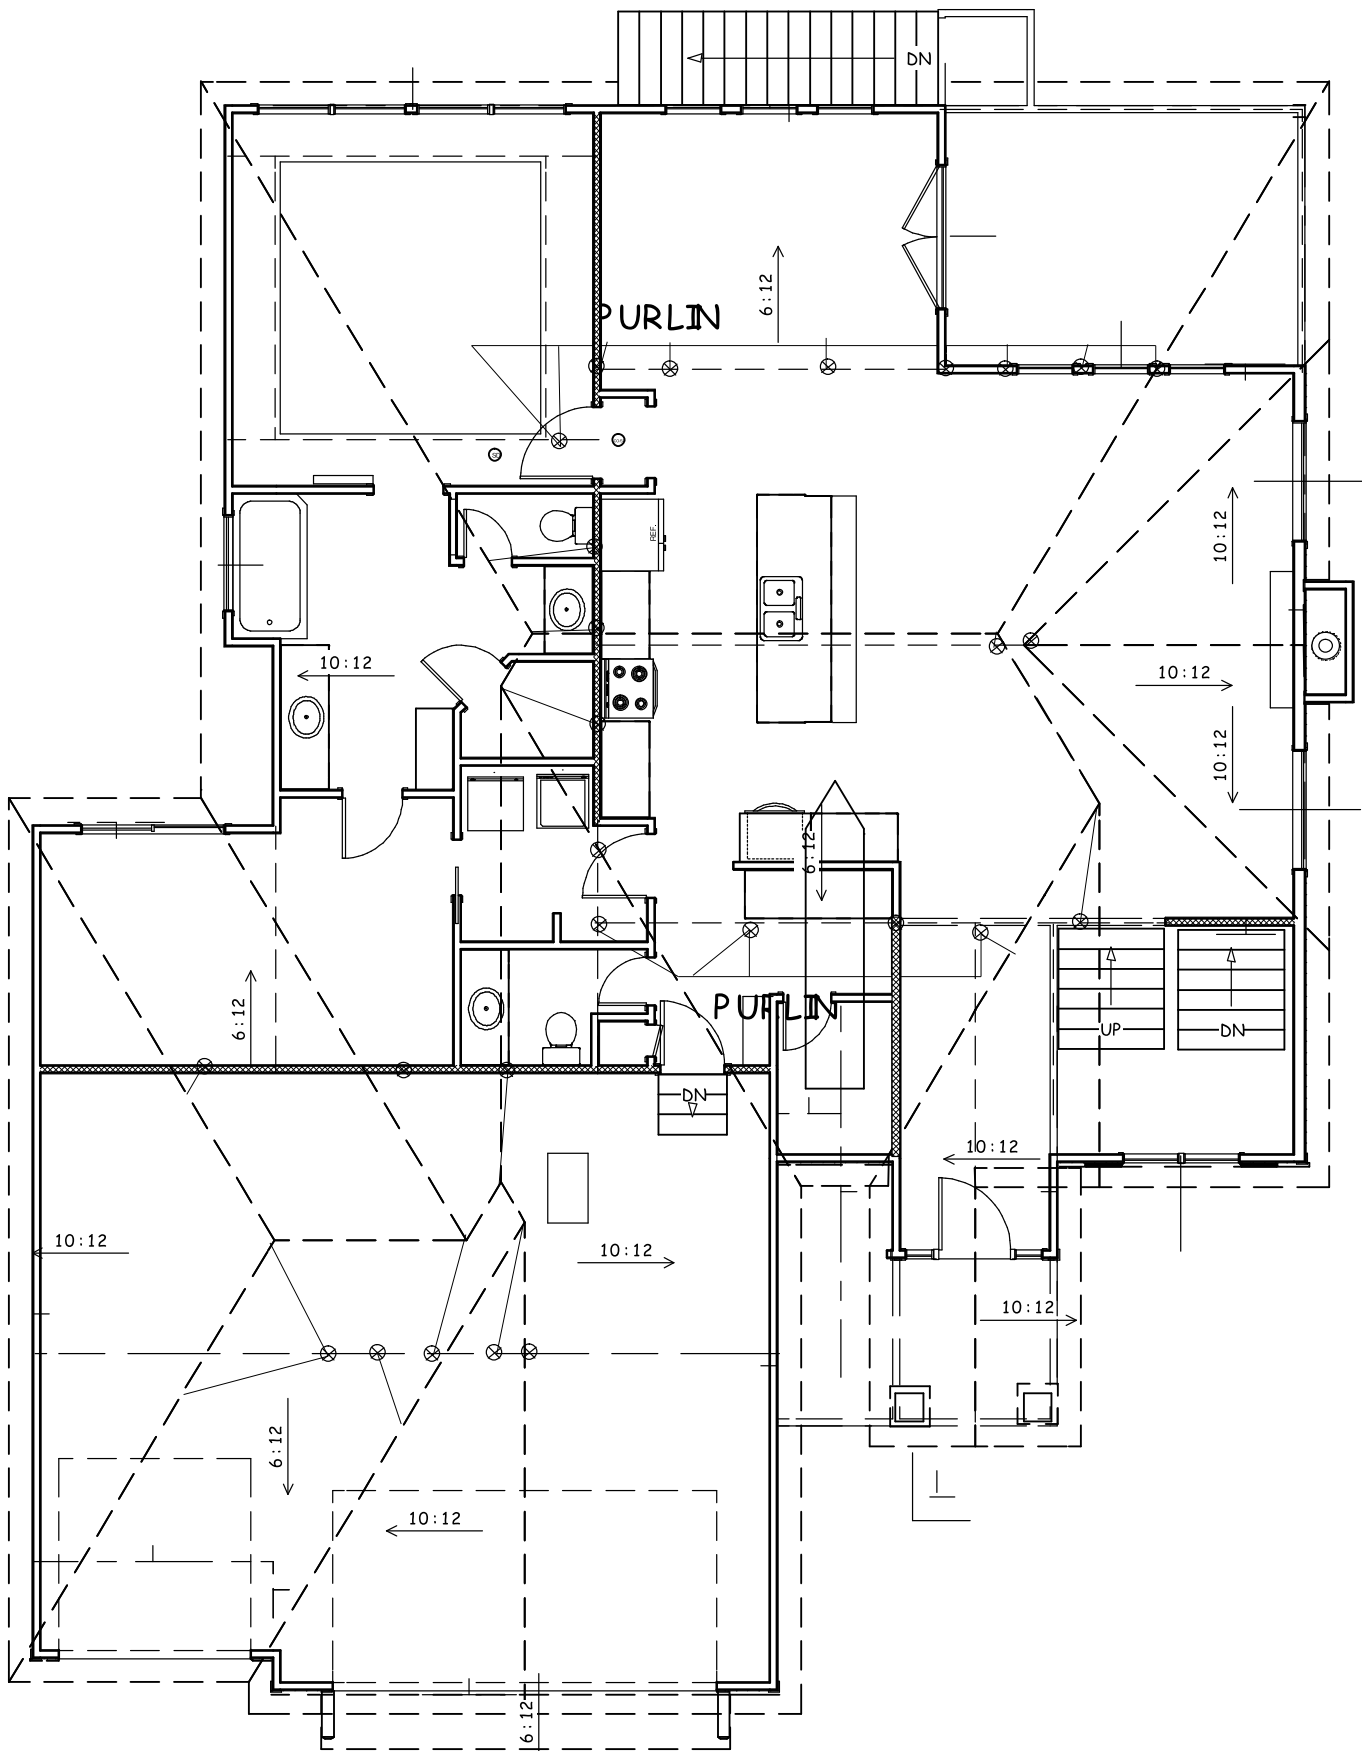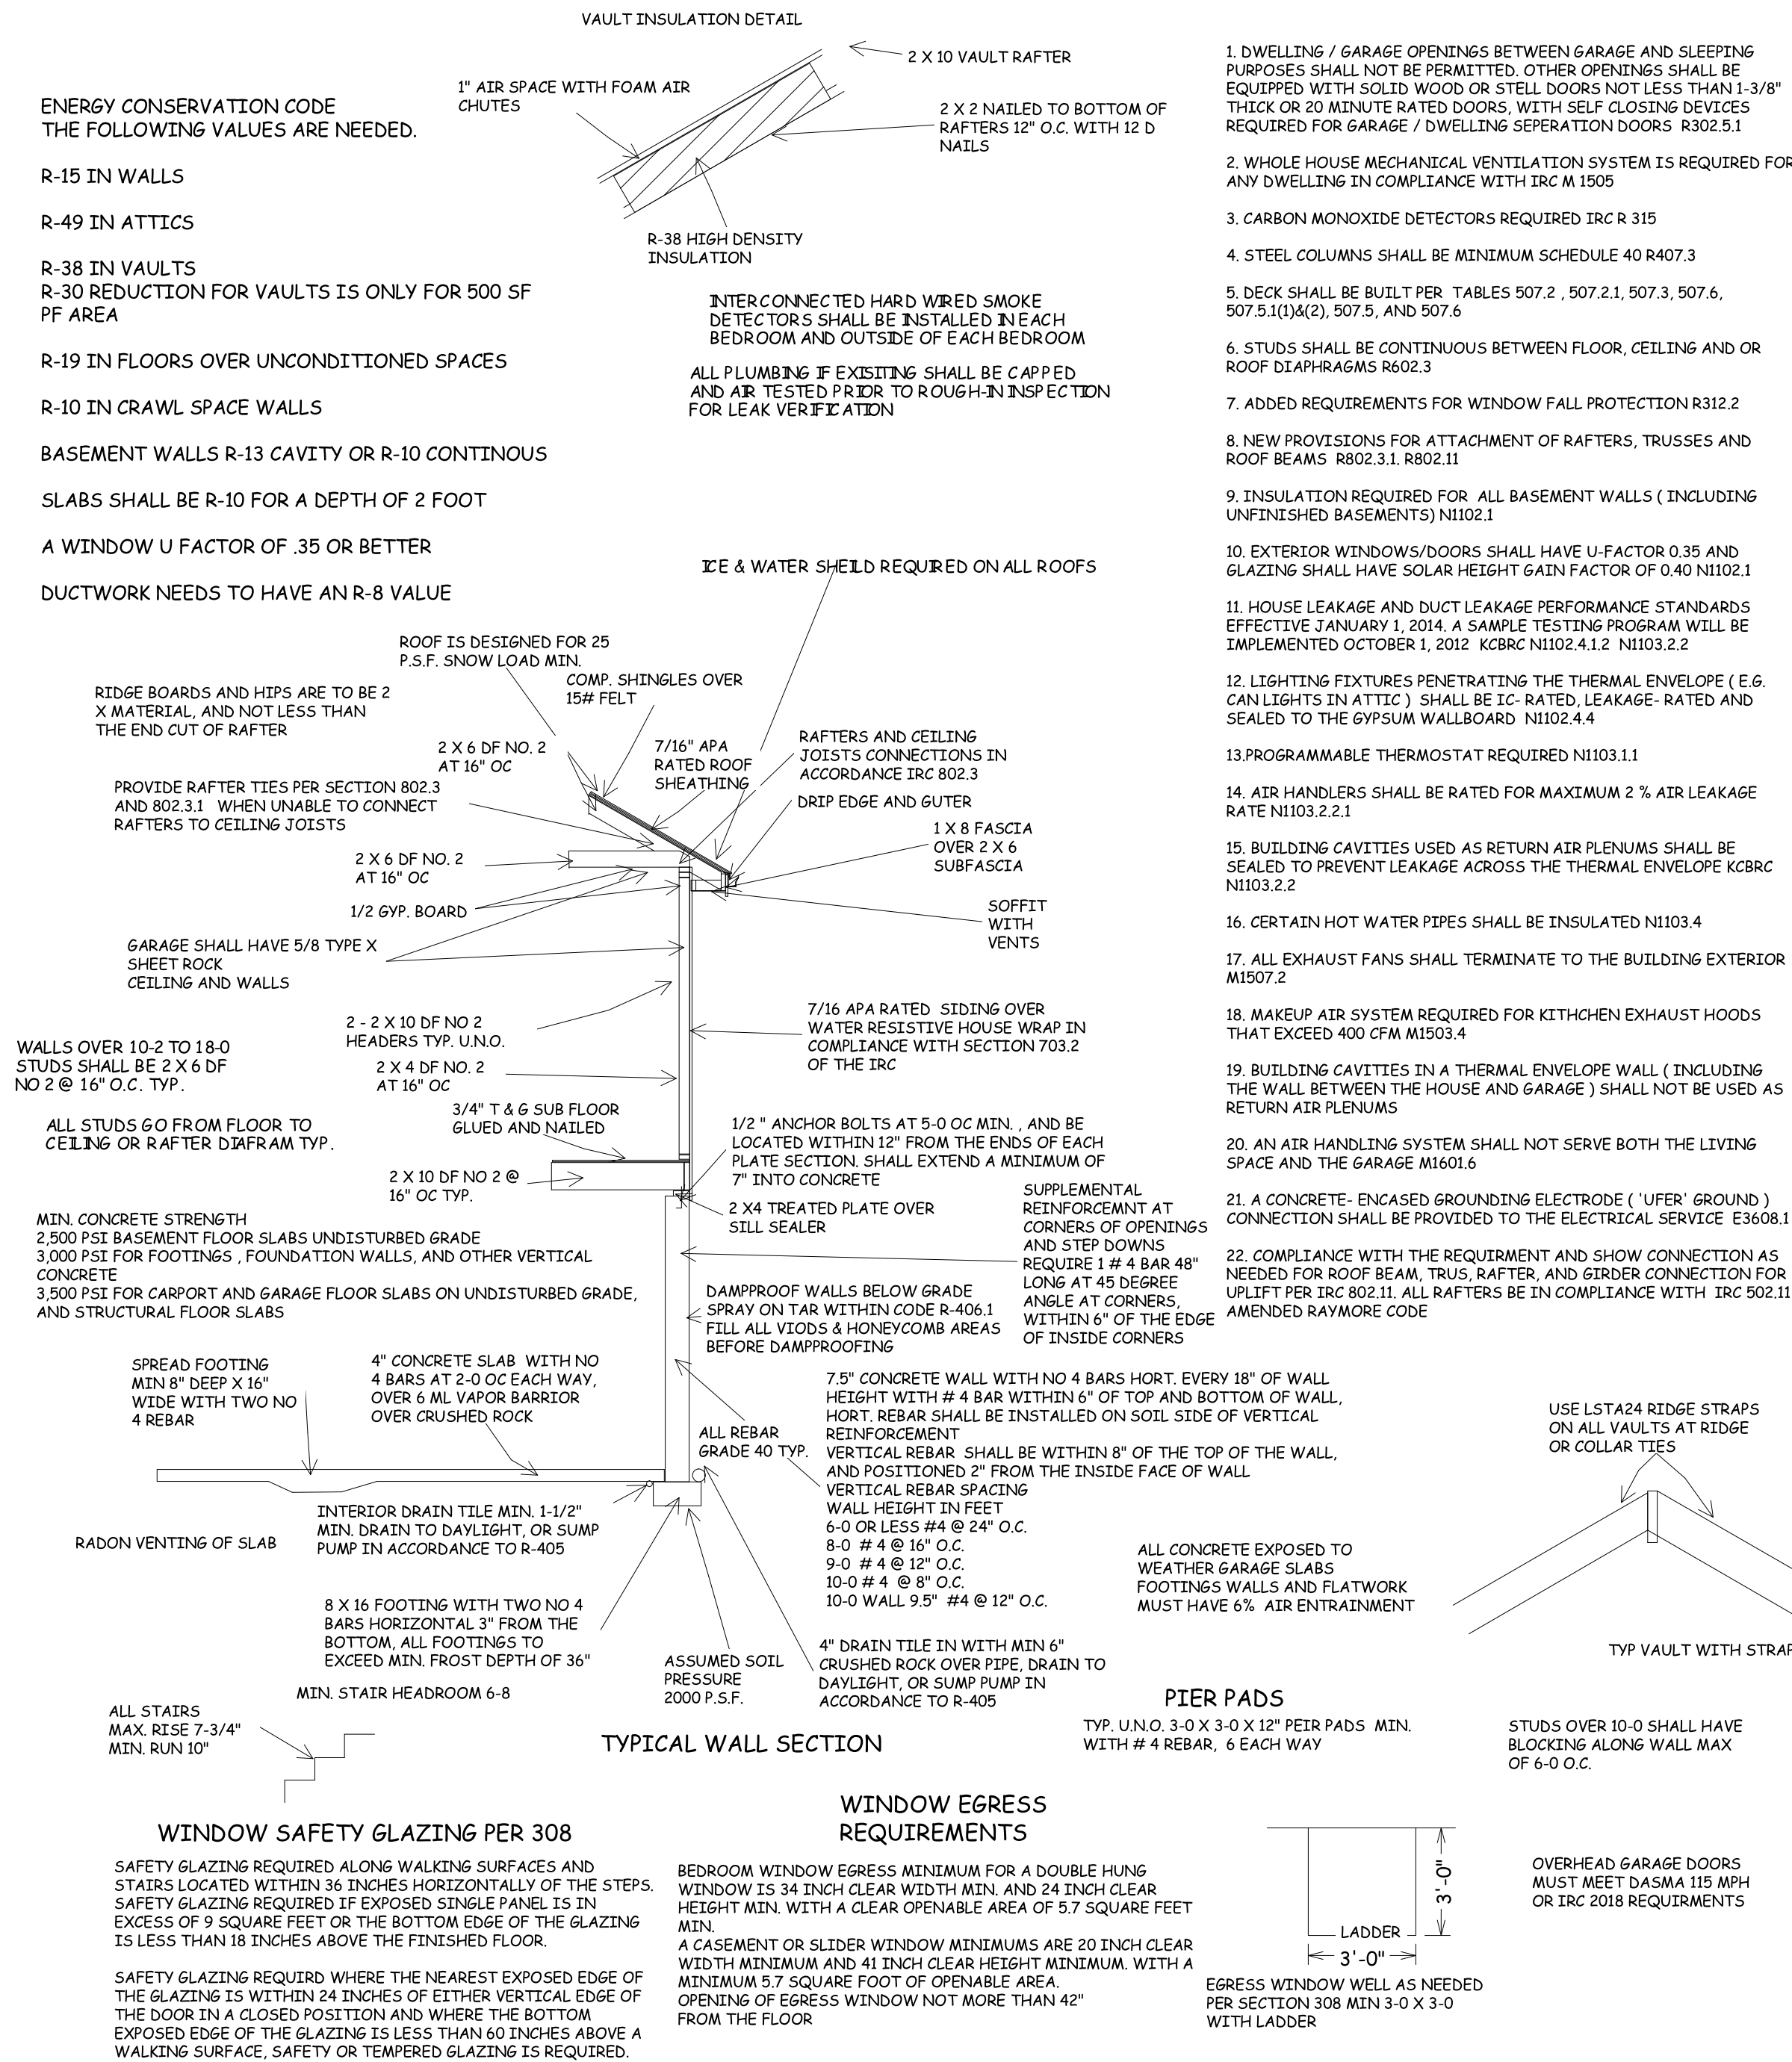

PURLIN PLAN
1/8" = 1'-0
RAFTER SPAN MAX. 14-0

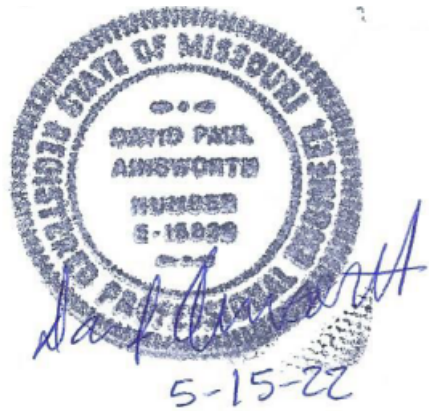

BUILD IN ACCORDANCE WITH
2018 INTERNATIONAL
RESIDENTIAL CODE AND
LOCAL CODES.

TRUMARK HOMES
KYLE III
ELEVATION A
LOT 195 WATERSIDE RIDGE
2225 KILLARNEY LN
LEE SUMMIT MO

SCALE
1/4" = 1-0

DATE
5-12-22

PLAN NO.
3821

SHEET NO.

EXPOSURE CATEGORY B 30-FOOT MEAN ROOF HEIGHT 15-FOOT WALL HEIGHT 3 BRACED WALL LINES		MINIMUM TOTAL LENGTH (FEET) OF BRACED WALL PANELS REQUIRED ALONG EACH BRACED WALL LINE ^a				
Ultimate Design Wind Speed (mph)	Story Location	Braced Wall Line Spacing (feet)	Method L1B ^b	Method Q8	Methods DWB, WSP, SFB, PFB, PCP, HPS, BV-WSP, ASB, PFH, PFC, CS-SFB	Methods CS-WSP, CS-Q, CS-PF
≤ 115		10	3.5	3.5	2.0	2.0
		20	6.5	6.5	3.5	3.5
		30	9.5	9.5	5.5	4.5
		40	12.5	12.5	7.0	6.0
		50	15.0	15.0	9.0	7.5
		60	18.0	18.0	10.5	9.0
		10	7.0	7.0	4.0	3.5
		20	12.5	12.5	7.5	6.5
		30	18.0	18.0	10.5	9.0
		40	23.5	23.5	13.5	11.5
		50	29.0	29.0	16.5	14.0
		60	34.5	34.5	20.0	17.0
		10	NP	10.0	6.0	5.0
		20	NP	18.5	11.0	9.0
		30	NP	27.0	15.5	13.0
		40	NP	35.0	20.0	17.0
		50	NP	43.0	24.5	21.0
		60	NP	51.0	29.0	25.0


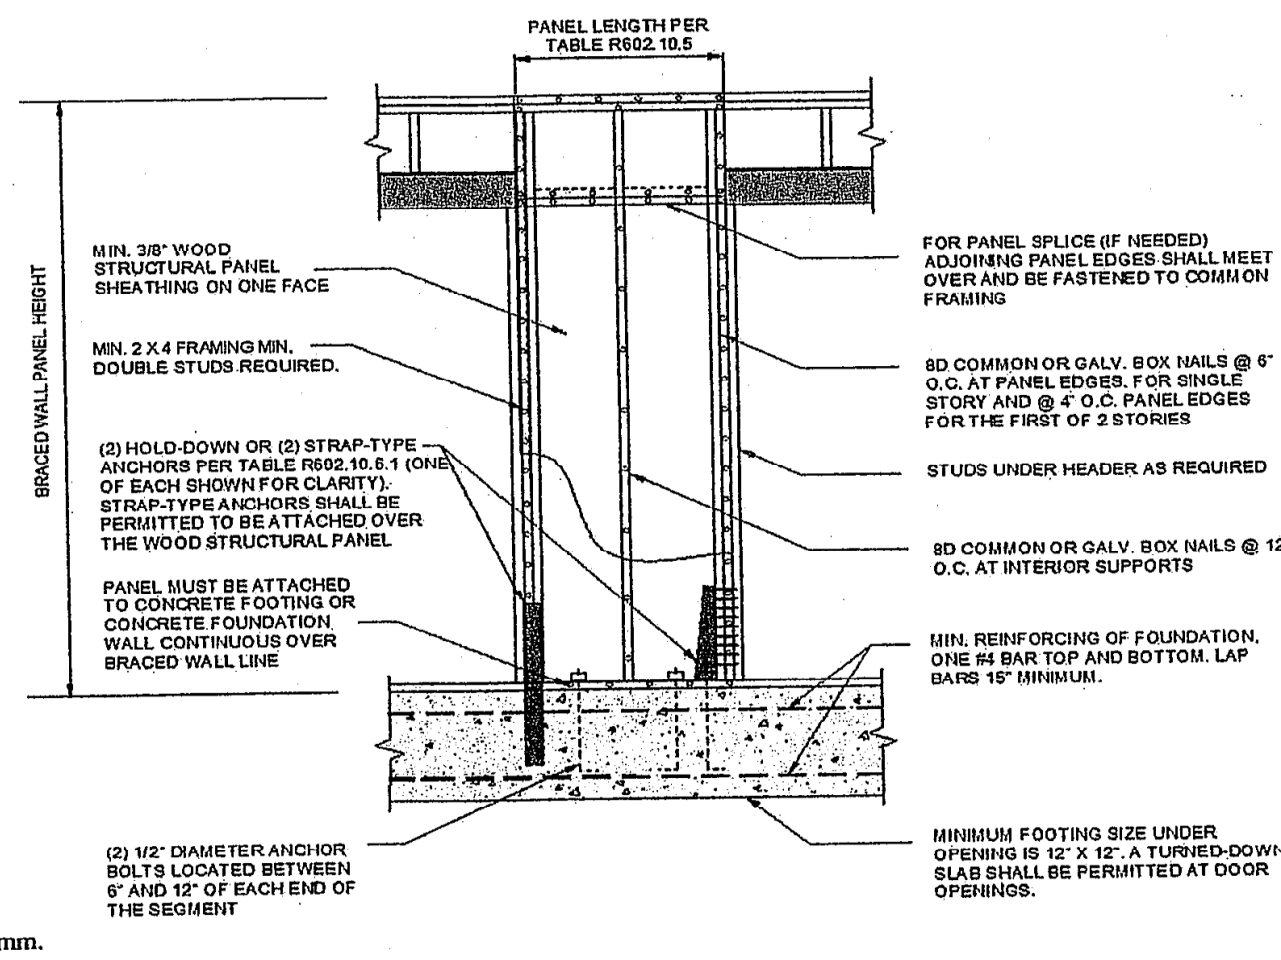


FIGURE R602.10.6.1
METHOD ABW—ALTERNATE BRACED WALL PANEL

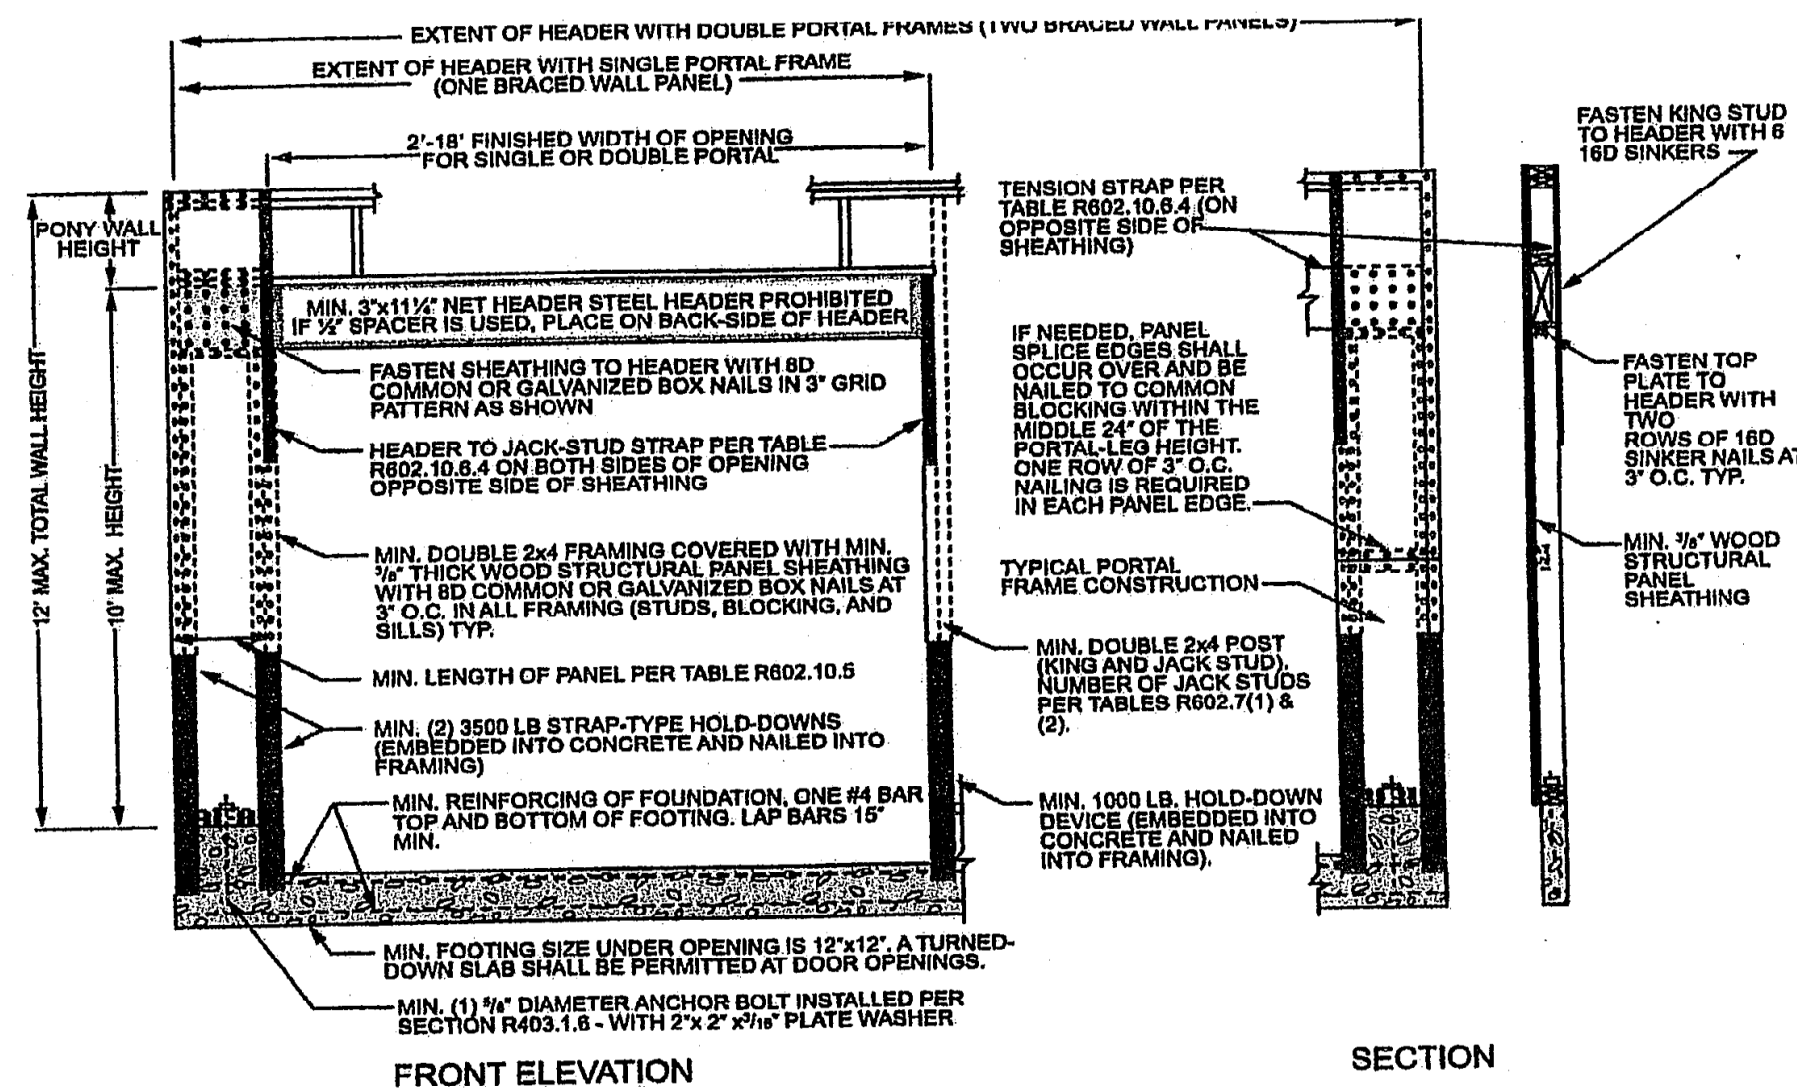

4 mm, 1 foot = 304.8 mm.

FIGURE R602.10.6.2
METHOD PFH—PORTAL FRAME WITH HOLD-DOWNS


METHODS, MATERIAL	MINIMUM THICKNESS	FIGURE	CONNECTION CRITERIA ^a	
			Fasteners	Spacing
Intermittent Bracing Methods	L1B Let-in-bracing		Wood: 2-8d common nails or 3-8d (2 1/2\"/>	Wood: per stud and top and bottom plates Metal: per manufacturer
	DWB Diagonal wood boards		2-8d (2 1/2\"/>	Per stud
	WSP Wood structural panel (See Section R604)		Exterior sheathing per Table R602.3(3) Interior sheathing per Table R602.3(1) or R602.3(2)	6\"/>
	BV-WSP ^b Wood structural panels with stone or masonry veneer (See Section R602.10.6.5)		8d common (2 1/2\"/>	4\"/>
	SFB Structural fiberboard sheathing		1 1/2\"/>	3\"/>
	GB Gypsum board		Nails or screws per Table R602.3(1) for exterior locations Nails or screws per Table R702.3.5 for interior locations	For all braced wall panel locations: 7\"/>
	PFB Particleboard sheathing (See Section R605)		For 1/2\"/>	3\"/>
	PCP Portland cement plaster		1 1/2\"/>	6\"/>
	HPS Hardboard panel siding		0.092\"/>	4\"/>
	ABW Alternate braced wall		See Section R602.10.6.1	See Section R602.10.6.1

METHOD (See Table R602.10.4)	MINIMUM LENGTH ^a (inches)					CONTRIBUTING LENGTH (inches)
	8 feet	9 feet	10 feet	11 feet	12 feet	
DWB, WSP, SFB, PFB, PCP, HPS, BV-WSP	48	48	48	53	58	Actual ^b
GB	48	48	48	53	58	Double sided = Actual Single sided = 0.5 × Actual
L1B	55	62	69	NP	NP	Actual ^b
ABW	SDC A, B and C, ultimate design wind speed < 140 mph	28	32	34	NP	42
	SDC D ₁ , D ₂ and D ₃ , ultimate design wind speed < 140 mph	32	32	34	NP	NP
CS-G	Adjacent clear opening height (inches)	24	27	30	33	36
CS-WSP, CS-SFB	≤ 64	24	27	30	33	36
	68	26	27	30	33	36
	72	27	27	30	33	36
	76	30	29	30	33	36
	80	32	30	30	33	36
	84	35	32	32	33	36
	88	38	35	33	33	36
	92	43	37	35	35	36
	96	48	41	38	35	36
	104	—	44	40	38	38
	108	—	49	43	40	39
	112	—	—	50	45	43
	116	—	—	55	48	45
	120	—	—	60	52	48
	124	—	—	—	56	51
	128	—	—	—	61	54
	132	—	—	—	66	58
	136	—	—	—	—	62
	140	—	—	—	—	66
	144	—	—	—	—	72
METHOD (See Table R602.10.4)	Portal header height					Actual ^b
	8 feet	9 feet	10 feet	11 feet	12 feet	
	Supporting roof only	16	16	16	Note c	Note c
	Supporting one story and roof	24	24	24	Note c	Note c
PFH	Supporting one story and roof	24	24	24	Note c	Note c
	Supporting one story and roof	24	24	24	Note c	Note c
PFG	Supporting one story and roof	24	27	30	Note d	Note d
	Supporting one story and roof	24	27	30	Note d	Note d
CS-PF	SDC A, B and C	16	18	20	Note e	Note e
	SDC D ₁ , D ₂ and D ₃	16	18	20	Note e	Note e

For S1: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 mile per hour = 0.447 m/s.
NP = Not Permitted.
a. Linear interpolation shall be permitted.
b. Use the actual length where it is greater than or equal to the minimum length.
c. Maximum header height for PFH is 10 feet in accordance with Figure R602.10.6.2, but wall height shall be permitted to be increased to 12 feet with pony wall.
d. Maximum header height for PFG is 10 feet in accordance with Figure R602.10.6.3, but wall height shall be permitted to be increased to 12 feet with pony wall.
e. Maximum header height for CS-PF is 10 feet in accordance with Figure R602.10.6.4, but wall height shall be permitted to be increased to 12 feet with pony wall.

METHODS, MATERIAL	MINIMUM THICKNESS	FIGURE	CONNECTION CRITERIA ^a	
			Fasteners	Spacing
Intermittent Bracing Methods	PFH Portal frame with hold-downs		See Section R602.10.6.2	See Section R602.10.6.2
	PFG Portal frame at garage		See Section R602.10.6.3	See Section R602.10.6.3
Continuous Sheathing Methods	CS-WSP Continuously sheathed wood structural panel		Exterior sheathing per Table R602.3(3) Interior sheathing per Table R602.3(1) or R602.3(2)	6\"/>
	CS-G ^b Continuously sheathed wood structural panel adjacent to garage openings		See Method CS-WSP	See Method CS-WSP
	CS-PF Continuously sheathed portal frame		See Section R602.10.6.4	See Section R602.10.6.4
	CS-SFB ^c Continuously sheathed structural fiberboard		1 1/2\"/>	3\"/>

For S1: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 degree = 0.0175 rad, 1 pound per square foot = 47.8 N/m², 1 mile per hour = 0.447 m/s.
a. Adhesive attachment of wall sheathing, including Method GB, shall not be permitted in Seismic Design Categories C, D₁, D₂ and D₃.
b. Applies to panels next to garage door opening where supporting gable and wall or roof load only. Shall only be used on one wall of the garage. In Seismic Design Categories D₁, D₂ and D₃, roof covering dead load shall not exceed 3 psf.
c. Garage openings adjacent to a Method CS-G panel shall be provided with a header in accordance with Table R602.7(1). A full-height clear opening shall not be permitted adjacent to a Method CS-G panel.
d. Method CS-SFB does not apply in Seismic Design Categories D₁, D₂ and D₃.
e. Method applies to detached one- and two-family dwellings in Seismic Design Categories D₁ through D₃ only.

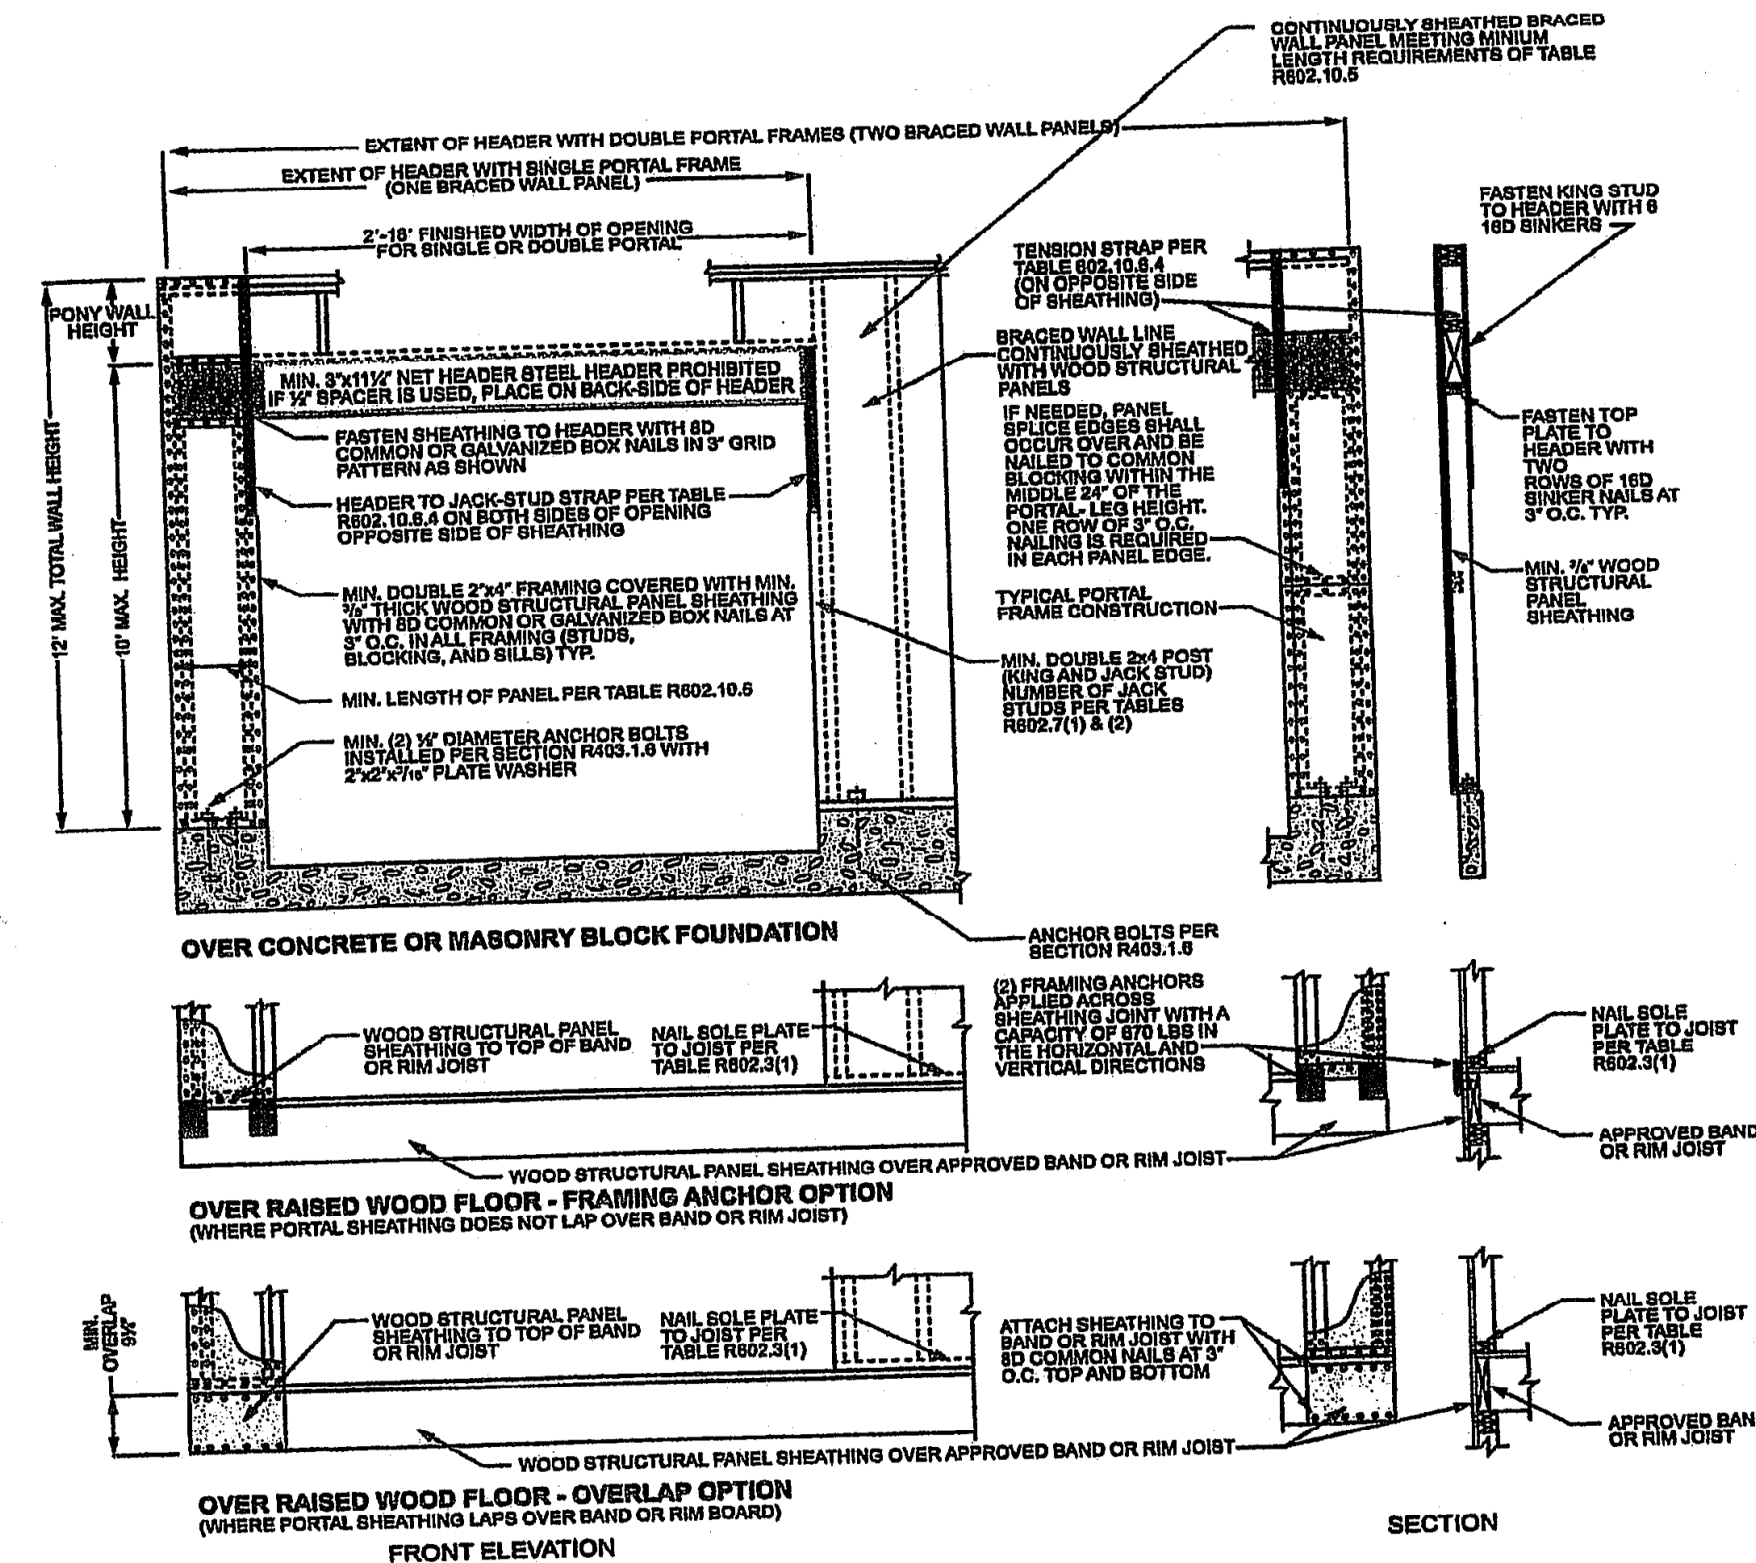

For S1: 1 inch = 25.4 mm, 1 foot = 304.8 mm.

FIGURE R602.10.6.4
METHOD CS-PF—CONTINUOUSLY SHEATHED PORTAL FRAME PANEL CONSTRUCTION

BRACE WALL DETAILS
WIND SPEED 115 MPH
WIND EXPOSURE A
SEISMIC DESIGN CATEGORY A

BUILD IN ACCORDANCE WITH
2018 INTERNATIONAL
RESIDENTIAL CODE AND
LOCAL CODES.

TRUMARK HOMES
KYLE III
ELEVATION A
LOT 195 WATERSIDE RIDGE
2225 KILLARNEY LN
LEE SUMMIT MO

SCALE
1/4" = 1-0

DATE
5-12-22

PLAN NO.
3821

SHEET NO.