




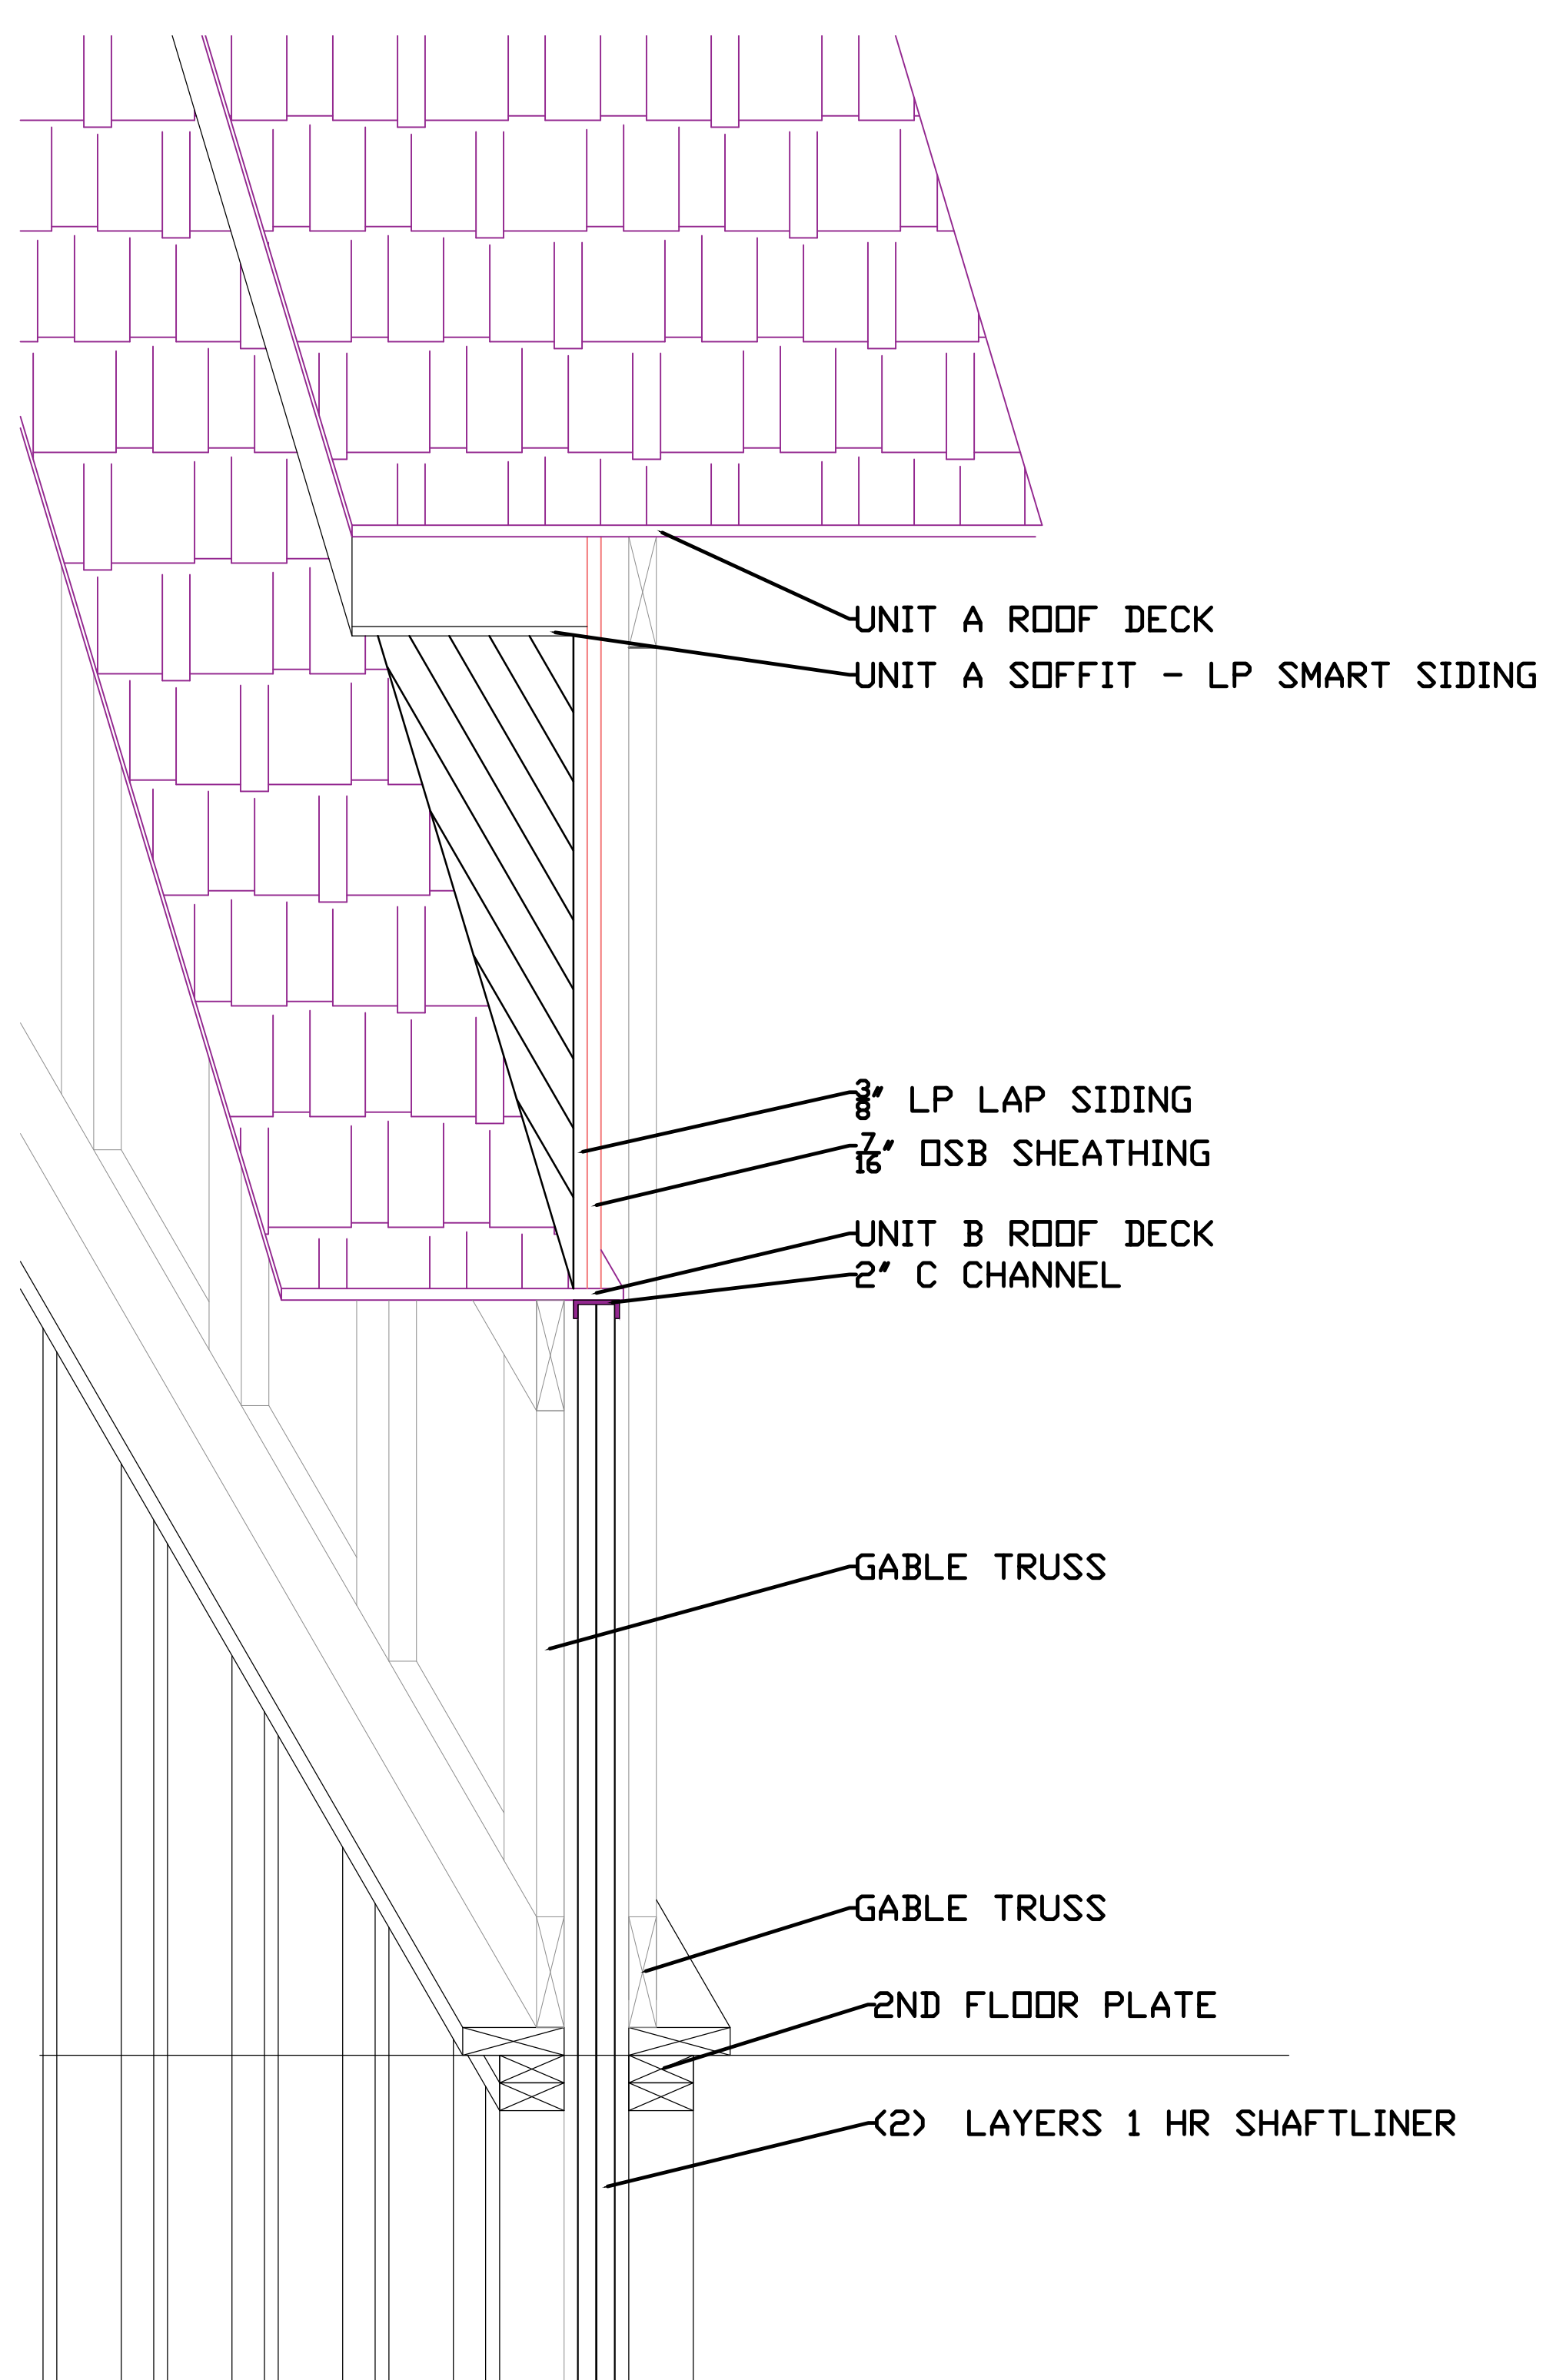

CURRENT CONDITION OF TOWNHOMES AT
OSAGE # 11 AND 12

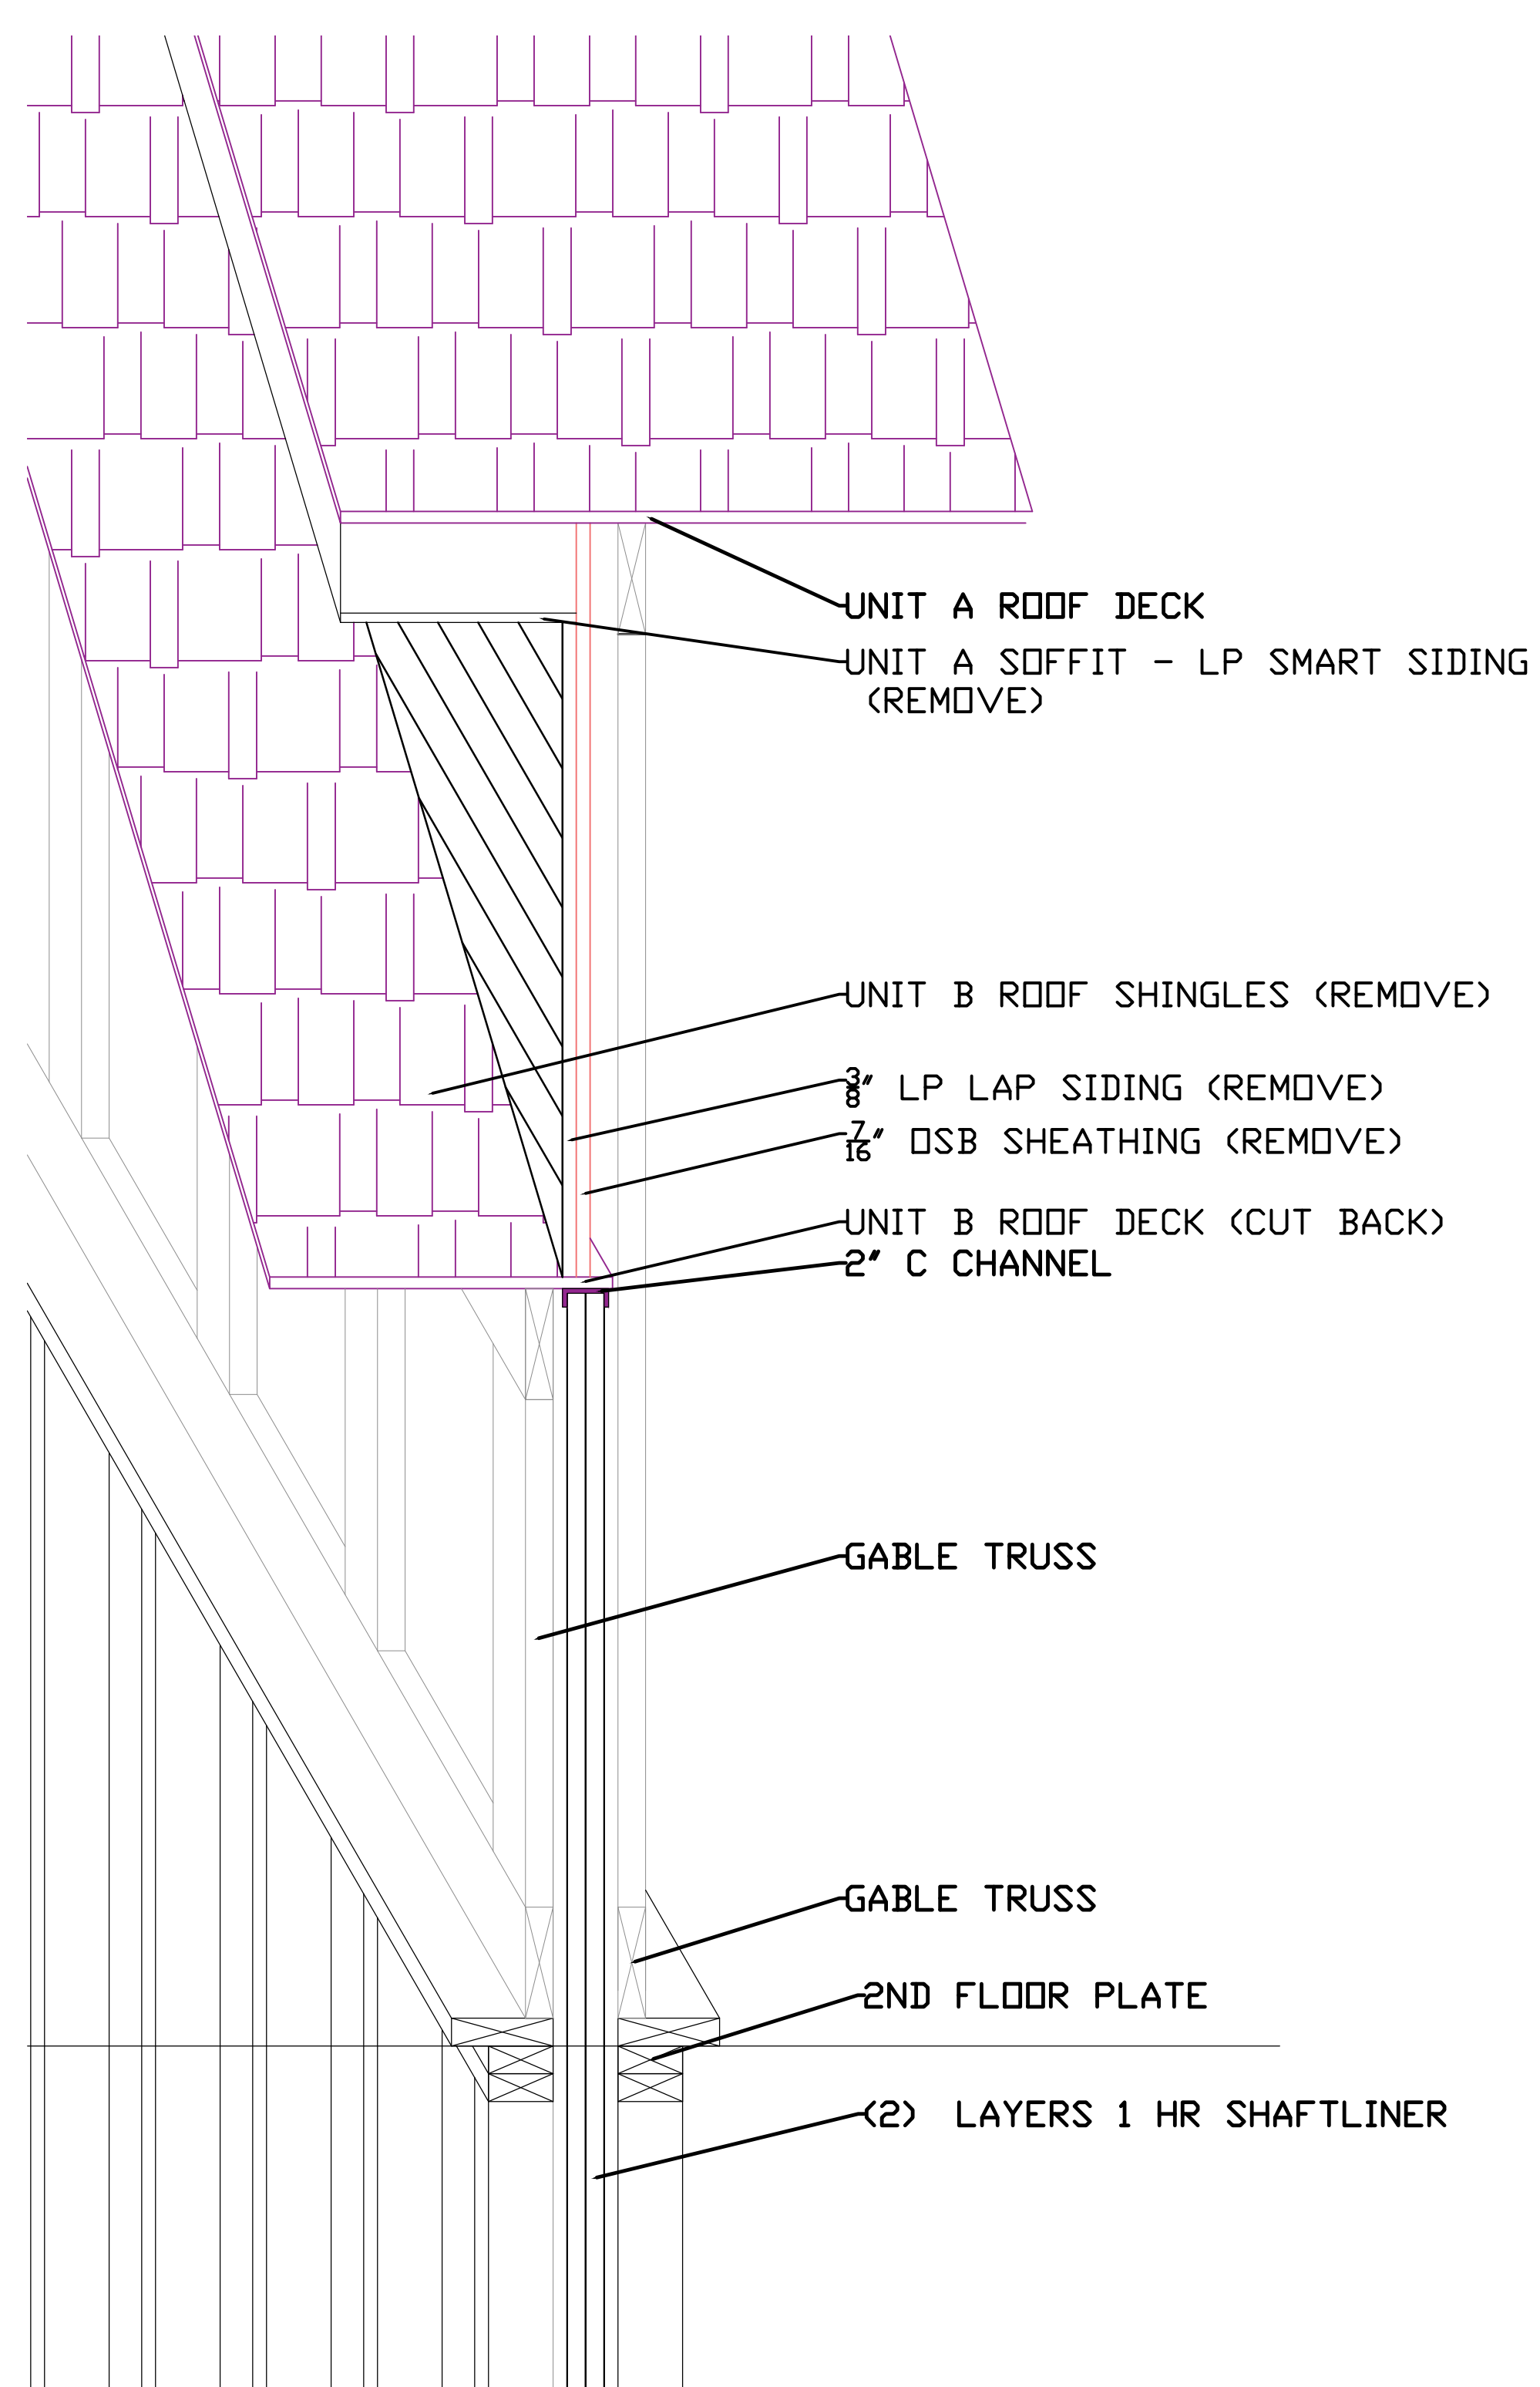

NECESSARY DEMOLITION TO MAKE
CORRECTIONS

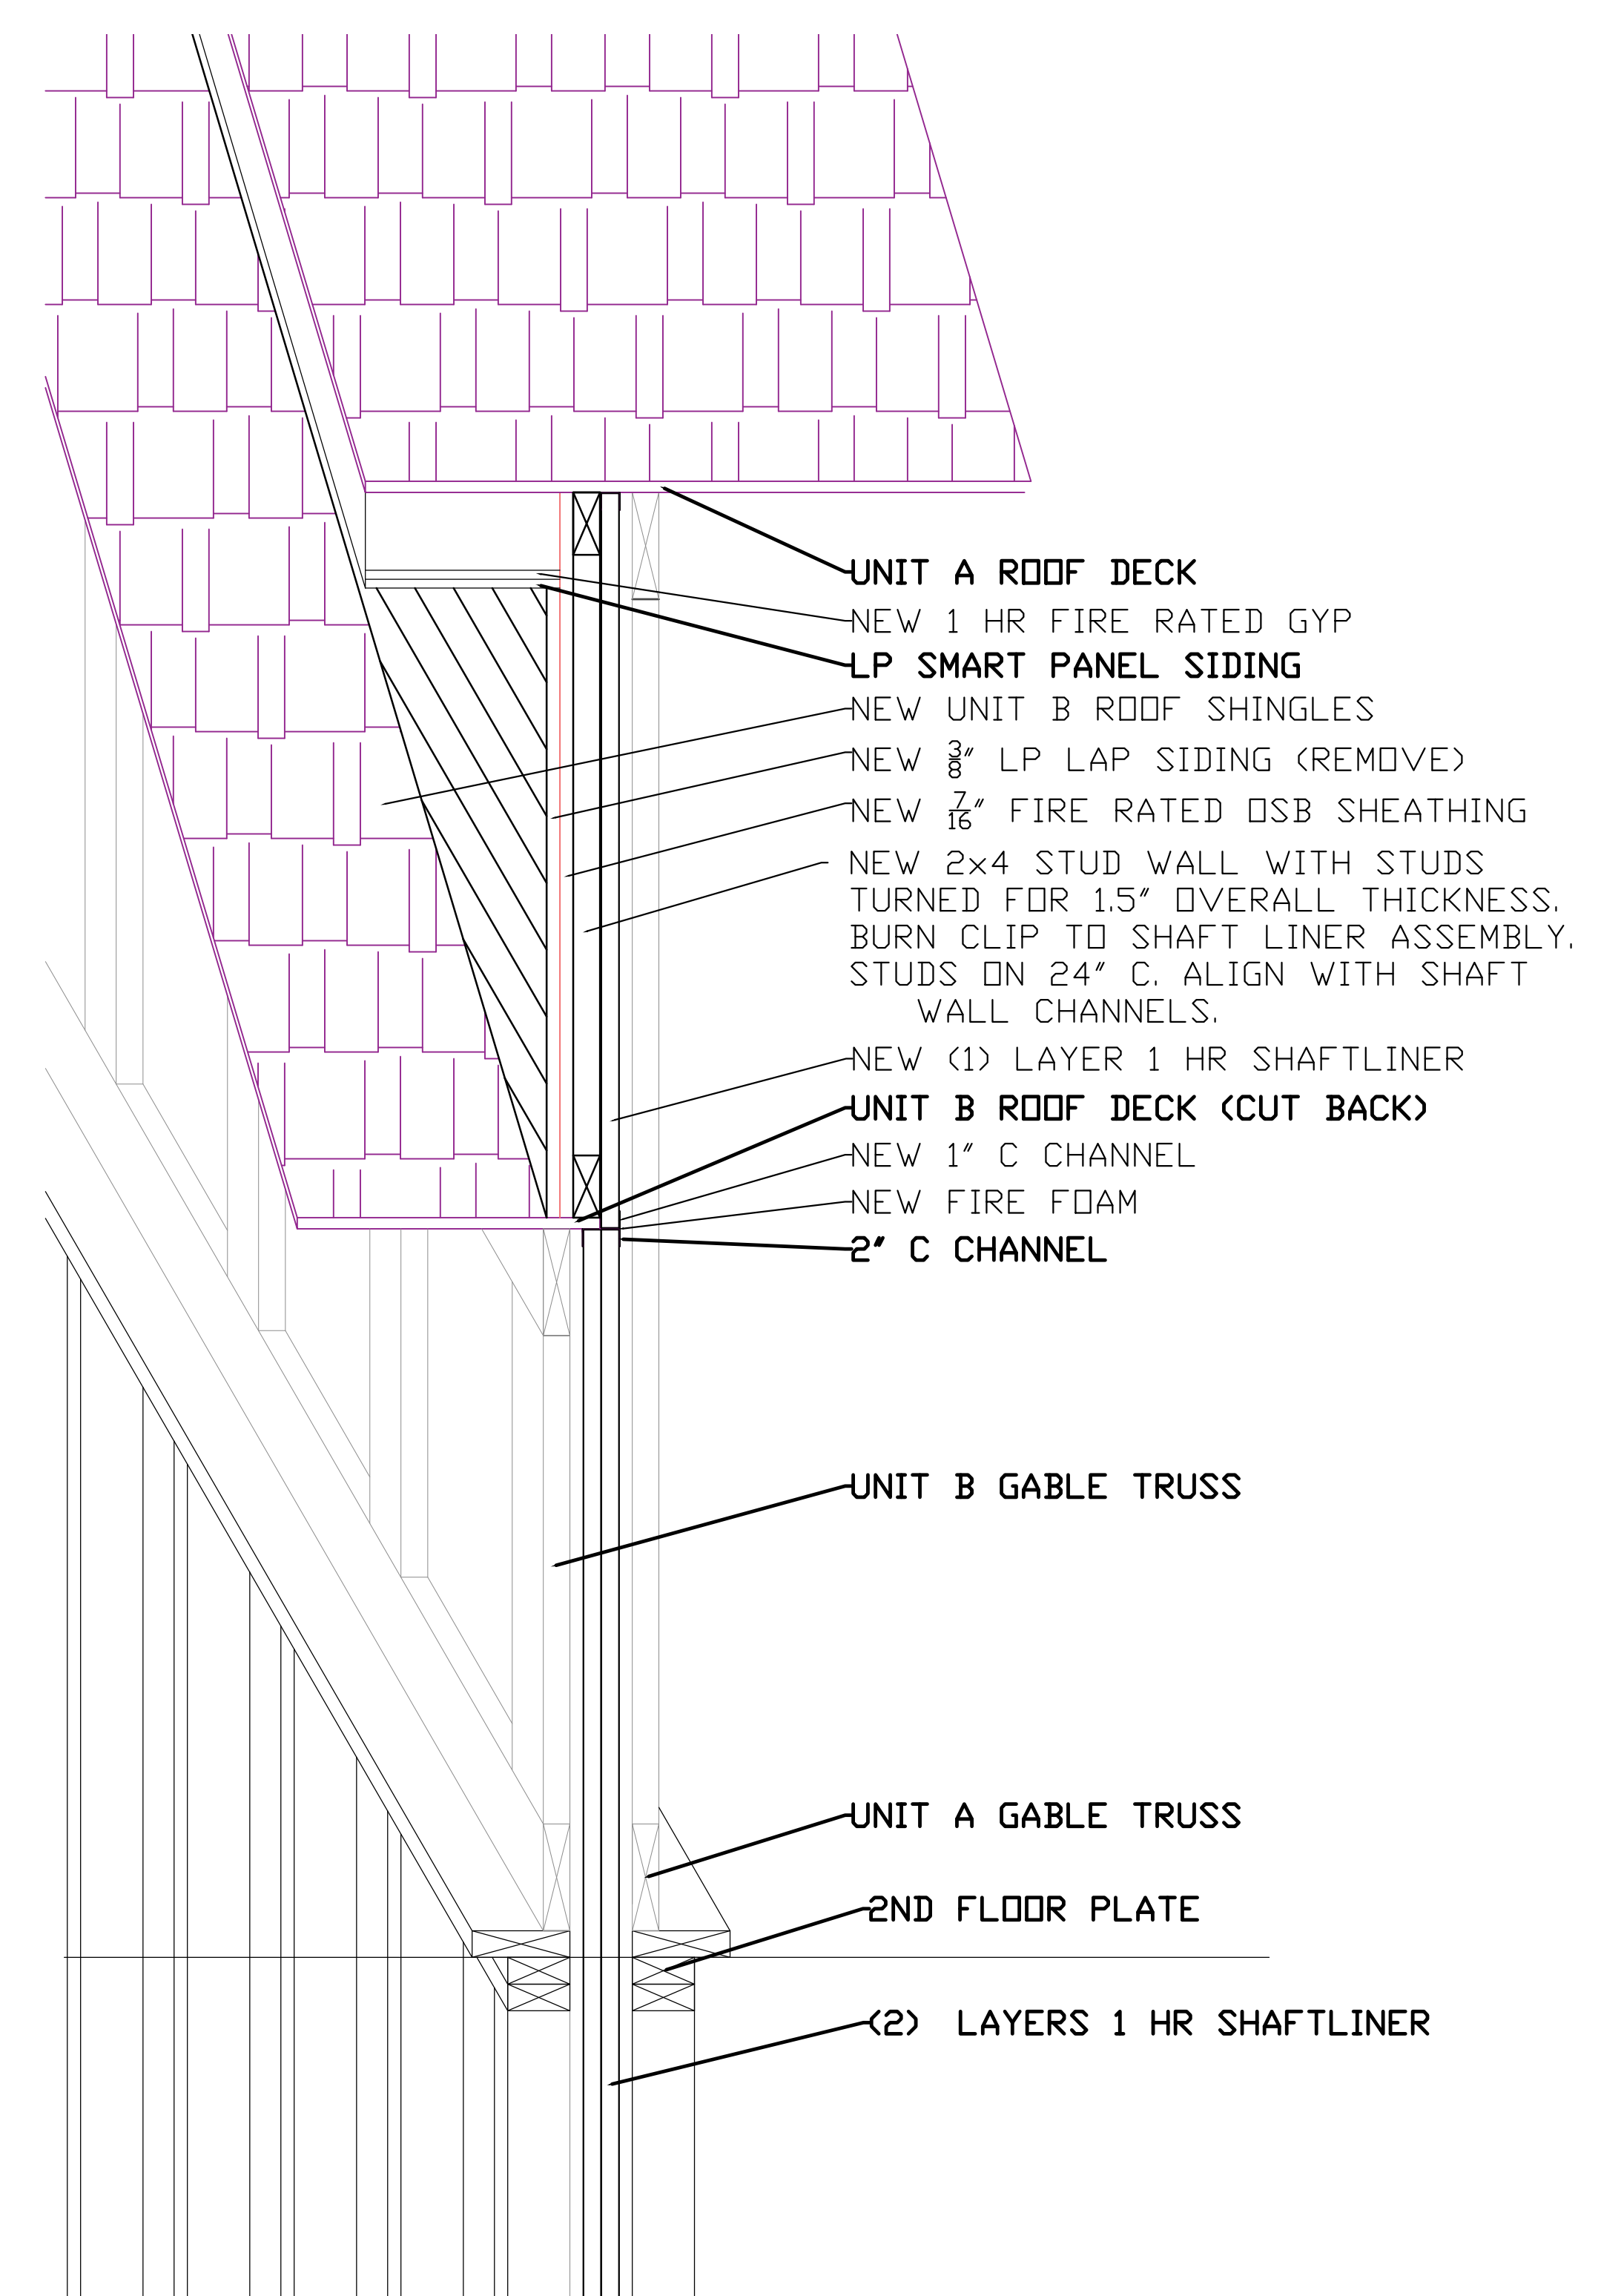

CORRECTIONS REQUIRED TO MEET R302.1(1)
AND R302.2 MAINTAINING 1 HR FIRE
PROTECTION PER UNIT FROM EITHER SIDE
THROUGH HEIGHT OF SEPARATION WALL AND
ADDING 1 HR PROTECTION FOR PROJECTIONS
BETWEEN UNITS.