

# *Royal Metal Industries, LLC*

Home Builder Division

July 12, 2022

Permit# PRRES-20215563

Address: 1620 SW 27<sup>th</sup> St  
Whispering Woods Lot 44  
Lees Summit, MO 64082

Welded connections for: New Mark Homes KC

Welding rod 7018, per industry standards was used by our certified welder, Dan Brown, contracted employee through Royal Metal Industries.

Weld Certification attached.

Best Regards,

Laura Schinkel  
Customer Representative  
Royal Metal Industries  
913-440-0026

# ROYAL METALS INDUSTRIES

## Welding Operator Qualification Test Record

Page 1 of 1

RMI-SMAW-OH-DB

WQTR No. RMI-SMAW-OH-DB Welder Name DAN BROWN Welder Id DB  
WPS No. RMI-SMAW Revision \_\_\_\_\_ Date 2/27/2018

### Variables Record Actual Values Used In Qualification

Process (Table 4.10, Item (1)) SMAW

Transfer Mode (GMAW): Short-Cir. ☐ Globular ☐ Spray ☐

Type Manual ☒ Machine ☐ Semi-Auto ☐ Auto ☐

Number of Electrodes Single ☐ Multiple ☐

Current/Polarity AC ☐ DCEP ☒ DCEN ☐ Pulsed ☐

Position (Table 4.10, Item (4)) Overhead

Weld Progression: (Table 4.10, Item (6)) Up ☐ Down ☐

Backing [Table 4.10, Item (7)] Use Backing ☒

Consumable Insert (GTAW) Use Insert ☐

Material/Spec. A-36 to A-36

Thickness (Plate): Groove (in ) .375

Fillet (in ) .375

Thickness (Pipe/tube): Groove ( ) \_\_\_\_\_

Fillet ( ) \_\_\_\_\_

Diameter(Pipe): Groove ( ) \_\_\_\_\_

Fillet ( ) \_\_\_\_\_

Notes \_\_\_\_\_

Filler Metal (Table 10, Item (2))

Spec. 5.1

Class. E-7018 LH

F-No. 4

Gas/Flux Type (Table 4.10, Item (3)) \_\_\_\_\_

Other \_\_\_\_\_

### Qualification Range

#### SMAW-MILD STEEL GROUPS

Short-Circuiting ☐ Globular ☐ Spray ☐

Manual ☒ Machine ☐ Semi-Auto ☐ Auto ☐

Single ☐ Multiple ☐

AC ☐ DCEP ☒ DCEN ☐ Pulsed ☐

Flat, Overhead, Horizontal, 4G

Up ☐ Down ☐

With Backing ☒ Without Backing ☐

With Insert ☐ Without Insert ☐

#### MILD STEEL GROUPS

.125 - .750 in

Any - Any in

VISUAL INSPECTION (4.8.1) Acceptable Yes

### GUIDED BEND TEST RESULTS (4.30.5)

Type	Result	Type	Result
ROOT	PASSED	FACE	PASSED
ROOT	PASSED	FACE	PASSED

Fillet Test Results (4.30.2.3 and 4.30.4.1)

Appearance GOOD

Fillet Size .340"

Macroetch SOUND

Fracture Test Root Penetration COMPLETE Description PASSED

Inspected By \_\_\_\_\_ Test No. RMI Organization A-Z WELDER Date 2/27/2018

### RADIOGRAPHIC TEST RESULTS (4.30.3.1)


Film Identification No.	Result	Remark	Interpreted By
			Organization
			Test No.
			Date

We, the undersigned, certify that the statements in this record are correct and that the test welds were prepared, welded, and tested in accordance with the requirements of section 4 of ANSI/AWS D1.1, ( 2015 ) Structural Welding Code-Steel.

Manufacturer ROYAL METALS INDUSTRIES

Authorized By \_\_\_\_\_

Date 2/27/2018



# ROYAL METALS INDUSTRIES

Page 1 of 3

## Procedure Qualification Record

RMI-SMAW

PQR No. RMI-SMAW Revision \_\_\_\_\_ Date \_\_\_\_\_ By \_\_\_\_\_

Authorized By \_\_\_\_\_ Date \_\_\_\_\_ Type ☒ Manual ☐ Machine ☐

Welding Process(es) SMAW Reference WPS No. RMI-SMAW Semi-Auto ☐ Auto ☐

### JOINT

Type Butt

Backing Yes ☐ No ☒ Single Weld ☐ Double Weld ☒

Backing Material BACK WELD


Root Opening 3/32" Root Face Dimension 3/32"

Groove Angle 60 Radius (J-U) \_\_\_\_\_

Back Gouging Yes ☒ No ☐

Method GRIND AND BRUSH

Single-V groove weld (2)  
Butt joint (B)

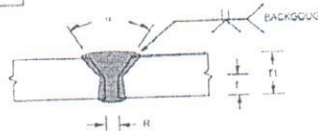

Welding Process	Joint Configuration	Base Metal Thickness (Unlimited)		Root Opening (See 3.13.1)	Groove Preparation		Permitted Varying Positions	Notes
		T 1	T 2		As Detailed (See 3.13.1)	As F.P. Up (See 3.13.1)		
SMAW	B-122	U		R = 0 to 1/8 F = 0 to 1/8 α = 60°	+1/16, 0 +1/16, 0 +10° - 45°	+1/16, -1/8 face limited +10° - 5°	A-1	(C, D, E)

### BASE METALS

Material Spec A-36 to A-36

Type or Grade \_\_\_\_\_ to \_\_\_\_\_

Thickness: Groove (in) .375 Fillet (in) .375

Diameter (Pipe, ) \_\_\_\_\_

### FILLER METALS

AWS Specification 5.1

AWS Classification E-7018 LH

### SHIELDING

Flux \_\_\_\_\_ Gas \_\_\_\_\_

Composition \_\_\_\_\_

Electrode-Flux (Class) \_\_\_\_\_ Flow Rate \_\_\_\_\_

Gas Cup Size \_\_\_\_\_

### PREHEAT

Preheat Temp., Min. 50 F

Interpass Temp., Min. 50 F Max. 450 F

### POSTWELD HEAT TREATMENT

Temp. \_\_\_\_\_ Required ☐

Time \_\_\_\_\_

### POSITION

Position of Groove Vertical Fillet Vertical

Vertical Progression: Up ☒ Down ☐

### ELECTRICAL CHARACTERISTICS

Transfer Mode (GMAW):

Short-Circuiting ☐ Globular ☐ Spray ☐

Current: AC ☐ DCEP ☒ DCEN ☐ Pulsed ☐

Other \_\_\_\_\_

Tungsten Electrode (GTAW):

Size \_\_\_\_\_ Type \_\_\_\_\_

### TECHNIQUE

Stringer or Weave Bead Both

Multi-pass or Single Pass (per side) Both

Number of Electrodes 1

Electrode Spacing: Longitudinal \_\_\_\_\_

Lateral \_\_\_\_\_ Angle \_\_\_\_\_

Contact Tube to Work Distance \_\_\_\_\_

Peening \_\_\_\_\_

Interpass Cleaning GRIND-BRUSH

### WELDING PROCEDURE

Layer/Pass	Process	Filler Metal Class	Diameter	Cur. Type	Amps or WFS	Volts	Travel Speed	Other Notes
1-n	SMAW	E-7018 LH	5/32"	DCEP	130 A	20 V	7IPM	BACK GOUGE BACK WELD





# ROYAL METALS INDUSTRIES

Page 2 of 3

## Procedure Qualification Record

RMI-SMAW

### TEST RESULTS

#### TENSILE TEST

Specimen no.	Width	Thickness	Area	Ultimate tensile load, lb	Ultimate unit stress, psi	Character of failure and location

#### GUIDED BEND TEST

Specimen no.	Type of bend	Result	Remark
1	ROOT	PASSED	
2	FACE	PASSED	
3	ROOT	PASSED	
4	FACE	PASSED	

#### VISUAL INSPECTION

Appearance GOOD  
 Undercut NONE  
 Piping porosity NONE  
 Convexity SLIGHT  
 Test date 2/27/2018  
 Witnessed by \_\_\_\_\_

#### Other Test

GROOVES AND FILLETS AWS D1.1 STRUCTURAL CODE

#### Radiographic-ultrasonic examination

RT report no: \_\_\_\_\_ Result \_\_\_\_\_  
 UT report no: \_\_\_\_\_ Result \_\_\_\_\_

#### FILLET WELD TEST RESULTS

Minimum size multiple pass \_\_\_\_\_ Maximum size single pass \_\_\_\_\_  
 Macroetch \_\_\_\_\_ Macroetch \_\_\_\_\_  
 1. \_\_\_\_\_ 3. \_\_\_\_\_ 1. .295" 3. PASSED  
 2. \_\_\_\_\_ 2. .310"

#### All-weld-metal tension test

Tensile strength, psi \_\_\_\_\_  
 Yield point/strength, psi \_\_\_\_\_  
 Elongation in 2 in., % \_\_\_\_\_  
 Laboratory test no. \_\_\_\_\_

Welder's name DAN BROWN Clock no. \_\_\_\_\_ Stamp no. DB

Test conducted by A-Z WELDER Laboratory \_\_\_\_\_


Test number RMI Per AWS D1.1

We, the undersigned, certify that the statements in this record are correct and that the test welds were prepared, welded, and tested in accordance with the requirements of section 4 of ANSI/AWS D1.1, 2015 ) Structural Welding Code-Steel.

Manufacturer ROYAL METALS INDUSTRIES


By \_\_\_\_\_  
 Title \_\_\_\_\_

Date 2/27/2018



Single-V-groove weld (2)

Butt joint (B)

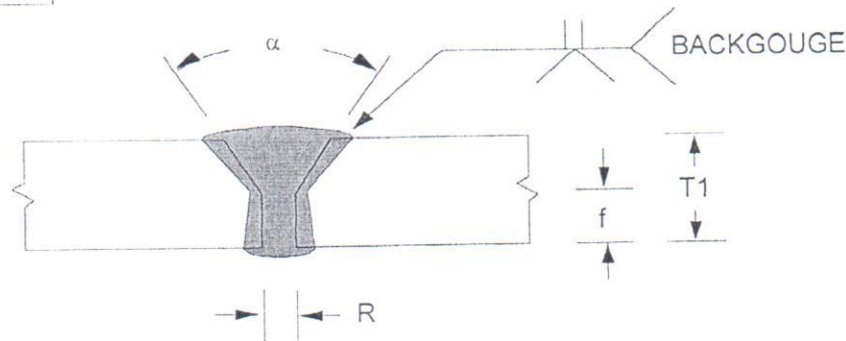

Welding Process	Joint Designation	Base Metal Thickness ( U=unlimited )		Groove Preparation			Permitted Welding Positions	Notes
				Root Opening Root Face Groove Angle	Tolerances			
		T1	T 2		As Detailed (see 3.13.1)	As Fit Up (see 3.13.1)		
SMAW	B-U2	U	-	R = 0 to 1/8 f = 0 to 1/8 $\alpha = 60^{\circ}$	+1/16, -0 +1/16, -0 +10° , -0°	+1/16, -1/8 Not limited +10° , -5°	All	C, D, N

## MEMO

AWS D1.1 STRUCTURAL CODE- GROOVES AND FILLETS



# ROYAL METALS INDUSTRIES

## Welding Operator Qualification Test Record

Page 1 of 1  
RMI-SMAW-V-DB

WQTR No. RMI-SMAW-V-DB Welder Name DAN BROWN Welder Id \_\_\_\_\_  
WPS No. RMI-SMAW Revision \_\_\_\_\_ Date 2/27/2018

### Variables Record Actual Values Used In Qualification

Process (Table 4.10, Item (1)) SMAW

Transfer Mode (GMAW): Short-Cir. ☐ Globular ☐ Spray ☐

Type Manual ☒ Machine ☐ Semi-Auto ☐ Auto ☐

Number of Electrodes Single ☐ Multiple ☐

Current/Polarity AC ☐ DCEP ☒ DCEN ☐ Pulsed ☐

Position (Table 4.10, Item (4)) Vertical

Weld Progression: (Table 4.10, Item (6)) Up ☒ Down ☐

Backing [Table 4.10, Item (7)] Use Backing ☒

Consumable Insert (GTAW) Use Insert ☐

Material/Spec. A-36 to A-36

Thickness (Plate): Groove (in ) .375

Fillet (in ) .375

Thickness (Pipe/tube): Groove ( ) \_\_\_\_\_

Fillet ( ) \_\_\_\_\_

Diameter(Pipe): Groove ( ) \_\_\_\_\_

Fillet ( ) \_\_\_\_\_

Notes \_\_\_\_\_

Filler Metal (Table 10, Item (2))

Spec. 5.1

Class. E-7018 LH

F-No. 4

Gas/Flux Type (Table 4.10, Item (3)) \_\_\_\_\_

Other \_\_\_\_\_

### Qualification Range

#### SMAW-MILD STEEL GROUPS

Short-Circuiting ☐ Globular ☐ Spray ☐

Manual ☒ Machine ☐ Semi-Auto ☐ Auto ☐

Single ☐ Multiple ☐

AC ☐ DCEP ☒ DCEN ☐ Pulsed ☐

Flat, Vertical, Horizontal, 3G

Up ☒ Down ☐

With Backing ☒ Without Backing ☒

With Insert ☐ Without Insert ☐

#### MILD STEEL GROUPS

.125 - .750 in

Any - Any in

### VISUAL INSPECTION (4.8.1) Acceptable Yes

#### GUIDED BEND TEST RESULTS (4.30.5)

Type	Result	Type	Result
ROOT	PASSED	FACE	PASSED
ROOT	PASSED	FACE	PASSED

#### Fillet Test Results (4.30.2.3 and 4.30.4.1)

Appearance GOOD Fillet Size .310" Macroetch SOUND

Fracture Test Root Penetration COMPLETE Description PASSED

Inspected By \_\_\_\_\_ Test No. RMI Organization A-Z WELDER Date 2/27/2018

#### RADIOGRAPHIC TEST RESULTS (4.30.3.1)

Film Identification No.	Result	Remark	Interpreted By

We, the undersigned, certify that the statements in this record are correct and that the test welds were prepared, welded, and tested in accordance with the requirements of section 4 of ANSI/AWS D1.1, ( 2015 ) Structural Welding Code-Steel.

Manufacturer ROYAL METALS INDUSTRIES

Authorized By \_\_\_\_\_

Date 2/27/2018

