



LEE'S SUMMIT
GRID: 0901

94°22'38"W 38°51'17"N NAD83
Maximo WO #: 24389266

THE ROUTE OF THE GAS SERVICE
MUST BE BROUGHT TO GRADE AND
CLEARED OF BUILDING MATERIAL
BY THE CUSTOMER PRIOR TO
INSTALLATION.




GRANULAR BACKFILL, IF REQUIRED,
IS TO BE PROVIDED BY THE
CUSTOMER. IN WHICH CASE, SPIRE
WILL NOT BE RESPONSIBLE FOR
THE DISPOSAL OF EXCESS SPOIL
FROM THE DITCH.

SPIRE TO ONLY PATCH THAT
PAVEMENT REMOVED FOR THE
INSTALLATION OF THE GAS
SERVICE.

PIPE SYSTEM
PRESSURE SYS - C-017
MINOP -
MOP - 55 PSIG
MAOP - 55 PSIG
DESIGNED MAOP - 60 PSIG
TEST PRESSURE - 100 PSIG

CUSTOMER APPROVAL SIGNATURE:

GAS METER MUST COMPLY WITH
REQUIREMENTS SHOWN BELOW

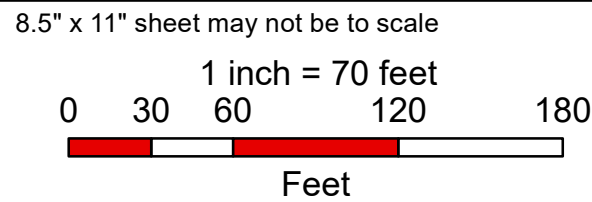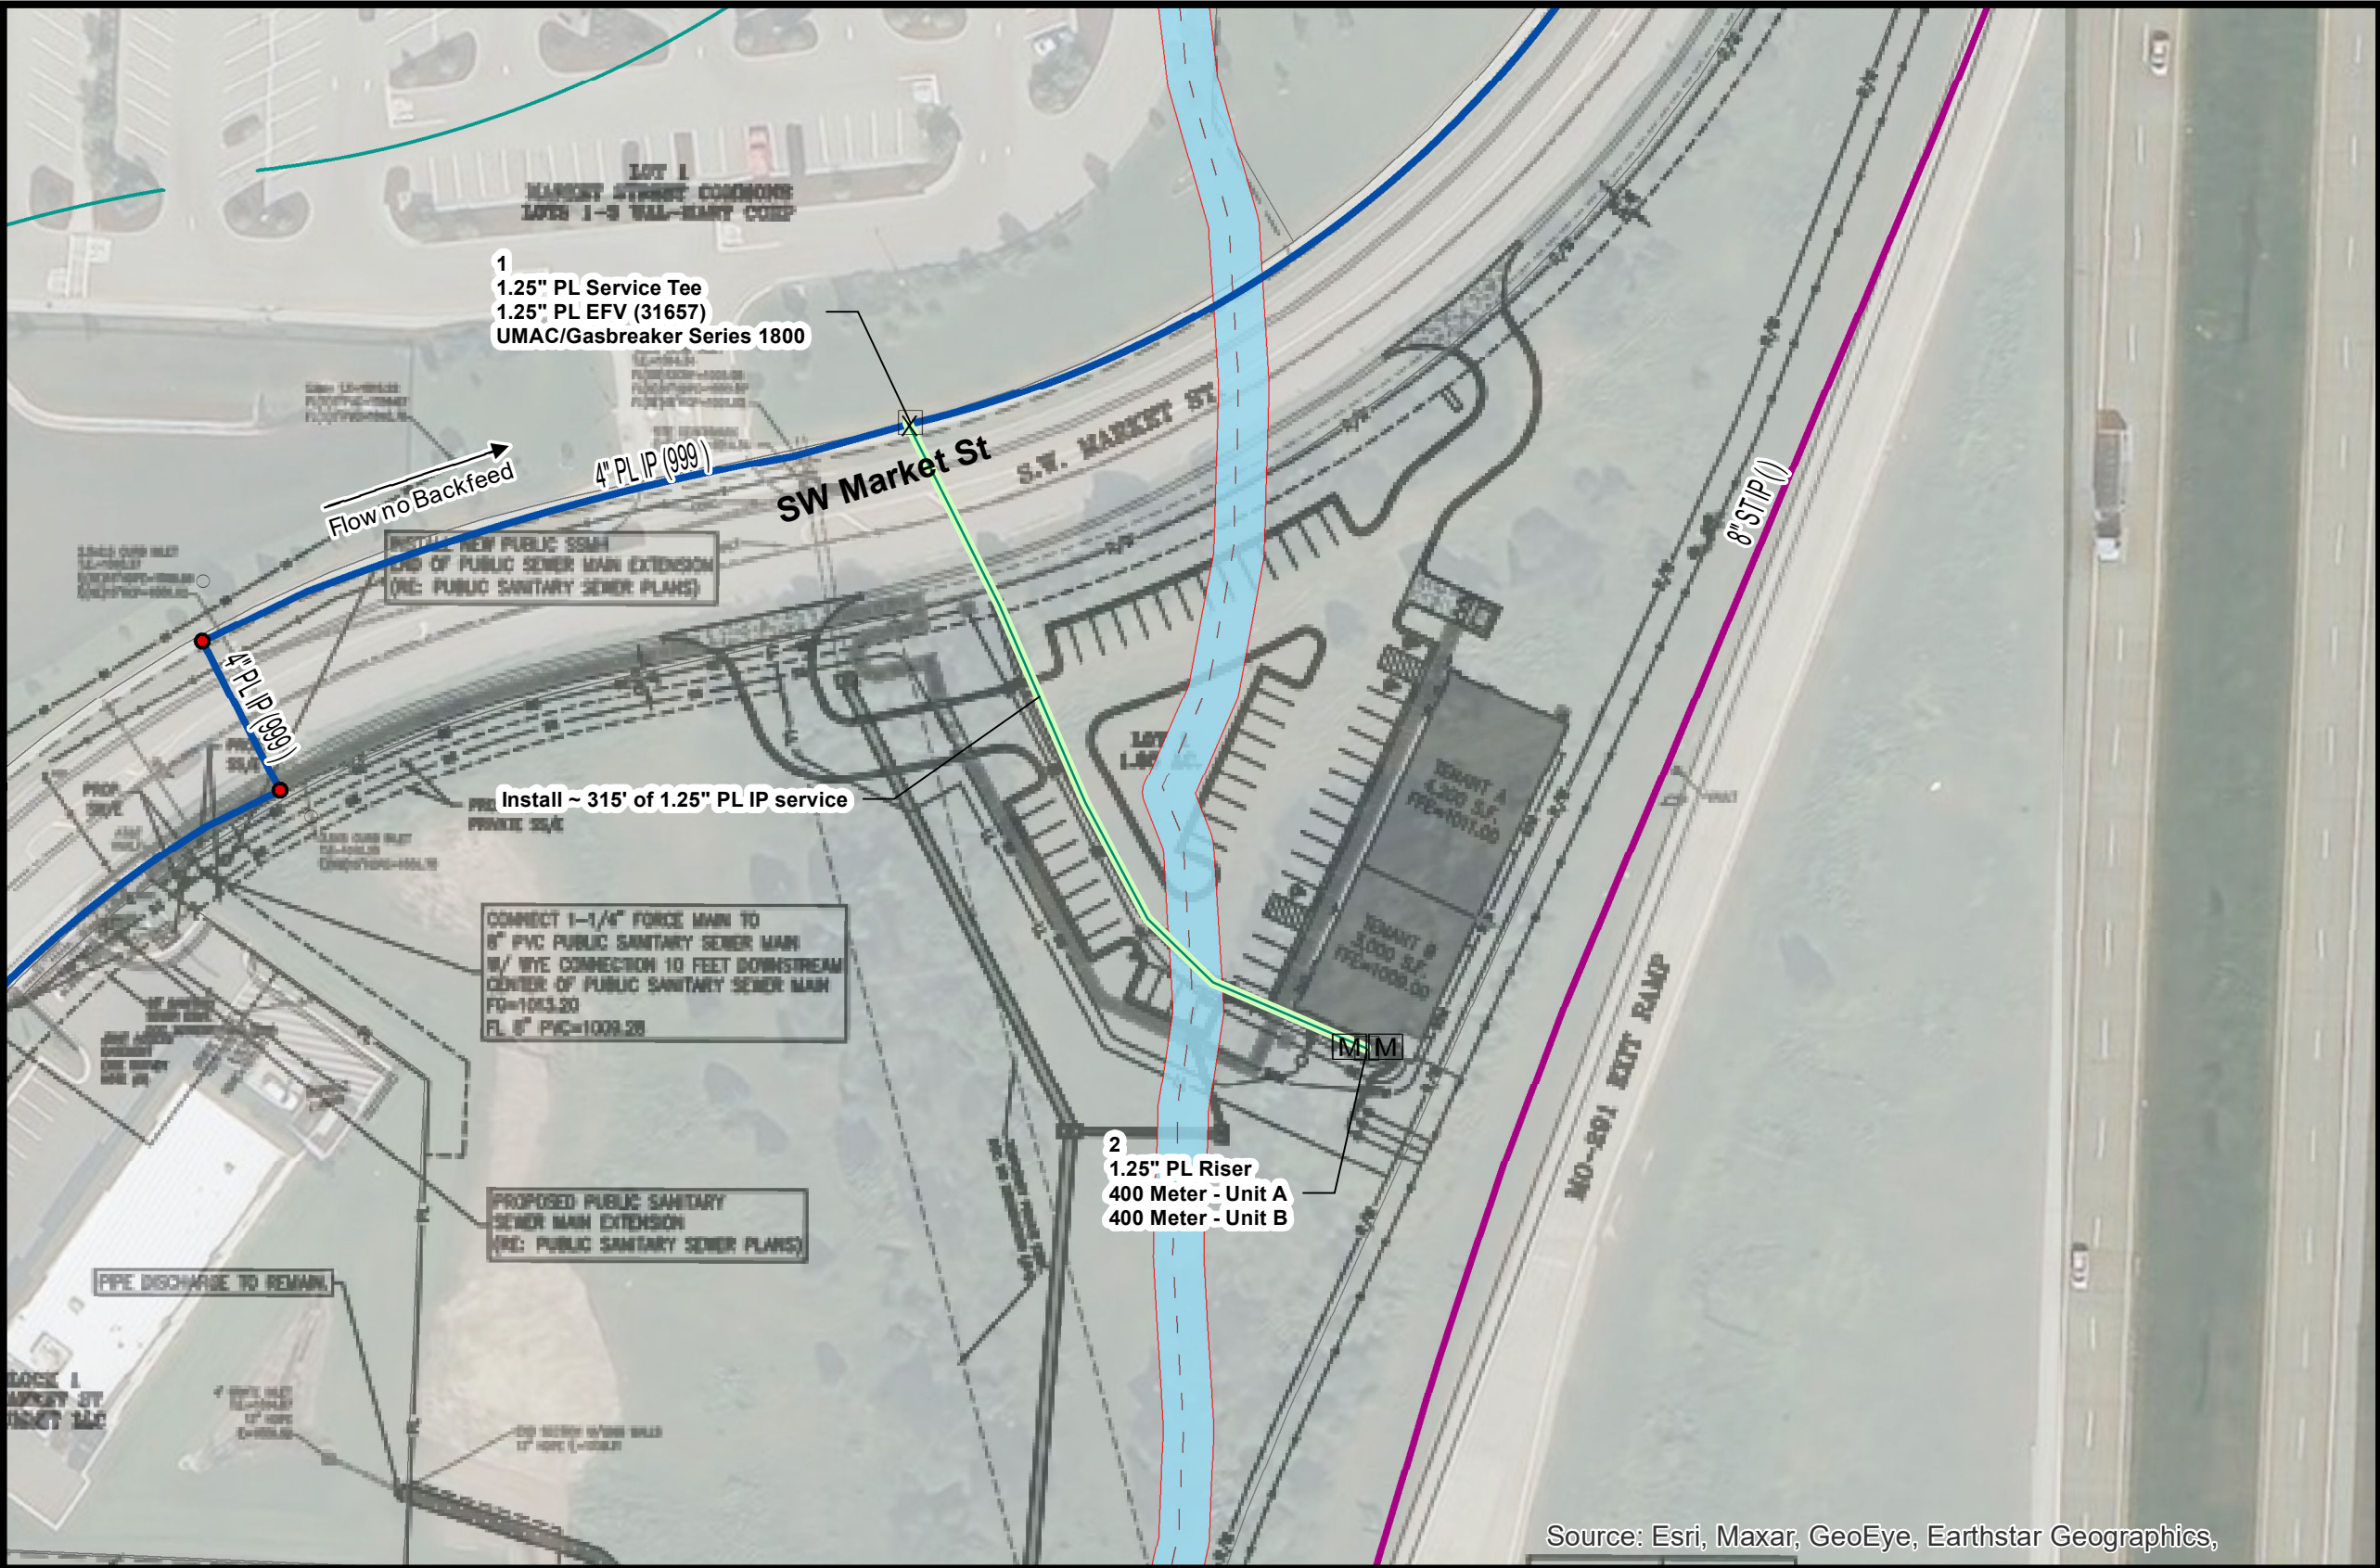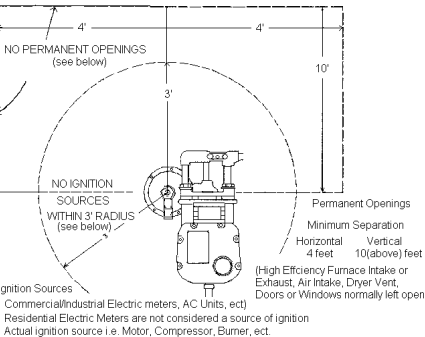

DESIGNER: BKW	REVISION DATE(S): _____ _____ _____
DATE: 6-15-22	_____ _____ _____

spire 
Missouri West

2501 SW MARKET ST
LEE'S SUMMIT
TOTAL LOAD 510 CFH
2 PSIG DELIVERY PRESSURE