


Town Centre Lot 1
520 NE Town Centre Drive
Lee's Summit, Missouri

VAN DEURZEN AND ASSOCIATES, P.A.

CONSULTING STRUCTURAL ENGINEERS

11011 KING STREET, SUITE 130
COMMERCE TERRACE BUILDING D
OVERLAND PARK, KANSAS 66210
(913) 451 - 6305 FAX (913) 451 - 1021

Reinforced Soil Retaining Wall Design

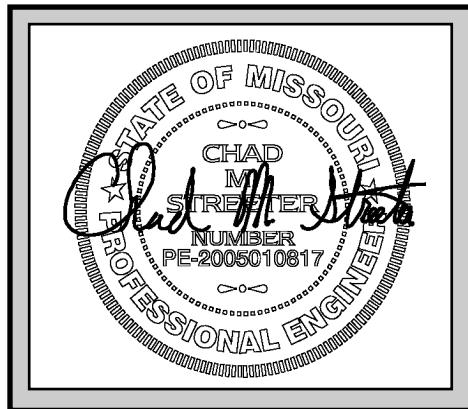

VAN DEURZEN AND ASSOCIATES, P.A.
September 8, 2022

Segmental Retaining Wall Design Calculations per NCMA

Wall Geometry

Height $H := 7.67 \cdot \text{ft}$	Backslope $\beta := 12.0 \cdot \text{deg}$	Dead Load $q_d := 0 \cdot \text{psf}$	Live Load $q_l := 0 \cdot \text{psf}$	Distance to Slope $Z := 1.0 \cdot \text{ft}$	Wall below grade at toe $H_{cmb} := .67 \cdot \text{ft}$
---------------------------------------	---	--	--	---	---

Soil Properties

Reinforced Soil (Internal) $\gamma_i := 110 \cdot \text{pcf}$ $\phi_i := 32 \cdot \text{deg}$ $C_{dsi} := 0.8$	Retained Soil (External) $\gamma_e := 120 \cdot \text{pcf}$ $\phi_e := 26 \cdot \text{deg}$ $C_{dse} := 1.0$	Drainage Fill $\gamma_d := 110 \cdot \text{pcf}$ $\phi_d := 32 \cdot \text{deg}$	Foundation Soil $\gamma_f := 120 \cdot \text{pcf}$ $\phi_f := 26 \cdot \text{deg}$ $c_f := 0.0 \text{ psf}$	Pullout $C_i := 0.7$
--	--	--	--	-------------------------

Segmental Unit Properties

Height $H_u := 8 \cdot \text{in}$	Length $L_u := 18 \cdot \text{in}$	Width $W_u := 12 \cdot \text{in}$	Setback $\Delta_u := 1.0 \cdot \text{in}$	Center of Gravity $G_u := 6 \cdot \text{in}$	Batter $\omega := \tan\left(\frac{\Delta_u}{H_u}\right)$ $\omega = 7.125 \cdot \text{deg}$
Infilled Unit Weight $\gamma_u := 120 \cdot \text{pcf}$	Hinge Height $H_h := \text{if} \left[\tan(\omega) = 0, H, \left[2 \cdot \frac{(W_u - G_u)}{\tan(\omega)} \right] \right] \Rightarrow H_h = 8 \text{ ft}$				[Eq. 4-1]

Internal Interface Friction Angle

$$\delta_i := \frac{2}{3} \cdot \phi_i \quad [\delta_i = 21.33 \cdot \text{deg}] \quad [\text{Eq. 3-17}]$$

Internal Active Earth Pressure

$$K_{ai} := \frac{\cos(\phi_i + \omega)^2}{\cos(\omega)^2 \cdot \cos(\omega - \delta_i) \cdot \left[1 + \sqrt{\left(\frac{\sin(\phi_i + \delta_i) \cdot \sin(\phi_i - \beta)}{\cos(\omega - \delta_i) \cdot \cos(\omega + \beta)} \right)^2} \right]^2} \quad [\text{Eq. 3-11}] \quad [K_{ai} = 0.263]$$

External Interface Friction Angle

$$\delta_e := \text{if}(\phi_i > \phi_e, \phi_e, \phi_i) \quad [\delta_e = 26 \cdot \text{deg}] \quad [\text{Eq. 3-16}]$$

External Active Earth Pressure

$$K_{ae} := \frac{\cos(\phi_e + \omega)^2}{\cos(\omega)^2 \cdot \cos(\omega - \delta_e) \cdot \left[1 + \sqrt{\left(\frac{\sin(\phi_e + \delta_e) \cdot \sin((\phi_e - \beta))}{\cos(\omega - \delta_e) \cdot \cos(\omega + \beta)} \right)^2} \right]^2} \quad [\text{Eq. 3-11}] \quad [K_{ae} = 0.352]$$

Orientation of Critical Internal Failure Surface

$$\alpha_i := \text{atan} \left[\frac{-\tan(\phi_i - \beta) + \sqrt{(\tan(\phi_i - \beta)) \cdot (\tan(\phi_i - \beta) + \cot(\phi_i + \omega)) \cdot (1 + \tan(\delta_i - \omega) \cdot \cot(\phi_i + \omega))}}{1 + \tan(\delta_i - \omega) \cdot (\tan(\phi_i - \beta) + \cot(\phi_i + \omega))} \right] + \phi_i \quad [\text{Eq. 3-14}] \quad [\alpha_i = 51.901 \cdot \text{deg}]$$

Orientation of Critical External Failure Surface

$$\alpha_e := \text{atan} \left[\frac{-\tan(\phi_e - \beta) + \sqrt{\tan(\phi_e - \beta) \cdot (\tan(\phi_e - \beta) + \cot(\phi_e + \omega)) \cdot (1 + \tan(\delta_e - \omega) \cdot \cot(\phi_e + \omega))}}{1 + \tan(\delta_e - \omega) \cdot (\tan(\phi_e - \beta) + \cot(\phi_e + \omega))} \right] + \phi_e \quad [\text{Eq. 3-14}] \quad [\alpha_e = 45.615 \cdot \text{deg}]$$

Sliding**External Stability Analysis**

Given

$$\min \left[\frac{C_{dse} \cdot \left[q_d \cdot \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] + L \cdot \gamma_e \cdot H \dots + \frac{1}{2} \cdot \gamma_e \cdot (L - W_u - Z) \cdot \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] \cdot \tan(\beta) \right] \cdot \tan(\phi_e)}{C_{dse} \cdot \left[q_d \cdot \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] + L \cdot \gamma_e \cdot H \dots + \frac{1}{2} \cdot \gamma_e \cdot (L - W_u - Z) \cdot \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] \cdot \tan(\beta) \right] \cdot \tan(\phi_d)} \right. \\ \left. \frac{C_{dse} \cdot c_f \cdot L + \left[q_d \cdot \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] + L \cdot \gamma_e \cdot H \dots + \frac{1}{2} \cdot \gamma_e \cdot (L - W_u - Z) \cdot \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] \cdot \tan(\beta) \right] \cdot \tan(\phi_f)}{1.5 = \left[\frac{1}{2} \cdot K_a_e \cdot \gamma_e \cdot \left[H + \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] \cdot \tan(\beta) \right]^2 \cdot \cos(\delta_e - \omega) \dots + (q_d + q_l) \cdot K_a_e \cdot \left[H + \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] \cdot \tan(\beta) \right] \cdot \cos(\delta_e - \omega) \right]} \right]$$

Overspinning

$L_{sliding} := \text{Find}(L)$

$L_{sliding} = 4.407 \text{ ft}$

Given

$$2.0 = \frac{\left[(L \cdot \gamma_e \cdot H) \cdot \left[\frac{1}{2} \cdot (L + H \cdot \tan(\omega)) \right] \right] \dots + \left[\frac{1}{2} \cdot \gamma_e \cdot (L - W_u - Z) \cdot \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] \cdot \tan(\beta) \right] \cdot \left[H \cdot \tan(\omega) + W_u + Z + \frac{2}{3} \cdot (L - W_u - Z) \right] + q_d \cdot \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] \cdot \frac{Z + \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right]}{2} + H \cdot \tan(\omega) +}{\left[\frac{1}{2} \cdot K_a_e \cdot \gamma_e \cdot \left[H + \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] \cdot \tan(\beta) \right]^2 \cdot \cos(\delta_e - \omega) \right] \cdot \left[\frac{1}{3} \cdot \left[H + \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] \cdot \tan(\beta) \right] \cdot \cos(\delta_e - \omega) \right] \cdot \left[\frac{1}{2} \cdot \left[H + \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] \cdot \tan(\beta) \right] \cdot \cos(\delta_e - \omega) \right]}$$

$L_{overspinning} := \text{Find}(L)$

$L_{overspinning} = 3.351 \text{ ft}$

$$L := \max \begin{pmatrix} L_{sliding} \\ L_{overspinning} \\ 0.7 \cdot H \end{pmatrix}$$

$L = 5.369 \text{ ft}$

Based on Overspinning and Sliding:

$L := 6.0 \text{ ft}$

Eccentricity

$$L' := L - W_u - Z$$

$$L' = 4 \text{ ft}$$

[Fig. 2-10] [Eq. 5-1]

$$L'' := \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)}$$

$$L'' = 0.109 \text{ ft}$$

[Fig. 2-10] [Eq. 5-2]

$$L_\beta := L' + L''$$

$$L_\beta = 4.109 \text{ ft}$$

[Fig. 2-10] [Eq. 5-3]

$$h := L_\beta \cdot \tan(\beta)$$

$$h = 0.873 \text{ ft}$$

[Fig. 2-10] [Eq. 5-4]

$$W_{ri} := L \cdot \gamma_i \cdot H$$

$$W_{ri} = 5062.2 \text{ plf}$$

[Eq. 5-15]

$$X_{ri} := \frac{1}{2} \cdot (L + H \cdot \tan(\omega))$$

$$X_{ri} = 3.479 \text{ ft}$$

[Eq. 5-19]

$$W_{r\beta} := \frac{1}{2} \cdot \gamma_i \cdot (L' - Z) \cdot h$$

$$W_{r\beta} = 144.116 \text{ plf}$$

[Eq. 5-16]

$$X_{r\beta} := H \cdot \tan(\omega) + W_u + \frac{2}{3} \cdot L_\beta + Z$$

$$X_{r\beta} = 5.698 \text{ ft}$$

[Eq. 5-20]

$$X_{q\beta} := \frac{Z + L_\beta}{2} + [(H + h) \cdot \tan(\omega)] + W_u$$

$$X_{q\beta} = 4.623 \text{ ft}$$

[Eq. 5-21]

Actual Height of wall:

$$H_s := (H + h)$$

$$H_s = 8.543 \text{ ft}$$

Earth Pressures:

$$P_{sH} := \left[\frac{1}{2} \cdot K_a e \cdot \gamma_e \cdot (H + h)^2 \cdot \cos(\delta_e - \omega) \right]$$

$$P_{sH} = 1459.939 \text{ plf}$$

[Eq. 5-6]

$$Y_s := \frac{1}{3} \cdot (H + h)$$

$$Y_s = 2.848 \text{ ft}$$

[Eq. 5-9]

$$P_{qH} := (q_d + q_l) \cdot K_a e \cdot (H + h) \cdot \cos(\delta_e - \omega)$$

$$P_{qH} = 0 \text{ plf}$$

[Eq. 5-8]

$$Y_q := \frac{1}{2} \cdot (H + h)$$

$$Y_q = 4.272 \text{ ft}$$

[Eq. 5-10]

$$\frac{e}{W_{ri} + W_{r\beta} + q_d \cdot (L_\beta)} = \frac{\left[P_{sH} \cdot Y_s + P_{qH} \cdot Y_q - W_{ri} \cdot \left(X_{ri} - \frac{L}{2} \right) - W_{r\beta} \cdot \left(X_{r\beta} - \frac{L}{2} \right) - q_d \cdot (L_\beta) \cdot \left(X_{q\beta} - \frac{L}{2} \right) \right]}{W_{ri} + W_{r\beta} + q_d \cdot (L_\beta)}$$

$$e = 0.2578 \text{ ft}$$

[Eq. 5-25]

Check $\frac{e}{W_{ri} + W_{r\beta} + q_d \cdot (L_\beta)} := \text{if}(e \leq 0, 0.075L, e)$

$$e = 0.258 \text{ ft}$$

Surcharge is applied over:

$$(L' + L'') = 4.109 \text{ ft}$$

$$B := L - 2 \cdot e$$

$$B = 5.484 \text{ ft}$$

[Eq. 5-24]

Bearing Capacity

$$Q_a := \frac{[W_{ri} + W_{rf\beta} + (q_d + q_l) \cdot (L' + L'')]}{B}$$

$$Q_a = 949.289 \cdot \text{psf}$$

$$N_q := \tan\left(45^\circ - \frac{\phi_f}{2}\right)^2 \cdot \exp(\pi \cdot \tan(\phi_f))$$

$$N_q = 11.854$$

[Fig. 4-5]

$$N_c := \text{if } [\phi_f = 0, 5.14, (N_q - 1) \cdot \cot(\phi_f)]$$

$$N_c = 22.254$$

[Fig. 4-5]

$$N_\gamma := 2(N_q + 1) \cdot \tan(\phi_f)$$

$$N_\gamma = 12.539$$

[Fig. 4-5]

$$Q_{ult} := c_f \cdot N_c + \frac{1}{2} \cdot \gamma_f \cdot B \cdot N_\gamma + \gamma_f \cdot H_{emb} \cdot N_q$$

$$Q_{ult} = 5079.185 \cdot \text{psf}$$

[Eq. 4-20]

$$FS_{bearing} := \frac{Q_{ult}}{Q_a}$$

$$FS_{bearing} = 5.351$$

[Eq. 4-19]

Internal Stability

Reinforcement Properties

Geogrid Design Data

Backfill Soil Type := (gravel)

1 2 3 4 5 6 7 8 9

Geogrid Number

$$\text{Type}^T = (411 \ 834 \ 1199 \ 1336 \ 2004 \ 2508 \ 3011 \ 3873 \ 7914)$$

$$GN1 := 2$$

$$GN2 := 2$$

$$\text{inter}^T = (1145 \ 1145 \ 1145 \ 1145 \ 1145 \ 1145 \ 0)$$

$$\text{slope}^T = (38 \ 38 \ 38 \ 38 \ 38 \ 38 \ 0)$$

$$\text{maxc}^T = (4540 \ 4540 \ 4540 \ 4540 \ 4540 \ 4540 \ 0) \quad x := 4..1 \quad x \text{ is the number of grids at the top of the wall of a different type}$$

$$T_a := \text{Type}_{GN1} \cdot \text{plf} \quad T_a = 834 \cdot \text{plf}$$

$$T_{a2} := \text{Type}_{GN2} \cdot \text{plf} \quad T_{a2} = 834 \cdot \text{plf}$$

$$a_{cs} := \text{inter}_{GN1} \cdot \text{plf} \quad a_{cs} = 1145 \cdot \text{plf}$$

$$\lambda_{cs} := \text{slope}_{GN1} \cdot \text{deg} \quad \lambda_{cs} = 38 \cdot \text{deg}$$

$$V_{csmax} := \text{maxc}_{GN1} \cdot \text{plf} \quad V_{csmax} = 4540 \cdot \text{plf}$$

$$a_{cs2} := \text{inter}_{GN2} \cdot \text{plf} \quad a_{cs2} = 1145 \cdot \text{plf}$$

$$\lambda_{cs2} := \text{slope}_{GN2} \cdot \text{deg} \quad \lambda_{cs2} = 38 \cdot \text{deg}$$

$$V_{csmax2} := \text{maxc}_{GN2} \cdot \text{plf} \quad V_{csmax2} = 4540 \cdot \text{plf}$$

Tension in Geogrid

Number of Grids:	Grig Spacing (ft):	# of grids for that spacing:	Depth of first grid (ft):	Length of grids:
$n_g := 3$	Spacing1 := 2	$n_1 := 3$	$h_1 := 2.33$	$L_1 := 6.0 \quad L_2 := 6.0 \quad L_t := \frac{L}{\text{ft}}$
	Spacing2 := 1.67	$n_2 := 0$		

Make all zero when using one geogrid

Note: make sure that the elevations don't exceed the height of the wall (H) $H = 7.67 \text{ ft}$

$$\begin{aligned} \text{top} &:= \text{length}(E) & p &:= 2.. \text{top} & \text{top} &= 3 \\ \text{grids} &:= \text{length}(E) & n &:= 1.. \text{top} & l &:= 1.. \text{grids} - 1 \end{aligned}$$

$$E = \begin{pmatrix} 2.33 \\ 4.33 \\ 6.33 \end{pmatrix} \text{ ft}$$

$$\begin{aligned} T_{a_x} &:= T_{a2} & T_{a_x} &= \begin{pmatrix} 834 \\ 834 \\ 834 \\ 834 \end{pmatrix} \cdot \text{plf} & \xrightarrow{\substack{\longrightarrow \\ L \cdot T_a}} \\ T_a &= \begin{pmatrix} 834 \\ 834 \\ 834 \end{pmatrix} \cdot \text{plf} \end{aligned}$$

$$L = \begin{pmatrix} 6 \\ 6 \\ 6 \end{pmatrix} \text{ ft}$$

$$T_a^T = (834 \ 834 \ 834 \ 834) \cdot \text{plf}$$

$$D_p := \frac{E_{p-1} + E_p}{2} \quad D_1 := 0 \text{ ft} \quad D_{\text{grids}+1} := H$$

$$D^T = (0 \ 3.33 \ 5.33 \ 7.67) \text{ ft}$$

Total Applied Tensile Strength in the Geosynthetic reinf.:

$$F_{g_n} := \int_{D_n}^{D_{(n+1)}} (\gamma_i \cdot D + q_l + q_d) \cdot K a_i \cdot \cos(\delta_i - \omega) \, dD \quad [\text{Eq. 5-36}]$$

$$F_g^T = (155.706 \ 243.201 \ 427.146) \cdot \text{plf}$$

Safety factor:

$$FS_{ten_n} := \frac{T_{a_n}}{F_{g_n}} \quad FS_{ten}^T = (5.356 \ 3.429 \ 1.952)$$

Pullout Capacity

Anchorage Length of Geosynthetic

$$La_n := L_n - W_u - [(H + h) - E_n] \cdot \tan(90^\circ - \alpha_i) + [(H + h) - E_n] \cdot \tan(\omega) \quad [\text{Eq. 5-46}]$$

$$La^T = (0.905 \quad 2.223 \quad 3.541) \text{ ft}$$

Note: If the anchorage length is less than 1ft then there is not enough embedment length and it has to be increased. Note that in some cases it might just be the top two grids.

Average Depth of overburden on Anchorage length

$$d_n := E_n + \left[(H - E_n) \cdot \tan(90^\circ - \alpha_i) + \frac{La_n}{2} - (Z + H \cdot \tan(\omega) - \Delta_u) \right] \cdot \tan(\beta) \quad [\text{Eq. 5-47}]$$

$$d^T = (2.917 \quad 4.724 \quad 6.531) \text{ ft}$$

Anchorage Capacity

$$AC_n := 2 \cdot La_n \cdot C_i \cdot (d_n \cdot \gamma_i + q_d) \cdot \tan(\phi_i) \quad [\text{Eq. 5-45}]$$

$$AC^T = (254.072 \quad 1010.654 \quad 2225.588) \cdot \text{plf}$$

$$F_g^T = (155.706 \quad 243.201 \quad 427.146) \cdot \text{plf}$$

Safety Factor

$$FS_{po} := \frac{\overrightarrow{AC}}{F_g} \quad [\text{Eq. 5-44}]$$

$$FS_{po}^T = (1.632 \quad 4.156 \quad 5.21)$$

Internal Sliding

Reduced reinforcement length

$$\Delta L_{l+1} := \begin{cases} \left[(E_{l+1} - E_l) \cdot \left(\frac{1}{\tan(\alpha_e)} - \tan(\omega) \right) \right] & \text{if } n_g > 2 \\ \text{Spacing1} \cdot \text{ft} \cdot \left(\frac{1}{\tan(\alpha_e)} - \tan(\omega) \right) & \text{if } n_g = 2 \\ 0 & \text{if } n_g = 1 \end{cases} \quad [\text{Eq. 5-51}]$$

$$\Delta L^T = (0 \quad 1.707 \quad 1.707) \text{ ft}$$

$$L'_{s_n} := L_n - W_u - \Delta L_n \quad [\text{Eq. 5-50}]$$

$$L'_s^T = (5 \quad 3.293 \quad 3.293) \text{ ft}$$

Length of sloping ground

$$L_{s\beta_n} := L'_{s_n} + \frac{(L'_{s_n} - W_u) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} - Z \quad [\text{Eq. 5-53 & 5-52}]$$

$$\underline{L}_{s\beta}^T = (4.109 \ 2.355 \ 2.355) \text{ ft}$$

Height of slope above crest of wall

$$h'_n := L_{s\beta_n} \cdot \tan(\beta) \quad [\text{Eq. 5-54}]$$

$$\underline{h}^T = (0.873 \ 0.501 \ 0.501) \text{ ft}$$

Weight of reduced reinforced area

$$W'_{ri_n} := L'_{s_n} \cdot E_n \cdot \gamma_i \quad [\text{Eq. 5-55}]$$

$$\underline{W'}_{ri}^T = (1282 \ 1568 \ 2293) \cdot \text{plf}$$

Weight of wedge beyond reinforced soil zone

$$W'_{r\beta_n} := \frac{1}{2} \cdot \left(L_{s\beta_n} \cdot h'_n \right) \cdot \gamma_i \quad [\text{Eq. 5-56}]$$

$$\underline{W'}_{r\beta}^T = (197.4 \ 64.84 \ 64.84) \cdot \text{plf}$$

Friction developed by weight

$$R'_{s_n} := C_{dsi} \cdot \left[q_d \cdot \left(L_{s\beta_n} + Z \right) + W'_{ri_n} + W'_{r\beta_n} \right] \cdot \tan(\phi_i) \quad [\text{Eq. 5-49}]$$

$$\underline{R'}_s^T = (739 \ 816 \ 1178) \cdot \text{plf}$$

Shear capacity of facing elements

$$V_{u_n} := \min[V_{csmax}, a_{cs} + (\text{if}(E_n > H_h, H_h, E_n) \cdot \gamma_u \cdot W_u) \cdot \tan(\lambda_{cs})] \quad [\text{Eq. 4-25}]$$

$$\underline{V}_u^T = (1363 \ 1551 \ 1738) \cdot \text{plf}$$

Driving Forces

From retained soil

$$P_{s_n} := \left[\frac{1}{2} \cdot K_a e \cdot \gamma_e \cdot (E_n + h'_n)^2 \cdot \cos(\delta_e - \omega) \right] \quad [\text{Eq. 5-6}]$$

$$\underline{P_s}^T = (205 \ 467 \ 933) \cdot \text{plf}$$

From surcharge

$$P_{q_n} := (q_d + q_l) \cdot K_a e \cdot (E_n + h'_n) \cdot \cos(\delta_e - \omega) \quad [\text{Eq. 5-8}]$$

$$\underline{P_q}^T = (0 \ 0 \ 0) \cdot \text{plf}$$

Factor of safety against internal sliding

$$P_{a_n} := P_{s_n} + P_{q_n} \quad [\text{Eq. 5-11}]$$

$$\underline{P_a}^T = (205 \ 467 \ 933) \cdot \text{plf}$$

$$FS_{sl_n} := \frac{R'_{s_n} + V_{u_n}}{(P_{a_n})} \quad [\text{Eq. 5-48}]$$

$$\underline{FS_{sl}}^T = (10.244 \ 5.072 \ 3.126)$$

Local Stability of Facing Units

Facing Connection Strength

$$T_{conn,n} := \min \left[V_{csmax,n}, a_{cs,n} + \left(\text{if}(E_n > H_h, H_h, E_n) \cdot \gamma_u \cdot W_u \right) \cdot \tan(\lambda_{cs,n}) \right] \quad [\text{Eq. 5-59}]$$

$$\boxed{T_{conn}^T = (1363 \ 1551 \ 1738) \cdot \text{plf}}$$

$$FS_{conn,n} := \frac{T_{conn,n}}{F_{g,n}} \quad \boxed{FS_{conn}^T = (8.757 \ 6.377 \ 4.07)}$$

Resistance to Bulging

Shear capacity at each geogrid layer

$$V_{u,n} := \min \left[V_{csmax}, a_{cs} + \left(\text{if}(E_n > H_h, H_h, E_n) \cdot \gamma_u \cdot W_u \right) \cdot \tan(\lambda_{cs}) \right] \quad [\text{Eq. 4-25}]$$

$$\boxed{V_u^T = (1363 \ 1551 \ 1738) \cdot \text{plf}}$$

Driving Force at each geogrid layer

$$P_{a,n} := \left[\frac{1}{2} \cdot K_a \cdot \gamma_i \cdot (E_n)^2 \cdot \cos(\delta_i - \omega) \right] + (q_d + q_l) \cdot K_a \cdot (E_n) \cdot \cos(\delta_i - \omega) \quad [\text{Eq. 5-11}]$$

$$\boxed{P_a^T = (76 \ 263 \ 563) \cdot \text{plf}}$$

Sum of tension in reinforcement layers above layer being considered

$$F_{n+1} := \sum_{i=1}^n F_{g,i}$$

$$\boxed{F^T = (0 \ 156 \ 399 \ 826) \cdot \text{plf}}$$

$$FS_{sc,n} := \frac{V_{u,n}}{P_{a,n} - F_n} \quad [\text{Eq. 5-61}]$$

$$\boxed{FS_{sc}^T = (17.886 \ 14.42 \ 10.618)}$$

Maximum unreinforced height of SRW units

$$y := E_1 = 2.33 \text{ ft}$$

$$\gamma_w := 0 \text{ psf}$$

Moment equilibrium

Driving Moments

$$P'_s := \left[\frac{1}{2} \cdot K_a \cdot \gamma_i \cdot (y)^2 \cdot \cos(\delta_i - \omega) \right] \quad [\text{Eq. 4-5}]$$

$$\boxed{P'_s = 76.231 \cdot \text{plf}}$$

$$P'_q := (q_d + q_l) \cdot K_{a_i} \cdot (y) \cdot \cos(\delta_i - \omega)$$

[Eq. 4-6]

$$P'_q = 0 \cdot \text{plf}$$

$$P'_a := P'_s + P'_q$$

[Eq. 4-4]

$$P'_a = 76.231 \cdot \text{plf}$$

$$Y'_s := \frac{1}{3} \cdot y$$

[Eq. 4-7]

$$Y'_s = 0.777 \text{ ft}$$

$$Y'_q := \frac{1}{2} \cdot y$$

[Eq. 4-8]

$$Y'_q = 1.17 \text{ ft}$$

$$M'_o := P'_s \cdot Y'_s + P'_q \cdot Y'_q$$

[Eq. 4-17]

$$M'_o = 59.21 \cdot \text{lbft}$$

Resisting Moments

$$W'_w := y \cdot \gamma_u \cdot W_u$$

[Eq. 4-9]

$$W'_w = 279.6 \cdot \text{plf}$$

$$X'_w := G_u + \frac{1}{2} \cdot (y) \cdot \tan(\omega)$$

[Eq. 4-16]

$$X'_w = 0.646 \text{ ft}$$

$$M'_r := W'_w \cdot X'_w$$

[Eq. 4-15]

$$M'_r = 180.517 \text{ ft} \cdot \text{plf}$$

$$FS_{ot} := \frac{M'_r}{M'_o}$$


[Eq. 4-14]

$$FS_{ot} = 3.049$$

Factor of Safety against Shear failure

$$V'_u := a_{cs} + W'_w \cdot \tan(\lambda_{cs})$$

[Eq. 4-25]



$$FS_{sh} := \frac{V'_u}{P'_a}$$

[Eq. 4-27]

Summary

Wall Height

$$H = 7.67 \text{ ft}$$

Unreinforced Stability

$$FS_{ot} = 3.049$$

$$FS_{bearing} = 5.351$$

Applied Bearing Stress

$$Q_a = 949 \cdot \text{psf}$$

Grid Elevation	Geogrid Length	Tensile Force	Geogrid Strength	Anch. Length	Anch. Capacity	FS Grid Tension (1.0)	FS Pullout (1.5)	FS Int Sliding (1.5)	FS Conn (1.5)	FS Bulging (1.5)
$E_n =$	$L_n =$	$\frac{F_{g_n}}{\text{plf}} =$	$\frac{T_{a_n}}{\text{plf}} =$	$La_n =$	$\frac{AC_n}{\text{plf}} =$	$FS_{ten_n} =$	$FS_{po_n} =$	$FS_{sl_n} =$	$FS_{conn_n} =$	$FS_{sc_n} =$
2.33	ft	6	ft	156	834	0.9	254	5.36	1.63	10.24
4.33		6		243	834	2.22	1011	3.43	4.16	5.07
6.33		6		427	834	3.54	2226	1.95	5.21	3.13

Segmental Retaining Wall Design Calculations per NCMA

Wall Geometry

Height $H_{\text{w}} := 6.33 \cdot \text{ft}$	Backslope $\beta := 12.0 \cdot \text{deg}$	Dead Load $q_d := 0 \cdot \text{psf}$	Live Load $q_l := 0 \cdot \text{psf}$	Distance to Slope $Z := 1.0 \cdot \text{ft}$	Wall below grade at toe $H_{\text{cmb}} := .67 \cdot \text{ft}$
--	---	--	--	---	--

Soil Properties

Reinforced Soil (Internal) $\gamma_i := 110 \cdot \text{pcf}$ $\phi_i := 32 \cdot \text{deg}$ $C_{\text{dsi}} := 0.8$	Retained Soil (External) $\gamma_e := 120 \cdot \text{pcf}$ $\phi_e := 26 \cdot \text{deg}$ $C_{\text{dse}} := 1.0$	Drainage Fill $\gamma_d := 110 \cdot \text{pcf}$ $\phi_d := 32 \cdot \text{deg}$	Foundation Soil $\gamma_f := 120 \cdot \text{pcf}$ $\phi_f := 26 \cdot \text{deg}$ $c_f := 0.0 \text{ psf}$	Pullout $C_i := 0.7$
---	---	--	--	-------------------------

Segmental Unit Properties

Height $H_u := 8 \cdot \text{in}$	Length $L_u := 18 \cdot \text{in}$	Width $W_u := 12 \cdot \text{in}$	Setback $\Delta_u := 1.0 \cdot \text{in}$	Center of Gravity $G_u := 6 \cdot \text{in}$	Batter $\omega := \tan\left(\frac{\Delta_u}{H_u}\right)$ $\omega = 7.125 \cdot \text{deg}$
Infilled Unit Weight $\gamma_u := 120 \cdot \text{pcf}$	Hinge Height $H_h := \text{if} \left[\tan(\omega) = 0, H, \left[2 \cdot \frac{(W_u - G_u)}{\tan(\omega)} \right] \right] \Rightarrow H_h = 8 \text{ ft}$				[Eq. 4-1]

Internal Interface Friction Angle

$$\delta_i := \frac{2}{3} \cdot \phi_i \quad [\delta_i = 21.33 \cdot \text{deg}] \quad [\text{Eq. 3-17}]$$

Internal Active Earth Pressure

$$K_{a_i} := \frac{\cos(\phi_i + \omega)^2}{\cos(\omega)^2 \cdot \cos(\omega - \delta_i) \cdot \left[1 + \sqrt{\left(\frac{\sin(\phi_i + \delta_i) \cdot \sin(\phi_i - \beta)}{\cos(\omega - \delta_i) \cdot \cos(\omega + \beta)} \right)^2} \right]^2} \quad [\text{Eq. 3-11}] \quad [K_{a_i} = 0.263]$$

External Interface Friction Angle

$$\delta_e := \text{if}(\phi_i > \phi_e, \phi_e, \phi_i) \quad [\delta_e = 26 \cdot \text{deg}] \quad [\text{Eq. 3-16}]$$

External Active Earth Pressure

$$K_{a_e} := \frac{\cos(\phi_e + \omega)^2}{\cos(\omega)^2 \cdot \cos(\omega - \delta_e) \cdot \left[1 + \sqrt{\left(\frac{\sin(\phi_e + \delta_e) \cdot \sin((\phi_e - \beta))}{\cos(\omega - \delta_e) \cdot \cos(\omega + \beta)} \right)^2} \right]^2} \quad [\text{Eq. 3-11}] \quad [K_{a_e} = 0.352]$$

Orientation of Critical Internal Failure Surface

$$\alpha_i := \text{atan} \left[\frac{-\tan(\phi_i - \beta) + \sqrt{(\tan(\phi_i - \beta)) \cdot (\tan(\phi_i - \beta) + \cot(\phi_i + \omega)) \cdot (1 + \tan(\delta_i - \omega) \cdot \cot(\phi_i + \omega))}}{1 + \tan(\delta_i - \omega) \cdot (\tan(\phi_i - \beta) + \cot(\phi_i + \omega))} \right] + \phi_i \quad [\text{Eq. 3-14}] \quad [\alpha_i = 51.901 \cdot \text{deg}]$$

Orientation of Critical External Failure Surface

$$\alpha_e := \text{atan} \left[\frac{-\tan(\phi_e - \beta) + \sqrt{\tan(\phi_e - \beta) \cdot (\tan(\phi_e - \beta) + \cot(\phi_e + \omega)) \cdot (1 + \tan(\delta_e - \omega) \cdot \cot(\phi_e + \omega))}}{1 + \tan(\delta_e - \omega) \cdot (\tan(\phi_e - \beta) + \cot(\phi_e + \omega))} \right] + \phi_e \quad [\text{Eq. 3-14}] \quad [\alpha_e = 45.615 \cdot \text{deg}]$$

Sliding**External Stability Analysis**

Given

$$\min \left[\frac{C_{dse} \cdot \left[q_d \cdot \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] + L \cdot \gamma_e \cdot H \dots + \frac{1}{2} \cdot \gamma_e \cdot (L - W_u - Z) \cdot \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] \cdot \tan(\beta) \right] \cdot \tan(\phi_e)}{C_{dse} \cdot \left[q_d \cdot \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] + L \cdot \gamma_e \cdot H \dots + \frac{1}{2} \cdot \gamma_e \cdot (L - W_u - Z) \cdot \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] \cdot \tan(\beta) \right] \cdot \tan(\phi_d)} \right. \\ \left. \frac{C_{dse} \cdot c_f \cdot L + \left[q_d \cdot \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] + L \cdot \gamma_e \cdot H \dots + \frac{1}{2} \cdot \gamma_e \cdot (L - W_u - Z) \cdot \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] \cdot \tan(\beta) \right] \cdot \tan(\phi_f)}{1.5 = \left[\frac{1}{2} \cdot K_a_e \cdot \gamma_e \cdot \left[H + \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] \cdot \tan(\beta) \right]^2 \cdot \cos(\delta_e - \omega) \dots + (q_d + q_l) \cdot K_a_e \cdot \left[H + \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] \cdot \tan(\beta) \right] \cdot \cos(\delta_e - \omega) \right]} \right]$$

Overspinning

$L_{sliding} := \text{Find}(L)$

$L_{sliding} = 3.562 \text{ ft}$

Given

$$2.0 = \frac{\left[(L \cdot \gamma_e \cdot H) \cdot \left[\frac{1}{2} \cdot (L + H \cdot \tan(\omega)) \right] \right] \dots + \left[\frac{1}{2} \cdot \gamma_e \cdot (L - W_u - Z) \cdot \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] \cdot \tan(\beta) \right] \cdot \left[H \cdot \tan(\omega) + W_u + Z + \frac{2}{3} \cdot (L - W_u - Z) \right] + q_d \cdot \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] \cdot \frac{Z + \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right]}{2} + H \cdot \tan(\omega) +}{\left[\frac{1}{2} \cdot K_a_e \cdot \gamma_e \cdot \left[H + \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] \cdot \tan(\beta) \right]^2 \cdot \cos(\delta_e - \omega) \right] \cdot \left[\frac{1}{3} \cdot \left[H + \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] \cdot \tan(\beta) \right] \cdot \cos(\delta_e - \omega) \right] \cdot \left[\frac{1}{2} \cdot \left[H + \left[(L - W_u - Z) + \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} \right] \cdot \tan(\beta) \right] \cdot \cos(\delta_e - \omega) \right]}$$

$L_{overspinning} := \text{Find}(L)$

$L_{overspinning} = 2.716 \text{ ft}$

$$L := \max \begin{pmatrix} L_{sliding} \\ L_{overspinning} \\ 0.7 \cdot H \end{pmatrix}$$

$L = 4.431 \text{ ft}$

Based on Overspinning and Sliding:

$L := 5.0 \text{ ft}$

Eccentricity

$$L' := L - W_u - Z$$

$$L' = 3 \text{ ft}$$

[Fig. 2-10] [Eq. 5-1]

$$L'' := \frac{(L - W_u - Z) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)}$$

$$L'' = 0.082 \text{ ft}$$

[Fig. 2-10] [Eq. 5-2]

$$L_\beta := L' + L''$$

$$L_\beta = 3.082 \text{ ft}$$

[Fig. 2-10] [Eq. 5-3]

$$h := L_\beta \cdot \tan(\beta)$$

$$h = 0.655 \text{ ft}$$

[Fig. 2-10] [Eq. 5-4]

$$W_{ri} := L \cdot \gamma_i \cdot H$$

$$W_{ri} = 3481.5 \cdot \text{plf}$$

[Eq. 5-15]

$$X_{ri} := \frac{1}{2} \cdot (L + H \cdot \tan(\omega))$$

$$X_{ri} = 2.896 \text{ ft}$$

[Eq. 5-19]

$$W_{r\beta} := \frac{1}{2} \cdot \gamma_i \cdot (L' - Z) \cdot h$$

$$W_{r\beta} = 72.058 \cdot \text{plf}$$

[Eq. 5-16]

$$X_{r\beta} := H \cdot \tan(\omega) + W_u + \frac{2}{3} \cdot L_\beta + Z$$

$$X_{r\beta} = 4.846 \text{ ft}$$

[Eq. 5-20]

$$X_{q\beta} := \frac{Z + L_\beta}{2} + [(H + h) \cdot \tan(\omega)] + W_u$$

$$X_{q\beta} = 3.914 \text{ ft}$$

[Eq. 5-21]

Actual Height of wall:

$$H_s := (H + h)$$

$$H_s = 6.985 \text{ ft}$$

Earth Pressures:

$$P_{sH} := \left[\frac{1}{2} \cdot K_a e \cdot \gamma_e \cdot (H + h)^2 \cdot \cos(\delta_e - \omega) \right]$$

$$P_{sH} = 975.915 \cdot \text{plf}$$

[Eq. 5-6]

$$Y_s := \frac{1}{3} \cdot (H + h)$$

$$Y_s = 2.328 \text{ ft}$$

[Eq. 5-9]

$$P_{qH} := (q_d + q_l) \cdot K_a e \cdot (H + h) \cdot \cos(\delta_e - \omega)$$

$$P_{qH} = 0 \cdot \text{plf}$$

[Eq. 5-8]

$$Y_q := \frac{1}{2} \cdot (H + h)$$

$$Y_q = 3.493 \text{ ft}$$

[Eq. 5-10]

$$\frac{e := \left[P_{sH} \cdot Y_s + P_{qH} \cdot Y_q - W_{ri} \cdot \left(X_{ri} - \frac{L}{2} \right) - W_{r\beta} \cdot \left(X_{r\beta} - \frac{L}{2} \right) - q_d \cdot (L_\beta) \cdot \left(X_{q\beta} - \frac{L}{2} \right) \right]}{W_{ri} + W_{r\beta} + q_d \cdot (L_\beta)}$$

$$e = 0.2043 \text{ ft}$$

[Eq. 5-25]

Check $\textcolor{green}{e} := \text{if}(e \leq 0, 0.075L, e)$

$$e = 0.204 \text{ ft}$$

Surcharge is applied over:

$$(L' + L'') = 3.082 \text{ ft}$$

$$B := L - 2 \cdot e$$

$$B = 4.591 \text{ ft}$$

[Eq. 5-24]

Bearing Capacity

$$Q_a := \frac{[W_{ri} + W_{rf\beta} + (q_d + q_l) \cdot (L' + L'')]}{B}$$

$$Q_a = 773.948 \cdot \text{psf}$$

$$N_q := \tan\left(45^\circ - \frac{\phi_f}{2}\right)^2 \cdot \exp(\pi \cdot \tan(\phi_f))$$

$$N_q = 11.854$$

[Fig. 4-5]

$$N_c := \text{if}[\phi_f = 0, 5.14, (N_q - 1) \cdot \cot(\phi_f)]$$

$$N_c = 22.254$$

[Fig. 4-5]

$$N_\gamma := 2(N_q + 1) \cdot \tan(\phi_f)$$

$$N_\gamma = 12.539$$

[Fig. 4-5]

$$Q_{ult} := c_f \cdot N_c + \frac{1}{2} \cdot \gamma_f \cdot B \cdot N_\gamma + \gamma_f \cdot H_{emb} \cdot N_q$$

$$Q_{ult} = 4407.374 \cdot \text{psf}$$

[Eq. 4-20]

$$FS_{bearing} := \frac{Q_{ult}}{Q_a}$$

$$FS_{bearing} = 1$$

[Eq. 4-19]

Internal Stability

Reinforcement Properties

Geogrid Design Data

Backfill Soil Type := (gravel)

1 2 3 4 5 6 7 8 9

Geogrid Number

$$\text{Type}^T = (411 \ 834 \ 1199 \ 1336 \ 2004 \ 2508 \ 3011 \ 3873 \ 7914)$$

$$GN1 := 2$$

$$GN2 := 2$$

$$\text{inter}^T = (1145 \ 1145 \ 1145 \ 1145 \ 1145 \ 1145 \ 0)$$

$$\text{slope}^T = (38 \ 38 \ 38 \ 38 \ 38 \ 38 \ 0)$$

$$\text{maxc}^T = (4540 \ 4540 \ 4540 \ 4540 \ 4540 \ 4540 \ 0) \quad x := 4..1 \quad x \text{ is the number of grids at the top of the wall of a different type}$$

$$T_a := \text{Type}_{GN1} \cdot \text{plf} \quad T_a = 834 \cdot \text{plf}$$

$$T_{a2} := \text{Type}_{GN2} \cdot \text{plf} \quad T_{a2} = 834 \cdot \text{plf}$$

$$a_{cs} := \text{inter}_{GN1} \cdot \text{plf} \quad a_{cs} = 1145 \cdot \text{plf}$$

$$\lambda_{cs} := \text{slope}_{GN1} \cdot \text{deg} \quad \lambda_{cs} = 38 \cdot \text{deg}$$

$$V_{csmax} := \text{maxc}_{GN1} \cdot \text{plf} \quad V_{csmax} = 4540 \cdot \text{plf}$$

$$a_{cs2} := \text{inter}_{GN2} \cdot \text{plf} \quad a_{cs2} = 1145 \cdot \text{plf}$$

$$\lambda_{cs2} := \text{slope}_{GN2} \cdot \text{deg} \quad \lambda_{cs2} = 38 \cdot \text{deg}$$

$$V_{csmax2} := \text{maxc}_{GN2} \cdot \text{plf} \quad V_{csmax2} = 4540 \cdot \text{plf}$$

Tension in Geogrid

Number of Grids:	Grig Spacing (ft):	# of grids for that spacing:	Depth of first grid (ft):	Length of grids:
$n_g := 3$	$Spacing1 := 2$	$n_1 := 2$	$h_1 := 2.33$	$L_1 := 5.0 \quad L_2 := 5.0 \quad L_t := \frac{L}{ft}$
	$Spacing2 := 1.33$	$n_2 := 1$		

Make all zero when using one geogrid

Note: make sure that the elevations don't exceed the height of the wall (H) $H = 6.33$ ft

$$\begin{aligned} top &:= \text{length}(E) & p &:= 2..top & top &= 3 \\ \text{grids} &:= \text{length}(E) & n &:= 1..top & l &:= 1.. \text{grids} - 1 \end{aligned}$$

$$E = \begin{pmatrix} 2.33 \\ 4.33 \\ 5.66 \end{pmatrix} \text{ ft}$$

$$\begin{aligned} T_{a_x} &:= T_{a2} & T_{a_x} &= \begin{pmatrix} 834 \\ 834 \\ 834 \\ 834 \end{pmatrix} \cdot \text{plf} & \xrightarrow{\text{L} \cdot T_a} \\ T_{a_x} &:= \frac{T_a}{L} & T_a &= \begin{pmatrix} 834 \\ 834 \\ 834 \end{pmatrix} \cdot \text{plf} \end{aligned}$$

$$L = \begin{pmatrix} 5 \\ 5 \\ 5 \end{pmatrix} \text{ ft}$$

$$T_a^T = (834 \ 834 \ 834 \ 834) \cdot \text{plf}$$

$$D_p := \frac{E_{p-1} + E_p}{2} \quad D_1 := 0 \cdot \text{ft} \quad D_{\text{grids}+1} := H$$

$$D^T = (0 \ 3.33 \ 4.995 \ 6.33) \text{ ft}$$

Total Applied Tensile Strength in the Geosynthetic reinf.:

$$F_{g_n} := \int_{D_n}^{D_{(n+1)}} (\gamma_i \cdot D + q_l + q_d) \cdot K a_i \cdot \cos(\delta_i - \omega) dD \quad [\text{Eq. 5-36}]$$

$$F_g^T = (155.706 \ 194.633 \ 212.293) \cdot \text{plf}$$

Safety factor:

$$FS_{ten_n} := \frac{T_{a_n}}{F_{g_n}} \quad FS_{ten}^T = (5.356 \ 4.285 \ 3.929)$$

Pullout Capacity

Anchorage Length of Geosynthetic

$$La_n := L_n - W_u - [(H + h) - E_n] \cdot \tan(90^\circ - \alpha_i) + [(H + h) - E_n] \cdot \tan(\omega) \quad [\text{Eq. 5-46}]$$

$$[La_n^T = (0.932 \ 2.25 \ 3.127) \text{ ft}]$$

Note: If the anchorage length is less than 1ft then there is not enough embedment length and it has to be increased. Note that in some cases it might just be the top two grids.

Average Depth of overburden on Anchorage length

$$d_n := E_n + \left[(H - E_n) \cdot \tan(90^\circ - \alpha_i) + \frac{La_n}{2} - (Z + H \cdot \tan(\omega) - \Delta_u) \right] \cdot \tan(\beta) \quad [\text{Eq. 5-47}]$$

$$[d_n^T = (2.733 \ 4.539 \ 5.741) \text{ ft}]$$

Anchorage Capacity

$$AC_n := 2 \cdot La_n \cdot C_i \cdot (d_n \cdot \gamma_i + q_d) \cdot \tan(\phi_i) \quad [\text{Eq. 5-45}]$$

$$[AC_n^T = (245.088 \ 982.928 \ 1727.341) \cdot \text{plf}]$$

$$[F_g^T = (155.706 \ 194.633 \ 212.293) \cdot \text{plf}]$$

Safety Factor

$$\xrightarrow{\text{FS}_{po}} \frac{AC}{F_g} \quad [\text{Eq. 5-44}]$$

$$[\text{FS}_{po}^T = (1.574 \ 5.05 \ 8.137)]$$

Internal Sliding

Reduced reinforcement length

$$\Delta L_{l+1} := \begin{cases} \left[(E_{l+1} - E_l) \cdot \left(\frac{1}{\tan(\alpha_e)} - \tan(\omega) \right) \right] & \text{if } n_g > 2 \\ \text{Spacing} \cdot 1 \cdot \text{ft} \cdot \left(\frac{1}{\tan(\alpha_e)} - \tan(\omega) \right) & \text{if } n_g = 2 \\ 0 & \text{if } n_g = 1 \end{cases} \quad [\text{Eq. 5-51}]$$

$$[\Delta L^T = (0 \ 1.707 \ 1.135) \text{ ft}]$$

$$L'_{s_n} := L_n - W_u - \Delta L_n \quad [\text{Eq. 5-50}]$$

$$[L'_{s_n}^T = (4 \ 2.293 \ 2.865) \text{ ft}]$$

Length of sloping ground

$$L_{s\beta_n} := L'_{s_n} + \frac{(L'_{s_n} - W_u) \cdot \tan(\beta) \cdot \tan(\omega)}{1 - \tan(\beta) \cdot \tan(\omega)} - Z \quad [\text{Eq. 5-53 & 5-52}]$$

$$\boxed{L_{s\beta}^T = (3.082 \ 1.328 \ 1.915) \text{ ft}}$$

Height of slope above crest of wall

$$h'_n := L_{s\beta} \cdot \tan(\beta) \quad [\text{Eq. 5-54}]$$

$$\boxed{h^T = (0.655 \ 0.282 \ 0.407) \text{ ft}}$$

Weight of reduced reinforced area

$$W'_{ri} := L'_s \cdot E_n \cdot \gamma_i \quad [\text{Eq. 5-55}]$$

$$\boxed{W'_{ri}^T = (1025 \ 1092 \ 1783) \cdot \text{plf}}$$

Weight of wedge beyond reinforced soil zone

$$W'_{r\beta} := \frac{1}{2} \cdot \left(L_{s\beta} \cdot h'_n \right) \cdot \gamma_i \quad [\text{Eq. 5-56}]$$

$$\boxed{W'_{r\beta}^T = (111.04 \ 20.61 \ 42.89) \cdot \text{plf}}$$

Friction developed by weight

$$R'_s := C_{dsi} \cdot \left[q_d \cdot \left(L_{s\beta} + Z \right) + W'_{ri} + W'_{r\beta} \right] \cdot \tan(\phi_i) \quad [\text{Eq. 5-49}]$$

$$\boxed{R'_s^T = (568 \ 556 \ 913) \cdot \text{plf}}$$

Shear capacity of facing elements

$$V_{u_n} := \min[V_{csmax}, a_{cs} + (\text{if}(E_n > H_h, H_h, E_n) \cdot \gamma_u \cdot W_u) \cdot \tan(\lambda_{cs})] \quad [\text{Eq. 4-25}]$$

$$\boxed{V_u^T = (1363 \ 1551 \ 1676) \cdot \text{plf}}$$

Driving Forces

From retained soil

$$P_s := \left[\frac{1}{2} \cdot K_a \cdot \gamma_e \cdot (E_n + h'_n)^2 \cdot \cos(\delta_e - \omega) \right] \quad [\text{Eq. 5-6}]$$

$$\boxed{P_s^T = (178 \ 425 \ 736) \cdot \text{plf}}$$

From surcharge

$$P_q := (q_d + q_l) \cdot K_a \cdot (E_n + h'_n) \cdot \cos(\delta_e - \omega) \quad [\text{Eq. 5-8}]$$

$$\boxed{P_q^T = (0 \ 0 \ 0) \cdot \text{plf}}$$

Factor of safety against internal sliding

$$P_a := P_s + P_q \quad [\text{Eq. 5-11}]$$

$$\boxed{P_a^T = (178 \ 425 \ 736) \cdot \text{plf}}$$

$$FS_{sl} := \frac{R'_s + V_{u_n}}{(P_a)} \quad [\text{Eq. 5-48}]$$

$$\boxed{FS_{sl}^T = (10.837 \ 4.952 \ 3.516)}$$

Local Stability of Facing Units

Facing Connection Strength

$$T_{conn,n} := \min \left[V_{csmax,n}, a_{cs,n} + \left(\text{if}(E_n > H_h, H_h, E_n) \cdot \gamma_u \cdot W_u \right) \cdot \tan(\lambda_{cs,n}) \right] \quad [\text{Eq. 5-59}]$$

$$\boxed{T_{conn}^T = (1363 \ 1551 \ 1676) \cdot \text{plf}}$$

$$FS_{conn,n} := \frac{T_{conn,n}}{F_{g,n}} \quad \boxed{FS_{conn}^T = (8.757 \ 7.969 \ 7.893)}$$

Resistance to Bulging

Shear capacity at each geogrid layer

$$V_{u,n} := \min \left[V_{csmax}, a_{cs} + \left(\text{if}(E_n > H_h, H_h, E_n) \cdot \gamma_u \cdot W_u \right) \cdot \tan(\lambda_{cs}) \right] \quad [\text{Eq. 4-25}]$$

$$\boxed{V_u^T = (1363 \ 1551 \ 1676) \cdot \text{plf}}$$

Driving Force at each geogrid layer

$$P_{a,n} := \left[\frac{1}{2} \cdot K_{a,i} \cdot \gamma_i \cdot (E_n)^2 \cdot \cos(\delta_i - \omega) \right] + (q_d + q_l) \cdot K_{a,i} \cdot (E_n) \cdot \cos(\delta_i - \omega) \quad [\text{Eq. 5-11}]$$

$$\boxed{P_a^T = (76 \ 263 \ 450) \cdot \text{plf}}$$

Sum of tension in reinforcement layers above layer being considered

$$F_{n+1} := \sum_{i=1}^n F_{g,i}$$

$$\boxed{F^T = (0 \ 156 \ 350 \ 563) \cdot \text{plf}}$$

$$FS_{sc,n} := \frac{V_{u,n}}{P_{a,n} - F_n} \quad [\text{Eq. 5-61}]$$

$$\boxed{FS_{sc}^T = (17.886 \ 14.42 \ 16.842)}$$

Maximum unreinforced height of SRW units

$$y := E_1 = 2.33 \text{ ft}$$

$$q_w := 0 \text{ psf}$$

Moment equilibrium

Driving Moments

$$P'_s := \left[\frac{1}{2} \cdot K_{a,i} \cdot \gamma_i \cdot (y)^2 \cdot \cos(\delta_i - \omega) \right] \quad [\text{Eq. 4-5}]$$

$$\boxed{P'_s = 76.231 \cdot \text{plf}}$$

$$P'_q := (q_d + q_l) \cdot K_{a_i} \cdot (y) \cdot \cos(\delta_i - \omega) \quad [\text{Eq. 4-6}]$$

$$P'_q = 0 \cdot \text{plf}$$

$$P'_a := P'_s + P'_q \quad [\text{Eq. 4-4}]$$

$$P'_a = 76.231 \cdot \text{plf}$$

$$Y'_s := \frac{1}{3} \cdot y \quad [\text{Eq. 4-7}]$$

$$Y'_s = 0.777 \text{ ft}$$

$$Y'_q := \frac{1}{2} \cdot y \quad [\text{Eq. 4-8}]$$

$$Y'_q = 1.17 \text{ ft}$$

$$M'_o := P'_s \cdot Y'_s + P'_q \cdot Y'_q \quad [\text{Eq. 4-17}]$$

$$M'_o = 59.21 \cdot \text{lbft}$$

Resisting Moments

$$W'_w := y \cdot \gamma_u \cdot W_u \quad [\text{Eq. 4-9}]$$

$$W'_w = 279.6 \cdot \text{plf}$$

$$X'_w := G_u + \frac{1}{2} \cdot (y) \cdot \tan(\omega) \quad [\text{Eq. 4-16}]$$

$$X'_w = 0.646 \text{ ft}$$

$$M'_r := W'_w \cdot X'_w \quad [\text{Eq. 4-15}]$$

$$M'_r = 180.517 \text{ ft} \cdot \text{plf}$$

$$\text{FS}_{ot} := \frac{M'_r}{M'_o} \quad [\text{Eq. 4-14}]$$

$$\text{FS}_{ot} = 3.049$$

Factor of Safety against Shear failure

$$V'_u := a_{cs} + W'_w \cdot \tan(\lambda_{cs}) \quad [\text{Eq. 4-25}]$$

$$V'_u = \begin{pmatrix} 1363.447 \\ 1363.447 \\ 17.886 \\ 17.886 \\ 17.886 \\ 17.886 \end{pmatrix}$$

$$\text{FS}_{sh} := \frac{V'_u}{P'_a} \quad [\text{Eq. 4-27}]$$

Summary

Wall Height

$$H = 6.33 \text{ ft}$$

Unreinforced Stability

$$\text{FS}_{ot} = 3.049$$

$$\text{FS}_{bearing} = 5.695$$

Applied Bearing Stress

$$Q_a = 774 \cdot \text{psf}$$

Grid Elevation	Geogrid Length	Tensile Force	Geogrid Strength	Anch. Length	Anch. Capacity	FS Grid Tension (1.0)	FS Pullout (1.5)	FS Int Sliding (1.5)	FS Conn (1.5)	FS Bulging (1.5)
$E_n =$	$L_n =$	$\frac{F_{g_n}}{\text{plf}} =$	$\frac{T_{a_n}}{\text{plf}} =$	$La_n =$	$\frac{AC_n}{\text{plf}} =$	$\text{FS}_{ten_n} =$	$\text{FS}_{po_n} =$	$\text{FS}_{sl_n} =$	$\text{FS}_{conn_n} =$	$\text{FS}_{sc_n} =$
2.33	ft	5	ft	156	834	0.93	245	5.36	1.57	10.84
4.33		5		195	834	2.25	983	4.28	5.05	4.95
5.66		5		212	834	3.13	1727	3.93	8.14	3.52