

09/20/2022



Hello,

The requested revisions have been added to the follow documents.

Please do not hesitate to reach out if you have any further questions! Our phone number is (833) 987-1870

Best,  
Erin

866.736.1253



fluentsolar.com  
answers@fluentsolar.com



2578 W 600 N suite 100  
Lindon UT 84042





Scott E. Wyssling, PE  
Jon P. Ward, SE, PE  
Gregory T. Elvestad, PE

RELEASE FOR CONSTRUCTION  
AS NOTED FOR PLAN REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI

09/30/2022

76 North Meadowbrook Drive  
Alpine, UT 84004  
office (201) 874-3483  
swyssling@wysslingconsulting.com

September 7, 2022

Fluent Solar, LLC  
2578 W 600 N  
Lindon, UT 84042

Re: Engineering Services  
Adkins Residence  
4410 Southwest Amethyst Drive,  
Lees Summit, MO  
6.800 kW System

To Whom It May Concern:

We have received information regarding solar panel installation on the roof of the above referenced structure. Our evaluation of the structure is to verify the existing capacity of the roof system and its ability to support the additional loads imposed by the proposed solar system.

**A. Site Assessment Information**

1. Site visit documentation identifying attic information including size and spacing of framing for the existing roof structure.
2. Design drawings of the proposed system including a site plan, roof plan and connection details for the solar panels. This information will be utilized for approval and construction of the proposed system.

**B. Description of Structure:**

**Roof Framing:** Prefabricated wood trusses at 24" on center. All truss members are constructed of 2x4 dimensional lumber.

**Roof Material:** Composite Asphalt Shingles

**Roof Slope:** 15 degrees

**Attic Access:** Accessible

**Foundation:** Permanent

**C. Loading Criteria Used**

- **Dead Load**
  - Existing Roofing and framing = 7 psf
  - New Solar Panels and Racking = 3 psf
  - TOTAL = 10 PSF
- **Live Load** = 20 psf (reducible) – 0 psf at locations of solar panels
- **Ground Snow Load** = 25 psf
- **Wind Load** based on ASCE 7-16
  - Ultimate Wind Speed = 115 mph (based on Risk Category II)
  - Exposure Category C

*Analysis performed of the existing roof structure utilizing the above loading criteria is in accordance with the 2018 IRC, including provisions allowing existing structures to not require strengthening if the new loads do not exceed existing design loads by 105% for gravity elements and 110% for seismic elements. This analysis indicates that the existing framing will support the additional panel loading without damage, if installed correctly.*

09/20/2022


**D. Solar Panel Anchorage**

1. The solar panels shall be mounted in accordance with the most recent Quickbolt installation manual. If during solar panel installation, the roof framing members appear unstable or deflect non-uniformly, our office should be notified before proceeding with the installation.
2. The maximum allowable withdrawal force for a  $\frac{5}{16}$ " lag screw is 235 lbs per inch of penetration as identified in the National Design Standards (NDS) of timber construction specifications. Based on a minimum penetration depth of  $2\frac{1}{2}$ ", the allowable capacity per connection is greater than the design withdrawal force (demand). Considering the variable factors for the existing roof framing and installation tolerances, the connection using one  $\frac{5}{16}$ " diameter lag screw with a minimum of  $2\frac{1}{2}$ " embedment will be adequate and will include a sufficient factor of safety.
3. Considering the wind speed, roof slopes, size and spacing of framing members, and condition of the roof, the panel supports shall be placed no greater than 48" on centers.
4. Panel supports connections shall be staggered to distribute load to adjacent framing members.

Based on the above evaluation, this office certifies that with the racking and mounting specified, the existing roof system will adequately support the additional loading imposed by the solar system. This evaluation is in conformance with the 2018 IRC, current industry standards, and is based on information supplied to us at the time of this report.

Should you have any questions regarding the above or if you require further information do not hesitate to contact me.

Very truly yours,

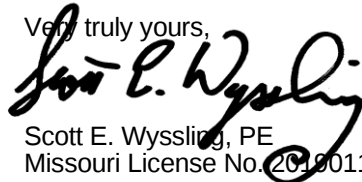  
Scott E. Wyssling, PE  
Missouri License No. 2019011786



DC SYSTEM SIZE: 6.8 KW

SCOPE OF WORK:

FLUENT SOLAR INSTALL THE PROPOSED GRID-TIED PHOTOVOLTAIC SYSTEM. FLUENT SOLAR WILL BE RESPONSIBLE FOR COLLECTING THE NEEDED SITE INFORMATION TO DESIGN AND INSTALL THE PROPOSED PHOTOVOLTAIC SYSTEM.

THE PHOTOVOLTAIC SYSTEM INCLUDES:

|                                             |
|---------------------------------------------|
| ( 17 ) URE – FBM400MFG-BB (CS-1)            |
| ( 1 ) SOLAREEDGE – SE5000H-US000BNU4 (CS-2) |
| ( 17 ) SOLAREEDGE – S440 (CS-3)             |
|                                             |

THE MODULES SHALL BE FLUSH MOUNTED USING

|                                        |
|----------------------------------------|
| APPROX. ( 42 ) QUICKBOLT #16318 MOUNTS |
| ON IRONRIDGE XR-10-168A RAIL           |


THE PHOTOVOLTAIC SYSTEM SHALL BE INTERCONNECTED BY PERFORMING A PV BREAKER INTO THE EXISTING 200 A MAIN SERVICE PANEL

INSTALL SHALL INCLUDE:

- MODULE INSTALLATION
- OPTIMIZER INSTALLATION
- INVERTER INSTALLATION
- MOUNTING AND RACKING INSTALLATION
- AC/DC DISCONNECTS
- GROUNDING AND PV GROUNDING ELECTRODE AND BONDING TO EXISTING GEC
- SYSTEM WIRING
- NET METERING (IF NEEDED)
- PV LABELS (THAT ARE APPLICABLE TO PROJECT)

GENERAL NOTES

1. EACH MODULE TO BE GROUNDED USING THE SUPPLIED CONNECTION POINT PER MANUFACTURER’S REQUIREMENTS. ALL SOLAR MODULES, EQUIPMENT, AND METALLIC COMPONENTS ARE TO BE BONDED. IF THE EXISTING GROUNDING ELECTRODE SYSTEM CANNOT BE VERIFIED OR IS ONLY METALLIC WATER PIPING, IT IS THE CONTRACTOR’S RESPONSIBILITY TO INSTALL A SUPPLEMENTAL GROUNDING ELECTRODE.
2. ALL PLAQUES AND SIGNAGE REQUIRED BY THE ADOPTED NATIONAL ELECTRIC CODE SHALL BE METAL OR PLASTIC, ENGRAVED OR MACHINED IN A CONTRASTING COLOR TO THE PLAQUE/LABEL. ALL PLAQUES/LABELS SHALL BE UV & WEATHER RESISTANT (SEE PV-2).
3. DC CONDUCTORS SHALL BE RUN IN EMT AND/OR MC (METAL CLAD CABLE) AND SHALL BE LABELED A MINIMUM OF EVERY 10’ (SEE E2-E2.1)
4. EXPOSED NON-CURRENT CARRYING METAL PARTS OF ELECTRICAL EQUIPMENT SHALL BE GROUNDED IN ACCORDANCE WITH 250.134 OR 250.136(A).
5. CONFIRM LINE SIDE VOLTAGE AT ELECTRIC UTILITY SERVICE PRIOR TO CONNECTING INVERTER. VERIFY SERVICE VOLTAGE IS WITHIN INVERTER VOLTAGE OPERATIONAL RANGE.
6. ALL SIGNAGE MUST BE PERMANENTLY ATTACHED AND BE WEATHER/SUNLIGHT RESISTANT AND CANNOT BE HAND-WRITTEN(SEE E2-E2.1)
7. ELECTRICAL CONTRACTOR TO PROVIDE CONDUIT EXPANSION JOINTS AND ANCHOR CONDUIT RUNS AS REQUIRED PER NEC.
8. ALL WIRING MUST BE PROPERLY SUPPORTED BY DEVICES OR MECHANICAL MEANS DESIGNED AND LISTED FOR SUCH USE, AND FOR ROOF-MOUNTED SYSTEMS, WIRING MUST BE PERMANENTLY AND COMPLETELY HELD OFF OF THE ROOF SURFACE. NEC 110.2 – 110.4 / 300.4
9. ALL PV METERS AND RAPID SHUTDOWNS TO BE WITHIN 5’ OF ANOTHER. AC DISCONNECT TO BE WITHIN 10’ OF UTILITY METER. PV METER CENTER OF GLASS TO BE AT 5’
10. PV METERS TO BE INSTALLED CORRECTLY, SUPPLIED FROM THE TOP JAWS.
11. ALL ROOF PENETRATIONS MUST BE FLASHED. SIMPLY CAULKING DOES NOT SUFFICE.
12. ALL DC CONDUCTORS RUN INSIDE OF THE STRUCTURE SHALL BE INSTALLED A MINIMUM OF 18” BELOW THE ROOF DECK.
13. ALL WORK SHALL COMPLY WITH THE 2018 IBC AND 2018 IRC
14. ALL ELECTRICAL WORK SHALL COMPLY WITH THE 2017 NATIONAL ELECTRIC CODE.
15. EQUIPMENT MAY BE SUBSTITUTED FOR SIMILAR EQUIPMENT BASED ON AVAILABILITY. SUBSTITUTED EQUIPMENT SHALL COMPLY WITH DESIGN CRITERIA

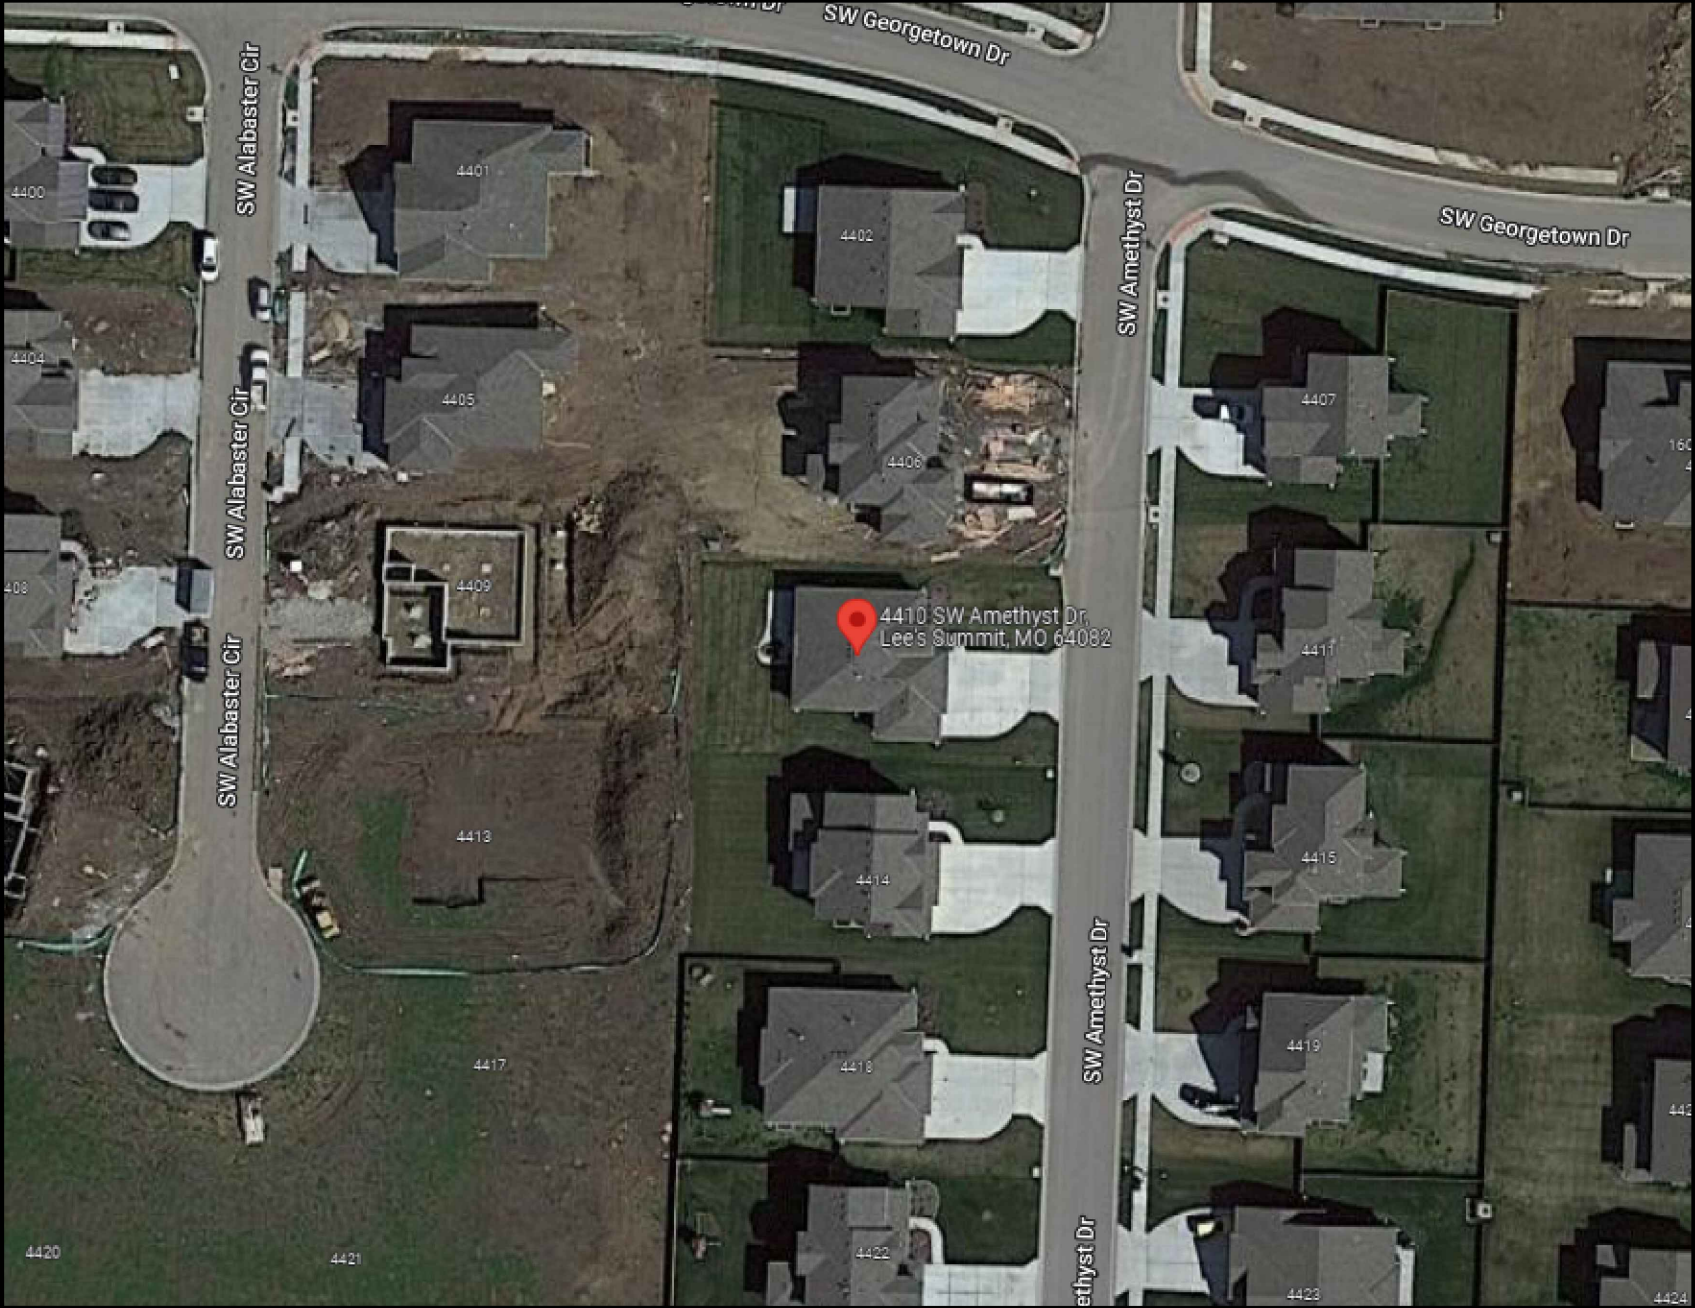

|                       |                             |
|-----------------------|-----------------------------|
| ASCE 7-10 WIND SPEED: | 115PSF, EXPOSURE CATEGORY C |
| GROUND SNOW LOAD:     | 25 PSF, EXPOSURE CATEGORY C |

STAMPS (IF NEEDED)

Wyssling Consulting, PLLC  
76 N Meadowbrook Drive Alpine UT 84004  
Missouri COA # 2020037943  
Signed 9/16/2022

RELEASE FOR CONSTRUCTION  
AS NOTED FOR PLAN REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
09/20/2022

CONTENTS:

|       |                               |
|-------|-------------------------------|
| C-1   | COVER PAGE                    |
| PV-1  | SITE PLAN                     |
| PV-2  | ROOF INFO                     |
| PV-3  | SITE PHOTOS                   |
| E-1   | 3-LINE DIAGRAM                |
| E-2   | LABELS                        |
| E-2.1 | LABELS LOCATION               |
| E-3   | ELEC CALCS AND EQUIPMENT INFO |
| M-1   | MOUNT                         |
| M-2   | MOUNT CONT.                   |
| EQ-1  | EQUIPMENT                     |
| EQ-2  | EQUIP. CONT.                  |
| EQ-3  | EQUIP. CONT.                  |
| EQ-4  | EQUIP. CONT.                  |
| EQ-5  | EQUIP. CONT.                  |
| CS-1  | MODULE                        |
| CS-2  | OPTIMIZER                     |
| CS-3  | INVERTER                      |
| PL-1  | PLACARD                       |




ADDRESS: 2578 W 600 N  
SUITE 100 LONDON, UT 84042  
PHONE: 866-736-1253

|                     |                     |                                             |
|---------------------|---------------------|---------------------------------------------|
| CUSTOMER LAST NAME: | ADKINS              | SYSTEM SIZE: 6.8 KW (E-1)                   |
| ADDRESS:            | 4410 SW AMETHYST DR | ( 17 ) URE – FBM400MFG-BB (CS-1)            |
| CITY:               | LEES SUMMIT         | ( 1 ) SOLAREEDGE – SE5000H-US000BNU4 (CS-2) |
| STATE:              | MO                  | ( 17 ) SOLAREEDGE – S440 (CS-3)             |
| ZIP:                | 64082               | ROOF TYPE: COMP SHINGLE (PV-2)              |
| JURISDICTION:       | Aberdeen            | PREFABRICATED TRUSSES, 2X4 @ 24" (PV-2)     |
| UTILITY COMPANY:    | EVERGY              | INTERCONNECTION METHOD: PV BREAKER          |
| DESIGNED BY: DA     |                     |                                             |
| DESIGNED ON         |                     |                                             |
| 9/6/2022            |                     |                                             |
| COVER PAGE          |                     |                                             |
| C-1                 |                     |                                             |


LEGEND:

-  =UTILITY METER
-  =MAIN SERVICE PANEL
-  =AC DISCONNECT
-  =INVERTER

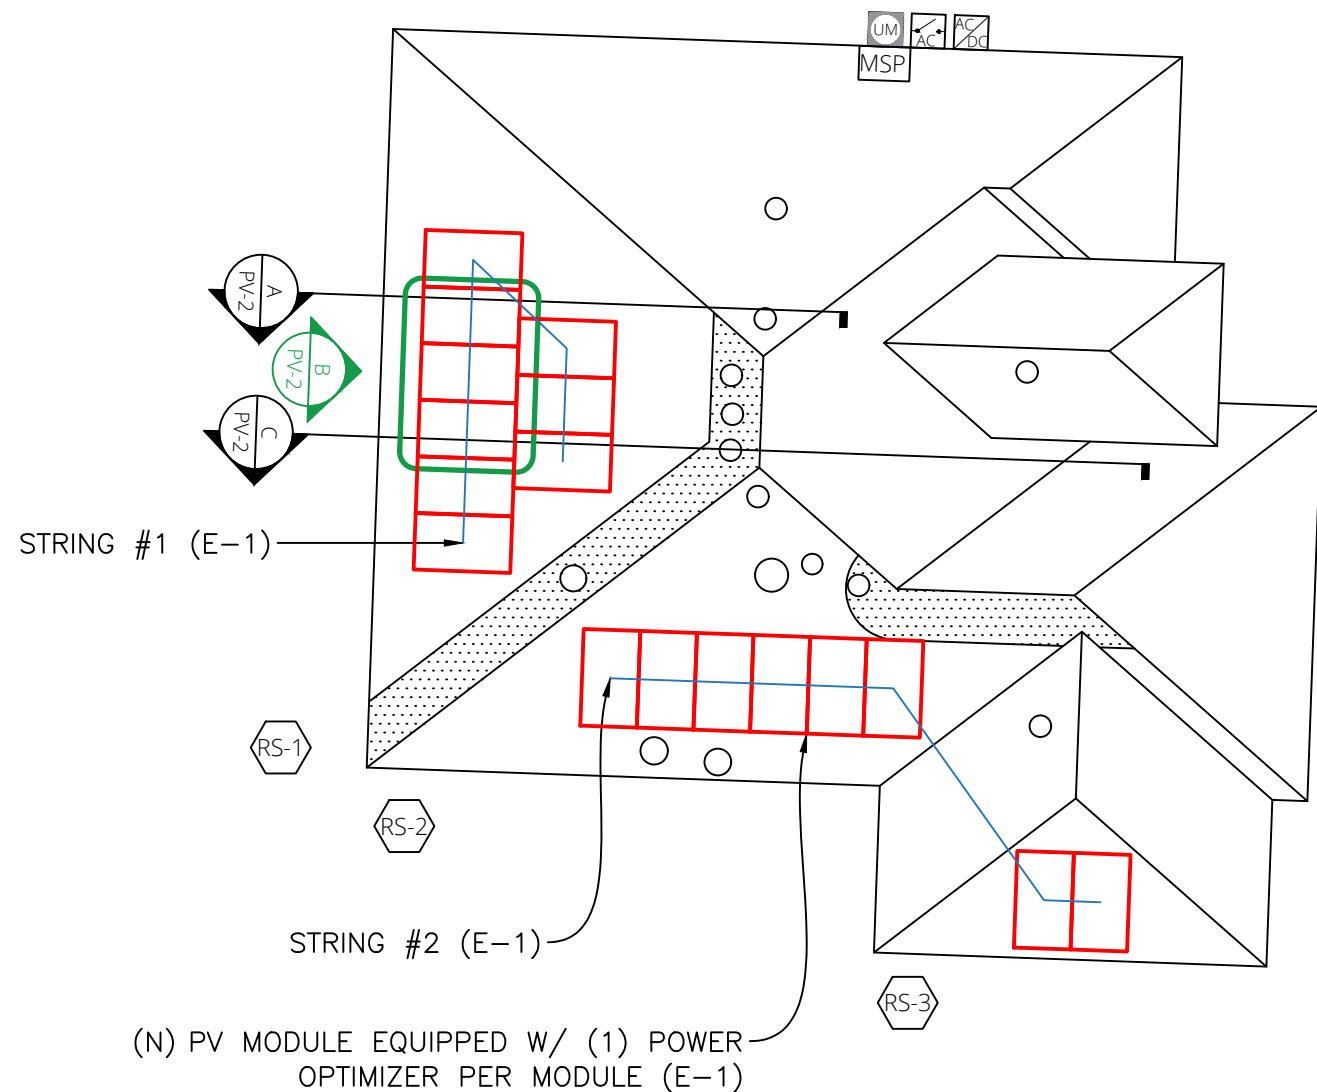

SITE PLAN NOTES:

- VERIFY ALL OBSTRUCTIONS IN THE FIELD.
- VERIFY ALL DIMENSIONS IN THE FIELD.
- PROVIDE RAIL SPLICES AS REQUIRED BY MANUFACTURER'S GUIDELINES.
- NO SIGNIFICANT SHADING WILL RESULT FROM EXISTING ROOF OBSTRUCTIONS.
- PV MODULES CANNOT BE INSTALLED OVER OR BLOCK ATTIC VENTS, PLUMBING VENTS, FURNACE OR WATER HEATER VENTS ETC.
- WHERE INDICATED ON PLAN, MIN. DIMENSIONS ARE REQUIRED PER THE "SOLAR PV INSTALLATION GUIDELINE" PUBLISHED BY THE OFFICE OF THE STATE FIRE MARSHAL.
- SCALE  $\frac{3}{32}"=1'$
- ALL PV METERS AND RAPID SHUTDOWNS TO BE WITHIN 5' OF ANOTHER. AC DISCONNECT TO BE WITHIN 10' OF UTILITY METER. PV METER CENTER OF GLASS TO BE AT 5'

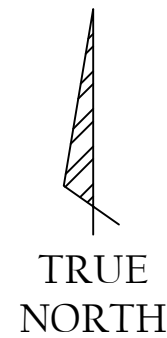

|                | TILT | AZIMUTH |
|----------------|------|---------|
| ROOF SECTION 1 | 15   | 272     |
| ROOF SECTION 2 | 15   | 182     |
| ROOF SECTION 3 | 15   | 182     |
| ROOF SECTION 4 | N/A  | N/A     |
| ROOF SECTION 5 | N/A  | N/A     |
| ROOF SECTION 6 | N/A  | N/A     |

DESIGN ADDENDUMS TO STANDARD TEMPLATE  
BASED ON CITY, STATE, UTILITY, AHJ, OR PREVIOUS  
PLAN REVIEWER COMMENTS IF THERE ARE  
CONFLICTING NOTES, ADDENDUMS TAKE  
PRECEDENCE OVER STANDARD TEMPLATE NOTES

RELEASE FOR CONSTRUCTION

AS NOTED FOR PLAN REVIEW

**Filament**

DEVELOPMENT SERVICES

LEE'S SUMMIT, MISSOURI

**09/20/2022**

ADDRESS: 2578 W 600 N  
SUITE 100 LINDON, UT 84042  
PHONE: 866-736-1253

|                     |                     |                                             |
|---------------------|---------------------|---------------------------------------------|
| CUSTOMER LAST NAME: | ADKINS              | SYSTEM SIZE: 6.8 KW (E-1)                   |
| ADDRESS:            | 4410 SW AMETHYST DR | ( 17 ) URE - FBM400MFG-BB (CS-1)            |
| CITY:               | LEES SUMMIT         | ( 1 ) SOLAREdge - SE5000H-US0000BNU4 (CS-2) |
| STATE:              | MO                  | ( 17 ) SOLAREdge - S440 (CS-3)              |
| ZIP:                | 64082               | ROOF TYPE: COMP SHINGLE (PV-2)              |
| JURISDICTION:       | Aberdeen            | PREFABRICATED TRUSSES, 2X4 @ 24" (PV-2)     |
| UTILITY COMPANY:    | EVERGY              | INTERCONNECTION METHOD: PV BREAKER          |


DESIGNED BY: DA

DESIGNED ON

9/6/2022


SITE PLAN

PV-1



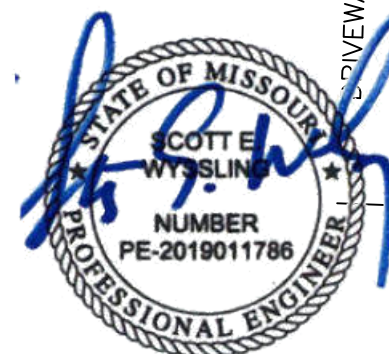


Wyssling Consulting, PLLC  
76 N Meadowbrook Drive Alpine UT 84004  
Missouri COA # 2020037943

Signed 9/16/2022

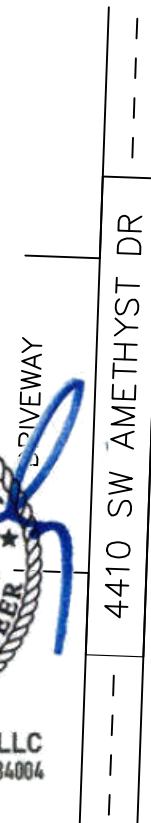

HATCHED AREA WILL PROVIDE A  
3' FIRECODE PATHWAY  
TO COMPLY WITH IFC 605.11.3.2.1

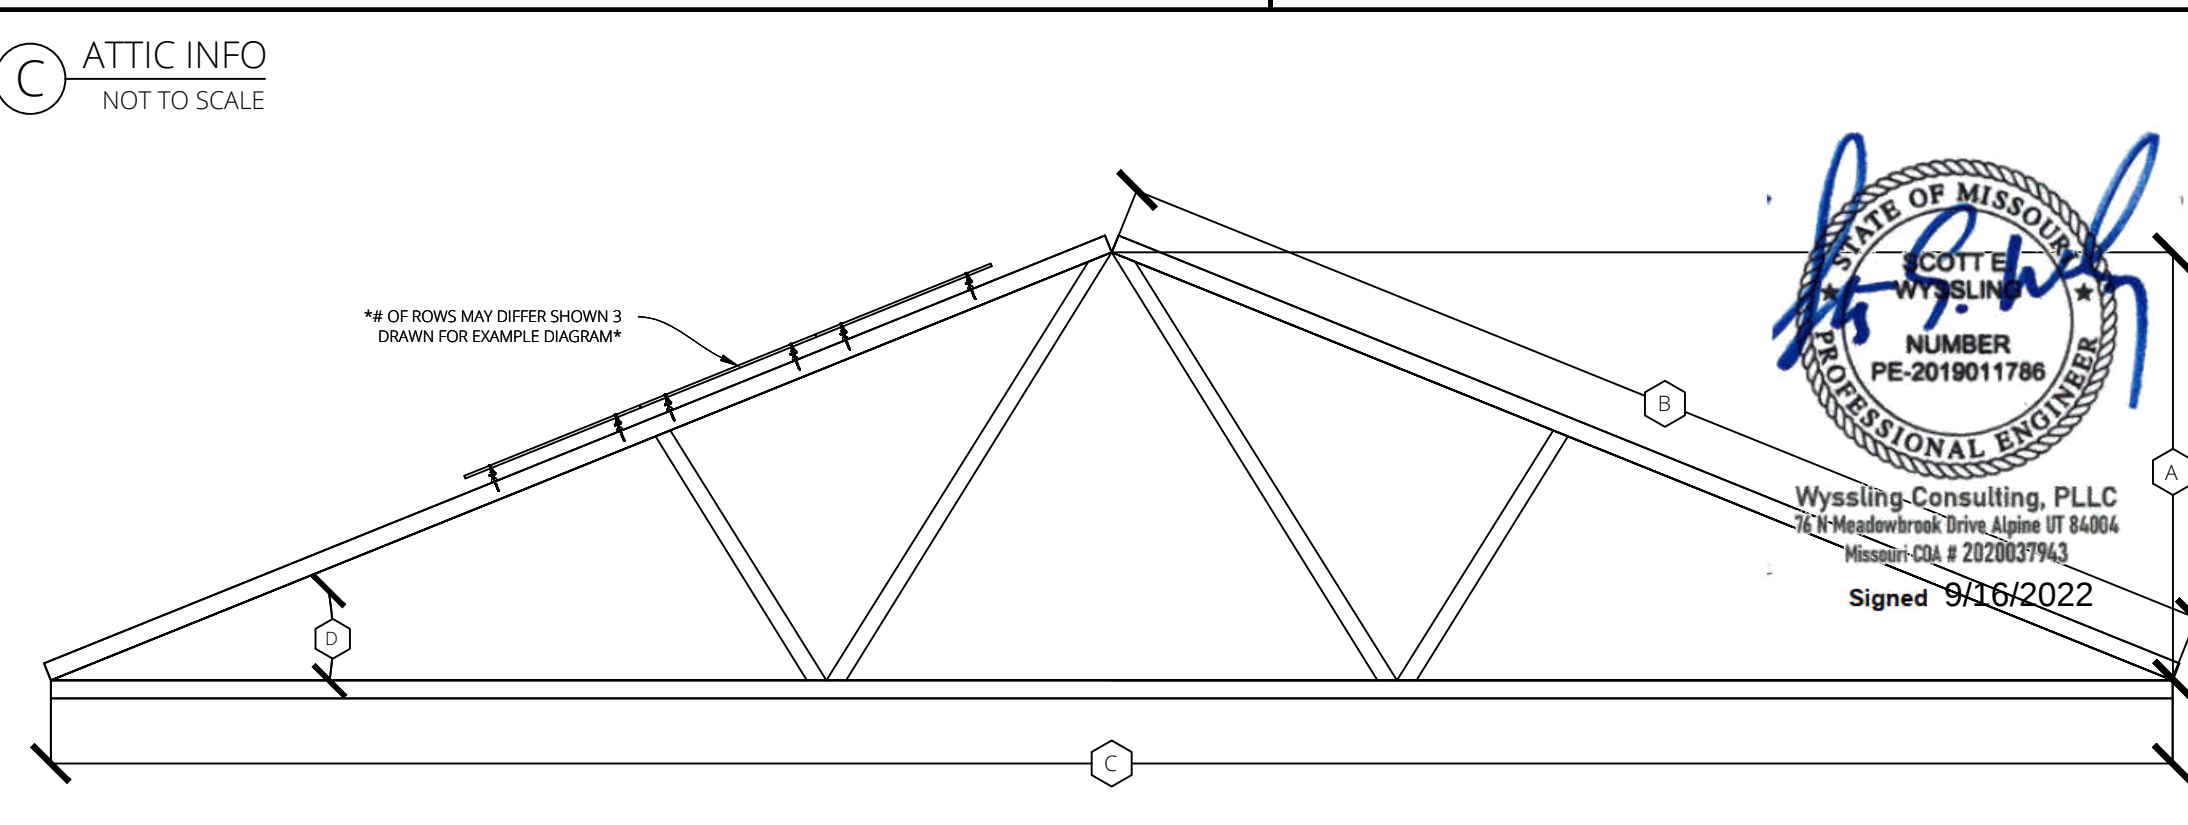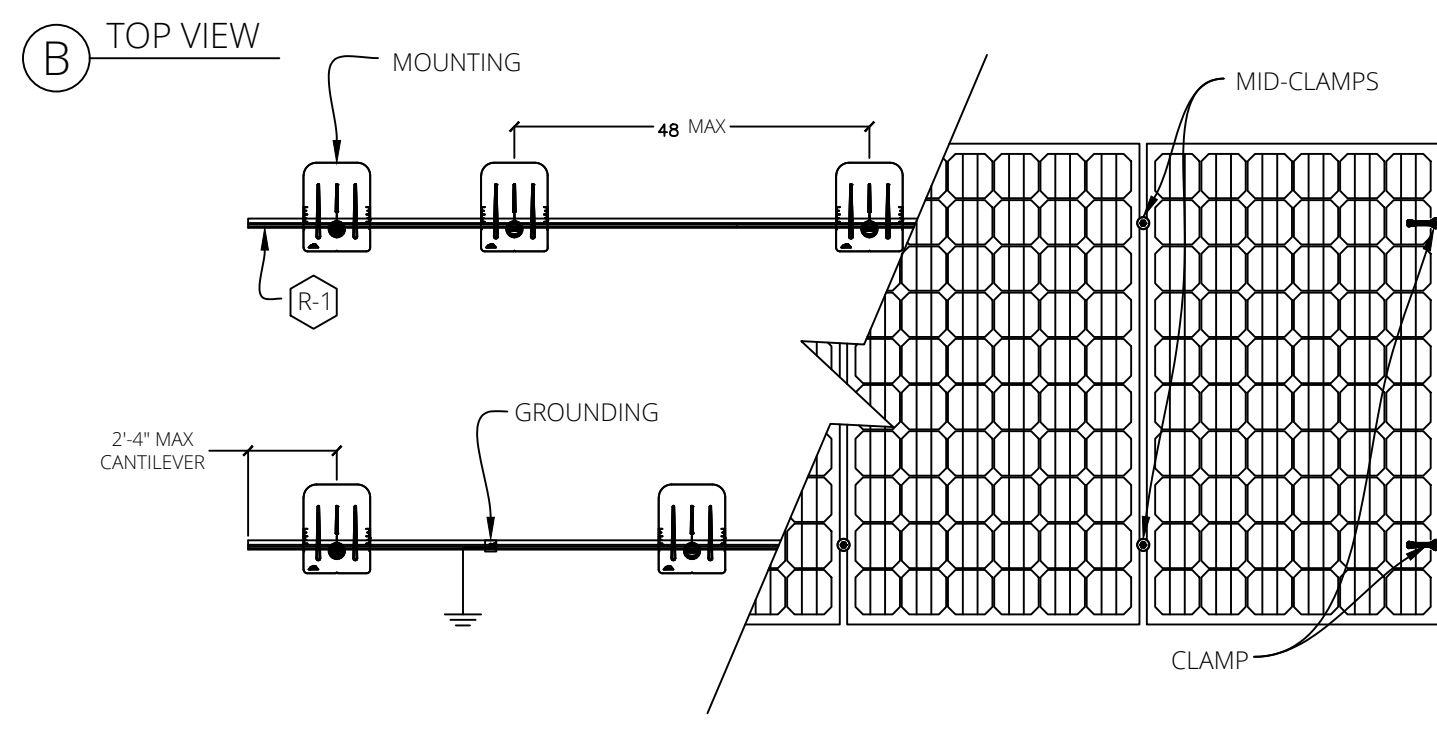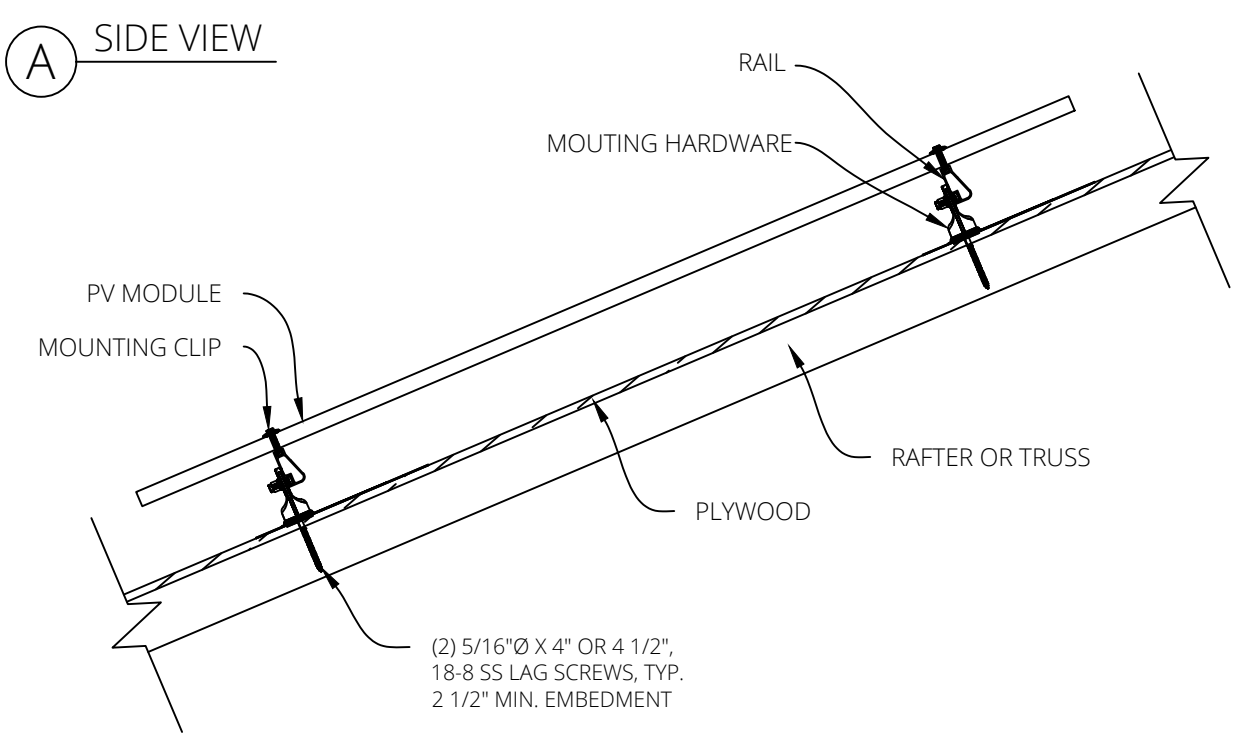

| PREFABRICATED TRUSSES         |     | SIZE:  | 2X4 | SPACING: | 24 |
|-------------------------------|-----|--------|-----|----------|----|
| ROOF INFO IN INCHES & DEGREES |     | TAG ID |     |          |    |
| ROOF HEIGHT:                  | 76  | A      |     |          |    |
| ROOF FACE SPAN:               | 292 | B      |     |          |    |
| ROOF LENGTH:                  | 564 | C      |     |          |    |
| ROOF TILT:                    | 15  | D      |     |          |    |

| PV ARRAY STRUCTURAL INFO        |                                                       |        |               |
|---------------------------------|-------------------------------------------------------|--------|---------------|
| TOTAL PV MODULE COUNT:          | (TOTAL NUMBER OF MODULES BEING INSTALLED)             | 17     | MODULES       |
| APPROX. ATTACHMENT POINTS:      | (ROUND UP (TOTAL ROWS WIDTH) / (MOUNT SPACING)) +2    | 42     | MOUNTS        |
| INDIVIDUAL ARRAY AREA:          | (MODULE LENGTH) X (MODULE WIDTH)                      | 21.03  | FT^2          |
| TOTAL ARRAY AREA:               | (INDIVIDUAL ARRAY AREA) X (TOTAL MODULE COUNT) = FT^2 | 357.54 | FT^2          |
| TOTAL ROOF AREA:                | (ROOF AREA TOTAL) = FT^2                              | 1098   | FT^2          |
| % ARRAY/ROOF:                   | (AREA AREA) / (ROOF AREA) = %                         | 32.6   | %             |
| TOTAL ARRAY WEIGHT:             | (TOTAL MODULE COUNT) X (MODULE WEIGHT) = LBS          | 813.28 | LBS           |
| TOTAL DISTRIBUTED LOAD ON ROOF: | (TOTAL ARRAY WEIGHT) / (ARRAY AREA) = LBS / FT^2      | 2.27   | LBS / FT^2    |
| LOAD ON EACH MOUNT              | (TOTAL ARRAY WEIGHT) / (TOTAL NUMBER OF ATTACHMENTS)  | 19.36  | LBS / ATTACH. |

**GENERAL STRUCTURAL NOTES:**  
THE FOLLOWING CALCULATIONS ARE INITIAL CALCULATIONS BASED OFF OF THE SITE SURVEY INFORMATION, AND THE EQUIPMENT CUT SHEETS. REFER TO STRUCTURAL LETTER FOR FINAL CALCULATIONS, SNOW AND WIND SPEEDS

RELEASE FOR CONSTRUCTION

**Filament**

AS NOTED FOR PLAN REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI

**09/20/2022**

ADDRESS: 2578 W 600 N  
SUITE 100 LINDON, UT 84042  
PHONE: 866-736-1253

|                     |                     |                                         |                            |
|---------------------|---------------------|-----------------------------------------|----------------------------|
| CUSTOMER LAST NAME: | ADKINS              | SYSTEM SIZE:                            | 6.8 KW (E-1)               |
| ADDRESS:            | 4410 SW AMETHYST DR | ( 17 ) URE                              | - FBM400MFG-BB (CS-1)      |
| CITY:               | LEES SUMMIT         | ( 1 ) SOLAREGE                          | - SE5000H-US000BNU4 (CS-2) |
| STATE:              | MO                  | ( 17 ) SOLAREGE                         | - S440 (CS-3)              |
| ZIP:                | 64082               | ROOF TYPE:                              | COMP SHINGLE (PV-2)        |
| JURISDICTION:       | Aberdeen            | PREFABRICATED TRUSSES, 2X4 @ 24" (PV-2) |                            |
| UTILITY COMPANY:    | EVERGY              | INTERCONNECTION METHOD: PV BREAKER      |                            |

DESIGNED BY: DA

DESIGNED ON

9/6/2022

ROOF INFO

PV-2




|                            |                     |
|----------------------------|---------------------|
| RELEASE FOR CONSTRUCTION   |                     |
| AS NOTED FOR PLAN REVIEW   |                     |
| DEVELOPMENT SERVICES       |                     |
| LEE'S SUMMIT, MISSOURI     |                     |
| 09/20/2022                 |                     |
| ADDRESS: 2578 W 600 N      |                     |
| SUITE 100 LINDON, UT 84042 |                     |
| PHONE: 866-736-1253        |                     |
| CUSTOMER LAST NAME:        | ADKINS              |
| ADDRESS:                   | 4410 SW AMETHYST DR |
| CITY:                      | LEES SUMMIT         |
| STATE:                     | MO                  |
| ZIP:                       | 64082               |
| JURISDICTION:              | Aberdeen            |
| UTILITY COMPANY:           | EVERGY              |
| DESIGNED BY:               | DA                  |
| DESIGNED ON                | 9/6/2022            |
| SITE PHOTOS                |                     |
| PV-3                       |                     |

|                     |                     |                                            |
|---------------------|---------------------|--------------------------------------------|
| CUSTOMER LAST NAME: | ADKINS              | SYSTEM SIZE: 6.8 KW (E-1)                  |
| ADDRESS:            | 4410 SW AMETHYST DR | ( 17 ) URE - FBM400MFG-BB (CS-1)           |
| CITY:               | LEES SUMMIT         | ( 1 ) SOLAREdge - SE5000H-US000BNU4 (CS-2) |
| STATE:              | MO                  | ( 17 ) SOLAREdge - S440 (CS-3)             |
| ZIP:                | 64082               | ROOF TYPE: COMP SHINGLE (PV-2)             |
| JURISDICTION:       | Aberdeen            | PREFABRICATED TRUSSES, 2X4 @ 24" (PV-2)    |
| UTILITY COMPANY:    | EVERGY              | INTERCONNECTION METHOD: PV BREAKER         |

| CONDUCTOR SCHEDULE           |                  |          |                |                                                        |         |                      |                |          |
|------------------------------|------------------|----------|----------------|--------------------------------------------------------|---------|----------------------|----------------|----------|
| CONDUCTORS                   |                  |          |                | GROUND                                                 |         |                      | CONDUIT        |          |
| TAG ID                       | WIRES IN CONDUIT | WIRE AWG | TYPE, MATERIAL | WIRE 90°C (194°F) AMPERAGE RATING TABLE 310.15 (B)(16) | SIZE    | RATING TABLE 250.122 | TYPE, MATERIAL |          |
| A                            | 5                | #8 AWG   | PV CABLE, CU   | 40                                                     | #8 AWG  | 60                   | BARE, CU       | 3/4" EMT |
| B                            | 5                | #8 AWG   | THWN-2, CU     | 40                                                     | #10 AWG | 20                   | THWN-2, CU     | 3/4" EMT |
| C                            | 4                | #10 AWG  | THWN-2, CU     | 30                                                     | #8 AWG  | 60                   | THWN-2, CU     | 3/4" EMT |
| D                            | 4                | #6 AWG   | THWN-2, CU     | 55                                                     | #8 AWG  | 60                   | THWN-2, CU     | 3/4" EMT |
| * TAG D ONLY IF APPLICABLE * |                  |          |                |                                                        |         |                      |                |          |

|                      |          |                 |                     |                |  |
|----------------------|----------|-----------------|---------------------|----------------|--|
| AC DISCONNECT SIZE:  |          | ENCLOSURE TYPE: |                     | SPECIAL NOTES: |  |
| 30A NON-FUSED        |          | NEMA 3R         |                     |                |  |
| ELECTRICAL EQUIPMENT |          |                 |                     |                |  |
| EE-1                 | EXISTING | 200A            | BUS BAR RATING      |                |  |
| EE-2                 | EXISTING | 200A            | MAIN BREAKER RATING |                |  |
| EE-3                 | NEW      | 30A             | PV BREAKER          |                |  |
| EE-4                 |          |                 |                     |                |  |
| EE-5                 |          |                 |                     |                |  |

| PRODUCTION METER: |  |
|-------------------|--|
| NO PM REQUIRED    |  |



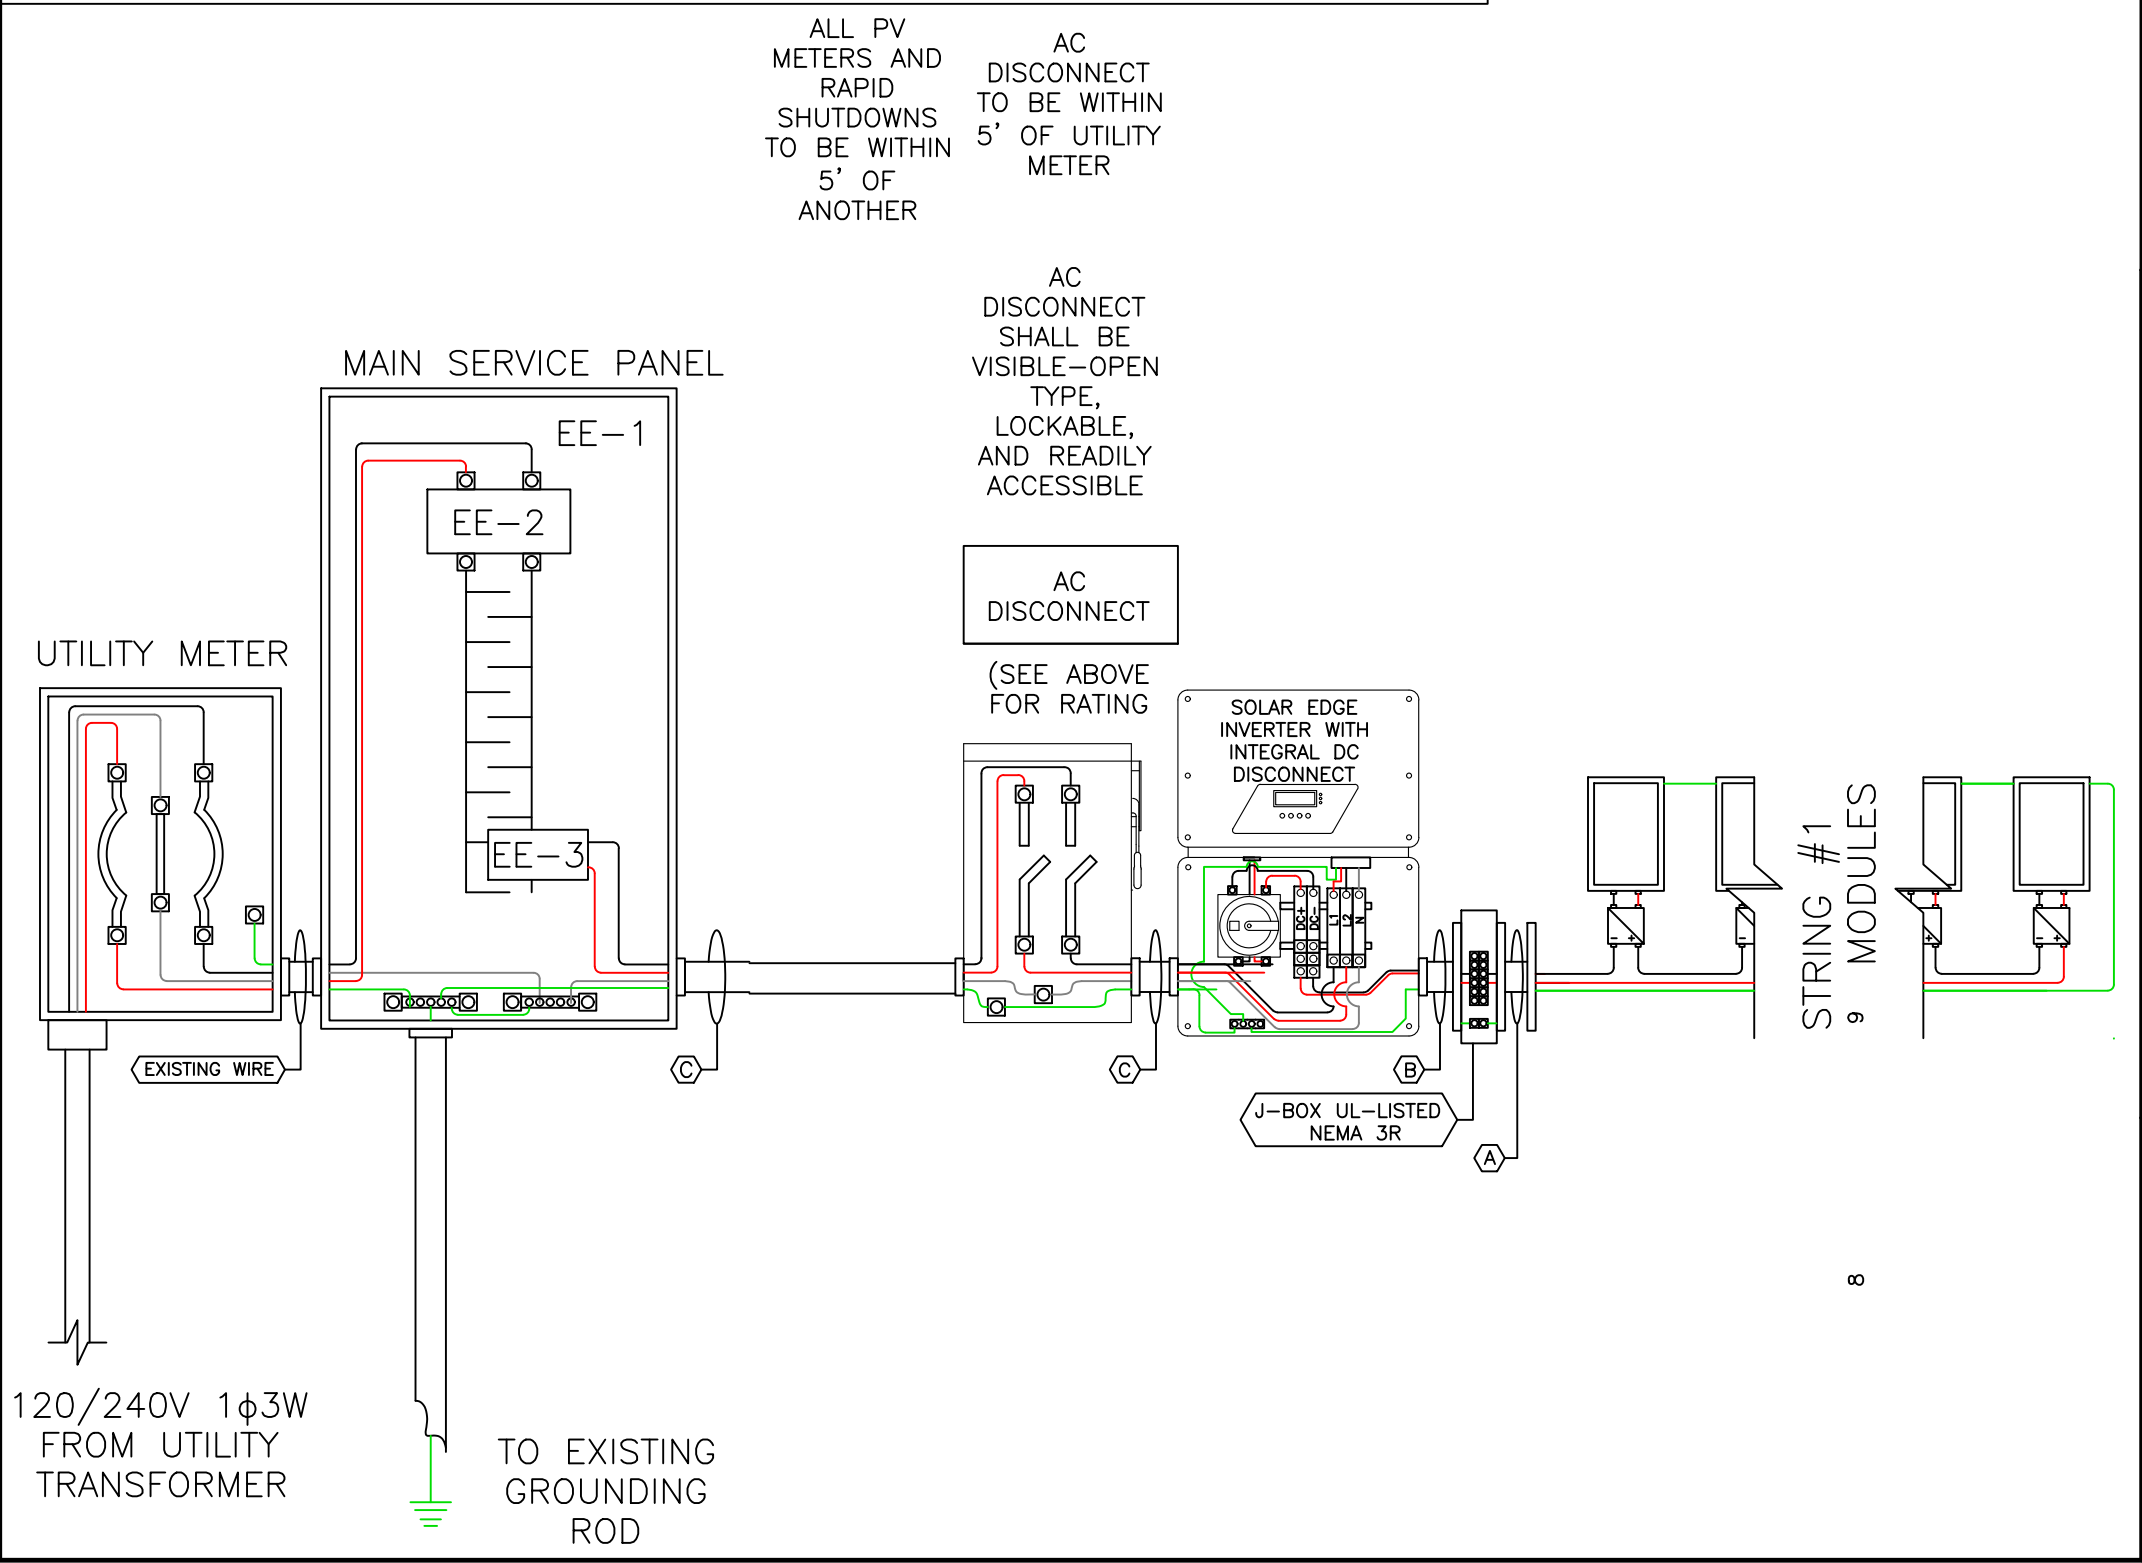


DESIGN ADDENDUMS TO STANDARD TEMPLATE  
BASED ON CITY, STATE, UTILITY, AHJ, OR PREVIOUS  
PLAN REVIEWER COMMENTS IF THERE ARE  
CONFLICTING NOTES, ADDENDUMS TAKE  
PRECEDENCE OVER STANDARD TEMPLATE NOTES

INSTALLATION NOTES:

LAND PV BREAKER IN MSP LOCATED IN THE FURTHEST  
POSITION FROM THE MAIN DISCONNECT

|                                                                            |  |                              |  |                   |  |           |  |            |  |
|----------------------------------------------------------------------------|--|------------------------------|--|-------------------|--|-----------|--|------------|--|
| RELEASE FOR CONSTRUCTION                                                   |  |                              |  |                   |  |           |  |            |  |
| AS NOTED FOR PLAN REVIEW                                                   |  |                              |  |                   |  |           |  |            |  |
| Filiant DEVELOPMENT SERVICES                                               |  |                              |  |                   |  |           |  |            |  |
| LEE'S SUMMIT, MISSOURI                                                     |  |                              |  |                   |  |           |  |            |  |
| 09/20/2022                                                                 |  |                              |  |                   |  |           |  |            |  |
| ADDRESS: 2578 W 600 N<br>SUITE 100 LONDON, UT 84042<br>PHONE: 866-736-1253 |  |                              |  |                   |  |           |  |            |  |
| SYSTEM SIZE: 6.8 KW (E-1)                                                  |  |                              |  |                   |  |           |  |            |  |
| ( 17 ) URE - FBM400MFG-BB (CS-1)                                           |  |                              |  |                   |  |           |  |            |  |
| ( 1 ) SOLAREdge - SE5000H-US000BNU4 (CS-2)                                 |  |                              |  |                   |  |           |  |            |  |
| ( 17 ) SOLAREdge - S440 (CS-3)                                             |  |                              |  |                   |  |           |  |            |  |
| ROOF TYPE: COMP SHINGLE (PV-2)                                             |  |                              |  |                   |  |           |  |            |  |
| PREFABRICATED TRUSSES, 2X4 @ 24" (PV-2)                                    |  |                              |  |                   |  |           |  |            |  |
| INTERCONNECTION METHOD: PV BREAKER                                         |  |                              |  |                   |  |           |  |            |  |
| CUSTOMER LAST NAME: ADKINS                                                 |  | ADDRESS: 4410 SW AMETHYST DR |  | CITY: LEES SUMMIT |  | STATE: MO |  | ZIP: 64082 |  |
| JURISDICTION: Aberdeen                                                     |  |                              |  |                   |  |           |  |            |  |
| UTILITY COMPANY: EVERGY                                                    |  |                              |  |                   |  |           |  |            |  |
| DESIGNED BY: DA                                                            |  |                              |  |                   |  |           |  |            |  |
| DESIGNED ON                                                                |  |                              |  |                   |  |           |  |            |  |
| 9/6/2022                                                                   |  |                              |  |                   |  |           |  |            |  |
| 3-LINE DIAGRAM                                                             |  |                              |  |                   |  |           |  |            |  |
| E - 1                                                                      |  |                              |  |                   |  |           |  |            |  |

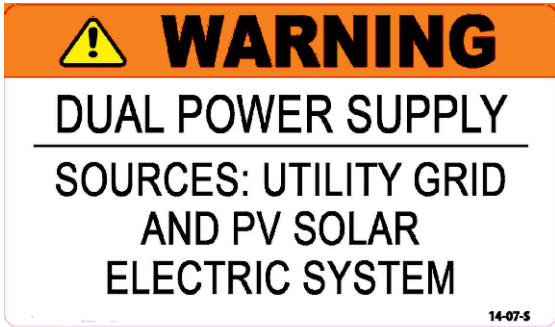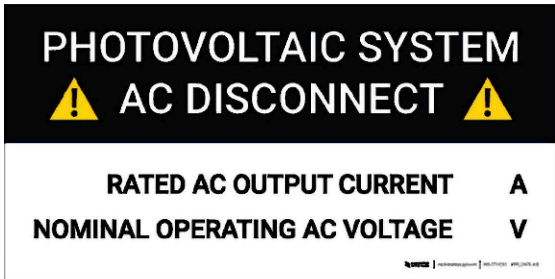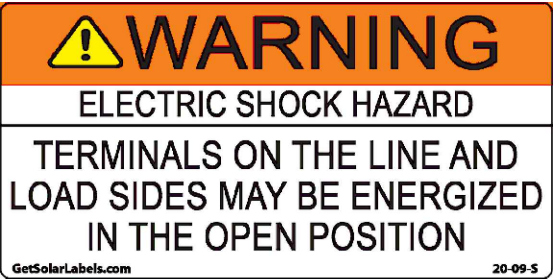

LABEL 1  
AT EACH JUNCTION BOX, COMBINER BOX, DISCONNECT, AND DEVICE WHERE ENERGIZED UNGROUNDED CONDUCTORS MAY BE EXPOSED DURING SERVICE. NEC. 690.35(F)

LABEL 2  
FOR PV DISCONNECTING MEANS WHERE ALL TERMINALS OF THE DISCONNECTING MEANS MAY BE ENERGIZED IN THE OPEN POSITION. NEC 690.17(E), NEC 705.22





LABEL 3  
AT POINT OF INTERCONNECTION, MARKED AT AC DISCONNECTING MEANS. NEC 690.54, NEC 690.13 (B)

\*FOR VALUES SEE ELECTRICAL CALCS PAGE, VALUES TO BE PRINTED AND NOT HAND WRITTEN\*

LABEL 4  
AT POINT OF INTERCONNECTION FOR EQUIPMENT CONTAINING OVERCURRENT DEVICES IN CIRCUITS SUPPLYING POWER TO A BUSBAR OR CONDUCTOR SUPPLIED FORM MULTIPLE SOURCES, EACH SERVICE EQUIPMENT AND ALL ELECTRIC POWER PRODUCTION SOURCE LOCATIONS. NEC 705.12(D)(3)

LABEL 5  
AT DIRECT-CURRENT EXPOSED RACEWAYS, CABLE TRAYS, COVERS AND ENCLOSURES OF JUNCTION BOXES, AND OTHER WIRING METHODS; SPACED AT MAXIMUM 10FT SECTION OR WHERE SEPARATED BY ENCLOSURES, WALLS, PARTITIONS, CEILINGS, OR FLOORS. NEC 690.31(G)(3&4)

LABEL 6  
PLACED ADJACENT TO THE BACK-FED BREAKER FROM THE INVERTER IF TIE IN CONSISTS OF LOAD SIDE CONNECTION TO BUSBAR. NEC 705.12(D)(2)(3)(B)

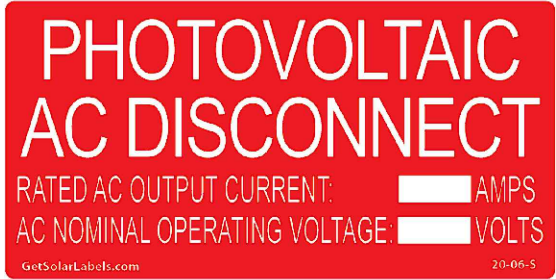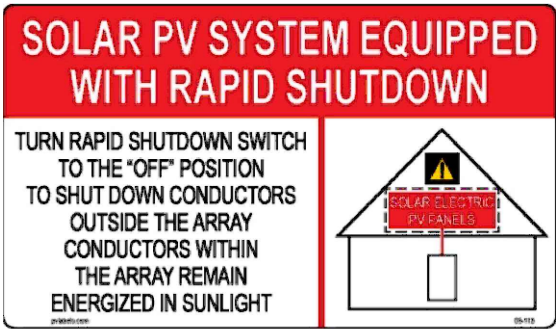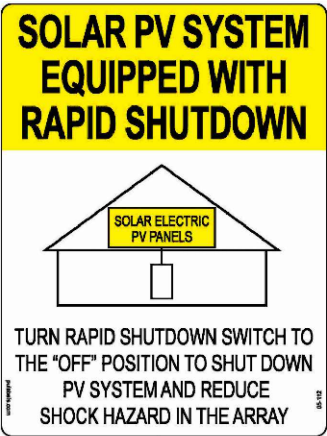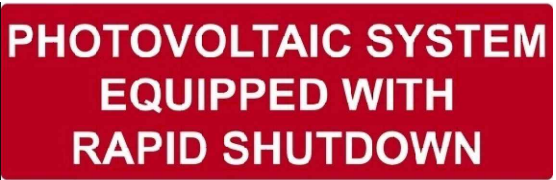

LABEL 7  
SIGN LOCATED AT UTILITY SERVICE EQUIPMENT. NEC 690.56(C)

LABEL 8  
(ONLY IF 3 OR MORE SUPPLY SOURCES TO A BUSBAR)  
SIGN LOCATED AT LOAD CENTER IF CONTAINS 3 OR MORE POWER SOURCES. NEC 705.12(D)(2)(3)(C)

LABEL 9  
FOR PV SYSTEMS THAT SHUT DOWN THE ARRAY AND CONDUCTORS LEAVING THE ARRAY: SIGN TO BE LOCATED ON OR NO MORE THAN 3 FT AWAY FROM SERVICE DISCONNECTING MEANS TO WHICH THE PV SYSTEMS ARE CONNECTED AND SHALL INDICATE THE LOCATION OF ALL IDENTIFIED RAPID SHUTDOWN SWITCHES IF NOT AT THE SAME LOCATION. [NEC 690.56(C)(1)(A)]

LABEL 10  
FOR PV SYSTEMS THAT ONLY SHUT DOWN CONDUCTORS LEAVING THE ARRAY: SIGN TO BE LOCATED ON OR NO MORE THAN 3 FT AWAY FROM SERVICE DISCONNECTING MEANS TO WHICH THE PV SYSTEMS ARE CONNECTED AND SHALL INDICATE THE LOCATION OF ALL IDENTIFIED RAPID SHUTDOWN SWITCHES IF NOT AT THE SAME LOCATION. [NEC 690.56(C)(1)(B)]

LABEL 11  
A PERMANENT LABEL FOR THE DC PV POWER SOURCE INDICATING THE INFORMATION SPECIFIED IN (1) THROUGH (3) SHALL BE PROVIDED BY INSTALLER AT DC PV SYSTEM DISCONNECTING MEANS AND AT EACH DC EQUIPMENT DISCONNECTING MEANS REQUIRED BY 690.15. WHERE A DISCONNECTING MEANS HAS MORE THAN ONE DC PV POWER SOURCE, THE VALUES IN 690.53(1) THROUGH (3) SHALL BE SPECIFIED FOR EACH SOURCE.

\*FOR VALUES SEE ELECTRICAL CALCS PAGE, VALUES TO BE PRINTED AND NOT HAND WRITTEN\*

LABEL 12  
A RAPID SHUTDOWN SWITCH SHALL HAVE A LABEL LOCATED ON OR NO MORE THAN 1M (3FT) FROM THE SWITCH THAT INCLUDES THE FOLLOWING WORDING "RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM" THE LABEL SHALL BE REFLECTIVE WITH ALL LETTERS CAPITALIZED AND HAVING A MINIMUM HEIGHT OF 9.5MM (3/8 IN.), IN WHITE ON RED BACKGROUND)

RELEASE FOR CONSTRUCTION

AS NOTED FOR PLAN REVIEW

DEVELOPMENT SERVICES

LEE'S SUMMIT, MISSOURI

09/20/2022

ADDRESS: 2578 W 600 N  
SUITE 100 LINDON, UT 84042  
PHONE: 866-736-1253

|                                            |                     |                     |
|--------------------------------------------|---------------------|---------------------|
| SYSTEM SIZE: 6.8 KW (E-1)                  | ADKINS              | CUSTOMER LAST NAME: |
| ( 17 ) URE - FBM400MFG-BB (CS-1)           | 4410 SW AMETHYST DR | ADDRESS:            |
| ( 1 ) SOLAREdge - SE5000H-US000BNU4 (CS-2) | LEES SUMMIT         | CITY:               |
| ( 17 ) SOLAREdge - S440 (CS-3)             | MO                  | STATE:              |
| ROOF TYPE: COMP SHINGLE (PV-2)             | 64082               | ZIP:                |
| PREFABRICATED TRUSSES, 2X4 @ 24" (PV-2)    | Aberdeen            | JURISDICTION:       |
| INTERCONNECTION METHOD: PV BREAKER         | EVERGY              | UTILITY COMPANY:    |

DESIGNED BY: DA

DESIGNED ON


9/6/2022

LABELS

E-2

ADDRESS: 2578 W 600 N  
SUITE 100 LINDON, UT 84042  
PHONE: 866-736-1253

PV SYSTEM LABELING MAP



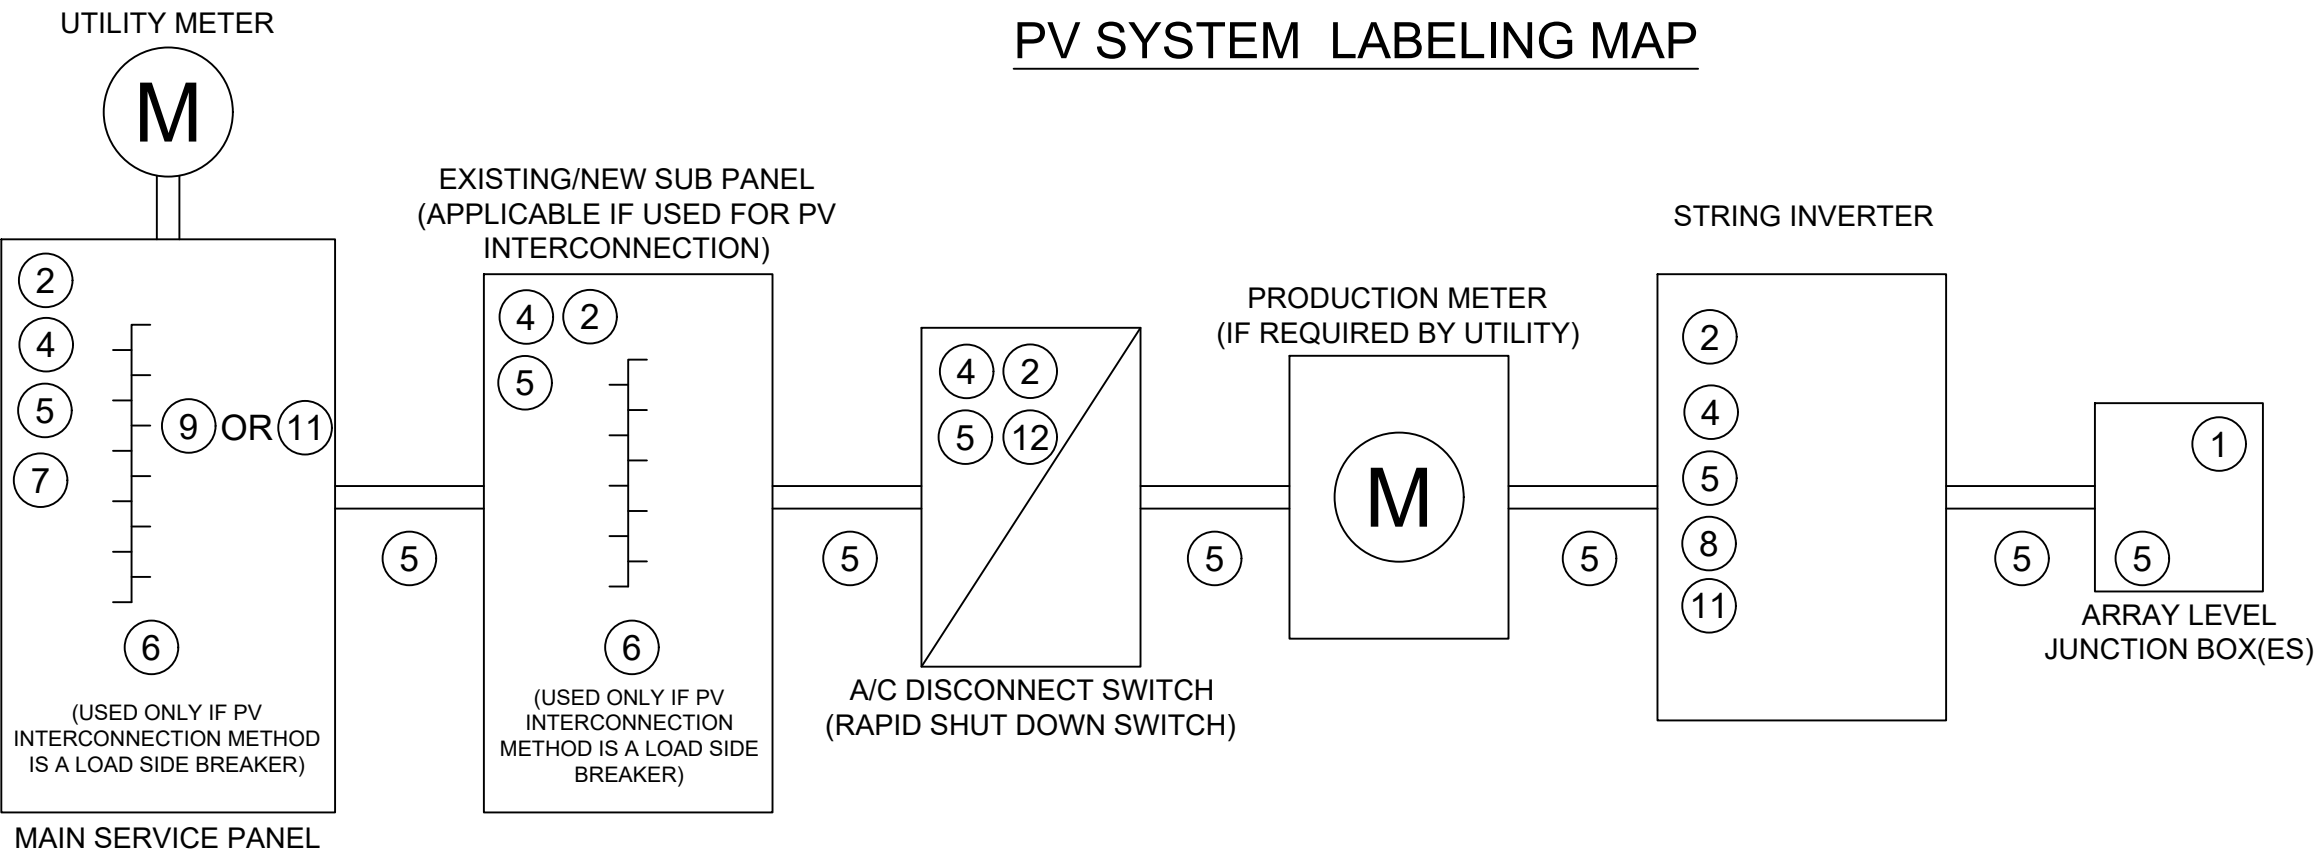


\* DIRECTORY PLACARD REQUIRED BY NEC 705.10, TO BE PLACED ON THE MAIN SERVICE PANEL COVER (SHOWN AS LABEL "DP").  
SEE DIRECTORY PLACARD ATTACHED TO PLANSET FOR REFERENCE.


- LABELING NOTES:**
1. LABELS CALLED OUT ACCORDING TO ALL COMMON CONFIGURATIONS IN ADOPTED NATIONAL ELECTRIC CODE (SEE C-1). ELECTRICIAN TO DETERMINE EXACT REQUIREMENTS IN THE FIELD PER DESIGN CONFIGURATION, CURRENT, NEC, AND LOCAL CODES.
  2. LABELING REQUIREMENTS BASED ON THE ADOPTED NATIONAL ELECTRIC CODE (SEE C-1), OSHA STANDARD 19010.145, ANSI Z535.
  3. MATERIAL BASED ON THE REQUIREMENTS OF THE AUTHORITY HAVING JURISDICTION.
  4. LABELS TO BE OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED [NEC 110.21] THEY SHALL BE PERMANENTLY ATTACHED, WEATHER/SUNLIGHT RESISTANT, AND WILL NOT BE HAND WRITTEN NEC 11.21(B)
  5. LABELS TO BE A MINIMUM LETTER HEIGHT OF 3/8", WHITE ON RED BACKGROUND; REFLECTIVE, AND PERMANENTLY AFFIXED [IFC 605.11.1.1]
  6. FOR LOCATION OF LABEL SEE CODE REFERENCED NEXT TO LABEL FOR.

|                     |                     |                                            |
|---------------------|---------------------|--------------------------------------------|
| CUSTOMER LAST NAME: | ADKINS              | SYSTEM SIZE: 6.8 KW (E-1)                  |
| ADDRESS:            | 4410 SW AMETHYST DR | ( 17 ) URE - FBM400MFG-BB (CS-1)           |
| CITY:               | LEES SUMMIT         | ( 1 ) SOLAREGE - SE5000H-US0000BNU4 (CS-2) |
| STATE:              | MO                  | ( 17 ) SOLAREGE - S440 (CS-3)              |
| ZIP:                | 64082               | ROOF TYPE: COMP SHINGLE (PV-2)             |
| JURISDICTION:       | Aberdeen            | PREFABRICATED TRUSSES, 2X4 @ 24" (PV-2)    |
| UTILITY COMPANY:    | EVERGY              | INTERCONNECTION METHOD: PV BREAKER         |
| DESIGNED BY: DA     |                     |                                            |
| DESIGNED ON         |                     |                                            |
| 9/6/2022            |                     |                                            |
| LABELS              |                     |                                            |
| E-2.1               |                     |                                            |



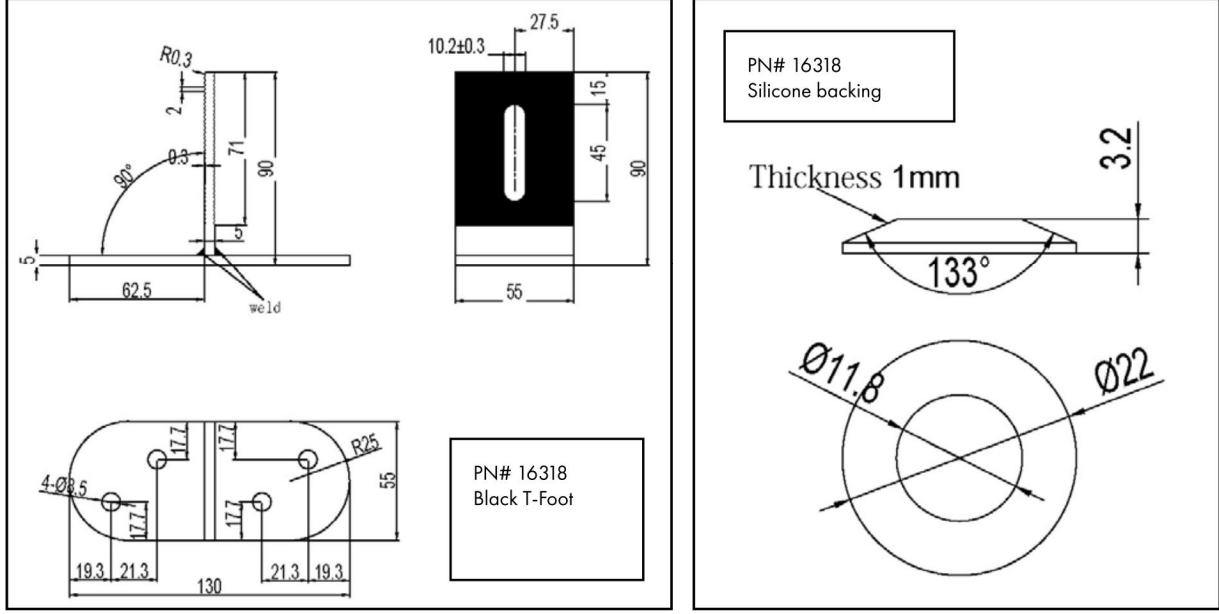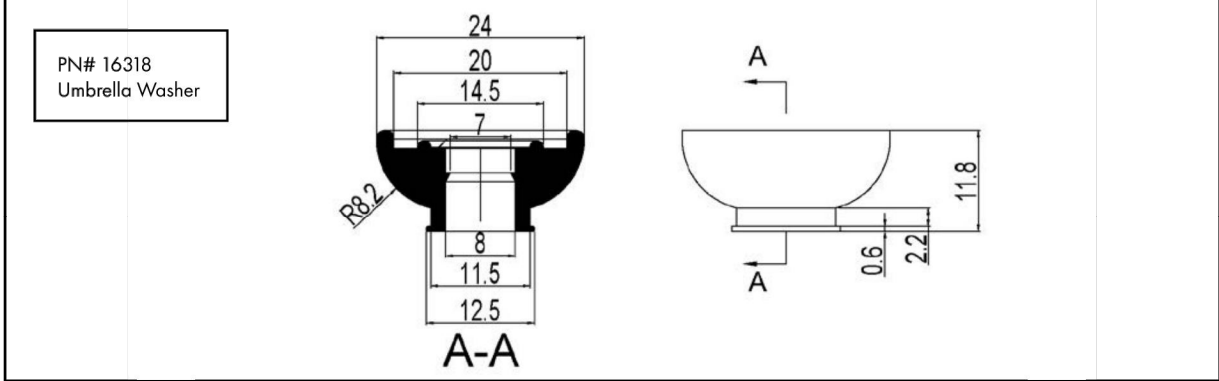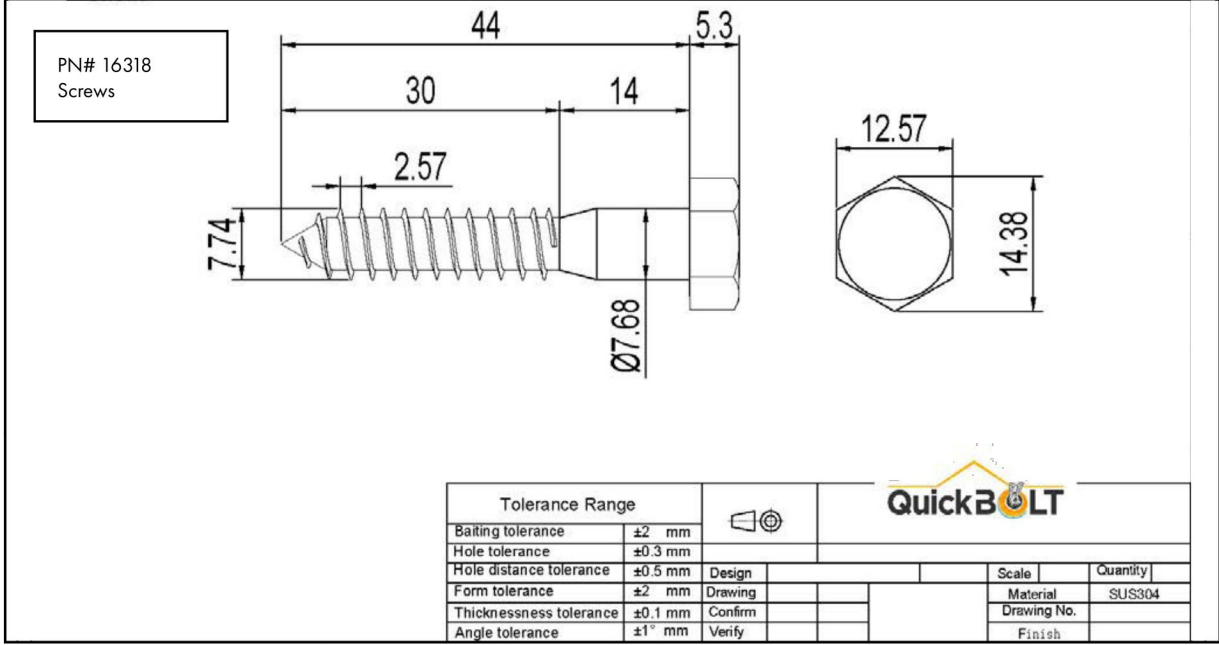

# INSTALL INSTRUCTIONS

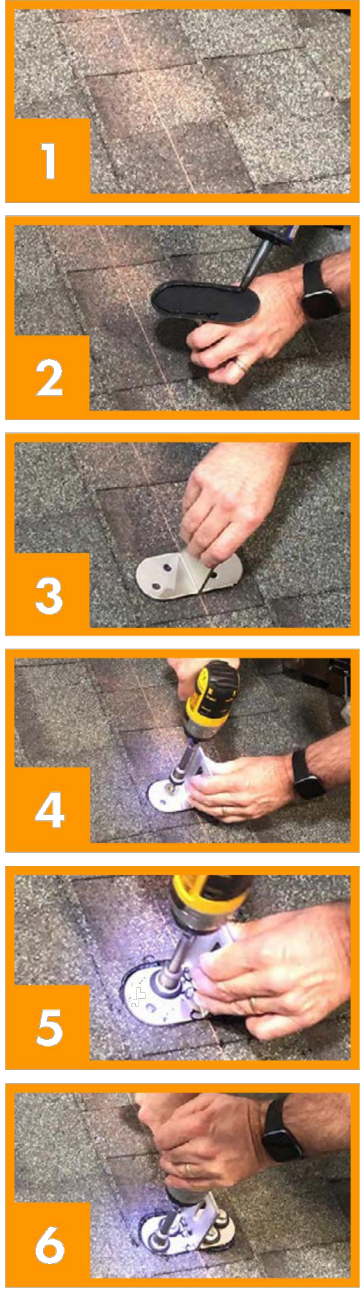

## BLACK DECK MOUNT (16318)

### RECOMMENDED MATERIALS

- MFG approved sealant
- 1/2" Nut Setter

### INSTALLATION INSTRUCTIONS

- Install anywhere on roof. No need to locate rafters
- Place sealant around the bottom of the T-Foot
- Place the T-Foot onto the roof
- Insert first 5/16" x 1-3/4" Hex Lags into T-Foot
- Drive the screw until the Umbrella Washer is compressed
- Repeat with remaining screws

\* Do not predrill

\* To Drive Screws and Set Umbrella Washers Properly  
Torque PSI should not Exceed 57 Lbs/Inch



|                     |                     |                         |                                           |
|---------------------|---------------------|-------------------------|-------------------------------------------|
| CUSTOMER LAST NAME: | ADKINS              | SYSTEM SIZE:            | 6.8 KW (E-1)                              |
| ADDRESS:            | 4410 SW AMETHYST DR |                         | ( 17 ) URE - FBM400MFG-BB (CS-1)          |
| CITY:               | LEES SUMMIT         |                         | ( 1 ) SOLAREGE - SE5000H-US000BNU4 (CS-2) |
| STATE:              | MO                  |                         | ( 17 ) SOLAREGE - S440 (CS-3)             |
| ZIP:                | 64082               | ROOF TYPE:              | COMP SHINGLE (PV-2)                       |
| JURISDICTION:       | Aberdeen            |                         | PREFABRICATED TRUSSES, 2X4 @ 24" (PV-2)   |
| UTILITY COMPANY:    | EVERGY              | INTERCONNECTION METHOD: | PV BREAKER                                |

DESIGNED BY: DA  
DESIGNED ON  
9/6/2022

MOUNT

M-1

UL CERTIFICATION

CERTIFICATE OF COMPLIANCE

Certificate Number 20191115-E493748  
Report Reference E493748-20170817  
Issue Date 2019-NOVEMBER-15

Issued to: QUICKBOLT A DIVISION OF QUICKSCREWS INTERNATIONAL CORP  
5830 Las Positas Rd  
Livermore, CA 94551

This is to certify that representative samples of COMPONENT - MOUNTING SYSTEMS, MOUNTING DEVICES, CLAMPING DEVICES AND GROUND LUGS FOR USE WITH PHOTOVOLTAIC MODULES AND PANELS (See Adendum for Additional Information.)

Have been investigated by UL in accordance with the component requirements in the Standard(s) indicated on this Certificate. UL Recognized components are incomplete in certain constructional features or restricted in performance capabilities and are intended for installation in complete equipment submitted for investigation to UL LLC.

Standard(s) for Safety: UL 2703 Standard for Mounting Systems, Mounting Devices, Clamping/Retention Devices, and Ground Lugs for Use with Flat-Plate Photovoltaic Modules and Panels.

Additional Information: See the UL Online Certifications Directory at [www.ul.com/database](http://www.ul.com/database) for additional information

This Certificate of Compliance does not provide authorization to apply the UL Recognized Component Mark.

Only those products bearing the UL Recognized Component Mark should be considered as being UL Certified and covered under UL's Follow-Up Services.

Look for the UL Recognized Component Mark on the product.

B. Mahlenz  
Bruce Mahlenz, Director North American Certification Program  
UL LLC



Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) for any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at <http://www.ul.com/customer-service>

CERTIFICATE OF COMPLIANCE

Certificate Number 20191115-E493748  
Report Reference E493748-20170817  
Issue Date 2019-NOVEMBER-15

This is to certify that representative samples of the product as specified on this certificate were tested according to the current UL requirements.

Addendum -

Models/Product

USR - Component, Roof Mounting Hook Units, Models 15891, 15893, 15987, 16000, 16317, 16318, 16988, 16990, 16991, 16993, 17508, 17509, 17510, 17511, 17512, 17513, 17514, 17515, 17516, 17517, 17518, 17519, 17520, 17521, 17522, 17523, 17524, 17525, 17526, 17527, 17536, 17537, 17538, 17539, 17540, 17541, 17542, 17543, 17544, 17545, 17546, 17547, 17548, 17549, 17550, 17551, 17552, 17553, 17554, 17555, 17556, 17558, 17559, 17560, 17568, 17569, 17570, 17571, 17572, 17573, 17574, 17575, 17576, 17577, 17578, 17579, 17580, 17585, 17586, 17587, 17588, 17589, 17592, 17596, 17600, 17601, 17606, 17607, 17608, 17609, 17610, 17611, 17612, 17613, 17614, 17615, 17616, 17617, 17618, 17620, 17621, 17622, 17623, 17624, 17625, 17626, 17627, 17628, 17629, 17630, 17631, 17632, 17633, 17636, 17637, 17638, 17639, 17642, 17643, 17646, 17647, 17648, 17649, 17650, 17651, 17659, 17664, 17667, 17669, 17670, 17671, 17672, 17673, 17678, 17679, 17680, 17681, 17686, 17687, 17688, 17689, 17700, 17701, 17702, 17703, 17704, 17705, 17706, 17707, 17708, 17709, 17710, 17711, 17712, 17717, 17718, 17759, 15891-10, 15891BLK-10, 15987A, 15987B, 17667SS, 17672SS, 17680SS, 17688SS, 17713SS, 17720, 17721SS, 17723, 17724SS, 17726, 17727SS, 17729, 17730SS, 15894SS, 15891SS, 15987BSS, 17660, 17661, 17662, 17663

Ratings: Overcurrent Protection Rating - 25 Amps

B. Mahlenz  
Bruce Mahlenz, Director North American Certification Program  
UL LLC



Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) for any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at <http://www.ul.com/customer-service>

RELEASE FOR CONSTRUCTION

AS NOTED FOR PLAN REVIEW

DEVELOPMENT SERVICES

LEE'S SUMMIT, MISSOURI

09/20/2022

ADDRESS: 2578 W 600 N  
SUITE 100 LINDON, UT 84042  
PHONE: 866-736-1253

|                     |                     |                                           |
|---------------------|---------------------|-------------------------------------------|
| CUSTOMER LAST NAME: | ADKINS              | SYSTEM SIZE: 6.8 KW (E-1)                 |
| ADDRESS:            | 4410 SW AMETHYST DR | ( 17 ) URE - FBM400MFG-BB (CS-1)          |
| CITY:               | LEES SUMMIT         | ( 1 ) SOLAREGE - SE5000H-US000BNU4 (CS-2) |
| STATE:              | MO                  | ( 17 ) SOLAREGE - S440 (CS-3)             |
| ZIP:                | 64082               | ROOF TYPE: COMP SHINGLE (PV-2)            |
| JURISDICTION:       | Aberdeen            | PREFABRICATED TRUSSES, 2X4 @ 24" (PV-2)   |
| UTILITY COMPANY:    | EVERGY              | INTERCONNECTION METHOD: PV BREAKER        |

DESIGNED BY: DA

DESIGNED ON

9/6/2022



MOUNT CONT.

M-2



## XR10 Rail

Cut Sheet

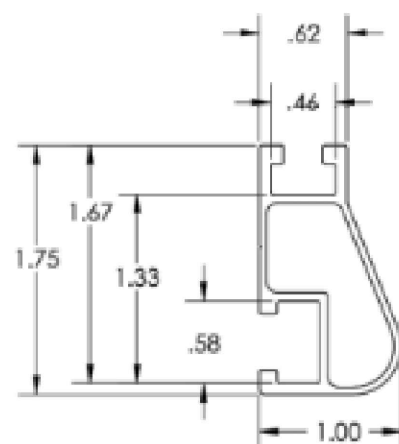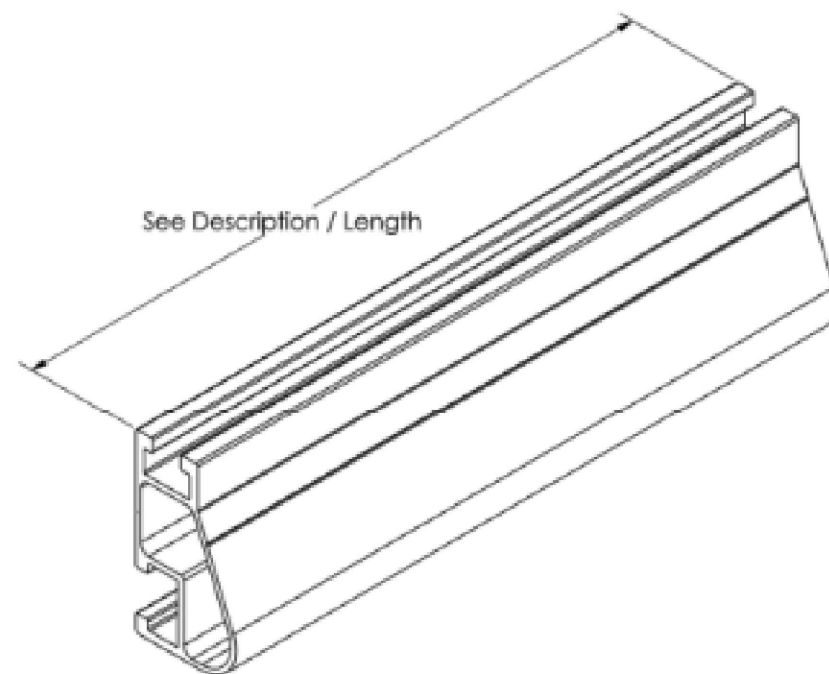

| Rail Section Properties    |                       |
|----------------------------|-----------------------|
| Property                   | Value                 |
| Total Cross-Sectional Area | 0.363 in <sup>2</sup> |
| Section Modulus (X-axis)   | 0.136 in <sup>3</sup> |
| Moment of Inertia (X-axis) | 0.124 in <sup>4</sup> |
| Moment of Inertia (Y-axis) | 0.032 in <sup>4</sup> |
| Torsional Constant         | 0.076 in <sup>3</sup> |
| Polar Moment of Inertia    | 0.033 in <sup>4</sup> |


| Clear Part Number | Black Part Number | Description / Length      | Material             | Weight    |
|-------------------|-------------------|---------------------------|----------------------|-----------|
| XR-10-132A        | XR-10-132B        | XR10, Rail 132" (11 Feet) | 6000-Series Aluminum | 4.67 lbs. |
| XR-10-168A        | XR-10-168B        | XR10, Rail 168" (14 Feet) |                      | 5.95 lbs. |
| XR-10-204A        | XR-10-204B        | XR10, Rail 204" (17 Feet) |                      | 7.22 lbs. |

v1.0




## XR10 Bonded Splice

Cut Sheet

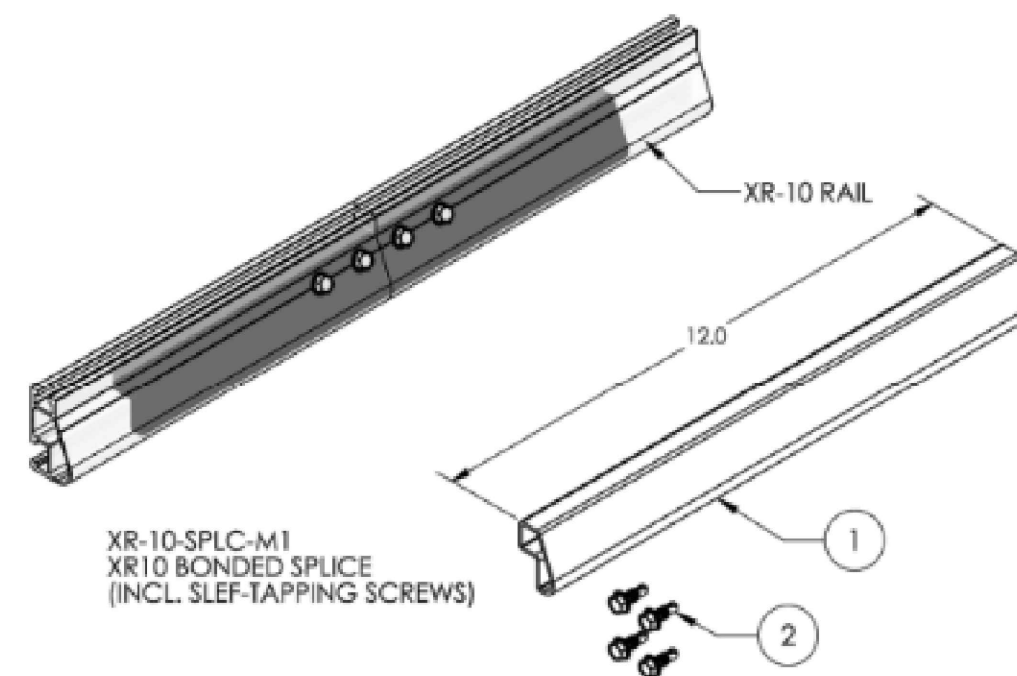


### 1) Splice, XR10, Mill 12" long

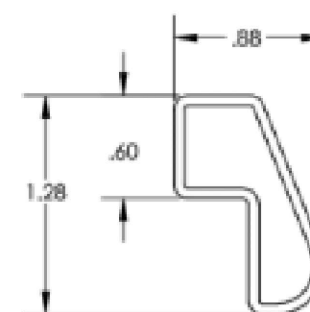

| Property | Value                |
|----------|----------------------|
| Material | 6000 Series Aluminum |
| Finish   | Mill                 |

### 2) Screw, Self Drilling

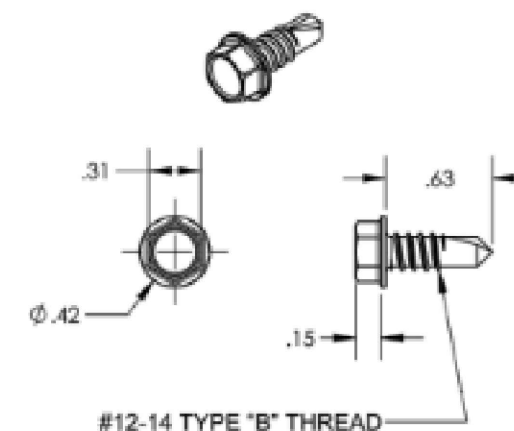

| Property | Value                      |
|----------|----------------------------|
| Material | 300 Series Stainless Steel |
| Finish   | Clear                      |

v1.10

RELEASE FOR CONSTRUCTION  
AS NOTED FOR PLAN REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
09/20/2022

ADDRESS: 2578 W 600 N  
SUITE 100 LONDON, UT 84042  
PHONE: 866-736-1253

|                     |                     |                         |                            |
|---------------------|---------------------|-------------------------|----------------------------|
| CUSTOMER LAST NAME: | ADKINS              | SYSTEM SIZE:            | 6.8 KW (E-1)               |
| ADDRESS:            | 4410 SW AMETHYST DR | ( 17 ) URE              | - FBM400MFG-BB (CS-1)      |
| CITY:               | LEES SUMMIT         | ( 1 ) SOLAREGE          | - SE5000H-US000BNU4 (CS-2) |
| STATE:              | MO                  | ( 17 ) SOLAREGE         | - S440 (CS-3)              |
| ZIP:                | 64082               | ROOF TYPE:              | COMP SHINGLE (PV-2)        |
| JURISDICTION:       | Aberdeen            | PREFABRICATED TRUSSES:  | 2X4 @ 24" (PV-2)           |
| UTILITY COMPANY:    | EVERGY              | INTERCONNECTION METHOD: | PV BREAKER                 |

DESIGNED BY: DA

DESIGNED ON

9/6/2022


EQUIPMENT

EQ-1




Universal Fastening Object

Cut Sheet

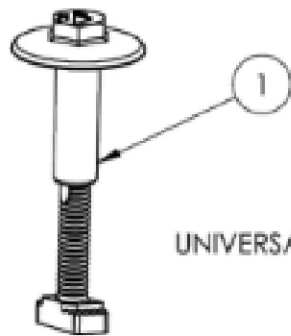

UNIVERSAL FASTENING OBJECT

| ITEM NO.     | DESCRIPTION                              | QTY. IN KIT |
|--------------|------------------------------------------|-------------|
| UFO-CL-001   | KIT, 4PCS, UNIVERSAL MODULE CLAMP, CLEAR | 4           |
| UFO-CL-001-B | KIT, 4PCS, UNIVERSAL MODULE CLAMP, BLACK | 4           |

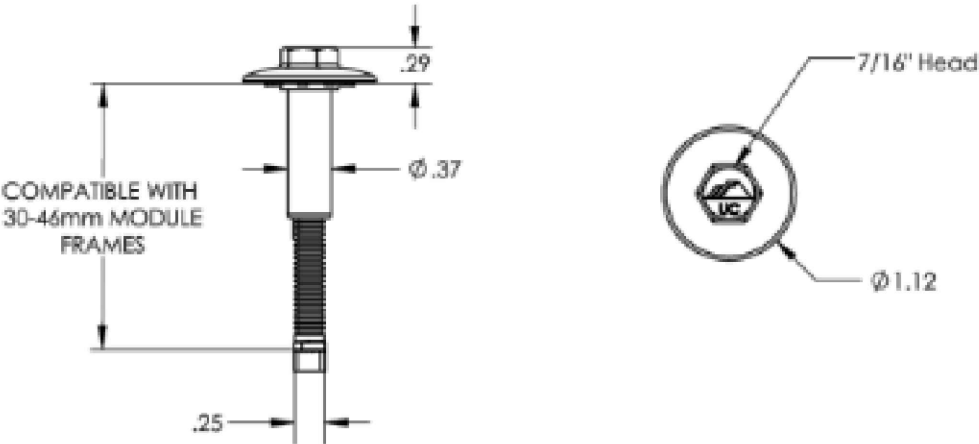


| Property | Value                      |
|----------|----------------------------|
| Material | 300 Series Stainless Steel |
| Finish   | Clear and Black            |

v1.20




CAMO

Cut Sheet

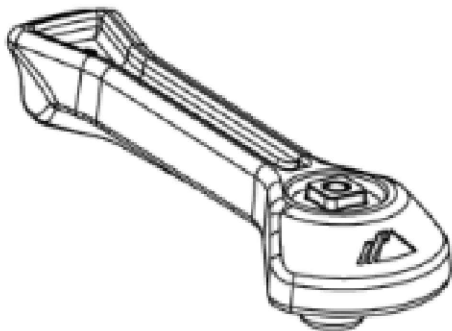

| PART NO.   | DESCRIPTION                      |
|------------|----------------------------------|
| CAMO-01-M1 | HIDDEN END CAM (UNIVERSAL CLAMP) |

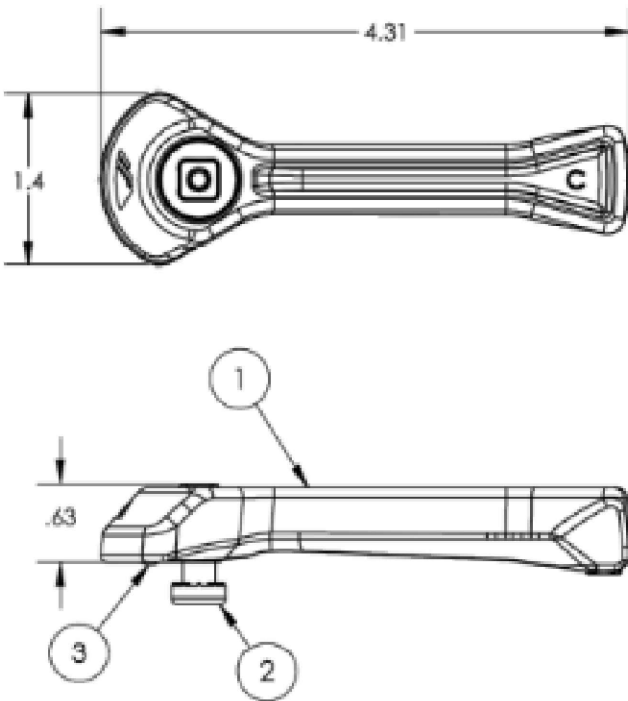

| Item No. | Description            | Material                   | Finish |
|----------|------------------------|----------------------------|--------|
| 1        | Handle                 | Aluminum                   | Mill   |
| 2        | Bolt, Bonding Shoulder | 300 Series Stainless Steel | Clear  |
| 3        | Bonding Pins, Linear   | 300 Series Stainless Steel | Clear  |

v1.0

ADDRESS: 2578 W 600 N  
SUITE 100 LINDON, UT 84042  
PHONE: 866-736-1253

|                     |                     |                         |                            |
|---------------------|---------------------|-------------------------|----------------------------|
| CUSTOMER LAST NAME: | ADKINS              | SYSTEM SIZE:            | 6.8 KW (E-1)               |
| ADDRESS:            | 4410 SW AMETHYST DR | ( 17 ) URE              | - FBM400MFG-BB (CS-1)      |
| CITY:               | LEES SUMMIT         | ( 1 ) SOLAREGE          | - SE5000H-US000BNU4 (CS-2) |
| STATE:              | MO                  | ( 17 ) SOLAREGE         | - S440 (CS-3)              |
| ZIP:                | 64082               | ROOF TYPE:              | COMP SHINGLE (PV-2)        |
| JURISDICTION:       | Aberdeen            | PREFABRICATED TRUSSES:  | 2X4 @ 24" (PV-2)           |
| UTILITY COMPANY:    | EVERGY              | INTERCONNECTION METHOD: | PV BREAKER                 |

DESIGNED BY: DA  
DESIGNED ON  
9/6/2022

EQUIPMENT

EQ-2

Attn: Corey Geiger, COO, IronRidge Inc.  
Date: September 7<sup>th</sup>, 2018

Re: Structural Certification and Span Tables for IronRidge Flush Mount System

This letter addresses the structural performance and code compliance of IronRidge's Flush Mount System. The Flush Mount System is a proprietary rooftop mounting system used to support photovoltaic (PV) modules installed in portrait or landscape orientation and set parallel to the underlying roof surface. PV modules are supported by extruded aluminum XR Rails and secured to the rails with IronRidge mounting clamps. The XR Rails are side mounted to a selected roof attachment with 3/8" stainless steel bonding hardware and then attached directly to the roof structure or to a stanchion that is fastened to the underlying roof structure. Assembly details of a typical Flush Mount installation and its core components are shown in Exhibit EX-0015.

The IronRidge Flush Mount System is designed and certified to the structural requirements of the reference standards listed below, for the load conditions and configurations tabulated in the attached span tables.

- ASCE/SEI 7-10 Minimum Design Loads for Buildings and Other Structures (ASCE 7-10)
- 2015 International Building Code (IBC-2015)
- 2016 California Building Code (CBC-2016)
- 2015 Aluminum Design Manual (ADM-2015)

The tables included in this letter provide the maximum allowable spans of XR Rails in the Flush Mount System for the respective loads and configurations listed, covering wind exposure categories B, C, & D, roof zones 1, 2 & 3, and roof slopes from 0° to 45°. The span tables are applicable provided that the following conditions are met:

- Span is the distance between two adjacent roof attachment points (measured at the center of the attachment fastener)
- The underlying roof pitch, measured between roof surface and horizontal plane, is 45° or less.
- The *mean roof height*, defined as the average of the roof eave height and the roof ridge height measured from grade, does not exceed 30 feet.
- Module length shall not exceed the listed maximum dimension provided for the respective span table and module width shall not exceed 48".
- All Flush Mount components shall be installed in a professional workmanlike manner per IronRidge's *Flush Mount installation manual* and other applicable standards for general roof construction practice.

© 2018 IronRidge, Inc.

CA Flush Mount System Certification Letter - 1

13. Systems using CAMO module clamps shall be installed with the following guidance:

- For single module installations ("orphan modules") using modules with a length greater than 67.5", CAMO clamps shall not be installed in regions that experience ground snow loads of 70psf and greater: such scenarios are shown by asterisks in the applicable span table.
- CAMO will function within a module's design load ratings. Be sure the specific module being used with CAMO is listed in IronRidge's installation manual, is suitable for the environmental conditions of a particular project, and meets the dimensional requirements shown in the figure below.




Figure 1: CAMO Module Frame Dimensional Requirements

© 2018 IronRidge, Inc.

CA Flush Mount System Certification Letter - 3

The parameters and adjustments allowed in the span tables are defined as the following:

- The Flush Mount System is designed as a Risk Category II structure as defined by ASCE 7-10 Chart 1.5-1.
- When designing with a roof slope not listed in the span tables, but no greater than 45°, the lesser of the two span values listed immediately below and above the desired slope shall be used. For instance, if one is designing to a roof slope of 12°, use the lesser of the two span values associated with 10° and 15°.
- The wind speed selection shall conform to ASCE 7-10 Fig. 26.5-1A (Risk Category II wind) and any state & local county/city amendments to the IBC. No special wind topographic features are included in the span tables and the topographic coefficient (Kzt) is taken as 1.0.
- The snow load used in the span tables is the *ground snow* and shall conform to ASCE 7-10 Fig. 7-1. If a more restrictive snow load is imposed by a local building code/amendment to the IBC, such snow load requirement shall also be complied with. If the local jurisdiction specified snow load is in the format of a flat roof snow load, it shall first be converted to a ground snow following the local building code/amendment before the application of the attached span tables. No special snow conditions are considered including unbalanced, drifting, sliding or ponding snow. Snow load conditions presented in the span tables do not include buildings which are intentionally kept below freezing, kept just above freezing, or unheated.
- The span tables reflect the ASCE 7 prescribed earthquake loads with the maximum magnitudes being:
  - For ground snow no greater than 42psf:  $S_s \leq 2.0g$  for Site Class A, B, C, or D.
  - For ground snow greater than 42psf:  $S_s \leq 1.0g$  for Site Class A, B, C, or D.
  - For ground snow between 42 and 65psf:  $S_s \leq 1.5g$  for Site Class A, B, C, or D.
- Roof zone size and definition conforms to ASCE 7-10 Fig. 30.4-2A.
- Allowable span length in the charts may be multiplied by a factor of 1.08 if the rails are continuous over a minimum of three spans.
- An array to roof clearance of 2" minimum must be provided.
- The maximum cantilever length measured from the rail end to the nearest attachment point shall not exceed 40% of the *allowable span* provided for the respective load & configuration condition from the span tables.
- No rail splices are allowed in the cantilever, outer 2/3 of end spans, or middle 1/3 of interior spans.
- For shaded cells of the span tables, UFO Mid Clamps shall not be installed closer than 20" to the shaded cell's associated Roof Zone.
- When a roof attachment listed in IronRidge's *Flush Mount installation manual* is considered, the span values provided in this letter can be adjusted using IronRidge's online Design Assistant by checking the capacity of the selected roof attachment against the reaction forces provided in Design Assistant.

© 2018 IronRidge, Inc.

CA Flush Mount System Certification Letter - 2

The span tables provided in this letter are certified based on the structural performance of IronRidge XR Rails only with no consideration of the structural adequacy of the chosen roof attachments, PV modules, or the underlying roof supporting members. It is the responsibility of the installer or system designer to verify the structural capacity and adequacy of the aforementioned system components in regards to the applied or resultant loads of any chosen array configuration.

Sincerely,



Gang Xuan, SE  
Senior Structural Engineer

Date:  
2018.09.18  
10:17:09 -07'00'

© 2018 IronRidge, Inc.

CA Flush Mount System Certification Letter - 4

ADDRESS: 2578 W 600 N  
SUITE 100 LINDON, UT 84042  
PHONE: 866-736-1253

|                     |                     |                         |                            |
|---------------------|---------------------|-------------------------|----------------------------|
| CUSTOMER LAST NAME: | ADKINS              | SYSTEM SIZE:            | 6.8 KW (E-1)               |
| ADDRESS:            | 4410 SW AMETHYST DR | ( 17 ) URE              | - FBM400MFG-BB (CS-1)      |
| CITY:               | LEES SUMMIT         | ( 1 ) SOLAREGE          | - SE5000H-US000BNU4 (CS-2) |
| STATE:              | MO                  | ( 17 ) SOLAREGE         | - S440 (CS-3)              |
| ZIP:                | 64082               | ROOF TYPE:              | COMP SHINGLE (PV-2)        |
| JURISDICTION:       | Aberdeen            | PREFABRICATED TRUSSES,  | 2X4 @ 24" (PV-2)           |
| UTILITY COMPANY:    | EVERGY              | INTERCONNECTION METHOD: | PV BREAKER                 |

DESIGNED BY: DA

DESIGNED ON

9/6/2022

EQUIPMENT

EQ-3

RELEASE FOR CONSTRUCTION

AS NOTED FOR PLAN REVIEW

DEVELOPMENT SERVICES

LEE'S SUMMIT, MISSOURI

09/20/2022

ADDRESS: 2578 W 600 N  
SUITE 100 LINDON, UT 84042  
PHONE: 866-736-1253

|                                            |  |
|--------------------------------------------|--|
| SYSTEM SIZE: 6.8 KW (E-1)                  |  |
| ( 17 ) URE - FBM400MFG-BB (CS-1)           |  |
| ( 1 ) SOLAREdge - SE5000H-US000BNU4 (CS-2) |  |
| ( 17 ) SOLAREdge - S440 (CS-3)             |  |
| ROOF TYPE: COMP SHINGLE (PV-2)             |  |
| PREFABRICATED TRUSSES, 2X4 @ 24" (PV-2)    |  |
| INTERCONNECTION METHOD: PV BREAKER         |  |

|                              |  |
|------------------------------|--|
| CUSTOMER LAST NAME: ADKINS   |  |
| ADDRESS: 4410 SW AMETHYST DR |  |
| CITY: LEES SUMMIT            |  |
| STATE: MO                    |  |
| ZIP: 64082                   |  |
| JURISDICTION: Aberdeen       |  |
| UTILITY COMPANY: EVERGY      |  |

DESIGNED BY: DA

DESIGNED ON

9/6/2022

EQUIPMENT


EQ-4

| Rail:<br>XR10       |                        | Flush Mount System Span Table (inches)<br>Portrait Installation (Maximum Module Length 67.5")<br>Exposure C |        |        |                |        |        |                |        |        |                                                                                                                  |        |        |        |        |        |        |        |        |        |        |        |        |        |        |        |        |        |        |        |        |               |  |  |
|---------------------|------------------------|-------------------------------------------------------------------------------------------------------------|--------|--------|----------------|--------|--------|----------------|--------|--------|------------------------------------------------------------------------------------------------------------------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|---------------|--|--|
| Wind Speed<br>(mph) | Roof Slope<br>(deg.s.) | Ground Snow: 0 psf                                                                                          |        |        | 10 psf         |        |        | 20 psf         |        |        | 30 psf                                                                                                           |        |        | 40 psf |        |        | 50 psf |        |        | 60 psf |        |        | 70 psf |        |        | 80 psf |        |        | 90 psf |        |        |               |  |  |
|                     |                        | Zone 1                                                                                                      | Zone 2 | Zone 3 | Zone 1         | Zone 2 | Zone 3 | Zone 1         | Zone 2 | Zone 3 | Zone 1                                                                                                           | Zone 2 | Zone 3 | Zone 1 | Zone 2 | Zone 3 | Zone 1 | Zone 2 | Zone 3 | Zone 1 | Zone 2 | Zone 3 | Zone 1 | Zone 2 | Zone 3 | Zone 1 | Zone 2 | Zone 3 | Zone 1 | Zone 2 | Zone 3 |               |  |  |
| 110                 | 0-7                    | 83                                                                                                          | 72     | 55     | 81             | 72     | 55     | 68             | 68     | 55     | 67                                                                                                               | 67     | 55     | 60     | 60     | 55     | 54     | 54     | 54     | 50     | 50     | 50     | 46     | 46     | 46     | 43     | 43     | 43     | 41     | 41     | 41     |               |  |  |
|                     | 8-27                   | 85                                                                                                          | 72     | 56     | 80             | 72     | 56     | 67             | 67     | 56     | 66                                                                                                               | 66     | 56     | 60     | 60     | 56     | 54     | 54     | 54     | 50     | 50     | 50     | 46     | 46     | 46     | 43     | 43     | 43     | 41     | 41     | 41     |               |  |  |
|                     | 28-45                  | 81                                                                                                          | 79     | 79     | 76             | 76     | 76     | 66             | 66     | 66     | 65                                                                                                               | 65     | 65     | 61     | 61     | 61     | 57     | 57     | 57     | 53     | 53     | 53     | 50     | 50     | 50     | 47     | 47     | 47     | 45     | 45     | 45     |               |  |  |
| 115                 | 0-7                    | 84                                                                                                          | 66     | 53     | 81             | 66     | 53     | 68             | 66     | 53     | 67                                                                                                               | 66     | 53     | 60     | 60     | 53     | 54     | 54     | 53     | 50     | 50     | 50     | 46     | 46     | 46     | 43     | 43     | 43     | 41     | 41     | 41     |               |  |  |
|                     | 8-27                   | 84                                                                                                          | 66     | 54     | 80             | 66     | 54     | 67             | 66     | 54     | 66                                                                                                               | 66     | 54     | 60     | 60     | 54     | 54     | 54     | 53     | 50     | 50     | 50     | 46     | 46     | 46     | 43     | 43     | 43     | 41     | 41     | 41     |               |  |  |
|                     | 28-45                  | 79                                                                                                          | 76     | 76     | 74             | 74     | 74     | 65             | 65     | 65     | 64                                                                                                               | 64     | 64     | 60     | 60     | 60     | 56     | 56     | 56     | 53     | 53     | 53     | 50     | 50     | 50     | 47     | 47     | 47     | 45     | 45     | 45     |               |  |  |
| 120                 | 0-7                    | 81                                                                                                          | 64     | 50     | 81             | 64     | 50     | 68             | 64     | 50     | 67                                                                                                               | 64     | 50     | 60     | 60     | 50     | 54     | 54     | 50     | 50     | 50     | 50     | 46     | 46     | 46     | 43     | 43     | 43     | 41     | 41     | 41     |               |  |  |
|                     | 8-27                   | 84                                                                                                          | 64     | 51     | 80             | 64     | 51     | 67             | 64     | 51     | 66                                                                                                               | 64     | 51     | 60     | 60     | 51     | 54     | 54     | 51     | 50     | 50     | 50     | 46     | 46     | 46     | 43     | 43     | 43     | 41     | 41     | 41     |               |  |  |
|                     | 28-45                  | 76                                                                                                          | 73     | 73     | 73             | 73     | 73     | 64             | 64     | 64     | 64                                                                                                               | 64     | 64     | 59     | 59     | 59     | 55     | 55     | 55     | 52     | 52     | 52     | 50     | 50     | 50     | 47     | 47     | 47     | 45     | 45     | 45     |               |  |  |
| 130                 | 0-7                    | 77                                                                                                          | 58     | 46     | 77             | 58     | 46     | 68             | 58     | 46     | 67                                                                                                               | 58     | 46     | 60     | 58     | 46     | 54     | 54     | 46     | 50     | 50     | 46     | 46     | 46     | 46     | 43     | 43     | 43     | 41     | 41     | 41     |               |  |  |
|                     | 8-27                   | 80                                                                                                          | 59     | 47     | 79             | 59     | 47     | 66             | 59     | 47     | 65                                                                                                               | 59     | 47     | 60     | 58     | 47     | 54     | 54     | 47     | 50     | 50     | 47     | 46     | 46     | 46     | 43     | 43     | 43     | 41     | 41     | 41     |               |  |  |
|                     | 28-45                  | 72                                                                                                          | 68     | 68     | 72             | 68     | 68     | 64             | 64     | 64     | 61                                                                                                               | 61     | 61     | 57     | 57     | 57     | 54     | 54     | 54     | 51     | 51     | 51     | 49     | 49     | 49     | 47     | 47     | 47     | 45     | 45     | 45     |               |  |  |
| 140                 | 0-7                    | 73                                                                                                          | 54     | 43     | 73             | 54     | 43     | 68             | 54     | 43     | 67                                                                                                               | 54     | 43     | 60     | 54     | 43     | 54     | 54     | 43     | 50     | 50     | 43     | 46     | 46     | 43     | 43     | 43     | 43     | 41     | 41     | 41     |               |  |  |
|                     | 8-27                   | 74                                                                                                          | 54     | 44     | 74             | 54     | 44     | 65             | 54     | 44     | 64                                                                                                               | 54     | 44     | 59     | 54     | 44     | 54     | 54     | 44     | 50     | 50     | 44     | 46     | 46     | 44     | 43     | 43     | 43     | 41     | 41     | 41     |               |  |  |
|                     | 28-45                  | 67                                                                                                          | 64     | 64     | 67             | 64     | 64     | 60             | 60     | 60     | 59                                                                                                               | 59     | 59     | 56     | 56     | 56     | 53     | 53     | 53     | 50     | 50     | 50     | 48     | 48     | 48     | 46     | 46     | 46     | 44     | 44     | 44     |               |  |  |
| 150                 | 0-7                    | 68                                                                                                          | 50     | 40     | 68             | 50     | 40     | 68             | 50     | 40     | 67                                                                                                               | 50     | 40     | 60     | 50     | 40     | 54     | 50     | 40     | 50     | 50     | 40     | 46     | 46     | 40     | 43     | 43     | 40     | 41     | 41     | 40     |               |  |  |
|                     | 8-27                   | 72                                                                                                          | 51     | 41     | 72             | 51     | 41     | 64             | 51     | 41     | 64                                                                                                               | 51     | 41     | 57     | 51     | 41     | 53     | 51     | 41     | 50     | 50     | 41     | 46     | 46     | 41     | 43     | 43     | 41     | 41     | 41     | 41     |               |  |  |
|                     | 28-45                  | 64                                                                                                          | 59     | 59     | 64             | 59     | 59     | 58             | 58     | 58     | 57                                                                                                               | 57     | 57     | 54     | 54     | 54     | 51     | 51     | 51     | 49     | 49     | 49     | 47     | 47     | 47     | 45     | 45     | 45     | 43     | 43     | 43     |               |  |  |
| 160                 | 0-7                    | 64                                                                                                          | 48     | 38     | 64             | 48     | 38     | 64             | 48     | 38     | 64                                                                                                               | 48     | 38     | 60     | 48     | 38     | 54     | 48     | 38     | 50     | 48     | 38     | 46     | 46     | 38     | 43     | 43     | 38     | 41     | 41     | 38     |               |  |  |
|                     | 8-27                   | 65                                                                                                          | 48     | 39     | 65             | 48     | 39     | 64             | 48     | 39     | 61                                                                                                               | 48     | 39     | 56     | 48     | 39     | 53     | 48     | 39     | 49     | 48     | 39     | 46     | 46     | 39     | 43     | 43     | 39     | 41     | 41     | 39     |               |  |  |
|                     | 28-45                  | 60                                                                                                          | 55     | 55     | 60             | 55     | 55     | 56             | 55     | 55     | 55                                                                                                               | 55     | 55     | 52     | 52     | 52     | 50     | 50     | 50     | 48     | 48     | 48     | 46     | 46     | 46     | 44     | 44     | 44     | 42     | 42     | 42     |               |  |  |
| 170                 | 0-7                    | 60                                                                                                          | 44     | 35     | 60             | 44     | 35     | 60             | 44     | 35     | 60                                                                                                               | 44     | 35     | 60     | 44     | 35     | 54     | 44     | 35     | 50     | 44     | 35     | 46     | 44     | 35     | 43     | 43     | 35     | 41     | 41     | 35     |               |  |  |
|                     | 8-27                   | 61                                                                                                          | 45     | 36     | 61             | 45     | 36     | 61             | 45     | 36     | 60                                                                                                               | 45     | 36     | 55     | 45     | 36     | 52     | 45     | 36     | 49     | 45     | 36     | 46     | 45     | 36     | 43     | 43     | 36     | 41     | 41     | 36     |               |  |  |
|                     | 28-45                  | 57                                                                                                          | 52     | 52     | 57             | 52     | 52     | 54             | 52     | 52     | 54                                                                                                               | 52     | 52     | 51     | 51     | 51     | 48     | 48     | 48     | 46     | 46     | 46     | 45     | 45     | 45     | 43     | 43     | 43     | 42     | 42     | 42     |               |  |  |
| 180                 | 0-7                    | 56                                                                                                          | 42     | 33     | 56             | 42     | 33     | 56             | 42     | 33     | 56                                                                                                               | 42     | 33     | 56     | 42     | 33     | 54     | 42     | 33     | 50     | 42     | 33     | 46     | 42     | 33     | 43     | 42     | 33     | 41     | 41     | 33     |               |  |  |
|                     | 8-27                   | 58                                                                                                          | 42     | 34     | 58             | 42     | 34     | 58             | 42     | 34     | 58                                                                                                               | 42     | 34     | 54     | 42     | 34     | 51     | 42     | 34     | 48     | 42     | 34     | 46     | 42     | 34     | 43     | 42     | 34     | 41     | 41     | 34     |               |  |  |
|                     | 28-45                  | 54                                                                                                          | 50     | 50     | 54             | 50     | 50     | 52             | 50     | 50     | 52                                                                                                               | 50     | 50     | 49     | 49     | 49     | 47     | 47     | 47     | 45     | 45     | 45     | 44     | 44     | 44     | 42     | 42     | 42     | 41     | 41     | 41     |               |  |  |
|                     |                        | = min 72" span                                                                                              |        |        | = min 64" span |        |        | = min 48" span |        |        | = Note: additional installation requirement on UFO middle clamps. Please refer to Note 10 on Page 2 for details. |        |        |        |        |        |        |        |        |        |        |        |        |        |        |        |        |        |        |        |        | REV 5/09/2018 |  |  |



## Grounding Lug


Cut Sheet

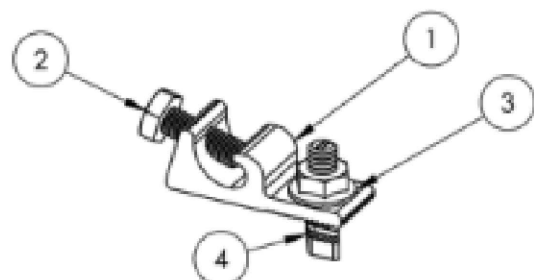

| ITEM NO. | DESCRIPTION                          | QTY. IN KIT |
|----------|--------------------------------------|-------------|
| 1        | LUG, GROUNDING, LAY-IN - LOW PROFILE | 2           |
| 2        | BOLT, 1/4-28 X .750" HEX CS SST      | 2           |
| 3        | NUT, FLANGE HEX 1/4-20 SST           | 2           |
| 4        | BOLT, T CSTM 1/4-20 X 1.188" LOCK SS | 2           |

| Part Number | Description                           | Wire Size Range (AWG) |
|-------------|---------------------------------------|-----------------------|
| GD-LUG-003  | KIT, 2PCS, GROUNDING LUG, LOW PROFILE | 4-10                  |

1) Lug, Grounding

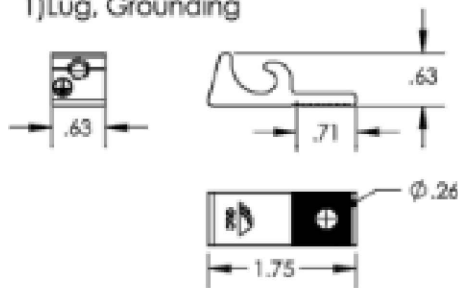


| Property | Value             |
|----------|-------------------|
| Material | Tin Plated Copper |
| Finish   | Clear Matte       |

3) Nut, Flange Hex 1/4-20



| Property | Value                      |
|----------|----------------------------|
| Material | 300 Series Stainless Steel |
| Finish   | Clear                      |

4) Bolt, T CSTM 1/4-20 x .750

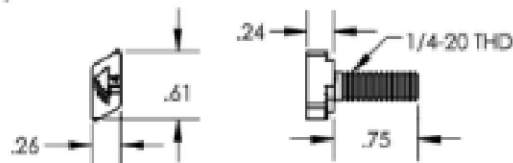


| Property | Value                      |
|----------|----------------------------|
| Material | 300 Series Stainless Steel |
| Finish   | Clear                      |

v1.0



## Bonding Hardware

Cut Sheet

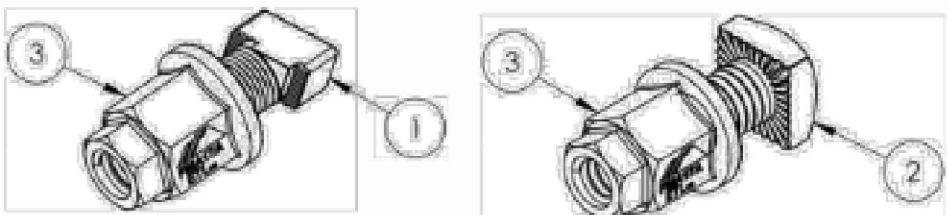


| ITEM NO. | DESCRIPTION                  |
|----------|------------------------------|
| 1        | BOLT, T CSTM, 3/8-16         |
| 2        | BOLT, BONDING 3/8-16 SQ HEAD |
| 3        | NUT, BONDING STEP            |

### BONDING HARDWARE


| Part Number  | Description                   |
|--------------|-------------------------------|
| BHW-TB-02-A1 | T-BOLT, BONDING HARDWARE      |
| BHW-SQ-02-A1 | SQUARE-BOLT, BONDING HARDWARE |

1) BOLT, T CSTM, 3/8-16

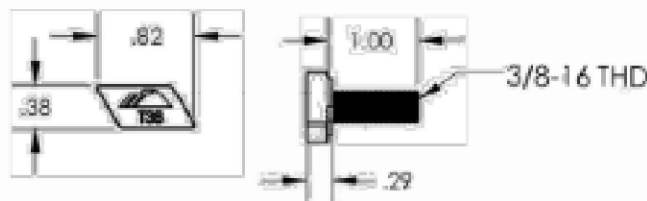

| Property | Value                      |
|----------|----------------------------|
| Material | 300 Series Stainless Steel |
| Finish   | Clear                      |

2) BOLT, BONDING 3/8-16 SQ HEAD

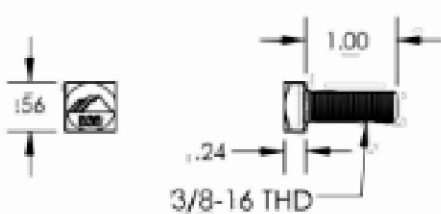

| Property | Value                      |
|----------|----------------------------|
| Material | 300 Series Stainless Steel |
| Finish   | Clear                      |

3) NUT, BONDING STEP



| Property | Value                      |
|----------|----------------------------|
| Material | 300 Series Stainless Steel |
| Finish   | Clear                      |

v1.00

|                         |                          |
|-------------------------|--------------------------|
| CUSTOMER LAST NAME:     | ADKINS                   |
| ADDRESS:                | 4410 SW AMETHYST DR      |
| CITY:                   | LEES SUMMIT              |
| STATE:                  | MO                       |
| ZIP:                    | 64082                    |
| JURISDICTION:           | Aberdeen                 |
| UTILITY COMPANY:        | EVERGY                   |
| SYSTEM SIZE:            | 6.8 KW (E-1)             |
| ( 17 ) URE -            | FBM400MFG-BB (CS-1)      |
| ( 1 ) SOLAREGE -        | SE5000H-US000BNU4 (CS-2) |
| ( 17 ) SOLAREGE -       | S440 (CS-3)              |
| ROOF TYPE:              | COMP SHINGLE (PV-2)      |
| PREFABRICATED TRUSSES,  | 2X4 @ 24" (PV-2)         |
| INTERCONNECTION METHOD: | PV BREAKER               |


DESIGNED BY: DA

DESIGNED ON

9/6/2022

EQUIPMENT

EQ-5

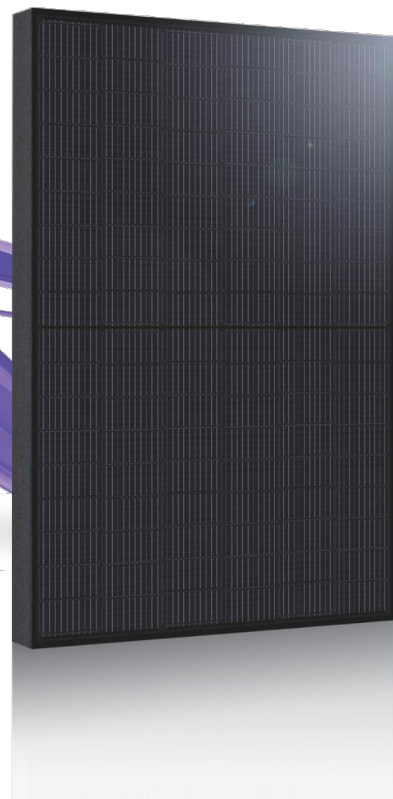

FBM\_MFG-BB / 108 cells  
390W - 405 W  
Mono-Crystalline PV Module

URE modules use URE's state-of-the-art cell cutting technology, and advanced module manufacturing experience.



## Key Features

+ Publicly Traded Taiwanese Company. Formed as the merger of four Cell and Module Manufacturers in 2018. All four founding companies (Neo Solar Power, Gintech, Solartech, NDF) were in existence since 2008 or earlier.

+ Over 400MW Of Projects Installed in the United States.

+ 25 Year Output Warranty and 25 Year Product Guarantee

+ Winner of Taiwan Excellence Award 7 Consecutive Years for Highest Efficiency Module.

+ Super All Black Design for High Profile Residential and Commercial Installations.

+ High Quality Solar Cell Technology allows URE to be major international exporter to Solar Module manufacturers in the United States and Europe.



For more information, please visit us at [www.urecorp.com](http://www.urecorp.com)  
Copyright © 2021 URE Corp. All rights reserved



## Electrical Data

| Model - STC                 |     | FBM390MFG-BB | FBM395MFG-BB | FBM400MFG-BB | FBM405MFG-BB |
|-----------------------------|-----|--------------|--------------|--------------|--------------|
| Maximum Rating Power (Pmax) | [W] | 390          | 395          | 400          | 405          |
| Module Efficiency           | [%] | 19.98        | 20.23        | 20.49        | 20.75        |
| Open Circuit Voltage (Voc)  | [V] | 36.84        | 37.03        | 37.20        | 37.36        |
| Maximum Power Voltage       | [V] | 30.82        | 31.00        | 31.17        | 31.36        |
| Short Circuit Current (Isc) | [A] | 13.50        | 13.59        | 13.68        | 13.78        |
| Maximum Power Current       | [A] | 12.66        | 12.75        | 12.84        | 12.92        |

\*Standard Test Condition (STC): Cell Temperature 25 °C, Irradiance 1000 W/m<sup>2</sup>, AM 1.5  
\*Values without tolerance are typical numbers. Measurement tolerance: ± 3%

## Mechanical Data

| Item                  | Specification                                                                                                                                             |
|-----------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------|
| Dimensions            | 1723 mm (L) <sup>1</sup> x 1133 mm (W) <sup>1</sup> x 35 mm (D) <sup>2</sup> / 67.83" (L) <sup>1</sup> x 44.61" (W) <sup>1</sup> x 1.38" (D) <sup>2</sup> |
| Weight                | 21.7 kg / 47.84 lbs                                                                                                                                       |
| Solar Cell            | 12x9 pieces monocrystalline solar cells series strings                                                                                                    |
| Front Glass           | White toughened safety glass, 3.2mm thickness                                                                                                             |
| Cell Encapsulation    | EVA (Ethylene-Vinyl-Acetate)                                                                                                                              |
| Frame                 | Black anodized aluminum profile                                                                                                                           |
| Junction Box          | IP68, 3 diodes                                                                                                                                            |
| Cable & Connector     | Potrait : 500 mm (cable length can be customized), 1 x 4 mm <sup>2</sup> compatible with MC4                                                              |
| Package Configuration | 31 pcs Per Pallet, 806 pcs per 40' HQ container                                                                                                           |

<sup>1</sup> : With assembly tolerance of ± 2 mm [ ± 0.08" ]  
<sup>2</sup> : With assembly tolerance of ± 0.8 mm [ ± 0.03" ]

## Operating Conditions


| Item                   | Specification |
|------------------------|---------------|
| Mechanical Load        | 5400 Pa       |
| Maximum System Voltage | 1000V         |
| Series Fuse Rating     | 30 A          |
| Operating Temperature  | -40 to 85 °C  |

## Temperature Characteristics


| Item                                 | Specification |
|--------------------------------------|---------------|
| Nominal Module Operating Temperature | 45°C ± 2°C    |
| Temperature Coefficient of Isc       | 0.048 % / °C  |
| Temperature Coefficient of Voc       | -0.27 % / °C  |
| Temperature Coefficient of Pmax      | -0.32 % / °C  |

\*Nominal module operating temperature (NMOT): Air mass AM 1.5, irradiance 800W/m<sup>2</sup>, temperature 20°C, windspeed 1 m/s.  
\*Reduction in efficiency from 1000W/m<sup>2</sup> to 200W/m<sup>2</sup> at 25°C: 3.5 ± 2%.


## Engineering Drawing (mm)

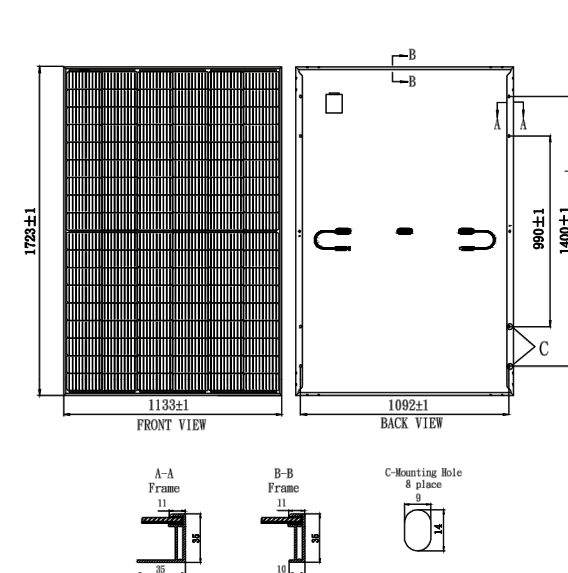

## Dependence on Irradiance

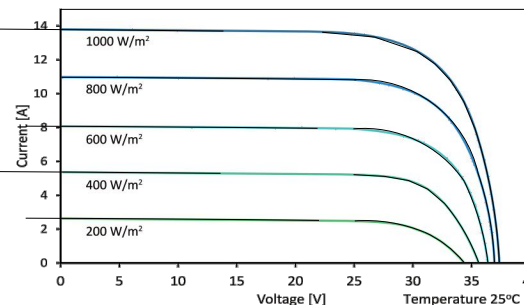

## Reliability with Warranty

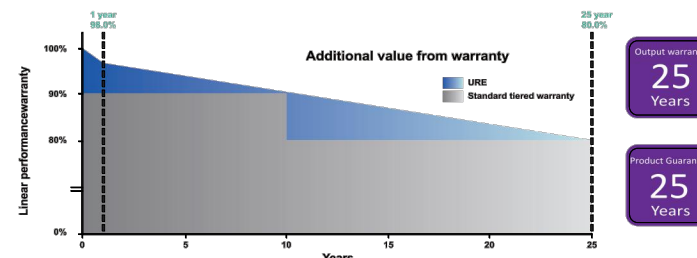

United Renewable Energy Co., Ltd.  
Copyright © 2021 URE Corp. All rights reserved



For more information, please visit us at [www.urecorp.com](http://www.urecorp.com)  
Copyright © 2021 URE Corp. All rights reserved



RELEASE FOR CONSTRUCTION  
AS NOTED FOR PLAN REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
09/20/2022

ADDRESS: 2578 W 600 N  
SUITE 100 LONDON, UT 84042  
PHONE: 866-736-1253

|                            |                                  |                                           |                               |                                |                                         |                                    |
|----------------------------|----------------------------------|-------------------------------------------|-------------------------------|--------------------------------|-----------------------------------------|------------------------------------|
| SYSTEM SIZE: 6.8 KW (E-1)  | ( 17 ) URE - FBM400MFG-BB (CS-1) | ( 1 ) SOLAREGE - SE5000H-US000BNU4 (CS-2) | ( 17 ) SOLAREGE - S440 (CS-3) | ROOF TYPE: COMP SHINGLE (PV-2) | PREFABRICATED TRUSSES, 2X4 @ 24" (PV-2) | INTERCONNECTION METHOD: PV BREAKER |
| CUSTOMER LAST NAME: ADKINS | ADDRESS: 4410 SW AMETHYST DR     | CITY: LEES SUMMIT                         | STATE: MO                     | ZIP: 64082                     | JURISDICTION: Aberdeen                  | UTILITY COMPANY: EVERGY            |

DESIGNED BY: DA

DESIGNED ON

9/6/2022

MODULE

CS-1

# Power Optimizer For Residential Installations

S440, S500



POWER OPTIMIZER

## Enabling PV power optimization at the module level

- Specifically designed to work with SolarEdge residential inverters
- Mitigates all types of module mismatch loss, from manufacturing tolerance to partial shading
- Detects abnormal PV connector behavior, preventing potential safety issues\*
- Faster installations with simplified cable management and easy assembly using a single bolt
- Module-level voltage shutdown for installer and firefighter safety
- Flexible system design for maximum space utilization
- Superior efficiency (99.5%)
- Compatible with bifacial PV modules

\* Functionality subject to inverter model and firmware version

[solaredge.com](https://solaredge.com)




## Power Optimizer For Residential Installations S440, S500

|                                                                                    | S440                                                               | S500 | UNIT    |
|------------------------------------------------------------------------------------|--------------------------------------------------------------------|------|---------|
|                                                                                    |                                                                    |      |         |
| Rated Input DC Power <sup>®</sup>                                                  | 440                                                                | 500  | W       |
| Absolute Maximum Input Voltage (Voc)                                               | 60                                                                 |      | Vdc     |
| MPPT Operating Range                                                               | 8 - 60                                                             |      | Vdc     |
| Maximum Short Circuit Current (Isc) of Connected PV Module                         | 14.5                                                               | 15   | Adc     |
| Maximum Efficiency                                                                 | 99.5                                                               |      | %       |
| Weighted Efficiency                                                                | 98.6                                                               |      | %       |
| Overvoltage Category                                                               | II                                                                 |      |         |
| OUTPUT DURING OPERATION                                                            |                                                                    |      |         |
| Maximum Output Current                                                             | 15                                                                 |      | Adc     |
| Maximum Output Voltage                                                             | 60                                                                 |      | Vdc     |
| OUTPUT DURING STANDBY (POWER OPTIMIZER DISCONNECTED FROM INVERTER OR INVERTER OFF) |                                                                    |      |         |
| Safety Output Voltage per Power Optimizer                                          | 1                                                                  |      | Vdc     |
| STANDARD COMPLIANCE                                                                |                                                                    |      |         |
| EMC                                                                                | FCC Part 15 Class B, IEC61000-6-2, IEC61000-6-3, CISPR11, EN-55011 |      |         |
| Safety                                                                             | IEC62109-1 (class II safety), UL1741                               |      |         |
| Material                                                                           | UL94 V-0, UV Resistant                                             |      |         |
| RoHS                                                                               | Yes                                                                |      |         |
| Fire Safety                                                                        | VDE-AR-E 2100-712:2013-05                                          |      |         |
| INSTALLATION SPECIFICATIONS                                                        |                                                                    |      |         |
| Maximum Allowed System Voltage                                                     | 1000                                                               |      | Vdc     |
| Dimensions (W x L x H)                                                             | 129 x 155 x 30                                                     |      | mm      |
| Weight (including cables)                                                          | 655 / 1.5                                                          |      | gr / lb |
| Input Connector                                                                    | MC4 <sup>(2)</sup>                                                 |      |         |
| Input Wire Length                                                                  | 0.1                                                                |      | m       |
| Output Connector                                                                   | MC4                                                                |      |         |
| Output Wire Length                                                                 | (+) 2.3, (-) 0.10                                                  |      | m       |
| Operating Temperature Range <sup>®</sup>                                           | -40 to +85                                                         |      | °C      |
| Protection Rating                                                                  | IP68 / NEMA6P                                                      |      |         |
| Relative Humidity                                                                  | 0 - 100                                                            |      | %       |

(1) Rated power of the module at STC will not exceed the Power Optimizer Rated Input DC Power. Modules with up to +5% power tolerance are allowed  
(2) For other connector types please contact SolarEdge  
(3) For ambient temperature above +70°C / +158°F power de-rating is applied. Refer to [Power Optimizers Temperature De-Rating Technical Note](#) for more details

| PV System Design Using a SolarEdge Inverter           |            | Single Phase HD-Wave | Three Phase          | Three Phase for 277/480V Grid |   |
|-------------------------------------------------------|------------|----------------------|----------------------|-------------------------------|---|
| Minimum String Length (Power Optimizers)              | S440, S500 | 8                    | 16                   | 18                            |   |
| Maximum String Length (Power Optimizers)              |            | 25                   | 50                   |                               |   |
| Maximum Nominal Power per String <sup>(4)</sup>       |            | 5700                 | 11250 <sup>(5)</sup> | 12750 <sup>(6)</sup>          | W |
| Parallel Strings of Different Lengths or Orientations |            | Yes                  |                      |                               |   |

(4) If the inverters rated AC power  $\leq$  maximum nominal power per string, then the maximum power per string will be able to reach up to the inverters maximum input DC power. Refer to: <https://www.solaredge.com/sites/default/files/se-power-optimizer-single-string-design-application-note.pdf>  
(5) For the 230/400V grid: it is allowed to install up to 13,500W per string when the maximum power difference between each string is 2,000W  
(6) For the 277/480V grid: it is allowed to install up to 15,000W per string when the maximum power difference between each string is 2,000W  
(7) It is not allowed to mix S-series and P-series Power Optimizers in new installations

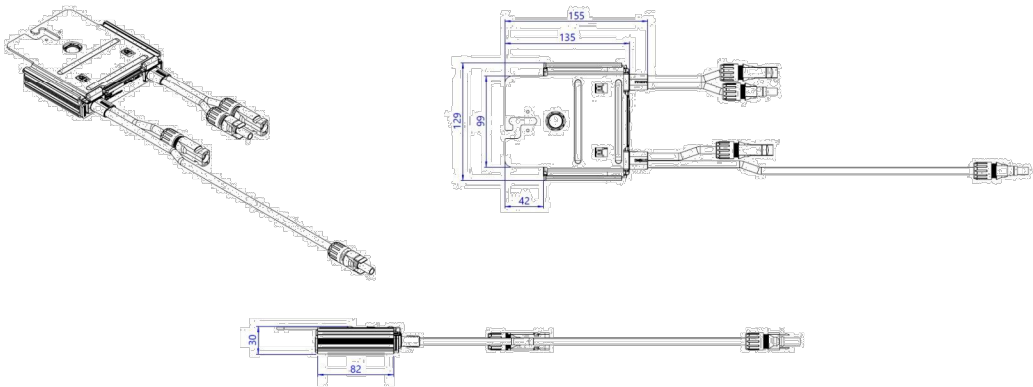

© SolarEdge Technologies, Inc. All rights reserved. SOLAREGE, the SolarEdge logo, OPTIMIZED BY SOLAREGE are trademarks or registered trademarks of SolarEdge Technologies, Inc. All other trademarks mentioned herein are trademarks of their respective owners. Date: 12/2021 DS-000091-1.2-ENG. Subject to change without notice.

CE RoHS

RELEASE FOR CONSTRUCTION  
AS NOTED FOR PLAN REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
09/20/2022

ADDRESS: 2578 W 600 N  
SUITE 100 LINDON, UT 84042  
PHONE: 866-736-1253

|                     |                     |                                           |
|---------------------|---------------------|-------------------------------------------|
| CUSTOMER LAST NAME: | ADKINS              | SYSTEM SIZE: 6.8 KW (E-1)                 |
| ADDRESS:            | 4410 SW AMETHYST DR | ( 17 ) URE - FBM400MFG-BB (CS-1)          |
| CITY:               | LEES SUMMIT         | ( 1 ) SOLAREGE - SE5000H-US000BNU4 (CS-2) |
| STATE:              | MO                  | ( 17 ) SOLAREGE - S440 (CS-3)             |
| ZIP:                | 64082               | ROOF TYPE: COMP SHINGLE (PV-2)            |
| JURISDICTION:       | Aberdeen            | PREFABRICATED TRUSSES, 2X4 @ 24" (PV-2)   |
| UTILITY COMPANY:    | EVERGY              | INTERCONNECTION METHOD: PV BREAKER        |

DESIGNED BY: DA

DESIGNED ON

9/6/2022

OPTIMIZER

CS-2

# Single Phase Inverter with HD-Wave Technology for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US



12-25  
YEAR  
WARRANTY

INVERTERS

## Optimized installation with HD-Wave technology

- Specifically designed to work with power optimizers
- Record-breaking 99% weighted efficiency
- Quick and easy inverter commissioning directly from a smartphone using the SolarEdge SetApp
- Fixed voltage inverter for longer strings
- Integrated arc fault protection and rapid shutdown for NEC 2014, NEC 2017 and NEC 2020 per article 690.11 and 690.12
- UL1741 SA certified, for CPUC Rule 21 grid compliance
- Small, lightweight, and easy to install both outdoors or indoors
- Built-in module-level monitoring
- Optional: Faster installations with built-in consumption metering (1% accuracy) and production revenue grade metering (0.5% accuracy, ANSI C12.20)

solaredge.com



## Single Phase Inverter with HD-Wave Technology for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

| MODEL NUMBER                                                              | SE3000H-US                      | SE3800H-US                 | SE5000H-US | SE6000H-US                 | SE7600H-US | SE10000H-US | SE11400H-US                  |     |
|---------------------------------------------------------------------------|---------------------------------|----------------------------|------------|----------------------------|------------|-------------|------------------------------|-----|
| APPLICABLE TO INVERTERS WITH PART NUMBER                                  | SEXXXXH-XXXXXBXX4               |                            |            |                            |            |             |                              |     |
| OUTPUT                                                                    |                                 |                            |            |                            |            |             |                              |     |
| Rated AC Power Output                                                     | 3000                            | 3800 @ 240V<br>3300 @ 208V | 5000       | 6000 @ 240V<br>5000 @ 208V | 7600       | 10000       | 11400 @ 240V<br>10000 @ 208V | VA  |
| Maximum AC Power Output                                                   | 3000                            | 3800 @ 240V<br>3300 @ 208V | 5000       | 6000 @ 240V<br>5000 @ 208V | 7600       | 10000       | 11400 @ 240V<br>10000 @ 208V | VA  |
| AC Output Voltage Min.-Nom.-Max.<br>(211 - 240 - 264)                     | ✓                               | ✓                          | ✓          | ✓                          | ✓          | ✓           | ✓                            | Vac |
| AC Output Voltage Min.-Nom.-Max.<br>(183 - 208 - 229)                     | -                               | ✓                          | -          | ✓                          | -          | -           | ✓                            | Vac |
| AC Frequency (Nominal)                                                    | 59.3 - 60 - 60.5 <sup>(1)</sup> |                            |            |                            |            |             |                              | Hz  |
| Maximum Continuous Output Current @240V                                   | 12.5                            | 16                         | 21         | 25                         | 32         | 42          | 47.5                         | A   |
| Maximum Continuous Output Current @208V                                   | -                               | 16                         | -          | 24                         | -          | -           | 48.5                         | A   |
| Power Factor                                                              | 1, Adjustable - 0.85 to 0.85    |                            |            |                            |            |             |                              |     |
| GFDI Threshold                                                            | 1                               |                            |            |                            |            |             |                              | A   |
| Utility Monitoring, Islanding Protection, Country Configurable Thresholds | Yes                             |                            |            |                            |            |             |                              |     |
| INPUT                                                                     |                                 |                            |            |                            |            |             |                              |     |
| Maximum DC Power @240V                                                    | 4650                            | 5900                       | 7750       | 9300                       | 11800      | 15500       | 17650                        | W   |
| Maximum DC Power @208V                                                    | -                               | 5100                       | -          | 7750                       | -          | -           | 15500                        | W   |
| Transformer-less, Ungrounded                                              | Yes                             |                            |            |                            |            |             |                              |     |
| Maximum Input Voltage                                                     | 480                             |                            |            |                            |            |             |                              | Vdc |
| Nominal DC Input Voltage                                                  | 380                             |                            |            |                            | 400        |             |                              | Vdc |
| Maximum Input Current @240V <sup>(2)</sup>                                | 8.5                             | 10.5                       | 13.5       | 16.5                       | 20         | 27          | 30.5                         | Adc |
| Maximum Input Current @208V <sup>(2)</sup>                                | -                               | 9                          | -          | 13.5                       | -          | -           | 27                           | Adc |
| Max. Input Short Circuit Current                                          | 45                              |                            |            |                            |            |             |                              | Adc |
| Reverse-Polarity Protection                                               | Yes                             |                            |            |                            |            |             |                              |     |
| Ground-Fault Isolation Detection                                          | 600ka Sensitivity               |                            |            |                            |            |             |                              |     |
| Maximum Inverter Efficiency                                               | 99                              | 99.2                       |            |                            |            |             |                              | %   |
| CEC Weighted Efficiency                                                   | 99                              |                            |            |                            |            |             | 99 @ 240V<br>98.5 @ 208V     | %   |
| Nighttime Power Consumption                                               | < 2.5                           |                            |            |                            |            |             |                              | W   |

(1) For other regional settings please contact SolarEdge support.  
(2) A higher current source may be used; the inverter will limit its input current to the values stated


## Single Phase Inverter with HD-Wave Technology for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

| MODEL NUMBER                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                             | SE3000H-US                                                                                | SE3800H-US  | SE5000H-US | SE6000H-US  | SE7600H-US                          | SE10000H-US | SE11400H-US |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------|-------------|------------|-------------|-------------------------------------|-------------|-------------|
| ADDITIONAL FEATURES                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                      |                                                                                           |             |            |             |                                     |             |             |
| Supported Communication Interfaces                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       | RS485, Ethernet, ZigBee (optional), Cellular (optional)                                   |             |            |             |                                     |             |             |
| Revenue Grade Metering, ANSI C12.20                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                      | Optional <sup>(3)</sup>                                                                   |             |            |             |                                     |             |             |
| Consumption metering                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     | Optional <sup>(3)</sup>                                                                   |             |            |             |                                     |             |             |
| Inverter Commissioning                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                   | With the SetApp mobile application using Built-in Wi-Fi Access Point for Local Connection |             |            |             |                                     |             |             |
| Rapid Shutdown - NEC 2014, NEC 2017 and NEC 2020, 690.12                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 | Automatic Rapid Shutdown upon AC Grid Disconnect                                          |             |            |             |                                     |             |             |
| STANDARD COMPLIANCE                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                      |                                                                                           |             |            |             |                                     |             |             |
| Safety                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                   | UL1741, UL1741 SA, UL1699B, CSA C22.2, Canadian AFCI according to T.L.L. M-07             |             |            |             |                                     |             |             |
| Grid Connection Standards                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                | IEEE1547, Rule 21, Rule 14 (H)                                                            |             |            |             |                                     |             |             |
| Emissions                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                | FCC Part 15 Class B                                                                       |             |            |             |                                     |             |             |
| INSTALLATION SPECIFICATIONS                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                              |                                                                                           |             |            |             |                                     |             |             |
| AC Output Conduit Size / AWG Range                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       | 1" Maximum / 14-6 AWG                                                                     |             |            |             | 1" Maximum /14-4 AWG                |             |             |
| DC Input Conduit Size / # of Strings / AWG Range                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         | 1" Maximum / 1-2 strings / 14-6 AWG                                                       |             |            |             | 1" Maximum / 1-3 strings / 14-6 AWG |             |             |
| Dimensions with Safety Switch (hXwXd)                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    | 17.7 x 14.6 x 6.8 / 450 x 370 x 174                                                       |             |            |             | 21.3 x 14.6 x 7.3 / 540 x 370 x 185 |             |             |
| Weight with Safety Switch                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                | 22 / 10                                                                                   | 25.1 / 11.4 |            | 26.2 / 11.9 |                                     | 38.8 / 17.6 |             |
| Noise                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    | < 25                                                                                      |             |            |             | <50                                 |             |             |
| Cooling                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  | Natural Convection                                                                        |             |            |             |                                     |             |             |
| Operating Temperature Range                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                              | -40 to +140 / -40 to +60 <sup>(4)</sup>                                                   |             |            |             |                                     |             |             |
| Protection Rating                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        | NEMA 4X (Inverter with Safety Switch)                                                     |             |            |             |                                     |             |             |
| (3) Inverter with Revenue Grade Meter P/N: SExxxxH-US000BNC4; Inverter with Revenue Grade Production and Consumption Meter P/N: SExxxxH-US000BNI4. For consumption metering, current transformers should be ordered separately: SEAC10750-200NA-20 or SEAC10750-400NA-20, 20 units per box.<br>(4) Full power up to at least 50°C / 122°F; for power de-rating information refer to: <a href="https://www.solaredge.com/sites/default/files/se-temperature-de-rating-note-na.pdf">https://www.solaredge.com/sites/default/files/se-temperature-de-rating-note-na.pdf</a> |                                                                                           |             |            |             |                                     |             |             |

## How to Enable Consumption Monitoring

By simply wiring current transformers through the inverter's existing AC conduits and connecting them to the service panel, homeowners will gain full insight into their household energy usage helping them to avoid high electricity bills

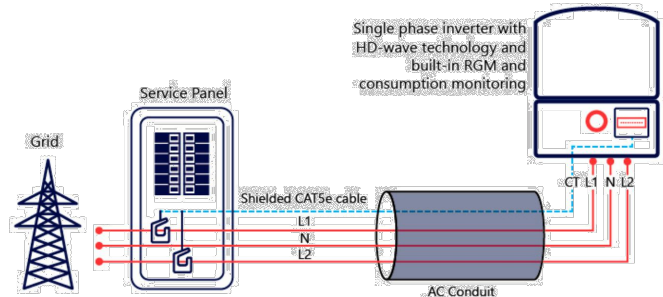

© SolarEdge Technologies, Inc. All rights reserved. SOLAREEDGE, the SolarEdge logo, OPTIMIZED BY SOLAREEDGE are trademarks or registered trademarks of SolarEdge Technologies, Inc. All other trademarks mentioned herein are trademarks of their respective owners. Date: 12/2020/01/ENG NAM. Subject to change without notice.

RoHS

RELEASE FOR CONSTRUCTION  
AS NOTED FOR PLAN REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
09/20/2022  
ADDRESS: 2578 W 600 N  
SUITE 100 LINDON, UT 84042  
PHONE: 866-736-1253

|                     |                              |                                             |  |              |             |
|---------------------|------------------------------|---------------------------------------------|--|--------------|-------------|
| CUSTOMER LAST NAME: | ADKINS                       | SYSTEM SIZE: 6.8 KW (E-1)                   |  | DESIGNED BY: | DA          |
|                     | ADDRESS: 4410 SW AMETHYST DR | ( 17 ) URE - FBM400MFG-BB (CS-1)            |  |              | DESIGNED ON |
| CITY:               | LEES SUMMIT                  | ( 1 ) SOLAREEDGE - SE5000H-US000BNU4 (CS-2) |  |              | 9/6/2022    |
| STATE:              | MO                           | ( 17 ) SOLAREEDGE - S440 (CS-3)             |  |              | INVERTER    |
| ZIP:                | 64082                        | ROOF TYPE: COMP SHINGLE (PV-2)              |  |              |             |
| JURISDICTION:       | Aberdeen                     | PREFABRICATED TRUSSES, 2X4 @ 24" (PV-2)     |  |              | CS-3        |
| UTILITY COMPANY:    | EVERGY                       | INTERCONNECTION METHOD: PV BREAKER          |  |              |             |

|                     |                     |                                            |
|---------------------|---------------------|--------------------------------------------|
| CUSTOMER LAST NAME: | ADKINS              | SYSTEM SIZE: 6.8 KW (E-1)                  |
| ADDRESS:            | 4410 SW AMETHYST DR | ( 17 ) URE - FBM400MFG-BB (CS-1)           |
| CITY:               | LEES SUMMIT         | ( 1 ) SOLAREdge - SE5000H-US000BNU4 (CS-2) |
| STATE:              | MO                  | ( 17 ) SOLAREdge - S440 (CS-3)             |
| ZIP:                | 64082               | ROOF TYPE: COMP SHINGLE (PV-2)             |
| JURISDICTION:       | Aberdeen            | PREFABRICATED TRUSSES, 2X4 @ 24" (PV-2)    |
| UTILITY COMPANY:    | EVERGY              | INTERCONNECTION METHOD: PV BREAKER         |

|              |          |
|--------------|----------|
| DESIGNED BY: | DA       |
| DESIGNED ON  | 9/6/2022 |

|         |
|---------|
| PLACARD |
|---------|


|      |
|------|
| PL-1 |
|------|

CAUTION



MULTIPLE SOURCES OF POWER


- LEGEND:
- UTILITY METER
  - MSP = MAIN SERVICE PANEL
  - AC DISCONNECT
  - INVERTER

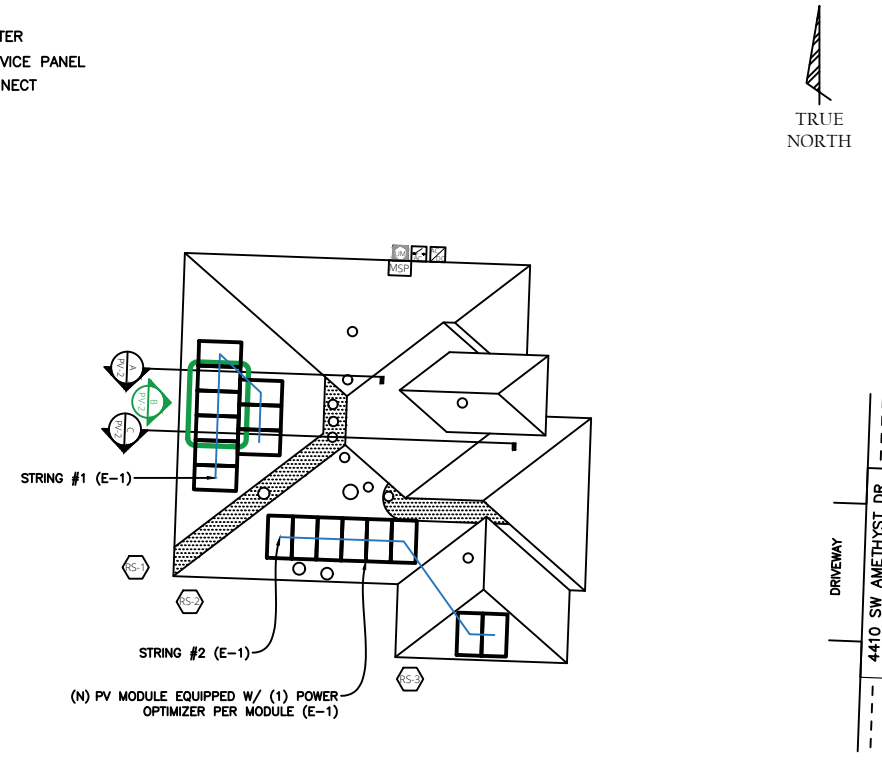

HATCHED AREA WILL PROVIDE A  
3' FIRECODE PATHWAY  
TO COMPLY WITH IFC 605.11.3.2.1


2020 NEC  
LABEL (FOR FIELD USE ONLY)

CAUTION



POWER TO THIS BUILDING IS ALSO SUPPLIED FROM THE  
FOLLOWING SOURCES WITH DISCONNECTS LOCATED AS SHOWN

- LEGEND:
- UTILITY METER
  - MSP = MAIN SERVICE PANEL
  - AC DISCONNECT
  - INVERTER

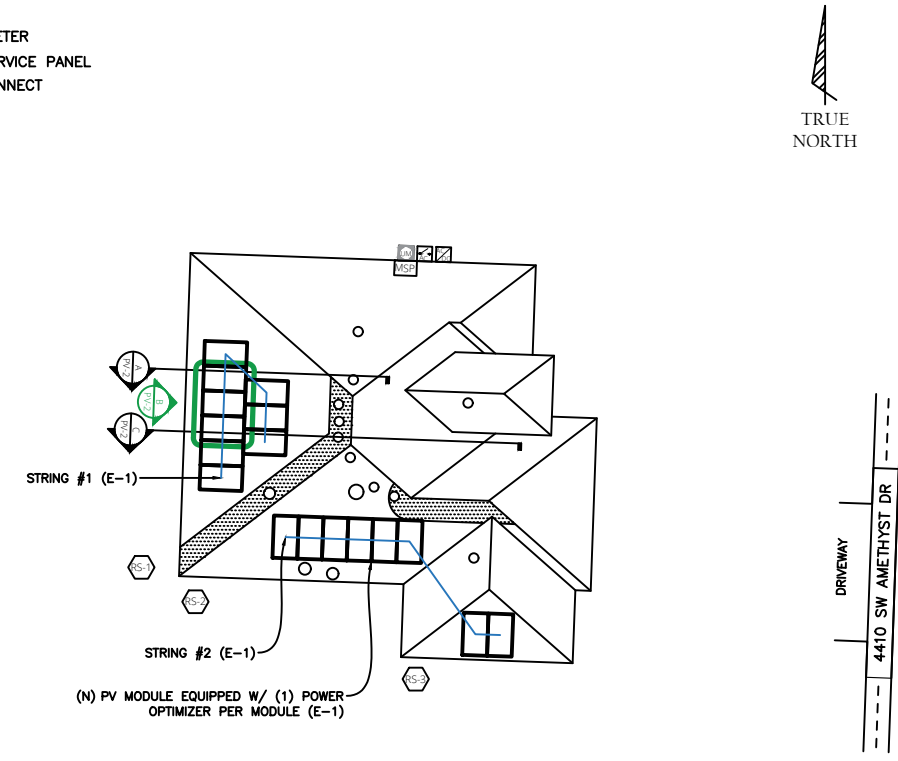

HATCHED AREA WILL PROVIDE A  
3' FIRECODE PATHWAY  
TO COMPLY WITH IFC 605.11.3.2.1

2017 NEC  
LABEL (FOR FIELD USE ONLY)