



- ALTERNATES LIST:
- 1) Paint ALL exterior of existing metal panel and CMU on Building D and Building E  
Base Bid: existing finish to remain.
  - 2) Replace existing Robotics space general lighting in Building D with efficient LED  
Base Bid: existing lighting to remain.
  - 3) Replace existing weight room, new weight room, and new GiC space general lighting in Building E with efficient LED.  
Base Bid: existing lighting to remain.
  - 4) Exclude exterior canopy scope at GiC space North of Building E.  
Base Bid: as documented in Construction Documents.



# LSR7 Robotics, GiC & Phys Education: Construction Documents

owner:  
Lee's Summit R-7 School District  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4200 Pennsylvania Avenue  
Kansas City, MO 64111  
816.931.6655  
www.multi.studio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com

MEPFT/Code::  
Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

structural engineer:  
Bob D. Campbell & Company,  
4338 Belleview  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

LSN: 901 NE Douglas St.,  
Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd,  
Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy,  
Lee's Summit MO 64063  
Project Number: 0121-0100  
Issue Date: September 9, 2022

**multistudio**  
the evolution of gould evans












NOTE: BUILDING D PLUMBING COUNTS ARE EXISTING NON-CONFORMING. BUILDINGS OCCUPANT LOAD PRIOR TO THE ADDITION IS 2690CC. AFTER THE ADDITION, THE BUILDING OCCUPANT LOAD IS INCREASED BY 12% TO 3050CC. PER IBC 2018, SECTION 809.1, INCREASE IN THE EXISTING BUILDING OCCUPANT LOAD LESS THAN 20% DOES NOT REQUIRE A CHANGE IN THE QUANTITIES OF PLUMB FIXTURES. THE ADDITION TO THE EXISTING CONDITIONS (NON-CONFORMITY) SHALL COMPLY WITH IBC 2018, SECTION 1101. PER OF LEVEL 2 ALTERATIONS THERE ARE NO ADDITIONAL PLUMBING FIXTURES REQUIRED AS ALTERATIONS + ADDITION INCREASED THE BUILDING OCCUPANCY BY LESS THAN 20%.

[illegible]

Occupant Load Schedule - Full LSHS Building E					
Occupancy	Number	Name	Area	Occupant Load Factor	Occupant Load
E					
E	E100	Restroom	51 SF	0 SF	
E	E101	GiC	1,979 SF	50 SF	37
E	E102	Weights 2	1,953 SF	50 SF	39
E	E104	Elec	62 SF	300 SF	0
E	E105	A/V Closet	87 SF	300 SF	1
E	E106	Storage	177 SF	300 SF	1
E	E107	Wrestling	4,171 SF	50 SF	80
E	E109	Uniforms / Laundry	380 SF	50 SF	2
E	E110	Mechanical	254 SF	300 SF	1
E	E111	Weights 1	3,442 SF	50 SF	71
E	E112	Football Locker Room	1,226 SF	50 SF	25
E	E113	Men's Restroom	301 SF	0 SF	0
E	E115	Vestibule	49 SF	0 SF	0
E	E116	Men's Athletic Locker Room	542 SF	50 SF	11
E	E119	Coaches RR	81 SF	0 SF	0
E	E122	Head Coach	194 SF		2
E	E123	Coaches Storage	56 SF	300 SF	1
E	E124	Locker Room Vestibule	65 SF	0 SF	0
E	E125	Women's Locker Room	350 SF	50 SF	10
E	E126	Women's Showers	139 SF	0 SF	0
			15,560 SF		281

Path of Travel - Building E		
Mark	Path of Egress (200' Max)	Common Path (75' Max)
PATH D	60'	35'
PATH E	89'	67'

MEPFT/Code: :  
**Henderson Engineers**  
 834S Lenexa Drive, Suite  
 300  
 Lenexa, KS 66214  
 816.742.5000  
[www.hendersonengineers.com](http://www.hendersonengineers.com)

NUMBER	DESCRIPTION	DATE
1	Addendum 01	09/19/2022
2	Addendum 02	09/23/2022

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS  
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR  
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



# G101-C







Lee's Summit Robotics,  
Gic & Phys Educaiton

LSN: 901 NE Douglas St., Lee's Summit MO  
64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO  
64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0321-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multistudio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com

structural engineer:  
Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEPFI/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

COORDINATE TABLE			
◇	NORTHING	EASTING	DESCRIPTION
1000	997998.91	2826705.12	SAW CUT
1001	997998.41	2826717.66	SAW CUT
1002	997841.78	2826826.96	SAW CUT
1003	997833.29	2826820.69	SAW CUT
1004	997864.51	2826857.35	EC
1005	997865.89	2826890.18	EC
1006	997879.16	2826872.43	EC
1007	997879.33	2826876.53	EC
1008	997879.67	2826884.52	EC
1009	997879.88	2826889.60	EC
1010	997916.86	2826869.98	EC
1011	997917.07	2826874.95	EC
1012	997917.40	2826882.94	EC
1013	997917.62	2826888.01	EC
1014	997865.64	2826884.19	SW
1015	997848.49	2826884.91	SW
1016	997848.74	2826890.90	SW
1017	997801.87	2826913.91	EA
1018	997793.66	2826945.83	EA
1019	997821.21	2826890.98	R30.0
1020	997822.11	2826920.97	EA
1021	997833.78	2826920.48	EA
1022	997812.98	2826972.67	EA
1023	997835.73	2826971.72	EA
1024	997835.31	2826961.73	EA
1025	997872.80	2826970.16	EC
1026	997872.38	2826960.17	EC
1028	997834.35	2826962.77	BOLLARD
1029	997848.60	2826966.03	BOLLARD
1030	997849.30	2826961.14	SW
1031	997849.51	2826966.13	SW
1032	997860.50	2826965.67	SW
1033	997860.29	2826960.68	SW
1034	998035.02	2826983.13	EC
1035	998059.97	2826982.08	EC
1036	998061.97	2827029.72	EC
1037	998037.02	2827030.77	EC

HORIZONTAL AND VERTICAL DATUM:

UNLESS OTHERWISE NOTED THE COORDINATES SHOWN HEREON ARE GRID COORDINATES  
BASED ON THE MISSOURI STATE PLANE, WEST ZONE (NAD 1983) (NAD 1988)  
CAF: 0.9998978  
1 METER = 3.28083333 U.S. SURVEY FEET  
GROUND COORDINATES X COMBINED ADJUSTMENT FACTOR (CAF) = GRID COORDINATES  
SCALED AROUND 0.0

JA-25 (PID-095025)

NORTHING: 303646.030 (GRID/METERS) 996212.016 (GROUND/FEET)  
EASTING: 860950.475 (GRID/METERS) 2824635.014 (GROUND/FEET)  
ELEV = 321.8 (METERS) 1055.77 (FEET)

PROJECT BENCH MARK:

BM-64  
CHISELED SQUARE AT THE TOP NORTHEAST CORNER OF STEPS TO THE NORTH  
ENTRY TO BUILDING "B" ON WEST SIDE.  
ELEV = 1015.34

BM-65  
CHISELED SQUARE ON NORTHEAST CORNER CONCRETE TRANSFORMERS PAD  
WEST OF PARKING LOT NORTH OF TENNIS COURTS.  
ELEV = 1021.13

BM-66  
CHISELED SQUARE ON NORTHEAST CORNER CONCRETE TRANSFORMERS PAD  
(NORTH MOST) BETWEEN BUILDINGS "D" AND "E".  
ELEV = 1015.69

UTILITY STATEMENT:

THE UNDERGROUND UTILITIES SHOWN HEREON ARE FROM FIELD SURVEY INFORMATION OF ONE-CALL LOCATED  
UTILITIES, FIELD SURVEY INFORMATION OF ABOVE GROUND OBSERVABLE EVIDENCE, AND/OR THE SCALING AND  
PLOTING OF EXISTING UTILITY MAPS AND DRAWINGS AVAILABLE TO THE SURVEYOR AT THE TIME OF SURVEY.  
THE SURVEYOR MAKES NO GUARANTEE THAT THE UNDERGROUND UTILITIES SHOWN COMPRISE ALL SUCH UTILITIES  
IN THE AREA, EITHER IN SERVICE OR ABANDONED. FURTHERMORE, THE SURVEYOR DOES NOT WARRANT THAT THE  
UNDERGROUND UTILITIES SHOWN ARE IN THE EXACT LOCATION INDICATED ALTHOUGH HE DOES CERTIFY THAT THEY  
ARE LOCATED AS ACCURATELY AS POSSIBLE FROM INFORMATION AVAILABLE. THE SURVEYOR HAS NOT  
PHYSICALLY LOCATED THE UNDERGROUND UTILITIES BY EXCAVATION UNLESS OTHERWISE NOTED ON THIS SURVEY.  
MISSOURI ONE CALL TICKET #221653482 & #222143061  
BLOOD HOUND WORK ORDER #202977

PROJECT CONTROL:

CP #208  
1/2" REBAR W/ CONTROL POINT CAP  
NORTHING: 997985.92 (GROUND)  
EASTING: 2826567.03 (GROUND)  
ELEV = 1012.56

CP #211

1/2" REBAR W/ CONTROL POINT CAP  
NORTHING: 998086.62 (GROUND)  
EASTING: 2826963.98 (GROUND)  
ELEV = 1014.61

CP #220

1/2" REBAR W/ CONTROL POINT CAP  
NORTHING: 997737.04 (GROUND)  
EASTING: 2826986.56 (GROUND)  
ELEV = 1024.94

Issue Date: September 9, 2022

Revisions

NUMBER	DESCRIPTION	DATE
--------	-------------	------

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS  
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR  
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION




Kaw Valley Engineering, Inc.  
Missouri Certificate of Authority: 000842  
Christian Crowder Date: 9/9/2022  
Engineer License No. PE-2015000538

DIMENSION PLAN

C105-C



PROJ. NO. C20-0496-1DSN: CJC  
CFN: 0496-1DIM DWN: NUN  
ENGINEER  
MO # 2015000538  
14700 WEST 114TH TERRACE  
LENEXA, KANSAS 66215  
PH. (913) 894-5150 | FAX (913) 894-5977  
kveng.com | www.kveng.com  
KAW VALLEY ENGINEERING  
KAW VALLEY ENGINEERING, INC., IS AUTHORIZED TO OFFER  
ENGINEERING SERVICES BY MISSOURI STATE CERTIFICATE OF  
AUTHORITY # 000842. EXPIRES 12/31/23

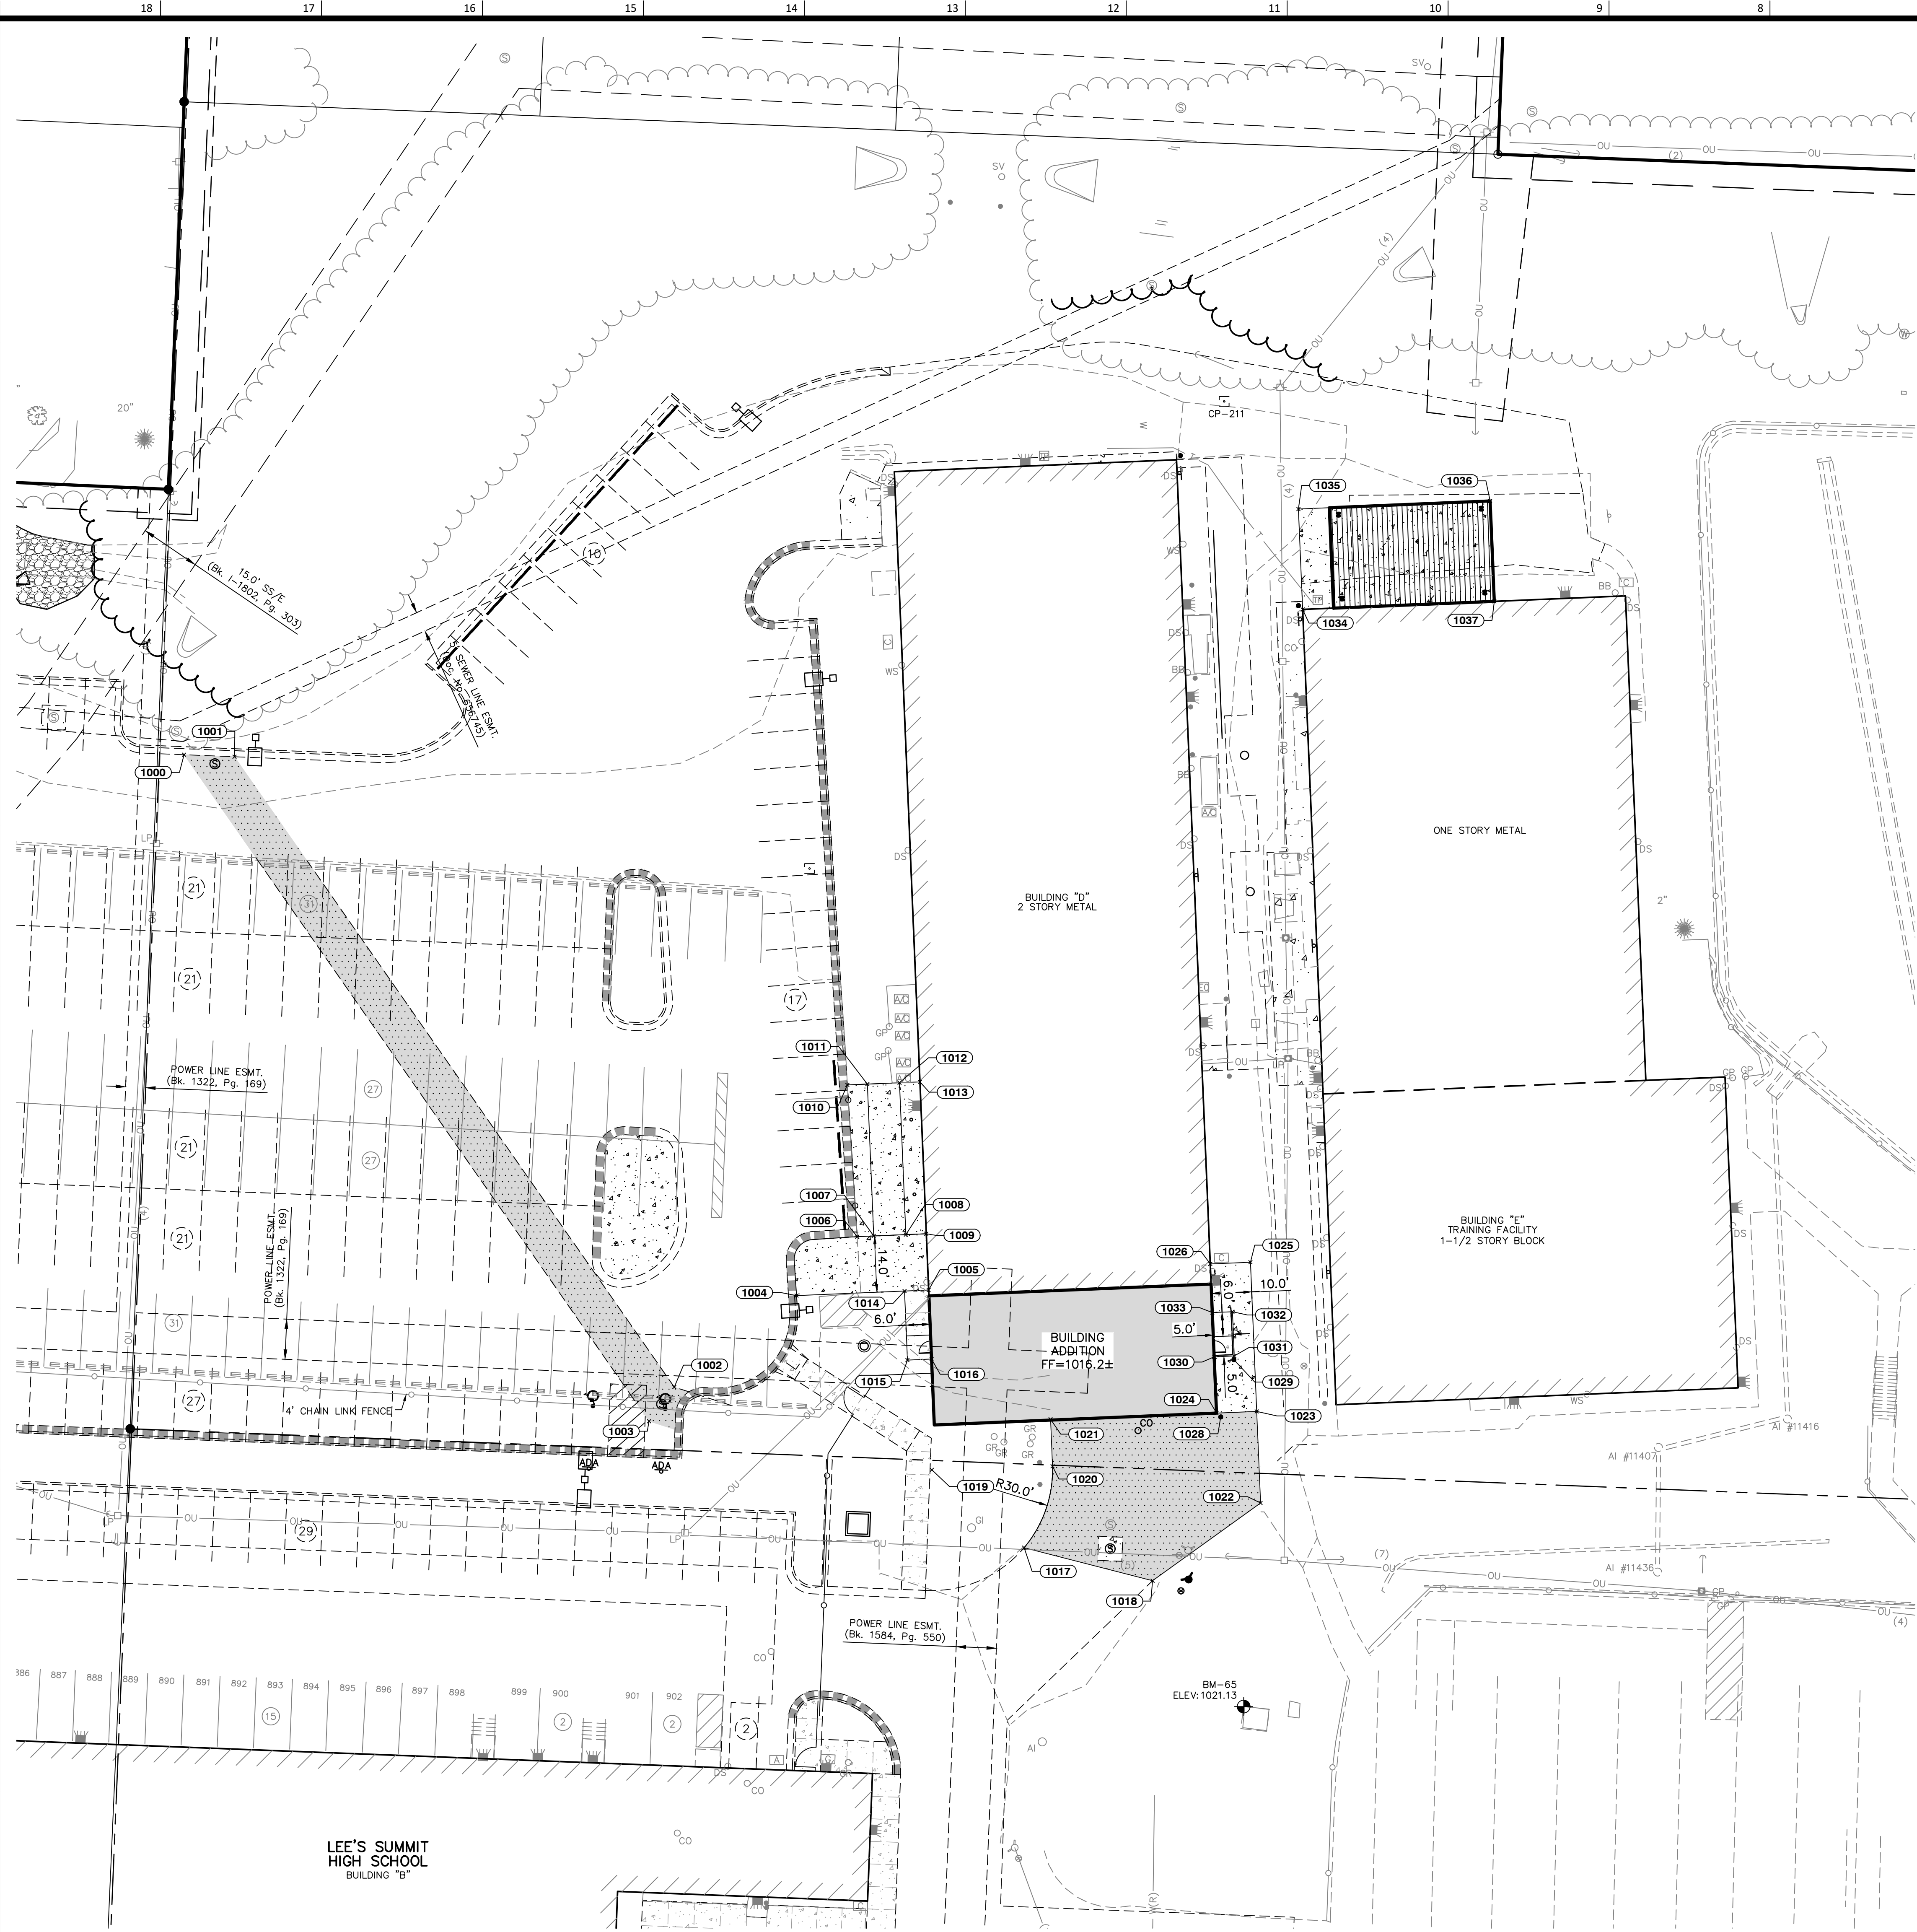


**SAFETY NOTICE TO CONTRACTOR**  
IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, THE CONTRACTOR WILL BE SOLELY  
AND COMPLETELY RESPONSIBLE FOR CONDITIONS OF THE JOB SITE, INCLUDING SAFETY OF ALL PERSONS AND  
PROPERTY DURING PERFORMANCE OF THE WORK. THIS REQUIREMENT WILL APPLY CONTINUOUSLY AND NOT BE  
LIMITED TO NORMAL WORKING HOURS.

**WARRANTY / DISCLAIMER**  
THE DESIGNS REPRESENTED IN THESE PLANS ARE IN ACCORDANCE WITH ESTABLISHED PRACTICES OF CIVIL  
ENGINEERING FOR THE DESIGN FUNCTIONS AND USES INTENDED BY THE OWNER AT THIS TIME. HOWEVER,  
NEITHER KAW VALLEY ENGINEERING, INC NOR ITS PERSONNEL CAN OR DO WARRANTY THESE DESIGNS OR  
PLANS AS CONSTRUCTED, EXCEPT IN THE SPECIFIC CASES WHERE KAW VALLEY ENGINEERING PERSONNEL  
INSPECT AND CONTROL THE PHYSICAL CONSTRUCTION ON A CONTINUOUS BASIS AT THE SITE.

**CAUTION - NOTICE TO CONTRACTOR**  
THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING  
UTILITIES AS SHOWN ON THESE PLANS IS BASED ON RECORDS OF THE VARIOUS UTILITY COMPANIES AND,  
WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THE INFORMATION IS NOT TO BE RELIED ON AS  
BEING EXACT OR COMPLETE. THE CONTRACTOR MUST CALL THE APPROPRIATE UTILITY COMPANY AT LEAST  
72 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATION OF UTILITIES. IT SHALL BE THE  
RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH PROPOSED  
IMPROVEMENTS SHOWN ON THE PLANS.  
THE CONTRACTOR SHALL EXPOSE EXISTING UTILITIES AT LOCATIONS OF POSSIBLE CONFLICTS PRIOR TO ANY  
CONSTRUCTION.

LEGEND:	
	AIR CONDITIONER
	WALL MOUNTED ELECTRICAL OUTLET
	UNDERGROUD GAS
	GAS METER
	CONTROL POINT
	BENCHMARK
	GATE POST
	CHAIN LINK FENCE
	WOOD FENCE
	BOLLARD
	STREET/TRAFFIC SIGN
	PAINTED DIRECTIONAL ARROW
	TURN LANE DIRECTION
	HANDICAP SYMBOL
	PARKING STALL COUNT
	HANDICAP SIGN
	HANDICAP RAMP
	WHEEL STOP
	DUCTILE IRON PIPE
	HIGH DENSITY POLYETHYLENE
	WALL MOUNTED LIGHT
	WALL MOUNTED CAMERA
	GAS VALVE
	GAS RISER
	GAS LINE SIGN
	DOOR ELEVATION
	AT THRESHOLD
	FINISH FLOOR ELEVATION
	BUILDING HEIGHT/ELEVATION
	BACK TO BACK OF CURB MEASUREMENT
	EDGE TO EDGE OF ASPHALT
	WATER METER
	WATER LINE GATE VALVE
	FIRE HYDRANT
	SPRINKLER CONTROL BOX
	WATER MANHOLE
	OVERHEAD UTILITY LINE (# OF LINES)
	PULL BOX
	LIGHT POLE
	UTILITY POLE
	UTILITY POLE W/ LIGHT
	UTILITY POLE W/ TRANSFORMER
	GUY ANCHOR
	CONIFEROUS TREE
	FLAG POLE
	ELECTRIC METER
	UNDERGROUD ELECTRIC PEDESTAL
	SPEAKER BOX
	BREAKER BOX
	TELEPHONE PEDESTAL
	SANITARY SEWER MANHOLE
	STORM SEWER MANHOLE
	AREA INLET
	CURB INLET
	SANITARY SEWER CLEAN OUT
	DOWN SPOUT
	FLOOR DRAIN
	FLARED END SECTION
	SPRINKLER VALVE
	SIAMESE FIRE CONNECTOR
	CANOPY SUPPORT
	MAIL BOX
	CONCRETE JOINT/OUT LINE
	BUSH
	DECIDUOUS TREE
	TRASH ENCLOSURE
	LANDSCAPING AREA
	CONCRETE
	LOWEST WIRE HEIGHT
	ASPHALT EDGE TREATMENT. SEE SECTION ON G190
	ASPHALT OVERLAY (040)
	AREAS OF FULL DEPTH ASPHALT (040)
	TURF
	CONCRETE PAVEMENT (042) W/JOINTING
	CONCRETE SIDEWALK (055+005) W/JOINTING
	JOINT (TYP)
	JOINT TYPE
	LANDING
	RAMP
	TRANSITION
	PROJECT AREA (LIMITS OF DISTURBANCE)

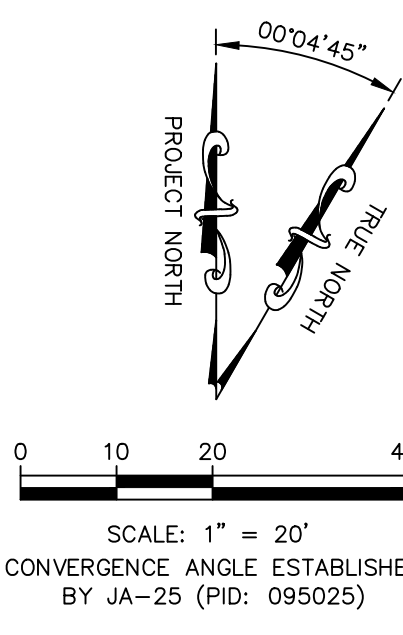



Lee's Summit Robotics,  
Gic & Phys Educaiton

LSN: 901 NE Douglas St., Lee's Summit MO  
64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO  
64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100

owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086  
architect: Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816-931.6655  
multi-studio

civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com  
structural engineer: Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEPFI/Code: Henderson Engineers  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

ASPHALT NOTES:


PAVING SHALL BE IN ACCORDANCE WITH THE KANSAS CITY METROPOLITAN CHAPTER OF APWA SECTION 2200 AS AMENDED BELOW.

MILLING FOR THE DRIVES AND PARKING LOTS SHALL BE COLD MILLED AS FOLLOWS:

- EQUIPMENT: MILLING THE SURFACE OF PAVEMENTS SHALL BE COMPLETED BY USE OF A MILLING MACHINE CONFORMING TO THE FOLLOWING.
  - MACHINE: THE COLD MILLING MACHINE SHALL BE SELF-PROPELLED AND SHALL HAVE IN COMBINATION THE MEANS OF MILLING AND CUTTING, WITHOUT SOFTENING THE OLD SURFACE AND BLADING THE CUTTING INTO A SINGLE WINDROW, OR DEPOSITING THEM DIRECTLY INTO A TRUCK.
  - AIR POLLUTION: THE MACHINE SHALL BE EQUIPPED WITH A DUST SUPPRESSION SYSTEM INCLUDING WATER STORAGE TANKS AND HIGH PRESSURE SPRAY BARS.
  - OPERATING WIDTH: IT IS DESIRABLE THAT THE CUTTING WIDTH BE GREATER THAN 1 FEET (0.3 m). IN THE EVENT THE CUTTING WIDTH IS LESS THAN 1 FEET (0.3 m) CONTRACTOR IS RESPONSIBLE FOR ENSURING GRADE CONTROL AS NOTED ON PLANS.
  - CUTTING DRUM: THE CUTTING DRUM SHALL BE TOTALLY ENCLOSED TO PREVENT DISCHARGE OF ANY LOOSESED MATERIAL ADJACENT TO WORK AREAS.
- CONSTRUCTION DETAILS
  - METHODS OF OPERATIONS FOR MILLING:
    - OPERATOR: THE MILLING MACHINE SHALL BE OPERATED BY AN EXPERIENCED AND CAPABLE OPERATOR.
    - UTILITIES: STREET SURFACES ADJACENT TO MANHOLE, WATER VALVES AND OTHER UTILITY EXTENSIONS, SHALL BE COMPLETELY REMOVED TO THE FULL DEPTH THE CUT SPECIFIED FOR THE STREET UNLESS OTHERWISE SPECIFIED BY THE ENGINEER.
    - MATERIAL DISPOSAL: THE MATERIAL WITHDREW BY THE MACHINE SHALL BE REMOVED FROM THE SURFACE OF THE PAVEMENT AND PROPERLY DISPOSED OF BY THE CONTRACTOR.
    - SURFACE CONDITIONS: THE DRUM LACING PATTERNS SHALL PRODUCE A SMOOTH SURFACE AFTER MILLING WITH GROOVE DEPTHS NOT TO EXCEED 1/4 INCH (0.64 cm) AND GROOVE SPACING NOT TO EXCEED 1 INCH (2.54 cm) UNLESS OTHERWISE APPROVED BY THE ENGINEER.
  - TYPES OF CUTS TO BE MADE BY MILLING:
- LEVELING: SUFFICIENT PASSES SHALL BE MADE SUCH THAT ALL IRREGULARITIES OR HIGH SPOTS ARE ELIMINATED, AND THAT 100% OF THE SURFACE IS MILLED.
- AVERAGE DEPTH: SUFFICIENT PASSES, OR CUTS, SHALL BE MADE IN ORDER TO REMOVE A SPECIFIED DEPTH OVER THE ENTIRE STREET SECTION. THESE DEPTHS WILL BE DESIGNATED ON THE PLANS.
- CURB CUT: SUFFICIENT PASSES, OR CUTS, SHALL BE MADE IN ORDER TO REMOVE A SPECIFIED DEPTH AT THE CURB FOR A SPECIFIED WIDTH. THE DEPTH AT THE WIDTH FURTHEST FROM THE CURB IS 0. THESE DIMENSIONS WILL BE DESIGNATED ON THE PLANS.
- CLEANUP: ALL LOOSE ASPHALT AND DEBRIS SHALL BE REMOVED FROM THE STREET SURFACE AND CURB AND GUTTER. ANY MATERIAL AND DEBRIS THAT ADHERES TO THE CURB AND GUTTER SHALL BE REMOVED.

CRACKS: REFER TO CRACK SEALING/FILLING GUIDELINES.

- AREAS OF THE PAVEMENT REQUIRING PATCHING WILL BE DESIGNATED ON THE PLANS OR MARKED BY THE ENGINEER AFTER COMPLETION OF MILLING OPERATIONS FOR THE SECTION OF PAVEMENT UNDER CONSTRUCTION. THE DETERIORATED PAVEMENT WILL BE REMOVED TO THE LIMITS DESIGNATED BY THE ENGINEER. THE SUBGRADE SHALL BE ADJUSTED TO PERMIT THE THICKNESS OF ASPHALT INDICATED ON THE PLANS. THE SUBGRADE SHALL CONSIST OF MODOT TYPE 5 AGGREGATE AND SHALL BE UNIFORMLY COMPACTED BY HAND TAMPING OR ROLLING. BITUMINOUS MIX FOR PATCHING WILL MEET THE REQUIREMENTS FOR APWA TYPE 1 OR 2 ASPHALT CONCRETE AS SPECIFIED IN THE KANSAS CITY METROPOLITAN CHAPTER OF APWA SECTION 2200. AT THE TIME OF PLACING ASPHALT THE EDGE OF THE AREA TO BE PATCHED WILL BE COATED WITH SS-1H EMULSIFIED ASPHALT OR APPROVED EQUAL. THE ASPHALT IN THE PATCH SHALL BE PLACED IN TWO EQUAL LIFTS WITH EACH LIFT THOROUGHLY COMPACTED PRIOR TO PLACEMENT OF THE SUBSEQUENT LIFT.
- CONSTRUCTION OF THE 2 INCH OVERLAY WILL BE PERFORMED IN ACCORDANCE WITH THE KANSAS CITY METROPOLITAN CHAPTER OF APWA SECTION 2200 – ASPHALT CONCRETE SURFACE WITH THE FOLLOWING MODIFICATIONS:
- THE APWA TYPE 3 ASPHALT CONCRETE MIX MAY CONTAIN RECYCLED ASPHALT CONTENT. RECYCLED ASPHALT MIX DESIGN APWA TYPE 3 (FRAP) AND APWA TYPE 1 OR 2 (FRAP) (FOR FULL DEPTH PATCH) MUST BE A 50-BLOW MARSHALL MIX MEETING THE AGGREGATE, GRADATION, AND VOLUMETRIC DESIGN REQUIREMENTS FOR APWA TYPE 3 OR APWA TYPE 3 (FRAP) FOR SURFACE COURSE AND APWA TYPE 1 OR 2 OR APWA TYPE 1 OR 2 (FRAP) FOR BASE COURSES AS DEFINED BY THE KANSAS CITY METROPOLITAN CHAPTER OF APWA SECTION 2200, CURRENT EDITION. ANY SUBMITTED 50-BLOW MARSHALL MIX DESIGN MUST ALSO BE CHECKED FOR RESISTANCE TO STRIPPING DURING DESIGN USING AASHTO T-283 TO DETERMINE IF ANTISTRIPPING AGENT IS NEEDED FOR THE SAME ASPHALT CONCRETE CHOSEN FOR THE PROJECT. THE INDEX OF RETAINED STRENGTH SHALL EXCEED 80% ANY ASPHALT MIX SUPPLIED TO THE PROJECT DURING PLACEMENT WILL BE SUBJECT TO TESTING BY THE OWNERS REPRESENTATIVES USING THE AASHTO T-283 PROCEDURE FOR TENSILE STRENGTH RATIO.)
- MEASURED DENSITY OF THE COMPLETED OVERLAY SHALL HAVE A COMPACTED DENSITY OF 92% TO 97% OF THE DAILY THEORETICAL MAXIMUM SPECIFIC GRAVITY (GMM) OF THE APWA TYPE 3 MIX SUPPLIED TO THE PROJECT.
- AREAS OF THE PAVEMENT SURFACE ON THE DRIVES AND PARKING LOTS THAT ARE SHOWN TO HAVE SEGREGATION UPON COMPLETION OF FINAL ROLLING SHALL RECEIVE AN ADDITIONAL SURFACE TREATMENT TO CLOSE THE SURFACE VOIDS. THE SURFACE TREATMENT SHALL CONSIST OF MANUFACTURED SAND COATED WITH SS-1H EMULSION WORKED INTO THE SURFACE VOIDS TO YIELD A UNIFORM APPEARING SURFACE.

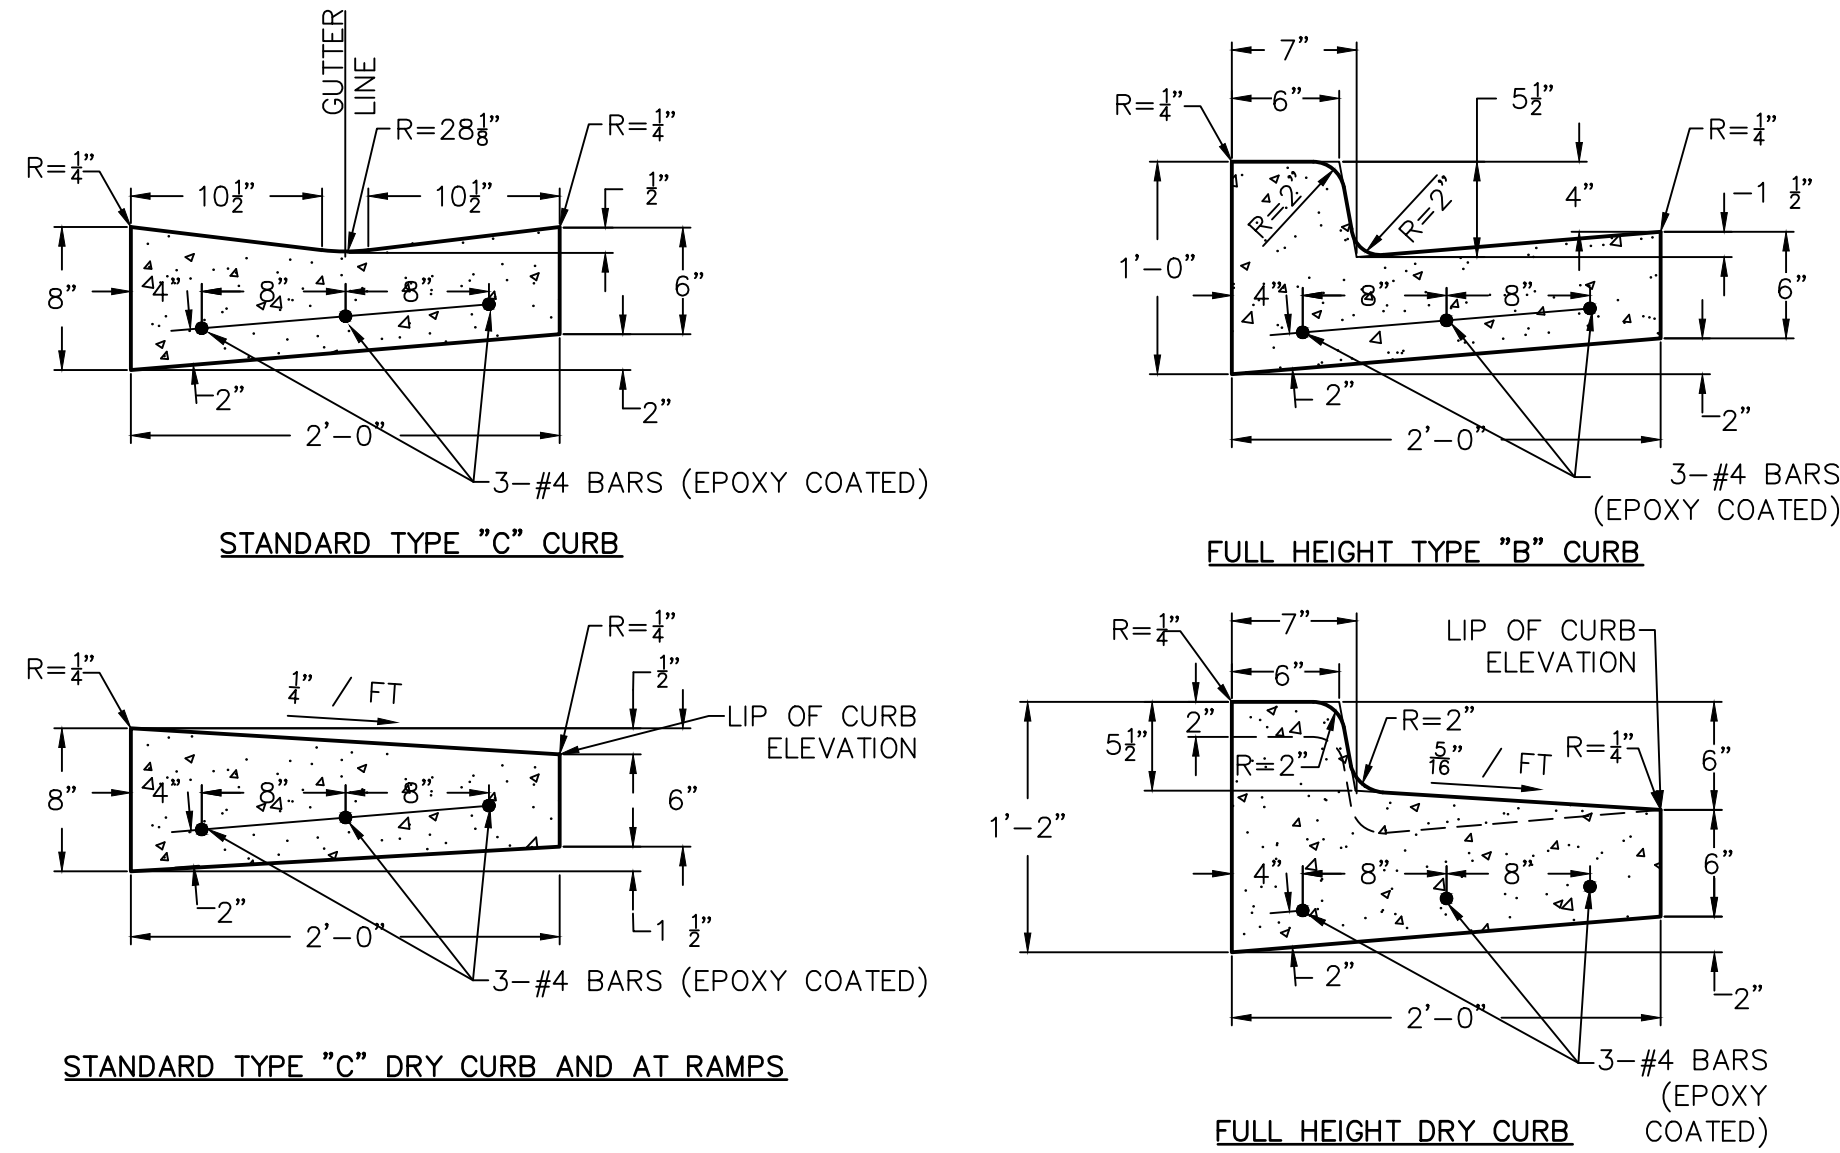

ZERO HEIGHT CURB 002


FULL HEIGHT CURB 001

CURB & GUTTER NOTES:


- 3" PREMOLDED EXPANSION JOINTS SHALL BE PLACED AT POINTS OF CURVATURE, CURB RETURNS, CURB INLETS AND AT 250' CENTERS. THE EXPANSION JOINTS SHALL BE DOWELED IN ACCORDANCE WITH THE SPECIFICATIONS. CONTRACTION JOINTS SHALL BE 2" DEEP AND PLACED AT 15' INTERVALS EQUALLY SPACED BETWEEN EXPANSION JOINTS.
- ALL CONCRETE USED IN THIS WORK SHALL MEET THE LATEST EDITION OF THE KANSAS CITY METROPOLITAN CHAPTER OF THE AMERICAN PUBLIC WORKS ASSOCIATION. KOMMB4K CONCRETE SHALL BE USED THROUGHOUT.
- ALL REINFORCING STEEL SHALL BE SUPPORTED ON FABRICATED STEEL BAR SUPPORTS @ 3'-0" MAXIMUM SPACING.
- SEE SIDEWALK RAMP DETAILS FOR TYPICAL SIDEWALK RAMP CURB & GUTTER SECTIONS.
- DETAILS AS SHOWN FOR CONCRETE AND ASPHALT PAVING. WHEN USED WITH CONCRETE PAVING POURED MONOLITHICALLY WITH CURB NO MODIFICATIONS ARE REQUIRED. WHEN CURB AND CONCRETE PAVING ARE TO BE POURED SEPARATELY #4 BARS, 24" LONG ARE TO BE PROVIDED TO TIE CURB TOGETHER WITH CONCRETE PAVING. PLACE AT 8" O.C.
- ALL REINFORCING SHALL BE 60 GRADE 60 DEFORMED BARS AND COMPLY WITH ASTM A615. EPOXY BARS AS NOTED, SHALL COMPLY WITH ASTM A775.
- CURBS TO BE CONSTRUCTED ON MINIMUM 6 INCHES OF COMPACTED WELL GRADED BASE ROCK.

CURB & GUTTER

N.T.S

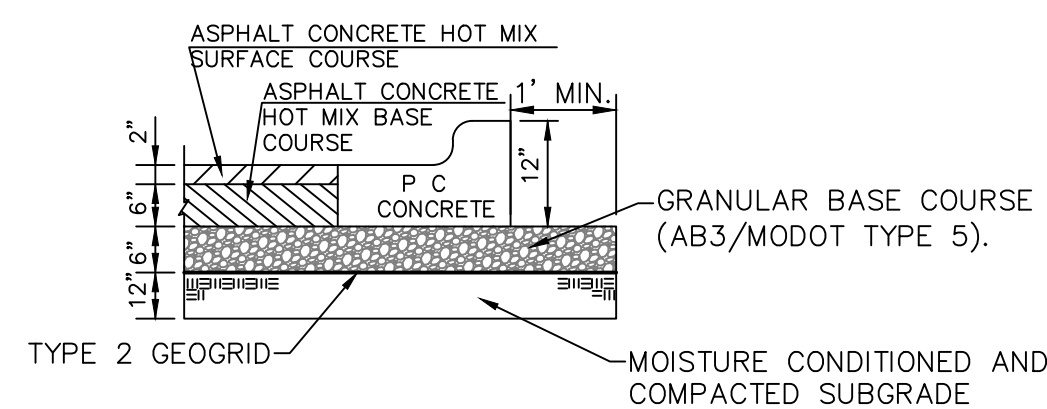


ASPHALT PAVEMENT 040

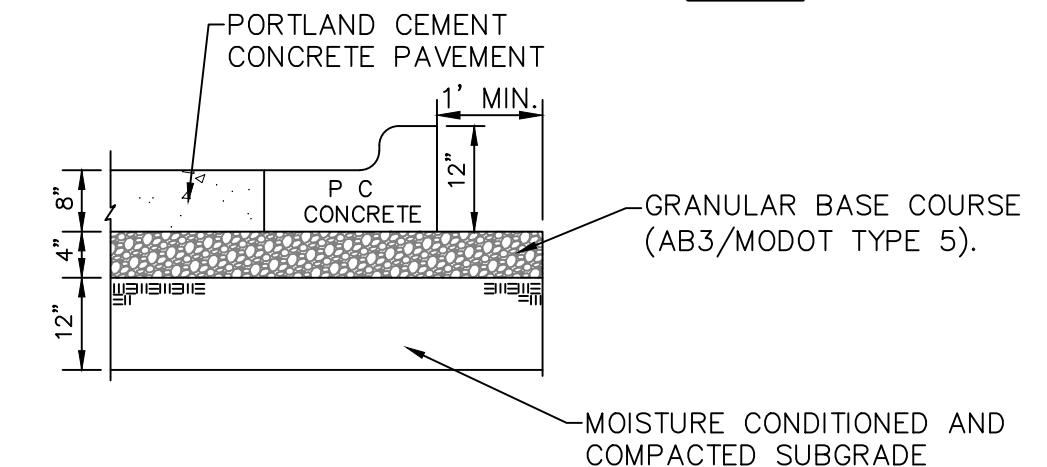

CONCRETE PAVEMENT 042


- FLEXIBLE PAVEMENT SHALL BE IN ACCORDANCE WITH THE LATEST (FEBRUARY 2017) EDITION OF THE KANSAS CITY METROPOLITAN CHAPTER OF APWA SECTION 2200 AS AMENDED BY PROJECT SPECIFICATIONS.

ASPHALT SURFACE COURSE – APWA TYPE 3-01  
ASPHALT BASE COURSE – APWA TYPE 2-01
- PORTLAND CEMENT CONCRETE FOR DRIVEWAYS SHALL BE A KOMMB4K MIX AND SHALL MEET THE LATEST EDITION OF THE KANSAS CITY METROPOLITAN CHAPTER OF APWA SECTION 2200.

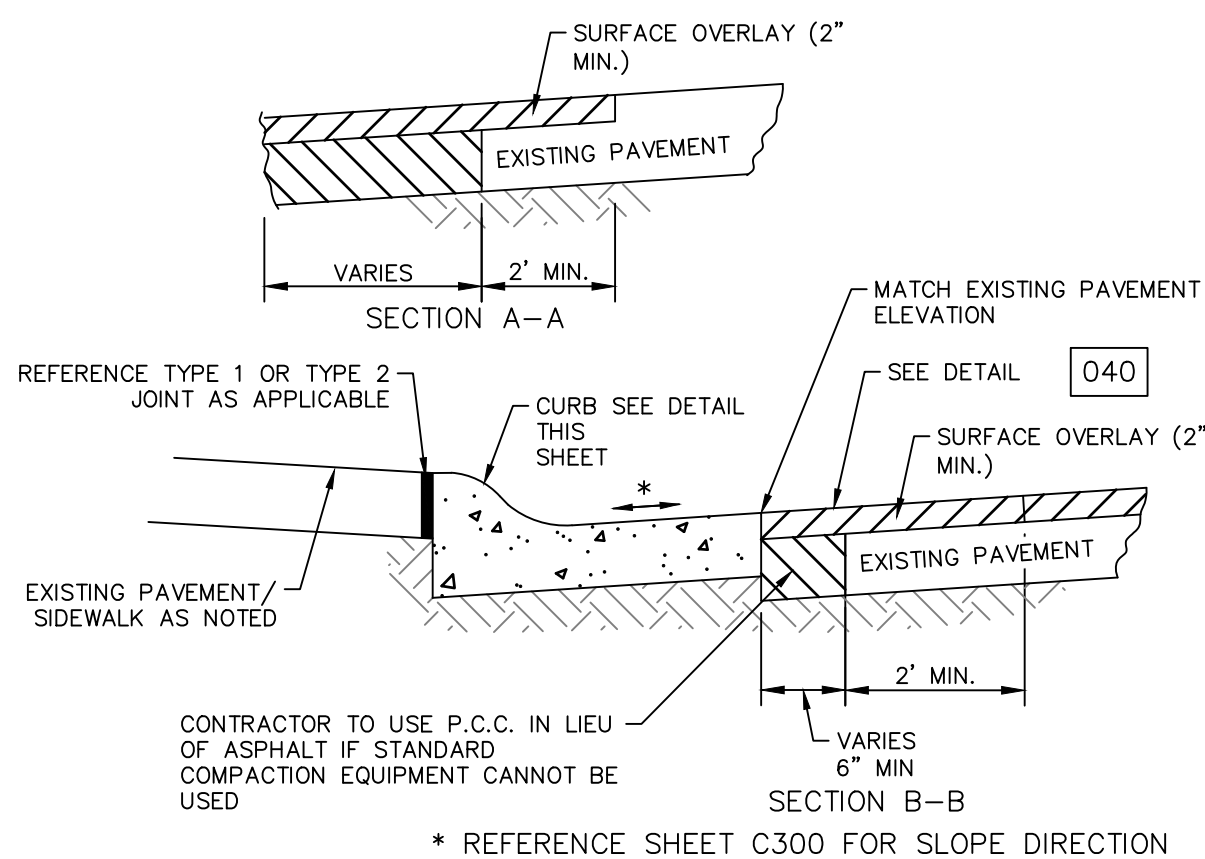

MILL AND OVERLAY DETAIL

INTEGRAL CURB AND SIDEWALK 005

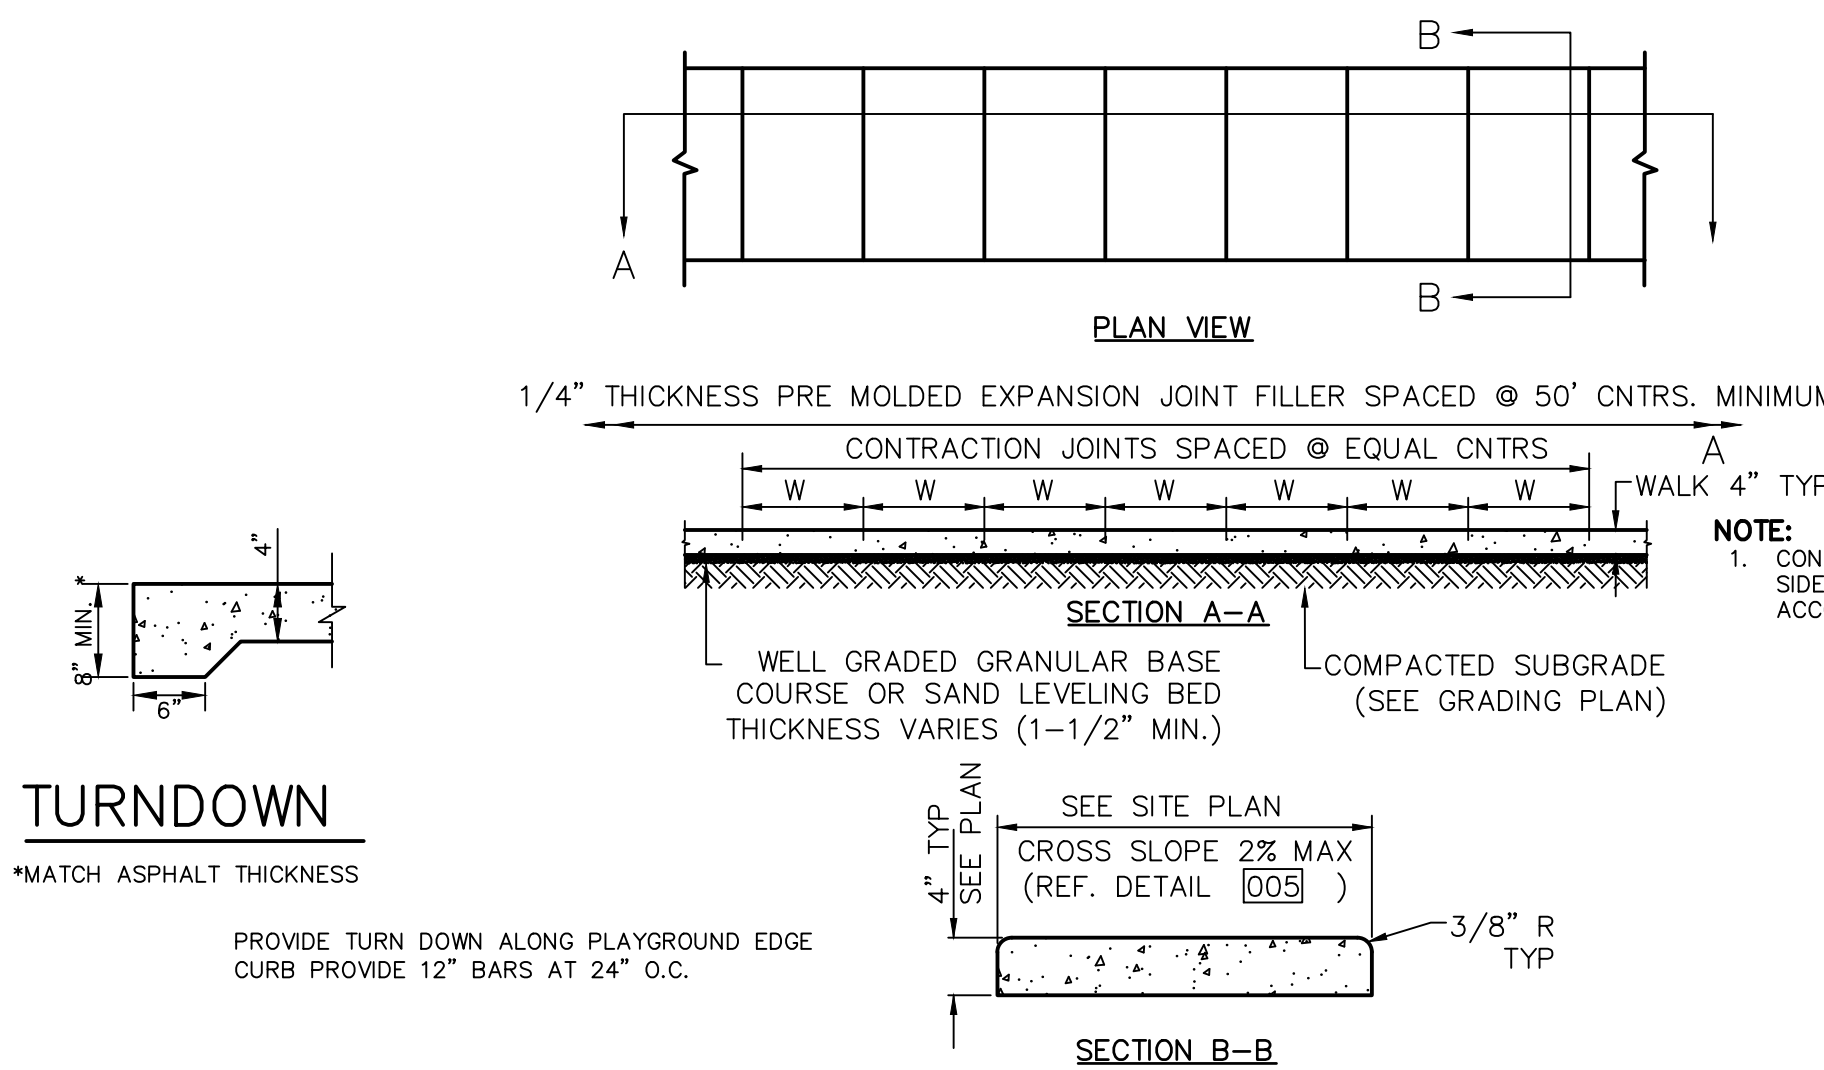

CONCRETE AND SIDEWALK NOTES:


- CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI AND COMPLY WITH KOMMB SPECIFICATIONS. ALL CONCRETE SHALL BE PLACED IN ACCORDANCE WITH APWA SECTION 2200.
- REINFORCING STEEL SHALL BE GRADE 60 AND COMPLY WITH ASTM A615. EPOXY COATED BARS AS NOTED SHALL COMPLY WITH ASTM A775. ALL CUT ENDS OR DAMAGED AREAS SHALL BE FIELD REPAIRED WITH EPOXY COATING.
- SIDEWALKS TO BE BROOM FINISHED.
- SUBGRADE TO BE COMPACTED TO 90% MAXIMUM DRY DENSITY AS DETERMINED BY ASTM D698. MOISTURE CONTENT TO BE WITHIN A RANGE OF 2% BELOW TO 2% ABOVE OPTIMUM MOISTURE AS DEFINED BY ASTM D698.
- SIDEWALK JOINTS MAY BE SAWN UNLESS OTHERWISE NOTED ON ARCHITECTURAL PLANS.

NOTE:  
1. CONTRACTOR SHALL BACKFILL SIDEWALKS WITH TOPSOIL AND SEED IN ACCORDANCE WITH NOTES ON PLANS.

Issue Date: September 9, 2022

NUMBER	DESCRIPTION	DATE
--------	-------------	------


UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

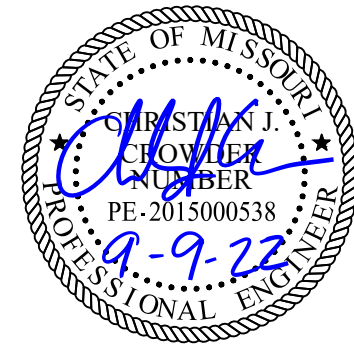


Kaw Valley Engineering, Inc.  
Missouri Certificate of Authority: 000842  
Christian Crowder Date: 9/9/2022  
Engineer License No. PE-2015000538

SITE DETAILS

C190-C

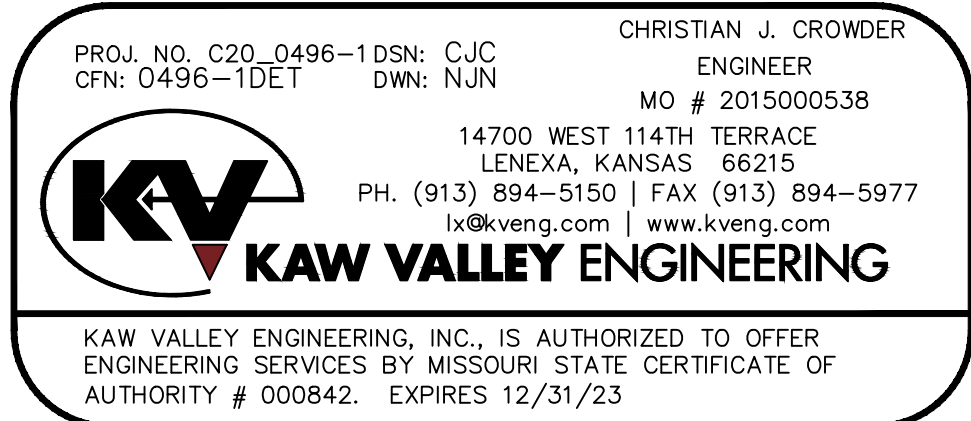



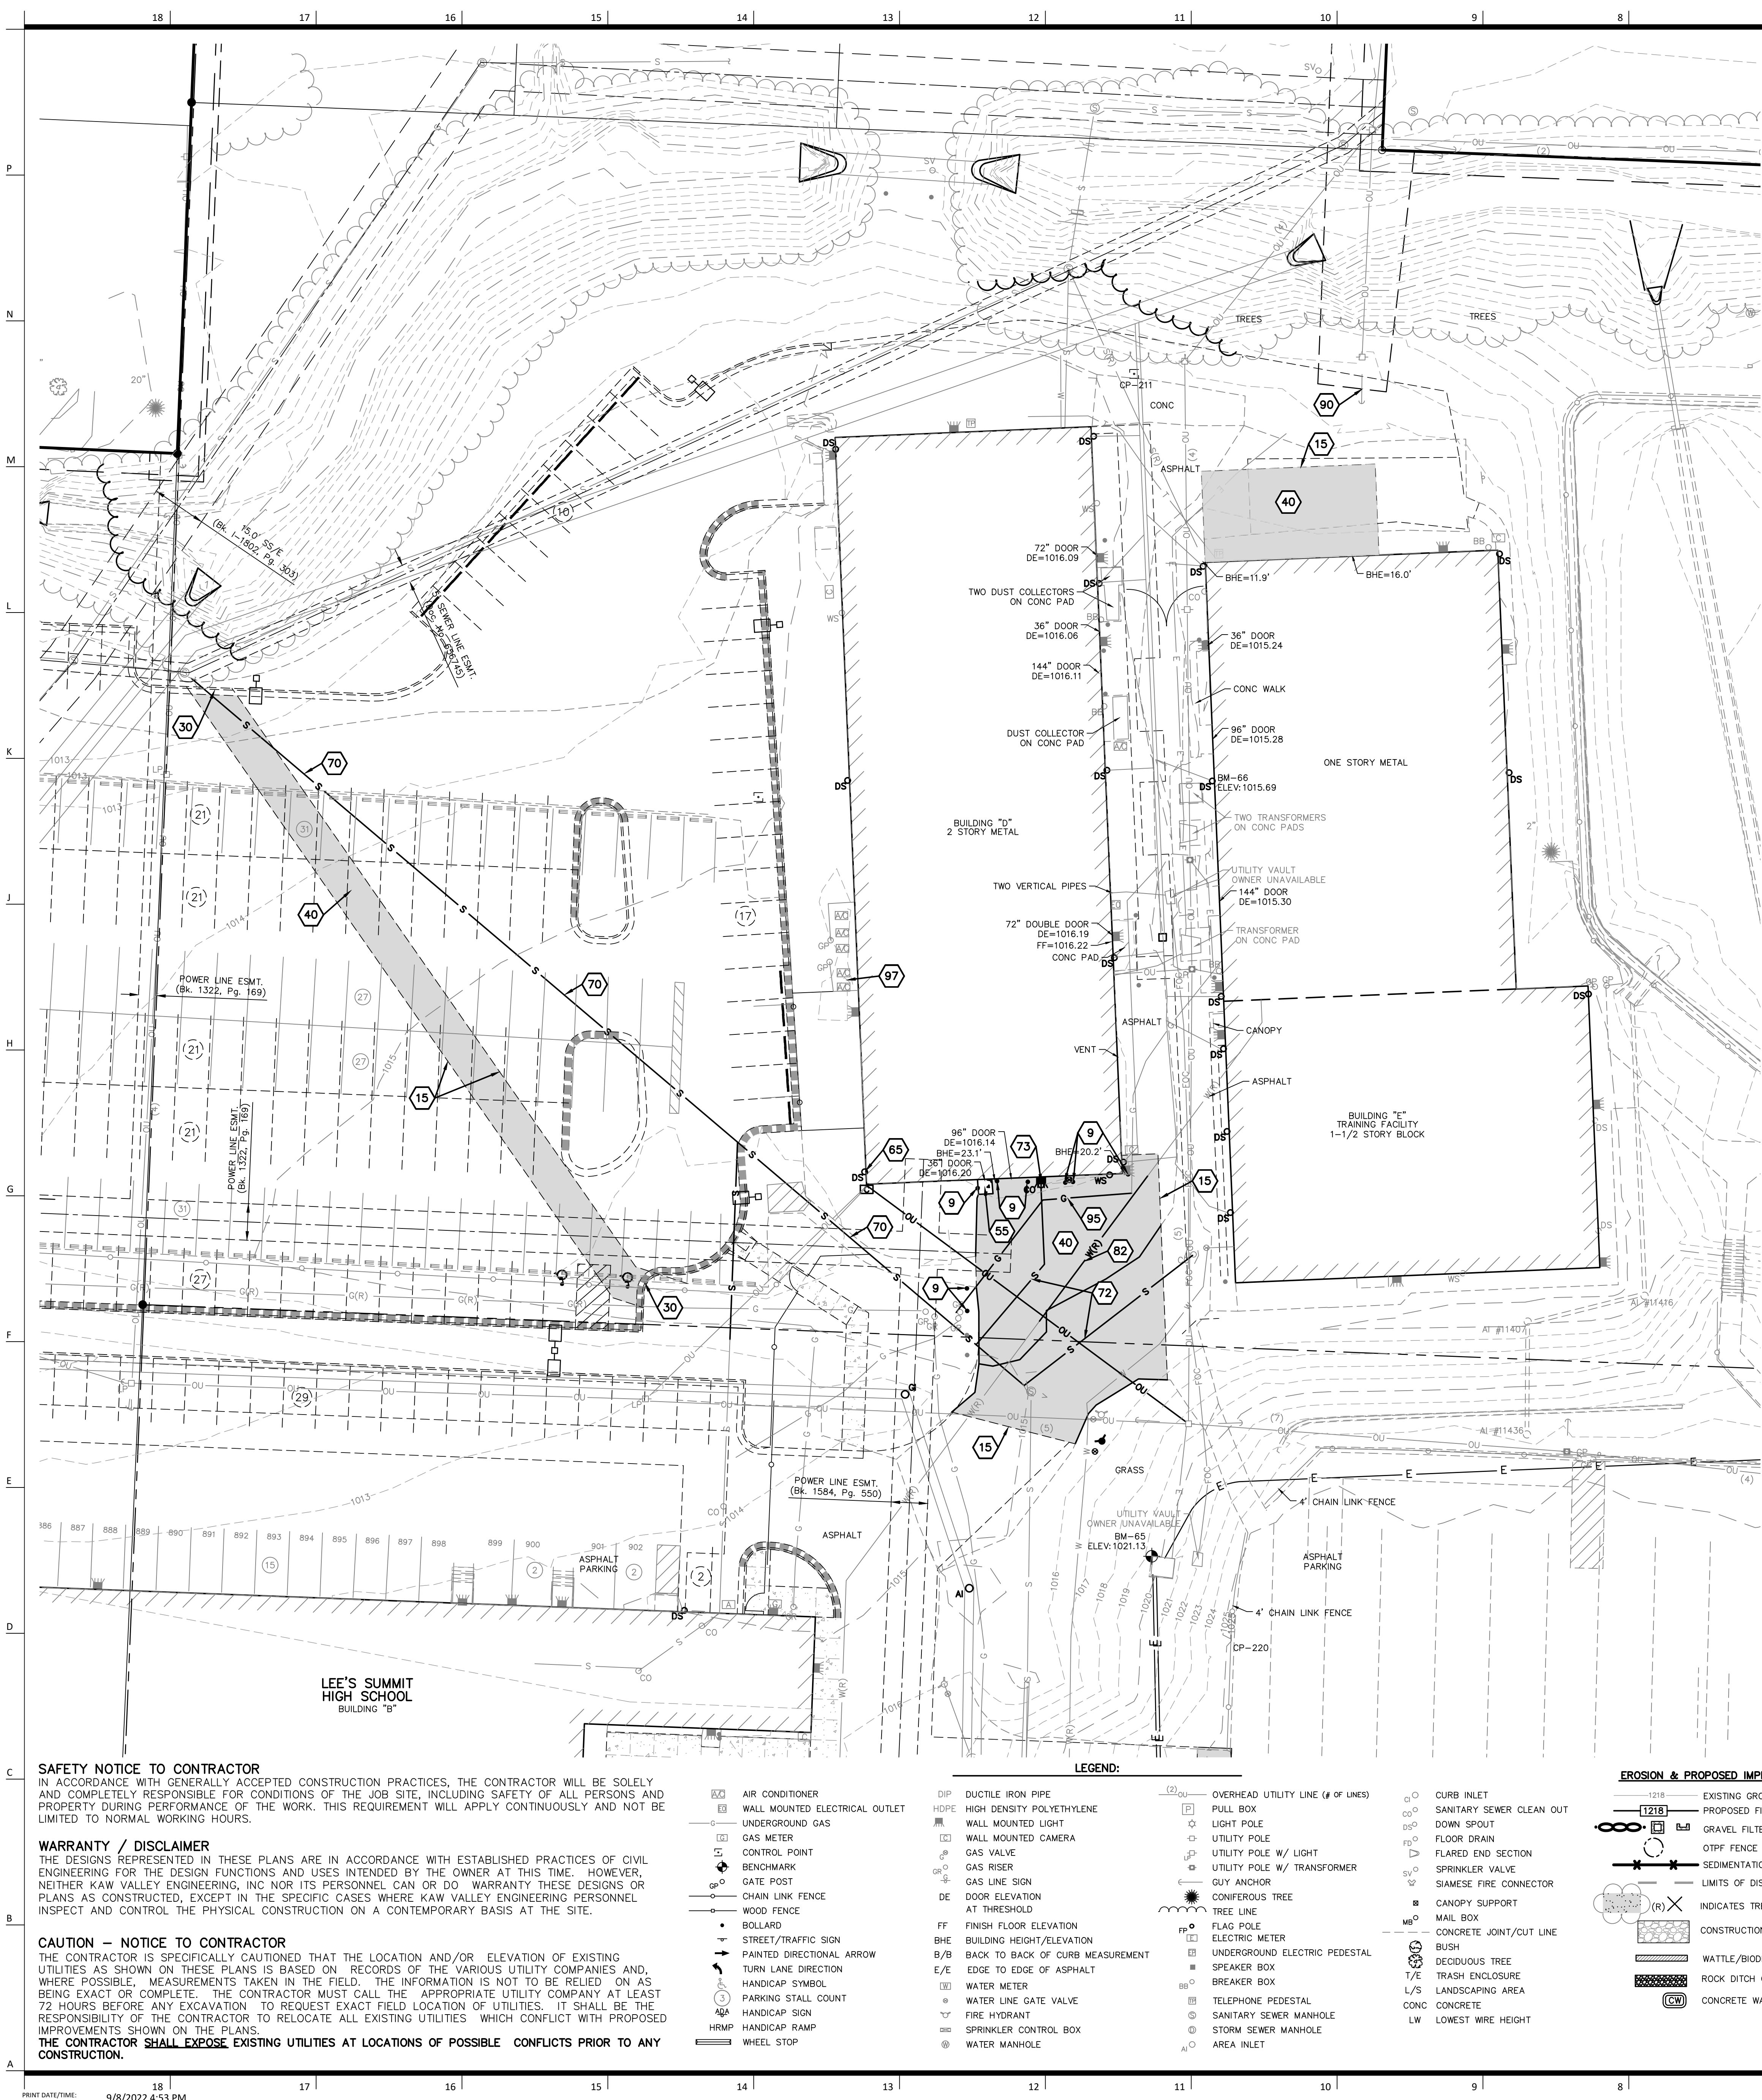

DEMOLITION

- 1 TO REMAIN.
- 6 SIGN TO BE REMOVED
- 7 SIGN TO BE RELOCATED
- 8 REMOVE BUILDING AND BUILDING EQUIPMENT. (COORDINATE WITH ARCHITECTURAL AND MEP PLAN)
- 8A REMOVE EXISTING SERVICE TUNNEL AFTER UTILITIES HAVE BEEN ABANDONED. SEAL PENETRATIONS AT BUILDING IN ACCORDANCE WITH ARCHITECTURAL AND STRUCTURAL PLANS
- 9 CONCRETE BOLLARD/TALL DELINEATORS TO BE REMOVED. (COORDINATE WITH ARCHITECTURAL PLAN)
- 10 FENCE AND FENCE POST TO BE REMOVED AS NECESSARY TO CONSTRUCT IMPROVEMENTS.
- 15 SAW CUT LINE (FOR CONCRETE SAW CUT AT NEAREST CONTROL JOINT. FOR ASPHALT SAW CUT MINIMUM OF 6" FROM NEW CURB LINE). SEE SHEET C100 AND C200 FOR LIMITS.
- 30 CONTRACTOR TO REMOVE CONCRETE CURBS TO CONSTRUCT IMPROVEMENTS. SEE SHEET C100 AND C200 FOR LIMITS.
- 40 CONTRACTOR TO REMOVE ASPHALT PAVING AS REQUIRED TO CONSTRUCT IMPROVEMENTS.
- 55 CONTRACTOR TO REMOVE CONCRETE PAVING AND WALKS.
- 60 CONTRACTOR TO MODIFY, REMOVE AND/OR REROUTE STORM SEWER PRIOR TO CONSTRUCTING ADDITIONS. REFER TO C600 SHEETS FOR ADDITIONAL INFORMATION.
- 65 CONTRACTOR TO RELOCATE DOWNSPOUT TO FACILITATE IMPROVEMENTS
- 70 CONTRACTOR TO REMOVE AND/OR REROUTE EXISTING SANITARY SEWER REFER TO C500, AND C700 SERIES SHEETS FOR ADDITIONAL INFORMATION.
- 72 CONTRACTOR TO DISCONNECT AND REMOVE AND RELOCATE EXISTING SANITARY SERVICE LINE ROUTED EXTERIOR TO THE BUILDING AS NECESSARY TO CONSTRUCT THE BUILDING ADDITIONS AND SITE IMPROVEMENTS AS APPLICABLE REFER TO C500 SHEETS AND MEP PLANS FOR ADDITIONAL INFORMATION.
- 73 CONTRACTOR TO DISCONNECT AND REMOVE AND RELOCATE EXISTING CLEANOUT AS NECESSARY TO CONSTRUCT THE BUILDING ADDITIONS AND SITE IMPROVEMENTS AS APPLICABLE REFER TO C500 SHEETS AND MEP PLANS FOR ADDITIONAL INFORMATION.
- 82 CONTRACTOR TO DISCONNECT AND REMOVE AND RELOCATE EXISTING DOMESTIC WATER SERVICE LINE ROUTED EXTERIOR TO THE BUILDING AS NECESSARY TO CONSTRUCT THE BUILDING ADDITIONS AND SITE IMPROVEMENTS AS APPLICABLE REFER TO C500 SHEETS AND MEP PLANS FOR ADDITIONAL INFORMATION.
- 90 CONTRACTOR TO COORDINATE WITH LSR7 TO RELOCATE GUY ANCHOR OUTSIDE OF PROPOSED PAVING
- 95 EXISTING GAS SERVICE AND APPURTENANCES TO BE REMOVED, REPLACED OR RELOCATED PRIOR TO CONSTRUCTING ADDITION. (COORDINATE WITH C500, SPIRE ENERGY AND MEP PLANS)
- 97 CONTRACTOR TO REMOVE HVAC UNITS. COORDINATE WITH LSR7 AND MEP PLANS

CONSTRUCTION NOTES:

- CONTRACTOR SHALL VERIFY SITE CONDITIONS PRIOR TO BIDDING. CONTRACTOR SHALL REMOVE ALL BUILDINGS, UTILITIES, PAVEMENT, FOUNDATIONS, FENCES, CURBS AND ALL OTHER STRUCTURES FROM WITHIN PROPERTY LINES EXCEPT AS DESIGNATED "TO REMAIN" OR "TO BE REMOVED BY OTHERS" IN ACCORDANCE WITH THE SPECIFICATIONS AND THE CITY OF LEE'S SUMMIT AND STATE REGULATIONS. SITE CONDITIONS SHOWN WERE AS OF MARCH 19, 2020.
- ALL UTILITY PIPE LINES TO BE ABANDONED SHALL BE PLUGGED PER CITY AND STATE REGULATIONS.
- DRIVES, PAVING AND OTHER STRUCTURES ON STREET OR HIGHWAY RIGHT-OF-WAY SHALL BE REMOVED AS NECESSARY TO CONSTRUCT IMPROVEMENTS SHOWN ON THESE PLANS. REMOVAL AND DISPOSAL SHALL BE IN CONFORMANCE WITH LOCAL, STATE AND FEDERAL REGULATIONS.
- ALL PAVING WITHIN PROPERTY TO BE REMOVED AND DISPOSED OF IN CONFORMANCE WITH LOCAL, STATE AND FEDERAL REGULATIONS.
- ALL EXISTING UTILITIES ETC. LOCATED WITHIN THE BOUNDARIES OF THE PROPOSED BUILDING SHALL BE COMPLETELY REMOVED TO 10 FEET OUTSIDE OF BUILDING LINE.
- ALL HAZARDOUS ASBESTOS AND OTHER HAZARDOUS MATERIALS MUST BE IDENTIFIED AND REMOVED PRIOR TO ANY BUILDING DEMOLITION, IN STRICT CONFORMANCE WITH LOCAL, STATE AND FEDERAL REGULATIONS.
- CONTRACTOR SHALL VERIFY THAT ALL UTILITIES TO EXISTING STRUCTURES HAVE BEEN DISCONNECTED PRIOR TO COMMENCING DEMOLITION.
- EXISTING POWER LINES AND APPURTENANCES TO BE RELOCATED. COORDINATE WITH LOCAL UTILITIES.
- ALL SLOPES THAT ARE 4:1 OR STEEPER MUST BE FULLY OR PERMANENTLY STABILIZED WITHIN TWO WEEKS OF FINAL GRADING.
- CONTRACTOR HAS THE OPTION TO CONSTRUCT MULCH BERMS FROM TREE REMOVAL IN LIEU OF SILT FENCE ALONG TREE LINES. SEE DETAIL ESC-04.
- STAGE INSTALL OF CONSTRUCTION STAGING AND ACCESS AREA AS CONSTRUCTION PROGRESSES ON SITE. WEST PARKING LOT TO REMAIN TO THE MAXIMUM EXTENTS PRACTICAL TO MAINTAIN SITE CIRCULATION AND BUS ACCESS. COORDINATE WITH CM'S SITE LOGISTIC PLAN.
- PROVIDE CONSTRUCTION FENCING AS NOTED ON CM'S SITE LOGISTIC PLAN.

DESCRIPTION OF WORK -- PRE CLEAR AND PHASE I:

- OBTAIN REVIEW COMPLIANCE AND APPLICABLE PERMITS.
- HOLD PRE-CONSTRUCTION CONFERENCE.
- INSTALL PERIMETER EROSION CONTROL MEASURES, INLET PROTECTION DOWNSIDE OF DEMOLITION AREAS AND TREE PROTECTION FENCING WITHIN CLEARING LIMITS AS APPLICABLE
- SAWCUT AND REMOVE PAVEMENT, FLATWORK AND CURBING IN IMMEDIATE VICINITY OF PROPOSED WORK AREAS AND UTILITY RELOCATION POINTS. COORDINATE WORK WITH SCHOOL SCHEDULE TO MAINTAIN PEDESTRIAN AND VEHICULAR TRAFFIC FLOW AROUND CONSTRUCTION SITE. PROVIDE STABILIZED CONSTRUCTION ENTRANCE OR TEMPORARY ACCESS ROAD AS REQUIRED.
- REMOVE/RELOCATE UTILITIES IN ACCORDANCE WITH DEMOLITION PLANS AS REQUIRED TO CONSTRUCT CLASSROOM BUILDING ADDITIONS.

NOTE:


THIS EROSION CONTROL PLAN HAS BEEN PLACED IN THE CITY'S FILE FOR THIS PROJECT. THE PLAN APPEARS TO FULFILL THE MISSOURI DEPARTMENT OF NATURAL RESOURCES TECHNICAL CRITERIA AND THE CRITERIA FOR EROSION CONTROL AND REQUIREMENTS OF THE CITY. I UNDERSTAND THAT ADDITIONAL EROSION CONTROL MEASURES MAY BE NEEDED IF UNFORESEEN EROSION PROBLEMS ARISE OR IF THE SUBMITTED PLAN DOES NOT FUNCTION AS INTENDED. THE REQUIREMENTS OF THIS PLAN SHALL RUN WITH THE LAND AND BE THE OBLIGATION OF THE LAND OWNER UNTIL SUCH TIME AS THE PLAN IS PROPERLY COMPLETED, MODIFIED OR VOIDED.

GENERAL NOTES:

- REFER TO SHEET C490 AND LANDSCAPE PLAN FOR TEMPORARY AND PERMANENT SEEDING/STABILIZATION REQUIREMENTS.
- REFER TO APWA STANDARD ESC DRAWINGS FOR ADDITIONAL DETAILS AND SPECIFICATIONS.

FOR THE FOLLOWING DETAILS REFER TO THE KC METROPOLITAN CHAPTER ADOPTED DIVISION III APWA STANDARD DRAWINGS FOR EROSION AND SEDIMENT CONTROL (2017 VERSION) ON SHEETS C480 AND C485.

- ESC-01 CONSTRUCTION ENTRANCE AND CONCRETE WASHOUT
- ESC-02 EROSION CONTROL BLANKETS AND TURF REINFORCEMENT MAT
- ESC-03 SEDIMENTATION FENCE
- ESC-04 WATTLES/BIODEGRADABLE LOGS AND MULCH/COMPOST FILTER BERMS
- ESC-06 CURB INLET PROTECTION
- ESC-07 AREA INLET PROTECTION
- ESC-10 ROCK DITCH CHECKS
- ESC-14 OUTLET PROTECTION (REFERENCE DETAIL 406 ON SHEET C695)

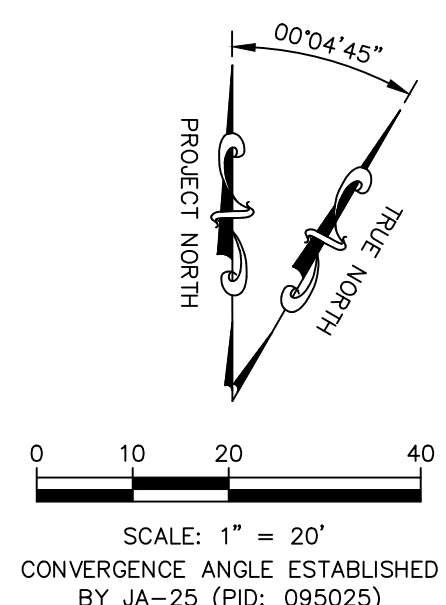

EROSION & PROPOSED IMPROVEMENTS LEGEND:

- EXISTING GROUND CONTOUR (1' INTERVALS)
- PROPOSED FINISHED GROUND CONTOUR (1' INTERVALS)
- GRAVEL FILTER BAGS AND INLET PROTECTION (ESC-06 & ESC-07)
- GTPF FENCE (GTPF)
- SEDIMENTATION FENCE (ESC-03)
- LIMITS OF DISTURBANCE
- INDICATES TREE/SHRUB TO BE REMOVED
- CONSTRUCTION ENTRANCE AND STAGING (ESC-01)
- WATTLE/BIODEGRADABLE LOG (ESC-04)
- ROCK DITCH CHECK (ESC-10) OR OUTLET PROTECTION (ESC-14)
- CONCRETE WASH AREA (ESC-01)

- GRAVEL TO BE REMOVED
- ASPHALT PAVING TO BE REMOVED
- CONCRETE PAVING/SIDEWALKS TO BE REMOVED
- AREA TO BE MILLED
- BUILDING TO BE REMOVED

SAFETY NOTICE TO CONTRACTOR

IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, THE CONTRACTOR WILL BE SOLELY AND COMPLETELY RESPONSIBLE FOR CONDITIONS OF THE JOB SITE, INCLUDING SAFETY OF ALL PERSONS AND PROPERTY DURING PERFORMANCE OF THE WORK. THIS REQUIREMENT WILL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS.

WARRANTY / DISCLAIMER

THE DESIGNS REPRESENTED IN THESE PLANS ARE IN ACCORDANCE WITH ESTABLISHED PRACTICES OF CIVIL ENGINEERING FOR THE DESIGN FUNCTIONS AND USES INTENDED BY THE OWNER AT THIS TIME. HOWEVER, NEITHER KAW VALLEY ENGINEERING, INC NOR ITS PERSONNEL CAN OR DO WARRANTY THESE DESIGNS OR PLANS AS CONSTRUCTED, EXCEPT IN THE SPECIFIC CASES WHERE KAW VALLEY ENGINEERING PERSONNEL INSPECT AND CONTROL THE PHYSICAL CONSTRUCTION ON A CONTINUOUS BASIS AT THE SITE.

CAUTION -- NOTICE TO CONTRACTOR

THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES AS SHOWN ON THESE PLANS IS BASED ON RECORDS OF THE VARIOUS UTILITY COMPANIES AND, WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THE INFORMATION IS NOT TO BE RELIED ON AS BEING EXACT OR COMPLETE. THE CONTRACTOR MUST CALL THE APPROPRIATE UTILITY COMPANY AT LEAST 72 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATION OF UTILITIES. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH PROPOSED IMPROVEMENTS SHOWN ON THE PLANS. THE CONTRACTOR SHALL EXPOSE EXISTING UTILITIES AT LOCATIONS OF POSSIBLE CONFLICTS PRIOR TO ANY CONSTRUCTION.

- AIR CONDITIONER
- WALL MOUNTED ELECTRICAL OUTLET
- UNDERGROUND GAS
- GAS METER
- CONTROL POINT
- BENCHMARK
- GATE POST
- CHAIN LINK FENCE
- WOOD FENCE
- BOLLARD
- STREET/TRAFFIC SIGN
- PAINTED DIRECTIONAL ARROW
- TURN LANE DIRECTION
- HANDICAP SYMBOL
- PARKING STALL COUNT
- HANDICAP SIGN
- HANDICAP RAMP
- HRMP
- WHEEL STOP

LEGEND:

- DIP DUCTILE IRON PIPE
- HDPE HIGH DENSITY POLYETHYLENE
- WALL MOUNTED LIGHT
- WALL MOUNTED CAMERA
- GAS VALVE
- GAS RISER
- GAS LINE SIGN
- DOOR ELEVATION AT THRESHOLD
- DE FINISH FLOOR ELEVATION
- BHE BUILDING HEIGHT/ELEVATION
- B/B BACK TO BACK OF CURB MEASUREMENT
- E/E EDGE TO EDGE OF ASPHALT
- WATER METER
- WATER LINE GATE VALVE
- FIRE HYDRANT
- SPIRINKLER CONTROL BOX
- WATER MANHOLE

- OVERHEAD UTILITY LINE (# OF LINES)
- PULL BOX
- LIGHT POLE
- UTILITY POLE
- UTILITY POLE W/ LIGHT
- UTILITY POLE W/ TRANSFORMER
- GUY ANCHOR
- CONFEROUS TREE
- TREE LINE
- FLAG POLE
- ELECTRIC METER
- UNDERGROUND ELECTRIC PEDESTAL
- SPEAKER BOX
- BREAKER BOX
- TELEPHONE PEDESTAL
- SANITARY SEWER MANHOLE
- STORM SEWER MANHOLE
- AREA INLET

- CURB INLET
- SANITARY SEWER CLEAN OUT
- DOWN SPOUT
- FLOOR DRAIN
- FLARED END SECTION
- SPIRINKLER VALVE
- SIAMSE FIRE CONNECTOR
- MAIL BOX
- CONCRETE JOINT/OUT LINE
- BUSH
- DECIDUOUS TREE
- TRASH ENCLOSURE
- LANDSCAPING AREA
- CONCRETE
- LOWEST WIRE HEIGHT

Lee's Summit Robotics,  
Gic & Phys Educaiton

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100

owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect: Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816-931.6655  
multi-studio

civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com

structural engineer: Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com


MEP/Electrical: Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

Issue Date: September 9, 2022

Revisions

NUMBER	DESCRIPTION	DATE
--------	-------------	------

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

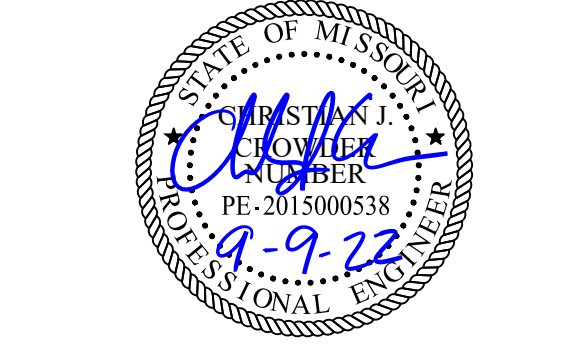

Kaw Valley Engineering, Inc.  
Missouri Certificate of Authority: 000842  
Christian Crowder Date: 9/9/2022  
Engineer License No. PE-2015000538




DEMOLITION PLAN

C200

PROJ. NO. C20-0496-1DSN: CJC  
CFN: 0496-1DEMO DWN: NJN  
ENGINEER  
MO # 2015000538  
14700 WEST 114TH TERRACE  
LENEXA, KANSAS 66215  
PH. (913) 894-5150 | FAX (913) 894-5977  
kveng.com | www.kveng.com  
KAW VALLEY ENGINEERING  
KAW VALLEY ENGINEERING, INC., IS AUTHORIZED TO OFFER ENGINEERING SERVICES BY MISSOURI STATE CERTIFICATE OF AUTHORITY # 000842. EXPIRES 12/31/23



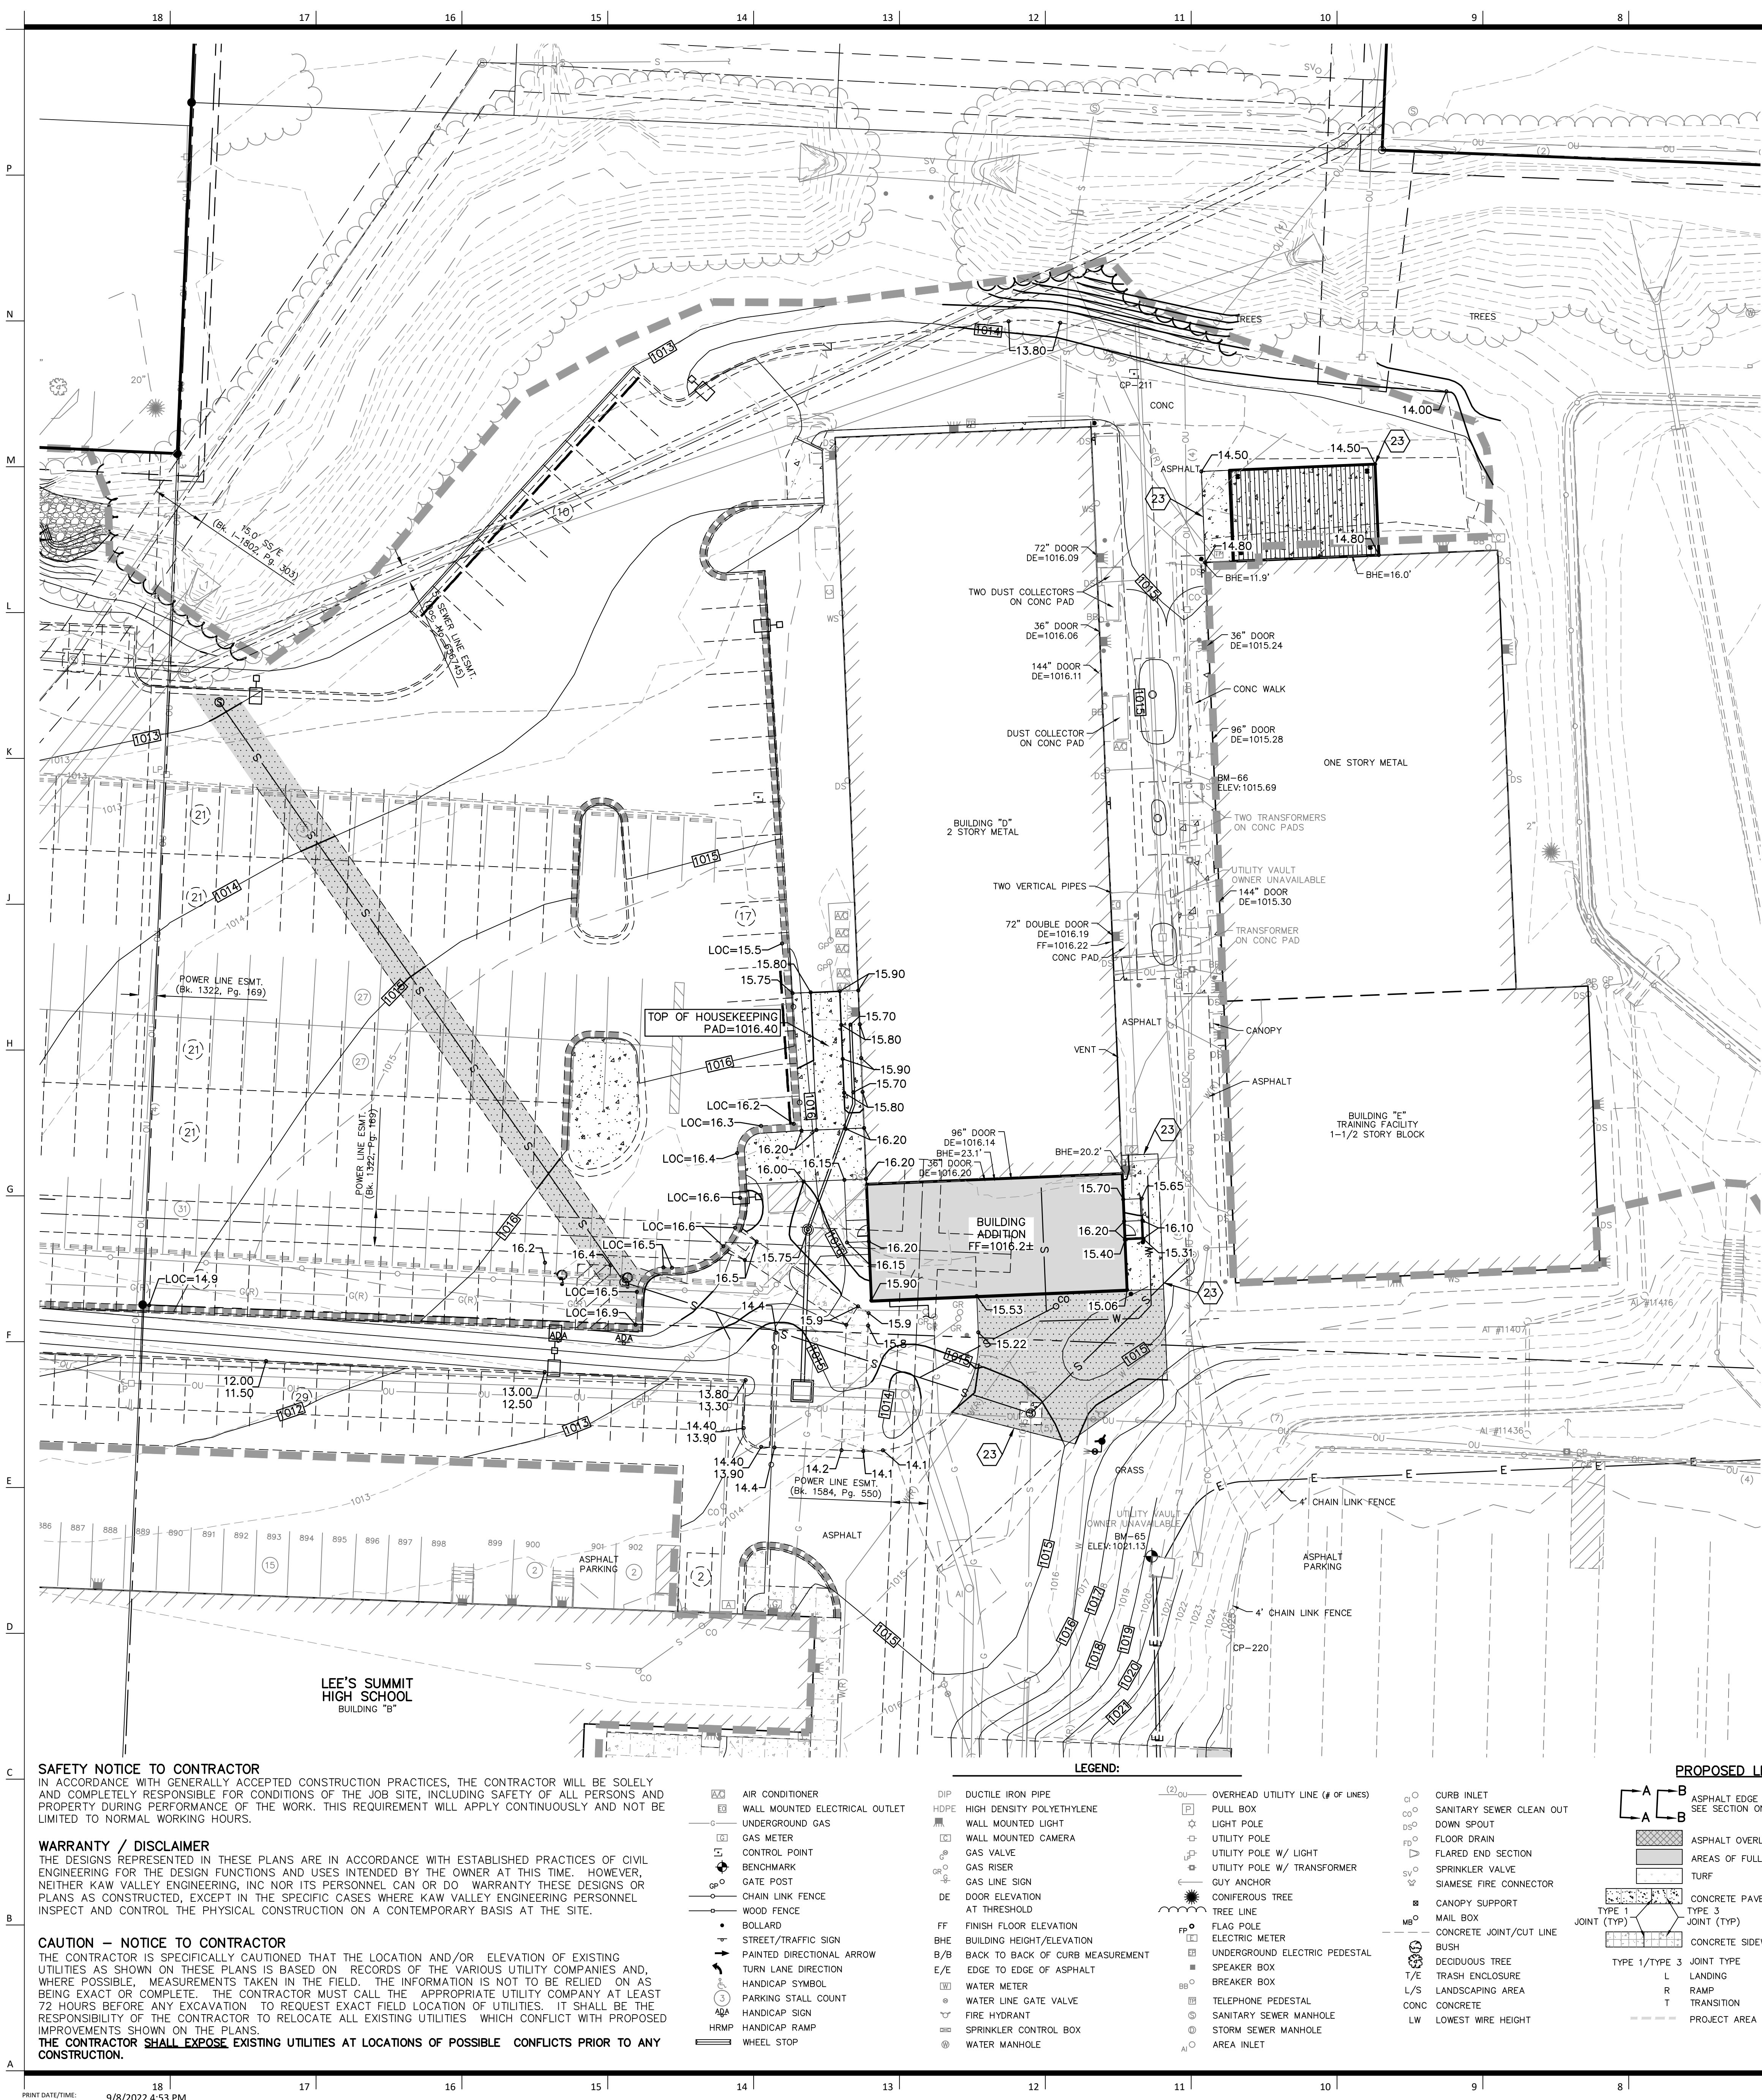

- GRADING NOTES:**
- THE CONSTRUCTION AREA SHALL BE CLEARED, GRUBBED, AND STRIPPED OF TOPSOIL AND ORGANIC MATTER FROM ALL AREAS TO BE OCCUPIED BY BUILDING AND PAVING. TOPSOIL FOR REPLACEMENT ON SLOPES MAY BE STOCKPILED ON SITE. EXCESS TOPSOIL MAY BE WASTED IN FILL SLOPES PROVIDED THAT NO TOPSOIL WILL BE WASTED WITHIN 10 FEET OF THE EDGE OF THE BUILDING OR PARKING AREA. BURNING OF TIMBER WILL NOT BE PERMITTED UNLESS APPROVAL IS OBTAINED FROM GOVERNING OFFICIALS. STRIPPING EXISTING TOPSOIL AND ORGANIC MATTER SHALL BE TO A MINIMUM DEPTH OF 6 INCHES. CONSTRUCTION MANAGER SHALL DESIGNATE LOCATION OF STOCKPILE AREAS DURING CONSTRUCTION. ANY UNAUTHORIZED STOCKPILE SHALL BE REMOVE/RELOCATED AT THE CONTRACTORS EXPENSE.
  - AREAS TO RECEIVE FILL SHALL BE SCARIFIED AND THE TOP 12-INCH DEPTH COMPACTED TO 95% OF THE MAXIMUM DRY DENSITY AS DETERMINED BY ASTM D 698 WITH A MOISTURE CONTENT OF +/-3% OF OPTIMUM FOR SOILS WITH A LIQUID LIMIT OF LESS THAN 40 AND 0 TO +4% FOR SOILS WITH A LIQUID LIMIT GREATER THAN 40. ANY UNSUITABLE AREAS SHALL BE UNDERCUT AND REPLACED WITH SUITABLE MATERIAL BEFORE ANY FILL MATERIAL CAN BE APPLIED.
  - OFF-SITE SOIL MATERIAL FOR USE UNDER BUILDING AND PAVED AREAS SHALL HAVE A PLASTICITY INDEX OF 25 OR LESS, A LIQUID LIMIT OF 45 OR LESS AND CONTAIN NO ROCK LARGER THAN THREE INCHES. OFF-SITE FILL MATERIAL SHALL BE APPROVED BY THE OWNER'S TESTING AGENCY PRIOR TO BRINGING ON SITE.
  - EARTHWORK UNDER THE BUILDING, PAVING AND LIGHTLY LOADED STRUCTURAL FEATURES SHALL COMPLY WITH THE CONTRACT DOCUMENTS AND PROJECT GEOTECHNICAL REPORT. THE BUILDING PAD SHALL BE EXCAVATED AS REQUIRED TO ALLOW THE PLACEMENT OF LOW VOLUME CHANGE MATERIAL. REFER TO GEOTECHNICAL REPORT FOR PREPARING BUILDING PAD AND LOW VOLUME CHANGE THICKNESS REQUIREMENTS. OTHER FILL MATERIAL SHALL BE MADE IN LIFTS NOT TO EXCEED EIGHT INCHES DEPTH COMPACTED TO 95% OF THE MAXIMUM DRY DENSITY AS DETERMINED BY ASTM D 698. LVC SOILS SHALL BE COMPACTED AT A MOISTURE CONTENT OF 0 TO +4% OF OPTIMUM FOR SOILS WITH A LIQUID LIMIT GREATER THAN 40 AND +/-3% OF OPTIMUM FOR SOILS WITH A LIQUID LIMIT LESS THAN 40. NO ROCK LARGER THAN THREE INCHES IN ANY DIMENSION NOR ANY SHALE SHALL BE PLACED IN THE TOP 24 INCHES OF EMBANKMENT.
  - ON-SITE HIGH PLASTICITY CLAYS MAY BE TREATED WITH 5% TYPE 1/2 PORTLAND CEMENT BY WEIGHT. REFER TO PROJECT GEOTECHNICAL REPORT FOR REQUIREMENTS.
  - AREAS THAT ARE TO BE CUT TO SUBGRADE LEVELS SHALL BE PROOF ROLLED WITH A LOADED DUMP TRUCK OR SIMILAR APPROVED CONSTRUCTION EQUIPMENT TO DETECT UNSUITABLE SOIL CONDITIONS.
  - IN ALL AREAS OF EXCAVATION, IF UNSUITABLE SOIL CONDITIONS ARE ENCOUNTERED, THE OWNER'S ENGINEER SHALL RECOMMEND TO THE OWNER THE METHODS OF UNDERCUTTING AND REPLACEMENT OF PROPERLY COMPACTED, APPROVED FILL MATERIAL. ALL PROOFROLLING AND UNDERCUTTING SHOULD BE PERFORMED DURING A PERIOD OF DRY WEATHER.
  - ALL EXCAVATIONS SHALL BE CONSIDERED AS UNCLASSIFIED. REFER TO PROJECT GEOTECHNICAL REPORT.**
  - ALL DISTURBED SLOPES ARE TO BE 3:1 OR FLATTER.
  - DETENTION BASIN AND ALL SLOPES DISTURBED EXCEEDING 4:1 SHALL BE HYDROSEED, SODDED OR PROTECTED BY EROSION CONTROL BLANKETS THAT WILL PREVENT EROSION AND PLACED SUCH THAT THE SURFACE IS FLUSH WITH SURROUNDING GROUND AND SHAPED TO CHANNEL WATER IN DIRECTIONS INDICATED. SEE GENERAL NOTES ON THIS SHEETS.
  - ALL SLOPES AND AREAS DISTURBED BY CONSTRUCTION SHALL BE GRADED SMOOTH AND A MINIMUM OF FOUR INCHES OF TOPSOIL APPLIED. IF ADEQUATE TOPSOIL IS NOT AVAILABLE ON-SITE, THE CONTRACTOR SHALL PROVIDE TOPSOIL, APPROVED BY THE OWNER, AS NEEDED. THE AREA SHALL THEN BE SODDED OR SEED, FERTILIZED, MULCHED, WATERED AND MAINTAINED UNTIL HARDY GRASS GROWTH IS ESTABLISHED IN ALL AREAS. ANY AREAS DISTURBED FOR ANY REASON SHALL BE CORRECTED BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE OWNER PRIOR TO FINAL ACCEPTANCE OF THE PROJECT. REFER TO THE NOTES ON THIS SHEET FOR TEMPORARY SEEDING SPECIFICATIONS. REFER TO PROJECT SITE PLAN FOR FINAL STABILIZATION TREATMENTS.
  - CONTRACTOR IS TO REMOVE AND DISPOSE OF ALL DEBRIS, RUBBISH AND OTHER MATERIALS RESULTING FROM PREVIOUS AND CURRENT DEMOLITION OPERATIONS.
  - THE CONTRACTOR SHALL TAKE ALL PRECAUTIONS NECESSARY TO AVOID PROPERTY DAMAGE TO ADJACENT PROPERTIES DURING THE CONSTRUCTION PHASES OF THIS PROJECT. THE CONTRACTOR WILL BE HELD SOLELY RESPONSIBLE FOR ANY DAMAGES TO THE ADJACENT PROPERTIES OCCURRING DURING THE CONSTRUCTION PHASES OF THIS PROJECT.
  - IT IS NOT THE DUTY OF THE ENGINEER OR THE OWNER TO REVIEW THE ADEQUACY OF THE CONTRACTOR'S SAFETY MEASURES, IN, ON OR NEAR THE CONSTRUCTION SITE AT ANY TIME DURING CONSTRUCTION.
  - IF ANY OF THESE NOTES CONFLICT WITH THE PROJECT GEOTECHNICAL REPORT (CFS PROJECT 22-5546) AND ALL ADDENDUMS PREPARED BY CFS ENGINEERS DATED AUGUST 3, 2022, RECOMMENDATIONS IN GEOTECHNICAL REPORT SHALL GOVERN.

**HORIZONTAL AND VERTICAL DATUM.**  
UNLESS OTHERWISE NOTED THE COORDINATES SHOWN HEREON ARE GRID COORDINATES BASED ON THE MISSOURI STATE PLANE, WEST ZONE (NAD 1983) (NAVD 1988)  
CAF: 0.9998978  
1 METER = 3.28083333 U.S. SURVEY FEET  
GROUND COORDINATES X COMBINED ADJUSTMENT FACTOR (CAF) = GRID COORDINATES  
SCALED AROUND 0.0


**JA-25 (PID=095025)**  
NORTHING: 303646.030 (GRID/METERS) 996212.016 (GROUND/FEET)  
EASTING: 860950.475 (GRID/METERS) 2824635.014 (GROUND/FEET)  
ELEV = 321.8 (METERS) 1055.77 (FEET)

**PROJECT BENCH MARK:**  
BM-64  
CHISELED SQUARE AT THE TOP NORTHEAST CORNER OF STEPS TO THE NORTH ENTRY TO BUILDING "B" ON WEST SIDE.  
ELEV = 1015.34

BM-65  
CHISELED SQUARE ON NORTHEAST CORNER CONCRETE TRANSFORMERS PAD WEST OF PARKING LOT NORTH OF TENNIS COURTS.  
ELEV = 1021.13

BM-66  
CHISELED SQUARE ON NORTHEAST CORNER CONCRETE TRANSFORMERS PAD (NORTH MOST) BETWEEN BUILDINGS "D" AND "E".  
ELEV = 1015.69

**FLOOD STATEMENT:**  
THE SURVEYED PARCEL LIES WITHIN ZONE "X" (AREAS DETERMINED TO BE OUTSIDE THE 0.2% ANNUAL CHANCE FLOODPLAIN) AS DETERMINED BY FEMA FLOOD INSURANCE RATE MAP NUMBER 29095C04366, MAP REVISED JANUARY 20, 2017, AND BY MAP NUMBER 29095C04366, MAP REVISED JANUARY 20, 2017 LEE'S SUMMIT, JACKSON COUNTY, MISSOURI. LOCATION DETERMINED BY A SCALED GRAPHICAL PLOT OF THE FLOOD INSURANCE RATE MAP.

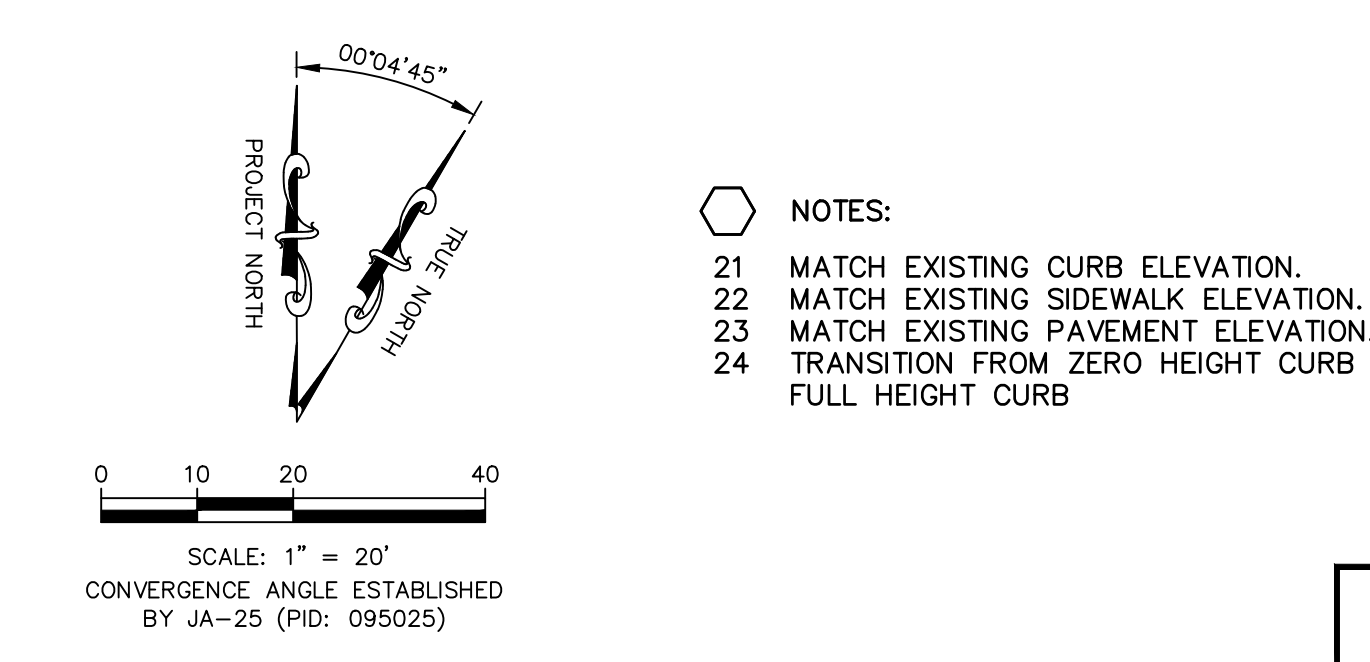

- LEGEND (PROPOSED)**
- PROPOSED LEGEND**
- ASPHALT OVERLAY (040)  
AREAS OF FULL DEPTH ASPHALT (040)  
TURF
- CONCRETE PAVEMENT (042) W/JOINTING  
CONCRETE SIDEWALK (055+005) W/JOINTING
- JOINT TYPE  
L LANDING  
R RAMP  
T TRANSITION  
PROJECT AREA (LIMITS OF DISTURBANCE)
- NOTES:  
21 MATCH EXISTING CURB ELEVATION.  
22 MATCH EXISTING SIDEWALK ELEVATION.  
23 MATCH EXISTING PAVEMENT ELEVATION.  
24 TRANSITION FROM ZERO HEIGHT CURB TO FULL HEIGHT CURB
- 22.9 SPOT ELEVATION (ADD 900), TOP OF PAVEMENT  
23.6 TOP OF CURB (ADD 900)  
23.7 FLOWLINE OF CURB (ADD 900)  
950 FINISHED 1' CONTOUR INTERVALS, TOP OF PAVEMENT
- SWALE
- LP LOW POINT  
HP HIGH POINT  
LC LIP OF CURB  
TW TOP OF WALL  
BW BOTTOM OF WALL  
SW SIDEWALK ELEVATION  
P PAVEMENT ELEVATION

**PROJECT CONTROL:**  
CP #206  
1/2" REBAR W/ CONTROL POINT CAP  
NORTHING: 997985.92 (GROUND)  
EASTING: 2826967.03 (GROUND)  
ELEV = 1012.56

CP #211  
1/2" REBAR W/ CONTROL POINT CAP  
NORTHING: 998086.62 (GROUND)  
EASTING: 2826963.98 (GROUND)  
ELEV = 1014.61

CP #220  
1/2" REBAR W/ CONTROL POINT CAP  
NORTHING: 997737.04 (GROUND)  
EASTING: 2826986.56 (GROUND)  
ELEV = 1024.94

**UTILITY STATEMENT:**  
THE UNDERGROUND UTILITIES SHOWN HEREON ARE FROM FIELD SURVEY INFORMATION OF ONE-CALL LOCATED UTILITIES, FIELD SURVEY INFORMATION OF ABOVE GROUND OBSERVABLE EVIDENCE, AND/OR THE SCALING AND PLOTTING OF EXISTING UTILITY MAPS AND DRAWINGS AVAILABLE TO THE SURVEYOR AT THE TIME OF SURVEY. THE SURVEYOR MAKES NO GUARANTEE THAT THE UNDERGROUND UTILITIES SHOWN COMPRISE ALL SUCH UTILITIES IN THE AREA, EITHER IN SERVICE OR ABANDONED. FURTHERMORE, THE SURVEYOR DOES NOT WARRANT THAT THE UNDERGROUND UTILITIES SHOWN ARE IN THE EXACT LOCATION INDICATED ALTHOUGH HE DOES CERTIFY THAT THEY ARE LOCATED AS ACCURATELY AS POSSIBLE FROM INFORMATION AVAILABLE. THE SURVEYOR HAS NOT PHYSICALLY LOCATED THE UNDERGROUND UTILITIES BY EXCAVATION UNLESS OTHERWISE NOTED ON THIS SURVEY. MISSOURI ONE CALL TICKET #221653482 & #221243061 BLOOD HOUND WORK ORDER #202977



**SAFETY NOTICE TO CONTRACTOR**  
IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, THE CONTRACTOR WILL BE SOLELY AND COMPLETELY RESPONSIBLE FOR CONDITIONS OF THE JOB SITE, INCLUDING SAFETY OF ALL PERSONS AND PROPERTY DURING PERFORMANCE OF THE WORK. THIS REQUIREMENT WILL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS.

**WARRANTY / DISCLAIMER**  
THE DESIGNS REPRESENTED IN THESE PLANS ARE IN ACCORDANCE WITH ESTABLISHED PRACTICES OF CIVIL ENGINEERING FOR THE DESIGN FUNCTIONS AND USES INTENDED BY THE OWNER AT THIS TIME. HOWEVER, NEITHER KAW VALLEY ENGINEERING, INC NOR ITS PERSONNEL CAN OR DO WARRANTY THESE DESIGNS OR PLANS AS CONSTRUCTED, EXCEPT IN THE SPECIFIC CASES WHERE KAW VALLEY ENGINEERING PERSONNEL INSPECT AND CONTROL THE PHYSICAL CONSTRUCTION ON A CONTINUOUS BASIS AT THE SITE.

**CAUTION - NOTICE TO CONTRACTOR**  
THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES AS SHOWN ON THESE PLANS IS BASED ON RECORDS OF THE VARIOUS UTILITY COMPANIES AND, WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THE INFORMATION IS NOT TO BE RELIED ON AS BEING EXACT OR COMPLETE. THE CONTRACTOR MUST CALL THE APPROPRIATE UTILITY COMPANY AT LEAST 72 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATION OF UTILITIES. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH PROPOSED IMPROVEMENTS SHOWN ON THE PLANS.  
**THE CONTRACTOR SHALL EXPOSE EXISTING UTILITIES AT LOCATIONS OF POSSIBLE CONFLICTS PRIOR TO ANY CONSTRUCTION.**

- LEGEND:**
- AIR CONDITIONER  
WALL MOUNTED ELECTRICAL OUTLET  
UNDERGROUND GAS  
GAS METER  
CONTROL POINT  
BENCHMARK  
GATE POST  
CHAIN LINK FENCE  
WOOD FENCE  
BOLLARD  
STREET/TRAFFIC SIGN  
PAINTED DIRECTIONAL ARROW  
TURN LANE DIRECTION  
HANDICAP SYMBOL  
PARKING STALL COUNT  
HANDICAP SIGN  
HANDICAP RAMP  
WHEEL STOP
- DIP DUCTILE IRON PIPE  
HDPE HIGH DENSITY POLYETHYLENE  
WALL MOUNTED LIGHT  
WALL MOUNTED CAMERA  
GAS VALVE  
GAS RISER  
GAS LINE SIGN  
DOOR ELEVATION AT THRESHOLD  
FINISH FLOOR ELEVATION  
BUILDING HEIGHT/ELEVATION  
B/B BACK TO BACK OF CURB MEASUREMENT  
E/E EDGE TO EDGE OF ASPHALT  
WATER METER  
WATER LINE GATE VALVE  
FIRE HYDRANT  
SPRINKLER CONTROL BOX  
WATER MANHOLE
- OVERHEAD UTILITY LINE (# OF LINES)  
PULL BOX  
LIGHT POLE  
UTILITY POLE  
UTILITY POLE W/ LIGHT  
UTILITY POLE W/ TRANSFORMER  
GUY ANCHOR  
CONFEROUS TREE  
TREE LINE  
FLAG POLE  
ELECTRIC METER  
UNDERGROUND ELECTRIC PEDESTAL  
SPEAKER BOX  
BREAKER BOX  
TELEPHONE PEDESTAL  
SANITARY SEWER MANHOLE  
STORM SEWER MANHOLE  
AREA INLET
- CURB INLET  
SANITARY SEWER CLEAN OUT  
DOWN SPOUT  
FLOOR DRAIN  
FLARED END SECTION  
SIAMSE FIRE CONNECTOR  
MAIL BOX  
CONCRETE JOINT/OUT LINE  
BUSH  
DECIDUOUS TREE  
T/R TRASH ENCLOSURE  
LANDSCAPING AREA  
CONCRETE  
LW LOWEST WIRE HEIGHT

**NOTE:**

- CONTRACTOR SHALL REFER TO ARCHITECTURAL PLANS FOR EXACT LOCATIONS AND DIMENSIONS OF ENTRANCE, SLOPED PAVING, EXISTING DRIVEWAYS, RAMP, TRUCK DOCKS, PRECISE BUILDING DIMENSIONS AND EXACT BUILDING UTILITY ENTRANCE LOCATIONS.
- THESE PLANS HAVE NOT BEEN VERIFIED WITH FINAL ARCHITECTURAL CONTRACT DRAWINGS. CONTRACTOR SHALL VERIFY AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES. CONTRACTOR IS FULLY RESPONSIBLE FOR REVIEW AND COORDINATION OF ALL DRAWINGS AND CONTRACTOR DOCUMENTS.
- ALL DIMENSIONS ARE TO BACK OF CURB UNLESS NOTED OTHERWISE.
- ALL DIMENSIONS ARE PERPENDICULAR TO PROPERTY LINE.

PROJ. NO. C20-0496-1DSN: CJC  
CFN: 0496-TGP  
DWN: NJN  
MO # 2015000538  
14700 WEST 114TH TERRACE  
LENEXA, KANSAS 66215  
PH. (913) 894-5150 | FAX (913) 894-5977  
lv@kve.com | www.kve.com

**KAW VALLEY ENGINEERING**

KAW VALLEY ENGINEERING, INC., IS AUTHORIZED TO OFFER ENGINEERING SERVICES BY MISSOURI STATE CERTIFICATE OF AUTHORITY # 000842. EXPIRES 12/31/23

**multistudio**  
the evolution of gould evans

**Lee's Summit Robotics, Gic & Phys Educaiton**

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0321-0100

owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect: Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multistudio

civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveeng.com

structural engineer: Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEPFI/Code: Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

Issue Date: September 9, 2022


NUMBER	DESCRIPTION	DATE
1	Revisions	

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

**GRADING PLAN**

**C300-C**



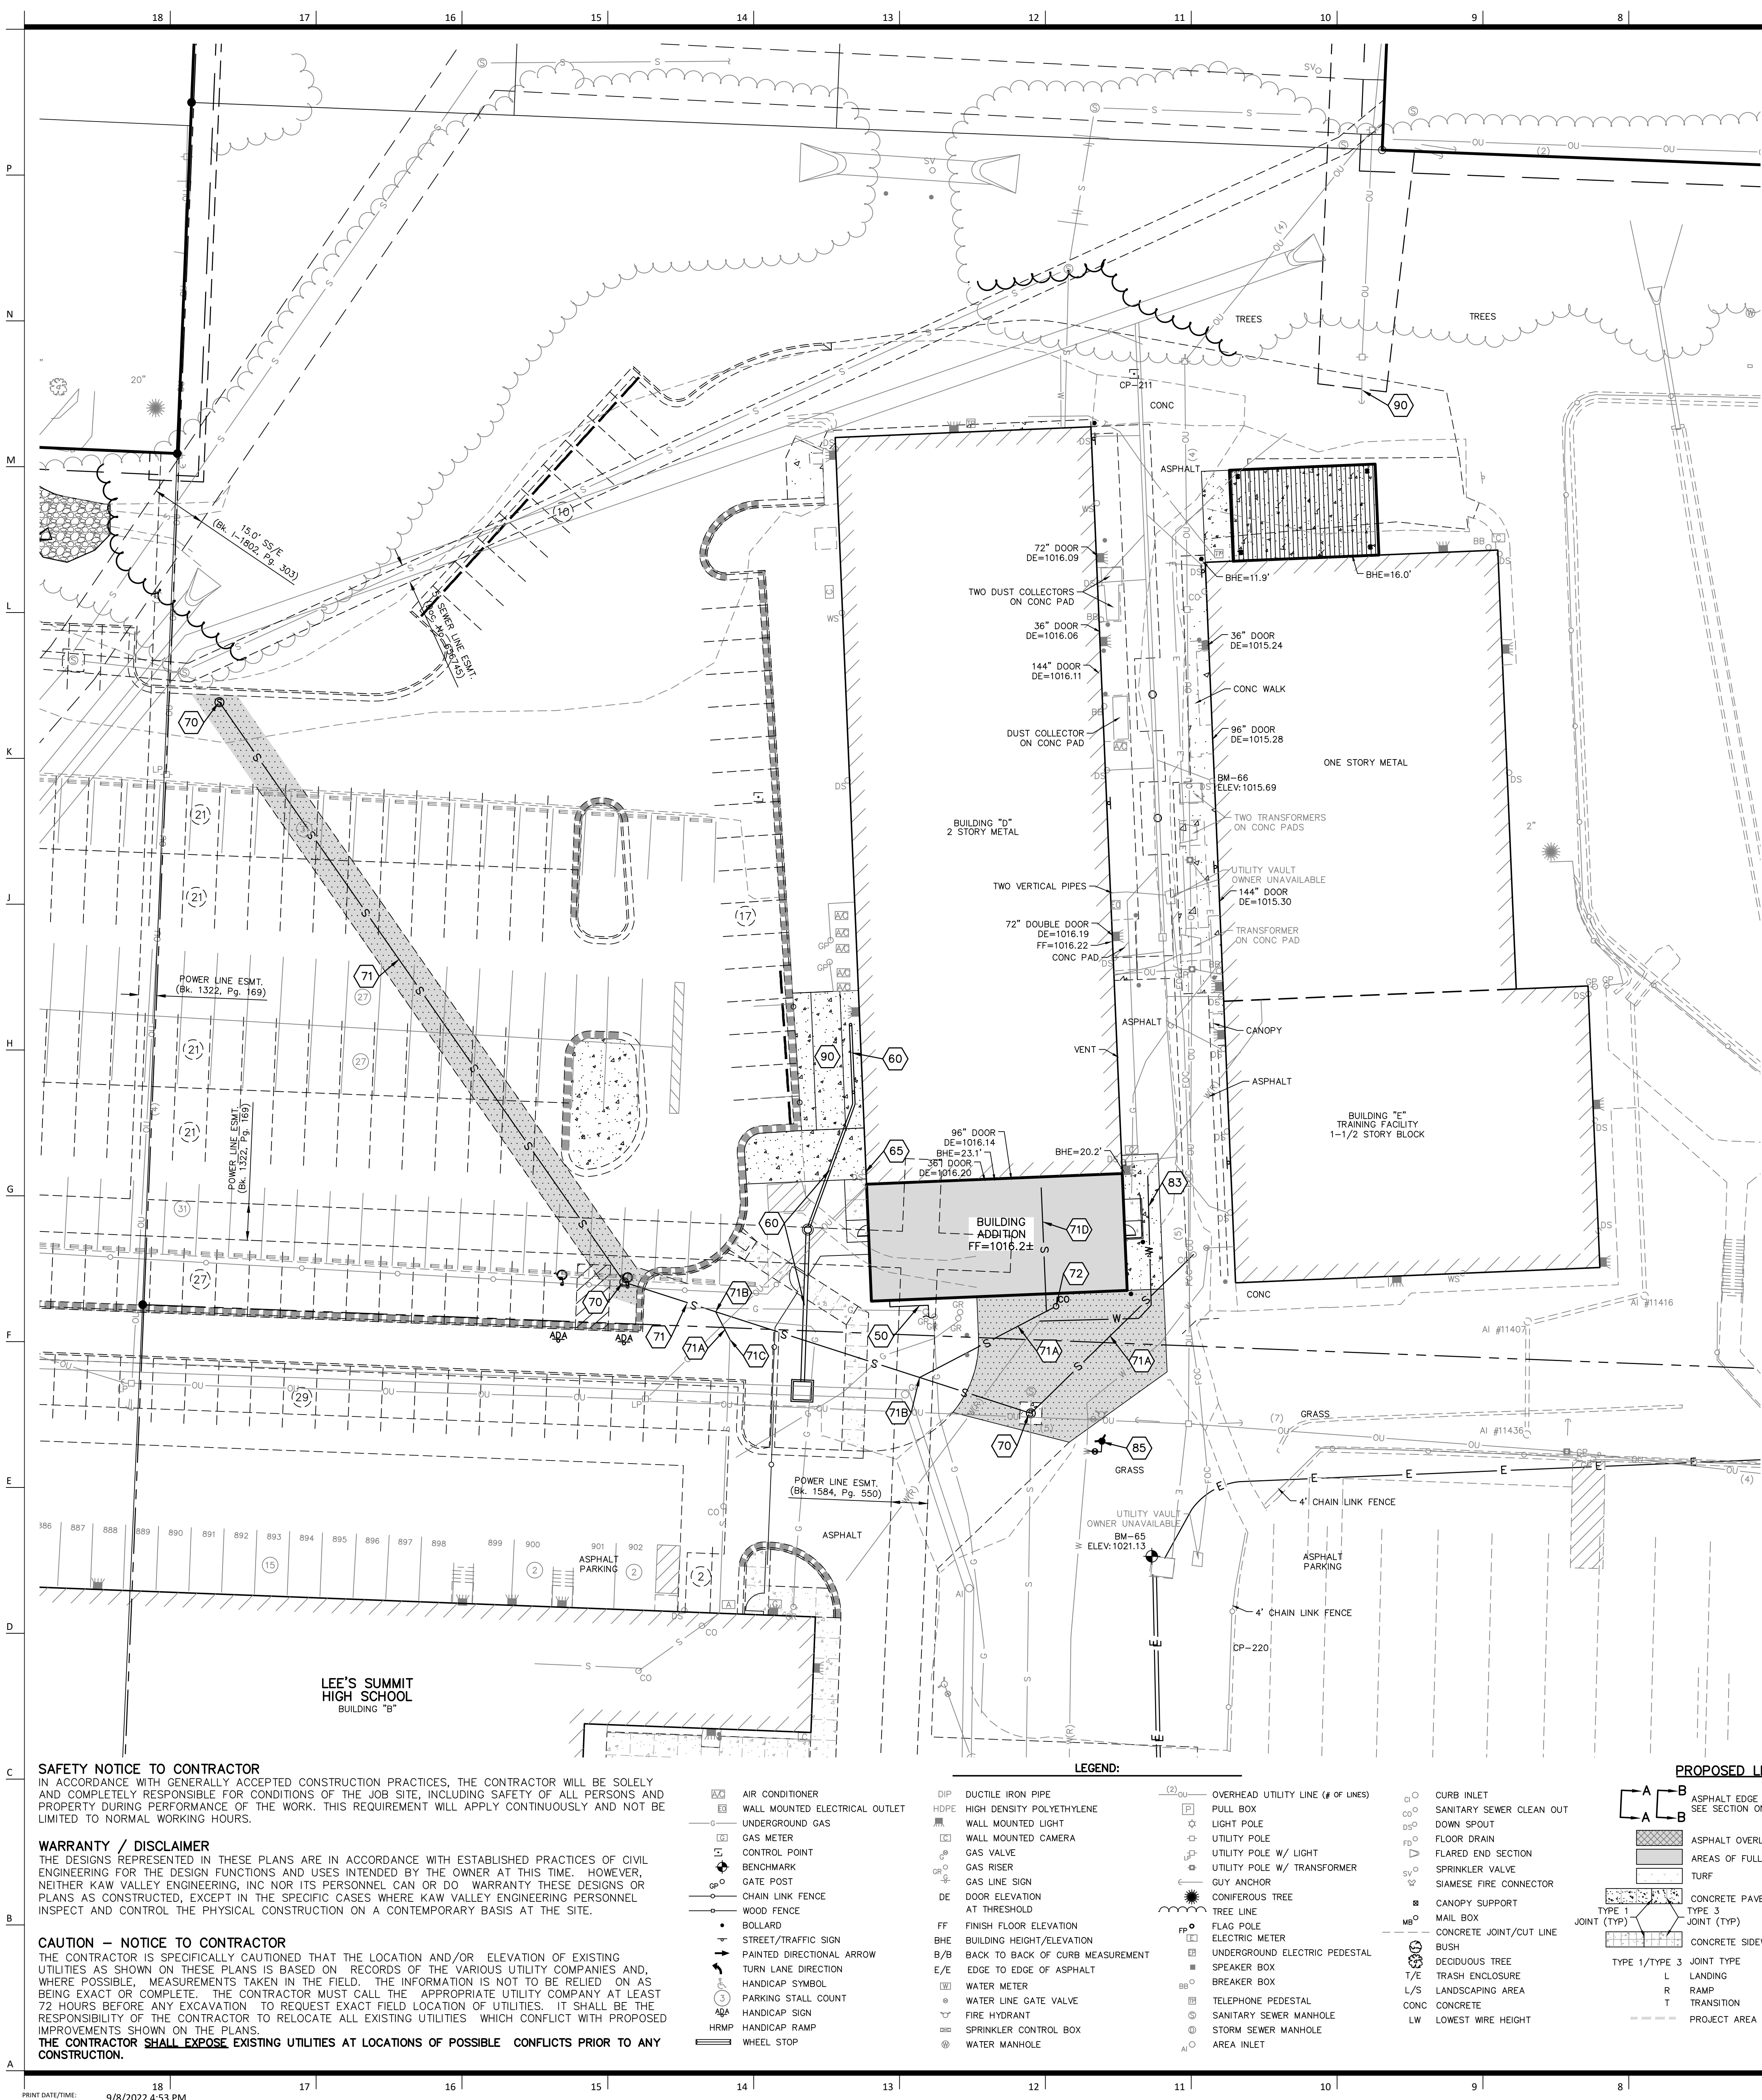

- CONSTRUCTION NOTE:**
1. INSTALLATION OF ELECTRICAL CONDUITS SHALL BE COORDINATED WITH WEIGHT ROOM CONTRACTOR. CONDUIT ROUTING MAY BE IN CONFLICT WITH EXCAVATION FOR BUILDING FOUNDATION WALL. IF CONDUIT IS INSTALLED PRIOR TO WEIGHT ROOM CONSTRUCTION, CONDUIT SHOULD BE LOCATED A MINIMUM OF 55' SOUTH AND PARALLEL TO BUILDING TO CLEAR OVER DIG AND SLOPE LAY BACK.
- UTILITY NOTES:**
1. EXCAVATION, TRENCHING AND BACKFILL SHALL BE COMPLETED IN ACCORDANCE WITH SECTION 2100 GRADING AND SITE PREPARATION OF THE KANSAS CITY METROPOLITAN CHAPTER OF APWA SPECIFICATIONS AS ADOPTED AND AMENDED BY THE CITY OF LEE'S SUMMIT.
  2. ALL BACKFILL SHALL BE TAMPED. BACKFILL WITHIN THE RIGHT-OF-WAY AND UNDER PARKING AREAS AND SLABS SHALL BE 95% COMPACTION OF OPTIMUM MOISTURE.
  3. CONTRACTOR SHALL NOT OPEN, TURN OFF, INTERFERE WITH, OR ATTACH ANY PIPE OR HOSE TO OR TAP ANY WATER MAIN BELONGING TO THE CITY OF LEE'S SUMMIT UTILITIES DEPARTMENT UNLESS DULY AUTHORIZED TO DO SO. ANY ADVERSE CONSEQUENCE OF ANY SCHEDULED OR UNSCHEDULED DISRUPTIONS OF SERVICE TO THE PUBLIC ARE TO BE THE LIABILITY OF THE CONTRACTOR. **KAW VALLEY ENGINEERING AND OWNER ARE TO BE HELD HARMLESS.** CONTRACTOR SHALL NOTIFY THE UTILITIES DEPARTMENT 48 HOURS MINIMUM.
  4. CONTRACTOR TO INSTALL TRACING TAPE ALONG ALL NON-METALLIC SERVICE LINES PER SPECIFICATIONS.
  5. CONTRACTOR SHALL EXPOSE EXISTING UTILITIES AT LOCATIONS OF POSSIBLE CONFLICT AND POINTS OF CONNECTION PRIOR TO ANY CONSTRUCTION OF NEW UTILITIES.
  6. A MINIMUM HORIZONTAL DISTANCE SHALL BE MAINTAINED BETWEEN PARALLEL WATER AND SANITARY SEWER LINES. REFERENCE LEE'S SUMMIT SPECIFICATIONS, SECTIONS 3500 AND 3900
  7. CONTRACTOR TO SCHEDULE ALL INSPECTIONS FOR SEWER MAIN CONNECTIONS THROUGH THE PUBLIC WORKS DEPARTMENT.

**UTILITY STATEMENT:**

THE UNDERGROUND UTILITIES SHOWN HEREON ARE FROM FIELD SURVEY INFORMATION OF ONE-CALL LOCATED UTILITIES, FIELD SURVEY INFORMATION OF ABOVE GROUND OBSERVABLE EVIDENCE, AND/OR THE SCALING AND PLOTTING OF EXISTING UTILITY MAPS AND DRAWINGS AVAILABLE TO THE SURVEYOR AT THE TIME OF SURVEY. THE SURVEYOR MAKES NO GUARANTEE THAT THE UNDERGROUND UTILITIES SHOWN COMPRISE ALL SUCH UTILITIES IN THE AREA, EITHER IN SERVICE OR ABANDONED. FURTHERMORE, THE SURVEYOR DOES NOT WARRANT THAT THE UNDERGROUND UTILITIES SHOWN ARE IN THE EXACT LOCATION INDICATED ALTHOUGH HE DOES CERTIFY THAT THEY ARE LOCATED AS ACCURATELY AS POSSIBLE FROM INFORMATION AVAILABLE. THE SURVEYOR HAS NOT PHYSICALLY LOCATED THE UNDERGROUND UTILITIES BY EXCAVATION UNLESS OTHERWISE NOTED ON THIS SURVEY. MISSOURI ONE CALL TICKET #221653482 & #222143061 BLOOD HOUND WORK ORDER #202977

- NOTES:**
- 50 PROPOSED GAS SERVICE LINE (COORDINATE WITH MEP PLANS, SPIRE AND CONSTRUCTION MANAGER)
  - 60 STORM SEWER (SEE SHEET C600-C)
  - 65 CONTRACTOR TO RELOCATE DOWNSPOUT TO FACILITATE IMPROVEMENTS
  - 70 SANITARY SEWER MANHOLE
  - 71 SANITARY SEWER MAIN (SEE C700-C SERIES SHEETS)
  - 71A CONTRACTOR TO DISCONNECT AND REMOVE AND RELOCATE EXISTING SANITARY SERVICE LINE ROUTED EXTERIOR TO THE BUILDING AS NECESSARY TO CONSTRUCT THE BUILDING ADDITIONS AND SITE IMPROVEMENTS AS APPLICABLE REFER TO C500, C700 SHEETS AND MEP PLANS FOR ADDITIONAL INFORMATION.
  - 71B POINT OF CONNECTION AT SANITARY SEWER MAIN
  - 71C 6" WYE
  - 71D SANITARY SERVICE LINE UNDER BUILDING TO BE EXTENDED USING MATERIALS SUITABLE FOR UNDER SLAB PLUMBING (COORDINATE WITH MEP PLANS AND SPECIFICATIONS)
  - 72 SANITARY SEWER CLEANOUTS (SEE DETAIL ON SHEET C790-C)
  - 81 WATER MAIN UNDER BUILDING TO BE RELOCATED AS REQUIRED TO CONSTRUCT IMPROVEMENTS.
  - 83 RELOCATE EXISTING DOMESTIC WATERLINE AS REQUIRED TO CONSTRUCT IMPROVEMENTS. FIELD VERIFY SIZE AND MATERIAL. NEW MATERIALS SHALL MEET REQUIREMENTS OUTLINED IN THE CONSTRUCTION NOTES ON SHEET C520 AND PROJECT SPECIFICATIONS.
  - 85 CONTRACTOR TO RELOCATE EXISTING HYDRANT TO FACILITATE FIRE LANE ACCESS
  - 90 CONTRACTOR TO COORDINATE WITH LSR7 AND TO RELOCATE GUY ANCHOR OUTSIDE OF PROPOSED PAVEMENT
  - 91 MECHANICAL EQUIPMENT ON HOUSE KEEPING PAD (REFER TO MEP & STRUCTURAL SHEETS)

**NOTE:**

1. REFER TO SHEETS E001 THRU E004 FOR ADDITIONAL SITE ELECTRICAL AND TELECOM REQUIREMENTS FOR SITE ELECTRICAL, LIGHTING AND SIGNAGE.
2. ALL WATER SERVICE INSTALLATIONS INCLUDING BACKFLOW DEVICES ARE SUBJECT TO FIELD VERIFICATION AND APPROVAL BY THE WATER DEPARTMENT INSPECTOR.

**NOTE:**

1. CONTRACTOR SHALL REFER TO ARCHITECTURAL PLANS FOR EXACT LOCATIONS AND DIMENSIONS OF ENTRANCE, SLOPED PAVING, EXIT PORCHES, RAMPS, TRUCK DOCKS, PRECISE BUILDING DIMENSIONS AND EXACT BUILDING UTILITY ENTRANCE LOCATIONS.
2. THESE PLANS HAVE NOT BEEN VERIFIED WITH FINAL ARCHITECTURAL CONTRACT DRAWINGS. CONTRACTOR SHALL VERIFY AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES. CONTRACTOR IS FULLY RESPONSIBLE FOR REVIEW AND COORDINATION OF ALL DRAWINGS AND CONTRACTOR DOCUMENTS.

**SAFETY NOTICE TO CONTRACTOR**

IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, THE CONTRACTOR WILL BE SOLELY AND COMPLETELY RESPONSIBLE FOR CONDITIONS OF THE JOB SITE, INCLUDING SAFETY OF ALL PERSONS AND PROPERTY DURING PERFORMANCE OF THE WORK. THIS REQUIREMENT WILL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS.

**WARRANTY / DISCLAIMER**

THE DESIGNS REPRESENTED IN THESE PLANS ARE IN ACCORDANCE WITH ESTABLISHED PRACTICES OF CIVIL ENGINEERING FOR THE DESIGN FUNCTIONS AND USES INTENDED BY THE OWNER AT THIS TIME. HOWEVER, NEITHER KAW VALLEY ENGINEERING, INC NOR ITS PERSONNEL CAN OR DO WARRANTY THESE DESIGNS OR PLANS AS CONSTRUCTED, EXCEPT IN THE SPECIFIC CASES WHERE KAW VALLEY ENGINEERING PERSONNEL INSPECT AND CONTROL THE PHYSICAL CONSTRUCTION ON A CONTINUOUS BASIS AT THE SITE.

**CAUTION - NOTICE TO CONTRACTOR**

THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES AS SHOWN ON THESE PLANS IS BASED ON RECORDS OF THE VARIOUS UTILITY COMPANIES AND, WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THE INFORMATION IS NOT TO BE RELIED ON AS BEING EXACT OR COMPLETE. THE CONTRACTOR MUST CALL THE APPROPRIATE UTILITY COMPANY AT LEAST 72 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATION OF UTILITIES. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH PROPOSED IMPROVEMENTS SHOWN ON THE PLANS.

**THE CONTRACTOR SHALL EXPOSE EXISTING UTILITIES AT LOCATIONS OF POSSIBLE CONFLICTS PRIOR TO ANY CONSTRUCTION.**

- LEGEND:**
- AIR CONDITIONER
  - WALL MOUNTED ELECTRICAL OUTLET
  - UNDERGROUND GAS
  - GAS METER
  - CONTROL POINT
  - BENCHMARK
  - GATE POST
  - CHAIN LINK FENCE
  - WOOD FENCE
  - BOLLARD
  - STREET/TRAFFIC SIGN
  - PAINTED DIRECTIONAL ARROW
  - TURN LANE DIRECTION
  - HANDICAP SYMBOL
  - PARKING STALL COUNT
  - HANDICAP SIGN
  - HANDICAP RAMP
  - HRMP
  - WHEEL STOP
- PROPOSED LEGEND:**
- DUCTILE IRON PIPE
  - HIGH DENSITY POLYETHYLENE
  - WALL MOUNTED LIGHT
  - WALL MOUNTED CAMERA
  - GAS VALVE
  - GAS RISER
  - GAS LINE SIGN
  - DOOR ELEVATION AT THRESHOLD
  - FINISH FLOOR ELEVATION
  - BUILDING HEIGHT/ELEVATION
  - BACK TO BACK OF CURB MEASUREMENT
  - EDGE TO EDGE OF ASPHALT
  - WATER METER
  - WATER LINE GATE VALVE
  - FIRE HYDRANT
  - SPRINKLER CONTROL BOX
  - WATER MANHOLE
  - OVERHEAD UTILITY LINE (# OF LINES)
  - PULL BOX
  - LIGHT POLE
  - UTILITY POLE
  - UTILITY POLE W/ LIGHT
  - UTILITY POLE W/ TRANSFORMER
  - GUY ANCHOR
  - CONIFEROUS TREE
  - TREE LINE
  - FLAG POLE
  - ELECTRIC METER
  - UNDERGROUND ELECTRIC PEDESTAL
  - SPEAKER BOX
  - BREAKER BOX
  - TELEPHONE PEDESTAL
  - SANITARY SEWER MANHOLE
  - STORM SEWER MANHOLE
  - AREA INLET
  - CURB INLET
  - SANITARY SEWER CLEAN OUT
  - DRAIN SPOUT
  - FLOOR DRAIN
  - FLARED END SECTION
  - SPRINKLER VALVE
  - SIAMSE FIRE CONNECTOR
  - CANOPY SUPPORT
  - MAIL BOX
  - CONCRETE JOUT/OUT LINE
  - BUSH
  - DECIDUOUS TREE
  - TRASH ENCLOSURE
  - LANDSCAPING AREA
  - CONCRETE
  - LOWEST WIRE HEIGHT
  - ASPHALT EDGE TREATMENT. SEE SECTION ON C190
  - ASPHALT OVERLAY (040)
  - AREAS OF FULL DEPTH ASPHALT (040)
  - TURF
  - CONCRETE PAVEMENT (042) W/Jointing
  - CONCRETE SIDEWALK (055+005) W/Jointing
  - CONCRETE SIDEWALK (055+005) W/Jointing
  - LANDING
  - RAMP
  - TRANSITION
  - PROJECT AREA (LIMITS OF DISTURBANCE)



PROJ. NO. C20-0496-1DSN: CJC  
CFN: 0496-TUP

CHRISTIAN J. CROWDER  
ENGINEER  
MO # 2015000538

14700 WEST 114TH TERRACE  
LENEXA, KANSAS 66215  
PH. (913) 894-5150 | FAX (913) 894-5977  
lx@kveg.com | www.kveg.com

**KAW VALLEY ENGINEERING**

KAW VALLEY ENGINEERING, INC., IS AUTHORIZED TO OFFER ENGINEERING SERVICES BY MISSOURI STATE CERTIFICATE OF AUTHORITY # 000842. EXPIRES 12/31/23

**multistudio**  
the evolution of gould evans

**Lee's Summit Robotics, Gic & Phys Educaiton**

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100

owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect: Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816-931-6655  
multi-studio

civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveg.com

structural engineer: Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEPFI/Code: Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

Issue Date: September 9, 2022

Revisions	NUMBER	DESCRIPTION	DATE
-----------	--------	-------------	------

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

**UTILITY PLAN**

**C500-C**



Lee's Summit Robotics,  
Gic & Phys Educaiton

LSN: 901 NE Douglas St., Lee's Summit MO  
64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO  
64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100


owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816-931.6655  
multi-studio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com

structural engineer:  
Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEPFI/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

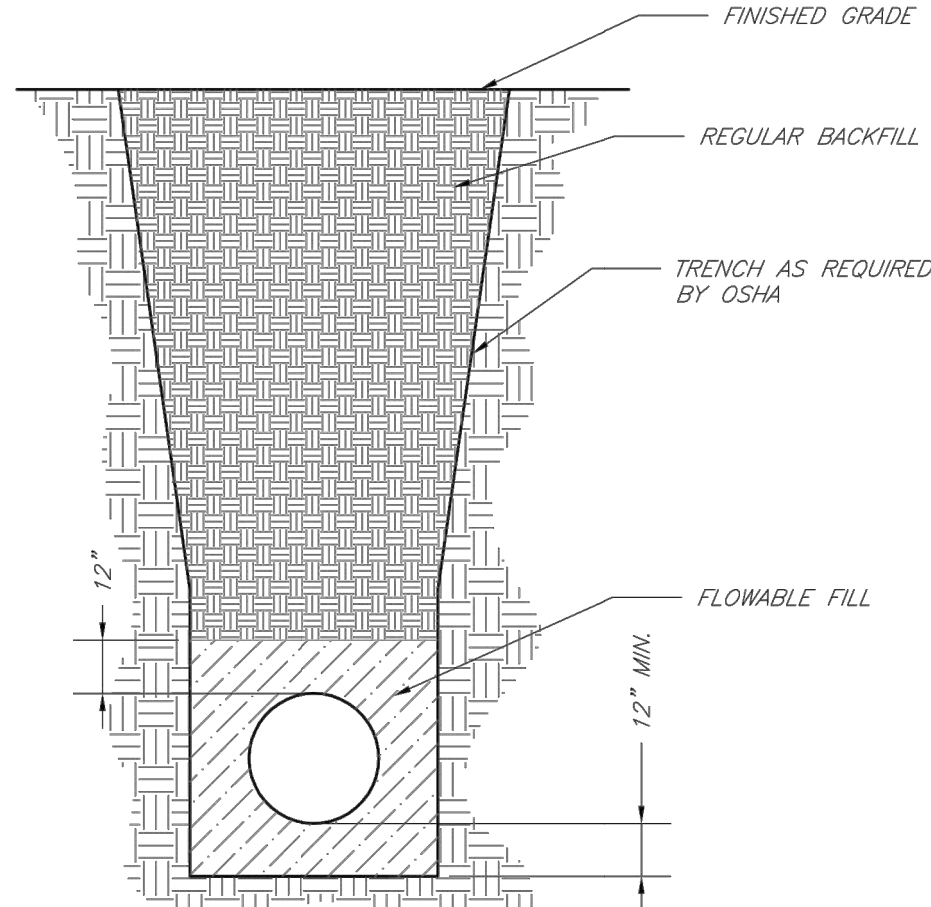

- NOTES:
1. FLOWABLE FILL SHALL MEET THE REQUIREMENTS OF THE CITY OF LEE'S SUMMIT DESIGN AND CONSTRUCTION MANUAL.
  2. REGULAR BACKFILL ABOVE THE TRENCH CHECK SHALL BE FREE OF DEBRIS, ORGANIC MATTER, AND STONES > 6" IN ANY DIMENSION.
  3. TOP OF FLOWABLE BACKFILL SHALL EXTEND 12" ABOVE THE TOP OF THE PIPE.
  4. LENGTH OF TRENCH CHECK SHALL BE A MINIMUM OF 12'.




LEE'S SUMMIT  
MISSOURI

PUBLIC WORKS ENGINEERING DIVISION | 230 SE GREEN STREET | LEE'S SUMMIT, MO 64063

TRENCH CHECK

Date: 02/13  
Drawn By: JN  
Checked By: DL  
FILE: WAT-6  
Rev: 1/14  
Rev:

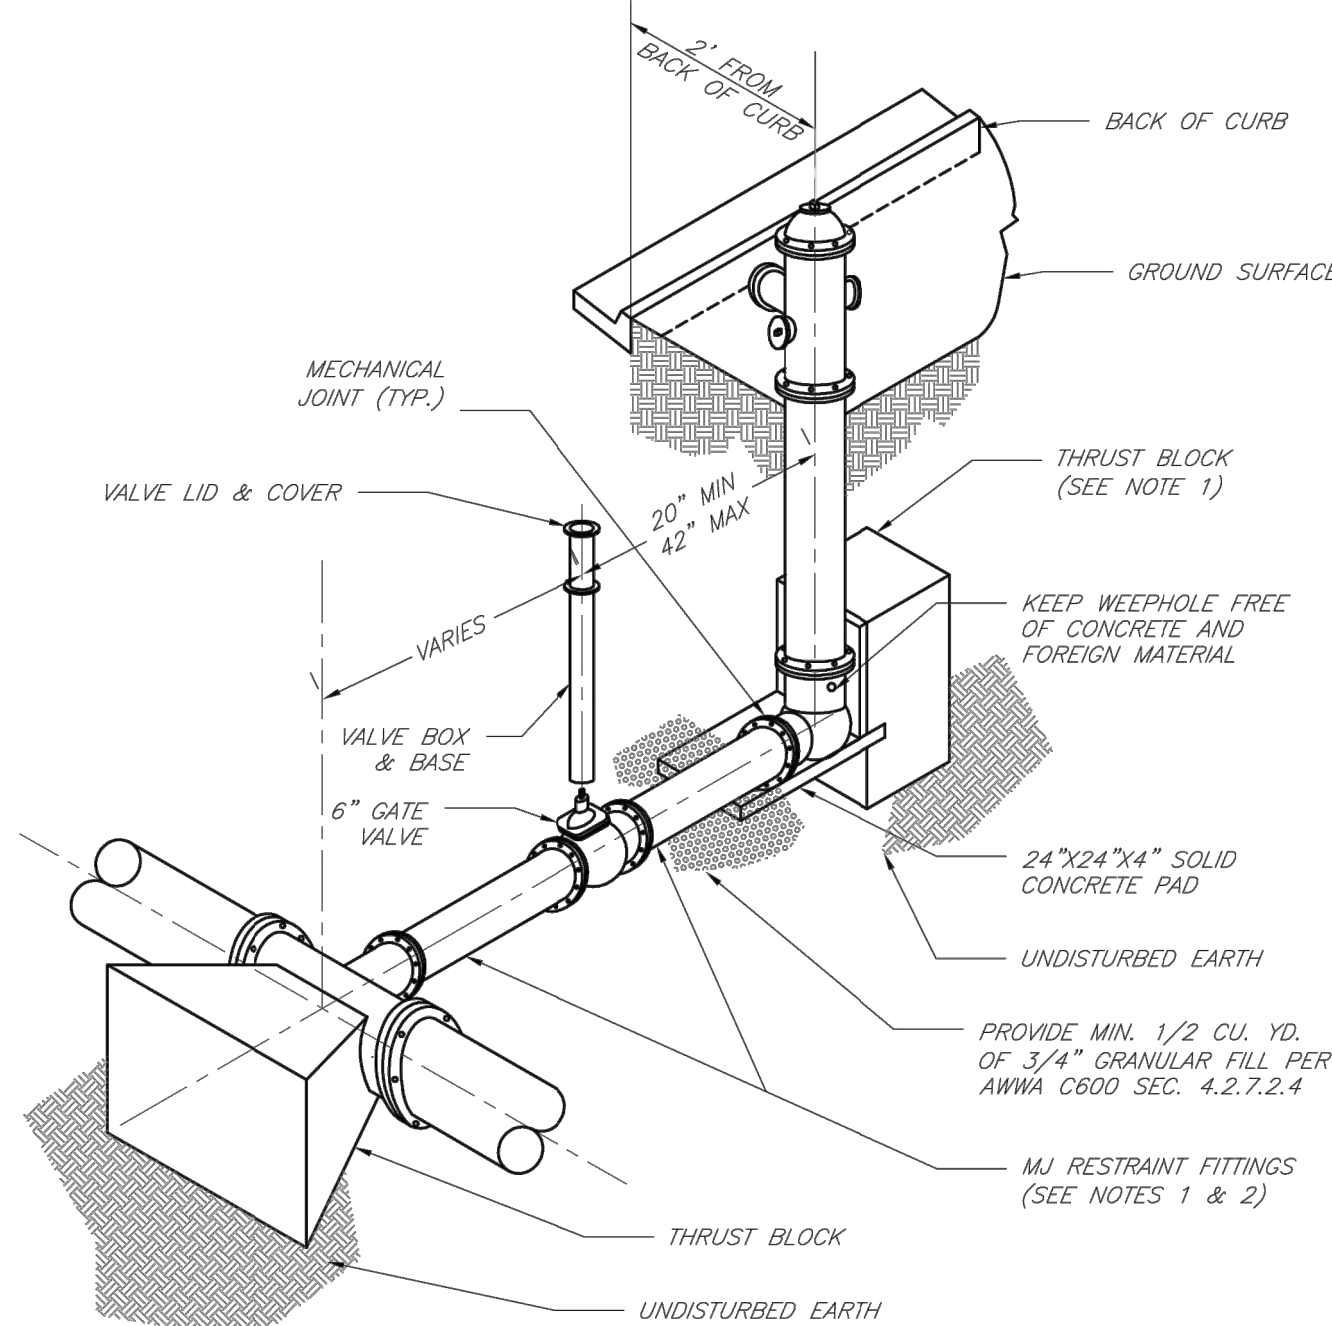

- NOTES:
1. WHEN RETAINER GLANDS ARE USED IN LIEU OF MECHANICAL JOINT (MJ) RESTRAINT FITTINGS, HORIZONTAL THRUST BLOCKS ARE REQUIRED.
  2. GATE VALVE MAY BE BOLTED DIRECTLY TO MJ RESTRAINT TEE.
  3. SEE APPROVED PRODUCTS LIST FOR WATER UTILITIES FOR FIRE HYDRANT, VALVES, VALVE BOX LID, AND COVER.
  4. BOTTOM HYDRANT FLANGE SHALL BE 2" TO 6" ABOVE FINISHED GRADE.
  5. FOR STREETS WITHOUT CURBS FIRE HYDRANTS SHALL BE PLACED WITHIN 1 FOOT OF THE R/W LINE, BUT NOT MORE THAN 10' FROM EDGE OF PAVEMENT. FIRE HYDRANT SHALL NOT BE PLACED IN BOTTOM OF DITCH.
  6. HYDRANT SHALL BE ROTATED AS DIRECTED BY INSPECTOR.



LEE'S SUMMIT  
MISSOURI

PUBLIC WORKS ENGINEERING DIVISION | 230 SE GREEN STREET | LEE'S SUMMIT, MO 64063

HYDRANT INSTALLATION - STRAIGHT SET

Date: 02/13  
Drawn By: JN  
Checked By: DL  
FILE: WAT-7  
Rev: 1/14  
Rev:

Issue Date: September 9, 2022

Revisions		
NUMBER	DESCRIPTION	DATE

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS  
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR  
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



Kaw Valley Engineering, Inc.  
Missouri Certificate of Authority: 000842  
Christian Crowder Date: 9/9/2022  
Engineer License No. PE-2015000538

UTILITY DETAILS

C590-C

PROJ. NO. C20\_0496-1 DSN: CJC  
CFN: 0496-TDET DWN: N/JN

CHRISTIAN J. CROWDER  
ENGINEER  
MO # 2015000538

14700 WEST 114TH TERRACE  
LENEXA, KANSAS 66215  
PH. (913) 894-5150 | FAX (913) 894-5977  
lx@kveng.com | www.kveng.com

**KV KAW VALLEY ENGINEERING**

KAW VALLEY ENGINEERING, INC., IS AUTHORIZED TO OFFER  
ENGINEERING SERVICES BY MISSOURI STATE CERTIFICATE OF  
AUTHORITY # 000842. EXPIRES 12/31/23



Lee's Summit Robotics,  
Gic & Phys Educaiton

LSN: 901 NE Douglas St., Lee's Summit MO  
64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO  
64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multistudio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com

structural engineer:  
Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-enr.com

MEP/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

## STORM SEWER CONSTRUCTION NOTES:

- ALL WORK SHALL BE COMPLETED IN ACCORDANCE WITH SECTION 2600 STORM SEWER OF THE KANSAS CITY METRO CHAPTER OF APWA SPECIFICATIONS AS ADOPTED AND AMENDED BY THE CITY OF PLATE CITY, MISSOURI STANDARD SPECIFICATIONS. REFERENCE APWA SPECIFICATION SECTION 2102.4 FOR EXCAVATION, TRENCHING AND BACKFILLING FOR PIPE AND STORM STRUCTURES. REFER TO PROJECT GEOTECHNICAL REPORT AND PROJECT SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
- A MINIMUM OF 18" COVER SHALL BE PROVIDED PRIOR TO AND MAINTAINED AFTER INSTALLATION OF STORM SEWER.
- ALL COORDINATES FOR CURB INLETS ARE TO THE MIDDLE OF THE INSIDE FRONT FACE. ALL COORDINATES FOR PVC STRUCTURES AND CONCRETE YARD INLETS ARE TO THE CENTER OF THE STRUCTURE.
- ALL JUNCTION BOXES/AREA INLETS HAVE ONE COORDINATE PROVIDED AT THE CENTER OF STRUCTURE. SEE PLAN FOR CLARIFICATION. ORIENT STRUCTURES PARALLEL TO ADJACENT CURB, BUILDING OR WALL FACE, UNLESS NOTED OTHERWISE.
- RIM ELEVATION IS PROVIDED AT COORDINATE, UNLESS NOTED OTHERWISE. CONTRACTOR TO ADJUST ELEVATION OF RIM AS REQUIRED TO MATCH SLOPE OF ADJACENT CURB LINE. REFER TO GRADING PLAN (C3.0 SERIES SHEETS).
- ALL EXISTING UTILITIES INDICATED ON THE DRAWING ARE ACCORDING TO THE BEST INFORMATION AVAILABLE TO THE ENGINEER; HOWEVER, ALL UTILITIES ACTUALLY EXISTING MAY NOT BE SHOWN. UTILITIES DAMAGED THROUGH THE NEGLIGENCE OF THE CONTRACTOR TO OBTAIN THE LOCATION OF SAME SHALL BE REPAIRED OR REPLACED BY THE CONTRACTOR AT THEIR EXPENSE.
- ALL BACKFILL SHALL BE COMPACTED TO 95 PERCENT STANDARD DENSITY AT OPTIMUM MOISTURE.
- ALL EXCAVATION BENEATH THE STREETS AND PARKING LOTS FOR DRAINAGE PIPE LESS THAN 4'-0" IN DIAMETER SHALL BE BACKFILLED WITH AGGREGATE TO FOUR FEET (4') PAST BACK OF CURB IN ACCORDANCE WITH APWA SPECIFICATIONS SECTION 2102.4J.
- RELOCATION OF ANY WATER LINE, SEWER LINE OR SERVICE LINE THEREOF REQUIRED FOR THE CONSTRUCTION OF THIS PROJECT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR AND SHALL BE AT THEIR EXPENSE.
- IF PRECAST STORM STRUCTURES ARE TO BE USED ON THIS PROJECT, THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS AND HAVE THEM APPROVED BY THE ENGINEER PRIOR TO FABRICATION OF THE STRUCTURES. FAILURE TO DO SO SHALL BE CAUSE FOR REJECTION.
- ALL HDPE PIPE JOINTS SHALL BE WATER TIGHT.

## UTILITY NOTES:

- EXCAVATION, TRENCHING AND BACKFILL SHALL BE COMPLETED IN ACCORDANCE WITH SECTION 2100 GRADING AND SITE PREPARATION OF THE KANSAS CITY METROPOLITAN CHAPTER OF APWA SPECIFICATIONS AS ADOPTED AND AMENDED BY THE CITY OF LEE'S SUMMIT.
- ALL BACKFILL SHALL BE TAMPED. BACKFILL WITHIN THE RIGHT-OF-WAY AND UNDER PARKING AREAS AND SLABS SHALL BE 95% COMPACTION OF OPTIMUM MOISTURE.
- CONTRACTOR SHALL NOT OPEN, TURN OFF, INTERFERE WITH, OR ATTACH ANY PIPE OR HOSE TO OR TAP ANY WATER MAIN BELONGING TO THE CITY OF LEE'S SUMMIT UNLESS DULY AUTHORIZED TO DO SO. ANY ADVERSE CONSEQUENCE OF ANY SCHEDULED OR UNSCHEDULED DISRUPTIONS OF SERVICE TO THE PUBLIC ARE TO BE THE LIABILITY OF THE CONTRACTOR. **KAW VALLEY ENGINEERING AND OWNER ARE TO BE HELD HARMLESS.** CONTRACTOR SHALL NOTIFY THE KCMO WSD 48 HOURS MINIMUM.
- CONTRACTOR TO INSTALL TRACING TAPE ALONG ALL NON-METALLIC SERVICE LINES PER SPECIFICATIONS.
- CONTRACTOR SHALL EXPOSE EXISTING UTILITIES AT LOCATIONS OF POSSIBLE CONFLICT AND POINTS OF CONNECTION PRIOR TO ANY CONSTRUCTION OF NEW UTILITIES.
- A MINIMUM HORIZONTAL DISTANCE OF 10' SHALL BE MAINTAINED BETWEEN PARALLEL WATER AND SANITARY SEWER LINES. REFERENCE APWA SPECIFICATIONS AS ADOPTED AND AMENDED BY THE CITY OF LEE'S SUMMIT.
- CONTRACTOR TO SCHEDULE ALL INSPECTIONS FOR SEWER MAIN CONNECTIONS THROUGH THE PUBLIC WORKS DEPARTMENT.

## WARRANTY / DISCLAIMER

THE DESIGNS REPRESENTED IN THESE PLANS ARE IN ACCORDANCE WITH ESTABLISHED PRACTICES OF CIVIL ENGINEERING FOR THE DESIGN FUNCTIONS AND USES INTENDED BY THE OWNER AT THIS TIME. HOWEVER, NEITHER KAW VALLEY ENGINEERING, INC NOR ITS PERSONNEL CAN OR DO WARRANTY THESE DESIGNS OR PLANS AS CONSTRUCTED, EXCEPT IN THE SPECIFIC CASES WHERE KAW VALLEY ENGINEERING PERSONNEL INSPECT AND CONTROL THE PHYSICAL CONSTRUCTION ON A TEMPORARY BASIS AT THE SITE.

## CAUTION - NOTICE TO CONTRACTOR

THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES AS SHOWN ON THESE PLANS IS BASED ON RECORDS OF THE VARIOUS UTILITY COMPANIES AND, WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THE INFORMATION IS NOT TO BE RELIED ON AS BEING EXACT OR COMPLETE. THE CONTRACTOR MUST CALL THE APPROPRIATE UTILITY COMPANY AT LEAST 72 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATION OF UTILITIES. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH PROPOSED IMPROVEMENTS SHOWN ON THE PLANS.

**THE CONTRACTOR SHALL EXPOSE EXISTING UTILITIES AT LOCATIONS OF POSSIBLE CONFLICTS PRIOR TO ANY CONSTRUCTION.**

## SAFETY NOTICE TO CONTRACTOR

IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, THE CONTRACTOR WILL BE SOLELY AND COMPLETELY RESPONSIBLE FOR CONDITIONS OF THE JOB SITE, INCLUDING SAFETY OF ALL PERSONS AND PROPERTY DURING PERFORMANCE OF THE WORK. THIS REQUIREMENT WILL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS.

Issue Date: September 9, 2022

NUMBER	DESCRIPTION	DATE
1	ADDENDUM 2	9/23/2022


UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION.




Kaw Valley Engineering, Inc.  
Missouri Certificate of Authority: 000842  
Christian Crowder Date: 9/23/2022  
Engineer License No. PE-2015000538

STORM SEWER PLAN &  
PROFILE

C600-C

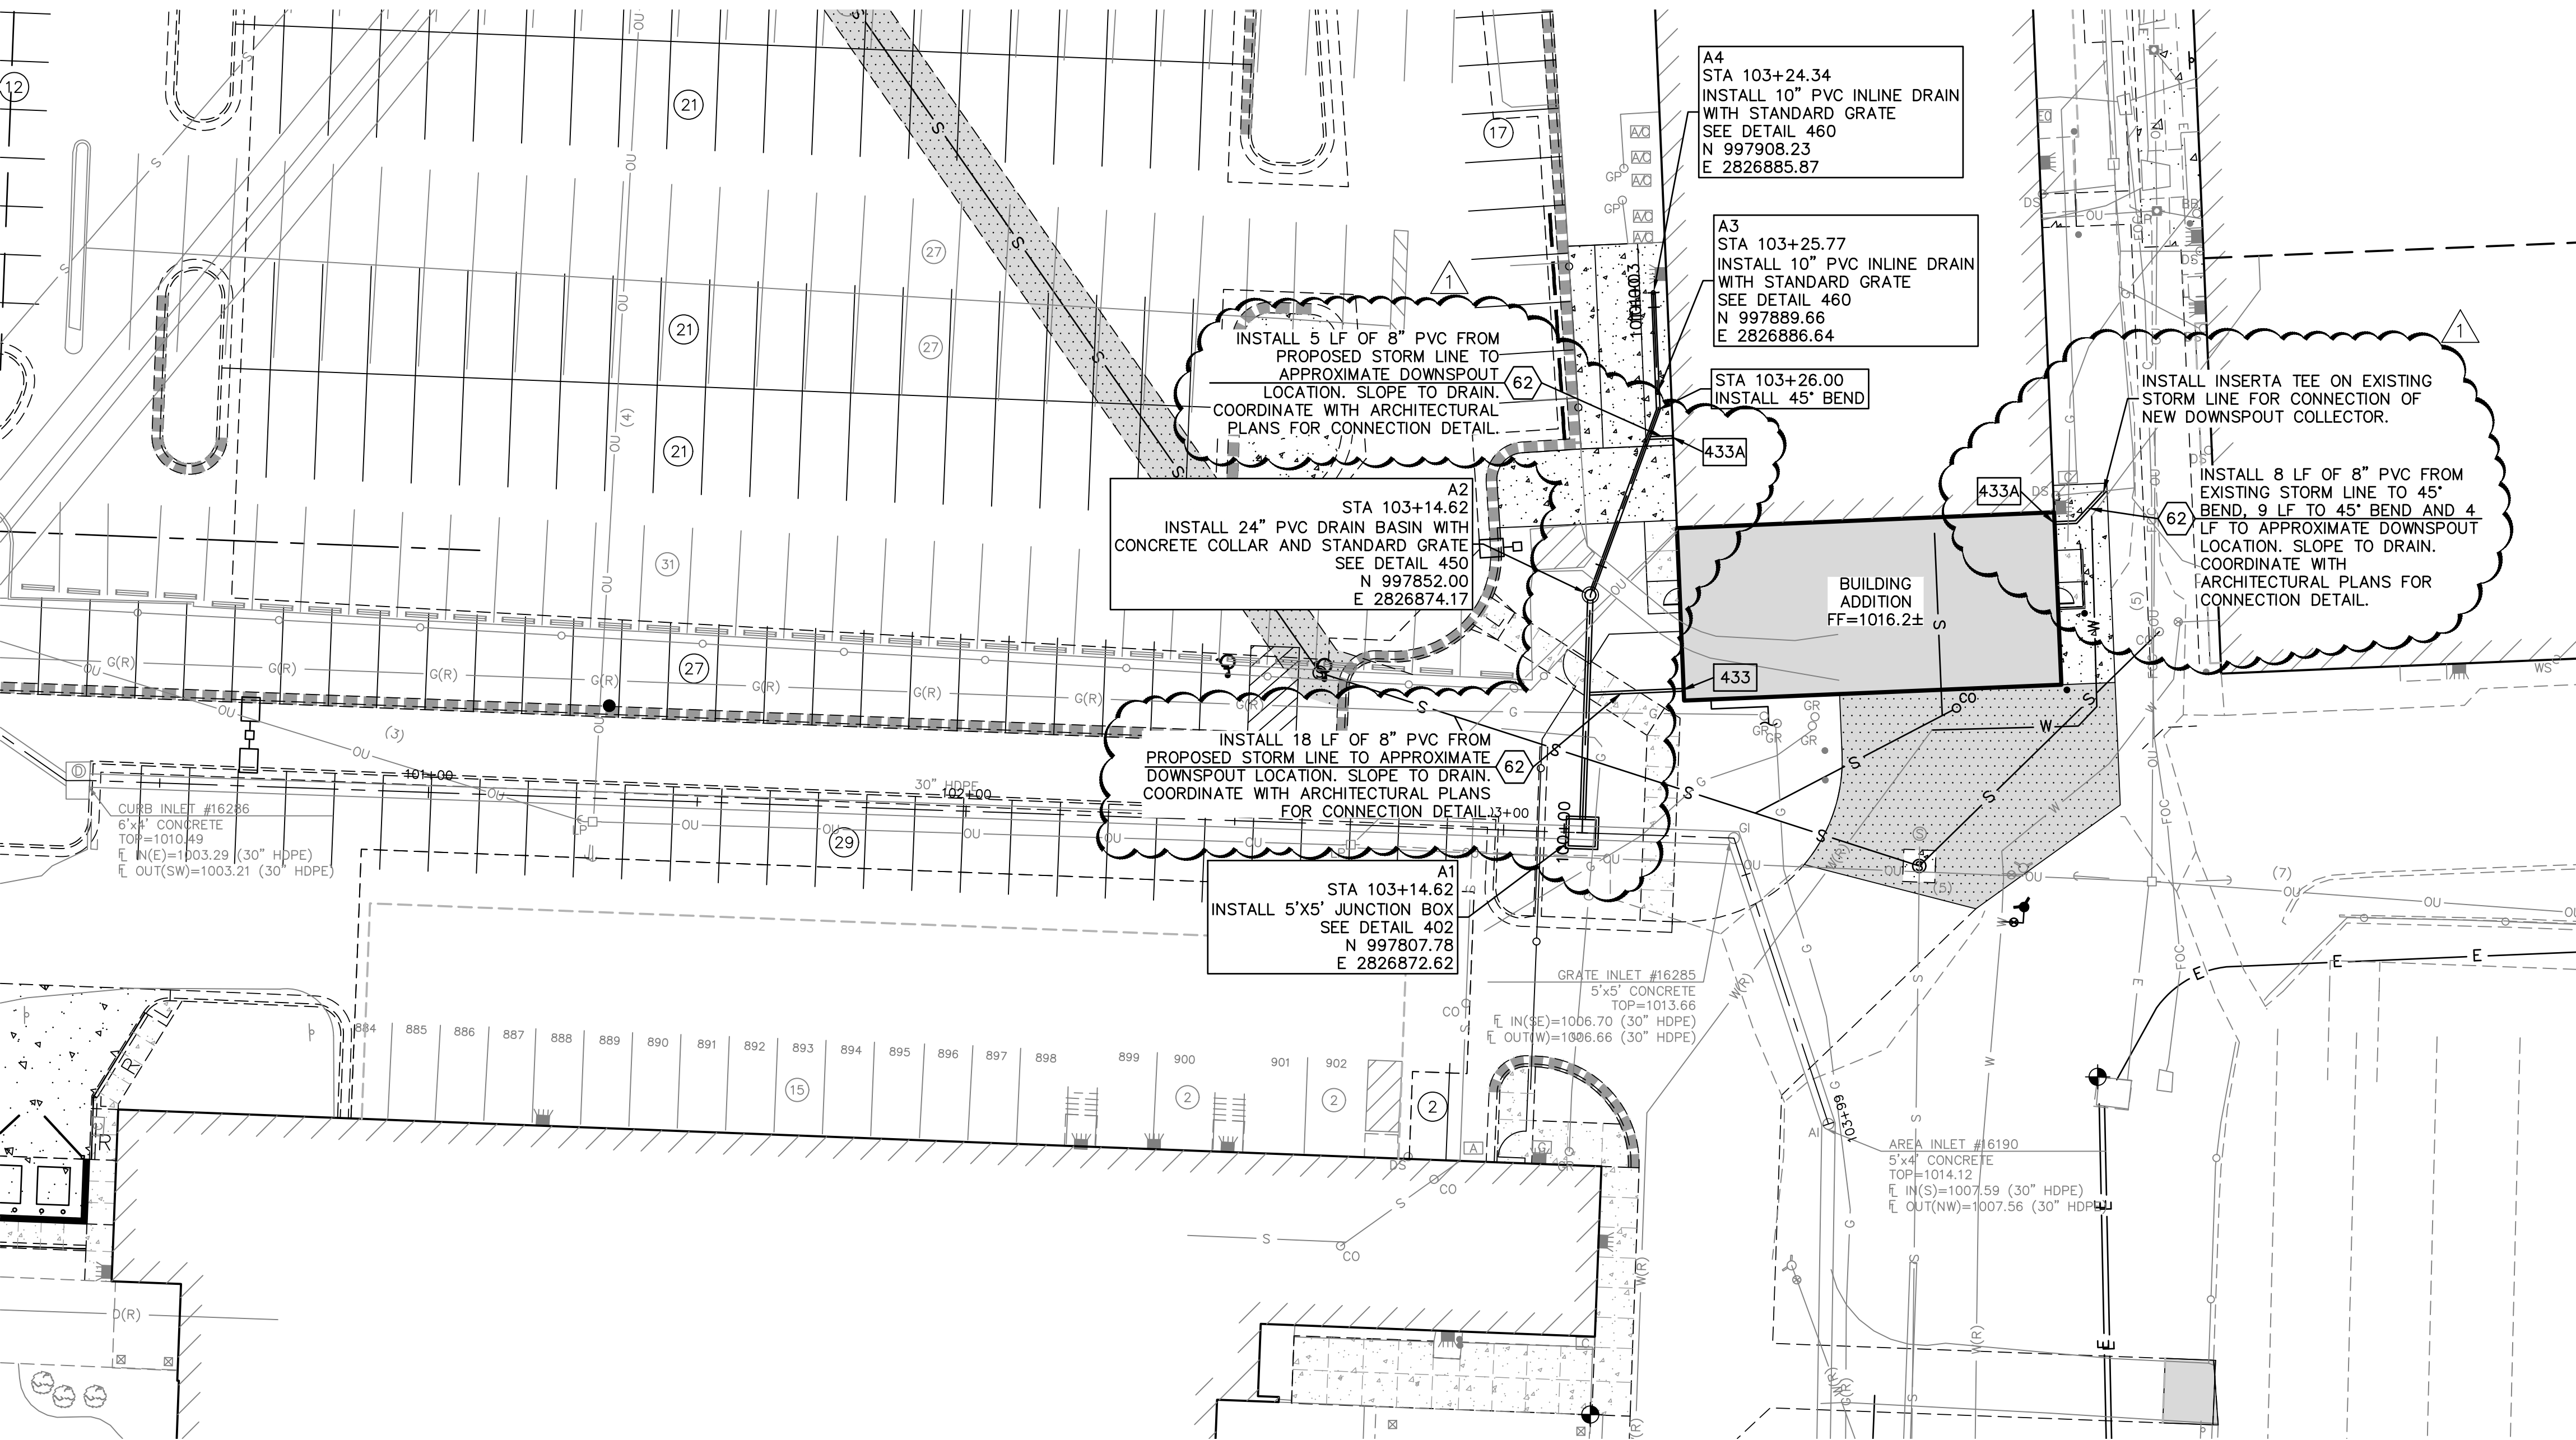

PROPOSED STORM SEWER LINE A PLAN

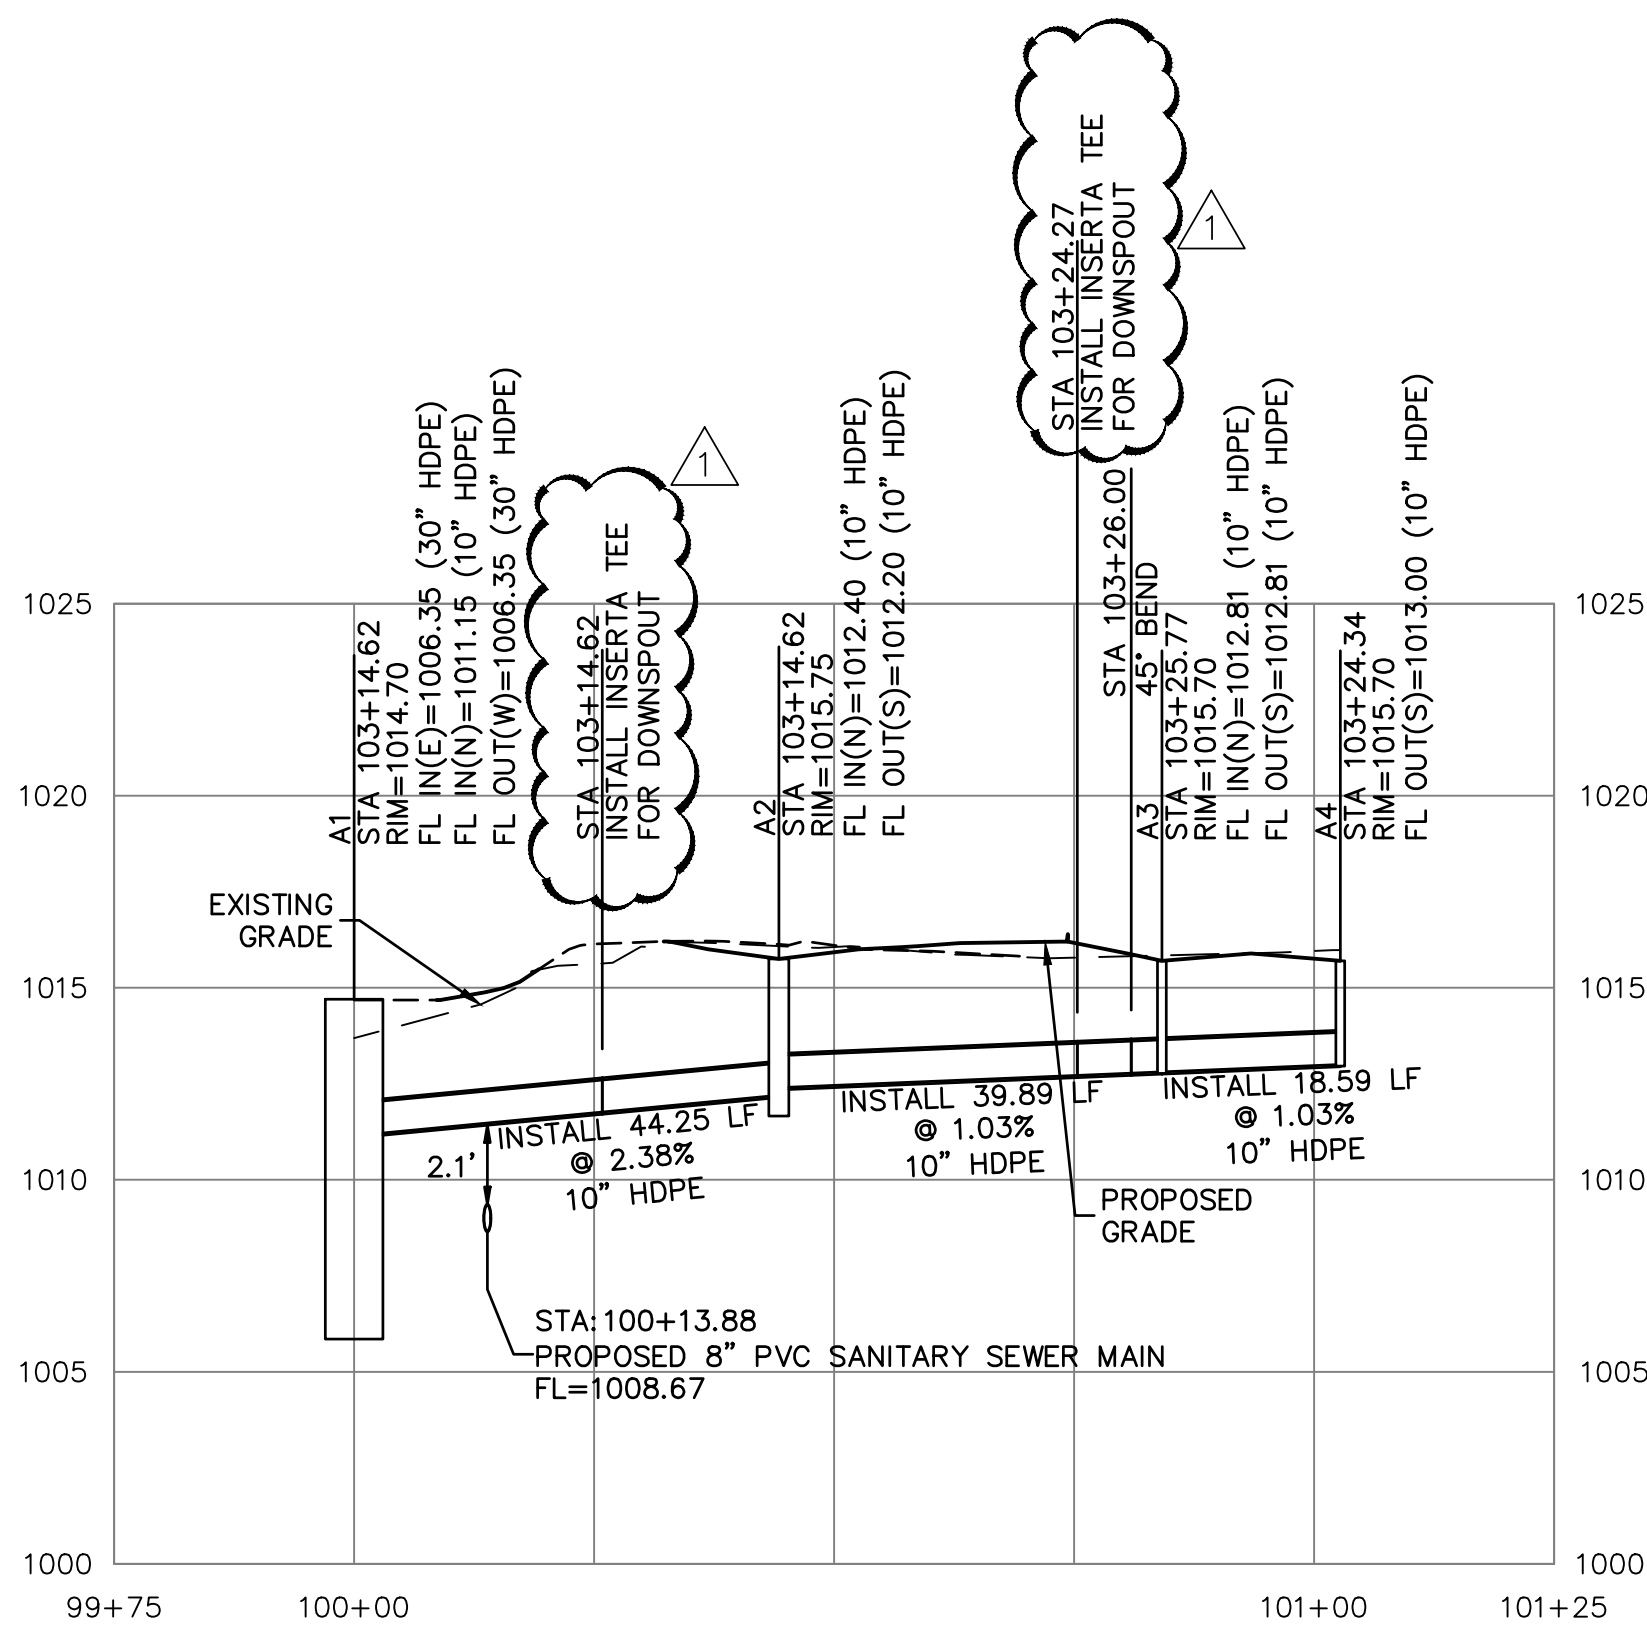

PROPOSED STORM SEWER LINE A PROFILE

DETAILS SEE SHEET C690-C

402 CONCRETE JUNCTION BOX  
433 DOWNSPOUT COLLECTOR  
433A MODIFIED DOWNSPOUT COLLECTOR  
450 PVC DRAIN BASIN  
460 PVC INLINE DRAIN

## NOTES

- 62 PVC SDR-26 ROOF DRAIN, IF DRAIN IS LESS THAN 2' USE SCHEDULE 40 PVC FOR THE ENTIRE RUN. SLOPE TO DRAIN (1% MINIMUM FOR 6" AND LARGER ROOF DRAINS, 2% MINIMUM FOR 4" ROOF DRAINS)

Know what's below.  
Call before you dig.

PROJ. NO. C20\_0496-1DSN: CJC CHRISTIAN J. CROWDER  
CFN: 0496-1DPP DWN: NUN ENGINEER  
MO # 2015000538  
14700 WEST 114TH TERRACE  
LENEXA, KANSAS 66215  
PH. (913) 894-5150 | FAX (913) 894-5977  
lx@kveng.com | www.kveng.com

**KV KAW VALLEY ENGINEERING**

KAW VALLEY ENGINEERING, INC., IS AUTHORIZED TO OFFER ENGINEERING SERVICES BY MISSOURI STATE CERTIFICATE OF AUTHORITY # 000842. EXPIRES 12/31/23



**Lee's Summit Robotics,  
Gic & Phys Educaiton**

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0321-0100



owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect: Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi-studio

civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com

structural engineer: Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEPFI/Code: Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

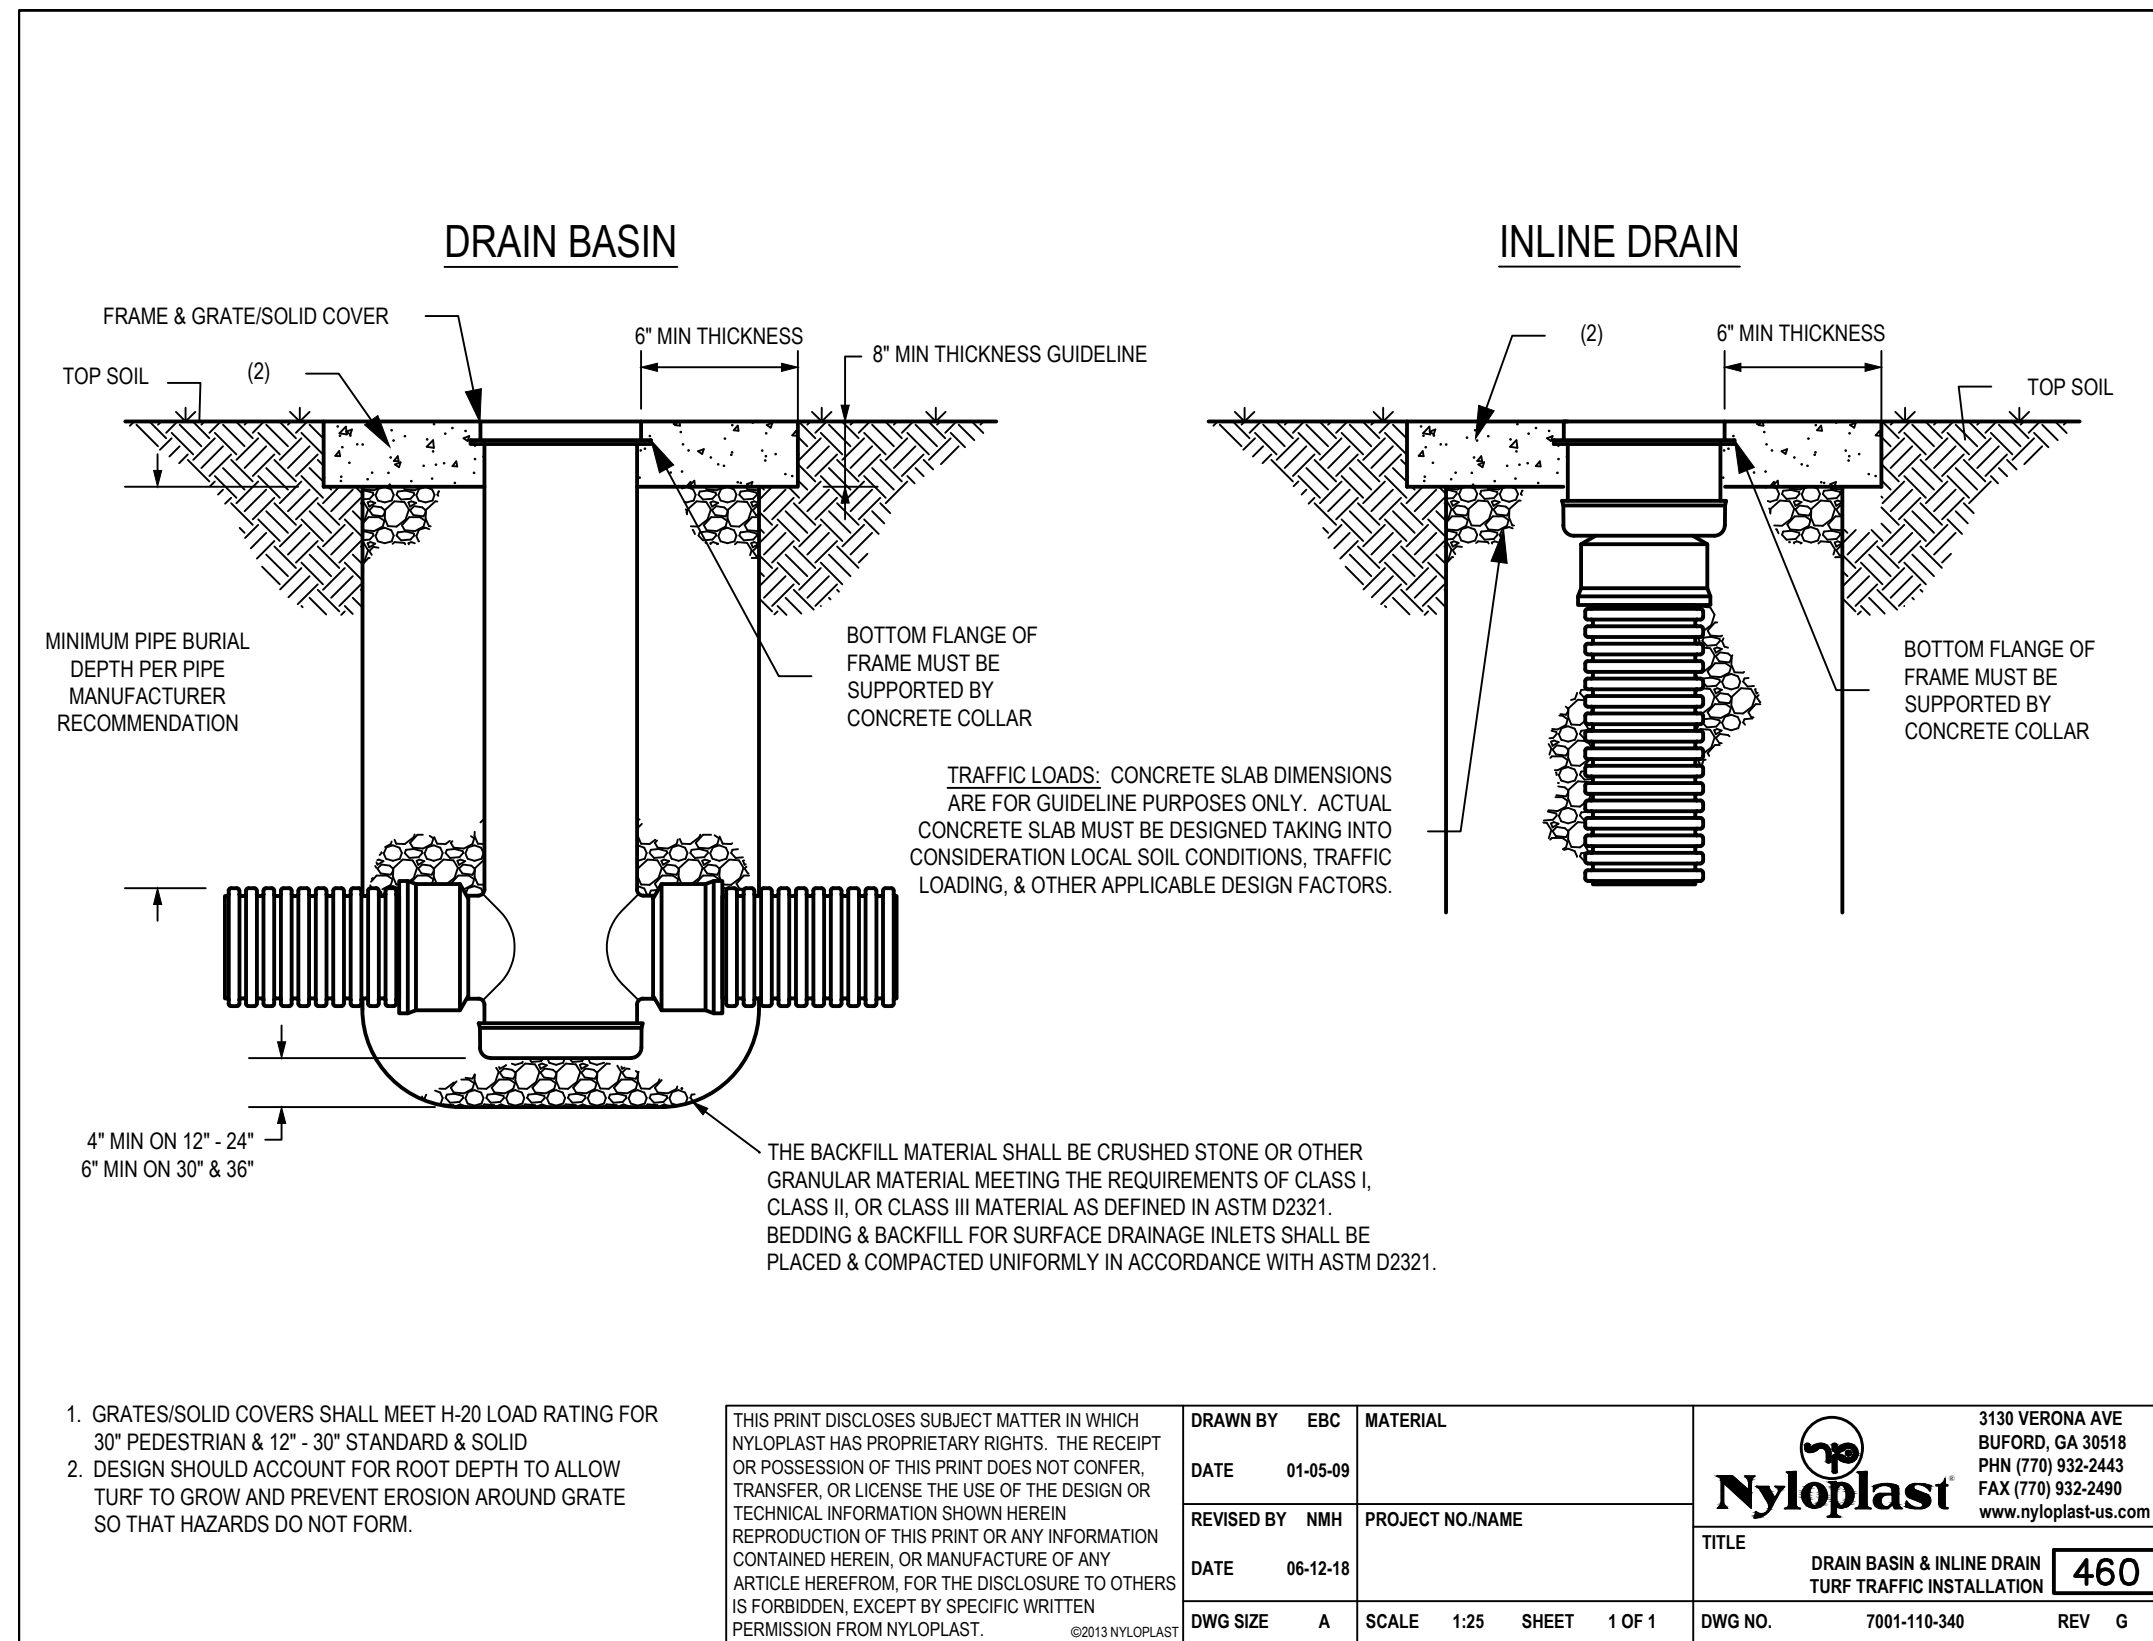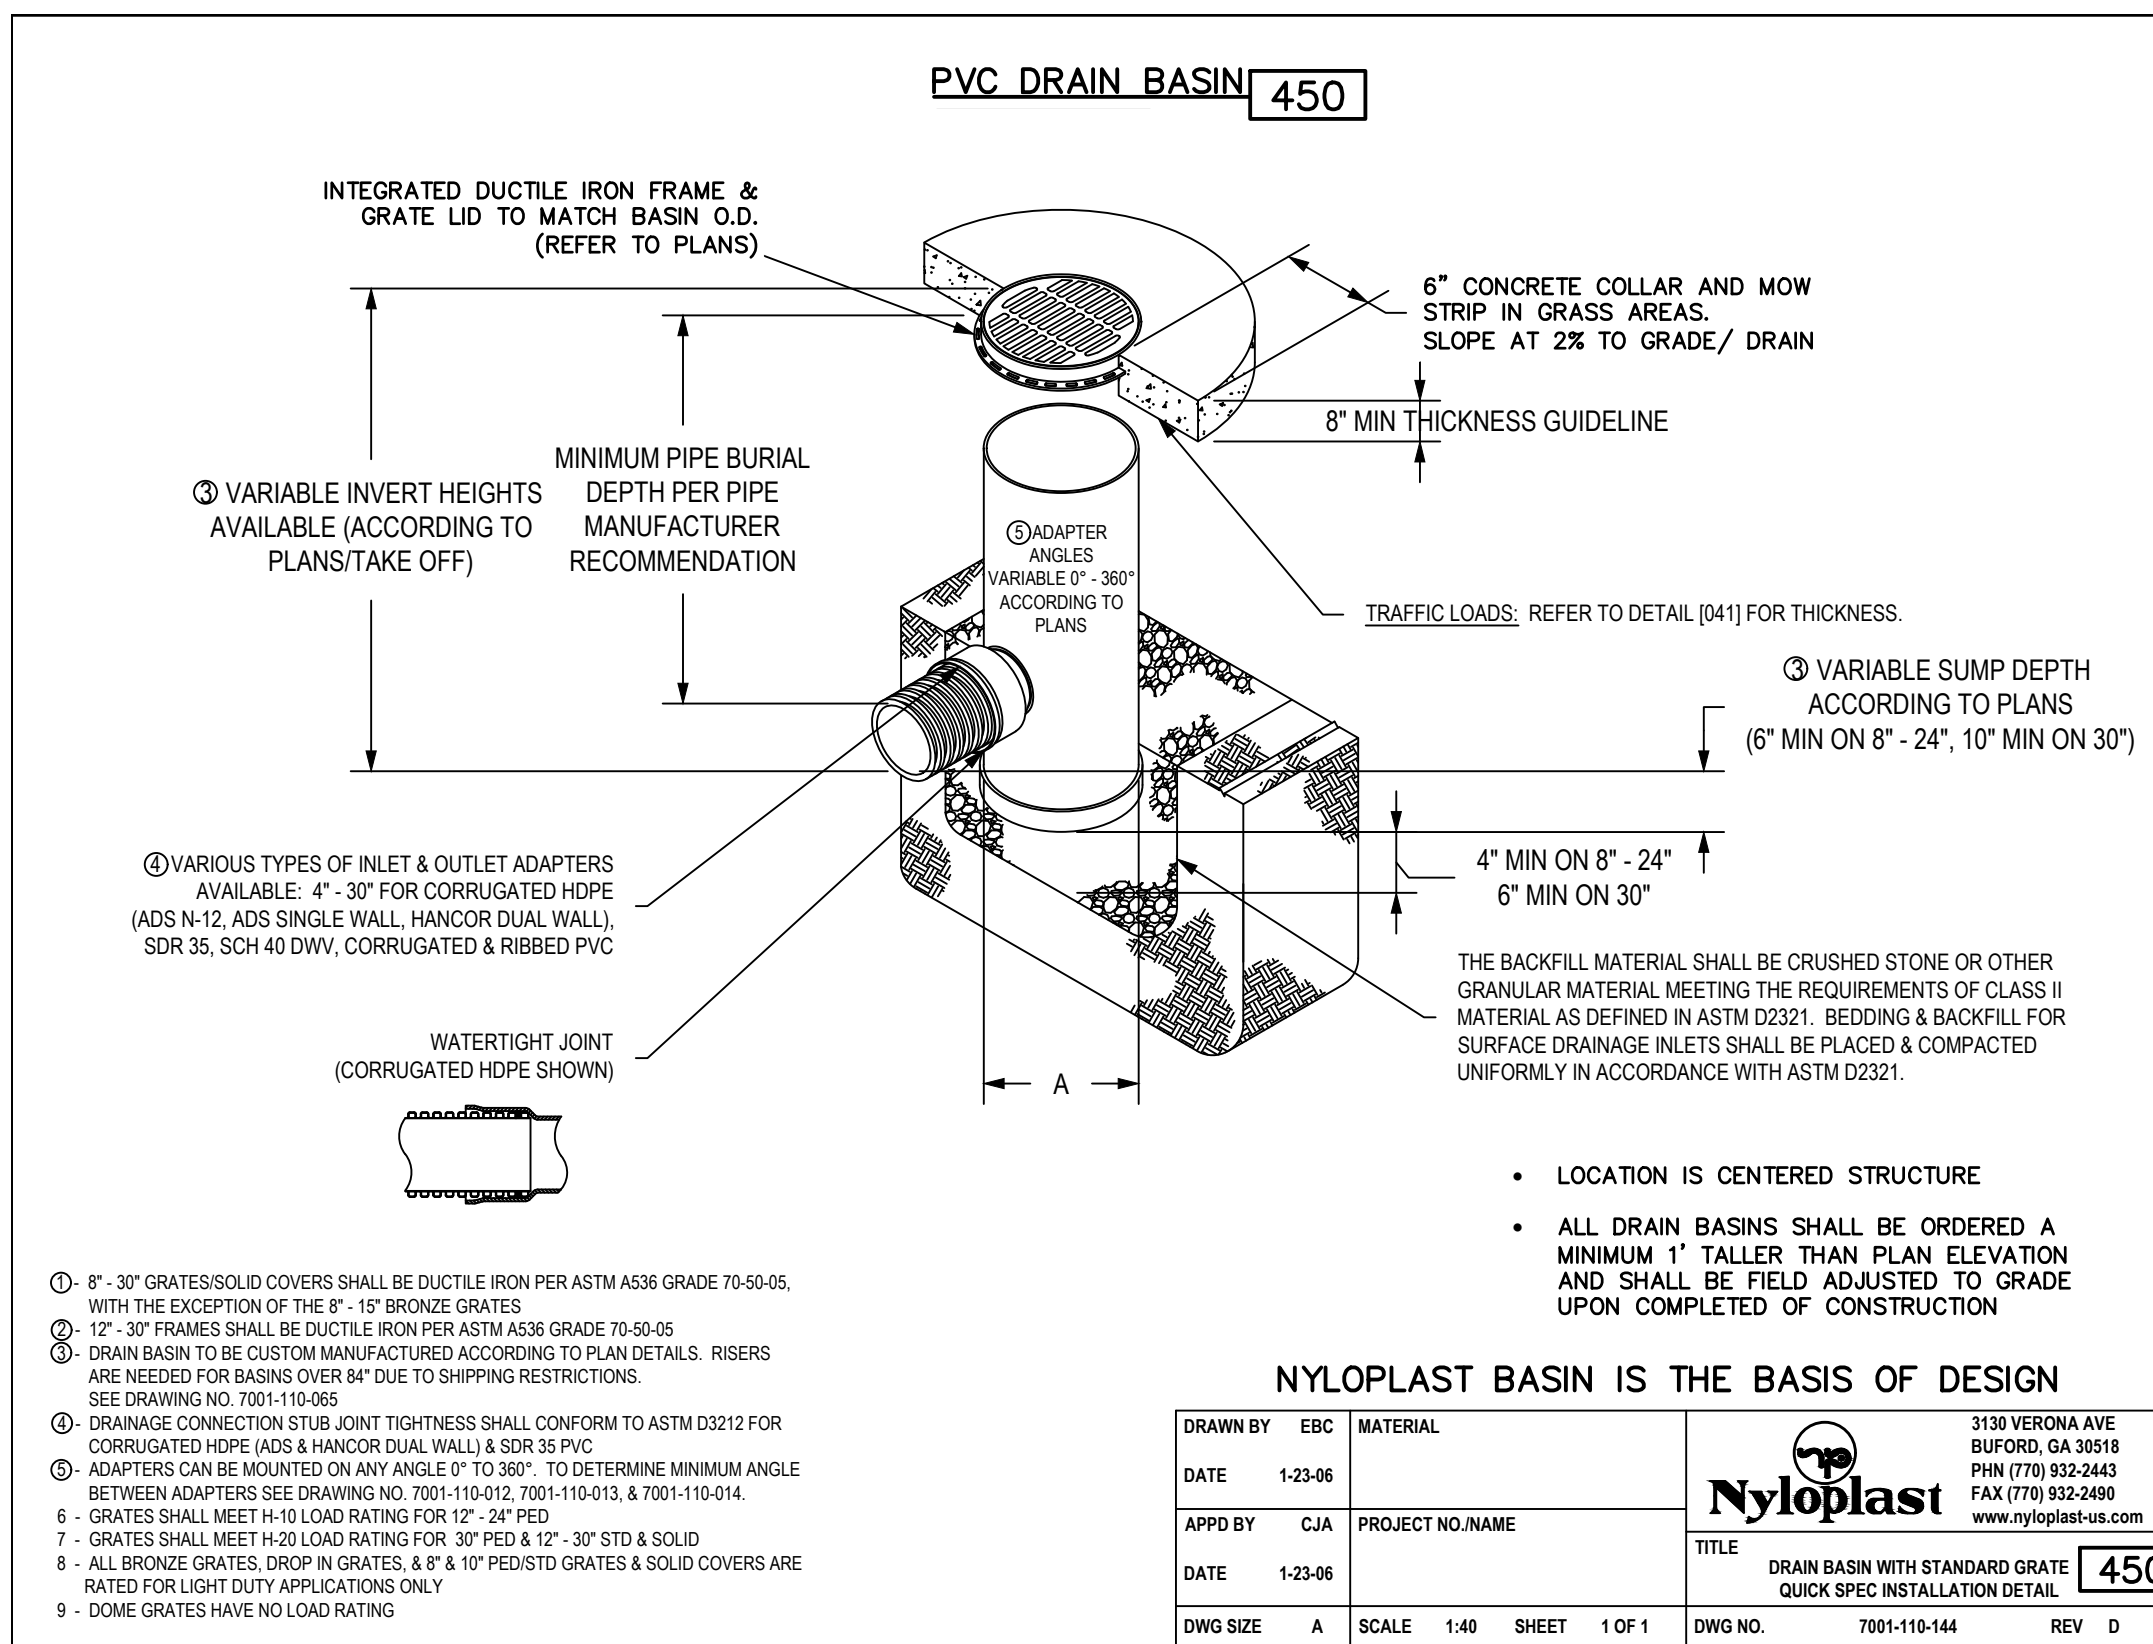

**JUNCTION BOX YARD INLETS AND CURB INLET NOTES**

**GENERAL**


- ALL STORM SEWER STRUCTURES SHALL BE PRE-CAST OR POURED IN PLACE. IF PRE-CAST STRUCTURES ARE USED FOR PUBLICLY FINANCED, MAINTAINED OR ADMINISTERED CONSTRUCTION, THE TOPS SHALL BE POURED IN PLACE AND THE WALL STEEL SHALL BE LEFT EXPOSED TO A HEIGHT 2" BELOW THE FINISH TOP ELEVATION, OR AS DIRECTED BY THE CITY ENGINEER.
- PRE-CAST SHOP DRAWINGS ARE TO BE APPROVED BY THE ENGINEER.
- DO NOT SCALE THESE DRAWINGS FOR DIMENSIONS OR CLEARANCES. ANY QUESTIONS REGARDING DIMENSIONS SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER PRIOR TO CONSTRUCTION.
- THE FIRST DIMENSION LISTED IN THE CONSTRUCTION NOTES IS THE "L" DIMENSION. THE SECOND DIMENSION IS THE "W" DIMENSION. THE CONCRETE THICKNESS AND REINFORCEMENT SHOWN IS FOR BOXES WITH ("L" + "H") AND ("W" + "H") LESS THEN OR EQUAL TO 20. FOR BOXES WITH EITHER OF THESE CALCULATIONS GREATER THAN 20, A SPECIAL DESIGN IS REQUIRED. PRECASTER SHALL PROVIDE DESIGN CALCULATIONS FOR DEEP STRUCTURES TO ENGINEER PRIOR TO CONSTRUCTING BOX.

**CONCRETE**

- CONCRETE USED IN THIS WORK SHALL BE CLASS "A" CONCRETE (AE) THROUGHOUT, AND SHALL MEET THE REQUIREMENTS OF THE KANSAS CITY METROPOLITAN CHAPTER OF THE APWA TECHNICAL SPECIFICATIONS.
- CONCRETE CONSTRUCTION SHALL MEET THE APPLICABLE REQUIREMENTS OF STANDARD SPECIFICATIONS FOR MOB, LATEST EDITION, EXCEPT AS MODIFIED IN THE APWA TECHNICAL SPECIFICATIONS.
- INLET FLOORS SHALL BE SHAPED WITH NON-REINFORCED CONCRETE INVERTS TO PROVIDE SMOOTH FLOW.
- BEVEL ALL EXPOSED EDGES WITH 3/4" TRIANGULAR MOLDING.
- 8" SOLID CONCRETE BLOCK OR BRICK MAY BE USED IN WALLS IN LIEU OF POURED CONCRETE WHERE NEITHER "H" + "L" NOR "H" + "W" (IN FEET) EXCEED FOURTEEN. BLOCK OR BRICK MAY BE USED IN ANY BOX WHERE "H" IS 5' OR LESS.
- ALL CRUSHED STONE USED AS AGGREGATE FOR CONCRETE CONSTRUCTION SHALL BE OBTAINED FROM QUARRIES AND BEDS DESIGNATED BY THE MISSOURI DEPARTMENT OF TRANSPORTATION AS MEETING DURABILITY REQUIREMENTS OF KANSAS CITY METROPOLITAN CHAPTER OF THE APWA TECHNICAL SPECIFICATIONS.
- REINFORCING STEEL SHALL BE NEW BILLET, MINIMUM GRADE 60 AS PER ASTM A615, AND SHALL BE BENT COLD.
- ALL DIMENSIONS RELATIVE TO REINFORCING STEEL ARE TO CENTERLINE OF BARS. 2" CLEARANCE SHALL BE PROVIDED THROUGHOUT UNLESS NOTED OTHERWISE. TOLERANCE OF +/- 3/8" SHALL BE PERMITTED.
- ALL LAP SPICES NOT SHOWN SHALL BE A MINIMUM OF 40 BAR DIAMETERS IN LENGTH.
- ALL REINFORCING STEEL SHALL BE SUPPORTED ON FABRICATED STEEL BAR SUPPORTS @ 3'-0" MAXIMUM SPACING.
- ALL DOWELS SHALL BE ACCURATELY PLACED AND SECURELY TIED IN PLACE PRIOR TO PLACEMENT OF BOTTOM SLAB CONCRETE. STICKING OF DOWELS INTO FRESH OR PARTIALLY HARDENED CONCRETE WILL NOT BE ACCEPTABLE.

**CONSTRUCTION**

- THE BOTTOM SLAB SHALL BE AT LEAST 24 HOURS OLD BEFORE PLACING SIDEWALL CONCRETE. ALL SIDEWALL FORMS SHALL REMAIN IN PLACE A MINIMUM OF 24 HOURS AFTER SIDEWALLS ARE POURED BEFORE REMOVAL. AND AFTER REMOVAL SHALL BE IMMEDIATELY TREATED WITH MEMBRANE CURING COMPOUND.
- PIPE CONNECTIONS TO PRE-CAST STRUCTURES SHALL HAVE A MINIMUM OF 6" OF CONCRETE AROUND THE ENTIRE PIPE WITHIN 2' OF THE STRUCTURE.
- MATERIAL SELECTION AND COMPACTION REQUIREMENTS FOR BACKFILL AROUND STRUCTURES SHALL BE AS SPECIFIED IN THE KANSAS CITY METROPOLITAN CHAPTER OF THE APWA TECHNICAL SPECIFICATIONS.

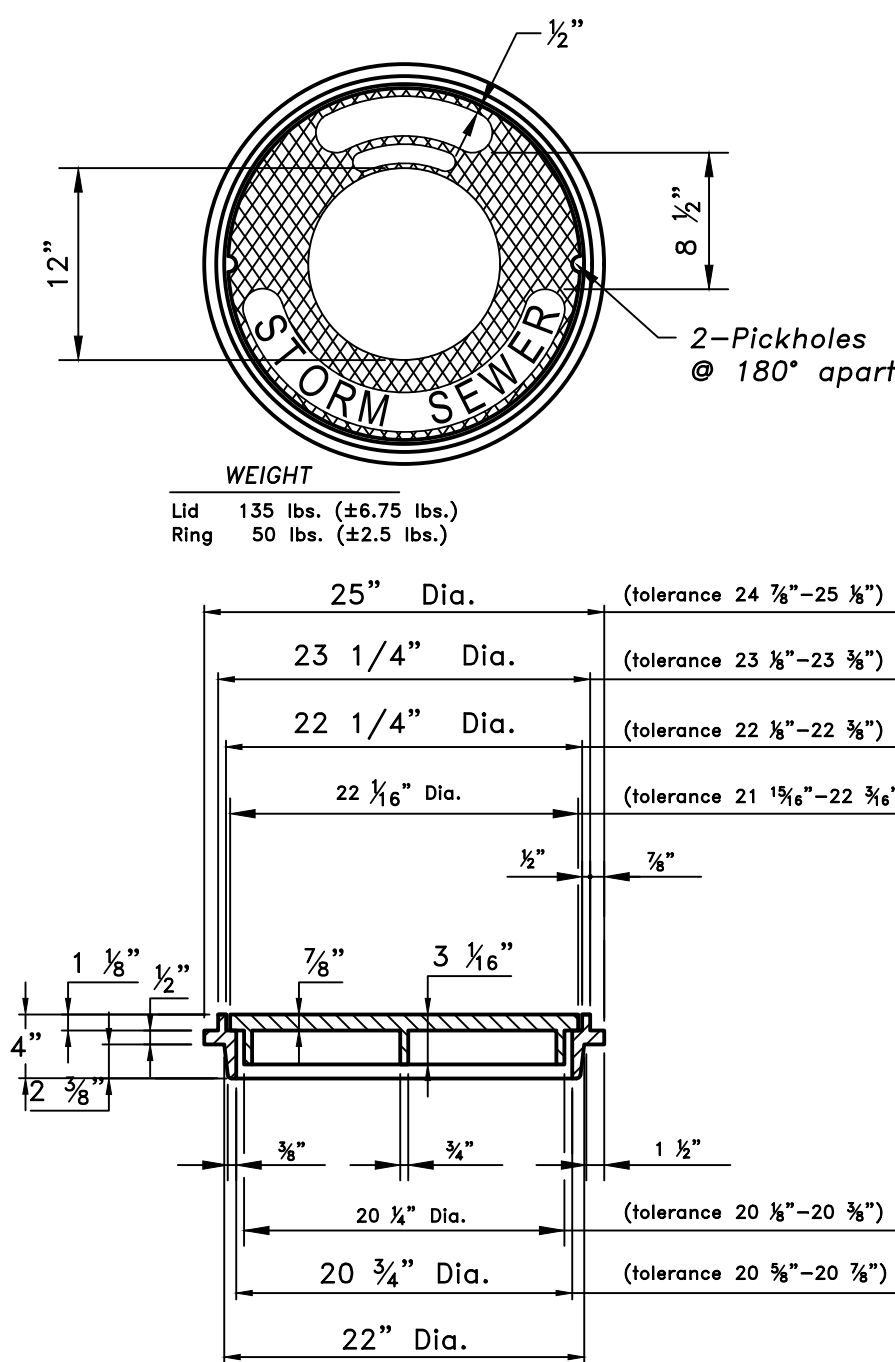


**Manhole Cover Notes:**


- Casting shall comply with ASTM A-48 and AASHTO M306-04.
- As-cast dimensions may vary ± 1/16 inch per foot.
- Each Casting shall be marked in accordance with AASHTO M 306-04, Sec. 9.
- Raised surfaces shall be cast on non-skid finish.
- Horizontal bearing surfaces shall be machined.
- Paint is optional unless specified.

**MANHOLE COVER**


(Public Systems Only)  
SCALE: 1 1/2" = 1'-0"  
(REV. Feb. 2005)

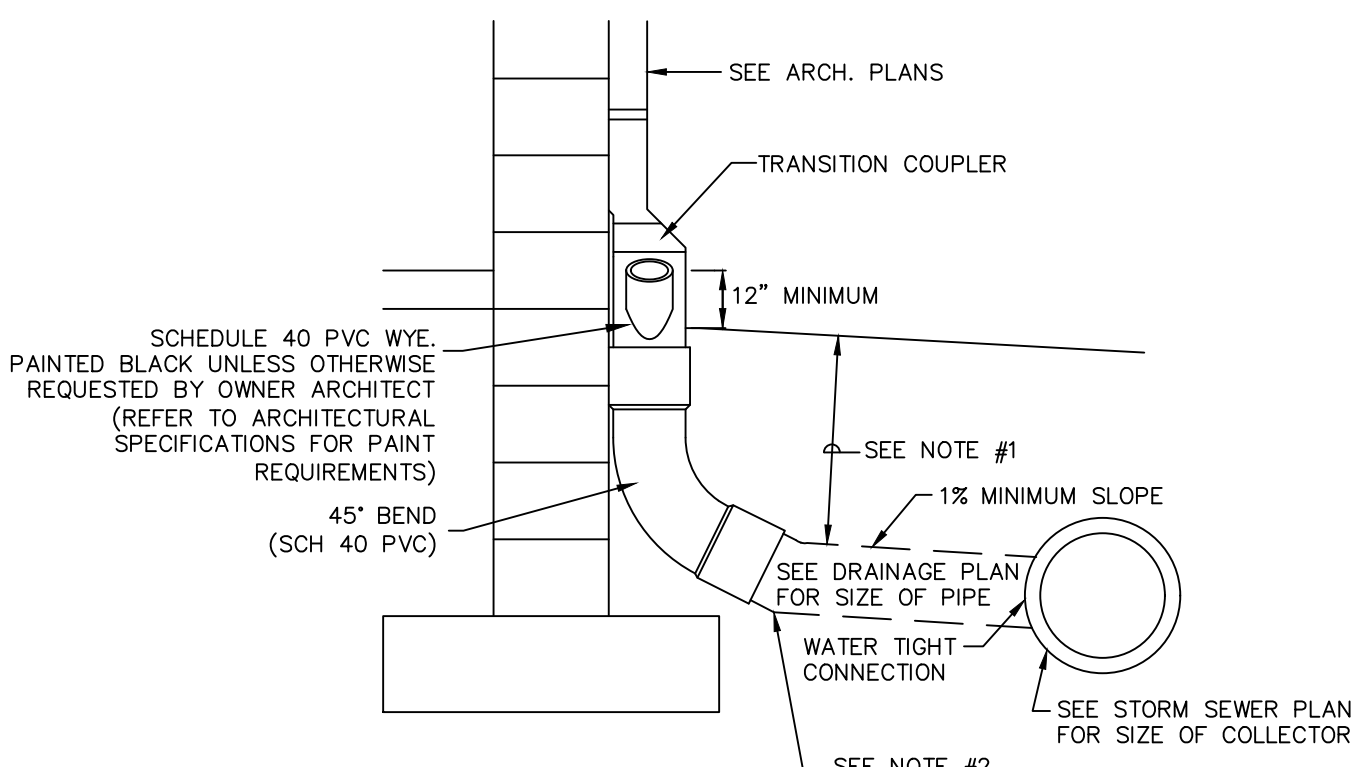

- NOTES:
- FOR ALL DEPTHS OF COVER LESS THAN TWO (2) FEET, PIPE MUST BE SCHEDULE 40 PVC. FOR DEPTHS OF COVER GREATER THAN TWO (2) FEET, FLEXIBLE PIPE MAY BE USED. REFER TO SPECIFICATIONS FOR ALLOWABLE PIPE TYPES.
  - A WATERTIGHT CONNECTION SHALL BE MAINTAINED WITH ANY TRANSITION FROM SCHEDULE 40 PVC PIPE TO ANY OTHER PIPE TYPE.

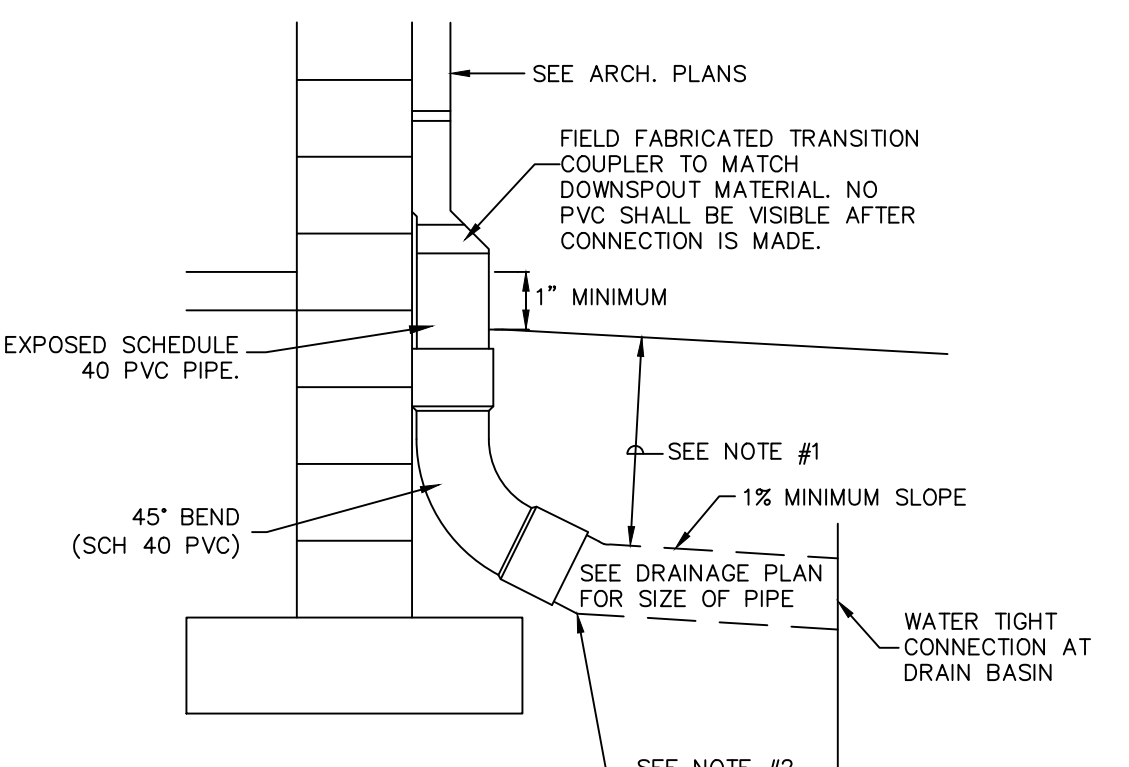

- NOTES:
- FOR ALL DEPTHS OF COVER LESS THAN TWO (2) FEET, PIPE MUST BE SCHEDULE 40 PVC. FOR DEPTHS OF COVER GREATER THAN TWO (2) FEET, FLEXIBLE PIPE MAY BE USED. REFER TO SPECIFICATIONS FOR ALLOWABLE PIPE TYPES.
  - A WATERTIGHT CONNECTION SHALL BE MAINTAINED WITH ANY TRANSITION FROM SCHEDULE 40 PVC PIPE TO ANY OTHER PIPE TYPE.

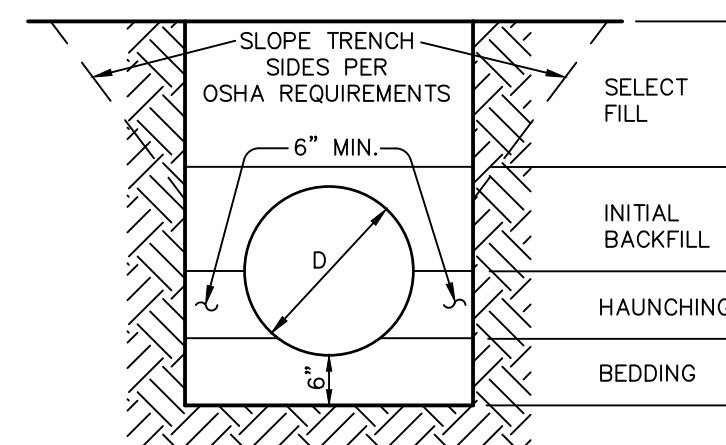

- FLEXIBLE PIPE: INCLUDES CORRUGATED POLYETHYLENE PIPE AND/OR POLYVINYL CHLORIDE PIPE.
- RIGID PIPE: INCLUDES REINFORCED CONCRETE, DUCTILE IRON, & CAST IRON
- BEDDING SHALL BE COMPACTED CRUSHED STONE AND SHALL BE SHAPED TO THE BOTTOM OF THE PIPE.
  - HAUNCHING AND INITIAL BACKFILL MATERIAL SHALL BE CLASS I OR II (REF. ASTM D2321) GRANULAR MATERIAL AND SHALL BE COMPACTED TO 95% STANDARD PROCTOR.

**TRENCH AND BEDDING DETAILS**  
REFER TO KANSAS CITY METROPOLITAN CHAPTER OF APWA SPECIFICATIONS SECTION 2102.4

PROJ. NO. C20-0496-1DSN: CJC  
CFN: 0496-TDET

ENGINEER  
CHRISTIAN J. CROWDER  
MO # 2015000538

14700 WEST 114TH TERRACE  
LENEXA, KANSAS 66215  
PH. (913) 894-5150 | FAX (913) 894-5977  
lx@kveng.com | www.kveng.com


**KAW VALLEY ENGINEERING**

KAW VALLEY ENGINEERING, INC., IS AUTHORIZED TO OFFER ENGINEERING SERVICES BY MISSOURI STATE CERTIFICATE OF AUTHORITY # 000842. EXPIRES 12/31/23

Issue Date: September 9, 2022

Revisions	NUMBER	DESCRIPTION	DATE
1	ADDENDUM 2	9/23/2022	

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

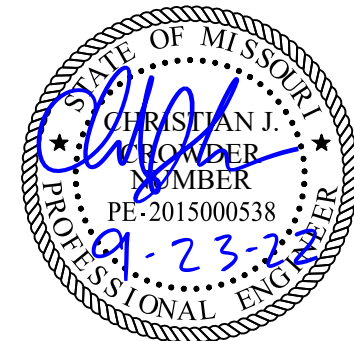

Kaw Valley Engineering, Inc.  
Missouri Certificate of Authority: 000842  
Christian Crowder Date: 9/23/2022  
Engineer License No. PE-2015000538

**STORM SEWER DETAILS**

**C690-C**



**SANITARY SEWER MATERIALS AND CONSTRUCTION NOTES:**

1. ALL WORK RELATED TO SANITARY SEWER SHALL BE COMPLETED IN ACCORDANCE WITH SECTION 3500 SANITARY SEWERS OF THE CITY OF LEE'S SUMMIT, MISSOURI STANDARD SPECIFICATIONS.
2. ALL PIPE USED FOR SANITARY SEWER SHALL BE PVC (SDR 26) OR DIP (CL 50) AS NOTED ON PLANS. MATERIAL SHALL CONFORM TO SECTION 3501 C & D OF THE CITY OF LEE'S SUMMIT, MISSOURI STANDARD SPECIFICATIONS.
3. MANHOLES SHALL CONFORM TO SECTION 3501 P OF THE CITY OF LEE'S SUMMIT, MISSOURI STANDARD SPECIFICATIONS.
4. ALL EXISTING UTILITIES INDICATED ON THE DRAWINGS ARE ACCORDING TO THE BEST INFORMATION AVAILABLE TO THE ENGINEER; HOWEVER, ALL UTILITIES ACTUALLY EXISTING MAY NOT BE SHOWN. UTILITIES DAMAGED THROUGH THE NEGLIGENCE OF THE CONTRACTOR TO OBTAIN THE LOCATION OF SAME SHALL BE REPAIRED OR REPLACED BY THE CONTRACTOR AT HIS EXPENSE.
5. ALL INSTALLATION SHALL BE COMPLETED IN ACCORDANCE WITH SECTION 3502 OF THE CITY OF LEE'S SUMMIT, MISSOURI STANDARD SPECIFICATIONS. REFER TO SECTION 3502.C FOR TESTING AND ACCEPTANCE REQUIREMENTS.
6. EXCAVATION, TRENCHING AND BACKFILL SHALL BE COMPLETED IN ACCORDANCE WITH SECTION 2100 GRADING AND SITE PREPARATION OF THE KANSAS CITY METROPOLITAN CHAPTER OF APWA SPECIFICATIONS AS ADOPTED AND AMENDED BY THE CITY OF LEE'S SUMMIT. ALL EXCAVATIONS SHALL BE CONSIDERED UNCLASSIFIED. REFER TO PROJECT GEOTECHNICAL REPORT.
7. ALL BACKFILL SHALL BE TAMPED, BACKFILL WITHIN THE RIGHT-OF-WAY AND UNDER PARKING AREAS AND SLABS SHALL BE 95% COMPACTION OF OPTIMUM MOISTURE.
8. ALL STUB LINES SHALL BE LAID ON 1.00% GRADE FOR 6" PIPE AND 2.00% GRADE FOR 4" PIPE, UNLESS NOTED OTHERWISE.
9. RELOCATION OF ANY WATER LINE, SEWER LINE OR SERVICE LINE THEREOF REQUIRED FOR THE CONSTRUCTION OF THIS PROJECT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR AND SHALL BE AT HIS EXPENSE. REFER TO PLANS FOR ADDITIONAL INFORMATION.
10. REFER TO SHEET C790-C FOR SANITARY SEWER DETAILS.

DETAILS SEE SHEET C690-C

701 CLEANOUT  
706 4" DIAMETER DOGHOUSE MANHOLE  
SAN-2 STANDARD PRECAST MANHOLE

SANITARY MANHOLE #5890  
4" CONCRETE  
RM = 1012.82  
IN (W) = 1008.35 (12" VCP)  
IN (N) = 1008.60 (8" VCP)  
IN (S) = 1008.38 (8" VCP)  
OUT (E) = 1008.17 (12" VCP)

SANITARY MANHOLE #5873  
4" CONCRETE  
RM = 1011.77  
IN (W) = 1008.52 (8" VCP)  
OUT (N) = 1008.35 (8" VCP)

SANITARY SEWER MANHOLE #16294  
4" BRICK  
RM=1012.10  
IN (SE)=1006.15 (8" VCP)  
IN (W)=1005.68 (8" VCP)  
OUT (NE)=1005.58 (8" VCP)  
NOTE: NO STEPS

MH A1  
STA 3+23.74  
INSTALL 4" SANITARY SEWER  
DOGHOUSE MANHOLE  
SEE DETAIL 706  
N 997996.67  
E 2826712.79

EXISTING 8" VCP SANITARY SEWER MAIN TO BE  
ABANDONED IN PLACE CAPPED AND FILLED WITH  
FLOWABLE FILL IN ACCORDANCE WITH CITY OF  
LEE'S SUMMIT SPECIFICATIONS. CONTRACTOR TO  
REMOVE SECTIONS AS NECESSARY TO FACILITATE  
PROPOSED BUILDING ADDITION.

SANITARY SEWER MANHOLE #16188 TO  
BE ABANDONED IN PLACE AND FILL WITH  
FLOWABLE FILL IN ACCORDANCE WITH  
CITY OF LEE'S SUMMIT SPECIFICATIONS.

INSTALL APPROXIMATELY 63 LF OF  
SANITARY SEWER SERVICE LINE FROM  
PROPOSED MANHOLE A3 TO EXISTING  
CLEANOUT. ASSUME 6" FIELD VERIFY  
SIZE AND MATERIALS. NEW MATERIALS  
SHALL MEET REQUIREMENTS OUTLINED IN  
CONSTRUCTION NOTES AND PROJECT  
SPECIFICATIONS. SLOPE AT 1.0% MINIMUM.



MH A3  
STA 6+34.92  
INSTALL 4" SANITARY SEWER  
DOGHOUSE MANHOLE  
SEE DETAIL 706  
N 997801.60  
E 2826935.32

INSTALL SERVICE WYE AND APPROXIMATELY 39  
LF OF SANITARY SEWER SERVICE LINE FROM  
PROPOSED SEWER LINE WYE AND CLEANOUT  
AND 5 LF TO POINT OF CONNECTION. ASSUME  
4". FIELD VERIFY SIZE AND MATERIALS WITH  
EXISTING. NEW MATERIALS SHALL MEET  
REQUIREMENTS OUTLINED IN CONSTRUCTION  
NOTES AND PROJECT SPECIFICATIONS. SLOPE  
AT 1.0% MINIMUM.

INSTALL SERVICE WYE AND  
APPROXIMATELY 8 LF OF 6" CL 50  
DIP SANITARY SEWER LINE FROM  
PROPOSED SEWER LINE TO POINT OF  
CONNECTION AT EXISTING SERVICE  
LINE. SLOPE AT 1.0% MINIMUM.

EXISTING SERVICE LINE  
REPLACEMENT  
FIELD VERIFIED FL=1009.87

PRIVATE SANITARY SEWER LINE A PLAN

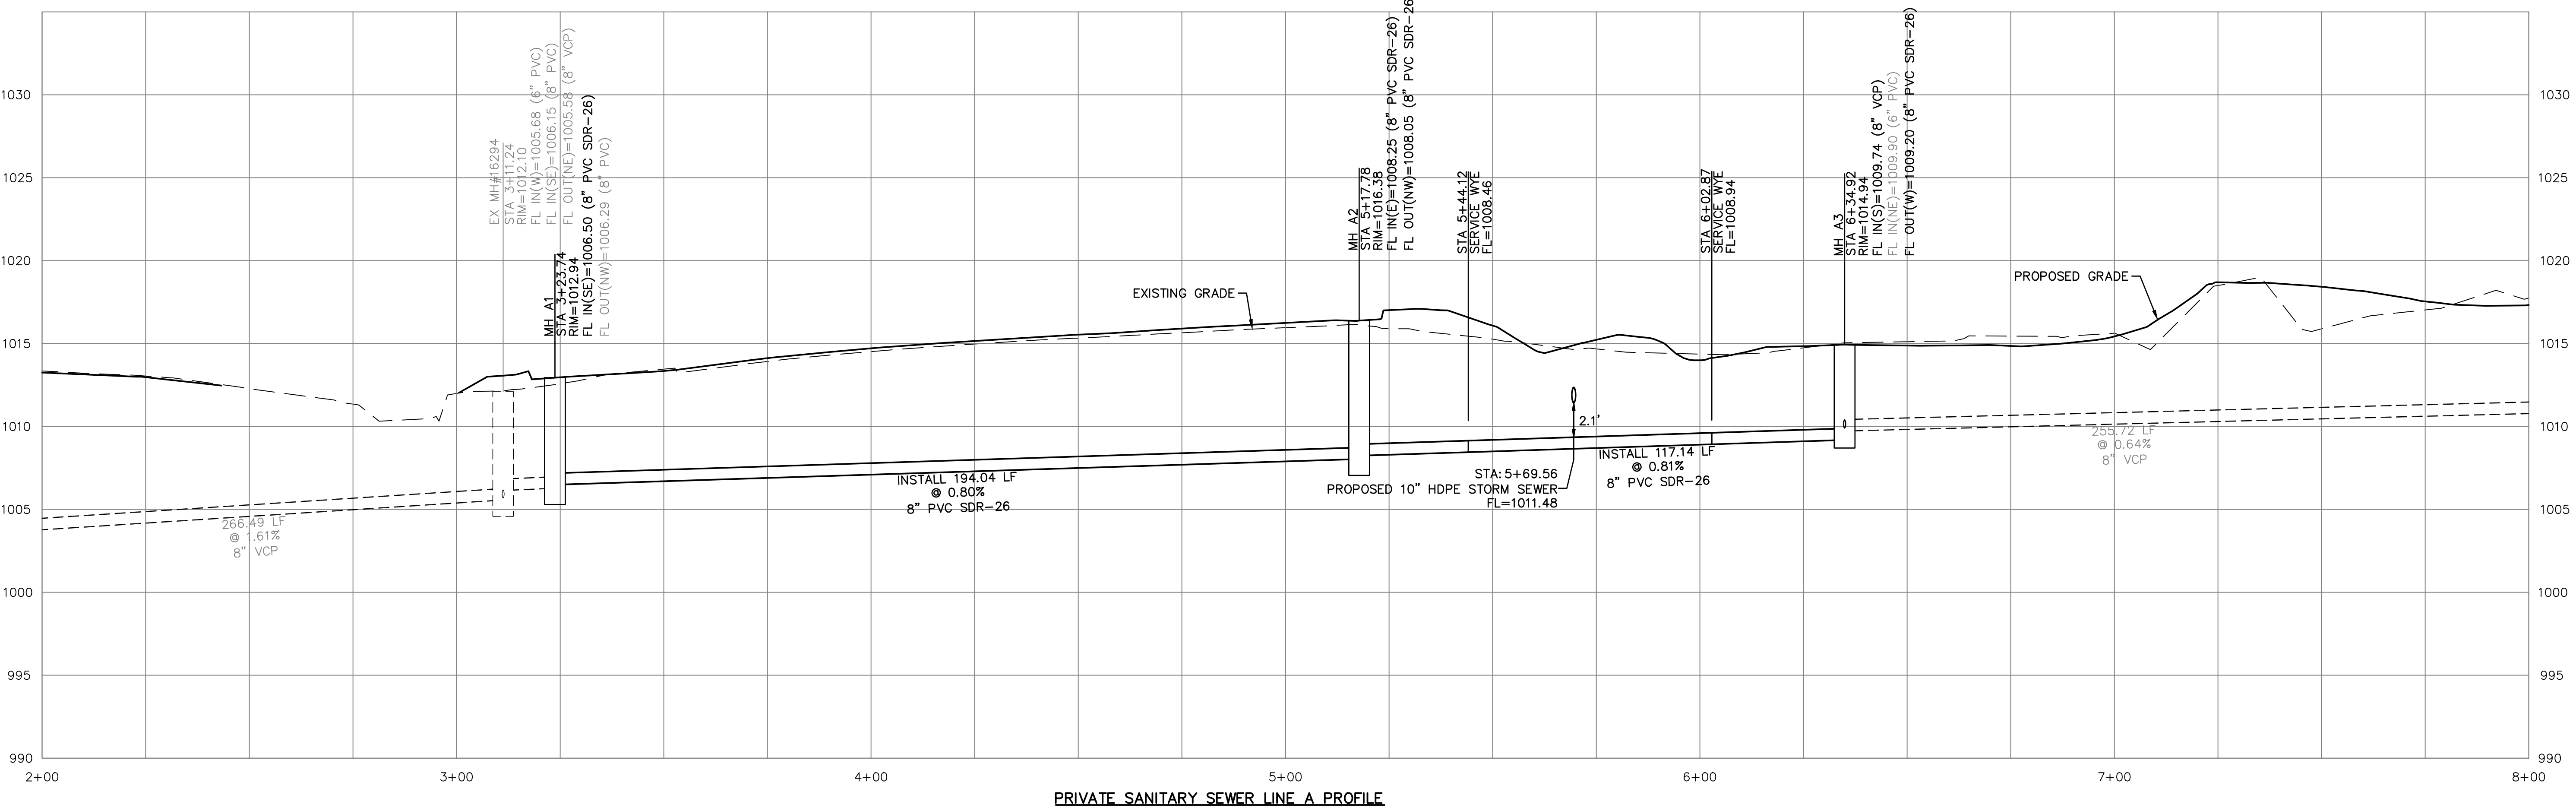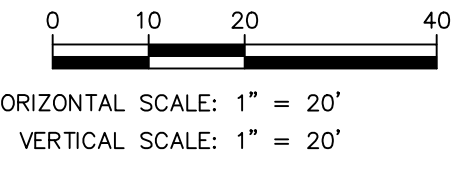

PRIVATE SANITARY SEWER LINE A PROFILE

**WARRANTY / DISCLAIMER**

THE DESIGNS REPRESENTED IN THESE PLANS ARE IN ACCORDANCE WITH ESTABLISHED PRACTICES OF CIVIL ENGINEERING FOR THE DESIGN FUNCTIONS AND USES INTENDED BY THE OWNER AT THIS TIME. HOWEVER, NEITHER KAW VALLEY ENGINEERING, INC NOR ITS PERSONNEL CAN OR DO WARRANTY THESE DESIGNS OR PLANS AS CONSTRUCTED, EXCEPT IN THE SPECIFIC CASES WHERE KAW VALLEY ENGINEERING PERSONNEL INSPECT AND CONTROL THE PHYSICAL CONSTRUCTION ON A CONTEMPORARY BASIS AT THE SITE.

**SAFETY NOTICE TO CONTRACTOR**

IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, THE CONTRACTOR WILL BE SOLELY AND COMPLETELY RESPONSIBLE FOR CONDITIONS OF THE JOB SITE, INCLUDING SAFETY OF ALL PERSONS AND PROPERTY DURING PERFORMANCE OF THE WORK. THIS REQUIREMENT WILL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS.

**CAUTION - NOTICE TO CONTRACTOR**

THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES AS SHOWN ON THESE PLANS IS BASED ON RECORDS OF THE VARIOUS UTILITY COMPANIES AND, WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THE INFORMATION IS NOT TO BE RELIED ON AS BEING EXACT OR COMPLETE. THE CONTRACTOR MUST CALL THE APPROPRIATE UTILITY COMPANY AT LEAST 72 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATION OF UTILITIES. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH PROPOSED IMPROVEMENTS SHOWN ON THE PLANS. THE CONTRACTOR SHALL EXPOSE EXISTING UTILITIES AT LOCATIONS OF POSSIBLE CONFLICTS PRIOR TO ANY CONSTRUCTION.




PROJ. NO. C20\_0496-1DSN: CJC  
CFN: 0496-TSPD DWN: NJN  
CHRISTIAN J. CROWDER  
ENGINEER  
MO # 2015000538  
14700 WEST 114TH TERRACE  
LENEXA, KANSAS 66215  
PH. (913) 894-5150 | FAX (913) 894-5977  
lx@kveg.com | www.kveg.com  
KAW VALLEY ENGINEERING  
KAW VALLEY ENGINEERING, INC., IS AUTHORIZED TO OFFER  
ENGINEERING SERVICES BY MISSOURI STATE CERTIFICATE OF  
AUTHORITY # 000842. EXPIRES 12/31/23

**SANITARY SEWER PLAN  
& PROFILE**

C700-C

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS  
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR  
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

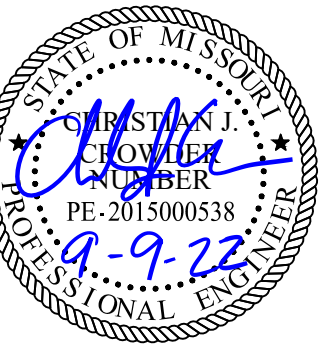


Kaw Valley Engineering, Inc.  
Missouri Certificate of Authority: 000842  
Christian Crowder Date: 9/9/2022  
Engineer License No. PE-2015000538







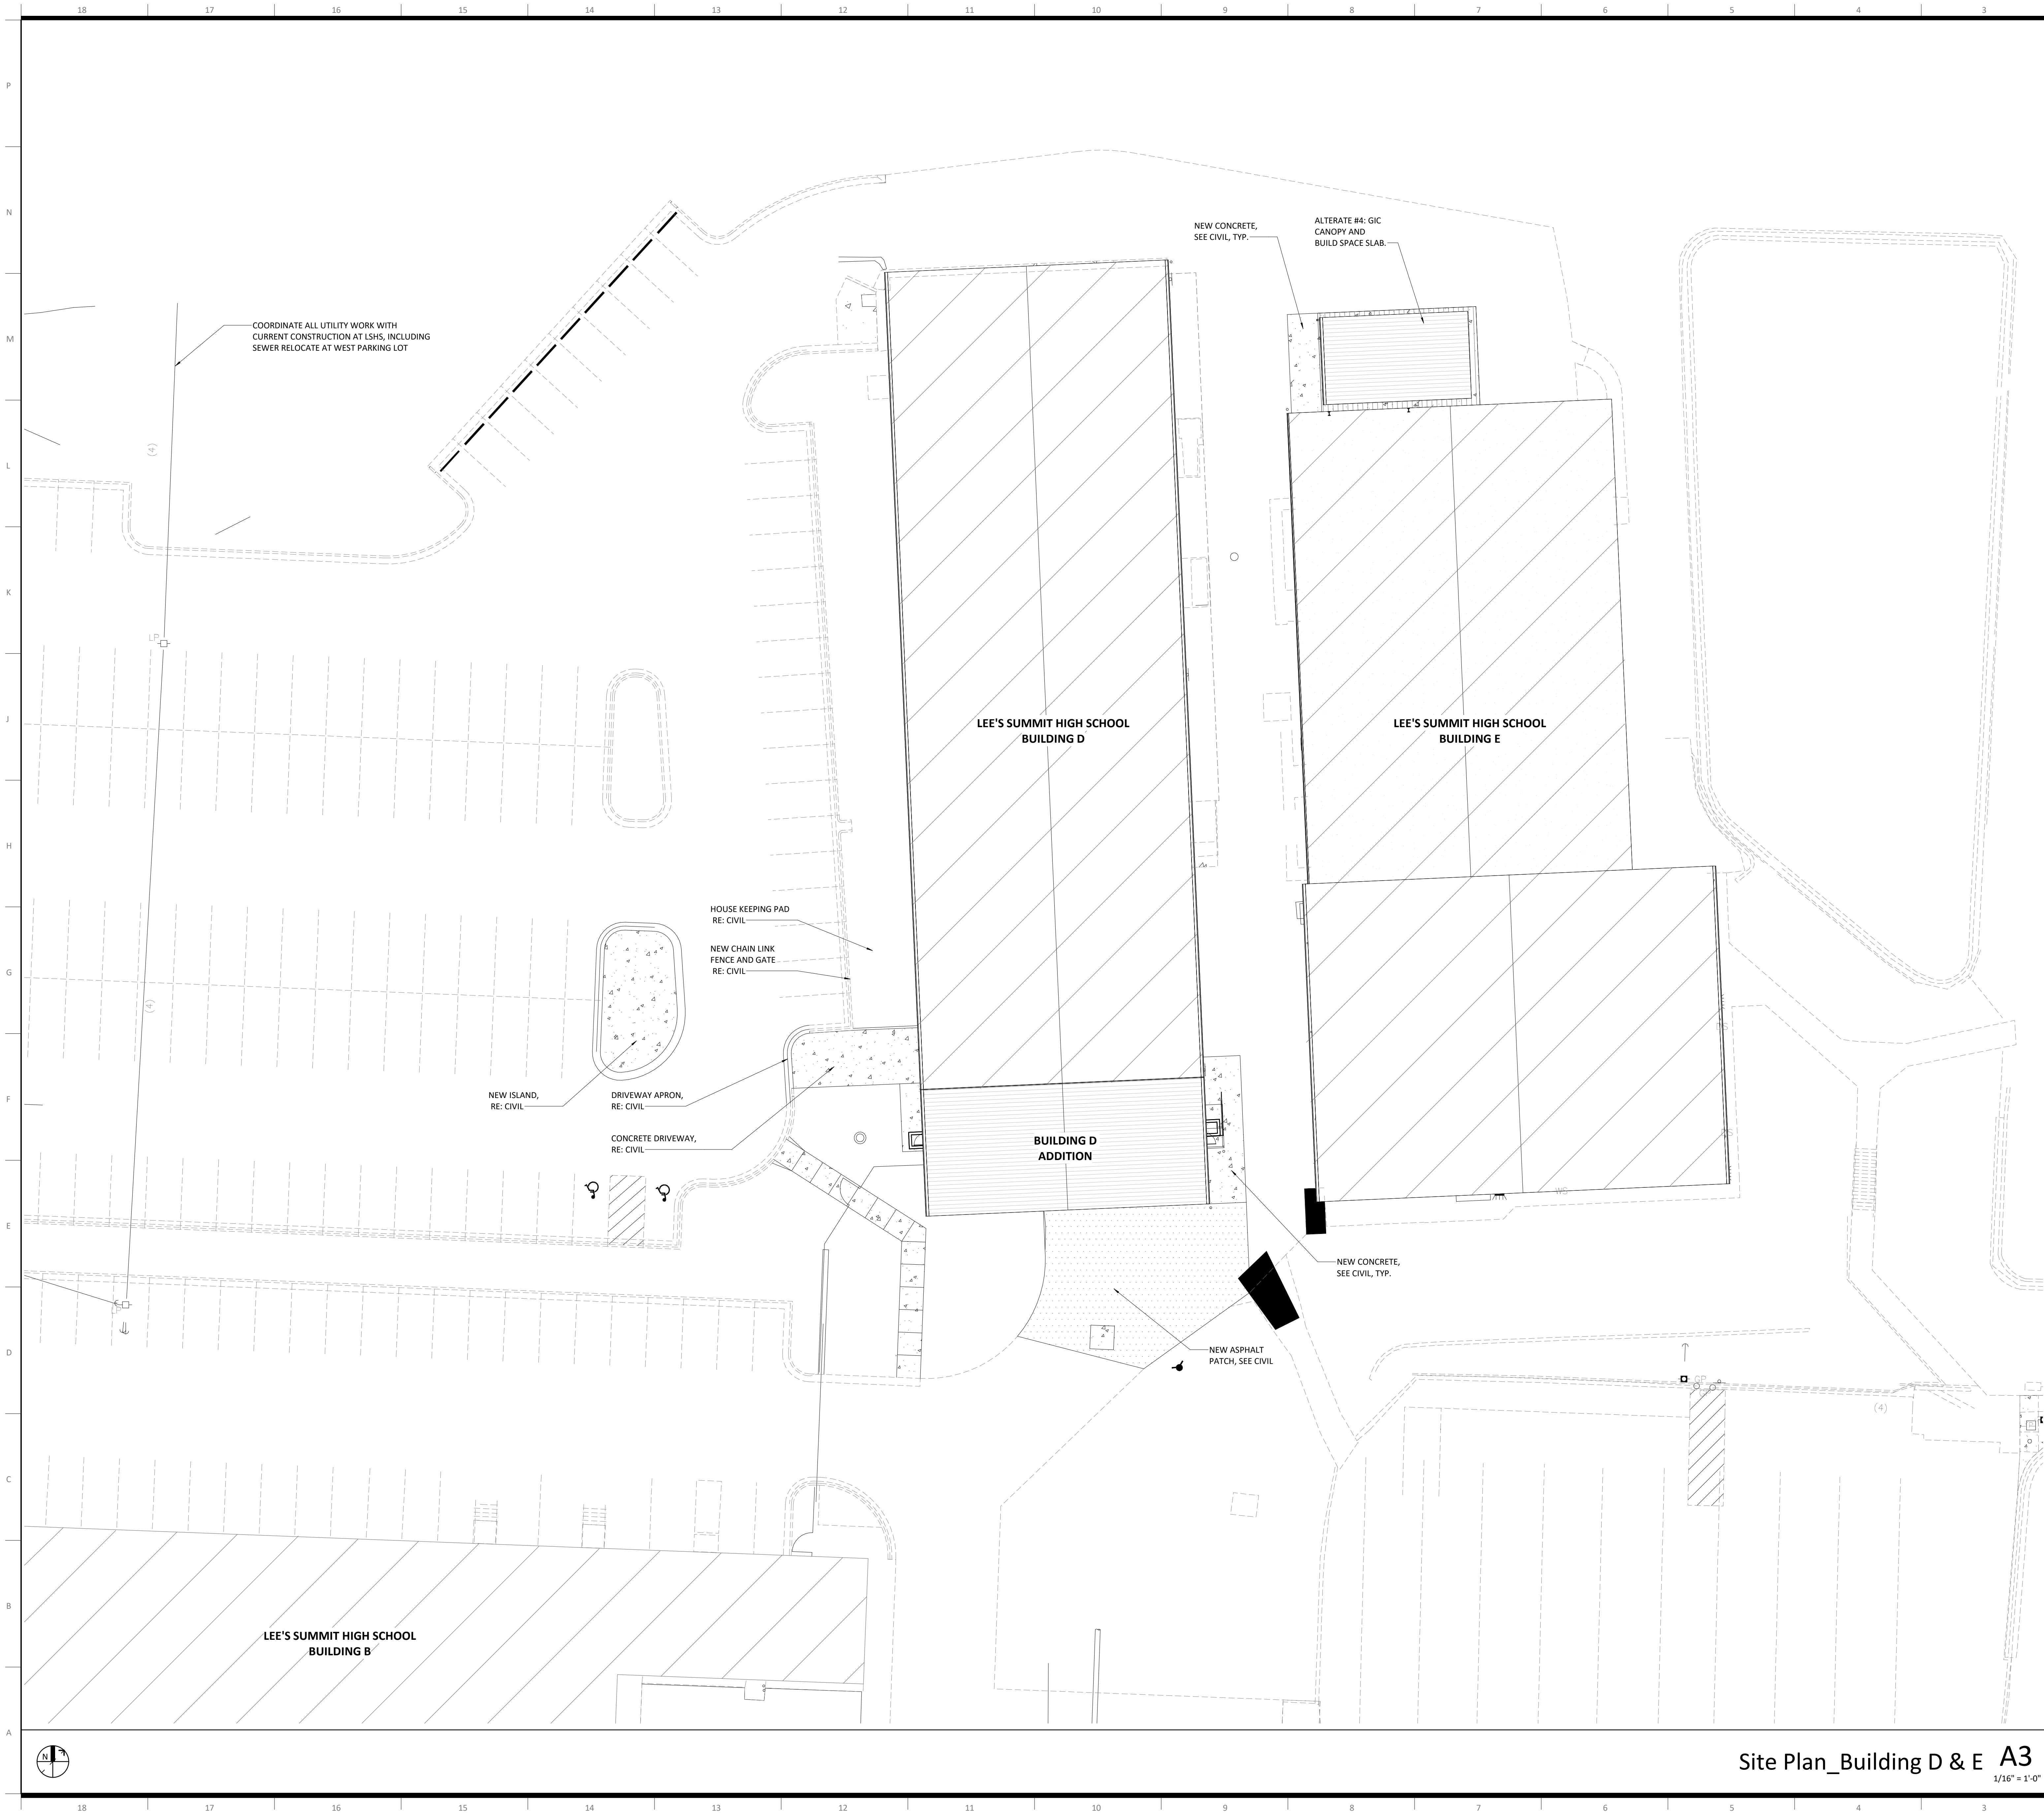

General Notes (Site Plan):

- COORDINATE ALL SPOT ELEVATIONS AND DIMENSIONS WITH CIVIL/LANDSCAPE/STRUCTURAL DRAWINGS
- PROVIDE POSITIVE DRAINAGE OF 1% MINIMUM / 2% MAXIMUM AT ALL EXTERIOR PAVED PEDESTRIAN AREAS SUCH AS SIDEWALKS, PATIOS, STAIRS, ETC. UNLESS NOTED OTHERWISE
- PROVIDE POSITIVE DRAINAGE AWAY FROM THE BUILDING OF 5% FOR A DISTANCE OF 10 FEET UNLESS NOTED OTHERWISE.
- FINISH GRADE SLOPES SHALL BE NO STEEPER THAN 1 FOOT VERTICAL IN 3 FEET HORIZONTAL UNLESS NOTED OTHERWISE.

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100

owner: Lee's Summit R-7 School 301 NE Tudor Road Lee's Summit, MO 64086	architect: Multistudio 4200 Pennsylvania Kansas City, MO 64111 816.931.6655 multi-studio
civil engineer: Kaw Valley Engineering 14700 West 114th Terrace Lenexa, KS 66215 913.485.0318 kveg.com	structural engineer: Bob D. Campbell & 4338 Bellevue Kansas City, MO 64111 816.531.4144 www.bdc-engrs.com

MEP/PT/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

NUMBER	DESCRIPTION	DATE

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

STATE OF MISSOURI  
ADAM LEE  
STERIS  
NUMBER  
A-7460  
REGISTERED PROFESSIONAL

LSHS - Architectural Site Plan


**AS100-C**

Site Plan\_Building D & E **A3**  
1/16" = 1'-0"








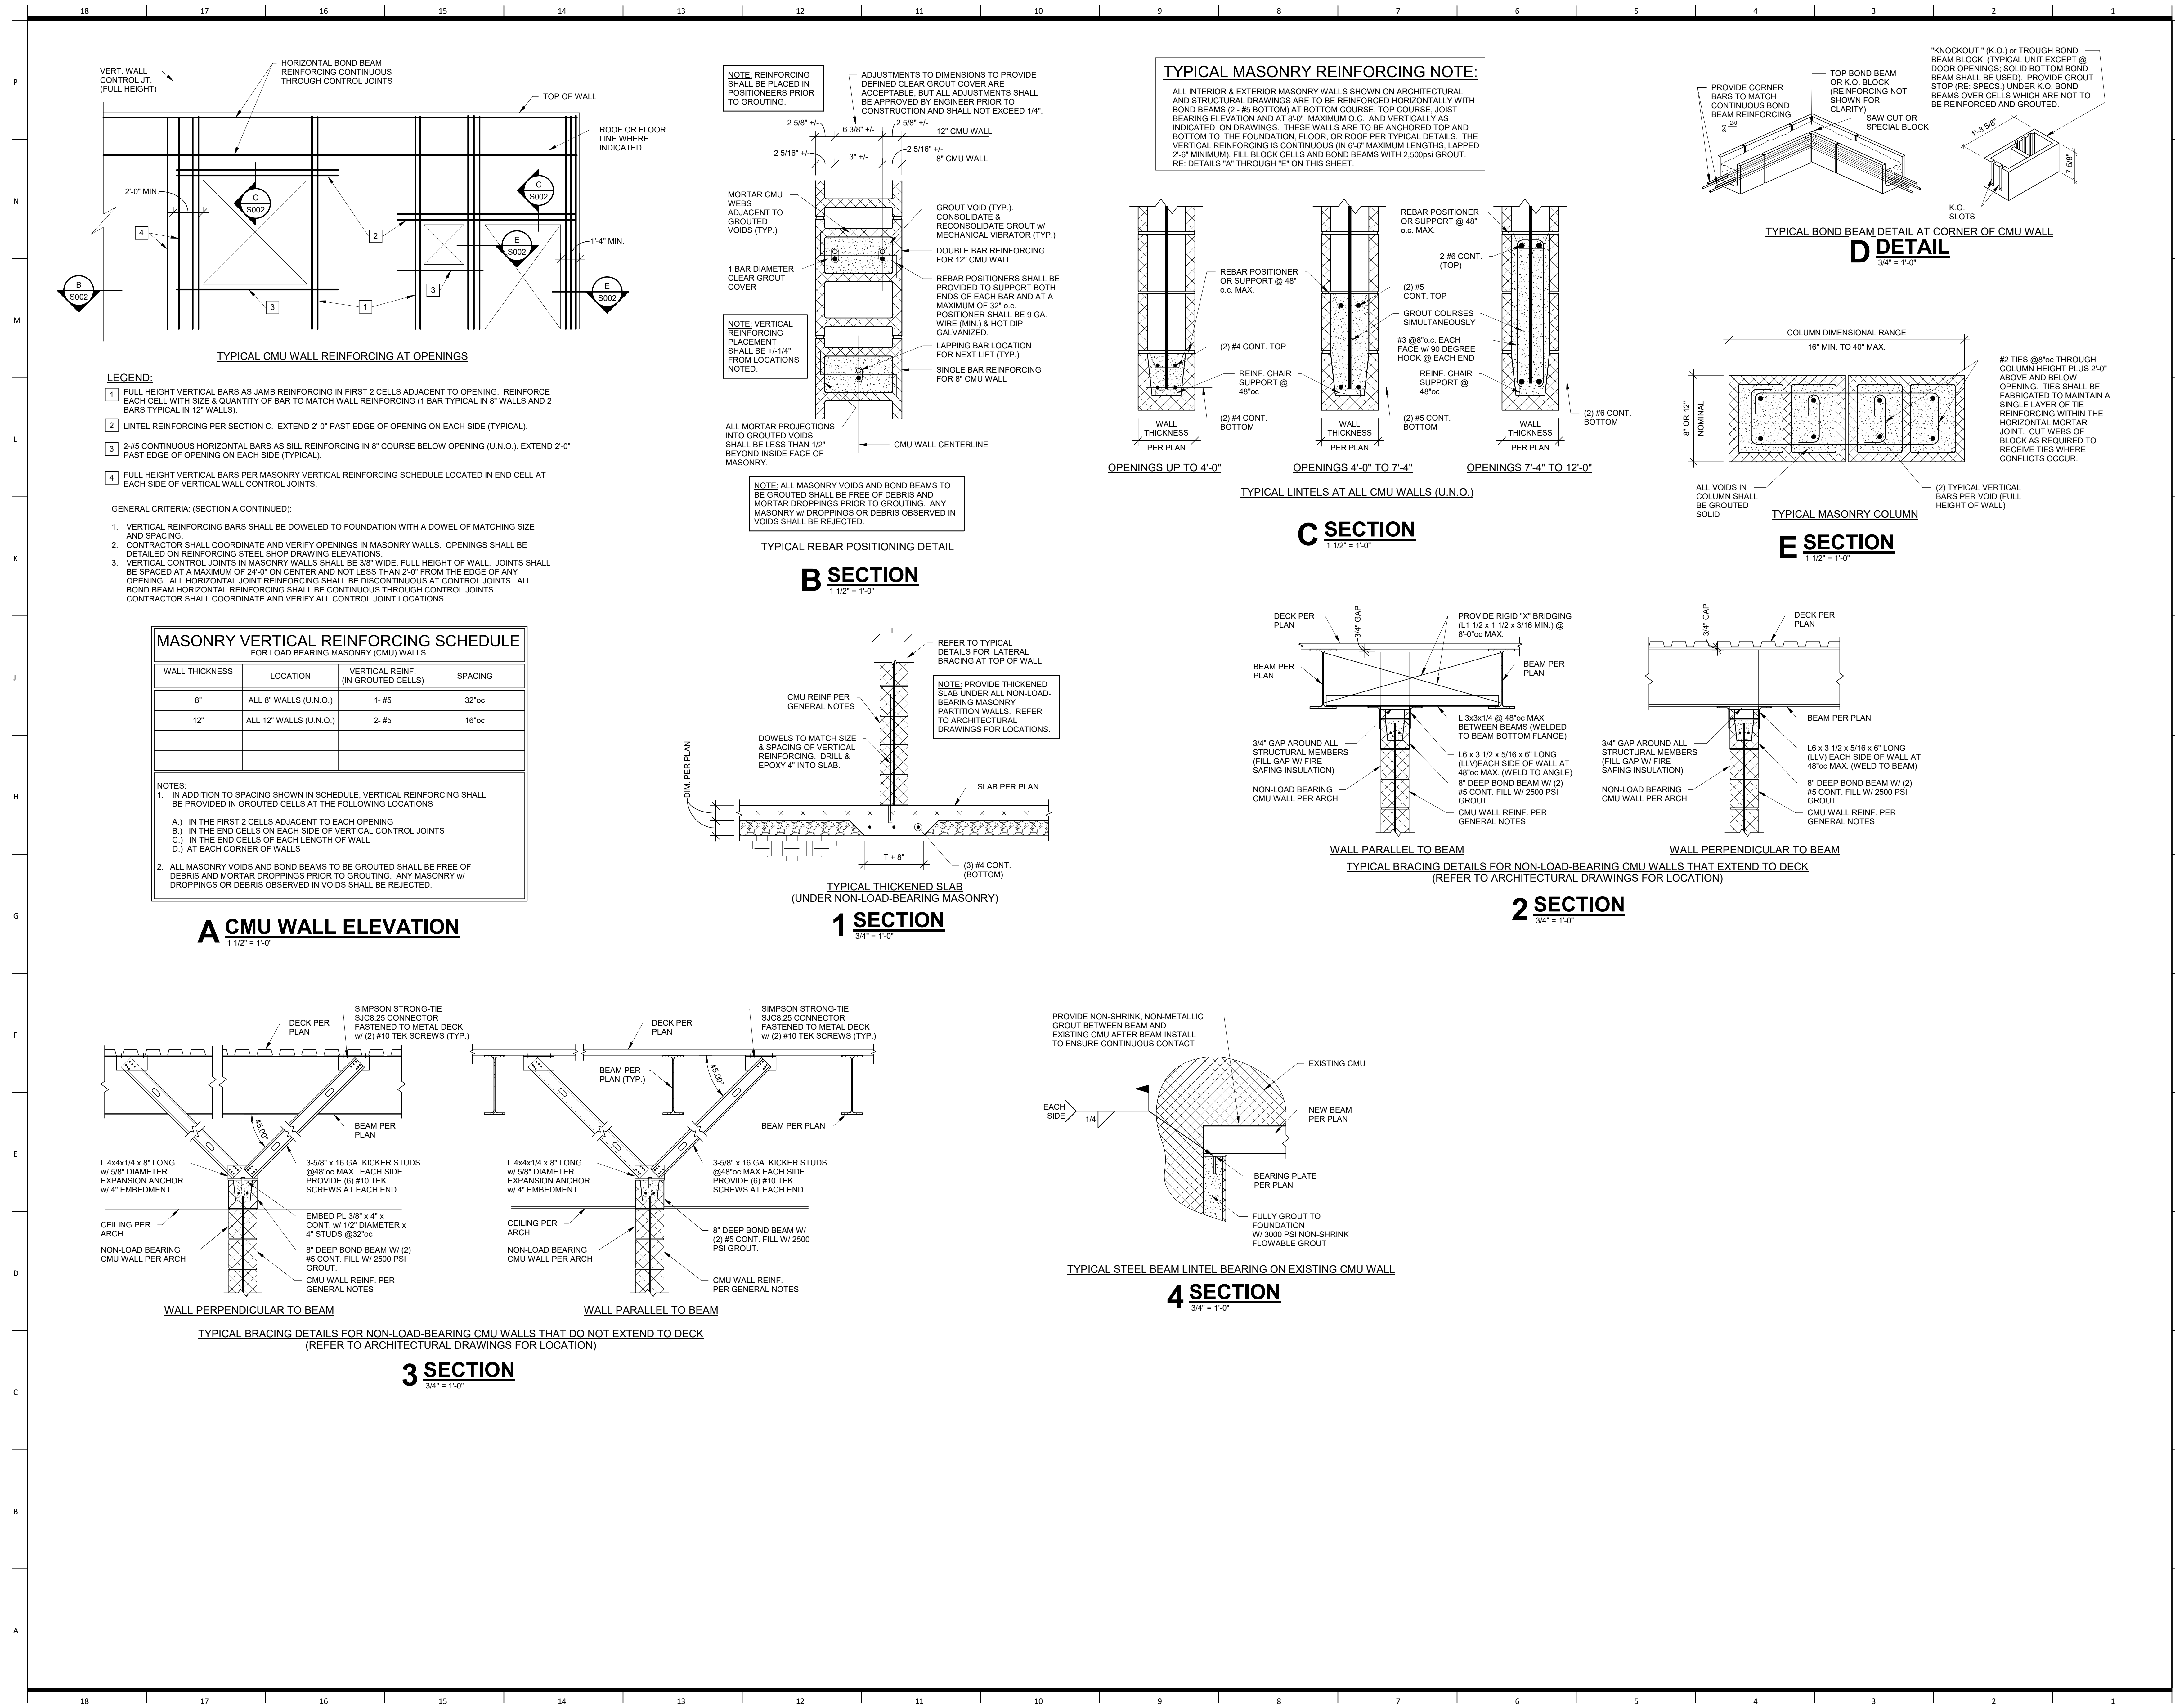



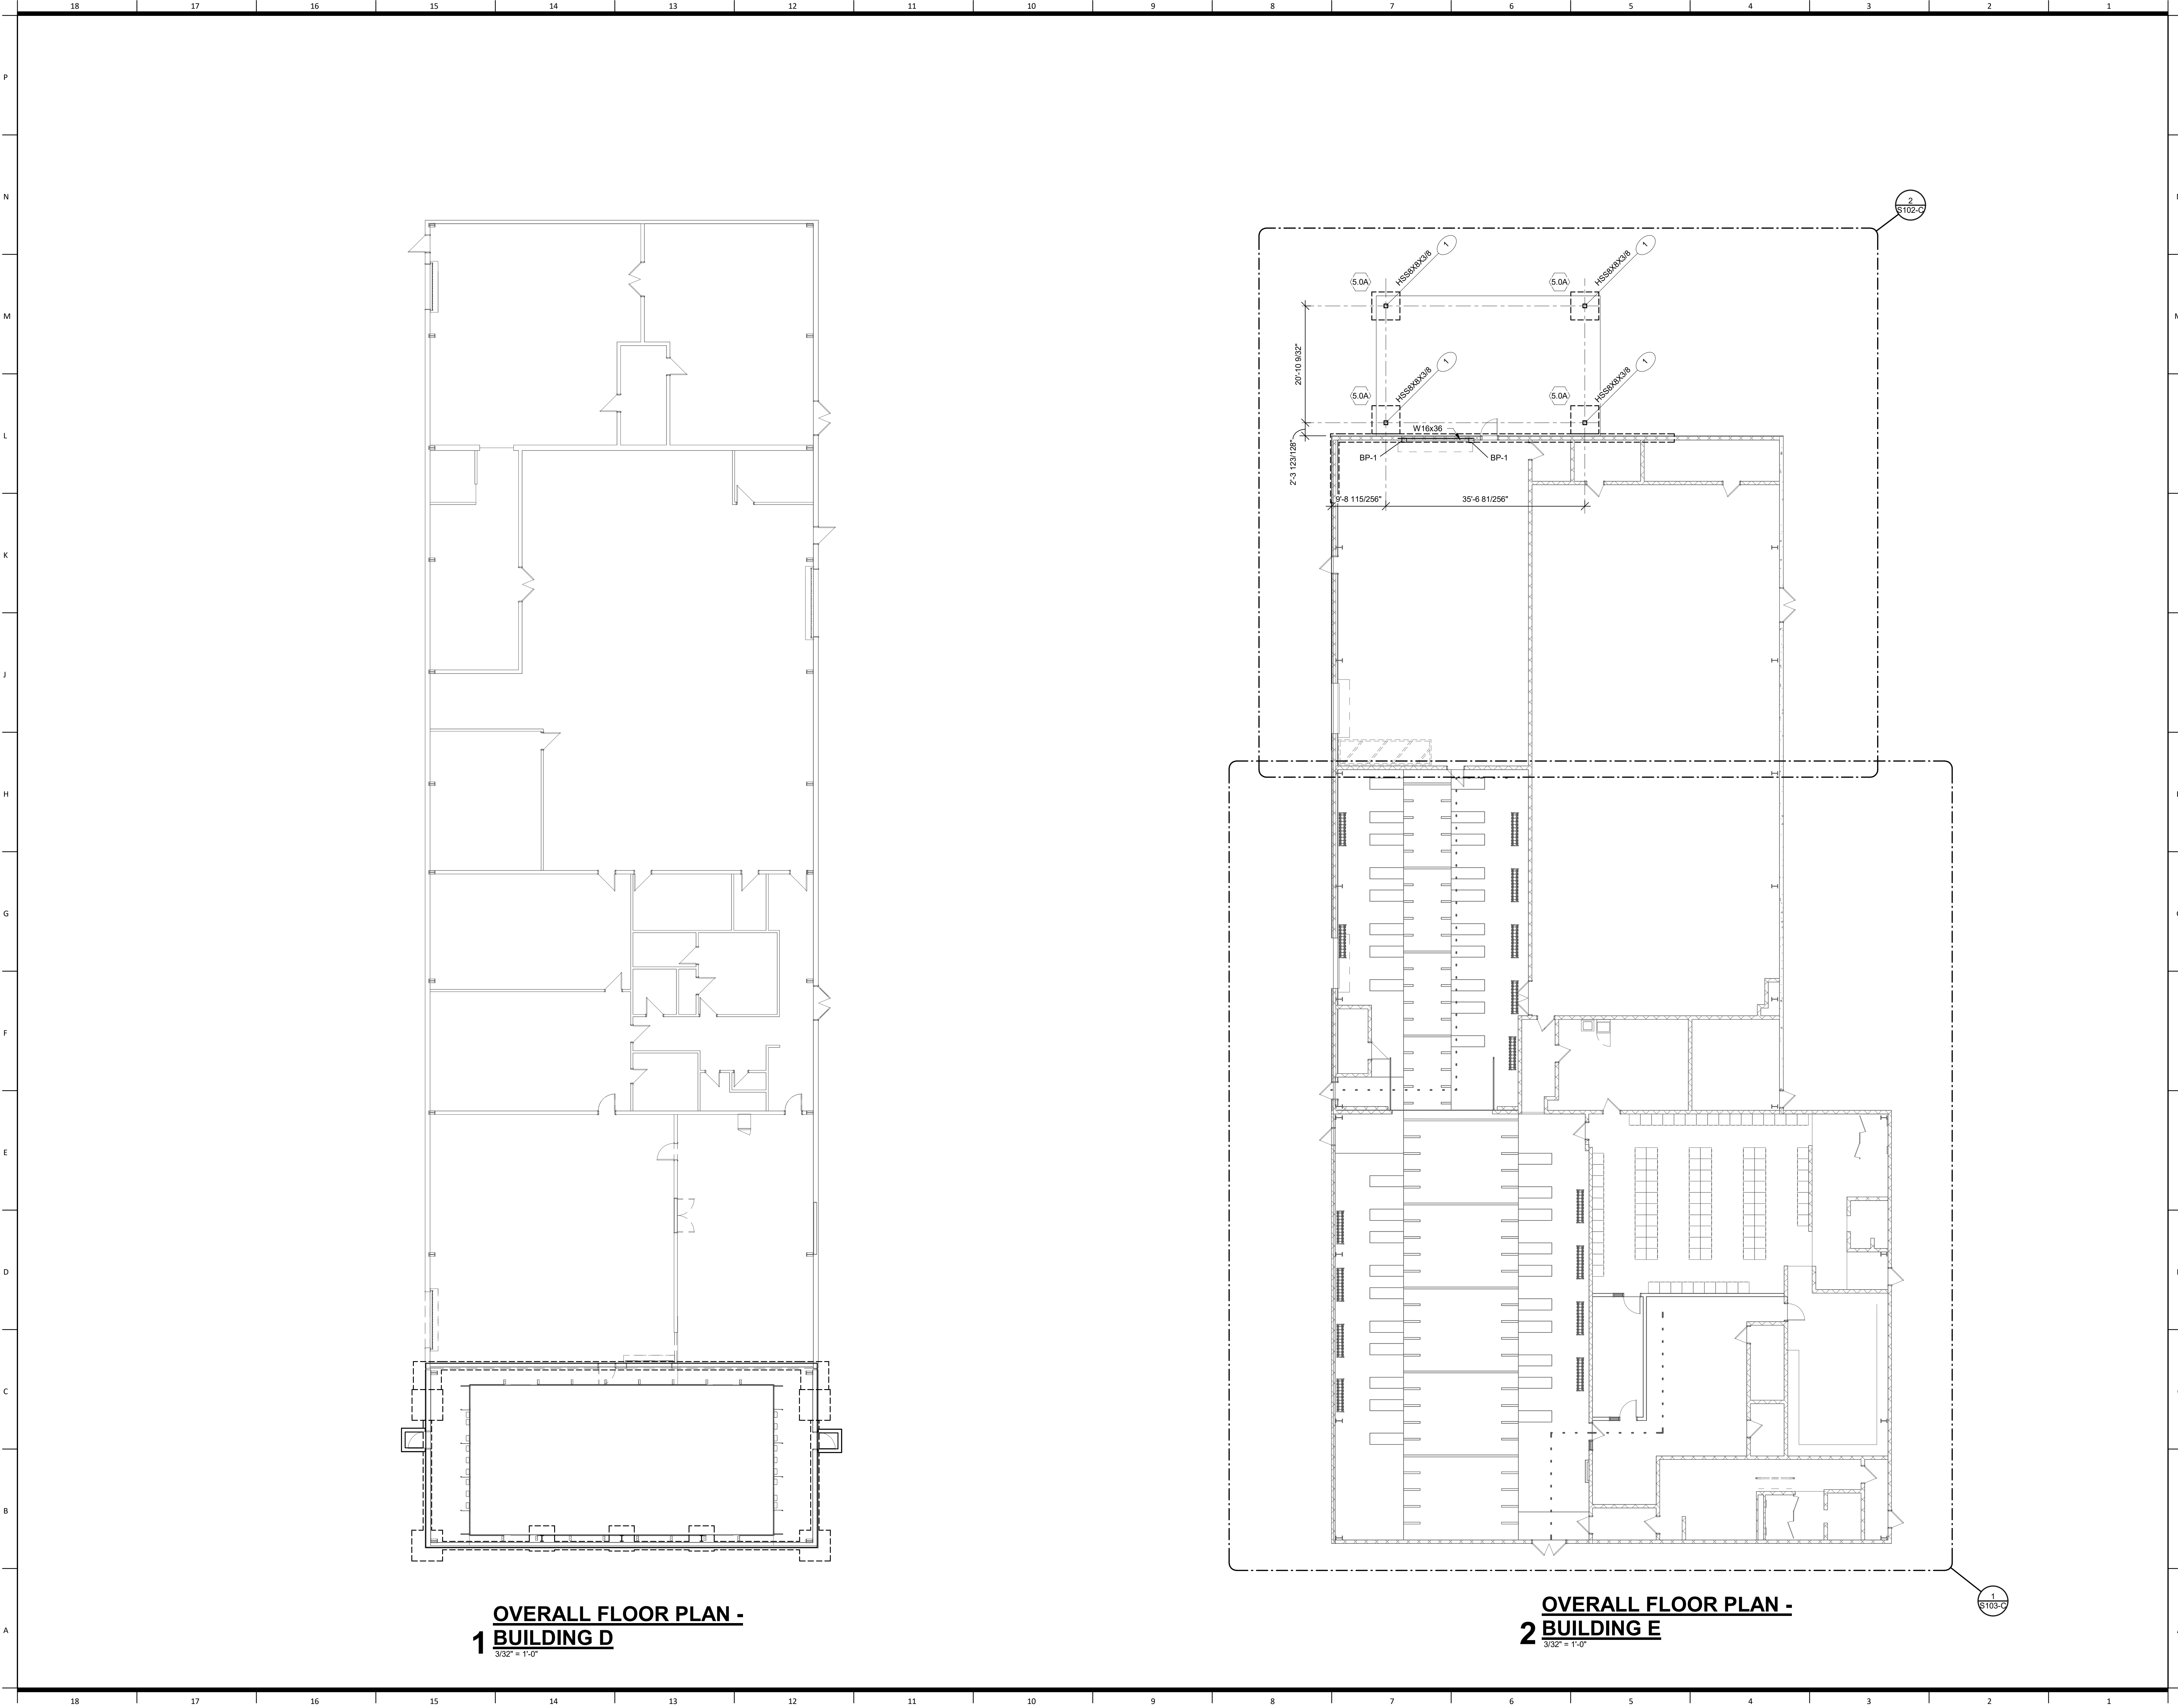

**OVERALL FLOOR PLAN -**  
**1 BUILDING D**  
3/32" = 1'-0"

**OVERALL FLOOR PLAN -**  
**2 BUILDING E**  
3/32" = 1'-0"

**multistudio**  
the evolution of gould evans

**LSR7 Robotics, GiC & Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100


owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086  
architect: Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi-studio  
civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kvang.com  
structural engineer: Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/PT/Code: Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

Issue Date: September 9, 2022

Revisions		
NUMBER	DESCRIPTION	DATE

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION.

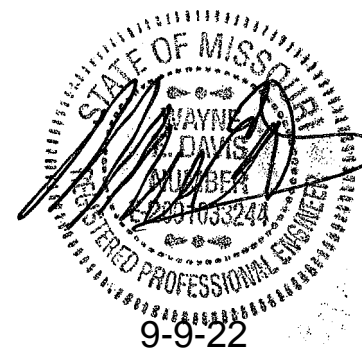

**OVERALL FLOOR PLANS**  
**- BUILDING D & E**

**S101-C**






NUMBER	DESCRIPTION	
--------	-------------	--

#### 4 BASE PLATE DETAIL

# S102-C



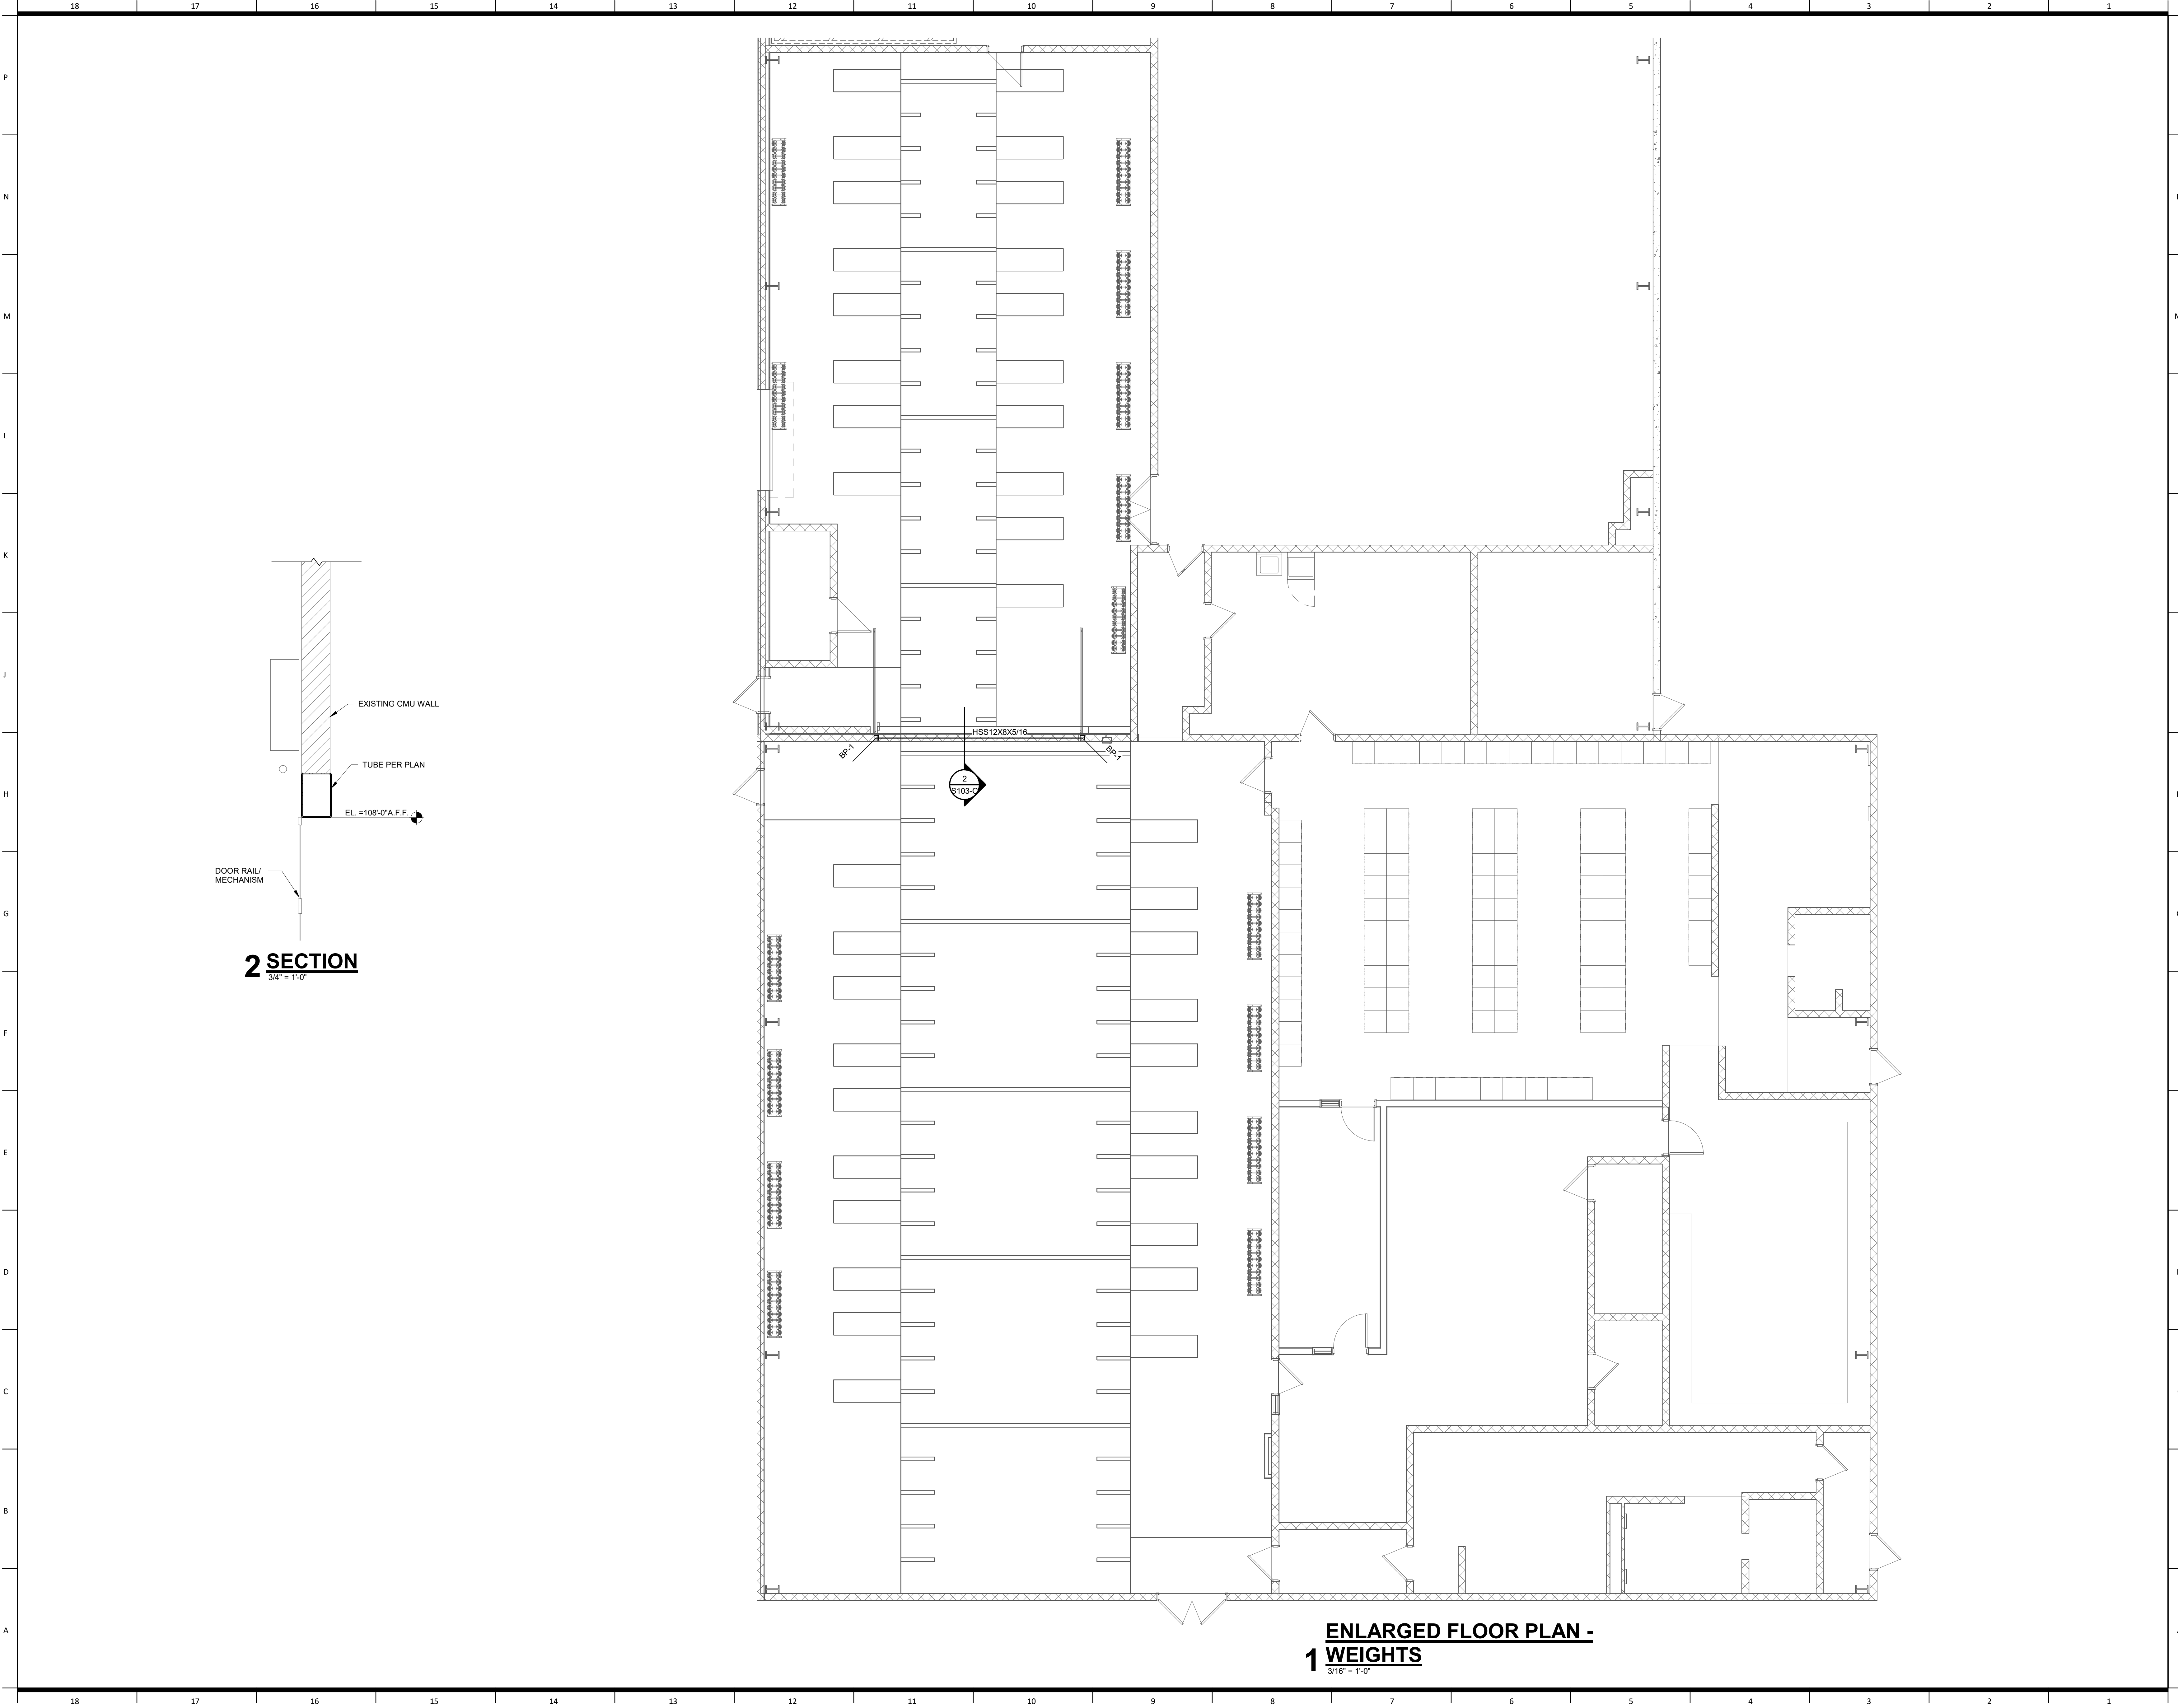

**LSR7 Robotics, GiC & Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100

owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086  
multi-studio

architect: Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816.931.6655

civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com


structural engineer: Bob D. Campbell &  
4338 Belview  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/T/Code: Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

Issue Date: September 9, 2022

Revisions		
NUMBER	DESCRIPTION	DATE

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

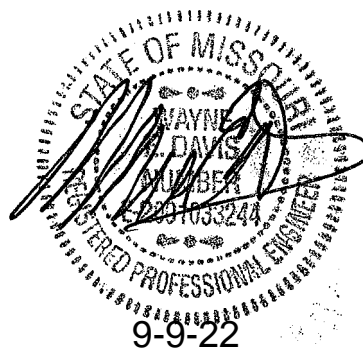

**ENLARGED FLOOR PLAN - WEIGHTS**

**S103-C**



LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100

owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086  
architect: Multistudio  
4205 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi-studio  
civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kvang.com  
structural engineer: Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com


MEP/IT/Code: Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

Issue Date: September 9, 2022

Revisions


NUMBER	DESCRIPTION	DATE
--------	-------------	------

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

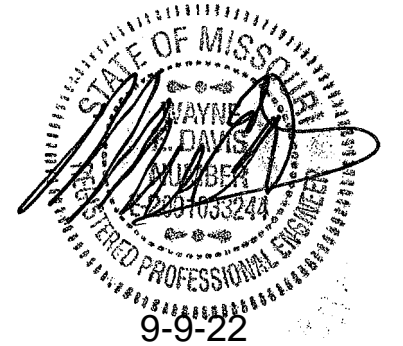


ROOF FRAMING PLAN

S111-C

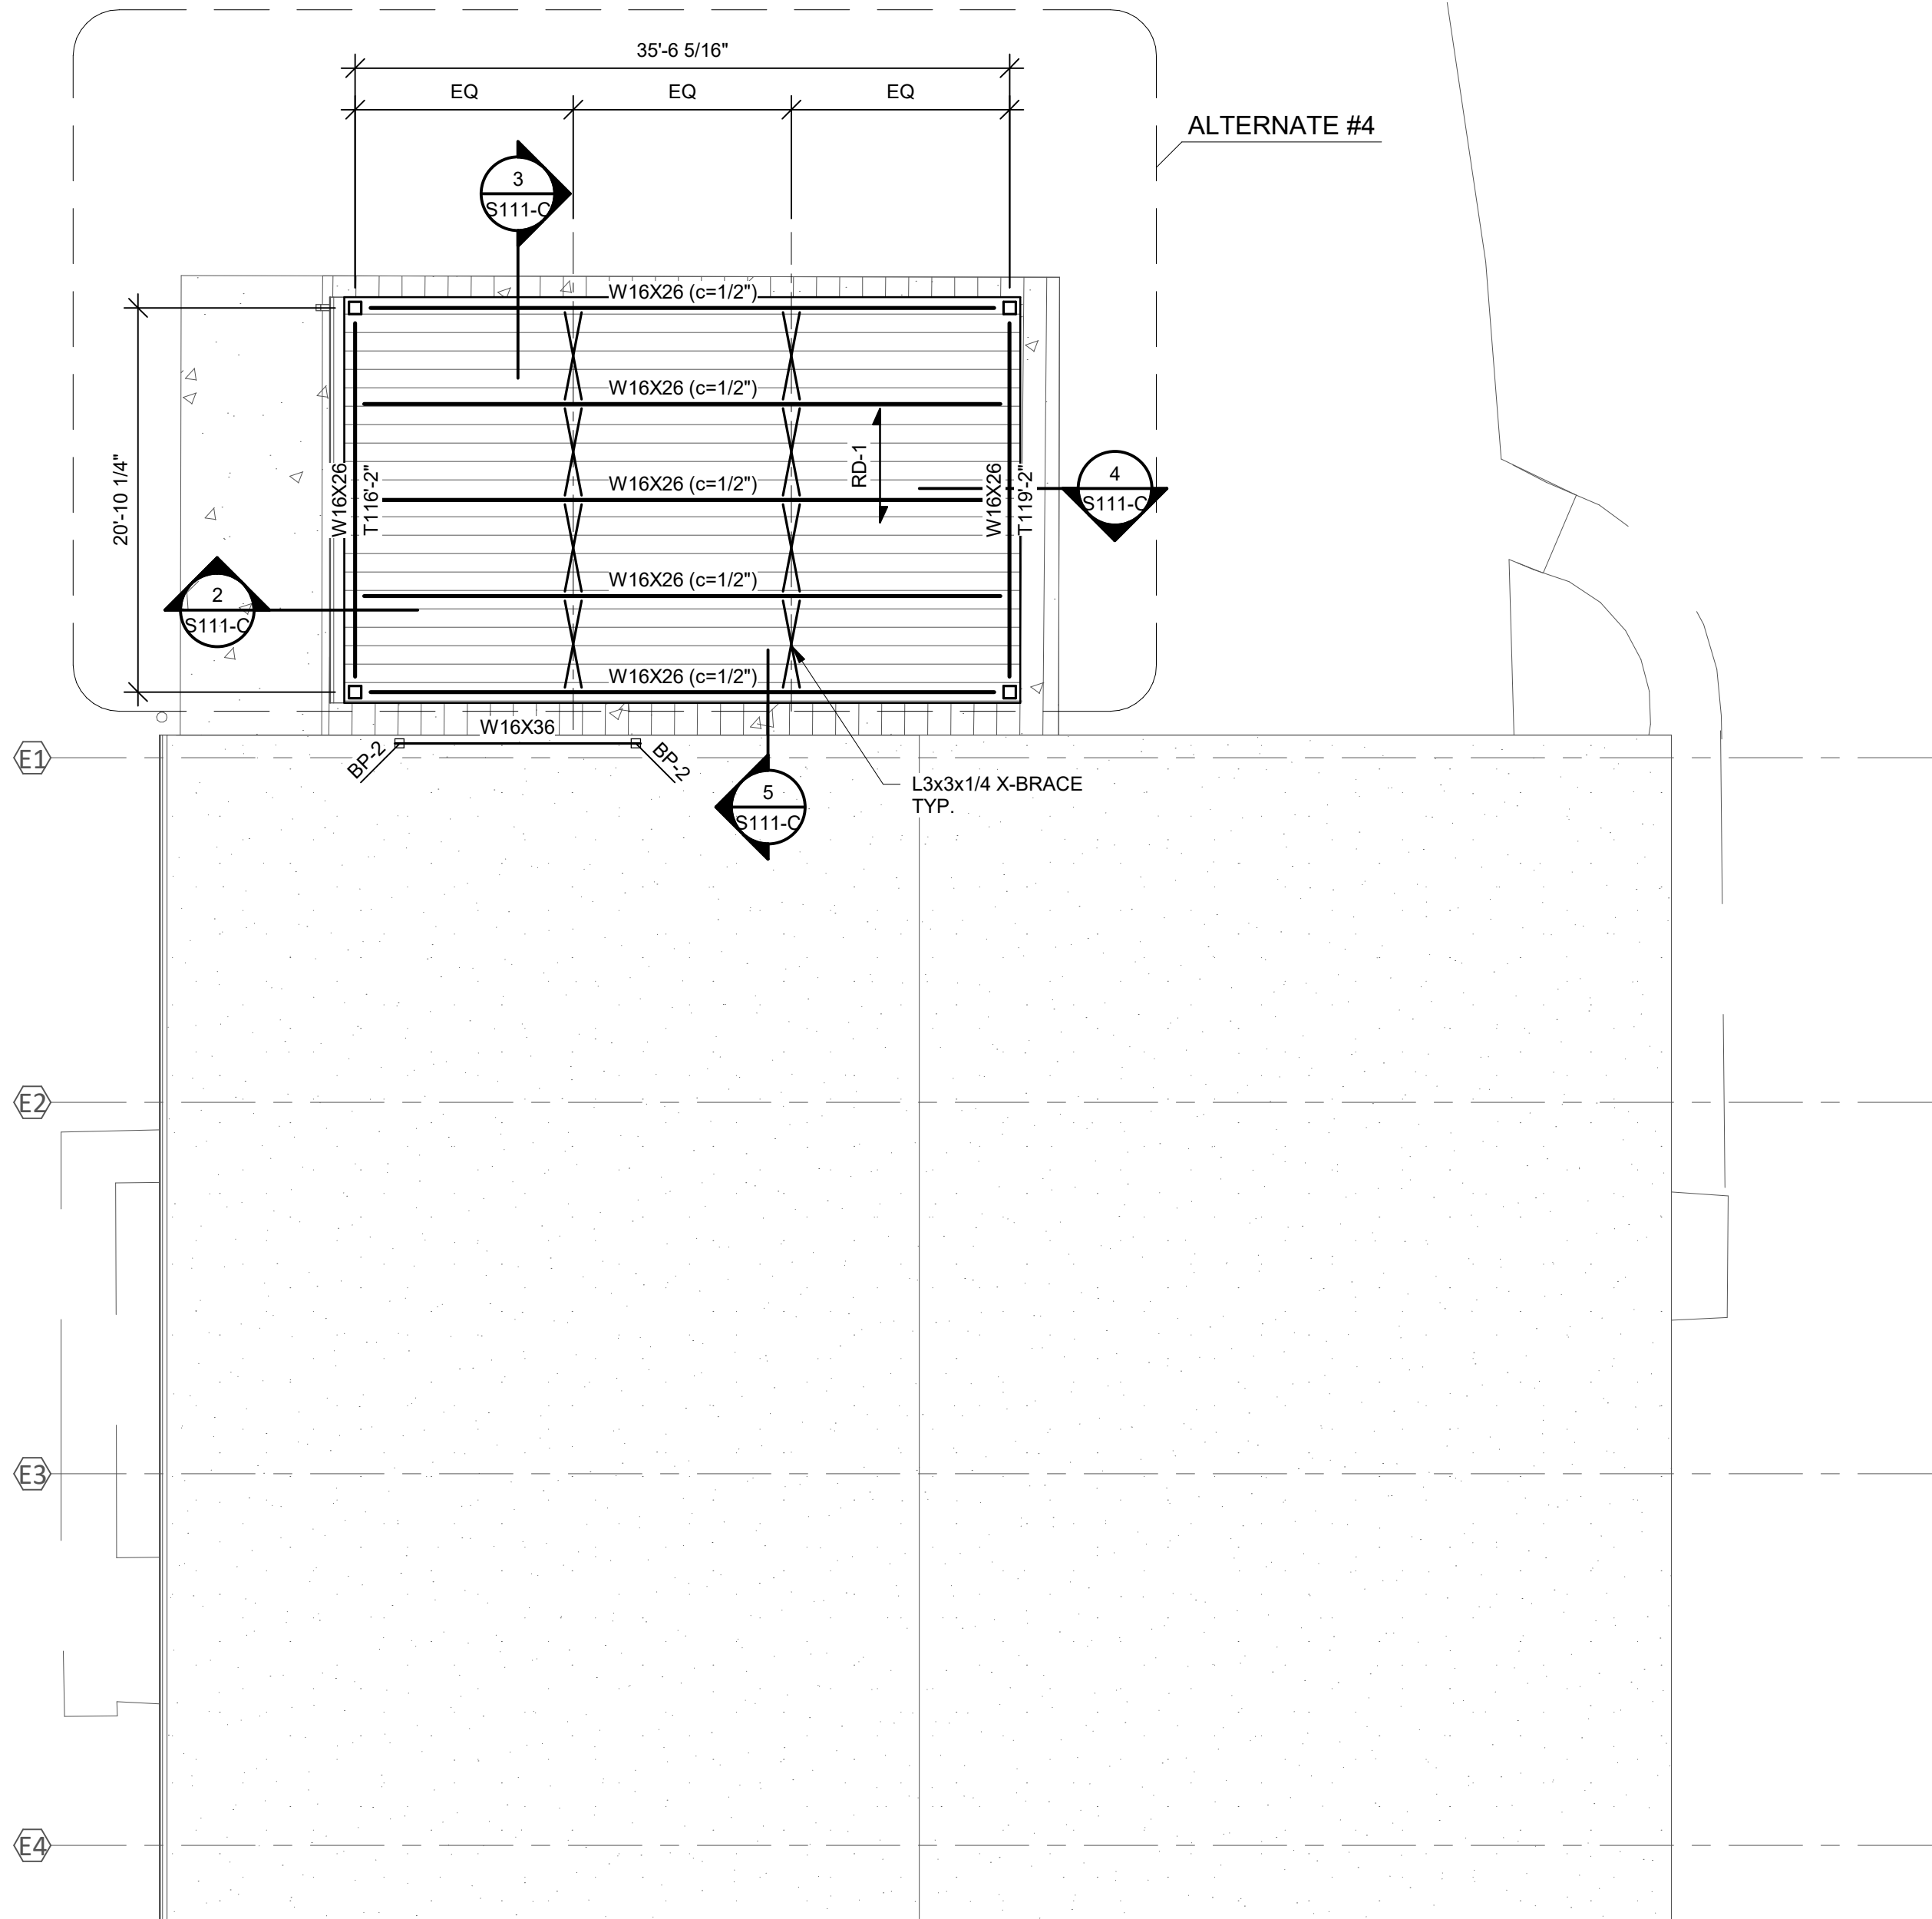


1 ROOF FRAMING PLAN  
1/8" = 1'-0"


2 SECTION  
3/4" = 1'-0"  
(ALTERNATE #4)

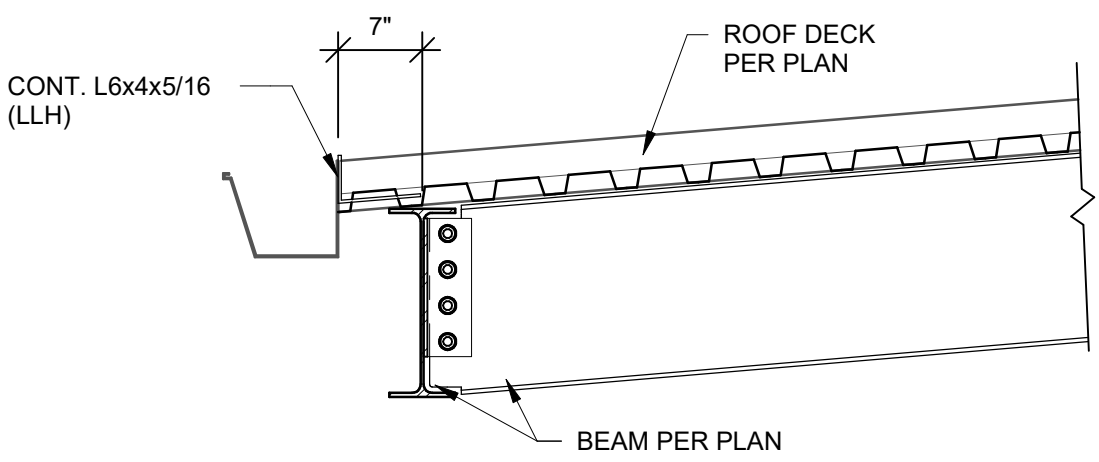


3 SECTION  
3/4" = 1'-0"  
(ALTERNATE #4)

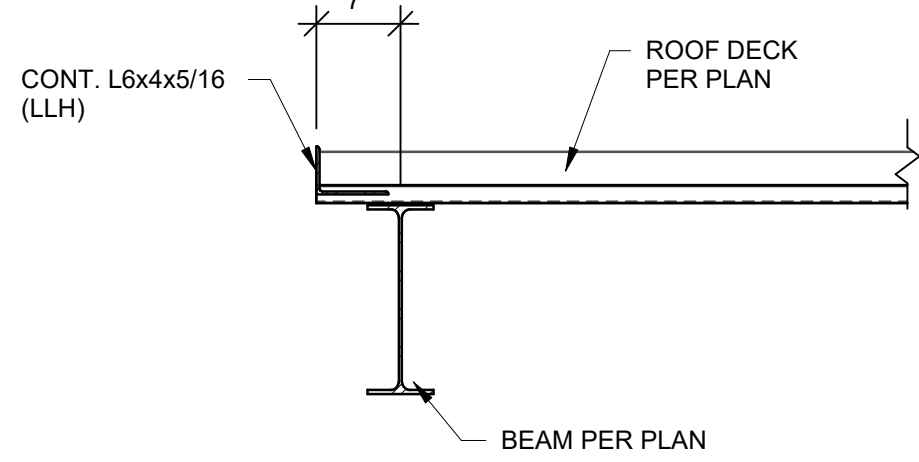

4 SECTION  
3/4" = 1'-0"  
(ALTERNATE #4)

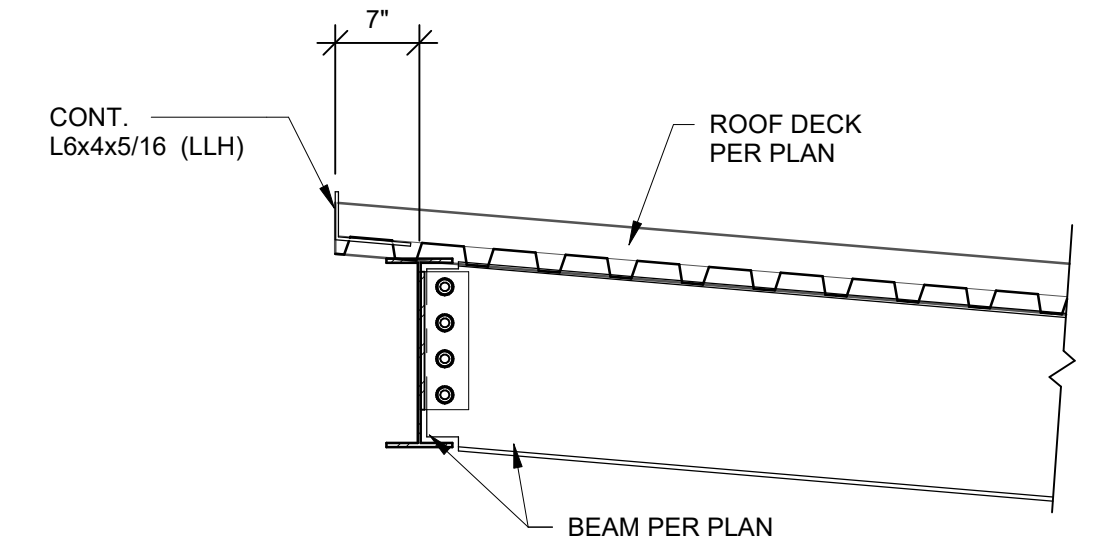

5 SECTION  
3/4" = 1'-0"  
(ALTERNATE #4)

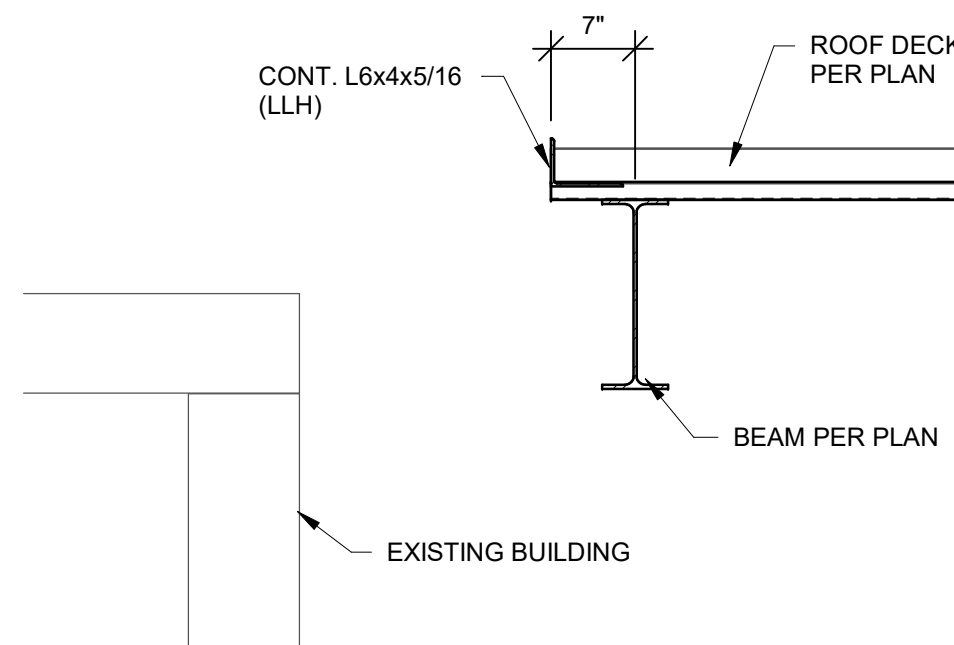



LSR7 Robotics, GiC &  
Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO  
64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO  
64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086  
multistudio

architect:  
Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816.931.6655

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kvegeng.com

structural engineer:  
Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com


MEP/IT/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

Issue Date: September 9, 2022


Revisions

NUMBER DESCRIPTION DATE

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS  
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR  
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

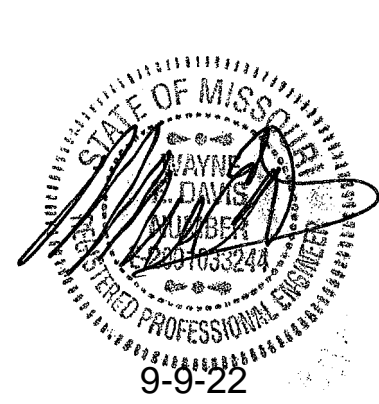


FOUNDATION  
SECTIONS  
**S200-C**

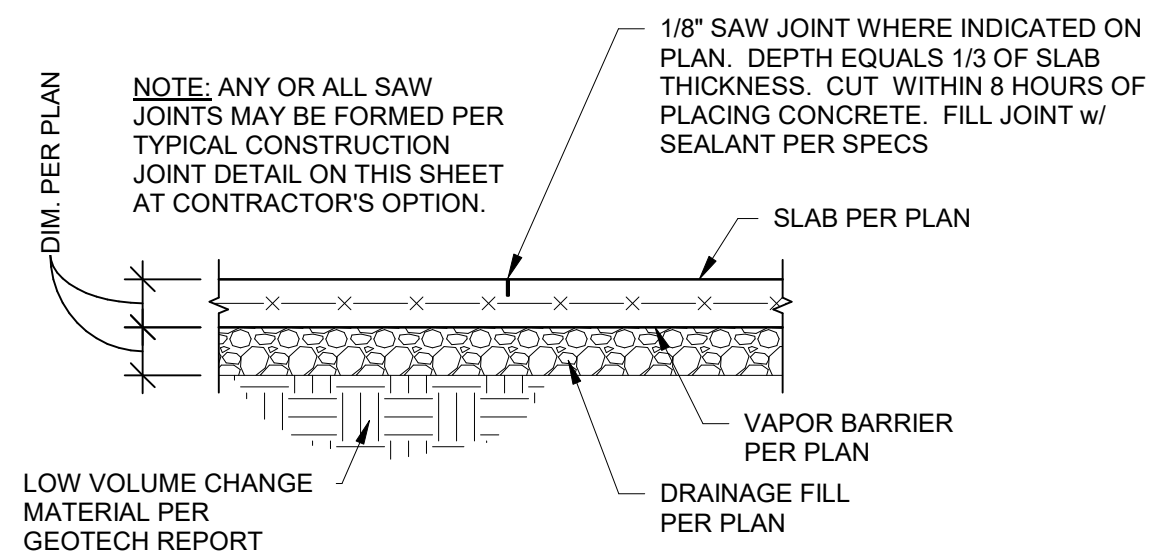

TYPICAL SAW JOINT  
NOTED "SJ" ON PLAN

**1 SECTION**


3/4" = 1'-0"

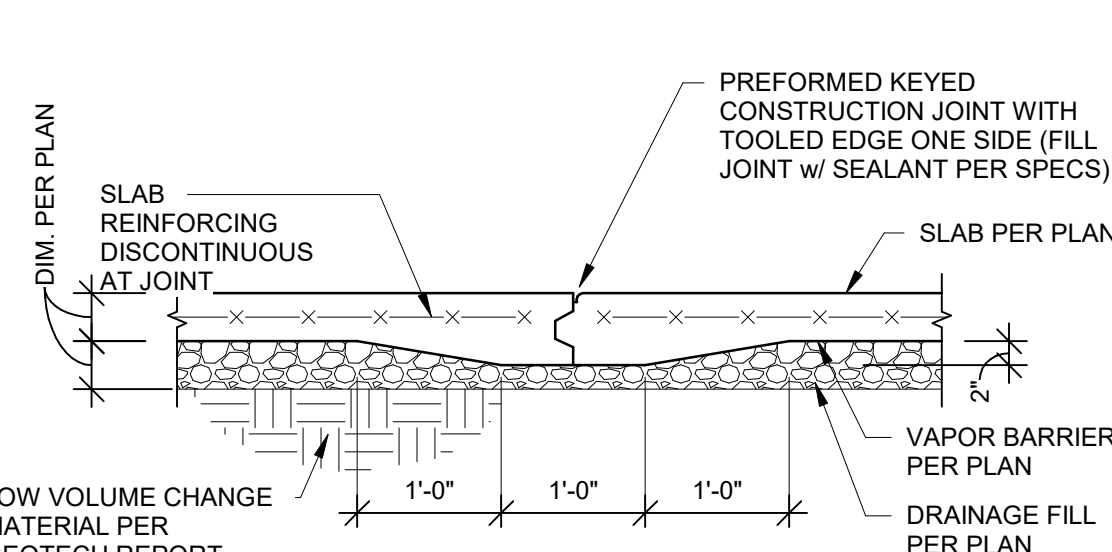


TYPICAL CONSTRUCTION JOINT  
NOTED "CJ" ON PLAN

**2 SECTION**


3/4" = 1'-0"

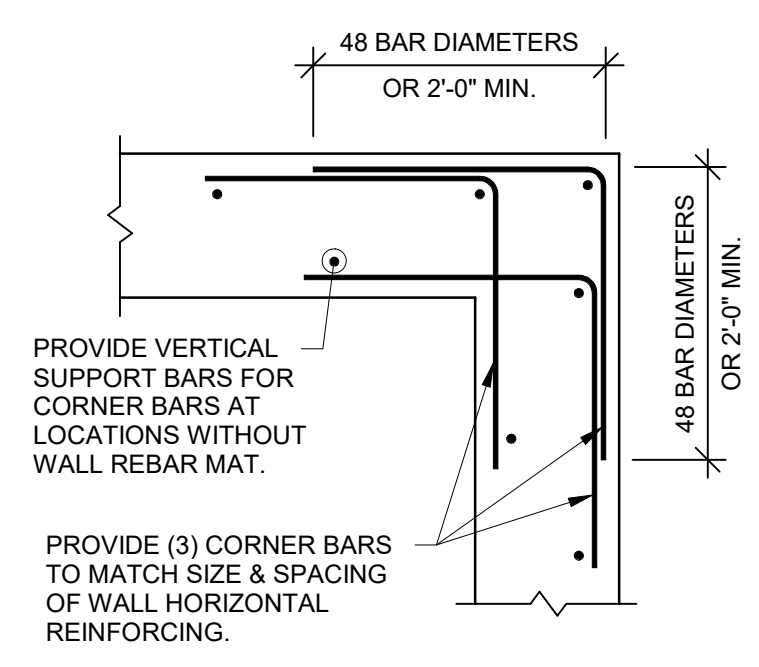

TYPICAL CORNER BARS AT  
CONCRETE WALLS & FOUNDATIONS

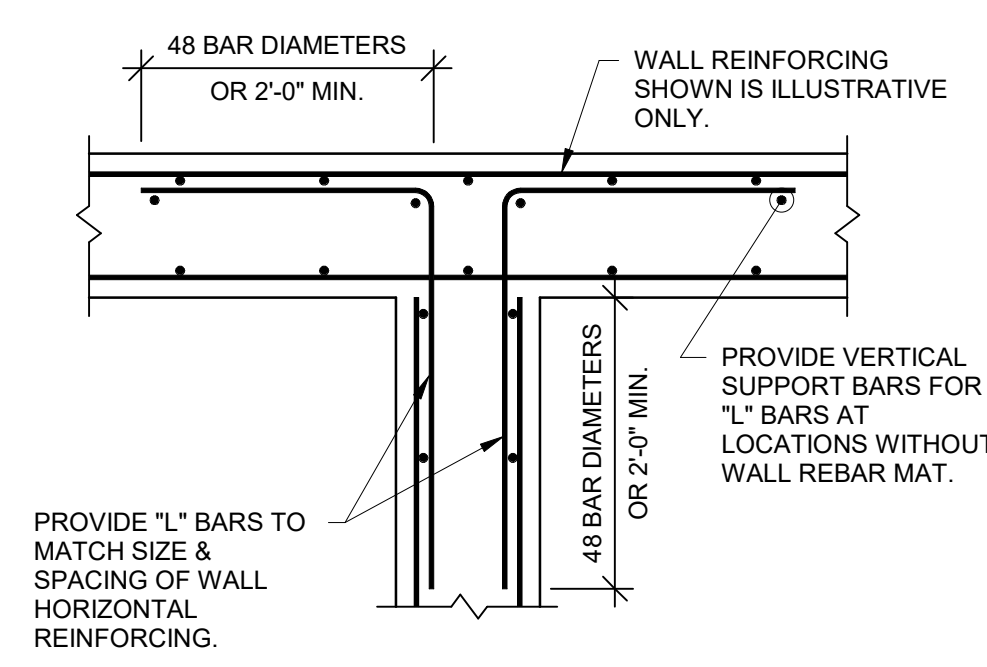


TYPICAL T-INTERSECTION REINFORCING  
AT CONCRETE WALLS & FOUNDATIONS

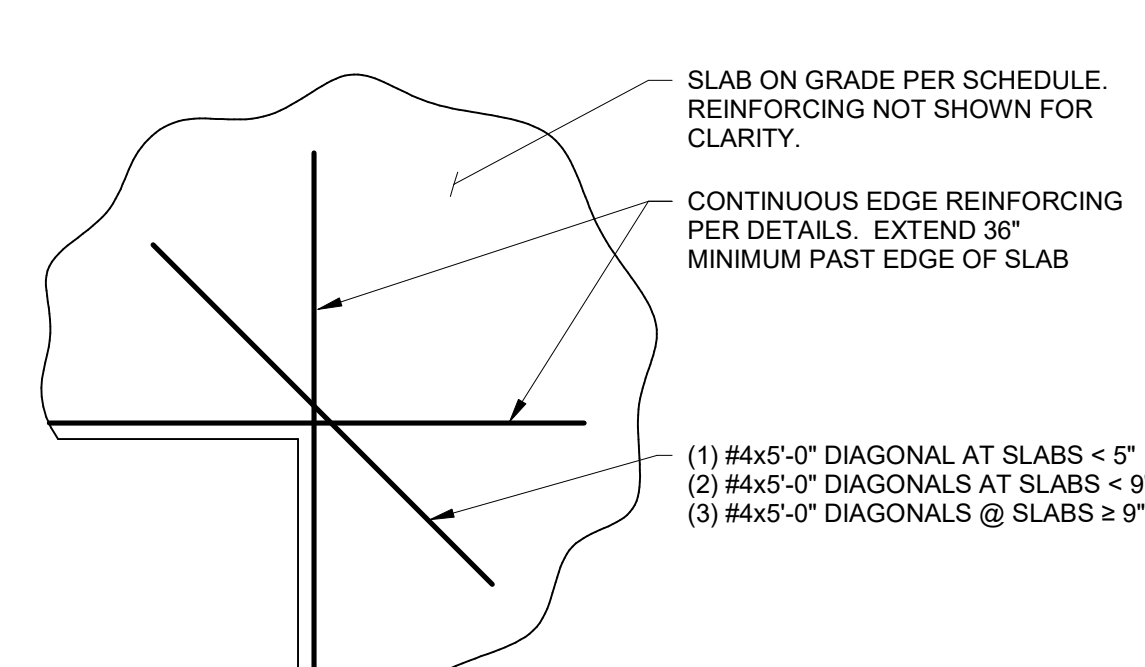

TYPICAL SLAB ON GRADE RE-ENTRANT CORNER BARS


**4 DETAIL**

1/2" = 1'-0"

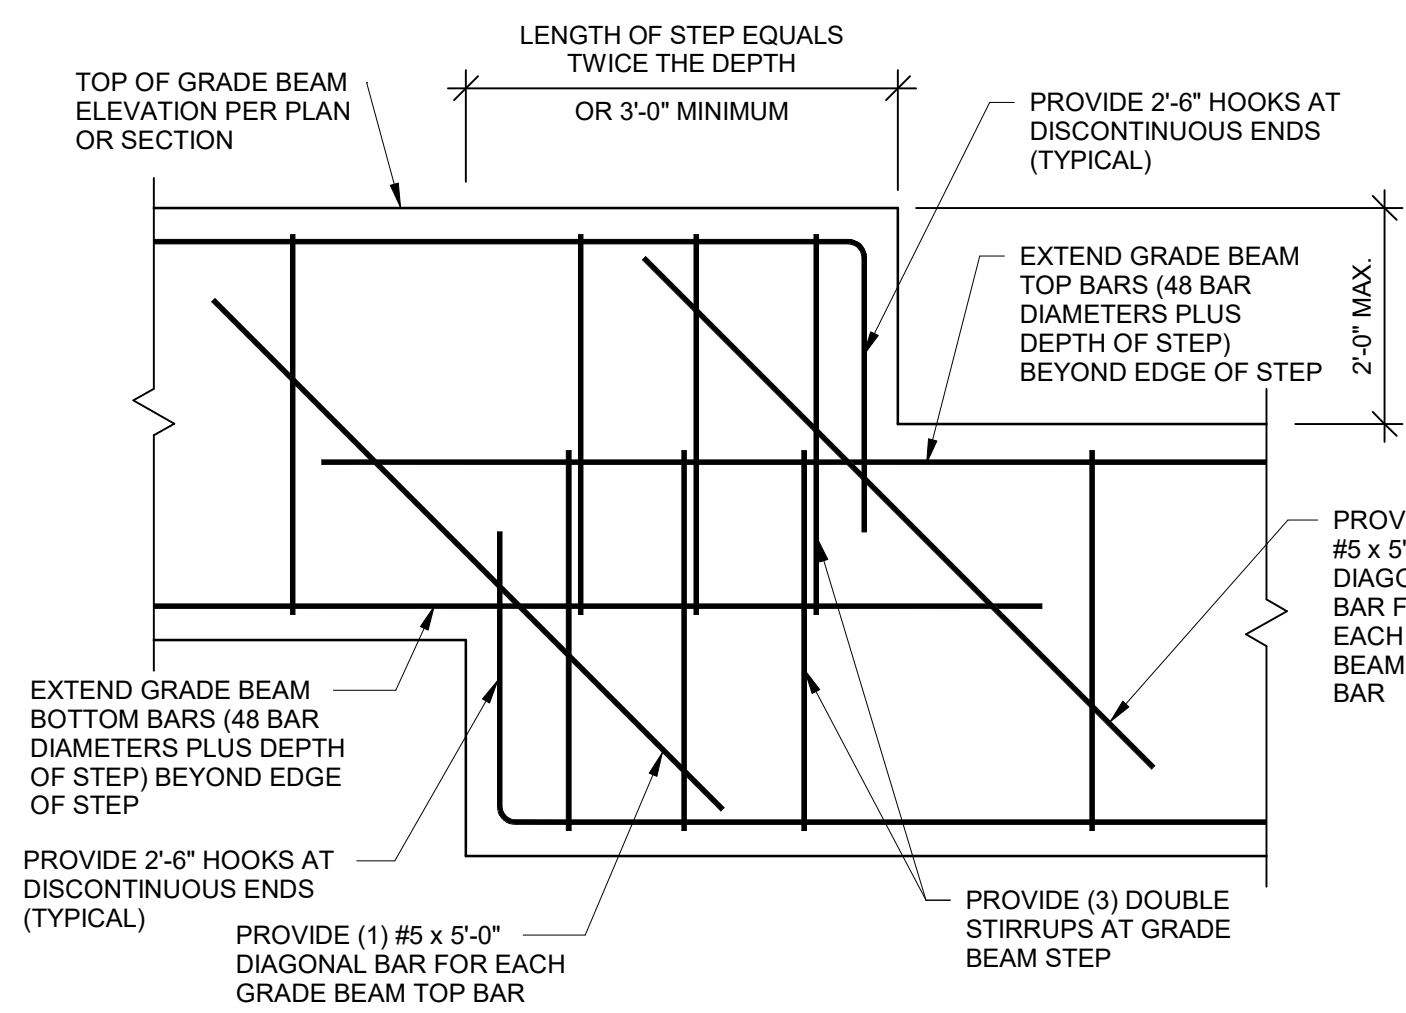

**5 TYPICAL GRADE BEAM STEP**

3/4" = 1'-0"

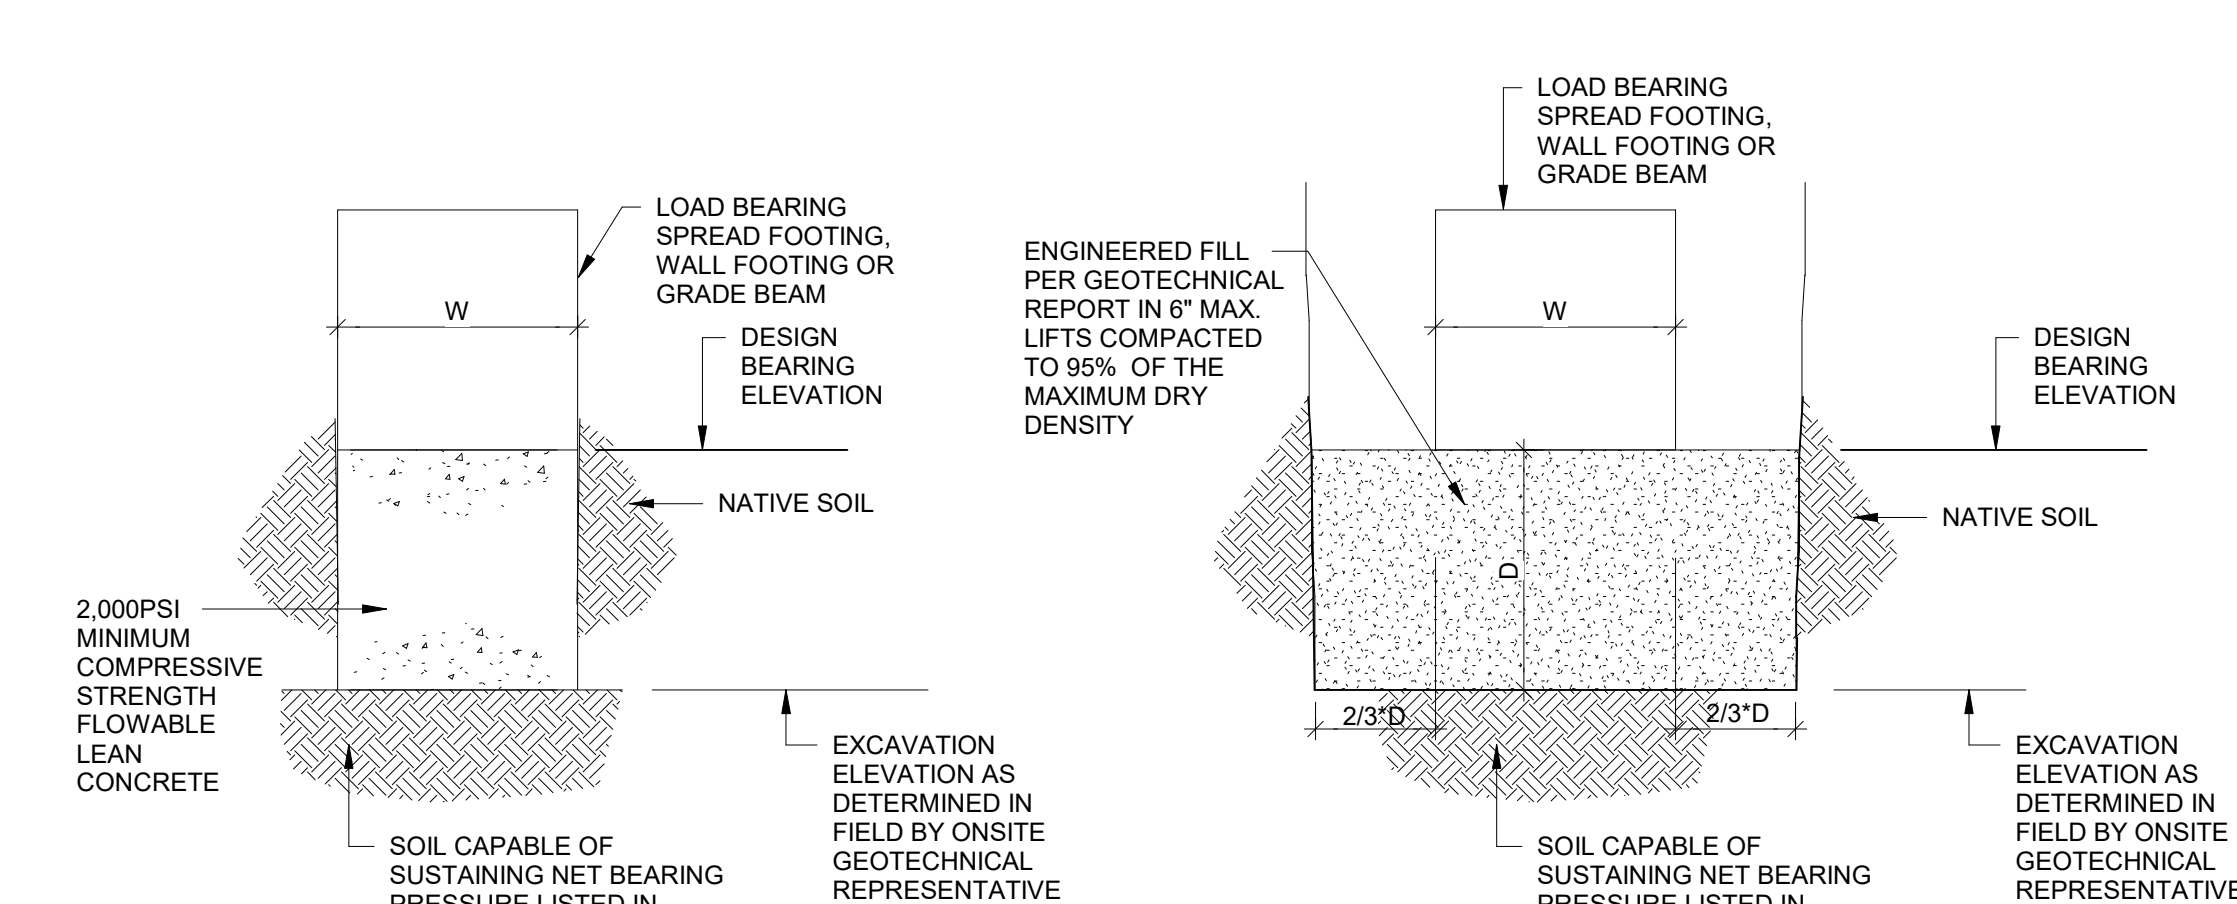


LEAN CONCRETE BACKFILL

ENGINEERED FILL BACKFILL

**6 OVEREXCAVATION DETAIL**


3/4" = 1'-0"

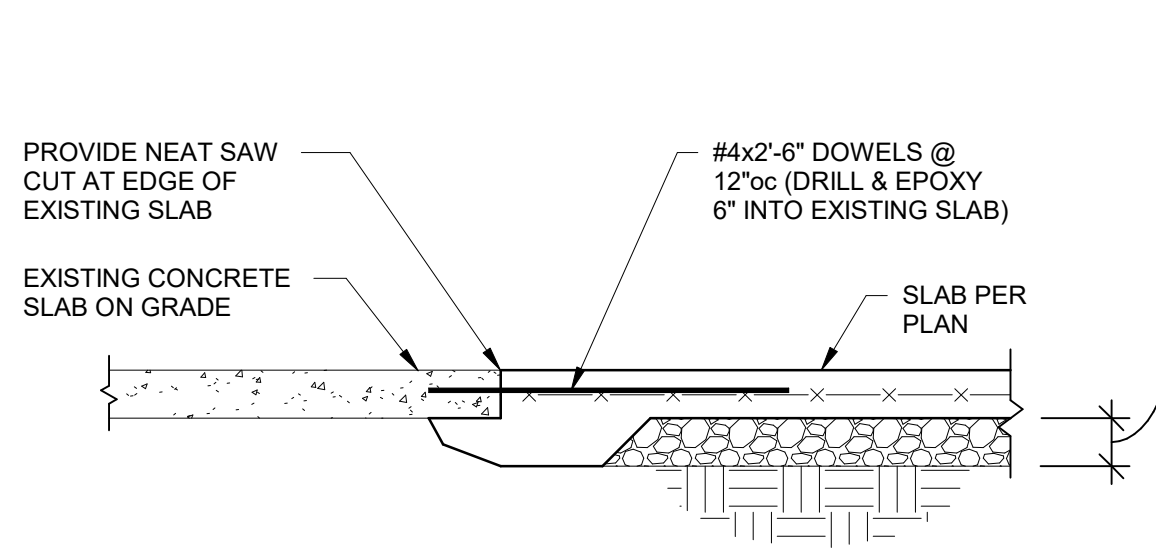

TYPICAL AT NEW-TO-EXISTING SLAB ON GRADE

**8 SECTION**


3/4" = 1'-0"

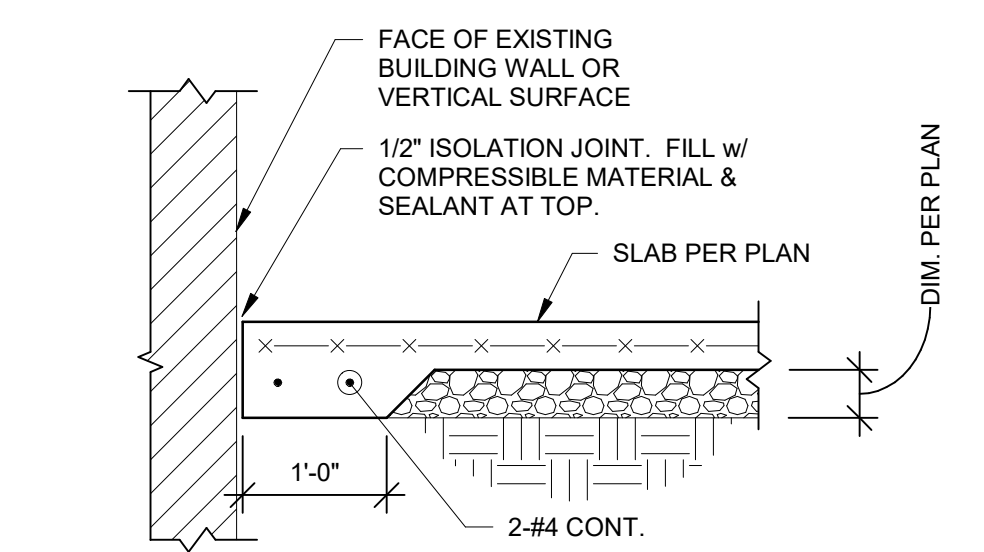

TYPICAL SLAB EDGE DETAIL AGAINST EXISTING  
BUILDING WALL OR VERTICAL SURFACE


**9 SECTION**

3/4" = 1'-0"

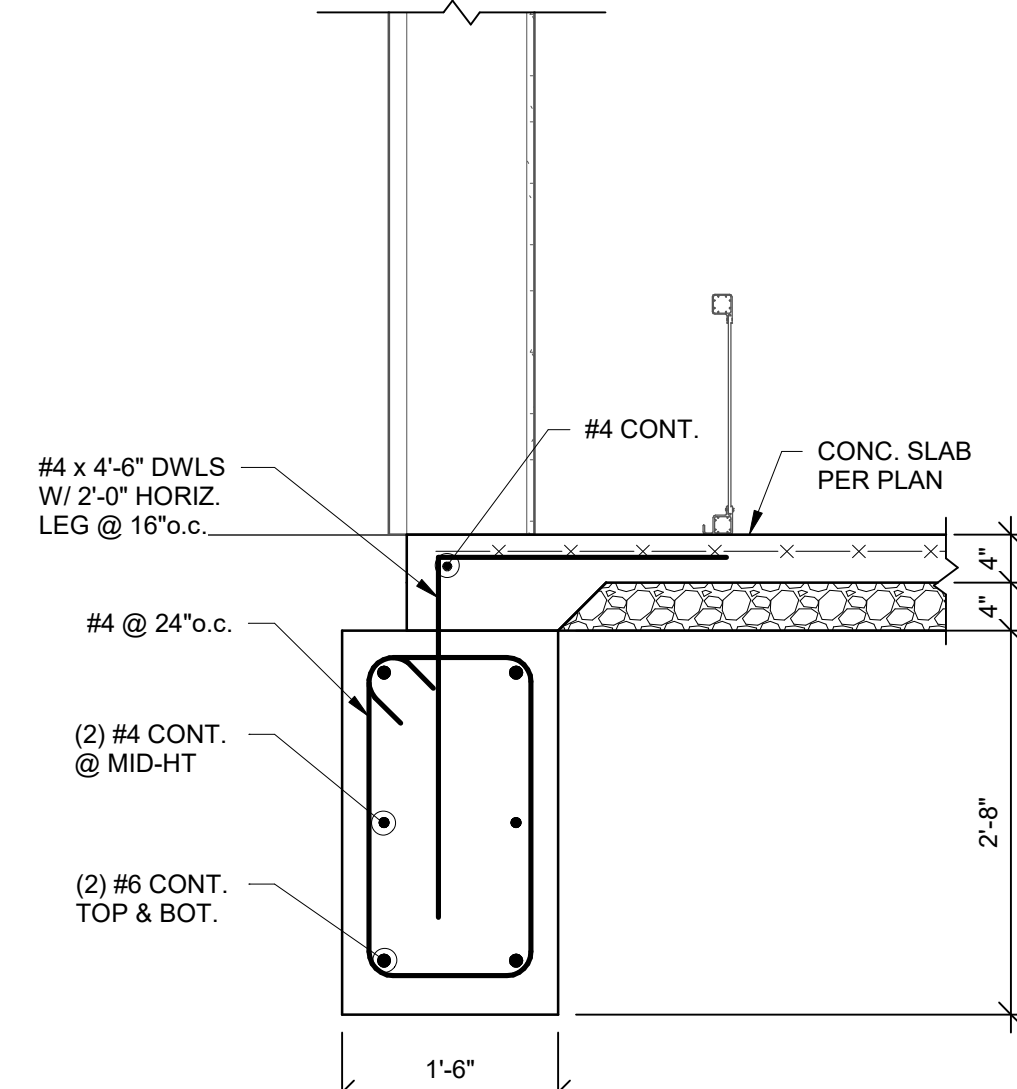


**10 SECTION**

3/4" = 1'-0"

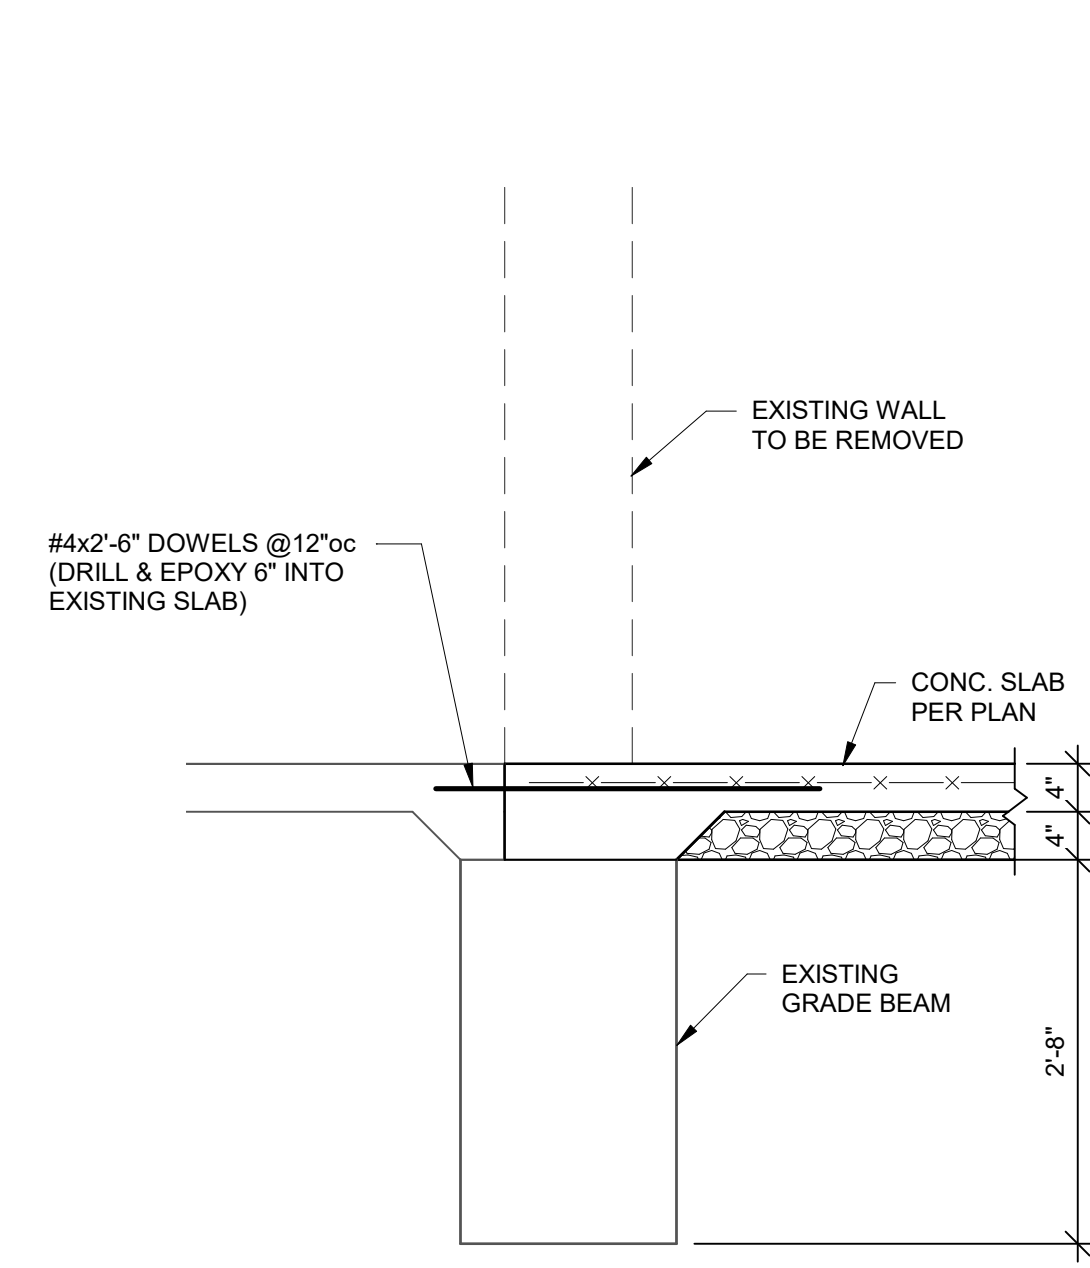


**11 SECTION**

3/4" = 1'-0"

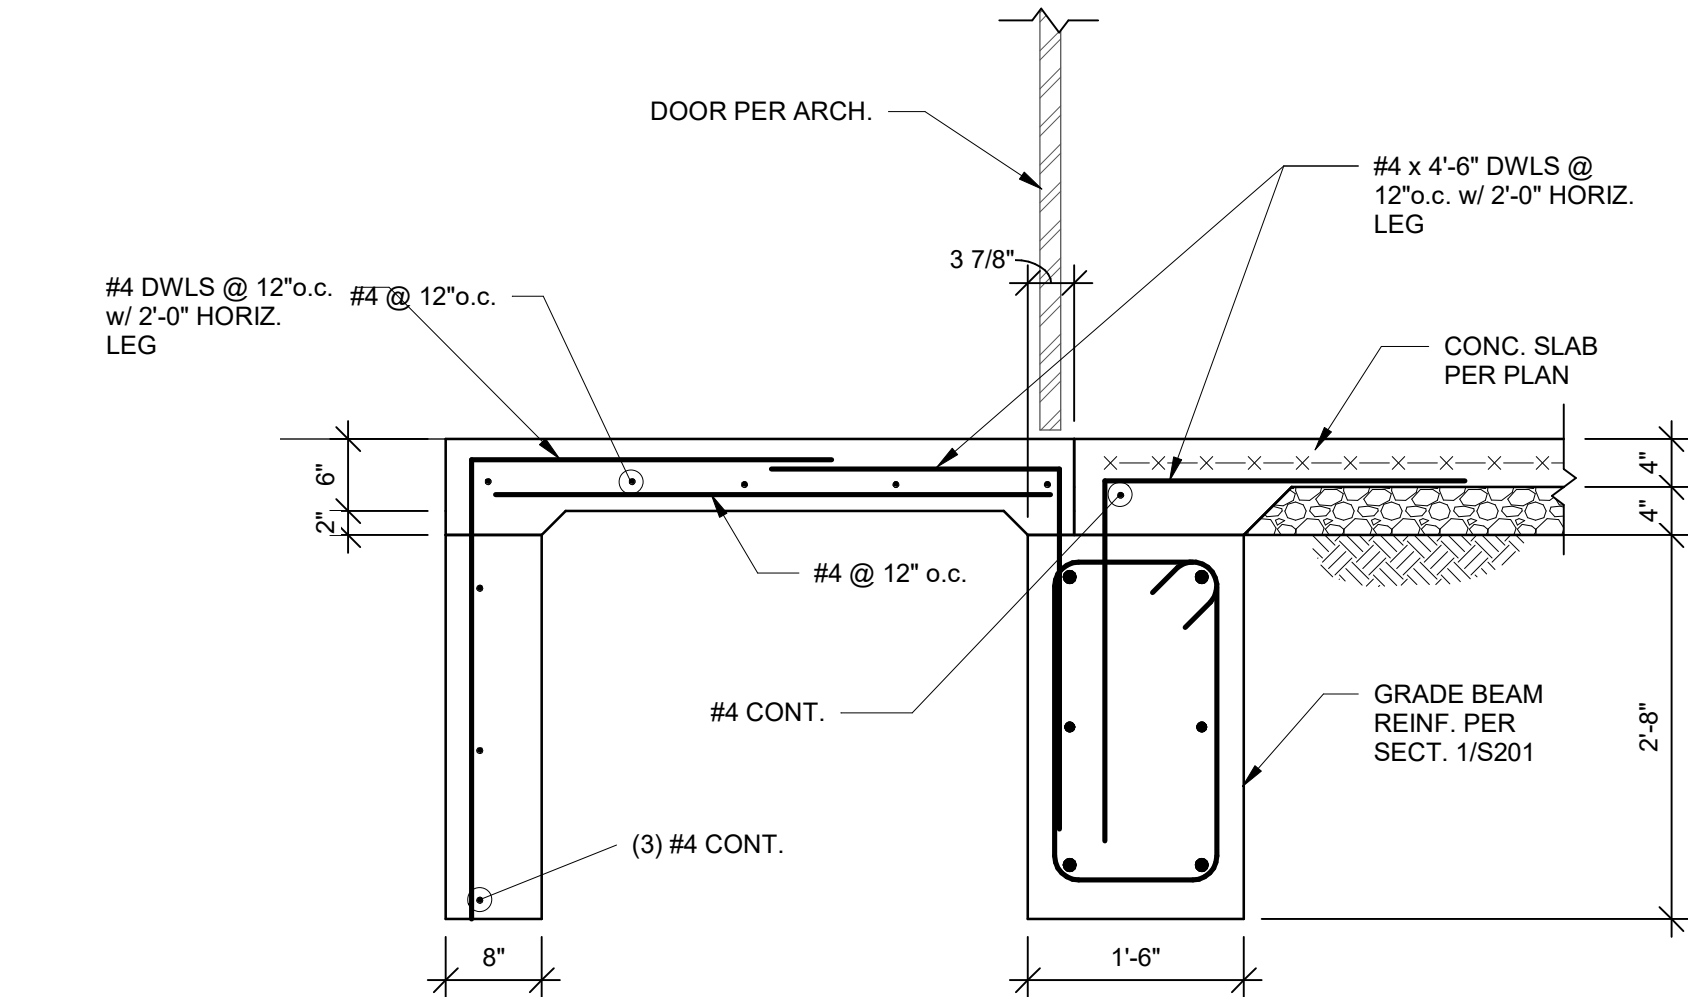

**13 SECTION**

3/4" = 1'-0"

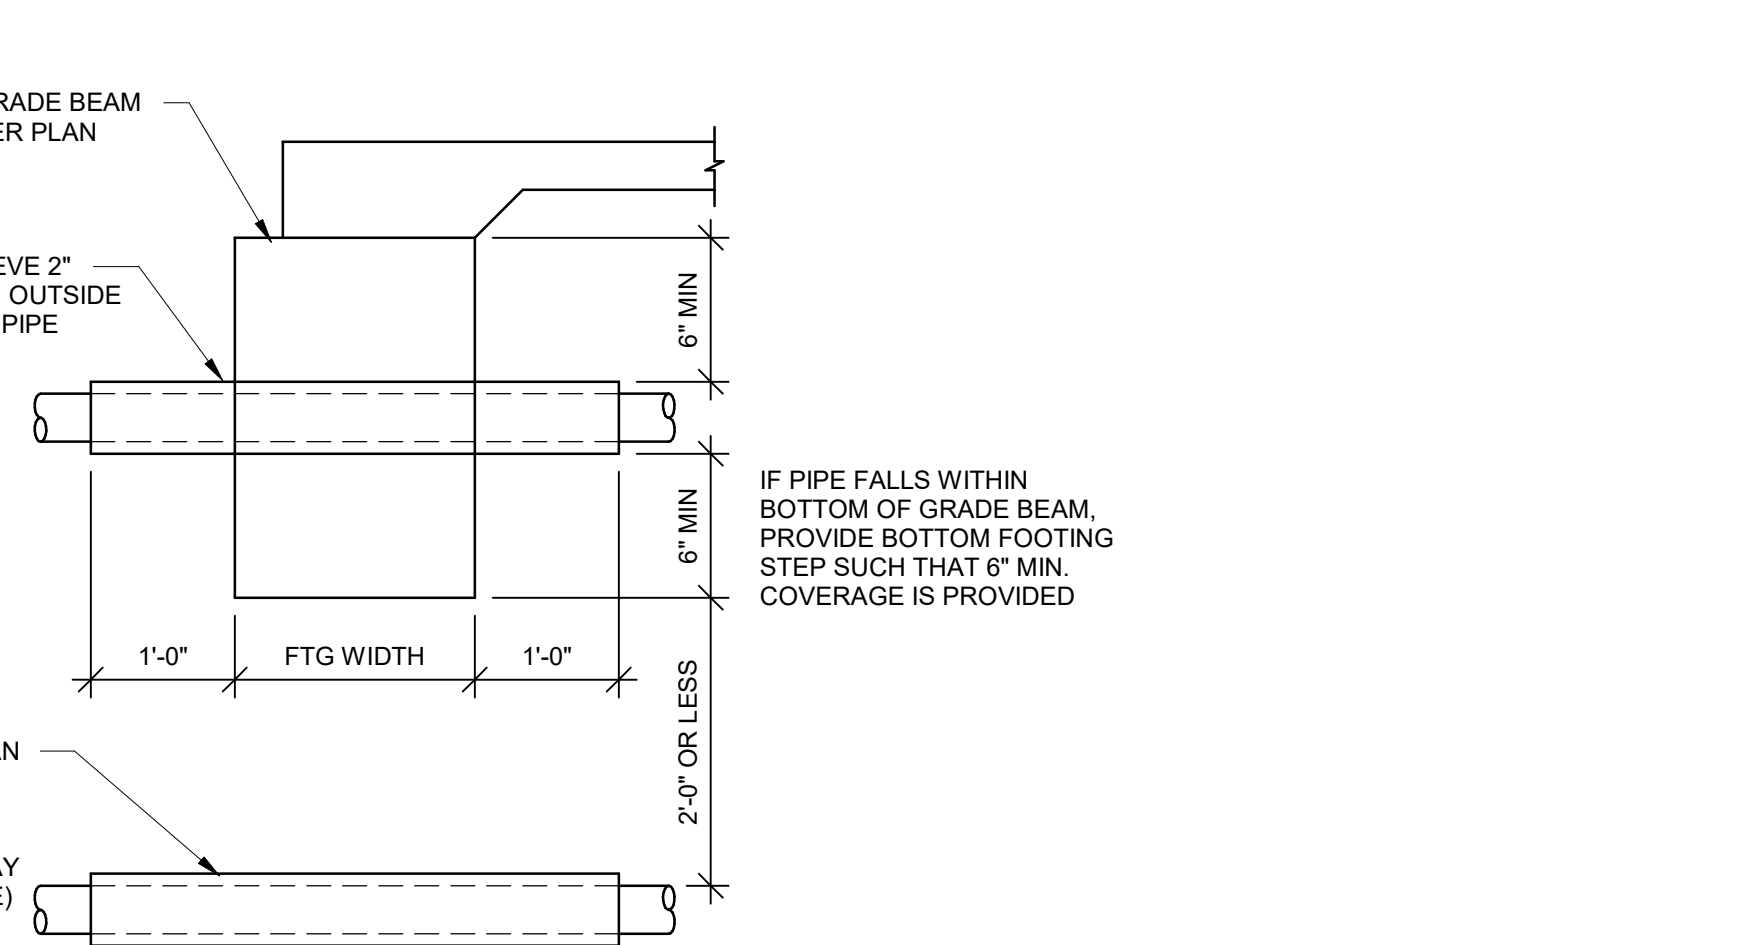


- NOTES:
- IF PIPE IS MORE THAN 2'-0" BELOW BOTTOM OF GRADE BEAM, SLEEVE IS NOT REQUIRED
  - PIPES SHALL NOT CROSS BELOW OR THROUGH A SPREAD FOOTING.

TYPICAL GRADE BEAM SLEEVE

**7 SECTION**

3/4" = 1'-0"

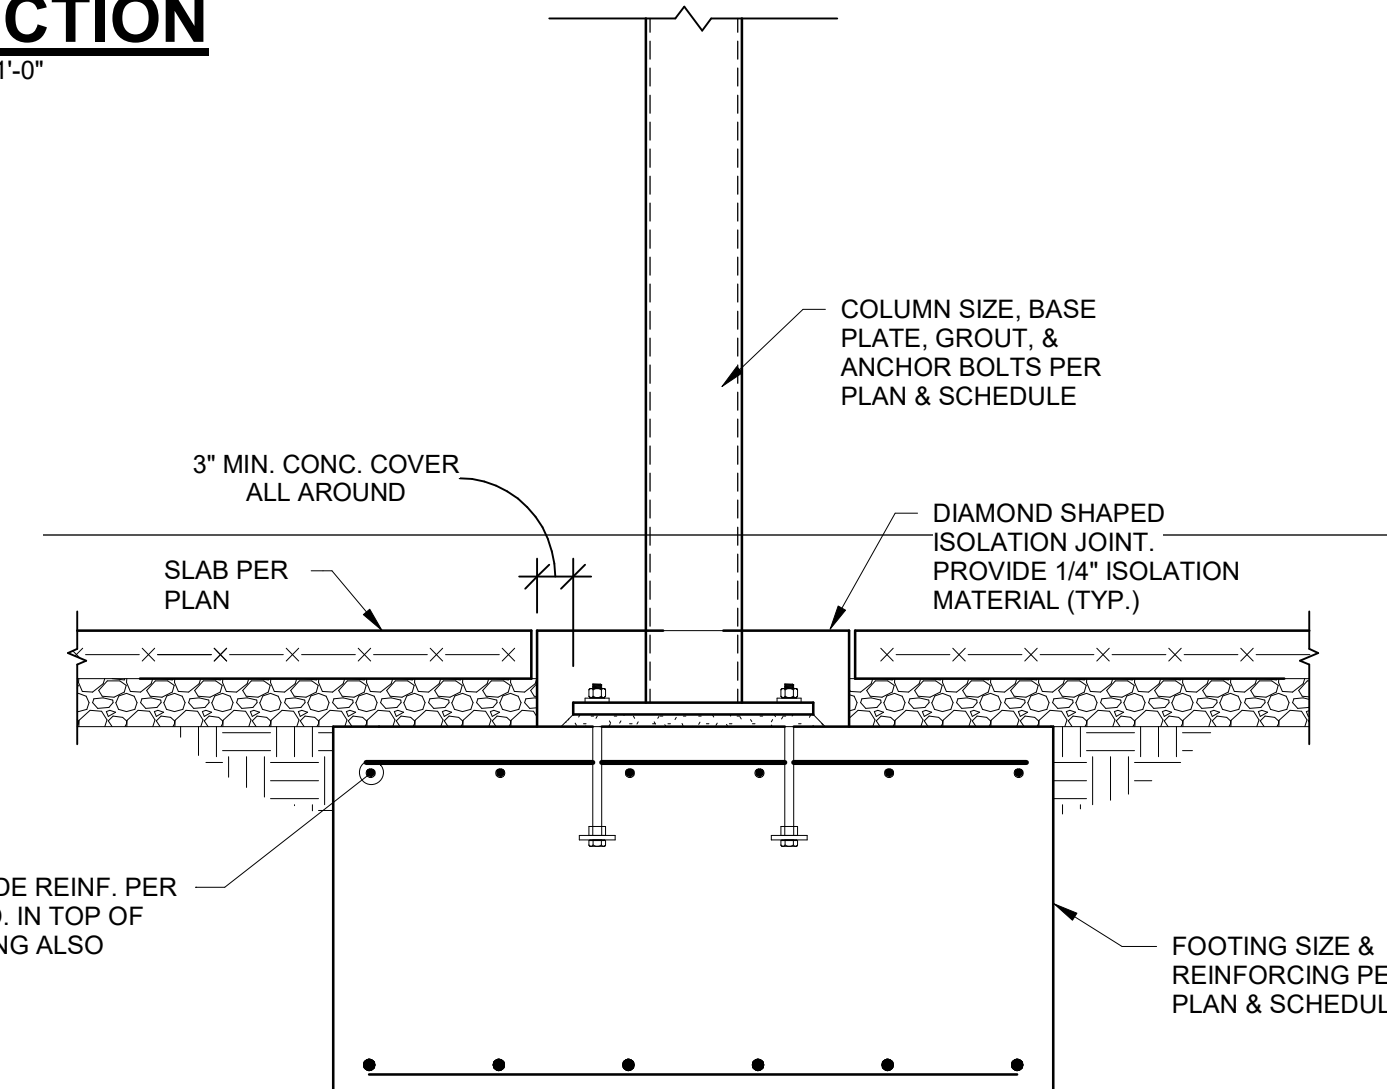

**12 SECTION**

3/4" = 1'-0"



LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100


owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086  
architect: Multistudio  
4202 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi.studio  
civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com  
structural engineer: Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/IT/Code: Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com


Issue Date: September 9, 2022

Revisions	NUMBER	DESCRIPTION	DATE
-----------	--------	-------------	------

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

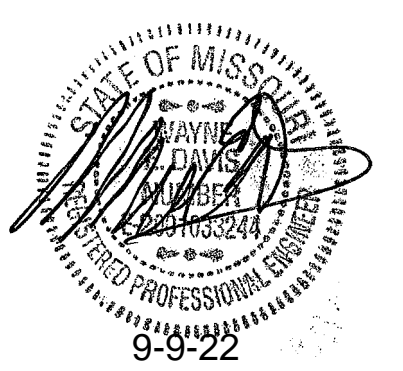


FRAMING SECTIONS  
S300-C

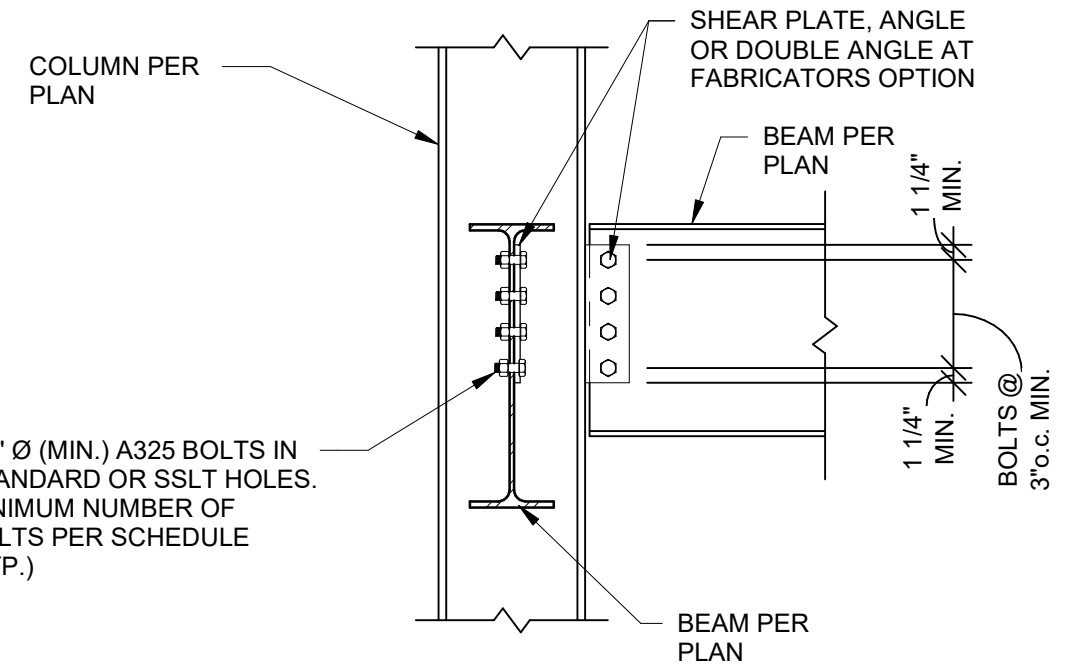


TYPICAL BEAM TO COLUMN SHEAR CONNECTION

1 DETAIL  
3/4" = 1'-0"

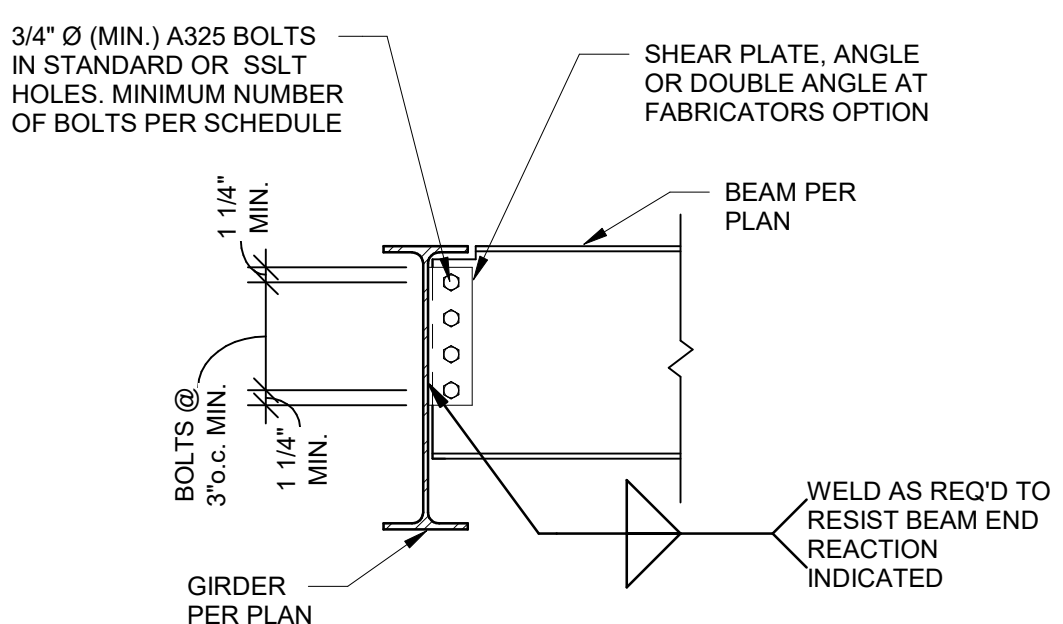


TYPICAL BEAM TO GIRDER CONNECTION

2 DETAIL  
3/4" = 1'-0"

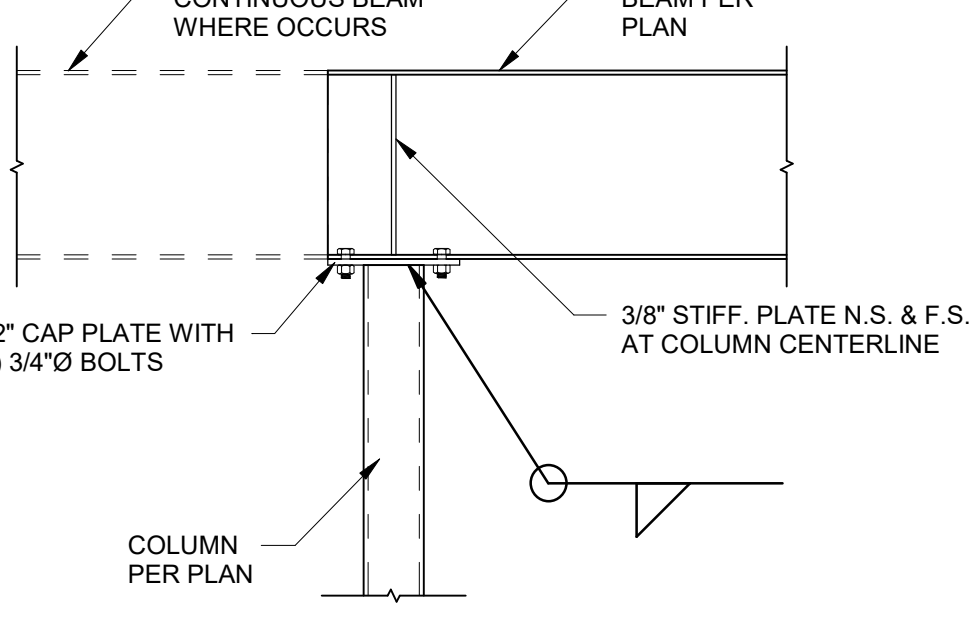


TYPICAL BEAM TO COLUMN CONNECTION

3 DETAIL  
3/4" = 1'-0"

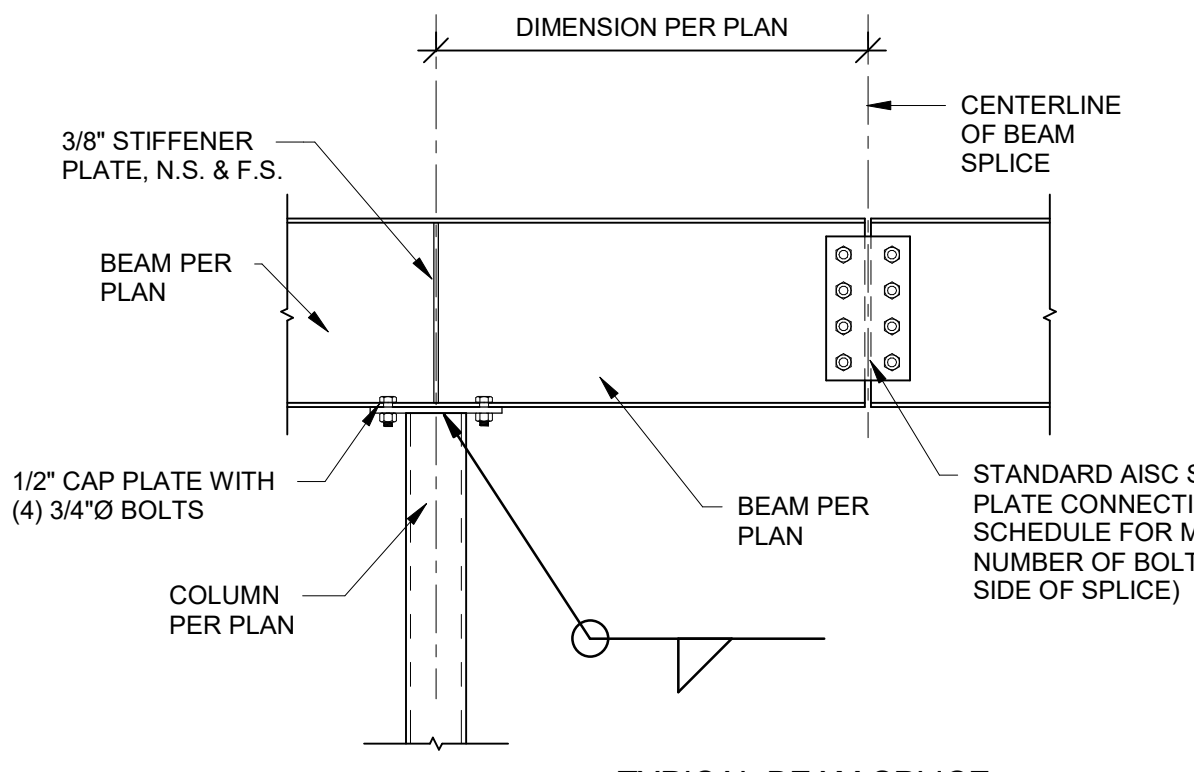


TYPICAL BEAM SPLICE

4 DETAIL  
3/4" = 1'-0"

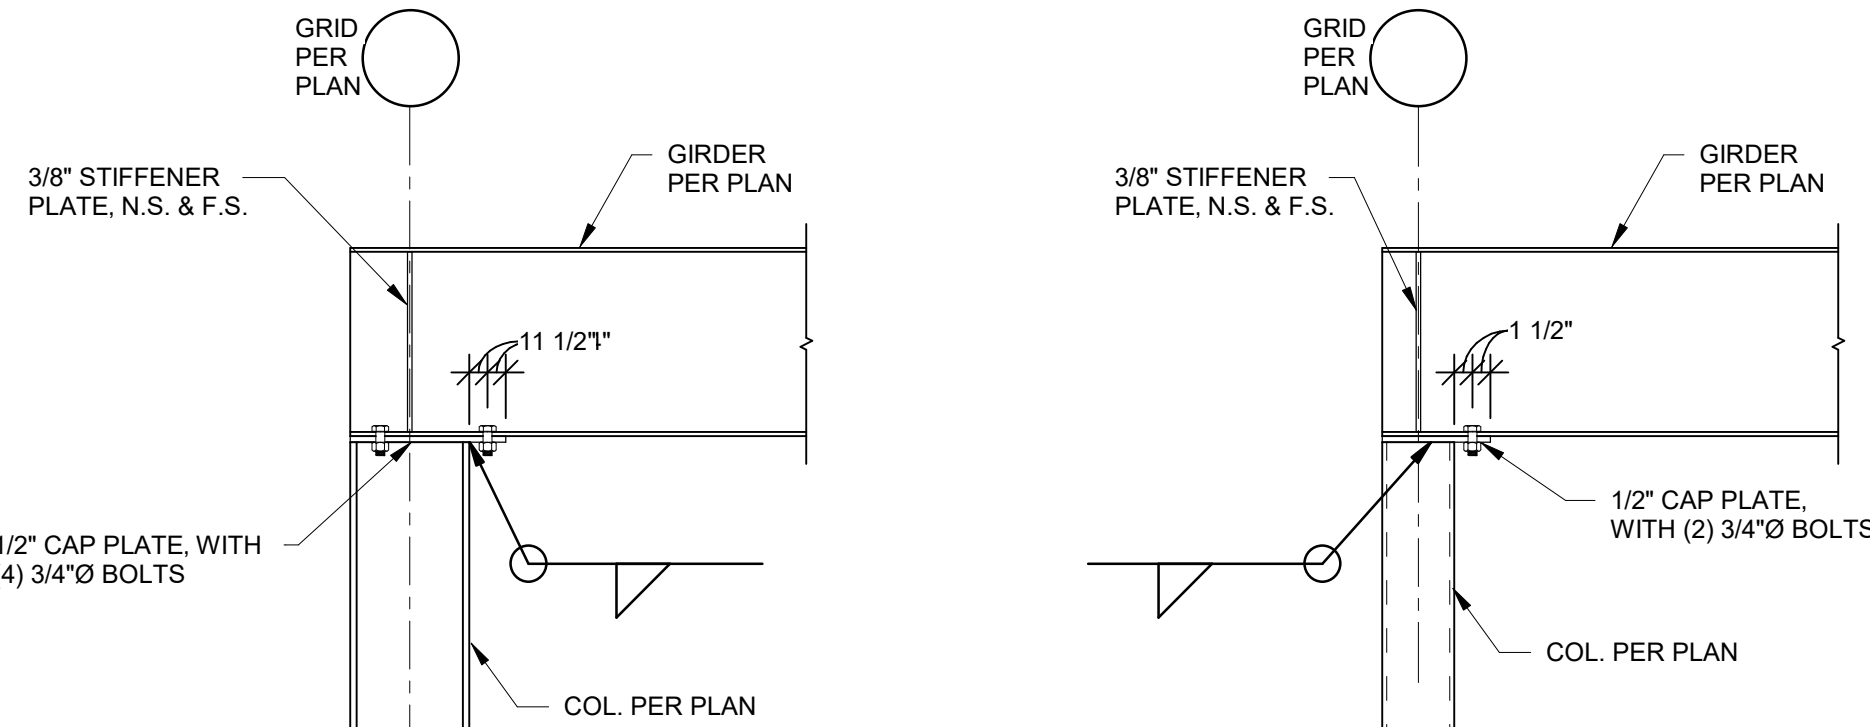

TYPICAL ROOF BEAM TO COLUMN CONNECTION AT EXTERIOR WALL


5 SECTION  
3/4" = 1'-0"

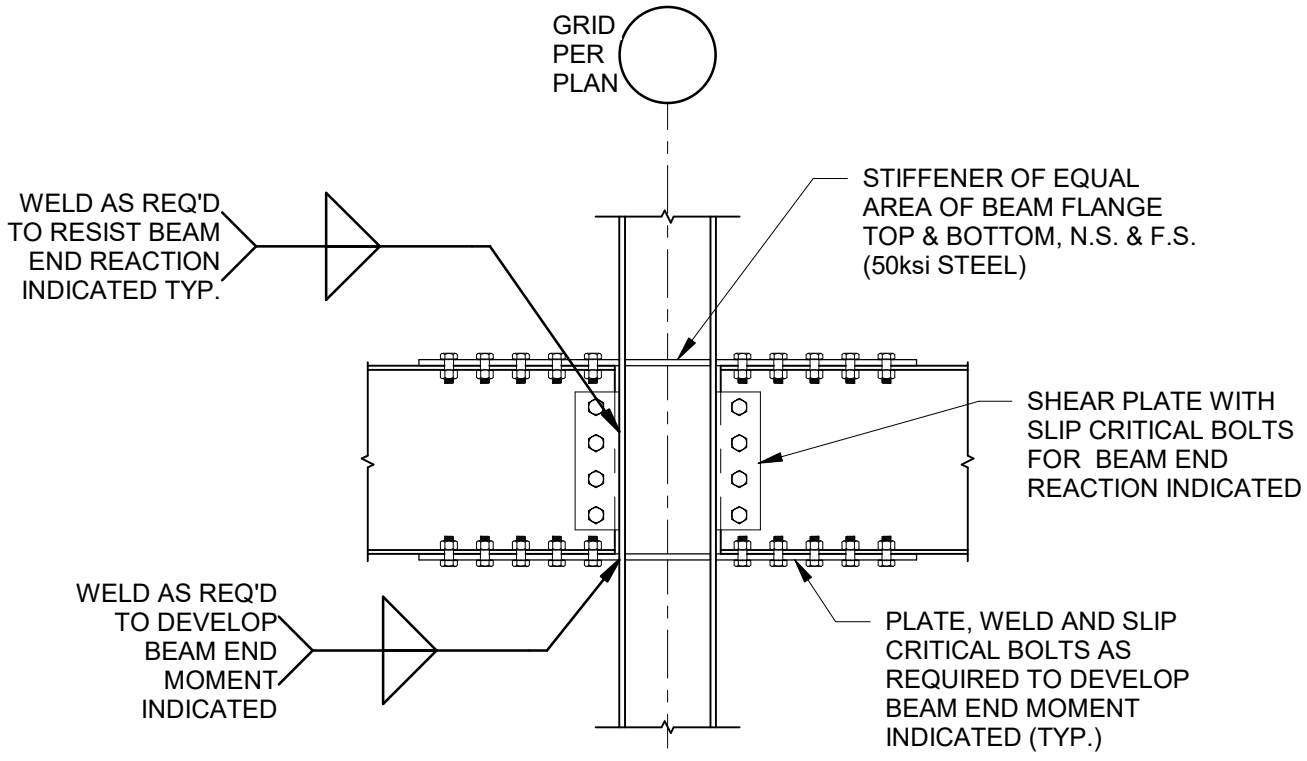

TYP. BEAM TO WIDE FLANGE COL. MOMENT CONNECTIONS


NOTE: FLANGE PLATES MAY BE FULL PENETRATION WELDED TO COLUMN AT CONTRACTORS OPTION

6 SECTION  
3/4" = 1'-0"

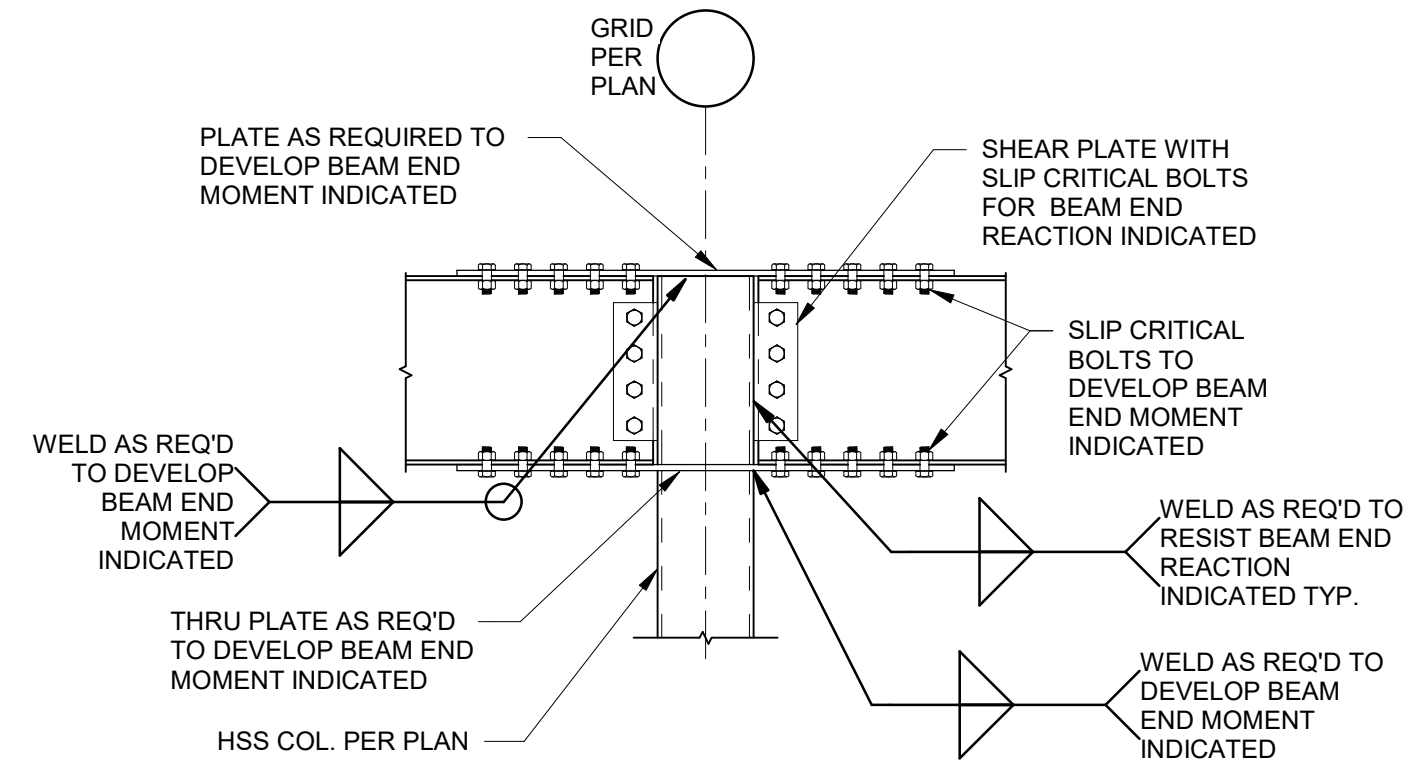

TYPICAL BEAM TO HSS COLUMN MOMENT CONNECTIONS

7 SECTION  
3/4" = 1'-0"

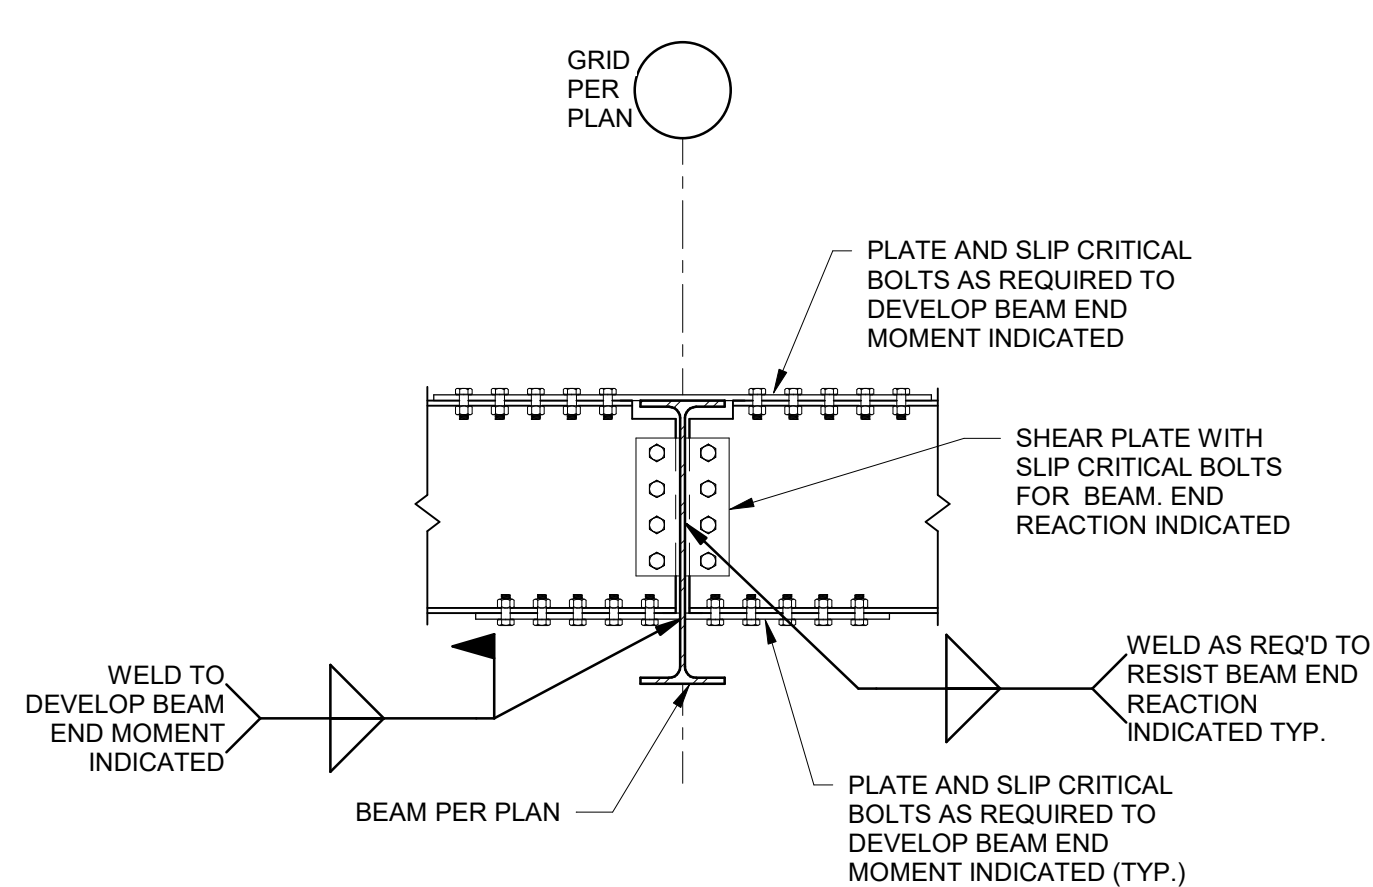

TYP. BEAM TO BEAM MOMENT CONNECTIONS


8 SECTION  
3/4" = 1'-0"

BEAM SHEAR CONNECTION SCHEDULE		
BEAM SIZE	MINIMUM ROWS OF BOLTS	END REACTION (kips)(U.N.O.)
W8,C8	2	16
W10,C10	2	16
W12,C12	2	16
W14	3	24
W16,C15	3	24
W18	4	32
W21	5	40
W24	5	40
W27	6	48
W30	7	56
W33	8	64
W36	8	64

STEEL CONNECTION NOTES:

- REFER TO GENERAL NOTES ON SHEET S001.
- CONNECTIONS SHOWN IN THESE DETAILS ARE MINIMUM REQUIREMENTS.
- FABRICATOR SHALL BE RESPONSIBLE FOR THE ENGINEERING, DESIGNING, AND DETAILING OF EACH CONNECTION FOR LOADS SHOWN ON THE DRAWINGS IN ACCORDANCE WITH THE SPECIFICATIONS AND THE STRUCTURAL GENERAL NOTES.
- SUGGESTED CONNECTION DETAILS ARE SHOWN. FINAL CONNECTION CONFIGURATION AND DESIGN SHALL BE COMPLETED BY THE CONNECTION ENGINEER. CONNECTION DESIGN SHALL INCLUDE COLUMN OR BEAM CONTINUITY PLATES, WEB STIFFENERS, AND/OR DOUBLER PLATES AS REQUIRED FOR THE FORCES INDICATED.
- FABRICATOR MAY OPT TO USE OTHER AISC APPROVED CONNECTIONS IN LIEU OF THOSE SHOWN HEREIN TO MEET END REACTION REQUIREMENTS (i.e. DOUBLE ANGLE CONNECTION).
- CONNECTION DETAILING SHALL COMPLY WITH THE STANDARD DETAILS SHOWN IN THE LATEST EDITION OF THE AISC MANUAL OF STEEL CONSTRUCTION.
- ALL BOLTS SHALL BE 3/4" Ø ASTM A325 MINIMUM.
- ALL BOLTS SHALL BE SPACED AT 3" c/c MINIMUM.
- ALL BOLTS SHALL HAVE HEAVY HEX NUTS.
- ALL BOLTS SHALL BE FULLY PRE-TENSIONED.
- BOLT SPACING AND EDGE DISTANCES SHALL BE ADJUSTED PER AISC MANUAL FOR BOLTS LARGER THAN 3/4" DIAMETER.
- CLIP ANGLES MAY BE SHOP WELDED TO BEAM WEB PER AISC.
- FOR BEAMS WITH AXIAL LOADS PER DRAWINGS, BOLTS AND CONNECTIONS SHALL BE SLIP-CRITICAL PER AISC GUIDELINES. INCREASE NUMBER OF BOLTS AND/OR PROVIDE EXTENDED SHEAR PLATE CONNECTION W/ AN ADDITIONAL COLUMN OF BOLTS TO ACCOMMODATE COMBINED FORCES.
- PROVIDE ASTM A490 BOLTS IF REQUIRED TO MEET END REACTION LOAD REQUIREMENTS.
- REFER TO ELEVATIONS ON SHEET S FOR BRACE FORCES. REFER TO PLANS FOR ADDITIONAL BEAM AXIAL FORCES. BRACE AND BEAM FORCES INDICATED ARE UNFACTORED (ASD) LOADS AND SHALL BE CONSIDERED CONCURRENT W/ BEAM SHEAR DESIGN FORCES LISTED IN THE BEAM SHEAR CONNECTION SCHEDULE.
- COORDINATE BRACED FRAME CONNECTION W/ ARCHITECTURAL WALLS AS REQUIRED TO AVOID CONFLICT OR EXPOSURE OUTSIDE OF WALL OR FINISH.
- ALL END REACTIONS INDICATED ARE UNFACTORED (ASD) LOADS.



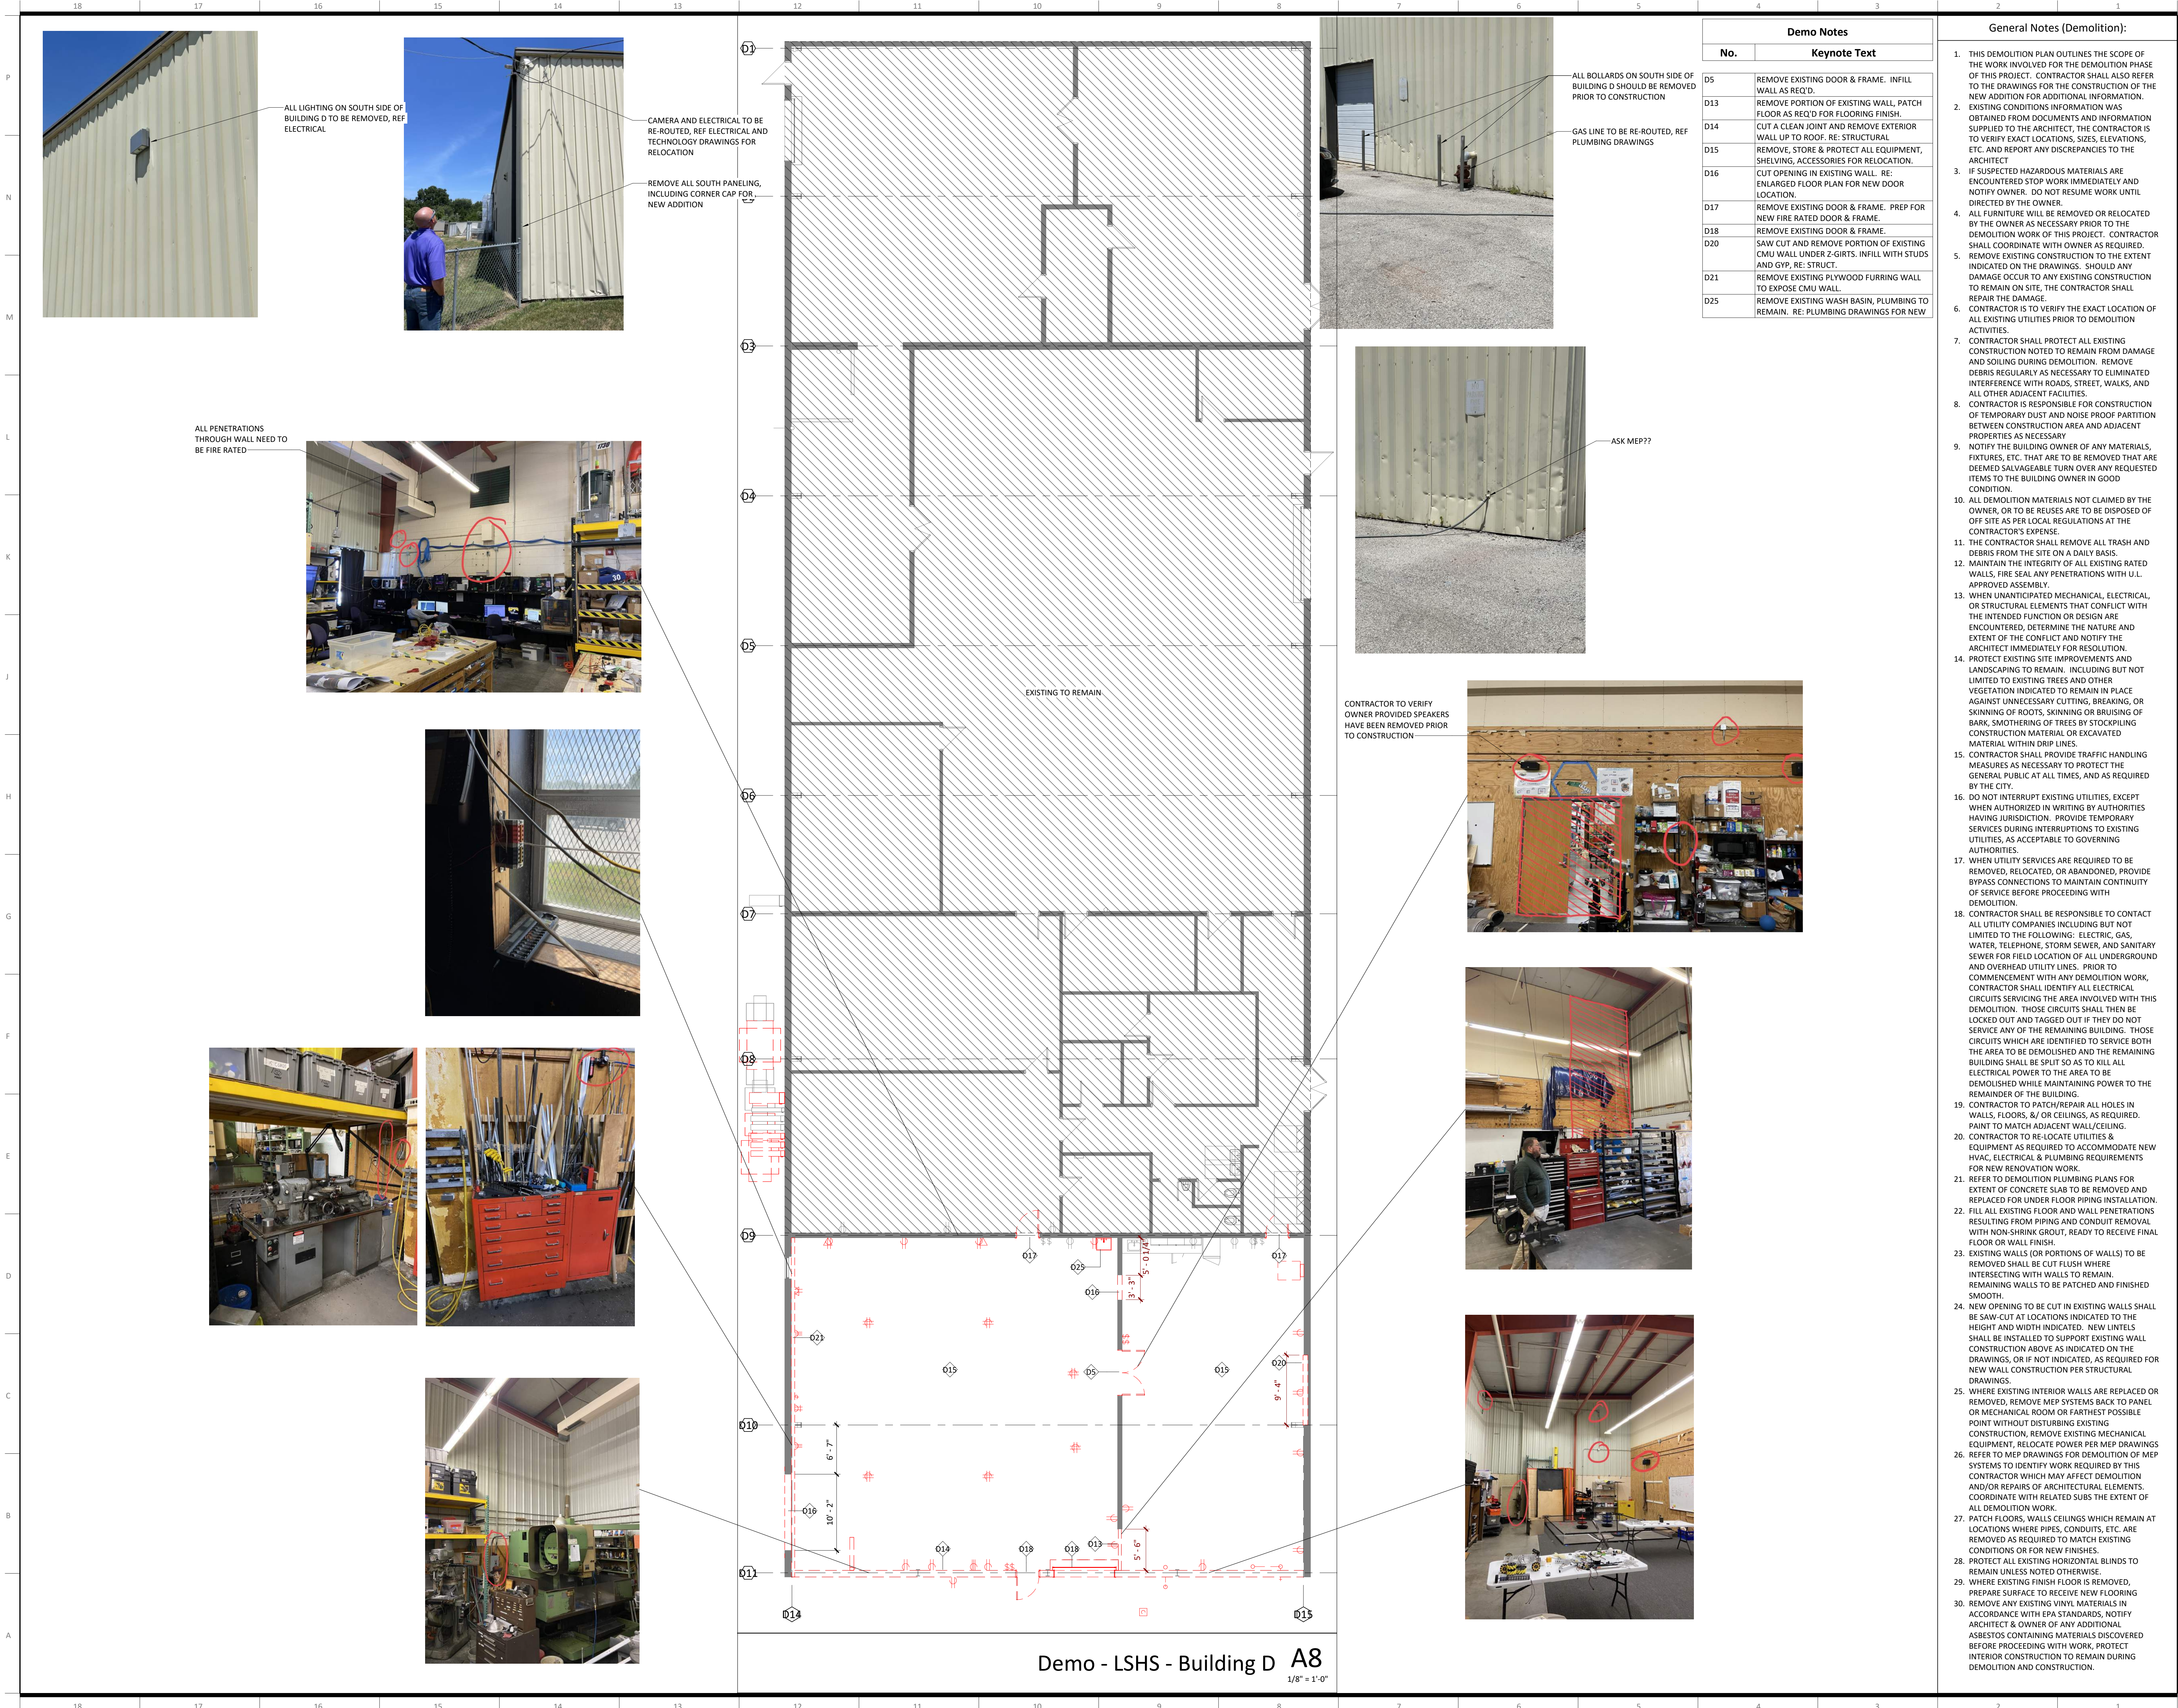

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100

owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect: multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multistudio

civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveeng.com

structural engineer: Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com


MEP/IT/Code: Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

Issue Date: September 9, 2022

Revisions

NUMBER	DESCRIPTION	DATE
--------	-------------	------



UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

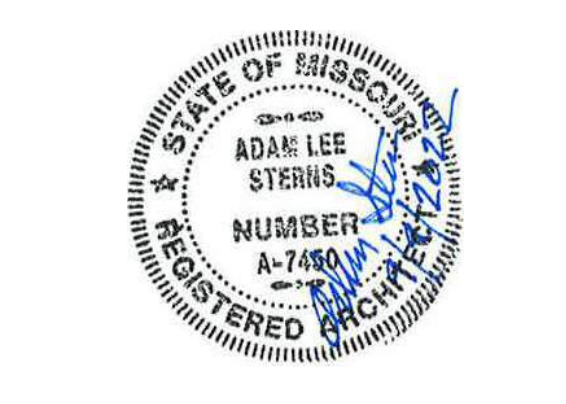

Demolition Plan - Building D

AD101-C



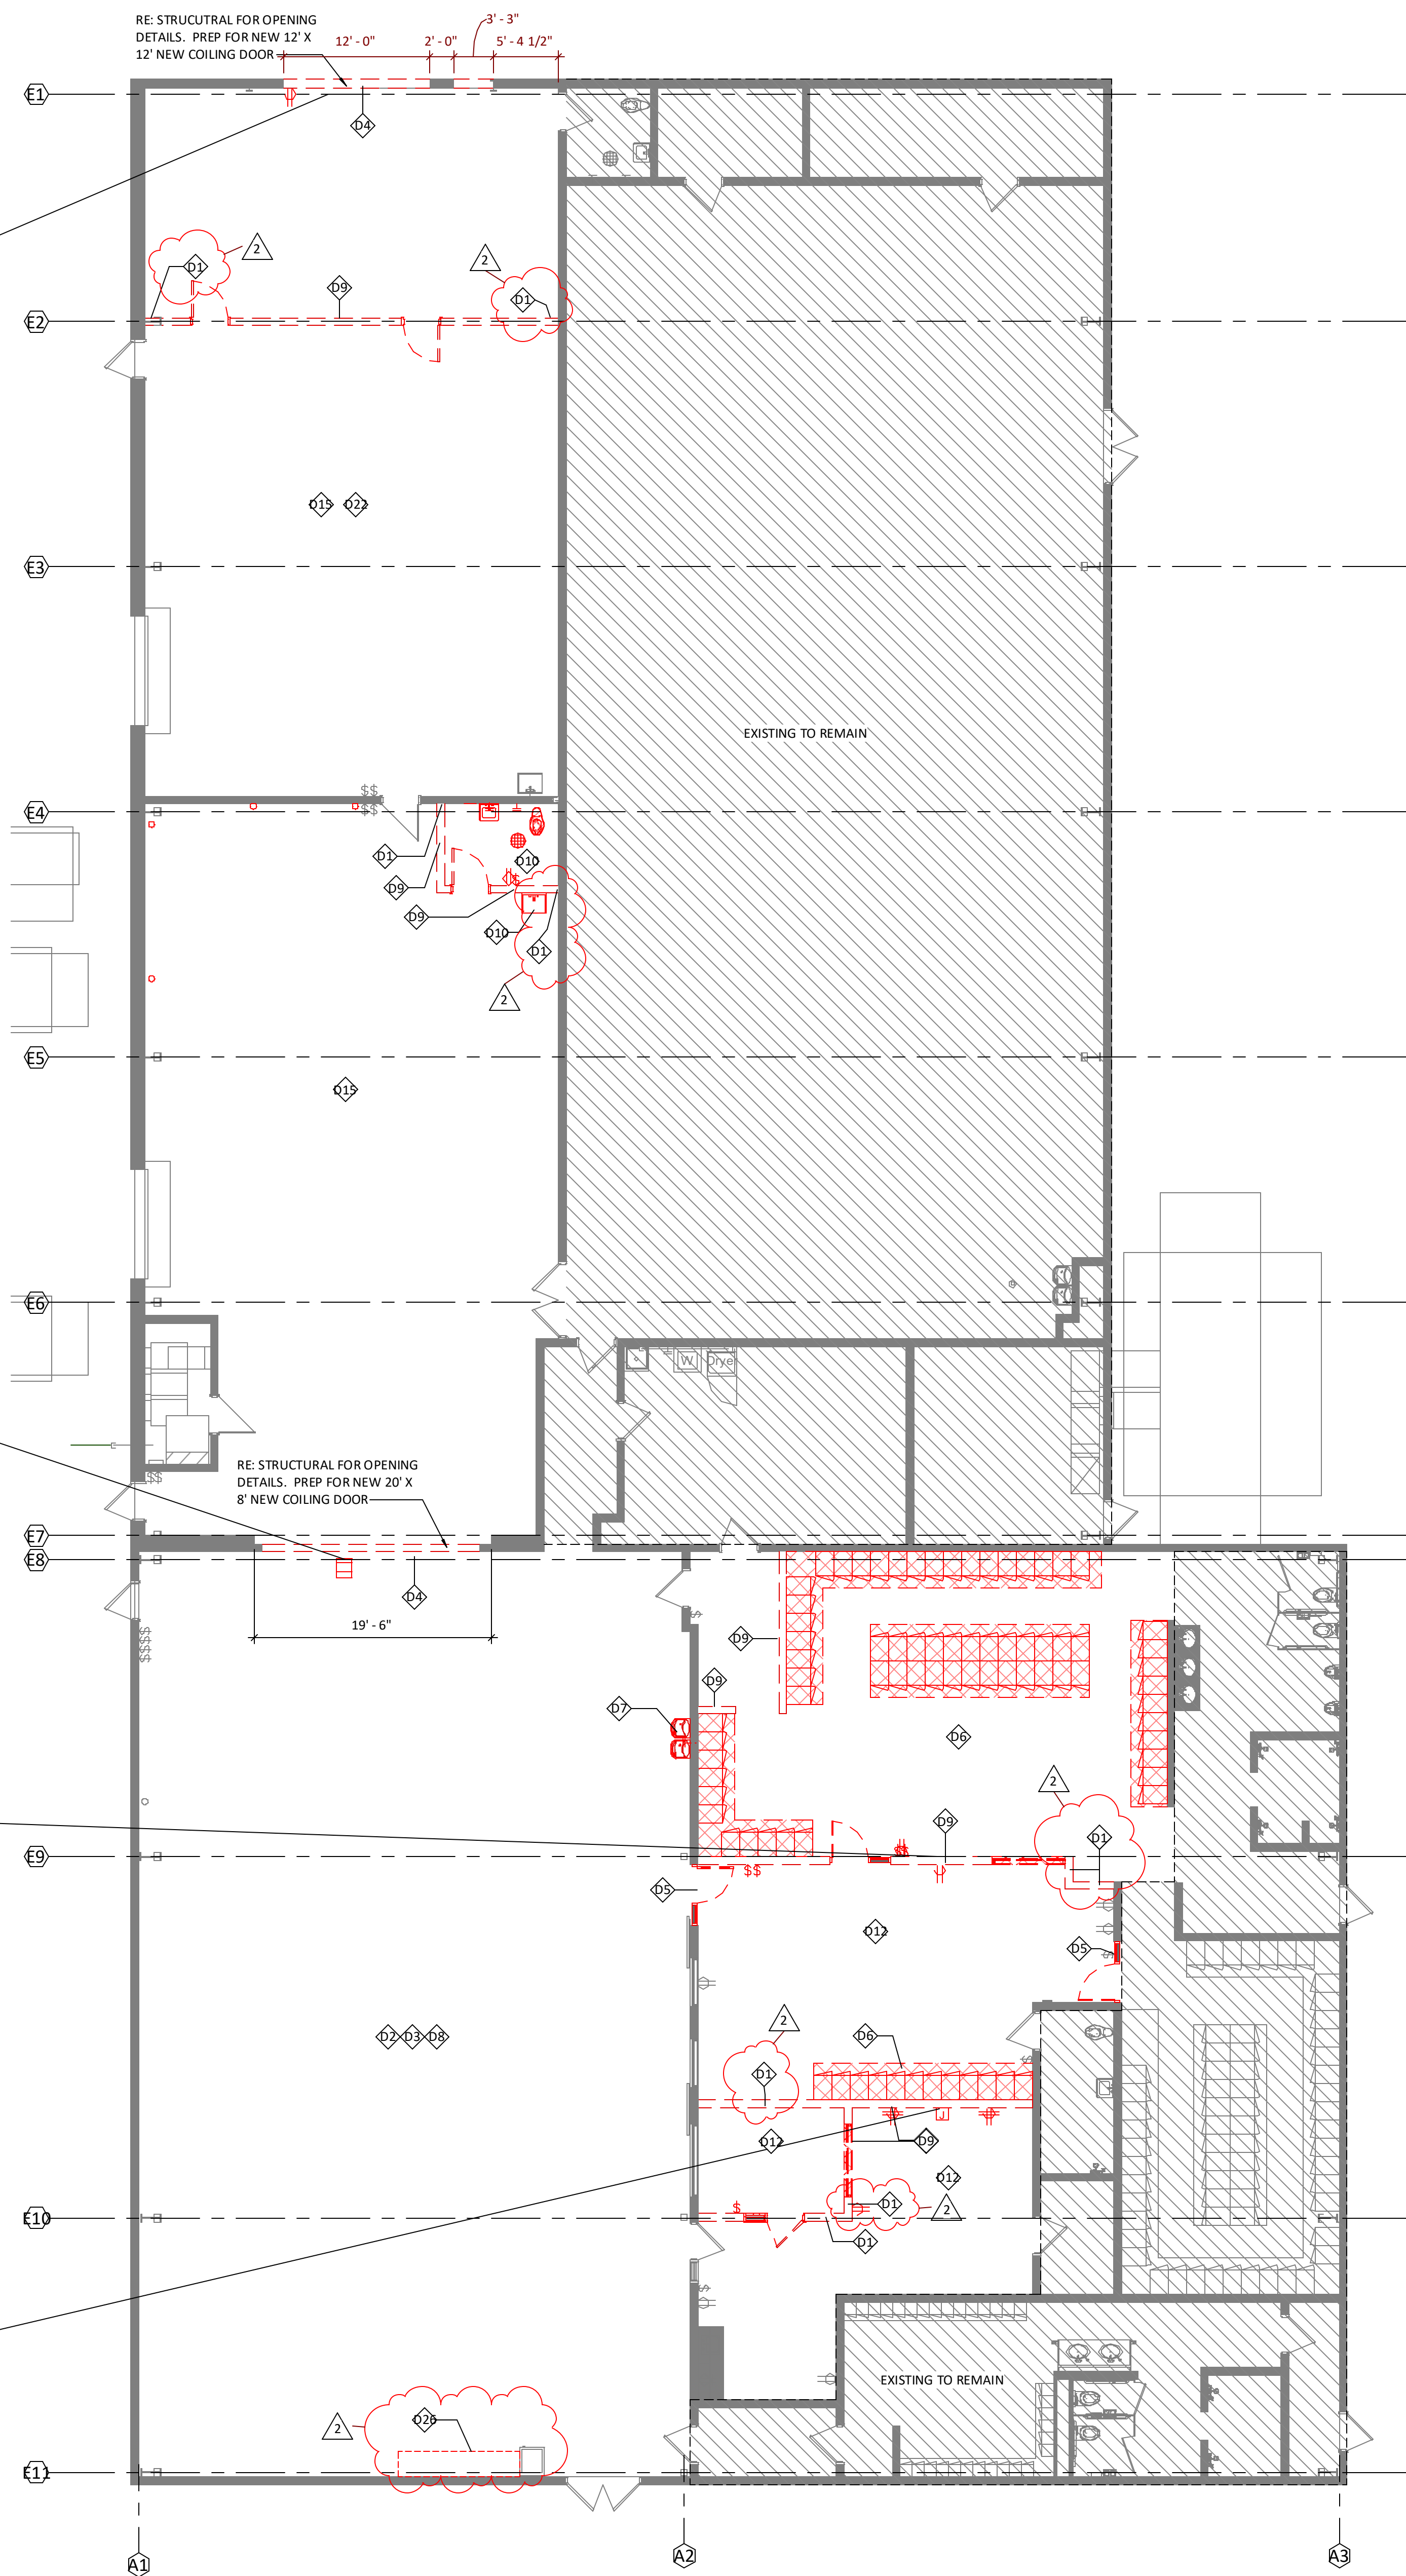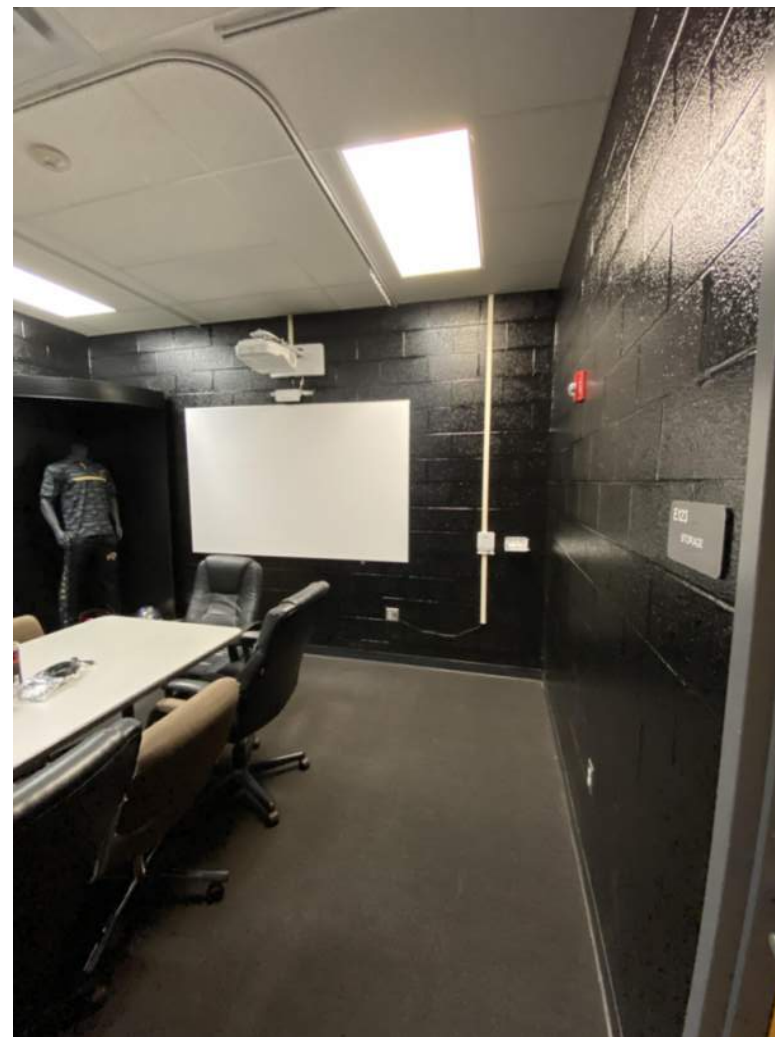

Demo Plan - LSHS - Building E **A5**  
1/8" = 1'-0"

Demo Notes	
No.	Keynote Text
D1	CUT CLEAN JOINT AND REMOVE CMU WALL, PATCH FLOOR AS REQ'D FOR FLOORING FINISH.
D2	REMOVE EXISTING ATHLETIC FLOORING & WALL BASE INCLUDING ALL ADHESIVES. PREP FOR NEW FLOORING.
D3	REMOVE AND PROTECT ALL EXISTING PROJECTORS FOR REINSTALL.
D4	CUT OPENING IN EXISTING STRUCTURAL WALL. RE: STRUCTURAL FOR NEW BRACING DETAIL.
D5	REMOVE EXISTING DOOR & FRAME. INFILL WALL AS REQ'D.
D6	REMOVE EXISTING LOCKERS & CONCRETE BASE. PATCH FLOOR AS REQ'D.
D7	REMOVE AND RELOCATE EXISTING DRINKING FOUNTAINS. RE: PLUMBING.
D8	REMOVE ALL EXISTING EQUIPMENT. CONFIRM WITH SCHOOL: WHAT NEEDS TO BE STORED AND PROTECTED.
D9	REMOVE EXISTING WALL, PATCH FLOOR AS REQ'D FOR FLOORING FINISH.
D10	REMOVE EXISTING PLUMBING FIXTURES AND ALL ASSOCIATED PLUMBING.
D12	STORE, PROTECT AND REUSE EXISTING FURNITURE.
D15	REMOVE, STORE & PROTECT ALL EQUIPMENT, SHELVING, ACCESSORIES FOR RELOCATION.
D22	REMOVE EXISTING CARPET FLOORING & ANY ASSOCIATED ADHESIVE.
D26	SALVAGE EXISTING STAINLESS STEEL SHEET COUNTERTOP FOR RELOCATION IN SAME SPACE

1. THIS DEMOLITION PLAN OUTLINES THE SCOPE OF THE WORK INVOLVED FOR THE DEMOLITION PHASE OF THIS PROJECT. CONTRACTOR SHALL ALSO REFER TO THE DRAWINGS FOR THE CONSTRUCTION OF THE NEW ADDITION FOR THE REMAINING WORK.
2. EXISTING CONDITIONS INFORMATION WAS OBTAINED FROM DOCUMENTS AND INFORMATION SUPPLIED TO THE ARCHITECT. THE CONTRACTOR IS TO VERIFY EXACT LOCATIONS, SIZES, ELEVATIONS, ETC. AND REPORT ANY DISCREPANCIES TO THE ARCHITECT
3. IF SUSPECTED HAZARDOUS MATERIALS ARE ENCOUNTERED STOP WORK IMMEDIATELY AND NOTIFY ARCHITECT. DO NOT RESUME WORK UNTIL DIRECTED BY THE OWNER.
4. ALL FURNITURE WILL BE REMOVED OR RELOCATED BY THE OWNER AS NECESSARY PRIOR TO THE DEMOLITION WORK OF THIS PROJECT. CONTRACTOR SHALL IMMEDIATELY REMOVE ANY FURNITURE REQUIRED.
5. REMOVE EXISTING CONSTRUCTION TO THE EXTENT INDICATED ON THE DRAWINGS. SHOULD ANY DAMAGE OCCUR TO ANY EXISTING CONSTRUCTION OR ADJACENT SITE THE CONTRACTOR SHALL REPAIR THE DAMAGE.
6. CONTRACTOR IS TO VERIFY THE EXACT LOCATION OF ALL EXISTING UTILITIES PRIOR TO DEMOLITION ACTIVITIES.
7. CONTRACTOR SHALL PROTECT ALL EXISTING CONSTRUCTION NOTED TO REMAIN FROM DAMAGE AND SOILING DURING DEMOLITION. REMOVE DEBRIS REGULARLY AS NECESSARY TO ELIMINATE OBSTACLES WITHIN THE PROJECT, WALKS, AND ALL OTHER ADJACENT FACILITIES.
8. CONTRACTOR IS RESPONSIBLE FOR CONSTRUCTION OF TEMPORARY DUST AND NOISE PROOF PARTITION BETWEEN THE CONSTRUCTION AREA AND ADJACENT AREAS.
9. NOTIFY THE BUILDING OWNER OF ANY MATERIALS, FIXTURES, ETC. THAT ARE TO BE REMOVED THAT ARE DEEMED SALVAGEABLE TURN OVER ANY REQUESTED ITEMS TO THE BUILDING OWNER IN GOOD CONDITION.
10. ALL DEMOLITION MATERIALS NOT CLAIMED BY THE OFF-SITE, OR TO BE REUSABLE ARE TO BE DISPOSED OF AS PER ALL LOCAL REGULATIONS AT THE CONTRACTOR'S EXPENSE.
11. THE CONTRACTOR SHALL REMOVE ALL TRASH AND DEBRIS FROM THE SITE ON A DAILY BASIS.
12. MAINTAIN THE INTEGRITY OF ALL EXISTING RATED WALLS, FIRE SEAL ANY PENETRATIONS WITH U.L. APPROVED FIREBARRIER.
13. WHEN UNANTICIPATED MECHANICAL, ELECTRICAL, OR STRUCTURAL ELEMENTS THAT CONFLICT WITH THE INTENDED FUNCTION OR DESIGN ARE ENCOUNTERED DETERMINE THE CAUSE AND EXTENT OF THE CONFLICT AND NOTIFY THE ARCHITECT IMMEDIATELY FOR RESOLUTION.
14. PROTECT EXISTING SITE IMPROVEMENTS AND LANDSCAPING TO REMAIN. INCLUDING BUT NOT LIMITED TO TREES, SHRUBS, AND LANDSCAPING VEGETATION INDICATED TO REMAIN IN PLACE AGAINST UNNECESSARY CUTTING, BRUISING, OR SKINNING OF ROOTS, SKINNING OR BREAKING OF BARK, SKINNING OR DETACHING OF TWIGS. PROTECT CONSTRUCTION MATERIAL OR EXCAVATED MATERIAL WITH DRIP LINES.
15. CONTRACTOR SHALL PROVIDE TRAFFIC HANDLING MEASURES AS NECESSARY TO PROTECT THE GENERAL PUBLIC AT ALL TIMES, AND AS REQUIRED BY THE CITY.
16. DO NOT INTERRUPT EXISTING UTILITIES, EXCEPT WHEN AUTHORIZING DISCONTINUING BY AUTHORITIES HAVING JURISDICTION. NOTIFY THE CITY OF ANY SUCH DISCONTINUING IN WRITING TO THE CITY AND OBTAINING NECESSARY PERMITS TO EXISTING UTILITIES, AS ACCEPTABLE TO GOVERNING AUTHORITIES.
17. WHEN UTILITY SERVICES ARE REQUIRED TO BE DISCONTINUED, CONTRACTOR SHALL PROVIDE BYPASS CONNECTIONS TO MAINTAIN CONTINUITY OF SERVICE BEFORE PROCEEDING WITH DEMOLITION.
18. CONTRACTOR SHALL BE RESPONSIBLE TO CONTACT ALL UTILITIES COMPANIES INCLUDING BUT NOT LIMITED TO THE FOLLOWING: ELECTRIC, GAS, WATER, TELEPHONE, STORM SEWER, AND SANITARY SEWER FOR FIELD LOCATION OF ALL UNDERGROUND UTILITIES. AFTER LOCATING ALL UTILITIES, COMMENCEMENT WITH ANY DEMOLITION WORK, CONTRACTOR SHALL IDENTIFY ALL ELECTRICAL CIRCUITS SERVING THE AREA INVOLVED WITH THIS DEMOLITION. THOSE CIRCUITS SHALL THEN BE IDENTIFIED AND TRACED TO THE SOURCE AND NOT SERVICE ANY OF THE REMAINING BUILDING. THOSE CIRCUITS WHICH ARE IDENTIFIED TO SERVICE BOTH THE AREA TO BE DEMOLISHED AND THE REMAINING BUILDING SHALL BE TRACED TO ALL ELECTRICAL POWER TO THE AREA TO BE DEMOLISHED WHILE MAINTAINING POWER TO THE REMAINDER OF THE BUILDING.
19. CONTRACTOR TO PATCH/REPAIR ALL HOLES IN WALLS, FLOORS, CEILINGS, OR PARTITIONS, PAINT TO MATCH ADJACENT WALLS/CEILING.
20. CONTRACTOR TO RE-LOCATE UTILITIES & EQUIPMENT AS REQUIRED TO ACCOMMODATE NEW HVAC, ELECTRICAL & PLUMBING REQUIREMENTS FOR THE REMAINING BUILDING.
21. REFERTO DEMOLITION PLUMBING PLANS FOR EXPOSED OF CONCRETE SLAB TO BE REMOVED AND REPLACED FOR UNDER FLOOR PIPING INSTALLATION.
22. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
23. EXISTING WALLS (OR PORTIONS OF WALLS) TO BE REMOVED TO BE PATCHED, RE-FINISH WITH INTERSECTING WITH WALLS TO REMAIN. REMAINING WALLS TO BE PATCHED AND FINISHED SMOOTH.
24. MATERIALS TO BE CUT IN EXISTING WALLS SHALL BE SAW-CUT AT LOCATIONS INDICATED TO THE HEIGHT AND WIDTH INDICATED. NEW LITELS SHALL BE INSTALLED TO SUPPORT EXISTING WALL CONSTRUCTION ABOVE AS INDICATED ON THE DRAWINGS.
25. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
26. WHERE EXISTING INTERIOR WALLS ARE REPLACED OR REMOVED, REMOVE EXISTING MECHANICAL EQUIPMENT, RELOCATE POWER PER MEP DRAWINGS.
27. REMOVE EXISTING MECHANICAL EQUIPMENT, PARTITIONS TO IDENTIFY WORK AFFECTED BY THIS CONTRACTOR WHICH MAY REQUIRE DEMOLITION AND/OR REPAIRS OF ARCHITECTURAL ELEMENTS. COORDINATE WITH RELATED SUBS THE EXTENT OF ALL WORK TO BE REMOVED.
28. PATCH FLOORS, WALLS CEILINGS WHICH REMAIN AT LOCATIONS WHERE PIPES, CONDUITS, ETC. ARE REMOVED AS REQUIRED TO MATCH EXISTING CONSTRUCTION FOR FINISHING.
29. PROTECT ALL EXISTING HORIZONTAL BLENDS TO REMAIN UNLESS NOTED OTHERWISE.
30. WHERE EXISTING FINISH FLOOR IS REMOVED, PREPARE SURFACE TO RECEIVE NEW FLOORING.
31. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
32. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
33. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
34. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
35. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
36. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
37. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
38. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
39. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
40. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
41. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
42. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
43. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
44. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
45. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
46. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
47. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
48. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
49. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
50. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
51. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
52. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
53. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
54. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
55. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
56. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
57. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
58. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
59. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
60. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
61. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
62. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
63. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
64. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
65. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
66. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
67. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
68. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
69. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
70. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
71. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
72. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
73. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
74. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
75. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
76. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
77. REMOVE ALL EXISTING FINISH MATERIALS, PARTITIONS RESULTING FROM PIP

**multistudio**  
the evolution of gould evans

**LSR7 Robotics, GiC & Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100

owner: Lee's Summit R-7 School 301 NE Tudor Road Lee's Summit, MO 64086	architect: <b>Multistudio</b> 4200 Pennsylvania Kansas City, MO 64111 800.888.3377
--	--

civil engineer:  
**Kaw Valley Engineering**  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kvengr.com

structural engineer:  
**Bob D. Campbell &**  
4338 Belleview  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEPFT/Code::  
**Henderson Engineers**  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
[www.hendersonengineers.com](http://www.hendersonengineers.com)

Issue Date: September 9, 2022

## Revisions

NUMBER	DESCRIPTION	DATE
2	Addendum 02	09/23/2022

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS  
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR  
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION.



## Demolition Plan - Building E

# AD102-C




	18	17	16	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1		
	Abbreviations									Graphic Symbols		Materials Graphics							General Architectural Drawing Notes:	
P	A		D		H		P		T										1. VERIFY DIMENSIONS AND EXISTING CONDITIONS BEFORE COMMENCING WORK. REPORT DISCREPANCIES TO THE ARCHITECT PRIOR TO PROCEEDING WITH AFFECTED WORK.	
	@	AT		DEEP, DEPTH	HB	HOSE BIBB	PA	PUBLIC ADDRESS	T	TREAD										
	A/C	AIR CONDITIONING (ED)	DBL	DOUBLE	HC	HANDICAP, HOLLOW CORE	PAR	PARALLEL	T & B	TOP AND BOTTOM										
	A/C UNIT	AIR CONDITIONING UNIT	DEG	DEGREE	HCP	HANDICAPPED	PART	PARTIAL	T & G	TONGUE AND GROOVE										
N	AB	ANCHOR BOLT	DEMO	DEMOLITION	HD	HEAVY DUTY	PAT	PATTERN	TB	THROUGH BOLT, TOWEL BAR									2. BUILDING FLOOR PLAN DIMENSIONS ARE REFERENCED FROM STRUCTURAL GRID, FACE OF CONCRETE, FACE OF MASONRY, OR FACE OF FINISHED SURFACE, UNLESS NOTED OTHERWISE.	
	ABBYR		DEPT	DEPARTMENT	HDW	HARDWARE	PC	PLUMBING CONTRACTOR	TECH	TECHNICAL TECHNOLOGY										
	ACC	ACCESSIBLE	DET	DETAIL	HDWD	HARDWOOD	PERF	PERFORATED	TEL	TELEPHONE										
	ACCU	AIR COOLED CONDENSING UNIT	DF	DRINKING FOUNTAIN	HM	HOLLOW METAL	PERIM	PERIMETER	TEMP	TEMPORARY, TEMPERATURE										
M	ACI	AMERICAN CONCRETE INSTITUTE	DH	DOUBLE HUNG	HO	HOLD OPEN	PL	PLATE, PROPERTY LINE	TERR	TERRAZZO									3. REFLECTED CEILING PLAN DIMENSIONS ARE REFERENCED FROM FINISHED SURFACES UNLESS NOTED OTHERWISE. CEILING HEIGHTS ARE DIMENSIONED FROM FLOOR TO FINISHED CEILING HEIGHT.	
	ACOUS	ACOUSTICAL INSULATION	DIA or Ø	DIAMETER	HORIZ	HORIZON	PL GL	PLATE GLASS	THERM	THERMAL										
	INSUL		DIFF	DIFFERENCE	HR	HOUR	PLAM	PLASTIC LAMINATE	THK	THICKNESS										
	ACOUS PNL	ACOUSTICAL PANEL	DIM	DIMENSION	HSS	HOLLOW STRUCTURAL SECTION	PLAS	PLASTER, PLASTIC	THRU	THROUGH										
L	ACT	ACOUSTIC	DIR	DIRECTION	HT	HEIGHT	PLBG	PLUMBING	TK BD	TACK BOARD									4. CASEWORK, PLUMBING FIXTURES, TOILET PARTITIONS, AND OTHER FIXTURES AND EQUIPMENT ARE DIMENSIONED FROM FINISHED SURFACES UNLESS NOTED OTHERWISE.	
	ADA	AMERICANS WITH DISABILITIES ACT	DISP	DISPENSER	HVAC	HEATING, VENTILATING AND AIR CONDITIONING	PLYWD	PLYWOOD	TMPD	TEMPERED										
	ADDL	ADDITIONAL	DIST	DISTANCE	HW	HOT WATER	PNL	PANEL	TMPD GL	TEMPERED GLASS										
	ADDM	ADDITIONUM	DIV	DIVIDE, DIVISION	HYD	HYDRANT	POL	POLISHED	TOC	TOP OF CONCRETE										
K	ADH	ADHESIVE	DL	DEAD LOAD	I		POLY	POLYETHYLENE (PLASTIC)	TOF	TOP OF FOOTING, TOP OF FLOOR, TOP OF FRAME									5. DIMENSIONS NOTED AS "FIELD VERIFY" SHALL BE CHECKED AT THE SITE BY THE CONTRACTOR AND REVIEWED WITH THE ARCHITECT BEFORE INCORPORATING INTO THE WORK.	
	ADJ	ADJUSTABLE, ADJACENT	DMPF	DAMP-PROOFING	IN	INSIDE DIAMETER	PORC	PORCELAIN	TOM	TOP OF MASONRY										
	ADH	ADHESIVE	DMPR	DAMPER	ID	INCHES	PORT	PORTABLE	TOPO	TOPOGRAPHY										
	AE	ARCHITECT/ ENGINEER	DN	DOWN	INCAND	INCANDESCENT	POS	POSITIVE	TOS	TOP OF STEEL										
J	AF	ABOVE FINISHED FLOOR	DO	DITTO	INCL	INCLUDE	PR	PAIR	TPD	TOILET PAPER DISPENSER									6. DIMENSIONS NOTED AS "CLEAR" REQUIRE SPECIFIC COORDINATION BETWEEN DISCIPLINES AND/OR MANUFACTURERS.	
	AGGR	AGGREGATE	DOC	DOCUMENT	INFO	INFORMATION	PRCST	PRECAST	TV	TELEVISION										
	AHJ	AUTHORITY HAVING JURISDICTION	DOZ	DOZEN	INSUL	INSULATION	PREFAB	PREFABRICATED	TYP	TYPICAL										
	AHU	AIR HANDLING UNIT	DR	DOOR	INT	INTERIOR	PREFIN	PREFINISHED												
I	AISC	AMERICAN INSTITUTE OF STEEL CONSTRUCTION	DSG	DOWNSPOUT	INTERM	INTERMEDIATE	PRELIM	PRELIMINARY	U	UNIT									7. DRAWINGS NOTED AT "N.T.S." ARE NOT TO SCALE. DO NOT SCALE DRAWING. WRITTEN DIMENSIONS TAKE PRECEDENCE. IF CLARIFICATION IS REQUIRED IN ORDER TO DETERMINE THE INTENT OF THE CONTRACT DOCUMENTS, CONTACT THE ARCHITECT.	
	ALT	ALTERNATE	DT	DRAIN TILE	J	JANITOR	PRKG	PARKING	UC	UNDERCUT										
	ALUM	ALUMINUM	DW	DISH WASHER	JAN CLO	JANITOR CLOSET	PROJ	PROJECT	UGND	UNDERGROUND										
	ANOD	ANNOZZED	DWG	DRAWING	JNT	JOINT	PROP	PROPERTY	UH	UNIT HEATER										
H	APC	ACOUSTICAL PANEL CEILING	E	EAST	JR	JUNIOR	PSF	POUNDS PER SQUARE FOOT	UL	UNDERWRITERS LABORATORIES									8. DO NOT SCALE DRAWING. WRITTEN DIMENSIONS TAKE PRECEDENCE. IF CLARIFICATION IS REQUIRED IN ORDER TO DETERMINE THE INTENT OF THE CONTRACT DOCUMENTS, CONTACT THE ARCHITECT.	
	ARCH	ARCHITECT (URAL)	EA	EACH	JST	JOIST	PT	POST TENSIONED	UNFIN	UNFINISHED										
	ASL	ABOVE STRUCTURAL LEVEL	EC	ELECTRICAL CONTRACTOR	PTN	PARTITION	PTD	PAPER TOWER DISPENSER	UNO	UNLESS NOTED OTHERWISE										
	AWT	ACOUSTICAL WALL TREATMENT	EF	EACH FACE	PVC	POLYVINYL CHLORIDE (PLASTIC)	PT	POST TENSIONED	UTL	UTILITY										
G	B		EJ	EXPANSION JOINT	K	KNOCK DOWN	Q	QUARRY TILE	V	VOLT									9. NOTES OR DIMENSIONS LABELED "TYPICAL" SHALL APPLY TO SITUATIONS THAT ARE THE SAME OR SIMILAR.	
	B BD	BASE BOARD	E	EAST	KD	KNOCK DOWN	QT	QUARRY TILE	VAR	VARIABLES, VARIATION										
	B/B	BACK-TO-BACK	E	EAST	KIP	1000 POUNDS	QTR	QUARTER	VB	VINYL BASE										
	BAT	BATTEN	ELEC	ELECTRIC (IAL)	KIT	KITCHEN	QTY	QUANTITY	VCT	VINYL COMPOSITE TILE										
F	BD	BOARD	ELEV	ELEVATOR	KPL	KICK PLATE	R	RISER, RADIUS, HEAT RESISTANCE	VOC	VOLATILE ORGANIC COMPOUND									1. PROVIDE GALVANIC PROTECTION BETWEEN DISSIMILAR METALS.	
	BDRM	BEDROOM	ELEM	ELEMENTARY	KOL	KNOCK OUT	R	RISER, RADIUS, HEAT RESISTANCE	VOC	VOLATILE ORGANIC COMPOUND										
	BITUM	BITUMINOUS	ENAM	ENAMEL	L	LITER, ANGLE	R	RISER, RADIUS, HEAT RESISTANCE	VOC	VOLATILE ORGANIC COMPOUND										
	BLDG	BUILDING	ENCL	ENCLOSURE	L	LITER, ANGLE	RA	RADIATOR	VOC	VOLATILE ORGANIC COMPOUND										
E	BLKS	BLOCKING	ENGR	ENGINEER	LAB	LABORATORY	RAD	RADIATOR	VOC	VOLATILE ORGANIC COMPOUND									2. INSTALL PIPING AND CONDUIT TIGHT TO WALLS, COLUMNS AND ROOF DECK.	
	BM	BENCHMARK, BEAM	ENVIR	ENVIRONMENT	LAM	LAMINATE(D)	RB	RUBBER BASE, RESILIENT BASE	VOL	VOLUME										
	EOS	EDGE OF SLAB	EP	ELECTRIC PANEL	LAV	LAVATORY	RC	ROOFING CONTRACTOR	VOL	VOLUME										
	BOT	BOTTOM	EPDM	ETHYLENE PROPYLENE DIENE MONOMER	LBL	LABEL	RC	ROOFING CONTRACTOR	VOL	VOLUME										
D	BRG	BEARING	EPS	EXPANDED POLYSTYRENE	LBS	POUND	RD	ROOF DRAIN	VUH	VERTICAL UNIT HEATER									3. SEAL ALL PIPE OR CONDUIT PENETRATIONS WITH APPROPRIATE SEALANT. PROVIDE FIRE SEALANT AT RATED PARTITIONS.	
	BRZ	BRONZE	EQ	EQUAL	LD	LOAD	REC	RECESSED	VWC	VERTICAL WALL COVERING										
	BSMT	BASEMENT	EQUIP	EQUIPMENT	LF	LINEAR FEET	REC RM	RECREATION ROOM	W	WATT, WEST										
	BTWN	BETWEEN	EQUIV	EQUIVALENT	LH	LATENT HEAT, LEFT HAND LIBRARY	REF	REFRIGERATOR	W/O	WITHOUT										
C	BUR	BUILT-UP ROOFING	EQ	EQUAL	LKR	LOCKER	REIN	REINFORCE	W/W	WALL TO WALL									4. PLYWOOD AND WOOD BLOCKING SHALL BE FIRE RESISTANT.	
	BW	BOTH WAYS	EQ	EQUAL	LKR RM	LOCKER ROOM	REQD	REQUIRED	WB	WOOD BASE										
			ETR	EXISTING TO REMAIN	LL	LIVE LOAD	RESIL	RESILIENT	WC	WALL COVERING, WATER CLOSET										
			EW	EACH WAY	LLH	LONG LEG HORIZONTAL	REV	REVISION	WD	WOOD										
B	CAB	CABINET	EWC	ELECTRIC WATER COOLER	LLV	LONG LEG VERTICAL	RFG	ROOFING	WF	WIDE FLANGE									5. DO NOT CUT OR DRILL ANY STRUCTURAL MEMBER, OTHER THAN DESCRIBED ON THE STRUCTURAL DRAWINGS, WITHOUT WRITTEN APPROVAL FROM THE STRUCTURAL ENGINEER.	
	CB	CARRIAGE BOLT, CATCH BASIN	EW	EACH WAY	LT	LINEAR FEET	RFI	REQUEST FOR INFORMATION	WH	WATER HEATER, WALL HUNG										
	CD	CLOSED-CIRCUIT TELEVISION	EXC	EXCAVATE	LTG	LIGHTING	RFI	REQUEST FOR INFORMATION	WI	WROUGHT IRON										
	CD	CONSTRUCTION DOCUMENTS, CONTRACT DOCUMENTS	EXH	EXHAUST	M	MATCHLINE	RFI	REQUEST FOR INFORMATION	WM	WIRE MESH										
A	CEM	CEMENT	EXIST	EXISTING	MACH	MACHINE ROOM	RFI	REQUEST FOR INFORMATION	WP	WATER PROOFING, WEATHERPROOF									UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION	
	CERT	CERTIFY, CERTIFICATE, CERTIFICATION	EXP	EXPAND, EXPANSION	MACH RM	MACHINE ROOM	RFI	REQUEST FOR INFORMATION	WR	WATER REPELENT, WEATHER RESISTANT										
	CF/CI	CONTRACTOR FURNISHED/ CONTRACTOR INSTALLED	EXT	EXTERIOR	MAHOG	MAHOGANY	RFI	REQUEST FOR INFORMATION	WSC	WAINSCOT										
	CF/OI	CONTRACTOR FURNISHED/ OWNER INSTALLED	F	FACE-TO-FACE	MAINT	MAINTENANCE	RFI	REQUEST FOR INFORMATION	WT	WEIGHT										
Z	CG	CORNER GUARD	F/F	FACE-TO-FACE	MATL	MATERIAL	RFI	REQUEST FOR INFORMATION	WWF	WELDED WIRE FABRIC									STATE OF MISSOURI PLASTER NUMBER REGISTERED PROFESSIONAL	
	CH	COAT HOOK	FA	FIRE ALARM	MAX	MAXIMUM	RFI	REQUEST FOR INFORMATION	WWW	WELDED WIRE MESH										
	CHBD	CHALK BOARD	FAAP	FIRA ALARM ANNUNCIATOR PANEL	MB or MKR	MARKERBOARD	RFI	REQUEST FOR INFORMATION												
	CHEM	CHEMICAL	FACP	FIRE ALARM CONTROL PANEL	MC	MECHANICAL CONTRACTOR	RFI	REQUEST FOR INFORMATION												
Y																				




Specialty Equipment Schedule LSHS				
Mark	Description	Manufacturer	Model Number	Comments
Fire Extinguisher Cabinets				
FE01	FIRE EXTINGUISHER CABINET			SEMI-RECESSED
FE02	FIRE EXTINGUISHER CABINET			WALL MOUNTED


- ### Specialty Equipment Notes:
1. THIS PROJECT WILL COMPLY WITH ALL AMERICAN WITH DISABILITIES REGULATIONS AND ALL LOCAL ACCESSIBILITY CODE REQUIREMENTS.
  2. ALL MOUNTING HEIGHTS ARE TO COMPLY WITH ICC/IBC CODES, IN REFERENCE TO THE LATEST HEIGHT GUIDELINES FOR TYPICAL, MOUNTING HEIGHTS. COORDINATE WITH OWNER/ARCHITECT FOR ANY ITEMS IN CONFLICT OR NOT EXPLICITLY IDENTIFIED. PROVIDE WOOD BLOCKING AT ALL EQUIPMENT FIXTURES, AND ACCESSORIES INCLUDING WOODEN PROVIDE ITEMS WHETHER OR NOT SUCH BLOCKING IS NOTED OR SPECIFIED.
  3. ACCESSORIES SHOWN ARE GENERIC. REFER TO SCHEDULE SPECIFIED MODEL.
  4. FIXTURES, ACCESSORIES SHOWN ARE GENERIC. REFER TO PLUMBING DRAWINGS FOR SCHEDULED FIXTURES.

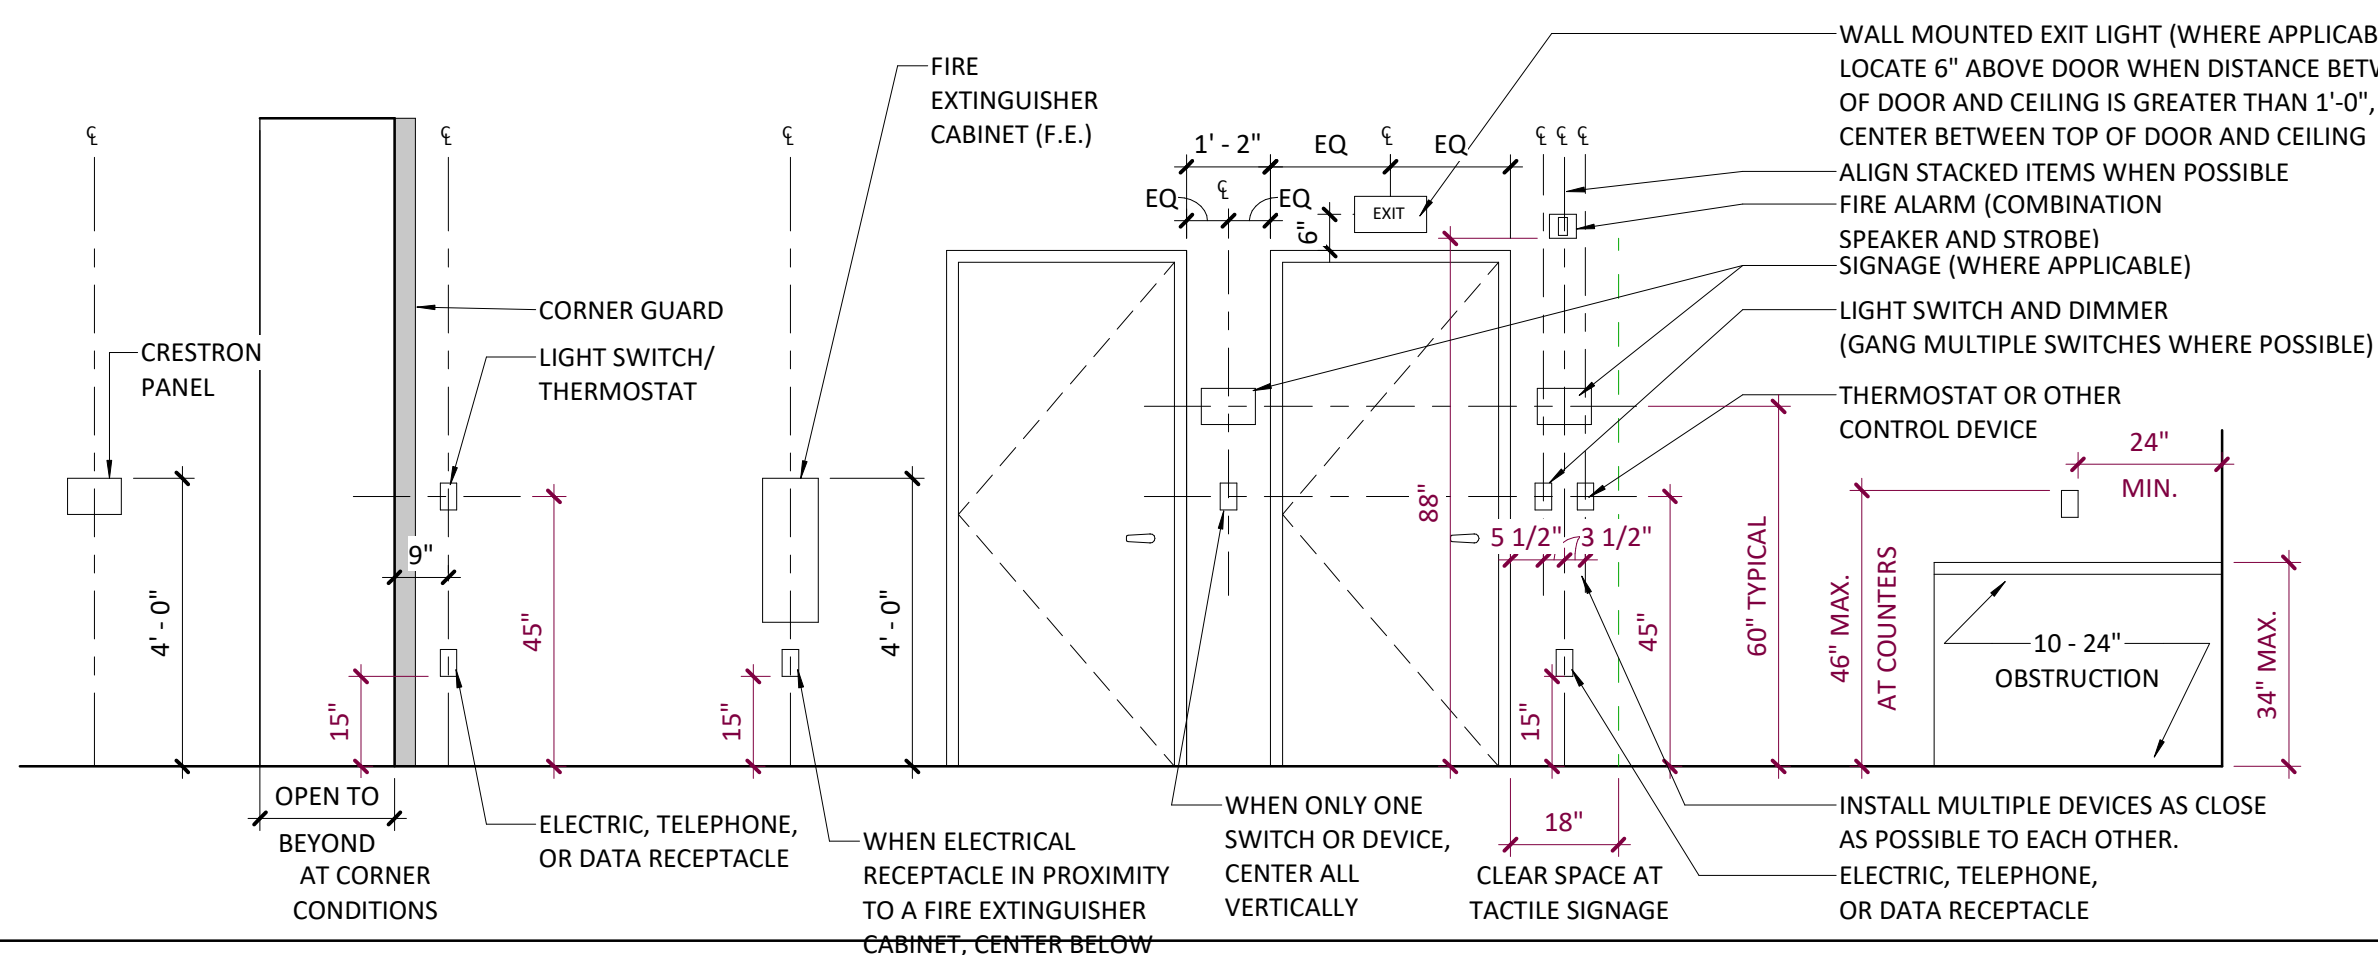


Miscellaneous Heights **G1**  
3/8" = 1'-0"

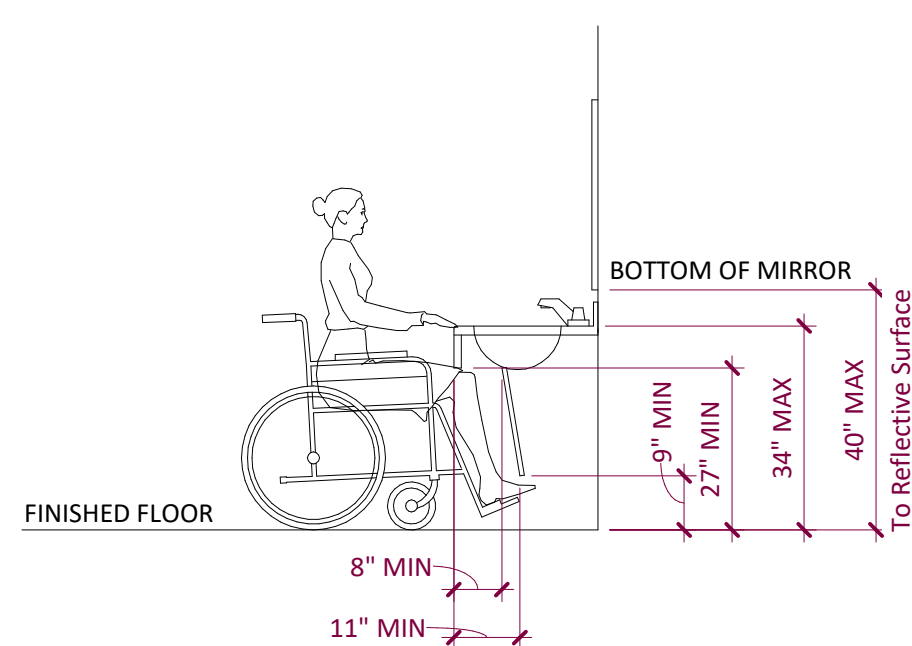

Lavatory Guidelines **D7**  
3/8" = 1'-0"

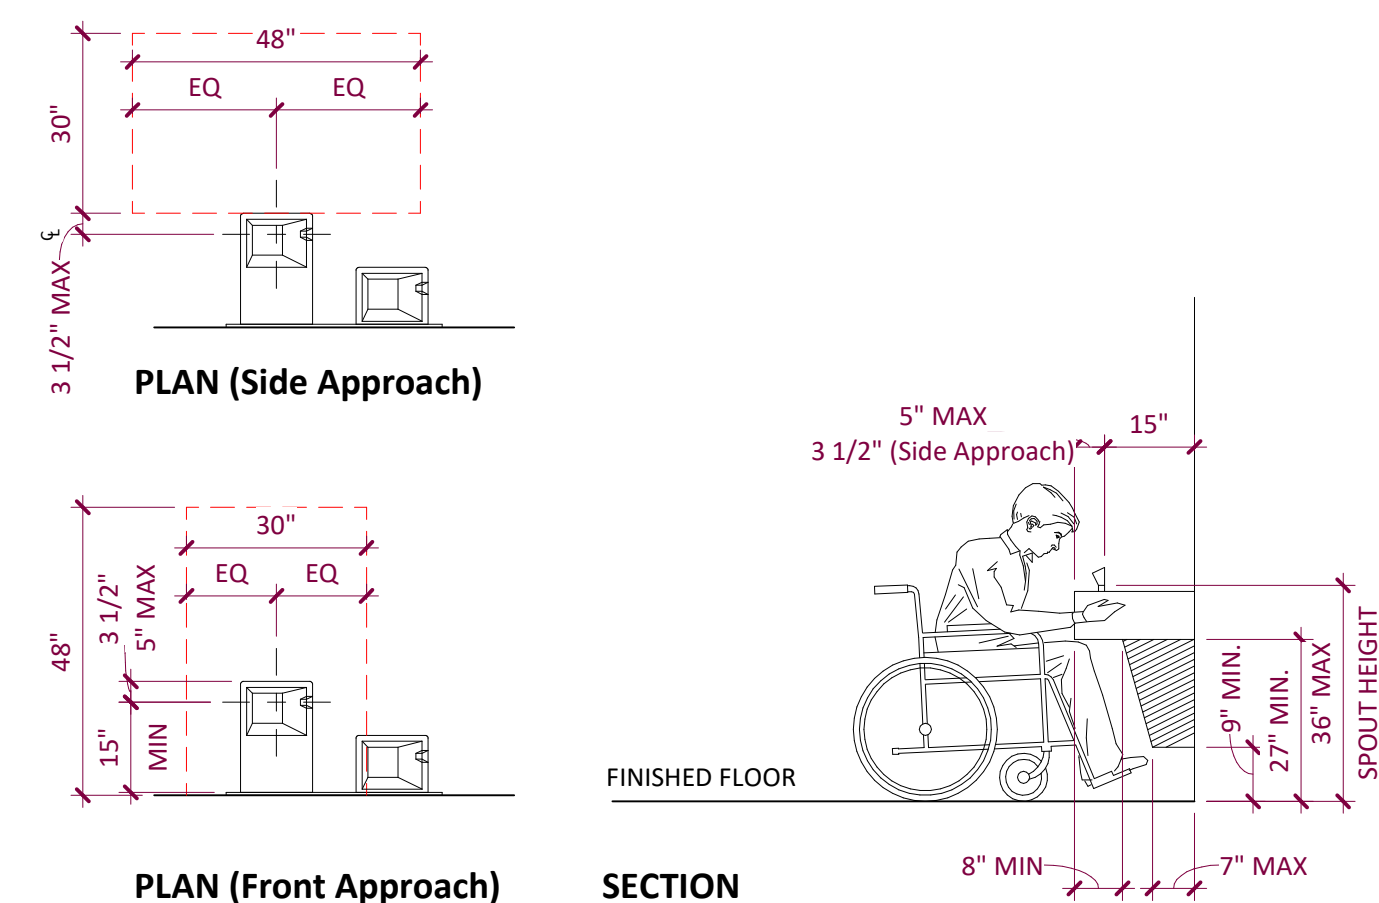

## Drinking Fountain Guidelines **D1**

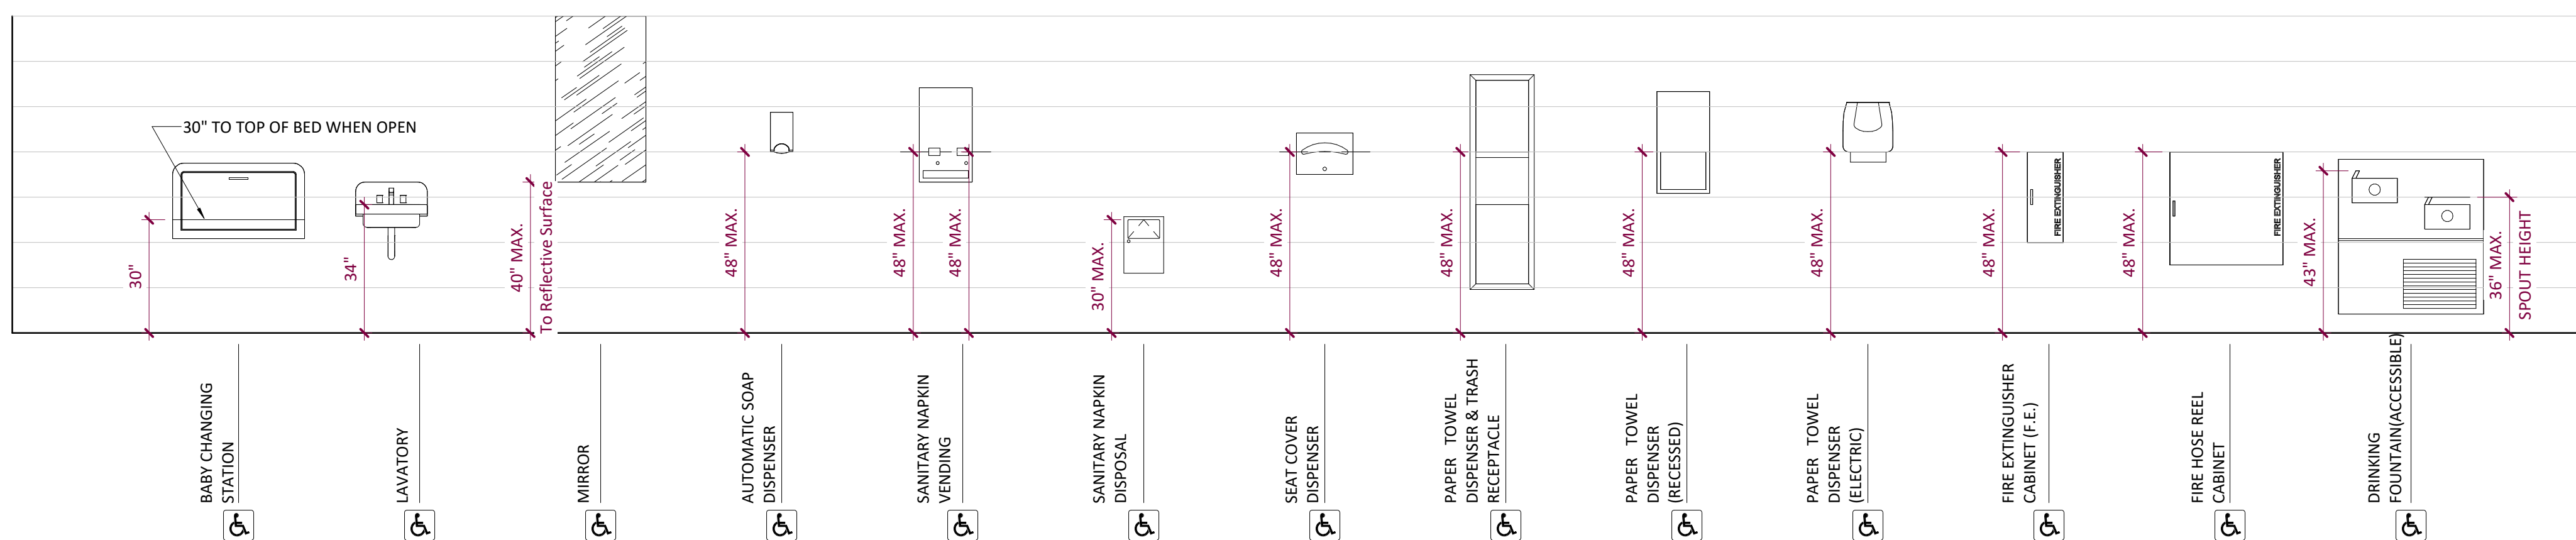

## Fixture Height Guidelines **A1**

**LSR7 Robotics, GiC & Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100

owner:  
**Lee's Summit R-7 School**  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
**Multistudio**  
4200 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi.studio

civil engineer:  
**Kaw Valley Engineering**  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com

MEPFT/Code::  
**Henderson Engineers**  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
[www.hendersonengineers.com](http://www.hendersonengineers.com)

Issue Date: September 9, 2022

## Revisions

NUMBER	DESCRIPTION	DATE
--------	-------------	------



## Accessibility Standards

### A002-C









5/8" GYPSUM BOARD	ALL LOCATIONS UNLESS NOTED BELOW OR DETAILLED OTHERWISE.
5/8" ABUSE RESISTANT GYPSUM BOARD	HIGH TRAFFIC AREAS SUCH AS LOBBIES, PLUMBING CORRIDORS AND WORK ROOMS SUCH AS: JANITOR, HOUSEKEEPING, MECHANICAL, ETC.
5/8" GLASS MAT BACKING BOARD	"WET" WALLS NON-RATED WITH PLUMBING FIXTURES, DRINKING FOUNTAINS, TOILETS, LAVATORIES, URINALS, ETC.
1/2" FIBER CEMENT BACKING PANEL S.	WALLS EXPOSED DIRECTLY TO RUNNING WATER AND SCHEDULE TO RECEIVE TILE, BATHTUBS, SHOWERS, ETC.

## G6.1


NUMBER	DESCRIPTION	DATE
--------	-------------	------

# A090-C

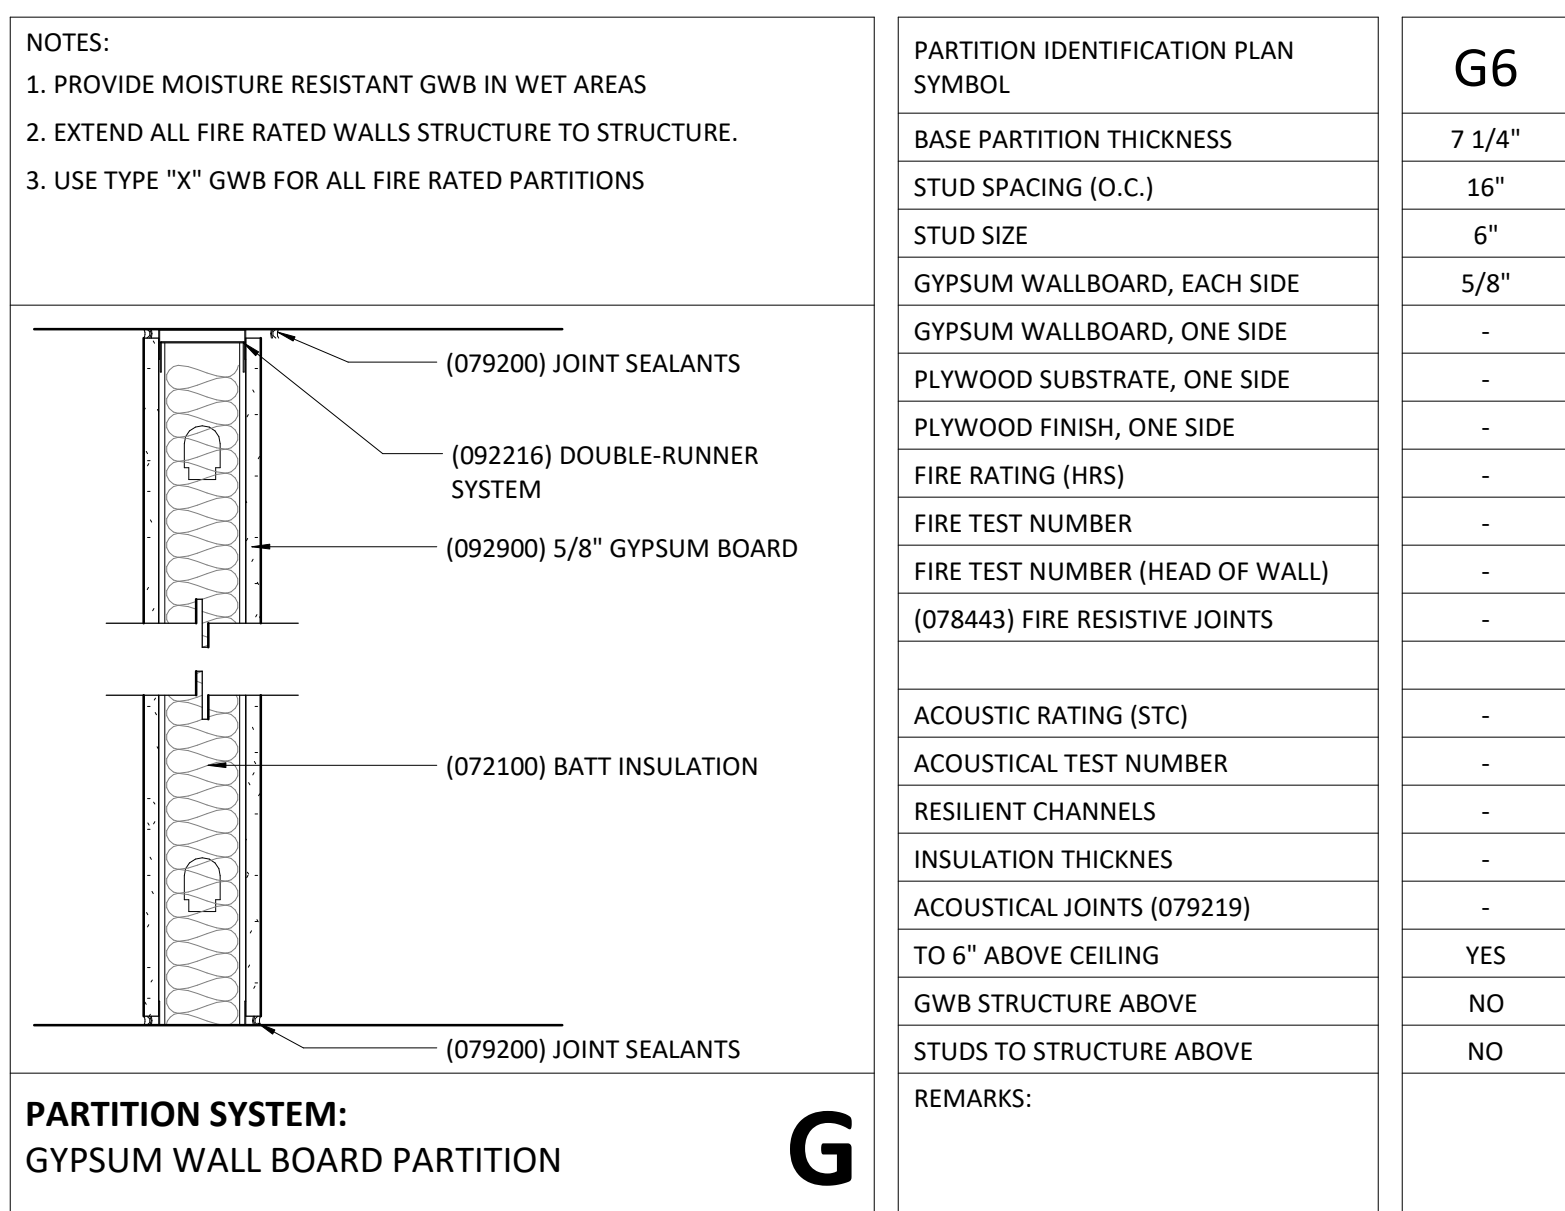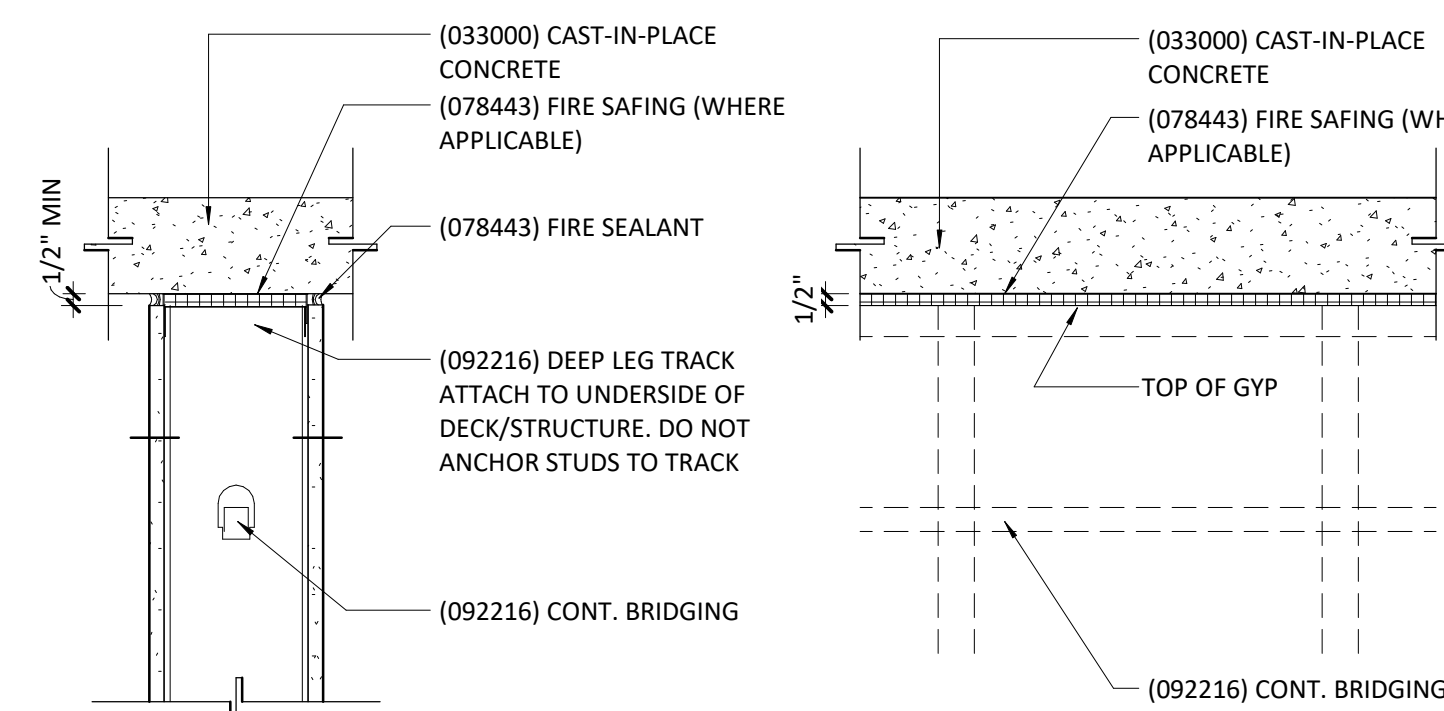


Partition to Underside of Deck - Rated **A3**  
 $1\frac{1}{2}" = 1'-0"$



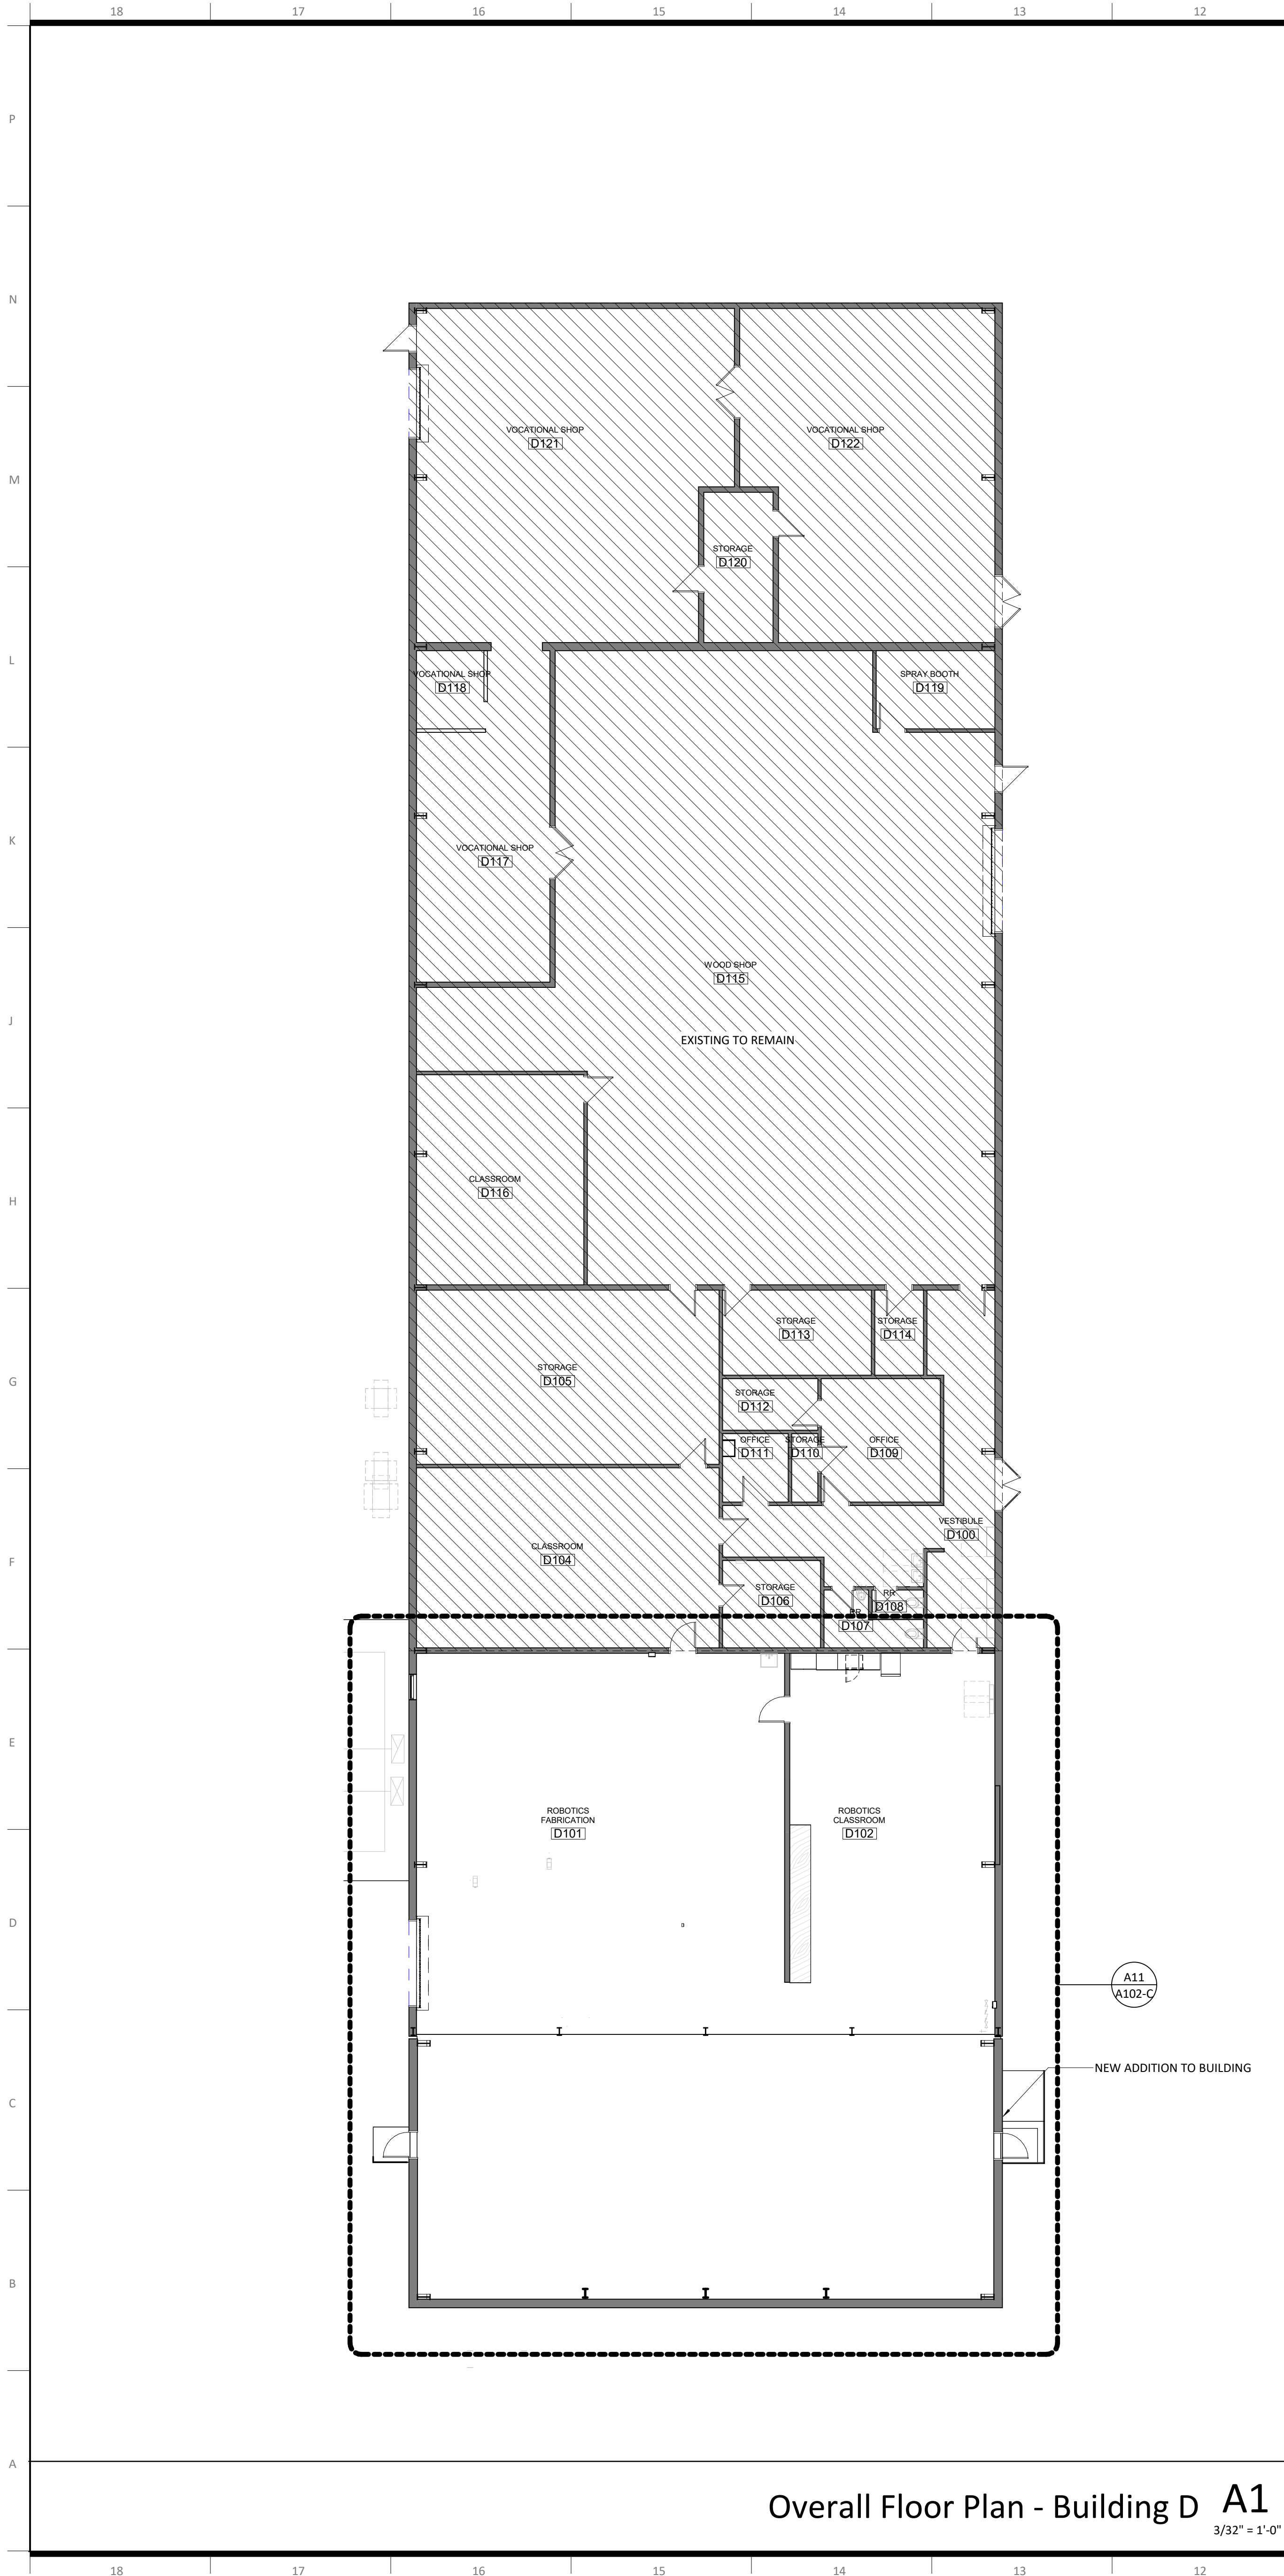

Overall Floor Plan - Building D A1  
3/32" = 1'-0"

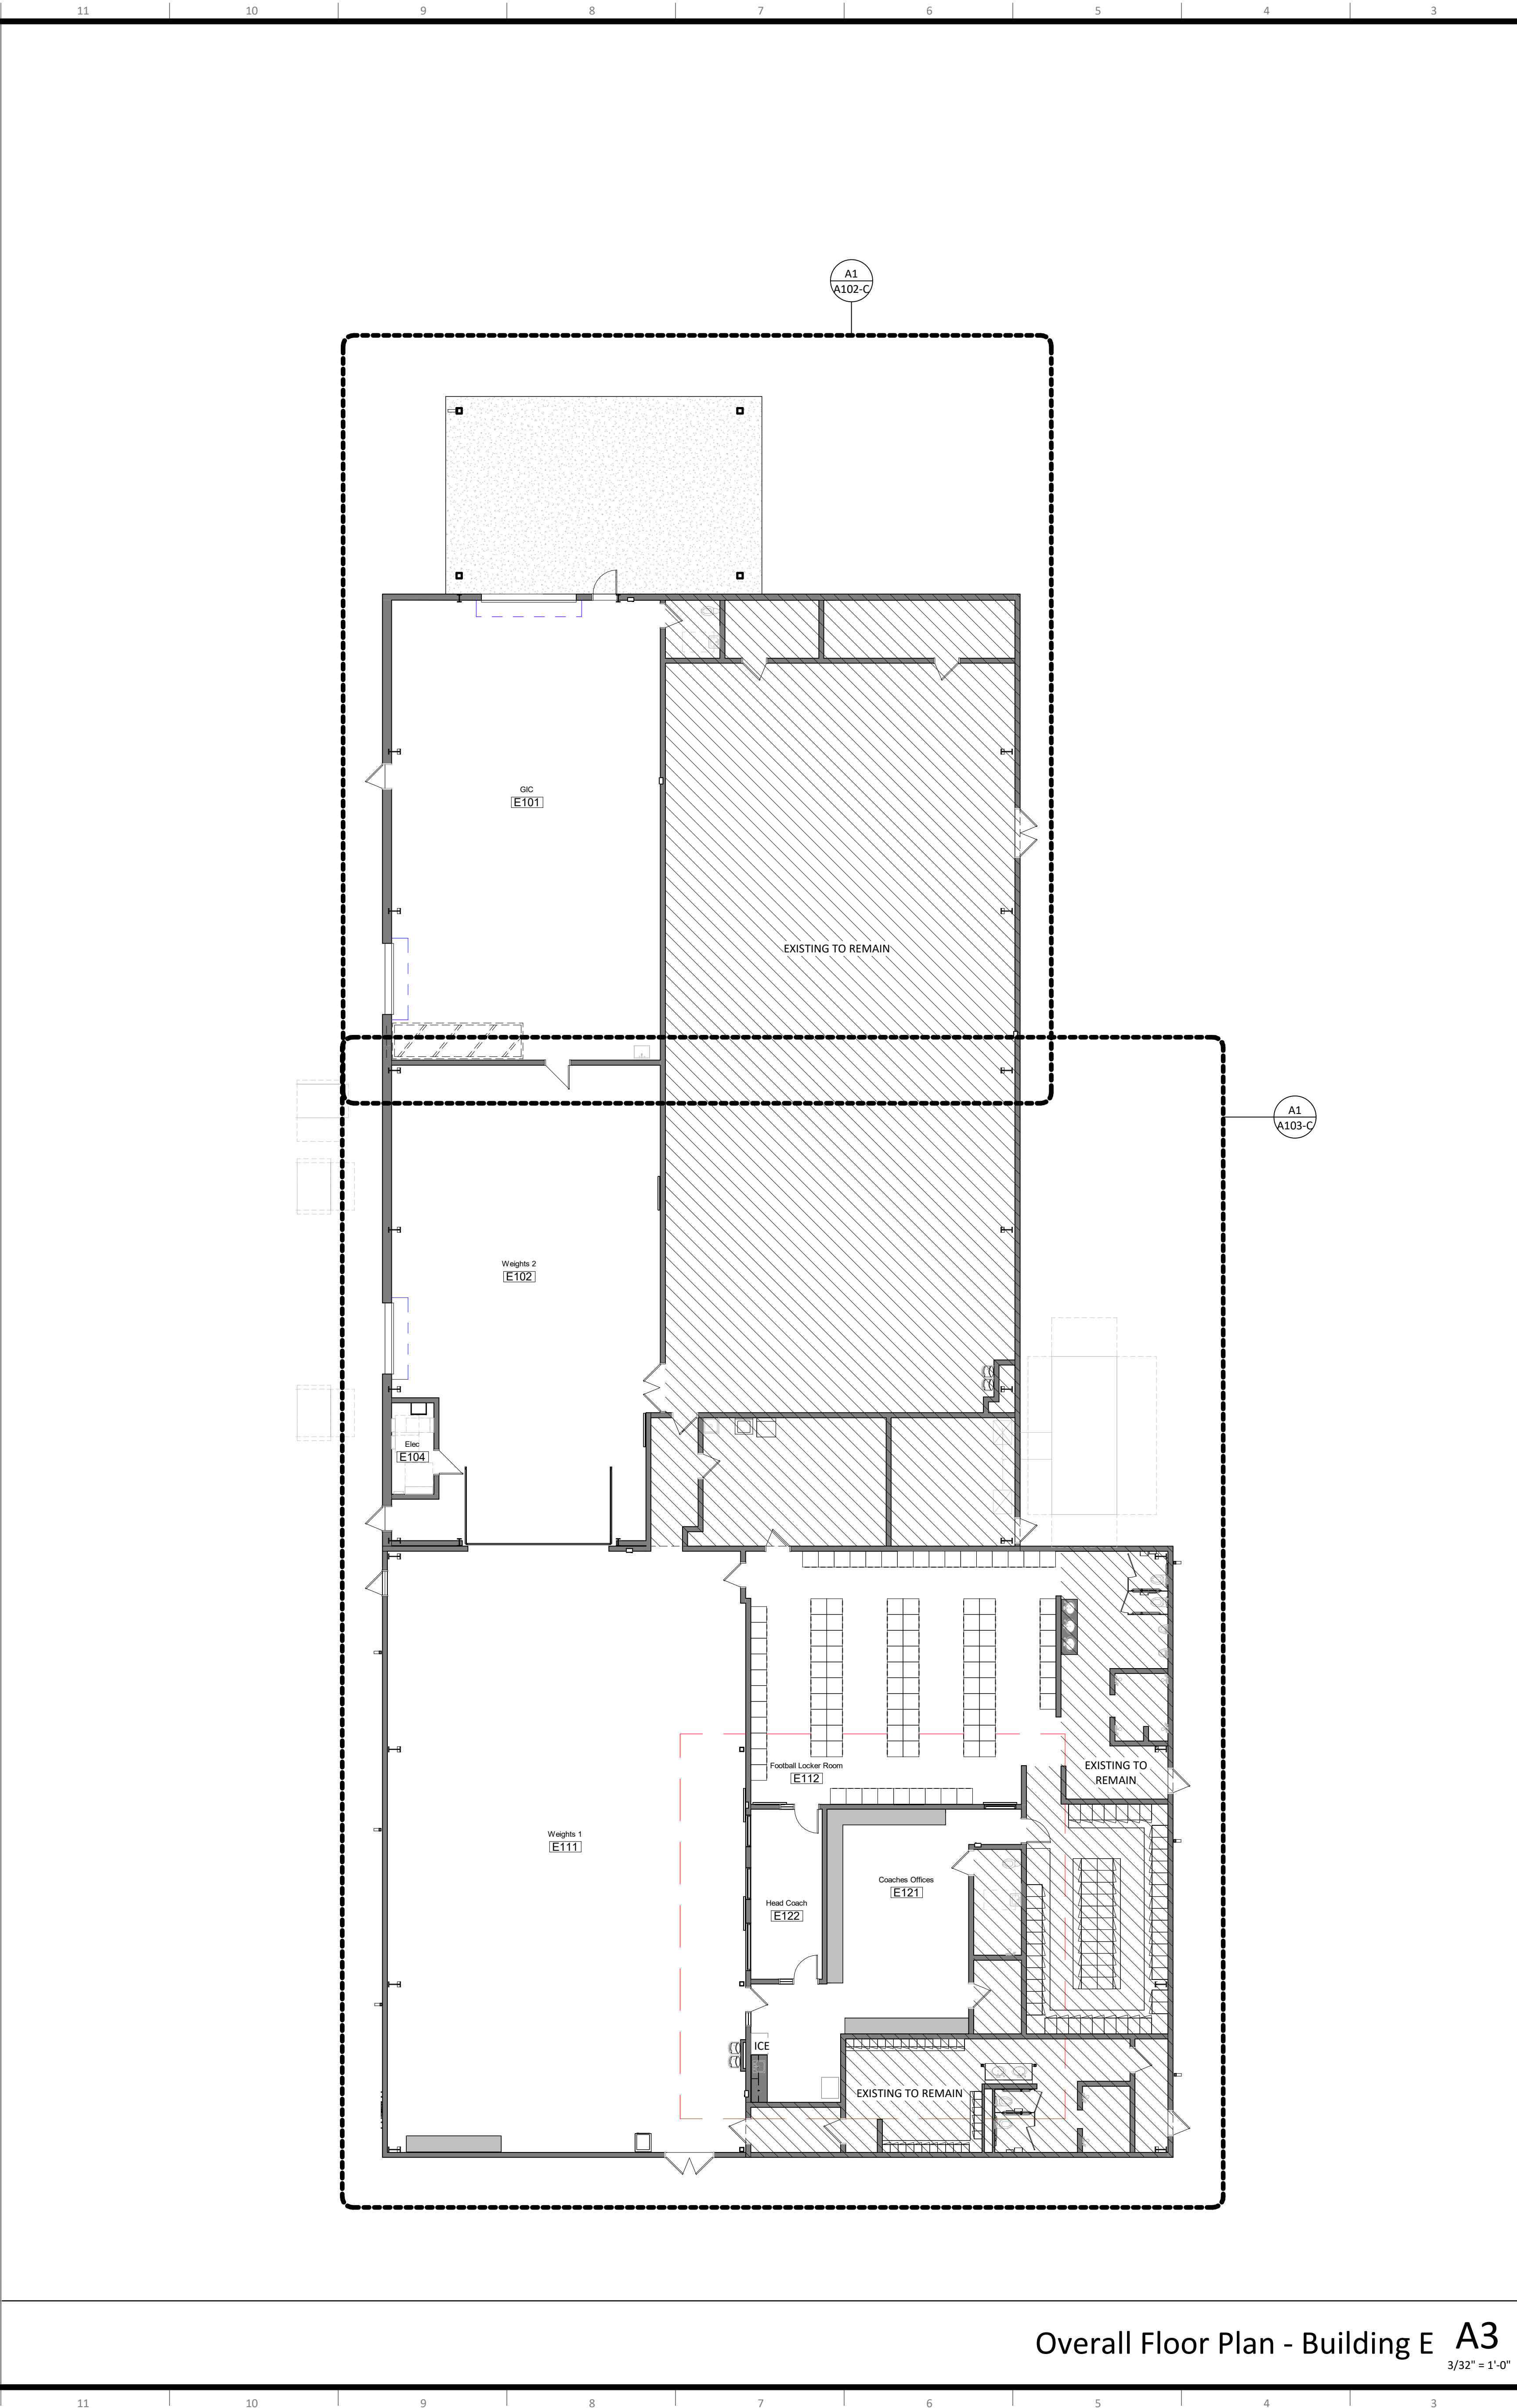

Overall Floor Plan - Building E A3  
3/32" = 1'-0"

- General Notes (Floor Plans):
1. ALL WALL TYPES TO BE G4.1 UNLESS OTHERWISE NOTED.
  2. ALL WALL DIMENSIONS ARE TO FACE OF WALL UNLESS OTHERWISE NOTED.
  3. MASONRY WALLS ARE NOMINALLY CENTERED ON GRID LINES AND MASONRY DIMENSIONS ARE NOMINAL UNLESS OTHERWISE NOTED.
  4. DOORS IN STUD WALLS NEAR PERPENDICULAR WALLS ARE LOCATED 4" OFF FACE OF PERPENDICULAR WALL UNLESS OTHERWISE NOTED.
  5. DOORS IN MASONRY WALLS ARE LOCATED IN ROUGH OPENINGS DIMENSIONED ON SHEET.
  6. SEE GENERAL ACCESSIBILITY SHEET FOR HEIGHTS AND LOCATIONS OF TOILET ACCESSORIES NOT SHOWN ON ELSEWHERE.
  7. CONTRACTOR TO FIELD VERIFY ALL MEASUREMENTS AND CONDITIONS NEW AND EXISTING. NOTIFY THE ARCHITECT/OWNER'S REPRESENTATIVE OF ANY DISCREPANCIES.
  8. ENLARGED PLANS MAY BE ROTATED OR MIRRORED COORDINATE WITH MAIN FLOOR PLAN.
  9. CONTRACTOR TO PROVIDE 4'-0" HIGH PLYWOOD BACKER BOARD IN ALL MECHANICAL AND ELECTRICAL ROOMS MOUNTED 3'-6" A.F.F. FOR PERIMETER OF ROOM.

**multistudio**  
the evolution of gould evans

**LSR7 Robotics, GiC & Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100

owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect: Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi-studio

civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kvang.com

structural engineer: Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/IT/Code: Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

Issue Date: September 9, 2022

Revisions		
NUMBER	DESCRIPTION	DATE

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



Overall Floor Plans -  
Building D & E  
**A101-C**



LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100

owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086  
architect: Multistudio  
4300 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multistudio.com  
civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveeng.com  
structural engineer: Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/FIT Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

Issue Date: September 9, 2022


Revisions		
NUMBER	DESCRIPTION	DATE
1	Addendum 01	09/09/2022
2	Addendum 02	09/28/2022

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION




Enlarged Floor Plan - Building D & E

A102-C

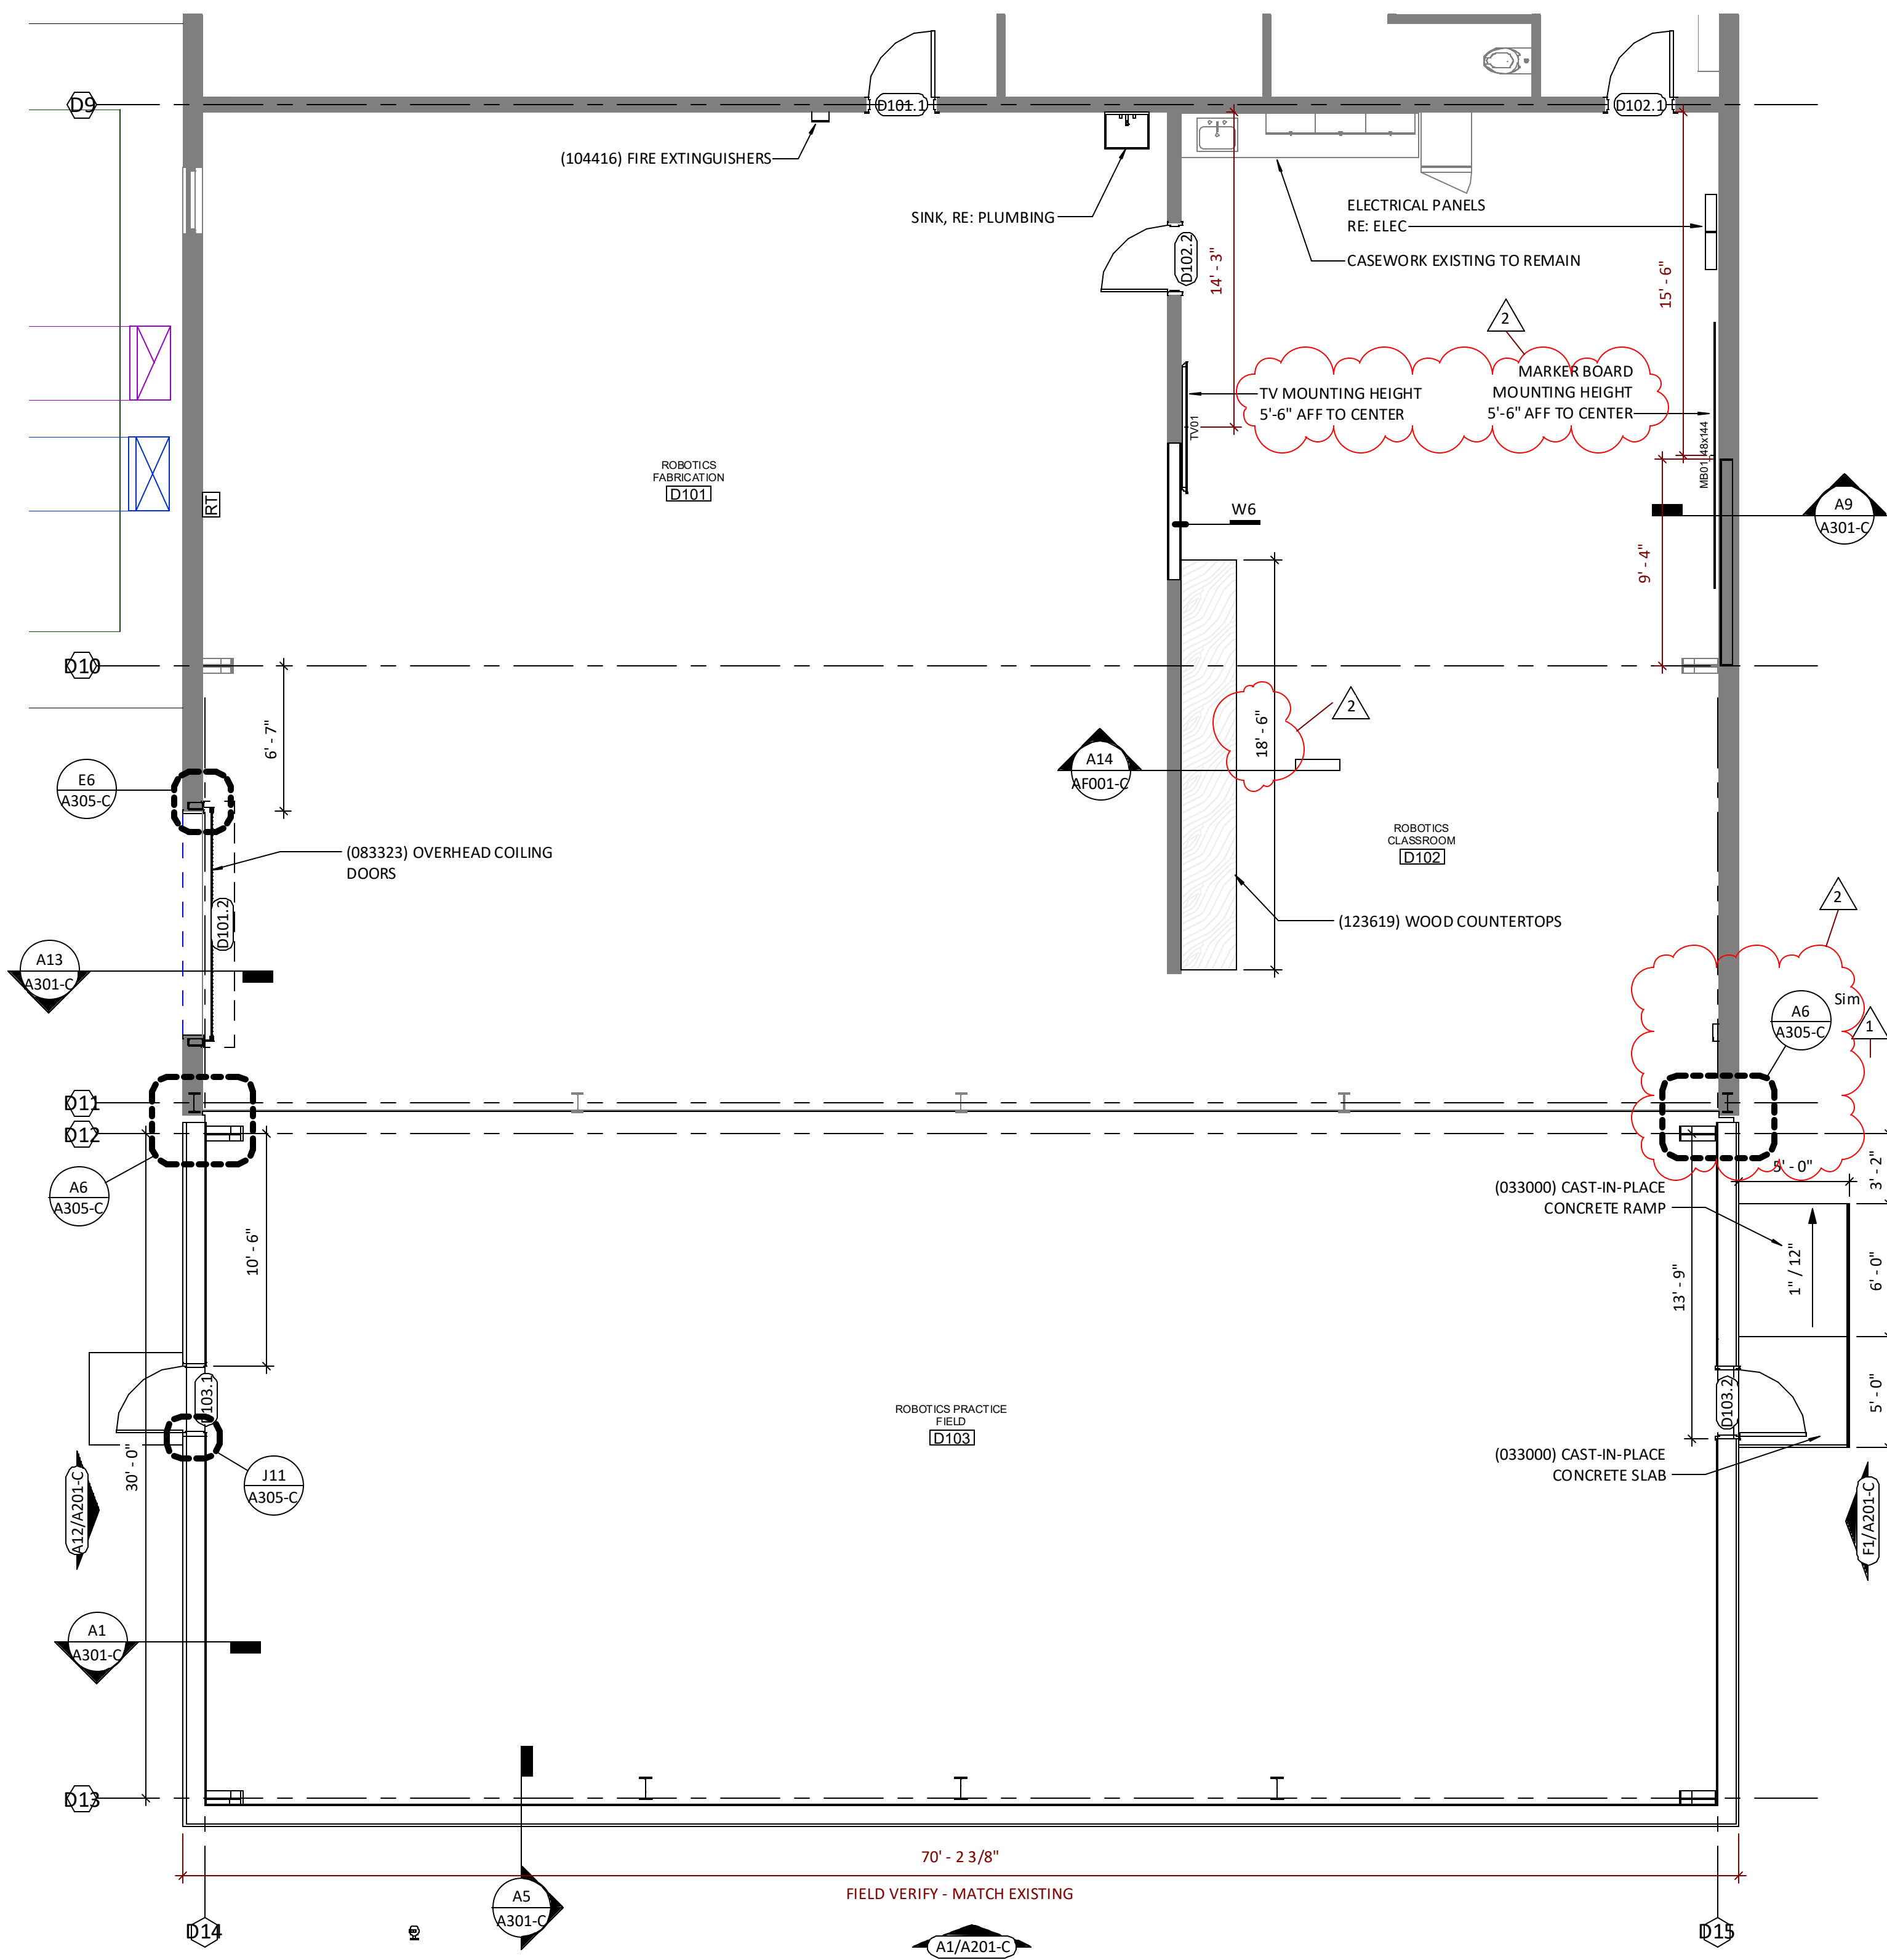

Enlarged Floor Plan - Building D - Robotics A11  
3/16" = 1'-0"

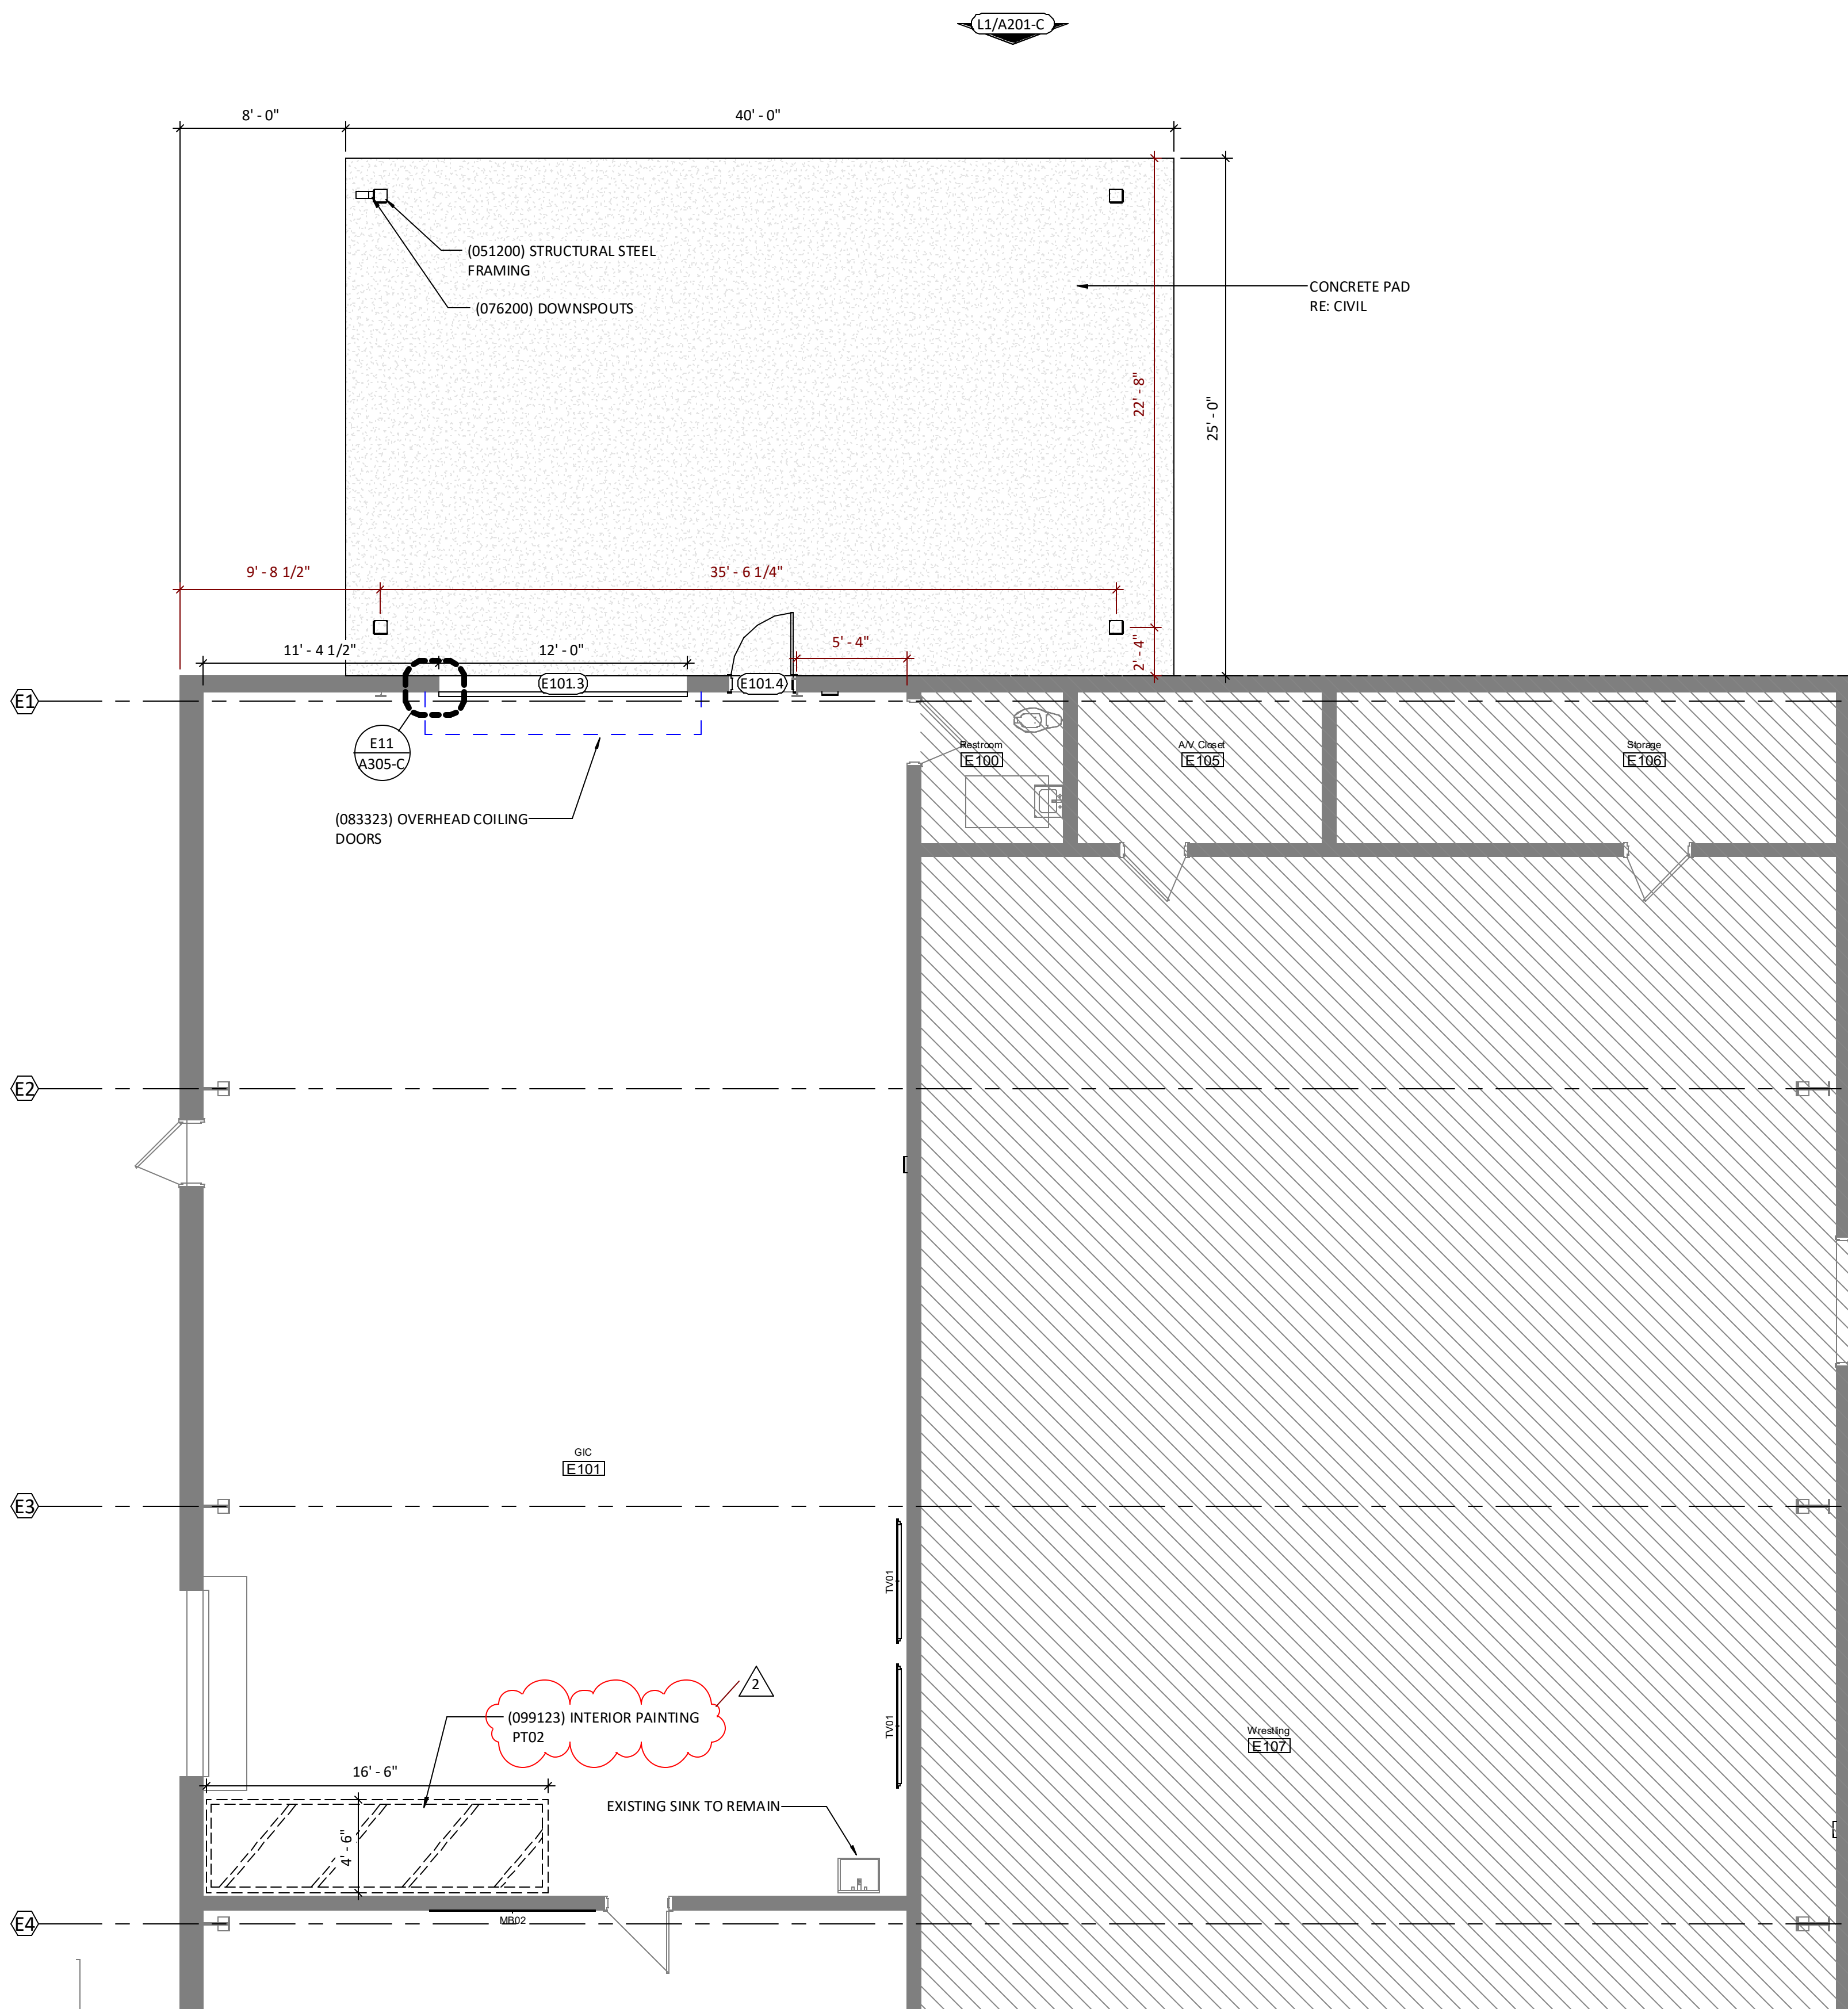

Enlarged Floor Plan - Building E - GIC A1  
3/16" = 1'-0"



LSR7 Robotics, GiC &  
Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO  
64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO  
64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4205 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi-studio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com

structural engineer:  
Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/IT Codes:  
Henderson Engineers  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

Issue Date: September 9, 2022

Revisions

NUMBER	DESCRIPTION	DATE
--------	-------------	------

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS  
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR  
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



Enlarged Floor Plan -  
Building E

A103-C

Enlarged Floor Plan - Weights A1  
3/16" = 1'-0"



## Revisions

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS  
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR  
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



# A111-C

Enlarged Roof Plan - Building E - GIC **A1**  
3/16" = 1'-0"





LSR7 Robotics, GiC &  
Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO  
64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO  
64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086  
multi-studio

architect:  
Multistudio  
4205 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi-studio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com

structural engineer:  
Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/T/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

Issue Date: September 9, 2022

Revisions


NUMBER	DESCRIPTION	DATE
--------	-------------	------

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS  
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR  
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION




Reflected Ceiling Plan -  
Building D & E

A151-C

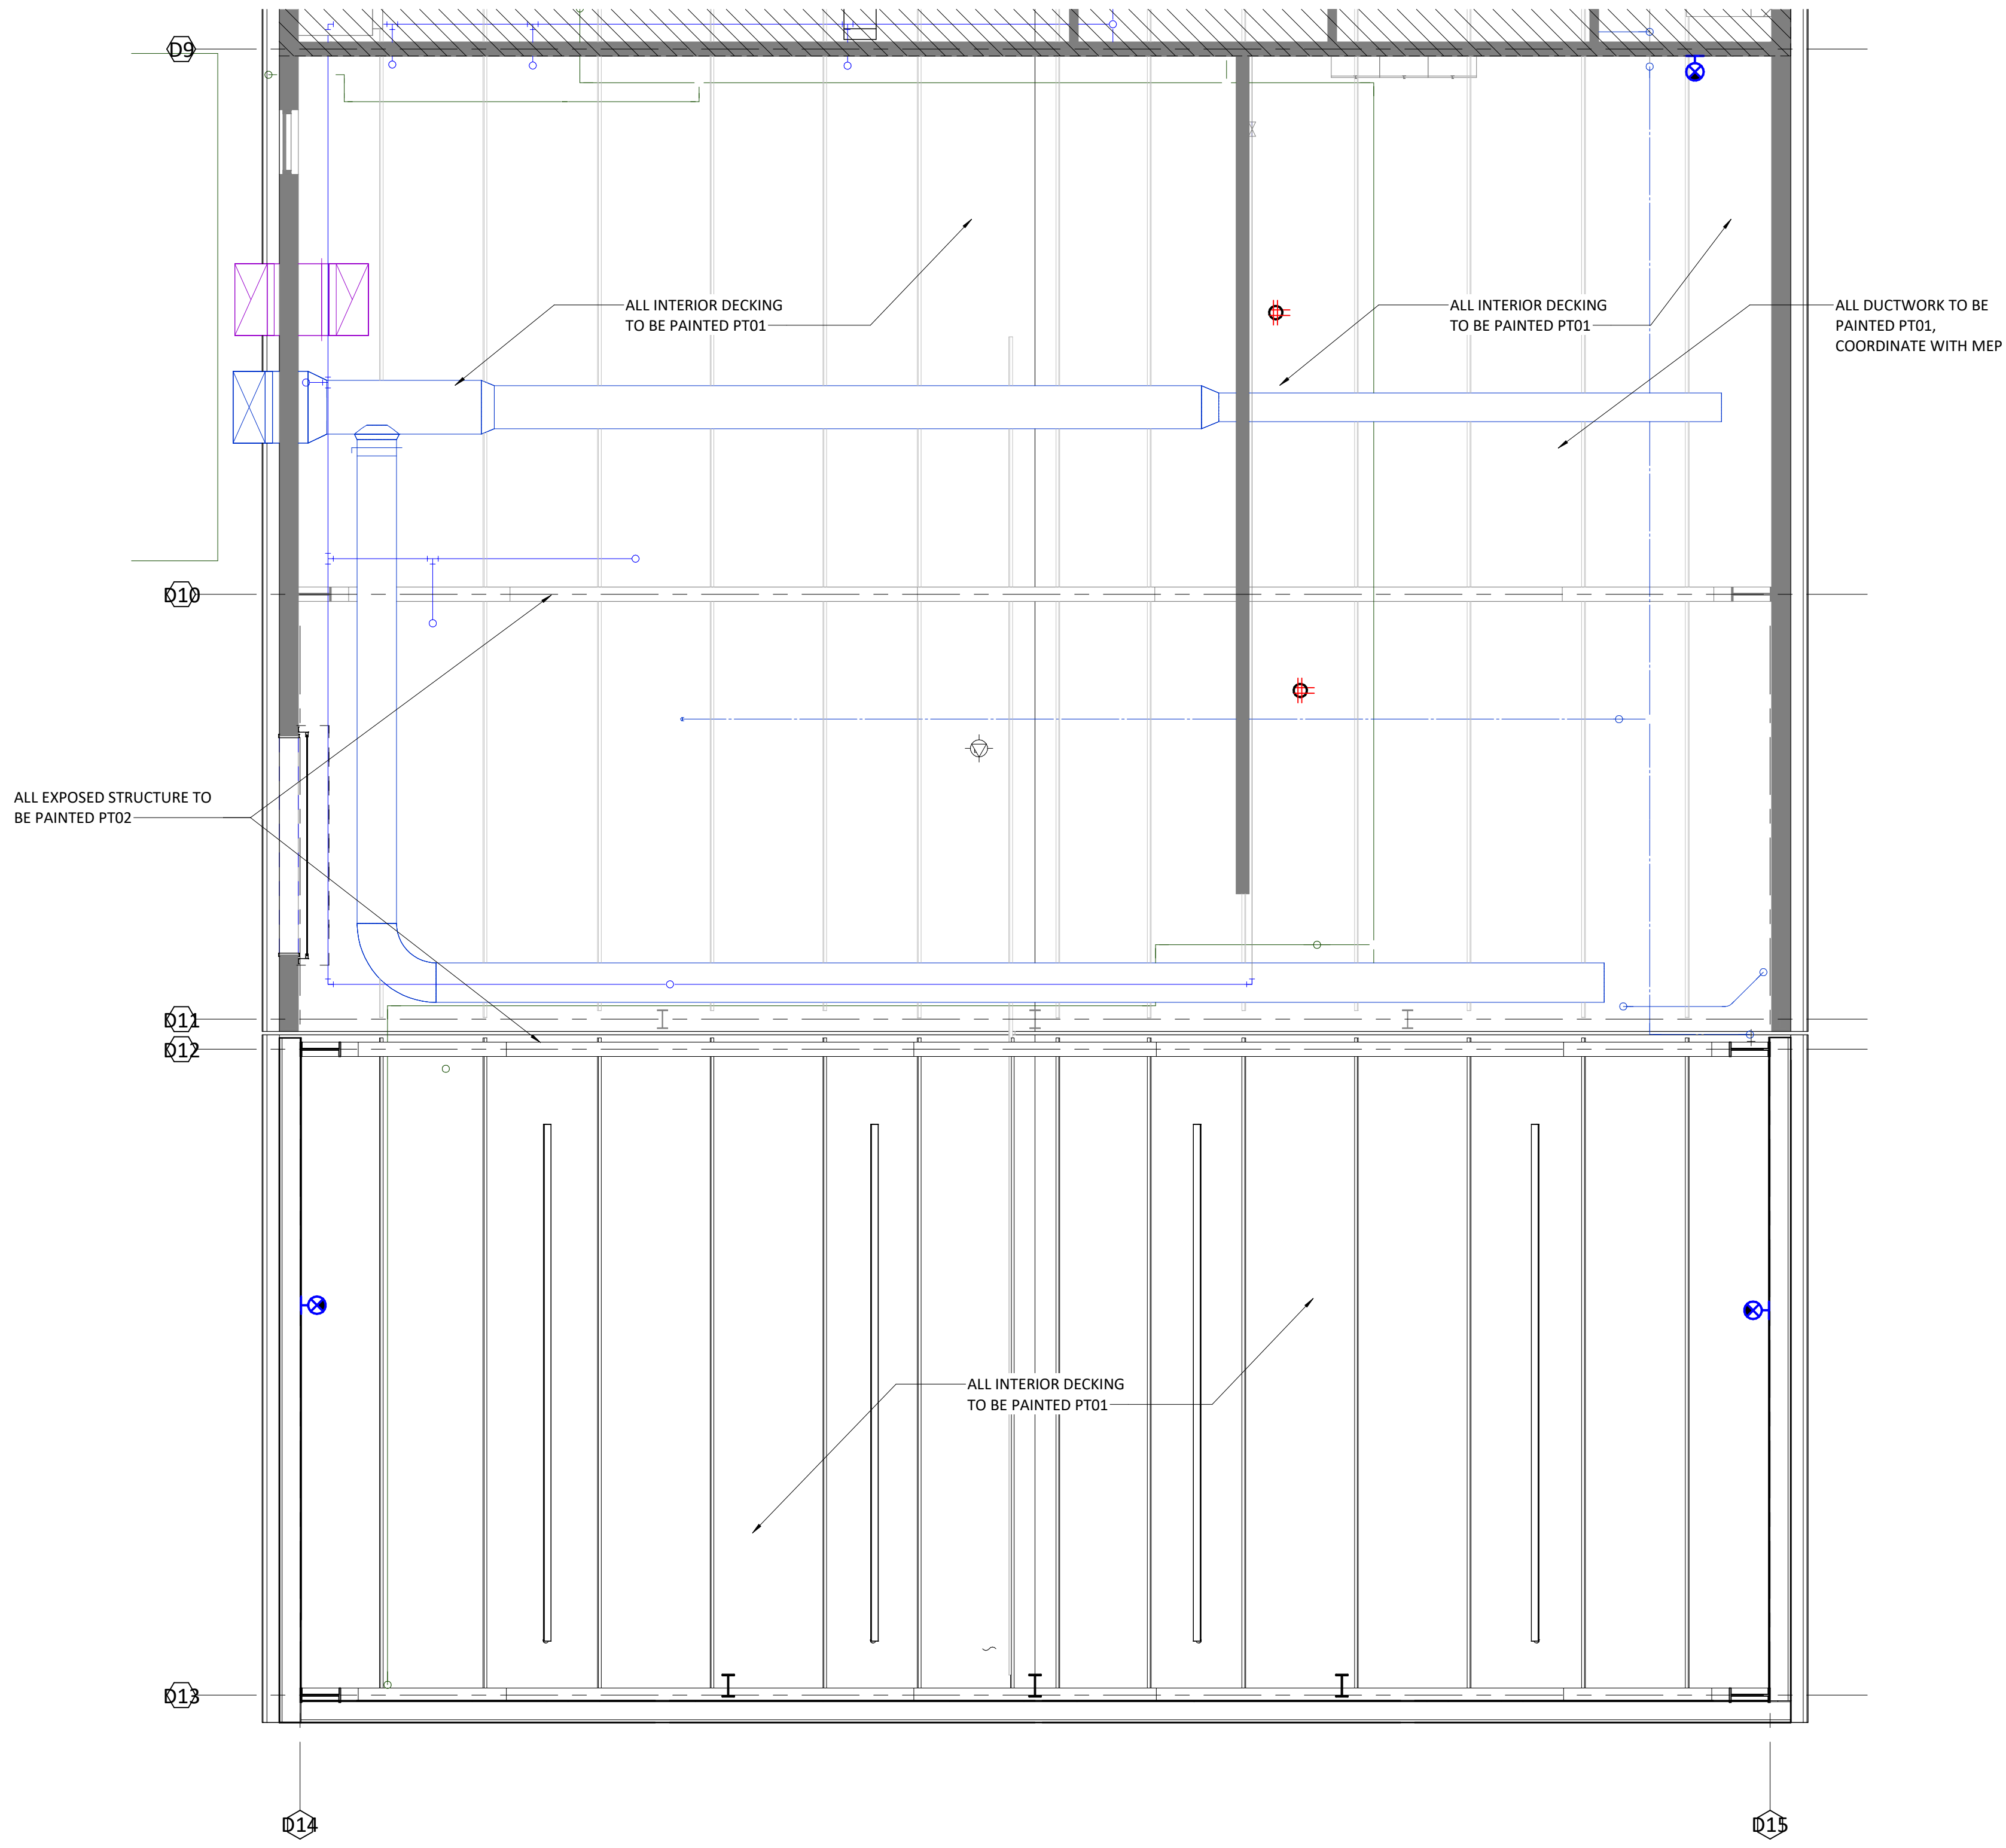

Reflected Ceiling Plan - Robotics A10  
3/16" = 1'-0"

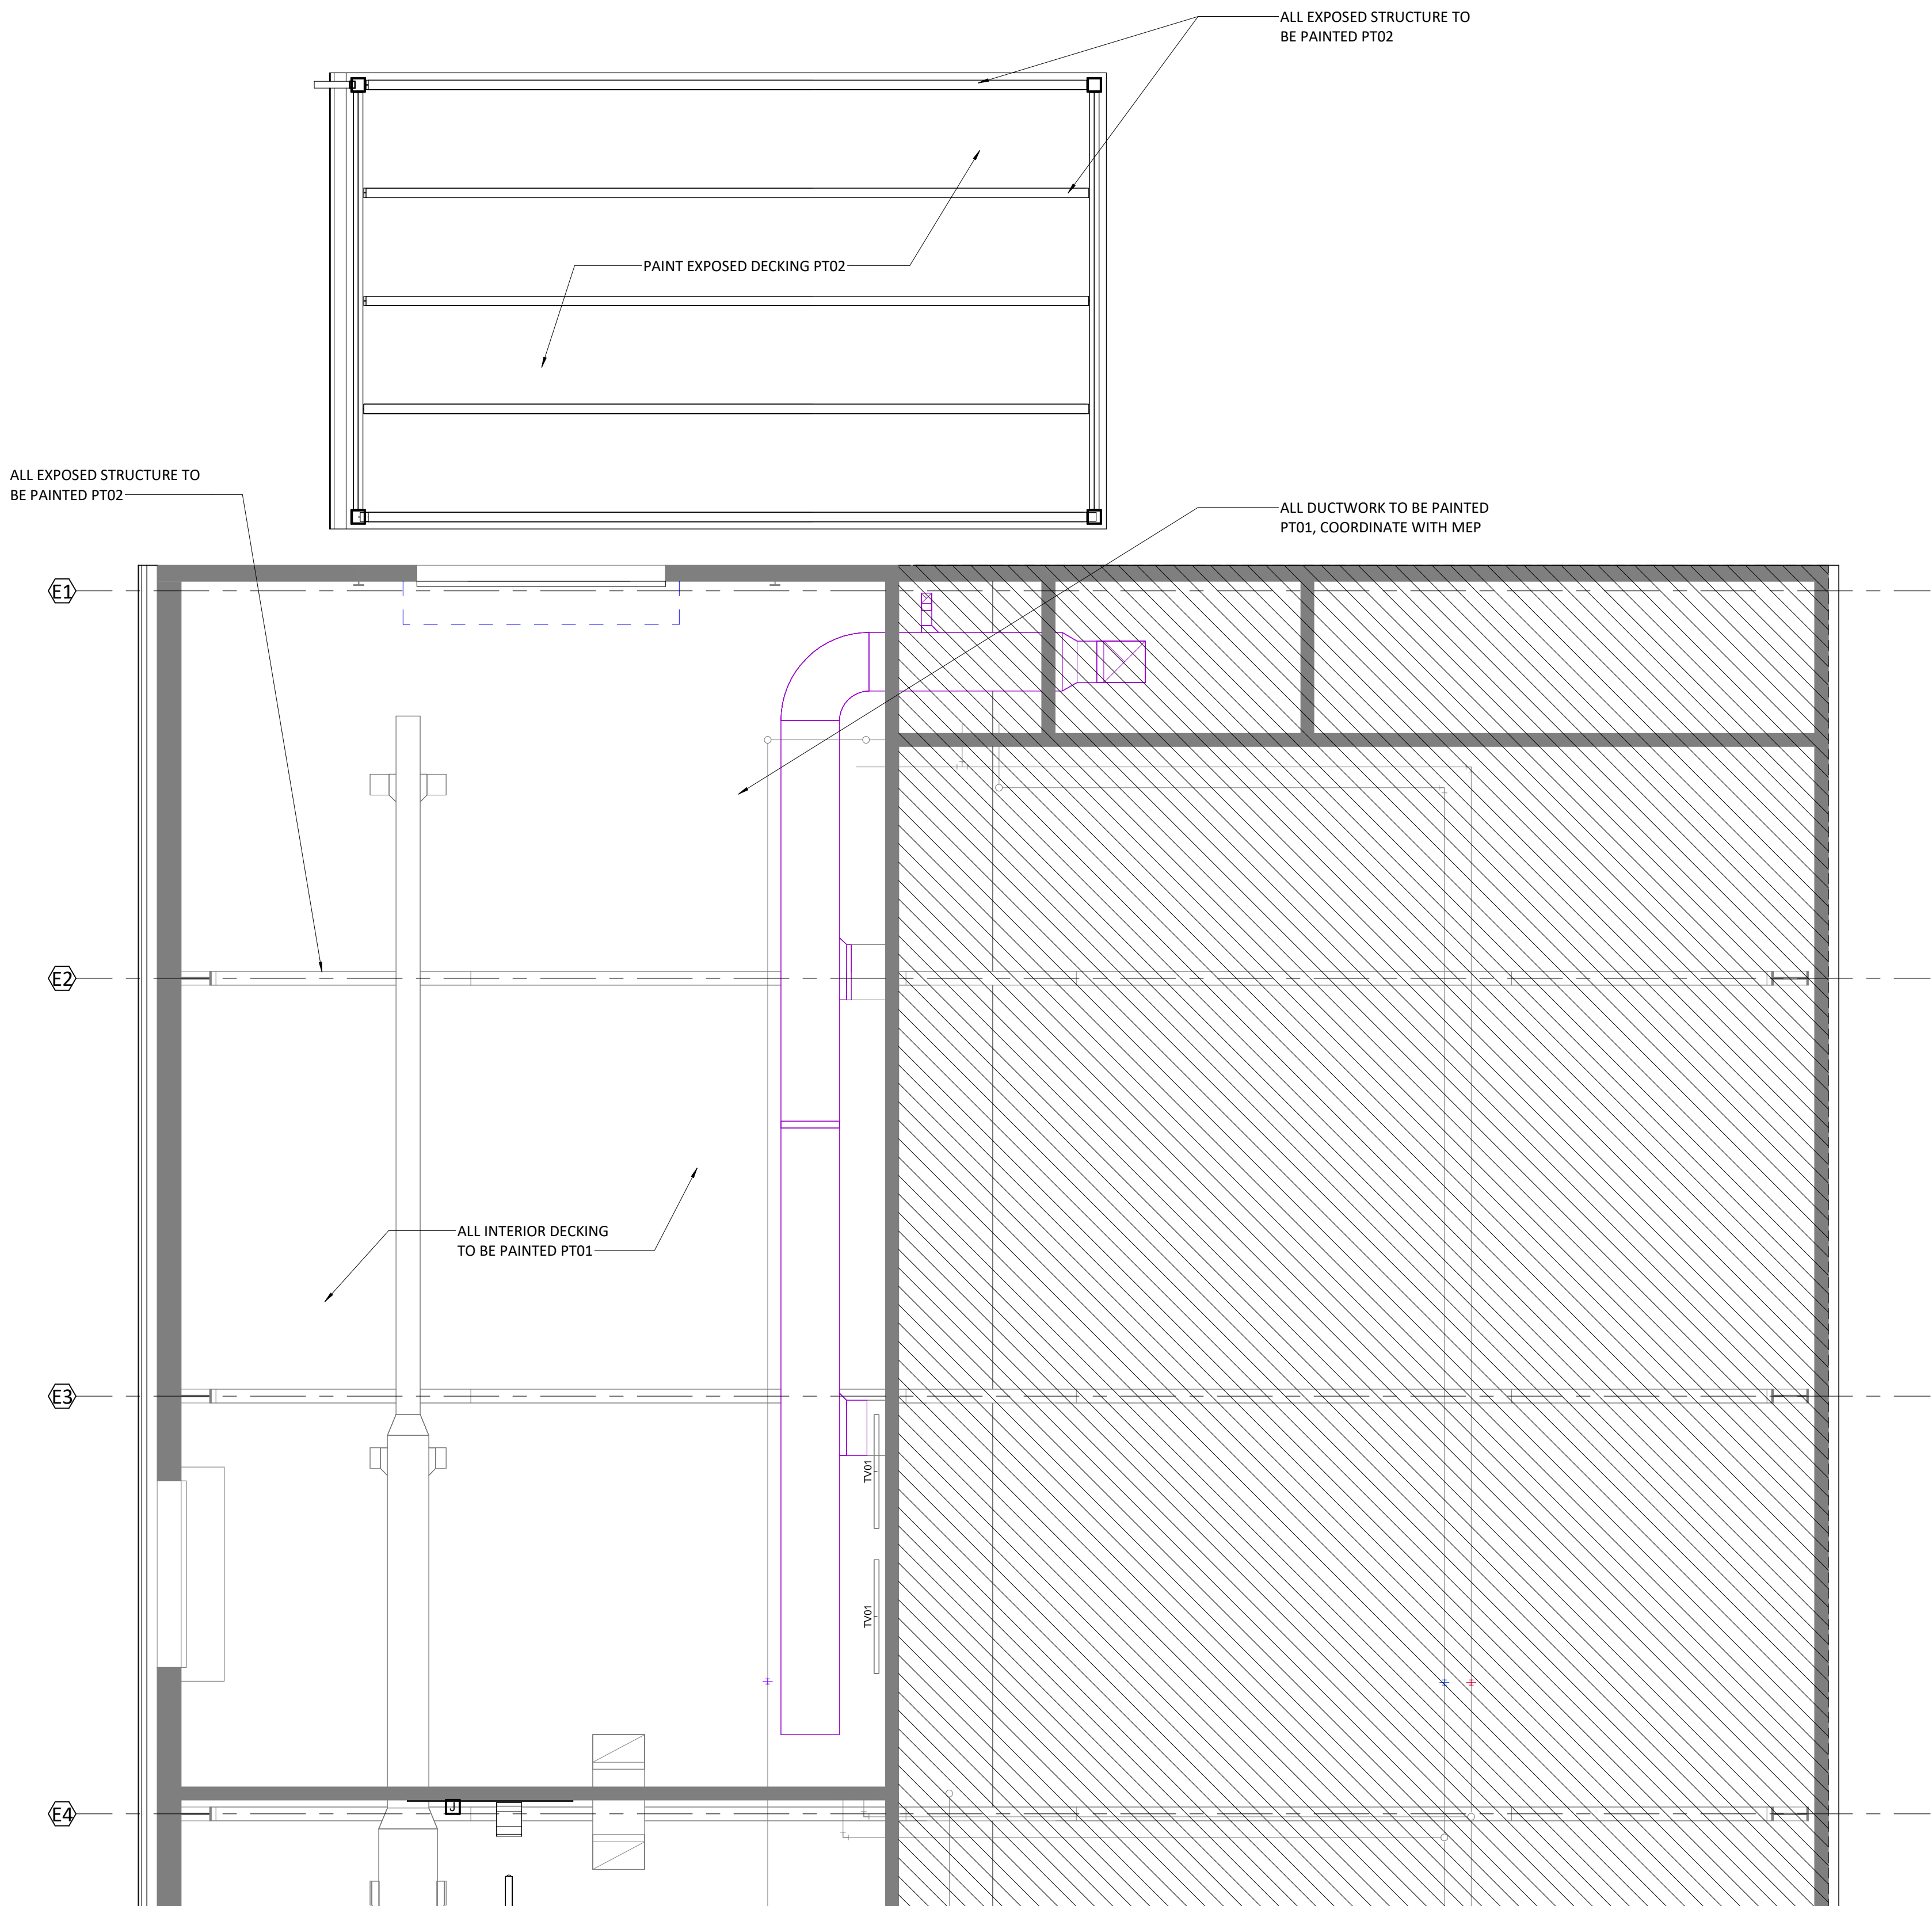

Reflected Ceiling Plan - GIC A1  
3/16" = 1'-0"



LSR7 Robotics, GiC &  
Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO  
64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO  
64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi-studio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com

structural engineer:  
Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/IT/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

Issue Date: September 9, 2022

Revisions

NUMBER	DESCRIPTION	DATE
--------	-------------	------

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS  
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR  
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



Reflected Ceiling Plan -  
Building E

A152-C

Reflected Ceiling Plan - Building E A1  
3/16" = 1'-0"



LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100


owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086  
multistudio

architect: Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multistudio


civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kvenrg.com

structural engineer: Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com


MEP/PT/Code: Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

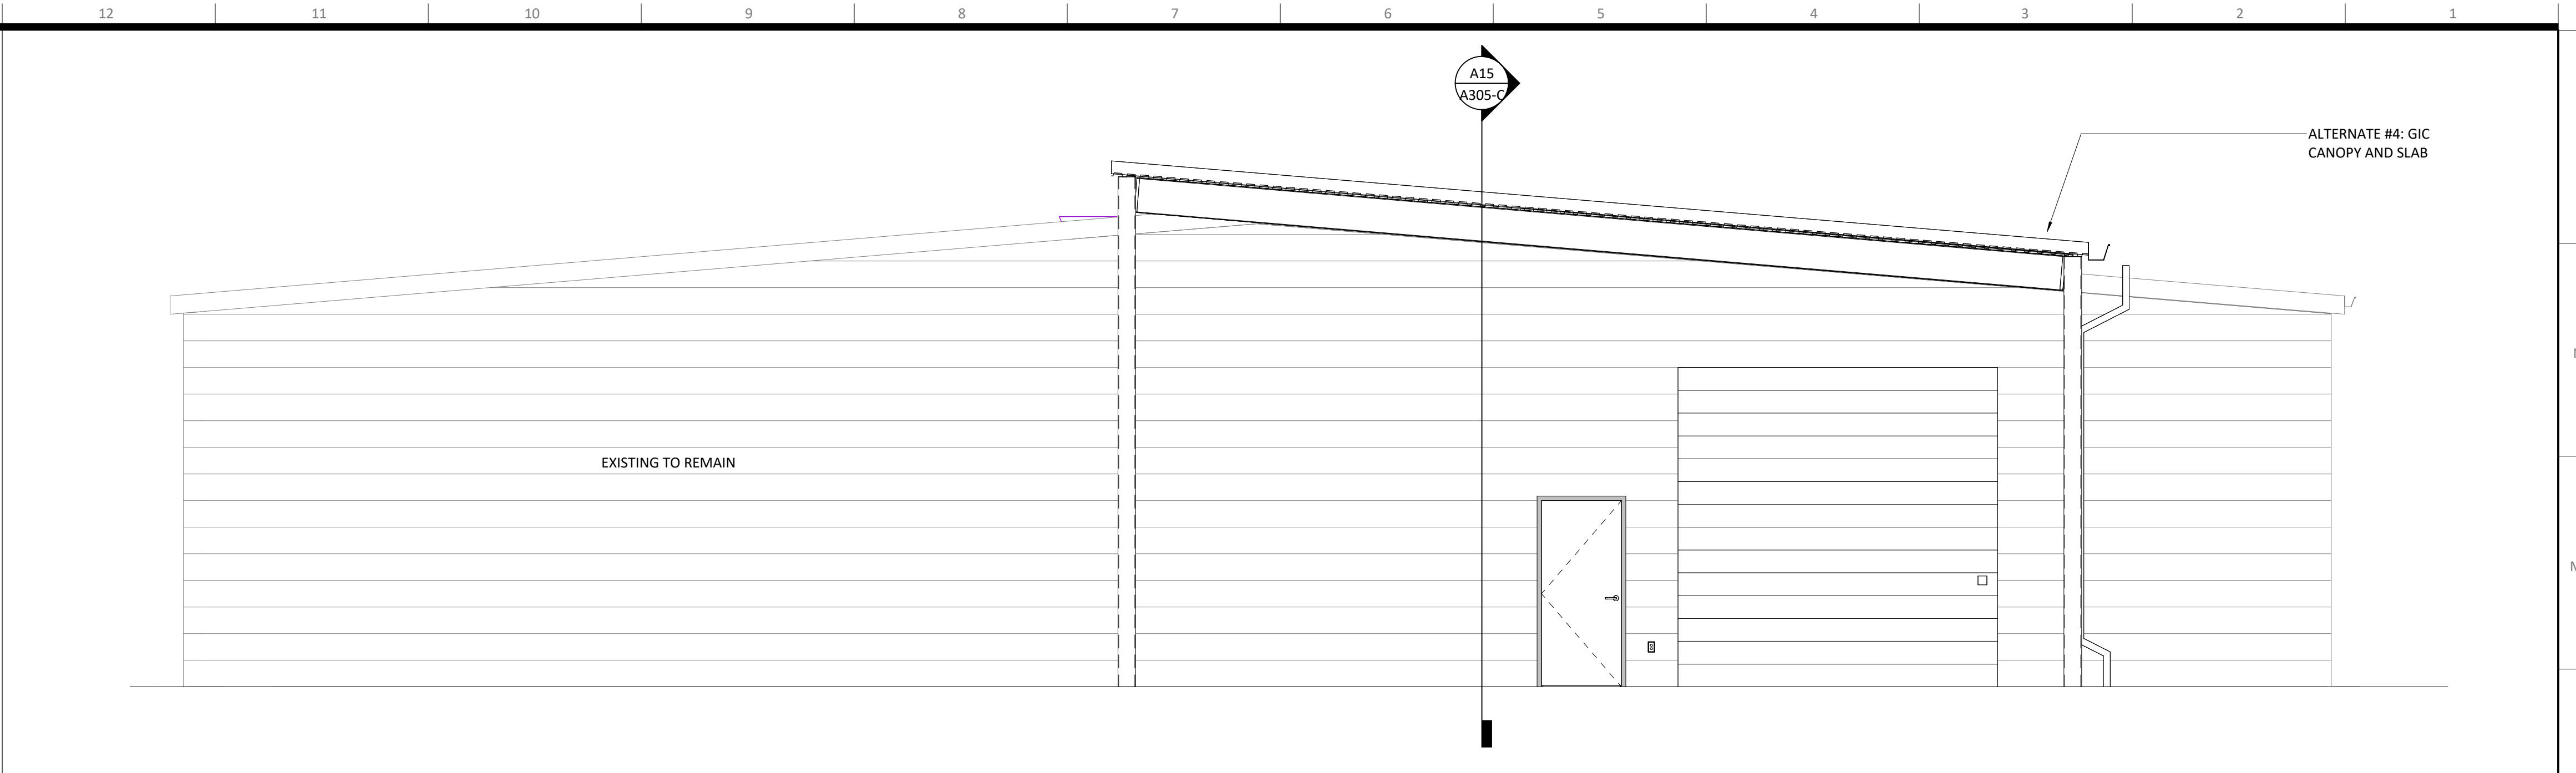

Building E - LSHS - North Elevation L1  
1/4" = 1'-0"

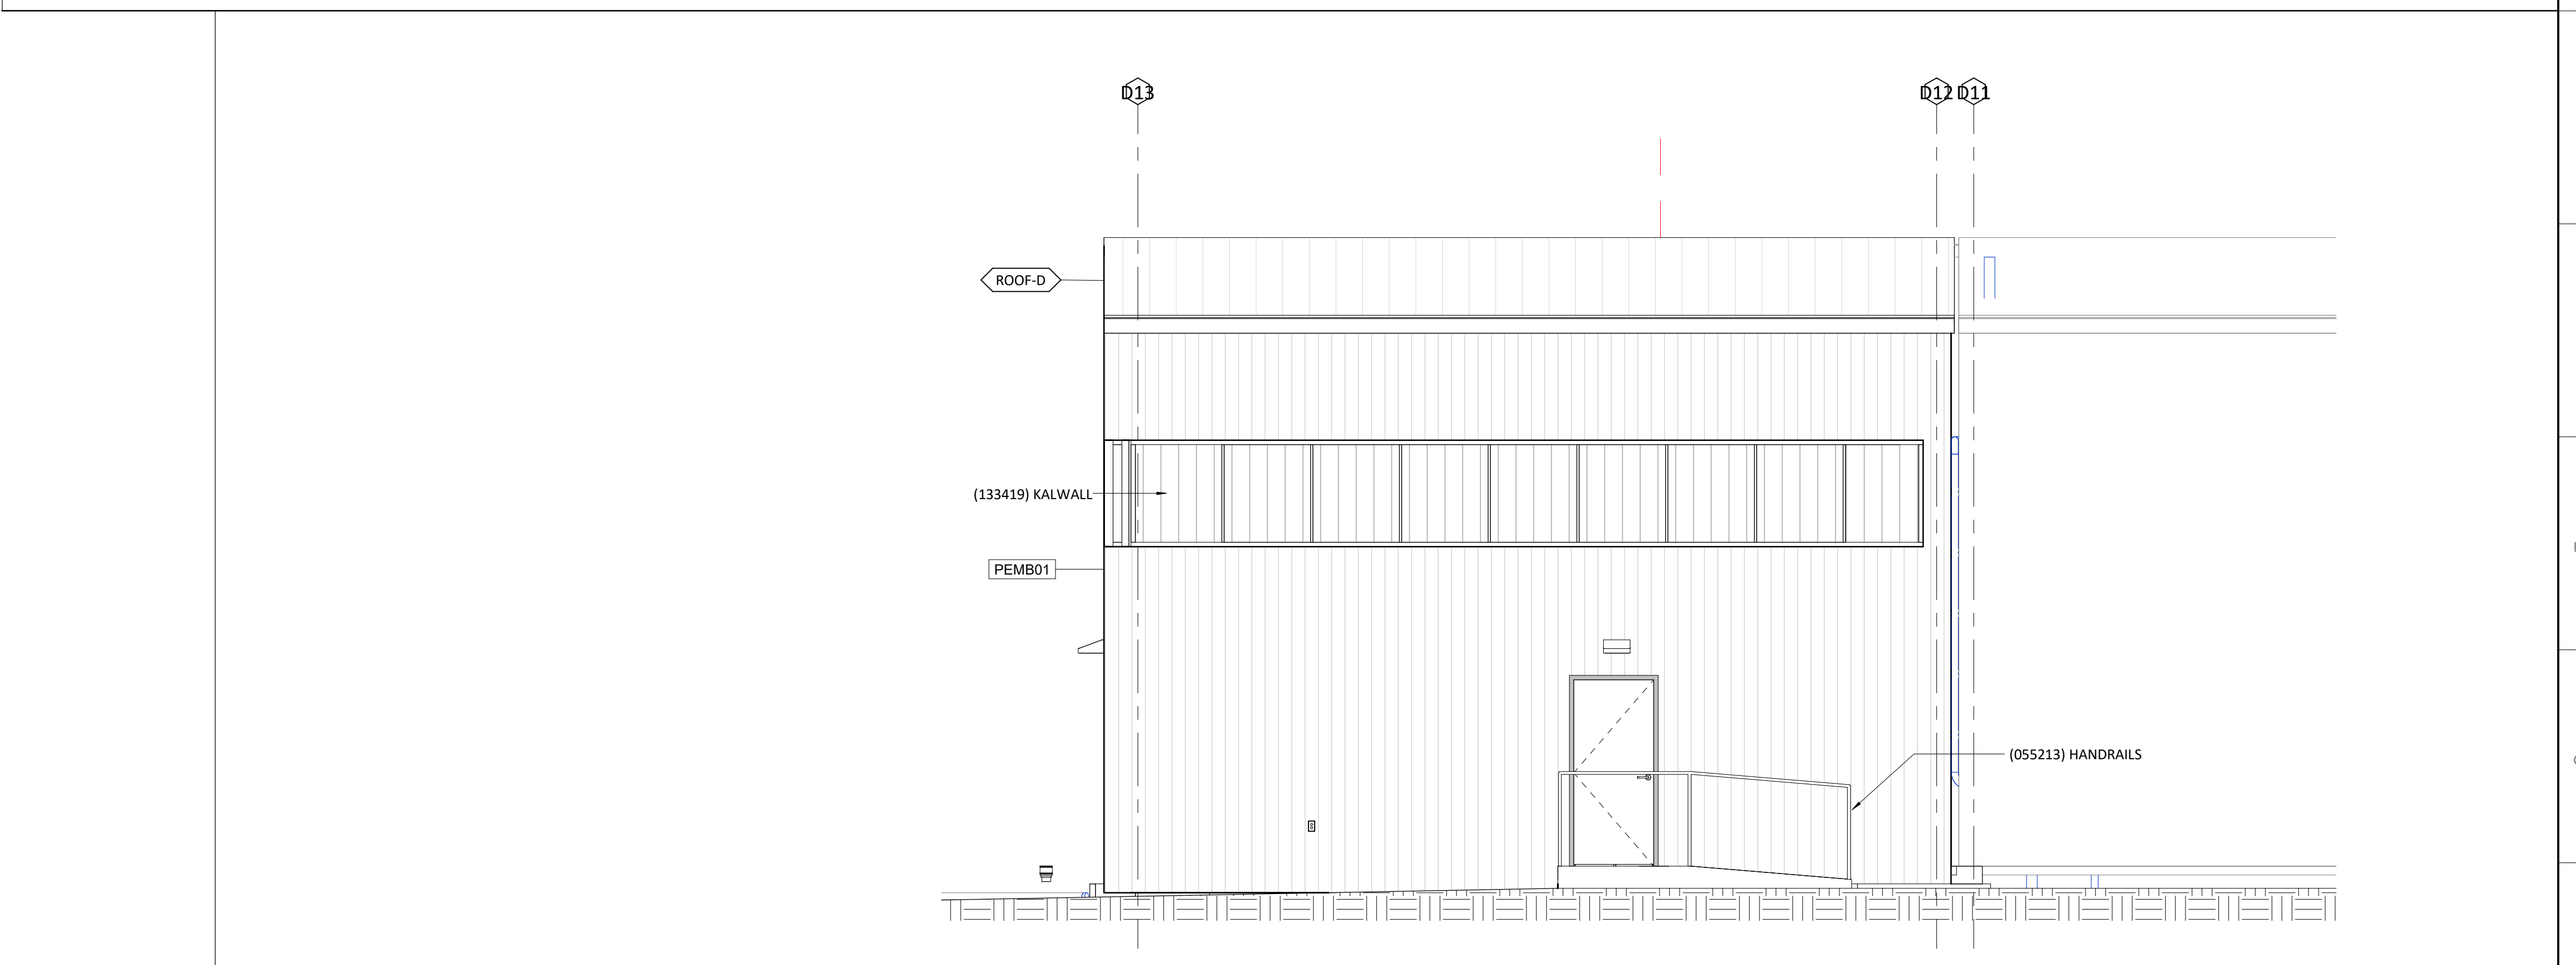

Building D - LSHS - East Elevation F1  
1/4" = 1'-0"

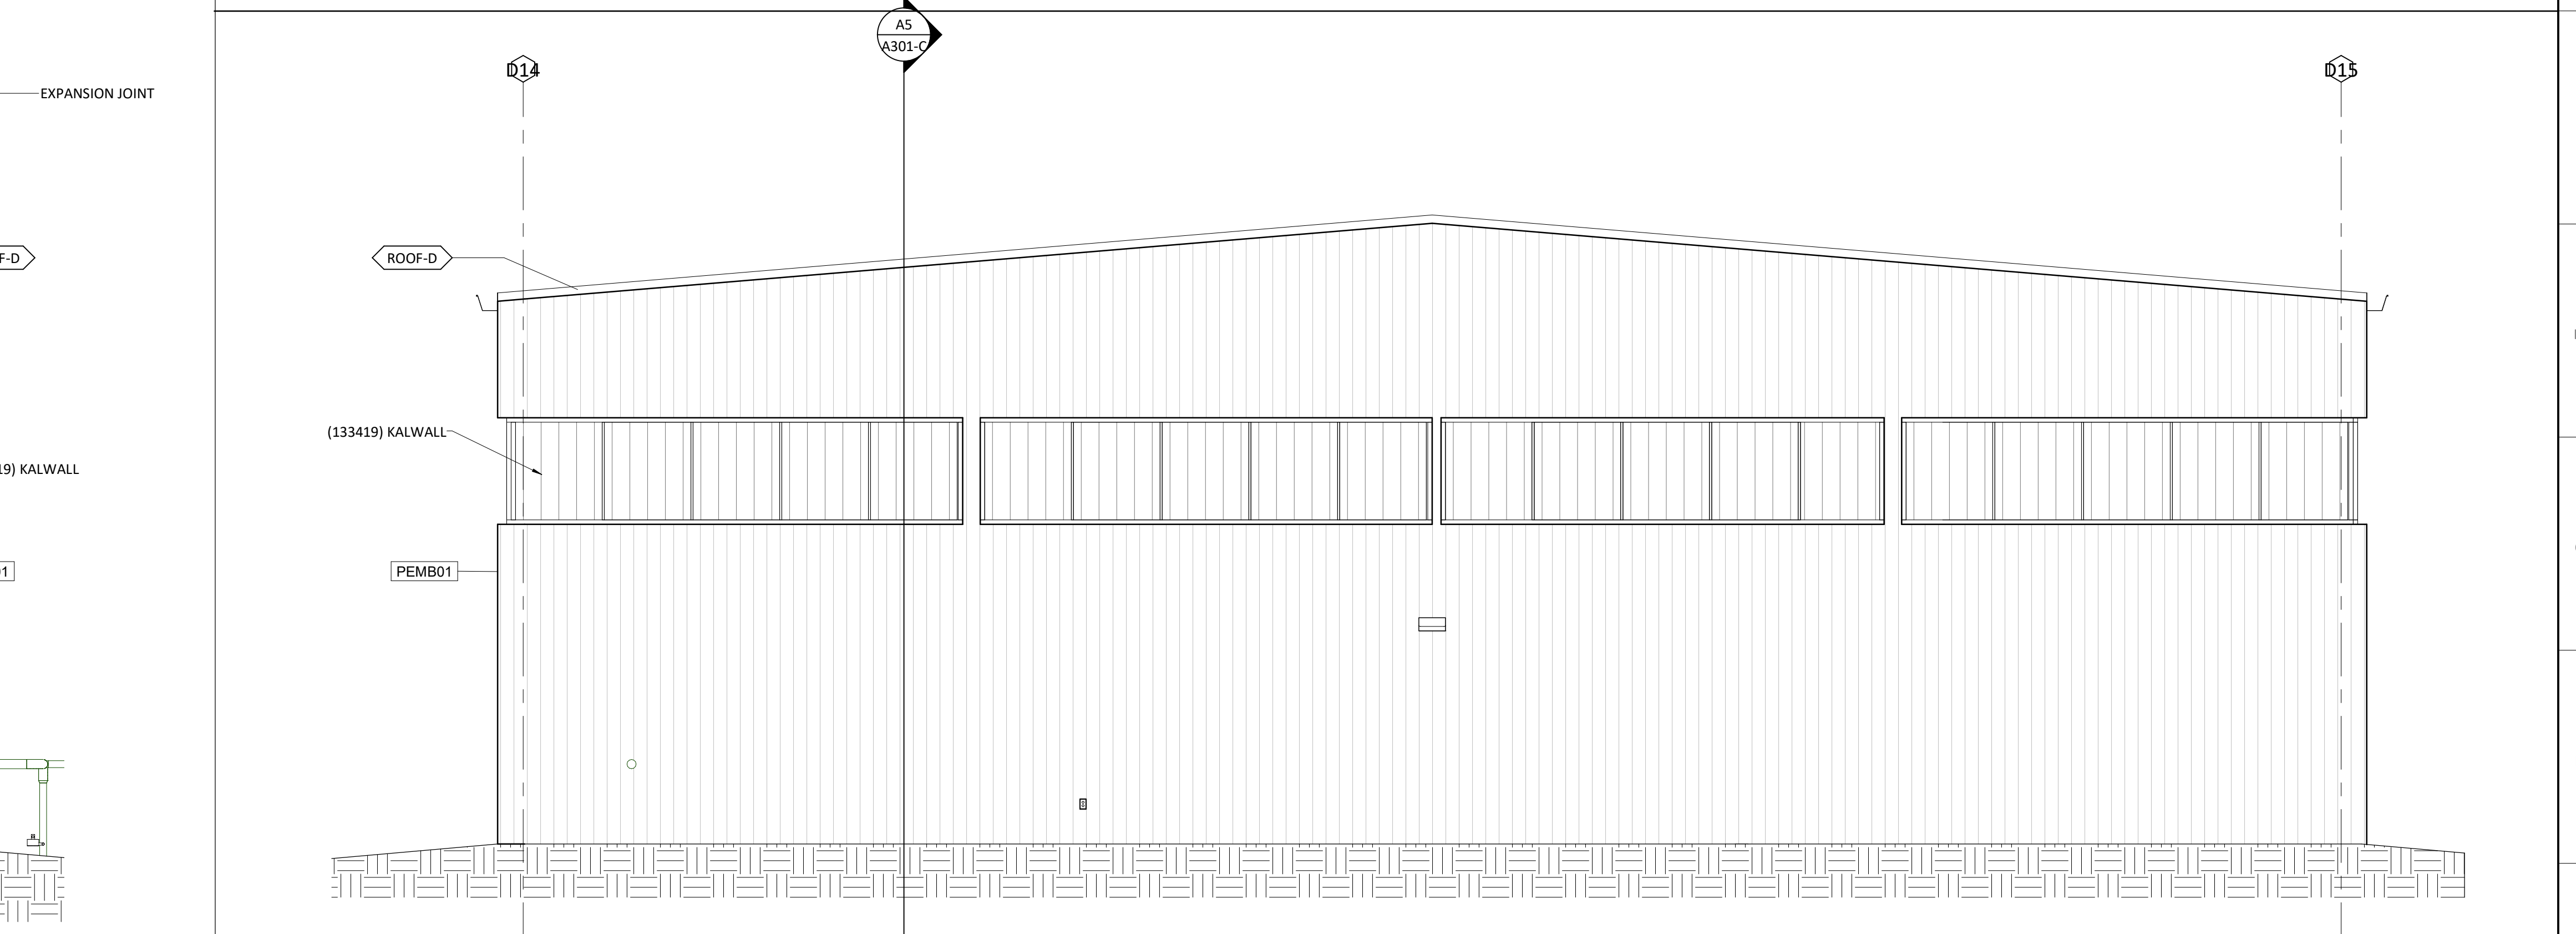

Building D - LSHS - South Elevation A1  
1/4" = 1'-0"



Building D - LSHS - West Elevation A12  
1/4" = 1'-0"




Issue Date: September 9, 2022

Revisions

NUMBER	DESCRIPTION	DATE
--------	-------------	------



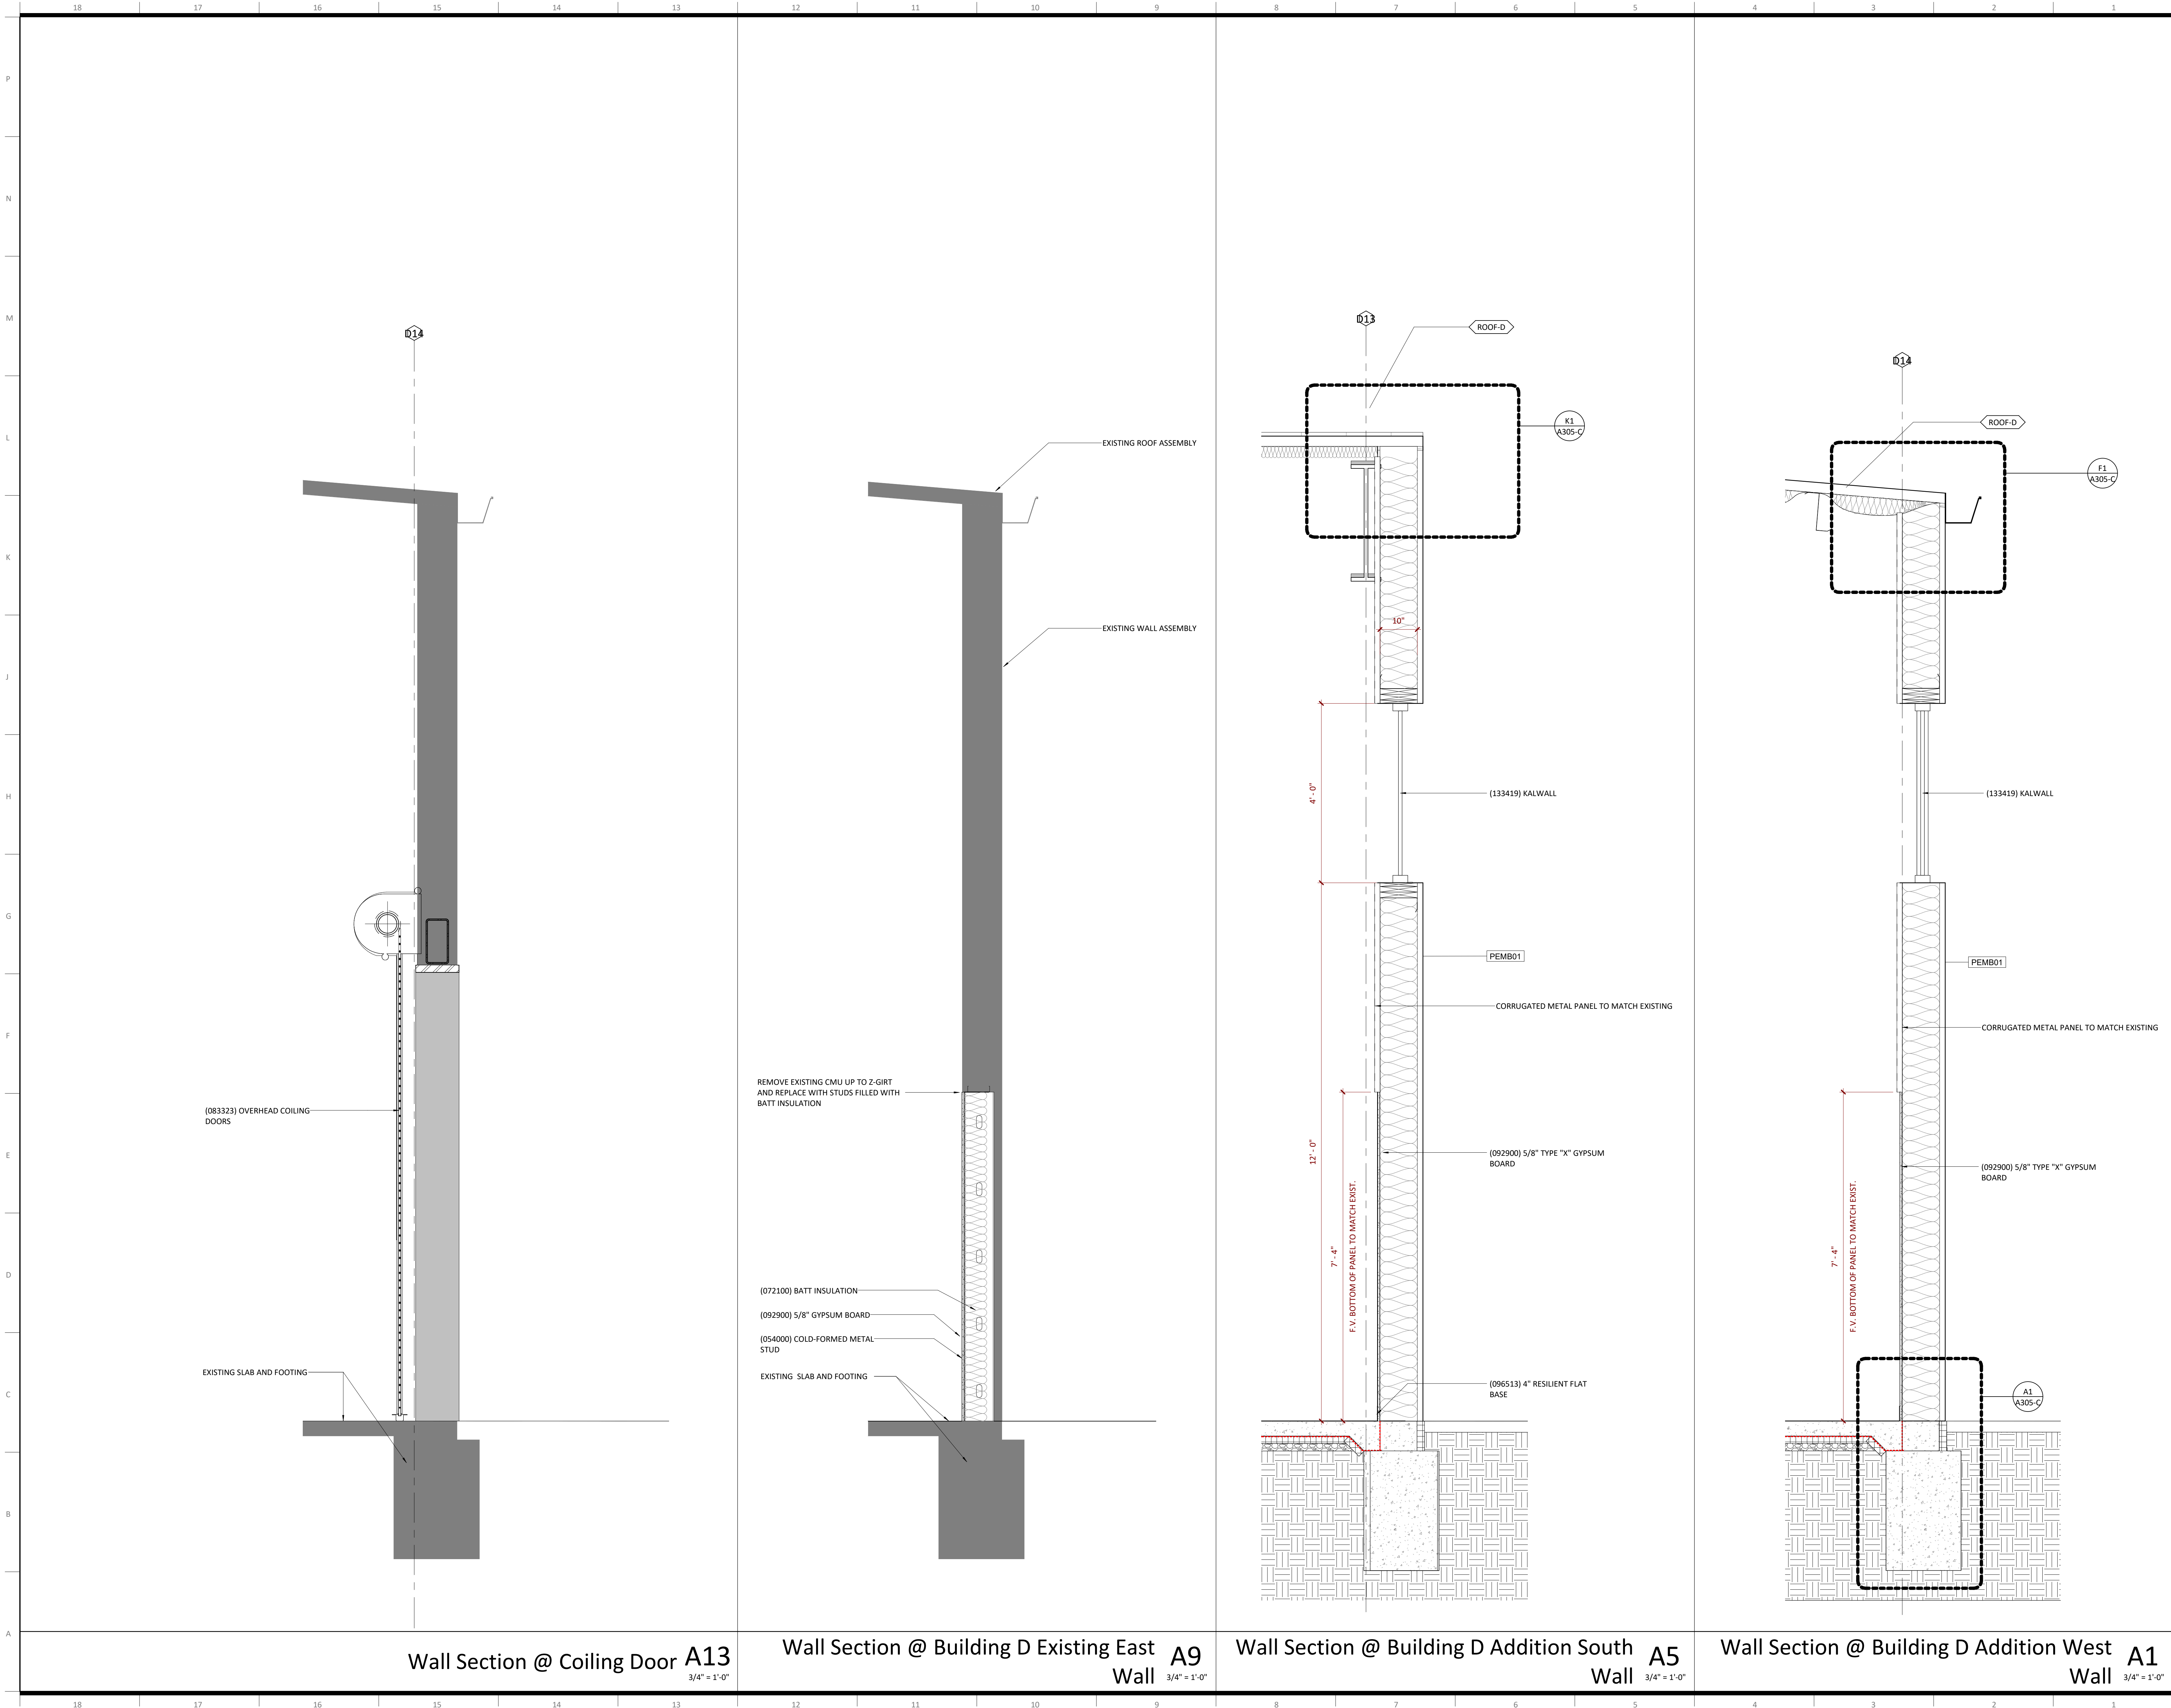

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100

owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086  
multi-studio

architect: Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi-studio

civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kvang.com

structural engineer: Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/IT/Code: Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

Issue Date: September 9, 2022

Revisions

NUMBER	DESCRIPTION	DATE
--------	-------------	------

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION






LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063


Project Number: 0121-0100

owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086  
architect: Multistudio  
4300 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multistudio  
civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveeng.com  
structural engineer: Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com


MEP/FCode: Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

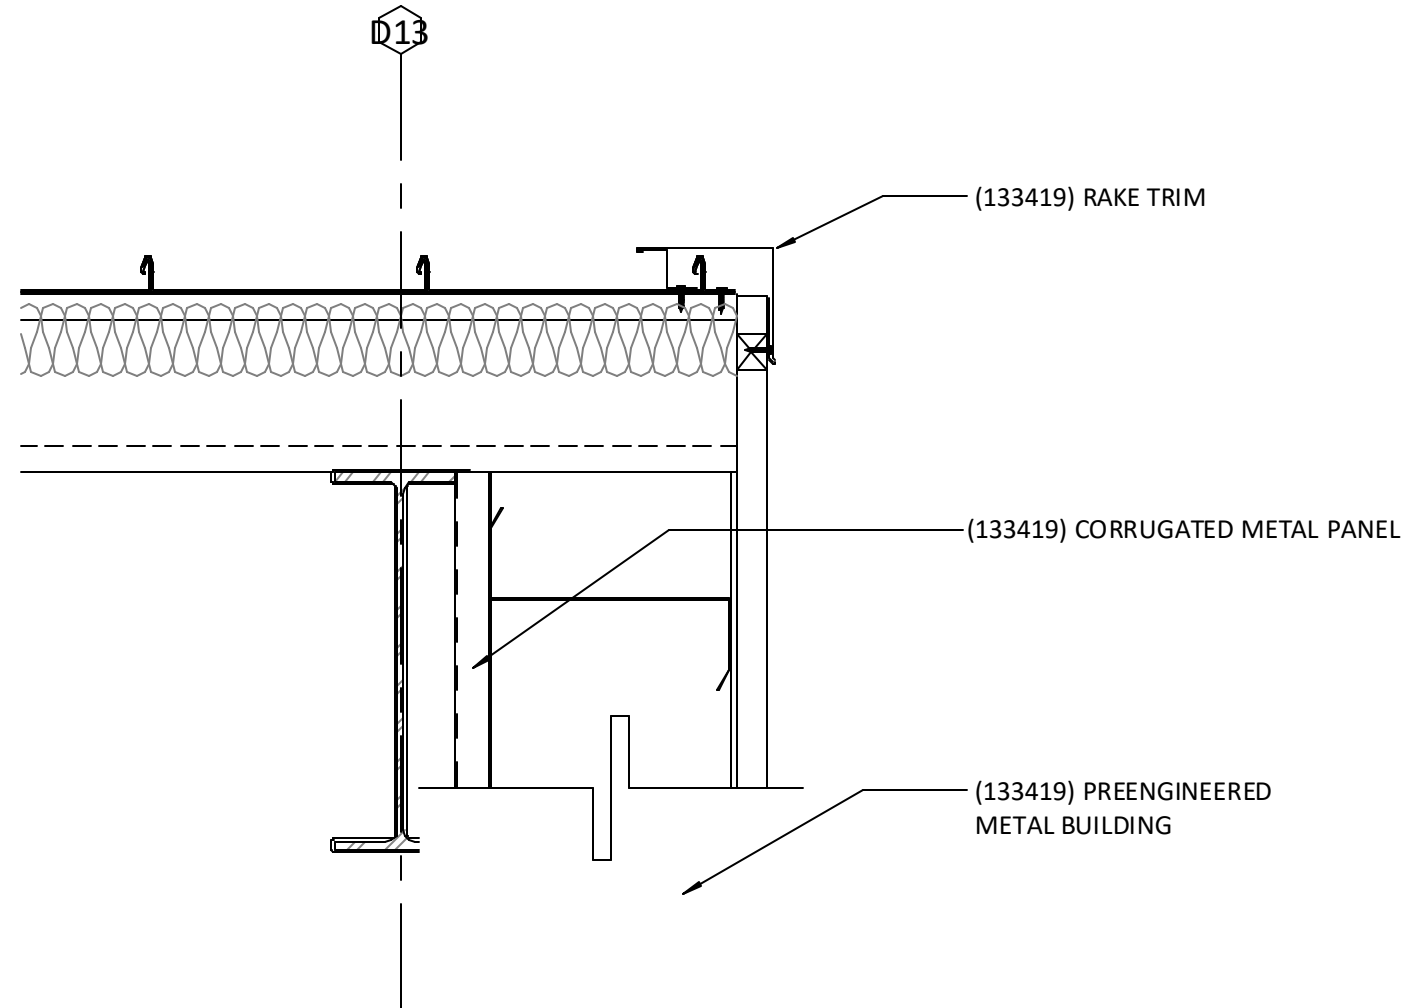


Section Detail @ PEMB Rake K1  
1 1/2" = 1'-0"

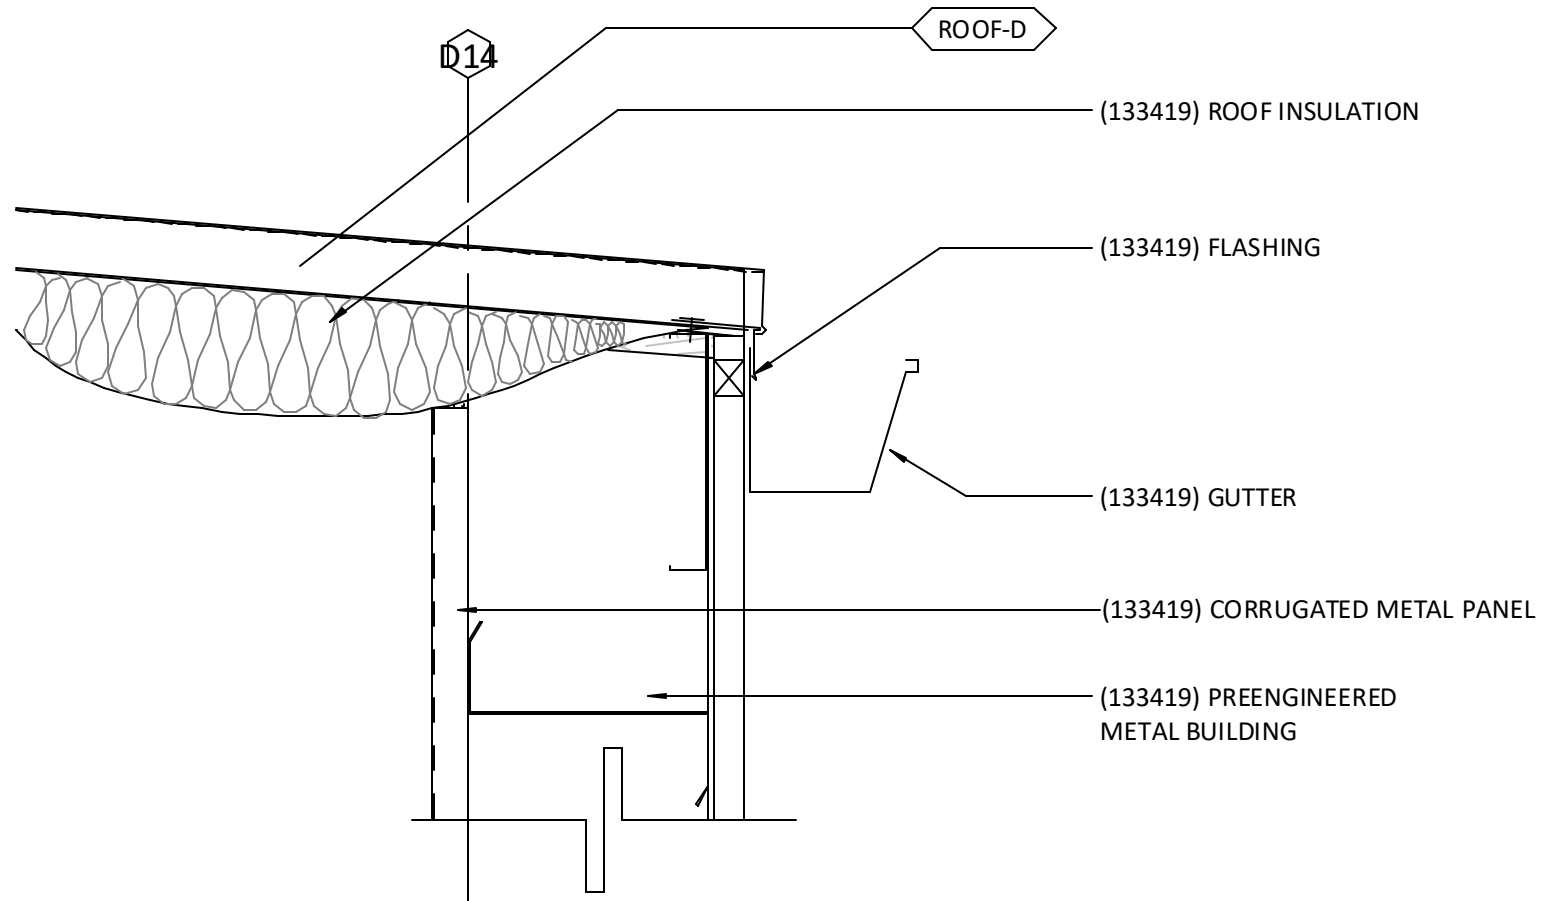


Section Detail @ PEMB Gutter F1  
1 1/2" = 1'-0"

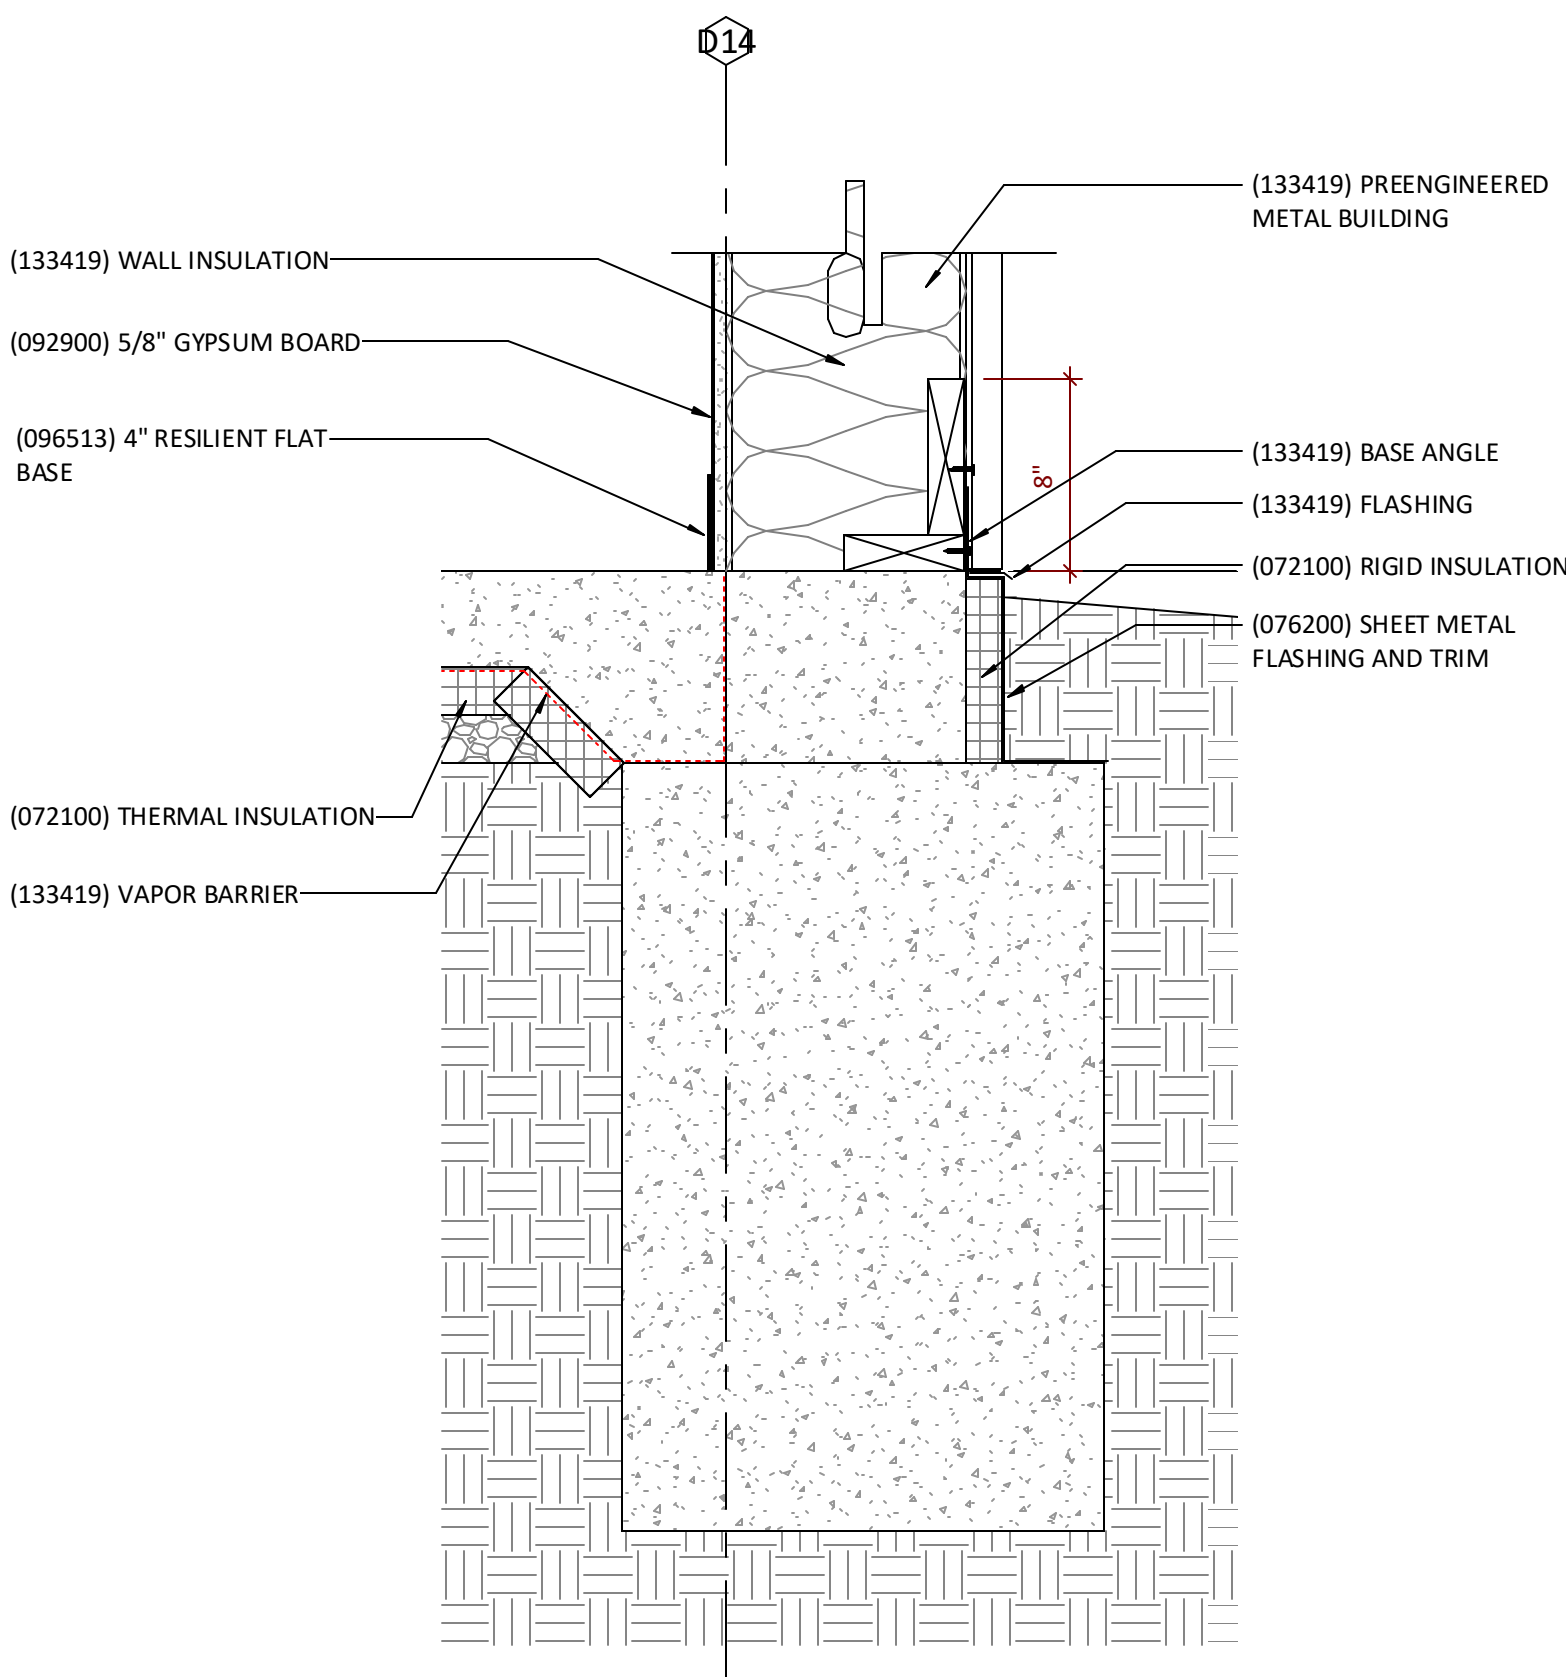


Foundation Detail @ PEMB01 A1  
1 1/2" = 1'-0"

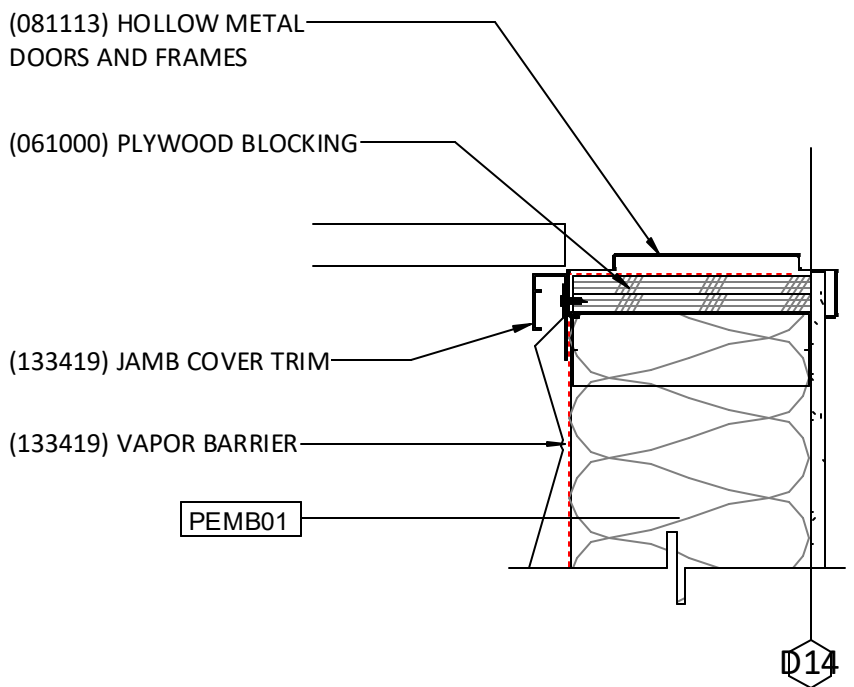


Plan Detail @ PEMB Door Jamb J11  
1 1/2" = 1'-0"

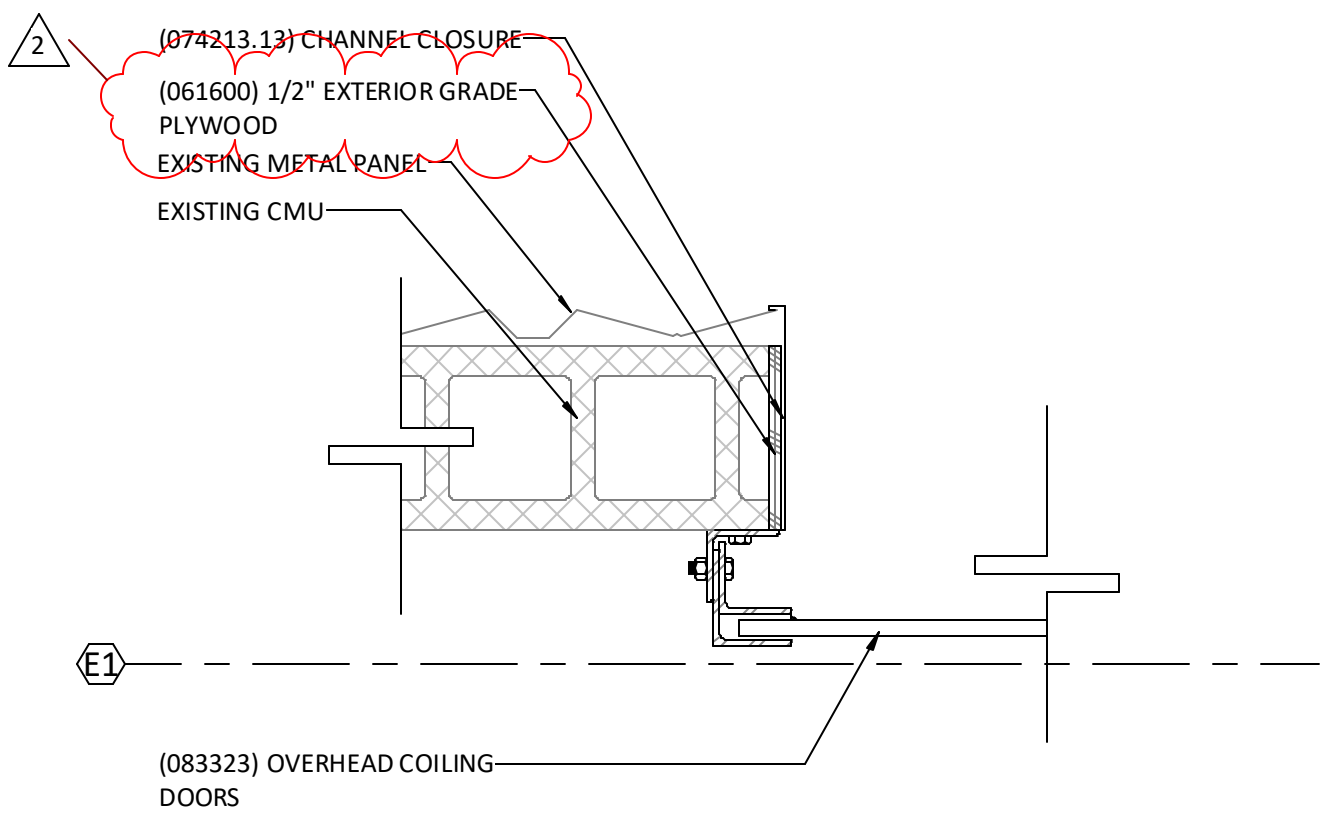


Plan Detail @ GIC Garage Door E11  
1 1/2" = 1'-0"

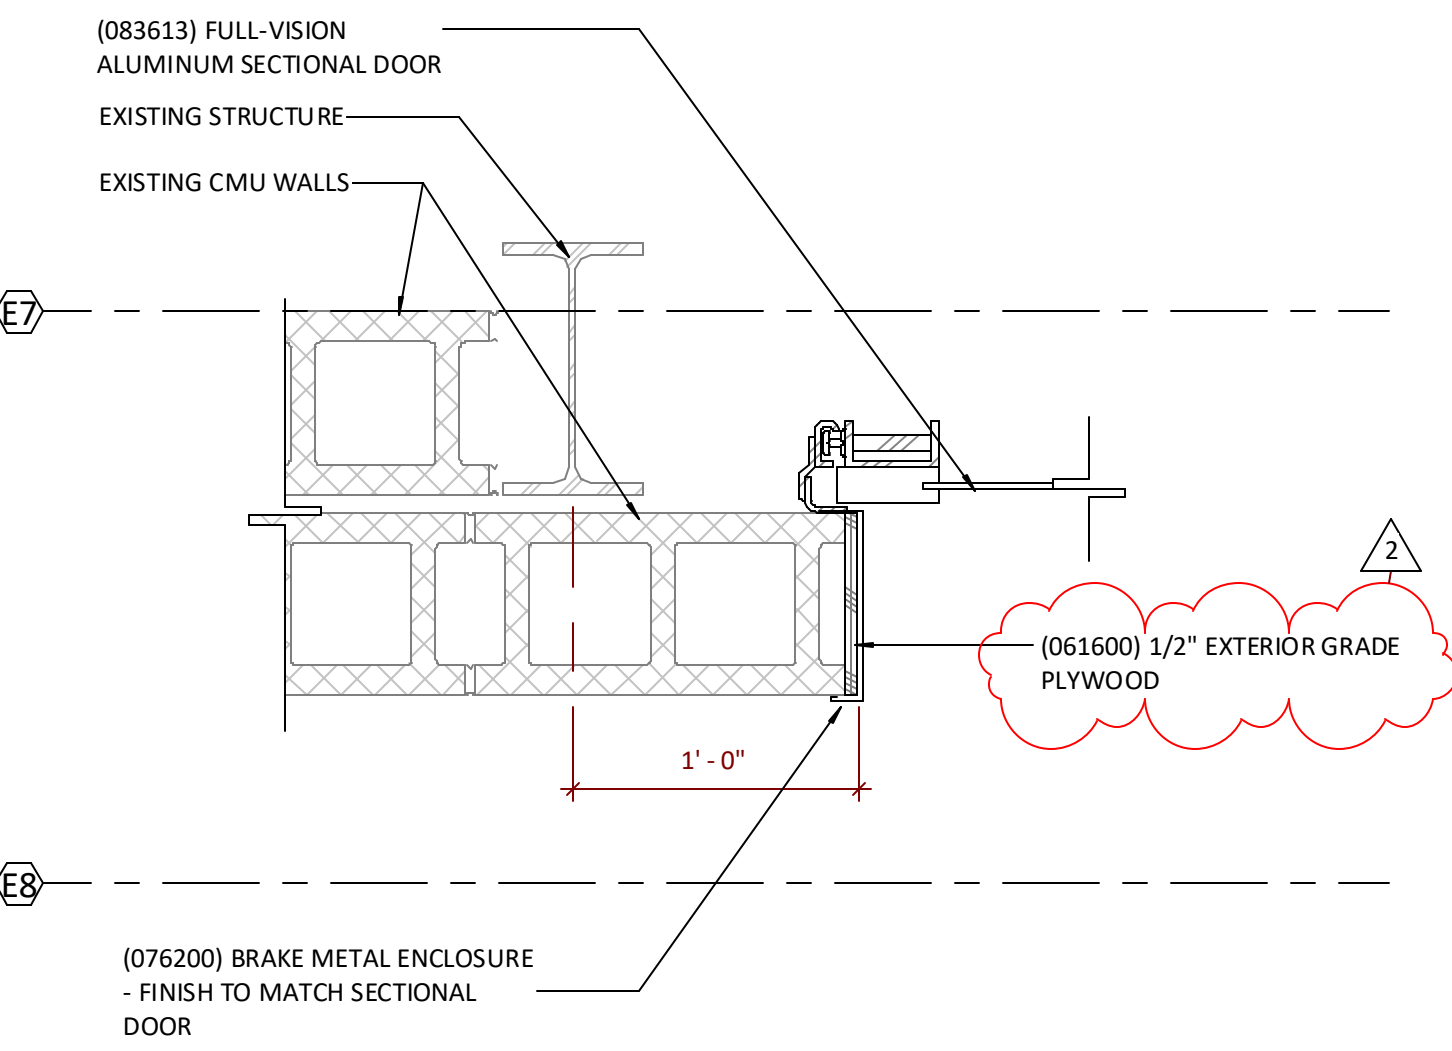


Plan Detail @ Weight Room Garage Door A11  
1 1/2" = 1'-0"

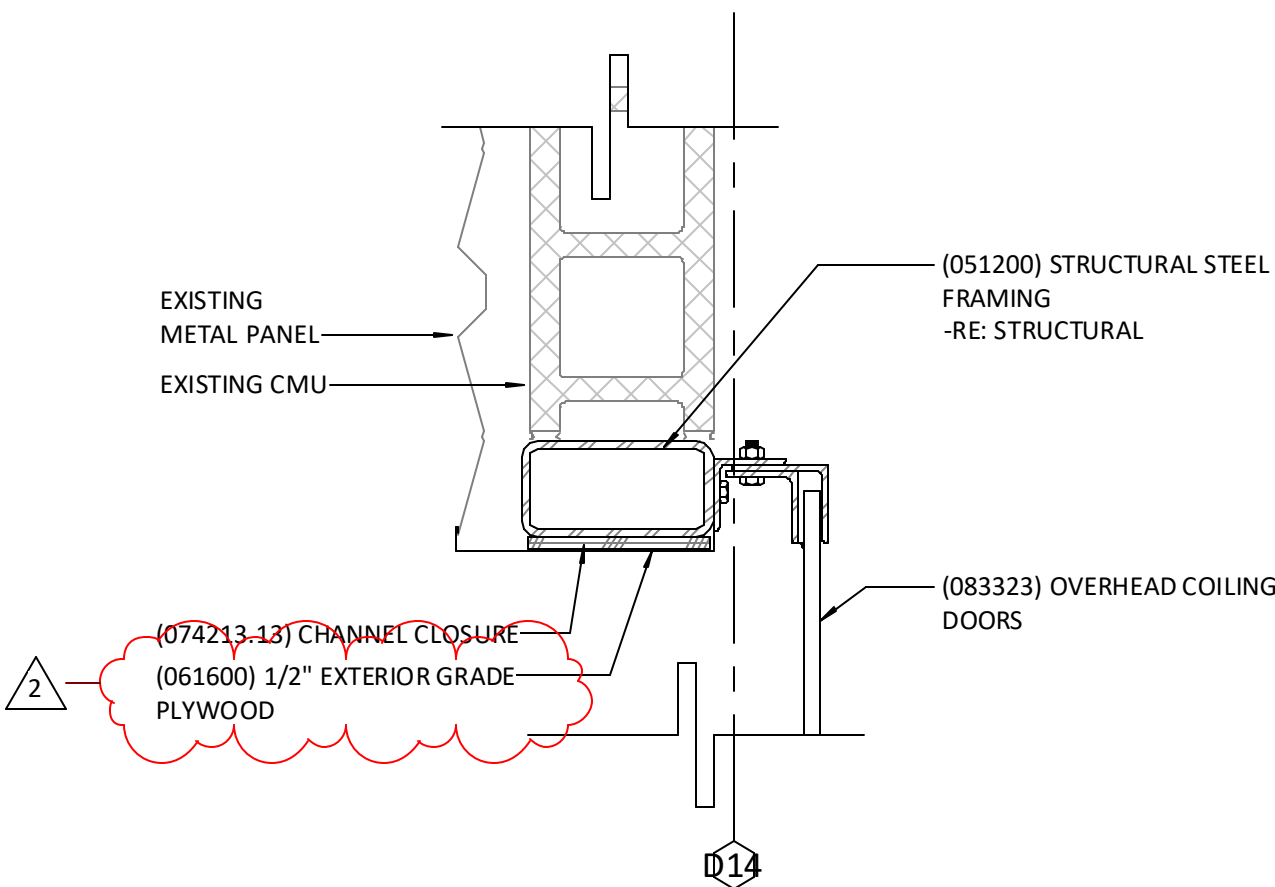


Plan Detail @ Building D Coiling Door E6  
1 1/2" = 1'-0"

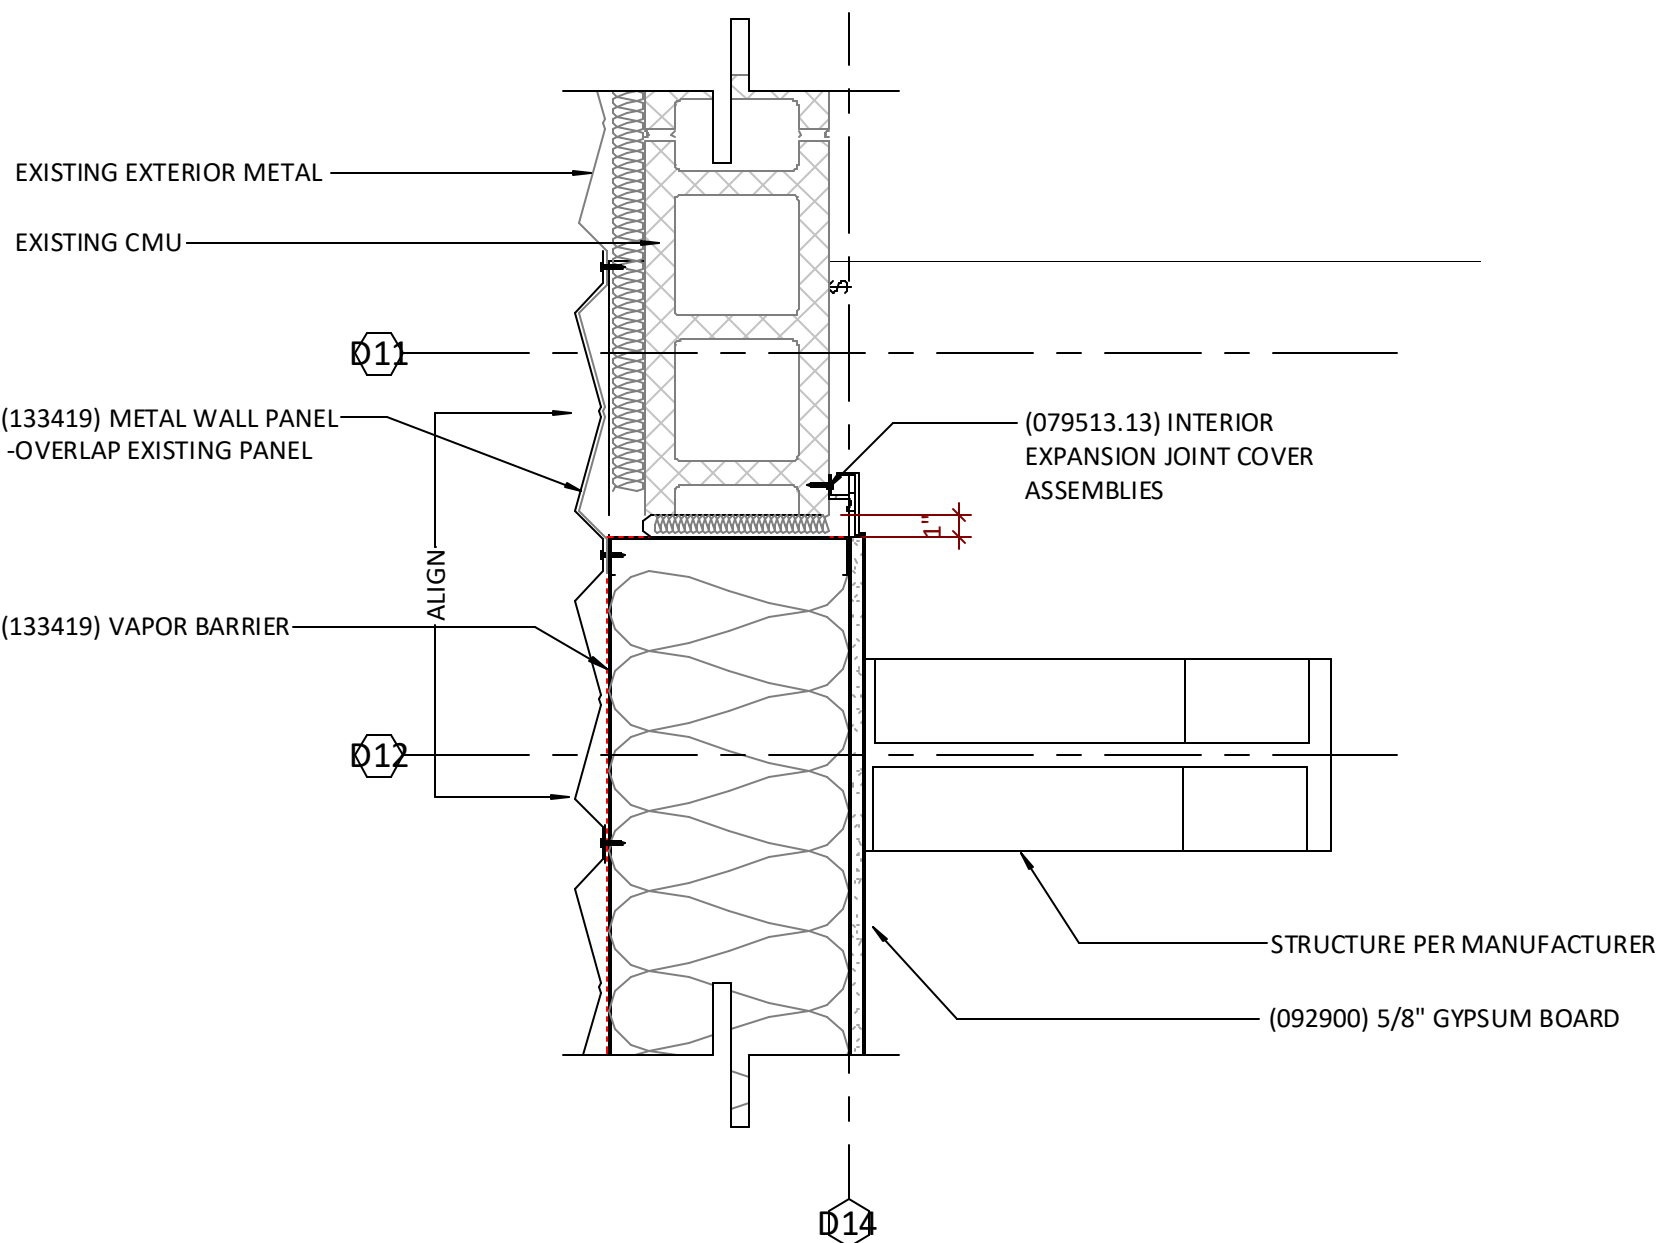

Plan Detail @ Building D Addition A6  
1 1/2" = 1'-0"

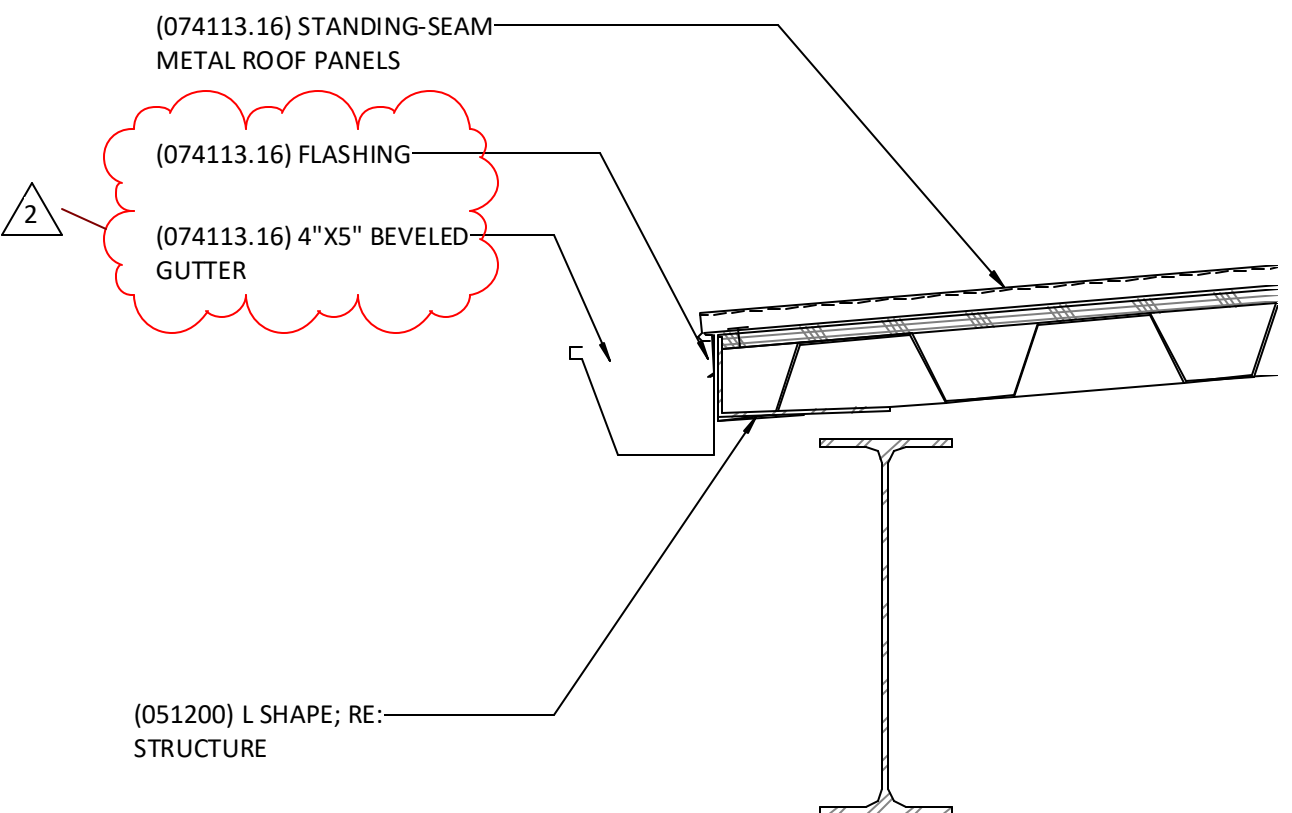

Section Detail @ Canopy Gutter E15  
1 1/2" = 1'-0"

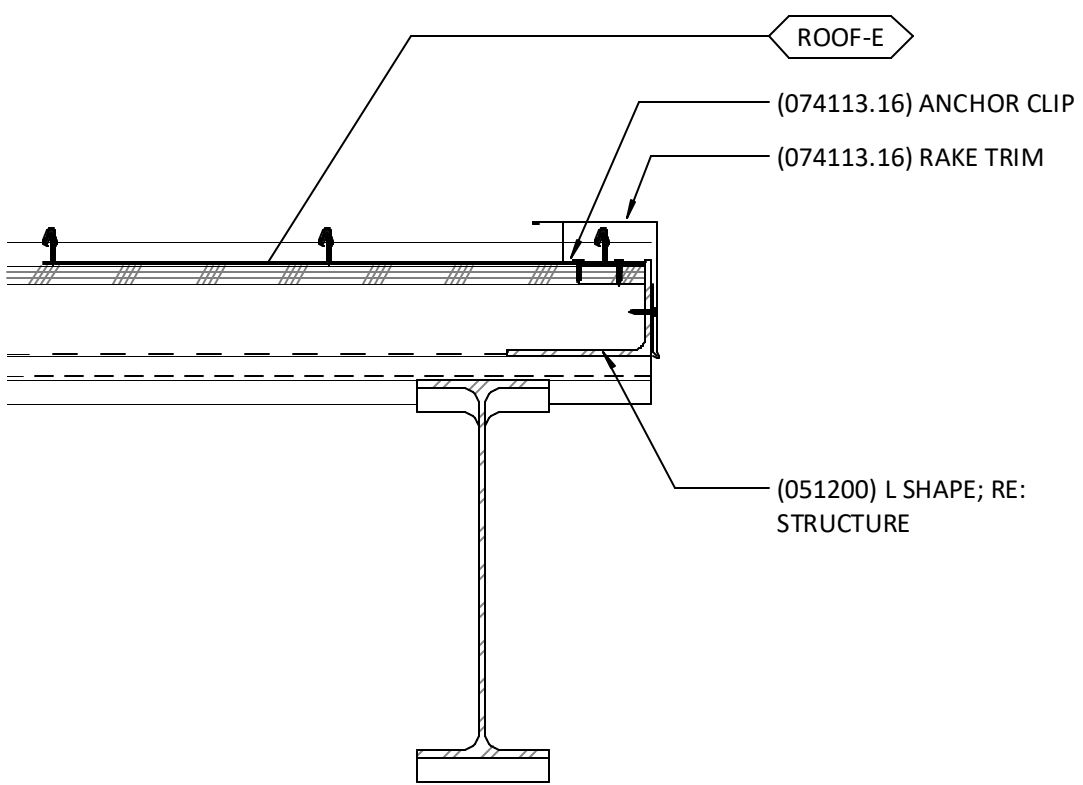

Section Detail @ Canopy A15  
1 1/2" = 1'-0"



LSR7 Robotics, GiC &  
Phys Education


LSN: 901 NE Douglas St., Lee's Summit MO  
64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO  
64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100


owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086  
architect: Multistudio  
4300 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multistudio

civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kvang.com  
structural engineer: Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com


MEP/IT Code: Henderson Engineers  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

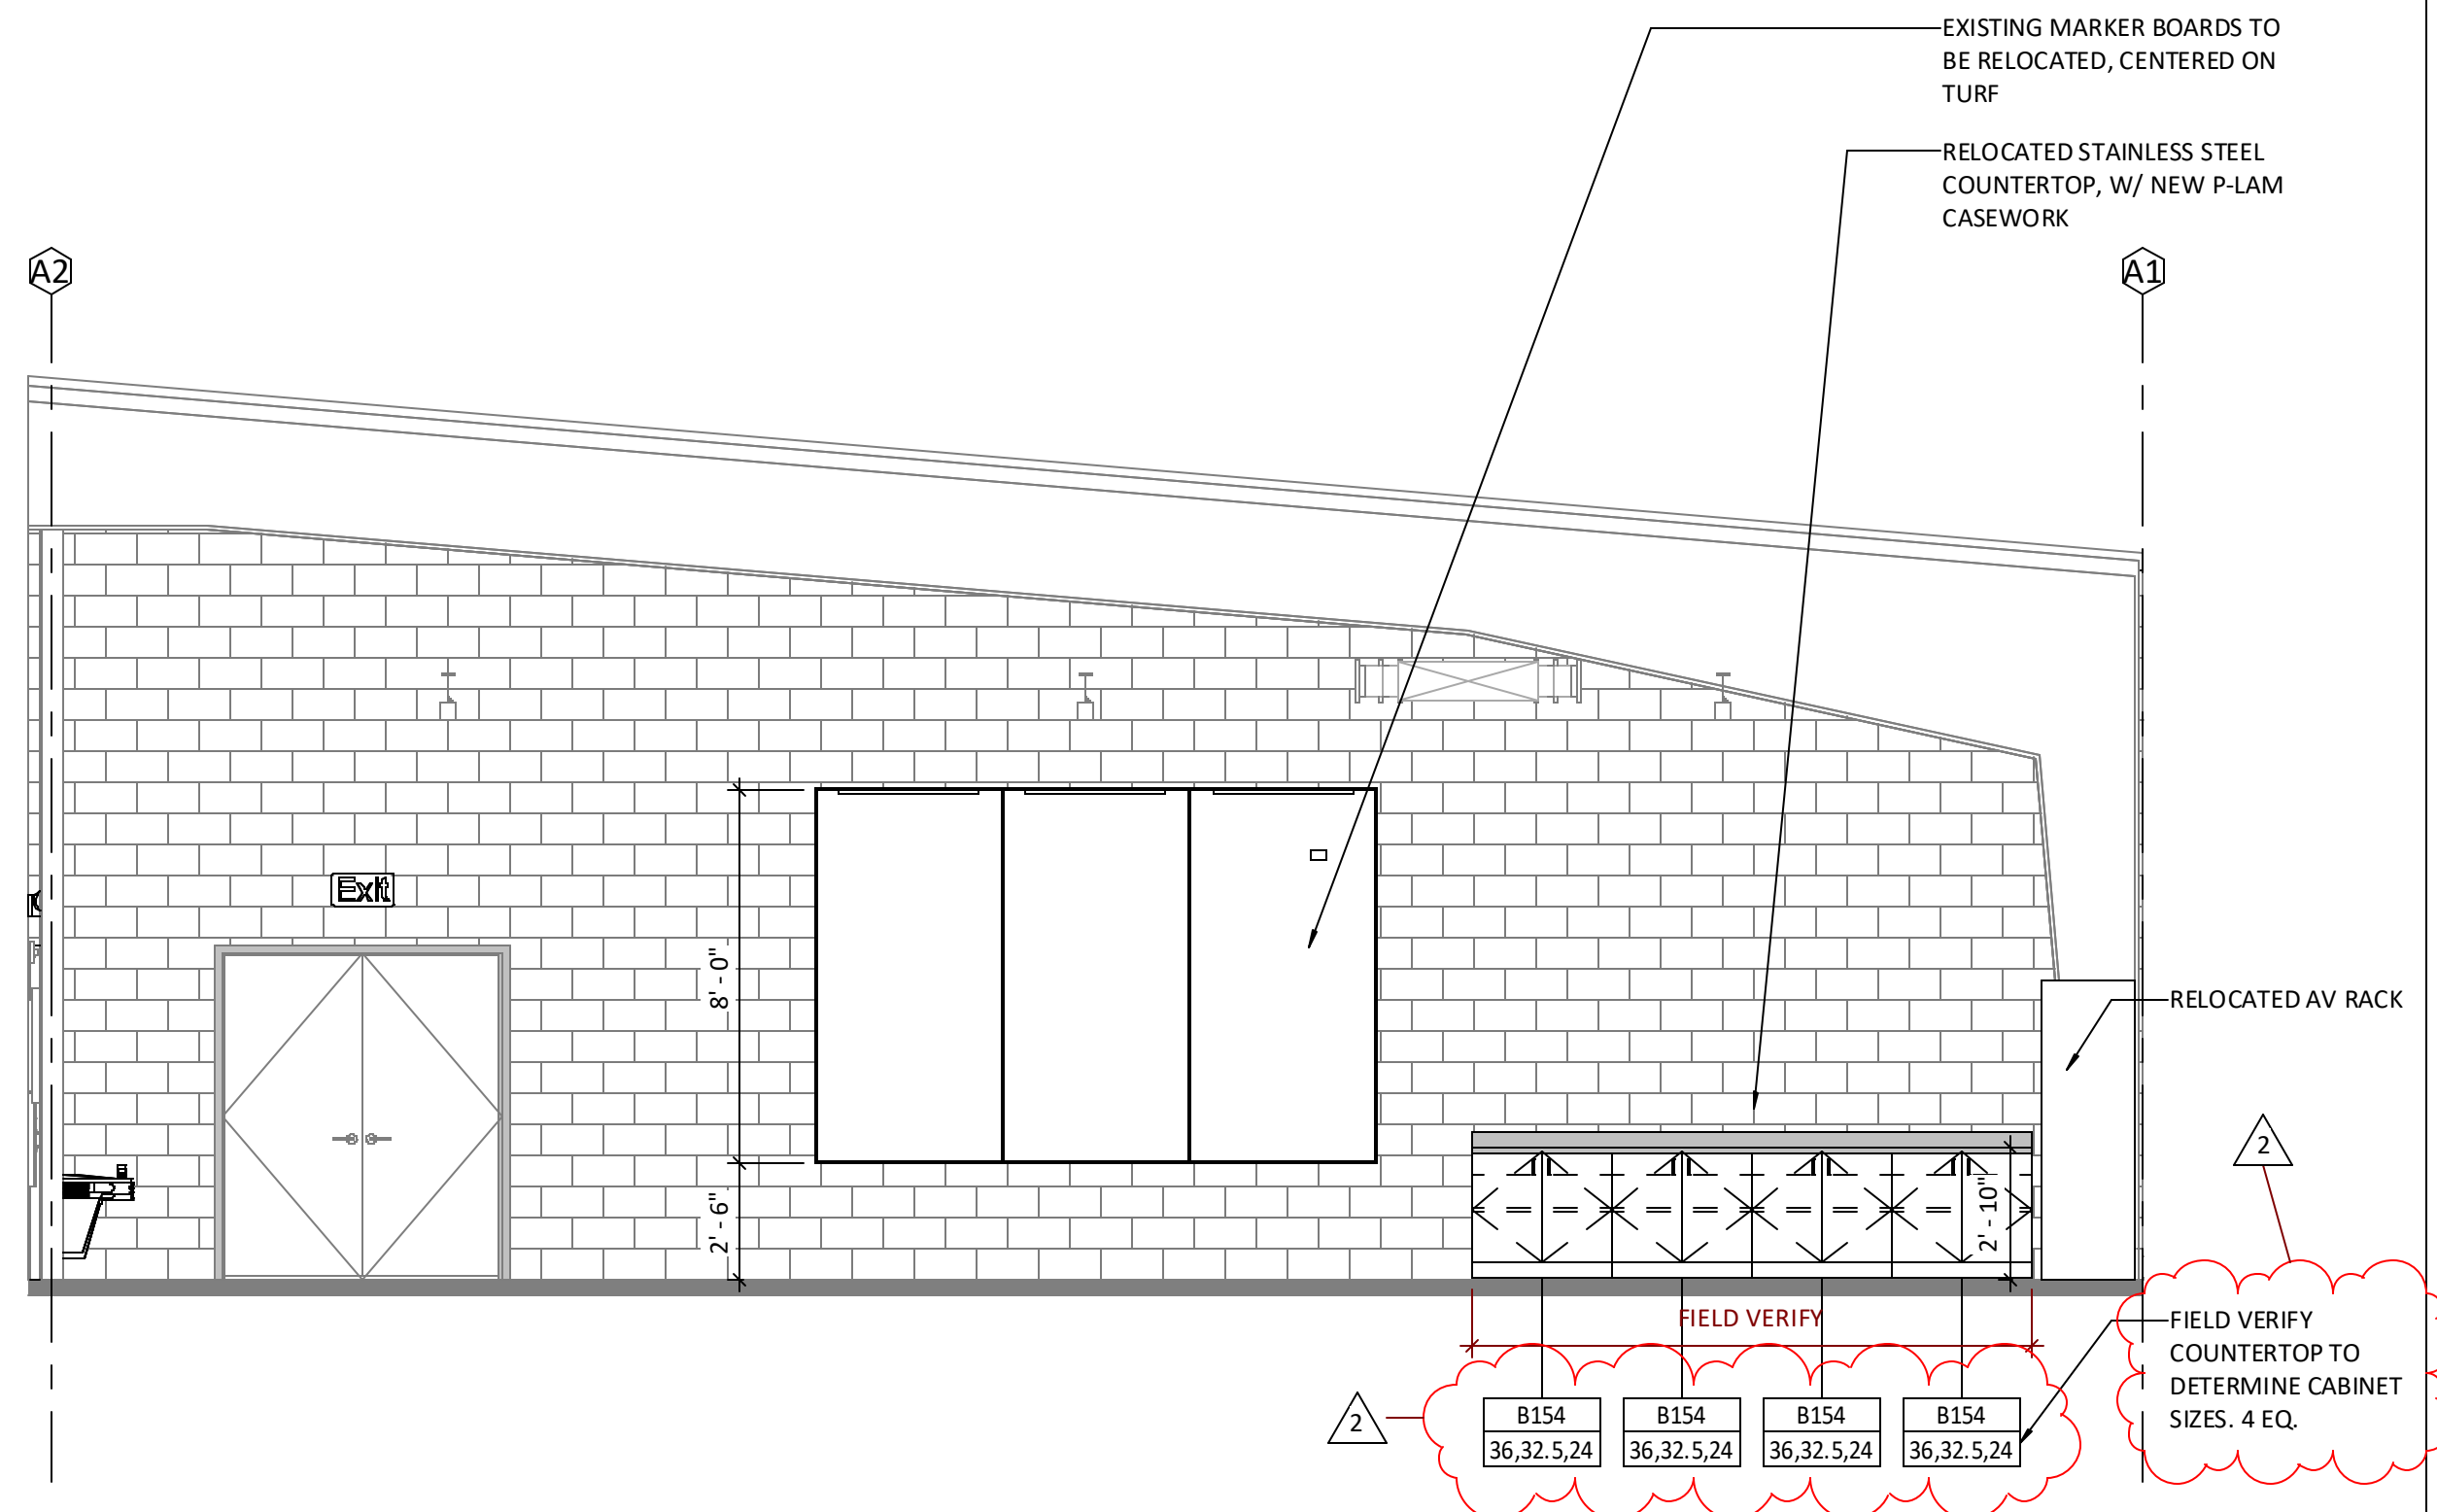


Weight Room 1 - South Elevation **G8**  
1/4" = 1'-0"

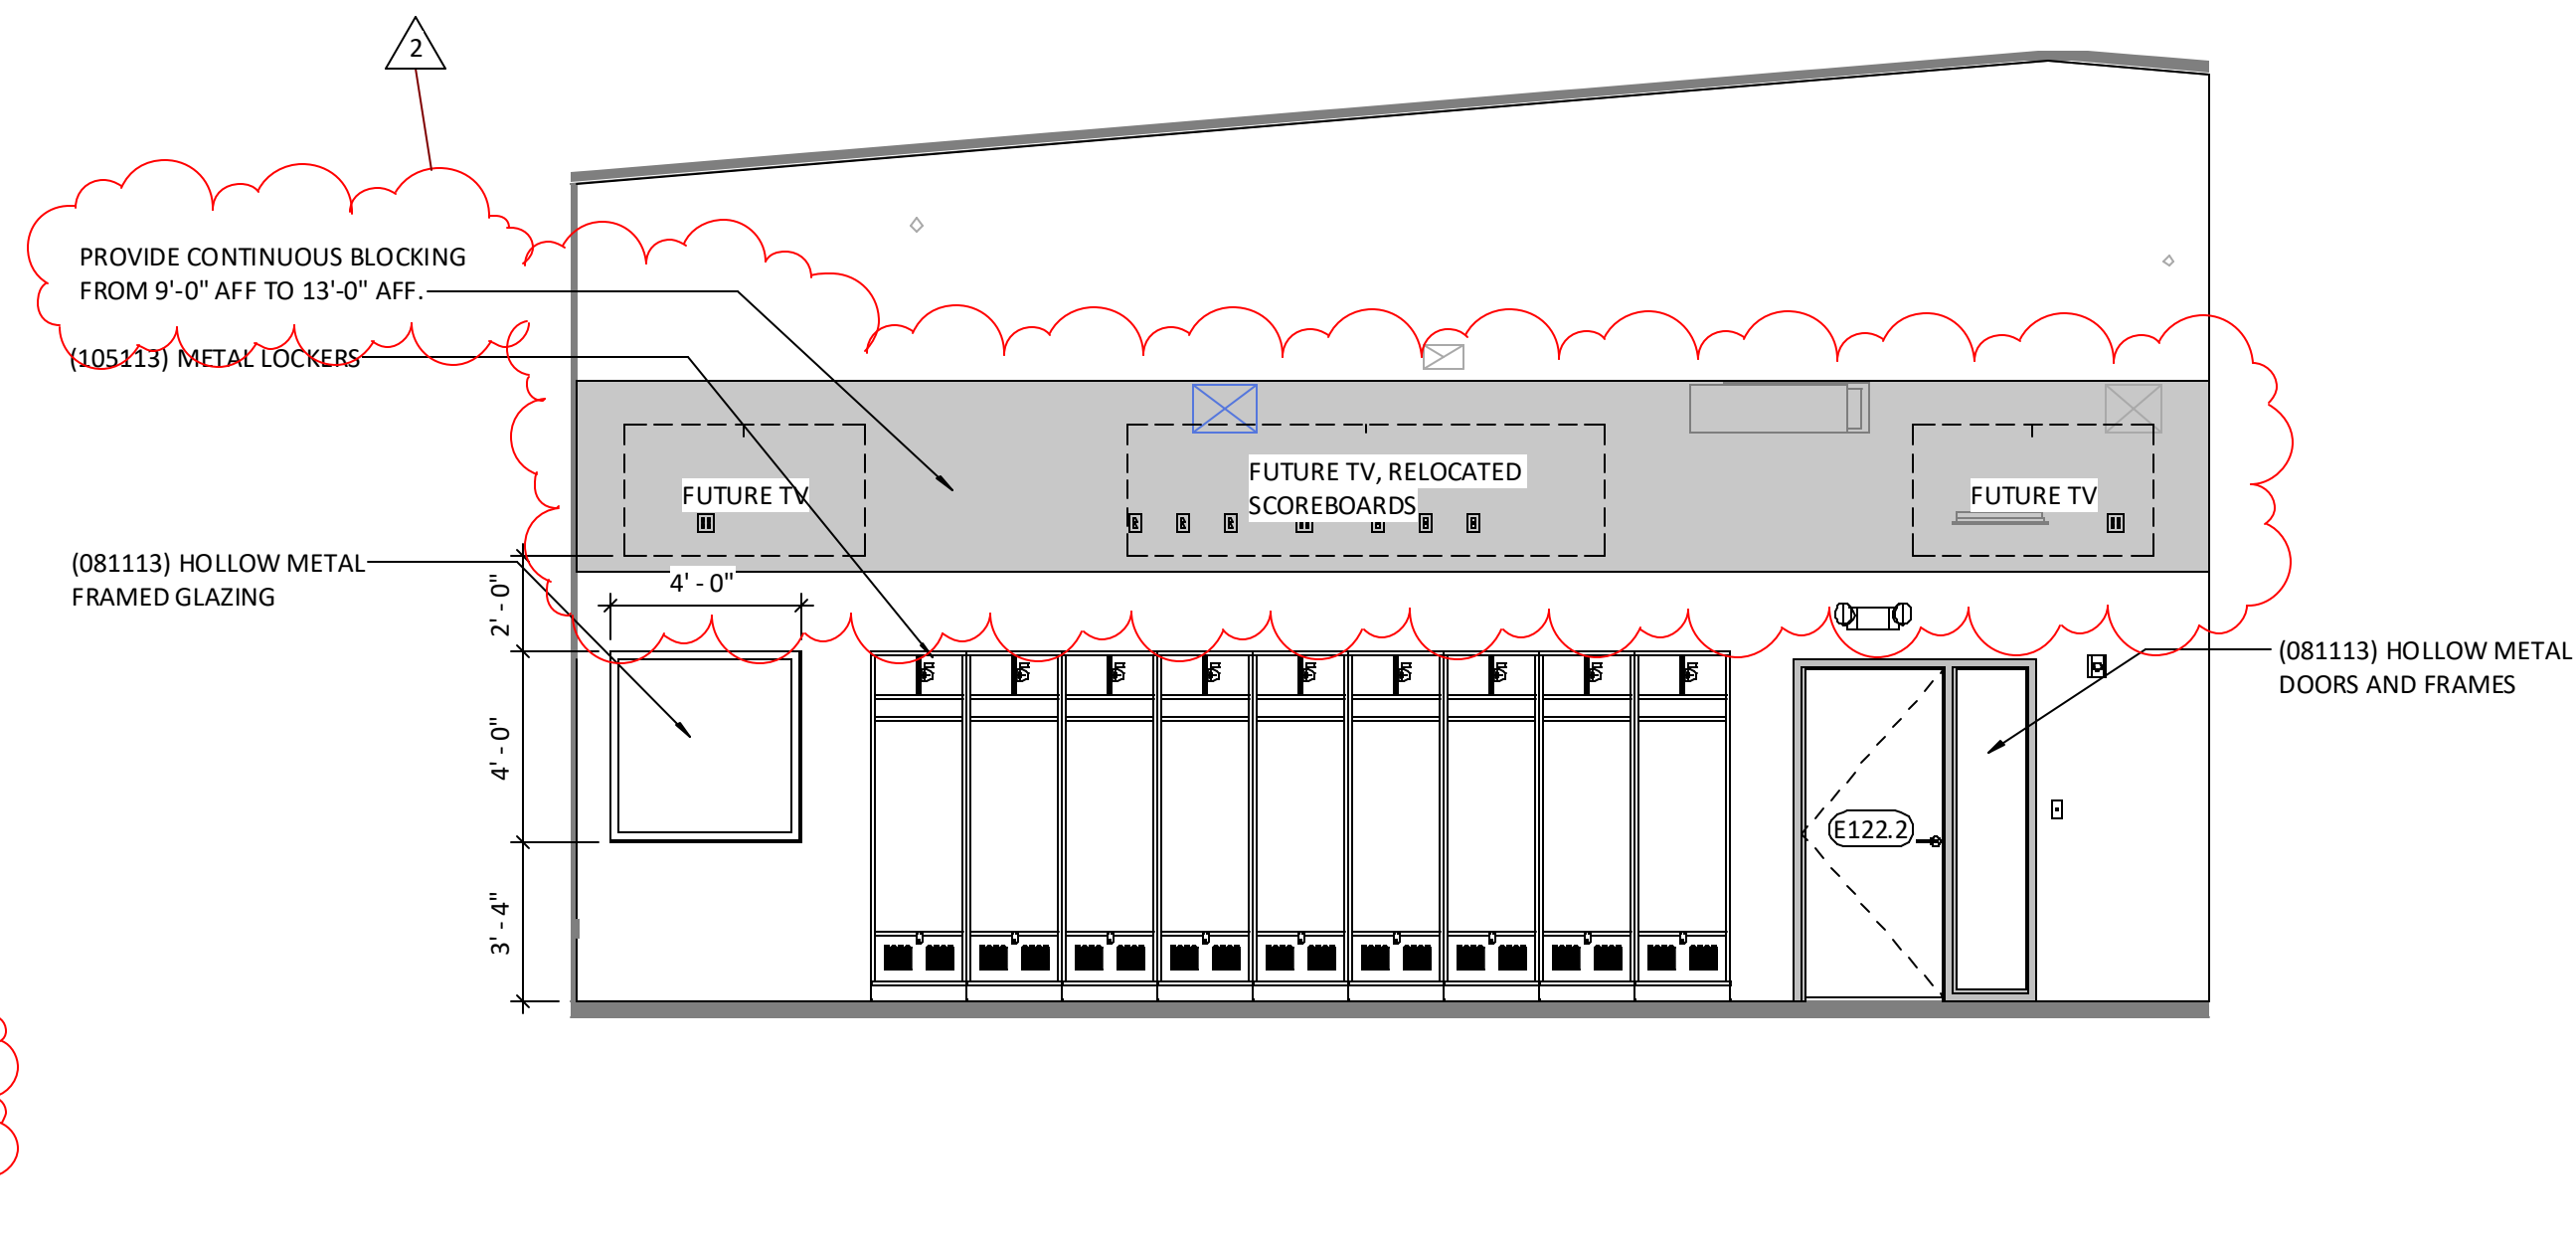

Football Locker Room - South Elevation **G1**  
1/4" = 1'-0"

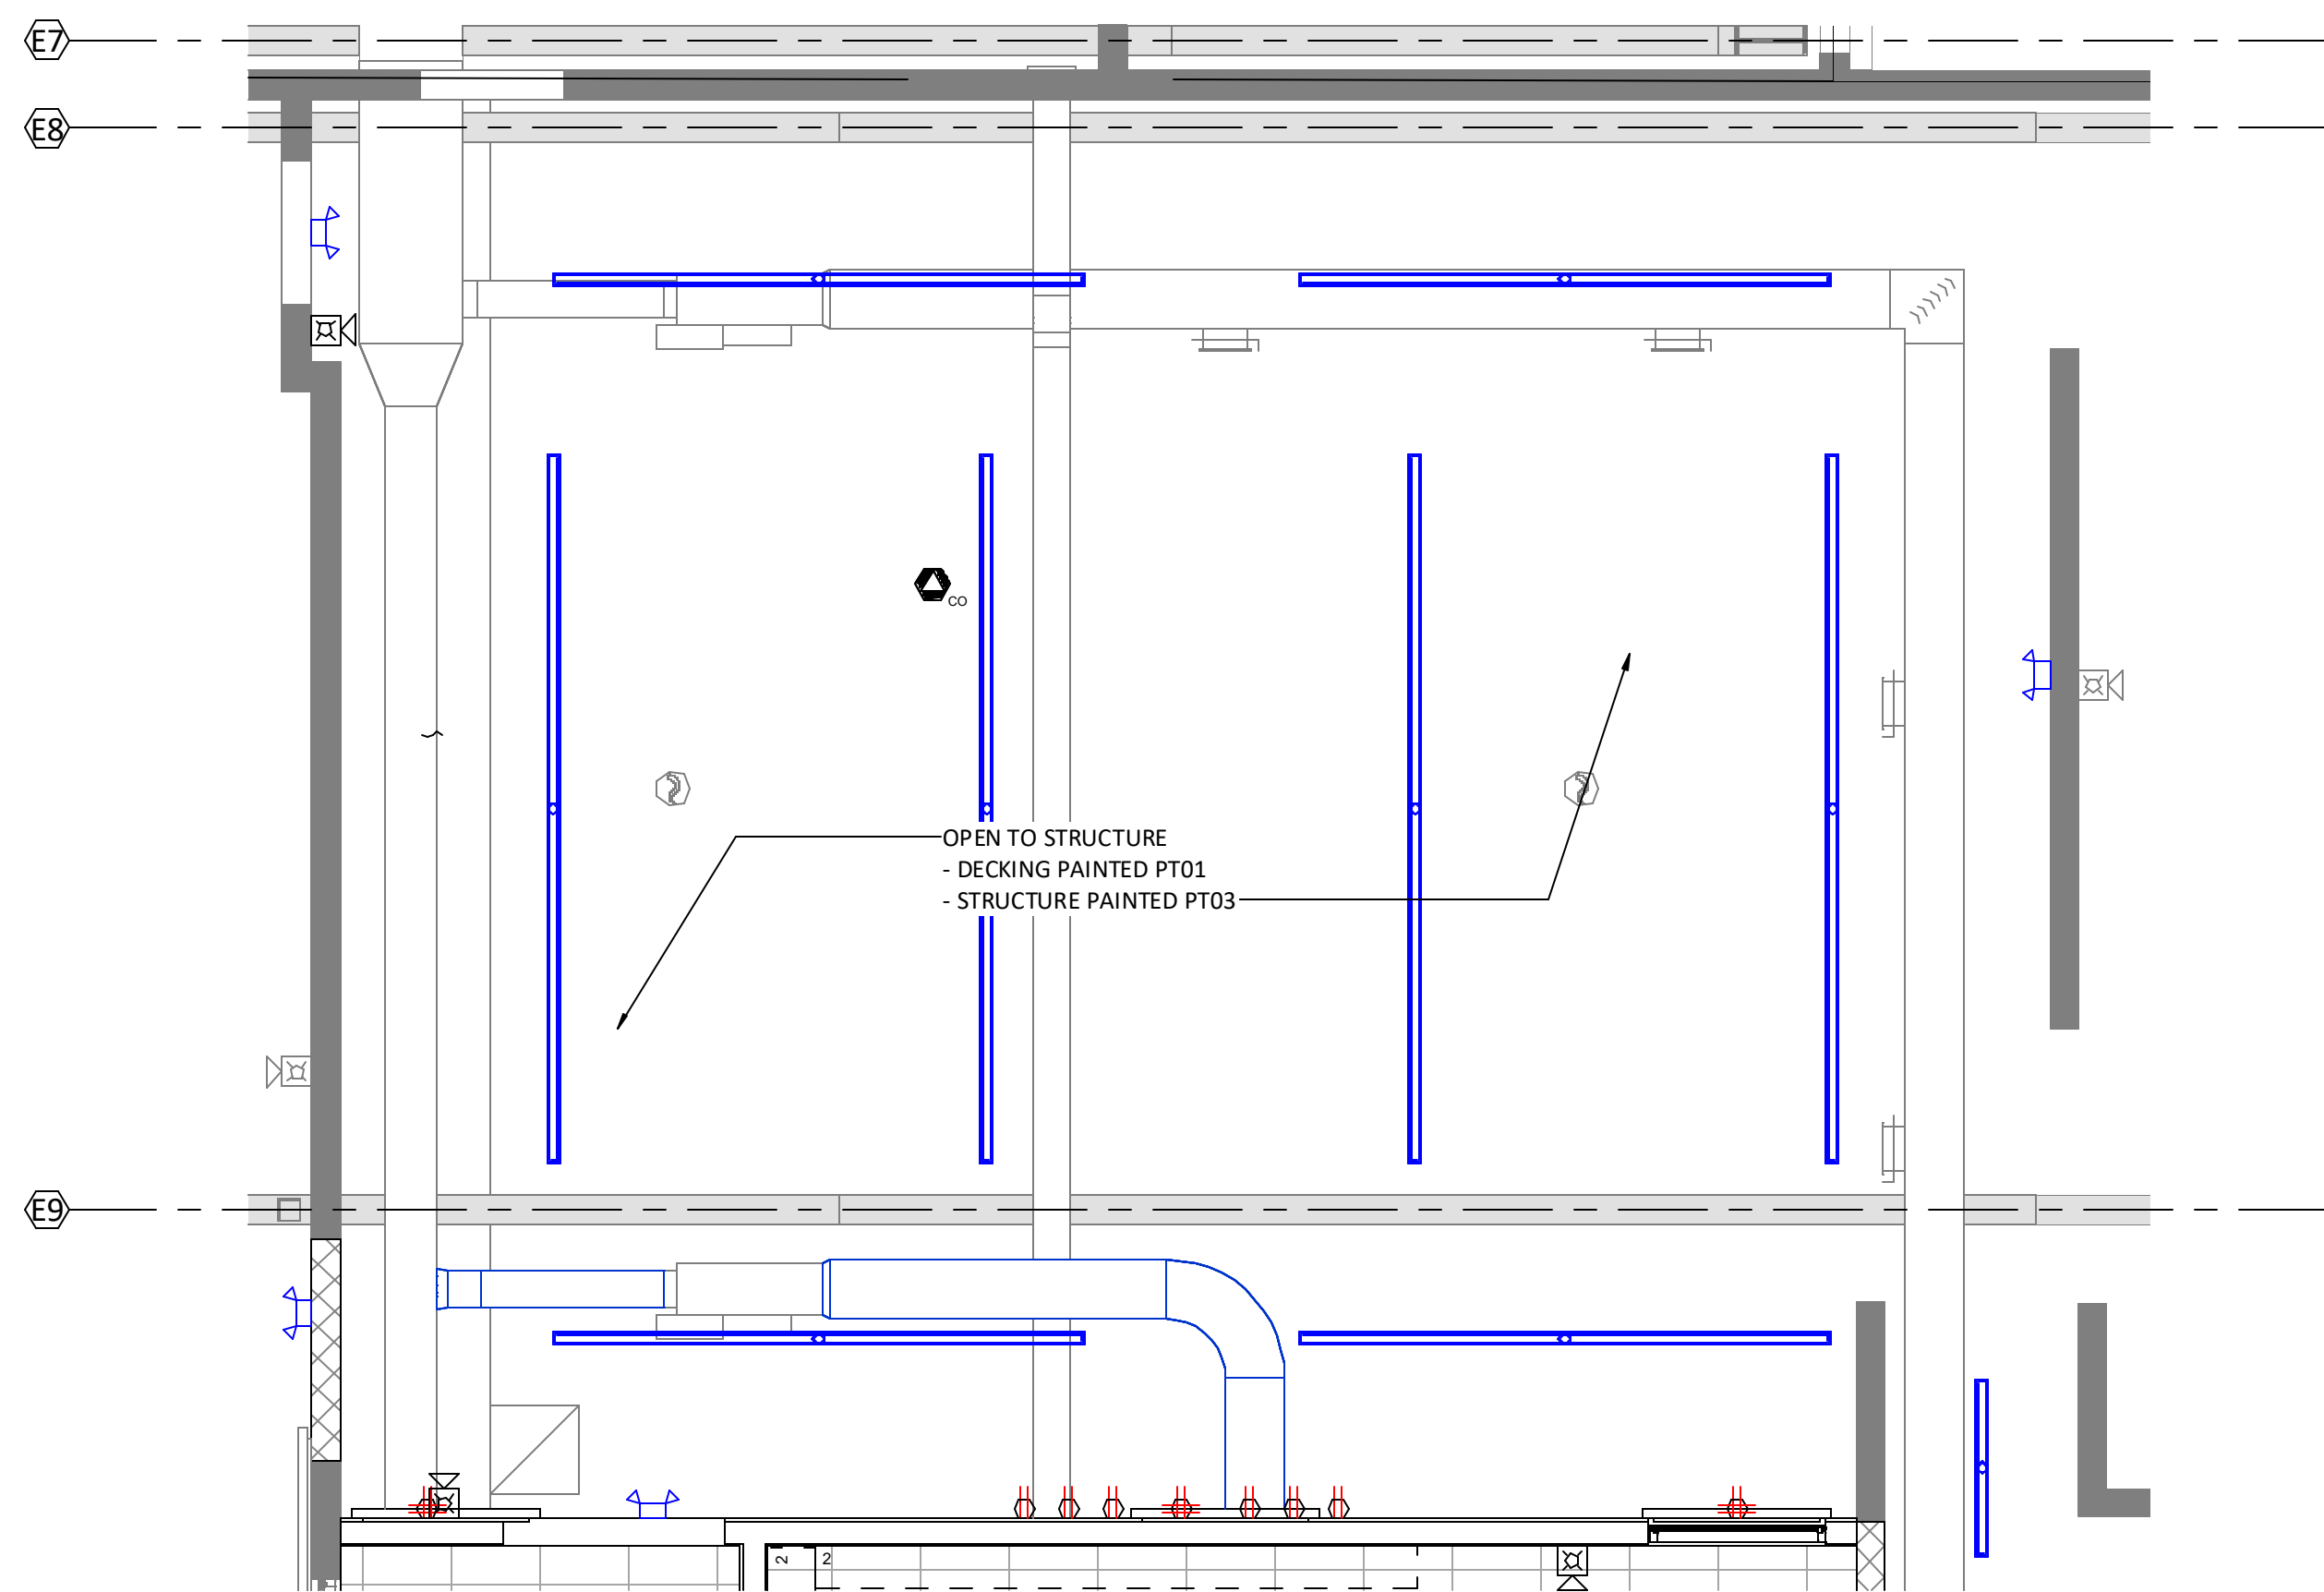

Reflected Ceiling Plan - Football Locker Room **A8**  
1/4" = 1'-0"

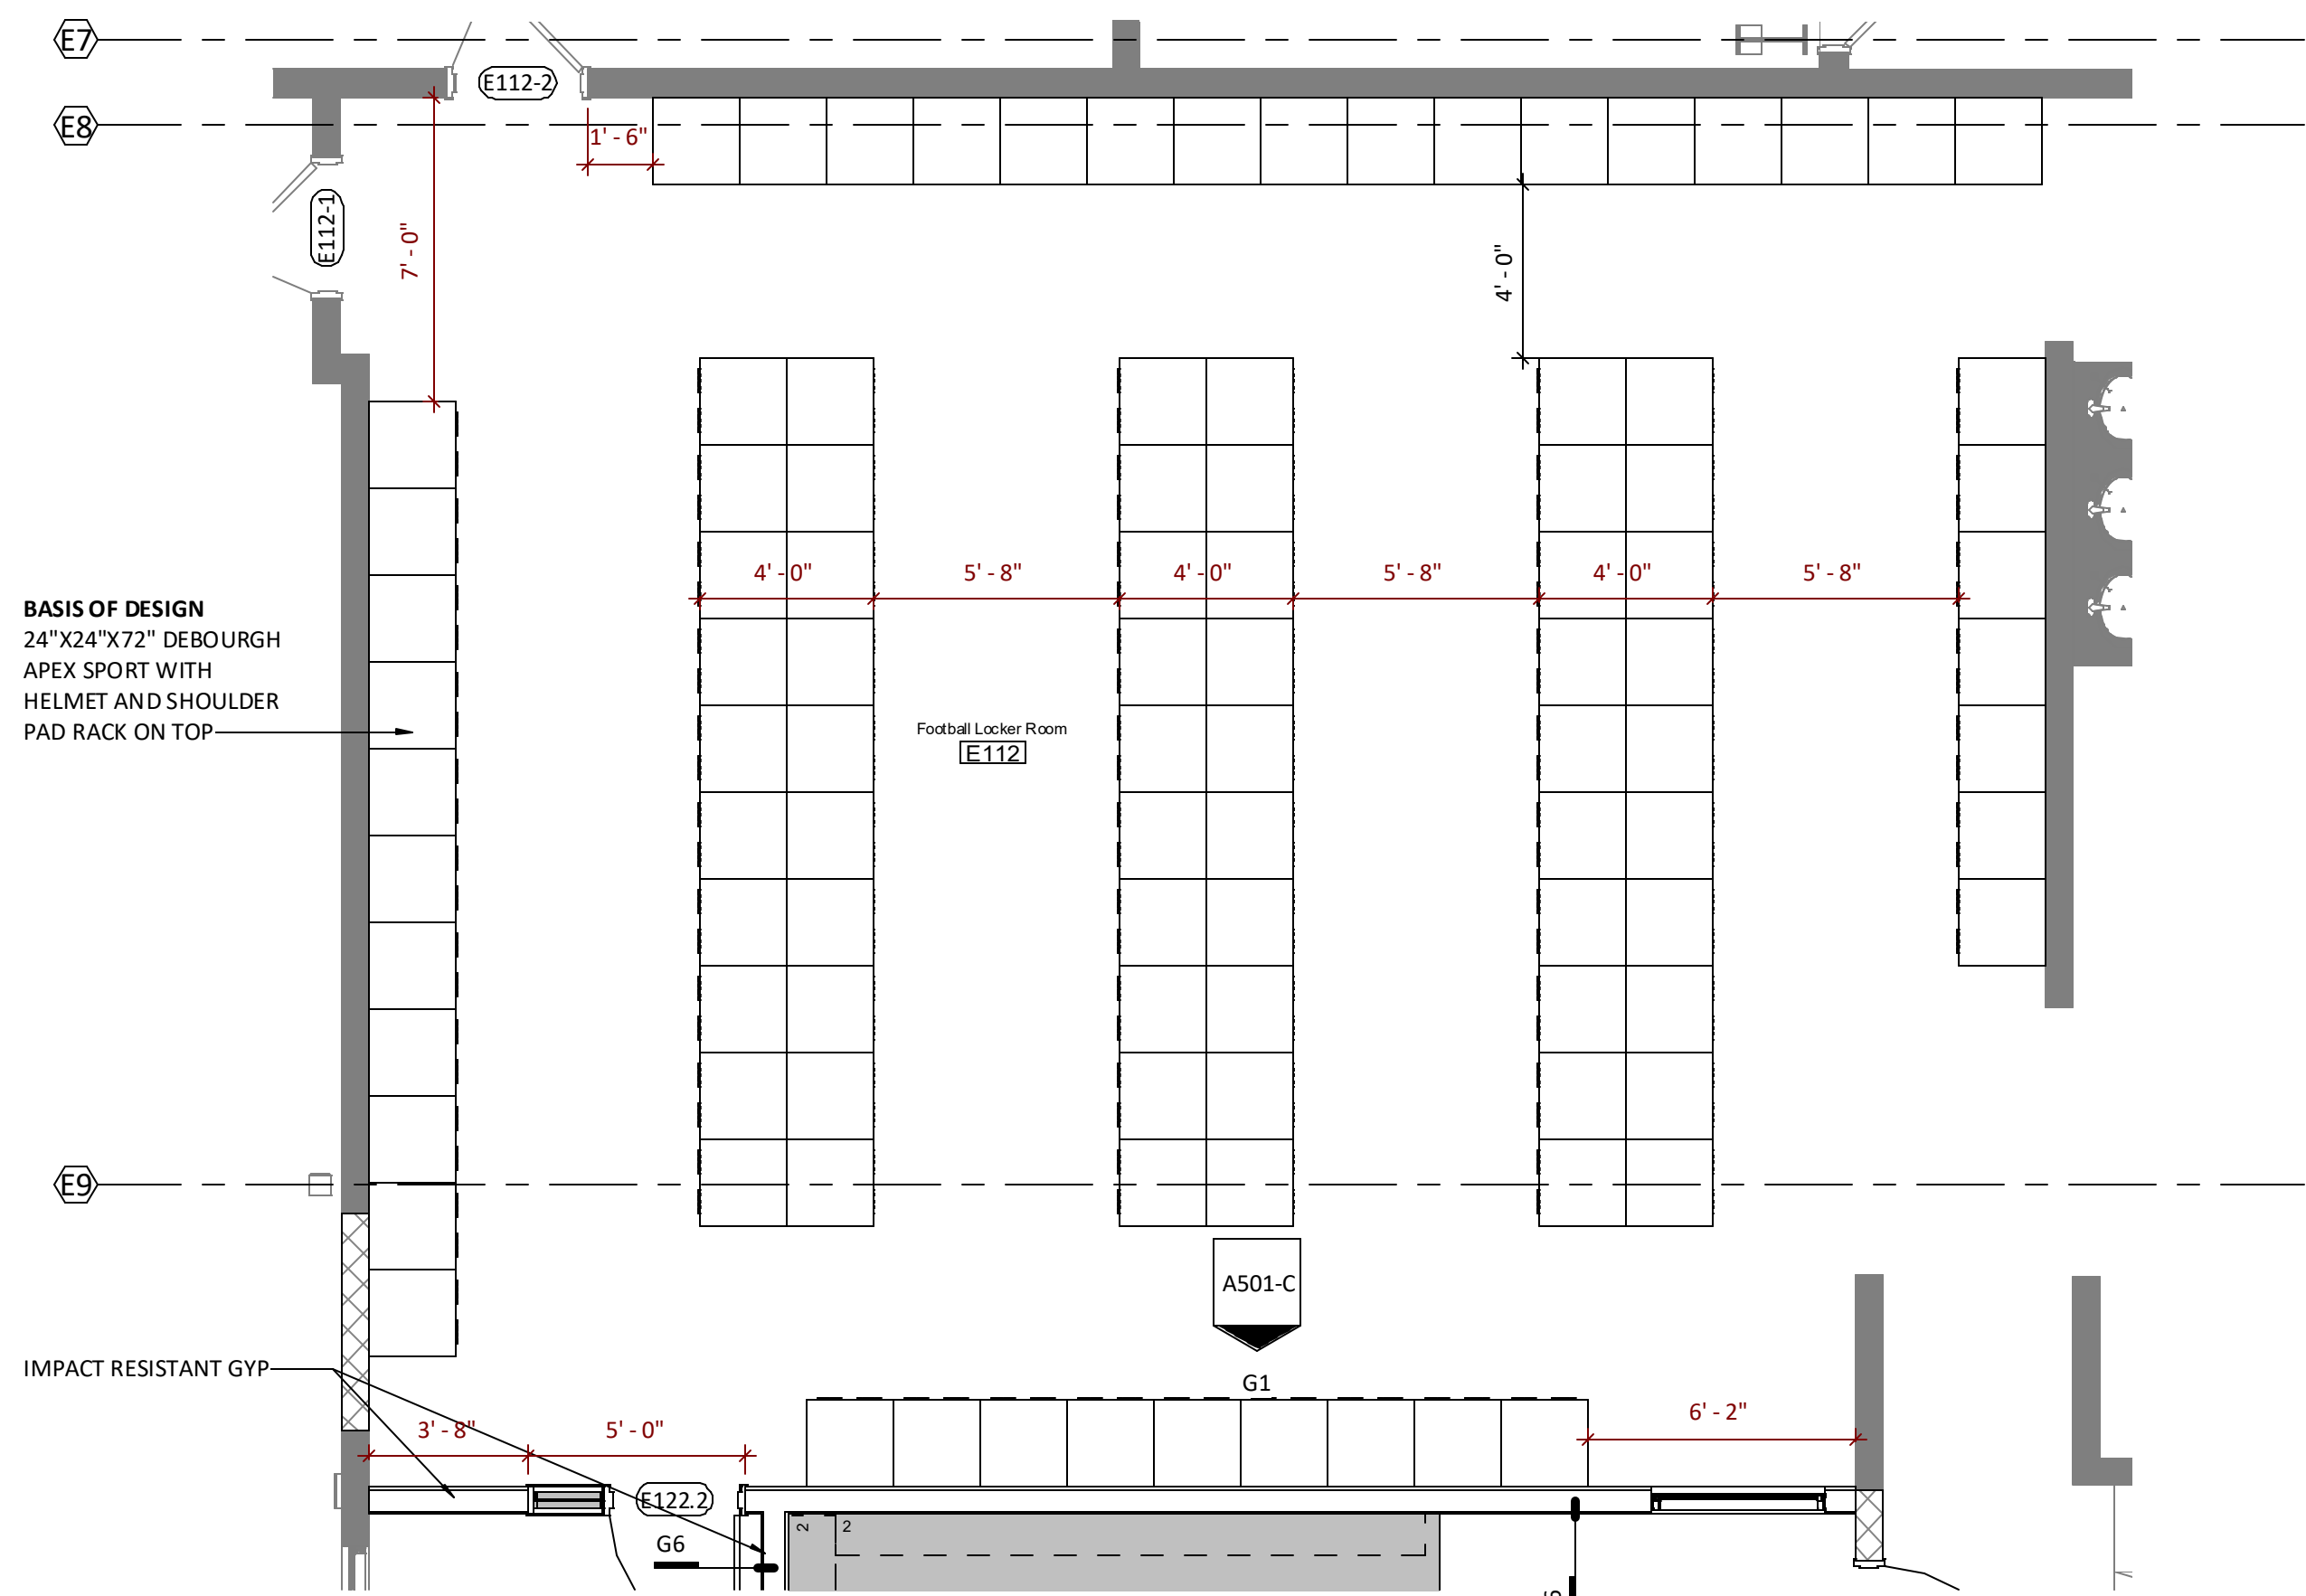

Enlarged Floor Plan - Football Locker Room **A1**  
1/4" = 1'-0"

Issue Date: September 9, 2022

Revisions		
NUMBER	DESCRIPTION	DATE
2	Addendum 02	09/23/2022

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION.



Interior Context  
Drawings - Football  
Locker Room & Weight  
Room

**A501-C**



LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100

owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086


architect: Multistudio  
4300 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multistudio

civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kvweng.com


structural engineer: Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/T/Code: Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com


123616 - METAL  
COUNTERTOPS: 1 1/2"  
STAINLESS COUNTERTOP  
(PLYWOOD SUBSTRATE), WALL  
MOUNTED STEEL SUPPORT  
BRACKETS @ 24" O.C.

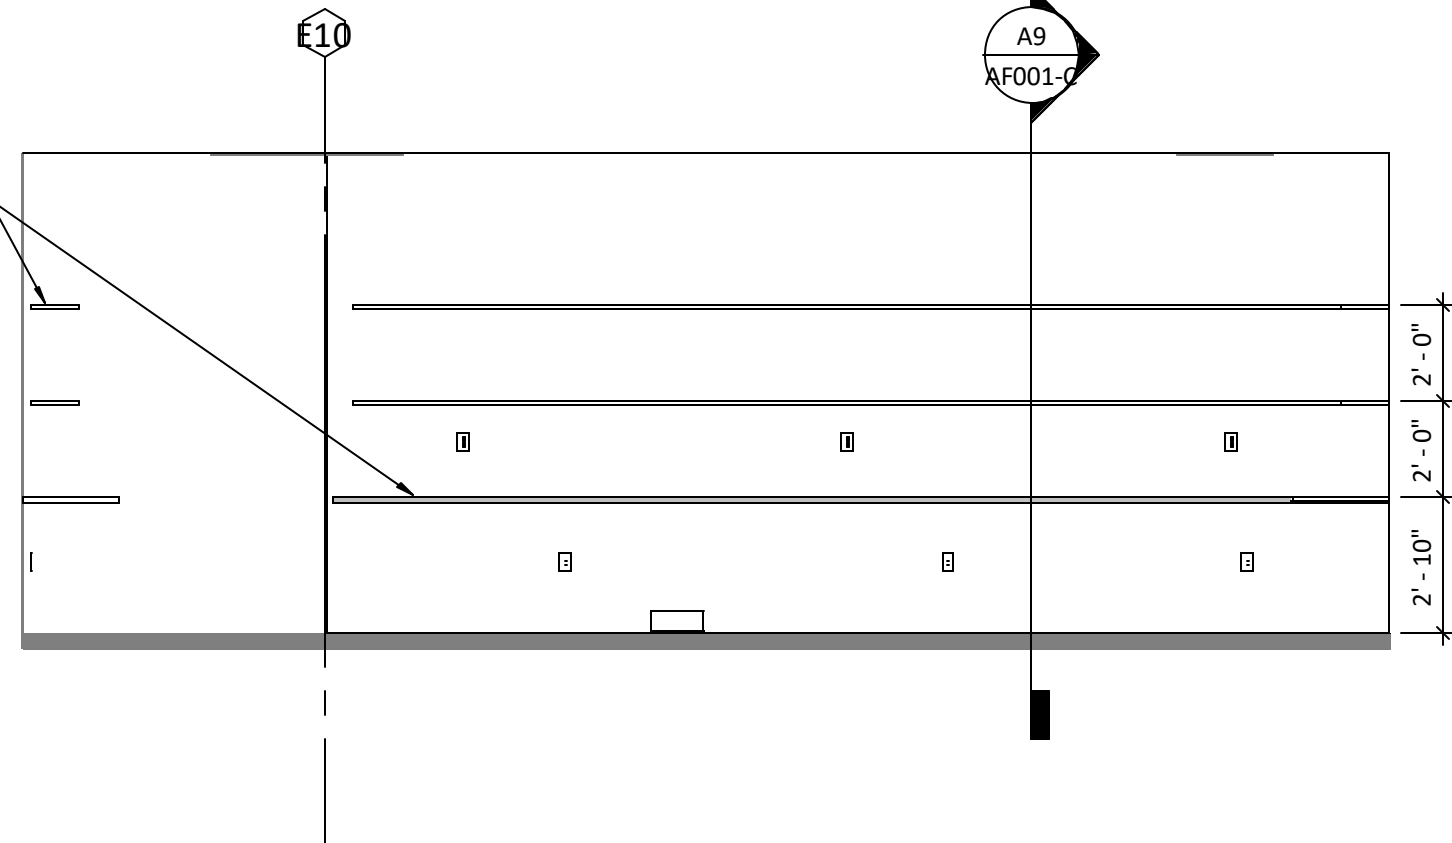


Coaches Office - West Elevation L12  
1/4" = 1'-0"

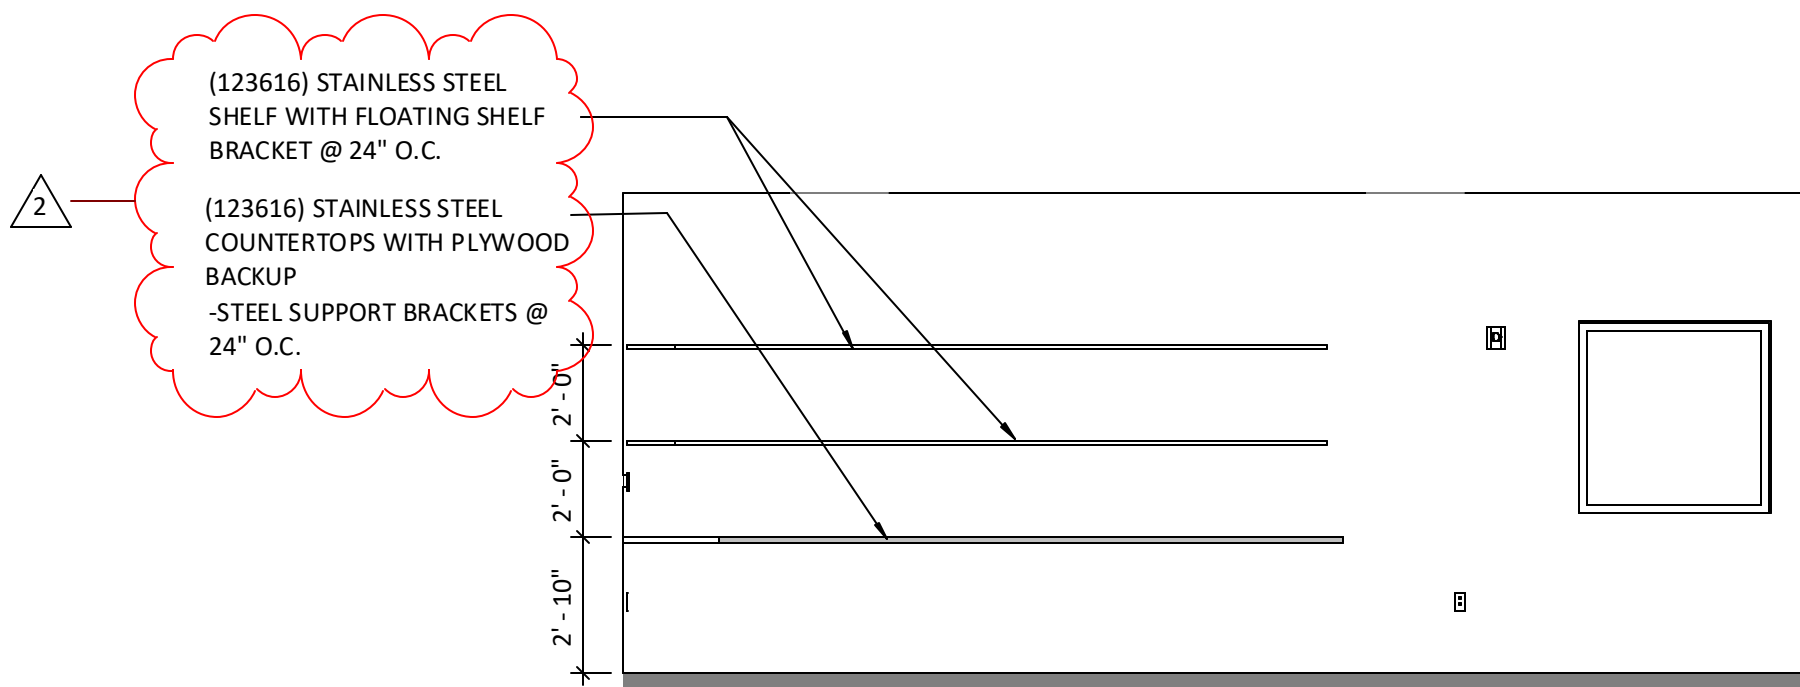


Coaches Office - North Elevation L6  
1/4" = 1'-0"

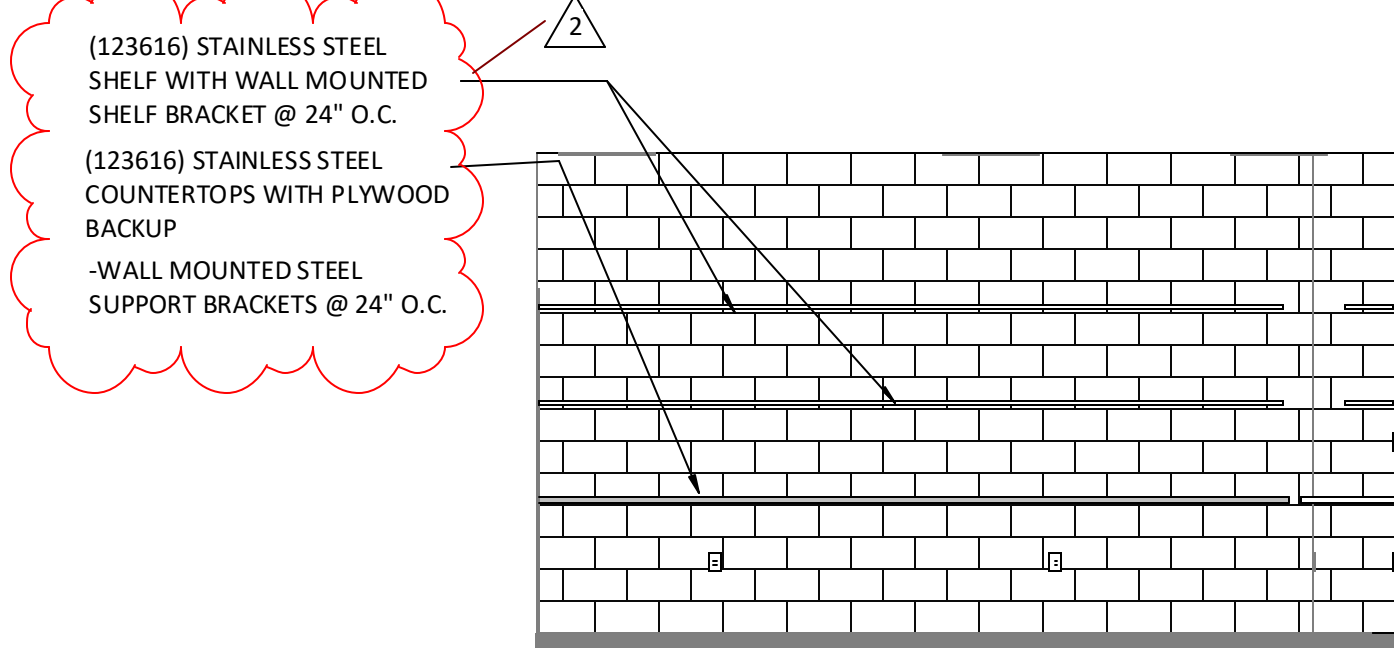

Coaches Office - South Elevation M1  
1/4" = 1'-0"

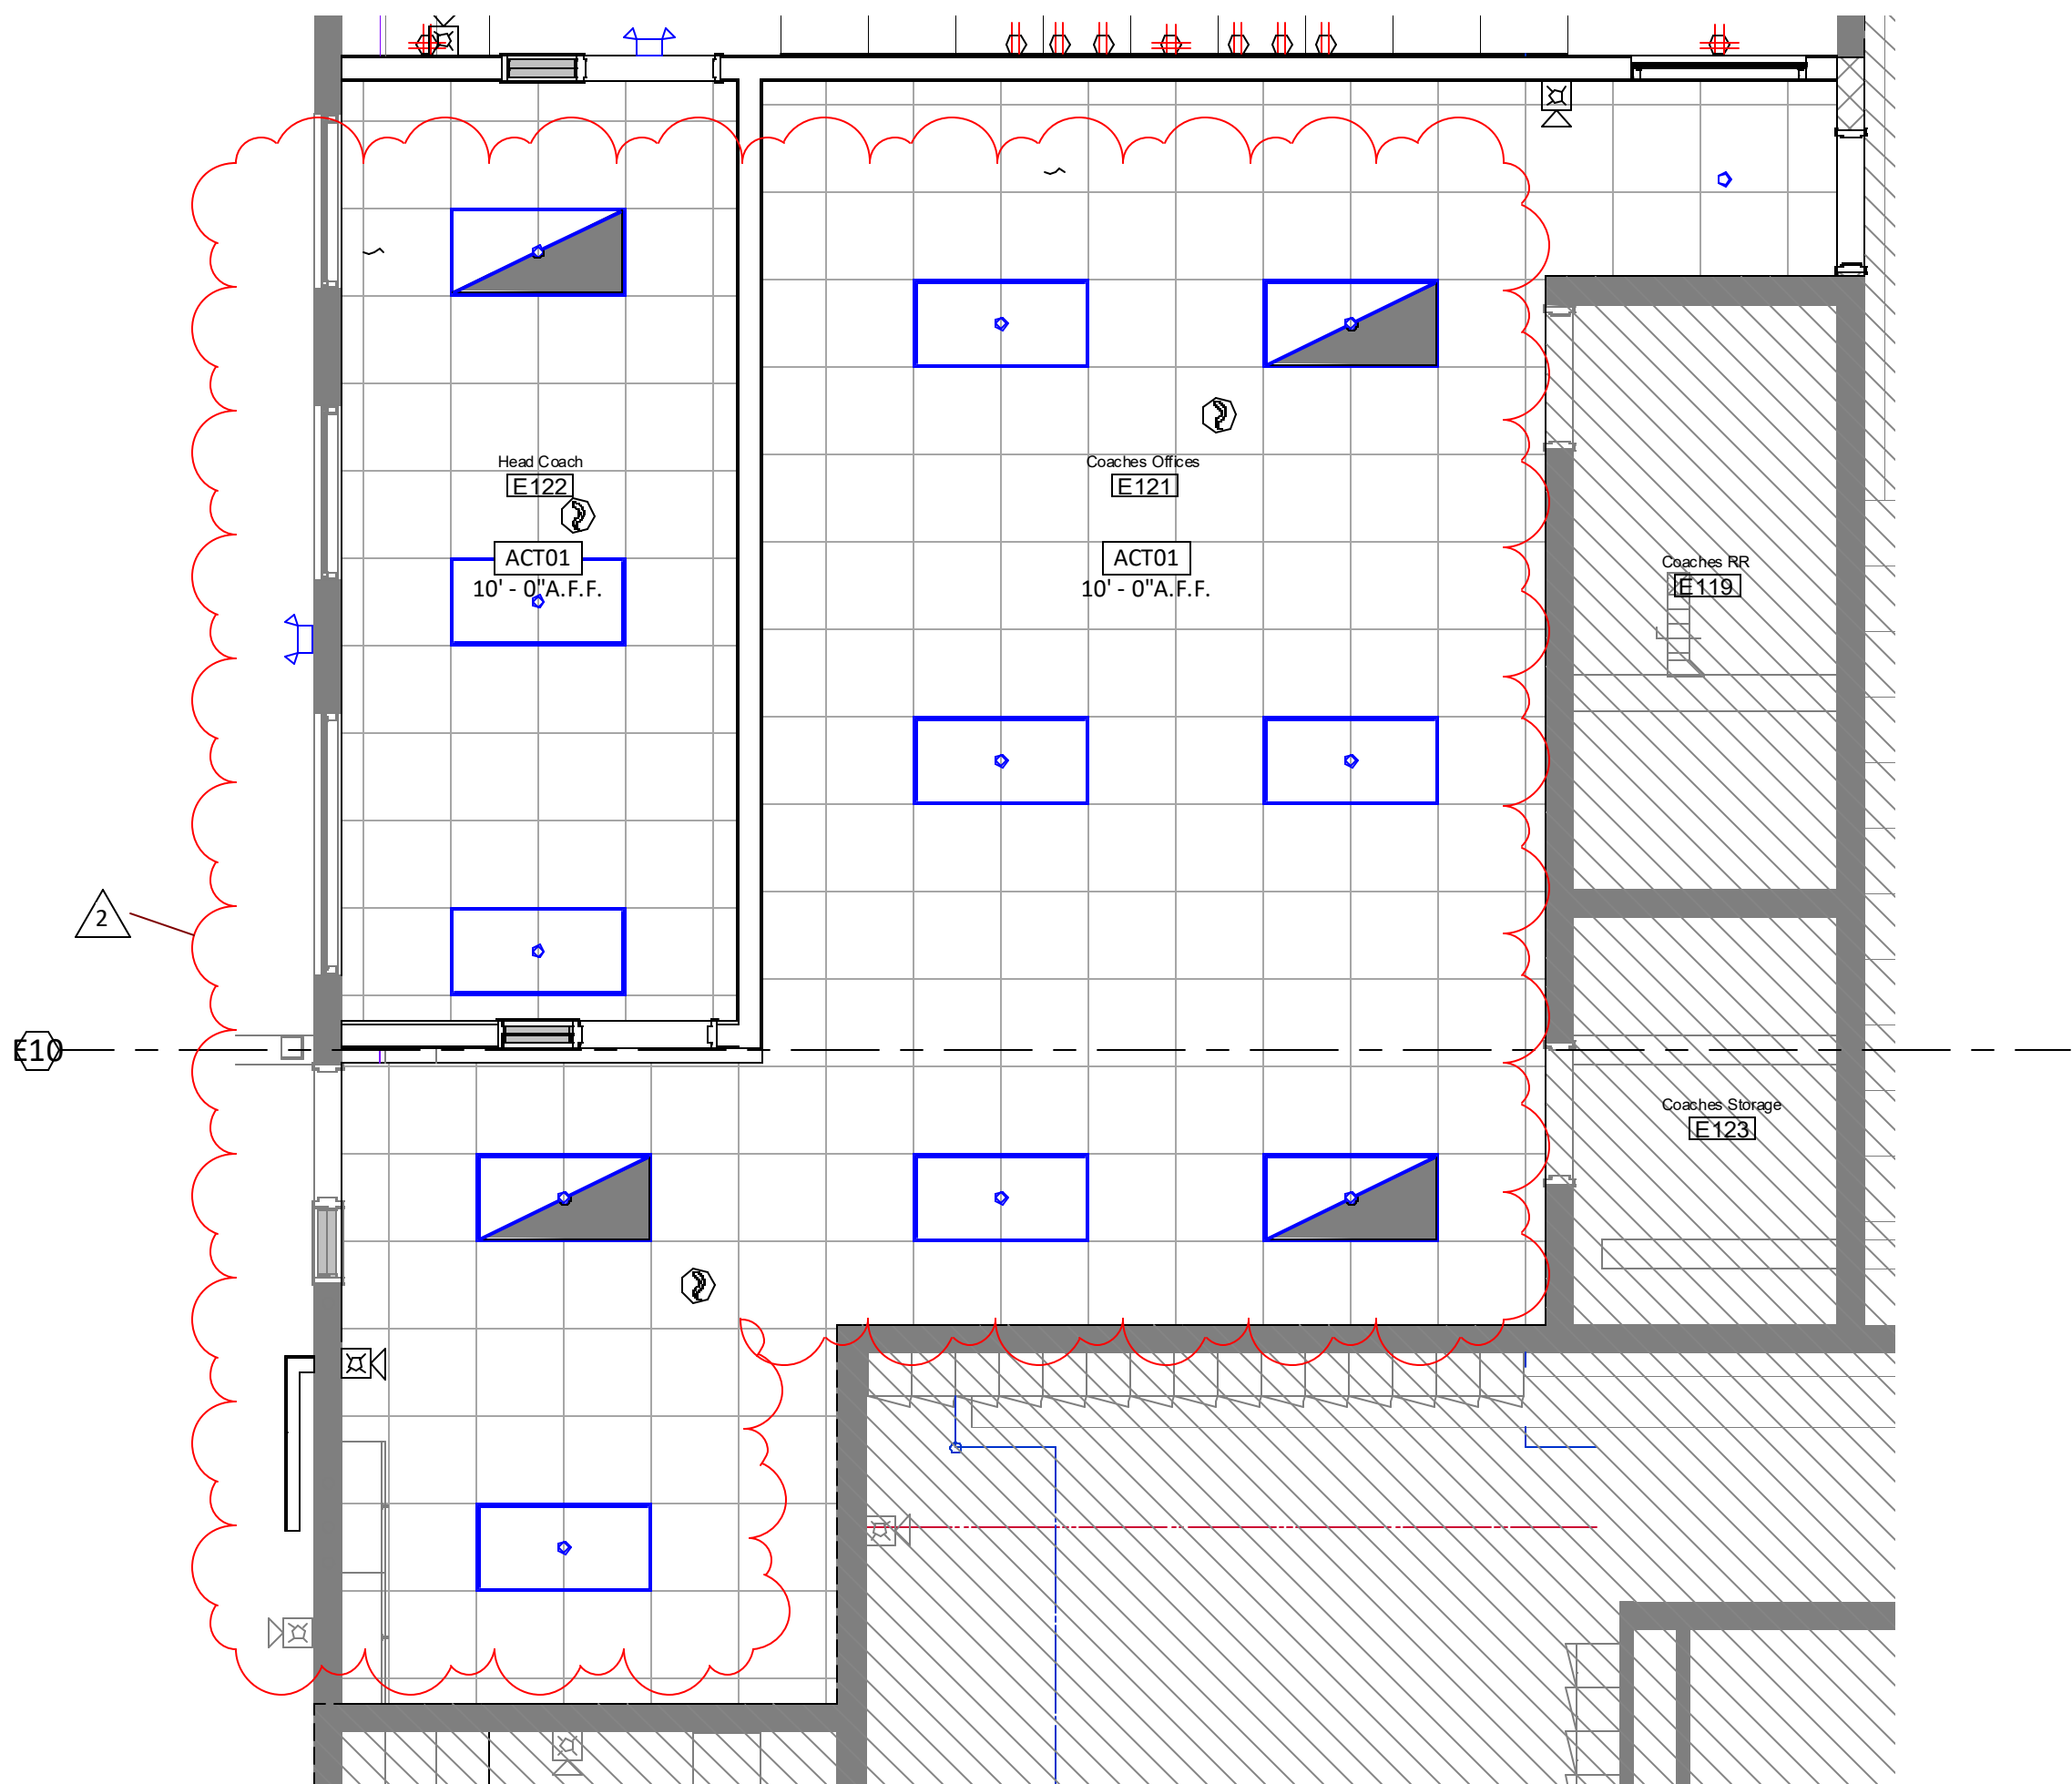

Reflected Ceiling Plan - Coaches Office A8  
1/4" = 1'-0"

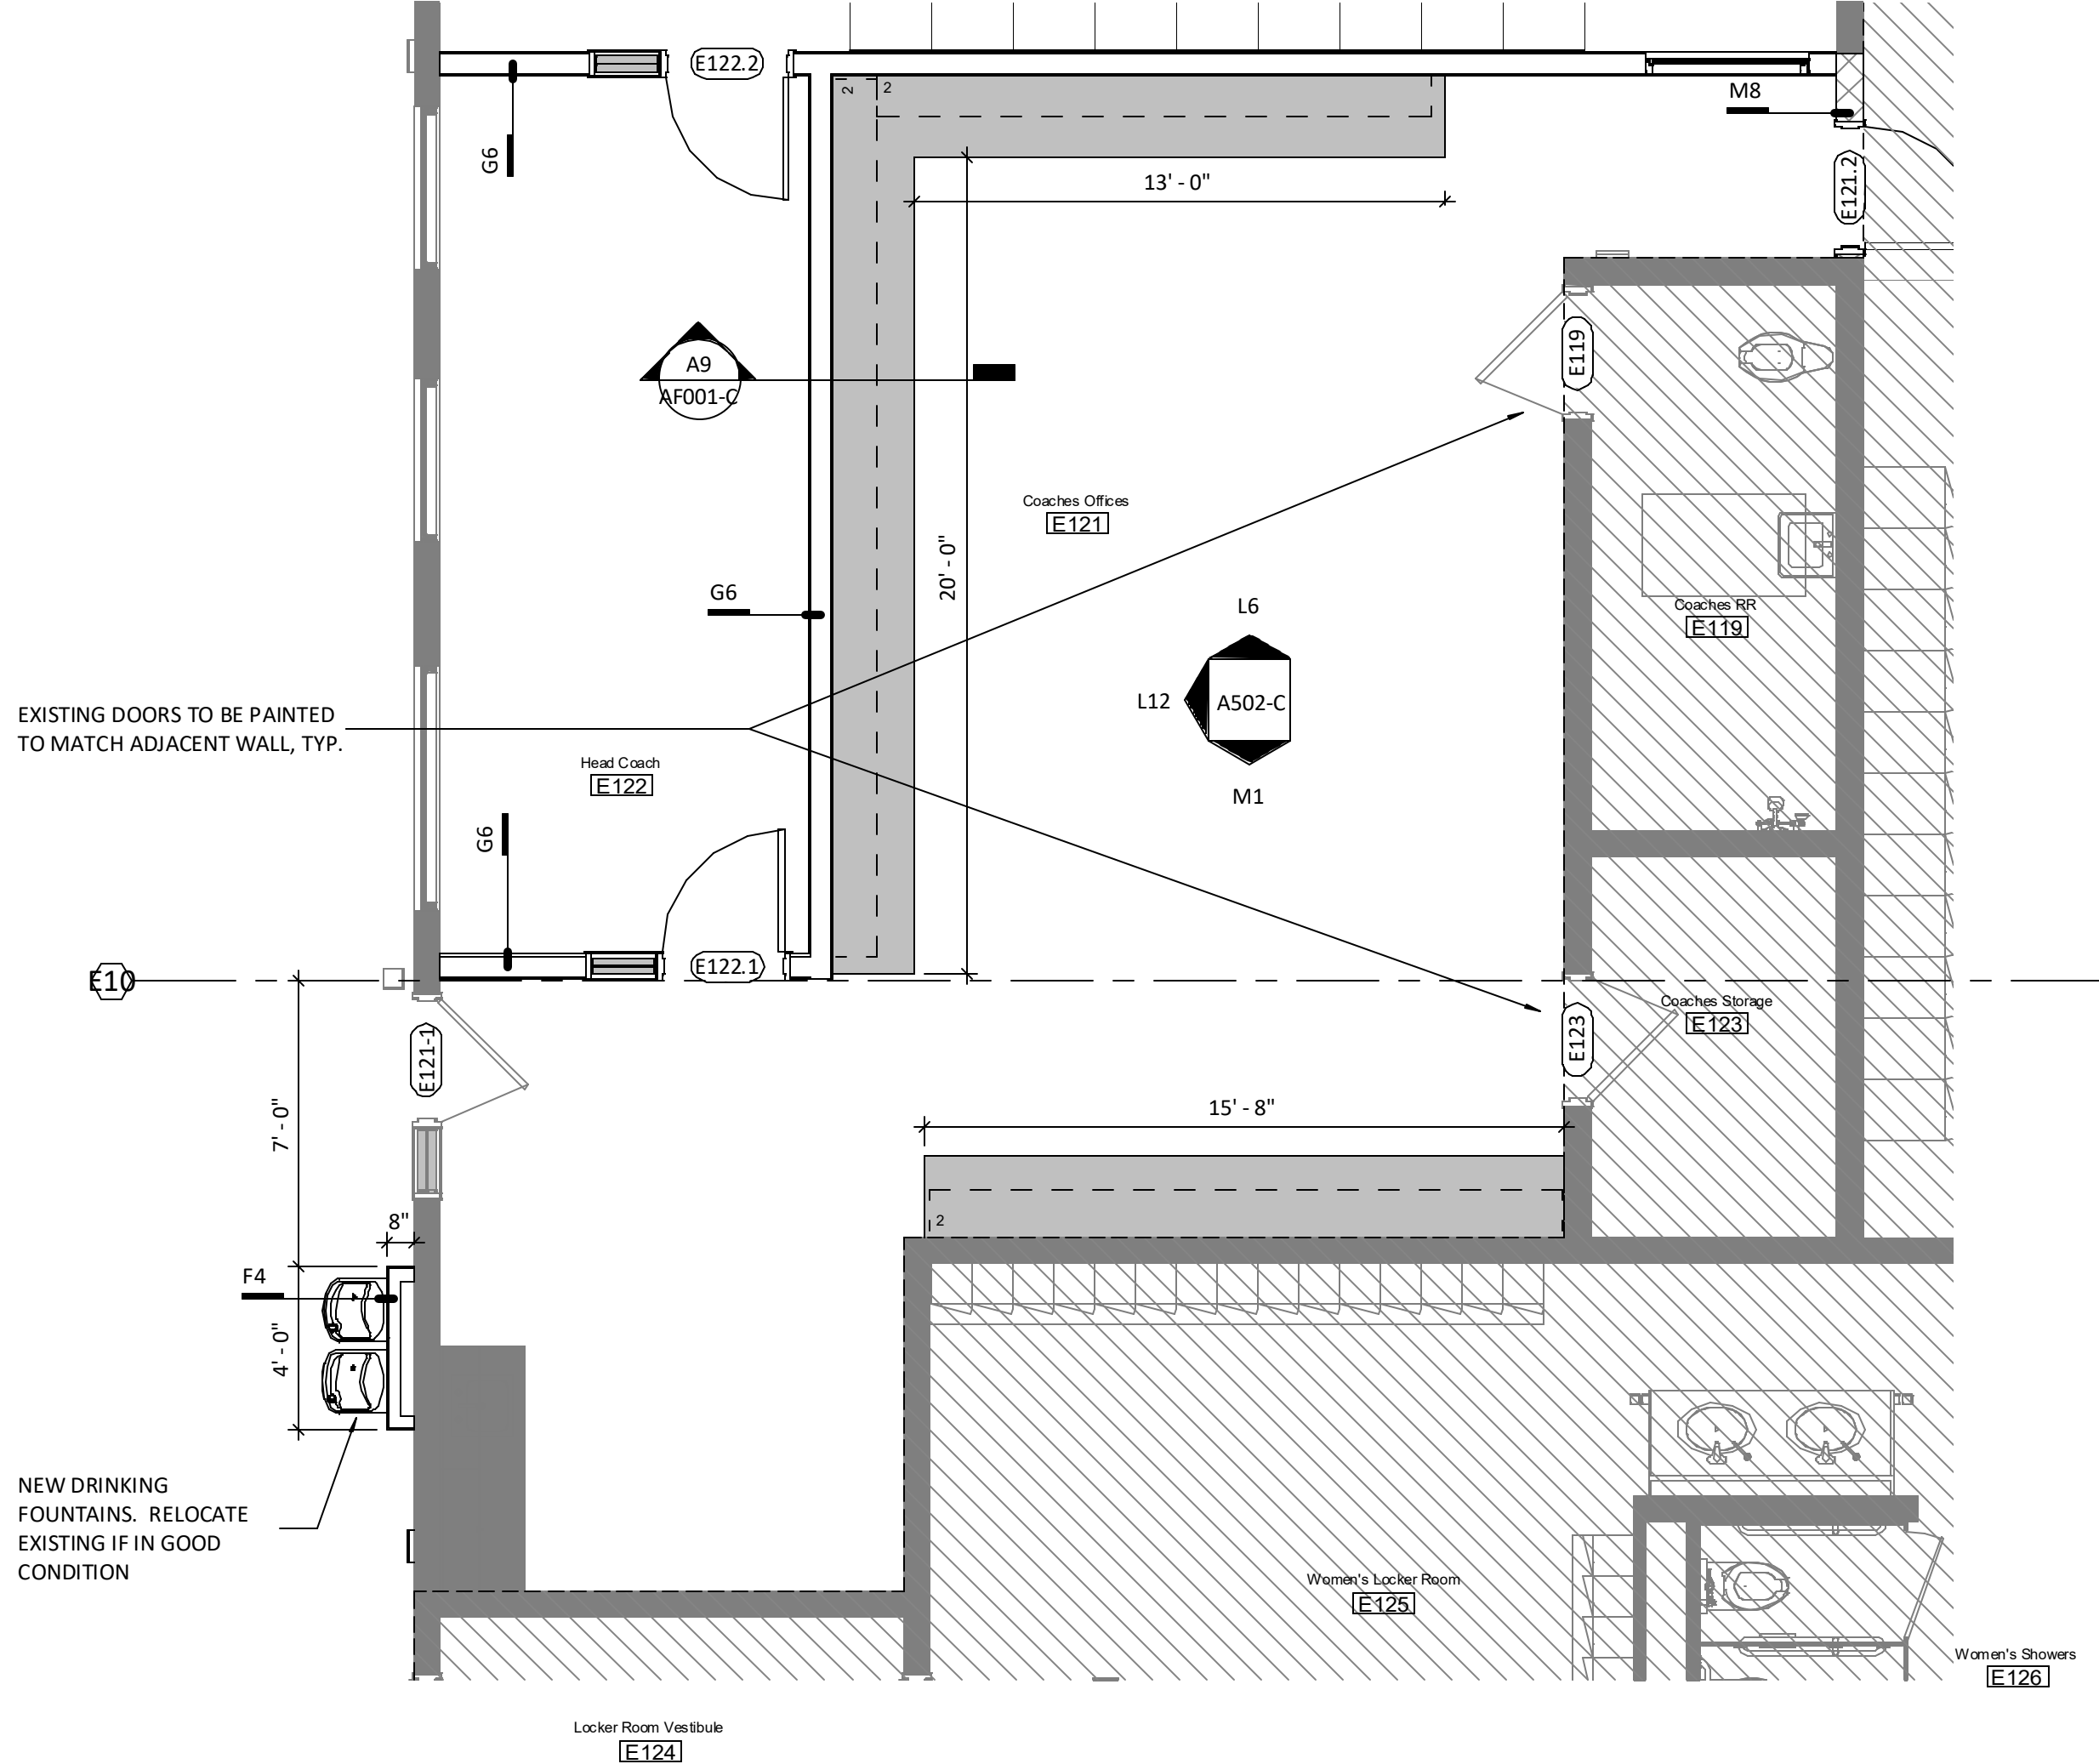

Enlarged Floor Plan - Coaches Office A1  
1/4" = 1'-0"

Issue Date: September 9, 2022

NUMBER	DESCRIPTION	DATE
2	Addendum 02	09/29/2022


UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS  
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR  
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



Interior Context  
Drawings - Coaches  
Office

A502-C



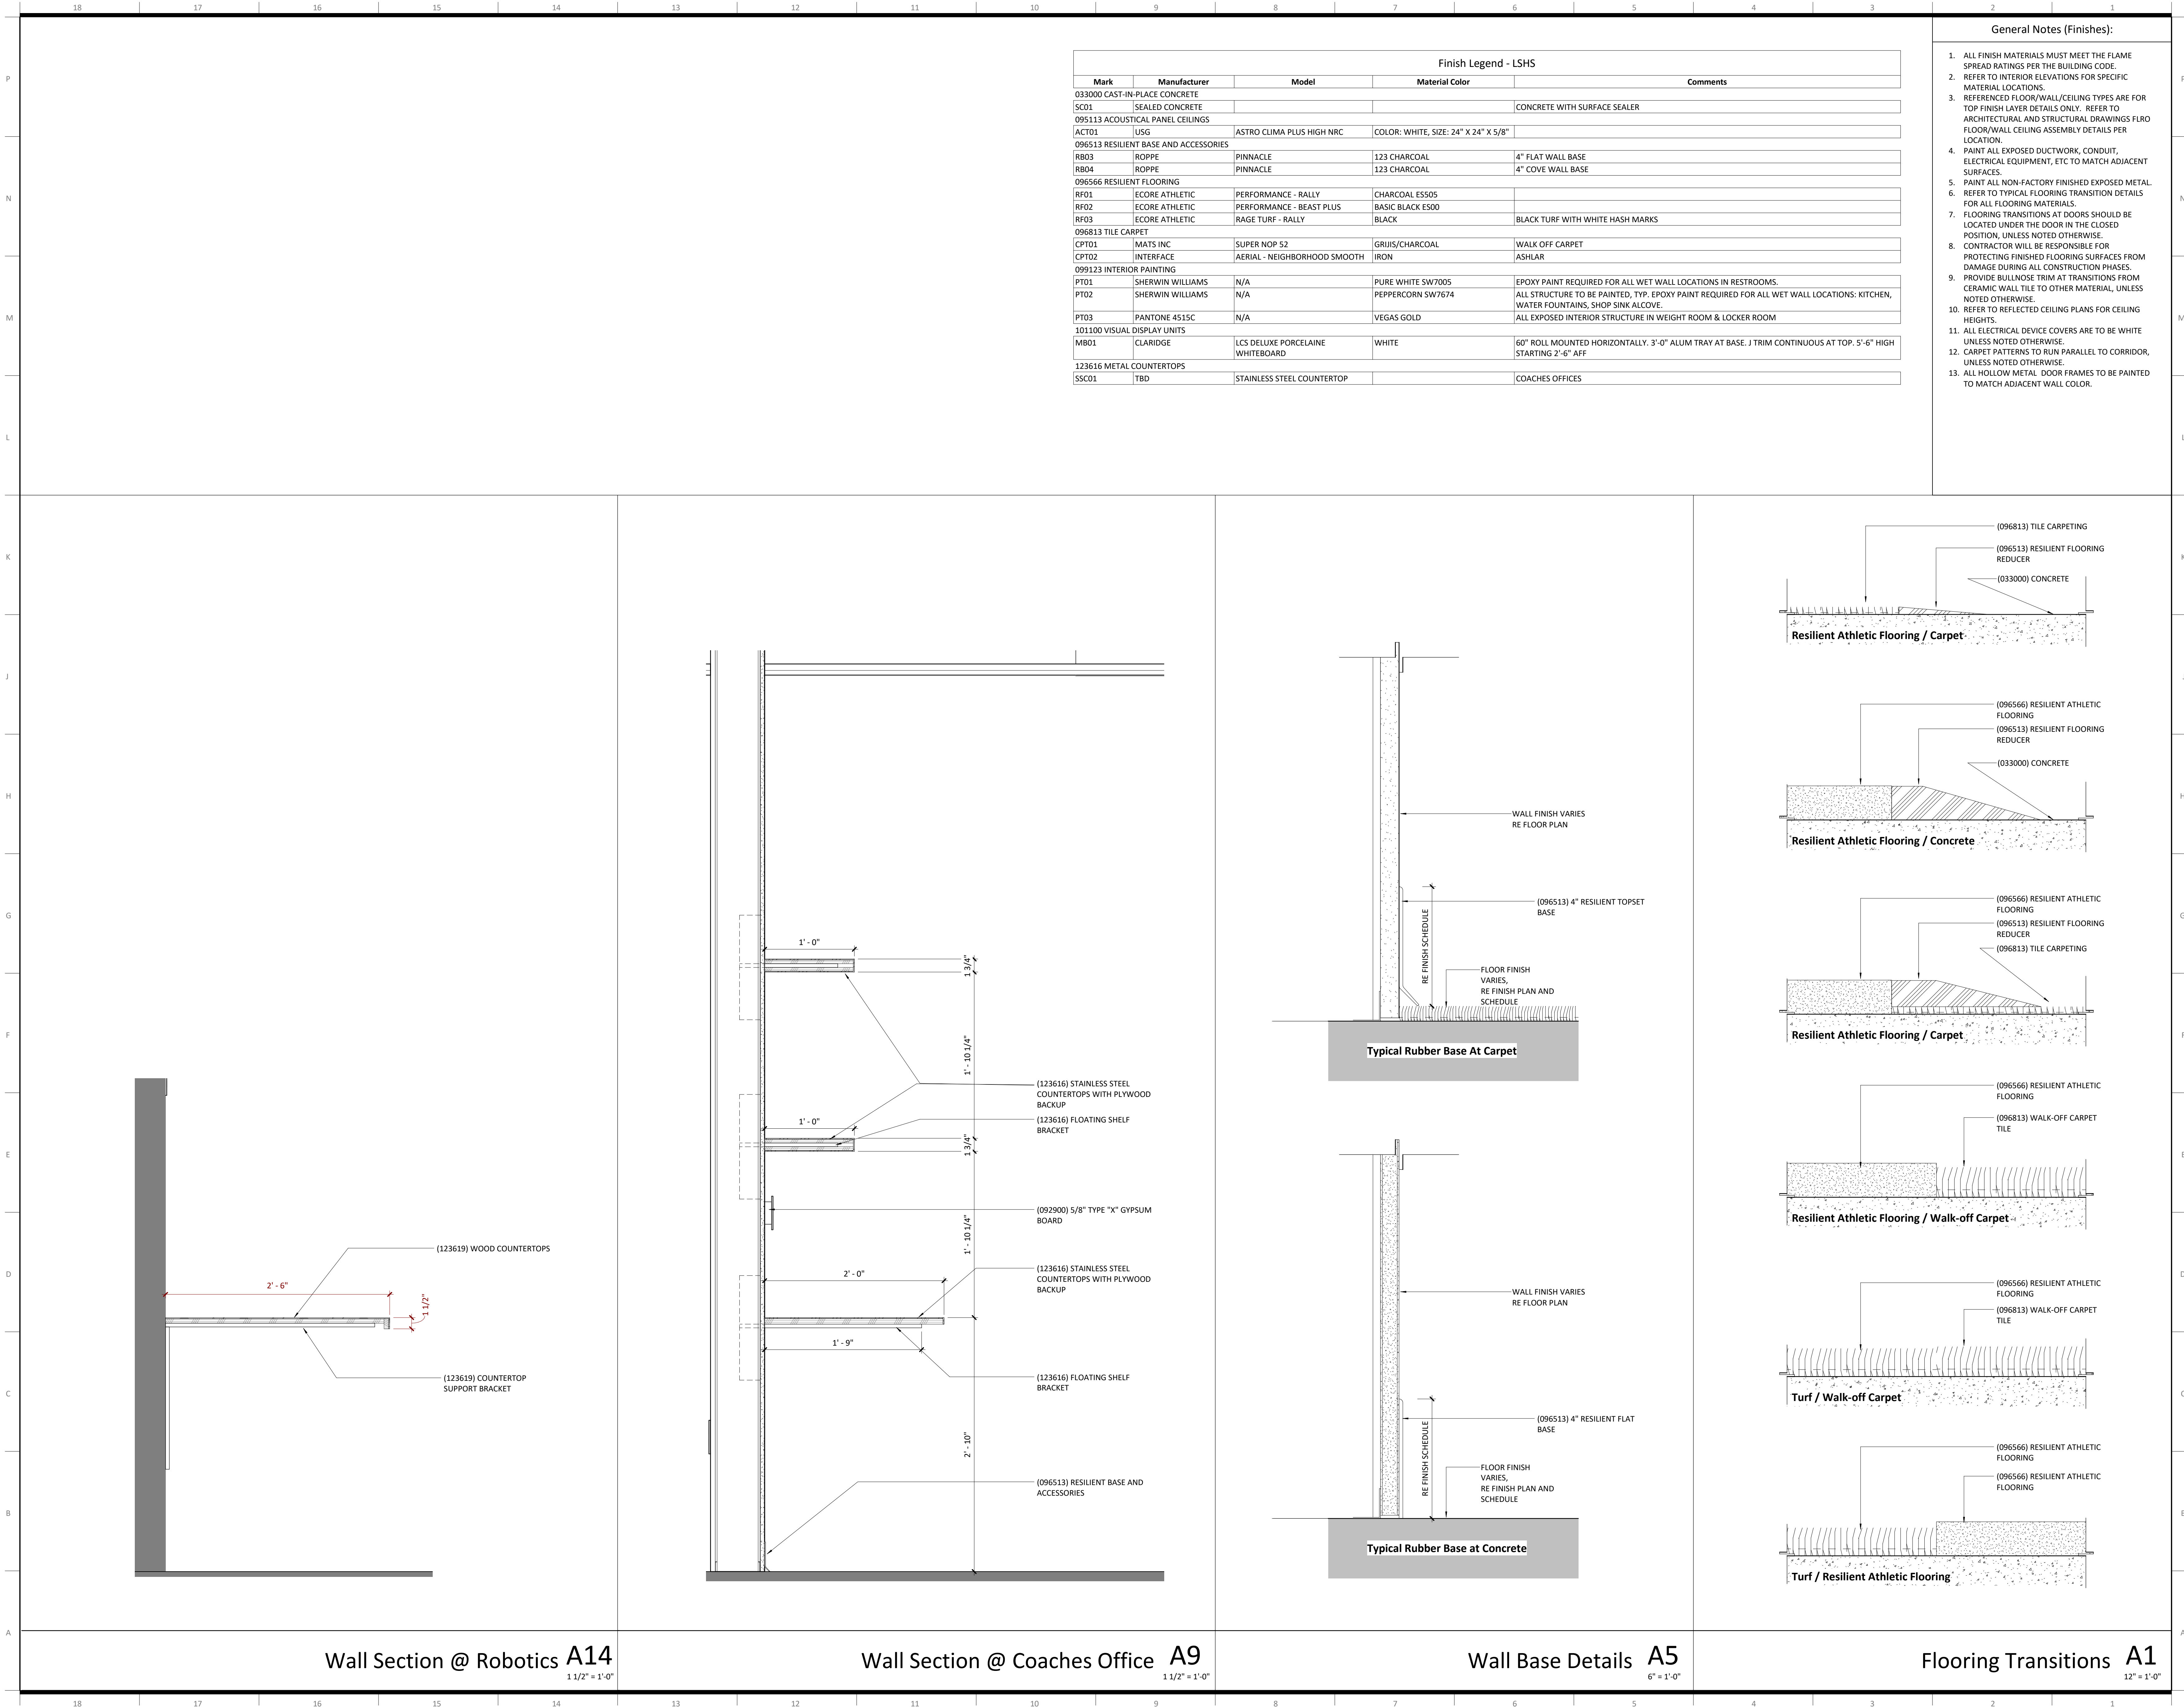

multistudio

the evolution of gould evans

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086

LSW: 2600 SW Ward Rd, Lee's Summit MO 64082

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100

owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect: Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi.studio

civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveeng.com

structural engineer: Bob D. Campbell & Associates  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/IT/Code: Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

Issue Date: September 9, 2022

Revisions		
NUMBER	DESCRIPTION	DATE

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

STATE OF MISSOURI

ADAM LEE STERNIS

NUMBER A-7460

REGISTERED PROFESSIONAL

Finish Legend & Details

AF001-C



Project Number: 0121-0


MEPFT/Code::  
**Henderson Engineers**  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
[www.hendersonengineers.com](http://www.hendersonengineers.com)

- Issue Date: September 9, 2019


UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS  
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR  
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



# AF101-C

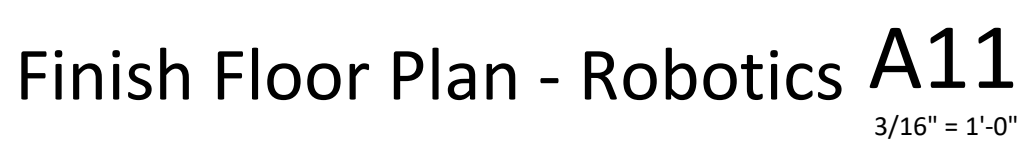



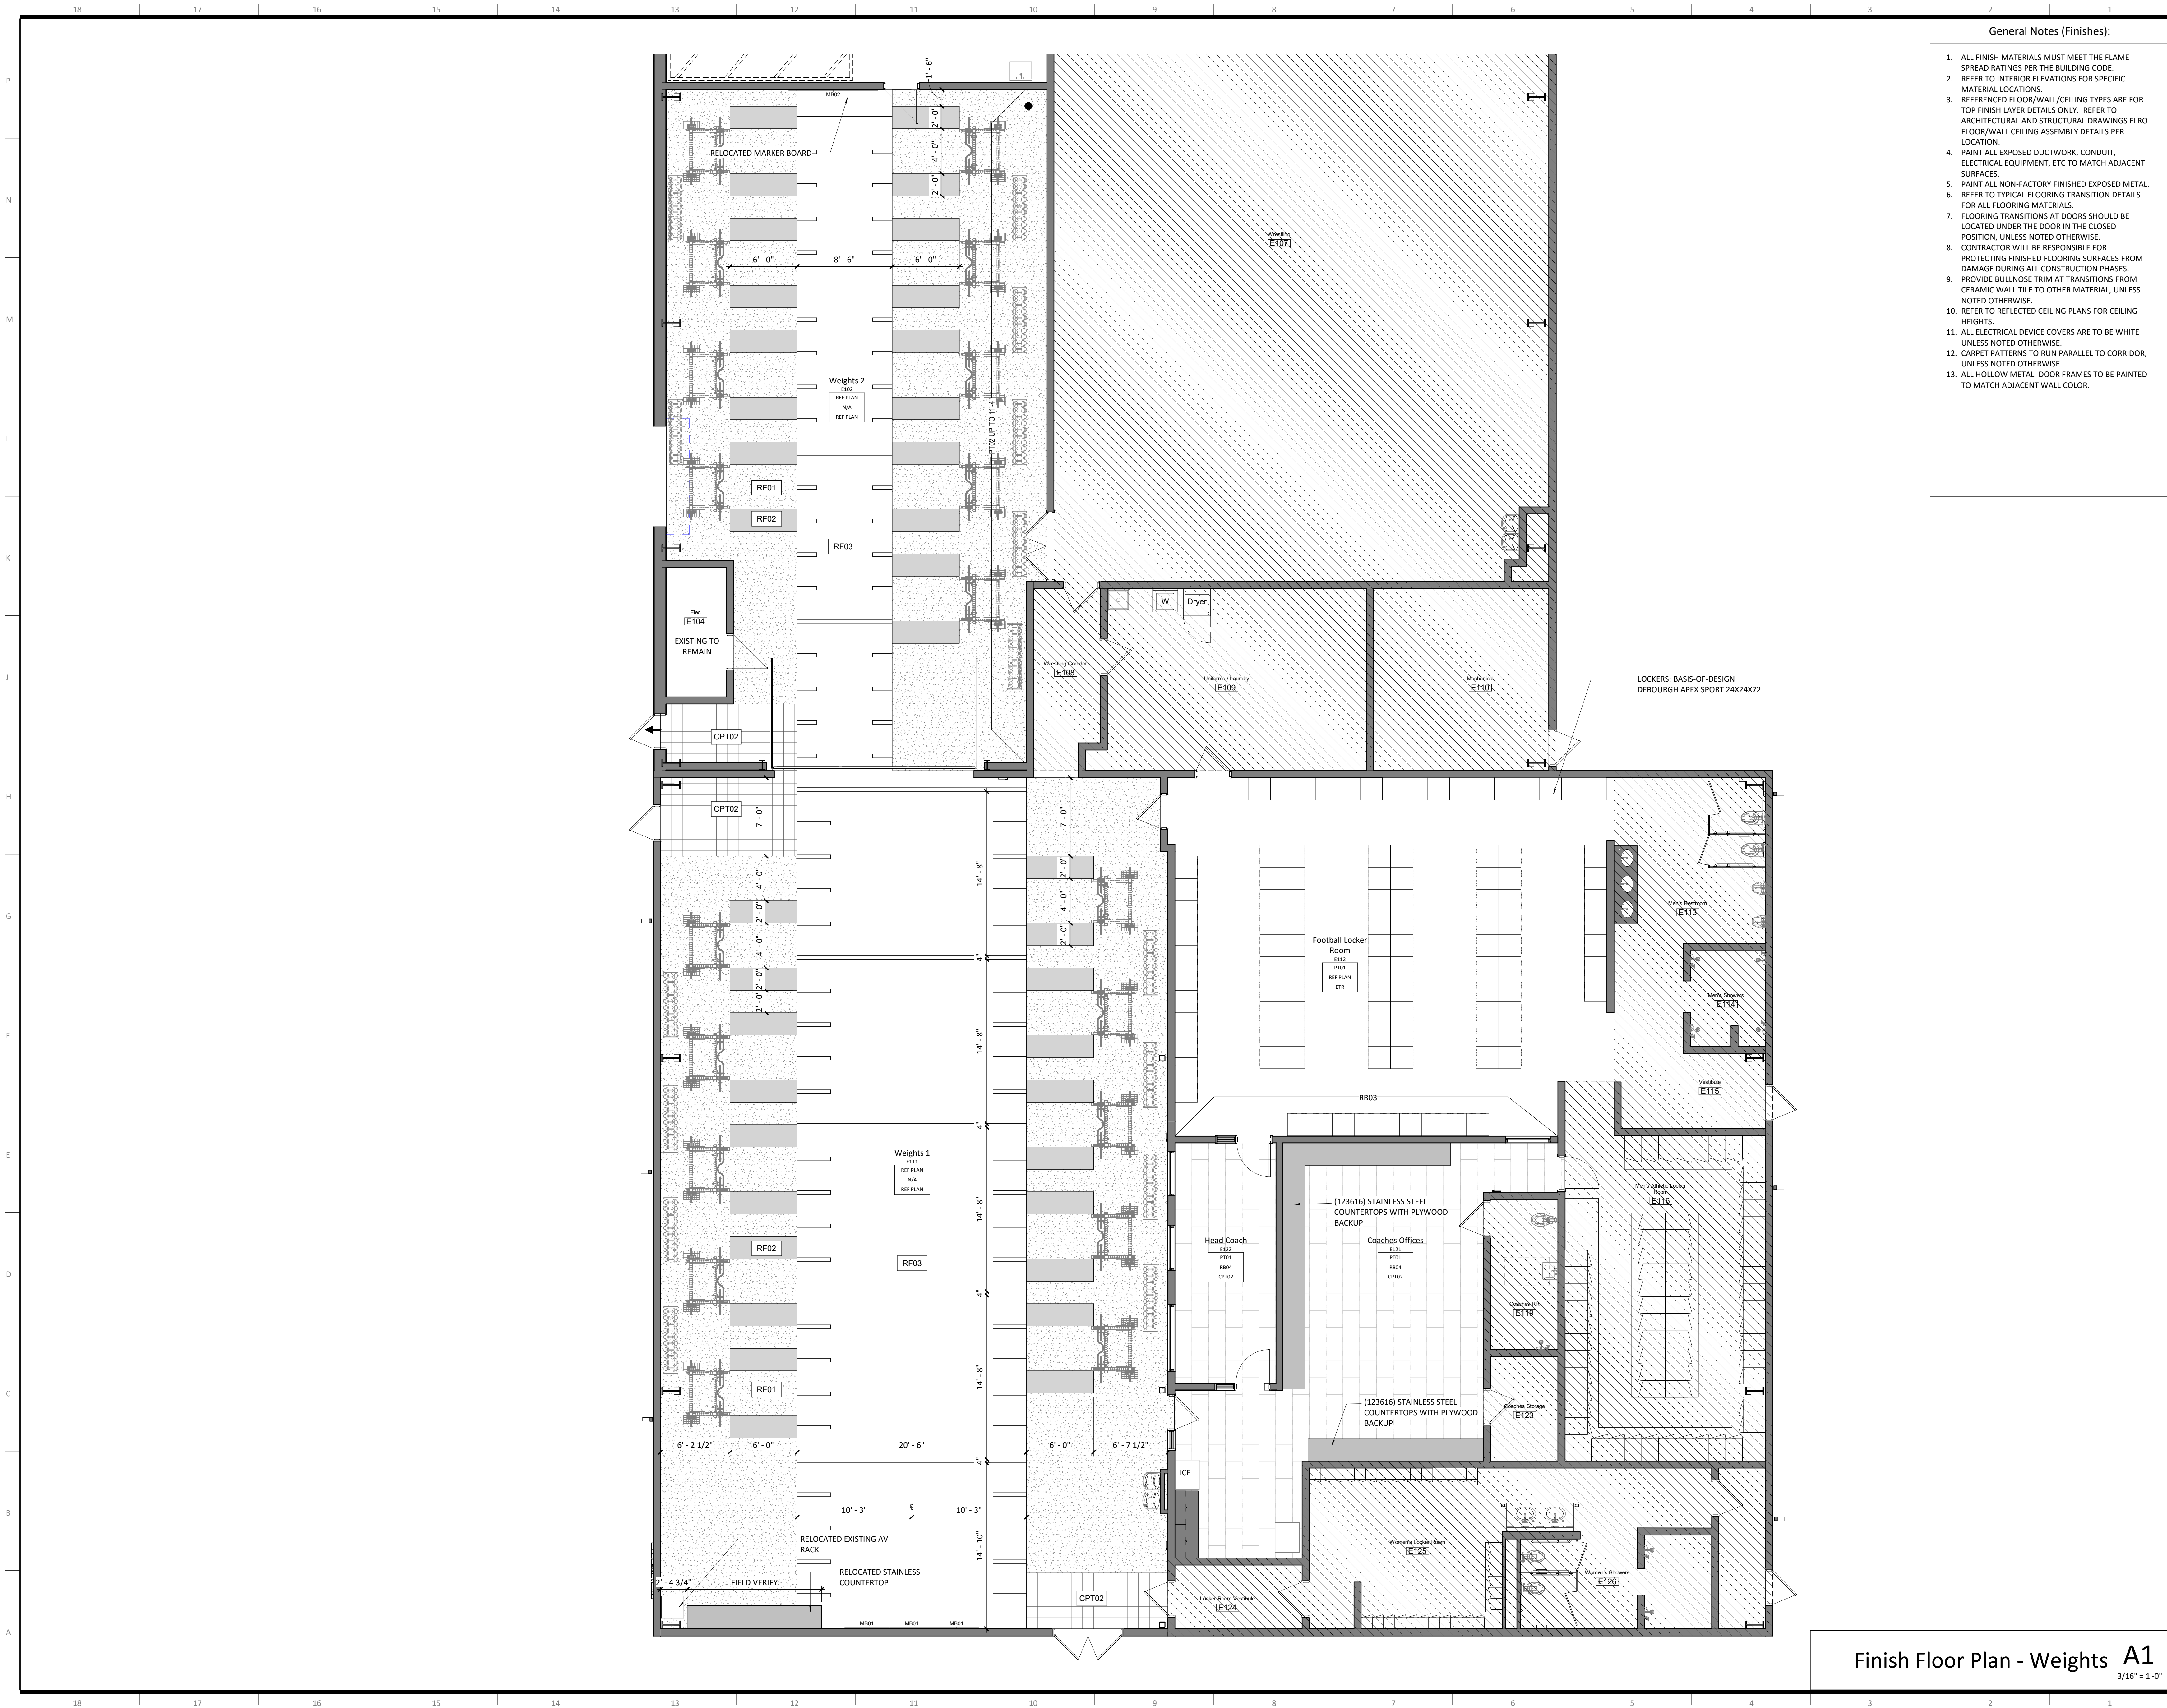

- General Notes (Finishes):
1. ALL FINISH MATERIALS MUST MEET THE FLAME SPREAD RATINGS PER THE BUILDING CODE.
  2. REFER TO INTERIOR ELEVATIONS FOR SPECIFIC MATERIAL LOCATIONS.
  3. REFERENCED FLOOR/WALL/CEILING TYPES ARE FOR TOP FINISH LAYER DETAILS ONLY. REFER TO ARCHITECTURAL AND STRUCTURAL DRAWINGS FLOOR/WALL/CEILING ASSEMBLY DETAILS PER LOCATION.
  4. PAINT ALL EXPOSED DUCTWORK, CONDUIT, ELECTRICAL EQUIPMENT, ETC TO MATCH ADJACENT SURFACES.
  5. PAINT ALL NON-FACTORY FINISHED EXPOSED METAL.
  6. REFER TO TYPICAL FLOORING TRANSITION DETAILS FOR ALL FLOORING MATERIALS.
  7. FLOORING TRANSITIONS AT DOORS SHOULD BE LOCATED UNDER THE DOOR IN THE CLOSED POSITION, UNLESS NOTED OTHERWISE.
  8. CONTRACTOR WILL BE RESPONSIBLE FOR PROTECTING FINISHED FLOORING SURFACES FROM DAMAGE DURING ALL CONSTRUCTION PHASES.
  9. PROVIDE BULLNOSE TRIM AT TRANSITIONS FROM CERAMIC WALL TILE TO OTHER MATERIAL, UNLESS NOTED OTHERWISE.
  10. REFER TO REFLECTED CEILING PLANS FOR CEILING HEIGHTS.
  11. ALL ELECTRICAL DEVICE COVERS ARE TO BE WHITE UNLESS NOTED OTHERWISE.
  12. CARPET PATTERNS TO RUN PARALLEL TO CORRIDOR, UNLESS NOTED OTHERWISE.
  13. ALL HOLLOW METAL DOOR FRAMES TO BE PAINTED TO MATCH ADJACENT WALL COLOR.

multistudio  
the evolution of gould evans

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100

owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect: Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi.studio

civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kvereng.com

structural engineer: Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/T/Code: Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

Issue Date: September 9, 2022

Revisions		
NUMBER	DESCRIPTION	DATE

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



Finish Floor Plan - Weights

AF102-C

Finish Floor Plan - Weights A1  
3/16" = 1'-0"



LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086  
multi-studio

architect:  
Multistudio  
4205 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
www.multistudio.com

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kvang.com

structural engineer:  
Bob D. Campbell &  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/IT/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

Issue Date: September 9, 2022


Revisions		
NUMBER	DESCRIPTION	DATE

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



Furniture Plan -  
Building D & E

AF103-C

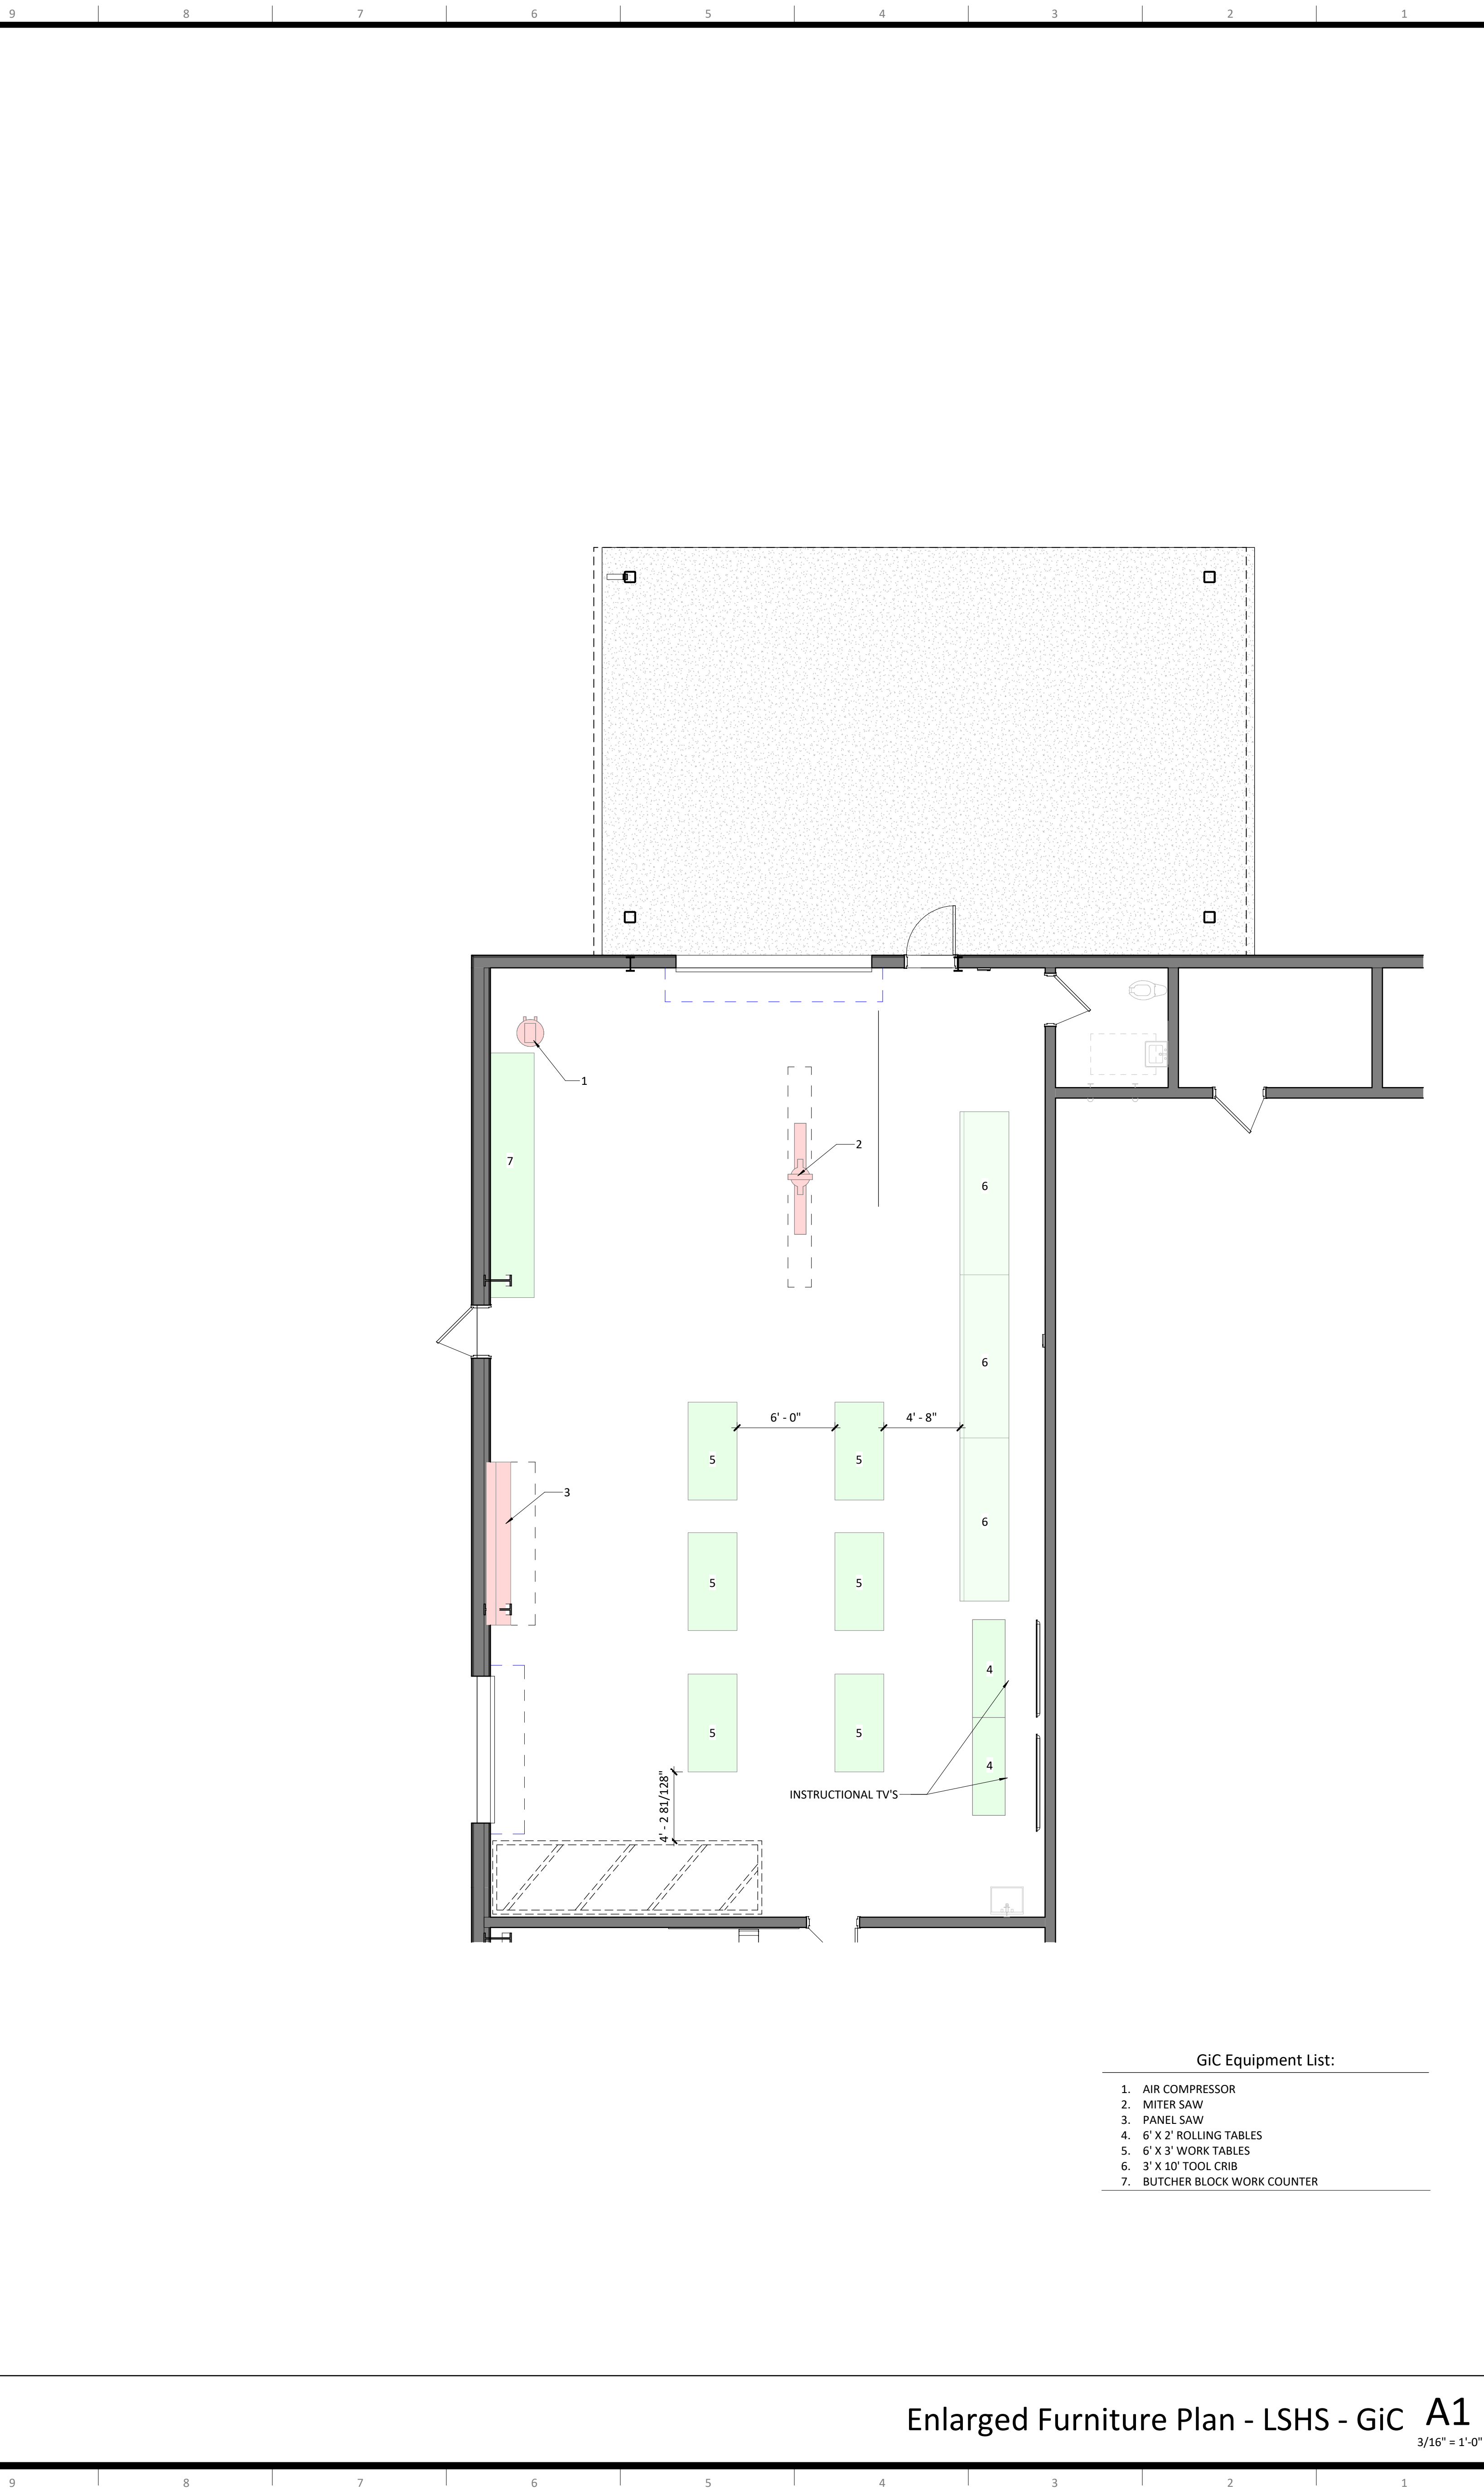



LSR7 Robotics, GiC &  
Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO  
64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO  
64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4209 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi-studio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com

structural engineer:  
Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/IT/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com



8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM  
2150005255  
MO. CORPORATE NO. E-6580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

NUMBER	DESCRIPTION	DATE
2	Addendum 02	09/23/2022




CARL J. HOLDEN  
LICENSE # PE-2020016283

LSHS - PLUMBING  
DEMOLITION PLAN -  
LEVEL 1 - BUILDING D &  
E


PD101-C

PLUMBING DEMOLITION PLAN NOTES:

- PD1 REMOVE EXISTING PLUMBING FIXTURES IN THIS AREA AS WELL AS PIPING (WASTE, VENT, HOT AND COLD WATER) TO BELOW FINISHED FLOOR AND TO ACTIVE MAINS ABOVE CEILING AND CAP.
- PD2 REMOVE EXISTING PLUMBING FIXTURE AS WELL AS PIPING (WASTE, VENT, HOT AND COLD WATER) TO BELOW FINISHED FLOOR AND TO ACTIVE MAINS ABOVE CEILING AND CAP. KEEP EXISTING PLUMBING FIXTURE FOR INSTALLATION UNDER NEW WORK.
- PD3 DEMO ABANDONED GAS PIPING TO THE CONSTRUCTION AREA BOUNDARY AND CAP.
- PD4 DEMO ACTIVE GAS PIPING TO APPROXIMATELY 15 FEET SOUTH OF NEW ADDITION AND CAP FOR FUTURE CONNECTION UNDER NEW WORK.
- PD5 RETAIN EXISTING GAS PRESSURE REGULATOR SET FOR USE IN NEW WORK.
- PD6 REMOVE EXISTING WATER SERVICE ENTRY.
- PD7 REMOVE EXISTING COMPRESSED AIR PIPING AND ASSOCIATED ACCESSORIES. RETAIN PRESSURE REGULATOR FOR NEW WORK.
- PD8 REMOVE EXISTING PLUMBING PIPING (SANITARY AND GAS) TO BELOW FINISHED FLOOR AND TO ACTIVE MAINS ABOVE CEILING AND CAP. REPAIR REMAINING SURFACES TO MATCH EXISTING WHERE REQUIRED.
- PD9 EXISTING PLUMBING FIXTURE SHALL REMAIN. PROTECT FROM DAMAGE DURING DEMOLITION AND RENOVATION.
- PD10 REMOVE EXISTING PLUMBING FIXTURE AND CAP PIPING (SANITARY, VENT, HOT AND COLD WATER) AT WALL FOR RECONNECTION UNDER NEW WORK.
- PD11 REMOVE EXISTING COMPRESSED AIR PIPING, REMOVE AIR COMPRESSOR TANK AND COMPRESSED AIR DRYER AND RELINQUISH TO OWNER.
- PD12 CUT AND PATCH EXISTING WALL AND CONCRETE FLOOR SLABS REQUIRED FOR PREP OF INSTALLATION OF FIXTURE IN NEW WORK.
- PD13 CAP AND ABANDON EXISTING VENT THROUGH ROOF WITH NEW PIPE CAPS ABOVE AND BELOW ROOF.
- PD14 REMOVE EXISTING WALL HYDRANT AS WELL AS PIPING (COLD WATER) TO ACTIVE MAIN ABOVE CEILING AND CAP.

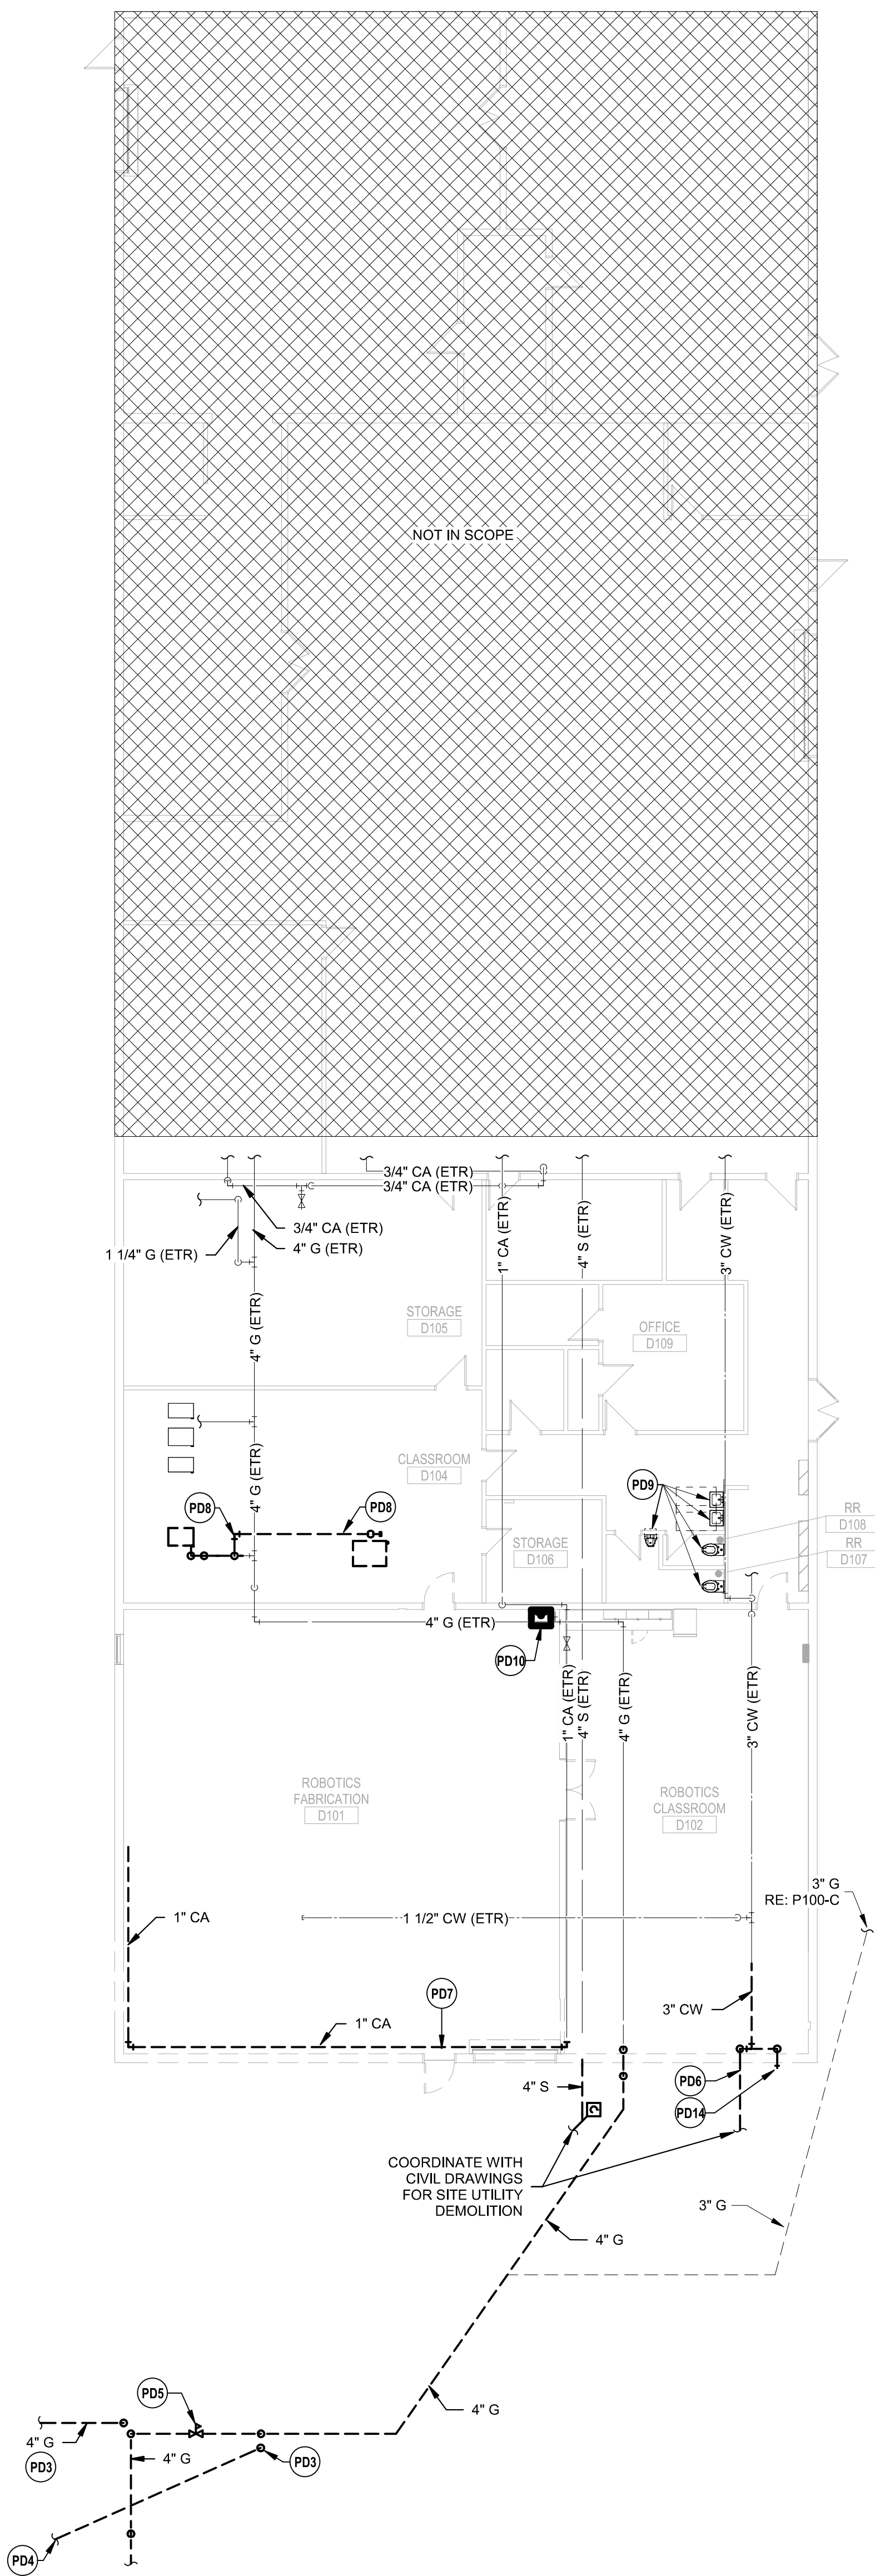

1 BSHS - PLUMBING DEMOLITION PLAN - LEVEL 1 - BUILDING D  
3/32" = 1'-0"

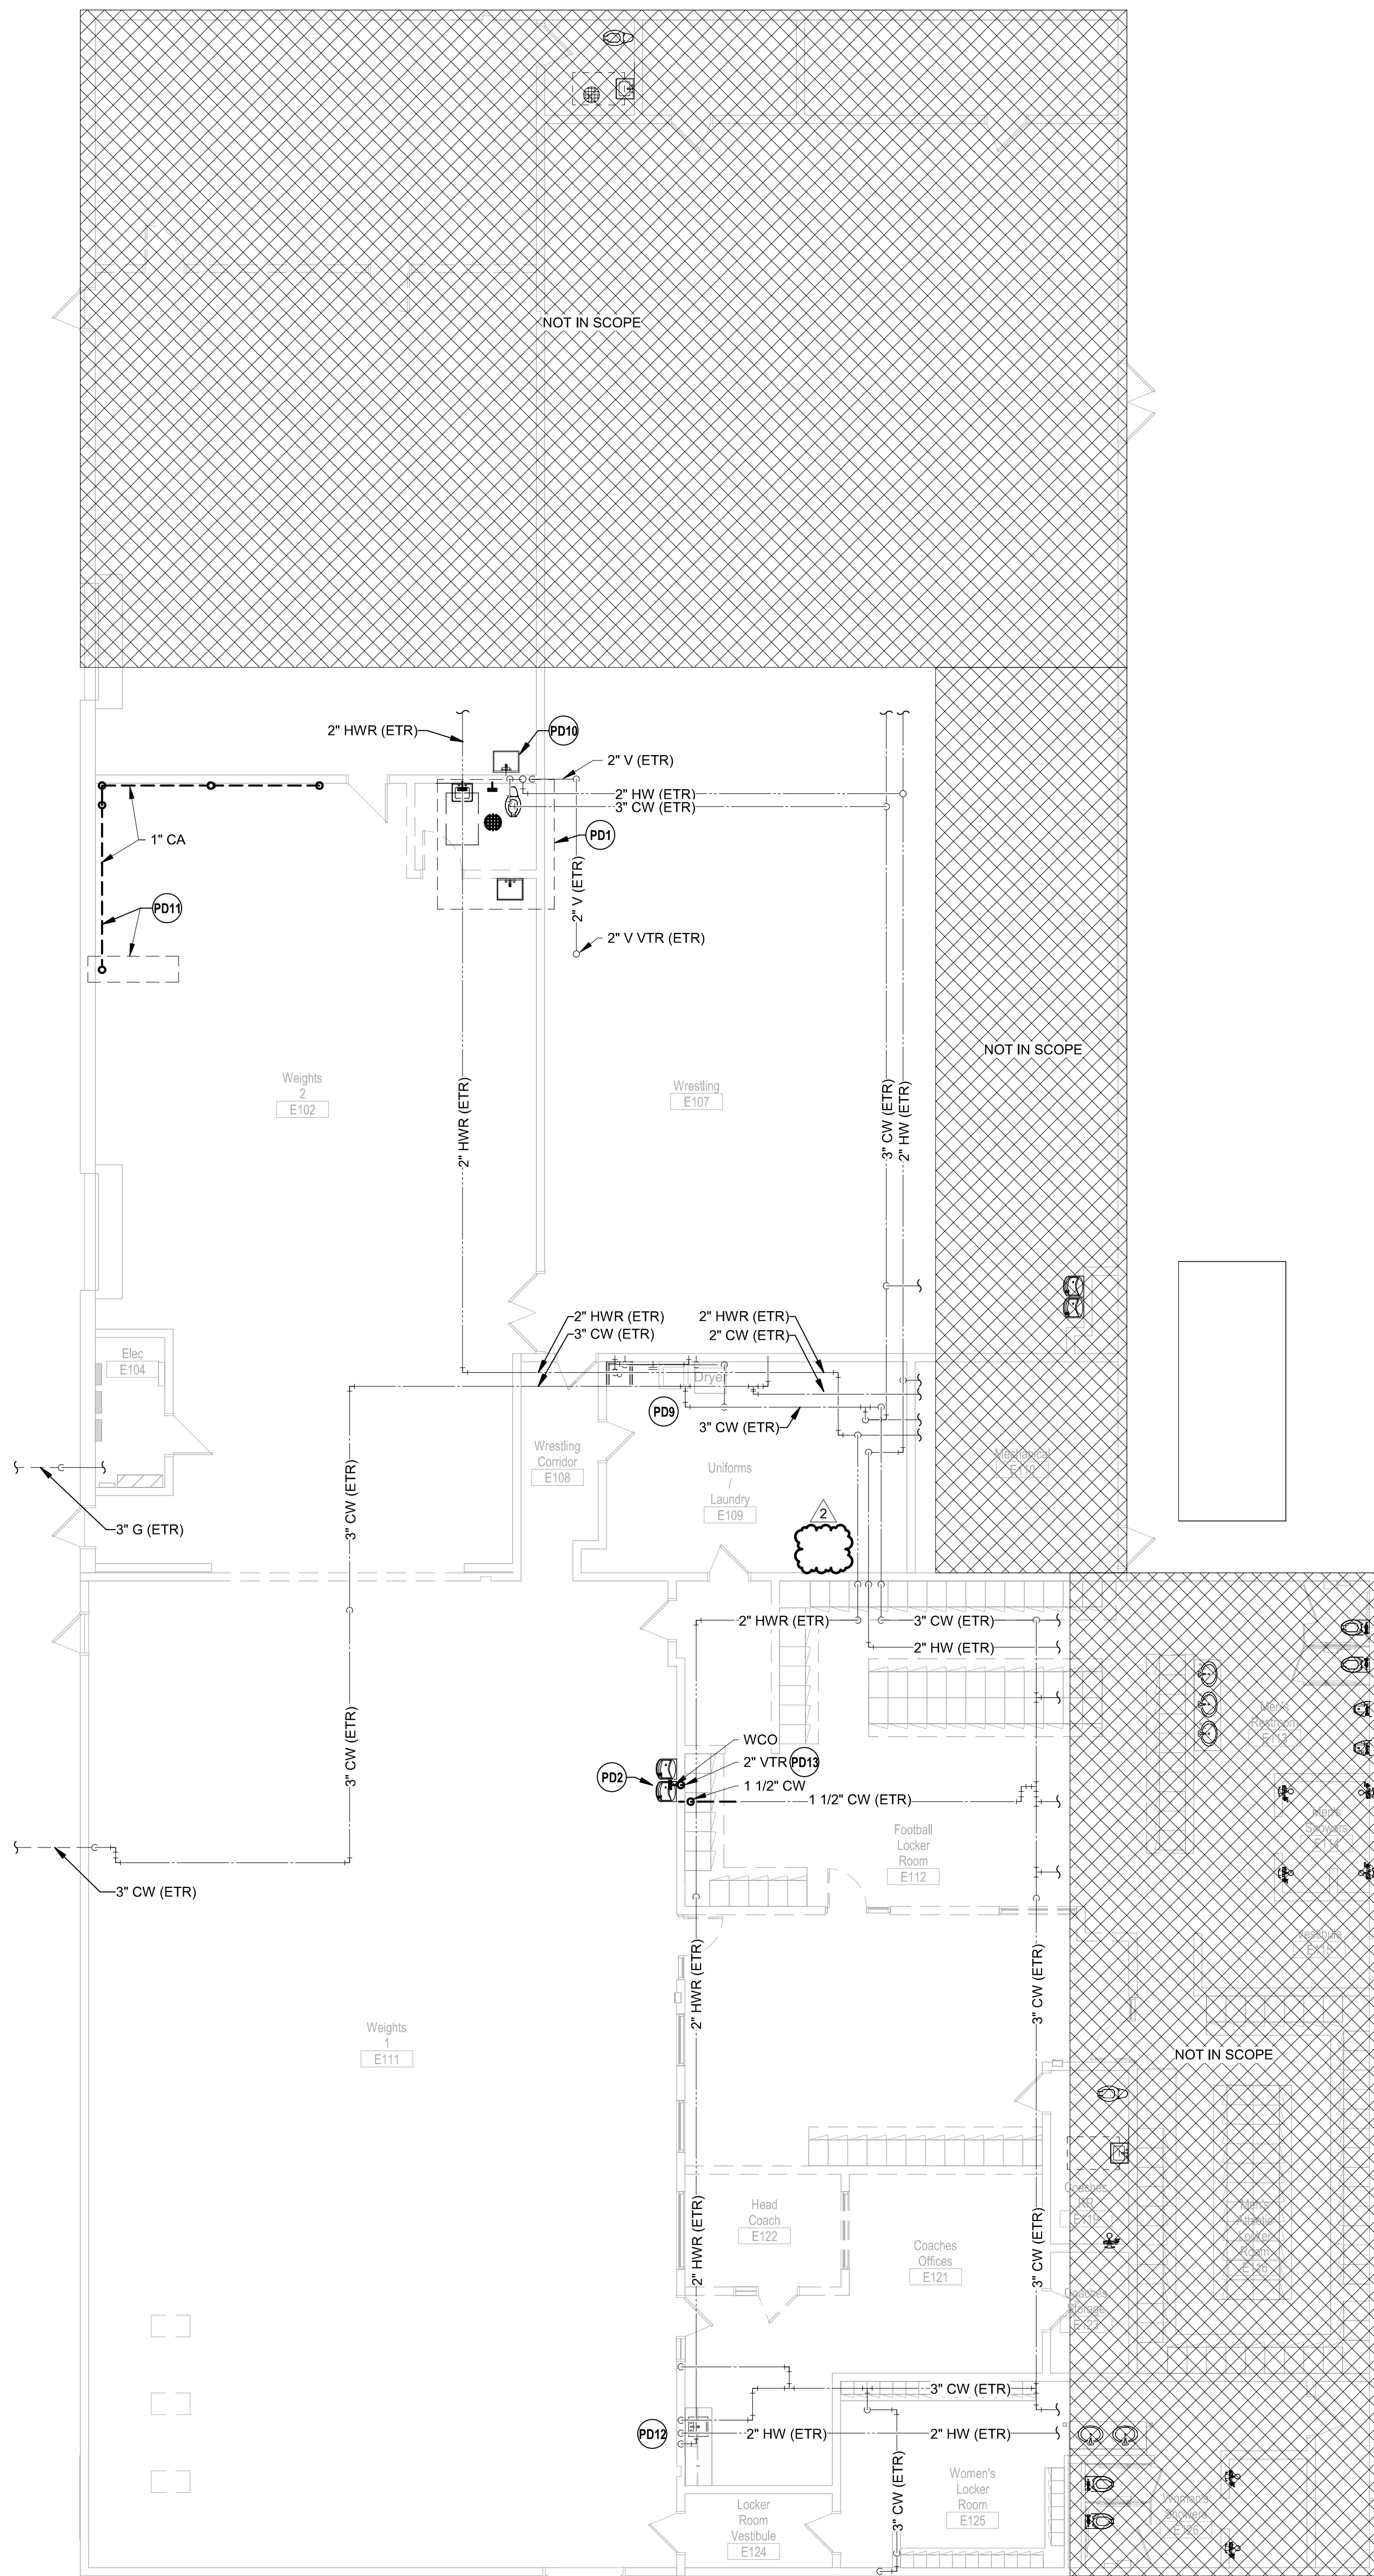

2 LSHS - PLUMBING DEMOLITION PLAN - LEVEL 1 - BUILDING E  
1/8" = 1'-0"



0121-0

civil engineer:  
**Kaw Valley Engineering**  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com

structural engineer:  
**Bob D. Campbell & Company**  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

 ENGINEERS

**WWW.HENDERSONENGINEERS.COM**

## Revisions



PROCEEDINGS  
PE-2020016283  
VOLUME

CARL J. HOLDEN  
LICENSE # DE-2020016282

## LEGEND AND GENERAL

**P000-C**

\_\_\_\_\_

THIS IS A MASTER LEGEND AND NOT ALL SYMBOLS OR ABBREVIATIONS ARE USED.

THIS IS A MASTER LEGEND AND NOT ALL SYMBOLS OR ABBREVIATIONS ARE USED.

V2.02

---



LSR7 Robotics, GiC &  
Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO  
64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO  
64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi-studio

0121-0100

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com

structural engineer:  
Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/ET/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

**HENDERSON**  
ENGINEERS  
8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM  
2150005255  
MO. CORPORATE NO. E-858D  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions		
NUMBER	DESCRIPTION	DATE
2	Addendum 02	09/23/2022



CARL J. HOLDEN  
LICENSE # PE-2020016283

LSHS - PLUMBING SITE  
PLAN  
**P100-C**

1 LSHS - PLUMBING SITE PLAN  
1" = 20'-0"



LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4209 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi.studio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com

structural engineer:  
Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/T/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com



8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM  
2150005255  
MO. CORPORATE NO. E-5580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions

NUMBER	DESCRIPTION	DATE
2	Addendum 02	09/23/2022




CARL J. HOLDEN  
LICENSE # PE-2020016283

LSHS - PLUMBING PLAN  
- LEVEL 1 - BUILDING D  
& E


P101-C

PLUMBING PLAN NOTES:

- P3 CONNECT RELOCATED PLUMBING FIXTURE TO EXISTING PLUMBING PIPING (WASTE, VENT, AND COLD/HOT WATER) IN THIS AREA. PROVIDE ADDITIONAL PIPING AND INSULATION TO MATCH EXISTING AS REQUIRED. REPAIR AND MATCH FINAL FINISH PER ARCHITECTURAL INSTRUCTIONS.
- P5 CUT AND PATCH EXISTING CONCRETE FLOOR SLAB FOR INSTALLATION OF NEW UNDERGROUND PLUMBING PIPE. REPAIR AND MATCH FINAL FINISH PER ARCHITECTURAL INSTRUCTIONS.
- P6 EXISTING PLUMBING FIXTURE SHALL REMAIN. PROTECT FROM DAMAGE DURING DEMOLITION AND RENOVATION.
- P8 1/2" CA DROP WITH SHUTOFF VALVE. DROP TO 4" AFF
- P9 CONNECT NEW PLUMBING FIXTURE TO EXISTING PLUMBING SERVICE PIPING (WASTE, VENT, AND COLD/HOT WATER). PROVIDE ADDITIONAL PIPING AND INSULATION TO MATCH EXISTING AS REQUIRED
- P10 CONNECT NEW SANITARY PIPING TO EXISTING SANITARY PIPING IN THIS VICINITY. FIELD VERIFY THE EXACT LOCATION, SIZE AND INVERT ELEVATION OF PIPING PRIOR TO START OF INSTALLATION.

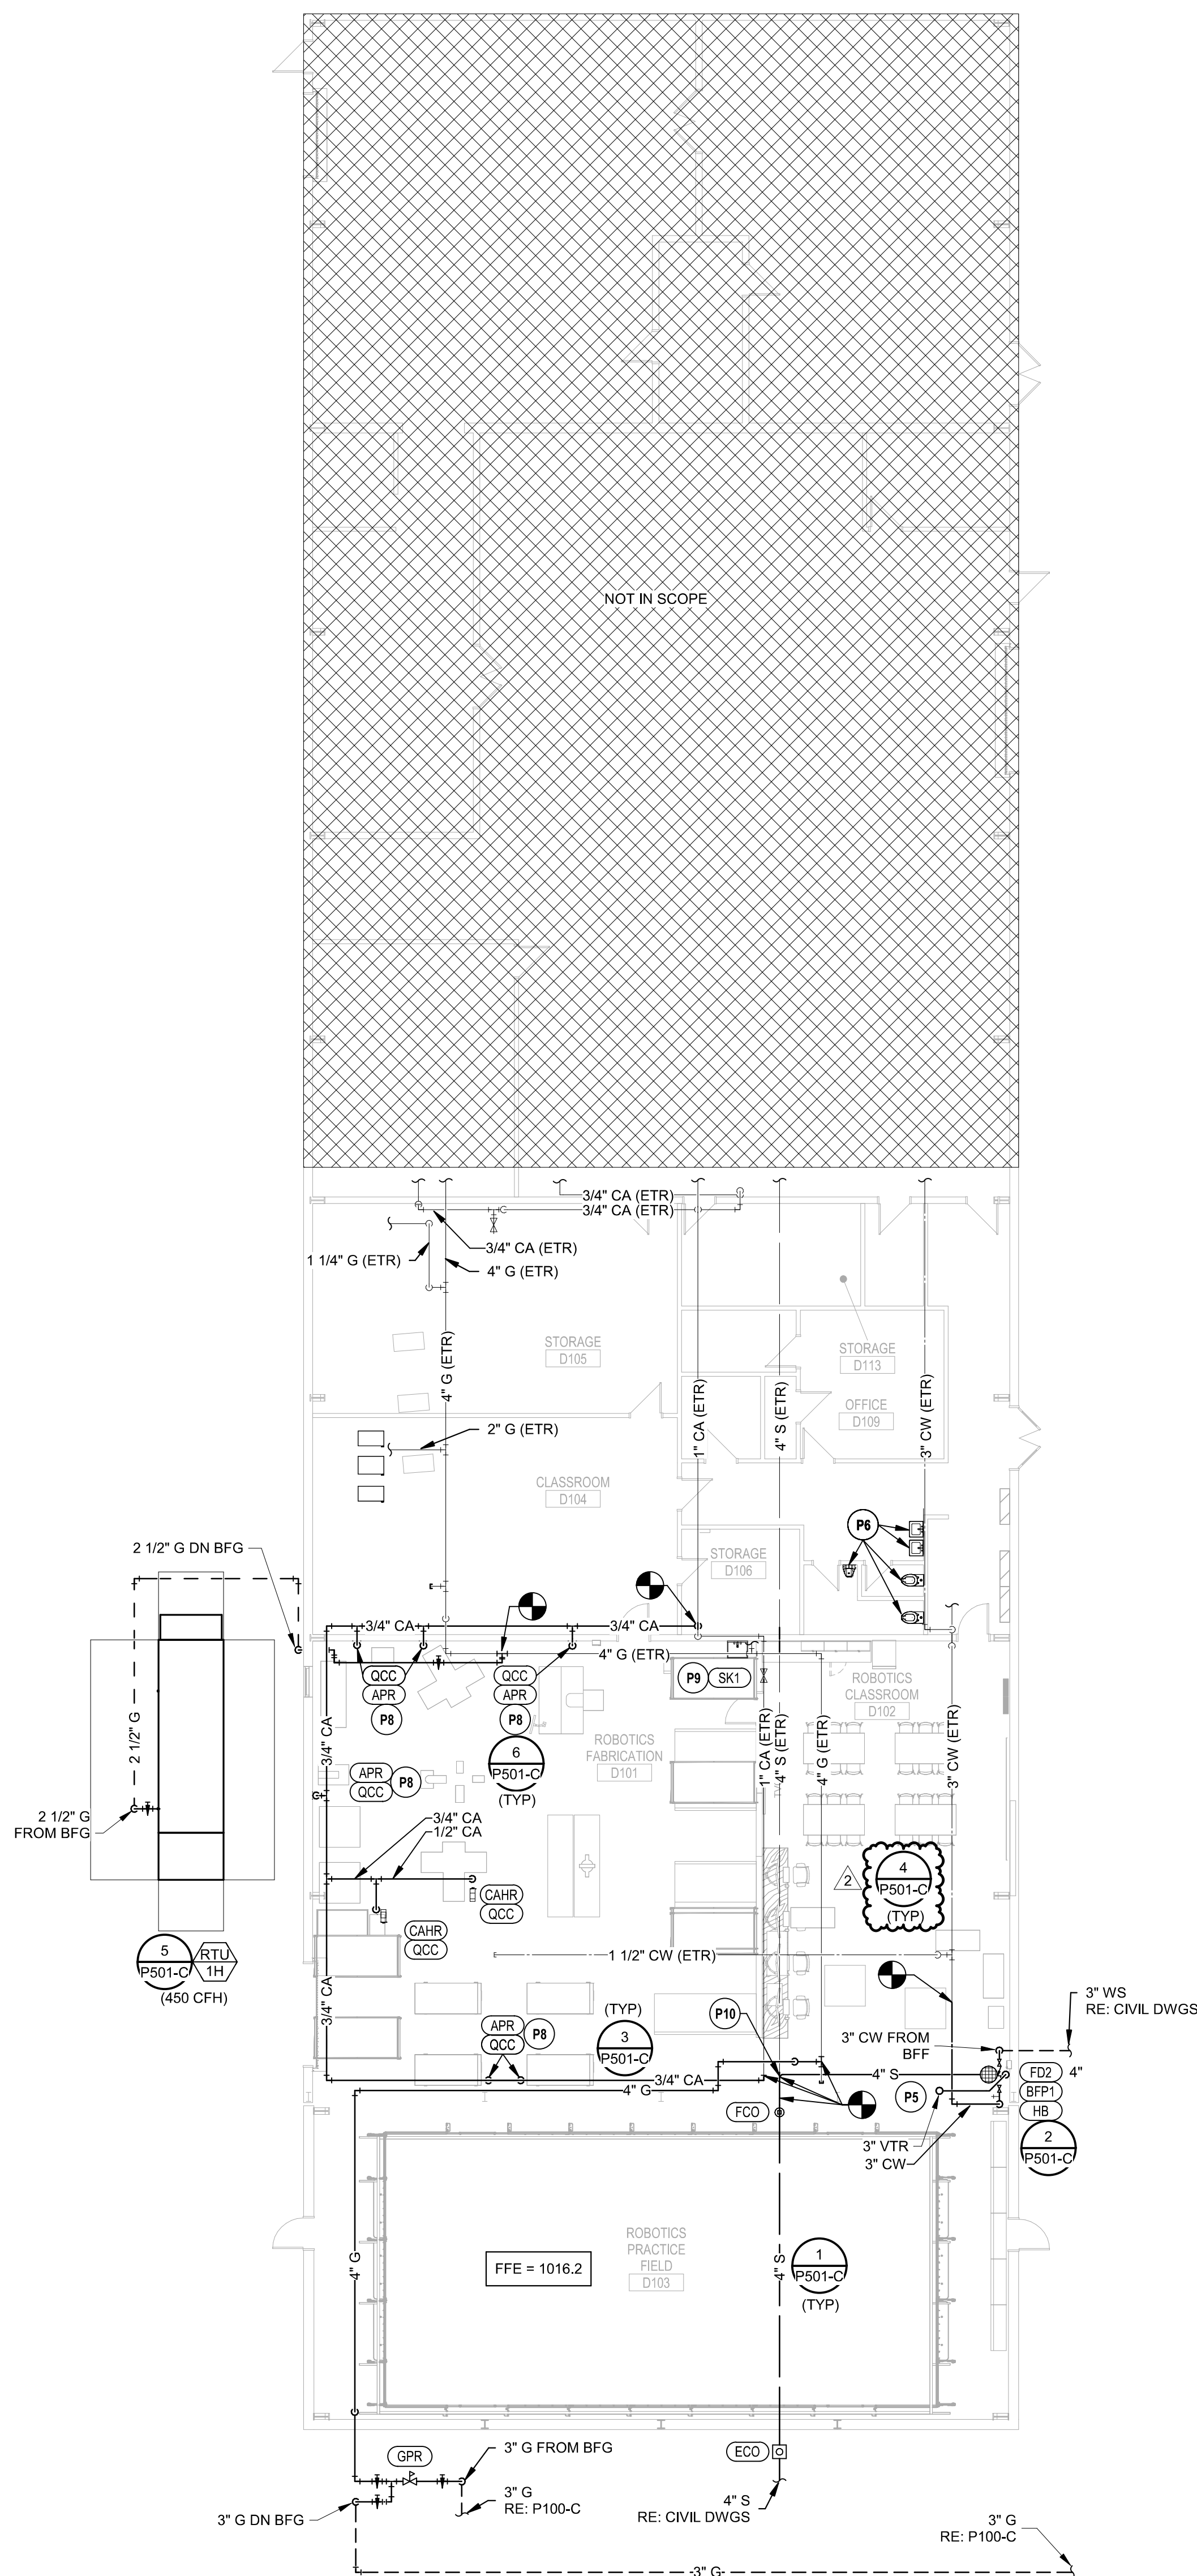

① LSHS - PLUMBING PLAN - LEVEL 1 - BUILDING D  
3/32" = 1'-0"

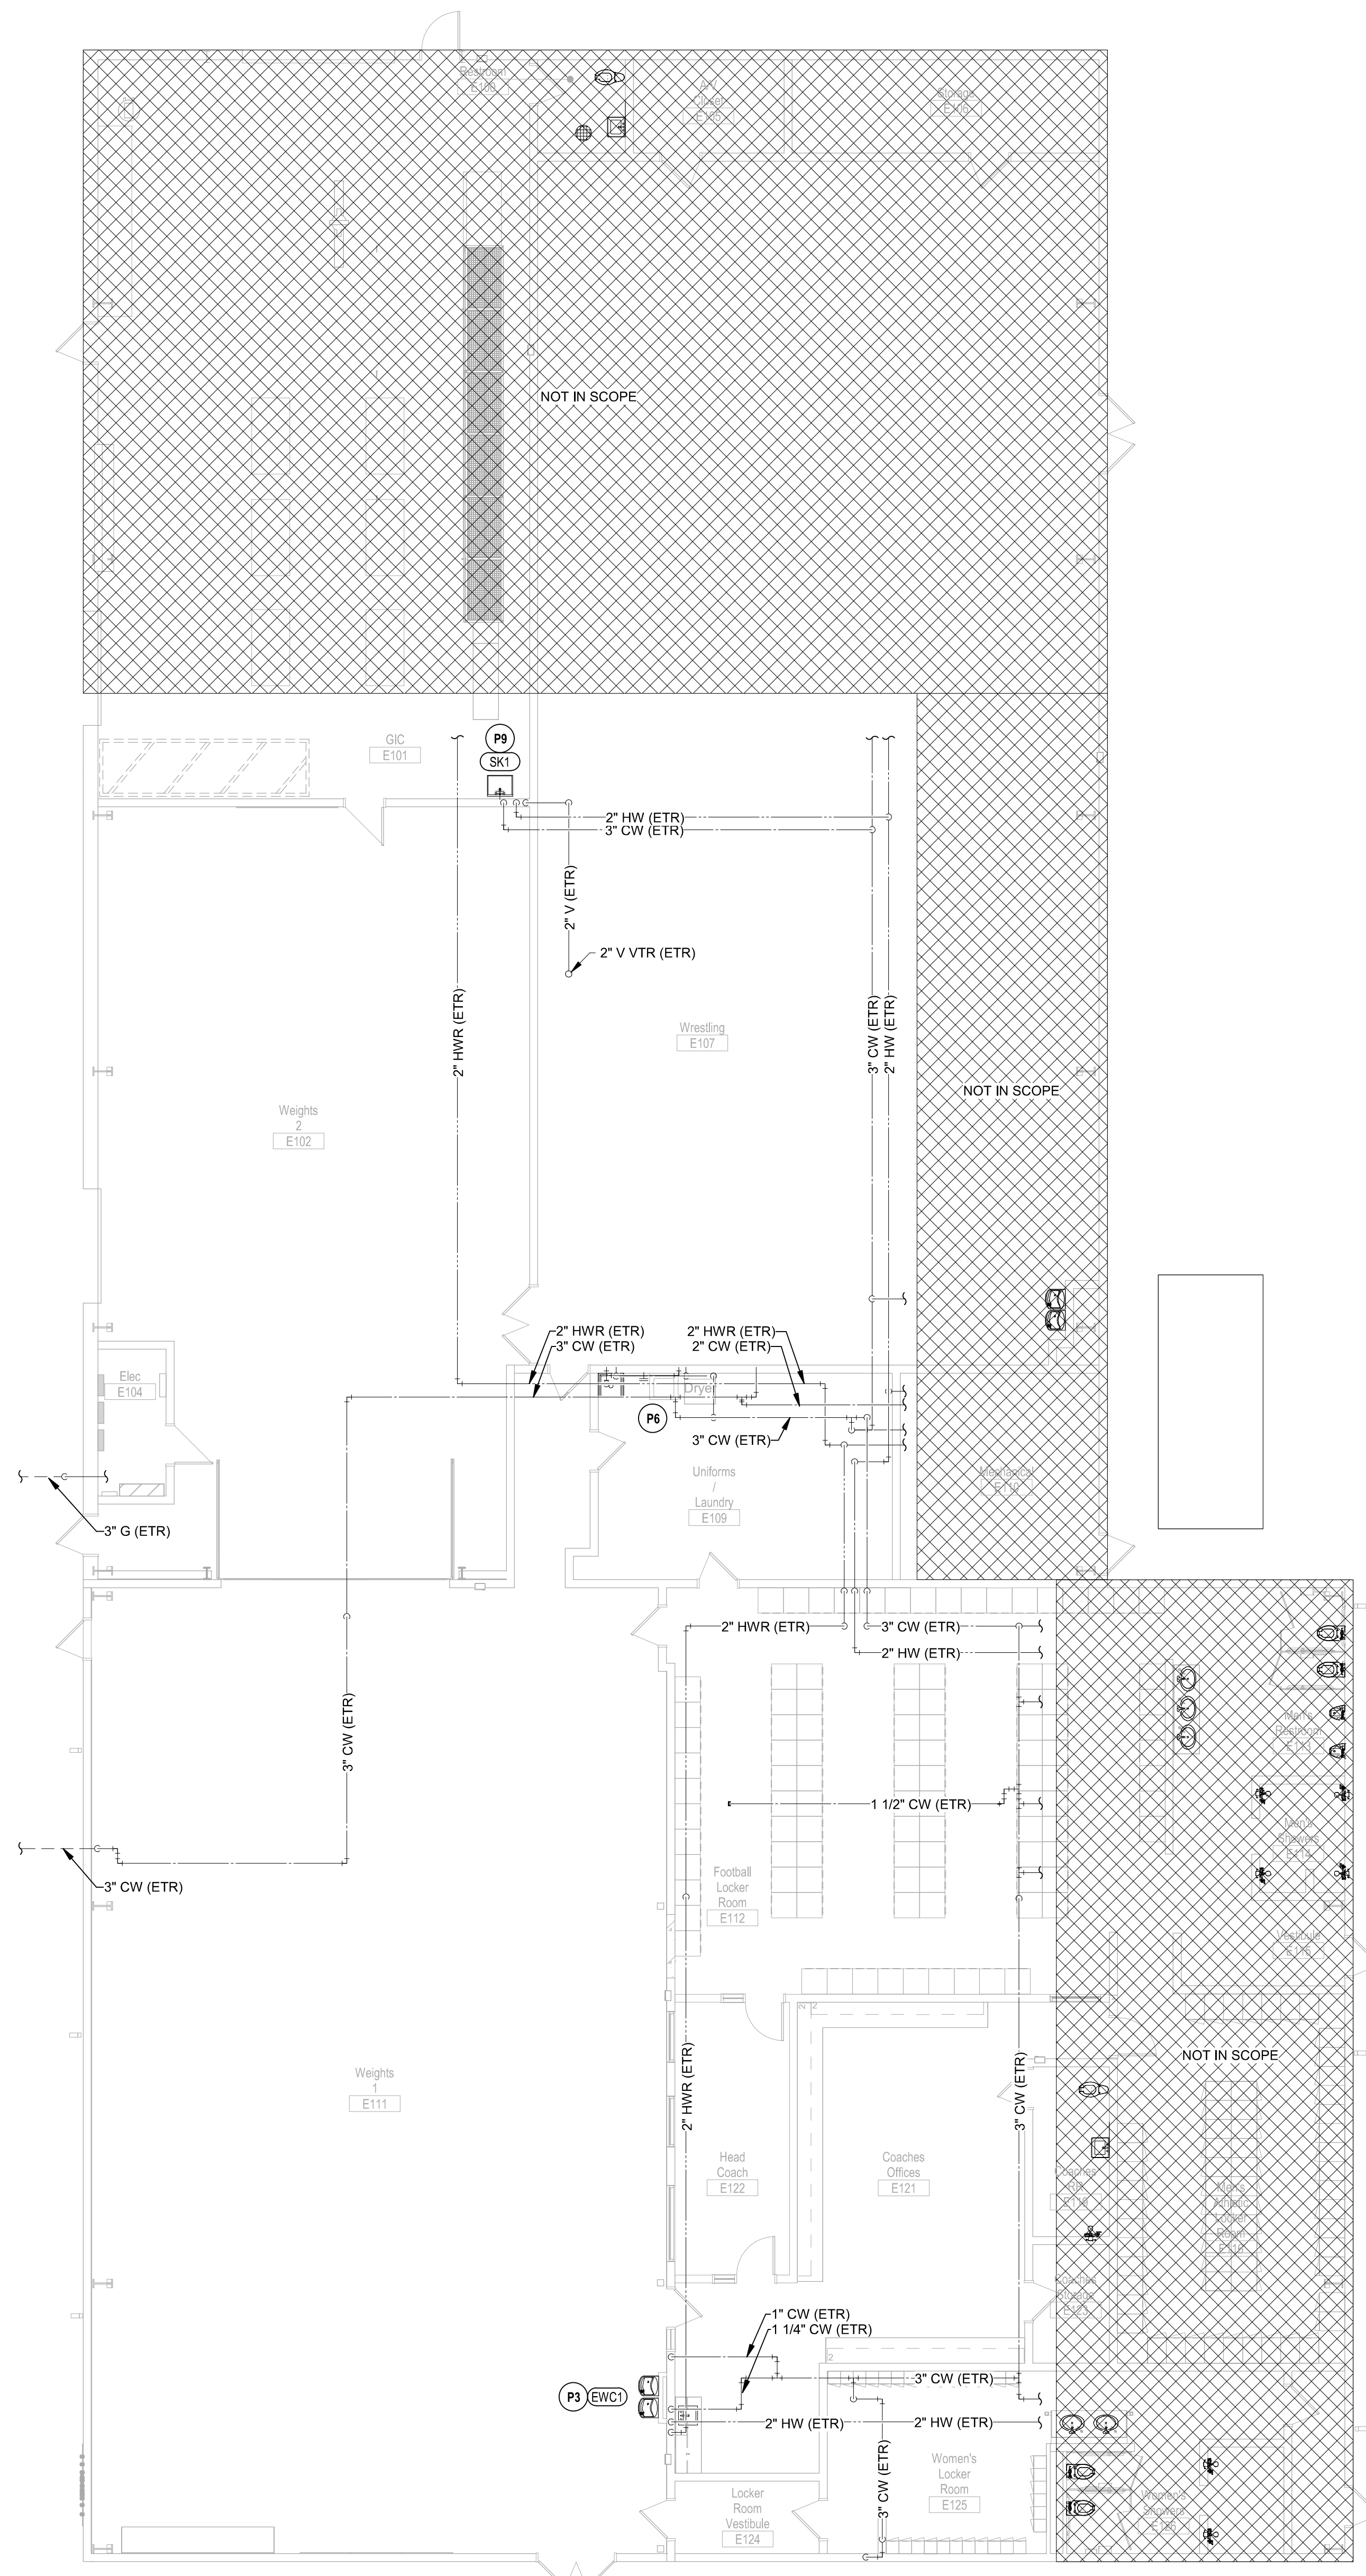

② LSHS - PLUMBING PLAN - LEVEL 1 - BUILDING E  
1/8" = 1'-0"



### ① PIPE AND TRENCH LOCATION



LSR7 Robotics, GiC &  
Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO  
64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO  
64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4209 Pennsylvania  
Kansas City, MO 64111  
816.591.6655  
mstudio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com

structural engineer:  
Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/T/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com



8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM  
2150005255  
MO. CORPORATE NO. E-8580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions		
NUMBER	DESCRIPTION	DATE



09/09/2022  
CARL J. HOLDEN  
LICENSE # PE-2020016283

LSHS - HVAC  
DEMOLITION PLAN -  
LEVEL 1 - BUILDING D &  
E

MD101-C

MECHANICAL DEMOLITION PLAN NOTES:

- MD1 DEMOLISH DUCT AND SUPPLY DIFFUSER(S) BACK TO MAIN. PROVIDE PERMANENT INSULATED SHEET METAL CAP OVER DUCT OPENING.
- MD4 DEMOLISH TRANSFER DUCT.
- MD5 DEMOLISH EXHAUST FAN AND ASSOCIATED DUCTWORK, GRILLES, AND CONTROLS. PROVIDE TEMPORARY TAP OVER ROOF FOR RE-USE OF PENETRATION IN NEW WORK.
- MD6 DEMOLISH EXHAUST TAP TO POINT SHOWN. PROVIDE TEMPORARY CAP OVER OPENING FOR RE-USE OF DUCT AND GRILLE IN NEW WORK.
- MD7 DEMOLISH EXHAUST GRILLE AND ASSOCIATED DUCTWORK.
- MD8 DEMOLISH ABANDONED IN PLACE CONDENSING UNIT.
- MD9 DEMOLISH EVAPORATOR COIL, FURNACE, ASSOCIATED CONDENSING UNIT, CONTROL DEVICES, AND PIPING. PROVIDE PERMANENT SHEET METAL CAP OVER PIPE/WALL EXTERIOR PENETRATIONS. SEAL PENETRATIONS AIR/WATER TIGHT.
- MD10 DEMOLISH ALL DUCTWORK AND SUPPLY GRILLES SERVED BY EVAP COIL AND FURNACE.
- MD11 DEMOLISH RELIEF LOUVER AND ASSOCIATED DUCTWORK/GRILLE. INFILL WALL OPENING TO MAINTAIN REQUIRED WALL RATING CALLED OUT IN NEW WORK. COORDINATE WITH ARCHITECTURAL PLANS FOR RECONSTRUCTION MATERIALS AND WALL RATINGS (TYP.).
- MD12 INFILL WALL OPENINGS CREATED BY DEMOLITION, INFILL TO MAINTAIN REQUIRED WALL RATING CALLED OUT IN NEW WORK. COORDINATE WITH ARCHITECTURAL PLANS FOR RECONSTRUCTION MATERIALS AND WALL RATINGS (TYP.).
- MD13 DEMOLISH RETURN DUCT BACK TO POINT SHOWN. LEAVE DUCT OPEN TO SPACE AND PROVIDE BIRDSCREEN OVER OPENING TO PROTECT FROM DEBRIS.
- MD14 DEMOLISH VAV INLET DUCT AND PROVIDE TEMPORARY CAP OVER DUCT AND BOX INLET FOR RECONNECTION IN NEW WORK.
- MD15 DEMOLISH DUCTWORK SHOWN. PROVIDE TEMPORARY CAP OVER DUCT AND BOX OUTLET FOR RECONNECTION IN NEW WORK.
- MD16 PRE-TEST EXISTING DIFFUSERS/GRILLES IN ROOM NOTED TO DETERMINE EXISTING AIRFLOW.

1 HVAC LEVEL 1 DEMO PLAN - LSHS - BUILDING D  
3/32" = 1'-0"

2 HVAC LEVEL 1 DEMO PLAN - LSHS - BUILDING E  
1/8" = 1'-0"







LSR7 Robotics, GiC &  
Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO  
64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO  
64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4209 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi.studio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com

structural engineer:  
Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/T/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com




8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM  
2150005255  
MO. CORPORATE NO. E-658D  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions

NUMBER	DESCRIPTION	DATE
--------	-------------	------

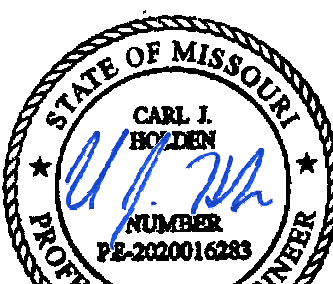


09/09/2022  
CARL J. HOLDEN  
LICENSE # PE-2020016283

LSHS - HVAC PLAN -  
LEVEL 1 - BUILDING D &  
E

M101-C

MECHANICAL PLAN NOTES:


- M2 ALL FULLY AND PARTIALLY EXPOSED SUPPLY SPIRAL AND RECTANGULAR DUCT SHALL BE INTERNALLY LINED AND FIELD PAINTED. COLOR BY ARCHITECT.
- M3 PROVIDE BUILDING BAS PANEL(S), QUANTITY OF PANELS TO BE DETERMINED BY CONTROLS CONTRACTOR. COORDINATE LOCATIONS WITH ARCHITECT AND OTHER TRADES.
- M4 INSTALL BUILDING DIFFERENTIAL PRESSURE SENSOR. EXTEND LOW PORT TUBING UP THRU ROOF TO MATCH MANUFACTURER RECOMMENDATIONS/REQUIREMENTS.
- M8 COORDINATE PIPING, CONDUIT, AND DUCT ROUTING THROUGH EXPOSED AREAS TO CLEANLY ROUTE/GROUP TOGETHER. COORDINATE WITH ALL OTHER TRADES.
- M22 ELBOW EXHAUST DUCT UP AND LEAVE OPEN TO SPACE. PROVIDE BIRDSCREEN OVER OPENING TO PROTECT DUCT FROM DEBRIS.
- M23 PROVIDE NEW BRANCH DUCT SERVING EXISTING VAV. BRANCH DUCT TO MATCH EXISTING VAV INLET SIZE.
- M24 FIELD VERIFY SIZE OF EXISTING DUCT AND PROVIDE NEW DUCT CONNECTION BETWEEN EXISTING VAV AND EXISTING DUCTWORK.
- M25 ROUTE SUPPLY AND EXHAUST DUCT UP EXTERIOR WALL, BOTTOM OF DUCT TO PENETRATE EXTERIOR WALL AT 15'-0" ABOVE ROBOTICS FABRICATION FINISHED FLOOR.
- M26 ROUTE EXHAUST DUCT UP THROUGH ROOF. TRANSITION TO DUCT/FAN CONNECTION SIZE IN CURB. RE-USE EXISTING ROOF PENETRATION.
- M28 BALANCE EXISTING DIFFUSER/GRILLE TO CFM DETERMINED DURING PRE-TESTING.
- M29 BALANCE NEW EXHAUST GRILLES TO ENSURE EXHAUST AIRFLOW IS 10% HIGHER THAN SUPPLY AIRFLOW. SUPPLY AIRFLOW DETERMINED DURING TESTING.
- M30 REBALANCE EXISTING DIFFUSERS. DISTRIBUTE CFM SO THAT THREE REMAINING CEILING MOUNTED DIFFUSERS HAVE SAME AIRFLOW. REFER TO BOX AIRFLOW DETERMINE IN PRETESTING. NEW CFM DETERMINE BASED OFF OF BOX AIRFLOW MINUS TO SUPPLY DIFFUSERS IN E122 HEAD COACH.

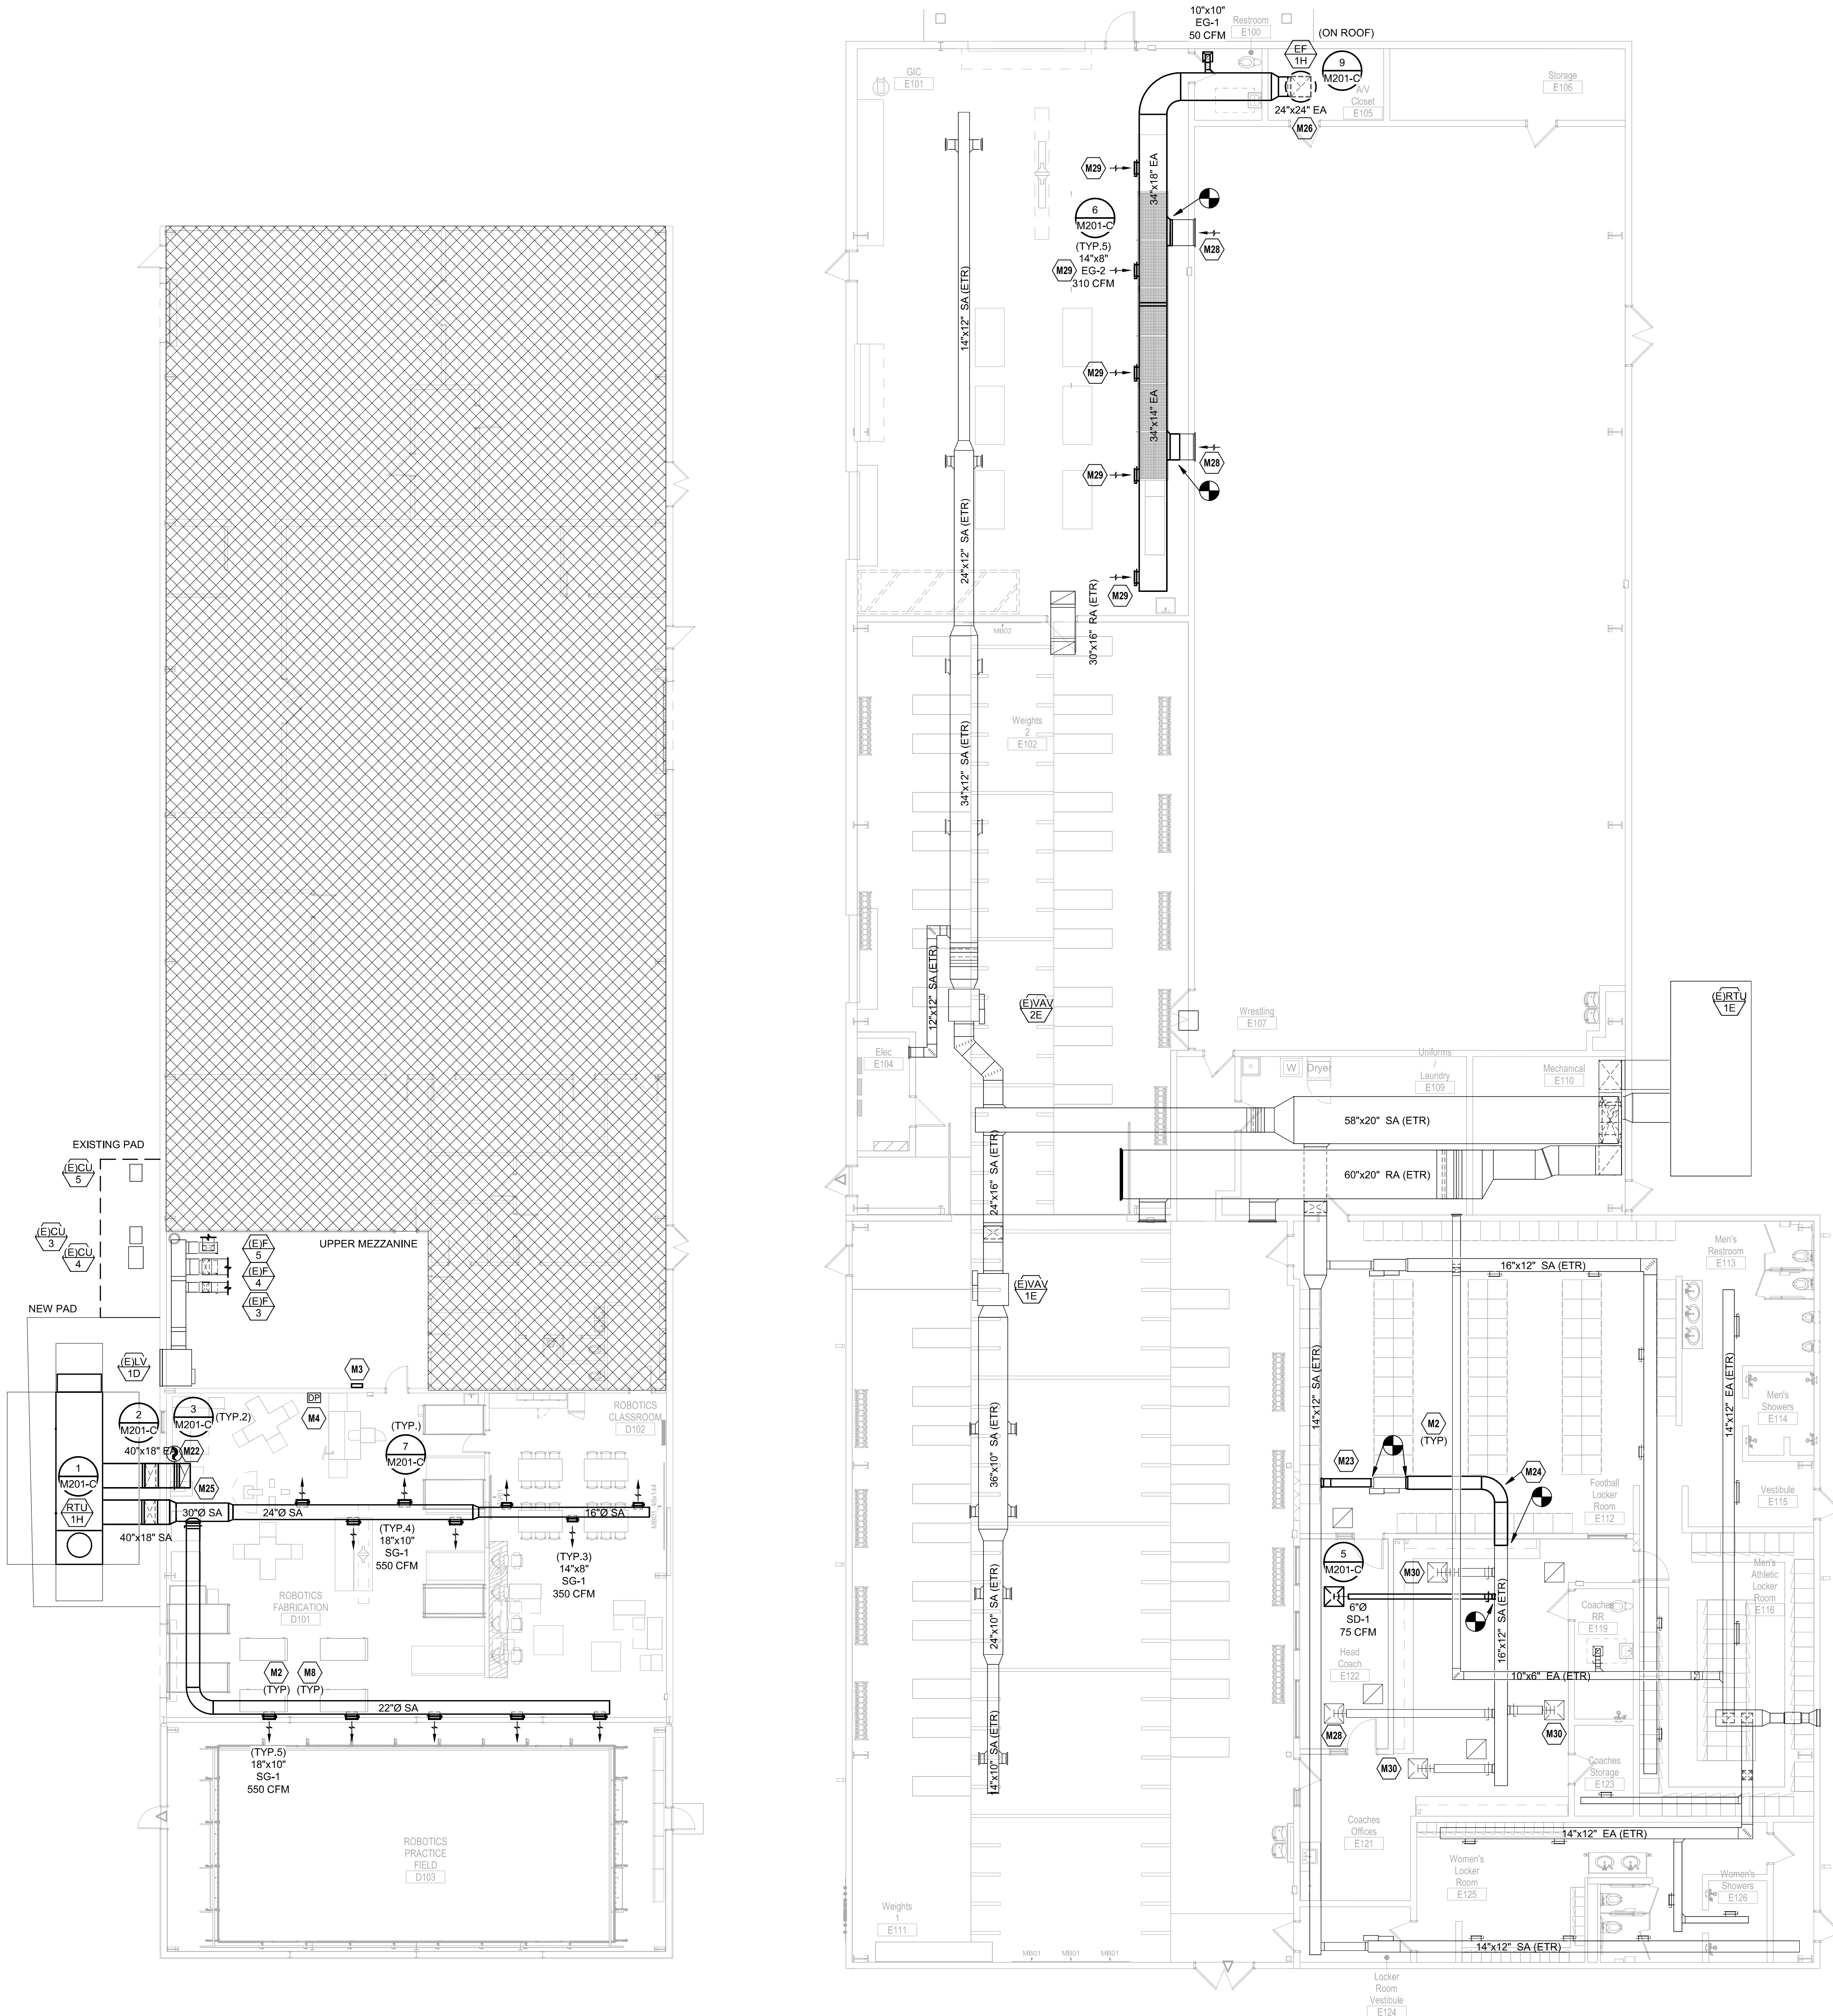

1 HVAC LEVEL 1 PLAN - LSHS - BUILDING D  
3/32" = 1'-0"

2 HVAC LEVEL 1 PLAN - LSHS - BUILDING E  
1/8" = 1'-0"



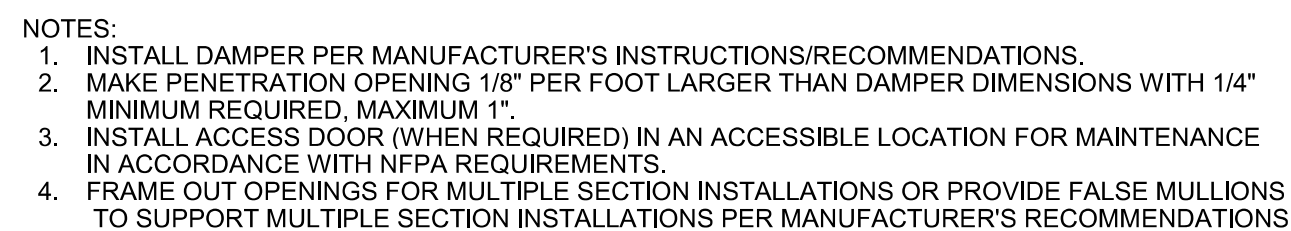

### PENETRATION WITH INDOOR DUCT WRAP

7" ARMATUFF (ARMACELL WITH INTEGRAL GLASSING), OR 2" ARMATUFF WITH VENTURE CLAD OR ALUMINUM JACKET.

GALVANIZED STEEL DUCT, SLOPE DUCTWORK TO PREVENT PONDING.

BOND ARMATUFF TO EXTERIOR DUCTWORK WITH ADHESIVE PER MANUFACTURERS RECOMMENDATION.

APPLY TOP SURFACE TO DUCTWORK OVERLAPPING SIDE PIECES.

SEAL AND PROTECT EXPOSED EDGES AND SEAMS WITH CONTINUOUS ARMATUFF SEAL TAPE. (ARMATUFF ONLY).

SUPPORT EXTERIOR DUCTWORK AT STANDING SEAM JOINTS.

0.032 ALUMINUM OUTER JACKET (10 GAUGE)

MECHANICAL FASTENER 3" MAXIMUM FROM BUTT JOINT (TYPICAL)

FACTORY APPLIED VAPOR BARRIER JACKETING

SLOPE TO DRAIN

TWO PIECE JACKETING ON TOP OF INSULATED DUCTWORK WITH STANDING SEAM, SLOPE DOWN TO DRAIN.

OVERLAP OUTER JACKET AND SECURE WITH POP RIVETS 16" O.C.

2" THICK FIBROUS BOARD INSULATION

SEAL ALL JOINTS WATER TIGHT (TYPICAL)

CORNER BEAD (TYPICAL)


VAPOR BARRIER TAPE OVER ALL JOINTS, BREAKS AND PENETRATIONS OF VAPOR BARRIER JACKET.

ADHESIVE SPOTTED TO ASSIST INSTALLATION OF

"Z" CHANNEL TO SUPPORT JACKETING


GALVANIZED STEEL DUCT

L-SHAPED AIR DUCT (PLAN VIEW)

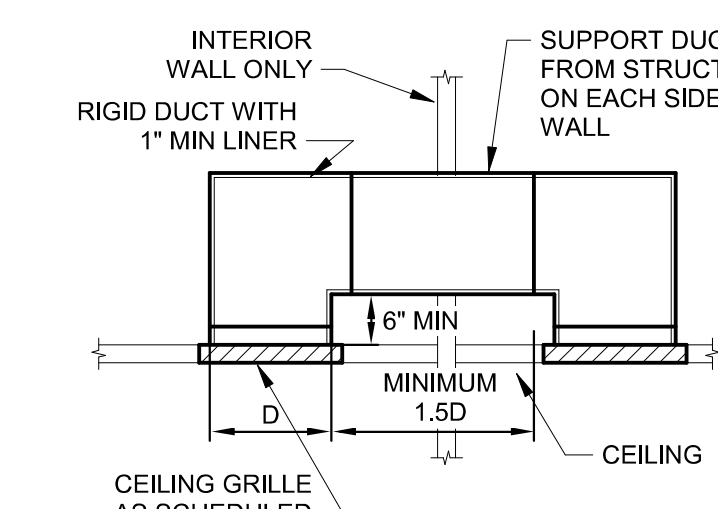

CEILING TO CEILING SECTION

### U-SHAPED AIR DUCT SECTION

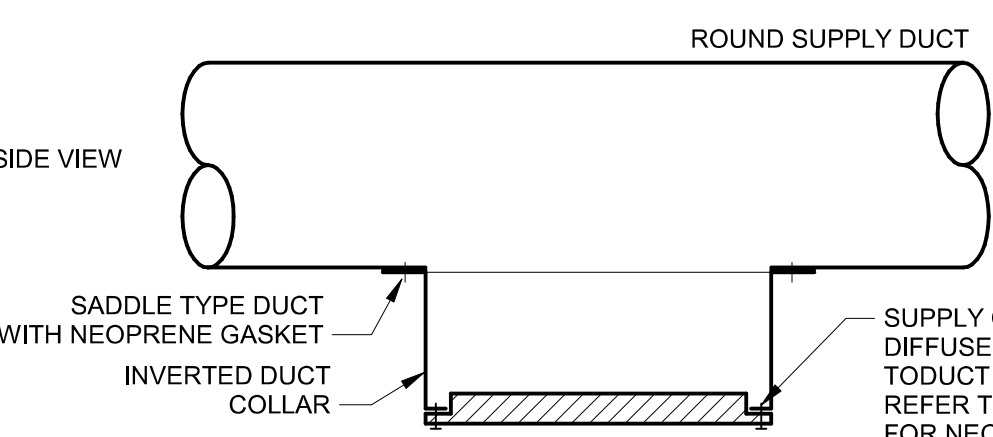

ROUND SUPPLY DUCT

OVERSIZE DUCT COLLAR TO FIT REGISTER FLANGE  
REFER TO DWG.'S FOR REGISTER NECK SIZE.

END VIEW

45°

SADDLE TYPE DUCT WITH NEOPRENE GASKET (TYPICAL)

RECTANGULAR SUPPLY DUCT

TOP/SIDE VIEW

AIR FLOW

TAP WITH 45° ENTRY COLLAR

SUPPLY AIR REGISTER WITH INTEGRAL VOLUME DAMPER

OVERSIZE DUCT COLLAR TO FIT REGISTER FLANGE, REFER TO DRAWINGS FOR REGISTER NECK SIZE.

END VIEW

TAP WITH 45° ENTRY COLLAR


Diagram illustrating the installation of a pre-insulated flexible duct system. The duct is shown connected to a ceiling diffuser and an elbow. Labels indicate the following components and requirements:

- EXTERNALLY INSULATED TAKEOFF WITH VOLUME DAMPER AND DAMPER LOCK WITH EXTENSION
- METALLIC OR NON-METALLIC BAND OVER INSULATION (TYPICAL)
- FOIL TAPE AT INSULATION JOINT
- PROVIDE RIGID 90° ELBOW WHERE REQUIRED TO KEEP FLEXIBLE DUCT WITHIN 5'-0" LENGTH LIMITATION.
- PRE-INSULATED FLEXIBLE DUCT AS REQUIRED. INSTALL PERMANENTLY SEALED AND SUPPORTED TO PREVENT KINKING AND SHARP TURNS
- METALLIC OR NON-METALLIC BAND (TYPICAL)
- CEILING DIFFUSER AS SCHEDULED
- CEILING

NOTES:

1. FLEXIBLE DUCT LENGTH MAY NOT EXCEED 5'-0". EXTEND RIGID DUCT AS REQUIRED.
2. REFER TO SPECIFICATIONS FOR FLEXIBLE DUCTWORK INSTALLATION REQUIREMENTS

### RETURN TRANSFER AIR DUCT DETAIL

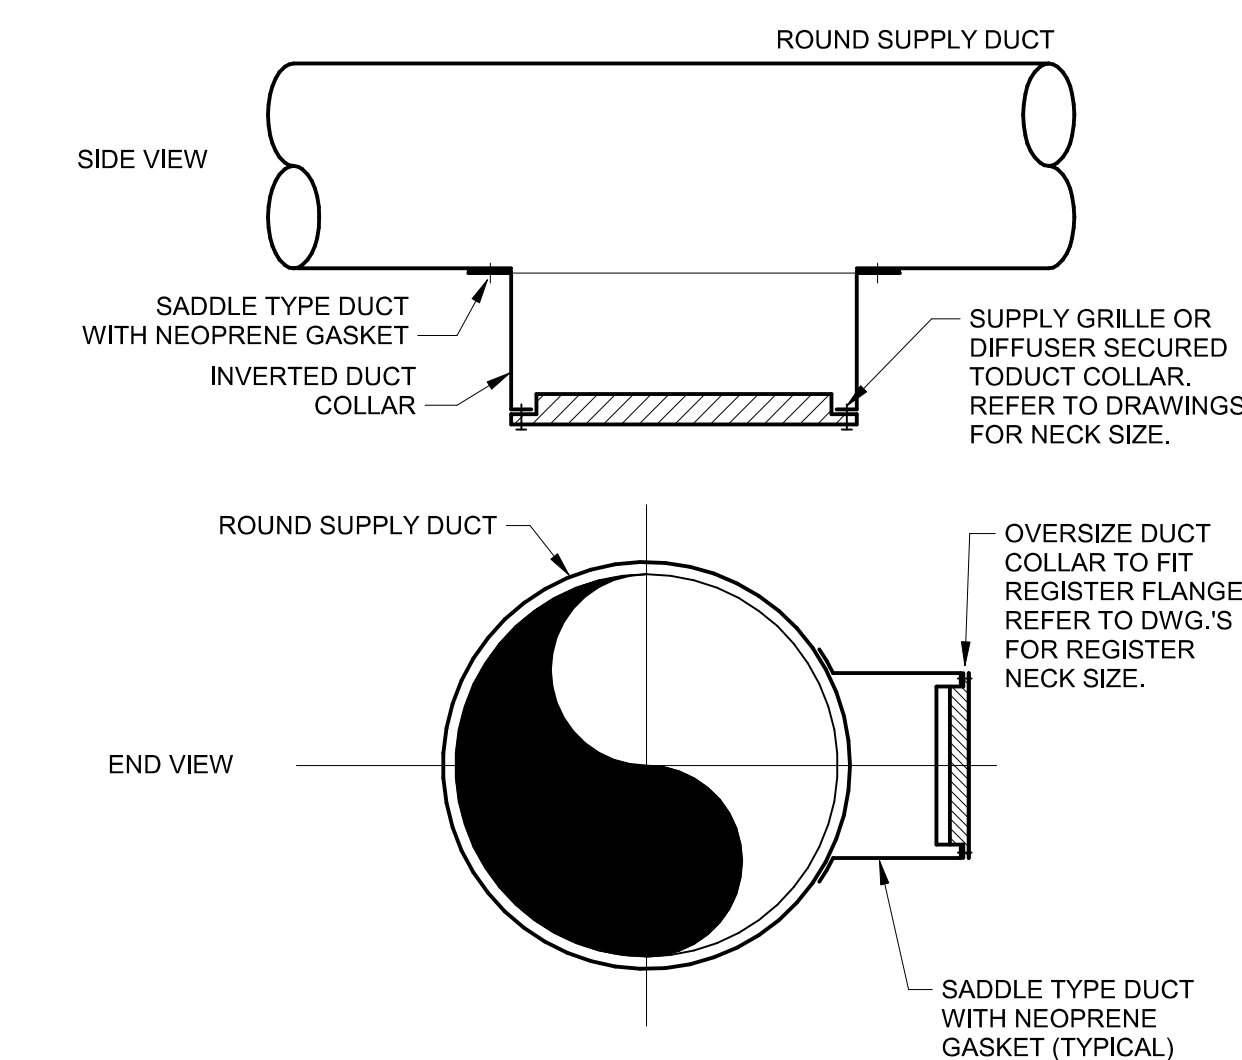

EXHAUST FAN

PROVIDE VIBRATION ISOLATORS BETWEEN CURB AND BASE

SECURE BASE TO CURB

TRANSITION DUCT TO CONNECT TO FAN CURB, EXTEND DUCTWORK OVER TOP OF CURB AND SECURE TO WOOD NAILER

ROOF DECK AND INSULATION PER ARCHITECTURAL DWGS

SECURE CURB TO ROOF WITH METHOD CONSISTENT WITH ROOF CONSTRUCTION

SEE NOTES 3 AND 4

SEE NOTE 2

A

### 9 ROOF MOUNTED UPBLAST FAN DETAILS







MECHANICAL SYMBOLS

NOTE: THIS IS A MASTER LEGEND AND NOT ALL SYMBOLS, ABBREVIATIONS, ETC. ARE NECESSARILY USED ON THE DRAWINGS.

CONTROLS SYMBOLS AND NOMENCLATURE

	FLUE DAMPER (BOILERS)		HOT GAS REHEAT COIL		RISER DESIGNATION		MOTORIZED DAMPER
	BOILER		COOLING COIL		FIRE DAMPER		BACKDRAFT DAMPER
	COOLING TOWER		FURNACE		FIRE SMOKE DAMPER		VOLUME DAMPER
	CONDENSING UNIT		HEATING COIL		SMOKE DAMPER		HUMIDISTAT
	FLUID COOLER		DAMPER - GENERIC BLADE TYPE		SMOKE DETECTOR		THERMOSTAT
	WATER-COOLED CHILLER		DAMPER - OPPOSED BLADE TYPE		BTU METER		PRESSURE SENSOR
	AIR-COOLED CHILLER		DAMPER - PARALLEL BLADE TYPE		CARBON MONOXIDE SENSOR		POLLUTANT ALARM
	GENERIC HEAT EXCHANGER		FLEXIBLE SENSING ELEMENT		CARBON DIOXIDE SENSOR		PULL STATION
	SHELL AND TUBE HEAT EXCHANGER		AIRFLOW STATION		CONTROL PANEL		REFRIGERANT LEAK SENSOR
	BASIN HEATER		PUMP		CURRENT CIRCUIT RELAY		SENSOR - GENERIC
	GROUND HEAT EXCHANGER		FAN		DIFFERENTIAL PRESSURE SENSOR		STATIC PRESSURE PORT
	HEAT RECOVERY WHEEL		HUMIDIFIER		ELECTRIC METER		SWITCH
			AIR FILTER		FLOW METER, FUEL METER		TEMPERATURE SENSOR
			3-WAY CONTROL VALVE		FLOW SWITCH		WATER METER
			2-WAY CONTROL VALVE		HUMIDITY SENSOR		
			AIR BYPASS DAMPER				
			AIRFLOW MEASURING STATION				
			DIRECT EXPANSION COOLING UNIT CONTROLLER				
			FURNACE BURNER CONTROLLER				
			SILICON-CONTROLLED RECTIFIER				
			ELECTRIC HEATER CONTROL (MODULATING)				
			ELECTRIC HEATER CONTROLLER (ON/OFF)				
			ELECTRONIC COMMUTATED MOTOR				
			VARIABLE FREQUENCY DRIVE				
			MOTOR STARTER				
			LOW LIMIT TEMPERATURE CONTROLLER (FREEZE/STAT)				
			EMERGENCY PUSH BUTTON				

PROJECT DESIGN CONDITIONS - LSHS

CLIMATE CONDITONS		LEE'S SUMMIT MUNICIPAL, MO		BUILDING OPERATING HOURS:	
WEATHER STATION:				MONDAY - FRIDAY	
CLIMATE ZONE:		4A		TBD BY OWNER	
HEATING (DB):		99.6%	4.7 °F	SATURDAY	
DESIGN HEATING CONDITIONS (DB):		0	°F	TBD BY OWNER	
HUMIDIFICATION (DP/ HRV/ MCDDB):		99.6%	°F/	SUNDAY	
COOLING (DB/AMCWB):		0.4%	96.4 °F/	TBD BY OWNER	
DESIGN COOLING CONDITIONS (DB/ MCWB):			74.7 °F/	HOLIDAY	
DEHUMIDIFICATION (DP/ HRV/ MCDDB):		0.4%	79.9 °F/		
			135.8 gr/lb		
			85.9 °F		

SPACE / UNIT DESCRIPTION	COOLING / DE-HUMIDIFICATION				SET POINTS				ZONE VENTILATION RESET			SPACE OPERATING HOURS OCCUPIED / UNOCCUPIED			NOTES
	OCC	UNOCC	MAX	MIN	OCC	UNOCC	MIN	MAX	CONTROL	BASE	MAXIMUM	M-F	SAT	SUN	
GIC	75	80	60%	NA	70	60	NA	NA	CO2	400	900	TBD	TBD	TBD	A-C
ROBOTICS	75	80	60%	NA	70	60	NA	NA	OCC	400	900	TBD	TBD	TBD	A-C
LOCKER	75	80	60%	NA	70	60	NA	NA	OCC	400	900	TBD	TBD	TBD	A-C
WEIGHTS	75	80	60%	NA	70	60	NA	NA	OCC	400	900	TBD	TBD	TBD	A-C

NOTES:

A. ZONE LEVEL VENTILATION RESET / DEMAND CONTROL VENTILATION (DCV) CONTROL METHOD: CARBON DIOXIDE SENSOR (CO2).

B. ZONE LEVEL SET POINT CONDITIONS SHALL BE AS SCHEDULED UNLESS OTHERWISE SCHEDULED OR NOTED ON THE DRAWINGS FOR ROOM SPECIFIC SPACE CONDITIONS.

C. ZONE LEVEL OCCUPANCY HOUR SCHEDULE SHALL BE PER BUILDING OPERATING HOURS UNLESS OTHERWISE SCHEDULED.


POINTS LIST - GLOBAL BUILDING MONITORING - LSHS

POINT ID	DESCRIPTION	POINT TYPE	UNITS	ACCURACY	TRENDING INTERVAL	ENERGY DASHBOARD DISPLAY	STATUS ALARM	ALARM RANGE	NOTES
BUILDING SENSORS									
BDP	BUILDING DIFFERENTIAL PRESSURE	AI	IN. W.G.	SPEC	15 MIN.	X	X	-0.15 > BDP > +0.20	A, B
OACO2	OUTSIDE AIR CARBON DIOXIDE LEVEL	AI	PPM	SPEC	15 MIN.				
OAT	OUTSIDE AIR DRY BULB TEMPERATURE	AI	°F	SPEC	15 MIN.	X			
OAH	OUTSIDE AIR RELATIVE HUMIDITY	AI	%	SPEC	15 MIN.	X			

NOTES:

A. INITIAL SETPOINT SHALL BE 0.05 IN. W.G. COORDINATE FINAL SETPOINT AT BUILDING STARTUP.

B. APPLY A MOVING TIME AVERAGE TO BUILDING DIFFERENTIAL PRESSURE USING A SLIDING 5-MINUTE WINDOW TO REDUCE DAMPER AND FAN CONTROL FLUCTUATIONS.

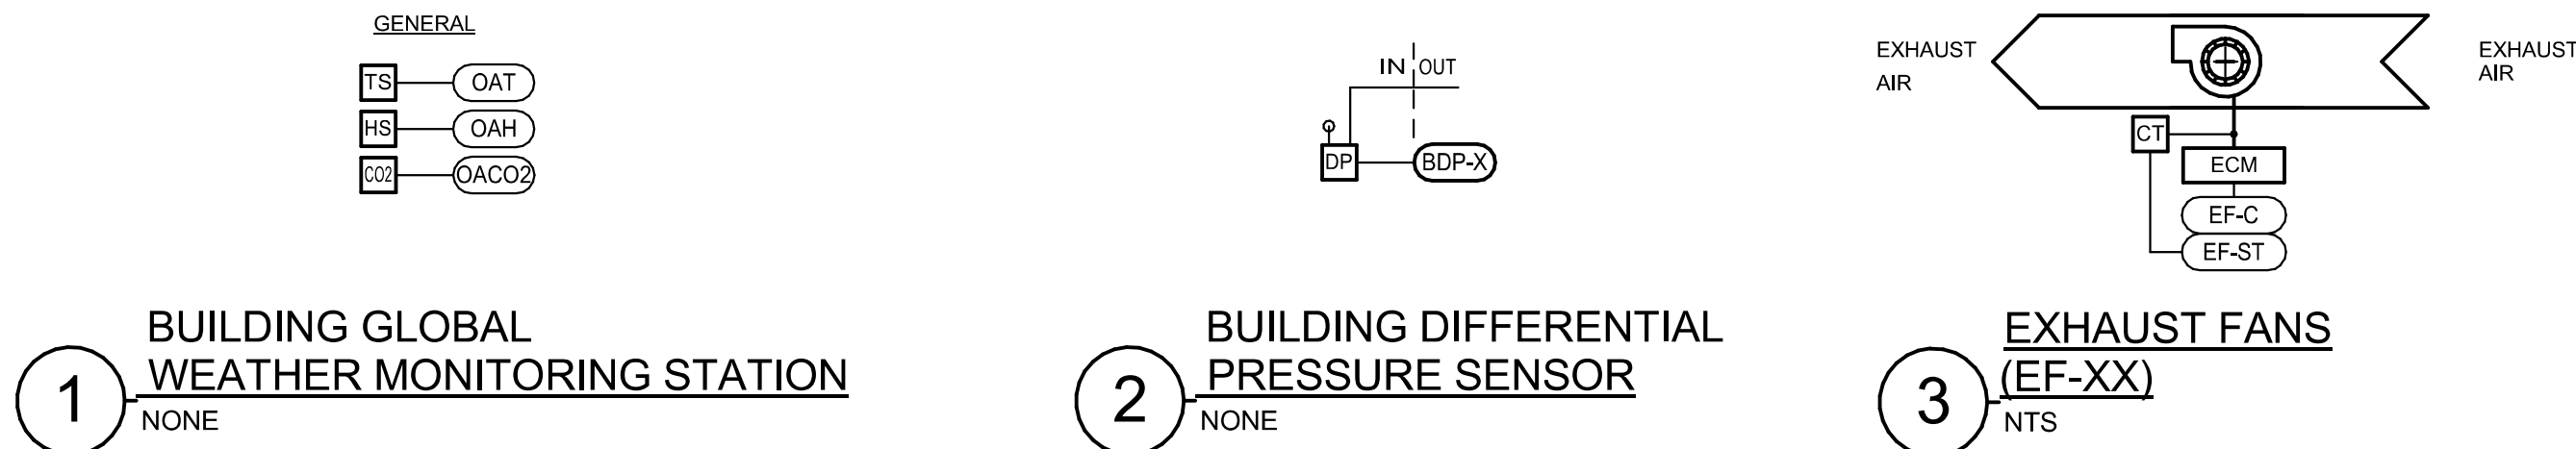

BUILDING GLOBAL WEATHER MONITORING STATION

NONE

BUILDING DIFFERENTIAL PRESSURE SENSOR

NONE

EXHAUST FANS (EF-XX)

NTS

SEQUENCE OF OPERATIONS MISCELLANEOUS EQUIPMENT

This sequence of operations is organized into the following main categories: safeties, overrides and interlocks, and component control loops. either enable or disable the various modes of operation. If a mode of operation is not listed within a component control loop section then that mode of operation has no direct influence on the operation of the component. The control setpoint reset section describes the logic and reference variables that will be used to reset control setpoints to a new value within its reset range. The safeties and interlocks section outlines the hardwired interlocks that will be required to meet life safety requirements. Safeties and interlocks take precedence over all other control strategies outlined in this document. The control responses of each component for the various modes of operation are described in the component control loop sections.

The sequence of operations, the points list and control diagrams shall be used to provide a complete description of the control philosophy for the controlled equipment. Individual setpoint values, reset ranges, and alarm action levels are listed in the points list. Components and control sensor locations are graphically depicted on the control diagram.

EXHAUST FANS (EF-XX)

OPERATING MODES

OCCUPIED MODE:

The units shall be in occupied mode per the project design conditions schedule shown on the control drawings.

UNOCCUPIED MODE:

The units shall be in unoccupied mode for all periods not included in the occupied hours of operation.

COMPONENT CONTROL LOOPS

FAN CONTROL - CONSTANT VOLUME RMS SCHEDULED

When in Occupied Mode:

The fan shall be ON.

When in Unoccupied Mode:

The fan shall be OFF.

EXHAUST FAN CONTROL POINTS - LSHS

POINT ID	DESCRIPTION	POINT TYPE	DEFAULT SETPOINT	FAIL POSITION	STATUS ALARM	ALARM RANGE	NOTES
EXHAUST FANS (EF-1H)							
EF-C	EXHAUST FAN COMMAND (START/STOP)	BO					A
EF-ST	EXHAUST FAN STATUS (CT)	BI			X	EF-C=ON, EF-ST=OFF	

NOTES:

A. POINTS APPLY TO MULTIPLE UNITS. SEE CONTROL DIAGRAMS FOR NUMBER OF UNITS.

C. ALARM TO SIGNAL AFTER 30 SECOND TIME DELAY (ADJ.)

D. ALARM TO SIGNAL AFTER 10 MINUTE TIME DELAY (ADJ.)

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd., Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect: Multistudio  
4209 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi.studio

civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveeng.com

structural engineer: Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/ET/Code: Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

Issue Date: September 9, 2022

Revisions

NUMBER	DESCRIPTION	DATE
--------	-------------	------



09/09/2022  
CARL J. HOLDEN  
LICENSE # PE-2020016283

LSHS - MECHANICAL CONTROLS

M401-C







LSR7 Robotics, GiC &  
Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4209 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi.studio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com

structural engineer:  
Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite 300  
300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com



8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM  
2150005255  
MO. CORPORATE NO. E-8680  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions

NUMBER	DESCRIPTION	DATE
--------	-------------	------


E

D

C

B

A

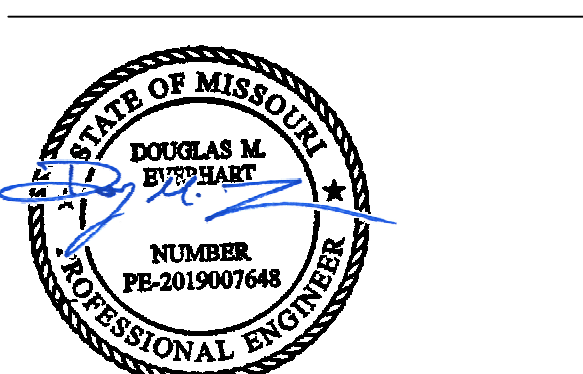

09/09/2022  
DOUGLAS M. EVERHART  
LICENSE # PE-2019007648

LSHS - LIGHTING  
DEMOLITION RCP -  
LEVEL 1 - BUILDING D &  
E


ED101-C

ELECTRICAL DEMOLITION PLAN NOTES:

- ED03 MAIN SERVICE ENTRANCE LOCATION IS ON MEZZANINE LEVEL ABOVE. EQUIPMENT IS ETR.
- ED18 RELOCATE WALL PACK TO SOUTH SIDE OF NEW ROBOTICS FIELD ADDITION. RE: 1/E101-C FOR ADDITIONAL INFORMATION.
- ED24 BASE BID: REMOVE FIXTURES AND LIGHTING CONTROLS MARKED AS "DEMO". ALL OTHER LIGHT FIXTURES AND CONTROLS ARE TO EXISTING TO REMAIN WITHIN DASHED REGION. ADD ALTERNATE #3: DEMOLISH ALL LIGHTING IN AREA SHOWN BOLD AND DASHED UNLESS NOTED OTHERWISE. REMOVE ALL EXISTING LIGHT FIXTURES, RACEWAY, CIRCUITRY, AND RELATED ACCESSORIES NOT BEING REUSED BACK TO SOURCE PANELBOARD OR NEAREST REMAINING DEVICES. LIGHTING CONTROLS ARE EXISTING TO REMAIN. MAINTAIN ALL EXISTING CIRCUITRY FOR REUSE WHERE NOTED ON NEW CONSTRUCTION DRAWINGS.
- ED25 DEMO FIXTURE AND SUPPORTS. REMOVE CIRCUITRY BACK TO JUNCTION BOX.
- ED27 BASE BID: REMOVE FIXTURES AND LIGHTING CONTROLS MARKED AS "DEMO". ALL OTHER LIGHT FIXTURES AND CONTROLS ARE EXISTING TO REMAIN WITHIN DASHED REGION. ADD ALTERNATE #2: REMOVE ALL LIGHT FIXTURES AND SUPPORTS. REMOVE CIRCUITRY BACK TO JUNCTION BOX FOR RE-USE. LIGHTING CONTROLS ARE EXISTING TO REMAIN. UNLESS NOTED OTHERWISE, REFER TO NEW CONSTRUCTION DRAWINGS FOR ADDITIONAL INFORMATION.
- ED29 DEMOLISH ALL LIGHTING AND CONTROLS IN AREA SHOWN BOLD AND DASHED UNLESS NOTED OTHERWISE. REMOVE ALL EXISTING LIGHT FIXTURES, RACEWAY, CIRCUITRY, AND RELATED ACCESSORIES NOT BEING REUSED BACK TO SOURCE PANELBOARD OR NEAREST REMAINING DEVICES. LIGHTING CONTROLS ARE EXISTING TO REMAIN. MAINTAIN ALL EXISTING CIRCUITRY AND CONTROLS FOR REUSE WHERE NOTED ON NEW CONSTRUCTION DRAWINGS.

ELECTRICAL DEMOLITION GENERAL NOTES:


- REFERENCE ARCHITECTURAL DRAWINGS FOR FULL EXTENT OF DEMOLITION WORK AND PHASING. NOTIFY ARCHITECT, ENGINEER AND OWNER, AS APPLICABLE, OF ANY CONFLICTS OR DISCREPANCIES BETWEEN DRAWINGS AND JOB SITE CONDITIONS PRIOR TO SUBMITTING BID.
- COORDINATE DEMOLITION AND REMOVAL OF EXISTING LIGHTING SYSTEMS WITH ARCHITECTURAL PHASING DRAWING AND OWNER TO ALLOW NECESSARY SYSTEMS TO REMAIN OPERATIONAL DURING CONSTRUCTION. (NOTE: NOT ALL EXISTING DEMOLISHED EQUIPMENT, LIGHT FIXTURES, DEVICES OR RACEWAYS WILL BE SHOWN ON THE DRAWINGS). COORDINATE ELECTRICAL REQUIREMENTS FOR REMODELED/RENOVATED SPACES WITH THE OWNER.
- AVOID DAMAGING FACILITIES, INCLUDING EQUIPMENT, LIGHT FIXTURES AND DEVICES THAT ARE EXISTING TO REMAIN, NEW OR REUSED. REPAIR ALL DAMAGE CAUSED DURING WORK AT NO EXTRA COST TO THE OWNER.
- DISPOSE OF ALL ELECTRICAL EQUIPMENT, LIGHT FIXTURES, AND DEVICES SHOWN TO BE REMOVED, UNLESS NOTED OTHERWISE. COORDINATE WITH THE OWNER THE ITEMS TO BE SALVAGED, AND THE LOCATION FOR STORAGE, AVOID DAMAGING SALVAGED ITEMS DURING DEMOLITION WORK AND DURING TRANSPORT TO OWNER'S DESIGNATED STORAGE LOCATION.
- WHERE ALTERATION OF ELECTRICAL EQUIPMENT, LIGHT FIXTURES, RACEWAYS OR WIRING DEVICES AFFECTS EXISTING SURFACES/FINISHES: REPAIR/PAINT AFFECTED SURFACE TO MATCH EXISTING ADJACENT SURFACE IN ACCORDANCE WITH OWNER REQUIREMENTS. MAINTAIN FIRE RATING OF ALL FLOORS/WALLS/CEILING THAT ARE RATED.
- WHERE DEMOLITION WORK INTERRUPTS ELECTRICAL CONTINUITY OF CIRCUITS THAT ARE TO REMAIN IN USE, PROVIDE NECESSARY DEVICES AND RELATED CIRCUITRY TO MAINTAIN ELECTRICAL CONTINUITY IN ACCORDANCE WITH OWNER REQUIREMENTS. RE-CIRCUIT REUSED ELECTRICAL EQUIPMENT, LIGHT FIXTURES AND WIRING DEVICES PREVIOUSLY POWERED FROM DEMOLISHED EQUIPMENT TO NEW OR TEMPORARY EQUIPMENT AS NEEDED.
- COORDINATE DISCONNECTION OF POWER TO EQUIPMENT BEING DEMOLISHED/REMOVED/RELOCATED WITH OTHER TRADES PRIOR TO START OF WORK. ALL ELECTRICAL EQUIPMENT, LIGHT FIXTURES, RACEWAYS, WIRING DEVICES AND RELATED CIRCUITRY NOT BEING REUSED SHALL BE REMOVED IN ALL ACCESSIBLE AREAS AND IN FLOORS/WALLS/CEILING THAT ARE TO BE REMOVED, UNLESS NOTED OTHERWISE, AS ALLOWED BY OWNER. UNUSED ELECTRICAL EQUIPMENT, RACEWAYS AND RELATED CIRCUITRY THAT ARE INACCESSIBLE MAY BE ABANDONED IN PLACE AND SHALL BE PERMANENTLY DISCONNECTED FROM ALL POWER SOURCES, INSULATED FROM CONTACT WITH OTHER LIVE ELECTRICAL WIRING/DEVICES, AND IDENTIFIED AT THE TERMINATIONS AS NO LONGER BEING IN SERVICE.
- LOW VOLTAGE CABLES/WIRING NOT BEING REUSED SHALL BE REMOVED UNLESS IDENTIFIED FOR FUTURE USE. COORDINATE REQUIREMENTS WITH OWNER. CARE SHOULD BE TAKEN DURING THE REMOVAL PROCESS TO PROTECT THE EXISTING REUSED CABLES/WIRING FROM DAMAGE.

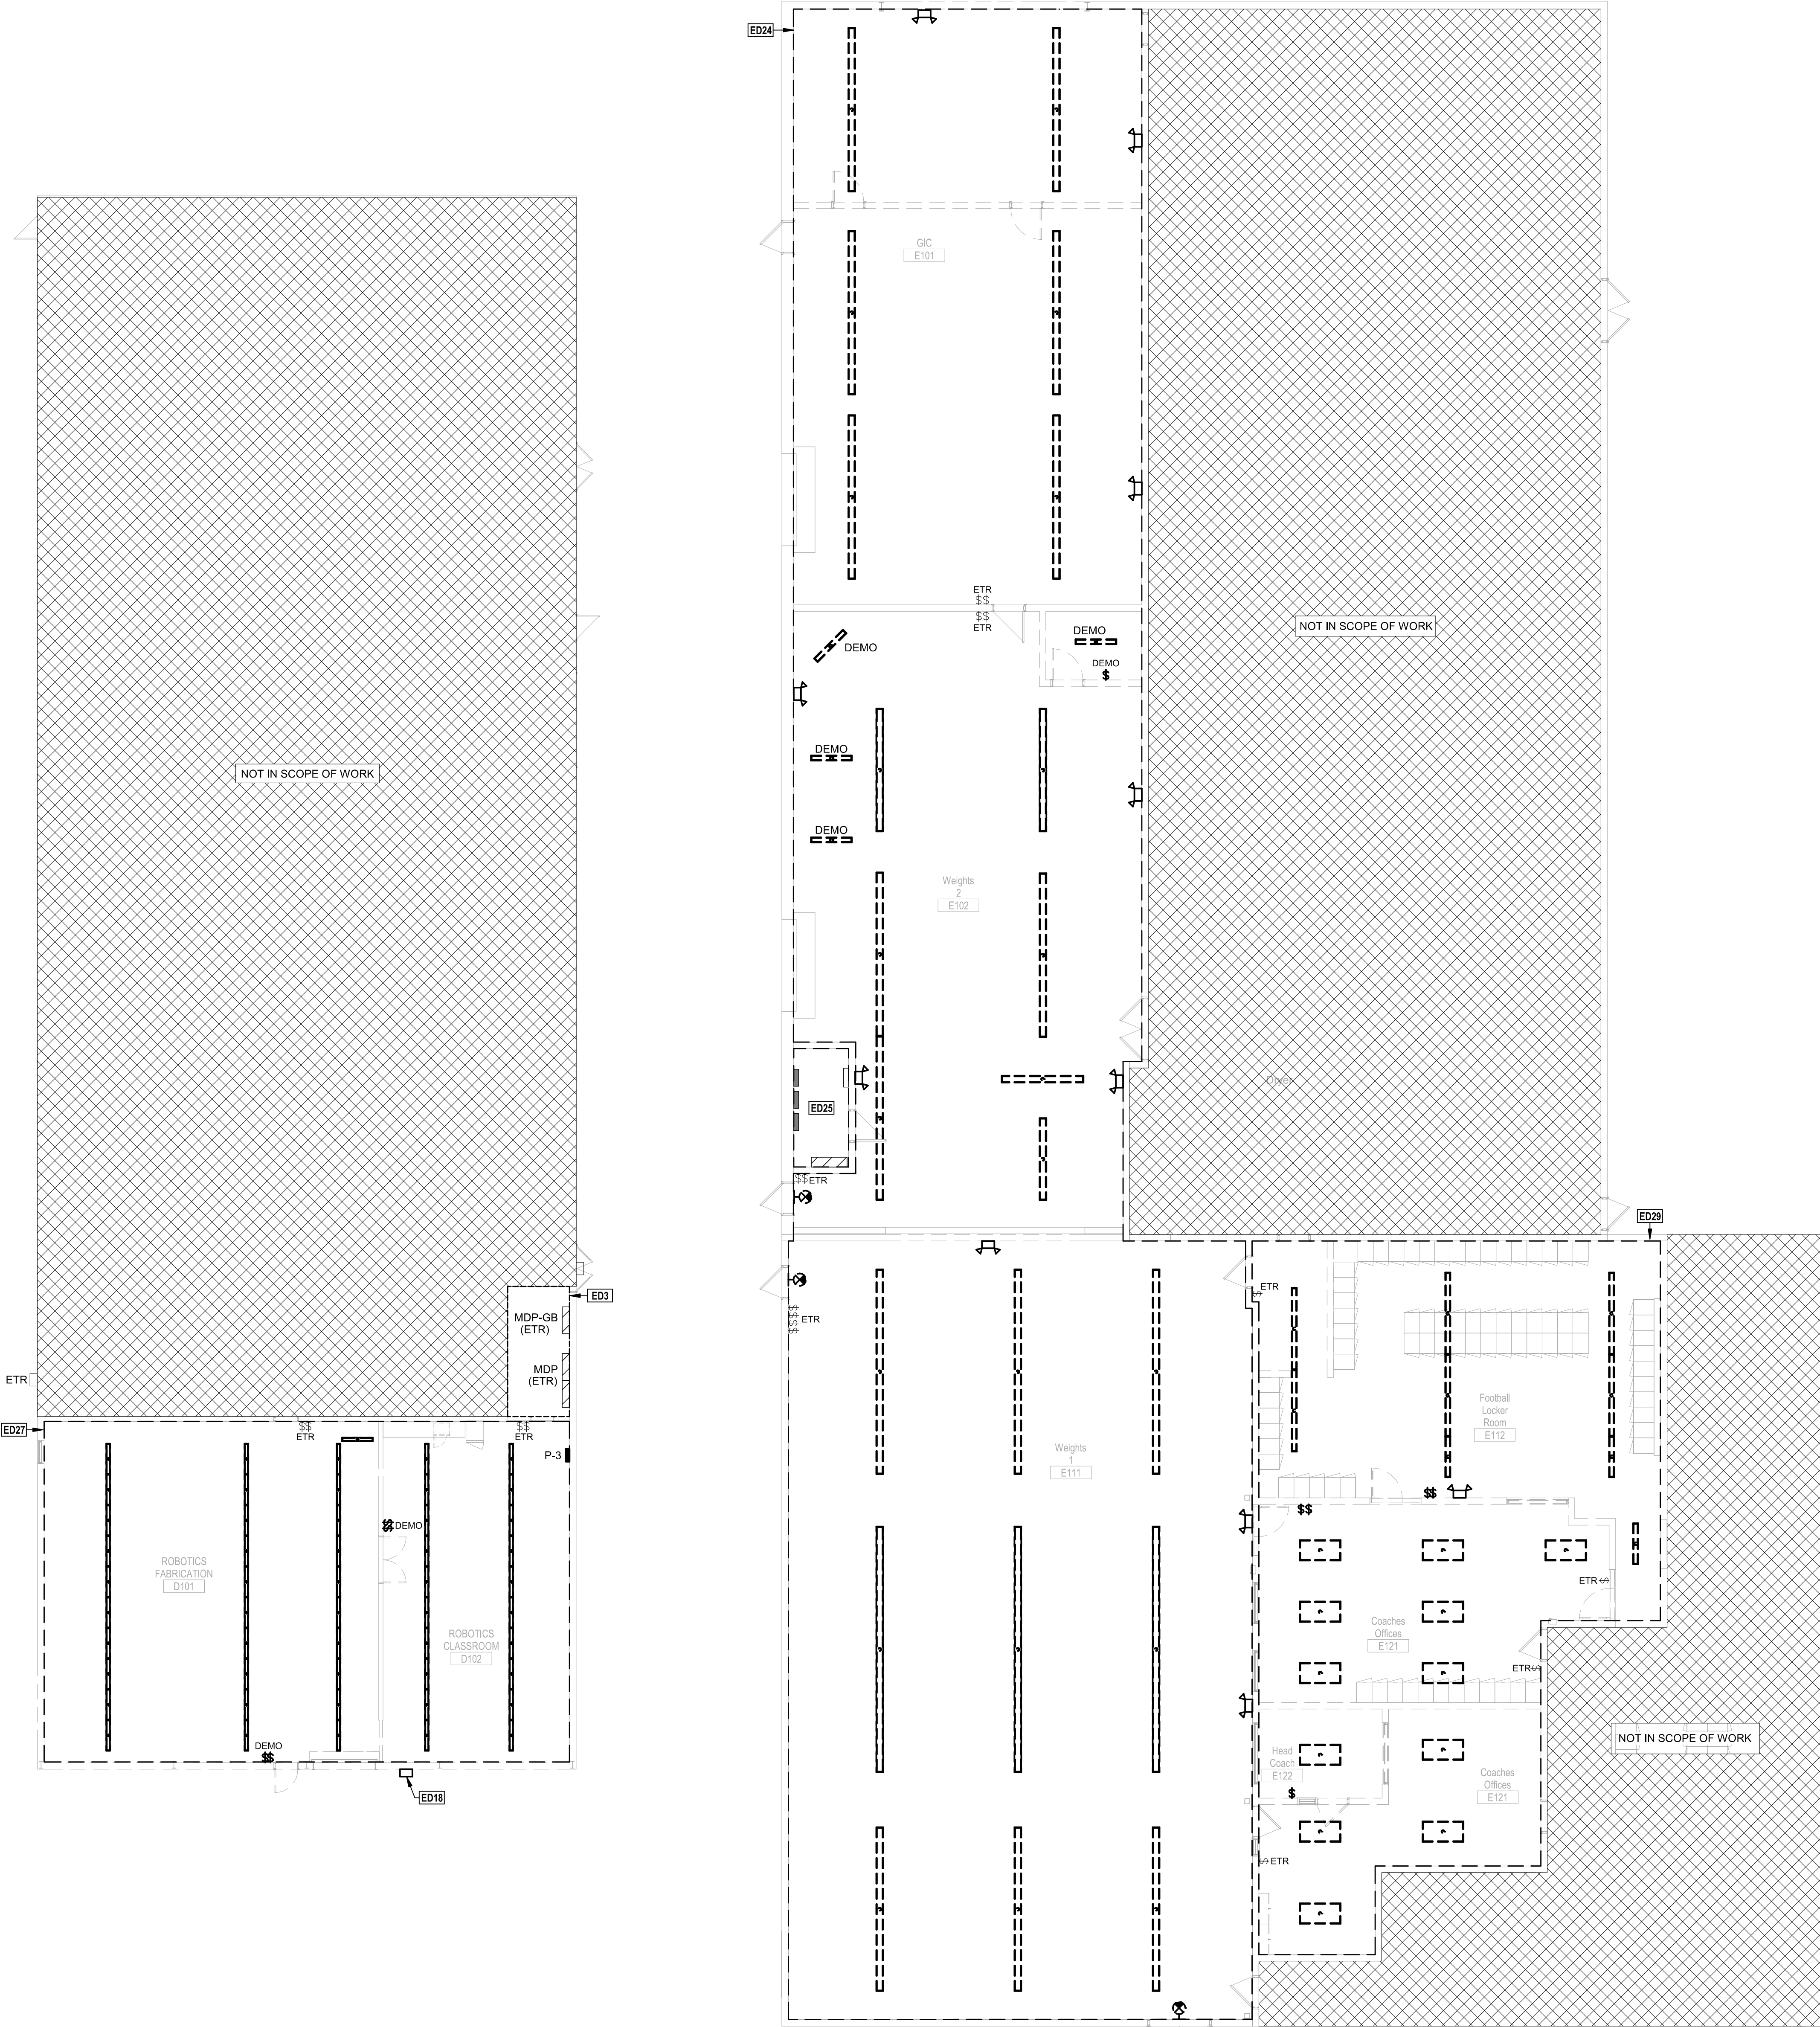

1 LIGHTING LEVEL 1 DEMO RCP - LSHS - BUILDING D  
3/32" = 1'-0"



2 LIGHTING LEVEL 1 DEMO RCP - LSHS - BUILDING E  
1/8" = 1'-0"





LSR7 Robotics, GiC &  
Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO  
64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO  
64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4209 Pennsylvania  
Kansas City, MO 64111  
816.591.6655  
mstudio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveeng.com

structural engineer:  
Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/IT/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com



8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM  
2150005255  
MO. CORPORATE NO. E-8580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

NUMBER	DESCRIPTION	DATE
--------	-------------	------



09/09/2022  
DOUGLAS M. EVERHART  
LICENSE # PE-2019007648

LSHS - POWER  
DEMOLITION PLAN -  
LEVEL 1 - BUILDING D &  
E

ED201-C


☐ ELECTRICAL DEMOLITION PLAN NOTES:

- ED03 MAIN SERVICE ENTRANCE LOCATION IS ON MEZZANINE LEVEL ABOVE. EQUIPMENT IS ETR.
- ED04 EXISTING WIREWAY MOUNTED AT APPROXIMATELY 10' AFF. PROTECT EXISTING WIREWAY AND ALL CONDUIT TERMINATIONS ENTERING AND LEAVING WIREWAY.
- ED08 RELOCATE EXISTING PENDANT MOUNTED PROJECTOR AND REVISE AND EXTEND RELATED CIRCUITRY. EXISTING RACEWAY, CIRCUITRY, AND RELATED ACCESSORIES MAY BE REUSED IF IN GOOD CONDITION AND NEW DESIGN CRITERIA CAN BE MET, OTHERWISE REPLACE. RE: NEW CONSTRUCTION DRAWINGS FOR ADDITIONAL INFORMATION.
- ED09 PROTECT EXISTING EXPOSED CONDUIT WITHIN DASHED REGION DURING CONSTRUCTION OF NEW GARAGE DOOR. RELOCATE ALL EXPOSED CONDUIT SURFACE MOUNTED TO PORTION OF WALL GETTING DEMOLISHED TIGHT TO DECK. REMOVE ALL RECEPTACLES WITHIN PORTION OF WALL GETTING DEMOLISHED. REMOVE CONDUIT AND CIRCUITRY BACK TO SOURCE.
- ED11 DEMOLISH ALL ELECTRICAL DEVICES LOCATED ON WALL OR PORTION OF WALL TO BE REMOVED UNLESS NOTED OTHERWISE. REMOVE EXISTING ELECTRICAL DEVICES, RACEWAY, CIRCUITRY, AND RELATED ACCESSORIES NOT BEING REUSED BACK TO SOURCE PANELBOARD OR NEAREST REMAINING DEVICE. NOT ALL EXISTING TO REMAIN RECEPTACLES ARE SHOWN.
- ED13 RELOCATE EXISTING RECEPTACLES SERVING GAME CLOCKS AND REVISE AND EXTEND RELATED CIRCUITRY. EXISTING RACEWAY, CIRCUITRY, AND RELATED ACCESSORIES MAY BE REUSED IF IN GOOD CONDITION AND NEW DESIGN CRITERIA CAN BE MET, OTHERWISE REPLACE. RE: NEW CONSTRUCTION DRAWINGS FOR ADDITIONAL INFORMATION.
- ED15 RELOCATE EXISTING RECEPTACLE SERVING WALL RACK AND REVISE AND EXTEND RELATED CIRCUITRY. EXISTING RACEWAY, CIRCUITRY, AND RELATED ACCESSORIES MAY BE REUSED IF IN GOOD CONDITION AND NEW DESIGN CRITERIA CAN BE MET, OTHERWISE REPLACE. RE: NEW CONSTRUCTION DRAWINGS FOR ADDITIONAL INFORMATION.
- ED16 RELOCATE EXISTING WALL MOUNTED PROJECTOR AND REVISE AND EXTEND RELATED CIRCUITRY. EXISTING RACEWAY, CIRCUITRY, AND RELATED ACCESSORIES MAY BE REUSED IF IN GOOD CONDITION AND NEW DESIGN CRITERIA CAN BE MET, OTHERWISE REPLACE. RE: NEW CONSTRUCTION DRAWINGS FOR ADDITIONAL INFORMATION.
- ED22 REMOVE PANEL. DISCONNECT ALL EXISTING BRANCH CIRCUITRY LOADS AND MAINTAIN CONDITION FOR RECONNECTION TO NEW PANEL.
- ED28 EXISTING ROLLING DOOR TO REMAIN.
- ED31 DEMOLISH ALL RECEPTACLES IN AREA SHOWN BOLD AND DASHED UNLESS NOTED OTHERWISE. REMOVE EXISTING ELECTRICAL DEVICES, RACEWAY, CIRCUITRY, AND RELATED ACCESSORIES NOT BEING REUSED BACK TO SOURCE PANELBOARD OR NEAREST REMAINING DEVICE.
- ED32 ALL RECEPTACLES WITHIN DASHED REGION ARE EXISTING TO REMAIN.
- ED33 NO DEMOLITION WORK IN THIS AREA. ALL EQUIPMENT IS EXISTING TO REMAIN.

1 POWER LEVEL 1 DEMO PLAN - BUILDING D  
3/32" = 1'-0"

2 POWER LEVEL 1 DEMO PLAN - BUILDING E  
1/8" = 1'-0"



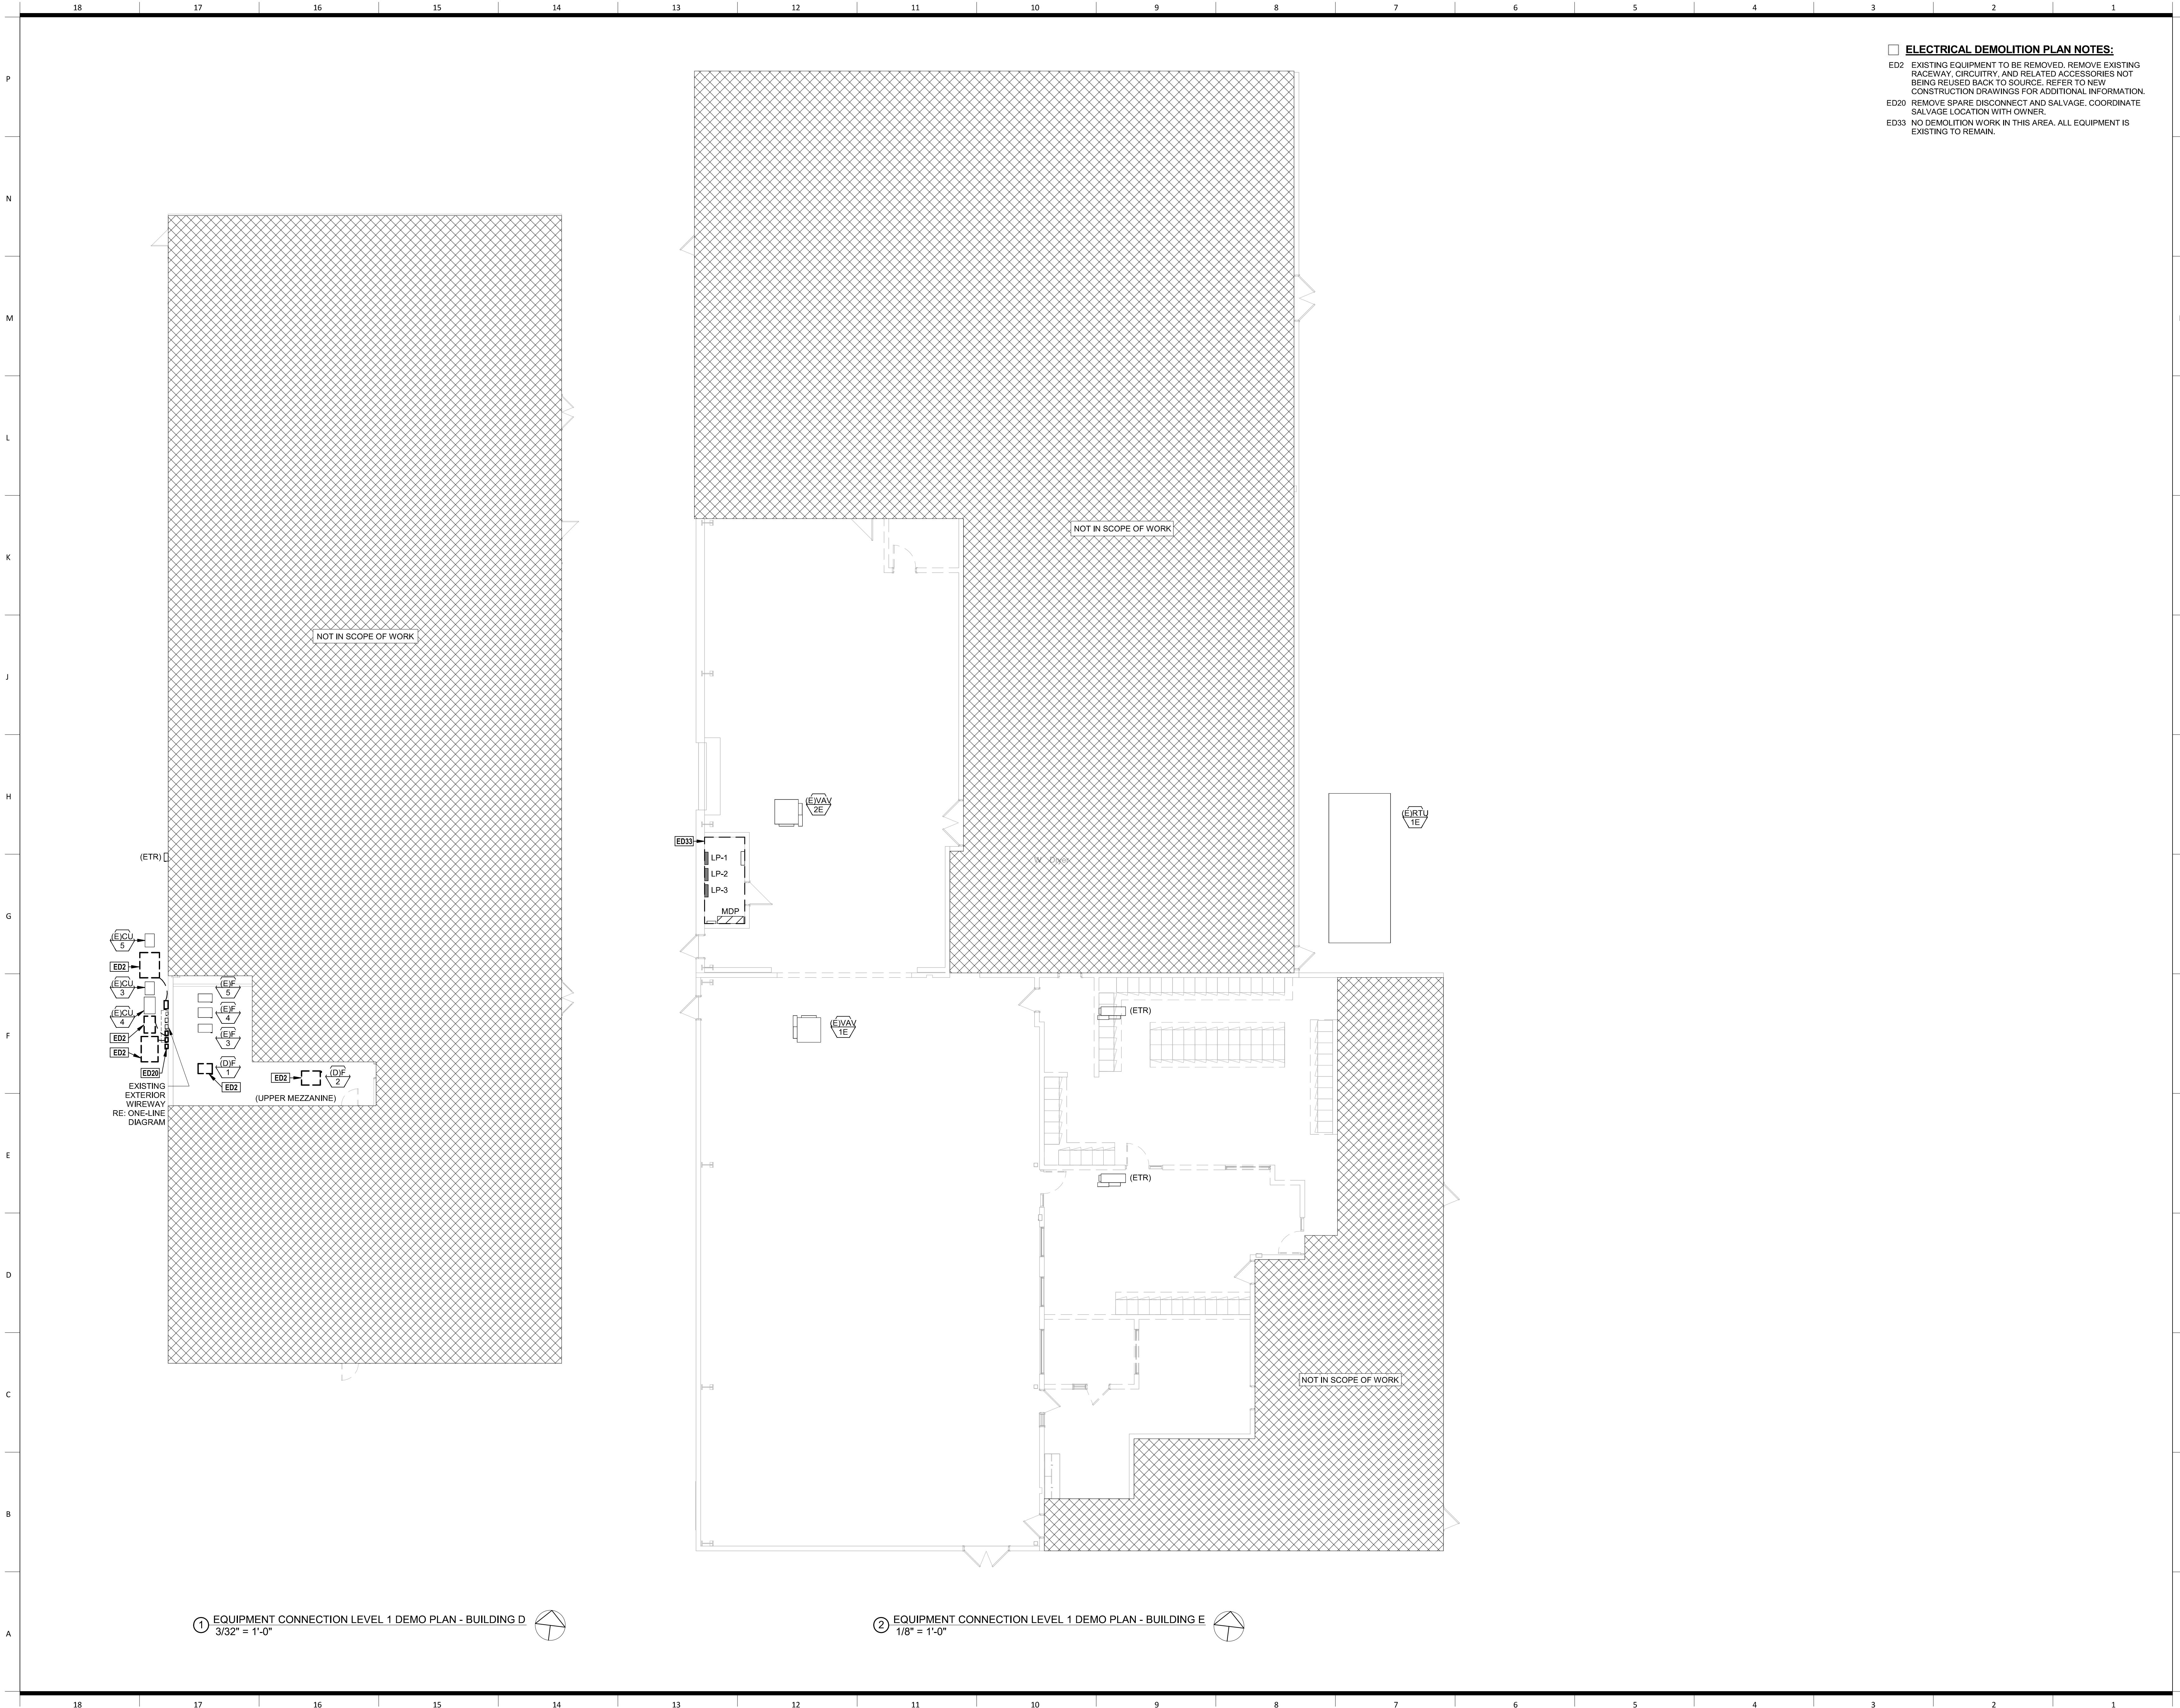

**ELECTRICAL DEMOLITION PLAN NOTES:**  
ED2 EXISTING EQUIPMENT TO BE REMOVED. REMOVE EXISTING RACEWAY, CIRCUITRY, AND RELATED ACCESSORIES NOT BEING REUSED BACK TO SOURCE. REFER TO NEW CONSTRUCTION DRAWINGS FOR ADDITIONAL INFORMATION.  
ED20 REMOVE SPARE DISCONNECT AND SALVAGE. COORDINATE SALVAGE LOCATION WITH OWNER.  
ED33 NO DEMOLITION WORK IN THIS AREA. ALL EQUIPMENT IS EXISTING TO REMAIN.

**LSR7 Robotics, GiC & Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi.studio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveeng.com

structural engineer:  
Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com


MEP/ET/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com



**HENDERSON ENGINEERS**  
8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM  
2150005255  
MO. CORPORATE NO. E-8580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions		
NUMBER	DESCRIPTION	DATE

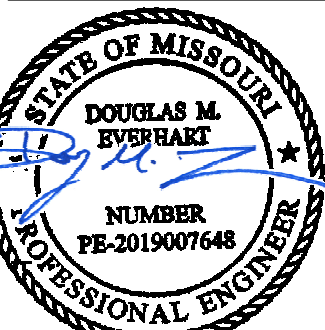

09/09/2022  
DOUGLAS M. EVERHART  
LICENSE # PE-2019007648

**LSHS - EQUIPMENT  
CONNECTION  
DEMOLITION PLAN -  
LEVEL 1 - BUILDING D &  
E**

**ED301-C**



LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect: Multistudio  
4209 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi-studio

civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kvereng.com

structural engineer: Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/IT/Code: Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

0121-0100

ELECTRICAL PLAN NOTES:

ED22 REMOVE PANEL, DISCONNECT ALL EXISTING  
BRANCH CIRCUITRY LOADS AND MAINTAIN  
CONDITION FOR RECONNECTION TO NEW PANEL.

FEEDER SCHEDULE:

SIZES ARE BASED ON COPPER (CU) THHN/THWN-2  
INSULATION. UNO. ALL CONDUCTOR SIZES ARE BASED ON  
75 DEG C RATED TERMINATIONS. UNO. CONDUIT SIZES  
SHOWN ARE APPROPRIATE FOR SCHEDULE 40 PVC, EMT,  
GRS, IMC AND RMC. ADJUST SIZE AS NEEDED FOR OTHER  
RACEWAY TYPES. FOR ANY OTHER CONDITIONS MODIFY  
SIZES PER CODE. REFER TO SPECIFICATIONS FOR  
ADDITIONAL INFORMATION.

FEEDER TAG	FEEDER DESCRIPTION
DEMO	DEMOLISH FEEDER
E33	EXISTING (3) #10, (1) #10 G, 1-1/2" C
E43	EXISTING (3) #8, (1) #10 G, 3/4" C
E104	EXISTING (4) #3, (1) #8 G, 1-1/4" C
E104A	EXISTING (4) #3, (1) #8 G, 1-1/4" C
E104B	EXISTING (4) #3, (1) #8 G, 1-1/2" C
E154	EXISTING (4) #10, (1) #8 G, 2" C
E173	EXISTING (3) #2/0, (1) #8 G, 1-1/2" C
E204A	EXISTING (4) #3/0, (1) #8 G, 2" C
E204B	EXISTING (4) #3/0, (1) #8 G, 2-1/2" C
E224	EXISTING (4) #4/0, (1) #4 G, 2" C
E253	EXISTING (3)-250 kcmil, (1) #4 G, 2-1/2" C
E304	EXISTING (4)-350 kcmil, (1) #4 G, 3" C
E354	EXISTING (4)-500 kcmil, (1) #3 G, 3-1/2" C
E404	EXISTING (2) 2" C, EACH W/ (4) #3/0, (1) #3 G
E804A	EXISTING (2) 3-1/2" C, EACH W/ (4)-500 kcmil, (1) #10 G


① ELECTRICAL PARTIAL ONE-LINE DIAGRAM - DEMO - LSHS BUILDINGS D&E  
NTS



8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM  
2150005255  
MO. CORPORATE NO. E-8680  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions  
NUMBER DESCRIPTION DATE

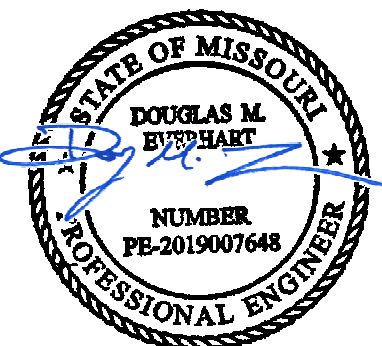

09/09/2022  
DOUGLAS M. EVERHART  
LICENSE # PE-201907648

LSHS - ELECTRICAL  
ONE-LINE DIAGRAM -  
DEMO

ED800-C



ELECTRICAL SYMBOLS

THIS IS A MASTER LEGEND AND NOT ALL SYMBOLS OR ABBREVIATIONS ARE USED.

STANDARD MOUNTING HEIGHTS	ANNOTATION
AUDIBLE APPLIANCE (CENTERLINE)	84"
ALARM (TOP OF DEVICE)	48"
ANNUNCIATOR PANEL (DISPLAY)	48"
CONTROLS (TOP OF DEVICE)	48"
DATA WALL OUTLET	SAME AS ADJACENT DEVICE, UNO
EXIT SIGNS (WALL MOUNTED)	12" ABOVE DOOR OPENING
FIRE ALARM ANNUNCIATOR PANEL (TOP OF DISPLAY)	60"
FIRE ALARM BELL (EXTERIOR) (CENTERLINE)	120"
FIRE ALARM CONTROL PANEL/UNIT (TOP OF DISPLAY)	60"
INTERCOM (TOP OF DEVICE)	48"
PULL STATION (TOP OF DEVICE)	48"
RECEPTACLE	18"
RECEPTACLE (ABOVE COUNTER)	*6" ABOVE BACKSPASH/COUNTER, 40" MAX
RECEPTACLE (CLOCK/CENTERLINE)	54"
RECEPTACLE (EQUIPMENT ROOMS) (TOP OF DEVICE)	54"
RECEPTACLE (EXTERIOR)	24"
RECEPTACLE (GARAGES)	24"
REMOTE INDICATING LIGHT (EQUIPMENT ROOMS) (TOP OF DEVICE)	48"
REMOTE INDICATING LIGHT (FINISHED AREAS)	CEILING
SAFETY SWITCH (TOP OF DEVICE)	48"
STARTER (TOP OF DEVICE)	48"
SWITCH (TOP OF DEVICE)	48"
TELEPHONE WALL OUTLET (TOP OF DEVICE)	48"
TELECOMMUNICATIONS BACKBOARD	48"
TELEVISION OUTLET	REFER TO ARCH
VISIBLE APPLIANCE (CENTERLINE)	84"

INSTALL OUTLET BOXES AT THE MOUNTING HEIGHTS SHOWN ABOVE UNO IN THE CONSTRUCTION DOCUMENTS. MOUNTING HEIGHTS LISTED ABOVE, OR ELSEWHERE IN THE CONSTRUCTION DOCUMENTS, ARE AFF OR AFG TO BOTTOM OF OUTLET BOX UNO. ALL DEVICES SHALL BE INSTALLED IN COMPLIANCE WITH CURRENT ADA AND LOCAL REQUIREMENTS.

ABBREVIATIONS

AF	AMPERE FUSE SIZE	MCC	MOTOR CONTROL CENTER
AFB	ABOVE FINISHED CEILING	MFR	MANUFACTURER
AFD	ABOVE FINISHED FLOOR	MN	MINIMUM
AFG	ABOVE FINISHED GRADE	NLO	NO LOADS ONLY
AHJ	AUTHORITY HAVING JURISDICTION	NLV	MAGNETIC LOW-VOLTAGE
AHU	AIR HANDLING UNIT	NOC	NO MINIMUM OVERCURRENT
AIC	AMPERE INTERRUPTING CAPACITY	MTD	MOUNTED
AS	AMPERE SWITCH SIZE	NF	NOT APPLICABLE
AT	AMPERE TRIP SETTING	NL	NIGHT LIGHT (24HR ON)
ATS	AUTOMATIC TRANSFER SWITCH	NRTL	NATIONALLY RECOGNIZED TESTING LABORATORY
AV	AUDIO VISUAL	NTS	NOT TO SCALE
BAS	BUILDING AUTOMATION SYSTEM	OS	OCCUPANCY SENSOR
BKR	BREAKER	PART	PARTIAL CIRCUIT
C	CATEGORY	PHO	PHASE
CATV	CABLE TELEVISION SYSTEM	PINL	PANEL
CD	CLOSED CIRCUIT TELEVISION	PNLB	PANELBOARD
CD	CABLE	PT	POTENTIAL TRANSFORMER
CKT	CIRCUIT	QTY	QUANTITY
CODE	APPLICABLE CODE	R/REL	RELOCATE
CT	CURRENT TRANSFORMER	RCPT	RECEPTACLE
CTR	CENTER	RLA	RUNNING LOAD AMPS
CVD	CUMULATIVE VOLTAGE DROP	RTU	ROOFTOP UNIT
DD	DEMOLITION	SCCR	SHORT-CIRCUIT CURRENT RATING
DDPT	DOUBLE-THROW	SD	SMOKE DUCT DETECTOR
DPST	DOUBLE-POLE, SINGLE-THROW	SF	SQUARE FEET
E/ETREX	EXISTING TO REMAIN	SPDT	SINGLE-THROW, DOUBLE-THROW
EC	ELECTRICAL CONTRACTOR	SPST	SINGLE-POLE, SINGLE-THROW
EF	EXHAUST FAN	SSBJ	SUPPLY-SIDE BONDING JUNCTION
EM	EMERGENCY	ST	SHUNT TRIP
EMS	EMERGENCY MANAGEMENT SYSTEM	SWBD	SWITCHBOARD
ELV	ELECTRONIC LOW-VOLTAGE	SWGR	SWITCHGEAR
EW	ELECTRIC WATER COOLER	TBB	TELECOMMUNICATIONS BONDING BACKBONE
FAAP	FIRE ALARM ANNUNCIATOR PANEL	TBD	TO BE DETERMINED
FACP	FIRE ALARM CONTROL PANEL	TGB	TELECOMMUNICATIONS GROUND BUS BAR
FCA	FAULT CURRENT AMPS AVAILABLE	TL	TRAILING NEUTRAL
FCU	FAN COIL UNIT	TMBG	TELECOMMUNICATIONS MAIN GROUND BUS BAR
FL	FINISHED FLOOR	TX/FM	TRANSFORMER
FLA	FULL LOAD AMPS	TV	TELEVISION
FLR	FLOOR	U/F	UNDERFLOOR
GC	GENERAL CONTRACTOR	U/G	UNDERGROUND
GEC	GROUNDING ELECTRODE CONDUCTOR	UH	UNIT HEATER
GES	GROUNDING ELECTRODE SYSTEM	UNO	UNLESS NOTED OTHERWISE
GFR	GROUND FAULT RELAY	UPS	UNINTERRUPTIBLE POWER SUPPLY
G	GROUND	VD	VOLTAGE DROP
IG	ISOLATED GROUND	VFD	VARIABLE FREQUENCY DRIVE
ISC	SHORT CIRCUIT CURRENT	VS	VACUANCY SENSOR
JB/BOX	JUNCTION BOX	W	WIRE
LF	LINEAR FEET	W	WITH
LRA	LOCKED ROTOR AMPS	WP	WEATHER PROOF
LTLTS	LIGHTING LIGHTS	WR	WEATHER RESISTANT
MAU	MAKE-UP AIR UNIT	WT	WATERTIGHT
MAX	MAXIMUM	XP	EXPLOSION PROOF
MCA	MINIMUM CIRCUIT AMPACITY		
MCB	MAIN CIRCUIT BREAKER		

LINETYPE LEGEND

THROUGHOUT THE DRAWINGS DIFFERENT LINETYPES ARE USED IN COMBINATION WITH THE SYMBOLS TO INDICATE THE STATUS OF ITEMS AS EXISTING, TO BE DEMOLISHED, TO BE INCLUDED AS PART OF NEW WORK AND/OR ITEMS WHICH ARE ANTICIPATED TO BE PROVIDED IN THE FUTURE. THE STATUS OF ITEMS USING THESE LINETYPES ARE RELATIVE TO THE VIEW IN WHICH THEY APPEAR. PHASING SHOWN IN DRAWINGS IS NOT INTENDED TO FULLY DESCRIBE ALL NECESSARY CONSTRUCTION PHASING, WHICH IS DETERMINED BY THE CONTRACTOR AS PART OF THEIR RESPONSIBILITIES. ANY SUCH PHASING DESCRIBED IN THE CONSTRUCTION DOCUMENTS ARE GENERAL AND ONLY INTENDED TO INDICATE A BROAD ORDER FOR THE SAKE OF DESCRIBING THE PROJECT. THE FOLLOWING LINETYPES MAY BE USED ON ANY DEVICE, EQUIPMENT, NOTE, LINE, SHAPE, ETC.

EXISTING	ARTICLE 700 OR LIFE SAFETY
DEMOLISH	ARTICLE 701 OR CRITICAL / EQUIPMENT BRANCH
NEW	ARTICLE 702 OR OPTIONAL
FUTURE	

APPLICABLE ELECTRICAL CODES:

NOTE: PROJECT IS DESIGNED IN COMPLIANCE WITH THE FOLLOWING CODES. THIS IS NOT AN EXHAUSTIVE LIST. PROJECT SHALL COMPLY WITH ALL APPLICABLE CODES, STANDARDS AND LOCAL REQUIREMENTS. REFER TO THE SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.

ELECTRICAL CODE: 2017 NATIONAL ELECTRICAL CODE, (NFPA 70)  
BUILDING CODE: 2018 INTERNATIONAL BUILDING CODE  
ENERGY CODE: N/A

CIRCUITING & WIRING

7 5 3 OR P1-3/5,7	HOMERUN TO PANELBOARD, INFORMATION AT ARROWS ARE CIRCUIT NUMBERS AND PANELBOARD FOR TERMINATION. REFER TO PANELBOARD SCHEDULES FOR BRANCH CIRCUIT CONDUCTOR SIZES.
—	INDICATES RELAY NUMBER
—	CIRCUIT CONTINUATION OR PARTIAL CIRCUIT
—	CONDUIT CONCEALED
—	CONDUIT CONCEALED (EMERGENCY)
—	CONDUIT IN UNDER FLOOR/GROUND CONSTRUCTION
—	EXPOSED CONDUIT
—	EXPOSED CONDUIT (EMERGENCY)
—	FLEXIBLE CONDUIT
—	LOW VOLTAGE CABLE (NOT ROUTED IN CONDUIT)
—	CONDUIT TURNING DOWN
—	CONDUIT TURNING UP
—	CONNECTION POINT OR EQUIPMENT TERMINATION
—	EQUIPMENT TERMINATION

CONDUCTOR TICK MARK LEGEND

—	SWITCHED HOT (PHASE) CONDUCTORS (SHOWN TRAILING NEUTRAL)
—	NEUTRAL (GROUNDED) CONDUCTOR
—	UNSWITCHED HOT (PHASE) CONDUCTORS (SHOWN LEADING NEUTRAL)
—	NOTE: HASH MARKS INDICATE QUANTITY OF CONDUCTORS
—	EQUIPMENT GROUNDING CONDUCTOR IN CONDUIT (GREEN INSULATION OR BARE)
—	ISOLATED GROUNDING CONDUCTOR IN CONDUIT (GREEN INSULATION WITH YELLOW TRACER)

BRANCH CIRCUIT CONDUCTOR TABLE

# OF POLES	HOT (PHASE)	NEUTRAL	GROUNDING***
1P	(1)	(1) UNO	(1)
2P	(2)	(1) UNO	(1)
3P	(3)	(1) UNO	(1)

\* PROVIDE ADDITIONAL CONDUCTORS THROUGH ENTIRE CIRCUIT (SWITCHED, UNSWITCHED/EM, ETC.) AS INDICATED THROUGHOUT CONSTRUCTION DOCUMENTS AND AS REQUIRED FOR A COMPLETE AND WORKING SYSTEM.

\*\* REFER TO SPECIFICATIONS FOR LIMITATIONS ON SHARING NEUTRAL (GROUNDED) CONDUCTORS. DO NOT CIRCUMVENT A MULTIWIRE BRANCH CIRCUIT, UNO.

\*\*\* PROVIDE ADDITIONAL ISOLATED GROUNDING CONDUCTORS WHERE INDICATED.

REFER TO SPECIFICATIONS, PLANS, NOTES, WIRING AND CONTROL DIAGRAMS FOR ADDITIONAL CIRCUITING REQUIREMENTS.

LIGHTING	
	LIGHT FIXTURE
a	a = LOWER CASE LETTER IS SWITCH IDENTIFIER
A	A = UPPER CASE LETTER INDICATES LIGHT FIXTURE TYPE
	⊥ = WALL MOUNT
	) = ARROW INDICATED AIMING DIRECTION
	LIGHT FIXTURE CIRCUISTED AS A NIGHT LIGHT (NL)
	EMERGENCY LIGHTING FIXTURE WITH EMERGENCY LIGHTING BATTERY PACK OR CONNECTED TO EMERGENCY SOURCE
	NIGHT LIGHT/EMERGENCY LIGHTING FIXTURE WITH EMERGENCY BATTERY PACK OR CONNECTED TO EMERGENCY SOURCE
	LIGHT FIXTURE WITH DUAL BALLASTS CIRCUISTED SEPARATELY (SHADING IMPLIES EMERGENCY LIGHT FIXTURE)
	LIGHTING TRACK (# INDICATES RELAY NUMBER)
	MIRROR LIGHTS
	EXTERIOR PARKING LOT LIGHT FIXTURE
	EXTERIOR PEDESTRIAN POST TOP LIGHT FIXTURE
	EXTERIOR LIT BOLLARD LIGHT
	EXIT SIGN - CEILING / WALL MOUNTED, ARROWS AS INDICATED, FACE HATCHED
	EMERGENCY LIGHTING UNIT EQUIPMENT WITH BATTERY PACK - CEILING/WALL MOUNTED
	AFA (AREA FOR EVACUATION ASSISTANCE) SIGN - CEILING/WALL MOUNTED, ARROWS AS INDICATED

POWER EQUIPMENT & DEVICES

	ELECTRICAL PANELBOARD (SURFACE OR FLUSH MOUNT)
	ELECTRICAL CABINET (SURFACE OR FLUSH MOUNT), TYPE AS NOTED
	PLYWOOD TERMINAL BOARD FOR TELEPHONE SYSTEM, UNO, SIZE AS NOTED
	SWITCHBOARD OR MOTOR CONTROL CENTER ON HOUSEKEEPING PAD
	ELECTRICAL DISTRIBUTION PANELBOARD
	TRANSFORMER
	DISCONNECT SWITCH - "200/3/150/3R" DENOTES AMPERES/POLE/FUSE/NEMA ENCLOSURE RATING, NF=NON-FUSED, CB= CIRCUIT BREAKER (200/3/CB), NO VALUE (200/3/150) FOR NEMA ENCLOSURE MEANS STANDARD NEMA 1 RATING
	COMBINATION DISCONNECT (SAFETY) SWITCH AND MOTOR STARTER "30/3/15/1/3R" DENOTES AMPERES/POLE/FUSE/NEMA STARTER SIZE/NEMA ENCLOSURE RATING, NF=NON-FUSED, CB= CIRCUIT BREAKER (30/3/CB/1), NO VALUE (200/3/150/1) FOR NEMA ENCLOSURE MEANS STANDARD NEMA 1 ENCLOSURE RATING
	MAGNETIC MOTOR STARTER, NEMA SIZE AS NOTED, 3-POLE, UNO
	VARIABLE FREQUENCY DRIVE
	INDICATING LIGHT
	EMERGENCY POWER OFF BUTTON
	STOP-START PUSH BUTTON CONTROL STATION
	HAND-OFF-AUTO PUSH BUTTON CONTROL STATION
	MUSHROOM-TYPE PUSH BUTTON
	OVERHEAD PADDLE FAN

WHERE TICK MARKS ARE NOT SHOWN, THE FOLLOWING SHALL GOVERN:

—	SWITCHED HOT (PHASE) CONDUCTORS (SHOWN TRAILING NEUTRAL)
—	NEUTRAL (GROUNDED) CONDUCTOR
—	UNSWITCHED HOT (PHASE) CONDUCTORS (SHOWN LEADING NEUTRAL)
—	NOTE: HASH MARKS INDICATE QUANTITY OF CONDUCTORS
—	EQUIPMENT GROUNDING CONDUCTOR IN CONDUIT (GREEN INSULATION OR BARE)
—	ISOLATED GROUNDING CONDUCTOR IN CONDUIT (GREEN INSULATION WITH YELLOW TRACER)

\* PROVIDE ADDITIONAL CONDUCTORS THROUGH ENTIRE CIRCUIT (SWITCHED, UNSWITCHED/EM, ETC.) AS INDICATED THROUGHOUT CONSTRUCTION DOCUMENTS AND AS REQUIRED FOR A COMPLETE AND WORKING SYSTEM.

\*\* REFER TO SPECIFICATIONS FOR LIMITATIONS ON SHARING NEUTRAL (GROUNDED) CONDUCTORS. DO NOT CIRCUMVENT A MULTIWIRE BRANCH CIRCUIT, UNO.

\*\*\* PROVIDE ADDITIONAL ISOLATED GROUNDING CONDUCTORS WHERE INDICATED.

REFER TO SPECIFICATIONS, PLANS, NOTES, WIRING AND CONTROL DIAGRAMS FOR ADDITIONAL CIRCUITING REQUIREMENTS.

SPECIAL SYSTEMS SUPPLEMENTAL SPECIFICATIONS:

- PROVIDE NECESSARY BOXES, CONDUIT AND MAKE FINAL CONNECTIONS TO TEMPERATURE CONTROL DEVICES PER MANUFACTURER'S RECOMMENDATIONS. THIS INCLUDES BUT IS NOT LIMITED TO: MAIN CONTROL PANELS, THERMOSTATS, HUMIDISTATS, AC SOLENOIDS, HEAT RECLAIM WIRING, AHU CONTROL WIRING, DUCT FURNACE CONTROL WIRING, TIMERS, AND SIMILAR CONTROLS. PROVIDE CONDUIT FOR ALL WIRING WITHIN WALLS. PROVIDE CONTROL AND INTERLOCK WIRING WHEN NOT PROVIDED BY OTHER TRADES. COORDINATE REQUIREMENTS WITH EQUIPMENT SUPPLIERS AND OTHER TRADES PRIOR TO ROUGH-IN.
- PROVIDE LINE VOLTAGE WIRING AND MAKE FINAL CONNECTIONS TO ALL DUCT-MOUNTED SMOKE DETECTORS, FIRE/SMOKE AND SMOKE DAMPERS WHERE APPLICABLE. COORDINATE REQUIREMENTS WITH OTHER TRADES PRIOR TO INSTALLATION.
- DEVICES MOUNTED ON ACOUSTICAL TILE CEILINGS SHALL BE CENTERED ON THE TILE, UNO.
- PROVIDE BOX AND 3/4" CONDUIT FROM EACH THERMOSTAT LOCATION TO MECHANICAL EQUIPMENT (FLUSH MOUNT BOX WHEREVER PRACTICABLE), COORDINATE LOCATION OF ALL THERMOSTAT BOXES WITH MECHANICAL/CONTROLS CONTRACTOR AND OWNER PRIOR TO ROUGH-IN.
- PROVIDE BOXES AND CONDUITS FOR THE FIRE PROTECTION SYSTEM LOW VOLTAGE WIRING AS REQUIRED. THIS INCLUDES EXPOSED WIRING LESS THAN 96" AFF. AT A MINIMUM, PROVIDE 3/4" CONDUIT, UNLESS NOTED OTHERWISE. COORDINATE REQUIREMENTS AND LOCATIONS WITH SYSTEM INSTALLER AND FIRE ALARM SPECIFICATIONS.
- AT A MINIMUM, PROVIDE EXTRA DEEP, DOUBLE GANG COMMUNICATION OUTLET BOXES, (FLUSH MOUNTED WHEREVER PRACTICABLE), WITH SINGLE-GANG PLASTER RING AND 1" CONDUIT STUBBED-UP CONCEALED TO ACCESSIBLE CEILING SPACE, UNLESS NOTED OTHERWISE. PROVIDE SURFACE MOUNTED DATA BOXES, AND SELECT OTHER LOCATIONS AS INDICATED ON THE DRAWINGS. COORDINATE TELEPHONE/DATA BOX AND CONDUIT LOCATIONS AND SIZES WITH OWNER AND OTHER TRADES PRIOR TO ROUGH-IN.

BOXES, LIGHTING CONTROL & WIRING DEVICES

	SWITCH LETTER DESIGNATIONS AS FOLLOWS: BLANK = SINGLE 2 = TWO POLE 3 = THREE-WAY 4 = FOUR-WAY D = DIMMER F = FAN SPEED CONTROL FH = FRACTIONAL HORSEPOWER MANUAL CONTROLLER H = INTEGRAL HORSEPOWER MANUAL CONTROLLER K = KEYS LV = LOW VOLTAGE / DIGITAL M = MANUAL MOTOR STARTER DISCONNECT OS = OCCUPANCY SENSOR P = SPST PILOT LIGHT WP = WEATHER PROOF # = REFER TO LIGHTING CONTROL DEVICE SCHEDULE
	AUTOMATIC LOAD CONTROL RELAY
	BRANCH CIRCUIT TRANSFER SWITCH
	CEILING / WALL MOUNTED OCCUPANCY SENSOR (# INDICATES TYPE PER SCHEDULE)
	CORNER 90 DEGREE SENSING
	ONE-DIRECTION SENSING, CEILING/WALL MOUNT
	CEILING MOUNT, TWO DIRECTION SENSING
	CEILING MOUNT, FOUR DIRECTION SENSING
	CONTRACTOR (SIZE, COIL VOLTAGE AND NUMBER OF POLES AS INDICATED)
	TRACK-MOUNTED CURRENT LIMITER (## INDICATES AMPERAGE)
	DAYLIGHT SENSOR (# INDICATES TYPE PER SCHEDULE)
	LIGHTING CONTROLS PROCESSOR AND/OR EQUIPMENT
	POWER PACK (# INDICATES TYPE PER SCHEDULE)
	PHOTOELECTRIC SWITCH
	ROOM CONTROLLER (# INDICATES TYPE PER SCHEDULE)
	TIME SWITCH
	SIMPLEX RECEPTACLE - NEMA 5-20R, UNO
	DUPLEX RECEPTACLE - NEMA 5-20R, UNO
	DOUBLE DUPLEX RECEPTACLE - NEMA 5-20R, UNO
	SPECIAL RECEPTACLE - NEMA TYPE AS NOTED
	TWIST-LOCK TYPE RECEPTACLE
	BLANK FACE GFCI FEED THROUGH DEVICE
	GFCI TYPE RECEPTACLE*
	ISOLATED GROUND TYPE RECEPTACLE*
	EMERGENCY RECEPTACLE*
	RECEPTACLE INSTALLED ABOVE COUNTER OR BACKSPASH*
	RECEPTACLE INSTALLED IN CEILING*
	RECEPTACLE INSTALLED IN FLOOR*
	RECEPTACLE INSTALLED VIA DROP CORD*
	RECEPTACLE LETTER DESIGNATIONS AS FOLLOWS: C = AUTOMATICALLY CONTROLLED CH = CLOCK HANGER TYPE G = GFCI PROTECTED BY GFCI CIRCUIT BREAKER OR UPSTREAM GFCI DEVICE H = HORIZONTALLY MOUNTED S = MANUALLY CONTROLLED SP / TVSS = SURGE PROTECTION TRIP - TAMPER RESISTANT TV = TELEVISION USB = USB/DUPLEX WP = WEATHER PROOF COVER WR = WEATHER RESISTANT
	MULTI-OUTLET ASSEMBLY
	TELEPHONE OUTLET
	DATA OUTLET
	MULTI-SERVICE OUTLET; TELEPHONE AND DATA
	ABOVE COUNTER, TYPE
	WALL, TYPE
	FLOOR, TYPE
	MULTI-SERVICE POWER POLE WITH TELEPHONE, DATA AND POWER OUTLETS A = TYPE, REFER TO PLANS, SCHEDULES AND SPECIFICATIONS
	MULTI-SERVICE FLOOR BOX WITH TELEPHONE, DATA AND POWER OUTLETS A = TYPE, REFER TO PLANS, SCHEDULES AND SPECIFICATIONS
	POKE THROUGH, A = TYPE, REFER TO PLANS, SCHEDULES AND SPECIFICATIONS
	THERMOSTAT
	CEILING/FLOOR MOUNT JUNCTION/OUTLET BOX
	WALL MOUNT JUNCTION/OUTLET BOX

\* SYMBOL DEMONSTRATED WITH DUPLEX RECEPTACLE. WHEN USED IN COMBINATION WITH OTHER DEVICES MEANING IS SIMILAR FOR THOSE DEVICE TYPES.

REFER TO LIGHTING CONTROL DEVICE SCHEDULE FOR MORE INFORMATION.

ELECTRICAL ONE-LINE & RISER DIAGRAM

	SWITCH (RATING AS INDICATED)
	DRAWOUT CIRCUIT BREAKER (RATINGS AS INDICATED)
	FUSED SWITCH (RATING, POLES AND FUSE TYPE AS INDICATED)
	COMBINATION FUSED SWITCH/STARTER AND STARTER SIZE
	CIRCUIT BREAKER (RATINGS AS INDICATED)
	COMBINATION CIRCUIT BREAKER/STARTER AND STARTER SIZE
	PANELBOARD, SINGLE OR MULTI-SECTION (REFER TO SCHEDULES)
	ISOLATED POWER PANELBOARD W/ INTEGRAL TRANSFORMER (REFER TO SCHEDULES)
	TRANSFORMER (TYPE AND RATINGS AS INDICATED)
	SHIELDED TRANSFORMER (TYPE AND RATINGS AS INDICATED)
	AUTOMATIC TRANSFER SWITCH (RATINGS AS INDICATED)
	AUTOMATIC TRANSFER SWITCH WITH BYPASS (RATINGS AS INDICATED)
	GENERATOR (RATINGS AS INDICATED)
	NON-SEPARATELY DERIVED SOURCE
	SEPARATELY DERIVED SOURCE
	SWITCHGEAR, SWITCHBOARD AND/OR DISTRIBUTION PANELBOARD (TYPE, RATING, DEVICES AND ACCESSORIES AS INDICATED)
	COMBINATION DIGITAL VOLT METER/AMMETER
	CIRCUIT IDENTIFICATION (REFER TO CIRCUIT SCHEDULE)
	GROUND FAULT RELAY
	PHASE FAILURE RELAY
	KIRK-KEY INTERLOCK (# INDICATES KEY PAIR)
	SHUNT TRIP
	AMMETER (RANGE AS SPECIFIED OR REQUIRED)
	VOLTMETER (RANGE AS SPECIFIED OR REQUIRED)
	UTILITY METER (AS REQUIRED BY UTILITY)
	AMMETER SWITCH
	VOLTMETER SWITCH
	WATT-HOUR METER, "D" DENOTES DEMAND REGISTER, "15" DENOTES MINUTES OF DEMAND INTERVAL
	CURRENT TRANSFORMER RATING AS SPECIFIED OR REQUIRED
	POTENTIAL TRANSFORMER RATING AS SPECIFIED OR REQUIRED
	SURGE-PROTECTIVE DEVICE
	GROUND CONNECTION
	GROUND ROD
	LIGHTNING ARRESTER
	CAPACITOR
	CONTACT (OPEN OR CLOSED)
	HEATER
	MOTOR
	BLOCK LOAD KW OR KVA
	FAULT POINT REFERENCED IN SHORT CIRCUIT CURRENT AND VOLTAGE DROP SPREADSHEET
	CALL OUTS
	ENLARGED PLAN CALLOUT
	NOT IN SCOPE

ELECTRICAL SUPPLEMENTAL SPECIFICATIONS:

- EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND SITE VISITS AND MAY NOT REFLECT ACTUAL "AS-BUILT" CONDITIONS. VERIFY EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BID. COORDINATE NEW AND DEMOLITION WORK WITH ALL OTHER TRADES AND EXISTING CONDITIONS.
- NOTIFY ARCHITECT, ENGINEER AND OWNER, AS APPLICABLE, IF ANY DANGEROUS CONDITIONS EXIST ON JOB SITE BEFORE ANY DEMOLITION OR REMODEL WORK BEGINS.
- FOR AREAS AND EQUIPMENT WITHIN THE SCOPE OF THIS REMODEL: EXISTING ELECTRICAL EQUIPMENT AND CIRCUITRY MAY BE REUSED IF IN GOOD CONDITION AND NEW DESIGN REQUIREMENTS CAN BE MET; OTHERWISE REPLACE.
- FOR AREAS AND EQUIPMENT WITHIN THE SCOPE OF THIS REMODEL: REPAIR OR REPLACE ANY EXISTING DAMAGED OR RECALLED ELECTRICAL EQUIPMENT, LIGHT FIXTURES, WIRING DEVICES AND RELATED CIRCUITRY AND RESTORE ALL ELECTRICAL SYSTEMS TO PROPER WORKING ORDER. THE FINAL ELECTRICAL INSTALLATION SHALL BE FREE FROM ELECTRICAL DEFECTS TO THE SATISFACTION OF THE AHJ, OWNER, ARCHITECT AND ENGINEER.
- PRIOR TO SUBMITTING BID, VISIT THE JOB SITE AND BECOME FULLY ACQUAINTED WITH THE EXISTING CONDITIONS, AS APPLICABLE. REVIEW THE OWNER CRITERIA, GENERAL NOTES, OTHER TRADE DRAWINGS AND SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS THAT MAY NOT BE CALLED OUT IN THIS PORTION OF THE CONSTRUCTION DOCUMENTS. NOTIFY ARCHITECT AND ENGINEER OF ANY CONFLICTS OR DISCREPANCIES PRIOR TO SUBMITTING BID.
- ALL WORK SHALL CONFORM TO ALL LOCAL CODES AND ORDINANCES AS WELL AS APPLICABLE INDUSTRY STANDARDS. ALL EQUIPMENT SHALL BEAR LABELS FOR THE USE INTENDED BY AN AHJ ACCEPTED NATIONALLY RECOGNIZED TESTING LABORATORY (NRTL), SUCH AS UL OR ETL. THE FINAL ELECTRICAL INSTALLATION OF THE FACILITY OCCUPIED BY OWNER SHALL BE FREE FROM ELECTRICAL DEFECTS TO THE SATISFACTION OF THE AHJ, OWNER, ARCHITECT AND ENGINEER.
- COORDINATE FINAL LOCATION AND INSTALLATION REQUIREMENTS OF ALL LIGHT FIXTURES, ELECTRICAL EQUIPMENT AND ELECTRICAL DEVICES WITH ARCHITECTURAL DRAWINGS, EXISTING CONDITIONS AND OTHER TRADES PRIOR TO ROUGH-IN. PROVIDE ALL NECESSARY DEVICES, CORDS, PLUGS, DISCONNECTS AND FINAL CONNECTIONS TO ELECTRICAL EQUIPMENT FOR PROPER OPERATION IN ACCORDANCE WITH CODE, OWNER AND MANUFACTURER REQUIREMENTS.
- ELECTRICAL DRAWINGS ARE DIAGRAMMATIC/SCHEMATIC IN NATURE AND REPRESENT THE GENERAL SCOPE OF WORK. THE DESIGN CALCULATIONS BY THE DESIGN PROFESSIONAL, UNLESS NOTED OTHERWISE, LENGTHS SHOWN SHALL NOT BE USED TO ASSIST IN THE BIDDING TAKEOFF PROCESS. THE CONTRACTOR IS SOLELY RESPONSIBLE FOR THE MATERIAL QUANTITIES REQUIRED TO BID AND CONSTRUCT THE COMPLETE PROJECT.
- ALL CONDUCTOR AND CONDUIT LENGTHS SHOWN IN THESE DESIGN DOCUMENTS ARE INTENDED SOLELY FOR USE IN THE DESIGN CALCULATIONS BY THE DESIGN PROFESSIONAL. UNLESS NOTED OTHERWISE, LENGTHS SHOWN SHALL NOT BE USED TO ASSIST IN THE BIDDING TAKEOFF PROCESS. THE CONTRACTOR IS SOLELY RESPONSIBLE FOR THE MATERIAL QUANTITIES REQUIRED TO BID AND CONSTRUCT THE COMPLETE PROJECT.
- PROVIDE PROPER FIRE PROOFING AND SEALANT FOR PENETRATIONS THROUGH FIRE RATED ASSEMBLIES. THE FIRE STOPPING METHOD, MATERIAL AND ITS APPLICATION SHALL BE NRTL LISTED, CODE COMPLIANT AND APPROVED BY AHJ.
- WHEN CONCRETE TRENCHING/CORING IS REQUIRED, THE METHODS, DEPTHS, AND LOCATIONS SHALL BE PRE-APPROVED BY ARCHITECT AND STRUCTURAL ENGINEER PRIOR TO THE START OF WORK. X-RAY SLAB AS NECESSARY TO AVOID DAMAGING ANY UNDER-SLAB UTILITIES OR STRUCTURE. SLAB REPLACEMENT SHALL BE INSTALLED WITH DOVELLING AND REINFORCED CONCRETE AS DIRECTED BY THE STRUCTURAL ENGINEER. WHERE SLAB ON GRADE IS SAW-CUT AND REMOVED FOR TRENCHING THE CONTRACTOR SHALL INSTALL MOISTURE BARRIER PER LANDLORDS REQUIREMENTS. PROVIDE 3/4" MINIMUM CONDUITS ROUTED THROUGH SLAB AND STUBBED UP INTO DEVICES. FOR SLAB ON DECK, THE FLOOR SHALL BE SLEEVED AND EQUIPPED WITH THE APPROPRIATE LISTED ASSEMBLY. PROVIDE 3/4" MINIMUM CONDUITS ROUTED BELOW SLAB, TIGHT TO STRUCTURE, AND STUBBED UP INTO DEVICES.
- ALL APPLICABLE SWITCHES, RECEPTACLES, OUTLETS, AND CONTROLS SHALL BE PLACED AT HEIGHTS THAT ARE IN ACCORDANCE WITH ADA ACCESSIBILITY GUIDELINES.
- COORDINATE FLOOR MOUNTED BOX, RECEPTACLE, AND COVER PLATE TYPES WITH ARCHITECT AND OWNER PRIOR TO ORDER.
- WIRING DEVICES ADJACENT TO EACH OTHER SHALL BE INSTALLED UNDER A SINGLE COVER PLATE, UNO.
- WIRING DEVICES SHOWN BACK-TO-BACK ON A COMMON WALL SHALL BE OFFSET A MINIMUM OF 12" HORIZONTALLY TO REDUCE SOUND TRANSMISSION BETWEEN ROOMS, UNO.
- ALL WIP OUTLET BOX HOODS SHALL BE "EXTRA-DUTY" AND "WHILE-IN-USE COVER" TYPE. OUTLET BOX HOODS SHALL BE LOW PROFILE WHEREVER PRACTICABLE, UNLESS NOTED OTHERWISE. THE USE OF LARGE BUBBLE COVERS SHALL BE AVOIDED ON THE EXTERIOR OF THE BUILDING OR BEHIND EQUIPMENT IN ORDER TO PREVENT DAMAGE TO THE COVER AND TO ALLOW THE EQUIPMENT TO BE LOCATED CLOSE TO THE WALL.
- ALL 120V RECEPTACLES 50A OR LESS, 208V AND 240V RECEPTACLES 100A OR LESS, SHALL BE GFCI PROTECTED IN LOCATIONS REQUIRED BY CODE. THIS INCLUDES EXTERIOR LOCATIONS AND RECEPTACLES WITHIN 6 FEET OF A SINK. GFCI RECEPTACLES SHALL BE READILY ACCESSIBLE AND SHALL NOT BE LOCATED BEHIND STATIONARY EQUIPMENT. GFCI PROTECTION MAY BE VIA A GFCI CIRCUIT BREAKER OR GFCI RECEPTACLE, UNLESS NOTED OTHERWISE. WHERE NECESSARY, GFCI PROTECTION MAY BE ACHIEVED VIA A BLANK FACE GFCI DEVICE LOCATED IN A READILY ACCESSIBLE LOCATION NEAR RECEPTACLE BEING PROTECTED. FOR DOWNSTREAM WIRING DEVICES LOCATED ON THE SAME BRANCH CIRCUIT, THE GFCI PROTECTION MAY BE PROVIDED FOR BY A SINGLE UPSTREAM DEVICE IF ALL PROTECTED DEVICES ARE LABELED PER CODE.
- PROVIDE TAMPER-RESISTANT (TR) TYPE RECEPTACLES AT ALL CODE REQUIRED LOCATIONS AND AT LOCATIONS WHERE RECEPTACLES ARE MOUNTED LESS THAN 5'-6" AFF AND ARE EASILY ACCESSIBLE BY CHILDREN, UNLESS NOTED OTHERWISE.
- FLEXIBLE CONDUIT IS ONLY PERMITTED WHERE SPECIFICALLY ALLOWED IN THE CONSTRUCTION DOCUMENTS, WHERE CONCEALED FROM VIEW OR EXPOSED FINAL CONNECTIONS TO LIGHT FIXTURES AND EQUIPMENT IN LENGTHS OF 6'-0" OR LESS.
- ALL EMPTY CONDUIT/RACEWAY SHALL BE INSTALLED WITH PULL STRINGS. TERMINATE CONDUIT STUB-UP WITH A NYLON BUSHING.
- EXPOSED CONDUIT/RACEWAY SHALL BE PAINTED TO MATCH ADJACENT SURFACE, UNLESS NOTED



LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi.studio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com

structural engineer:  
Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com


MEP/ET/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com



8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM  
2150005255  
MO. CORPORATE NO. E-658D  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions		
NUMBER	DESCRIPTION	DATE

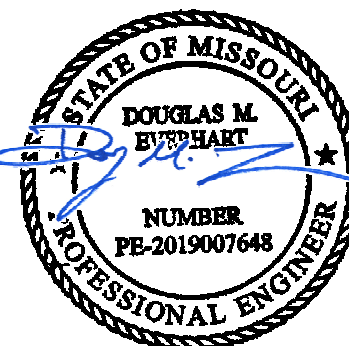

09/09/2022  
DOUGLAS M. EVERHART  
LICENSE # PE-201907648


LSHS - ELECTRICAL SITE  
PLAN

E100-C

1 ELECTRICAL SITE PLAN - LSHS  
1" = 20'-0"



## E101-C

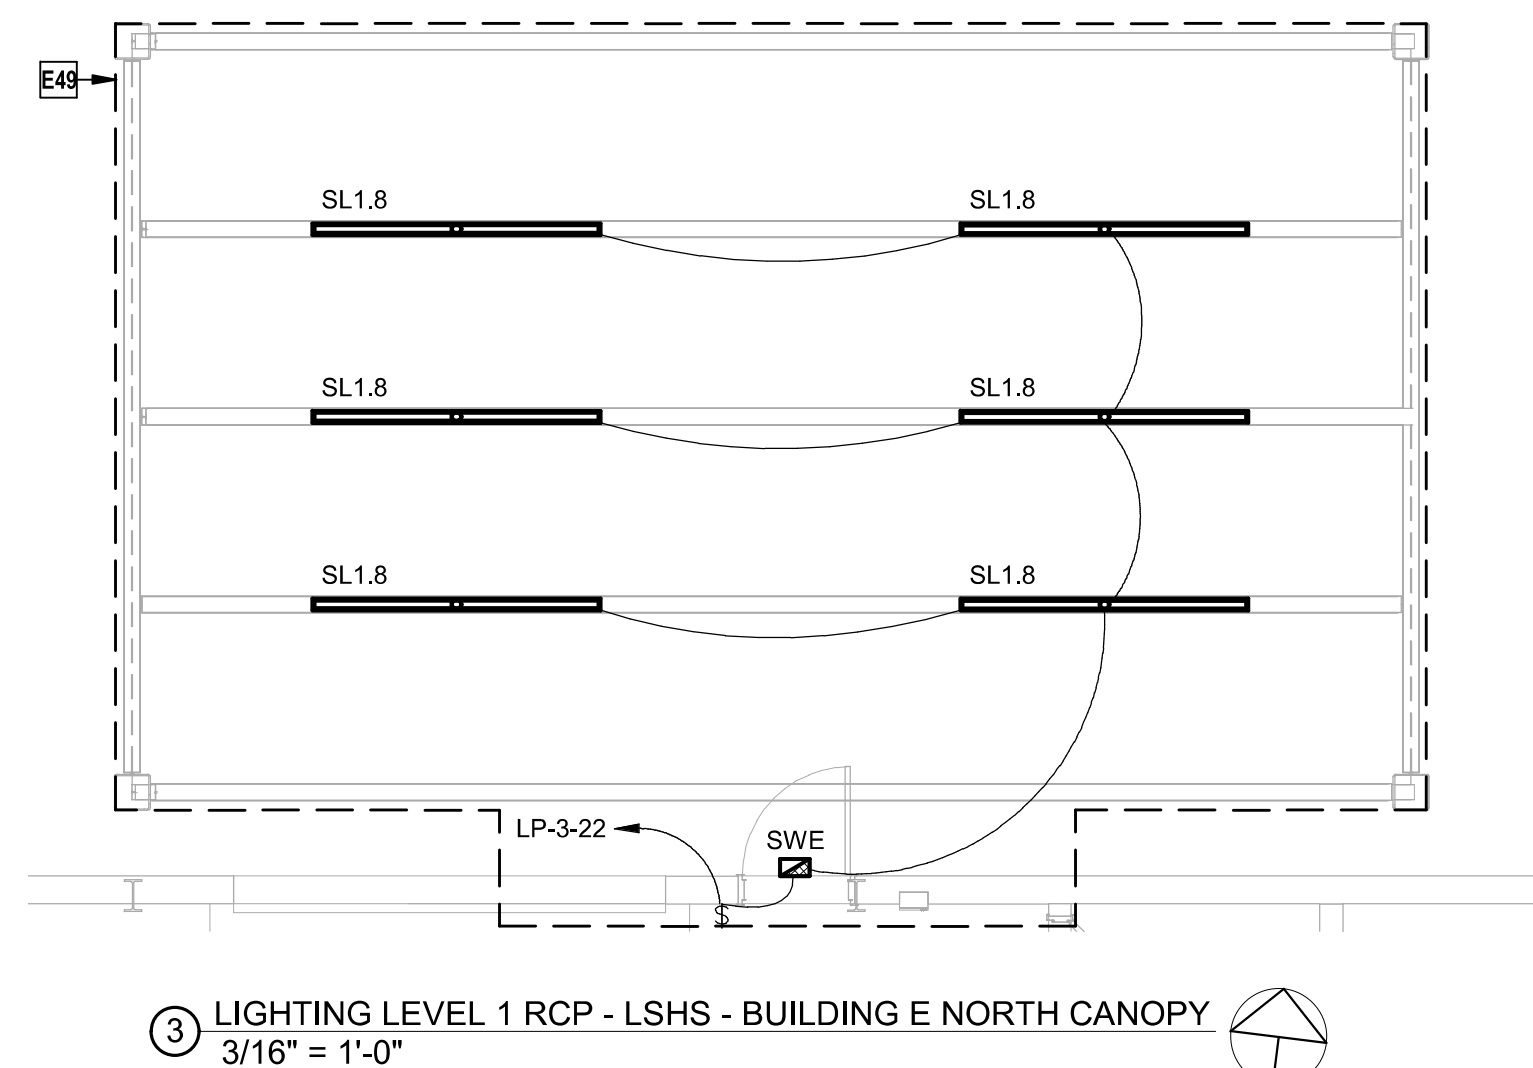



LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4209 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multistudio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveeng.com

structural engineer:  
Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/ET/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com




8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM  
2150005255  
MO. CORPORATE NO. E-8580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions

NUMBER DESCRIPTION DATE

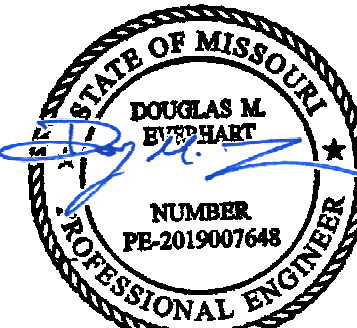

09/09/2022  
DOUGLAS M. EVERHART  
LICENSE # PE-2019007648

LSHS - POWER PLAN -  
LEVEL 1 - BUILDING D &  
E

E201-C

NO EXPOSED CONDUITS SHALL PENETRATE FINISHED PLYWOOD ON WALLS. ALL CONDUITS SHALL ROUTE ABOVE PLYWOOD WHEN PENETRATING WALLS. ALL SURFACE MOUNTED CONDUIT SHALL FIT BEHIND NEW PLYWOOD FURRING. RE: ARCH FOR LOCATIONS AND EXACT HEIGHTS OF FINISHED PLYWOOD.


VERIFY ALL EQUIPMENT PLUG TYPES AND ASSOCIATED RECEPTACLE NEMA RATINGS PRIOR TO ROUGH-IN.

ROBOTICS EQUIPMENT SCHEDULE


TAG	EQUIPMENT DESCRIPTION	VOLTAGE	PHASE	RECEPTACLE TYPE
1B	BRIDGEPORT 3-AXIS CNC	208 V	3	15-20R
2B	HURCO BMC-2416 CNC	208 V	3	HARDWIRED
3B	HURCO HAWK 5M 3-AXIS CNC	208 V	3	15-30R
4B-1	HARDINGE LATHE (MAIN)	208 V	3	14-20R
4B-2	HARDINGE LATHE (CONTROLS)	120 V	1	5-20R
5B	DEWALT MITER SAW	120 V	1	5-20R
6B	BURR KING BELT SANDER	120 V	1	5-20R
7B	WILTON A5816 DRILL PRESS	120 V	1	5-20R
8B/10B	RYOBI BENCH GRINDER SHOP FOX DISC SANDER	120 V	1	RE: PLAN NOTE
9B	JET VERTICAL BANDSAW	208 V	3	14-20R
18B-1	TIG WELDER (MAIN)	208 V	1	6-50R
18B-2	TIG WELDER (MISC)	120 V	1	5-20R

GIC EQUIPMENT SCHEDULE

TAG	EQUIPMENT DESCRIPTION	VOLTAGE	PHASE	RECEPTACLE TYPE
1A	AIR COMPRESSOR	208 V	3	HARDWIRED
2A	MITER SAW	120 V	1	5-20R
3A	PANEL SAW	120 V	1	5-20R

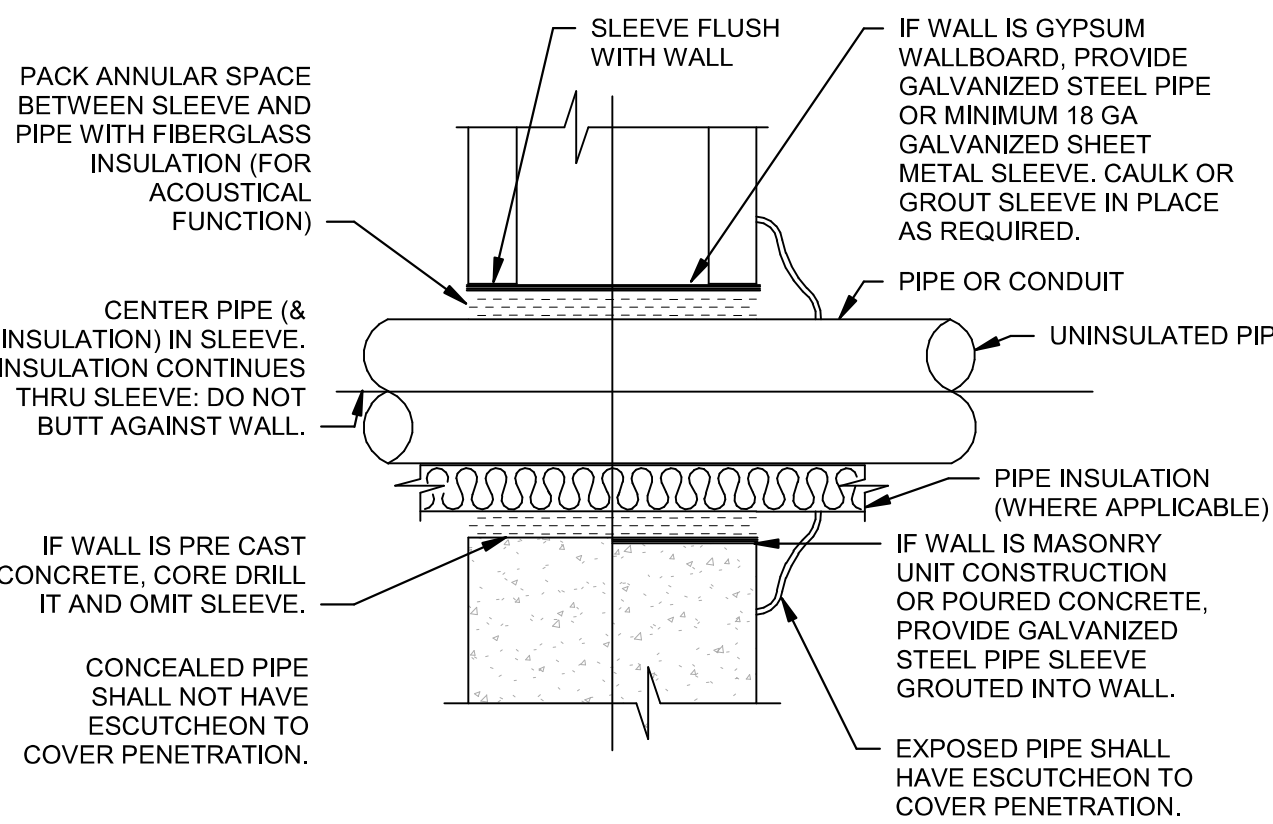

4 CONDUIT PENETRATION THRU NON-FIREWALL NTS

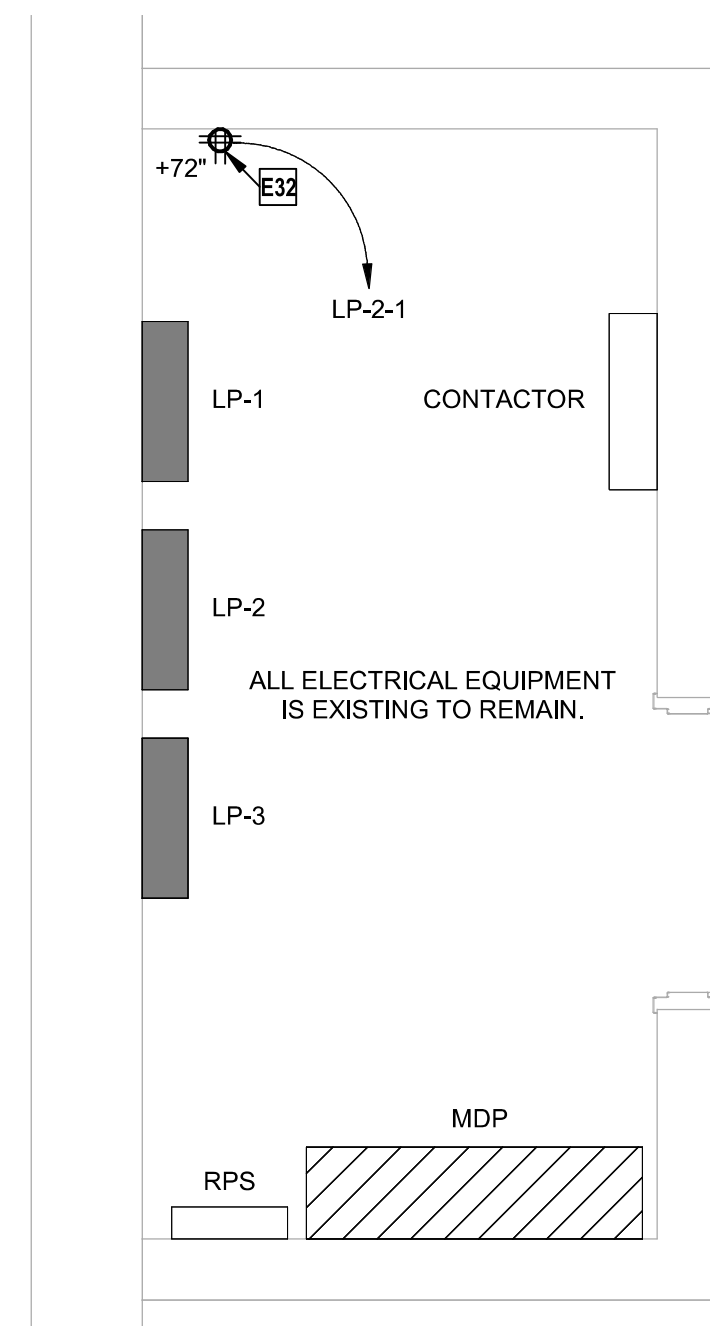

3 POWER LEVEL 1 PLAN - LSHS - BUILDING E - ELEC ROOM 1/2" = 1'-0"

2 POWER LEVEL 1 PLAN - LSHS - BUILDING E 1/8" = 1'-0"

1 POWER LEVEL 1 PLAN - LSHS - BUILDING D 3/32" = 1'-0"



① EQUIPMENT CONNECTION LEVEL 1 PLAN - LSHS - BUILDING D  
3/32" = 1'-0"

② EQUIPMENT CONNECTION LEVEL 1 PLAN - LSHS - BUILDING E  
1/8" = 1'-0"

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4209 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multistudio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveg.com

structural engineer:  
Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/ET/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

HENDERSON  
ENGINEERS  
8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM

2150005255  
MO. CORPORATE NO. E-8580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions  
NUMBER DESCRIPTION DATE

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

HENDERSON  
ENGINEERS  
8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM

2150005255  
MO. CORPORATE NO. E-8580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions  
NUMBER DESCRIPTION DATE

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

HENDERSON  
ENGINEERS  
8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM

2150005255  
MO. CORPORATE NO. E-8580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions  
NUMBER DESCRIPTION DATE

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

HENDERSON  
ENGINEERS  
8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM

2150005255  
MO. CORPORATE NO. E-8580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions  
NUMBER DESCRIPTION DATE

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

HENDERSON  
ENGINEERS  
8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM

2150005255  
MO. CORPORATE NO. E-8580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions  
NUMBER DESCRIPTION DATE

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

HENDERSON  
ENGINEERS  
8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM

2150005255  
MO. CORPORATE NO. E-8580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions  
NUMBER DESCRIPTION DATE

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

HENDERSON  
ENGINEERS  
8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM

2150005255  
MO. CORPORATE NO. E-8580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions  
NUMBER DESCRIPTION DATE

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

HENDERSON  
ENGINEERS  
8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM

2150005255  
MO. CORPORATE NO. E-8580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions  
NUMBER DESCRIPTION DATE

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

HENDERSON  
ENGINEERS  
8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM

2150005255  
MO. CORPORATE NO. E-8580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions  
NUMBER DESCRIPTION DATE

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

HENDERSON  
ENGINEERS  
8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM

2150005255  
MO. CORPORATE NO. E-8580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions  
NUMBER DESCRIPTION DATE

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

HENDERSON  
ENGINEERS  
8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM

2150005255  
MO. CORPORATE NO. E-8580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions  
NUMBER DESCRIPTION DATE

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

HENDERSON  
ENGINEERS  
8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM

2150005255  
MO. CORPORATE NO. E-8580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions  
NUMBER DESCRIPTION DATE

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

HENDERSON  
ENGINEERS  
8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM

2150005255  
MO. CORPORATE NO. E-8580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions  
NUMBER DESCRIPTION DATE

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

HENDERSON  
ENGINEERS  
8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM

2150005255  
MO. CORPORATE NO. E-8580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions  
NUMBER DESCRIPTION DATE

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100



DOUGLAS M. EVERHART

PANELBOARD: LP-1 (EXISTING)

BUS AMPS: 400A  
MAIN SIZE/TYPE: MLO  
VOLTS/PHASE: 208Y/120 V 3P/4W  
SUPPLIED BY: MDP

FAULT CURRENT: <10,000  
AIC RATED: FULLY RATED  
AIC RATING: 10,000  
SERVES: BUILDING E  
MOUNTING: SURFACE  
LOCATION: ELEC E104

EQUIPMENT GROUND BUS

															LINE-SIDE LUGS: MECHANICAL														
CKT NO.	DESCRIPTION	LOAD TYPE	NOTES	WIRE SIZE	BKR AMP	P	PHASE A		PHASE B		PHASE C		P	BKR AMP	WIRE SIZE	NOTES	LOAD TYPE	DESCRIPTION		CKT NO.									
1	RCPT - WEIGHTS GENERAL	EX	EX	20	1		720	250		720	540			1	20	EX	EX		WATER COOLER - WEIGHTS	2									
3	RCPT - MAIN LOCKER GENERAL	EX	EX	20	1					720	540			1	20	EX	EX		RCPT - WHIRLPOOL	4									
5	RCPT - AUX LOCKER GENERAL	EX	EX	20	1							720	720	1	20	EX	EX		RCPT - TRAINER	6									
7	RCPT - CARDIO EQUIPMENT	EX	EX	20	1		720	720						1	20	EX	EX		RCPT - TRAINER	8									
9	RCPT - COACHES LOCKER	EX	EX	20	1					720	720			1	20	EX	EX		RCPT - TRAINER	10									
11	RCPT - COACHES OFFICE	EX	EX	20	1							540	500	1	20	EX	EX		EF-2	12									
13	RCPT - COACHES OFFICE	EX	EX	20	1		540	250						1	20	EX	EX		WATER COOLER - WRESTLING	14									
15	PROJECTOR - LOCKER	EX	EX	20	1					500	800			1	20	EX	EX		RCPT - WASHER	16									
17	PROJECT/SMART BOARDS - WEIGHTS	EX	EX	20	1							500	0	1	20	EX	EX		SPARE - ABV CLG IN COACH OFFICE	18									
19	PROJECTOR - WRESTLING	EX	EX	20	1		500	1200						1	20	EX	EX		ICE MACHINE - TRAILER	20									
21	SCOREBOARDS - WRESTLING	EX	EX	20	1					500	250			1	20	EX	EX		PLASMA SCREEN - WRESTLING	22									
23	RCPT - WRESTLING GENERAL	EX	EX	20	1						720	250	1	20	EX	EX		SPEAKERS - WRESTLING	24										
25	CEILING FANS - WRESTLING	EX	EX	20	1		500	800						1	20	EX	EX		RCPT - WASHER	26									
27	PROJECTOR SCREEN	EX	EX	20	1					500	2200			2	30	EX	EX		RCPT - DRYER	28									
29	RCPT - AV CLOSET	EX	EX	20	1						500	2200								30									
31							6000	540						1	20	EX	EX		RCPT - LAUNDRY ROOM/UNIFORMS	32									
33	VAV 1-1	EX	EX	70	3					6000	500			1	20	EX	EX		WH RECIRC PUMP	34									
35												6000	500	1	20	EX	EX		BAS PANEL	36									
37							6000	1500												38									
39	VAV 1-2	EX	EX	70	3					6000	1500			3	20	EX	EX		UH-1	40									
41												6000	1500							42									
43	VAV 1-3	EX	EX	70	3					6000	2000			3	25	EX	EX		VAV 1-5	44									
45												6000	2000							46									
47							2000	2000												48									
49																				50									
51	VAV 1-4	EX	EX	25	3					2000	2000			3	25	EX	EX		VAV 1-6	52									
53												2000	2000							54									
55	EXHAUST FAN EF-1	EX	EX	20	1		250	1080						1	20	12	R,GF	R	RCPT - LOCKR RM TVS	56									
57	RCPT - HEAD COACH	R	R	12	20	1				540	900			1	20	12	R	R	RCPT - COACHES OFFICE	58									
59	SPARE											0	250	1	20	12	N,GF	Z	RCPT - WEIGHTS EWC	60									
61	EQUIPPED SPACE						0	0											EQUIPPED SPACE	62									
63	EQUIPPED SPACE									0	0								EQUIPPED SPACE	64									
65	EQUIPPED SPACE											0	0	1					EQUIPPED SPACE	66									
67	EQUIPPED SPACE						0	0						1					EQUIPPED SPACE	68									
69	EQUIPPED SPACE									0	0			1					EQUIPPED SPACE	70									
71	EQUIPPED SPACE											0	0	1					EQUIPPED SPACE	72									

LOAD TYPE	CONNECTED LOAD	DEMAND FACTOR	NEC DEMAND	PANELBOARD NOTES	PANELBOARD TOTALS
EXISTING LOAD (E)	98580 VA	100%	98580 VA		TOTAL CONNECTED LOAD 101360 VA
COOLING (C)	0 VA	0%	0 VA		TOTAL NEC LOAD 101360 VA
HEATING (H)	0 VA	100%	0 VA		TOTAL CONNECTED CURRENT 281 A
LIGHTING (L)	0 VA	125%	0 VA		TOTAL NEC DEMAND CURRENT 281 A
RECEPTACLES (R)	2500 VA	100%	2500 VA		
MOTORS (M)	0 VA	100%	0 VA		
SUPPLEMENTAL HEAT (U)	0 VA	100%	0 VA		
MISC EQUIP (Z)	250 VA	100%	250 VA		
REFRIGERATION (F)	0 VA	100%	0 VA		
SIGNAGE (S)	0 VA	125%	0 VA		
KITCHEN (K)	0 VA	100%	0 VA		
LARGEST MOTOR	0 VA	125%	0 VA		
SHOW WINDOW (W)	0 VA	125%	0 VA		
TRACK LIGHTING	0 VA	100%	0 VA		

PANELBOARD: LP-2 (EXISTING)

BUS AMPS: 225A  
MAIN SIZE/TYPE: MLO  
VOLTS/PHASE: 208Y/120 V 3P/4W  
SUPPLIED BY: MDP

FAULT CURRENT: <10,000  
AIC RATED: FULLY RATED  
AIC RATING: 10,000  
SERVES: BUILDING E  
MOUNTING: SURFACE  
LOCATION: ELEC E104

EQUIPMENT GROUND BUS

LINE-SIDE LUGS: MECHANICAL																	CKT NO.	
CKT NO.	DESCRIPTION	LOAD TYPE	NOTES	WIRE SIZE	BKR AMP	P	PHASE A	PHASE B	PHASE C	P	BKR AMP	WIRE SIZE	NOTES	LOAD TYPE	DESCRIPTION	CKT NO.		
1	RCPT - ELEC E104 DATA	Z	R	12	20	1	800	1080		1	20	12	R	R	RCPT - NEW WEIGHTS E	2		
3	RCPT - NEW WEIGHTS W	R	R	12	20	1		900	720	1	20	12	R	R	RCPT - NEW WEIGHTS N	4		
5	WEIGHTS GARAGE DOOR	Z	R	12	20	1			800	0	2	20		D	SPARE	6		
7	SPARE						0	0								8		
9		D			20	2		0	720		1	20	12	R	R	CRD REEL - GIC TABLES 1	10	
11	SPARE				20	2			0	5820							12	
13		D					0	5820		0	5820	3	70	4	N	M	GIC AIR COMPRESSOR	14
15								0	5820								16	
17	SPARE		D		20	3		0	0			0	0				18	
19							0	0				3	20		D		20	
21								0	0						SPARE		22	
23	SPARE		D		20	3			0	720	1	20	12	R	R	CRD REEL - GIC TABLES 2	24	
25							0	720				1	20	12	R	R	CRD REEL - GIC TABLES 3	26
27	RCPT - GIC E WALL	R	R	12	20	1			900	900	1	20	12	R	R	RCPT - GIC SE WALL	28	
29	RCPT - GIC NE WALL	R	R	12	20	1				900	180	1	20	12	R	R	EXT RCPT - GIC CANOPY	30
31	SPARE		D		20	2	0	0			2	20		D			32	
33																	34	
35	GIC N GARAGE DOOR	Z	R	VD	10	20	1			1200	0	2	20		D	SPARE	36	
37	RCPT - GIC ABV CTR W 1	R	R	12	20	1	360	0									38	
39															SPARE		40	
41		D			20	3			0	0	1	20		D			42	
43	SPARE						0	0							EQUIPPED SPACE		44	
45									0	0	2	20		D	SPARE		46	
47	SPARE		D		20	2			0	0							48	
49	EQUIPPED SPACE					1	0	180				1	20	12	R	R	EXT RCPT - EF-1H	50
51	RCPT - GIC ABV CTR W 2	R	R	12	20	1			540	0	1	20		D	SPARE		52	
53	RCPT - GIC PANEL SAW	M	R	VD	10	20				1800	0	1	20		D	SPARE	54	
55	DROP RCPT - GIC MITER SAW	M	R	VD	10	20	1800	0				1	20		D	SPARE	56	
57	EF-1H	M	R	VD	10	20			1656	0	0	1	20		D	SPARE	58	
59	SPARE		D		20	1				0	0	1	20		D	SPARE	60	
61	SPARE		D		20	1	0	0							EQUIPPED SPACE		62	
63	SPARE		D		20	1		0	0			1			EQUIPPED SPACE		64	
65	SPARE		D		20	1			0	0	1				EQUIPPED SPACE		66	
67	SPARE		D		20	1	0	0				1			EQUIPPED SPACE		68	
69	EQUIPPED SPACE					1		0	0	0	1	70			EQUIPPED SPACE		70	
71	EQUIPPED SPACE					1			0	0	0	1			EQUIPPED SPACE		72	



DOUGLAS M. EVERHART

LIGHT FIXTURE SCHEDULE													
TYPE	MANUFACTURER	SERIES / MODEL	APPROVED ALTERNATES	TYPE	CRI	SOURCE CCT	LUMENS	DIMMING TYPE	VOLTAGE	INPUT WATTS	INPUT VA	DESCRIPTION	NOTES
A1	METALUX	24CZ2 SERIES 24CZ2-45-UNV-L935-CD-1-U	HEW LT SERIES LITHONIA BLT SERIES COLUMBIA LCAT SERIES DAY-BRITE CFI SERIES	LED	90	3500K	4500 LM	0-10V	120	35	39	2'X4' CENTER BASKET TROFFER WITH RIBBED FROSTED ACRYLIC LENS. SUITABLE FOR GRID CEILINGS. STANDARD WHITE FINISH.	
A1E	METALUX	24CZ2 SERIES 24CZ2-45-UNV-EL7W-L935-CD-1-U	REFER TO TYPE A1	LED	90	3500K	4500 LM	0-10V	120	35	39	SIMILAR TO TYPE A1 EXCEPT WITH 7W EMERGENCY BATTERY BACKUP.	
D1	H.E. WILLIAMS	4DR SERIES 4DR-TL-L10/935-DIM-UNV-QW-OF-CS-TD-N-F1	PORTFOLIO LDAC SERIES LITHONIA LDW4 SERIES INTENSE GRAVITY SERIES PRESCOLITE LTR-4RD SERIES	LED	90	3500K	1000 LM	0-10V	120	9	10	NOMINAL 4" DIAMETER DOWNLIGHT WITH WIDE DISTRIBUTION OPTICS. CLEAR SEMI-SPECULAR ANODIZED REFLECTOR FINISH. DIFFUSE POLYCARBONATE LENS MEDIA AT TOP OF OPEN REFLECTOR.	
EM1	H.E. WILLIAMS	EMERLED SERIES EMERLED-WHT-SDT-D	COLUMBIA CU250 SERIES LITHONIA EU2C SERIES CHLORIDE VLTU SERIES	LED	N/A	N/A	N/A	N/A	120	2	2	DUAL-HEAD EMERGENCY BUGEYE SUITABLE FOR WALL MOUNTING. 90 MINUTE RUNTIME. SELF-DIAGNOSTIC TEST. STANDARD WHITE FINISH.	
L1B.16	H.E. WILLIAMS	MX4 SERIES MX4D-16-L12/935-P-AC/D96-DIM-UNV	AXIS BEAM SERIES LUMENWERX VIA 4 SERIES ALW LIGHTPLANE SERIES METALUMEN RAIL SERIES PINNACLE EDGE SERIES	LED	90	3500K	1200 LM/FT	0-10V	120	176	194	NOMINAL 4" W X 4" H X 8" LONG FULLY EXTRUDED LINEAR WITH DIRECT OPTICS. PROUD, DIFFUSE ACRYLIC LENS WITH 5/16" DROP. 96" FIELD ADJUSTABLE AIRCRAFT CABLE. BLACK FINISH.	
L1B.24	H.E. WILLIAMS	MX4 SERIES MX4D-24-L12/935-P-AC/D96-DIM-UNV	REFER TO TYPE L1B.16	LED	90	3500K	1200 LM/FT	0-10V	120	264	291	SIMILAR TO L1B.16 EXCEPT 24" IN LENGTH.	
L1BE.16	H.E. WILLIAMS	MX4 SERIES MX4D-16-L12/935-P-AC/D96-EM/7W-DIM-UNV	REFER TO TYPE L1B.16	LED	90	3500K	1200 LM/FT	0-10V	120	176	194	SIMILAR TO TYPE L1B.16 EXCEPT WITH 7W EMERGENCY BATTERY BACKUP.	
L1BE.24	H.E. WILLIAMS	MX4 SERIES MX4D-24-L12/935-P-AC/D96-EM/7W-DIM-UNV	REFER TO TYPE L1B.16	LED	90	3500K	1200 LM/FT	0-10V	120	264	291	SIMILAR TO TYPE L1B.24 EXCEPT WITH 7W EMERGENCY BATTERY BACKUP.	
PL2A.4	STARTEK	BEAM DI SERIES BEAMDI-4-500-350-SD-BW-35K-90-PB-ACW10-U-1C	LUX EOS 4.0 SERIES FINELITE HP-4 SERIES ALW HBEAM 3.5 SERIES AXIS BEAM 4 SERIES	LED	90	3500K	500 LM/FT DOWN 350 LM/FT UP	0-10V	120	40	44	NOMINAL 3.5" W X 3.5" TALL X 4" LONG CONTINUOUS LINEAR CONSTRUCTED IN FULLY ALUMINUM HOUSING. DIRECT/INDIRECT DISTRIBUTION. SATIN ICE DIFFUSE FLUSH LENS FOR DIRECT OPTICS WITH BATWING DISTRIBUTION FOR INDIRECT OPTICS. 10' FIELD CUTTABLE BLACK MOUNTING CORD. BLACK FINISH.	
PL2A.12	STARTEK	BEAMDI-S12-500-350-SD-BW-35K-90-PW-ACW10-U-1C	REFER TO TYPE PL2A.4	LED	90	3500K	500 LM/FT DOWN 350 LM/FT UP	0-10V	120	120	132	SIMILAR TO TYPE PL2A.4 EXCEPT 12" IN LENGTH.	
PL2A.16	STARTEK	BEAMDI-S16-500-350-SD-BW-35K-90-PW-ACW10-U-1C	REFER TO TYPE PL2A.4	LED	90	3500K	500 LM/FT DOWN 350 LM/FT UP	0-10V	120	160	176	SIMILAR TO TYPE PL2A.4 EXCEPT 16" IN LENGTH.	
PL2B.8	STARTEK	BEAMDI-S8-1000-350-SD-BW-35K-90-PW-ACW10-U-1C	REFER TO TYPE PL2A.4	LED	90	3500K	1000 LM/FT DOWN 350 LM/FT UP	0-10V	120	120	132	SIMILAR TO TYPE PL2A.4 EXCEPT 8" IN LENGTH AND WITH HIGHER LUMEN OUTPUT.	
PL2B.16	STARTEK	BEAMDI-S16-1000-350-SD-BW-35K-90-PW-ACW10-U-1C	REFER TO TYPE PL2A.4	LED	90	3500K	1000 LM/FT DOWN 350 LM/FT UP	0-10V	120	240	264	SIMILAR TO TYPE PL2B.8 EXCEPT 16" IN LENGTH.	
PL2B.24	STARTEK	BEAMDI-S24-1000-350-SD-BW-35K-90-PW-ACW10-U-1C	REFER TO TYPE PL2A.4	LED	90	3500K	1000 LM/FT DOWN 350 LM/FT UP	0-10V	120	360	396	SIMILAR TO TYPE PL2B.8 EXCEPT 24" IN LENGTH.	
SL1.8	STARTEK	BEAM D SERIES BEAMD-S8-500-SD-40K-80-PW-U-1C	HEW MX4D SERIES LUX EOS 4.0 SERIES AXIS WET BEAM 4 SERIES LUMENWERX VIA 4 SEAL SERIES ALW LITEPLANE 3.5 SERIES	LED	80	4000K	500 LM/FT	0-10V	120	64	71	NOMINAL 3.5" W X 3.5" TALL X 8" LONG CONTINUOUS LINEAR CONSTRUCTED IN FULLY EXTRUDED ALUMINUM. DIRECT DISTRIBUTION WITH SATIN ICE DIFFUSE LENS. END CONDUIT FEED FOR SURFACE MOUNT APPLICATIONS. BLACK FINISH.	
SWE	LITHONIA	WPX SERIES WPX2LED-40K-MVOLT-E14WC-DNAXD	-	LED	70	4000K	6000 LM	N/A	120	47	52	SIMILAR TO TYPE SW EXCEPT WITH 14W EMERGENCY BATTERY BACKUP.	1
X1	SURE-LITES	EUX SERIES EUX7RSD	LITHONIA COLUMBIA SIGNIFY	LED	N/A	N/A	N/A	N/A	<varies>	5	5	UNIVERSALLY MOUNTED EDGE-LIT EXIT SIGN. RED LETTERING. SELF-DIAGNOSTICS.	

LIGHT FIXTURE SCHEDULE NOTES:

1. BASIS-OF-DESIGN FIXTURE IS SPECIFIED TO MATCH EXISTING FIXTURES FOR RE-USE. ANY SUBSTITUTIONS SHALL BE DIRECTED TO ENGINEER FOR APPROVAL.

LIGHT FIXTURE SCHEDULE SUPPLEMENTAL SPECIFICATIONS:

1. ANY PROPRIETARY, SOLE-SOURCED LIGHT FIXTURE LISTED IN THE LIGHT FIXTURE SCHEDULE SHALL BE UNIT PRICED ONLY. NO PACKAGING OR LOT PRICING OF THESE LIGHT FIXTURES SHALL BE ALLOWED. UNIT PRICES SHALL BE CLEARLY IDENTIFIED ON THE BID FORM.
2. LIGHTING CONTROL S PRICING, INCLUDING BUT NOT LIMITED TO THOSE REFERENCED IN ELECTRICAL SPECIFICATIONS, SHALL BE COMPLETELY SEPARATE OF ANY LIGHT FIXTURE PRICING. ANY LIGHTING CONTROLS PRICING THAT IS SUBMITTED WITH LIGHT FIXTURE PRICING (UNIT OR MIN/LOT) WILL BE IMMEDIATELY REJECTED IN ITS ENTIRETY.
3. CATALOG NUMBERS SHALL NOT BE CONSIDERED COMPLETE AND MATERIAL SHALL NOT BE ORDERED BY MANUFACTURER AND CATALOG NUMBERS ONLY. FIRST READ THE COMPLETE DESCRIPTION, NOTES AND SPECIFICATIONS IN CONJUNCTION WITH THE CATALOG NUMBER TO DETERMINE THE MATERIAL AND ACCESSORIES TO BE ORDERED. THE MANUFACTURERS LISTED ARE THE BASIS FOR THE DESIGN.
4. COORDINATE LIGHT FIXTURE MOUNTING HARDWARE AND TRIMS NEEDED TO SUIT CEILING CONDITIONS. LIGHT FIXTURES NEAR OR IN CONTACT WITH INSULATION SHALL COMPLY WITH CODE. MAINTAIN 3" MINIMUM WORKING CLEARANCE BETWEEN NON-IC RATED LIGHT FIXTURE HOUSINGS AND INSULATION ON ALL ADJACENT DUCTWORK, PIPING, WALLS, AND CEILINGS.
5. ALL LIGHT FIXTURES AND RELATED COMPONENTS SHALL BE PROVIDED BY THE CONTRACTOR, UNLESS NOTED OTHERWISE.
6. THE PARTY SUPPLYING THE LIGHT FIXTURES IS RESPONSIBLE FOR SUPPLYING THE PROPER QUANTITY OF LIGHT FIXTURES.

multistudio  
the evolution of gould evans

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4209 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi.studio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com

structural engineer:  
Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com


MEP/IT/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

HENDERSON  
ENGINEERS  
8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM

2150005255  
MO. CORPORATE NO. E-658D  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions		
NUMBER	DESCRIPTION	DATE

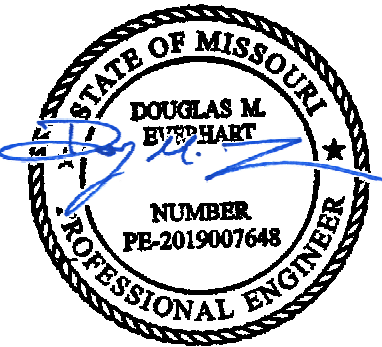

09/09/2022  
DOUGLAS M. EVERHART  
LICENSE # PE-2019007648

LSHS - LIGHT FIXTURE  
SCHEDULE  
E700-C



LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4209 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multistudio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com

MEP/IT/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

structural engineer:  
Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

ONE-LINE DIAGRAM GENERAL NOTES:

- THE INFORMATION SHOWN IN THE SHORT-CIRCUIT AND VOLTAGE DROP CALCULATIONS SCHEDULE IS SHOWN FOR CALCULATION PURPOSES ONLY. CONTRACTOR SHALL NOT USE THE CONDUIT TYPES, CONDUCTOR TYPES, SIZES, QUANTITIES OR LENGTHS FOR TAKEOFFS OR BIDDING PURPOSES. CONTRACTOR SHALL NOTIFY ENGINEER OF ANY CONFLICTS BETWEEN THIS SCHEDULE AND OTHER PORTIONS OF THE CONSTRUCTION DOCUMENTS. CONTRACTOR SHALL NOTIFY ENGINEER OF AS-BUILT CONDITIONS THAT CONSTITUTE A CHANGE FROM WHAT IS SHOWN BELOW. THIS INCLUDES CONDUCTOR LENGTHS DIFFERING BY MORE THAN 10%.
- REFER TO THE SHORT-CIRCUIT AND VOLTAGE DROP CALCULATIONS TABLE ON SHEET E801-C. AVAILABLE FAULT CURRENT INFORMATION IS LISTED UNDER THE "FAULT CURRENT" COLUMN. VOLTAGE DROP VALUES ARE LISTED UNDER THE "CUMULATIVE VOLTAGE DROP" COLUMN. THE AISCOR RATING OF THE EQUIPMENT SHALL NOT BE LESS THAN THE AVAILABLE 3-PHASE SYMMETRICAL FAULT CURRENT. ALL SERIES RATED EQUIPMENT SHALL BE PROPERLY LISTED AND LABELED PER CODE.
- CIRCUITRY SIZES ARE BASED ON COPPER (CU) THHN/THWN-2 INSULATION, UNLESS NOTED OTHERWISE. CONDUIT SIZES SHOWN ARE APPROPRIATE FOR SCHEDULE 40 PVC, EMT, GRS, IMC AND RMC. ADJUST SIZE AS NEEDED FOR OTHER RACEWAY TYPES. ALL CONDUCTOR SIZES ARE BASED ON 75 DEG C RATED TERMINATIONS, UNLESS NOTED OTHERWISE. FOR ANY OTHER CONDITIONS MODIFY SIZES PER CODE. REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- INSTALL FEEDERS OVERHEAD AS HIGH AS PRACTICABLE AND ORTHOGONALLY ALONG BUILDING STRUCTURE, UNLESS NOTED OTHERWISE. COORDINATE FINAL ROUTING WITH OTHER TRADES.
- PROVIDE A PERMANENT LABEL ON FRONT OF EQUIPMENT ENCLOSURE: REFER TO SPECIFICATIONS FOR LABEL REQUIREMENTS. LABEL SHALL READ AS FOLLOWS (INCLUDE RESPECTIVE NAMES IN BLANKS):

SERVICE EQUIPMENT LABEL:

EXAMPLE:  
208Y/120V, 60HZ  
800A  
SCCR = 65,000A  
MAX AVAILABLE FAULT CURRENT = 58,815A  
CALCULATED: 01/01/2018

PANELBOARD/SWITCHBOARD LABEL:  
LINE 1: PANELBOARD - SUPPLIED BY UPSTREAM  
LINE 2: PANELBOARD/SWITCHBOARD -  
LINE 3: LOCATED IN -  
LINE 4: PANELBOARD - SUPPLIES DOWNSTREAM  
LINE 5: PANELBOARD(S) -

ELECTRICAL UTILITY CONTACT NOTE:

UTILITY COMPANY: EVERGY  
UTILITY CONTACT: PHILLIP INGRAM  
PHONE: 816-347-4339  
EMAIL: PHILLIP.INGRAM@EVERGY.COM

FAULT CURRENT GENERAL NOTE (UTILITY VALUE):

THE MAXIMUM AVAILABLE 3-PHASE SYMMETRICAL FAULT CURRENT VALUE AT THE UTILITY TRANSFORMER SECONDARY/POINT OF SERVICE COULD NOT BE DETERMINED AT THE TIME OF THIS SUBMITTAL. THE ESTIMATED WORST CASE VALUE OF 23,530A IS BASED ON AN INFINITE BUS CALCULATION AT THE UTILITY TRANSFORMER. CONTRACTOR SHALL VERIFY ACTUAL AVAILABLE FAULT CURRENT VALUE WITH UTILITY PRIOR TO BEGINNING CONSTRUCTION. NOTIFY ENGINEER IF ACTUAL VALUE EXCEEDS ESTIMATED CALCULATED VALUE. ESTIMATED DESIGN VALUE IS BASED ON THE FOLLOWING:

UTILITY TRANSFORMER SECONDARY VOLTAGE: 208V  
UTILITY TRANSFORMER SIZE: 225 KVA, 3PH 4W

OVERCURRENT PROTECTIVE DEVICE COORDINATION STUDY GENERAL NOTE:

- CONTRACTOR SHALL PROVIDE AN OVERCURRENT PROTECTIVE DEVICE COORDINATION STUDY TO DETERMINE THE CORRECT SETTINGS FOR THE ADJUSTABLE TRIP CIRCUIT BREAKERS TO DOCUMENT ARC-FLASH HAZARDS. PROVIDE ALL NECESSARY AS-BUILT INFORMATION REQUIRED FOR COMPLETION OF THE STUDY TO THE ENGINEER DOING THE STUDY. PROVIDE SUBMITTALS INDICATED WITHIN THE SPECIFICATIONS TO OWNER AND ARCHITECT/ENGINEER TO CONFIRM STUDY HAS BEEN COMPLETED. CONTRACTOR SHALL INCLUDE THE COST FOR THIS WORK IN THEIR BID. REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- PRIOR TO BEGINNING CONSTRUCTION, THE CONTRACTOR SHALL VERIFY THE EXISTING AISCOR RATING OF EACH PANELBOARD/SWITCHBOARD. ALL NEW AND EXISTING OVER-CURRENT PROTECTION DEVICES (CIRCUIT BREAKERS AND FUSES) MUST HAVE AN AISCOR RATING EXCEEDING THE AVAILABLE FAULT CURRENT AT THAT POINT IN THE SYSTEM. NOTIFY THE OWNER AND THE ENGINEER IF THE EXISTING EQUIPMENT DOES NOT COMPLY WITH THIS REQUIREMENT.
- VERIFY THE INTEGRITY OF THE EXISTING GROUNDING ELECTRODE SYSTEM AND THAT THE NEUTRAL AND GROUND ARE PROPERLY BONDED TOGETHER AT THE POINT OF SERVICE ENTRANCE. NOTIFY THE LANDLORD, OWNER AND THE ENGINEER OF ANY EXISTING DEFICIENCIES.

ONE-LINE DIAGRAM SUPPLEMENTAL SPECIFICATIONS:

- GROUNDING ELECTRODE SYSTEM SHALL BE PER LOCAL REQUIREMENTS AND SHALL NOT BE LESS STRINGENT THAN THAT SPECIFIED IN THE CONSTRUCTION DOCUMENTS.
- PROVIDE PROPERLY SIZED LUGS FOR ALL EQUIPMENT, CIRCUIT BREAKERS, AND OTHER ELECTRICAL DEVICES TO ACCOMMODATE INSTALLED CONDUCTORS. A LARGER FRAME, OVERSIZED LUGS OR NON-STANDARD PRODUCT MAY BE REQUIRED IN SOME INSTANCES. UTILIZE PIN ADAPTERS ONLY IF NECESSARY AND ONLY AS ALLOWED BY MANUFACTURER AND AHJ.
- PROVIDE ANY AVAILABLE SPACE IN SWITCHBOARDS/PANELBOARDS WITH BUSSING.
- PROVIDE TYPED FINAL CIRCUIT DIRECTORY FOR ALL PANELBOARDS TO REFLECT ACTUAL AS-BUILT CONDITIONS. COORDINATE FINAL ROOM NAMES, NUMBERS AND DESCRIPTIONS WITH OWNER PRIOR TO COMPLETION. CIRCUIT DESCRIPTIONS SHALL BE PER CODE AND SHALL BE DISTINGUISHABLE FROM ALL OTHERS.

ELECTRICAL PLAN NOTES:

- E30 REPLACE EXISTING 100A FUSED SWITCH WITH NEW SIEMENS 400A/3P CIRCUIT BREAKER. REFER TO SPECIFICATIONS FOR CIRCUIT BREAKER TYPE. PROVIDE NEW FEED AS INDICATED FOR NEW PANELBOARD L1H.
- E31 TAP OFF EXISTING WIREWAY FEEDING CONDENSING UNITS ON WEST SIDE OF BUILDING D. FEED RTU-1H WITH EXISTING 250A FEED. VERIFY EXISTING 250A FEED IS IN GOOD WORKING CONDITION. NOTIFY ENGINEER OF ANY DISCREPANCIES.

FEEDER SCHEDULE:

SIZES ARE BASED ON COPPER (CU) THHN/THWN-2 INSULATION. UNO. ALL CONDUCTOR SIZES ARE BASED ON 75 DEG C RATED TERMINATIONS. UNO. CONDUIT SIZES SHOWN ARE APPROPRIATE FOR SCHEDULE 40 PVC, EMT, GRS, IMC AND RMC. ADJUST SIZE AS NEEDED FOR OTHER RACEWAY TYPES. FOR ANY OTHER CONDITIONS MODIFY SIZES PER CODE. REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.

FEEDER TAG	FEEDER DESCRIPTION
E203	(3) #3/0, (1) #6 G, 2" C
E404	(2) 2" C, EACH W/ (4) #3/0, (1) #3 G
E33	EXISTING (3) #10, (1) #10 G, 1/2" C
E43	EXISTING (3) #8, (1) #10 G, 3/4" C
E104	EXISTING (4) #3, (1) #8 G, 1-1/4" C
E104A	EXISTING (4) #3, (1) #8 G, 1-1/4" C
E104B	EXISTING (4) #3, (1) #8 G, 1-1/2" C
E154	EXISTING (4) #10, (1) #6 G, 2" C
E173	EXISTING (4) #10, (1) #6 G, 1-1/2" C
E204A	EXISTING (4) #3/0, (1) #6 G, 2" C
E204B	EXISTING (4) #3/0, (1) #6 G, 2-1/2" C
E224	EXISTING (4) #4/0, (1) #4 G, 2" C
E253	EXISTING (3)-250 kcmil, (1) #4 G, 2-1/2" C
E304	EXISTING (4)-350 kcmil, (1) #4 G, 3" C
E354	EXISTING (4)-500 kcmil, (1) #3 G, 3-1/2" C
E404	EXISTING (2) 2" C, EACH W/ (6) #3/0, (1) #3 G
E804A	EXISTING (2) 3-1/2" C, EACH W/ (4)-500 kcmil, (1) #1/0 G
ETR	UNKNOWN FEEDER - EXISTING TO REMAIN

EXISTING EXTERIOR WIREWAY LOAD SUMMARY:	
EXISTING CU-5	18A
EXISTING CU-3	24A
EXISTING CU-4	15A
NEW RTU-1H	146A
<b>TOTAL</b>	<b>206A</b>
EXISTING FEEDER 'E253' SUITABLE FOR 250A	

2 ELECTRICAL PARTIAL ONE-LINE DIAGRAM - LSHS BUILDINGS D&E NTS




8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM  
2150005255  
MO. CORPORATE NO. E-8680  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions

NUMBER DESCRIPTION DATE

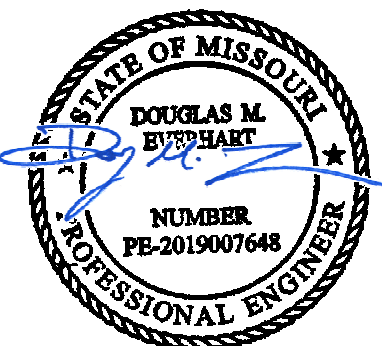

09/09/2022  
DOUGLAS M. EVERHART  
LICENSE # PE-201907648

LSHS - ELECTRICAL  
ONE-LINE DIAGRAM  
E800-C




Utility Voltage: 200V/120V/3 Phase															Use in Calculations																			
Fault Point (F#)	Bus/Feeder Description	Source (Fault Point)	Phase	Source Isc (amps)	Feeder		Conductor Type	TX	Material	Quantity of Parallel Sets and Bus/Phase & Neutral Size	Conductor 'C' Value	Busway 'C' Value	L-L Voltage (E)	Circuit Length (L)	Load Power Factor (pf)	Circuit Load (Amperage)	Conductor		Transformer				Type	Degree Rise	kVA	New Xfmr Z	Existing Xfmr Z	Secondary Voltage	Tap Setting	f	Fault Current (amps)	Voltage Drop (%VD)	Cumulative Voltage Drop (%VD)	Fault Point (F#)
					Resistance (X)	Arccos (pf) (Radians)											Primary	Secondary	Primary	Secondary														
1	Utility Service Point	23.530	at the secondary of the utility transformer																															
	Motor Contribution	480	The connected full load amps (includes compressors) on the system																															
2	MDP-GB	1	3	26.410	M	CU	4	Set(s) of	350	kcmil	19704	--	208	80	0.9	900	0.000039	0.000050	0.451027	0.223	0.82	21.590	-0.85%	-0.85%	2									
2	MDP-GB	2	3	21.590	M	CU	4	Set(s) of	350	kcmil	19704	--	208	15	0.9	500	0.000039	0.000050	0.451027	0.034	0.87	20.878	-0.49%	-0.94%	3									
3	RTU-1H	3	3	20.878	M	CU	4	Set(s) of	330	AWG	12844	--	208	30	0.9	500	0.000039	0.000050	0.451027	0.237	0.81	16.878	-0.44%	-1.38%	4									
3	RTU-1H	3	3	20.878	M	CU	4	Set(s) of	250	kcmil	16843	--	208	100	0.85	148	0.000054	0.000052	0.554811	1.055	0.49	10.160	-0.88%	-1.83%	5									

BUILDING OCCUPANCY TYPE: SCHOOL		SERVICE DESCRIPTION:	
BUILDING SQUARE FOOTAGE: 14400		208Y/120 V	
LOAD TYPE	CONNECTED LOAD KVA	DEMAND FACTOR	NEC DEMAND KVA
EXISTING PEAK UTILITY (@ 0.9 pf)	222.22	125%	277.78
COOLING (C)	0.00	0%	0.00
HEATING (H)	0.00	100%	0.00
LIGHTING (L) (PER NEC-220)	3.70	125%	4.63
RECEPTACLES (R)	10.44	98%	10.22
MOTORS (M)	27.96	100%	27.96
SUPPLEMENTAL HEAT (U)	0.00	100%	0.00
MISC EQUIP (Z)	2.44	100%	2.44
REFRIGERATION (F)	0.00	100%	0.00
SIGNAGE (S)	0.00	125%	0.00
KITCHEN (K)	0.00	100%	0.00
LARGEST MOTOR	14.82	125%	18.64
SHOW WINDOW (W)	0.00	125%	0.00
TRACK LIGHTING	0.00	100%	0.00
EXISTING LOAD TO BE DELETED	55.00	100%	55.00
ELEVATOR (V)	0.00	100%	0.00
TOTAL LOAD	226.68	KVA	286.67
TOTAL AMPACITY	629.21	AMPS	795.73
SERVICE AMPACITY		AMPS	1200.00
SPARE CAPACITY		AMPS	404.27
*PER UTILITY COMPANY BILLING PEAK DEMAND OF:		200.00 KW	

Fault Point #	Bus/Feeder Description	Source (Fault Point)	Phase	Source Isc (amps)	Conduit Type	Material	Feeder Quantity of Parallel Sets and Bus/ Phase & Neutral Size	Conductor 'C' Value	Buryway 'C' Value	L-L Voltage (E)	Circuit Length (L)	Load Power Factor (pf)	Circuit Load (Amperage)	Resistance (R)	Reactance (X)	Arcos (pf)	Type	Degree Rise	Transformer				Fault Current (amps)	Voltage Drop (VDD)	Cumulative Voltage Drop (%VD)	Fault Point #		
																			kVA	New Xlm Z	Existing Xlm Z	Secondary Voltage	Tap Setting	f	M			
1	Utility Service Point Motor Contribution			15,998 320	At the secondary of the utility transformer The connected full load motor amps (includes compressors) on the system																		Source Isc + 6X Motor Contribution =				17,818	
2	MDP	1	3	17,818	M	CU	3 Set(s) of 300 kcmil	18177	--	208	50	0.9	500	0.000045	0.000051	0.451027							0.136	0.88	15,684	-0.44%	-0.44%	2
3	RTU-1	2	3	15,684	M	CU	1 Set(s) of 500 kcmil	22185	--	208	150	0.85	310	0.000029	0.000048	0.554811							0.883	0.53	8,329	-1.93%	-2.37%	3
4	LP-1	2	3	15,684	M	CU	1 Set(s) of 350 kcmil	19774	--	208	15	0.9	240	0.000039	0.000050	0.451027							0.099	0.91	14,288	-0.17%	-0.61%	4
5	LP-2	2	2	15,684	M	CU	1 Set(s) of 400 kcmil	19083	--	208	13	0.9	180	0.000063	0.000051	0.451027							0.113	0.90	14,087	-0.15%	-0.90%	5
6	LP-3	2	3	15,684	M	CU	1 Set(s) of 3 AWG	47704	--	208	10	0.9	80	0.000250	0.000059	0.451027							0.274	0.79	12,315	-0.17%	-0.60%	6

BUILDING OCCUPANCY TYPE: SCHOOL		SERVICE DESCRIPTION:	
BUILDING SQUARE FOOTAGE: 14400		208Y/120 V	
LOAD TYPE	CONNECTED LOAD KVA	DEMAND FACTOR	NEC DEMAND KVA
EXISTING PEAK UTILITY (@ 0.9 pf)	111.11	125%	138.89
COOLING (C)	31.02	100%	31.02
HEATING (H)	0.00	0%	0.00
LIGHTING (L) (PER NEC-220)	0.48	125%	0.60
RECEPTACLES (R)	11.34	94%	10.67
MOTORS (M)	22.72	100%	22.72
SUPPLEMENTAL HEAT (U)	0.00	100%	0.00
MISC EQUIP (Z)	3.05	100%	3.05
REFRIGERATION (F)	0.00	100%	0.00
SIGNAGE (S)	0.00	125%	0.00
KITCHEN (K)	0.00	100%	0.00
LARGEST MOTOR	20.79	125%	25.98
SHOW WINDOW (W)	0.00	125%	0.00
TRACK LIGHTING	0.00	100%	0.00
EXISTING LOAD TO BE DELETED	18.00	100%	18.00
ELEVATOR (V)	0.00	100%	0.00
TOTAL LOAD	182.50	KVA	214.92
TOTAL AMPACITY	506.57	AMPS	596.57
SERVICE AMPACITY		AMPS	800.00
SPARE CAPACITY		AMPS	203.43
*PER UTILITY COMPANY BILLING PEAK DEMAND OF:		100.00 KW	



# E801-C



LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086  
architect: Multistudio  
4209 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multistudio

civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveeng.com  
structural engineer: Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/IT/Code: Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100

0121-0100


LSHS - FIRE ALARM  
GENERAL NOTES AND  
LEGEND

FA000-C

FIRE PROTECTION SYMBOLS

THIS IS A MASTER LEGEND AND NOT ALL SYMBOLS OR ABBREVIATIONS ARE USED. V2.02

ABBREVIATIONS		FIRE ALARM
AFF AFG CD DI ESFR	ABOVE FINISHED FLOOR ABOVE FINISHED GRADE CANDELA DUCTILE IRON EARLY SUPPRESSION FAST RESPONSE	FACP FACP FACP FACP FACP
ETR FHC FP GG GPM JBU-BOX MAX MIN N/A	EXISTING TO REMAIN FIRE HOSE CABINET FIRE PROTECTION CONTRACTOR GALLONS PER MINUTE JUNCTION BOX MAXIMUM MINIMUM NOT APPLICABLE	RD REV SD SF TYPICAL UNO V W WP
NIC OC PIV PRV	NOT IN CONTRACT ON CENTER POST INDICATOR VALVE PROVIDE FURNISH AND INSTALL PRESSURE REDUCING VALVE	FACP FACP FACP FACP
ETR FHC FP GG GPM JBU-BOX MAX MIN N/A	EXISTING TO REMAIN FIRE HOSE CABINET FIRE PROTECTION CONTRACTOR GALLONS PER MINUTE JUNCTION BOX MAXIMUM MINIMUM NOT APPLICABLE	RD REV SD SF TYPICAL UNO V W WP
ANNOTATION		FIRE ALARM
①		FIRE PROTECTION PLAN NOTE CALLOUT
●		CONNECTION POINT OF NEW WORK TO EXISTING
① F1		DETAIL REFERENCE UPPER NUMBER INDICATES DETAIL NUMBER LOWER NUMBER INDICATES SHEET NUMBER
▲ F1		SECTION CUT DESIGNATION
■		DEDICATED EQUIPMENT ACCESS TILE
▽		ACCESS PANEL
STANDARD MOUNTING HEIGHTS		
AUDIBLE APPLIANCE (TOP OF APPLIANCE)		90"
FIRE ALARM ANNUNCIATOR PANEL (TOP OF DISPLAY)		60"
FIRE ALARM BELL (EXTERIOR) (CENTERLINE)		120"
FIRE ALARM CONTROL PANEL/JUNIT (TOP OF DISPLAY)		60"
PULL STATION (TOP OF DEVICE)		48"
VISIBLE APPLIANCE (CENTERLINE)		84"
INSTALL DEVICES AT THE MOUNTING HEIGHTS SHOWN ABOVE UNO IN THE CONSTRUCTION DOCUMENTS. MOUNTING HEIGHTS LISTED ABOVE, OR ELSEWHERE IN THE CONSTRUCTION DOCUMENTS, ARE AFF OR AFS. UNO, ALL DEVICES SHALL BE INSTALLED IN COMPLIANCE WITH CURRENT ADA AND LOCAL REQUIREMENTS.		
CALL OUTS		
ENLARGED PLAN CALLOUT		
NOT IN SCOPE		
LINETYPE LEGEND		
THROUGHOUT THE DRAWINGS DIFFERENT LINETYPES ARE USED IN COMBINATION WITH THE SYMBOLS TO INDICATE THE STATUS OF ITEMS AS EXISTING, TO BE DEMOLISHED, TO BE INCLUDED AS PART OF NEW WORK AND/OR ITEMS WHICH ARE ANTICIPATED TO BE PROVIDED IN THE FUTURE. THE STATUS OF ITEMS USING THESE LINETYPES ARE RELATIVE TO THE VIEW IN WHICH THEY APPEAR. PHASING SHOWN IN DRAWINGS IS NOT INTENDED TO FULLY DESCRIBE ALL NECESSARY CONSTRUCTION PHASING, WHICH IS DETERMINED BY THE CONTRACTOR AS PART OF THEIR RESPONSIBILITIES. ANY SUCH PHASES DESCRIBED IN THE CONSTRUCTION DOCUMENTS ARE GENERAL AND ONLY INTENDED TO INDICATE A BROAD ORDER FOR THE SAKE OF DESCRIBING THE PROJECT. THE FOLLOWING LINETYPES MAY BE USED ON ANY DEVICE, EQUIPMENT, NOTE, LINE, SHAPE, ETC.		
EXISTING		NEW
DEMOLISH		FUTURE

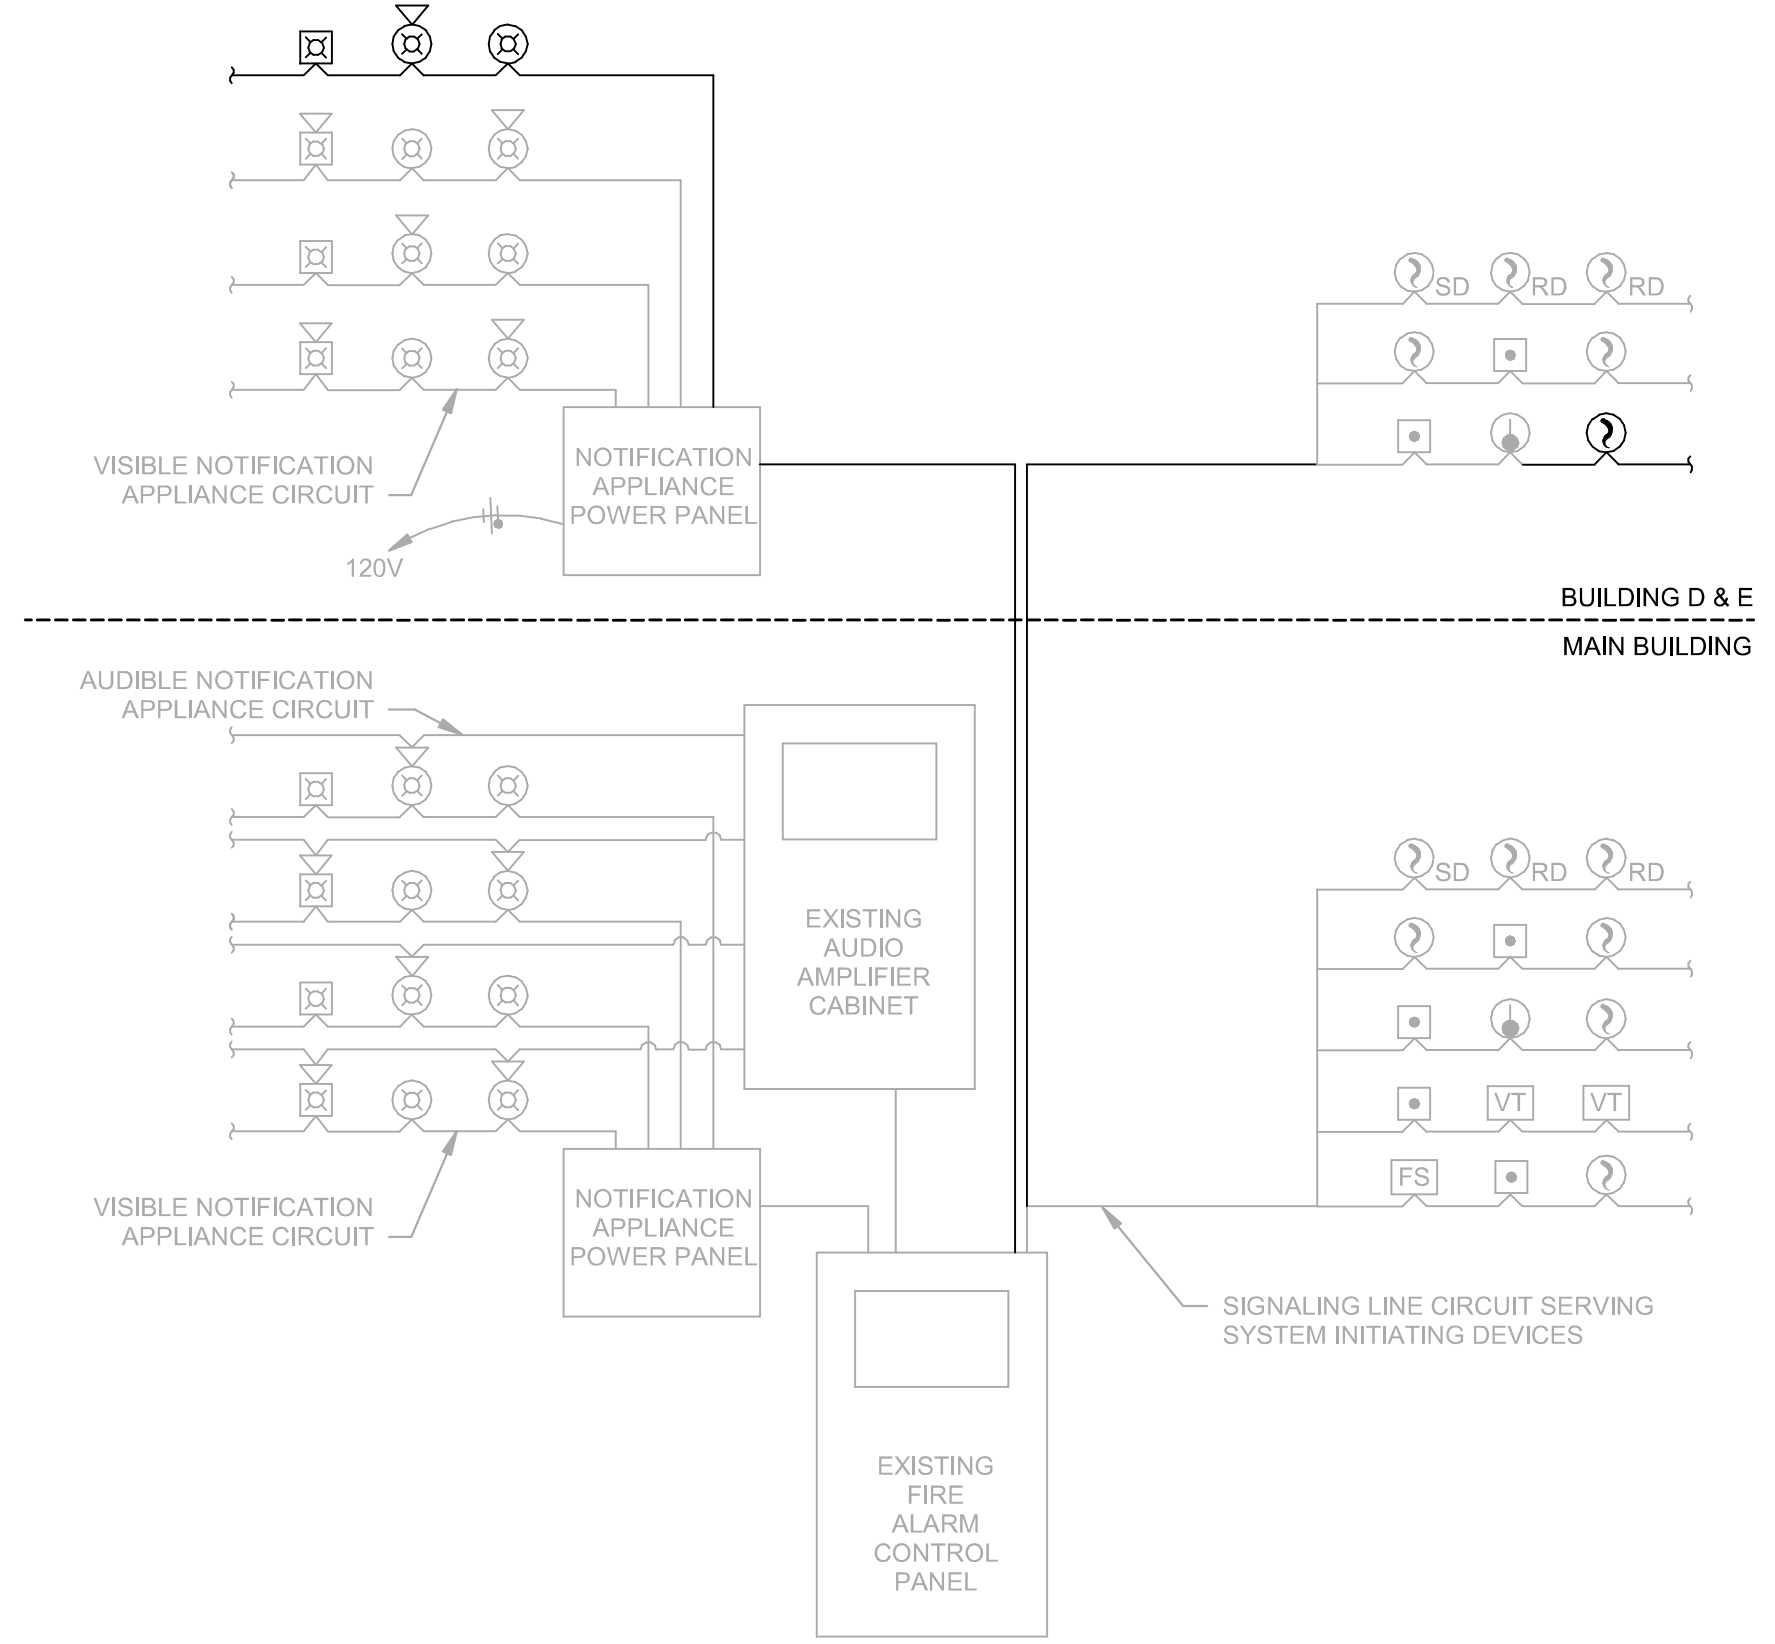

RISER DIAGRAM IS SCHEMATIC IN NATURE. NOT ALL DEVICES ARE SHOWN. REFER TO PLANS FOR EQUIPMENT QUANTITIES AND LOCATIONS.  
DUCT DETECTORS MAY HAVE INTEGRAL RELAYS FOR AIR HANDLING UNIT SHUT-DOWN AND FIRE/SMOKE DAMPER CONTROL. WIRING FOR THIS FUNCTION  
HAS NOT BEEN SHOWN. COORDINATE WITH MECHANICAL SYSTEM INSTALLER.  
REFER TO PLANS AND SPECIFICATIONS FOR ADDITIONAL INFORMATION.

① FIRE ALARM RISER DIAGRAM - ADDRESSABLE SYSTEM (VOICE)  
NTS

FIRE ALARM SCOPE NOTES:

1. FIRE ALARM SCOPE INCLUDES THE MODIFICATION OF THE EXISTING FIRE ALARM SYSTEM.
2. MODIFY EXISTING HORN/STROBE NOTIFICATION IN THE EXISTING BUILDINGS D & E FOR THE MODIFIED BUILDING LAYOUT IN ACCORDANCE WITH NFPA 72 AND ANY LOCAL LAWS.

FIRE ALARM GENERAL NOTES:

1. PRIOR TO SUBMITTING BID, VISIT THE JOB SITE AND BECOME FULLY ACQUAINTED WITH THE EXISTING CONDITIONS OF THE PROJECT. REVIEW THE GENERAL NOTES, SPECIFICATIONS AND OTHER DRAWINGS FOR ADDITIONAL REQUIREMENTS WHICH MAY NOT BE SPECIFICALLY CALLED OUT IN THIS PORTION OF THE CONSTRUCTION DOCUMENTS. NOTIFY ARCHITECT, ENGINEER AND/OR OWNER OF CONFLICTS OR DISCREPANCIES PRIOR TO SUBMISSION OF BID.
2. SYSTEM DESIGN, INSTALLATION AND MATERIALS SHALL BE IN ACCORDANCE WITH APPLICABLE NFPA STANDARDS. SYSTEM SHALL ALSO MEET ALL APPLICABLE BUILDING CODES, FIRE CODES AND THE REQUIREMENTS OF THE AUTHORITY HAVING JURISDICTION AND INSURANCE CARRIER. VERIFY REQUIREMENTS PRIOR TO BID SUBMITTAL.
3. INFORMATION ON CONTRACT DOCUMENTS IS GENERAL INFORMATION AND FOR BID PURPOSES ONLY. CONTRACTOR SHALL BE FULLY RESPONSIBLE FOR THE FINAL SYSTEM DESIGN AND LAYOUT OF ALL COMPONENTS. COORDINATION WITH ALL OTHER TRADES, AND SYSTEM CALCULATIONS REQUIRED FOR APPROVAL BY THE AUTHORITY HAVING JURISDICTION, ENGINEER, AND OWNER'S INSURER.
4. THE CONTRACTOR SHALL FOLLOW THE ENGINEER OF RECORD'S SYSTEM DESIGN AND LAYOUT OF ALL COMPONENTS EXCEPT WHERE MODIFICATION TO THE DESIGN IS NECESSARY. MODIFICATIONS SHALL BE REFLECTED IN THE CONTRACTOR'S SHOP DRAWINGS AND CALCULATIONS.
5. DEVIATIONS FROM ENGINEER'S DESIGN WILL NOT BE CONSIDERED UNLESS A FORMALLY SUBMITTED RFI IS RECEIVED AND APPROVED.
6. THE CONTRACTOR SHALL PROVIDE ALL EQUIPMENT AND LABOR REQUIRED FOR A COMPLETE AND OPERATIONAL SYSTEM AS INDICATED IN THE DRAWINGS AND SPECIFICATIONS.
7. WHERE EXISTING SYSTEMS ARE PRESENT, CONTRACTOR SHALL MODIFY, RELOCATE AND/OR PROVIDE ADDITIONAL EQUIPMENT AS REQUIRED FOR SCOPE OF WORK AS REQUIRED FOR A COMPLETE AND OPERATIONAL SYSTEM. COORDINATE WITH WALLS, CEILINGS, LIGHTS, DIFFUSERS, STRUCTURE, OBSTRUCTIONS, ETC. IN AREAS AFFECTED BY SCOPE OF WORK. NEW EQUIPMENT SHALL BE COMPATIBLE WITH EXISTING SYSTEMS. CONTRACTOR SHALL REMOVE ALL ABANDONED EQUIPMENT. COORDINATE SYSTEM MODIFICATIONS TO MINIMIZE SYSTEM IMPAIRMENT, AND PROVIDE FIRE WATCH AND/OR INTERIM FIRE PROTECTION MEASURES WHERE REQUIRED BY THE AUTHORITY HAVING JURISDICTION, INSURANCE CARRIER OR OWNER.
8. PROVIDE ADDITIONAL MATERIALS AND LABOR REQUIRED DUE TO LACK OF COORDINATION OR TO MEET AUTHORITY HAVING JURISDICTION AND INSURANCE CARRIER REQUIREMENTS AT NO ADDITIONAL COST TO THE OWNER.
9. FORWARD COMPLETED CERTIFICATE OF COMPLETION AND CONTRACTOR MATERIAL TEST CERTIFICATES TO THE OWNER.
10. REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.

FIRE ALARM GENERAL DEMOLITION NOTES:

1. COORDINATE ALL DEMOLITION WITH WHAT IS SHOWN ON ARCHITECTURAL PLANS. NOTIFY ARCHITECT OF ANY DISCREPANCIES.
2. COORDINATE NEW WORK AND DEMOLITION WITH OTHER DISCIPLINES AND EXISTING CONDITIONS PRIOR TO CONSTRUCTION.
3. PRIOR TO SUBMITTING BID, VISIT THE JOB SITE AND BECOME FULLY ACQUAINTED WITH THE EXISTING CONDITIONS OF THE PROJECT. REVIEW GENERAL NOTES, SPECIFICATIONS AND OTHER DRAWINGS FOR ADDITIONAL REQUIREMENTS THAT MAY NOT BE SPECIFICALLY CALLED OUT IN THIS PORTION OF THE CONSTRUCTION DOCUMENTS. NOTIFY ARCHITECT, ENGINEER OR OWNER, AS DEFINED IN BID DOCUMENTS, OF CONFLICTS OR DISCREPANCIES PRIOR TO SUBMISSION OF BID. ADDITIONAL COMPENSATION WILL NOT BE PAID FOR LACK OF SUCH DETERMINATION, FAMILIARIZATION, AND/OR ALLOWANCE.
4. EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND SITE VISITS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. FIELD VERIFY EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. COORDINATE NEW WORK AND DEMOLITION WITH OTHER DISCIPLINES AND EXISTING CONDITIONS PRIOR TO CONSTRUCTION.
5. OWNER RETAINS RIGHTS OF SALVAGE FOR EQUIPMENT AND FIXTURES TO BE REMOVED. COORDINATE WITH THE OWNER THE EQUIPMENT AND FIXTURES TO BE SALVAGED AND THE LOCATION FOR STORAGE. AVOID DAMAGE TO EQUIPMENT DURING DEMOLITION WORK AND DURING TRANSPORT TO OWNER'S DESIGNATED STORAGE LOCATION. PROPERLY DISPOSE OF MATERIALS THAT ARE REMOVED AND ARE NOT REQUESTED TO BE SALVAGED BY THE OWNER.
6. EQUIPMENT TO BE REMOVED SHALL BE KEPT FOR REINSTALLATION DURING THE CONSTRUCTION PHASE WHEN POSSIBLE AND/OR INDICATED ON THE DRAWINGS. AVOID DAMAGING EXISTING SURFACES AND EQUIPMENT TO REMAIN FOR NEW INSTALLATION. REPAIR ANY DAMAGE CAUSED DURING WORK AT NO EXTRA COST TO THE OWNER.
7. SEAL PENETRATIONS THROUGH FLOORS, WALLS, CEILINGS AND ROOFS WHERE COMPONENTS ARE REMOVED AND WHERE THE EXISTING PENETRATION IS NOT USED FOR THE NEW INSTALLATION. REPAIR DAMAGED SURFACES TO MATCH ADJACENT AREAS OR AS INDICATED ON THE ARCHITECTURAL DRAWINGS.
8. PERFORM ALL WORK ACCORDING TO THE PHASING SCHEDULE FOR THIS PROJECT. PROVIDE ALL TEMPORARY DESIGN AND/OR CONFIGURATIONS THAT MEET APPLICABLE CODE REQUIREMENTS AS NECESSARY TO CONFORM TO THE REQUIRED CONSTRUCTION PHASING OF THE PROJECT.
9. ONLY THE PORTIONS OF THE BUILDING AFFECTED BY THE SCOPE OF THE PROJECT HAVE BEEN SHOWN. INFORMATION SHOWN AS EXISTING TO REMAIN IS NOT BEING MODIFIED AS A PART OF THIS PROJECT.
10. ALL WORK SHALL BE PERFORMED SO AS TO NOT INTERRUPT SERVICE. THE CONTRACTOR SHALL PROPERLY NOTIFY THE BUILDING OWNER, LANDLORD, THE LEASER AND ADJACENT TENANTS AS APPLICABLE A MINIMUM OF 48 HOURS IN ADVANCE BEFORE PROCEEDING WITH THIS WORK.
11. REMOVE ALL UNUSED AND DEMOLISHED EQUIPMENT AND ASSOCIATED MATERIALS FROM SITE. ABANDONING UNUSED PORTIONS WILL NOT BE ACCEPTABLE.
12. SYSTEM(S) NOT ASSOCIATED WITH THE DEMOLITION SHALL BE LEFT IN SERVICE AS APPLICABLE.
13. INSPECT EXISTING EQUIPMENT TO REMAIN TO VERIFY THAT EQUIPMENT IS OPERATING PROPERLY. NOTIFY OWNER OF DAMAGED AND/OR MALFUNCTIONING COMPONENTS.
14. ALL SYSTEMS TO BE LEFT IN SERVICE PRIOR TO THE END OF EACH WORKDAY.



LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4209 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi-studio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kverg.com

structural engineer:  
Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/IT/Codes:  
Henderson Engineers  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com



8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM  
2150005255  
MO. CORPORATE NO. E-6580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

NUMBER	DESCRIPTION	DATE
--------	-------------	------



CHRISTOPHER J. CULP  
LICENSE # PE-2013037646  
09/08/2022


LSHS - FIRE ALARM RCP  
- LEVEL 1 - BUILDING D  
& E

FA101-C

FIRE ALARM PLAN NOTES:

- F2 ADJUST OR REPLACE APPLIANCE AS NECESSARY TO MEET THE REQUIRED CANDELA RATING REQUIREMENTS PER CODE AND LAYOUT SHOWN.
- F3 PROVIDE DUCT MOUNTED SMOKE DETECTOR FOR FAN POWERED MECHANICAL AIR HANDLING EQUIPMENT SHUTDOWN. INSTALL DETECTOR PER MANUFACTURER'S RECOMMENDATIONS. REFER TO MECHANICAL SHEETS FOR EQUIPMENT AND DUCTWORK LAYOUT AND DETAILS.
- F4 PROVIDE LOW VOLTAGE WIRING FROM DUCT DETECTOR TO REMOTE TEST STATION. MOUNT REMOTE TEST STATION ON WALL AT 48" AFF.
- F6 PROVIDE A CARBON MONOXIDE DETECTOR IN ROOMS CONTAINING FIRST DIFFUSER FROM GAS POWERED AIR HANDLING UNITS. CARBON MONOXIDE DETECTOR SHALL EMIT A LOCAL ALARM TONE UPON DETECTION OF CARBON MONOXIDE.


1 FIRE ALARM PLAN - LSHS - BUILDING D  
3/32" = 1'-0"



2 FIRE ALARM PLAN - LSHS - BUILDING E  
1/8" = 1'-0"





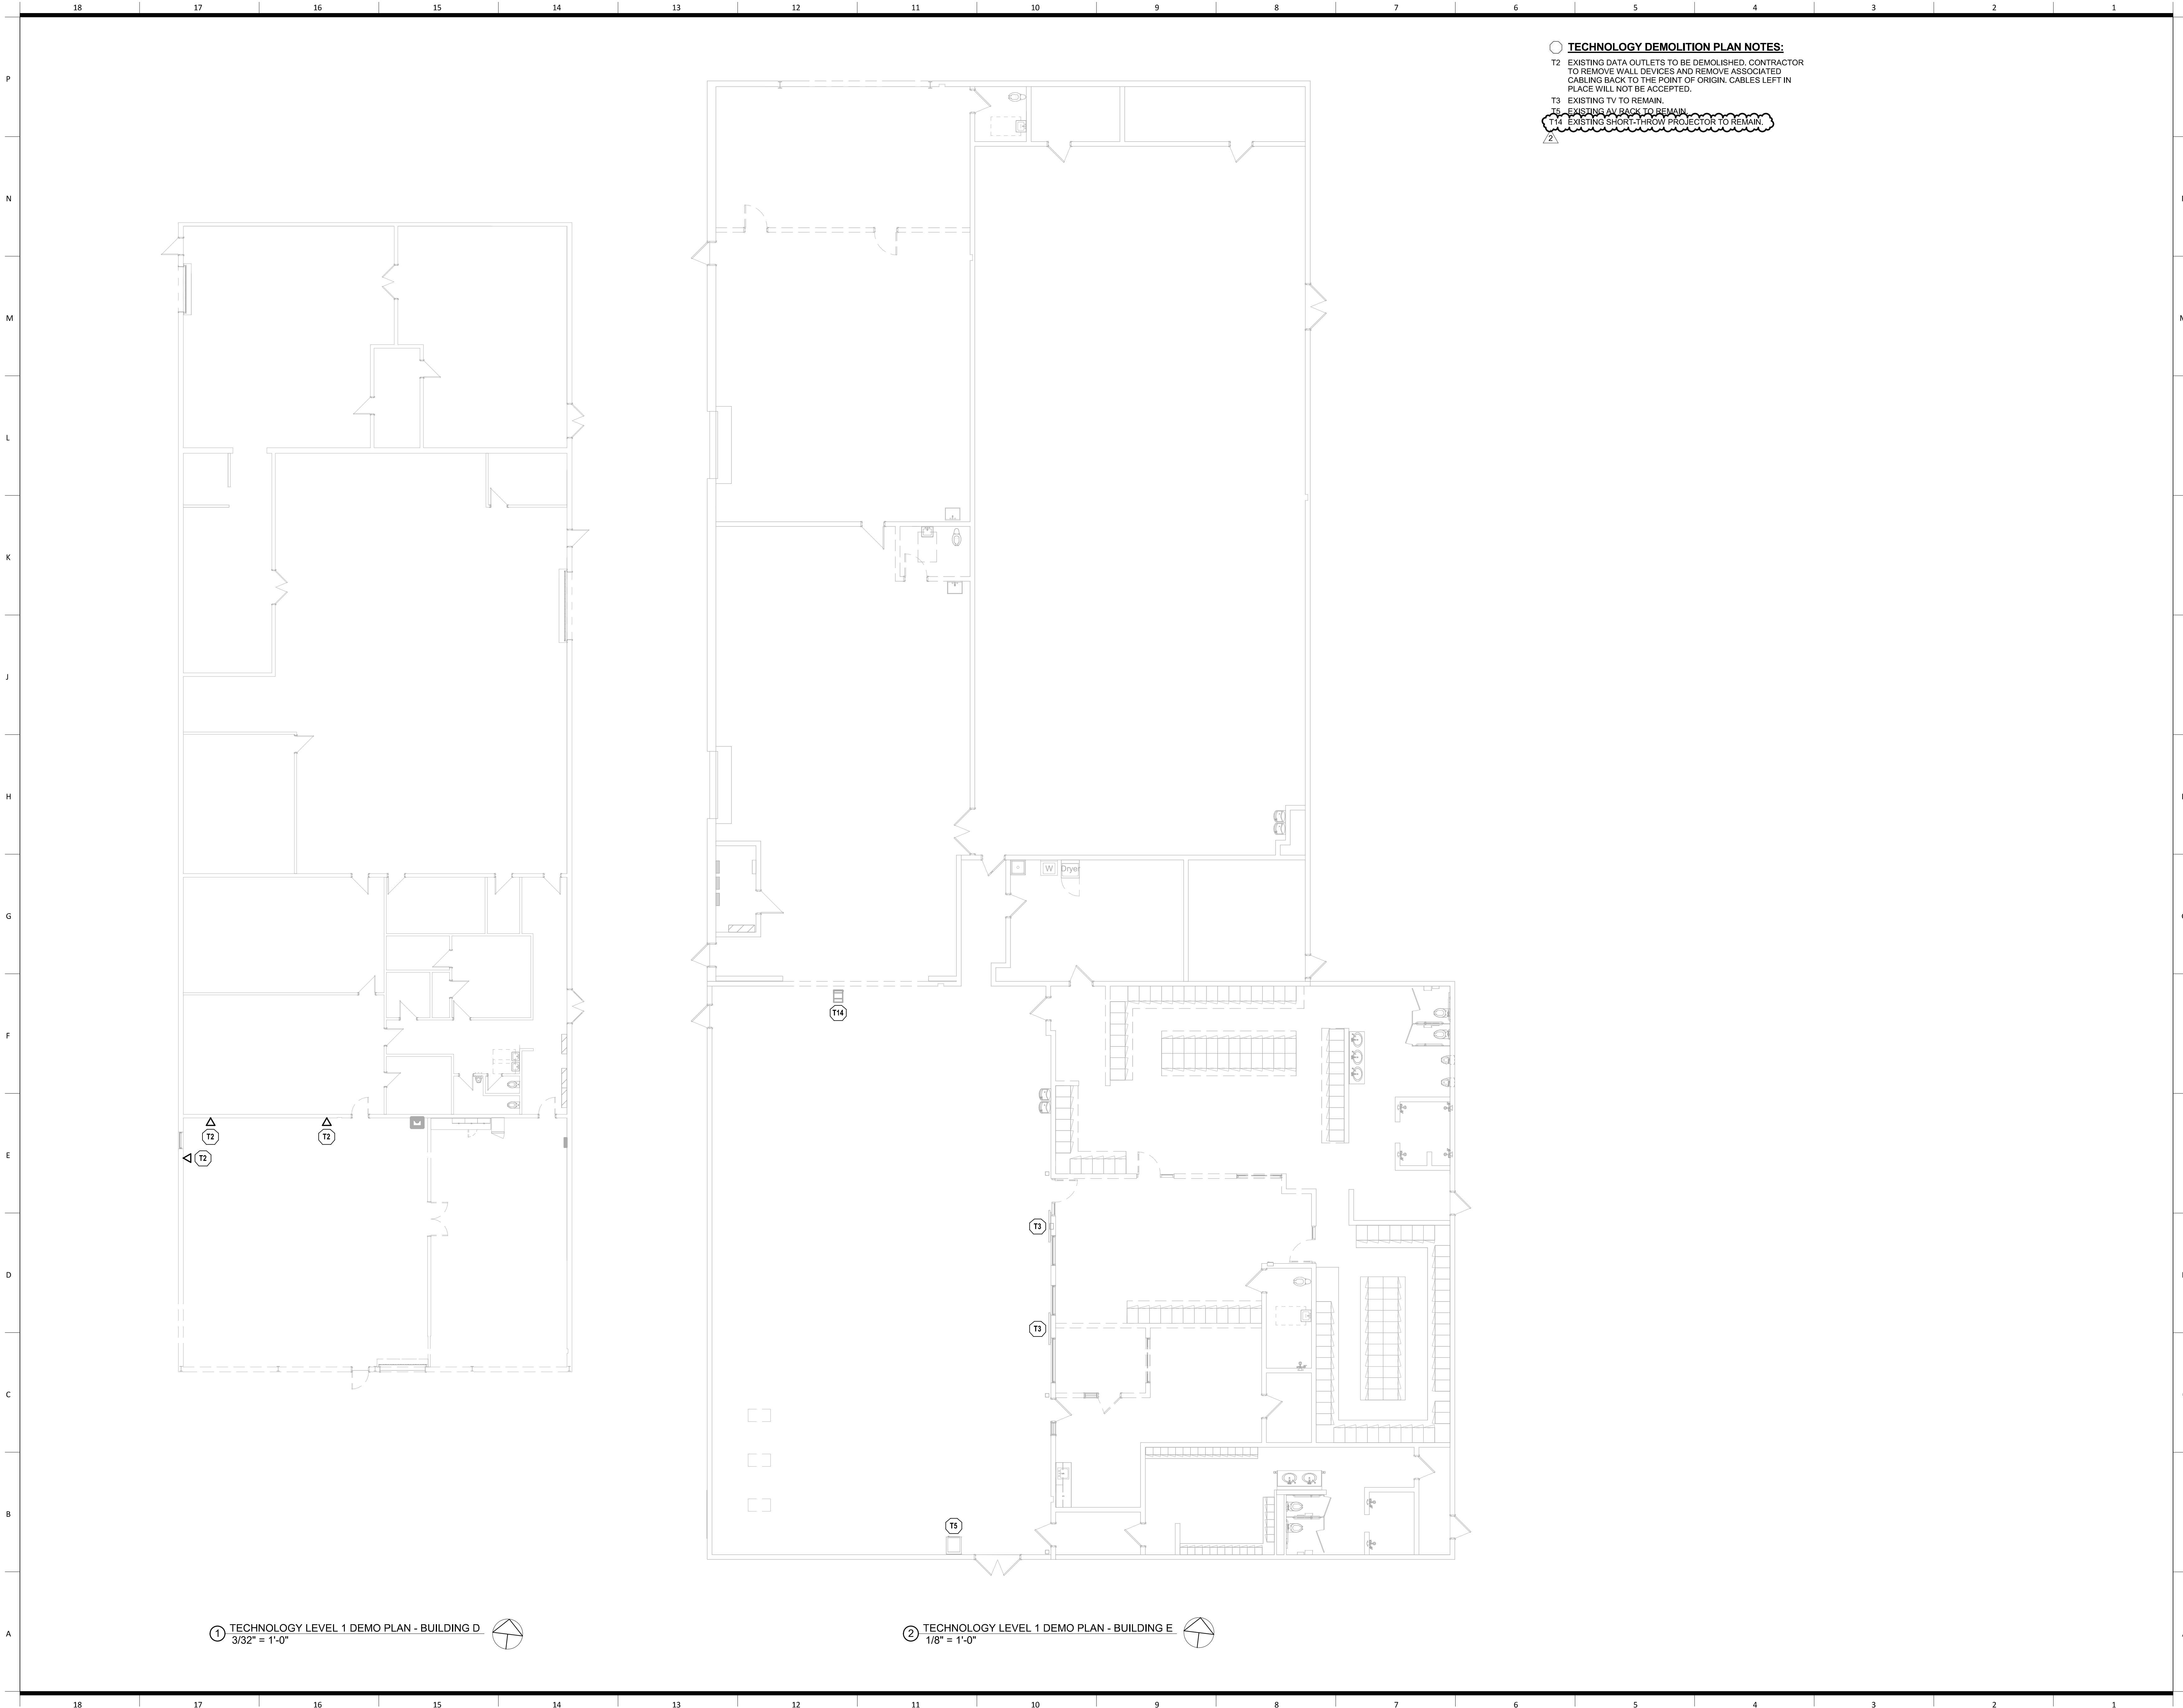

**LSR7 Robotics, GiC & Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect: Multistudio  
4205 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multistudio

0121-0100

civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kvereng.com

structural engineer: Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/ET/Code: Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

**HENDERSON**  
ENGINEERS  
8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM

2150005255  
MO. CORPORATE NO. E-658D  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

NUMBER	DESCRIPTION	DATE
2	Addendum 02	09/23/2022



09/23/2022  
DOUGLAS M. EVERHART  
LICENSE # PE-2019007648

**LSHS - TECHNOLOGY  
DEMOLITION PLAN -  
LEVEL 1 - BUILDING D &  
E**

**TND101-C**



## TELECOMMUNICATIONS SYMBOLS

THIS IS A MASTER LEGEND AND NOT ALL SYMBOLS OR ABBREVIATIONS ARE USED.

### STANDARD MOUNTING HEIGHTS

TELECOM BACKBOARD (BOTTOM OF BACKBOARD)	4"
LADDER RACK IN TELECOM ROOMS (BOTTOM OF DEVICE)	30"
CABLE TRAY / CONDUIT AFC (BOTTOM OF PATHWAY)	3"(MIN)
LIGHT FIXTURE IN TELECOM ROOMS (BOTTOM OF DEVICE)	108"(MIN)
TELEPHONE WALL OUTLET (CENTERLINE)	48"
DATA WALL OUTLET	SAME AS ADJACENT DEVICE, UNO
TELEVISION OUTLET	REFER TO ARCH DRAWINGS
TW6B/TGB (CENTERLINE)	84"
WALL CLOCK (CENTERLINE)	84"
INTERCOM (CENTERLINE)	48"

USE THE DEFAULT MOUNTING HEIGHTS SHOWN ABOVE UNO IN THE CONSTRUCTION DOCUMENTS. MOUNTING HEIGHTS LISTED ARE ABOVE FINISHED FLOOR (AFF) OR ABOVE FINISHED GRADE (AFG) TO BOTTOM OF OUTLET BOX. ALL DEVICES SHALL BE INSTALLED IN COMPLIANCE WITH CURRENT ADA AND LOCAL REQUIREMENTS.

### ABBREVIATIONS

ADA	AMPERES	LAN	LOCAL AREA NETWORK
ADA	AMERICANS WITH DISABILITIES ACT	LCC	LIMITED COMBUSTIBLE CABLE
AFC	ABOVE FINISHED CEILING	LEC	LOCAL EXCHANGE CARRIER
AFF	ABOVE FINISHED FLOOR	LED	LIGHT-EMITTING DIODE
AFG	ABOVE FINISHED GRADE	LF	LINEAR FEET
AHJ	AUTHORITY HAVING JURISDICTION	MAN	METROPOLITAN AREA NETWORK
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE	MATV	MASTER ANTENNA TELEVISION
AP	ACCESS POINT	MC	MAIN CROSS-CONNECT
AV	AUDIO-VIDEO	MDF	MAIN DISTRIBUTION FRAME
AWG	AMERICAN WIRE GAUGE	MFR	MANUFACTURER
BAS	BUILDING AUTOMATION SYSTEM	MM	MULTIMODE
BB	BACKBONE BONDING CONDUCTOR	MPOE	MAIN POINT OF ENTRANCE
BDC	BUILDING DISTRIBUTOR	MPOP	MAIN POINT OF PRESENCE
BD	BUILDING DISTRIBUTION FRAME	MTD	MOUNTED
BFC	BELOW FINISHED CEILING	N/A	NOT APPLICABLE
C	CONDUIT	NEC	NATIONAL ELECTRICAL CODE
CAT	CATEGORY	NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
CATV	COMMUNITY ANTENNA TELEVISION	NIC	NOT IN CONTRACT
CCTV	CLOSED CIRCUIT TELEVISION	nm	NANOMETER
CD	CAMPUS DISTRIBUTOR	NRTL	NATIONALLY RECOGNIZED TESTING LAB
CMF	COMMUNICATIONS PLENUM JACKET	OC	ON CENTER
CMR	COMMUNICATIONS RISER JACKET	OSHA	OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION
DAS	DISTRIBUTED ANTENNA SYSTEM	OSP	OUTSIDE PLANT
dB	DECIBELS	PBB	PRIMARY BONDING BUSBAR
DEMO	DEMOLITION	PBX	PRIVATE BRANCH EXCHANGE
(E)	EXISTING	POE	POWER OVER ETHERNET
EC	ELECTRICAL CONTRACTOR	PON	PASSIVE OPTICAL NETWORK
ECIA	ELECTRONIC COMPONENTS INDUSTRY ASSOCIATION	POTS	PLAIN OLD TELEPHONE SERVICE
EMI	ELECTROMAGNETIC INTERFERENCE	PSST	PUBLIC SWITCHED TELEPHONE NETWORK
EMS	ENERGY MANAGEMENT SYSTEM	QTY	QUANTITY
EMT	ELECTRICAL METALLIC TUBING	RCD	REGISTERED COMMUNICATIONS DISTRIBUTION DESIGNER
ER	EQUIPMENT ROOM	RMC	RIGID METAL CONDUIT
ETR	EXISTING TO REMAIN	RU	RACK UNIT
FAFP	FIRE ALARM ANNUNCIATOR PANEL	SBB	SECONDARY BONDING BUSBAR
FCAP	FIRE ALARM CONTROL PANEL	SCS	STRUCTURED CABLING SYSTEM
FD	FLOOR DISTRIBUTOR	SF	SQUARE FEET
FMC	FLEXIBLE METAL CONDUIT	SM	SINGLEMODE
FS	FIRE STOP SYSTEM	SPEC	SPECIFICATIONS
FLR	FLOOR	TBB	TELECOMMUNICATIONS BONDING BACKBONE
FUTP	SHIELDED SCREEN TWISTED PAIR	TBD	TO BE DETERMINED
GC	GENERAL CONTRACTOR	TIA	TELECOMMUNICATIONS INDUSTRY ASSOCIATION
GYP	GYPSON BOARD	TR	TELECOMMUNICATIONS ROOM
HC	HORIZONTAL CROSS-CONNECT	TYP	TYPICAL
HCM	HORIZONTAL CABLE MANAGER	UNO	UNLESS NOTED OTHERWISE
HH	HAND HOLE	UL	UNDERWRITER LABORATORIES, INC.
HZ	HERTZ	UPS	UNINTERRUPTIBLE POWER SUPPLY
IMC	INTERMEDIATE METAL CONDUIT	UJUTP	UNSHIELDED TWISTED PAIR
IP	INTERNET PROTOCOL	V	VOLTS
ISP	INTERNET SERVICE PROVIDER	VCN	VERTICAL CABLE MANAGER
ISP	INSIDE PLANT CABLE	W	WIRE
JB	JUNCTION BOX	WAO	WORK AREA NETWORK
J-BOX	JUNCTION BOX	WAP	WIRELESS ACCESS POINT
		WP	WEATHER RESISTANT
		WT	WEATHER PROOF
		XP	EXPLOSION-PROOF

### ANNOTATION

①	TECHNOLOGY PLAN CALLOUT
1	EQUIPMENT DESIGNATION (OWNER FURNISHED, CONTRACTOR INSTALLED)
●	CONNECTION POINT OF NEW WORK TO EXISTING
① T1	DETAIL REFERENCE UPPER NUMBER INDICATES DETAIL NUMBER, LOWER NUMBER INDICATES SHEET NUMBER
① T1	SECTION CUT DESIGNATION
⊞	DEDICATED EQUIPMENT ACCESS TILE
⊞	ACCESS PANEL

### LINETYPE LEGEND

THROUGHOUT THE DRAWINGS DIFFERENT LINE-TYPES ARE USED IN COMBINATION WITH THE SYMBOLS TO INDICATE THE STATUS OF ITEMS AS EXISTING, TO BE DEMOLISHED, TO BE INCLUDED AS PART OF THE NEW WORK AND/OR ITEMS WHICH ARE ANTICIPATED TO BE PROVIDED IN THE FUTURE. THE STATUS OF ITEMS USING THESE LINTYPES ARE RELATIVE TO THE VIEW IN WHICH THEY APPEAR. PHASING SHOWN IN DRAWINGS IS NOT INTENDED TO FULLY DESCRIBE ALL NECESSARY CONSTRUCTION PHASING, WHICH IS DETERMINED BY THE CONTRACTOR AS PART OF THEIR RESPONSIBILITIES. ANY SUCH PHASES DESCRIBED IN THE CONSTRUCTION DOCUMENTS ARE GENERAL AND ONLY INTENDED TO INDICATE A BROAD ORDER FOR THE SAKE OF DESCRIBING THE PROJECT. THE FOLLOWING LINTYPES MAY BE USED ON ANY DEVICE, EQUIPMENT, NOTE, LINE, SHAPE, ETC.

EXISTING	NEW
DEMOLISH	FUTURE

### CABLE TYPES

A	CATEGORY 6 CABLE
B	PAGING SPEAKER CABLE
C	HDMI CABLE

### PATHWAYS

	WIRE MESH CABLE TRAY (W"=WIDTH, "H"=HEIGHT)
	VERTICAL CABLE TRAY
	UNDERGROUND CONDUIT ("F"=QUANTITY, "D"=CONDUIT DIAMETER)
	CONDUIT ("F"=QUANTITY, "D"=CONDUIT DIAMETER)
	CABLE SUPPORTS OR J-HOOKS
	CONDUIT SLEEVE ("F"=QUANTITY, "D"=CONDUIT DIAMETER)
	UL FIRESTOP SYSTEM ASSEMBLY
	PULL BOX ("L"=LENGTH, "W"=WIDTH, "H"=HEIGHT)
	SPLICE

### RISER DIAGRAMS

	FIBER OPTIC CROSS CONNECT
	COPPER UTP CROSS CONNECT
	110-TYPE PROTECTOR BLOCK
	PATCH PANEL
	SECONDARY BONDING BUSBAR (SBB)
	PRIMARY BONDING BUSBAR (PBB)
	TELECOMMUNICATIONS BACKBONE CABLING (REFER TO RISER DIAGRAM FOR MORE INFORMATION)

### TELECOMMUNICATIONS ROOM

	LADDER RACK
	PRIMARY BONDING BUSBAR (PBB) - WALL ELEVATION VIEW
	SECONDARY BONDING BUSBAR (SBB) - WALL ELEVATION VIEW
	PBB/SBB - PLAN VIEW
	TELECOM BACKBOARD
	TWO-POST EQUIPMENT RACK
	FOUR-POST EQUIPMENT RACK
	EQUIPMENT CABINET (REFER TO PLAN NOTES ON ENLARGED PLANS FOR MORE INFORMATION)

### TELECOMMUNICATIONS OUTLETS

SYMBOL	DESCRIPTION	CABLE(S)			DETAIL
		A	B	C	
▽ 2D	DATA WALL OUTLET	2	0	0	3/TN400-C
▽ 4D	DATA WALL OUTLET	4	0	0	3/TN400-C
▽ 4D	DATA WALL OUTLET	4	0	0	3/TN400-C
▽ 2D	DATA CEILING OUTLET	2	0	0	4/TN400-C
▽ W,2D	TELEPHONE, VoIP WALL OUTLET	2	0	0	3/TN400-C

### TELECOMMUNICATIONS END-POINT DEVICES

DEVICE SCHEDULE					
SYMBOL	DESCRIPTION	CABLE(S)			DETAIL
		A	B	C	
⊖ (C) S	CLOCK, ANALOG SINGLE SIDED, WALL MOUNT	0	0	0	N/A
⊖ (S) RC	PAGING SPEAKER, RECESSED CAN CEILING MOUNT	0	1	0	2/TN400-C
⊖ (S) P	PAGING SPEAKER, PENDANT CEILING MOUNT	0	1	0	2/TN400-C
AUDIO-VIDEO IP END-POINT DEVICES					
REFER TO TA-SERIES DRAWINGS FOR AV DEVICES					
SYMBOL	DESCRIPTION	CABLE(S)			DETAIL
		A	B	C	
⬠	TELEVISION WALL OUTLET	1	0	2	6/TN400-C
⬠	HDMI INTERFACE PLATE	2	0	1	5/TN400-C

### TELECOMMUNICATIONS RESPONSIBILITY MATRIX

Description	Furnish		Install		Comments
	Construction Team	Owner	Construction Team	Owner	
<b>General Communications</b>					
Grounding and Bonding	X		X		
Hangers and Supports	X		X		
Conduits and Backboxes	X		X		
Cable Trays			X		
Underground pathways for utility entrance and floor boxes	X		X		
Firestops, Conduit Sleeves, and Sleeve Seals	X		X		
<b>Structured Cabling</b>					
Telecom Room Cabinets, Racks, Frames, and Enclosures	X		X		
Telecom Room Buildout (ex. backboard and ladder rack)	X		X		
Telecom Room Uninterruptible Power Supply (UPS)		X		X	
Telecom Room Power Strips		X		X	
Optical Fiber Backbone Cable and Connectivity	X		X		
Copper Backbone Cable and Connectivity	X		X		
Copper Horizontal Cable and Connectivity	X		X		
<b>Data Communications</b>					
Router / Firewall		X		X	
Core Switch / Edge Switch		X		X	
Wireless Access Points		X		X	
Servers / Storage and Backup		X		X	
Laptops / Desktops / Copiers / Printers / Scanners		X		X	
Software		X		X	
<b>Voice Communications</b>					
VoIP Gateway / Analog handsets		X		X	
VoIP handset wall mount kit		X		X	
VoIP handsets		X		X	
VoIP Network licensing		X		X	
<b>Audio-Video Communications</b>					
Conduits and Backboxes for AV systems	X		X		
HDMI Classroom Cabling and Connectivity	X		X		
Refer to AV drawings for AV Scope					
<b>Distributed &amp; Monitoring Communications</b>					
K12 Classroom Analog Paging	X		X		
Wireless Clock Systems	X		X		
<b>Electronic Safety and Security</b>					
Conduits and Backboxes for Security systems	X		X		
Refer to Security drawings for Security Scope					

### GENERAL NEW WORK NOTES

- READ THE SPECIFICATIONS AND REVIEW DRAWINGS OF ALL DIVISIONS OF WORK. COORDINATE THIS WORK WITH ALL OTHER DIVISIONS OF WORK AND ALL SUBCONTRACTORS.
- ALL WORK SHALL CONFORM TO THE APPLICABLE SPECIFICATIONS (DIVISION 26, DIVISION 27, DIVISION 28, ETC.) AND THE CUSTOMER PRE-ESTABLISHED STRUCTURED CABLING STANDARDS. SHOULD DIFFERENCES EXIST IN THE SPECIFICATIONS RELATING TO TECHNOLOGY AND THE CLIENT'S PRE-ESTABLISHED STANDARDS THE CONTRACTOR SHALL CONTACT THE LOW VOLTAGE ENGINEER FOR CLARIFICATION THROUGH THE RFI PROCESS.
- FULLY COORDINATE ALL CABLE TRAY, FIRE STOP CONDUITS / SLEEVES, AND CONDUIT ROUTING WITH STRUCTURAL ELEMENTS. COORDINATE CABLE TRAY AND CONDUIT INSTALLATIONS WITH ARCHITECT, STRUCTURAL ENGINEER, STRUCTURAL CONTRACTOR, AND GENERAL CONTRACTOR PRIOR TO INSTALLATION. ROUTING IN CONCRETE SLAB OR UNDER SLAB (WHERE CONDUIT WOULD BE ON GRADE) REQUIRES THE USE OF WET LOCATION RATED CABLES.
- ALL TELECOMMUNICATIONS CONTINUOUS PATHWAYS SHALL BE BONDED TO THE TELECOMMUNICATIONS BONDING BACKBONE; FOR CONDUITS, INSULATION BUSHINGS SHALL BE USED AT THE END OF THE CONDUIT THE FARTHEST AWAY FROM THE SERVING TR; A BONDING BUSHING SHALL BE USED AT THE END CLOSEST TO THE SERVING TR. CONTRACTOR TO REFER TO THE ANSI/ISO-6907 STANDARD FOR ADDITIONAL INFORMATION AS TO THE INSTALLATION OF THE TELECOMMUNICATIONS BONDING BACKBONE.
- ALL FIRE RATED WALL / FLOOR ASSEMBLIES PENETRATED FOR TELECOMMUNICATIONS CABLING PATHWAYS SHALL BE FIRE STOPPED WITH TITEX FIBRE STOP SYSTEMS. ALL FIRESTOP SYSTEMS SHALL BE INSTALLED AS DIRECTED BY THE MANUFACTURER AND AS SPECIFIED IN DIVISION 07 07 84 00 - "FIRESTOPPING". FIRE STOP ASSEMBLY LOCATIONS ARE TO BE COORDINATED WITH CABLE TRAY PATHWAY TO TELECOMMUNICATIONS ROOM.
- BACK BOXES AND CONDUIT LOCATIONS IN PRECAST CONCRETE WALLS SHALL BE COORDINATED WITH ARCHITECT, STRUCTURAL ENGINEER, AND GC PRIOR TO ORDERING THE PRECAST WALLS.
- ROUTING OF CABLES SHALL BE CONCEALED. CABLES SHALL BE ROUTED IN CONDUIT IN EXPOSED AREAS. MINIMIZE AMOUNT OF EXPOSED CONDUIT BY EMBEDDING CONDUIT IN SLAB WHEN POSSIBLE. EMBEDDED CONDUITS AND PENETRATIONS OF STRUCTURE SHALL FOLLOW DETAILS IN STRUCTURAL DRAWINGS. WHEN CONDUITS CAN ONLY BE INSTALLED EXPOSED, NOTIFY ARCHITECT PRIOR TO START OF INSTALLATION OF CONDUITS. CABLES SHALL BE ROUTED IN CONDUIT WHEN ABOVE HARD CEILINGS. CONDUITS FOR ELEVATOR PHONES AND FIRE ALARM CONTROL PANEL SHALL BE CONTINUOUS (HOMERUN) FROM THE TELECOMMUNICATIONS ROOM TO THE APPLICABLE BOX / CABINET. CONTRACTOR SHALL SIZE AND PROVIDE CONDUITS TO MEET TIA-569.
- TELECOMMUNICATIONS ROOMS SHALL BE DEDICATED FOR INFORMATION TECHNOLOGY USE (I.E. NO SHARED SPACE WITH A JANITOR, FIRE ALARM SYSTEM, ETC.) NO SERVICES SHALL PASS THROUGH THE SPACE UNLESS DEDICATED TO THE SPACE (NO PLUMBING, MECHANICAL, ELECTRICAL, FIRE, ETC.)

### GENERAL DEMOLITION NOTES

- PRIOR TO SUBMITTING BID, VISIT THE JOB SITE AND BECOME FULLY ACQUAINTED WITH THE EXISTING CONDITIONS OF THE FACILITY, INCLUDING PATWAYS, BACKBOXES AND ELEVATIONS. REVIEW THE GENERAL NOTES AND ALL OTHER TRADE DRAWINGS FOR ADDITIONAL REQUIREMENTS THAT MAY NOT BE CALLED OUT IN THIS SECTION OF THE CONSTRUCTION DOCUMENTS. INCLUDING ALL DEMOLITION AND NEW WORK DOCUMENTS. NOTIFY ARCHITECT, ENGINEER OR OWNER, AS SPECIFIED, OF ANY CONFLICTS OR DISCREPANCIES.
- EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND SITE VISITS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. FIELD VERIFY CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. COORDINATE NEW WORK AND DEMOLITION WITH OTHER DISCIPLINES AND EXISTING CONDITIONS PRIOR TO CONSTRUCTION.
- AVOID DAMAGING EXISTING SURFACES AND EQUIPMENT TO REMAIN FOR NEW INSTALLATION. REPAIR DAMAGE CAUSED DURING WORK AT NO EXTRA COST TO OWNER.
- REMOVE ALL PATHWAYS, CABLING AND ASSOCIATED DEVICES FOR ALL ITEMS INTENDED TO BE REMOVED. ABANDONING UNUSED PORTIONS WILL NOT BE ACCEPTABLE.
- REMOVE EXISTING ITEMS AS REQUIRED TO ACCOMMODATE THE GENERAL DEMOLITION SCOPE. ANY SYSTEMS PASSING THROUGH THE SPACE INTENDED TO REMAIN IN SERVICE SHALL BE PROTECTED, OR RELOCATED AS REQUIRED TO MAINTAIN SERVICE AND ACCOMMODATE THE GENERAL DEMOLITION AND NEW SCOPE OF WORK.
- REFER TO ARCHITECTURAL PLANS FOR SCOPE OF AREAS THAT ARE TO BE DEMOLISHED UNDER THIS PHASE OF CONSTRUCTION. NOTE THAT IN SOME CASES, MEFFT DEMOLITION WORK EXTENDS BEYOND SCOPE OF AREA IDENTIFIED DUE TO EXISTING SYSTEM DESIGN. NOTIFY ARCHITECT AND ENGINEER OF ANY CONFLICTS OR DISCREPANCIES PRIOR TO STARTING WORK.
- COORDINATE THE INTERMEDIATE STORAGE, REMOVAL AND FINAL DISPOSITION OF TELECOMMUNICATIONS SCS COMPONENTS (PATHWAYS, CABLE, TERMINATION COMPONENTS, ETC.) AND THE REQUIRED PROTECTION OF EXISTING SPECIAL SYSTEMS EQUIPMENT WITH OWNER PRIOR TO IMPLEMENTATION THAT ARE TO BE REMOVED AS A RESULT OF THE DEMOLITION / RENOVATION WORK.
- EXISTING TELECOMMUNICATIONS CABLES AND COMPONENTS THAT PASS THROUGH THE CONSTRUCTION ZONE SHALL BE PROTECTED AND REMAIN IN PLACE SO AS TO MAINTAIN SERVICE WHILE ALSO ACCOMMODATING THE GENERAL DEMOLITION AND NEW SCOPE OF WORK. CONTRACTOR SHALL COORDINATE ALL SUCH EFFORTS WITH THE CLIENT PRIOR TO IMPLEMENTATION. DAMAGE TO EXISTING AND TO REMAIN IN PLACE TELECOMMUNICATIONS CABLES AND COMPONENTS CAUSED BY THE CONTRACTOR SHALL BE REPAIRED IN A TIMELY MANNER AND TO THE WRITTEN SATISFACTION OF THE CLIENT AND AT NO ADDITIONAL COST TO THE CLIENT. CONTRACTOR SHALL PROVIDE CABLE SUPPORTS FOR ANY EXISTING CABLES THAT ARE NOT PROPERLY SUPPORTED.

### CALL OUTS

ENLARGED PLAN CALLOUT	
NOT IN SCOPE	

## LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi-studio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveeng.com

structural engineer:  
Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com


MEP/IT/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com



8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM  
2150005255  
MO. CORPORATE NO. E-8580  
EXPIRES 12/31/2022

Issue Date: September 5, 2022

NUMBER	DESCRIPTION	DATE
--------	-------------	------

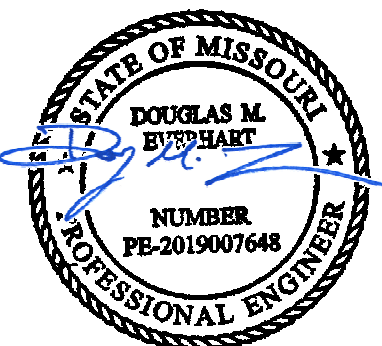

09/09/2022  
DOUGLAS M. EVERHART  
LICENSE # PE-2019007648

## LSHS - TECHNOLOGY GENERAL NOTES AND LEGEND

TN000-C



LSR7 Robotics, GiC &  
Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO  
64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO  
64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4200 Pennsylvania  
Kansas City, MO 64111  
816.591.6655  
multistudio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveeng.com

structural engineer:  
Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/ET/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite  
300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com



8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM  
2150005255  
MO. CORPORATE NO. E-858D  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

NUMBER	DESCRIPTION	DATE
1	Addendum 01	09/16/2022
2	Addendum 02	09/13/2022




DOUGLAS M. EVERHART  
LICENSE # PE-2019007648

LSHS - TECHNOLOGY  
PLAN - LEVEL 1 -  
BUILDING D & E


TN101-C

TECHNOLOGY PLAN NOTES:

T5 EXISTING AV RACK TO REMAIN.  
T17 LOCATION OF EXISTING WALL MOUNTED SHALLOW RACK.  
CONTRACTOR TO REPLACE WITH A NEW STANDARD OPEN  
WALL MOUNT RACK THAT SHALL BE 19" W X 36" H X 18" D.  
REFER TO SPEC SECTION "271100 TELECOMMUNICATIONS  
EQUIPMENT ROOM FITTINGS" FOR FURTHER  
REQUIREMENTS.

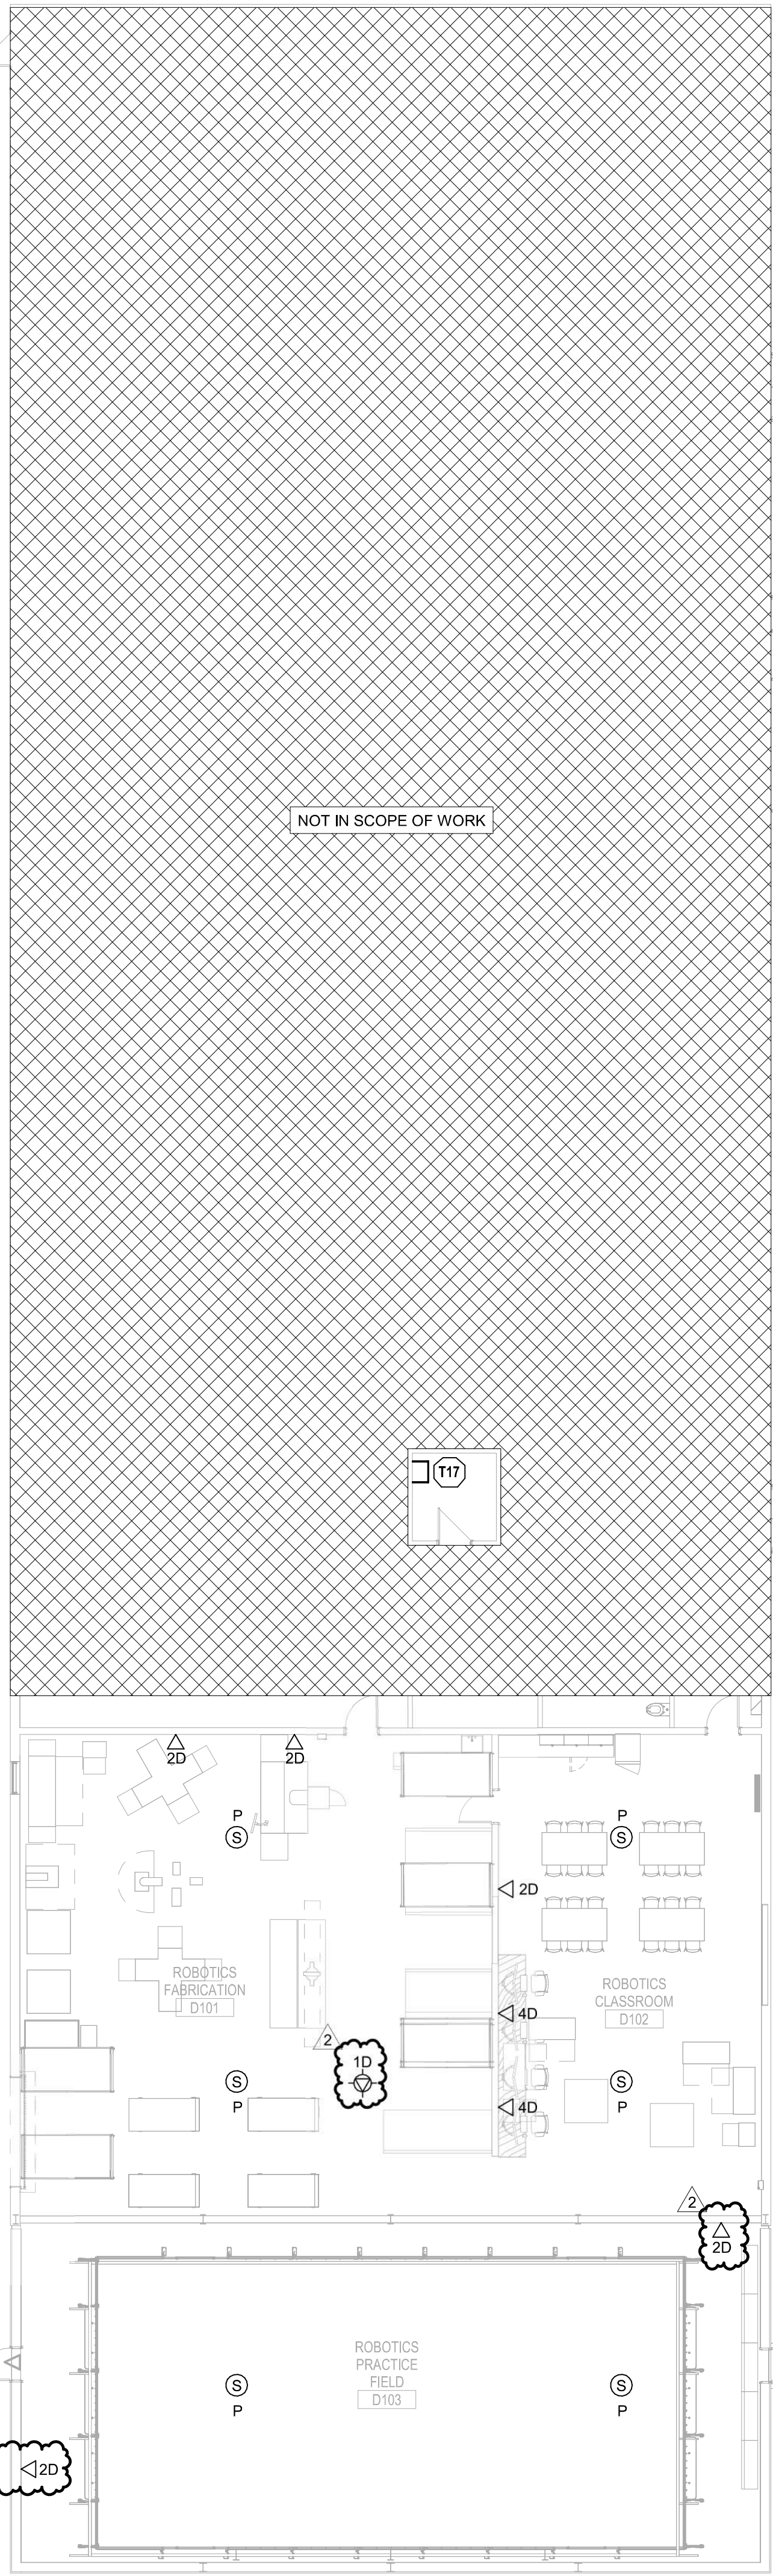


1 TECHNOLOGY LEVEL 1 PLAN - LSHS - BUILDING D  
3/32" = 1'-0"

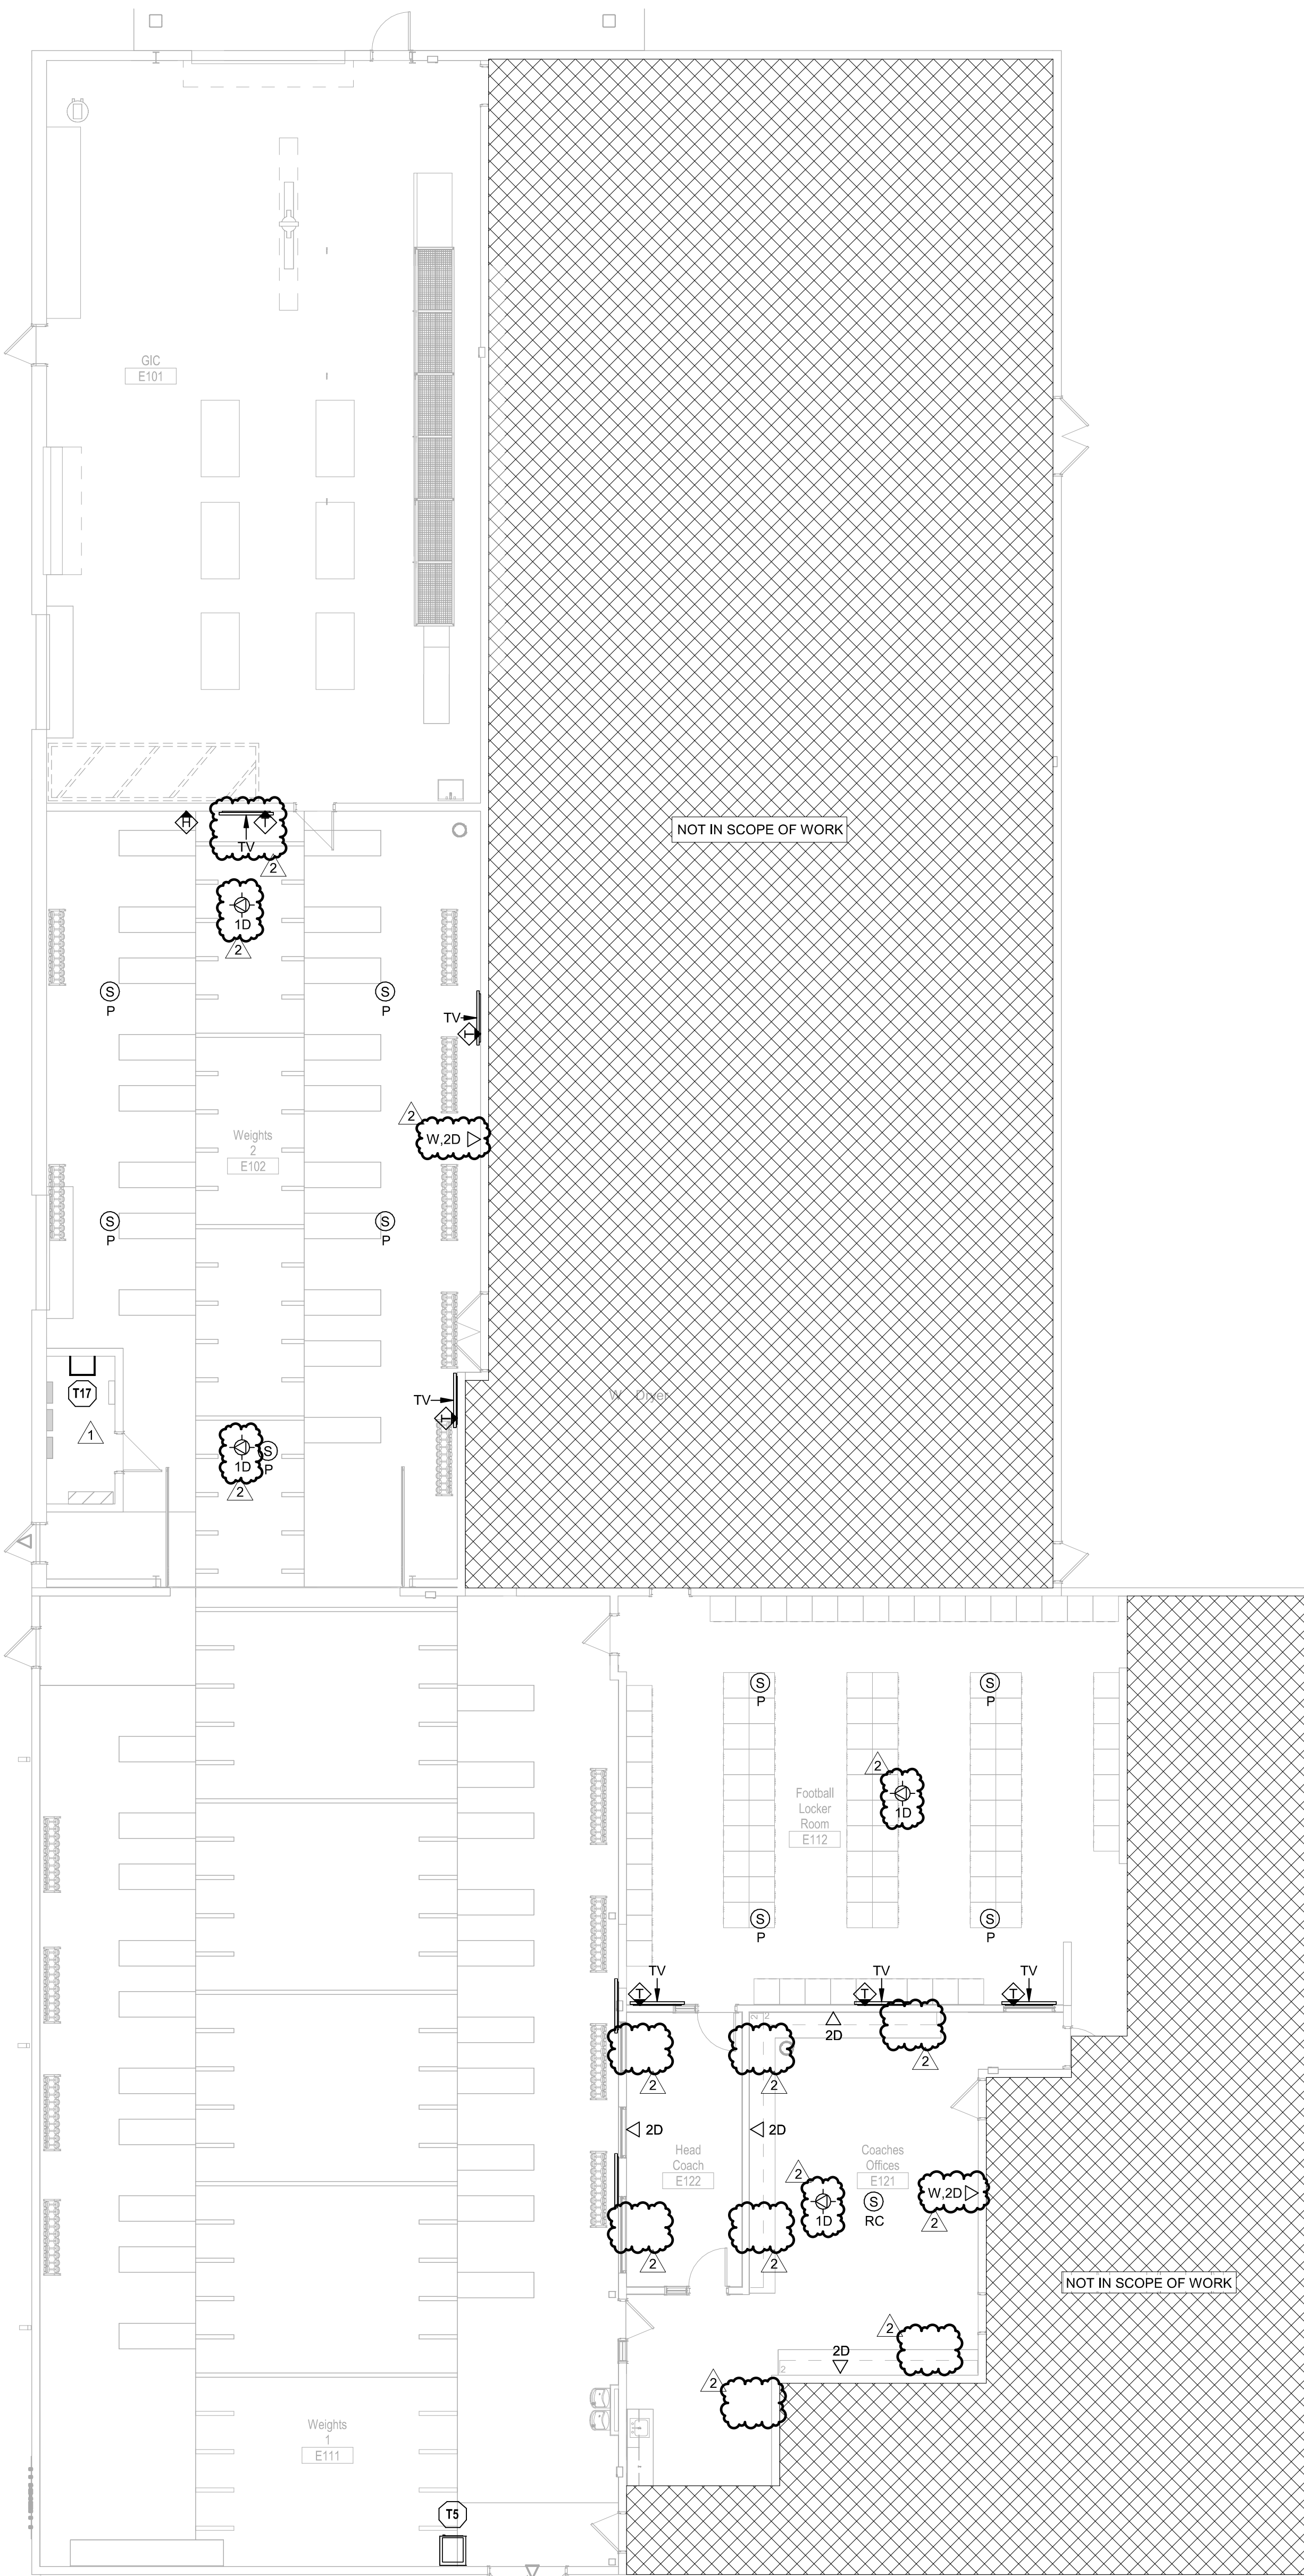


2 TECHNOLOGY LEVEL 1 PLAN - LSHS - BUILDING E  
1/8" = 1'-0"



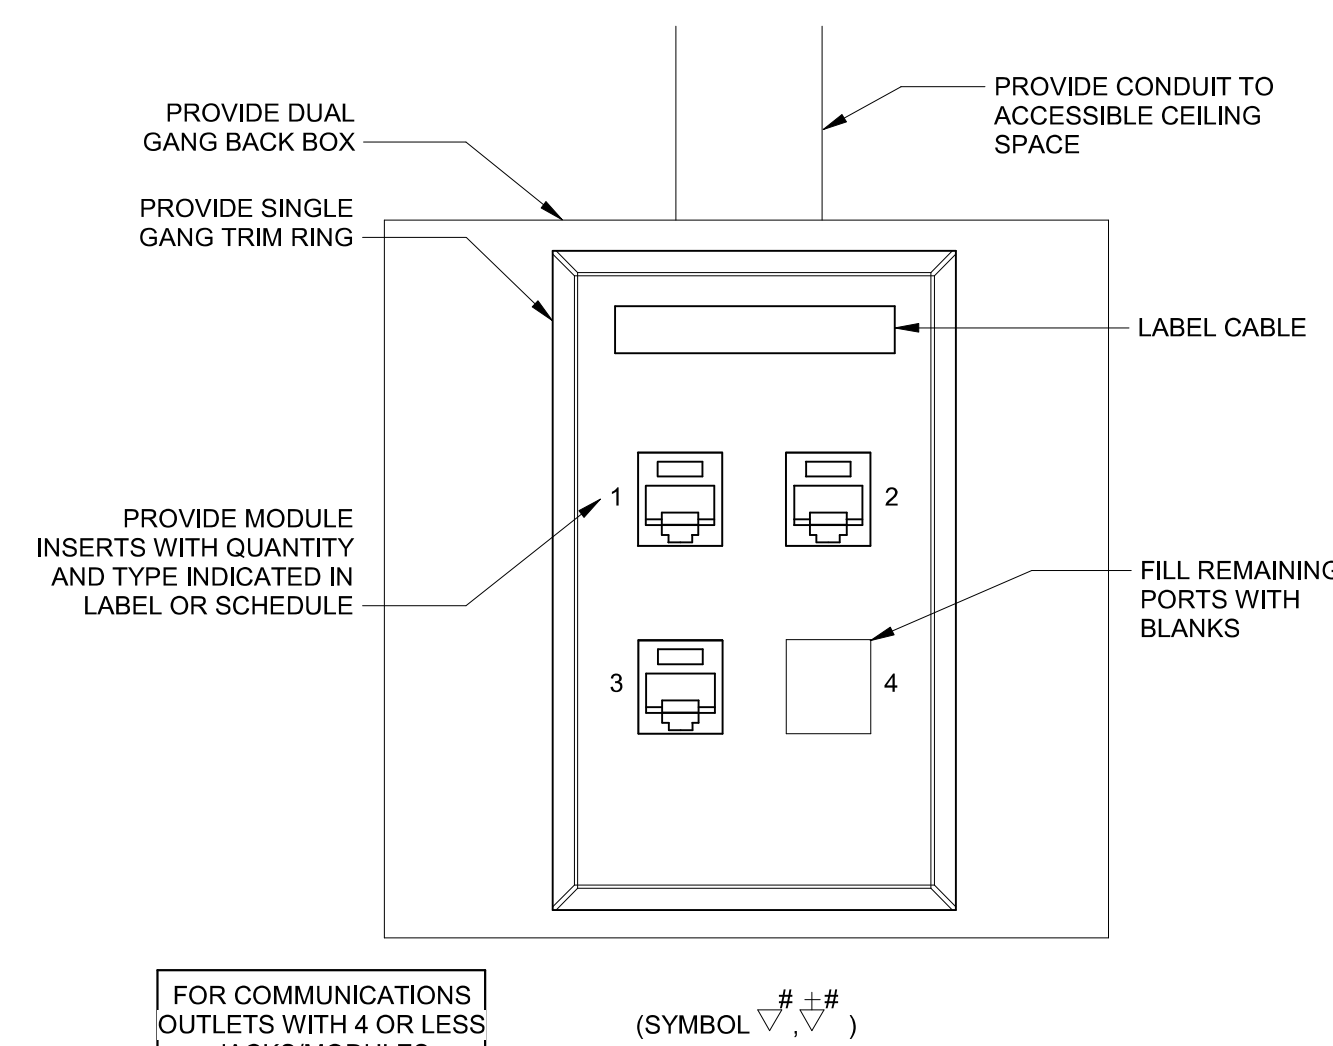

③ SINGLE GANG COMM OUTLET (2D)  
NTS

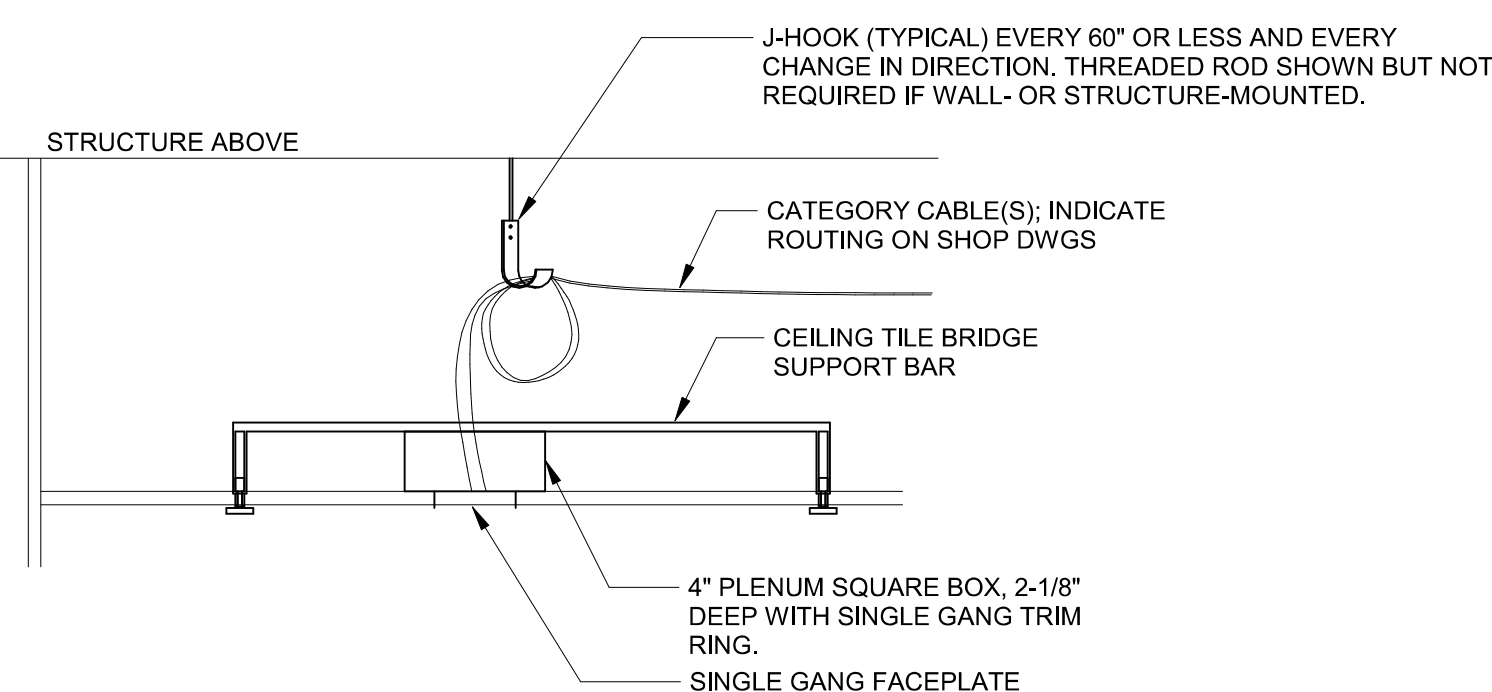


FOR OUTLETS IN GYPSUM BOARD CEILINGS

Diagram illustrating the installation of a single gang faceplate on a hard ceiling. The diagram shows a horizontal line representing the ceiling, with a vertical line indicating the location of the faceplate. A label points to the ceiling: "HARD CEILING". Another label points to the faceplate: "SINGLE GANG FACEPLATE". A label points to the conduit: "1\" CONDUIT TO ACCESSIBLE CEILING SPACE OR SERVING TELECOM ROOM; INDICATE ROUTING ON SHOP DRAWINGS". A label points to the cable: "CATEGORY CABLE(S)". A label points to the box: "4\" PLENUM SQUARE BOX 2-1/8\" DEEP WITH SINGLE GANG TRIM RING".


FOR OUTLETS IN EXPOSED TO STRUCTURE AREAS

④ CEILING COMM OUTLET 2D  
NTS

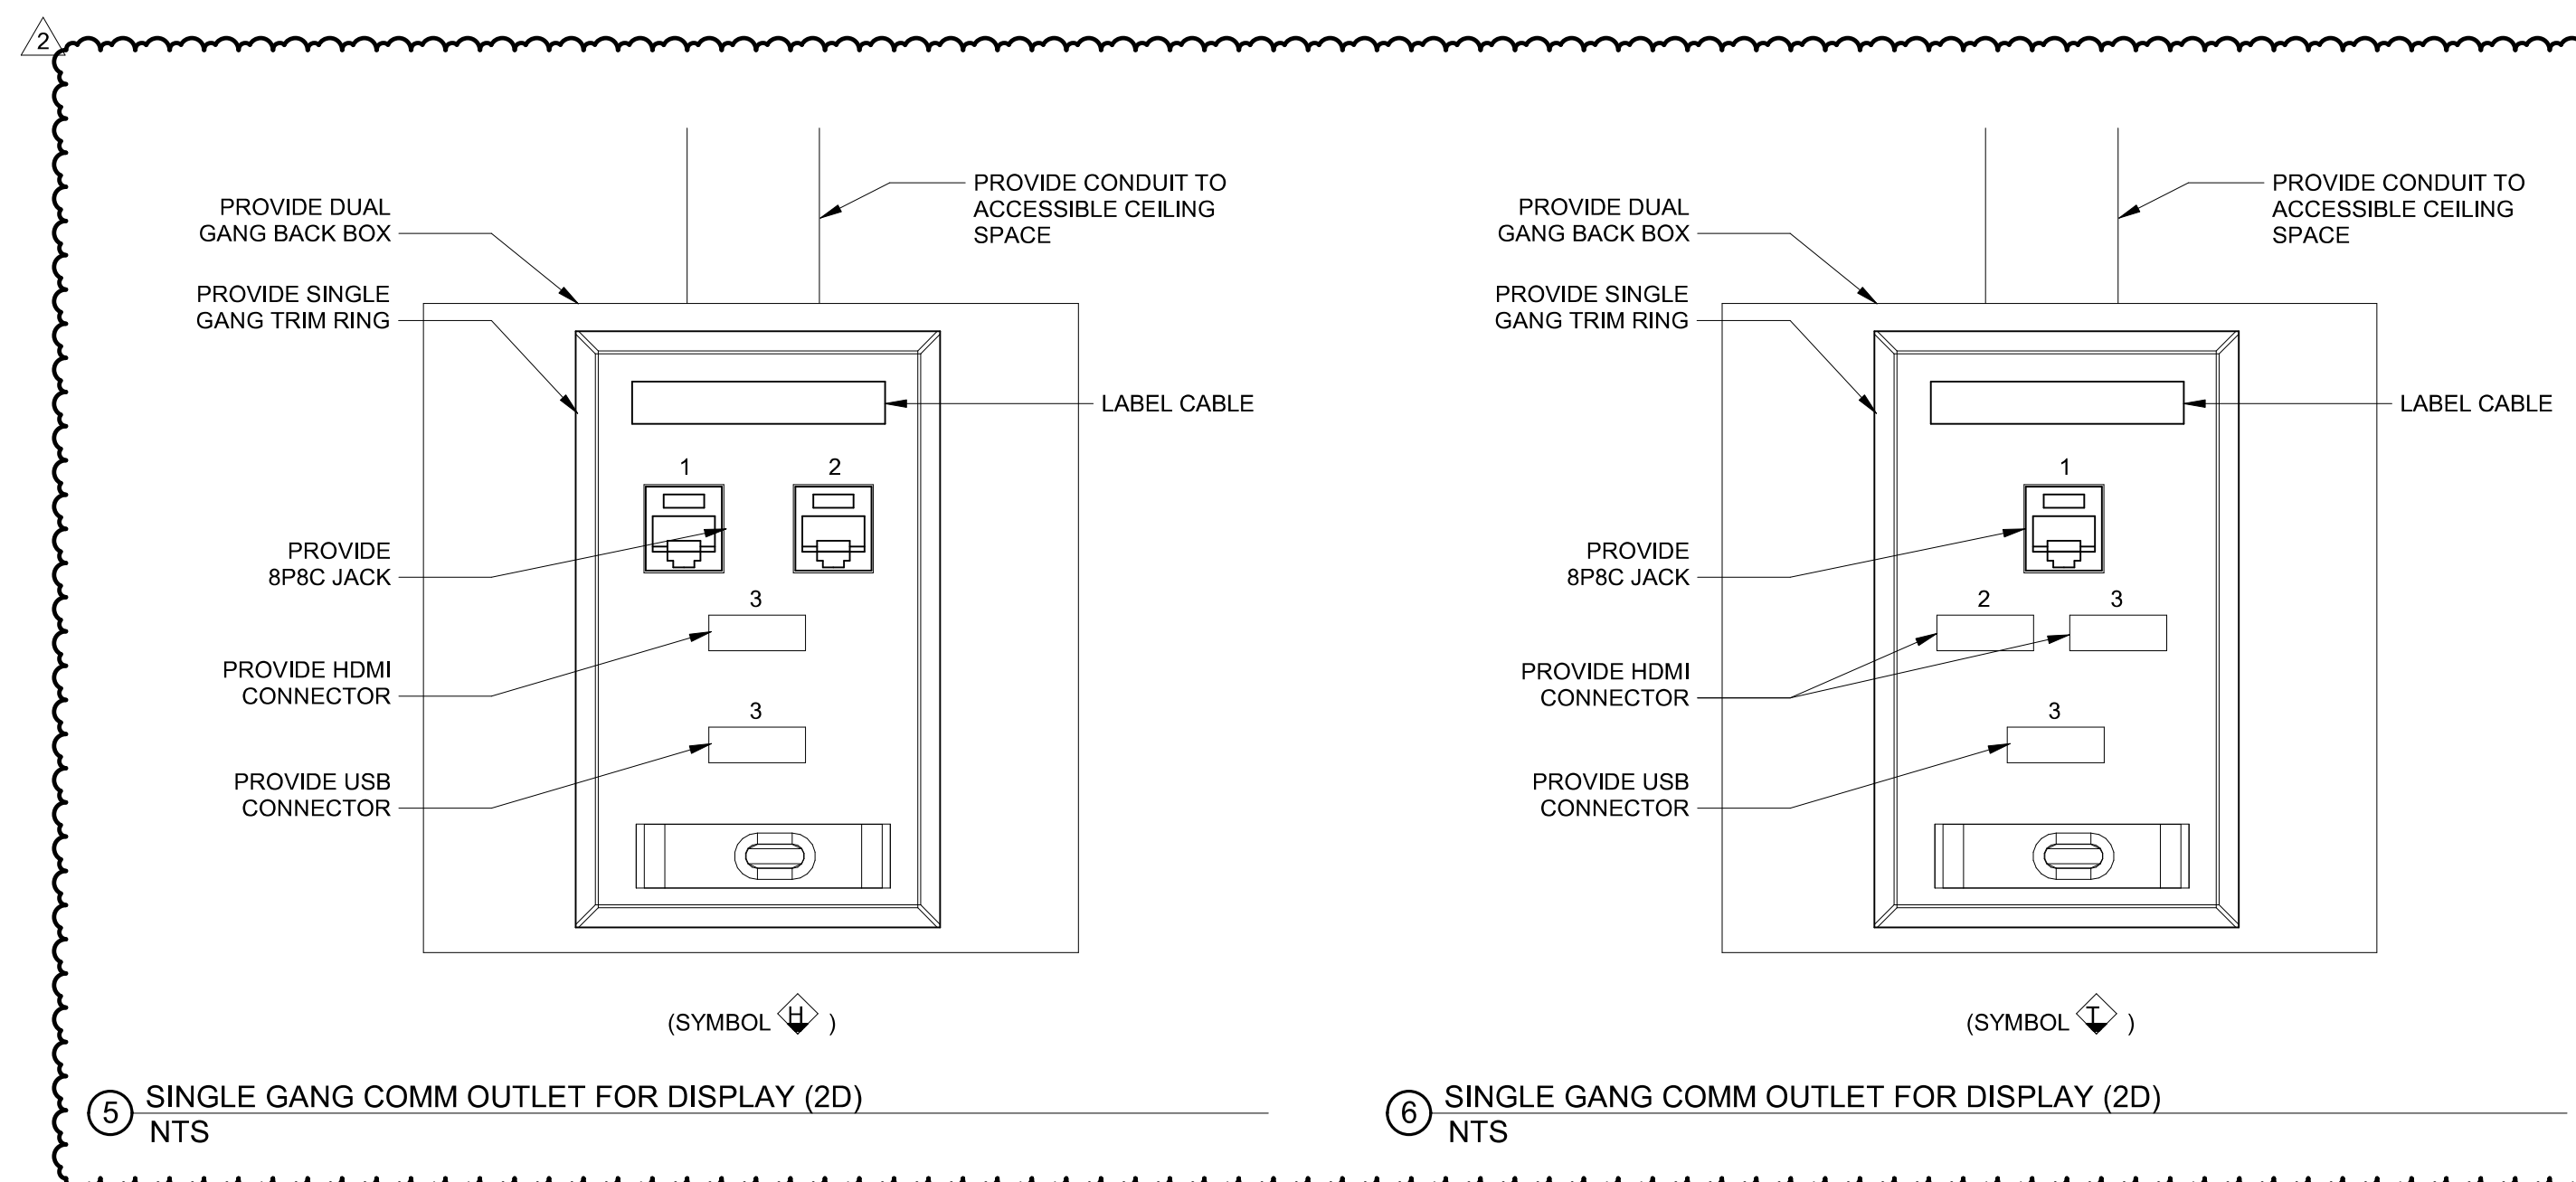


⑤ SINGLE GANG COMM OUTLET FOR DISPLAY (2D)  
NTS

⑥ SINGLE GANG COMM OUTLET FOR DISPLAY (2D)  
NTS

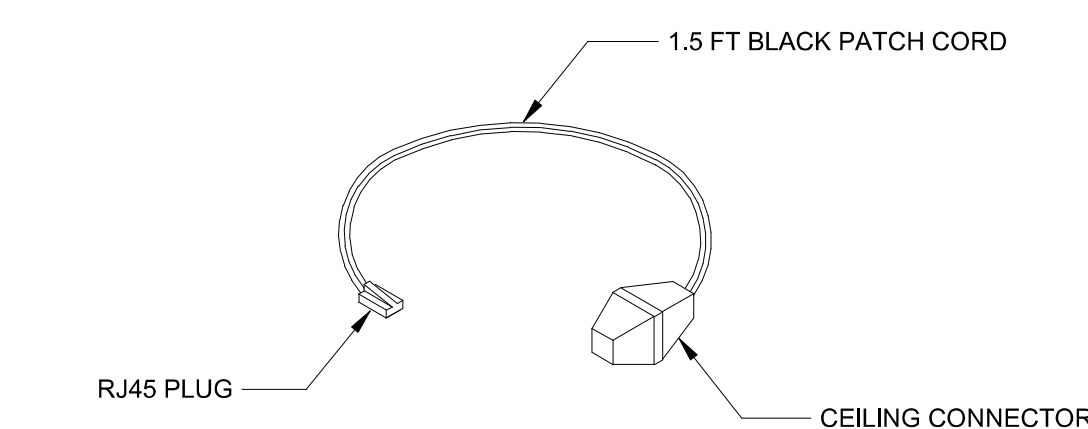

⑦ ACCESS POINT CONNECTOR ASSEMBLY  
NTS

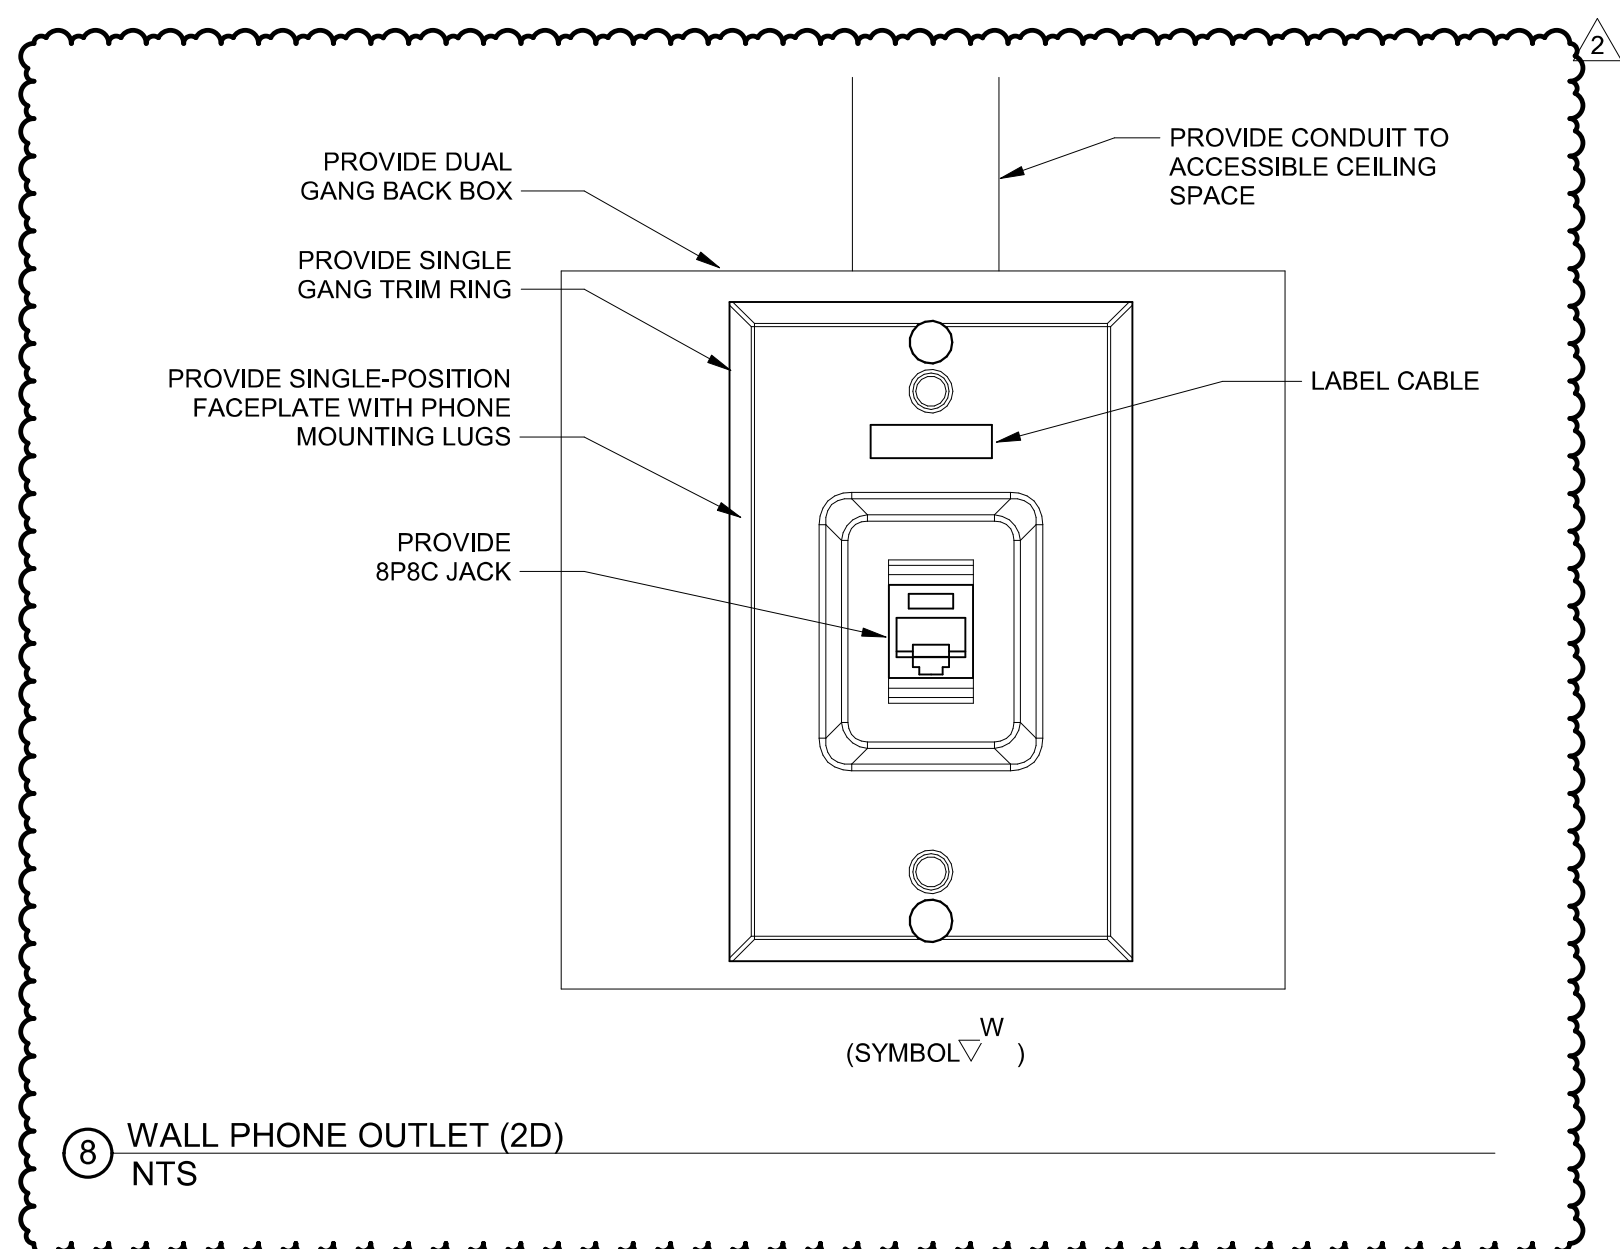

⑧ WALL PHONE OUTLET (2D)  
NTS



LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4209 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi-studio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kveng.com

structural engineer:  
Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/IT/Codes:  
Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com



8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM

Issue Date: September 9, 2022

Revisions

NUMBER DESCRIPTION DATE



09/09/2022  
DOUGLAS M. EVERHART  
LICENSE # PE-2019007648

LSHS - SECURITY  
GENERAL NOTES AND  
LEGEND

TY000-C





1 SECURITY LEVEL 1 PLAN - LSHS - BUILDING D  
3/32" = 1'-0"

2 SECURITY LEVEL 1 PLAN - LSHS - BUILDING E  
1/8" = 1'-0"

SECURITY PLAN NOTES:

TY2 ALL SECURITY DEVICES SHOWN SHALL BE SERVED BY EXISTING PANELS NOT SHOWN ON PLAN. COORDINATE WITH OWNER'S SECURITY VENDOR.

multistudio  
the evolution of gould evans

LSR7 Robotics, GIC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

owner:  
Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect:  
Multistudio  
4209 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multi-studio

civil engineer:  
Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kvang.com

structural engineer:  
Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com


MEP/IT/Code:  
Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com



8345 LENEXA DRIVE, SUITE 300  
LENEXA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM  
2150005255  
MO. CORPORATE NO. E-6580  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions		
NUMBER	DESCRIPTION	DATE

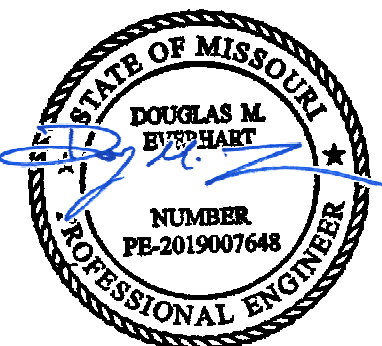

09/09/2022  
DOUGLAS M. EVERHART  
LICENSE # PE-2019007648

LSHS - SECURITY PLAN -  
LEVEL 1 - BUILDING D &  
E

TY101-C



LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086  
LSW: 2600 SW Ward Rd, Lee's Summit MO 64082  
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063


owner: Lee's Summit R-7 School  
301 NE Tudor Road  
Lee's Summit, MO 64086

architect: Multistudio  
4203 Pennsylvania  
Kansas City, MO 64111  
816.931.6655  
multistudio

civil engineer: Kaw Valley Engineering  
14700 West 114th Terrace  
Lenexa, KS 66215  
913.485.0318  
kvang.com

structural engineer: Bob D. Campbell & Company, Inc.  
4338 Bellevue  
Kansas City, MO 64111  
816.531.4144  
www.bdc-engrs.com

MEP/IT/Code: Henderson Engineers  
8345 Lenexa Drive, Suite 300  
Lenexa, KS 66214  
816.742.5000  
www.hendersonengineers.com

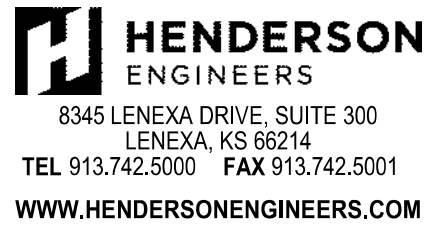


2150005255  
MO. CORPORATE NO. E-658D  
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions

NUMBER	DESCRIPTION	DATE
--------	-------------	------

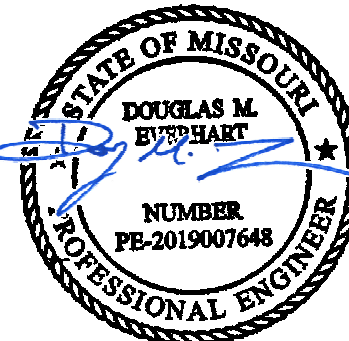

09/09/2022  
DOUGLAS M. EVERHART  
LICENSE # PE-2019007648

LSHS - SECURITY  
DETAILS

TY500-C

