



Greystone - Hook Farms - Lot 24

2621 SW Hook Farm Lane  
Lee's Summit, MO 64082

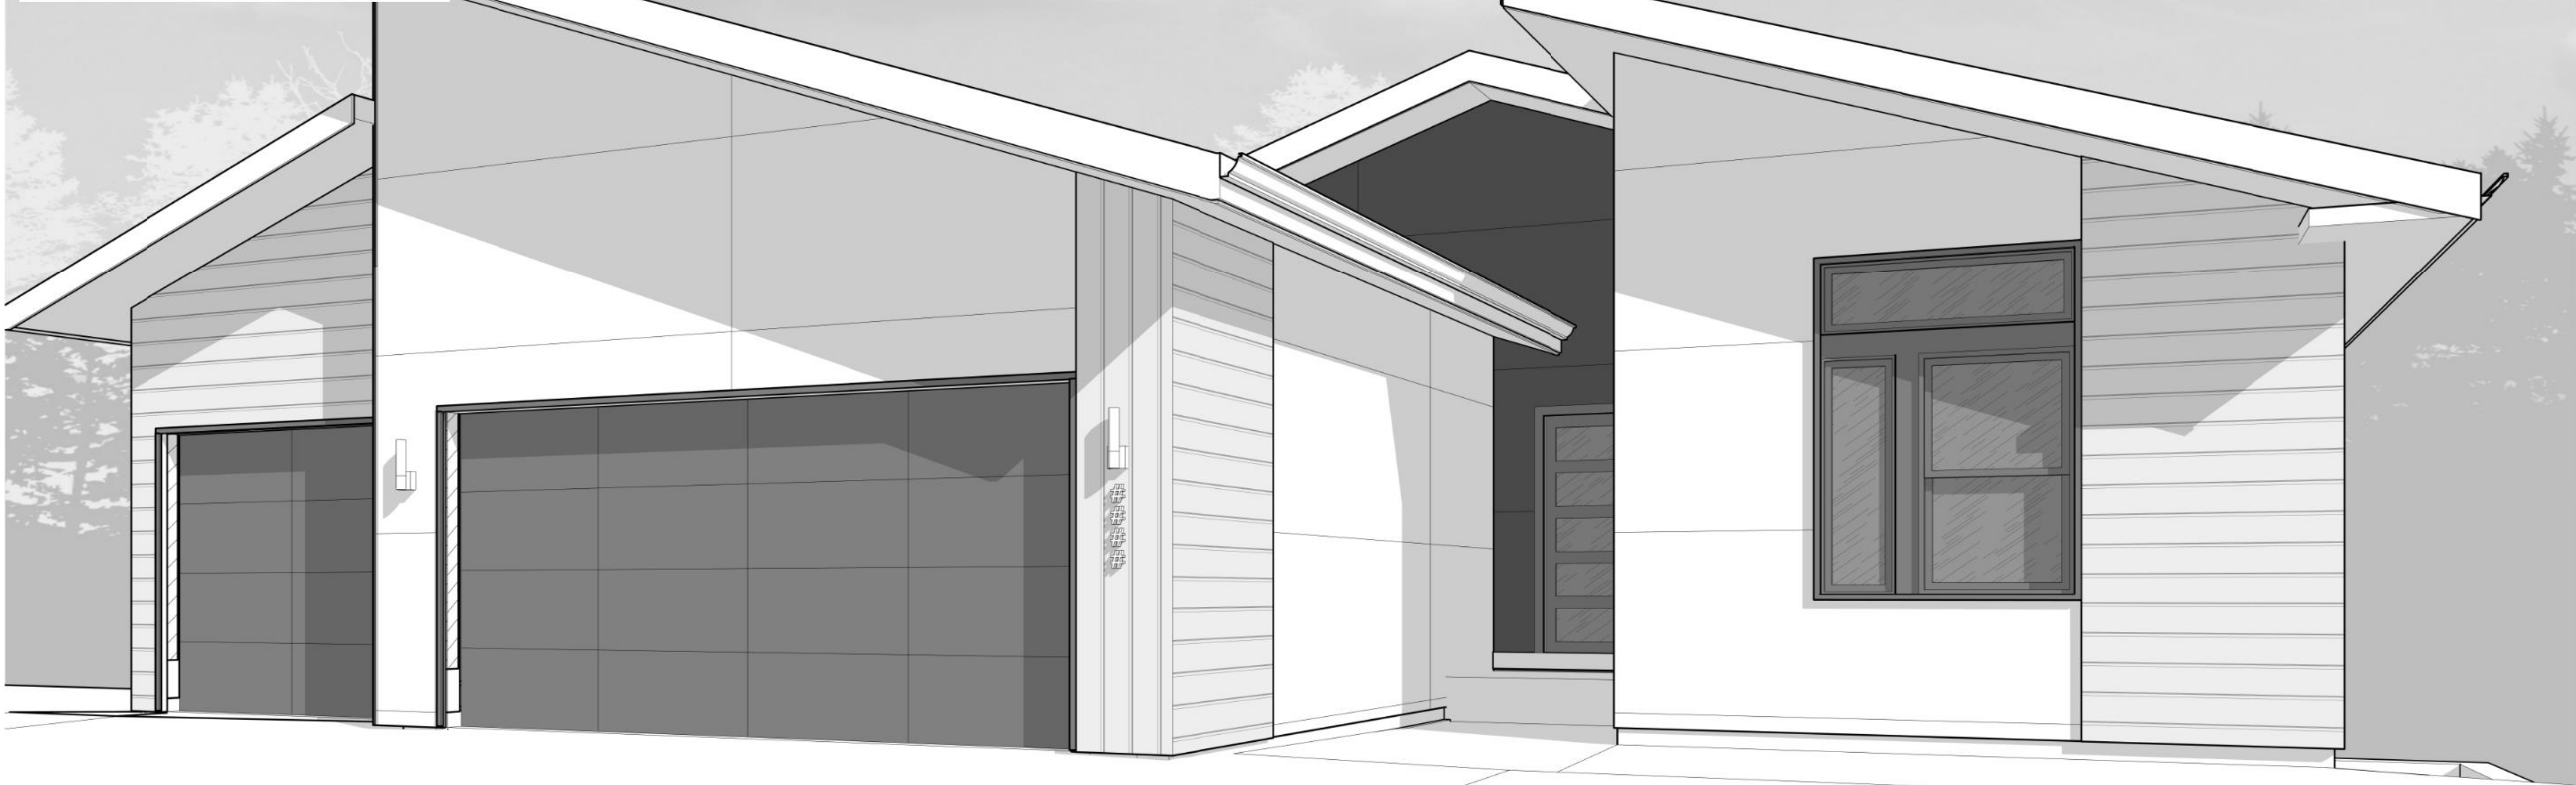


Sheet List

- 05 - Architecture
- A0 - Foundation Plan
- A1 - Floor Plan - Main Level
- A2 - RCP/Electrical Plan
- A3.D - Elevations
- A4.D - Building Sections
- A5 - Details
- A6 - Details

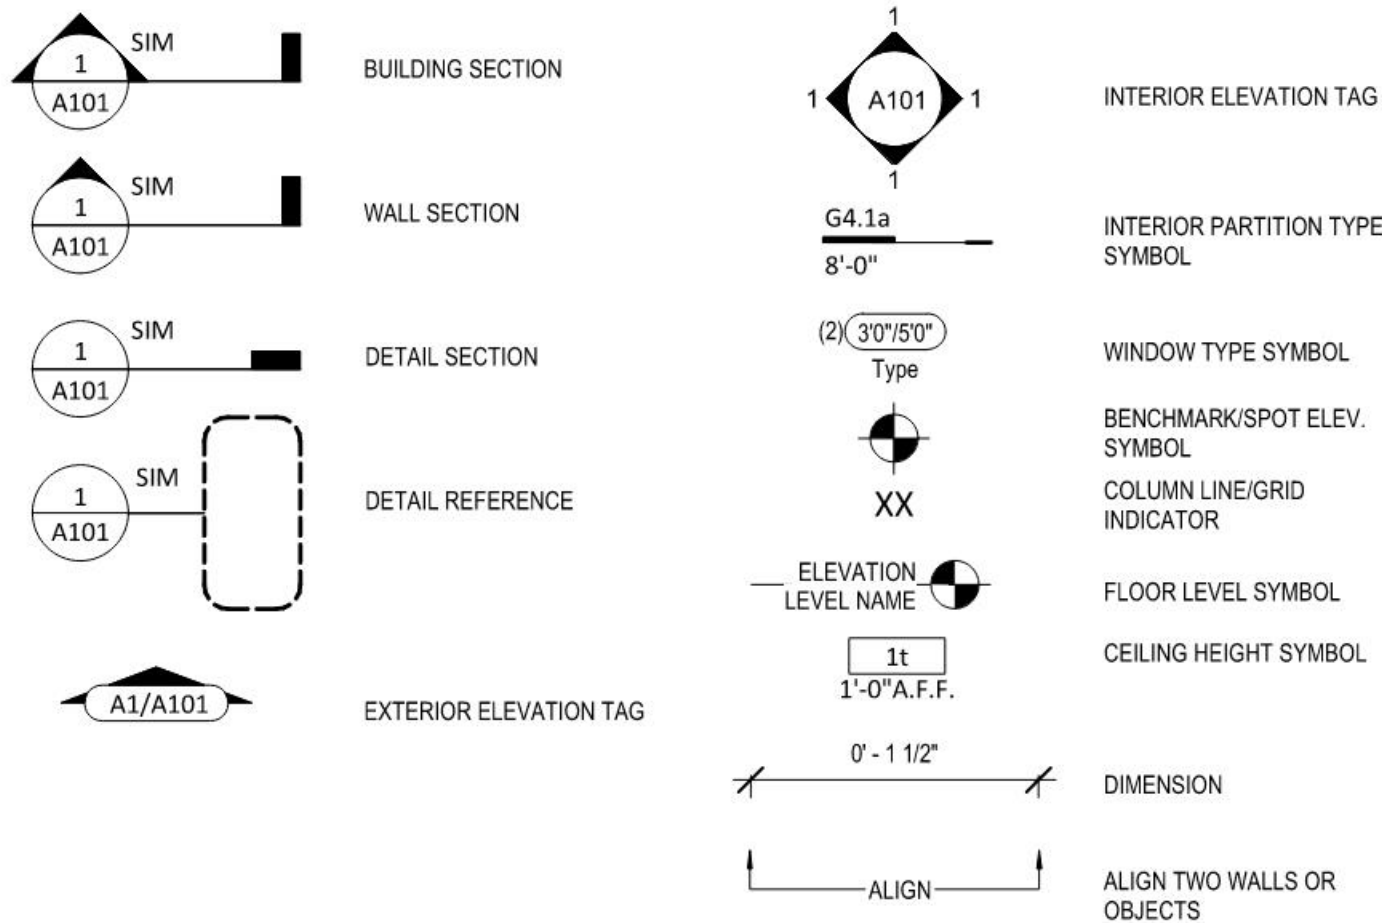

Interior Partition Types

- NOTES:
1. PROVIDE MOISTURE RESISTANT GWB IN WET AREAS
  2. EXTEND ALL FIRE RATED WALLS STRUCTURE TO STRUCTURE.
  3. USE TYPE "X" GWB FOR ALL FIRE RATED PARTITIONS
  4. REFER TO ELEVATIONS FOR LOCATIONS WHERE WALL IS NOT FULL HEIGHT. IN THESE CASES CAP THE TOP OF THE WALL WITH A LAYER OF 1/2" GYPSUM BOARD U.N.O.

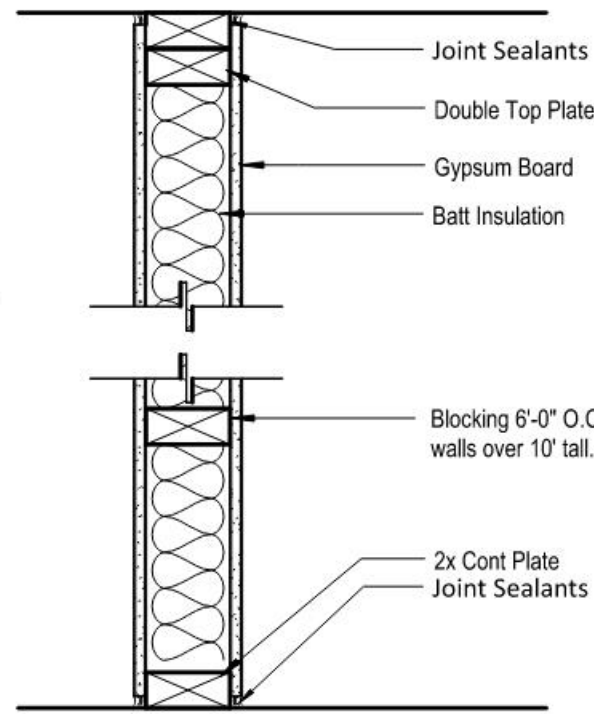


PARTITION SYSTEM:  
GYPSUM WALL BOARD PARTITION

G

PARTITION IDENTIFICATION PLAN SYMBOL	G4	G4.1	G4.L	G6
BASE PARTITION THICKNESS	4.5"	4.5"	4.5"	6.5"
STUD SPACING (O.C.)	16"	16"	16"	16"
STUD SIZE	2x4	2x4	2x4	2x6
GWB THICKNESS	1/2"	5/8"	5/8"	1/2"
JOINT SEALANTS	No	No	No	No
INTERIOR LOAD BEARING WALL	No	No	Yes	No
FIRE RATING (HRS)	-	1	-	-
FIRE TEST NUMBER	-	U314	-	-
FIRE TEST NUMBER (HEAD OF WALL)	-	-	-	-
FIRE RESISTIVE JOINTS	-	-	-	-
ACOUSTIC RATING (STC)	-	-	-	-
ACOUSTICAL TEST NUMBER	-	-	-	-
INSULATION	No	Yes	No	No
ACOUSTICAL JOINTS	-	-	-	-
REMARKS:	* SEE NOTE #4	* SEE NOTE #3	* SEE NOTE #3	* SEE NOTE #4

- NOTES:
1. REFER TO ELEVATIONS FOR LOCATIONS WHERE WALL IS NOT FULL HEIGHT. IN THESE CASES CAP THE TOP OF THE WALL WITH A LAYER OF 1/2" GYPSUM BOARD U.N.O.

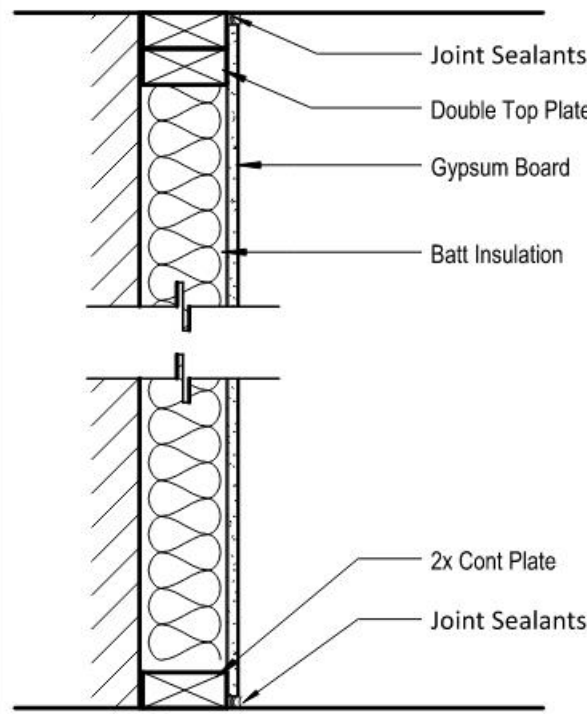


PARTITION SYSTEM:  
GYPSUM FURING PARTITION

F

PARTITION IDENTIFICATION PLAN SYMBOL	F4
BASE PARTITION THICKNESS	4"
STUD SPACING (O.C.)	16"
STUD SIZE	2x4
GWB THICKNESS	1/2"
JOINT SEALANT	No
FIRE RATING (HRS)	-
FIRE TEST NUMBER	-
FIRE TEST NUMBER (HEAD OF WALL)	-
FIRE RESISTIVE JOINTS	-
ACOUSTIC RATING (STC)	-
ACOUSTICAL TEST NUMBER	-
INSULATION	No
ACOUSTICAL JOINTS	-
REMARKS:	* SEE NOTE #1

- NOTES:
1. REFER TO ELEVATIONS FOR LOCATIONS WHERE WALL IS NOT FULL HEIGHT. IN THESE CASES CAP THE TOP OF THE WALL WITH A LAYER OF 1/2" GYPSUM BOARD U.N.O.

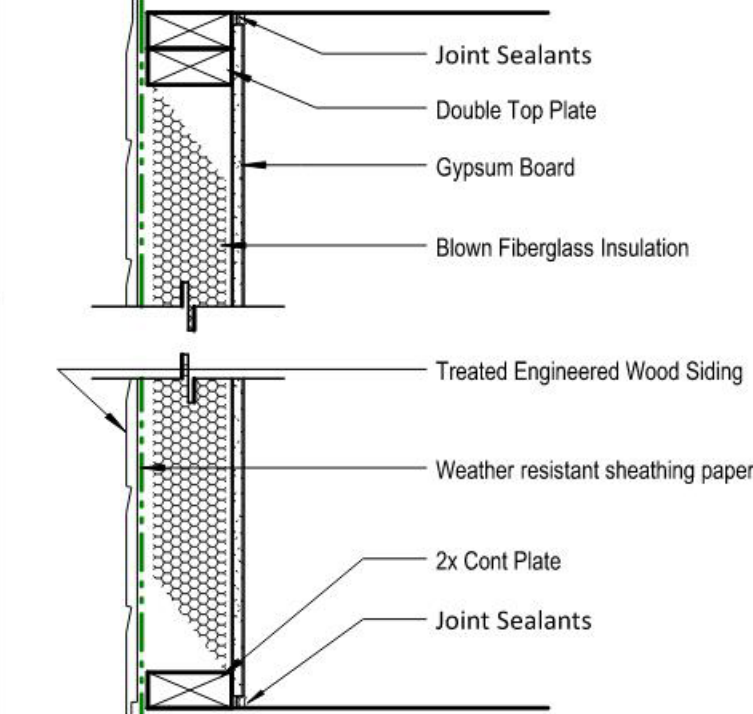

PARTITION SYSTEM:  
Exterior Partition

E

PARTITION IDENTIFICATION PLAN SYMBOL	E4
BASE PARTITION THICKNESS	4"
STUD SPACING (O.C.)	16"
STUD SIZE	2x4
GWB THICKNESS	1/2"
JOINT SEALANT	Yes
FIRE RATING (HRS)	-
FIRE TEST NUMBER	-
FIRE TEST NUMBER (HEAD OF WALL)	-
FIRE RESISTIVE JOINTS	-
ACOUSTIC RATING (STC)	-
ACOUSTICAL TEST NUMBER	-
INSULATION	Yes
ACOUSTICAL JOINTS	-
REMARKS:	* SEE NOTE #1

RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
11/03/2022 3:44:47

General Information

2018 Interior Energy Cons. Code (Table N1102.1.2)	
Doors & Windows:	U-0.32 MAX
Glazing SHGF:	0.40
Skylights:	U-0.55 MAX
Roof	
Attic Ceilings:	R-49 MIN
Vaults:	R-38 MIN
Vaults < 500sf:	R-30 MIN
Wood Frame Walls:	R-20 or R-13 + 5 MIN
Basement Walls:	R-13 or R-10 Continuous
Floor (over unconditioned):	R-19 MIN
Slab on Grade:	R-10 for 24" MIN
Ductwork:	R-8 MIN
Fuel Fired Furnace:	90% AFUE MIN
Electric Furnace:	No Minimum
Cooling System:	13 SEER MIN
Water Heater	
Gas Fired Storage:	0.67 EF MIN
Gas Fired Instant:	0.62 EF MIN
Electric Storage:	0.97 EF MIN
Electric Instant:	0.93 EF MIN

An energy efficient certificate is required to be posted in or on the electrical panel before the final inspection. The certificate will be provided with all new residential permits. It is the permit holder/contractor's responsibility to ensure the certificate has accurate information and is posted before final inspection - Owner/Contractor is responsible for meeting the prescriptive requirements of IRC chapter 11 unless a HER Index Analysis for Performance Compliance based on the plans is submitted to the AHJ for approval.

IRC 2018	
Ground Snow Load:	20PSF
Wind Speed:	115mph
Topography Effects:	No
Seismic Design Category:	A
Damage From Weather:	Severe
Frost Line Depth:	36 inches
Termites:	Moderate to Heavy
Winter Design Temperature:	6 F
Ice Barrier Underlayment:	Yes
Flood Hazard:	
Air Freezing Index:	927 or less
Mean Annual Temperature:	55.5 F

1. Whole House Mechanical Ventilation System is required for any dwelling with air infiltration at a rate of less than 5 air changes per hour (at ACH50 standard R303.4).
2. Carbon monoxide detectors required (R315)
3. Steel columns shall be minimum schedule 40 (R507.2)
4. Deck Ledger attachment to house shall be per Tables 507.9.1.3.
5. New provisions for attachment of rafters, trusses and roof beams. (R802.3 and R802.11)
6. Programmable thermostat required (N1103.1.1)
7. Air handlers shall be rated for Maximum 2% air leakage rate (N1103.2.2.1)
8. Building cavities used as return air plenums shall be sealed to prevent leakage across the thermal envelope. (N1103.2.3)
9. Certain hot water pipes shall be insulated (N1103.4)
10. All exhaust fans shall terminate to the building exterior (M1507.2)
11. Makeup air system required for kitchen exhaust hoods that exceed 400 CFM M1503.4
12. Building cavities in a thermal envelope wall (including the wall between the house and garage) shall not be used as return air plenums (unless the required insulation and air barrier are maintained) (M1601.1.1.#7.3)
13. An air handling system shall not serve both the living space and the garage (M1601.6)
14. A concrete-Encased grounding electrode (UFER Ground) connection complies with the requirements of the 2018 IRC Section E3608.1.2 in providing a connection with no less than the required minimum of steel.
15. Compliance with the requirements and show connection as needed for roof beam, trus, rafter, and girder connections for uplift per IRC 802.11
16. Garage Door Rating: DASMA 115 MPH Rated



Greystone - Hook Farms - Lot 24  
2621 SW Hook Farm Lane  
Lee's Summit, MO 64082


Original Issue Date:		Permit Set
11/03/2022		01/25/22
REVISIONS		
Number	Description	Date

Permit Set

PLAN DESCRIPTION: Greystone

00



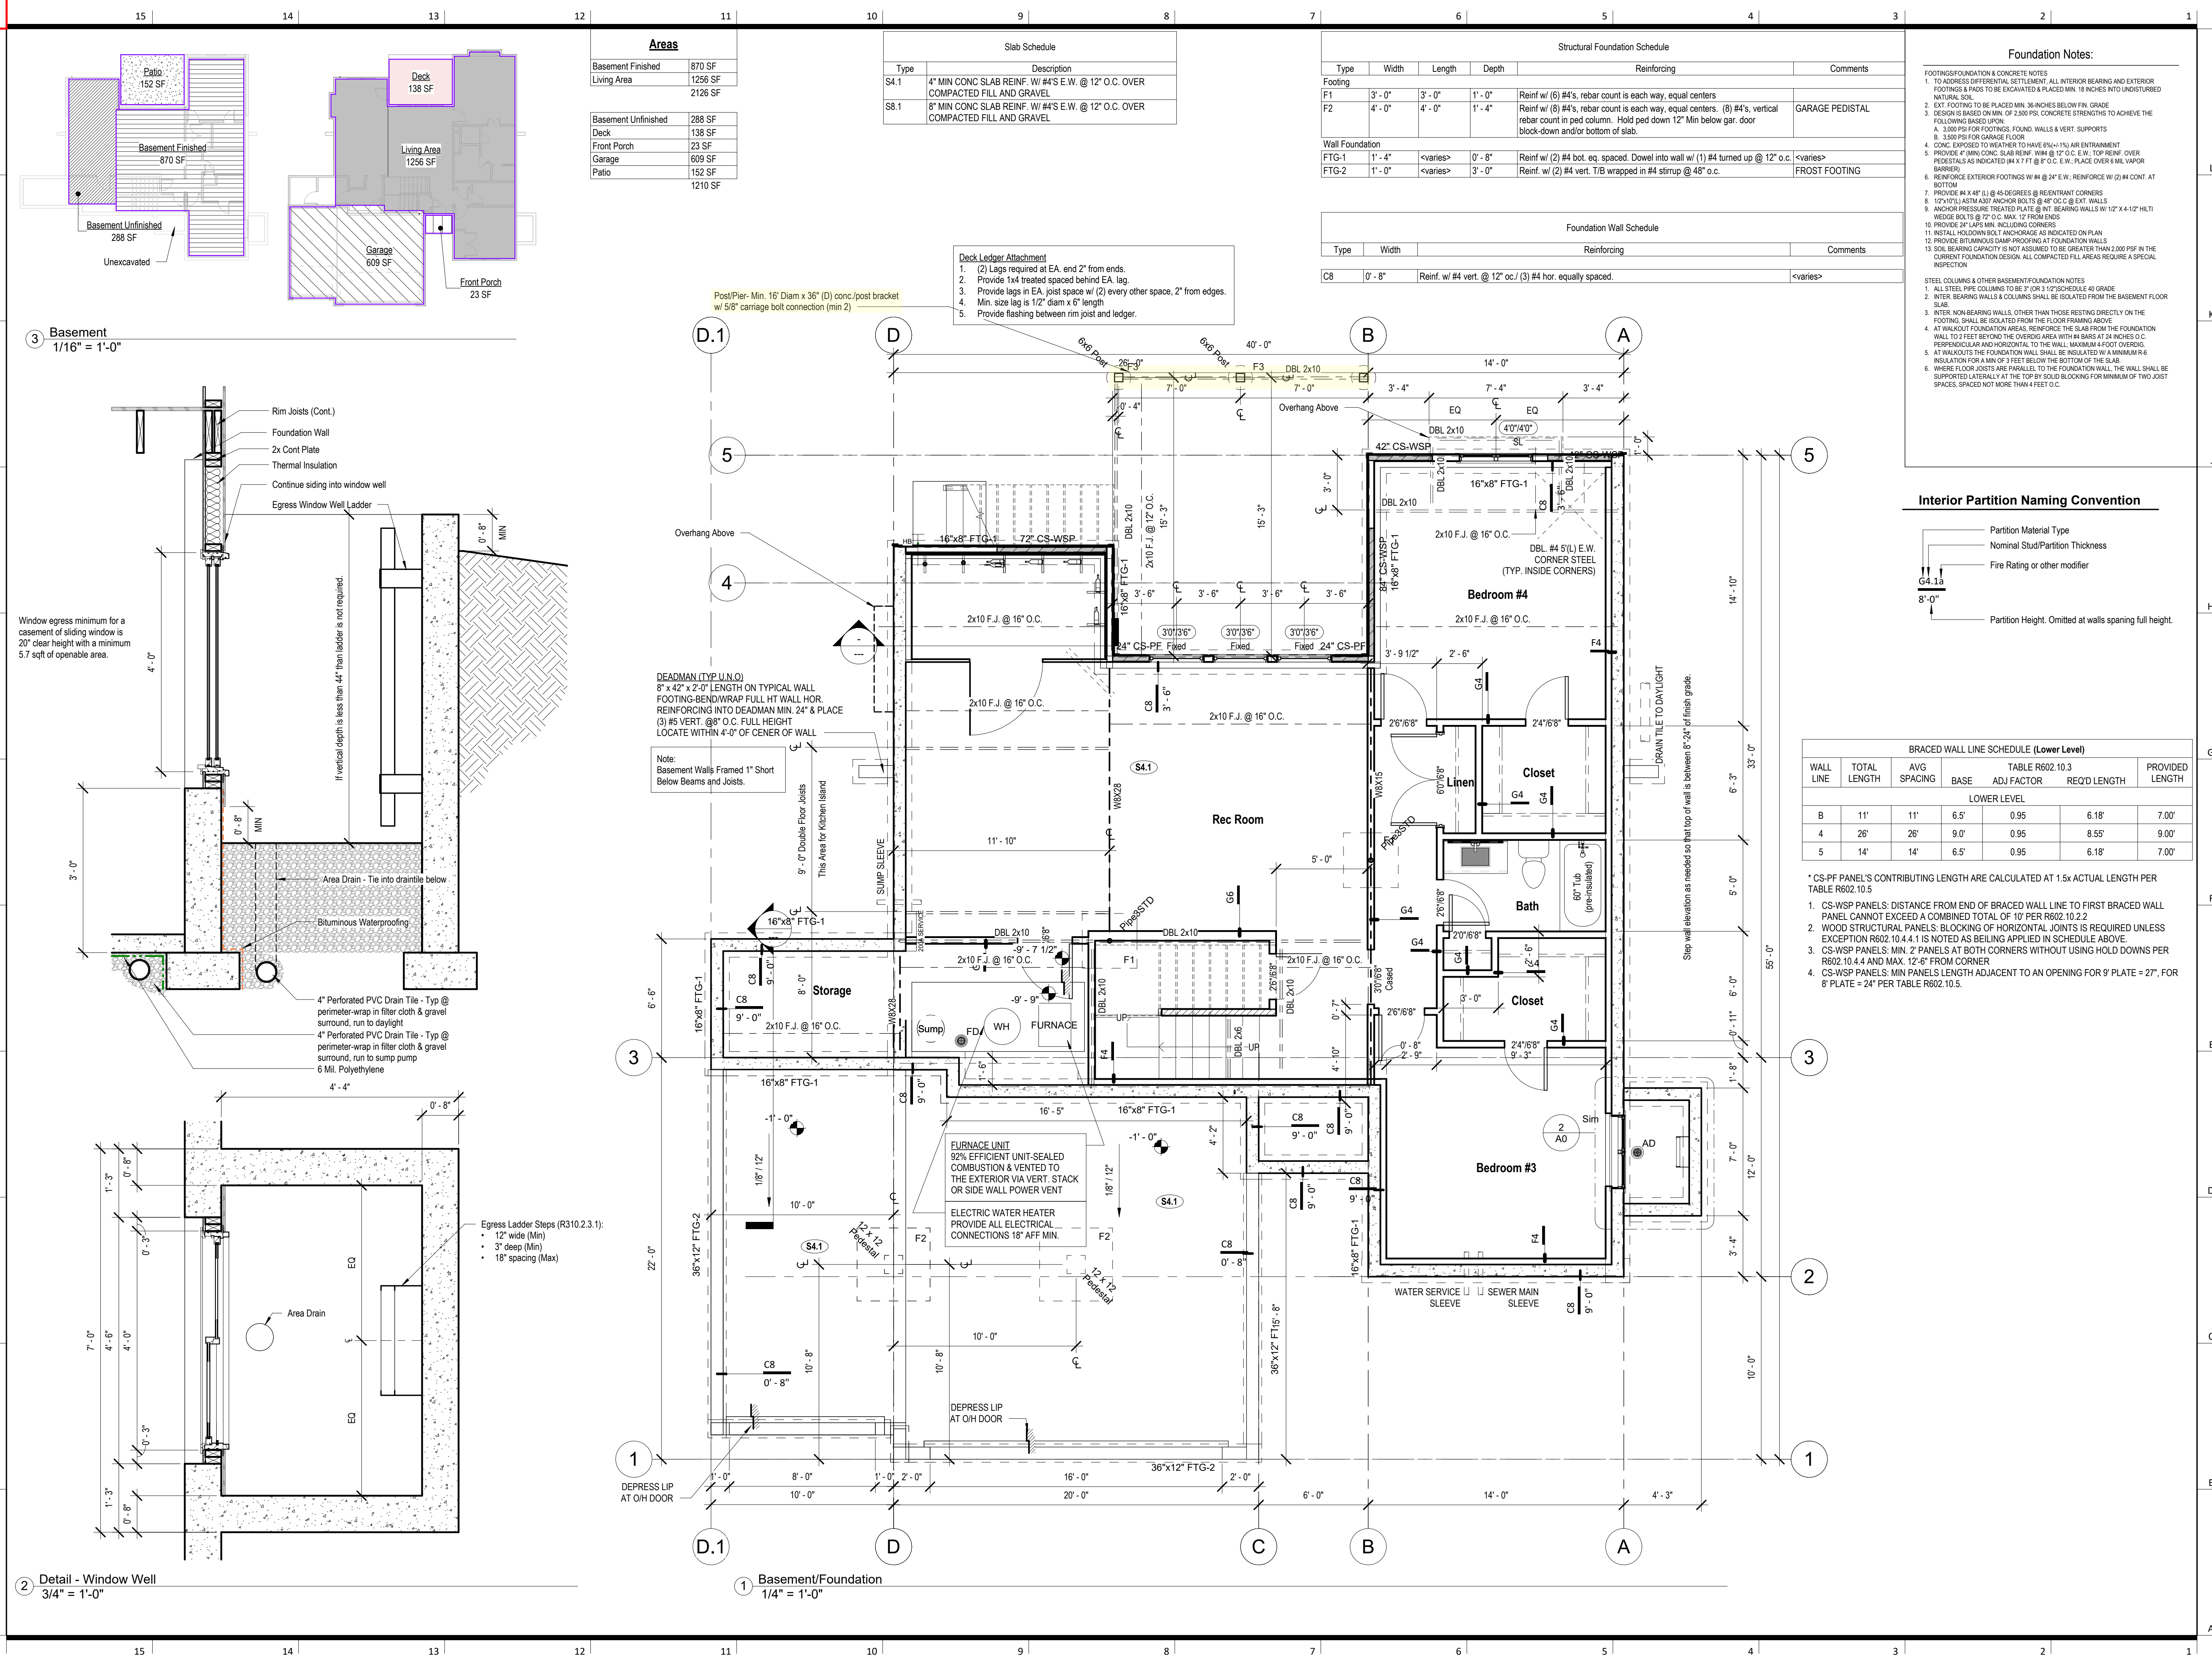

architect:  
**Elevate Design + Build**  
350 SW Longview Blvd.  
Lee's Summit, MO 64081  
816.622.8826 voice  
www.elevatedesignbuildco.com  
2621 SW Hook Farm Lane  
Lee's Summit, MO 64082

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

Original Issue Date: 01/25/22  
**REVISIONS**  
Number DESCRIPTION DATE











Lighting Fixture Schedule		
Type Mark	Description	Type Comments
B1	Ceiling Mounted Exposed Bulb	
C1	Recessed Can Light - Interior	
C2	Recessed Can Light - Exterior	
C3	LED Disk Light	
CF1	Ceiling Fan w/ Light - Surface Mounted	
CF2	Ceiling Fan w/ Light - Down Rod	Mount with 2'-0" Down Rod
P1	Decorative Pendant Fixture	Mount bottom of fixture 84" AFF
P2	Decorative Pendant Fixture	Mount bottom of fixture 84" AFF
S1	Wall Sconce - Exterior	
V1	Vanity Wall Mounted	
V2	Vanity Wall Mounted	

Note:  
1. Lighting fixtures penetrating the thermal envelope (Ex: can lights in attic) shall be IC-Rated, Leakage-Rated and sealed to teh gypsum wallboard (N1103.1.1)

Legend - RCP  
Wall Mounted   
Ceiling Mounted   
CO - Carbon Monoxide Detector  
S - Smoke Detector  
S/C - Smoke Detector/CO Detector

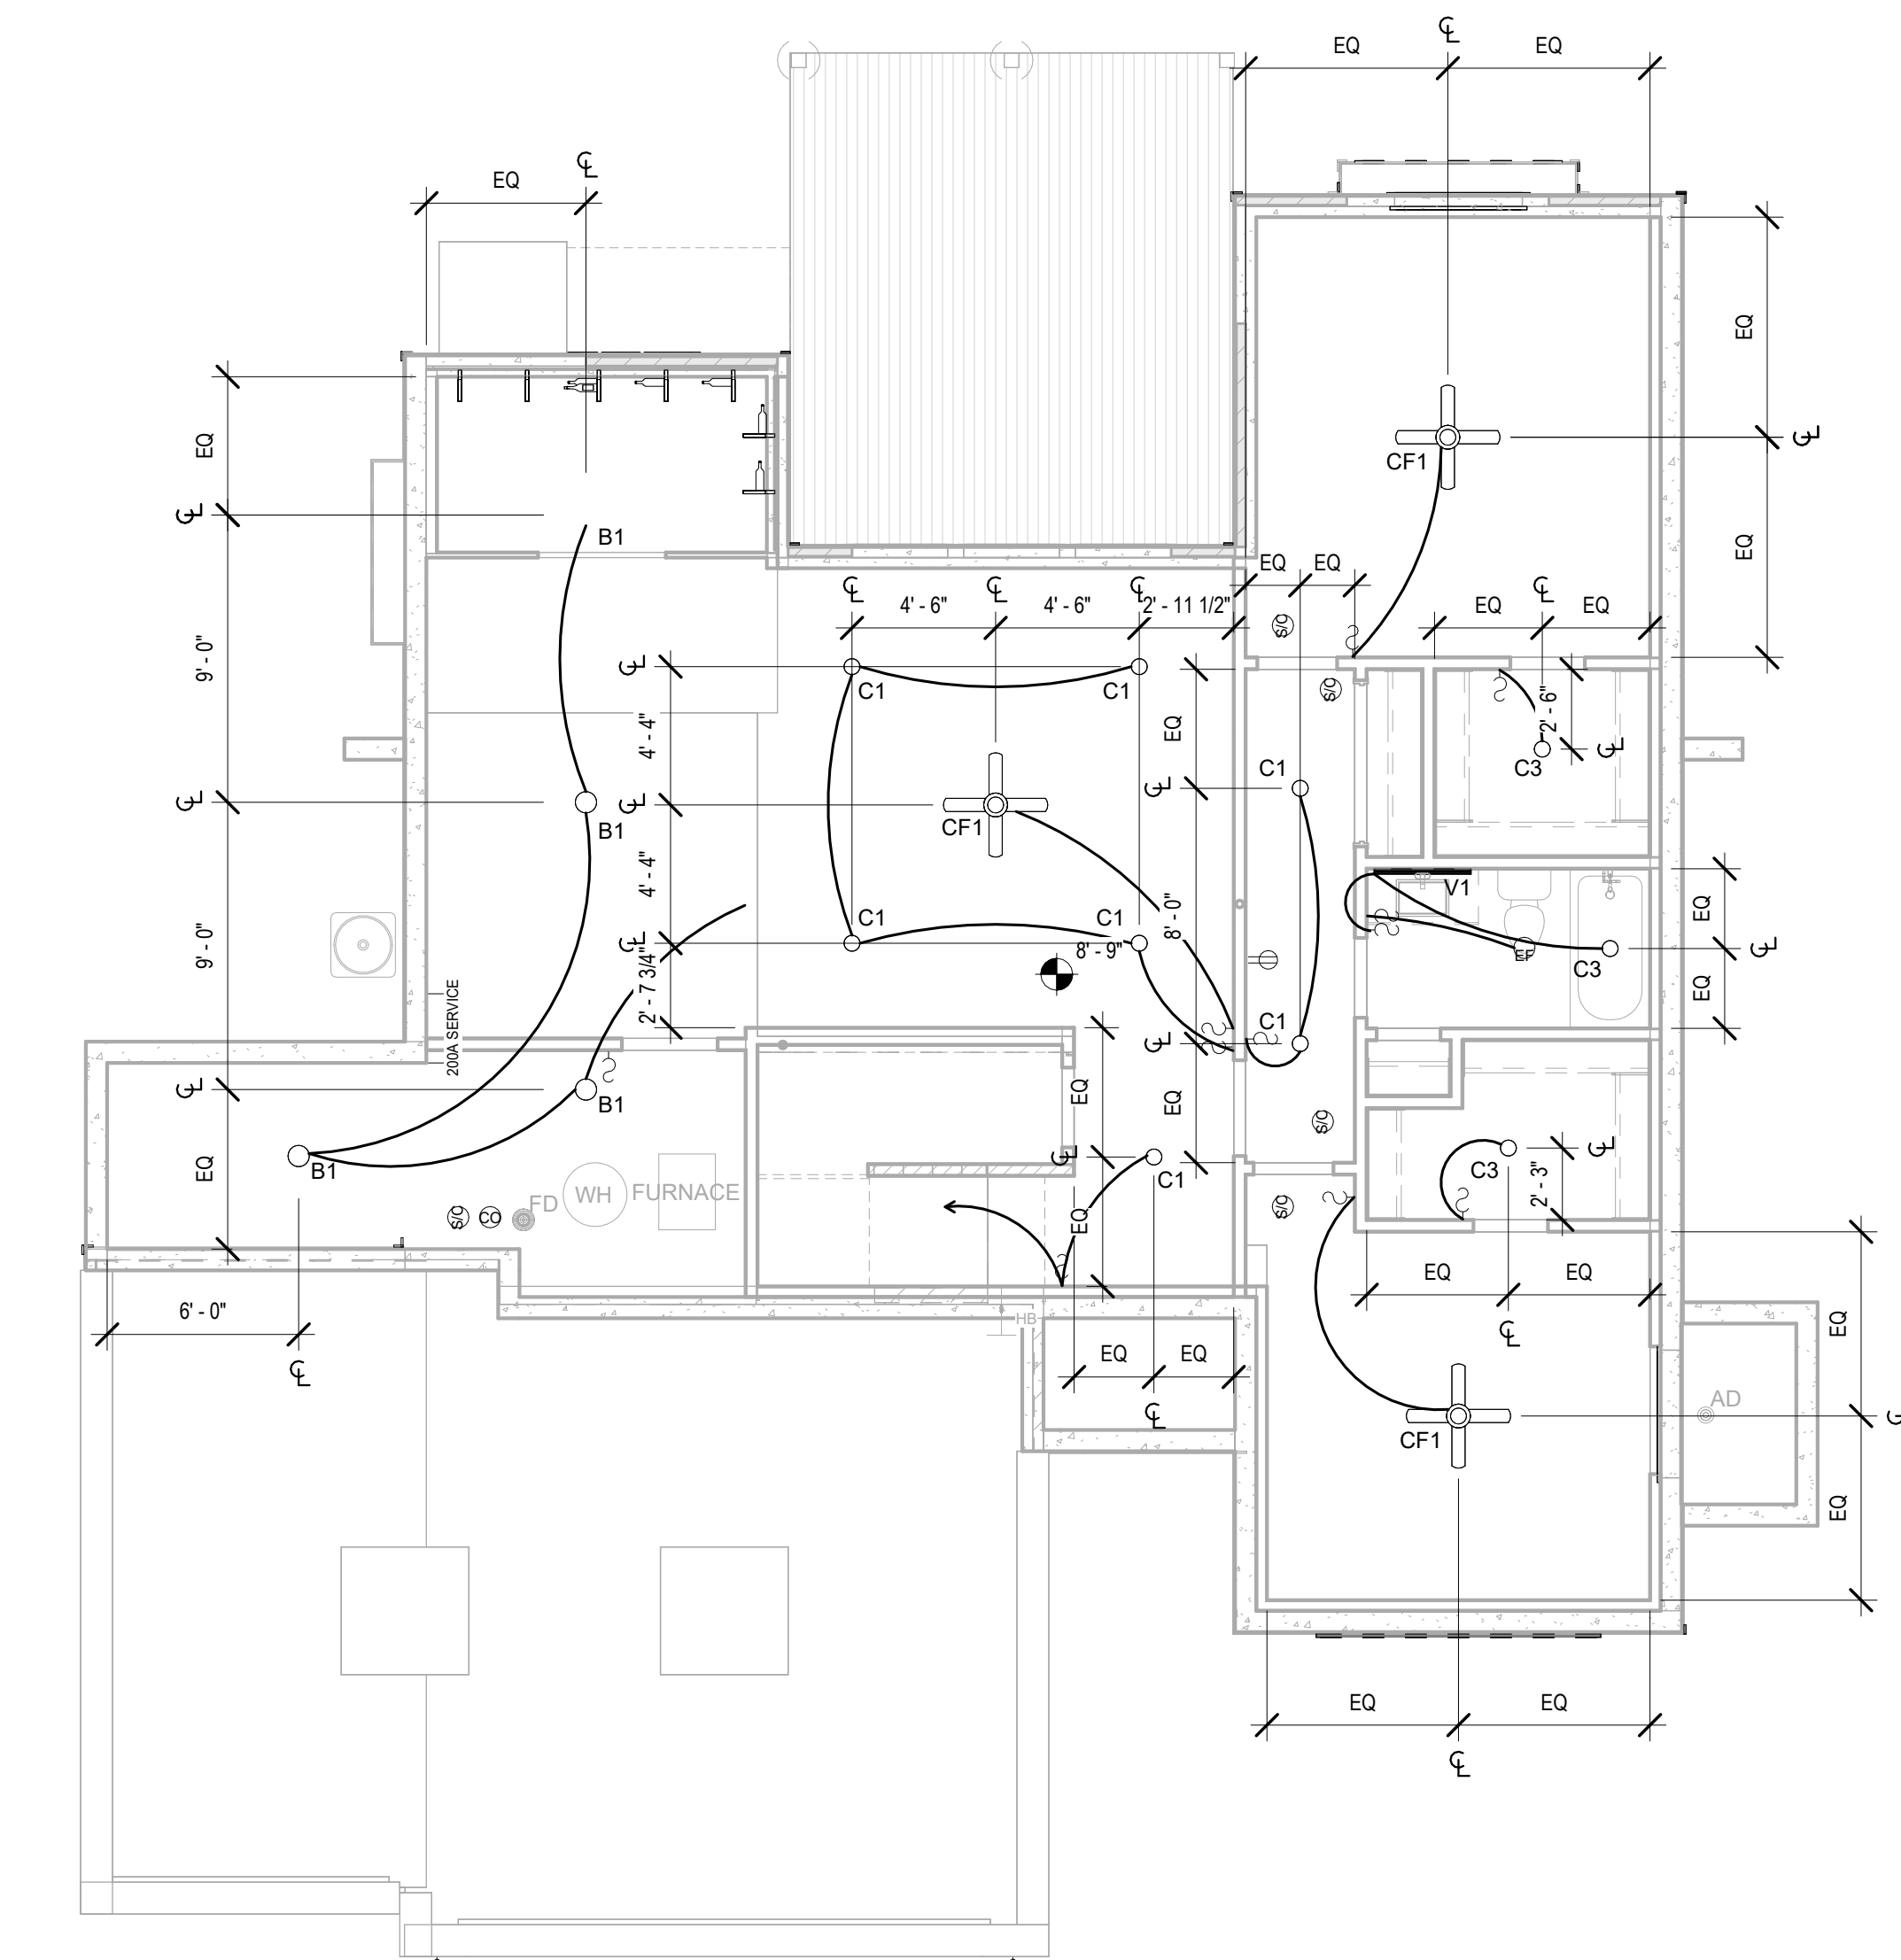

② RCP/Electrical - Basement  
3/16" = 1'-0"

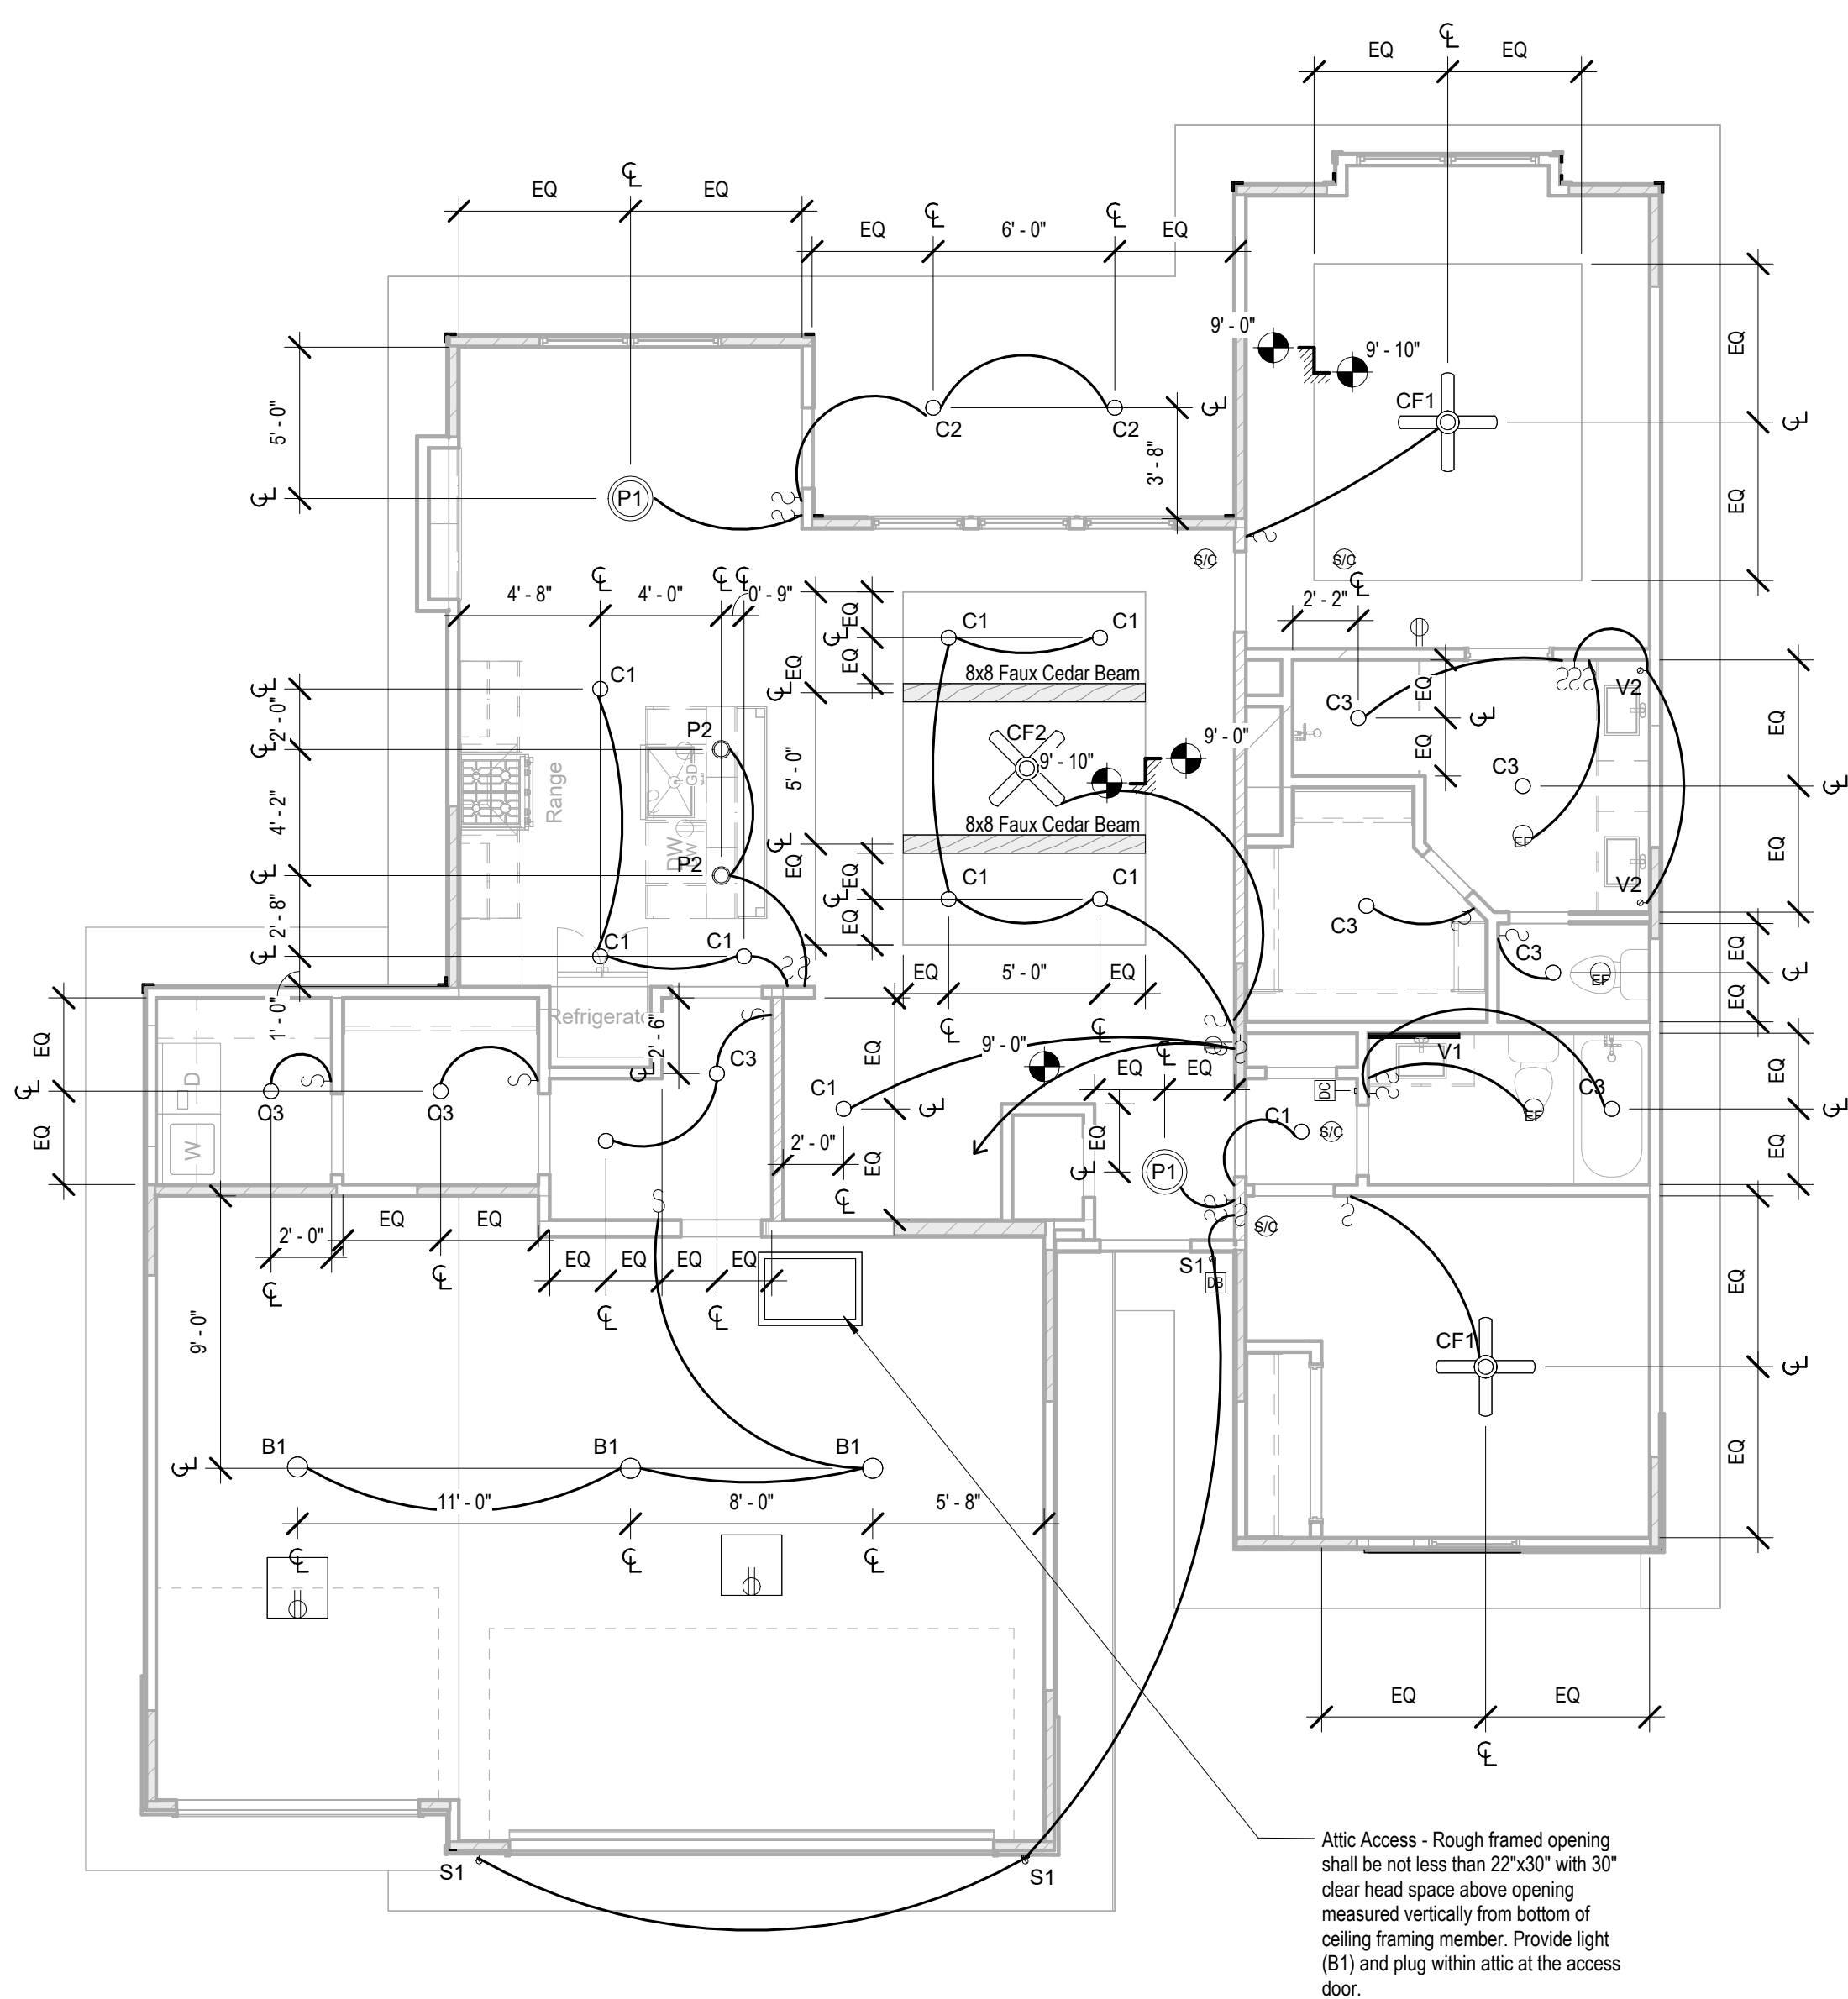

① RCP/Electrical Plan - Main Level  
3/16" = 1'-0"

architect:  
**Elevate Design + Build**  
350 SW Longview Blvd.  
Lee's Summit, MO 64081  
816.622.8826 voice  
www.elevatedesignbuildkc.com  
**2621 SW Hook Farm Lane**  
Lee's Summit, MO 64082

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS  
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR  
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

		Permit Set
Original Issue Date:		01/25/22
REVISIONS		
Number	DESCRIPTION	DATE

RCP/Electrical Plan

A2

# Greystone - Hook Farms - Lot 24

architect:  
**Elevate Design + Build**  
350 SW Longview Blvd.  
Lee's Summit, MO 64081  
816.622.8826 voice  
www.elevatedesignbuildkc.com  
2621 SW Hook Farm Lane  
Lee's Summit, MO 64082


UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS  
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR  
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

Original Issue Date:		Permit Set
REVISIONS		01/25/22
Number	DESCRIPTION	DATE


Elevations

# A3.D


Project No. HF 024

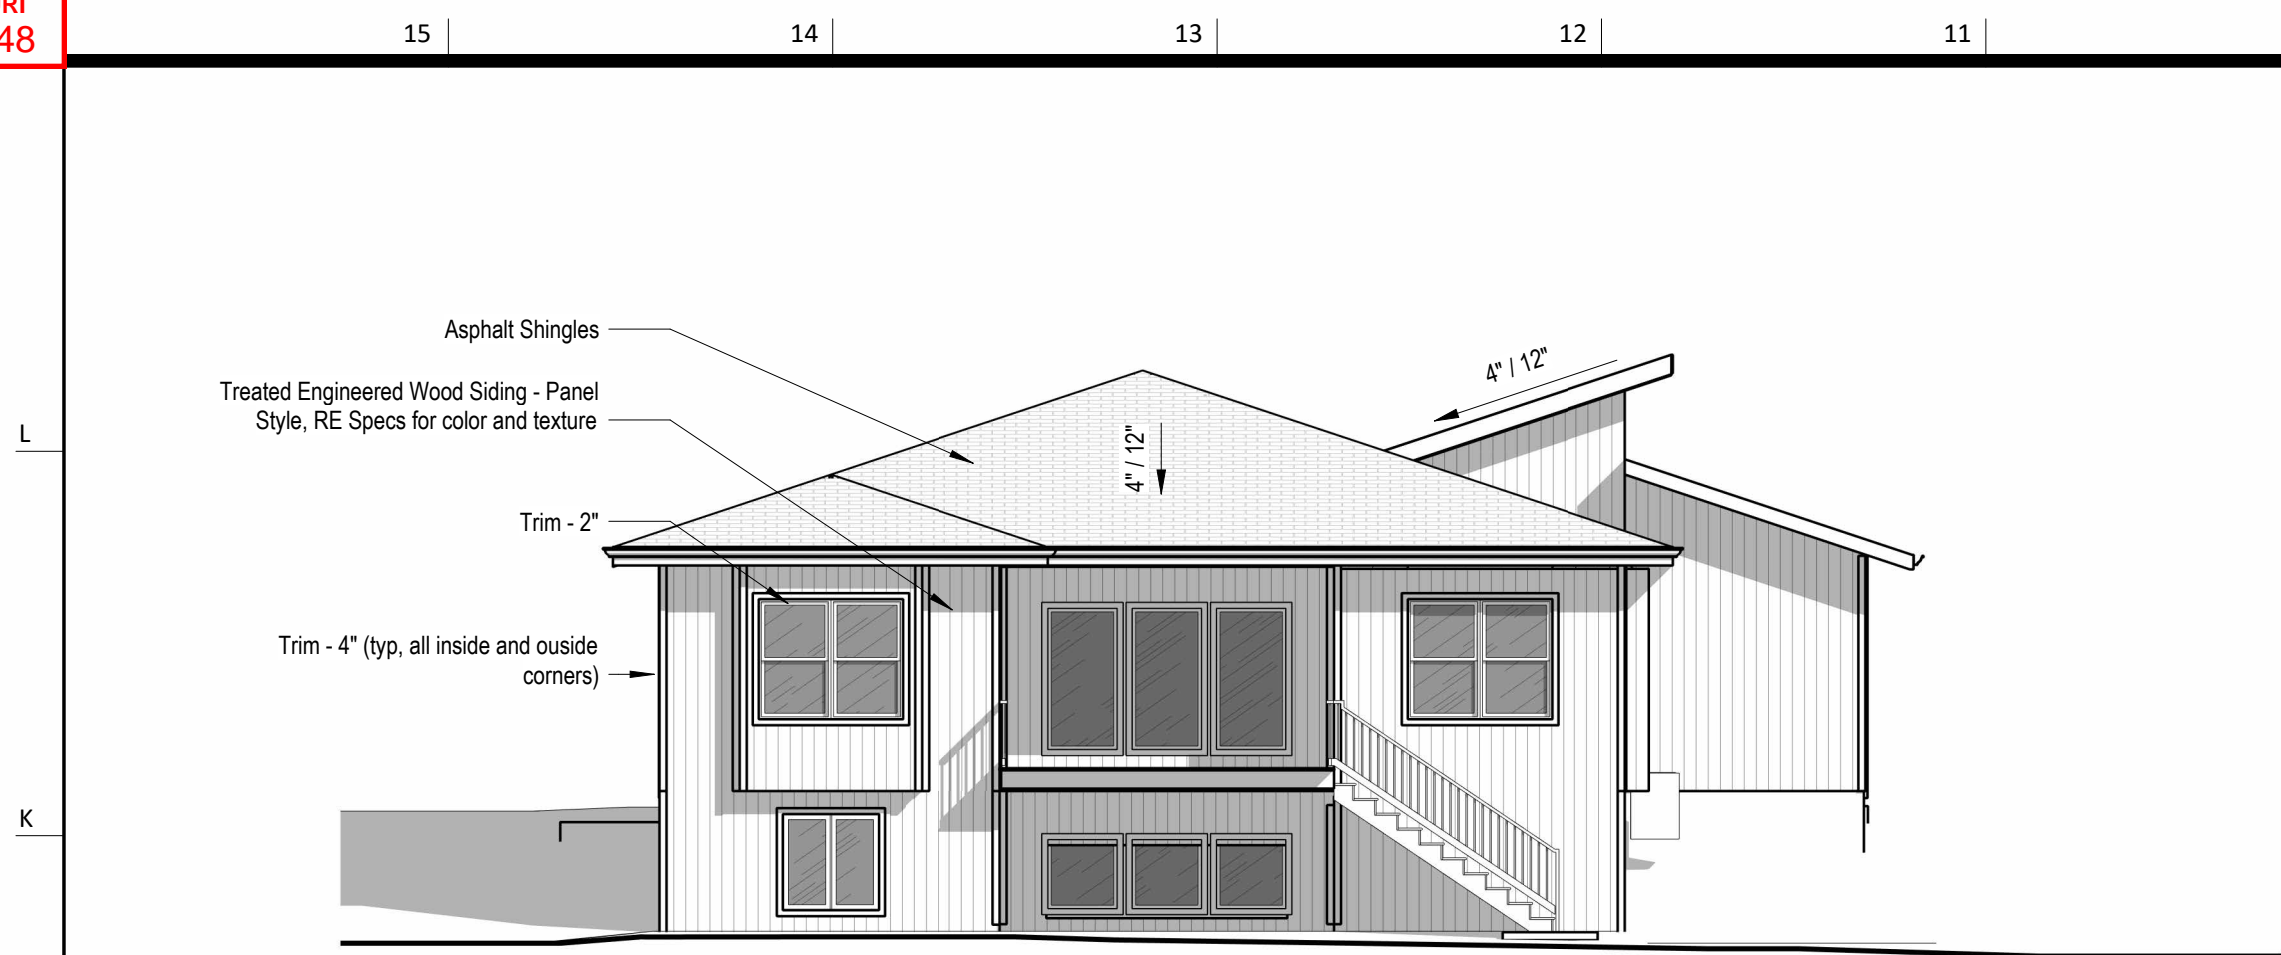


④ Back Elevation  
1/8" = 1'-0"

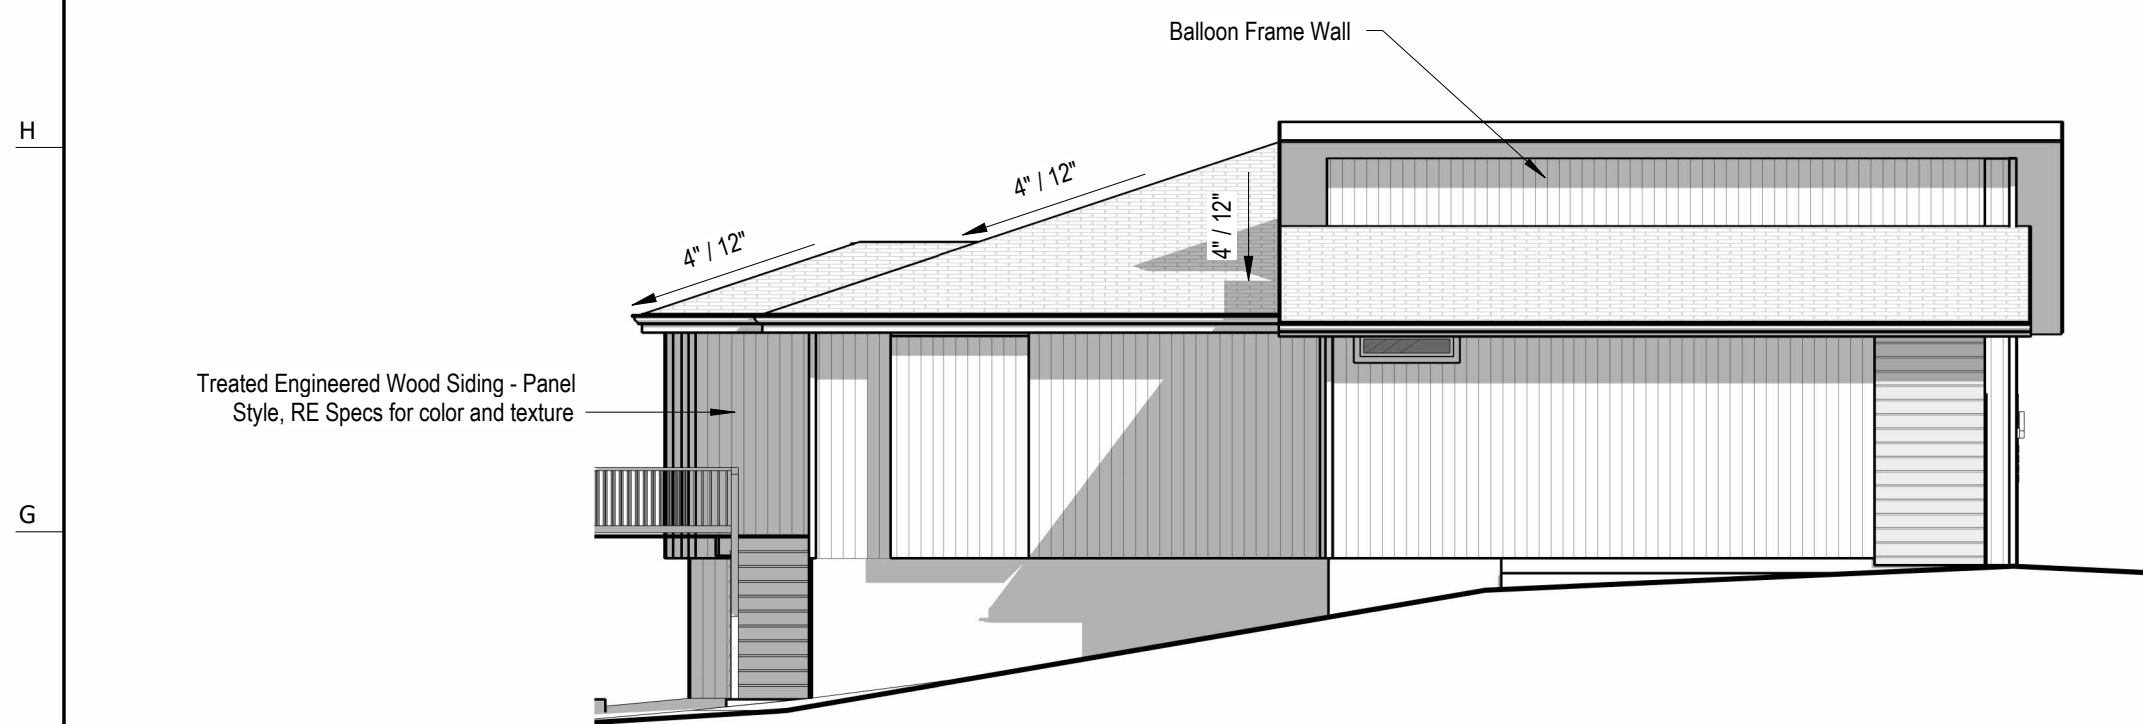


③ Right Elevation  
1/8" = 1'-0"

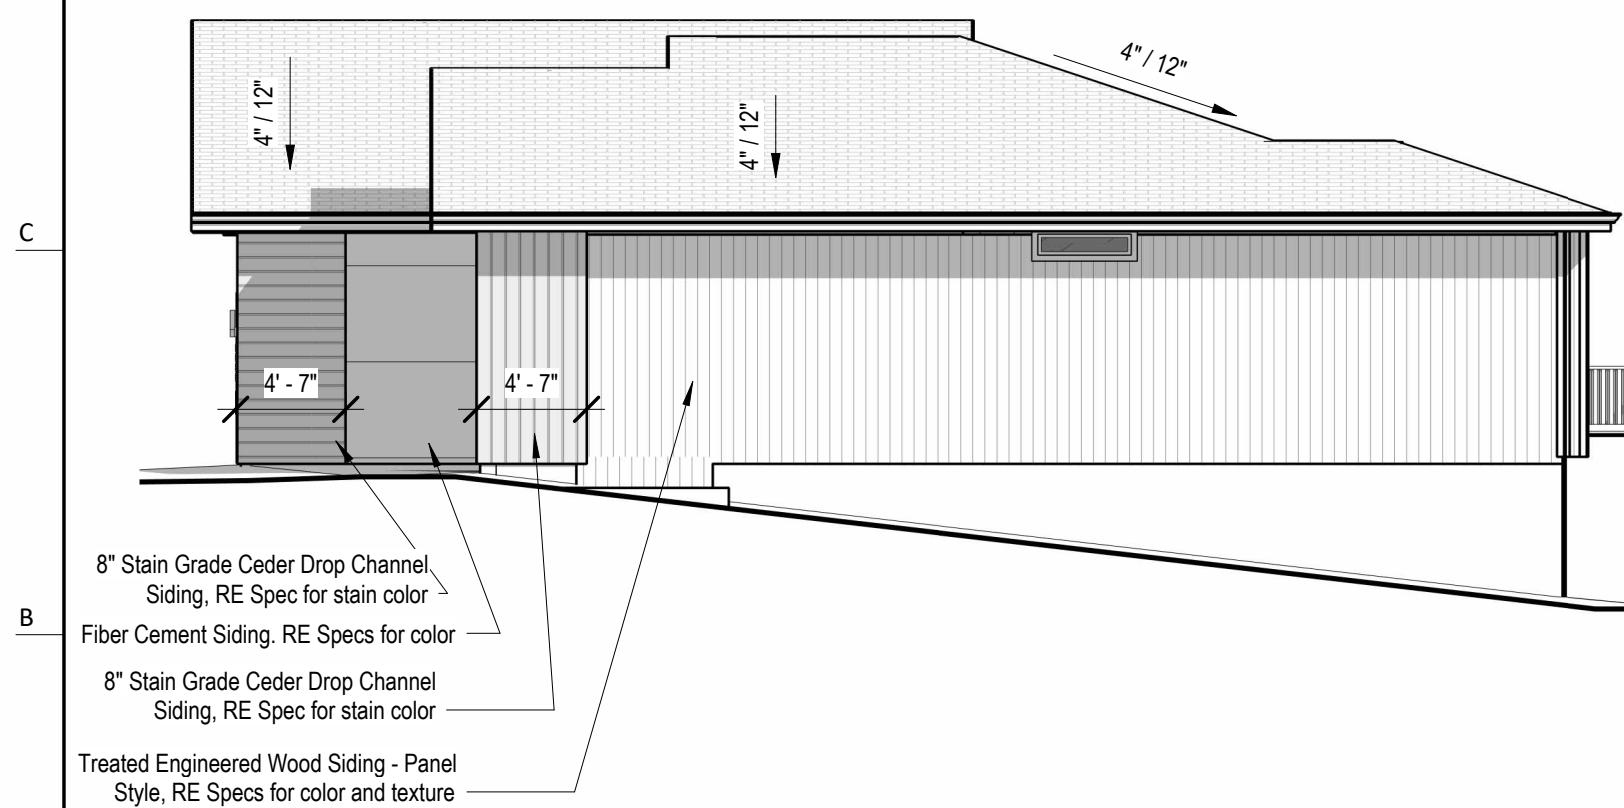

② Left Elevation  
1/8" = 1'-0"

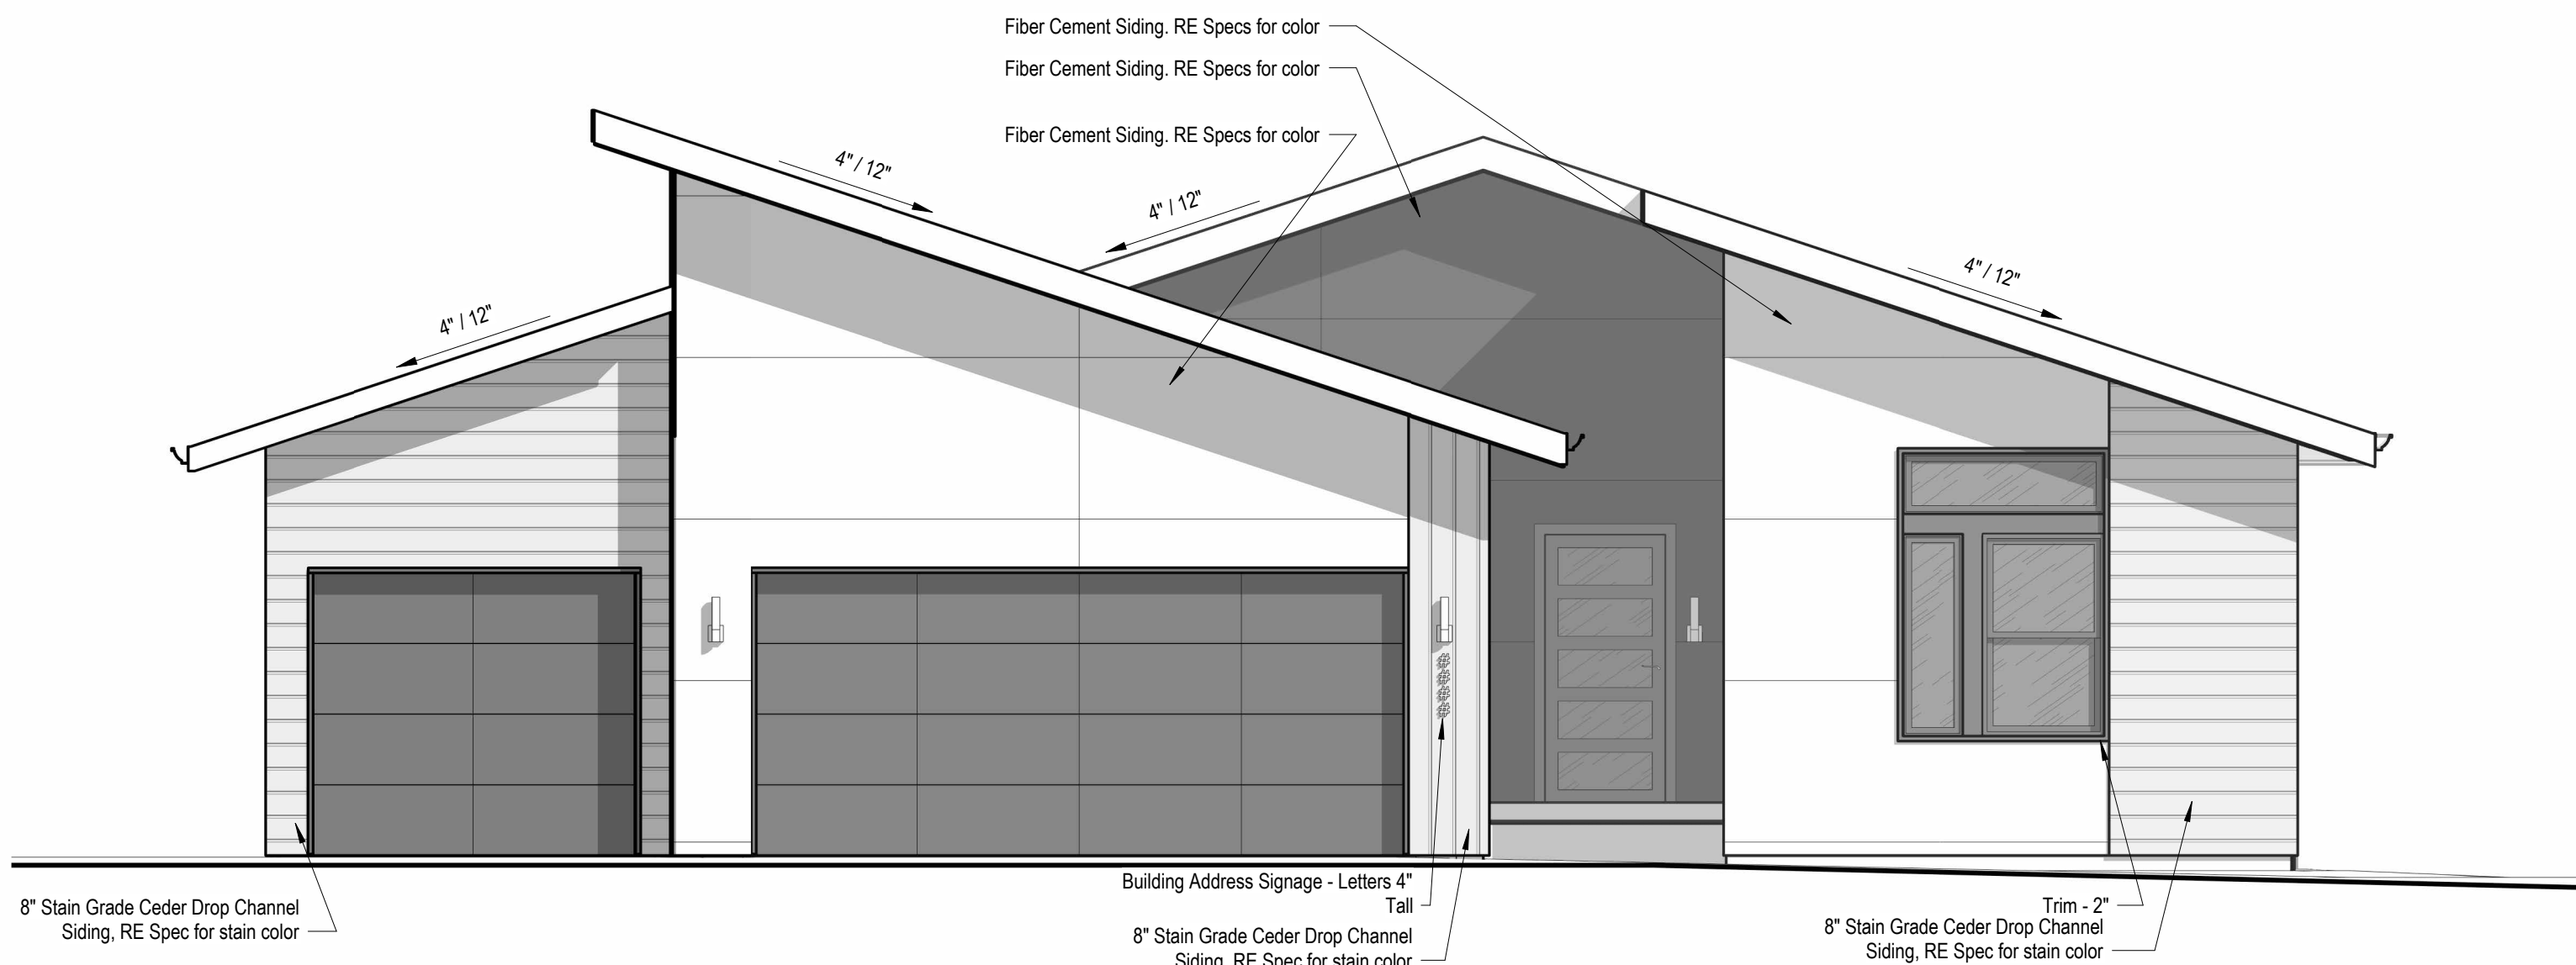

① Front Elevation - Shed  
1/4" = 1'-0"

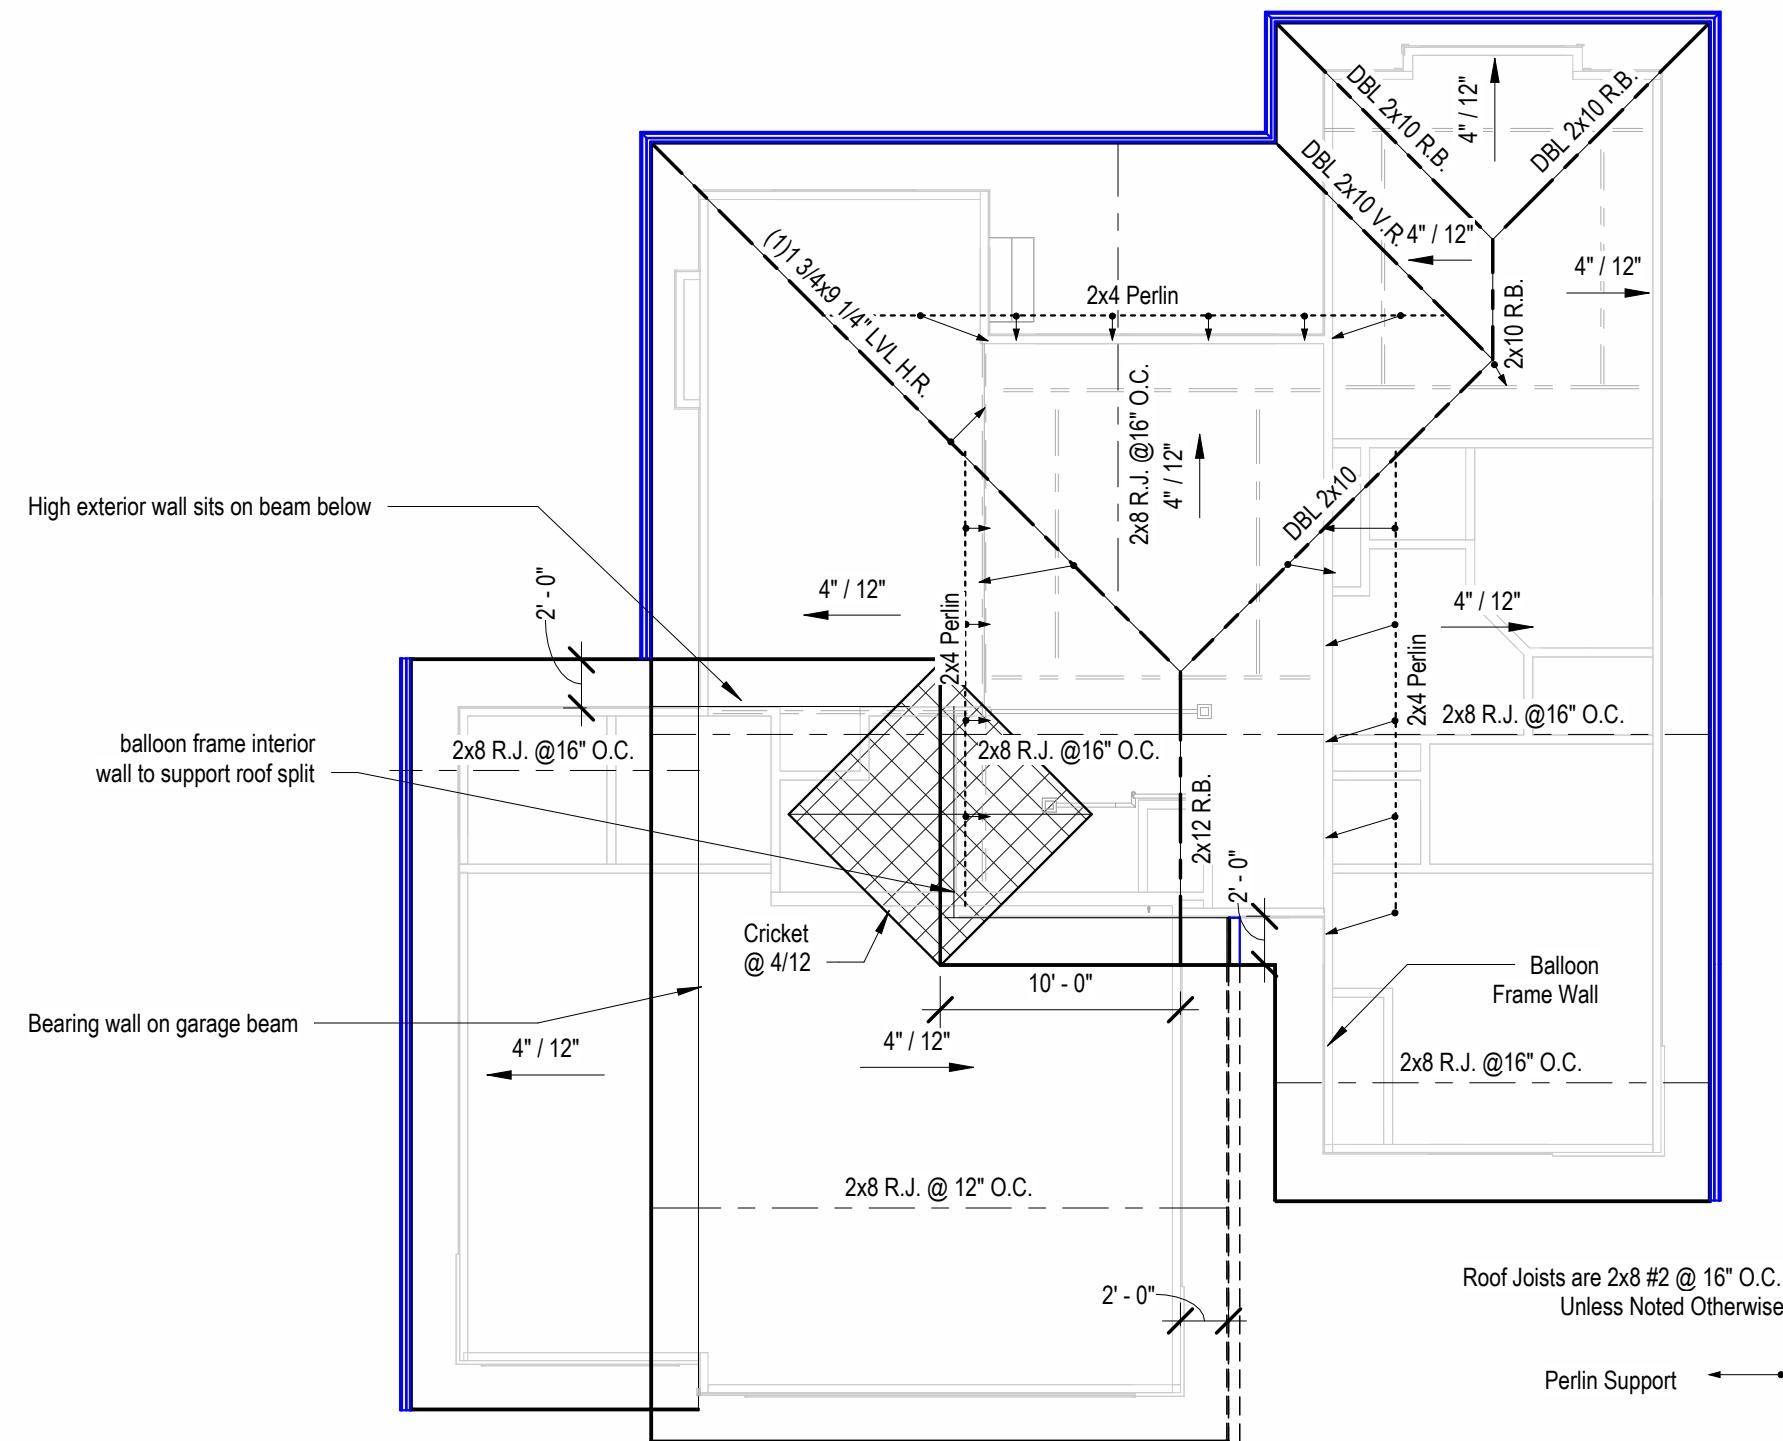

⑤ Roof Framing  
1/8" = 1'-0"



# Greystone - Hook Farms - Lot 24

architect:  
**Elevate Design + Build**  
350 SW Longview Blvd.  
Lee's Summit, MO 64081  
816.622.8826 voice  
www.elevatedesignbuildllc.com  
2621 SW Hook Farm Lane  
Lee's Summit, MO 64082

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS  
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR  
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

Original Issue Date: 01/25/22  
Permit Set


REVISIONS

Number	DESCRIPTION	DATE
--------	-------------	------


Building Sections

## A4.D

Project No. HF 024

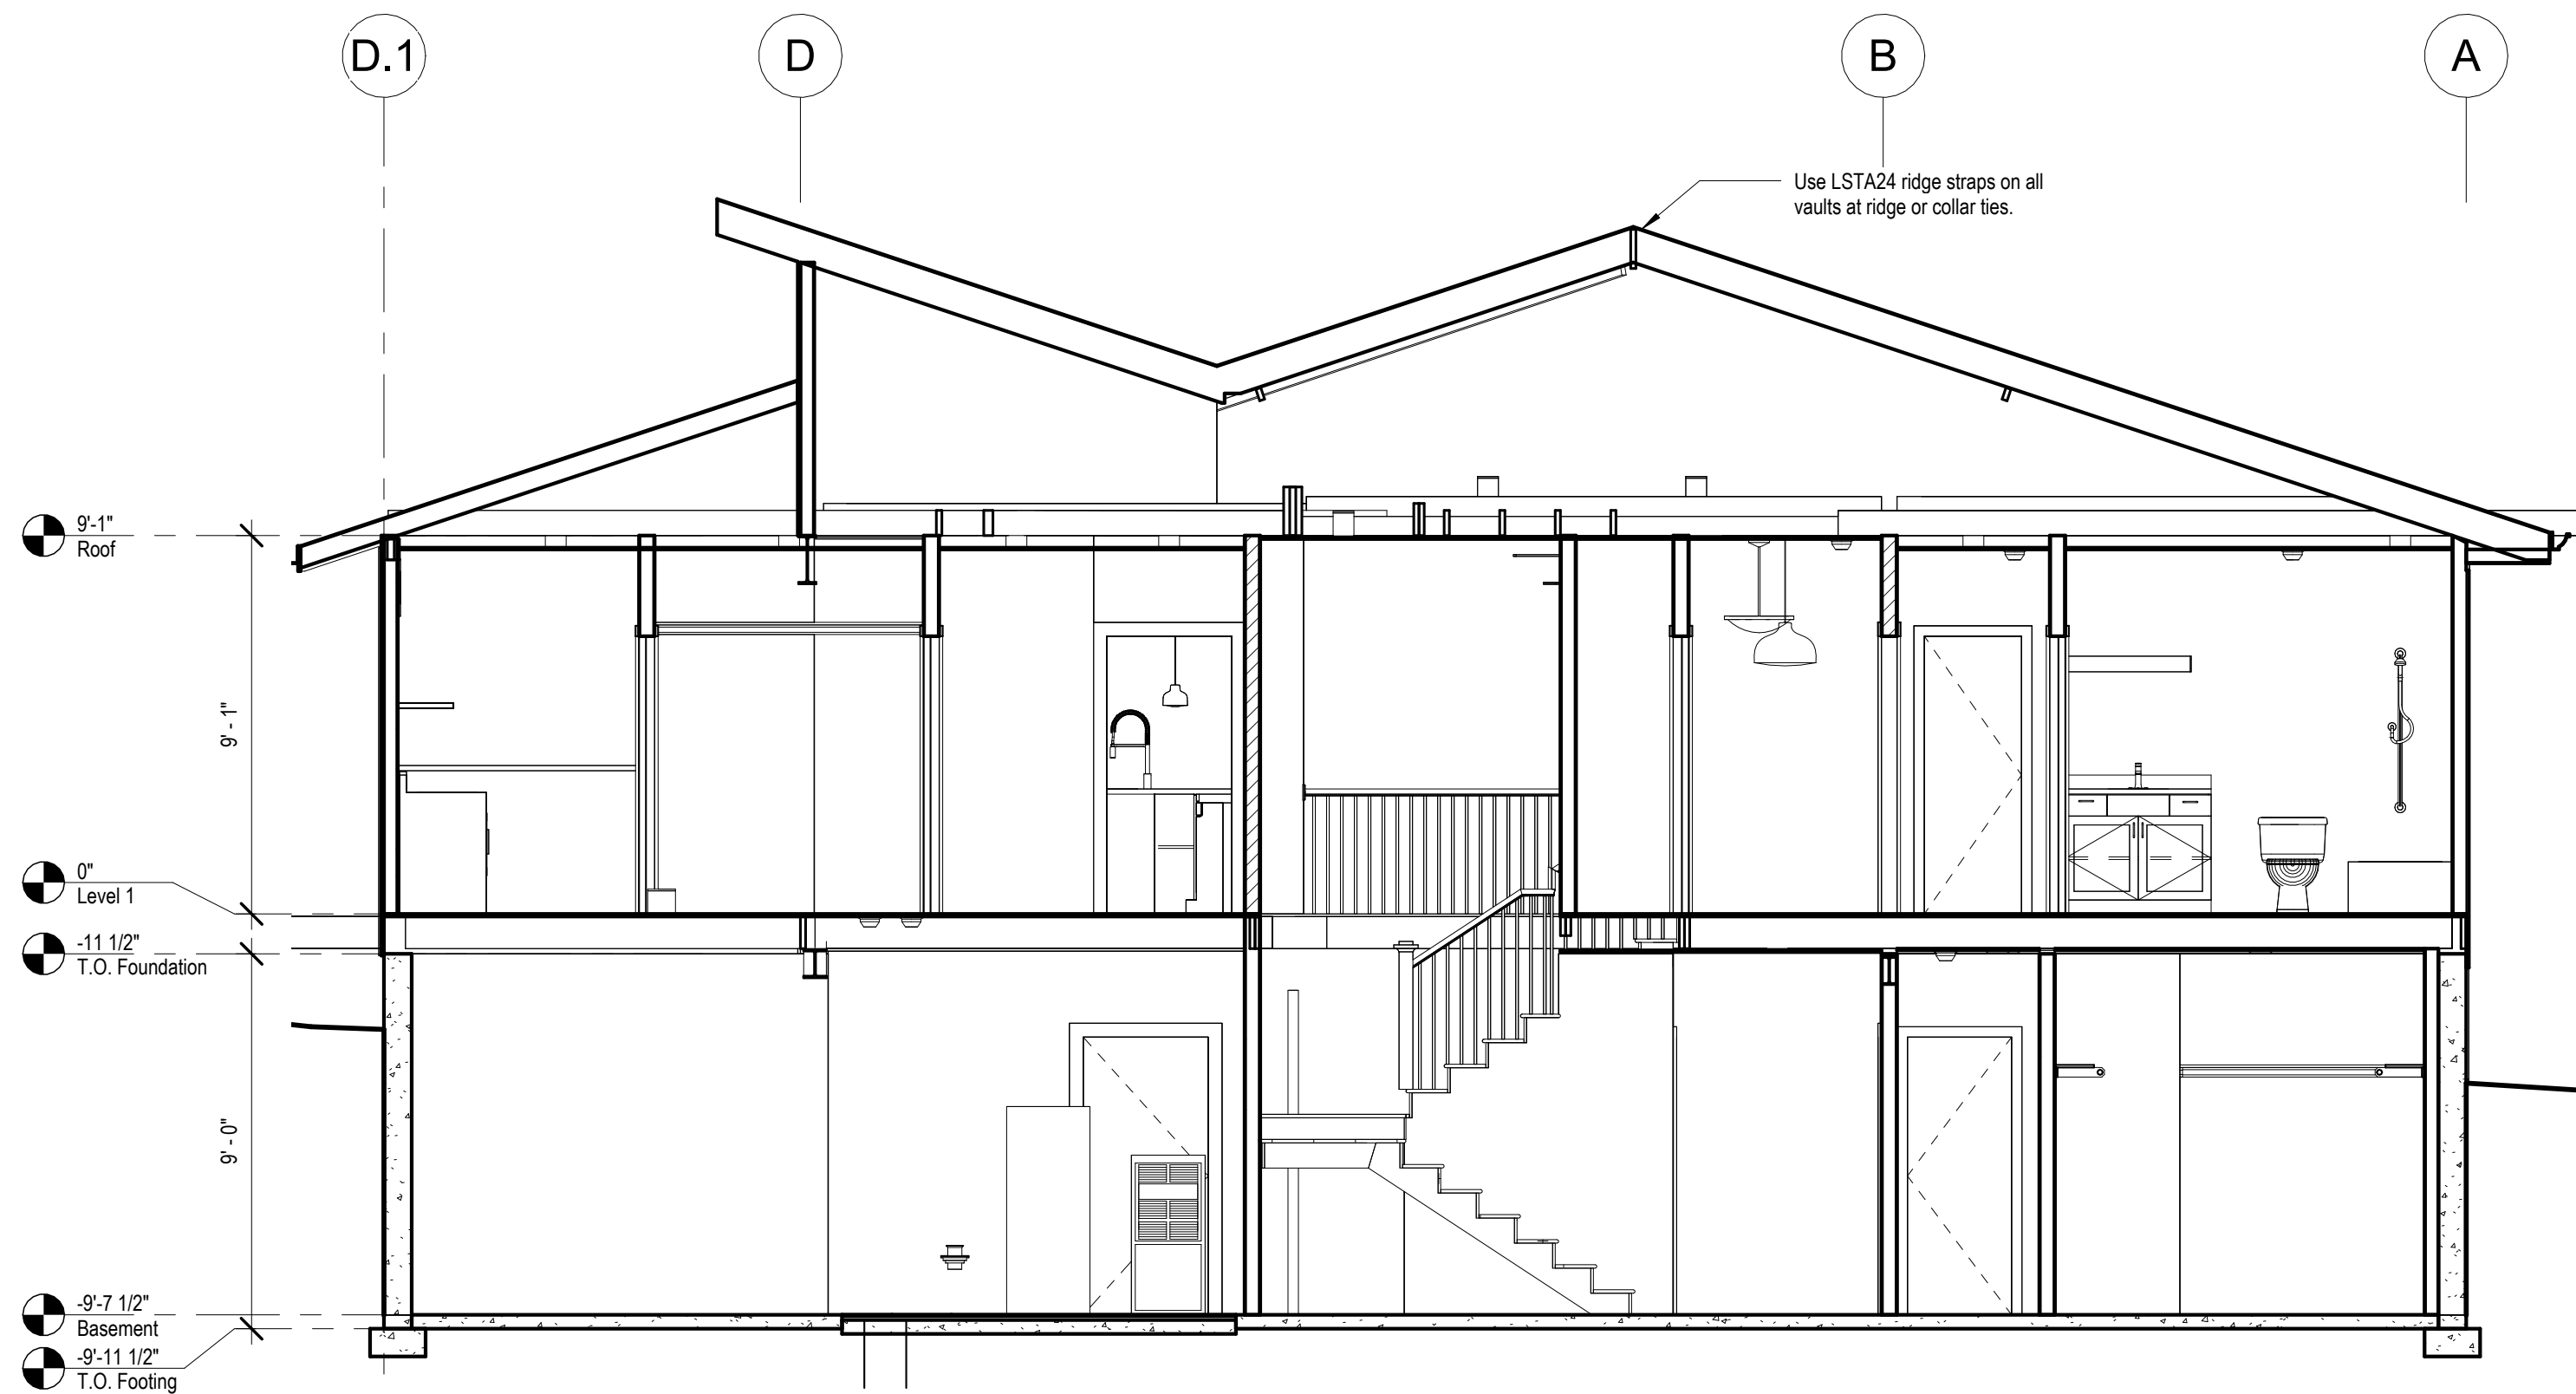

② Building Section  
1/4" = 1'-0"

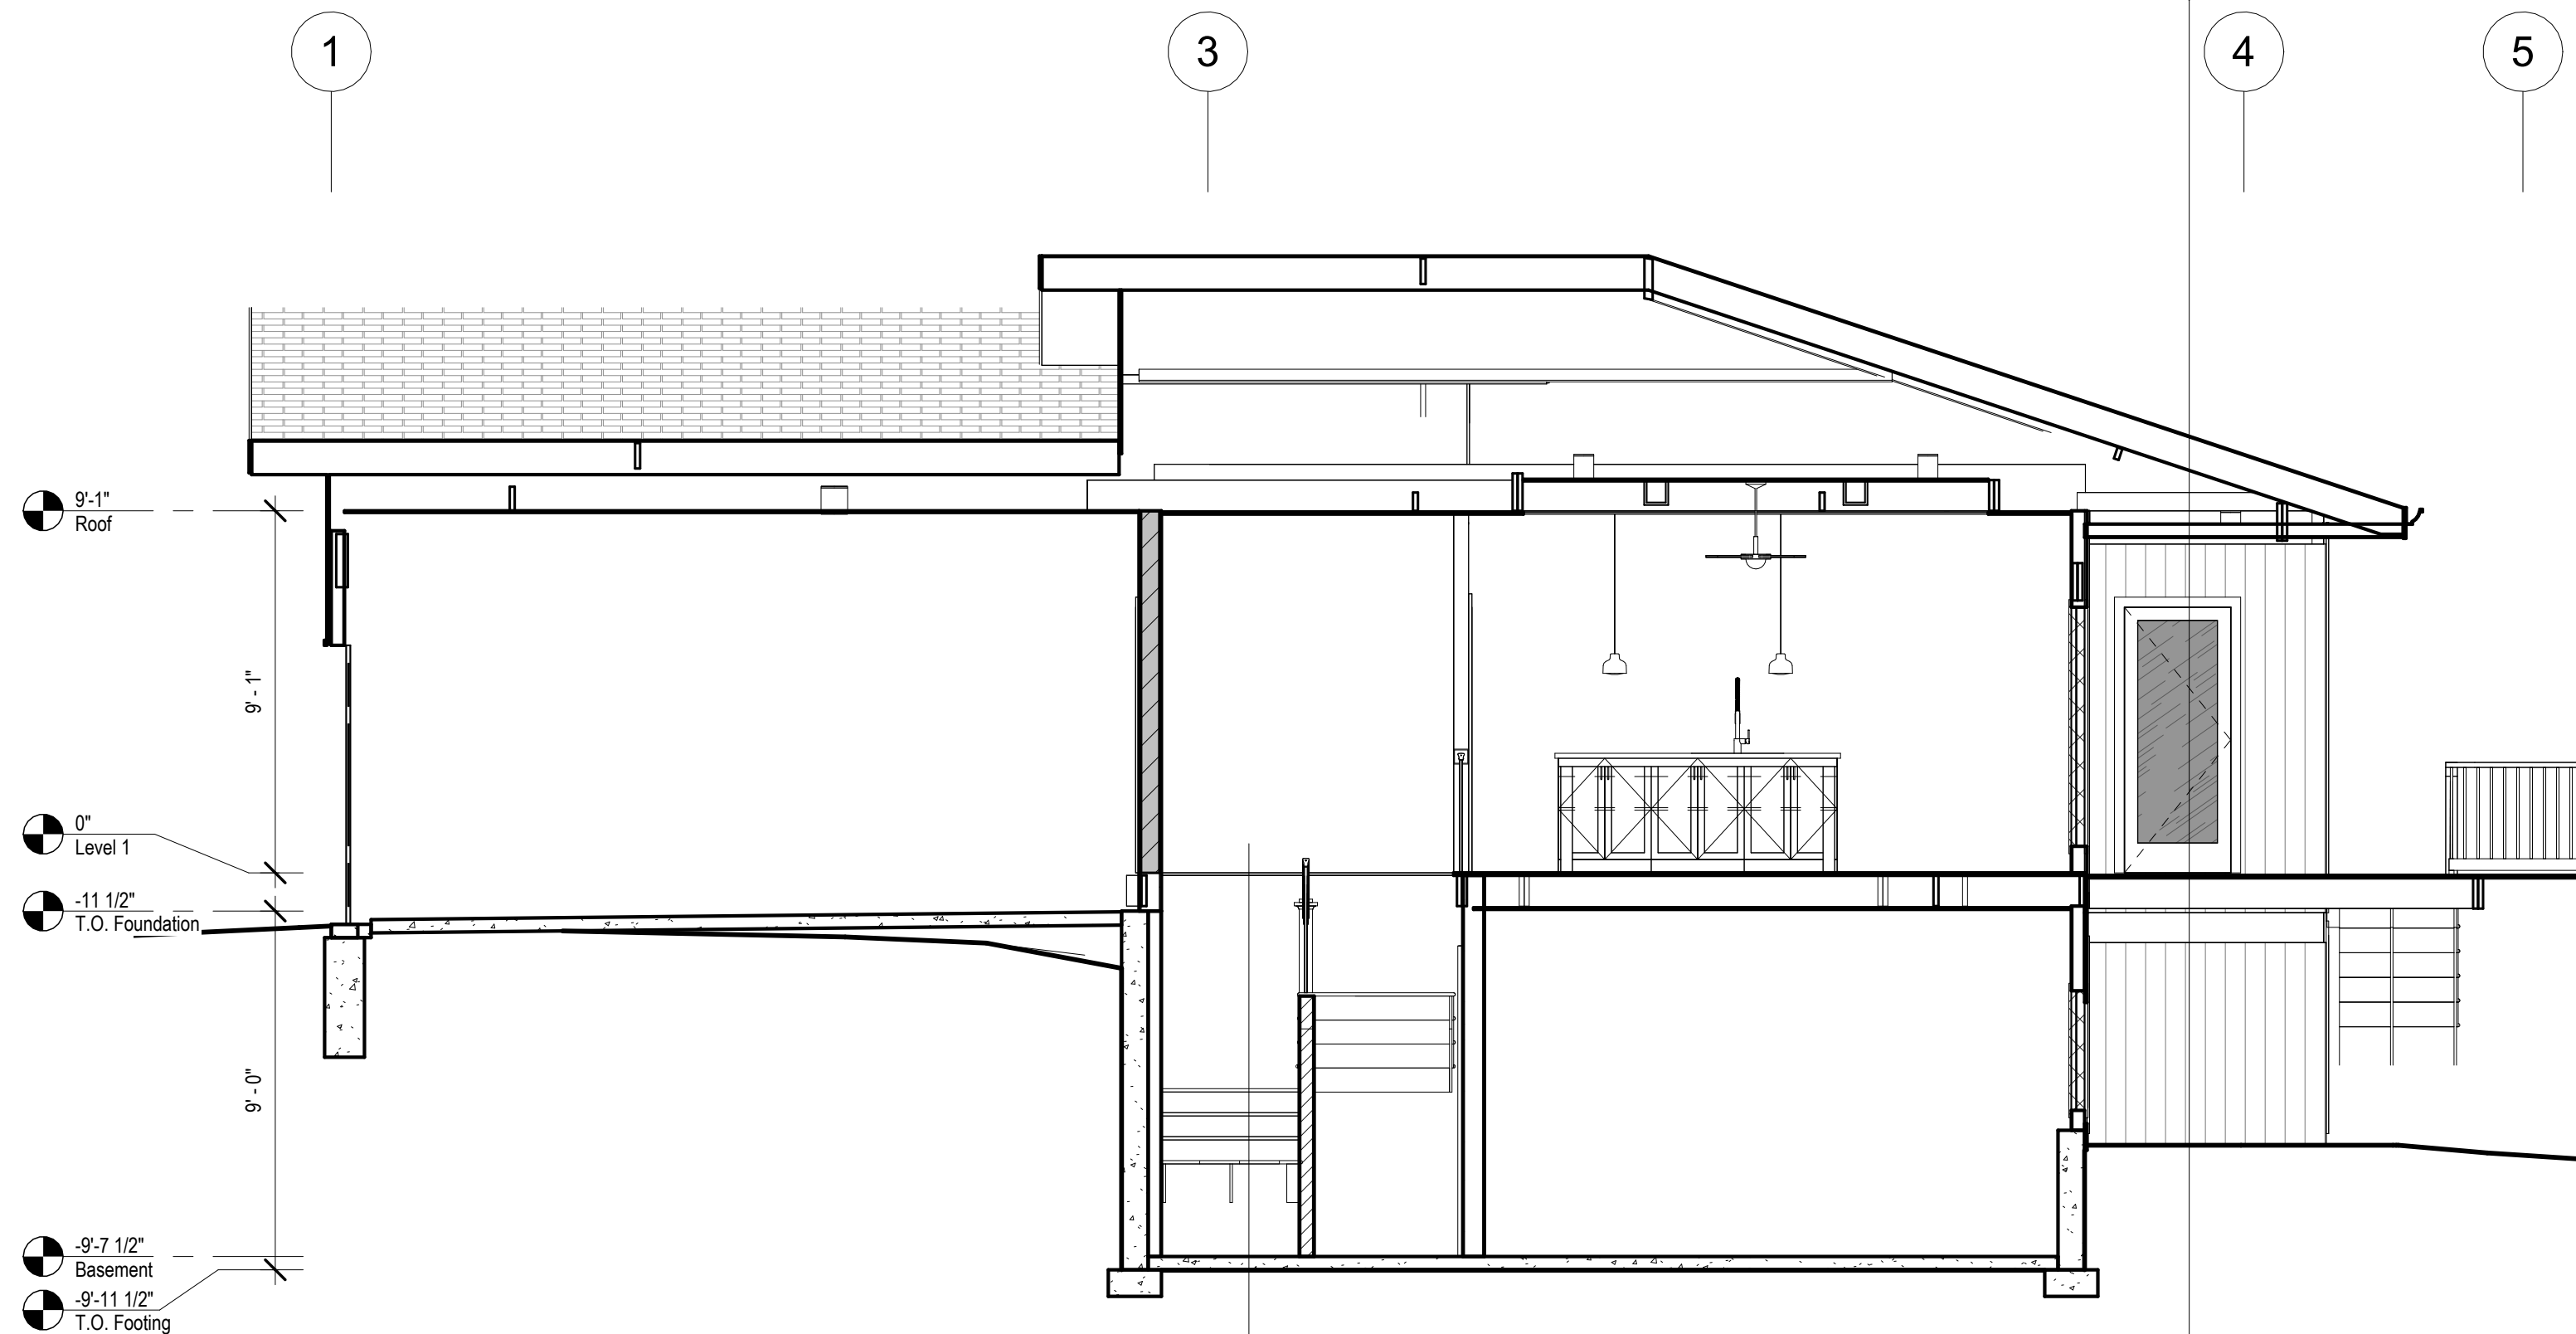

① Building Section  
1/4" = 1'-0"



# Greystone - Hook Farms - Lot 24

architect:  
**Elevate Design + Build**  
350 SW Longview Blvd.  
Lee's Summit, MO 64081  
816.622.8826 voice  
www.elevatedesignbuildllc.com  
**2621 SW Hook Farm Lane**  
Lee's Summit, MO 64082

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS  
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR  
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

Original Issue Date: 01/25/22  
Permit Set


REVISIONS

Number	DESCRIPTION	DATE
--------	-------------	------



Details

# A5

Project No. HF 024

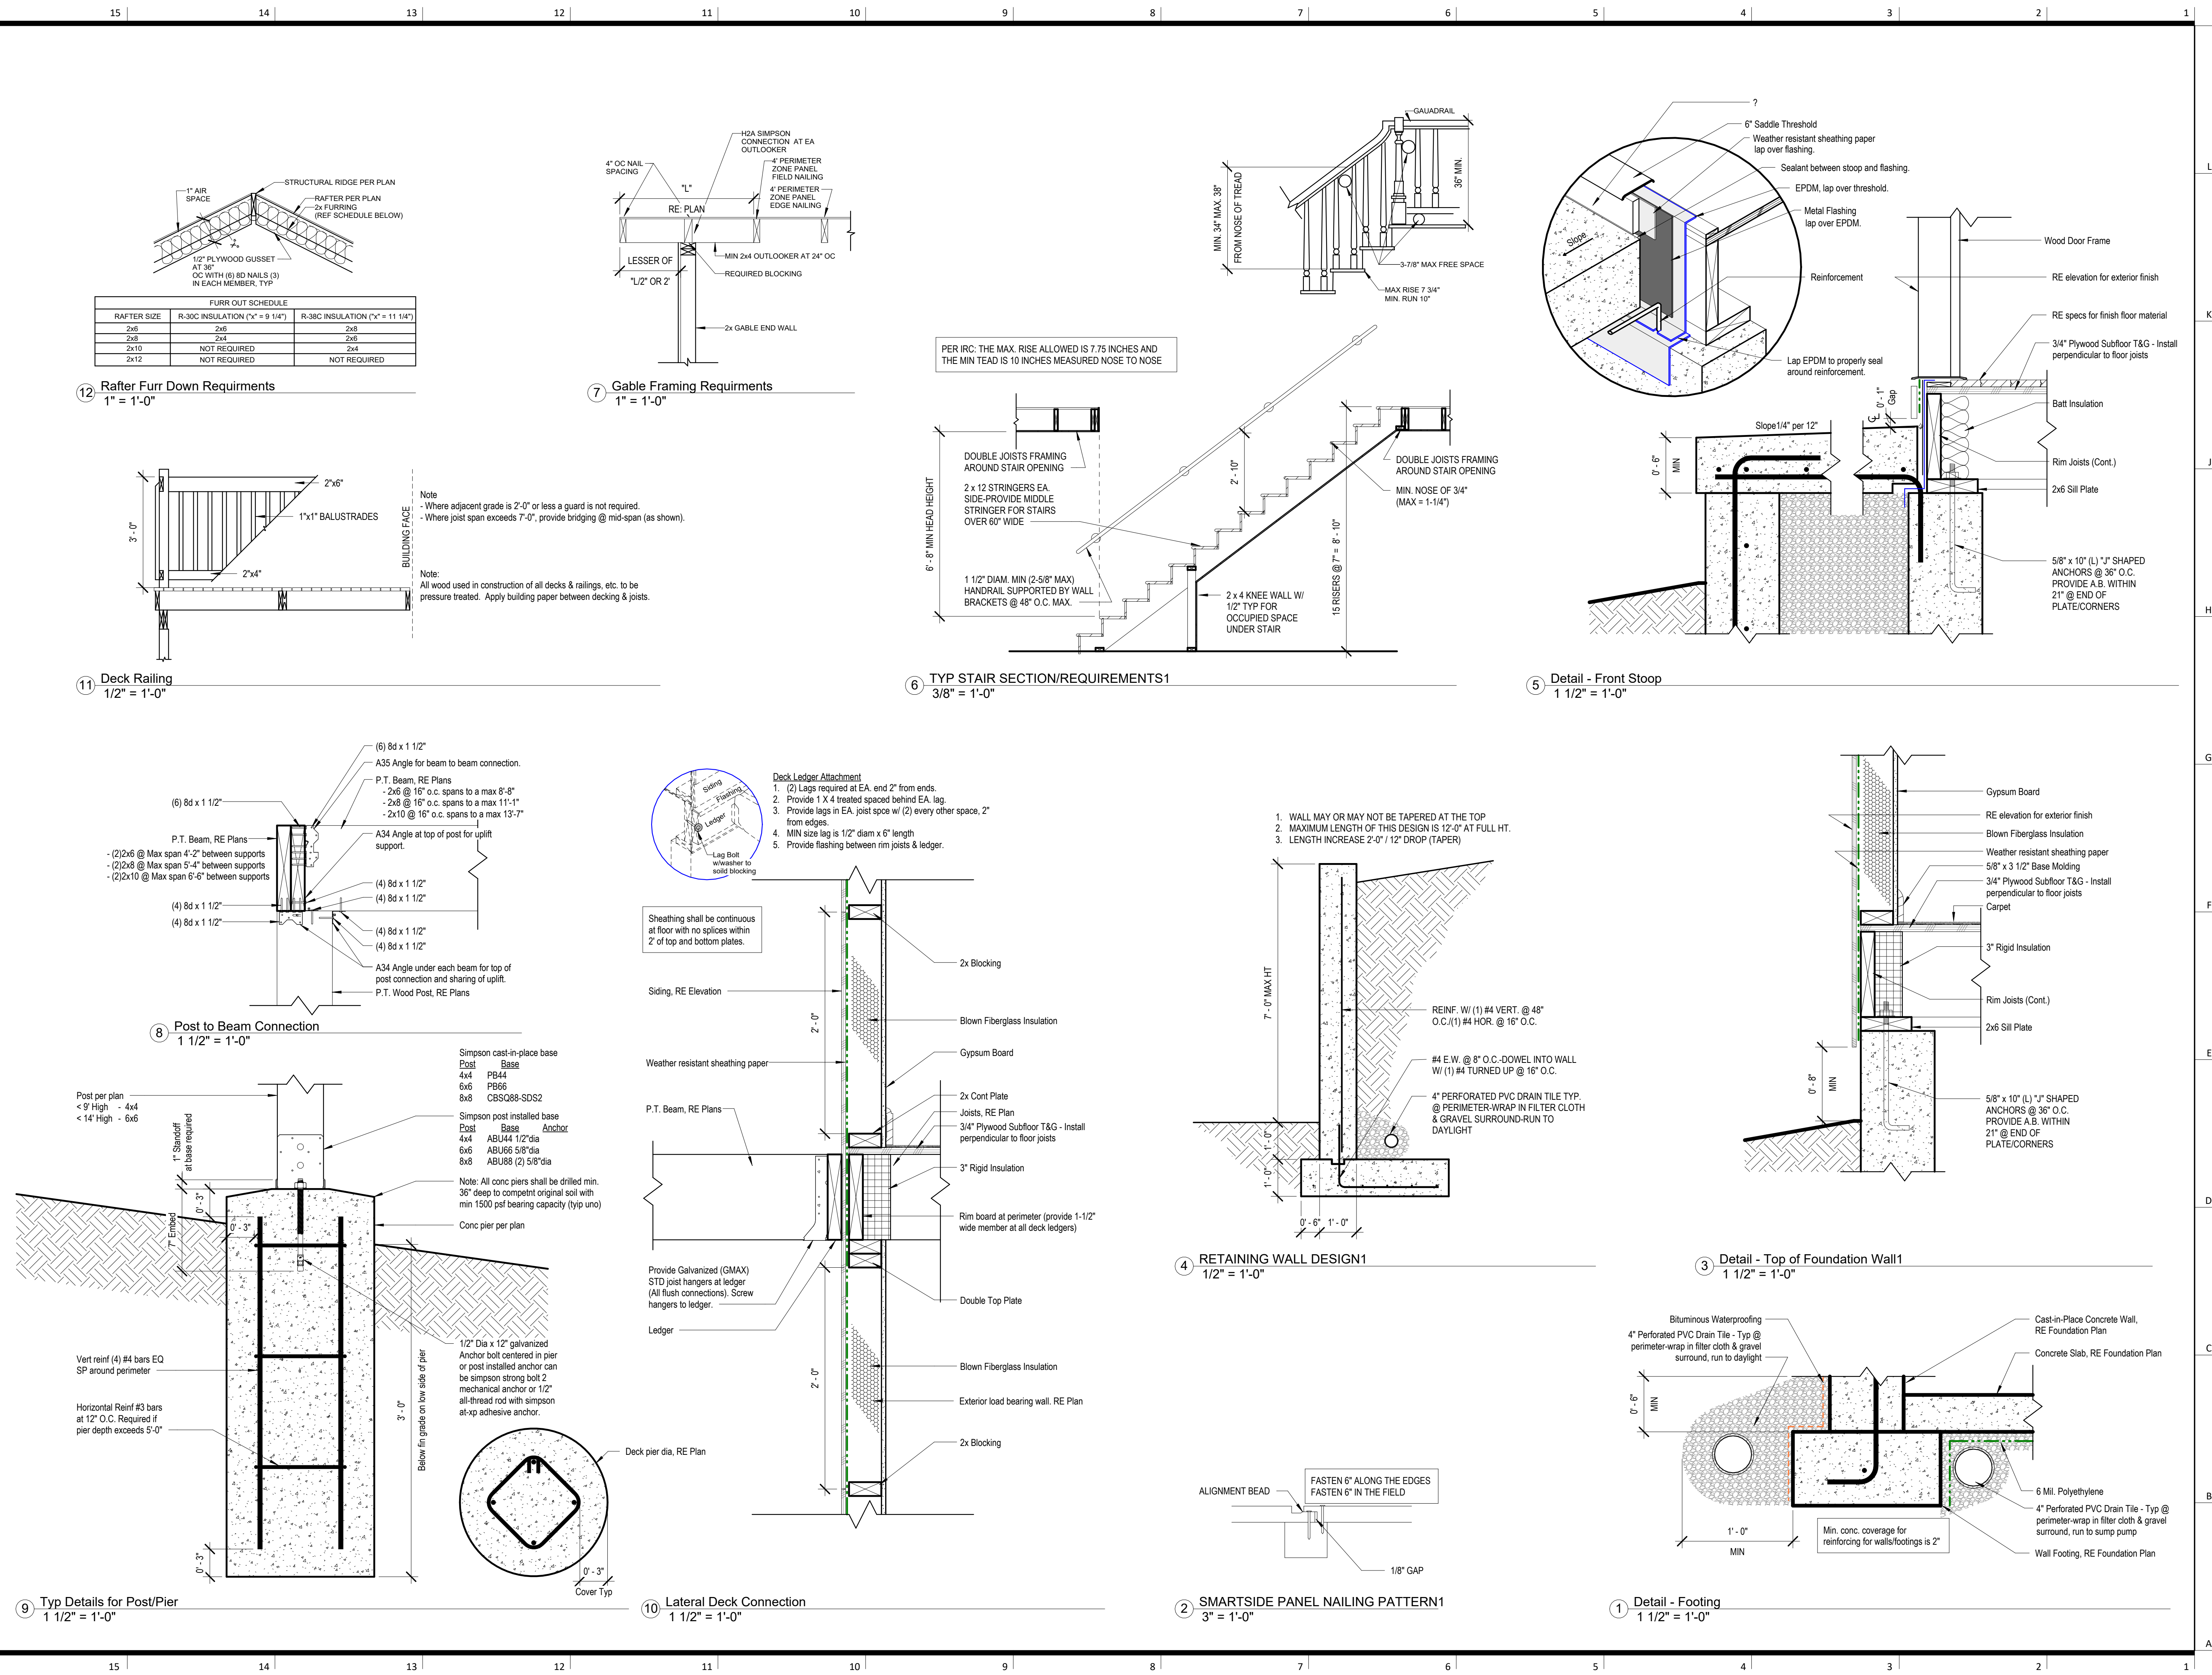




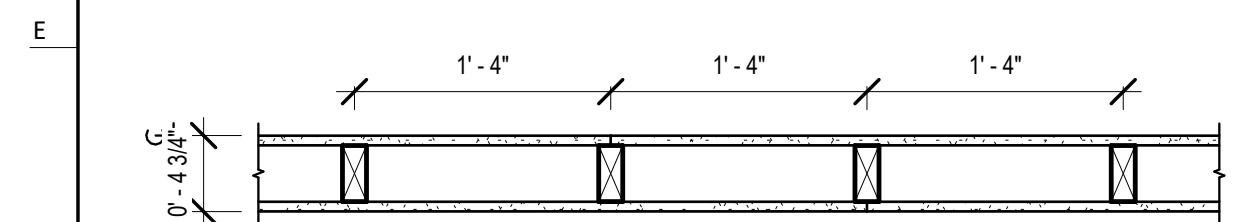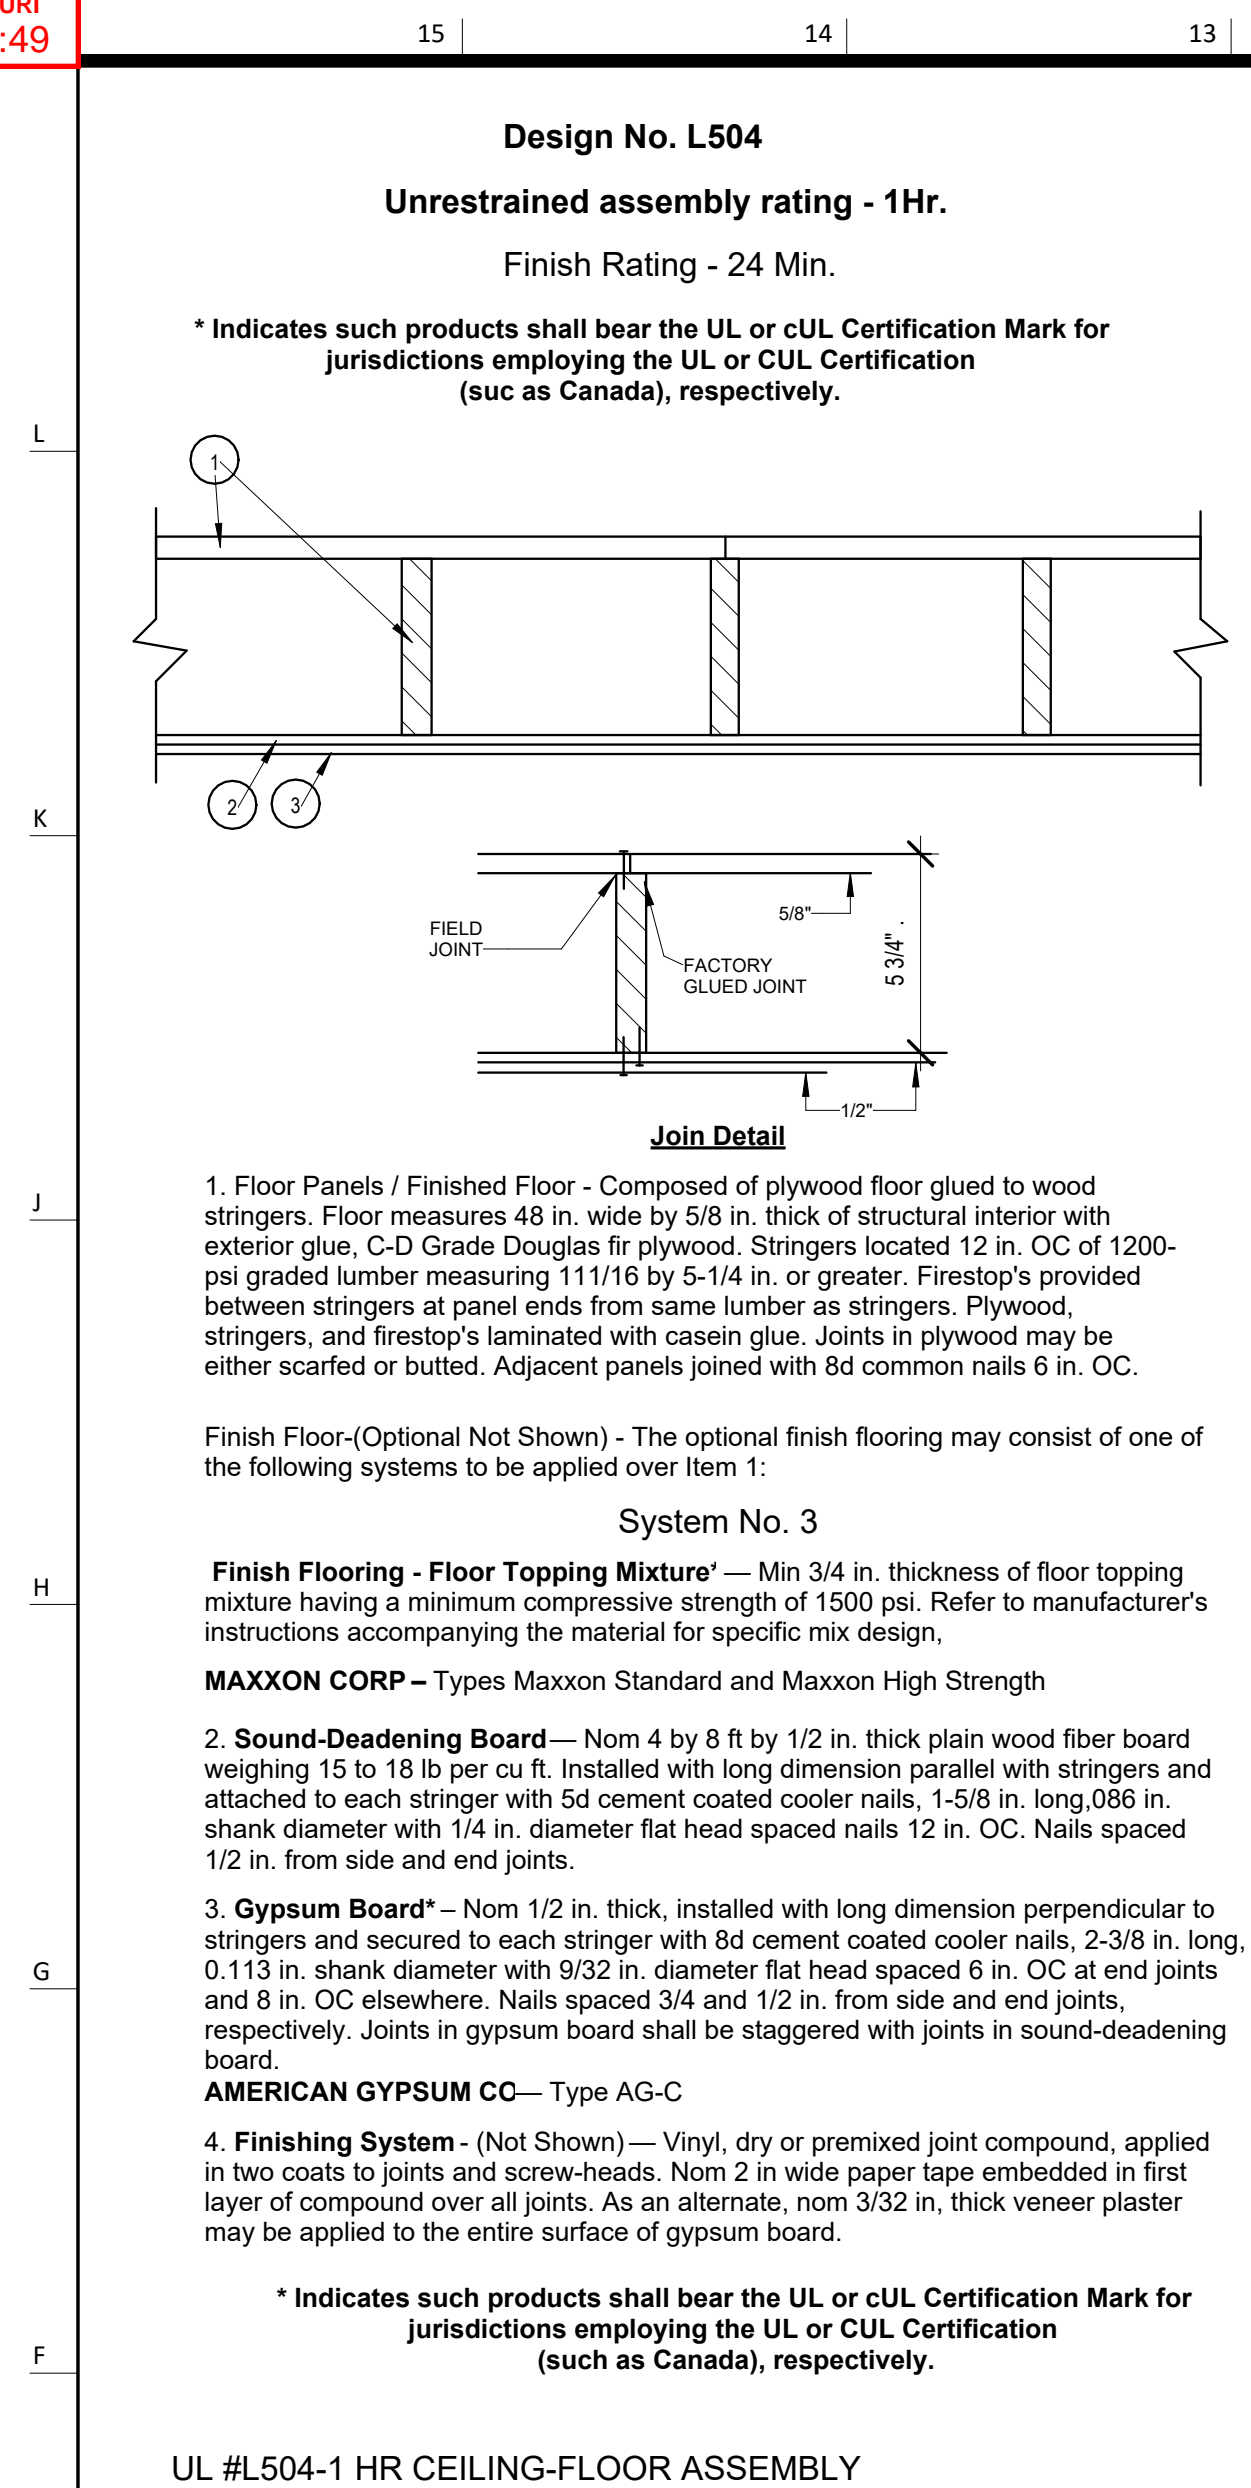


D	<b>ASSEMBLY OPTIONS:</b>	
	<b>GYPSUM BOARD:</b>	ONE LAYER 5/8" THICK GYPSUM BOARD (UL TYPE ULIX™)
	<b>WOOD STUDS:</b>	2X4 WOOD STUDS, 16" O.C.
	<b>GYPSUM BOARD:</b>	ONE LAYER 5/8" THICK GYPSUM BOARD (UL TYPE ULIX™)

UL #U305-1 HR WALL ASSEMBLY - INTERIOR, LOAD BEARING

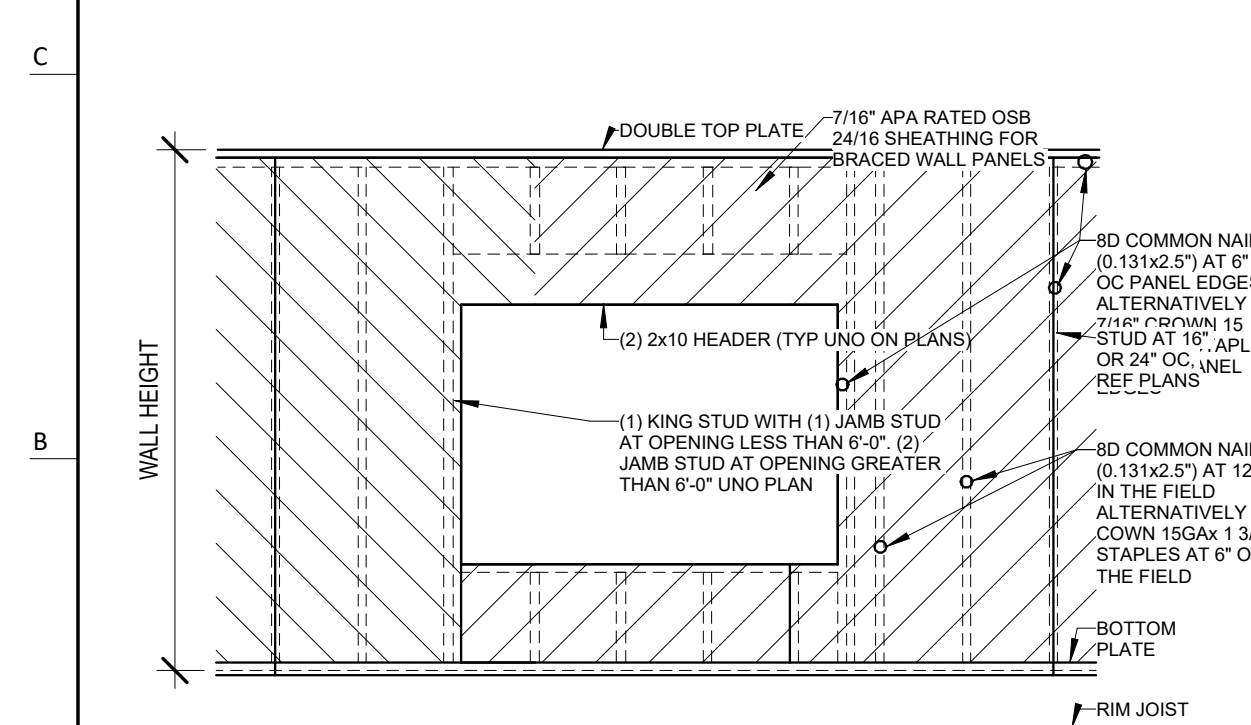


6 Method CS-WSP  
1/2" = 1'-0"

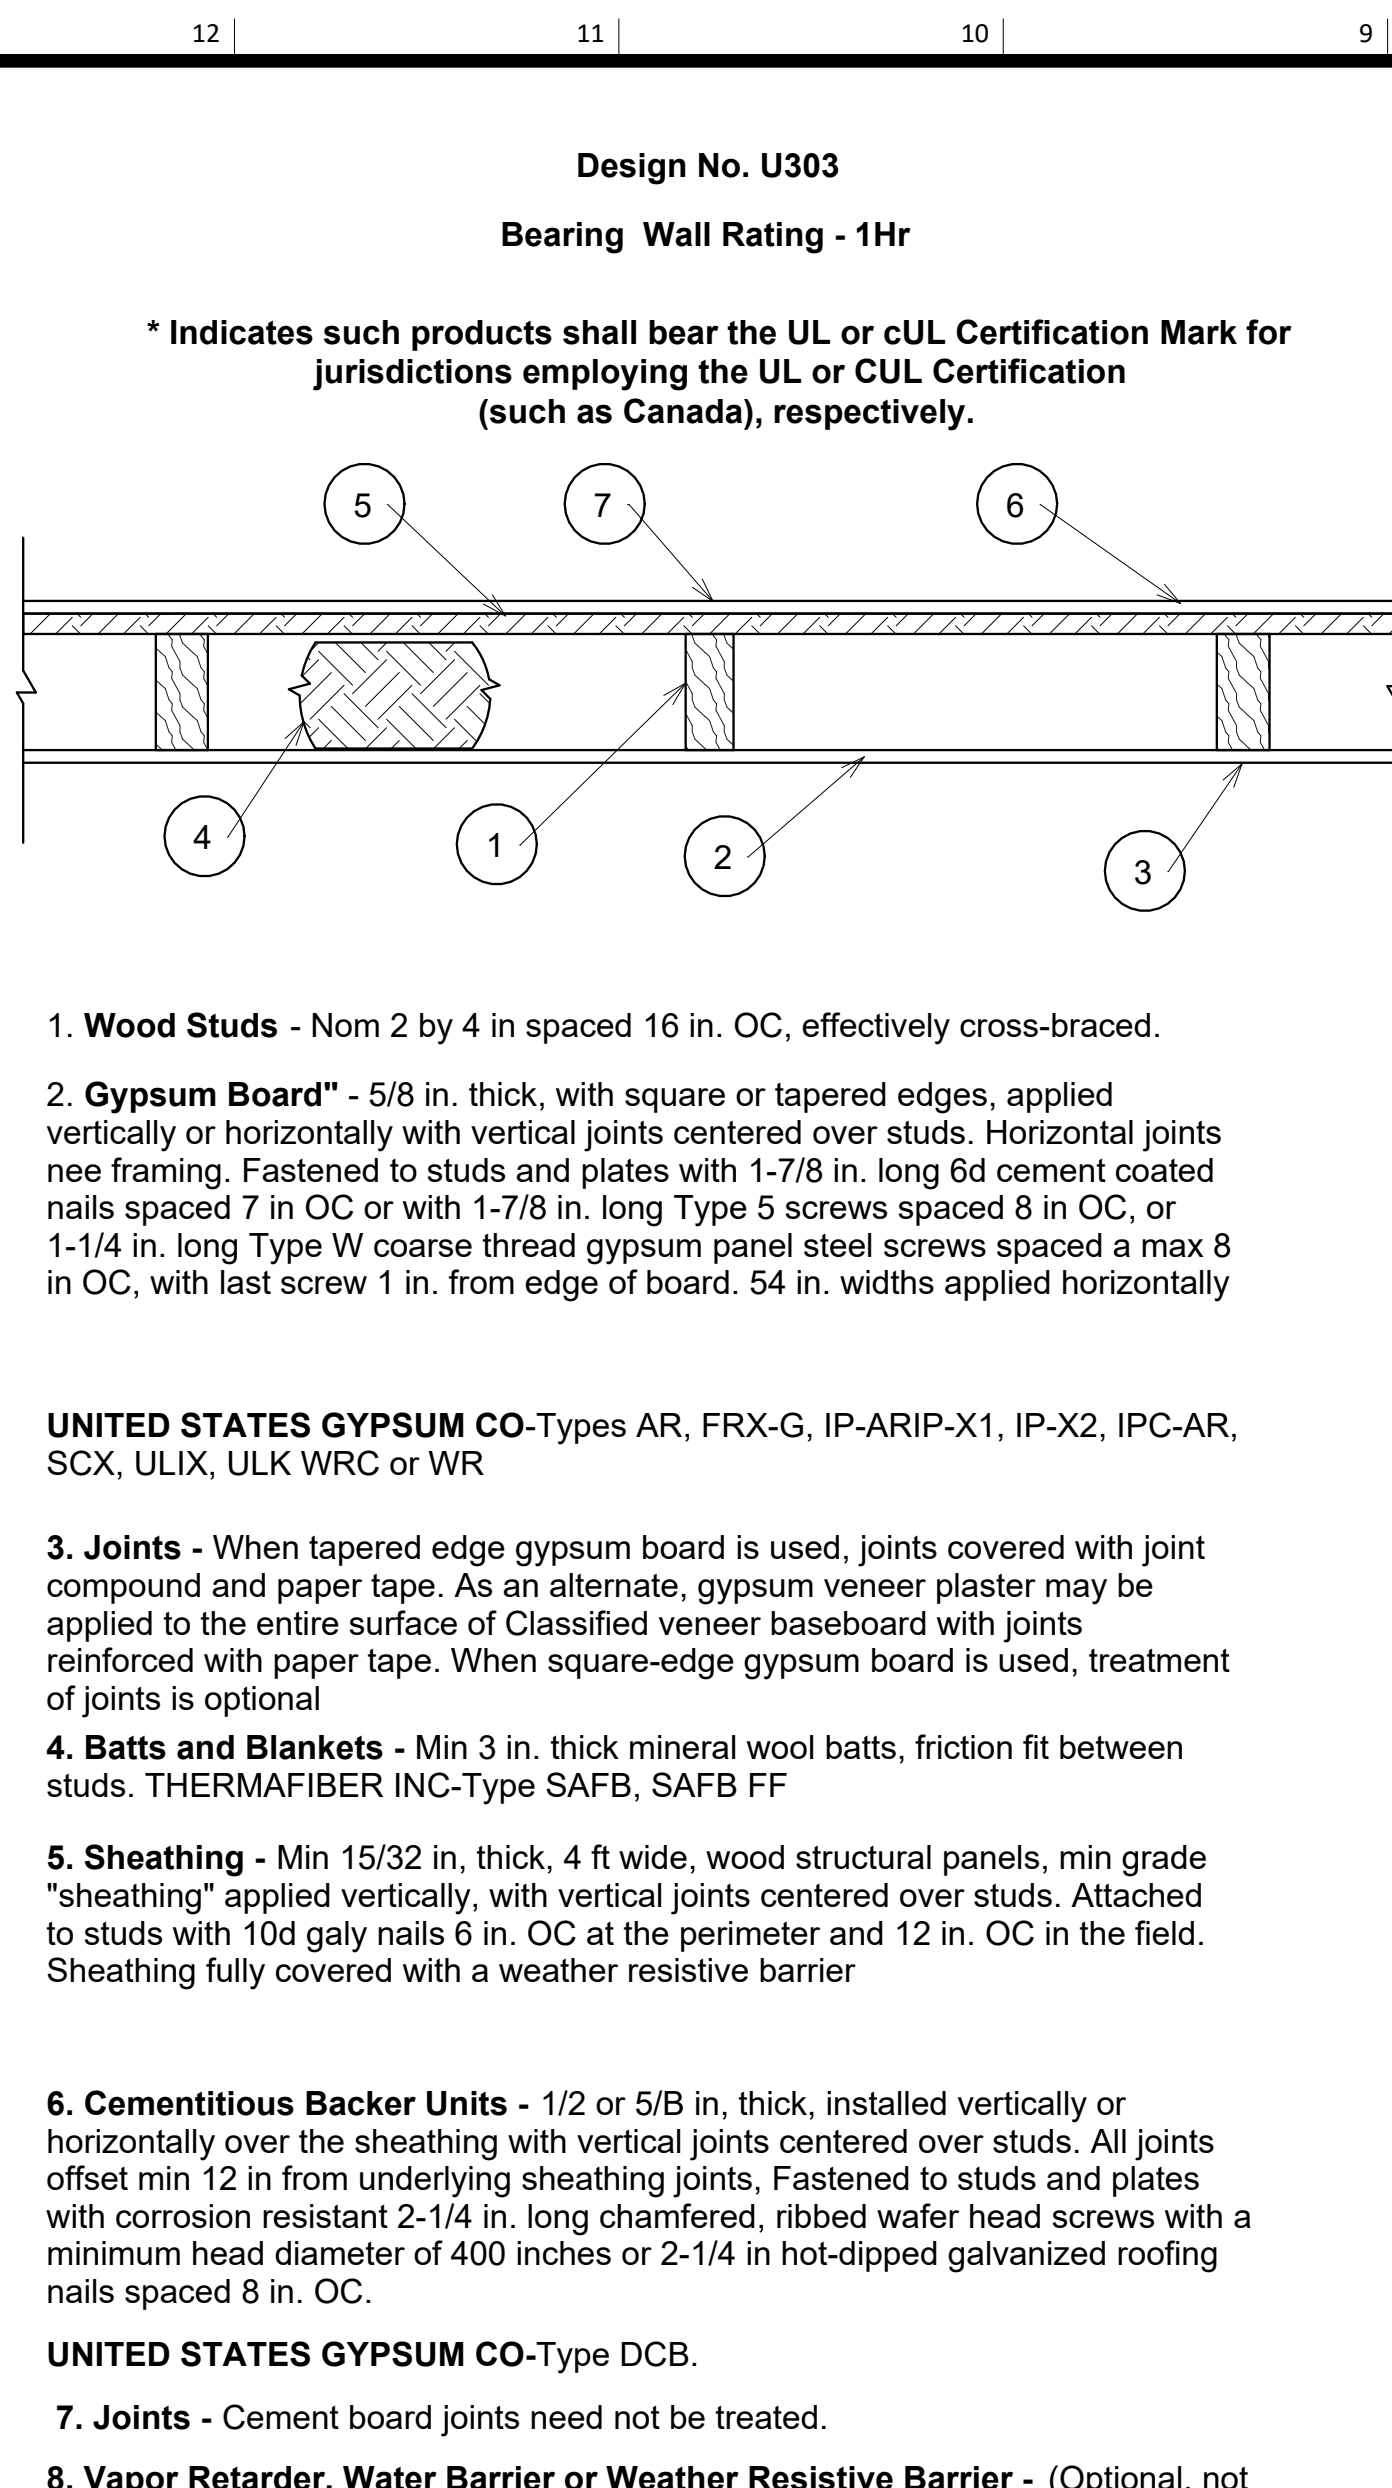


\* Indicates such products shall bear the UL or CUL Certification Mark for jurisdictions employing the UL or CUL Certification (such as Canada), respectively.

UL #U303-1 HR WALL ASSEMBLY - EXTERIOR, LOAD BEARING

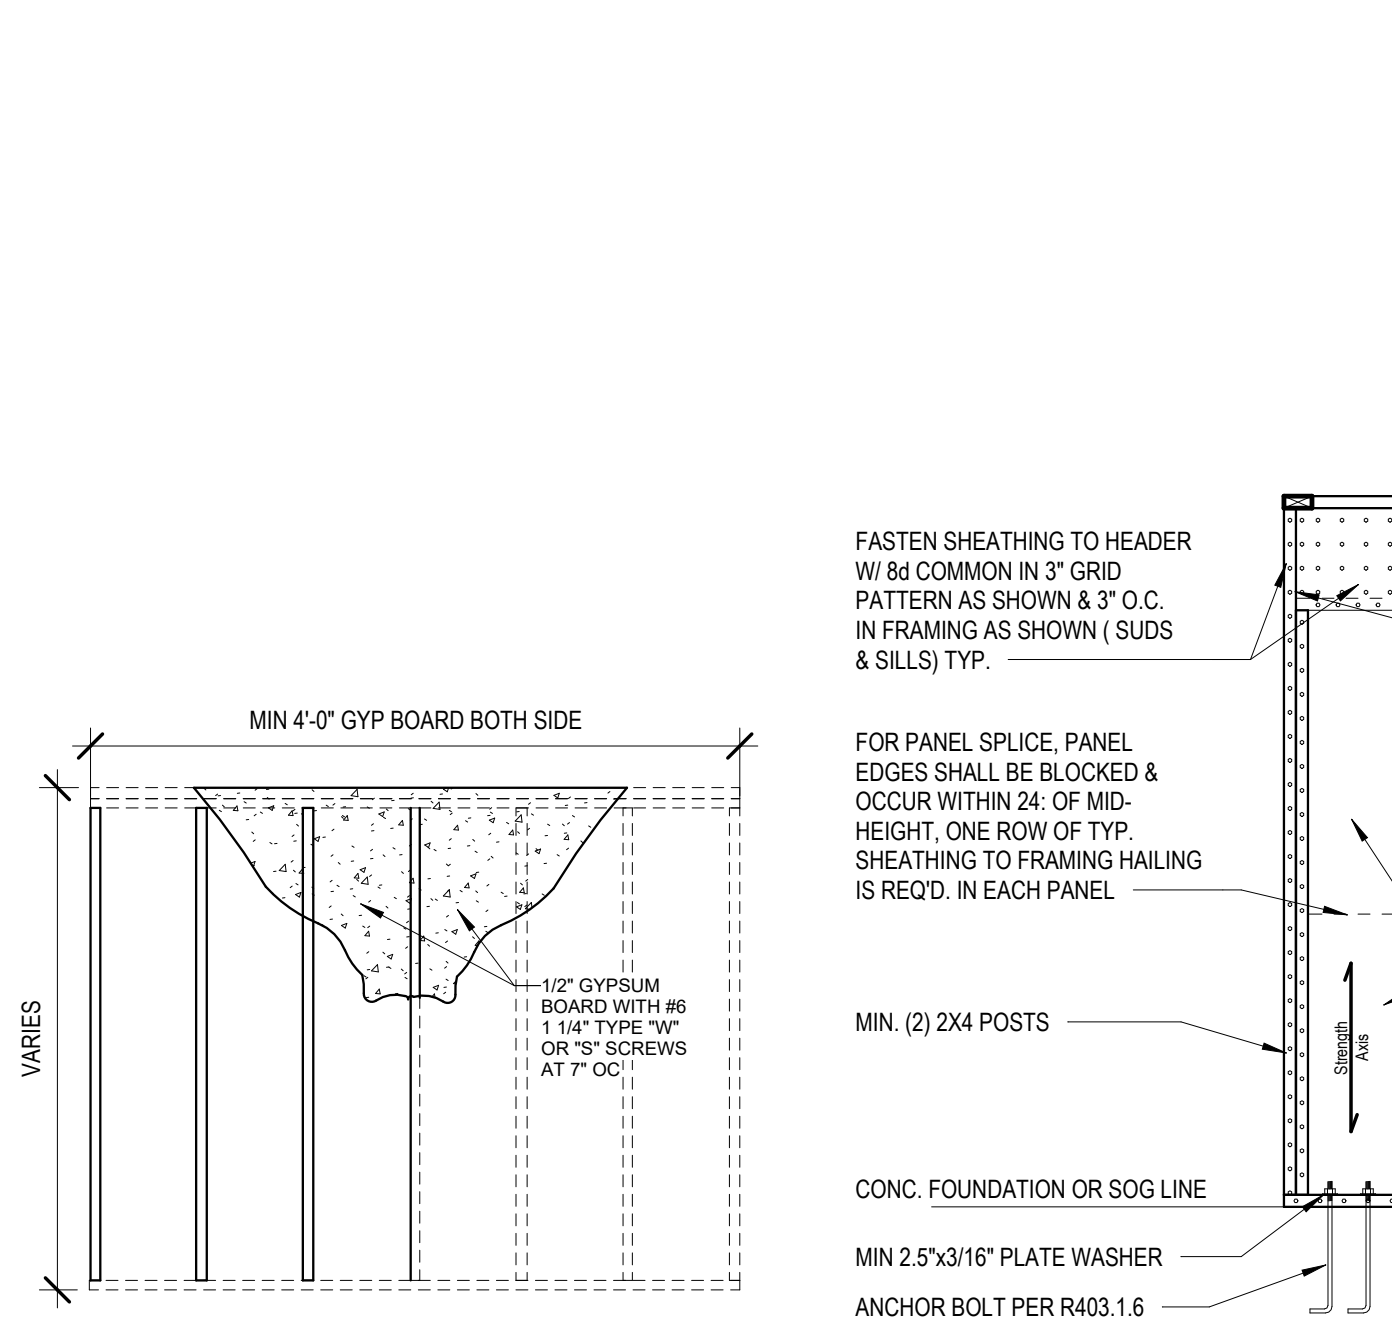


⑤ Method - GB  
1/2" = 1'-0"


⑦ PORTAL FRAME METHOD CS  
1/2" = 1'-0"

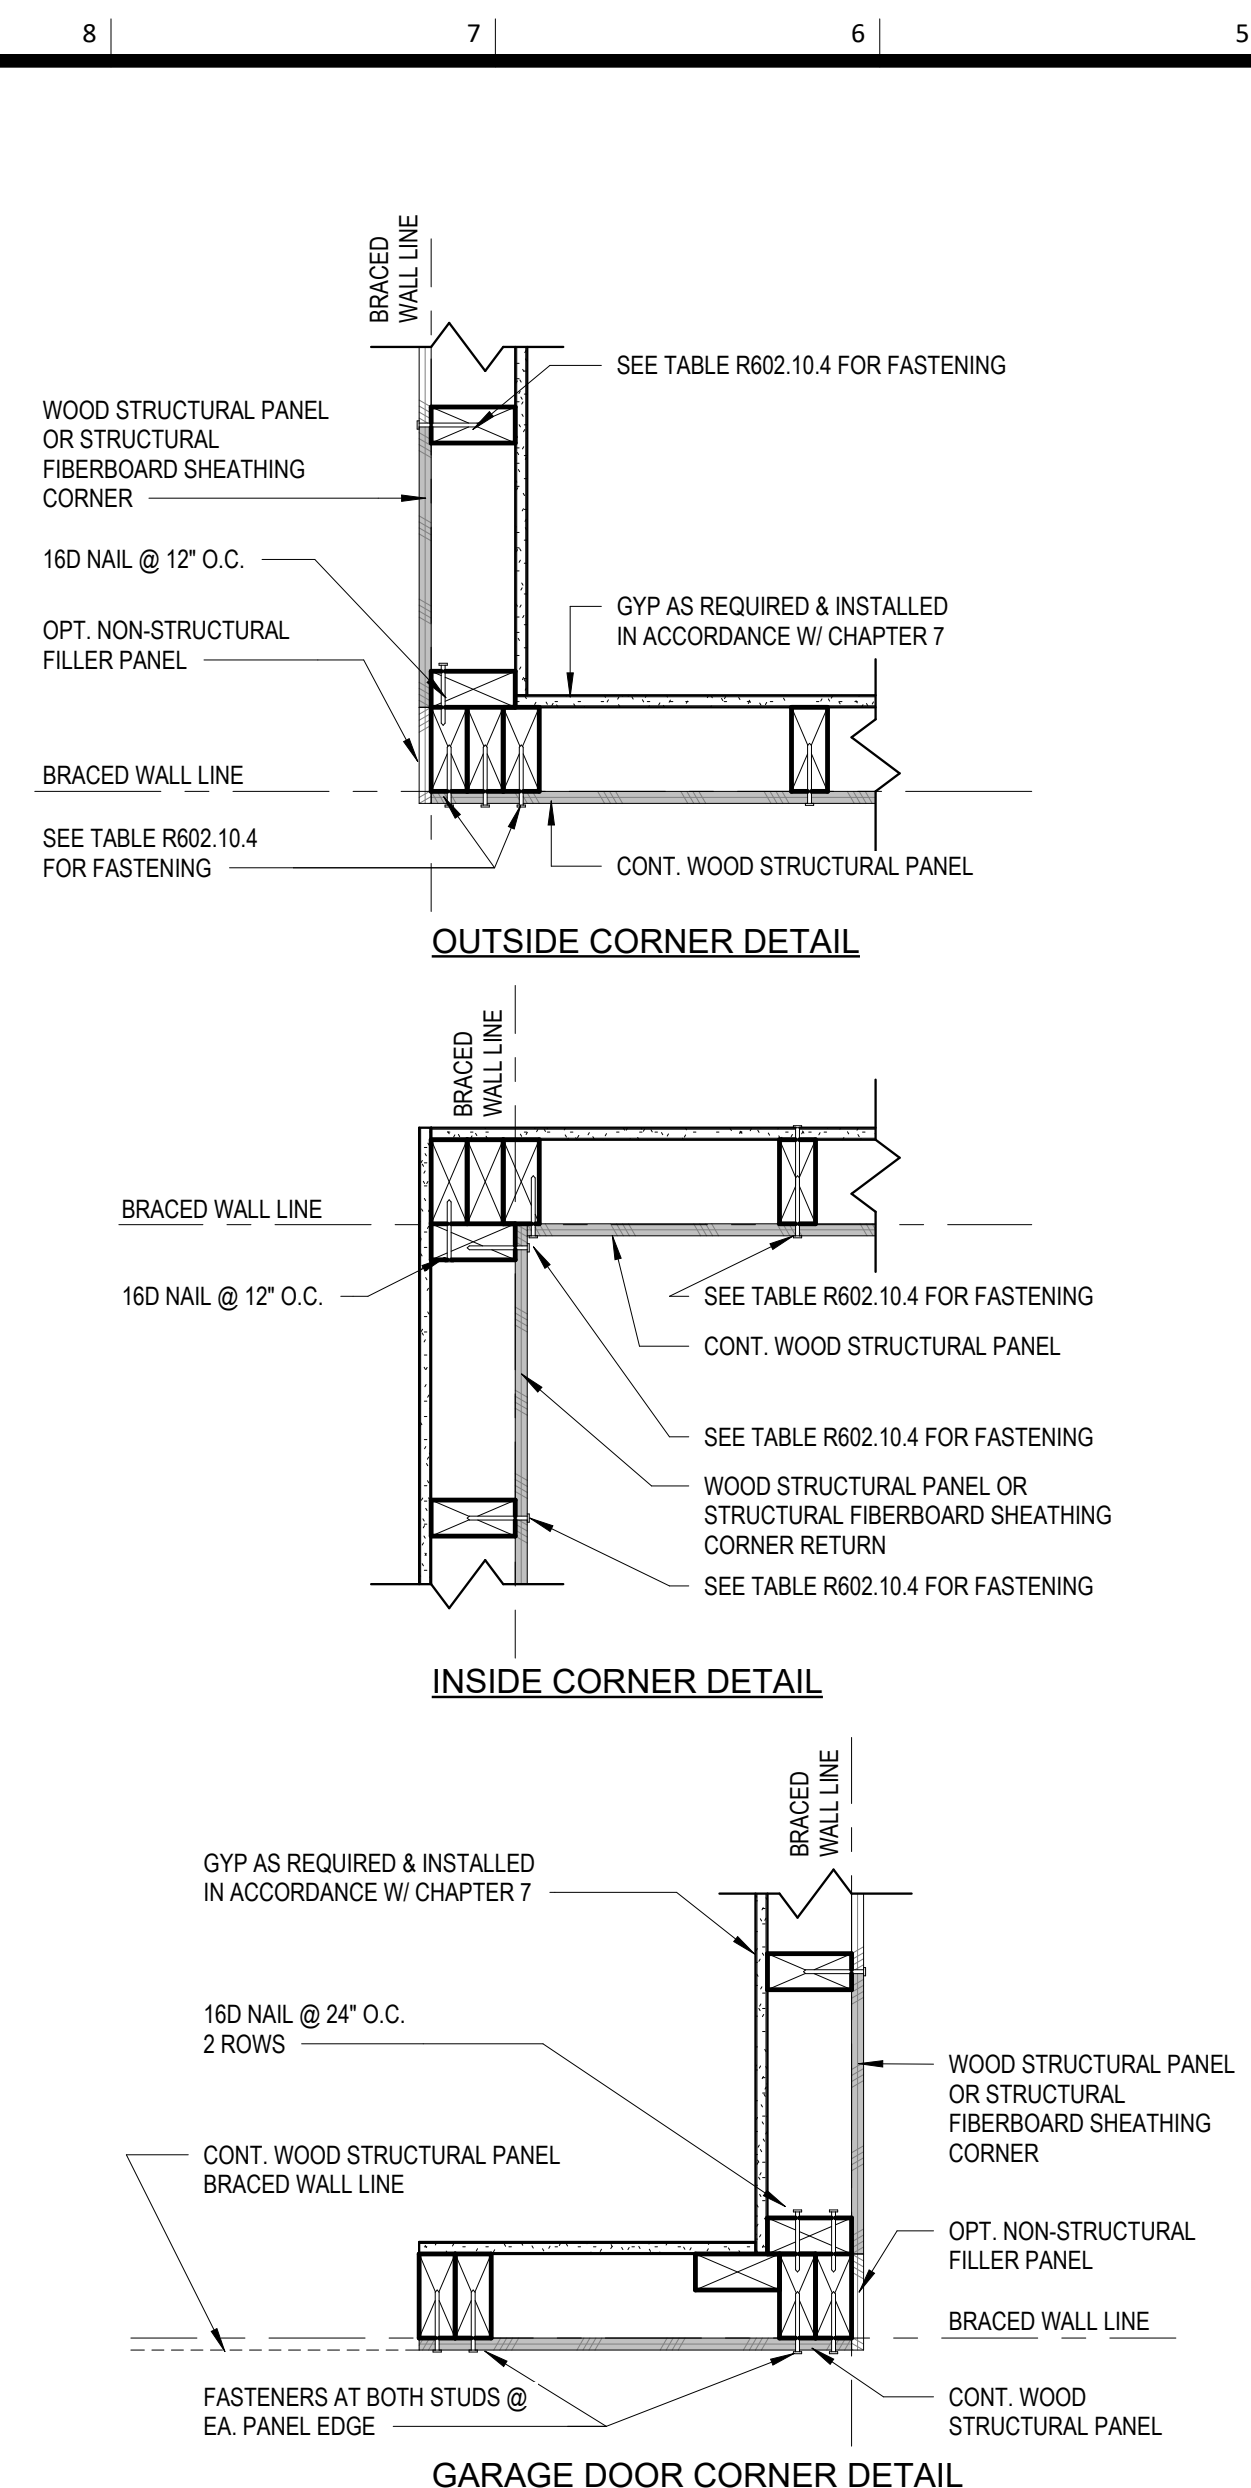


3 CS-WSP Corner Framing Details  
1 1/2" = 1'-0"

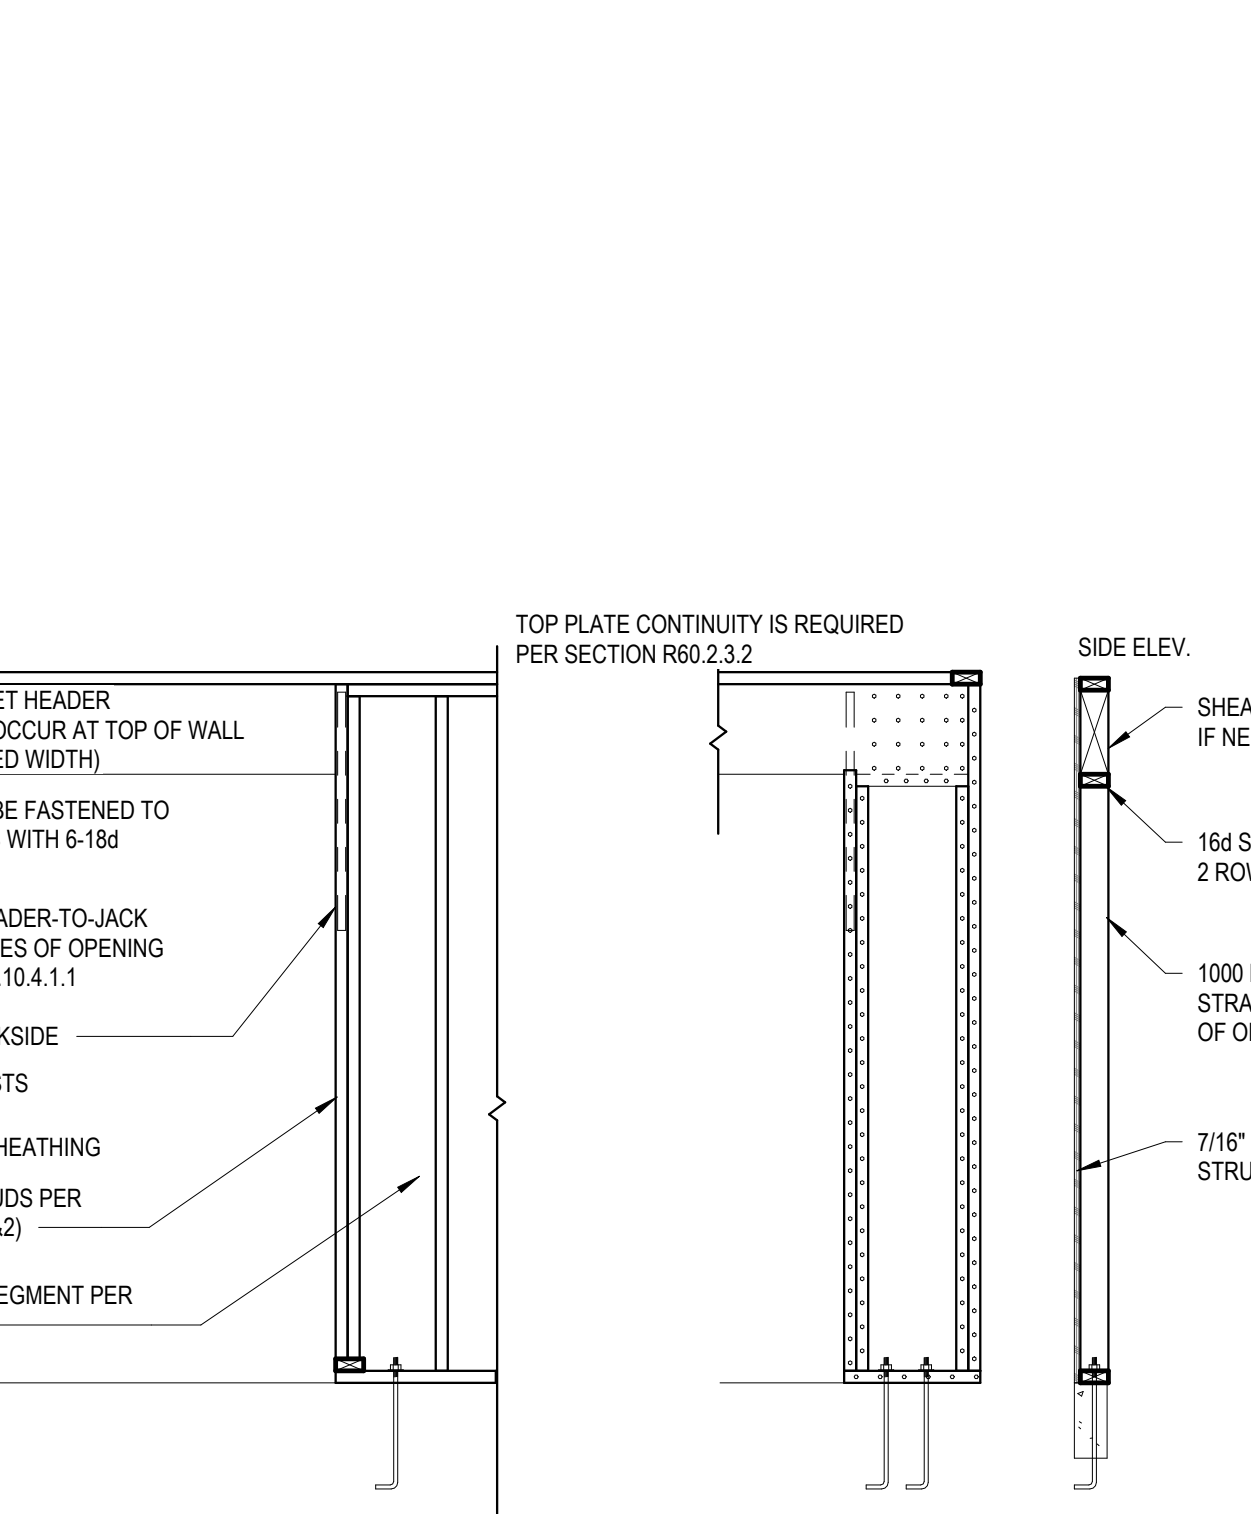

---

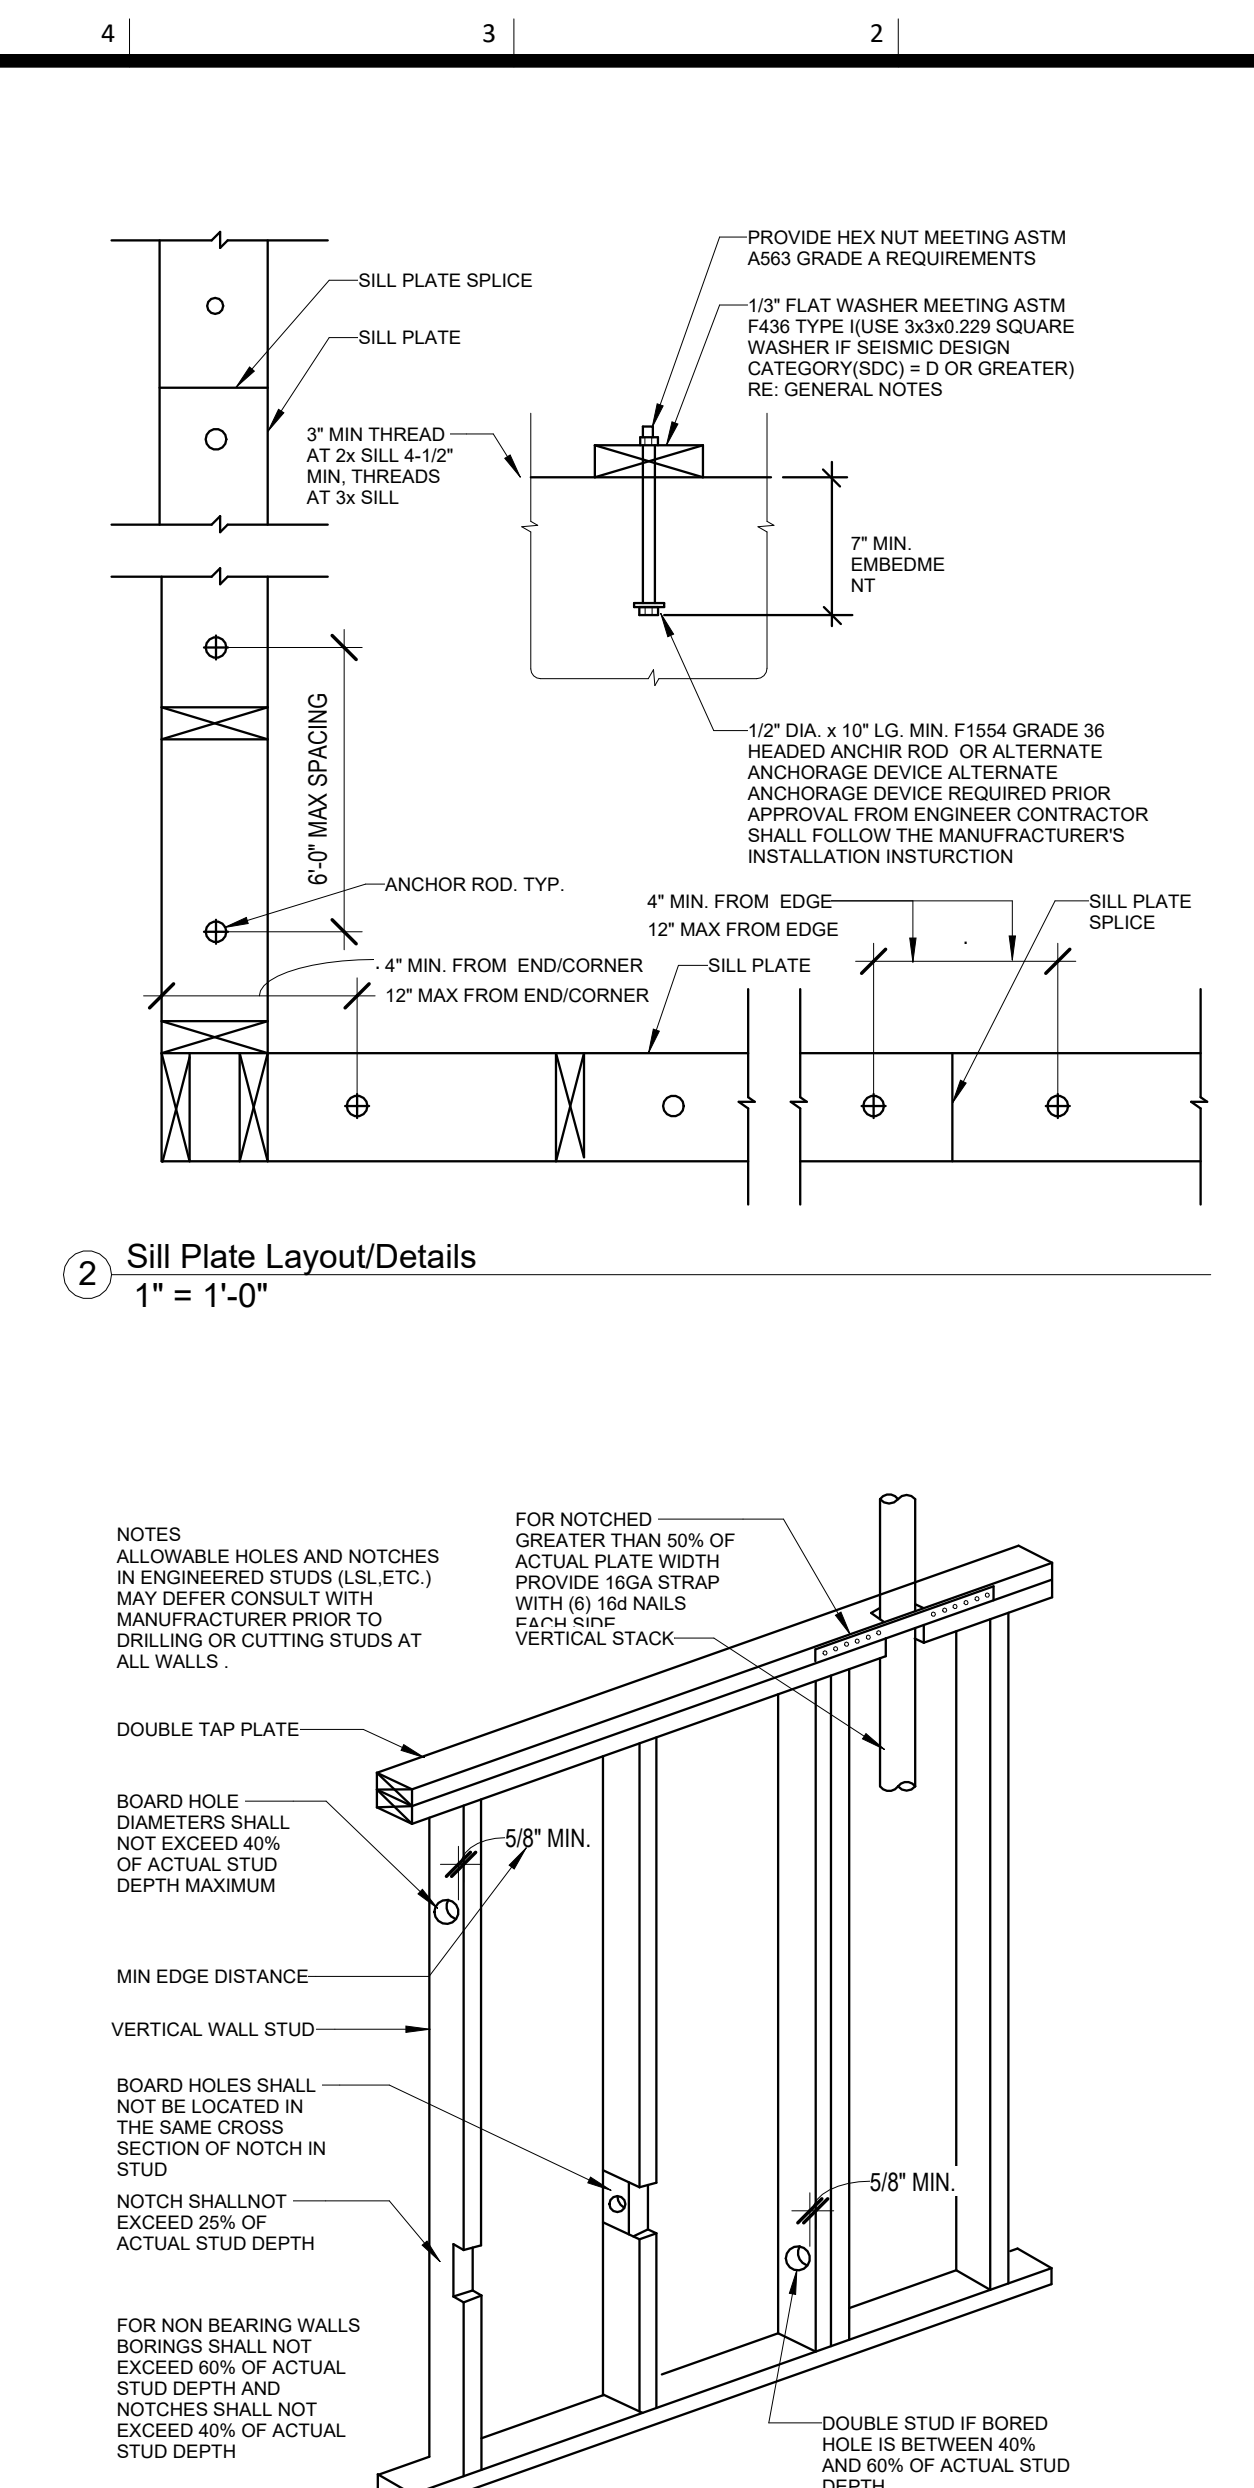

3 Notching Requirements  
1" = 1'-0"

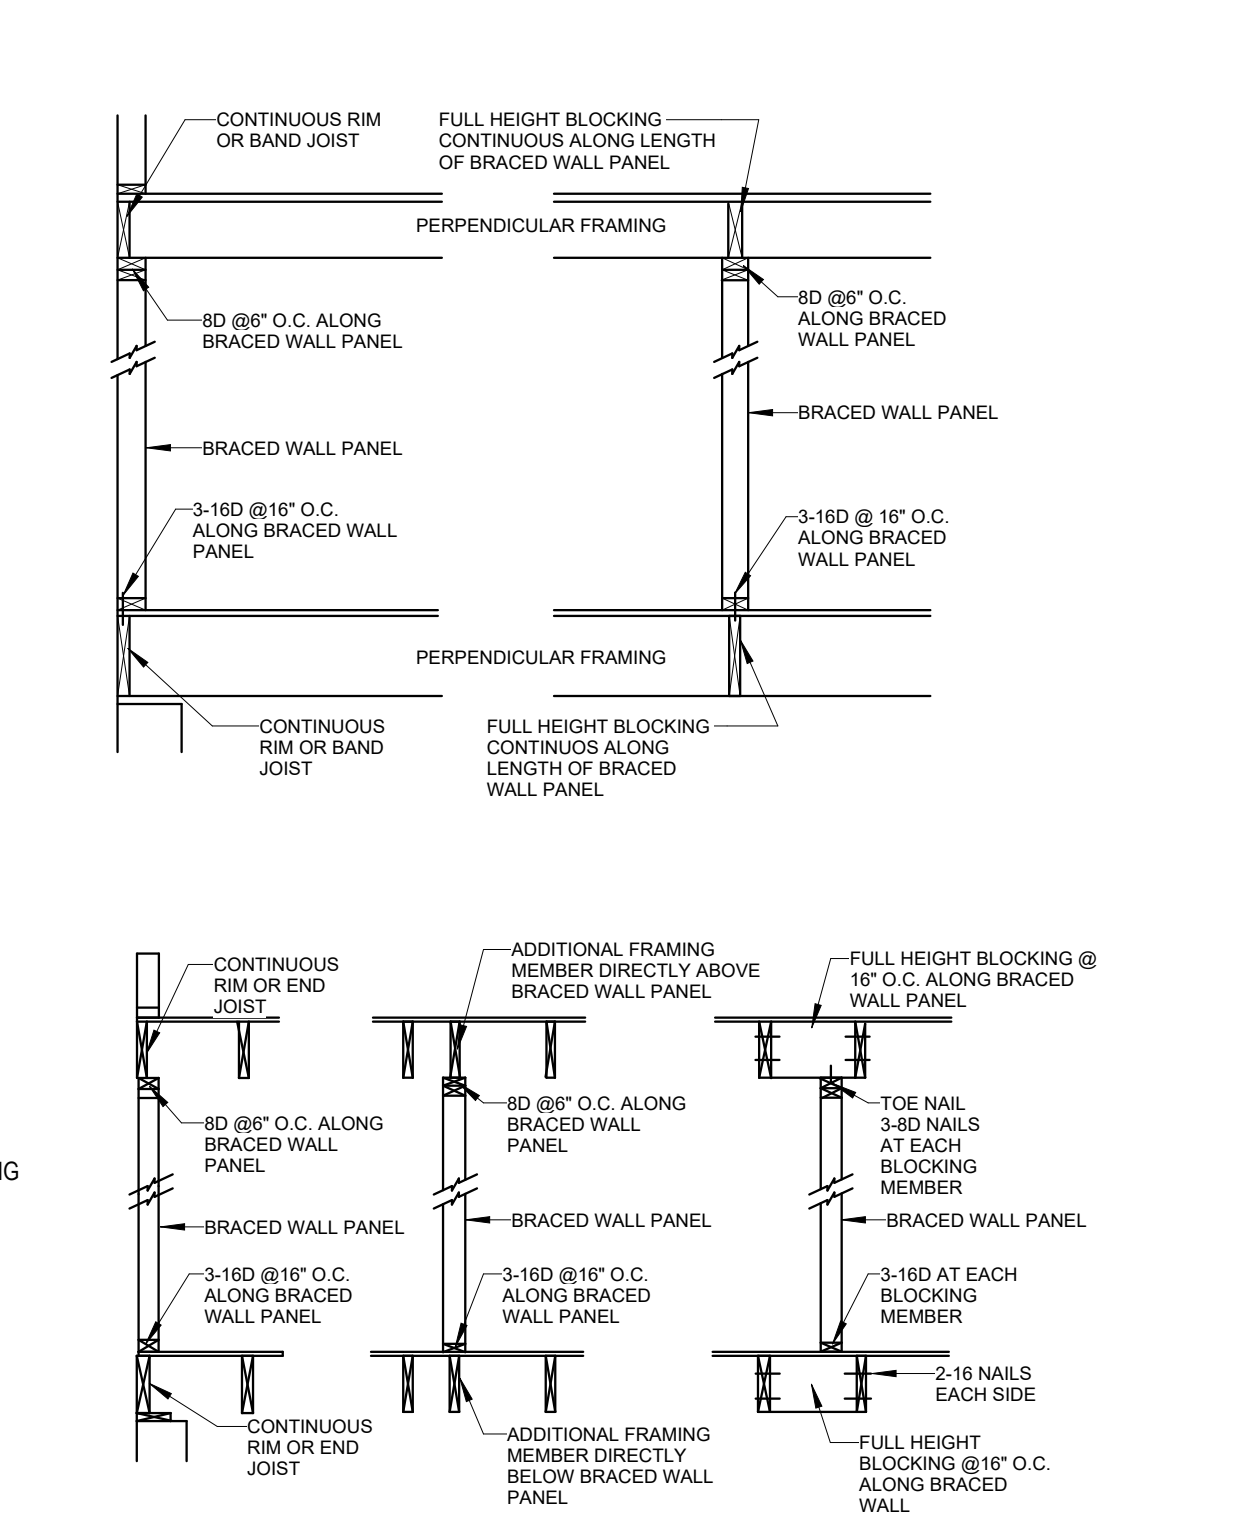

4 Ceiling/Floor  
1" = 1'-0"