

# LEE'S SUMMIT LOGISTICS

## 43 I K SPEC BUILDING



NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO  
64086  
11.02.22

### BUILD OUT CONSTRUCTION SET

**OWNER**  
SCANNELL PROPERTIES  
8801 RIVER CROSSING BLVD. SUITE 300  
INDIANAPOLIS, IN 46240  
O : 317 . 218 . 1648

**CIVIL ENGINEER**  
OLLSON  
7301 W. 133RD ST. SUITE 200  
OVERLAND PARK, KS 66213  
O : 913 . 381 . 1170

**ARCHITECT**  
  
**CURRAN**  
ARCHITECTURE  
5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O : 317 . 288 . 0681  
CONTACT : SHAWN CURRAN

**STRUCTURAL ENGINEER**  
WALLACE DESIGN  
COLLECTIVE  
1741 MCGEE STREET  
KANSAS CITY, MO 64108  
O : 816 . 421 . 8282

**CONTRACTOR**  
KADEAN CONSTRUCTION  
1821 MCGEE STREET  
KANSAS CITY, MO 64108  
O : 816 . 708 . 1199

#### DRAWINGS INDEX

##### CIVIL - BUILD OUT

C4.01 DIMENSION PLAN  
C4.02 DIMENSION PLAN  
C5.01 GRADING PLAN  
C5.02 GRADING PLAN  
C5.05 GRADING DETAIL  
L1.01 LANDSCAPE PLAN  
L1.02 LANDSCAPE PLAN

##### ARCHITECTURAL - BUILD OUT

A1.08 ENLARGED LIFE SAFETY PLAN  
A1.09 1ST FLOOR PLAN BUILD OUT  
A1.10 ENLARGED FLOOR PLANS  
A1.11 ENLARGED FLOOR PLANS  
A1.12 OVERALL REFLECTED CEILING PLAN  
A1.13 ENLARGED REFLECTED CEILING PLANS  
A5.01 SECTIONS & DETAILS  
A5.02 SECTIONS & DETAILS  
A6.02 INTERIOR DOOR SCHEDULE  
A6.03 FINISH SCHEDULE  
A7.01 EXTERIOR ENCLOSURE  
A7.02 COMPACTOR ENCLOSURE

##### STRUCTURAL - BUILD OUT

S0.0 GENERAL NOTES  
S0.1 GENERAL NOTES  
S1.0 OVERALL FOUNDATION PLAN  
S1.1 ENLARGED PARTIAL FOUNDATION PLAN  
S1.2 ENLARGED MEZZANINE ROOF FRAMING PLAN  
S2.0 OVERALL FRAMING PLAN  
S2.1 ENLARGED PARTIAL FRAMING PLAN  
S2.2 ENLARGED PARTIAL FRAMING PLAN  
S2.3 ENLARGED PARTIAL FRAMING PLAN  
S2.4 ENLARGED PARTIAL FRAMING PLAN  
S3.0 FOUNDATION DETAILS  
S3.1 FRAMING DETAILS  
S3.2 FOUNDATION DETAILS  
S4.0 FRAMING DETAILS  
S4.1 FRAMING DETAILS  
S4.2 FRAMING DETAILS

##### MECHANICAL - BUILD OUT

M1.1 OVERALL MECHANICAL FLOOR PLAN  
M1.2 ENLARGED MECHANICAL FLOOR PLANS  
M1.3 ENLARGED MECHANICAL FLOOR PLANS  
M2.1 SPECIFICATIONS & DETAILS  
M3.1 MECHANICAL SCHEDULES

##### PLUMBING - BUILD OUT

P0.0 PLUMBING SPECIFICATIONS  
P1.0 PLUMBING PLAN  
P1.1 COMPRESSED AIR PLAN  
P1.2 ENLARGED PLUMBING PLANS  
P2.0 PLUMBING SCHEDULES AND DETAILS  
P2.1 PLUMBING RISERS

##### ELECTRICAL - BUILD OUT

E1.0 WAREHOUSE LIGHTING  
E1.1 OFFICE LIGHTING  
E2.0 WAREHOUSE POWER  
E2.1 OFFICE POWER  
E3.0 HVAC POWER  
E3.1 OFFICE HVAC  
E4.0 SITE  
E5.0 RISER  
E6.0 PANEL SCHEDULE  
E6.1 PANEL SCHEDULE

##### FIRE PROTECTION - BUILD OUT

FP0.0 SYSTEM NOTES  
FP1.0 HYDRAULIC SITE PLAN  
FP2.0 OVERHEAD PIPING LAYOUT  
FP2.1.1 AREA 1: SYSTEMS 01-02  
FP2.1.2 AREA 1 (CONT): SYSTEMS 01-02  
FP2.2.1 AREA 2: SYSTEMS 02-03  
FP2.2.2 AREA 2 (CONT): SYSTEMS 02-03  
FP2.3.1 AREA 3: SYSTEMS 03-04  
FP2.3.2 AREA 3 (CONT): SYSTEMS 03-04  
FP2.4 AREA 4: SYSTEM 05  
FP2.5 AREA 5: SYSTEM 06  
FP2.6 AREA 6: SYSTEM 07  
FP2.7.1 AREA 7: SYSTEMS 08-09  
FP2.7.2 AREA 7 (CONT): SYSTEMS 08-09  
FP2.8.1 AREA 8: SYSTEMS 09-10  
FP2.8.2 AREA 8 (CONT): SYSTEMS 09-10  
FP2.9.1 AREA 9: SYSTEMS 10-11  
FP2.9.2 AREA 9 (CONT): SYSTEMS 10-11  
FP2.10 TENANT IMPROVEMENT OFFICE PLAN  
FP2.11 TENANT IMPROVEMENT COOLER PLAN  
FP3.0 FIRE PUMP & RISER DETAIL

#### DRAWINGS INDEX

COVER

##### CIVIL ENGINEERING

C200 SITE PLAN

##### ARCHITECTURAL

A001 SCOPE NOTES & CODE SUMMARY  
A002 TYPICAL ACCESSIBILITY DETAILS  
A100 LIFE SAFETY PLAN  
A101 OVERALL FLOOR PLAN  
A102 FLOOR PLAN - AREA A  
A103 FLOOR PLAN - AREA B  
A104 FLOOR PLAN - AREA C  
A105 FLOOR PLAN - AREA D  
A106 FLOOR PLAN - AREA E  
A107 FLOOR PLAN - AREA F  
A120 ROOF PLAN  
A200 OVERALL EXTERIOR ELEVATIONS  
A201 EXTERIOR ELEVATIONS  
A202 EXTERIOR ELEVATIONS  
A203 EXTERIOR ELEVATIONS  
A204 EXTERIOR ELEVATIONS  
A205 EXTERIOR ELEVATIONS  
A206 EXTERIOR ELEVATIONS  
A207 EXTERIOR ELEVATIONS  
A301 WALL SECTIONS  
A302 WALL SECTIONS  
A303 WALL SECTIONS  
A304 WALL SECTIONS  
A501 TYPICAL TILT WALL BUILDING DETAILS  
A502 TYPICAL TILT WALL BUILDING DETAILS  
A503 TYPICAL TILT WALL BUILDING DETAILS  
A601 DOOR SCHEDULE & STOREFRONT ELEVATIONS

##### STRUCTURAL

S0.0 GENERAL NOTES  
S0.1 GENERAL NOTES  
S1.0 OVERALL FOUNDATION PLAN  
S1.1 ENLARGED PARTIAL FOUNDATION PLAN  
S1.2 ENLARGED PARTIAL FOUNDATION PLAN  
S1.3 ENLARGED PARTIAL FOUNDATION PLAN  
S1.4 ENLARGED PARTIAL FOUNDATION PLAN  
S2.0 OVERALL ROOF FRAMING PLAN  
S2.1 ENLARGED PARTIAL FRAMING PLAN  
S2.2 ENLARGED PARTIAL FRAMING PLAN  
S2.3 ENLARGED PARTIAL FRAMING PLAN  
S2.4 ENLARGED PARTIAL FRAMING PLAN  
S2.5 ROOF DECK ATTACHMENT PLAN  
S2.6 LATERAL LOAD PLAN  
S3.0 FOUNDATION DETAILS  
S3.1 FOUNDATION DETAILS  
S3.2 FOUNDATION DETAILS  
S3.3 FOUNDATION DETAILS  
S4.0 FRAMING DETAILS  
S4.1 FRAMING DETAILS  
S4.2 FRAMING DETAILS  
S4.3 FRAMING DETAILS

##### MECHANICAL

M1.1 OVERALL MECHANICAL PLAN  
M2.1 MECHANICAL SCHEDULES

##### PLUMBING


P100 PARTIAL PLUMBING FLOOR PLAN UNIT A  
P101 PARTIAL PLUMBING FLOOR PLAN UNIT B  
P102 PARTIAL PLUMBING FLOOR PLAN UNIT C  
P103 PARTIAL PLUMBING FLOOR PLAN UNIT D  
P104 PARTIAL PLUMBING FLOOR PLAN UNIT E  
P105 PARTIAL PLUMBING FLOOR PLAN UNIT F  
P106 PLUMBING SPECIFICATIONS

##### ELECTRICAL

E1.00 LIGHTING PLAN  
E2.00 POWER PLAN  
E3.00 UNDERGROUND ELECTRICAL PLAN  
E4.00 PHOTOMETRIC PLAN  
E5.00 SITE LIGHTING PLAN  
E6.00 ONE LINE DIAGRAM  
E7.00 PANEL SCHEDULES


##### FIRE PROTECTION

FP0.0 SYSTEM NOTES  
FP1.0 HYDRAULIC SITE PLAN  
FP2.0 OVERHEAD PIPING LAYOUT  
FP2.1 AREA 1: SYSTEMS 01-02  
FP2.1.2 AREA 1 SYSTEMS CONT. 01-02  
FP2.2.1 AREA 2: SYSTEMS 02-03  
FP2.2.2 AREA 2 SYSTEMS CONT. 02-03  
FP2.3.1 AREA 3: SYSTEMS 03-04  
FP2.3.2 AREA 3 SYSTEMS CONT. 03-04  
FP2.4 AREA 4: SYSTEM 05  
FP2.5 AREA 5: SYSTEM 06  
FP2.6 AREA 6: SYSTEM 07  
FP2.7.1 AREA 7: SYSTEMS 08-09  
FP2.7.2 AREA 7 SYSTEMS CONT. 08-09  
FP2.8.1 AREA 8: SYSTEMS 09-10  
FP2.8.2 AREA 8 SYSTEMS CONT. 09-10  
FP2.9.1 AREA 9: SYSTEMS 10-11  
FP2.9.2 AREA 9 SYSTEMS CONT. 10-11  
FP3.0 FIRE PUMP AND RISER DETAIL

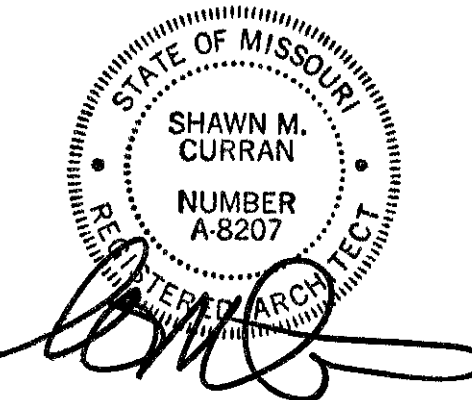





DWG: F:\2021\04001-04500\021-04157\40-design\AutoCAD\final plans\Sheets\GNCV\PHASE 1\021-04157.dwg USER: sgillard  
DATE: Jul 07, 2022 8:35am XREFS: C:\BULK\_02104157 C:\BULK\_02104157 E:\PHASE\_02104157

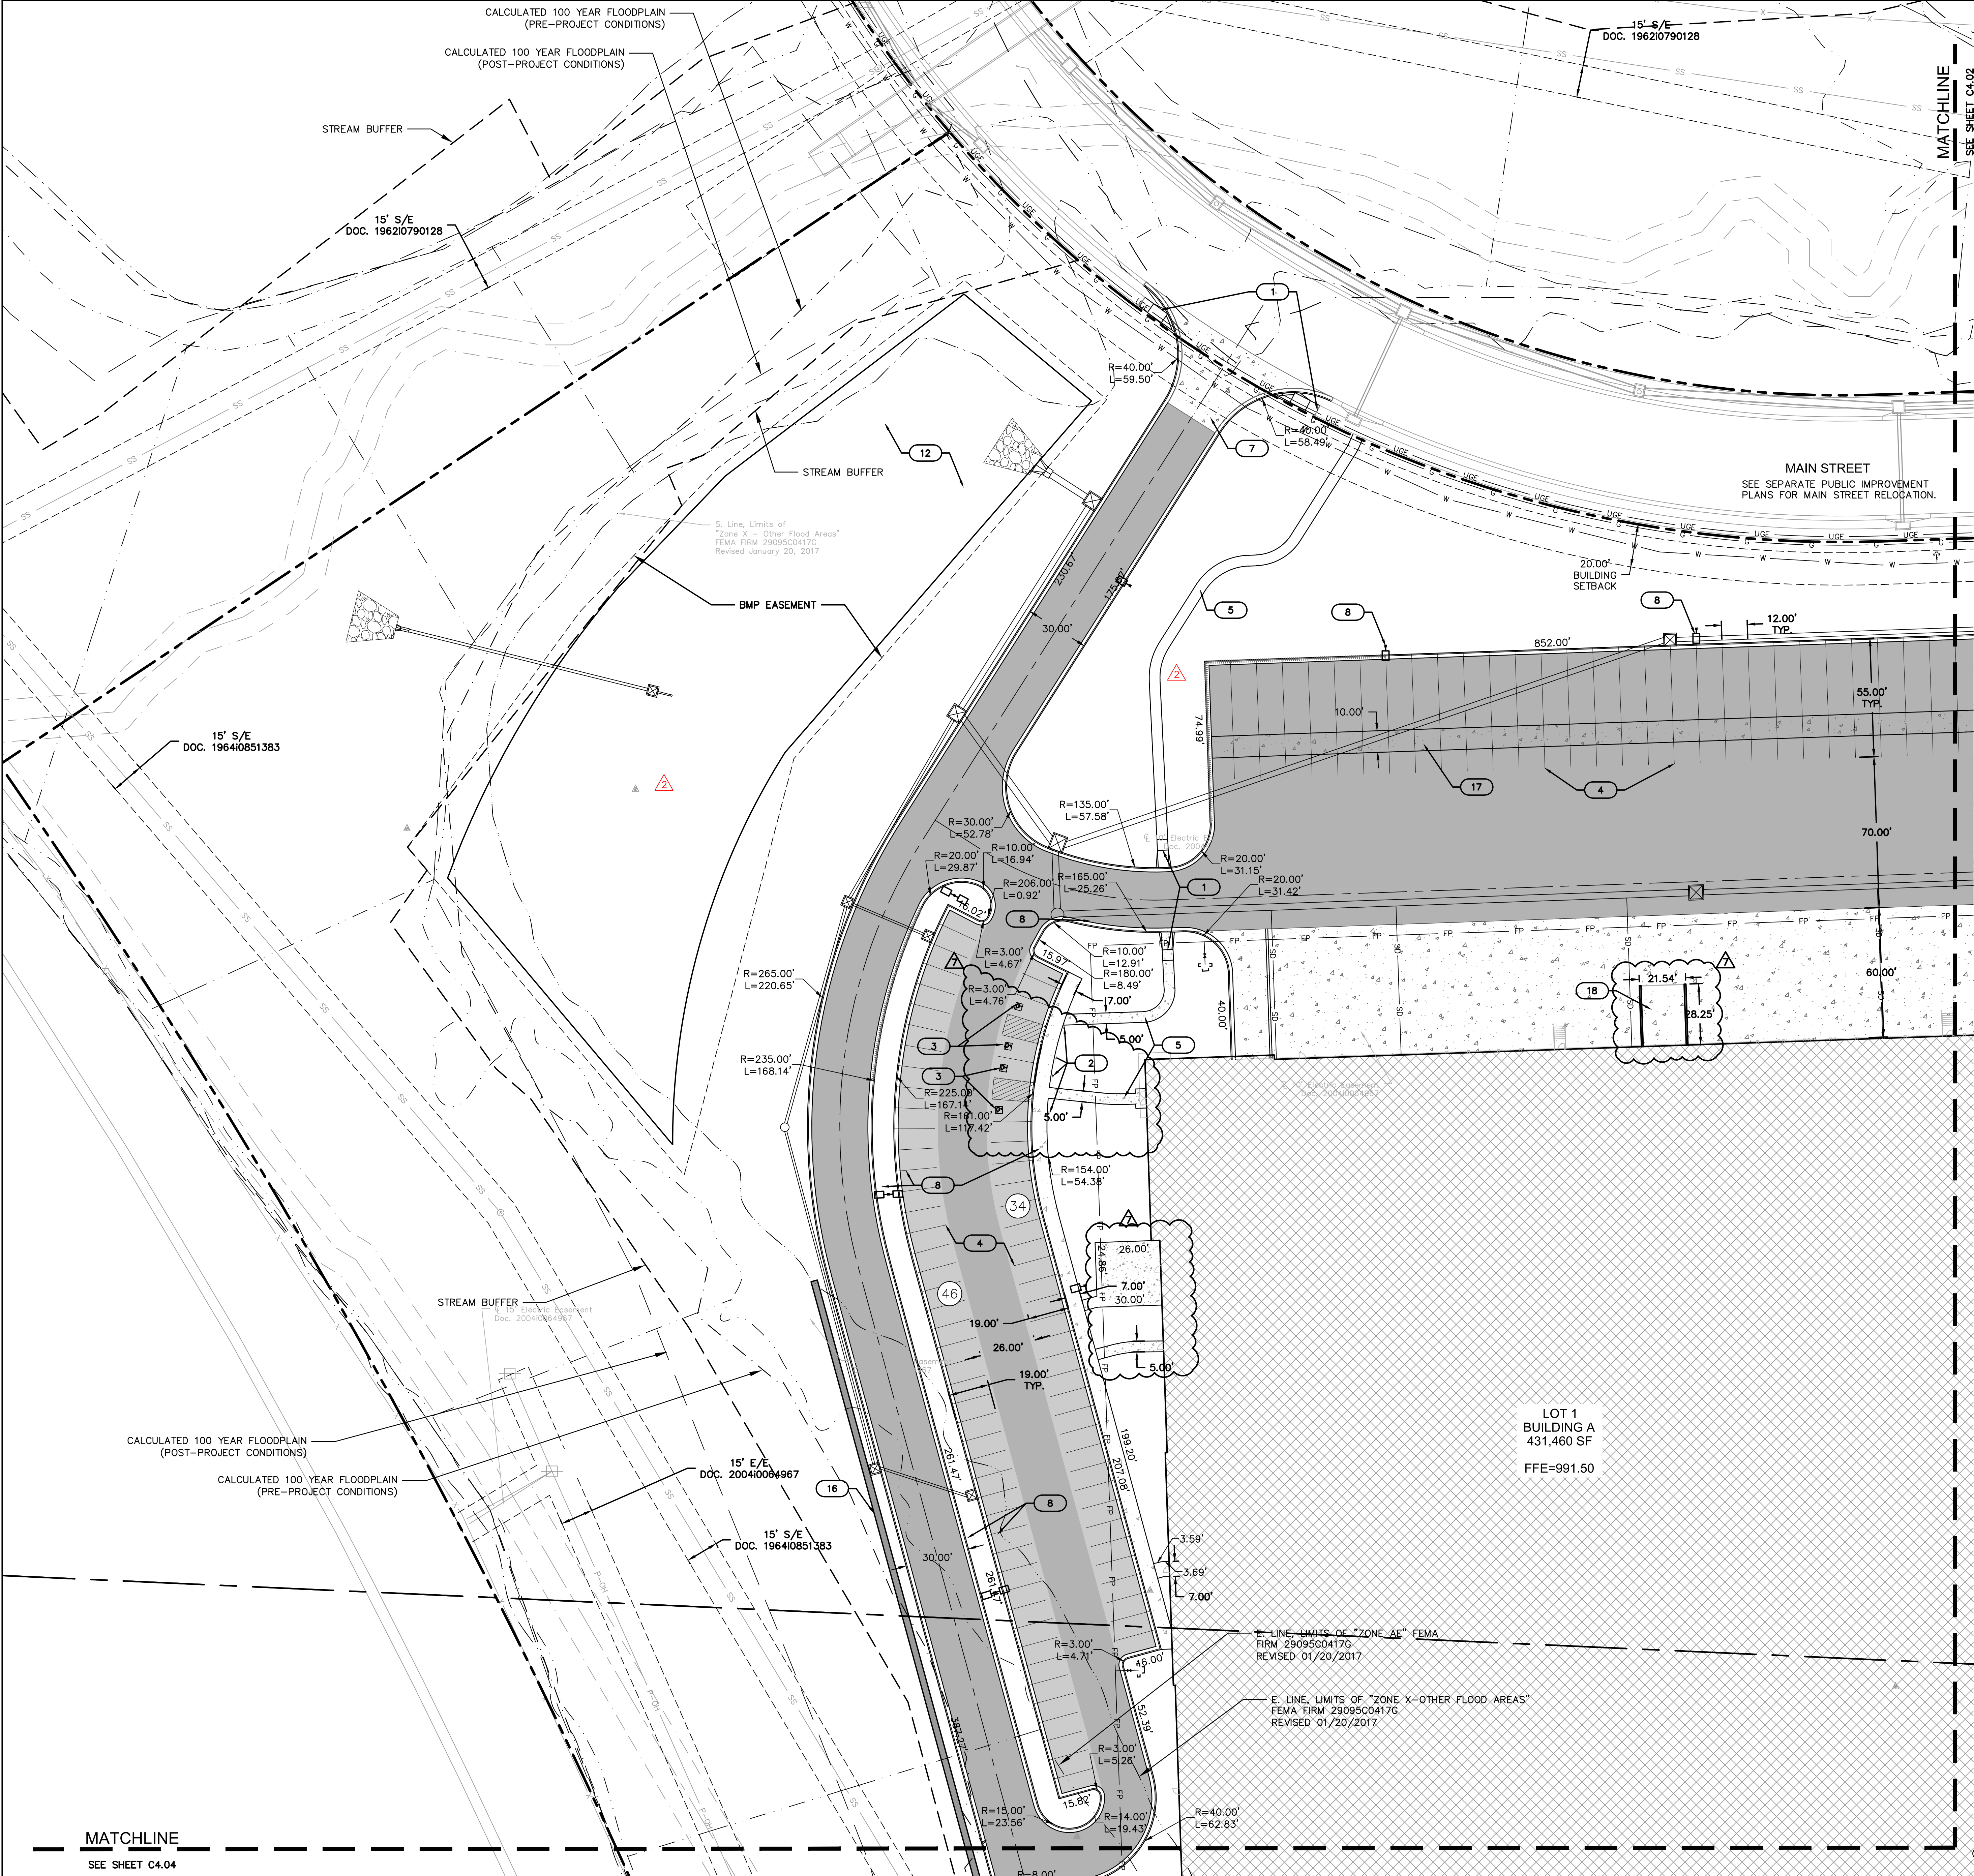

**DIMENSION PLAN LEGEND**

- PROPERTY LINE
- LOT LINE
- UTILITY EASEMENT
- BUILDING SET/BACK/LANDSCAPE BUFFER
- SAWCUT PAVEMENT FULL DEPTH
- ADA PATH - SIDEWALKS NOT DELINEATED AS ADA PATHS WILL NOT BE ADA COMPLIANT.
- PROPOSED STORM SEWER
- INSTALL STANDARD "WET" CURB & GUTTER (PER LEE'S SUMMIT STANDARD DETAIL)
- INSTALL STANDARD "DRY" CURB & GUTTER (PER LEE'S SUMMIT STANDARD DETAIL)
- INSTALL "ADA RAMP" CURB & GUTTER (PER LEE'S SUMMIT STANDARD DETAIL)
- INSTALL MEDIUM DUTY ASPHALT SEE PAVEMENT SECTION ON C3.00
- INSTALL HEAVY DUTY ASPHALT SEE PAVEMENT SECTION ON C3.00
- INSTALL HEAVY DUTY CONCRETE SEE PAVEMENT SECTION ON C3.00
- INSTALL CONCRETE SIDEWALK SEE PAVEMENT SECTION ON C3.00
- PROPOSED LIGHT POLE
- PROPOSED PARKING STALL COUNT

- KEYNOTES**
- 1 CONSTRUCT ADA ACCESSIBLE RAMP. (SEE DETAIL SHEET)
  - 2 PROPOSED ADA ACCESSIBLE PARKING SIGN. (SEE DETAIL SHEET). SIGNS PROVIDED BY TENANT.
  - 3 ADA PARKING STALL LAYOUT. (SEE DETAIL SHEET)
  - 4 PROPOSED PAVEMENT STRIPING. (SEE PAVEMENT STRIPING PLAN)
  - 5 PROPOSED CONCRETE SIDEWALK. (SEE DETAIL SHEET)
  - 6 PROPOSED TRANSFORMER. (SEE MEP PLANS)
  - 7 PROPOSED CONCRETE APRON
  - 8 PARKING AND STREET LIGHTING. (SEE SEPARATE PLAN SET)
  - 9 PROPOSED ROOF DRAIN/DOWN SPOUT LOCATION. (SEE STORM SHEETS)
  - 10 INSTALL YIELD/STOP SIGNS. (SEE ARCH PLANS)
  - 11 PROPOSED TRAILER SPACING NUMBERING
  - 12 PROPOSED DRY DETENTION BASIN
  - 13 CONCRETE STAIRS (SEE DETAIL SHEET)
  - 14 PROPOSED EV CHARGING STATION(SEE MEP/ARCH PLANS)
  - 15 PROPOSED FIRE HYDRANT
  - 16 PROPOSED RETAINING WALL WITH TRAFFIC RATED RAILING/FENCE
  - 17 PROPOSED TRAILER PARKING DOLLY STRIP
  - 18 PROPOSED TRASH ENCLOSURE (SEE ARCH PLANS)
  - 19 PROPOSED GENERATOR ENCLOSURE (SEE ARCH PLANS)

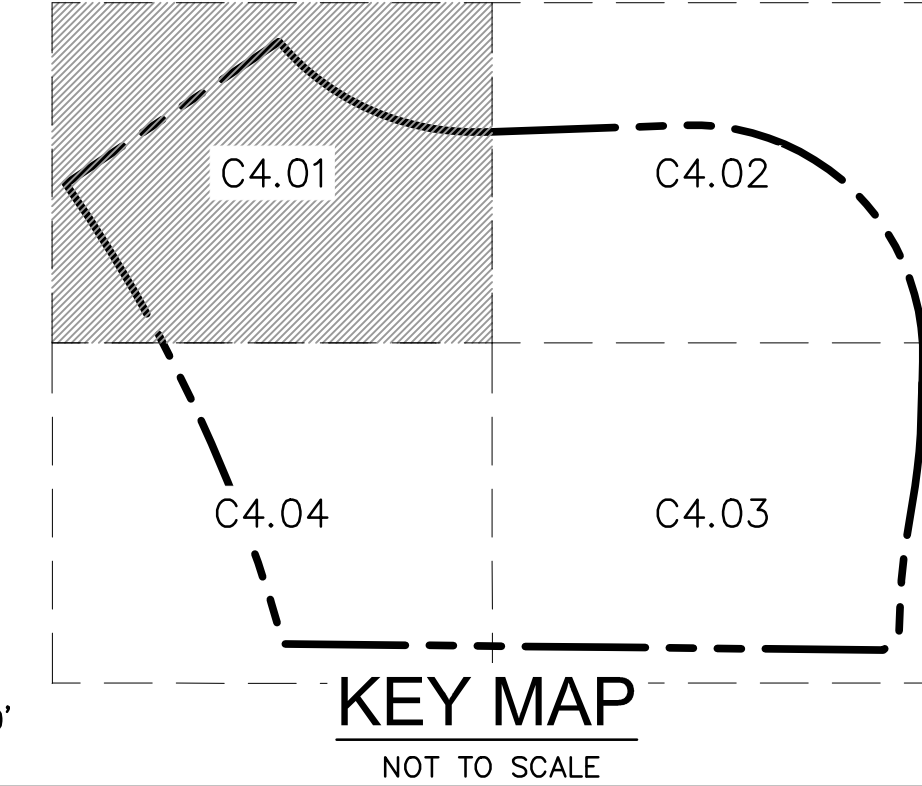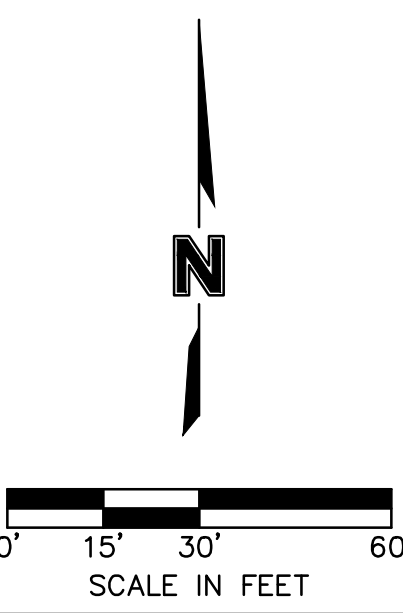

**olsson**

**SCANNELL PROPERTIES**

**MISSOURI PROFESSIONAL ENGINEER**

MITCHELL ALAN  
PE-2009016764  
7-7-24

REV.	NO.	DATE	DESCRIPTION
1	12.24.2021	CITY COMMENTS	
2	03.03.2022	CITY COMMENTS	
3	03.03.2022	CITY COMMENTS	
4	03.03.2022	CITY COMMENTS	
5	03.03.2022	CITY COMMENTS	
6	03.03.2022	CITY COMMENTS	
7	03.03.2022	CITY COMMENTS	

**REVISIONS**

2021

**DIMENSION PLAN**

**PHASE 1/FINAL DEVELOPMENT PLAN**

**SCANNELL DEVELOPMENT LEE'S SUMMIT LOGISTICS**

**NORTHWEST CORNER OF TUDOR ROAD AND MAIN STREET**

**LEE'S SUMMIT, MISSOURI**

drawn by: OLSSON  
checked by: ENG  
approved by: ENG  
project no.: 021-04157  
drawing no.: 021-04157  
date:

**SHEET C4.01**







DWG: F:\2021\04001-04500\021-04157\40-design\AutoCAD\final plans\Sheets\GNCV\PHASE I\NC\_GRD02\_02104157.dwg USER: sgillard  
DATE: Jul 07, 2022 8:36am XREFS: C:\BASE\_02104157 C:\BLK\_02104157 C:\BASE\_02104157



**LEGEND**


---	PROPERTY LINE
---	SURROUNDING PROPERTY LINES
---	UTILITY EASEMENT
---	PROPOSED CONTOURS
---	EXISTING CONTOURS
---	GRADE BREAK LINE
---	RIDGE LINE
---	VALLEY LINE
(X)	GRADING DETAIL LOCATIONS (SHEETS C5.05-C5.07)

**SPOT ELEVATION LEGEND:**


ALL SPOT ELEVATIONS ARE TOP OF PAVEMENT ELEVATION UNLESS NOTED OTHERWISE. RE: PLAN VIEW, LEGEND AND DETAILS FOR CURB TYPE AND TO CALCULATE TOP OF CURB ELEVATION.

TC	TOP OF CURB
FG	FINISHED GRADE WITHIN GREENSPACE
TS	TOP OF STRUCTURE
FC	CURB DEPRESSED TO BE FLUSH WITH ADJACENT PAVEMENT
HP	HIGH POINT
LP	LOW POINT
ME±	MATCH EXISTING
FFE	FINISH FLOOR ELEVATION AT TOP OF SLAB
HFG	HIGH FINISHED GRADE
LFG	LOW FINISHED GRADE

- NOTES:**
- CONTRACTOR TO REMOVE AND REPLACE ALL SIDEWALK NECESSARY FOR CONNECTION TO EXISTING.
  - ALL ADA ACCESSIBLE SIDEWALK CROSS SLOPES SHALL HAVE A MAXIMUM CROSS SLOPE OF 2.00% AND MAXIMUM LONGITUDINAL SLOPE OF 5.00%.
  - ALL ADA ACCESSIBLE PARKING AREAS SHALL NOT EXCEED 2.00% IN ANY DIRECTION.
  - CONTRACTOR TO PROVIDE FLAT A/C UNIT PADS FOR ALL A/C UNITS.
  - NO GRADES SHALL EXCEED 5:1 UNLESS OTHERWISE NOTES.
  - GRADING AND STORM SEWER IMPROVEMENTS SHALL BE STAKED, INCLUDING ALL HIGH POINTS AND KEY GRADE BREAKS.

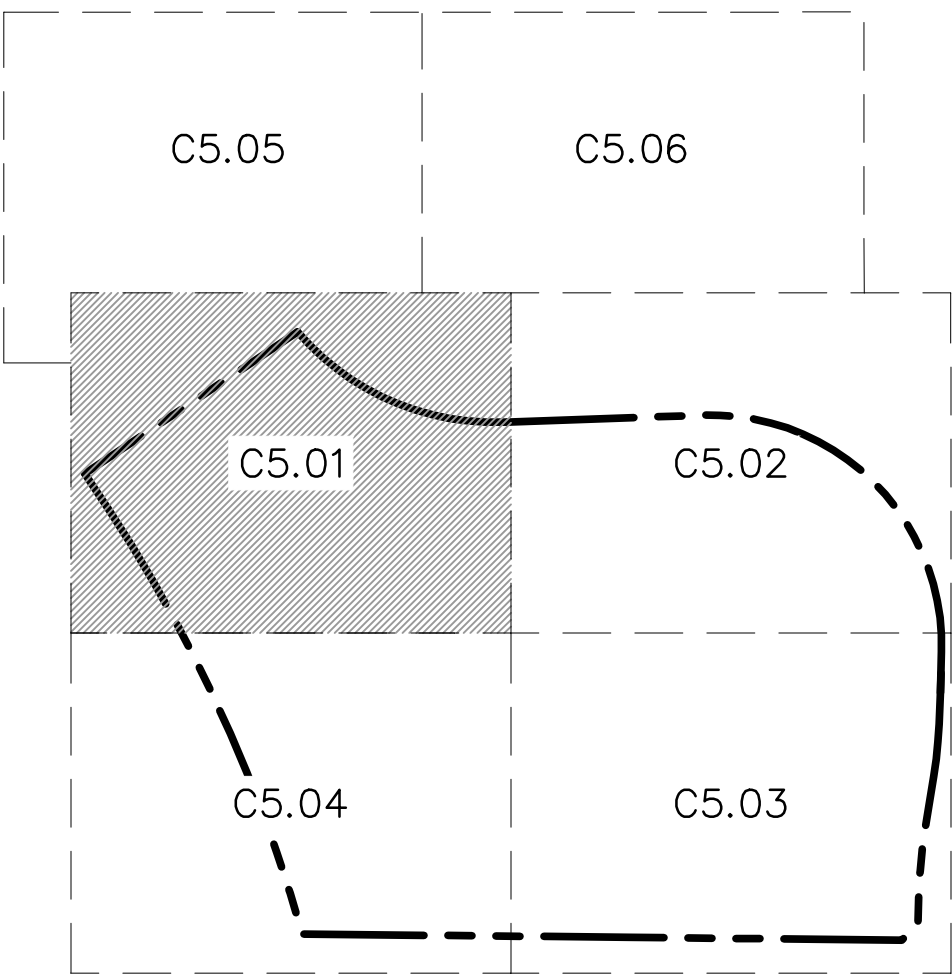

**KEY MAP**  
NOT TO SCALE

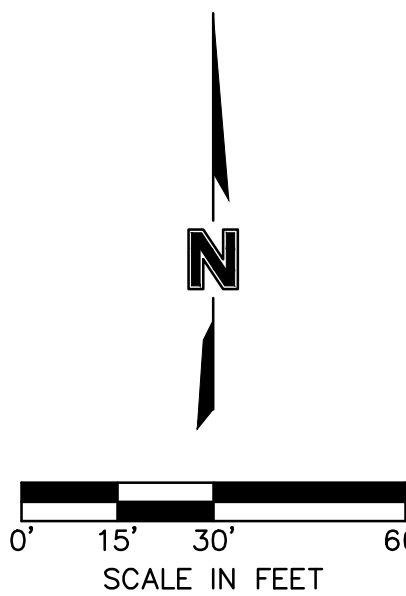

7301 West 133rd Street, Suite 200  
Overland Park, KS 66213-7756  
TEL 913.381.1170  
www.olsson.com

SCANNELL PROPERTIES

MITCHELL ALAN SCANNELL  
PROFESSIONAL ENGINEER  
NO. 2009016764  
STATE OF MISSOURI

REV. NO.	DATE	REVISIONS DESCRIPTION	BY
1	12/28/2021	CITY COMMENTS	
2	01/05/2022	CITY COMMENTS AND OWNER CHANGES	
3	02/03/2022	CITY & OWNER COMMENTS	
4	02/24/2022	CITY COMMENTS	
5	03/12/2022	OWNER & MEP COMMENTS & SHOPS	
6	03/12/2022	OWNER & MEP COMMENTS & SHOPS	
7	07/06/2022	ZONING T CHANGES	

GRADING PLAN  
PHASE I FINAL DEVELOPMENT PLAN

SCANNELL DEVELOPMENT LEE'S SUMMIT LOGISTICS  
NORTHWEST CORNER OF TUDOR ROAD AND MAIN STREET

LEE'S SUMMIT, MISSOURI

drawn by: OLSSON  
checked by: ENG  
approved by: ENG  
QA/QC by: ENG  
project no.: 021-04157  
drawing no.: GGRD02\_02104157.dwg  
date:


SHEET  
C5.01

2021

REVISIONS



DWG: F:\2021\04001-04500\021-04157\40-design\AutoCAD\final plans\Sheets\GNCV\PHASE 1\NC\_GRD02\_02104157.dwg USER: sgillard  
DATE: Jul 07, 2022 8:36am XREFS: C:\PBASE\_02104157 C:\PBASE\_02104157 C:\PBASE\_02104157 C:\PBASE\_02104157

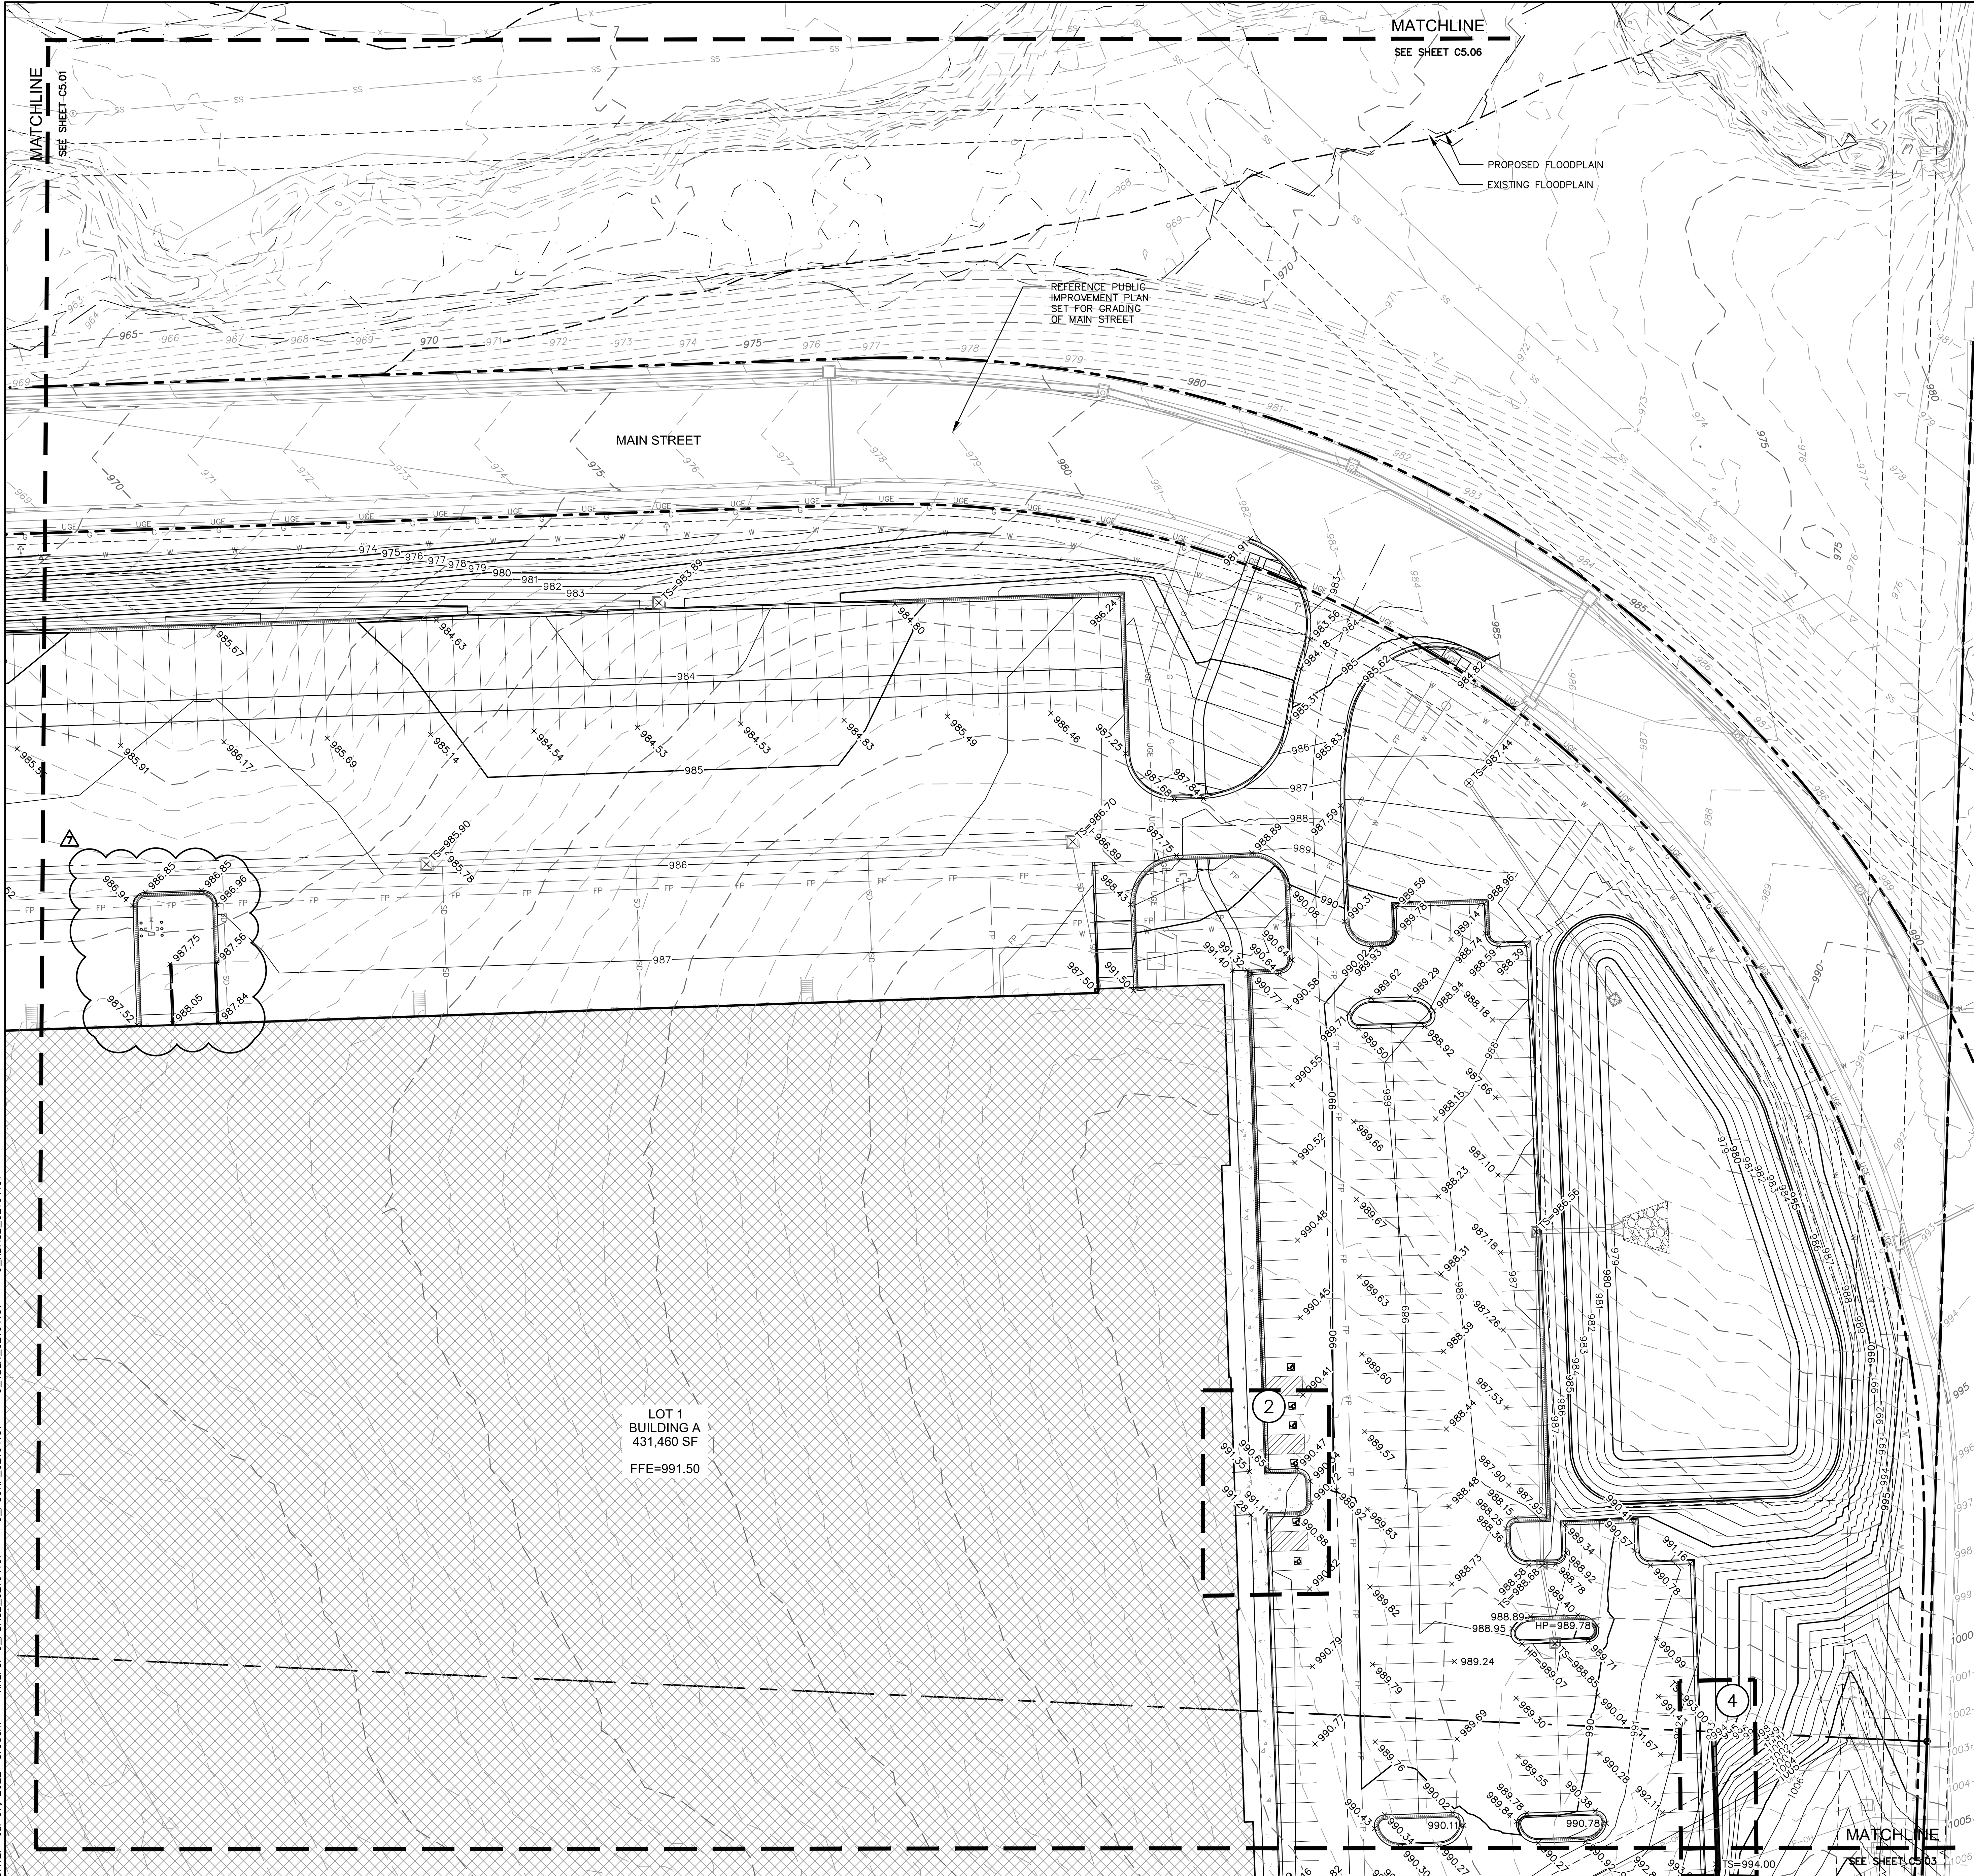

LEGEND	
	PROPERTY LINE
	SURROUNDING PROPERTY LINES
	UTILITY EASEMENT
	PROPOSED CONTOURS
	EXISTING CONTOURS
	GRADE BREAK LINE
	RIDGE
	VALLEY
	GRADING DETAIL LOCATIONS (SHEETS C5.05-C5.07)



#### SPOT ELEVATION LEGEND:

ALL SPOT ELEVATIONS ARE TOP OF PAVEMENT ELEVATION UNLESS NOTED OTHERWISE. RE: PLAN VIEW, LEGEND AND DETAILS FOR CURB TYPE AND TO CALCULATE TOP OF CURB ELEVATION.

TC	TOP OF CURB
FG	FINISHED GRADE WITHIN GREENSPACE
TS	TOP OF STRUCTURE
FC	CURB DEPRESSED TO BE FLUSH WITH ADJACENT PAVEMENT
HP	HIGH POINT
LP	LOW POINT
ME±	MATCH EXISTING
FFE	FINISH FLOOR ELEVATION AT TOP OF SLAB
HFG	HIGH FINISHED GRADE
LFG	LOW FINISHED GRADE

#### NOTES:

- CONTRACTOR TO REMOVE AND REPLACE ALL SIDEWALK NECESSARY FOR CONNECTION TO EXISTING.
- ALL ADA ACCESSIBLE SIDEWALK CROSS SLOPES SHALL HAVE A MAXIMUM CROSS SLOPE OF 2.00% AND MAXIMUM LONGITUDINAL SLOPE OF 5.00%.
- ALL ADA ACCESSIBLE PARKING AREAS SHALL NOT EXCEED 5:1 UNLESS OTHERWISE NOTES.
- CONTRACTOR TO PROVIDE FLAT A/C UNIT PADS FOR ALL A/C UNITS.
- NO GRADES SHALL EXCEED 5:1 UNLESS OTHERWISE NOTES.
- GRADING AND STORM SEWER IMPROVEMENTS SHALL BE STAKED, INCLUDING ALL HIGH POINTS AND KEY GRADE BREAKS.

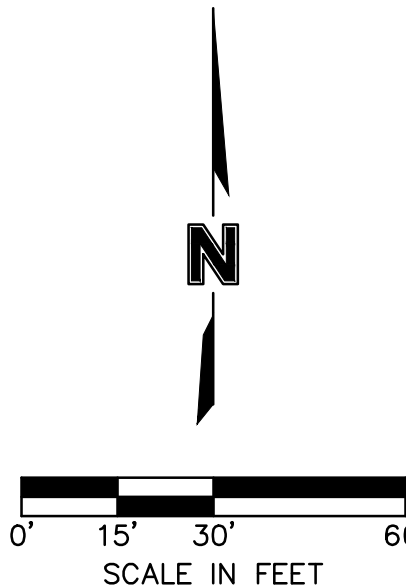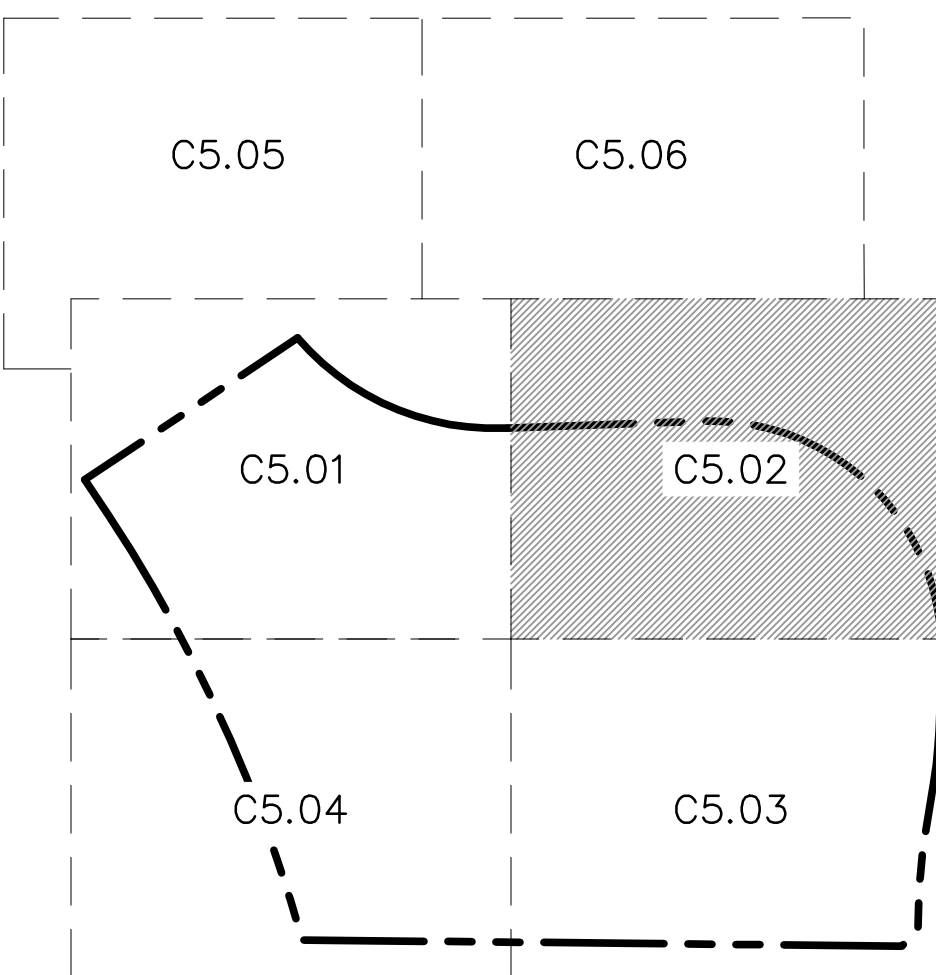

REV. NO.	DATE	REVISIONS DESCRIPTION	BY
1	12-28-2021	CITY COMMENTS	
2	01-05-2022	CITY COMMENTS AND OWNER CHANGES	
3	03-03-2022	CITY & EVERY COMMENTS	
4	02-24-2022	CITY COMMENTS	
5	03-12-2022	EVERY & MEP COMMENTS & SHOPS	
6	04-12-2022	EVERY & MEP COMMENTS & SHOPS	
7	07-06-2022	ZONING CHANGES	

GRADING PLAN  
PHASE I FINAL DEVELOPMENT PLAN


SCANNELL DEVELOPMENT LEE'S SUMMIT LOGISTICS  
NORTHWEST CORNER OF TUDOR ROAD AND MAIN STREET  
LEE'S SUMMIT, MISSOURI

drawn by: OLSSON  
checked by: ENG  
approved by: ENG  
checked by: ENG  
project no.: 021-04157  
drawing no.: GGRD02\_02104157.dwg  
date:


2021

SHEET  
C5.02



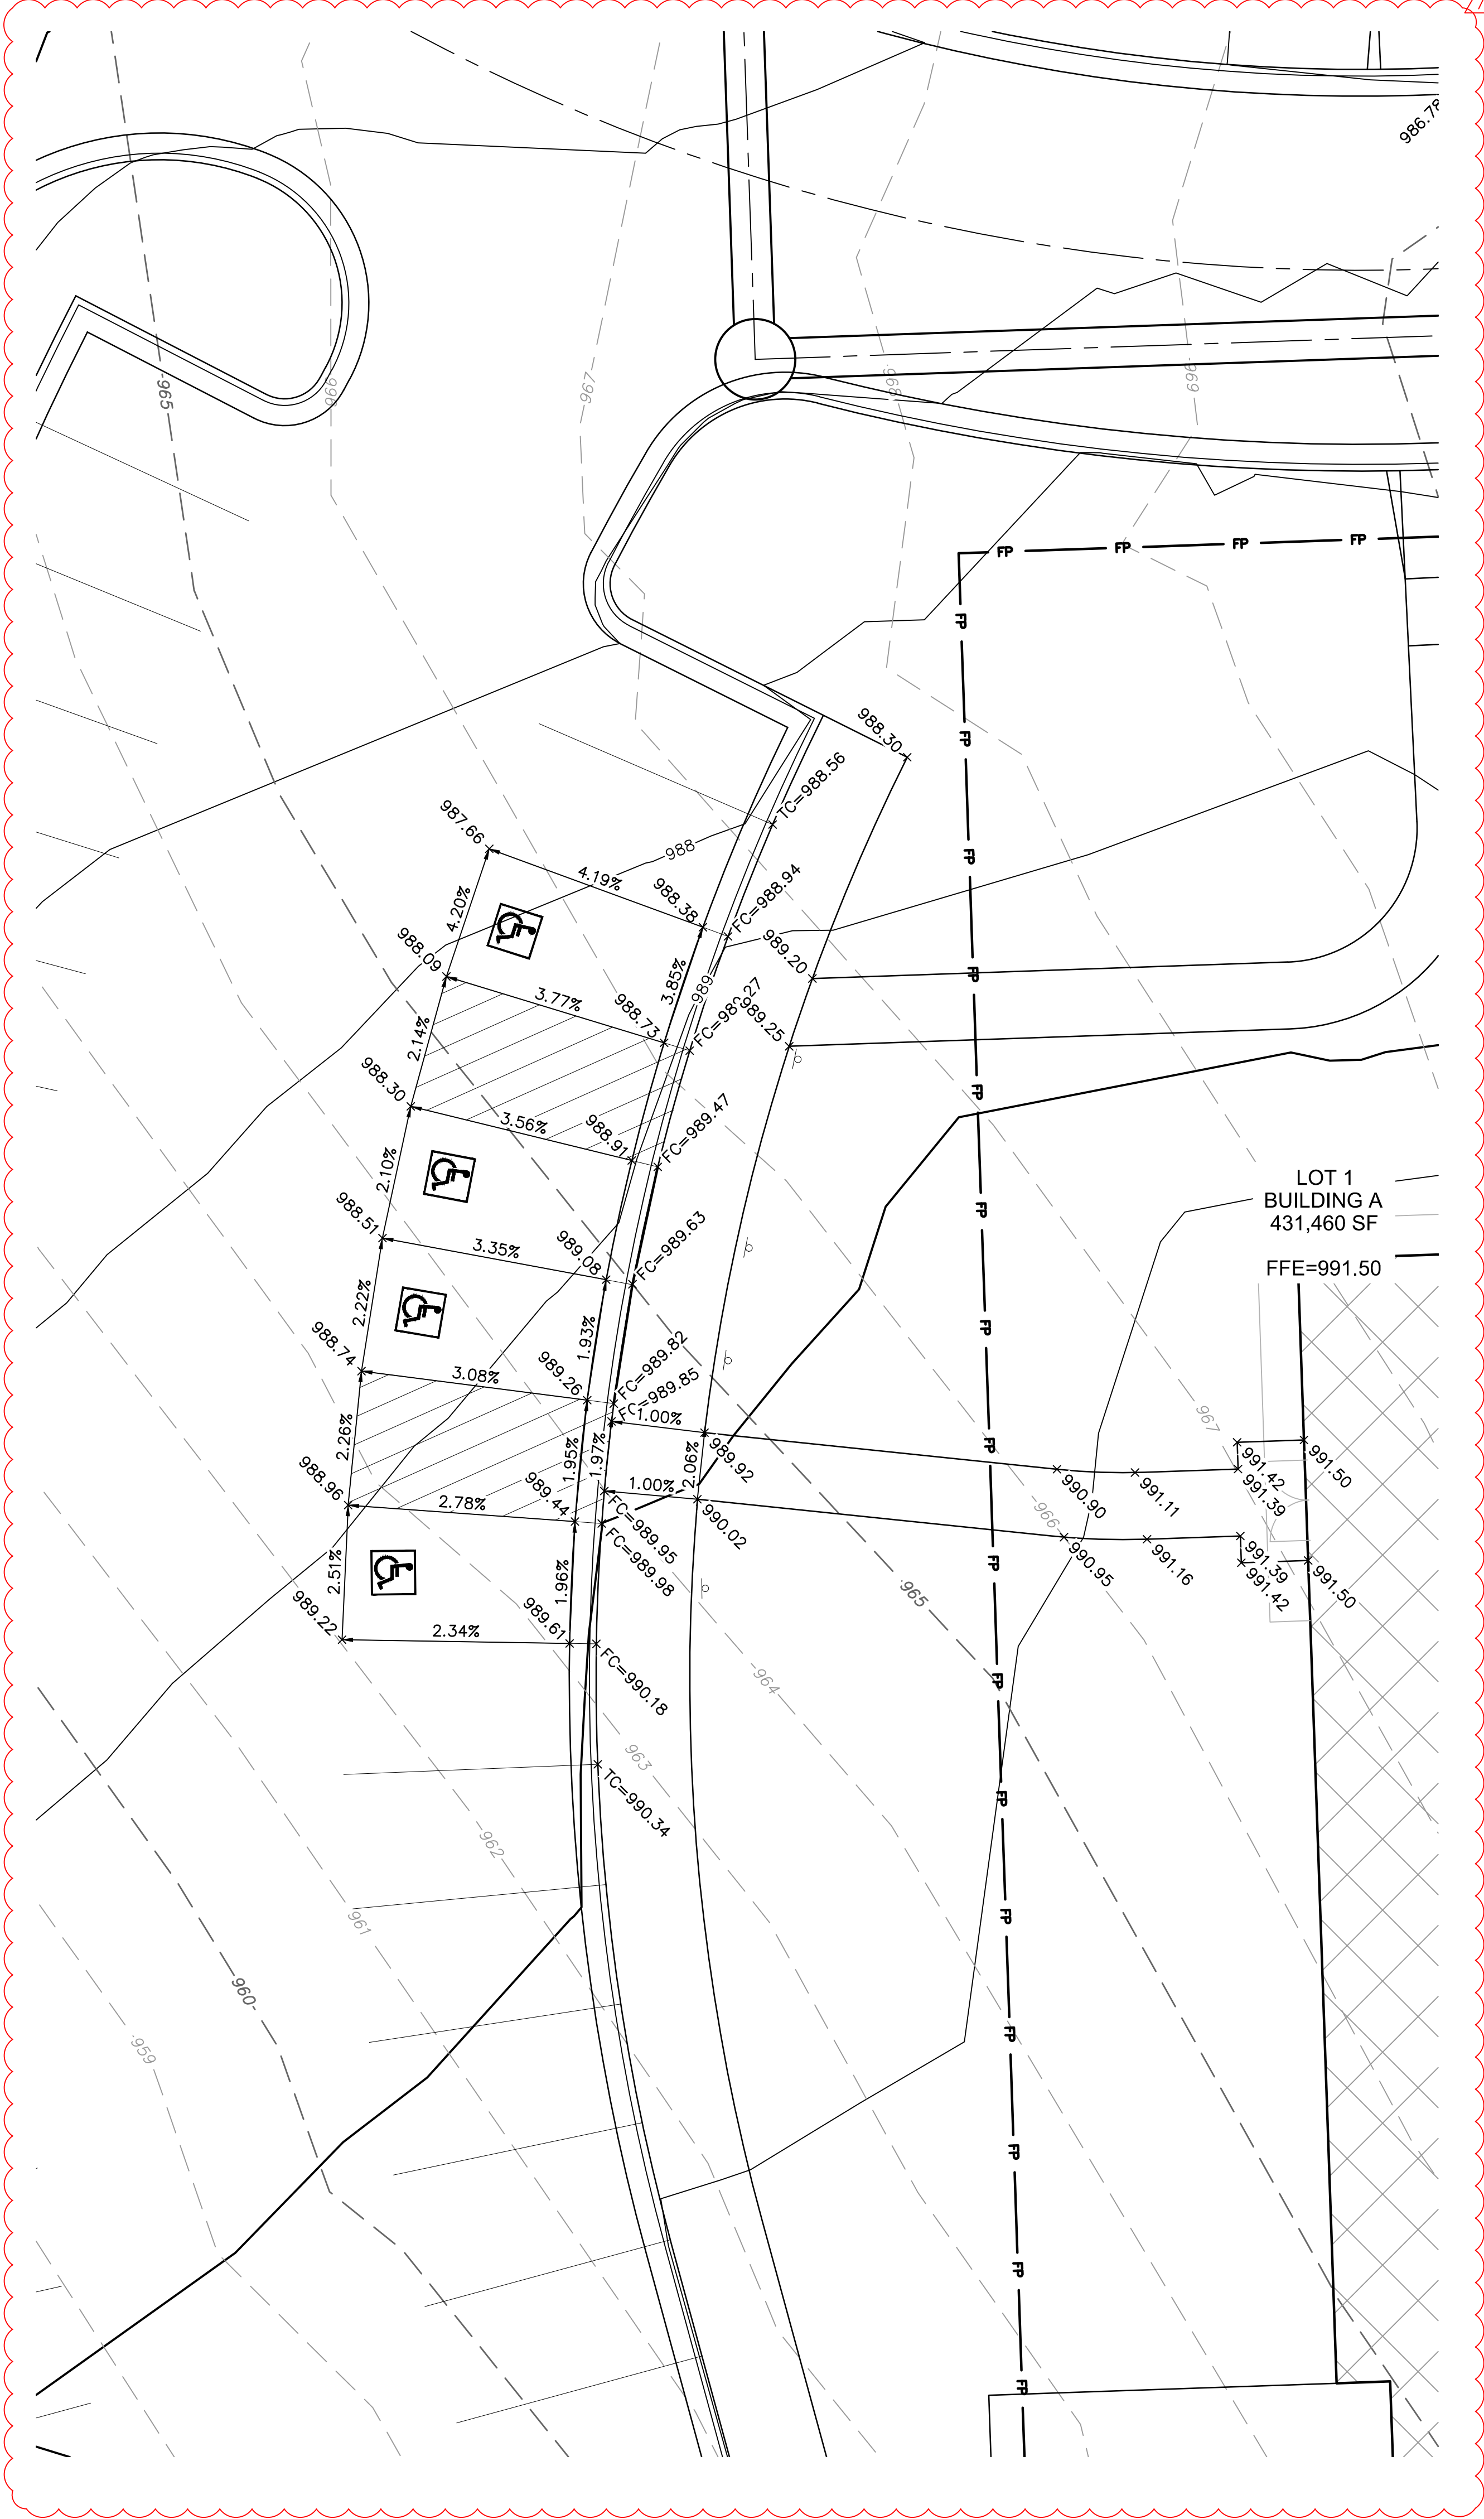

1 GRADING DETAIL

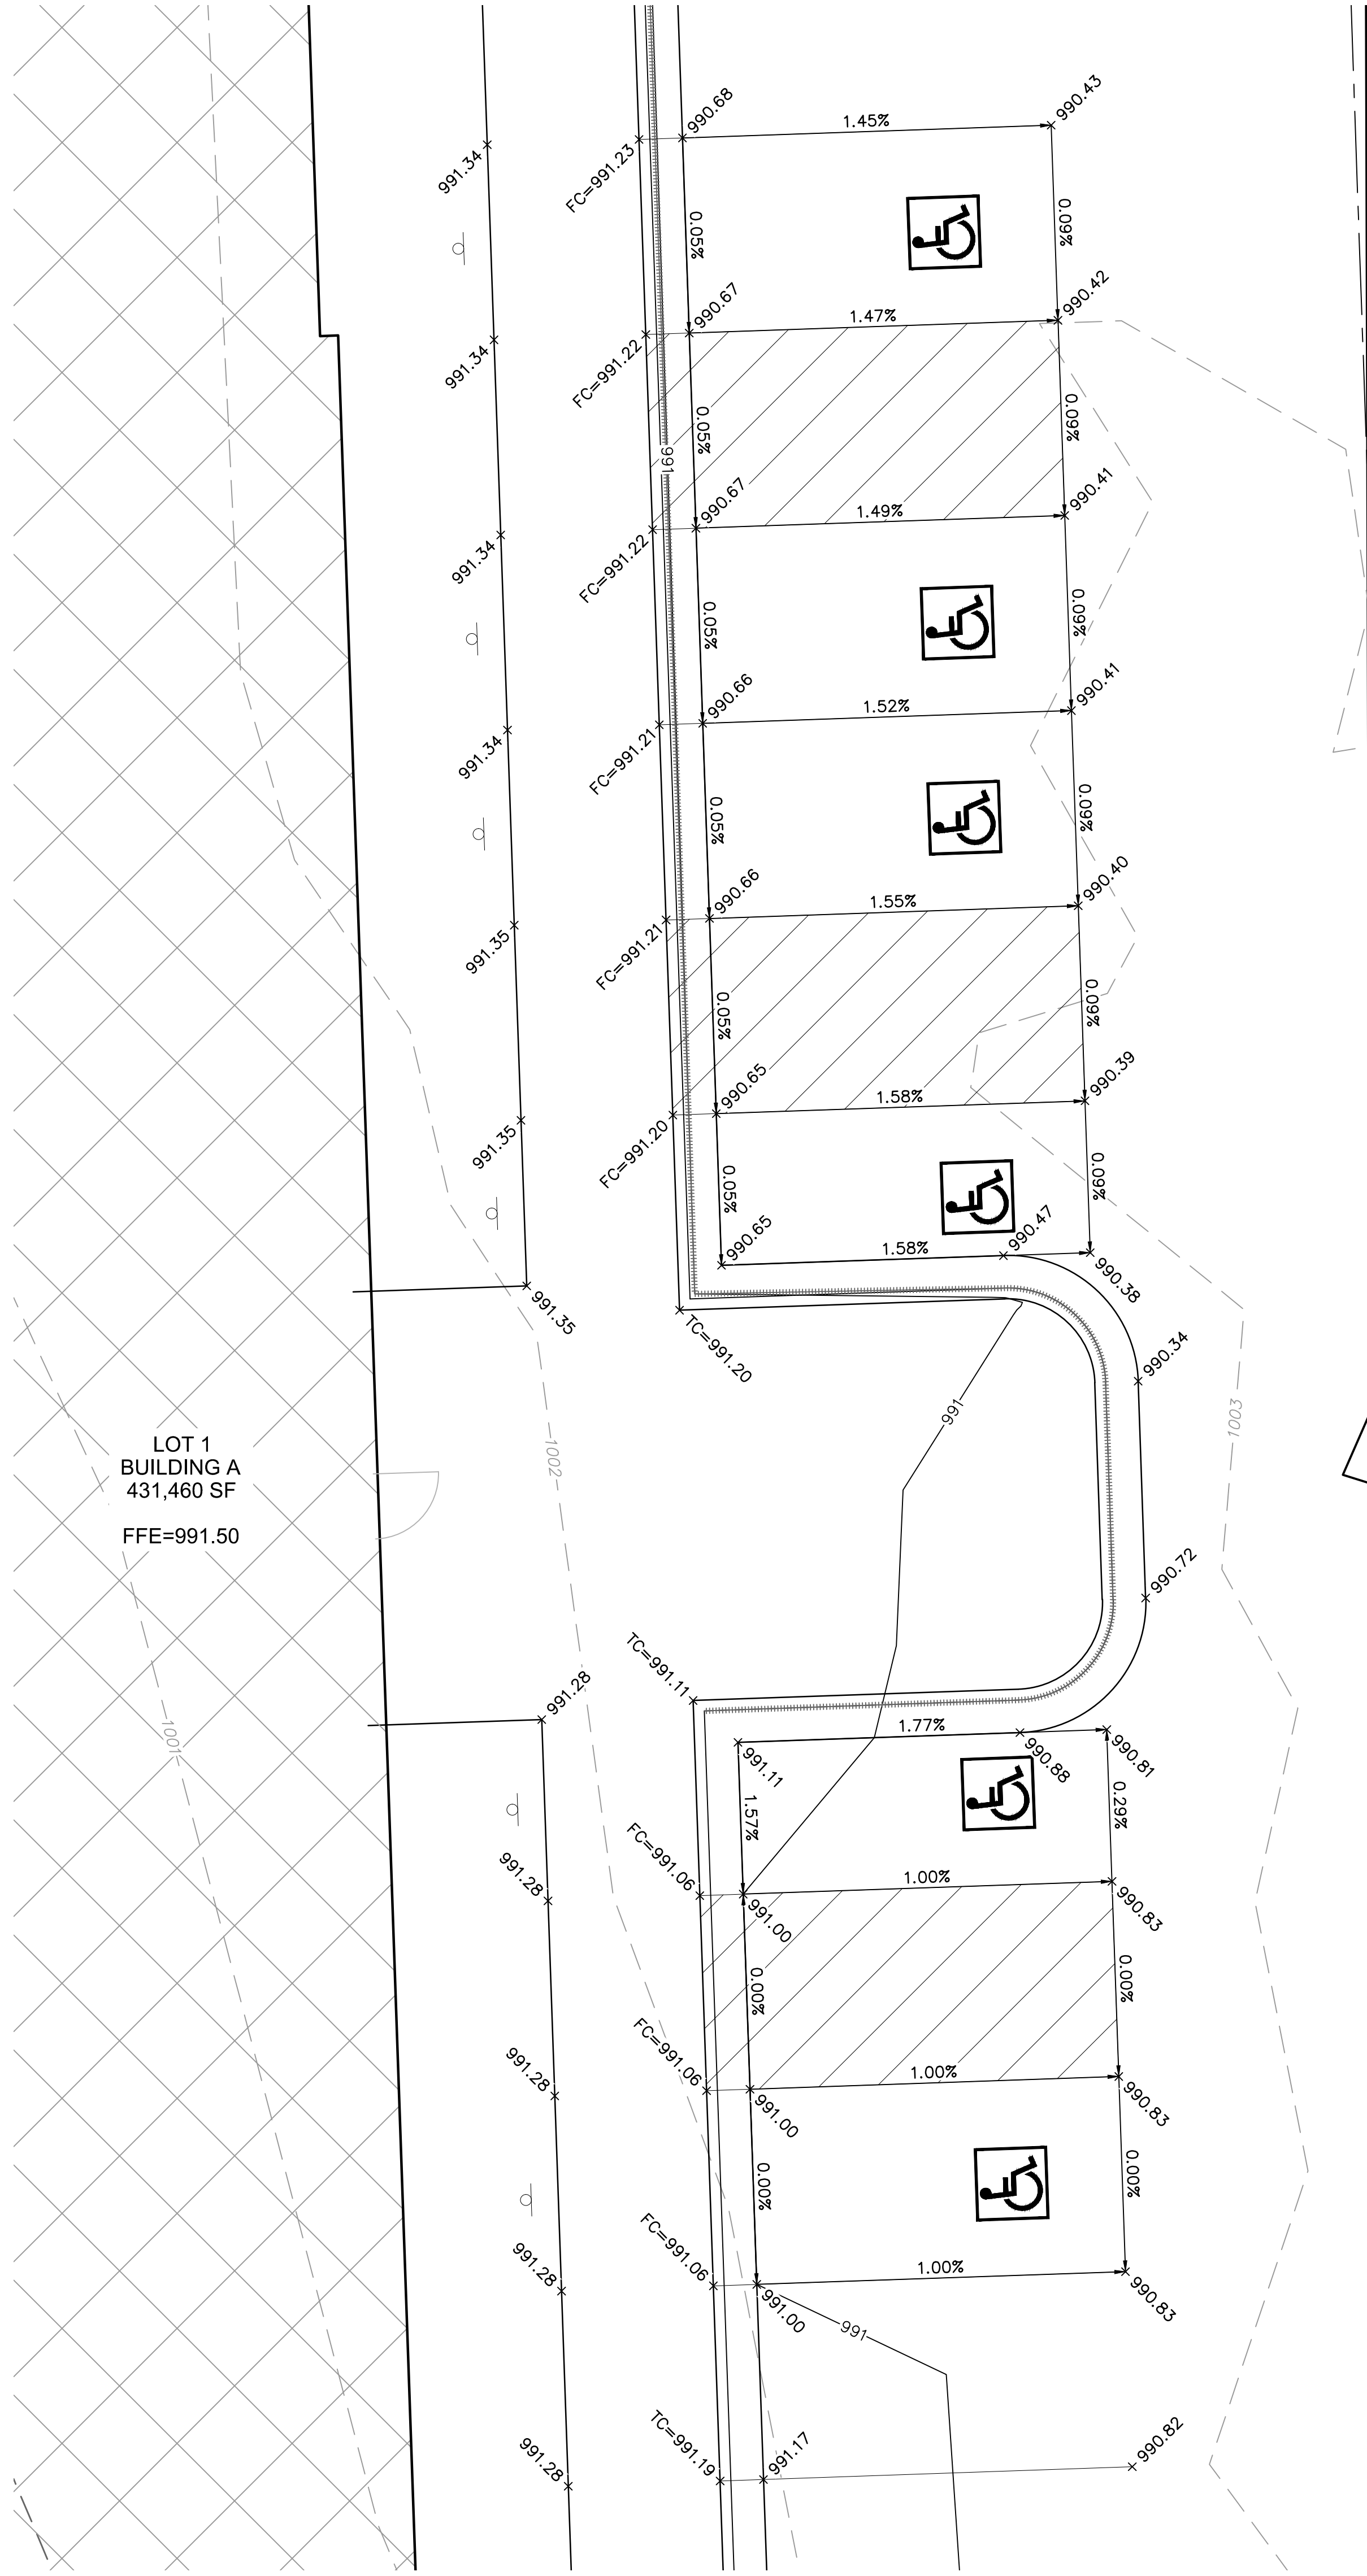


2 GRADING DETAIL


- LEGEND**
- |     |  |
|-----|--|
| --- | PROPERTY LINE                                  |
| --- | SURROUNDING PROPERTY LINES                     |
| --- | UTILITY EASEMENT                               |
| --- | PROPOSED CONTOURS                              |
| --- | EXISTING CONTOURS                              |
| --- | GRADE BREAK LINE                               |
| --- | RIDGE  |
| --- | RIDGE LINE                                     |
| --- | VALLEY   |
| --- | VALLEY LINE                                    |
| (X) | GRADING DETAIL LOCATIONS<br>(SHEETS C509-C515) |

- SPOT ELEVATION LEGEND:**
- ALL SPOT ELEVATIONS ARE TOP OF PAVEMENT ELEVATION UNLESS NOTED OTHERWISE. RE: PLAN VIEW, LEGEND AND DETAILS FOR CURB TYPE AND TO CALCULATE TOP OF CURB ELEVATION.
- |     |   |
|-----|---|
| TC  | TOP OF CURB                                       |
| FG  | FINISHED GRADE WITHIN GREENSPACE                  |
| TS  | TOP OF STRUCTURE                                  |
| FC  | CURB DEPRESSED TO BE FLUSH WITH ADJACENT PAVEMENT |
| HP  | HIGH POINT  |
| LP  | LOW POINT   |
| ME± | MATCH EXISTING                                    |
| FFE | FINISH FLOOR ELEVATION AT TOP OF SLAB             |
| HFG | HIGH FINISHED GRADE                               |
| LFG | LOW FINISHED GRADE                                |

- NOTES:**
- CONTRACTOR TO REMOVE AND REPLACE ALL SIDEWALK NECESSARY FOR CONNECTION TO EXISTING.
  - ALL ADA ACCESSIBLE SIDEWALK CROSS SLOPES SHALL HAVE A MAXIMUM CROSS SLOPE OF 2.00% AND MAXIMUM LONGITUDINAL SLOPE OF 5.00%.
  - ALL ADA ACCESSIBLE PARKING AREAS SHALL NOT EXCEED 2.00% IN ANY DIRECTION.
  - CONTRACTOR TO PROVIDE FLAT A/C UNIT PADS FOR ALL A/C UNITS.
  - NO GRADES SHALL EXCEED 5:1 UNLESS OTHERWISE NOTES.
  - GRADING AND STORM SEWER IMPROVEMENTS SHALL BE STAKED, INCLUDING ALL HIGH POINTS AND KEY GRADE BREAKS.

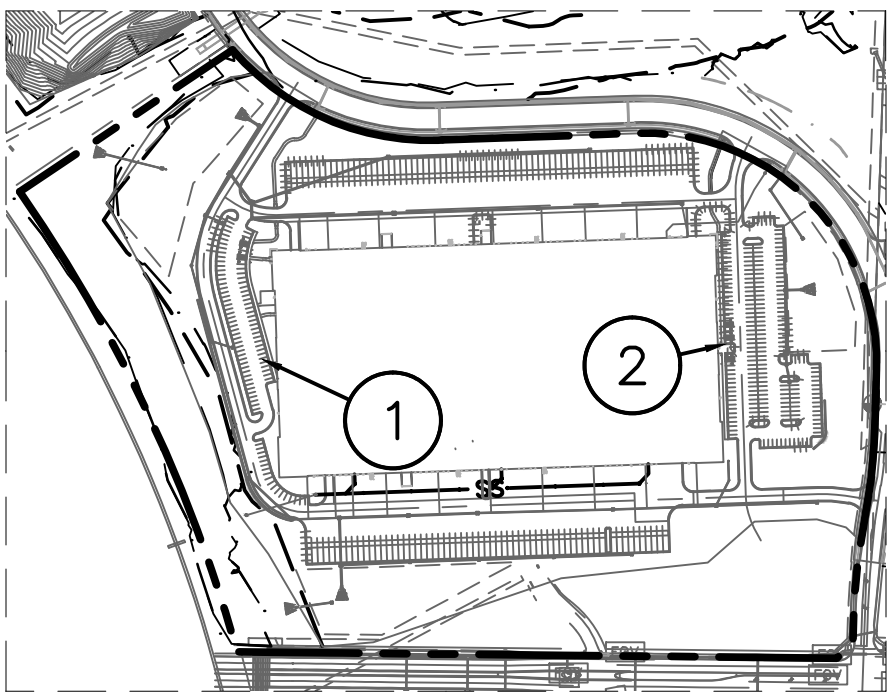


KEY MAP  
NOT TO SCALE

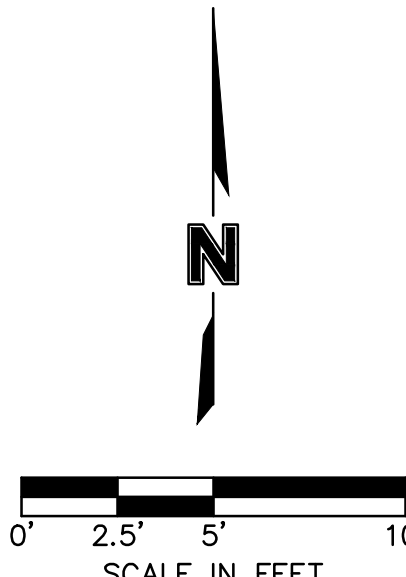

		7301 West 133rd Street, Suite 200 Overland Park, KS 66213-7756 TEL 913.381.1170 www.olson.com	
		SCANNELL PROPERTIES	
REV. NO.	DATE	REVISIONS DESCRIPTION	BY
1	12/24/2021	CITY COMMENTS	
2	01/11/2022	CITY COMMENTS	
3	02/03/2022	CITY & ENGINEER COMMENTS	
4	02/24/2022	CITY COMMENTS	
5	03/12/2022	OVERSEY & MFP COMMENTS & SHOPS	
6	03/12/2022	OVERSEY & MFP COMMENTS & SHOPS	
7	07/06/2022	ZONING CHANGES	
GRADING DETAIL PHASE I FINAL DEVELOPMENT PLAN SCANNELL DEVELOPMENT LEE'S SUMMIT LOGISTICS NORTHWEST CORNER OF TUDOR ROAD AND MAIN STREET LEE'S SUMMIT, MISSOURI			2021
drawn by: OLSSON checked by: ENG approved by: ENG QA/QC by: ENG project no.: 021-04157 drawing no.: GRD03_02104157.dwg date:			SHEET C5.05




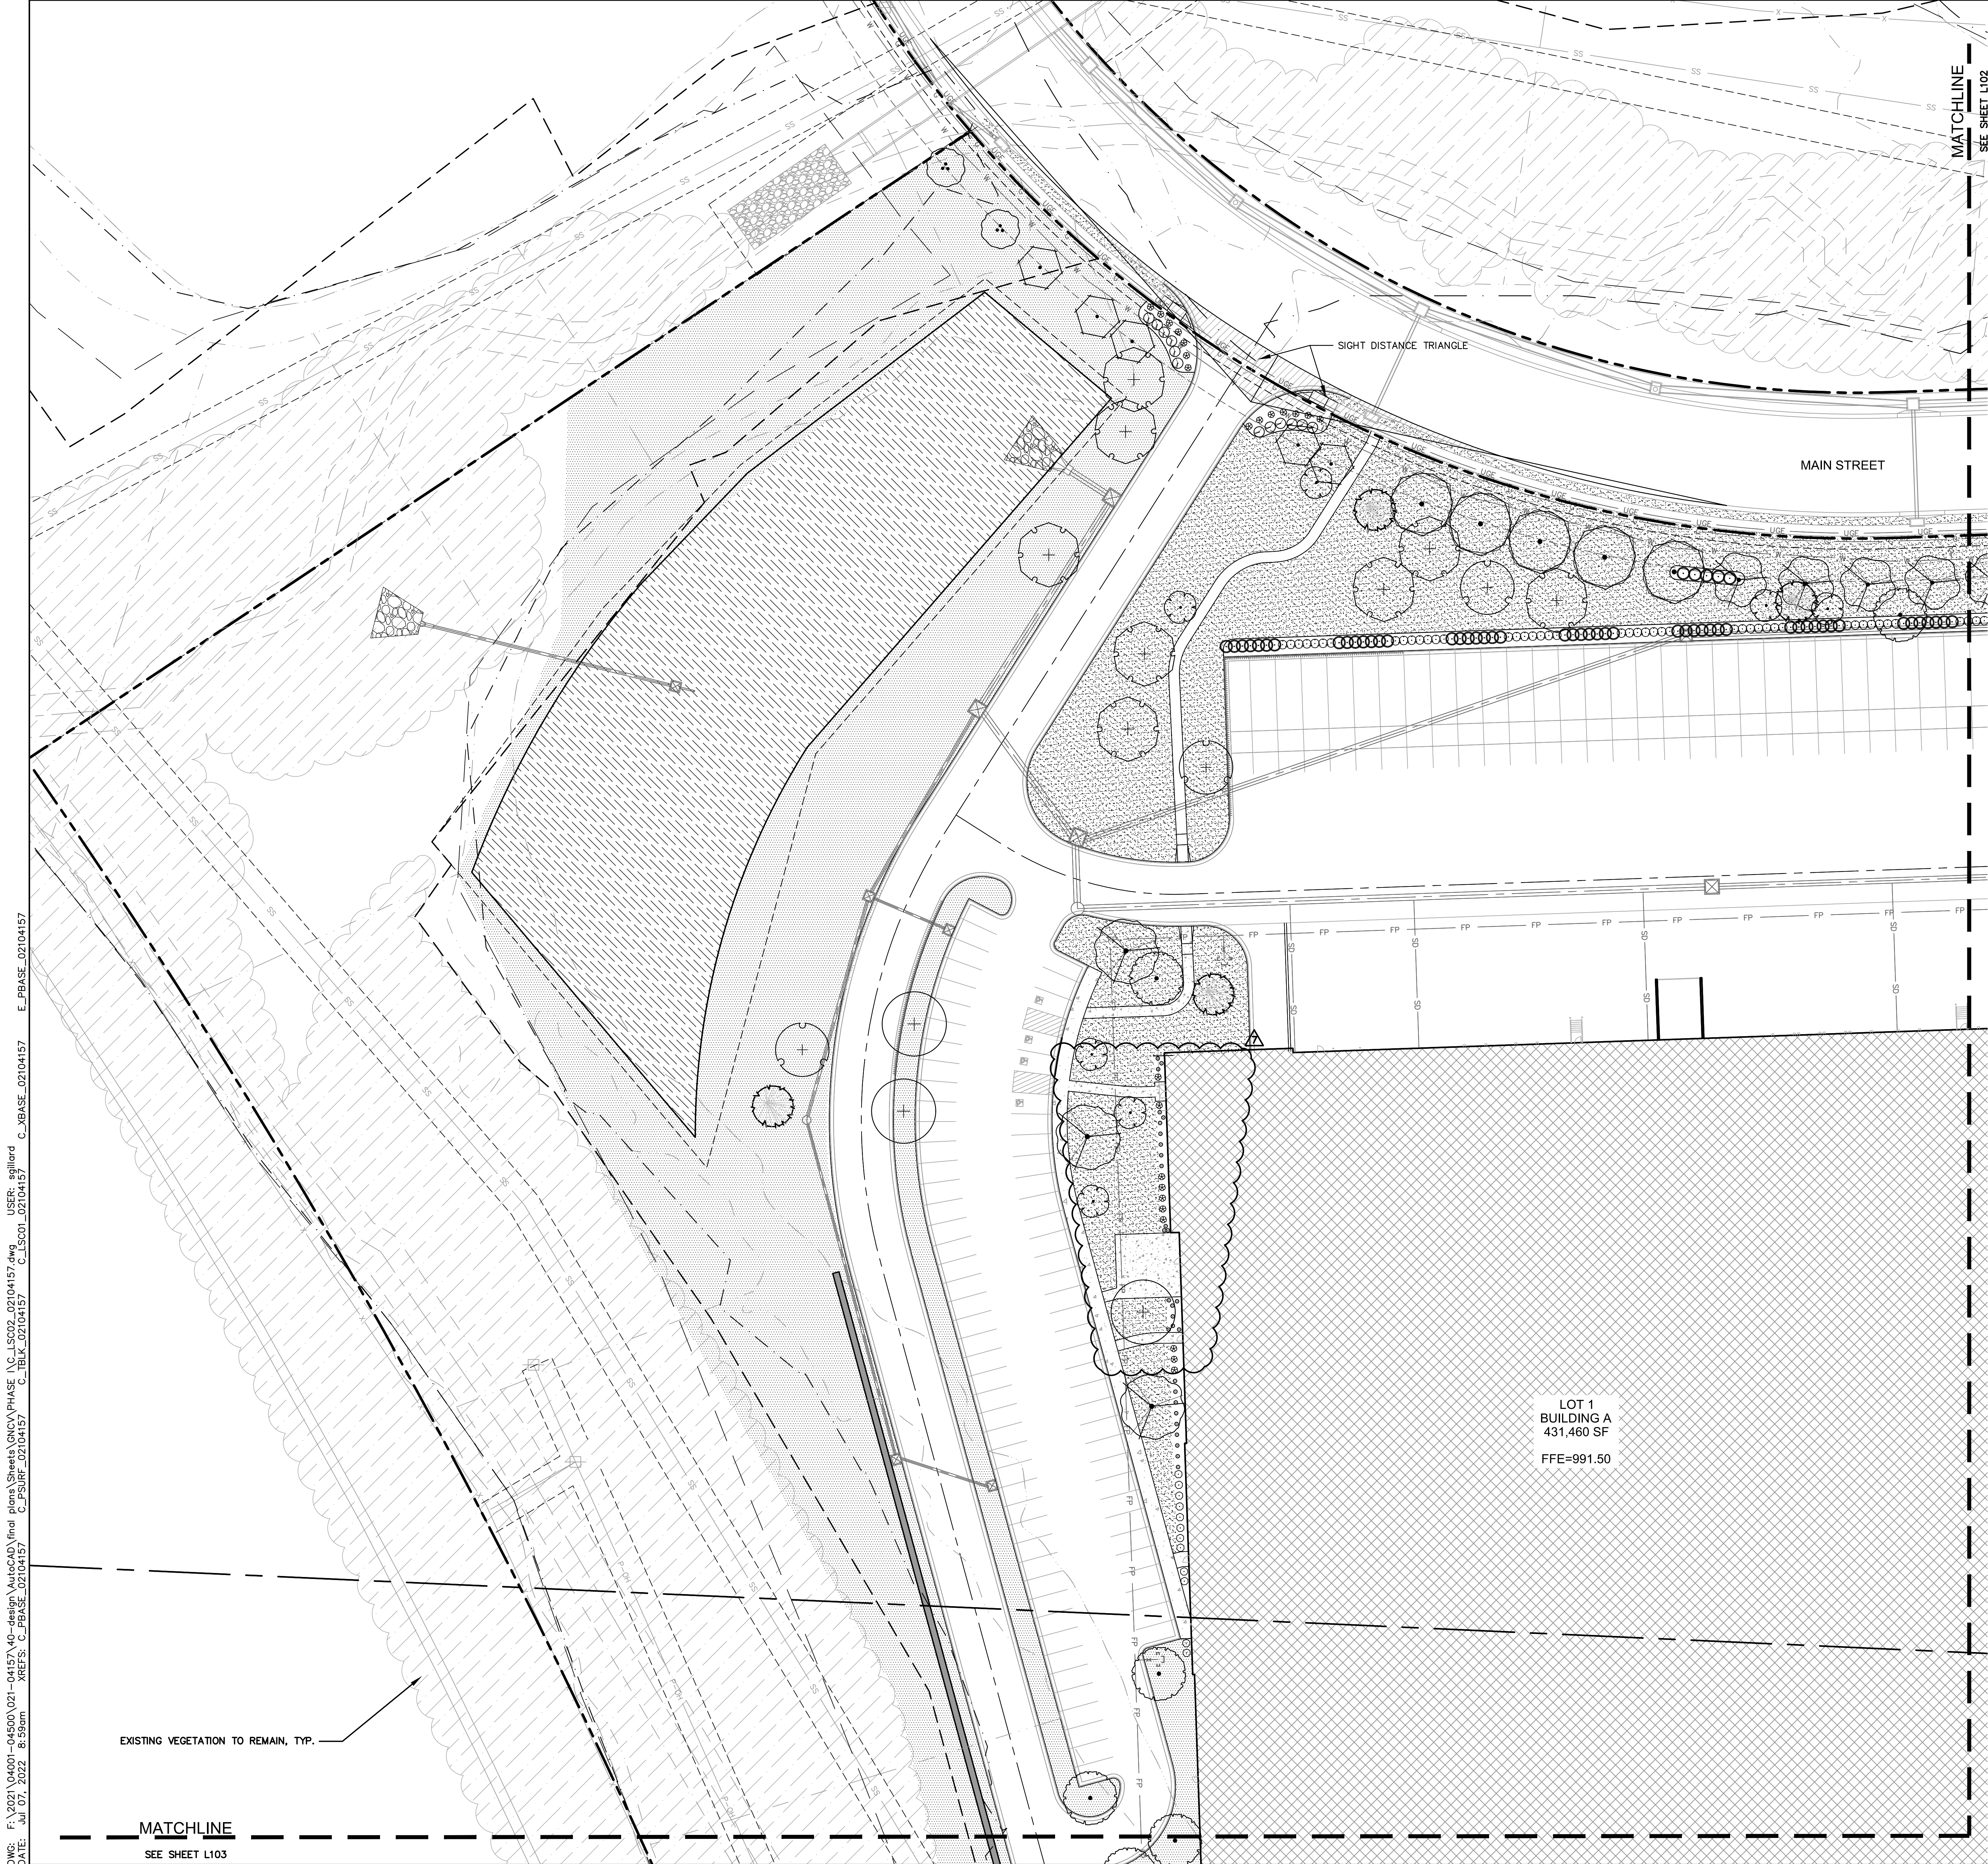


PLANT SCHEDULE L1.01		
DECIDUOUS TREES	BOTANICAL / COMMON NAME	QTY
	ACER MIYABEI 'STATE STREET' MIYABEI MAPLE	5
	EUCOMMIA ULMOIDES HARDY RUBBER TREE	3
	GLEDITSIA TRIACANTHOS INERMIS 'SHADEMASTER' SHADEMASTER LOCUST	3
	PLATANUS X ACERIFOLIA 'EXCLAMATION' TM EXCLAMATION LONDON PLANE TREE	8
	QUERCUS MACROCARPA BURR OAK	3
	QUERCUS SHUMARDII SHUMARD RED OAK	4
	TILIA AMERICANA 'BOULEVARD' BOULEVARD LINDEN	4
	ZELKOVA SERRATA 'MUSASHINO' SAWLEAF ZELKOVA	5
EVERGREEN TREES	BOTANICAL / COMMON NAME	QTY
	PICEA ABIES NORWAY SPRUCE	4
ORNAMENTAL TREES	BOTANICAL / COMMON NAME	QTY
	CERCIS CANADENSIS EASTERN REDBUD	2
	MALUS X 'PRAIRIFIRE' PRAIRIFIRE CRABAPPLE	7
SHRUBS	BOTANICAL / COMMON NAME	QTY
	BUXUS X 'GREEN VELVET' BOXWOOD	12
	DIERVILLA RIVULARIS 'KODIAK ORANGE' KODIAK ORANGE BUSH-HONEYSUCKLE	24
	JUNIPERUS CHINENSIS 'GOLD LACE' GOLD LACE JUNIPER	12
	JUNIPERUS CHINENSIS 'SEA GREEN' SEA GREEN JUNIPER	54
	PANICUM VIRGATUM 'NORTH WIND' NORTHWIND SWITCH GRASS	29
	VIBURNUM NUDUM 'WINTERTHUR' WINTERTHUR VIBURNUM	44
GROUND COVERS	BOTANICAL / COMMON NAME	QTY
	FESTUCA TURF TYPE TALL FESCUE BLEND	4,999 SF
	FESTUCA TURF TYPE TALL FESCUE BLEND	67,277 SF
NATIVE VEGETATION	BOTANICAL / COMMON NAME	QTY
	PANICUM VIRGATUM SWITCH GRASS	40,043 SF

SEE SHEET L1.0 FOR COMPLETE PLANT SCHEDULE FOR SIZE AND TOTAL QUANTITIES.

NOTE: ALL EQUIPMENT MUST BE SCREENED WHETHER OR NOT INDICATED ON PLANS. FIELD ADJUSTMENTS MAY BE NECESSARY TO ACCOMMODATE SITE CONDITIONS EQUIPMENT AND LANDSCAPE. COORDINATE WITH LANDSCAPE ARCHITECT FOR ADEQUATE SCREENING. MUST MEET CITY REQUIREMENTS.

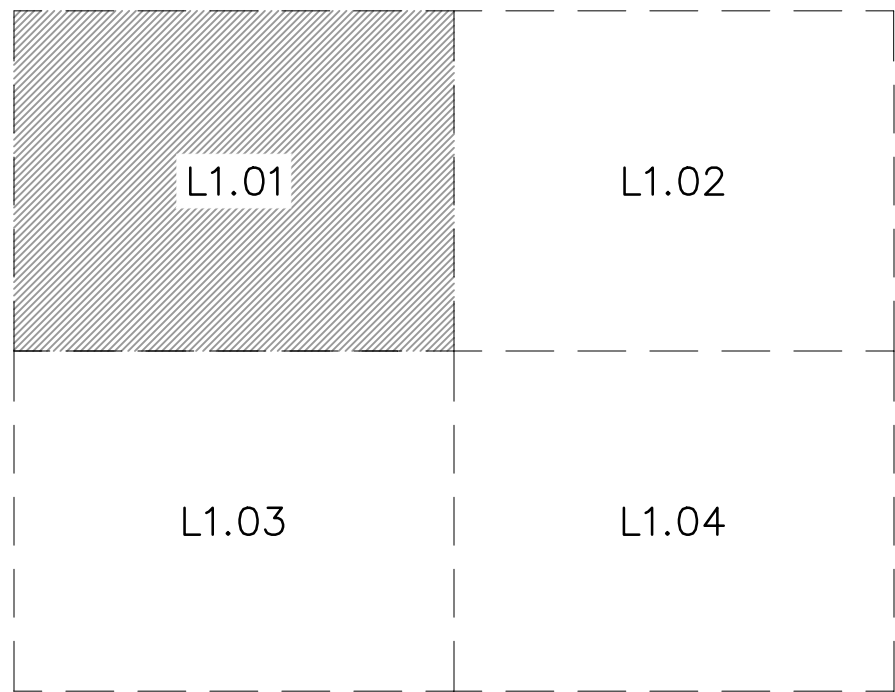

KEY MAP  
NOT TO SCALE

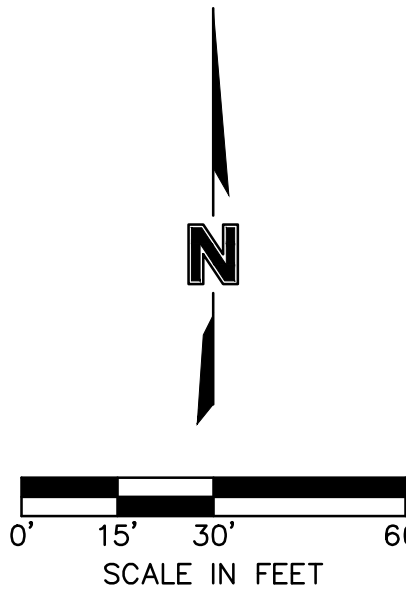

DWG: F:\2021\04001-04500\021-04157\40-design\AutoCAD\final plans\Sheets\GNV\PHASE 1\NC\_LSC02\_02104157.dwg USER: sgillard  
DATE: Jul 07, 2022 8:59am XREFS: C:\PBASE\_02104157 C:\BLK\_02104157 C:\LSC01\_02104157 C:\XBASE\_02104157

MATCHLINE  
SEE SHEET L103

EXISTING VEGETATION TO REMAIN, TYP.

LOT 1  
BUILDING A  
431,460 SF  
FFE=991.50

LANDSCAPE PLAN  
PHASE I FINAL DEVELOPMENT PLAN

SCANNELL DEVELOPMENT LEE'S SUMMIT LOGISTICS  
NORTHWEST CORNER OF TUDOR ROAD AND MAIN STREET  
LEE'S SUMMIT, MISSOURI

2021

drawn by: OLSSON  
checked by: ENG  
approved by: ENG  
QA/QC by: ENG  
project no.: 021-04157  
drawing no.: 021-S002\_02104157.dwg  
date:




REVISIONS

REV. NO.	DATE	REVISIONS DESCRIPTION
1	12/24/2021	CITY COMMENTS
2	01/05/2022	CITY COMMENTS AND OWNER CHANGES
3	02/03/2022	CITY & OWNER COMMENTS
4	02/24/2022	CITY COMMENTS
5	03/12/2022	OWNER & MEP COMMENTS & SHOPS
6	03/12/2022	OWNER & MEP COMMENTS & SHOPS
7	07/06/2022	ZONING CHANGES







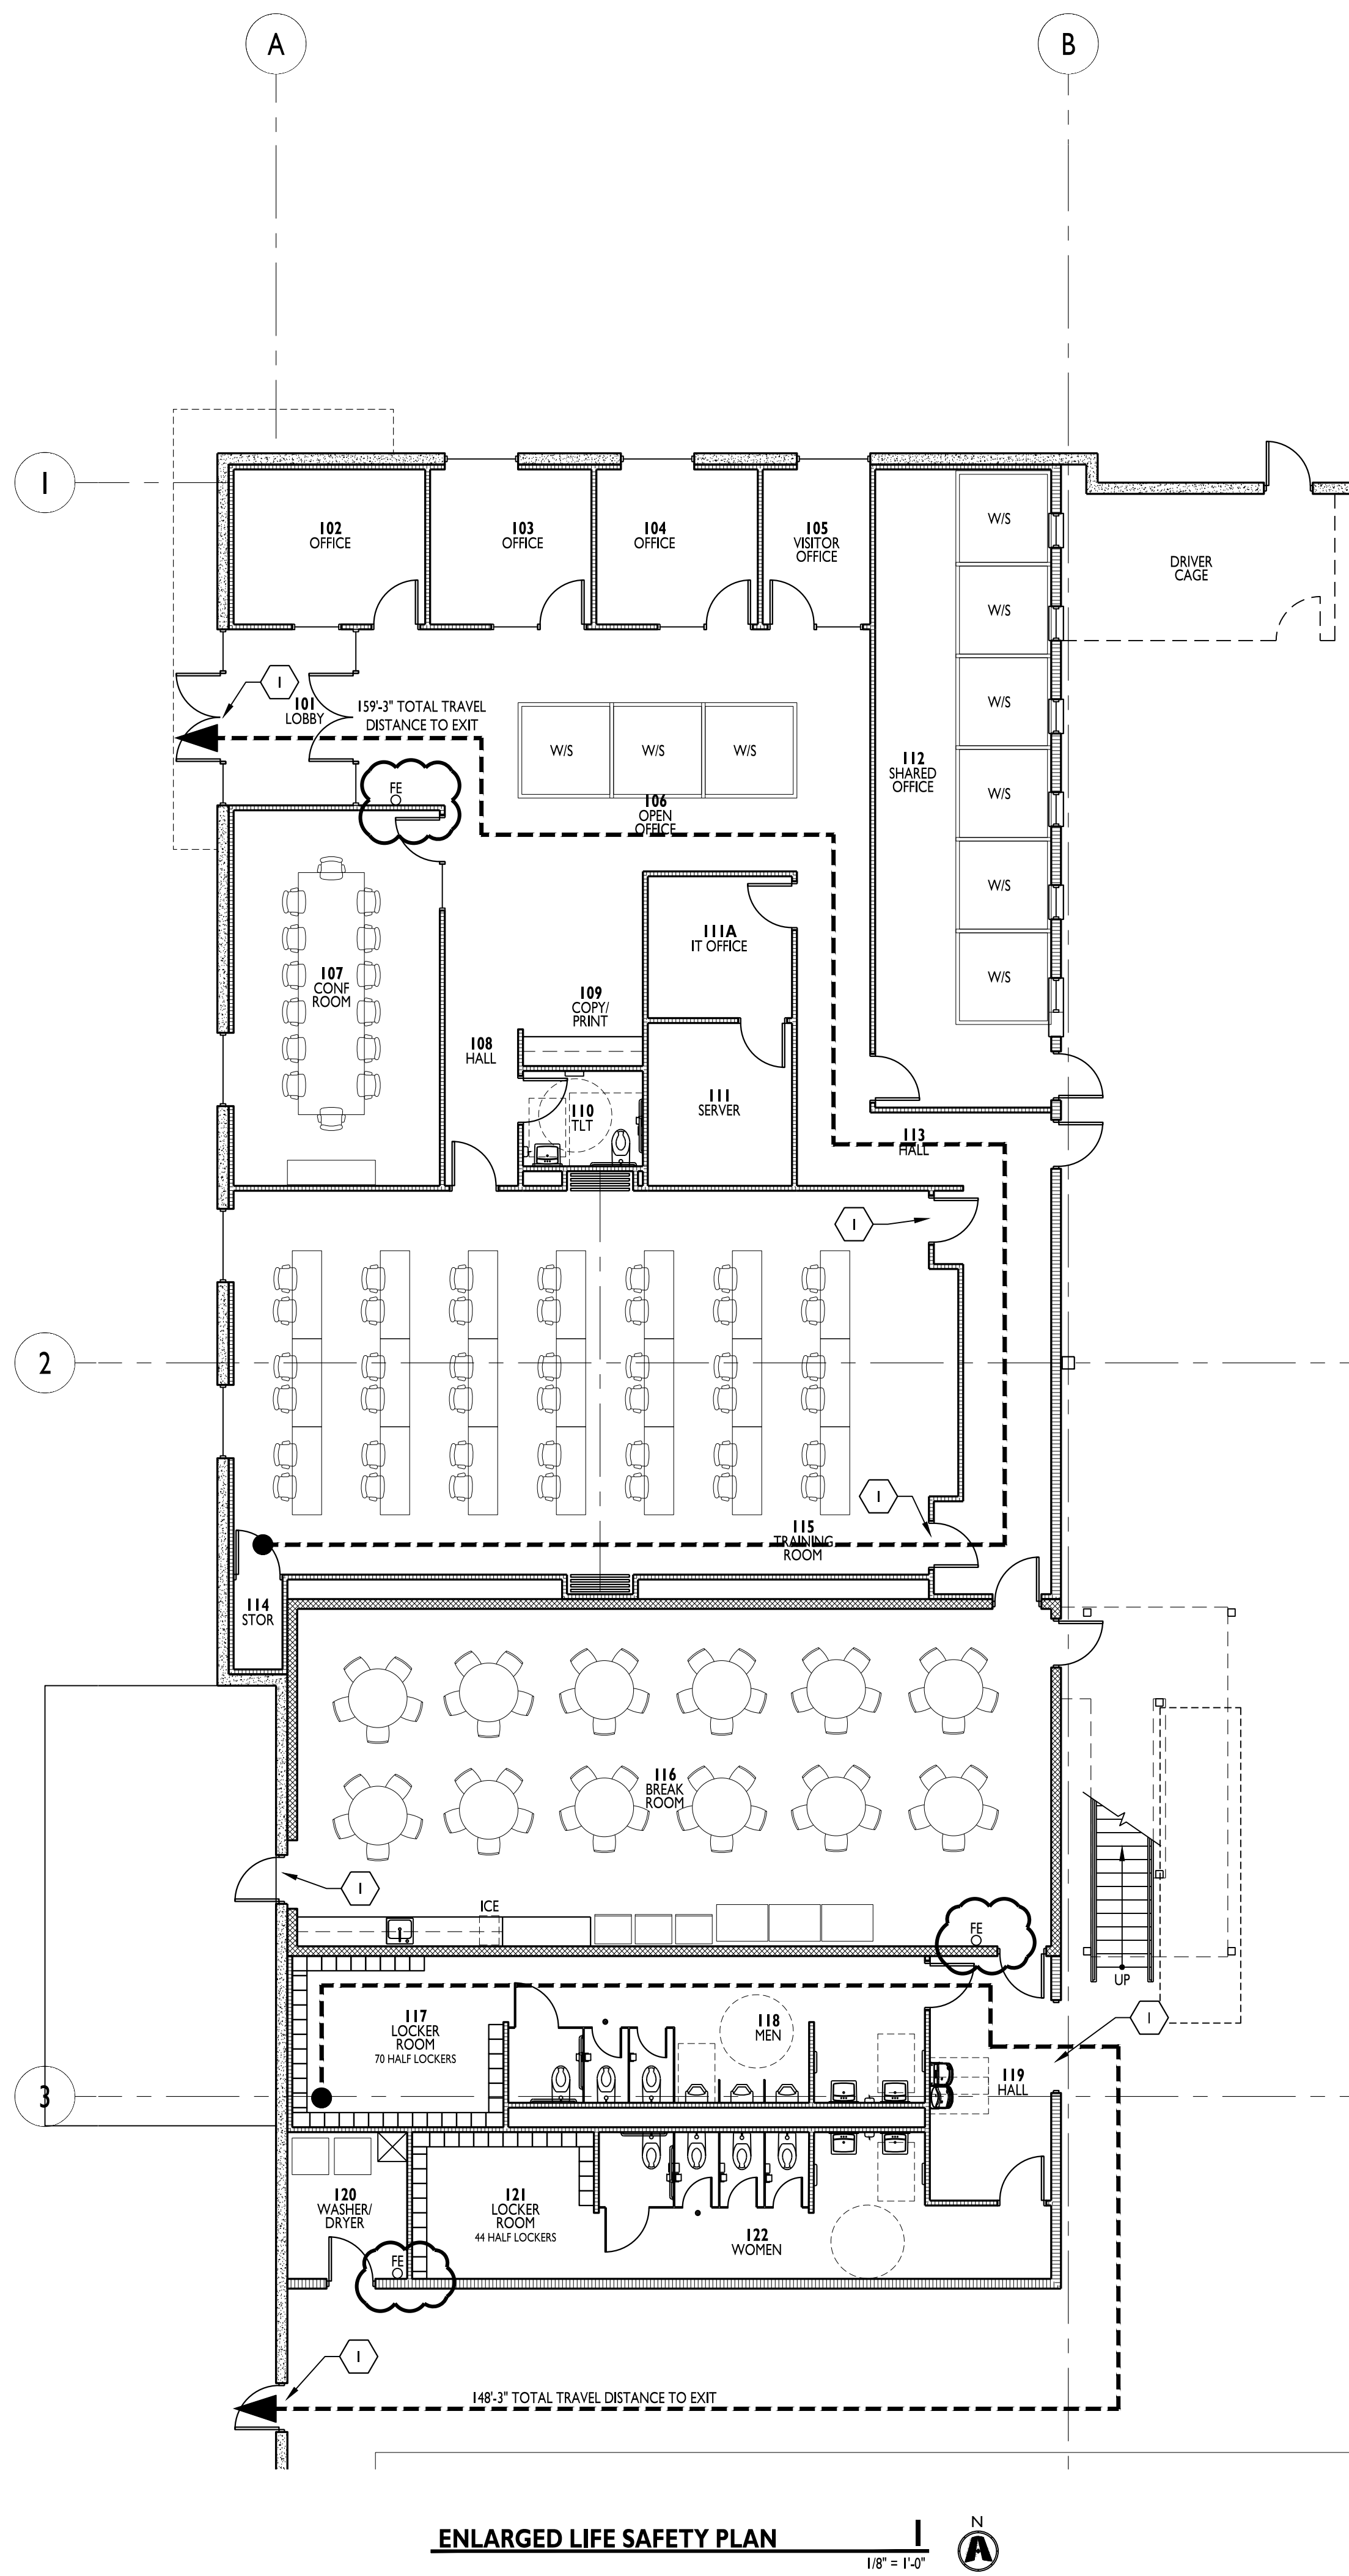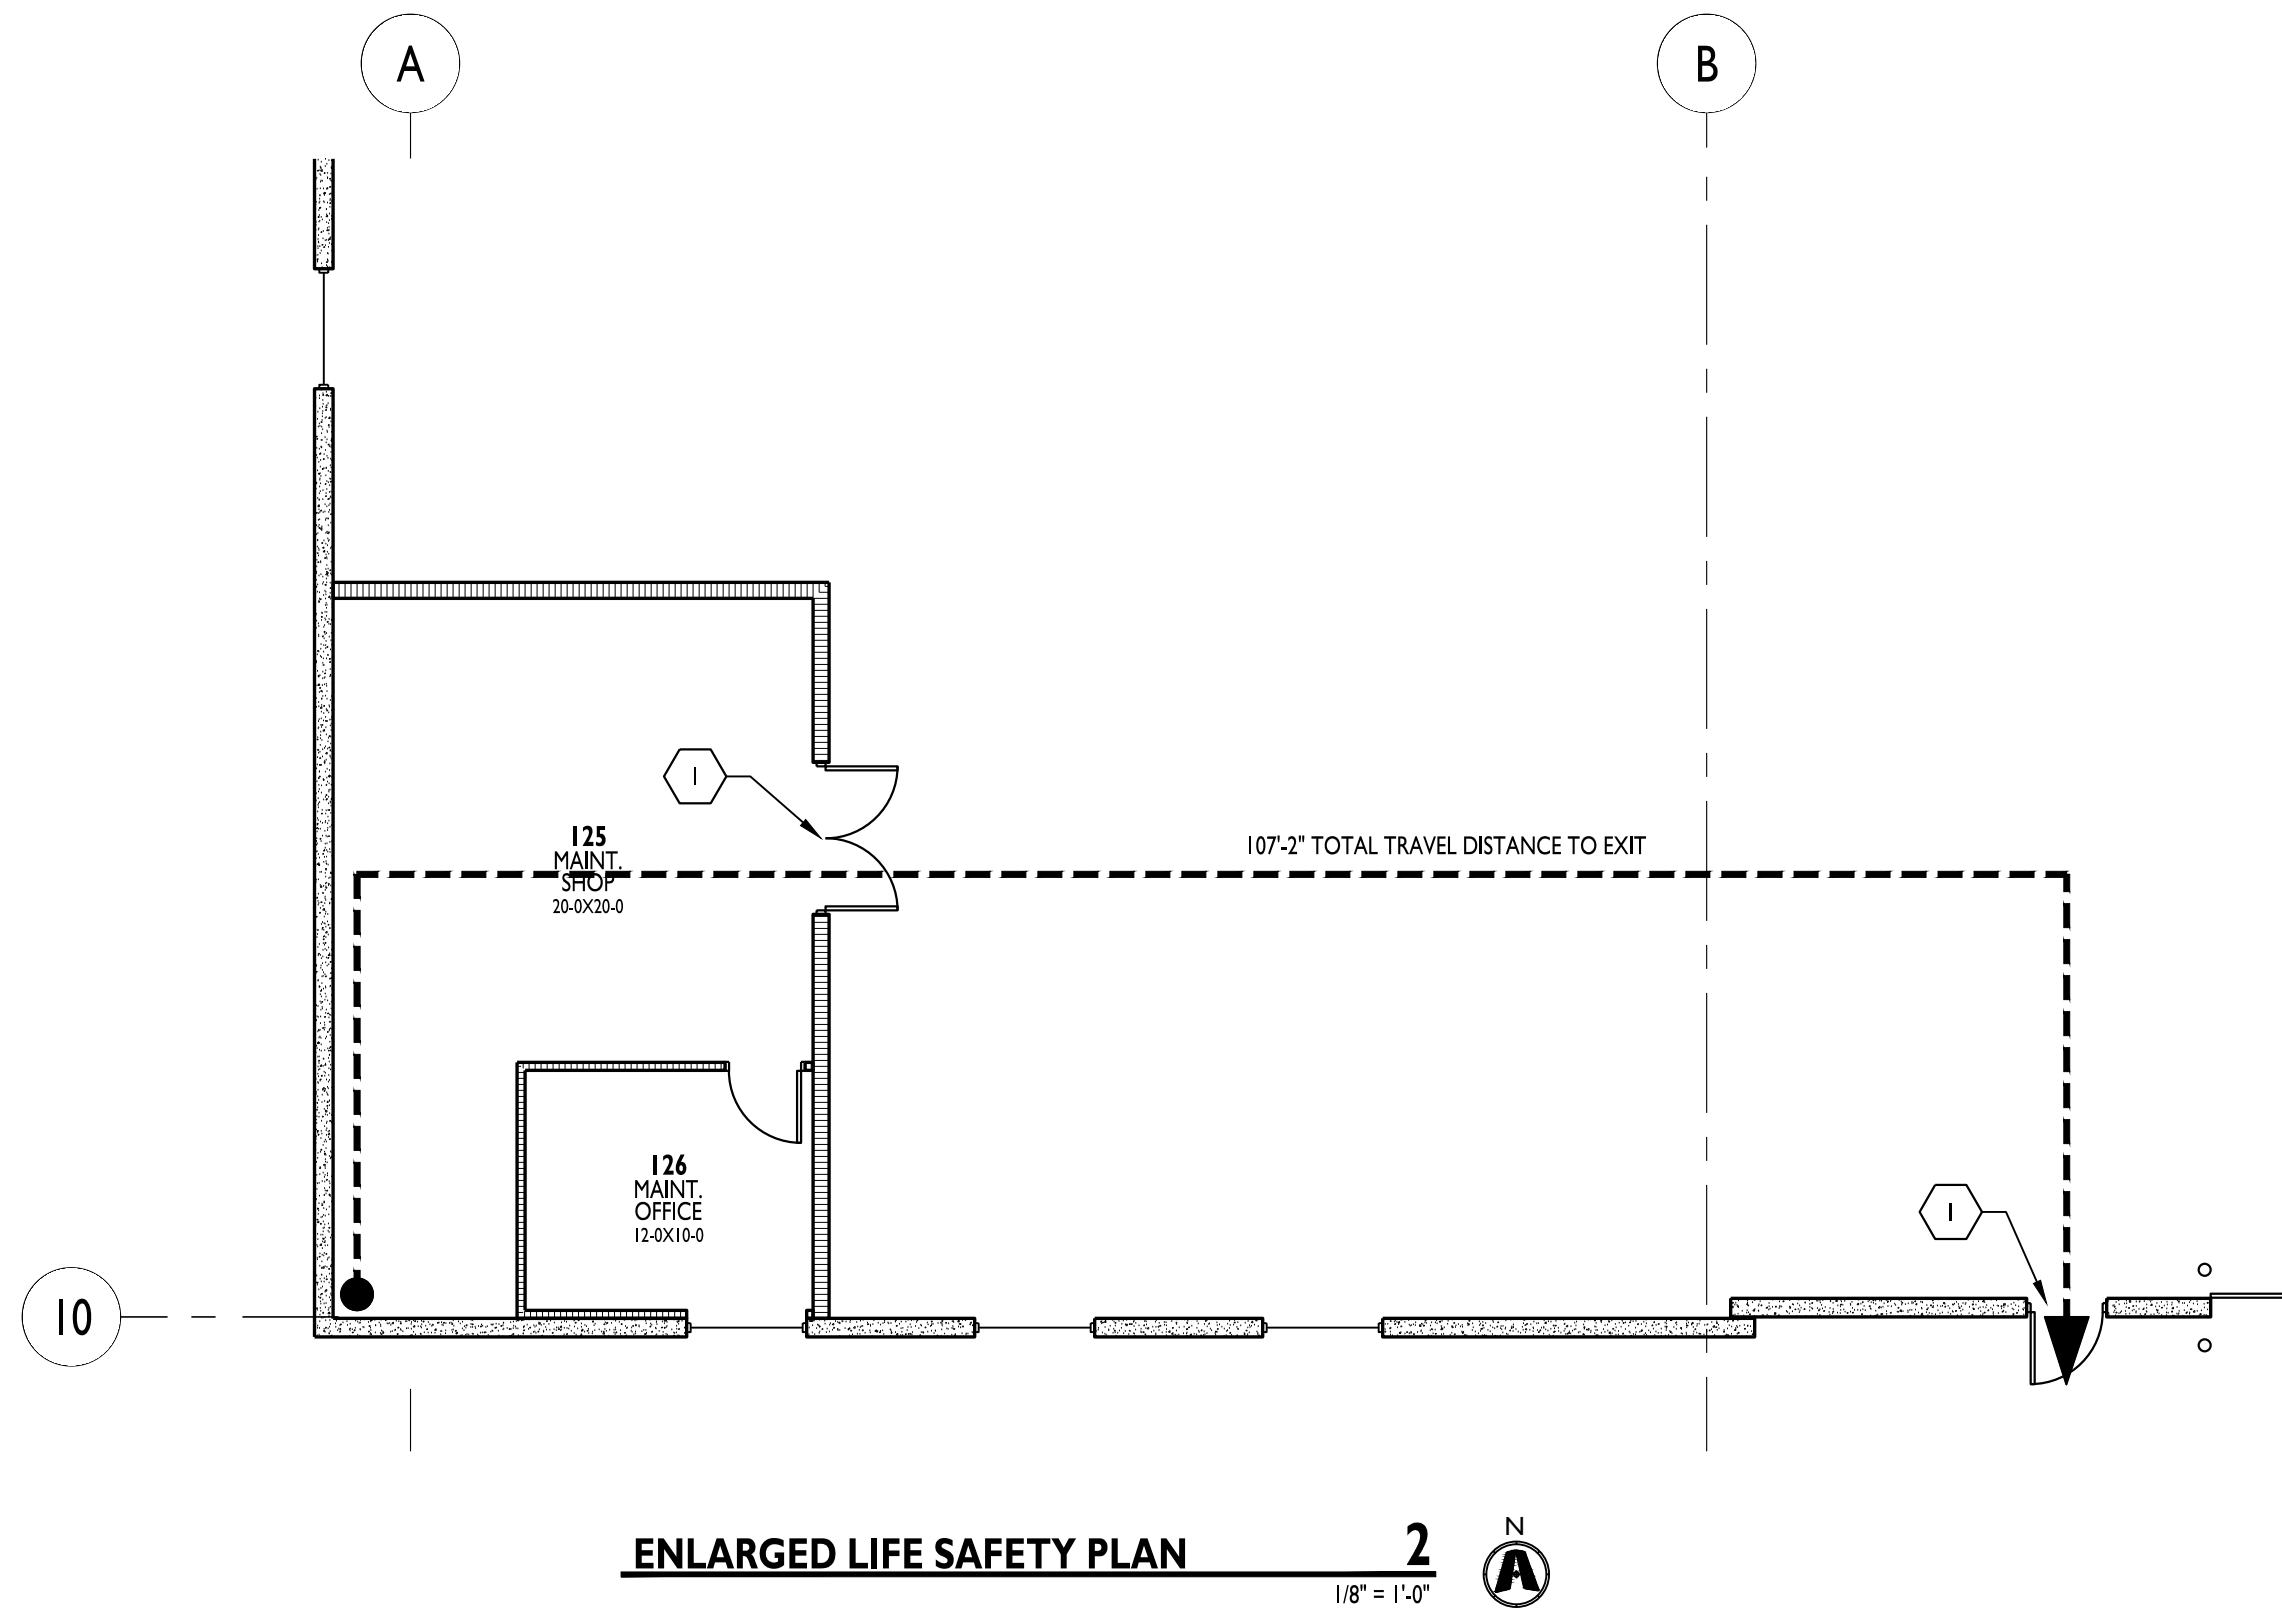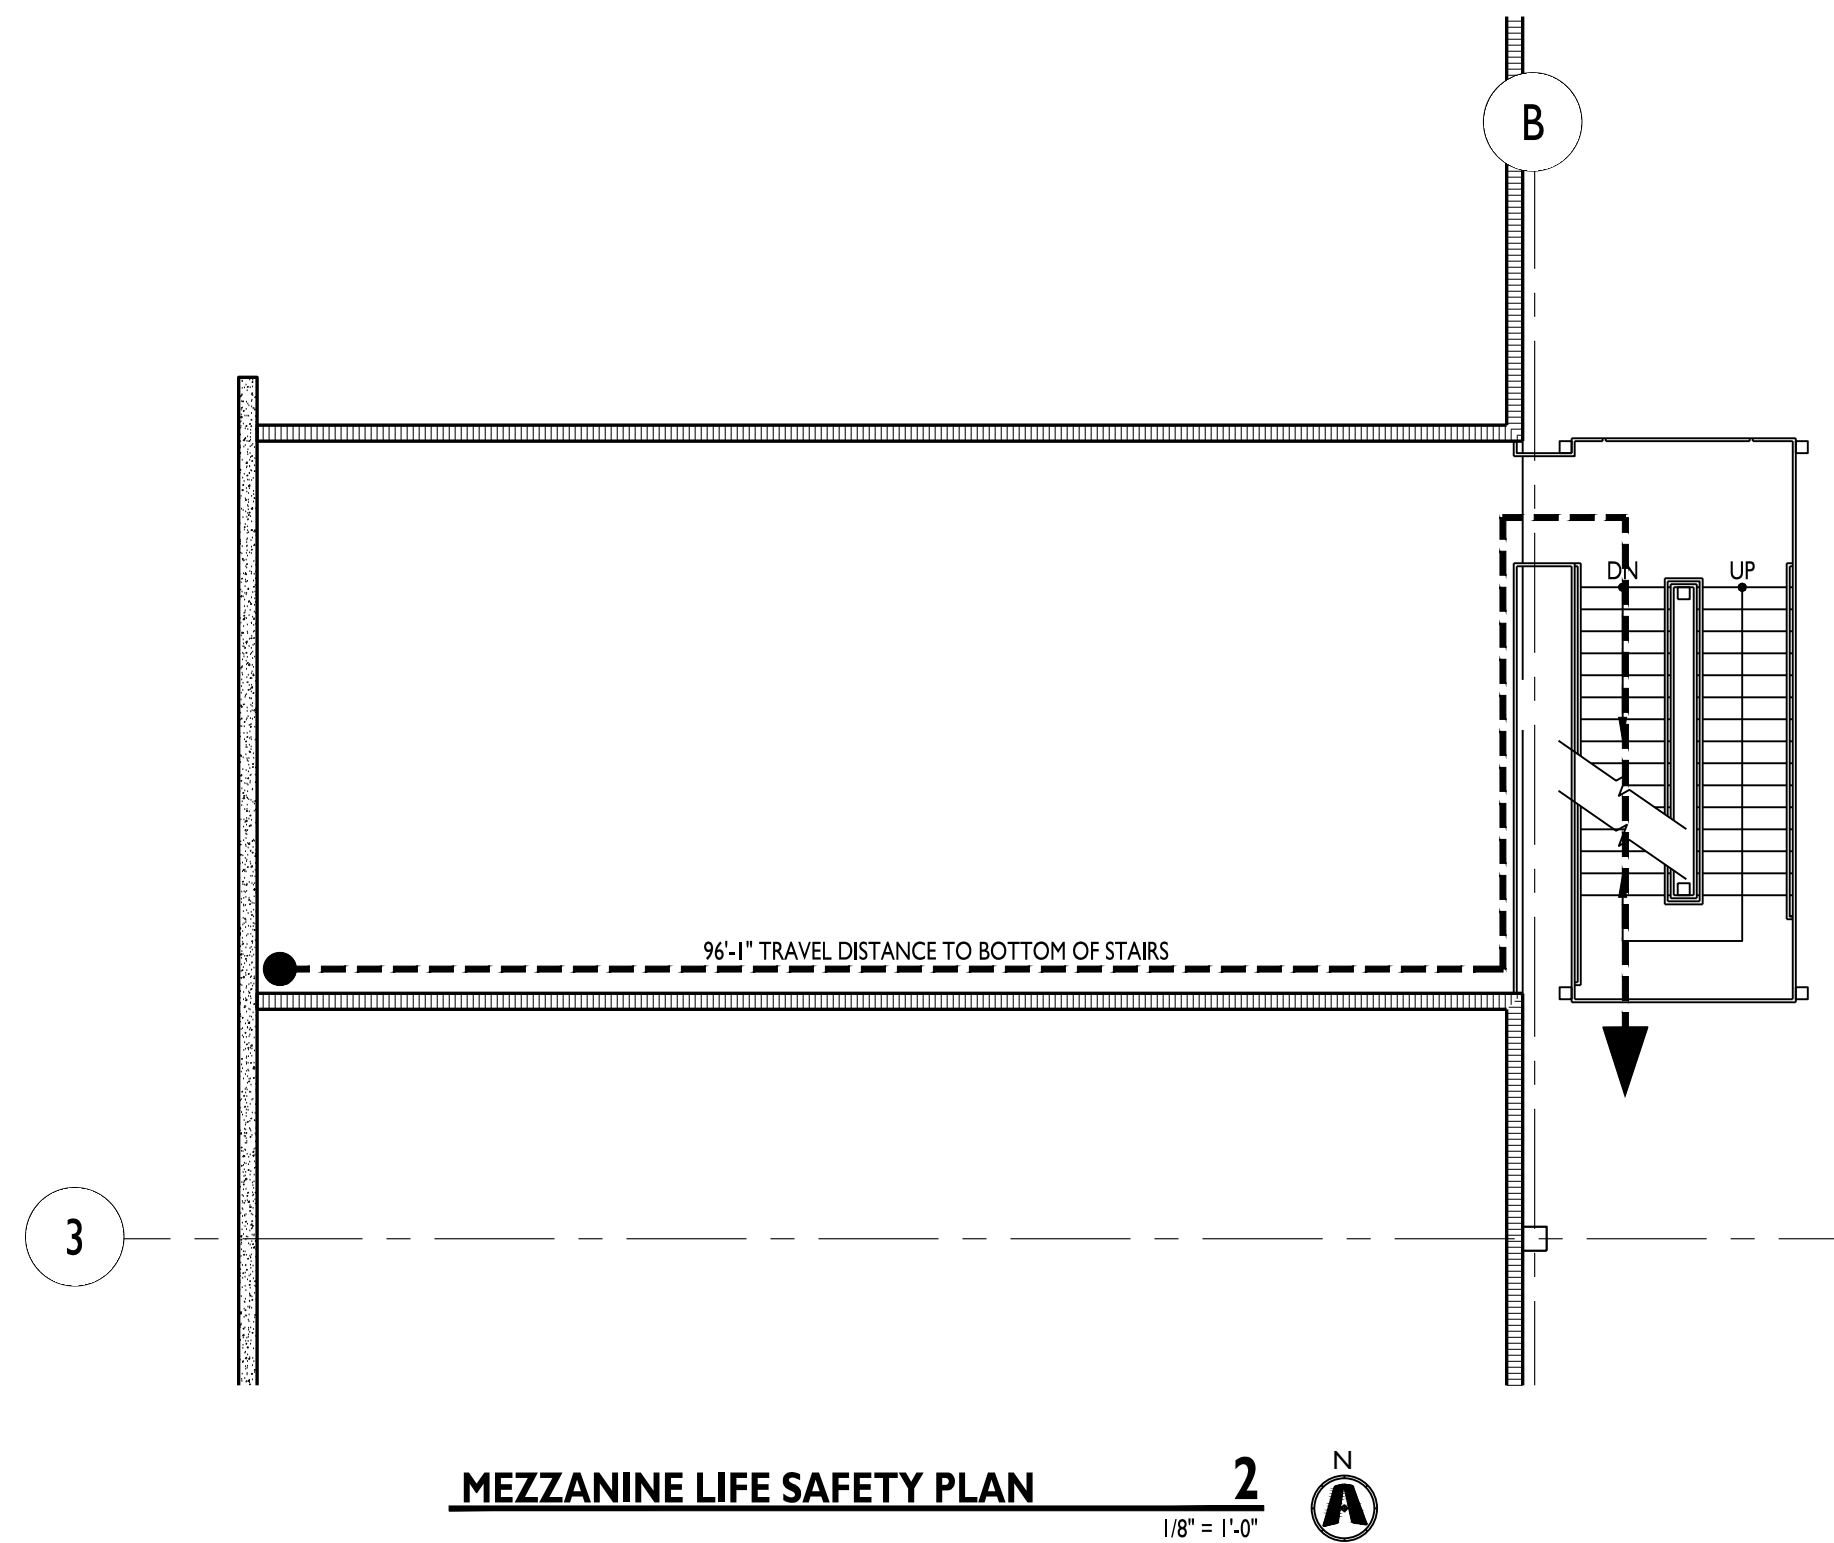

## KEYED NOTES

- EXIT, EXIT SIGN, AND EMERGENCY LIGHTING ABOVE DOOR  
INTERIOR WITH BATTERY BACKUP, EXTERIOR EGRESS  
LIGHTING ABOVE DOOR TIED TO BATTERY BACK UP.
- FINAL QUANTITY AND LOCATIONS TO BE DETERMINED  
WITH FINAL RACKING PLAN AND FIRE DEPARTMENT REVIEW.

## CODE ANALYSIS

### APPLICABLE CODES

BUILDING CODE  
2018 INTERNATIONAL BUILDING CODE

PLUMBING CODE  
2017 INTERNATIONAL PLUMBING CODE

ELECTRICAL CODE  
2017 NATIONAL ELECTRICAL CODE

FIRE CODE  
2018 INTERNATIONAL FIRE CODE

MECHANICAL CODE  
2018 INTERNATIONAL MECHANICAL CODE

FUEL GAS CODE  
2018 FUEL GAS CODE

HANDICAPPED ACCESSIBILITY CODE  
2009 ANSI A117.1  
ADA ACCESSIBILITY GUIDELINES

### OCCUPANCY (OVERALL BUILDING)

CLASSIFICATION (302.1):

S-I

### OCCUPANCY (TENANT SPACE)

CLASSIFICATION (302.1):

S-I

ACCESSORY USES (508.2.1):

B

NON-SEPARATED USES (508.3.2):

N/A

SEPARATED USES (508.3.3):

N/A

### AUTOMATIC SPRINKLER SYSTEM

SPRINKLER SYSTEM REQUIRED (903):

YES

SPRINKLER SYSTEM PROVIDED:

YES / ESR

### ALLOWABLE BUILDING HEIGHT

TABULAR HEIGHT (503):

2 STORY

### ALLOWABLE BUILDING AREA

TABULAR AREA (503):

17,500 SF

### BUILDING AREA INCREASE

INCREASE FOR SPRINKLERED BUILDING (506.3):

300%

UNLIMITED AREA (507):

UNLIMITED

FRONTAGE INCREASE (506.2):

N/A

If = (FP + 25) x W / 30

TOTAL ALLOWABLE AREA WITH INCREASES:

$A_2 = A_1 + (A_2 \times I) + (A_2 \times I)$

$A_2 = \text{FILL IN}$

UNLIMITED

### ACTUAL BUILDING HEIGHT AND AREA

BUILDING AREA:

433,301 SF

BUILDING HEIGHT (FEET / # FLOORS):

45'-6" / 1 FLR

### TABULAR OCCUPANT LOAD (1004.1.2)

OCCUPANT LOAD FACTOR:

1 / 500

### ACTUAL OCCUPANT LOAD (1004.1.2)

SQUARE FOOTAGE / OCCUPANT LOAD FACTOR:

433301 / 500

TOTAL OCCUPANTS:

867

### FIRE RESISTIVE REQUIREMENTS (601 AND 602)

CONSTRUCTION TYPE:

II-B

STRUCTURAL FRAME:

NR

EXTERIOR BEARING WALLS:

NR

INTERIOR BEARING WALLS:

NR

EXTERIOR NON-BEARING WALLS:

NR

INTERIOR NON-BEARING WALLS:

NR

FLOOR CONSTRUCTION:

NR

ROOF CONSTRUCTION:

NR

SHAFTS:

N/A

### FIRE RESISTANCE RATED CONSTRUCTION (704, 601, 402)

RATED EXTERIOR WALLS:

N/A

FIRE SEPARATION DISTANCE

60' +

UNPROTECTED OPENING AREA:

N/A

### INTERIOR WALL AND CEILING FINISH REQUIREMENTS (803)

SEE FINISH SCHEDULE FOR MATERIALS

ALL MATERIALS ARE CLASS A RATED

### FIRE PROTECTION SYSTEMS

STANDPIPE SYSTEM (905):

YES

PORTABLE FIRE EXTINGUISHERS (906.1):

BY TENANT

FIRE ALARM AND DETECTION SYSTEMS (907):

YES

SMOKE CONTROL SYSTEMS (909):

N/A

SMOKE AND HEAT VENTS (910):

N/A

### EGRESS

MINIMUM WIDTH FACTOR (1005.1):

0.15

REQUIRED MINIMUM WIDTH FROM SPACE (1005.1):

130.05"

MINIMUM NUMBER OF EXITS (1015):

3

ACTUAL NUMBER OF EXITS:

20

ACTUAL WIDTH OF EXITS:

792"

ALLOWABLE TRAVEL DISTANCE (1016.2):

400'

CORRIDOR CONSTRUCTION (1018.1):


NR

MINIMUM CORRIDOR WIDTH (1018.2):

44"


MAXIMUM DEAD END CORRIDOR (1018.4):

20'

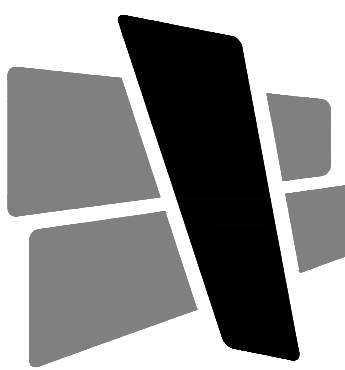


**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

## CERTIFICATION

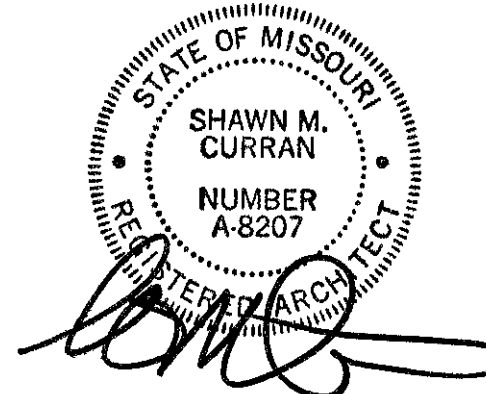

THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY  
OF CURRAN ARCHITECTURE, AND ARE NOT  
TO BE USED OR REPRODUCED, WHOLE OR  
IN PART, WITHOUT THE WRITTEN  
CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

## PROJECT INFORMATION

**LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I**

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

## ISSUE DATES


PERMIT SET 02.18.22  
PERMIT COMMENTS 10.24.22

210300

ENLARGED LIFE SAFETY  
PLANS

**A108**



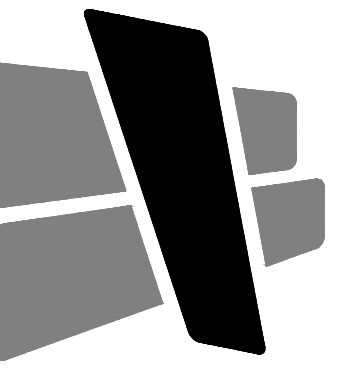


**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



CERTIFICATION

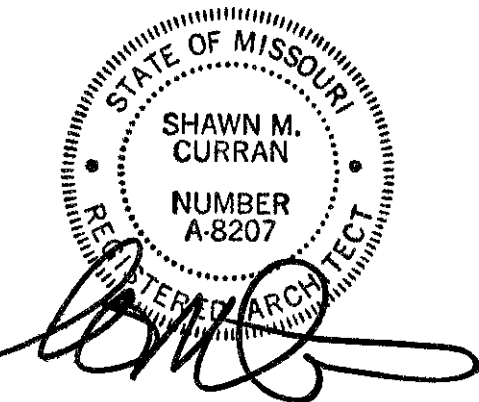

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


ISSUE DATES

PERMIT SET	02.18.22
REVISIONS	06.14.22
PERMIT COMMENTS	10.24.22

210300

1st FLOOR PLAN  
BUILD OUT

**A109**

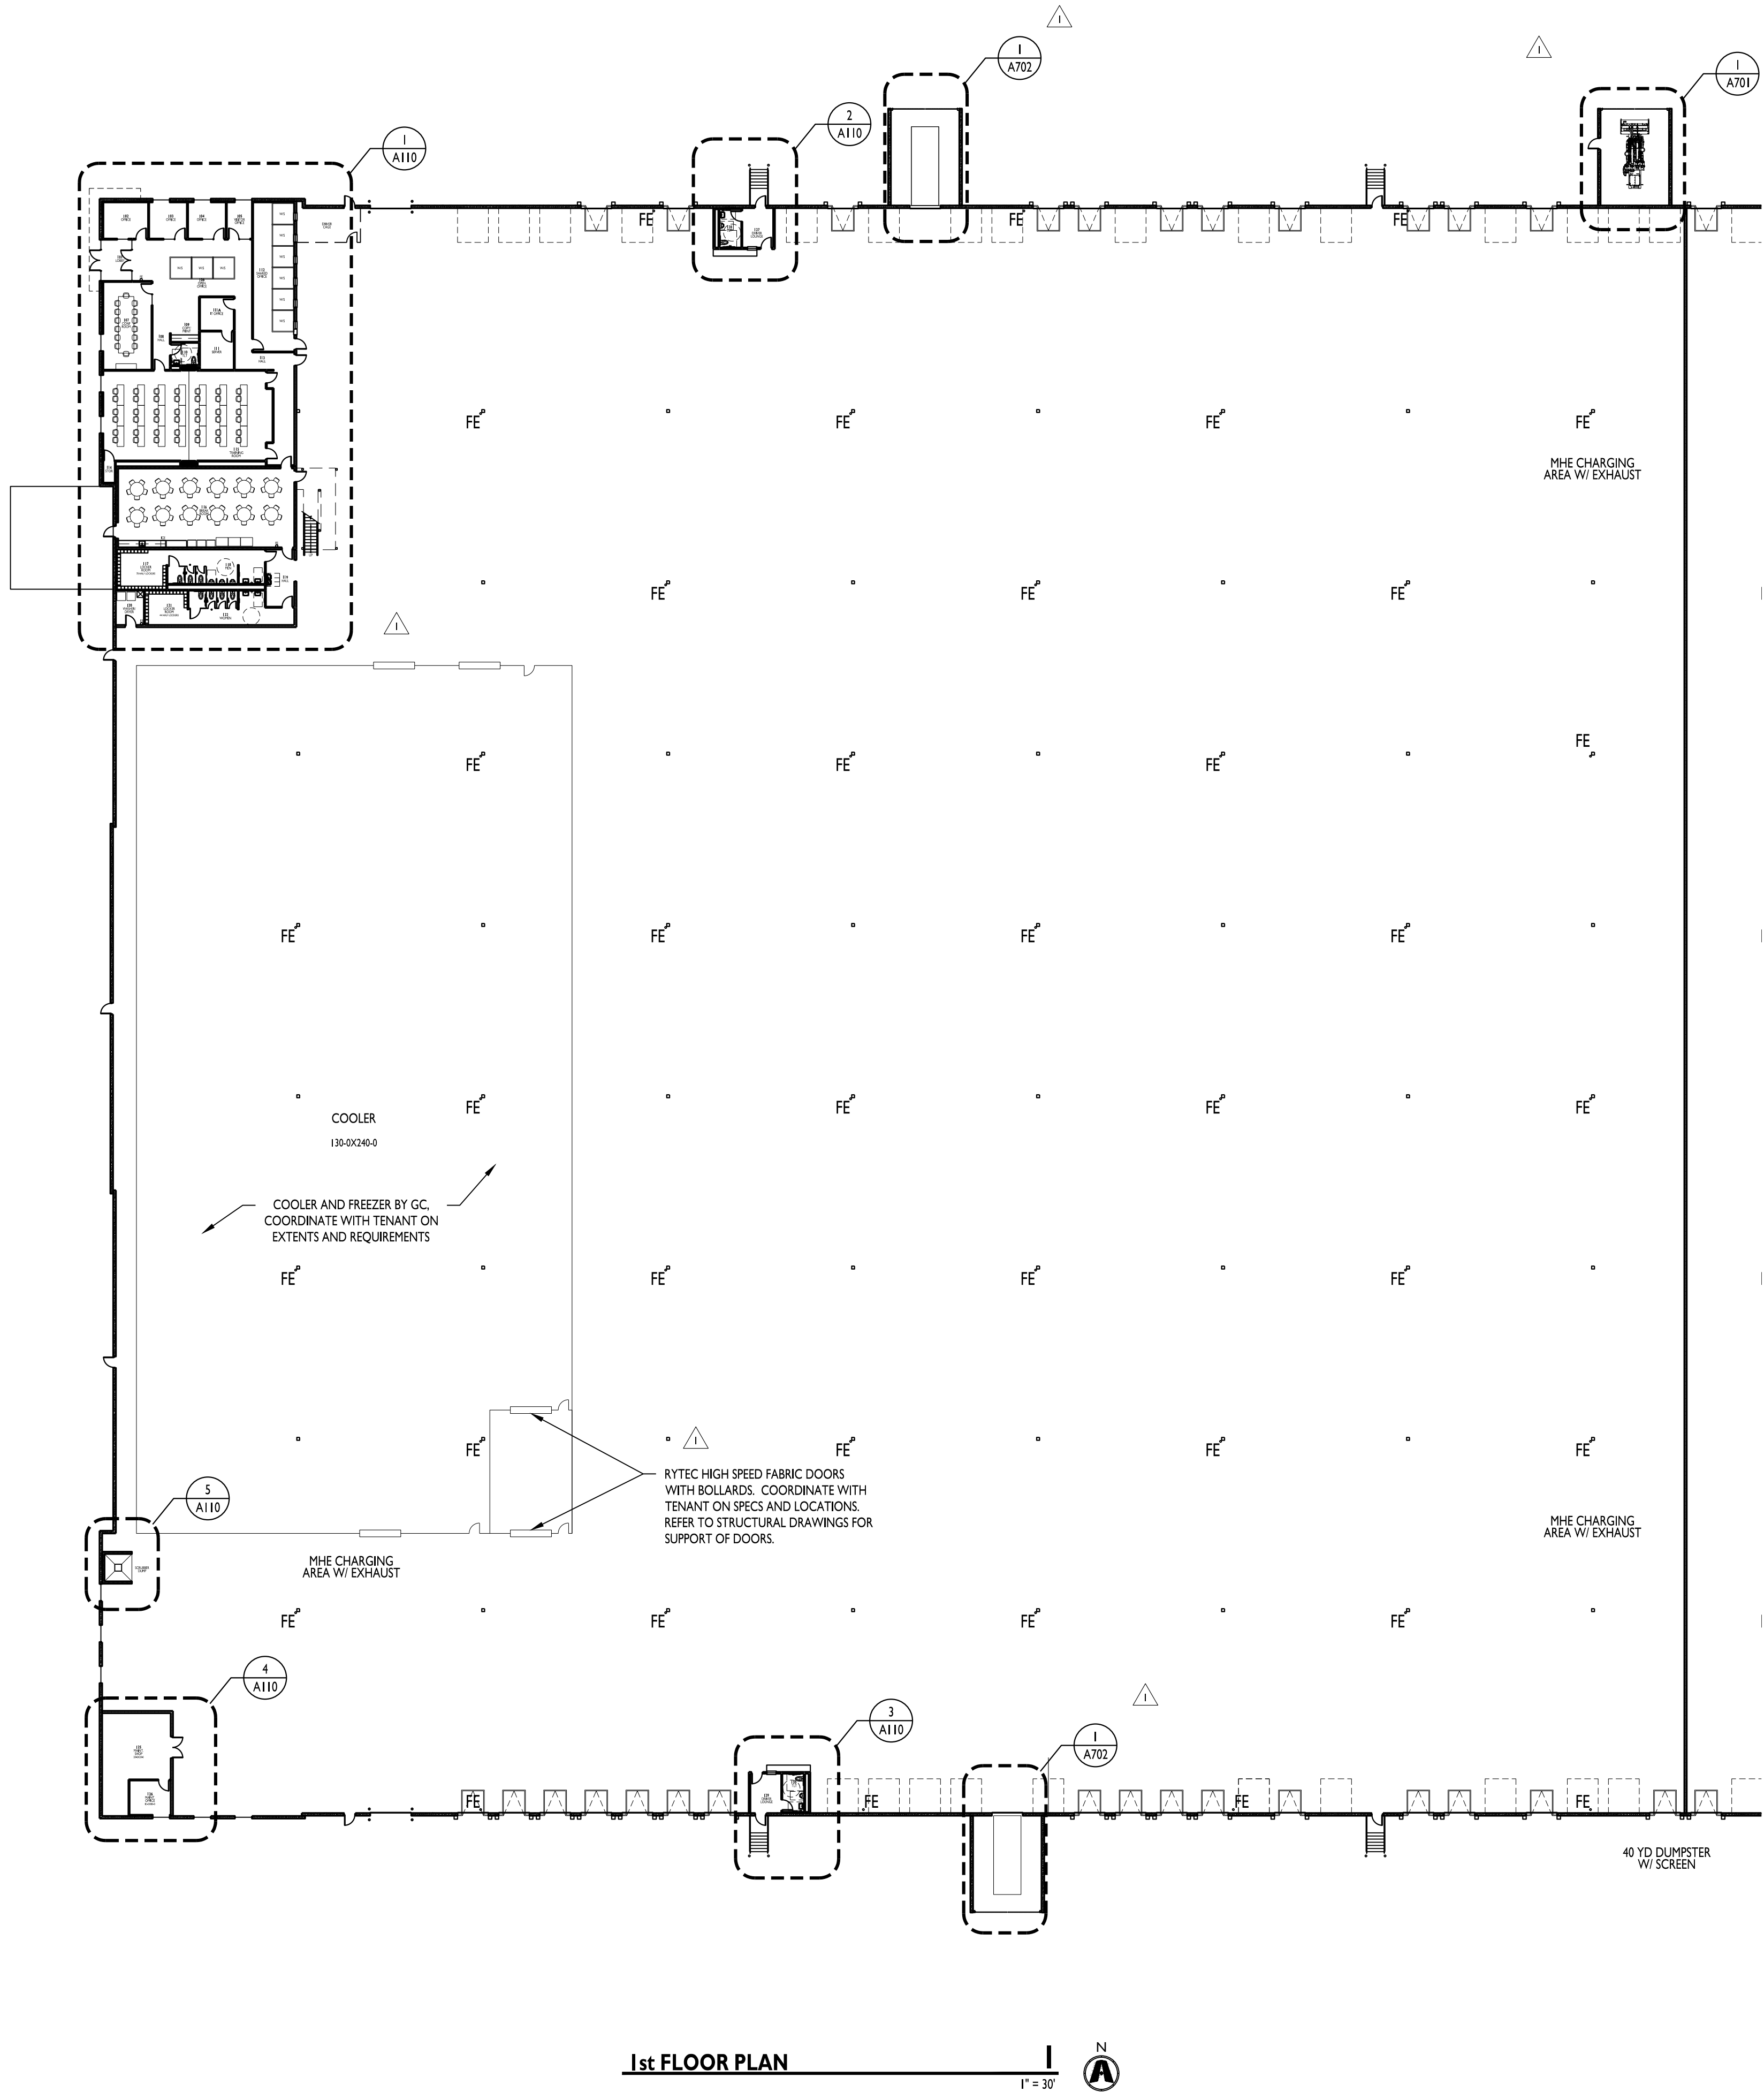


1st FLOOR PLAN







TOILET ACCESSORY SCHEDULE			
MARK	SYMBOL	MFR #	DESCRIPTION
TT1		BOBRICK B-2888	MULTI-ROLL TOILET TISSUE DISPENSER
GB1		BOBRICK B-5806 X 36 B-5806 X 42	36" AND 42" GRAB BARS
GB2		BOBRICK B-5806 X 18	18" VERTICAL GRAB BAR
MI		BOBRICK B-165	MIRROR 2'-0" X 4'-0"
TD1		BOBRICK B-3944	TOWEL DISPENSER / WASTE RECEPTACLE
SD1		BOBRICK B-2112	SOAP DISPENSER
ND1		BOBRICK B-353 B-270	B-353: SANITARY NAPKIN DISPOSAL UNIT AT GWB LOCATIONS B-270: SURFACE MOUNT SANITARY NAPKIN DISPOSAL UNIT AT PARTITIONS
TP1		GENERAL PARTITION	TOILET PARTITION AND/OR URINAL SCREEN POWDER COATED URINAL SCREEN BOTTOM 12" FROM FLOOR AND TOP 60" MAX FROM FLOOR

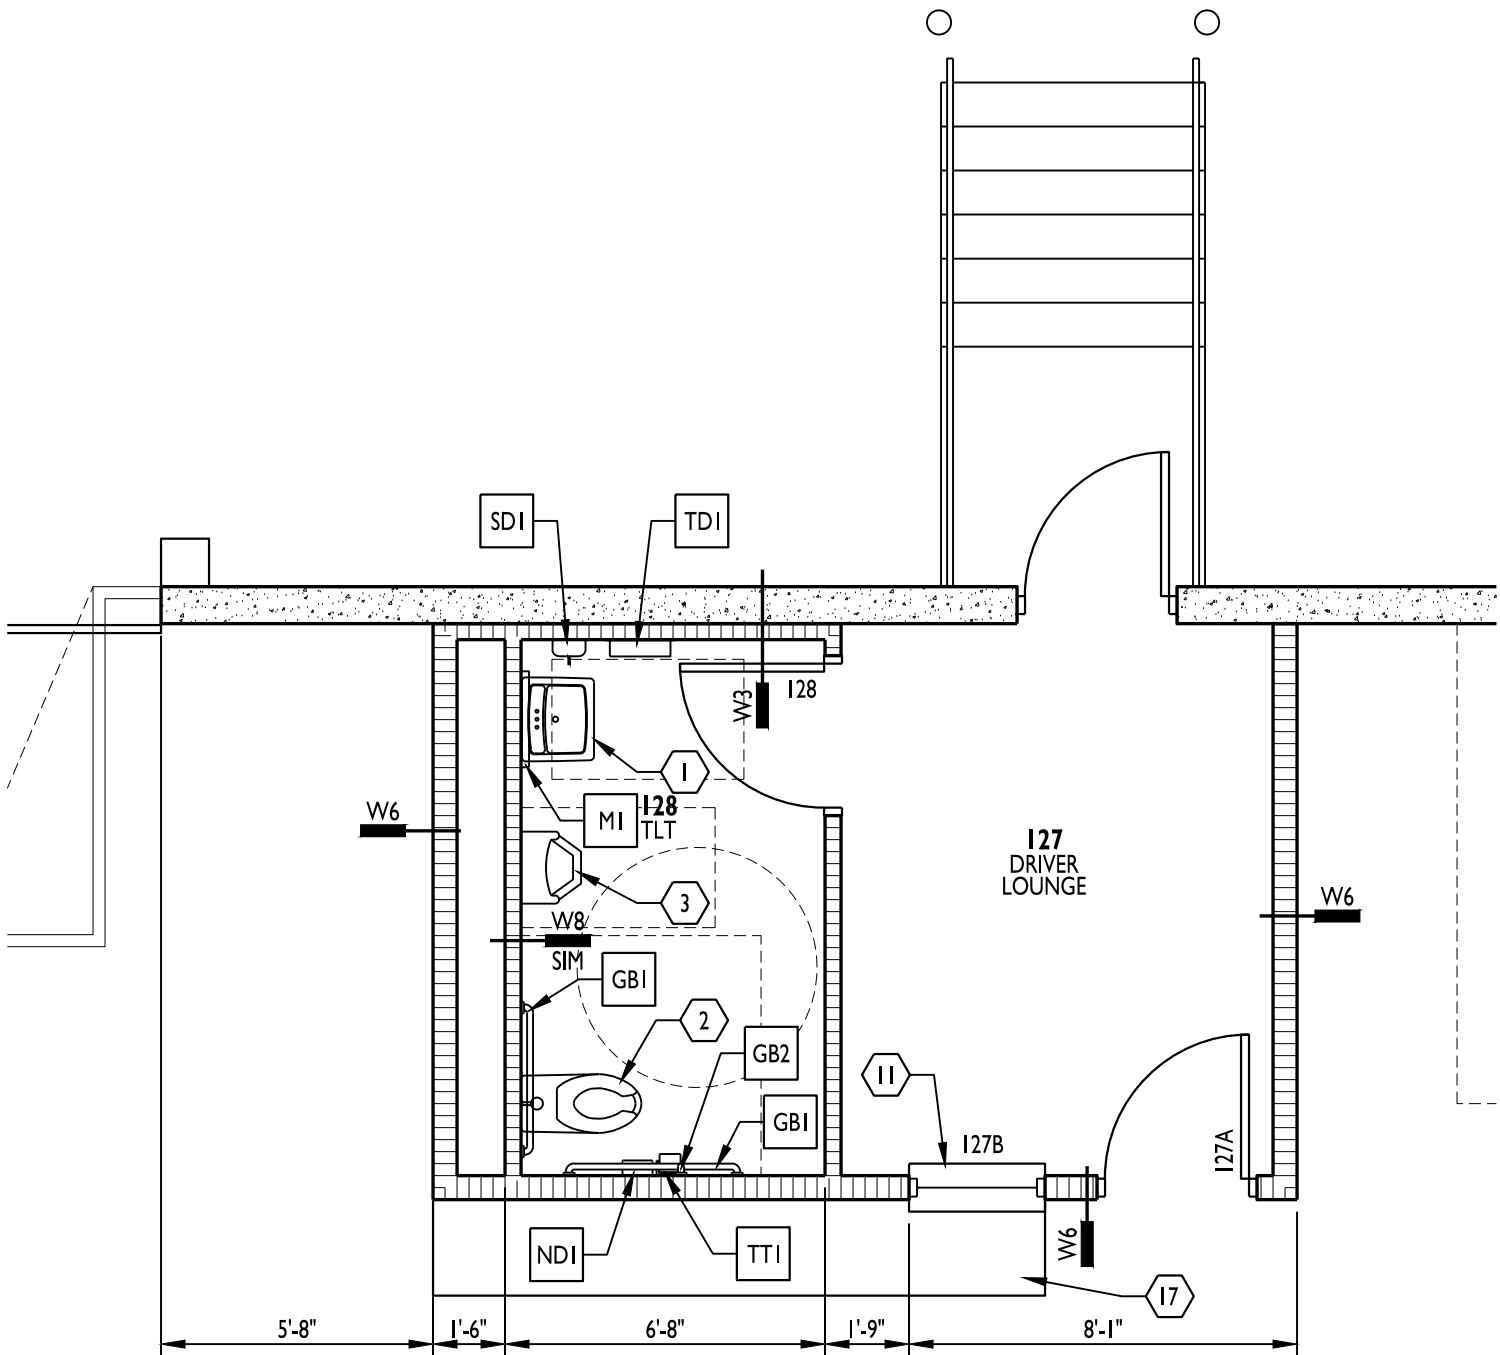


OUTBOUND DRIVER LOUNGE 2  
1/4" = 1'-0"

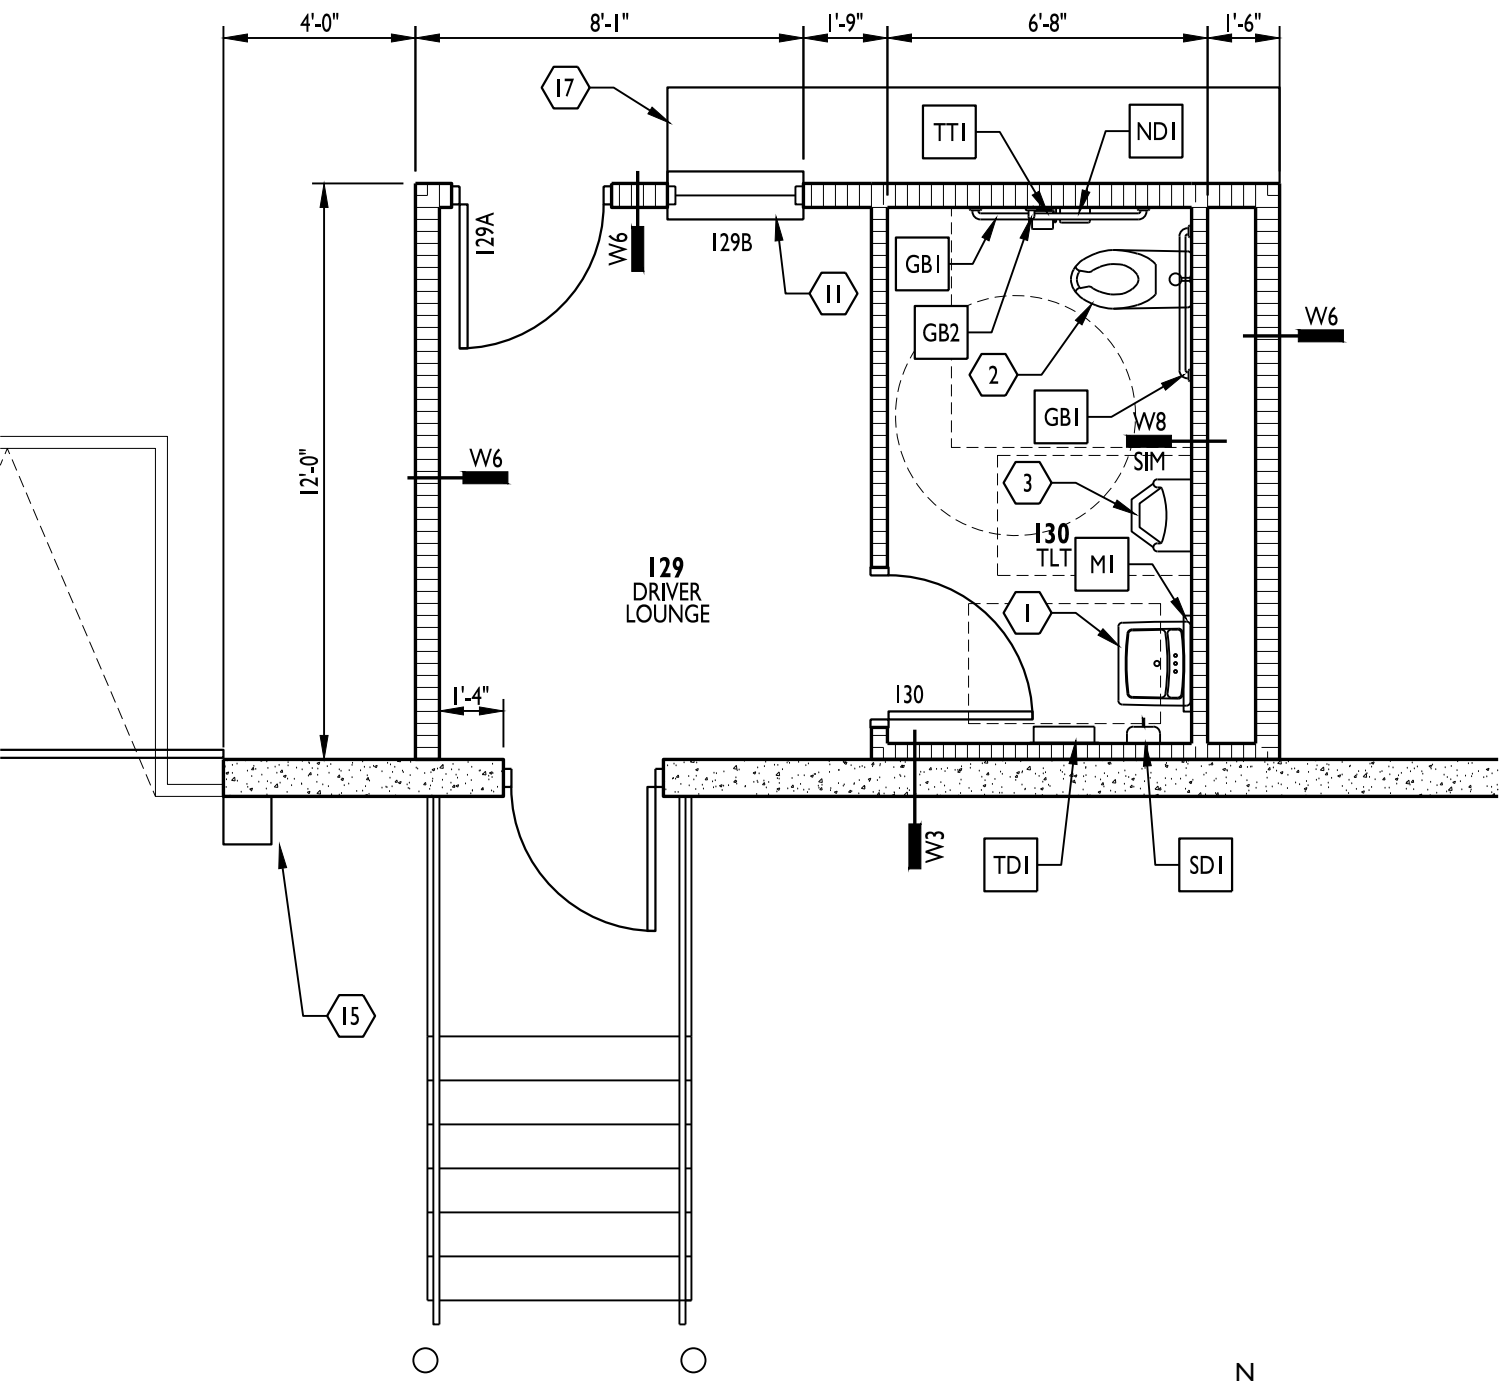


INBOUND DRIVER LOUNGE 3  
1/4" = 1'-0"

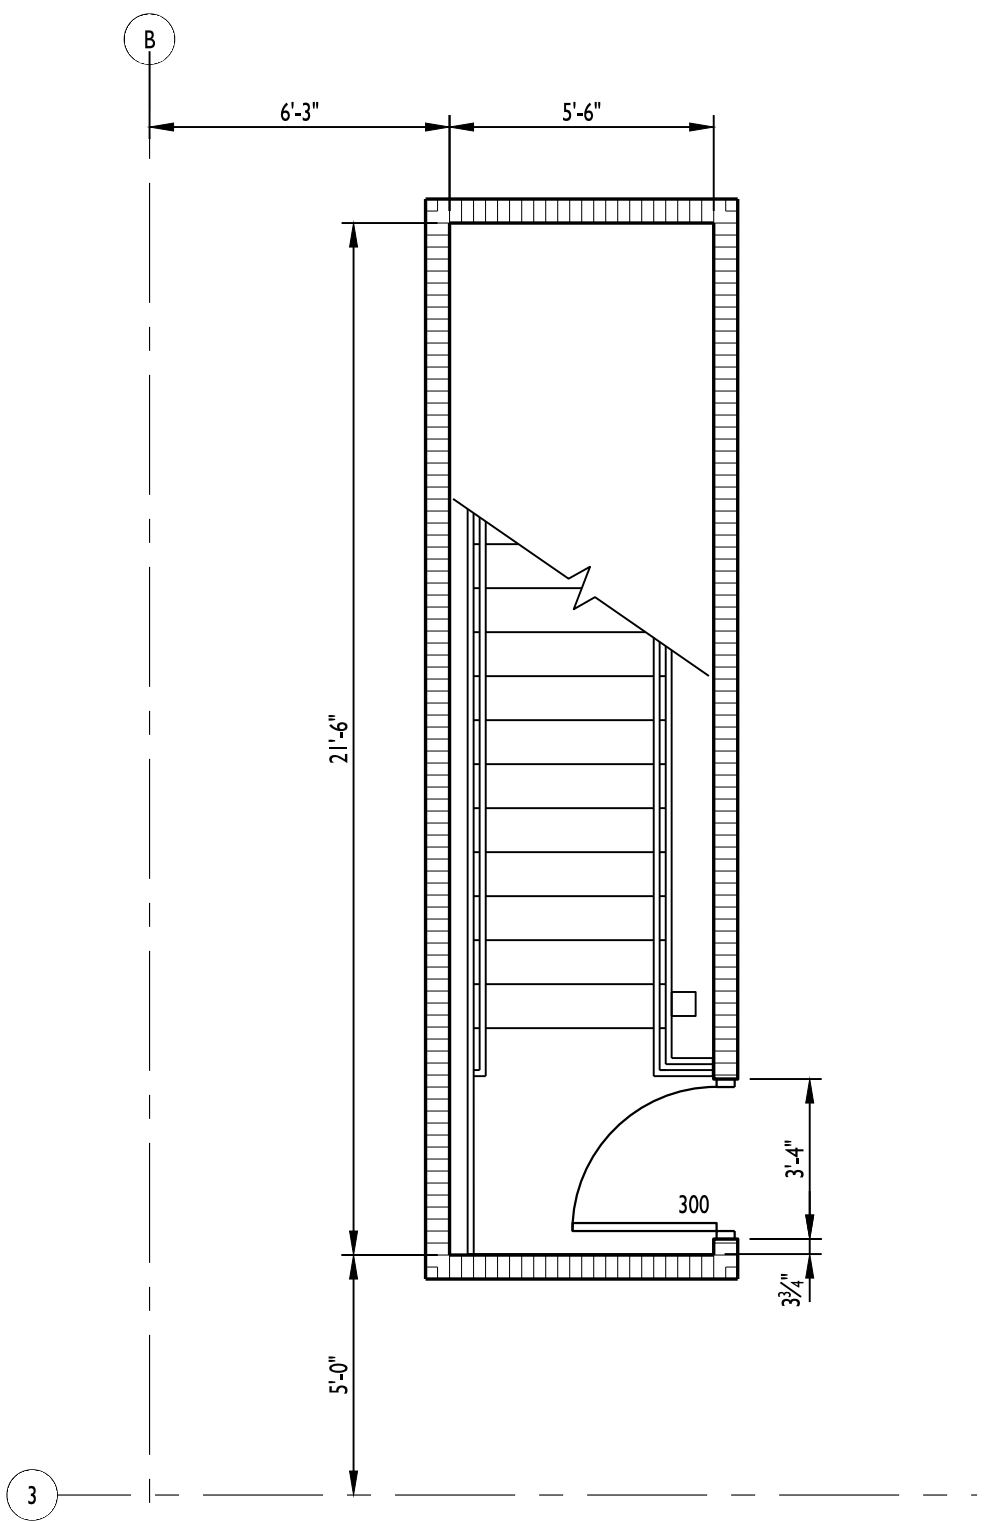

PENTHOUSE FLOOR PLAN 6  
1/4" = 1'-0"

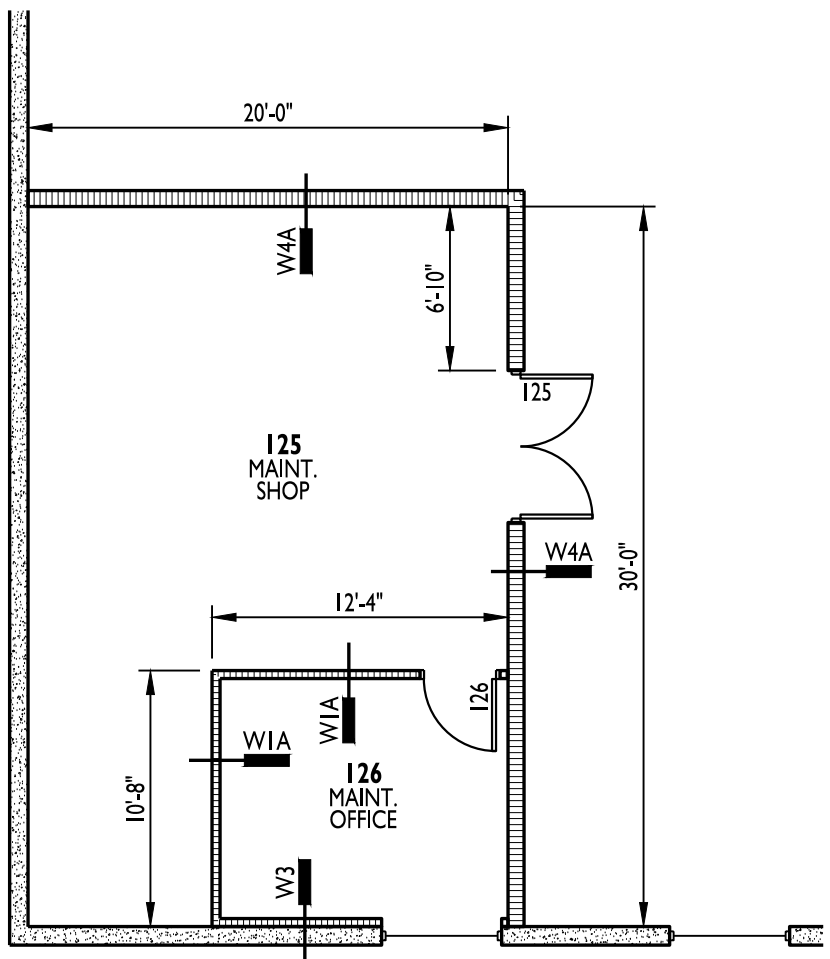

ENLARGED FLOOR PLAN 4  
1/8" = 1'-0"

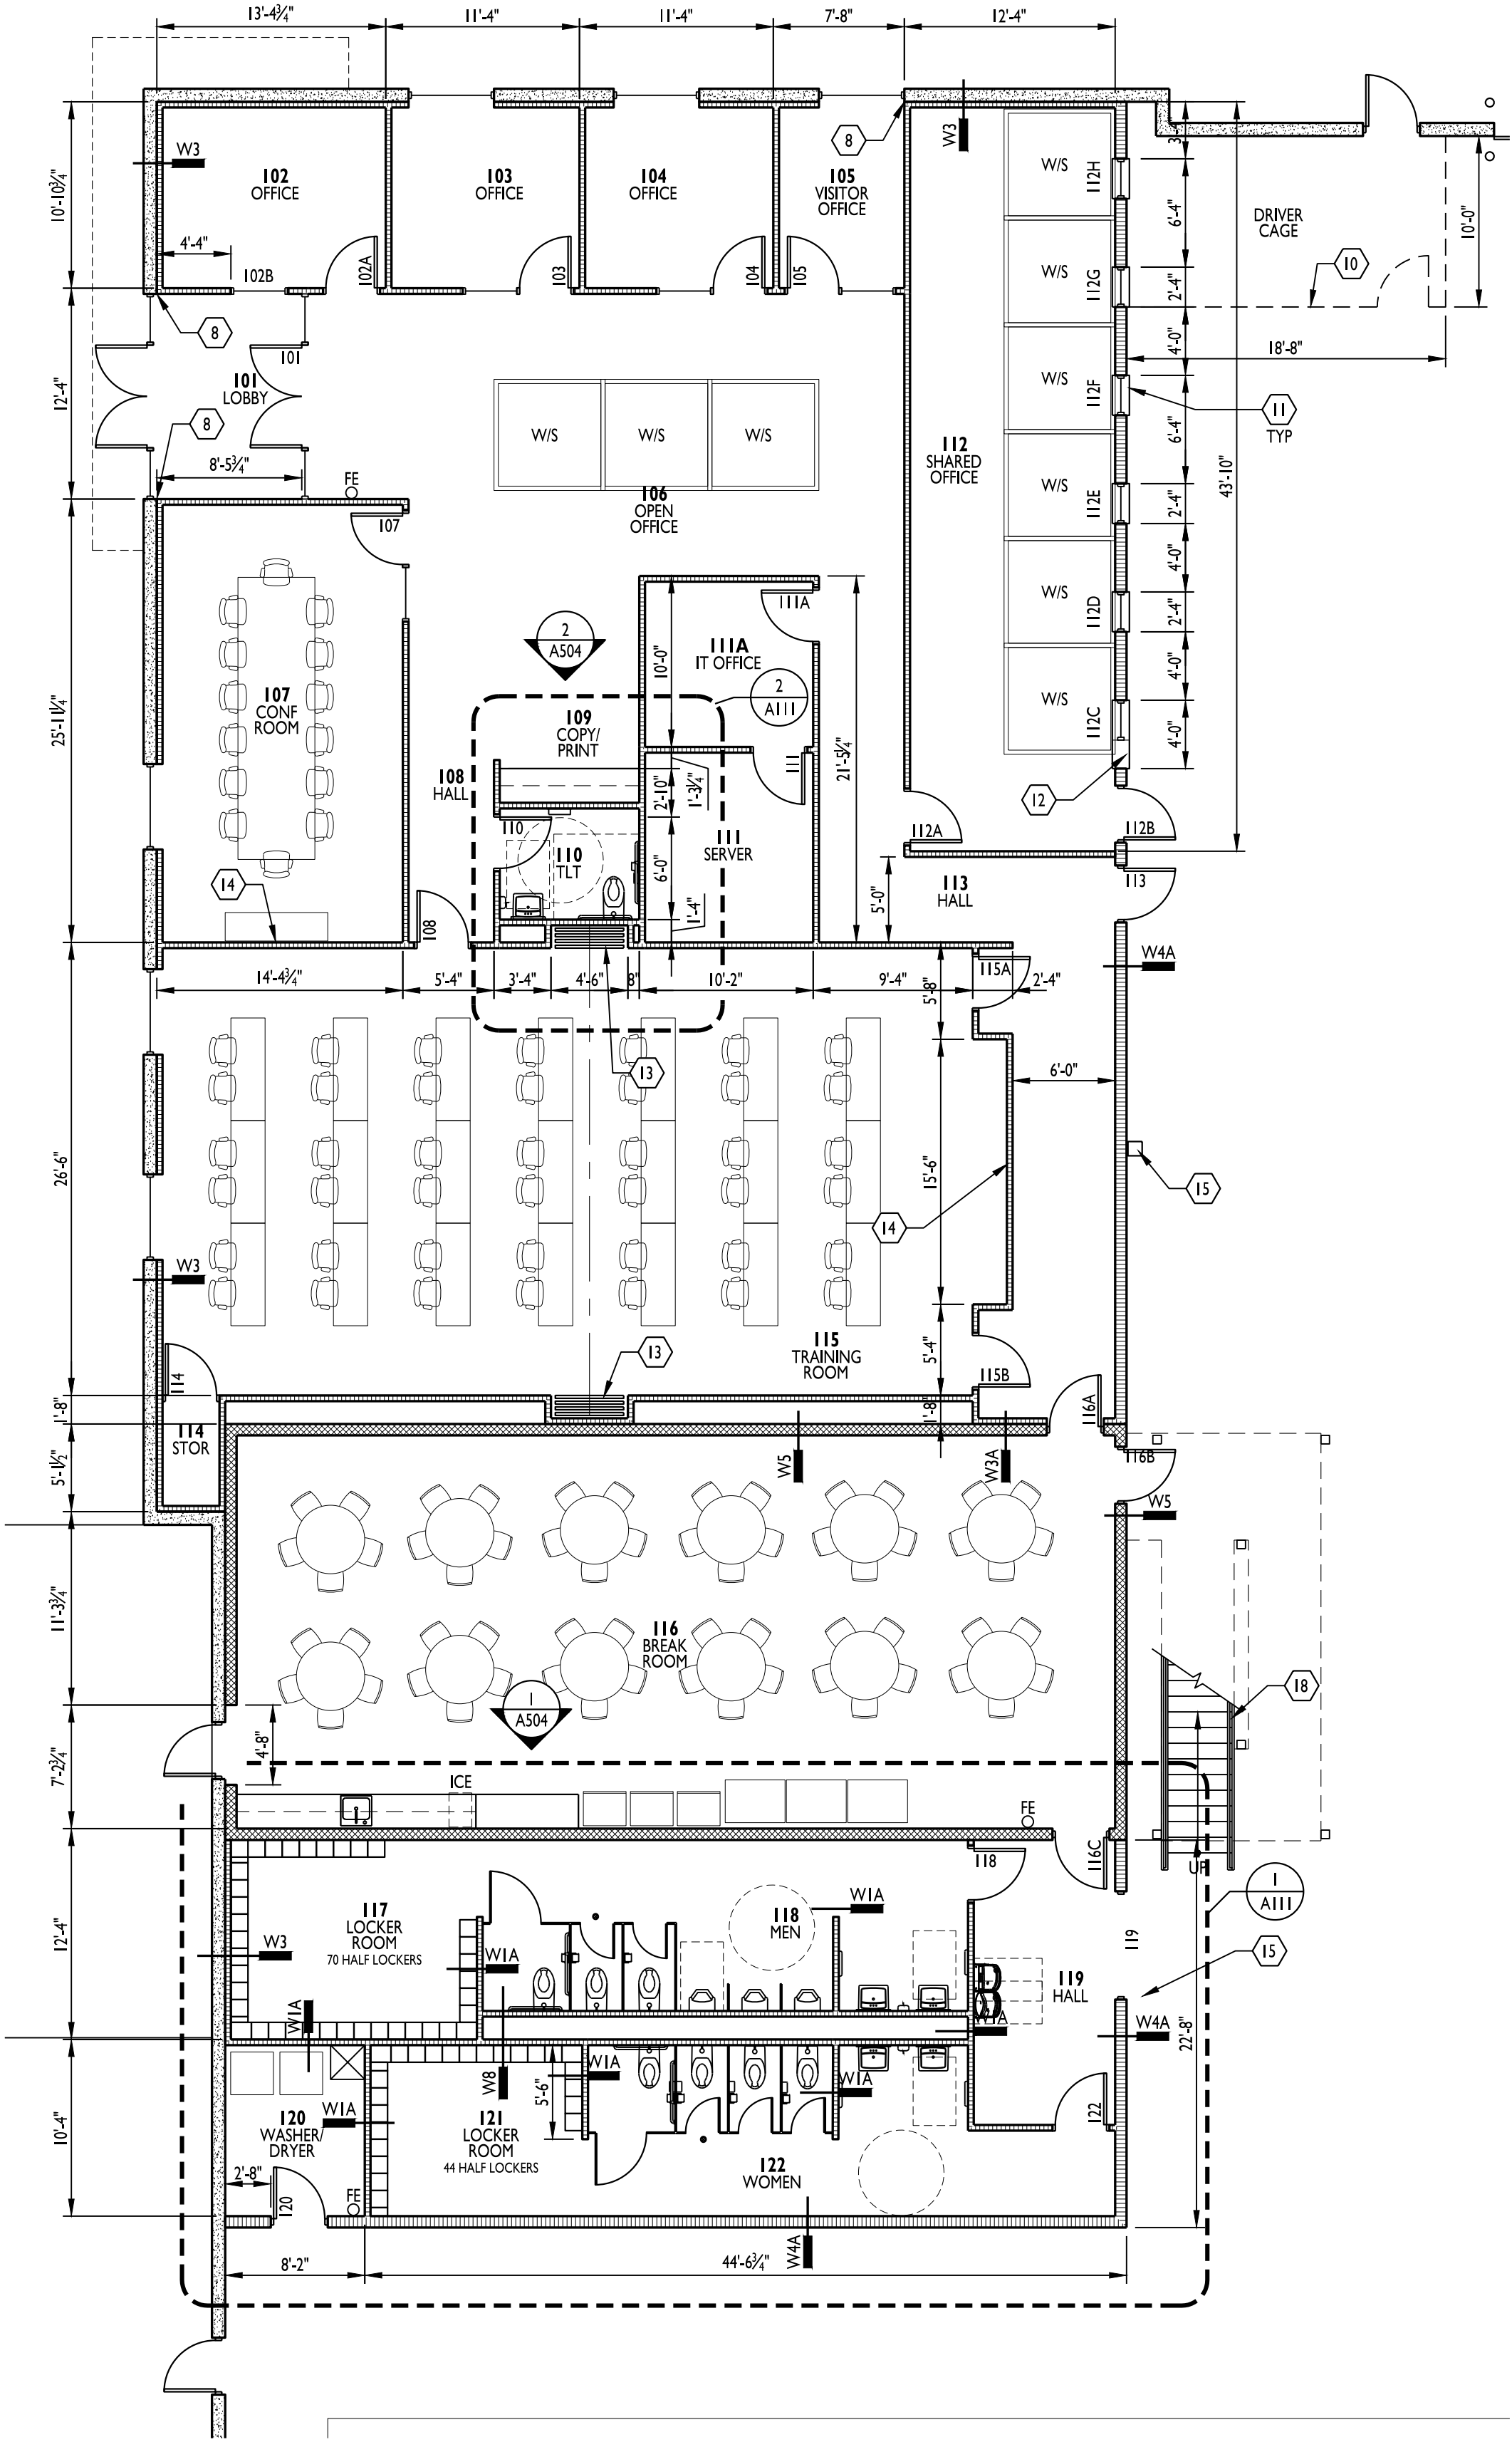


1st FLOOR PLAN 1  
1/8" = 1'-0"

## GENERAL NOTES

- CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFICATION OF ALL DIMENSIONS AND JOB CONDITIONS. ANY DEVIATION FROM WHAT IS NOTED IN DRAWINGS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT IMMEDIATELY.
- ALL DIMENSIONS SHOWN ARE FACE OF BRICK, MASONRY OR METAL STUD FRAMING, UNLESS OTHERWISE NOTED.
- PROVIDE DEEP LEG DEFLECTION TRACK AT ALL METAL STUD CONNECTIONS WITH STRUCTURE ABOVE, TYPICAL.
- PROVIDE FIRE RATED WOOD BLOCKING IN METAL STUD WALLS FOR ANY WALL SUPPORTED ITEMS.
- PROVIDE APPROVED FIRE RATED STOPPING MATERIALS IN ANY OPENINGS IN FIRE RATED ASSEMBLIES.
- REFER TO DOOR AND WINDOW SCHEDULES FOR ALL MATERIALS, FINISHES, AND HARDWARE INFORMATION.
- REFER TO EXTERIOR ELEVATIONS FOR ALL BRICK, MASONRY, AND OTHER EXPANSION JOINT LOCATIONS.
- ALL MATERIALS LOCATED IN CEILING PLENUM SHALL BE RATED FOR SUCH INSTALLATION OR PROTECTED TO PROVIDE COMPLIANCE. THIS INCLUDES BUT IS NOT LIMITED TO INSULATION (FHC 25/50) POWER AND LOW VOLTAGE WIRING, TELECOMMUNICATIONS CABLING, PLUMBING SUPPLY AND DRAIN LINES AND SUPPORTING BRACKETS AND/OR BLOCKING FOR CEILING HUNG ITEMS.
- PRIOR TO ORDERING ANY PRODUCTS, CONTRACTOR SHALL SUBMIT SAMPLES TO THE ARCHITECT OF ALL FINISH MATERIALS TO BE USED ON THE PROJECT. THE CONTRACTOR SHALL BEAR SOLE RESPONSIBILITY FOR ANY MATERIALS ORDERED INCORRECTLY WHEN THAT MATERIAL WAS NOT REVIEWED BY THE ARCHITECT.
- PROVIDE CONCRETE FILLED STEEL PIPE BOLLARDS AT ALL REQUIRED UTILITY EQUIPMENT LOCATIONS SUCH AS GAS METERS, ELECTRICAL TRANSFORMER PANELS, ETC. COORDINATE WITH UTILITY COMPANY AND CONTRACTORS, WHEN APPLICABLE, FOR NECESSARY LOCATIONS. REFER TO CIVIL DRAWINGS FOR BOLLARD SPECIFICATIONS AND ADDITIONAL INFORMATION.
- ALL DOORS, UNLESS OTHERWISE NOTED, TO HAVE HINGE SIDE SET 4" FROM CORNER SHOWN TO OUTSIDE OF FRAME.
- UNLESS SPECIFIED ELSEWHERE, ALL INTERIOR SLABS AND SLAB INFILLS TO BE FF-50/FL-35 OVERALL AND FF-35/FL-25 LOCAL.
- ALL EXIT DOORS TO HAVE TACTILE EXIT SIGNAGE PER 703.4 OF THE ANSI 117.1 2009.

## KEYED NOTES

- ADA COMPLIANT WALL MOUNTED LAVATORY. PROVIDE SCALD GUARDS ON SUPPLY / WASTE LINE. REFER TO PLUMBING DWGS. SEE TYPICAL ACCESSIBILITY DETAILS FOR ACCESSIBLE MOUNTING INFORMATION.
- ADA COMPLIANT WALL MOUNT FLUSH VALVE TOILET. REFER TO PLUMBING DWGS. SEE TYPICAL ACCESSIBILITY DETAILS FOR ACCESSIBLE MOUNTING INFORMATION.
- ADA COMPLIANT WALL MOUNTED URINAL W/ FLUSH VALVE CONTROL. CENTER IN WIDTH OF STALL. REFER TO PLUMBING DRAWINGS. SEE TYPICAL ACCESSIBILITY DETAILS FOR ACCESSIBLE MOUNTING INFORMATION.
- STANDARD HEIGHT URINAL. CENTER IN WIDTH OF PARTITIONS (OR WALL).
- STANDARD HEIGHT URINAL. CENTER IN WIDTH OF PARTITIONS (OR WALL).
- WALL MOUNTED LAVATORY. MATCH HEIGHT OF ADA LAVATORIES.
- ADA COMPLIANT H2O WATER FOUNTAIN.
- ALIGN FINISH FACE OF WALL, BOTH SIDES.
- WASHER & DRYER.
- 8'-0" TALL GALVANIZE D FENCE. PROVIDE GATE PER DETAIL 4/A504.
- PLASTIC LAMINATE 12" WIDE COUNTER. CENTER ON WIDTH OF WALL.
- PASS THRU CABINET W/ DOORS ON BOTH SIDES SEE 6/A504. CENTER ON WIDTH OF WALL.
- MODERN FOLD PAIRED PANEL PARTITION W/ VINYL FACE, MIN 51 STC RATING. COORDINATE ALCOVE DIMENSIONS W/ SUPPLIER.
- PROVIDE FR BLOCKING FOR TENANT PROVIDED TV.
- STRUCTURAL STEEL COLUMN.
- HALF HEIGHT LOCKERS 12" x 12" w/ 4" CURB & SLOPED TOP. PROVIDE 2 ADA COMPLIANT LOCKERS IN EACH ROOM.
- WALL MOUNT SHELF. REFER TO 5/A504.
- STEEL STAIRS. PAINT SAFETY YELLOW. REFER TO 1/A505.
- 2' x 2' MOP SINK w/ WALL MOUNT FAUCET.
- PRECAST PLANK ON CMU WALL WITH TOPPING SLAB. TOP OF SLAB AT 11'-8" AFF. REFER TO STRUCTURAL DRAWINGS.
- BAR JOIST ROOF FRAMING ABOVE. COORDINATE WITH STRUCTURAL DRAWINGS.
- ALIGN FINISH FACE OF GYP BOARD WITH FACE OF CMU WALL.
- 1 1/2" DIA 42" TALL STEEL GUARDRAIL WITH VERTICAL PICKETS AT 4" OC MAX. PAINTED SAFETY YELLOW. ANCHOR INTO PRECAST PLANK. REFER TO 2/A505.
- 4" TALL CMU WALL WITH BULLNOSE TOP AND OUTER EDGES. PAINT WITH EPOXY PAINT.
- FLOOR SLAB TO SLOPE TO CATCH BASIN. REFER TO PLUMBING DRAWINGS FOR WATER SUPPLY AND DRAIN.
- PROVIDE INSULATED STEEL DOOR AT PENTHOUSE, FACING SOUTH. DOOR #200 ON SCHEDULE.

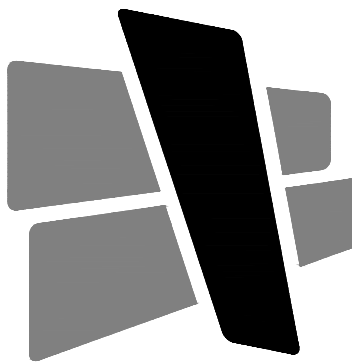


**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

## CERTIFICATION

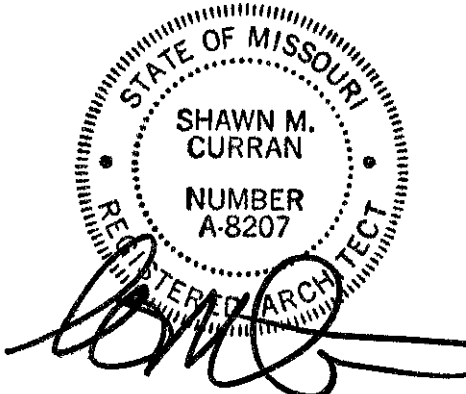

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

## PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

## ISSUE DATES

PERMIT SET 02.18.22  
REVISIONS 06.14.22


210300

ENLARGED  
FLOOR PLANS

**A110**




TOILET ACCESSORY SCHEDULE			
MARK	SYMBOL	MFR #	DESCRIPTION
TT1		BOBRICK B-2888	MULTI-ROLL TOILET TISSUE DISPENSER
GB1		BOBRICK B-5806 X 36 B-5806 X 42	36" AND 42" GRAB BARS
GB2		BOBRICK B-5806 X 18	18" VERTICAL GRAB BAR
MI		BOBRICK B-165	MIRROR 2'-0" X 4'-0"
TD1		BOBRICK B-3944	TOWEL DISPENSER / WASTE RECEPTACLE
SD1		BOBRICK B-2112	SOAP DISPENSER
ND1		BOBRICK B-353 B-270	B-353: SANITARY NAPKIN DISPOSAL UNIT AT GWB LOCATIONS B-270: SURFACE MOUNT SANITARY NAPKIN DISPOSAL UNIT AT PARTITIONS
TPI		GENERAL PARTITION	TOILET PARTITION AND/OR URINAL SCREEN POWDER COATED URINAL SCREEN BOTTOM 12" FROM FLOOR AND TOP 60" MAX FROM FLOOR

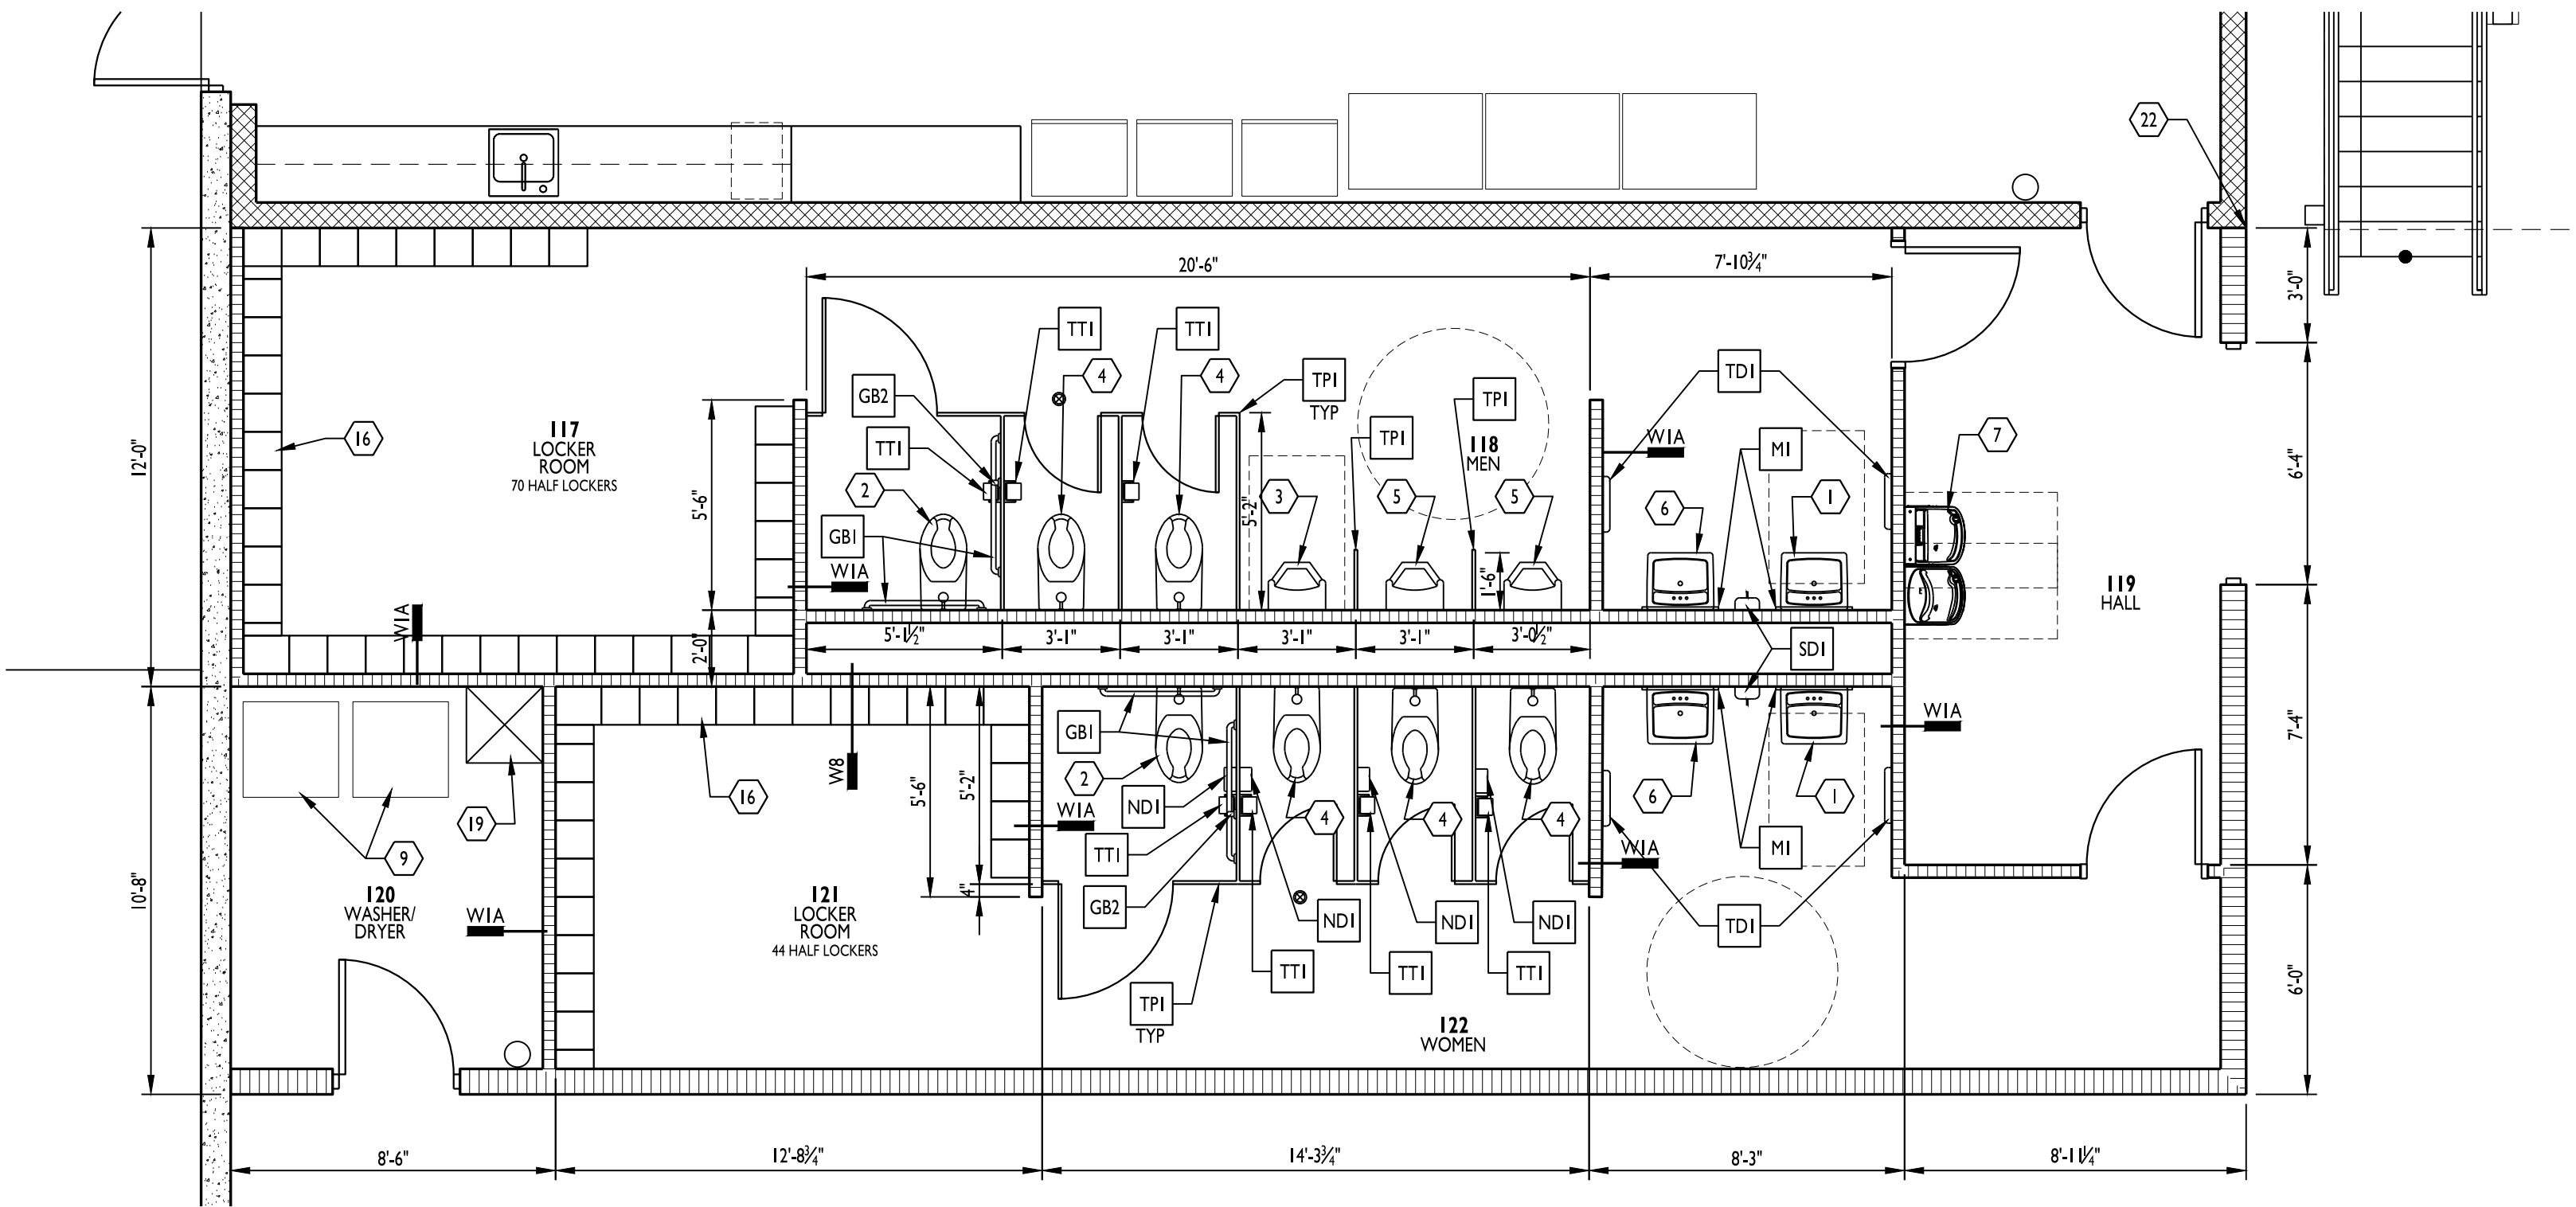

ENLARGED RESTROOM PLAN

1


1/4" = 1'-0"

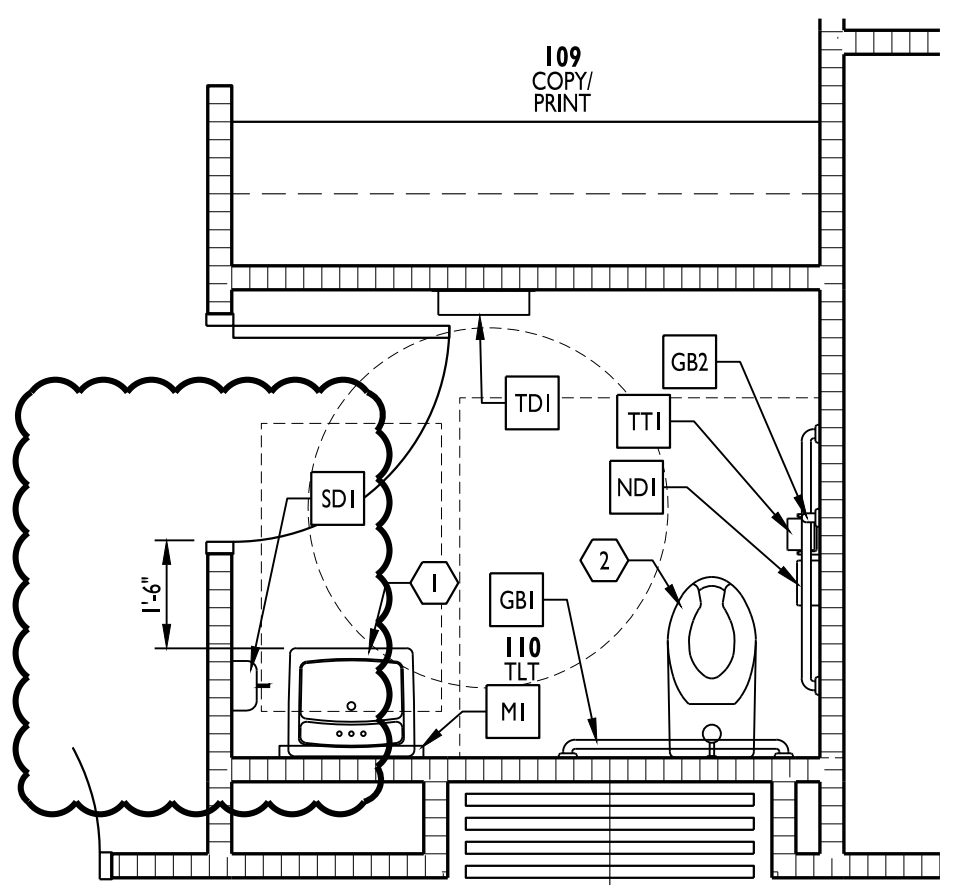

ENLARGED RESTROOM PLAN

2


3/8" = 1'-0"

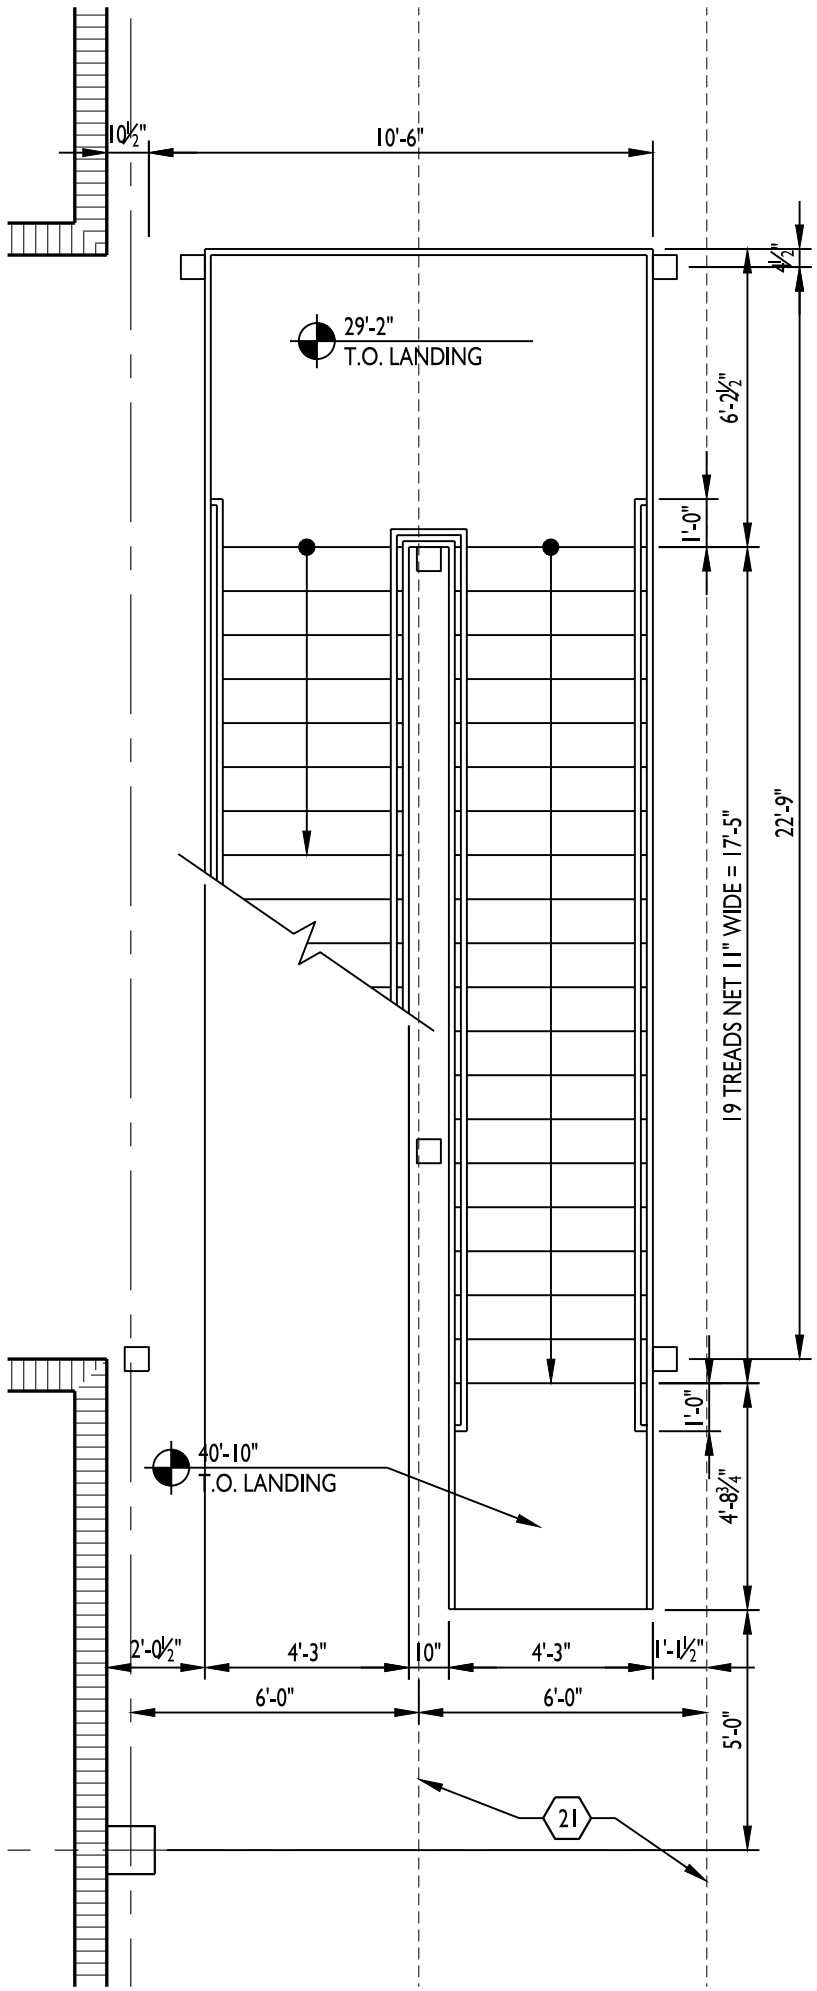

UPPER STAIR PLAN

4

1/4" = 1'-0"

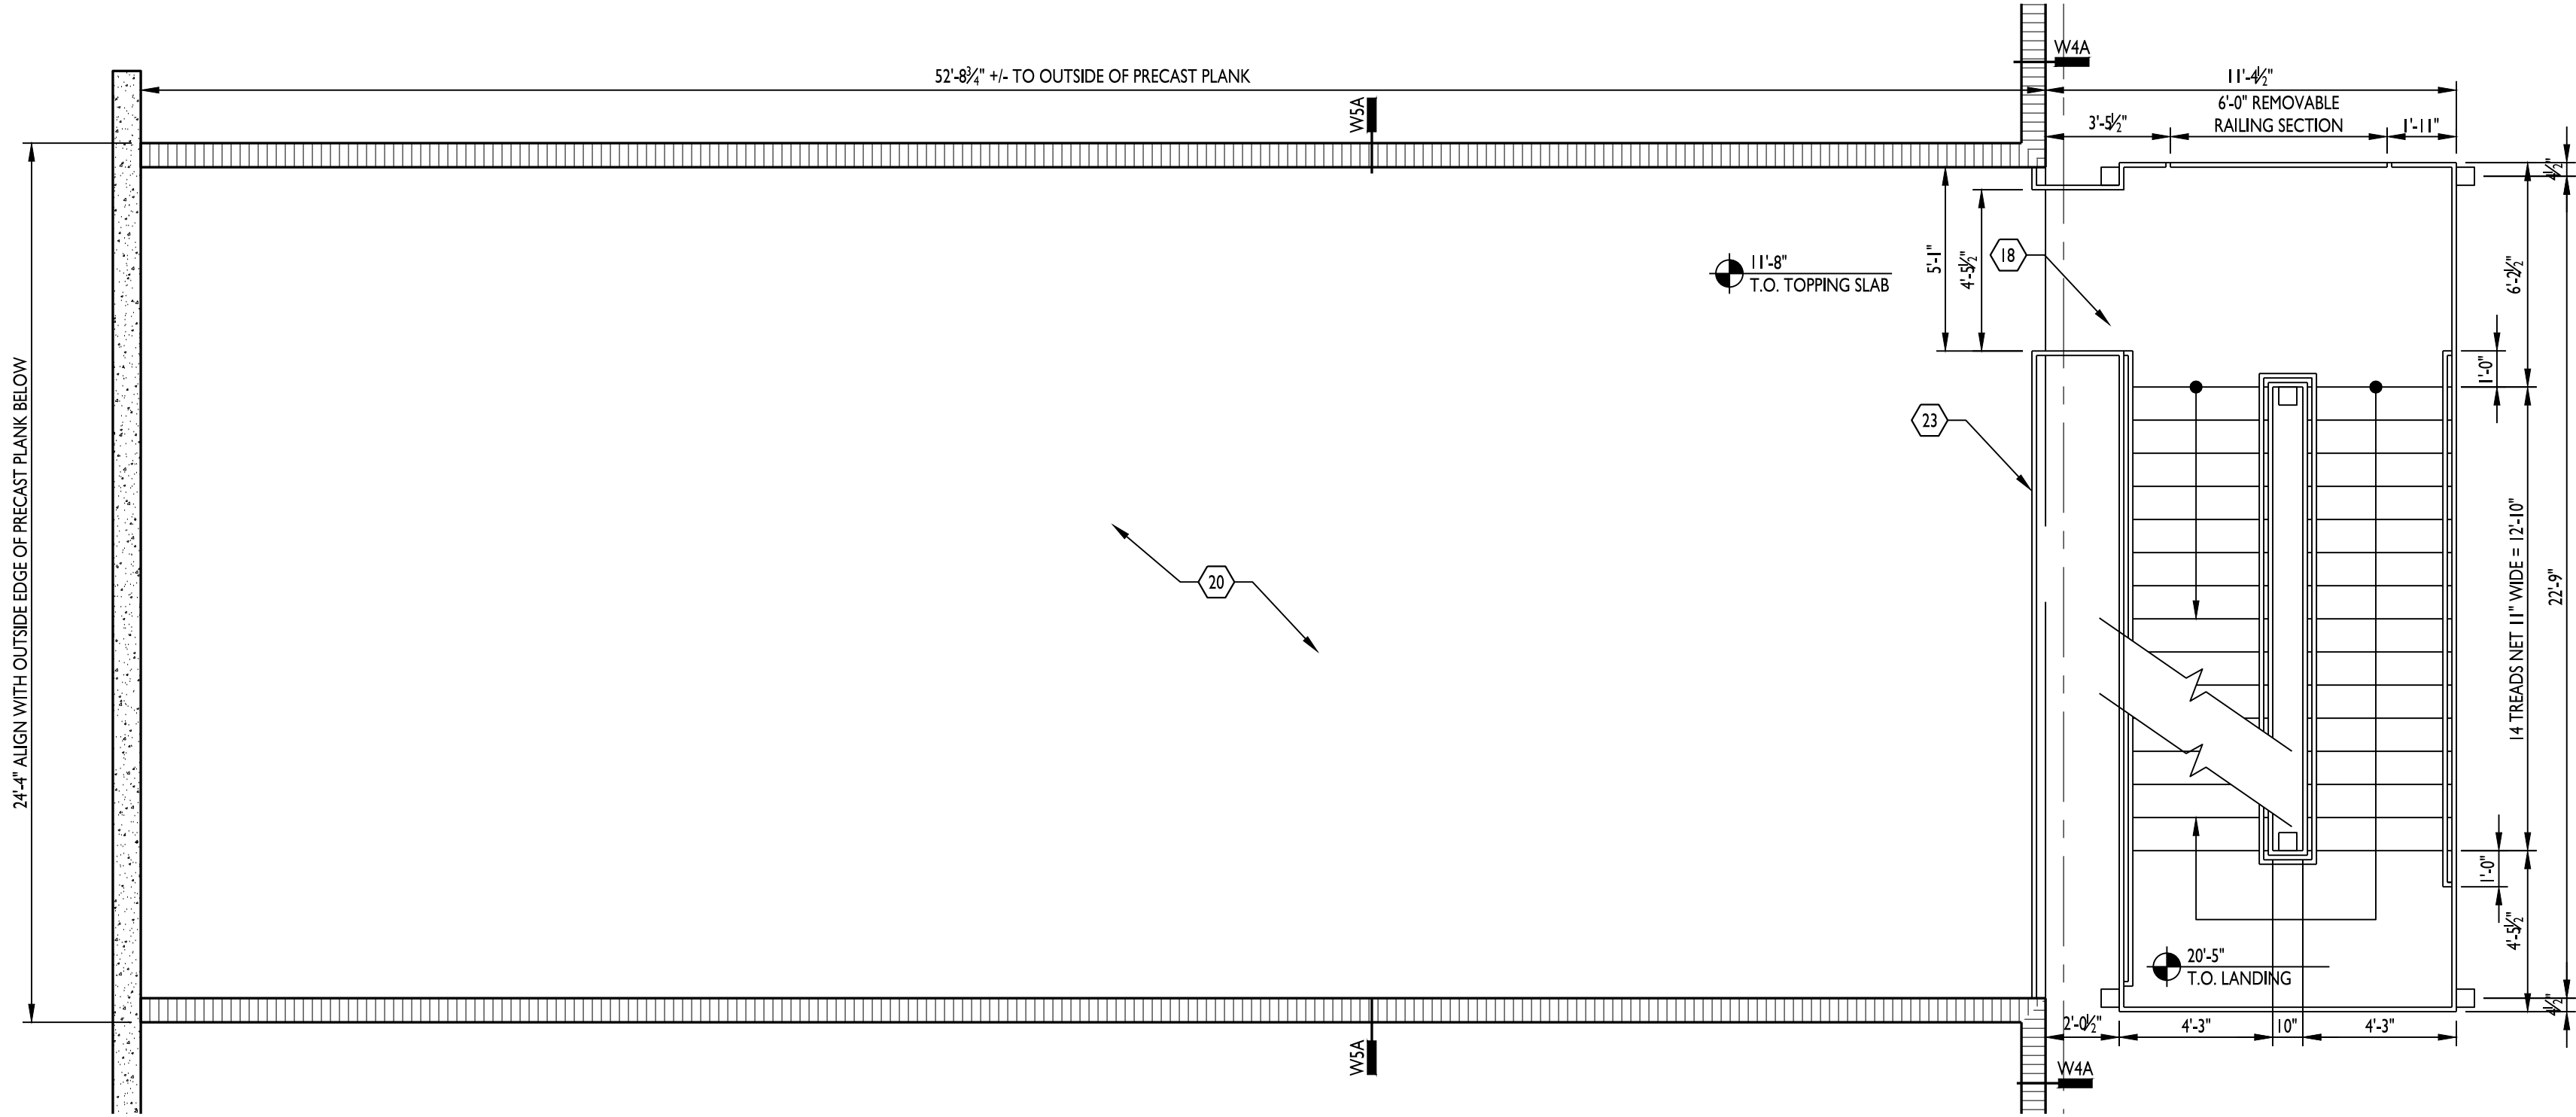

MEZZANINE PLAN

3


1/4" = 1'-0"

## GENERAL NOTES

- CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFICATION OF ALL DIMENSIONS AND JOB CONDITIONS. ANY DEVIATION FROM WHAT IS NOTED IN DRAWINGS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT IMMEDIATELY.
- ALL DIMENSIONS SHOWN ARE FACE OF BRICK, MASONRY OR METAL STUD FRAMING, UNLESS OTHERWISE NOTED.
- PROVIDE DEEP LEG DEFLECTION TRACK AT ALL METAL STUD CONNECTIONS WITH STRUCTURE ABOVE, TYPICAL.
- PROVIDE FIRE RATED WOOD BLOCKING IN METAL STUD WALLS FOR ANY WALL SUPPORTED ITEMS.
- PROVIDE APPROVED FIRE RATED STOPPING MATERIALS IN ANY OPENINGS IN FIRE RATED ASSEMBLIES.
- REFER TO DOOR AND WINDOW SCHEDULES FOR ALL MATERIALS, FINISHES, AND HARDWARE INFORMATION.
- REFER TO EXTERIOR ELEVATIONS FOR ALL BRICK, MASONRY, AND OTHER EXPANSION JOINT LOCATIONS.
- ALL MATERIALS LOCATED IN CEILING PLENUM SHALL BE RATED FOR SUCH INSTALLATION OR PROTECTED TO PROVIDE COMPLIANCE. THIS INCLUDES BUT IS NOT LIMITED TO INSULATION (FHC 25/50) POWER AND LOW VOLTAGE WIRING, TELECOMMUNICATIONS CABLING, PLUMBING SUPPLY AND DRAIN LINES AND SUPPORTING BRACKETS AND/OR BLOCKING FOR CEILING HUNG ITEMS.
- PRIOR TO ORDERING ANY PRODUCTS, CONTRACTOR SHALL SUBMIT SAMPLES TO THE ARCHITECT OF ALL FINISH MATERIALS TO BE USED ON THE PROJECT. THE CONTRACTOR SHALL BEAR SOLE RESPONSIBILITY FOR ANY MATERIALS ORDERED INCORRECTLY WHEN THAT MATERIAL WAS NOT REVIEWED BY THE ARCHITECT.
- PROVIDE CONCRETE FILLED STEEL PIPE BOLLARDS AT ALL REQUIRED UTILITY EQUIPMENT LOCATIONS SUCH AS GAS METERS, ELECTRICAL TRANSFORMER PANELS, ETC.. COORDINATE WITH UTILITY COMPANY AND CONTRACTORS, WHEN APPLICABLE, FOR NECESSARY LOCATIONS. REFER TO CIVIL DRAWINGS FOR BOLLARD SPECIFICATIONS AND ADDITIONAL INFORMATION.
- ALL DOORS, UNLESS OTHERWISE NOTED, TO HAVE HINGE SIDE SET 4" FROM CORNER SHOWN TO OUTSIDE OF FRAME.
- UNLESS SPECIFIED ELSEWHERE, ALL INTERIOR SLABS AND SLAB INFILLS TO BE FF-50/FL-25 OVERALL AND FF-35/FL-25 LOCAL.
- ALL EXIT DOORS TO HAVE TACTILE EXIT SIGNAGE PER 703.4 OF THE ANSI 117.1 2009.

## KEYED NOTES

- ADA COMPLIANT WALL MOUNTED LAVATORY. PROVIDE SCALD GUARDS ON SUPPLY / WASTE LINE. REFER TO PLUMBING DWGS. SEE TYPICAL ACCESSIBILITY DETAILS FOR ACCESSIBLE MOUNTING INFORMATION.
- ADA COMPLIANT WALL MOUNT FLUSH VALVE TOILET. REFER TO PLUMBING DWGS. SEE TYPICAL ACCESSIBILITY DETAILS FOR ACCESSIBLE MOUNTING INFORMATION.
- ADA COMPLIANT WALL MOUNTED URINAL W/ FLUSH VALVE CONTROL. CENTER IN WIDTH OF STALL. REFER TO PLUMBING DRAWINGS. SEE TYPICAL ACCESSIBILITY DETAILS FOR ACCESSIBLE MOUNTING INFORMATION.
- STANDARD HEIGHT WALL MOUNT FLUSH VALVE TOILET. CENTER IN WIDTH OF STALL.
- STANDARD HEIGHT URINAL. CENTER IN WIDTH OF PARTITIONS (OR WALL).
- WALL MOUNTED LAVATORY. MATCH HEIGHT OF ADA LAVATORIES
- ADA COMPLIANT H2O WATER FOUNTAIN.
- ALIGN FINISH FACE OF WALL, BOTH SIDES.
- WASHER & DRYER.
- 8'-0" TALL GALVANIZE D FENCE. PROVIDE GATE PER DETAIL 4/A504.
- PLASTIC LAMINATE 12" WIDE COUNTER. CENTER ON WIDTH OF WALL.
- PASS THRU CABINET W/ DOORS ON BOTH SIDES SEE 6/A504. CENTER ON WIDTH OF WALL.
- MODERN FOLD PAIRED PANEL PARTITION W/ VINYL FACE, MIN 51 STC RATING. COORDINATE ALCOVE DIMENSIONS W/ SUPPLIER.
- PROVIDE FR BLOCKING FOR TENANT PROVIDED TV.
- STRUCTURAL STEEL COLUMN.
- HALF HEIGHT LOCKERS 12" x 12" w/ 4" CURB & SLOPED TOP. PROVIDE 2 ADA COMPLIANT LOCKERS IN EACH ROOM.
- WALL MOUNT SHELF. REFER TO 5/A504.
- STEEL STAIRS. PAINT SAFETY YELLOW. REFER TO 1/A505.
- 2' x 2' MOP SINK w/ WALL MOUNT FAUCET.
- PRECAST PLANK ON CMU WALL WITH TOPPING SLAB. TOP OF SLAB AT 11'-8" AFF. REFER TO STRUCTURAL DRAWINGS
- BAR JOIST ROOF FRAMING ABOVE. COORDINATE WITH STRUCTURAL DRAWINGS
- ALIGN FINISH FACE OF GYP BOARD WITH FACE OF CMU WALL.
- 1 1/2" DIA 42" TALL STEEL GUARDRAIL WITH VERTICAL PICKETS AT 4" OC MAX. PAINTED SAFETY YELLOW. ANCHOR INTO PRECAST PLANK. REFER TO 2/A505
- 4" TALL CMU WALL WITH BULLNOSE TOP AND OUTER EDGES. PAINT WITH EPOXY PAINT.
- FLOOR SLAB TO SLOPE TO CATCH BASIN. REFER TO PLUMBING DRAWINGS FOR WATER SUPPLY AND DRAIN
- PROVIDE INSULATED STEEL DOOR AT PENTHOUSE, FACING SOUTH. DOOR #200 ON SCHEDULE.

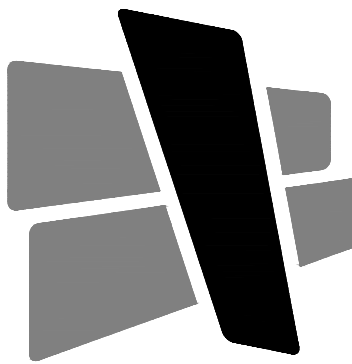


**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

## CERTIFICATION

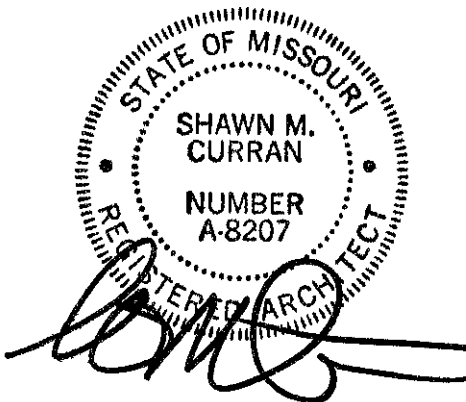

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

## PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

## ISSUE DATES

PERMIT SET	02.18.22
PERMIT COMMENTS	10.24.22



210300


ENLARGED  
FLOOR PLANS

**AIII**




CEILING LEGEND  
(NOT ALL MAY APPLY)

- ACOUSTICAL TILE CEILING / GRID. REFER TO FINISH SCHEDULE FOR TYPE AND HEIGHT.
- GYPSUM BOARD BULKHEAD OR CEILING. HEIGHT AS NOTED ON SCHEDULE OR KEYNOTES.

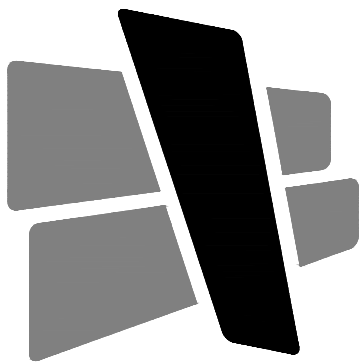


CURRAN  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



SCANNELL  
PROPERTIES

CERTIFICATION

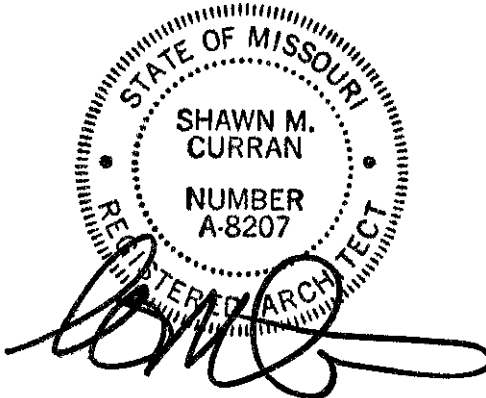

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT 1

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


ISSUE DATES

PERMIT SET 02.18.22

210300


OVERALL REFLECTED  
CEILING PLAN

A112

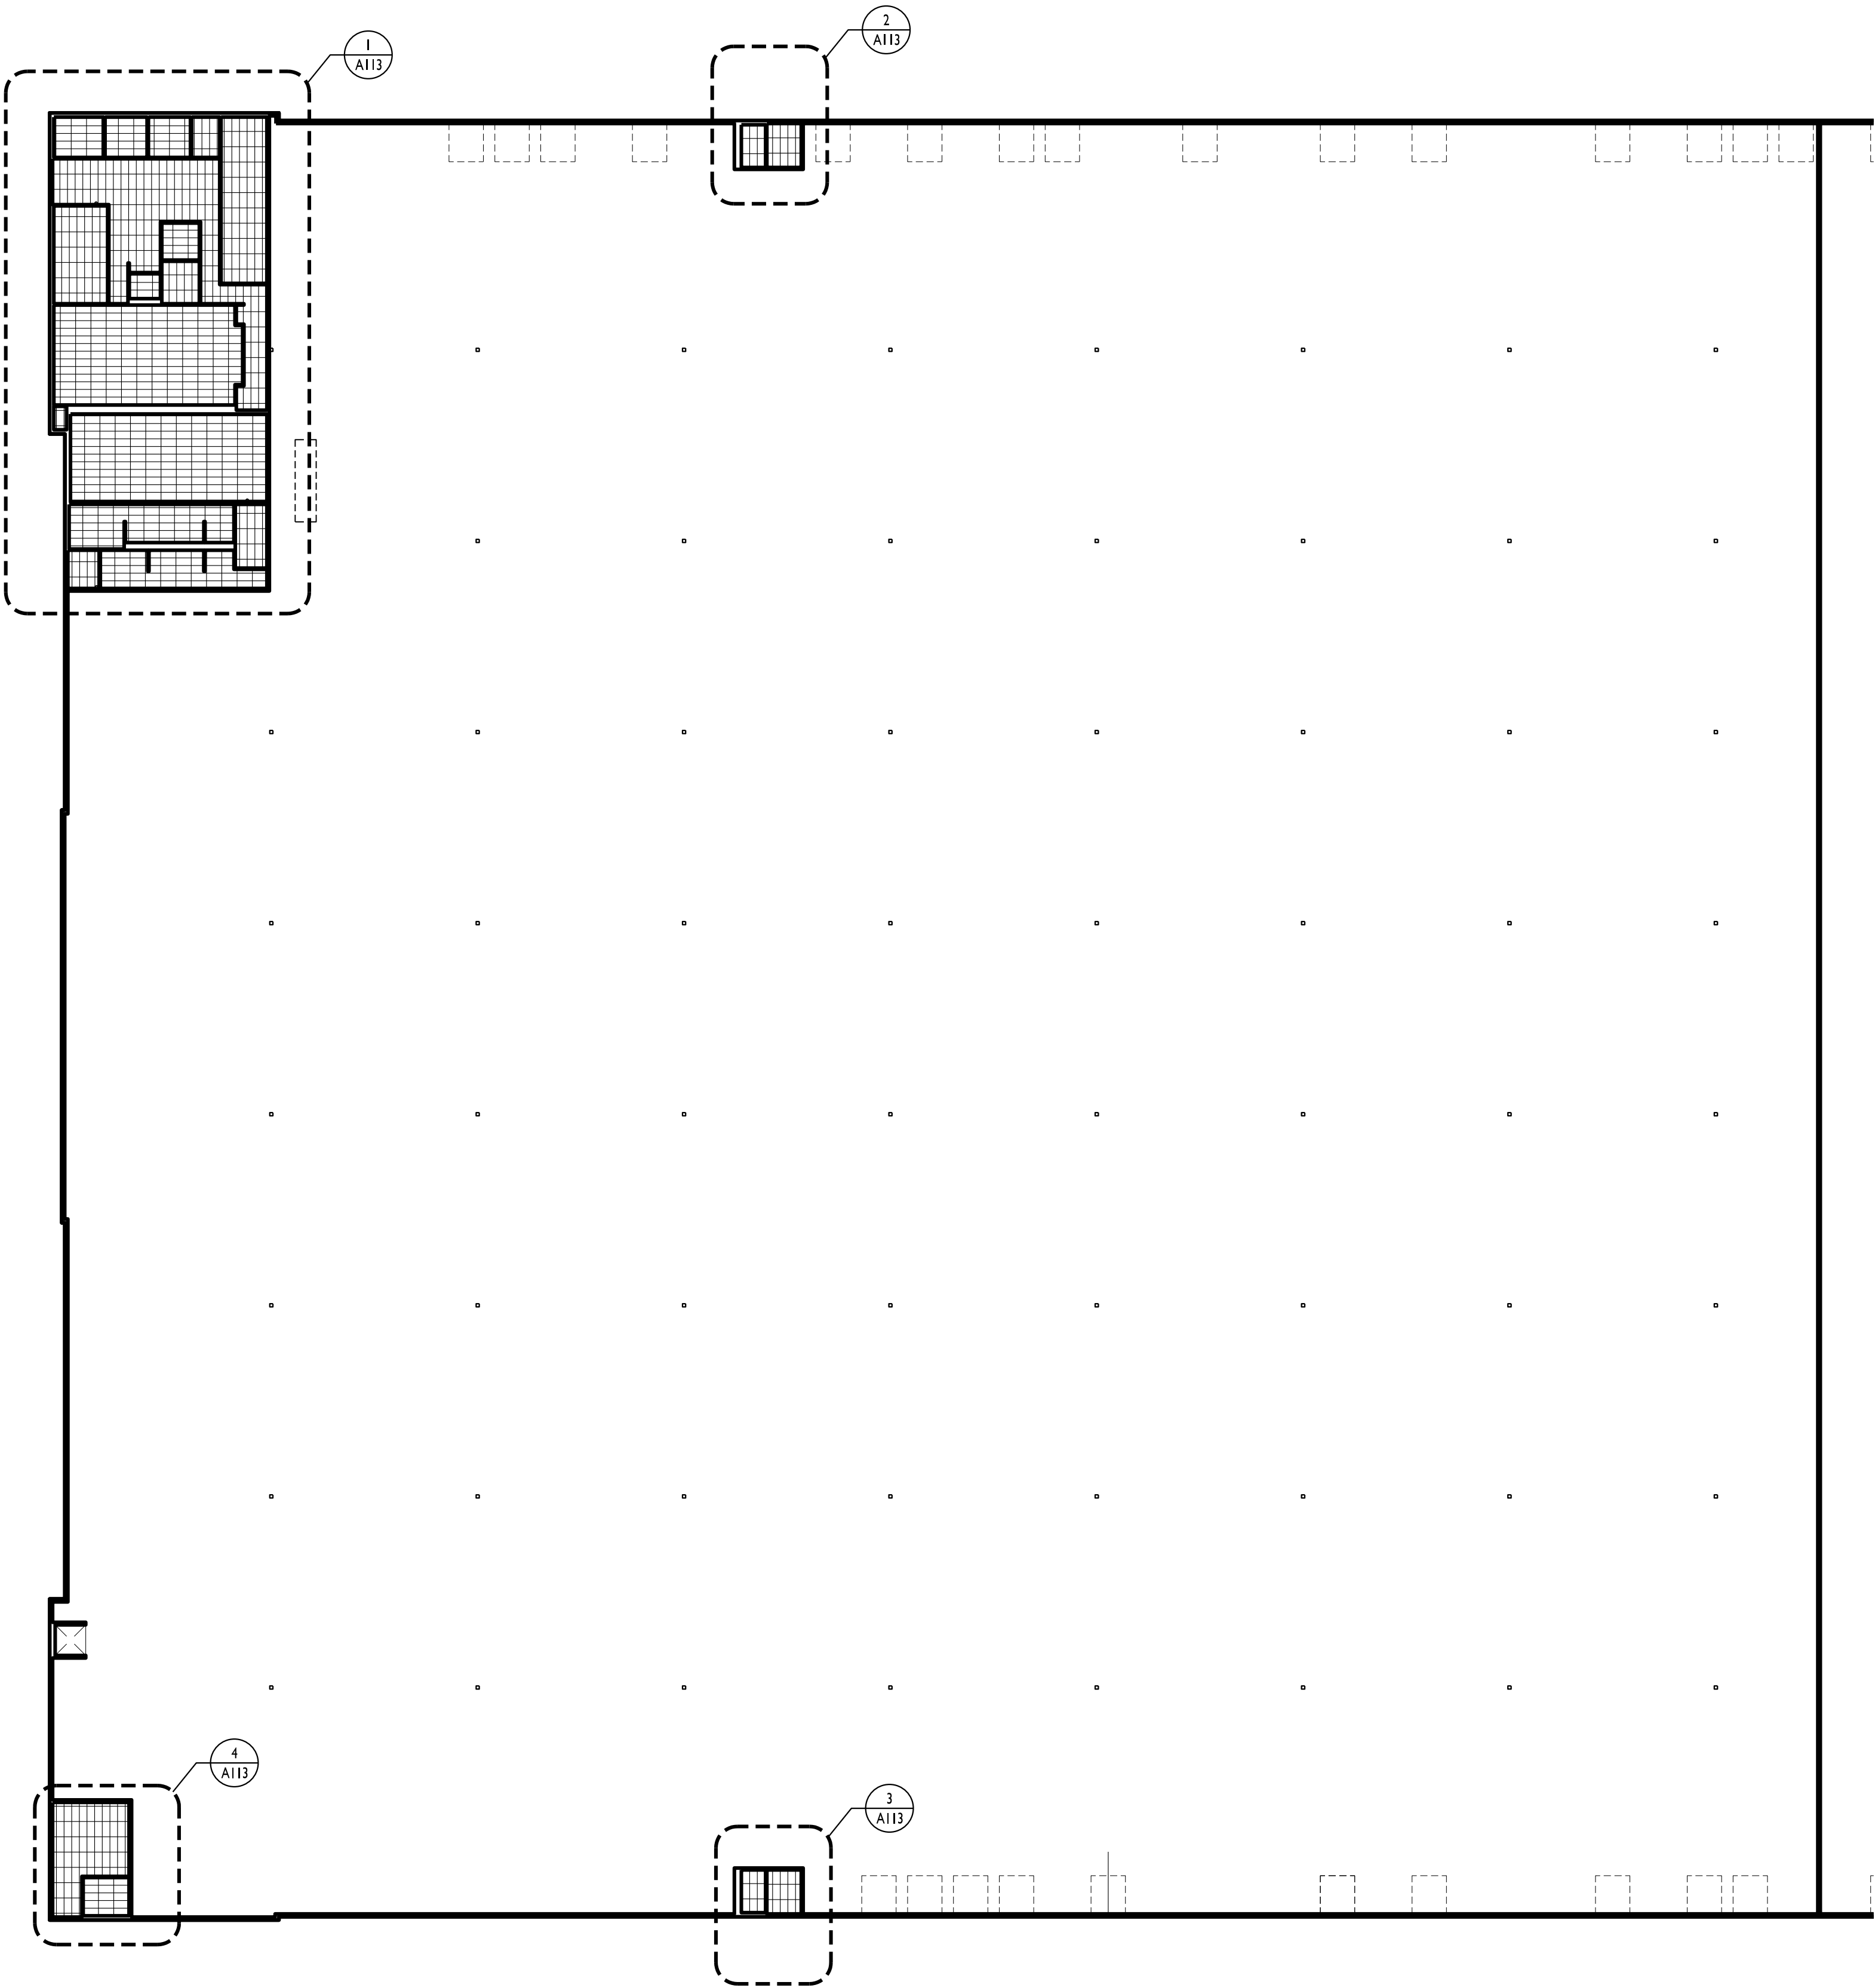


REFLECTED CEILING PLAN

1" = 30'

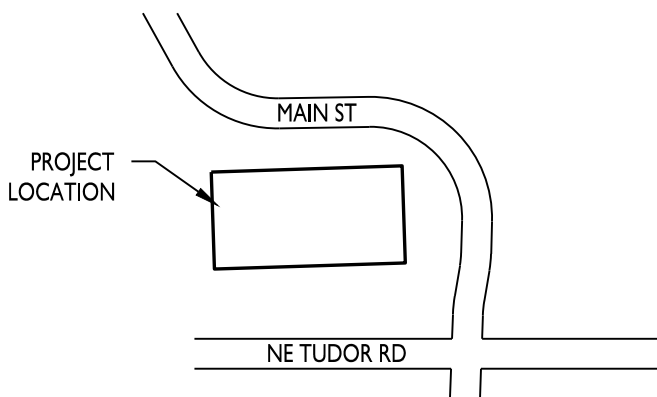

KEY PLAN



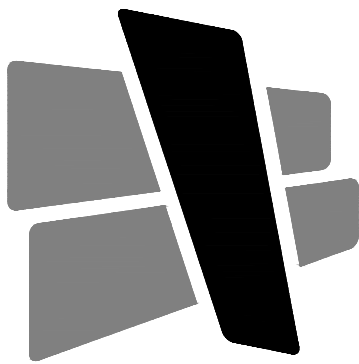


**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

CERTIFICATION

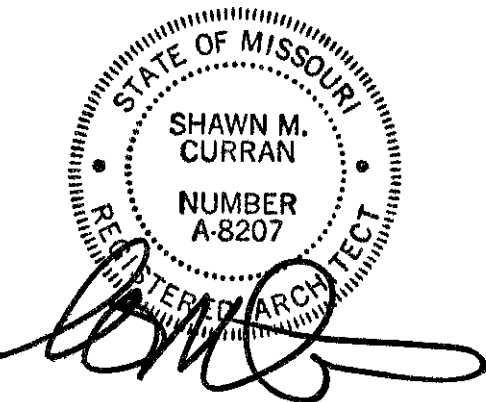

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT 1

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES

PERMIT SET 02.18.22

210300

ENLARGED REFLECTED  
CEILING PLANS

**A113**

CEILING LEGEND


(NOT ALL MAY APPLY)




ACOUSTICAL TILE CEILING / GRID. REFER TO FINISH SCHEDULE FOR TYPE AND HEIGHT.




GYPSUM BOARD BULKHEAD OR CEILING. HEIGHT AS NOTED ON SCHEDULE OR KEYNOTES.

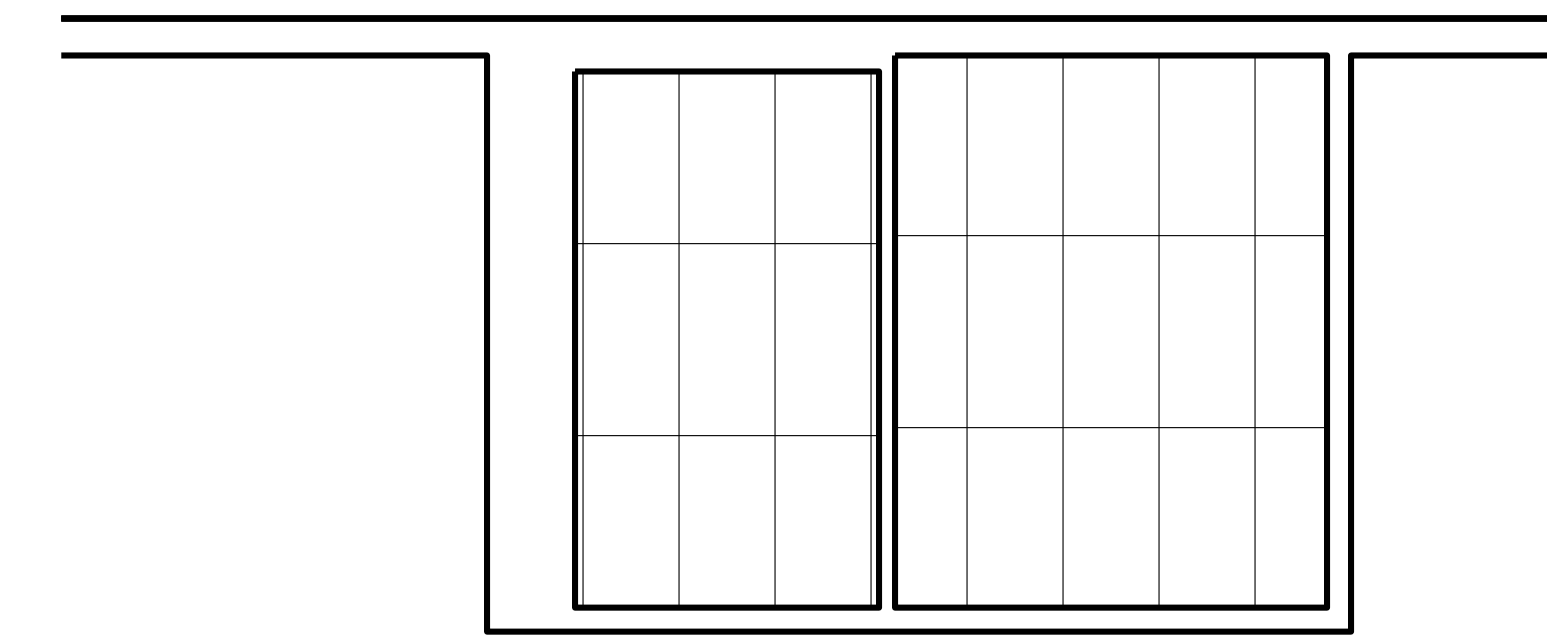


ENLARGED REFLECTED CEILING PLAN **2**  
1/4" = 1'-0"

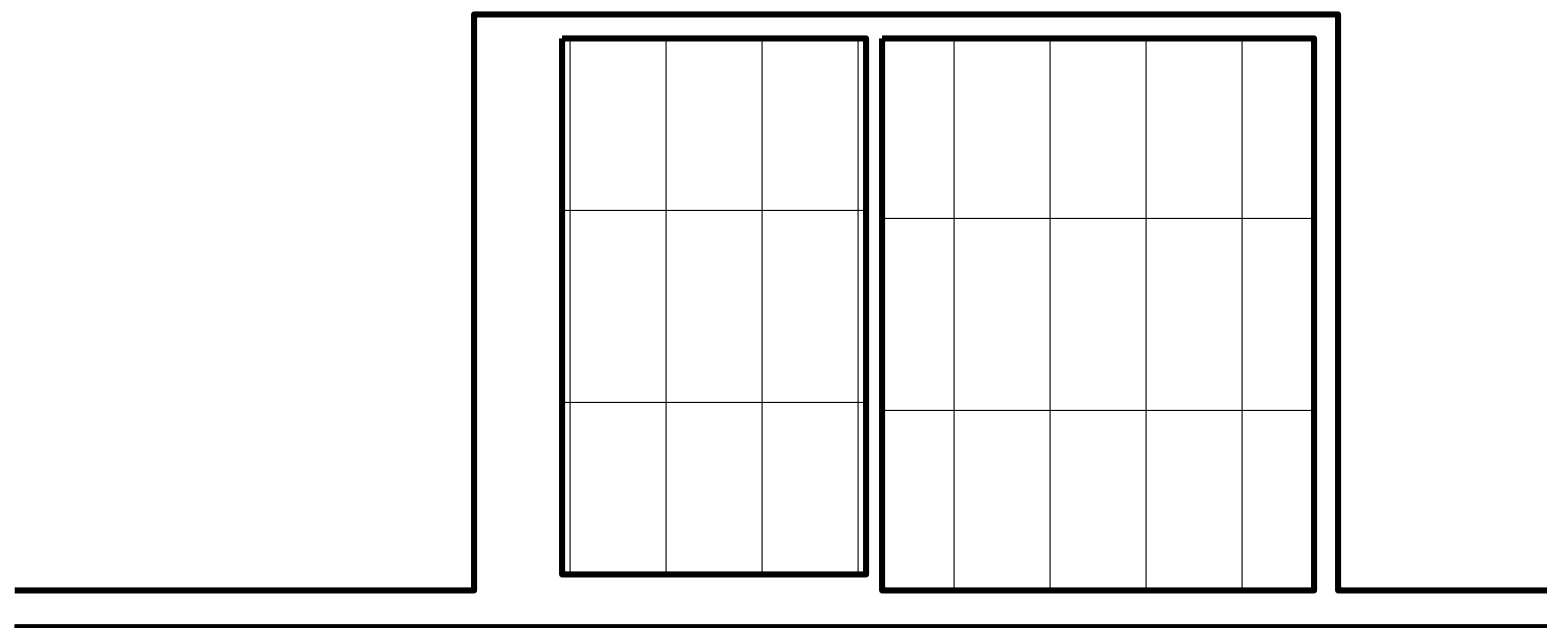


ENLARGED REFLECTED CEILING PLAN **3**  
1/4" = 1'-0"

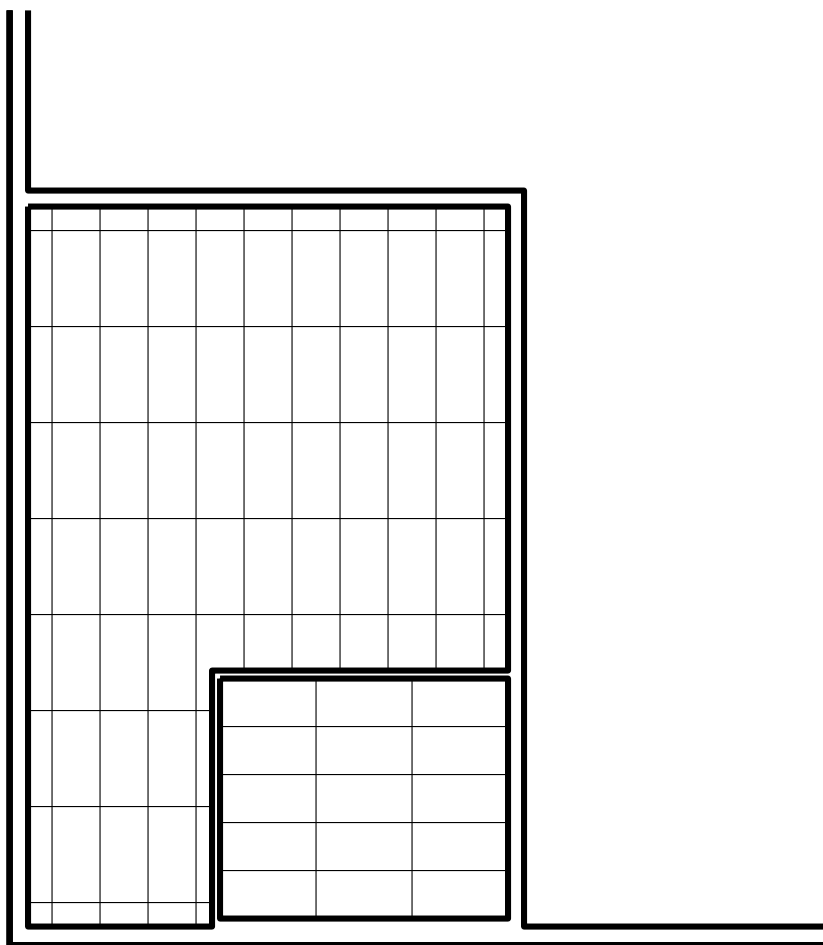

ENLARGED REFLECTED CEILING PLAN **4**  
1/8" = 1'-0"

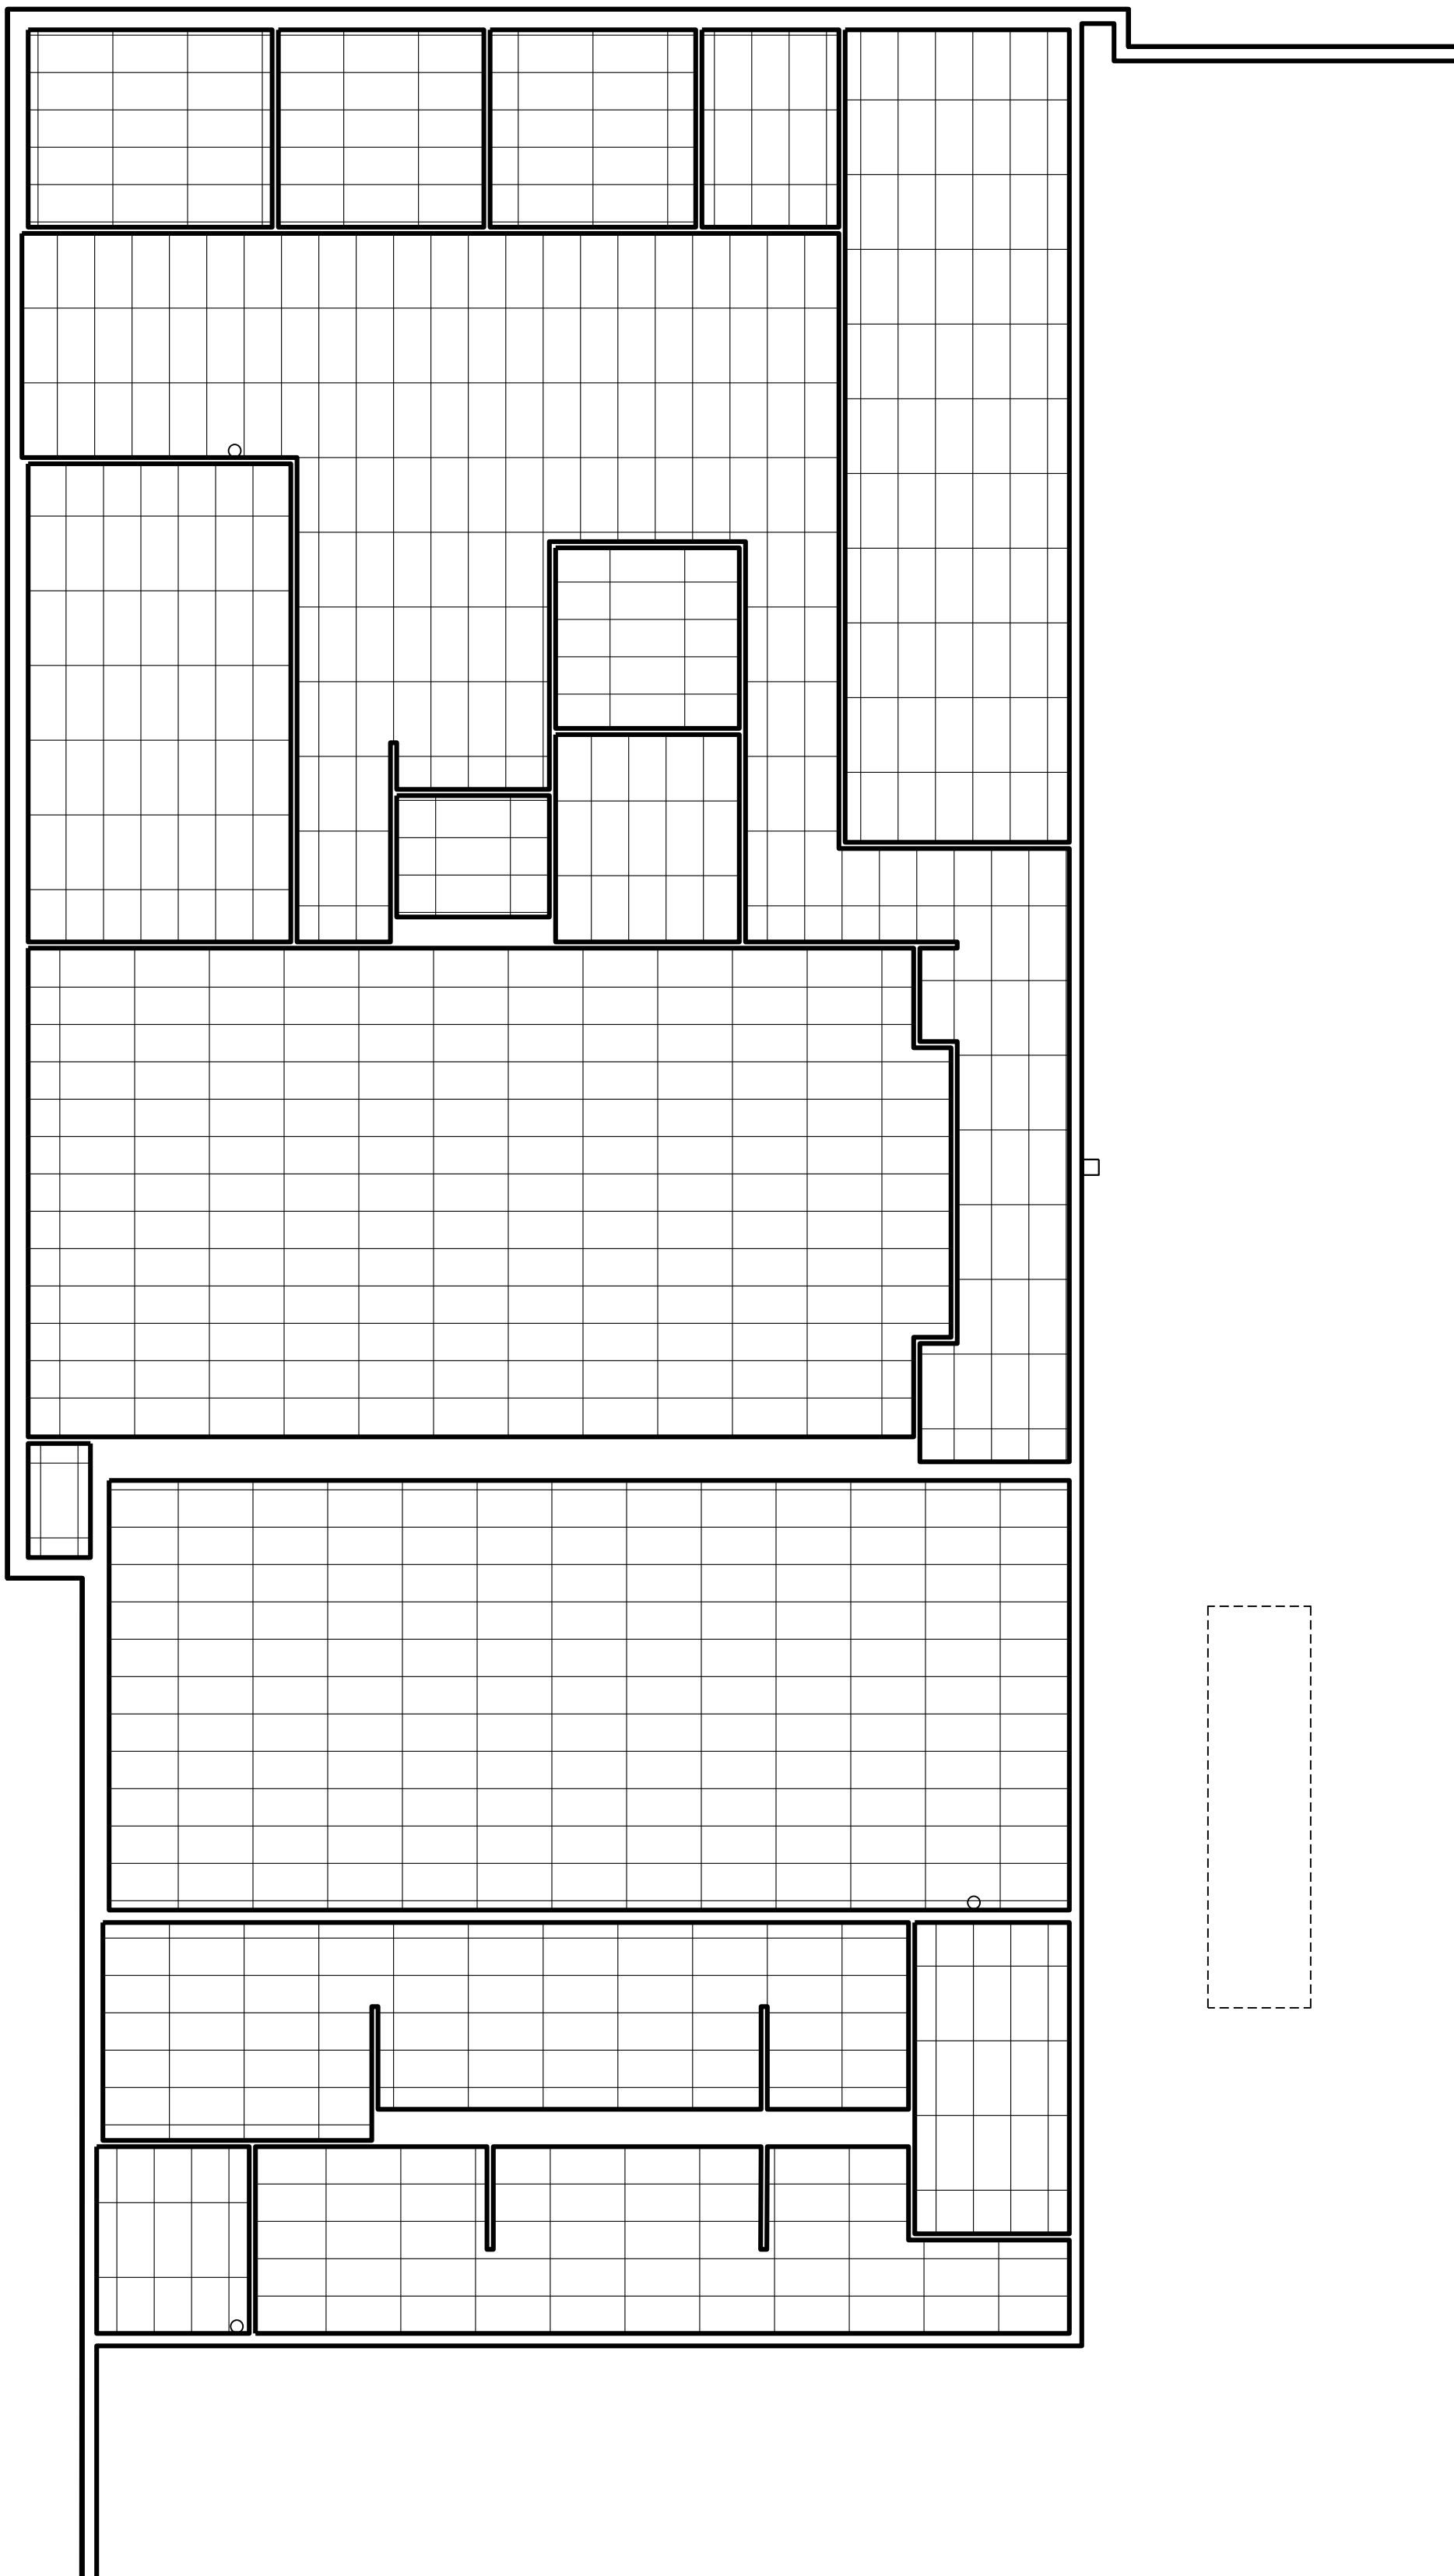


ENLARGED REFLECTED CEILING PLAN **1**  
1/8" = 1'-0"

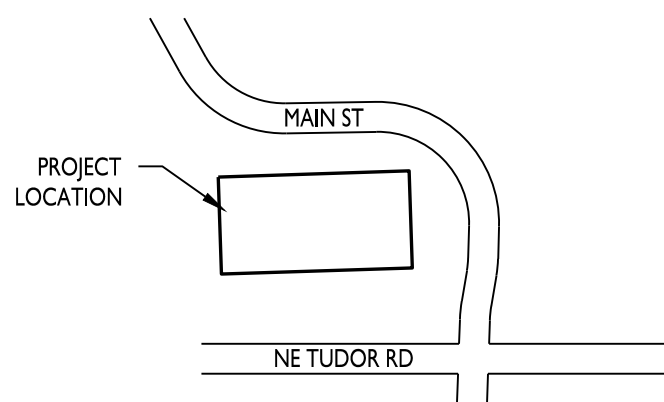


**KEY PLAN**



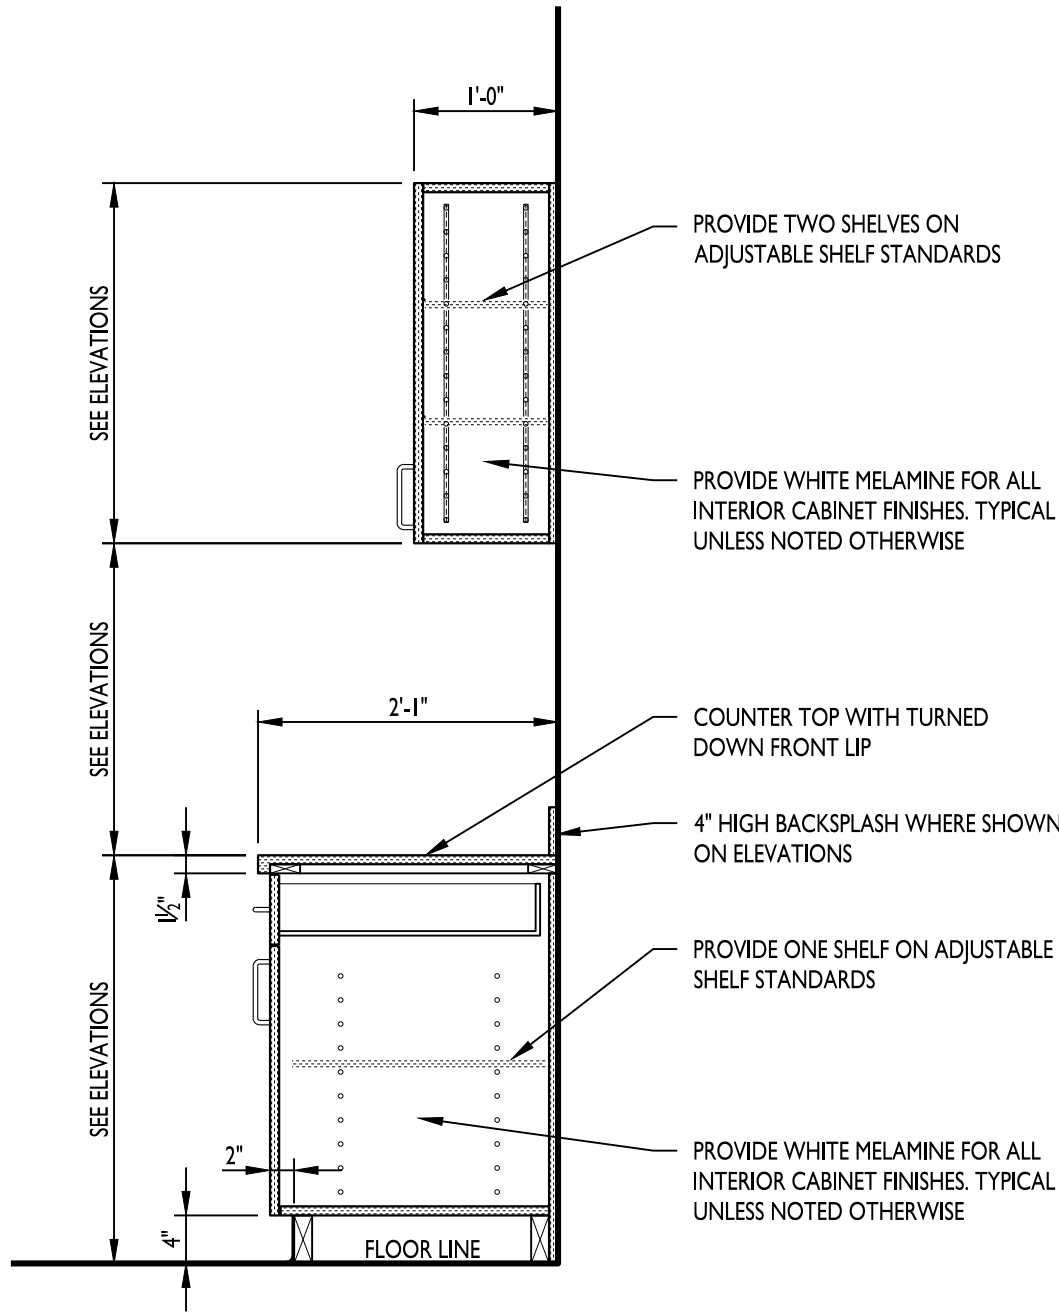


CASEWORK SECTION

3/4" = 1'-0"

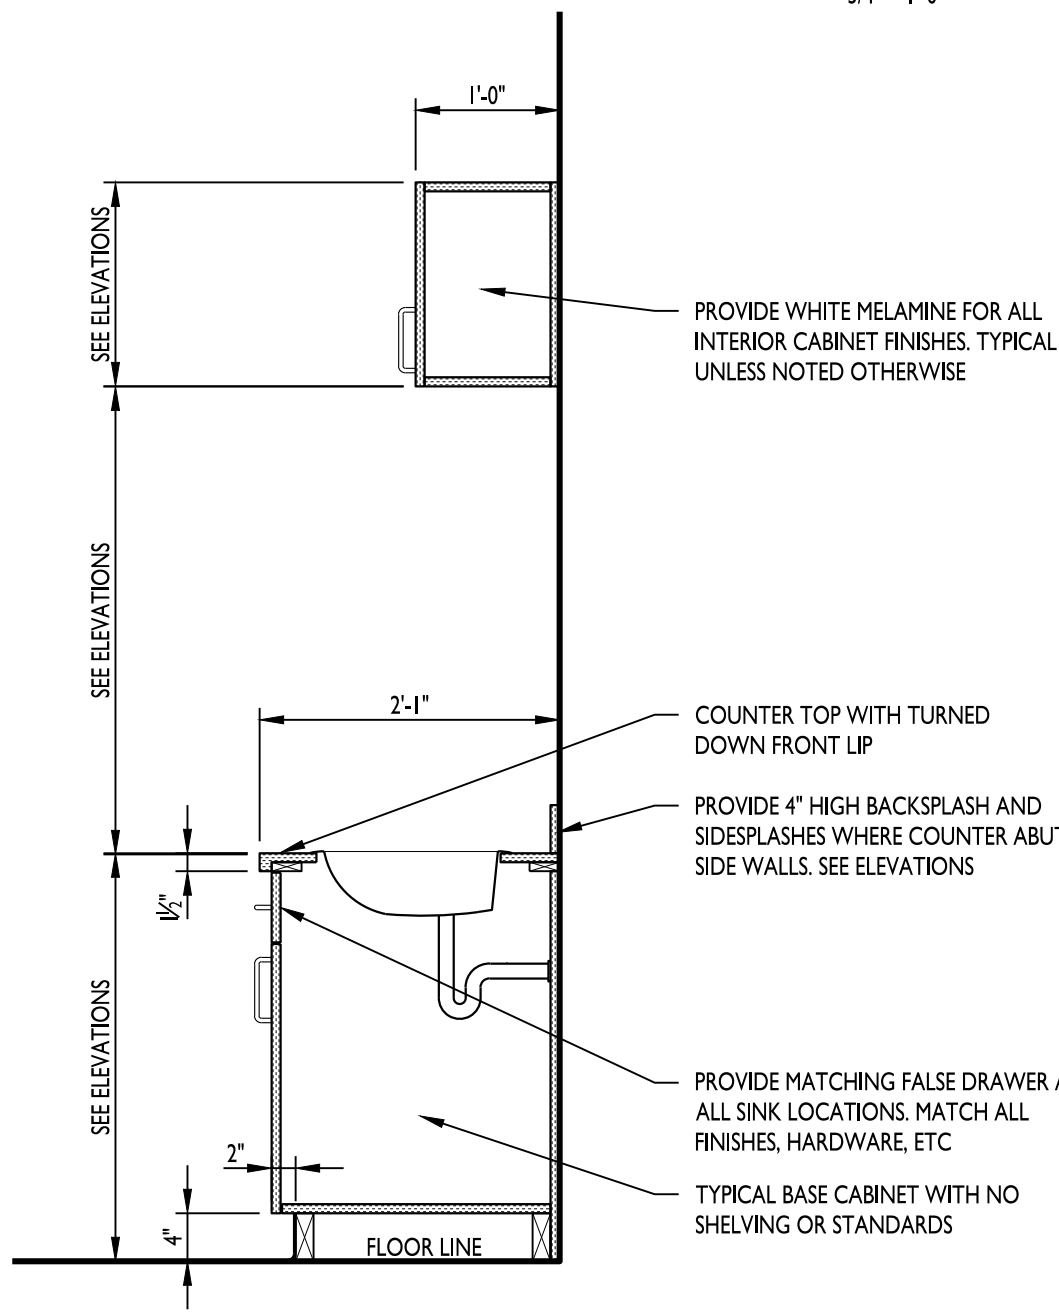


CASEWORK SECTION

3/4" = 1'-0"

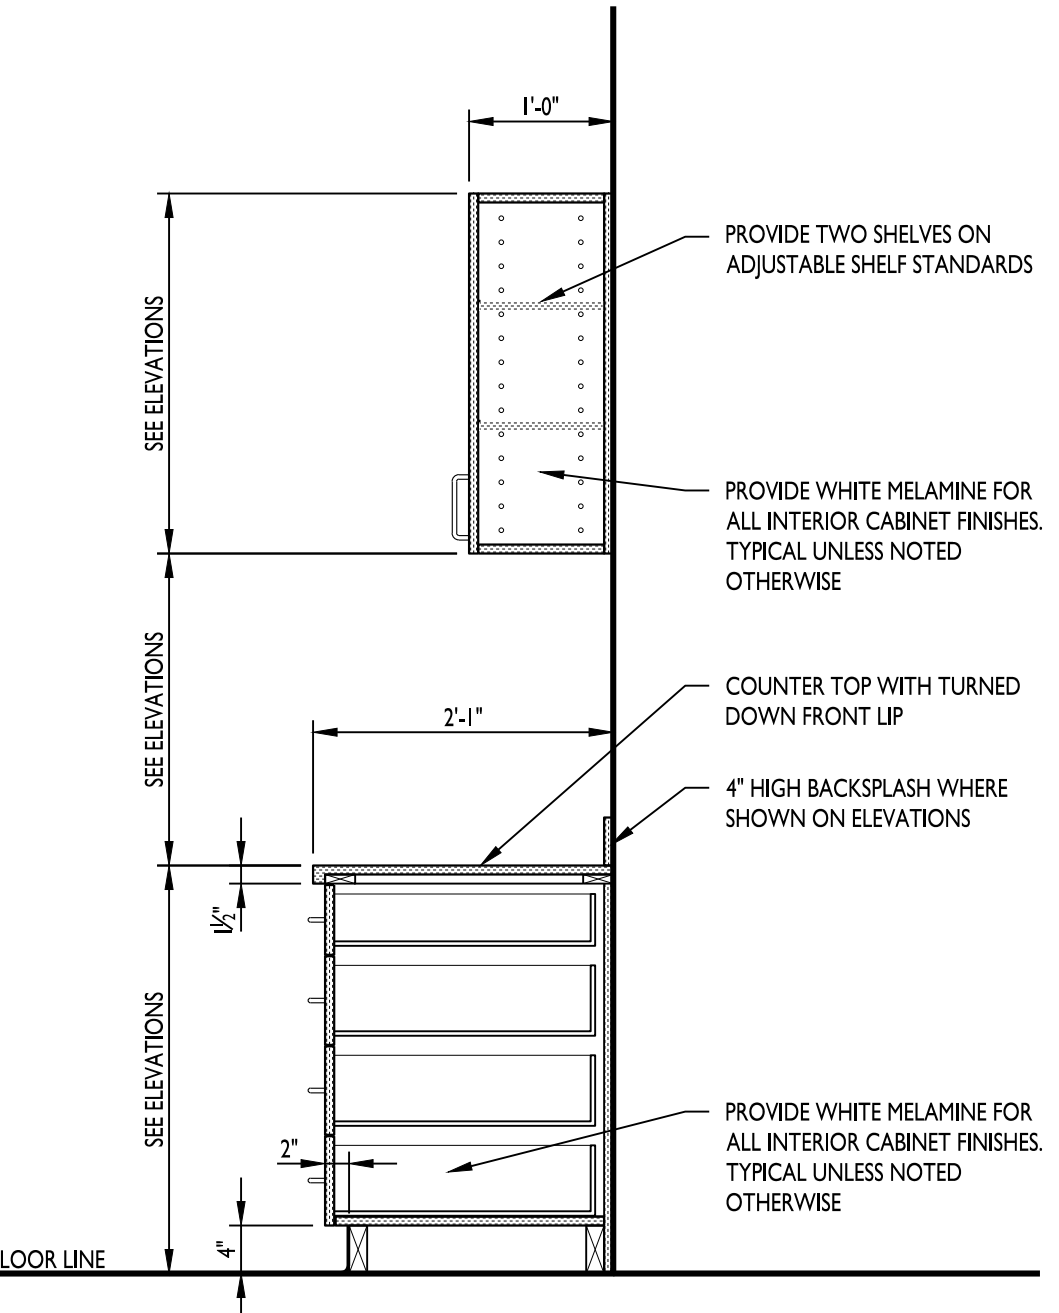


CASEWORK SECTION

3/4" = 1'-0"

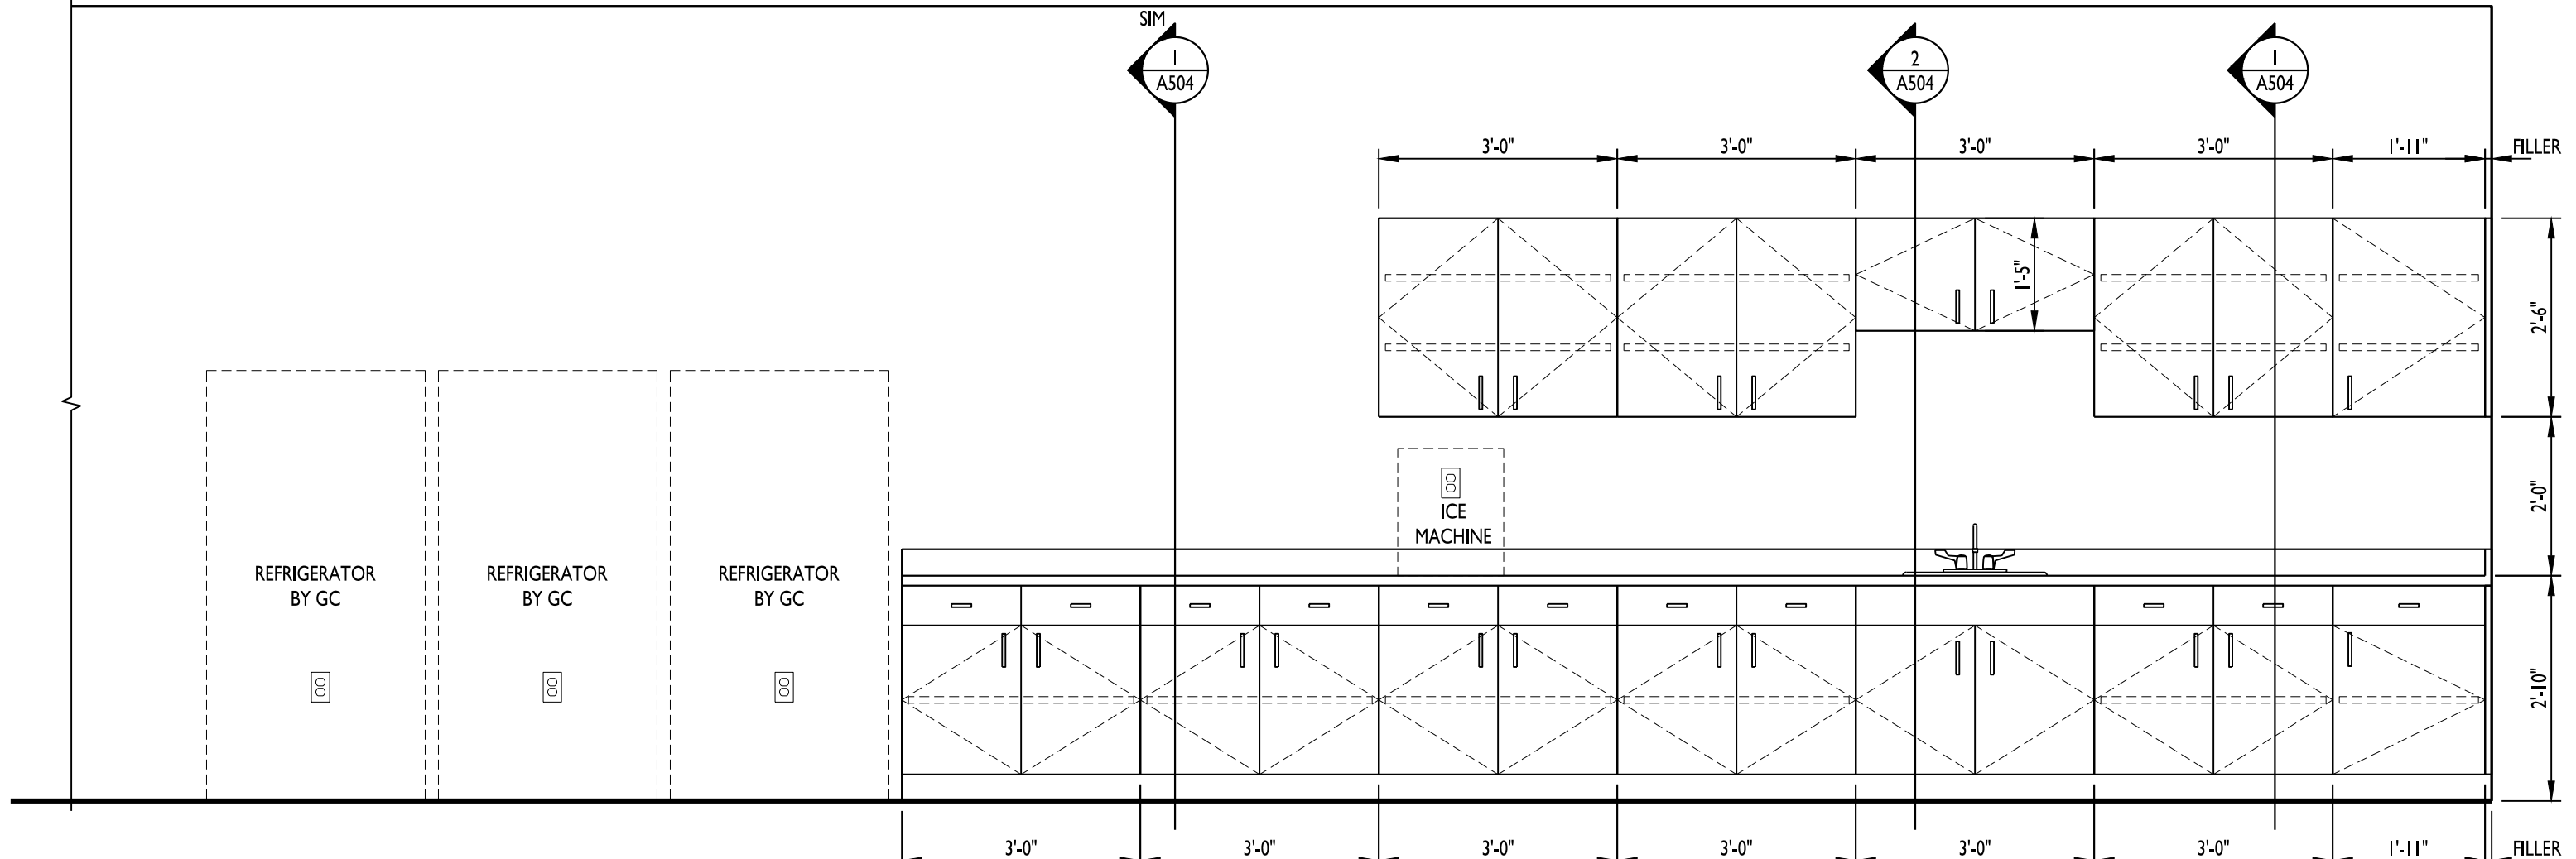


CASEWORK ELEVATION

1/2" = 1'-0"

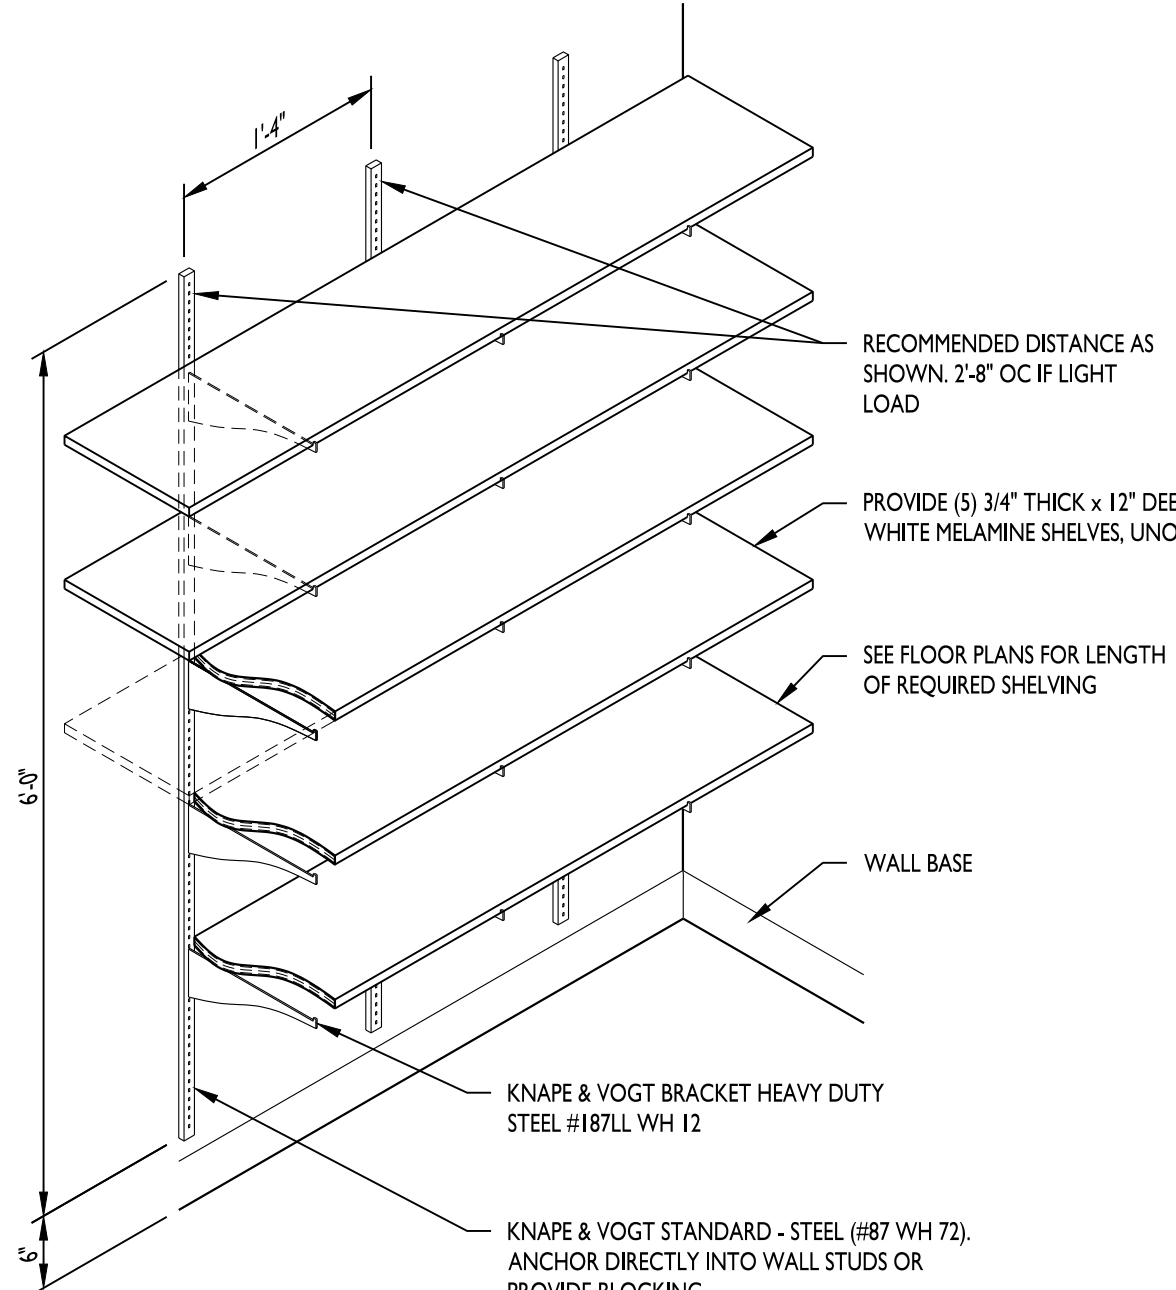


ADJUSTABLE SHELVING

3/4" = 1'-0"

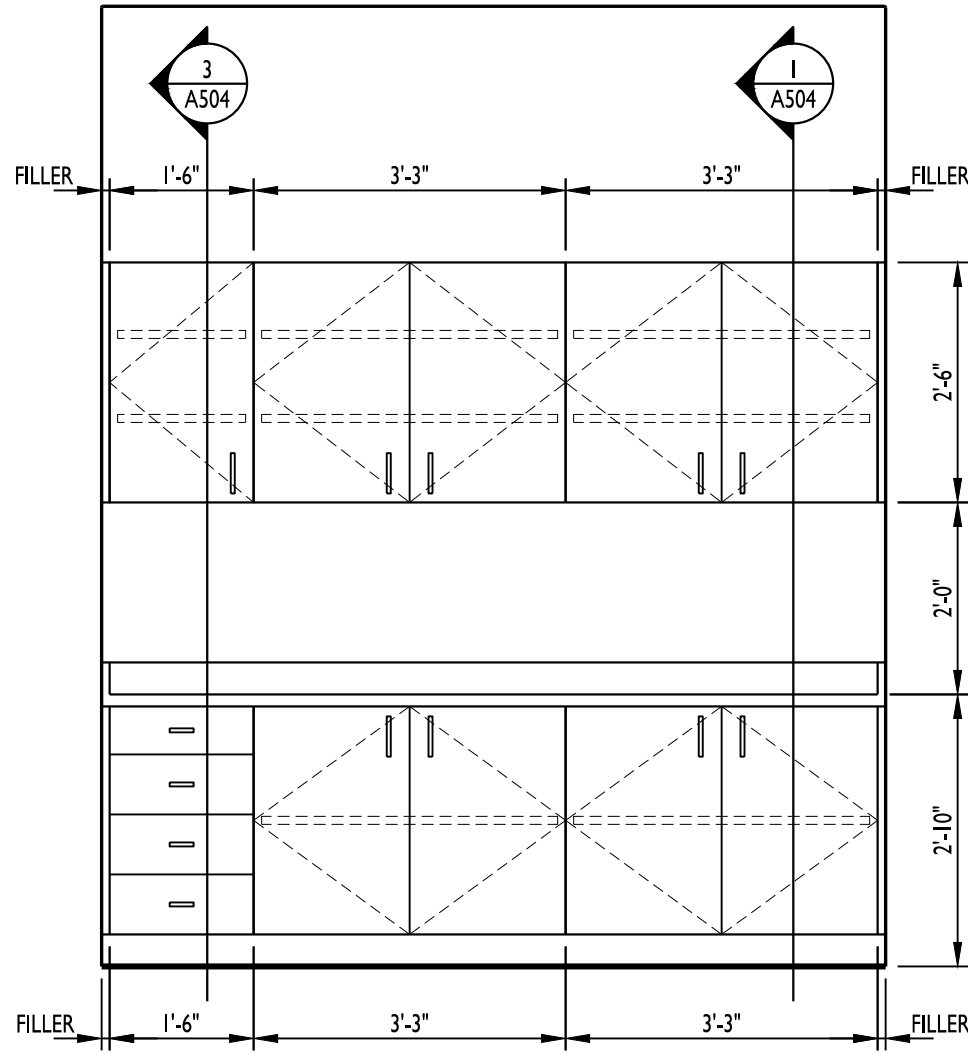


CASEWORK ELEVATION

1/2" = 1'-0"

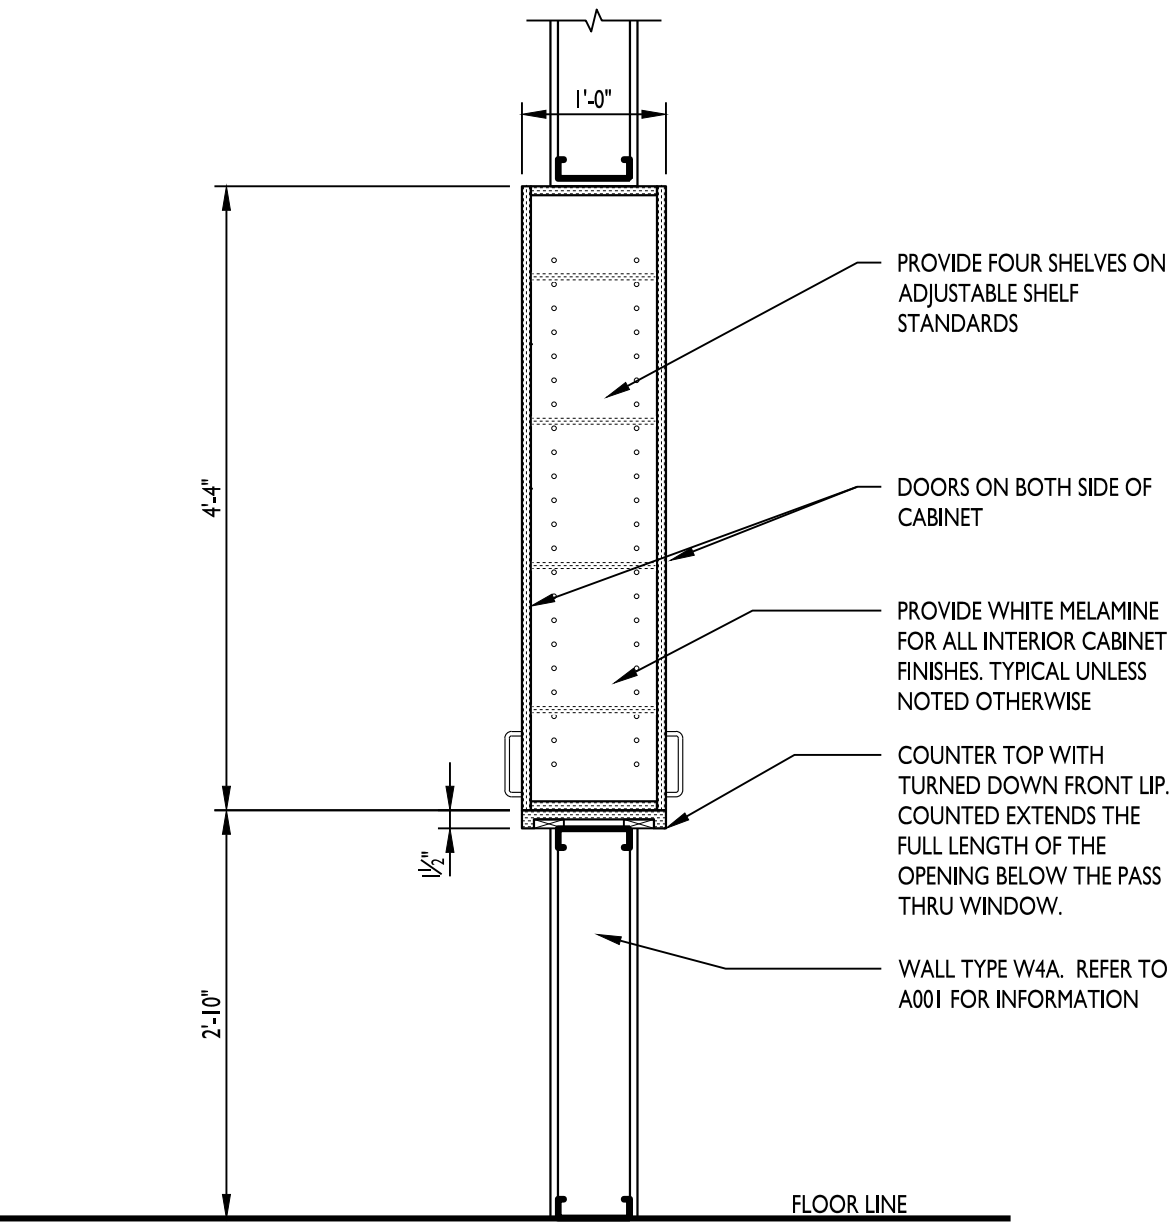

PASS-THRU CABINET SECTION

3/4" = 1'-0"

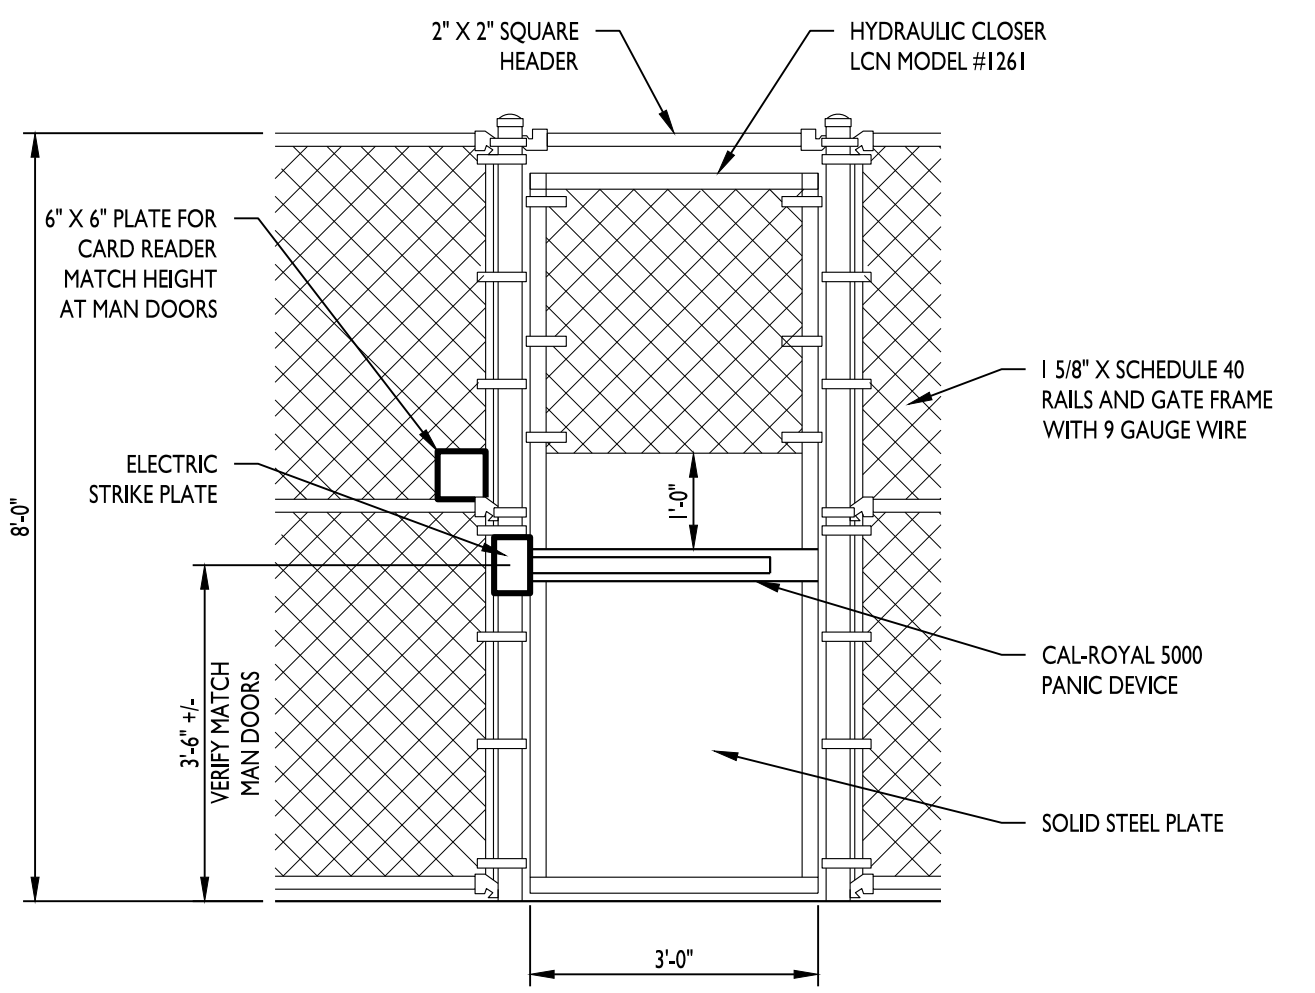


GATE DETAIL

1/2" = 1'-0"




**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753

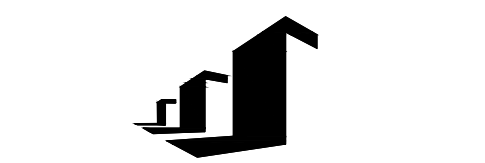

**SCANNELL**  
PROPERTIES

CERTIFICATION

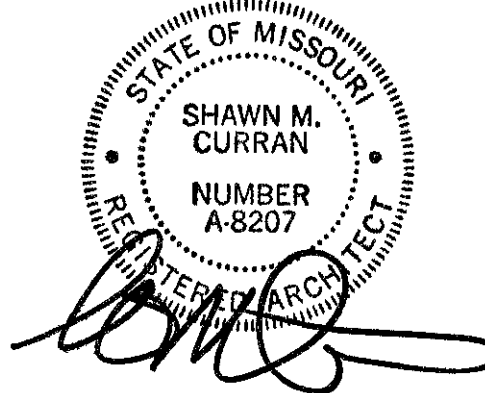

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE. © COPYRIGHT 2021, CURRAN ARCHITECTURE.

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES


PERMIT SET	02.18.22

210300

SECTIONS AND DETAILS


**A504**



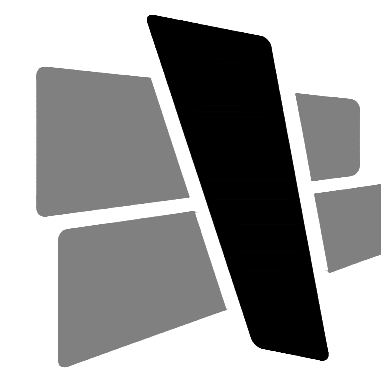


# CURRAN ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



## SCANNELL PROPERTIES

### CERTIFICATION

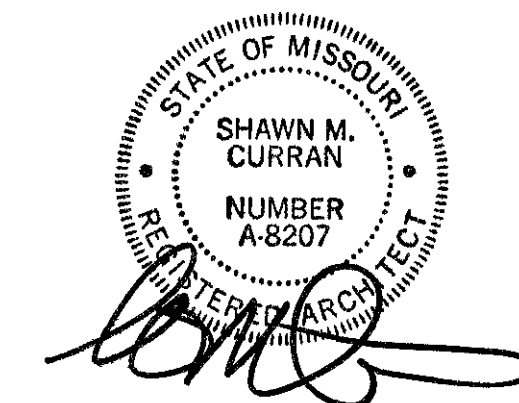

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

### PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


### ISSUE DATES

PERMIT SET 02.18.22



210300

SECTIONS AND DETAILS

# A505

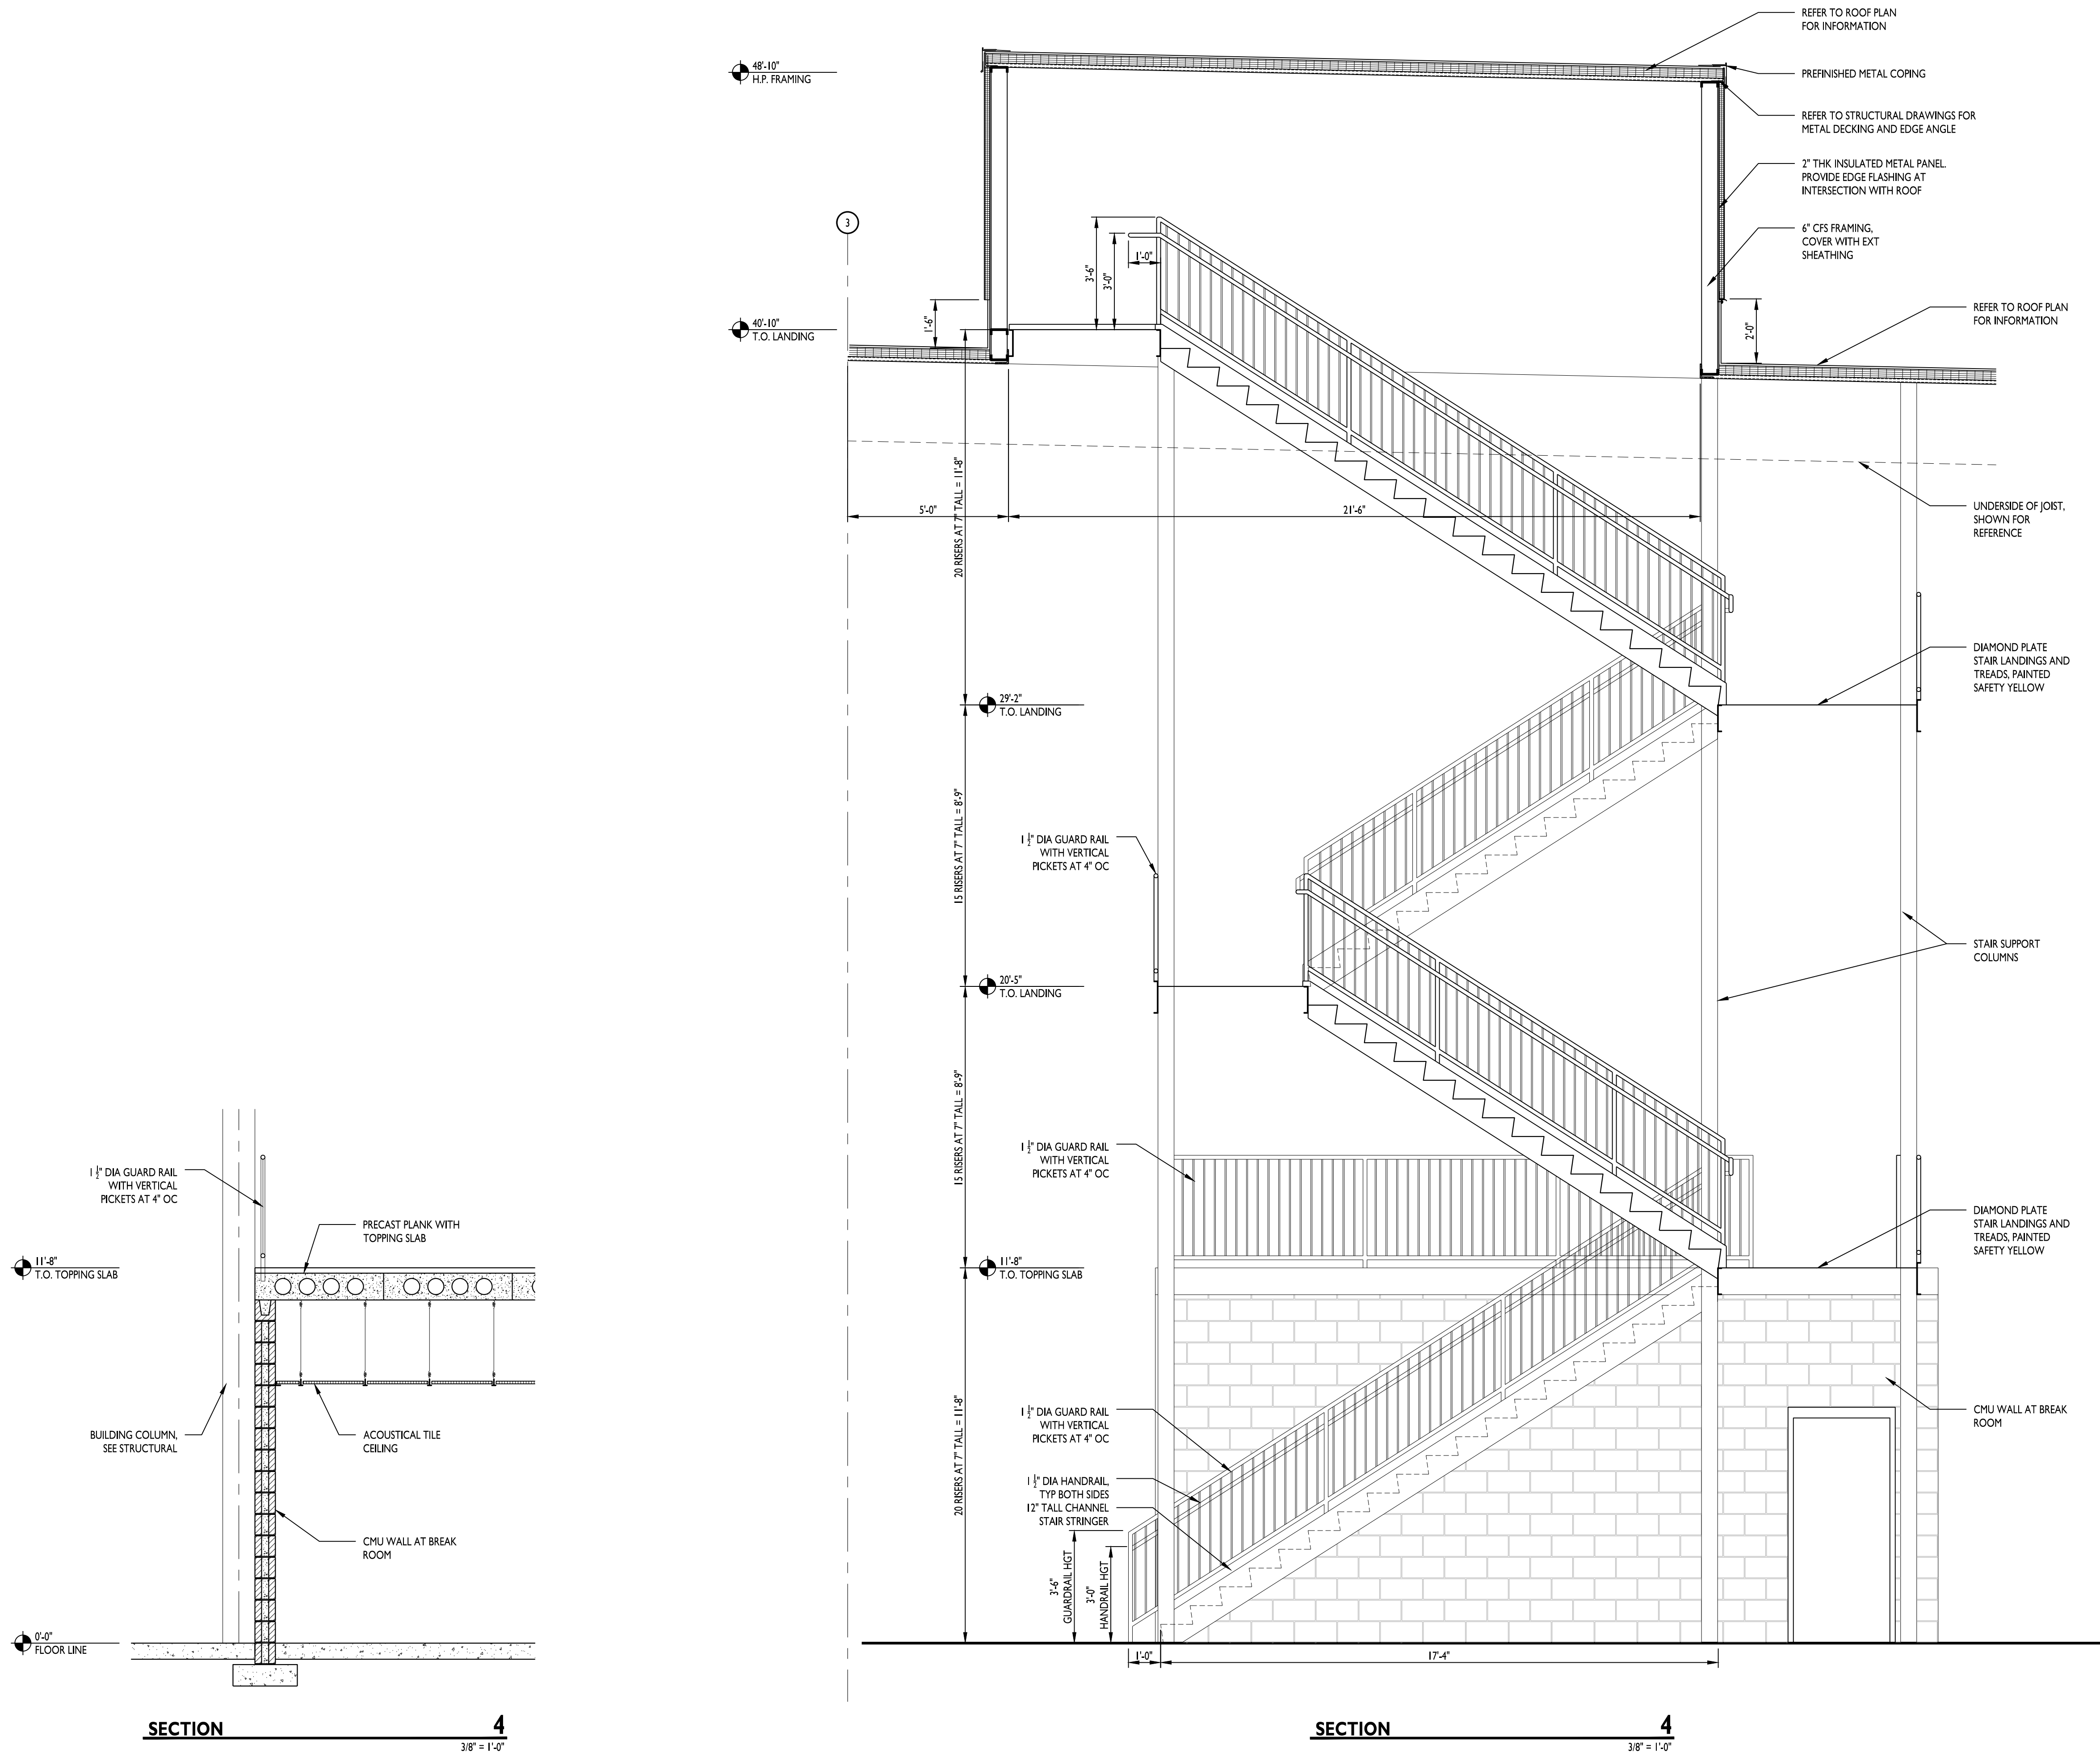



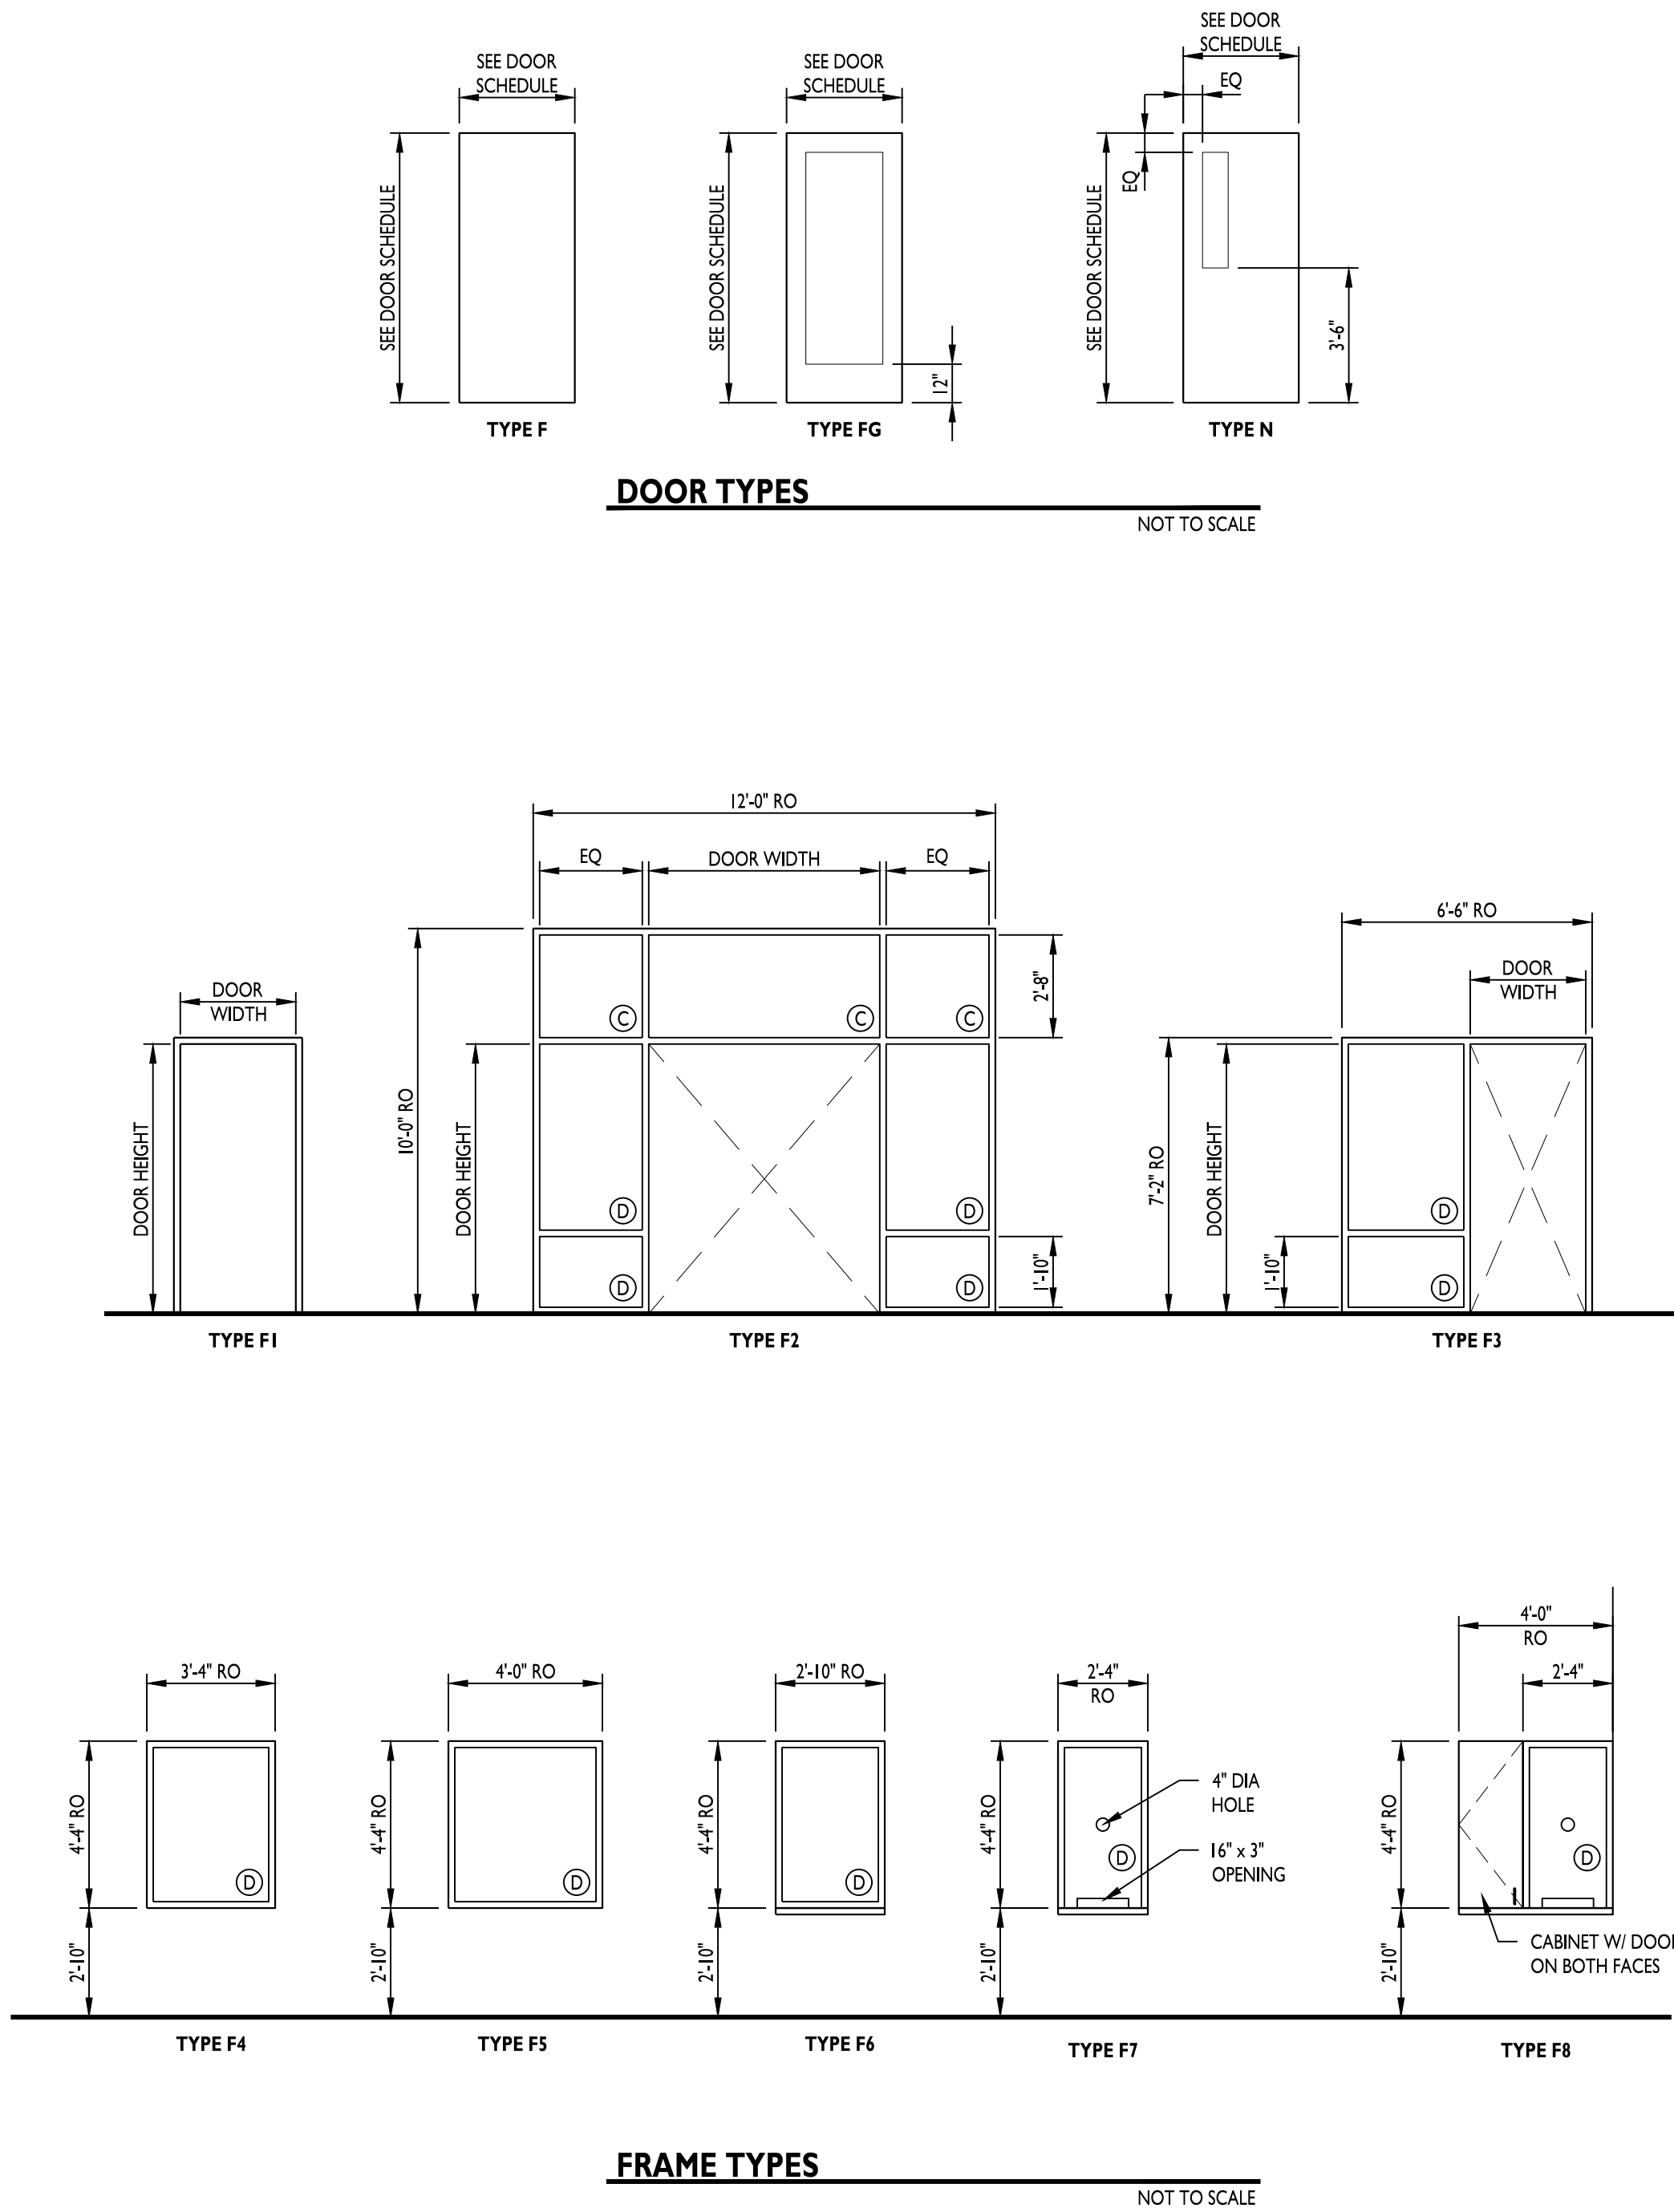

DOOR TYPES

NOT TO SCALE

FRAME TYPES

NOT TO SCALE

DOOR SCHEDULE

MARK	DOOR	SIZE	MATERIAL	GLAZING	FINISH	RATING	FRAME	MATERIAL	FINISH	RATING	HARDWARE	REMARKS
101	FG	(2) 3-0 x 7-0	SCWD	D	PRE-FIN	-	F2	KD	PAINT	-	7	
102A	F	3-0 x 7-0	SCWD	--	PRE-FIN	--	F1	KD	PAINT	-	4	
102B	-	-	-	-	-	-	F4	KD	PAINT	-	-	
103	F	3-0 x 7-0	SCWD	--	PRE-FIN	--	F3	KD	PAINT	-	4	
104	F	3-0 x 7-0	SCWD	--	PRE-FIN	--	F3	KD	PAINT	-	4	
105	F	3-0 x 7-0	SCWD	--	PRE-FIN	--	F3 (OH)	KD	PAINT	-	4	
107	F	3-0 x 7-0	SCWD	--	PRE-FIN	--	F3	KD	PAINT	-	5	
108	N	3-0 x 7-0	SCWD	D	PRE-FIN	--	F1	KD	PAINT	-	8	
110	F	3-0 x 7-0	SCWD	-	PRE-FIN	-	F1	KD	PAINT	-	6	
111	F	3-0 x 7-0	SCWD	-	PRE-FIN	-	F1	KD	PAINT	-	9	
111A	F	3-0 x 7-0	SCWD	-	PRE-FIN	-	F1	KD	PAINT	-	4	
112A	F	3-0 x 7-0	SCWD	-	PRE-FIN	-	F1	KD	PAINT	-	8	
112B	N	3-0 x 7-0	HM	D	PAINT	-	F1	KD	PAINT	-	9	
112C	-	-	-	-	-	-	F8	KD	PAINT	-	-	
112D	-	-	-	-	-	-	F7	KD	PAINT	-	-	
112E	-	-	-	-	-	-	F7	KD	PAINT	-	-	
112F	-	-	-	-	-	-	F7	KD	PAINT	-	-	
112G	-	-	-	-	-	-	F7	KD	PAINT	-	-	
112H	-	-	-	-	-	-	F7	KD	PAINT	-	-	
113	N	3-0 x 7-0	HM	D	PAINT	-	F1	KD	PAINT	-	9	
114	F	3-0 x 7-0	SCWD	-	PRE-FIN	-	F1	KD	PAINT	-	4	
115A	N	3-0 x 7-0	SCWD	D	PRE-FIN	--	F1	KD	PAINT	-	8	
115B	N	3-0 x 7-0	SCWD	D	PRE-FIN	--	F1	KD	PAINT	-	8	
116A	N	3-0 x 7-0	SCWD	D	PRE-FIN	-	F1 W/ 4" HEAD	HM	PAINT	-	9	
116B	N	3-0 x 7-0	HM	D	PAINT	-	F1 W/ 4" HEAD	HM	PAINT	-	10	
116C	N	3-0 x 7-0	HM	D	PAINT	-	F1 W/ 4" HEAD	HM	PAINT	-	10	
118	F	3-0 x 7-0	HM	-	PAINT	-	F1	KD	PAINT	-	8	
119	-	-	-	-	-	-	F1	KD	PAINT	-	--	
120	F	3-0 x 7-0	HM	--	PAINT	-	F1	KD	PAINT	-	8	
122	F	3-0 x 7-0	HM	--	PAINT	-	F1	KD	PAINT	-	10	
125	F	(2)3-0 x 7-0	HM	--	PAINT	-	F1	KD	PAINT	-	11	
126	F	3-0 x 7-0	HM	--	PAINT	-	F1	KD	PAINT	-	4	
127A	F	3-0 x 7-0	HM	--	PAINT	-	F1	KD	PAINT	-	12	
127B	-	-	-	-	-	-	F6	KD	PAINT	-	--	
128	F	3-0 x 7-0	HM	--	PAINT	-	F1	KD	PAINT	-	6	
129A	F	3-0 x 7-0	HM	--	PAINT	-	F1	KD	PAINT	-	12	
129B	-	-	-	-	-	-	F6	KD	PAINT	-	--	
130	F	3-0 x 7-0	HM	--	PAINT	-	F1	KD	PAINT	-	6	
200	F	3-0 x 7-0	INSUL STL	--	PAINT	--	F1	HM	PAINT	--	3	
201	F	3-0 x 7-0	INSUL STL	--	PAINT	--	F1	HM	PAINT	--	3	
300	F	3-0 x 7-0	INSUL STL	--	PAINT	--	F1	HM	PAINT	--	3	

GENERAL DOOR AND GLAZING NOTES

- A. ALL PRE-FINISHED WOOD DOORS SHALL BE SOLID CORE WITH WOOD VENEER, MARSHFIELD OR EQUIVALENT. PROVIDE FINISH SAMPLE AND DOOR CONSTRUCTION DIAGRAM FOR APPROVAL AND HARDWARE BLOCKING COORDINATION. VENEER TO BE WHITE BIRCH OR MAPLE, FREE OF DARK GRAINS UNLESS OTHERWISE NOTED.
- B. WOOD DOORS SHALL ONLY BE INSTALLED IN CONDITIONED SPACE.
- C. ALL HARDWARE TO BE MINIMUM 6 PIN BEST COMPATIBLE SYSTEM. COORDINATE KEYING WITH OWNER.
- D. TEMPERED AND ANNEALED GLASS TO BE CLEANED PER MANUFACTURER REQUIREMENTS. NYLON CLOTH METHODS PREFERRED. DO NOT USE RAZOR BLADES ON GLASS.
- E. GLASS AROUND DOORS AND IN DOORS SHALL BE TEMPERED UNLESS OTHERWISE NOTED IN ELEVATIONS.
- F. ANY RATED DOORS TO HAVE LABEL INSTALLED IN JAMB.
- G. ALL EXITS DOORS TO HAVE TACTILE EXIT SIGNAGE PER 703.4 OF THE ANSI 117.1 2009.
- H. INSTALL OWNER PROVIDED ADA COMPLIANT RESTROOM SIGNAGE. VERIFY WITH ARCHITECT.

GLAZING TYPES

- A. SECTION OF GLAZING REQUIRED TO BE 1" INSULATED GREY TINTED GLASS.
- B. SECTION OF GLAZING REQUIRED TO BE 1" INSULATED TEMPERED GLASS.
- C. SECTION OF GLAZING REQUIRED TO BE 1/4" GLASS.
- D. SECTION OF GLAZING REQUIRED TO BE 1/4" TEMPERED GLASS.
- E. SECTION OF GLAZING REQUIRED TO BE 1" INSULATED TEMPERED GREY TINTED SPANDREL GLASS.

EXTERIOR GLAZING MUST MEET THE FOLLOWING SPECIFICATIONS FOR ENERGY CODE COMPLIANCE:

LOW "E" COATING  
"U" VALUE - MINIMUM OF 0.28  
"SHGC" VALUE - MAXIMUM OF 0.47

DOOR HARDWARE

HARDWARE SET 1

- 2 CONTINUOUS HINGES  
2 PANIC DEVICES  
1 PERIMETER SEAL  
1 THRESHOLD  
2 SWEEPS  
2 HD CLOSERS  
2 PULLS  
FINISH: MATCH STOREFRONT

HARDWARE SET 2

- 3 BALL BEARING HINGES  
1 PANIC DEVICE W/ LEVER  
1 PERIMETER SEAL  
1 THRESHOLD W/ DRAINAGE SUBSILL  
1 SWEEP  
1 HD CLOSER  
1 DRIP TRIM  
FINISH: US26D

HARDWARE SET 3

- 3 BALL BEARING HINGES  
1 STOREROOM LOCKSET  
1 PERIMETER SEAL  
1 THRESHOLD W/ DRAINAGE SUBSILL  
1 SWEEP  
1 HD CLOSER  
1 DRIP TRIM  
FINISH: US26D

HARDWARE SET 4

- 3 HINGES  
1 OFFICE LOCKSET  
3 MUTES  
1 DOOR STOP  
FINISH: US26D

HARDWARE SET 5

- 3 HINGES  
1 PASSAGE SET  
3 MUTES  
1 DOOR STOP  
FINISH: US26D

HARDWARE SET 6

- 3 HINGES  
1 PRIVACY LOCKSET  
3 MUTES  
1 CLOSER  
1 DOOR STOP  
FINISH: US26D

HARDWARE SET 7

- 6 HINGES  
2 PUSH PULLS  
2 MUTES  
2 MAG LOCK (BY TENANT)  
2 DOOR STOPS  
FINISH: US26D

HARDWARE SET 8

- 3 HINGES  
1 PASSAGE SET  
3 MUTES  
1 CLOSER  
1 DOOR STOP  
FINISH: US26D

HARDWARE SET 9

- 3 HINGES  
1 STOREROOM LOCKSET  
3 MUTES  
1 CLOSER  
1 ELECTRIC STRIKE (BY TENANT)  
1 DOOR STOP  
FINISH: US26D

HARDWARE SET 10


- 3 HINGES  
1 PUSH PULL  
3 MUTES  
1 CLOSER  
1 DOOR STOP  
FINISH: US26D

HARDWARE SET 11

- 6 HINGES  
1 OFFICE LOCKSET  
2 MUTES  
1 PAIR FLUSH BOLTS  
1 DOOR STOP  
FINISH: US26D

HARDWARE SET 12

- 3 HINGES  
1 EXIT DEVICE  
3 MUTES  
1 CLOSER  
1 ELECTRIC STRIKE (BY TENANT)  
1 DOOR STOP  
FINISH: US26D

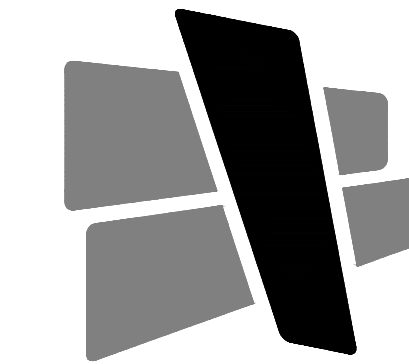


CURRAN  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



SCANNELL  
PROPERTIES

CERTIFICATION

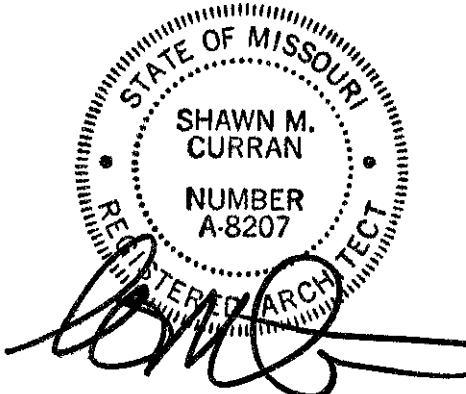

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE. AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES

PERMIT SET 02.18.22  
REVISIONS 06.14.22

210300

INTERIOR  
DOOR SCHEDULE

A602



MARK	MATERIAL	MANUFACTURER	COLOR	PATTERN / TEXTURE	NUMBER	REMARKS
S-1	SEALED CONCRETE	ASHFORD	CLEAR	CURE-N-SEAL	--	
CPT-1	CARPET TILE	MOHAWK	TBD	UNCHARTED SOLVE II	BT416	
CPT-2	CARPET TILE	MOHAWK	TBD	STEP IN STYLE II	QL312	
T-1	WALL TILE	DALTILE	TBD	COLOR WHEEL CLASSIC LINE 3X6 RUNNING BOND	TBD	PROVIDE SILLUTER STRIP AT TOP EDGE, AND SCHLUTER SANITARY COVE AT FLOOR/WALL INTERSECTION
T-2	FLOOR TILW	DALTILE	TBD	IRONCRAFT 12X24	TBD	
B-1	BASE	JOHNSONITE TARKETT	TBD	4" COVE	TBD	
P-1	PAINT	SHERWIN WILLIAMS	TBD	EGGSHELL	TBD	
P-2	PAINT	SHERWIN WILLIAMS	TBD	EGGSHELL	TBD	
P-3	PAINT	SHERWIN WILLIAMS	TBD	EGGSHELL	TBD	
P-4	PAINT	SHERWIN WILLIAMS	MATCH BASE COLOR	SEMI GLOSS	TBD	INTERIOR DOOR FRAMES AND HOLLOW METAL DOORS
FRP-1	FIBERGLASS REINFORCED PLASTIC	TBD	TBD	SMOOTH FINISH	TBD	
PL-1	PLASTIC LAMINATE	TBD	TBD	MATTE FINISH	TBD	
PL-2	PLASTIC LAMINATE	TBD	TBD	MATTE FINISH	TBD	
SS-1	SOLID SURFACE	TBD	TBD	TBD	TBD	GRADE C PRICE
ACT-1	ACOUSTICAL CEILING TILE	ARMSTRONG	WHITE	CORTEGA 2nd LOOK	2767	

ROOM #	ROOM NAME	FLOORING	BASE	NORTH WALL	EAST WALL	SOUTH WALL	WEST WALL	CABINETS / COUNTERTOPS	CEILING MAT / HEIGHT	REMARKS
101	LOBBY	CPT-2	B-1	P-1	P-1	P-1	P-1	--	ACT-1/9-8	
102	OFFICE	CPT-1	B-1	P-2	P-1	P-1	P-1	--	ACT-1/9-8	
103	OFFICE	CPT-1	B-1	P-2	P-1	P-1	P-1	--	ACT-1/9-8	
104	OFFICE	CPT-1	B-1	P-2	P-1	P-1	P-1	--	ACT-1/9-8	
105	VISITOR OFFICE	CPT-1	B-1	P-2	P-1	P-1	P-1	--	ACT-1/9-8	
106	OPEN OFFICE	CPT-1	B-1	P-1	P-1	P-1	P-1	--	ACT-1/9-8	
107	CONF ROOM	CPT-1	B-1	P-3	P-3	P-3	P-3	--	ACT-1/9-8	
108	HALL	CPT-1	B-1	P-1	P-1	P-1	P-1	--	ACT-1/9-8	
109	COPY / PRINT	CPT-1	B-1	P-1	P-1	P-1	P-1	PL-1/PL-2	ACT-1/9-8	
110	TLT	T-2	--	T-1/P-3	T-1/P-3	T-1/P-3	T-1/P-3	--	ACT-1/9-8	T-1 TO 5'-0" AFF AND P-3 TO CEILING
111	SERVER	SC-1	B-1	P-1	P-1	P-1	P-1	--	ACT-1/9-8	
112	SHARED OFFICE	CPT-1	B-1	P-1	P-2	P-1	P-1	--	ACT-1/9-8	
113	HALL	CPT-2	B-1	P-1	P-2	P-1	P-1	--	ACT-1/9-8	
114	STOR	CPT-1	B-1	P-1	P-1	P-1	P-1	--	ACT-1/9-8	
115	TRAINING ROOM	CPT-1	B-1	P-1	P-2	P-1	P-1	--	ACT-1/9-8	
116	BREAK ROOM	SC-1	--	P-1	P-1	P-1	P-1	PL-1/SS-1	ACT-1/9-8	
117	LOCKER ROOM	SC-1	B-1	P-2	P-1	P-1	P-1	--	ACT-1/9-8	
118	MEN	SC-1	B-1*	P-2	T-1/P-1	T-1/P-1	T-1/P-1	--	ACT-1/9-8	B-1 ON NON TILED WALLS ONLY, T-1 TO 5'-0" AFF AND P-1 TO CEILING
119	HALL	SC-1	B-1	P-1	P-1	P-1	P-1	--	ACT-1/9-8	
120	WASHER / DRYER	SC-1	B-1	FRP-1/P-1	FRP-1/P-1	FRP-1/P-1	FRP-1/P-1	--	ACT-1/9-8	FRP-1 TO 4'-0" AFF AND P-1 TO CEILING
121	LOCKER ROOM	SC-1	B-1	P-1	P-1	P-2	P-1	--	ACT-1/9-8	
122	WOMEN	SC-1	B-1*	T-1/P-1	T-1/P-1	P-2	T-1/P-1	--	ACT-1/9-8	B-1 ON NON TILED WALLS ONLY, T-1 TO 5'-0" AFF AND P-1 TO CEILING
125	MAINT SHOP	SC-1	B-1	P-1	P-1	P-1	P-1	--	ACT-1/9-8	
126	MAINT OFFICE	SC-1	B-1	P-1	P-1	P-1	P-1	--	ACT-1/9-8	
127	DRIVER LOUNGE	SC-1	B-1	P-1	P-1	P-1	P-1	PL-1	ACT-1/9-8	
128	TLT	SC-1	B-1	FRP-1/P-1	FRP-1/P-1	FRP-1/P-1	FRP-1/P-1	--	ACT-1/9-8	FRP-1 TO 4'-0" AFF AND P-1 TO CEILING
129	DRIVER LOUNGE	SC-1	B-1	FRP-1/P-1	FRP-1/P-1	FRP-1/P-1	FRP-1/P-1	--	ACT-1/9-8	
130	TLT	SC-1	B-1	FRP-1/P-1	FRP-1/P-1	FRP-1/P-1	FRP-1/P-1	--	ACT-1/9-8	FRP-1 TO 4'-0" AFF AND P-1 TO CEILING

- A. PROCEEDING WITH THE INSTALLATION OF FINISHES WILL BE CONSIDERED THAT THE INSTALLER AND/OR FINISHER HAS INSPECTED AND ACCEPTED THE SUBSTRATE FOR RECEIVING THE FINISH. NO CHANGE ORDER WILL BE ISSUED TO RECTIFY CONCEALED, UNKNOWN CONDITIONS OR UNSATISFACTORY SUBSTRATE ONCE THE FINISH WORK HAS PROCEEDED.
- B. USE MANUFACTURER'S RECOMMENDED INSTALLATION METHODS AND MATERIALS FOR ALL FINISHES.
- C. CONTRACTOR TO NOTIFY ARCHITECT IMMEDIATELY IF A SPECIFIED FINISH ITEM BECOMES UNAVAILABLE.
- D. CONTRACTOR TO SUBMIT SHOP DRAWINGS, FLOORING TRANSITION/GRAIP LOCATION AND SUBMITTALS OF ALL INTERIOR ITEMS AND FINISH MATERIALS TO ARCHITECT REVIEW PRIOR TO PLACING ANY MATERIAL ORDERS. CONTRACTOR MUST ACCOUNT FOR SUBMITTAL REVIEW, ORDERING AND DELIVERY WHEN SCHEDULING PROJECT INSTALLATION.
- E. USE SHORLOU REDUCER STRIPS (UNDER FLOORING) TO LEVEL MATERIALS OF UNEQUAL HEIGHTS.
- F. PROVIDE JOHNSONITE SLIM-LINE TRANSITION STRIPS WHERE FLOORING MATERIALS OF UNEQUAL THICKNESS MEET. TRANSITION STRIPS AT DOORS TO BE LOCATED UNDER THE CENTERLINE OF THE DOOR IN CLOSED POSITION. COLOR OF TRANSITION STRIPS TO BE SELECTED BY ARCHITECT.
- G. ALL WALL TILE TO BE INSTALLED TO FLOOR WITH NO BASE UNLESS NOTED OTHERWISE.
- H. ANY GRILLES, FIRE EXTINGUISHER CABINETS, ETC., TO BE PAINTED TO MATCH WALL COLOR ON WHICH THEY OCCUR.
- I. PROVIDE OWNER WITH A MINIMUM OF ONE FULL BOX OR 2% OF EACH FINISH PRODUCT/MATERIAL SPECIFIED ON THE PROJECT.
- J. ALL WOODWORK/MILLWORK SHALL CONFORM TO THE QUALITY STANDARDS OF ARCHITECTURAL WOODWORK INSTITUTE (AWI) PREMIUM GRADE. FABRICATOR SHALL BE FAMILIAR WITH AWI STANDARDS.
- K. FABRICATE WOODWORK/MILLWORK ITEMS TO ACTUAL FIELD DIMENSIONS. CONTRACTOR SHALL SUBMIT SHOP DRAWINGS, SAMPLES, AND/OR MATERIAL LITERATURE FOR ALL ITEMS. SHOP DRAWINGS SHALL SHOW SUFFICIENT DETAIL TO DETERMINE COMPLIANCE WITH THE QUALITY STANDARDS AND DESIGN INTENT.
- L. PROVIDE ALL NECESSARY FURRINGS AND GROUNDS FOR WOODWORK AND FINISH ITEMS. COORDINATE LOCATION OF BLOCKING WITH FINISH WALLS FOR ITEMS TO BE SECURED TO SURFACE. ALL FASTENERS SHALL BE CONCEALED.
- M. FINISH ALL SIDES AND BACK OF MILLWORK/CASEWORK.
- N. ALL COUNTERTOPS TO BE 1" THICK WITH A SQUARE EDGE, UNLESS OTHERWISE NOTED. PROVIDE COUNTER SUPPORTS AS REQUIRED.
- O. PROVIDE GROMMETS IN COUNTERTOPS ABOVE RECEPTACLES. COLOR TO MATCH COUNTER SURFACE. COORDINATE WITH OWNER AND ARCHITECT ON FINAL LOCATION AND SIZE OF GROMMETS BEFORE INSTALLATION.
- P. REFER TO FINISH SCHEDULE, INTERIOR ELEVATIONS AND SPECIFICATIONS FOR ALL MATERIAL INFORMATION AND LOCATIONS.



\_\_\_\_\_



STATE OF MISSOURI  
SHAWN M. CURRAN  
NUMBER  
A-8207  
REGISTERED ARCHITECT

## PROJECT INFORMATION


NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

## PERMIT SET 02.18.22

[illegible]


## FINISH SCHEDULE



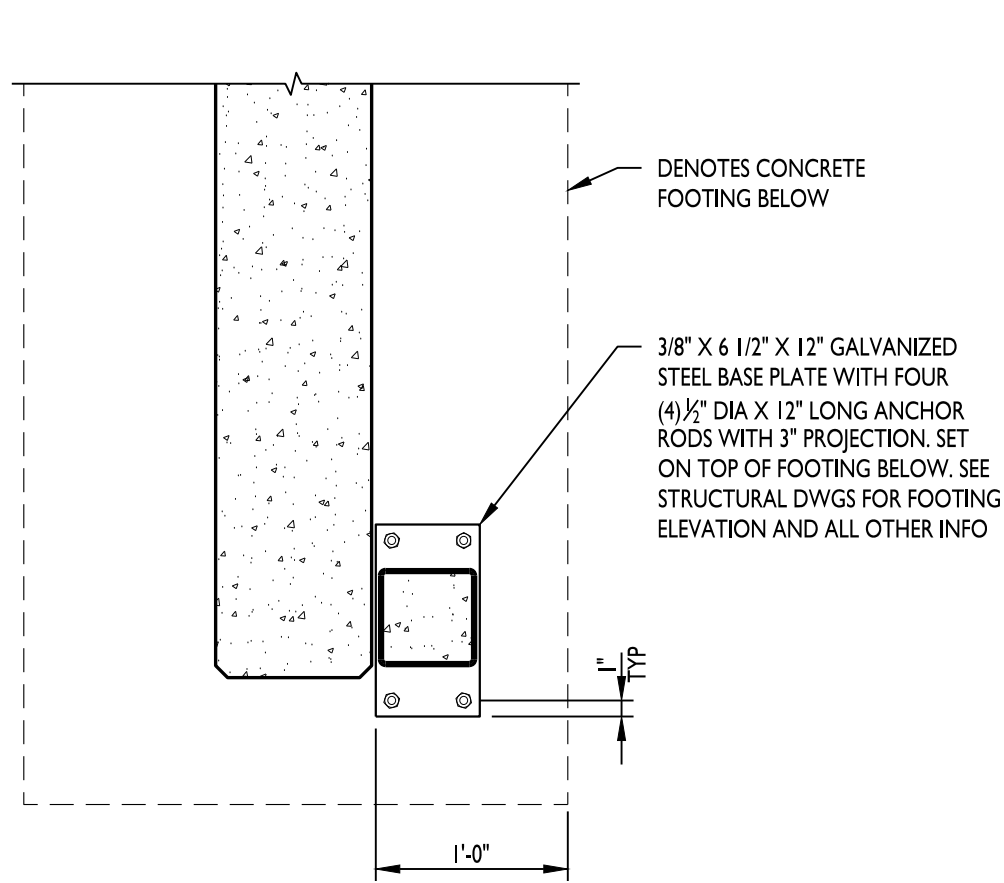


SEE DETAIL 7 ON THIS SHEET FOR ALL OTHER GATE REQUIREMENTS NOT SHOWN HERE

**DETAIL AT FOOTING** 6  
1" = 1'-0"

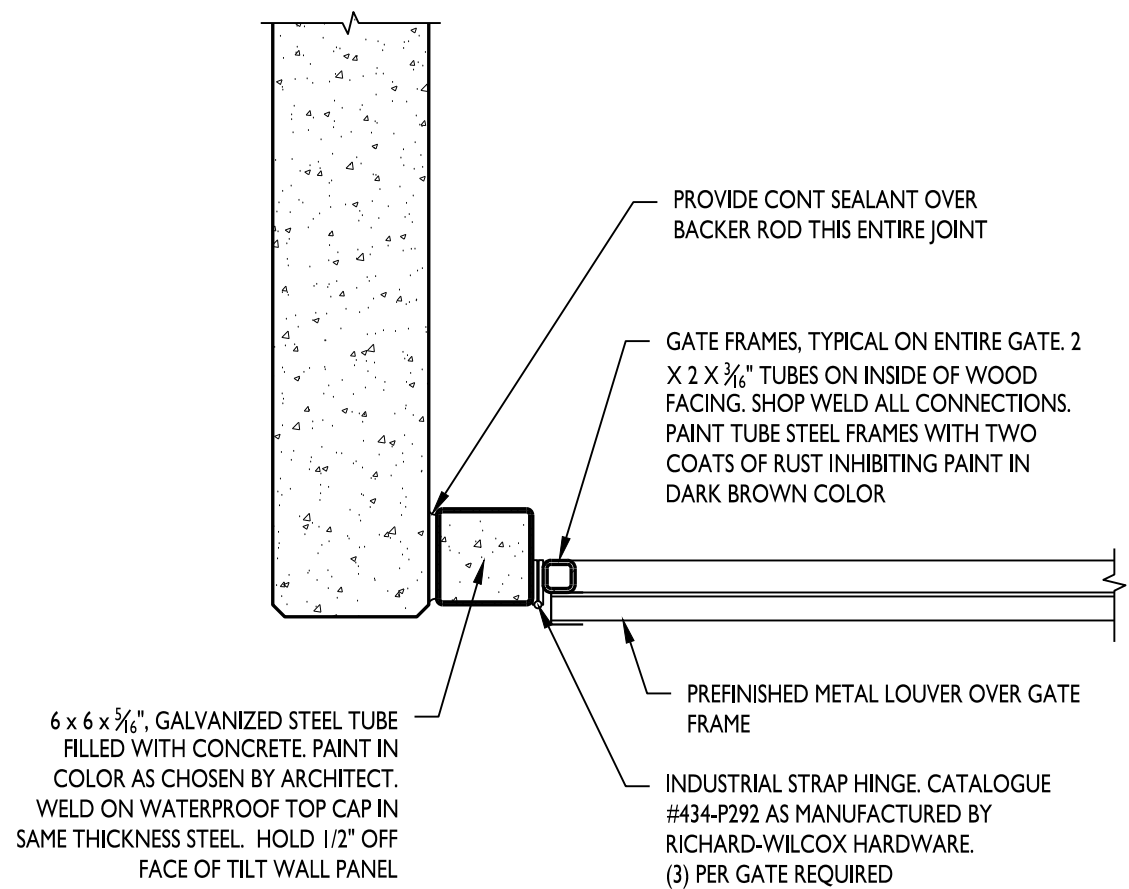


ALL STEEL PARTS OF GATE AND ALL GATE HARDWARE TO BE GALVANIZED. PRIME AND PAINT IN COLOR CHOSEN BY ARCHITECT

**DETAIL AT JAMB** 7  
1" = 1'-0"

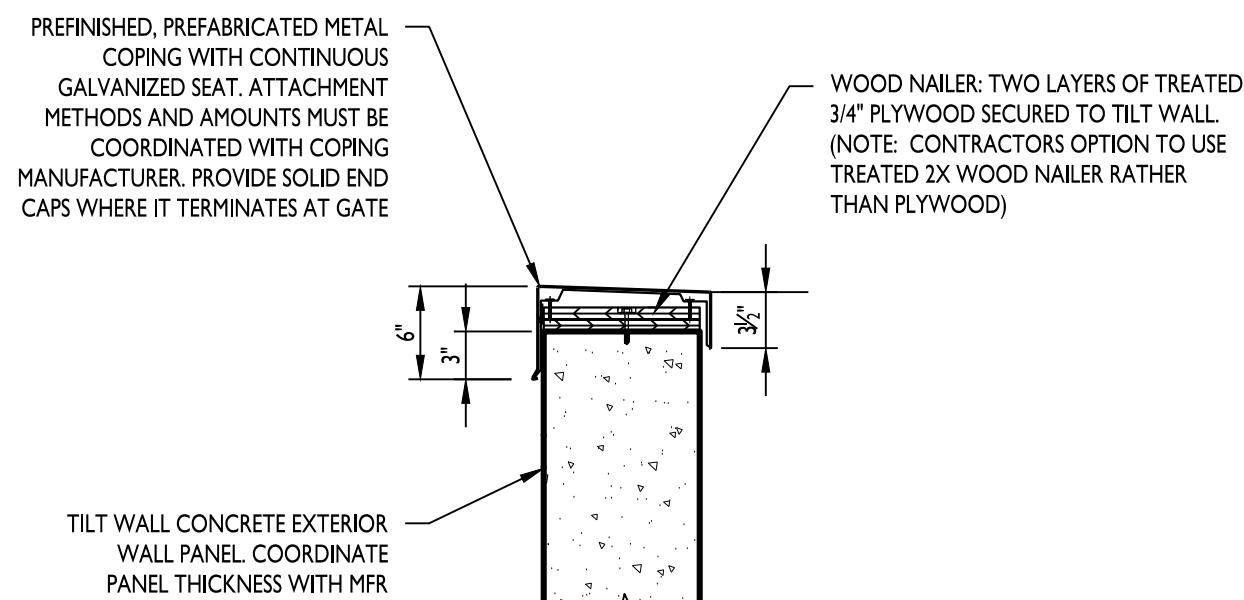


**COPING DETAIL** 8  
1" = 1'-0"


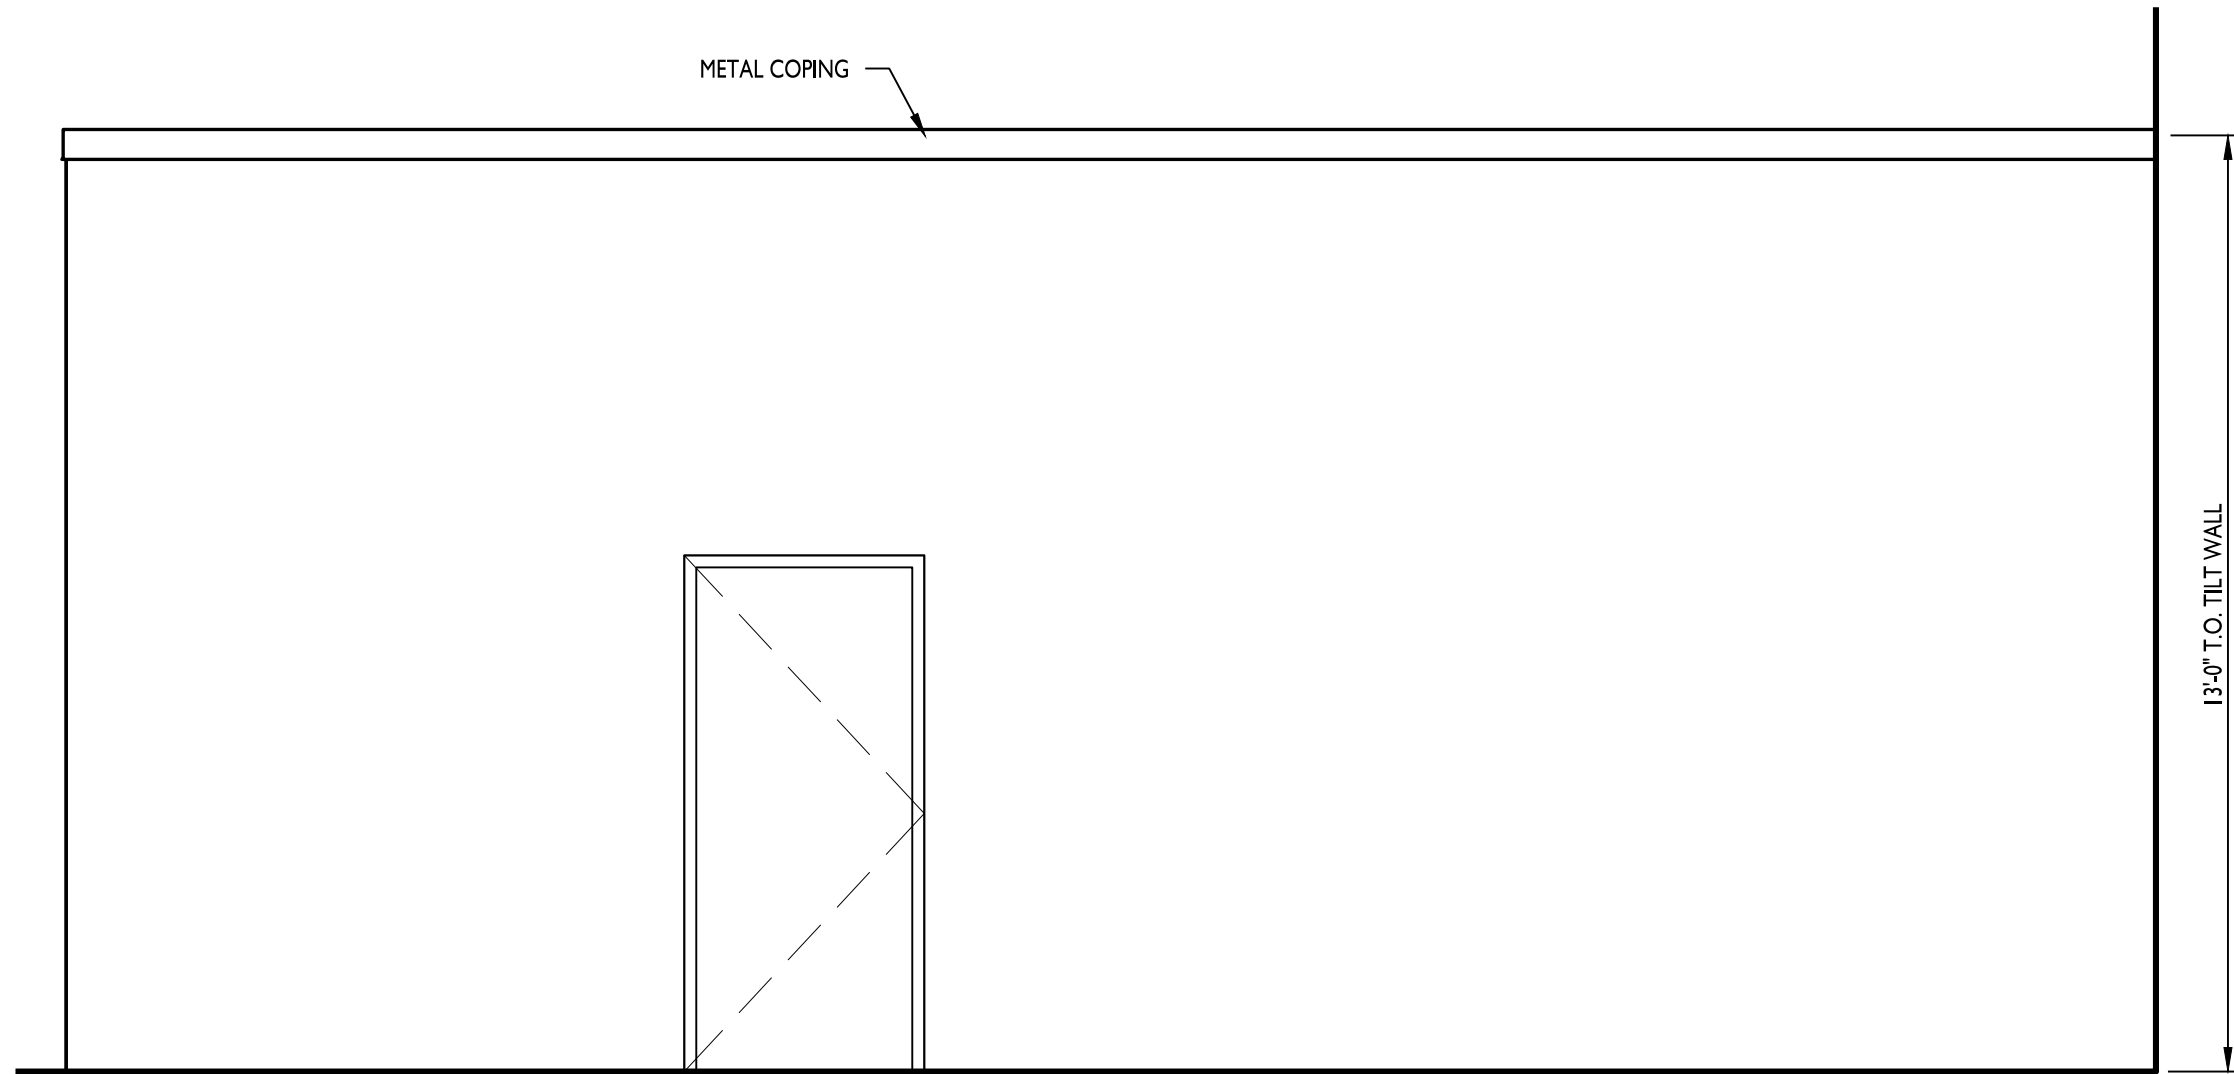


**ELEVATION - SIDE** 3  
3/8" = 1'-0"

**NOT USED** 4  
3/8" = 1'-0"

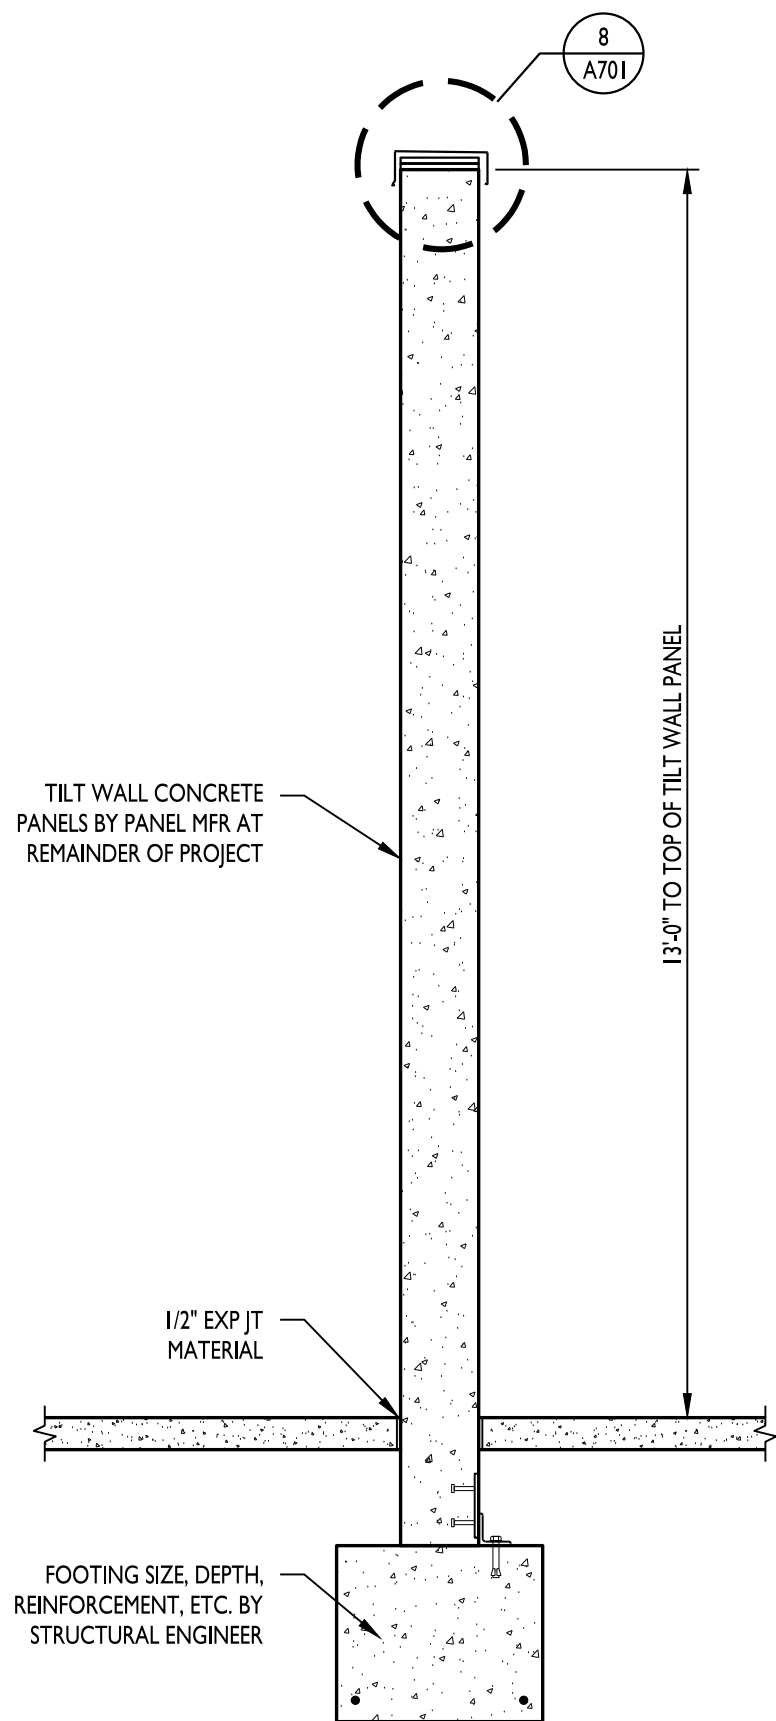

**SECTION** 5  
1/2" = 1'-0"

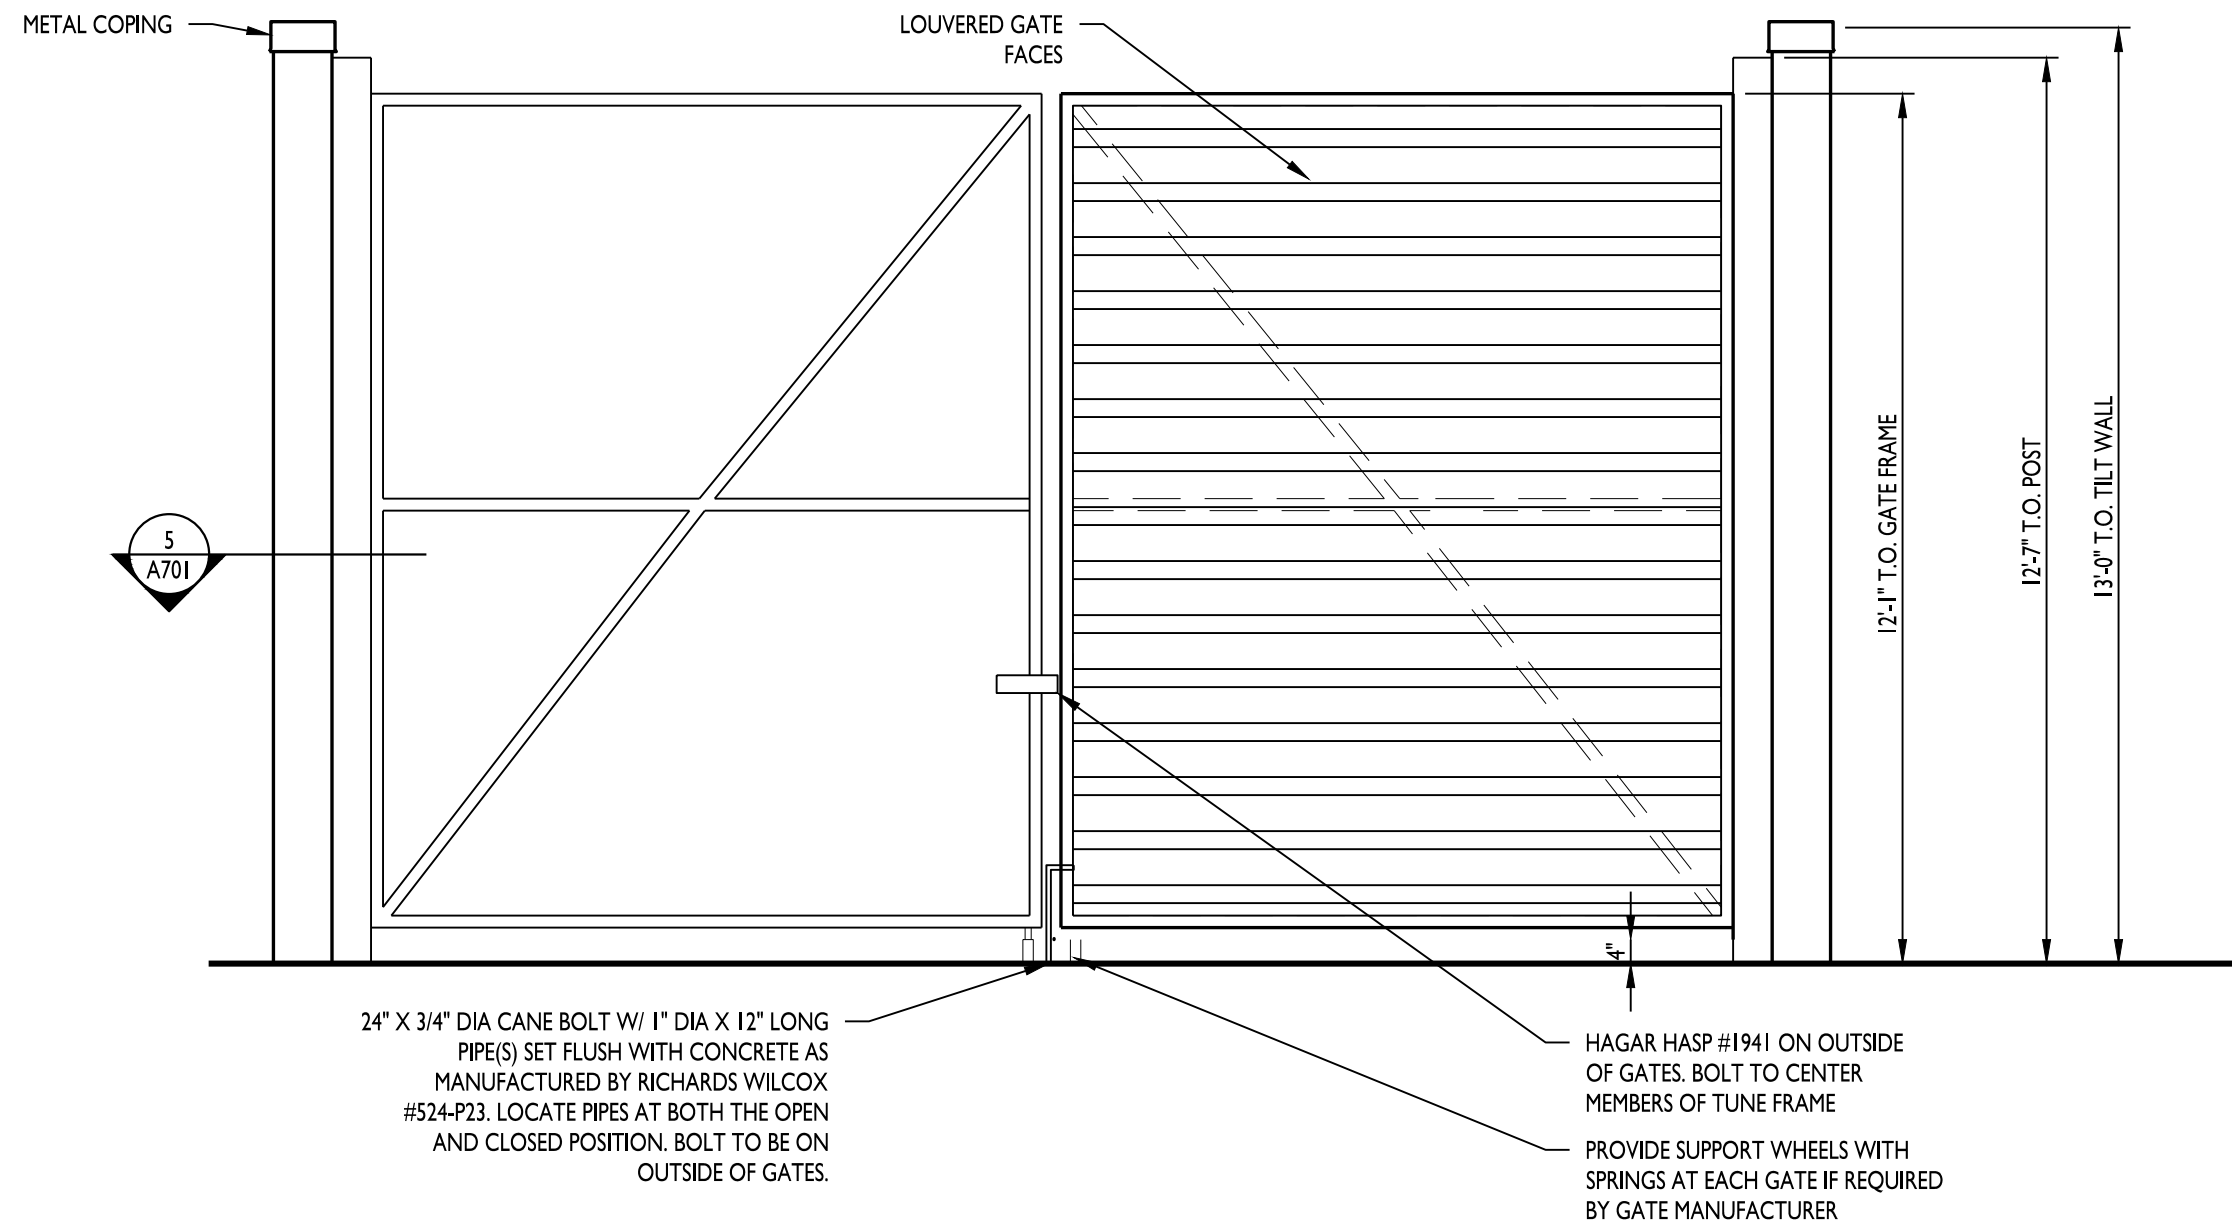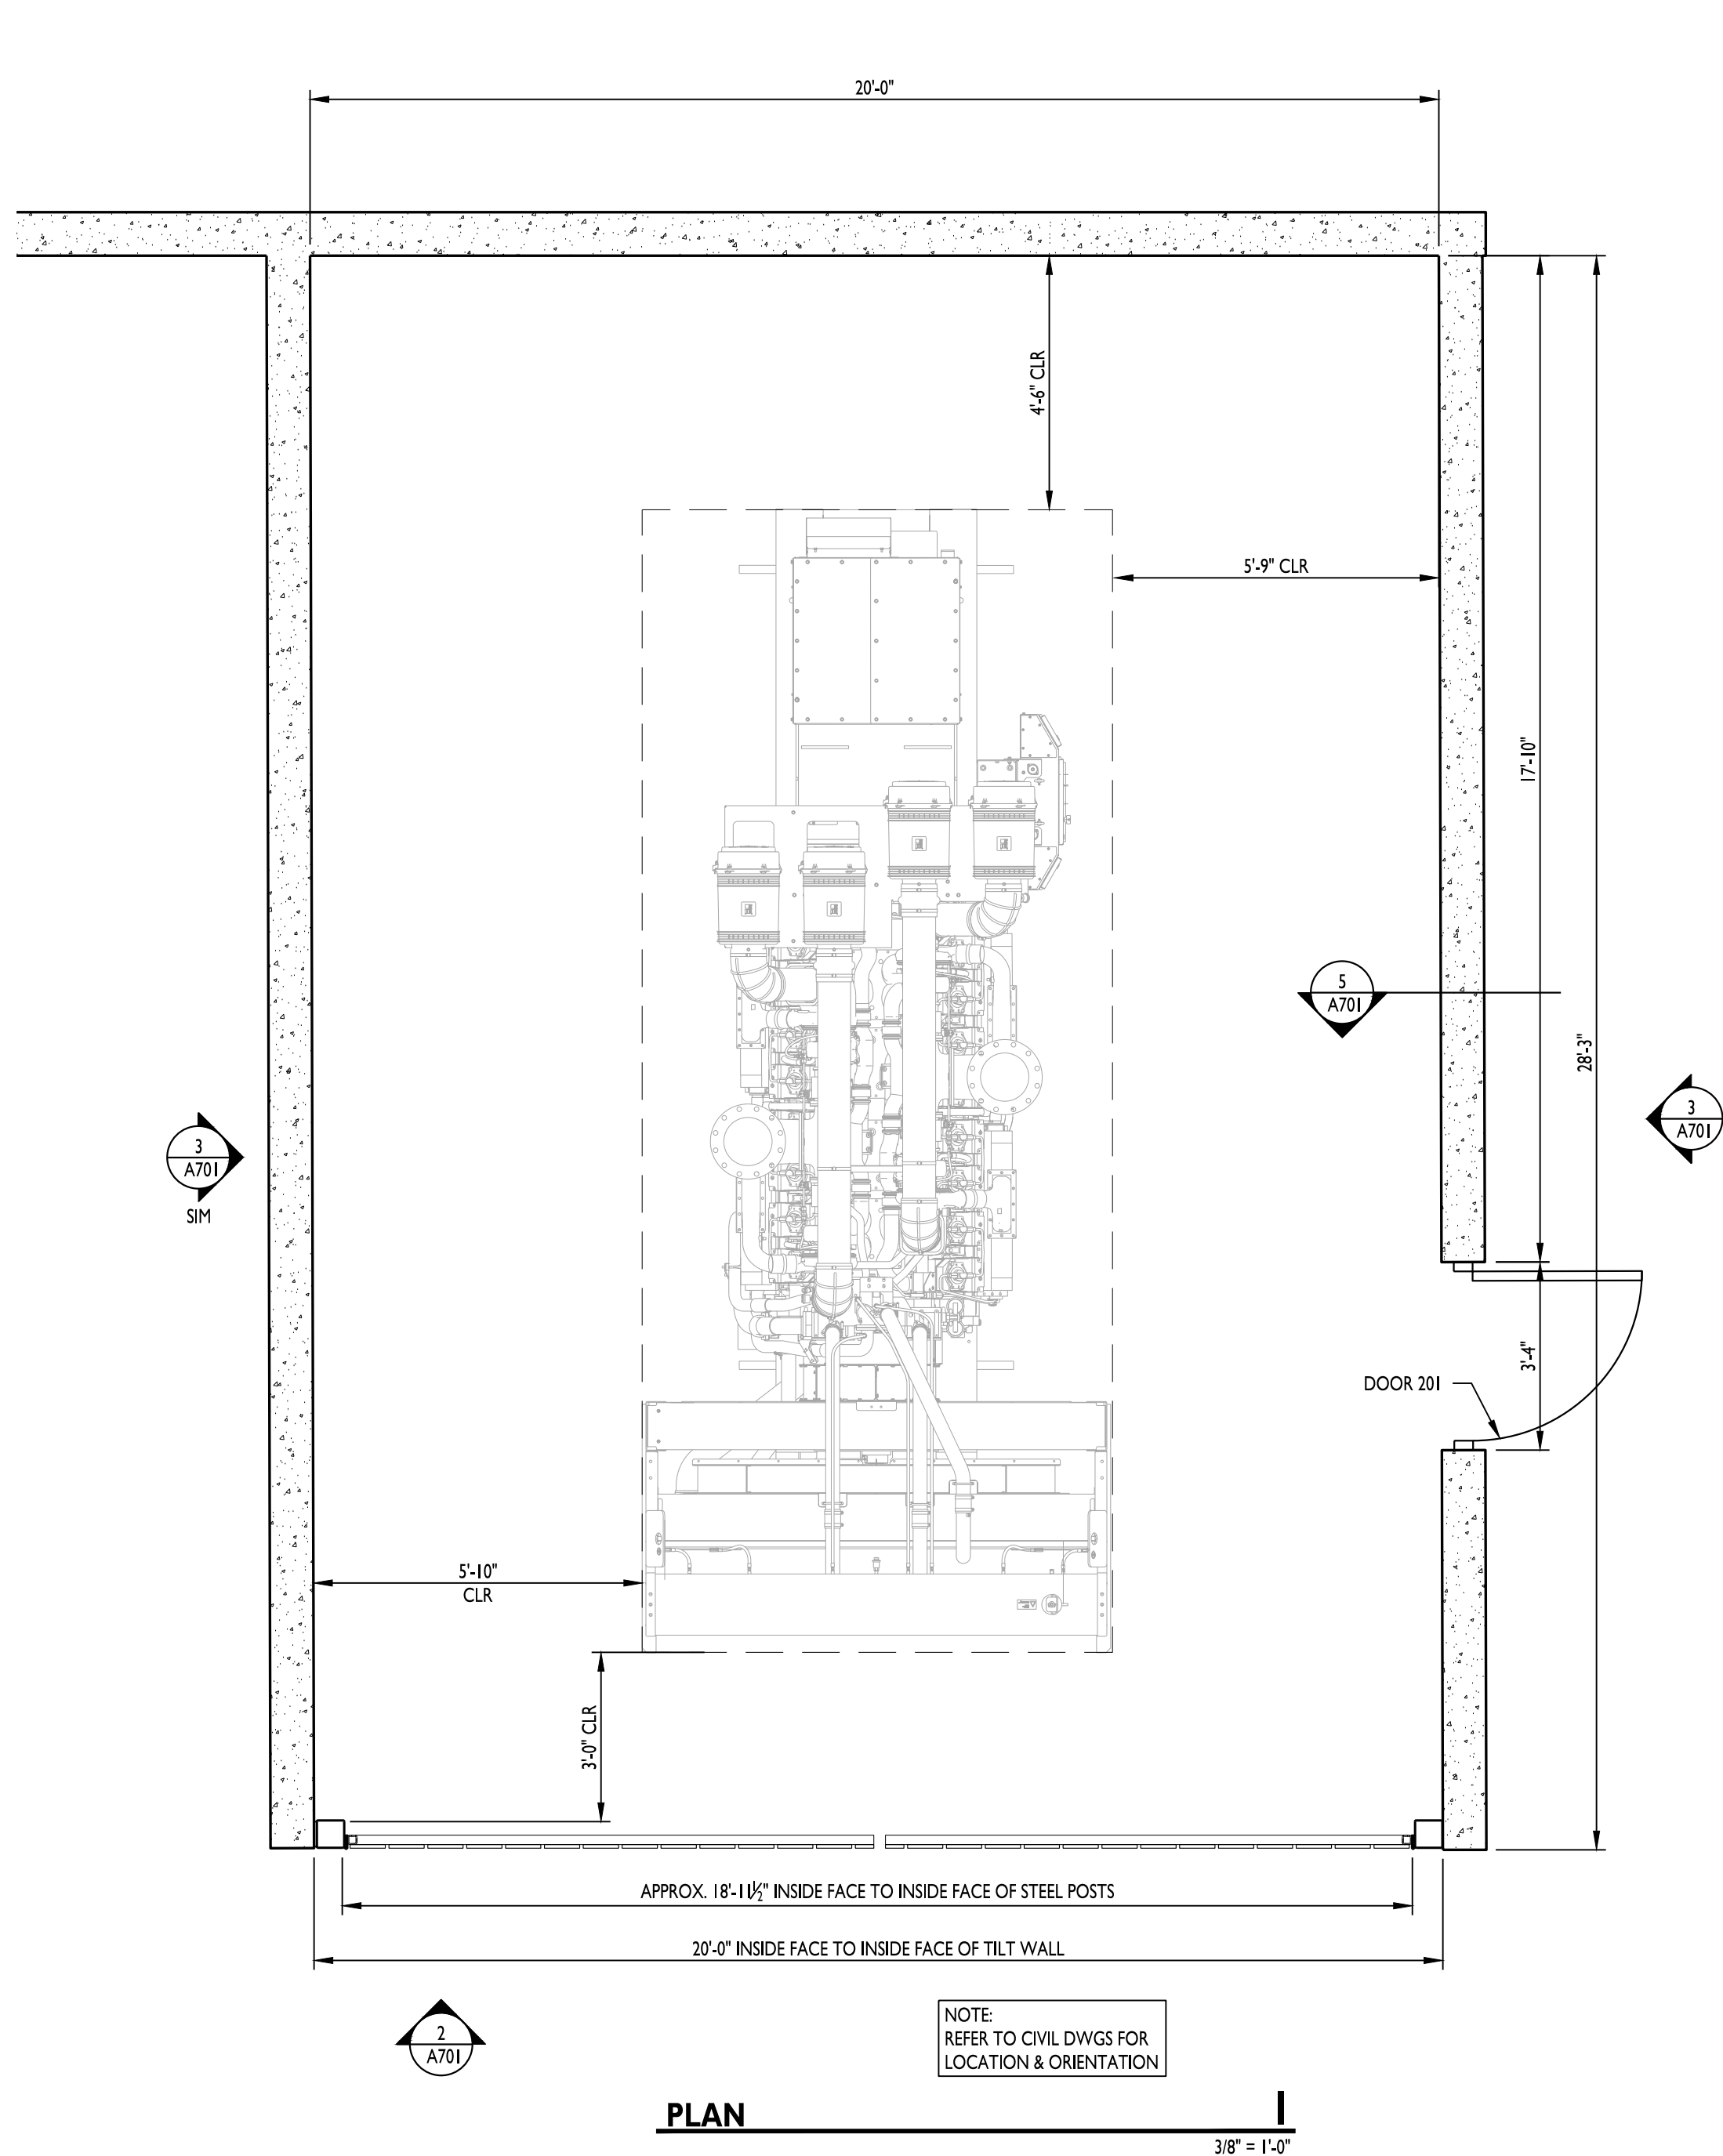

**ELEVATION - FRONT** 2  
3/8" = 1'-0"




**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

**CERTIFICATION**

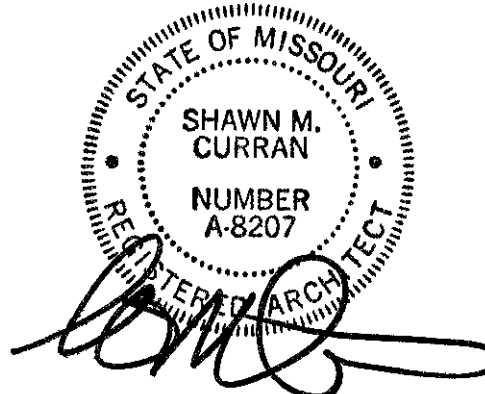

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE. AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

**PROJECT INFORMATION**

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

**ISSUE DATES**


PERMIT SET 02.18.22  
REVISIONS (ENTIRE SHEET) 06.14.22

210300


EXTERIOR ENCLOSURE

**A701**




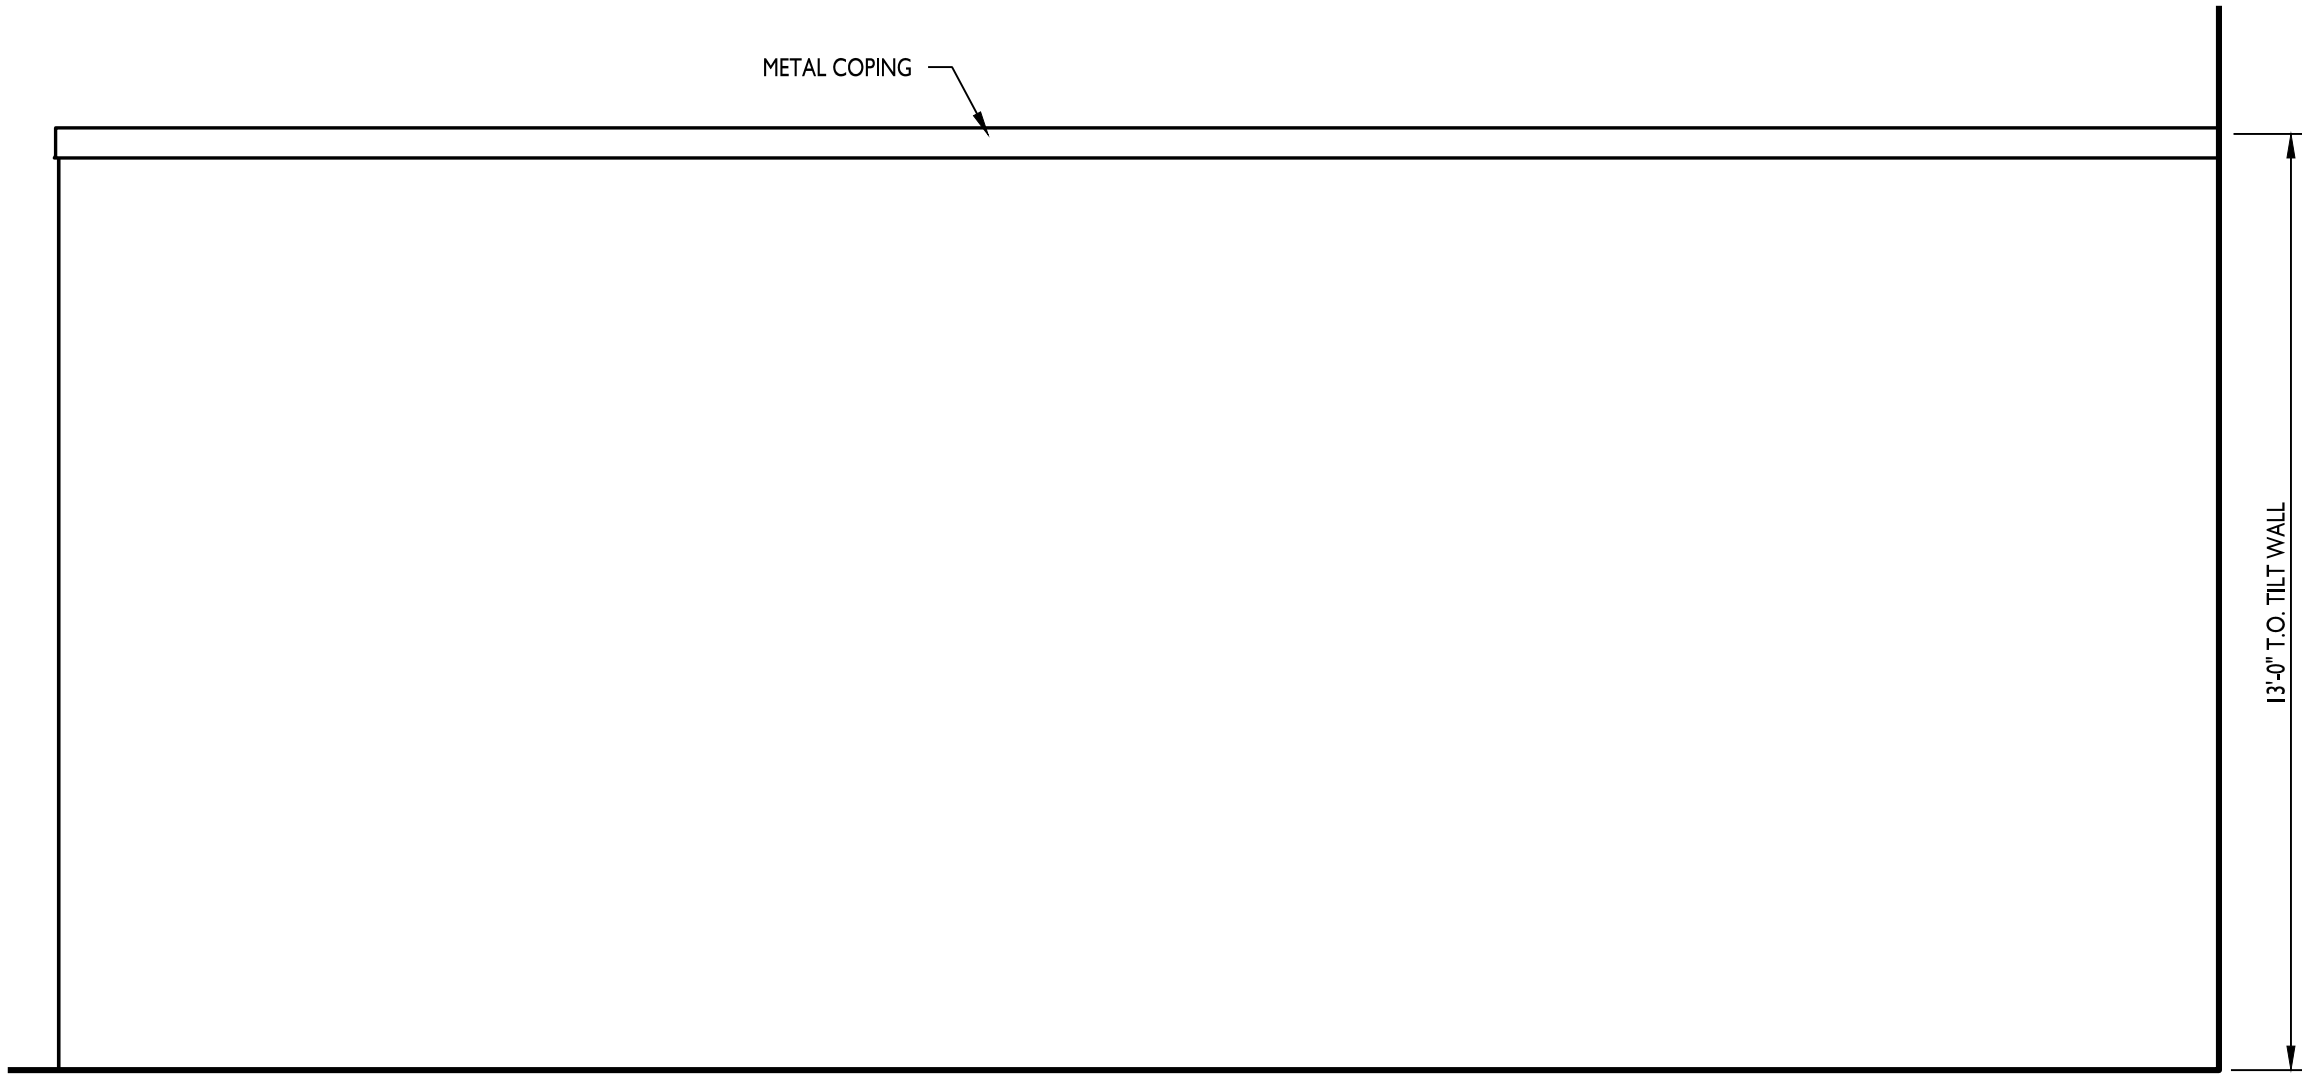


ELEVATION - SIDE 3  
3/8" = 1'-0"

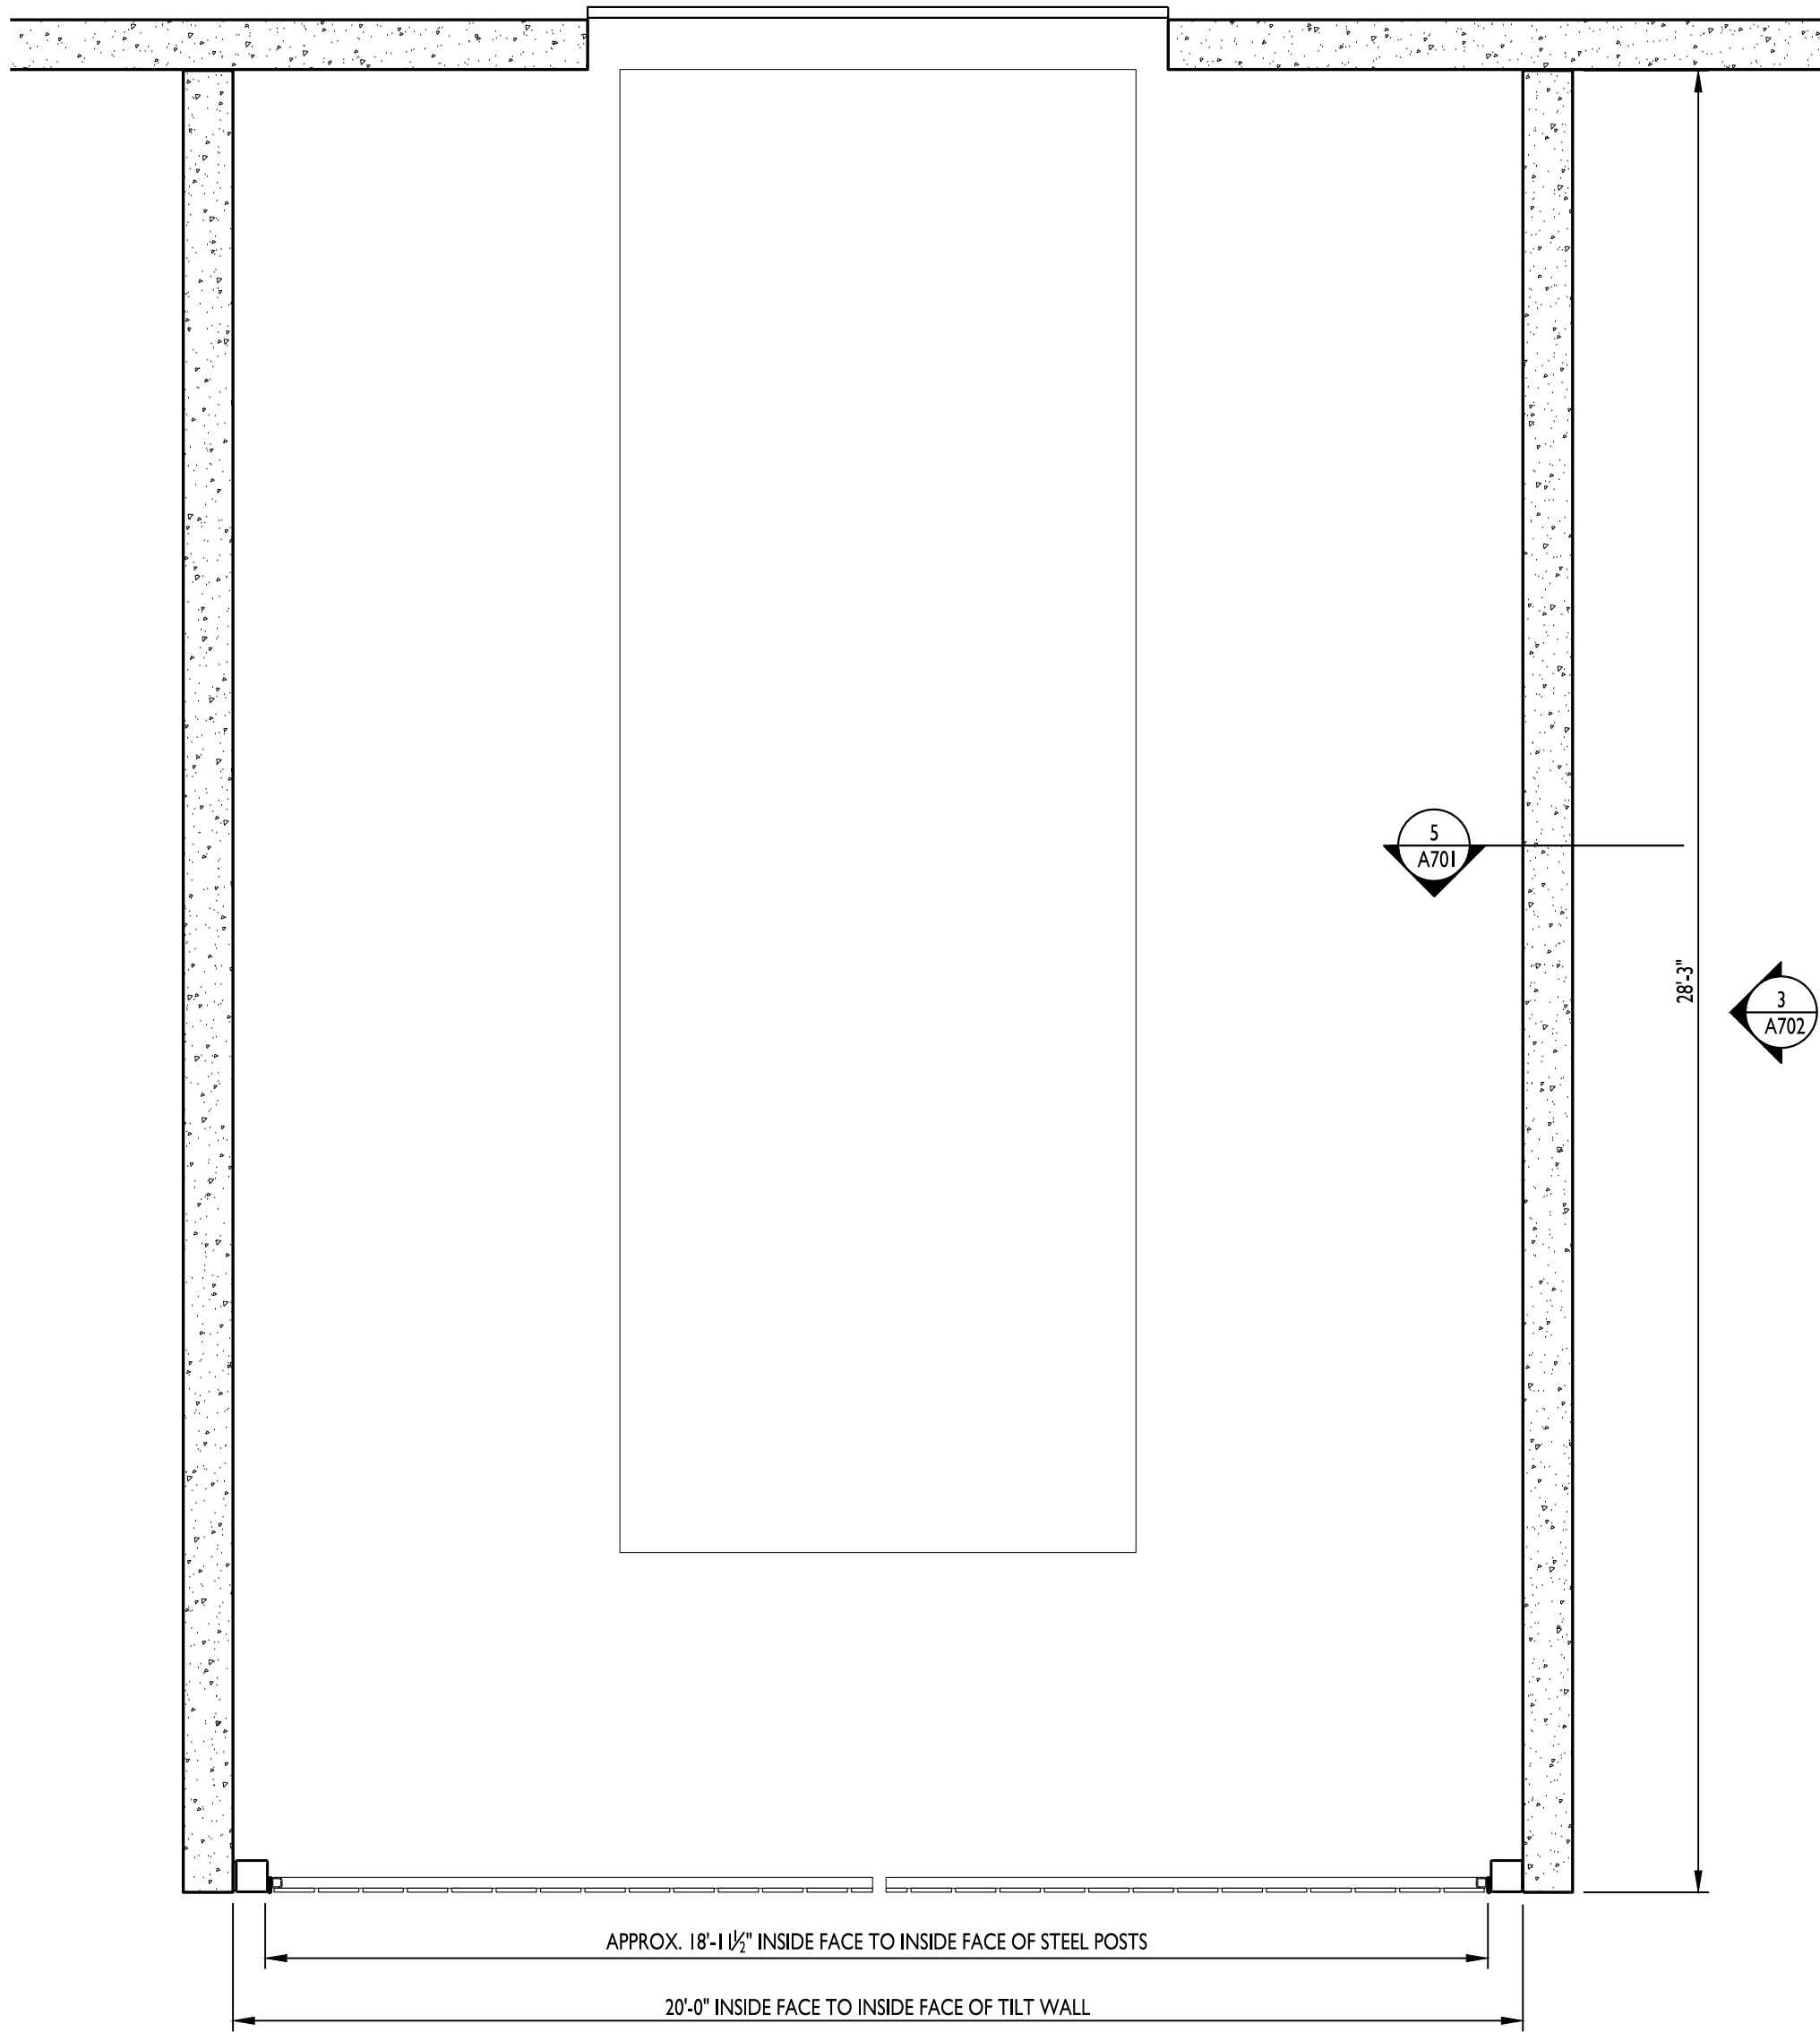

PLAN 1  
3/8" = 1'-0"

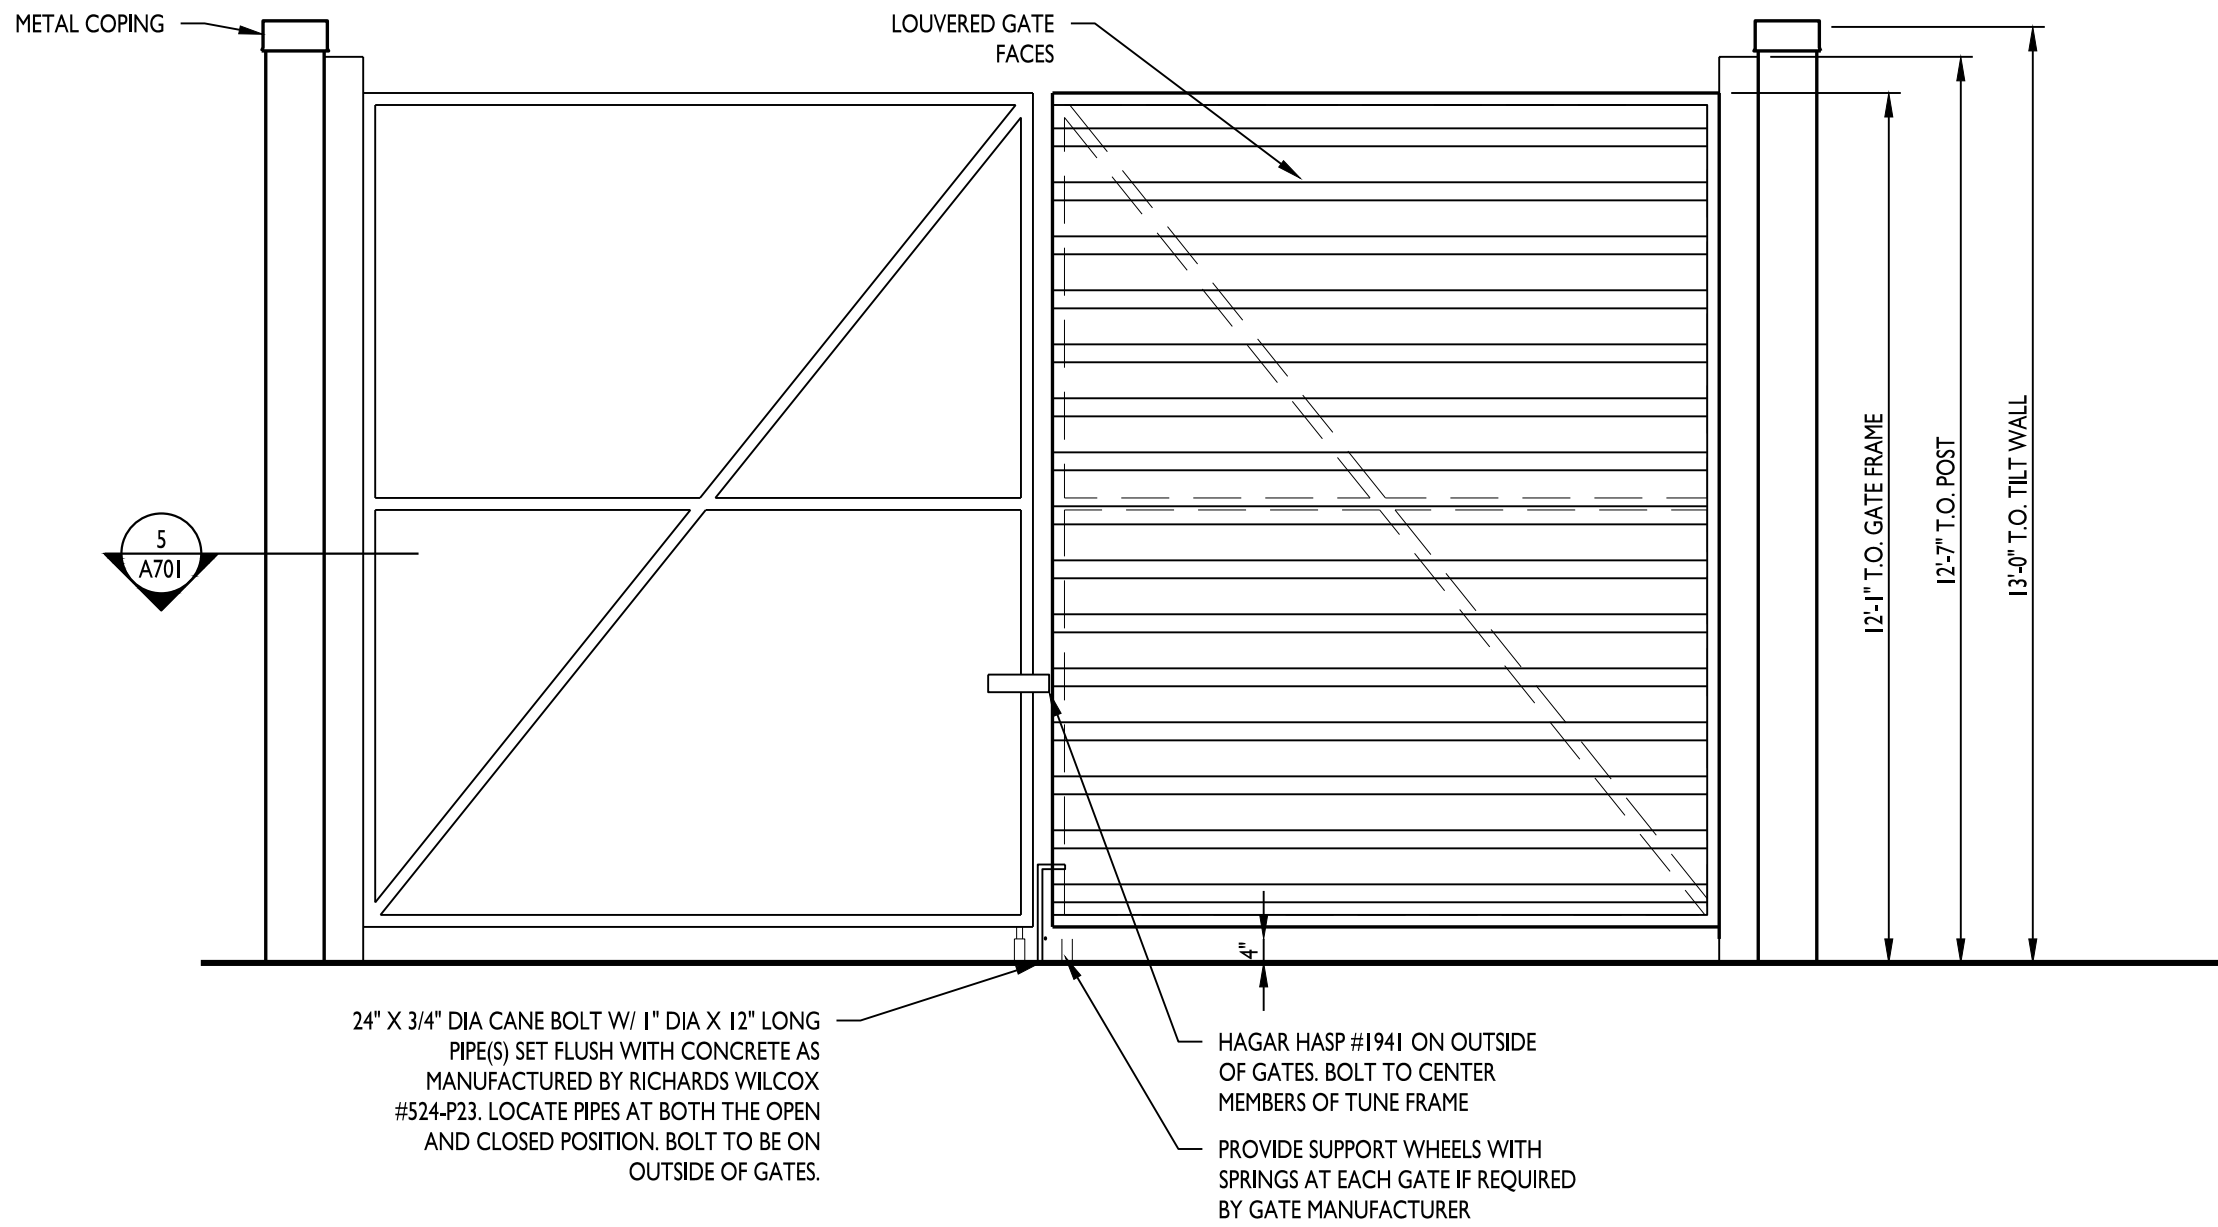

ELEVATION - FRONT 2  
3/8" = 1'-0"

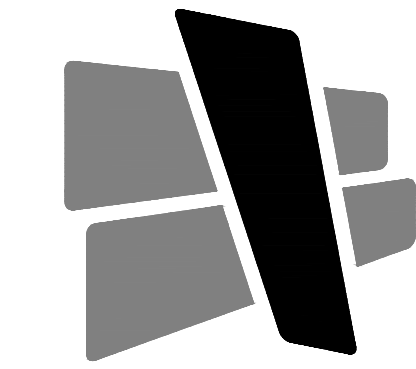


CURRAN  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



SCANNELL  
PROPERTIES

CERTIFICATION

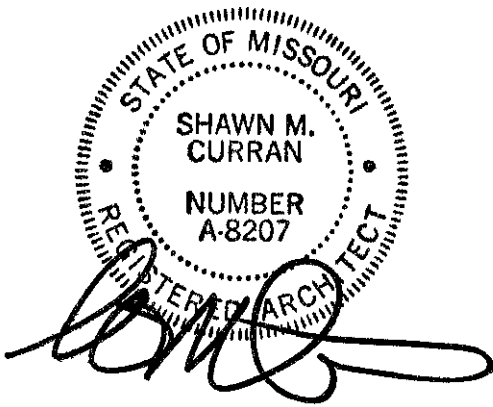

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES


PERMIT SET	02.18.22
REVISIONS (ENTIRE SHEET)	06.14.22

210300

COMPACTOR ENCLOSURE

A702



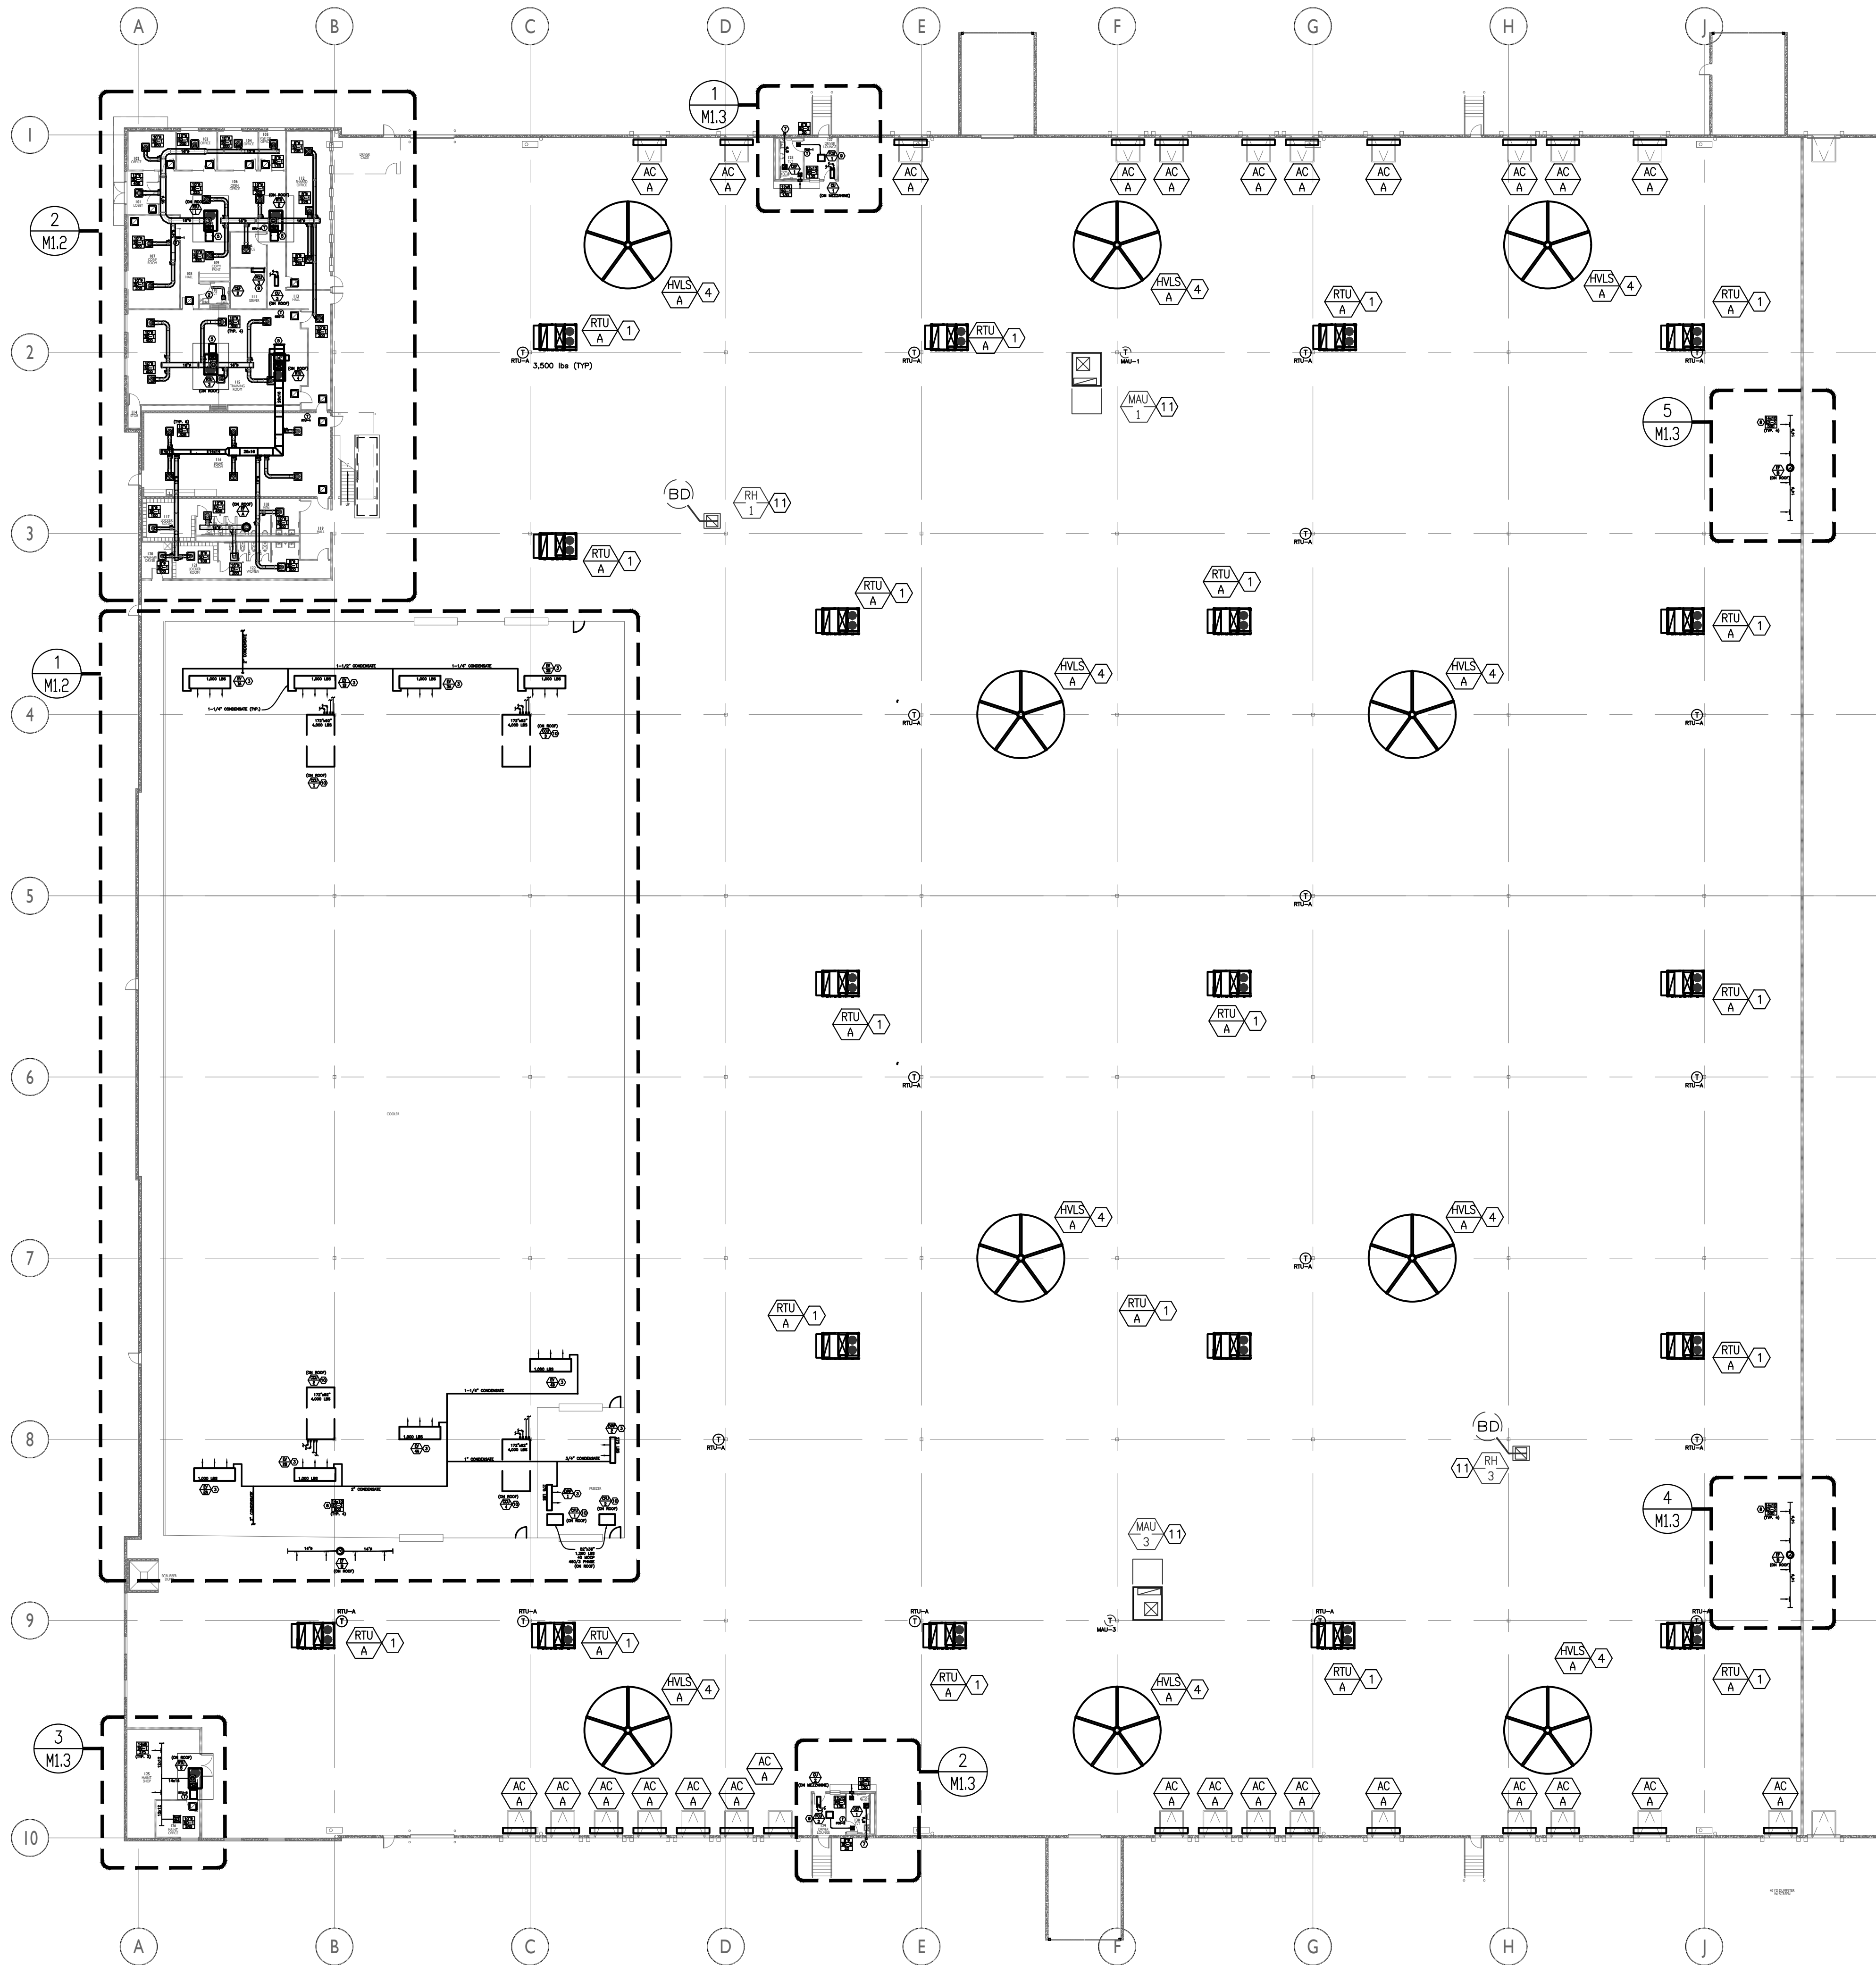

1 Overall Mechanical Floor Plan  
scale: 1" = 25'-0"



**MECHANICAL GENERAL NOTES:**

1. ALL MECHANICAL DUCTWORK SHALL BE GALVANIZED STEEL, CONSTRUCTED ACCORDING TO SMACNA STANDARDS.
2. ALL CONCEALED SUPPLY AIR AND RETURN AIR DUCTWORK SHALL BE EXTERNALLY INSULATED WITH 2" THICK, 3/4 LB DENSITY FIBERGLASS DUCT WRAP.  
ALL EXPOSED (WAREHOUSE) SUPPLY AIR DUCTWORK AND RETURN AIR DUCTWORK SHALL BE INTERNALLY INSULATED WITH 1" THICK, 2 LB DENSITY FIBERGLASS DUCT LINER.
3. HVAC CONTRACTOR WILL CHECK EACH SYSTEM FOR PROPER OPERATION.
4. HVAC CONTRACTOR SHALL HAVE AN INDEPENDENT CONTRACTOR TO TEST & BALANCE HVAC SYSTEM TO THE PROPER AIRFLOWS AND STATIC PRESSURES. A COPY OF THE BALANCING REPORT WILL BE SUBMITTED TO THE OWNER UPON COMPLETION. AIR TO (+/-) 10%, WATER TO (+/-) 5%.
5. FLEXIBLE RUN-OUTS TO BE U.L. LISTED AND HAVE A MAXIMUM LENGTH OF 8'-0". DUCT RUNS TO BE SAME SIZE AS DIFFUSER NECK SIZE SHOWN.
6. AIR HANDLING UNITS SUPPLYING 2,000 CFM OR MORE SHALL HAVE A SMOKE DETECTOR INSTALLED IN THE RETURN AIR DUCTWORK. THE SMOKE DETECTOR SHALL BE INTERLOCKED TO SHUT DOWN ALL SUPPLY FANS UPON ALARM.
7. MAINTAIN MINIMUM 10'-0" FROM ALL PLUMBING VENTS AND EXHAUST VENTS TO ALL OUTSIDE AIR INTAKES.
8. DO NOT INSTALL PIPING OR DUCTWORK OVER ELECTRICAL PANELS.
9. ALL COOLER/FREEZER REFRIGERANT PIPING TO BE INSULATED WITH 1" ARMAFLEX. ALL CONDENSATE PIPING TO BE INSULATED WITH 1" ARMAFLEX. CPVC CAN BE USED FOR ALL NON-HEAT TRACED CONDENSATE PIPING. COPPER TO BE USED FOR ALL HEAT-TRACED CONDENSATE. PROVIDE HEAT TRACING ON ALL CONDENSATE PIPING IN FREEZER PER MANUFACTURER'S RECOMMENDATIONS. PROVIDE UV PAINT ON ALL EXTERIOR INSULATION.

**MECHANICAL PLAN NOTES:**

- 1) COORDINATE LOCATION OF RTU WITH FIRE SUPPRESSION PIPING AND STRUCTURE. PROVIDE INTERNALLY LINED RETURN AIR DUCT DROP WITH MESH SCREEN AND PROVIDE SUPPLY AIR DISCHARGE DROP BOX DIFFUSER SIMILAR TO CURBS PLUS DLPD 40'±30'. NG TO BE UNDER 35 AT 9,000 CFM. PROVIDE SUPPLY AIR TRANSITION FROM RTU OPENING TO DROPBOX DIFFUSER AS REQUIRED. MOUNT THERMOSTAT ON ADJACENT COLUMN.
- 2) PROVIDE 6" EXHAUST VENT UP THROUGH ROOF. PROVIDE WITH WEATHERCAP.
- 3) ROUTE CONDENSATE AS DIRECTED TO FLOOR DRAIN. PROVIDE HEAT TRACE ON ALL FREEZER CONDENSATE PIPING.
- 4) COORDINATE EXACT LOCATION OF HVL'S FAN. PROVIDE ASSOCIATED FAN CONTROLLER ON ADJACENT COLUMN.
- 5) ROUTE FULL SIZE RETURN AIR DUCT DOWN TO 36" ABOVE FINISH CEILING AND PROVIDE WITH SCREENED MESH OPENING.
- 7) PROVIDE 6" EXHAUST VENT OUT THROUGH WALL. PROVIDE WITH WEATHERCAP.
- 8) INSTALL BATTERY CHARGING EXHAUST DUCTWORK TIGHT TO BOTTOM OF STRUCTURE. PROVIDE EXHAUST GRILLES AS NOTED AT 30" FROM BOTTOM OF DUCT. EXHAUST FAN TO RUN CONTINUOUSLY.
- 9) ROUTE CONDENSATE PIPING TO SINK TAILPIECE OR HUB DRAIN ABOVE CEILING FURNISHED BY PLUMBER
- 10) INSTALL CONDENSING UNIT ON ROOF RAILS.
- 11) EXISTING SHELL BUILDING EQUIPMENT TO REMAIN AS CURRENTLY INSTALLED.

**LEGEND**

- HVL 1** GREENHECK HVL/CIRCULATION FAN 24'-0" DIAMETER MODEL DS-6-24-170HV - 2HP, 460/3 PHASE, 250 LBS AND 6 BLADES. PROVIDE WITH MOUNTING ACCESSORIES AND CENTRAL CONTROL PANEL WITH BACKET INTERFACE FOR ALL (10) FANS. CONDUIT AND CONTROL WIRING BY OTHERS. (TYP. 10)
- AC A** AIR CURTAIN - POWERED AIR MODEL ETD-2-108E. UNIT TO BE 108" LONG WITH 10 KW ELECTRIC HEATING. 16 MCA @ 460/3 PHASE, 220 LBS. PROVIDE WITH MAGNETIC DOOR SWITCH, WHITE INTAKE SUPPLY GRILLE, WALL MOUNTED THERMOSTAT AND WASHABLE ALUMINUM FILTER (TYP. 27)
- EW 1** ELECTRIC WALL HEATER - RAYWALL OR EQUAL. 2KW @ 277/1 PHASE. PROVIDE WITH RECESS MOUNTING FRAME, DISCONNECT, INTEGRAL THERMOSTAT.
- SD-1** SUPPLY AIR DIFFUSER - AS SCHEDULED
- RG-1** RETURN AIR GRILLE - AS SCHEDULED
- RG-2** RETURN AIR GRILLE - AS SCHEDULED
- EX-1** EXHAUST AIR GRILLE - AS SCHEDULED
- EX-2** EXHAUST AIR GRILLE - AS SCHEDULED
- SG-1** SUPPLY AIR GRILLE - AS SCHEDULED
- SG-2** SUPPLY AIR GRILLE - AS SCHEDULED
- RETURN AIR GRILLE** - AS SCHEDULED
- T** THERMOSTAT WITH ZONE/UNIT DESIGNATION. MOUNT AT 48" A.F.F.
- VAV 1-3**
- CO2** CARBON DIOXIDE SENSOR - MOUNT IN RETURN OR WALL AS SHOWN

THIS PRINT IS CONFIDENTIAL TO METRO AIR CONDITIONING CO.  
REPRODUCTION OR DISCLOSURE TO OUTSIDE PARTIES IS  
PROHIBITED WITHOUT OUR WRITTEN CONSENT.  
© 2022 METRO AIR CONDITIONING CO.



LSCC BLDG. #1 - TI		
LEE'S SUMMIT, MO		
SCALE: AS NOTED	DATE: 9/6/22	DRAWN BY: M.D.K.
APPROVED BY: JDG	DWG #	M1
PERMIT DWGS.		of 5



**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



**SCANNELL**  
PROPERTIES

CERTIFICATION

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086




ISSUE DATES

PERMIT SET 04.21.22


210300

M1.1



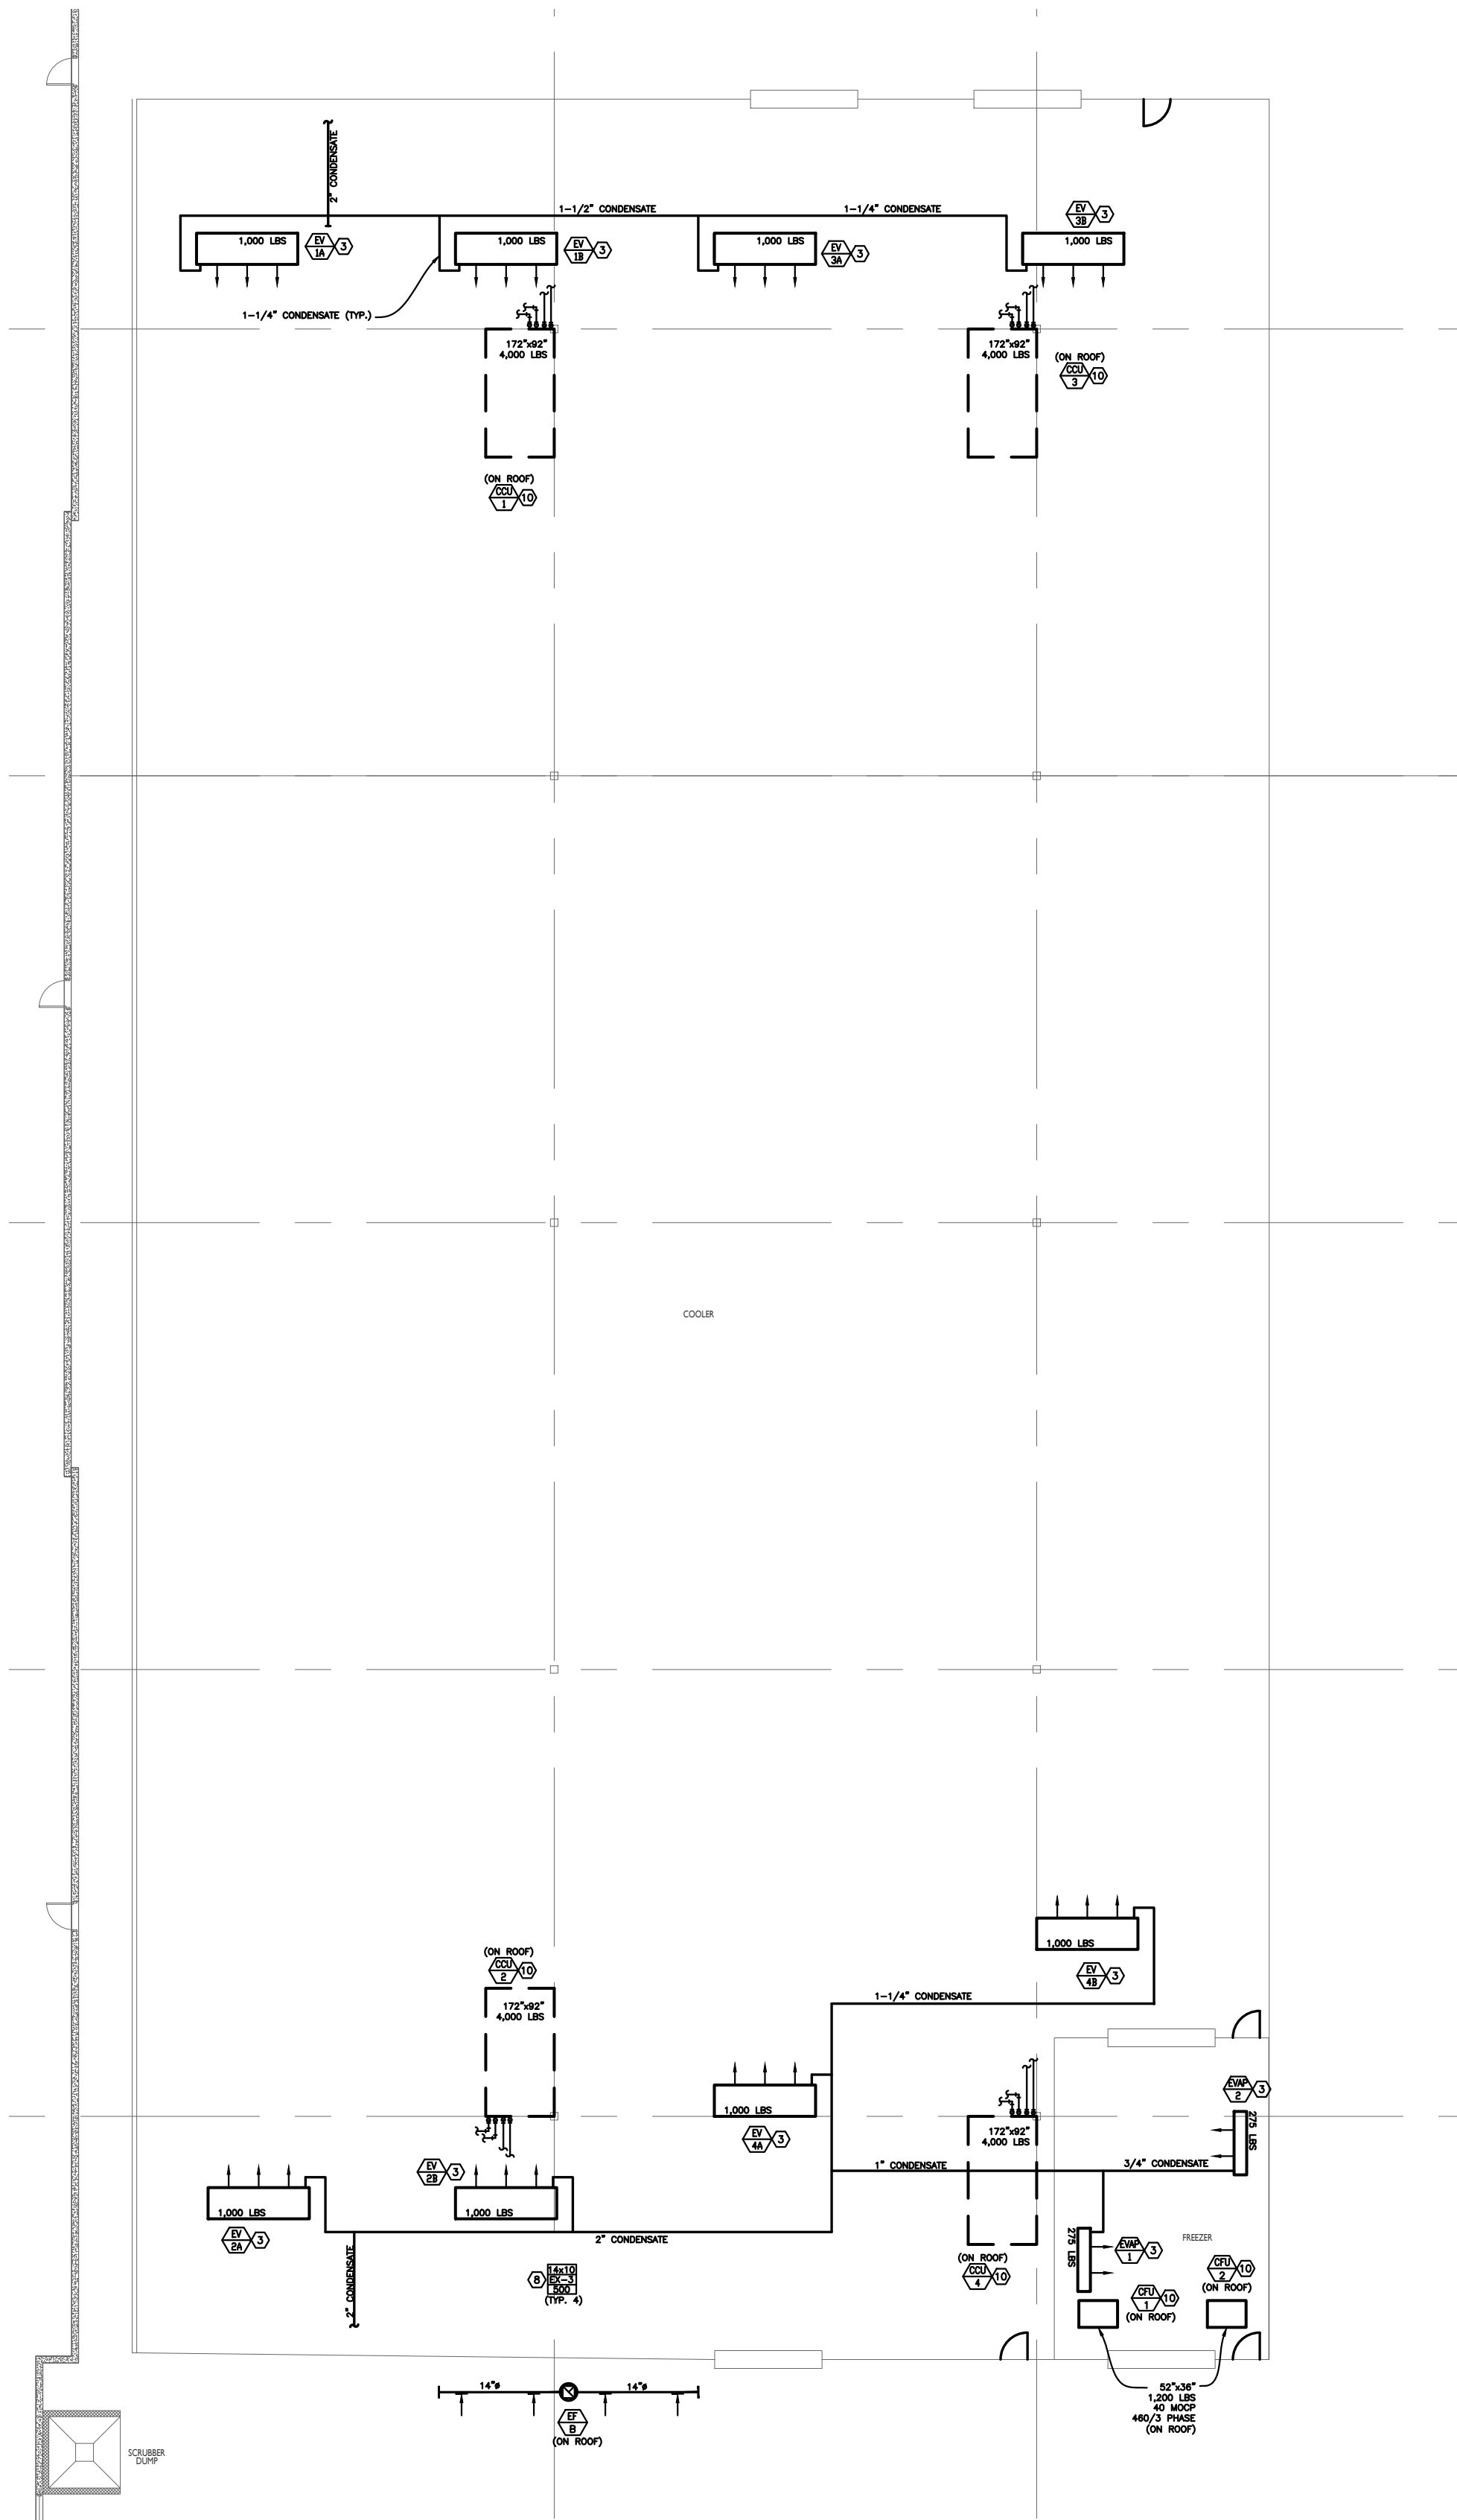

1 Cooler Mechanical Floor Plan  
scale: 1/16" = 1'-0"

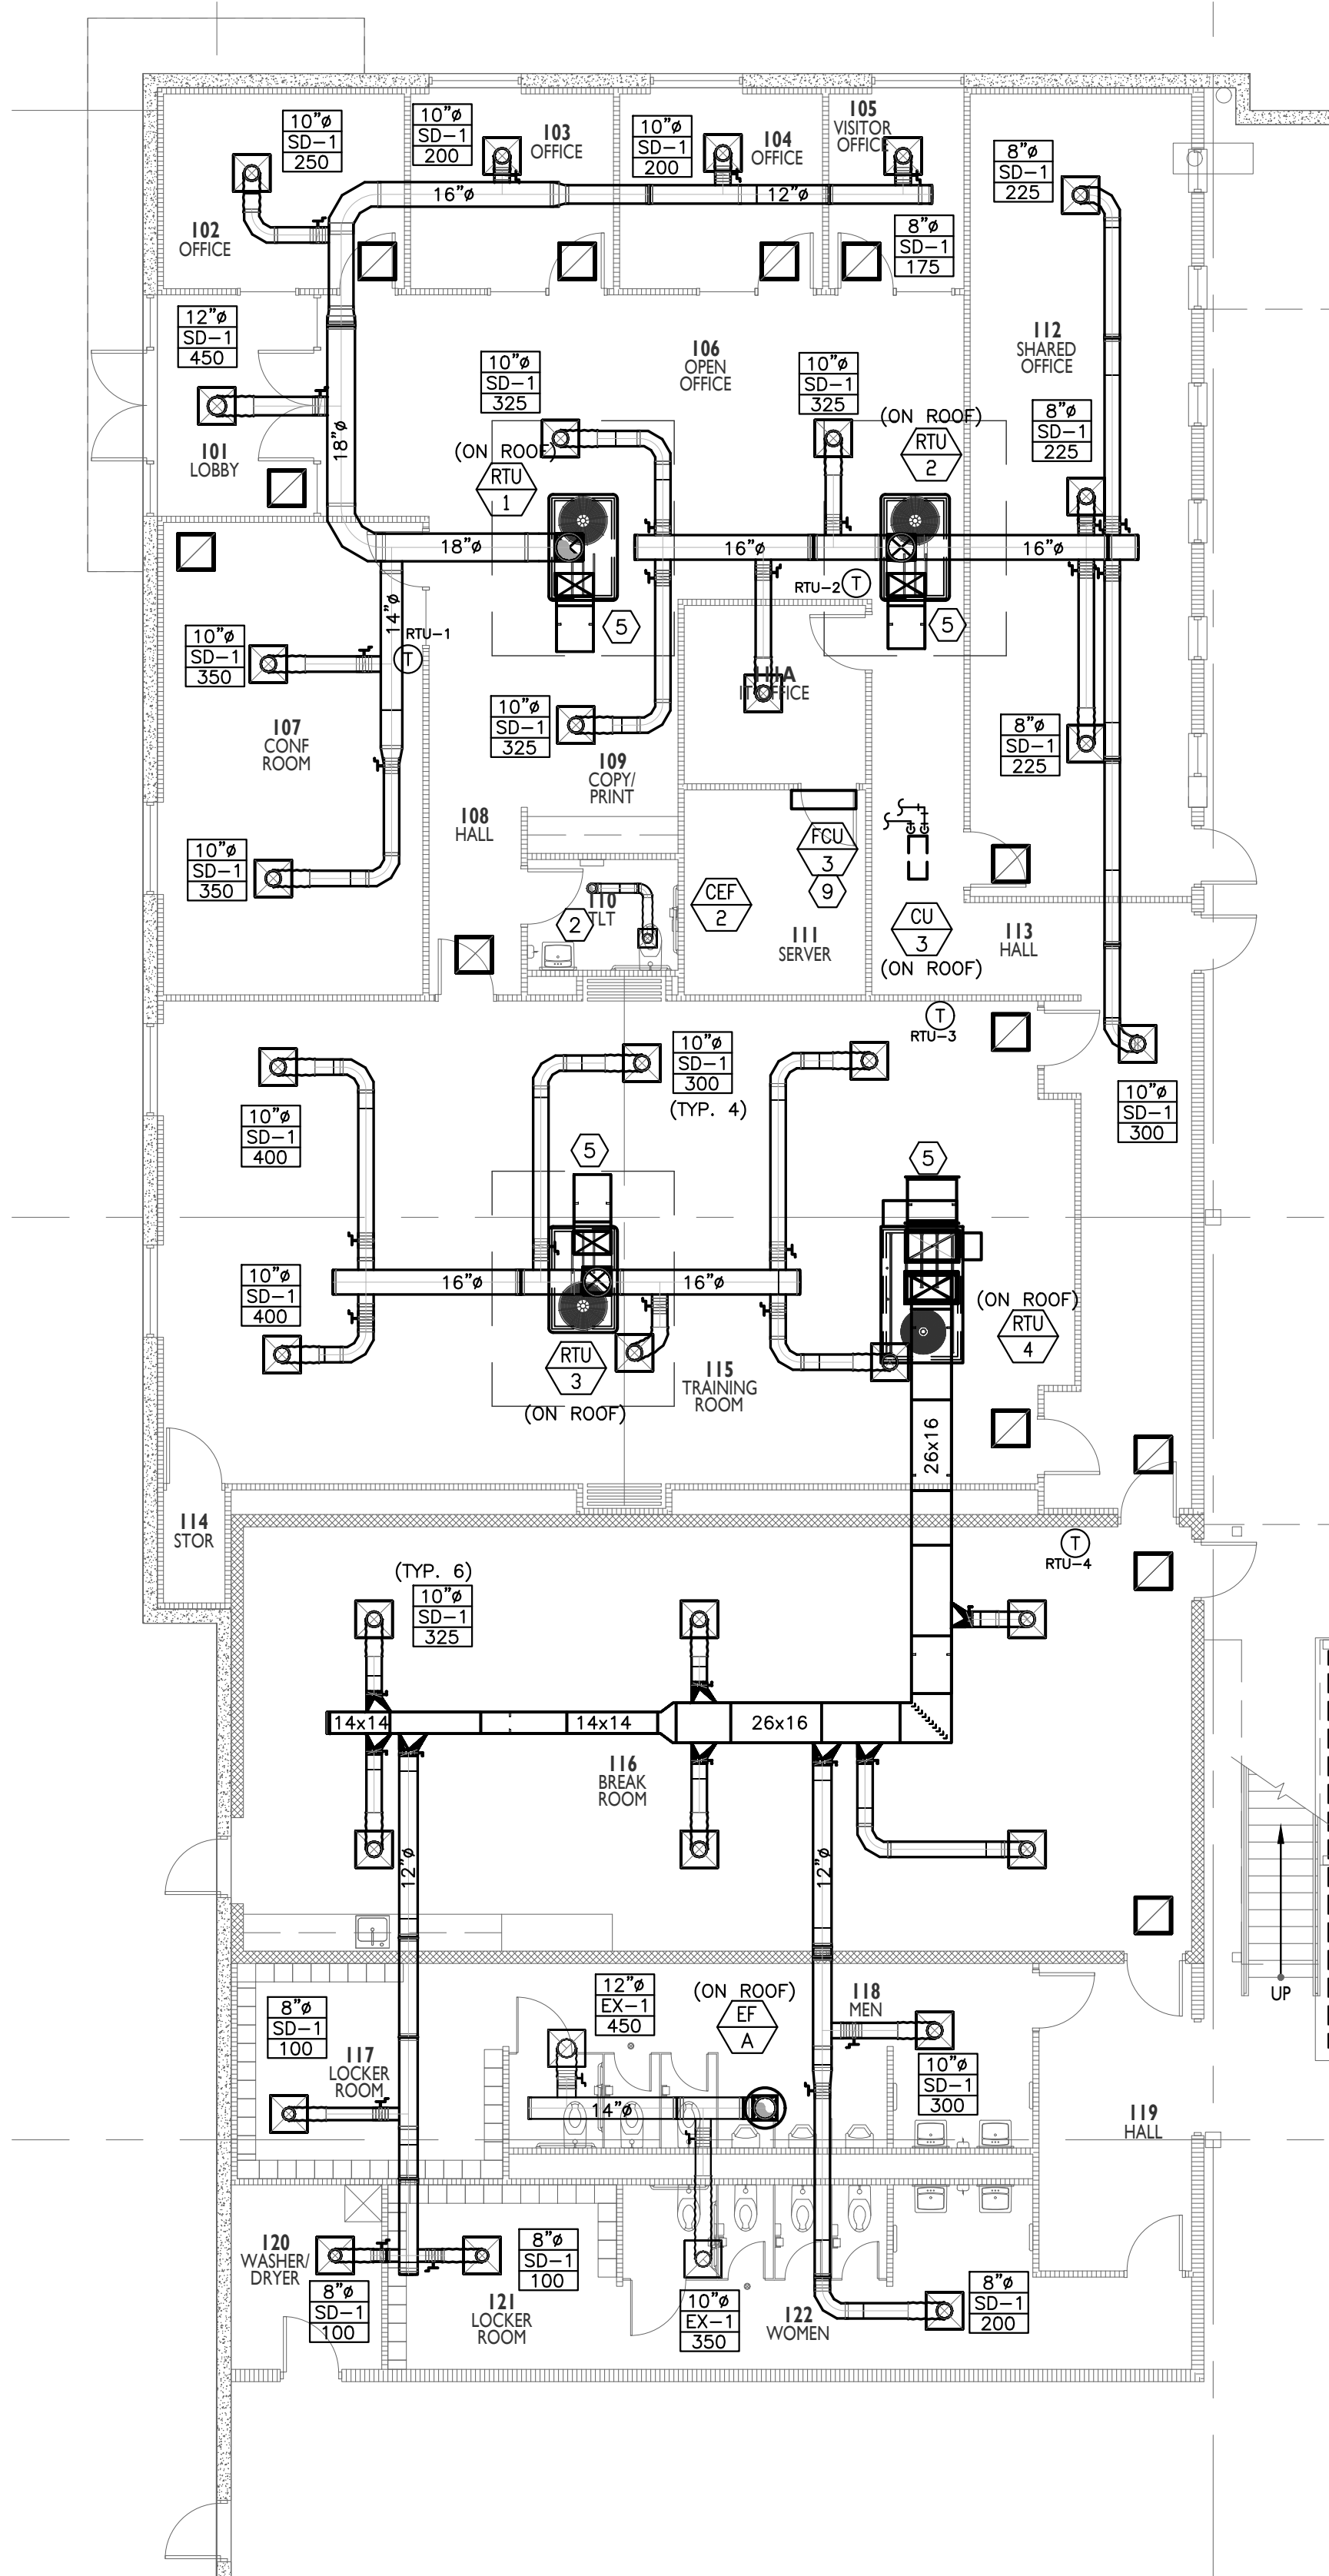

2 Office Mechanical Floor Plan  
scale: 1/8" = 1'-0"




MECHANICAL PLAN NOTES:

- COORDINATE LOCATION OF RTU WITH FIRE SUPPRESSION PIPING AND STRUCTURE. PROVIDE INTERNALLY LINED RETURN AIR DUCT DROP WITH MESH SCREEN AND PROVIDE SUPPLY AIR DISCHARGE DROP BOX DIFFUSER SIMILAR TO CURBS PLUS DUPD 4015-30. NC TO BE UNDER 35 AT 9,000 CFM. PROVIDE SUPPLY AIR TRANSITION FROM RTU OPENING TO DROPBOX DIFFUSER AS REQUIRED. MOUNT THERMOSTAT ON ADJACENT COLUMN.
- PROVIDE 6" EXHAUST VENT UP THROUGH ROOF. PROVIDE WITH WEATHERCAP.
- ROUTE CONDENSATE AS DIRECTED TO FLOOR DRAIN. PROVIDE HEAT TRACE ON ALL FREEZER CONDENSATE PIPING.
- COORDINATE EXACT LOCATION OF HVLS FAN. PROVIDE ASSOCIATED FAN CONTROLLER ON ADJACENT COLUMN.
- ROUTE FULL SIZE RETURN AIR DUCT DOWN TO 36" ABOVE FINISH CEILING AND PROVIDE WITH SCREENED MESH OPENING.
- PROVIDE 6" EXHAUST VENT OUT THROUGH WALL. PROVIDE WITH WEATHERCAP.
- INSTALL BATTERY CHARGING EXHAUST DUCTWORK TIGHT TO BOTTOM OF STRUCTURE. PROVIDE EXHAUST GRILLES AS NOTED AT 30" FROM BOTTOM OF DUCT. EXHAUST FAN TO RUN CONTINUOUSLY.
- ROUTE CONDENSATE PIPING TO SINK TAILPIECE OR HUB DRAIN ABOVE CEILING FURNISHED BY PLUMBER
- INSTALL CONDENSING UNIT ON ROOF RAILS.
- EXISTING SHELL BUILDING EQUIPMENT TO REMAIN AS CURRENTLY INSTALLED.



CURRAN  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



SCANNELL  
PROPERTIES

CERTIFICATION

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086



ISSUE DATES

PERMIT SET 04.21.22

THIS PRINT IS CONFIDENTIAL TO METRO AIR CONDITIONING CO.  
REPRODUCTION OR DISCLOSURE TO OUTSIDE PARTIES IS  
PROHIBITED WITHOUT OUR WRITTEN CONSENT.  
© 2022 METRO AIR CONDITIONING CO.




LSCC BLDG. #1 - TI		
LEE'S SUMMIT, MO		
SCALE: AS NOTED	DATE: 9/6/22	DRAWN BY: M.D.K.
APPROVED BY: JDG	DWG # M2	
PERMIT DWGS.	of 5	

210300

M1.2





**SCANNELL**  
PROPERTIES

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

## LEE'S SUMMIT LOGISTICS BUILDING A LOT 1


NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086



ERMIT SET 04.21.22

10300

M1.3

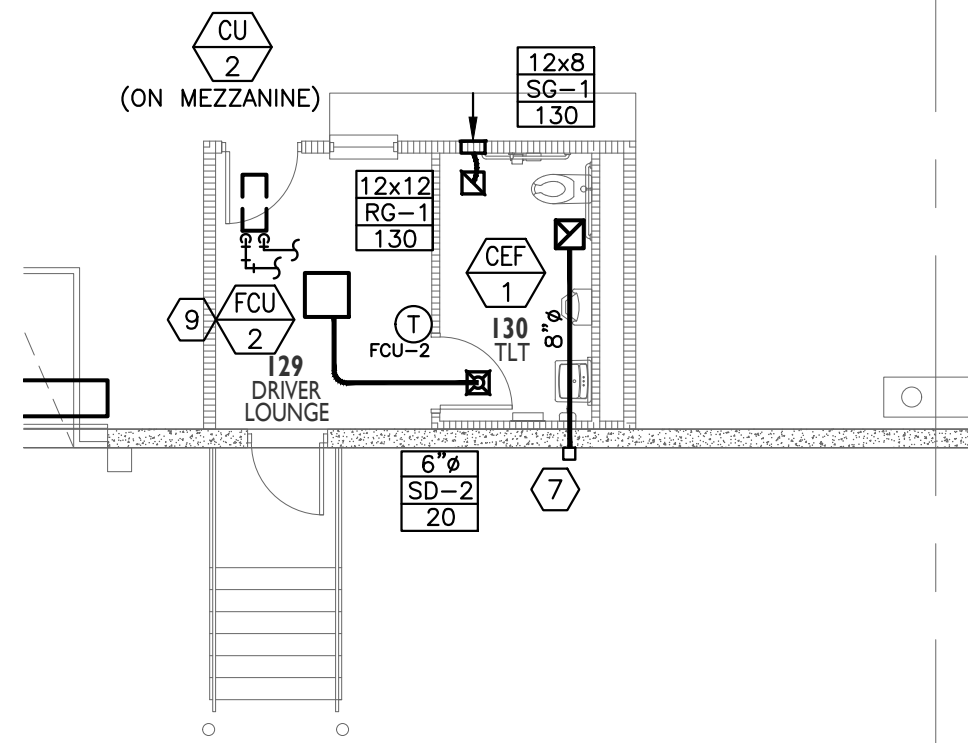

- ① COORDINATE LOCATION OF RTU WITH FIRE SUPPRESSION PIPING AND STRUCTURE. PROVIDE INTERNALLY LINED RETURN AIR DUCT DROP WITH MESH SCREEN AND PROVIDE SUPPLY AIR DISCHARGE DROP BOX DIFFUSER SIMILAR TO CURBS PLUS DLPD 4015-30. NC TO BE UNDER .35 AT 9,000 CFM. PROVIDE SUPPLY AIR TRANSITION FROM RTU OPENING TO DROPBOX DIFFUSER AS REQUIRED. MOUNT THERMOSTAT ON ADJACENT COLUMN.
- ② PROVIDE 6" EXHAUST VENT UP THROUGH ROOF. PROVIDE WITH WEATHERCAP.
- ③ ROUTE CONDENSATE AS DIRECTED TO FLOOR DRAIN. PROVIDE HEAT TRACE ON ALL FREEZER CONDENSATE PIPING.
- ④ COORDINATE EXACT LOCATION OF HVLS FAN. PROVIDE ASSOCIATED FAN CONTROLLER ON ADJACENT COLUMN.
- ⑤ ROUTE FULL SIZE RETURN AIR DUCT DOWN TO 36" ABOVE FINISH CEILING AND PROVIDE WITH SCREENED MESH OPENING.
- ⑦ PROVIDE 6" EXHAUST VENT OUT THROUGH WALL. PROVIDE WITH WEATHERCAP.
- ⑧ INSTALL BATTERY CHARGING EXHAUST DUCTWORK TIGHT TO BOTTOM OF STRUCTURE. PROVIDE EXHAUST GRILLES AS NOTED AT 30" FROM BOTTOM OF DUCT. EXHAUST FAN TO RUN CONTINUOUSLY.
- ⑨ ROUTE CONDENSATE PIPING TO SINK TAILPIPE OR HUB DRAIN ABOVE CEILING FURNISHED BY PLUMBER
- ⑩ INSTALL CONDENSING UNIT ON ROOF RAILS.
- ⑪ EXISTING SHELL BUILDING EQUIPMENT TO REMAIN AS CURRENTLY INSTALLED.



north



north

THIS PRINT IS CONFIDENTIAL TO METRO AIR CONDITIONING CO.  
REPRODUCTION OR DISCLOSURE TO OUTSIDE PARTIES IS  
PROHIBITED WITHOUT OUR WRITTEN CONSENT.  
© 2022 METRO AIR CONDITIONING CO.



LSCC BLDG. #1 - TI

LEE'S SUMMIT, MO

SCALE: AS NOTED

DATE: 9/6/22
--------------

DRAWN BY: M.D.K.

APPROVED BY: JDG

DWG #

of 5



## 1.1 DESCRIPTION:

- A. Division 15 shall be governed by all applicable provisions of the Contract Documents. The Mechanical Contractor shall furnish, install and connect all materials, equipment, apparatus, mechanical systems and incidentals required for complete and working installation. The Contractor shall supply all necessary labor, equipment, tools, insurance, taxes services; and The Contractor shall assume full responsibility for all obligations associated with completion of mechanical work as provided by the Contract Documents.

## 1.2 STANDARDS, REGULATIONS AND CODES:

- A. The work shall comply with the edition of the applicable standards, regulations and codes currently in force of all State and local authorities having jurisdiction. Where quantities, sizes, or other requirements indicated on the drawings or herein specified are in excess of the standard or code requirements, the specifications and/or drawings shall govern. In the absence of other applicable local codes, acceptable to the Architect/Engineer, the Uniform Plumbing and Mechanical Codes shall apply to this work.
- B. The Contractor shall comply with rules and regulations of public utilities and municipal departments affected by connections of services. The Contractor shall pay all fees associated there with.
- C. The Mechanical Contractor shall be licensed to perform mechanical work in the municipality in which the project is located.
- D. All products and types of construction shall meet or exceed the latest edition of applicable standards of manufacturer, testing, performance and installation.

## 1.3 LOCAL CONDITIONS:

- A. The Contractor shall carefully examine the local conditions and existing installations and shall thoroughly familiarize himself with all existing conditions which may affect his work. The Contractor shall locate all existing utilities and protect them during the execution of the work.
- B. The Contractor shall examine the Architectural, Mechanical and Electrical Drawings and Specifications to familiarize himself with the type of construction, materials, and equipment to be used for all work and how it will affect the installation of his contract.

## 1.4 CUTTING AND PATCHING:

- A. All necessary cutting, drilling and patching shall be provided by this Contractor. Structural members shall not be disturbed without prior approval of the Architect. All areas disturbed by work performed under this Contract shall be neatly repaired and refinished to the condition of adjoining surfaces in a manner suitable to the Architect.

## 1.5 OPERATION DURING CONSTRUCTION:

- A. Mechanical equipment shall not be used during construction unless instructed by the General Contractor. The mechanical contractor is responsible for the installation and operation, service and maintenance of all new equipment during construction and prior to acceptance by the Owner of the completed project at additional costs to the GC and/or owner.
- B. Warranty periods shall not commence until final acceptance by the Owner/Substantial Completion.

## 1.6 SAFETY REGULATIONS:

- A. All Mechanical work shall be performed in compliance with all applicable governing safety regulations, including OSHA regulations. Provide safety lights, guards and signs required.

## 1.7 HOUSEKEEPING:

- A. The Contractor shall be responsible for keeping stocks of material and equipment stored on the premises in a neat and orderly manner.
- B. The Contractor shall clean and maintain his portion of the work as specified in the General Conditions.
- C. The Contractor shall remove from the premises all waste material present as a result of his work.

## 1.8 GRAPHIC REPRESENTATION AND JOB CONDITIONS:

- A. The drawings shall serve as working drawings for the general layout of the various items of equipment; are diagrammatic unless specifically dimensioned; and do not necessarily indicate every required item.
- B. The Architectural drawings take precedence over the mechanical drawings in the representation of the general construction work.
- C. Arrange work in a neat, well organized manner. Coordinate work with other trades involved.

## 1.9 GUARANTEES:

- A. The Contractor shall guarantee all work performed and materials and equipment furnished under this contract, against defects in materials and workmanship for a period of one year from the Date of the Owner's Final Acceptance of the Work, or as noted in each section.

## 1.10 MOTORS AND CONTROLS:

- A. All motors furnished under this specification shall be recognized manufacturer, of adequate capacity for the loads involved. All motors shall conform to the standards of manufacturer and performance of the National Electrical Manufacturers Association as shown in their latest publications.

## 1.11 PIPING IN ELECTRICAL ROOMS:

- A. No piping except specifically noted otherwise will be permitted in electrical rooms. In rooms, where piping is indicated over electrical equipment, a suitable galvanized sheetmetal pan or gutter piped to the drainage system shall be provided.

END OF SECTION  
SECTION 15100 - HEATING, VENTILATION AND AIR CONDITIONING

## 1.1 SCOPE:

- A. The work included under this contract consists of providing all labor, materials, tools, transportation, services, etc., necessary to complete the installation of the heating, ventilating, and air conditioning systems and other items herein listed and as described in these specifications, as illustrated in the accompanying drawings or as directed by the Architect.

## 1.2 SHEET METAL:

- A. Provide ductwork shown with necessary dampers. Construction of new galvanized prime grade steel sheets per ASHRAE and SMACNA Standards. Provide round or rectangular duct as indicated. Fabricate for the pressure and SMACNA seal class required.
- B. Flexible duct shall be Wiremold WCK or acceptable equal maximum length shall be 8' - 0" or as noted/detailed.
- C. All duct sizes shown are actual size and include liner, where required.

## 1.3 GRILLES, REGISTERS, INLETS AND OUTLETS:

- A. All supply grilles, registers and diffusers shall be as scheduled on the drawings and shall be ADC rated.

## 1.4 DUCTWORK ACCESSORIES:

- A. Provide single thickness turning vanes in all supply duct turns.
- B. Provide duct access doors for all internal mounted equipment.
- C. Provide 45° take-off fittings with volume damper for all round takeoffs to diffusers.
- D. Provide dampers where shown and required. Balance and control dampers shall be opposed blade except air mixing dampers shall be parallel blade.

## 1.5 AIR CONDITIONING UNITS:

- A. Air conditioning units shall be as scheduled. Units shall be standard catalogued products with the appropriate approval or certification by AGA, ARI and UL. Efficiencies shall conform to ASHRAE 90.1 standards.

## 1.6 FANS:

- A. Fans with accessories shall be as scheduled and shall be AMCA rated.

## 1.7 VIBRATION ISOLATION:

- A. Duct flexible connection shall be non-combustible, 16 ounce canvas. Piping flexible connection shall be Flexicon 401H or acceptable equal.

## 1.8 MISCELLANEOUS MECHANICAL EQUIPMENT:

- A. Provide constant, variable volume and/or fan powered boxes and accessories as scheduled. Acceptable manufacturers are E.H. Price or acceptable equal.


## 1.9 CLEANING:

- A. Clean system by operating at least three hours prior to final acceptance with temporary filters. Remove all filters and replace with clean.
- B. Use precleaned precharged refrigerant tube. Clean per manufacturers recommendations.

## 1.10 TESTING AND ADJUSTING:

- A. Contractor shall operate and test the air conditioning and ventilation systems and instruct the Owner in its operation. Perform a series of general capacity and operating tests. The tests shall demonstrate the specified capacities of various pieces of equipment.


END OF SECTION

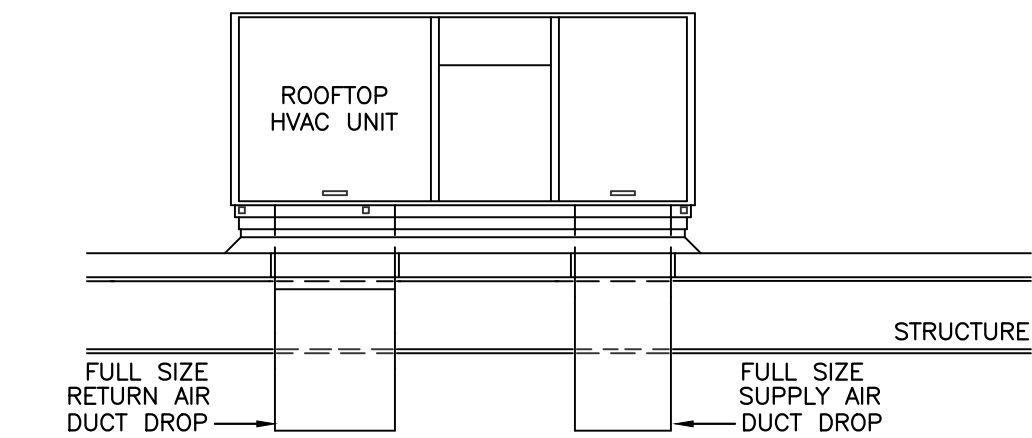

NOTES:  
1. PROVIDE OPENING THROUGH ROOF AND ROOF DECK INSULATION NO LARGER THAN REQUIRED TO ALLOW DUCTS TO PASS THROUGH. REFER TO PLANS FOR ROOF SIZES. FUTURE TI DUCTWORK CONNECTION BY OTHERS.


### 1 ROOFTOP UNIT DETAIL

NO SCALE

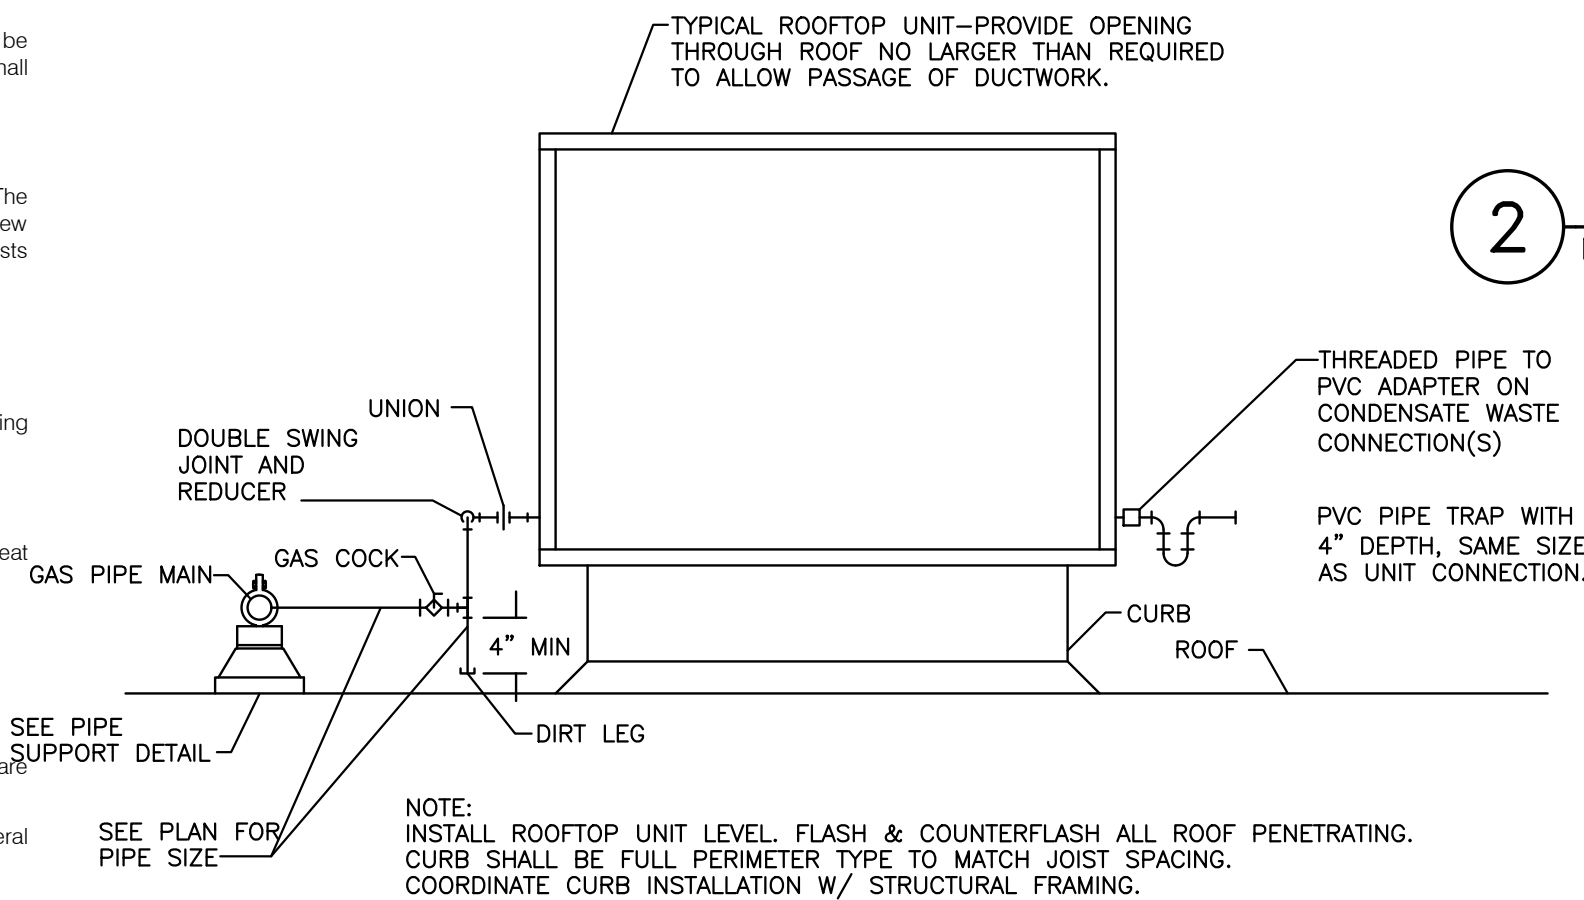

### 3 ROOFTOP UNIT CONNECTION DETAIL


NO SCALE

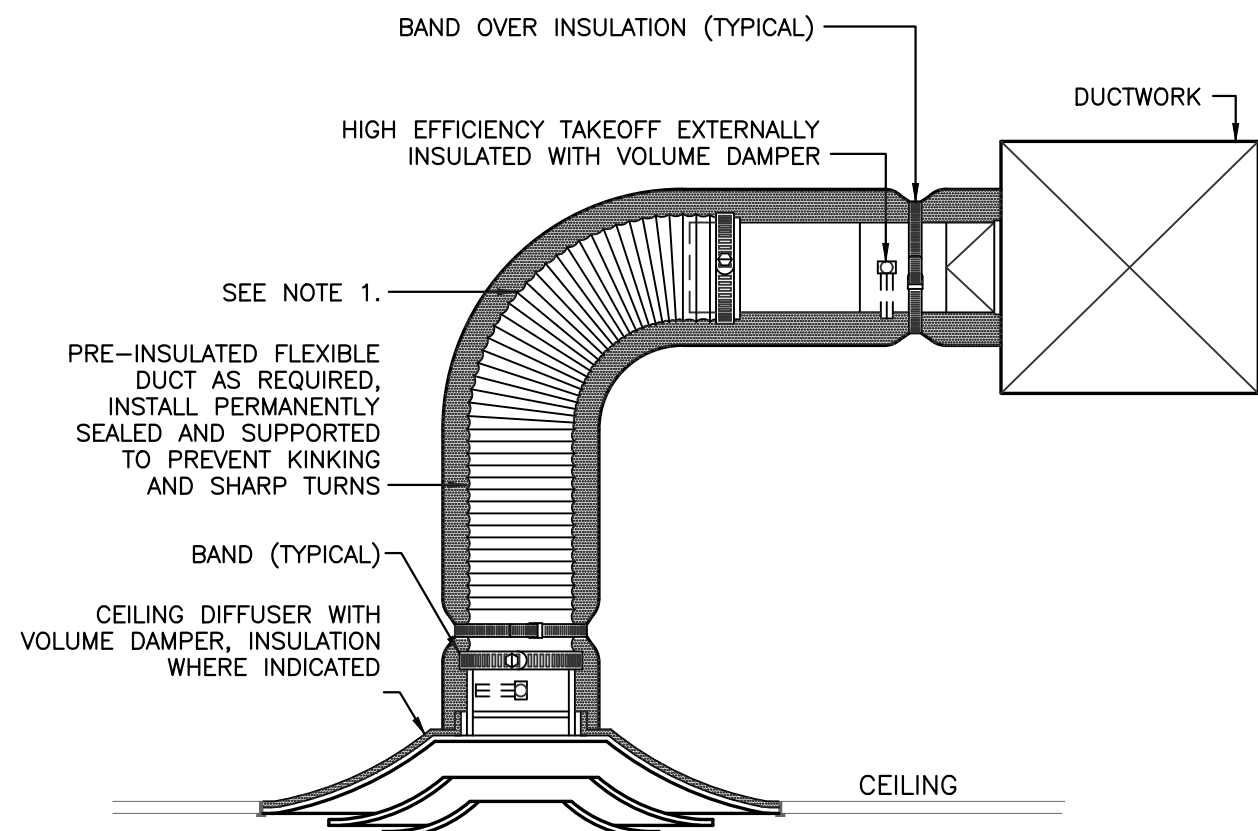

NOTES:  
1. EXTEND HARD METAL DUCT SO THAT MAXIMUM FLEXIBLE DUCT LENGTH DOES NOT EXCEED 8'-0\"/>

### 4 CEILING DIFFUSER DETAIL

NO SCALE

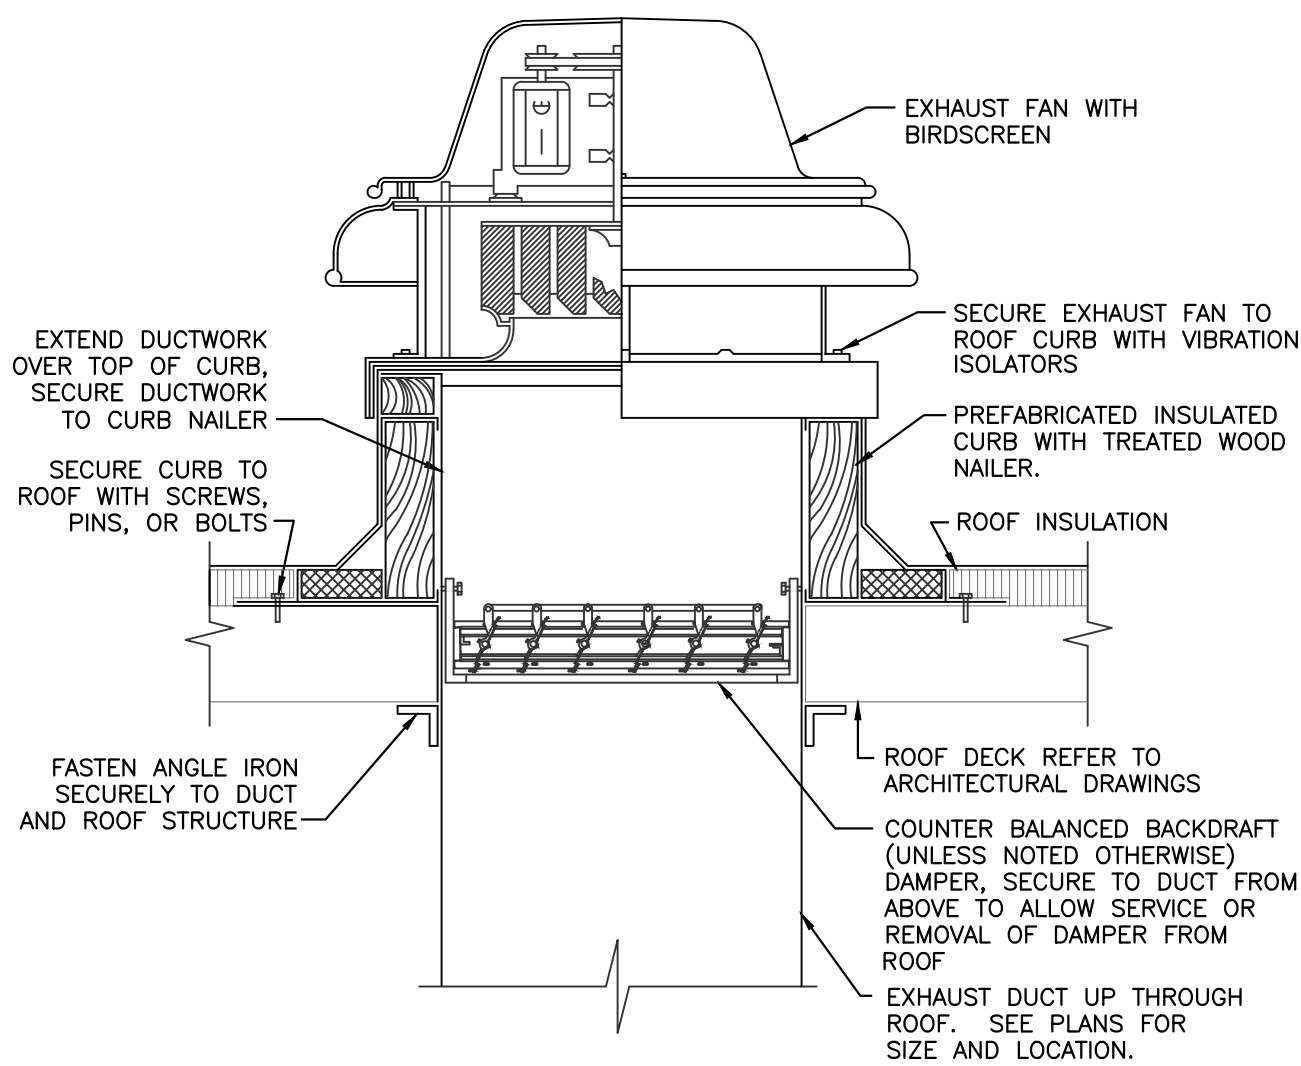

### 2 DOWNBLAST EXHAUST FAN DETAIL

NO SCALE

ROOFTOP UNIT - CONSTANT VOLUME WITH SINGLE SETPOINT CONTROL (ALL RTU'S)

1. DESCRIPTION:  
EACH SINGLE-ZONE PACKAGED ROOFTOP UNIT (RTU) WILL BE PROVIDED AS IDENTIFIED ON THE EQUIPMENT SCHEDULES, WITH DIRECT EXPANSION COOLING COIL, GAS HEAT, SINGLE SPEED SUPPLY FAN, 2" FILTERS, ECONOMIZER, BAROMETRIC RELIEF, AND FIELD POWERED GFCI CONVENIENCE OUTLET. ECONOMIZERS SHALL BE 0-100% FULLY MODULATING WITH ENTHALPY CONTROL, LOW LEAK DAMPERS.
2. CONTROL:  
EACH UNIT SHALL BE FURNISHED WITH A THERMOSTAT TO BE INSTALLED IN THE SPACE. THE OCCUPANCY MODE SHALL BE DETERMINED THROUGH A USER-ADJUSTABLE PROGRAMMABLE SCHEDULE WITH OR WITHOUT USER OVERRIDE BUTTON ON THE THERMOSTAT.
3. SUPPLY AIR FAN:  
THE FAN MODE SHALL BE SELECTABLE FOR AUTO OR ON. WHEN AUTO IS SELECTED, THE FAN SHALL CYCLE ON AND OFF WITH HEATING OR COOLING. WHEN ON IS SELECTED, THE FAN SHALL OPERATE CONTINUOUS.
4. MECHANICAL COOLING:  
EACH RTU SHALL CYCLE COOLING COMPRESSOR STAGES IN RESPONSE TO COOLING DEMAND FROM THE THERMOSTAT. THE SUPPLY FAN WILL BE ENERGIZED (AUTO MODE) AND STAGE COOLING CAPACITY TO MAINTAIN SPACE TEMPERATURE SETPOINT BASED ON FACTORY CONTROL SEQUENCES. THE SPACE COOLING TEMPERATURE SETPOINT SHALL BE ADJUSTABLE THRU THE PROGRAMMABLE THERMOSTAT AND WILL BE SET-UP TO MAINTAIN TEMPERATURES PER TABLE 2.
5. GAS HEATING:  
THE RTU SHALL CYCLE GAS HEATING STAGES IN RESPONSE TO HEATING DEMAND FROM THE THERMOSTAT. ON A CALL FOR HEATING FROM THE ZONE SENSOR, THE SUPPLY FAN WILL BE ENERGIZED AND THE BURNER SHALL BE ENERGIZED TO MAINTAIN SPACE TEMPERATURE. THE SPACE HEATING TEMPERATURE SETPOINT SHALL BE ADJUSTABLE THRU THE PROGRAMMABLE THERMOSTAT AND WILL BE SET-UP TO MAINTAIN TEMPERATURES PER TABLE 2.
6. DEMAND CONTROL VENTILATION (BREAK ROOM RTU'S ONLY):  
THE SPACE MOUNTED CO2 SENSOR SHALL MONITOR THE SPACE AIR QUALITY. AS THE CO2 RISES ABOVE THE CO2 SETPOINT (700 PPM, ADJ.) THE OUTSIDE AIR DAMPER INCREASES ABOVE MINIMUM SETPOINT TO A MAXIMUM POSITION SET DURING BALANCING. AS CO2 LEVELS DECREASE, THE DAMPER MODULATES CLOSED. ONCE THE CO2 LEVEL IS BELOW THE CO2 SETPOINT, THE OUTSIDE AIR DAMPER SHALL RETURN TO THE MINIMUM POSITION.
7. ECONOMIZER - ENTHALPY:  
THE FACTORY RTU CONTROLLER WILL INDEX THE UNIT INTO ECONOMIZER MODE IF THE OUTDOOR AIR DRY BULB IS BELOW THE SETPOINT. WHEN ECONOMIZER MODE IS ENABLED, THE RETURN AND OUTSIDE AIR DAMPERS WILL MODULATE BETWEEN MINIMUM POSITION AND FULL OPEN AS NECESSARY TO MAINTAIN DISCHARGE AIR TEMPERATURE. THE RTU START-UP TECHNICIAN SHALL SET THE UNIT ECONOMIZER.
8. UNOCCUPIED MODE:  
DURING UNOCCUPIED MODE, THE UNIT SHALL CONTROL TO THE UNOCCUPIED MODE SETBACK TEMPERATURE. IF THE UNOCCUPIED SETPOINT IS EXCEEDED, THE RTU SHALL HEAT OR COOL UNTIL THE ZONE TEMPERATURE IS WITHIN THE UNOCCUPIED SETPOINTS, PLUS OR MINUS AN OFFSET OF 5°F (ADJ.).
9. BAROMETRIC RELIEF DAMPER:  
THE BAROMETRIC RELIEF DAMPER CONSISTS OF A GRAVITY DAMPER THAT WILL OPEN TO RELIEVE EXCESS AIR AS BUILDING PRESSURE INCREASES.
10. OUTSIDE AIR DAMPER:  
WHEN UNIT IS NOT IN ECONOMIZER MODE AND THE SUPPLY FAN IS IN OPERATION, THE OUTDOOR AIR DAMPER SHALL MODULATE TO THE MINIMUM PER THE UNIT SCHEDULE DURING THE OCCUPIED MODE. THE OUTDOOR AIR DAMPER SHALL BE CLOSED WHEN THE SUPPLY FAN IS OFF.
11. BALANCING WAREHOUSE RTU WITH 4-WAY DIFFUSER:  
BALANCING CONTRACTOR TO BALANCE WAREHOUSE RTU UTILIZING RPM AND MANUFACTURER'S FAN CURVE. INDIVIDUAL GRILLE AIRFLOW IS NOT REQUIRED. THE BALANCING CONTRACTOR SHALL ASSIST IN SETTING OUTDOOR AIR DAMPER POSITIONS.
12. SMOKE DETECTION CONTROL:  
UPON DETECTION OF SMOKE FROM THE RETURN DUCT SMOKE DETECTOR (BY OTHERS), THE FANS WILL CYCLE OFF AND OUTDOOR AIR DAMPERS SHALL CLOSE. ONCE THE DETECTORS ARE RESET, THE UNIT WILL RETURN TO NORMAL CONTROL. SMOKE DETECTOR INSTALLATION BY OTHERS. IT IS THE RESPONSIBILITY OF THE FIRE ALARM CONTRACTOR TO WIRE THE SMOKE DETECTOR TO THE EMERGENCY SHUT DOWN OF THE RTU CONTROLLER.

IT / DATA / MDF ROOM DUCTLESS COOLING-ONLY SPLIT SYSTEM, WALL-MOUNTED (FCU-3)

1. DESCRIPTION:  
THE SYSTEM SHALL CONSIST OF A SINGLE-ZONE SPLIT SYSTEM WITH INDOOR FAN-COILHANDLING UNIT (FCU) AND COOLING-ONLY OUTDOOR CONDENSING UNIT (CU).
2. CONTROL:  
THE SPACE TEMPERATURE SHALL BE CONTROLLED IN A STAND-ALONE MODE BY MANUFACTURER SUPPLIED THERMOSTAT MOUNTED IN ROOM.
3. COOLING:  
THE AHU SHALL OPERATE CONTINUOUSLY. THE CU SHALL CYCLE CAPACITY AS NEEDED TO MAINTAIN THE SPACE TEMPERATURE OF 74°F (ADJ.).

SHIPPING/RECEIVING (FCU-1/2)

1. DESCRIPTION:  
THE SYSTEM SHALL CONSIST OF A SINGLE-ZONE SPLIT SYSTEM WITH INDOOR FAN-COILHANDLING UNIT (FCU) AND COOLING-ONLY OUTDOOR CONDENSING UNIT (CU).
2. CONTROL:  
THE SPACE TEMPERATURE SHALL BE CONTROLLED IN A STAND-ALONE MODE BY MANUFACTURER SUPPLIED THERMOSTAT MOUNTED IN ROOM.
3. COOLING:  
THE AHU SHALL OPERATE CONTINUOUSLY. THE CU SHALL CYCLE CAPACITY AS NEEDED TO MAINTAIN THE SPACE TEMPERATURE OF 74°F (ADJ.).

EXHAUST FAN (EF-1/2/3)

1. CONTROL:  
THE EXHAUST FAN SHALL OPERATE CONTINUOUSLY AS INDICATED ON THE EXHAUST FAN EQUIPMENT SCHEDULE.
2. CONTINUOUS:  
THE EXHAUST FAN SHALL OPERATE CONTINUOUSLY (24/7). THE FAN MAY BE DE-ENERGIZED USING THE DISCONNECT SWITCH.

EXHAUST FAN (CEF-1) (TYP.)

1. CONTROL:  
THE EXHAUST FAN SHALL BE INTERLOCKED WITH THE RESTROOM LIGHT SWITCH, AS INDICATED ON THE EXHAUST FAN EQUIPMENT SCHEDULE.
2. ROOM LIGHT SWITCH:  
THE EXHAUST FAN SHALL BE INTERLOCKED WITH THE ROOM LIGHT CONTROL OR WALL SWITCH AND SHALL BE ENERGIZED ANY TIME THE LIGHTS ARE ON IN THE ROOM. (WIRING BY OTHERS)

AIR CURTAIN (AC-A)

1. DESCRIPTION:  
EACH UNIT SHALL CONSIST OF A HEATED ELECTRIC AIR CURTAIN FOR ENVIRONMENTAL SEPARATION. UNIT SHALL BE PROVIDED WITH FACTORY-INSTALLED 24V TRANSFORMER, MAGNETIC DOOR LIMIT SWITCH, HEAT-OFF-FAN SWITCH, AND THERMOSTAT.
2. DOOR LIMIT CONTROL:  
AIR CURTAIN SHALL ENERGIZE AS DOOR BEGINS TO OPEN AS INDICATED BY THE MAGNETIC DOOR LIMIT SWITCHES. UNIT SHALL DE-ENERGIZE WHEN THE DOOR HAS CLOSED.
3. HEAT-OFF-FAN CONTROL:  
WHEN THE SWITCH IS IN THE OFF POSITION THE AIR CURTAIN IS INOPERABLE. IN THE HEAT POSITION, THE AIR CURTAIN WILL RUN WITH HEAT BASED ON THE LIMIT SWITCH OR THERMOSTAT. IN THE FAN POSITION, THE AIR CURTAIN WILL RUN WITHOUT HEAT BASED ON THE LIMIT SWITCH.
4. HEATING:  
AIR CURTAINS HAVING SINGLE (ONE-STAGE) HEATING ELEMENTS, ARE CONTROLLED BY A SINGLE STAGE THERMOSTAT. WHEN THE AIR CURTAIN CONTROL CIRCUIT CLOSSES, THE AIR CURTAIN FAN WILL RUN AND THROUGH INTERLOCKING, WILL ENABLE THE HEATER CIRCUIT ON A CALL FOR HEAT. THE THERMOSTAT WILL ENERGIZE THE HEATER CONTROL CONTACTOR. THE THERMOSTAT WILL THEN CYCLE THE HEATER AS NEEDED, AS LONG AS THE AIR CURTAIN CONTROL CIRCUIT IS CLOSED (FAN IS RUNNING). WHEN THE AIR CURTAIN CONTROL CIRCUIT OPENS, THE HEATER CIRCUIT IS DISABLED, THE HEATER WILL DE-ENERGIZE AND THE FAN WILL SHUT OFF.



**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

CERTIFICATION

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE. © COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086




ISSUE DATES

PERMIT SET 04.21.22

210300

M2.1

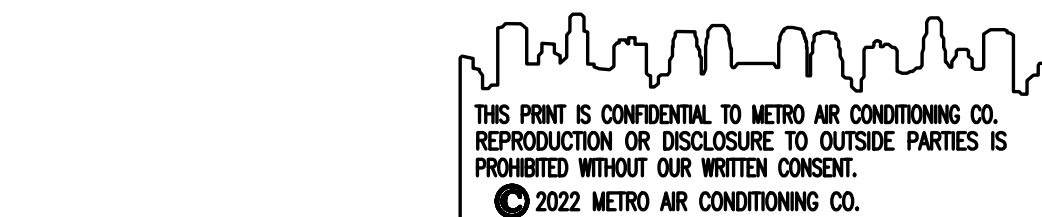

LSCC BLDG. #1 - TI		
LEE'S SUMMIT, MO		
SCALE: AS NOTED	DATE: 9/6/22	DRAWN BY: M.D.K.
APPROVED BY: JDG	DWG #	M4
PERMIT DWGS.		of 5



ROOFTOP UNIT SCHEDULE (NATURAL GAS HEAT)																								
MARK	MANUFACTURER	MODEL	SERVICE	QUANTITY	NOMINAL TONNAGE	SUPPLY FAN				COOLING COIL		GAS HEATING COIL			ELECTRIC HEATING		ELECTRICAL			WEIGHT (LBS) W/ CURB	MIN. OUTSIDE AIR (CFM)	MAX. OUTSIDE AIR (CFM)	MIN. EER	NOTES
						CFM	ESP (IN)	MODE	HP	IH (MBH)	SH (MBH)	INPUT (MBH)	OUTPUT (MBH)	STAGES	INPUT (KW)	STAGES	MCA	MOCP	V/PH					
RTU-A	TRANE	YSD300G4RHC	WAREHOUSE	19	25	9,000	0.50	CV	7.5	300	234	400	320	2	---	---	56	70	460/3	3,200	800	800	10.0	A - H
RTU-1	TRANE	YSC060	MAIN OFFICE	1	5	1,975	0.75	CV	1.0	58	48	100	81	2	---	---	15	20	460/3	1,000	200	200	12.0	A - H
RTU-2	TRANE	YSC060	MAIN OFFICE	1	5	1,950	0.75	CV	1.0	58	48	100	81	2	---	---	15	20	460/3	1,000	175	175	12.0	A - H
RTU-3	TRANE	YSC060	MAIN OFFICE	1	5	2,000	0.75	CV	1.0	58	48	100	81	2	---	---	15	20	460/3	1,000	300	300	12.0	A - H
RTU-4	TRANE	YSC092F	MAIN OFFICE	1	7.5	2,750	0.75	CV	2.0	90	68	150	120	2	---	---	18	20	460/3	1,500	450	450	11.0	A - H
RTU-5	TRANE	YSC036	MAINTENANCE	1	3	1,000	0.50	CV	0.5	35	26	80	60	2	---	---	10	15	460/3	1,000	70	70	12.0	A - H

NOTES:

A. STARTERS FOR ALL MOTORS SHALL BE FURNISHED INTEGRAL WITH UNIT.

B. EQUIPMENT SIZED FOR 100 DEGREE F AMBIENT TEMPERATURE.

C. PROVIDE 2", 30% EFFICIENT PLEATED THROWAWAY AIR FILTERS.

D. PROVIDE MANUFACTURER'S STANDARD SRPING VIBRATION ISOLATION ROOF CURB WITH MINIMUM HEIGHT OF 14".

E. PROVIDE FACTORY MOUNTED DISCONNECT SWITCH, FIELD POWERED GFI OUTLET AND HAIL GUARDS.

F. PROVIDE WITH TRANE AIRFI CONTROLS TO INTEGRATE INTO BAS.

G. PROVIDE ENTHALPY ECONOMIZER WITH BAROMETRIC RELIEF DAMPER.

H. ELECTRIC/FIRE ALARM CONTRACTOR TO FURNISH AND INSTALL SMOKE DETECTOR IN RETURN AIR DUCT.

J. PROVIDE WITH HOT-GAS REHEAT AND DEHUMIDIFICATION CONTROLS AND HAIL MOUNTED CO2 SENSOR. CO2 SENSOR TO MODULATE OA FROM MINIMUM TO MAXIMUM AIRFLOWS.

K. PROVIDE WITH VARIABLE FREQUENCY DRIVE FOR SINGLE ZONE VAV OPERATION.

L. UNIT SHALL BE VVT. PROVIDE WITH BYPASS DAMPER AND REQUIRED CONTROLS FOR PROPER OPERATION.

M. PROVIDE WITH CO2 SENSOR MOUNTED AS SHOWN ON PLANS (WALL OR DUCT MOUNT) AND MODULATE VENTILATION FROM MINIMUM TO MAXIMUM SCHEDULED VALUES.

OUTSIDE AIR CALCULATIONS									
UNIT SERVED	OCCUPANCY CLASSIFICATION	(AREA SQ. FT.)	PEOPLE PER 1,000 SQ. FT.	FIXED SEATING QUANTITY	QUANTITY OF PEOPLE	REQUIRED OUTSIDE AIR PER PERSON	REQUIRED OUTSIDE AIR PER SQ. FT.	TOTAL REQUIRED (CFM)	NOTES
RTU-A	WAREHOUSE	180,000	---	---	---	---	0.08	14,400	A
REQUIRED VENTILATION								14,400 CFM	B

NOTES:  
A. VALUES TAKEN FROM ASHRAE 62.1-2010 - VENTILATION FOR ACCEPTABLE INDOOR AIR QUALITY.  
B. TOTAL VENTILATION FOR WAREHOUSE TO BE DIVIDED AMONG ALL RTU-A. REFER TO EQUIPMENT SCHEDULE FOR ACTUAL AMOUNT.



**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



## CERTIFICATION

COOLER/FREEZER EQUIPMENT SCHEDULE																	
MARK	MANUFACTURER	MODEL	SERVICE	QUANTITY	TYPE	SUPPLY FAN(S)			PIPING CONNECTIONS			ELECTRICAL			WEIGHT	HEIGHT W/O RAILS	NOTES
						CFM	HP	QTY.	LIQUID	SUCTION	CONDENSATE	MCA	MOCP	V/PH			
CFU-1	HEATCRAFT/BOHN	BCH0075LDACD	(-) 10 F FREEZER	1	CONDENSING UNIT	---	7.5	---	7/8"	1-5/8"	---	38	40	460/3	1,000	40"	A - D
EVAP-1	HEATCRAFT/LARKIN	BEM0325MS4EMA		1	EVAPORATOR	7,100	1/4	3	1-1/8"	1-5/8"	3/4"	18	---	460/1	300	30"	A - B
CFU-2	HEATCRAFT/BOHN	BCH0075LDACD	(-) 10 F FREEZER	1	CONDENSING UNIT	---	7.5	---	7/8"	1-5/8"	---	38	40	460/3	1,000	40"	A - D
EVAP-2	HEATCRAFT/LARKIN	BEM0325MS4EMA		1	EVAPORATOR	7,100	1/4	3	1-1/8"	1-5/8"	3/4"	18	---	460/1	300	30"	A - B
CCU-1	HEATCRAFT/BOHN	BCD0400MDACD	(+ ) 38 F COOLER	1	CONDENSING UNIT	---	40	---	1-5/8" x (2)	2-1/8" x (2)	---	142	150	460/3	4,500	56"	A - D
EV-1A	HEATCRAFT/BOHN	BHA1400SA		1	EVAPORATOR	20,700	1	3	1-5/8"	2-1/8"	1-1/4"	7	---	460/3	800	51"	A - B, E
EV-1B	HEATCRAFT/BOHN	BHA1400SA		1	EVAPORATOR	20,700	1	3	1-5/8"	2-1/8"	1-1/4"	7	---	460/3	800	51"	A - B, E
CCU-2	HEATCRAFT/BOHN	BCD0400MDACD	(+ ) 38 F COOLER	1	CONDENSING UNIT	---	40	---	1-5/8" x (2)	2-1/8" x (2)	---	142	150	460/3	4,500	56"	A - D
EV-2A	HEATCRAFT/BOHN	BHA1400SA		1	EVAPORATOR	20,700	1	3	1-5/8"	2-1/8"	1-1/4"	7	---	460/3	800	51"	A - B, E
EV-2B	HEATCRAFT/BOHN	BHA1400SA		1	EVAPORATOR	20,700	1	3	1-5/8"	2-1/8"	1-1/4"	7	---	460/3	800	51"	A - B, E
CCU-3	HEATCRAFT/BOHN	BCD0400MDACD	(+ ) 38 F COOLER	1	CONDENSING UNIT	---	40	---	1-5/8" x (2)	2-1/8" x (2)	---	142	150	460/3	4,500	56"	A - D
EV-3A	HEATCRAFT/BOHN	BHA1400SA		1	EVAPORATOR	20,700	1	3	1-5/8"	2-1/8"	1-1/4"	7	---	460/3	800	51"	A - B, E
EV-3B	HEATCRAFT/BOHN	BHA1400SA		1	EVAPORATOR	20,700	1	3	1-5/8"	2-1/8"	1-1/4"	7	---	460/3	800	51"	A - B, E
CCU-4	HEATCRAFT/BOHN	BCD0400MDACD	(+ ) 38 F COOLER	1	CONDENSING UNIT	---	40	---	1-5/8" x (2)	2-1/8" x (2)	---	142	150	460/3	4,500	56"	A - D
EV-4A	HEATCRAFT/BOHN	BHA1400SA		1	EVAPORATOR	20,700	1	3	1-5/8"	2-1/8"	1-1/4"	7	---	460/3	800	51"	A - B, E
EV-4B	HEATCRAFT/BOHN	BHA1400SA		1	EVAPORATOR	20,700	1	3	1-5/8"	2-1/8"	1-1/4"	7	---	460/3	800	51"	A - B, E
NOTES: A. PROVIDE LOW AMBIENT CONTROL AND R448A REFRIGERANT AND 5YR COMPRESSOR WARRANTY. B. EQUIPMENT SIZED FOR 100 DEGREE F AMBIENT TEMPERATURE. C. PROVIDE WITH HEATCRAFT VANTAGE AUTO-ROTATE THERMOSTAT CONTROLLER FOR REFRIGERATION SYSTEM. PROVIDE WITH TEMPERATURE SENSORS FOR MOUNTING IN COOLER/FREEZER UNIT SHALL BE PROGRAMMED TO CALL OUT DURING TEMPERATURE ALARMS. D. ADD 16" EQUIPMENT SUPPORT RAILS TO CALCULATE OVERALL EQUIPMENT HEIGHT ON ROOF. E. PROVIDE WITH HIGH AIRFLOW COLLAR.																	

OUTSIDE AIR CALCULATIONS									
UNIT SERVED	OCCUPANCY CLASSIFICATION	AREA (SQ. FT.)	PEOPLE PER 1,000	FIXED SEATING QUANTITY	QUANTITY OF PEOPLE	REQUIRED OUTSIDE AIR PER PERSON	REQUIRED OUTSIDE AIR PER SF	TOTAL REQUIRED AIRFLOW	NOTES
RTU-1	OFFICE	470	7	---	3	5	0.06	45	A
	CORRIDOR	105	---	---	---	---	0.06	6	A
	CONFERENCE	385	50	---	19	5	0.06	119	A
							REQUIRED VENTILATION	170 CFM	C
RTU-2	OFFICE	1,390	7	---	10	5	0.06	132	A
	CORRIDOR	340	---	---	---	---	0.06	20	A
							REQUIRED VENTILATION	152 CFM	C
RTU-3	CONFERENCE	1,280	50	43	64	5	0.06	292	A
								REQUIRED VENTILATION	292 CFM
RTU-4	BREAK ROOM	1,250	25	60	31	5	0.06	375	A
	RESTROOMS	950	---	---	---	---	0.06	57	A
							REQUIRED VENTILATION	432 CFM	C
FCU-1	OFFICE	105	7	---	1	5	0.06	10	A
	RESTROOMS	70	---	---	---	---	0.06	4	A
							REQUIRED VENTILATION	14 CFM	D
FCU-2	OFFICE	105	7	---	1	5	0.06	10	A
	RESTROOMS	70	---	---	---	---	0.06	4	A
							REQUIRED VENTILATION	14 CFM	D
FCU-4	OFFICE	600	7	---	4	5	0.06	57	A
							REQUIRED VENTILATION	57 CFM	C
NOTES:									
A. VENTILATION RATES ARE TAKEN FROM ASHRAE 62.1-2010 - VENTILATION FOR ACCEPTABLE INDOOR AIR QUALITY.									
B. VENTILATION IS BASED ON TOTAL QUANTITY OF PEOPLE TAKEN FROM NUMBER OF ACTUAL SEATING SHOWN ON ARCHITECTURAL FLOOR PLAN.									
C. REFER TO RTU SCHEDULE FOR ACTUAL VENTILATION AIRFLOWS.									
D. VENTILATION PROVIDED BY OPERABLE DOORS.									

MARK	MANUFACTURER	MODEL	TYPE	SUPPLY FAN		COOLING COIL		ELECTRICAL			VENTILATION (CFM)	WEIGHT (LBS)	NOTES
				CFM	ESP (IN)	TH (MBH)	SH (MBH)	MCA	MOCP	V/PH			
FCU-1	LENNOX	M22A012S4-2P	CEILING MOUNT CASSETTE	400	---	12	8	1	---	---	---	45	F, G
CU-1	LENNOX	MPB012S4S-1P	CONDENSING UNIT	---	---	---	---	12	15	208/1	---	150	A - E
FCU-2	LENNOX	M22A012S4-2P	CEILING MOUNT CASSETTE	400	---	12	8	1	---	---	---	45	F, G
CU-2	LENNOX	MPB012S4S-1P	CONDENSING UNIT	---	---	---	---	12	15	208/1	---	150	A - E
FCU-3	LENNOX	MWMA036S4	WALL MOUNT FAN-COIL	1,000	---	36	28	1	---	---	---	45	F
CU-3	LENNOX	MPB036S4S	CONDENSING UNIT	---	---	---	---	35	50	208/1	---	250	A - E

NOTES:

A. PROVIDE WITH WIRELESS TEMPERATURE CONTROLLER AND LOW-AMBIENT WIND BAFFLE KIT.

B. FAN-COIL TO BE POWERED FROM CONDENSING UNIT POWER CIRCUIT. REFER TO INSTALLATION INSTRUCTIONS.

C. INSTALL CONDENSING UNIT ON TREATED 4X4 WOOD BLOCKING.

D. PROVIDE WITH 50'-0" PRE-INSULATED LINESET AS REQUIRED.

E. ELECTRICAL CONTRACTOR TO PROVIDE ASSOCIATED POWER WIRING BETWEEN CU AND FCU.

F. PROVIDE WITH CONDENSATE PUMP AND DISCHARGE. CONDENSATE PER PLANS AS REQUIRED.

G. VENTILATION PROVIDED BY OPERABLE DOORS.

MARK	MANUFACTURER	MODEL	TYPE	SIZE	MOUNTING	FINISH	MATERIAL	NOTES
SD-1	PRICE	SPD	SQUARE PLAQUE	24" x 24"	LAY-IN	WHITE	STEEL	
SD-2	PRICE	SPD	SQUARE PLAQUE	24" x 24"	SURFACE	WHITE	STEEL	B
SD-3	PRICE	SPD	SQUARE PLAQUE	12" x 12"	LAY-IN	WHITE	STEEL	
SD-4	PRICE	SPD	SQUARE PLAQUE	12" x 12"	SURFACE	WHITE	STEEL	B
VAV-1	PRICE	VARTHERM	VAV	24" x 24"	LAY-IN	WHITE	STEEL	
LSD-1	PRICE	TBD	LINEAR SLOT	4'-0" X (4) 1" SLOT	LAY-IN	WHITE	STEEL	H
SG-1	PRICE	520DL	WALL MOUNT	AS NOTED	WALL/DUCT	WHITE	STEEL	A
SG-2	PRICE	SDGE	SPIRAL MOUNT	AS NOTED	DUCT	MILL	STEEL	A, C
RG-1	PRICE	PDDR	PERFORATED	24" x 24"	LAY-IN	WHITE	STEEL	
RG-2	PRICE	PDDR	PERFORATED	12" x 24"	LAY-IN	WHITE	STEEL	
RG-3	PRICE	530DL	WALL MOUNT	AS NOTED	WALL/DUCT	WHITE	STEEL	
EX-1	PRICE	APDDR	PERFORATED	24" x 24"	SURFACE	WHITE	ALUMINUM	A, B
EX-2	PRICE	APDDR	PERFORATED	24" x 24"	LAY-IN	WHITE	ALUMINUM	
EX-3	PRICE	APDDR	PERFORATED	12" x 12"	LAY-IN	WHITE	ALUMINUM	


NOTES:

- PROVIDE WITH DAMPER OPERABLE FROM FACE OF DEVICE.
- PROVIDE WITH SURFACE MOUNT FRAME KIT FOR MOUNTING IN HARD CEILING/WALL.
- PROVIDE WITH CLOSED BLADE DAMPER AND MILL FINISH.
- PERFORATED SUPPLY AIR GRILLE TO BE INSTALLED WITHOUT DEFLECTORS.
- PROVIDE WITH 2KW ELECTRIC HEAT, WALL MOUNTED WIRELESS THERMOSTAT.
- PROVIDE WITH RETURN AIR LIGHT SHIELD.
- PROVIDE WITH INSULATED BACKING
- PROVIDE WITH FACTORY INSULATED SUPPLY PLENUM.

MARK	MANUFACTURER	QUANTITY	MODEL	LOCATION/ MOUNTING	SERVICE	FAN				ELECTRICAL (V/PH)	WEIGHT (LBS)	NOTES
						CFM	ESP (IN)	RPM	HP/WATTS			
EF-A	GREENHECK	1	G-099	ROOF	RESTROOM EXHAUST	800	0.5	1435	1/4	120/1	100	A, B, E
EF-B	GREENHECK	3	GB-130	ROOF	BATTERY EXHAUST	2,000	0.5	1600	3/4	120/1	120	A, B, C, J
CEF-1	GREENHECK	2	SPA-190	CEILING	RESTROOM EXHAUST	150	0.25	800	50	120/1	25	A, E, H
CEF-2	GREENHECK	1	SPA-090	CEILING	RESTROOM EXHAUST	75	0.25	800	50	120/1	25	A, E, H

NOTES:

- PROVIDE FACTORY MOUNTED DISCONNECT SWITCH.
- PROVIDE WITH 14" INSULATED ROOF CURB, BACKDRAFT DAMPER AND INSECT SCREEN.
- FAN TO RUN CONTINUOUSLY.
- FURNISH WITH WALL MOUNTED LINE VOLTAGE THERMOSTAT. THERMOSTAT TO BE INSTALLED BY ELECTRICAL CONTRACTOR.
- INTERLOCK EXHAUST FAN WITH LIGHTS SWITCH.
- FAN TO BE CONTROLLED BY WALL MOUNTED SWITCH.
- PROVIDE WITH REQUIRED ACCESSORIES FOR GREASE EXHAUST. FAN TO BE CONTROLLED BY HOOD MOUNTED SWITCH.
- PROVIDE WITH UNIT MOUNTED SPEED CONTROLLER, HANGING BRACKET, BACKDRAFT DAMPER AND INLET GUARD.
- FAN TO BE EXPLOSION PROOF.

			
<p>THIS PRINT IS CONFIDENTIAL TO METRO AIR CONDITIONING CO.          REPRODUCTION OR DISCLOSURE TO OUTSIDE PARTIES IS          PROHIBITED WITHOUT OUR WRITTEN CONSENT.          © 2022 METRO AIR CONDITIONING CO.</p>			
<p>LSCC BLDG. #1 — TI</p>			
<p>LEE'S SUMMIT, MO</p>			
SCALE: AS NOTED	DATE: 9/6/22	DRAWN BY: M.D.K.	
APPROVED BY: JDG	DWG #	M5	
PERMIT DWGS.		of 5	

THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY  
OF CURRAN ARCHITECTURE, AND ARE NOT  
TO BE USED OR REPRODUCED, WHOLE OR  
IN PART, WITHOUT THE WRITTEN  
CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

## PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT 1

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086




## ISSUE DATES

PERMIT SET 04.21.22

210300

M3.1



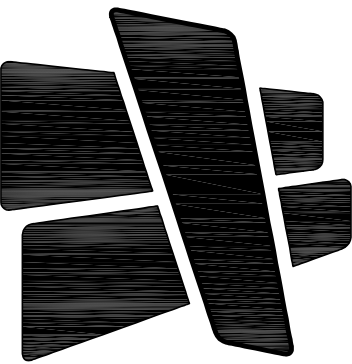


# CURRAN ARCHITECTURE

5719 LAWTON LOOP E. DR. #212

INDIANAPOLIS, IN 46216

O :: 317.288.0681

F :: 317.288.0753



# SCANNELL PROPERTIES

8/31/2022



## LEE'S SUMMIT LOGISTICS BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

PERMIT SET 08.31.22

210300

PLUMBING  
SPECIFICATIONS

P.O.0

## PLUMBING SPECIFICATIONS

1. GENERAL PROVISIONS:
  - A. PROVIDE ALL LABOR, MATERIALS, EQUIPMENT, NECESSARY FOR THE COMPLETE INSTALLATION OF THE PLUMBING AND MECHANICAL SYSTEMS OUTLINED.
  - B. OBTAIN ALL PERMITS, FEES, LICENSES, INSPECTIONS, AND CERTIFICATES OF COMPLIANCE OR APPROVAL AS REQUIRED BY THE AUTHORITIES.
  - C. ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH ALL APPLICABLE LAWS, CODES AND REGULATIONS OF THE GOVERNMENTAL BODIES HAVING JURISDICTION OVER THE SITE.
  - D. ALL TESTING REQUIRED BY AUTHORITIES SHALL BE CONSIDERED PART OF THIS WORK.
  - E. DURING CONSTRUCTION, ALL FIXTURES, EQUIPMENT, PIPE, DUCT, ETC. SHALL BE COVERED, PLUGGED, OR CAPPED AS REQUIRED TO KEEP CLEAN AND UNDAMAGED; ALL DAMAGED ITEMS SHALL BE RESTORED TO ORIGINAL CONDITION OR REPLACED; ALL PROTECTIVE COVERINGS SHALL BE REMOVED BEFORE FINAL ACCEPTANCE.
  - F. PROVIDE ALL NECESSARY CUTTING AND PATCHING OF WALLS, FLOORS, CEILINGSS, AND ROOFS AS NECESSARY; IF ANY WORK SHALL MAINTAIN OR IMPROVE THE EXISTING ROOFING WARRANTY SHALL BE MAINTAINED.
  - G. CONTRACTOR SHALL GUARANTEE ALL WORK AND MATERIALS AGAINST DEFECTS FOR A PERIOD OF ONE YEAR FROM FINAL ACCEPTANCE.
2. OPERATION AND MAINTENANCE MANUALS:
  - A. DURING THE COURSE OF CONSTRUCTION, COLLECT AND COMPIL OPERATING INSTRUCTIONS, WIRING DIAGRAMS, CATALOG CUTS, LUBRICATION AND PREVENTIVE MAINTENANCE INSTRUCTIONS, PARTS LISTS, ETC. FOR ALL EQUIPMENT FURNISHED UNDER THIS CONTRACT.
  - B. ALL LITERATURE AND INSTRUCTIONS SHIPPED WITH THE EQUIPMENT SHALL BE SAVED FOR INCLUSION IN THE OPERATION AND MAINTENANCE MANUALS.
  - C. ALL LITERATURE LISTED ABOVE AND ALL PAPERS LISTING WARRANTIES, ETC. SHALL BE BOUND IN A 3-RING BINDER AND LABELED WITH THE PROJECT NAME, ADDRESS, ARCHITECT, ENGINEER, CONTRACTORS, ETC.
3. MANUFACTURERS:
  - A. MANUFACTURERS, MODEL NUMBERS, ETC. INDICATED OR SCHEDULED ON THE DRAWINGS SHALL BE INTERPRETED AS HAVING ESTABLISHED A STANDARD OF QUALITY AND SHALL NOT BE CONSTRUED AS LIMITING COMPETITORS, ETC. OF EQUAL QUALITY BY MANUFACTURERS SHALL BE ACCEPTABLE, SUBJECT TO STRUCTURAL AND ELECTRICAL CONSTRAINTS OF THE PROJECT DESIGN, UNLESS NOTED OTHERWISE.
4. TESTING, BALANCING, AND CLEANING:
  - A. ALL PIPING SHALL BE TESTED FOR LEAKS BEFORE BEING CONCEALED IN WALL CONSTRUCTION OR COVERED WITH INSULATION.
  - B. SEWER AND VENT PIPING SHALL BE HYDROSTATICALLY TESTED WITH NO LESS THAN 10 FEET OF HEAD FOR A PERIOD OF NOT LESS THAN 15 MINUTES, PER THE LOCAL PLUMBING CODE, WITH NO LEAKS.
  - C. DOMESTIC WATER PIPING SHALL BE HYDROSTATICALLY TESTED AT A PRESSURE OF NOT LESS THAN 1-1/2 TIMES THE OPERATING PRESSURE, BUT NOT LESS THAN 60 PSI, FOR A PERIOD OF NOT LESS THAN 2 HOURS, WITH NO LEAKS.
  - D. NATURAL GAS PIPING SHALL BE PNEUMATICALLY TESTED AT A PRESSURE OF NOT LESS THAN 1-1/2 TIMES THE OPERATING PRESSURE, BUT NOT LESS THAN 50 PSI, FOR A PERIOD OF NOT LESS THAN 2 HOURS, WITH NO LEAKS.
  - E. BEFORE DOMESTIC WATER PIPING IS PLACED IN SERVICE, ALL DOMESTIC WATER DISTRIBUTION SYSTEMS, INCLUDING THOSE FOR COLD WATER AND HOT WATER SYSTEMS, SHALL BE FLUSHED, STERILIZED AND CHLORINATED IN ACCORDANCE WITH HEALTH DEPARTMENT REGULATIONS. THE SYSTEMS SHALL BE THOROUGHLY FLUSHED OF ALL DIRT AND FOREIGN MATTER, THEN FILLED WITH WATER TREATED WITH 50 PPM OF CHLORINE PROCESS. VALVE SEVER, HUB AND FAUCETS SHALL BE OPENED SEVERAL TIMES TO ASSURE TREATMENT OF THE ENTIRE SYSTEM. THE TREATED WATER SHALL BE LEFT IN THE SYSTEM FOR 24 HOURS AFTER WHICH TIME THE SYSTEM SHALL BE FLUSHED; IF THE RESIDUAL CHLORINE IS NOT LESS THAN 10 PPM, THE FLUSHING SHALL BE REPEATED. IF NEER STERILIZATION, SAMPLES OF WATER IN THE SYSTEM SHALL BE APPROVED BY THE BOARD OF HEALTH.
5. PLUMBING:
  - A. PROVIDE AN APPROVED WATER HAMMER ARRESTOR FOR EACH PLUMBING FIXTURE SUPPLY AS REQUIRED BY FIXTURE MANUFACTURER.
  - B. ALL EXPOSED WASTE PIPE SHALL BE CHROME PLATED BRASS PIPE, NO FERROUS PIPE.
  - C. PROVIDE CLEANOUTS AT EACH CHANGE OF DIRECTION AND AT 100 FOOT INTERVALS IN STRAIGHT RUNS.
  - D. PROVIDE ACCESS PANELS FOR ALL CONCEALED VALVES AND TRAPS.
  - E. CLEANOUTS:
    - 1) VINYL TILE FLOOR: JR SMITH #4140, OR EQUAL.
    - 2) QUARRY TILE FLOOR: JR SMITH #4200, OR EQUAL.
    - 3) CARPETED FLOOR: JR SMITH #4020-Y, OR EQUAL.
    - 4) UNFINISHED FLOOR: JR SMITH #4020, OR EQUAL.
    - 5) WALL: JR SMITH #4472, OR EQUAL, 24" ABOVE THE FLOOR.
    - 6) WAREHOUSE FLOORS/FORK TRUCK AREAS: JR SMITH #4100, OR EQUAL, WITH HEAVY DUTY CAST IRON BODY AND ROUND ADJUSTABLE SCREWED EXTRA HEAVY DUTY NICKEL BRONZE TOP.
    - 7) GRADE: JR SMITH #4256, OR EQUAL, WITH HEAVY DUTY CAST IRON BODY AND COVER.
  - F. PROVIDE DIELECTRIC UNIONS WITH APPROPRIATE END CONNECTIONS TO MATCH THE PIPE SYSTEM IN WHICH INSTALLED, OR FLANGED; PROVIDE DIELECTRIC UNIONS ON ALL PIPING CONNECTIONS TO HOT WATER HEATERS AND EXPANSION TANKS.
  - G. WATER HEATERS:
    - 1) EVERY WATER HEATER SHALL HAVE AN APPROVED MEANS INSTALLED ON THE COLD WATER SUPPLY LINE ABOVE THE EQUIPMENT TO PREVENT SIPHONING OF A STORAGE WATER HEATER OR TANK.
    - 2) BOTTOM FED WATER HEATERS AND TANKS CONNECT TO WATER HEATERS SHALL HAVE A VACUUM RELIEF VALVE INSTALLED, ANSI #21.22.
    - 3) STORAGE HEATERS OPERATING ABOVE ATMOSPHERIC PRESSURE SHALL HAVE AN APPROVED PRESSURE RELIEF VALVE AND/OR TEMPERATURE RELIEF VALVE.
  - H. ALL SEWER PIPING LOCATED INSIDE THE BUILDING SHALL BE INSTALLED WITH THE FOLLOWING SLOPES:
    - 1) INSTALL 2-1/2" AND SMALLER PIPE AT 1/4" PER FOOT FALL.
    - 2) INSTALL 3" - 6" PIPE AT 1/8" PER FOOT FALL.
    - 3) INSTALL 8" AND LARGER PIPE AT 1/16" PER FOOT FALL.
6. PIPING:
  - A. DOMESTIC COLD, HOT, AND HOT WATER RECIRCULATING (ABOVEGROUND).
    - 1) TYPE L HARD DRAWN COPPER TUBING, ASTM B-88.
    - a) WROUGHT COPPER SOLDERED FITTINGS, ASTM B75 ALLOY C12200, ANSI B16.22, MSS SP-104.
    - b) MECHANICAL PRESS COPPER FITTINGS FOR USE IN PLUMBING OR MECHANICAL APPLICATIONS, ASME B16.22, ASME B16.51, OR ASME B16.18. MECHANICAL PRESS COPPER FITTINGS SHALL CONFORM TO APMO PS-117 OR ASME B16.51.
    - 2) PEK HIGH-DENSITY CROSS-LINKED POLYETHYLENE TUBING SHALL BE MANUFACTURED TO THE REQUIREMENTS OF ASTM F876 AND MEET THE STANDARD GRADE HYDROSTATIC PRESSURE RATINGS FROM PLASTIC PIPE INSTITUTE IN ACCORDANCE WITH TR-4/03.
    - a) PEK-A AND PEK-B MEETINGS ANSI/NSF 61 AND ANSI/NSF 372 STANDARDS FOR POTABLE WATER SAFETY AND LEAD-FREE STANDARDS AND MUST BE MARKED WITH "PW-6", "NSF-61-6", OR OTHER NSF-APPROVED MARKINGS, ASTM F2023 FOR USE WITH CHLORINATED WATER.
    - b) PEK MECHANICAL, CRIMP/INSERT OR EXPANSION FITTINGS INSTALLED IN ACCORDANCE WITH MANUFACTURERS INSTRUCTIONS. PIPE SIZES GIVEN ON THE DRAWINGS ARE NOMINAL COPPER PIPE SIZE. INCREASE PEK PIPING SIZE TO EQUAL OR EXCEED COPPER PIPE INSIDE DIAMETER FOR SUPPLY MAINS. (MUST BE INSTALLED PER THE MANUFACTURERS REQUIREMENTS FOR FLENUM USE)
    - 3) VALVES:
      - a) TO BE INSTALLED ON THE FIXTURE SUPPLY TO EACH PLUMBING FIXTURE.
      - b) TO BE INSTALLED ON THE WATER SUPPLY SIDE TO EACH APPLIANCE OR MECHANICAL EQUIPMENT.
      - c) TYPES:
        1. GATE VALVE: JOMAR T-5-3015 OR EQUAL, LEAD-FREE NSF 61, ANSI B1.20.1.
        2. GLOBE VALVE: JOMAR T-55 OR EQUAL.
        3. BALL VALVE: JOMAR JF100P-R OR EQUAL, COMPACT LEAD FREE BRASS BALL VALVE, UL842, CSA B371-12 & B371-12, FM, CALIFORNIA CODE AB195, NSF61, ANEX 5 APPROVED.
        4. BALL VALVE: JOMAR T-100NE OR EQUAL, UL842, FM, CSA, NSF 61-8, MSS SP-110.
  - B. DOMESTIC COLD, AND HOT WATER (UNDERGROUND).
    - 1) TYPE L HARD DRAWN COPPER TUBING, ASTM B-88.
    - a) WROUGHT COPPER SOLDERED FITTINGS, ASTM B75 ALLOY C12200, ANSI B16.22, MSS SP-104.
    - b) MECHANICAL PRESS COPPER FITTINGS FOR USE IN PLUMBING OR MECHANICAL APPLICATIONS, ASME B16.22, ASME B16.51, OR ASME B16.18. MECHANICAL PRESS COPPER FITTINGS SHALL CONFORM TO APMO PS-117 OR ASME B16.51.
    - 2) PEK HIGH-DENSITY CROSS-LINKED POLYETHYLENE TUBING SHALL BE MANUFACTURED TO THE REQUIREMENTS OF ASTM F876 AND MEET THE STANDARD GRADE HYDROSTATIC PRESSURE RATINGS FROM PLASTIC PIPE INSTITUTE IN ACCORDANCE WITH TR-4/03.
    - a) PEK-A AND PEK-B MEETINGS ANSI/NSF 61 AND ANSI/NSF 372 STANDARDS FOR POTABLE WATER SAFETY AND LEAD-FREE STANDARDS AND MUST BE MARKED WITH "PW-6", "NSF-61-6", OR OTHER NSF-APPROVED MARKINGS, ASTM F2023 FOR USE WITH CHLORINATED WATER.
    - b) PEK MECHANICAL, CRIMP/INSERT OR EXPANSION FITTINGS INSTALLED IN ACCORDANCE WITH MANUFACTURERS INSTRUCTIONS. PIPE SIZES GIVEN ON THE DRAWINGS ARE NOMINAL COPPER PIPE SIZE. INCREASE PEK PIPING SIZE TO EQUAL OR EXCEED COPPER PIPE INSIDE DIAMETER FOR SUPPLY MAINS.
    - c) HDPE, PIGMENTED BLUE THROUGHOUT, CTS SIZES 1"-2" ANVVA C401 4710 DR4 PC250 IPS SIZES 2"-3", ANVVA C401 4710 DR11 PC200.
  - C. DOMESTIC WATER SERVICE, 1"-3"
    - 1) TYPE K SOFT DRAWN COPPER TUBING, ASTM B-88.
    - a) Cast Copper Alloy Fittings for Flared Copper Tube, ASME/ANSI B16.26.
    - 2) HDPE, PIGMENTED BLUE THROUGHOUT, CTS SIZES 1"-2" ANVVA C401 4710 DR4 PC250 IPS SIZES 2"-3", ANVVA C401 4710 DR11 PC200 MATERIAL AND INSTALLATION MUST CONFORM TO WATER DEPARTMENT REQUIREMENTS.
  - D. LEAD CONTENT OF WATER SUPPLY PIPE AND FITTINGS:
    - 1) PIPE AND PIPE FITTINGS, INCLUDING VALVES AND FAUCETS, UTILIZED IN THE WATER SUPPLY SYSTEM SHALL NOT HAVE MORE THAN 8% LEAD CONTENT.
    - 2) PIPE, PIPE FITTINGS, JOINTS, VALVES, FAUCETS, AND FIXTURE FITTINGS UTILIZED TO SUPPLY WATER FOR DRINKING OR COOKING PURPOSES SHALL COMPLY WITH NSF 372 AND SHALL HAVE A WEIGHTED AVERAGE LEAD CONTENT OF 0.25% OR LESS.

## PLUMBING SPECIFICATIONS (CONTINUED)

- E. STORM SEWER, SANITARY SEWER, GREASE WASTE, SAND OIL WASTE, AND VENTS (UNDERGROUND, INTERIOR TO THE BUILDING).
  - 1) ABS SCHEDULE 40 CELLULAR GORE (FOAM GORE) PIPE AND DNV FITTING SYSTEM (ASTM F1488) PIPE AND FITTINGS SHALL BE MANUFACTURED FROM ABS COMPOUND WITH A CELL CLASS OF 42222 FOR PIPE AND 32222 FOR FITTINGS AS PER ASTM D 2685 AND CONFORM WITH NATIONAL SANITATION FOUNDATION (NSF) STANDARD 14. PIPE SHALL BE IRON PIPE SIZE (IPS) CONFORMING TO ASTM F 620. FITTINGS SHALL CONFORM TO ASTM D 2661. SOLVENT CEMENTS SHALL CONFORM TO ASTM D 2235.
  - 2) PVC SCHEDULE 40 CELLULAR GORE (FOAM GORE) PIPE AND DNV FITTING SYSTEM (ASTM F1488) PIPE AND FITTINGS SHALL BE MANUFACTURED FROM PVC COMPOUND WITH A CELL CLASS OF 11432 PER ASTM D 4346 FOR PIPE AND 12454 PER ASTM D 1184 FOR FITTINGS AND CONFORM WITH NATIONAL SANITATION FOUNDATION (NSF) STANDARD 14. PIPE SHALL BE IRON PIPE SIZE (IPS) CONFORMING TO ASTM F 641. INJECTION MOLDED FITTINGS SHALL CONFORM TO ASTM D 2665. FABRICATED FITTINGS SHALL CONFORM TO ASTM F 1866. SOLVENT CEMENTS SHALL CONFORM TO ASTM D 2564.
  - 3) PVC SCHEDULE 40 SOLID WALL PIPE AND DNV FITTING SYSTEM (ASTM D2665) PIPE AND FITTINGS SHALL BE MANUFACTURED FROM PVC COMPOUND WITH A CELL CLASS OF 12454 PER ASTM D 1184 AND CONFORM WITH NATIONAL SANITATION FOUNDATION (NSF) STANDARD 14. PIPE SHALL BE IRON PIPE SIZE (IPS) CONFORMING TO ASTM D 1185 AND ASTM D 2665. INJECTION MOLDED FITTINGS SHALL CONFORM TO ASTM D 2665. FABRICATED FITTINGS SHALL CONFORM TO ASTM F 1866. SOLVENT CEMENTS SHALL CONFORM TO ASTM D 2564. (WHERE APPROVED BY LOCAL JURISDICTIONS) (NOT FOR USE IN A RETURN AIR FLENUM)
  - 4) HUBLESS CAST IRON SOIL PIPE AND FITTINGS: HUBLESS CAST IRON PIPE AND FITTINGS SHALL BE MANUFACTURED FROM GRAY CAST IRON AND SHALL CONFORM TO ASTM A 889 AND CSPI STANDARD 301. HUBLESS COUPLINGS SHALL CONFORM TO CSPI STANDARD 310 AND BE CERTIFIED BY NSF INTERNATIONAL.
  - 5) HUB AND SPIGOT CAST IRON SOIL PIPE AND FITTINGS: HUB AND SPIGOT CAST IRON PIPE AND FITTINGS SHALL BE MANUFACTURED FROM GRAY CAST IRON AND SHALL CONFORM TO ASTM A 74.
- F. STORM SEWER, SANITARY SEWER, GREASE WASTE, SAND OIL WASTE, AND VENTS (ABOVE GROUND, INTERIOR TO THE BUILDING).
  - 1) ABS SCHEDULE 40 CELLULAR GORE (FOAM GORE) PIPE AND DNV FITTING SYSTEM (ASTM F1488) PIPE AND FITTINGS SHALL BE MANUFACTURED FROM ABS COMPOUND WITH A CELL CLASS OF 42222 FOR PIPE AND 32222 FOR FITTINGS AS PER ASTM D 2685 AND CONFORM WITH NATIONAL SANITATION FOUNDATION (NSF) STANDARD 14. PIPE SHALL BE IRON PIPE SIZE (IPS) CONFORMING TO ASTM F 620. FITTINGS SHALL CONFORM TO ASTM D 2661. SOLVENT CEMENTS SHALL CONFORM TO ASTM D 2235. (NOT FOR USE IN A RETURN AIR FLENUM)
  - 2) PVC SCHEDULE 40 CELLULAR GORE (FOAM GORE) PIPE AND DNV FITTING SYSTEM (ASTM F1488) PIPE AND FITTINGS SHALL BE MANUFACTURED FROM PVC COMPOUND WITH A CELL CLASS OF 11432 PER ASTM D 4346 FOR PIPE AND 12454 PER ASTM D 1184 FOR FITTINGS AND CONFORM WITH NATIONAL SANITATION FOUNDATION (NSF) STANDARD 14. PIPE SHALL BE IRON PIPE SIZE (IPS) CONFORMING TO ASTM F 641. INJECTION MOLDED FITTINGS SHALL CONFORM TO ASTM D 2665. FABRICATED FITTINGS SHALL CONFORM TO ASTM F 1866. SOLVENT CEMENTS SHALL CONFORM TO ASTM D 2564. (WHERE APPROVED BY LOCAL JURISDICTIONS) (NOT FOR USE IN A RETURN AIR FLENUM)
  - 3) PVC SCHEDULE 40 SOLID WALL PIPE AND DNV FITTING SYSTEM (ASTM D 2665) PIPE AND FITTINGS SHALL BE MANUFACTURED FROM PVC COMPOUND WITH A CELL CLASS OF 12454 PER ASTM D 1184 AND CONFORM WITH NATIONAL SANITATION FOUNDATION (NSF) STANDARD 14. PIPE SHALL BE IRON PIPE SIZE (IPS) CONFORMING TO ASTM D 1185 AND ASTM D 2665. INJECTION MOLDED FITTINGS SHALL CONFORM TO ASTM D 2665. FABRICATED FITTINGS SHALL CONFORM TO ASTM F 1866. SOLVENT CEMENTS SHALL CONFORM TO ASTM D 2564. (WHERE APPROVED BY LOCAL JURISDICTIONS) (NOT FOR USE IN A RETURN AIR FLENUM)
  - 4) HUBLESS CAST IRON SOIL PIPE AND FITTINGS: HUBLESS CAST IRON PIPE AND FITTINGS SHALL BE MANUFACTURED FROM GRAY CAST IRON AND SHALL CONFORM TO ASTM A 889 AND CSPI STANDARD 301. HUBLESS COUPLINGS SHALL CONFORM TO CSPI STANDARD 310 AND BE CERTIFIED BY NSF INTERNATIONAL.
  - 5) HUB AND SPIGOT CAST IRON SOIL PIPE AND FITTINGS: HUB AND SPIGOT CAST IRON PIPE AND FITTINGS SHALL BE MANUFACTURED FROM GRAY CAST IRON AND SHALL CONFORM TO ASTM A 74.
- G. STORM SEWER, SANITARY SEWER, GREASE WASTE, SAND OIL WASTE, AND VENTS (UNDERGROUND, EXTERIOR TO THE BUILDING).
  - 1) ABS SCHEDULE 40 CELLULAR GORE (FOAM GORE) PIPE AND DNV FITTING SYSTEM (ASTM F1488) PIPE AND FITTINGS SHALL BE MANUFACTURED FROM ABS COMPOUND WITH A CELL CLASS OF 42222 FOR PIPE AND 32222 FOR FITTINGS AS PER ASTM D 2685 AND CONFORM WITH NATIONAL SANITATION FOUNDATION (NSF) STANDARD 14. PIPE SHALL BE IRON PIPE SIZE (IPS) CONFORMING TO ASTM F 620. FITTINGS SHALL CONFORM TO ASTM D 2661. SOLVENT CEMENTS SHALL CONFORM TO ASTM D 2235.
  - 2) PVC SCHEDULE 40 CELLULAR GORE (FOAM GORE) PIPE AND DNV FITTING SYSTEM (ASTM F1488) PIPE AND FITTINGS SHALL BE MANUFACTURED FROM PVC COMPOUND WITH A CELL CLASS OF 11432 PER ASTM D 4346 FOR PIPE AND 12454 PER ASTM D 1184 FOR FITTINGS AND CONFORM WITH NATIONAL SANITATION FOUNDATION (NSF) STANDARD 14. PIPE SHALL BE IRON PIPE SIZE (IPS) CONFORMING TO ASTM F 641. INJECTION MOLDED FITTINGS SHALL CONFORM TO ASTM D 2665. FABRICATED FITTINGS SHALL CONFORM TO ASTM F 1866. SOLVENT CEMENTS SHALL CONFORM TO ASTM D 2564.
  - 3) PVC SCHEDULE 40 SOLID WALL PIPE AND DNV FITTING SYSTEM (ASTM D 2665) PIPE AND FITTINGS SHALL BE MANUFACTURED FROM PVC COMPOUND WITH A CELL CLASS OF 12454 PER ASTM D 1184 AND CONFORM WITH NATIONAL SANITATION FOUNDATION (NSF) STANDARD 14. PIPE SHALL BE IRON PIPE SIZE (IPS) CONFORMING TO ASTM F 794. FITTINGS SHALL CONFORM TO ASTM F 794. SOLVENT CEMENTS SHALL CONFORM TO ASTM D 2564.
  - 4) HUBLESS CAST IRON SOIL PIPE AND FITTINGS: HUBLESS CAST IRON PIPE AND FITTINGS SHALL BE MANUFACTURED FROM GRAY CAST IRON AND SHALL CONFORM TO ASTM A 889 AND CSPI STANDARD 301. HUBLESS COUPLINGS SHALL CONFORM TO CSPI STANDARD 310 AND BE CERTIFIED BY NSF INTERNATIONAL.
  - 5) HUB AND SPIGOT CAST IRON SOIL PIPE AND FITTINGS: HUB AND SPIGOT CAST IRON PIPE AND FITTINGS SHALL BE MANUFACTURED FROM GRAY CAST IRON AND SHALL CONFORM TO ASTM A 74.
  - 6) COPPER DNV, DRAINAGE TUBES SHALL CONFORM TO ASTM B368. WROUGHT COPPER FITTINGS, ANSI B16-24.
  - 7) GALVANIZED STEEL PIPE, WITH MALLEABLE IRON, THREADED FITTINGS, DRAINAGE PATTERN FOR SEWERS SHALL CONFORM TO ASTM A 53.
- H. NATURAL GAS.
  - 1) BLACK STEEL PIPE, SCHEDULE 40, ASTM A53.
  - a) PIPE 3" AND SMALLER, 150 LB. MALLEABLE IRON, THREADED FITTINGS.
  - b) PIPE 4" AND SMALLER: VEGA MEGAPRESS G FOR WATER AND GAS, CSA C64, T56A/ASME B31 FOR USE WITH ASTM A53 SCHEDULE 40 BLACK IRON PIPE.
  - c) PIPE 2-1/2" AND LARGER, MELDED.
  - d) PLUS VALVE: ROCKWELL NORDSTROM FIGURE NO. 142 OR 143.
  - e) BALL VALVE: JOMAR T-100NE APPROVALS- UL842, FM, CSA, NSF 61-8, MSS SP-110.
  - 2) GAS PIPING LABELING:
    - a) ALL ELEVATED PRESSURE GAS PIPING SHALL BE LABELED EVERY 40 FEET WITH SIGNS INDICATING "ELEVATED PRESSURE".
  - 3) GAS PIPING PAINTING:
    - a) ALL BLACK STEEL GAS PIPING LOCATED EXTERIOR TO THE BUILDING SHALL BE PRIMED AND PAINTED TO EITHER MATCH ADJACENT EXTERIOR WHERE LOCATED ON OR NEAR EXTERIOR WALL AND PAINTED SAFETY YELLOW WHERE LOCATED ON THE ROOF.
- I. ALL PIPE HANGERS AND SUPPORTS SHALL BE STANDARD PRODUCTS OF GRINNELL, FEE AND MASON, OR ELGEN. HANGER SPACING SHALL BE IN ACCORDANCE WITH MSS-SP-68.
- J. SLEEVES
  - 1) PROVIDE, SET, AND PROPERLY LOCATE PIPE SLEEVES AS REQUIRED FOR THIS WORK. ALL SLEEVES SHALL BE OF SUFFICIENT SIZE TO PERMIT PIPE MOVEMENT DUE TO EXPANSION AND CONTRACTION AND TO ACCOMMODATE PIPE INSULATION.
  - 2) INTERIOR PARTITIONS: 16 GAGE GALVANIZED STEEL, PACK BETWEEN PIPE AND SLEEVE WITH FIRE RATING AND CAULK AT EACH END WITH FIRE RESISTANT SEALANT.
  - 3) ROOF: PROSET OR EQUAL, MANUFACTURED PVC SCHEDULE 40 PIPE SLEEVE WITH WATERPROOF SEAL COORDINATE WITH ROOFING CONTRACTOR AND FLASH AS REQUIRED TO MAINTAIN ROOF WARRANTY.
  - 4) PROTECTION AGAINST CONTACT: METALLIC PIPING, EXCEPT FOR CAST IRON, DUCTILE IRON AND GALVANIZED STEEL SHALL NOT BE PLACED IN DIRECT CONTACT WITH STEEL FRAMING MEMBERS, CONCRETE, OR OTHER WALLS AND FLOORS OR OTHER MASONRY. METALLIC PIPING SHALL NOT BE PLACED IN DIRECT CONTACT WITH CORROSIIVE SOIL. SHEATHING USED TO PREVENT DIRECT CONTACT SHALL HAVE A THICKNESS OF GREATER THAN .005, AND THE SHEATHING SHALL BE MADE OF PLASTIC. ANY PIPE THAT PASSES THROUGH A FOUNDATION WALL OR FOOTING SHALL BE PROVIDED WITH A RELIEVING ARCH, OR A PIPE SLEEVE SHALL BE BUILT INTO THE FOUNDATION WALL. THE SLEEVE SHALL BE TWO SIZES GREATER THAN THE PIPE PASSING THOUGH THE WALL OR FOOTING.
  - 5) PLUMBING VENTS: FLASH ROOF VENT INTO ROOFING SYSTEM AS REQUIRED BY THE ROOFING CONTRACTOR TO MAINTAIN EXISTING ROOF WARRANTY. ALL PLUMBING VENT TERMINALS SHALL TERMINATE A MINIMUM OF 12" ABOVE ROOF OR EQUAL TO HEIGHT OF PARAPET, WHICHEVER IS GREATER.
- K. COMPRESSED AIR PIPING
  - 1) PARKER TRANSAIR PIPING, EXTRUDED ALUMINUM PIPE, CONFORMS TO ASTM B241.
  - a) PARKER TRANSAIR FITTINGS CONFORMING TO UL54HB.
  - 2) PARKER TRANSAIR MOUNTING CLIPS, CONFORMING TO UL94V-2.
  - 2) TYPE L HARD DRAWN COPPER TUBING, ASTM B-88.
  - a) WROUGHT BRONZE SOLDERED FITTINGS.
- L. WATER HEATERS
  - A. COMMERCIAL, LIGHT-DUTY, STORAGE, ELECTRIC, DOMESTIC-WATER HEATERS:
    1. STANDARD: UL 174.
    2. STORAGE-TANK CONSTRUCTION: STEEL, VERTICAL ARRANGEMENT.
    - a. PRESSURE RATING: 150 PSIG.
    - b. INTERIOR FINISH: COMPLY WITH NSF 61 AND NSF 372 BARRIER MATERIALS FOR POTABLE WATER TANK LININGS, INCLUDING EXTENDING LINING MATERIAL INTO TAPPINGS.
    3. FACTORY-INSTALLED, STORAGE-TANK APPURTENANCES:
      - a. ANODE ROD: REPLACEABLE MAGNESIUM.
      - b. DIP TUBE: REQUIRED UNLESS COLD-WATER INLET IS NEAR BOTTOM OF TANK.
      - c. DRAIN VALVE: CORROSION-RESISTANT METAL WITH HOSE-END CONNECTION.
      - d. INSULATION: COMPLY WITH ASHRAE/IES 90.1.
      - e. JACKET: STEEL WITH ENAMELED FINISH OR HIGH-IMPACT COMPOSITE MATERIAL.
      - f. HEAT-TRAP FITTINGS: INLET TYPE IN COLD-WATER INLET AND OUTLET TYPE IN HOT-WATER OUTLET.
      - g. HEATING ELEMENTS: ELECTRIC, BORE-IN IMMERSION TYPE.
      - h. TEMPERATURE CONTROL: ADJUSTABLE THERMOSTAT.
      - i. SAFETY CONTROL: HIGH-TEMPERATURE-LIMIT CUTOFF DEVICE OR SYSTEM.
      - j. RELIEF VALVE: ASME RATED AND STAMPED FOR COMBINATION TEMPERATURE-AND-PRESSURE RELIEF VALVES, INCLUDE RELIEVING CAPACITY AT LEAST AS GREAT AS HEAT INPUT, AND INCLUDE PRESSURE SETTING LESS THAN WORKING-PRESSURE RATING OF DOMESTIC-WATER HEATER. SELECT RELIEF VALVE WITH SENSING ELEMENT THAT EXTENDS INTO STORAGE TANK.
  - B. DOMESTIC-WATER EXPANSION TANKS:
    1. DESCRIPTION: STEEL, PRESSURE-RATED TANK CONSTRUCTED WITH WELDED JOINTS AND FACTORY-INSTALLED BUTYL-RUBBER DIAPHRAGM. INCLUDE AIR PRECHARGE TO MINIMUM SYSTEM-OPERATING PRESSURE AT TANK.
    2. CONSTRUCTION:
      - a. TAPPINGS: FACTORY-FABRICATED STEEL, WELDED TO TANK BEFORE TESTING AND LABELING. INCLUDE ASME B1.20.1 PIPE THREAD.
      - b. INTERIOR FINISH: COMPLY WITH NSF 61 AND NSF 372 BARRIER MATERIALS FOR POTABLE-WATER TANK LININGS, INCLUDING EXTENDING FINISH INTO AND THROUGH TANK FITTINGS AND OUTLETS.
      - c. AIR-CHARGING VALVE: FACTORY INSTALLED.
    3. CAPACITY AND CHARACTERISTICS:
      - a. WORKING-PRESSURE RATING: 150 PSIG.

**CENTRAL**  
PLUMBING, HEATING & AIR CONDITIONING, INC.  
201 East Walnut  
Cleveland, MO 64734  
816-942-6355

BC PROJECT #22208  
MISSOURI PE COA #2009003629

This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on the project only. Pursuant to the Architecture-Engine Cooperation and Registration Act of 1980, all drawings, specifications, plans and designs, including the work of the Designer/Engineer and his employees and independent consultants, shall remain the property of the Designer/Engineer. Any reproduction, use or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2022 BC Engineers, Inc.

**BC ENGINEERS  
INCORPORATED**

5720 Reeder Shawnee, KS 66203 (913)262-1772



PLUMBING GENERAL NOTES:

1. INSTALL ALL PIPE, ETC. AS HIGH AS POSSIBLE.
2. COORDINATE ALL WORK WITH OTHER TRADES AND EXISTING CONDITIONS AS REQUIRED TO PROPERLY INSTALL ALL SYSTEMS AS INTENDED, WITHIN THE CONFINES OF THE SPACES AVAILABLE, AND WITHOUT INTERFERENCES.
3. REFER TO ARCHITECTURAL DRAWINGS FOR EXACT LOCATIONS AND MOUNTING HEIGHTS OF FIXTURES.
4. SAWCUT EXISTING FLOOR AS REQUIRED FOR INSTALLATION OF UNDERFLOOR PIPING. PATCH FLOOR TO MATCH EXISTING.
5. NO PIPING SHALL BE ROUTED OVER THE TOP OF ELECTRICAL PANELS.
6. ALL MATERIALS WITHIN PLENUMS SHALL BE NONCOMBUSTIBLE OR SHALL HAVE A FLAME SPREAD INDEX OF NOT MORE THAN 25 AND A SMOKE-DEVELOPED INDEX OF NOT MORE THAN 50 WHEN TESTED IN ACCORDANCE WITH ASTM E 84.


PLUMBING PLAN NOTES:

1. REFER TO ENLARGED PLUMBING PLAN ON SHEET P1.2 FOR CONTINUATION.
2. CONNECT WASTE TO EXISTING SANITARY SEWER AS REQUIRED. VERIFY EXACT LOCATION AND ELEVATION PRIOR TO INSTALLATION OF ANY PIPING.
3. CONNECT WATER TO EXISTING DOMESTIC WATER AS REQUIRED. VERIFY EXACT LOCATION PRIOR TO INSTALLATION OF ANY PIPING.
4. CONNECT GAS TO EXISTING NATURAL GAS AS REQUIRED. VERIFY EXACT SIZE, LOCATION AND PRESSURE PRIOR TO INSTALLATION OF ANY PIPING.
5. CONNECT GAS TO EQUIPMENT AS REQUIRED AND AS DETAILED. GAS PRESSURE REGULATOR SHALL BE ON ROOF.
6. INSTALL ROOF HYDRANT AS REQUIRED.
7. LOCATION OF 3" VTR. VERIFY 10' CLEARANCE FROM ALL OUTDOOR AIR INTAKES. COORDINATE WITH GENERAL CONTRACTOR TO SEAL PENETRATION WEATHERTIGHT.
8. INSTALL HOSE BIBB AS REQUIRED.
9. INSTALL HUB DRAIN AS REQUIRED.

PLUMBING SYMBOLS

- |  |   |
|--|---|
|  | SOIL AND WASTE PIPING BELOW FLOOR/GRADE |
|  | SOIL AND WASTE PIPING ABOVE FLOOR/GRADE |
|  | SANITARY VENT PIPING ABOVE GRADE        |
|  | SANITARY VENT PIPING BELOW GRADE        |
|  | DOMESTIC COLD WATER PIPING              |
|  | DOMESTIC HOT WATER PIPING               |
|  | DOMESTIC HOT WATER RECIRCULATION PIPING |
|  | GAS PIPING                              |
|  | EQUIPMENT DRAIN LINE                    |
|  | COMPRESSED AIR PIPING BELOW FLOOR       |
|  | PIPING TURNING DOWN                     |
|  | PIPING TURNING UP                       |
|  | TEE TOP CONNECTION                      |
|  | UNION                                   |
|  | BACKFLOW PREVENTER                      |
|  | FLOOR DRAIN                             |
|  | FLOOR CLEAN OUT                         |
|  | WALL CLEAN OUT                          |
|  | GRADE CLEAN OUT                         |
|  | VALVE                                   |
|  | BALANCING VALVE                         |
|  | SOLENOID VALVE                          |
|  | PRESSURE REGULATOR                      |
|  | CHECK VALVE                             |
|  | CONNECT TO EXISTING                     |
|  | INVERT ELEVATION OF PIPE                |
|  | MATCH MARKS ON PLUMBING RISER DIAGRAM   |
|  | CONTROL WIRING                          |
|  | REFRIGERANT PIPING                      |
|  | CHECK VALVE                             |
|  | THERMOMETER                             |
|  | PRESSURE GAUGE                          |
|  | TEMPERATURE AND PRESSURE RELIEF VALVE   |
|  | PETE'S PLUG                             |
|  | Y STRAINER                              |
|  | VACUUM RELIEF VALVE                     |

ALL STORM PIPING IS EXISTING TO REMAIN.

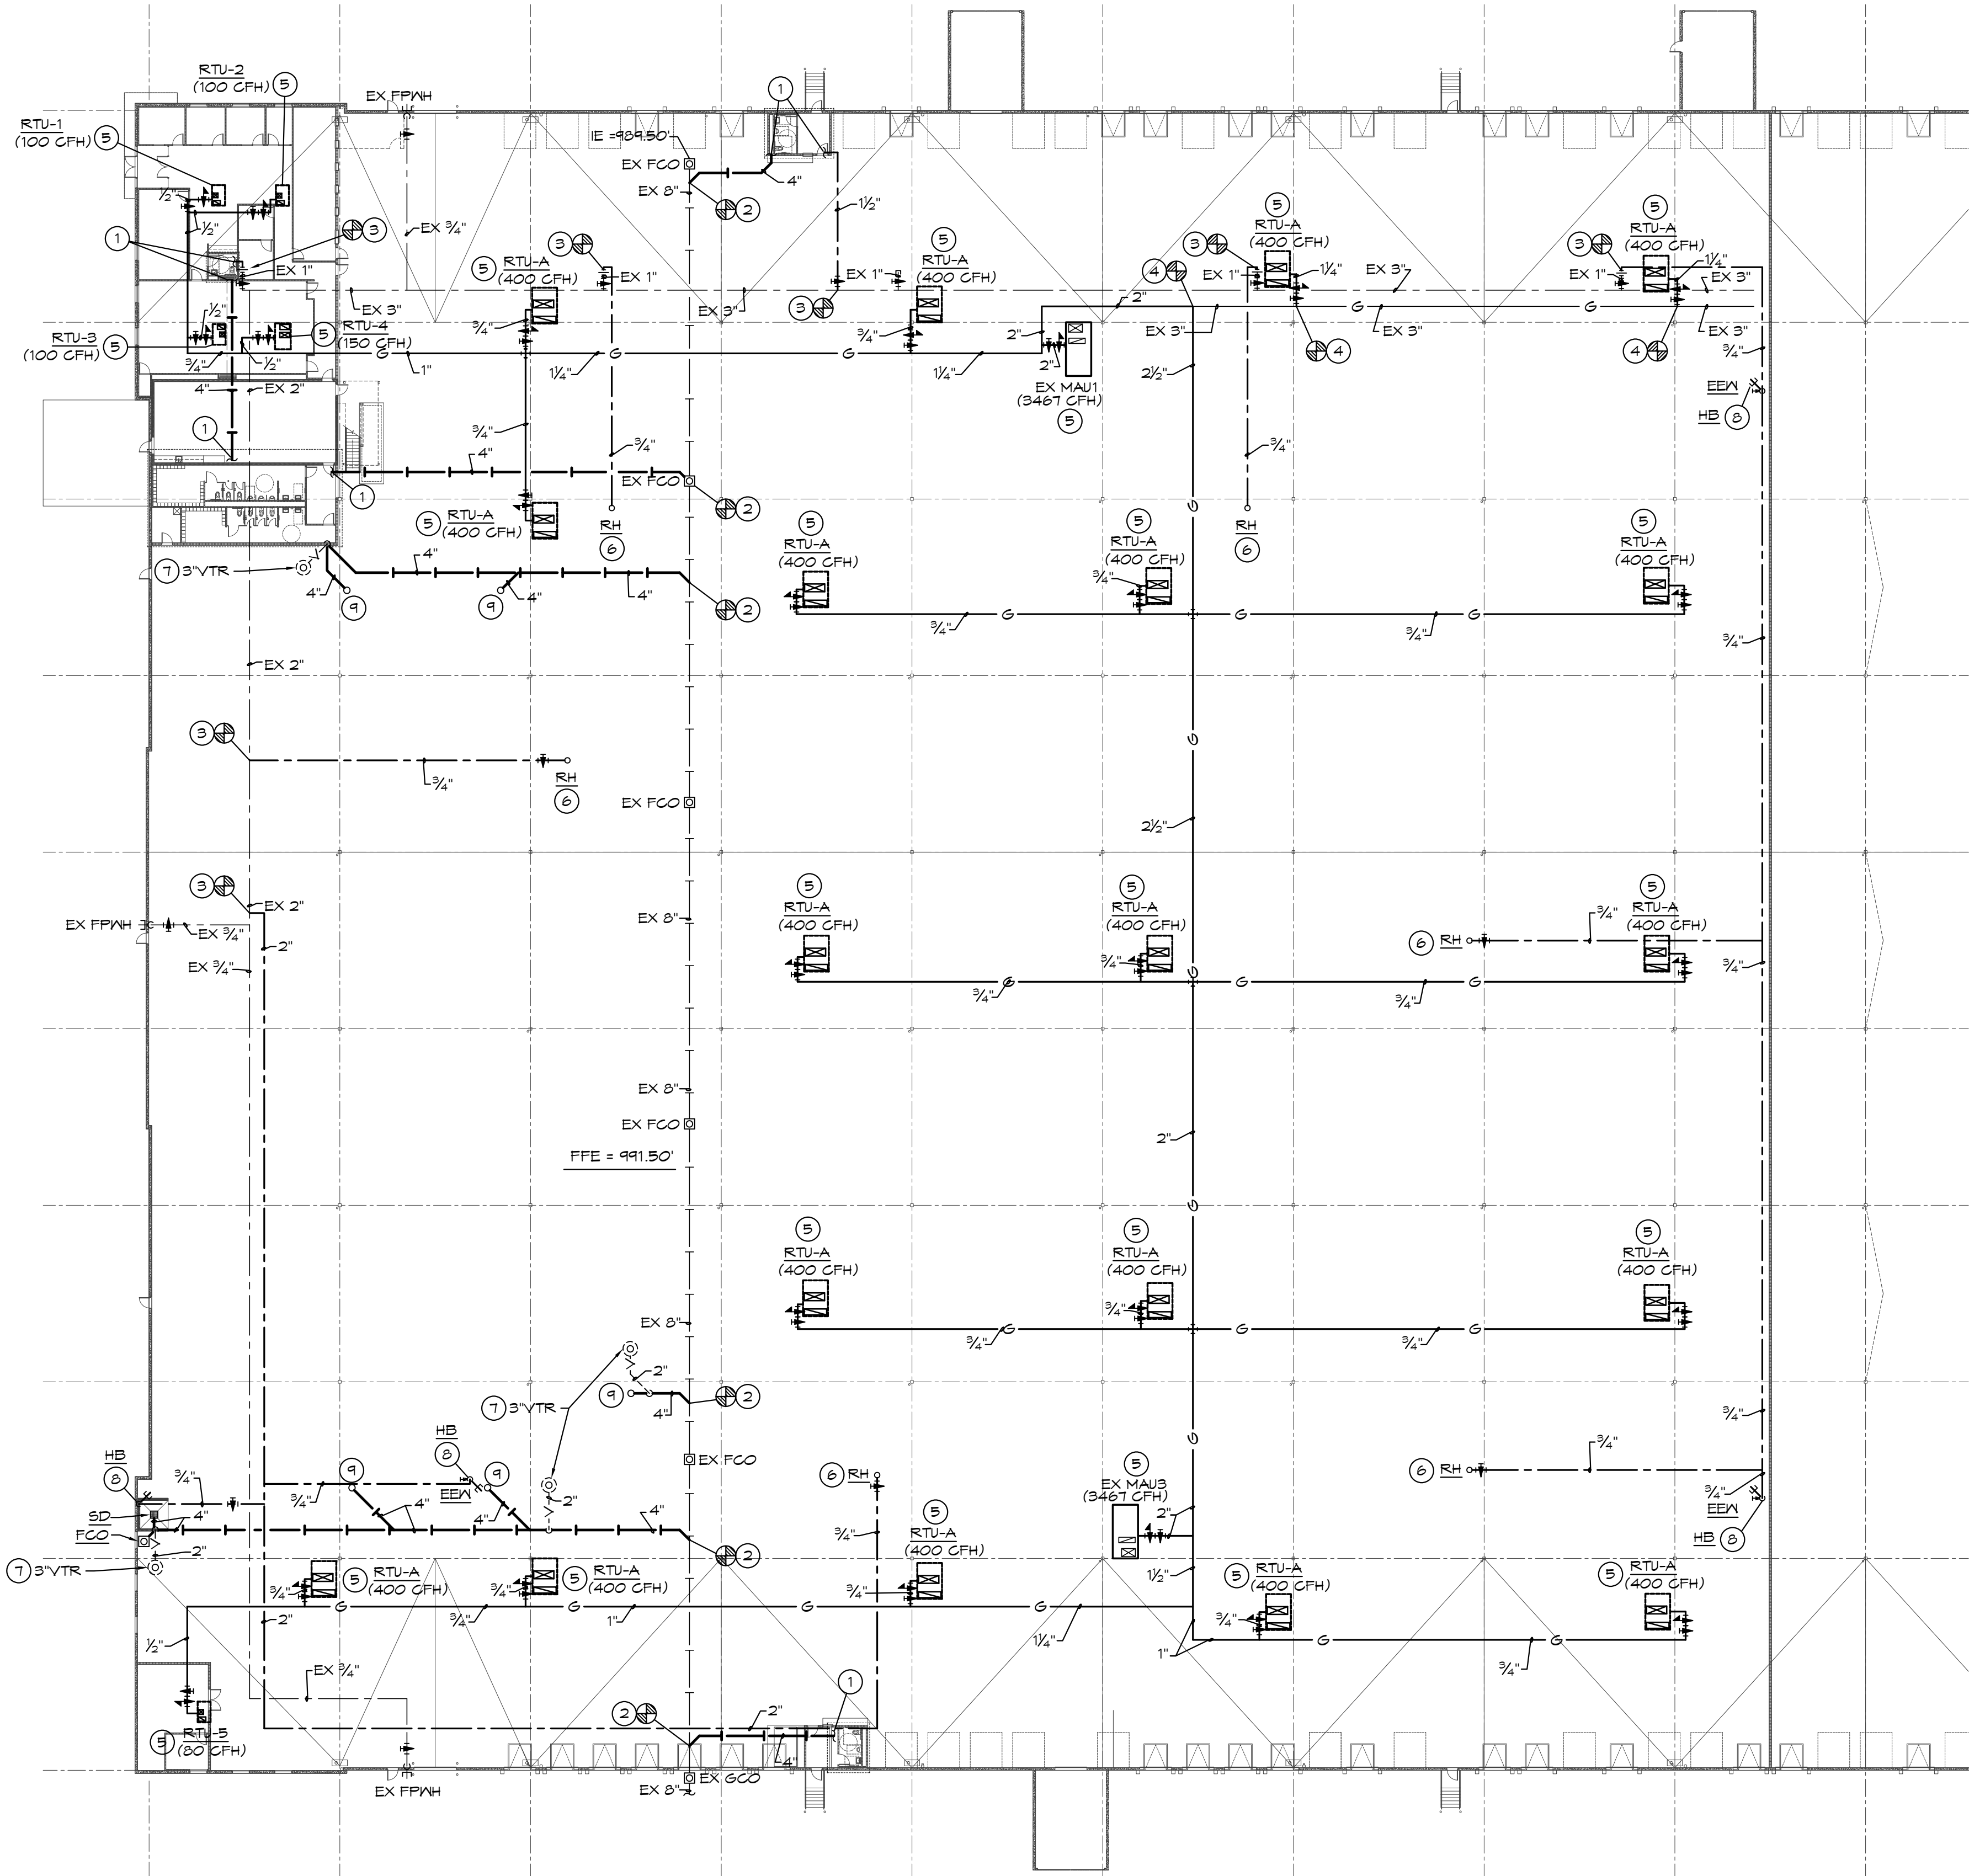


**PARTIAL PLUMBING FLOOR PLAN**  
SCALE: 1" = 30'-0"  
FFE = 991.50'

**CENTRAL**  
PLUMBING, HEATING & AIR CONDITIONING, INC.  
201 East Walnut  
Cleveland, MO 64734  
816-942-6355

BC PROJECT #22208  
MISSOURI PE COA #2009003629  
This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Engineer and is intended for use on the project only. Pursuant to the Architecture-Engine Act of 1967, all drawings, specifications, plans and designs, including the overall form, arrangement and composition of systems and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2022 BC Engineers, Inc.

**BC ENGINEERS**  
INCORPORATED  
5720 Reeder Shawnee, KS 66203 (913)262-1772

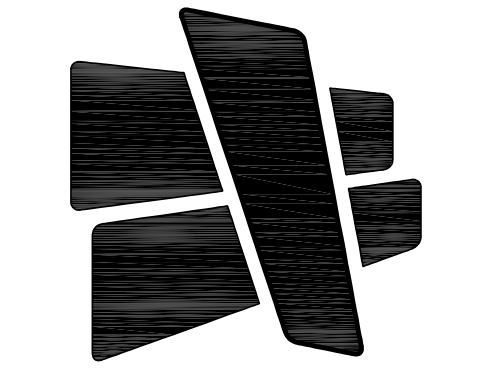


**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



**SCANNELL**  
PROPERTIES

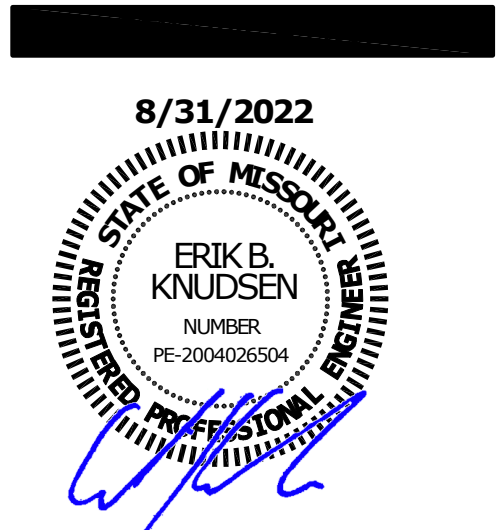

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

PERMIT SET 08.31.22

210300  
PLUMBING PLAN


P1.0





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



**SCANNELL**  
PROPERTIES

8/31/2022



LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

PERMIT SET 08.31.22


210300

COMPRESSED AIR PLAN

P1.1

**PLUMBING PLAN NOTES:**

- ① AIR PIPE WITH SHUT OFF VALVE DOWN TO AIR COMPRESSOR AND REGULATOR FURNISHED BY OTHERS. VERIFY EXACT LOCATION OF AIR CONNECTION AND COMPRESSED AIR REQUIREMENTS WITH MANUFACTURER'S SPECIFICATIONS.
- ② AIR PIPE WITH SHUT OFF VALVE 4'-0" AFF. SUPPORT AS REQUIRED.
- ③ AIR PIPE WITH SHUT OFF VALVE ABOVE ROOF. SUPPORT AS REQUIRED.

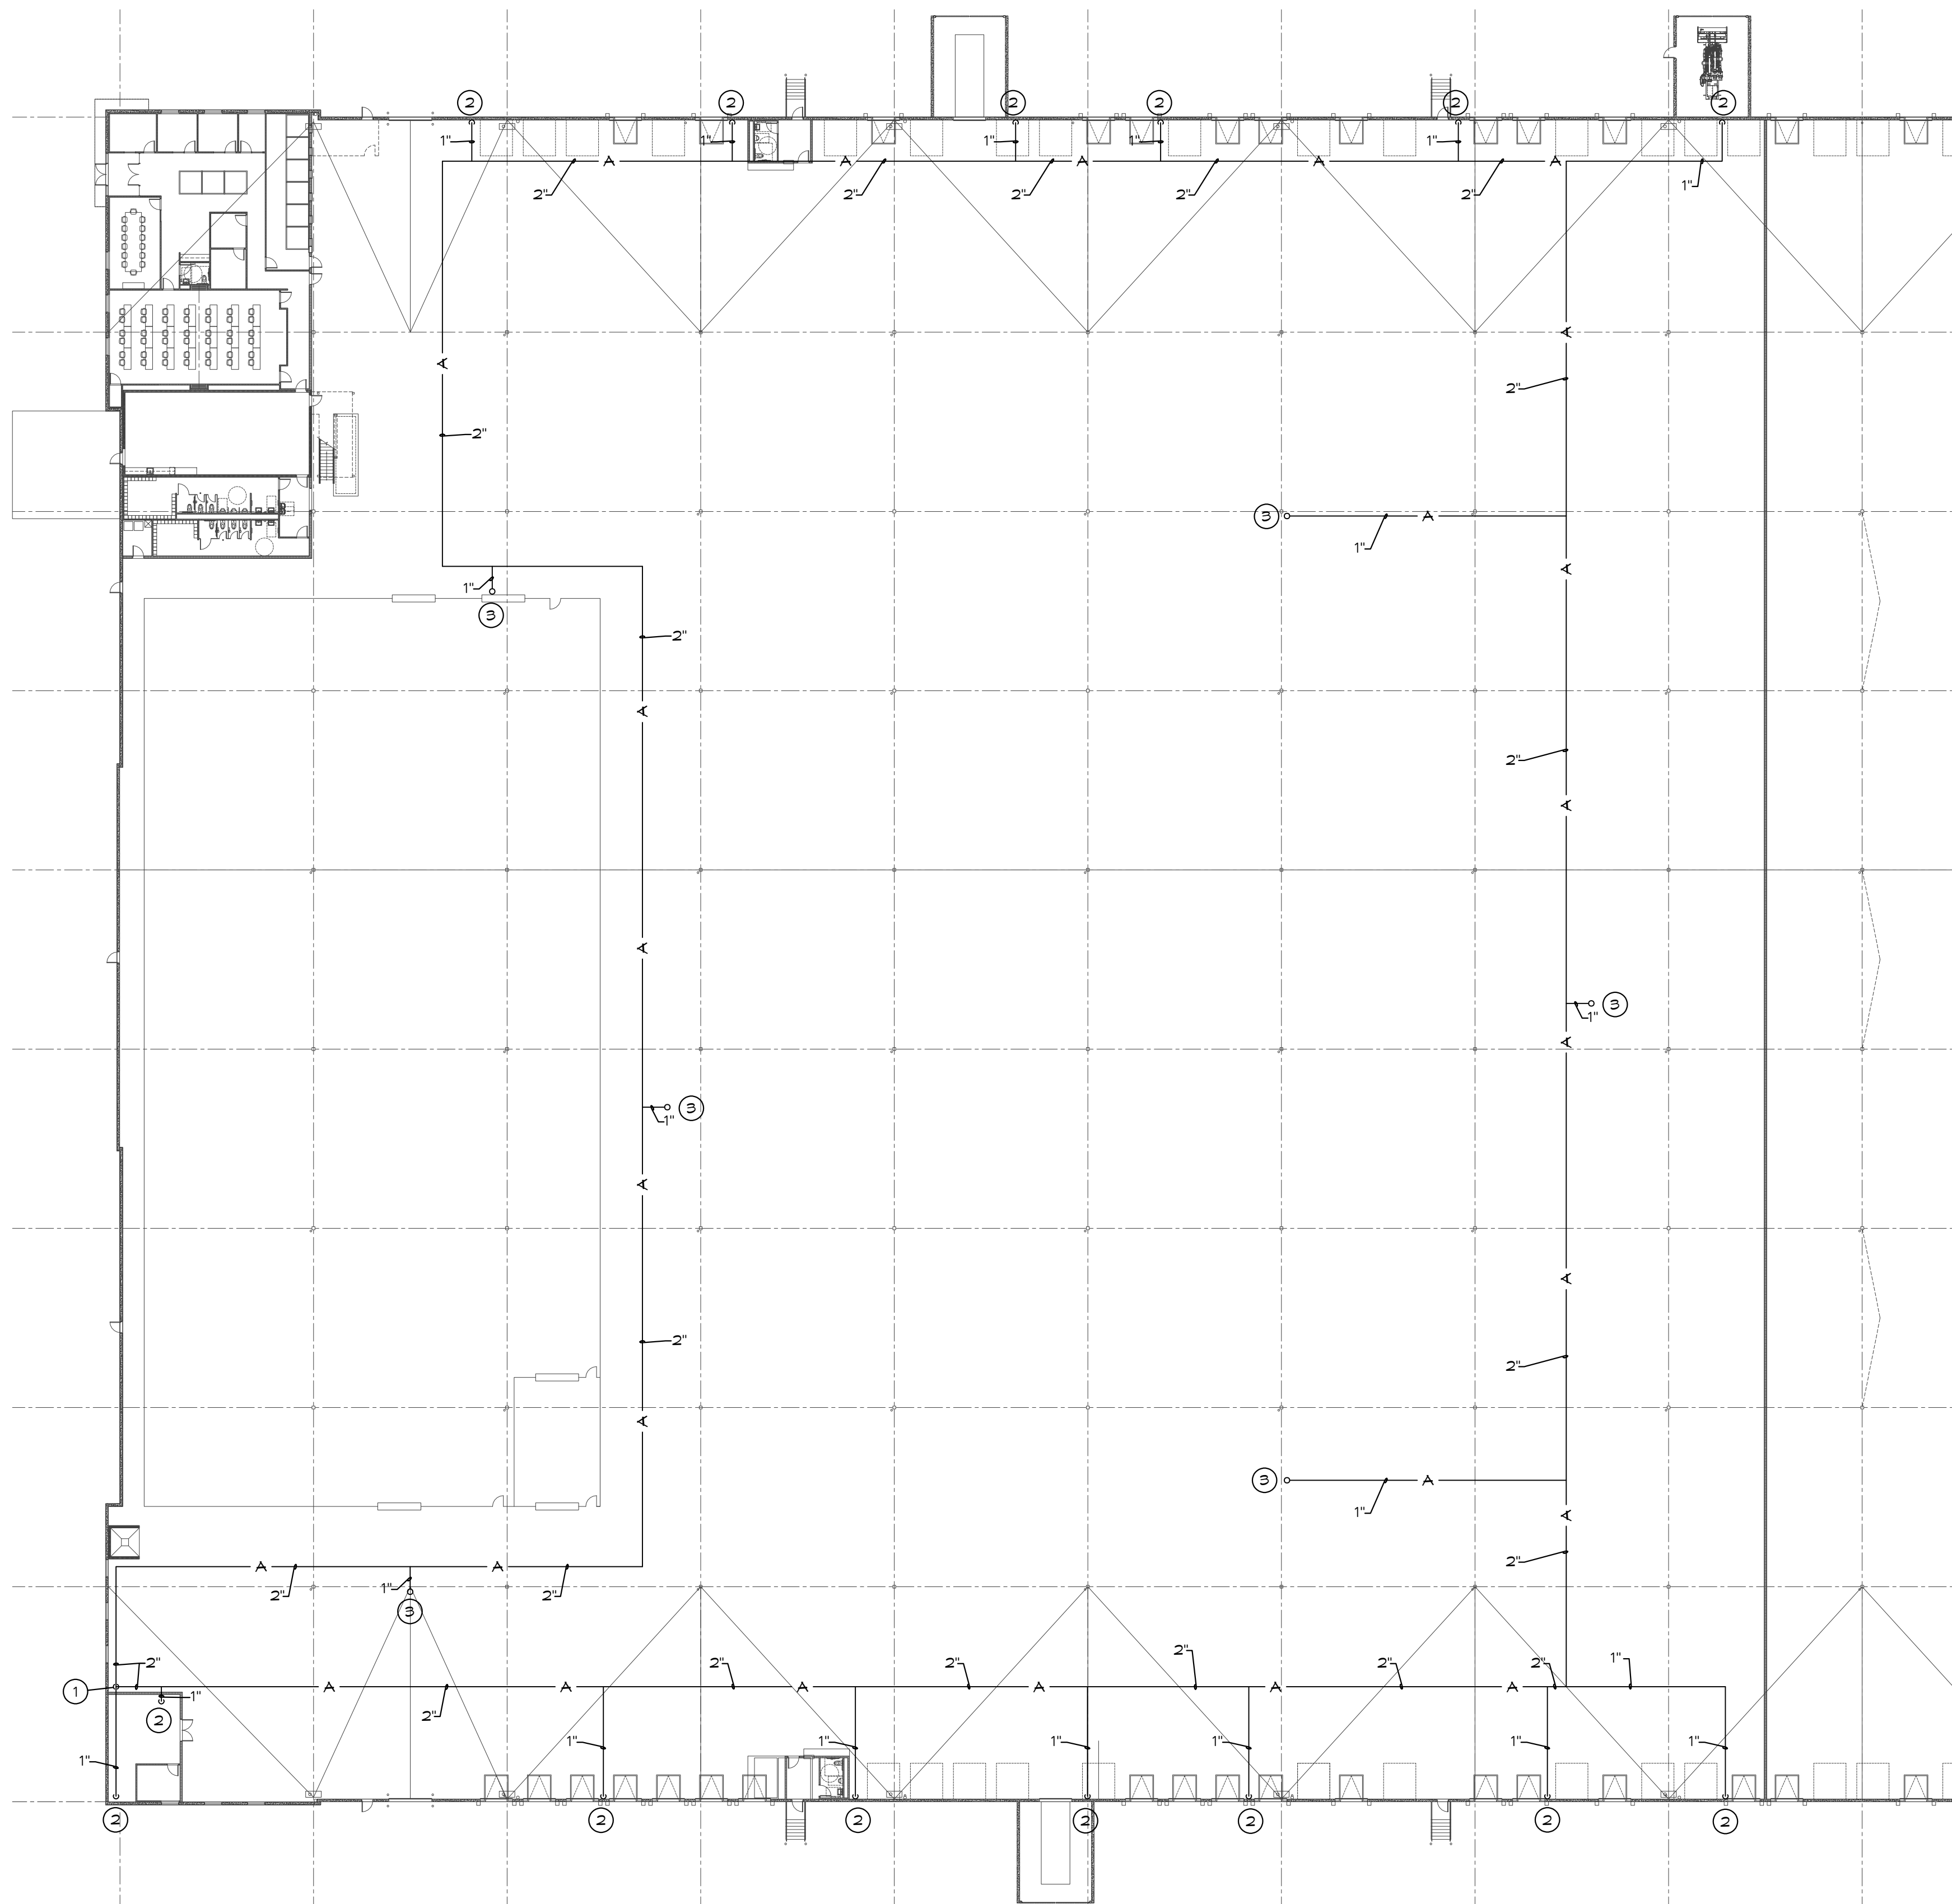

**PARTIAL COMPRESSED AIR FLOOR PLAN**  
SCALE: 1" = 30'-0" FFE = 991.50'



**CENTRAL**  
PLUMBING, HEATING & AIR CONDITIONING, INC.  
201 East Walnut  
Cleveland, MO 64734  
816-942-6355

BC PROJECT #22208  
MISSOURI PE COA #2009003629  
This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on the project only. Pursuant to the Architecture/Professional Engineering Act of 1980, all drawings, specifications, notes and designs, including the overall form, arrangement and composition of systems and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2022 BC Engineers, Inc.

**BC ENGINEERS**  
INCORPORATED

5720 Reeder Shawnee, KS 66203 (913)262-1772




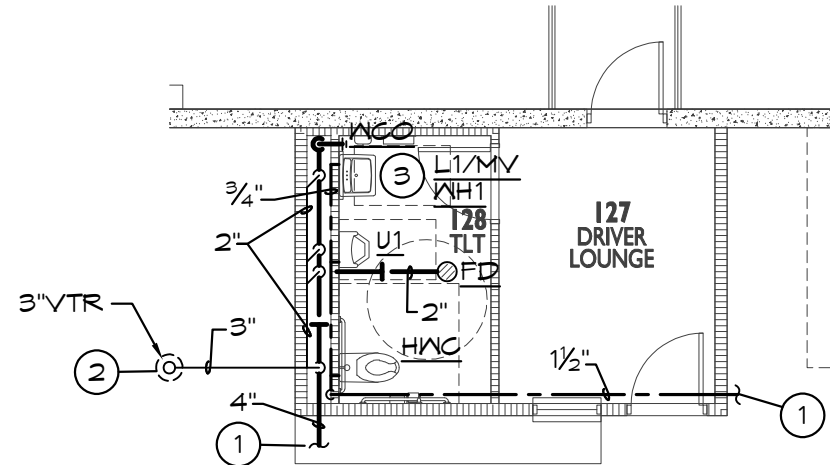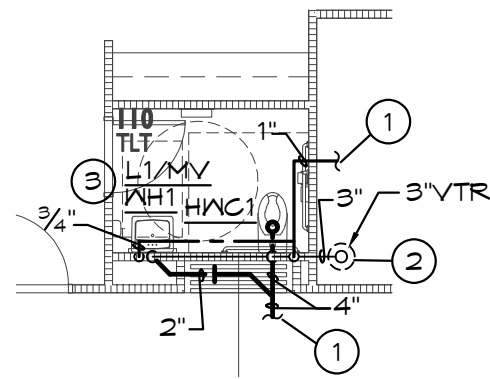


**ENLARGED PLUMBING FLOOR PLAN**  
SCALE: 1/8" = 1'-0"  
NORTH  
FFE = 991.50'

- PLUMBING PLAN NOTES:**
- 1 REFER TO PARTIAL PLUMBING PLAN ON P1.0 FOR CONTINUATION.
  - 2 LOCATION OF 3" VTR. VERIFY 10' CLEARANCE FROM ALL OUTDOOR AIR INTAKES. SEAL PENETRATION WEATHERTIGHT.
  - 3 INSTANTANEOUS WATER HEATER LOCATED BELOW SINK/LAV. SUPPORT FROM WALL PER THE MANUFACTURES REQUIREMENTS.
  - 4 PROVIDE BFP AND CONNECT CW TO ICE MAKER AND COFFEE MAKER AS REQUIRED.
  - 5 SUPPORT WATER HEATER FROM STRUCTURE ABOVE CEILING. PROVIDE GALVANIZED DRAIN PAIN UNDER WATER HEATER WITH DRAIN. ROUTE INDIRECT DRAIN PIPING TO MOP BASIN WITH AIR GAP.
  - 6 CONNECT WATER TO EXISTING DOMESTIC WATER AS REQUIRED. VERIFY EXACT LOCATION PRIOR TO INSTALLATION OF ANY PIPING.
  - 7 PROVIDE INDIRECT DRAIN FROM ICE MAKER TO FLOOR DRAIN WITH AIR GAP.

**ENLARGED PLUMBING FLOOR PLAN**  
SCALE: 1/8" = 1'-0"  
NORTH  
FFE = 991.50'

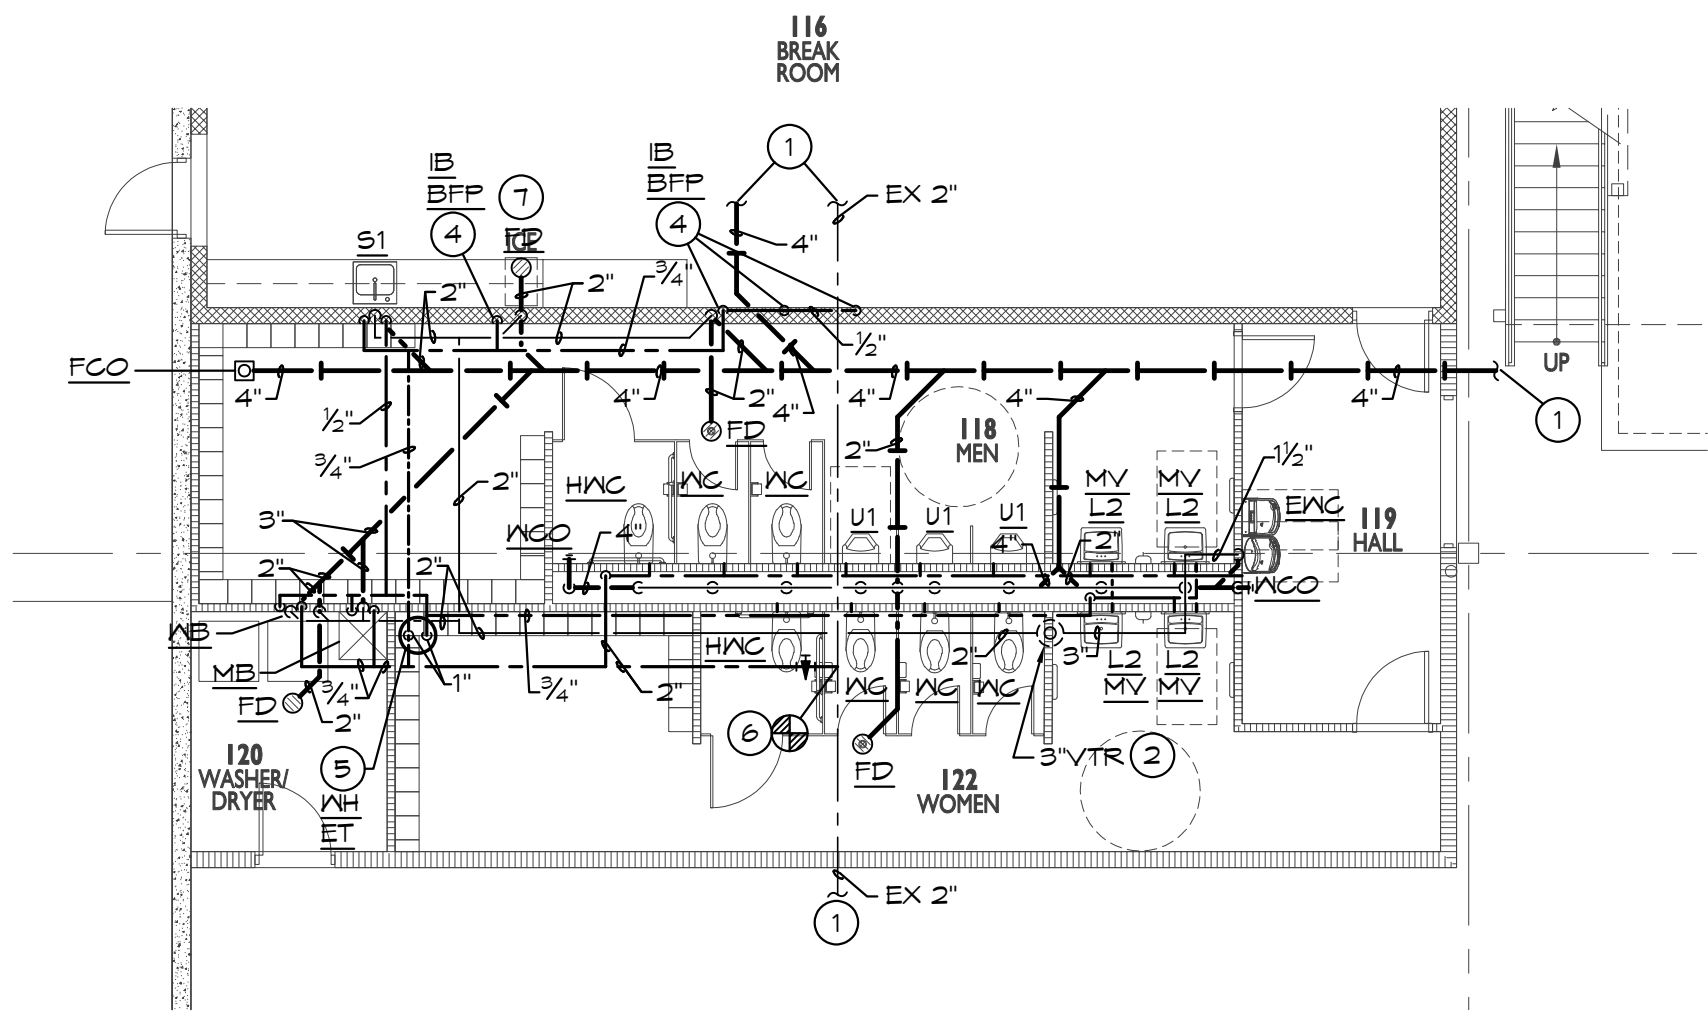

**ENLARGED PLUMBING FLOOR PLAN**  
SCALE: 1/8" = 1'-0"  
NORTH  
FFE = 991.50'

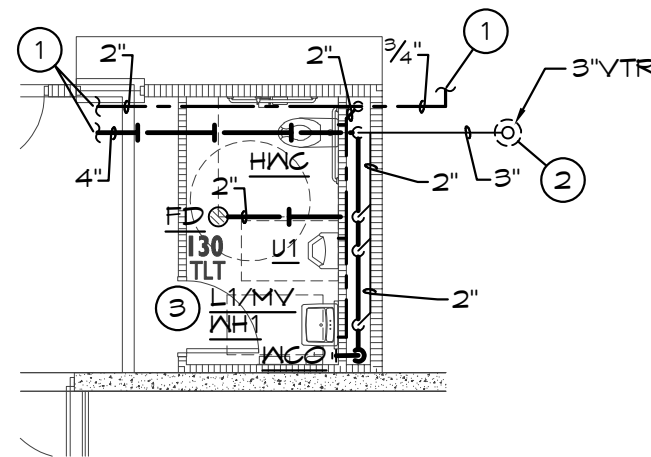

**ENLARGED PLUMBING FLOOR PLAN**  
SCALE: 1/8" = 1'-0"  
NORTH  
FFE = 991.50'

**CURRAN**  
ARCHITECTURE  
5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753

**SCANNELL**  
PROPERTIES

8/31/2022  
STATE OF MISSOURI  
ERIK B. KNUDSEN  
NUMBER  
PE-2004026504  
REGISTERED PROFESSIONAL ENGINEER

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I  
NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


PERMIT SET  
08.31.22  
210300  
ENLARGED PLUMBING  
PLANS

**CENTRAL**  
PLUMBING, HEATING & AIR CONDITIONING, INC.  
201 East Walnut  
Cleveland, MO 64734  
816-942-6355

**BC ENGINEERS**  
INCORPORATED  
5720 Reeder Shawnee, KS 66203 (913)262-1772

BC PROJECT #22208  
MISSOURI PE COA #2009003629  
This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on the project only. Pursuant to the Architecture/Professional Copyright Protection Act of 1980, all drawings, specifications, notes and designs, including the overall form, arrangement and composition of systems and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2022 BC Engineers, Inc.



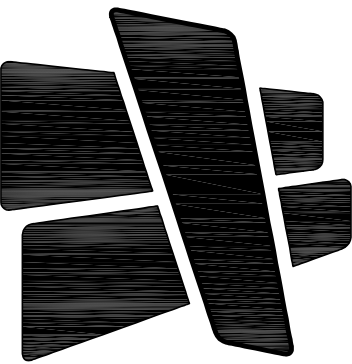

# CURRAN ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



# SCANNELL PROPERTIES

8/31/2022



## LEE'S SUMMIT LOGISTICS BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

PERMIT SET 08.31.22

210300

PLUMBING SCHEDULES AND  
DETAILS

P2.0


### PLUMBING FIXTURE SCHEDULE (OR EQUAL):

<u>HWC</u>	WATER CLOSET (HANDICAPPED): SAME AS WC, EXCEPT 18" HIGH BOWL FOR HANDICAPPED.
<u>WC</u>	WATER CLOSET: AMERICAN STANDARD #2257.001, VITREOUS CHINA, WALL HUNG, ELONGATED BOWL, SIPHON JET ACTION, SLOAN #111 FLUSH VALVE, 1.6 GAL/FLUSH, CENTROCO #STSCG-001 OPEN FRONT ELONGATED SEAT, FLOOR MOUNTED FIXTURE SUPPORT (HEAVY DUTY 500 LB CAPACITY).
<u>HWC1</u>	WATER CLOSET (HANDICAPPED): AMERICAN STANDARD, #3043.001 "MADERA ADA", VITREOUS CHINA, FLOOR MOUNTED, FLOOR OUTLET, 17-1/2" HIGH ELONGATED BOWL, SIPHON-JET ACTION, SLOAN "ROYAL" #111 FLUSH VALVE, 1.6 GAL/FLUSH, CENTROCO #STSCG-001 OPEN FRONT ELONGATED SEAT WITH CHECK HINGE. HANDLE ON WIDE SIDE OF FIXTURE.
<u>U</u>	URINAL, WALL HUNG: AMERICAN STANDARD, #6561.017 "TRIMBROOK", VITREOUS CHINA, 0.5 GPM WASH OUT ACTION, WALL HUNG URINAL WITH 3/4" TOP SPUD, SLOAN #186-1.0 FLUSH VALVE, FLOOR MOUNTED FIXTURE SUPPORT. SET RIM HEIGHT PER ARCHITECTURAL DRAWINGS.
<u>L1</u>	HANDICAP LAVATORY, WALL HUNG: AMERICAN STANDARD #03553012 "LUCERN", 20"x 18", VITREOUS CHINA, FRONT OVERFLOW, DELTA #B501LF FAUCET WITH SINGLE METAL LEVER FAUCET, OFFSET GRID ELBOW DRAIN AND 1-1/4" TAILPIECE, CHROME PLATED CAST BRASS P-TRAP WITH CLEANOUT (MOUNTED PARALLEL WITH WALL), CHROME PLATED LOOSE KEY ANGLE STOPS AND RISERS, FLOOR MOUNTED CONCEALED ARM LAVATORY SUPPORT, INSULATE EXPOSED DRAIN, WATER SUPPLIES, AND VALVES WITH PROWRAP SEAMLESS MOLDED CLOSED CELL VINYL INSULATION.
<u>L2</u>	HANDICAP LAVATORY, COUNTERTOP: AMERICAN STANDARD, #0476.028 "AQUALYN", VITREOUS CHINA, 20"x 17" OVAL BASIN, DELTA #B501LF FAUCET WITH SINGLE METAL LEVER HANDLE, OFFSET GRID DRAIN WITH 1-1/4" TAILPIECE, CHROME PLATED P-TRAP (MOUNTED PARALLEL WITH WALL), CHROME PLATED ANGLE STOPS AND RISERS, INSULATE EXPOSED DRAIN, WATER SUPPLIES, AND VALVES WITH PROWRAP SEAMLESS MOLDED CLOSED CELL VINYL INSULATION.
<u>S1</u>	SINK-ELKAY, #LRAD-2222, 19"x16"x 6-1/2" DEEP BOWL, 21-3/8"x 21-3/8" CUT-OUT, ADA COMPLIANT, SINGLE COMPARTMENT, SELF-RIMMING STAINLESS STEEL SINK WITH SATIN FINISH AND SOUND DAMPENING UNDERCOATING, #LK-1000CR FAUCET, SWING SPOUT, AERATOR, SINGLE LEVER HANDLE, CHROME PLATED CAST BRASS P-TRAP WITH CLEANOUT, CHROME PLATED ANGLE STOPS AND RISERS, IN-SINK-ERATOR #BADGER 3 DISPOSAL, 1/2 HP, 120 VOLT.
<u>MB</u>	MOP BASIN: FIAT, #MSB-2424, MOLDED STONE MOP BASIN, 2" DRAIN, 24"x 24" BASIN, VINYL BUMPER GUARD, STERN WILLIAMS #T-10-VB FAUCET, SPRING CHECKS, VACUUM BREAKER, INTEGRAL STOPS, WALL BRACE & PAIL HOOK, WALL BRACKET WITH 30' HOSE.
<u>ENC</u>	ELECTRIC WATER COOLER: OASIS, #P68ACSL, BARRIER FREE TWO-STATION WATER COOLER, 8.0 GPH, 50 DEGREES F WATER WITH 40 DEGREES F AIR TEMPERATURE, 120 VOLT, COLOR TO BE SELECTED BY ARCHITECT AFTER AWARD OF CONTRACT, FRONT AND SIDE ANTIMICROBIAL PUSH PADS, ANTIMICROBIAL FLEX BUBBLERS, CHROME PLATED CAST BRASS P-TRAP WITH CLEANOUT, CHROME PLATED LOOSE KEY ANGLE STOP, FLOOR MOUNTED CARRIER AND CANE APRON.
<u>FD</u>	FLOOR DRAIN: JR SMITH, #2005-A, CAST IRON FLOOR DRAIN WITH ADJUSTABLE TOP, 6" NIKALOY STRAINER. PROVIDE WITH #2642 QUAD GLOBE TRAP SEAL DEVICE.
<u>EEW</u>	PORTABLE EYE WASH STATION: BRADLEY #519-421, SELF-CONTAINED, LOCATED AT EACH CHARGING STATION.
<u>HB</u>	HOSE BIBB: PRIER, #P-164, 3/4" HOSE NOZZLE OUTLET, SATIN NICKEL PLATED BODY FINISH, HANDWHEEL OPERATED, INTEGRAL VACUUM BREAKER.
<u>IB</u>	ICE BOX: SIOUX CHIEF #696-1000, ICE BOX WITH 1/2" INLET AND CONNECTION AND 1/4-TURN SHUT OFF VALVE.
<u>WH1</u>	TANKLESS HOT WATER HEATER: STIEBEL ELTRON MINI 3, 120 VOLT, 3.0 KM.
<u>WH</u>	HOT WATER HEATER: AO SMITH #DEL-40, 40 GALLON STORAGE, 208 VOLT/1 PHASE, (2) 6000 WATT ELEMENT, NON-SIMULTANEOUS, ASME TEMPERATURE AND PRESSURE RELIEF VALVE.
<u>ET</u>	HOT WATER EXPANSION TANK: AMTROL, #ST-5, 2 GALLON EXPANSION TANK WITH DIAPHRAGM.
<u>MV</u>	MIXING VALVE: WATTS, #LFUSG-B, THERMOSTATIC CONTROLLED MIXING VALVE, LEAD FREE BRONZE BODY, LOCKED TEMPERATURE ADJUSTMENT CAP (VANDAL RESISTANT), COPPER ENCAPSULATED THERMOSTAT ASSEMBLY WITH BRASS SHUTTLE, STAINLESSSTEEL SPRINGS, INTEGRAL CHECK VALVES ON HOT AND COLD INLETS. (SET TO 110°F). ASSE 1070 LISTED.
<u>BFP</u>	BACKFLOW PREVENTOR: WATTS #SD-3, DUAL CHECK VALVE WITH ATMOSPHERIC PORT & STRAINER FOR CARBONATED BEVERAGE MACHINES
<u>RH</u>	FREEZELESS ROOF HYDRANT: WOODFORD #RH2-MS, HEAVY-DUTY CAST IRON MOUNTING SYSTEM, AUTOMATICALLY DRAIN WHEN SHUT OFF, ASSE 1052 DOUBLE CHECK BACKFLOW PREVENTOR.
<u>WB</u>	WASHER BOX : SIOUX CHIEFS "OXBOX" 696 SERIES WASHER OUTLET BOX WITH BUILT IN WATER HAMMER ARRESTER WITH 1-1/2" DRAIN OUTLET AND TAILPIECE, AND 1/2" HOT & COLD WATER CONNECTION.
<u>SD</u>	SCRUBBER DRAIN: RELIABLE CONCRETE 3030/2150SC CATCH BASIN REINFORCED, CLAY & BAILEY 2150BS 135" GRATE.
<u>WHA</u>	WATER HAMMER ARRESTOR: JR SMITH "HYDROTROL" #5000 LEAD-FREE WATER HAMMER ARRESTOR, SIZED AS PER MANUFACTURER'S RECOMMENDATIONS.
<u>FCO/MCO</u>	VINYL TILE FLOOR: JR SMITH #4140, OR EQUAL. QUARRY TILE FLOOR: JR SMITH #4200, OR EQUAL. CARPETED FLOOR: JR SMITH #4030-Y, OR EQUAL. UNFINISHED FLOOR: JR SMITH #4020, OR EQUAL.

PIPE HANGER SCHEDULE		
PIPE MATERIAL	MAXIMUM HANGER SPACING	HANGER ROD DIAMETER
ABS (All sizes)	4'	3/8"
PVC (All Sizes)	4'	3/8"
CPVC, 1 inch and smaller	3'	1/2"
CPVC, 1-1/4 inches and larger	4'	1/2"
Cast Iron (All Sizes)	5'	5/8"
Cast Iron (All Sizes) with 10 foot length of pipe	10'	5/8"
Copper Tube, 1-1/4 inches and smaller	6'	1/2"
Copper Tube, 1-1/2 inches and larger	10'	1/2"
Steel, 3 inches and smaller	12'	1/2"
Steel, 4 inches and larger	12'	5/8"
Pex, 1" and below without support channel	32"	3/8"
Pex, 1-1/4" and above without support channel	48"	3/8"
Pex 3/4" and below with support channel	6'	3/8"
Pex 1" and above with support channel	8'	3/8"


### PEX PIPING REQUIREMENTS

PIPE SIZES GIVEN ON THE DRAWINGS ARE NOMINAL COPPER PIPE SIZE. IF PEX PIPING IS USED, INCREASE PEX PIPING ONE SIZE ABOVE LISTED SIZES AS REQUIRED TO EQUAL OR EXCEED COPPER PIPE INSIDE DIAMETER.

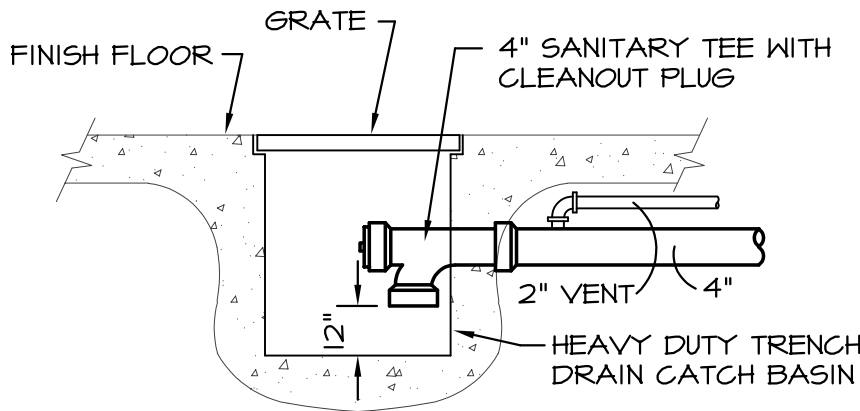

### CATCH BASIN DETAIL

SCALE: NONE

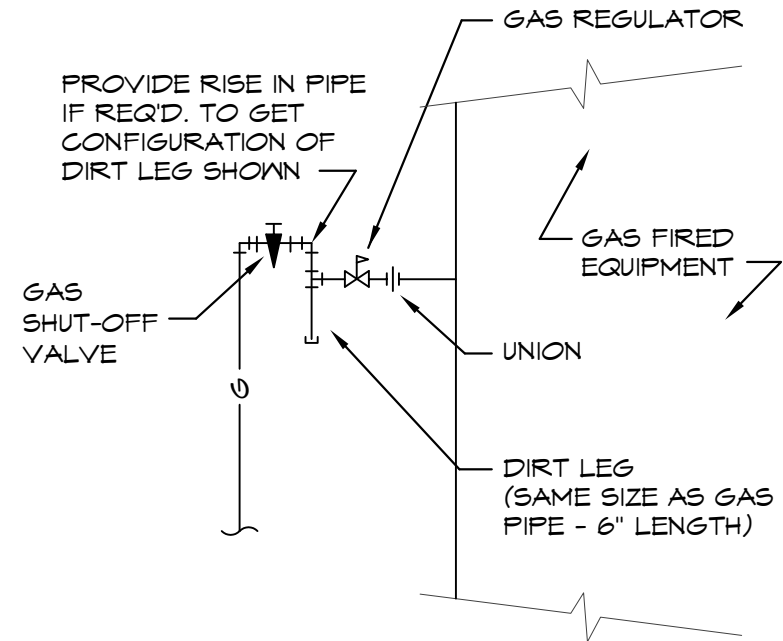


GAS PRESSURE REGULATORS FOR GAS FIRED EQUIPMENT SHALL BE SENSUS #243-B, 5 PSI INLET / 7" WC OUTLET PRESSURE WITH THE ORIFICE & SPRING SIZE AS RECOMMENDED BY THE MANUFACTURER.

PROVIDE GAS REGULATOR FOR EVERY PIECE OF GAS FIRED EQUIPMENT. VENT ON REGULATOR SHALL BE VENTED WITH FULL SIZE PIPE TO EXTERIOR OF BLDG. FLASH BLDG PENETRATION WEATHER TIGHT.

### GAS CONNECTION DETAIL

SCALE: NONE  
FOR ROOFTOP UNITS, MAKE-UP AIR UNITS, ETC. WITH 2 PSI GAS PRESSURE

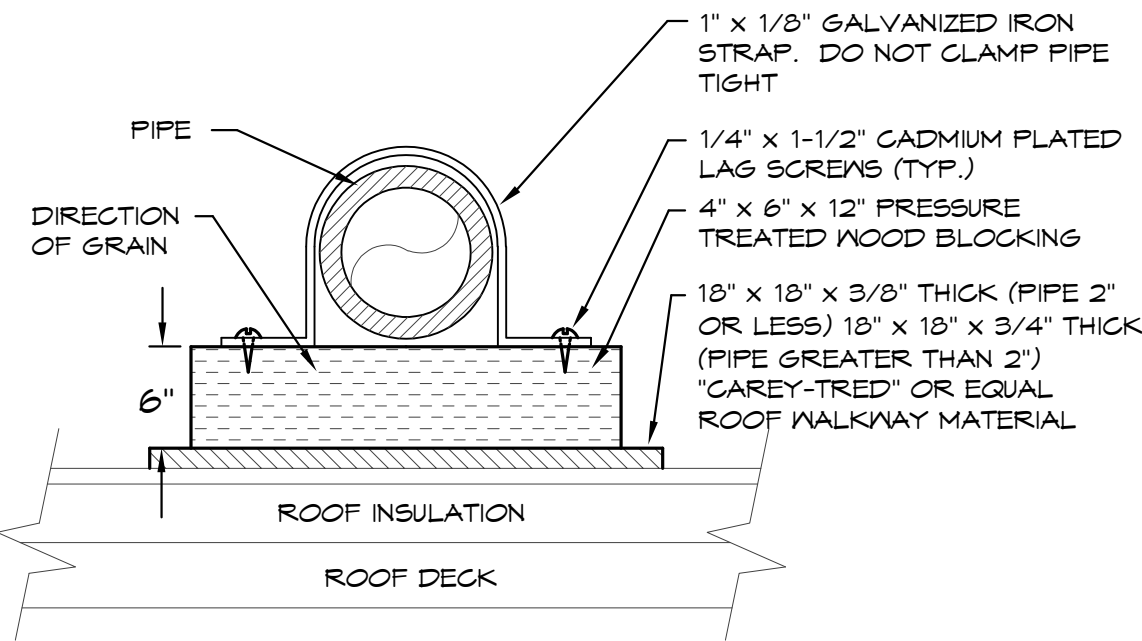

### ROOF PIPE SUPPORT DETAIL

SCALE: NONE

PLUMBING DRAINAGE CALCULATIONS					
FIXTURE	QUANTITY	FU	TOTAL FU		
WATER CLOSETS	10	4	40		
URINAL (1.0 GPF)	5	2	10		
LAVATORIES	7	1	7		
SINKS	1	2	2		
FLOOR DRAIN	7	2	14		
FLOOR SINK	5	2	10		
SCRUBBER DRAIN	1	2	2		
WASHER BOX	1	3	3		
MOP SINK	1	2	2		
ELECTRIC WATER COOLER	1	5	5		
TOTAL			90.5 FU		
VENT MAINS - 3"					
WASTE MAIN - 4"					

PLUMBING FIXTURE WATER COUNT						
FIXTURE	QUANTITY	CN FU	TOTAL FU	HN FU	TOTAL FU	COMBINED FU
WATER CLOSETS	10	10	100	-	-	-
URINAL	5	5	25	-	-	-
LAVATORIES	7	1.5	10.5	1.5	10.5	2
SINKS	1	2.25	2.25	-	2.25	0
WATER BOXES	4	.25	-	-	-	3
CLOTHES WASHER	1	2.25	2.25	2.25	2.25	3
MOP SINK	1	2.25	2.25	2.25	2.25	3
WATER COOLER	1	.25	.25	-	-	.25
		149.5 FU		17.25 FU		149.25 FU
COLD WATER MAIN - 2"						
HOT WATER MAIN - 1"						

# CENTRAL

PLUMBING, HEATING & AIR CONDITIONING, INC.  
201 East Walnut  
Cleveland, MO 64734  
816-942-6355


BC PROJECT #22208  
MISSOURI PE COA #2009003629

This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on the project only. Pursuant to the Architectural and Professional Engineer Act of 1980, all drawings, specifications, plans and designs, including the owner form, assignment and completion of forms and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2022 BC Engineers, Inc.

**BC ENGINEERS  
INCORPORATED**


5720 Reeder Shawnee, KS 66203 (913)262-1772



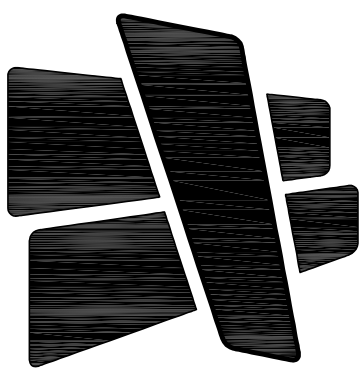

**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

8/31/2022



LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I


NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

PERMIT SET 08.31.22


210300

PLUMBING RISERS

P2.1

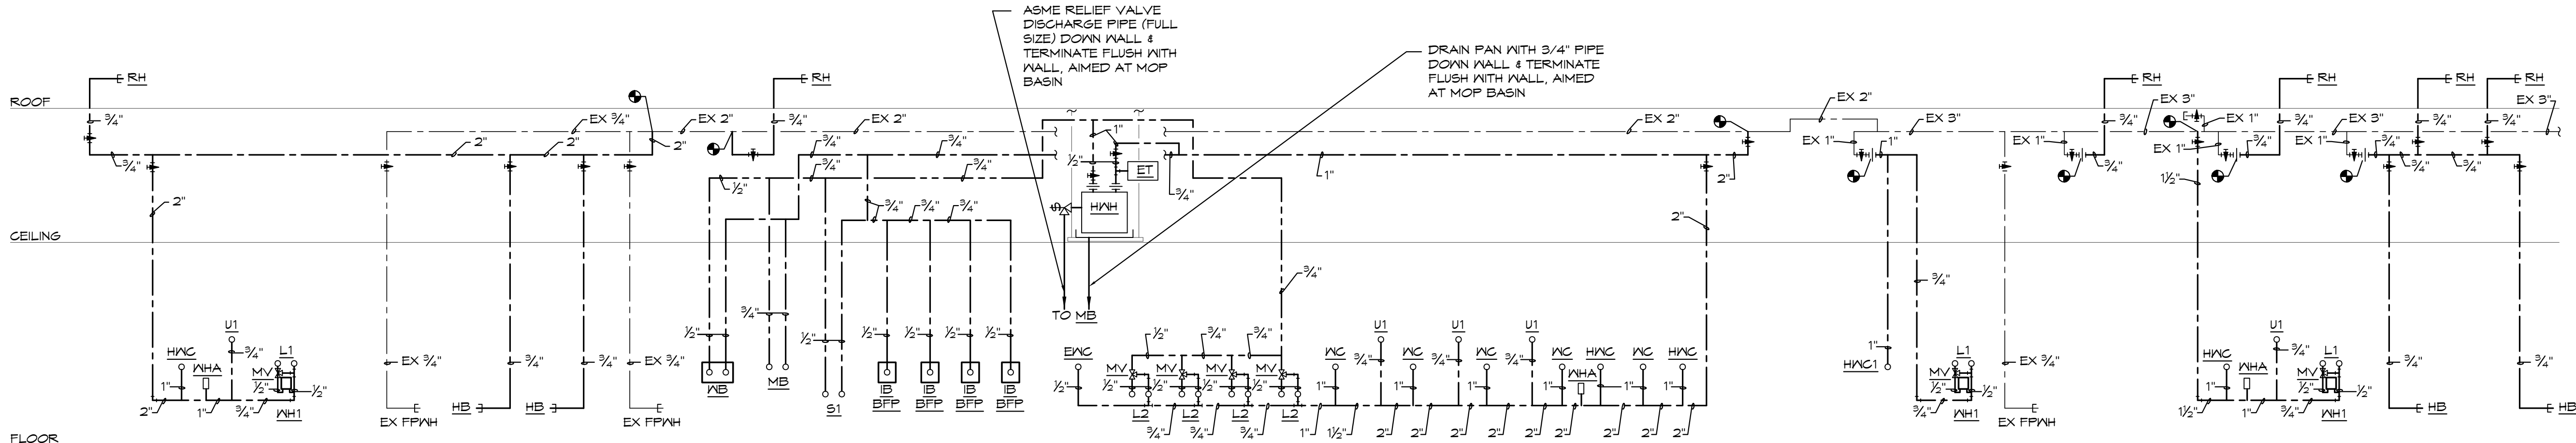

**HOT & COLD WATER**

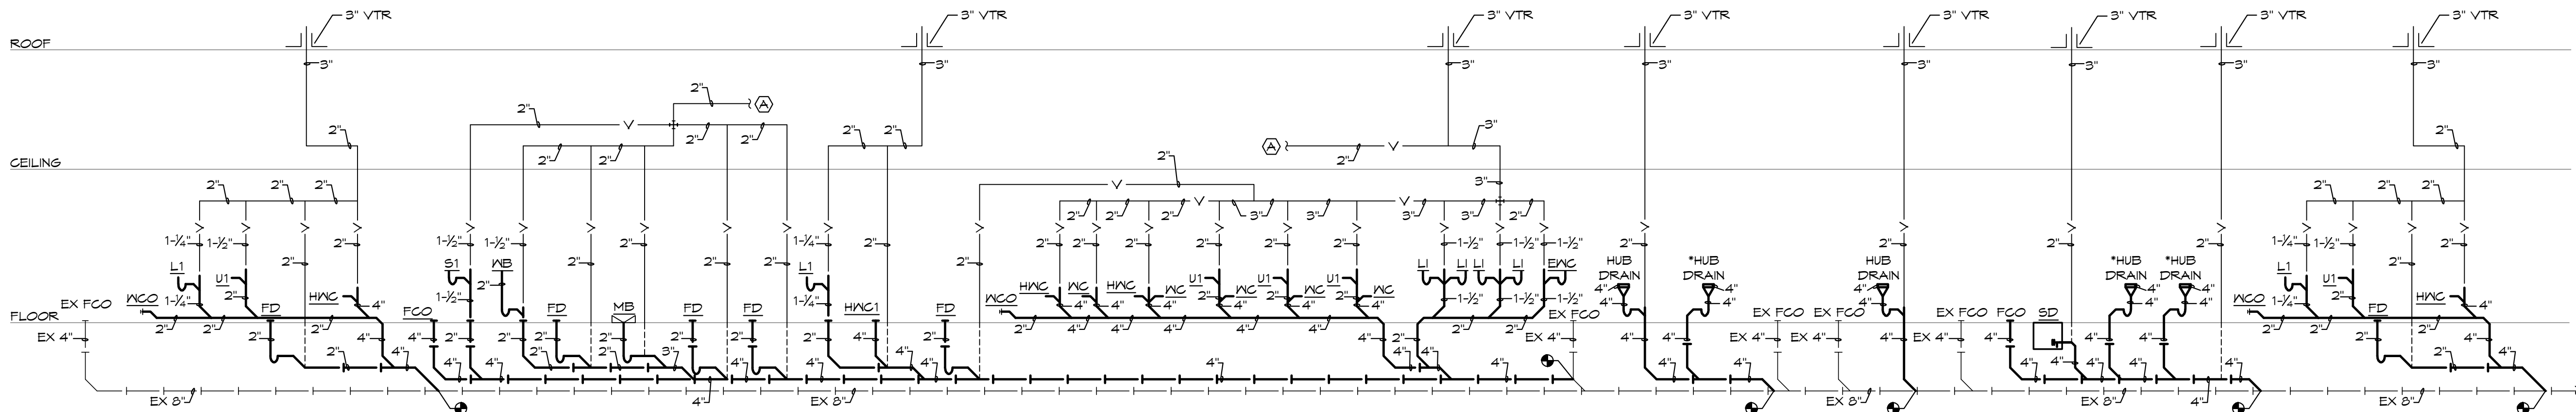

\* = COMBINATION WASTE & VENT DRAIN

**WASTE & VENT**

**PLUMBING RISER DIAGRAMS**

SCALE: NONE

BC PROJECT #22208  
MISSOURI PE COA #2009003629  
This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on the project only. Pursuant to the Architecture/Professional Engineering Act of 1980, all drawings, specifications, notes and designs, including the overall form, arrangement and composition of systems and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2022 BC Engineers, Inc.

**CENTRAL**  
PLUMBING, HEATING & AIR CONDITIONING, INC.  
201 East Walnut  
Cleveland, MO 64734  
816-942-6355

**BC ENGINEERS**  
INCORPORATED  
5720 Reeder Shawnee, KS 66203 (913)262-1772





**SCANNELL**  
PROPERTIES

THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY  
OF CURRAN ARCHITECTURE, AND ARE NOT  
TO BE USED OR REPRODUCED, WHOLE OR  
IN PART, WITHOUT THE WRITTEN  
CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT 1

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

PERMIT SET	02.18.22
CITY COMMENTS	10.17.22

HERITAGE ELECTRIC, L.L.C.  
841 N. MARTWAY  
Olathe, Kansas  
phone (913) 747 0528  
fax (913) 747 0539




THIS DRAWING HAS BEEN PRODUCED BY HERITAGE  
ELECTRIC, LLC, FOR THEIR COORDINATION OF THE  
ELECTRICAL INSTALLATION AND MAY NOT BE USED  
FOR ANY OTHER PURPOSE  
COPYRIGHT 2008, HERITAGE ELECTRIC, LLC.

THE SEAL OF THE ELECTRICAL P.E. APPLIES  
TO ONLY THIS DRAWING, SPECIFICATIONS AND OTHER  
DOCUMENTS BEARING THE PERSONAL SEAL OF THE  
UNDERSIGNED PROFESSIONAL AND IS NOT A  
RESPONSIBILITY FOR ALL OTHER DRAWINGS,  
SPECIFICATIONS, ESTIMATES, REPORTS OR OTHER  
DOCUMENTS WHICH DO NOT CONTAIN THE PERSONAL  
SEAL OF THE UNDERSIGNED PROFESSIONAL.

210300

## WAREHOUSE LIGHTING

# EI.0

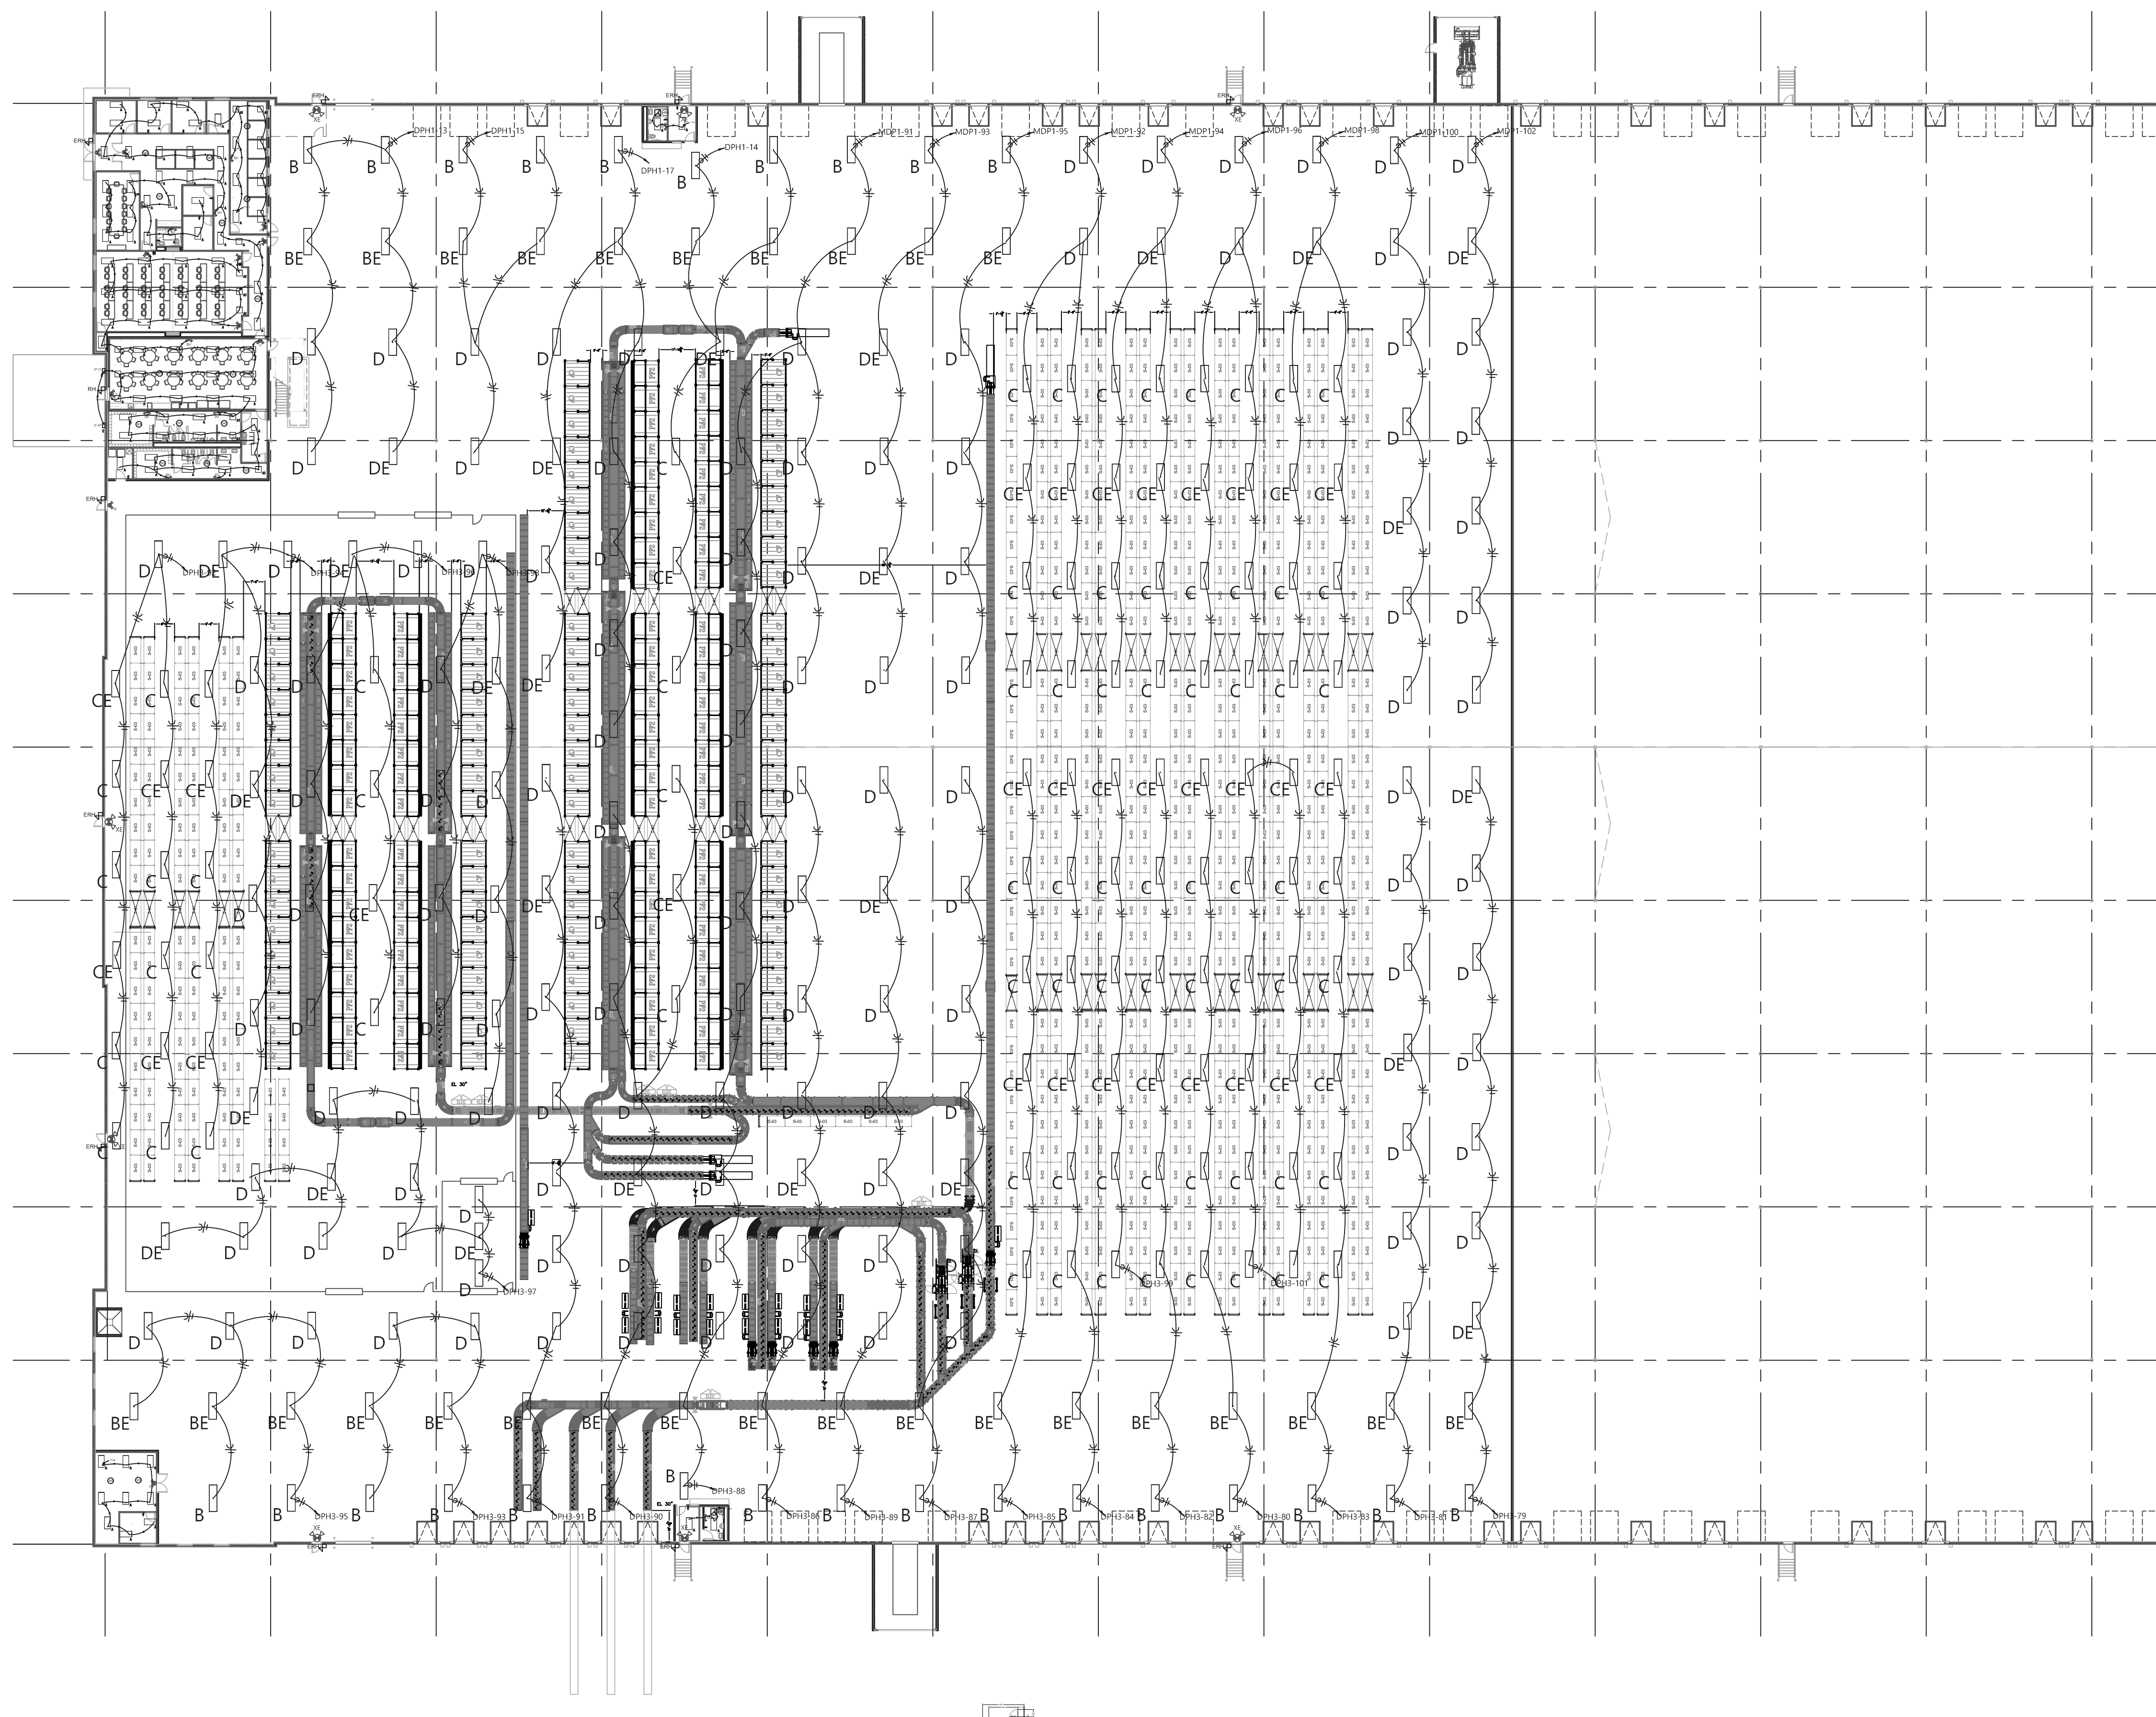

# 1 Warehouse lighting Plan








**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT 1

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


ISSUE DATES

PERMIT SET	02.18.22
CITY COMMENTS	10.17.22



210300

OFFICE LIGHTING


**EI.1**

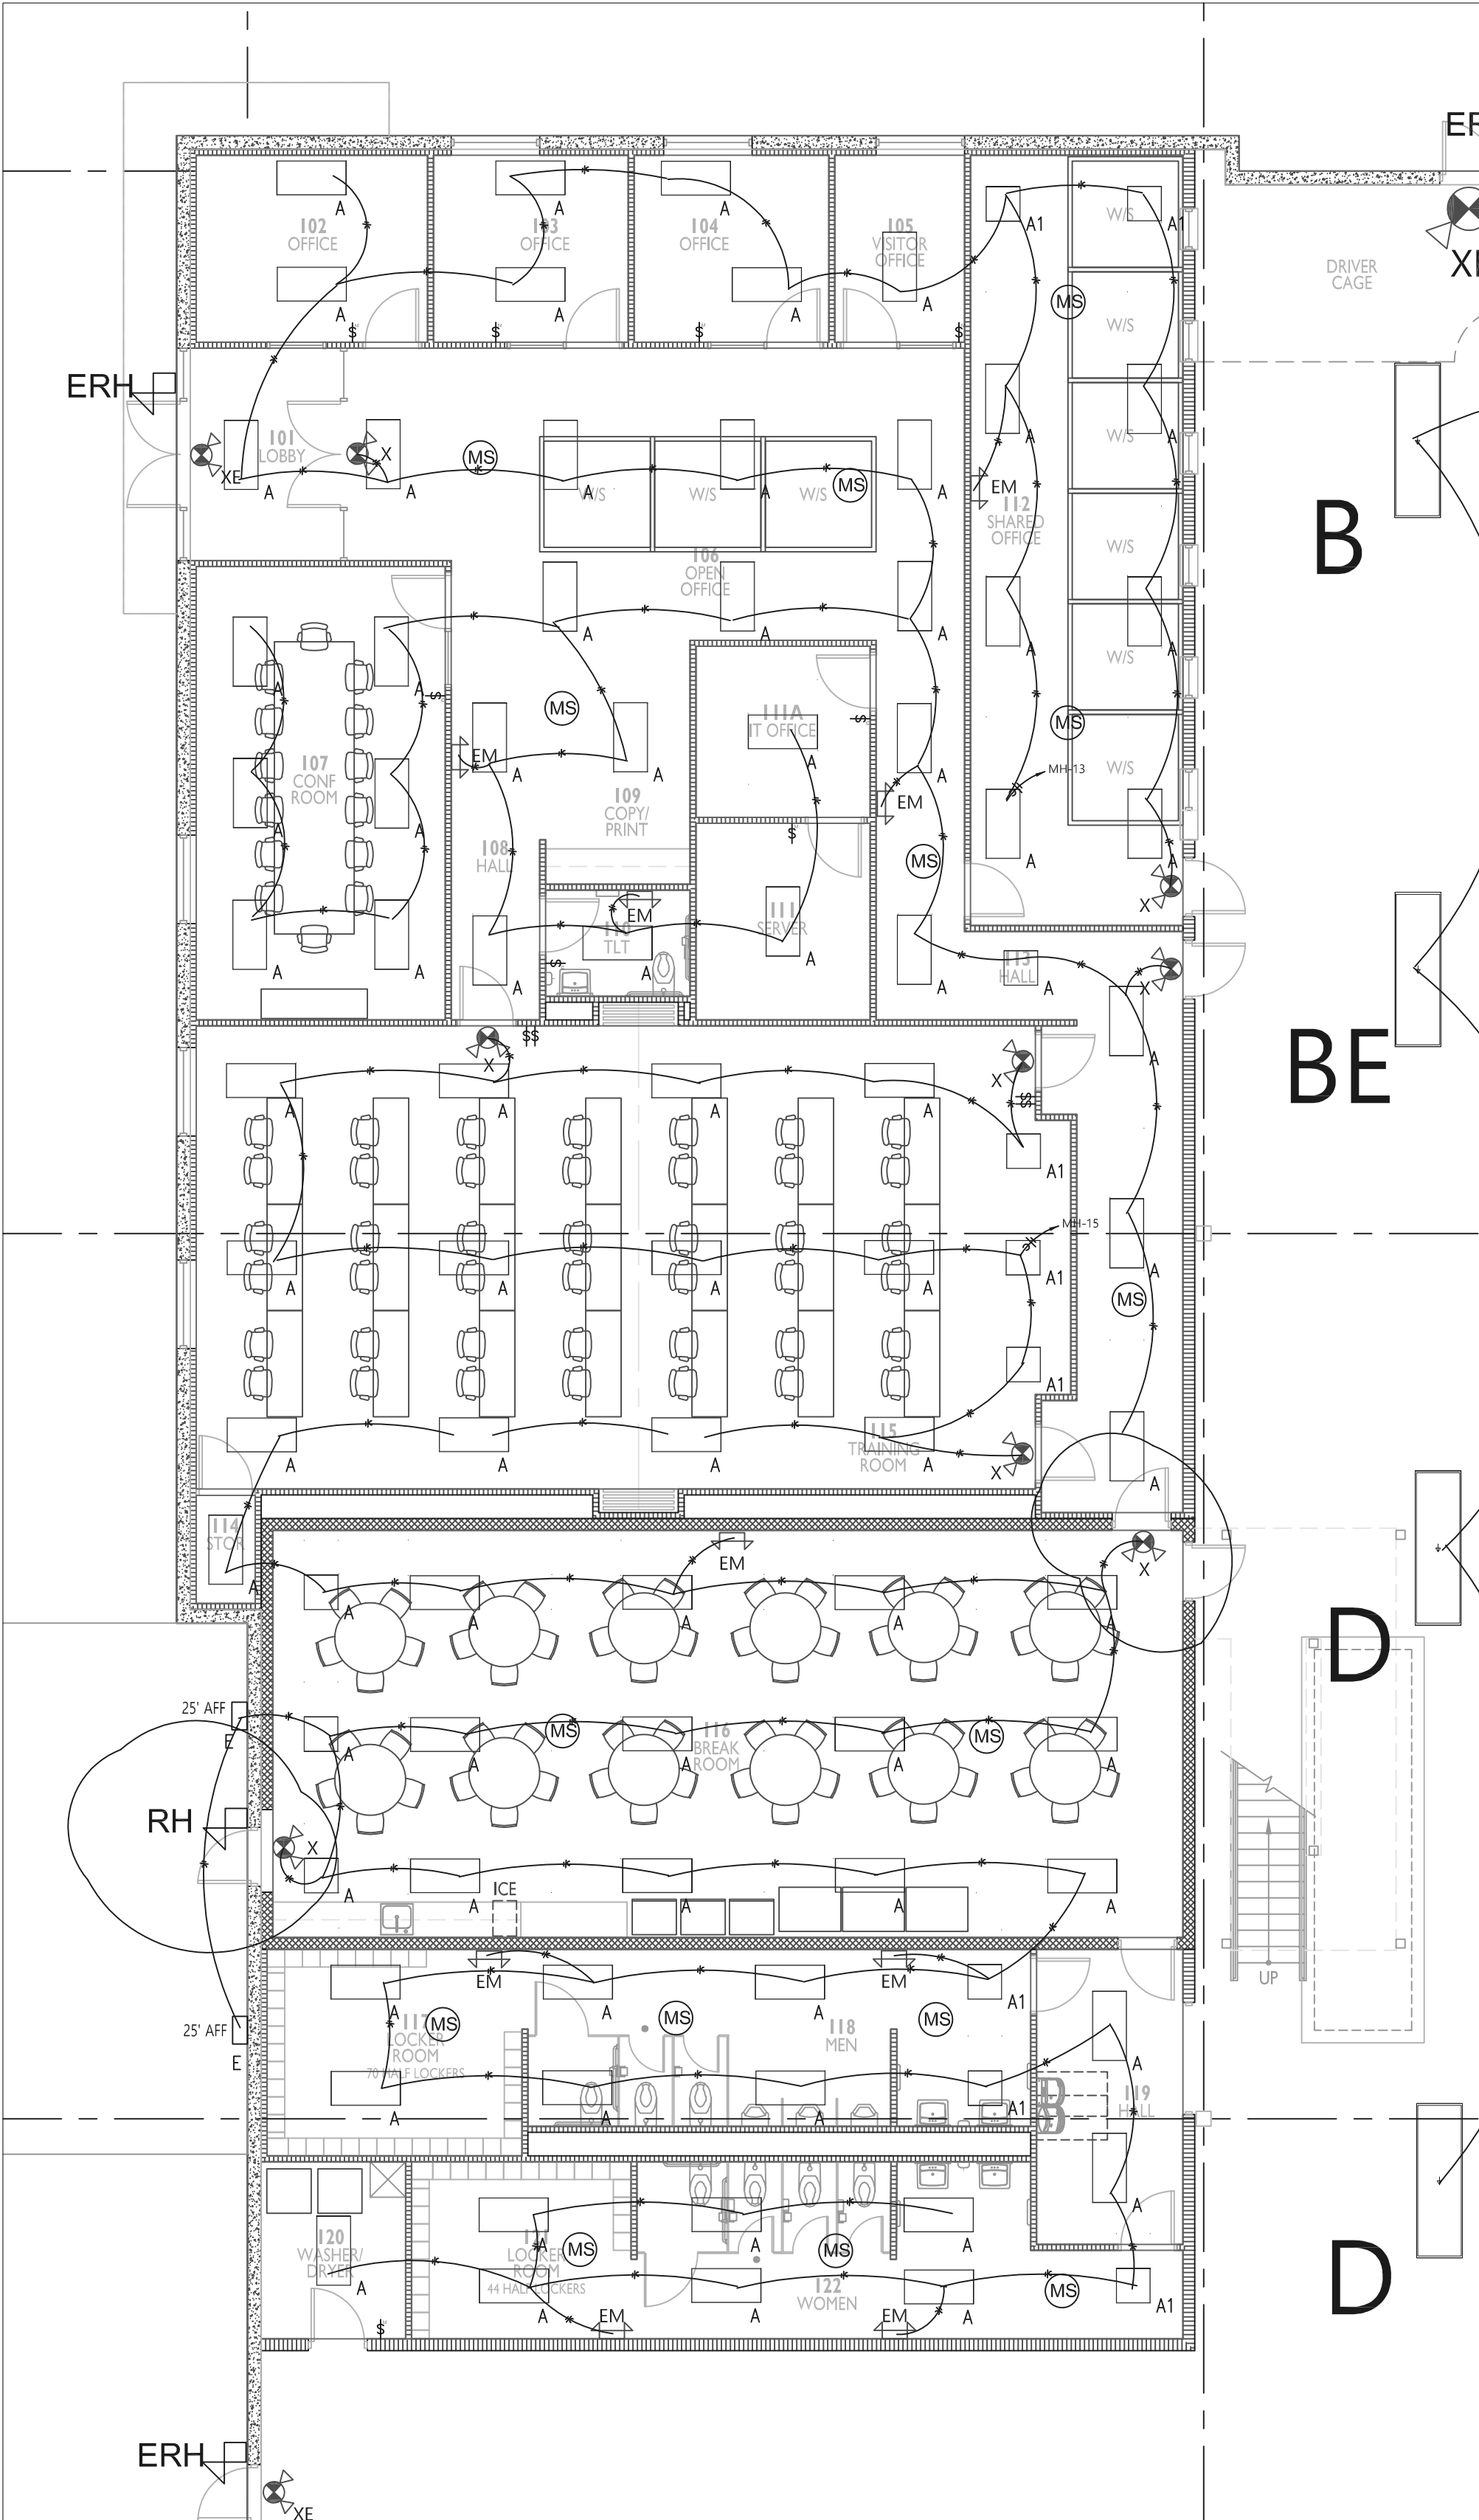


**1** Office lighting Plan  
scale: 1/8"=1'

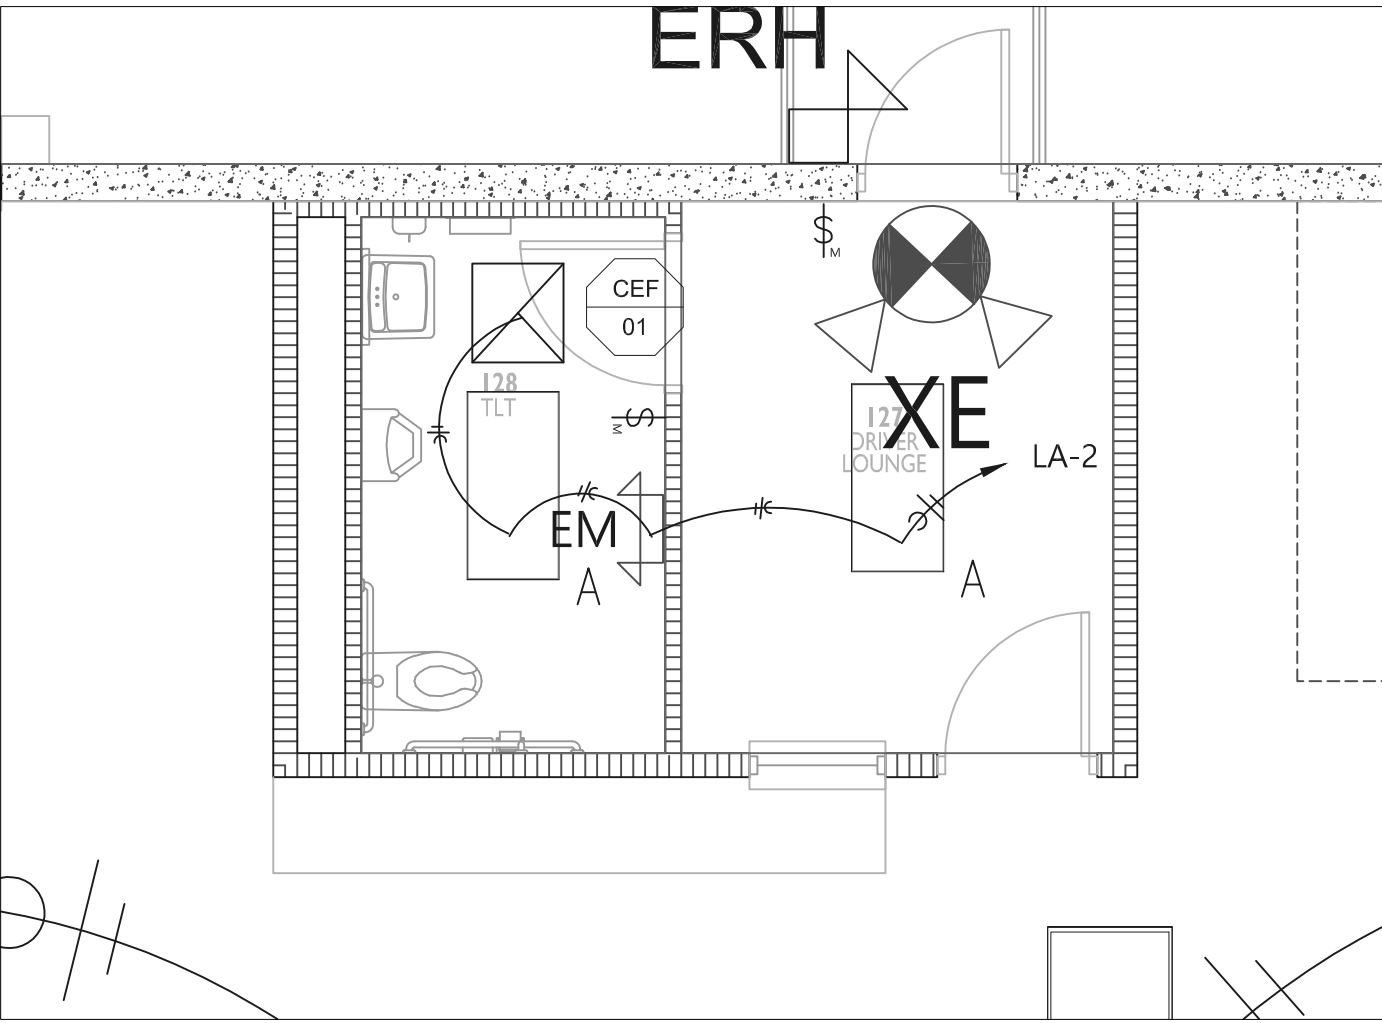

**2** Drivers Office lighting Plan  
scale: 1/4"=1'

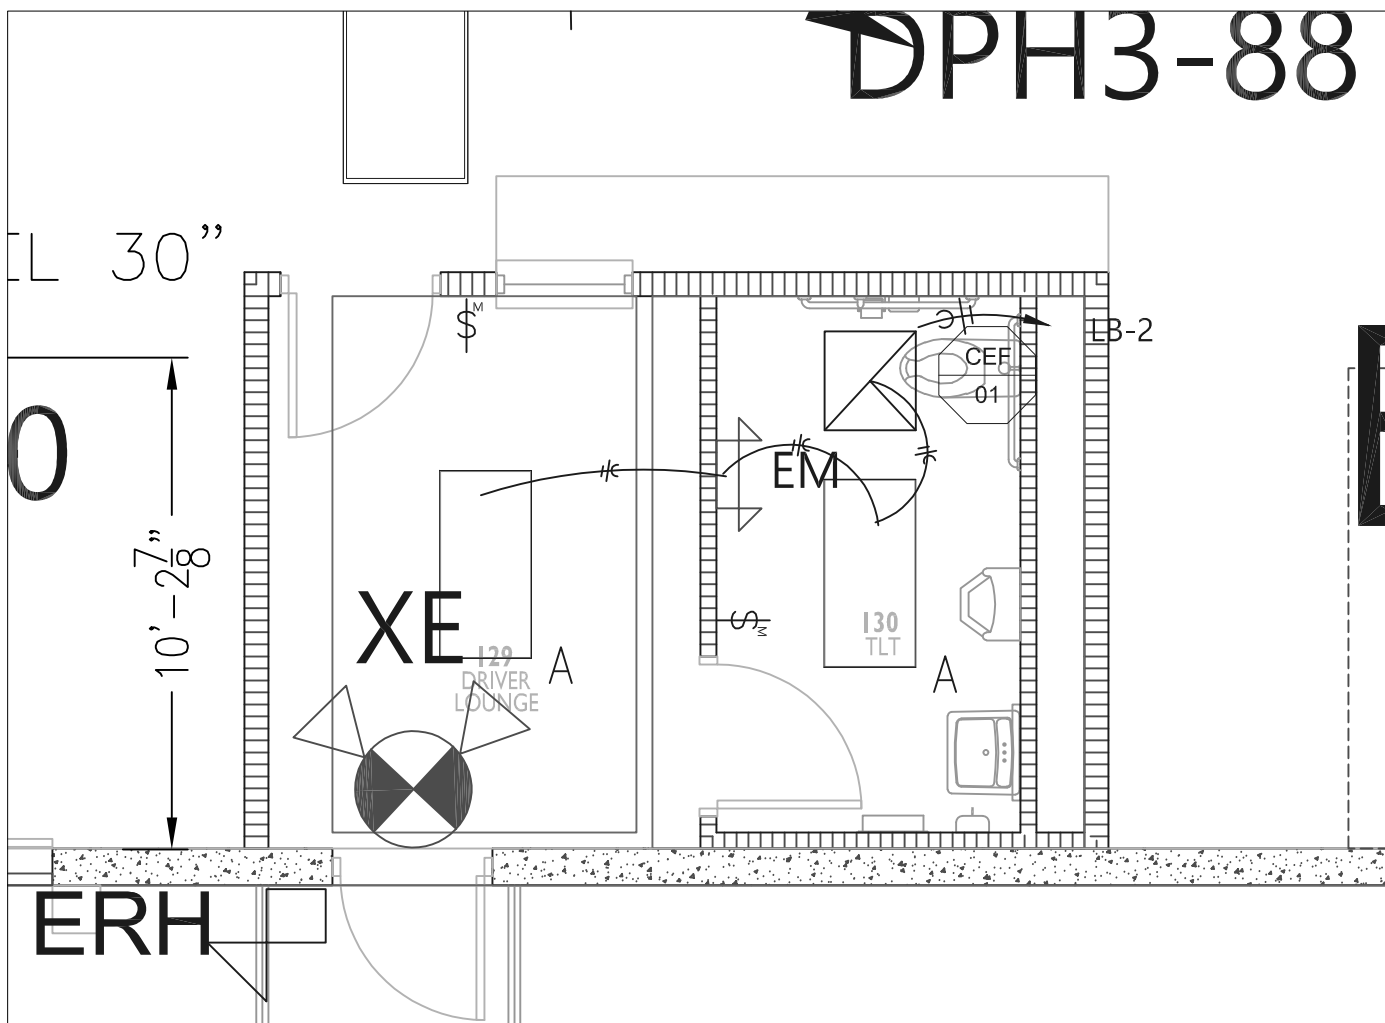

**3** Drivers Office lighting Plan  
scale: 1/4"=1'

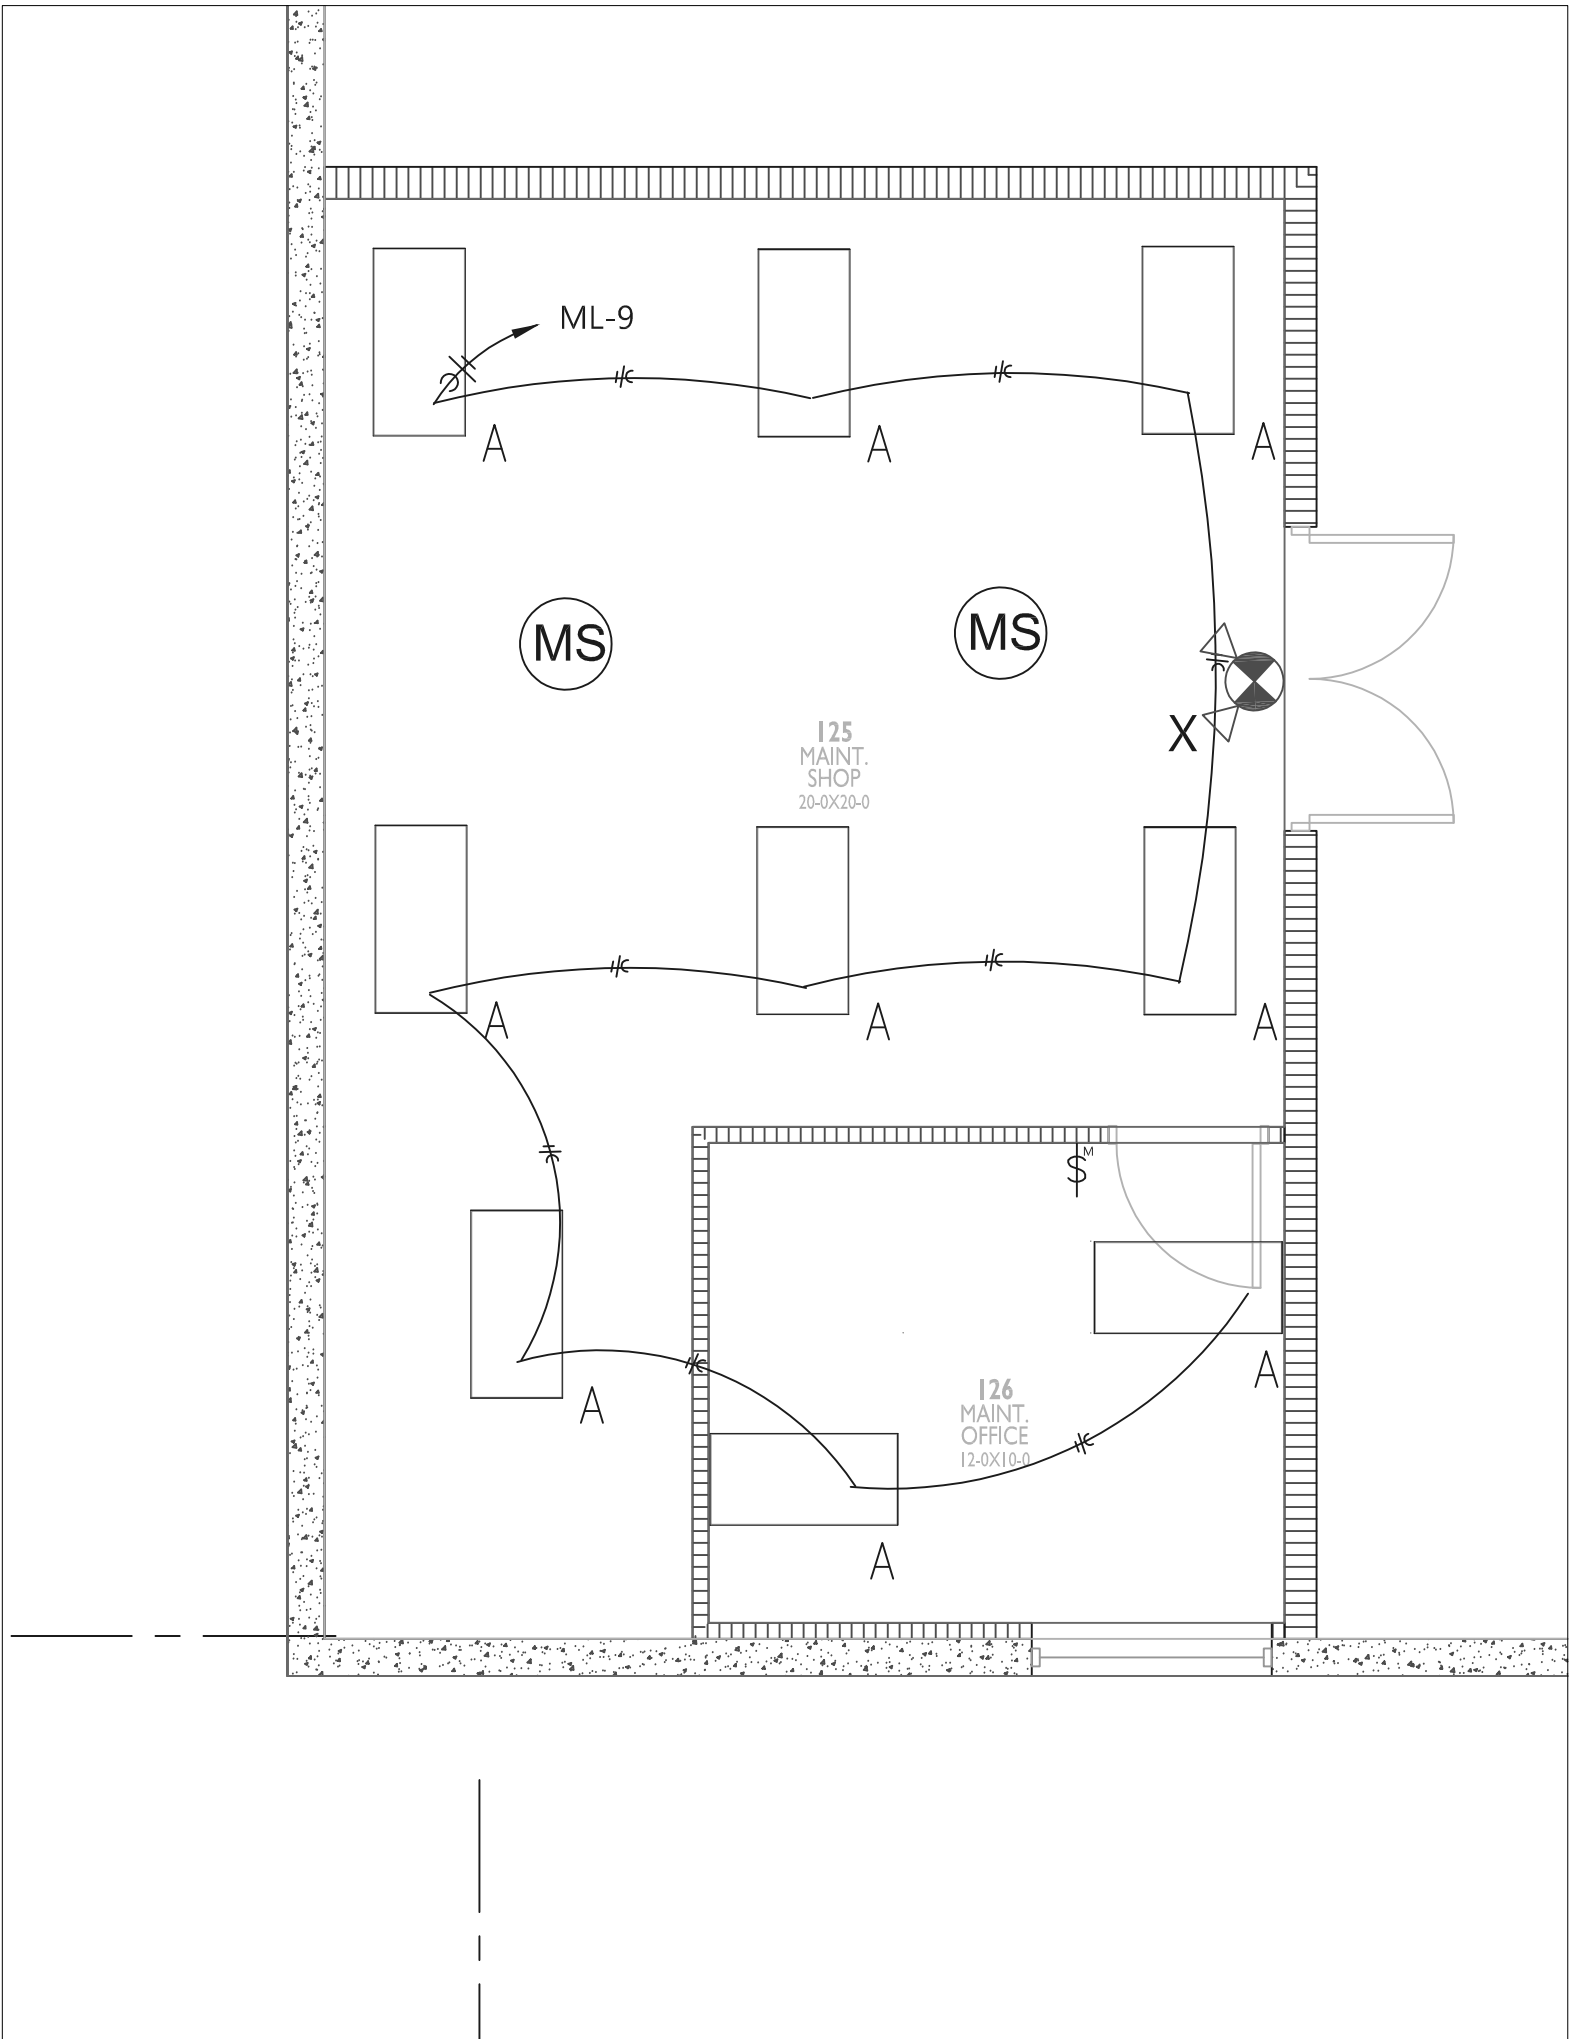

**4** Maintenance Office lighting Plan  
scale: 1/4"=1'



HERITAGE ELECTRIC, L.L.C.  
841 N. MARTWAY  
Olathe, Kansas  
phone (913) 747 0528  
fax (913) 747 0539




THIS DRAWING HAS BEEN PRODUCED BY HERITAGE ELECTRIC, LLC. FOR THEIR COORDINATION OF THE ELECTRICAL INSTALLATION AND MAY NOT BE USED FOR ANY OTHER PURPOSE.  
COPYRIGHT 2008, HERITAGE ELECTRIC, LLC.  
THE SEAL OF THE ELECTRICAL P.E. APPLIES TO ONLY THIS DRAWING. SPECIFICATIONS AND OTHER DOCUMENTS BEARING THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL AND DISCLAIM ANY RESPONSIBILITY FOR ALL OTHER DRAWINGS, SPECIFICATIONS, ESTIMATES, REPORTS OR OTHER DOCUMENTS WHICH DO NOT CONTAIN THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL.






**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

CERTIFICATION

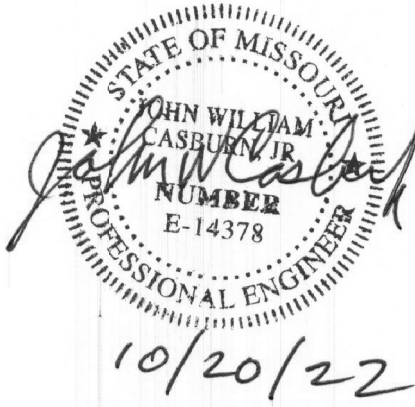

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES

PERMIT SET	02.18.22
CITY COMMENTS	10.17.22



HERITAGE ELECTRIC, L.L.C.  
841 N. MARTWAY  
Olathe, Kansas  
phone (913) 747 0528  
fax (913) 747 0539


THIS DRAWING HAS BEEN PRODUCED BY HERITAGE ELECTRIC, LLC. FOR THEIR COORDINATION OF THE ELECTRICAL INSTALLATION AND MAY NOT BE USED FOR ANY OTHER PURPOSE.  
COPYRIGHT 2008, HERITAGE ELECTRIC, LLC.

THE SEAL OF THE ELECTRICAL P.E. APPLIES TO ONLY THIS DRAWING, SPECIFICATIONS AND OTHER DOCUMENTS BEARING THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL AND DISCLAIM ANY RESPONSIBILITY FOR ALL OTHER DRAWINGS, SPECIFICATIONS, ESTIMATES, REPORTS OR OTHER DOCUMENTS WHICH DO NOT CONTAIN THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL.

210300

WAREHOUSE POWER

**E2.0**

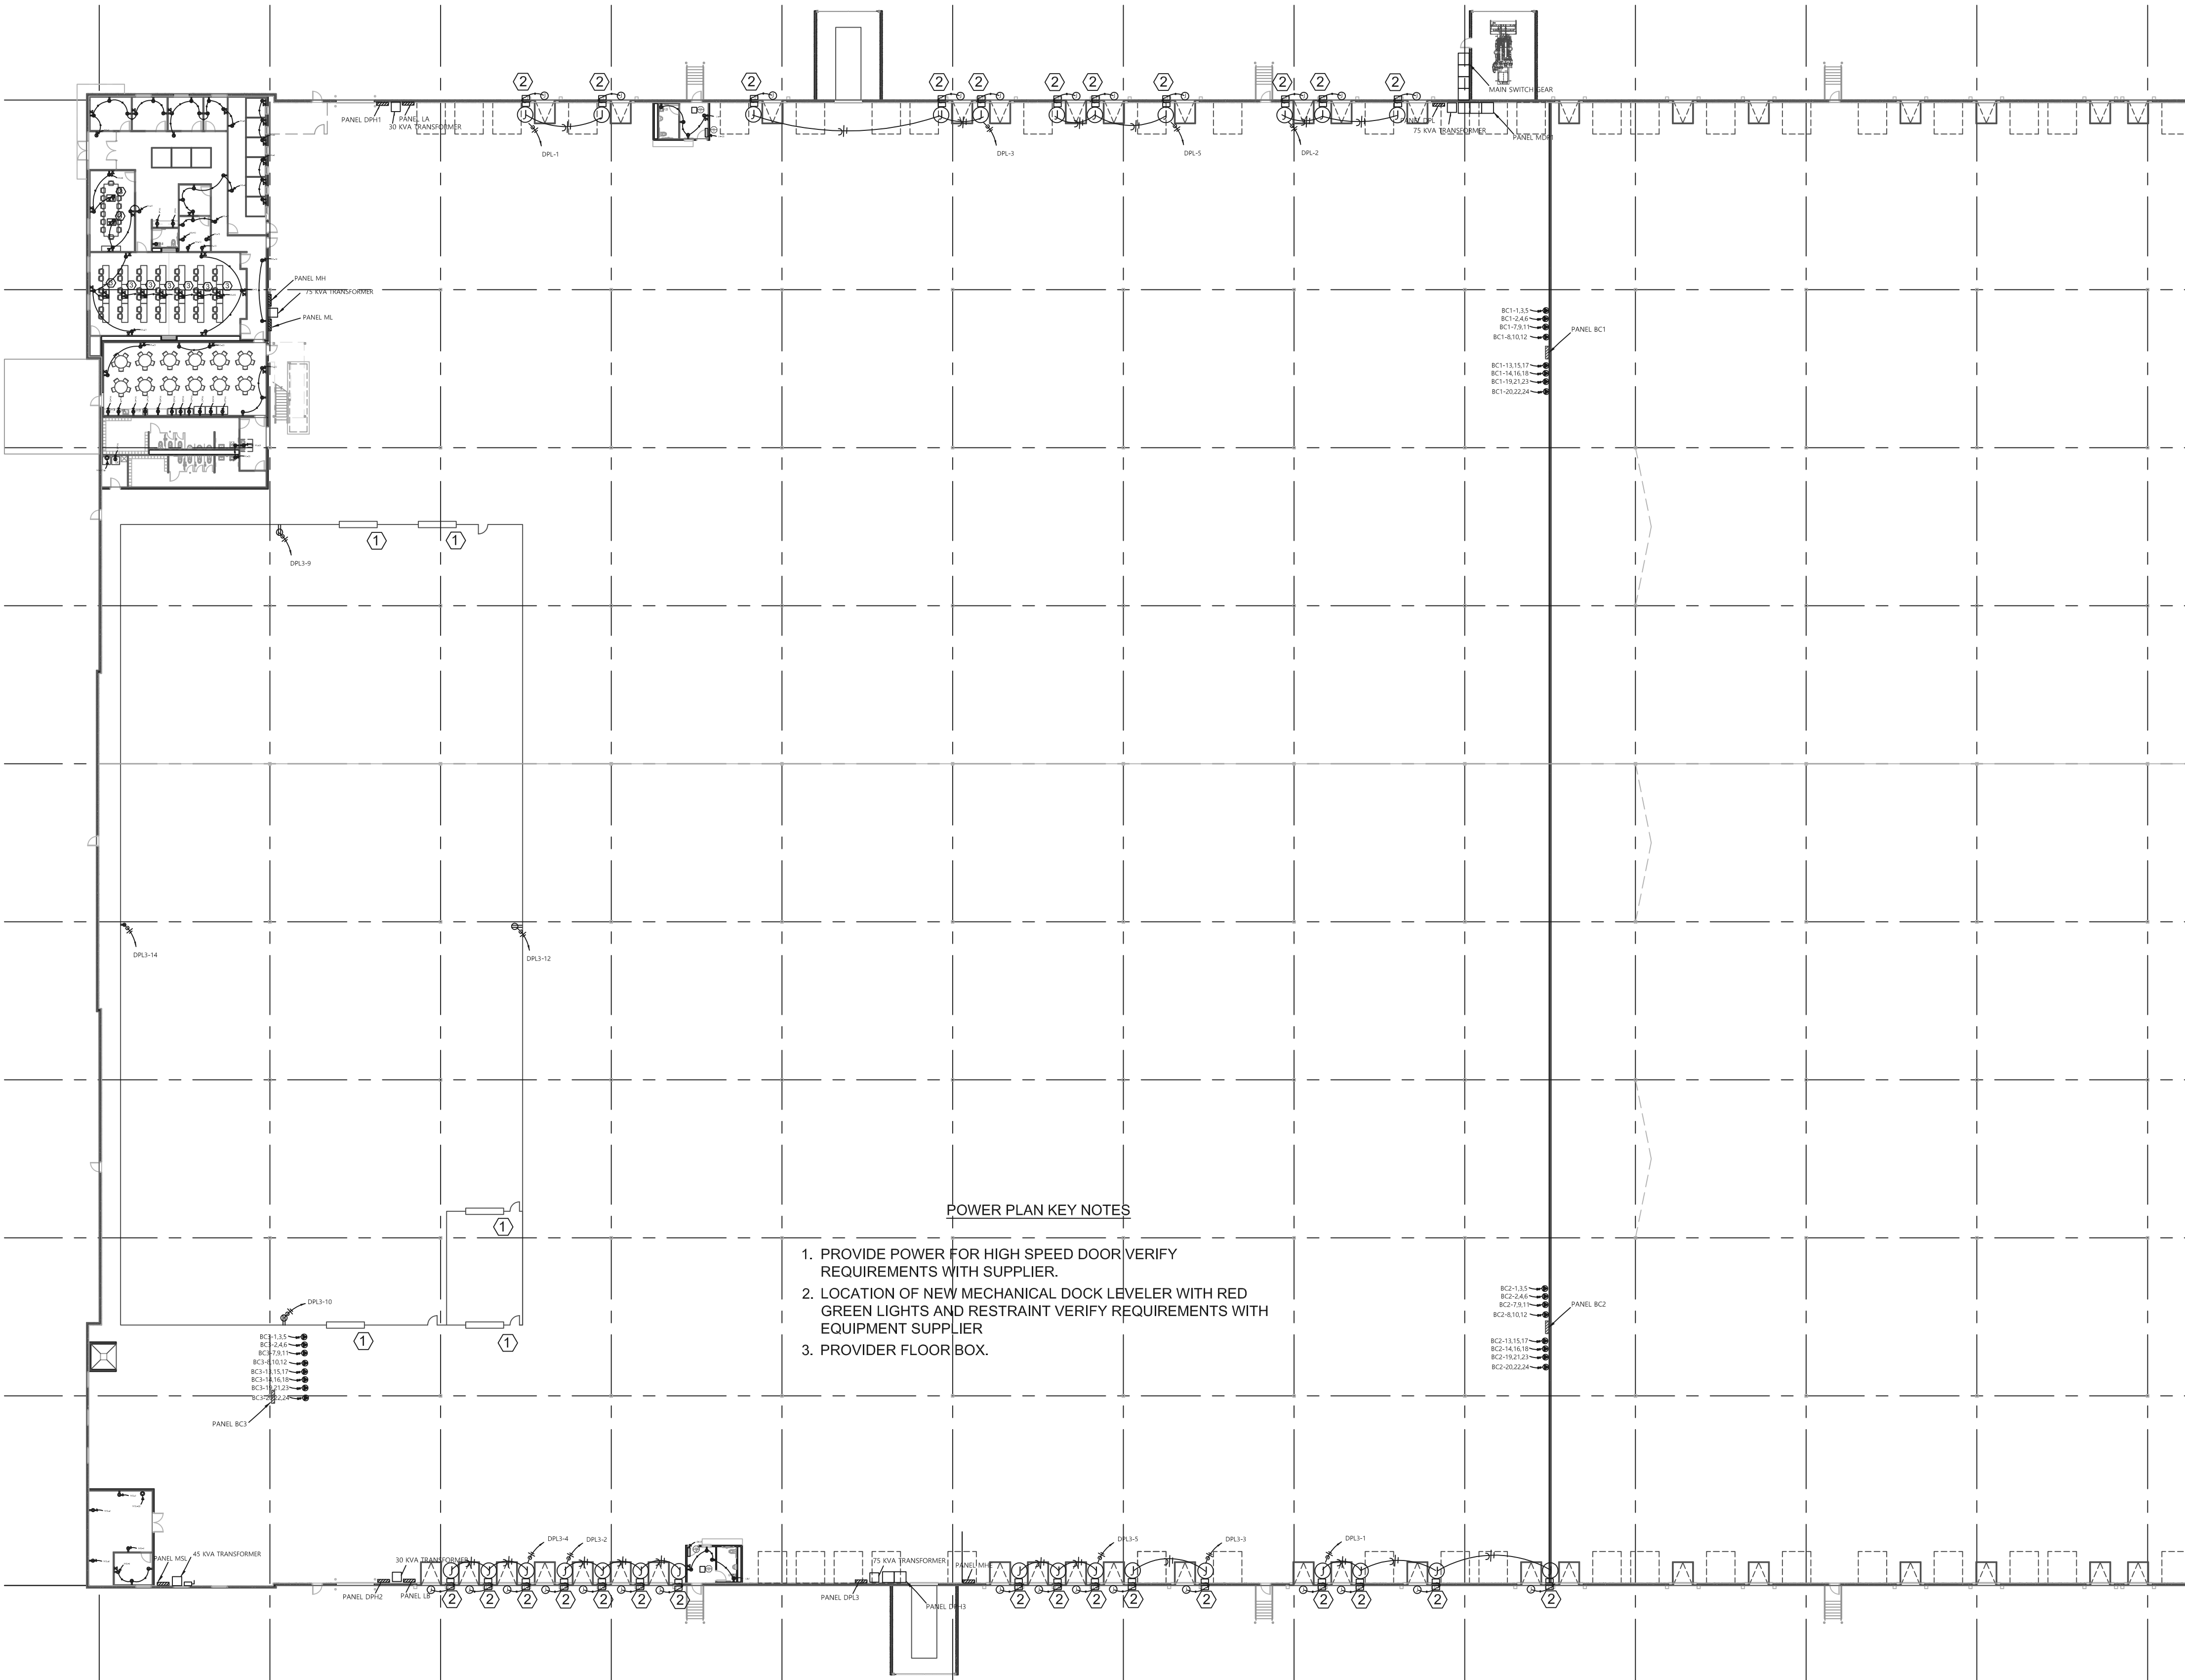

**1 Warehouse Power Plan**  
scale: 1"=30'









**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

CERTIFICATION

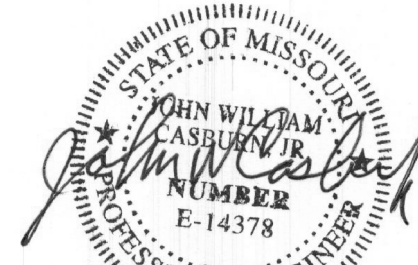

10/20/22

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE. © COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT 1

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


ISSUE DATES

PERMIT SET	02.18.22
CITY COMMENTS	10.17.22



210300

OFFICE POWER


**E2.1**

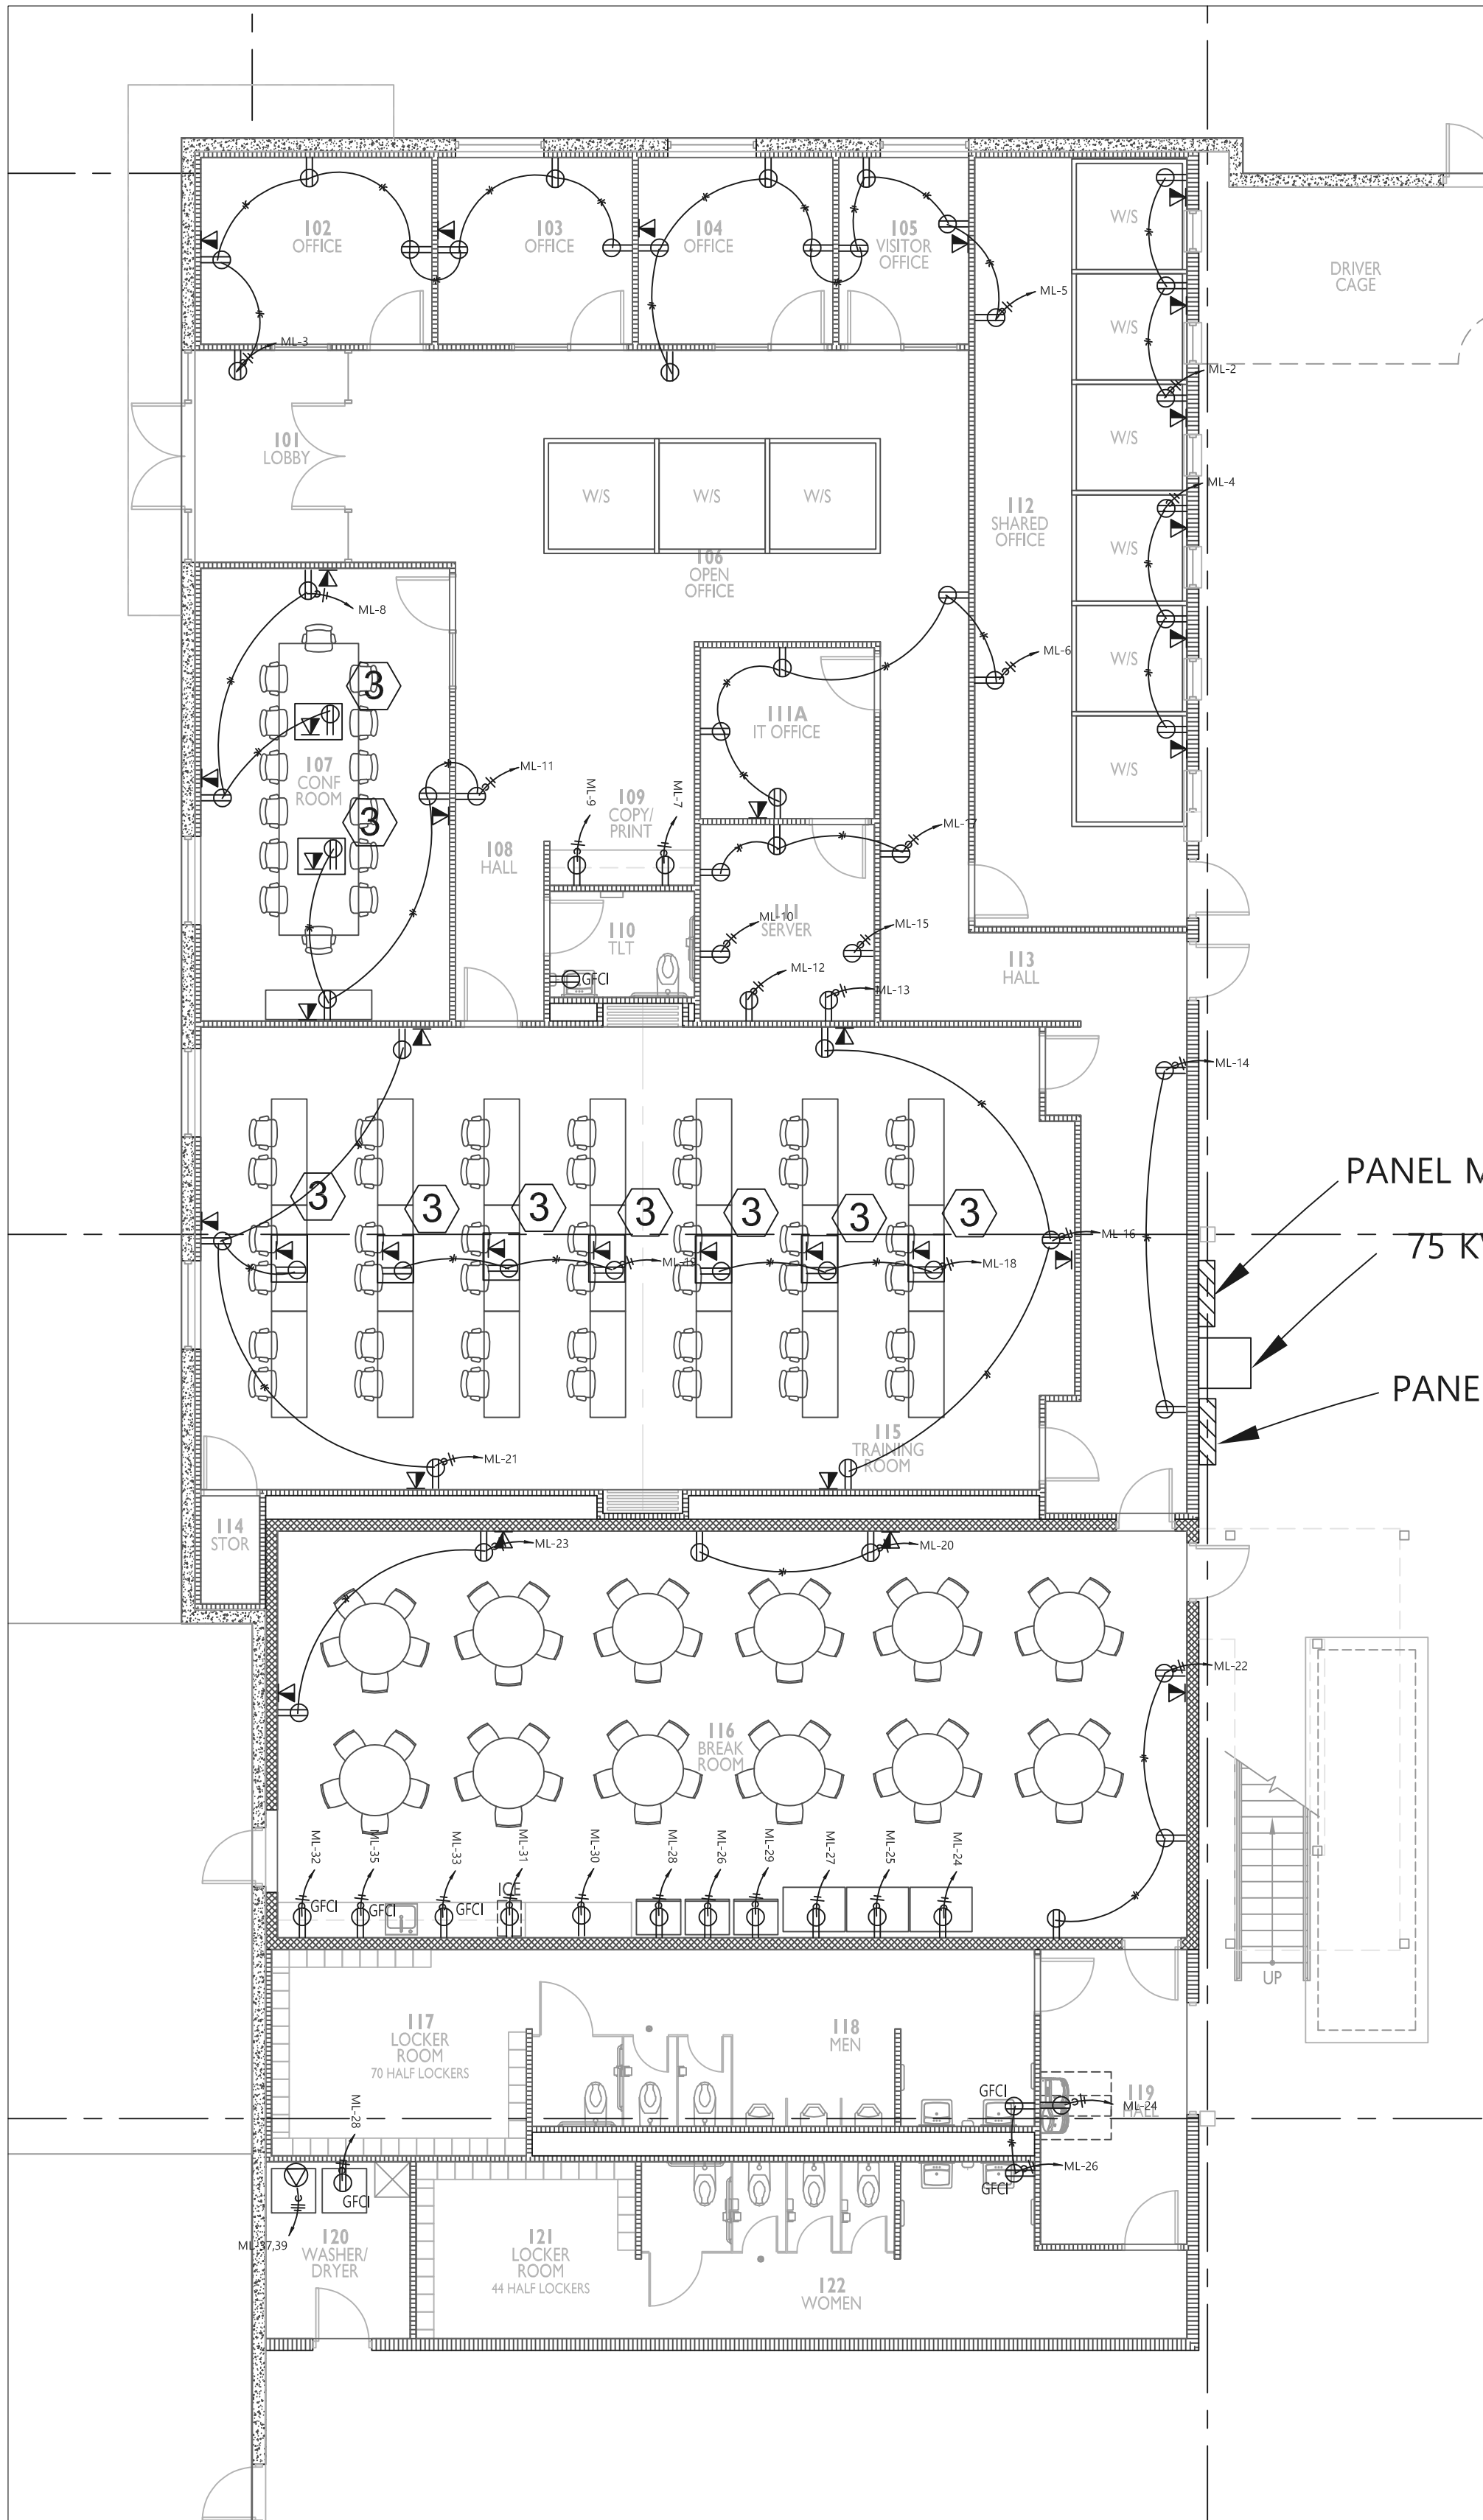


**1 Office Power Plan**  
scale: 1/8"=1'

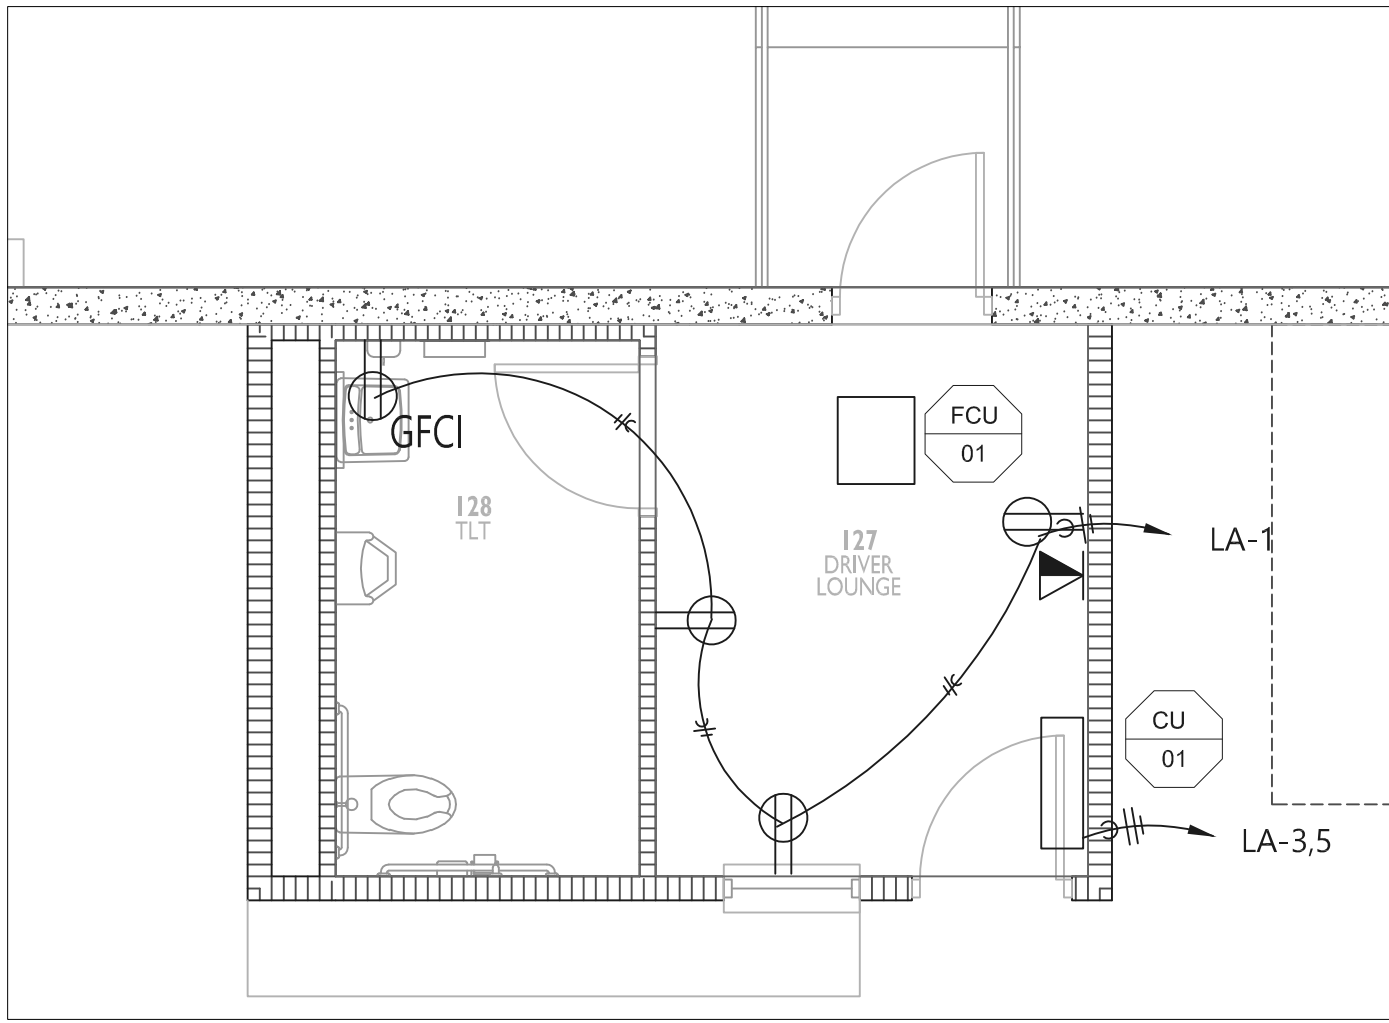

**2 Drivers Office Power Plan**  
scale: 1/4"=1'

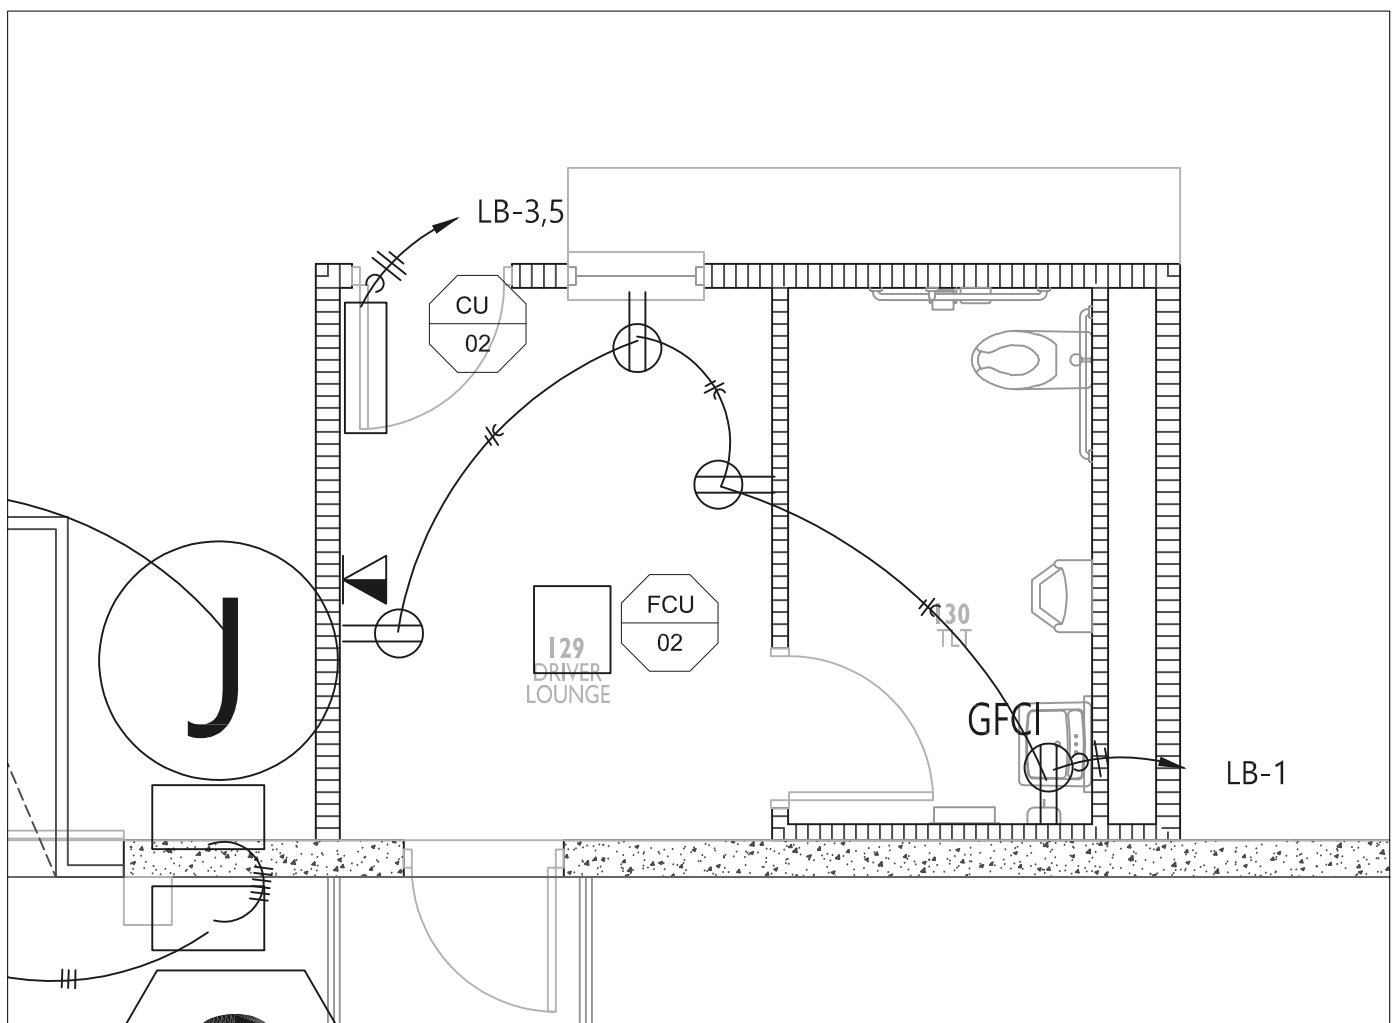

**3 Drivers Office Power Plan**  
scale: 1/4"=1'

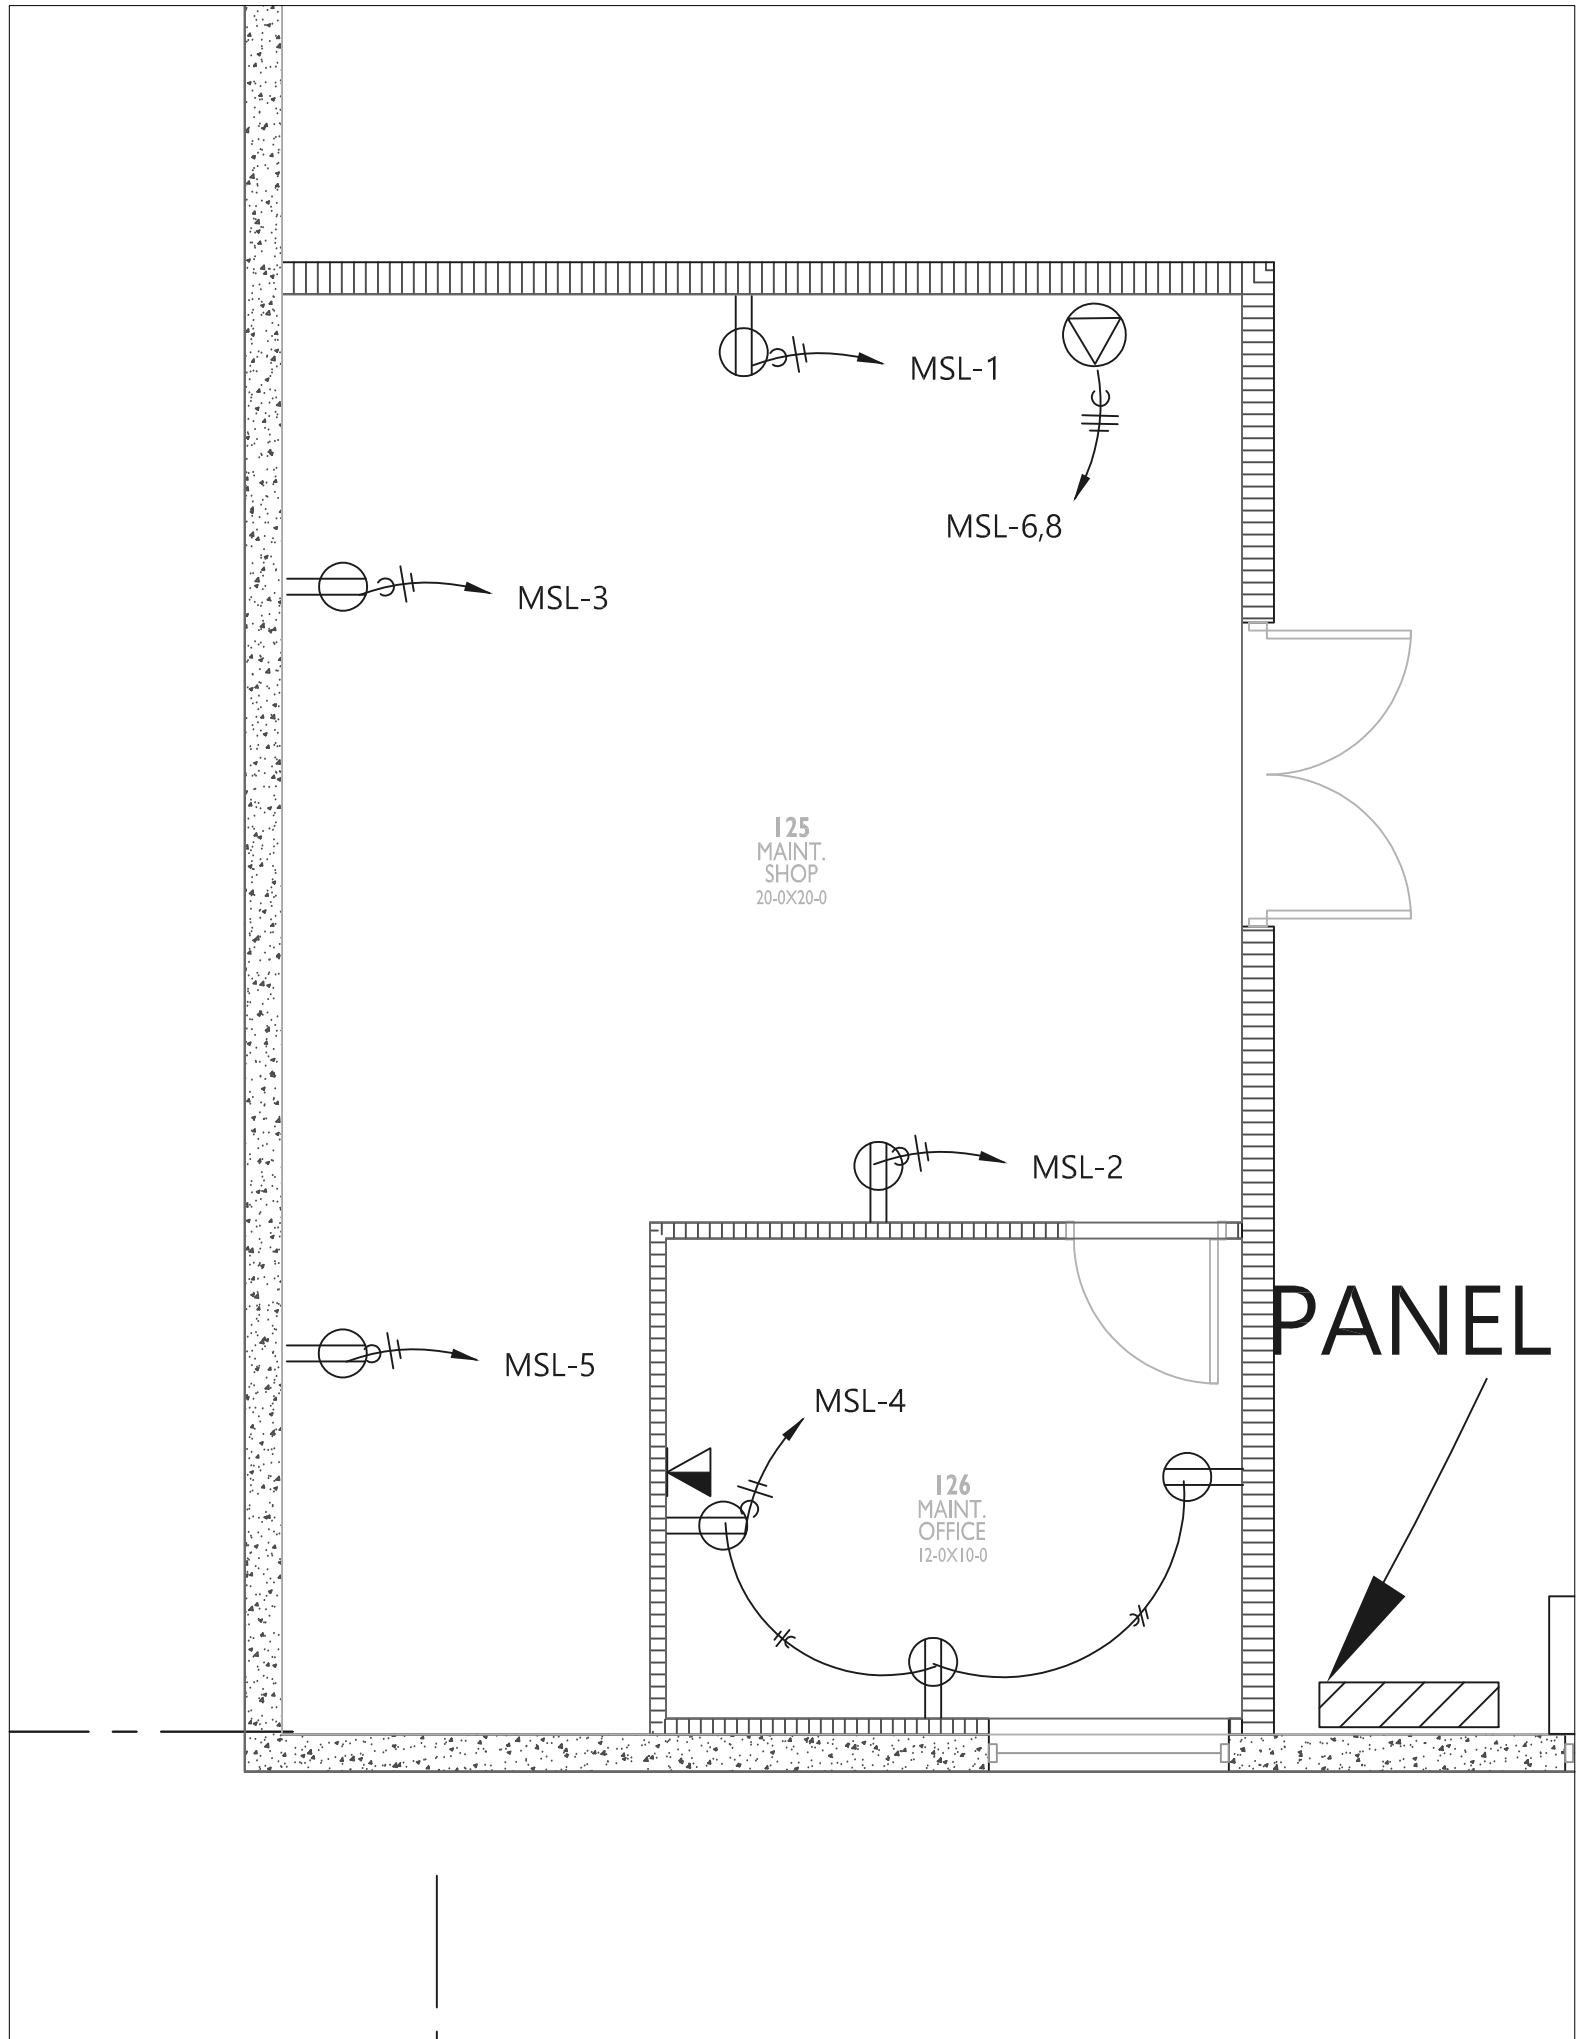

**4 Maintenance Office Power Plan**  
scale: 1/4"=1'



HERITAGE ELECTRIC, L.L.C.  
841 N. MARTWAY  
Olathe, Kansas  
phone (913) 747 0528  
fax (913) 747 0539



THIS DRAWING HAS BEEN PRODUCED BY HERITAGE ELECTRIC, L.L.C. FOR THEIR COORDINATION OF THE ELECTRICAL INSTALLATION AND MAY NOT BE USED FOR ANY OTHER PURPOSE. COPYRIGHT 2008, HERITAGE ELECTRIC, L.L.C.

THE SEAL OF THE ELECTRICAL P.E. APPLIES TO ONLY THIS DRAWING. SPECIFICATIONS AND OTHER DOCUMENTS BEARING THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL AND DISCLAIM ANY RESPONSIBILITY FOR ALL OTHER DRAWINGS, SPECIFICATIONS, ESTIMATES, REPORTS OR OTHER DOCUMENTS WHICH DO NOT CONTAIN THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL.






5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



## CERTIFICATION

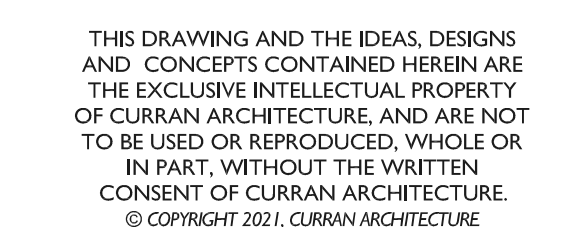

## PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT 1

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

## ISSUE DATES

PERMIT SET	02.18.22
CITY COMMENTS	10.17.22

HERITAGE ELECTRIC, L.L.C.  
841 N. MARTWAY  
Olathe, Kansas  
phone (913) 747 0528  
fax (913) 747 0539




THIS DRAWING HAS BEEN PRODUCED BY HERITAGE  
ELECTRIC, LLC. FOR THEIR COORDINATION OF THE  
ELECTRICAL INSTALLATION AND MAY NOT BE USED  
FOR ANY OTHER PURPOSE  
COPYRIGHT 2008, HERITAGE ELECTRIC, LLC

THE SEAL OF THE ELECTRICAL P.E. APPLIES TO ONLY THIS DRAWING, SPECIFICATIONS AND OTHER DOCUMENTS BEARING THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL AND DISCLAIM ANY RESPONSIBILITY FOR ALL OTHER DRAWINGS, SPECIFICATIONS, ESTIMATES, REPORTS OR OTHER DOCUMENTS WHICH DO NOT CONTAIN THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL.

210300

HVAC POWER

## E3.0

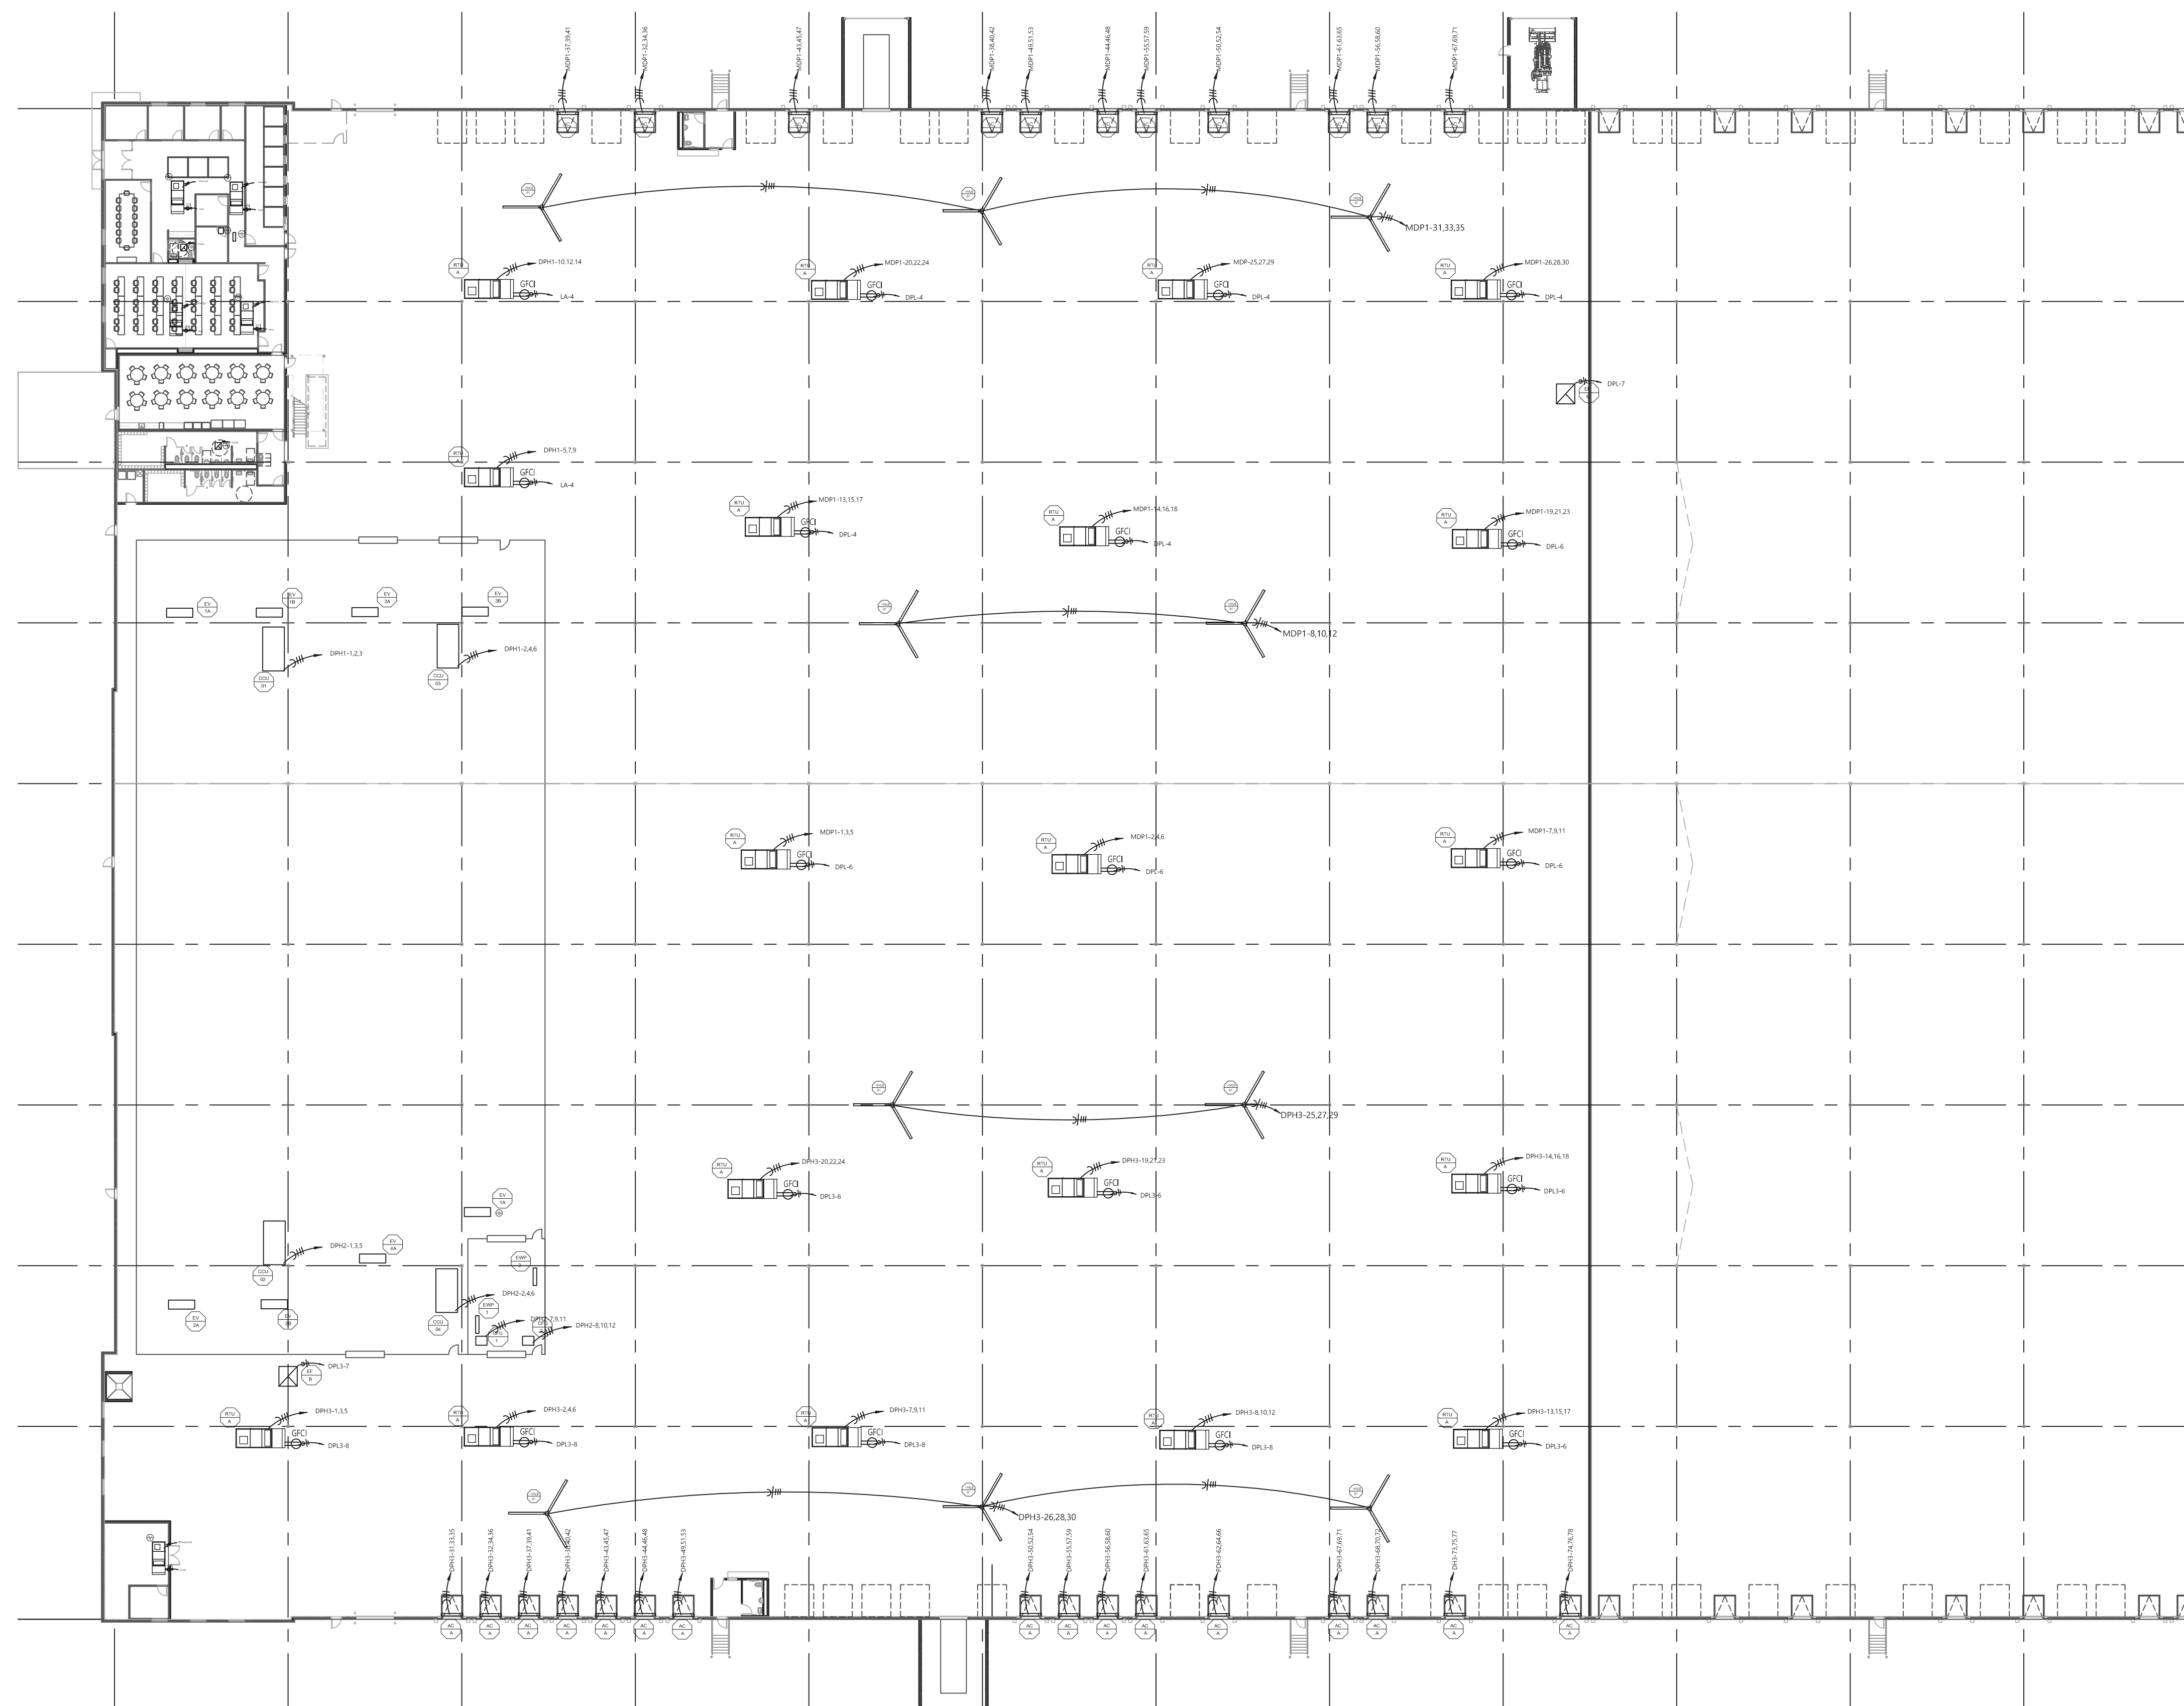


# 1 Warehouse HVAC Plan




THIS DRAWING HAS BEEN PRODUCED BY HERITAGE  
ELECTRIC, LLC. FOR THEIR COORDINATION OF THE  
ELECTRICAL INSTALLATION AND MAY NOT BE USED  
FOR ANY OTHER PURPOSE  
COPYRIGHT 2008, HERITAGE ELECTRIC, LLC




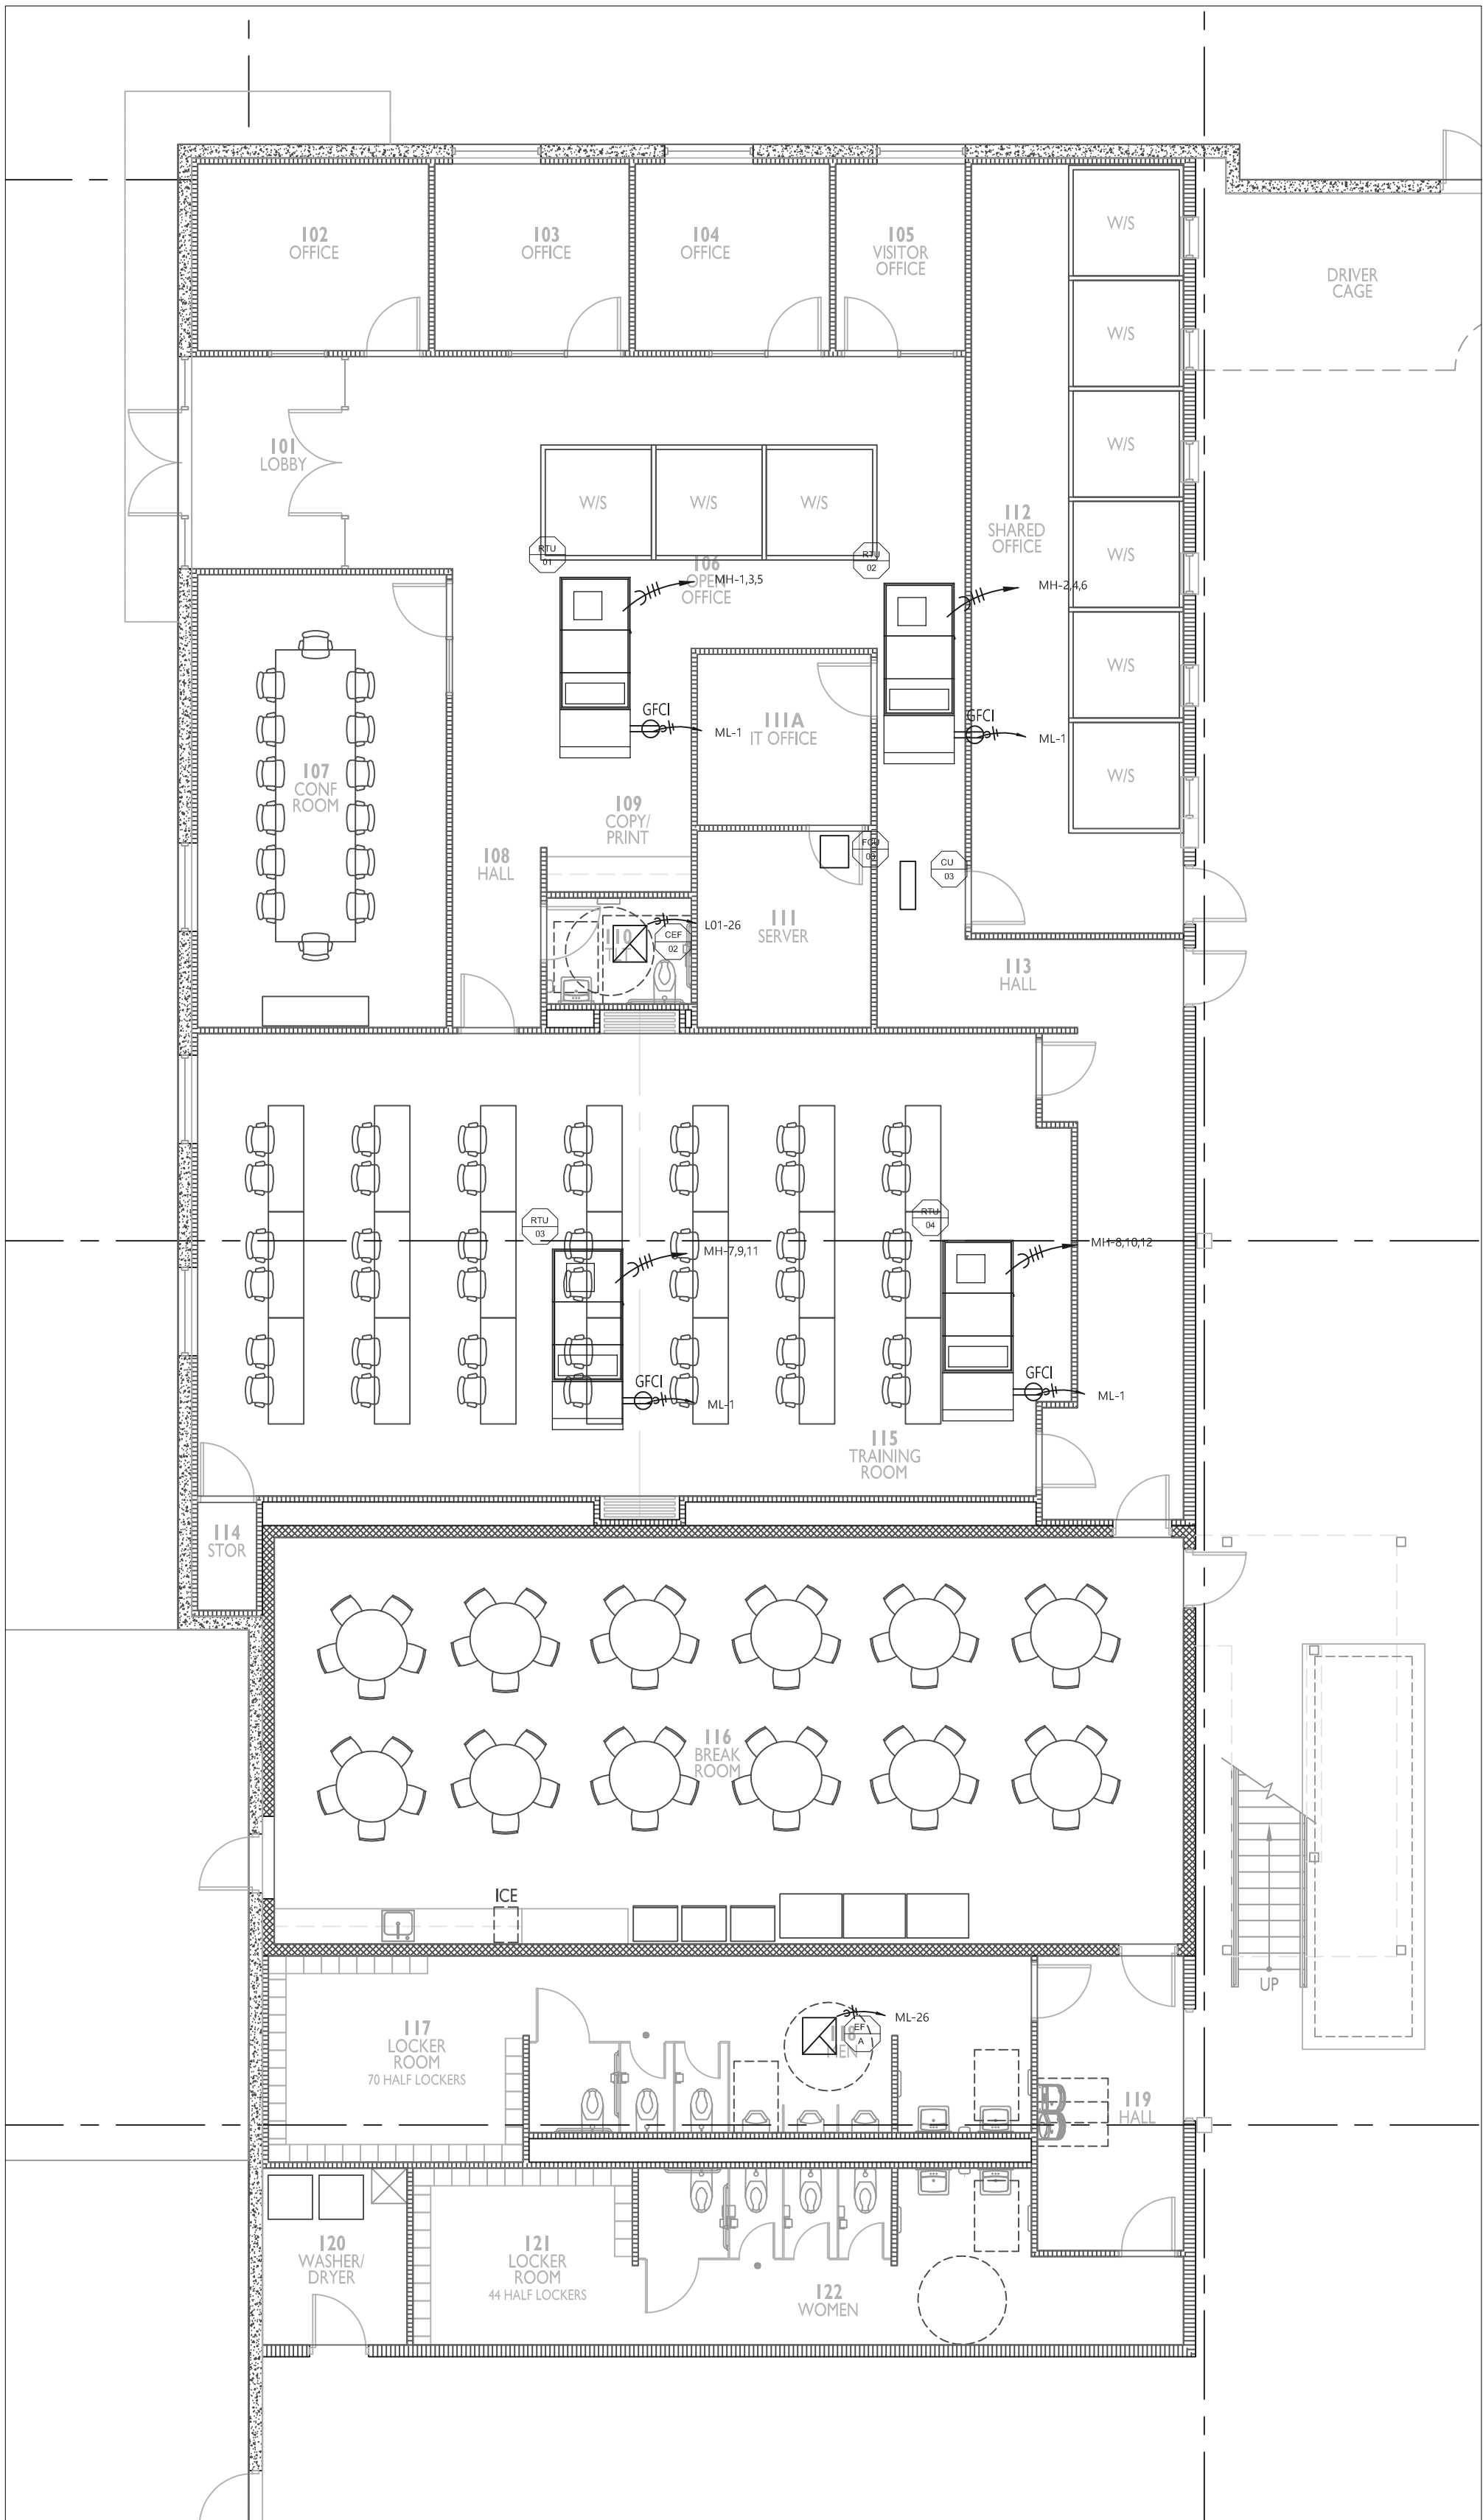

1 Office HVAC Power  
scale: 1/8"=1'

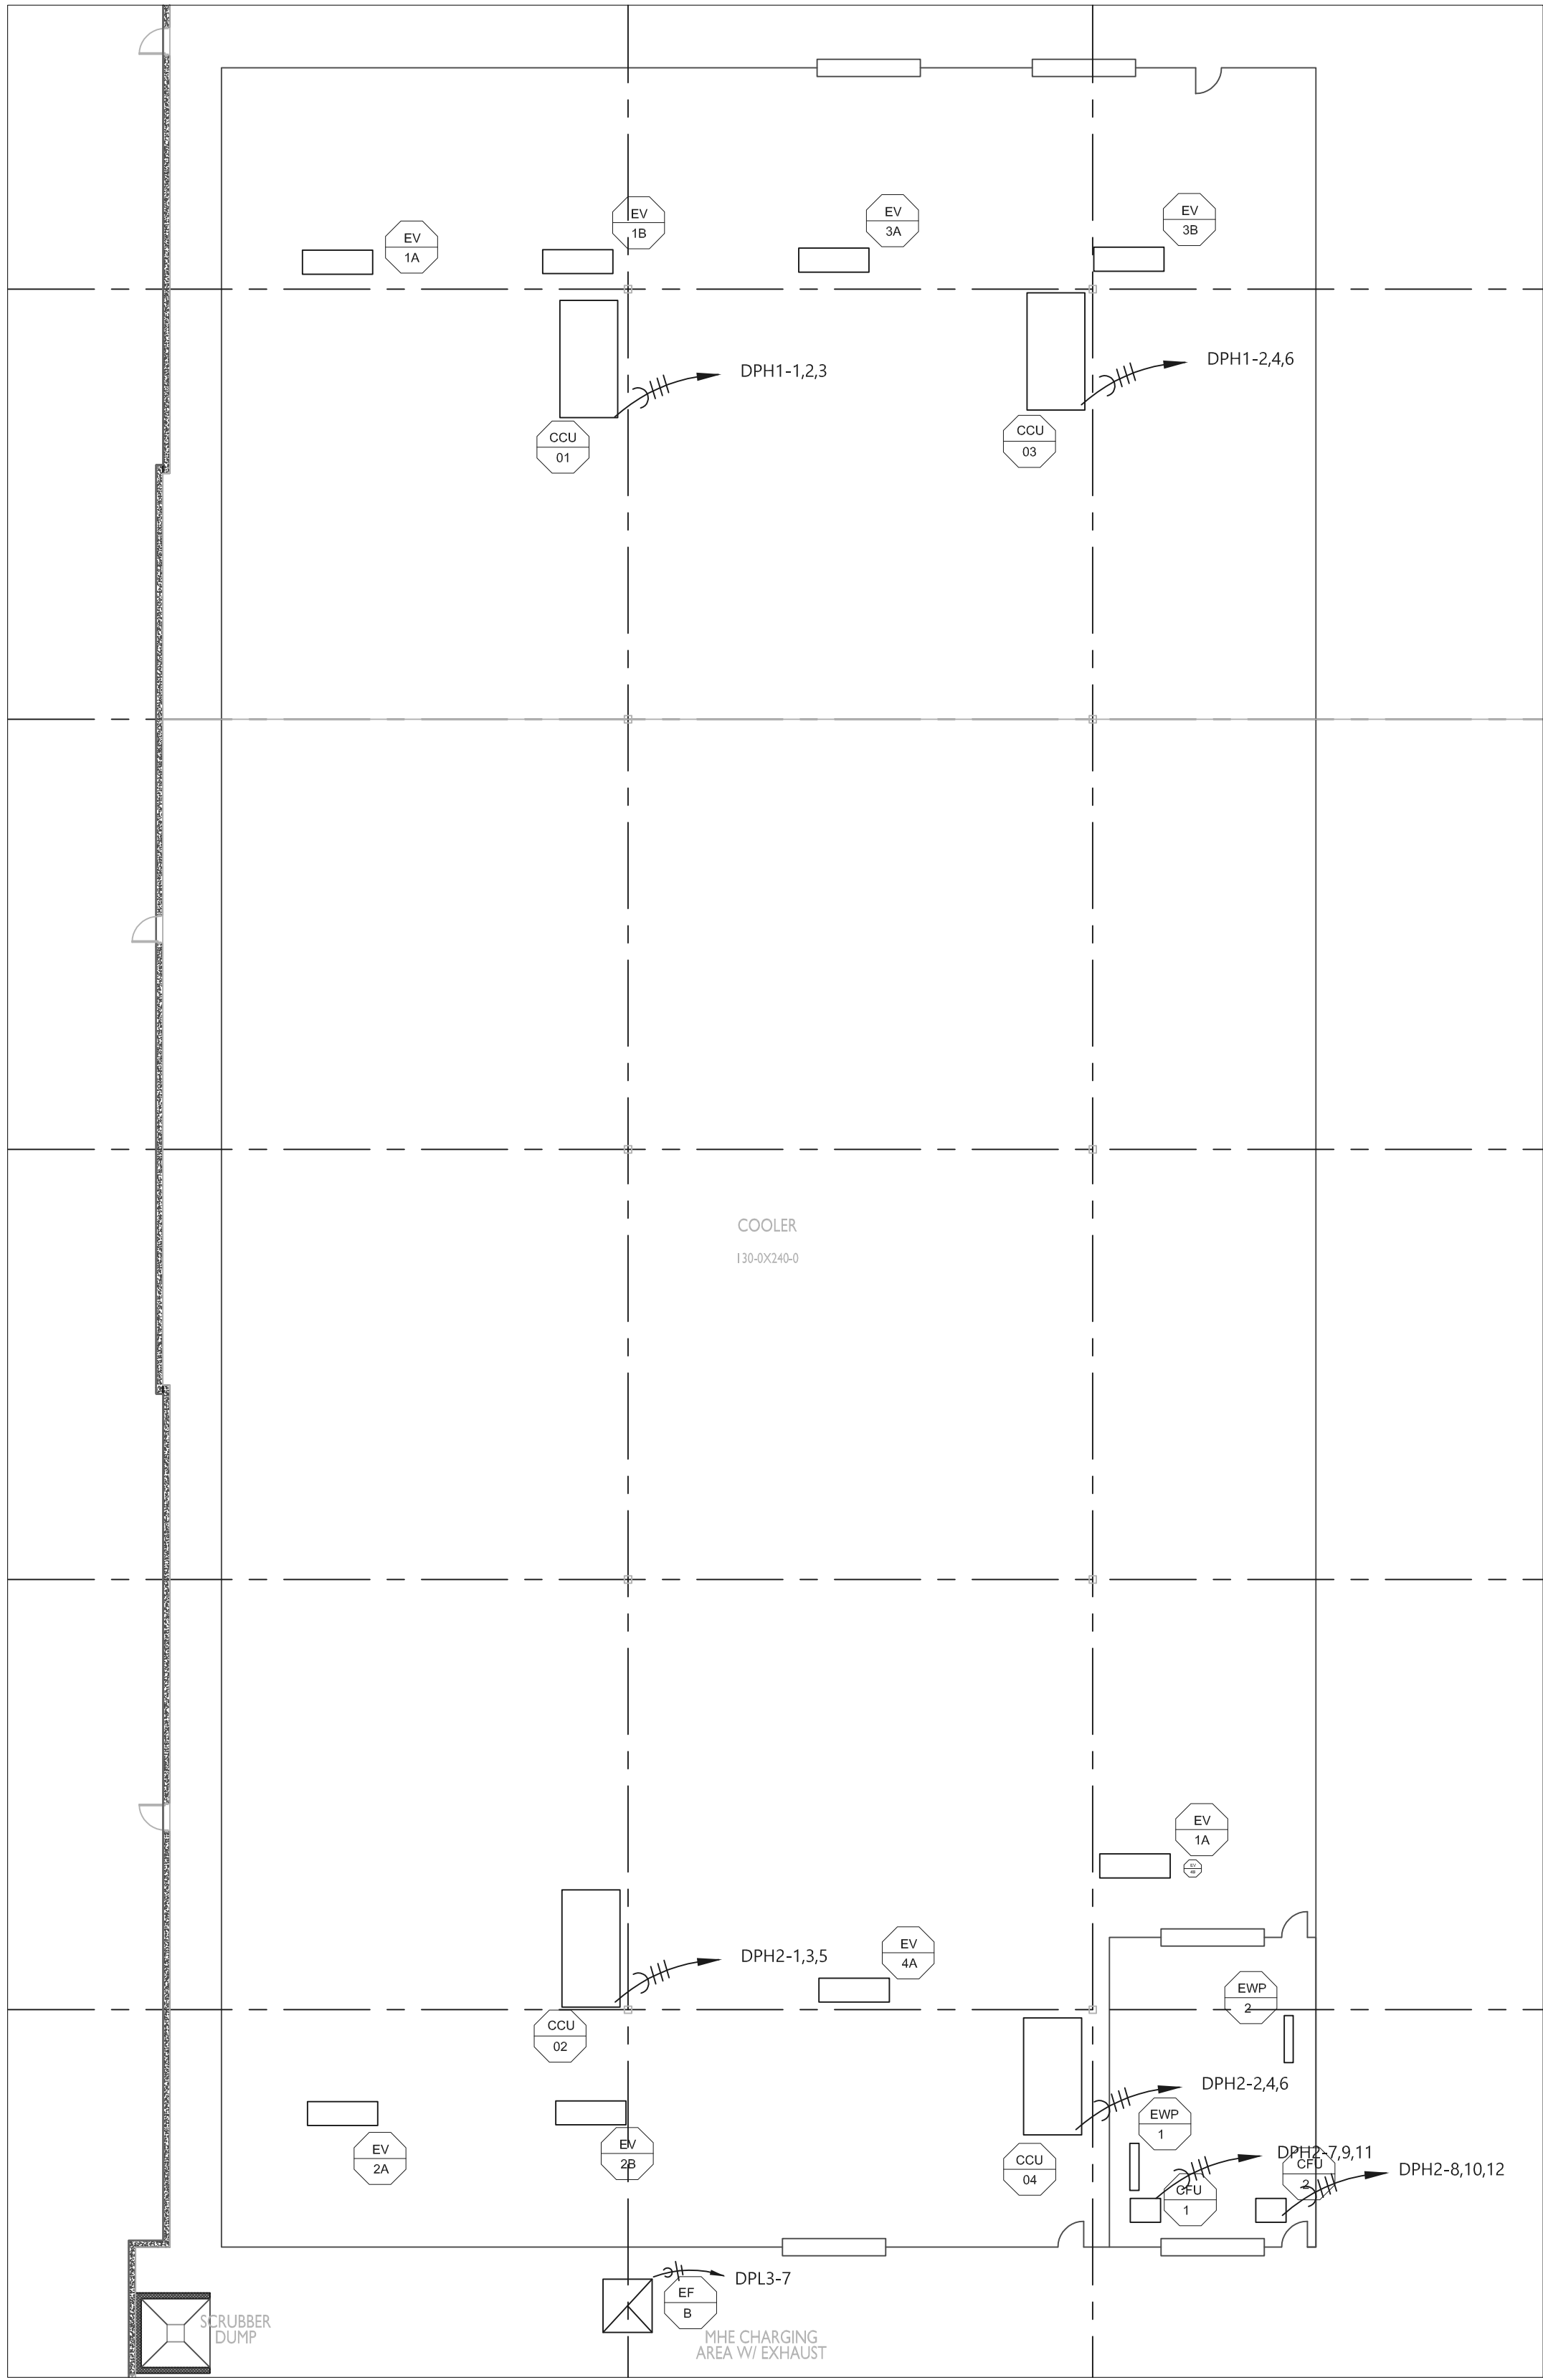


2 Cooler HVAC Power  
scale: 1/8"=1'

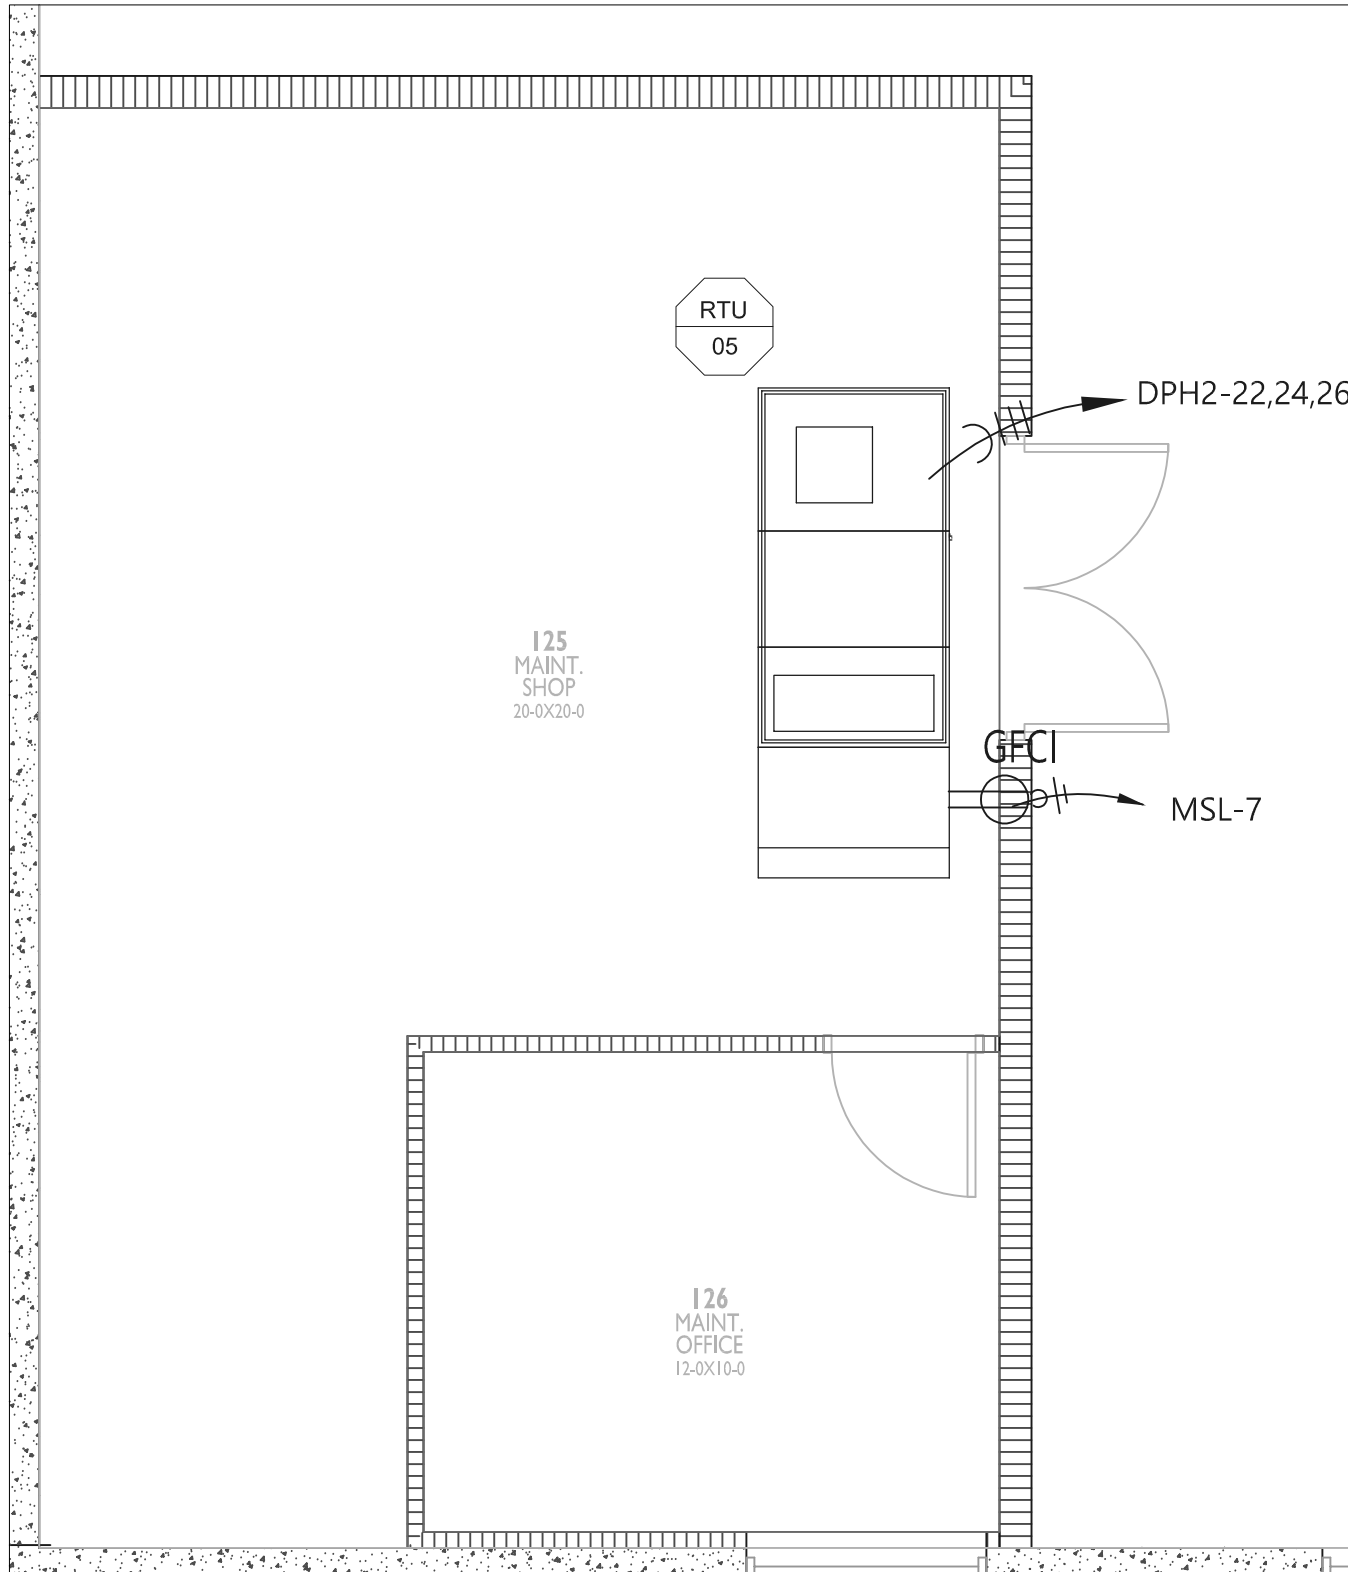


3 Maintenance Office HVAC Power  
scale: 1/4"=1'



THIS DRAWING HAS BEEN PRODUCED BY HERITAGE ELECTRIC, LLC. FOR THEIR COORDINATION OF THE ELECTRICAL INSTALLATION AND MAY NOT BE USED FOR ANY OTHER PURPOSE.  
COPYRIGHT 2008, HERITAGE ELECTRIC, LLC.  
THE SEAL OF THE ELECTRICAL P.E. APPLIES TO ONLY THIS DRAWING, SPECIFICATIONS AND OTHER DOCUMENTS BEARING THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL AND DISCLAIM ANY RESPONSIBILITY FOR ALL OTHER DRAWINGS, SPECIFICATIONS, ESTIMATES, REPORTS OR OTHER DOCUMENTS WHICH DO NOT CONTAIN THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL.

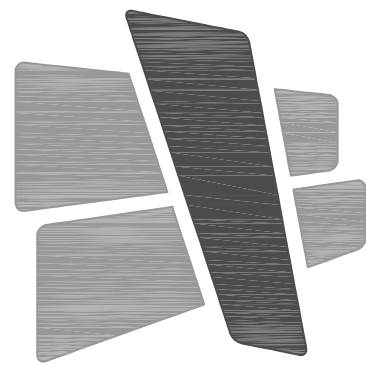


**CURRAN**  
ARCHITECTURE  
5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

CERTIFICATION

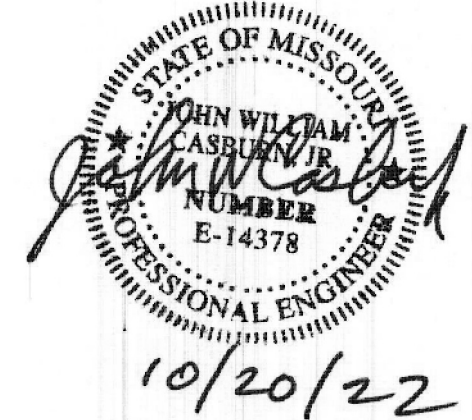

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES


PERMIT SET	02.18.22
CITY COMMENTS	10.17.22


210300

OFFICE HVAC

**E3.1**



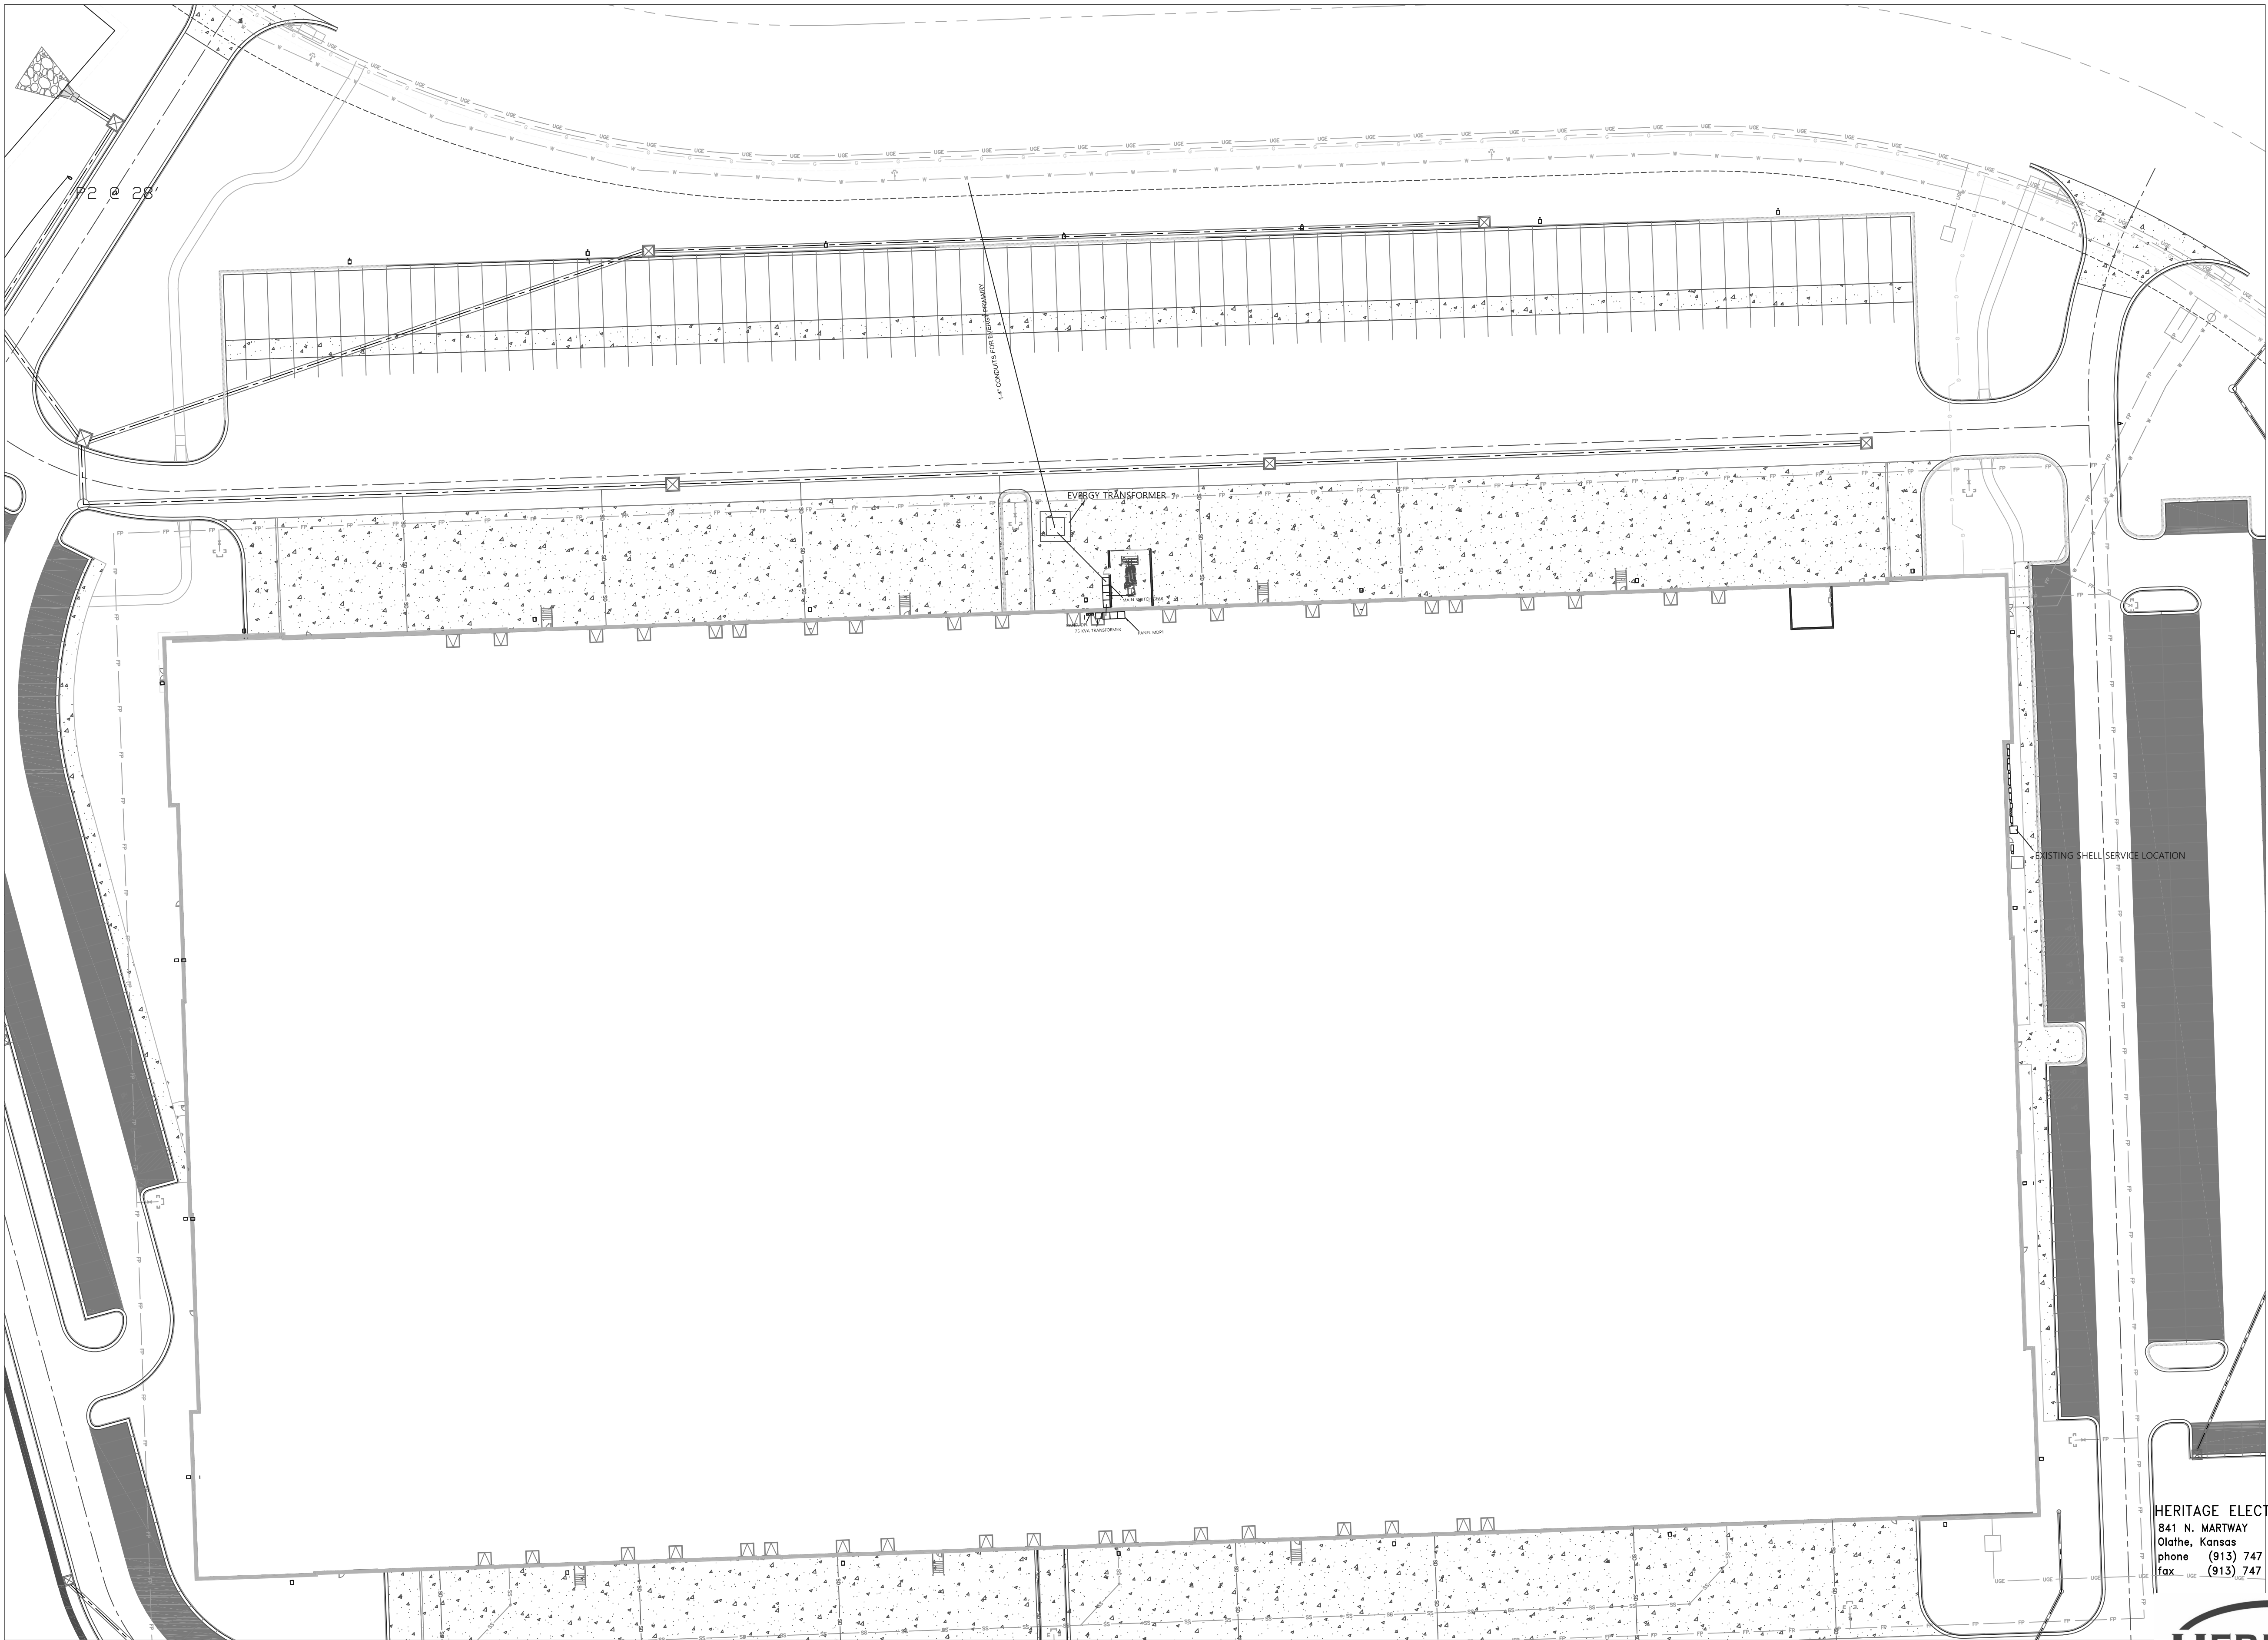


1 Site  
scale: N.T.S



HERITAGE ELECTRIC, L.L.C.  
841 N. MARTWAY  
Olathe, Kansas  
phone (913) 747 0528  
fax (913) 747 0539


THIS DRAWING HAS BEEN PRODUCED BY HERITAGE ELECTRIC, L.L.C. FOR THEIR COORDINATION OF THE ELECTRICAL INSTALLATION AND MAY NOT BE USED FOR ANY OTHER PURPOSE.  
COPYRIGHT 2008, HERITAGE ELECTRIC, L.L.C.

THE SEAL OF THE ELECTRICAL P.E. APPLIES TO ONLY THIS DRAWING, SPECIFICATIONS AND OTHER DOCUMENTS BEARING THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL AND DISCLAIM ANY RESPONSIBILITY FOR ALL OTHER DRAWINGS, SPECIFICATIONS, ESTIMATES, REPORTS OR OTHER DOCUMENTS WHICH DO NOT CONTAIN THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL.

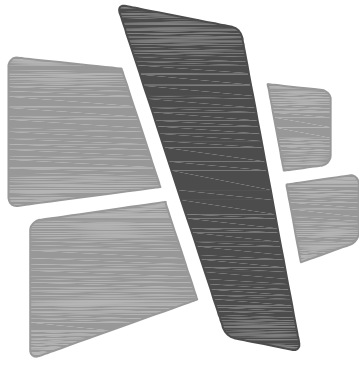

CURRAN  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



SCANNELL  
PROPERTIES

CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES

PERMIT SET	02.18.22
CITY COMMENTS	10.17.22


210300

Site

E4.0





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

CERTIFICATION

HERITAGE ELECTRIC, L.L.C.  
841 N. MARTWAY  
Olathe, Kansas  
phone (813) 747 0528  
fox (913) 747 0539



THIS DRAWING HAS BEEN PRODUCED BY HERITAGE ELECTRIC, LLC. FOR THEIR COORDINATION OF THE ELECTRICAL INSTALLATION AND MAY NOT BE USED FOR ANY OTHER PURPOSE.  
COPYRIGHT 2008, HERITAGE ELECTRIC, LLC.

THE SEAL OF THE ELECTRICAL P.E. APPLIES TO ONLY THIS DRAWING. SPECIFICATIONS AND OTHER DOCUMENTS BEARING THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL AND DISCLAIM ANY RESPONSIBILITY FOR ALL OTHER DRAWINGS, SPECIFICATIONS, ESTIMATES, REPORTS OR OTHER DOCUMENTS WHICH DO NOT CONTAIN THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL.

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


ISSUE DATES

PERMIT SET 02.18.22  
CITY COMMENTS 10.17.22


210300

Riser

**E5.0**

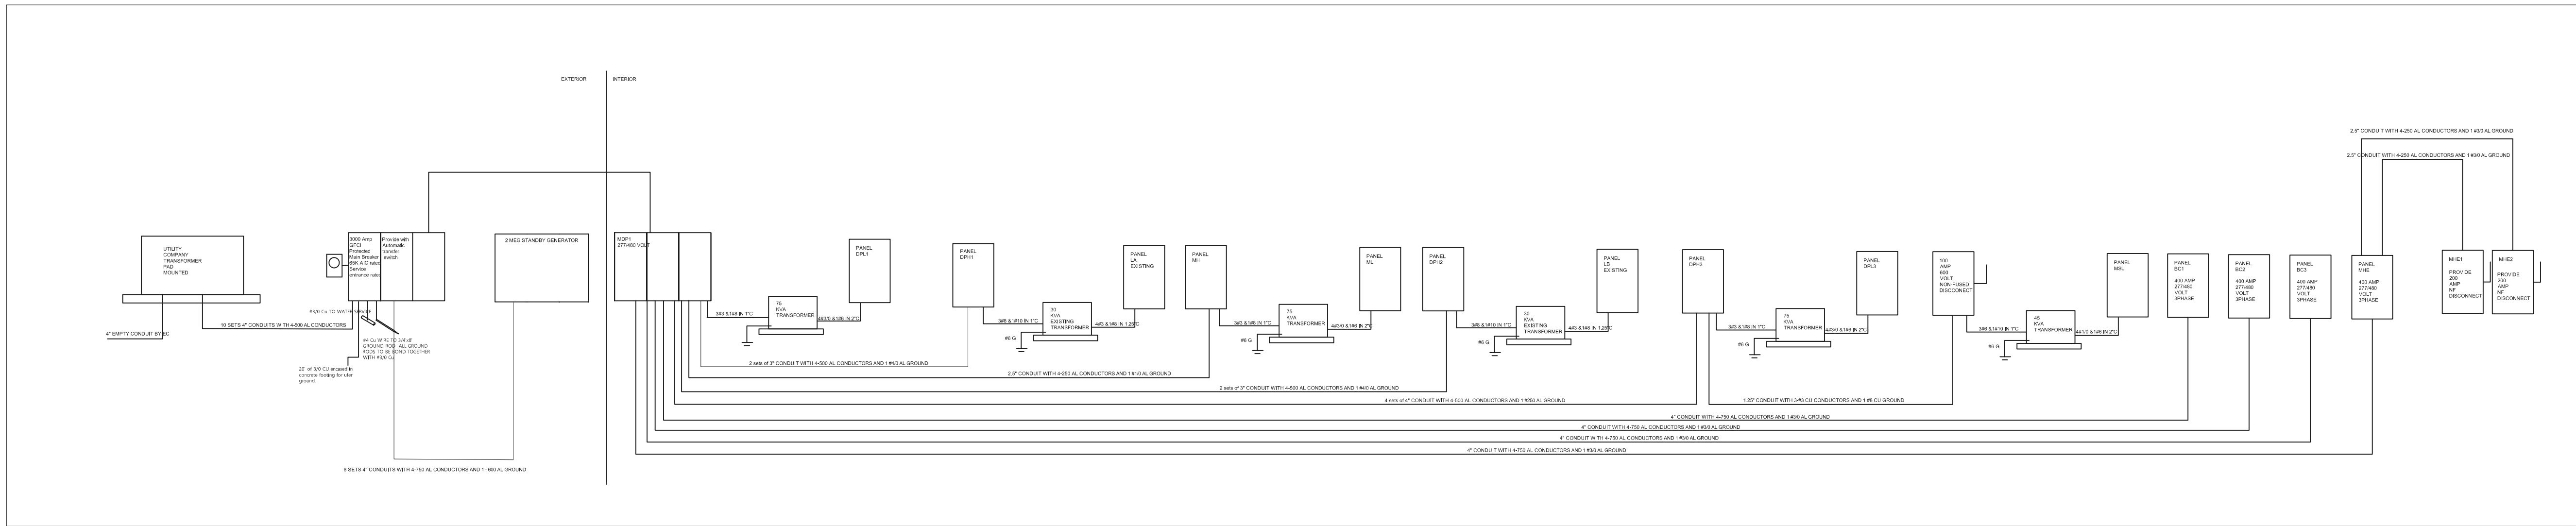

1 Riser  
scale: N.T.S

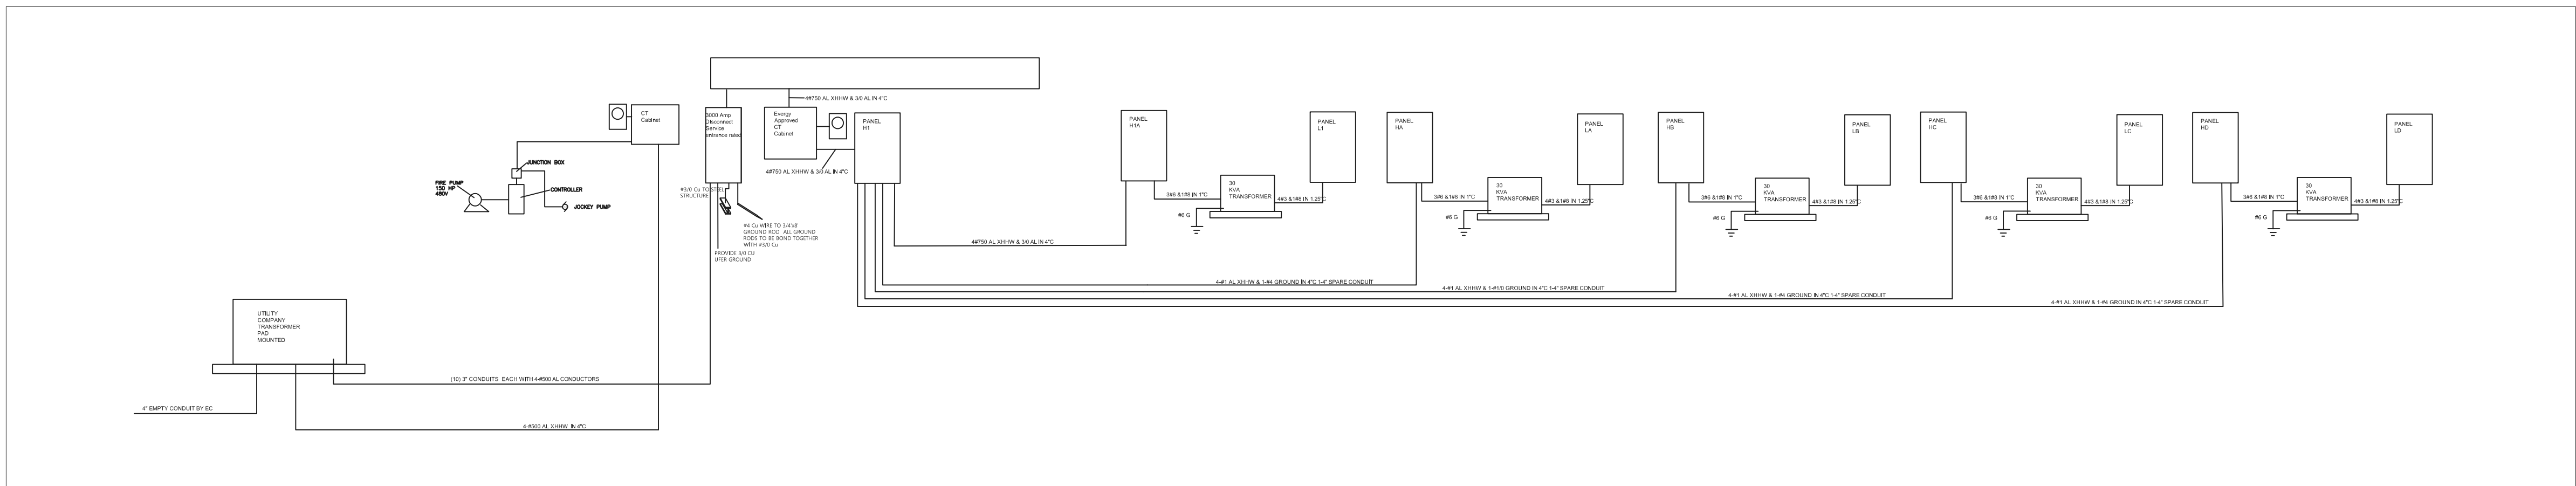

1 Existing Shell Riser Diagram  
scale: N.T.S



LIGHT FIXTURE SCHEDULE						
TYPE	MANUFACTURER	CATALOG NO.	LAMPS	MOUNTING	VOLTS	REMARKS
A	Columbia Lighting	CBT24-LS40	LED	CEILING	277	OR EQUAL
A1	Columbia Lighting	CBT22-LS40	LED	CEILING	277	OR EQUAL
B	Columbia Lighting	PEL2-40MV-EDU	LED	CEILING	277	PROVIDE WITH INTEGRAL OCCUPANCY SENSOR
BE	Columbia Lighting	PEL2-40MV-EDU	LED	CEILING	277	SAME AS TYPE B WITH EMERGENCY BALLAST
C	GE Lightnng	ABC1X30473Cxxx	LED	CEILING	277	PROVIDE WITH INTEGRAL OCCUPANCY SENSOR
CE	GE Lightnng	ABC1X30473Cxxx	LED	CEILING	277	SAME AS TYPE C WITH EMERGENCY BALLAST
D	GE Lightnng	ABC1X30475Cxxx	LED	CEILING	277	PROVIDE WITH INTEGRAL OCCUPANCY SENSOR
E	GE Lighting	EWS3-4-E3-D1-40-3-DKBZ	LED	WALL	277	OR EQUAL
DE	GE Lightnng	ABC1X30475Cxxx	LED	CEILING	277	SAME AS TYPE D WITH EMERGENCY BALLAST
X1	Compass	CCR	LED	WALL	277	OR EQUAL
RH	Compass	CUWZ-PC	LED	WALL	277	OR EQUAL
EM	Compass	CU2	LED	WALL	277	OR EQUAL
XE	Compass	CCR	LED	WALL	277	EXISTING EXIT/EM LIGHT INSTALLED IN SHELL
ERH	Compass	CUWZ-PC	LED	WALL	277	EXISTING REMOTE HEAD LIGHT INSTALLED IN SHELL

Scope:

Provide electrical for new TI in existing warehouse

All Electrical work shall be as per NEC 2017.

All work shall be done by qualified electricians.

All branch wiring shall be copper.

Devices shall be 20a commercial grade and color shall be by architect.

#### SPECIFICATIONS

- CONDUIT ABOVE GRADE SHALL BE EMT UNLESS OTHERWISE NOTED
- CONDUIT BELOW GRADE SHALL BE RIGID PVC UNLESS OTHERWISE NOTED
- CONNECTIONS SHALL BE MADE USING SET SCREW CONNECTORS
- MC CABLE IS ACCTEABLE FOR FINAL CONNECTIONS TO LIGHT FIXTURES PROVIDE WITH 10' WHIP ON ALL HIGHWAYS
- BRANCH WIRING SHALL BE #12 THIN COPPER UNLESS OTHERWISE NOTED
- WIRING SHALL BE AS PER CURRENT NEC 2005
- WIRING DEVICES SHALL BE OF COMMERCIAL GRADE RATED AT 20 AMP
- INSTALLATION SHALL ADHERE TO ADA STANDARDS
- ALUMINUM XHHW-#2 CABLE MAY BE USED FOR FEEDERS LARGER THEN #2 OTHERWISE COPPER
- REFER TO KCP&L STANDARDS MANUAL FOR 480 SERVICES
- ALL LIGHTING/EQUIPMENT IN WAREHOUSE SHALL BE MOUNTED TO PROVIDE A MIN OF 36" CLEAR HEIGHT

#### ELECTRICAL GENERAL NOTES

- WORK INCLUDED. FURNISH ALL LABOR, MATERIAL, SERVICES AND SKILLED SUPERVISION NECESSARY FOR THE CONSTRUCTION, ERECTION, INSTALLATION CONNECTIONS, TESTING AND ADJUSTMENTS OF ALL CIRCUITS AND ELECTRICAL EQUIPMENT SPECIFIED HEREIN, OR NOTED ON THE DRAWINGS, AND ITS DELIVERY TO THE OWNER COMPLETE IN ALL RESPECTS READY FOR USE.
- CONTRACT DRAWINGS THE CONTRACT DRAWINGS ARE SHOWN IN PART DIAGRAMMATIC, INTENDED TO CONVEY THE SCOPE OF WORK, INDICATING THE GENERAL ARRANGEMENT OF EQUIPMENT, CONDUIT AND OUTLETS. VERIFY SPACES FOR THE INSTALLATION OF THE MATERIALS BASED ON ACTUAL DIMENSIONS OF EQUIPMENT FURNISHED. IF A QUESTION EXISTS AS TO THE EXACT INTENDED LOCATION OF OUTLETS OR EQUIPMENT, OBTAIN INSTRUCTIONS FROM THE ARCHITECT/ENGINEER BEFORE PROCEEDING WITH WORK.
- MINIMUM SIZE OF CONDUIT SHALL BE 1/2" UNLESS NOTED OTHERWISE.
- ALL WIRING FOR LIGHTING, RECEPTACLE AND POWER CIRCUITS WHERE NOT SHOWN ON DRAWINGS SHALL BE WITH #12 CONDUCTORS, NUMBER AS REQUIRED IN CONDUIT SIZED PER N.E.C. PROVIDE EQUIPMENT GROUNDING CONDUCTOR FOR ALL BRANCH CIRCUITS AND FEEDERS. HOMERUNS TO PANEL SHALL BE IN INDIVIDUAL CONDUITS, UNLESS NOTED OTHERWISE, WITH CIRCUITS AS SHOWN.
- THE USE OF TYPE 'MC' AND TYPE 'AC' CABLE IS PERMITTED IN ALL AREAS PER NEC AND LOCAL CODE REQUIREMENTS.
- THE USE OF ALUMINUM CONDUCTORS WITH AMPACITY EQUIVALENT TO COPPER IS PERMITTED IN ALL AREAS PER NEC REQUIREMENTS.
- ALL JUNCTION BOXES, PULL BOXES, AND PANELBOARDS SHALL BE RIGIDLY ATTACHED TO STRUCTURE.
- COORDINATE ALL WORK WITH OTHER TRADES AND EXISTING CONDITIONS AS REQUIRED TO PROPERLY INSTALL ALL SYSTEMS AS INTENDED, WITHIN THE CONFINES OF THE SPACE AVAILABLE, AND WITHOUT INTERFERENCES.
- ALL CONDUIT, BOXES, ETC. SHALL BE CONCEALED OR MOUNTED FLUSH WITH CEILING OR WALL CONSTRUCTION. CONDUITS SHALL BE MOUNTED AS HIGH AS POSSIBLE. NO SURFACE MOUNTED CONDUIT, BOXES, ETC. WILL BE PERMITTED WITHOUT PERMISSION OF THE ENGINEER PRIOR TO INSTALLATION. ALL CONDUIT PENETRATIONS SHALL BE FIRE-CAULKED AS REQUIRED.






**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216


O :: 317. 288. .0681

F :: 317. 288. .0753



**SCANNELL**  
PROPERTIES

CERTIFICATION

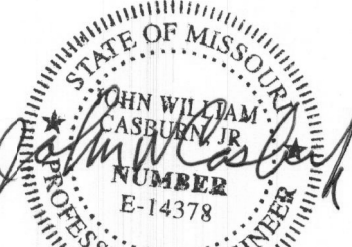

10/20/22

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES

PERMIT SET 02.18.22  
CITY COMMENTS 10.17.22



THIS DRAWING HAS BEEN PRODUCED BY HERITAGE ELECTRIC, LLC. FOR THEIR COORDINATION OF THE ELECTRICAL INSTALLATION AND MAY NOT BE USED FOR ANY OTHER PURPOSE.  
COPYRIGHT 2008, HERITAGE ELECTRIC, LLC.

THE SEAL OF THE ELECTRICAL ENGINEER APPLIES TO ONLY THIS DRAWING. SPECIFICATIONS AND OTHER DOCUMENTS BEARING THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL AND DISCLAIM ANY RESPONSIBILITY FOR ALL OTHER DRAWINGS, SPECIFICATIONS, ESTIMATES, REPORTS OR OTHER DOCUMENTS WHICH DO NOT CONTAIN THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL.

210300

Panel Schedule

**E6.0**

PANEL: MDP1										3000	MB	277/	480	V, 3PH, 4W, +GRND.	NEW PANEL									
CCT	SERVICES	VA	OCF	WIRE	PHASE	WIRE	OCF	VA	SERVICES															CCT
1	RTU A	15512	703	4/4L 1485	A	4/4L 1485	703	15512	RTU A															2
3		15512			B			15512																4
5		15512			C			15512																6
7	RTU A	15512	703	4/4L 1485	A	4/4L 1485	203	15512	RTU A															8
9		15512			B			15512																10
11		15512			C			500																12
13	RTU A	15512	703	4/4L 1485	A	4/4L 1485	703	15512	RTU A															14
15		15512			B			15512																16
17		15512			C			15512																18
19	RTU A	15512	703	4/4L 1485	A	4/4L 1485	703	15512	RTU A															20
21		15512			B			15512																22
23		15512			C			15512																24
25	RTU A	15512	203	4/4L 1485	A	4/410, 14100	203	500	HVLS FAN															26
27		15512			B			500	HVLS FAN															28
29		15512			C			500	HVLS FAN															30
31	HVLS FAN	1000	203	4/412, 14120	A	4/412, 14120	203	3333	AIR CURTAIN															32
33	HVLS FAN	1000			B			3333																34
35	HVLS FAN	1000			C			3333																36
37	AIR CURTAIN	3333	203	4/412, 14120	A	4/412, 14120	203	3333	AIR CURTAIN															38
39		3333			B			3333																40
41		3333			C			3333																42
43	AIR CURTAIN	3333	203	4/412, 14120	A	4/412, 14120	203	3333	AIR CURTAIN															44
45		3333			C			3333																46
47	AIR CURTAIN	3333	203	4/412, 14120	A	4/412, 14120	203	3333	AIR CURTAIN															50
49		3333			C			3333																52
51		3333			C			3333																54
53	AIR CURTAIN	3333	203	4/412, 14120	A	4/412, 14120	203	3333	AIR CURTAIN															56
55		3333			C			3333																58
57		3333			B			3333																60
59	AIR CURTAIN	3333	203	4/412, 14120	A	3.5E15 14250AL, 1440ALG	6003	12197	DPH1															62
61		3333			C			12197																64
63		3333			B			12197																66
65	AIR CURTAIN	3333	203	4/412, 14120	A	4/4250AL, 14100ALG	2003	121175	PANEL MHE															68
67		3333			B			121175																70
69		3333			C			16600																72
71	PANEL MHE EQUIPMENT	88640	4003	44750AL, 1430ALG	B	4.5E15 14250AL, 14250ALG	12003	178604	PANEL DPH3															74
73		88640			B			178604																76
75		88640			C			178604																78
77	PANEL DPH2	115138	6003	3.5E15 14400AL, 1440ALG	C	44750AL, 1430ALG	4003	35456	BC1															80
79		115386			A			25456																82
81		115386			B			35456																84
83	BC2	35456	4003	44750AL, 1430ALG	C	44750AL, 1430ALG	4003	35456	BC3															86
85		35456			B			35456																88
87		35456			C			35456																90
89	WAREHOUSE LIGHTS	1260	201	1412, 14120	A	1412, 14120	201	1260	WAREHOUSE LIGHTS															92
91	WAREHOUSE LIGHTS	1260	201	1412, 14120	B	1412, 14120	201	2110	WAREHOUSE LIGHTS															94
93	WAREHOUSE LIGHTS	1260	201	1412, 14120	C	1412, 14120	201	2110	WAREHOUSE LIGHTS															96
95	WAREHOUSE LIGHTS	1260	201	1412, 14120	A	1412, 14120	201	2110	WAREHOUSE LIGHTS															98
97	TRANSFORMER	1000	1485	1485	B	1412, 14120	201	1470	WAREHOUSE LIGHTS															100
99					C	1412, 14120	201	1470	WAREHOUSE LIGHTS															102
101																								

NOTES:		LOAD SUMMARY			CONN	NEC	DEM	LOAD BALANCE PER PHASE		
1	NEMA 1R ENCLOSURE	1	LIGHTING	1410	1.25	1787.5	PHASE A			22599.4
2	PROVIDE BOLT ON BREAKERS	2	RECEIPT ACLES	0	NEC	0	PHASE B			32151.6
3		3	SKIT CHEN	0	0.65	0	PHASE C			30534.4
		4	44VAC	23940.4	1	23940.4	LOWEST PHASE PLUS 10%			
		5	SHOCK-CONT	400	1	400	30534.4	1 = 10%		325932.4
		6	LARGEST MOTOR	0	0.25	0	PHASES ARE BALANCED			
		7	TOTAL VA	241344		241699.6				
		8	TOTAL AMPS	260.0		2607.3				

PANEL: DPH3										1200	MB	277/	480	V, 3PH, 4W, +GRND.	NEW PANEL										
CCT	SERVICES	VA	OCF	WIRE	PHASE	WIRE	OCF	VA	SERVICES															CCT	
1	RTU A	15512	703	4/4L 1485	A	4/4L 1485	703	15512	RTU A															2	
3		15512	-		B	-	-	15512																4	
5		15512	-		C	-	-	15512																6	
7	RTU A	15512	703	4/4L 1485	A	4/4L 1485	703	15512	RTU A															8	
9		15512	-		B	-	-	15512																10	
11		15512	-		C	-	-	15512																12	
13	RTU A	15512	703	4/4L 1485	A	4/4L 1485	703	15512	RTU A															14	
15		15512	-		B	-	-	15512																16	
17		15512	-		C	-	-	15512																18	
19	RTU A	15512	703	4/4L 1485	A	4/4L 1485	703	15512	RTU A															20	
21		15512	-		B	-	-	15512																22	
23		15512	-		C	-	-	15512																24	
25	HVLS FAN	1000	203	4/410, 14100	A	4/410, 14100	203	500	HVLS FAN															26	
27	HVLS FAN	1000			B			500	HVLS FAN															28	
29	HVLS FAN	1000			C			500	HVLS FAN															30	
31	AIR CURTAIN	3333	203	4/412, 14100	A	4/412, 14100	203	3333	AIR CURTAIN															32	
33		3333	-		B			3333																34	
35		3333	-		C			3333																36	
37	AIR CURTAIN	3333	203	4/412, 14100	A	4/412, 14100	203	3333	AIR CURTAIN															38	
39		3333	-		B			3333																40	
41		3333	-		C			3333																42	
43	AIR CURTAIN	3333	203	4/412, 14100	A	4/412, 14100	203	3333	AIR CURTAIN															44	
45		3333	-		B			3333																46	
47		3333	-		C			3333																48	
49	AIR CURTAIN	3333	203	4/412, 14100	A	4/412, 14100	203	3333	AIR CURTAIN															50	
51		3333	-		B			3333																52	
53		3333	-		C			3333																54	
55	AIR CURTAIN	3333	203	4/412, 14100	A	4/412, 14100	203	3333	AIR CURTAIN															56	
57		3333	--		C	--	--	3333																58	
59		3333	-		B			3333																60	
61	AIR CURTAIN	3333	203	4/412, 14100	A	4/412, 14100	203	3333	AIR CURTAIN															62	
63		3333	-		B			3333																64	
65		3333	-		C			3333																66	
67	AIR CURTAIN	3333	203	4/412, 14100	A	4/412, 14100	203	3333	AIR CURTAIN															68	
69		3333	-		B			3333																70	
71		3333	-		C			3333																72	
73	AIR CURTAIN	3333	203	4/412, 14100	A	4/412, 14100	203	3333	AIR CURTAIN															74	
75		3333	-		B			3333																76	
77		3333	-		C			3333																78	
79	WAREHOUSE LIGHTS	1980	201	3/412, 14100	A	3/412, 14100	201	586	WAREHOUSE LIGHTS															80	
81	WAREHOUSE LIGHTS	1980	201	3/412, 14100	A	3/412, 14100	201	586	WAREHOUSE LIGHTS															82	
83	WAREHOUSE LIGHTS	1980	201	3/412, 14100	A	3/412, 14100	201	586	WAREHOUSE LIGHTS															84	
85	WAREHOUSE LIGHTS	1980	201	3/412, 14100	B	3/412, 14100	201	586	WAREHOUSE LIGHTS															86	
87	WAREHOUSE LIGHTS	1980	201	3/412, 14100	C	3/412, 14100	201	586	WAREHOUSE LIGHTS															88	
89	WAREHOUSE LIGHTS	1980	201	3/412, 14100	A	3/412, 14100	201	2570	WAREHOUSE LIGHTS															90	
91	WAREHOUSE LIGHTS	1980	201	3/412, 14100	B	3/412, 14100	201	2570	WAREHOUSE LIGHTS															92	
93	WAREHOUSE LIGHTS	1980	201	3/412, 14100	C	3/412, 14100	201	2570	WAREHOUSE LIGHTS															94	
95	WAREHOUSE LIGHTS	1980	201	3/412, 14100	A	3/412, 14100	201	2570	WAREHOUSE LIGHTS															96	
97	WAREHOUSE LIGHTS	2520	201	3/412, 14100	C	3/412, 14100	201	2570	WAREHOUSE LIGHTS															98	
99	WAREHOUSE LIGHTS	1200	201	3/412, 14100	A																			100	
101	WAREHOUSE LIGHTS	2520	201	3/412, 14100	B																			102	
103					B																			104	
105					C																			106	
107					C																			108	
109					A																			110	
111					B																			112	
113					C																			114	
115	TRANSFORMER	1000	3/4L 1485	A	3/4L 1485		753		TRANSFORMER															116	
117			--		B	--	--																	118	
119			--		C	--	--																	120	
NOTES																									
1 NAME ON ENCLOSURE										LOAD SUMMARY										CONN	NEC	DEM	LOAD BALANCE PER PHASE		
2 PROVIDE BOLD ON BREAKERS										ELECTRICAL										4200	1.25	5062	PHASE A		
3										JUNCTION BOXES										0	NEC	0.05	PHASE B		
										SPLIT CEN													PHASE C		
										414WAC										51272	1.1	51272	LOWEST PHASE PLUS 5%		
										SINKING										640	1	640	1 + 10%		
										LARGEST MOTOR										0	0.25		PHASES ARE BALANCED		
										TOTAL VA										57902		58341			
										TOTAL AMPS										8672		7161			






**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216


O :: 317.288.0681

F :: 317.288.0753



**SCANNELL**  
PROPERTIES

CERTIFICATION

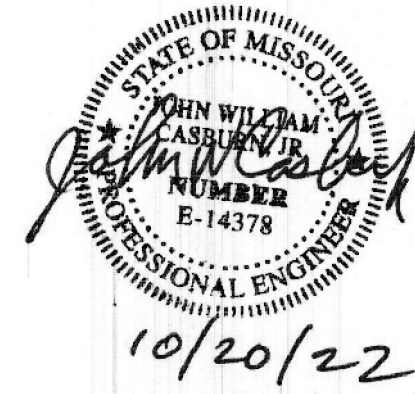

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES

PERMIT SET 02.18.22  
CITY COMMENTS 10.17.22



THIS DRAWING HAS BEEN PRODUCED BY HERITAGE ELECTRIC, LLC. FOR THEIR COORDINATION OF THE ELECTRICAL INSTALLATION AND MAY NOT BE USED FOR ANY OTHER PURPOSE.  
COPYRIGHT 2008, HERITAGE ELECTRIC, LLC.

THE SEAL OF THE ELECTRICAL P.E. APPLIES TO ONLY THE DRAWING, SPECIFICATIONS AND OTHER DOCUMENTS BEARING THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL AND DISCLAIM ANY RESPONSIBILITY FOR ALL OTHER DRAWINGS, SPECIFICATIONS, ESTIMATES, REPORTS OR OTHER DOCUMENTS WHICH DO NOT CONTAIN THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL.

210300

Panel Schedule

**E6.I**

PANEL: LA 100 MLO 120/ 208 V, 3PH, 4W.+GRND. EXISTING											
CCT	SERVICES	VA	DCP	WIRE	PHASE	WIRE	DCP	VA	SERVICES		CCT
1	RECEP	800	201	2#12,1#10S	A	2#12,1#10S	201	200	LIGHTS		2
3	FOU-1	1248	152	2#12,1#10S	B	2#12,1#10S	201	200	EXIST RECEP		4
5					C	2#12,1#10S	201		SFARE		6
7	DOCK RECEP	800	201	2#12,1#10S	A	2#12,1#10S	201		SFARE		8
9	DOCK RECEP	800	201	2#12,1#10S	B	2#12,1#10S	201		SFARE		10
11	DOCK RECEP	800	201	2#12,1#10S	C	2#12,1#10S	201		SFARE		12
13	SFARE	201	2#12,1#10S				201		SFARE		14
15	SFARE		201	2#12,1#10S	B	2#12,1#10S	201		SFARE		16
17					C						18
19					A						20
21					B						22
23					C						24
25					A						26
27					B						28
29					C						30
31					A						32
33					B						34
35					C						36
37					A						38
39					B						40
41					C						42
NOTES: 1 NEMA 1 ENCLOSURE 2 PROVIDE BOLT ON BREAKERS 3											
LOAD SUMMARY						CONN	NEC	DEM	LOAD BALANCE PER PHASE		
1 LIGHTING						200	1.25	200	PHASE A		
2 RECEPTACLES						5066	NEC	5066	PHASE B		
3 KITCHEN						0	0.65	0	PHASE C		
4 HVAC						200	1	200	LOWEST PHASE PLUS 10%		
5 SNOW CONT						0	1	0	1800		
6 LARGEST MOTOR						0	0.25	0	REBALANCE LOADS		
TOTAL VA						6596		6596			
TOTAL AMPS						16.9		17.1			

PANEL: BC1 400 MLO 277/ 480 V, 3PH, 4W.+GRND. NEW PANEL											
CCT	SERVICES	VA	DCP	WIRE	PHASE	WIRE	DCP	VA	SERVICES		CCT
1	BATTERY CHARGER	4432	303	3#10,1#10S	A	3#10,1#10S	303	4432	BATTERY CHARGER		2
3	BATTERY CHARGER	4432			B			4432	BATTERY CHARGER		4
5	BATTERY CHARGER	4432			C			4432	BATTERY CHARGER		6
7	BATTERY CHARGER	4432	303	3#12,1#10S	A	3#12,1#10S	303	4432	BATTERY CHARGER		8
9	BATTERY CHARGER	4432			B			4432	BATTERY CHARGER		10
11	BATTERY CHARGER	4432			C			4432	BATTERY CHARGER		12
13	BATTERY CHARGER	4432	303	3#12,1#10S	A	3#12,1#10S	303	4432	BATTERY CHARGER		14
15	BATTERY CHARGER	4432			B			4432	BATTERY CHARGER		16
17	BATTERY CHARGER	4432			C			4432	BATTERY CHARGER		18
19	BATTERY CHARGER	4432	303	3#12,1#10S	A	3#12,1#10S	303	4432	BATTERY CHARGER		20
21	BATTERY CHARGER	4432			B			4432	BATTERY CHARGER		22
23	BATTERY CHARGER	4432			C			4432	BATTERY CHARGER		24
25	BATTERY CHARGER	4432			A			4432	BATTERY CHARGER		26
27					B						28
29					C						30
31					A						32
33					B						34
35					C						36
37					A						38
39					B						40
41					C						42
NOTES: 1 NEMA 1 ENCLOSURE 2 PROVIDE BOLT ON BREAKERS 3											
LOAD SUMMARY						CONN	NEC	DEM	LOAD BALANCE PER PHASE		
1 LIGHTING						0	1.25	0	PHASE A		
2 RECEPTACLES						0	NEC	0	PHASE B		
3 KITCHEN						0	0.65	0	PHASE C		
4 HVAC						0	1	0	LOWEST PHASE PLUS 10%		
5 SNOW CONT						106368	1	106368	35456		
6 LARGEST MOTOR						0	0.25	0	PHASES ARE BALANCED		
TOTAL VA						106368		106368			
TOTAL AMPS						127.9		127.9			

PANEL: BC2 400 MLO 277/ 480 V, 3PH, 4W.+GRND. NEW PANEL											
CCT	SERVICES	VA	DCP	WIRE	PHASE	WIRE	DCP	VA	SERVICES		CCT
1	BATTERY CHARGER	4432	303	3#10,1#10S	A	3#10,1#10S	303	4432	BATTERY CHARGER		2
3	BATTERY CHARGER	4432			B			4432	BATTERY CHARGER		4
5	BATTERY CHARGER	4432			C			4432	BATTERY CHARGER		6
7	BATTERY CHARGER	4432	303	3#12,1#10S	A	3#12,1#10S	303	4432	BATTERY CHARGER		8
9	BATTERY CHARGER	4432			B			4432	BATTERY CHARGER		10
11	BATTERY CHARGER	4432			C			4432	BATTERY CHARGER		12
13	BATTERY CHARGER	4432	303	3#12,1#10S	A	3#12,1#10S	303	4432	BATTERY CHARGER		14
15	BATTERY CHARGER	4432			B			4432	BATTERY CHARGER		16
17	BATTERY CHARGER	4432			C			4432	BATTERY CHARGER		18
19	BATTERY CHARGER	4432	303	3#12,1#10S	A	3#12,1#10S	303	4432	BATTERY CHARGER		20
21	BATTERY CHARGER	4432			B			4432	BATTERY CHARGER		22
23	BATTERY CHARGER	4432			C			4432	BATTERY CHARGER		24
25					A						26
27					B						28
29					C						30
31					A						32
33					B						34
35					C						36
37					A						38
39					B						40
41					C						42
NOTES: 1 NEMA 1 ENCLOSURE 2 PROVIDE BOLT ON BREAKERS 3											
LOAD SUMMARY						CONN	NEC	DEM	LOAD BALANCE PER PHASE		
1 LIGHTING						0	1.25	0	PHASE A		
2 RECEPTACLES						0	NEC	0	PHASE B		
3 KITCHEN						0	0.65	0	PHASE C		
4 HVAC						0	1	0	LOWEST PHASE PLUS 10%		
5 SNOW CONT						106368	1	106368	35456		
6 LARGEST MOTOR						0	0.25	0	PHASES ARE BALANCED		
TOTAL VA						106368		106368			
TOTAL AMPS						127.9		127.9			

PANEL: BC3 400 MLO 277/ 480 V, 3PH, 4W.+GRND. NEW PANEL											
CCT	SERVICES	VA	DCP	WIRE	PHASE	WIRE	DCP	VA	SERVICES		CCT
1	BATTERY CHARGER	4432	303	3#10,1#10S	A	3#10,1#10S	303	4432	BATTERY CHARGER		2
3	BATTERY CHARGER	4432			B			4432	BATTERY CHARGER		4
5	BATTERY CHARGER	4432			C			4432	BATTERY CHARGER		6
7	BATTERY CHARGER	4432	303	3#12,1#10S	A	3#12,1#10S	303	4432	BATTERY CHARGER		8
9	BATTERY CHARGER	4432			B			4432	BATTERY CHARGER		10
11	BATTERY CHARGER	4432			C			4432	BATTERY CHARGER		12
13	BATTERY CHARGER	4432	303	3#12,1#10S	A	3#12,1#10S	303	4432	BATTERY CHARGER		14
15	BATTERY CHARGER	4432			B			4432	BATTERY CHARGER		16
17	BATTERY CHARGER	4432			C			4432	BATTERY CHARGER		18
19	BATTERY CHARGER	4432	303	3#12,1#10S	A	3#12,1#10S	303	4432	BATTERY CHARGER		20
21	BATTERY CHARGER	4432			B			4432	BATTERY CHARGER		22
23	BATTERY CHARGER	4432			C			4432	BATTERY CHARGER		24
25					A						26
27					B						28
29					C						30
31					A						32
33					B						34
35					C						36
37					A						38
39					B						40
41					C						42
NOTES:											
1 NEMA 1 ENCLOSURE											
2 PROVIDE BOLT ON BREAKERS											
3											
LOAD SUMMARY						CONN	NEC	DEM	LOAD BALANCE PER PHASE		
1 LIGHTING						0	1.25	0	PHASE A		
2 RECEPTACLES						0	NEC	0	PHASE B		
3 KITCHEN						0	0.65	0	PHASE C		
4 HVAC									LOWEST PHASE PLUS 10%		
5 SHOCK CONT						10000	1	10000	BASE 1% = 5%		
6 LARGEST MOTOR						0	0.25	0	PHASES ARE BALANCED		
TOTAL VA						10000		10000			
TOTAL AMP						127.5		127.5			



FIRE PROTECTION PLANS

M F. E. MORAN, INC. FIRE PROTECTION  
16815 COLLEGE BLVD.  
LENEXA, KS 66219  
(217) 356-0700 (217) 356-0777 FAX  
MISSOURI COA: E-2022012018

SCOPE OF WORK

SCOPE OF WORK:  
\*\* FURNISH & INSTALL (11) NEW WET PIPE SPRINKLER SYSTEM FOR THE NEW BUILDING.  
\*\* FURNISH & INSTALL A NEW FIRE PUMP AND ACCESSORIES  
\*\* FIRE PUMP ROOM POINT OF CONNECTION (START OF CONTRACT): 10" FLANGE, 12" ABOVE THE FINISHED FLOOR IN THE FIRE PUMP ROOM.  
\*\* FEED RISER POINT OF CONNECTION (START OF CONTRACT): 8" FLANGE, 12" ABOVE THE FINISHED FLOOR IN THE FIRE PUMP ROOM. TWO LOCATED ON EACH END OF THE BUILDING AND ONE ON EACH SIDE.  
\*\* INSTALL (18) 2 1/2" HOSE VALVES LOCATED AT MAN DOORS AND FED FROM ADJACENT SYSTEMS

NOT INCLUDED:  
\*\* WIRING OF ELECTRICAL DEVICES  
\*\* FIRE EXTINGUISHERS  
\*\* STANDPIPES AND HOSE STATIONS  
\*\* FIRE PUMP CONTROLLER AUTO TRANSFER SWITCH  
\*\* UNDERGROUND PIPING AND TESTING  
\*\* COLUMN SPRINKLERS  
\*\* SEISMIC BRACING  
\*\* PAINTED PIPING  
\*\* CONCRETE PADS  
\*\* COMPONENT IDENTIFICATION BEYOND NFPA 13 REQUIREMENTS  
\*\* ACCESS PANELS  
\*\* CUTTING AND PATCHING  
\*\* PIPE SLEEVES  
\*\* WALL POST INDICATOR VALVE  
\*\* PUMP CONTROLLER AUTOMATIC TRANSFER SWITCH

CODE INFORMATION

CODE INFORMATION:  
\*\*NFPA 13, 2016 EDITION: INSTALLATION OF SPRINKLER SYSTEMS  
\*\*NFPA 20, 2016 EDITION: INSTALLATION OF CENTRIFUGAL FIRE PUMPS  
\*\*INTERNATIONAL BUILDING & FIRE CODE, 2018 EDITION  
\*\*LOCAL AMENDMENTS

BUILDING INFO:  
IBC OCCUPANCY CLASSIFICATION: S-1  
IBC CONSTRUCTION TYPE: I-B  
IBC SEISMIC DESIGN CATEGORY: B  
HIGHEST FLOOR ELEVATION FROM FIRE DEPARTMENT VEHICLE ACCESS: GRADE  
NUMBER OF STORIES: 1  
BUILDING AREA: 433,364 S.F.

GENERAL REQUIREMENTS

\*\* SUPPLY A SPARE SPRINKLER CABINET WITH WRENCH FOR EACH SPRINKLER TYPE AS REQUIRED BY NFPA 13.  
\*\* IDENTIFY ALL HYDRAULICALLY CALCULATED SYSTEMS WITH A PERMANENTLY MARKED AND WEATHERPROOF SIGN.  
\*\* ALL NEW PIPING OR PIPING MODIFICATIONS WHICH AFFECT MORE THAN 20 SPRINKLERS SHALL BE HYDROSTATICALLY TESTED AT 200 PSI OR 60 PSI OVER THE SYSTEM WORKING PRESSURE. THE SYSTEM SHALL MAINTAIN THIS PRESSURE WITHOUT LOSS FOR 2 HOURS.  
\*\* ALL NEW PIPING OR PIPING MODIFICATIONS WHICH AFFECT 20 SPRINKLERS OR LESS SHALL BE TESTED AT THE SYSTEM WORKING PRESSURE.  
\*\* ALL PIPING MODIFICATIONS WHICH CANNOT BE ISOLATED FROM THE EXISTING SYSTEM, SHALL BE TESTED AT THE SYSTEM WORKING PRESSURE.  
\*\* THE LOCAL FIRE/BUILDING INSPECTOR IS TO BE NOTIFIED 48 HOURS IN ADVANCE OF ALL TESTING.  
\*\* UNDERGROUND TESTING AND FLUSHING:  
\*\* ALL UNDERGROUND PIPE SHALL BE TESTED AND FLUSHED BY THE INSTALLING CONTRACTOR AS REQUIRED BY NFPA 24 BEFORE ANY OVERHEAD SPRINKLER PIPING IS CONNECTED.

VALVES

\*\* ALL VALVES CONTROLLING WATER FLOW TO SPRINKLERS SHALL BE INDICATING & SUPERVISED.  
\*\* ALL VALVES SHALL BE ACCESSIBLE AT ALL TIMES AND PERMANENTLY IDENTIFIED.  
\*\* THE IDENTIFICATION OF CONTROL VALVES SHALL INCLUDE A DESCRIPTION OR DIAGRAM OF WHAT THEY CONTROL.  
\*\* ALL TRAPPED PORTIONS OF SPRINKLER PIPING SHALL BE PROVIDED WITH A LOW POINT DRAIN AS REQUIRED BY NFPA 13.

PIPE HANGERS

\*\* 2 1/2"-6" HANGER RINGS ARE TO BE ADJUSTABLE SWIVEL RINGS, ZINC PLATED, MANUFACTURED TO ANS/MSS SP-89 STANDARDS.  
\*\* 2 1/2"-6" CLEVIS HANGERS ARE TO BE ADJUSTABLE CLEVIS RINGS, PLAIN, MANUFACTURED TO ANS/MSS SP-89 STANDARDS.  
\*\* HANGERS AND SEISMIC BRACING ARE TO BE INSTALLED PER NFPA 13 REQUIREMENTS.  
\*\* HANGER ROD SIZES AND LOCATIONS ARE TO BE AS REQUIRED BY NFPA 13.

DESIGN CRITERIA - LIGHT HAZARD

SPRINKLER SYSTEM DESIGN CRITERIA - LIGHT HAZARD AREA/DENSITY (WET & SINGLE INTERLOCKED PREACTION SYSTEMS):  
THE NEW SYSTEM HAS BEEN DESIGNED WITH A DESIGN DENSITY OF .10 GPM/S.F. OVER THE MOST REMOTE AND DEMANDING DESIGN AREA OF 1500 S.F. WITH 225 S.F. (15') MAXIMUM SPRINKLER HEAD SPACING AND 100 GPM OUTSIDE HOSE ALLOWANCE. WHERE ROOF OR CEILING SLOPES EXCEED A PITCH OF 2:12, THE DESIGN AREA HAS BEEN INCREASED IN SIZE BY UP TO 1950 S.F. THE DESIGN AREA MAY BE REDUCED IN SIZE IN ACCORDANCE WITH NFPA 13 DUE TO THE USE OF QUICK RESPONSE SPRINKLERS BUT SHALL NEVER CONTAIN LESS THAN 5 SPRINKLERS. TOTAL SYSTEM SIZE SHALL NOT EXCEED 52,000 S.F.

WHERE EXTENDED COVERAGE SPRINKLERS ARE UTILIZED, THE MINIMUM DESIGN AREA SHALL BE 5 SPRINKLERS WITH 400 S.F. (20') MAXIMUM SPRINKLER HEAD SPACING. EXTENDED COVERAGE SPRINKLERS SHALL NOT BE USED WHERE ROOF OR CEILING SLOPES EXCEED A PITCH OF 2:12. WHERE SPECIFICALLY LISTED FOR SUCH USE, EXTENDED COVERAGE SPRINKLERS MAY BE USED FOR ROOF OR CEILING SLOPES UP TO A 4:12 PITCH.

WHEN A REDUCTION IN THE DESIGN AREA IS NOT USED, SPRINKLER DISCHARGE IN SMALL ROOMS SUCH AS CLOSETS AND WASHROOMS CONTAINING A SINGLE SPRINKLER MAY BE OMITTED FROM THE HYDRAULIC CALCULATIONS.

DRAWING SYMBOLS
PIPING CENTERLINES
★ 0" TS (---) TO TOP OF STEEL OR ROOF DECK
★ 0" TS (---) TO FLOOR
(X) HANGER LOCATION
(H) HYDRAULIC NODE
(A) ELECTRIC ALARM BELL

WET SYSTEM PIPE & FITTINGS

WET-PIPE SPRINKLER SYSTEM BLACK PIPE:  
\*\* 1" LINE PIPING SHALL BE BLACK STEEL SCH. 40 PIPE, MANUFACTURED TO ASTM A63 OR A795 STANDARDS.  
\*\* 2 1/2" LINE PIPING SHALL BE BLACK STEEL SCH. 7 PIPE, MANUFACTURED TO ASTM A795 STANDARDS.  
\*\* 8" MAIN PIPING SHALL BE BLACK STEEL SCH. 10 PIPE, MANUFACTURED TO ASTM A135 STANDARDS.  
\*\* 2'-6" MAIN PIPING SHALL BE BLACK STEEL SCH. 7 PIPE, MANUFACTURED TO ASTM A795 STANDARDS.

WET-PIPE SPRINKLER SYSTEM BLACK FITTINGS:  
\*\* 1" BRANCH LINE FITTINGS SHALL BE BLACK DUCTILE IRON THREADED, CLASS 150 STANDARD, MANUFACTURED PER ANS/ASME B16.3, U.L. LISTED FOR FIRE PROTECTION USE UP TO 175 PSI WORKING PRESSURE.  
\*\* 1/2"- 3" BRANCH LINE PIPE OUTLETS TO BE WELDED MANUFACTURED TO ASTM A53 & ANSI B1.20.1 STANDARDS.  
\*\* 1 1/4"-3" BRANCH LINE FITTINGS SHALL BE STANDARD GROOVED DUCTILE IRON, MANUF. TO ASTM A536 STANDARDS.

\*\* 2 1/2"-8" MAIN PIPE BRANCH OUTLETS TO BE WELDED MANUFACTURED TO ASTM A53 & ANSI B1.20.1 STANDARDS.  
\*\* 2 1/2"-8" MAIN PIPE FITTINGS SHALL BE STANDARD GROOVED DUCTILE IRON, MANUF. TO ASTM A536 STANDARDS.  
\*\* 2 1/2"-8" MAIN PIPE FITTINGS SHALL BE STANDARD GROOVED STEEL, MANUF. TO ASTM A536/A53 STANDARDS.

DESIGN CRITERIA - ESFR

SPRINKLER SYSTEM DESIGN CRITERIA (ESFR)-PALLETIZED/SOLID-PILE/RACK STORAGE:

FROM NFPA 13, 2016 EDITION TABLE 16.3.3.1  
COMMODITY CLASSIFICATION: CLASS I, II, III OR IV, ENCAPSULATED OR UNENCAPSULATED, NO OPEN TOP CONTAINERS  
STORAGE ARRANGEMENT: PALLETIZED/SOLID-PILE/SINGLE & DOUBLE ROW RACKS WITH NO SOLID SHELVING  
CONSTRUCTION TYPE: ALL TYPES  
MAXIMUM STORAGE HEIGHT: 35 FEET  
MAXIMUM CEILING/ROOF HEIGHT: 40 FEET  
MINIMUM CLEARANCE FROM SPRINKLER DEFLECTOR TO TOP OF STORAGE: 36 INCHES  
SPRINKLER TYPE: ESFR (EARLY SUPPRESSION FAST-RESPONSE)  
SPRINKLER K-FACTOR: 16.8  
SPRINKLER TEMPERATURE RATING: 205°F  
SPRINKLER ORIENTATION: PENDENT  
MAXIMUM SPRINKLER DEFLECTOR DISTANCE BELOW CEILING: 14 INCHES  
MINIMUM SPRINKLER DEFLECTOR DISTANCE BELOW CEILING: 6 INCHES  
MAXIMUM SPRINKLER SPACING/AREA: 10 FEET/100 S.F.  
MINIMUM SPRINKLER SPACING: 8 FEET/64 S.F.  
TYPE OF SYSTEM: WET  
NUMBER OF DESIGN SPRINKLERS: 12  
MINIMUM SPRINKLER OPERATING PRESSURE: 52 PSI  
INSIDE HOSE STREAM ALLOWANCE: 0 GPM  
OUTSIDE HOSE STREAM ALLOWANCE: 250 GPM  
TOTAL HOSE STREAM ALLOWANCE: 250 GPM  
IN-RACK SPRINKLERS: NO


SPRINKLER SYSTEM DESIGN CRITERIA (ESFR)-PALLETIZED/SOLID-PILE/RACK STORAGE:

FROM NFPA 13, 2016 EDITION TABLE 16.3.3.1  
COMMODITY CLASSIFICATION: CLASS I, II, III OR IV, ENCAPSULATED OR UNENCAPSULATED, NO OPEN TOP CONTAINERS  
STORAGE ARRANGEMENT: PALLETIZED/SOLID-PILE/SINGLE & DOUBLE ROW RACKS WITH NO SOLID SHELVING  
CONSTRUCTION TYPE: ALL TYPES  
MAXIMUM STORAGE HEIGHT: 40 FEET  
MAXIMUM CEILING/ROOF HEIGHT: 45 FEET  
MINIMUM CLEARANCE FROM SPRINKLER DEFLECTOR TO TOP OF STORAGE: 36 INCHES  
SPRINKLER TYPE: ESFR (EARLY SUPPRESSION FAST-RESPONSE)  
SPRINKLER K-FACTOR: 22.4  
SPRINKLER TEMPERATURE RATING: 205°F  
SPRINKLER ORIENTATION: PENDENT  
MAXIMUM SPRINKLER DEFLECTOR DISTANCE BELOW CEILING: 18 INCHES  
MINIMUM SPRINKLER DEFLECTOR DISTANCE BELOW CEILING: 6 INCHES  
MAXIMUM SPRINKLER SPACING/AREA: 10 FEET/100 S.F.  
MINIMUM SPRINKLER SPACING: 8 FEET/64 S.F.  
TYPE OF SYSTEM: WET  
NUMBER OF DESIGN SPRINKLERS: 12  
MINIMUM SPRINKLER OPERATING PRESSURE: 40 PSI  
INSIDE HOSE STREAM ALLOWANCE: 0 GPM  
OUTSIDE HOSE STREAM ALLOWANCE: 250 GPM  
TOTAL HOSE STREAM ALLOWANCE: 250 GPM  
IN-RACK SPRINKLERS: NO


SYSTEMS SHALL BE WET ONLY.

ROOF OR CEILING SLOPES SHALL NOT EXCEED A PITCH OF 2:12.

TOTAL SYSTEM SIZE SHALL NOT EXCEED 40,000 S.F. COMBINED HIGH PILED/RACK STORAGE & LIGHT/ORDINARY HAZARD SYSTEMS MAY COVER UP TO 52,000 S.F.

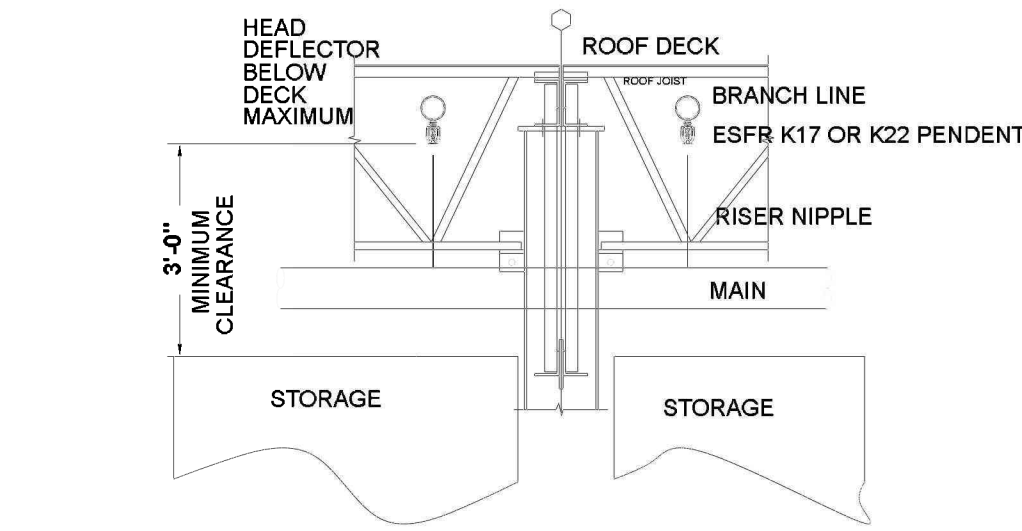


STORAGE CLEARANCE

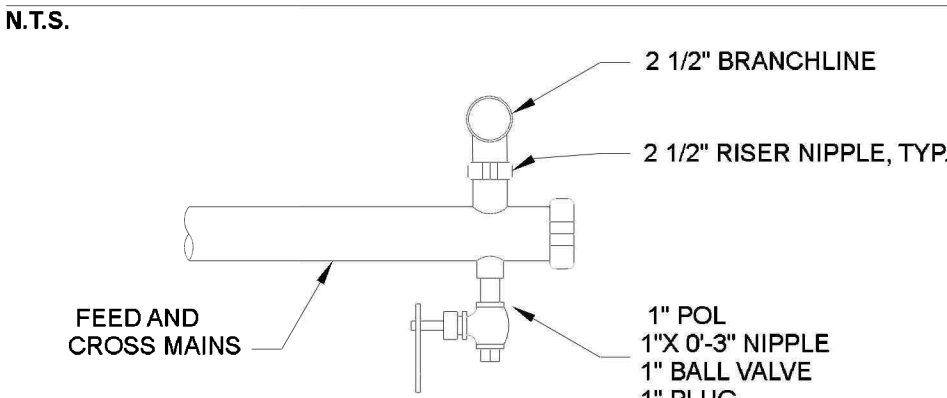


TYPICAL DRAIN DETAIL

N.T.S.

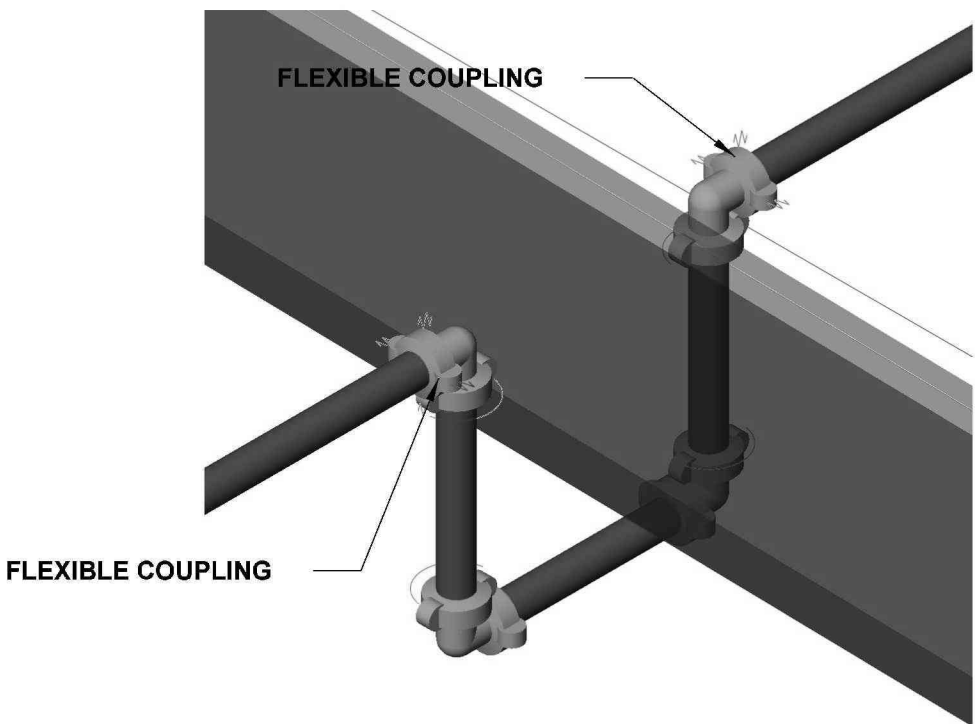


TYPICAL LINE AT EXPANSION JOINT

N.T.S.

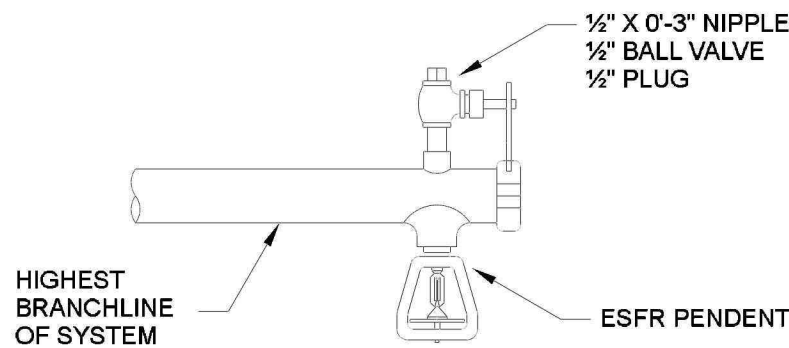

MANUAL AIR VENT DETAIL

N.T.S.

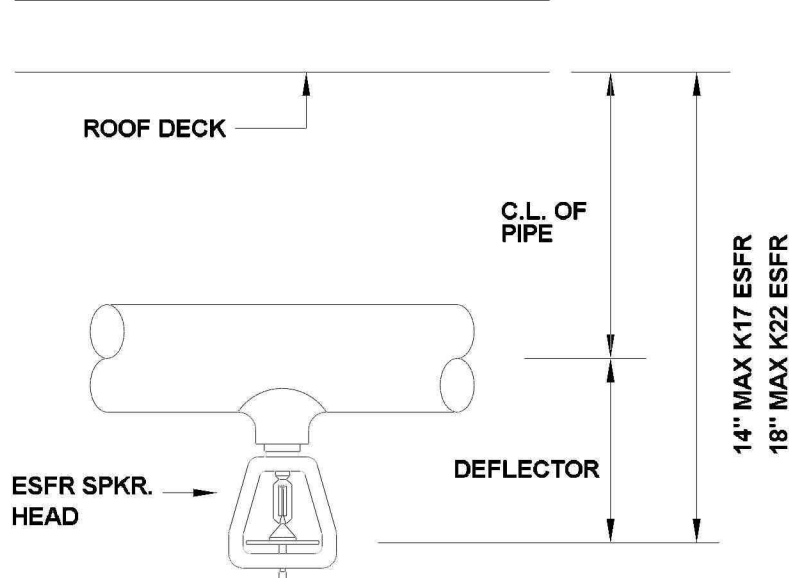

ESFR PENDENT DETAIL



N.T.S.

HANGER INSTALLATION REQUIREMENTS								
MAXIMUM DISTANCE BETWEEN HANGERS								
NOMINAL PIPE SIZE	3/4"	1"	1-1/4"	1-1/2"	2"	2-1/2"	3"	4"
BLAZEMASTER-OPV-G	5'-6"	8'-0"	8'-8"	7'-0"	8'-0"	9'-0"	10'-0"	N/A
THREADED LIGHTWALL	N/A	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"	N/A
STEEL PIPE (7/10/ 40)	N/A	12'-0"	12'-0"	15'-0"	15'-0"	15'-0"	15'-0"	15'-0"


THE UNSUPPORTED LENGTH BETWEEN THE END SPRINKLER AND THE LAST HANGER ON THE LINE SHALL NOT EXCEED 36" FOR 1" PIPE, 48" FOR 1 1/4" PIPE AND 60" FOR 1 1/2" PIPE OR LARGER

THE CUMULATIVE HORIZONTAL LENGTH OF AN UNSUPPORTED ARMORVO TO A SPRINKLER, SPRINKLER DROP, OR SPRIG-UP SHALL NOT EXCEED 24"

NOMINAL PIPE SIZE	SCHEDULE 40			SCHEDULE 10			EDDYFLOW		
	O.D.	I.D.	WALL THICKNESS	O.D.	I.D.	WALL THICKNESS	O.D.	I.D.	WALL THICKNESS
1	1.315	1.049	.133	1.315	1.097	.109	1.315	1.191	.062
1 1/4	1.660	1.380	.140	1.660	1.442	.109	1.660	1.536	.062
1 1/2	1.900	1.610	.145	1.900	1.682	.109	1.900	1.728	.086
2	2.375	2.067	.154	2.375	2.157	.109	2.375	2.203	.086
2 1/2	2.875	2.469	.203	2.875	2.635	.120	2.875	2.703	.086
3	3.500	3.068	.216	3.500	3.260	.120	3.500	3.314	.093
4	4.500	4.026	.237	4.500	4.260	.120	4.500	4.310	.095
5	5.563	5.047	.258	5.563	5.295	.134	----	----	----
6	6.625	6.065	.280	6.625	6.357	.134	----	----	----
8	8.625	7.981	.322	8.625	8.249	.168	----	----	----
10	10.750	10.020	.365	10.750	10.370	.188	----	----	----

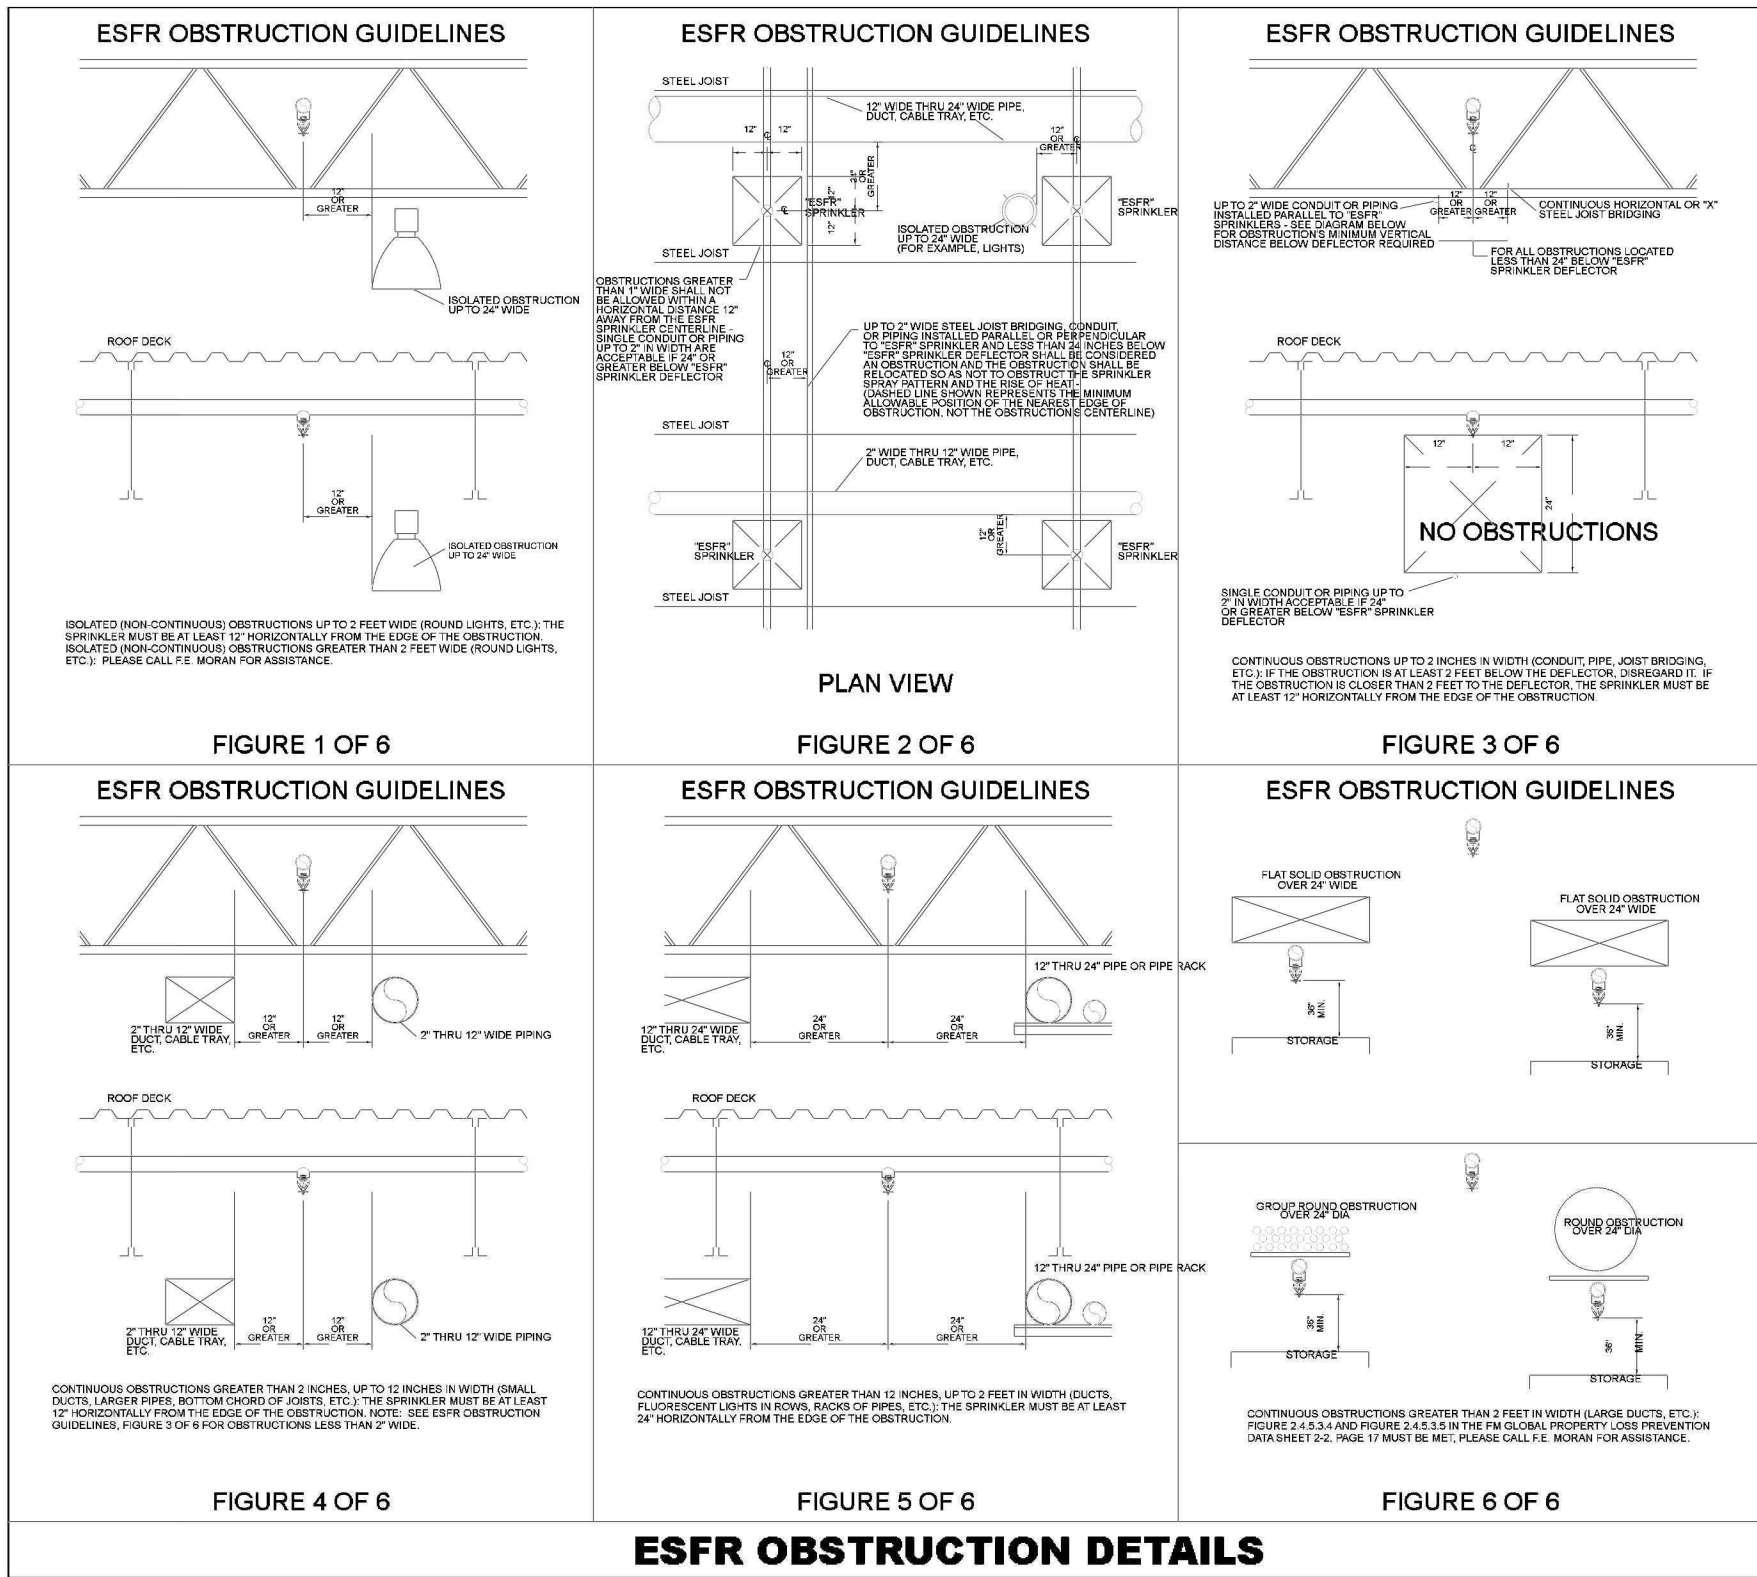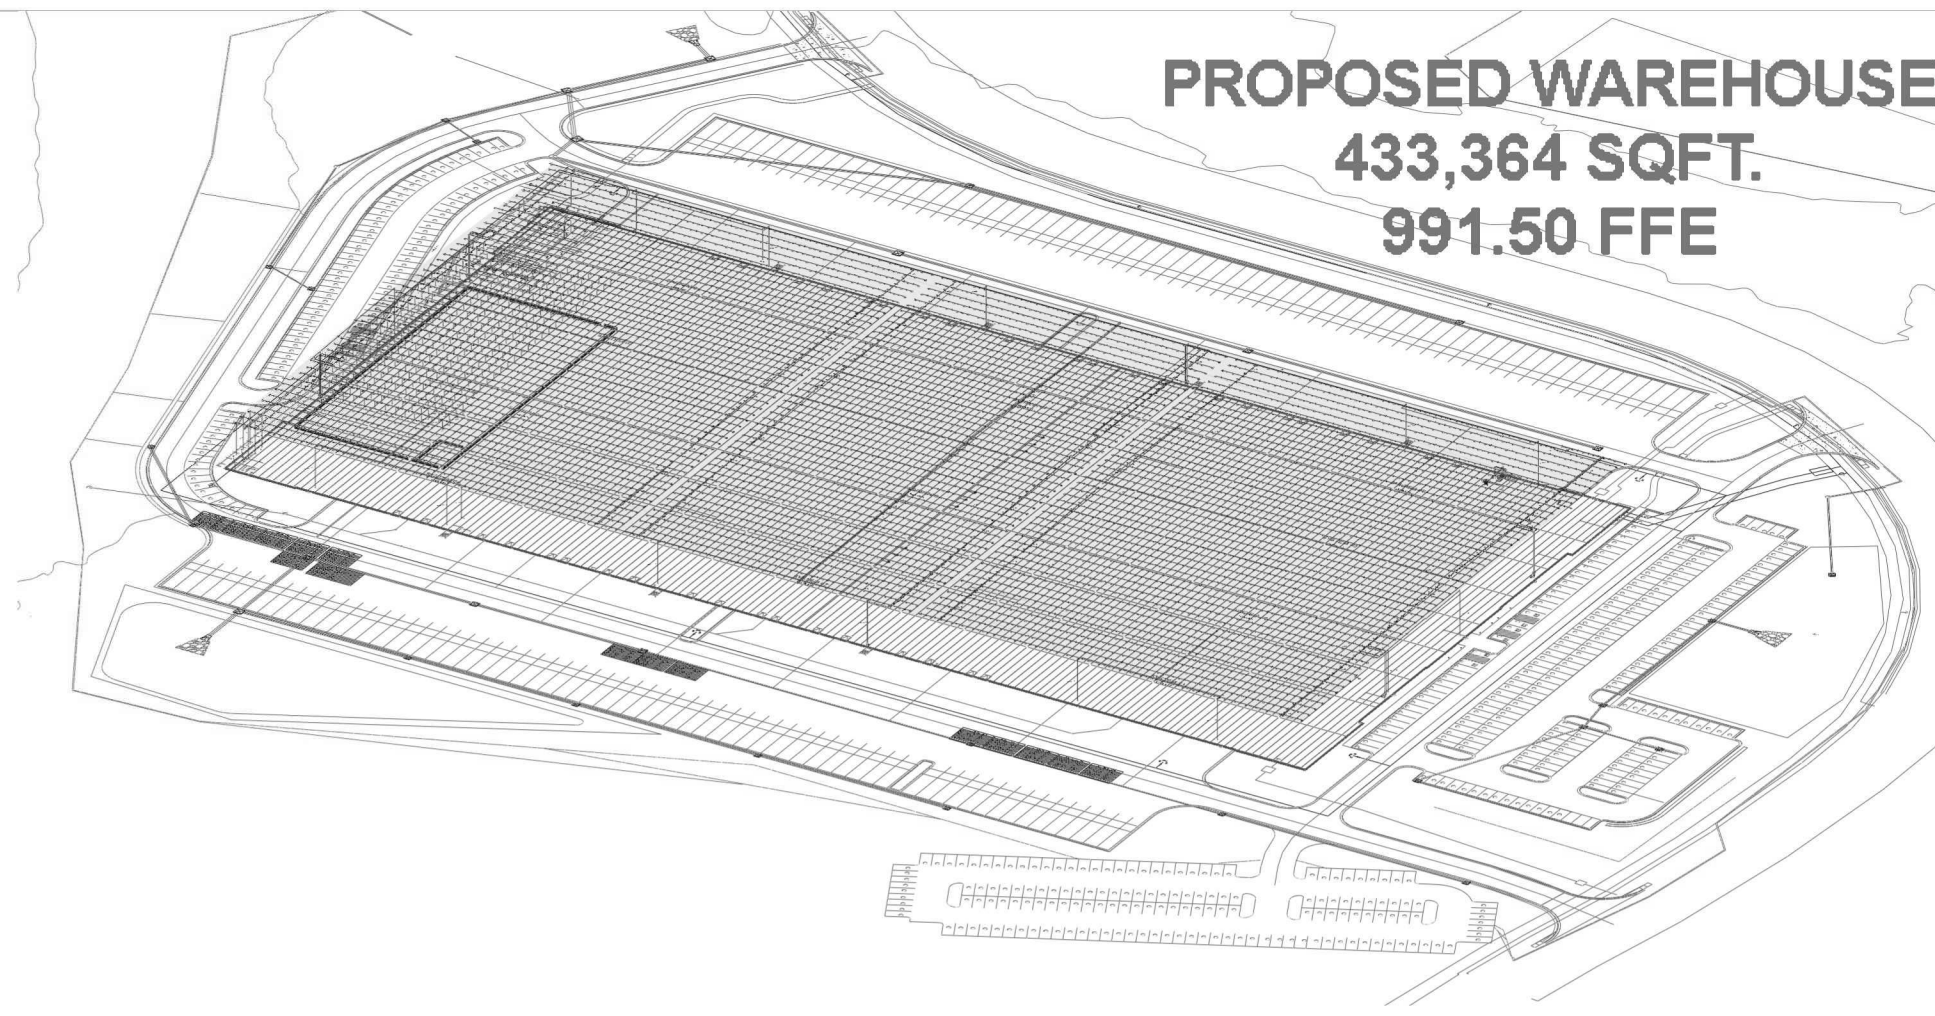

ESFR OBSTRUCTION DETAILS

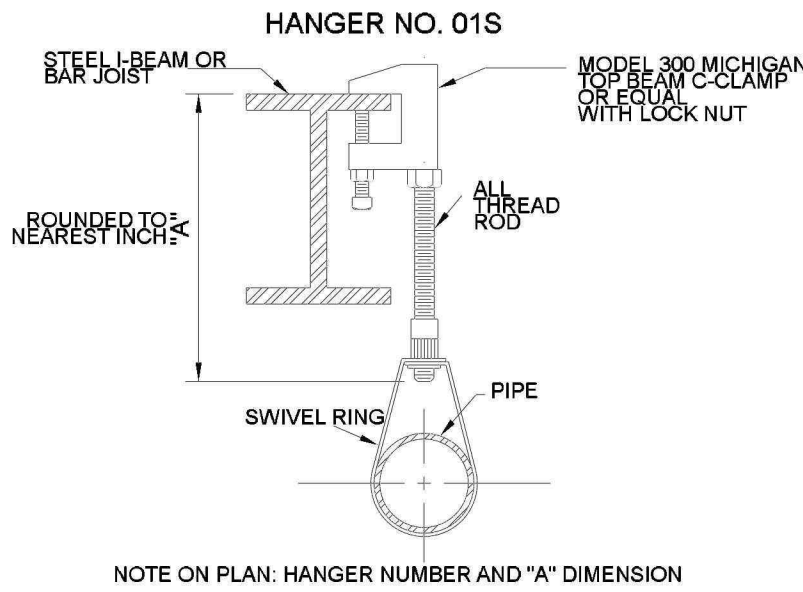

TOP BEAM C-CLAMP DETAIL


N.T.S.

DRAWING INDEX

FP0-0- SYSTEM NOTES  
FP1-0- HYDRAULIC SITE PLAN  
FP2-0- OVERHEAD PIPING PLAN  
FP2.1.1- AREA 1: SYSTEMS 1-2  
FP2.1.2- AREA 1: SYSTEMS 1-2 (CONT.)  
FP2.2.1- AREA 2: SYSTEMS 2-3  
FP2.2.2- AREA 2: SYSTEMS 2-3 (CONT.)  
FP2.3.1- AREA 3: SYSTEMS 3-4  
FP2.3.2- AREA 3: SYSTEMS 3-4 (CONT.)  
FP2.4- AREA 4: SYSTEM 05  
FP2.5- AREA 5: SYSTEM 06  
FP2.6- AREA 6: SYSTEM 07  
FP2.7.1- AREA 7: SYSTEMS 08-09  
FP2.7.2- AREA 7: SYSTEMS 08-09 (CONT.)  
FP2.8.1- AREA 8: SYSTEMS 09-10  
FP2.8.2- AREA 8: SYSTEM 09-10 (CONT.)  
FP2.9.1- AREA 9: SYSTEMS 10-11  
FP2.9.2- AREA 9: SYSTEMS 10-11 (CONT.)  
FP3-0- FIRE PUMP & RISER DETAIL



JASIEL COLBERT  
NICET LEVEL 1  
AUTO. SPRINKLER SYS. LAYOUT  
VALID THROUGH MARCH 03, 2025

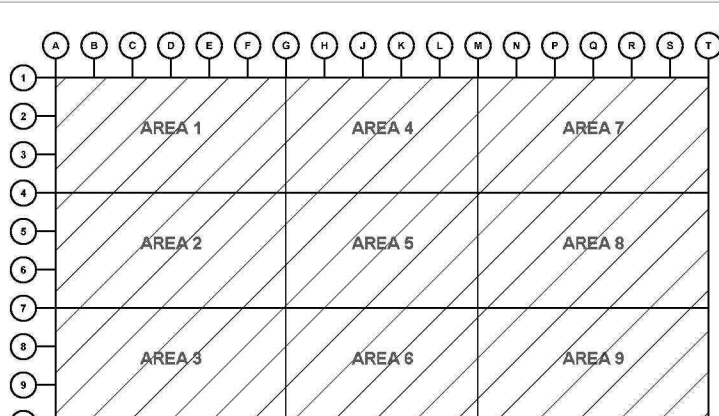

KEY PLAN



CURRAN  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



SCANNELL  
PROPERTIES

CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS

BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES

PERMIT SET 02.18.22

TENANT IMPROVEMENT 09.07.22

210300

FP0.0

SYSTEM NOTES




ALL UNDERGROUND PIPING AND  
APPURTENANCES WILL BE PROVIDED BY  
OTHERS



VICINITY SITE MAP

N.T.S.



TEST HYDRANT

WATER FLOW TEST DATA	
DATE	03.31.2022
STATIC PRESSURE	97 PSI (980 ELEV.)
RESIDUAL PRESSURE	88 PSI @ 1900 GPM
SOURCE INFO	LEE'S SUMMIT WATER UTILITIES



**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY OF  
CURRAN ARCHITECTURE, AND ARE NOT TO  
BE USED OR REPRODUCED, WHOLE OR IN  
PART, WITHOUT THE WRITTEN CONSENT OF  
CURRAN ARCHITECTURE.

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES

PERMIT SET 02.18.22

TENANT IMPROVEMENT 09.07.22



210300

**FP1.0**  
HYDRAULIC SITE  
PLAN

PROPOSED WAREHOUSE  
433,364 SQFT.  
991 FFE

HYDRAULIC SITE PLAN

SCALE: 1" = 40'-0"

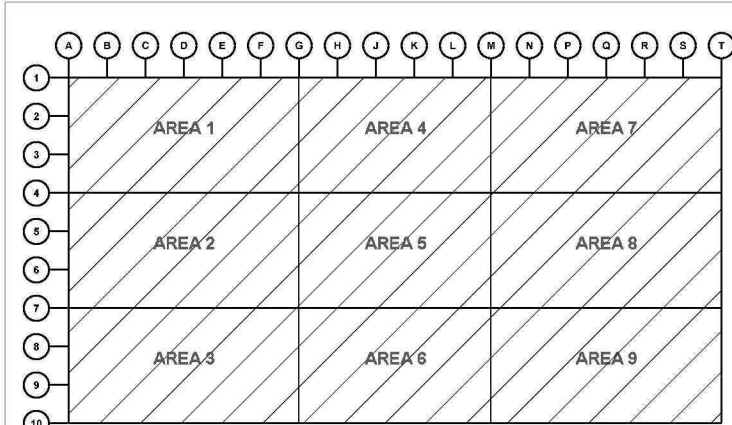

KEY PLAN





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



**SCANNELL**  
PROPERTIES

CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


ISSUE DATES

PERMIT SET 02.18.22  
TENANT IMPROVEMENT 09.07.22


210300

**FP2.0**

OVERHEAD PIPING  
LAYOUT

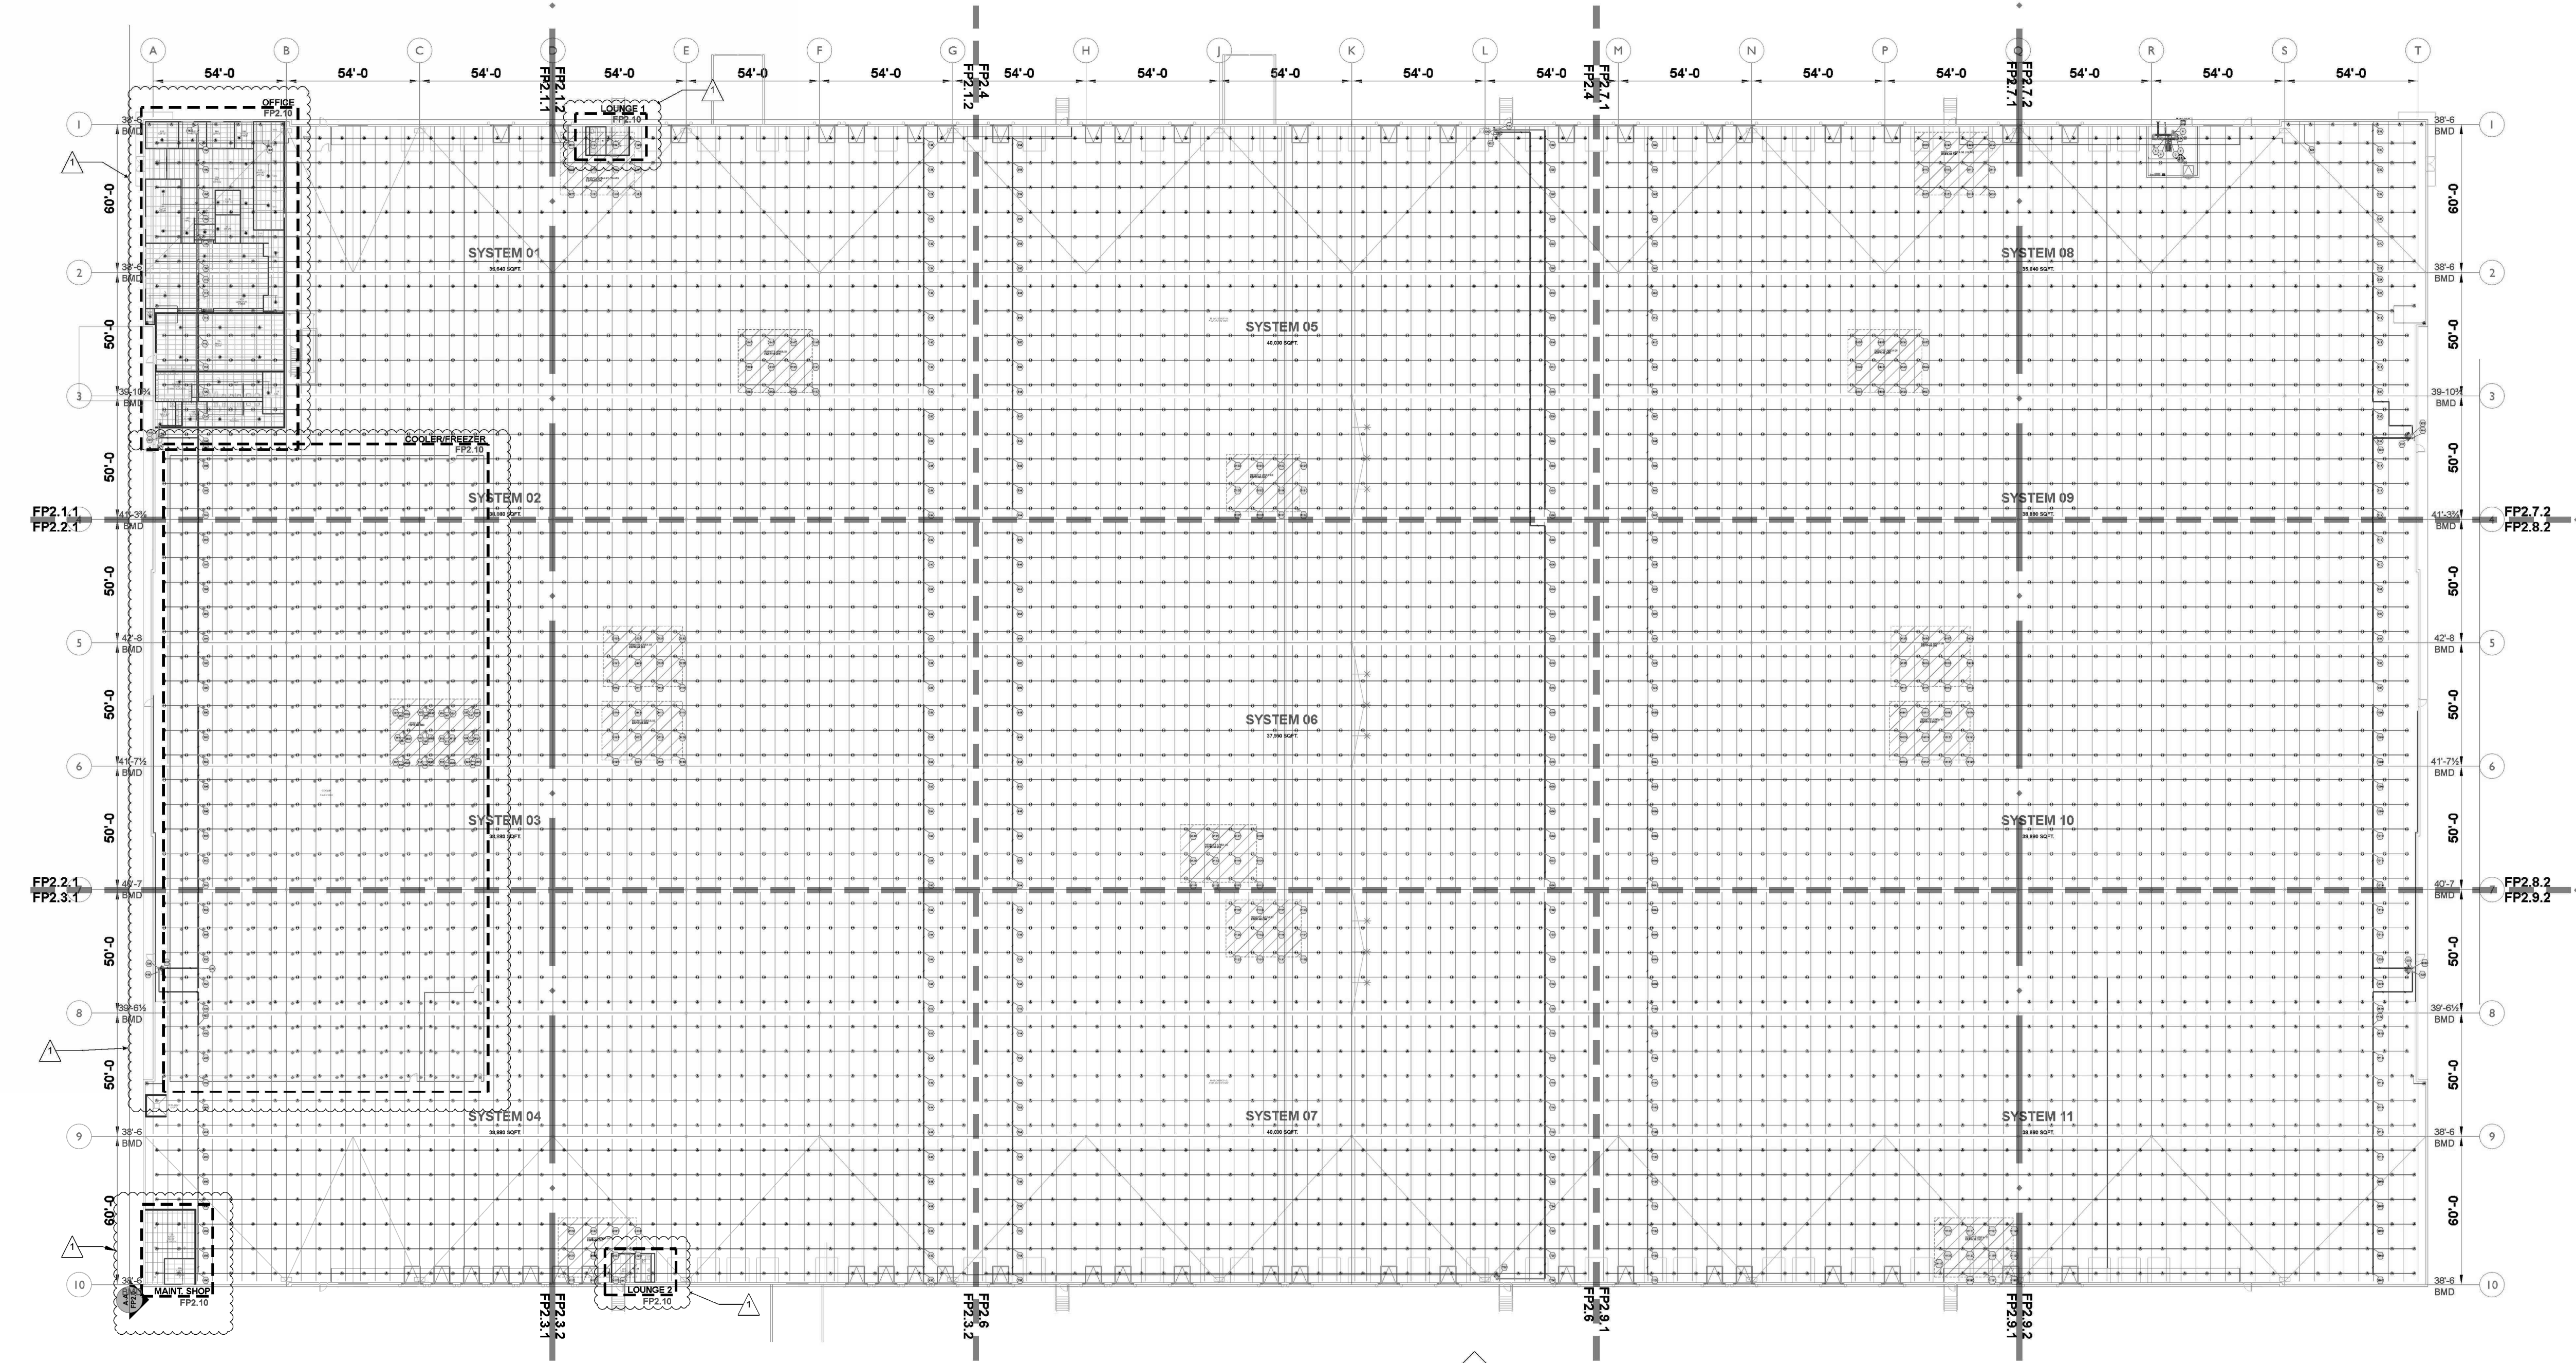


OVERHEAD PIPING  
SCALE: 1" = 30'-0"

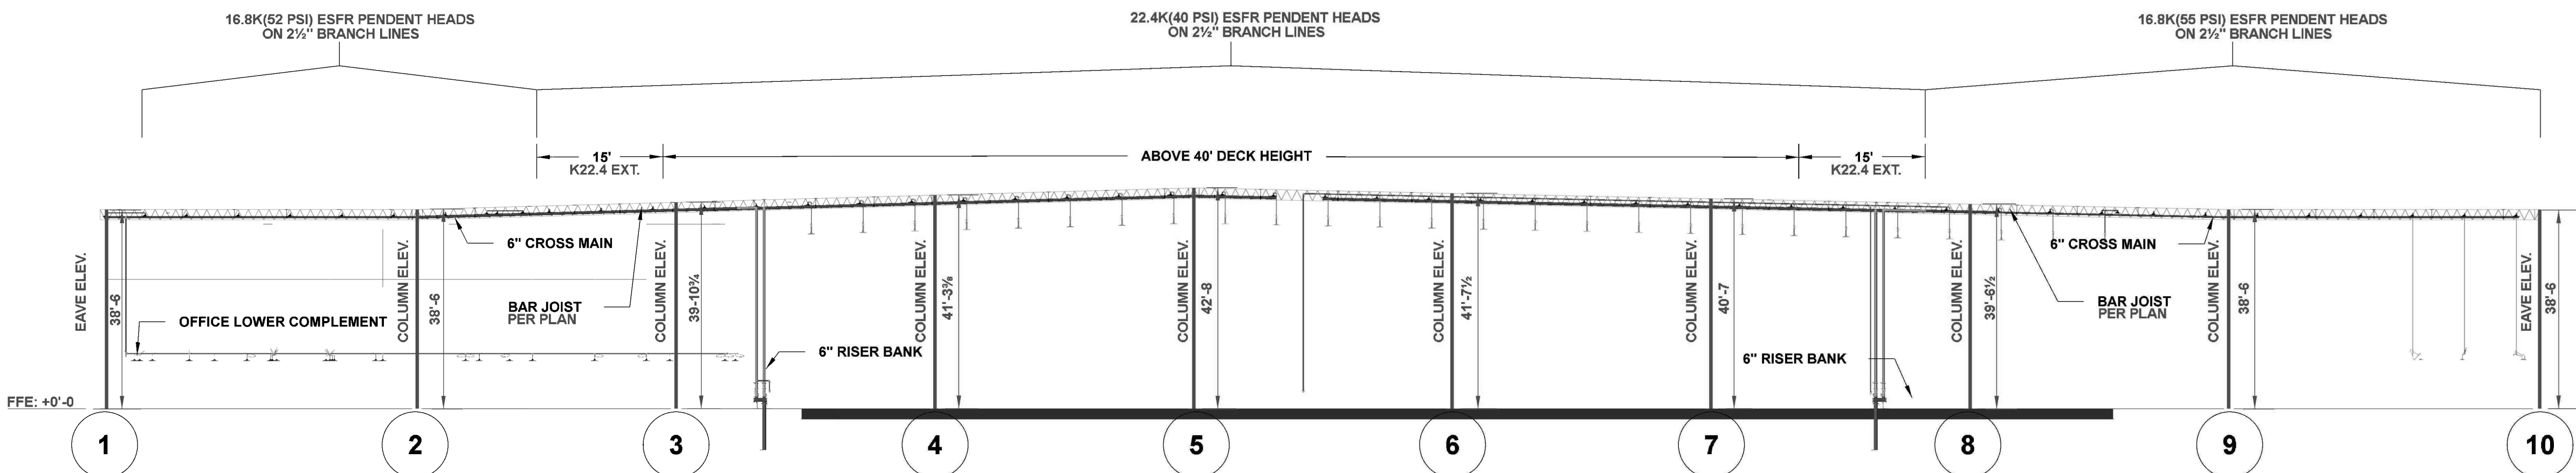

WALL VIEW (SECTION A-A)  
SCALE: 1/16" = 1'-0"

Sprinkler Legend									
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH
▲	2054	VICTAULIC	V4702	FLORIST/ESFR	16.8	PENDENT	1/2"	FAST	BRASS
●	4	VICTAULIC	V3406	ESFR	8	PENDENT	1/2"	QUICK	BRASS
●	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1"	FAST	BRASS
●	48	VIKING	VK600	MICROFAST	5.8	PENDENT	1/2"	QUICK	CHROME
●	6	VIKING	VK3221	ESFR	5.8	PENDENT	1/2"	QUICK	CHROME
●	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	1/2"	QUICK	BRASS
TOTAL = 5234									

\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6" OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

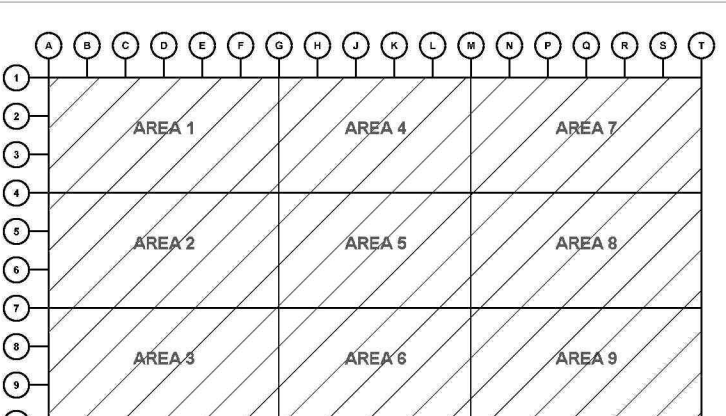

KEY PLAN





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



**SCANNELL**  
PROPERTIES

CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


ISSUE DATES

PERMIT SET 02.18.22  
TENANT IMPROVEMENT 09.07.22

210300

**FP2.1.1**

AREA 1: SYSTEMS  
01-02

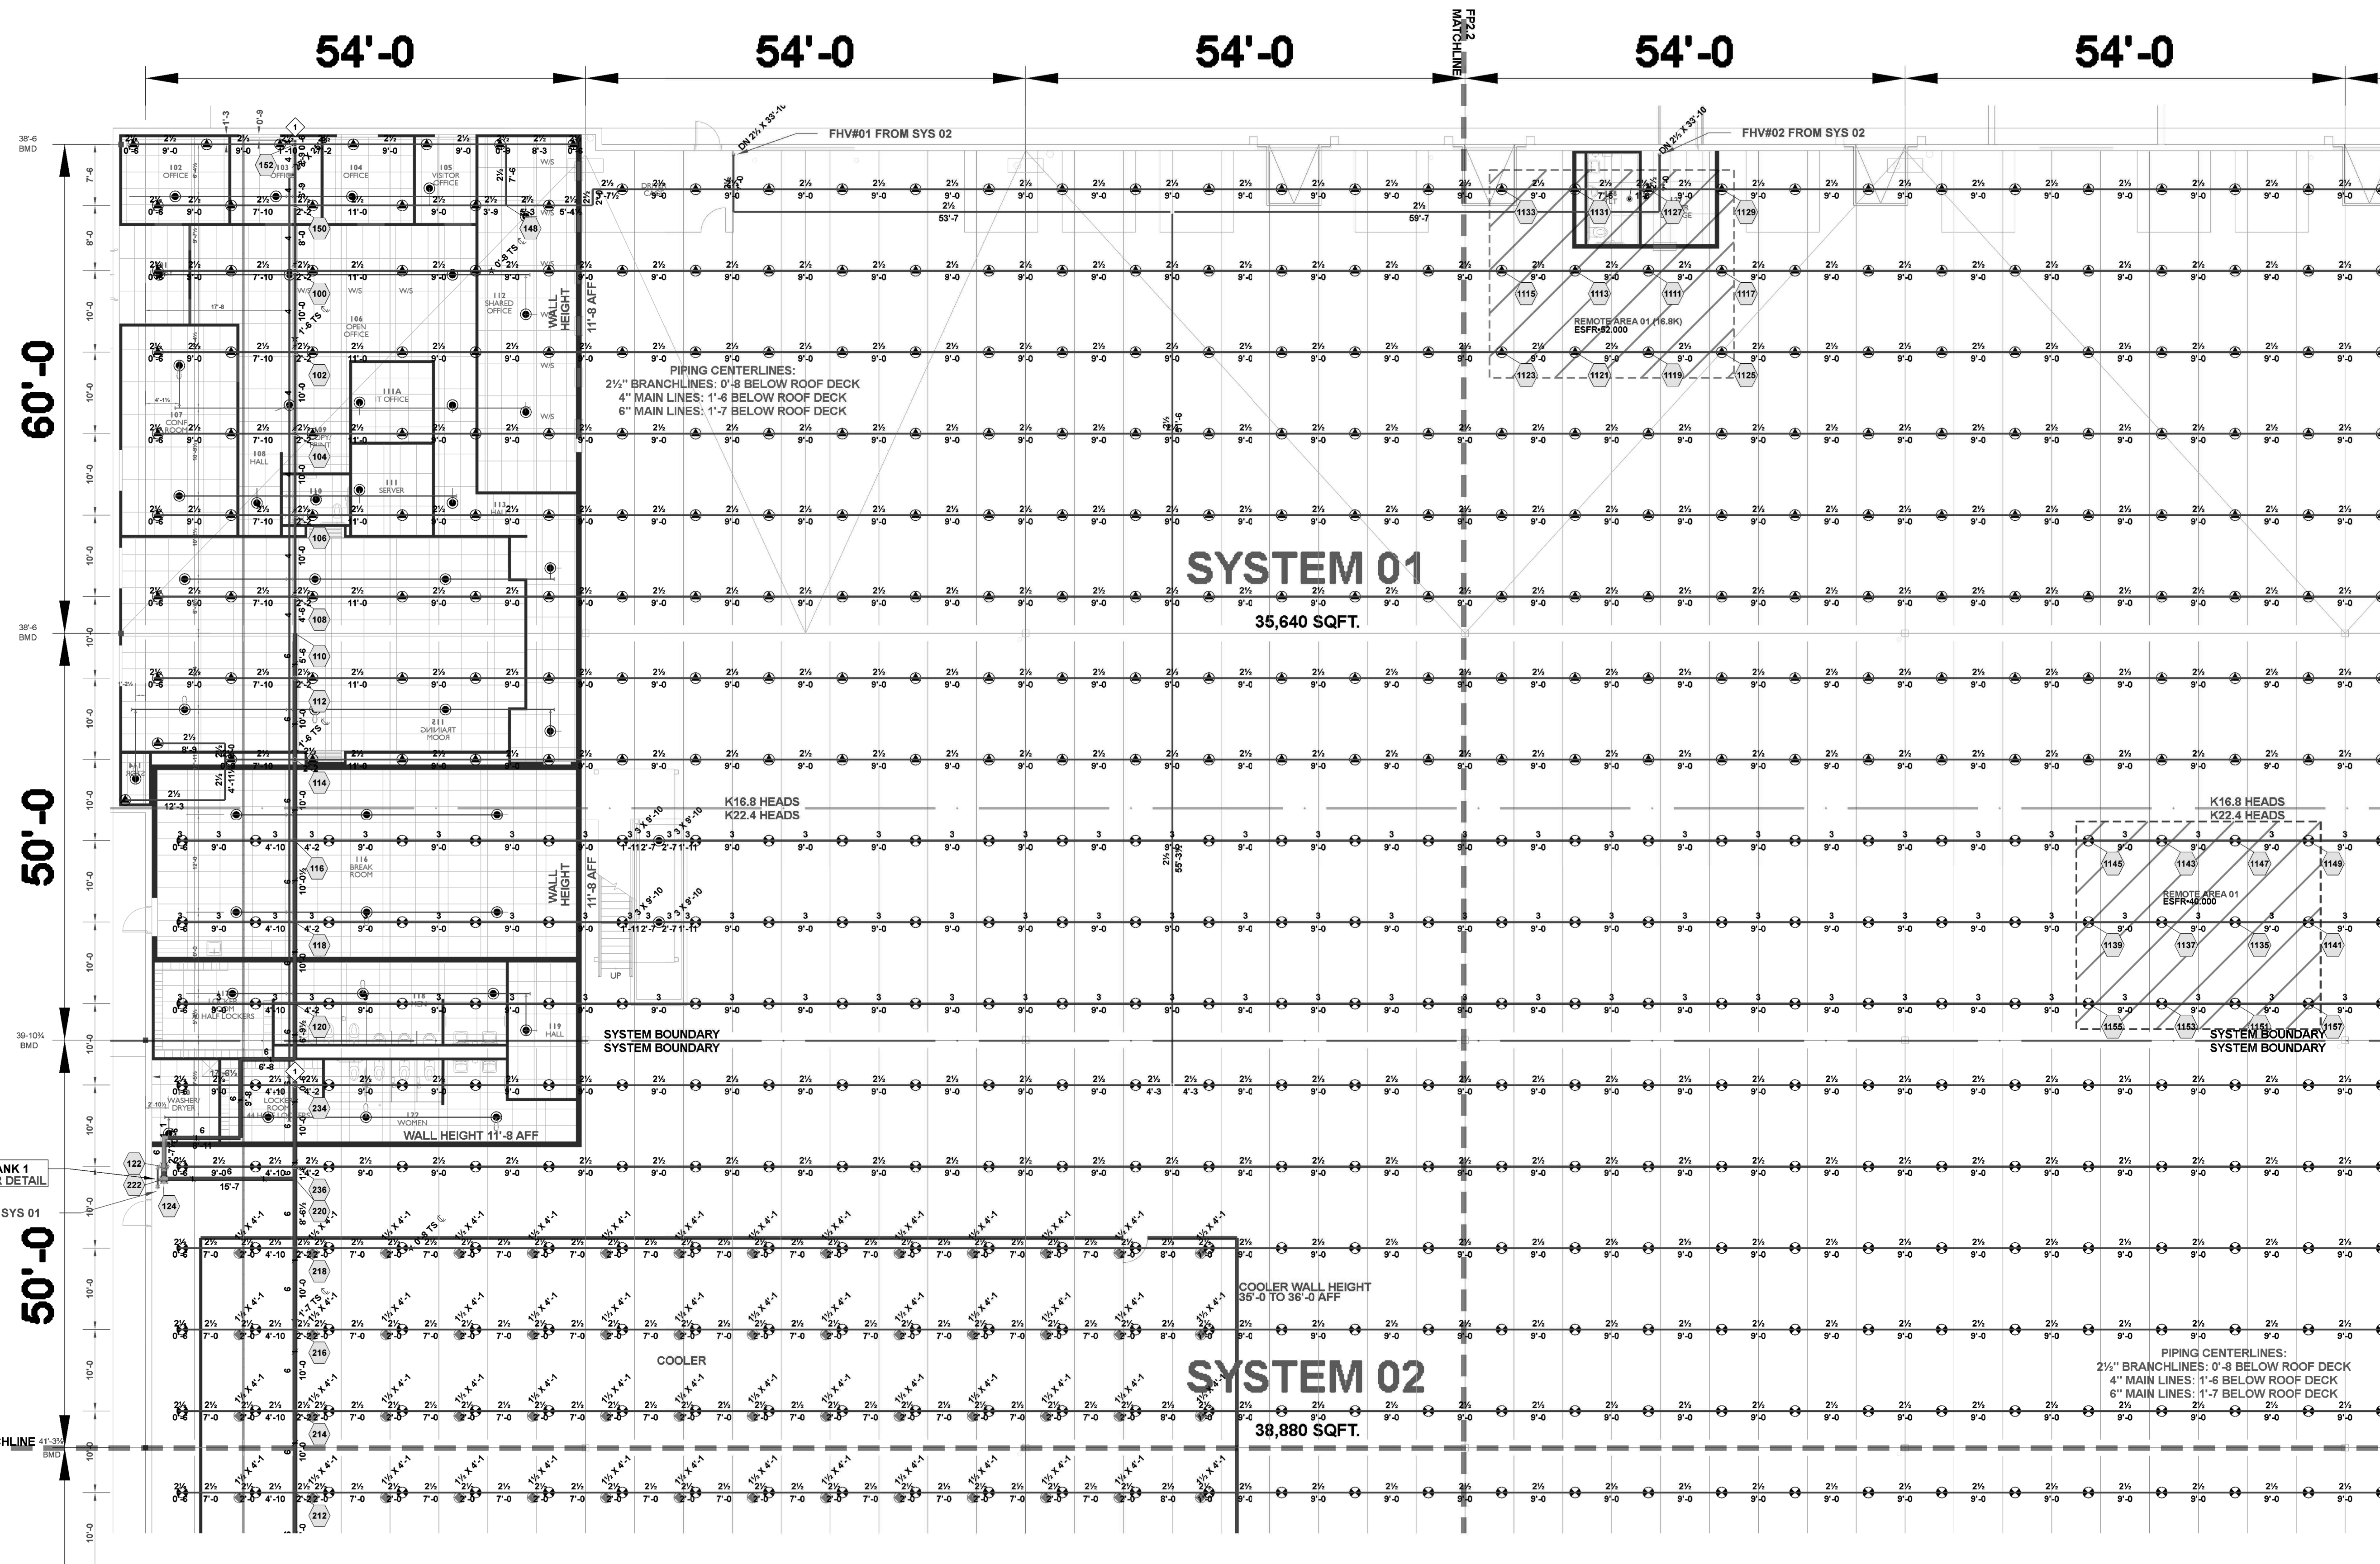

Hydraulic Information	
Remote Area 01 (K16.8)	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	52.000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	16.8
TOTAL WATER REQUIRED	1711.60
TOTAL PRESSURE REQUIRED	75.095
BASE OF RISER (GPM)	1711.60
BASE OF RISER (PSI)	75.095
SAFETY MARGIN (PSI)	+14.486 (16.2%)

Hydraulic Information	
Remote Area 01	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	40.000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	22.4
TOTAL WATER REQUIRED	1959.70
TOTAL PRESSURE REQUIRED	68.043
BASE OF RISER (GPM)	1959.70
BASE OF RISER (PSI)	68.043
SAFETY MARGIN (PSI)	+19.427 (22.2%)


AREA 1: SYSTEMS 01-02

SCALE: 3/32" = 1'-0"

Sprinkler Legend

SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE	NOTE
▲	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	3/4"	FAST	BRASS	200°F	
⊗	4	VICTAULIC	V3406	V34	8	PENDENT	3/4"	QUICK	BRASS	200°F	
◆	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1"	FAST	BRASS	200°F	
●	48	VIKING	VK600	MICROFAST	5.6	PENDENT	1/2"	QUICK	CHROME	135°F	
○	6	VIKING	VK3021		5.6	PENDENT	1/2"	QUICK	CHROME	135°F	
◆	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	3/4"	QUICK	BRASS	205°F	
TOTAL = 5234											

\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6" OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

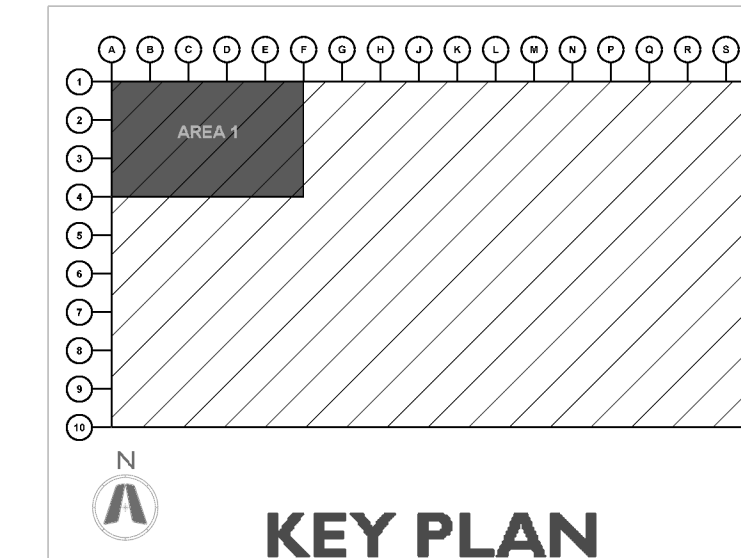





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



**SCANNELL**  
PROPERTIES

CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY OF  
CURRAN ARCHITECTURE, AND ARE NOT TO  
BE USED OR REPRODUCED, WHOLE OR IN  
PART, WITHOUT THE WRITTEN CONSENT OF  
CURRAN ARCHITECTURE.

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


ISSUE DATES

PERMIT SET 02.18.22  
TENANT IMPROVEMENT 09.07.22

210300

**FP2.1.2**

AREA 1 (CONT.):  
SYSTEMS 01-02

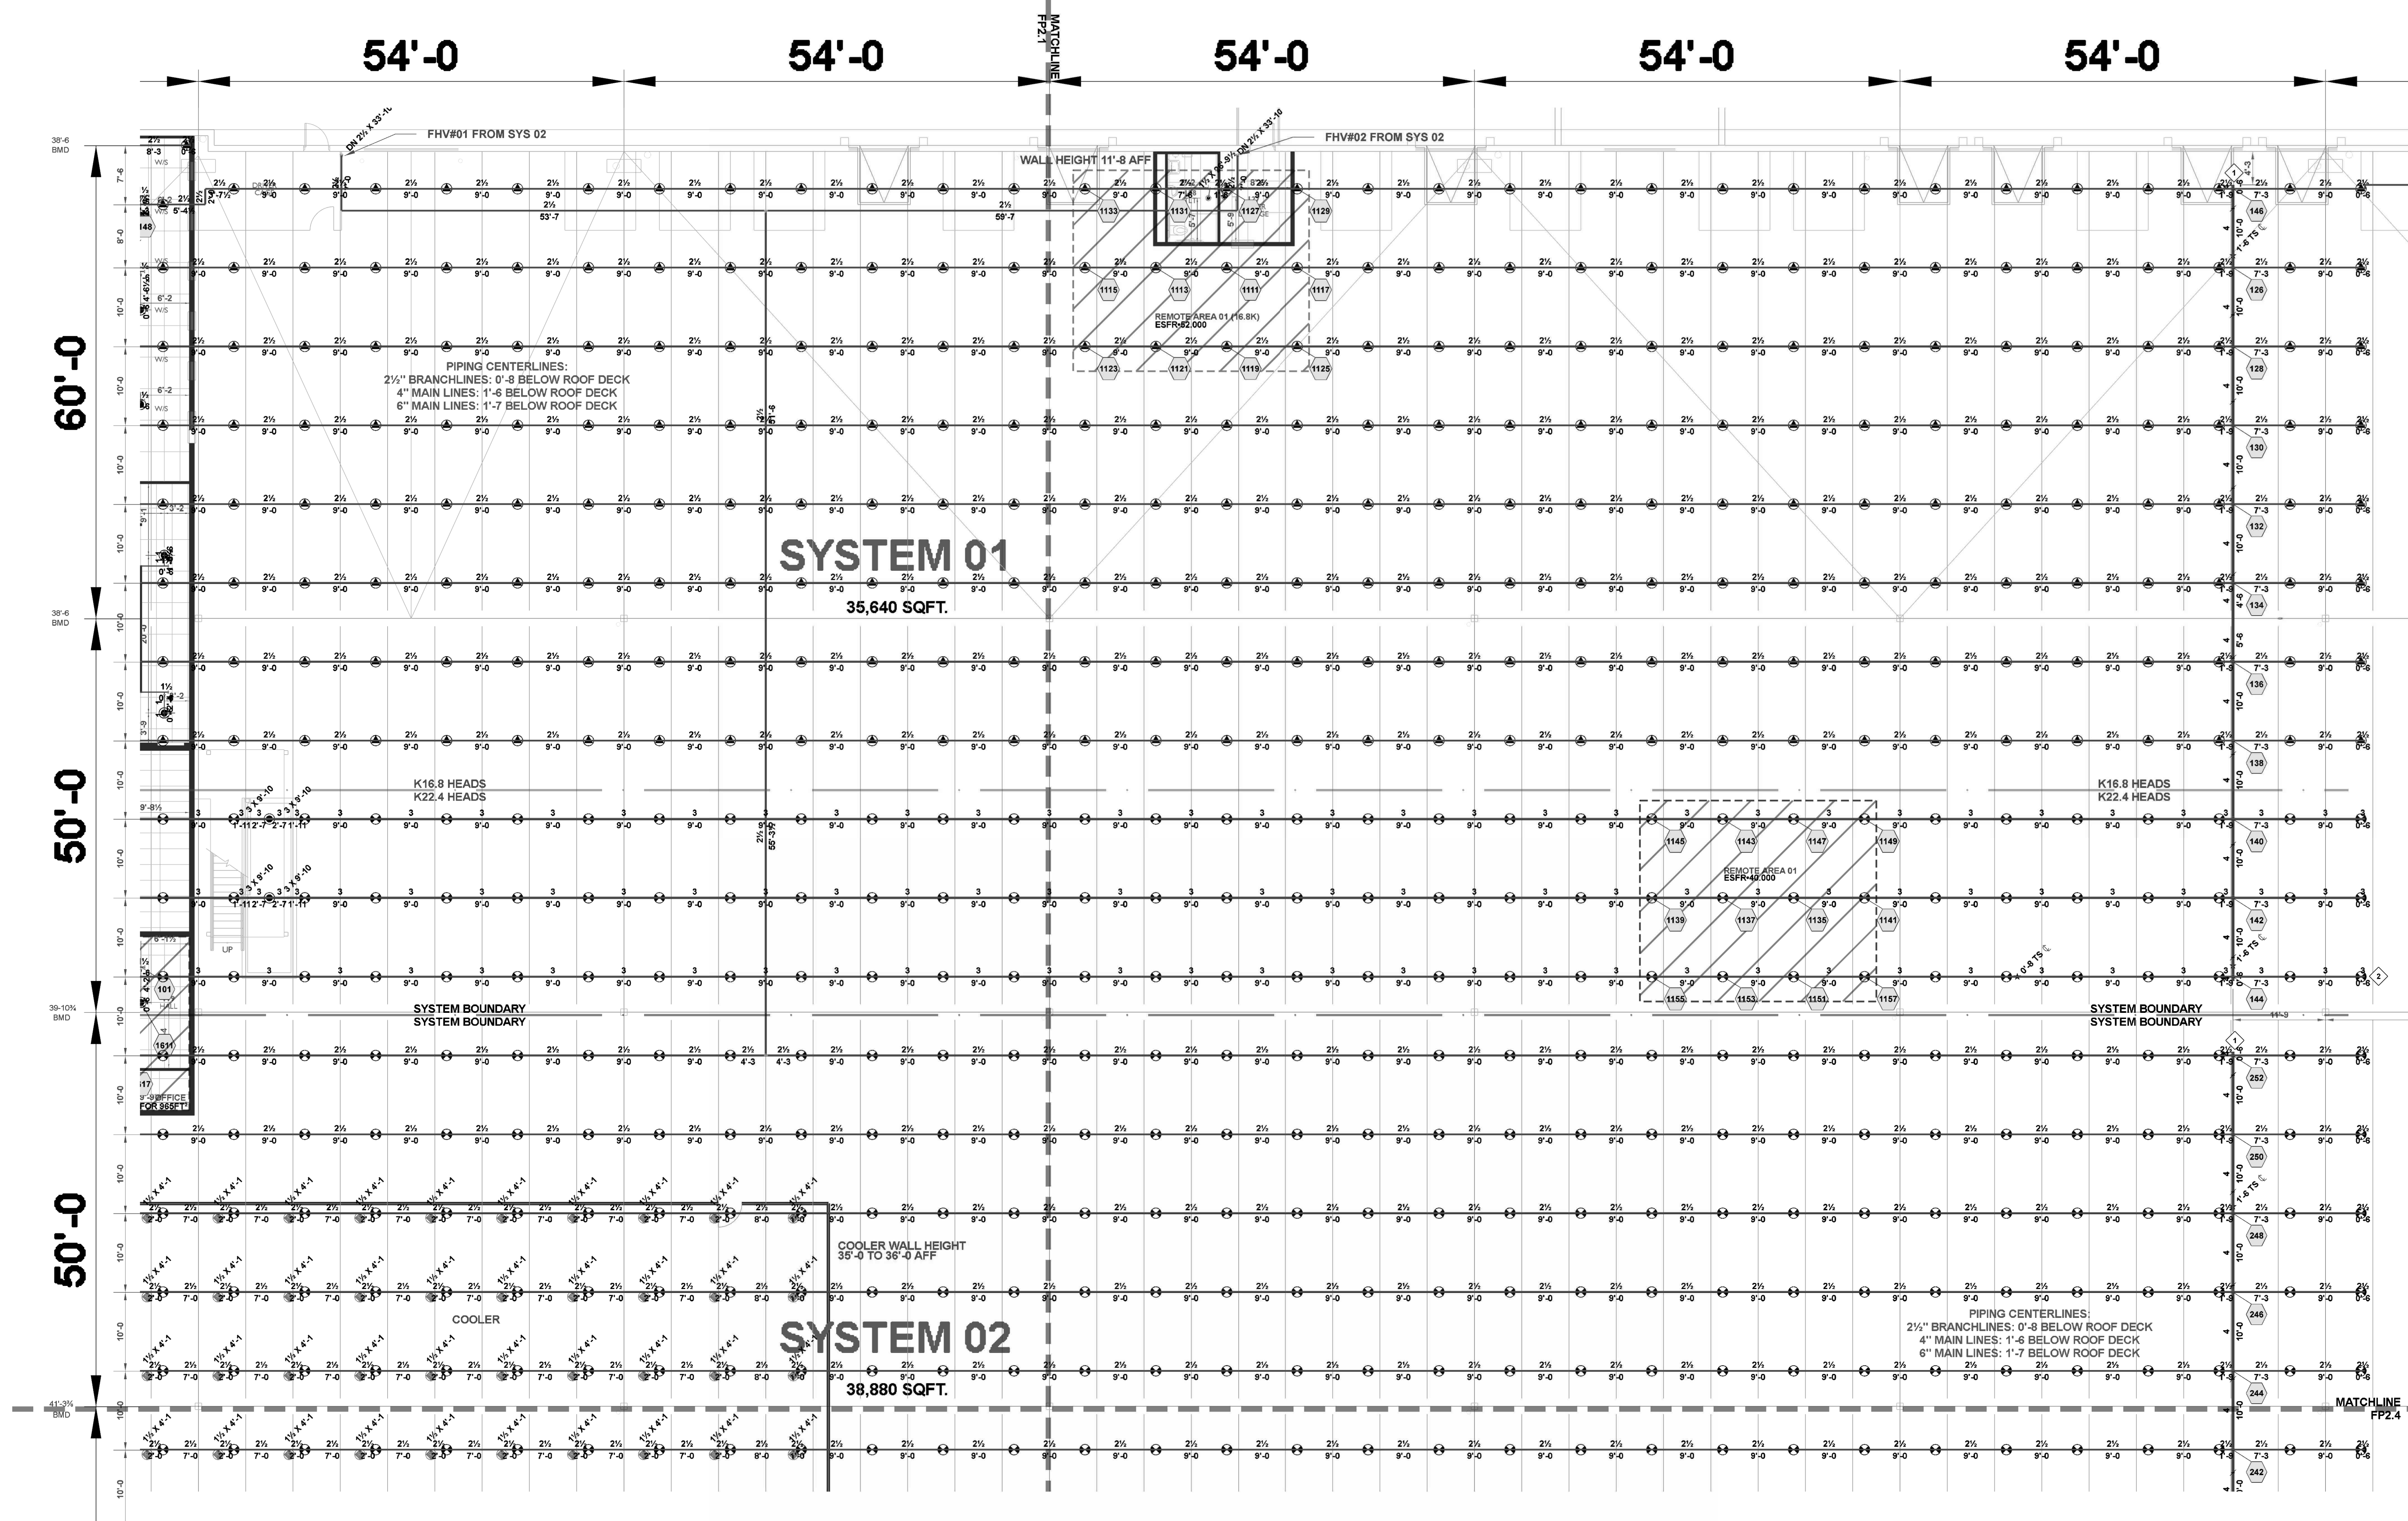


Hydraulic Information		Hydraulic Information	
Remote Area 01 (K16.8)		Remote Area 01	
OCCUPANCY CLASSIFICATION	ESFR	OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	52.000 (ESFR)	MIN. END HEAD PRESSURE	40.000 (ESFR)
TOTAL HOSE STREAMS	250.00	TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12	TOTAL HEADS FLOWING	12
K-FACTOR	16.8	K-FACTOR	22.4
TOTAL WATER REQUIRED	1711.60	TOTAL WATER REQUIRED	1959.70
TOTAL PRESSURE REQUIRED	75.095	TOTAL PRESSURE REQUIRED	68.043
BASE OF RISER (GPM)	1711.60	BASE OF RISER (GPM)	1959.70
BASE OF RISER (PSI)	75.095	BASE OF RISER (PSI)	68.043
SAFETY MARGIN (PSI)	+14.486 (16.2%)	SAFETY MARGIN (PSI)	+19.427 (22.2%)

Sprinkler Legend										
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE
▲	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	3/4"	FAST	BRASS	200°F
⊗	4	VICTAULIC	V3406	V34	8	PENDENT	3/4"	QUICK	BRASS	200°F
⊗	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1"	FAST	BRASS	200°F
⊗	48	VIKING	VK600	MICROFAST	5.6	PENDENT	1/2"	QUICK	CHROME	135°F
⊗	6	VIKING	VK3021		5.6	PENDENT	1/2"	QUICK	CHROME	135°F
⊗	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	3/4"	QUICK	BRASS	205°F
TOTAL = 5234										

AREA 1 (CONT.): SYSTEMS 01-02  
SCALE: 3/32" = 1'-0"

\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6"  
OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

▲ - AUXILIARY DRAIN  
SEE FP0.0 FOR DETAIL  
⊗ - AIR VENT  
SEE FP0.0 FOR DETAIL

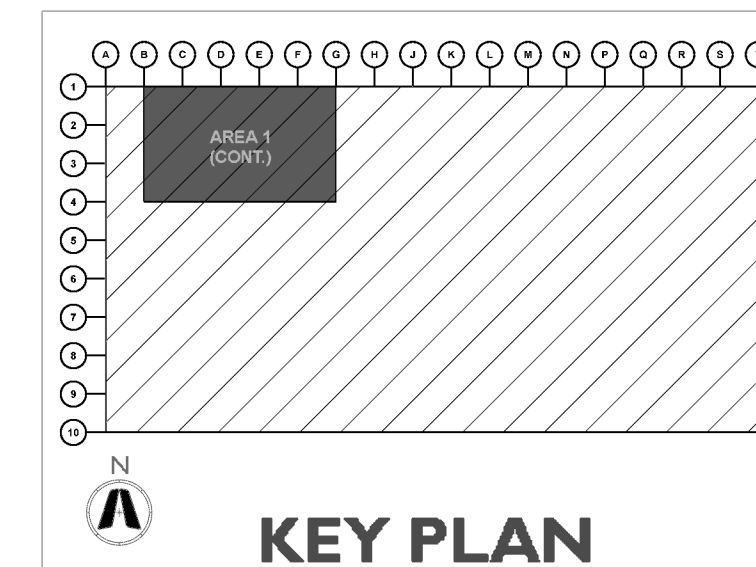






\_\_\_\_\_



## CERTIFICATION

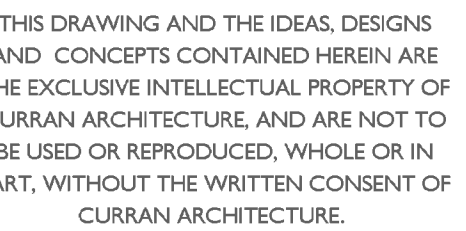

## PROJECT INFORMATION

## LEE'S SUMMIT LOGISTICS BUILDING A LOT 1

NW CORNER OF  
E TUDOR RD & MAIN ST  
EE'S SUMMIT, MO 64086

## ISSUE DATES

PERMIT SET 02.18.22

1	TENANT IMPROVEMENT	09.07.22
---	--------------------	----------

10300


### FP2.2.1

AREA 2: SYSTEM  
02-03



1 - **AUXILIARY DRAIN**  
SEE FP0.0 FOR DETAIL

2 - **AIR VENT**  
SEE FP0.0 FOR DETAIL

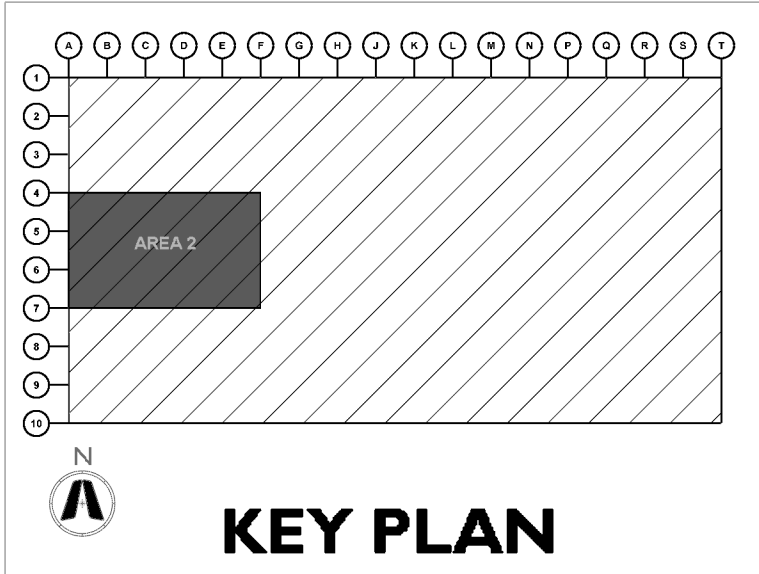







Hydraulic Information	
Remote Area 02	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	40,000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	22.4
TOTAL WATER REQUIRED	1956.70
TOTAL PRESSURE REQUIRED	78.341
BASE OF RISER (GPM)	1956.70
BASE OF RISER (PSI)	78.341
SAFETY MARGIN (PSI)	+9.156 (10.5%)

Hydraulic Information	
Remote Area 03	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	40,000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	22.4
TOTAL WATER REQUIRED	1958.59
TOTAL PRESSURE REQUIRED	79.726
BASE OF RISER (GPM)	1958.59
BASE OF RISER (PSI)	79.726
SAFETY MARGIN (PSI)	+77.54 (8.9%)

## AREA 2: SYSTEMS 02-03

**SCALE: 3/32" = 1'-0"**

Sprinkler Legend											
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE	NOTE
	2054	VICTAULIC	V4702	FL-QR-ST/ESFR	16.8	PENDENT	¾	FAST	BRASS	200°F	
	4	VICTAULIC	V3406	V34	8	PENDENT	¾	QUICK	BRASS	200°F	
	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1	FAST	BRASS	200°F	
	48	VIKING	VK600	MICROFAST	5.6	PENDENT	½	QUICK	CHROME	135°F	
	6	VIKING	VK3021		5.6	PENDENT	½	QUICK	CHROME	135°F	
	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	¾	QUICK	BRASS	205°F	
	TOTAL = 5234										





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.


PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I  
NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES

PERMIT SET 02.18.22  
TENANT IMPROVEMENT 09.07.22

210300  
**FP2.2**  
AREA 2(CONT):  
SYSTEMS 02-03

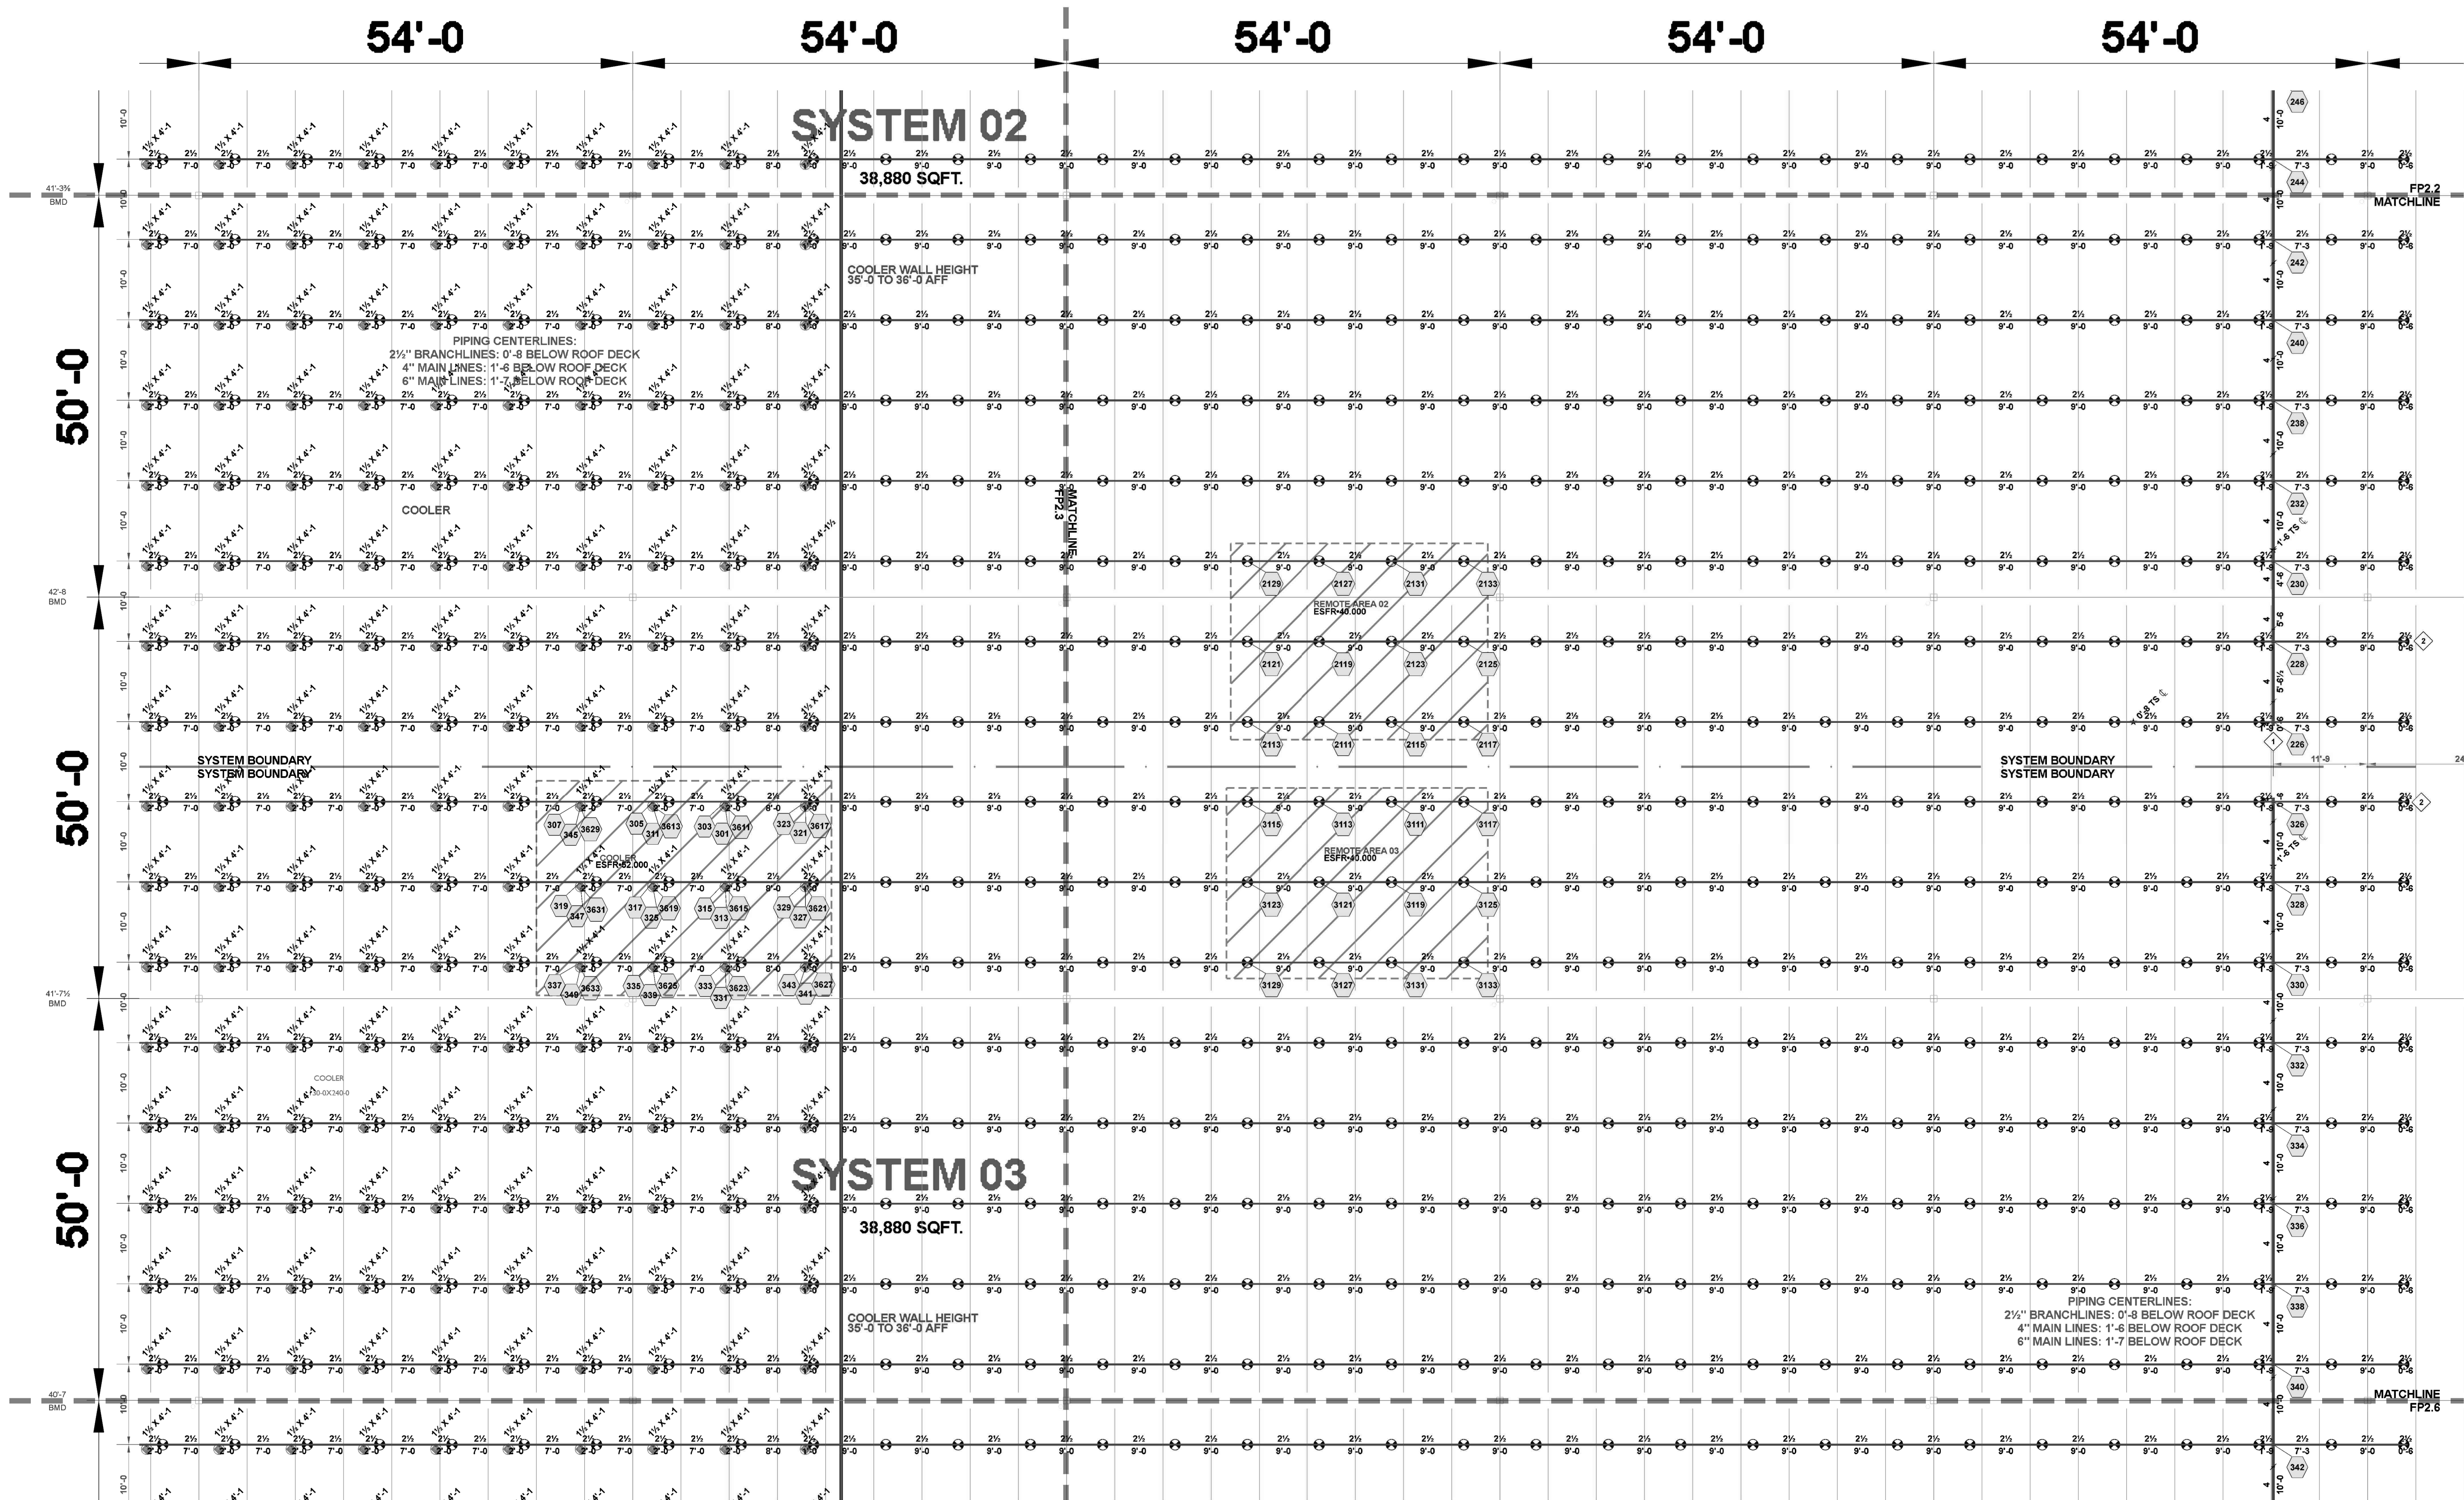


Hydraulic Information	
Remote Area 02	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	40.000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	22.4
TOTAL WATER REQUIRED	1956.70
TOTAL PRESSURE REQUIRED	78.341
BASE OF RISER (GPM)	1956.70
BASE OF RISER (PSI)	78.341
SAFETY MARGIN (PSI)	+9.156 (10.5%)

Hydraulic Information	
Remote Area 03	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	40.000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	22.4
TOTAL WATER REQUIRED	1958.59
TOTAL PRESSURE REQUIRED	79.726
BASE OF RISER (GPM)	1958.59
BASE OF RISER (PSI)	79.726
SAFETY MARGIN (PSI)	+7.754 (8.9%)

AREA 2(CONT): SYSTEMS 02-03  
SCALE: 3/32" = 1'-0"

Sprinkler Legend										
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE
	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	3/4	FAST	BRASS	200°F
	4	VICTAULIC	V3406	V34	8	PENDENT	3/4	QUICK	BRASS	200°F
	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1	FAST	BRASS	200°F
	48	VIKING	VK600	MICROFAST	5.6	PENDENT	1/2	QUICK	CHROME	135°F
	368	VIKING	VK3021	ESFR DRY	5.6	PENDENT	1/2	QUICK	CHROME	135°F
	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	3/4	QUICK	BRASS	205°F
TOTAL = 5234										

\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6" OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

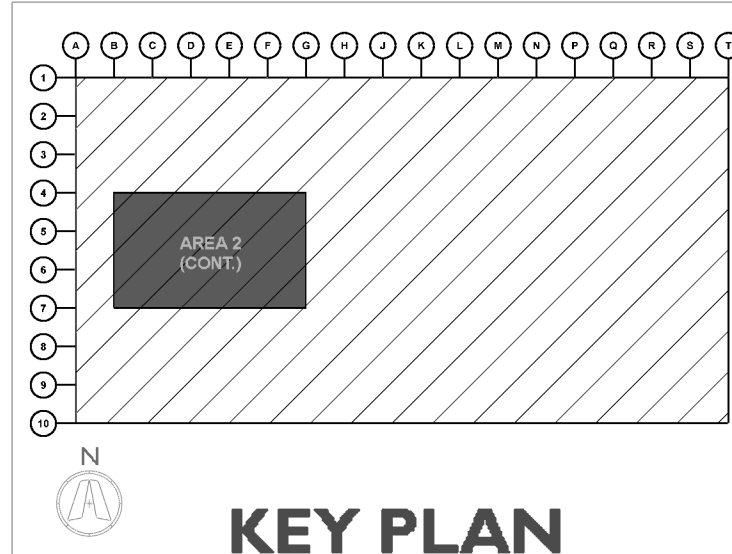





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753

**SCANNELL**  
PROPERTIES

CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.


PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I  
NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES





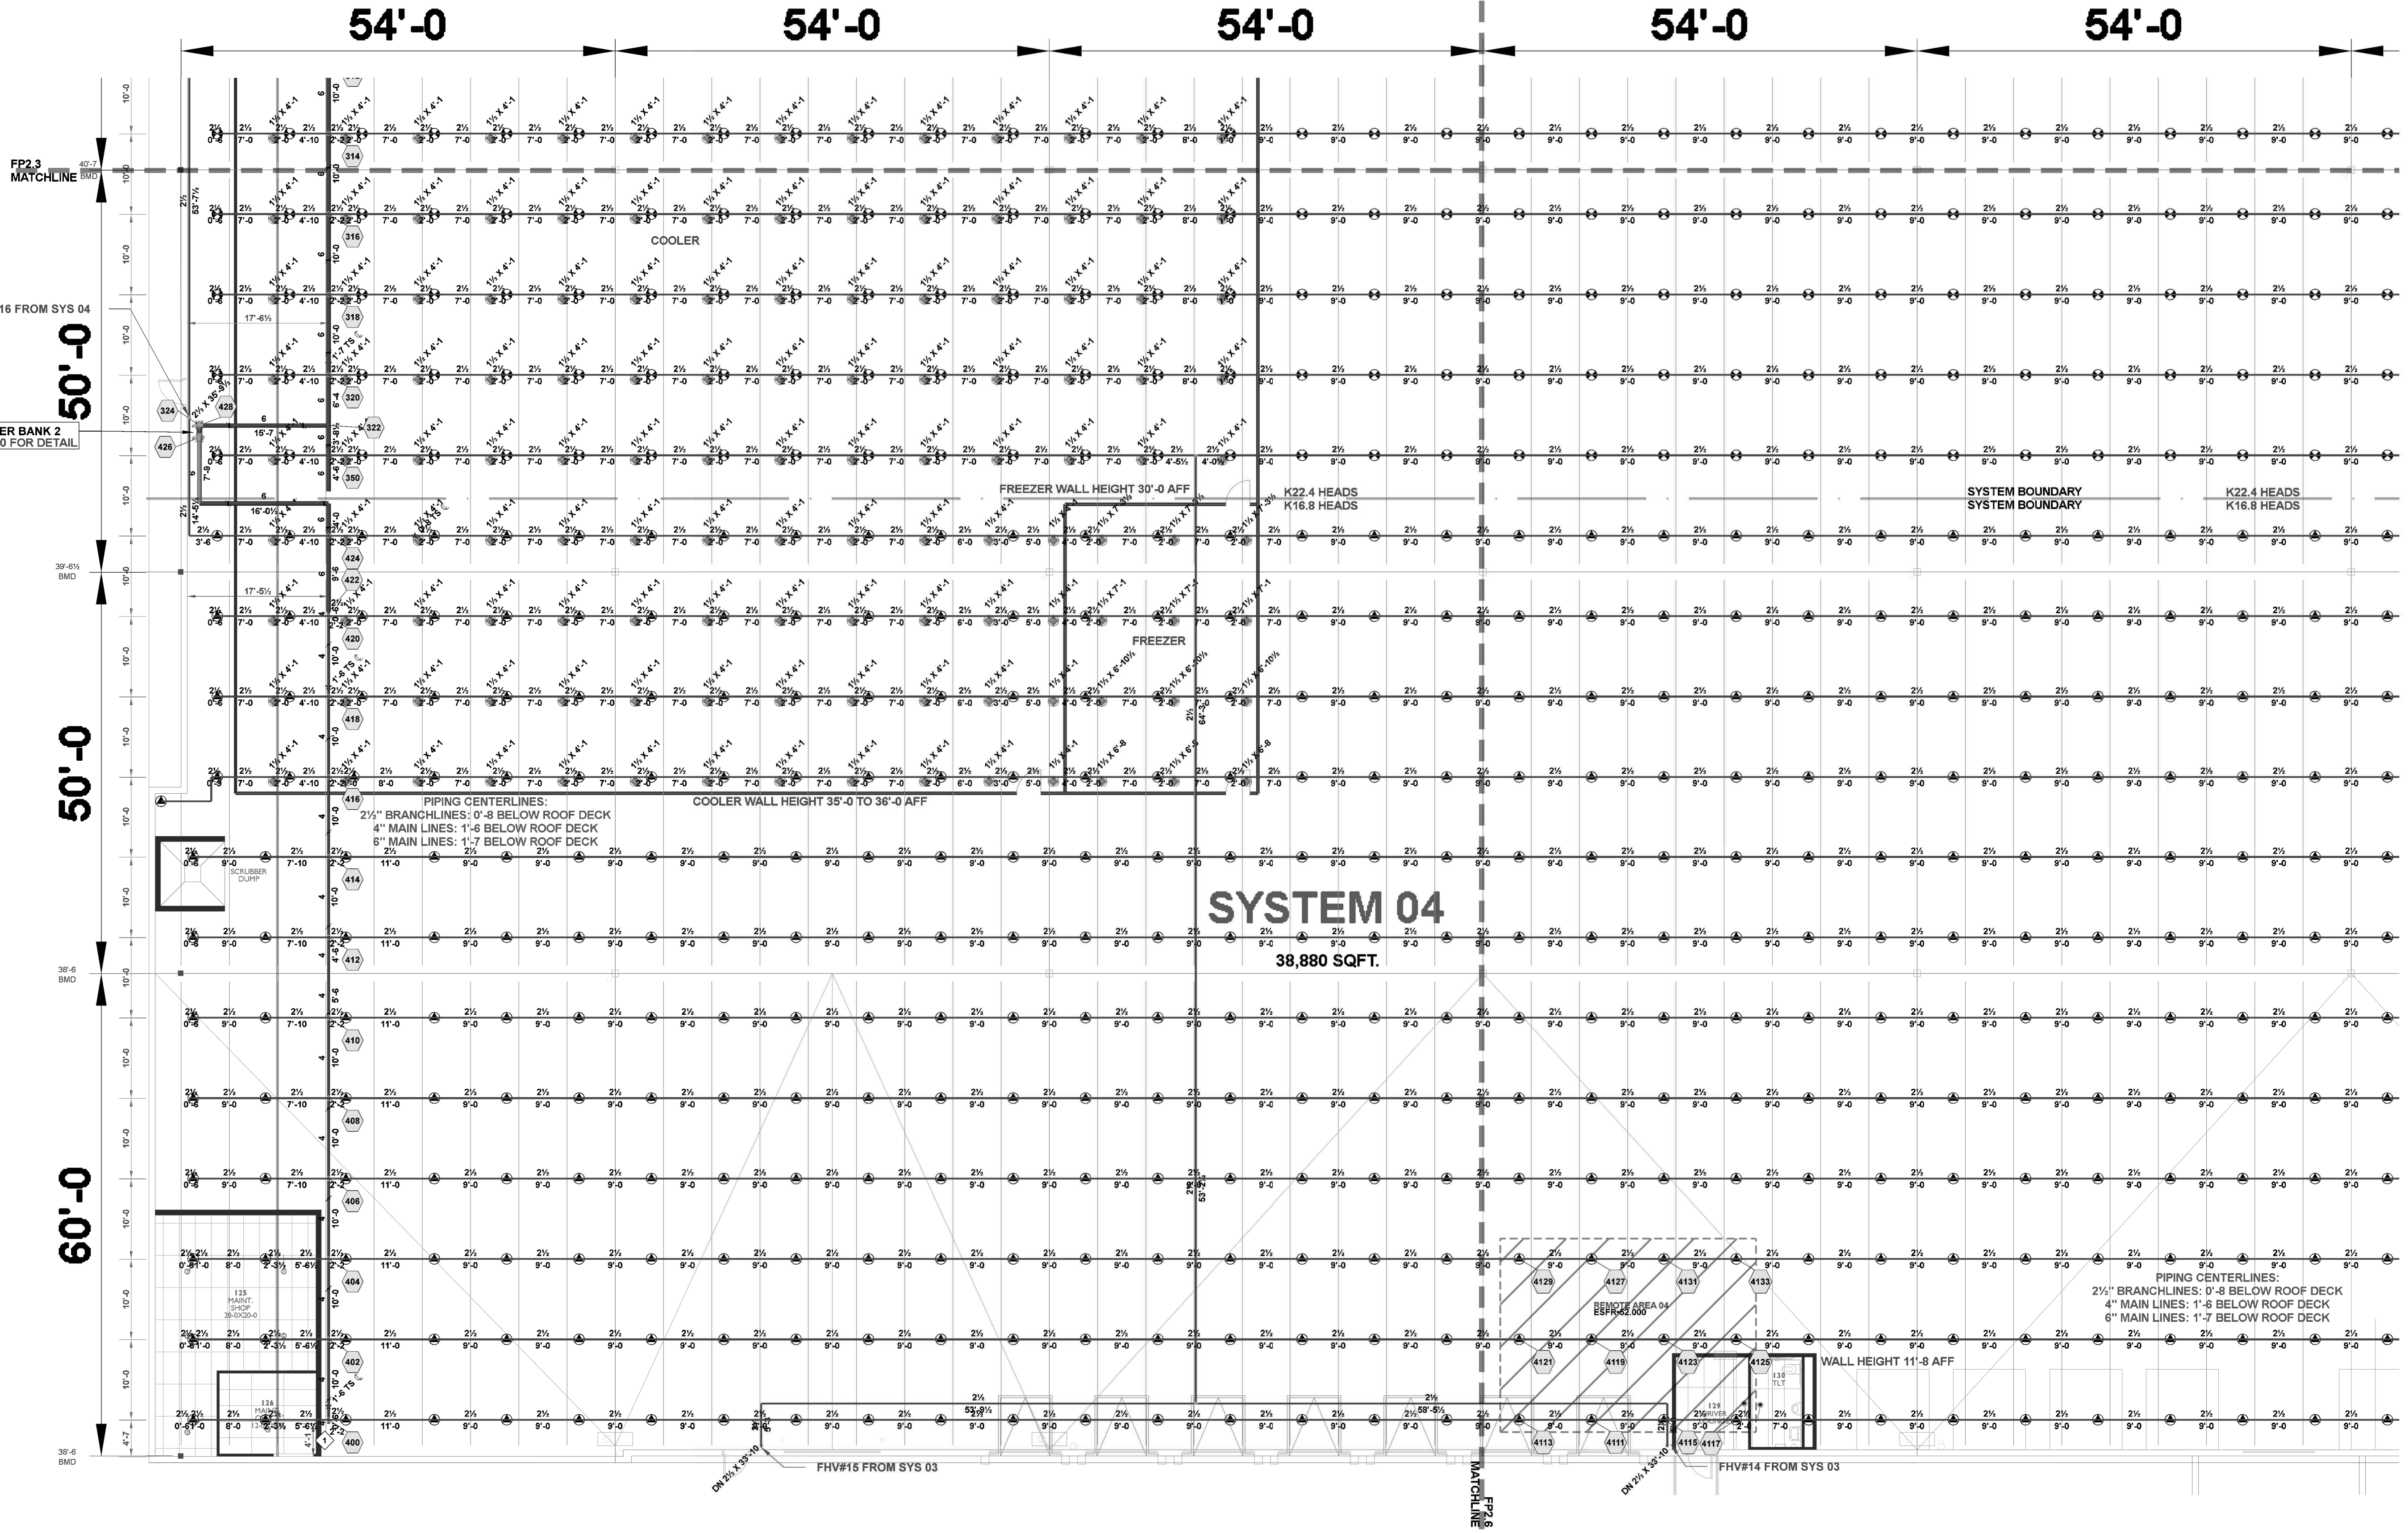

PERMIT SET 02.18.22  
TENANT IMPROVEMENT 09.07.22

210300  
**FP2.3.1**  
AREA 3: SYSTEMS  
03-04




Hydraulic Information	
Remote Area 04	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	52,000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	16.8
TOTAL WATER REQUIRED	1708.55
TOTAL PRESSURE REQUIRED	80.726
BASE OF RISER (GPM)	1708.55
BASE OF RISER (PSI)	80.726
SAFETY MARGIN (PSI)	+8.879 (9.9%)

AREA 3: SYSTEMS 03-04  
SCALE: 3/32" = 1'-0"

Sprinkler Legend											
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE	NOTE
	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	3/4"	FAST	BRASS	200°F	
	4	VICTAULIC	V3406	V34	8	PENDENT	3/4"	QUICK	BRASS	200°F	
	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1"	FAST	BRASS	200°F	
	48	VIKING	VK600	MICROFAST	5.6	PENDENT	1/2"	QUICK	CHROME	135°F	
	6	VIKING	VK3021		5.6	PENDENT	1/2"	QUICK	CHROME	135°F	
	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	3/4"	QUICK	BRASS	205°F	
	TOTAL = 5234										

\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6" OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

⬡ - AUXILIARY DRAIN  
SEE FP0.0 FOR DETAIL  
⬡ - AIR VENT  
SEE FP0.0 FOR DETAIL

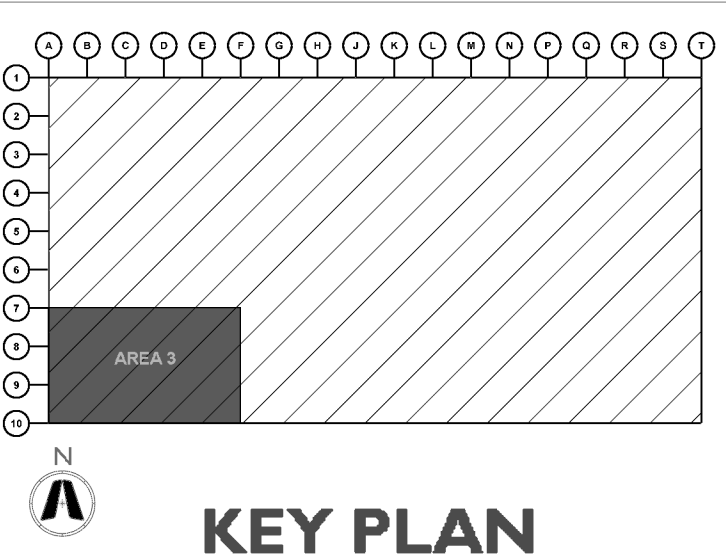






**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



**SCANNELL**  
PROPERTIES

CERTIFICATION

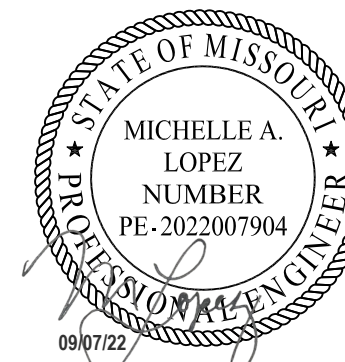

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


ISSUE DATES

PERMIT SET 02.18.22  
TENANT IMPROVEMENT 09.07.22

210300

**FP2.3.2**

AREA 3(CONT.):  
SYSTEMS 03-04

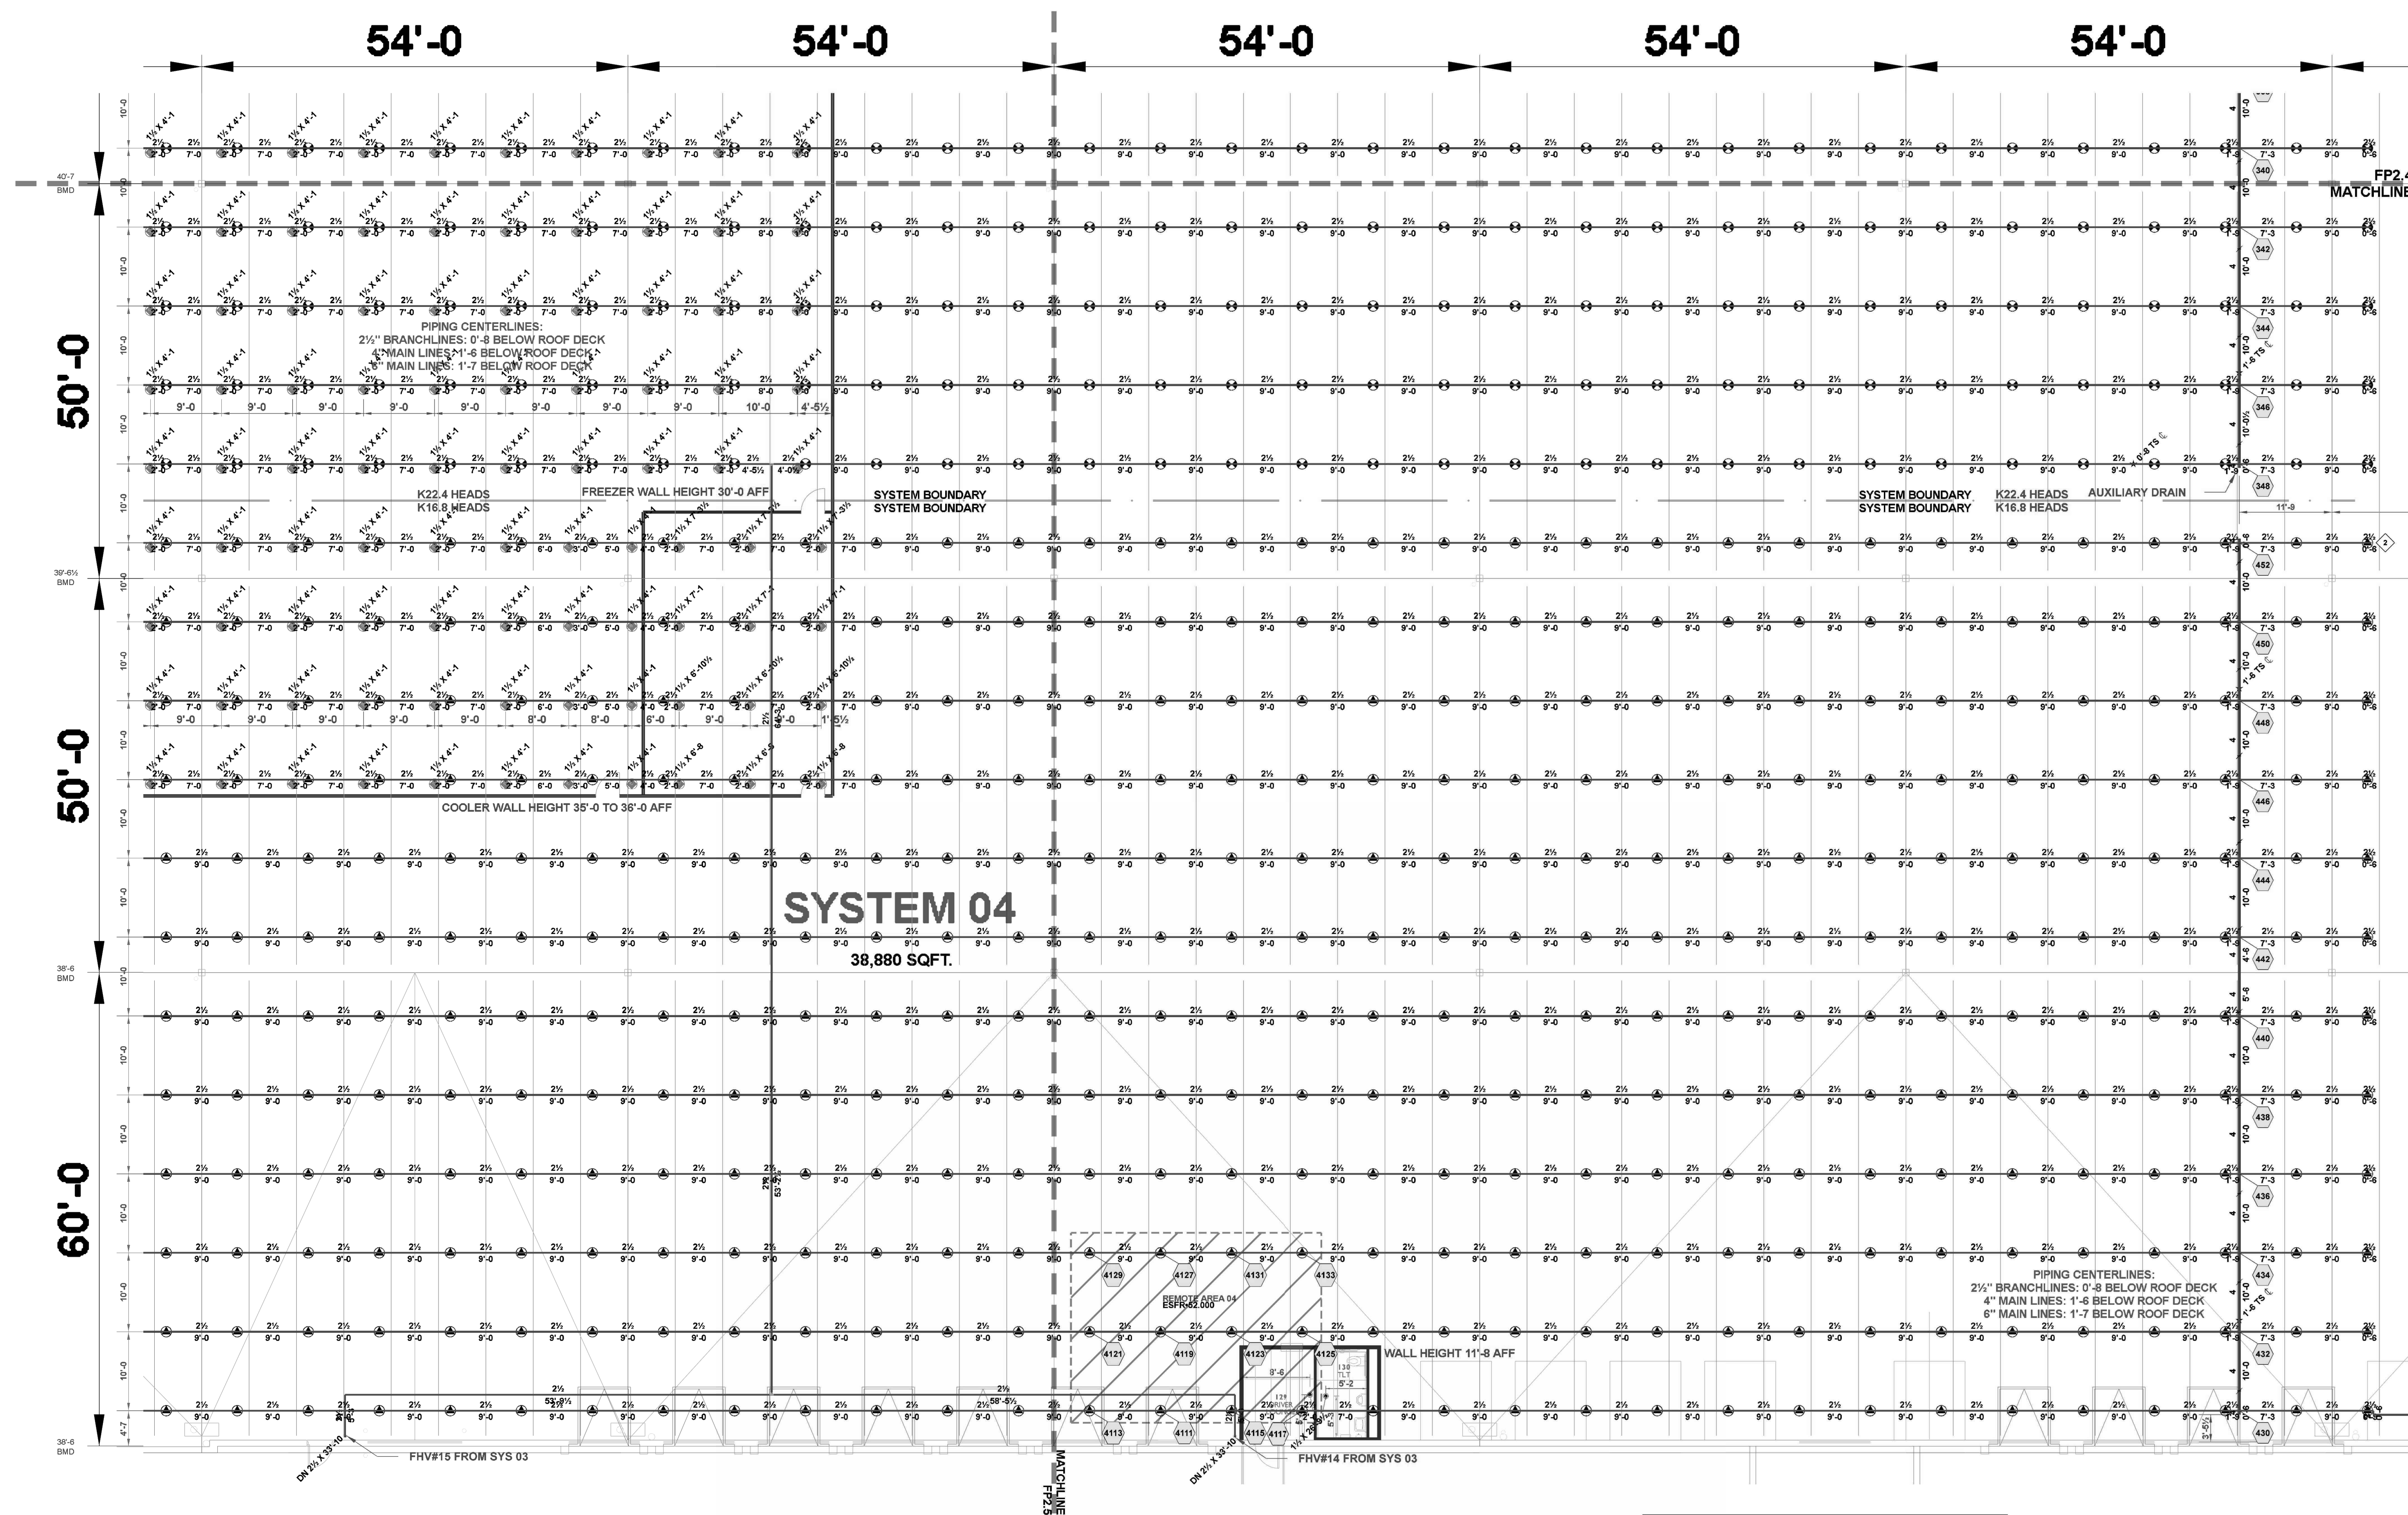


Hydraulic Information	
Remote Area 04	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	52.000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	16.8
TOTAL WATER REQUIRED	1708.55
TOTAL PRESSURE REQUIRED	80.726
BASE OF RISER (GPM)	1708.55
BASE OF RISER (PSI)	80.726
SAFETY MARGIN (PSI)	+8.879 (9.9%)

AREA 3(CONT.): SYSTEMS 03-04  
SCALE: 3/32" = 1'-0"

Sprinkler Legend										
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE
▲	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	3/4"	FAST	BRASS	200°F
⊗	4	VICTAULIC	V3406	V34	8	PENDENT	3/4"	QUICK	BRASS	200°F
⊕	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1"	FAST	BRASS	200°F
●	48	VIKING	VK600	MICROFAST	5.6	PENDENT	1/2"	QUICK	CHROME	135°F
⊙	6	VIKING	VK3021		5.6	PENDENT	1/2"	QUICK	CHROME	135°F
◆	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	3/4"	QUICK	BRASS	205°F
TOTAL = 5234										

\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6" OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

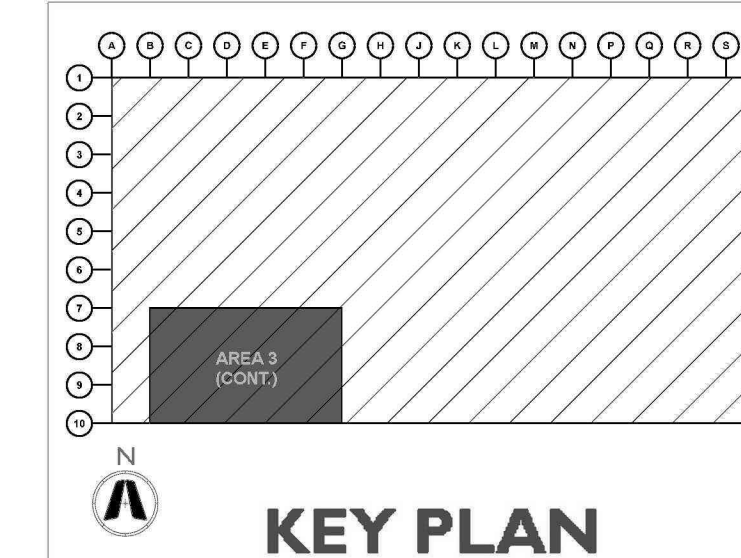





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


ISSUE DATES

PERMIT SET 02.18.22  
TENANT IMPROVEMENT 09.07.22

210300

**FP2.4**

AREA 4: SYSTEM 05

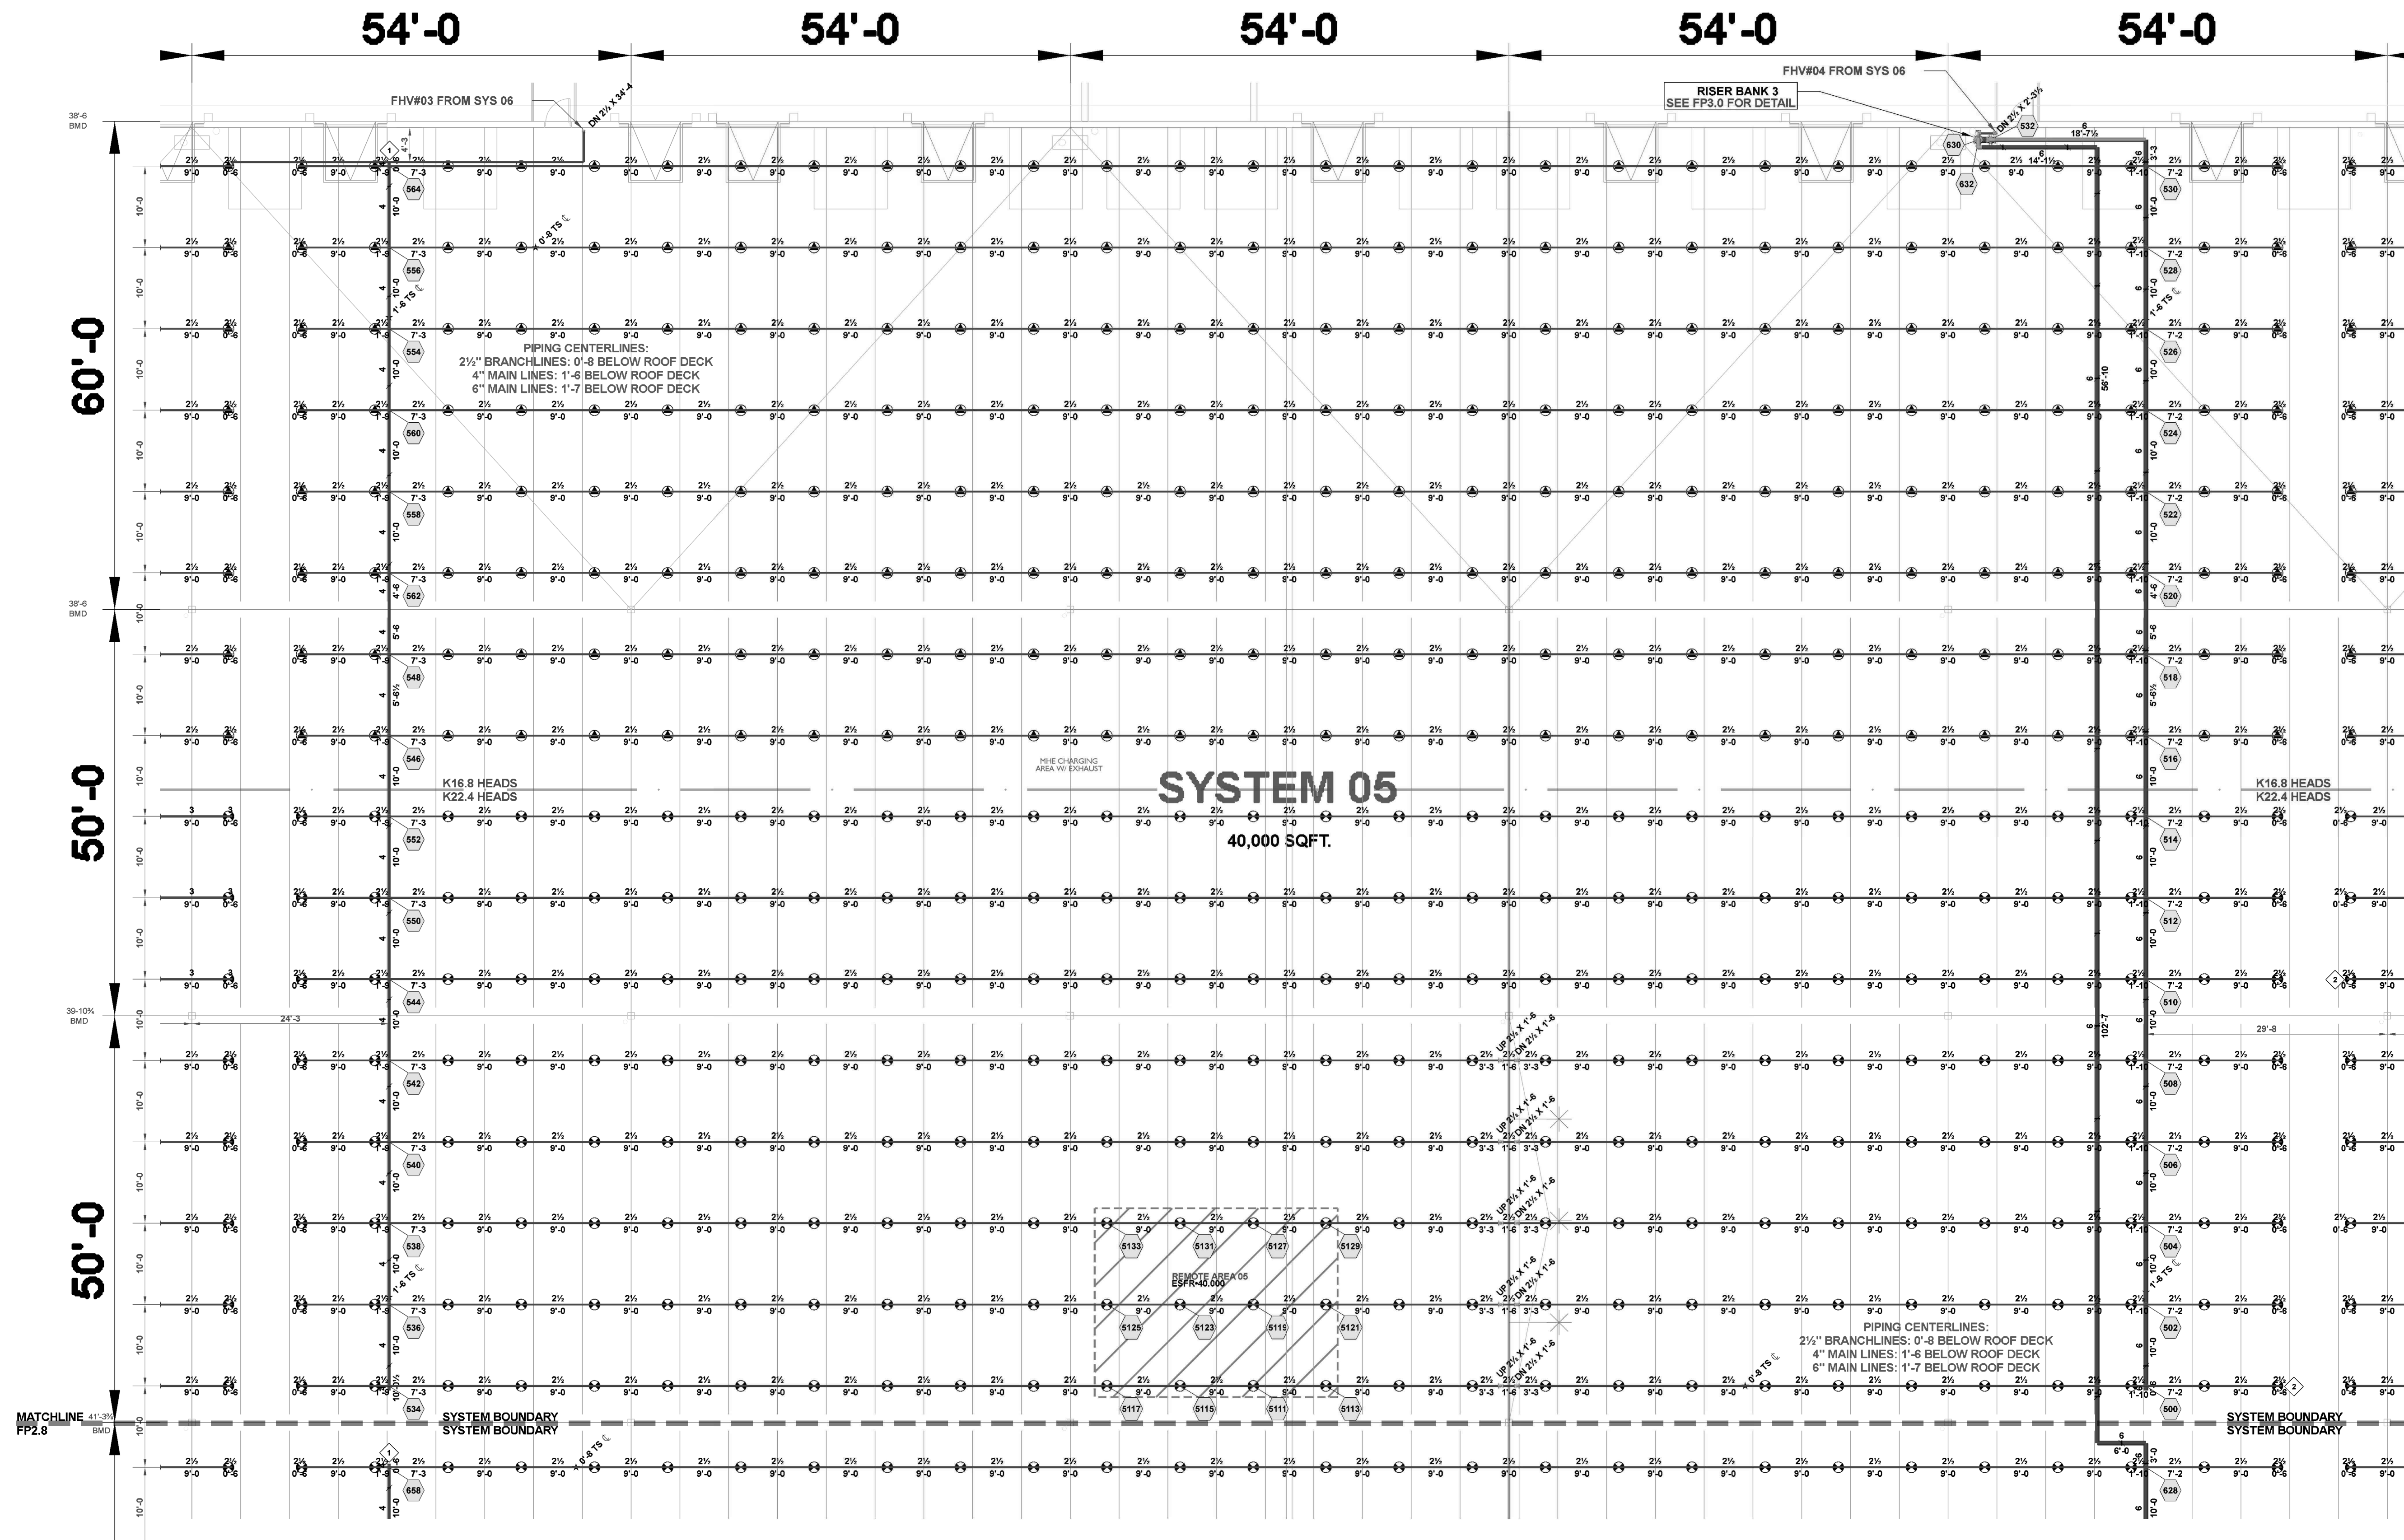


Hydraulic Information	
Remote Area 05	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	40,000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	22.4
TOTAL WATER REQUIRED	1959.12
TOTAL PRESSURE REQUIRED	73.843
BASE OF RISER (GPM)	1959.12
BASE OF RISER (PSI)	73.843
SAFETY MARGIN (PSI)	+13.633 (15.6%)

AREA 4: SYSTEM 05  
SCALE: 3/32" = 1'-0"

Sprinkler Legend											
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE	NOTE
▲	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	¾	FAST	BRASS	200°F	
⊗	4	VICTAULIC	V3406	V34	8	PENDENT	¾	QUICK	BRASS	200°F	
●	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1	FAST	BRASS	200°F	
⊙	48	VIKING	VK600	MICROFAST	5.6	PENDENT	½	QUICK	CHROME	135°F	
⊖	6	VIKING	VK3021		5.6	PENDENT	½	QUICK	CHROME	135°F	
◆	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	¾	QUICK	BRASS	205°F	
TOTAL = 5234											

\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6" OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

▲ - AUXILIARY DRAIN  
SEE FP0.0 FOR DETAIL  
◆ - AIR VENT  
SEE FP0.0 FOR DETAIL

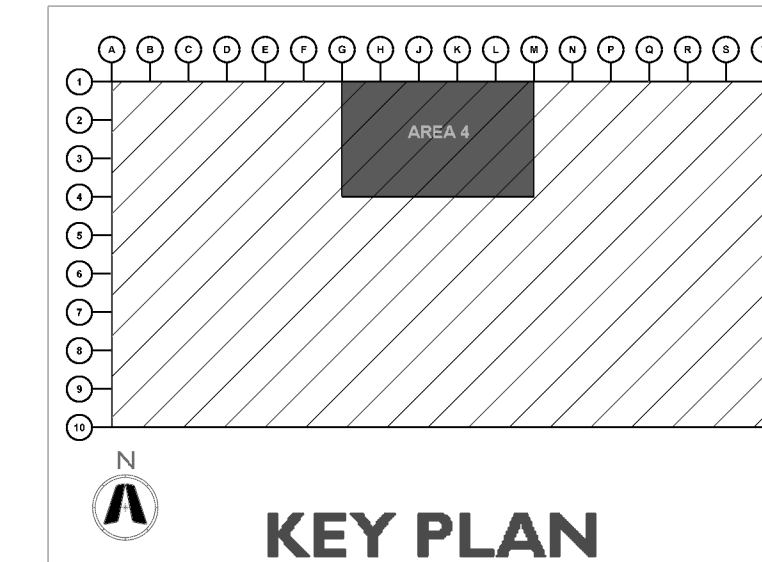

KEY PLAN





\_\_\_\_\_



## PROJECT INFORMATION


NW CORNER OF  
THE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

210300

210300

## FP2.5

## AREA 5: SYSTEM 06

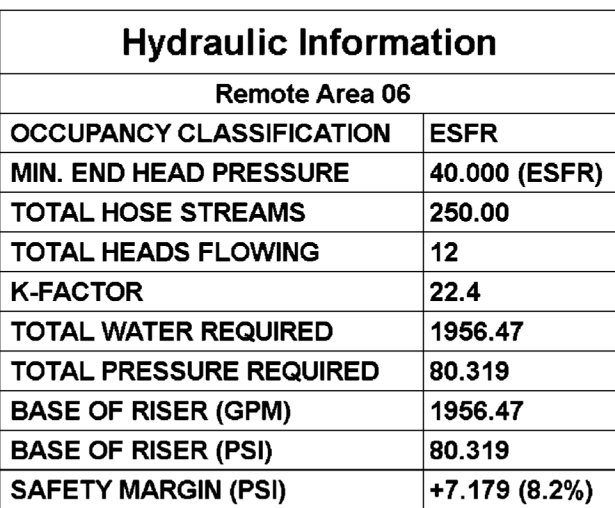

## AREA 5: SYSTEM 06


**SCALE: 3/32" = 1'-0"**

[illegible]

**\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6" OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE**

1 - **AUXILIARY DRAIN**  
SEE FP0.0 FOR DETAIL

2 - **AIR VENT**  
SEE FP0.0 FOR DETAIL

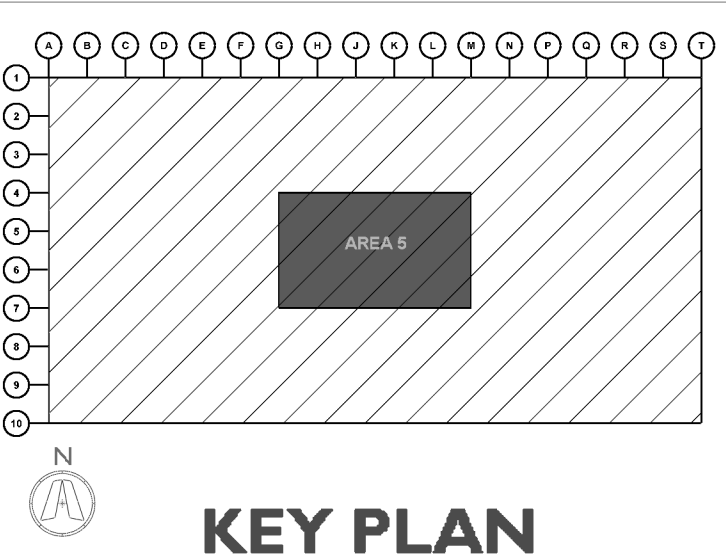





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753

**SCANNELL**  
PROPERTIES



THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.


PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I  
NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES

PERMIT SET 02.18.22  
TENANT IMPROVEMENT 09.07.22

210300  
**FP2.6**  
AREA 6: SYSTEM 07

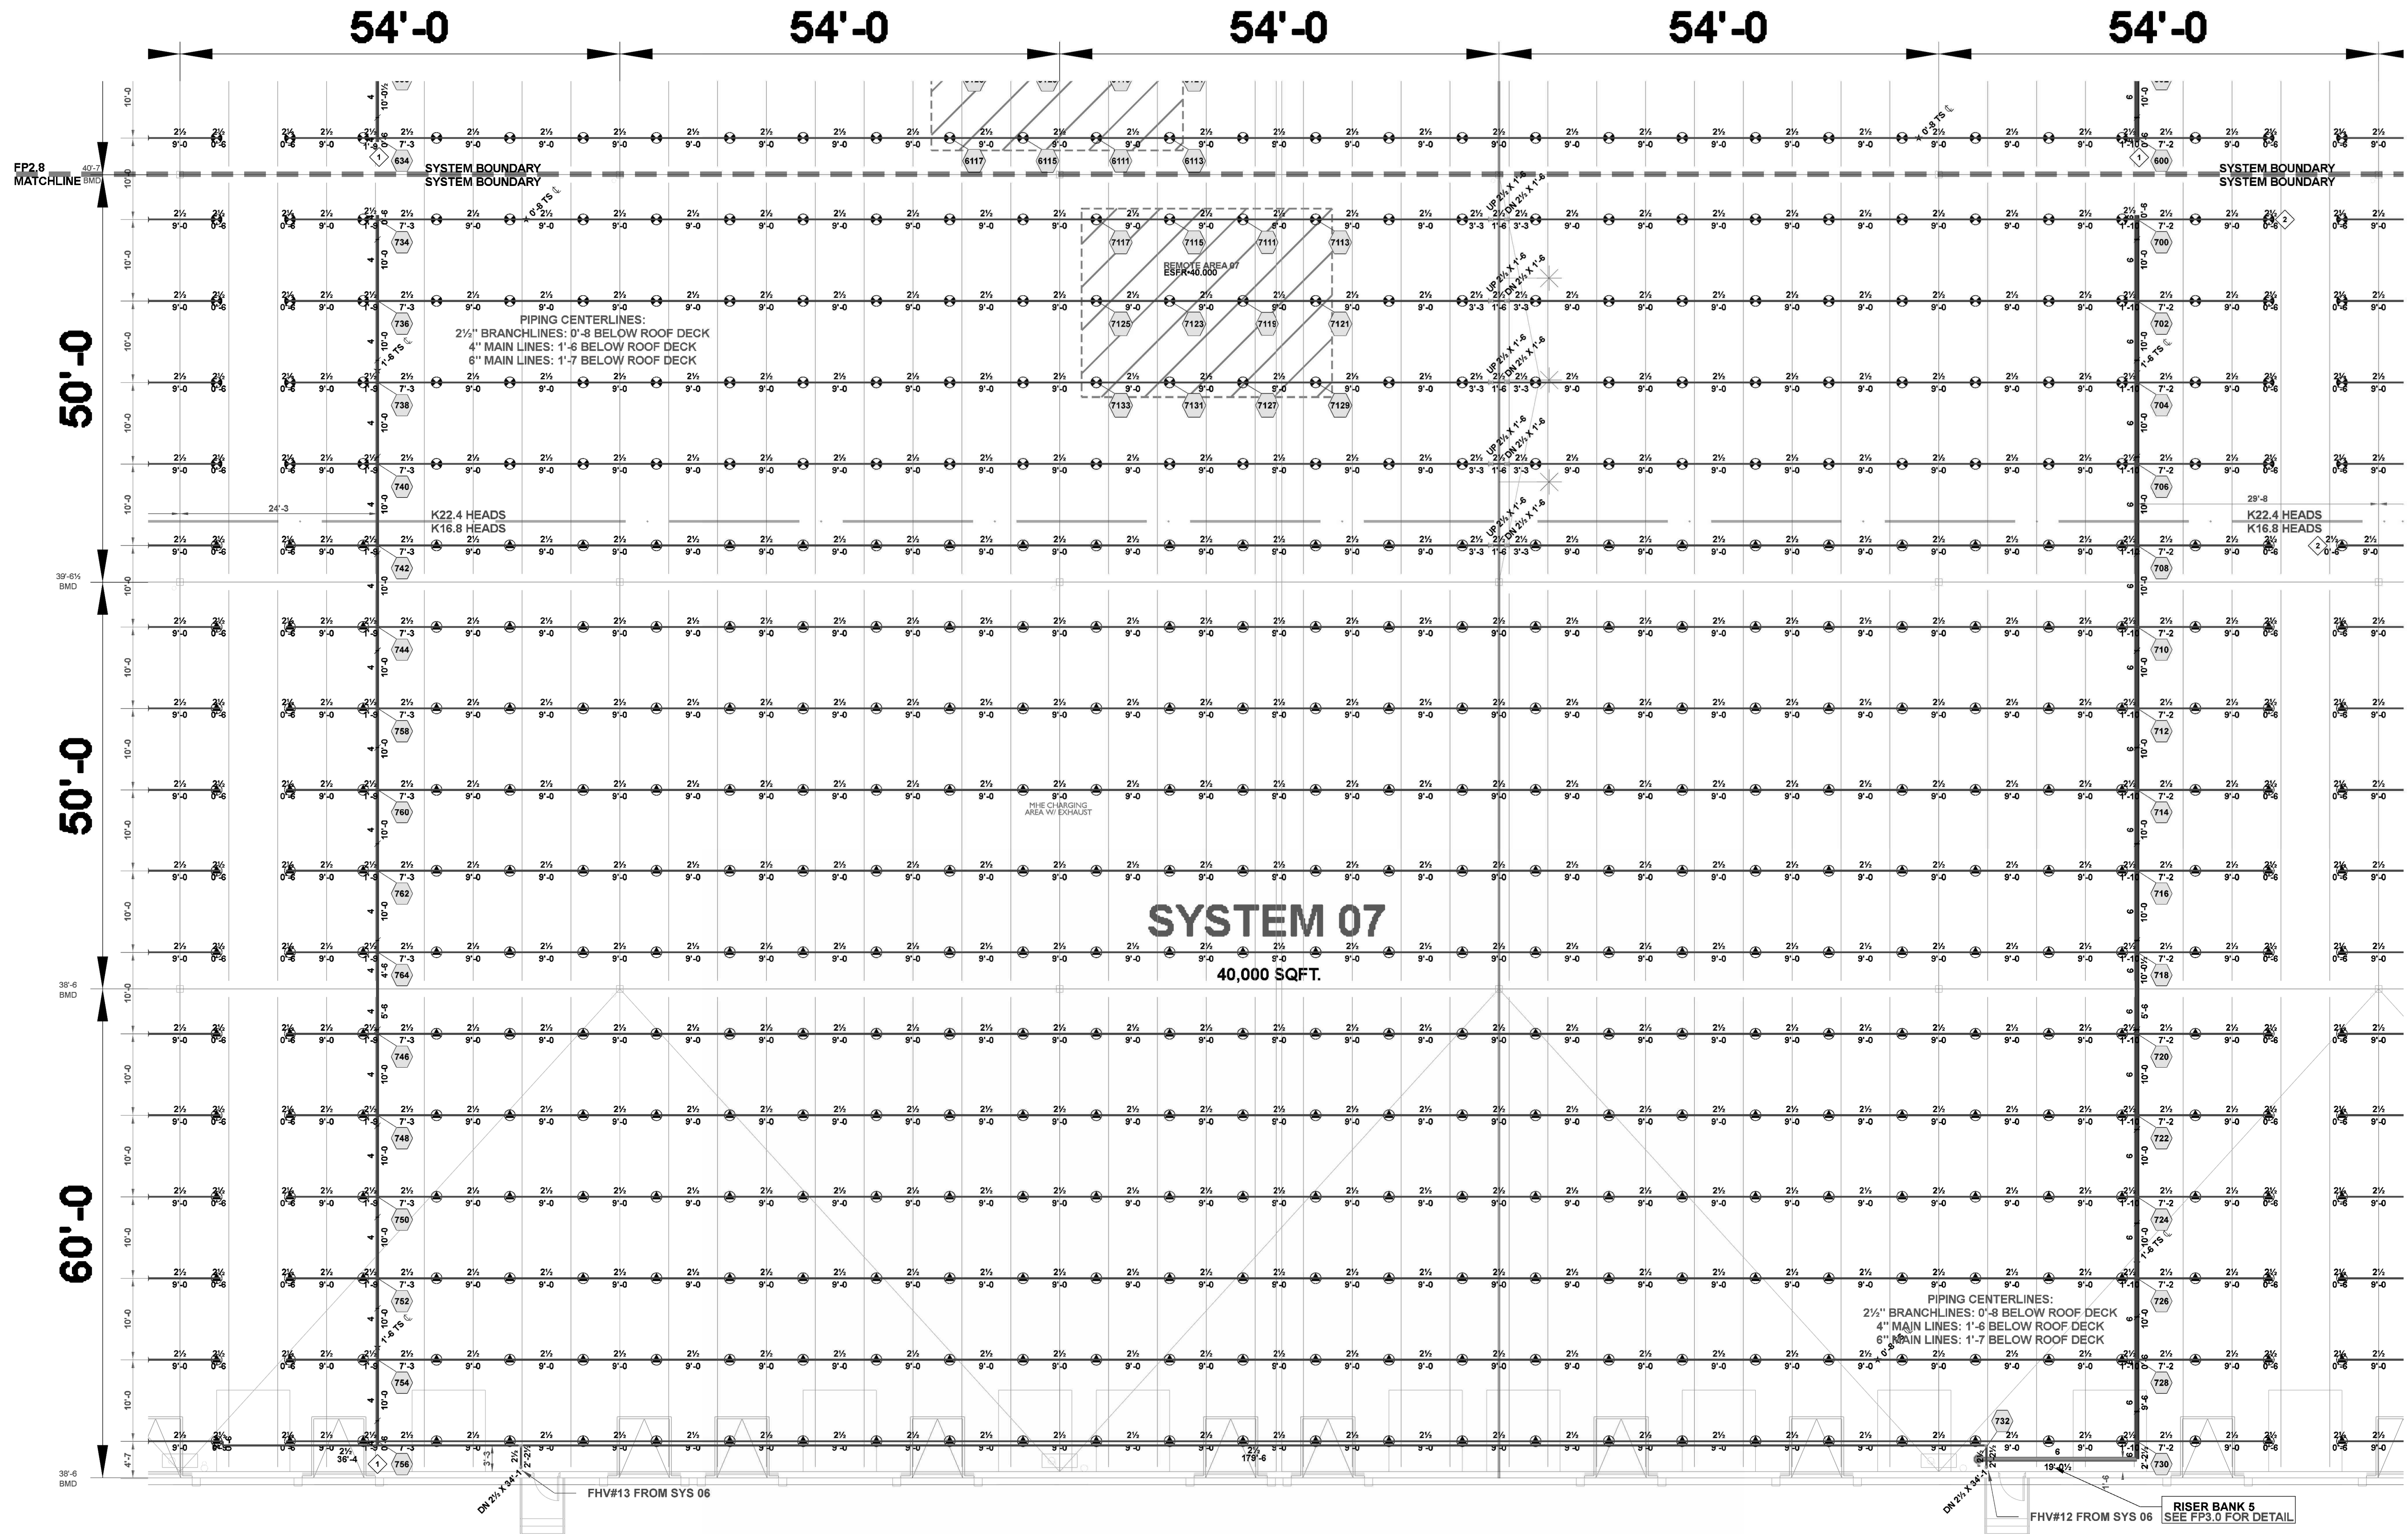


Hydraulic Information	
Remote Area 07	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	40.000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	22.4
TOTAL WATER REQUIRED	1958.72
TOTAL PRESSURE REQUIRED	74.363
BASE OF RISER (GPM)	1958.72
BASE OF RISER (PSI)	74.363
SAFETY MARGIN (PSI)	+13.116 (15.0%)

AREA 6: SYSTEM 07  
SCALE: 3/32" = 1'-0"

Sprinkler Legend										
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE
	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	3/4"	FAST	BRASS	200°F
	4	VICTAULIC	V3406	V34	8	PENDENT	3/4"	QUICK	BRASS	200°F
	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1"	FAST	BRASS	200°F
	48	VIKING	VK600	MICROFAST	5.6	PENDENT	1/2"	QUICK	CHROME	135°F
	6	VIKING	VK3021		5.6	PENDENT	1/2"	QUICK	CHROME	135°F
	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	3/4"	QUICK	BRASS	205°F
TOTAL = 5234										

\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6" OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

- AUXILIARY DRAIN  
SEE FP0.0 FOR DETAIL  
 - AIR VENT  
SEE FP0.0 FOR DETAIL

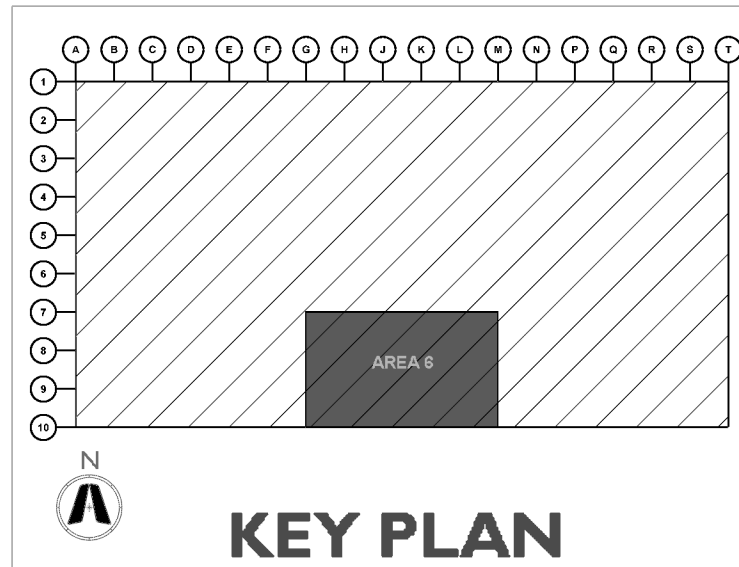





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



**SCANNELL**  
PROPERTIES

CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES


PERMIT SET 02.18.22

TENANT IMPROVEMENT 09.07.22

210300

**FP2.7.1**

AREA 7: SYSTEMS  
08-09

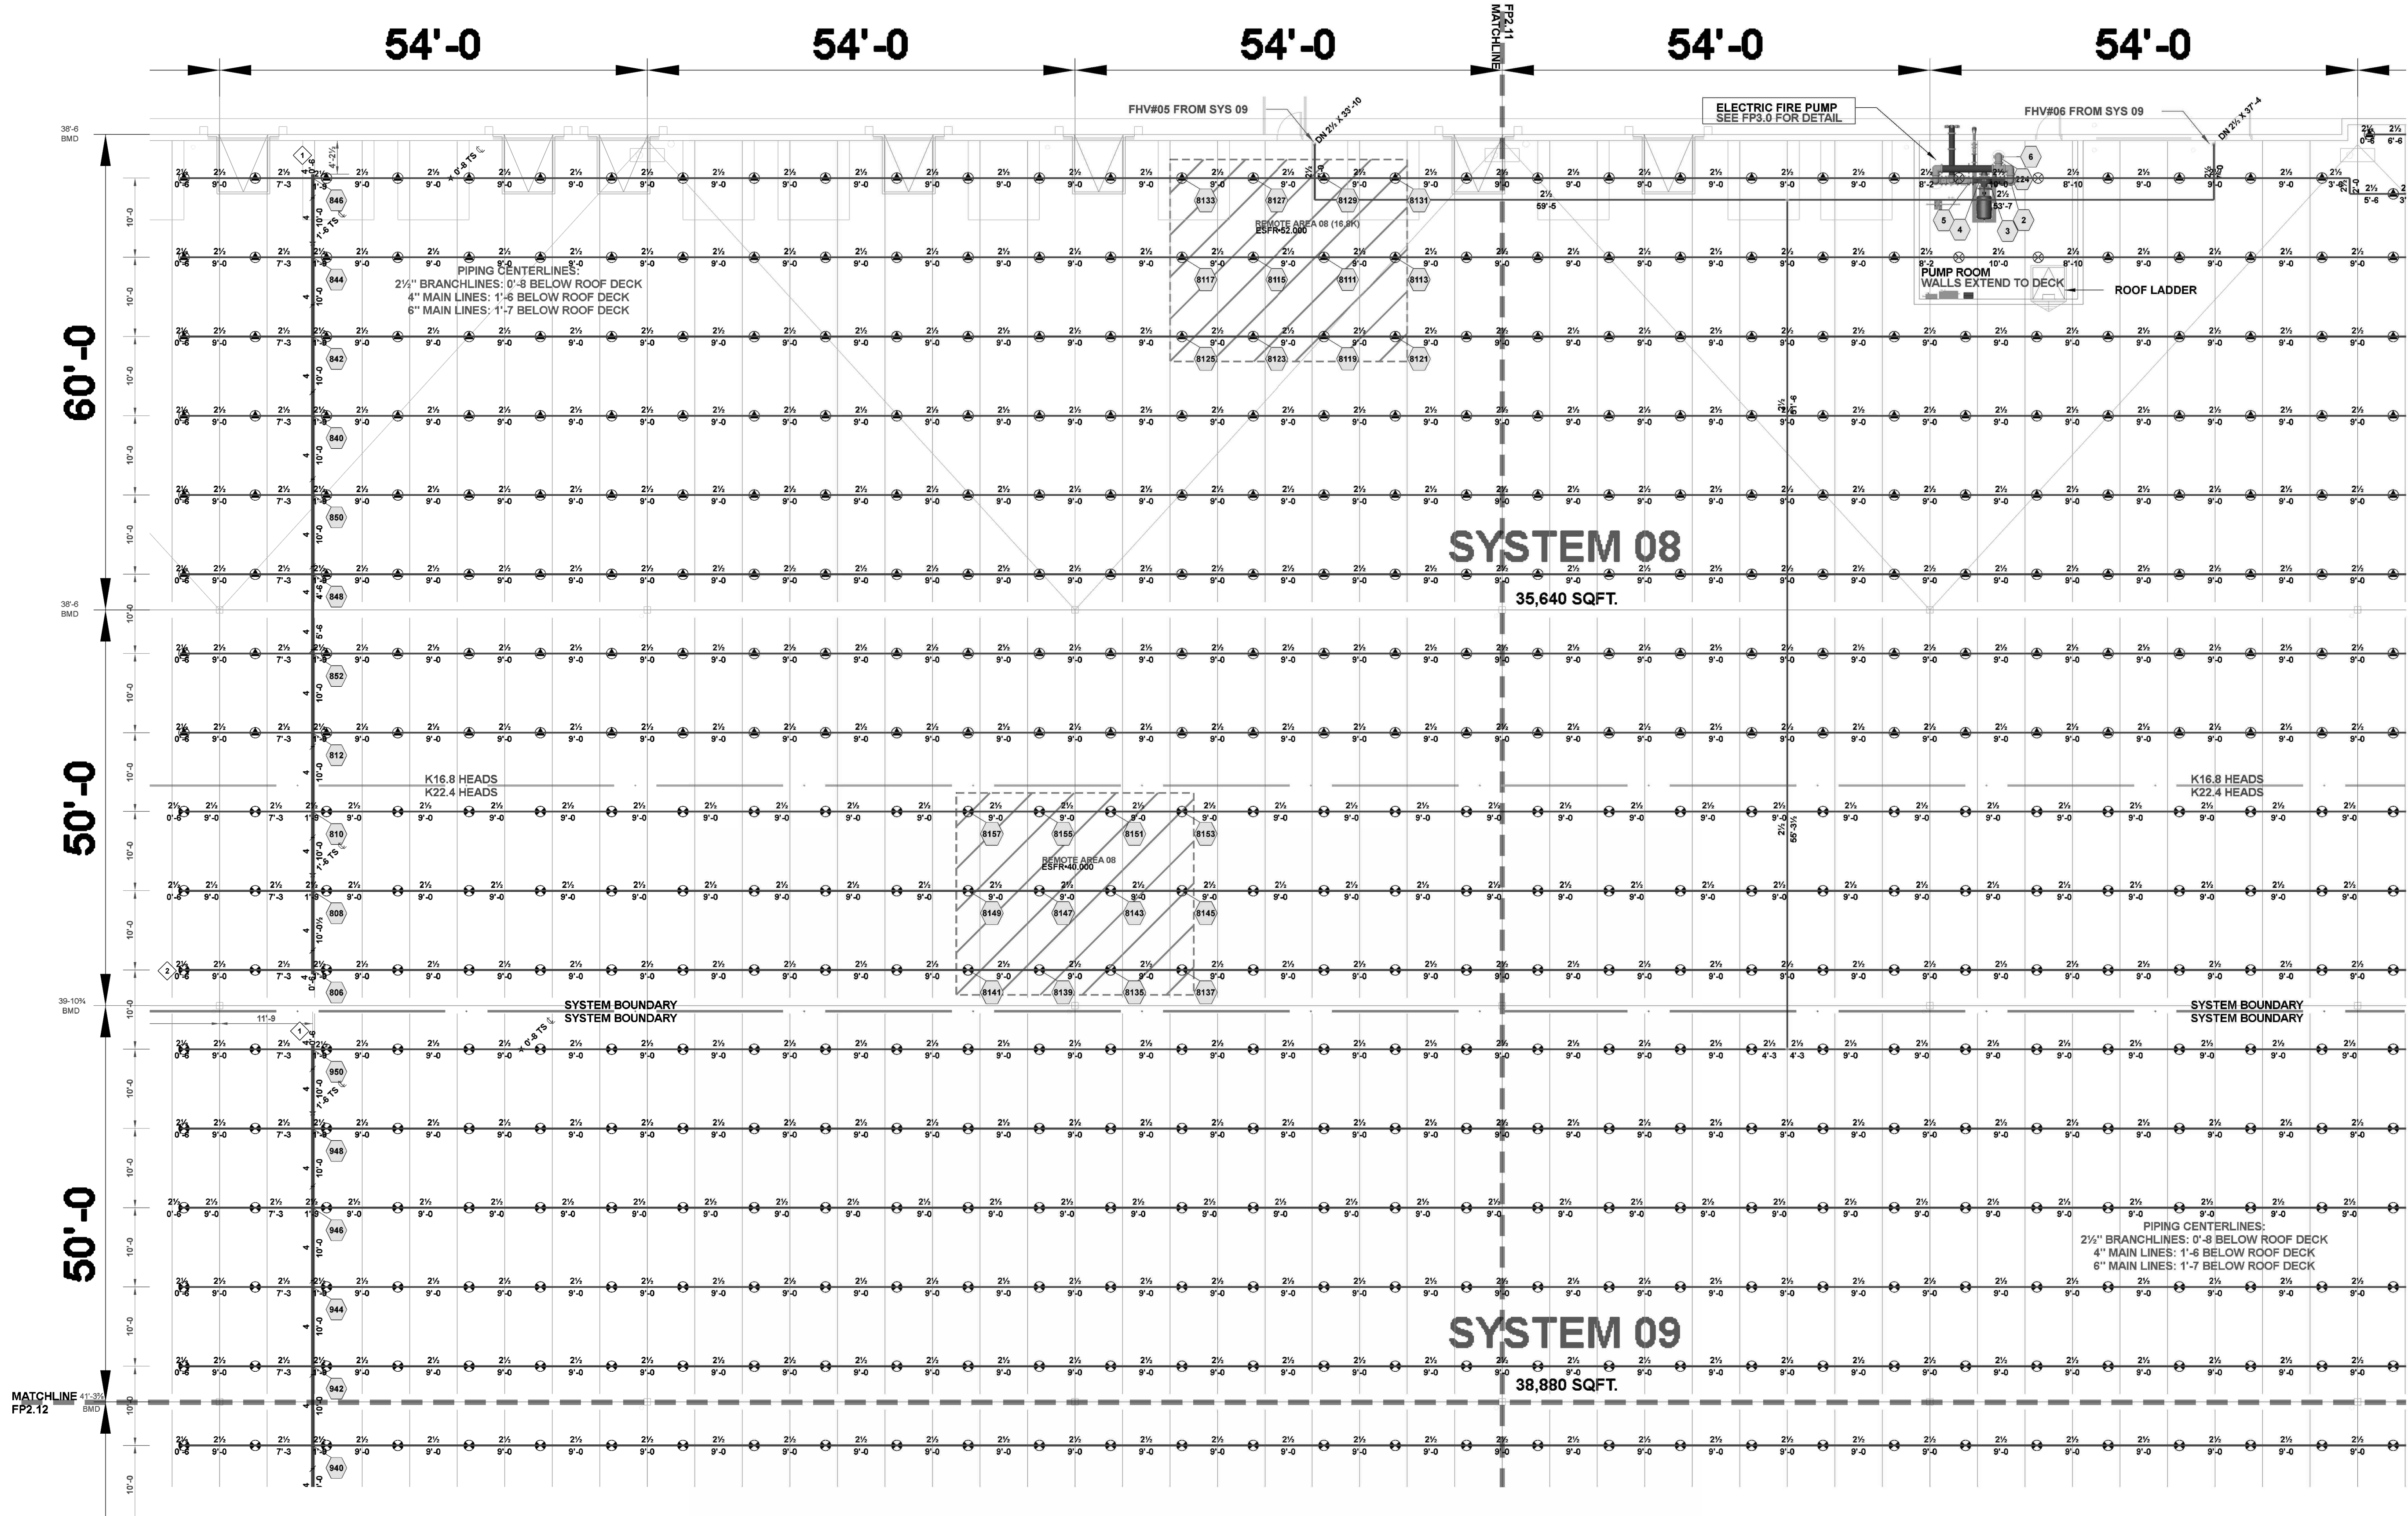

Hydraulic Information		Hydraulic Information	
Remote Area 08 (K16.8)		Remote Area 08	
OCCUPANCY CLASSIFICATION	ESFR	OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	52.000 (ESFR)	MIN. END HEAD PRESSURE	40.000 (ESFR)
TOTAL HOSE STREAMS	250.00	TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12	TOTAL HEADS FLOWING	12
K-FACTOR	16.8	K-FACTOR	22.4
TOTAL WATER REQUIRED	1711.62	TOTAL WATER REQUIRED	1956.80
TOTAL PRESSURE REQUIRED	73.476	TOTAL PRESSURE REQUIRED	81.616
BASE OF RISER (GPM)	1711.62	BASE OF RISER (GPM)	1956.80
BASE OF RISER (PSI)	73.476	BASE OF RISER (PSI)	81.616
SAFETY MARGIN (PSI)	+16.104 (18.0%)	SAFETY MARGIN (PSI)	+5.880 (6.7%)


AREA 7: SYSTEMS 08-09

SCALE: 3/32" = 1'-0"


Sprinkler Legend

SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE	NOTE
▲	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	3/4"	FAST	BRASS	200°F	
⊗	4	VICTAULIC	V3406	V34	8	PENDENT	3/4"	QUICK	BRASS	200°F	
⊙	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1"	FAST	BRASS	200°F	
●	48	VIKING	VK600	MICROFAST	5.6	PENDENT	1/2"	QUICK	CHROME	135°F	
⊙	6	VIKING	VK3021		5.6	PENDENT	1/2"	QUICK	CHROME	135°F	
◆	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	3/4"	QUICK	BRASS	205°F	
TOTAL = 5234											

\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6" OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

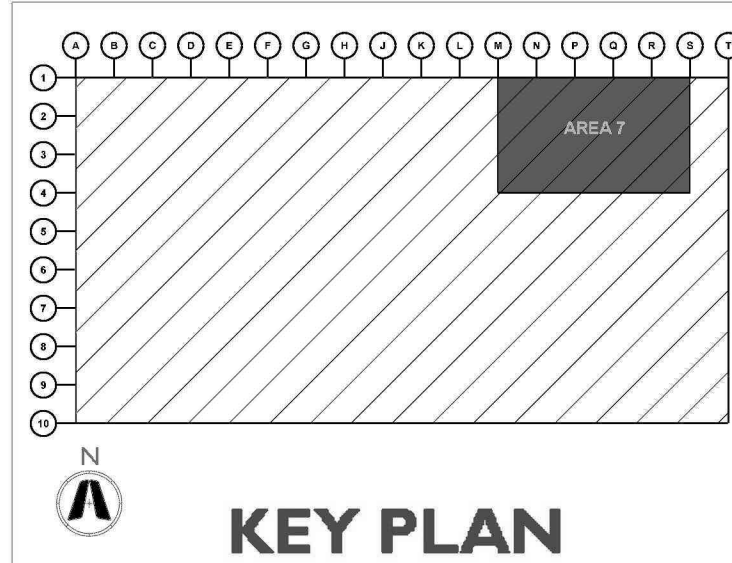



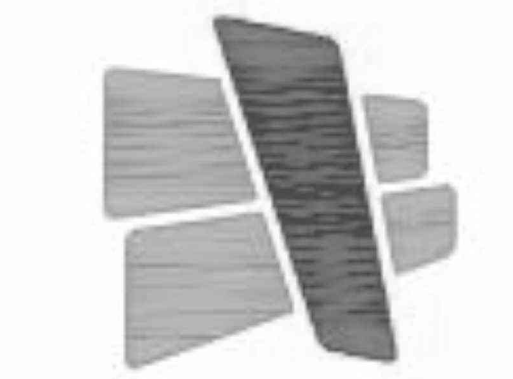

**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I  
NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


ISSUE DATES

PERMIT SET 02.18.22

TENANT IMPROVEMENT 09.07.22

210300

**FP2.7.2**  
AREA 7(CONT):  
SYSTEMS 08-09

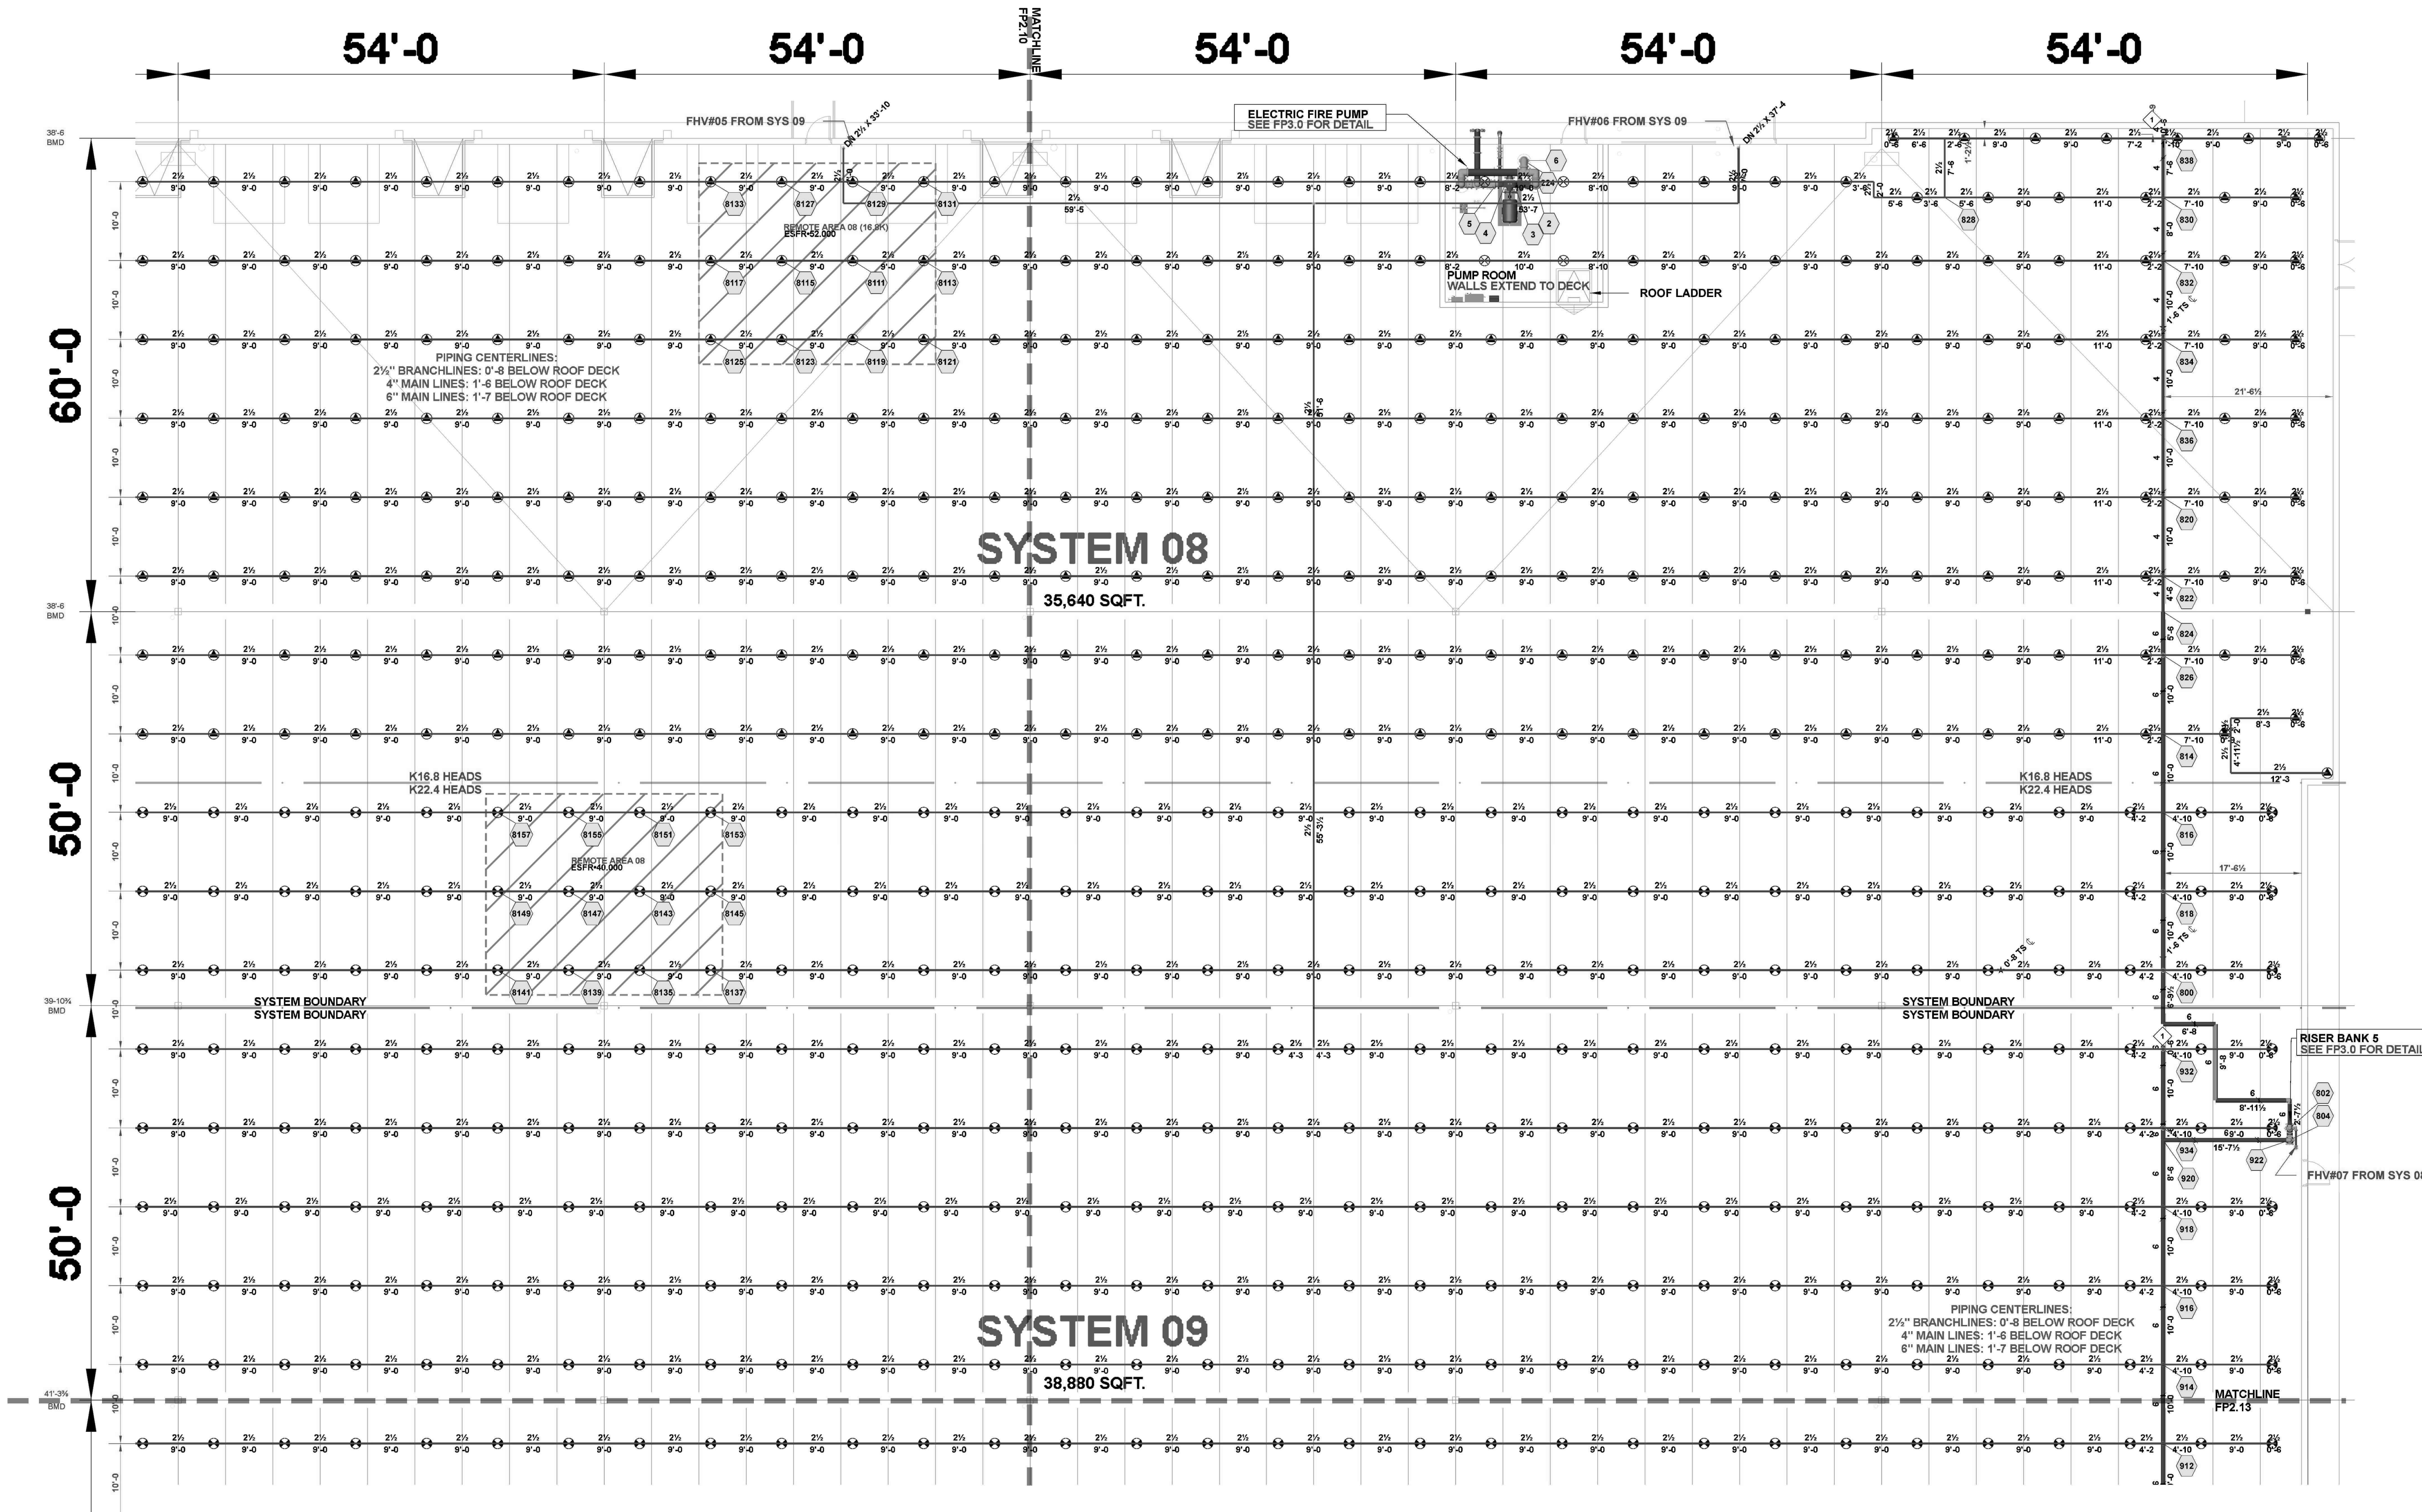





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I  
NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


ISSUE DATES

PERMIT SET 02.18.22

TENANT IMPROVEMENT 09.07.22


210300

**FP2.8.1**  
AREA 8: SYSTEMS  
09-10

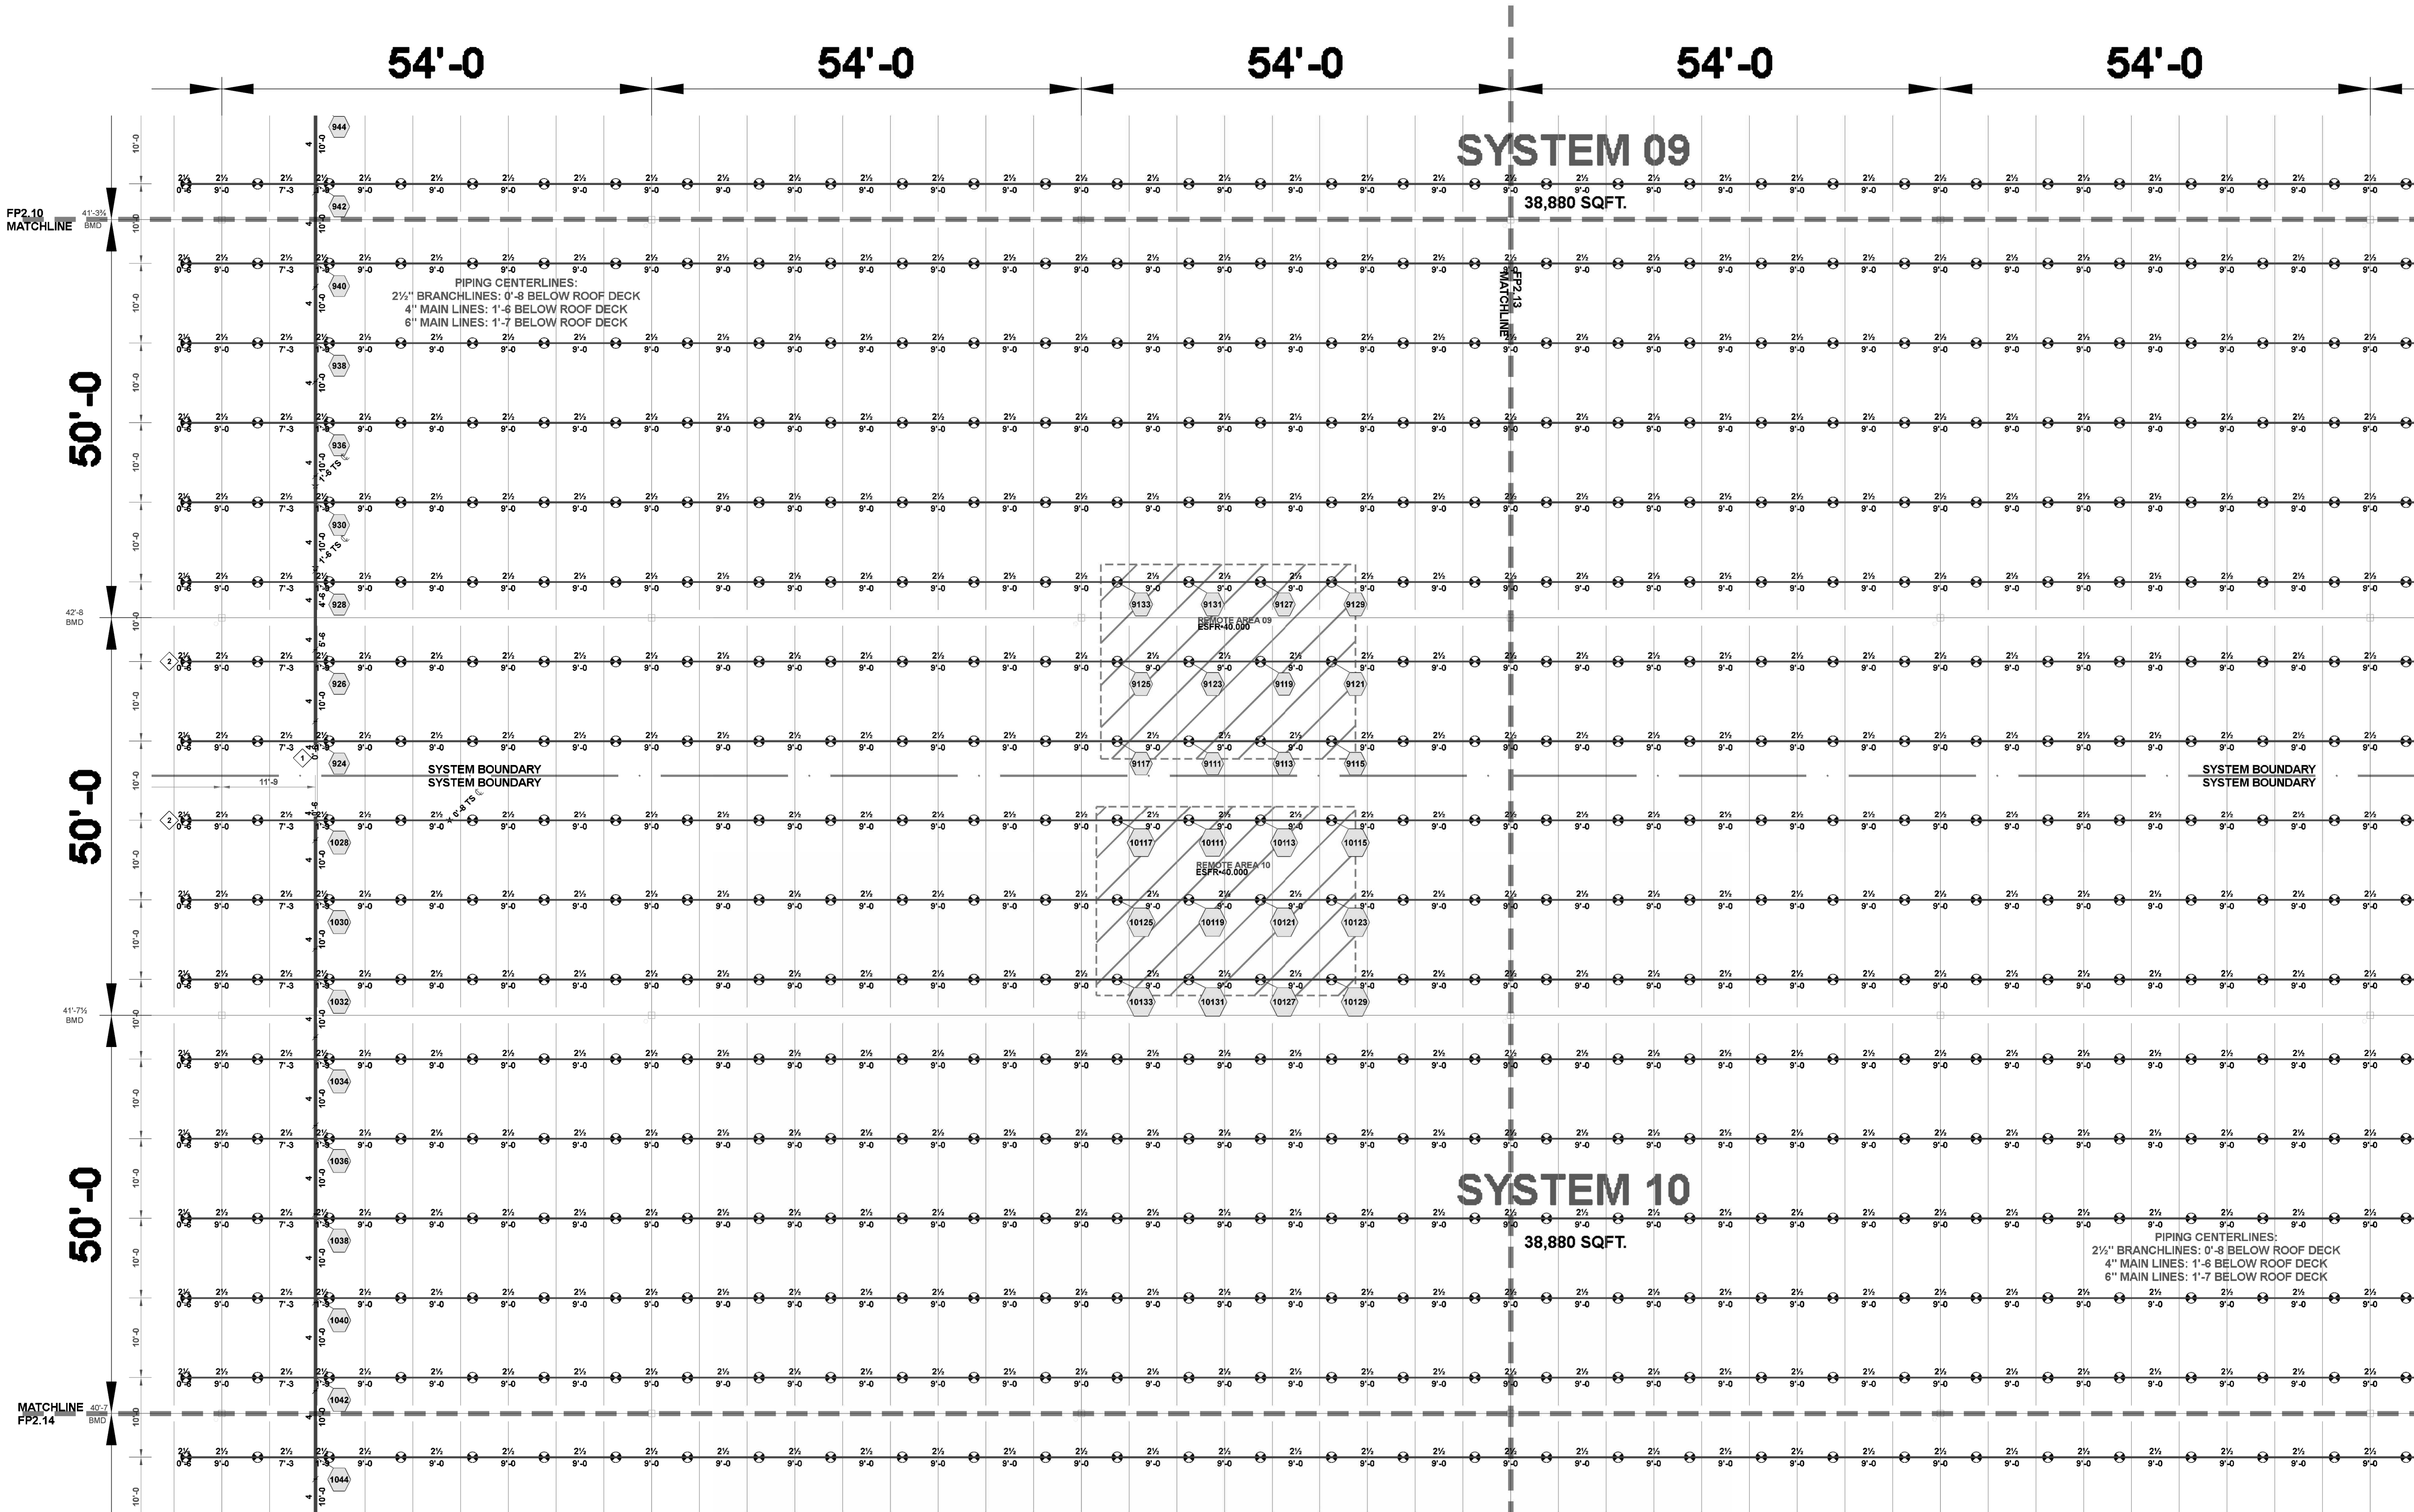

AREA 8: SYSTEMS 09-10

SCALE: 3/32" = 1'-0"




\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6" OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

Sprinkler Legend										
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE
	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	3/4"	FAST	BRASS	200°F
	4	VICTAULIC	V3406	V34	8	PENDENT	3/4"	QUICK	BRASS	200°F
	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1"	FAST	BRASS	200°F
	48	VIKING	VK600	MICROFAST	5.6	PENDENT	1/2"	QUICK	CHROME	135°F
	6	VIKING	VK3021		5.6	PENDENT	1/2"	QUICK	CHROME	135°F
	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	3/4"	QUICK	BRASS	205°F
	TOTAL = 5234									

- AUXILIARY DRAIN  
SEE FP0.0 FOR DETAIL

- AIR VENT  
SEE FP0.0 FOR DETAIL

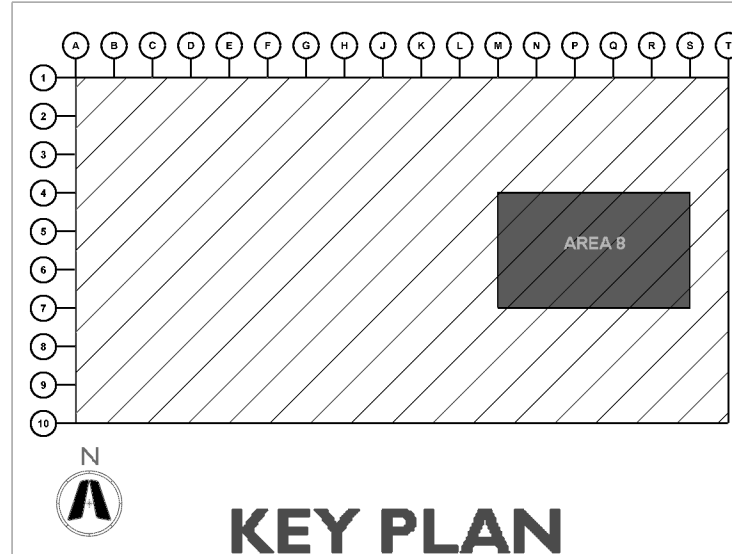

Hydraulic Information		Hydraulic Information	
Remote Area 09		Remote Area 10	
OCCUPANCY CLASSIFICATION	ESFR	OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	40.000 (ESFR)	MIN. END HEAD PRESSURE	40.000 (ESFR)
TOTAL HOSE STREAMS	250.00	TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12	TOTAL HEADS FLOWING	12
K-FACTOR	22.4	K-FACTOR	22.4
TOTAL WATER REQUIRED	1956.70	TOTAL WATER REQUIRED	1958.89
TOTAL PRESSURE REQUIRED	75.314	TOTAL PRESSURE REQUIRED	77.654
BASE OF RISER (GPM)	1956.70	BASE OF RISER (GPM)	1958.89
BASE OF RISER (PSI)	75.314	BASE OF RISER (PSI)	77.654
SAFETY MARGIN (PSI)	+12.183 (13.9%)	SAFETY MARGIN (PSI)	+9.826 (11.2%)





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.

PROJECT INFORMATION


LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES

PERMIT SET 02.18.22  
TENANT IMPROVEMENT 09.07.22

210300  
**FP2.8.2**  
AREA 8 (CONT.):  
SYSTEMS 09-10

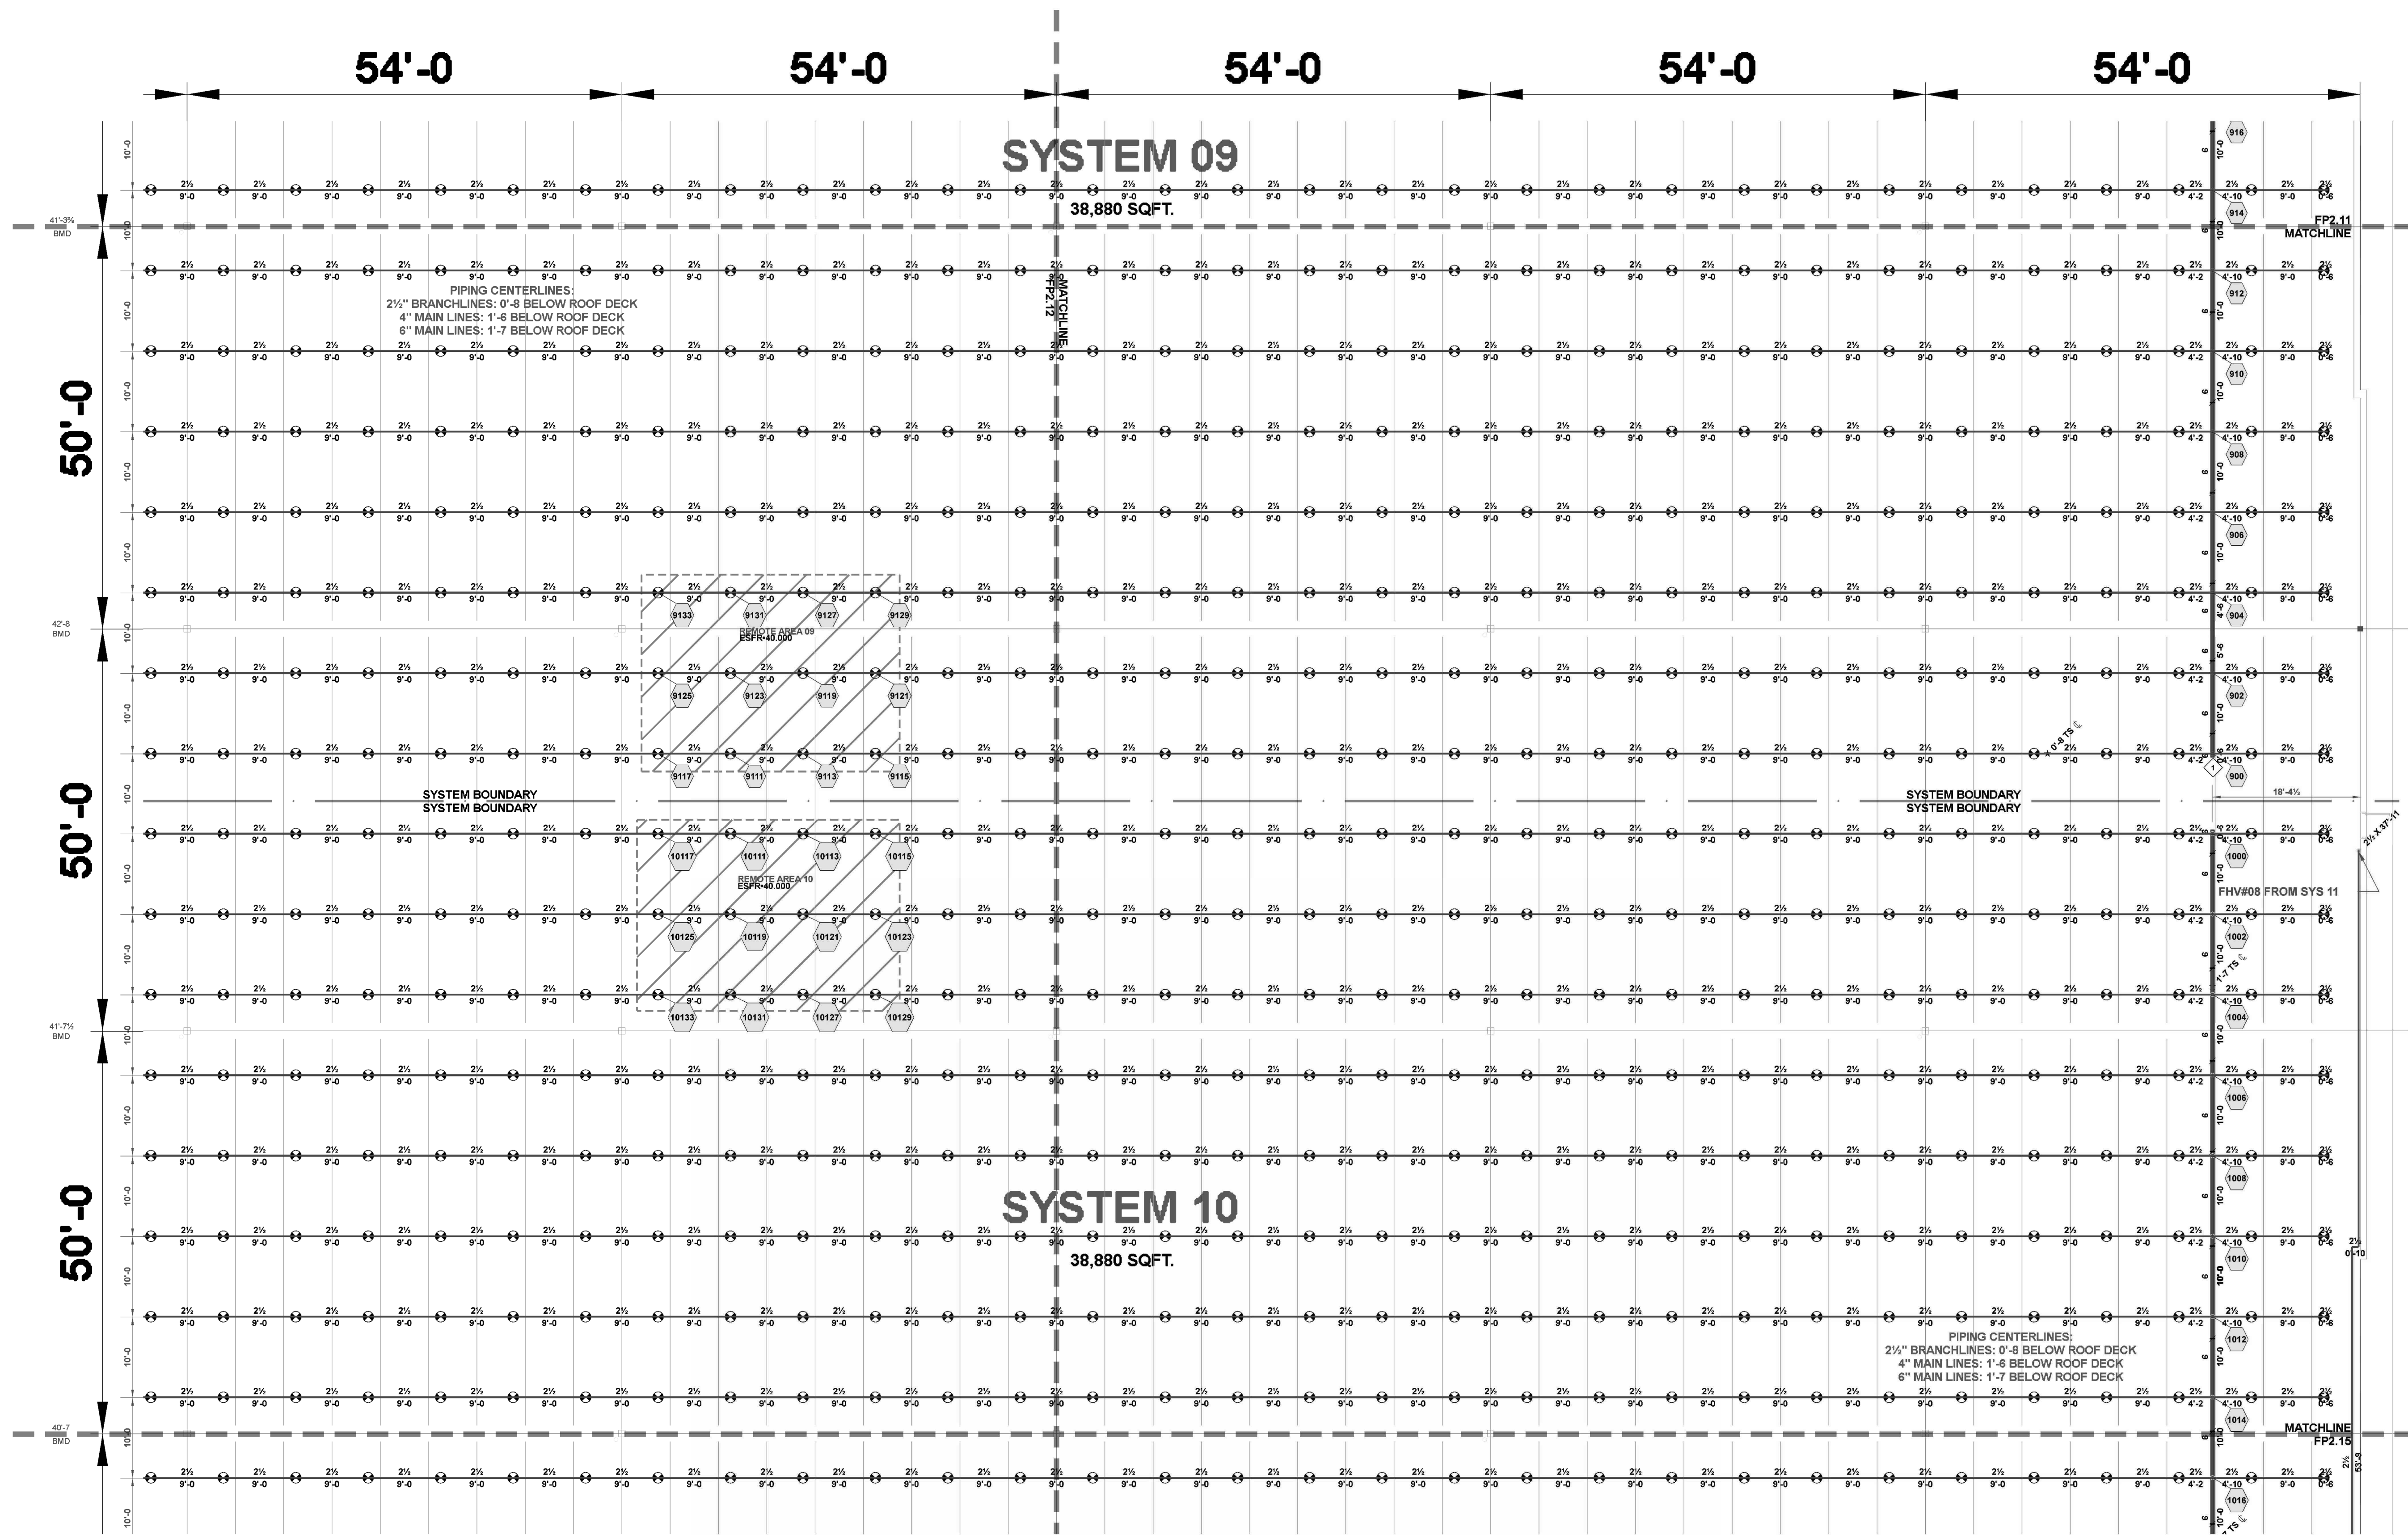


Hydraulic Information		Hydraulic Information	
Remote Area 09		Remote Area 10	
OCCUPANCY CLASSIFICATION	ESFR	OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	40.000 (ESFR)	MIN. END HEAD PRESSURE	40.000 (ESFR)
TOTAL HOSE STREAMS	250.00	TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12	TOTAL HEADS FLOWING	12
K-FACTOR	22.4	K-FACTOR	22.4
TOTAL WATER REQUIRED	1956.70	TOTAL WATER REQUIRED	1956.89
TOTAL PRESSURE REQUIRED	75.314	TOTAL PRESSURE REQUIRED	77.654
BASE OF RISER (GPM)	1956.70	BASE OF RISER (GPM)	1956.89
BASE OF RISER (PSI)	75.314	BASE OF RISER (PSI)	77.654
SAFETY MARGIN (PSI)	+12.183 (13.9%)	SAFETY MARGIN (PSI)	+9.826 (11.2%)

AREA 8 (CONT.): SYSTEMS 09-10

SCALE: 3/32" = 1'-0"

Sprinkler Legend										
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE
▲	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	3/4"	FAST	BRASS	200°F
⊗	4	VICTAULIC	V3406	V34	8	PENDENT	3/4"	QUICK	BRASS	200°F
⊙	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1"	FAST	BRASS	200°F
●	48	VIKING	VK600	MICROFAST	5.6	PENDENT	1/2"	QUICK	CHROME	135°F
⊙	6	VIKING	VK3021		5.6	PENDENT	1/2"	QUICK	CHROME	135°F
◆	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	3/4"	QUICK	BRASS	205°F
TOTAL = 5234										

\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6" OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

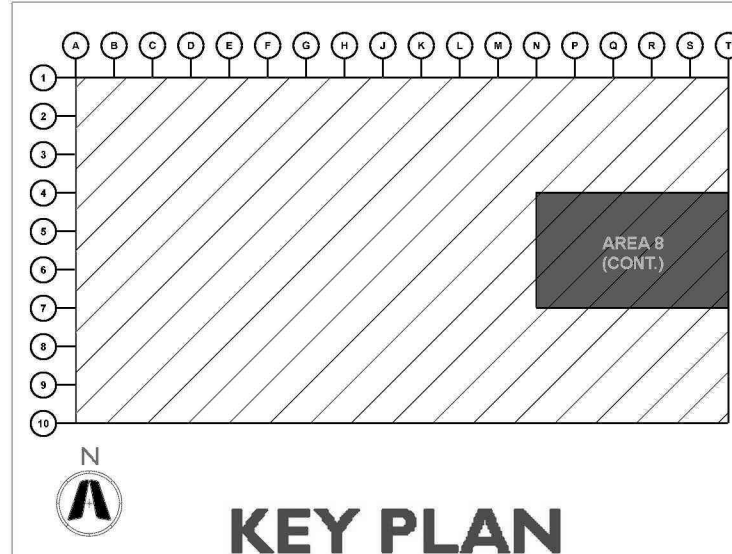





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


ISSUE DATES

PERMIT SET 02.18.22

TENANT IMPROVEMENT 09.07.22







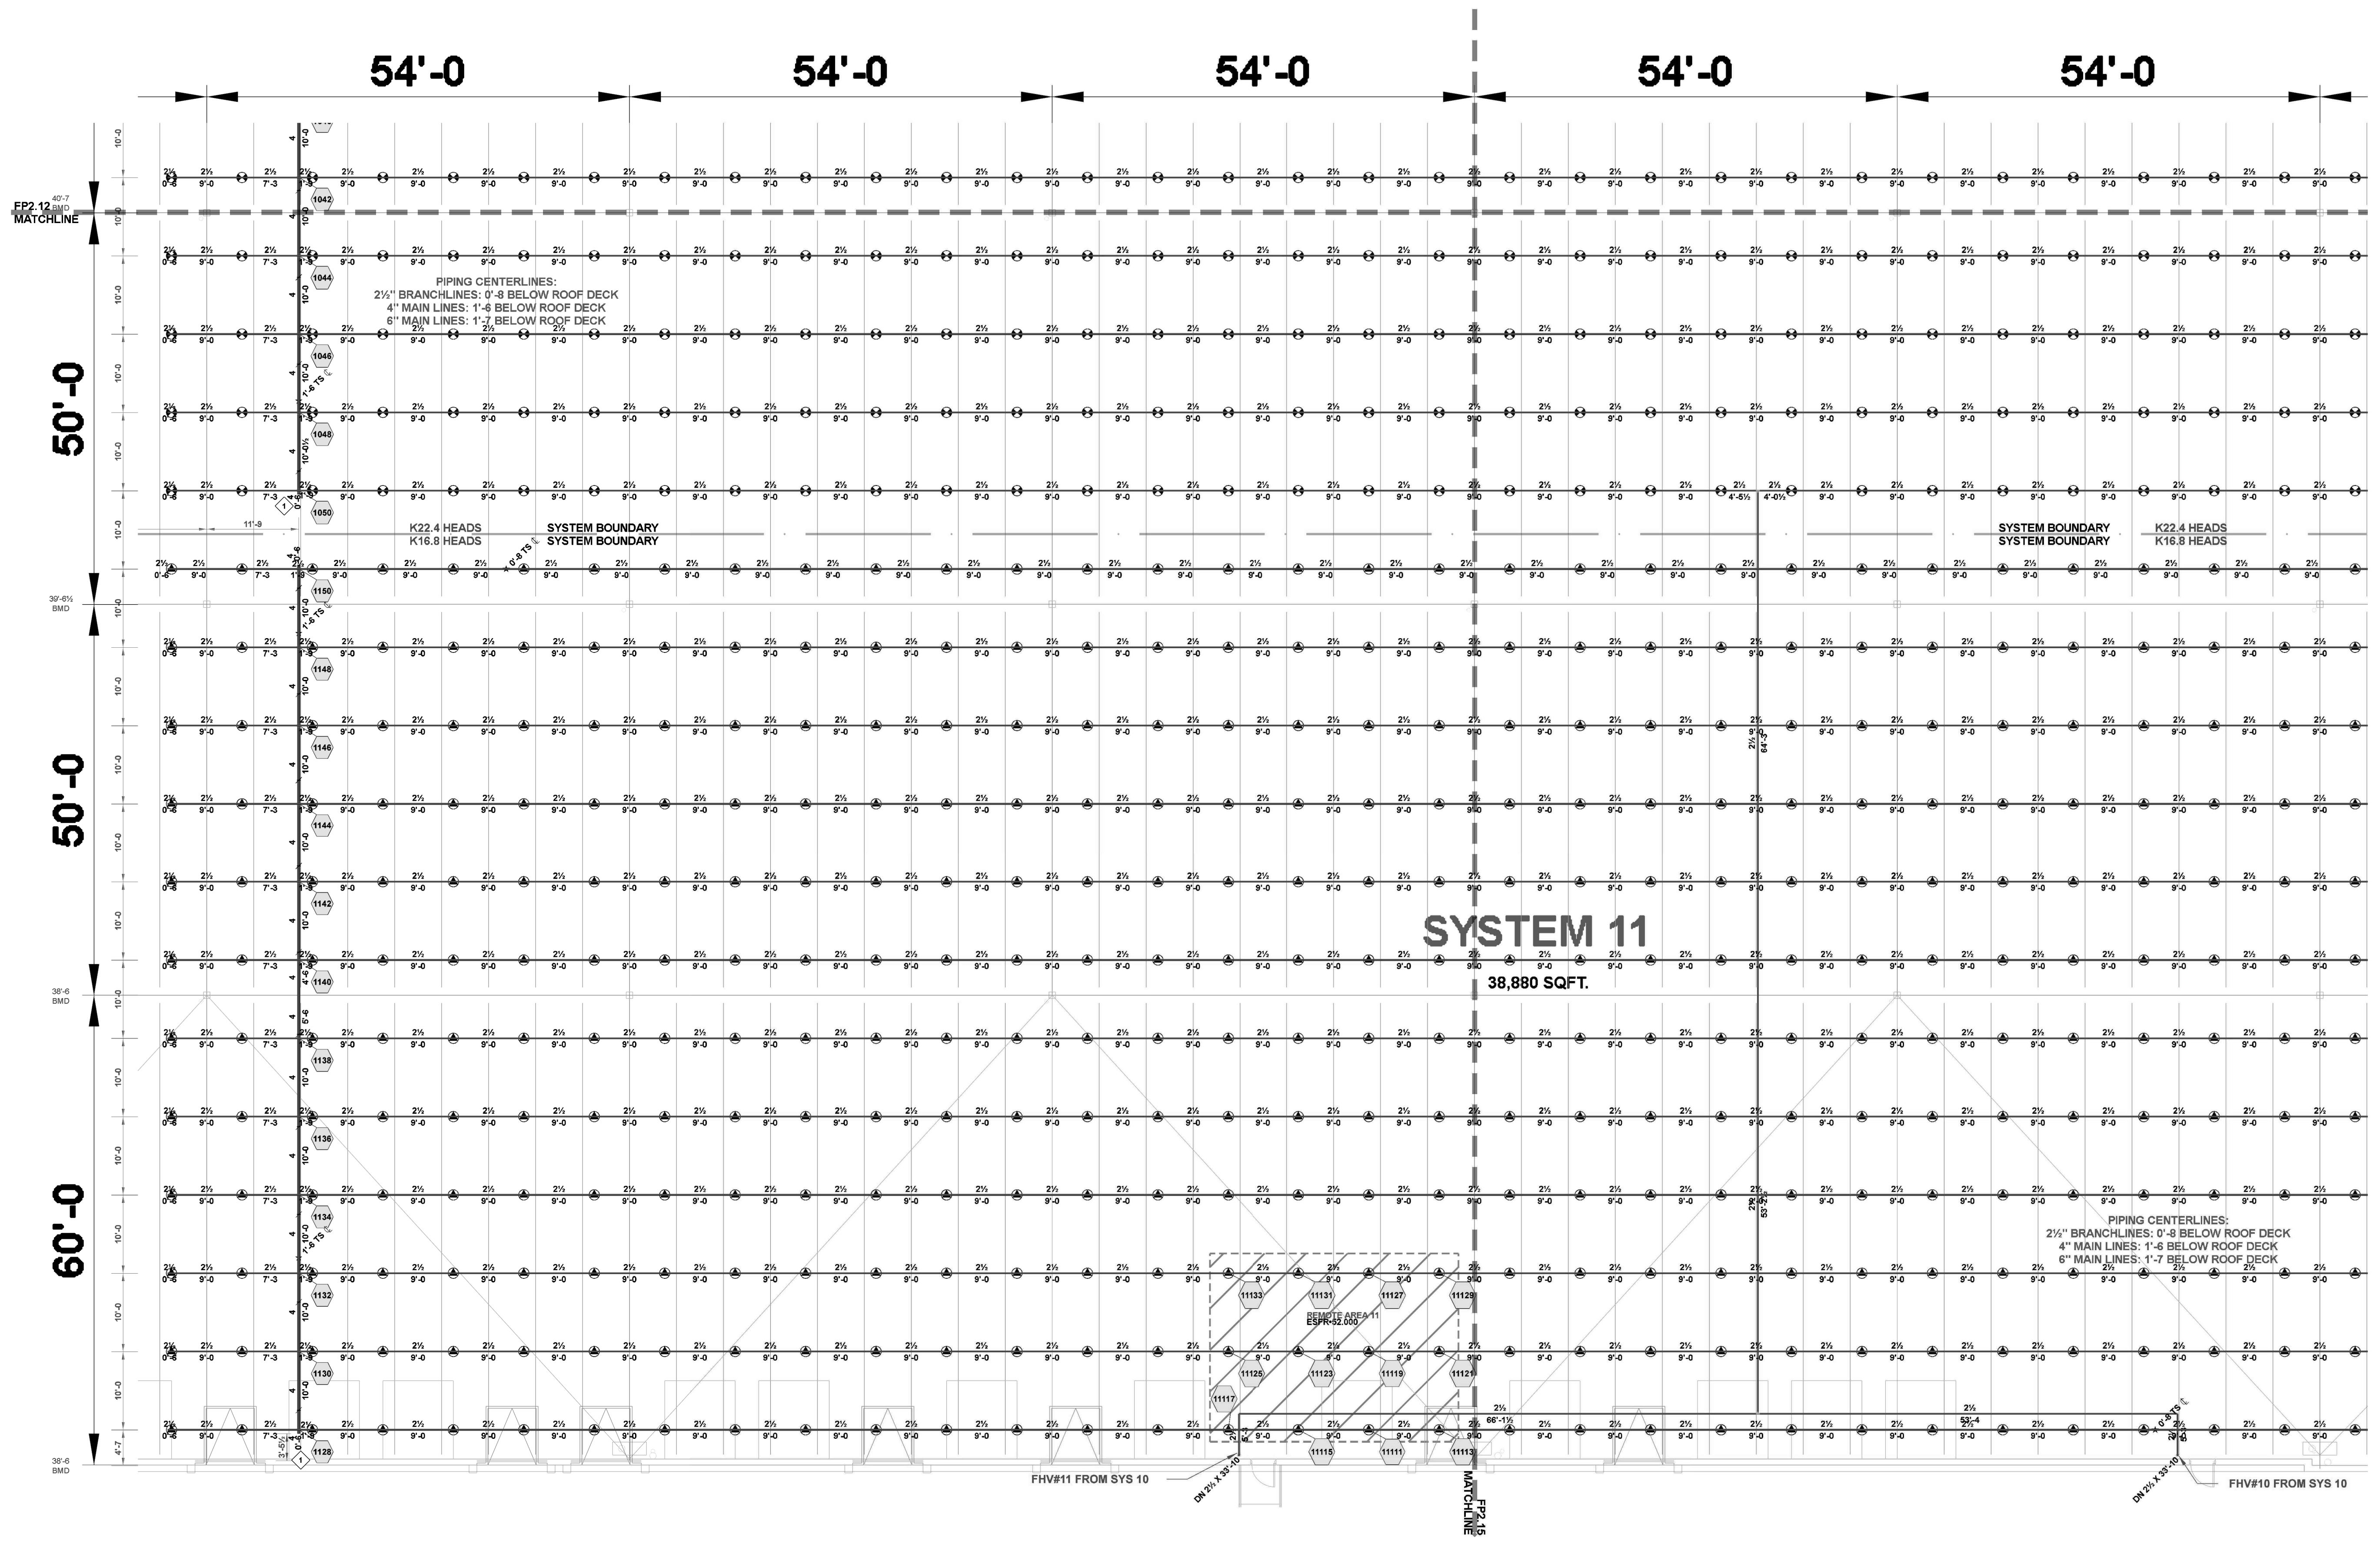210300

**FP2.9.1**  
AREA 9: SYSTEMS  
10-11




Hydraulic Information	
Remote Area 11	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	52,000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	16.8
TOTAL WATER REQUIRED	1708.55
TOTAL PRESSURE REQUIRED	79.115
BASE OF RISER (GPM)	1708.55
BASE OF RISER (PSI)	79.115
SAFETY MARGIN (PSI)	+10.490 (11.7%)

AREA 9: SYSTEMS 10-11  
SCALE: 3/32" = 1'-0"

Sprinkler Legend											
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE	NOTE
	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	3/4"	FAST	BRASS	200°F	
	4	VICTAULIC	V3406	V34	8	PENDENT	3/4"	QUICK	BRASS	200°F	
	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1"	FAST	BRASS	200°F	
	48	VIKING	VK600	MICROFAST	5.6	PENDENT	1/2"	QUICK	CHROME	135°F	
	6	VIKING	VK3021		5.6	PENDENT	1/2"	QUICK	CHROME	135°F	
	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	3/4"	QUICK	BRASS	205°F	
TOTAL = 5234											

\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6" OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

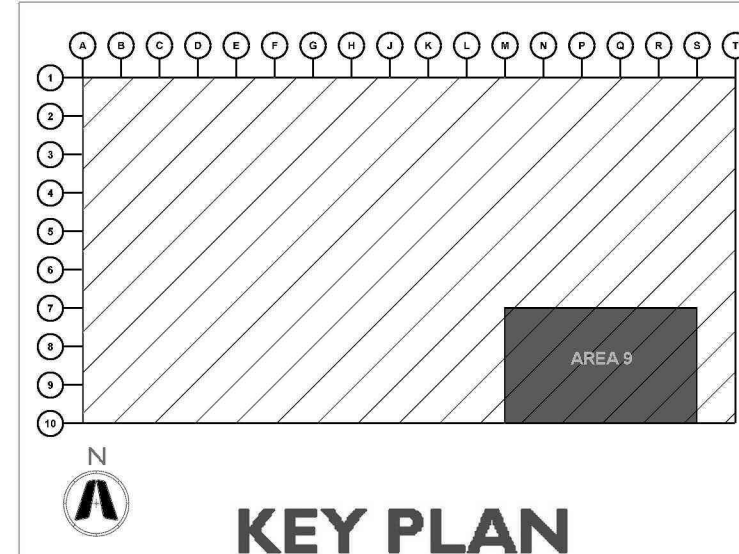





\_\_\_\_\_




## PROJECT INFORMATION







NW CORNER OF  
UDOR RD & MAIN ST  
S SUMMIT, MO 64086

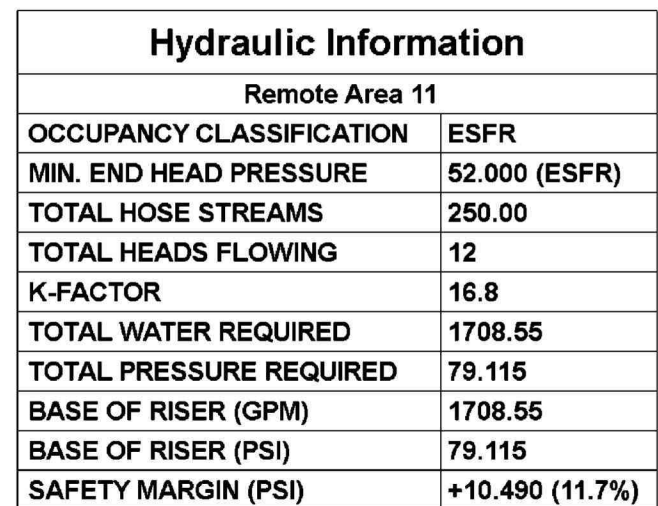PERMIT SET 02.18.22

## FP2.9.2


AREA 9(CONT.):  
SYSTEMS 10-11



Sprinkler Legend											
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE	NOTE
	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	¾	FAST	BRASS	200°F	
	4	VICTAULIC	V3406	V34	8	PENDENT	¾	QUICK	BRASS	200°F	
	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1	FAST	BRASS	200°F	
	48	VIKING	VK600	MICROFAST	5.6	PENDENT	½	QUICK	CHROME	135°F	
	6	VIKING	VK3021		5.6	PENDENT	½	QUICK	CHROME	135°F	
	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	¾	QUICK	BRASS	205°F	
	TOTAL = 5234										

1 - **AUXILIARY DRAIN**  
SEE FP0.0 FOR DETAIL

2 - **AIR VENT**  
SEE FP0.0 FOR DETAIL

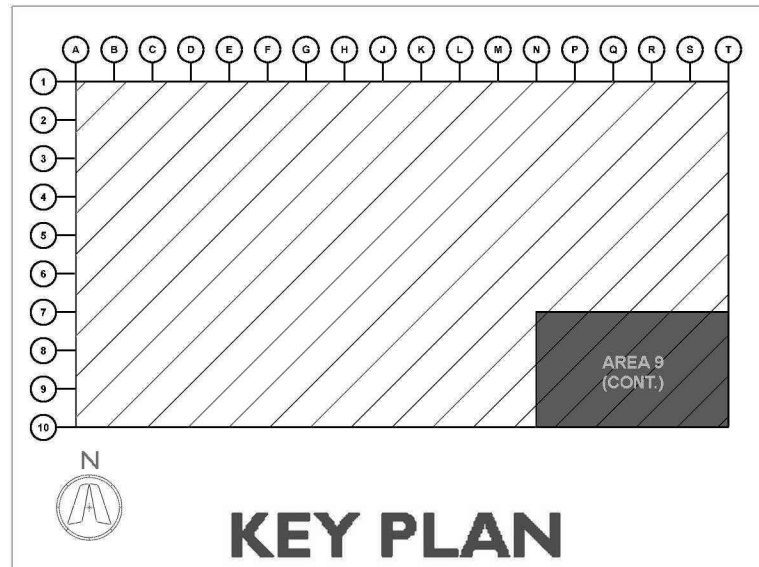





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



**SCANNELL**  
PROPERTIES

CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES


PERMIT SET 02.18.22

TENANT IMPROVEMENT 09.07.22

210300


**FP2.10**

TENANT  
IMPROVEMENT  
OFFICE PLAN

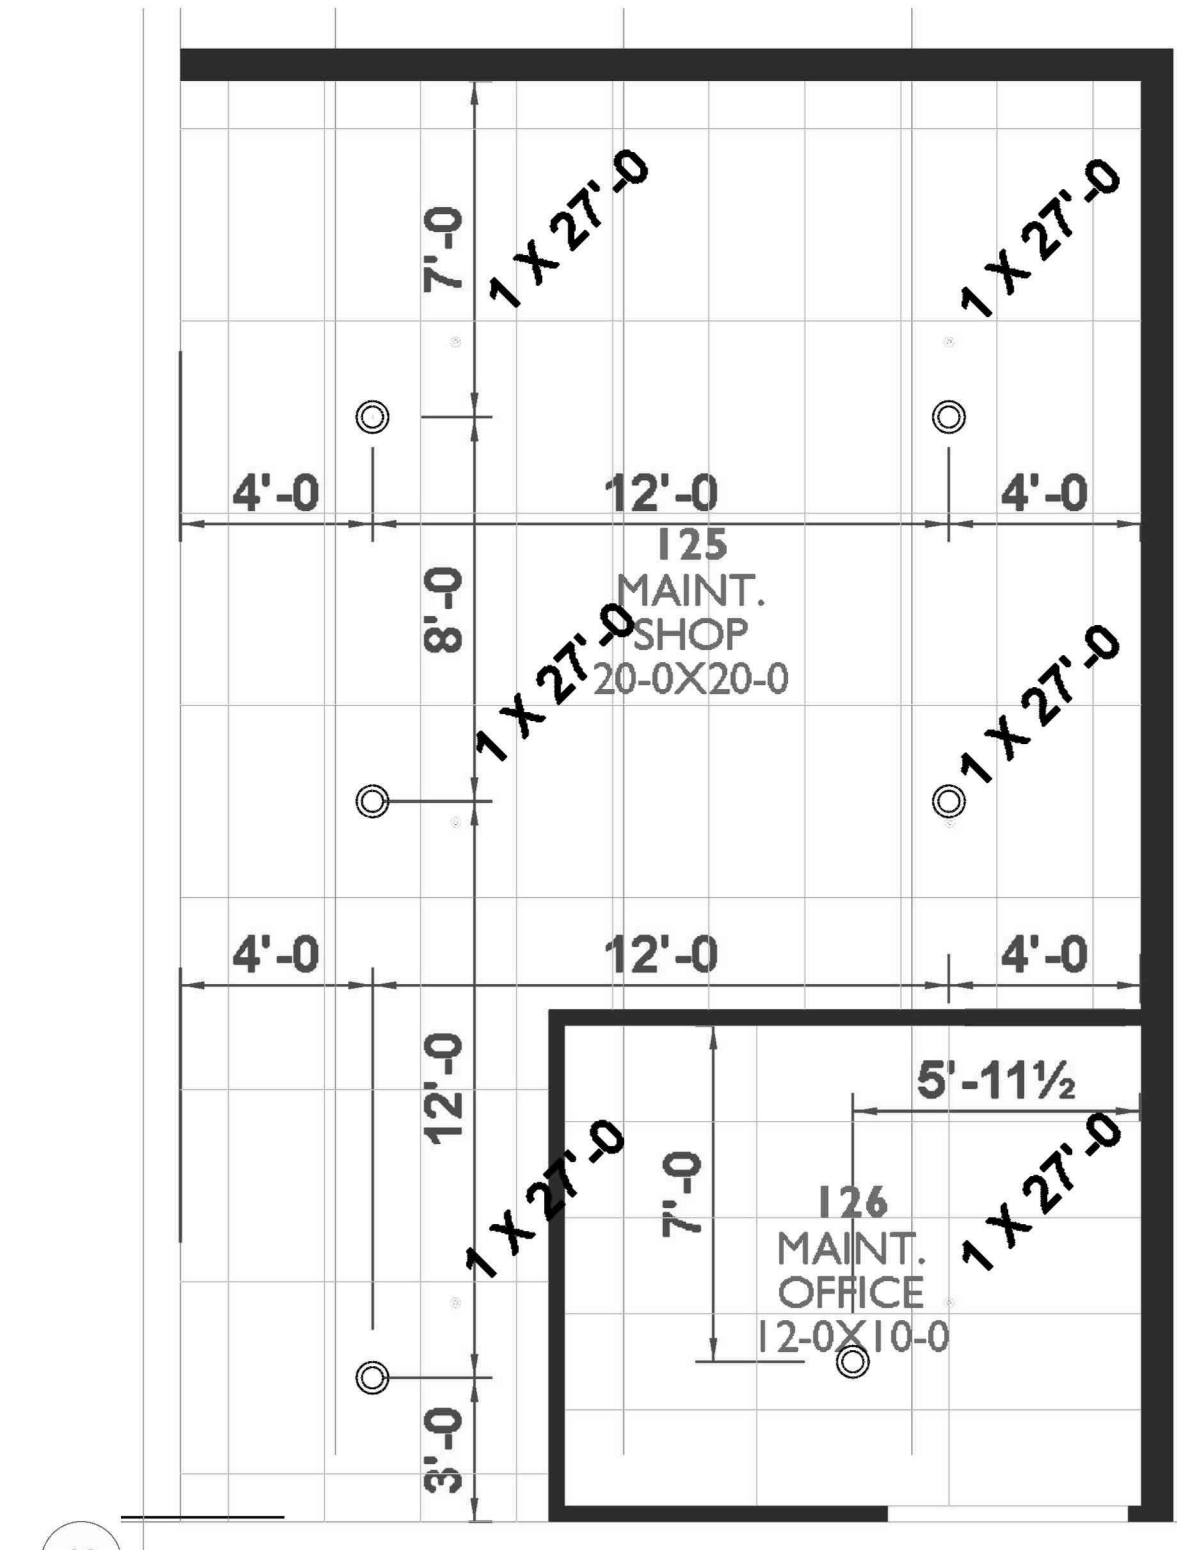


MAINT. SHOP SPRINKLER LAYOUT

SCALE: 1/4" = 1'-0"




Hydraulic Information	
Remote Area Office	
OCCUPANCY CLASSIFICATION	LIGHT HAZARD
DENSITY (GPM/FT²)	0.10 FOR 1500FT² (ACTUAL 965FT²)
QUICK RESPONSE REDUCTION	9'-8" CEILING (40.0%) 900FT²
TOTAL HOSE STREAMS	100.00
TOTAL HEADS FLOWING	7
K-FACTOR	5.6
TOTAL WATER REQUIRED	388.74
TOTAL PRESSURE REQUIRED	42.659
BASE OF RISER (GPM)	388.74
BASE OF RISER (PSI)	42.659
SAFETY MARGIN (PSI)	+53.863 (55.8%)

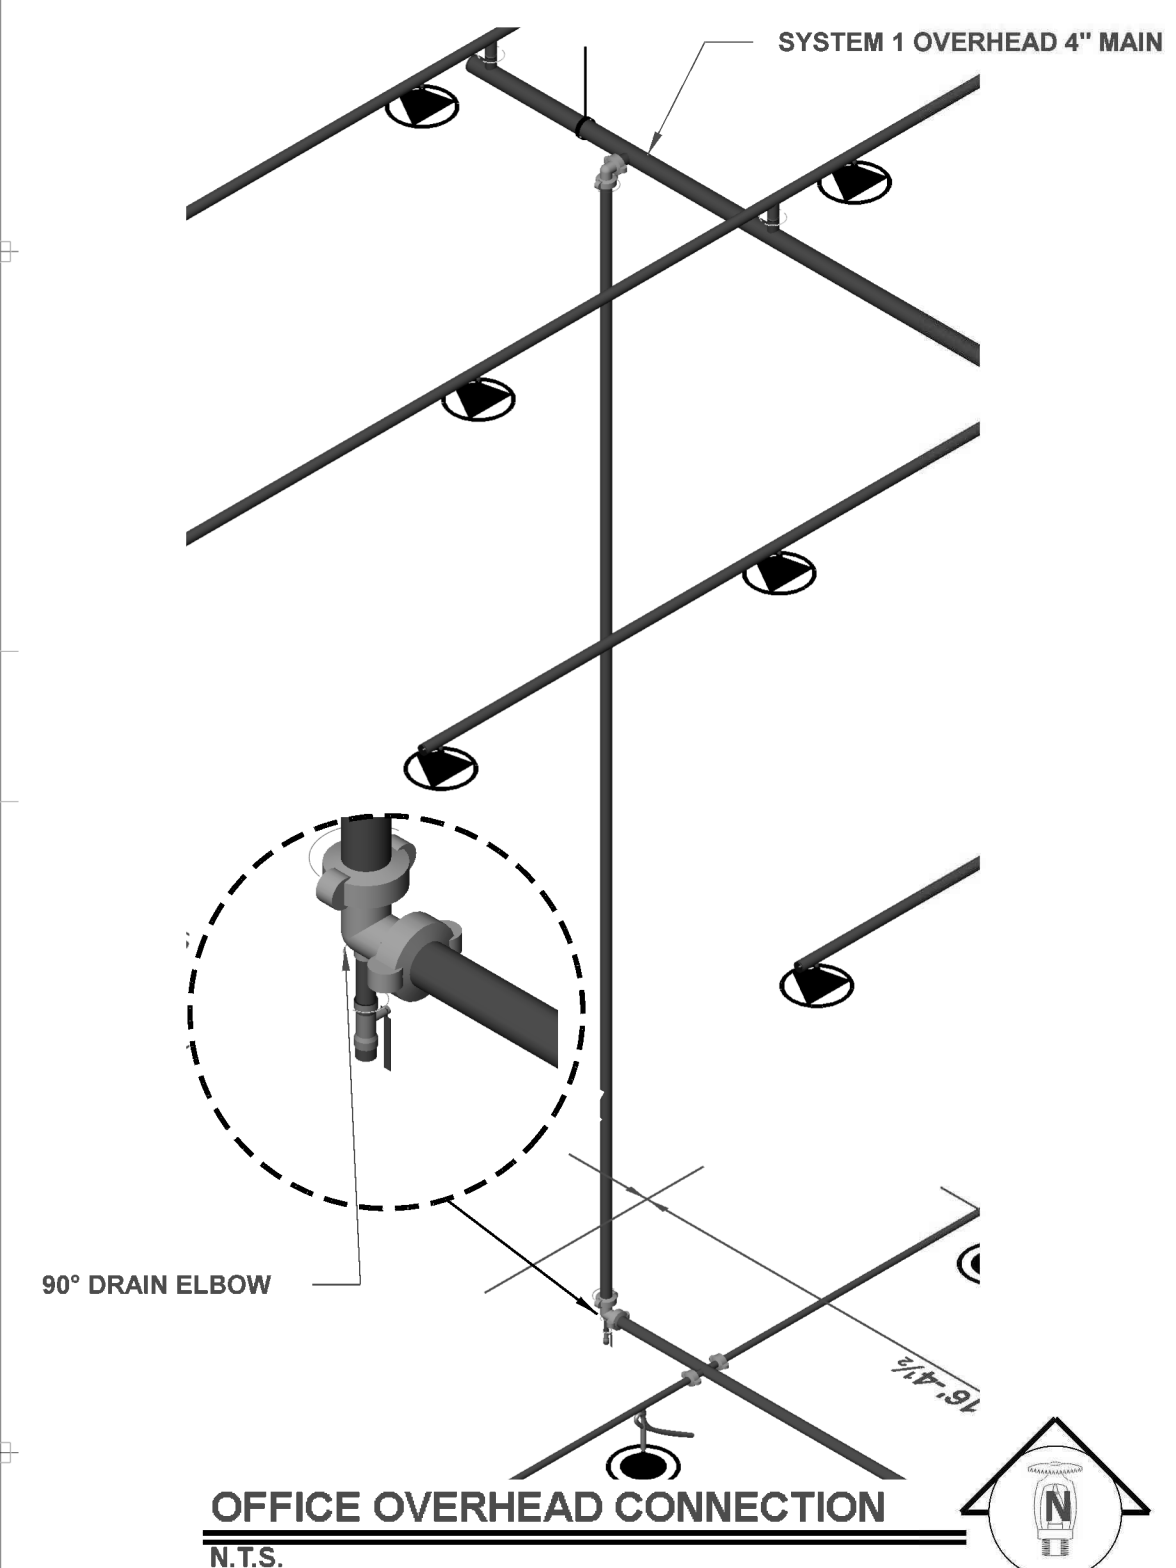


OFFICE OVERHEAD CONNECTION

N.T.S.

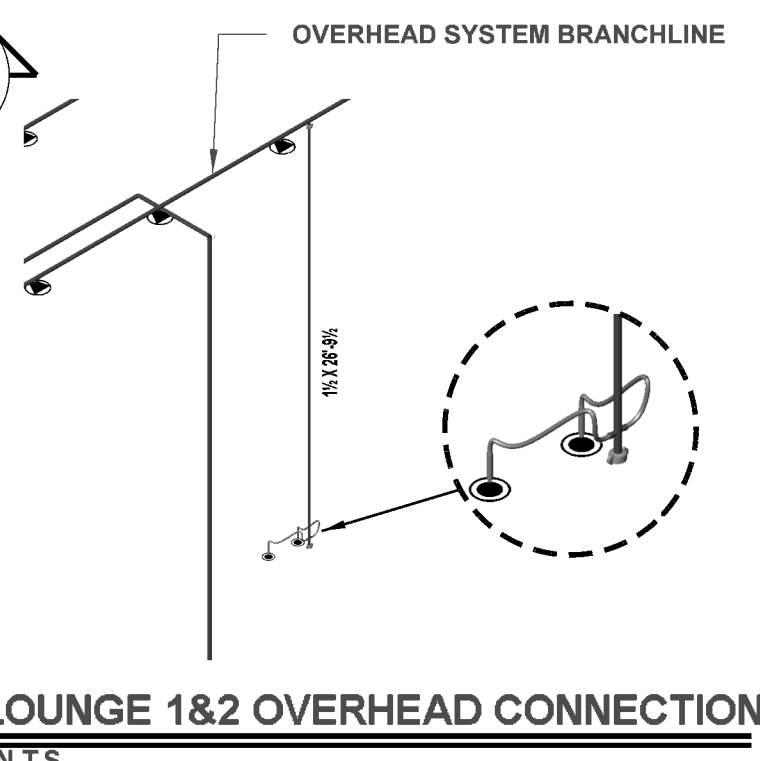


LOUNGE 1&2 OVERHEAD CONNECTION

N.T.S.

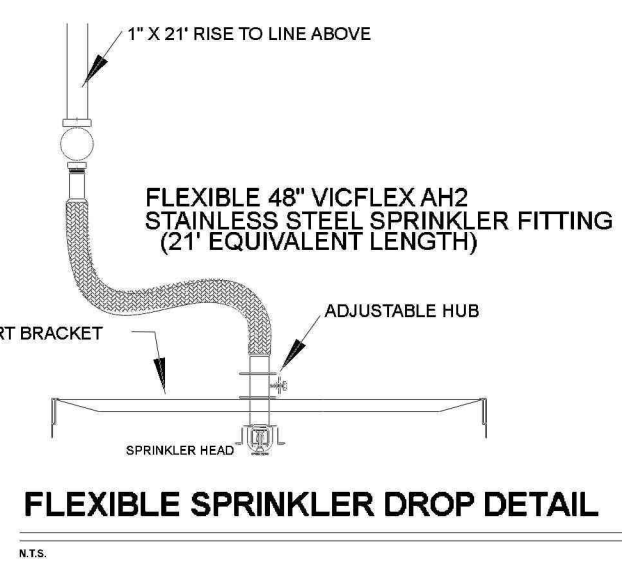


FLEXIBLE SPRINKLER DROP DETAIL

N.T.S.

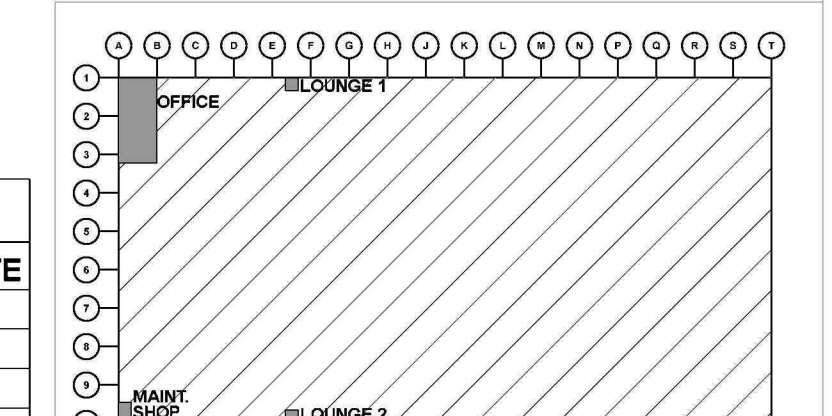


KEY PLAN

Sprinkler Legend										
SYMBOL	MANUFACTURER	SIN	MODEL	QUANTITY	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE
▲	VICTAULIC	V4702	FL-QR/ST/ESFR	2054	16.8	PENDENT	3/4"	FAST	BRASS	200°F
⊗	VICTAULIC	V3406	V34	4	9	PENDENT	3/4"	QUICK	BRASS	200°F
◆	VICTAULIC	V3428	ESFR	2754	22.4	PENDENT	1"	FAST	BRASS	200°F
●	VIKING	VK600	MICROFAST	48	5.6	PENDENT	1/2"	QUICK	CHROME	135°F
⊙	VIKING	VK3021		6	5.6	PENDENT	1/2"	QUICK	CHROME	135°F
◆	VIKING	VK504	ESFR DRY	368	16.8	PENDENT	3/4"	QUICK	BRASS	205°F
				TOTAL = 5234						

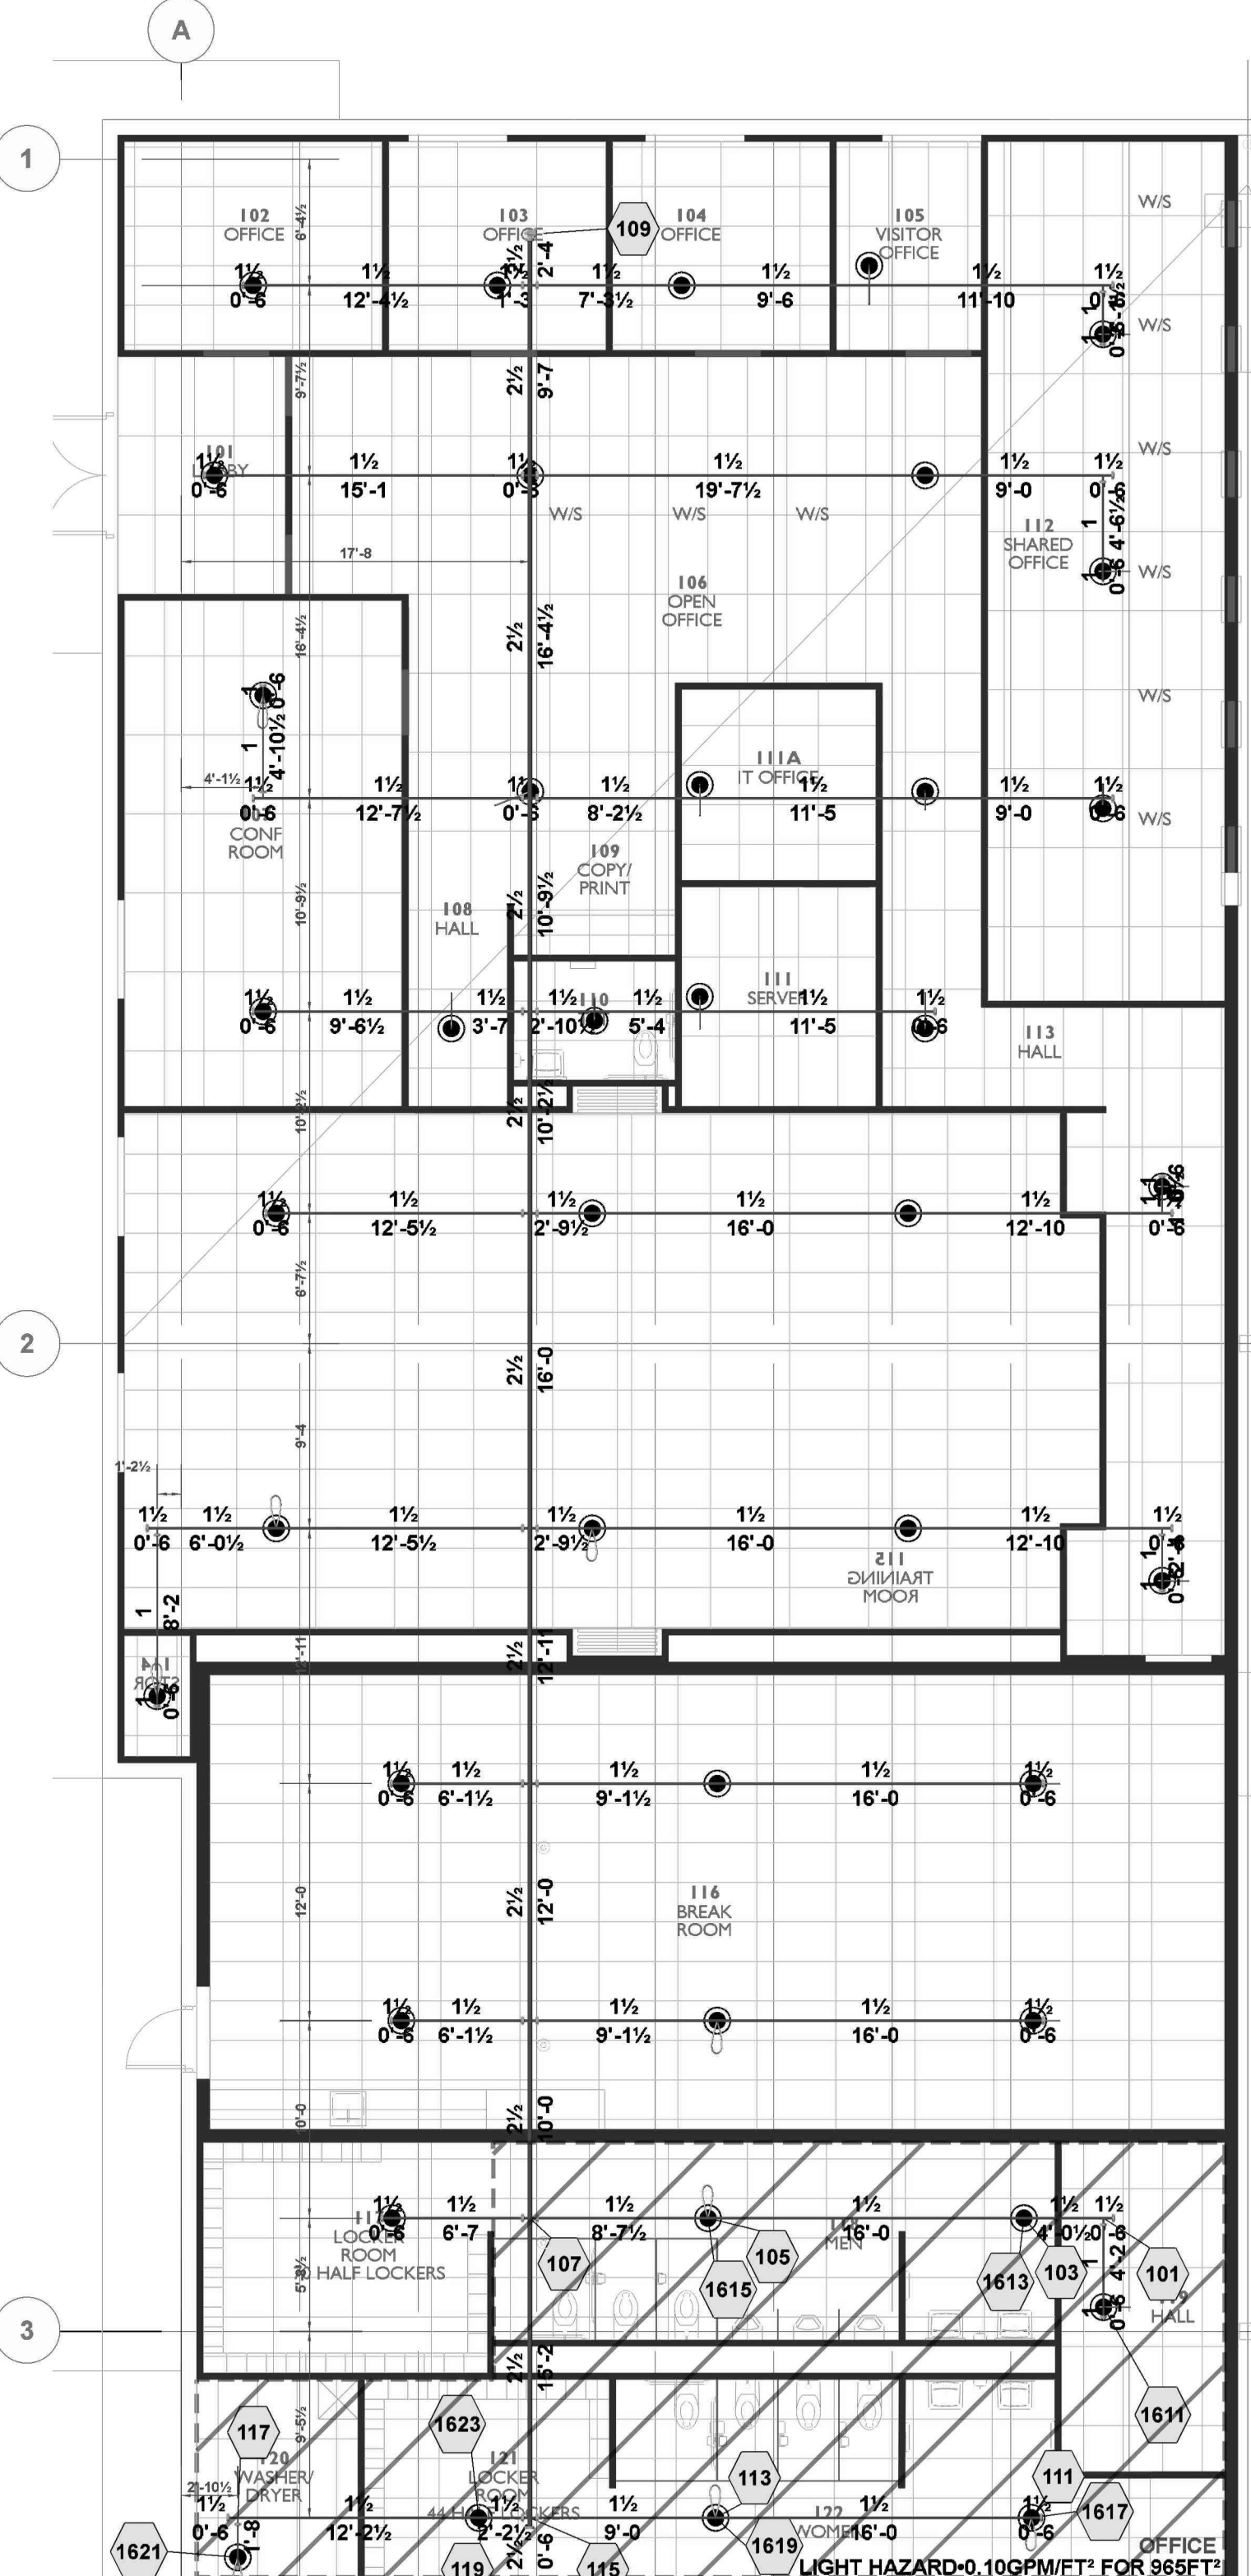


OFFICE PIPING LAYOUT

SCALE: 1/8" = 1'-0"





\*\*ACT ELEVATIONS: 9'-8" AFF  
\*\*PIPING CENTERLINES: 10'-8" AFF

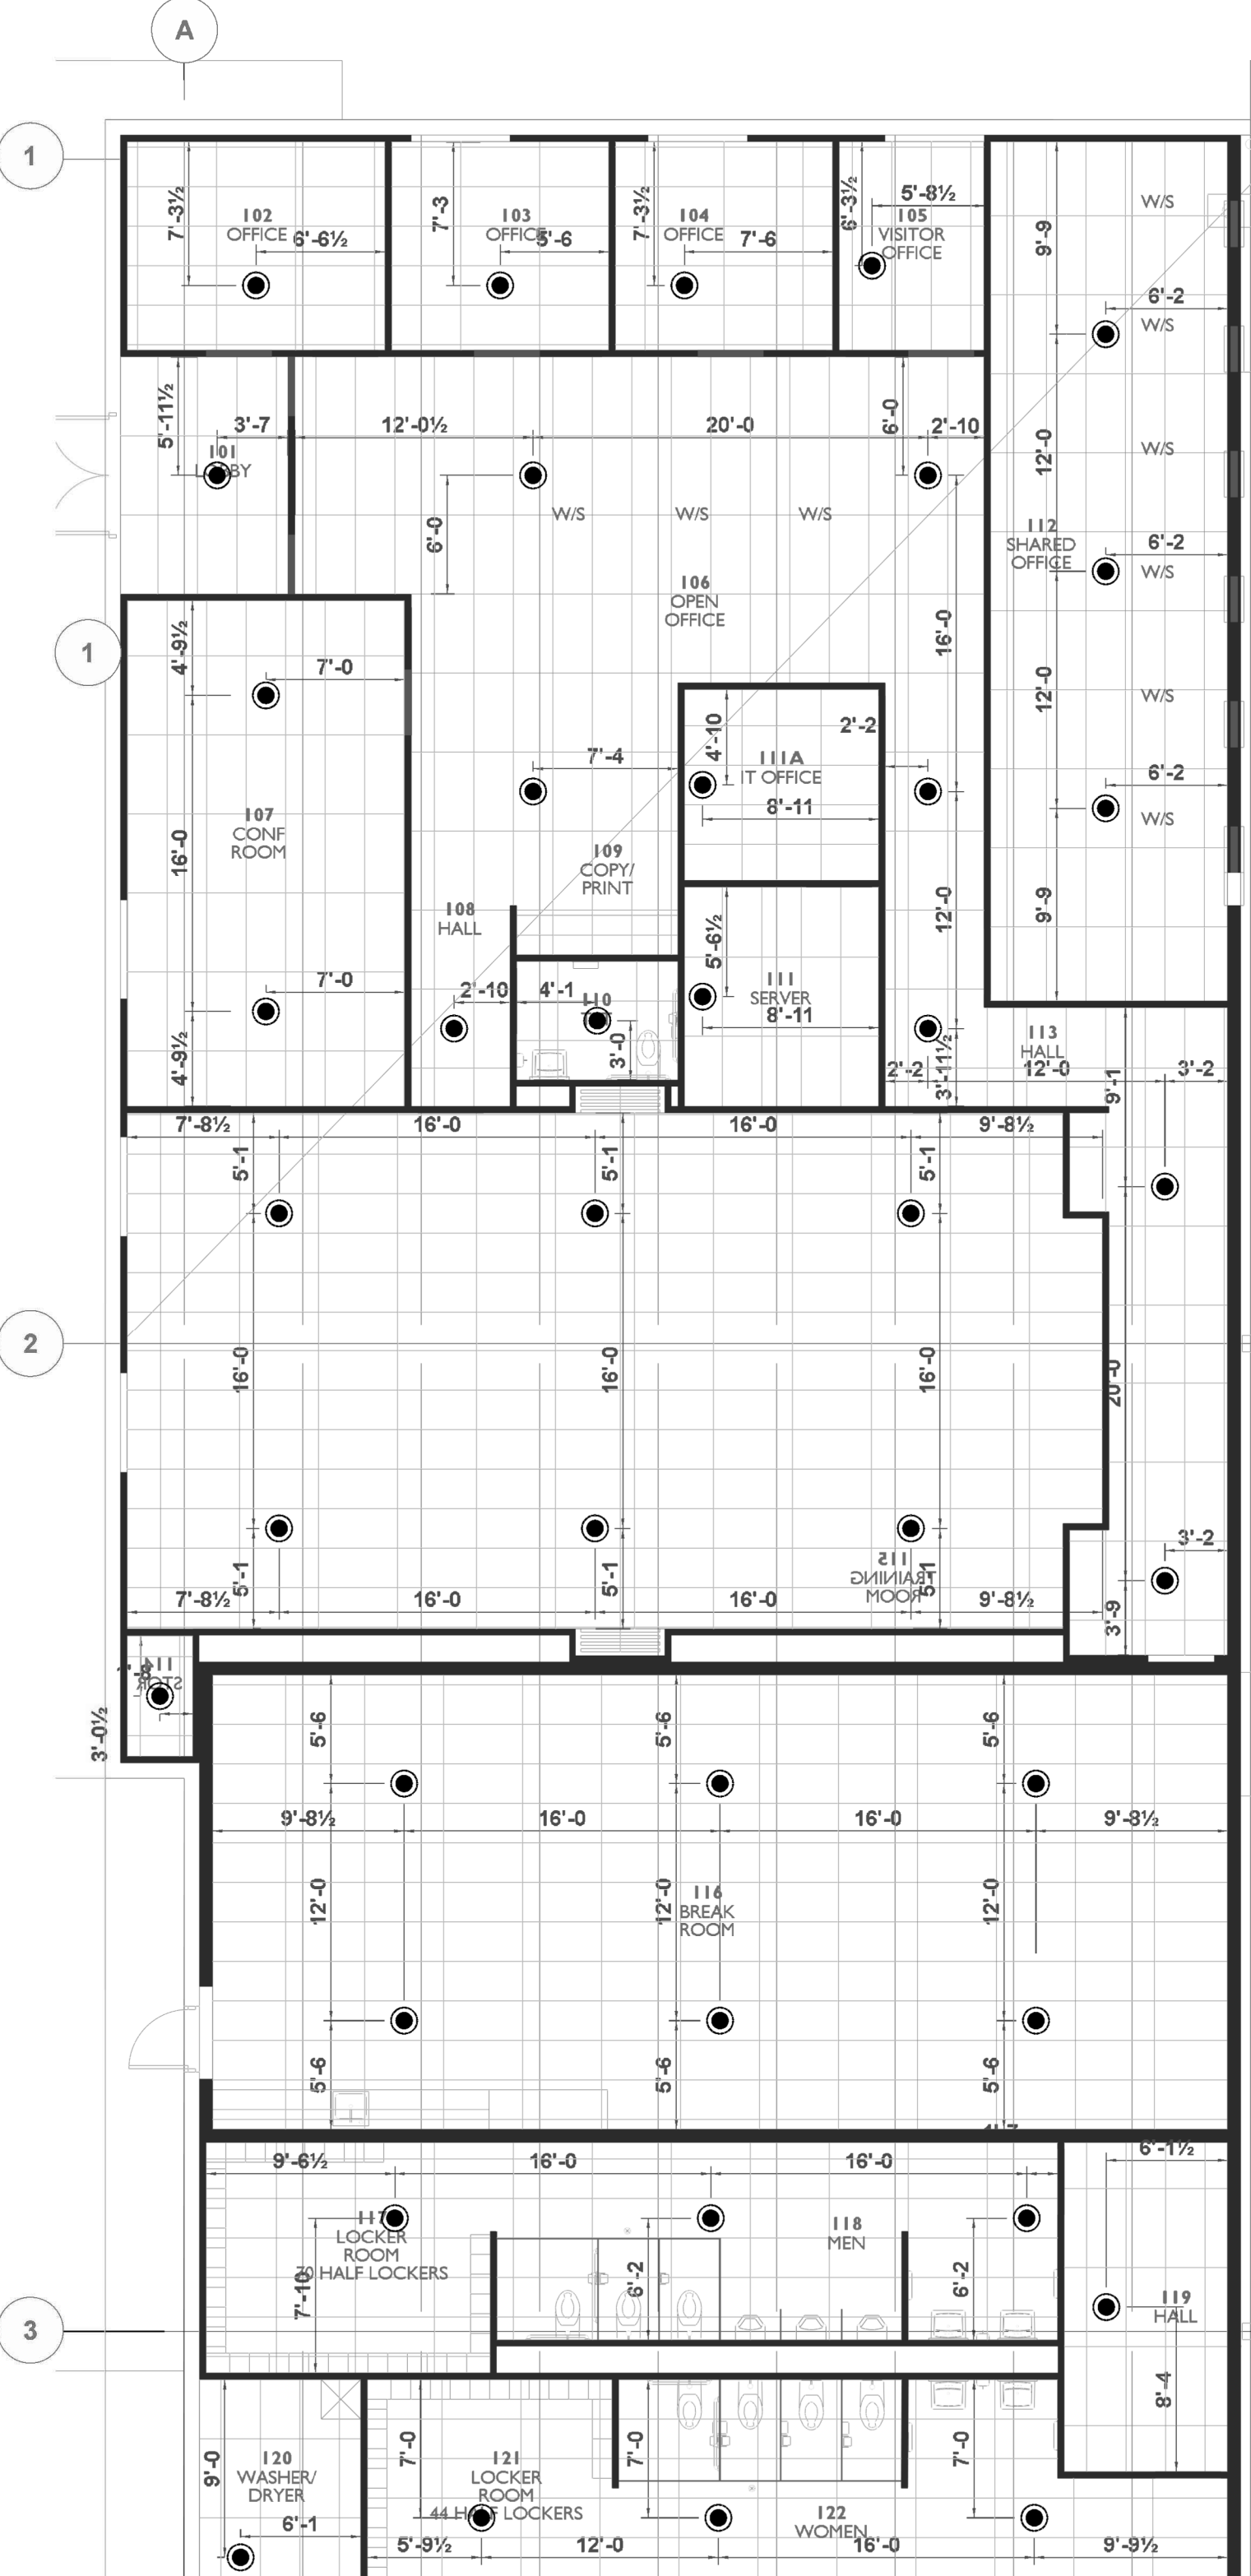



OFFICE SPRINKLER REFLECTED CEILING PLAN

SCALE: 1/8" = 1'-0"

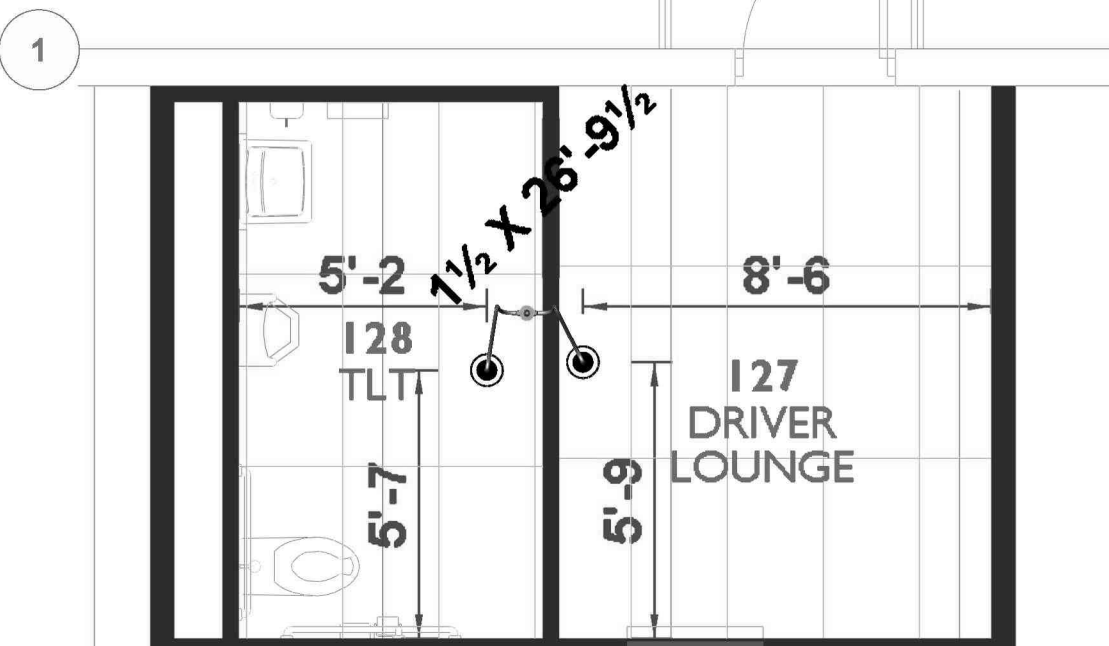

DRIVERS LOUNGE 1 REFLECTED CEILING PLAN

SCALE: 1/4" = 1'-0"

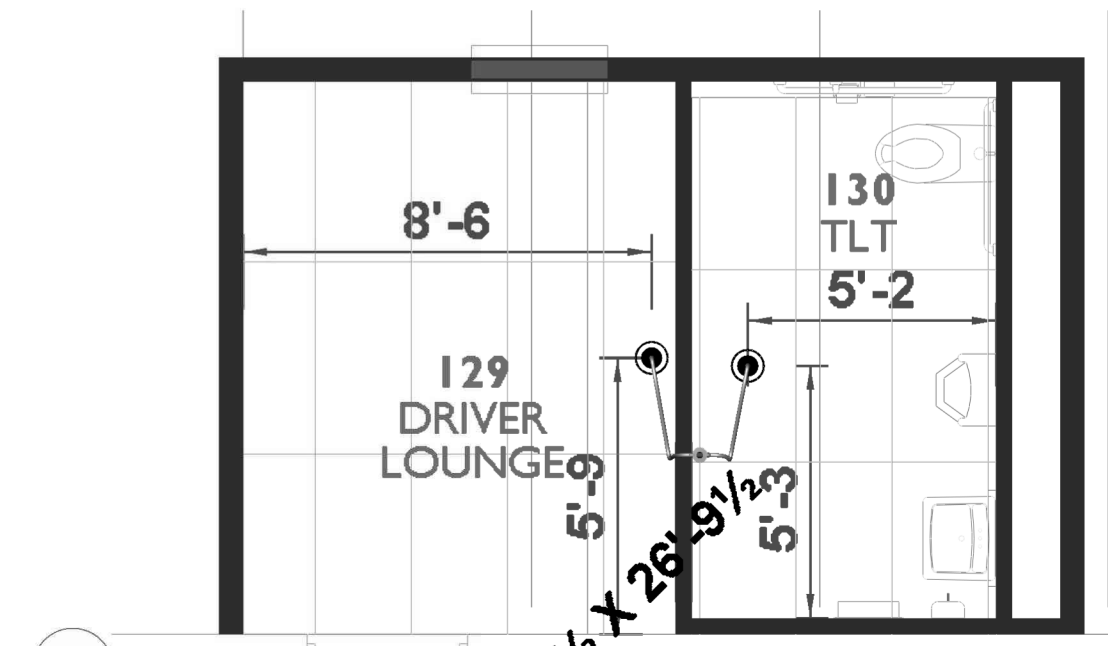

DRIVERS LOUNGE 2 REFLECTED CEILING PLAN

SCALE: 1/4" = 1'-0"







**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.


PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I  
NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086



ISSUE DATES  
PERMIT SET 02.18.22  
TENANT IMPROVEMENT 09.07.22

210300  
**FP2.11**  
TENANT  
IMPROVEMENT  
COOLER PLAN

Hydraulic Information	
Remote Area Cooler	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	52.000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	16.8
TOTAL WATER REQUIRED	1708.14
TOTAL PRESSURE REQUIRED	73.255
BASE OF RISER (GPM)	1708.14
BASE OF RISER (PSI)	73.255
SAFETY MARGIN (PSI)	+16.353 (18.2%)

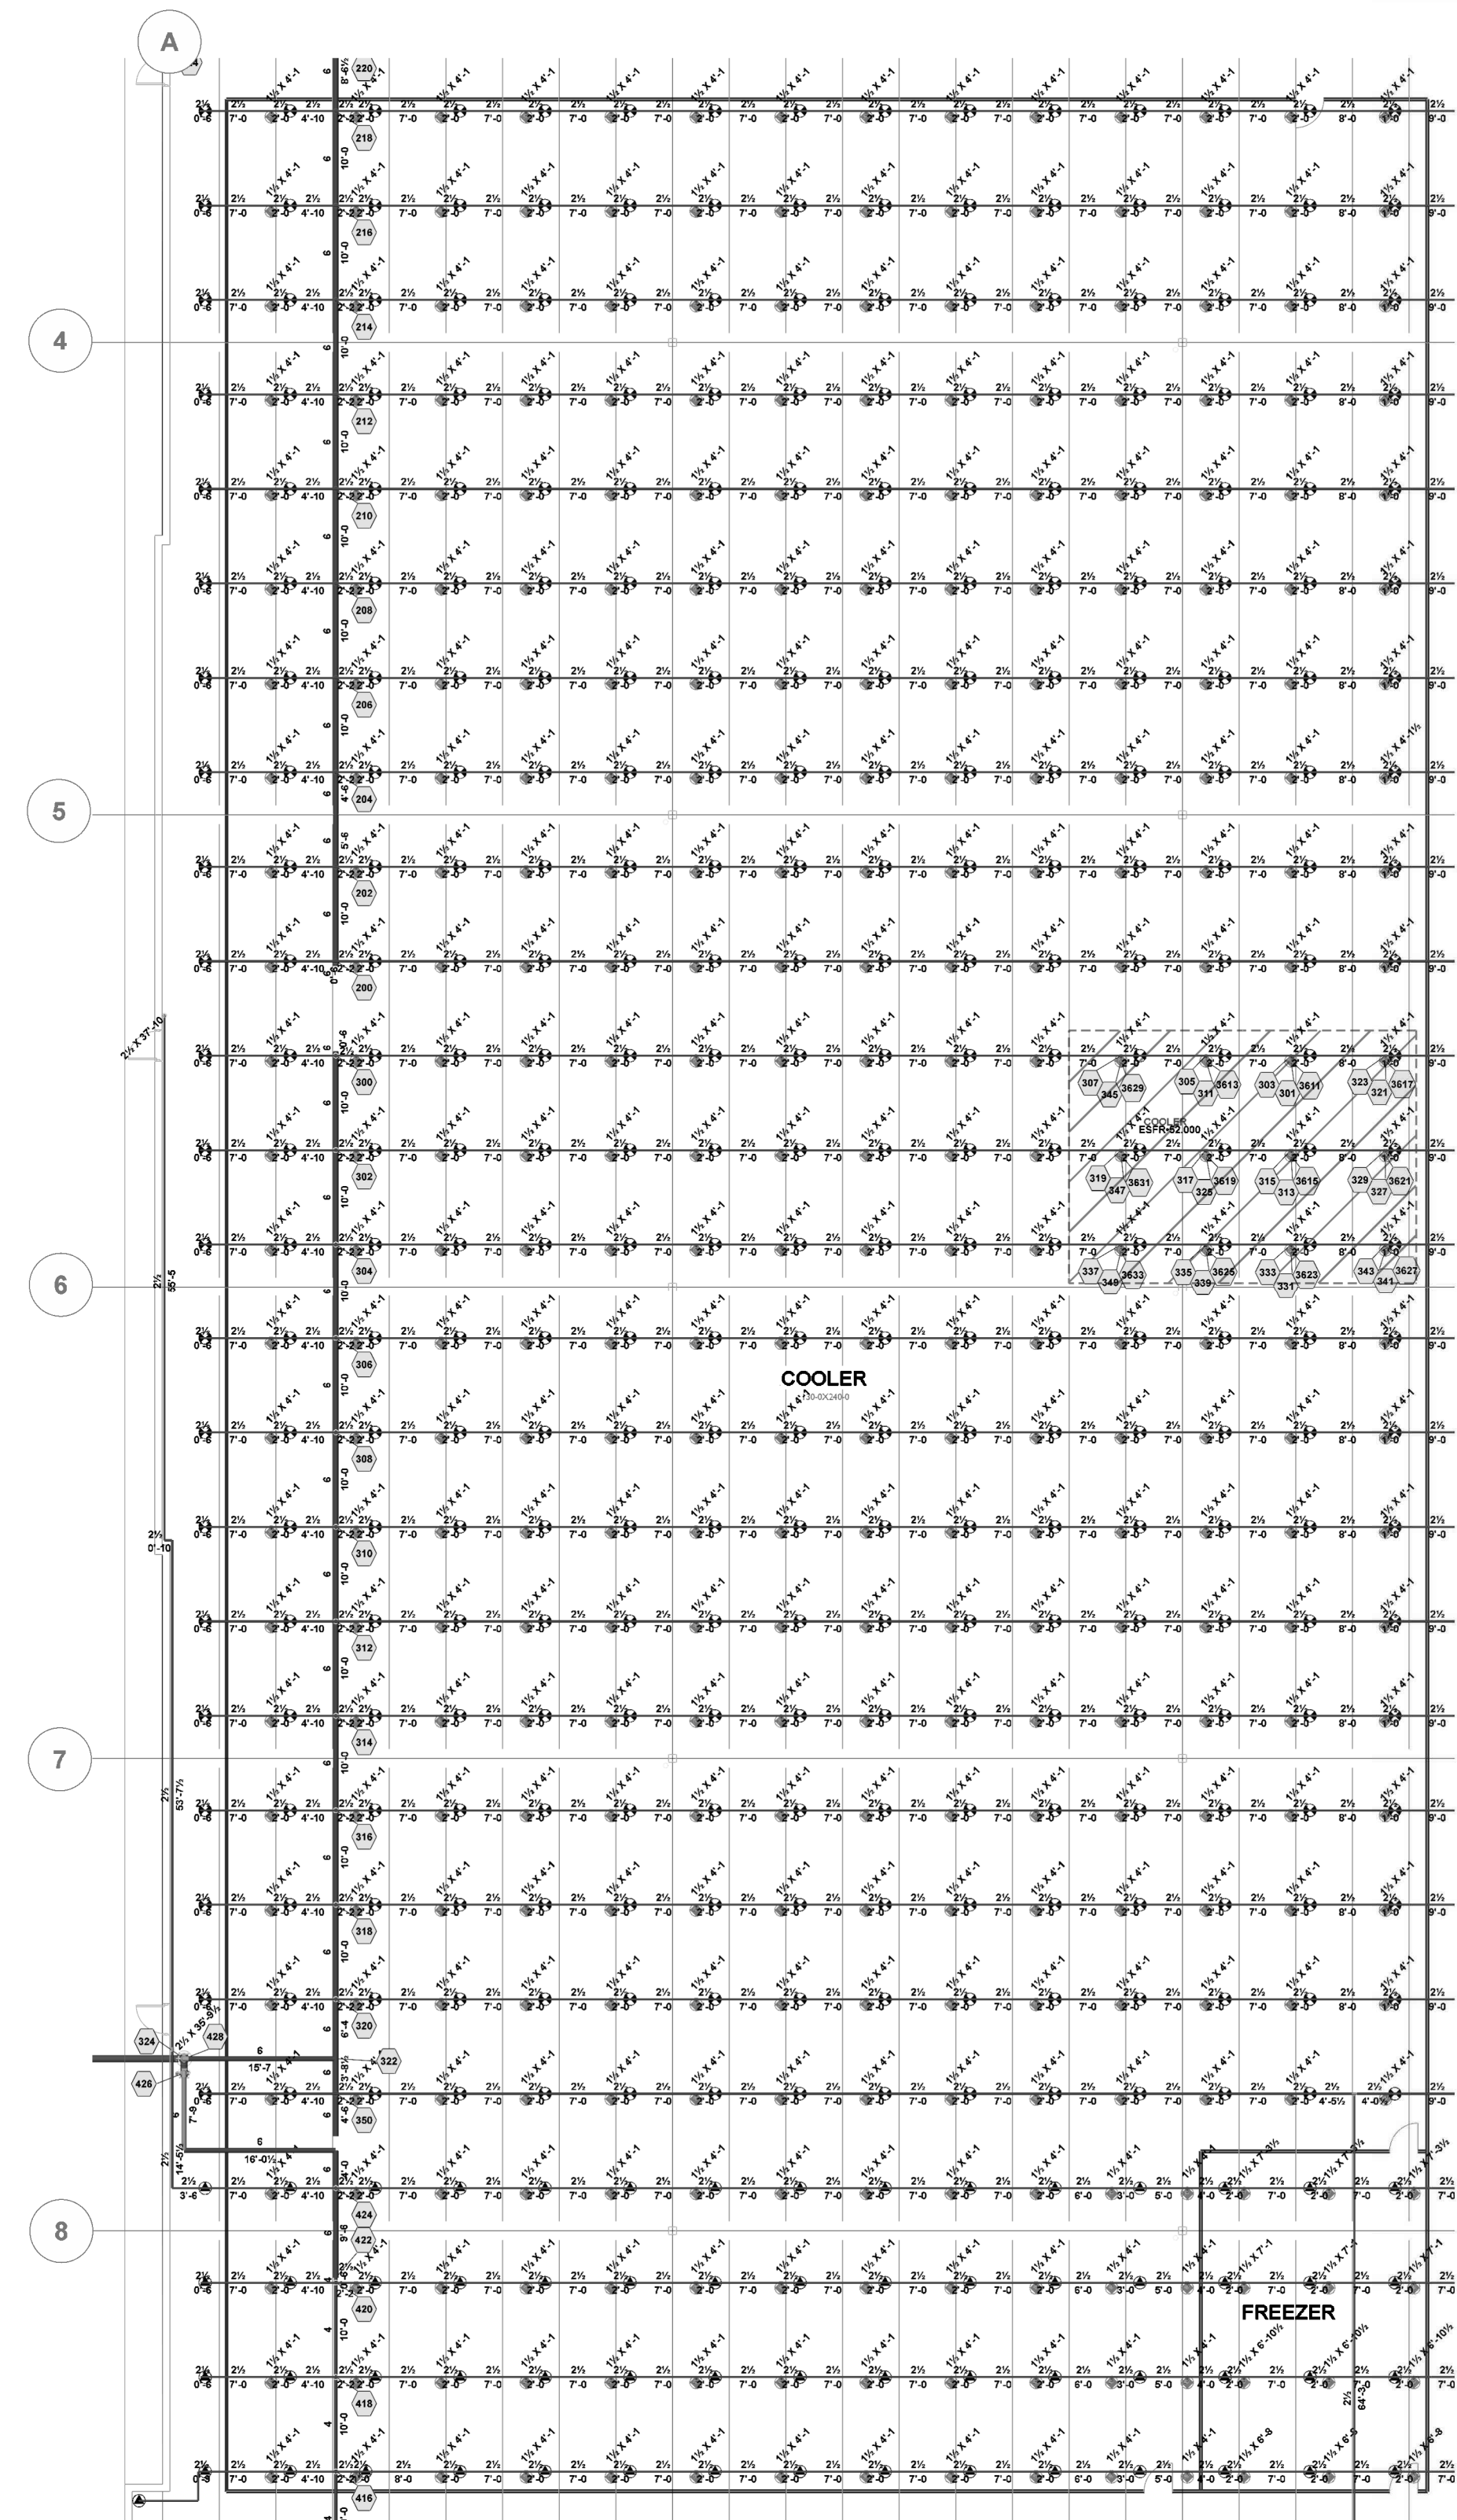


**COOLER/FREEZER OVERHAD LAYOUT**  
SCALE: 1/16" = 1'-0"

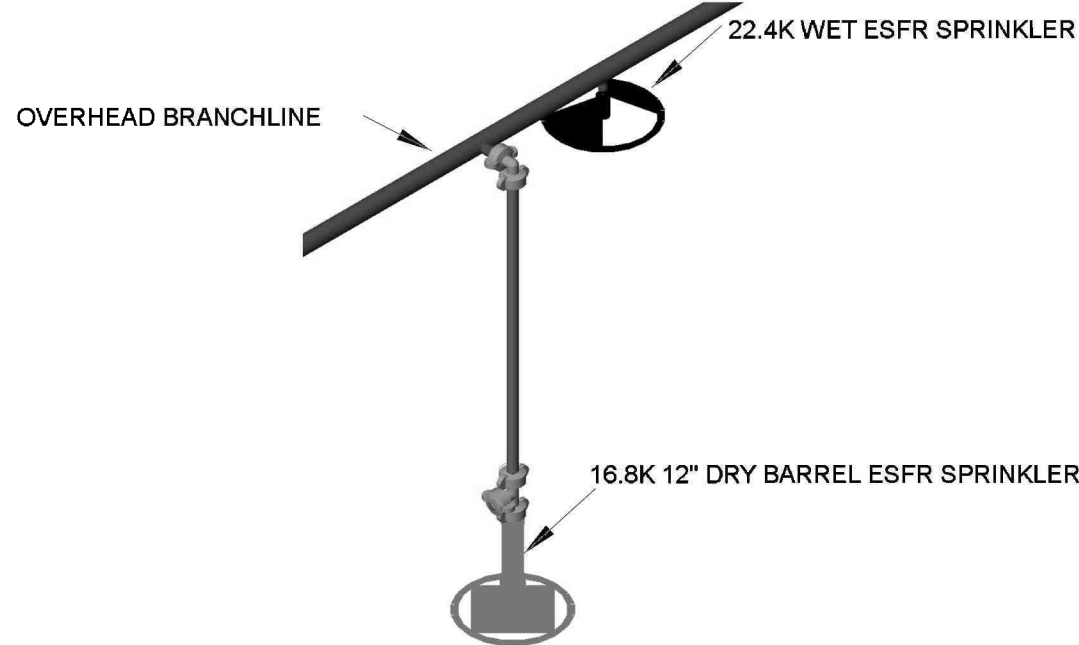


**DRY BARREL OVERHEAD CONNECTION**  
N.T.S.



\*\*COOLER CEILING ELEVATION: 6'-4 BELOW DECK  
\*\*COOLER CEILING THICKNESS: 0'-5  
\*\*BRANCHLINE CENTERLINES: 0'-3 BELOW DECK

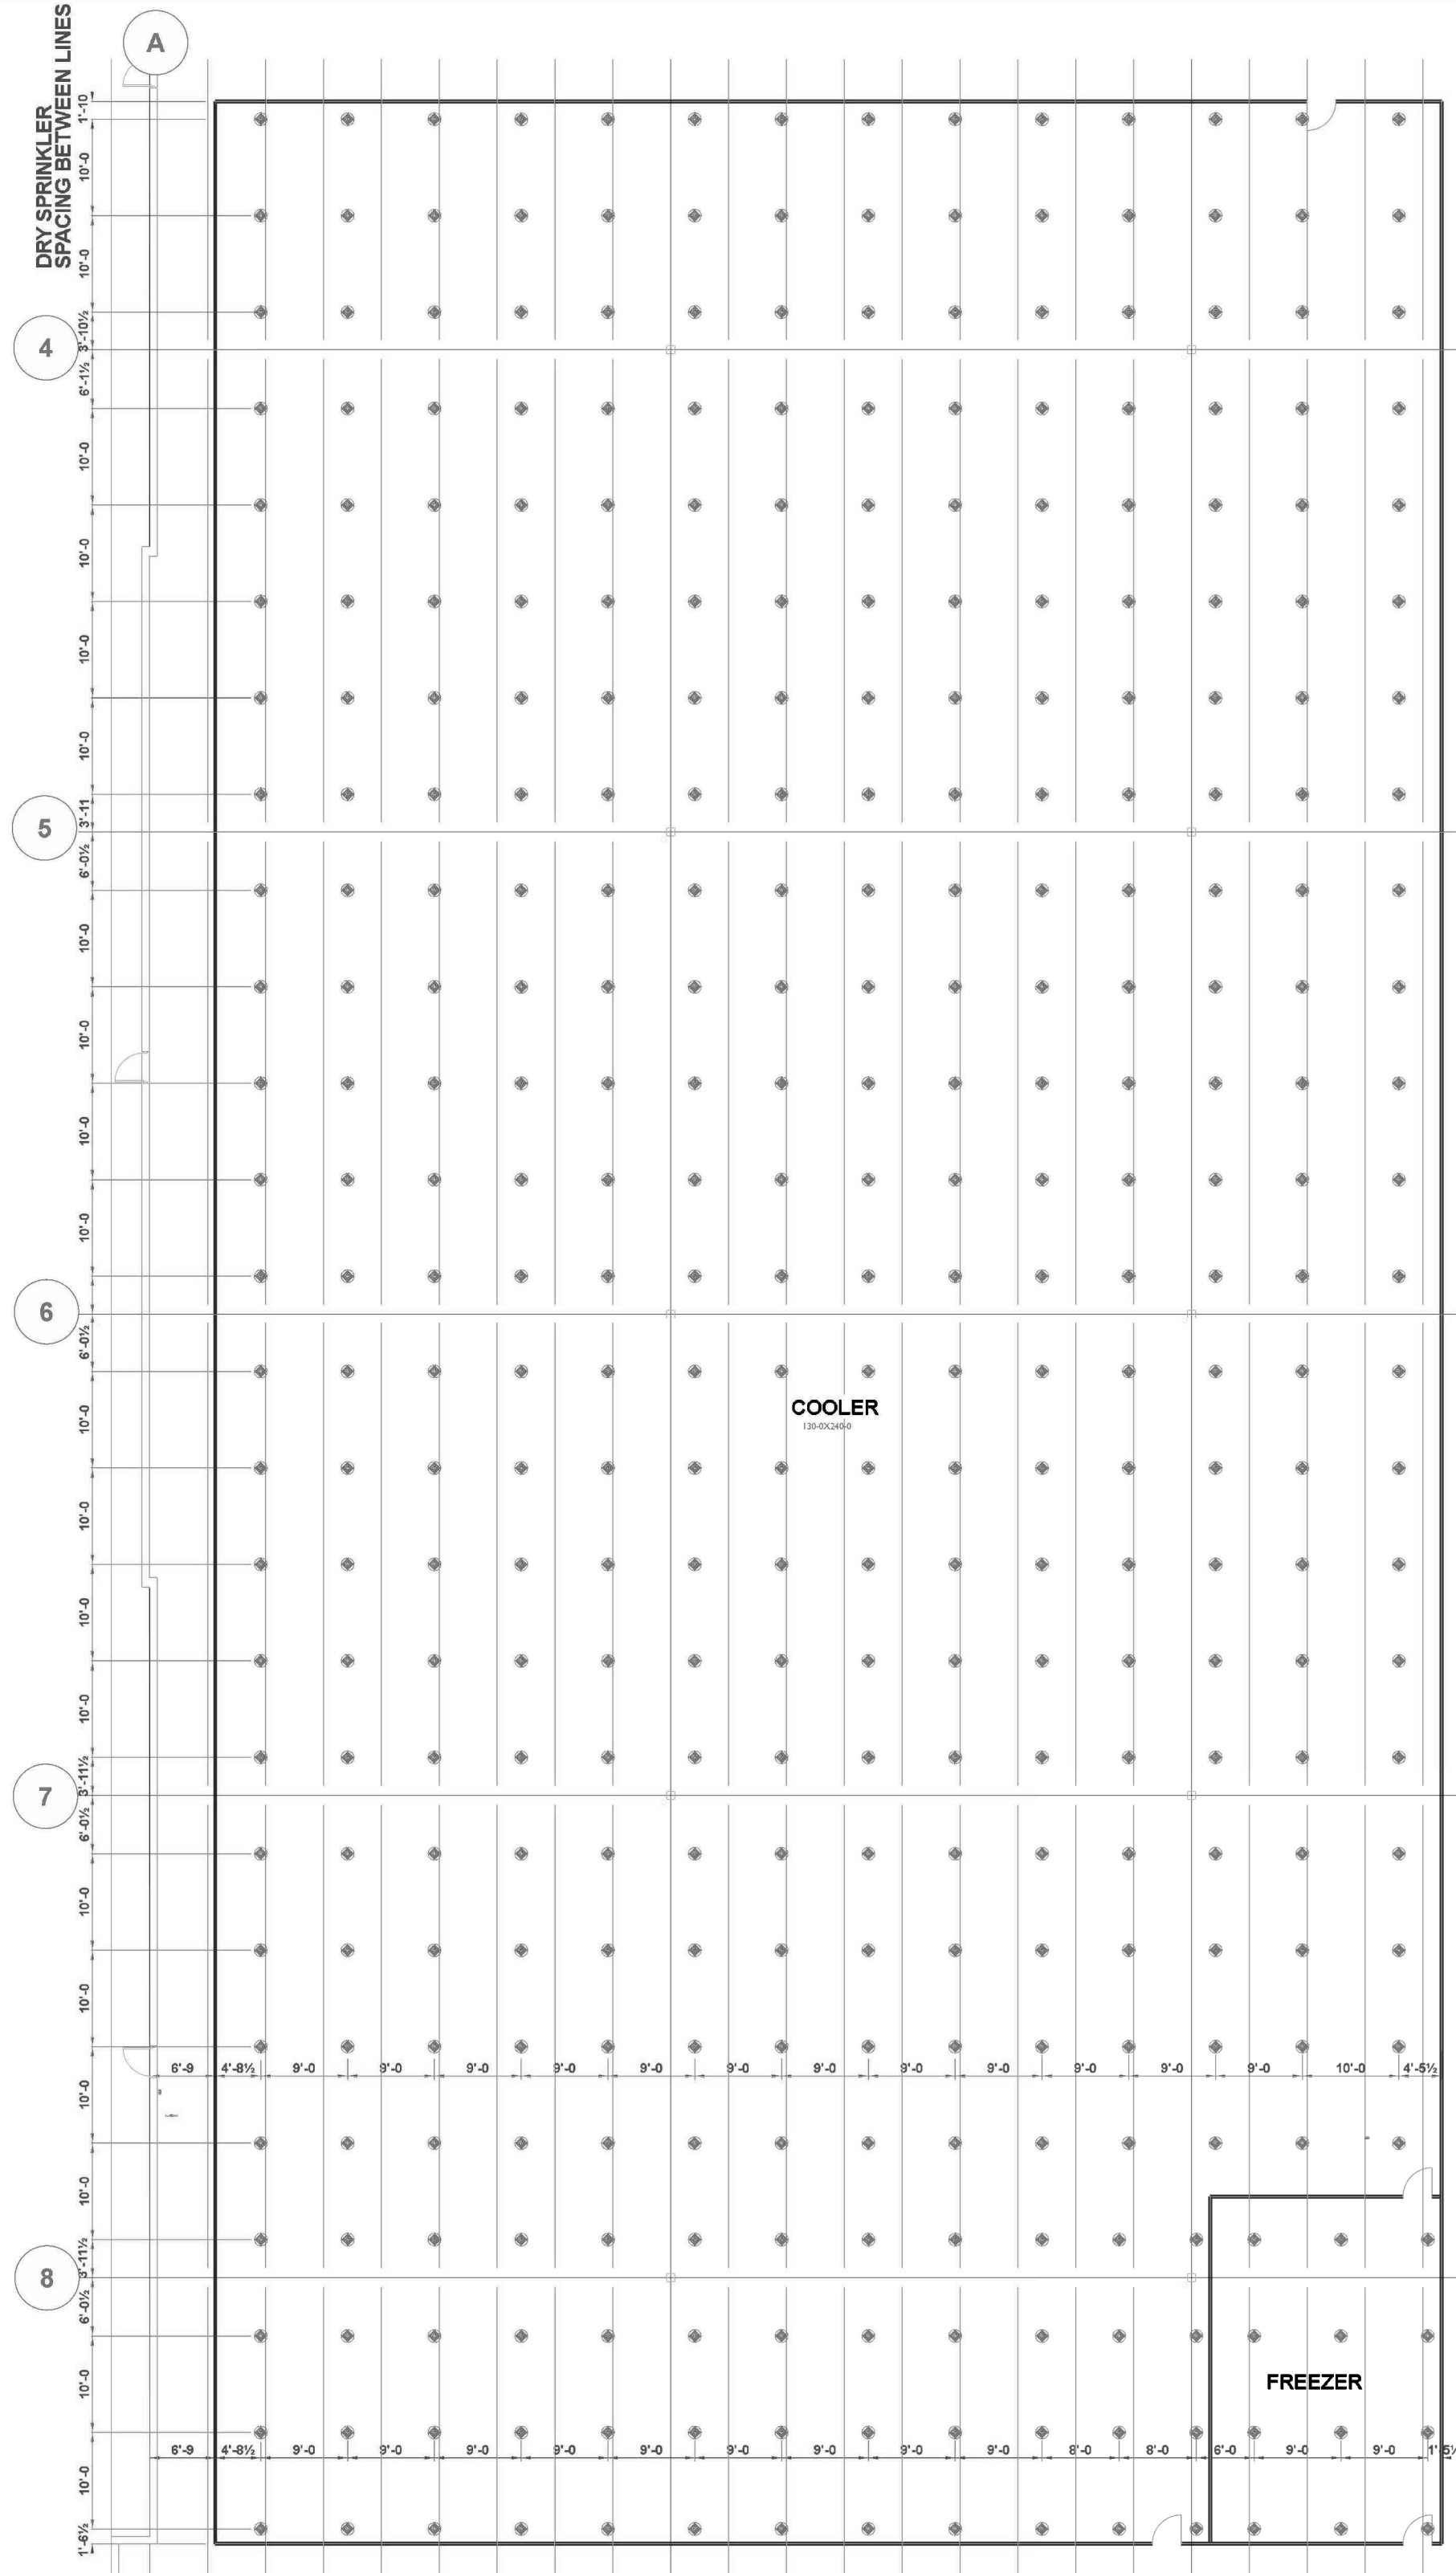

**COOLER/FREEZER LAYOUT**  
SCALE: 1/16" = 1'-0"




Sprinkler Legend											
SYMBOL	MANUFACTURER	SIN	MODEL	QUANTITY	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE	NOTE
	VICTAULIC	V4702	FL-QR/ST/ESFR	2054	16.8	PENDENT	3/4	FAST	BRASS	200°F	
	VICTAULIC	V3406	V34	4	8	PENDENT	3/4	QUICK	BRASS	200°F	
	VICTAULIC	V3428	ESFR	2754	22.4	PENDENT	1	FAST	BRASS	200°F	
	VIKING	VK600	MICROFAST	48	5.6	PENDENT	1/2	QUICK	CHROME	135°F	
	VIKING	VK3021		6	5.6	PENDENT	1/2	QUICK	CHROME	135°F	
	VIKING	VK504	ESFR DRY	368	16.8	PENDENT	3/4	QUICK	BRASS	205°F	
				TOTAL = 5234							

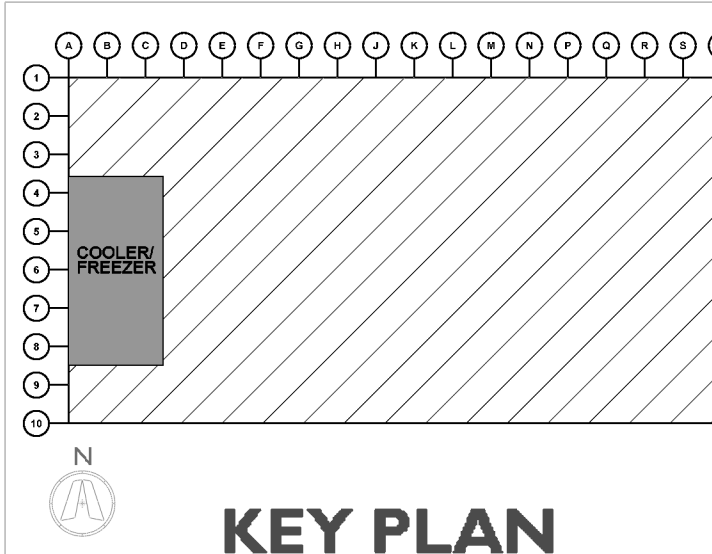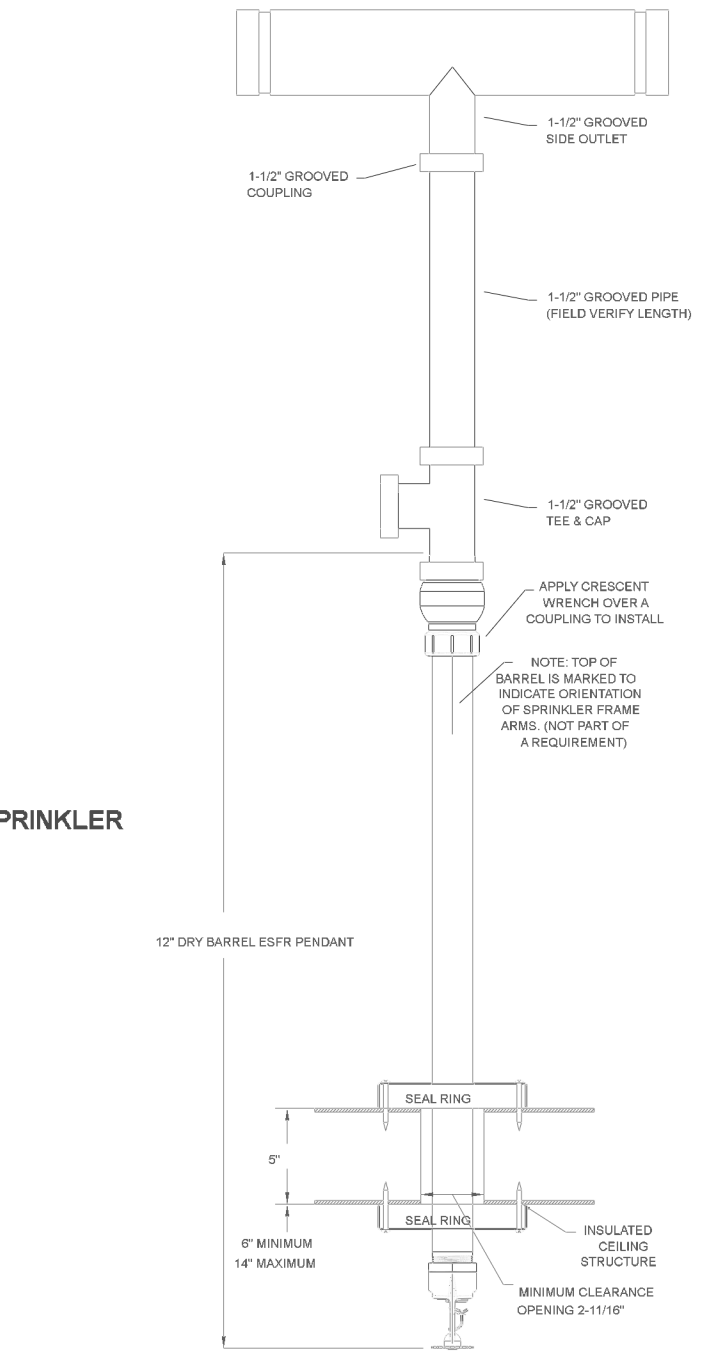





FIRE PUMP ROOM MATERIAL LIST		#
TAG#	MATERIAL CALL OUT	
01	2000 GPM @ 60 PSI 10x8 FIRE PUMP	
02	SPP 100 HP ELECTRIC MOTOR	
03	10" FLG OS&Y GATE VALVE W/ TAMPER (NORMALLY OPEN)	
04	10" BUTTERFLY VALVE W/ TAMPER (NORMALLY OPEN)	
05	8" BUTTERFLY VALVE W/ TAMPER (NORMALLY CLOSED)	
06	10" CHECK VALVE	
07	4" CHECK VALVE	
08	10" UNDERGROUND SUPPLY PIPING	
09	4" FDC PIPING W/ STORZ TYPE CONNECTION	
10	8X2½(6) TEST HEADER	
11	10" WATER DISCHARGE PIPING TO FIRE LOOP	
12	2 HP JOCKEY PUMP ASSEMBLY (15 GPM @ 104 PSI)	
13	ELECTRIC & JOCKEY PUMP CONTROLLERS	
14	10" PIPE STAND	
15	SPARE HEAD BOXES	



### FIRE PUMP & RISER DETAIL