




CONDUIT PER ELECTRICAL DESIGN
CONCRETE SHALL BE 4000 PSI MIN.

CONCRETE LIGHT POLE BASE DETAIL FOR POLE ≤ 15 FOOT

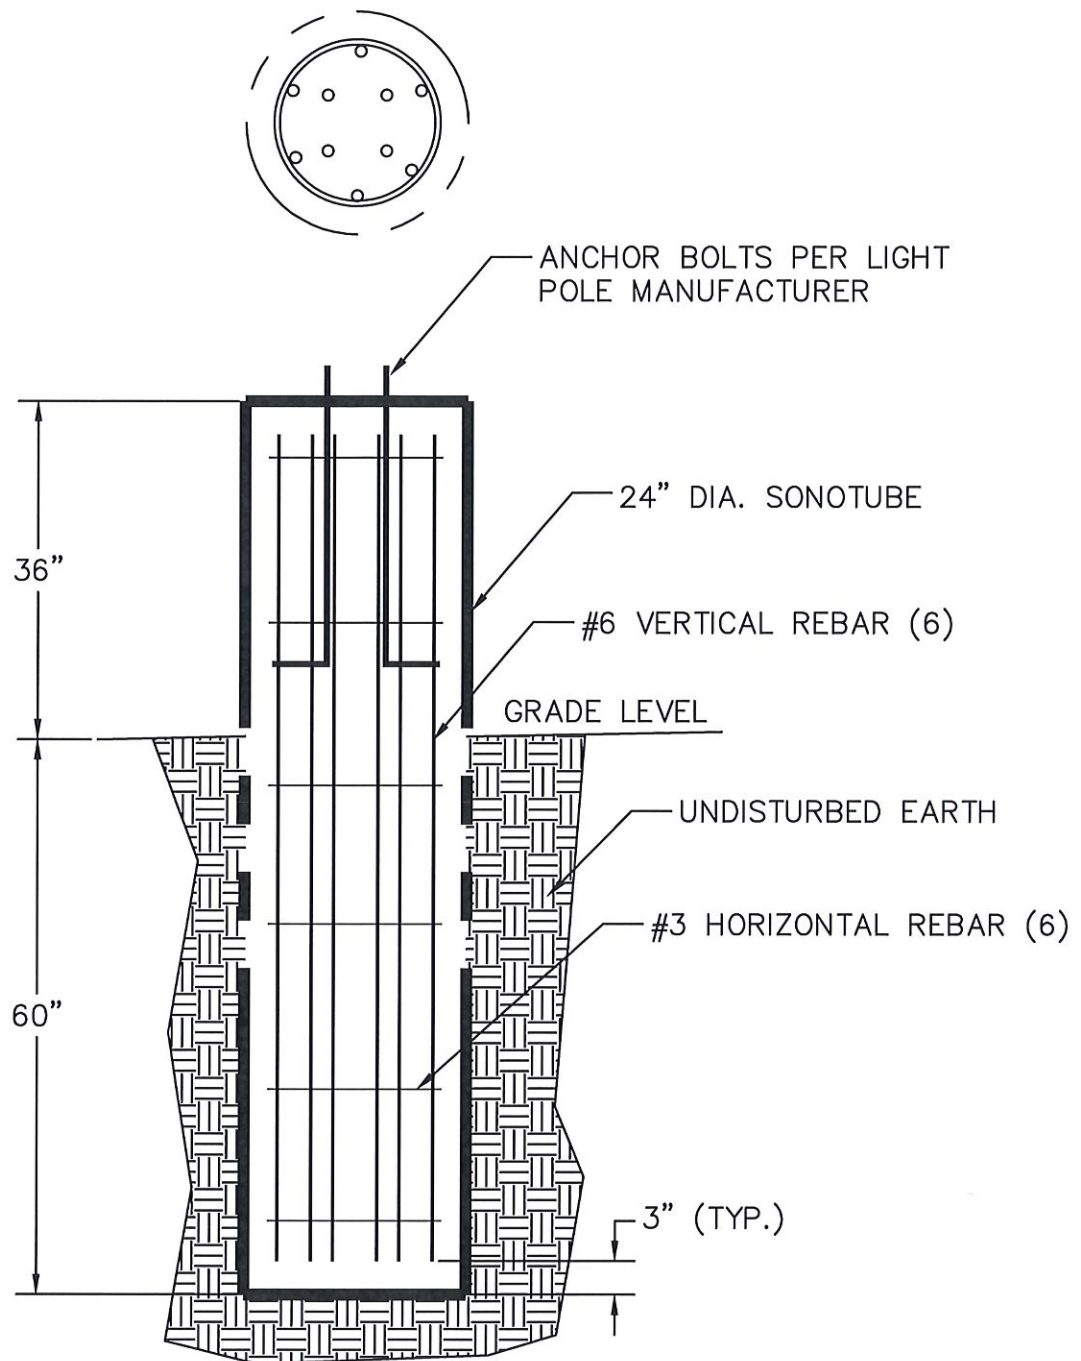

AGC Engineers, INC.

405 S. Leonard St., Suite D
Liberty, Missouri 64068

816.781.4200 ■
fax 792.3666

www.agcengineers.com

SCALE: 1" = N.T.S.

BY	REVISION	DATE
..	..	..
..	..	..
..	..	..
..	..	..
..	..	..
..	..	..

OAKVIEW LOT 4
LEE'S SUMMIT, JACKSON COUNTY, MISSOURI

CONCRETE LIGHT POLE BASE DETAIL

1