


**RELEASED FOR  
CONSTRUCTION**  
As Noted on Plans Review

Development Services Department  
Lee's Summit, Missouri  
12/07/2022

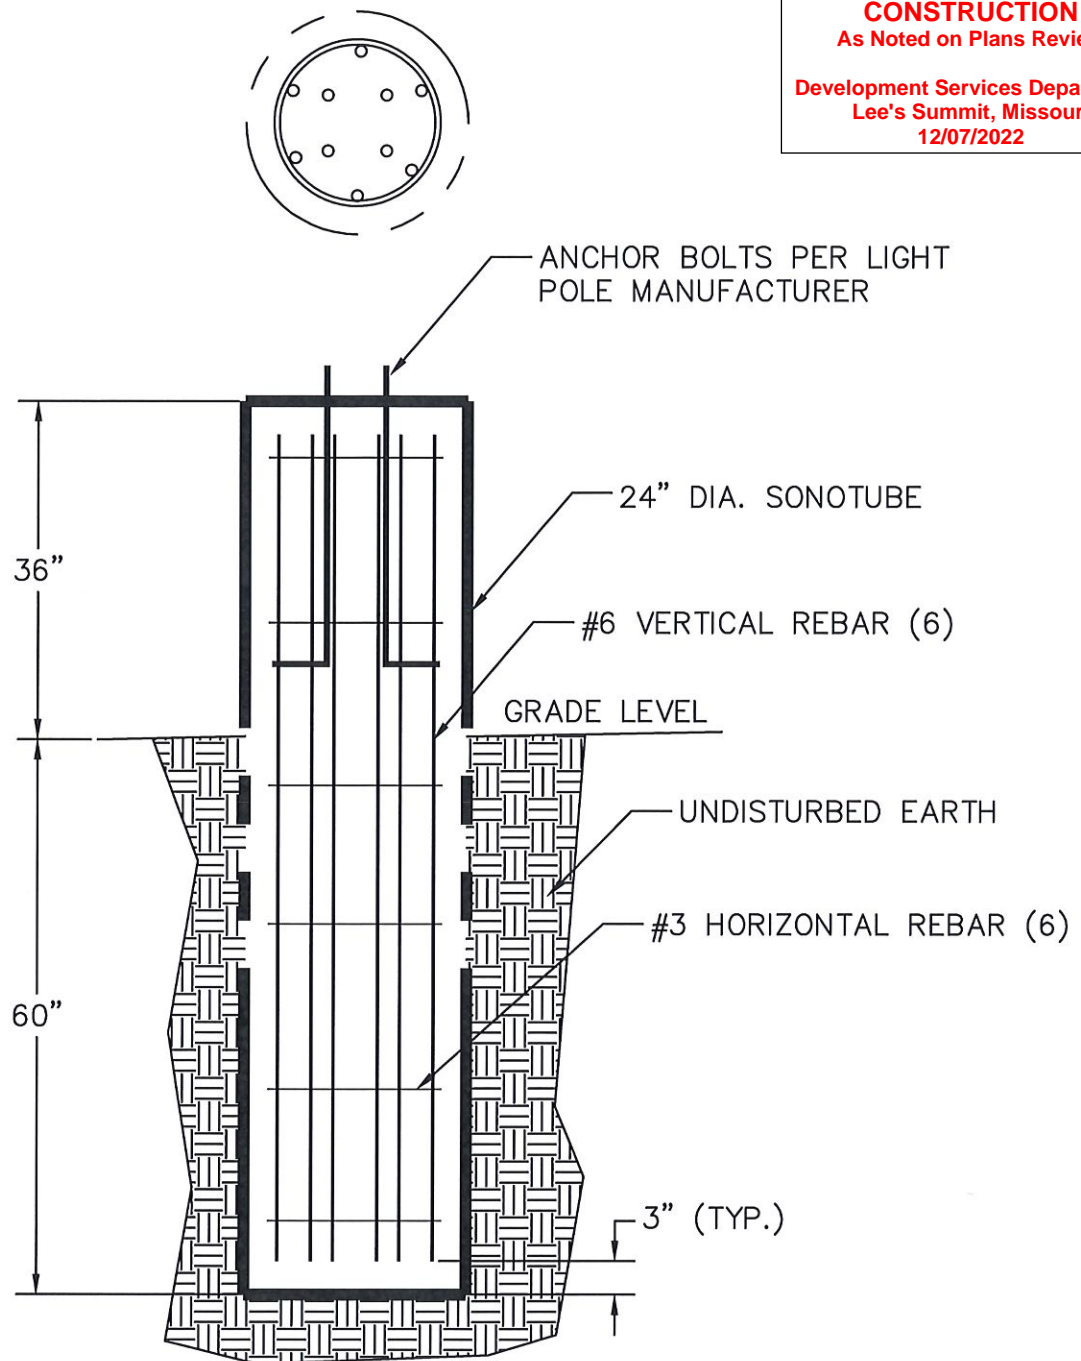

CONDUIT PER ELECTRICAL DESIGN  
CONCRETE SHALL BE 4000 PSI MIN.

**CONCRETE LIGHT POLE BASE DETAIL FOR POLE ≤ 15 FOOT**

RONALD L. GINGER  
NUMBER  
PE-29705  
12-6-22

**AGC Engineers, INC.**

405 S. Leonard St., Suite D  
Liberty, Missouri 64068

816.781.4200 ■  
fax 792.3666

www.agcengineers.com

SCALE: 1" = N.T.S.

| BY | REVISION | DATE |
|----|----------|------|
| .. | ..       | ..   |
| .. | ..       | ..   |
| .. | ..       | ..   |
| .. | ..       | ..   |
| .. | ..       | ..   |
| .. | ..       | ..   |

**OAKVIEW LOT 4**  
**LEE'S SUMMIT, JACKSON COUNTY, MISSOURI**

**CONCRETE LIGHT POLE BASE DETAIL**

1