



MiTek USA, Inc.
16023 Swingley Ridge Rd
Chesterfield, MO 63017
314-434-1200

Re: 220004
Lot 2 OS

The truss drawing(s) referenced below have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Wheeler - Waverly.

Pages or sheets covered by this seal: I55083718 thru I55083718

My license renewal date for the state of Missouri is December 31, 2023.

Missouri COA: Engineering 001193



November 4, 2022

Sevier, Scott ,Engineer

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	Lot 2 OS	UNITS 1 AH 1 OF 1	I55083718
220004	A1	Roof Special Supported Gable	4	1	Job Reference (optional)		


Wheeler Lumber, Waverly, KS - 66871,

Run: 8.43 S Jan 6 2022 Print: 8.430 S Jan 6 2022 MiTek Industries, Inc. Thu Nov 03 14:06:33

Page: 1

ID:q6SPGwyY2XfiPIHfSAmEnyz6Qwt-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f

REPAIR:
MEMBER 29-38 SPLIT FULL LENGTH OF MEMBER
MEMBER 30-37 SPLIT FULL LENGTH OF MEMBER

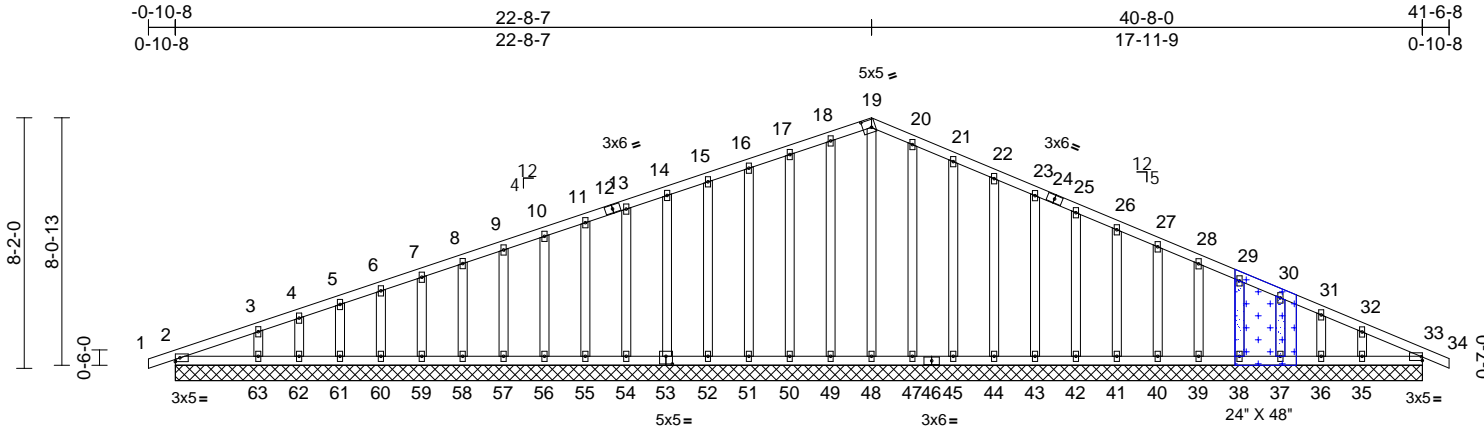

INSTALL 2 X 4 SPF NO.2
CUT TO FIT TIGHT.



ATTACH 1/2" PLYWOOD OR OSB GUSSET (15/32" RATED SHEATHING 32/16 EXP 1) TO ONE FACE OF TRUSS WITH (0.113" X 2") NAILS PER THE FOLLOWING NAIL SCHEDULE: 2 X 3'S - 2 ROWS, 2 X 4'S - 3 ROWS, 2 X 6'S AND LARGER - 4 ROWS: SPACED @ 2" O.C. INTO EACH COVERED TRUSS MEMBER. USE 2" MEMBER END DISTANCE.

Scale = 1:75.1

40-8-0

Plate Offsets (X, Y): [19:0-3-7,0-3-0], [53:0-2-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.06	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(CT)	n/a	-	n/a	999	197/144
BCLL	0.0*	Rep Stress Incr	YES	WB	0.12	Horz(CT)	0.01	33	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 228 lb FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 2=40-8-0, 33=40-8-0, 35=40-8-0, 36=40-8-0, 37=40-8-0, 38=40-8-0, 39=40-8-0, 40=40-8-0, 41=40-8-0, 42=40-8-0, 43=40-8-0, 44=40-8-0, 45=40-8-0, 47=40-8-0, 48=40-8-0, 49=40-8-0, 50=40-8-0, 51=40-8-0, 52=40-8-0, 53=40-8-0, 54=40-8-0, 55=40-8-0, 56=40-8-0, 57=40-8-0, 58=40-8-0, 59=40-8-0, 60=40-8-0, 61=40-8-0, 62=40-8-0, 63=40-8-0

Max Horiz 2=139 (LC 8)

Max Uplift 2=-19 (LC 9), 33=-9 (LC 5), 35=-57 (LC 9), 36=-28 (LC 9), 37=-32 (LC 9), 38=-32 (LC 9), 39=-32 (LC 9), 40=-32 (LC 9), 41=-32 (LC 9), 42=-32 (LC 9), 43=-32 (LC 9), 44=-32 (LC 9), 45=-38 (LC 9), 47=-18 (LC 9), 49=-19 (LC 8), 50=-33 (LC 4), 51=-28 (LC 4), 52=-28 (LC 8), 53=-28 (LC 4), 54=-29 (LC 8), 55=-28 (LC 4), 56=-28 (LC 4), 57=-28 (LC 8), 58=-28 (LC 4), 59=-28 (LC 8), 60=-28 (LC 4), 61=-30 (LC 8), 62=-22 (LC 4), 63=-65 (LC 8)

Max Grav 2=176 (LC 1), 33=154 (LC 1), 35=156 (LC 22), 36=108 (LC 22), 37=123 (LC 1), 38=119 (LC 22), 39=120 (LC 1), 40=120 (LC 1), 41=120 (LC 1), 42=120 (LC 22), 43=120 (LC 1), 44=120 (LC 1), 45=121 (LC 22), 47=124 (LC 22), 48=140 (LC 18), 49=124 (LC 21), 50=121 (LC 21), 51=120 (LC 1), 52=121 (LC 1), 53=120 (LC 1), 54=119 (LC 21), 55=120 (LC 1), 56=120 (LC 21), 57=120 (LC 21), 58=120 (LC 1), 59=120 (LC 1), 60=118 (LC 21), 61=130 (LC 1), 62=76 (LC 21), 63=226 (LC 21)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/6, 2-3=-166/72, 3-4=-122/71, 4-5=-107/78, 5-6=-89/83, 6-7=-75/92, 7-8=-61/103, 8-9=-48/114, 9-10=-38/124, 10-11=-28/135, 11-13=-20/146, 13-14=-20/157, 14-15=-21/168, 15-16=-21/179, 16-17=-21/190, 17-18=-21/202, 18-19=-22/208, 19-20=-25/208, 20-21=-24/188, 21-22=-24/162, 22-23=-24/137, 23-25=-24/113, 25-26=-24/90, 26-27=-24/74, 27-28=-24/58, 28-29=-24/43, 29-30=-31/29, 30-31=-44/23, 31-32=-64/16, 32-33=-109/28, 33-34=0/6

BOT CHORD 2-63=-10/117, 62-63=-10/117, 61-62=-10/117, 60-61=-10/117, 59-60=-10/117, 58-59=-10/117, 57-58=-10/117, 56-57=-10/117, 55-56=-10/117, 54-55=-10/117, 52-54=-10/117, 51-52=-10/117, 50-51=-10/117, 49-50=-10/117, 48-49=-10/117, 47-48=-10/117, 45-47=-10/117, 44-45=-10/117, 43-44=-10/117, 42-43=-10/117, 41-42=-10/117, 40-41=-10/117, 39-40=-10/117, 38-39=-10/117, 37-38=-10/117, 36-37=-10/117, 35-36=-10/117, 33-35=-10/117



November 4, 2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 2 OS
220004	A1	Roof Special Supported Gable	4	1	I55083718
					Job Reference (optional)

WEBS

19-48=-114/0, 18-49=-97/35, 17-50=-94/49,
16-51=-93/44, 15-52=-93/45, 14-53=-94/44,
13-54=-93/45, 11-55=-93/44, 10-56=-93/44,
9-57=-93/44, 8-58=-93/44, 7-59=-93/45,
6-60=-92/44, 5-61=-99/47, 4-62=-64/32,
3-63=-167/91, 20-47=-97/34, 21-45=-94/54,
22-44=-93/48, 23-43=-93/48, 25-42=-93/48,
26-41=-93/48, 27-40=-93/48, 28-39=-93/48,
29-38=-93/48, 30-37=-95/49, 31-36=-86/43,
32-35=-118/77

- NOTES

1) Unbalanced roof live loads have been considered for this design.

2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60

3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.

4) All plates are 2x4 MT20 unless otherwise indicated.

5) Gable requires continuous bottom chord bearing.

6) Gable studs spaced at 1-4-0 oc.

7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.


9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 19 lb uplift at joint 2, 9 lb uplift at joint 33, 19 lb uplift at joint 49, 33 lb uplift at joint 50, 28 lb uplift at joint 51, 28 lb uplift at joint 52, 28 lb uplift at joint 53, 29 lb uplift at joint 54, 28 lb uplift at joint 55, 28 lb uplift at joint 56, 28 lb uplift at joint 57, 28 lb uplift at joint 58, 28 lb uplift at joint 59, 28 lb uplift at joint 60, 30 lb uplift at joint 61, 22 lb uplift at joint 62, 65 lb uplift at joint 63, 18 lb uplift at joint 47, 38 lb uplift at joint 45, 32 lb uplift at joint 44, 32 lb uplift at joint 43, 32 lb uplift at joint 42, 32 lb uplift at joint 41, 32 lb uplift at joint 40, 32 lb uplift at joint 39, 32 lb uplift at joint 38, 32 lb uplift at joint 37, 28 lb uplift at joint 36 and 57 lb uplift at joint 35.

10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


LOAD CASE(S)
Standard

Symbols

PLATE LOCATION AND ORIENTATION

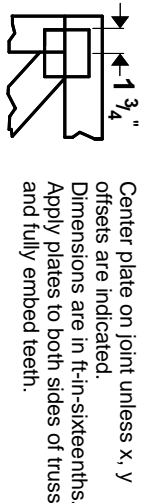

0- $\frac{1}{16}$ "

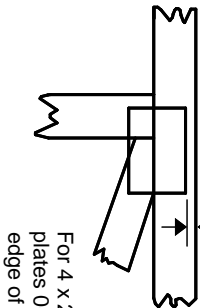

For 4 x 2 orientation, locate plates 0- $\frac{1}{16}$ " from outside edge of truss.

—
—
This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MiTek 20/20** software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

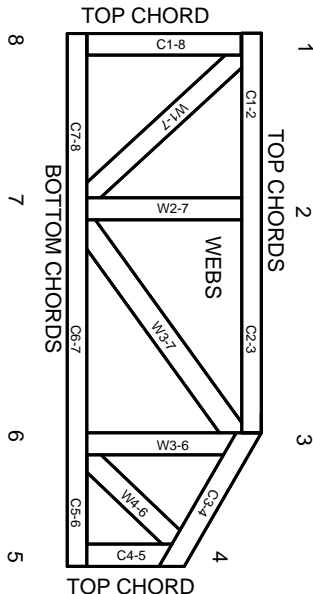

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MiTek® All Rights Reserved



MiTek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.