



**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

CERTIFICATION

THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY  
OF CURRAN ARCHITECTURE, AND ARE NOT  
TO BE USED OR REPRODUCED, WHOLE OR  
IN PART, WITHOUT THE WRITTEN  
CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I


NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES








PERMIT SET 04.21.22

210300

M1.4

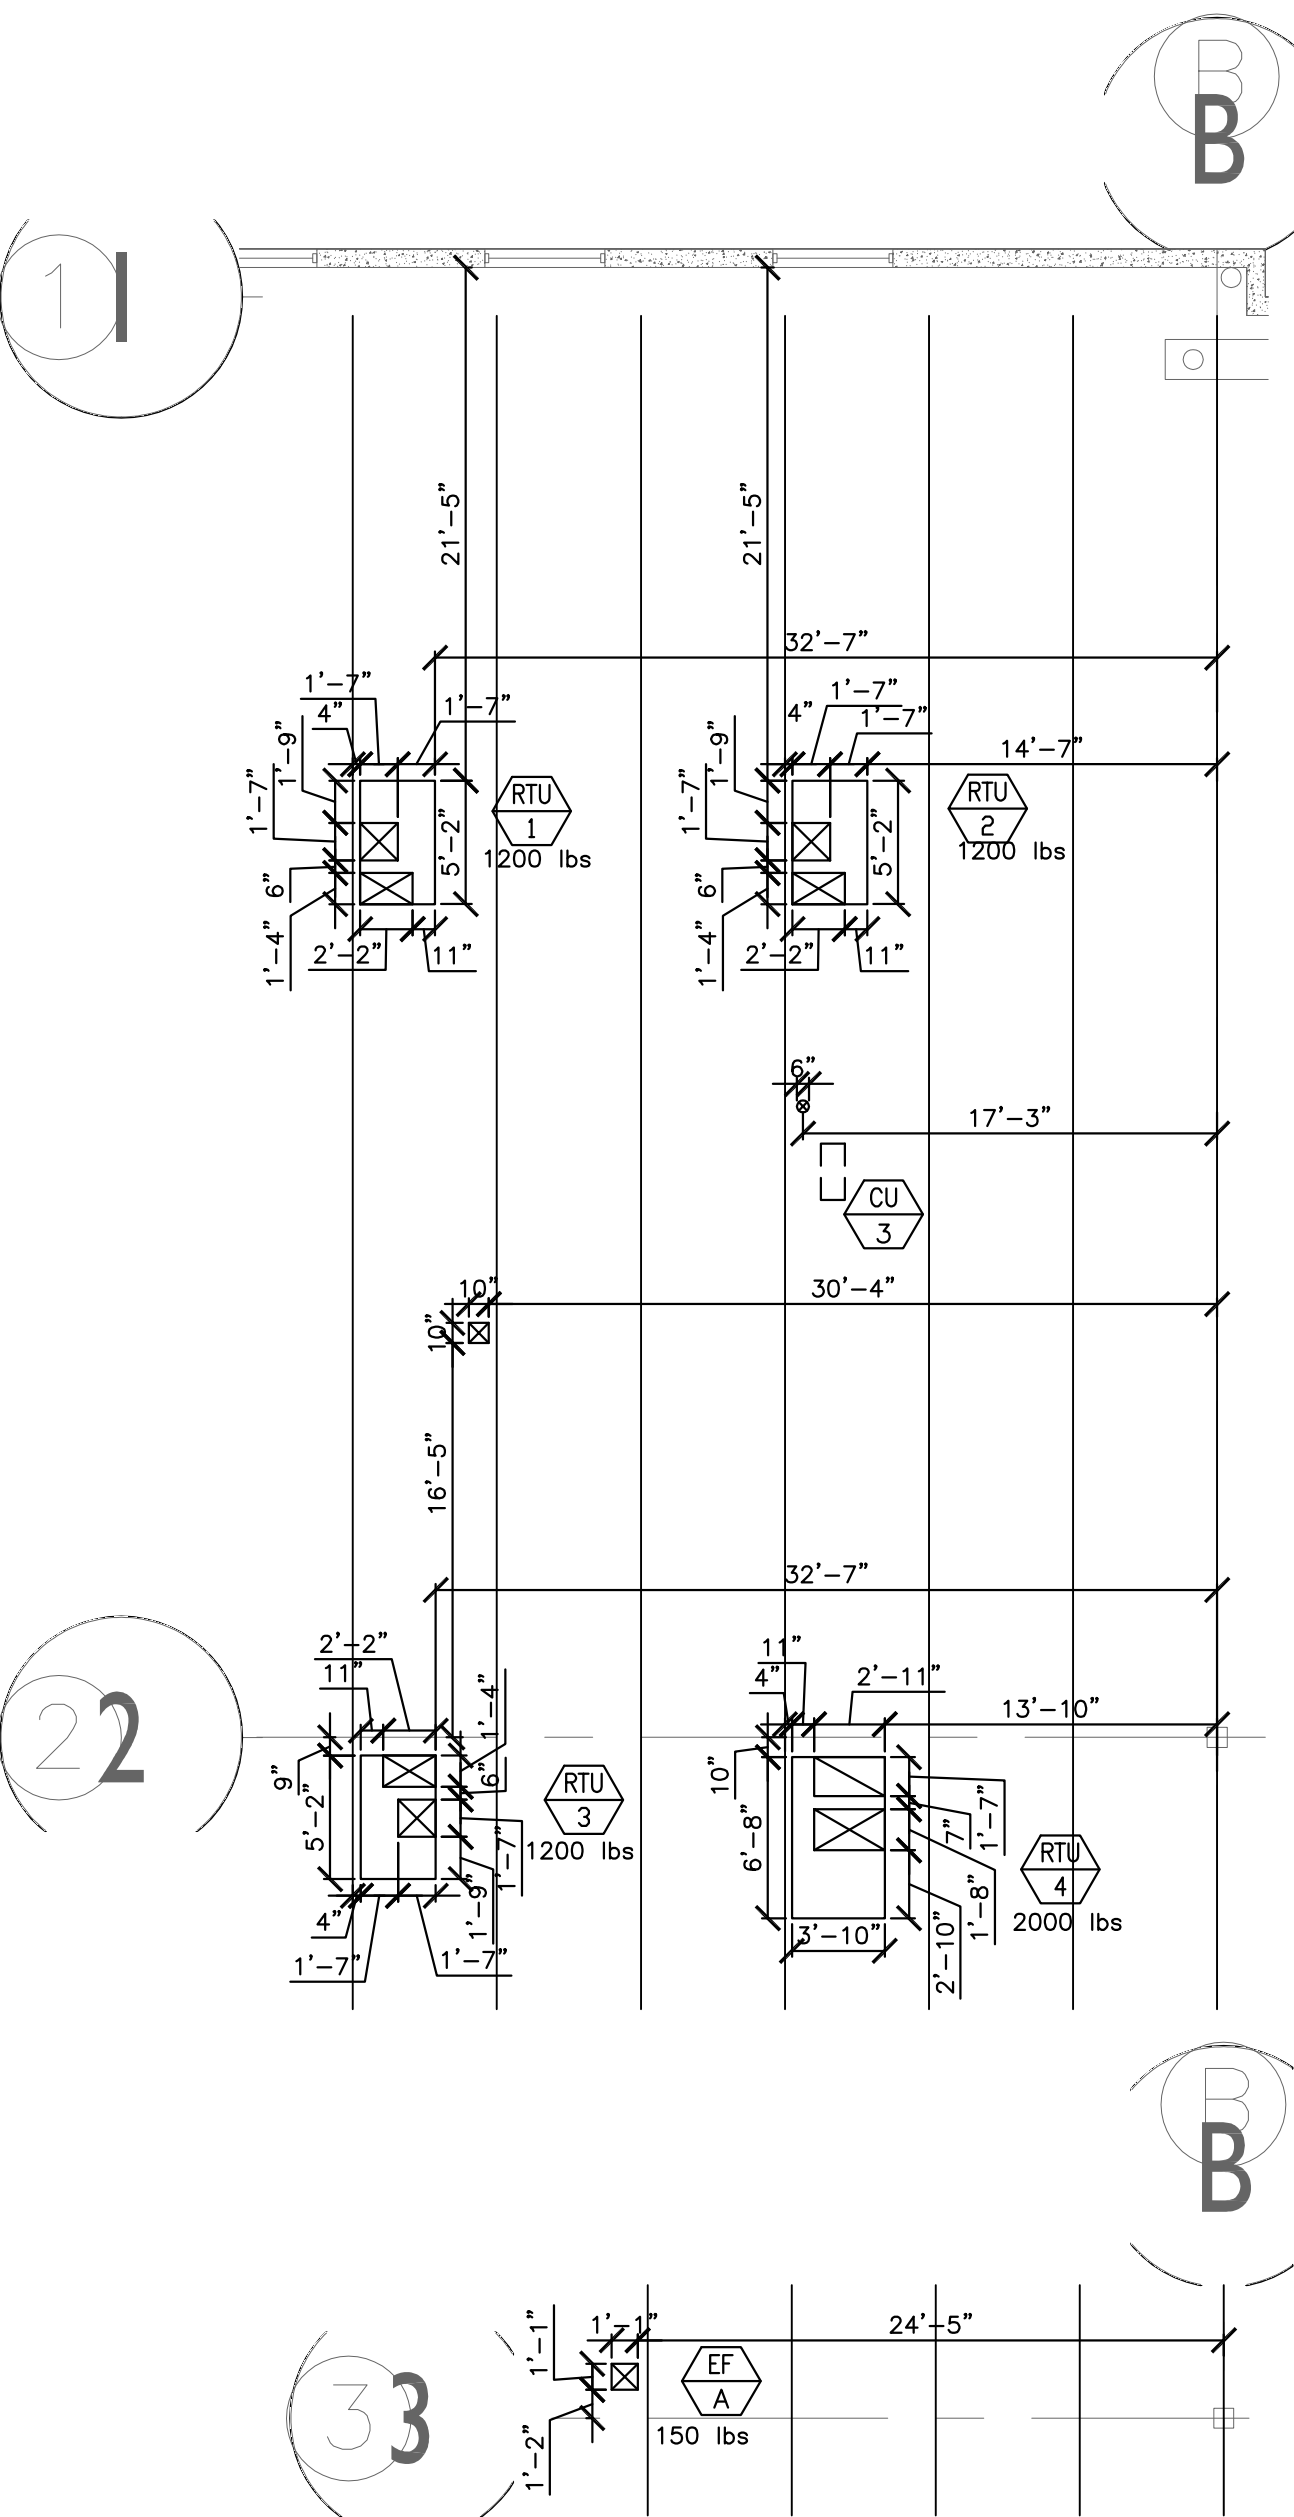

**1** ROOF DETAIL  
scale: 1/8" = 1'-0"

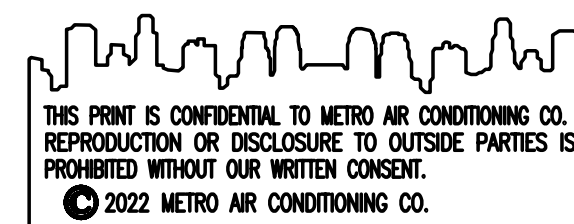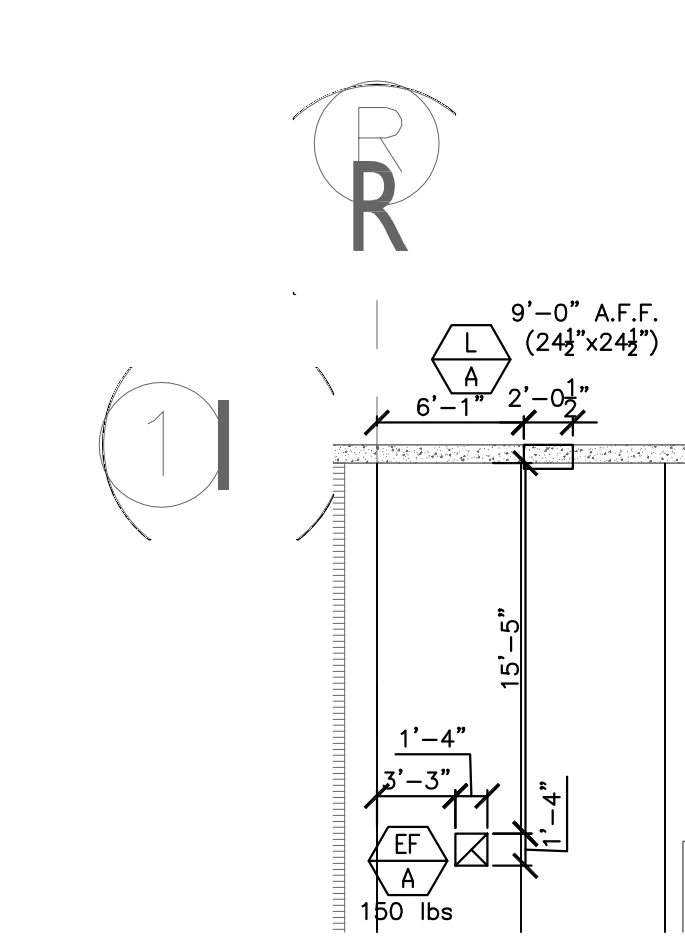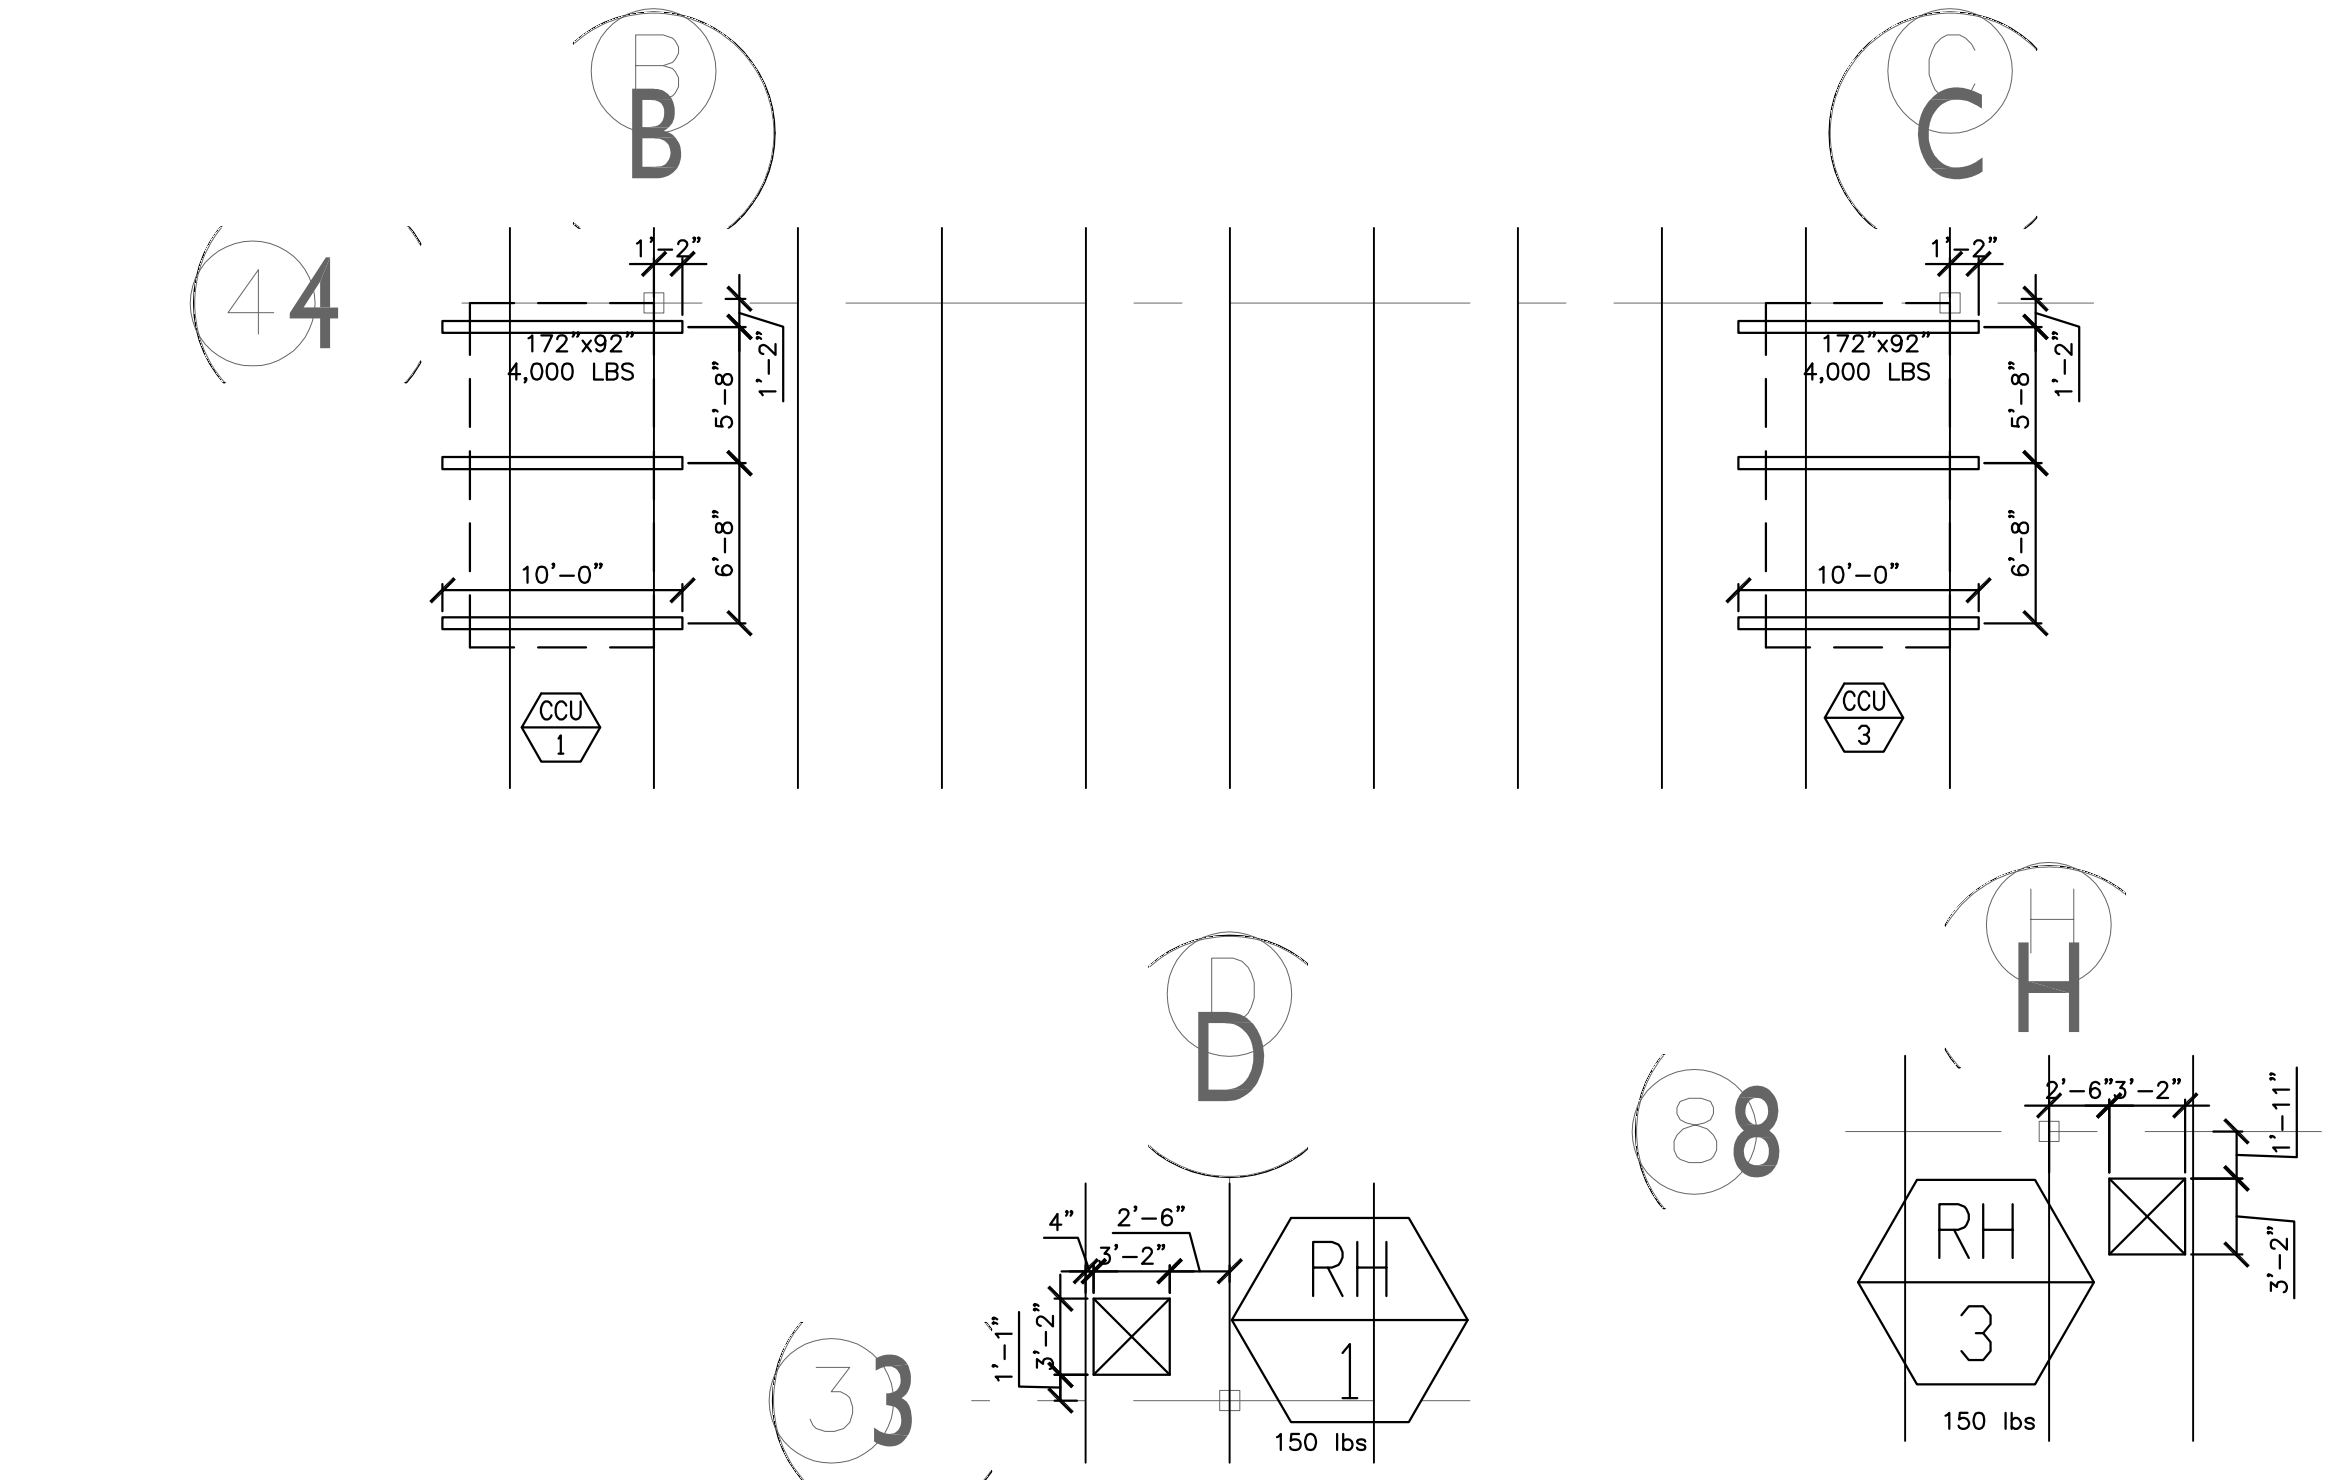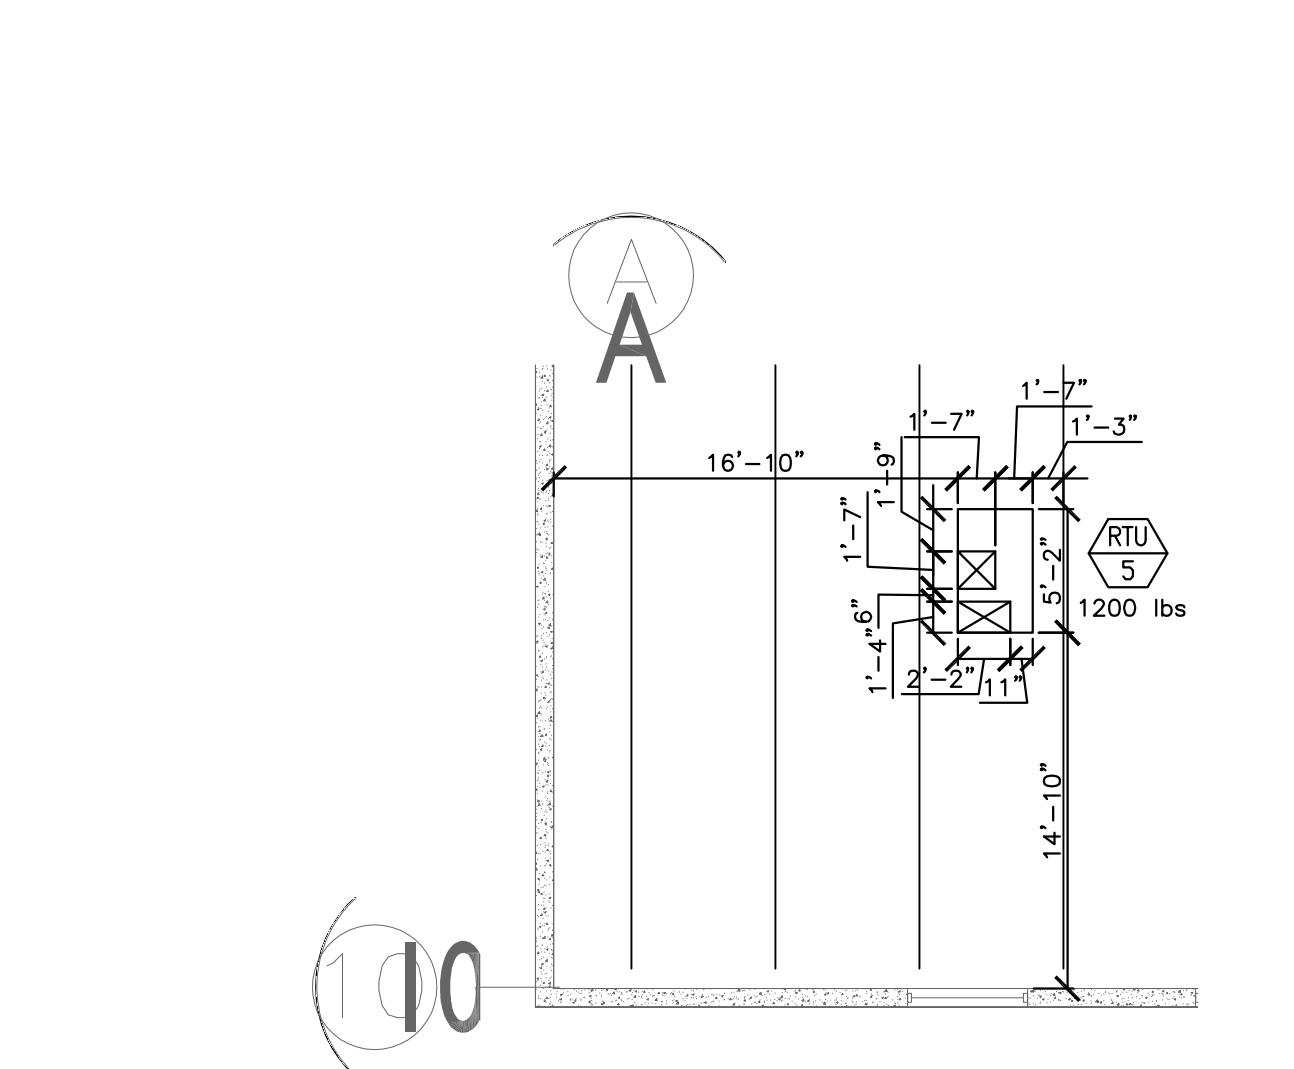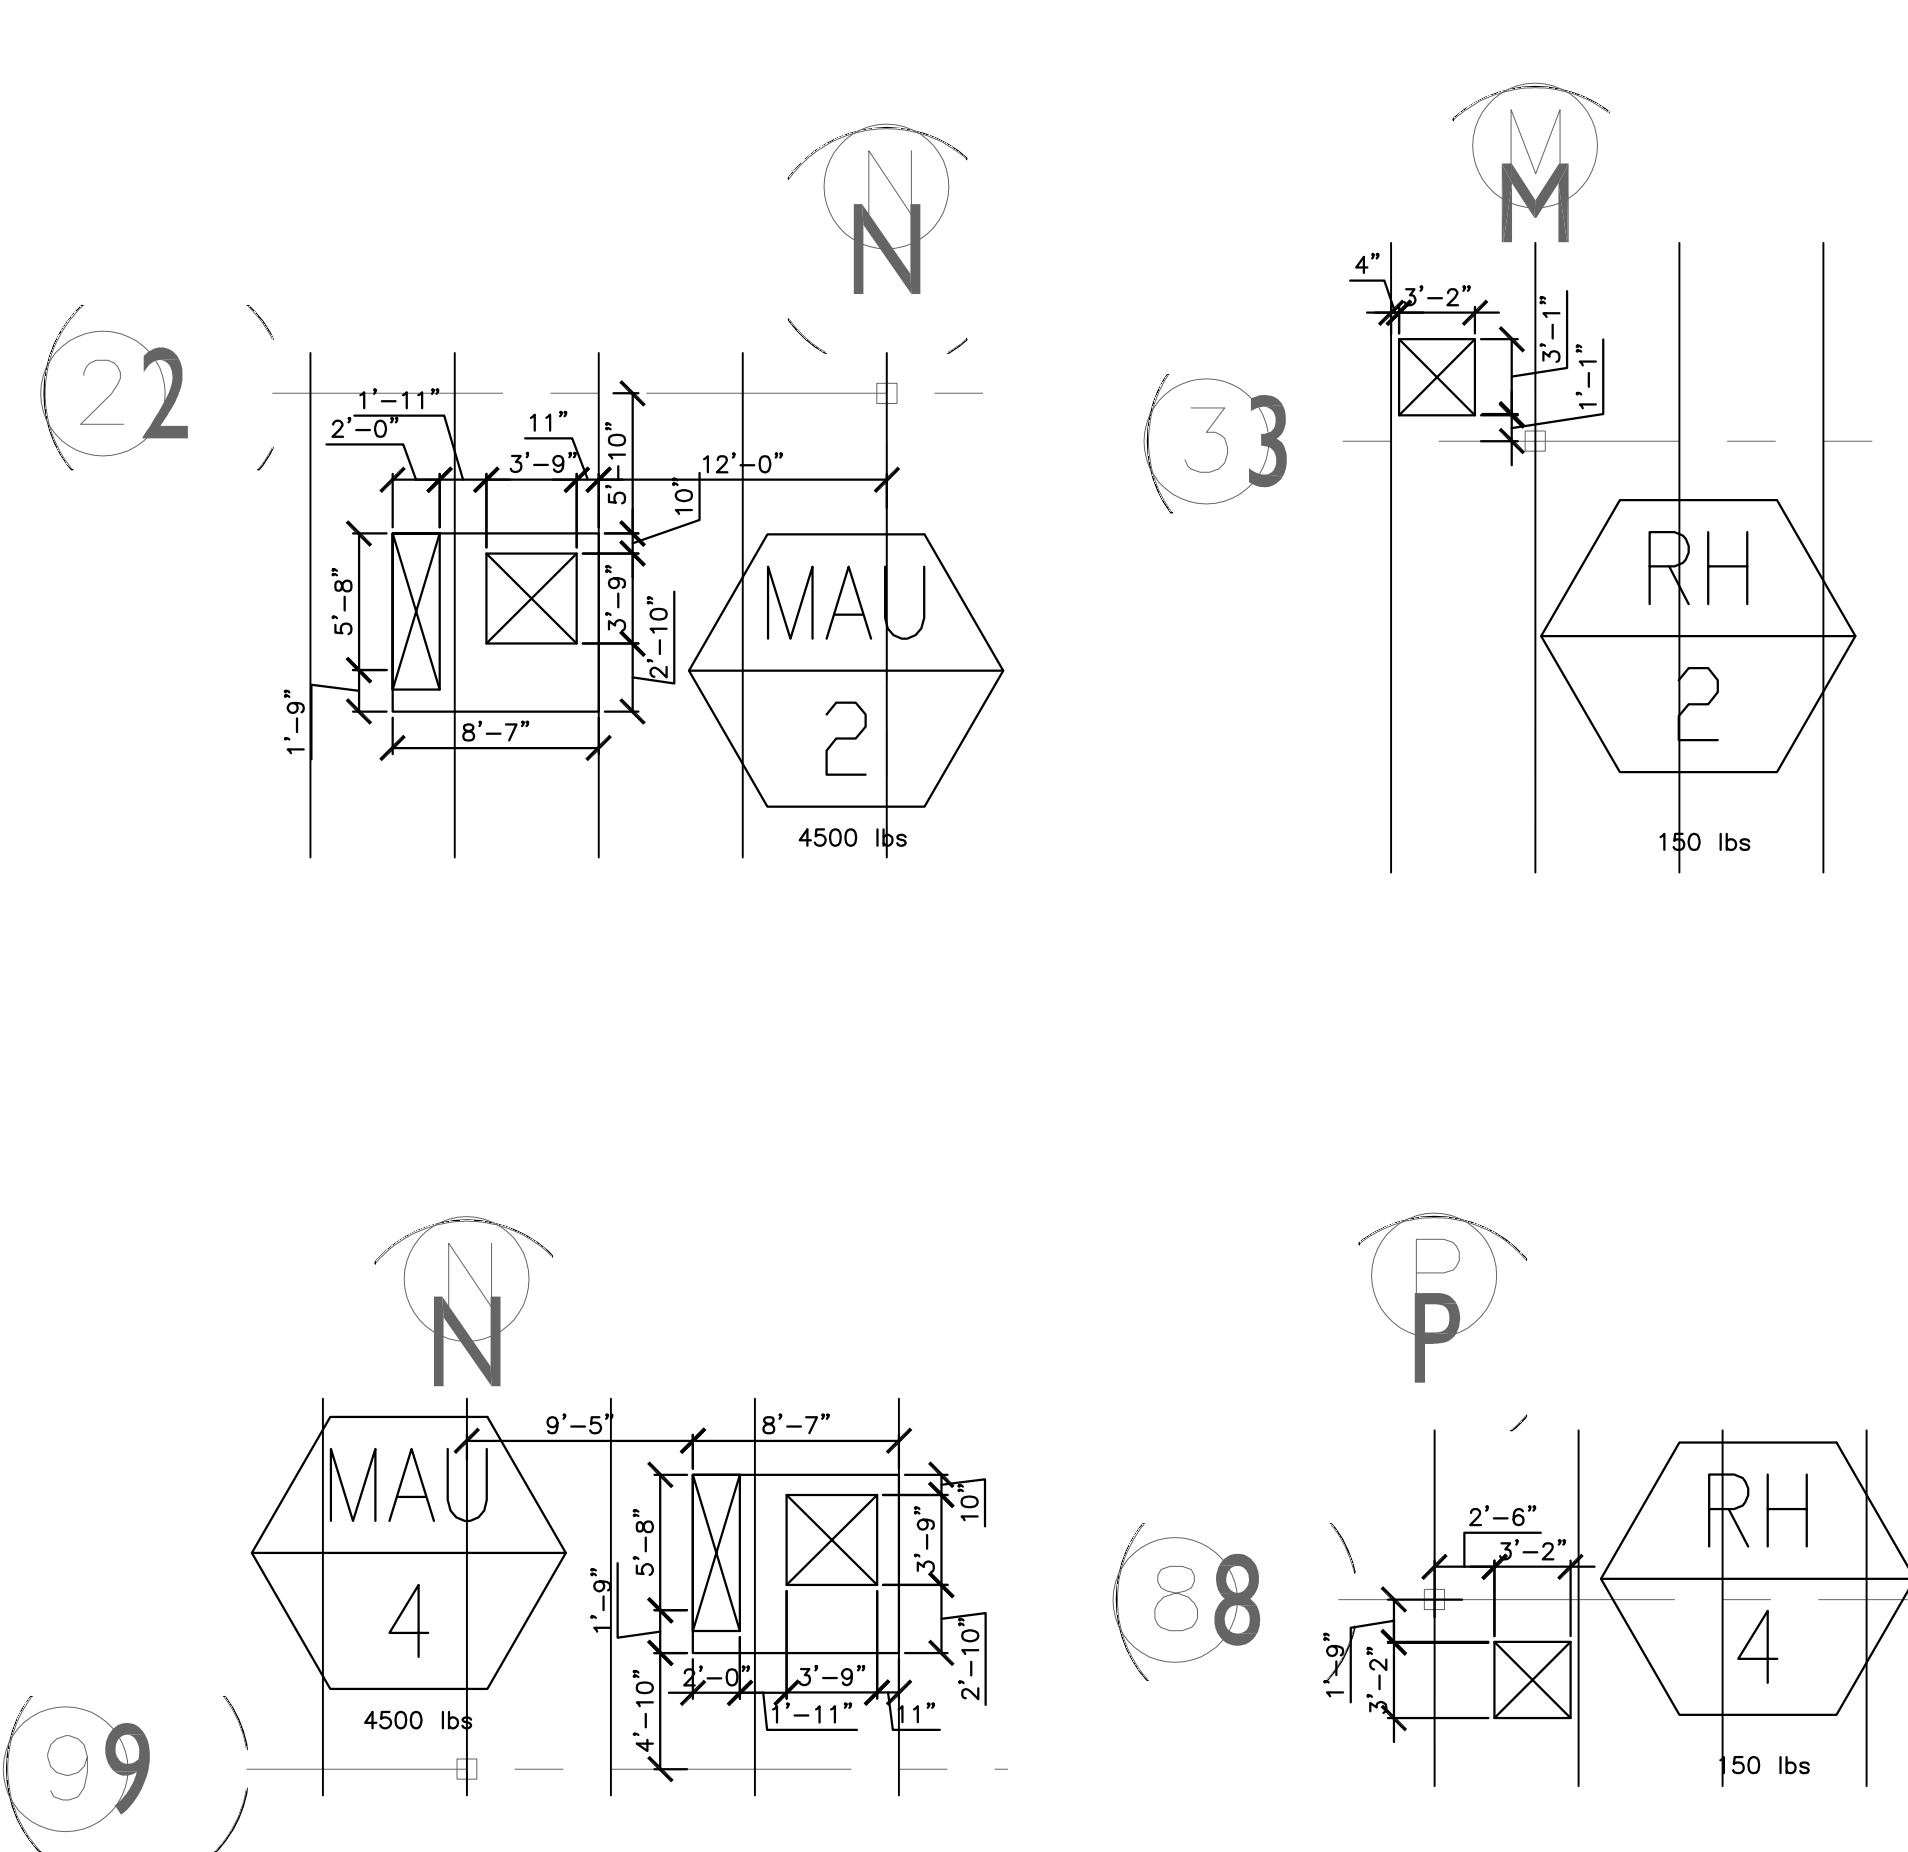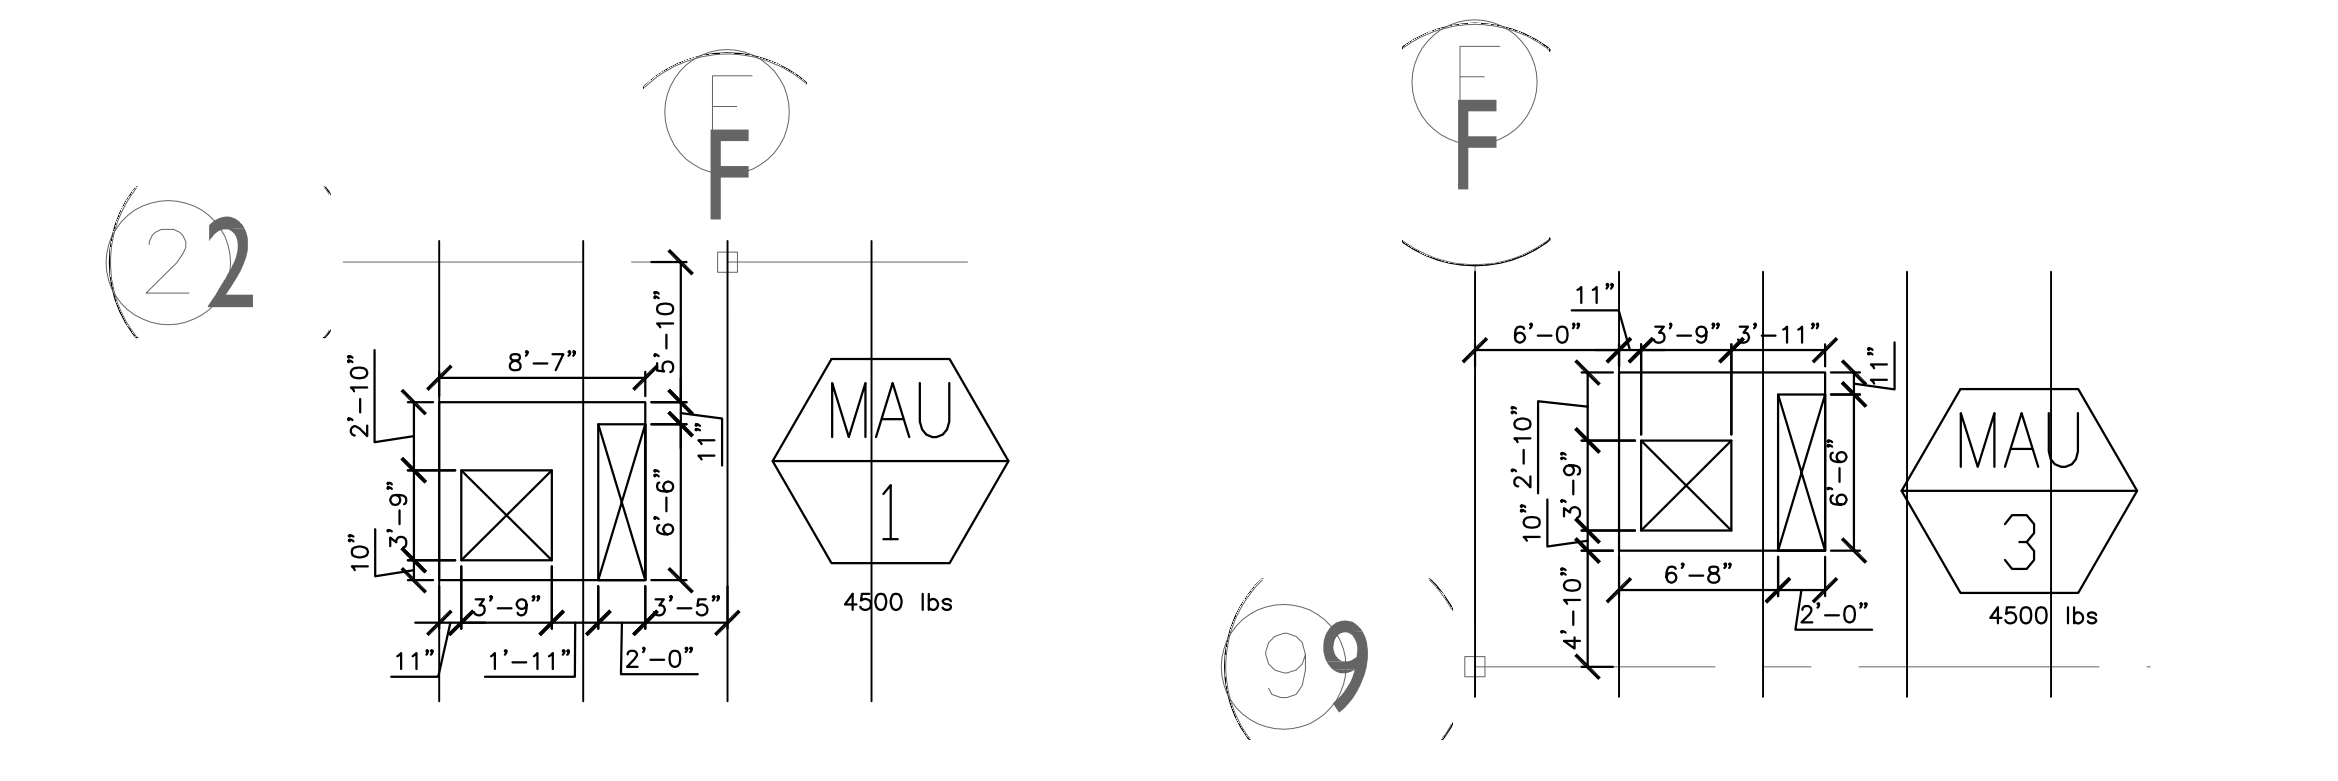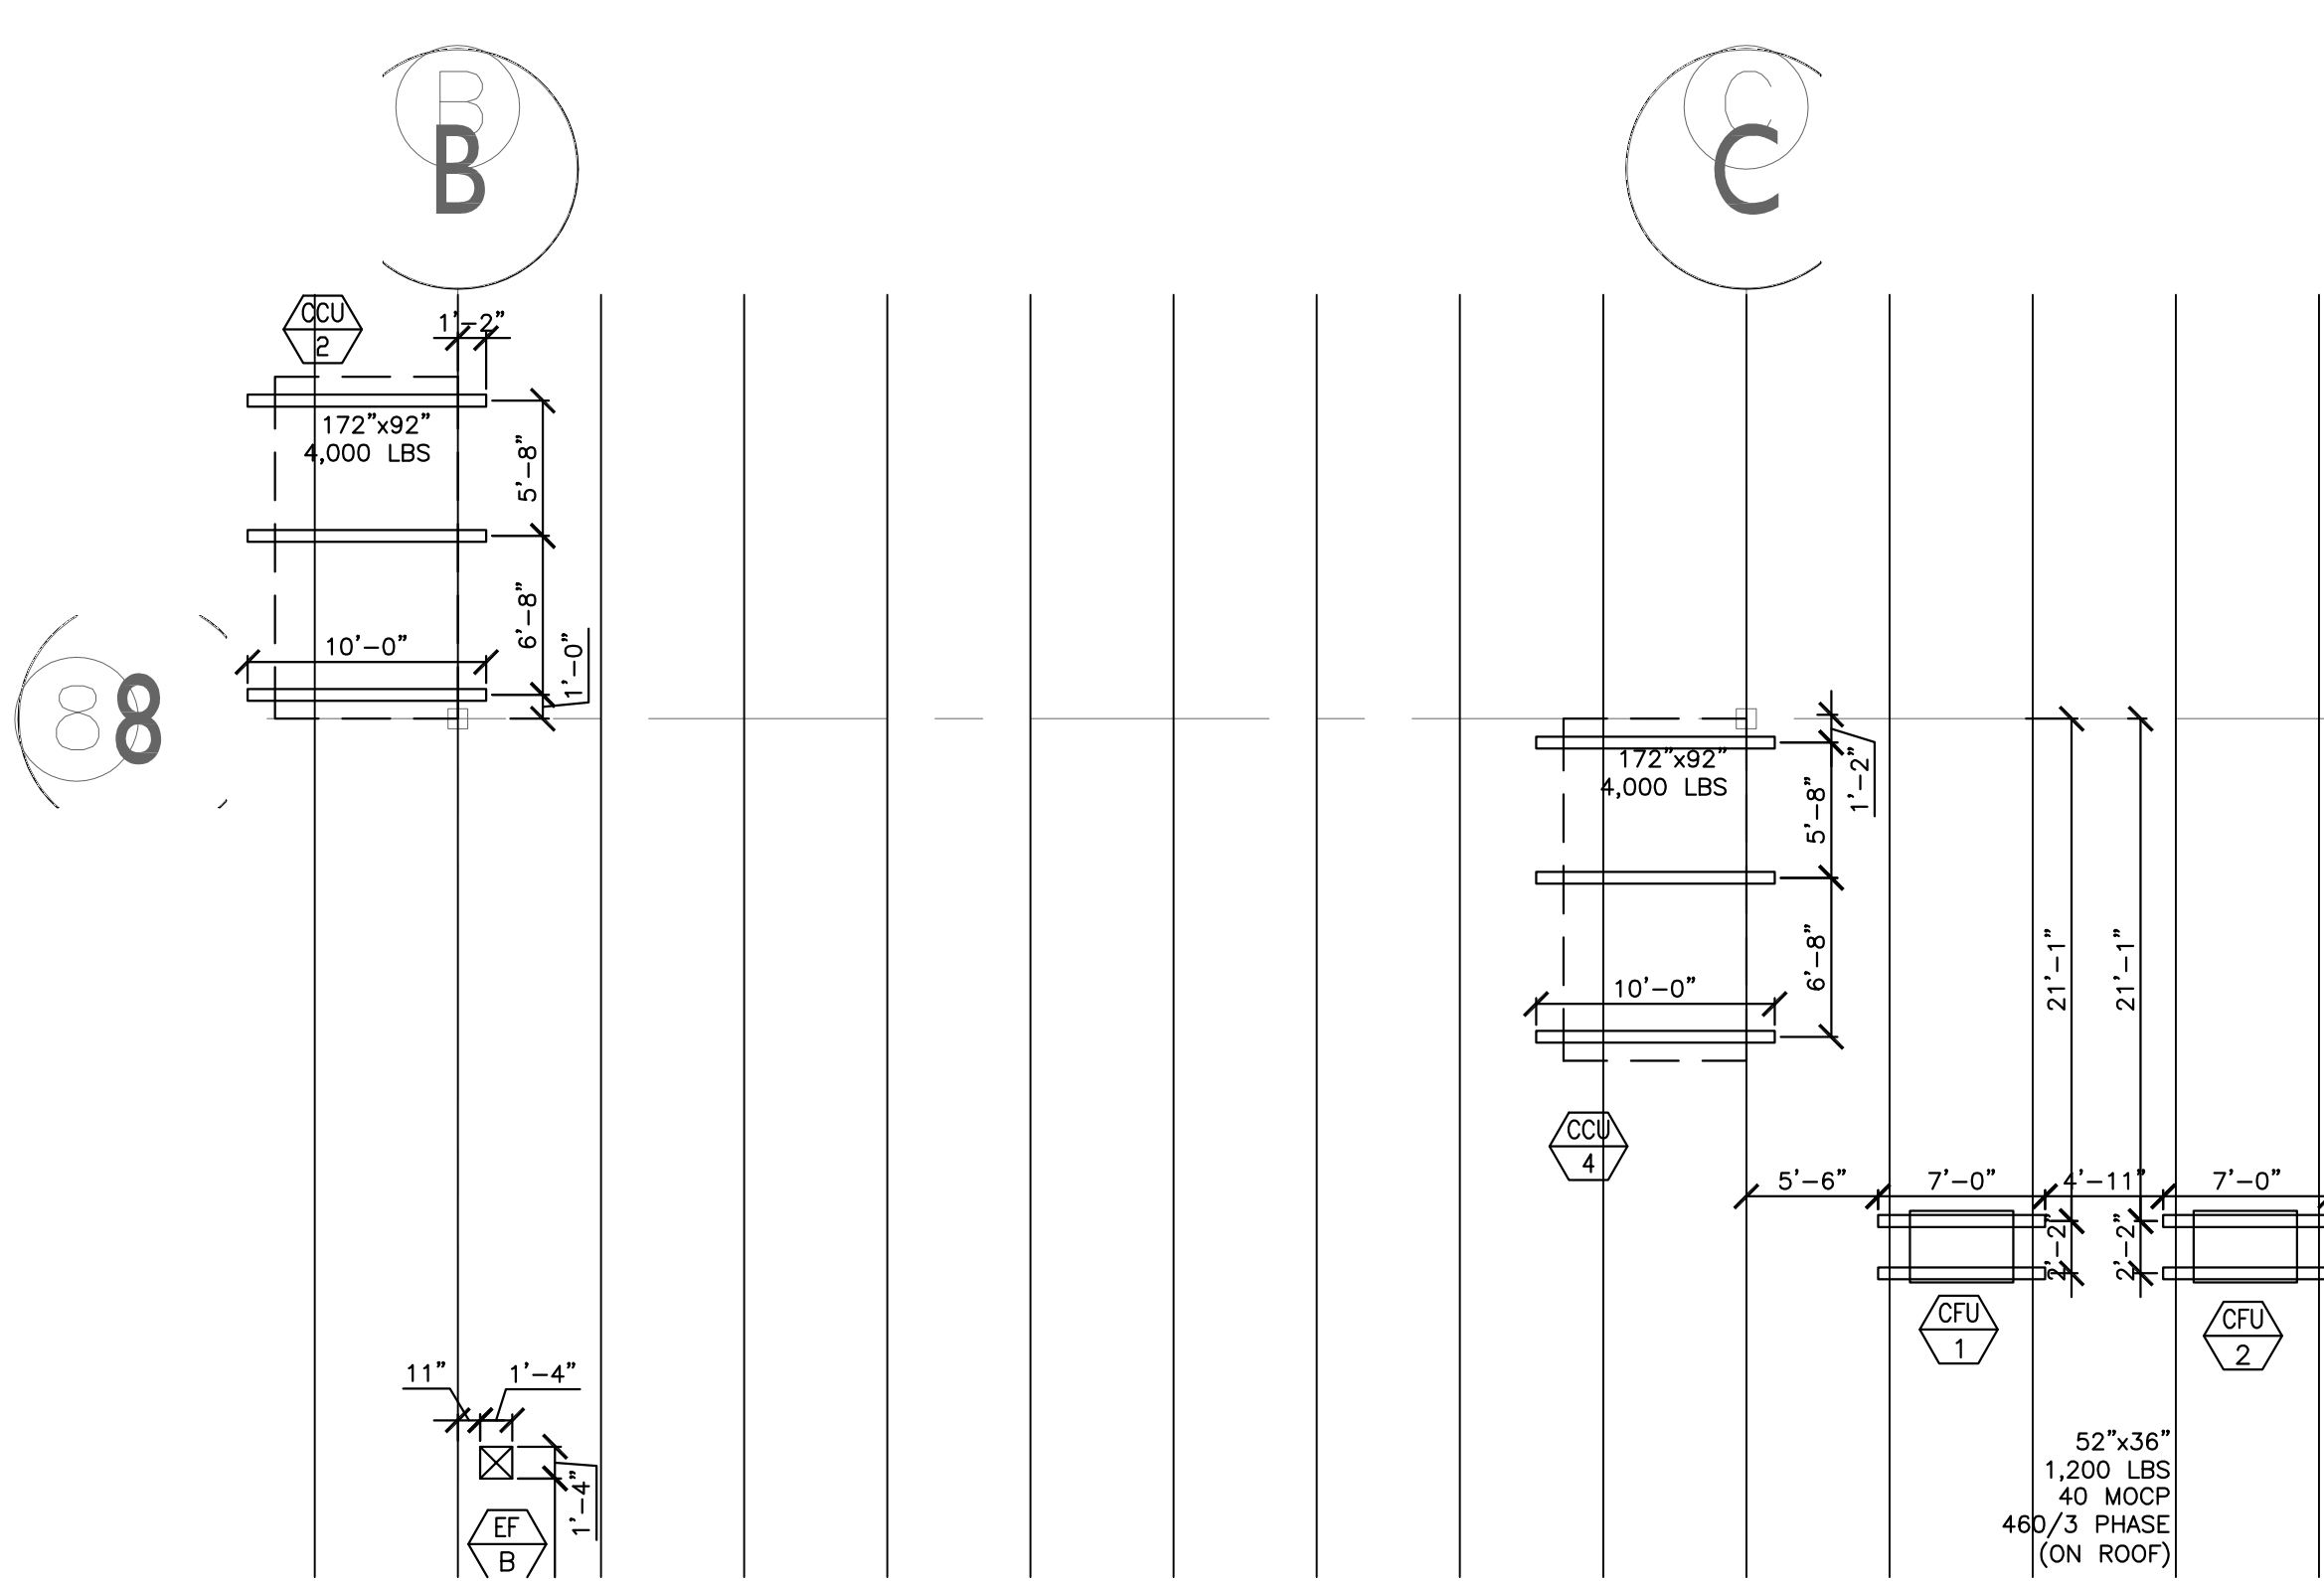

THIS PRINT IS CONFIDENTIAL TO METRO AIR CONDITIONING CO.  
REPRODUCTION OR DISCLOSURE TO OUTSIDE PARTIES IS  
PROHIBITED WITHOUT OUR WRITTEN CONSENT.  
© 2022 METRO AIR CONDITIONING CO.


LSCC BLDG. #1 - TI		
LEE'S SUMMIT, MO		
SCALE: AS NOTED	DATE: 12/15/22	DRAWN BY: M.D.K.
APPROVED BY: JDG	DWG #	M1
COORDINATION DWGS		of 5

\*\*ALL DIMENSIONS ARE TO BE INSIDE CLEAR\*\*

MECHANICAL GENERAL NOTES:

- ALL MECHANICAL DUCTWORK SHALL BE GALVANIZED STEEL, CONSTRUCTED ACCORDING TO SMACNA STANDARDS.
- ALL CONCEALED SUPPLY AIR AND RETURN AIR DUCTWORK SHALL BE EXTERNALLY INSULATED WITH 2" THICK, 3/4 LB DENSITY FIBERGLASS DUCT WRAP.
- HVAC CONTRACTOR WILL CHECK EACH SYSTEM FOR PROPER OPERATION.
- HVAC CONTRACTOR SHALL HAVE AN INDEPENDENT CONTRACTOR TO TEST & BALANCE HVAC SYSTEM TO THE PROPER AIRFLOWS AND STATIC PRESSURES. A COPY OF THE BALANCING REPORT WILL BE SUBMITTED TO THE OWNER UPON COMPLETION. AIR TO (+/-) 10% , WATER TO (+/-) 5%.
- FLEXIBLE RUN-OUTS TO BE U.L. LISTED AND HAVE A MAXIMUM LENGTH OF 8'-0". DUCT RUNS TO BE SAME SIZE AS DIFFUSER NECK SIZE SHOWN.
- AIR HANDLING UNITS SUPPLYING 2,000 CFM OR MORE SHALL HAVE A SMOKE DETECTOR INSTALLED IN THE RETURN AIR DUCTWORK. THE SMOKE DETECTOR SHALL BE INTERLOCKED TO SHUT DOWN ALL SUPPLY FANS UPON ALARM.
- MAINTAIN MINIMUM 10'-0" FROM ALL PLUMBING VENTS AND EXHAUST VENTS TO ALL OUTSIDE AIR INTAKES.
- DO NOT INSTALL PIPING OR DUCTWORK OVER ELECTRICAL PANELS.
- ALL COOLER/FREEZER REFRIGERANT PIPING TO BE INSULATED WITH 1" ARMAFLEX. ALL CONDENSATE PIPING TO BE INSULATED WITH 1" ARMAFLEX. CPVC CAN BE USED FOR ALL NON-HEAT TRACED CONDENSATE PIPING. COPPER TO BE USED FOR ALL HEAT-TRACED CONDENSATE. PROVIDE HEAT TRACING ON ALL CONDENSATE PIPING IN FREEZER PER MANUFACTURER'S RECOMMENDATIONS. PROVIDE UV PAINT ON ALL EXTERIOR INSULATION.



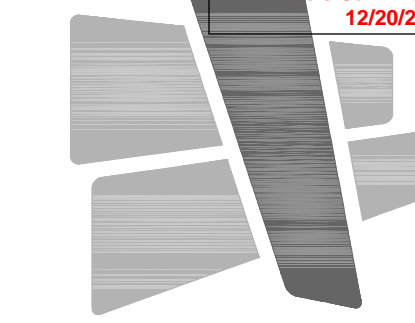

**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



CERTIFICATION

THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY  
OF CURRAN ARCHITECTURE, AND ARE NOT  
TO BE USED OR REPRODUCED, WHOLE OR  
IN PART, WITHOUT THE WRITTEN  
CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I















NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES

PERMIT SET 04.21.22

210300

M1.5

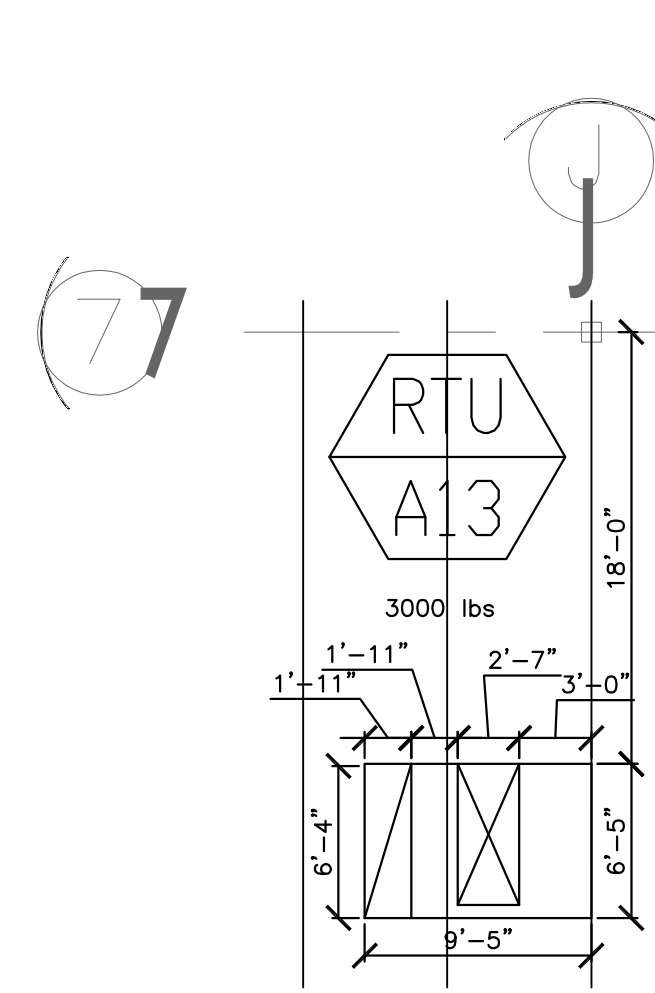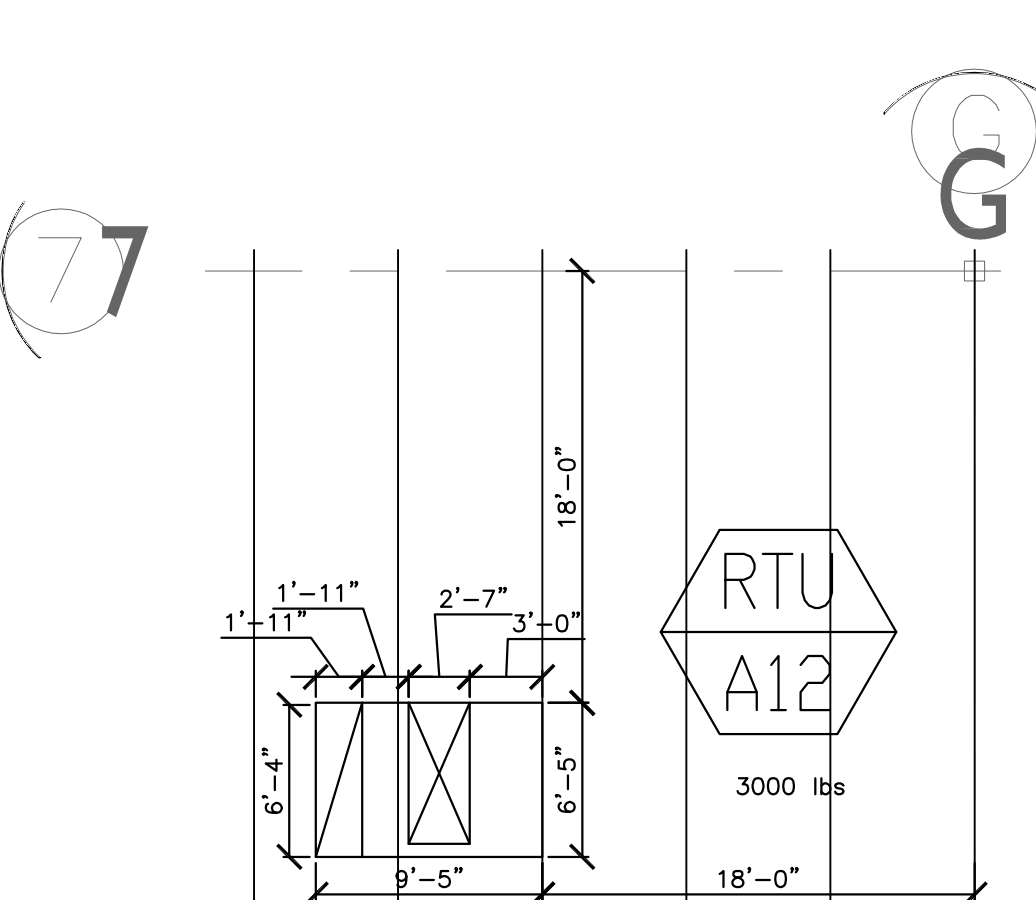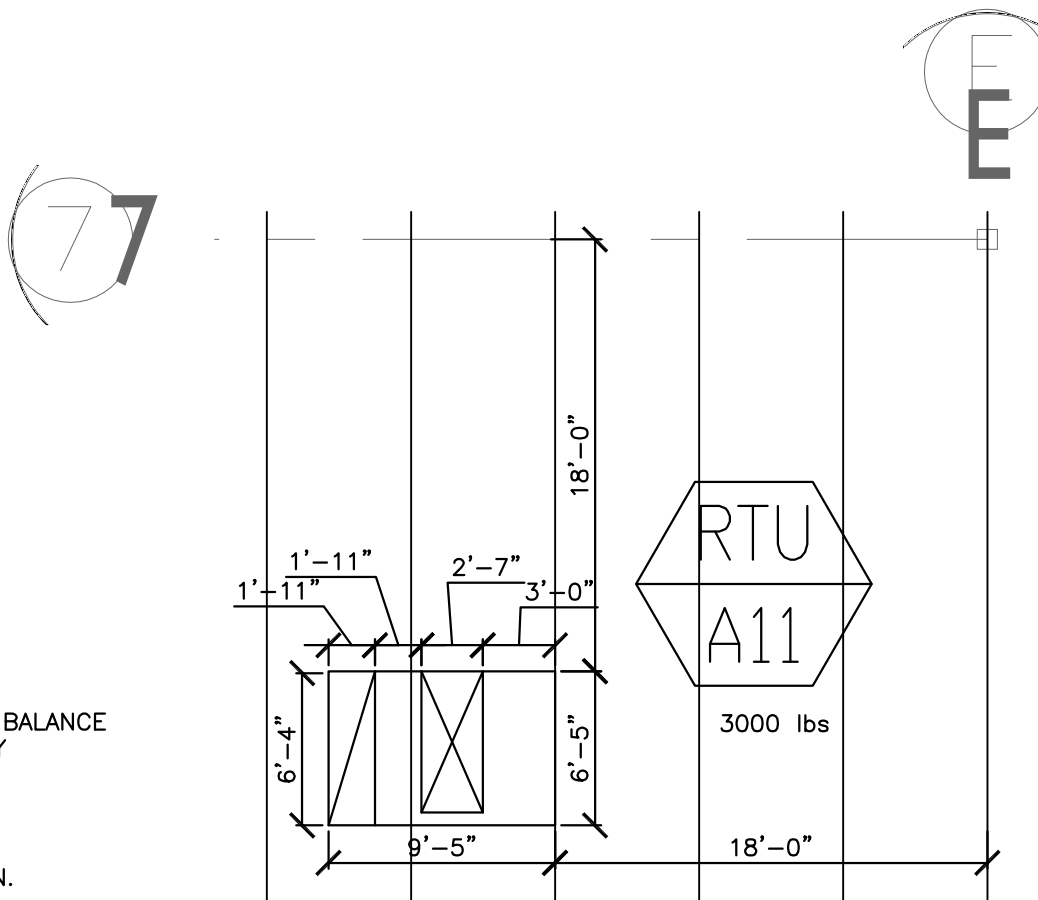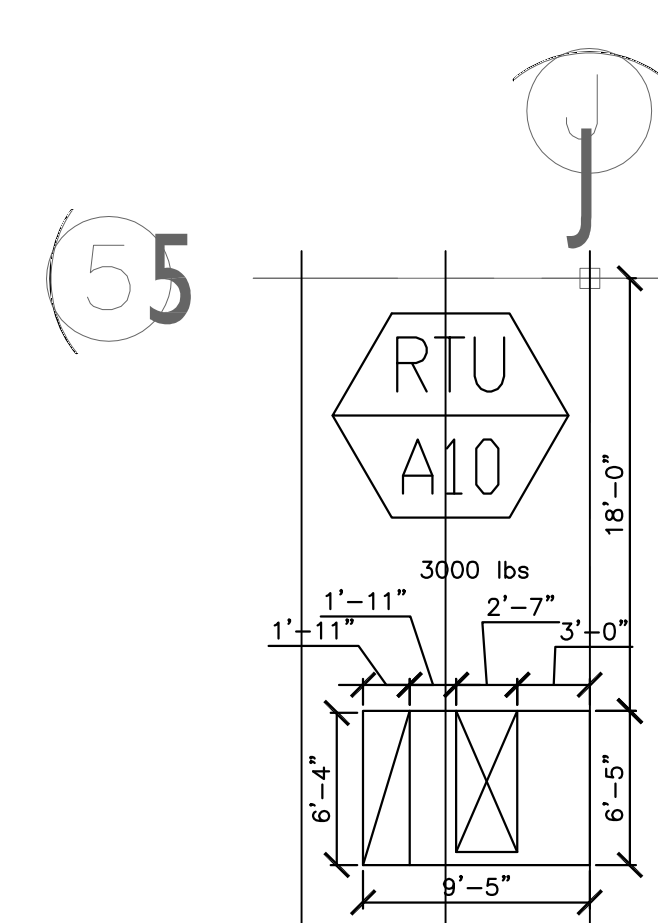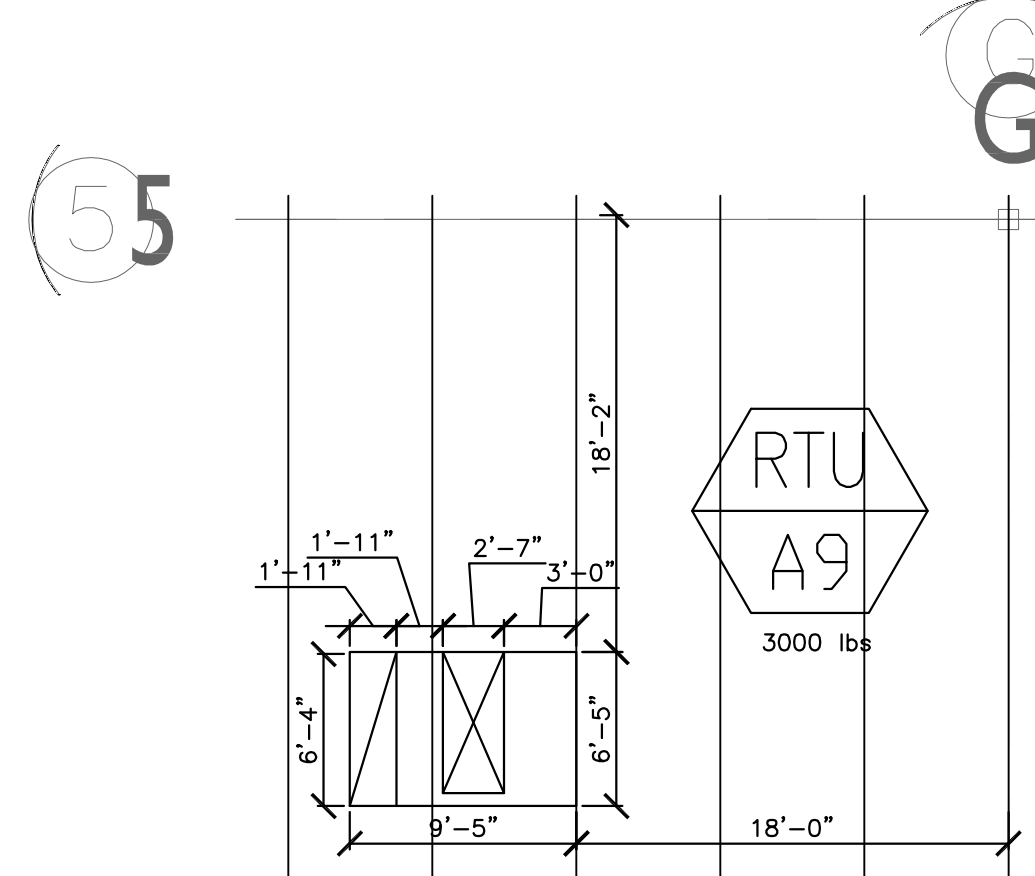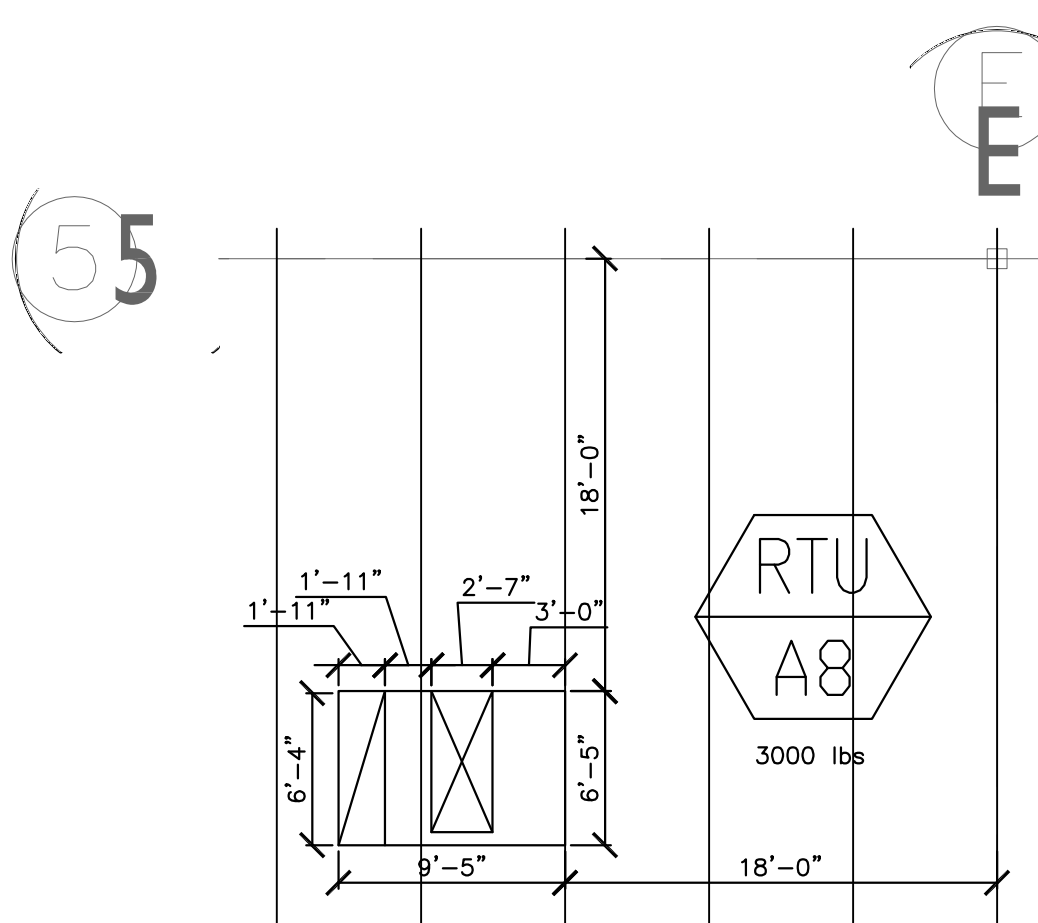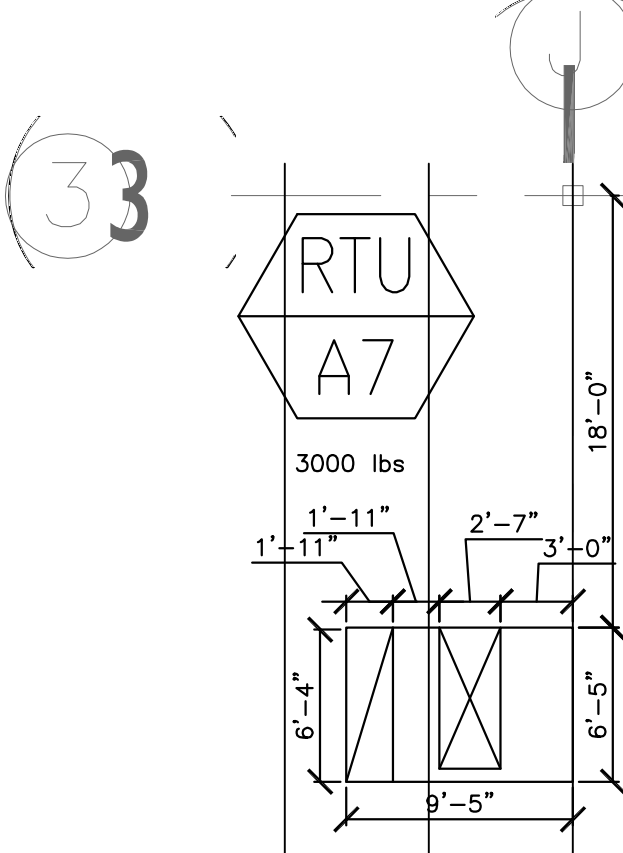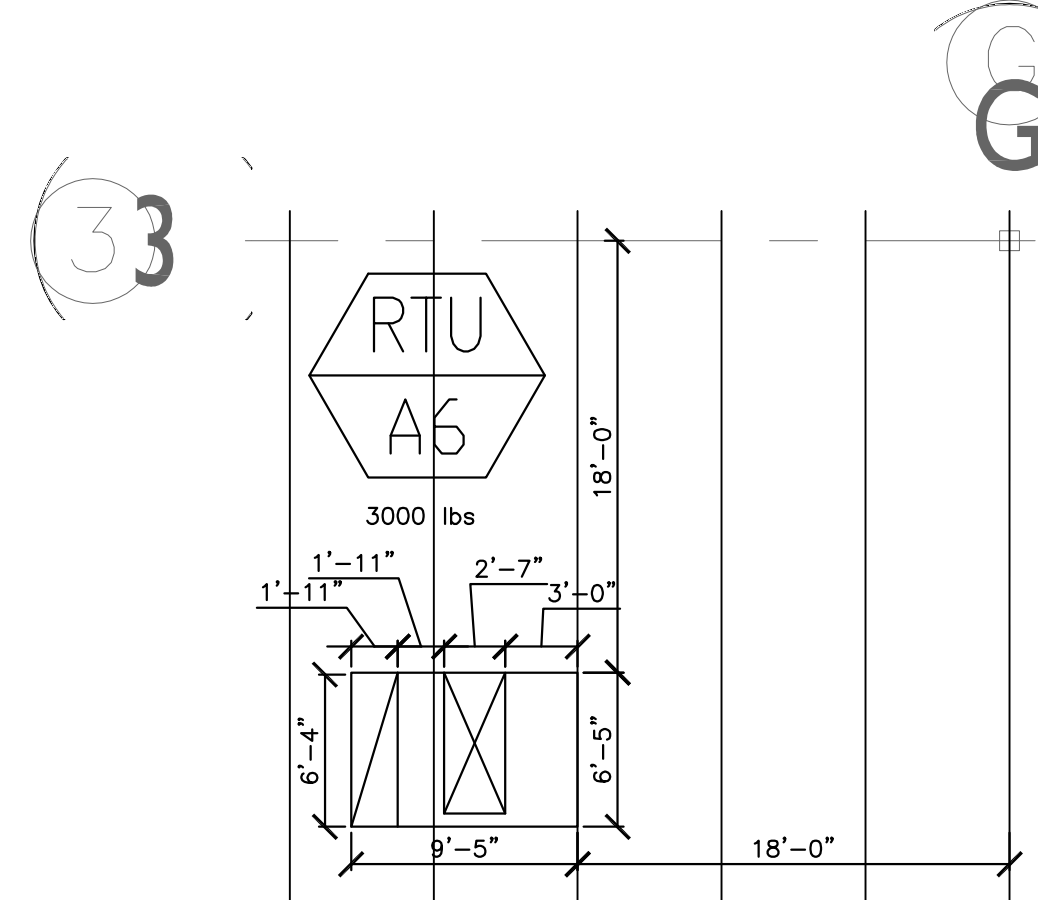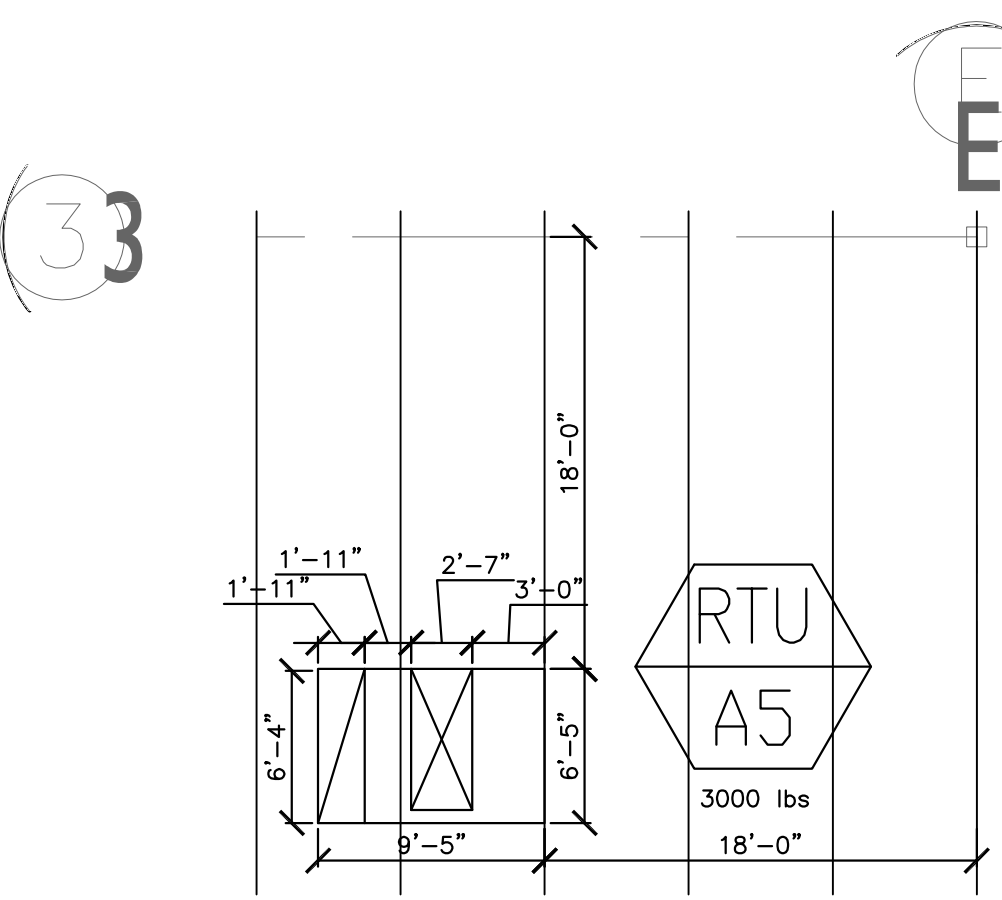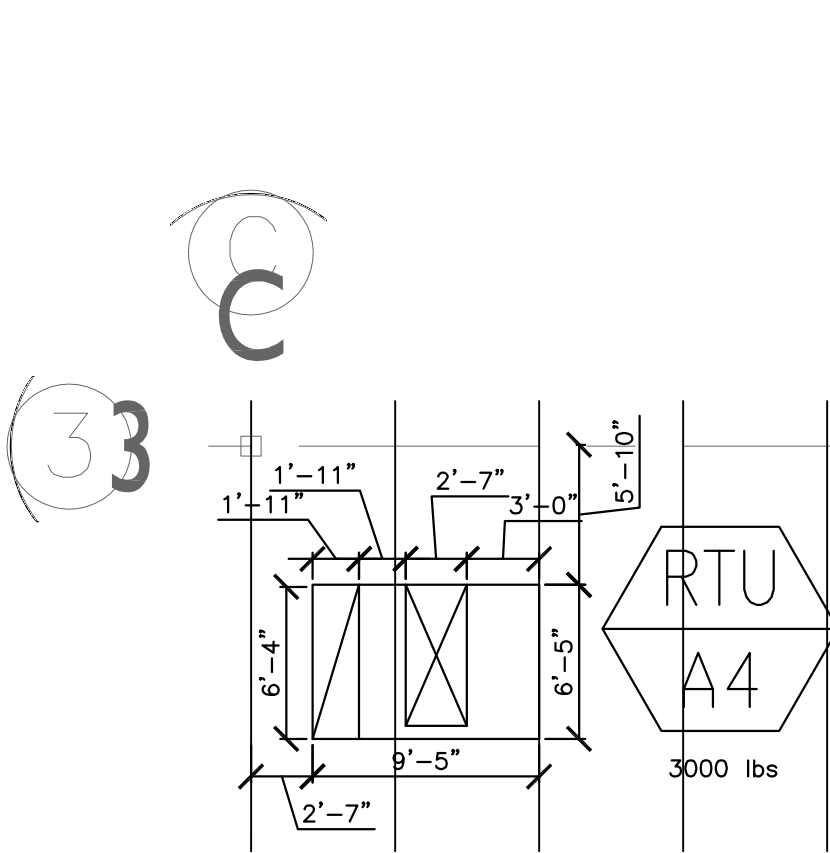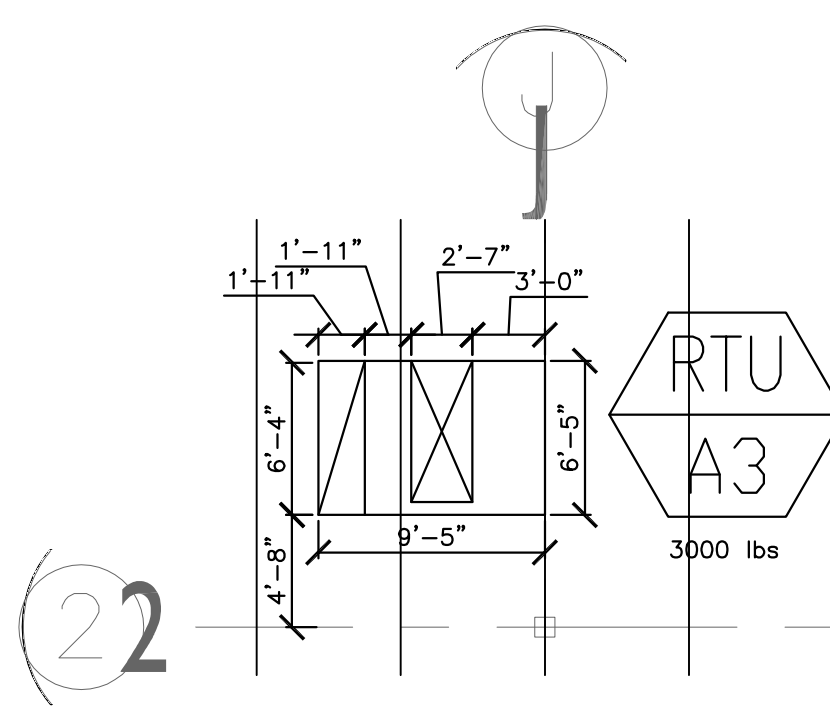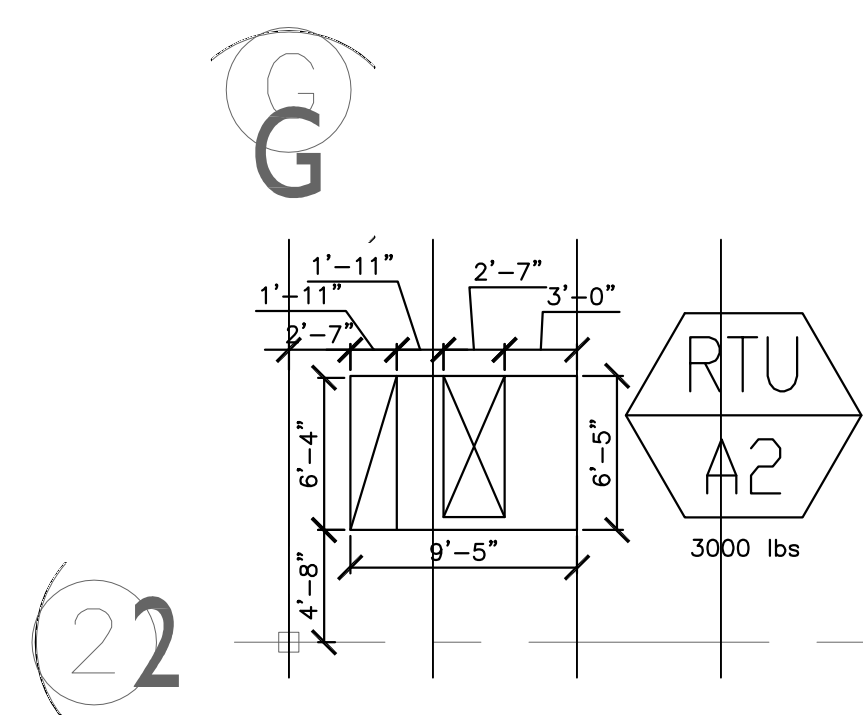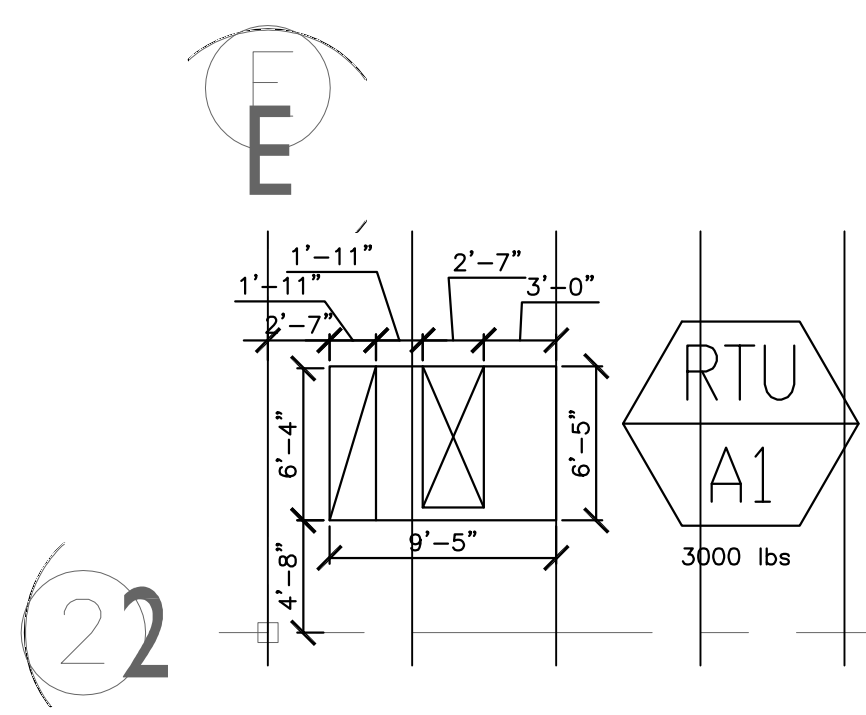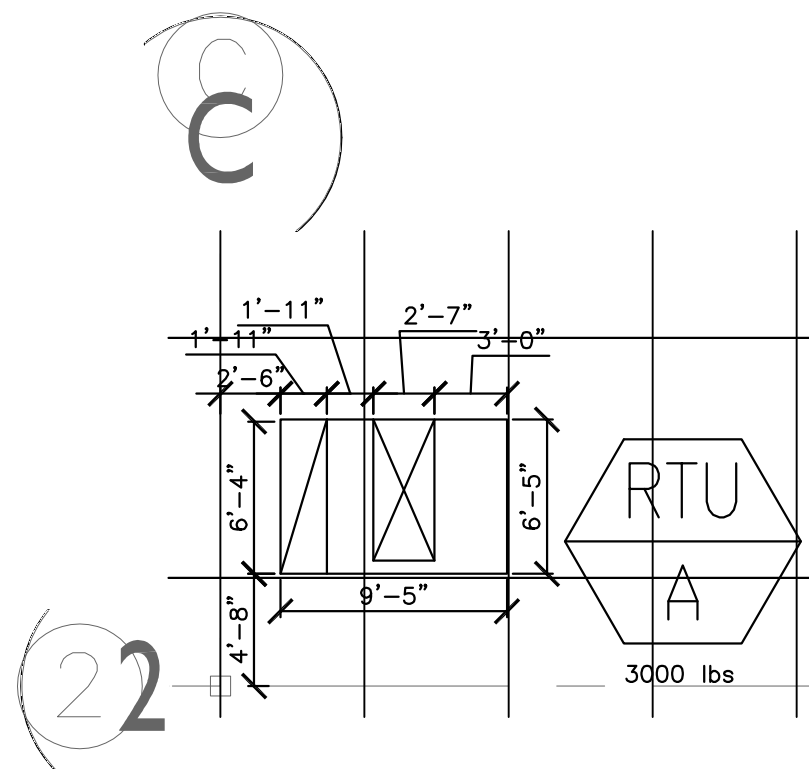

\*\*ALL DIMENSIONS ARE TO BE INSIDE CLEAR\*\*

**MECHANICAL GENERAL NOTES:**

- ALL MECHANICAL DUCTWORK SHALL BE GALVANIZED STEEL, CONSTRUCTED ACCORDING TO SMACNA STANDARDS.
- ALL CONCEALED SUPPLY AIR AND RETURN AIR DUCTWORK SHALL BE EXTERNALLY INSULATED WITH 2" THICK, 3/4 LB DENSITY FIBERGLASS DUCT WRAP.  
ALL EXPOSED (WAREHOUSE) SUPPLY AIR DUCTWORK AND RETURN AIR DUCTWORK SHALL BE INTERNALLY INSULATED WITH 1" THICK, 2 LB DENSITY FIBERGLASS DUCT LINER.
- HVAC CONTRACTOR WILL CHECK EACH SYSTEM FOR PROPER OPERATION.
- HVAC CONTRACTOR SHALL HAVE AN INDEPENDENT CONTRACTOR TO TEST & BALANCE HVAC SYSTEM TO THE PROPER AIRFLOWS AND STATIC PRESSURES. A COPY OF THE BALANCING REPORT WILL BE SUBMITTED TO THE OWNER UPON COMPLETION. AIR TO (+/-) 10% , WATER TO (+/-) 5%.
- FLEXIBLE RUN-OUTS TO BE U.L. LISTED AND HAVE A MAXIMUM LENGTH OF 8'-0". DUCT RUNS TO BE SAME SIZE AS DIFFUSER NECK SIZE SHOWN.
- AIR HANDLING UNITS SUPPLYING 2,000 CFM OR MORE SHALL HAVE A SMOKE DETECTOR INSTALLED IN THE RETURN AIR DUCTWORK. THE SMOKE DETECTOR SHALL BE INTERLOCKED TO SHUT DOWN ALL SUPPLY FANS UPON ALARM.
- MAINTAIN MINIMUM 10'-0" FROM ALL PLUMBING VENTS AND EXHAUST VENTS TO ALL OUTSIDE AIR INTAKES.
- DO NOT INSTALL PIPING OR DUCTWORK OVER ELECTRICAL PANELS.
- ALL COOLER/FREEZER REFRIGERANT PIPING TO BE INSULATED WITH 1" ARMAFLEX. ALL CONDENSATE PIPING TO BE INSULATED WITH 1" ARMAFLEX. CPVC CAN BE USED FOR ALL NON-HEAT TRACED CONDENSATE PIPING. COPPER TO BE USED FOR ALL HEAT-TRACED CONDENSATE.  
PROVIDE HEAT TRACING ON ALL CONDENSATE PIPING IN FREEZER PER MANUFACTURER'S RECOMMENDATIONS.  
PROVIDE UV PAINT ON ALL EXTERIOR INSULATION.

**1 ROOF DETAIL**  
scale: 1/8" = 1'-0"



THIS PRINT IS CONFIDENTIAL TO METRO AIR CONDITIONING CO.  
REPRODUCTION OR DISCLOSURE TO OUTSIDE PARTIES IS  
PROHIBITED WITHOUT OUR WRITTEN CONSENT.  
© 2022 METRO AIR CONDITIONING CO.

LSCC BLDG. #1 - TI		
LEE'S SUMMIT, MO		
SCALE: AS NOTED	DATE: 12/15/22	DRAWN BY: M.D.K.
APPROVED BY: JDG	DWG #	M1
COORDINATION DWGS		of 5





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



**SCANNELL**  
PROPERTIES

## CERTIFICATION

THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY  
OF CURRAN ARCHITECTURE, AND ARE NOT  
TO BE USED OR REPRODUCED, WHOLE OR  
IN PART, WITHOUT THE WRITTEN  
CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

## PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT 1









NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

## ISSUE DATES

PERMIT SET 04.21.22

210300

M1.6

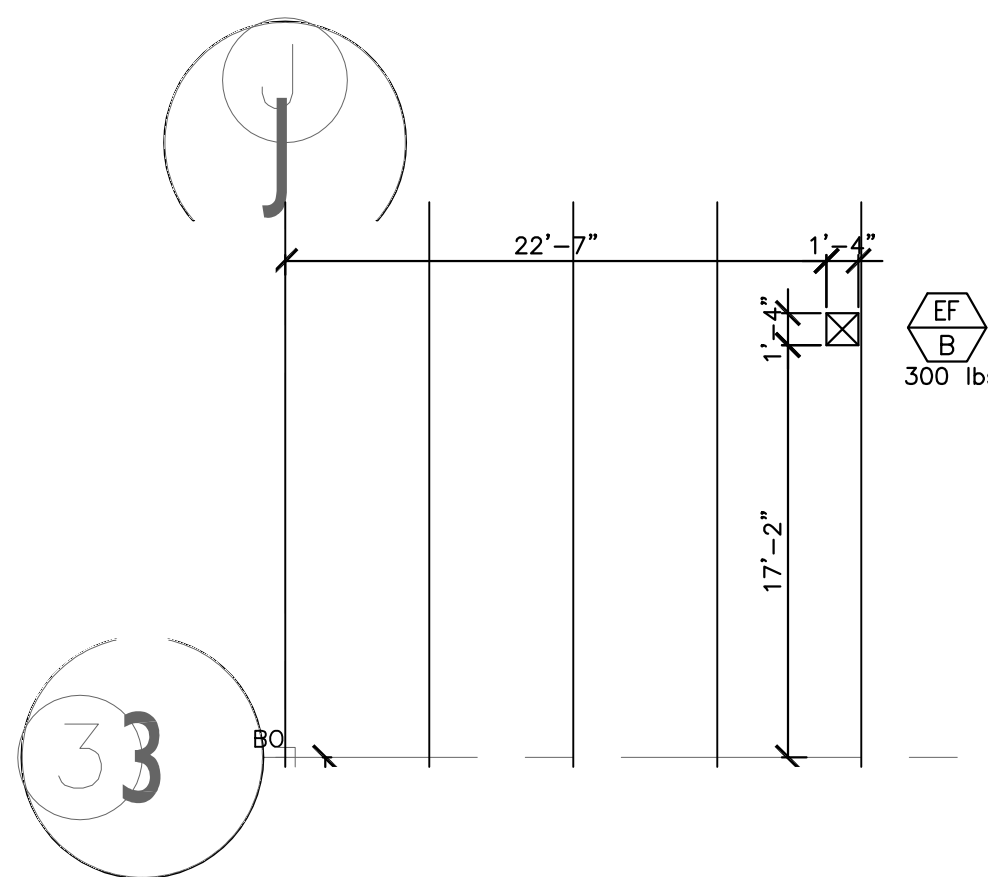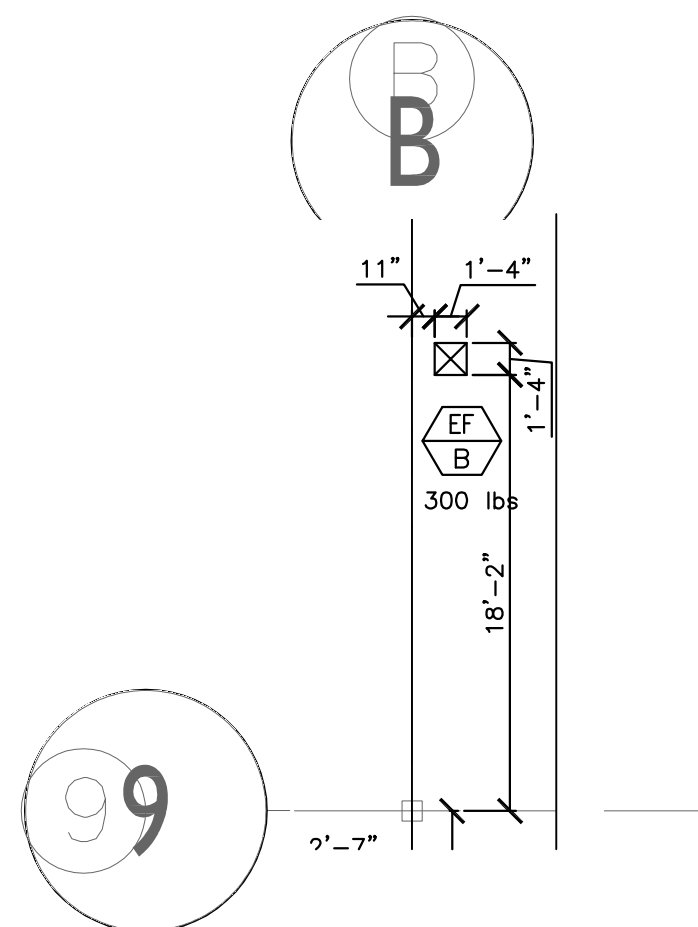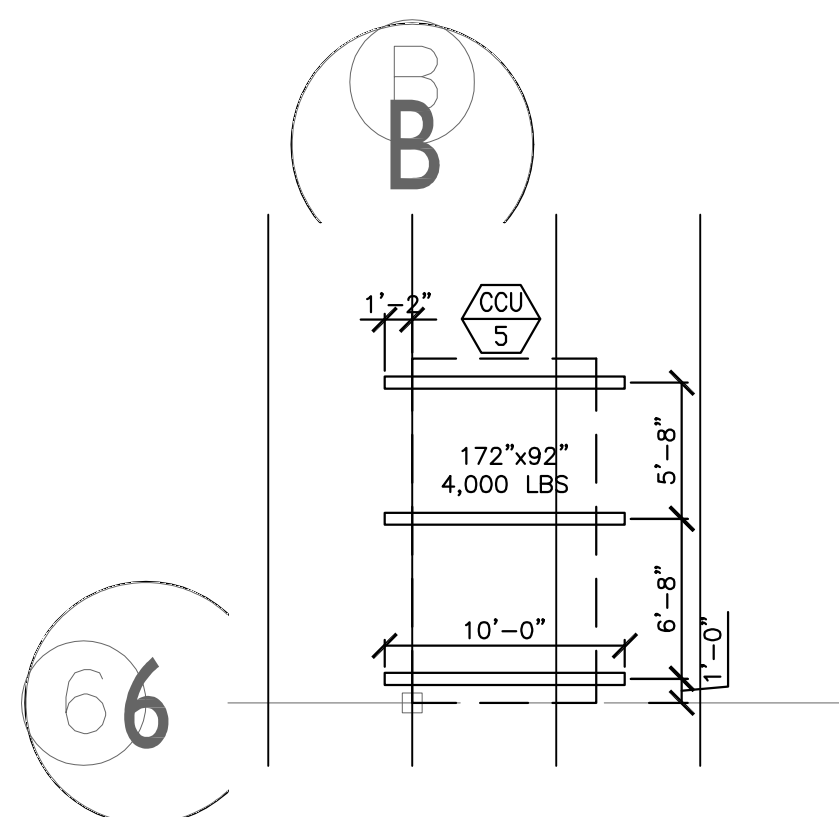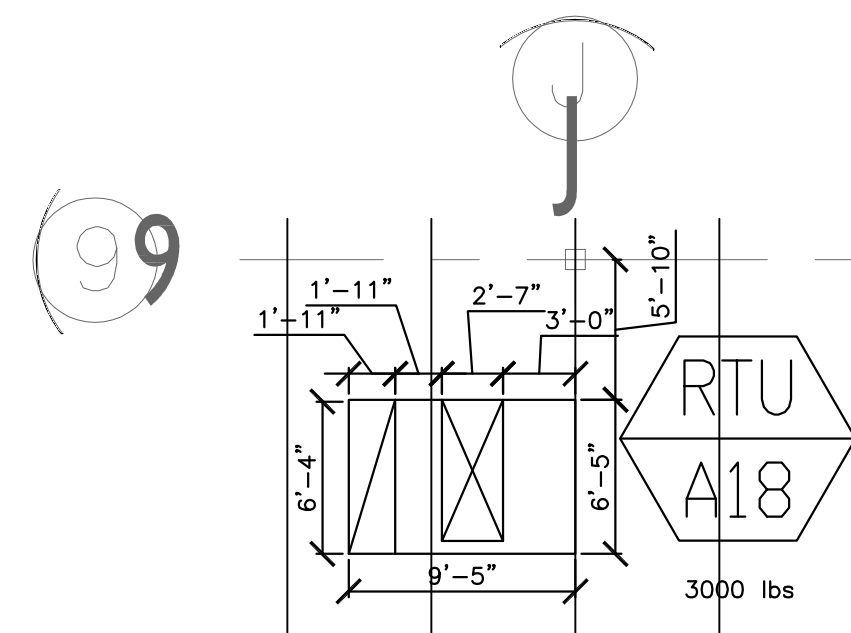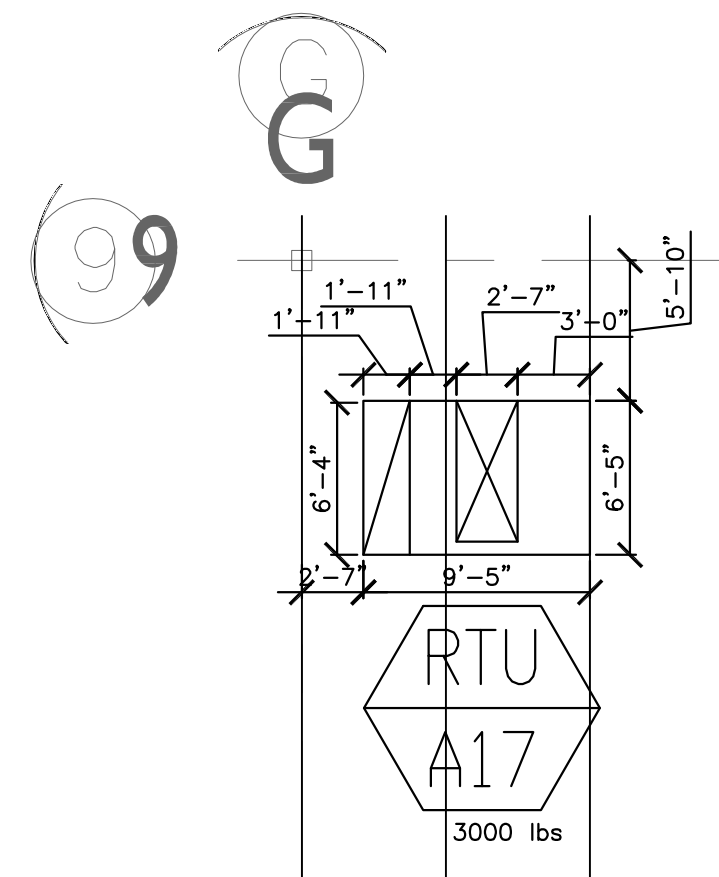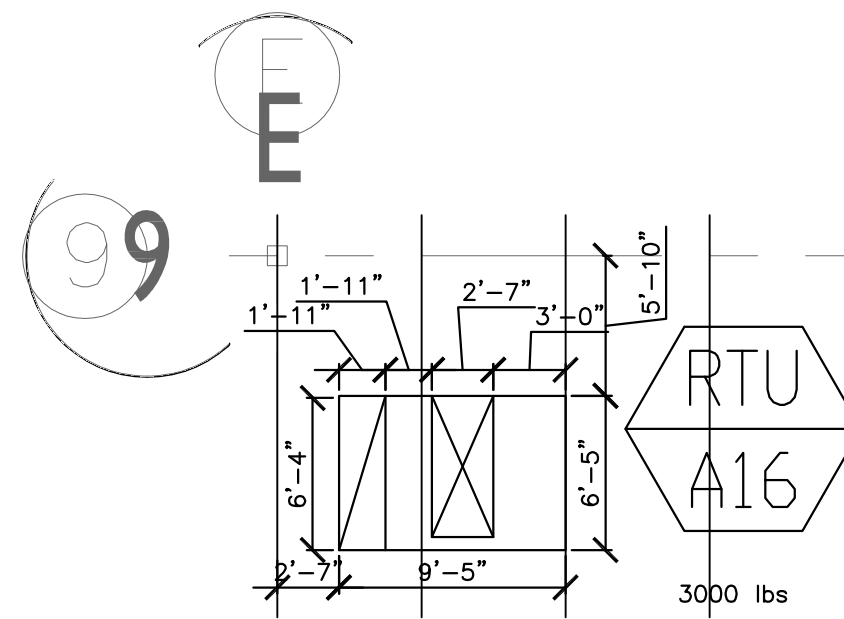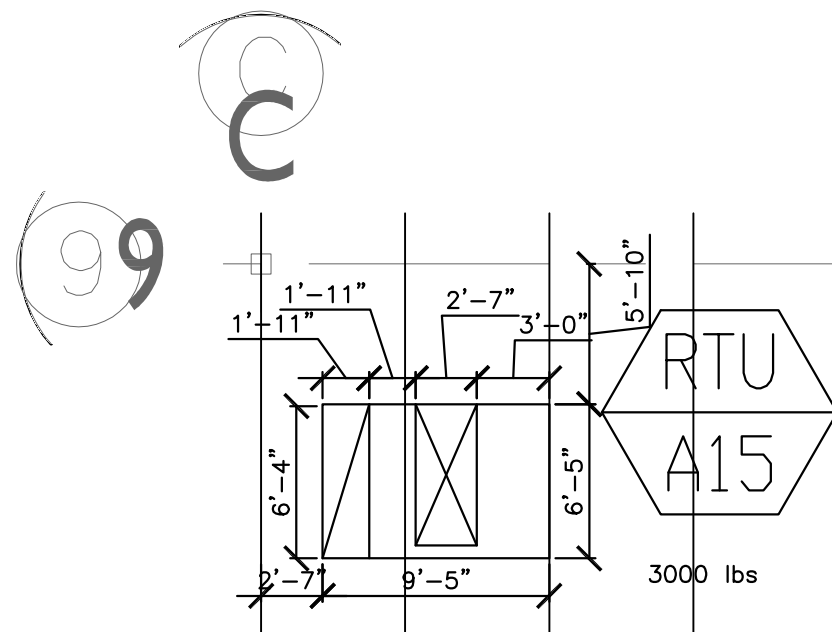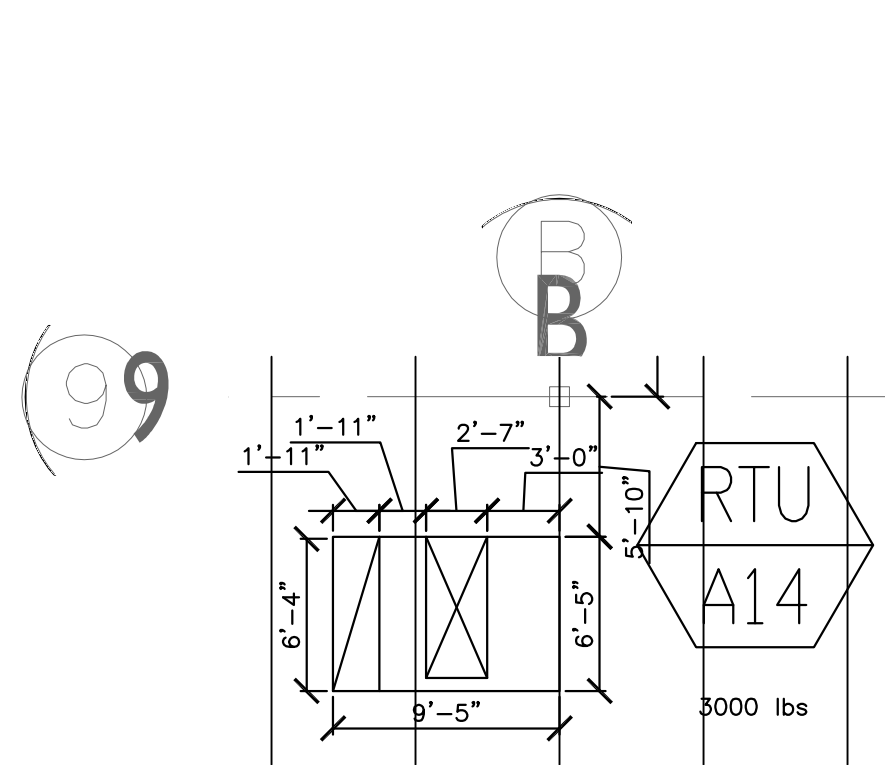

MECHANICAL GENERAL NOTES:

1. ALL MECHANICAL DUCTWORK SHALL BE GALVANIZED STEEL, CONSTRUCTED ACCORDING TO SMACNA STANDARDS.
2. ALL EXPOSED SUPPLY AIR AND RETURN AIR DUCTWORK SHALL BE EXTERNALLY INSULATED WITH 2" THICK, 3/4 LB DENSITY FIBERGLASS DUCT WRAP.  
ALL EXPOSED (WAREHOUSE) SUPPLY AIR DUCTWORK AND RETURN AIR DUCTWORK SHALL BE INTERNALLY INSULATED WITH 1" THICK, 2 LB DENSITY FIBERGLASS DUCT LINER.
3. HVAC CONTRACTOR WILL CHECK EACH SYSTEM FOR PROPER OPERATION.
4. HVAC CONTRACTOR SHALL HAVE AN INDEPENDENT CONTRACTOR TO TEST & BALANCE HVAC SYSTEM TO THE PROPER AIRFLOWS AND STATIC PRESSURES. A COPY OF THE BALANCING REPORT WILL BE SUBMITTED TO THE OWNER UPON COMPLETION. AIR TO (+/-) 10% , WATER TO (+/-) 5%.
5. FLEXIBLE RUN-OUTS TO BE U.L. LISTED AND HAVE A MAXIMUM LENGTH OF 8'-0". DUCT RUNS TO BE SAME SIZE AS DIFFUSER NECK SIZE SHOWN.
6. AIR HANDLING UNITS SUPPLYING 2,000 CFM OR MORE SHALL HAVE A SMOKE DETECTOR INSTALLED IN THE RETURN AIR DUCTWORK. THE SMOKE DETECTOR SHALL BE INTERLOCKED TO SHUT DOWN ALL SUPPLY FANS UPON ALARM.
7. MAINTAIN MINIMUM 10'-0" FROM ALL PLUMBING VENTS AND EXHAUST VENTS TO ALL OUTSIDE AIR INTAKES.
8. DO NOT INSTALL PIPING OR DUCTWORK OVER ELECTRICAL PANELS.
9. ALL COOLER/FREEZER REFRIGERANT PIPING TO BE INSULATED WITH 1" ARMAFLEX. ALL CONDENSATE PIPING TO BE INSULATED WITH 1" ARMAFLEX. CPVC CAN BE USED FOR ALL NON-HEAT TREATED CONDENSATE PIPING. COPPER TO BE USED FOR ALL HEAT-TREATED CONDENSATE.  
PROVIDE HEAT TRACING ON ALL CONDENSATE PIPING IN FREEZER PER MANUFACTURER'S RECOMMENDATIONS.  
PRODUCE U/P VAINT ON ALL EXTERIOR INSULATION.

**\*\*ALL DIMENSIONS ARE TO BE INSIDE CLEAR\*\***


THIS PRINT IS CONFIDENTIAL TO METRO AIR CONDITIONING CO.  
REPRODUCTION OR DISCLOSURE TO OUTSIDE PARTIES IS  
PROHIBITED WITHOUT OUR WRITTEN CONSENT.  
© 2022 METRO AIR CONDITIONING CO.

LSCC BLDG. #1 — TI		
LEE'S SUMMIT, MO		
SCALE: AS NOTED	DATE: 12/15/22	DRAWN BY: M.D.K.
APPROVED BY: JDG	DWG # M1	
COORDINATION DWGS	of 5	

## 1 ROOF DETAIL





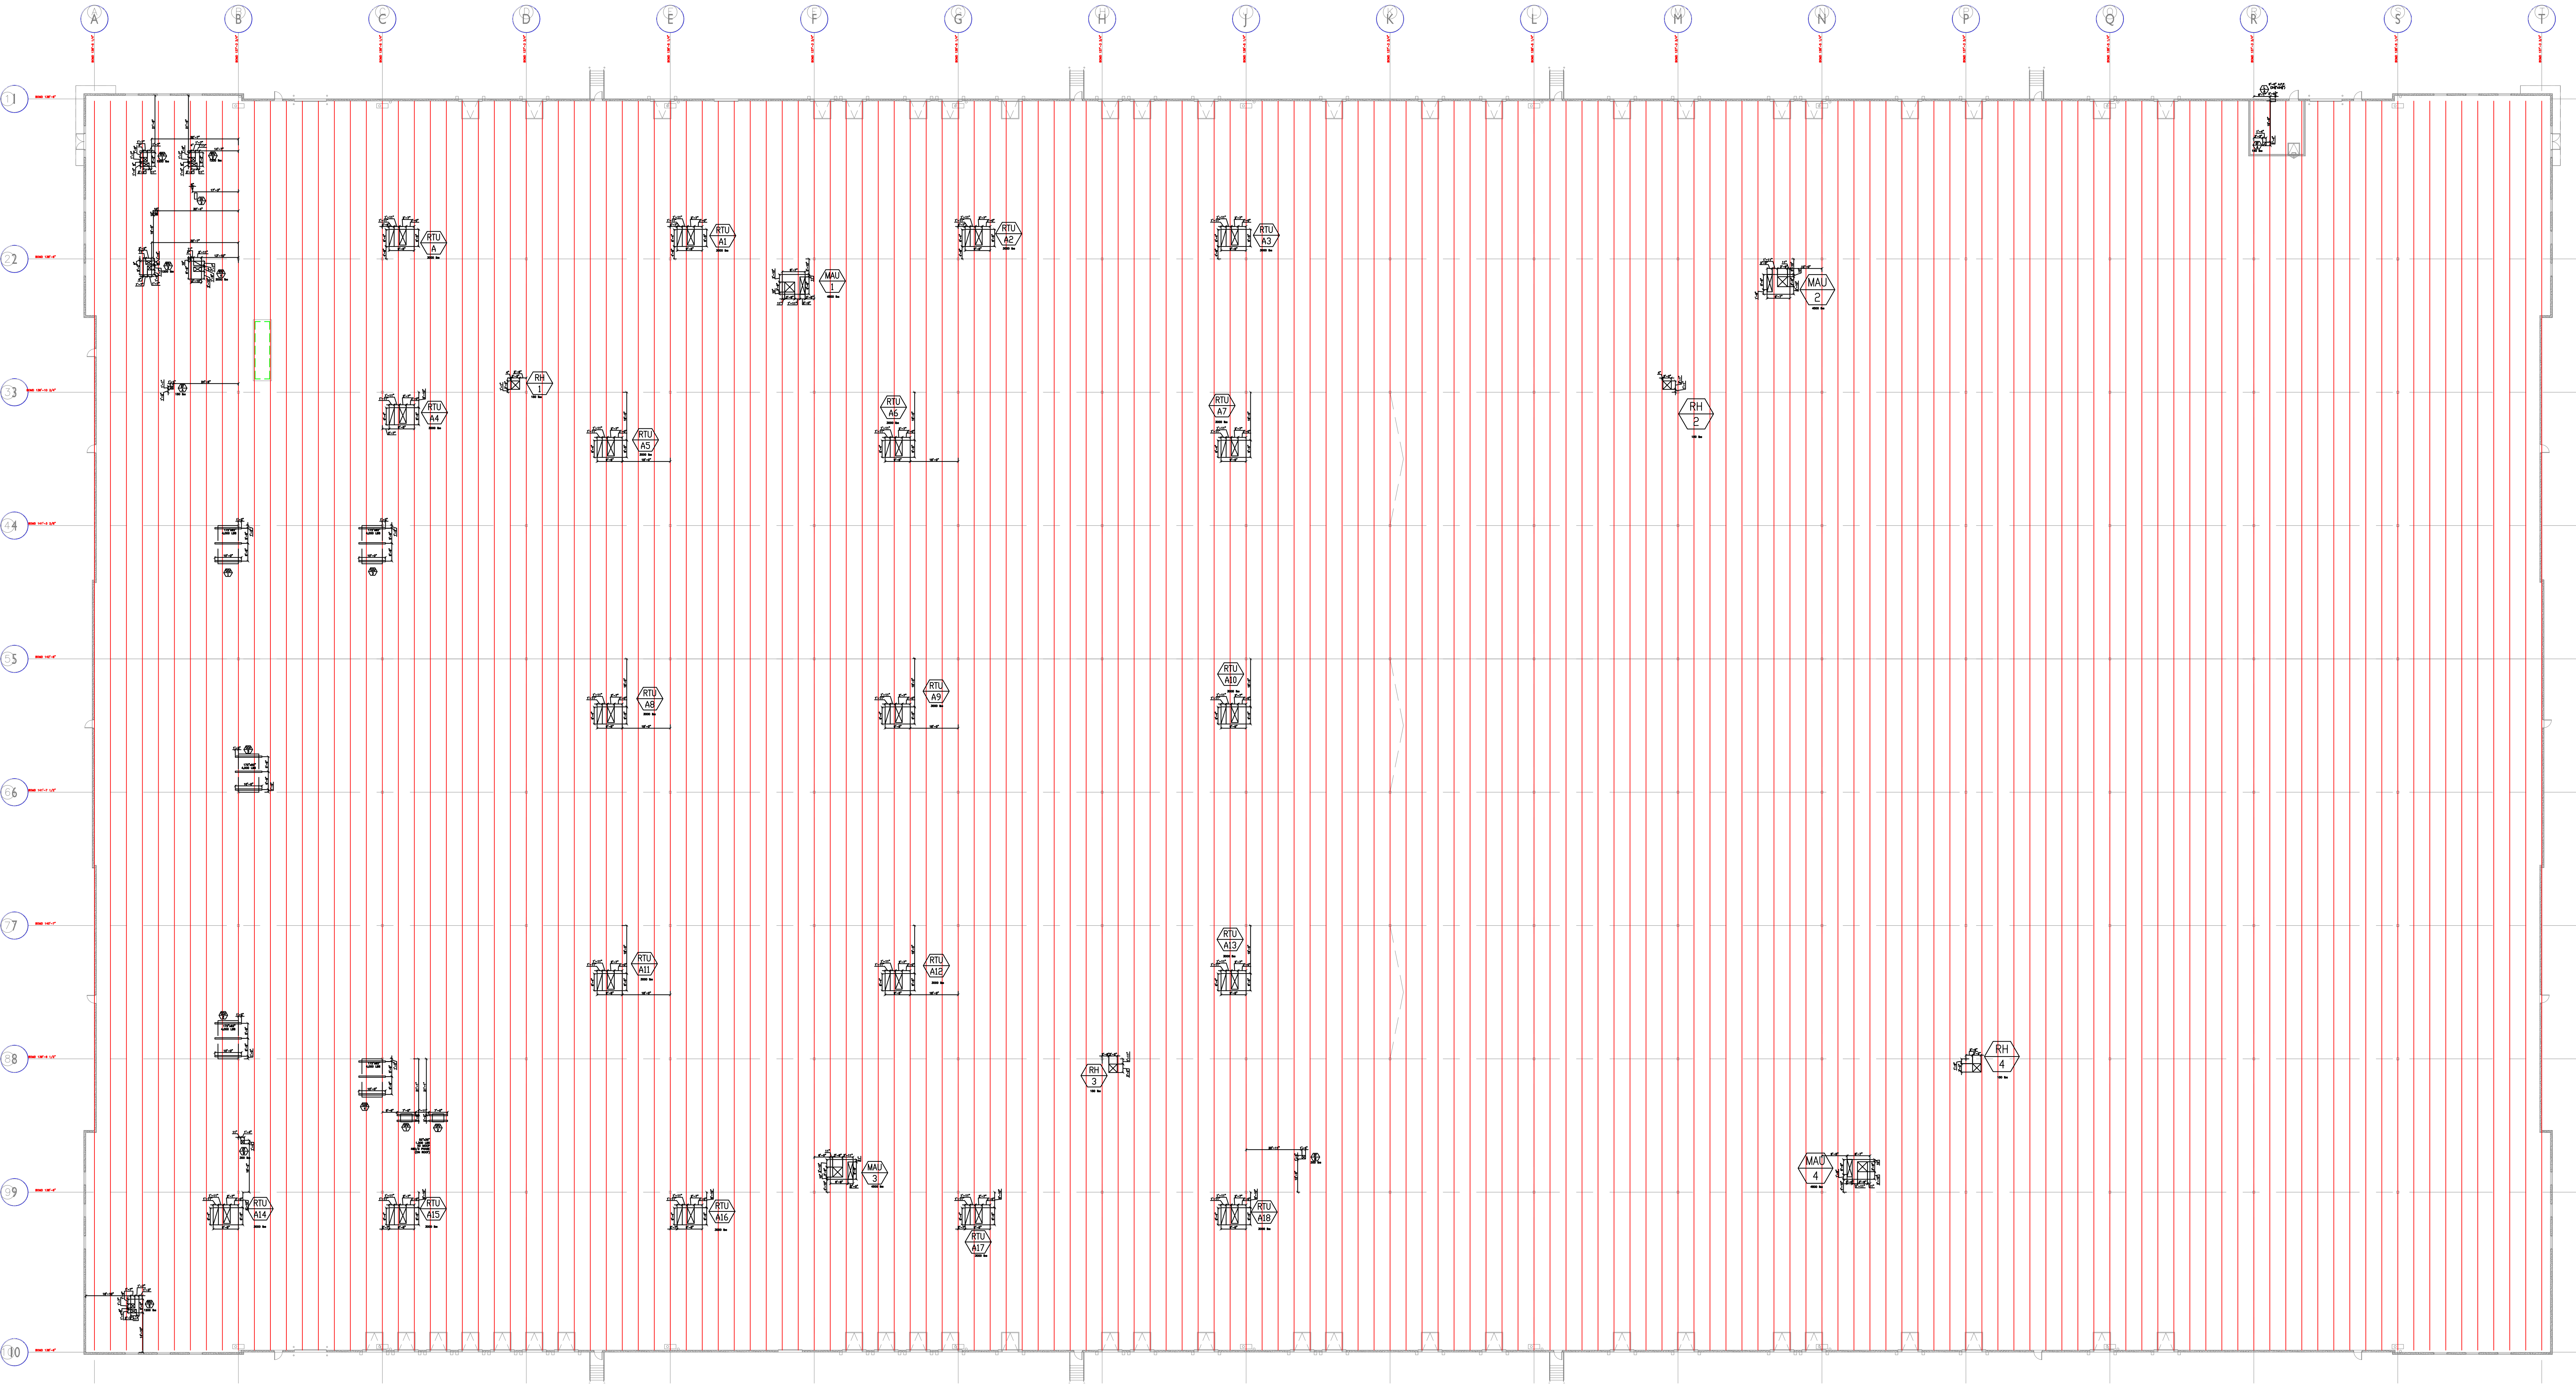

**MECHANICAL GENERAL NOTES:**

1. ALL MECHANICAL DUCTWORK SHALL BE GALVANIZED STEEL, CONSTRUCTED ACCORDING TO SMACNA STANDARDS.
2. ALL CONCEALED SUPPLY AIR AND RETURN AIR DUCTWORK SHALL BE EXTERNALLY INSULATED WITH 2" THICK, 3/4-LB DENSITY FIBERGLASS DUCT WRAP.  
ALL EXPOSED (WAREHOUSE) SUPPLY AIR DUCTWORK AND RETURN AIR DUCTWORK SHALL BE INTERNALLY INSULATED WITH 1" THICK, 2 LB DENSITY FIBERGLASS DUCT LINER.
3. HVAC CONTRACTOR WILL CHECK EACH SYSTEM FOR PROPER OPERATION.
4. HVAC CONTRACTOR SHALL HAVE AN INDEPENDENT CONTRACTOR TO TEST & BALANCE HVAC SYSTEM TO THE PROPER AIRFLOWS AND STATIC PRESSURES. A COPY OF THE BALANCING REPORT WILL BE SUBMITTED TO THE OWNER UPON COMPLETION. AIR TO (+/-) 10%, WATER TO (+/-) 5%.
5. FLEXIBLE RUN-OUTS TO BE U.L. LISTED AND HAVE A MAXIMUM LENGTH OF 8'-0". DUCT RUNS TO BE SAME SIZE AS DIFFUSER NECK SIZE SHOWN.
6. AIR HANDLING UNITS SUPPLYING 2,000 CFM OR MORE SHALL HAVE A SMOKE DETECTOR INSTALLED IN THE RETURN AIR DUCTWORK. THE SMOKE DETECTOR SHALL BE INTERLOCKED TO SHUT DOWN ALL SUPPLY FANS UPON ALARM.
7. MAINTAIN MINIMUM 10'-0" FROM ALL PLUMBING VENTS AND EXHAUST VENTS TO ALL OUTSIDE AIR INTAKES.
8. DO NOT INSTALL PIPING OR DUCTWORK OVER ELECTRICAL PANELS.
9. ALL COOLER/FREEZER REFRIGERANT PIPING TO BE INSULATED WITH 1" ARMAFLEX. ALL CONDENSATE PIPING TO BE INSULATED WITH 1" ARMAFLEX. CPVC CAN BE USED FOR ALL NON-HEAT TRACED CONDENSATE PIPING. COPPER TO BE USED FOR ALL HEAT-TRACED CONDENSATE. PROVIDE HEAT TRACING ON ALL CONDENSATE PIPING IN FREEZER PER MANUFACTURER'S RECOMMENDATIONS. PROVIDE UV PAINT ON ALL EXTERIOR INSULATION.

**1 Overall Mechanical Floor Plan**  
scale: 1" = 25'-0"



THIS PRINT IS CONFIDENTIAL TO METRO AIR CONDITIONING CO.  
REPRODUCTION OR DISCLOSURE TO OUTSIDE PARTIES IS  
PROHIBITED WITHOUT OUR WRITTEN CONSENT.  
© 2022 METRO AIR CONDITIONING CO.


**MetroAir**

LSCC BLDG. #1 - TI  
LEE'S SUMMIT, MO

SCALE: AS NOTED	DATE: 12/15/22	DRAWN BY: M.D.K.
APPROVED BY: JDG	DWG #	M1
COORDINATION DWGS		of 5


M1.7



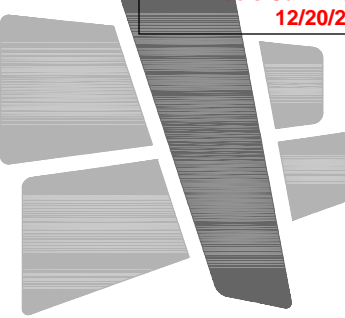

**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

CERTIFICATION

THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY  
OF CURRAN ARCHITECTURE, AND ARE NOT  
TO BE USED OR REPRODUCED, WHOLE OR  
IN PART, WITHOUT THE WRITTEN  
CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES

PERMIT SET 04.21.22

210300

M2.1

SECTION 1500 - MECHANICAL GENERAL PROVISIONS

1.1 DESCRIPTION:

- A. Division 15 shall be governed by all applicable provisions of the Contract Documents. The Mechanical Contractor shall furnish, install and connect all materials, equipment, apparatus, mechanical systems and incidentals required for complete and working installation. The Contractor shall supply all necessary labor, equipment, tools, insurance, taxes services; and The Contractor shall assume full responsibility for all obligations associated with completion of mechanical work as provided by the Contract Documents.

1.2 STANDARDS, REGULATIONS AND CODES:

- A. The work shall comply with the edition of the applicable standards, regulations and codes currently in force of all State and local authorities having jurisdiction. Where quantities, sizes, or other requirements indicated on the drawings or herein specified are in excess of the standard or code requirements, the specifications and/or drawings shall govern. In the absence of other applicable local codes, acceptable to the Architect/Engineer, the Uniform Plumbing and Mechanical Codes shall apply to this work.
- B. The Contractor shall comply with rules and regulations of public utilities and municipal departments affected by connections of services. The Contractor shall pay all fees associated therewith.
- C. The Mechanical Contractor shall be licensed to perform mechanical work in the municipality in which the project is located.
- D. All products and types of construction shall meet or exceed the latest edition of applicable standards of manufacturer, testing, performance and installation.

1.3 LOCAL CONDITIONS:

- A. The Contractor shall carefully examine the local conditions and existing installations and shall thoroughly familiarize himself with all existing conditions which may affect his work. The Contractor shall locate all existing utilities and protect them during the execution of the work.
- B. The Contractor shall examine the Architectural, Mechanical and Electrical Drawings and Specifications to familiarize himself with the type of construction, materials, and equipment to be used for all work and how it will affect the installation of his contract.

1.4 CUTTING AND PATCHING:

- A. All necessary cutting, drilling and patching shall be provided by this Contractor. Structural members shall not be disturbed without prior approval of the Architect. All areas disturbed by work performed under this Contract shall be neatly repaired and refinished to the condition of adjoining surfaces in a manner suitable to the Architect.

1.5 OPERATION DURING CONSTRUCTION:

- A. Mechanical equipment shall not be used during construction unless instructed by the General Contractor. The mechanical contractor is responsible for the installation and operation, service and maintenance of all new equipment during construction and prior to acceptance by the Owner of the completed project at additional costs to the GC and/or owner.
- B. Warranty periods shall not commence until final acceptance by the Owner/Substantial Completion.

1.6 SAFETY REGULATIONS:

- A. All Mechanical work shall be performed in compliance with all applicable governing safety regulations, including OSHA regulations. Provide safety lights, guards and signs required.

1.7 HOUSEKEEPING:

- A. The Contractor shall be responsible for keeping stocks of material and equipment stored on the premises in a neat and orderly manner.
- B. The Contractor shall clean and maintain his portion of the work as specified in the General Conditions.
- C. The Contractor shall remove from the premises all waste material present as a result of his work.

1.8 GRAPHIC REPRESENTATION AND JOB CONDITIONS:

- A. The drawings shall serve as working drawings for the general layout of the various items of equipment; are diagrammatic unless specifically dimensioned; and do not necessarily indicate every required item.
- B. The Architectural drawings take precedence over the mechanical drawings in the representation of the general construction work.
- C. Arrange work in a neat, well organized manner. Coordinate work with other trades involved.

1.9 GUARANTEES:

- A. The Contractor shall guarantee all work performed and materials and equipment furnished under this contract, against defects in materials and workmanship for a period of one year from the Date of the Owner's Final Acceptance of the Work, or as noted in each section.

1.10 MOTORS AND CONTROLS:

- A. All motors furnished under this specification shall be recognized manufacturer, of adequate capacity for the loads involved. All motors shall conform to the standards of manufacturer and performance of the National Electrical Manufacturers Association as shown in their latest publications.

1.11 PIPING IN ELECTRICAL ROOMS:

- A. No piping except specifically noted otherwise will be permitted in electrical rooms. In rooms, where piping is indicated over electrical equipment, a suitable galvanized sheetmetal pan or gutter piped to the drainage system shall be provided.

END OF SECTION  
SECTION 15100 - HEATING, VENTILATION AND AIR CONDITIONING

1.1 SCOPE:

- A. The work included under this contract consists of providing all labor, materials, tools, transportation, services, etc., necessary to complete the installation of the heating, ventilating, and air conditioning systems and other items herein listed and as described in these specifications, as illustrated in the accompanying drawings or as directed by the Architect.

1.2 SHEET METAL:

- A. Provide ductwork shown with necessary dampers. Construction of new galvanized prime grade steel sheets per ASHRAE and SMACNA Standards. Provide round or rectangular duct as indicated. Fabricate for the pressure and SMACNA seal class required.
- B. Flexible duct shall be Wiremold WCK or acceptable equal maximum length shall be 8' - 0" or as noted/detailed.
- C. All duct sizes shown are actual size and include liner, where required.

1.3 GRILLES, REGISTERS, INLETS AND OUTLETS:

- A. All supply grilles, registers and diffusers shall be as scheduled on the drawings and shall be ADC rated.

1.4 DUCTWORK ACCESSORIES:

- A. Provide single thickness turning vanes in all supply duct turns.
- B. Provide duct access doors for all internal mounted equipment.
- C. Provide 45° take-off fittings with volume damper for all round takeoffs to diffusers.
- D. Provide dampers where shown and required. Balance and control dampers shall be opposed blade except air mixing dampers shall be parallel blade.

1.5 AIR CONDITIONING UNITS:

- A. Air conditioning units shall be as scheduled. Units shall be standard catalogued products with the appropriate approval or certification by AGA, ARI and UL. Efficiencies shall conform to ASHRAE 90.1 standards.

1.6 FANS:

- A. Fans with accessories shall be as scheduled and shall be AMCA rated.

1.7 VIBRATION ISOLATION:

- A. Duct flexible connection shall be non-combustible, 16 ounce canvas. Piping flexible connection shall be Flexorics 401H or acceptable equal.

1.8 MISCELLANEOUS MECHANICAL EQUIPMENT:

- A. Provide constant, variable volume and/or fan powered boxes and accessories as scheduled. Acceptable manufacturers are E.H. Price or acceptable equal.


1.9 CLEANING:

- A. Clean system by operating at least three hours prior to final acceptance with temporary filters. Remove all filters and replace with clean.
- B. Use precleaned precharged refrigerant tube. Clean per manufacturers recommendations.

1.10 TESTING AND ADJUSTING:

- A. Contractor shall operate and test the air conditioning and ventilation systems and instruct the Owner in its operation. Perform a series of general capacity and operating tests. The tests shall demonstrate the specified capacities of various pieces of equipment.

END OF SECTION

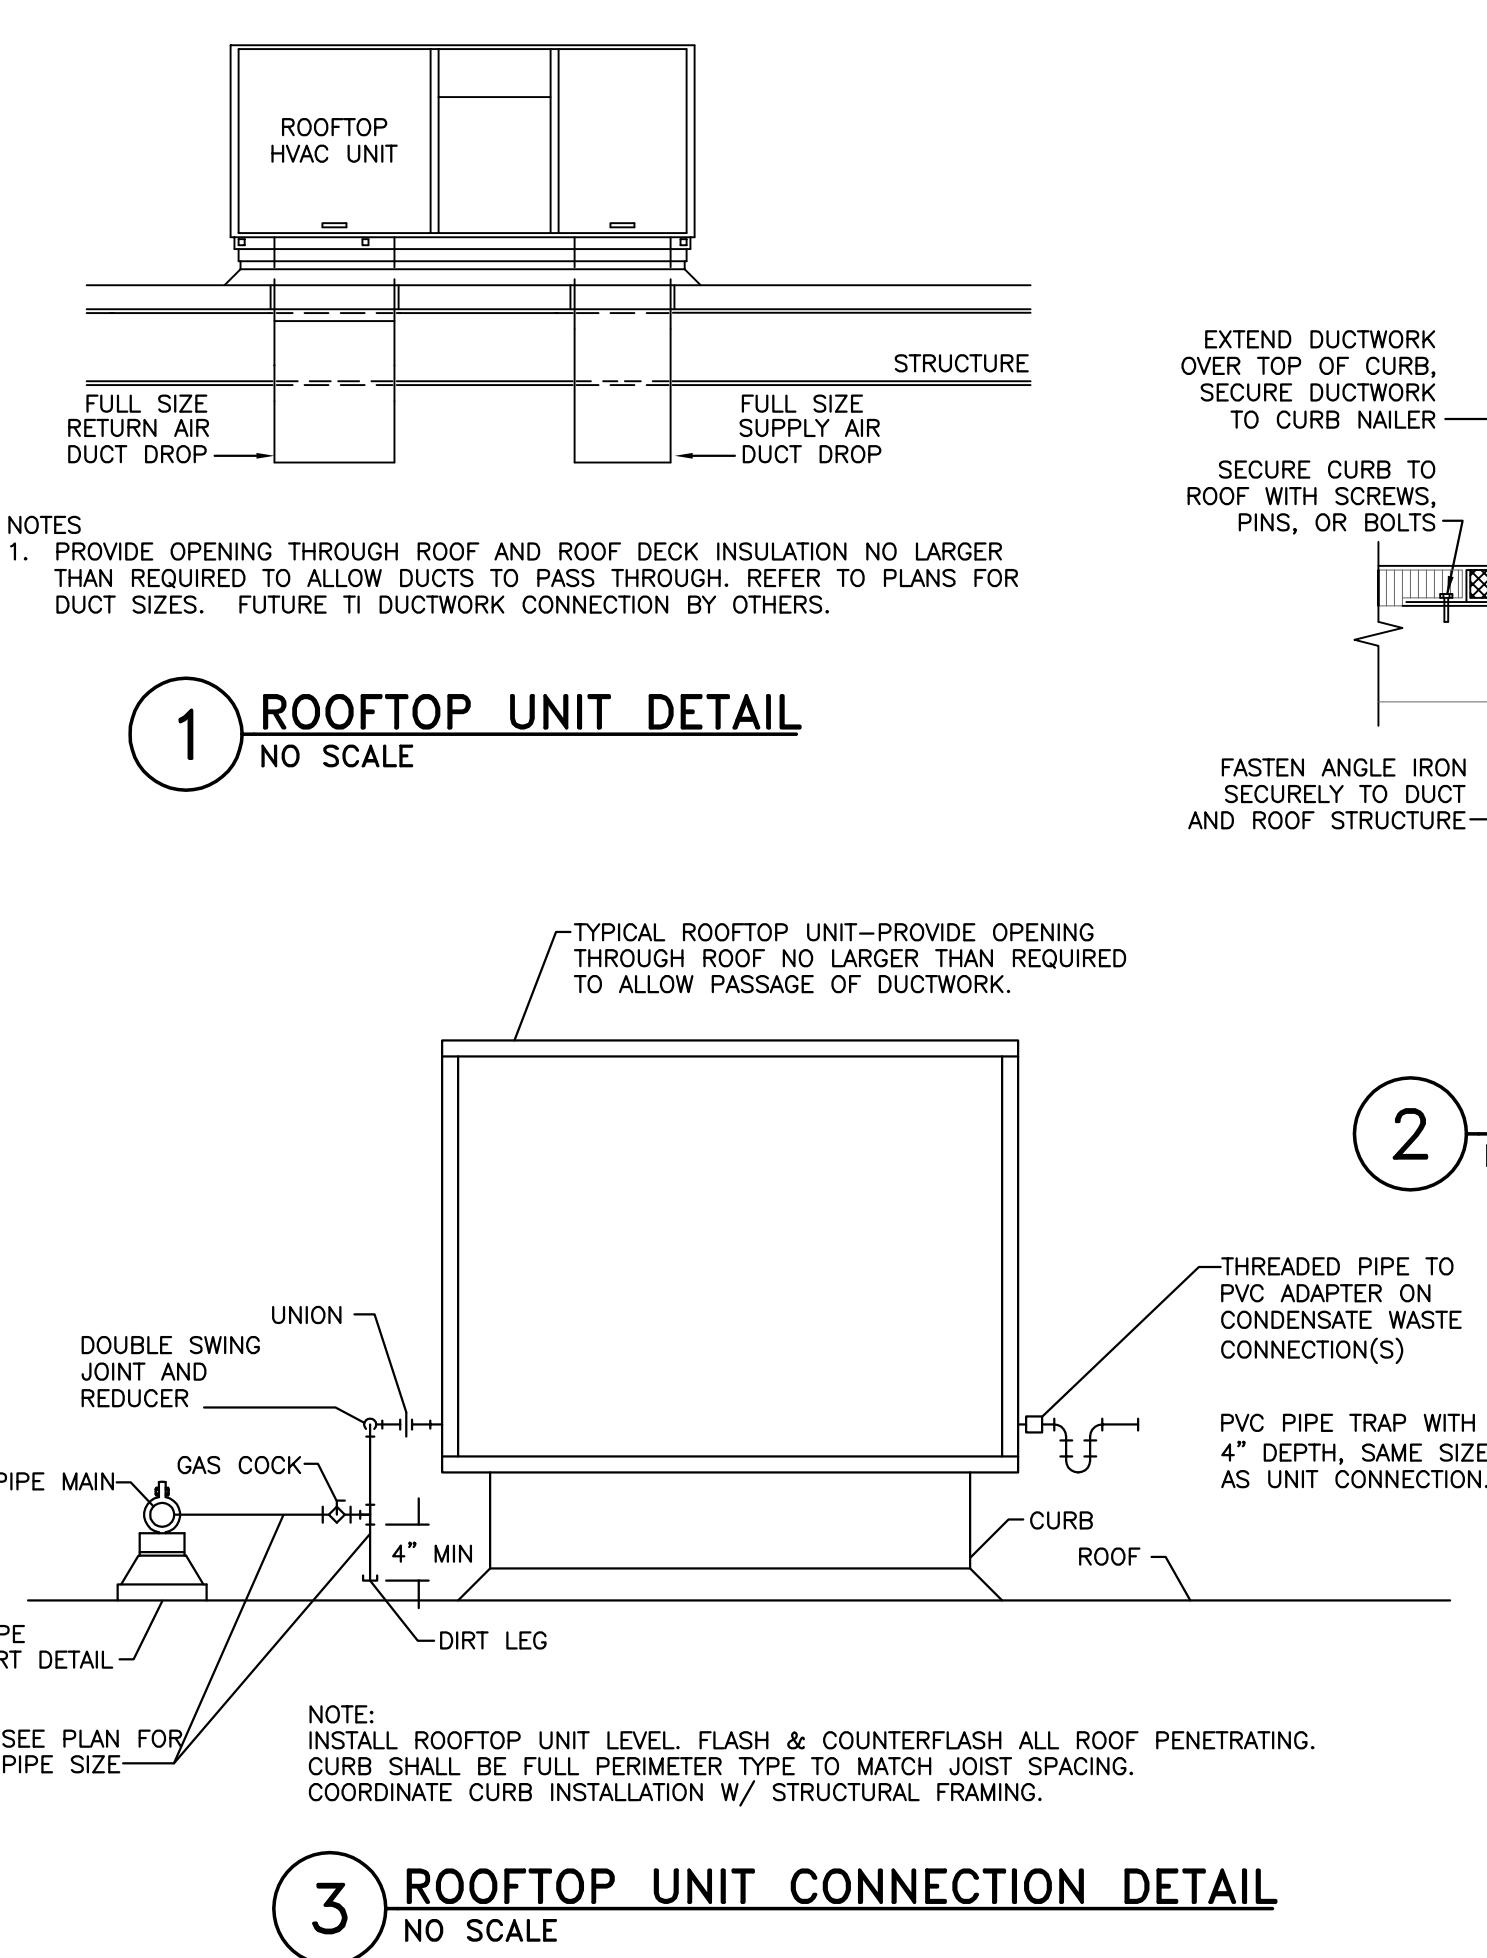

ROOFTOP UNIT - CONSTANT VOLUME WITH SINGLE SETPOINT CONTROL (ALL RTU'S)

1. DESCRIPTION:  
EACH SINGLE-ZONE PACKAGED ROOFTOP UNIT (RTU) WILL BE PROVIDED AS IDENTIFIED ON THE EQUIPMENT SCHEDULES, WITH DIRECT EXPANSION COOLING COIL, GAS HEAT, SINGLE-SPEED SUPPLY FAN, 2" FILTERS, ECONOMIZER, BAROMETRIC RELIEF, AND FIELD POWERED GFCI CONVENIENCE OUTLET. ECONOMIZERS SHALL BE 0-100% FULLY MODULATING WITH ENTHALPY CONTROL, LOW LEAK DAMPERS.

2. CONTROL:  
EACH UNIT SHALL BE FURNISHED WITH A THERMOSTAT TO BE INSTALLED IN THE SPACE. THE OCCUPANCY MODE SHALL BE DETERMINED THROUGH A USER-ADJUSTABLE PROGRAMMABLE SCHEDULE WITH OR WITHOUT USER OVERRIDE BUTTON ON THE THERMOSTAT.

3. SUPPLY AIR FAN:  
THE FAN MODE SHALL BE SELECTABLE FOR AUTO OR ON. WHEN AUTO IS SELECTED, THE FAN SHALL CYCLE ON AND OFF WITH HEATING OR COOLING. WHEN ON IS SELECTED, THE FAN SHALL OPERATE CONTINUOUS.

4. MECHANICAL COOLING:  
EACH RTU SHALL CYCLE COOLING COMPRESSOR STAGES IN RESPONSE TO COOLING DEMAND FROM THE THERMOSTAT. THE SUPPLY FAN WILL BE ENERGIZED (AUTO MODE) AND STAGE COOLING CAPACITY TO MAINTAIN SPACE TEMPERATURE SETPOINT BASED ON FACTORY CONTROL SEQUENCES. THE SPACE COOLING TEMPERATURE SETPOINT SHALL BE ADJUSTABLE THRU THE PROGRAMMABLE THERMOSTAT AND WILL BE SET-UP TO MAINTAIN TEMPERATURES PER TABLE 2.

5. GAS HEATING:  
THE RTU SHALL CYCLE GAS HEATING STAGES IN RESPONSE TO HEATING DEMAND FROM THE THERMOSTAT. ON A CALL FOR HEATING FROM THE ZONE SENSOR, THE SUPPLY FAN WILL BE ENERGIZED AND THE BURNER SHALL BE ENERGIZED TO MAINTAIN SPACE TEMPERATURE. THE SPACE HEATING TEMPERATURE SETPOINT SHALL BE ADJUSTABLE THRU THE PROGRAMMABLE THERMOSTAT AND WILL BE SET-UP TO MAINTAIN TEMPERATURES PER TABLE 2.

6. DEMAND CONTROL VENTILATION (BREAK ROOM RTU'S ONLY):  
THE SPACE MOUNTED CO2 SENSOR SHALL MONITOR THE SPACE AIR QUALITY. AS THE CO2 RISES ABOVE THE CO2 SETPOINT (700 PPM, ADJ.) THE OUTSIDE AIR DAMPER INCREASES ABOVE MINIMUM SETPOINT TO A MAXIMUM POSITION SET DURING BALANCING. AS CO2 LEVELS DECREASE, THE DAMPER MODULATES CLOSED. ONCE THE CO2 LEVEL IS BELOW THE CO2 SETPOINT, THE OUTSIDE AIR DAMPER SHALL RETURN TO THE MINIMUM POSITION.

7. ECONOMIZER - ENTHALPY:  
THE FACTORY RTU CONTROLLER WILL INDEX THE UNIT INTO ECONOMIZER MODE IF THE OUTDOOR AIR DRY BULB IS BELOW THE SETPOINT. WHEN ECONOMIZER MODE IS ENABLED, THE RETURN AND OUTSIDE AIR DAMPERS WILL MODULATE BETWEEN MINIMUM POSITION AND FULL OPEN AS NECESSARY TO MAINTAIN DISCHARGE AIR TEMPERATURE. THE RTU START-UP TECHNICIAN SHALL SET THE UNIT ECONOMIZER.

8. UNOCCUPIED MODE:  
DURING UNOCCUPIED MODE, THE UNIT SHALL CONTROL TO THE UNOCCUPIED MODE SETBACK TEMPERATURE. IF THE UNOCCUPIED SETPOINT IS EXCEEDED, THE RTU SHALL HEAT OR COOL UNTIL THE ZONE TEMPERATURE IS WITHIN THE UNOCCUPIED SETPOINTS, PLUS OR MINUS AN OFFSET OF 5°F (ADJ.).

9. BAROMETRIC RELIEF DAMPER:  
THE BAROMETRIC RELIEF DAMPER CONSISTS OF A GRAVITY DAMPER THAT WILL OPEN TO RELIEVE EXCESS AIR AS BUILDING PRESSURE INCREASES.

10. OUTSIDE AIR DAMPER:  
WHEN UNIT IS NOT IN ECONOMIZER MODE AND THE SUPPLY FAN IS IN OPERATION, THE OUTDOOR AIR DAMPER SHALL MODULATE TO THE MINIMUM PER THE UNIT SCHEDULE DURING THE OCCUPIED MODE. THE OUTDOOR AIR DAMPER SHALL BE CLOSED WHEN THE SUPPLY FAN IS OFF.

11. BALANCING WAREHOUSE RTU WITH 4-WAY DIFFUSER:  
BALANCING CONTRACTOR TO BALANCE WAREHOUSE RTU UTILIZING RPM AND MANUFACTURER'S FAN CURVE. INDIVIDUAL GRILLE AIRFLOW IS NOT REQUIRED. THE BALANCING CONTRACTOR SHALL ASSIST IN SETTING OUTDOOR AIR DAMPER POSITIONS.

12. SMOKE DETECTION CONTROL:  
UPON DETECTION OF SMOKE FROM THE RETURN DUCT SMOKE DETECTOR (BY OTHERS), THE FANS WILL CYCLE OFF AND OUTDOOR AIR DAMPERS SHALL CLOSE. ONCE THE DETECTORS ARE RESET, THE UNIT WILL RETURN TO NORMAL CONTROL. SMOKE DETECTOR INSTALLATION BY OTHERS, AS NECESSARY. IT IS THE RESPONSIBILITY OF THE FIRE ALARM CONTRACTOR TO WIRE THE SMOKE DETECTOR TO THE EMERGENCY SHUT DOWN OF THE RTU CONTROLLER.

IT / DATA / MDF ROOM DUCTLESS COOLING-ONLY SPLIT SYSTEM, WALL-MOUNTED (FCU-3)

1. DESCRIPTION:  
THE SYSTEM SHALL CONSIST OF A SINGLE-ZONE SPLIT SYSTEM WITH INDOOR FAN-COIL/HANDLING UNIT (FCU) AND COOLING-ONLY OUTDOOR CONDENSING UNIT (CU).

2. CONTROL:  
THE SPACE TEMPERATURE SHALL BE CONTROLLED IN A STAND-ALONE MODE BY MANUFACTURER SUPPLIED THERMOSTAT MOUNTED IN ROOM.

3. COOLING:  
THE AHU SHALL OPERATE CONTINUOUSLY. THE CU SHALL CYCLE CAPACITY AS NEEDED TO MAINTAIN THE SPACE TEMPERATURE OF 74°F (ADJ.).

EXHAUST FAN (EF-1/2/3)

1. CONTROL:  
THE EXHAUST FAN SHALL OPERATE CONTINUOUSLY AS INDICATED ON THE EXHAUST FAN EQUIPMENT SCHEDULE.

2. CONTINUOUS:  
THE EXHAUST FAN SHALL OPERATE CONTINUOUSLY (24/7). THE FAN MAY BE DE-ENERGIZED USING THE DISCONNECT SWITCH.

EXHAUST FAN (CEF-1) (TYP.)

1. CONTROL:  
THE EXHAUST FAN SHALL BE INTERLOCKED WITH THE RESTROOM LIGHT SWITCH, AS INDICATED ON THE EXHAUST FAN EQUIPMENT SCHEDULE.

2. ROOM LIGHT SWITCH:  
THE EXHAUST FAN SHALL BE INTERLOCKED WITH THE ROOM LIGHT CONTROL, OR WALL SWITCH AND SHALL BE ENERGIZED ANY TIME THE LIGHTS ARE ON IN THE ROOM. (WIRING BY OTHERS)

AIR CURTAIN (AC-A)

1. DESCRIPTION:  
EACH UNIT SHALL CONSIST OF A HEATED ELECTRIC AIR CURTAIN FOR ENVIRONMENTAL SEPARATION. UNIT SHALL BE PROVIDED WITH FACTORY-INSTALLED 24V TRANSFORMER, MAGNETIC DOOR LIMIT SWITCH, HEAT-OFF-FAN SWITCH, AND THERMOSTAT.

2. DOOR LIMIT CONTROL:  
AIR CURTAIN SHALL ENERGIZE AS DOOR BEGINS TO OPEN AS INDICATED BY THE MAGNETIC DOOR LIMIT SWITCHES. UNIT SHALL DE-ENERGIZE WHEN THE DOOR HAS CLOSED.


3. HEAT-OFF-FAN CONTROL:  
WHEN THE SWITCH IS IN THE OFF POSITION THE AIR CURTAIN IS INOPERABLE. IN THE HEAT POSITION, THE AIR CURTAIN WILL RUN WITH HEAT BASED ON THE LIMIT SWITCH OR THERMOSTAT. IN THE FAN POSITION, THE AIR CURTAIN WILL RUN WITHOUT HEAT BASED ON THE LIMIT SWITCH.

4. HEATING:  
AIR CURTAINS HAVING SINGLE (ONE-STAGE) HEATING ELEMENTS, ARE CONTROLLED BY A SINGLE STAGE THERMOSTAT. WHEN THE AIR CURTAIN CONTROL CIRCUIT CLOSSES, THE AIR CURTAIN FAN WILL RUN AND THROUGH INTERLOCKING, WILL ENABLE THE HEATER CIRCUIT ON A CALL FOR HEAT. THE THERMOSTAT WILL ENERGIZE THE HEATER CONTROL CONTACTOR. THE THERMOSTAT WILL THEN CYCLE THE HEATER AS NEEDED. AS LONG AS THE AIR CURTAIN CONTROL CIRCUIT IS CLOSED (FAN IS RUNNING), WHEN THE AIR CURTAIN CONTROL CIRCUIT OPENS, THE HEATER CIRCUIT IS DISABLED. THE HEATER WILL DE-ENERGIZE AND THE FAN WILL SHUT OFF.

THIS PRINT IS CONFIDENTIAL TO METRO AIR CONDITIONING CO.  
REPRODUCTION OR DISCLOSURE TO OUTSIDE PARTIES IS  
PROHIBITED WITHOUT OUR WRITTEN CONSENT.  
© 2022 METRO AIR CONDITIONING CO.


<b>MetroAir</b>		
LSCC BLDG. #1 - TI		
LEE'S SUMMIT, MO		
SCALE: AS NOTED	DATE: 5/9/22	DRAWN BY: M.D.K.
APPROVED BY: JDG	DWG #	M4
PROGRESS		of 5



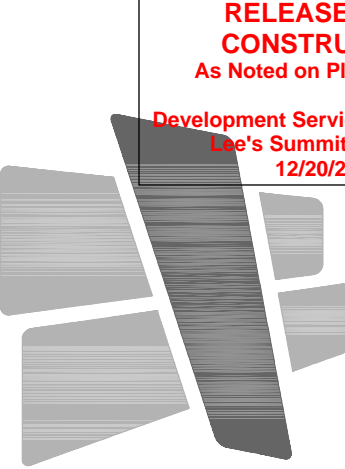

CURRAN  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



SCANNELL  
PROPERTIES

CERTIFICATION

THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY  
OF CURRAN ARCHITECTURE, AND ARE NOT  
TO BE USED OR REPRODUCED, WHOLE OR  
IN PART, WITHOUT THE WRITTEN  
CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES

PERMIT SET 04.21.22

210300

M3.1

## OUTSIDE AIR CALCULATIONS

UNIT SERVED	OCCUPANCY CLASSIFICATION	AREA (SQ. FT.)	PEOPLE PER 1,000 SQ. FT.	FIXED SEATING QUANTITY	QUANTITY OF PEOPLE	REQUIRED OUTSIDE AIR PER PERSON	REQUIRED OUTSIDE AIR PER SQ. FT.	TOTAL REQUIRED (CFM)	NOTES
RTU-A	WAREHOUSE	180,000	---	---	---	---	0.08	14,400	A
REQUIRED VENTILATION								14,400 CFM	B

NOTES:  
A. VALUES TAKEN FROM ASHRAE 62.1-2010 - VENTILATION FOR ACCEPTABLE INDOOR AIR QUALITY.  
B. TOTAL VENTILATION FOR WAREHOUSE TO BE DIVIDED AMONG ALL RTU-A. REFER TO EQUIPMENT SCHEDULE FOR ACTUAL AMOUNT.

## ROOFTOP UNIT SCHEDULE (NATURAL GAS HEAT)

MARK	MANUFACTURER	MODEL	SERVICE	QUANTITY	NOMINAL TONNAGE	SUPPLY FAN			HP	COOLING COIL		GAS HEATING COIL			ELECTRIC HEATING		MCA	MOCP	V/PH	WEIGHT (LBS) W/ CURB	MIN. OUTSIDE AIR (CFM)	MAX. OUTSIDE AIR (CFM)	MIN. EER	NOTES
						CFM	ESP (IN)	MODE		TH (MBH)	SH (MBH)	INPUT (MBH)	OUTPUT (MBH)	STAGES	INPUT (KW)	STAGES								
RTU-A	TRANE	YSD300G4RHC	WAREHOUSE	19	25	9,000	0.50	CV	7.5	300	234	400	320	2	---	---	56	70	460/3	3,200	800	800	10.0	A - H
RTU-1	TRANE	YSC080	MAIN OFFICE	1	5	1,975	0.75	CV	1.0	60	48	100	81	2	---	---	15	20	460/3	1,200	200	200	12.0	A - H
RTU-2	TRANE	YSC080	MAIN OFFICE	1	5	1,950	0.75	CV	1.0	60	48	100	81	2	---	---	15	20	460/3	1,200	175	175	12.0	A - H
RTU-3	TRANE	YSC080	MAIN OFFICE	1	5	2,000	0.75	CV	1.0	60	48	100	81	2	---	---	15	20	460/3	1,200	300	300	12.0	A - H
RTU-4	TRANE	YSC092F	MAIN OFFICE	1	7.5	2,750	0.75	CV	2.0	90	63	150	120	2	---	---	18	20	460/3	1,700	450	450	11.0	A - H
RTU-5	TRANE	TSC036G4RBA	MAINTENANCE	1	3	1,000	0.50	CV	0.5	35	26	60	48	1	12	2	21	25	460/3	1,000	70	70	12.0	A - H

NOTES:  
A. STARTERS FOR ALL MOTORS SHALL BE FURNISHED INTEGRAL WITH UNIT.  
B. EQUIPMENT SIZED FOR 100 DEGREE F AMBIENT TEMPERATURE.  
C. PROVIDE 2", 30% EFFICIENT PLEATED THROWAWAY AIR FILTERS.  
D. PROVIDE MANUFACTURER'S STANDARD SRPING VIBRATION ISOLATION ROOF CURB WITH MINIMUM HEIGHT OF 14".  
E. PROVIDE FACTORY MOUNTED DISCONNECT SWITCH, FIELD POWERED GFI OUTLET AND HAIL GUARDS.  
F. PROVIDE WITH TRANE AIRFI CONTROLS TO INTEGRATE INTO BAS.  
G. PROVIDE ENTHALPY ECONOMIZER WITH BAROMETRIC RELIEF DAMPER.  
H. ELECTRICAL/FIRE ALARM CONTRACTOR TO FURNISH AND INSTALL SMOKE DETECTOR IN RETURN AIR DUCT.  
J. PROVIDE WITH HOT-GAS REHEAT COIL, DEHUMIDIFICATION CONTROLS AND WALL MOUNTED CO2 SENSOR. CO2 SENSOR TO MODULATE OA FROM MINIMUM TO MAXIMUM AIRFLOWS.  
K. PROVIDE WITH VARIABLE FREQUENCY DRIVE FOR SINGLE ZONE VAV OPERATION.  
L. UNIT SHALL BE VVT. PROVIDE WITH BYPASS DAMPER AND REQUIRED CONTROLS FOR PROPER OPERATION.  
M. PROVIDE WITH CO2 SENSOR MOUNTED AS SHOWN ON PLANS (WALL OR DUCT MOUNT) AND MODULATE VENTILATION FROM MINIMUM TO MAXIMUM SCHEDULED VALUES.

## COOLER/FREEZER EQUIPMENT SCHEDULE

MARK	MANUFACTURER	MODEL	SERVICE	QUANTITY	TYPE	SUPPLY FAN(S)			PIPING CONNECTIONS			ELECTRICAL			WEIGHT	HEIGHT W/ O RAILS	NOTES
						CFM	HP	QTY.	LIQUID	SUCTION	CONDENSATE	MCA	MOCP	V/PH			
CFU-1	HEATCRAFT/BOHN	BCH0075LDA CD	(-) 10 F FREEZER	1	CONDENSING UNIT	---	7.5	---	7/8"	1-5/8"	---	38	40	460/3	1,000	40"	A - D
EVAP-1	HEATCRAFT/LARKIN	3EM0325MS4EMA		1	EVAPORATOR	7,100	1/4	3	1-1/8"	1-5/8"	3/4"	18	---	460/1	300	30"	A - B
CFU-2	HEATCRAFT/BOHN	BCH0075LDA CD	(-) 10 F FREEZER	1	CONDENSING UNIT	---	7.5	---	7/8"	1-5/8"	---	38	40	460/3	1,000	40"	A - D
EVAP-2	HEATCRAFT/LARKIN	3EM0325MS4EMA		1	EVAPORATOR	7,100	1/4	3	1-1/8"	1-5/8"	3/4"	18	---	460/1	300	30"	A - B
CCU-1	HEATCRAFT/BOHN	BCD0400MDA CD	(+) 38 F COOLER	1	CONDENSING UNIT	---	40	---	1-5/8" x (2)	2-1/8" x (2)	---	142	150	460/3	4,500	56"	A - D
EV-1A	HEATCRAFT/BOHN	BHA 1400SA		1	EVAPORATOR	20,700	1	3	1-5/8"	2-1/8"	1-1/4"	7	---	460/3	800	51"	A - B, E
EV-1B	HEATCRAFT/BOHN	BHA 1400SA		1	EVAPORATOR	20,700	1	3	1-5/8"	2-1/8"	1-1/4"	7	---	460/3	800	51"	A - B, E
CCU-2	HEATCRAFT/BOHN	BCD0400MDA CD	(+) 38 F COOLER	1	CONDENSING UNIT	---	40	---	1-5/8" x (2)	2-1/8" x (2)	---	142	150	460/3	4,500	56"	A - D
EV-2A	HEATCRAFT/BOHN	BHA 1400SA		1	EVAPORATOR	20,700	1	3	1-5/8"	2-1/8"	1-1/4"	7	---	460/3	800	51"	A - B, E
EV-2B	HEATCRAFT/BOHN	BHA 1400SA		1	EVAPORATOR	20,700	1	3	1-5/8"	2-1/8"	1-1/4"	7	---	460/3	800	51"	A - B, E
CCU-3	HEATCRAFT/BOHN	BCD0400MDA CD	(+) 38 F COOLER	1	CONDENSING UNIT	---	40	---	1-5/8" x (2)	2-1/8" x (2)	---	142	150	460/3	4,500	56"	A - D
EV-3A	HEATCRAFT/BOHN	BHA 1400SA		1	EVAPORATOR	20,700	1	3	1-5/8"	2-1/8"	1-1/4"	7	---	460/3	800	51"	A - B, E
EV-3B	HEATCRAFT/BOHN	BHA 1400SA		1	EVAPORATOR	20,700	1	3	1-5/8"	2-1/8"	1-1/4"	7	---	460/3	800	51"	A - B, E
CCU-4	HEATCRAFT/BOHN	BCD0400MDA CD	(+) 38 F COOLER	1	CONDENSING UNIT	---	40	---	1-5/8" x (2)	2-1/8" x (2)	---	142	150	460/3	4,500	56"	A - D
EV-4A	HEATCRAFT/BOHN	BHA 1400SA		1	EVAPORATOR	20,700	1	3	1-5/8"	2-1/8"	1-1/4"	7	---	460/3	800	51"	A - B, E
EV-4B	HEATCRAFT/BOHN	BHA 1400SA		1	EVAPORATOR	20,700	1	3	1-5/8"	2-1/8"	1-1/4"	7	---	460/3	800	51"	A - B, E

NOTES:  
A. PROVIDE LOW AMBIENT CONTROL AND R448A REFRIGERANT AND 5YR COMPRESSOR WARRANTY.  
B. EQUIPMENT SIZED FOR 100 DEGREE F AMBIENT TEMPERATURE.  
C. PROVIDE WITH HEATCRAFT VANTAGE AUTO-ROTATE THERMOSTAT CONTROLLER FOR REFRGERATION SYSTEM. PROVIDE WITH TEMPERATURE SENSORS FOR MOUNTING IN COOLER/FREEZER UNIT SHALL BE PROGRAMMED TO CALL OUT DURING TEMPERATURE ALARMS.  
D. ADD 16" EQUIPMENT SUPPORT RAILS TO CALCULATE OVERALL EQUIPMENT HEIGHT ON ROOF.  
E. PROVIDE WITH HIGH AIRFLOW COLLAR.

## OUTSIDE AIR CALCULATIONS

UNIT SERVED	OCCUPANCY CLASSIFICATION	AREA (SQ. FT.)	PEOPLE PER 1,000	FIXED SEATING QUANTITY	QUANTITY OF PEOPLE	REQUIRED OUTSIDE AIR PER PERSON	REQUIRED OUTSIDE AIR PER SF	TOTAL REQUIRED AIRFLOW	NOTES
RTU-1	OFFICE	470	7	---	3	5	0.06	45	A
	CORRIDOR	105	---	---	---	---	0.06	6	A
	CONFERENCE	385	50	---	19	5	0.06	119	A
REQUIRED VENTILATION								170 CFM	C
RTU-2	OFFICE	1,390	7	---	10	5	0.06	132	A
	CORRIDOR	340	---	---	---	---	0.06	20	A
REQUIRED VENTILATION								152 CFM	C
RTU-3	CONFERENCE	1,280	50	43	64	5	0.06	292	A
REQUIRED VENTILATION								292 CFM	C
RTU-4	BREAK ROOM	1,250	25	60	31	5	0.06	375	A
	RESTROOMS	950	---	---	---	---	0.06	57	A
REQUIRED VENTILATION								432 CFM	C
FCU-1	OFFICE	105	7	---	1	5	0.06	10	A
	RESTROOMS	70	---	---	---	---	0.06	4	A
REQUIRED VENTILATION								14 CFM	D
FCU-2	OFFICE	105	7	---	1	5	0.06	10	A
	RESTROOMS	70	---	---	---	---	0.06	4	A
REQUIRED VENTILATION								14 CFM	D
FCU-4	OFFICE	600	7	---	4	5	0.06	57	A
REQUIRED VENTILATION								57 CFM	C

NOTES:  
A. VENTILATION RATES ARE TAKEN FROM ASHRAE 62.1-2010 - VENTILATION FOR ACCEPTABLE INDOOR AIR QUALITY.  
B. VENTILATION IS BASED ON TOTAL QUANTITY OF PEOPLE TAKEN FROM NUMBER OF ACTUAL SEATING SHOWN ON ARCHITECTURAL FLOOR PLAN.  
C. REFER TO RTU SCHEDULE FOR ACTUAL VENTILATION AIRFLOWS.  
D. VENTILATION PROVIDED BY OPERABLE DOORS.

## DUCTLESS SPLIT SYSTEM EQUIPMENT SCHEDULE

MARK	MANUFACTURER	MODEL	TYPE	SUPPLY FAN		COOLING COIL		ELECTRICAL			VENTILATION (CFM)	WEIGHT (LBS)	NOTES
				CFM	ESP (IN)	TH (MBH)	SH (MBH)	MCA	MOCP	V/PH			
FCU-1	LENNOX	M22A012S4-2P	CEILING MOUNT CASSETTE	400	---	12	8	1	---	---	---	45	F, G
CU-1	LENNOX	MPB012S4S-1P	CONDENSING UNIT	---	---	---	---	12	15	208/1	---	150	A - E
FCU-2	LENNOX	M22A012S4-2P	CEILING MOUNT CASSETTE	400	---	12	8	1	---	---	---	45	F, G
CU-2	LENNOX	MPB012S4S-1P	CONDENSING UNIT	---	---	---	---	12	15	208/1	---	150	A - E
FCU-3	LENNOX	MWMA036S4	WALL MOUNT FAN-COIL	1,000	---	36	28	1	---	---	---	45	F
CU-3	LENNOX	MPB036S4S	CONDENSING UNIT	---	---	---	---	35	50	208/1	---	250	A - E

NOTES:  
A. PROVIDE WITH WIRELESS TEMPERATURE CONTROLLER AND LOW-AMBIENT WIND BAFFLE KIT.  
B. FAN-COIL TO BE POWERED FROM CONDENSING UNIT POWER CIRCUIT. REFER TO INSTALLATION INSTRUCTIONS.  
C. INSTALL CONDENSING UNIT ON TREATED 4X4 WOOD BLOCKING.  
D. PROVIDE WITH 50'-0" PRE-INSULATED LINESET AS REQUIRED.  
E. ELECTRICAL CONTRACTOR TO PROVIDE ASSOCIATED POWER WIRING BETWEEN CU AND FCU.  
F. PROVIDE WITH CONDENSATE PUMP AND DISCHARGE. CONDENSATE PER PLANS AS REQUIRED.  
G. VENTILATION PROVIDED BY OPERABLE DOORS.

## GRILLE, REGISTER & DIFFUSER SCHEDULE

MARK	MANUFACTURER	MODEL	TYPE	SIZE	MOUNTING	FINISH	MATERIAL	NOTES
SD-1	PRICE	SPD	SQUARE PLAQUE	24" x 24"	LAY-IN	WHITE	STEEL	
SD-2	PRICE	SPD	SQUARE PLAQUE	24" x 24"	SURFACE	WHITE	STEEL	B
SD-3	PRICE	SPD	SQUARE PLAQUE	12" x 12"	LAY-IN	WHITE	STEEL	
SD-4	PRICE	SPD	SQUARE PLAQUE	12" x 12"	SURFACE	WHITE	STEEL	B
VAV-1	PRICE	VARITHERM	VAV	24" x 24"	LAY-IN	WHITE	STEEL	
LSD-1	PRICE	TBD	LINEAR SLOT	4'-0" X (4) 1" SLOT	LAY-IN	WHITE	STEEL	H
SG-1	PRICE	520DL	WALL MOUNT	AS NOTED	WALL/DUCT	WHITE	STEEL	A
SG-2	PRICE	SDGE	SPIRAL MOUNT	AS NOTED	DUCT	MILL	STEEL	A, C
RG-1	PRICE	PDDR	PERFORATED	24" x 24"	LAY-IN	WHITE	STEEL	
RG-2	PRICE	PDDR	PERFORATED	12" x 24"	LAY-IN	WHITE	STEEL	
RG-3	PRICE	530DL	WALL MOUNT	AS NOTED	WALL/DUCT	WHITE	STEEL	
EX-1	PRICE	APDDR	PERFORATED	24" x 24"	SURFACE	WHITE	ALUMINUM	A, B
EX-2	PRICE	APDDR	PERFORATED	24" x 24"	LAY-IN	WHITE	ALUMINUM	
EX-3	PRICE	APDDR	PERFORATED	12" x 12"	LAY-IN	WHITE	ALUMINUM	

NOTES:  
A. PROVIDE WITH DAMPER OPERABLE FROM FACE OF DEVICE.  
B. PROVIDE WITH SURFACE MOUNT FRAME KIT FOR MOUNTING IN HARD CEILING/WALL.  
C. PROVIDE WITH OPPOSED BLADE DAMPER AND MILL FINISH.  
D. PERFORATED SUPPLY AIR GRILLE TO BE INSTALLED WITHOUT DEFLECTORS.  
E. PROVIDE WITH 2KW ELECTRIC HEAT, WALL MOUNTED WIRELESS THERMOSTAT.  
F. PROVIDE WITH RETURN AIR LIGHT SHIELD.  
G. PROVIDE WITH INSULATED BACKING.  
H. PROVIDE WITH FACTORY INSULATED SUPPLY PLENUM.

## EXHAUST FAN SCHEDULE

MARK	MANUFACTURER	MODEL	LOCATION/ MOUNTING	SERVICE	FAN			HP/WATTS	ELECTRICAL (V/PH)	WEIGHT (LBS)	NOTES
					CFM	ESP (IN)	RPM				
EF-A	GREENHECK	G-090	ROOF	RESTROOM EXHAUST	800	0.5	1435	1/4	120/1	100	A, B, E
EF-B	GREENHECK	GB-220	ROOF	RESTROOM EXHAUST	2,000	0.375	1600	3/4	120/1	150	A, B, C, J
CEF-1	GREENHECK	SPA-190	CEILING	RESTROOM EXHAUST	150	0.25	800	50	120/1	25	A, E, H
CEF-2	GREENHECK	SPA-090	CEILING	RESTROOM EXHAUST	75	0.25	800	50	120/1	25	A, E, H

NOTES:  
A. PROVIDE FACTORY MOUNTED DISCONNECT SWITCH.  
B. PROVIDE WITH 14" INSULATED ROOF CURB, BACKDRAFT DAMPER AND INSECT SCREEN.  
C. FAN TO RUN CONTINUOUSLY.  
D. FURNISH WITH WALL MOUNTED LINE VOLTAGE THERMOSTAT. THERMOSTAT TO BE INSTALLED BY ELECTRICAL CONTRACTOR.  
E. INTERLOCK EXHAUST FAN WITH LIGHTSWITCH.  
F. FAN TO BE CONTROLLED BY WALL MOUNTED SWITCH.  
G. PROVIDE WITH REQUIRED ACCESSORIES FOR GREASE EXHAUST. FAN TO BE CONTROLLED BY HOOD MOUNTED SWITCH.  
H. PROVIDE WITH UNIT MOUNTED SPEED CONTROLLER, HANGING BRACKET, BACKDRAFT DAMPER AND INLET GUARD.  
J. FAN TO BE EXPLOSION PROOF.








**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



**SCANNELL**  
PROPERTIES

8/31/2022



LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

PERMIT SET 08.31.22

210300

PLUMBING PLAN

P1.0

PLUMBING GENERAL NOTES:

1. INSTALL ALL PIPE, ETC. AS HIGH AS POSSIBLE.
2. COORDINATE ALL WORK WITH OTHER TRADES AND EXISTING CONDITIONS AS REQUIRED TO PROPERLY INSTALL ALL SYSTEMS AS INTENDED, WITHIN THE CONFINES OF THE SPACES AVAILABLE, AND WITHOUT INTERFERENCES.
3. REFER TO ARCHITECTURAL DRAWINGS FOR EXACT LOCATIONS AND MOUNTING HEIGHTS OF FIXTURES.
4. SAWCUT EXISTING FLOOR AS REQUIRED FOR INSTALLATION OF UNDERFLOOR PIPING. PATCH FLOOR TO MATCH EXISTING.
5. NO PIPING SHALL BE ROUTED OVER THE TOP OF ELECTRICAL PANELS.
6. ALL MATERIALS WITHIN PLENUMS SHALL BE NONCOMBUSTIBLE OR SHALL HAVE A FLAME SPREAD INDEX OF NOT MORE THAN 25 AND A SMOKE-DEVELOPED INDEX OF NOT MORE THAN 50 WHEN TESTED IN ACCORDANCE WITH ASTM E 84.


PLUMBING PLAN NOTES:

1. REFER TO ENLARGED PLUMBING PLAN ON SHEET P1.2 FOR CONTINUATION.
2. CONNECT WASTE TO EXISTING SANITARY SEWER AS REQUIRED. VERIFY EXACT LOCATION AND ELEVATION PRIOR TO INSTALLATION OF ANY PIPING.
3. CONNECT WATER TO EXISTING DOMESTIC WATER AS REQUIRED. VERIFY EXACT LOCATION PRIOR TO INSTALLATION OF ANY PIPING.
4. CONNECT GAS TO EXISTING NATURAL GAS AS REQUIRED. VERIFY EXACT SIZE, LOCATION AND PRESSURE PRIOR TO INSTALLATION OF ANY PIPING.
5. CONNECT GAS TO EQUIPMENT AS REQUIRED AND AS DETAILED. GAS PRESSURE REGULATOR SHALL BE ON ROOF.
6. INSTALL ROOF HYDRANT AS REQUIRED.
7. LOCATION OF 3" VTR. VERIFY 10' CLEARANCE FROM ALL OUTDOOR AIR INTAKES. COORDINATE WITH GENERAL CONTRACTOR TO SEAL PENETRATION WEATHERTIGHT.
8. INSTALL HOSE BIBB AS REQUIRED.
9. INSTALL HUB DRAIN AS REQUIRED.

PLUMBING SYMBOLS

- SOIL AND WASTE PIPING BELOW FLOOR/GRADE
- SOIL AND WASTE PIPING ABOVE FLOOR/GRADE
- SANITARY VENT PIPING ABOVE GRADE
- SANITARY VENT PIPING BELOW GRADE
- DOMESTIC COLD WATER PIPING
- DOMESTIC HOT WATER PIPING
- DOMESTIC HOT WATER RECIRCULATION PIPING
- GAS PIPING
- EQUIPMENT DRAIN LINE
- COMPRESSED AIR PIPING BELOW FLOOR
- PIPING TURNING DOWN
- PIPING TURNING UP
- TEE TOP CONNECTION
- UNION
- BACKFLOW PREVENTER
- FLOOR DRAIN
- FLOOR CLEAN OUT
- WALL CLEAN OUT
- GRADE CLEAN OUT
- VALVE
- BALANCING VALVE
- SOLENOID VALVE
- PRESSURE REGULATOR
- CHECK VALVE
- CONNECT TO EXISTING
- I.E. INVERT ELEVATION OF PIPE
- MATCH MARKS ON PLUMBING RISER DIAGRAM
- CONTROL WIRING
- REFRIGERANT PIPING
- CHECK VALVE
- THERMOMETER
- PRESSURE GAUGE
- TEMPERATURE AND PRESSURE RELIEF VALVE
- PETE'S PLUG
- Y STRAINER
- VACUUM RELIEF VALVE

ALL STORM PIPING IS EXISTING TO REMAIN.

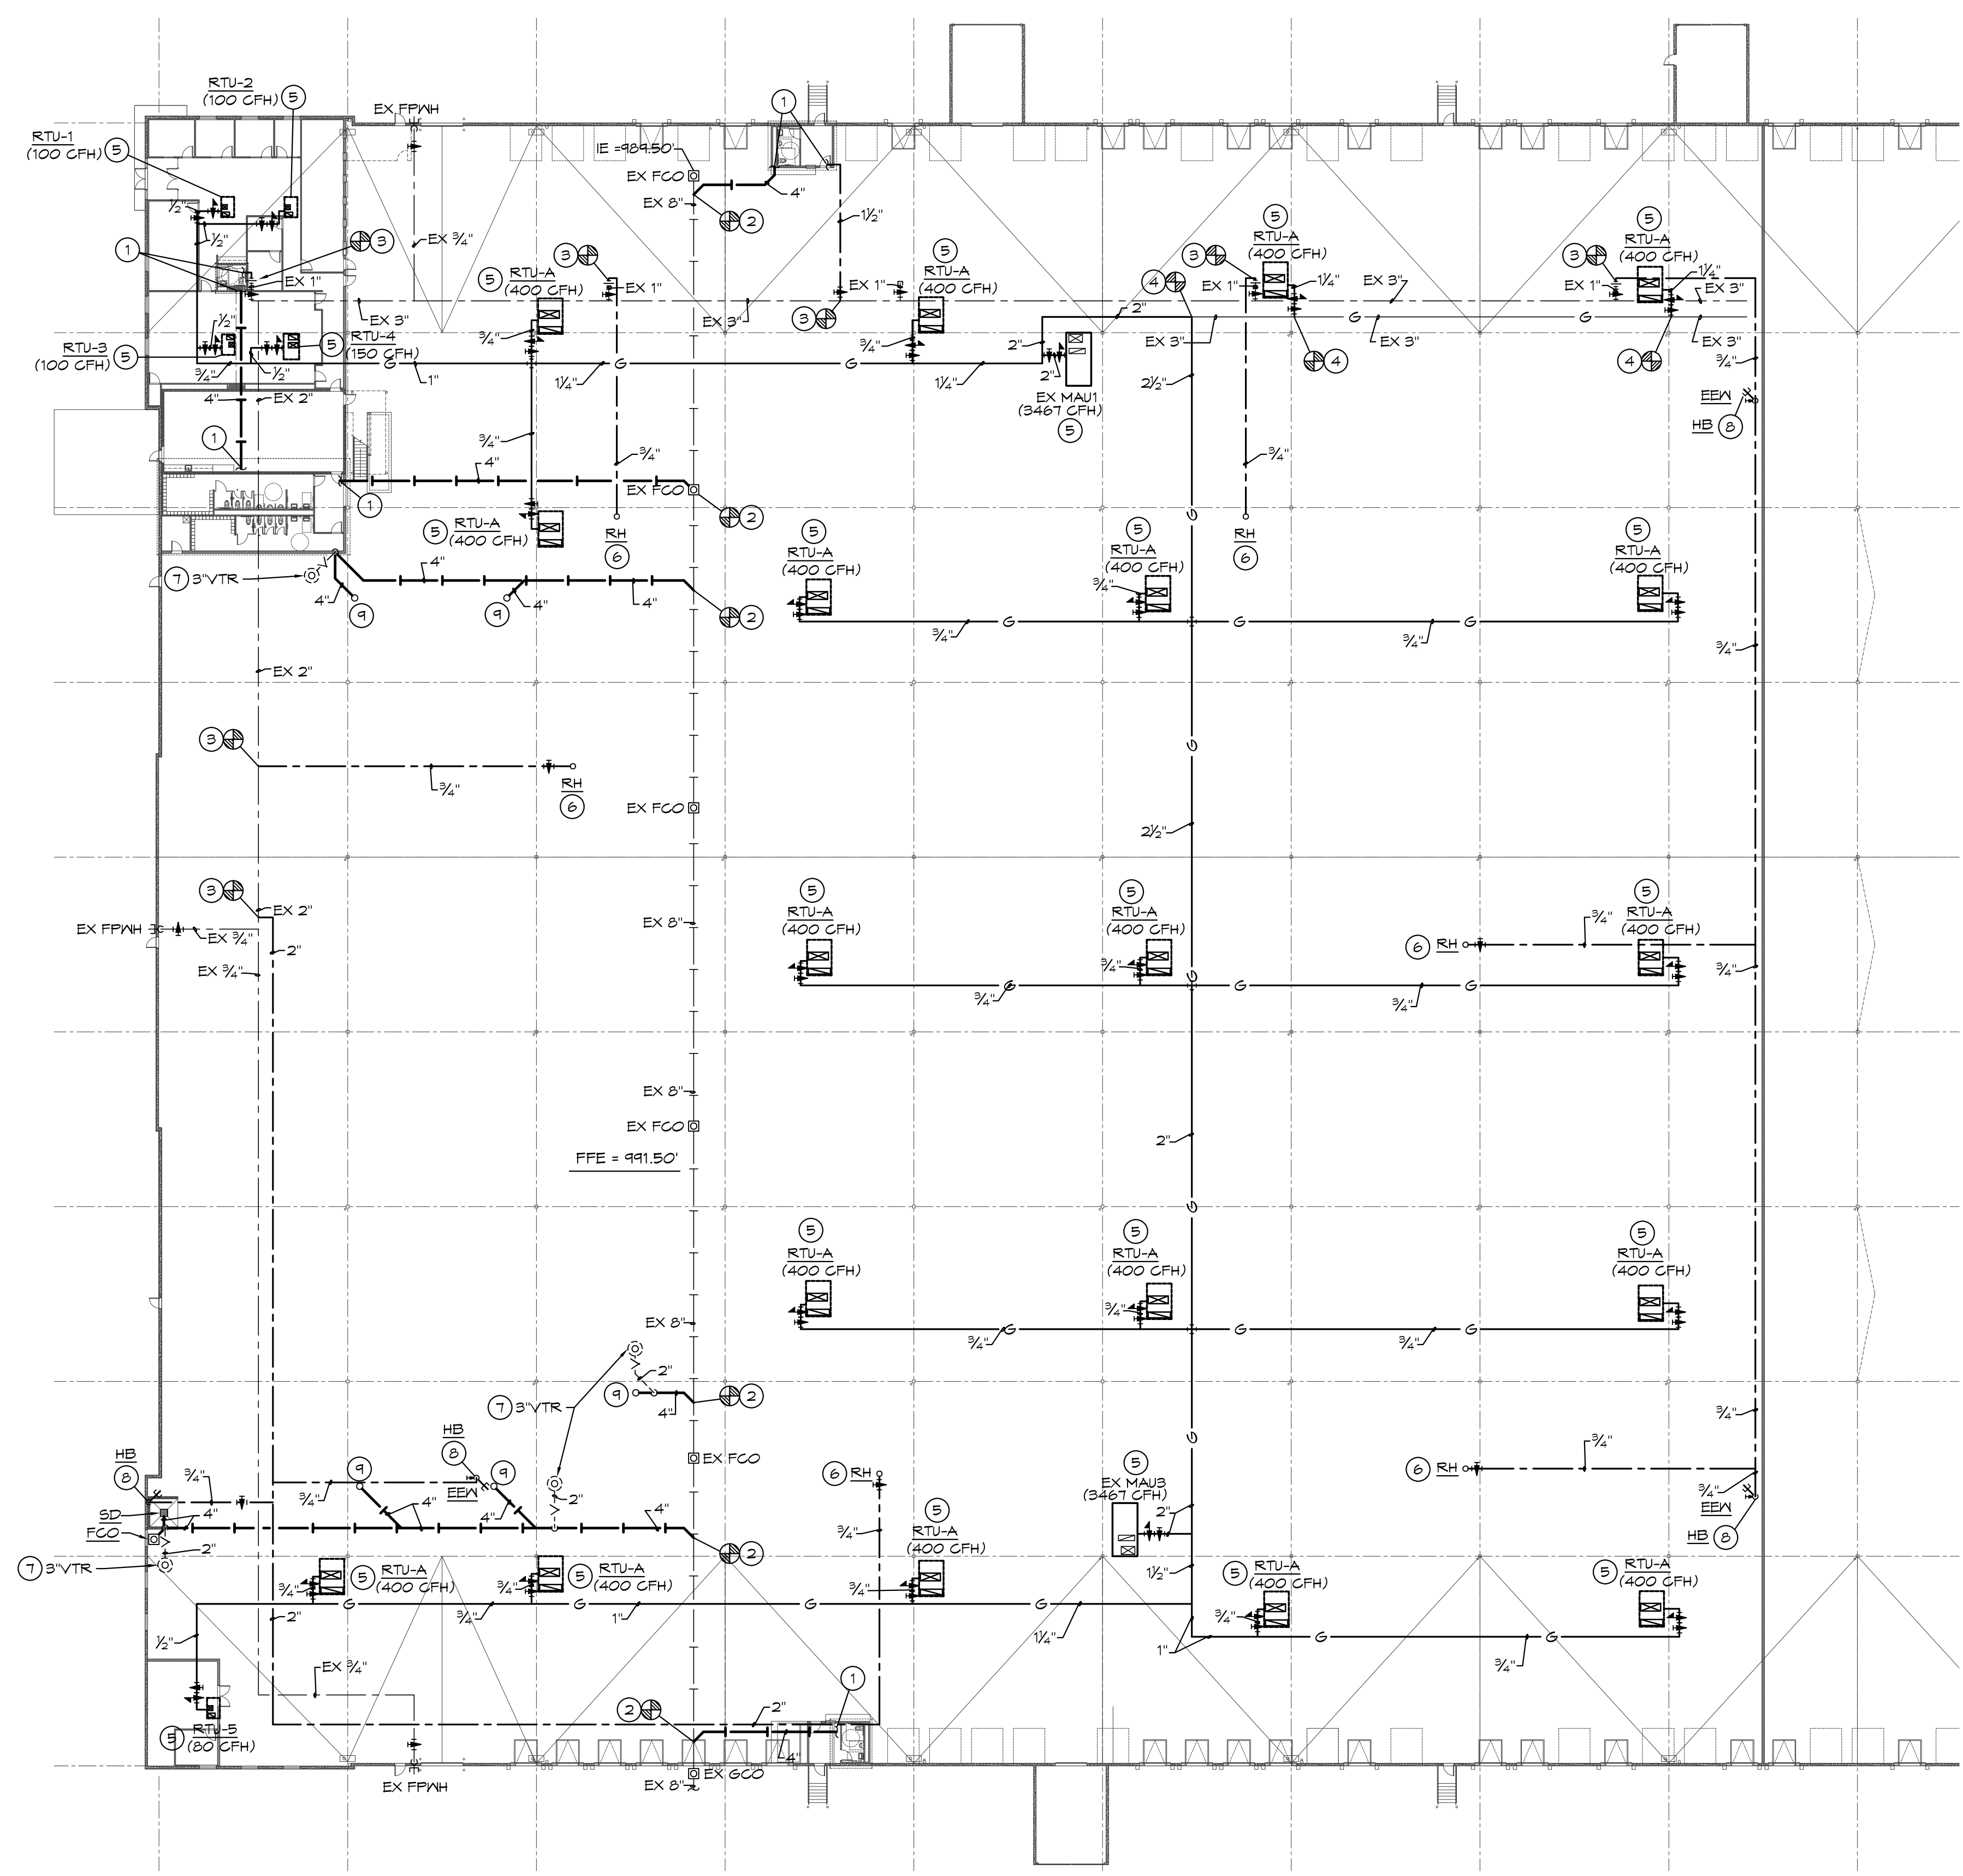

**PARTIAL PLUMBING FLOOR PLAN**  
SCALE: 1" = 30'-0" FFE = 991.50'

**CENTRAL**  
PLUMBING, HEATING & AIR CONDITIONING, INC.  
201 East Walnut  
Cleveland, MO 64734  
816-942-6355

BC PROJECT #22208  
MISSOURI PE COA #2009003629  
This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on the project only. Pursuant to the Architecture-Engineers Copyright Protection Act of 1980, all drawings, specifications, plans and designs, including the overall form, arrangement and composition of figures and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2022 BC Engineers, Inc.

**BC ENGINEERS**  
INCORPORATED  
5720 Reeder Shawnee, KS 66203 (913)262-1772





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

8/31/2022



LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

PERMIT SET 08.31.22


210300

COMPRESSED AIR PLAN

P1.1

**PLUMBING PLAN NOTES:**

- ① AIR PIPE WITH SHUT OFF VALVE DOWN TO AIR COMPRESSOR AND REGULATOR FURNISHED BY OTHERS. VERIFY EXACT LOCATION OF AIR CONNECTION AND COMPRESSED AIR REQUIREMENTS WITH MANUFACTURER'S SPECIFICATIONS.
- ② AIR PIPE WITH SHUT OFF VALVE 4'-0" AFF. SUPPORT AS REQUIRED.
- ③ AIR PIPE WITH SHUT OFF VALVE ABOVE ROOF. SUPPORT AS REQUIRED.

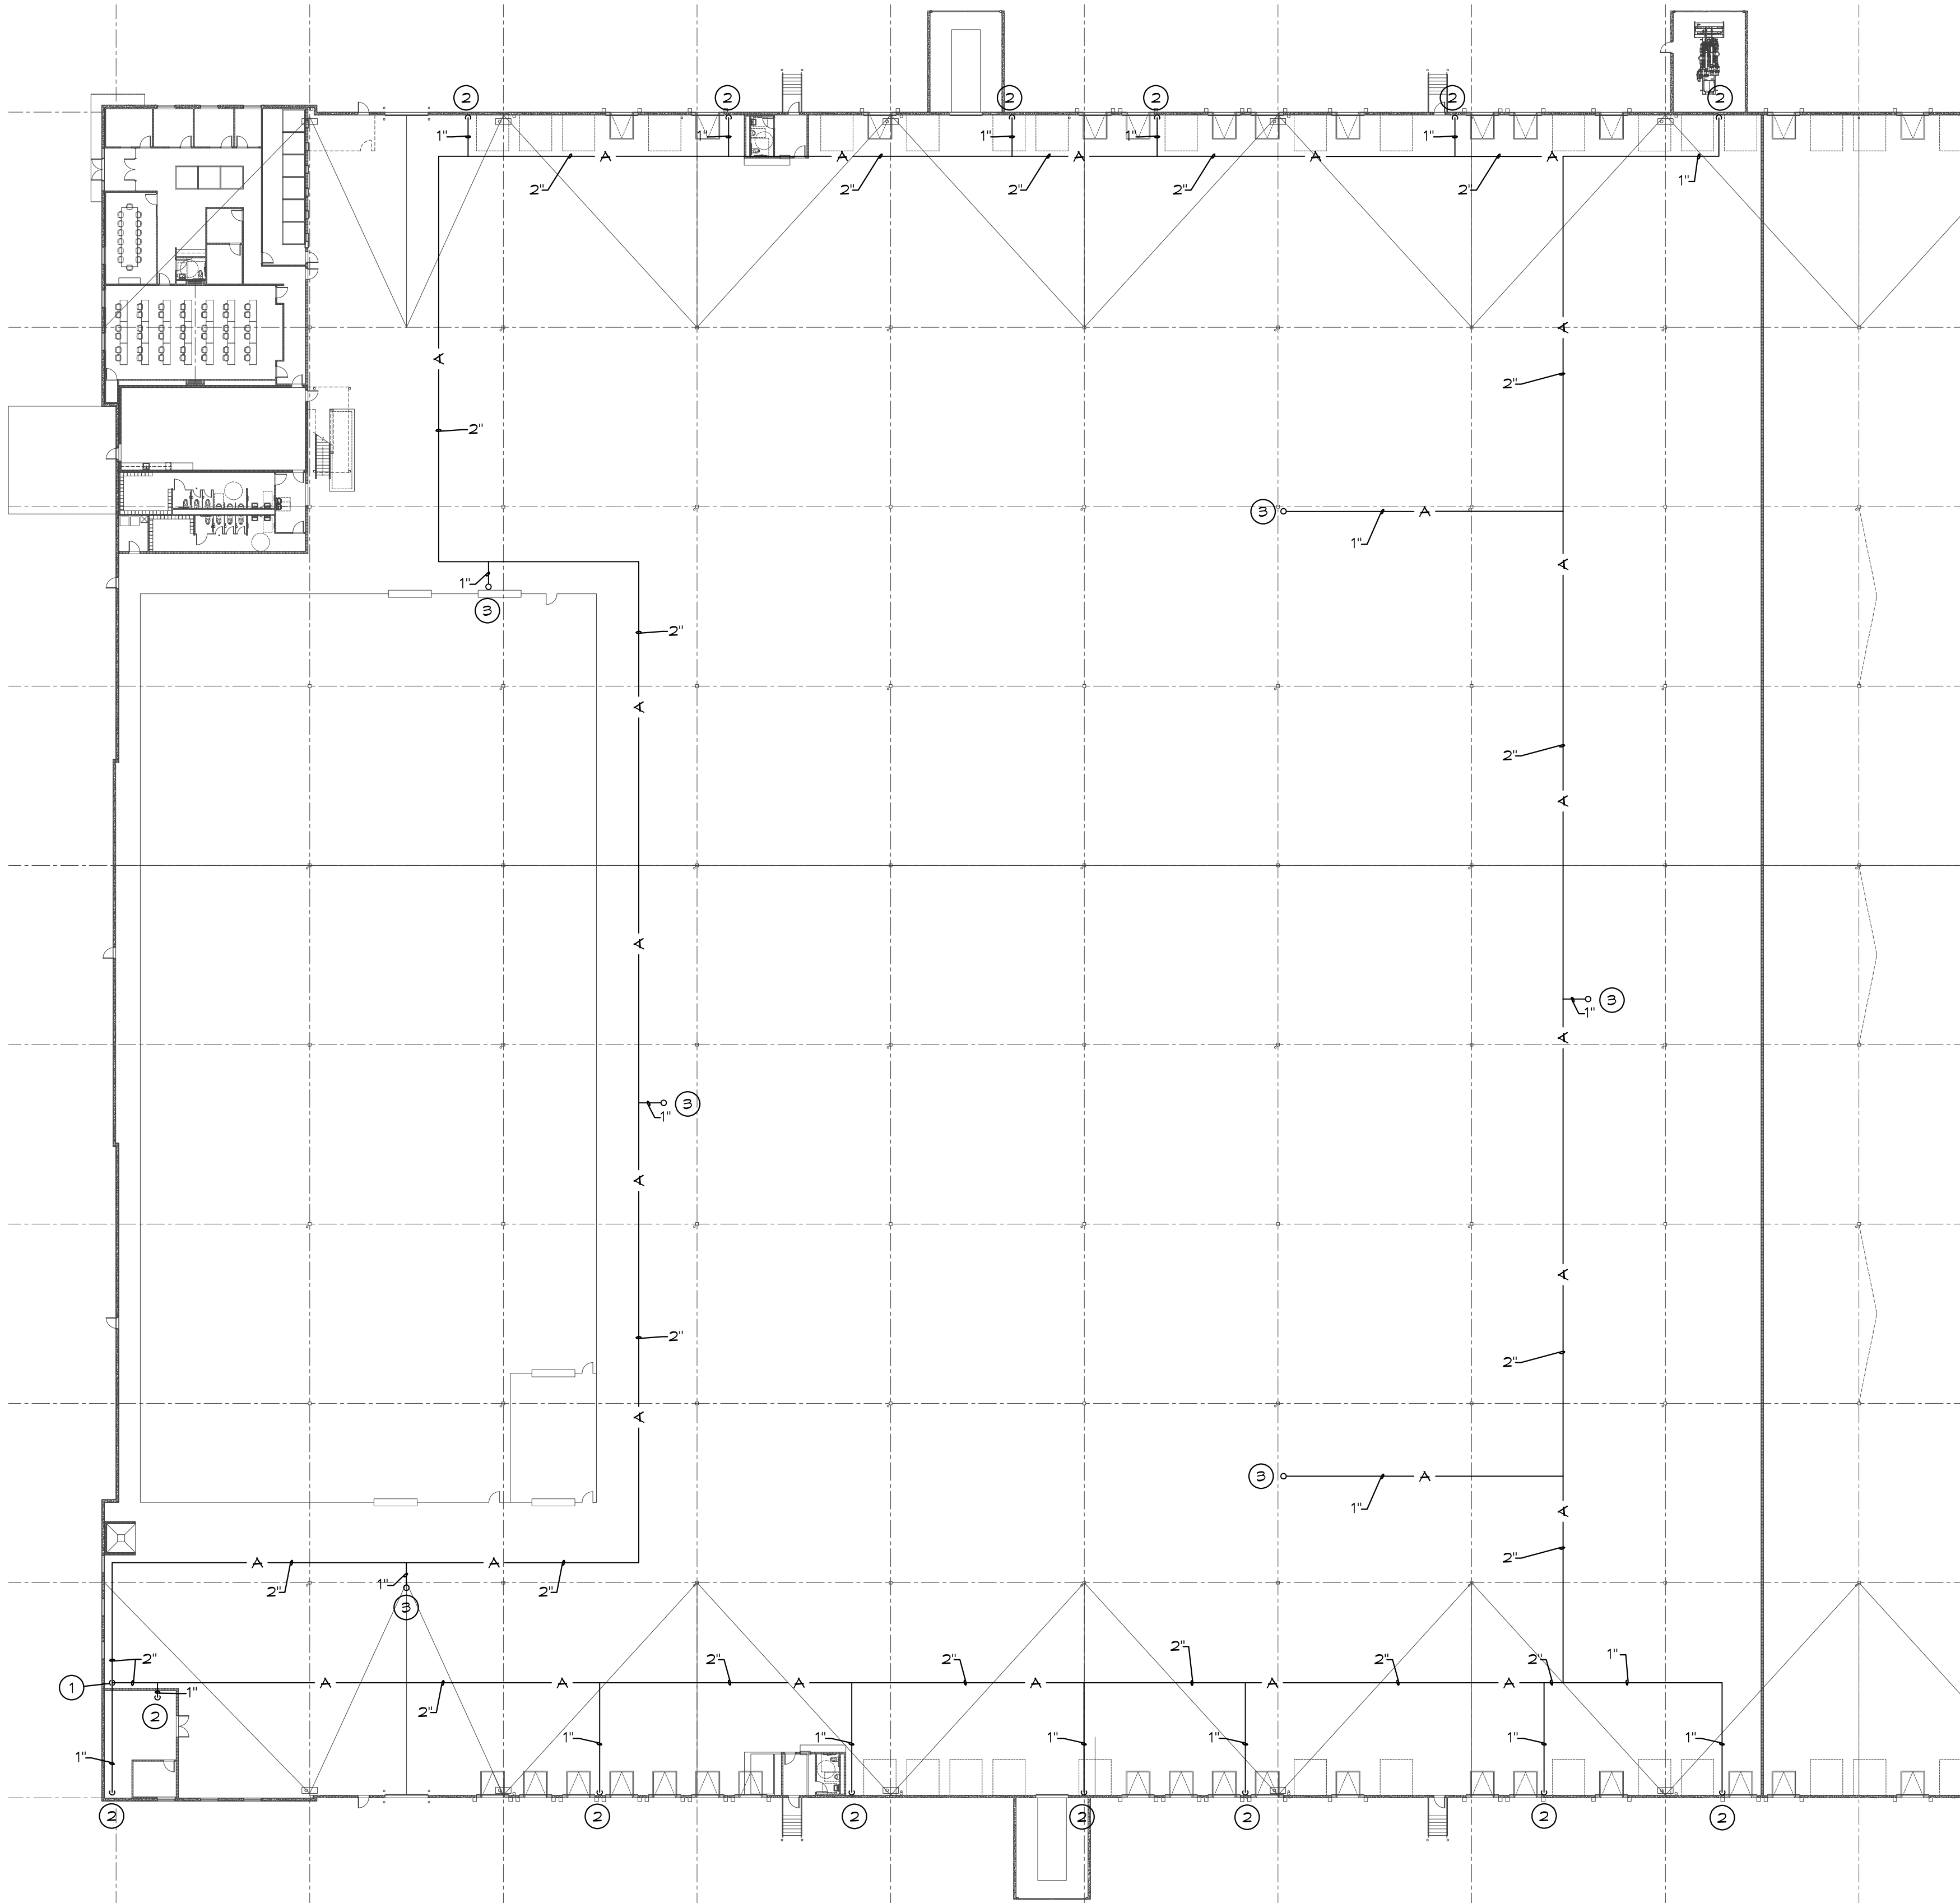

**PARTIAL COMPRESSED AIR FLOOR PLAN**  
SCALE: 1" = 30'-0" FFE = 991.50'

**CENTRAL**  
PLUMBING, HEATING & AIR CONDITIONING, INC.  
201 East Walnut  
Cleveland, MO 64734  
816-942-6355

BC PROJECT #22208  
MISSOURI PE COA #2009003629  
This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on the project only. Pursuant to the Architecture/Interior Design/Professional Act of 1980, all drawings, specifications, notes and designs, including the overall form, arrangement and composition of figures and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2022 BC Engineers, Inc.

**BC ENGINEERS**  
INCORPORATED


5720 Reeder Shawnee, KS 66203 (913)262-1772





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

8/31/2022



LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

PERMIT SET

08.31.22



210300

ENLARGED PLUMBING  
PLANS

P1.2



PLUMBING PLAN NOTES:

- REFER TO PARTIAL PLUMBING PLAN ON P1.0 FOR CONTINUATION.
- LOCATION OF 3" VTR. VERIFY 10' CLEARANCE FROM ALL OUTDOOR AIR INTAKES. SEAL PENETRATION WEATHERTIGHT.
- INSTANTANEOUS WATER HEATER LOCATED BELOW SINK/LAV. SUPPORT FROM WALL PER THE MANUFACTURES REQUIREMENTS.
- PROVIDE BFP AND CONNECT CW TO ICE MAKER AND COFFEE MAKER AS REQUIRED.
- SUPPORT WATER HEATER FROM STRUCTURE ABOVE CEILING. PROVIDE GALVANIZED DRAIN PAIN UNDER WATER HEATER WITH DRAIN. ROUTE INDIRECT DRAIN PIPING TO MOP BASIN WITH AIR GAP.
- CONNECT WATER TO EXISTING DOMESTIC WATER AS REQUIRED. VERIFY EXACT LOCATION PRIOR TO INSTALLATION OF ANY PIPING.
- PROVIDE INDIRECT DRAIN FROM ICE MAKER TO FLOOR DRAIN WITH AIR GAP.

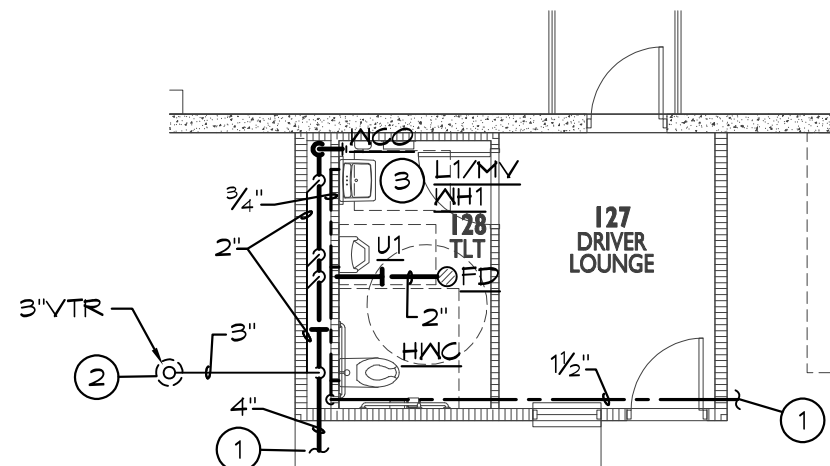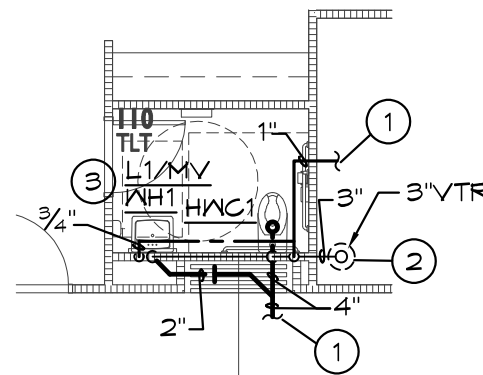

**ENLARGED PLUMBING FLOOR PLAN**  
SCALE: 1/8" = 1'-0"  
NORTH  
FFE = 991.50'

**ENLARGED PLUMBING FLOOR PLAN**  
SCALE: 1/8" = 1'-0"  
NORTH  
FFE = 991.50'

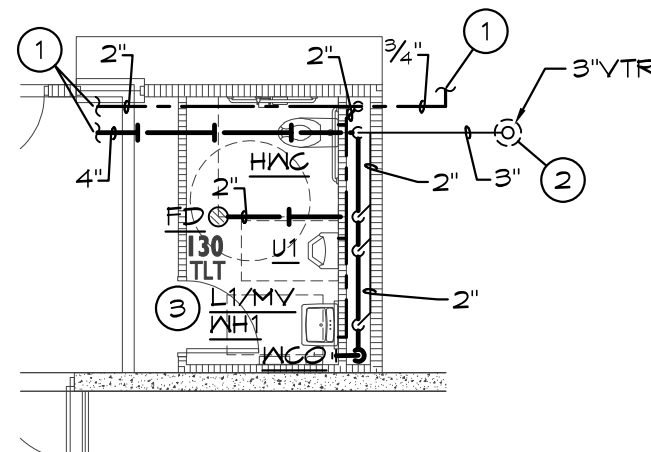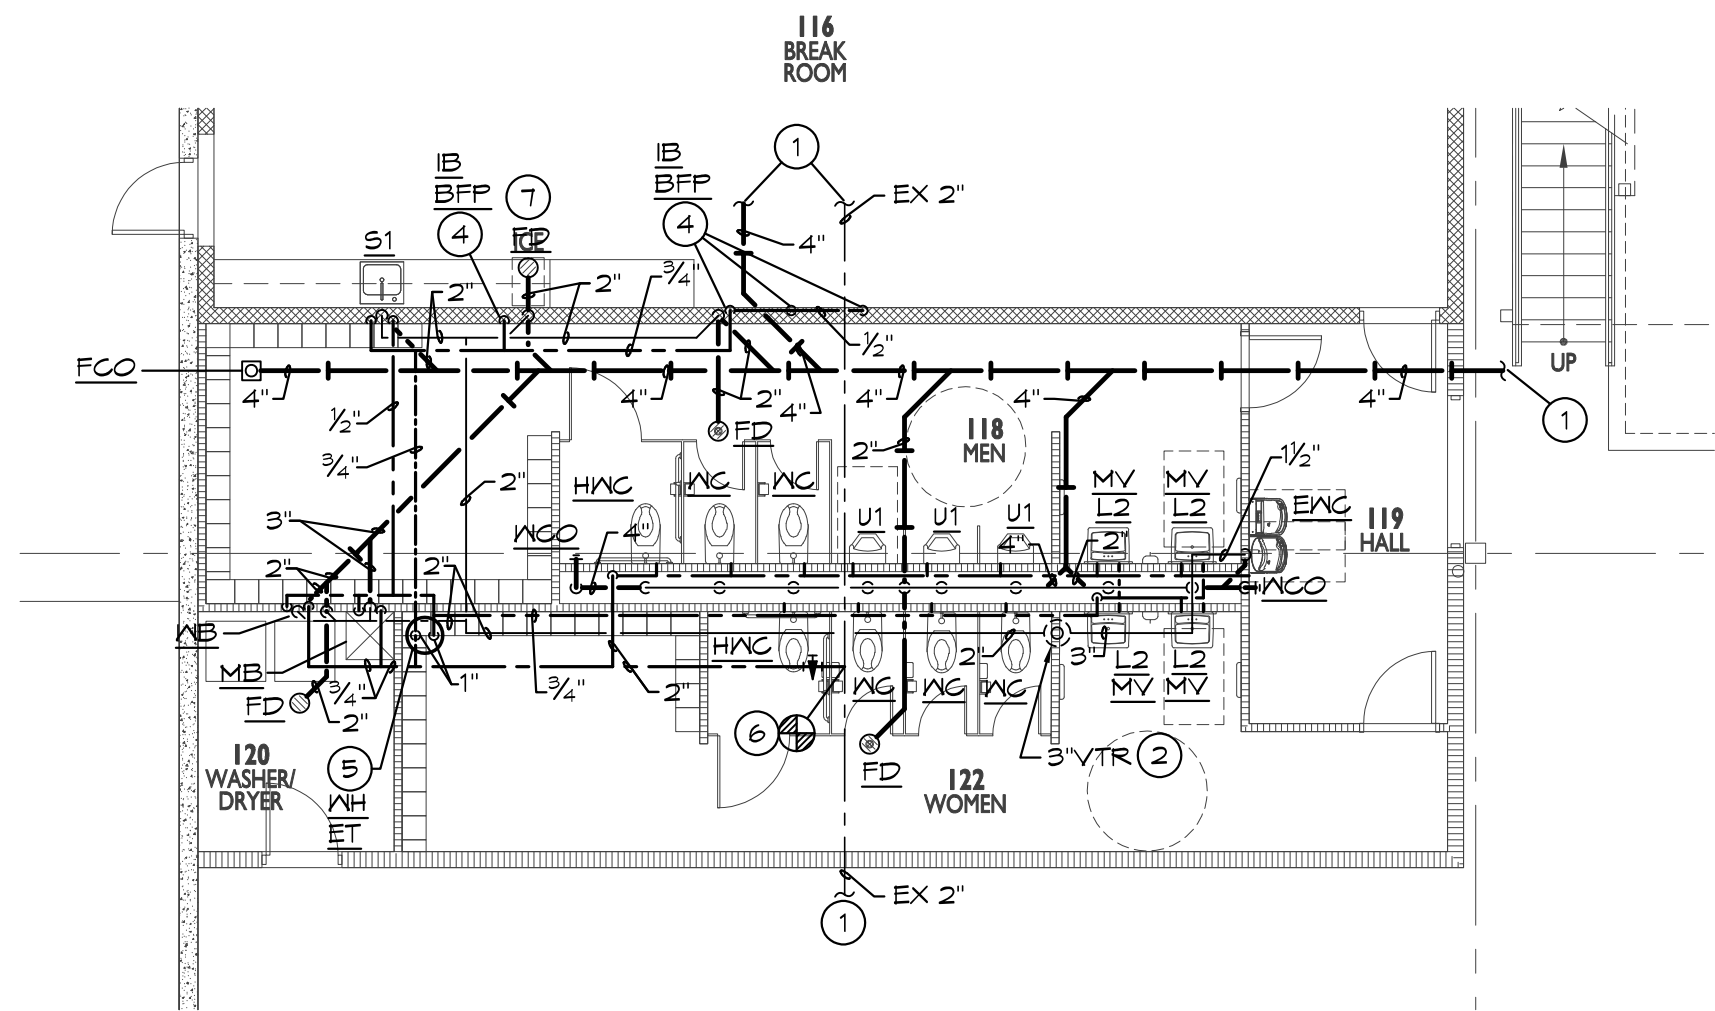

**ENLARGED PLUMBING FLOOR PLAN**  
SCALE: 1/8" = 1'-0"  
NORTH  
FFE = 991.50'

**ENLARGED PLUMBING FLOOR PLAN**  
SCALE: 1/8" = 1'-0"  
NORTH  
FFE = 991.50'

BC PROJECT #22208  
MISSOURI PE COA #2009003629  
This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on the project only. Pursuant to the Architects/Engineers Copyright Protection Act of 1980, all drawings, specifications, notes and designs, including the overall form, arrangement and composition of figures and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2022 BC Engineers, Inc.

**CENTRAL**  
PLUMBING, HEATING & AIR CONDITIONING, INC.  
201 East Walnut  
Cleveland, MO 64734  
816-942-6355

**BC ENGINEERS**  
INCORPORATED  
5720 Reeder Shawnee, KS 66203 (913)262-1772





# CURRAN ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



# SCANNELL PROPERTIES

8/31/2022



## LEE'S SUMMIT LOGISTICS BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

PERMIT SET 08.31.22

210300

PLUMBING SCHEDULES AND  
DETAILS

P2.0

## PLUMBING FIXTURE SCHEDULE (OR EQUAL):

<u>HWC</u>	WATER CLOSET (HANDICAPPED): SAME AS WC, EXCEPT 18" HIGH BOWL FOR HANDICAPPED.
<u>WC</u>	WATER CLOSET: AMERICAN STANDARD #2257.001, VITREOUS CHINA, WALL HUNG, ELONGATED BOWL, SIPHON JET ACTION, SLOAN #111 FLUSH VALVE, 1.6 GAL/FLUSH, CENTROCO #STSCG-001 OPEN FRONT ELONGATED SEAT, FLOOR MOUNTED FIXTURE SUPPORT (HEAVY DUTY 500 LB CAPACITY).
<u>HWC1</u>	WATER CLOSET (HANDICAPPED): AMERICAN STANDARD, #3043.001 "MADERA ADA", VITREOUS CHINA, FLOOR MOUNTED, FLOOR OUTLET, 17-1/2" HIGH ELONGATED BOWL, SIPHON-JET ACTION, SLOAN "ROYAL" #111 FLUSH VALVE, 1.6 GAL/FLUSH, CENTROCO #STSCG-001 OPEN FRONT ELONGATED SEAT WITH CHECK HINGE, HANDLE ON WIDE SIDE OF FIXTURE.
<u>U1</u>	URINAL, WALL HUNG: AMERICAN STANDARD, #6561.017 "TRIMBROOK", VITREOUS CHINA, 0.5 GPM WASH OUT ACTION, WALL HUNG URINAL WITH 3/4" TOP SPUD, SLOAN #186-1.0 FLUSH VALVE, FLOOR MOUNTED FIXTURE SUPPORT, SET RIM HEIGHT PER ARCHITECTURAL DRAWINGS.
<u>L1</u>	HANDICAP LAVATORY, WALL HUNG: AMERICAN STANDARD #03553012 "LUCERN", 20"x 18", VITREOUS CHINA, FRONT OVERFLOW, DELTA #B501LF FAUCET WITH SINGLE METAL LEVER FAUCET, OFFSET GRID ELBOW DRAIN AND 1-1/4" TAILPIECE, CHROME PLATED CAST BRASS P-TRAP WITH CLEANOUT (MOUNTED PARALLEL WITH WALL), CHROME PLATED LOOSE KEY ANGLE STOPS AND RISERS, FLOOR MOUNTED CONCEALED ARM LAVATORY SUPPORT, INSULATE EXPOSED DRAIN, WATER SUPPLIES, AND VALVES WITH PROWRAP SEAMLESS MOLDED CLOSED CELL VINYL INSULATION.
<u>L2</u>	HANDICAP LAVATORY, COUNTERTOP: AMERICAN STANDARD, #0476.028 "AQUALYN", VITREOUS CHINA, 20"x 17" OVAL BASIN, DELTA #B501LF FAUCET WITH SINGLE METAL LEVER HANDLE, OFFSET GRID DRAIN WITH 1-1/4" TAILPIECE, CHROME PLATED P-TRAP (MOUNTED PARALLEL WITH WALL), CHROME PLATED ANGLE STOPS AND RISERS, INSULATE EXPOSED DRAIN, WATER SUPPLIES, AND VALVES WITH PROWRAP SEAMLESS MOLDED CLOSED CELL VINYL INSULATION.
<u>S1</u>	SINK-ELKAY, #LRAD-2222, 19"X16"X 6-1/2" DEEP BOWL, 21-3/8"X 21-3/8" CUT-OUT, ADA COMPLIANT, SINGLE COMPARTMENT, SELF-RIMMING STAINLESS STEEL SINK WITH SATIN FINISH AND SOUND DAMPENING UNDERCOATING, #LK-1000CR FAUCET, SAVING SPOUT, AERATOR, SINGLE LEVER HANDLE, CHROME PLATED CAST BRASS P-TRAP WITH CLEANOUT, CHROME PLATED ANGLE STOPS AND RISERS, IN-SINK-ERATOR #BADGER 5 DISPOSAL, 1/2 HP, 120 VOLT.
<u>MB</u>	MOP BASIN: FIAT, #MSB-2424, MOLDED STONE MOP BASIN, 2" DRAIN, 24"x 24" BASIN, VINYL BUMPER GUARD, STERN WILLIAMS #T-10-VB FAUCET, SPRING CHECKS, VACUUM BREAKER, INTEGRAL STOPS, WALL BRACE & PAIL HOOK, WALL BRACKET WITH 30' HOSE.
<u>ENC</u>	ELECTRIC WATER COOLER: OASIS, #P68ACSL, BARRIER FREE TWO-STATION WATER COOLER, 8.0 GPH, 50 DEGREES F WATER WITH 90 DEGREES F AIR TEMPERATURE, 120 VOLT, COLOR TO BE SELECTED BY ARCHITECT AFTER AWARD OF CONTRACT, FRONT AND SIDE ANTIMICROBIAL PUSH PADS, ANTIMICROBIAL FLEX BUBBLERS, CHROME PLATED CAST BRASS P-TRAP WITH CLEANOUT, CHROME PLATED LOOSE KEY ANGLE STOP, FLOOR MOUNTED CARRIER AND CANE APRON.
<u>FD</u>	FLOOR DRAIN: JR SMITH, #2005-A, CAST IRON FLOOR DRAIN WITH ADJUSTABLE TOP, 6" NIKALOY STRAINER. PROVIDE WITH #2642 QUAD GLOBE TRAP SEAL DEVICE.
<u>EEW</u>	PORTABLE EYE WASH STATION: BRADLEY #519-421, SELF-CONTAINED, LOCATED AT EACH CHARGING STATION.
<u>HB</u>	HOSE BIBB: PRIER, #P-164, 3/4" HOSE NOZZLE OUTLET, SATIN NICKEL PLATED BODY FINISH, HANDY WHEEL OPERATED, INTEGRAL VACUUM BREAKER.
<u>IB</u>	ICE BOX: SIOUX CHIEF #696-1000, ICE BOX WITH 1/2" INLET AND CONNECTION AND 1/4-TURN SHUT OFF VALVE.
<u>WH1</u>	TANKLESS HOT WATER HEATER: STIEBEL ELTRON MINI 3, 120 VOLT, 3.0 KM.
<u>WH</u>	HOT WATER HEATER: AO SMITH #DEL-40, 40 GALLON STORAGE, 208 VOLT/1 PHASE, (2) 6000 WATT ELEMENT, NON-SIMULTANEOUS, ASME TEMPERATURE AND PRESSURE RELIEF VALVE.
<u>ET</u>	HOT WATER EXPANSION TANK: AMTROL, #ST-5, 2 GALLON EXPANSION TANK WITH DIAPHRAGM.
<u>MV</u>	MIXING VALVE: WATTS, #LFV5G-B, THERMOSTATIC CONTROLLED MIXING VALVE, LEAD FREE BRONZE BODY, LOCKED TEMPERATURE ADJUSTMENT CAP (VANDAL RESISTANT), COPPER ENCAPSULATED THERMOSTAT ASSEMBLY WITH BRASS SHUTTLE, STAINLESSSTEEL SPRINGS, INTEGRAL CHECK VALVES ON HOT AND COLD INLETS. (SET TO 110°F). ASSE 1070 LISTED.
<u>BFP</u>	BACKFLOW PREVENTOR: WATTS #SD-3, DUAL CHECK VALVE WITH ATMOSPHERIC PORT & STRAINER FOR CARBONATED BEVERAGE MACHINES
<u>RH</u>	FREEZELESS ROOF HYDRANT: WOODFORD #RH2-MS, HEAVY-DUTY CAST IRON MOUNTING SYSTEM, AUTOMATICALLY DRAIN WHEN SHUT OFF, ASSE 1052 DOUBLE CHECK BACKFLOW PREVENTOR.
<u>WB</u>	WASHER BOX : SIOUX CHIEFS "OXBOX" 696 SERIES WASHER OUTLET BOX WITH BUILT IN WATER HAMMER ARRESTER WITH 1-1/2" DRAIN OUTLET AND TAILPIECE, AND 1/2" HOT & COLD WATER CONNECTION.
<u>SD</u>	SCRUBBER DRAIN: RELIABLE CONCRETE 3030/21585G CATCH BASIN REINFORCED, CLAY & BAILEY 2158BG 135" GRATE.
<u>WHA</u>	WATER HAMMER ARRESTOR: JR SMITH "HYDROTROL" #5000 LEAD-FREE WATER HAMMER ARRESTOR, SIZED AS PER MANUFACTURER'S RECOMMENDATIONS.
<u>FCO/MCO</u>	VINYL TILE FLOOR: JR SMITH #4140, OR EQUAL. QUARRY TILE FLOOR: JR SMITH #4200, OR EQUAL. CARPETED FLOOR: JR SMITH #4020-Y, OR EQUAL. UNFINISHED FLOOR: JR SMITH #4020, OR EQUAL.

**CENTRAL**  
PLUMBING, HEATING & AIR CONDITIONING, INC.  
201 East Walnut  
Cleveland, MO 64734  
816-942-6355

BC PROJECT #22208  
MISSOURI PE COA #2009003629

This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on the project only. Pursuant to the Architecture/Engine Copyright Protection Act of 1980, all drawings, specifications, plans and designs, including the overall form, arrangement and composition of figures and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2022 BC Engineers, Inc.

BC


ENGINEERS  
INCORPORATED

5720 Reeder Shawnee, KS 66203 (913)262-1772


PIPE HANGER SCHEDULE		
PIPE MATERIAL	MAXIMUM HANGER SPACING	HANGER ROD DIAMETER
ABS (All Sizes)	4'	3/8"
PVC (All Sizes)	4'	3/8"
CPVC, 1 inch and smaller	3'	1/2"
CPVC, 1-1/4 inches and larger	4'	1/2"
Cast Iron (All Sizes)	5'	5/8"
Cast Iron (All Sizes) with 10 foot length of pipe	10'	5/8"
Copper Tube, 1-1/4 inches and smaller	6'	1/2"
Copper Tube, 1-1/2 inches and larger	10'	1/2"
Steel, 3 inches and smaller	12'	1/2"
Steel, 4 inches and larger	12'	5/8"
Pex, 1" and below without support channel	32"	3/8"
Pex, 1-1/4" and above without support channel	48"	3/8"
Pex 3/4" and below with support channel	6'	3/8"
Pex 1" and above with support channel	8'	3/8"

## PEX PIPING REQUIREMENTS

PIPE SIZES GIVEN ON THE DRAWINGS ARE NOMINAL COPPER PIPE SIZE. IF PEX PIPING IS USED, INCREASE PEX PIPING ONE SIZE ABOVE LISTED SIZES AS REQUIRED TO EQUAL OR EXCEED COPPER PIPE INSIDE DIAMETER.

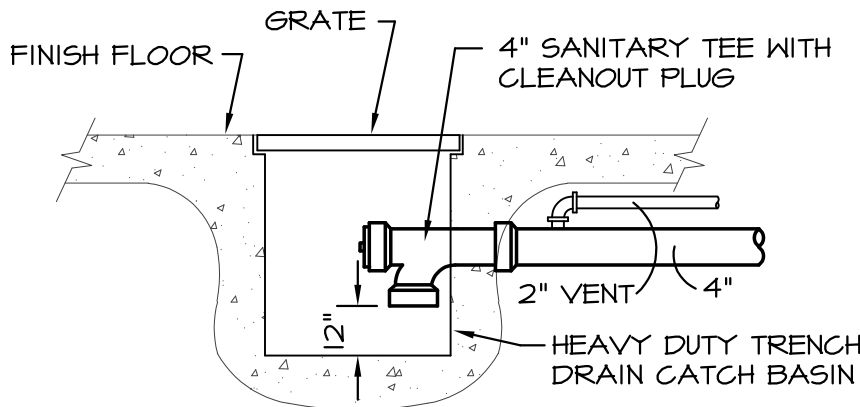

**CATCH BASIN DETAIL**  
SCALE: NONE

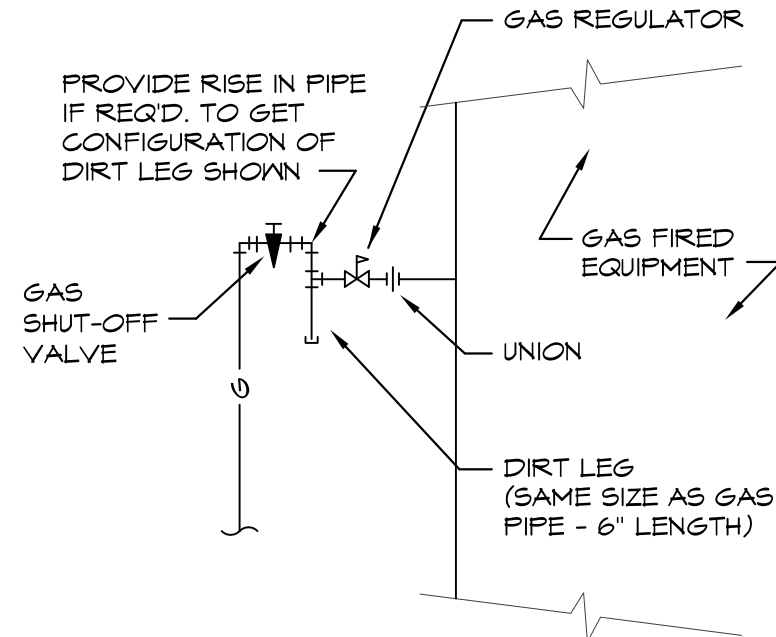


GAS PRESSURE REGULATORS FOR GAS FIRED EQUIPMENT SHALL BE SENSUS #243-B, 5 PSI INLET / 7" WC OUTLET PRESSURE WITH THE ORIFICE & SPRING SIZE AS RECOMMENDED BY THE MANUFACTURER.

PROVIDE GAS REGULATOR FOR EVERY PIECE OF GAS FIRED EQUIPMENT. VENT ON REGULATOR SHALL BE VENTED WITH FULL SIZE PIPE TO EXTERIOR OF BLDG. FLASH BLDG PENETRATION WEATHER TIGHT.

## GAS CONNECTION DETAIL

SCALE: NONE  
FOR ROOFTOP UNITS, MAKE-UP AIR UNITS, ETC. WITH 2 PSI GAS PRESSURE

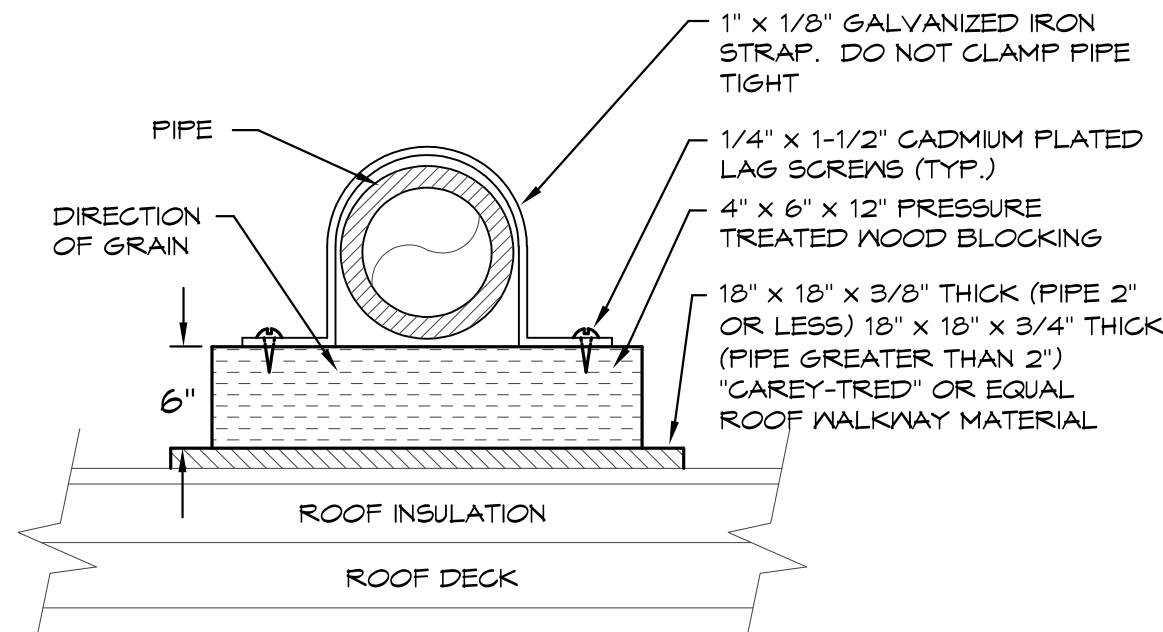


## ROOF PIPE SUPPORT DETAIL

SCALE: NONE

PLUMBING DRAINAGE CALCULATIONS				
FIXTURE	QUANTITY	FU	TOTAL FU	
WATER CLOSETS	10	4	40	
URINAL (1.0 GPF)	5	2	10	
LAVATORIES	7	1	7	
SINKS	1	2	2	
FLOOR DRAIN	7	2	14	
FLOOR SINK	5	2	10	
SCRUBBER DRAIN	1	2	2	
WASHER BOX	1	3	3	
MOP SINK	1	2	2	
ELECTRIC WATER COOLER	1	5	5	
TOTAL			90.5 FU	
VENT MAINS - 3"				
WASTE MAIN - 4"				


PLUMBING FIXTURE WATER COUNT							
FIXTURE	QUANTITY	CN FU	CN TOTAL FU	HN FU	HN TOTAL FU	COMBINED FU	COMBINED TOTAL FU
WATER CLOSETS	10	10	100	-	-	-	100
URINAL	5	5	25	-	-	-	25
LAVATORIES	7	1.5	10.5	1.5	10.5	2	14
SINKS	1	2.25	2.25	2.25	2.25	0	3
WATER BOXES	4	.25	-	-	-	-	1
CLOTHES WASHER	1	2.25	2.25	2.25	2.25	3	3
MOP SINK	1	2.25	2.25	2.25	2.25	3	3
WATER COOLER	1	.25	-	-	-	-	.25
			149.5 FU		17.25 FU		149.25 FU
			COLD WATER MAIN - 2"				
			HOT WATER MAIN - 1"				



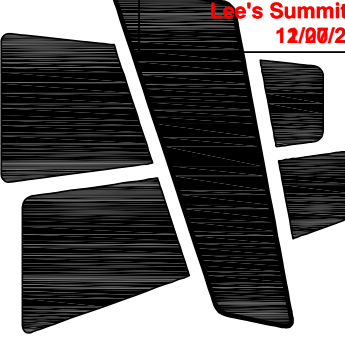

**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

8/31/2022



LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I


NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

PERMIT SET 08.31.22


210300

PLUMBING RISERS

P2.1

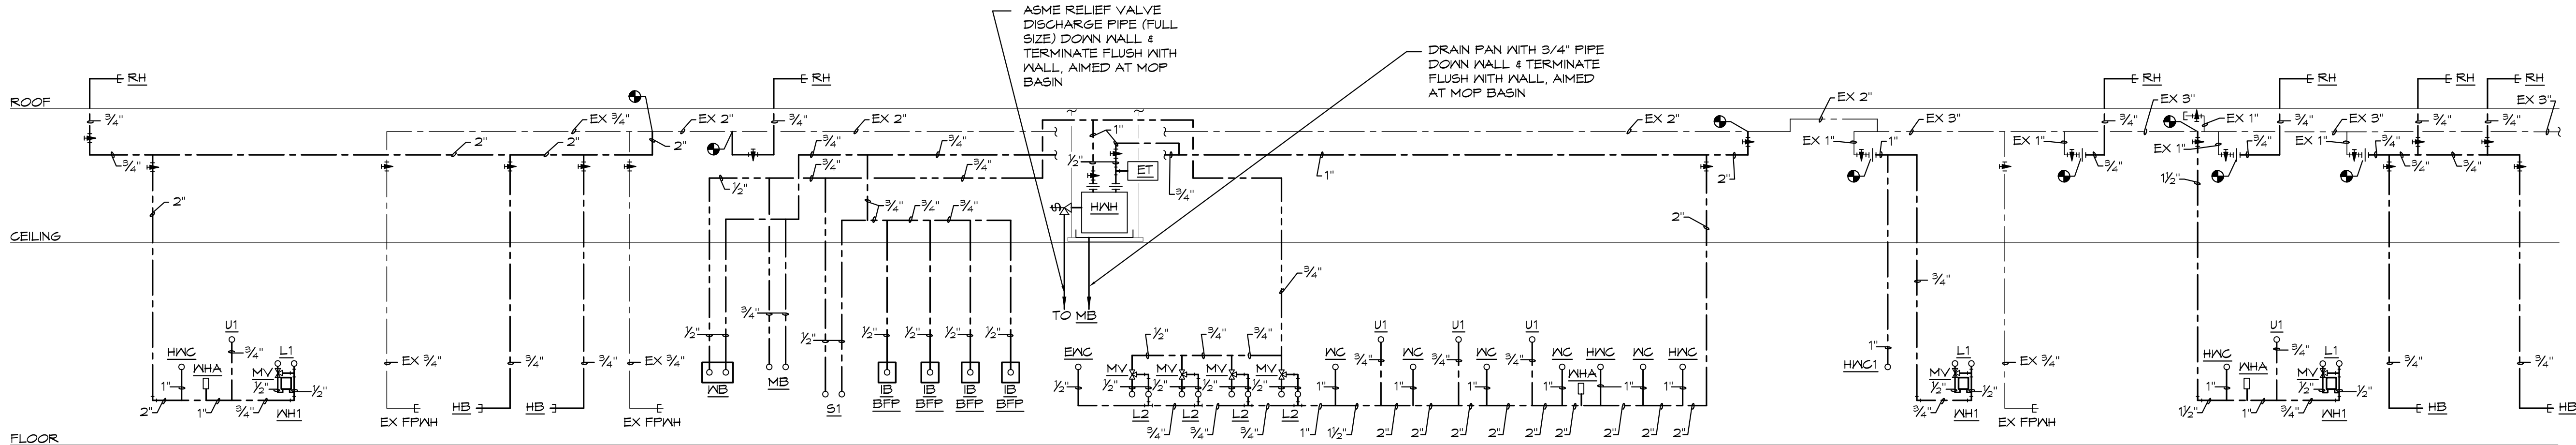

HOT & COLD WATER

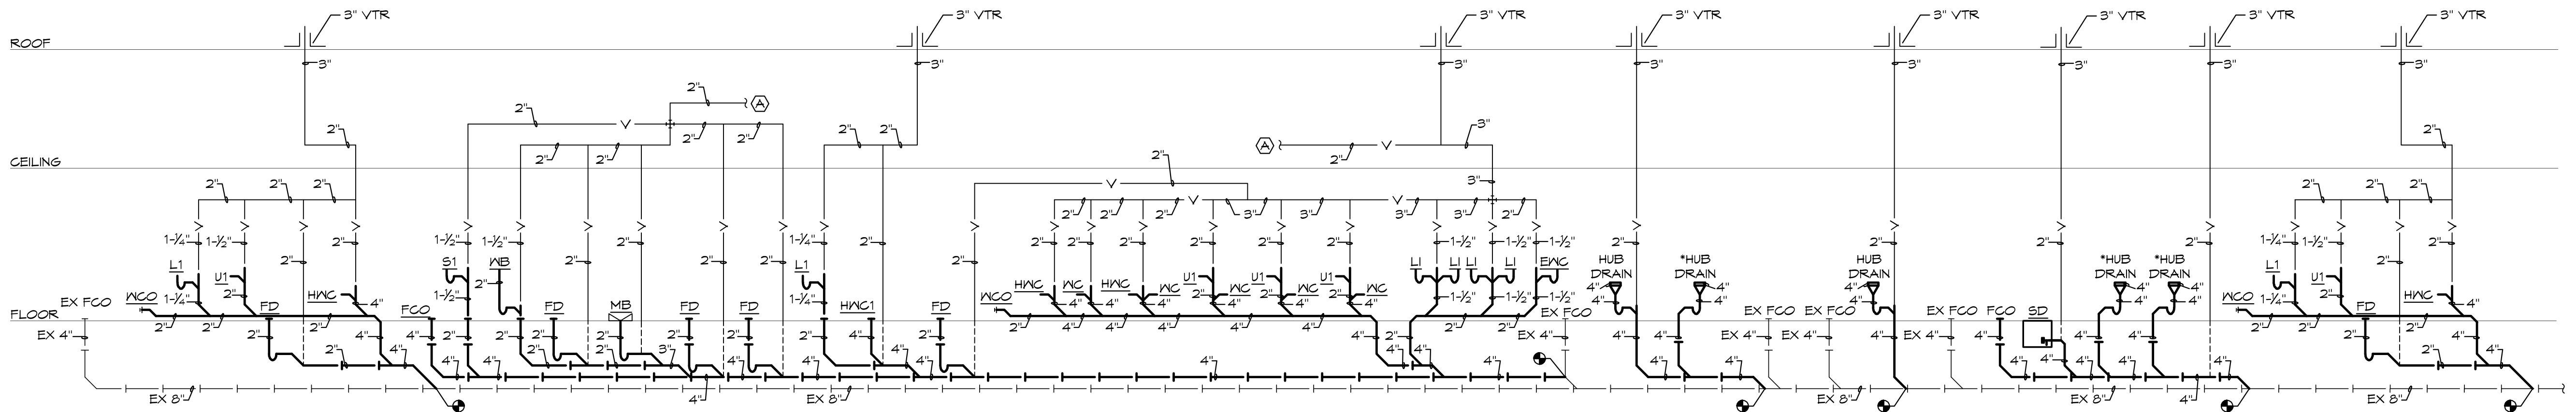

\* = COMBINATION WASTE & VENT DRAIN

WASTE & VENT

**PLUMBING RISER DIAGRAMS**

SCALE: NONE

BC PROJECT #22208  
MISSOURI PE COA #2009003629  
This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on the project only. Pursuant to the Architecture/Interior Design/Professional Act of 1980, all drawings, specifications, notes and designs, including the overall form, arrangement and composition of figures and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2022 BC Engineers, Inc.

**CENTRAL**  
PLUMBING, HEATING & AIR CONDITIONING, INC.  
201 East Walnut  
Cleveland, MO 64734  
816-942-6355

**BC ENGINEERS**  
INCORPORATED  
5720 Reeder Shawnee, KS 66203 (913)262-1772





NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

210300  
PLUMBING  
SPECIFICATION

## PLUMBING SPECIFICATIONS (CONTINUED)

- STORM SEWER, SANITARY SEWER, GREASE WASTE, SAND OIL WASTE, AND VENTS.  
(UNDERGROUND, EXTERIOR TO THE BUILDING).
- I. ABS SCHEDULE 40 CELLULAR CORE (FOAM CORE) PIPE AND DRY FITTING SYSTEM (ASTM F1488).  
PIPE AND FITTINGS SHALL BE MANUFACTURED FROM ABS COMPOUND WITH A CELL CLASS OF 42222 FOR PIPE AND 32222 FOR FITTINGS AS PER ASTM D 3565 AND CONFORM WITH NATIONAL SANITATION FOUNDATION (NSF) STANDARD 14. PIPE SHALL BE IRON PIPE SIZE (IPS) CONFORMING TO ASTM F 620. FITTINGS SHALL CONFORM TO ASTM D 2661. SOLVENT CEMENTS SHALL CONFORM TO ASTM D 2235.
- II. PVC SCHEDULE 40 CELLULAR CORE (FOAM CORE) PIPE AND DRY FITTING SYSTEM (ASTM F1488).  
PIPE AND FITTINGS SHALL BE MANUFACTURED FROM PVC COMPOUND WITH A CELL CLASS OF 11432 PER ASTM D 3596 FOR PIPE AND 12454 PER ASTM D 2661 FOR FITTINGS AND CONFORM WITH NATIONAL SANITATION FOUNDATION (NSF) STANDARD 14. PIPE SHALL BE IRON PIPE SIZE (IPS) CONFORMING TO ASTM F 681. INJECTION MOLDED FITTINGS SHALL CONFORM TO ASTM D 2665. FABRICATED FITTINGS SHALL CONFORM TO ASTM D 1886. SOLVENT CEMENTS SHALL CONFORM TO ASTM D 2564.
- III. PVC SCHEDULE 40 SOLID WALL PIPE AND DRY FITTING SYSTEM (ASTM D 2665).  
PIPE AND FITTINGS SHALL BE MANUFACTURED FROM PVC COMPOUND WITH A CELL CLASS OF 12454 PER ASTM D 1754 AND CONFORM WITH NATIONAL SANITATION FOUNDATION (NSF) STANDARD 14. PIPE SHALL BE IRON PIPE SIZE (IPS) CONFORMING TO ASTM D 1185 AND ASTM D 2665. INJECTION MOLDED FITTINGS SHALL CONFORM TO ASTM D 2665. FABRICATED FITTINGS SHALL CONFORM TO ASTM D 1886. SOLVENT CEMENTS SHALL CONFORM TO ASTM D 2564.
- IV. HUBLESS CAST IRON SOIL PIPE AND FITTINGS. HUBLESS CAST IRON PIPE AND FITTINGS SHALL BE MANUFACTURED FROM GRAY CAST IRON AND SHALL CONFORM TO ASTM A 880 AND GISI STANDARD 301. HUBLESS COUPLINGS SHALL CONFORM TO GISI STANDARD 310 AND BE CERTIFIED BY NSF8 INTERNATIONAL. HUB AND SPIGOT CAST IRON SOIL PIPE AND FITTINGS SHALL CONFORM TO ASTM A 74. HUB AND SPIGOT CAST IRON SOIL PIPE AND FITTINGS. HUB AND SPIGOT CAST IRON PIPE AND FITTINGS SHALL BE MANUFACTURED FROM GRAY CAST IRON AND SHALL CONFORM TO ASTM A 74.
- F. STORM SEWER, SANITARY SEWER, GREASE WASTE, SAND OIL WASTE, AND VENTS.  
(ABOVE GROUND, INTERIOR TO THE BUILDING).
- 1) ABS SCHEDULE 40 CELLULAR CORE (FOAM CORE) PIPE AND DRY FITTING SYSTEM (ASTM F1488).  
PIPE AND FITTINGS SHALL BE MANUFACTURED FROM ABS COMPOUND WITH A CELL CLASS OF 42222 FOR PIPE AND 32222 FOR FITTINGS AS PER ASTM D 3565 AND CONFORM WITH NATIONAL SANITATION FOUNDATION (NSF) STANDARD 14. PIPE SHALL BE IRON PIPE SIZE (IPS) CONFORMING TO ASTM F 620. FITTINGS SHALL CONFORM TO ASTM D 2661. SOLVENT CEMENTS SHALL CONFORM TO ASTM D 2235. (NOT FOR USE IN A RETURN AIR FLENUM)
- 2) PVC SCHEDULE 40 CELLULAR CORE (FOAM CORE) PIPE AND DRY FITTING SYSTEM (ASTM F1488).  
PIPE AND FITTINGS SHALL BE MANUFACTURED FROM PVC COMPOUND WITH A CELL CLASS OF 11432 PER ASTM D 3596 FOR PIPE AND 12454 PER ASTM D 2661 FOR FITTINGS AND CONFORM WITH NATIONAL SANITATION FOUNDATION (NSF) STANDARD 14. PIPE SHALL BE IRON PIPE SIZE (IPS) CONFORMING TO ASTM F 681. INJECTION MOLDED FITTINGS SHALL CONFORM TO ASTM D 2665. FABRICATED FITTINGS SHALL CONFORM TO ASTM D 1886. SOLVENT CEMENTS SHALL CONFORM TO ASTM D 2564. (NOT FOR USE IN A RETURN AIR FLENUM)
- 3) PVC SCHEDULE 40 SOLID WALL PIPE AND DRY FITTING SYSTEM (ASTM D 2665).  
PIPE AND FITTINGS SHALL BE MANUFACTURED FROM PVC COMPOUND WITH A CELL CLASS OF 12454 PER ASTM D 1754 AND CONFORM WITH NATIONAL SANITATION FOUNDATION (NSF) STANDARD 14. PIPE SHALL BE IRON PIPE SIZE (IPS) CONFORMING TO ASTM D 1185 AND ASTM D 2665. INJECTION MOLDED FITTINGS SHALL CONFORM TO ASTM D 2665. FABRICATED FITTINGS SHALL CONFORM TO ASTM F 174. SOLVENT CEMENTS SHALL CONFORM TO ASTM D 2564. (WHERE APPROVED BY LOCAL JURISDICTIONS). (NOT FOR USE IN A RETURN AIR FLENUM)
- 4) HUBLESS CAST IRON SOIL PIPE AND FITTINGS. HUBLESS CAST IRON PIPE AND FITTINGS SHALL BE MANUFACTURED FROM GRAY CAST IRON AND SHALL CONFORM TO ASTM A 880 AND GISI STANDARD 301. HUBLESS COUPLINGS SHALL CONFORM TO GISI STANDARD 310 AND BE CERTIFIED BY NSF8 INTERNATIONAL. HUB AND SPIGOT CAST IRON SOIL PIPE AND FITTINGS SHALL CONFORM TO ASTM A 74. HUB AND SPIGOT CAST IRON SOIL PIPE AND FITTINGS SHALL BE MANUFACTURED FROM GRAY CAST IRON AND SHALL CONFORM TO ASTM A 74.
- G. STORM SEWER, SANITARY SEWER, GREASE WASTE, SAND OIL WASTE, AND VENTS.  
(UNDERGROUND, EXTERIOR TO THE BUILDING).
- I. ABS SCHEDULE 40 CELLULAR CORE (FOAM CORE) PIPE AND DRY FITTING SYSTEM (ASTM F1488).  
PIPE AND FITTINGS SHALL BE MANUFACTURED FROM ABS COMPOUND WITH A CELL CLASS OF 42222 FOR PIPE AND 32222 FOR FITTINGS AS PER ASTM D 3565 AND CONFORM WITH NATIONAL SANITATION FOUNDATION (NSF) STANDARD 14. PIPE SHALL BE IRON PIPE SIZE (IPS) CONFORMING TO ASTM F 620. FITTINGS SHALL CONFORM TO ASTM D 2661. SOLVENT CEMENTS SHALL CONFORM TO ASTM D 2235.
- II. PVC SCHEDULE 40 CELLULAR CORE (FOAM CORE) PIPE AND DRY FITTING SYSTEM (ASTM F1488).  
PIPE AND FITTINGS SHALL BE MANUFACTURED FROM PVC COMPOUND WITH A CELL CLASS OF 11432 PER ASTM D 3596 FOR PIPE AND 12454 PER ASTM D 2661 FOR FITTINGS AND CONFORM WITH NATIONAL SANITATION FOUNDATION (NSF) STANDARD 14. PIPE SHALL BE IRON PIPE SIZE (IPS) CONFORMING TO ASTM F 681. INJECTION MOLDED FITTINGS SHALL CONFORM TO ASTM D 2665. FABRICATED FITTINGS SHALL CONFORM TO ASTM D 1886. SOLVENT CEMENTS SHALL CONFORM TO ASTM D 2564.
- III. PVC SCHEDULE 40 SOLID WALL PIPE AND DRY FITTING SYSTEM (ASTM D 2665).  
PIPE AND FITTINGS SHALL BE MANUFACTURED FROM PVC COMPOUND WITH A CELL CLASS OF 12454 PER ASTM D 1754 AND CONFORM WITH NATIONAL SANITATION FOUNDATION (NSF) STANDARD 14. PIPE SHALL BE IRON PIPE SIZE (IPS) CONFORMING TO ASTM D 1185 AND ASTM D 2665. INJECTION MOLDED FITTINGS SHALL CONFORM TO ASTM D 2665. FABRICATED FITTINGS SHALL CONFORM TO ASTM F 174. SOLVENT CEMENTS SHALL CONFORM TO ASTM D 2564.
- IV. HUBLESS CAST IRON SOIL PIPE AND FITTINGS. HUBLESS CAST IRON PIPE AND FITTINGS SHALL BE MANUFACTURED FROM GRAY CAST IRON AND SHALL CONFORM TO ASTM A 880 AND GISI STANDARD 301. HUBLESS COUPLINGS SHALL CONFORM TO GISI STANDARD 310 AND BE CERTIFIED BY NSF8 INTERNATIONAL. HUB AND SPIGOT CAST IRON SOIL PIPE AND FITTINGS. HUB AND SPIGOT CAST IRON PIPE AND FITTINGS SHALL BE MANUFACTURED FROM GRAY CAST IRON AND SHALL CONFORM TO ASTM A 74.
- 5) COPPER DRY. DRAINAGE TUBE SHALL CONFORM TO ASTM B306, VROUGHT COPPER FITTINGS, AND E-16-29.
- 6) GALVANIZED STEEL PIPE, WITH MALLEABLE IRON, THREADED FITTINGS, DRAINAGE PATTERN FOR SEWERS SHALL CONFORM TO ASTM A 53.
- H. NATURAL GAS.
- a) BLACK STEEL, PIPE, SCHEDULE 40, ASTM A53.
- b) PIPE 3" AND SMALLER; 150 LB MALLEABLE IRON, THREADED FITTINGS.
- c) PIPE 4" AND SMALLER; VESDA BE PRESSURE 6 FOR WATER AND GAS, ASCE LCA4, TSSA/ASME B31.
- d) FOR USE WITH ASHTA A-1000, APPROVALS-UL842, FM, GAS, NSF 610, MSS SP-110.
- e) PIPE 2-1/2" AND LARGER, WELDED.
- f) PLUG VALVE: ROCKWELL NORDSTREAM FIGURE NO. 142 OR 143.
- g) BALL VALVE: JOMAX T-1000E, APPROVALS-UL842, FM, GAS, NSF 610, MSS SP-110.
- GAS PIPING LABELING:
- a) ALL ELEVATED PRESSURE GAS PIPING SHALL BE LABELED EVERY 40 FEET WITH SIGNS INDICATING "ELEVATED PRESSURE".
- b) GAS PIPING PAINTING:
- a) ALL BLACK STEEL GAS PIPING LOCATED EXTERIOR TO THE BUILDING SHALL BE PRIMED AND PAINTED TO EIT. VAPOR INJURY HAZARD OR MINOR CORROSION. IF GAS PIPING IS LOCATED ON NEAR EXTERIOR WALL AND PAINTED SAFETY YELLOW LOCATED ON THE ROOF.
- II. ALL PIPE HANGERS AND SUPPORTS SHALL BE STANDARD PRODUCTS OF GRINNELL, FEE AND MASON, OR ELLEN. HANGER SPACING SHALL BE IN ACCORDANCE WITH MSS-SP-64.
- J. SLEEVES
- 1) PROVIDE, SET, AND PROPERLY LOCATE PIPE SLEEVES AS REQUIRED FOR THIS WORK. ALL SLEEVES SHALL BE OF SUFFICIENT SIZE TO PERMIT PIPE MOVEMENT DUE TO EXPANSION AND CONTRACTION AND TO ACCOMMODATE PIPE INSULATION.
- 2) INTERIOR PARTITIONS: 16 GAGE GALVANIZED STEEL, PLATE BETWEEN PIPE AND SLEEVE WITH FIRE RESISTING AND GASKETING TO PREVENT FIRE RESISTANCE.
- 3) ROOF, PROTECT OR EQUAL, MANUFACTURED PVC SCHEDULE 40 PIPE SLEEVE WITH WATERPROOF SEAL. COORDINATE WITH ROOFING CONTRACTOR AND FLASH AS REQUIRED TO MAINTAIN ROOF WARRANTY.
- 4) PROTECTION AGAINST CONTACT: METALLIC PIPING, EXCEPT FOR CAST IRON, DUCTILE IRON AND GALVANIZED STEEL, SHALL NOT BE PLACED IN DIRECT CONTACT WITH STEEL FRAMING MEMBERS, CONCRETE, OR UNDER SLAB. IF CONTACT WITH CONCRETE OR OTHER MATERIALS IS UNAVOIDABLE, IT SHALL BE PROTECTED WITH 1/2" OF SOL. SHEATHING USED TO PREVENT DIRECT CONTACT SHALL HAVE A THICKNESS OF GREATER THAN .005; AND THE SHEATHING SHALL BE MANUFACTURED FROM GRAY CAST IRON OR SHALL CONFORM TO ASTM A 74. IF BEING PROVIDED WITH A RELIEVING ARCH, OR A PIPE SLEEVE SHALL BE BUILT INTO THE FOUNDATION WALL. THE SL SHALL BE TWO TIMES GREATER THAN THE PIPE PASSING THOUGH THE WALL OR FOOTING.
- 5) PLUMBING VENTS: FLASH ROOF VENT INTO ROOFING SYSTEM AS REQUIRED BY THE ROOFING CONTRACTOR. VENTS TO ROOF SHALL BE PROTECTED WITH 1/2" OF SOL. SHEATHING. IF BEING PROVIDED WITH A RELIEVING ARCH, OR A PIPE SLEEVE SHALL BE BUILT INTO THE FOUNDATION WALL. THE SLEEVE SHALL BE TWO TIMES GREATER THAN THE PIPE PASSING THOUGH THE WALL OR FOOTING.
- INSULATION:
- ALL INSULATIONS AND ACCESSORIES SHALL HAVE A FIRE HAZARD CLASSIFICATION WITH A FLAME SPREAD RATINGS OF NOT OVER 25, A FUEL CONTRIBUTION RATINGS OF NOT OVER 50, AND A SMOKE DEVELOPMENT RATING OF NOT OVER 50, IN ACCORDANCE WITH NFPA.
- PI. PIPE INSULATION - ABOVE GRADE.
- 1) THE PIPING INSULATION USED SHALL HAVE A THERMAL CONDUCTIVITY OF 0.27 BTU IN/IN<sup>2</sup>FT<sup>2</sup>HR OR LESS.
- 2) FIBERGLASS INSULATION WITH FACTORY APPLIED VAPOR BARRIER, ASK JACKET, FACTORY APPLIED PRESSURE SEALING LONGITUDE LAP JOINT, NO STAPLES, ZESTON, PREMOULDED PIPING FITTING COVERS. INSTALLATION TO BE IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
- 3) FLEXIBLE CLOSED CELL ELASTOMER THERMAL INSULATION, UNSULIT OR PRESULIT NATURAL PRESSURE SENSITIVE CHEMICAL RESISTANT, OR GLOUSE AND VAPOR SEALING, TO BE STRONGS AR, ARMAFLEX OR ARMAFLEX 2000.
- 4) FOR NON CIRCULATING SYSTEMS, THE FIRST 8 FEET OF INLET AND OUTLET PIPING BETWEEN THE TANK AND THE HEAT TRAP (INCLUDING THE HEAT TRAP) MUST BE INSULATED.
- 5) FOR CIRCULATING SYSTEMS, ALL HOT WATER PIPING IN THE CIRCULATION LOOP MUST BE INSULATED AS SPECIFIED BELOW.
- 6) INSULATION SCHEDULE.
- a) DOMESTIC COLD WATER 1/2"
- b) DOMESTIC HOT WATER 1" FOR PIPING UP TO 1-1/4"; 1-1/2" FOR PIPING 1-1/2" AND LARGER
- c) HOT WATER RECIPIENT TANKS 1"
- d) CONDENSATE DRAINS INSIDE BUILDING 1"
- e) REFRIGERANT SUCTION 3/4" FOR PIPING UP TO 1-1/4"; 1" FOR PIPING 1-1/2" AND LARGER
- f) HORIZONTAL STORM PIPE 2"
- g) HORIZONTAL STORM OVERFLOW PIPE 1/2"
- ????? 1) ROOF DRAINS 1" INSULATION SHALL BE PROVIDED AT ROOF DRAIN BODY AND A MINIMUM OF 10' OF HORIZONTAL INSULATION TO THE DOWNSTREAM END OF THE INSULATION OF HORIZONTAL AND VERTICAL STORM PIPING DOWNSTREAM OF ROOF DRAIN BODY.


- a) DOMESTIC COLD WATER 1/2"  
 b) DOMESTIC HOT WATER 1" FOR PIPING UP TO 1-1/4", & 1-1/2" FOR PIPING 1-1/2" AND LARGER  
 c) HOT WATER RECIRCULATIONS 1"  
 d) CONDENSATE DRAINS INSIDE BUILDING 1/2"  
 e) REFRIGERANT SUCTION 3/4" FOR PIPING UP TO 1-1/4", & 1" FOR PIPING 1-1/2" AND LARGER  
 f) HORIZONTAL STORM PIPE 1/2"  
 g) HORIZONTAL STORM OVERFLOW PIPE 1/2"  
 h) ROOF DRAINS 1" INSULATION SHALL BE PROVIDED AT A MINIMUM OF 10' OF HORIZONTAL PIPING OR A MINIMUM OF 5' IF COMBINATION OF HORIZONTAL AND VERTICAL STORM PIPING DOWNSTREAM OF ROOF DRAIN BODY.



5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753

**SCANNELL**  
PROPERTIES

## CERTIFICATION

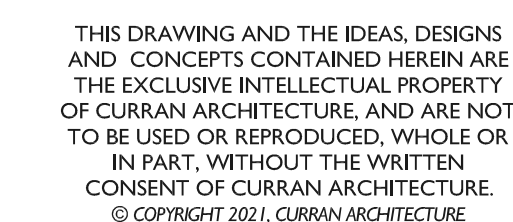

## PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT 1

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

## ISSUE DATES

PERMIT SET	02.18.22
CITY COMMENTS	10.17.22

HERITAGE ELECTRIC, L.L.C.  
841 N. MARTWAY  
Olathe, Kansas  
phone (913) 747 0528  
fax (913) 747 0539



THIS DRAWING HAS BEEN PRODUCED BY HERITAGE  
ELECTRIC, LLC, FOR THEIR COORDINATION OF THE  
ELECTRICAL INSTALLATION AND MAY NOT BE USED  
FOR ANY OTHER PURPOSE  
COPYRIGHT 2008, HERITAGE ELECTRIC, LLC.

THE SEAL OF THE ELECTRICAL P.E. APPLIES  
TO ONLY THIS DRAWING, SPECIFICATIONS AND OTHER  
DOCUMENTS BEARING THE PERSONAL SEAL OF THE  
UNDERSIGNED PROFESSIONAL AND SHALL BE HIS  
RESPONSIBILITY FOR ALL OTHER DRAWINGS,  
SPECIFICATIONS, ESTIMATES, REPORTS OR OTHER  
DOCUMENTS WHICH DO NOT CONTAIN THE PERSONAL  
SEAL OF THE UNDERSIGNED PROFESSIONAL.

210300


## WAREHOUSE LIGHTING

# EI.0


# 1 Warehouse lighting Plan





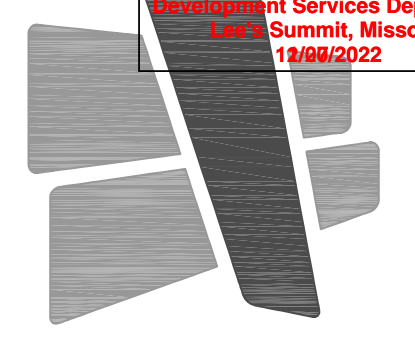


**CURRAN**  
ARCHITECTURE  
5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

CERTIFICATION

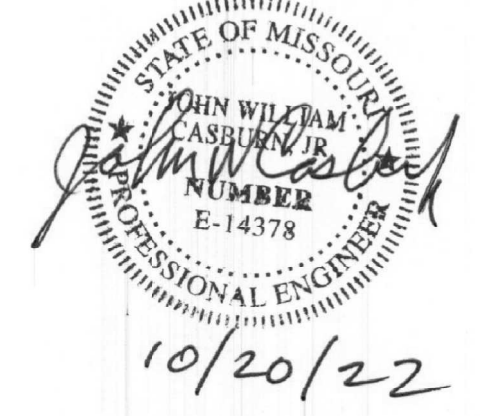

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT 1

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


ISSUE DATES

PERMIT SET	02.18.22
CITY COMMENTS	10.17.22



210300

OFFICE LIGHTING


**EI.1**

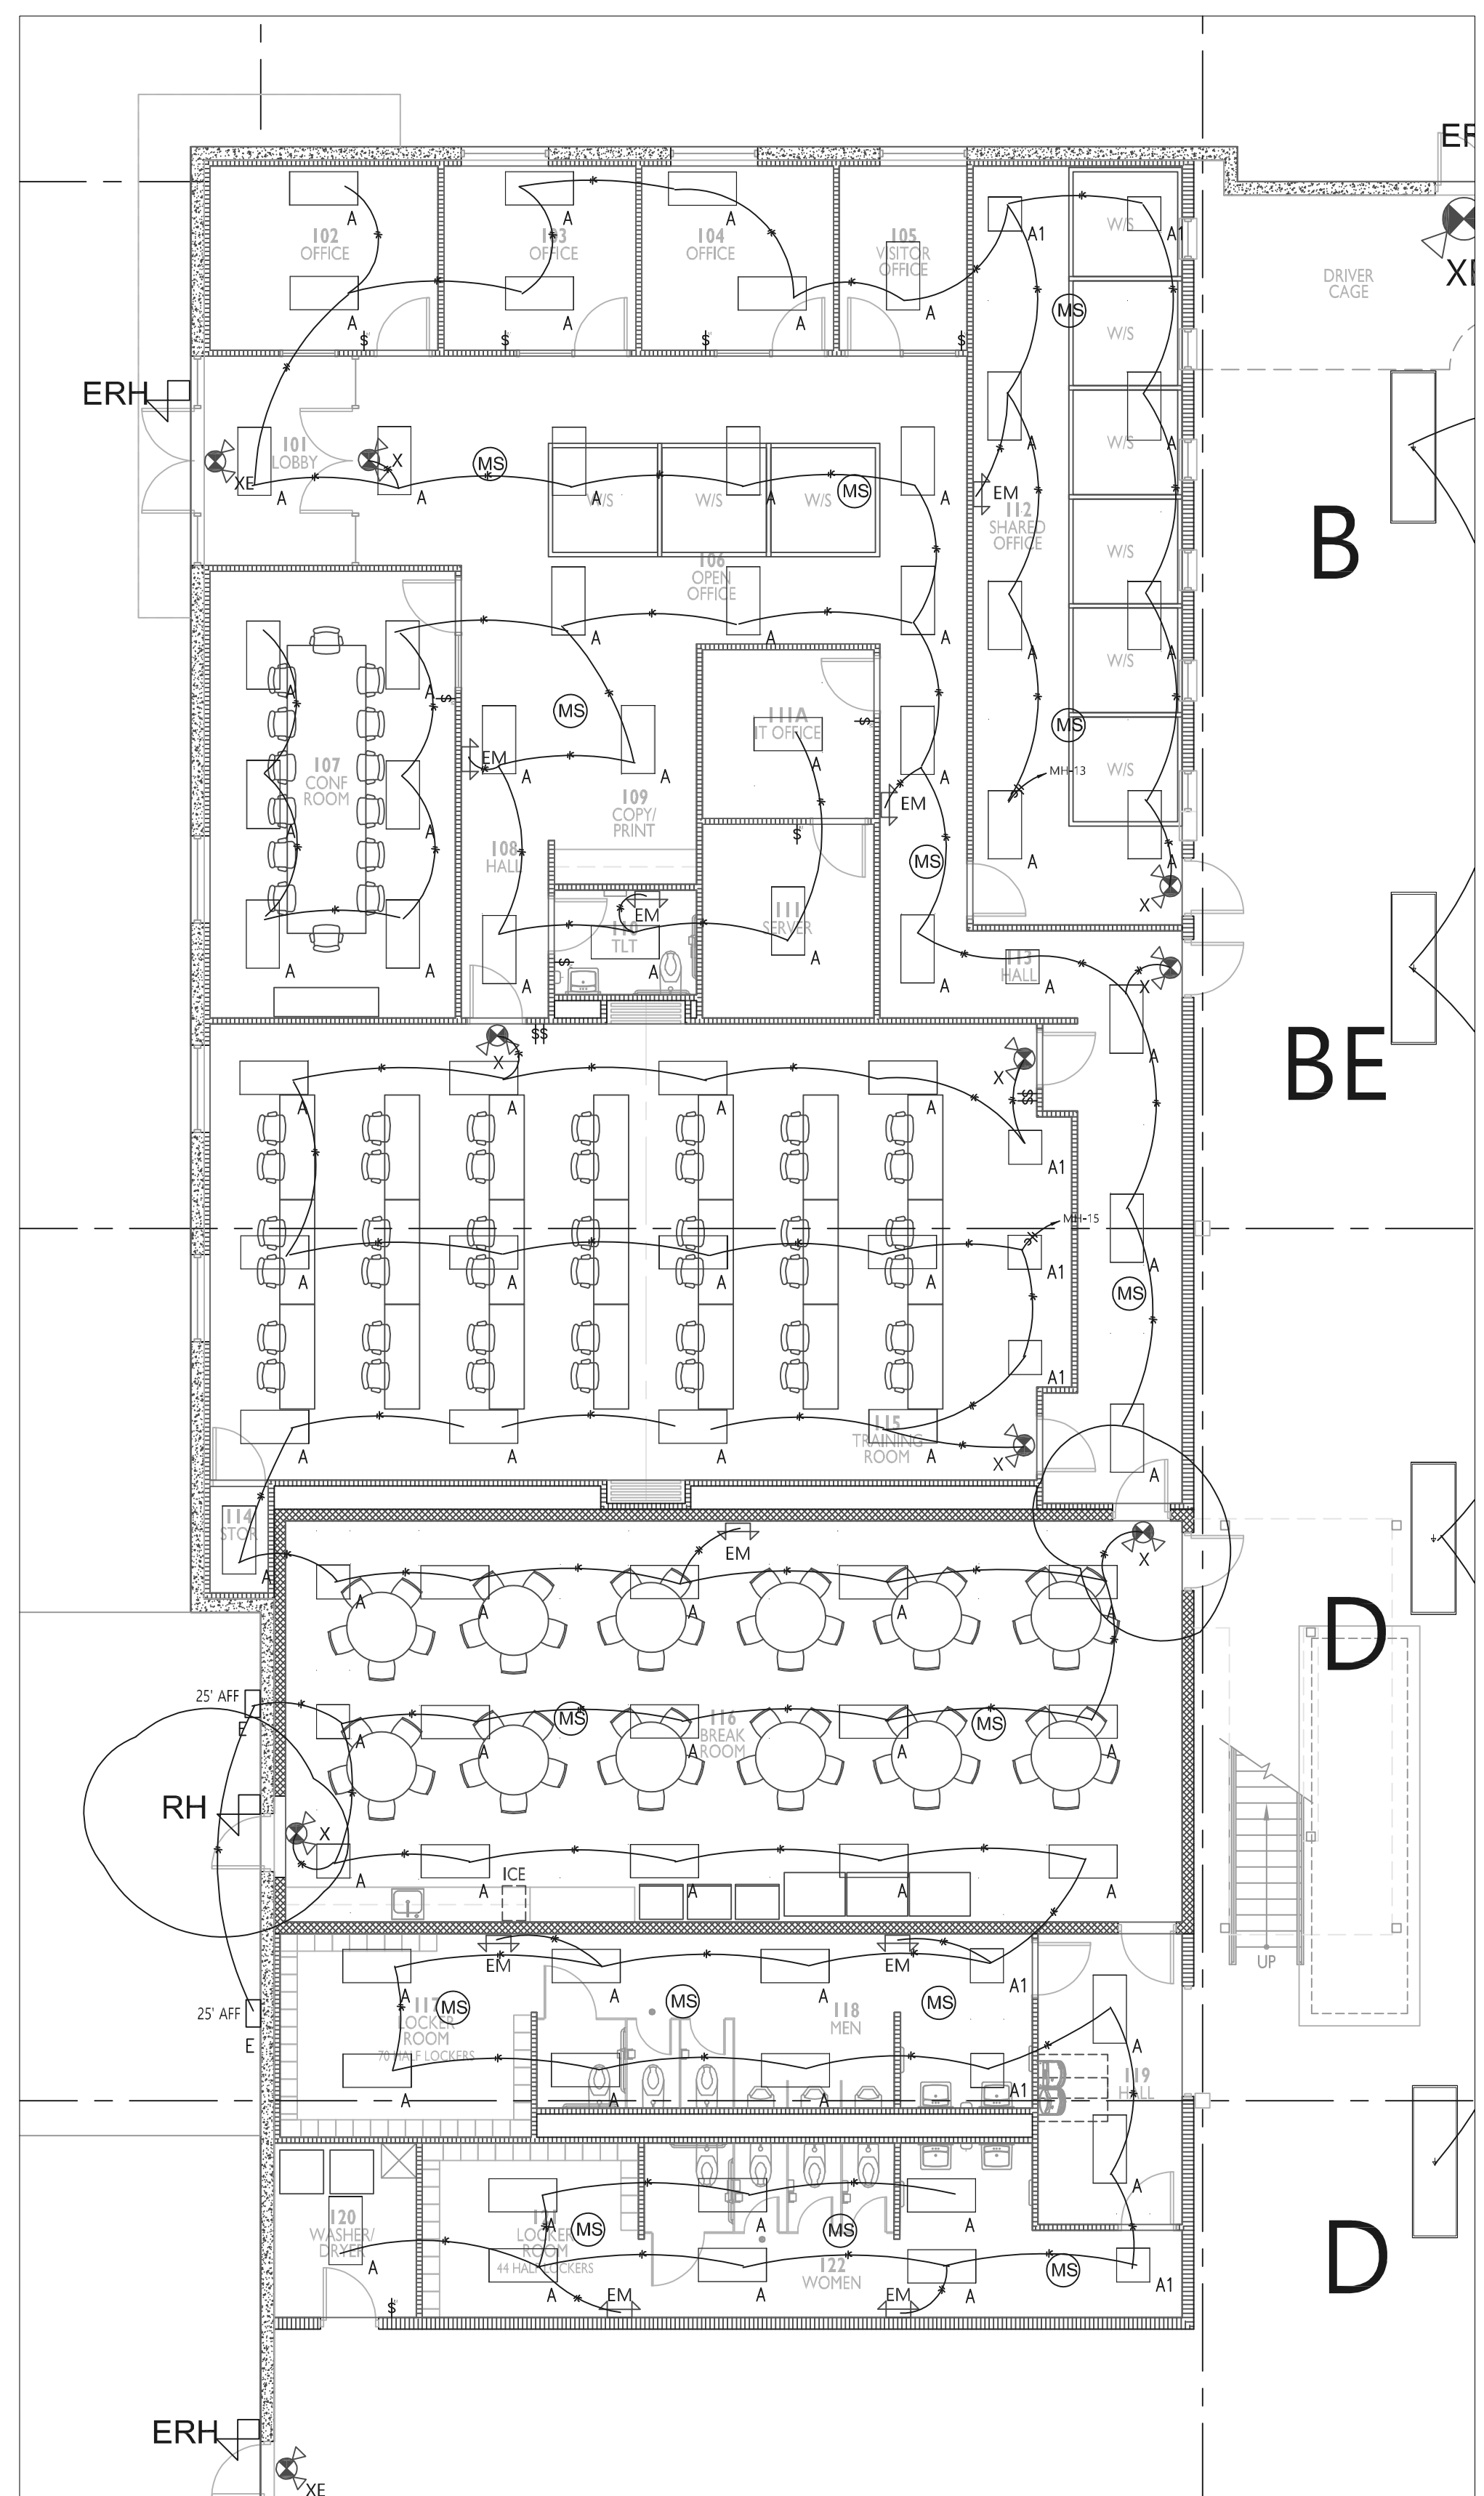


**1** Office lighting Plan  
scale: 1/8"=1'

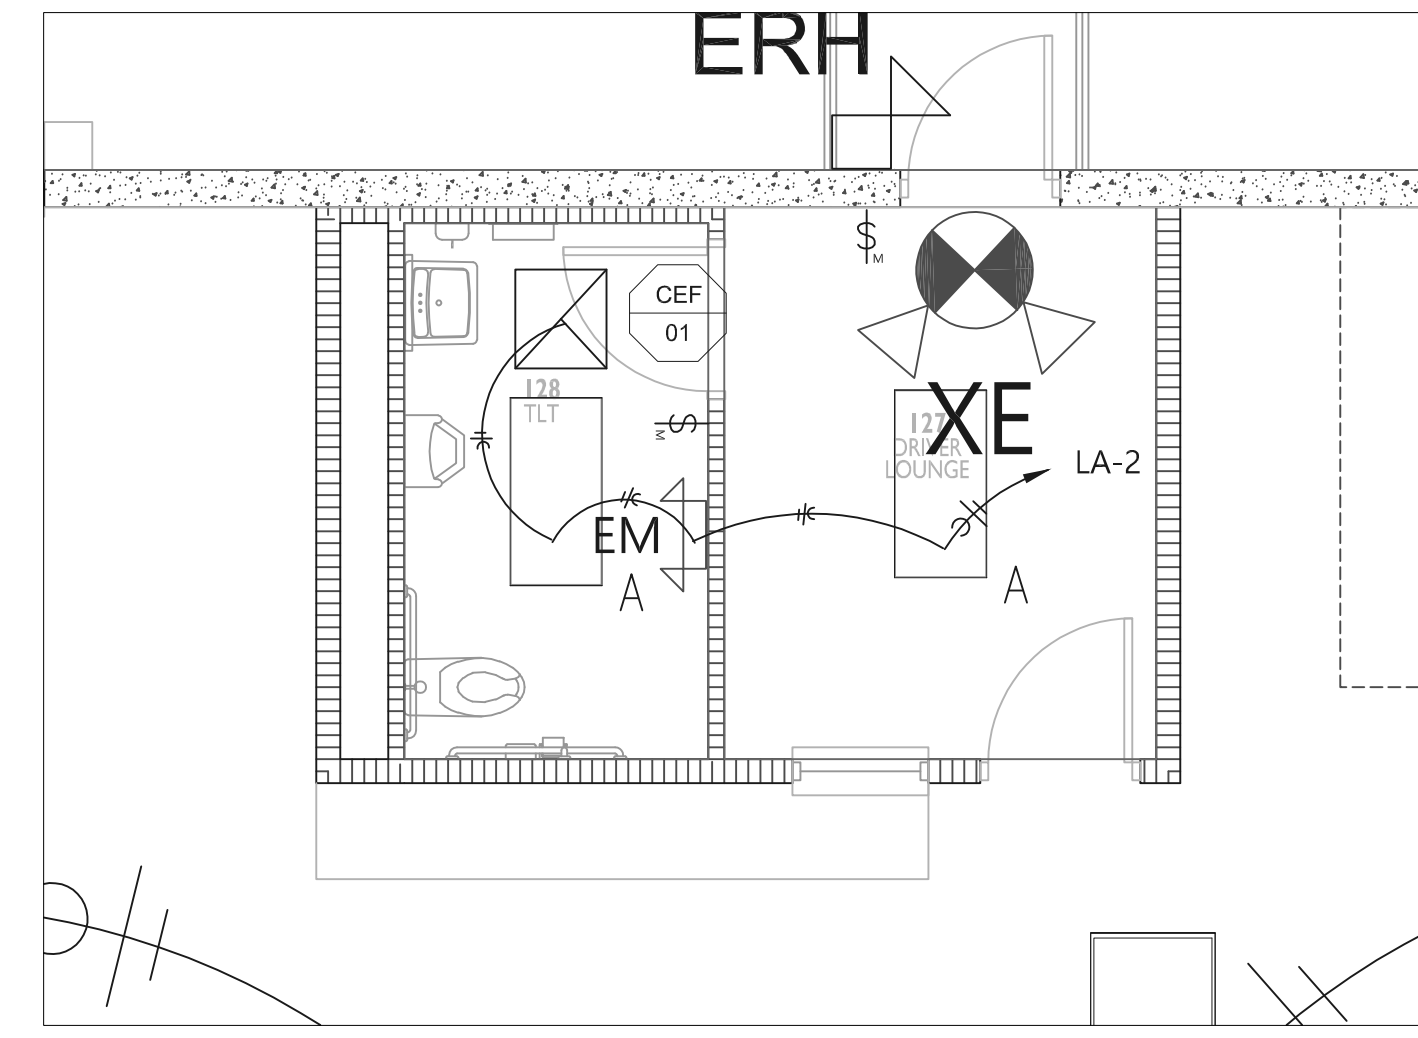

**2** Drivers Office lighting Plan  
scale: 1/4"=1' north

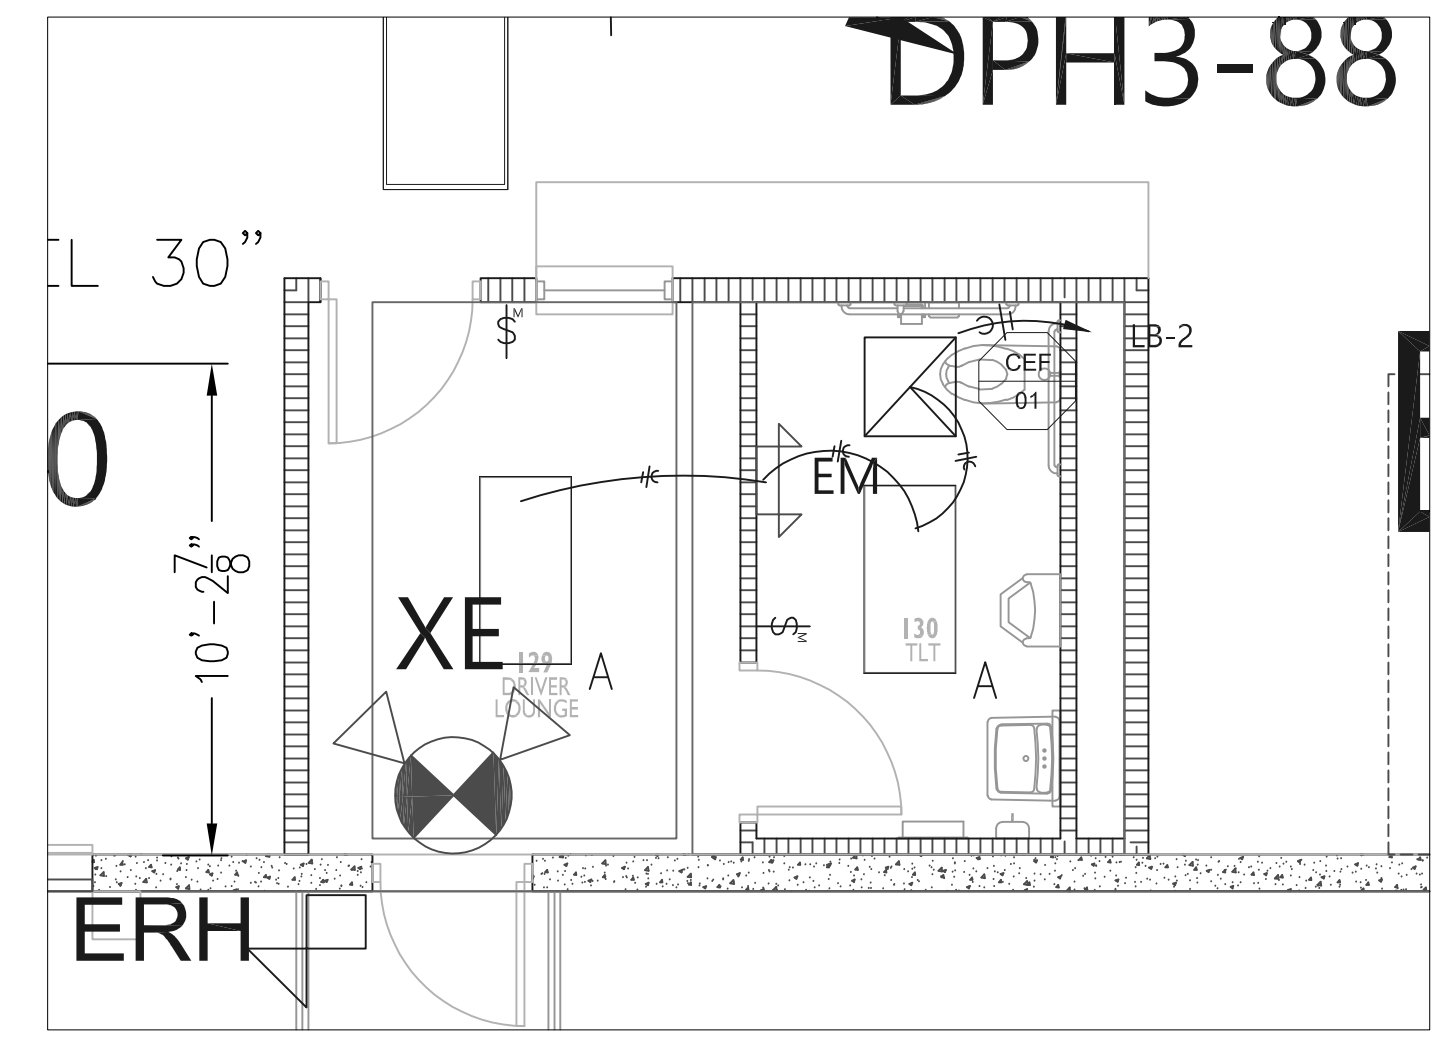

**3** Drivers Office lighting Plan  
scale: 1/4"=1' north

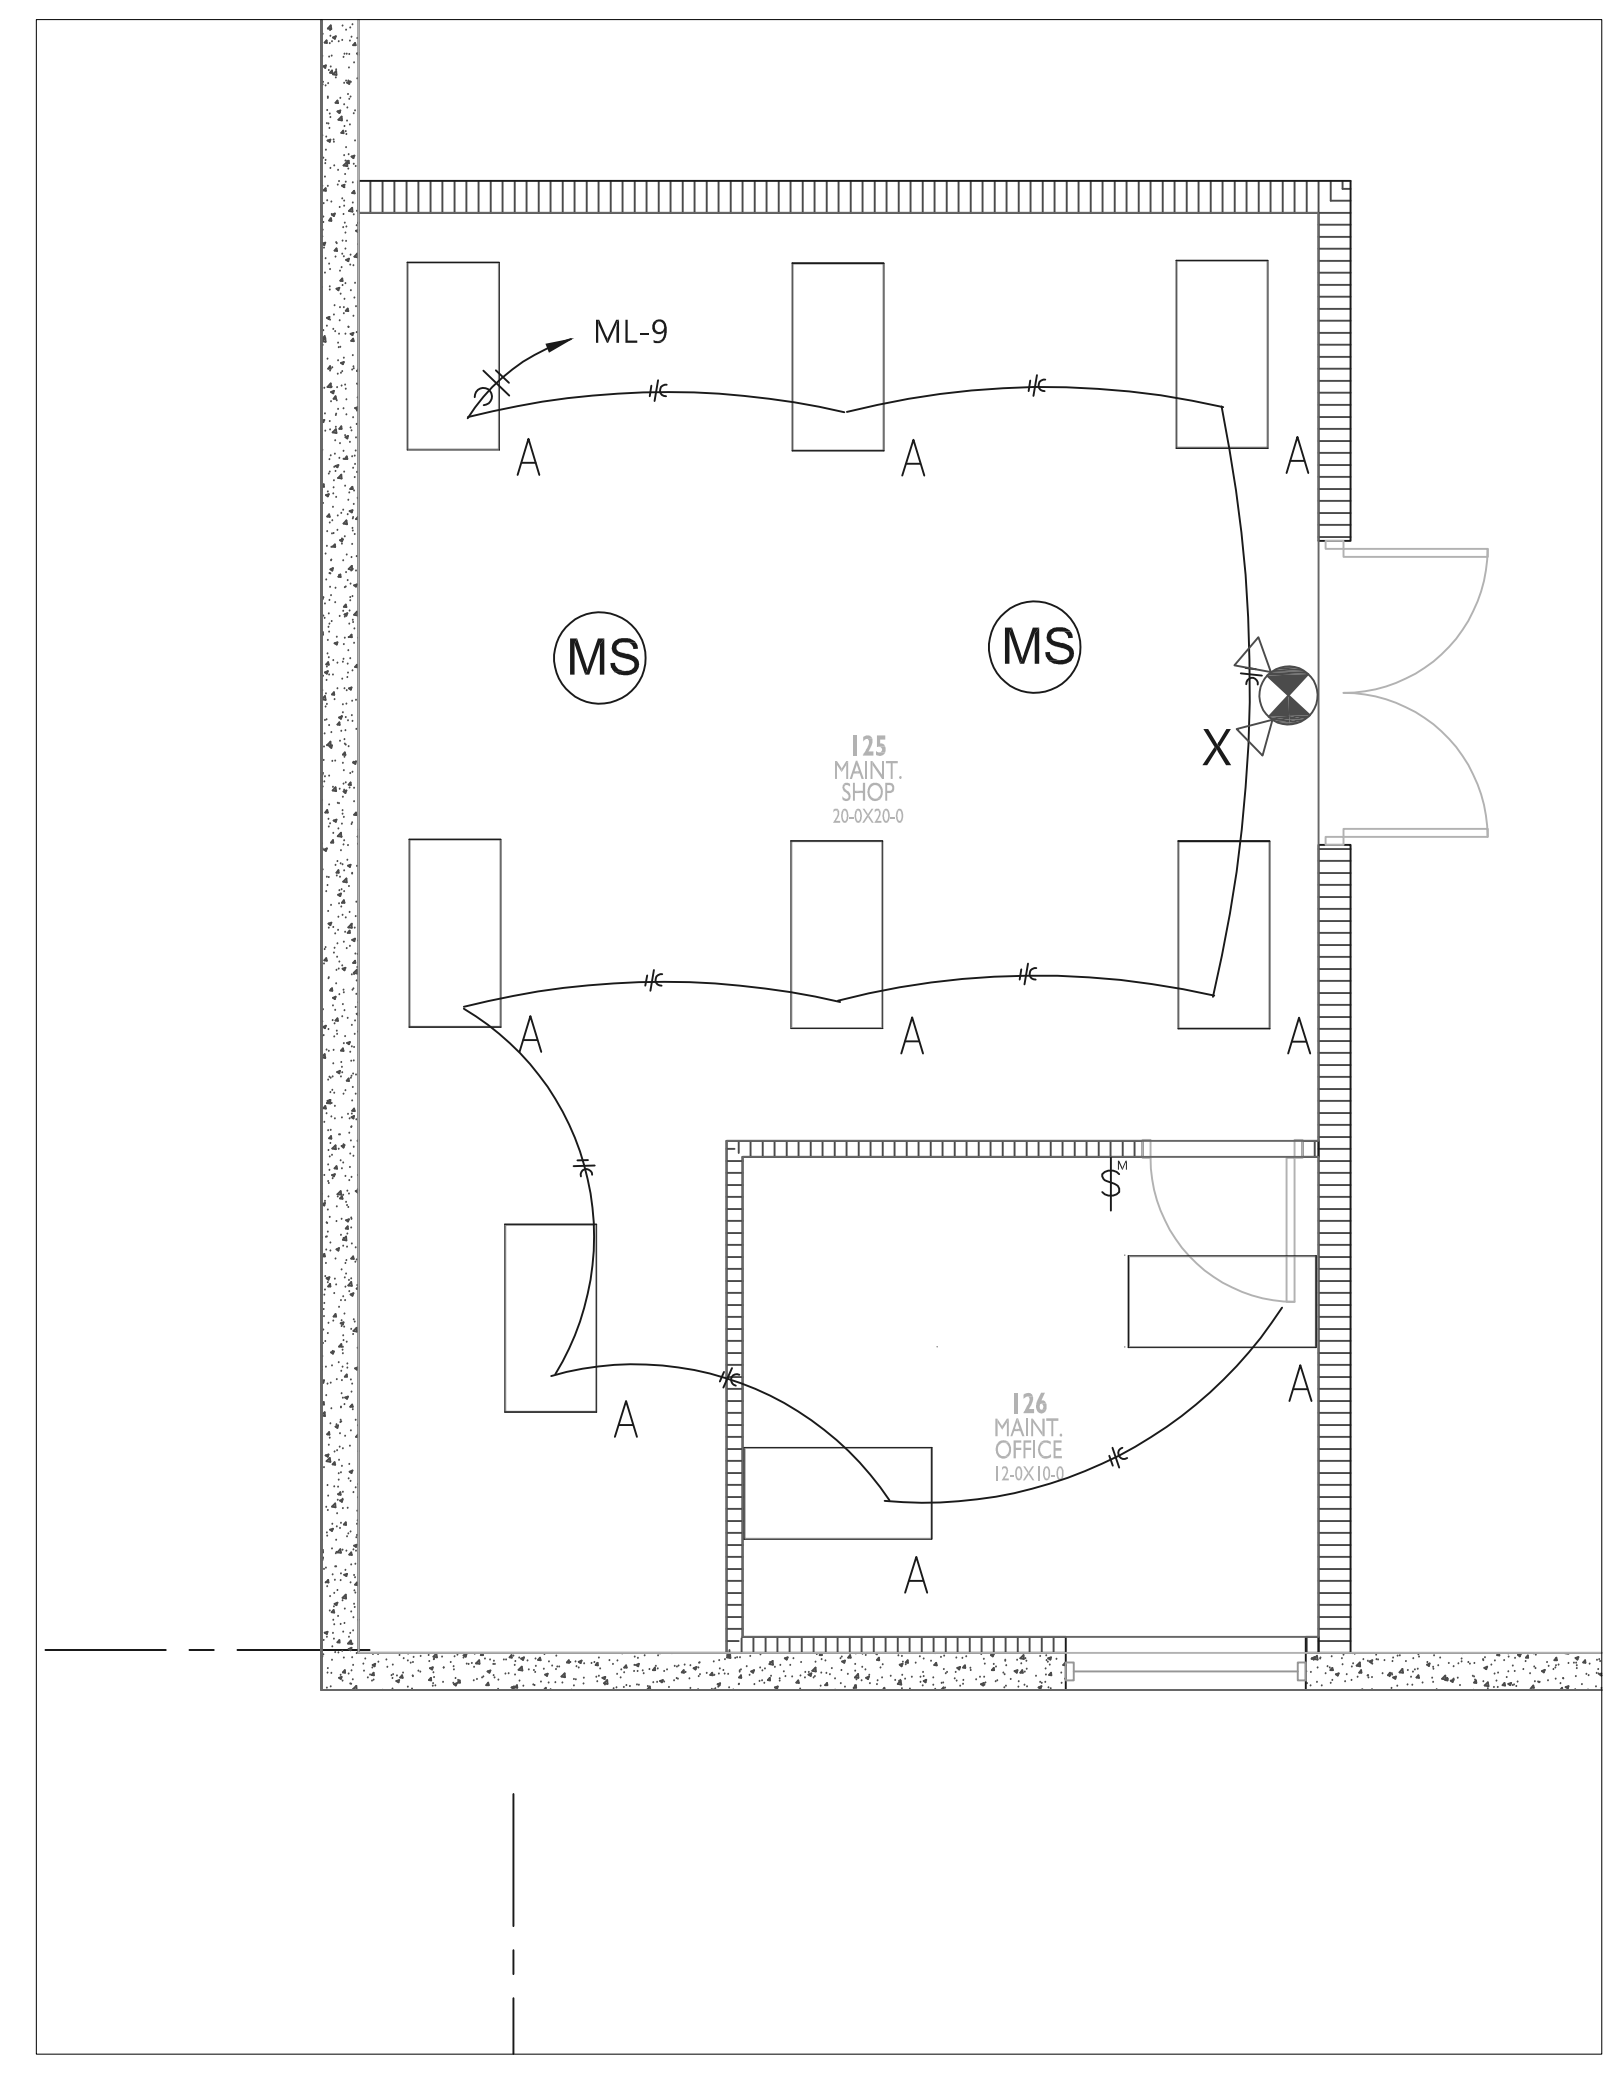

**4** Maintenance Office lighting Plan  
scale: 1/4"=1' north




HERITAGE ELECTRIC, L.L.C.  
841 N. MARTWAY  
Olathe, Kansas  
phone (913) 747 0528  
fax (913) 747 0539



THIS DRAWING HAS BEEN PRODUCED BY HERITAGE ELECTRIC, LLC. FOR THEIR COORDINATION OF THE ELECTRICAL INSTALLATION AND MAY NOT BE USED FOR ANY OTHER PURPOSE.  
COPYRIGHT 2008, HERITAGE ELECTRIC, LLC.  
THE SEAL OF THE ELECTRICAL P.E. APPLIES TO ONLY THIS DRAWING. SPECIFICATIONS AND OTHER DOCUMENTS BEARING THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL AND DISCLAIM ANY RESPONSIBILITY FOR ALL OTHER DRAWINGS, SPECIFICATIONS, ESTIMATES, REPORTS OR OTHER DOCUMENTS WHICH DO NOT CONTAIN THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL.



5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



**SCANNELL**  
PROPERTIES

STATE OF MISSOURI  
JOHN WILLIAM CASPER, JR.  
PROFESSIONAL ENGINEER  
NUMBER E-14378  
10/20/22

## PROJECT INFORMATION

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

PERMIT SET	02.18.22
CITY COMMENTS	10.17.22




**HERITAGE**  
ELECTRIC

THE SEAL OF THE ELECTRICAL P.E. APPLIES  
TO ONLY THIS DRAWING, SPECIFICATIONS AND OTHER  
DOCUMENTS BEARING THE PERSONAL SEAL OF THE  
UNDERSIGNED PROFESSIONAL AND DISCLAIM ANY  
RESPONSIBILITY FOR ALL OTHER DRAWINGS,  
SPECIFICATIONS, ESTIMATES, REPORTS OR OTHER  
DOCUMENTS WHICH DO NOT CONTAIN THE PERSONAL  
SEAL OF THE UNDERSIGNED PROFESSIONAL

## WAREHOUSE POWER


## E2.0

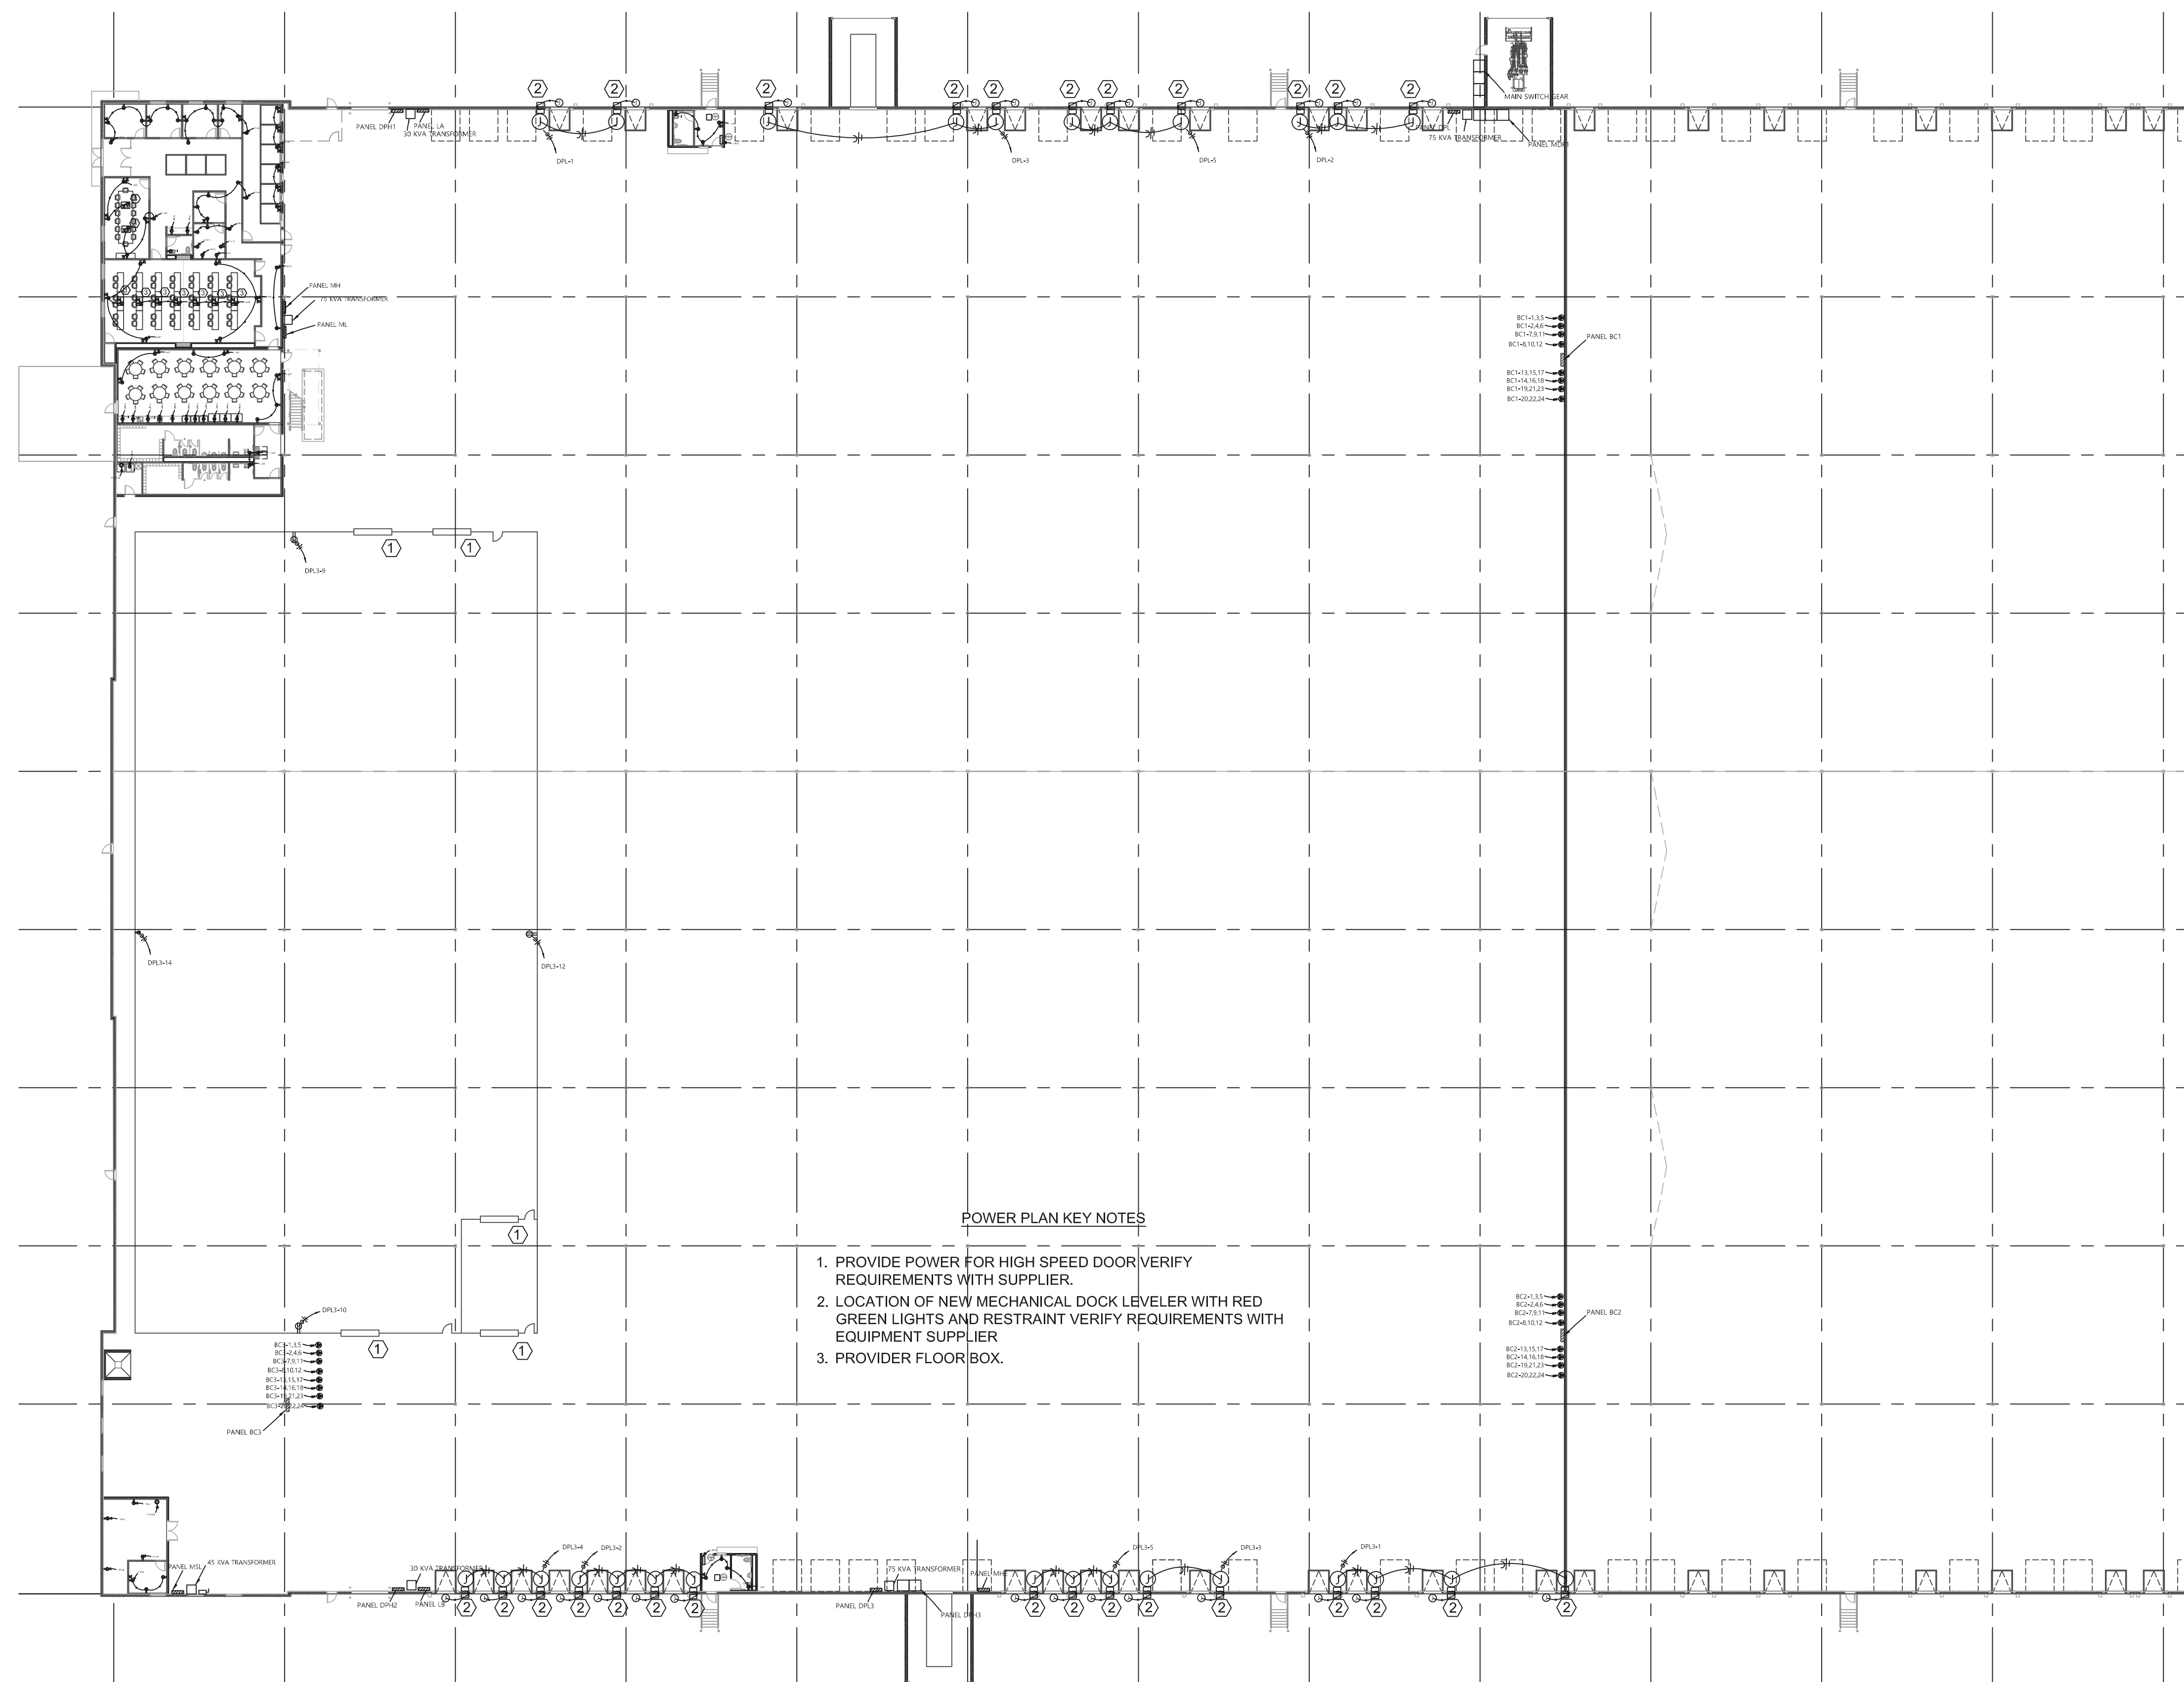

# 1 Warehouse Power Plan






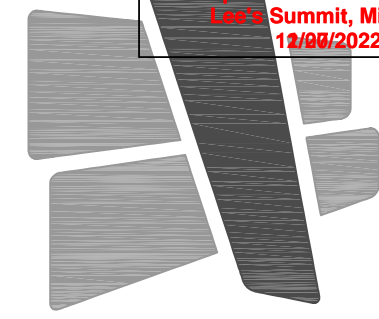

# CURRAN ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



## SCANNELL PROPERTIES

### CERTIFICATION



10/20/22

THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY  
OF CURRAN ARCHITECTURE, AND ARE NOT  
TO BE USED OR REPRODUCED, WHOLE OR  
IN PART, WITHOUT THE WRITTEN  
CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

### PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT 1

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


### ISSUE DATES

PERMIT SET	02.18.22
CITY COMMENTS	10.17.22



210300

OFFICE POWER


# E2.I

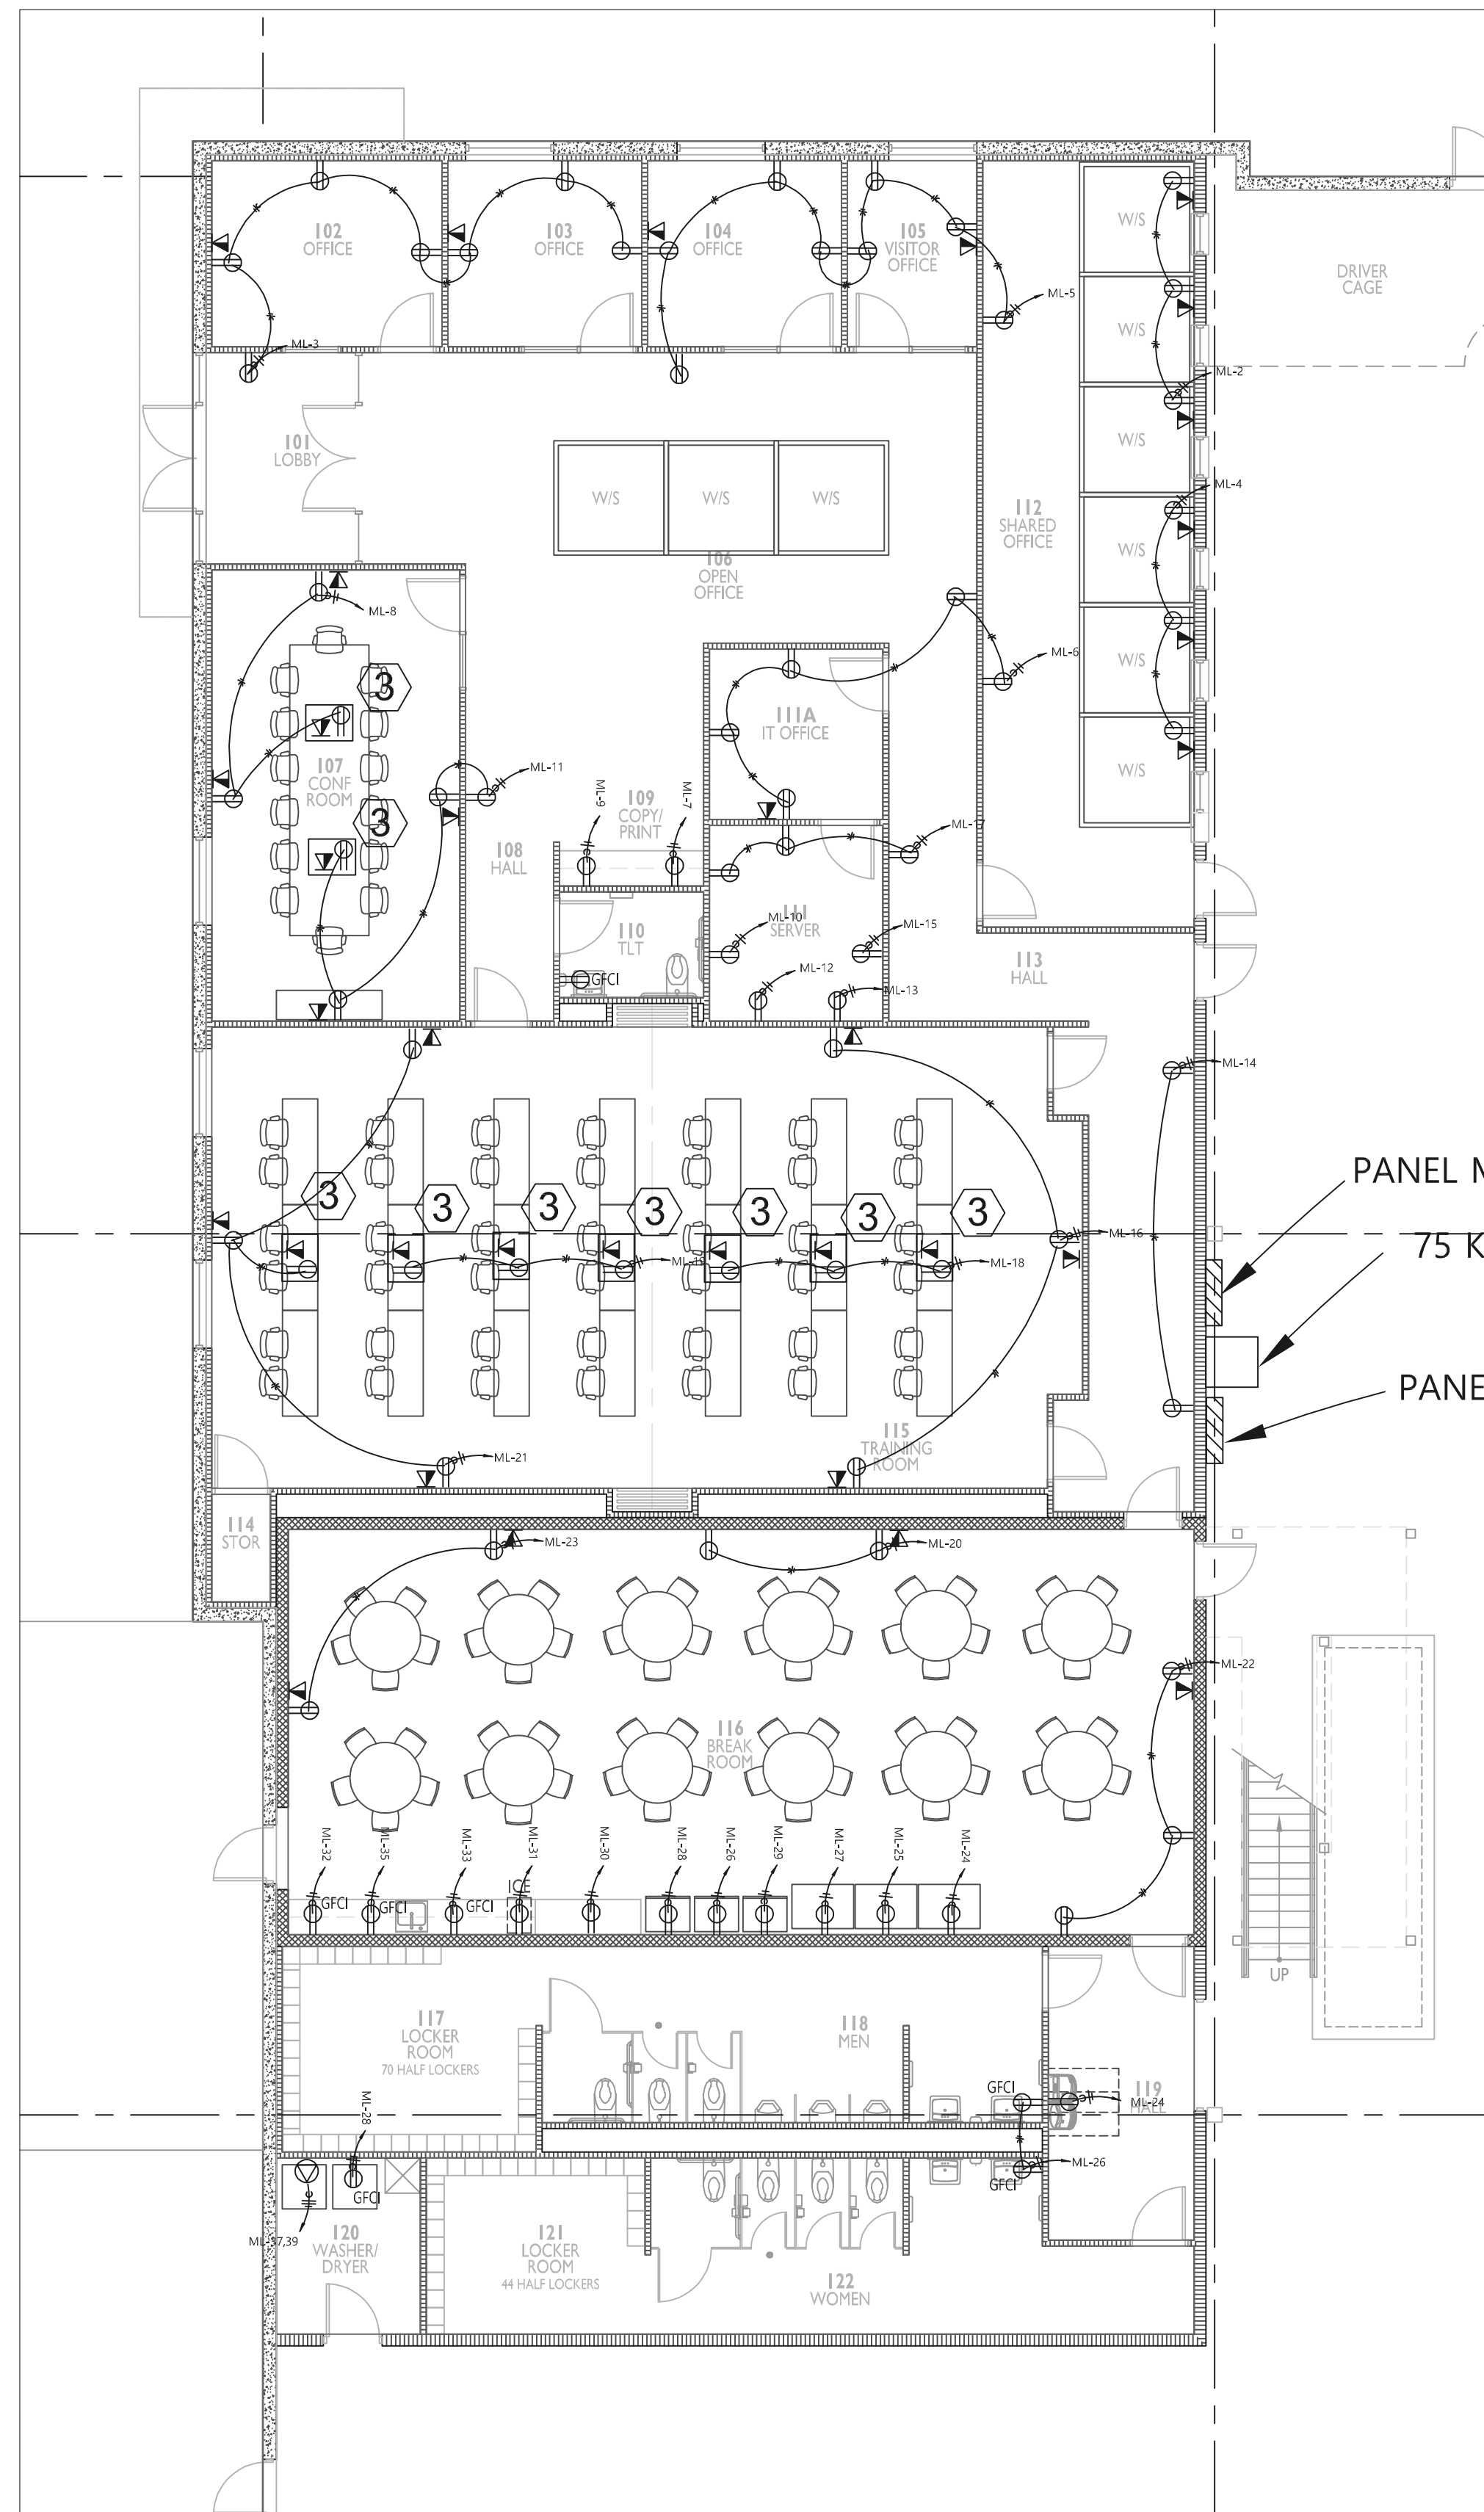


**1** Office Power Plan  
scale: 1/8"=1'

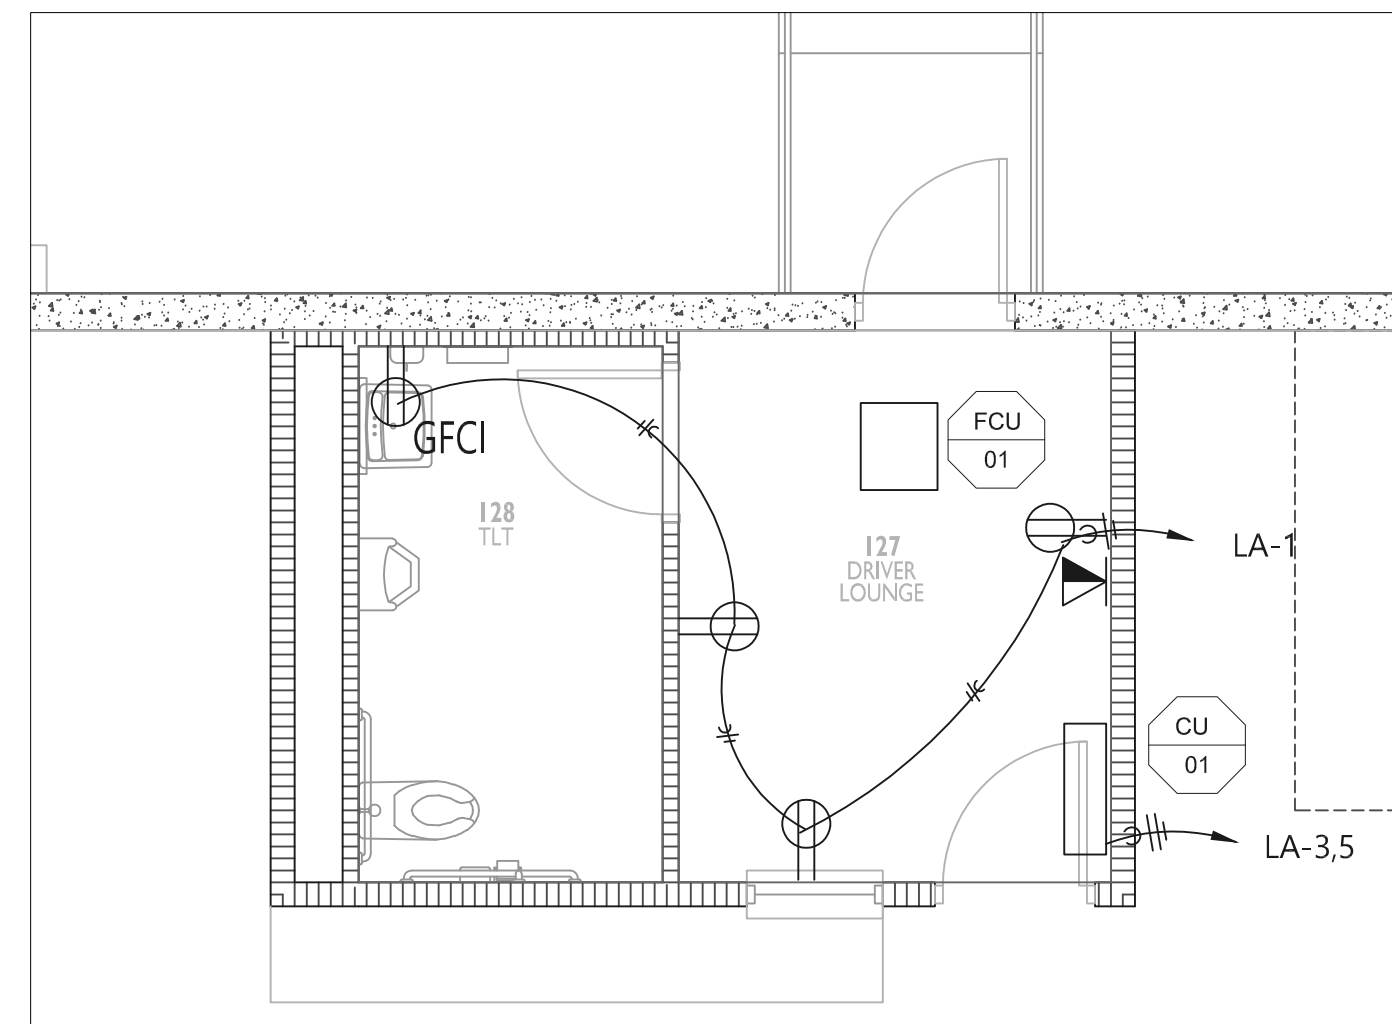

**2** Drivers Office Power Plan  
scale: 1/4"=1'

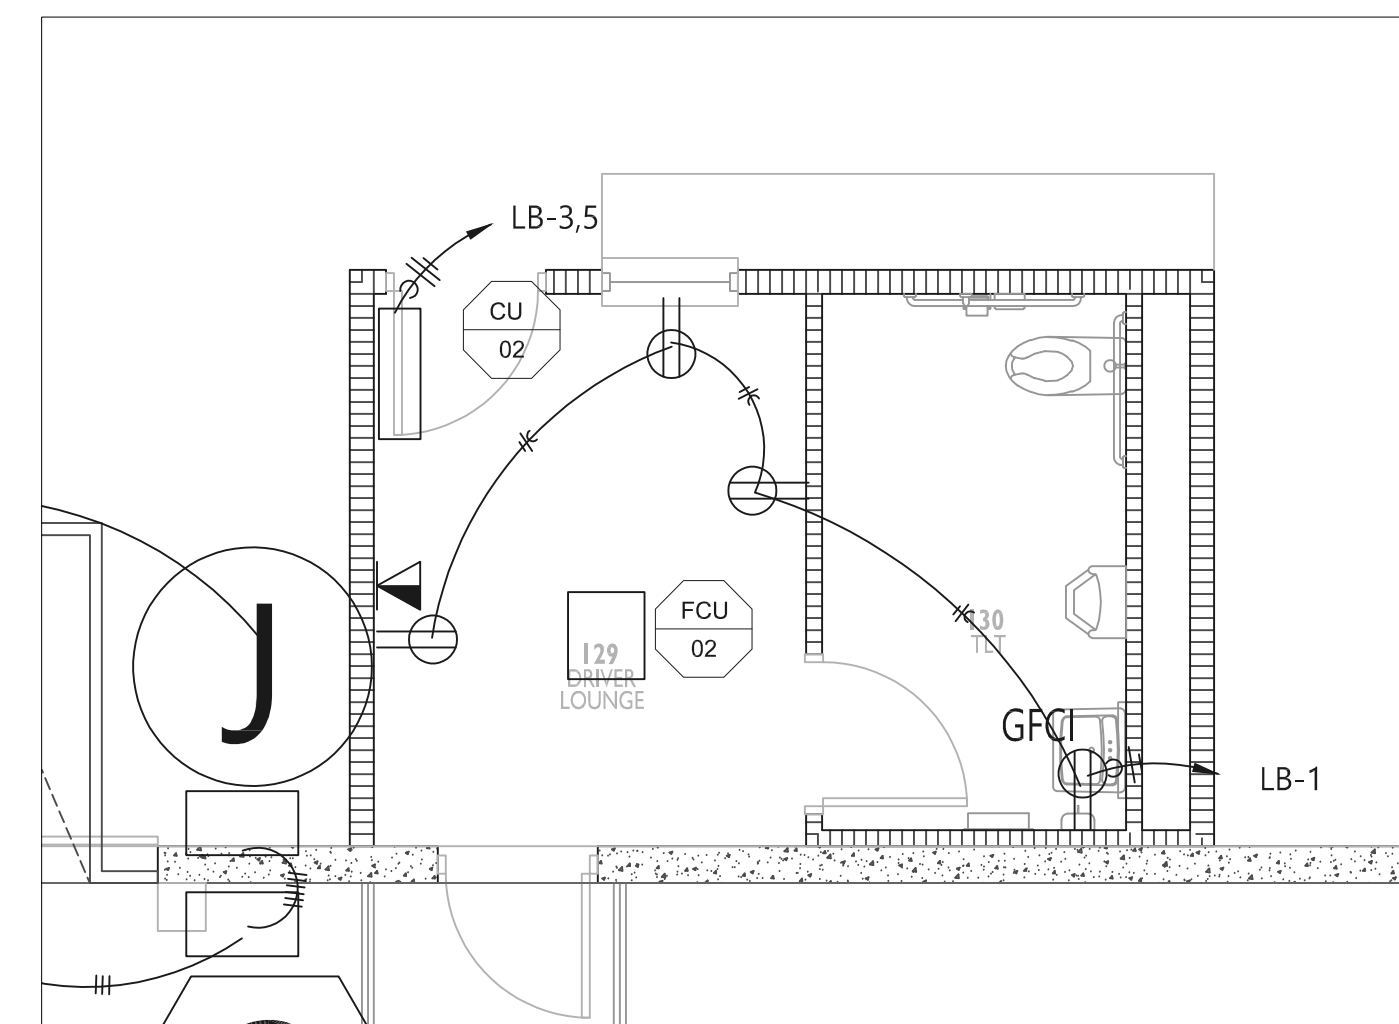

**3** Drivers Office Power Plan  
scale: 1/4"=1'

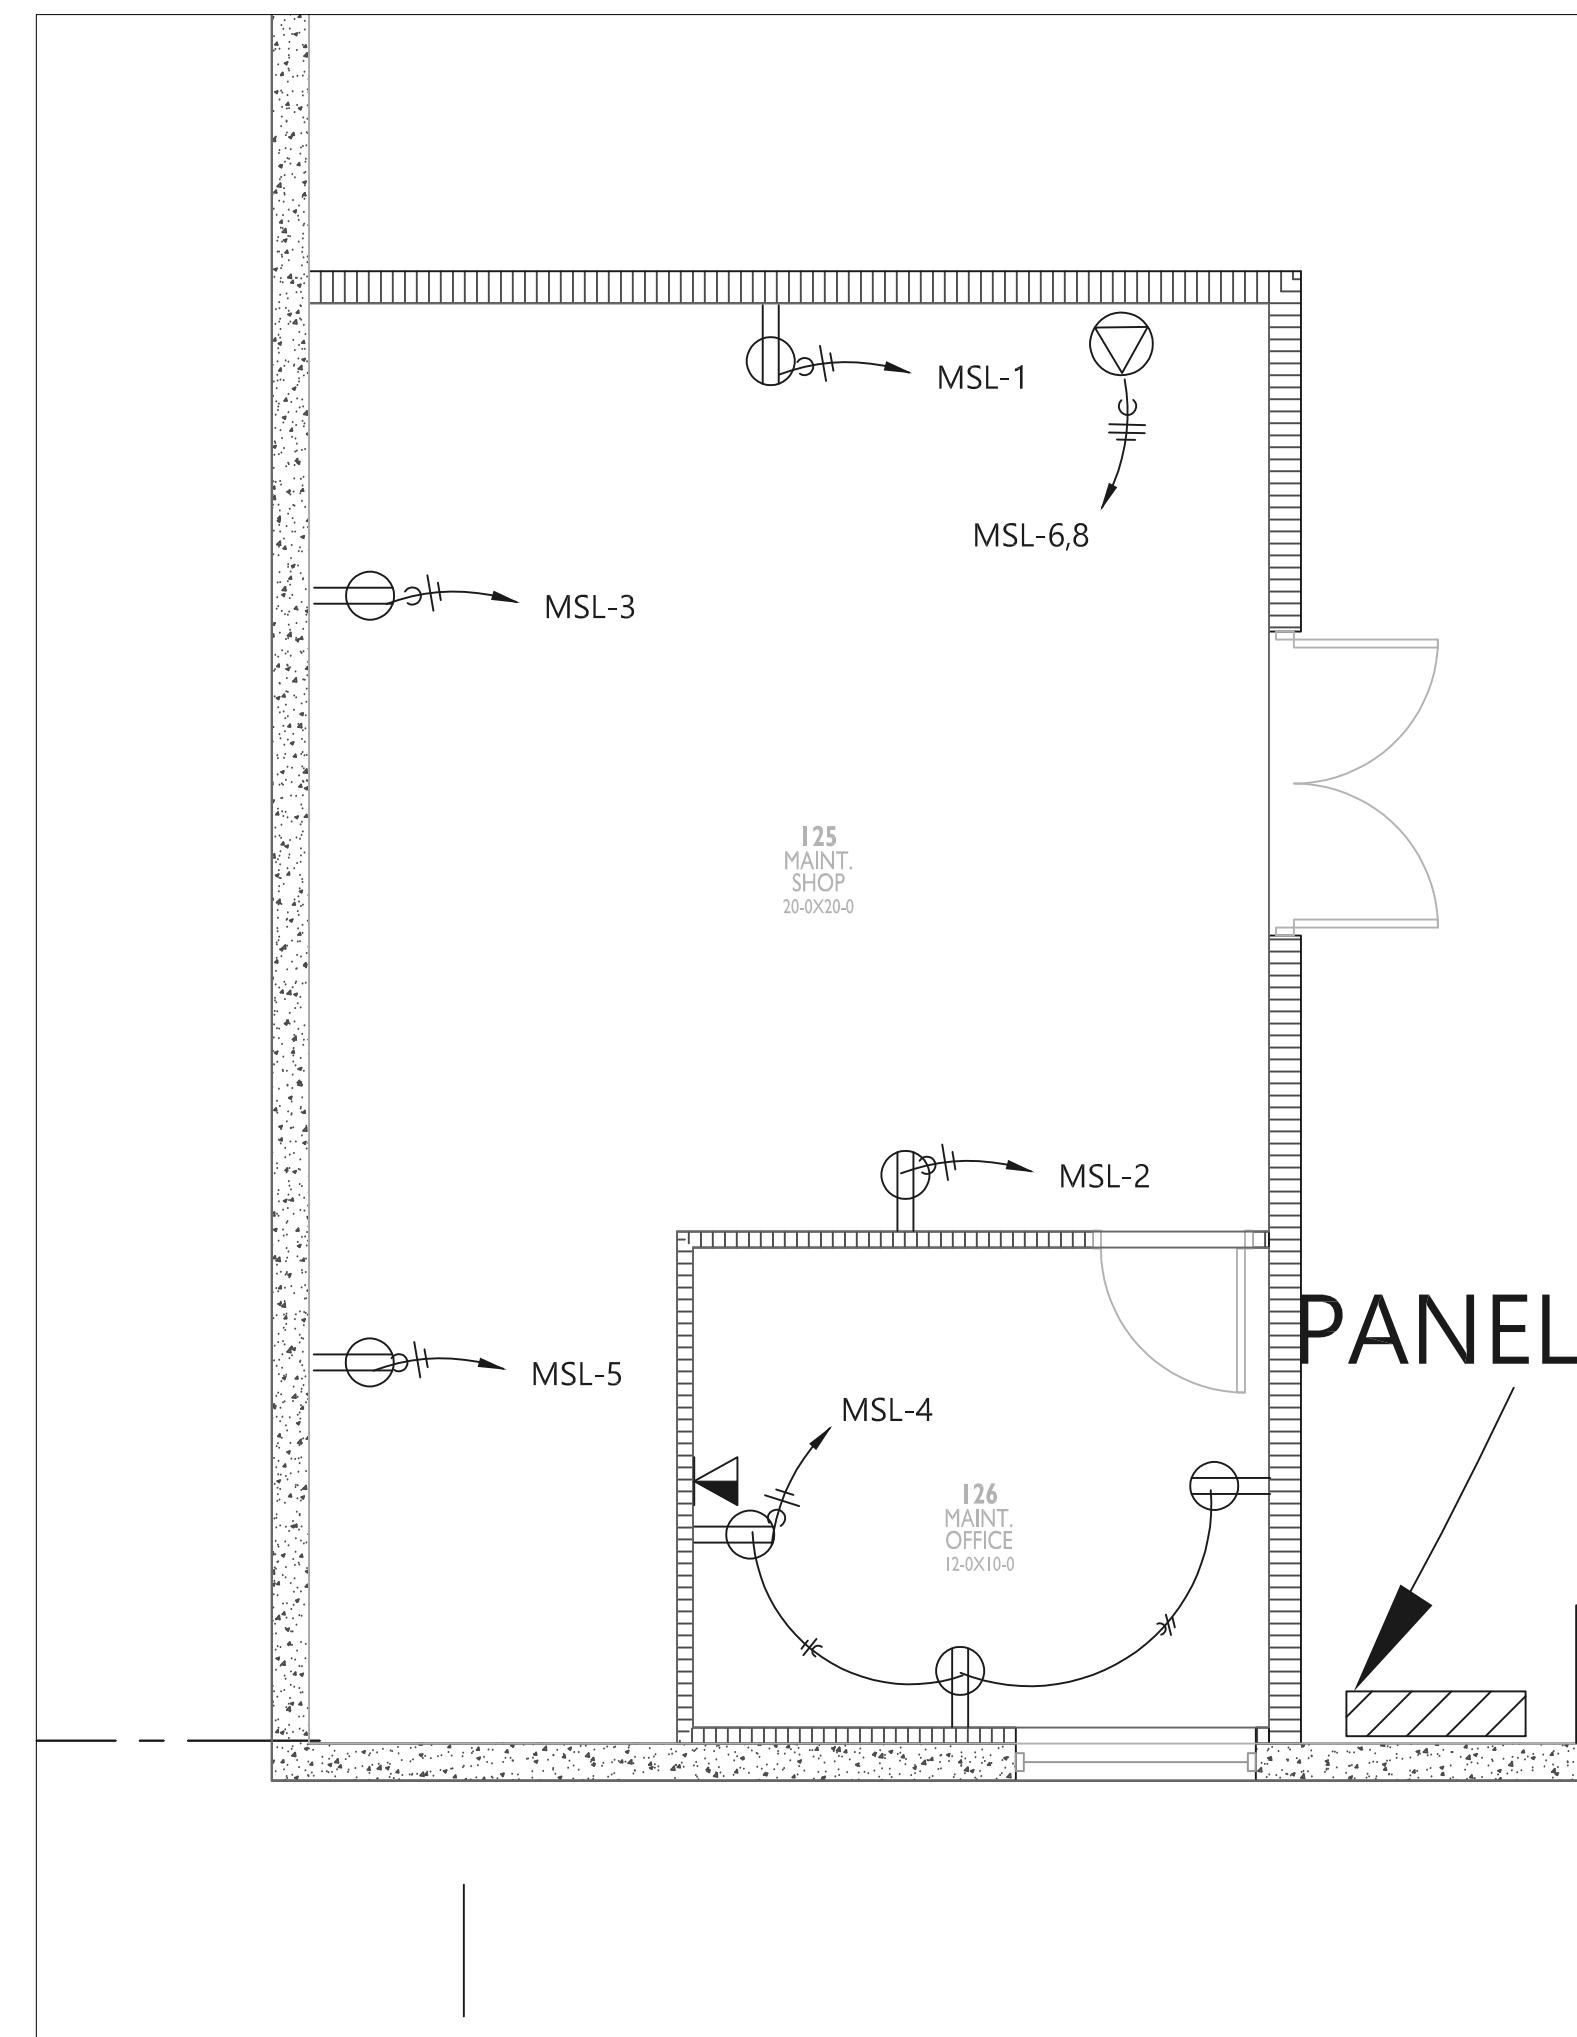

**4** Maintenance Office Power Plan  
scale: 1/4"=1'




HERITAGE ELECTRIC, L.L.C.  
841 N. MARTWAY  
Olathe, Kansas  
phone (913) 747 0528  
fax (913) 747 0539




THIS DRAWING HAS BEEN PRODUCED BY HERITAGE  
ELECTRIC, L.L.C. FOR THEIR COORDINATION OF THE  
ELECTRICAL INSTALLATION AND MAY NOT BE USED  
FOR ANY OTHER PURPOSE  
COPYRIGHT 2008, HERITAGE ELECTRIC, L.L.C.  
THE SEAL OF THE ELECTRICAL P.E. APPLIES  
TO ONLY THIS DRAWING. SPECIFICATIONS AND OTHER  
DOCUMENTS BEARING THE PERSONAL SEAL OF THE  
UNDERIGNED PROFESSIONAL AND DISCLAIM ANY  
RESPONSIBILITY FOR ALL OTHER DRAWINGS.  
SPECIFICATIONS, ESTIMATES, REPORTS OR OTHER  
DOCUMENTS WHICH DO NOT CONTAIN THE PERSONAL  
SEAL OF THE UNDERIGNED PROFESSIONAL



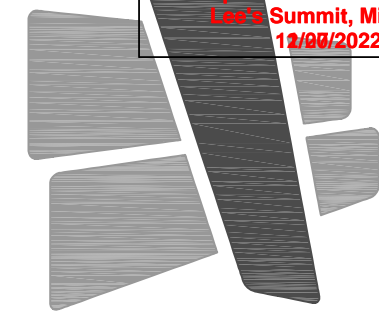


**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

CERTIFICATION

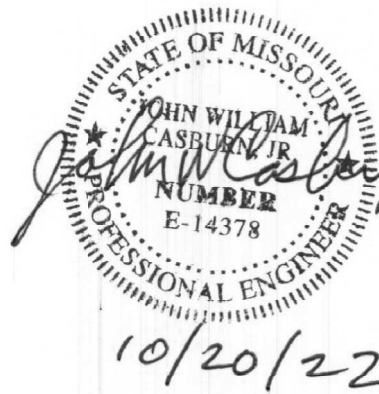

THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY  
OF CURRAN ARCHITECTURE, AND ARE NOT  
TO BE USED OR REPRODUCED, WHOLE OR  
IN PART, WITHOUT THE WRITTEN  
CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


ISSUE DATES

PERMIT SET	02.18.22
CITY COMMENTS	10.17.22


210300

HVAC POWER


**E3.0**

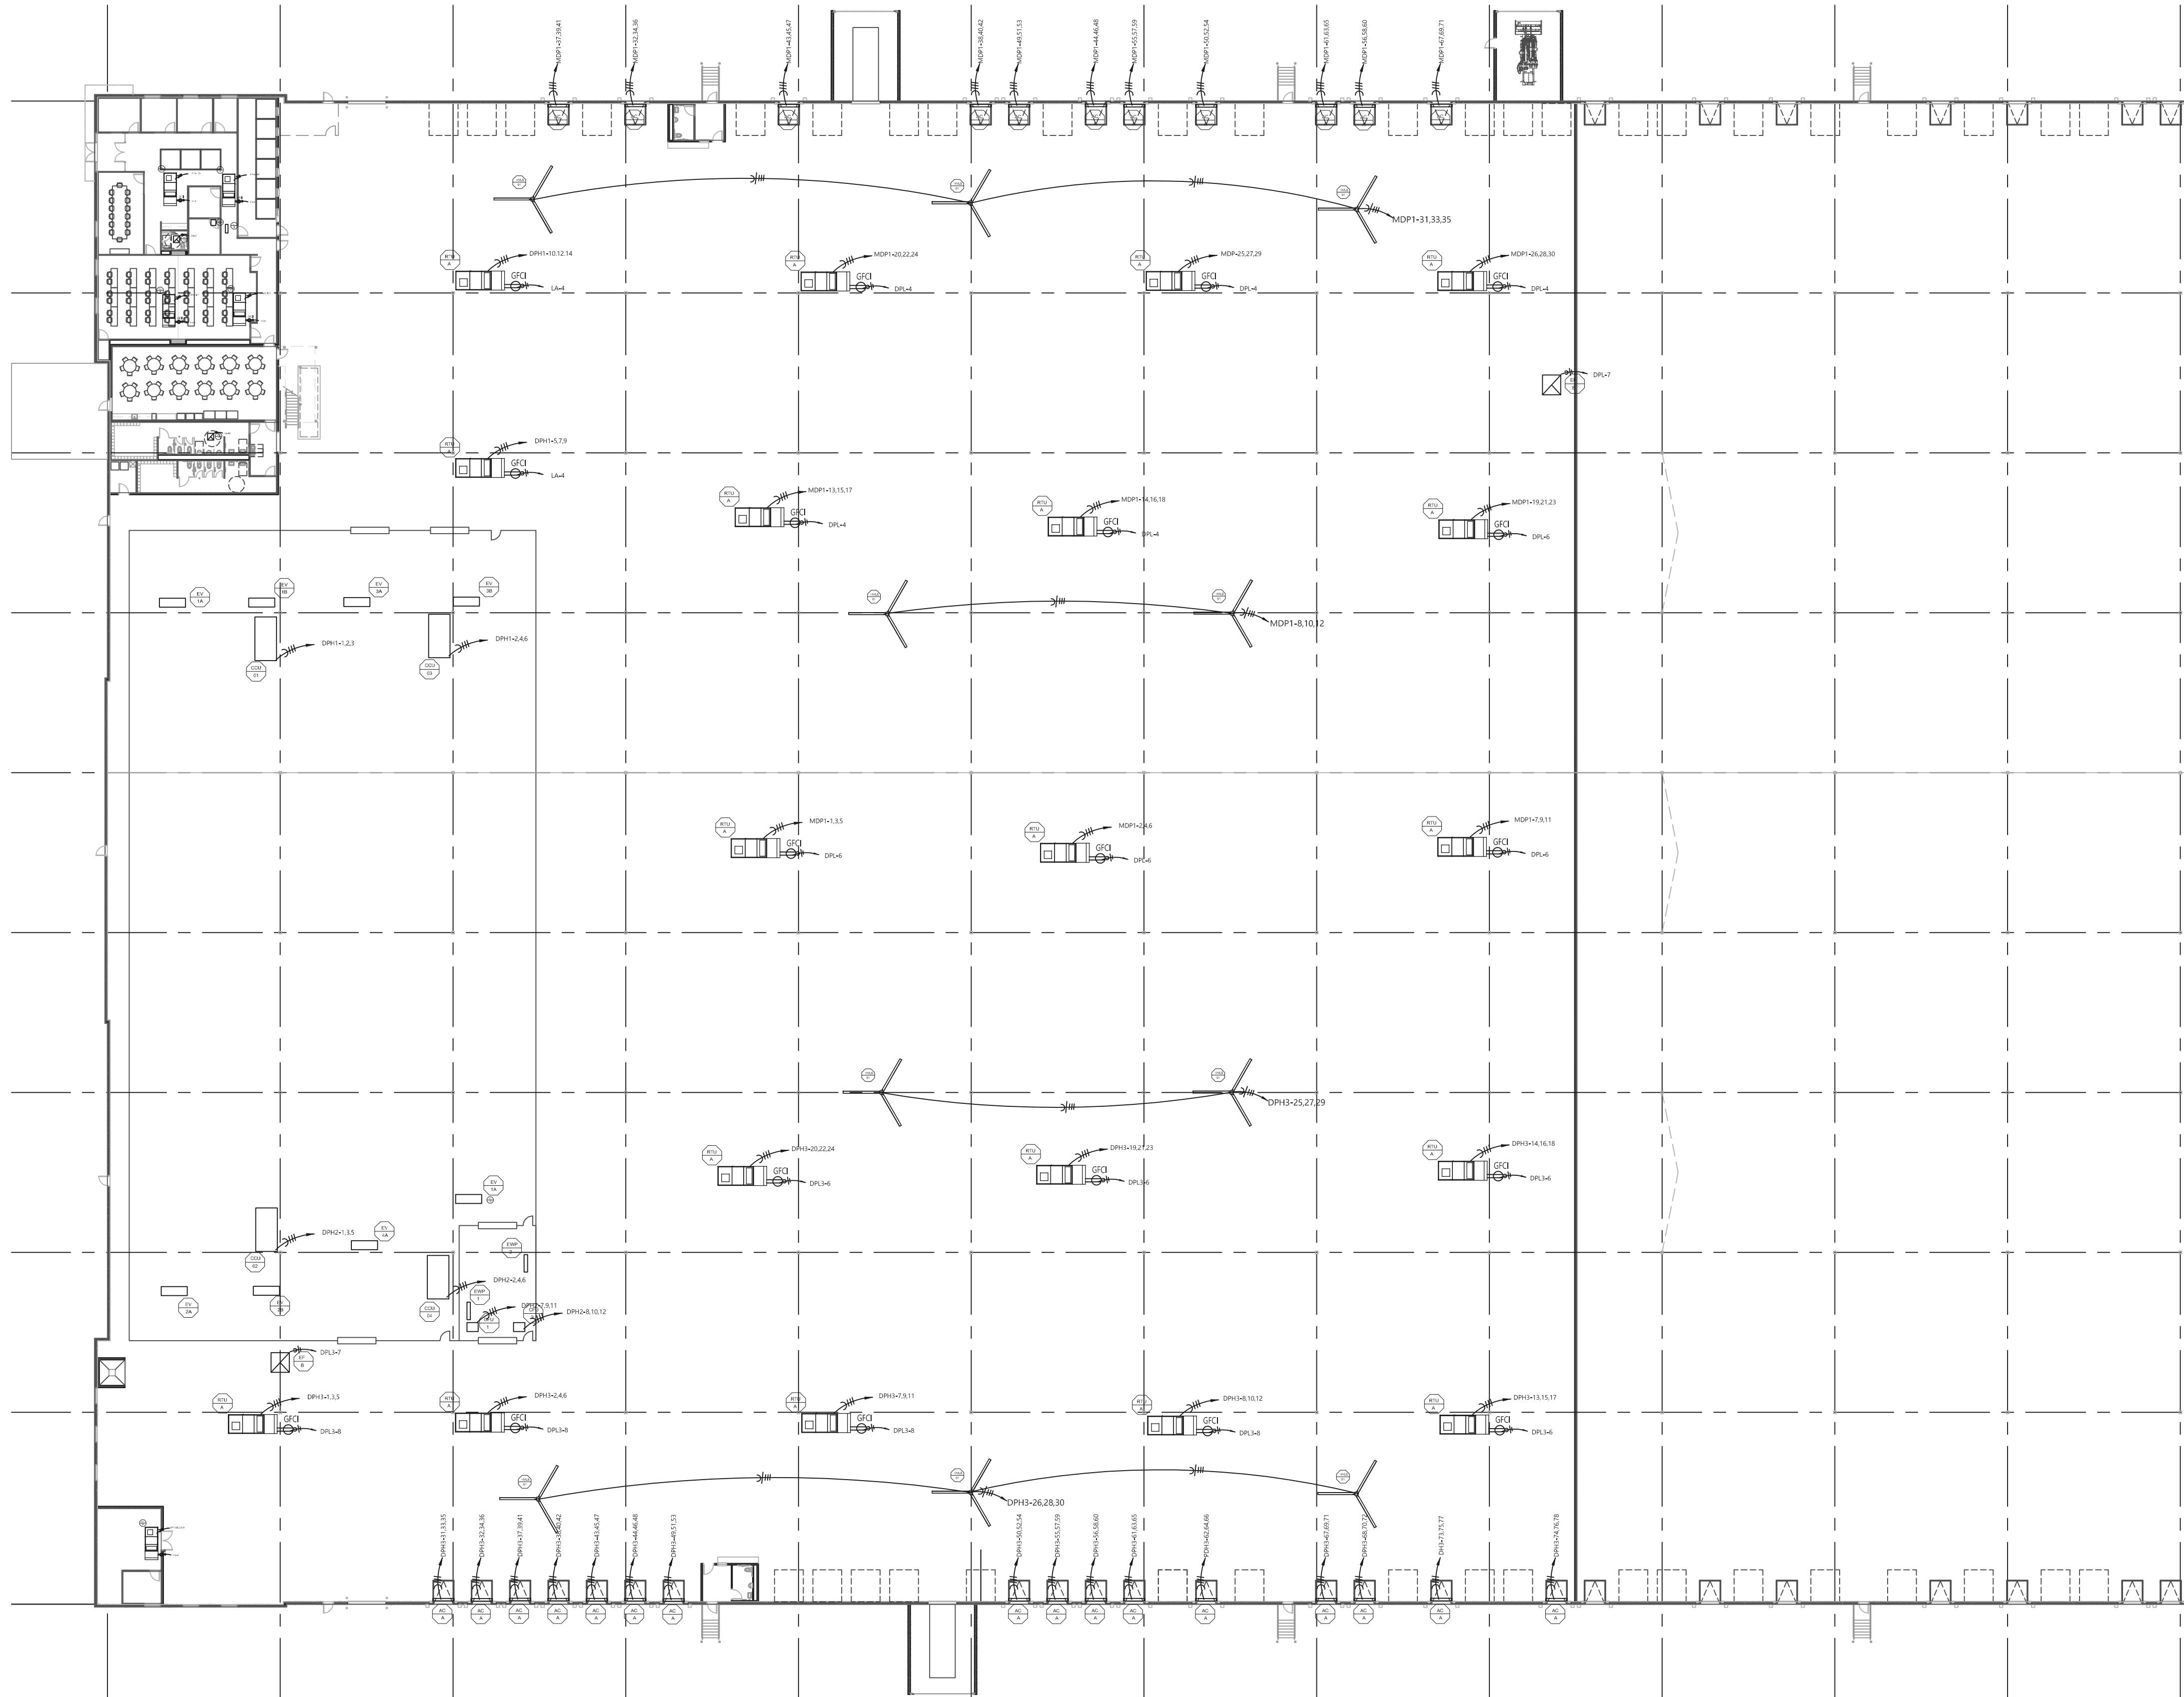








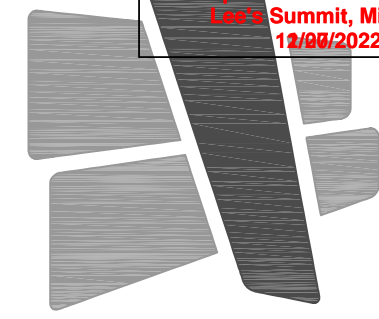

# CURRAN ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



## SCANNELL PROPERTIES

### CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY  
OF CURRAN ARCHITECTURE, AND ARE NOT  
TO BE USED OR REPRODUCED, WHOLE OR  
IN PART, WITHOUT THE WRITTEN  
CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

### PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


### ISSUE DATES

PERMIT SET	02.18.22
CITY COMMENTS	10.17.22


210300

Site

# E4.0

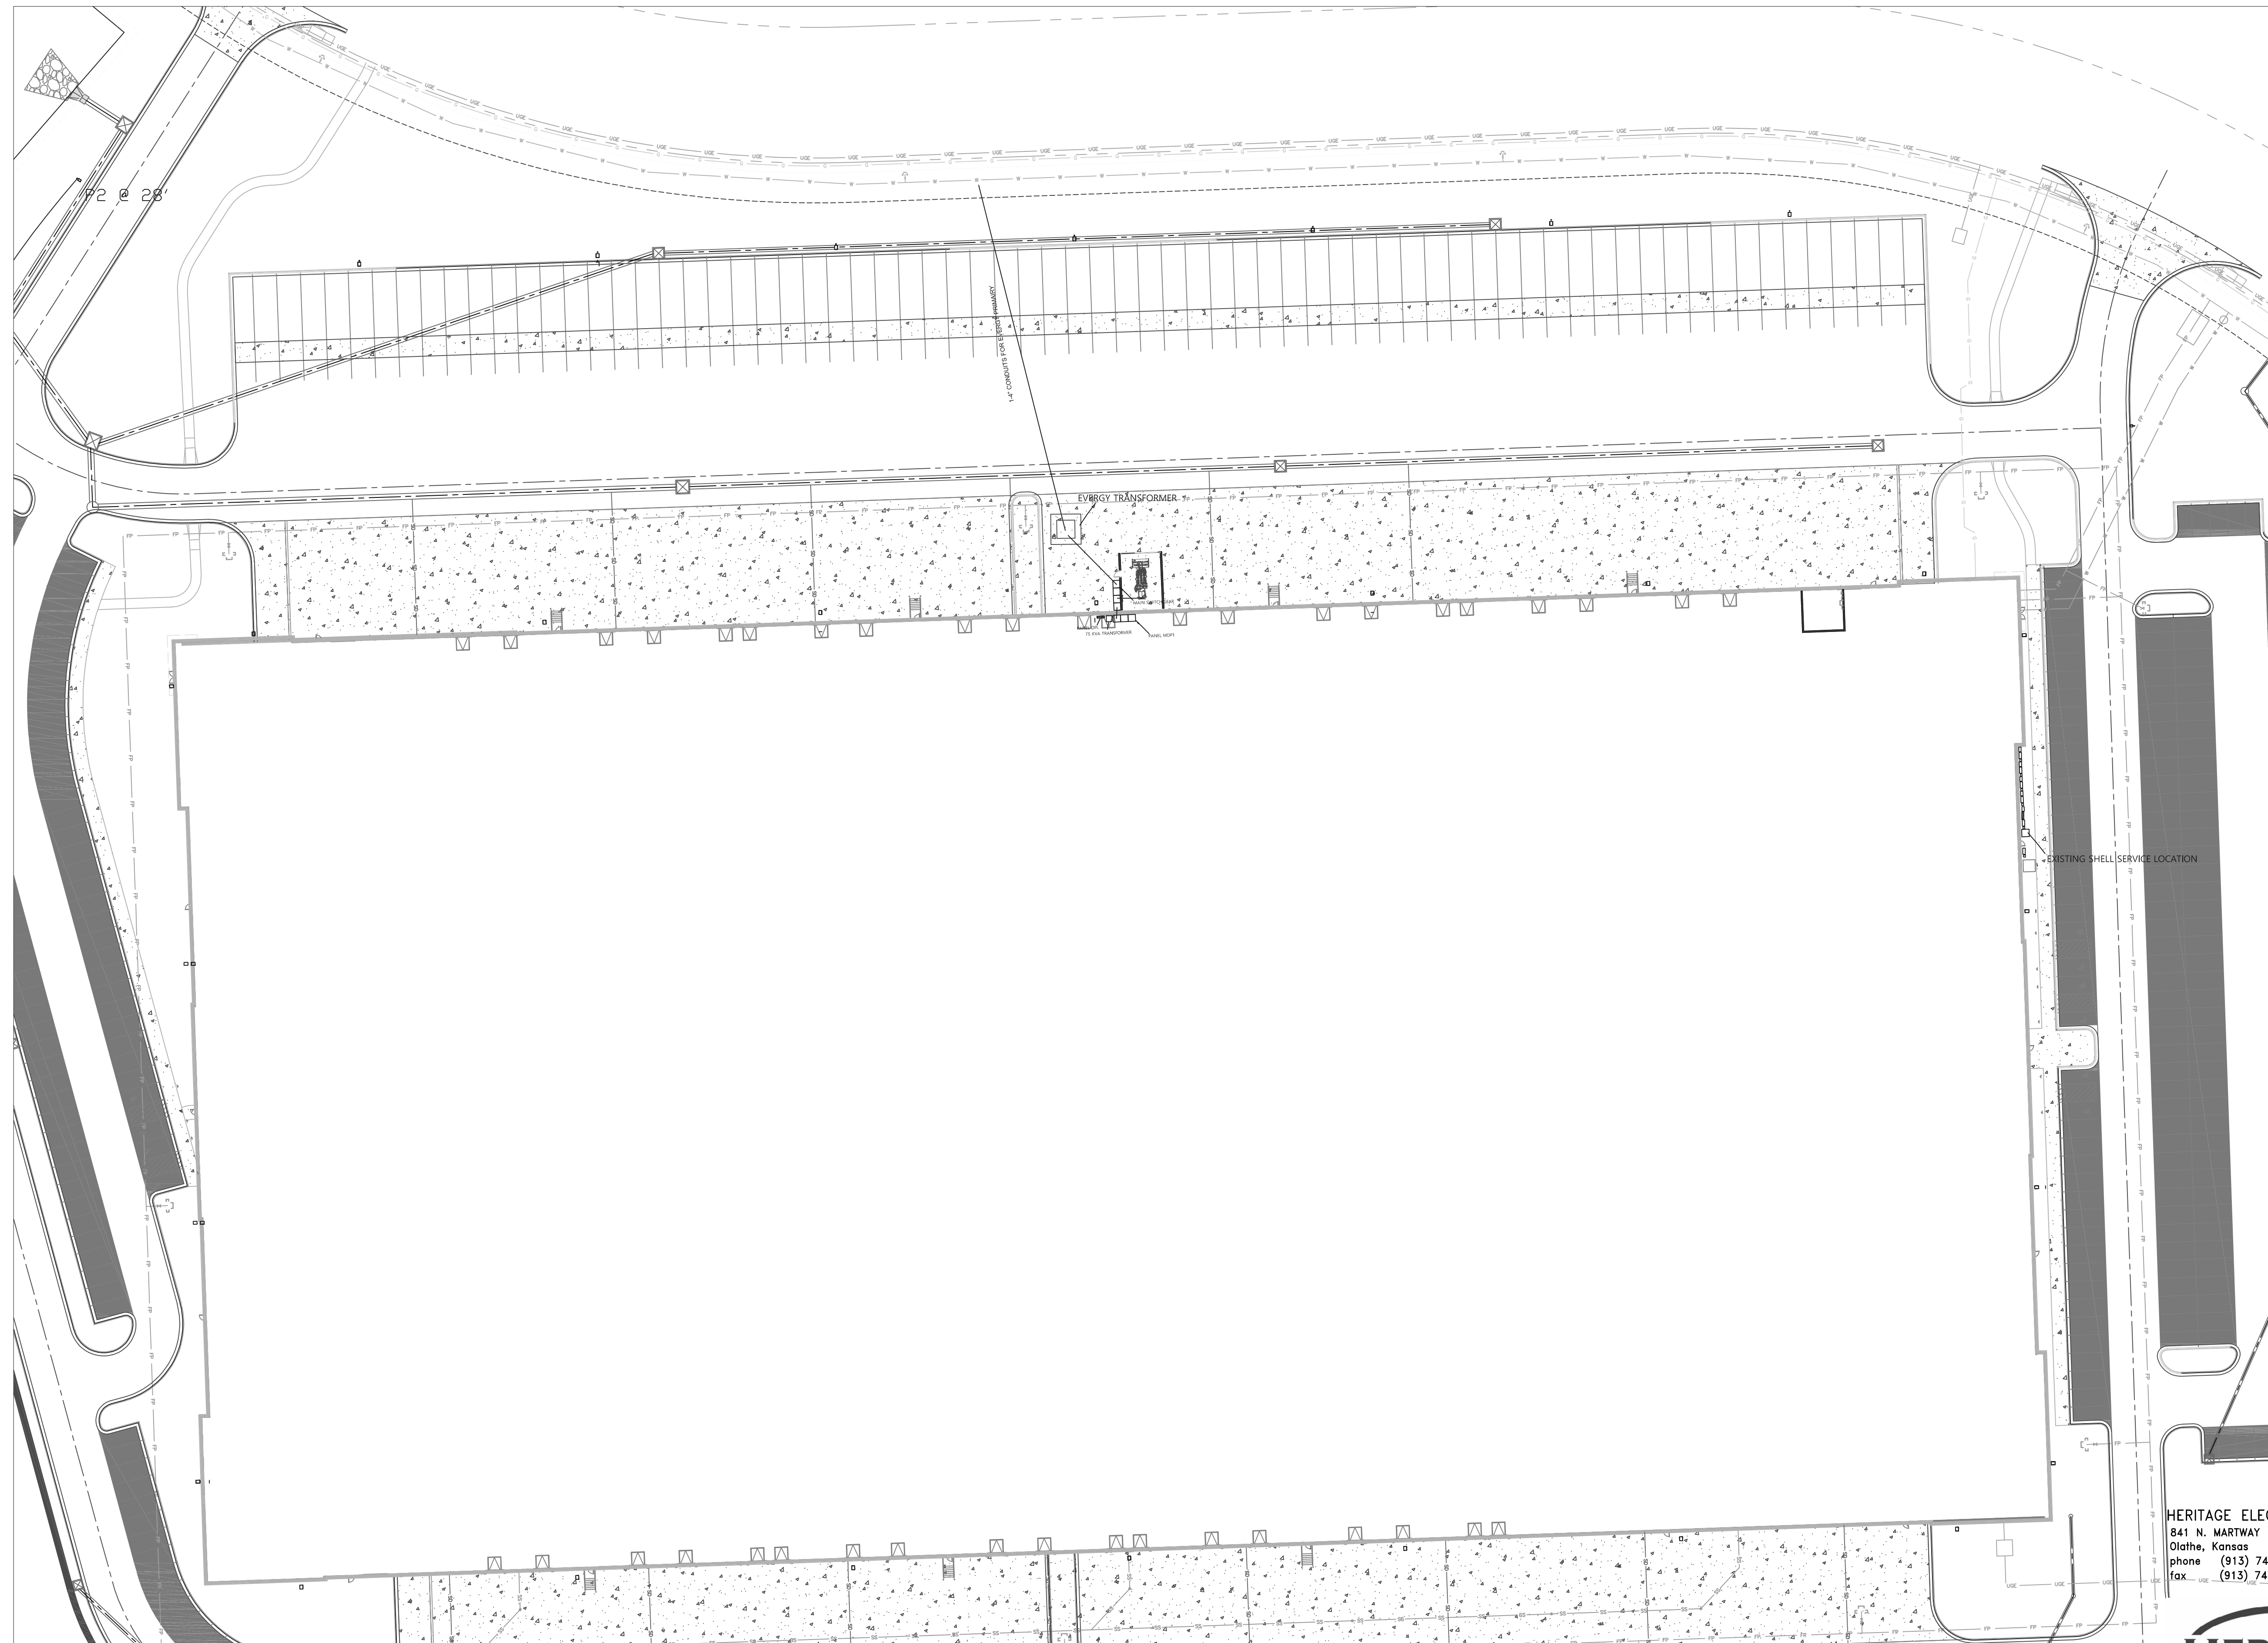

1 Site  
scale: N.T.S



HERITAGE ELECTRIC, L.L.C.  
841 N. MARTWAY  
Olathe, Kansas  
phone (913) 747 0528  
fax (913) 747 0539

THIS DRAWING HAS BEEN PRODUCED BY HERITAGE  
ELECTRIC, LLC FOR THEIR COORDINATION OF THE  
ELECTRICAL INSTALLATION AND MAY NOT BE USED  
FOR ANY OTHER PURPOSE.  
COPYRIGHT 2008, HERITAGE ELECTRIC, LLC.

THE SEAL OF THE ELECTRICAL P.E. APPLIES  
TO ONLY THIS DRAWING, SPECIFICATIONS AND OTHER  
DOCUMENTS BEARING THE PERSONAL SEAL OF THE  
UNDERSIGNED PROFESSIONAL AND DISCLAIM ANY  
RESPONSIBILITY FOR ALL OTHER DRAWINGS,  
SPECIFICATIONS, ESTIMATES, REPORTS OR OTHER  
DOCUMENTS WHICH DO NOT CONTAIN THE PERSONAL  
SEAL OF THE UNDERSIGNED PROFESSIONAL.





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



**SCANNELL**  
PROPERTIES

CERTIFICATION

HERITAGE ELECTRIC, L.L.C.  
841 N. MARTWAY  
Olathe, Kansas  
phone (813) 747 0528  
fox (913) 747 0539



THIS DRAWING HAS BEEN PRODUCED BY HERITAGE ELECTRIC, LLC. FOR THEIR COORDINATION OF THE ELECTRICAL INSTALLATION AND MAY NOT BE USED FOR ANY OTHER PURPOSE.  
COPYRIGHT 2008, HERITAGE ELECTRIC, LLC.  
THE SEAL OF THE ELECTRICAL P.E. APPLIES TO ONLY THIS DRAWING. SPECIFICATIONS AND OTHER DOCUMENTS BEARING THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL AND DISCLAIM ANY RESPONSIBILITY FOR ALL OTHER DRAWINGS, SPECIFICATIONS, ESTIMATES, REPORTS OR OTHER DOCUMENTS WHICH DO NOT CONTAIN THE PERSONAL SEAL OF THE UNDERSIGNED PROFESSIONAL.

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


ISSUE DATES

PERMIT SET 02.18.22  
CITY COMMENTS 10.17.22


210300

Riser

E5.0

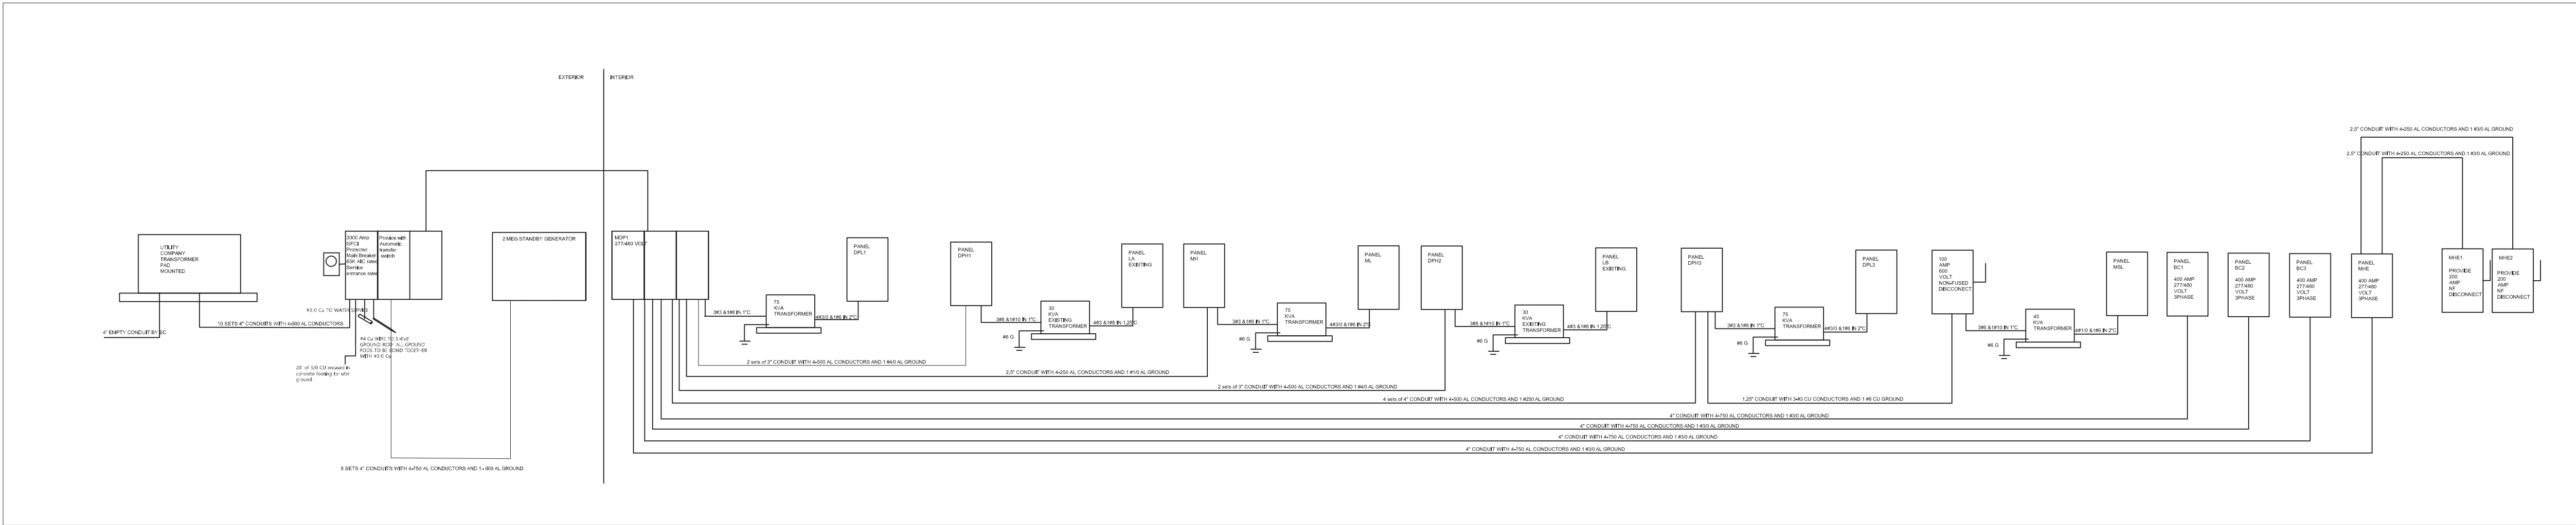

1 Riser  
scale: N.T.S

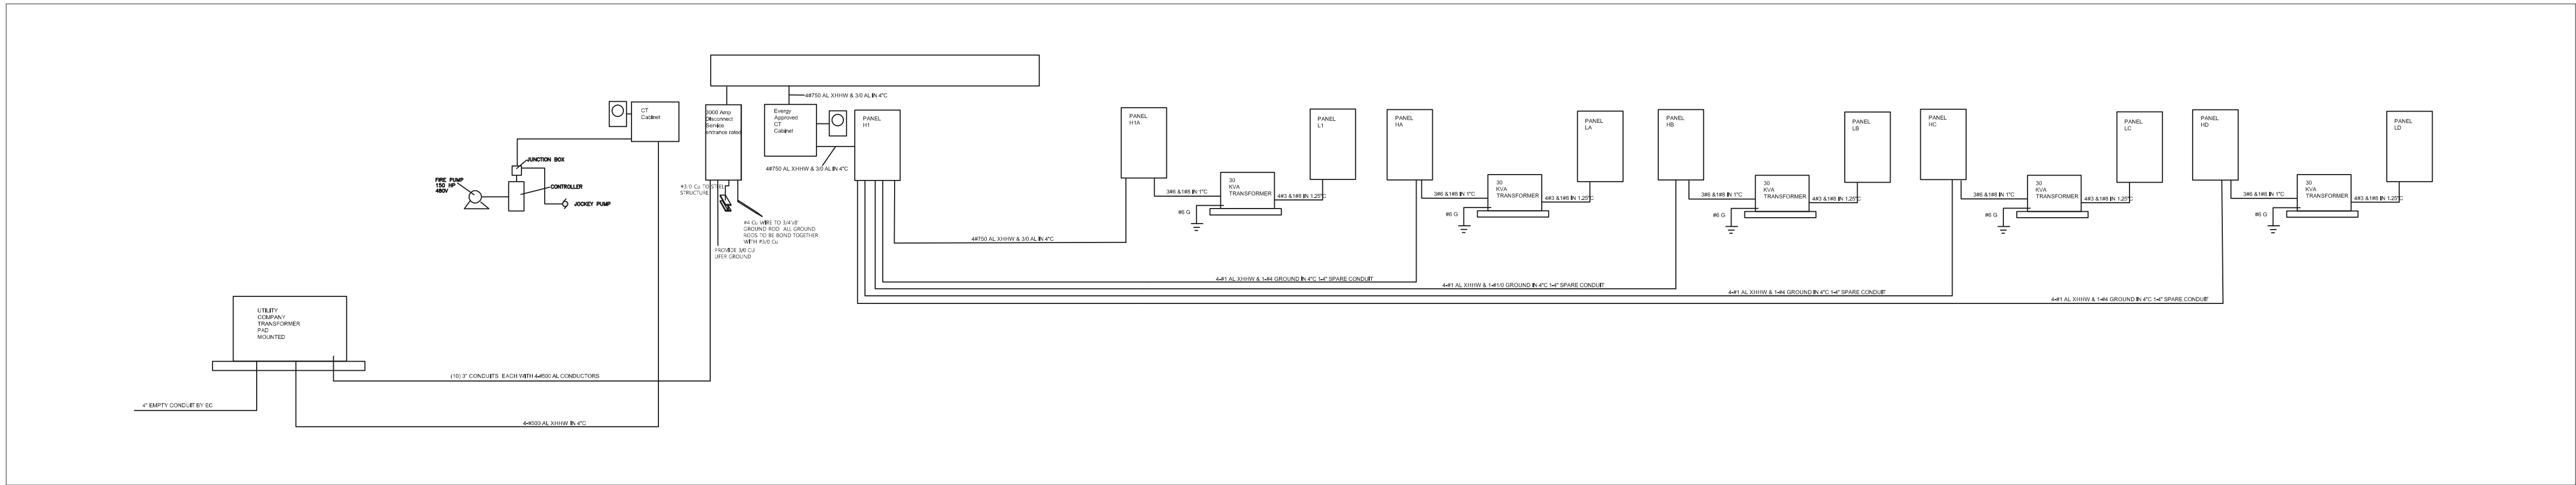

1 Existing Shell Riser Diagram  
scale: N.T.S



LIGHT FIXTURE SCHEDULE						
TYPE	MANUFACTURER	CATALOG NO.	LAMPS	MOUNTING	VOLTS	REMARKS
A	Columbia Lighting	CBT24-LS40	LED	CEILING	277	OR EQUAL
A1	Columbia Lighting	CBT22-LS40	LED	CEILING	277	OR EQUAL
B	Columbia Lighting	PEL2-40MV-EDU	LED	CEILING	277	PROVIDE WITH INTEGRAL OCCUPANCY SENSOR
BE	Columbia Lighting	PEL2-40MV-EDU	LED	CEILING	277	SAME AS TYPE B WITH EMERGENCY BALLAST
C	GE Lightnng	ABC1X30473Cxxx	LED	CEILING	277	PROVIDE WITH INTEGRAL OCCUPANCY SENSOR
CE	GE Lightnng	ABC1X30473Cxxx	LED	CEILING	277	SAME AS TYPE C WITH EMERGENCY BALLAST
D	GE Lightnng	ABC1X30475Cxxx	LED	CEILING	277	PROVIDE WITH INTEGRAL OCCUPANCY SENSOR
E	GE Lighting	EWS3-4-E3-D1-40-3-DKBZ	LED	WALL	277	OR EQUAL
DE	GE Lightnng	ABC1X30475Cxxx	LED	CEILING	277	SAME AS TYPE D WITH EMERGENCY BALLAST
X1	Compass	CCR	LED	WALL	277	OR EQUAL
RH	Compass	CUWZ-PC	LED	WALL	277	OR EQUAL
EM	Compass	CU2	LED	WALL	277	OR EQUAL
XE	Compass	CCR	LED	WALL	277	EXISTING EXIT/EM LIGHT INSTALLED IN SHELL
ERH	Compass	CUWZ-PC	LED	WALL	277	EXISTING REMOTE HEAD LIGHT INSTALLED IN SHELL

Scope:

Provide electrical for new TI in existing warehouse

All Electrical work shall be as per NEC 2017.

All work shall be done by qualified electricians.

All branch wiring shall be copper.

Devices shall be 20a commercial grade and color shall be by architect.

#### SPECIFICATIONS

- CONDUIT ABOVE GRADE SHALL BE EMT UNLESS OTHERWISE NOTED
- CONDUIT BELOW GRADE SHALL BE RIGID PVC UNLESS OTHERWISE NOTED
- CONNECTIONS SHALL BE MADE USING SET SCREW CONNECTORS
- MC CABLE IS ACCTEABLE FOR FINAL CONNECTIONS TO LIGHT FIXTURES PROVIDE WITH 10' WHIP ON ALL HIGHWAYS
- BRANCH WIRING SHALL BE #12 THIN COPPER UNLESS OTHERWISE NOTED
- WIRING SHALL BE AS PER CURRENT NEC 2005
- WIRING DEVICES SHALL BE OF COMMERCIAL GRADE RATED AT 20 AMP
- INSTALLATION SHALL ADHERE TO ADA STANDARDS
- ALUMINUM XHHW-#2 CABLE MAY BE USED FOR FEEDERS LARGER THEN #2 OTHERWISE COPPER
- REFER TO KCP&L STANDARDS MANUAL FOR 480 SERVICES
- ALL LIGHTING/EQUIPMENT IN WAREHOUSE SHALL BE MOUNTED TO PROVIDE A MIN OF 36" CLEAR HEIGHT

#### ELECTRICAL GENERAL NOTES

- WORK INCLUDED. FURNISH ALL LABOR, MATERIAL, SERVICES AND SKILLED SUPERVISION NECESSARY FOR THE CONSTRUCTION, ERECTION, INSTALLATION CONNECTIONS, TESTING AND ADJUSTMENTS OF ALL CIRCUITS AND ELECTRICAL EQUIPMENT SPECIFIED HEREIN, OR NOTED ON THE DRAWINGS, AND ITS DELIVERY TO THE OWNER COMPLETE IN ALL RESPECTS READY FOR USE.
- CONTRACT DRAWINGS THE CONTRACT DRAWINGS ARE SHOWN IN PART DIAGRAMMATIC, INTENDED TO CONVEY THE SCOPE OF WORK, INDICATING THE GENERAL ARRANGEMENT OF EQUIPMENT, CONDUIT AND OUTLETS. VERIFY SPACES FOR THE INSTALLATION OF THE MATERIALS BASED ON ACTUAL DIMENSIONS OF EQUIPMENT FURNISHED. IF A QUESTION EXISTS AS TO THE EXACT INTENDED LOCATION OF OUTLETS OR EQUIPMENT, OBTAIN INSTRUCTIONS FROM THE ARCHITECT/ENGINEER BEFORE PROCEEDING WITH WORK.
- MINIMUM SIZE OF CONDUIT SHALL BE 1/2" UNLESS NOTED OTHERWISE.
- ALL WIRING FOR LIGHTING, RECEPTACLE AND POWER CIRCUITS WHERE NOT SHOWN ON DRAWINGS SHALL BE WITH #12 CONDUCTORS, NUMBER AS REQUIRED IN CONDUIT SIZED PER N.E.C, PROVIDE EQUIPMENT GROUNDING CONDUCTOR FOR ALL BRANCH CIRCUITS AND FEEDERS. HOMERUNS TO PANEL SHALL BE IN INDIVIDUAL CONDUITS, UNLESS NOTED OTHERWISE, WITH CIRCUITS AS SHOWN.
- THE USE OF TYPE 'MC' AND TYPE 'AC' CABLE IS PERMITTED IN ALL AREAS PER NEC AND LOCAL CODE REQUIREMENTS.
- THE USE OF ALUMINUM CONDUCTORS WITH AMPACITY EQUIVALENT TO COPPER IS PERMITTED IN ALL AREAS PER NEC REQUIREMENTS.
- ALL JUNCTION BOXES, PULL BOXES, AND PANELBOARDS SHALL BE RIGIDLY ATTACHED TO STRUCTURE.
- COORDINATE ALL WORK WITH OTHER TRADES AND EXISTING CONDITIONS AS REQUIRED TO PROPERLY INSTALL ALL SYSTEMS AS INTENDED, WITHIN THE CONFINES OF THE SPACE AVAILABLE, AND WITHOUT INTERFERENCES.
- ALL CONDUIT, BOXES, ETC. SHALL BE CONCEALED OR MOUNTED FLUSH WITH CEILING OR WALL CONSTRUCTION. CONDUITS SHALL BE MOUNTED AS HIGH AS POSSIBLE. NO SURFACE MOUNTED CONDUIT, BOXES, ETC. WILL BE PERMITTED WITHOUT PERMISSION OF THE ENGINEER PRIOR TO INSTALLATION. ALL CONDUIT PENETRATIONS SHALL BE FIRE-CAULKED AS REQUIRED.






**CURRAN**  
ARCHITECTURE


5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216

O :: 317.288.0681  
F :: 317.288.0753



**SCANNELL**  
PROPERTIES

CERTIFICATION

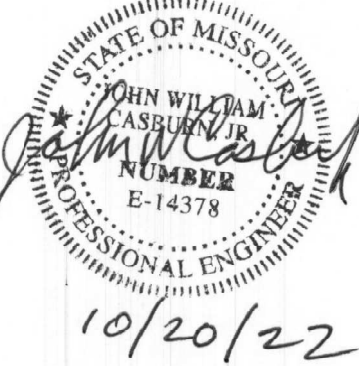

THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY  
OF CURRAN ARCHITECTURE, AND ARE NOT  
TO BE USED OR REPRODUCED, WHOLE OR  
IN PART, WITHOUT THE WRITTEN  
CONSENT OF CURRAN ARCHITECTURE.  
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES

PERMIT SET 02.18.22  
CITY COMMENTS 10.17.22



THIS DRAWING HAS BEEN PRODUCED BY HERITAGE  
ELECTRIC, LLC. FOR THEIR COORDINATION OF THE  
ELECTRICAL INSTALLATION AND MAY NOT BE USED  
FOR ANY OTHER PURPOSE.  
COPYRIGHT 2008, HERITAGE ELECTRIC, LLC.

THE SEAL OF THE ELECTRICAL ENGINEER  
TO ONLY THE DRAWING, SPECIFICATIONS AND OTHER  
DOCUMENTS BEARING THE PERSONAL SEAL OF THE  
UNDERSIGNED PROFESSIONAL AND DISCLAIM ANY  
RESPONSIBILITY FOR ALL OTHER DRAWINGS,  
SPECIFICATIONS, ESTIMATES, REPORTS OR OTHER  
DOCUMENTS WHICH DO NOT CONTAIN THE PERSONAL  
SEAL OF THE UNDERSIGNING PROFESSIONAL.

210300

Panel Schedule

**E6.0**

PANEL: MDP1										NEW PANEL									
CCT	SERVICES	VA	MB	277/	480	V, 3PH, 4W, +GRND.	PHASE	WIRE	OCF	VA	SERVICES	OCF	VA	SERVICES	OCF	VA	SERVICES	OCF	VA
1	RTU A	15512	703	444	1485		A	444, 1485	703	15512	RTU A	4	15512	RTU A	4	15512	RTU A	4	15512
3		15512					B	444, 1485		15512		6	15512		6	15512		6	15512
5		15512					C	444, 1485		15512		8	15512		8	15512		8	15512
7	RTU A	15512	703	444	1485		A	444, 1485	203	15512	RTU A	4	15512	RTU A	4	15512	RTU A	4	15512
9		15512					B	444, 1485		15512		6	15512		6	15512		6	15512
11		15512					C	444, 1485		15512		8	15512		8	15512		8	15512
13	RTU A	15512	703	444	1485		A	444, 1485	703	15512	RTU A	4	15512	RTU A	4	15512	RTU A	4	15512
15		15512					B	444, 1485		15512		6	15512		6	15512		6	15512
17		15512					C	444, 1485		15512		8	15512		8	15512		8	15512
19	RTU A	15512	703	444	1485		A	444, 1485	703	15512	RTU A	4	15512	RTU A	4	15512	RTU A	4	15512
21		15512					B	444, 1485		15512		6	15512		6	15512		6	15512
23		15512					C	444, 1485		15512		8	15512		8	15512		8	15512
25	RTU A	15512	703	444	1485		A	444, 1485	203	500	HVLS FAN	26	500	HVLS FAN	26	500	HVLS FAN	26	500
27		15512					B	444, 1485		500	HVLS FAN	28	500	HVLS FAN	28	500	HVLS FAN	28	500
29		15512					C	444, 1485		500	HVLS FAN	30	500	HVLS FAN	30	500	HVLS FAN	30	500
31	HVLS FAN	1000	203	4412	14125		A	4412, 14125	203	3333	AIR CURTAIN	32	3333	AIR CURTAIN	32	3333	AIR CURTAIN	32	3333
33	HVLS FAN	1000	203	4412	14125		B	4412, 14125	203	3333	AIR CURTAIN	34	3333	AIR CURTAIN	34	3333	AIR CURTAIN	34	3333
35	HVLS FAN	1000	203	4412	14125		C	4412, 14125	203	3333	AIR CURTAIN	36	3333	AIR CURTAIN	36	3333	AIR CURTAIN	36	3333
37	AIR CURTAIN	3333	203	4412	14125		A	4412, 14125	203	3333	AIR CURTAIN	38	3333	AIR CURTAIN	38	3333	AIR CURTAIN	38	3333
39		3333					B	4412, 14125		3333		40	3333		40	3333		40	3333
41		3333					C	4412, 14125		3333		42	3333		42	3333		42	3333
43	AIR CURTAIN	3333	203	4412	14125		A	4412, 14125	203	3333	AIR CURTAIN	44	3333	AIR CURTAIN	44	3333	AIR CURTAIN	44	3333
45		3333					B	4412, 14125		3333		46	3333		46	3333		46	3333
47	AIR CURTAIN	3333	203	4412	14125		A	4412, 14125	203	3333	AIR CURTAIN	48	3333	AIR CURTAIN	48	3333	AIR CURTAIN	48	3333
49		3333					B	4412, 14125		3333		50	3333		50	3333		50	3333
51		3333					C	4412, 14125		3333		52	3333		52	3333		52	3333
53	AIR CURTAIN	3333	203	4412	14125		A	4412, 14125	203	3333	AIR CURTAIN	54	3333	AIR CURTAIN	54	3333	AIR CURTAIN	54	3333
55		3333					B	4412, 14125		3333		56	3333		56	3333		56	3333
57		3333					C	4412, 14125		3333		58	3333		58	3333		58	3333
59	AIR CURTAIN	3333	203	4412	14125		A	4412, 14125	203	3333	AIR CURTAIN	60	3333	AIR CURTAIN	60	3333	AIR CURTAIN	60	3333
61		3333					B	4412, 14125		3333		62	3333		62	3333		62	3333
63		3333					C	4412, 14125		3333		64	3333		64	3333		64	3333
65	AIR CURTAIN	3333	203	4412	14125		A	4412, 14125	203	3333	AIR CURTAIN	66	3333	AIR CURTAIN	66	3333	AIR CURTAIN	66	3333
67		3333					B	4412, 14125		3333		68	3333		68	3333		68	3333
69	AIR CURTAIN	3333	203	4412	14125		A	4412, 14125	203	3333	AIR CURTAIN	70	3333	AIR CURTAIN	70	3333	AIR CURTAIN	70	3333
71		3333					B	4412, 14125		3333		72	3333		72	3333		72	3333
73	PANEL MHE EQUIPMENT	8640	4003	44750	14140	ALG	B	44750, 14140	12003	17864	PANEL DPH3	74	17864	PANEL DPH3	74	17864	PANEL DPH3	74	17864
75		8640					C	44750, 14140		17864		76	17864		76	17864		76	17864
77		8640					B	44750, 14140		17864		78	17864		78	17864		78	17864
79	PANEL DPH2	115138	600A	35615	44800	AL	C	44750, 14140	4003	35456	BC1	80	35456	BC1	80	35456	BC1	80	35456
81		115138					A	44750, 14140		35456		82	35456		82	35456		82	35456
83		115138					B	44750, 14140		35456		84	35456		84	35456		84	35456
85	EC2	35456	4003	44750	14140	ALG	C	44750, 14140	4003	35456	BC3	86	35456	BC3	86	35456	BC3	86	35456
87		35456					A	44750, 14140		35456		88	35456		88	35456		88	35456
89		35456					B	44750, 14140		35456		90	35456		90	35456		90	35456
91	WAREHOUSE LIGHTS	1260	201	3412	14125		A	3412, 14125	201	1260	WAREHOUSE LIGHTS	92	1260	WAREHOUSE LIGHTS	92	1260	WAREHOUSE LIGHTS	92	1260
93	WAREHOUSE LIGHTS	1260	201	3412	14125		B	3412, 14125	201	1260	WAREHOUSE LIGHTS	94	1260	WAREHOUSE LIGHTS	94	1260	WAREHOUSE LIGHTS	94	1260
95	WAREHOUSE LIGHTS	1260	201	3412	14125		C	3412, 14125	201	1260	WAREHOUSE LIGHTS	96	1260	WAREHOUSE LIGHTS	96	1260	WAREHOUSE LIGHTS	96	1260
97	TRANSFORMER	1000	4483	1485			A	3412, 14125	201	2110	WAREHOUSE LIGHTS	98	2110	WAREHOUSE LIGHTS	98	2110	WAREHOUSE LIGHTS	98	2110
99							B	3412, 14125	201	1470	WAREHOUSE LIGHTS	100	1470	WAREHOUSE LIGHTS	100	1470	WAREHOUSE LIGHTS	100	1470
101							C	3412, 14125	201	1470	WAREHOUSE LIGHTS	102	1470	WAREHOUSE LIGHTS	102	1470	WAREHOUSE LIGHTS	102	1470


NOTES:										LOAD SUMMARY									
1	NEMA 1 ENCLOSURE									LIGHTING	1410	1.25	17864	PHASE A		32298			
2	PROVIDE BOLT ON BREAKERS									RECEPTACLES	0	0.65	17864	PHASE B		32298			
3										SKITCHEN	0	0.65	17864	PHASE C		32298			
										4412V	239404	1	239404	LOWEST PHASE PLUS 10%					
										SAFON-CONT	400	1	400	LOWEST PHASE PLUS 10%					
										LARGEST MOTOR	0	0.25	0	PHASES ARE BALANCED					
										TOTAL VA	241344		241344						
										TOTAL AMPS	2603.0		2603.0						

PANEL: DPH3										NEW PANEL									
CCT	SERVICES	VA	MB	277/	480	V, 3PH, 4W, +GRND.	PHASE	WIRE	OCF	VA	SERVICES	OCF	VA	SERVICES	OCF	VA	SERVICES	OCF	VA
1	RTU A	15512	703	444	1485		A	444, 1485	703	15512	RTU A	4	15512	RTU A	4	15512	RTU A	4	15512
3		15512					B	444, 1485		15512		6	15512		6	15512		6	15512
5		15512					C	444, 1485		15512		8	15512		8	15512		8	15512
7	RTU A	15512	703	444	1485		A	444, 1485	703	15512	RTU A	4	15512	RTU A	4	15512	RTU A	4	15512
9		15512					B	444, 1485		15512		6	15512		6	15512		6	15512
11		15512					C	444, 1485		15512		8	15512		8	15512		8	15512
13	RTU A	15512	703	444	1485		A	444, 1485	703	15512	RTU A	4	15512	RTU A	4	15512	RTU A	4	15512
15		15512					B	444, 1485		15512		6	15512		6	15512		6	15512
17		15512					C	444, 1485		15512		8	15512		8	15512		8	15512
19	RTU A	15512	703	444	1485		A	444, 1485	703	15512	RTU A	4	15512	RTU A	4	15512	RTU A	4	15512
21		15512					B	444, 1485		15512		6	15512		6	15512		6	15512
23		15512					C	444, 1485		15512		8	15512		8	15512		8	15512
25	HYLS FAN	1000	203	444	1485		A	444, 1485	203	1000	HYLS FAN	26	1000	HYLS FAN	26	1000	HYLS FAN	26	1000
26	HYLS FAN	1000	203	444	1485		B	444, 1485	203	1000	HYLS FAN	26	1000	HYLS FAN	26	1000	HYLS FAN	26	1000
27	HYLS FAN	1000	203	444	1485		C	444, 1485	203	1000	HYLS FAN	26	1000	HYLS FAN	26	1000	HYLS FAN	26	1000
29	HYLS FAN	1000	203	444	1485		C	444, 1485	203	1000	HYLS FAN	26	1000	HYLS FAN	26	1000	HYLS FAN	26	1000
31	AIR CURTAIN	3033	203	444	1485		A	444, 1485	203	3033	AIR CURTAIN	30	3033	AIR CURTAIN	30	3033	AIR CURTAIN	30	3033
33		3033					B	444, 1485		3033		32	3033		32	3033		32	3033
35		3033					C	444, 1485		3033		34	3033		34	3033		34	3033
37	AIR CURTAIN	3033	203	444	1485		A	444, 1485	203	3033	AIR CURTAIN	36	3033	AIR CURTAIN	36	3033	AIR CURTAIN	36	3033
39		3033					B	444, 1485		3033		38	3033		38	3033		38	3033
41		3033					C	444, 1485		3033		40	3033		40	3033		40	3033
43	AIR CURTAIN	3033	203	444	1485		B	444, 1485	203	3033	AIR CURTAIN	42	3033	AIR CURTAIN	42	3033	AIR CURTAIN	42	3033
45		3033					C	444, 1485		3033		44	3033		44	3033		44	3033
47		3033					A	444, 1485		3033		46	3033		46	3033		46	3033
49	AIR CURTAIN	3033	203	444	1485		B	444, 1485	203	3033	AIR CURTAIN	50	3033	AIR CURTAIN	50	3033	AIR CURTAIN	50	3033
51		3033					C	444, 1485		3033		52	3033		52	3033		52	3033
53		3033					A	444, 1485		3033		54	3033		54	3033		54	3033
55	AIR CURTAIN	3033	203	444	1485		C	444, 1485	203	3033	AIR CURTAIN	56	3033	AIR CURTAIN	56	3033	AIR CURTAIN	56	3033
57		3033	--				C	--		3033		58	3033		58	3033		58	3033
59		3033					B	444, 1485		3033		60	3033		60	3033		60	3033
61	AIR CURTAIN	3033	203	444	1485		C	444, 1485	203	3033	AIR CURTAIN	62	3033	AIR CURTAIN	62	3033	AIR CURTAIN	62	3033
63		3033					B	444, 1485		3033		64	3033		64	3033		64	3033
65		3033					C	444, 1485		3033		66	3033		66	3033		66	3033
67	AIR CURTAIN	3033	203	444	1485		C	444, 1485	203	3033	AIR CURTAIN	68	3033	AIR CURTAIN	68	3033	AIR CURTAIN	68	3033
69		3033					B	444, 1485		3033		70	3033		70	3033		70	3033
71		3033					C	444, 1485		3033		72	3033		72	3033		72	3033
73	AIR CURTAIN	3033	203	444	1485		A	444, 1485	203	3033	AIR CURTAIN	74	3033	AIR CURTAIN	74	3033	AIR CURTAIN	74	3033
75		3033					B	444, 1485		3033		76	3033		76	3033		76	3033
77		3033					C	444, 1485		3033		78	3033		78	3033		78	3033
79	WAREHOUSE LIGHTS	1880	201	344	1485		B	344, 1485	1880	201	WAREHOUSE LIGHTS	80	1880	WAREHOUSE LIGHTS	80	1880	WAREHOUSE LIGHTS	80	1880
81	WAREHOUSE LIGHTS	1880	201	344	1485		C	344, 1485	201	1880	WAREHOUSE LIGHTS	82	1880	WAREHOUSE LIGHTS	82	1880	WAREHOUSE LIGHTS	82	1880
83	WAREHOUSE LIGHTS	1880	201	344	1485		A	344, 1485	201	1880	WAREHOUSE LIGHTS	84	1880	WAREHOUSE LIGHTS	84	1880	WAREHOUSE LIGHTS	84	1880
85	WAREHOUSE LIGHTS	1880	201	344	1485		B	344, 1485	201	1880	WAREHOUSE LIGHTS	86	1880	WAREHOUSE LIGHTS	86	1880	WAREHOUSE LIGHTS	86	1880
87	WAREHOUSE LIGHTS	1880	201	344	1485		C	344, 1485	201	1880	WAREHOUSE LIGHTS	88	1880	WAREHOUSE LIGHTS	88	1880	WAREHOUSE LIGHTS	88	1880
89	WAREHOUSE LIGHTS	1880	201	344	1485		A	344, 1485	201	2200	WAREHOUSE LIGHTS	90	2200	WAREHOUSE LIGHTS	90	2200	WAREHOUSE LIGHTS	90	2200
91	WAREHOUSE LIGHTS	1880	201	344	1485		B	344, 1485	201	2100	WAREHOUSE LIGHTS	92	2100	WAREHOUSE LIGHTS	92	2100	WAREHOUSE LIGHTS	92	2100
93	WAREHOUSE LIGHTS	1880	201	344	1485		C	344, 1485	201	1880	WAREHOUSE LIGHTS	94	1880	WAREHOUSE LIGHTS	94	1880	WAREHOUSE LIGHTS	94	1880
95	WAREHOUSE LIGHTS	1880	201	344	1485		A	344, 1485	201	2700	WAREHOUSE LIGHTS	96	2700	WAREHOUSE LIGHTS	96	2700	WAREHOUSE LIGHTS	96	2700
97	WAREHOUSE LIGHTS	1880	201	344	1485		C	344, 1485	201	2700	WAREHOUSE LIGHTS	98	2700	WAREHOUSE LIGHTS	98	2700	WAREHOUSE LIGHTS	98	2700
99	WAREHOUSE LIGHTS	1880	201	344	1485		A	344, 1485	201	1880	WAREHOUSE LIGHTS	100	1880	WAREHOUSE LIGHTS	100	1880	WAREHOUSE LIGHTS	100	1880
101	WAREHOUSE LIGHTS	2500	201	344	1485		B	344, 1485	201	2700	WAREHOUSE LIGHTS	102	2700	WAREHOUSE LIGHTS	102	2700	WAREHOUSE LIGHTS	102	2700
103		2500					C	344, 1485		2700		104	2700		104	2700		104	2700
105		2500					A	344, 1485		2700		106	2700		106	2700		106	2700
107		2500					B	344, 1485		2700		108	2700		108	2700		108	2700
109		2500					C	344, 1485		2700		110	2700		110	2700		110	2700
111		2500					A	344, 1485		2700		112	2700		112	2700		112	2700
113		2500					B	344, 1485		2700		114	2700		114	2700		114	2700
115	TRANSFORMER	1800	300	1480			C	300, 1480	750		TRANSFORMER	116		TRANSFORMER	116		TRANSFORMER	116	
117			--				B					118						118	
119			--				C	--				120						120	
NOTES:																			
1. NEMA 3R ENCLOSURE						LOAD SUMMARY		CUNN	NSC	DEM	LOAD BALANCE PER PHASE								
2. PROVIDE BOLT ON BREAKERS						LIGHTING		4269	1.25	5362	PHASE A		17604						
						RECEIPTACLES		0	NSC	0	PHASE B		17604						
						SWITCHES		0	0.65		PHASE C		17604						
						4X14AC		53272	1	53272	LOWEST LOADS PLUS 10%								
						SINK CONCT		658	1	658	PHASE A		19604.4						
						LARGEST MOTOR		0	0.25		PHASES ARE BALANCED								
						TOTAL VA		57662			98034.5								
						TOTAL AMPS		8612			7151								



5719 LAWTON LOOP E. DR. #21  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753

## CERTIFICATION

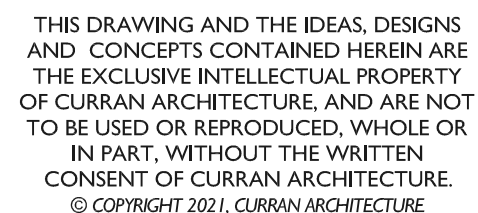

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT 1

210300

## E6. I

PANEL: BC2						400	277/	480	V, 3PH, 4W, +GRND.	NEW PANEL					
MCT		SERVICES		VA	OCF	WIRE	PHASE	WIRE	OCF	VA	SERVICES	OCF			
1	BATTERY CHARGER	4432	303	3/4 12,14 100		A	3/4 12,14 100		303	4432	BATTERY CHARGER	2			
3	BATTERY CHARGER	4432				B				4432	BATTERY CHARGER	4			
5	BATTERY CHARGER	4432				C				4432	BATTERY CHARGER	6			
7	BATTERY CHARGER	4432	303	3/4 12,14 100		A	3/4 12,14 100		303	4432	BATTERY CHARGER	8			
9	BATTERY CHARGER	4432				B				4432	BATTERY CHARGER	10			
11	BATTERY CHARGER	4432				C				4432	BATTERY CHARGER	12			
13	BATTERY CHARGER	4432	303	3/4 12,14 100		A	3/4 12,14 100		303	4432	BATTERY CHARGER	14			
15	BATTERY CHARGER	4432				B				4432	BATTERY CHARGER	16			
17	BATTERY CHARGER	4432				C				4432	BATTERY CHARGER	18			
19	BATTERY CHARGER	4432	303	3/4 12,14 100		A	3/4 12,14 100		303	4432	BATTERY CHARGER	20			
21	BATTERY CHARGER	4432				B				4432	BATTERY CHARGER	22			
23	BATTERY CHARGER	4432				C				4432	BATTERY CHARGER	24			
25						A						26			
27						B						28			
29						C						30			
31						A						32			
33						B						34			
35						C						36			
37						A						38			
39						B						40			
41						C						42			

NOTES:		LOAD SUMMARY		CONN	NEC	IDEM	LOAD BALANCE PER PHASE	
1	NEMA 1 ENCLOSURE	LIGHTING	0	1.25			PHASE A	35005
2	PROVIDE BOLT ON BREAKERS	SMALLEST FUSES	0	NEC			PHASE B	35055
3		SMALLEST FUSES	0	0.60			PHASE C	35000
		4W/AC					LOWEST PHASE PLUS 10%	
		SWITCH CONT	16300	1	16300		PHASES ARE BALANCED	35001.6
		LARGEST MOTOR	0	0.25				
		TOTAL VA	106300		106300			
		TOTAL AMPS	127.9		127.9			

PANEL: ML		200A MLO 120/ 208 V, 3PH, 4W+GRND.				NEW PANEL				
CCT	SERVES	VA	DCP	WIRE	PHASE	WIRE	DCP	VA	SERVES	CCT
1	GFI/ RECEPT	400	201	2412.14100	A	2412.14100	201	600	RECEPT	2
3	RECEPT	1400	201	2412.14100	B	2412.14100	201	600	RECEPT	4
5	RECEPT	1600	201	2412.14100	C	2412.14100	201	1000	RECEPT	6
7	PRINTER	1200	201	2412.14100	A	2412.14100	201	600	RECEPT	8
9	PRINTER	1200	201	2412.14100	B	2412.14100	201	1000	RECEPT	10
11	RECEPT	800	201	2412.14100	C	2412.14100	201	1000	RECEPT	12
13	RECEPT	1000	201	2412.14100	A	2412.14100	201	400	RECEPT	14
15	RECEPT	1000	201	2412.14100	B	2412.14100	201	600	RECEPT	16
17	RECEPT	600	201	2412.14100	C	2412.14100	201	600	RECEPT	18
19	RECEPT	600	201	2412.14100	A	2412.14100	201	400	RECEPT	20
21	RECEPT	800	201	2412.14100	B	2412.14100	201	600	RECEPT	22
23	RECEPT	400	201	2412.14100	C	2412.14100	201	1000	REFRIGERATOR	24
25	REFRIGERATOR	1000	201	2412.14100	A	2412.14100	201	1000	BREAK ROOM RECEPT	26
27	REFRIGERATOR	1000	201	2412.14100	B	2412.14100	201	1000	BREAK ROOM RECEPT	28
29	BREAK ROOM RECEPT	1000	201	2412.14100	C	2412.14100	201	1000	BREAK ROOM RECEPT	30
31	BREAK ROOM RECEPT	1000	201	2412.14100	A	2412.14100	201	1000	BREAK ROOM RECEPT	32
33	BREAK ROOM RECEPT	1000	201	2412.14100	B	2412.14100	201	1200	DRAINING FOUNTAIN	34
35	BREAK ROOM RECEPT	1000	201	2412.14100	C	2412.14100	201	400	BATHROOM GFI	36
37	DRYER RECEPT	1500	302	3410.14100	A	2412.14100	201	600	WASHER	38
39		1500			B		201		SPARE	40
41	SPARE		201		C		201		SPARE	42
43	SPARE		201		A		201		SPARE	44
45	SPARE		201		B		201		SPARE	46
47	SPARE		201		C		201		SPARE	48
49					A					50
51					B					52
53					C					54
55					A					56
57					B					58
59					C					60
61					A					62
63					B					64
65					C					66

NOTES:		LOAD SUMMARY		CONN	NEC	DEM	LOAD BALANCE PER PHASE	
1	NEMA 120/100/80	FLUORIGHT	0	1.25	PHASE A			11300
2	PROVIDE BOLT ON BREAKERS	2 RECEPTACLES	34000	NEC	22300	PHASE B		12000
3		SKITCHEN	0	0.65	0	PHASE C		10400
		LAVARY	0	1	0	LOWEST PHASE PLUS 10%		11460
		SHOW-CON	0	1	1000			
		LARGEST MOTOR	0	0.25	0	REBALANCE LOADS		
		TOTAL VA	34000		22300			
		TOTAL AMPS	ML		61%			




**HERITAGE**  
ELECTRIC

THE SEAL OF THE ELECTRICAL P.E. APPLIES  
TO ONLY THIS DRAWING, SPECIFICATIONS AND OTHER  
DOCUMENTS BEARING THE PERSONAL SEAL OF THE  
UNDERSIGNED PROFESSIONAL AND DISCLAIM ANY  
RESPONSIBILITY FOR ALL OTHER DRAWINGS,  
SPECIFICATIONS, ESTIMATES, REPORTS OR OTHER  
DOCUMENTS WHICH DO NOT CONTAIN THE PERSONAL  
SEAL OF THE UNDERSIGNED PROFESSIONAL



## FIRE PROTECTION PLANS

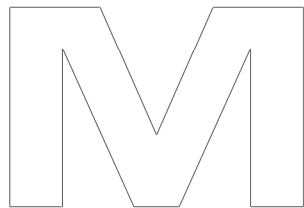

**F. E. MORAN, INC. FIRE PROTECTION**  
18815 COLLEGE BLVD.  
LENEXA, KS 66219  
(217) 356-0700 (217) 356-0777 FAX

MISSOURI COA: E-2022012018

## SCOPE OF WORK

SCOPE OF WORK:  
\*\* FURNISH & INSTALL (11) NEW WET PIPE SPRINKLER SYSTEM FOR THE NEW BUILDING.  
\*\* FURNISH & INSTALL A NEW FIRE PUMP AND ACCESSORIES  
\*\* FIRE PUMP ROOM POINT OF CONNECTION (START OF CONTRACT): 10" FLANGE, 12" ABOVE THE FINISHED FLOOR IN THE FIRE PUMP ROOM.  
\*\* FEED RISER POINT OF CONNECTION (START OF CONTRACT): 8" FLANGE, 12" ABOVE THE FINISHED FLOOR IN THE FIRE PUMP ROOM. TWO LOCATED ON EACH END OF THE BUILDING AND ONE ON EACH SIDE.  
\*\* INSTALL (18) 2 1/2" HOSE VALVES LOCATED AT MAN DOORS AND FED FROM ADJACENT SYSTEMS

NOT INCLUDED:  
\*\* WIRING OF ELECTRICAL DEVICES  
\*\* FIRE EXTINGUISHERS  
\*\* STANDPIPES AND HOSE STATIONS  
\*\* FIRE PUMP CONTROLLER AUTO TRANSFER SWITCH  
\*\* UNDERGROUND PIPING AND TESTING  
\*\* COLUMN SPRINKLERS  
\*\* SEISMIC BRACING  
\*\* PAINTED PIPING  
\*\* CONCRETE PADS  
\*\* COMPONENT IDENTIFICATION BEYOND NFPA 13 REQUIREMENTS  
\*\* ACCESS PANELS  
\*\* CUTTING AND PATCHING  
\*\* PIPE SLEEVES  
\*\* WALL POST INDICATOR VALVE  
\*\* PUMP CONTROLLER AUTOMATIC TRANSFER SWITCH

## CODE INFORMATION

CODE INFORMATION:  
\*\*NFPA 13, 2016 EDITION: INSTALLATION OF SPRINKLER SYSTEMS  
\*\*NFPA 20, 2016 EDITION: INSTALLATION OF CENTRIFUGAL FIRE PUMPS  
\*\*INTERNATIONAL BUILDING & FIRE CODE, 2018 EDITION  
\*\*LOCAL AMENDMENTS

BUILDING INFO:  
IBC OCCUPANCY CLASSIFICATION: S-1  
IBC CONSTRUCTION TYPE: I-B  
IBC SEISMIC DESIGN CATEGORY: B  
HIGHEST FLOOR ELEVATION FROM FIRE DEPARTMENT VEHICLE ACCESS: GRADE  
NUMBER OF STORIES: 1  
BUILDING AREA: 433,364 S.F.

## GENERAL REQUIREMENTS

\*\* SUPPLY A SPARE SPRINKLER CABINET WITH WRENCH FOR EACH SPRINKLER TYPE AS REQUIRED BY NFPA 13.  
\*\* IDENTIFY ALL HYDRAULICALLY CALCULATED SYSTEMS WITH A PERMANENTLY MARKED AND WEATHERPROOF SIGN.  
\*\* ALL NEW PIPING OR PIPING MODIFICATIONS WHICH AFFECT MORE THAN 20 SPRINKLERS SHALL BE HYDROSTATICALLY TESTED AT 200 PSI OR 50 PSI OVER THE SYSTEM WORKING PRESSURE. THE SYSTEM SHALL MAINTAIN THIS PRESSURE WITHOUT LOSS FOR 2 HOURS.  
\*\* ALL NEW PIPING OR PIPING MODIFICATIONS WHICH AFFECT 20 SPRINKLERS OR LESS SHALL BE TESTED AT THE SYSTEM WORKING PRESSURE.  
\*\* ALL PIPING MODIFICATIONS WHICH CANNOT BE ISOLATED FROM THE EXISTING SYSTEM, SHALL BE TESTED AT THE SYSTEM WORKING PRESSURE.  
\*\* THE LOCAL FIRE/BUILDING INSPECTOR IS TO BE NOTIFIED 48 HOURS IN ADVANCE OF ALL TESTING.  
UNDERGROUND TESTING AND FLUSHING:  
\*\* ALL UNDERGROUND PIPE SHALL BE TESTED AND FLUSHED BY THE INSTALLING CONTRACTOR AS REQUIRED BY NFPA 24 BEFORE ANY OVERHEAD SPRINKLER PIPING IS CONNECTED.

## VALVES

\*\* ALL VALVES CONTROLLING WATER FLOW TO SPRINKLERS SHALL BE INDICATING & SUPERVISED.  
\*\* ALL VALVES SHALL BE ACCESSIBLE AT ALL TIMES AND PERMANENTLY IDENTIFIED.  
\*\* THE IDENTIFICATION OF CONTROL VALVES SHALL INCLUDE A DESCRIPTION OR DIAGRAM OF WHAT THEY CONTROL.  
\*\* ALL TRAPPED PORTIONS OF SPRINKLER PIPING SHALL BE PROVIDED WITH A LOW POINT DRAIN AS REQUIRED BY NFPA 13.

## PIPE HANGERS

\*\* 2 1/2"-6" HANGER RINGS ARE TO BE ADJUSTABLE SWIVEL RINGS, ZINC PLATED, MANUFACTURED TO ANS/MSS SP-69 STANDARDS.  
\*\* 2 1/2"-6" CLEVIS HANGERS ARE TO BE ADJUSTABLE CLEVIS RINGS, PLAIN, MANUFACTURED TO ANS/MSS SP-69 STANDARDS.  
\*\* HANGERS AND SEISMIC BRACING ARE TO BE INSTALLED PER NFPA 13 REQUIREMENTS.  
\*\* HANGER ROD SIZES AND LOCATIONS ARE TO BE AS REQUIRED BY NFPA 13.

## DESIGN CRITERIA - LIGHT HAZARD

SPRINKLER SYSTEM DESIGN CRITERIA - LIGHT HAZARD AREA/DENSITY (WET & SINGLE INTERLOCKED PREACTION SYSTEMS):  
THE NEW SYSTEM HAS BEEN DESIGNED WITH A DESIGN DENSITY OF .10 GPM/S.F. OVER THE MOST REMOTE AND DEMANDING DESIGN AREA OF 1500 S.F. WITH 225 S.F. (15') MAXIMUM SPRINKLER HEAD SPACING AND 100 GPM OUTSIDE HOSE ALLOWANCE. WHERE ROOF OR CEILING SLOPES EXCEED A PITCH OF 2:12, THE DESIGN AREA HAS BEEN INCREASED IN SIZE BY UP TO 1950 S.F. THE DESIGN AREA MAY BE REDUCED IN SIZE IN ACCORDANCE WITH NFPA 13 DUE TO THE USE OF QUICK RESPONSE SPRINKLERS BUT SHALL NEVER CONTAIN LESS THAN 5 SPRINKLERS. TOTAL SYSTEM SIZE SHALL NOT EXCEED 52,000 S.F.

WHERE EXTENDED COVERAGE SPRINKLERS ARE UTILIZED, THE MINIMUM DESIGN AREA SHALL BE 5 SPRINKLERS WITH 400 S.F. (20') MAXIMUM SPRINKLER HEAD SPACING. EXTENDED COVERAGE SPRINKLERS SHALL NOT BE USED WHERE ROOF OR CEILING SLOPES EXCEED A PITCH OF 2:12. WHERE SPECIFICALLY LISTED FOR SUCH USE, EXTENDED COVERAGE SPRINKLERS MAY BE USED FOR ROOF OR CEILING SLOPES UP TO A 4:12 PITCH.

WHEN A REDUCTION IN THE DESIGN AREA IS NOT USED, SPRINKLER DISCHARGE IN SMALL ROOMS SUCH AS CLOSETS AND BATHROOMS CONTAINING A SINGLE SPRINKLER MAY BE OMITTED FROM THE HYDRAULIC CALCULATIONS.

DRAWING SYMBOLS	
PIPING CENTERLINES	
★ 0" TS	TO TOP OF STEEL OR ROOF DECK
★ 0" TS	TO FLOOR
—	HANGER LOCATION
—	HYDRAULIC NODE
—	ELECTRIC ALARM BELL

## WET SYSTEM PIPE & FITTINGS

WET-PIPE SPRINKLER SYSTEM BLACK PIPE:  
\*\* 1" LINE PIPING SHALL BE BLACK STEEL SCH. 40 PIPE, MANUFACTURED TO ASTM A63 OR A795 STANDARDS.  
\*\* 2 1/2" LINE PIPING SHALL BE BLACK STEEL SCH. 7 PIPE, MANUFACTURED TO ASTM A795 STANDARDS.

\*\* 8" MAIN PIPING SHALL BE BLACK STEEL SCH. 10 PIPE, MANUFACTURED TO ASTM A135 STANDARDS.  
\*\* 2'-6" MAIN PIPING SHALL BE BLACK STEEL SCH. 7 PIPE, MANUFACTURED TO ASTM A795 STANDARDS.

WET-PIPE SPRINKLER SYSTEM BLACK FITTINGS:  
\*\* 1" BRANCH LINE FITTINGS SHALL BE BLACK DUCTILE IRON THREADED, CLASS 150 STANDARD, MANUFACTURED PER ANSI/ASME B16.3, U.L. LISTED FOR FIRE PROTECTION USE UP TO 175 PSI WORKING PRESSURE.  
\*\* 1/2" - 3" BRANCH LINE PIPE OUTLETS TO BE WELDED MANUFACTURED TO ASTM A53 & ANSI B1.20.1 STANDARDS.  
\*\* 1 1/4"-3" BRANCH LINE FITTINGS SHALL BE STANDARD GROOVED DUCTILE IRON, MANUF. TO ASTM A536 STANDARDS.

\*\* 2 1/2"-8" MAIN PIPE BRANCH OUTLETS TO BE WELDED MANUFACTURED TO ASTM A53 & ANSI B1.20.1 STANDARDS.  
\*\* 2 1/2"-8" MAIN PIPE FITTINGS SHALL BE STANDARD GROOVED DUCTILE IRON, MANUF. TO ASTM A536 STANDARDS.  
2 1/2"-8" MAIN PIPE FITTINGS SHALL BE STANDARD GROOVED STEEL, MANUF. TO ASTM A598/A53 STANDARDS.

## DESIGN CRITERIA - ESFR

SPRINKLER SYSTEM DESIGN CRITERIA (ESFR)-PALLETIZED/SOLID-PILE/RACK STORAGE:

FROM NFPA 13, 2016 EDITION TABLE 16.3.3.1  
COMMODITY CLASSIFICATION: CLASS I, II, III OR IV, ENCAPSULATED OR UNENCAPSULATED, NO OPEN TOP CONTAINERS  
STORAGE ARRANGEMENT: PALLETIZED/SOLID-PILE/SINGLE & DOUBLE ROW RACKS WITH NO SOLID SHELVING  
CONSTRUCTION TYPE: ALL TYPES  
MAXIMUM STORAGE HEIGHT: 35 FEET  
MAXIMUM CEILING/ROOF HEIGHT: 40 FEET  
MINIMUM CLEARANCE FROM SPRINKLER DEFLECTOR TO TOP OF STORAGE: 36 INCHES  
SPRINKLER TYPE: ESFR (EARLY SUPPRESSION FAST-RESPONSE)  
SPRINKLER K-FACTOR: 16.8  
SPRINKLER TEMPERATURE RATING: 205°F  
SPRINKLER ORIENTATION: PENDENT  
MAXIMUM SPRINKLER DEFLECTOR DISTANCE BELOW CEILING: 14 INCHES  
MINIMUM SPRINKLER DEFLECTOR DISTANCE BELOW CEILING: 6 INCHES  
MAXIMUM SPRINKLER SPACING/AREA: 10 FEET/100 S.F.  
MINIMUM SPRINKLER SPACING: 8 FEET/64 S.F.  
TYPE OF SYSTEM: WET  
NUMBER OF DESIGN SPRINKLERS: 12  
MINIMUM SPRINKLER OPERATING PRESSURE: 52 PSI  
INSIDE HOSE STREAM ALLOWANCE: 0 GPM  
OUTSIDE HOSE STREAM ALLOWANCE: 250 GPM  
TOTAL HOSE STREAM ALLOWANCE: 250 GPM  
IN-RACK SPRINKLERS: NO


SPRINKLER SYSTEM DESIGN CRITERIA (ESFR)-PALLETIZED/SOLID-PILE/RACK STORAGE:

FROM NFPA 13, 2016 EDITION TABLE 16.3.3.1  
COMMODITY CLASSIFICATION: CLASS I, II, III OR IV, ENCAPSULATED OR UNENCAPSULATED, NO OPEN TOP CONTAINERS  
STORAGE ARRANGEMENT: PALLETIZED/SOLID-PILE/SINGLE & DOUBLE ROW RACKS WITH NO SOLID SHELVING  
CONSTRUCTION TYPE: ALL TYPES  
MAXIMUM STORAGE HEIGHT: 40 FEET  
MAXIMUM CEILING/ROOF HEIGHT: 45 FEET  
MINIMUM CLEARANCE FROM SPRINKLER DEFLECTOR TO TOP OF STORAGE: 36 INCHES  
SPRINKLER TYPE: ESFR (EARLY SUPPRESSION FAST-RESPONSE)  
SPRINKLER K-FACTOR: 22.4  
SPRINKLER TEMPERATURE RATING: 205°F  
SPRINKLER ORIENTATION: PENDENT  
MAXIMUM SPRINKLER DEFLECTOR DISTANCE BELOW CEILING: 18 INCHES  
MINIMUM SPRINKLER DEFLECTOR DISTANCE BELOW CEILING: 6 INCHES  
MAXIMUM SPRINKLER SPACING/AREA: 10 FEET/100 S.F.  
MINIMUM SPRINKLER SPACING: 8 FEET/64 S.F.  
TYPE OF SYSTEM: WET  
NUMBER OF DESIGN SPRINKLERS: 12  
MINIMUM SPRINKLER OPERATING PRESSURE: 40 PSI  
INSIDE HOSE STREAM ALLOWANCE: 0 GPM  
OUTSIDE HOSE STREAM ALLOWANCE: 250 GPM  
TOTAL HOSE STREAM ALLOWANCE: 250 GPM  
IN-RACK SPRINKLERS: NO

SYSTEMS SHALL BE WET ONLY.


ROOF OR CEILING SLOPES SHALL NOT EXCEED A PITCH OF 2:12.

TOTAL SYSTEM SIZE SHALL NOT EXCEED 40,000 S.F. COMBINED HIGH PILED/RACK STORAGE & LIGHT/ORDINARY HAZARD SYSTEMS MAY COVER UP TO 52,000 S.F.

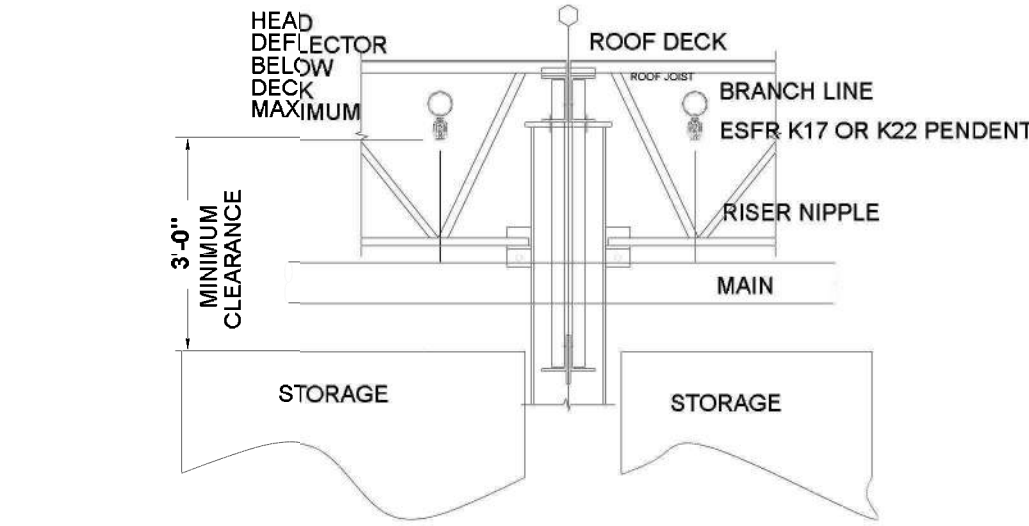


## STORAGE CLEARANCE

N.T.S.

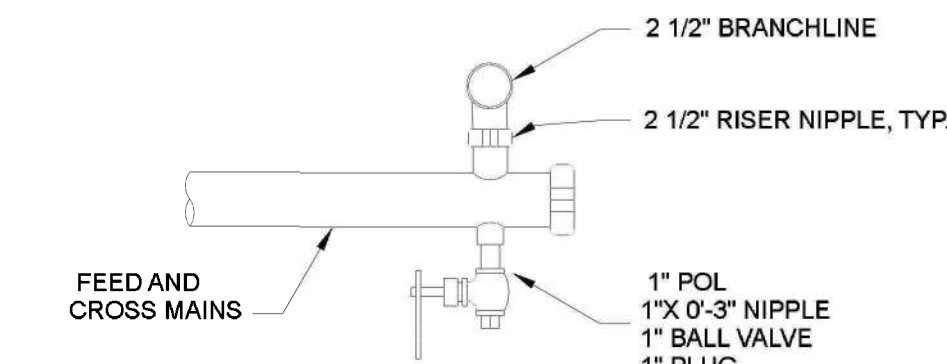


## TYPICAL DRAIN DETAIL

N.T.S.

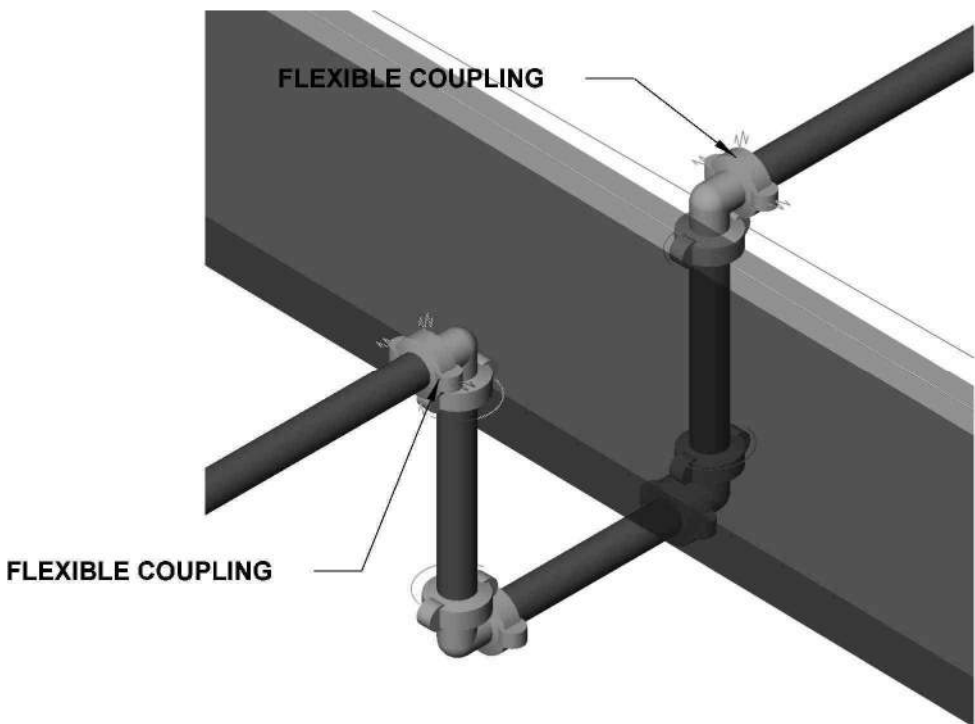


## TYPICAL LINE AT EXPANSION JOINT

N.T.S.

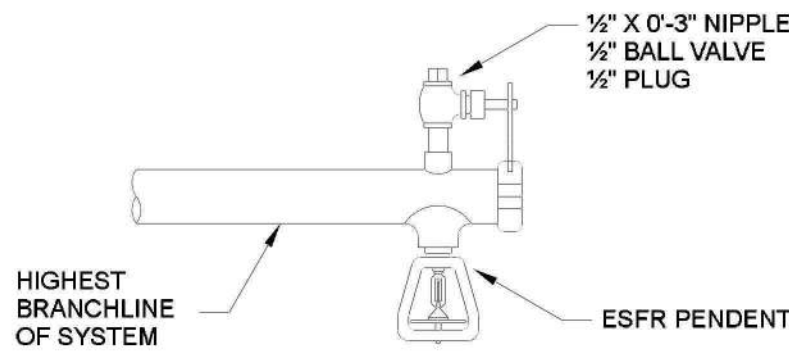

## MANUAL AIR VENT DETAIL

N.T.S.

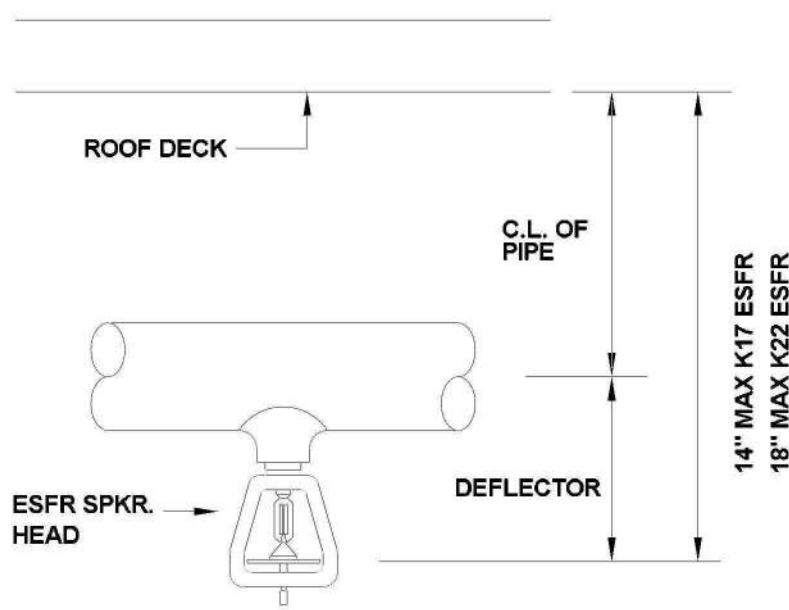


## ESFR PENDENT DETAIL

N.T.S.

HANGER INSTALLATION REQUIREMENTS									
MAXIMUM DISTANCE BETWEEN HANGERS									
NOMINAL PIPE SIZE	3/4"	1"	1-1/4"	1-1/2"	2"	2-1/2"	3"	4"	
BLAZEMASTER-OPV-G	5'-6"	6'-0"	6'-6"	7'-0"	8'-0"	9'-0"	10'-0"	N/A	
THREADED LIGHTWALL	N/A	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"	N/A	
STEEL PIPE (7/10/40)	N/A	12'-0"	12'-0"	15'-0"	15'-0"	15'-0"	15'-0"	15'-0"	


THE UNSUPPORTED LENGTH BETWEEN THE END SPRINKLER AND THE LAST HANGER ON THE LINE SHALL NOT EXCEED 36" FOR 1" PIPE, 48" FOR 1 1/4" PIPE AND 60" FOR 1 1/2" PIPE OR LARGER

THE CUMULATIVE HORIZONTAL LENGTH OF AN UNSUPPORTED ARMOR TO A SPRINKLER, SPRINKLER DROP, OR SPRIG-UP SHALL NOT EXCEED 24"

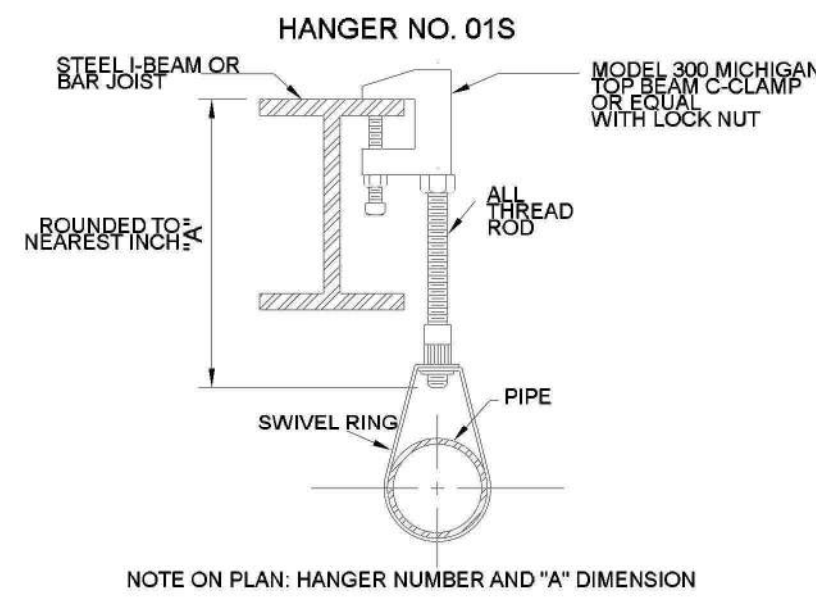

## TOP BEAM C-CLAMP DETAIL

N.T.S.

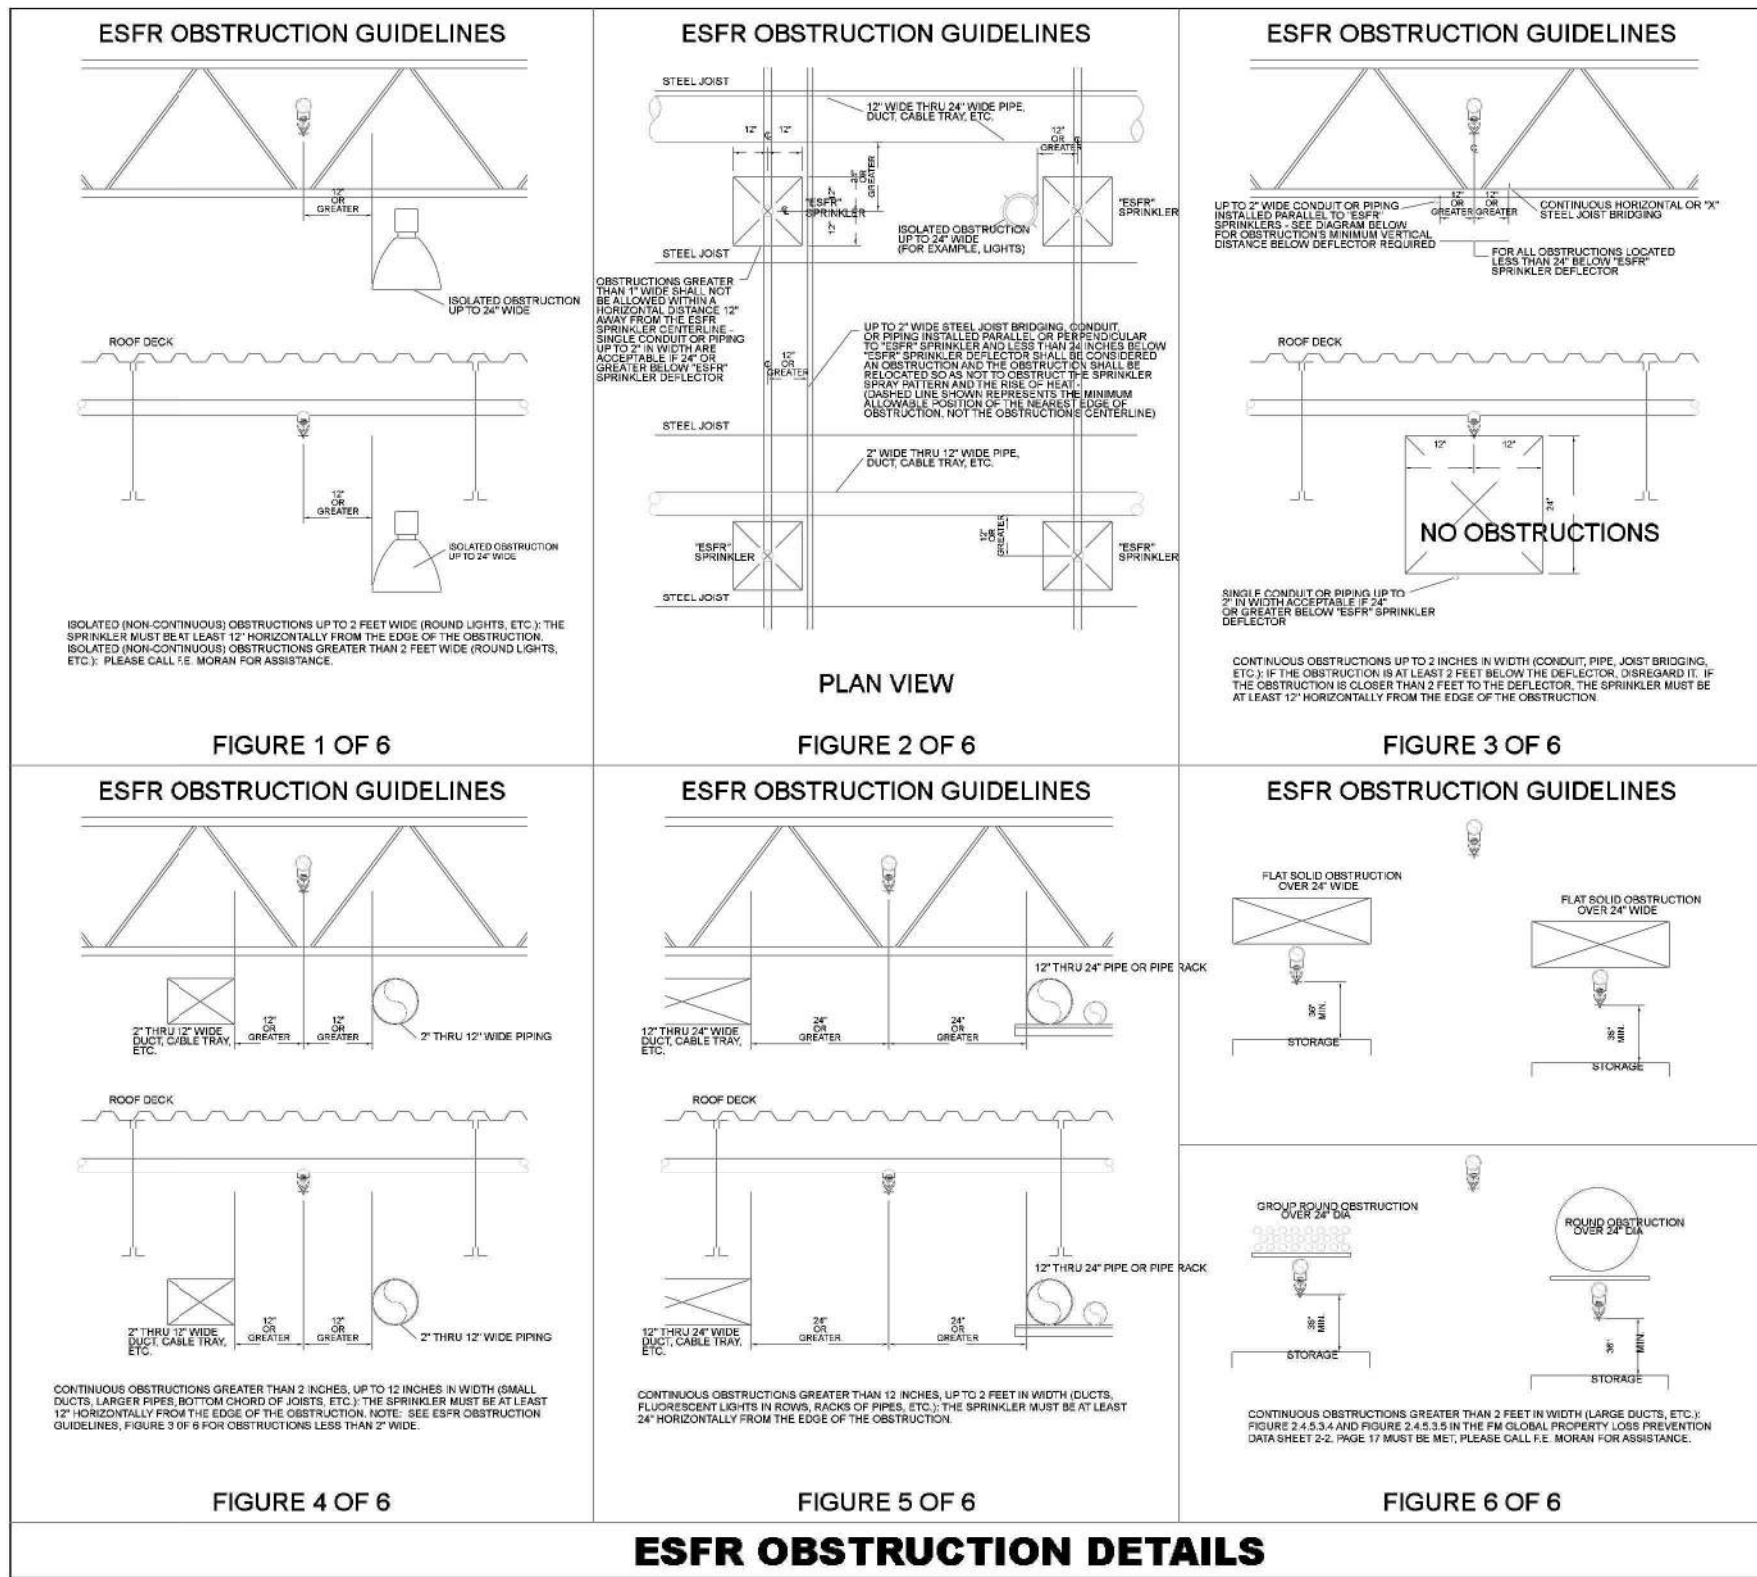


## ESFR OBSTRUCTION DETAILS

## DRAWING INDEX

FP0-0- SYSTEM NOTES  
FP10-0- HYDRAULIC SITE PLAN  
FP20-0- OVERHEAD PIPING PLAN  
FP2.1.1- AREA 1: SYSTEMS 1-2  
FP2.1.2- AREA 1: SYSTEMS 1-2 (CONT.)  
FP2.2.1- AREA 2: SYSTEMS 2-3  
FP2.2.2- AREA 2: SYSTEMS 2-3 (CONT.)  
FP2.3.1- AREA 3: SYSTEMS 3-4  
FP2.3.2- AREA 3: SYSTEMS 3-4 (CONT.)  
FP2.4- AREA 4: SYSTEM 05  
FP2.5- AREA 5: SYSTEM 06  
FP2.6- AREA 6: SYSTEM 07  
FP2.7.1- AREA 7: SYSTEMS 08-09  
FP2.7.2- AREA 7: SYSTEMS 08-09 (CONT.)  
FP2.8.1- AREA 8: SYSTEMS 09-10  
FP2.8.2- AREA 8: SYSTEM 09-10 (CONT.)  
FP2.9.1- AREA 9: SYSTEMS 10-11  
FP2.9.2- AREA 9: SYSTEMS 10-11 (CONT.)  
FP3.0- FIRE PUMP & RISER DETAIL




JASIEL COLBERT  
NICET LEVEL 1  
AUTO. SPRINKLER SYS. LAYOUT  
VALID THROUGH MARCH 03, 2025

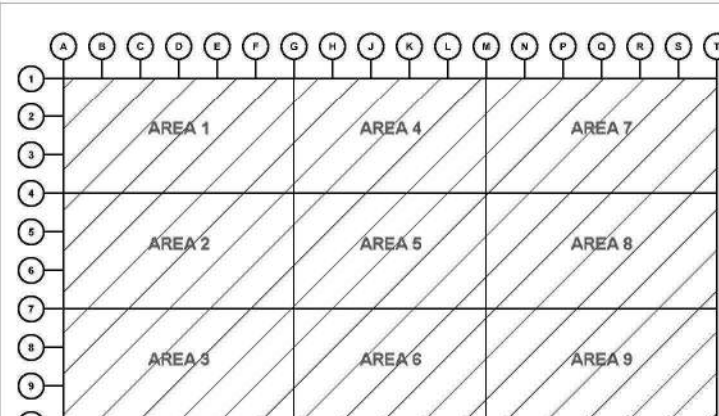

## KEY PLAN

RELEASED FOR CONSTRUCTION  
As Noted on Plans Review  
Development Services Department  
Lee's Summit, Missouri  
12/20/2022

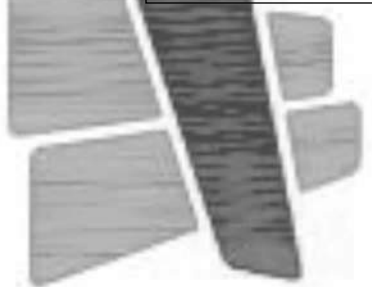


**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



**SCANNELL**  
PROPERTIES

## CERTIFICATION

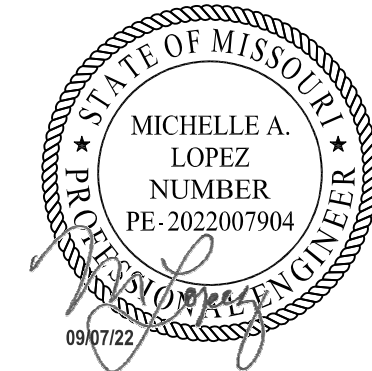

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.

## PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS

BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

## ISSUE DATES

PERMIT SET 02.18.22


TENANT IMPROVEMENT 09.07.22

210300

## FP0.0

SYSTEM NOTES



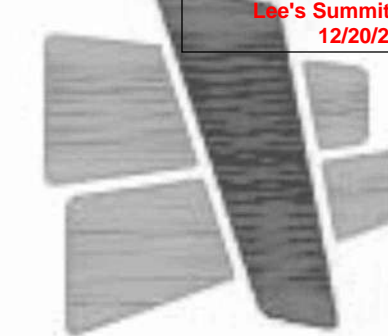


**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



SCANNELL  
PROPERTIES

## CERTIFICATION

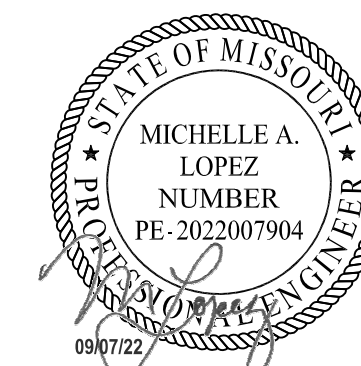

THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY OF  
CURRAN ARCHITECTURE, AND ARE NOT TO  
BE USED OR REPRODUCED, WHOLE OR IN  
PART, WITHOUT THE WRITTEN CONSENT OF  
CURRAN ARCHITECTURE.

## PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT 1

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


## ISSUE DATES

PERMIT SET	02.18.22
------------	----------


1	TENANT IMPROVEMENT	09.07.22
---	--------------------	----------

210300

## FP1.0

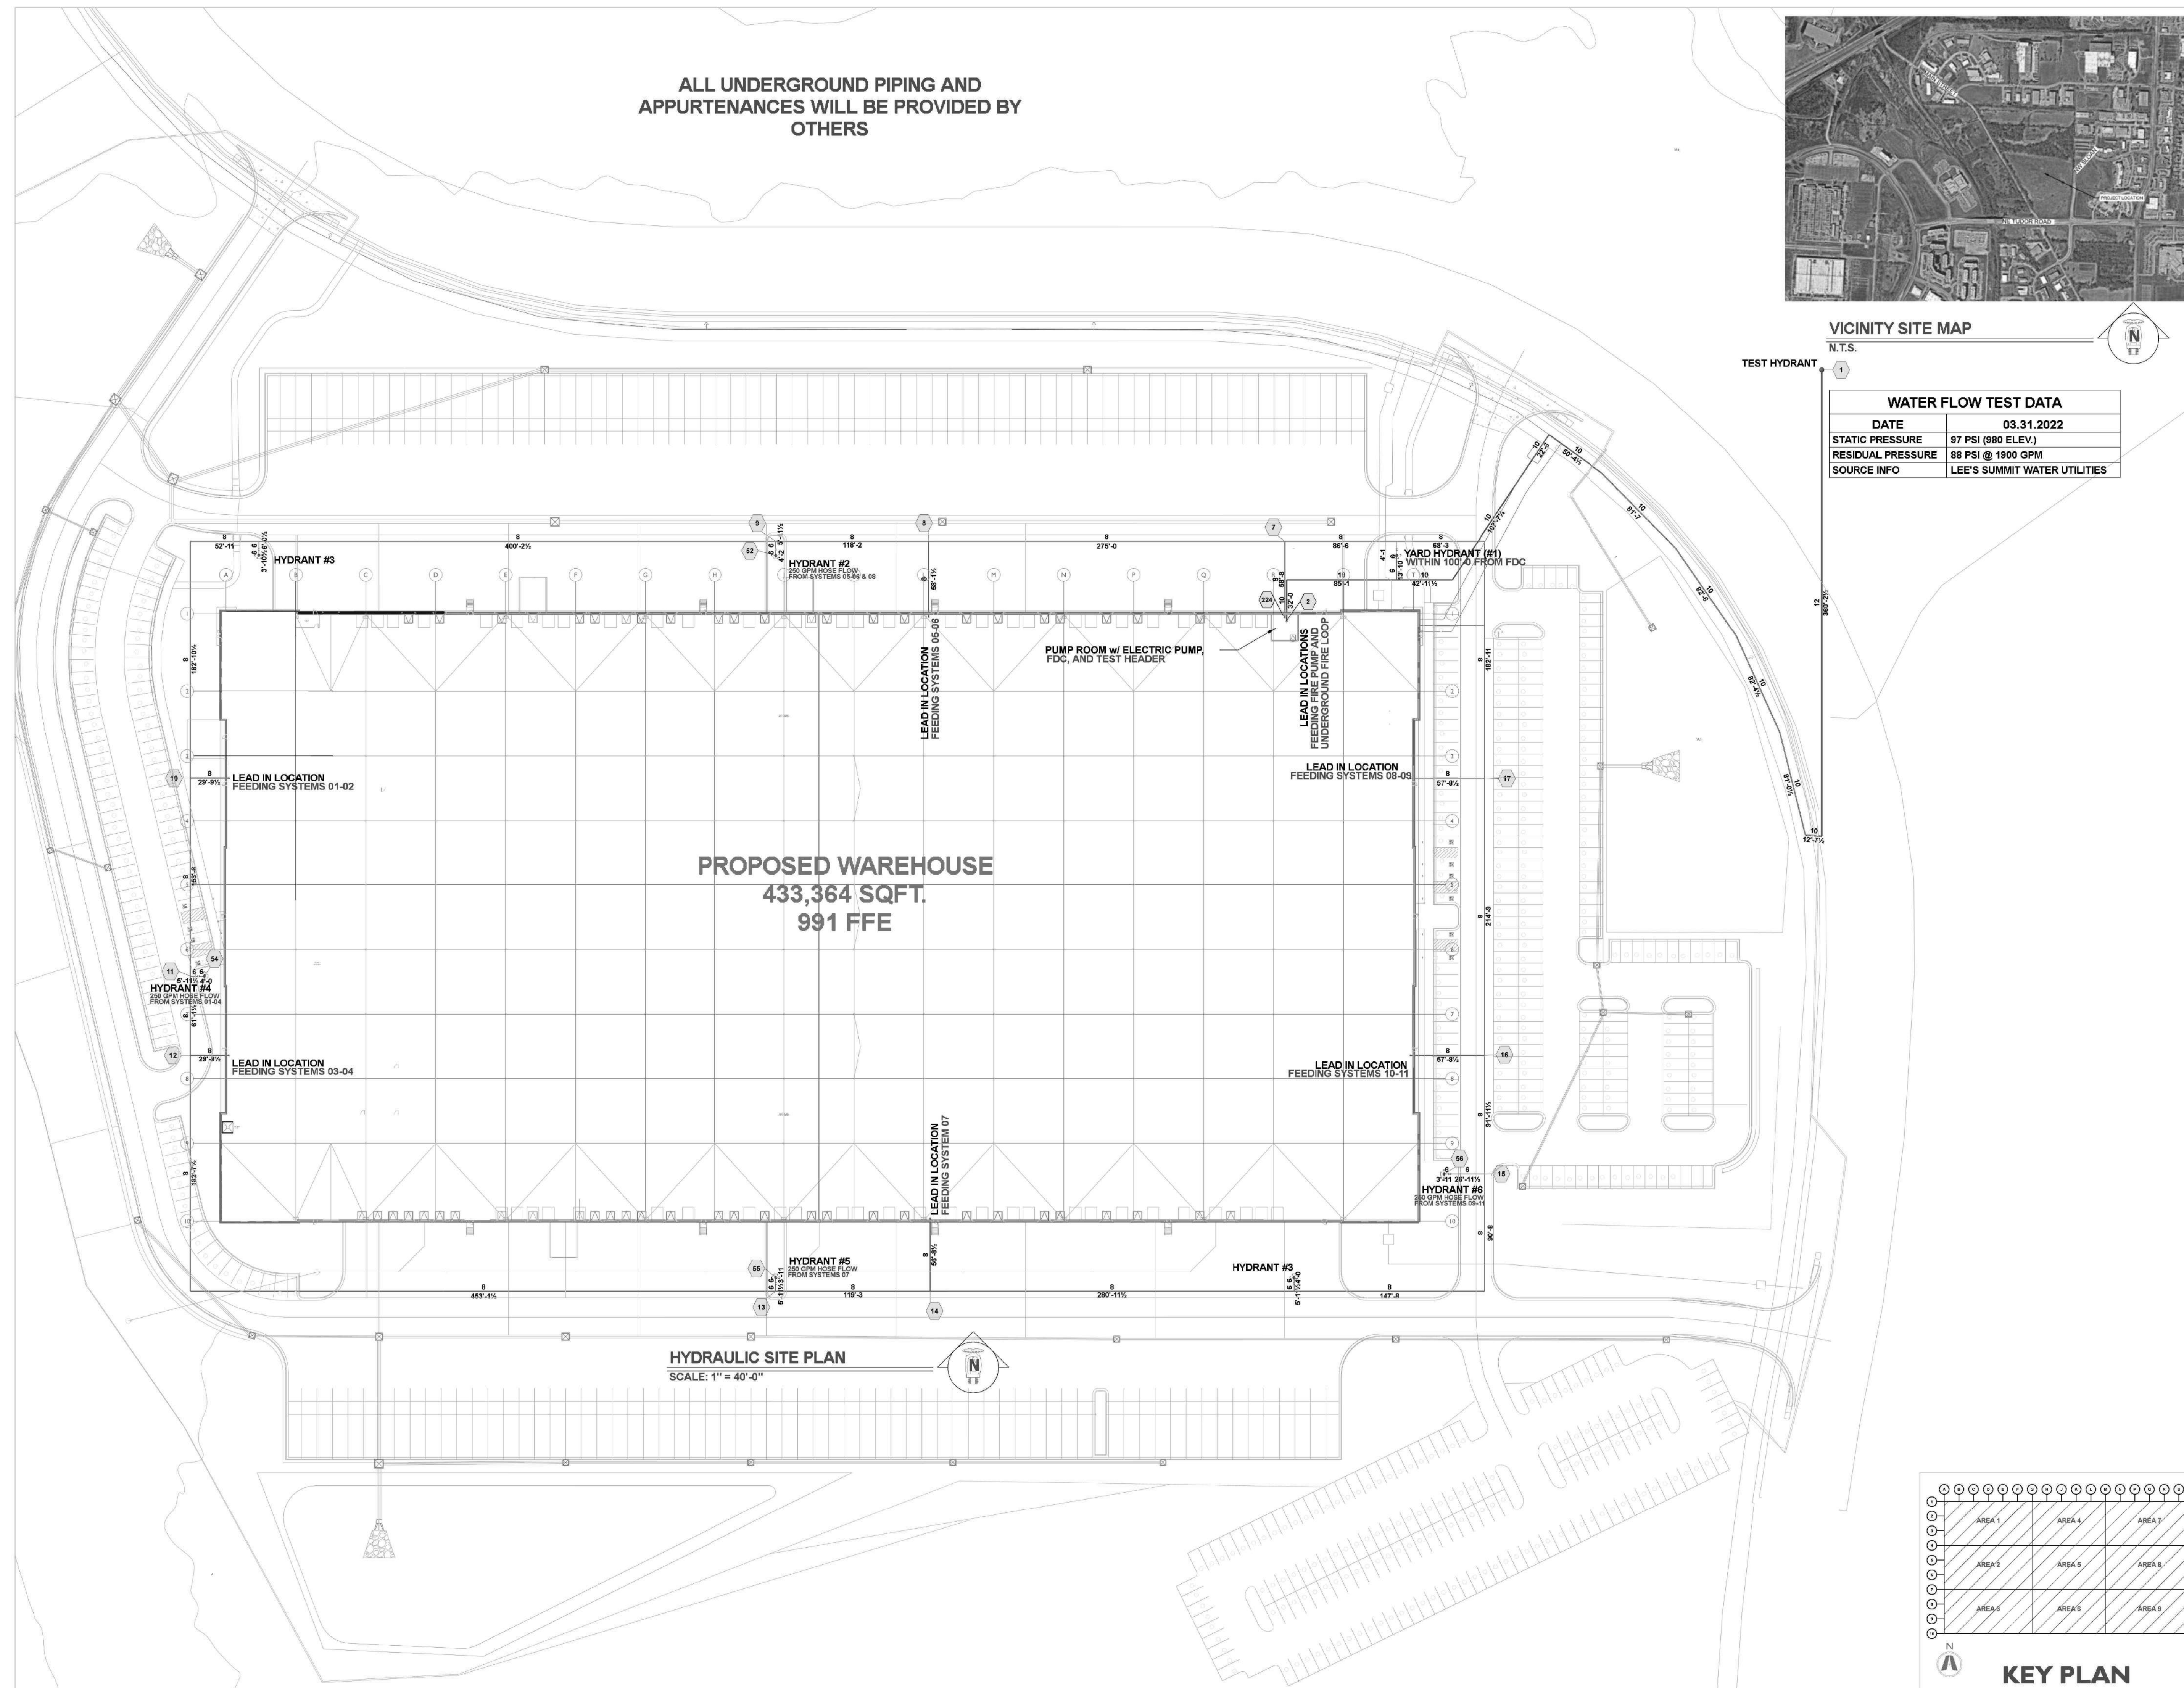HYDRAULIC SITE  
PLAN



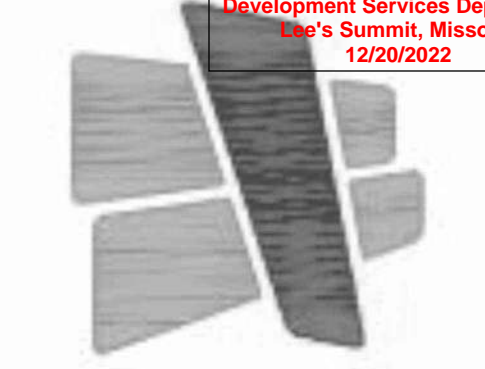

**CURRAN**  
ARCHITECTURE  
5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY OF  
CURRAN ARCHITECTURE, AND ARE NOT TO  
BE USED OR REPRODUCED, WHOLE OR IN  
PART, WITHOUT THE WRITTEN CONSENT OF  
CURRAN ARCHITECTURE.

PROJECT INFORMATION


LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I  
NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES	
PERMIT SET	02.18.22
TENANT IMPROVEMENT	09.07.22



210300

**FP2.0**

OVERHEAD PIPING  
LAYOUT

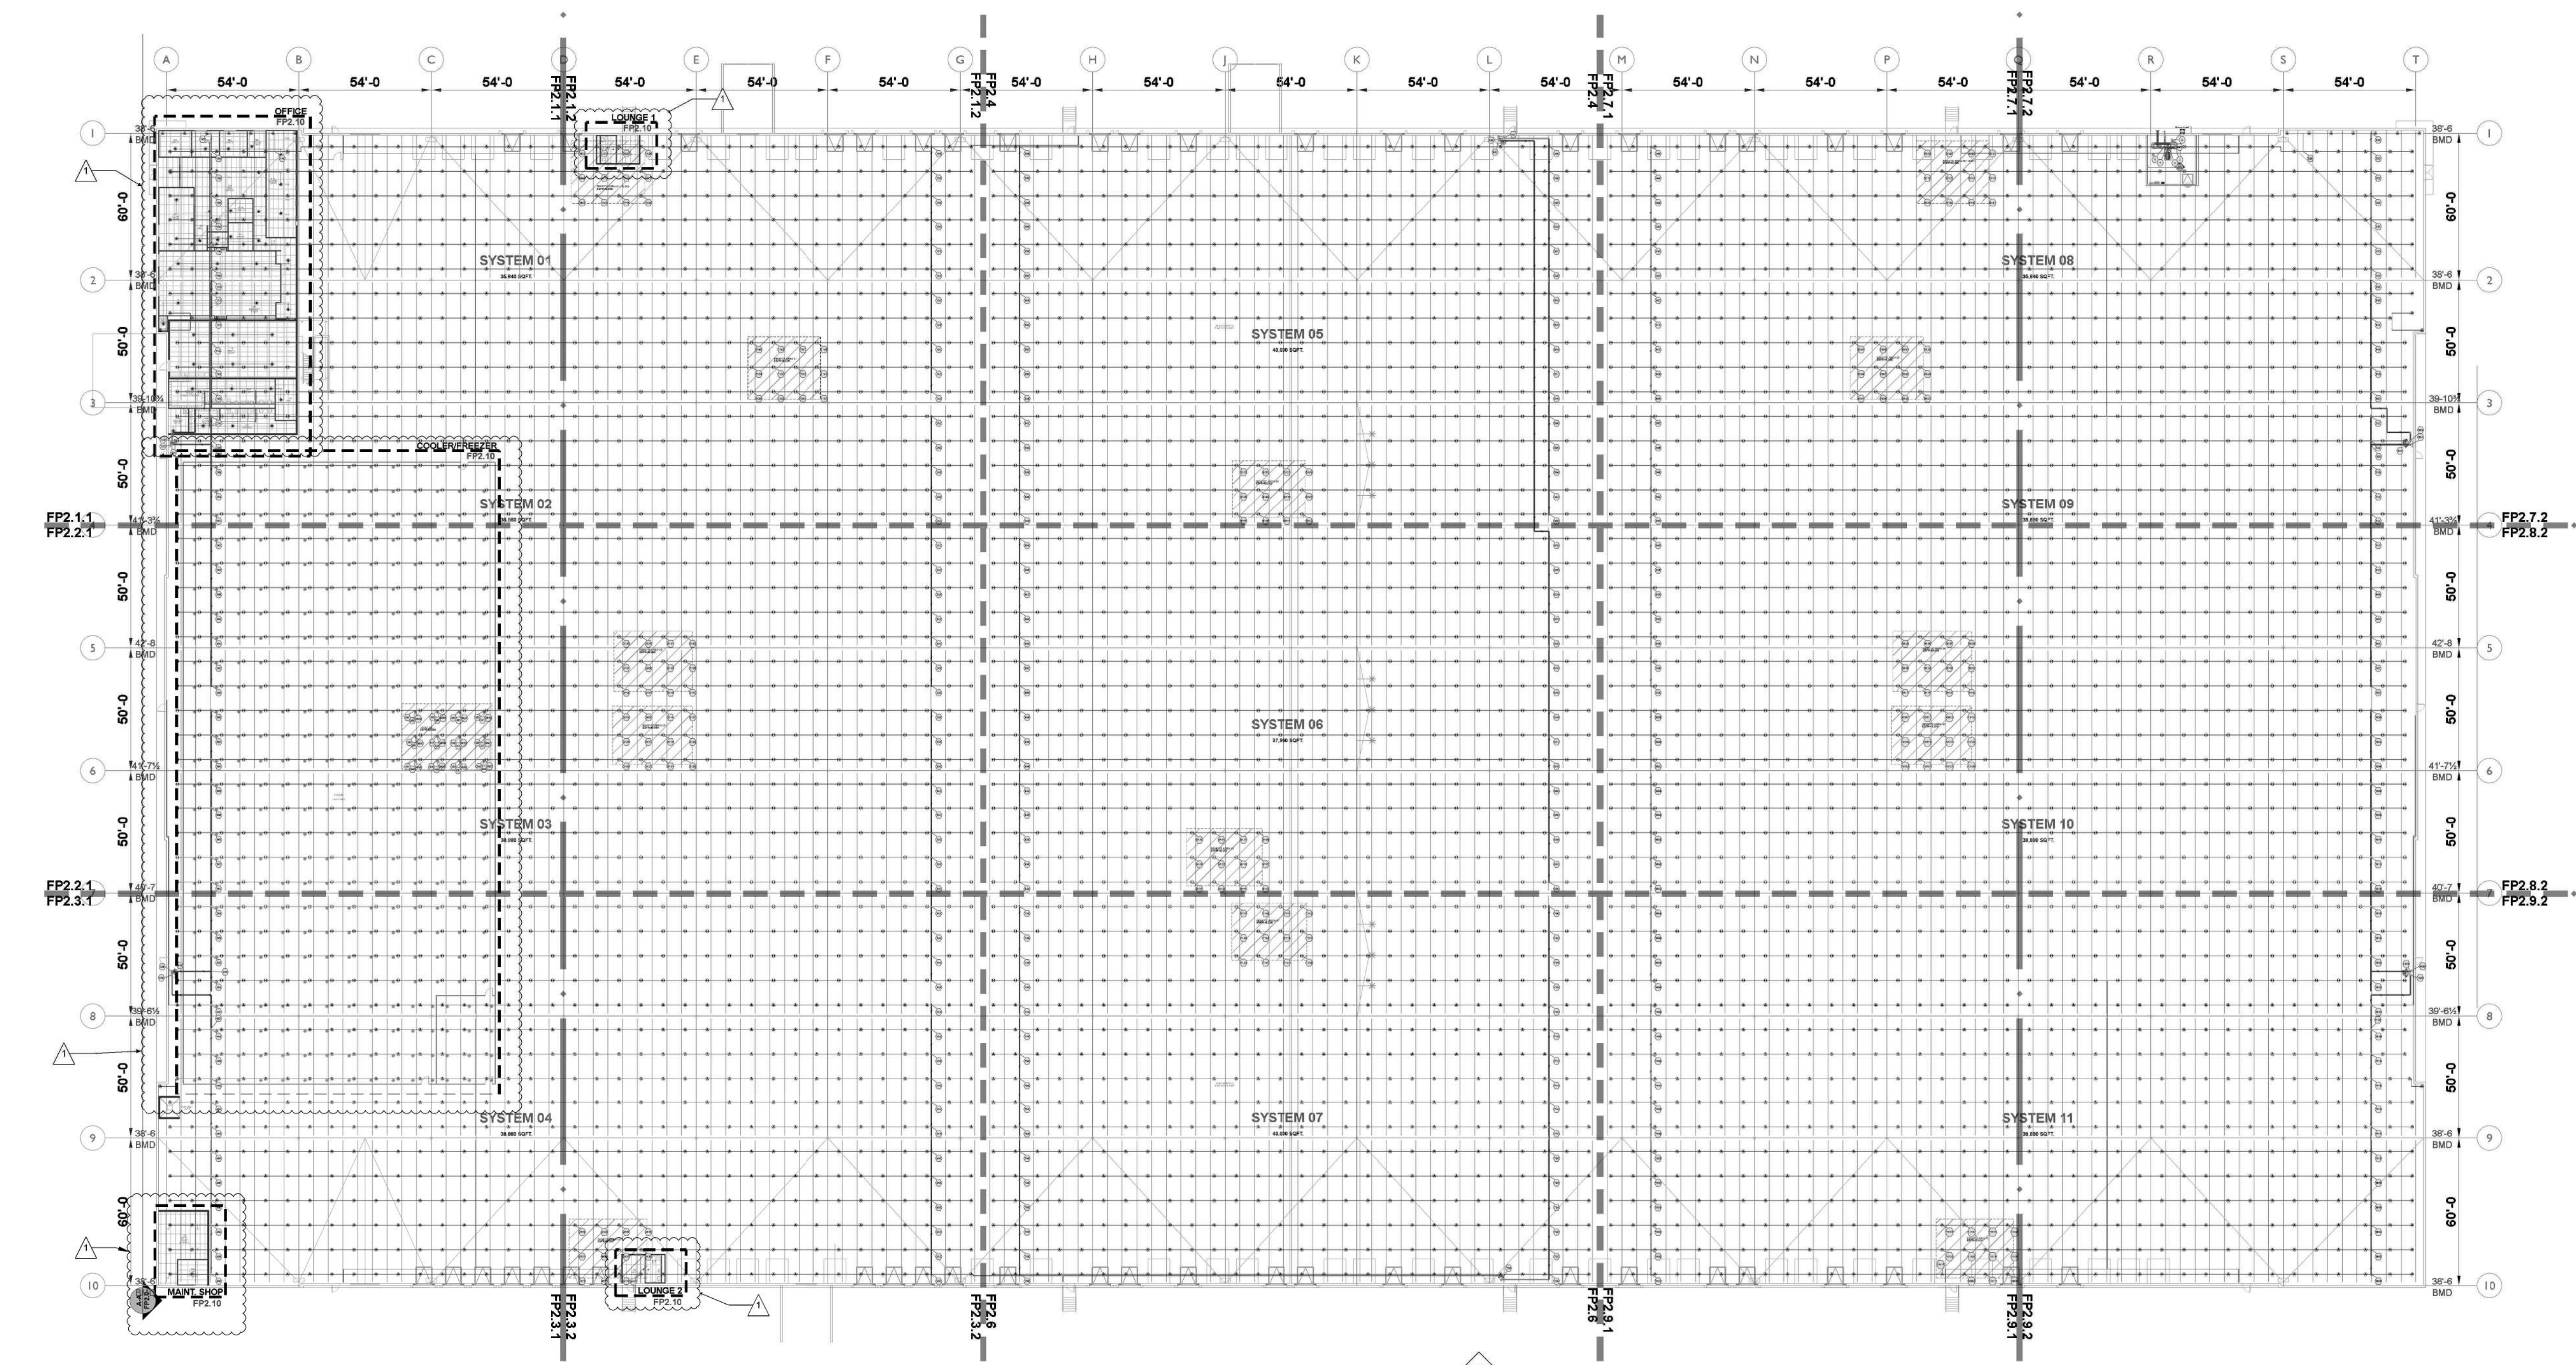


**OVERHEAD PIPING**  
SCALE: 1" = 30'-0"

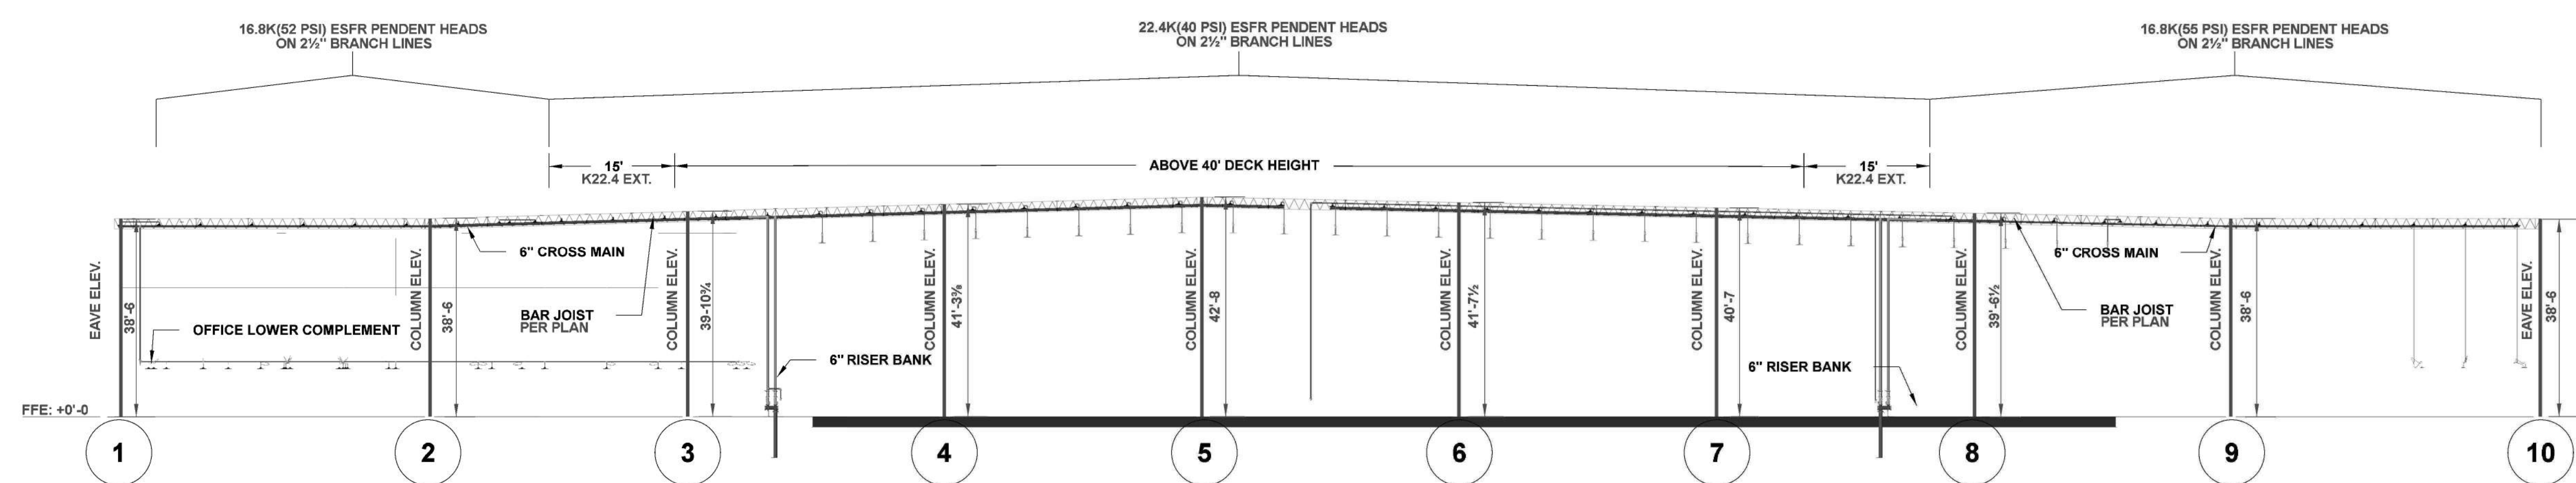

**WALL VIEW (SECTION A-A)**  
SCALE: 1/16" = 1'-0"

Sprinkler Legend									
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH
▲	2054	VICTAULIC	V4702	FL-QUIST/ESFR	16.8	PENDENT	1/2"	FAST	BRASS
●	4	VICTAULIC	V3406	V34	8	PENDENT	1/2"	QUICK	BRASS
●	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1/2"	FAST	BRASS
●	48	VIKING	VK600	MICROFAST	5.6	PENDENT	1/2"	QUICK	CHROME
●	6	VIKING	VK3021	ESFR	5.6	PENDENT	1/2"	QUICK	CHROME
●	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	1/2"	QUICK	BRASS
TOTAL = 5234									

\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6"  
OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

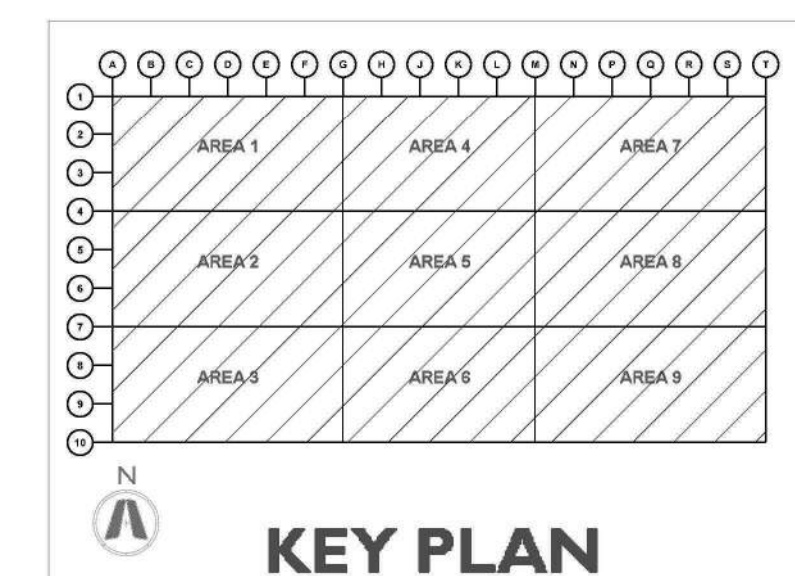

**KEY PLAN**





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



**SCANNELL**  
PROPERTIES

CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY OF  
CURRAN ARCHITECTURE, AND ARE NOT TO  
BE USED OR REPRODUCED, WHOLE OR IN  
PART, WITHOUT THE WRITTEN CONSENT OF  
CURRAN ARCHITECTURE.

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS

BUILDING A LOT I


NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES

PERMIT SET 02.18.22  
TENANT IMPROVEMENT 09.07.22

210300



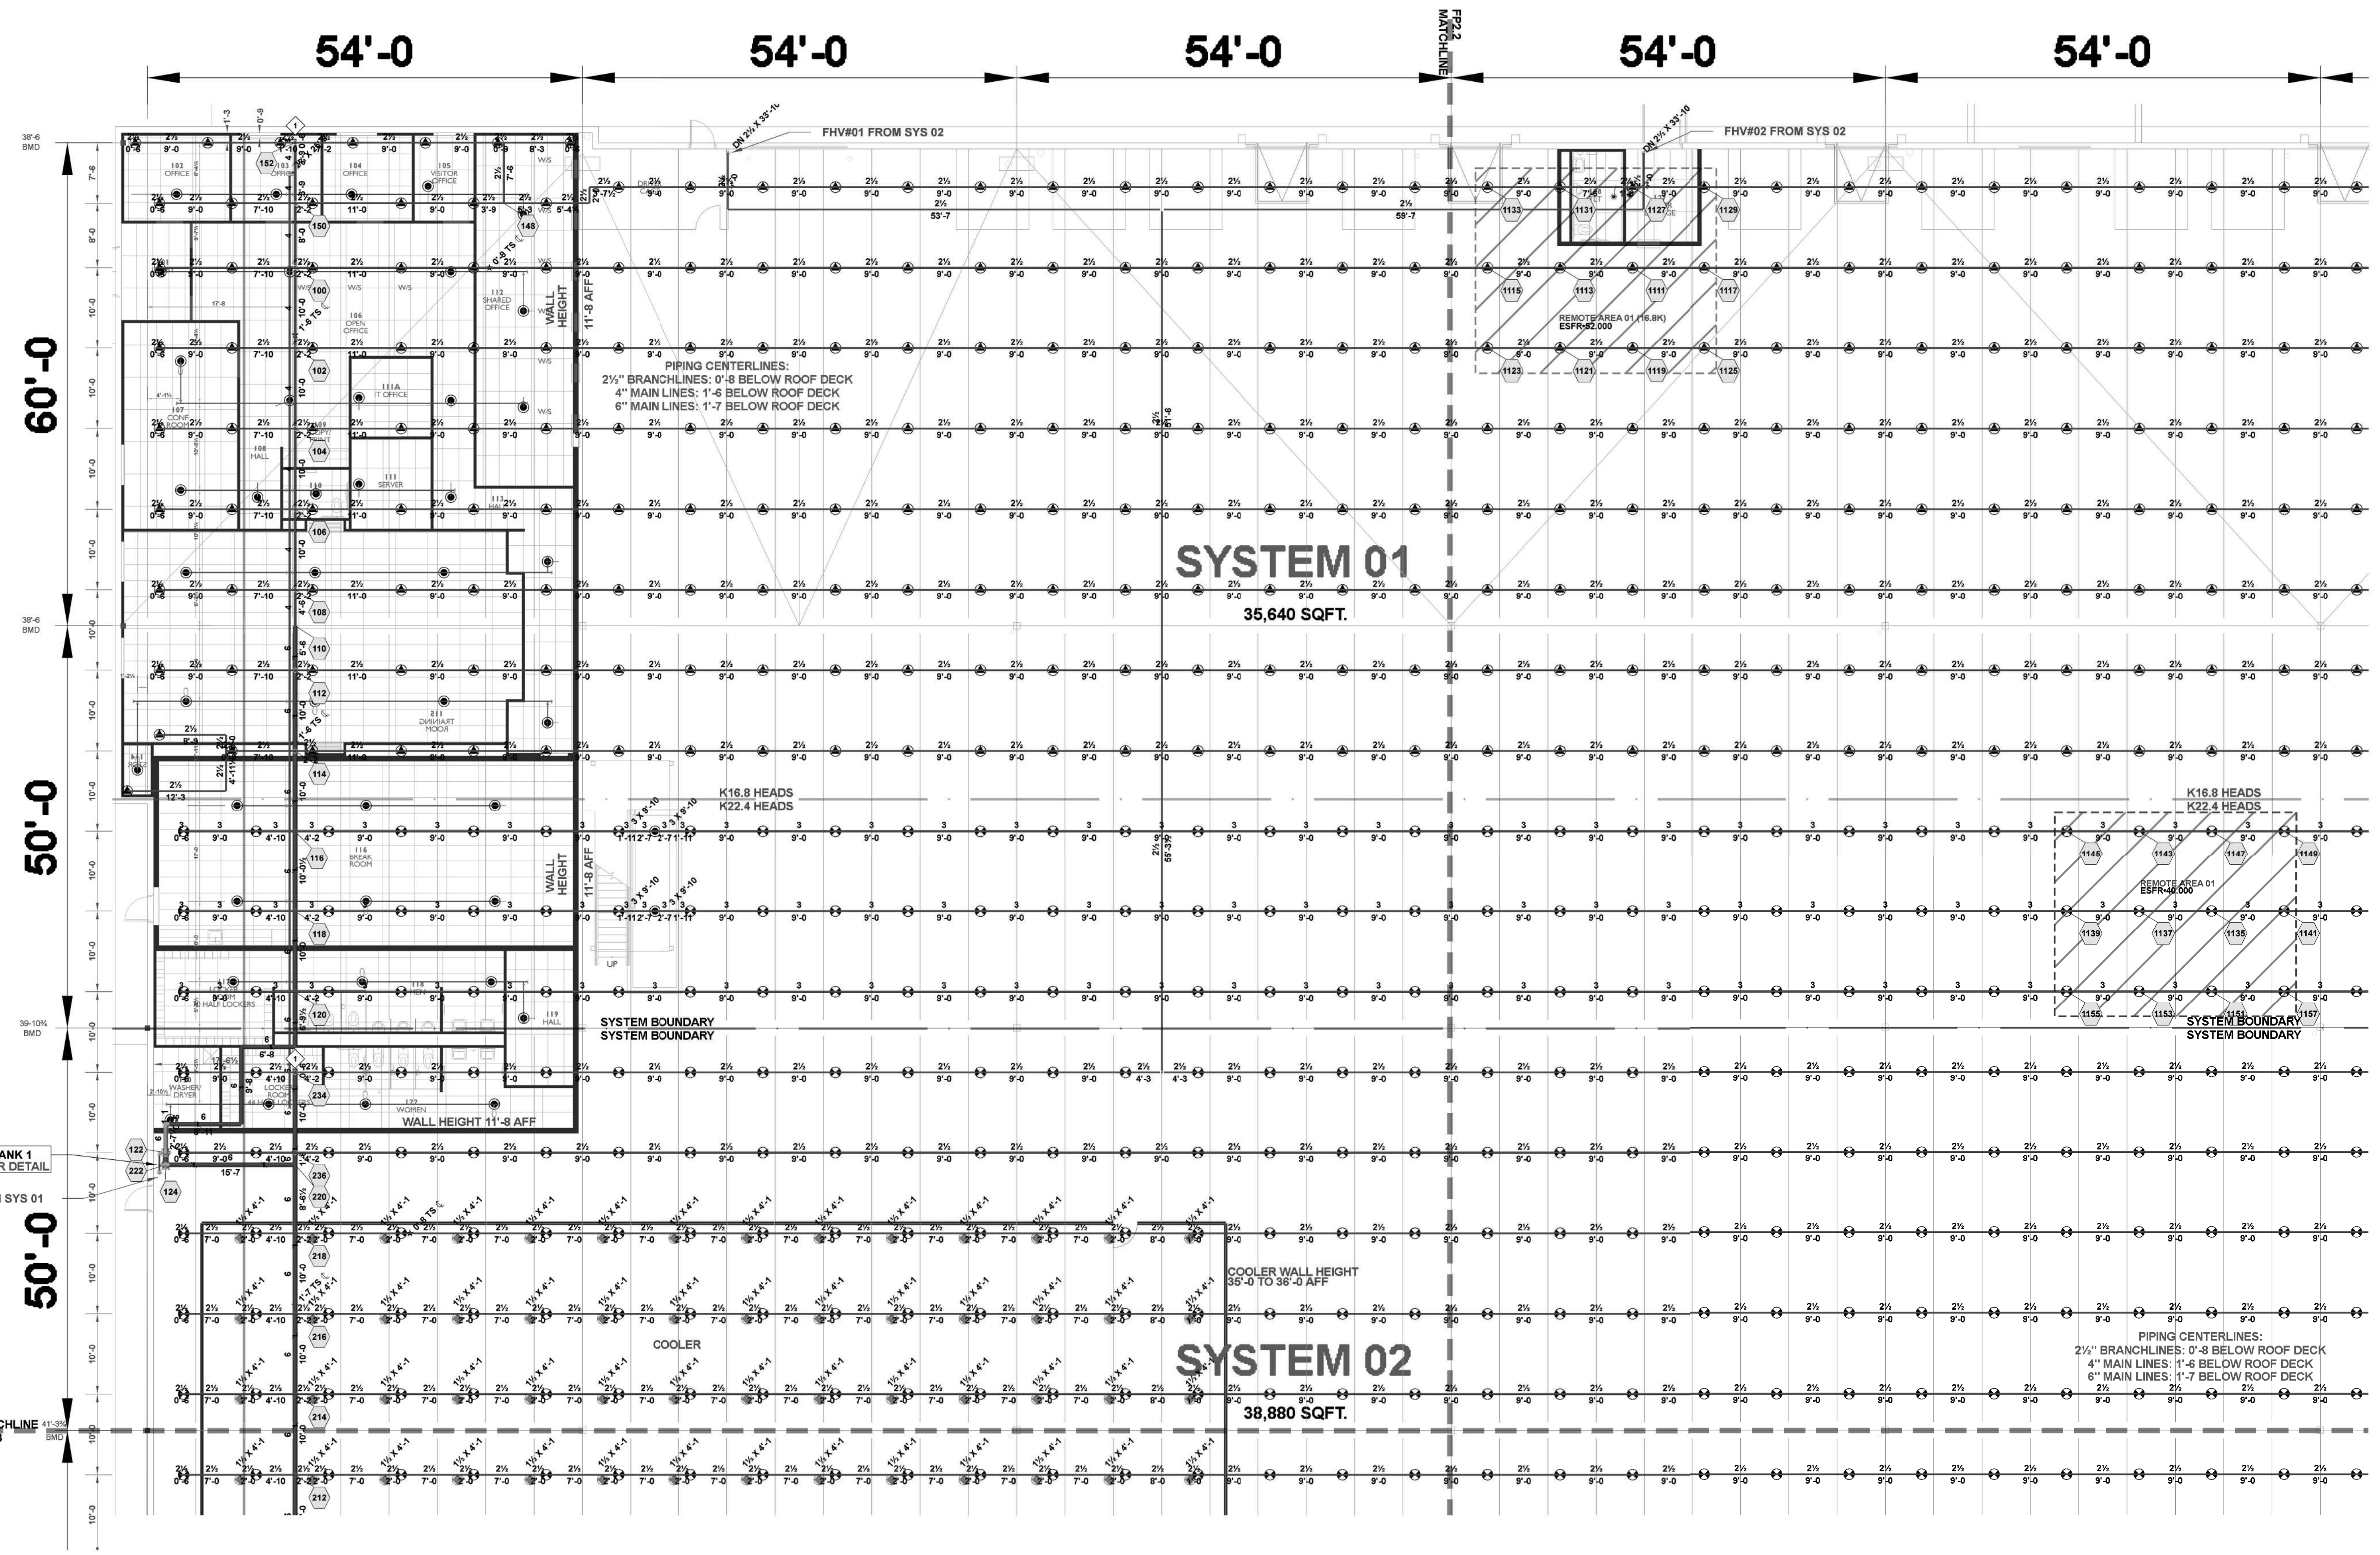



**FP2.1.1**  
AREA 1: SYSTEMS  
01-02



Hydraulic Information	
Remote Area 01 (K16.8)	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	52.000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	16.8
TOTAL WATER REQUIRED	1711.60
TOTAL PRESSURE REQUIRED	75.095
BASE OF RISER (GPM)	1711.60
BASE OF RISER (PSI)	75.095
SAFETY MARGIN (PSI)	+14.486 (16.2%)


Hydraulic Information	
Remote Area 01	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	40.000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	22.4
TOTAL WATER REQUIRED	1959.70
TOTAL PRESSURE REQUIRED	68.043
BASE OF RISER (GPM)	1959.70
BASE OF RISER (PSI)	68.043
SAFETY MARGIN (PSI)	+19.427 (22.2%)

AREA 1: SYSTEMS 01-02  
SCALE: 3/32" = 1'-0"


Sprinkler Legend											
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE	NOTE
	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	¾	FAST	BRASS	200°F	
	4	VICTAULIC	V3406	V34	8	PENDENT	¾	QUICK	BRASS	200°F	
	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1	FAST	BRASS	200°F	
	48	VIKING	VK600	MICROFAST	5.6	PENDENT	½	QUICK	CHROME	135°F	
	6	VIKING	VK3021		5.6	PENDENT	½	QUICK	CHROME	135°F	
	388	VIKING	VK504	ESFR DRY	16.8	PENDENT	¾	QUICK	BRASS	205°F	
	TOTAL = 5234										

\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6" OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

- ⬡ - AUXILIARY DRAIN  
SEE FP0.0 FOR DETAIL
- ⬢ - AIR VENT  
SEE FP0.0 FOR DETAIL

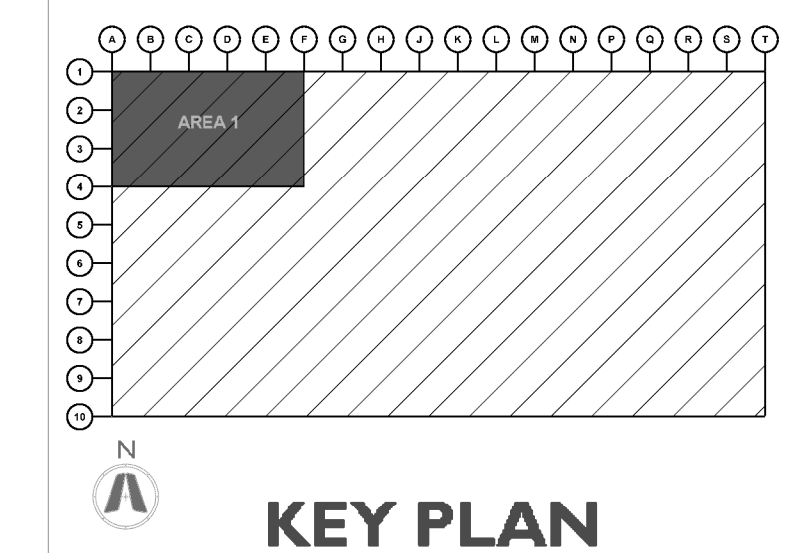



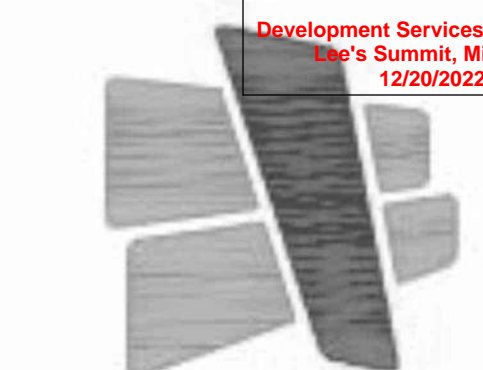

**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



**SCANNELL**  
PROPERTIES

CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY OF  
CURRAN ARCHITECTURE, AND ARE NOT TO  
BE USED OR REPRODUCED, WHOLE OR IN  
PART, WITHOUT THE WRITTEN CONSENT OF  
CURRAN ARCHITECTURE.

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I


NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES

PERMIT SET 02.18.22  
TENANT IMPROVEMENT 09.07.22

210300

**FP2.1.2**  
AREA 1 (CONT.):  
SYSTEMS 01-02

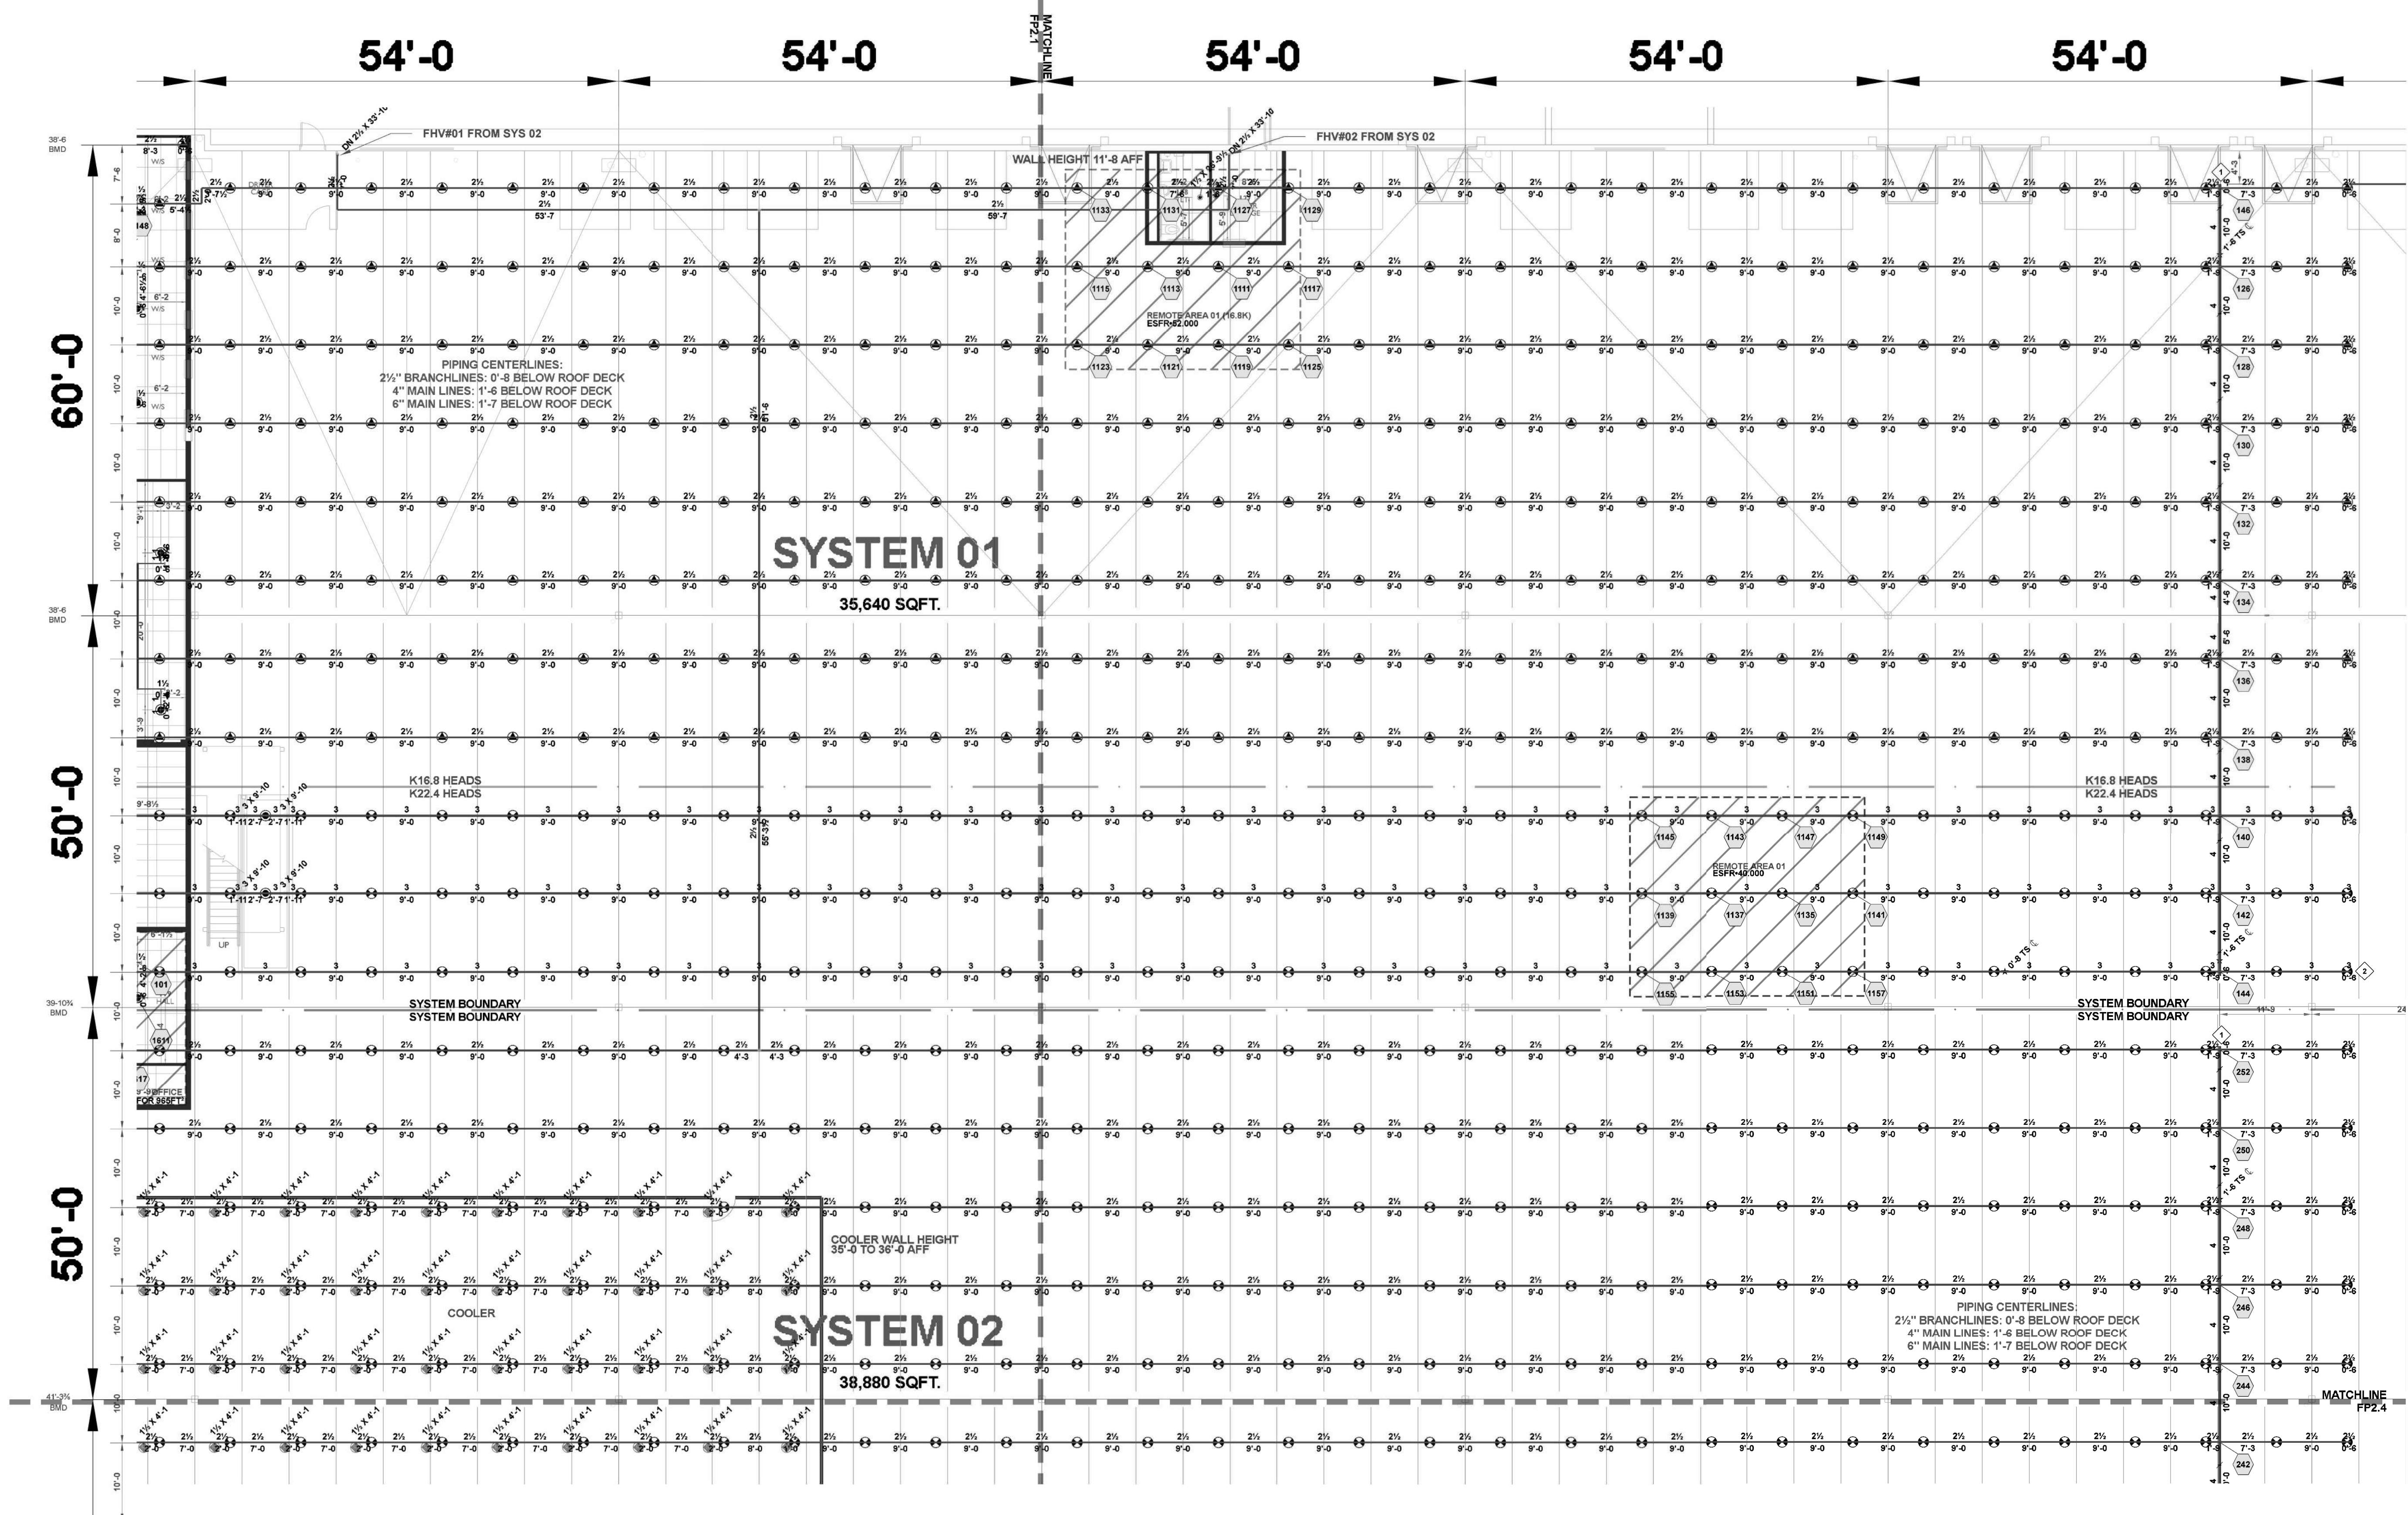


Hydraulic Information		Hydraulic Information	
Remote Area 01 (K16.8)		Remote Area 01	
OCCUPANCY CLASSIFICATION	ESFR	OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	52.000 (ESFR)	MIN. END HEAD PRESSURE	40.000 (ESFR)
TOTAL HOSE STREAMS	250.00	TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12	TOTAL HEADS FLOWING	12
K-FACTOR	16.8	K-FACTOR	22.4
TOTAL WATER REQUIRED	1711.60	TOTAL WATER REQUIRED	1959.70
TOTAL PRESSURE REQUIRED	75.095	TOTAL PRESSURE REQUIRED	68.043
BASE OF RISER (GPM)	1711.60	BASE OF RISER (GPM)	1959.70
BASE OF RISER (PSI)	75.095	BASE OF RISER (PSI)	68.043
SAFETY MARGIN (PSI)	+14.486 (16.2%)	SAFETY MARGIN (PSI)	+19.427 (22.2%)

Sprinkler Legend										
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE
▲	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	3/4"	FAST	BRASS	200°F
⊗	4	VICTAULIC	V3406	V34	8	PENDENT	3/4"	QUICK	BRASS	200°F
⊗	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1"	FAST	BRASS	200°F
⊗	48	VIKING	VK600	MICROFAST	5.6	PENDENT	1/2"	QUICK	CHROME	135°F
⊗	6	VIKING	VK3021		5.6	PENDENT	1/2"	QUICK	CHROME	135°F
⬢	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	3/4"	QUICK	BRASS	205°F
TOTAL = 5234										

AREA 1 (CONT.): SYSTEMS 01-02  
SCALE: 3/32" = 1'-0"

\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6"  
OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

⬢ - AUXILIARY DRAIN  
SEE FP2.0 FOR DETAIL  
⬢ - AIR VENT  
SEE FP2.0 FOR DETAIL

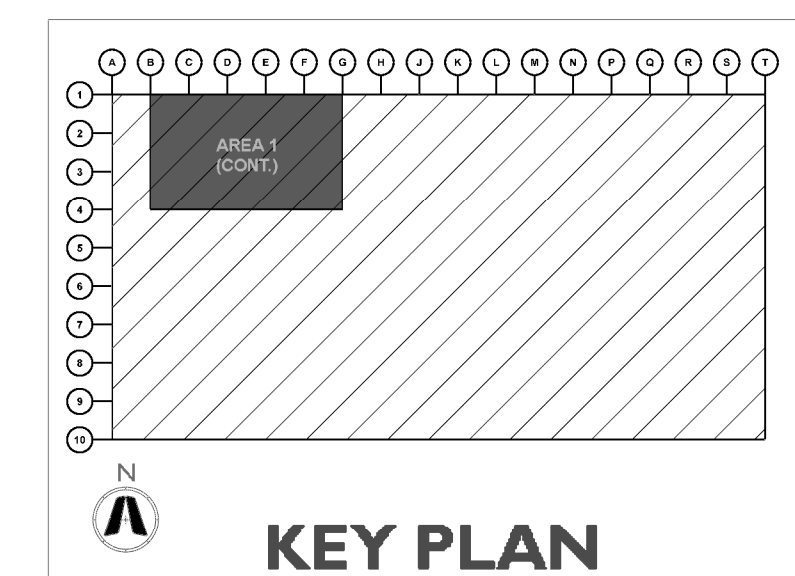



## PROJECT INFORMATION







LEE'S SUMMIT LOGISTICS  
BUILDING A LOT 1  
NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


AREA 2: SYSTEM  
02-03



Hydraulic Information	
Remote Area 03	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	40.000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	22.4
TOTAL WATER REQUIRED	1958.59
TOTAL PRESSURE REQUIRED	79.726
BASE OF RISER (GPM)	1958.59
BASE OF RISER (PSI)	79.726
SAFETY MARGIN (PSI)	+7.754 (8.9%)

SCALE: 3/32" = 1'-0"

Sprinkler Legend											
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE	NOTES
	2054	VICTAULIC	V4702	FL-QR-ST/ESFR	16.8	PENDENT	3/4"	FAST	BRASS	200°F	
	4	VICTAULIC	V3406	V34	8	PENDENT	3/4"	QUICK	BRASS	200°F	
	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1"	FAST	BRASS	200°F	
	48	VIKING	VK600	MICROFAST	5.6	PENDENT	1/2"	QUICK	CHROME	135°F	
	6	VIKING	VK3021		5.6	PENDENT	1/2"	QUICK	CHROME	135°F	
	368	VIKING	VK604	ESFR DRY	16.8	PENDENT	3/4"	QUICK	BRASS	205°F	
	TOTAL = 5234										

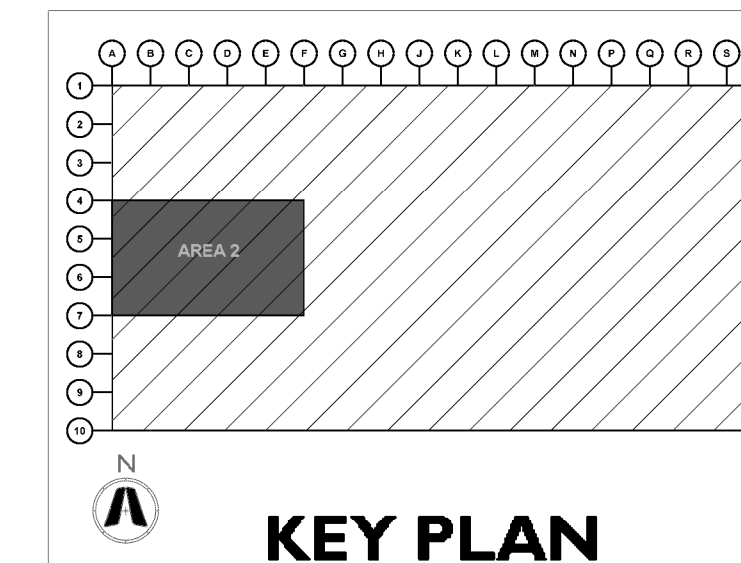





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



**SCANNELL**  
PROPERTIES

CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY OF  
CURRAN ARCHITECTURE, AND ARE NOT TO  
BE USED OR REPRODUCED, WHOLE OR IN  
PART, WITHOUT THE WRITTEN CONSENT OF  
CURRAN ARCHITECTURE.

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


ISSUE DATES

PERMIT SET 02.18.22  
TENANT IMPROVEMENT 09.07.22

210300

**FP2.2.2**

AREA 2(CONT):  
SYSTEMS 02-03

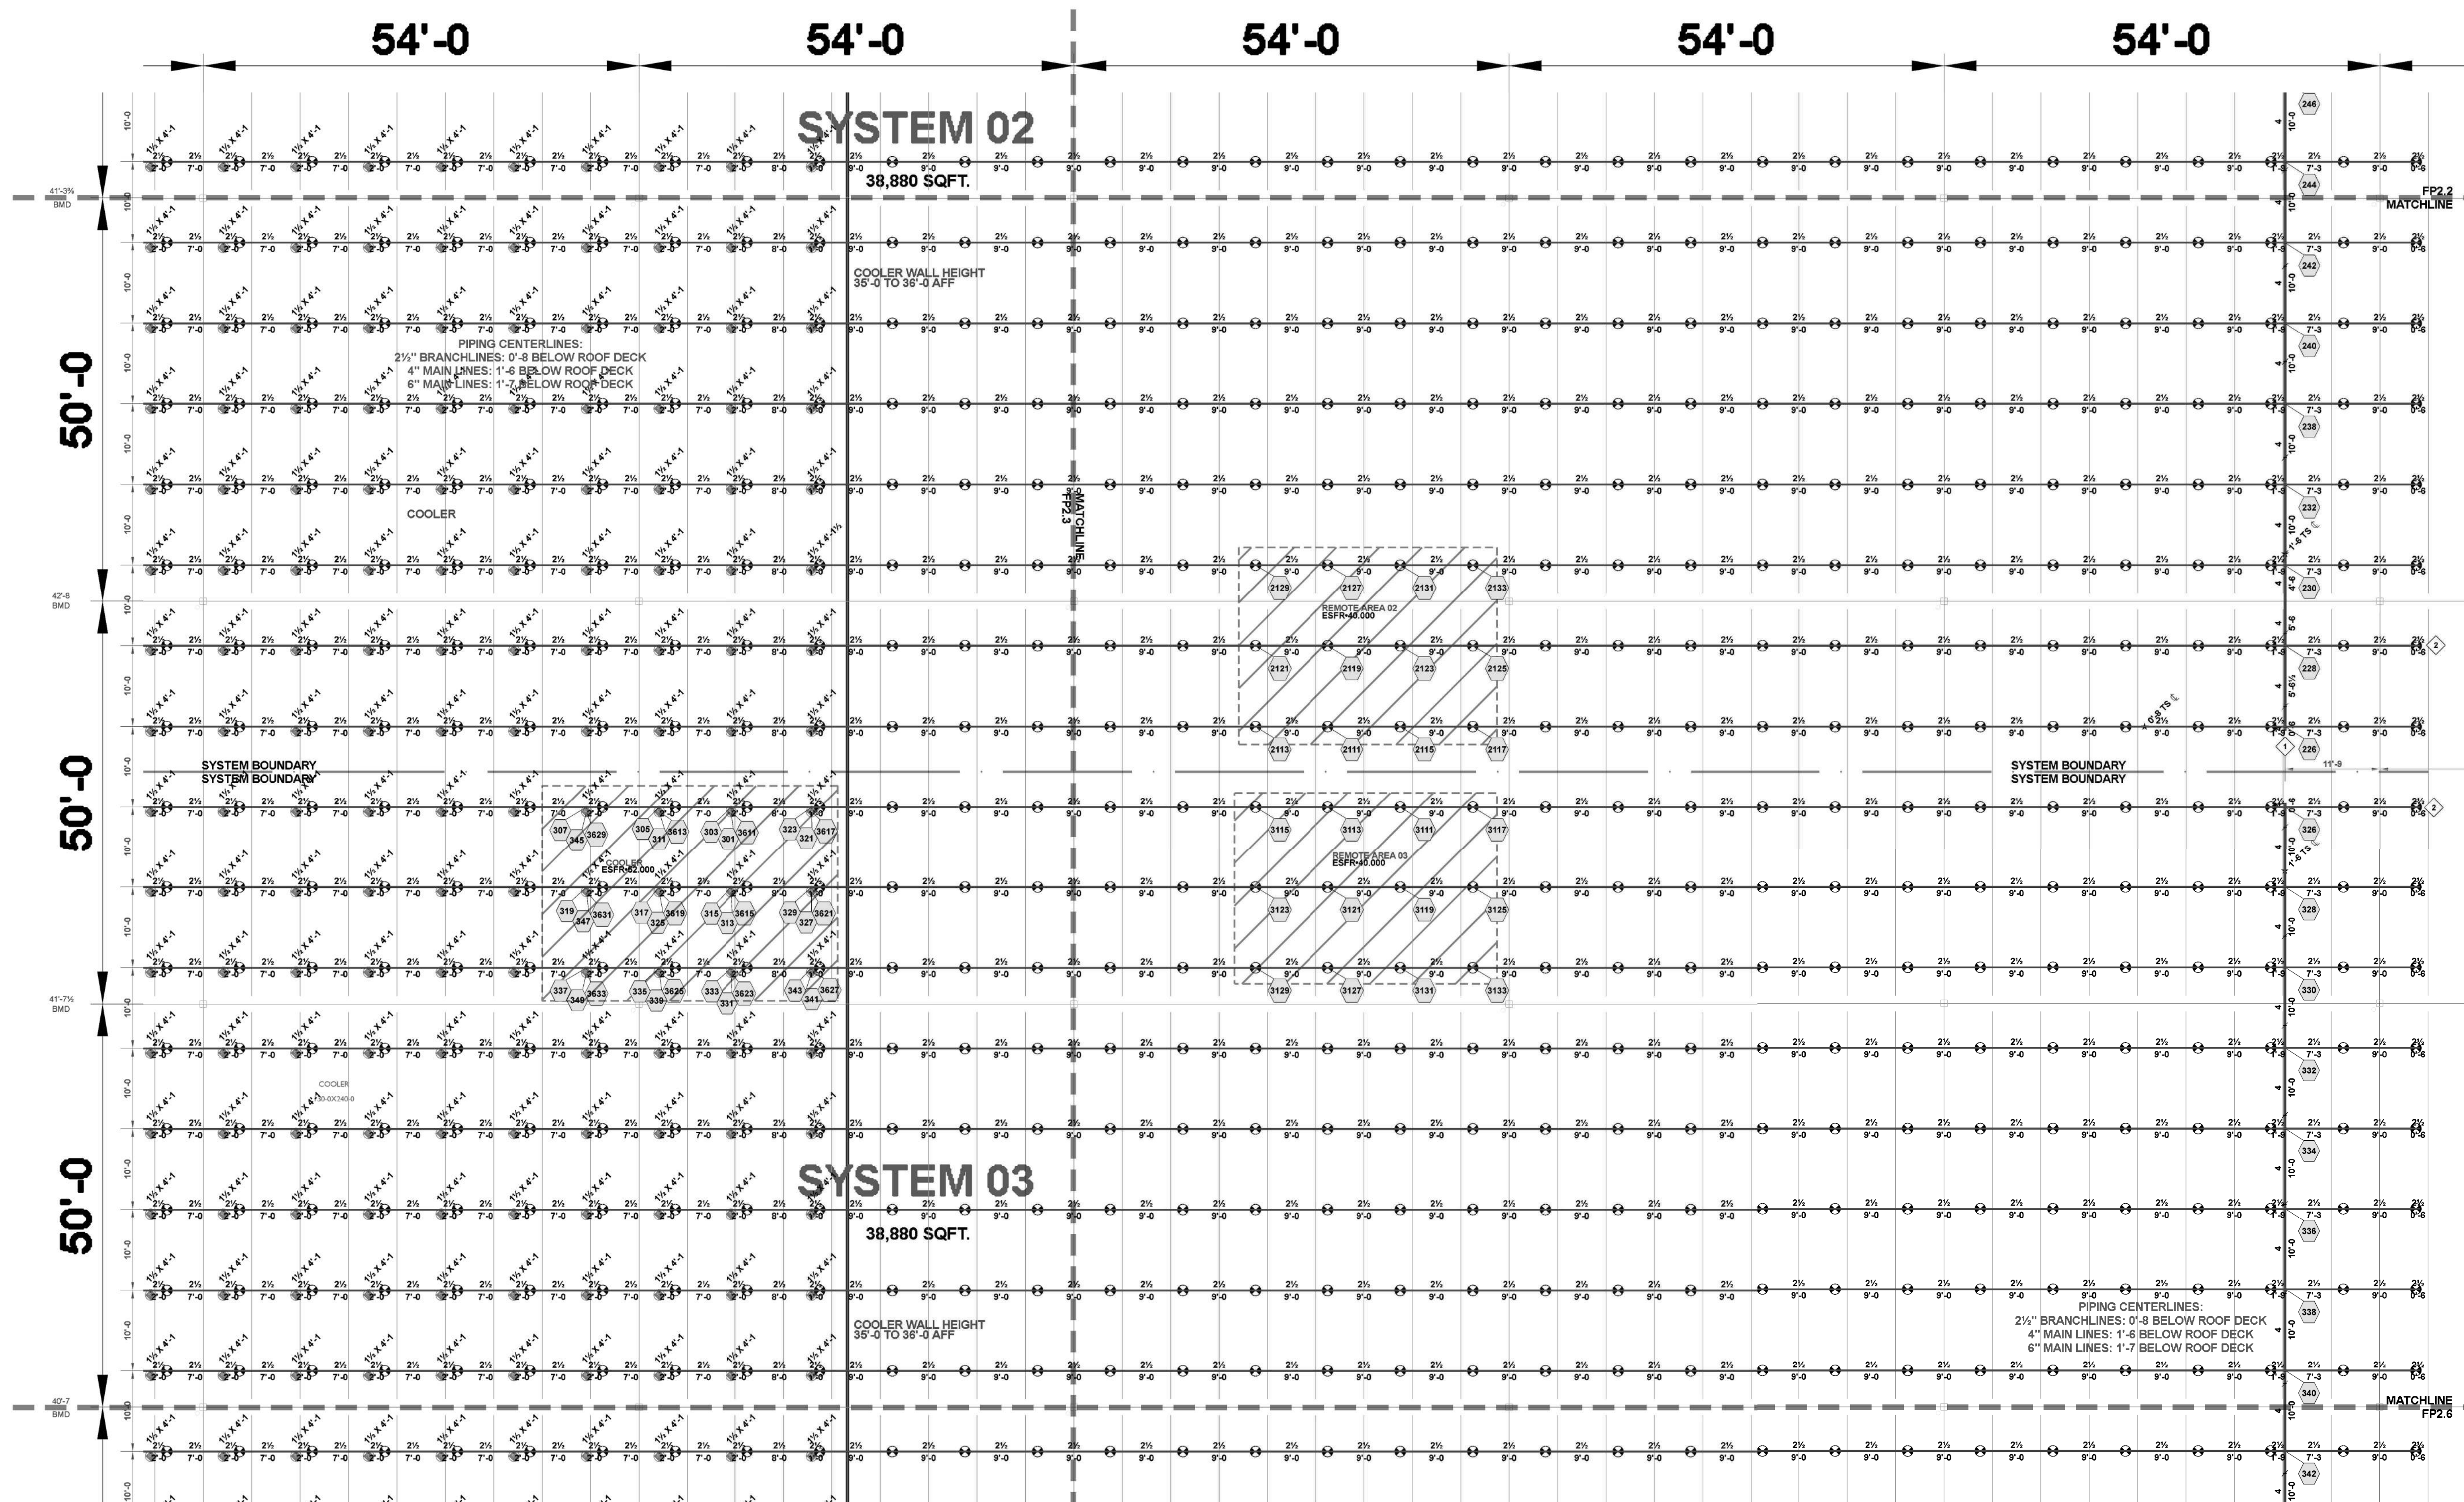


Hydraulic Information	
Remote Area 02	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	40.000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	22.4
TOTAL WATER REQUIRED	1956.70
TOTAL PRESSURE REQUIRED	78.341
BASE OF RISER (GPM)	1956.70
BASE OF RISER (PSI)	78.341
SAFETY MARGIN (PSI)	+9.156 (10.5%)

Hydraulic Information	
Remote Area 03	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	40.000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	22.4
TOTAL WATER REQUIRED	1958.59
TOTAL PRESSURE REQUIRED	79.726
BASE OF RISER (GPM)	1958.59
BASE OF RISER (PSI)	79.726
SAFETY MARGIN (PSI)	+7.754 (8.9%)

AREA 2(CONT): SYSTEMS 02-03  
SCALE: 3/32" = 1'-0"

Sprinkler Legend										
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE
	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	3/4	FAST	BRASS	200°F
	4	VICTAULIC	V3406	V34	8	PENDENT	3/4	QUICK	BRASS	200°F
	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1	FAST	BRASS	200°F
	48	VIKING	VK600	MICROFAST	5.6	PENDENT	1/2	QUICK	CHROME	135°F
	6	VIKING	VK3021	ESFR DRY	5.6	PENDENT	1/2	QUICK	CHROME	135°F
	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	3/4	QUICK	BRASS	205°F
TOTAL = 5234										

\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6"  
OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

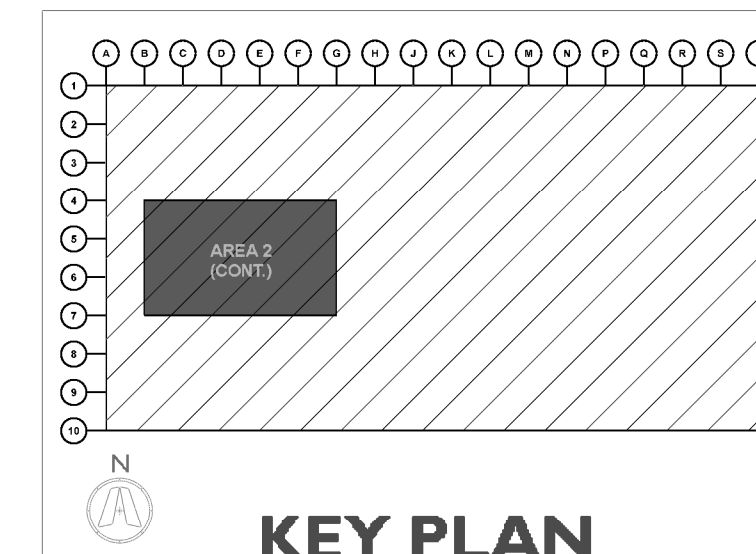





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY OF  
CURRAN ARCHITECTURE, AND ARE NOT TO  
BE USED OR REPRODUCED, WHOLE OR IN  
PART, WITHOUT THE WRITTEN CONSENT OF  
CURRAN ARCHITECTURE.

PROJECT INFORMATION


LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I  
NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES

PERMIT SET 02.18.22





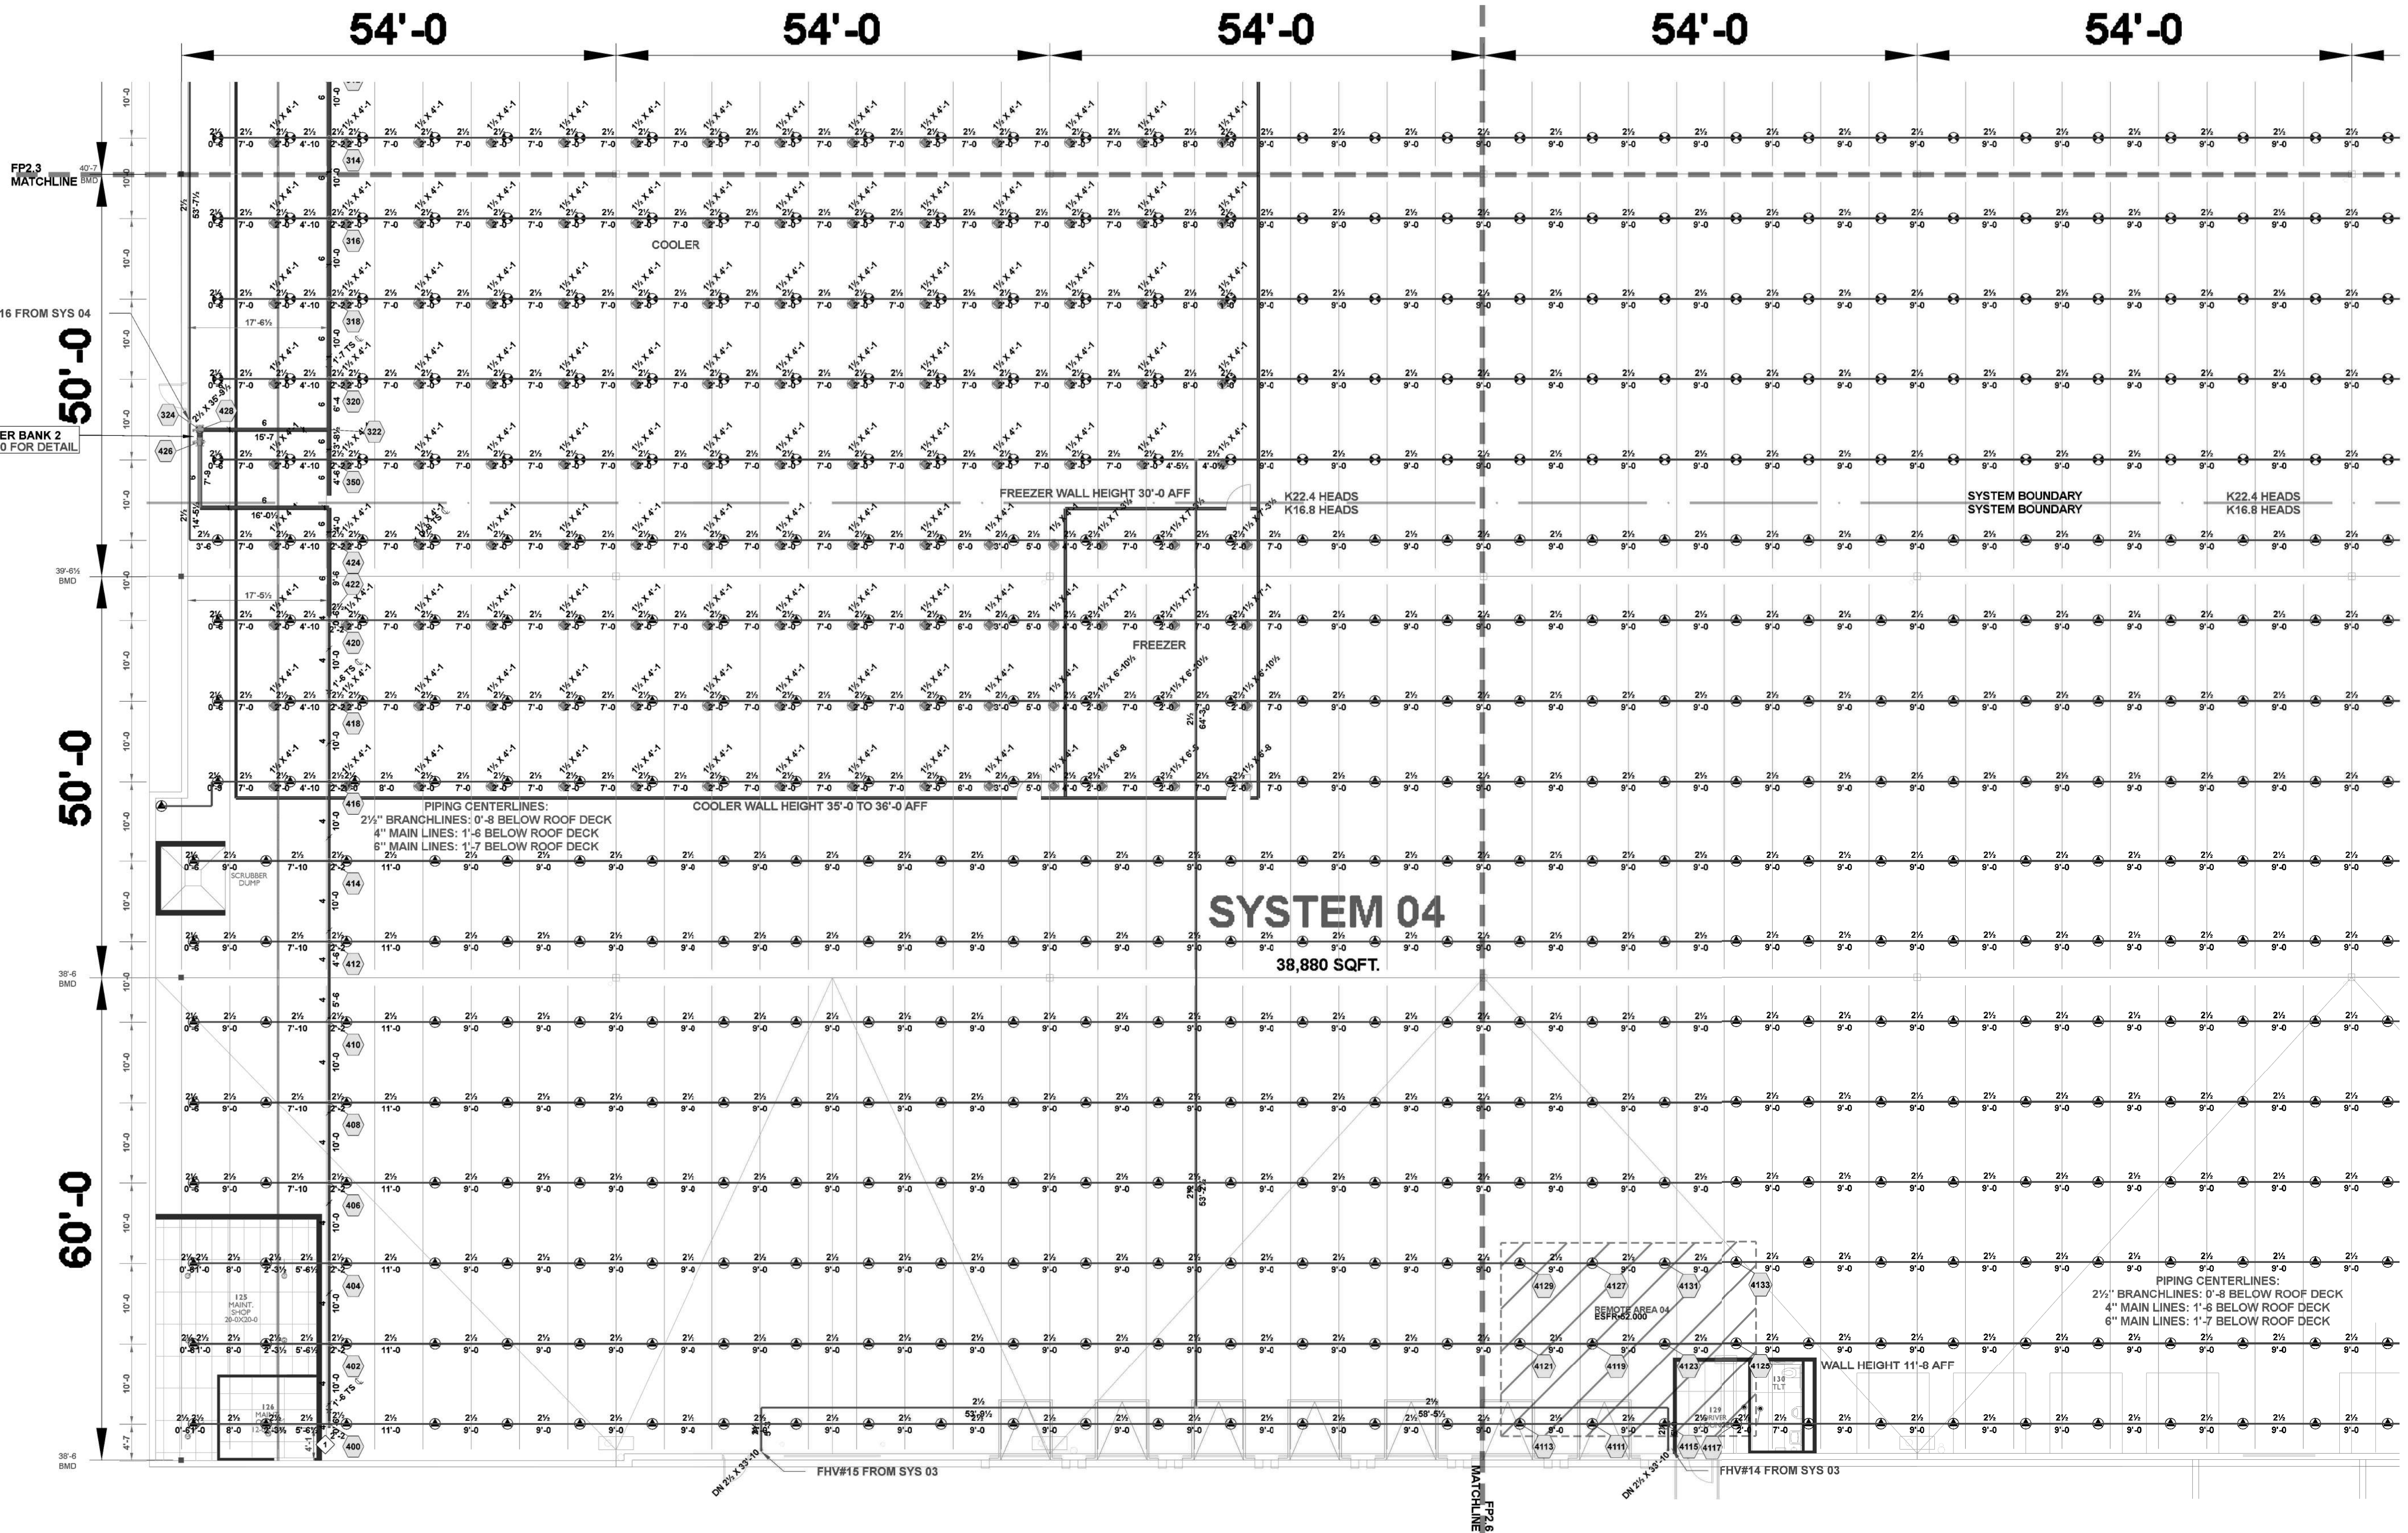

TENANT IMPROVEMENT 09.07.22


210300  
**FP2.3.1**  
AREA 3: SYSTEMS  
03-04




Hydraulic Information	
Remote Area 04	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	52,000' (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	16.8
TOTAL WATER REQUIRED	1708.55
TOTAL PRESSURE REQUIRED	80.726
BASE OF RISER (GPM)	1708.55
BASE OF RISER (PSI)	80.726
SAFETY MARGIN (PSI)	+8.879 (9.9%)

AREA 3: SYSTEMS 03-04  
SCALE: 3/32" = 1'-0"


Sprinkler Legend											
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE	NOTE
	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	3/4	FAST	BRASS	200°F	
	4	VICTAULIC	V3406	V34	8	PENDENT	3/4	QUICK	BRASS	200°F	
	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1	FAST	BRASS	200°F	
	48	VIKING	VK600	MICROFAST	5.6	PENDENT	1/2	QUICK	CHROME	135°F	
	6	VIKING	VK3021		5.6	PENDENT	1/2	QUICK	CHROME	135°F	
	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	3/4	QUICK	BRASS	205°F	
TOTAL = 5234											

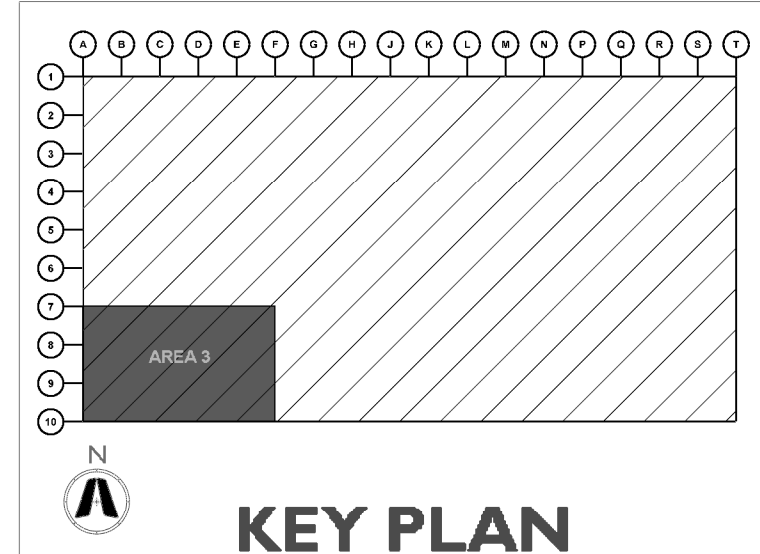



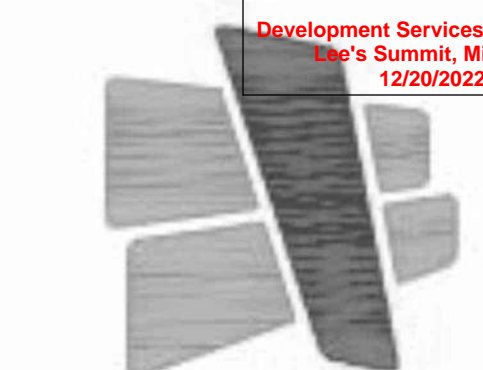

**CURRAN**  
ARCHITECTURE  
5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753

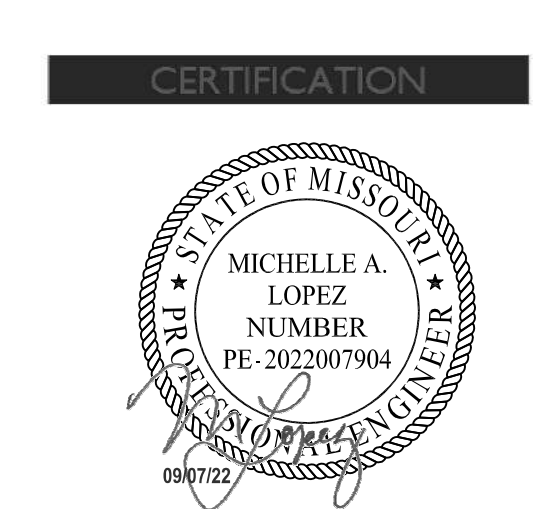

THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY OF  
CURRAN ARCHITECTURE, AND ARE NOT TO  
BE USED OR REPRODUCED, WHOLE OR IN  
PART, WITHOUT THE WRITTEN CONSENT OF  
CURRAN ARCHITECTURE.


**PROJECT INFORMATION**

**LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I**  
NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES	
PERMIT SET	02.18.22
TENANT IMPROVEMENT	09.07.22





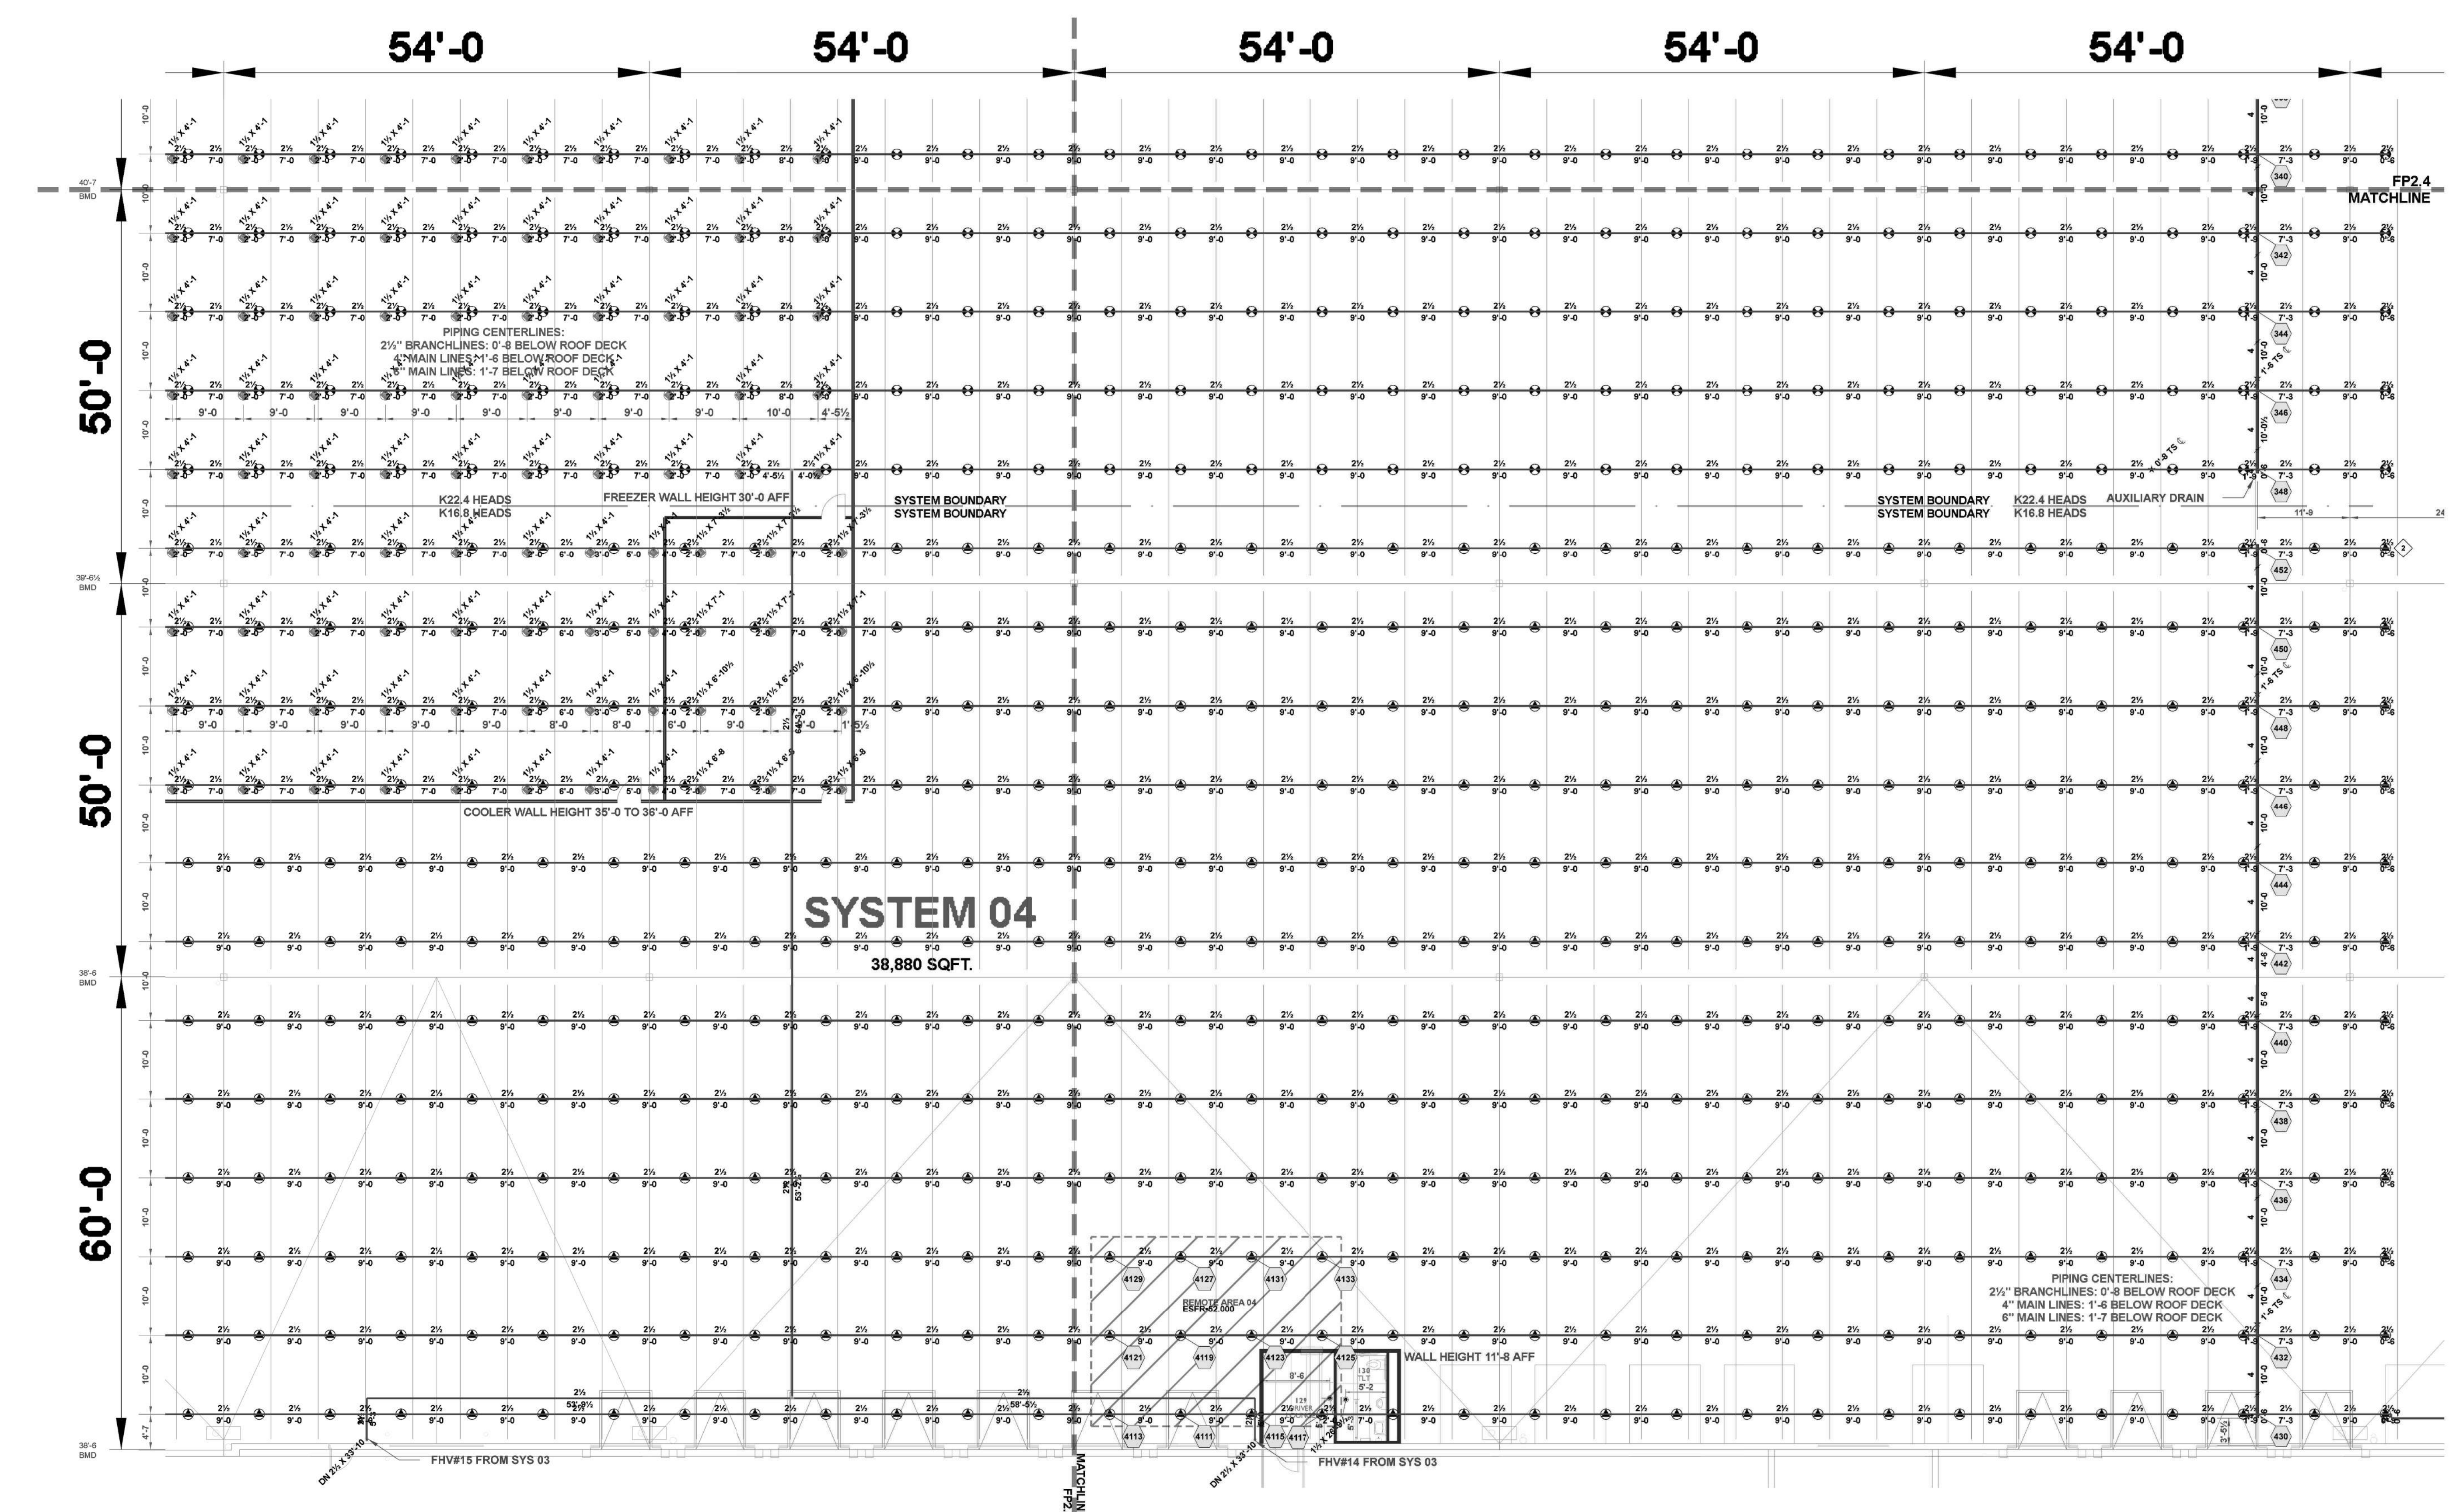

210300

**FP2.3.2**  
AREA 3(CONT.):  
SYSTEMS 03-04




Hydraulic Information	
Remote Area 04	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	52.000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	16.8
TOTAL WATER REQUIRED	1708.55
TOTAL PRESSURE REQUIRED	80.726
BASE OF RISER (GPM)	1708.55
BASE OF RISER (PSI)	80.726
SAFETY MARGIN (PSI)	+8.879 (9.9%)

**AREA 3(CONT.): SYSTEMS 03-04**  
SCALE: 3/32" = 1'-0"

Sprinkler Legend											
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE	NOTE
	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	¾	FAST	BRASS	200°F	
	4	VICTAULIC	V3406	V34	8	PENDENT	¾	QUICK	BRASS	200°F	
	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1	FAST	BRASS	200°F	
	48	VIKING	VK600	MICROFAST	5.6	PENDENT	½	QUICK	CHROME	135°F	
	6	VIKING	VK3021		5.6	PENDENT	½	QUICK	CHROME	135°F	
	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	¾	QUICK	BRASS	205°F	
TOTAL = 5234											

\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6" OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

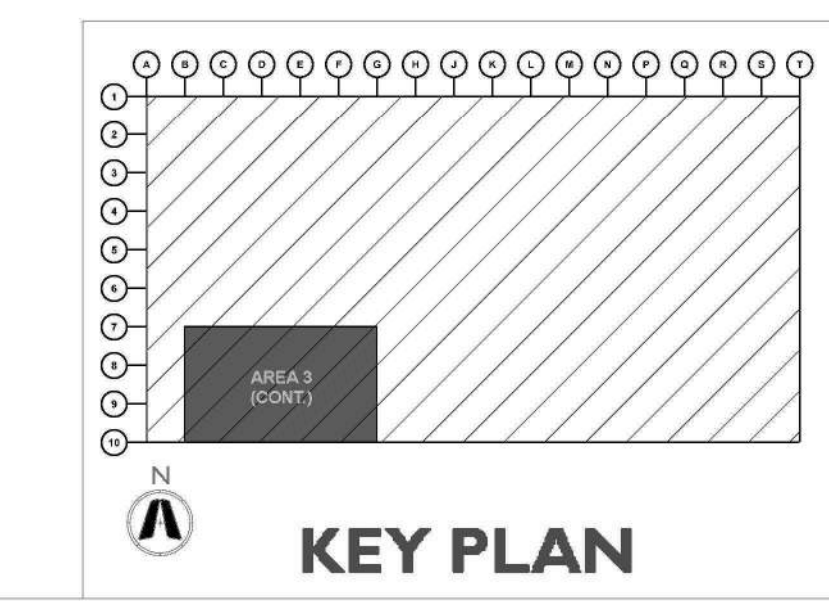





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



**SCANNELL**  
PROPERTIES

CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY OF  
CURRAN ARCHITECTURE, AND ARE NOT TO  
BE USED OR REPRODUCED, WHOLE OR IN  
PART, WITHOUT THE WRITTEN CONSENT OF  
CURRAN ARCHITECTURE.

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


ISSUE DATES

PERMIT SET 02.18.22  
TENANT IMPROVEMENT 09.07.22

210300

**FP2.4**

AREA 4: SYSTEM 05

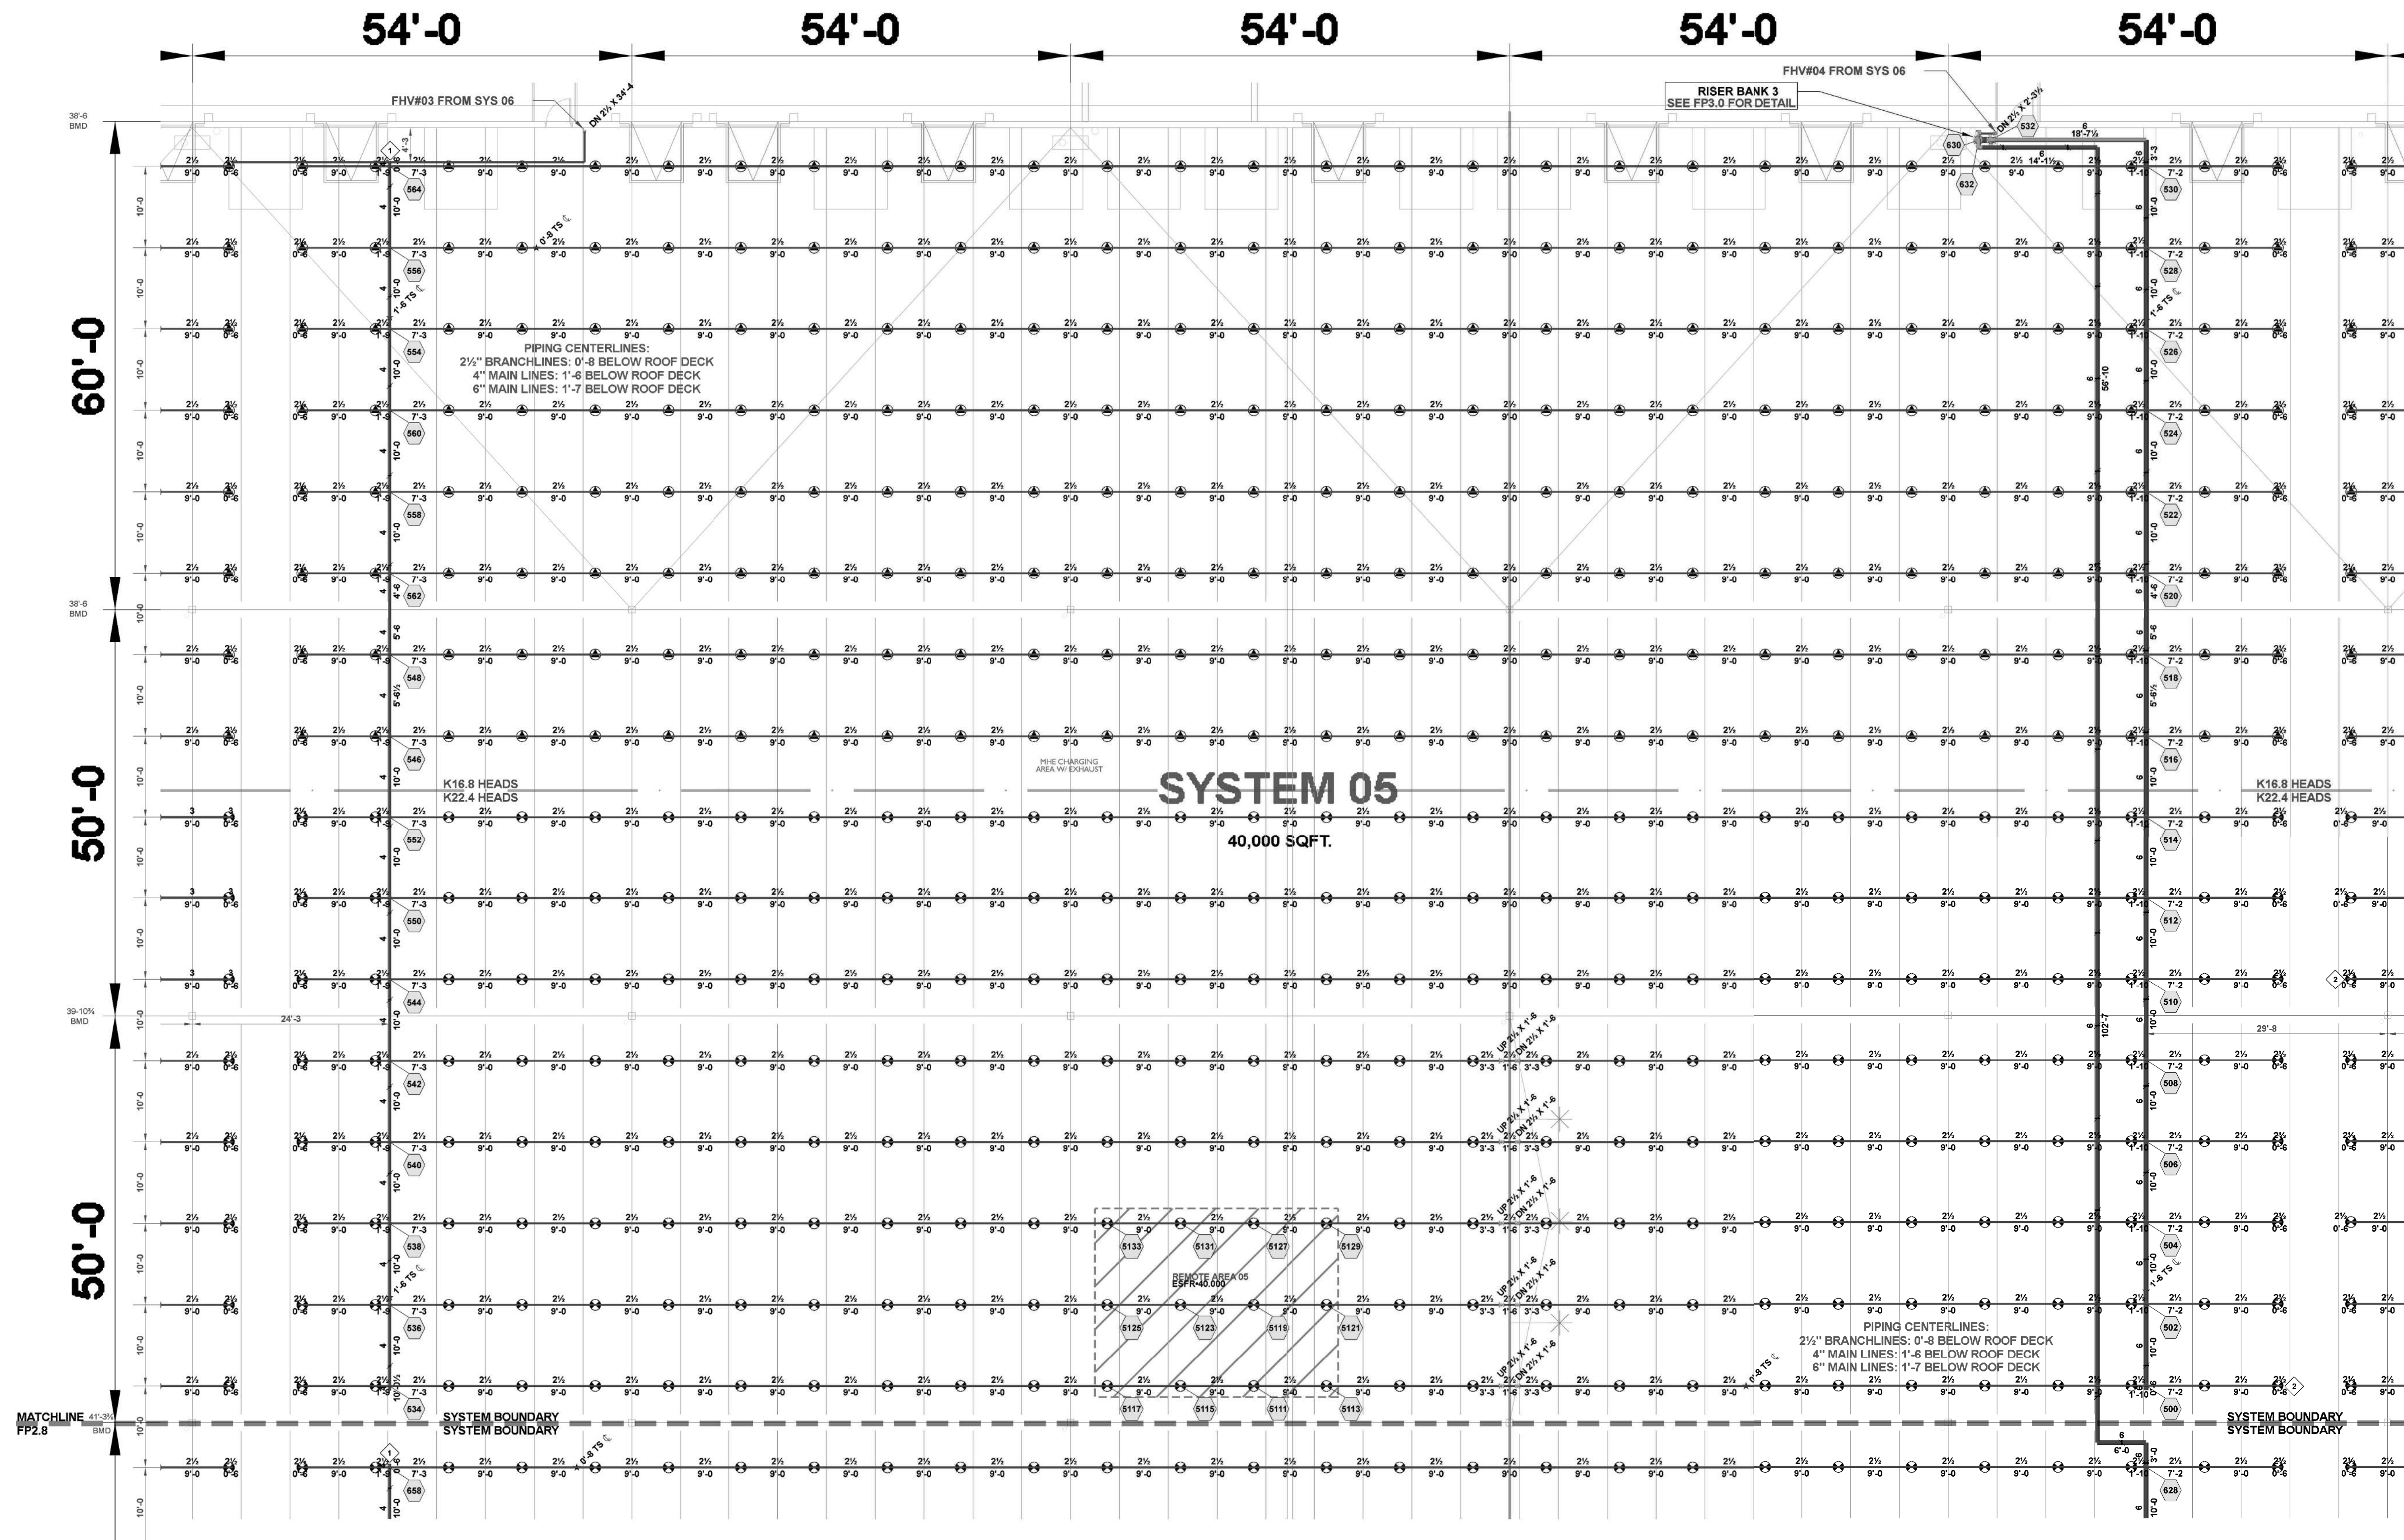


Hydraulic Information	
Remote Area 05	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	40.000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	22.4
TOTAL WATER REQUIRED	1959.12
TOTAL PRESSURE REQUIRED	73.843
BASE OF RISER (GPM)	1959.12
BASE OF RISER (PSI)	73.843
SAFETY MARGIN (PSI)	+13.633 (15.6%)

AREA 4: SYSTEM 05  
SCALE: 3/32" = 1'-0"

Sprinkler Legend										
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE
⬆	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	3/4	FAST	BRASS	200°F
⊗	4	VICTAULIC	V3406	V34	8	PENDENT	3/4	QUICK	BRASS	200°F
⊗	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1	FAST	BRASS	200°F
⊗	48	VIKING	VK600	MICROFAST	5.6	PENDENT	1/2	QUICK	CHROME	135°F
⊗	6	VIKING	VK3021		5.6	PENDENT	1/2	QUICK	CHROME	135°F
⬆	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	3/4	QUICK	BRASS	205°F
TOTAL = 5234										

\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6"  
OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

⬆ - AUXILIARY DRAIN  
SEE FP0.0 FOR DETAIL  
⬆ - AIR VENT  
SEE FP0.0 FOR DETAIL

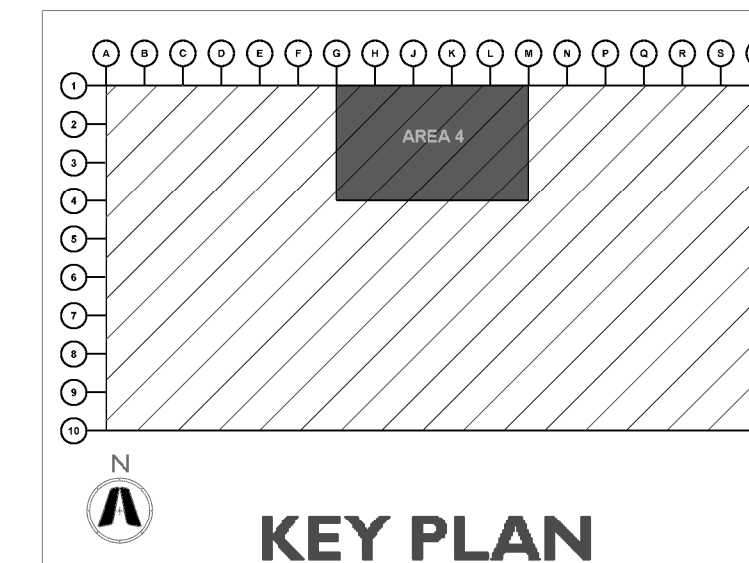



5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



SCANNELL  
PROPERTIES

## CERTIFICATION




## PROJECT INFORMATION

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


ISSUE DATES	
PERMIT SET	02.18.22
TENANT IMPROVEMENT	09.07.22

## FP2.5

AREA 5: SYSTEM 06

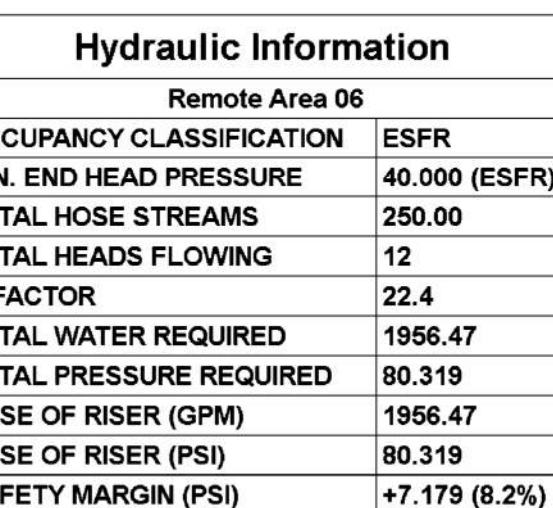


SCALE: 3/32" = 1'-0"



Sprinkler Legend											
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE	NOTES
	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	3/4"	FAST	BRASS	200°F	
	4	VICTAULIC	V3406	V34	8	PENDENT	3/4"	QUICK	BRASS	200°F	
	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1"	FAST	BRASS	200°F	
	48	VIKING	VK6001	MICROFAST	5.6	PENDENT	1/2"	QUICK	CHROME	135°F	
	6	VIKING	VK3021		5.6	PENDENT	1/2"	QUICK	CHROME	135°F	
	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	3/4"	QUICK	BRASS	205°F	
	TOTAL = 5234										

**\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6" OF ANY SURROUNDING ESRF BRANCH LINE CENTERLINE**

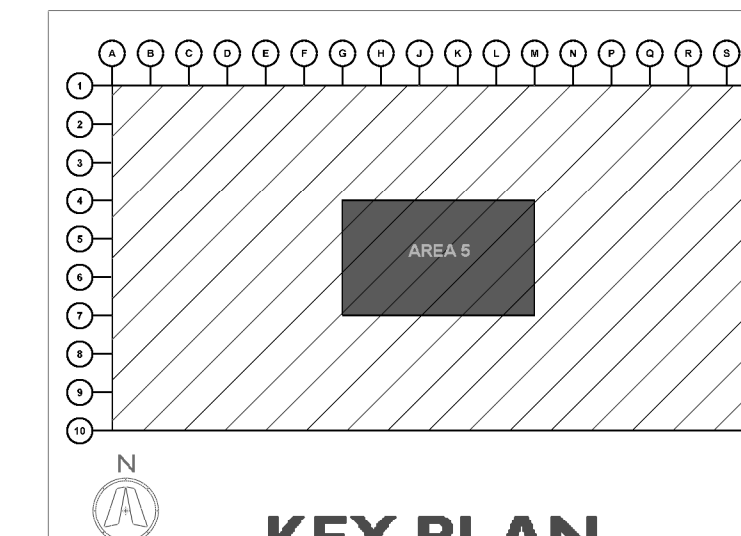





THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY OF  
CURRAN ARCHITECTURE, AND ARE NOT TO  
BE USED OR REPRODUCED, WHOLE OR IN  
PART, WITHOUT THE WRITTEN CONSENT OF  
CURRAN ARCHITECTURE.

## PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I  
NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


## ISSUE DATES

PERMIT SET	02.18.22
TENANT IMPROVEMENT	09.07.22

210300





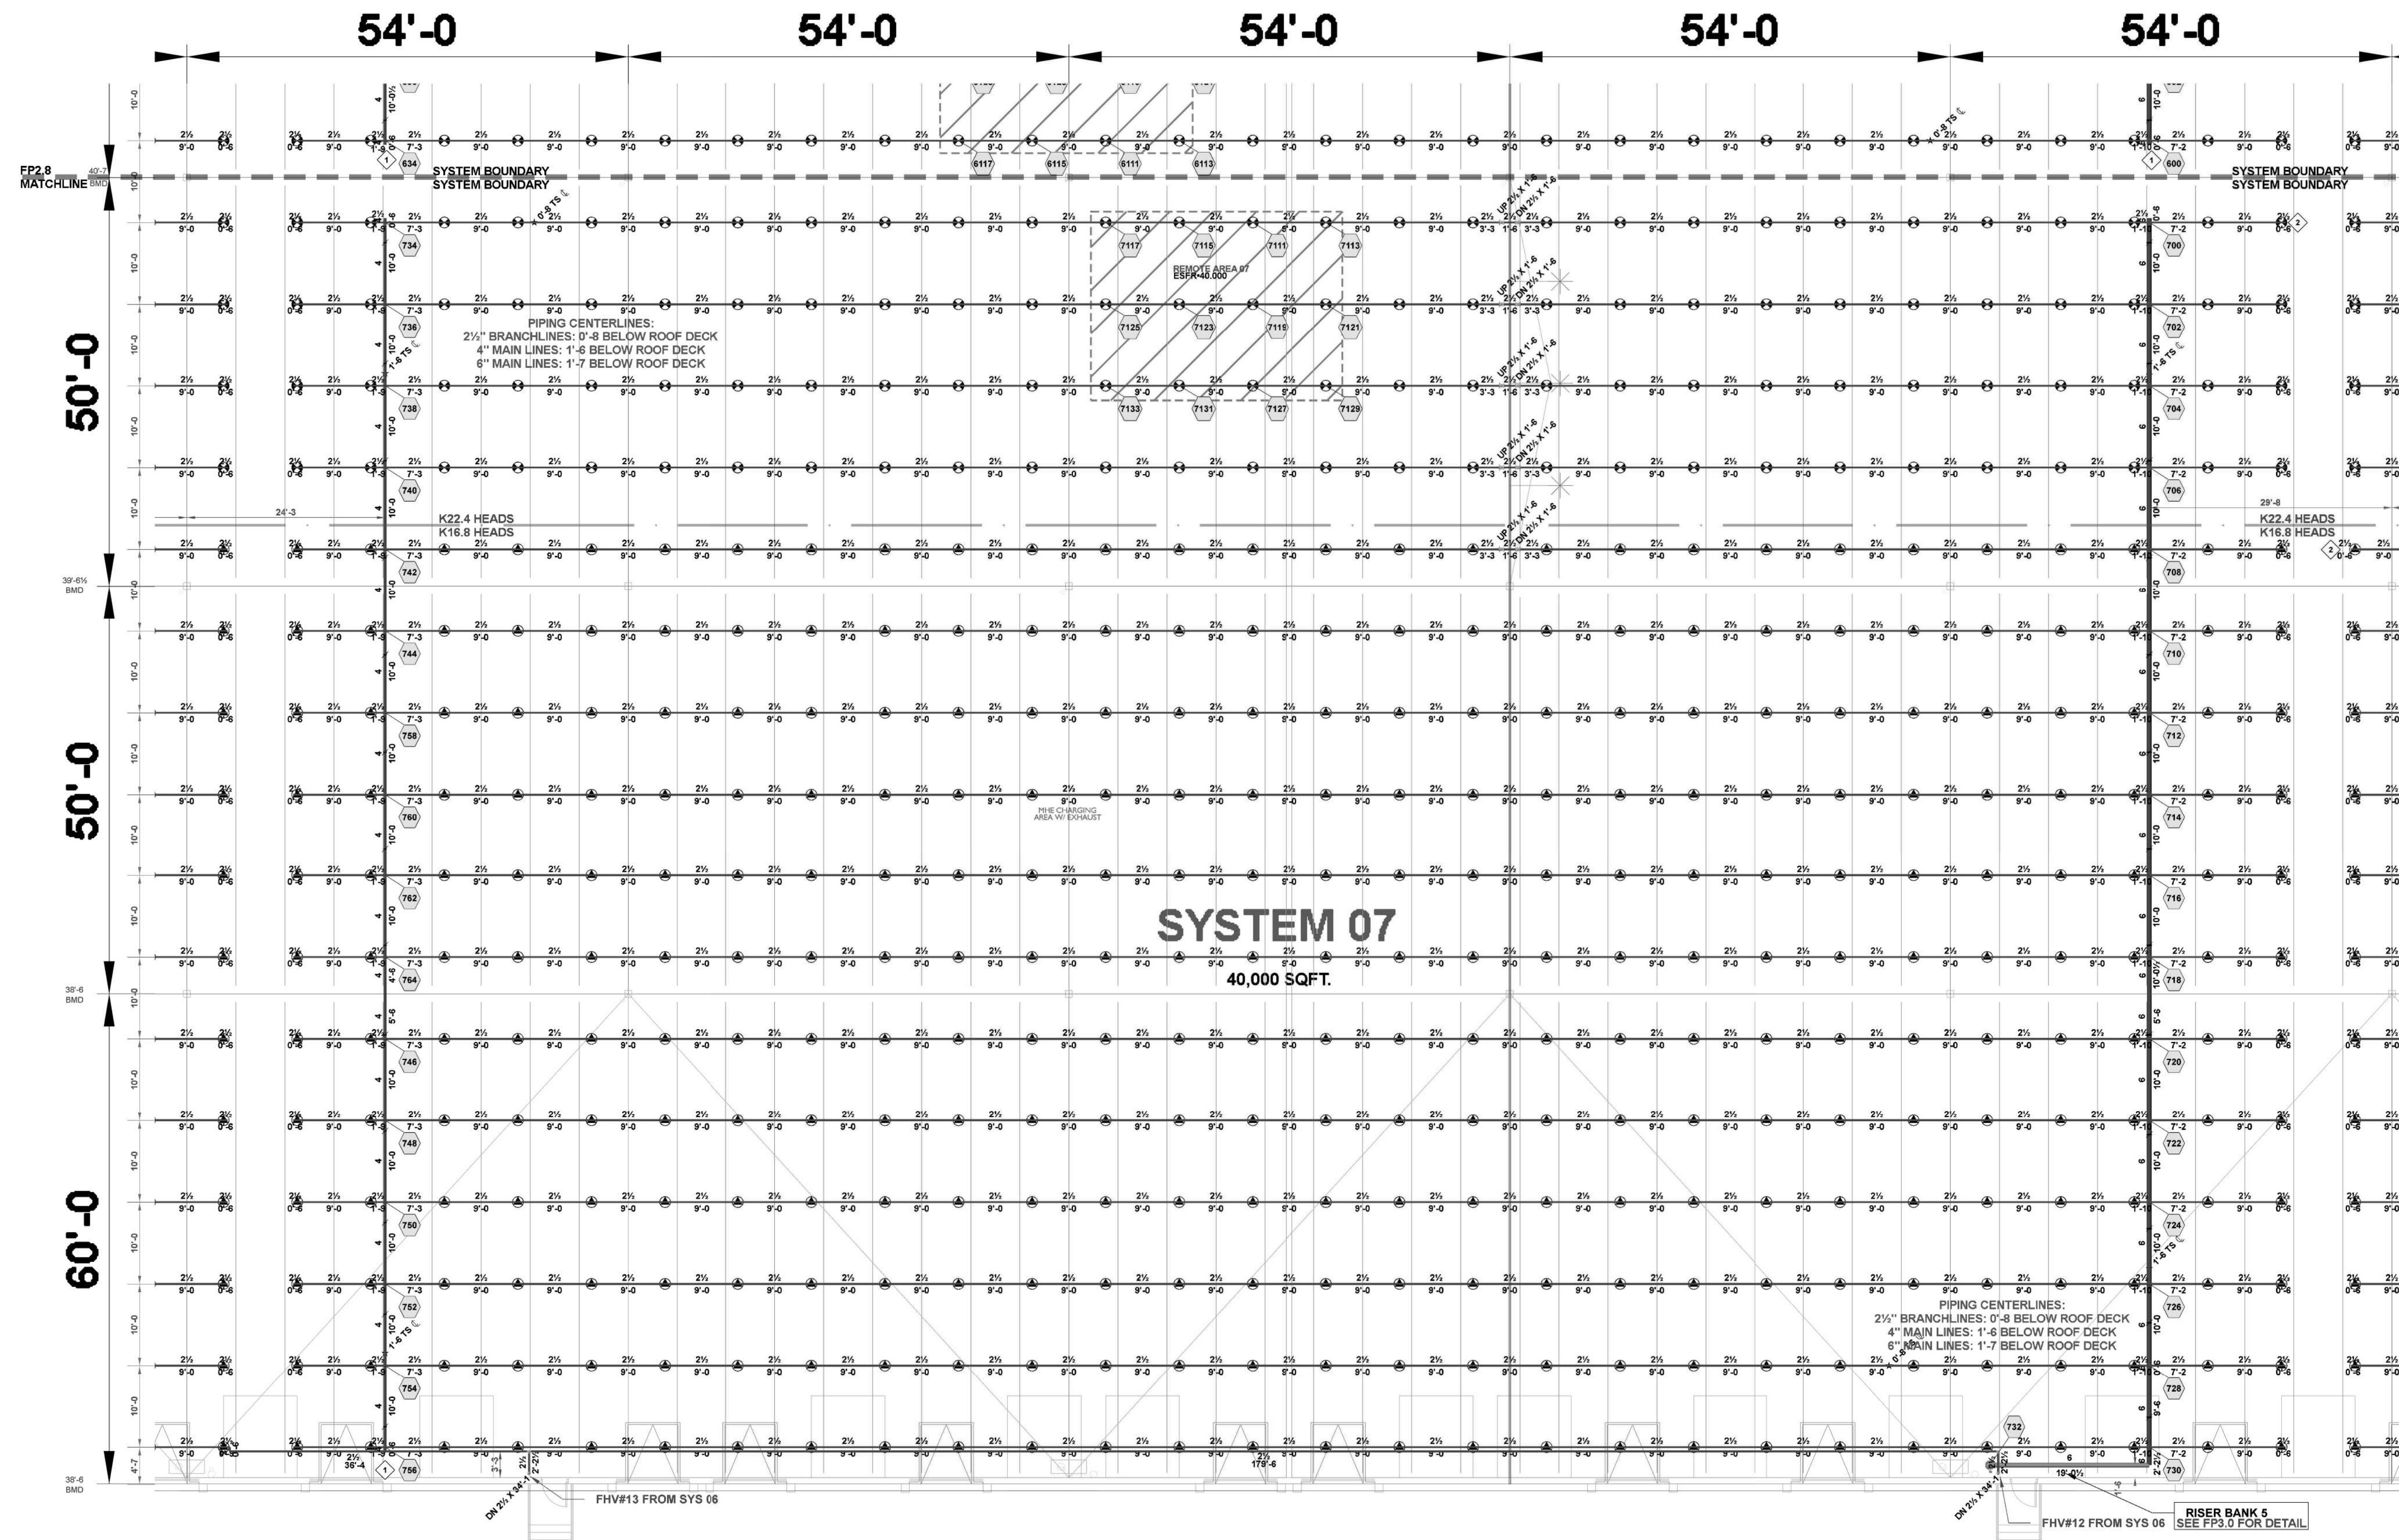

## FP2.6

AREA 6: SYSTEM 07




Hydraulic Information	
Remote Area 07	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	40.000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	22.4
TOTAL WATER REQUIRED	1958.72
TOTAL PRESSURE REQUIRED	74.363
BASE OF RISER (GPM)	1958.72
BASE OF RISER (PSI)	74.363
SAFETY MARGIN (PSI)	+13.116 (15.0%)

**AREA 6: SYSTEM 07**  
**SCALE: 3/32" = 1'-0"**

Sprinkler Legend											
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE	NOTES
	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	3/4"	FAST	BRASS	200°F	
	4	VICTAULIC	V3406	V34	8	PENDENT	3/4"	QUICK	BRASS	200°F	
	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1"	FAST	BRASS	200°F	
	48	VIKING	VK6001	MICROFAST	5.6	PENDENT	1/2"	QUICK	CHROME	135°F	
	6	VIKING	VK3021		5.6	PENDENT	1/2"	QUICK	CHROME	135°F	
	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	3/4"	QUICK	BRASS	205°F	
	TOTAL = 5234										

**\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1  
OF ANY SURROUNDING ESRF BRANCH LINE CENTERLINE**

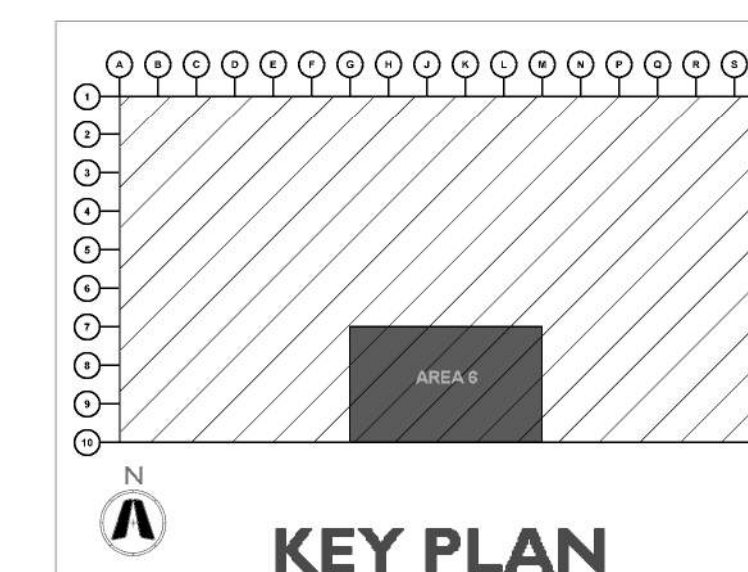





**CURRAN**  
ARCHITECTURE  
5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



**SCANNELL**  
PROPERTIES

CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY OF  
CURRAN ARCHITECTURE, AND ARE NOT TO  
BE USED OR REPRODUCED, WHOLE OR IN  
PART, WITHOUT THE WRITTEN CONSENT OF  
CURRAN ARCHITECTURE.

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I  
NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


ISSUE DATES

PERMIT SET 02.18.22  
TENANT IMPROVEMENT 09.07.22

210300





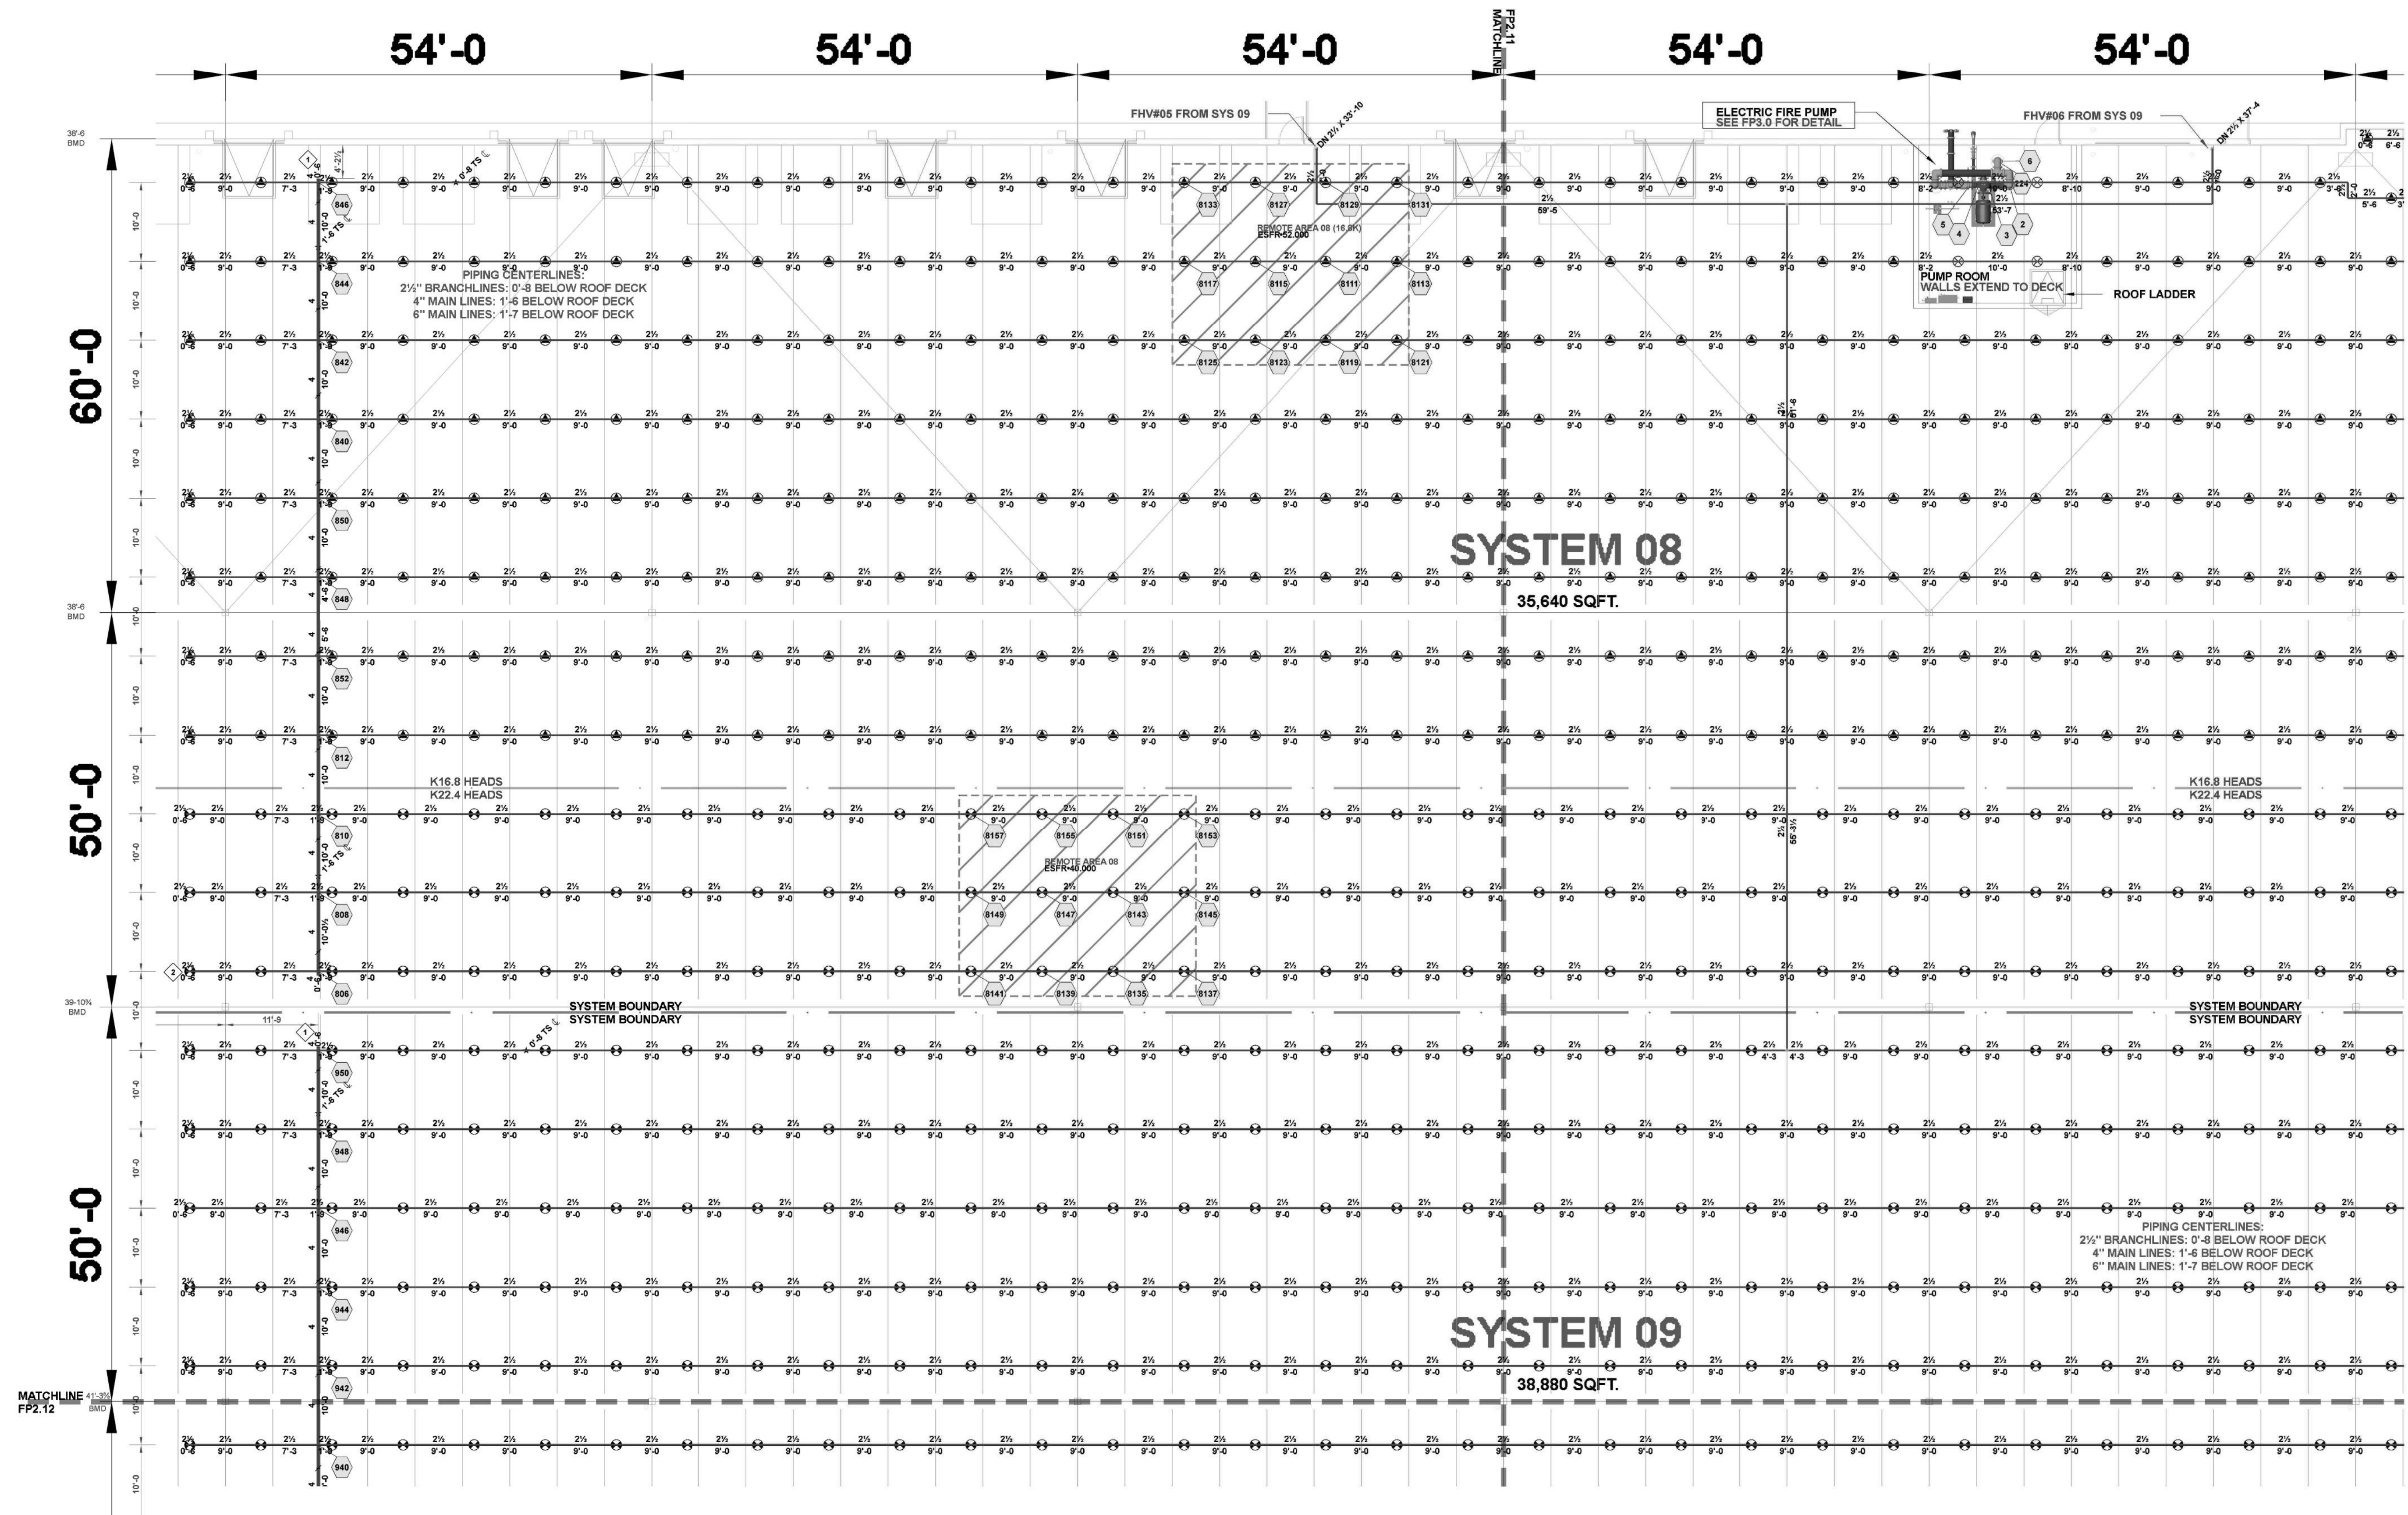

**FP2.7.1**

AREA 7: SYSTEMS  
08-09




Hydraulic Information		Hydraulic Information	
Remote Area 08 (K16.8)		Remote Area 08	
OCCUPANCY CLASSIFICATION	ESFR	OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	52,000 (ESFR)	MIN. END HEAD PRESSURE	40,000 (ESFR)
TOTAL HOSE STREAMS	250.00	TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12	TOTAL HEADS FLOWING	12
K-FACTOR	16.8	K-FACTOR	22.4
TOTAL WATER REQUIRED	1711.62	TOTAL WATER REQUIRED	1956.90
TOTAL PRESSURE REQUIRED	73.476	TOTAL PRESSURE REQUIRED	81.616
BASE OF RISER (GPM)	1711.62	BASE OF RISER (GPM)	1956.80
BASE OF RISER (PSI)	73.476	BASE OF RISER (PSI)	81.616
SAFETY MARGIN (PSI)	+16.104 (18.0%)	SAFETY MARGIN (PSI)	+5.880 (6.7%)

AREA 7: SYSTEMS 08-09  
SCALE: 3/32" = 1'-0"


Sprinkler Legend											
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE	NOTE
	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	¾	FAST	BRASS	200°F	
	4	VICTAULIC	V3406	V34	8	PENDENT	¾	QUICK	BRASS	200°F	
	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1	FAST	BRASS	200°F	
	48	VIKING	VK600	MICROFAST	5.6	PENDENT	½	QUICK	CHROME	135°F	
	6	VIKING	VK3021		5.6	PENDENT	½	QUICK	CHROME	135°F	
	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	¾	QUICK	BRASS	205°F	
TOTAL = 5234											

\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6"  
OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE


⬮ AUXILIARY DRAIN  
SEE FP0.0 FOR DETAIL  
⬮ AIR VENT  
SEE FP0.0 FOR DETAIL

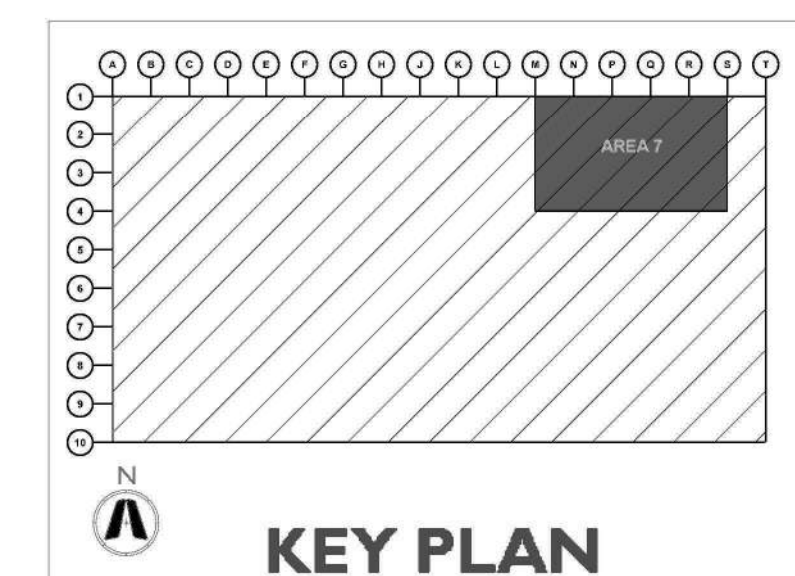



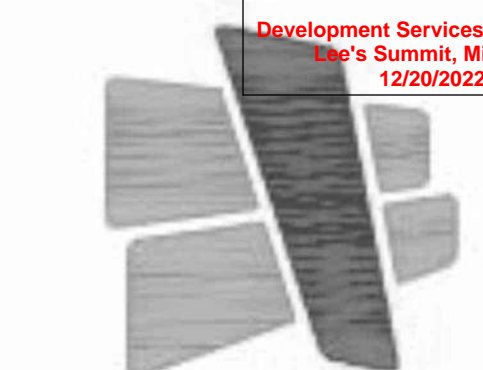

**CURRAN**  
ARCHITECTURE  
5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753

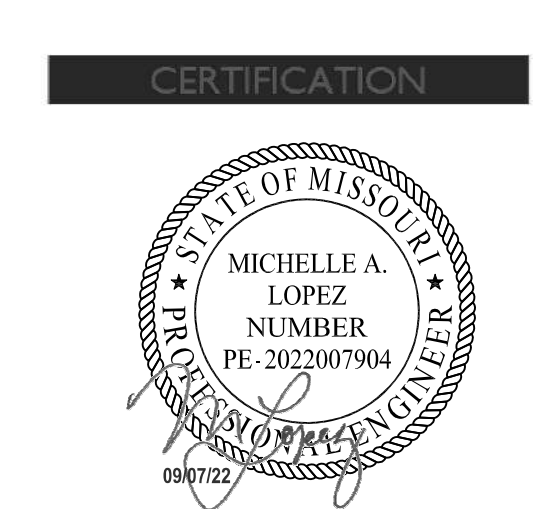


THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY OF  
CURRAN ARCHITECTURE, AND ARE NOT TO  
BE USED OR REPRODUCED, WHOLE OR IN  
PART, WITHOUT THE WRITTEN CONSENT OF  
CURRAN ARCHITECTURE.

**PROJECT INFORMATION**  
  
LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I  
  
NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES	
PERMIT SET	02.18.22
TENANT IMPROVEMENT	09.07.22


210300  
  
**FP2.7.2**  
AREA 7(CONT):  
SYSTEMS 08-09

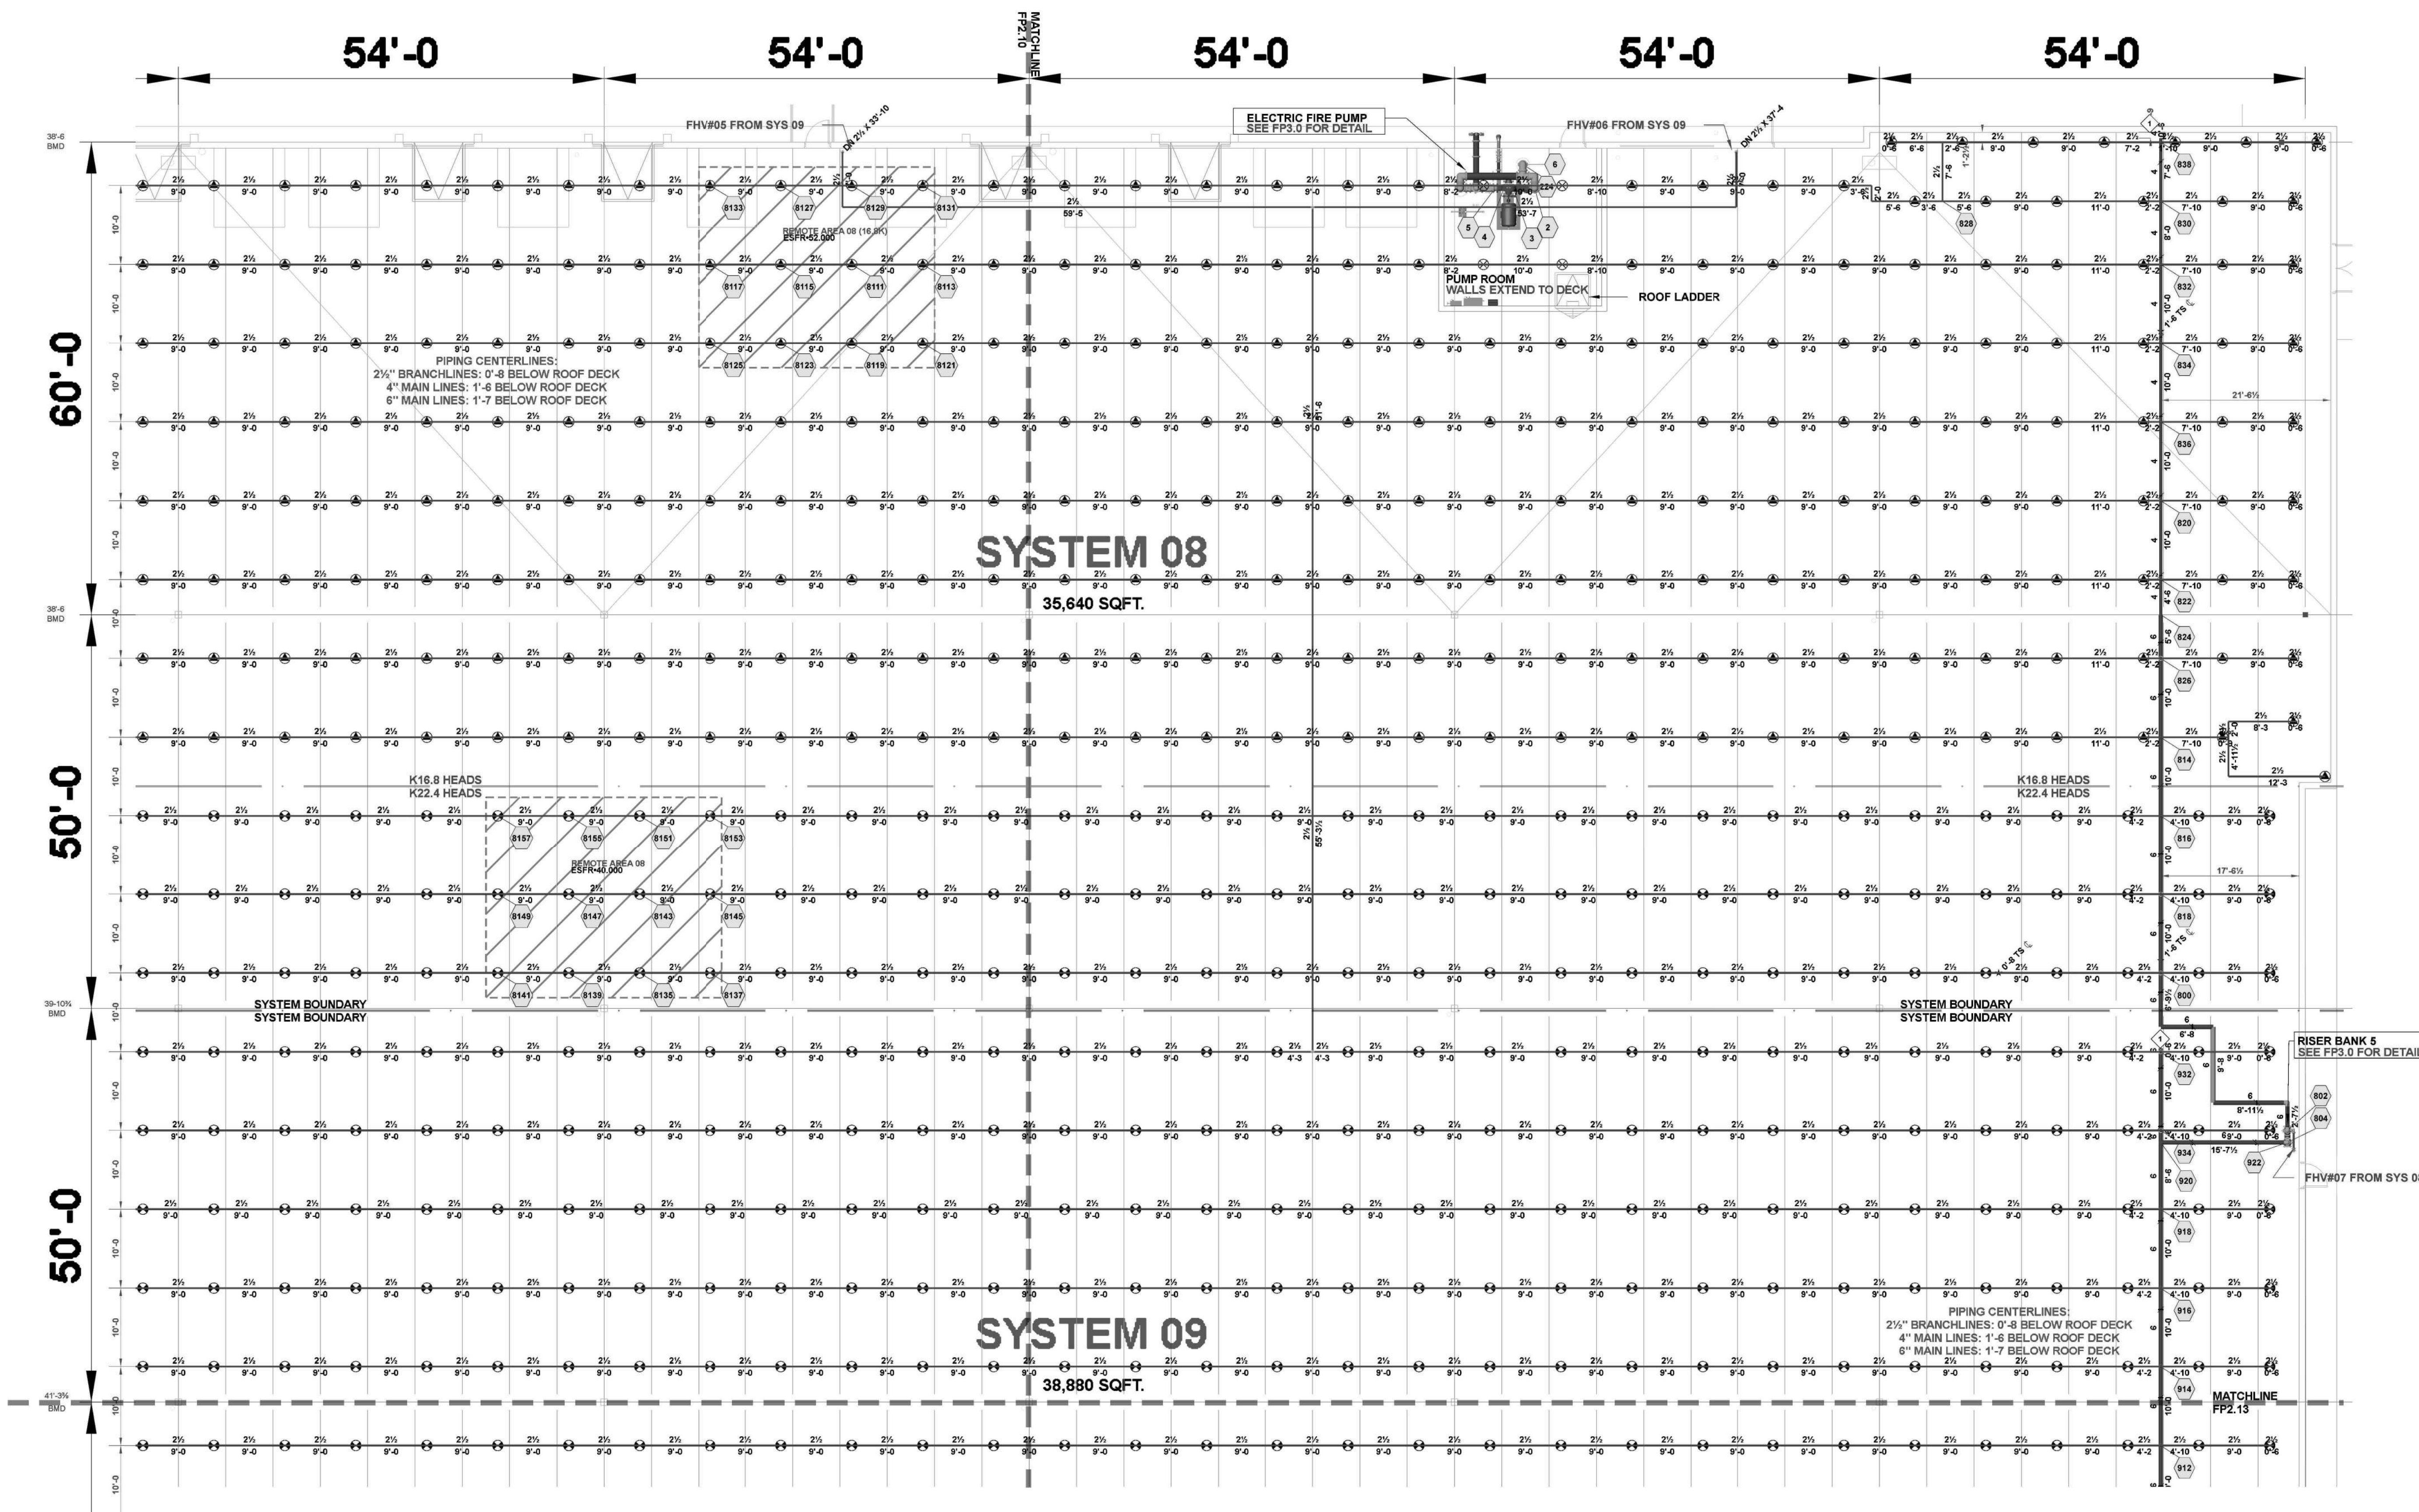


Hydraulic Information		Hydraulic Information	
Remote Area 08 (K16.8)		Remote Area 09	
OCCUPANCY CLASSIFICATION	ESFR	OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	52.000 (ESFR)	MIN. END HEAD PRESSURE	40.000 (ESFR)
TOTAL HOSE STREAMS	250.00	TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12	TOTAL HEADS FLOWING	12
K-FACTOR	16.8	K-FACTOR	22.4
TOTAL WATER REQUIRED	1711.62	TOTAL WATER REQUIRED	1956.80
TOTAL PRESSURE REQUIRED	73.476	TOTAL PRESSURE REQUIRED	81.616
BASE OF RISER (GPM)	1711.62	BASE OF RISER (GPM)	1956.80
BASE OF RISER (PSI)	73.476	BASE OF RISER (PSI)	81.616
SAFETY MARGIN (PSI)	+16.104 (18.0%)	SAFETY MARGIN (PSI)	+5.880 (6.7%)

Sprinkler Legend										
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE
▲	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	3/4"	FAST	BRASS	200°F
⊗	4	VICTAULIC	V3406	V34	8	PENDENT	3/4"	QUICK	BRASS	200°F
⊙	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1"	FAST	BRASS	200°F
●	48	VIKING	VK600	MICROFAST	5.6	PENDENT	1/2"	QUICK	CHROME	135°F
⦿	6	VIKING	VK3021		5.6	PENDENT	1/2"	QUICK	CHROME	135°F
◆	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	3/4"	QUICK	BRASS	205°F
TOTAL = 5234										


\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6"  
OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

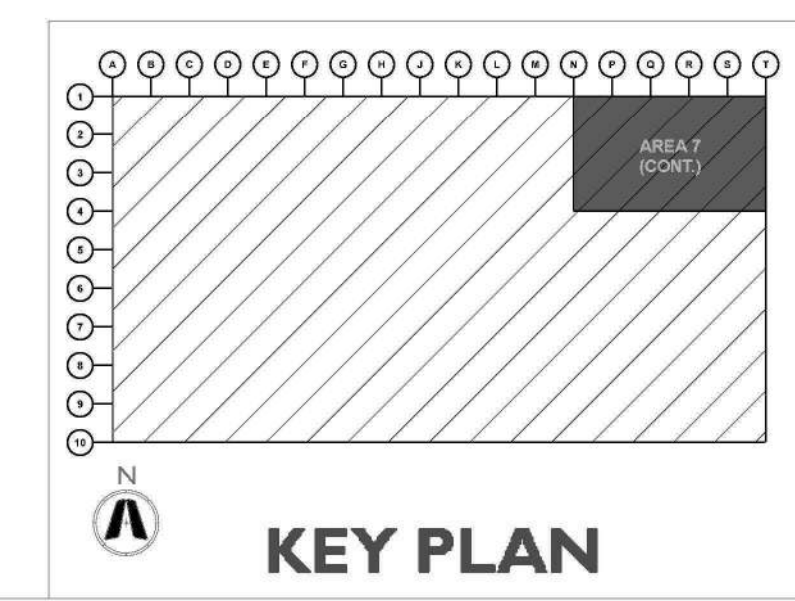



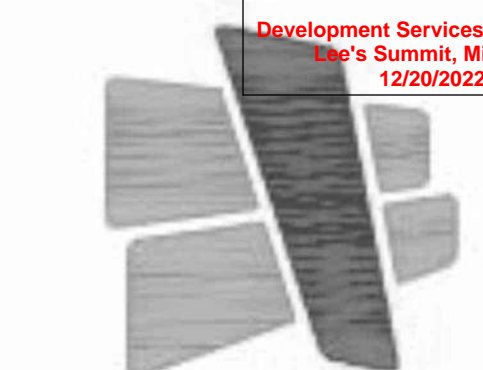

**CURRAN ARCHITECTURE**  
5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753

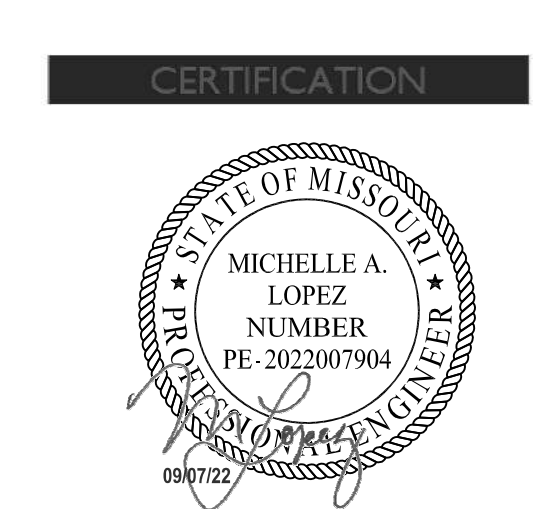

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.


**PROJECT INFORMATION**

**LEE'S SUMMIT LOGISTICS**  
**BUILDING A LOT I**  
NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES	
PERMIT SET	02.18.22
TENANT IMPROVEMENT	09.07.22



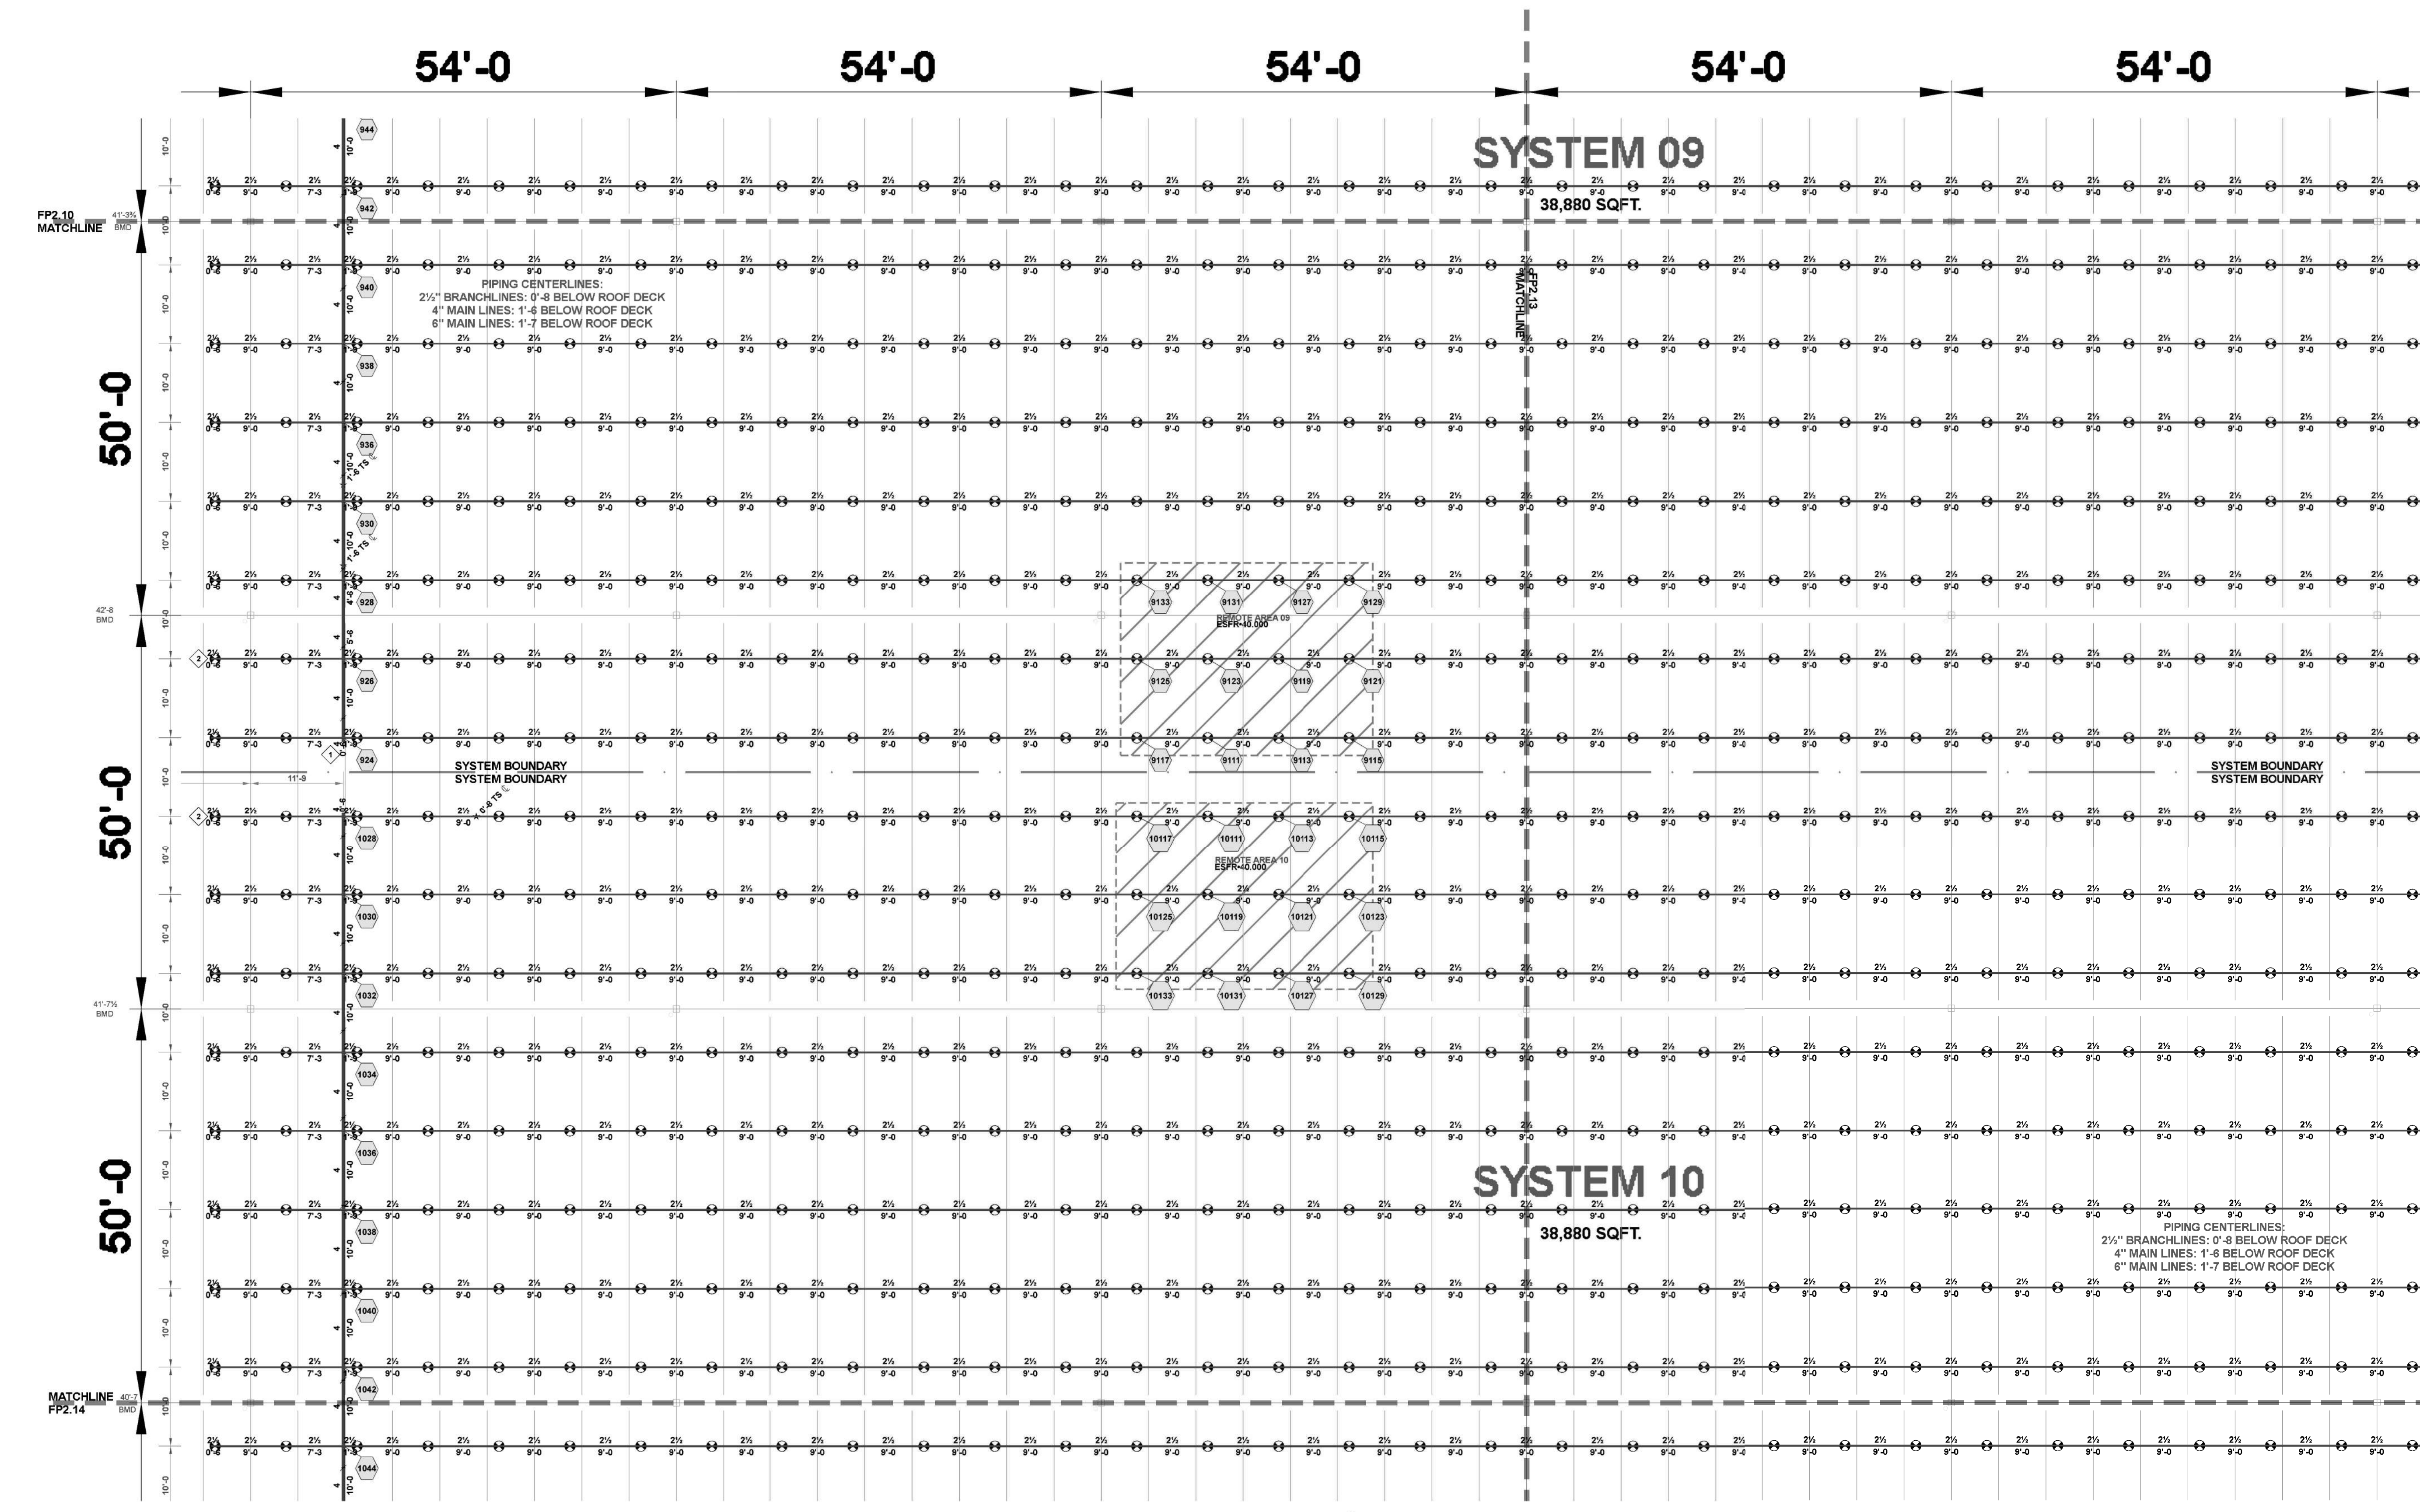



210300

**FP2.8.1**  
AREA 8: SYSTEMS  
09-10




**AREA 8: SYSTEMS 09-10**  
SCALE: 3/32" = 1'-0"

Hydraulic Information		Hydraulic Information	
Remote Area 09		Remote Area 10	
OCCUPANCY CLASSIFICATION	ESFR	OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	40.000 (ESFR)	MIN. END HEAD PRESSURE	40.000 (ESFR)
TOTAL HOSE STREAMS	250.00	TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12	TOTAL HEADS FLOWING	12
K-FACTOR	22.4	K-FACTOR	22.4
TOTAL WATER REQUIRED	1956.70	TOTAL WATER REQUIRED	1958.59
TOTAL PRESSURE REQUIRED	75.314	TOTAL PRESSURE REQUIRED	77.654
BASE OF RISER (GPM)	1956.70	BASE OF RISER (GPM)	1958.59
BASE OF RISER (PSI)	75.314	BASE OF RISER (PSI)	77.654
SAFETY MARGIN (PSI)	+12.183 (13.9%)	SAFETY MARGIN (PSI)	+9.826 (11.2%)

Sprinkler Legend											
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE	NOTE
	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	3/4	FAST	BRASS	200°F	
	4	VICTAULIC	V3406	V34	8	PENDENT	3/4	QUICK	BRASS	200°F	
	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1	FAST	BRASS	200°F	
	48	VIKING	VK600	MICROFAST	5.6	PENDENT	1/2	QUICK	CHROME	135°F	
	6	VIKING	VK3021		5.6	PENDENT	1/2	QUICK	CHROME	135°F	
	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	3/4	QUICK	BRASS	205°F	
	TOTAL = 5234										

\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6" OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

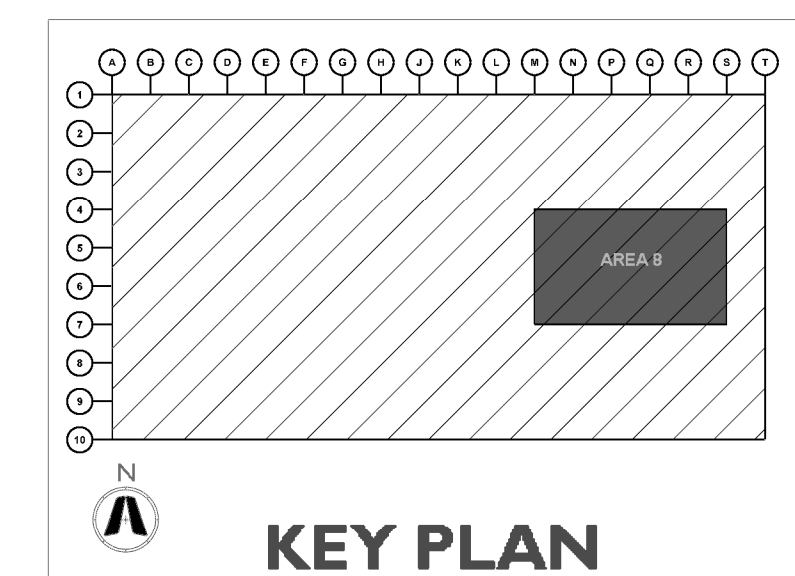





THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY OF  
CURRAN ARCHITECTURE, AND ARE NOT TO  
BE USED OR REPRODUCED, WHOLE OR IN  
PART, WITHOUT THE WRITTEN CONSENT OF  
CURRAN ARCHITECTURE.

## PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I  
NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


## ISSUE DATES

PERMIT SET	02.18.22
1 TENANT IMPROVEMENT	09.07.22

210300

## FP2.8.2

AREA 8 (CONT.):  
SYSTEMS 09-10

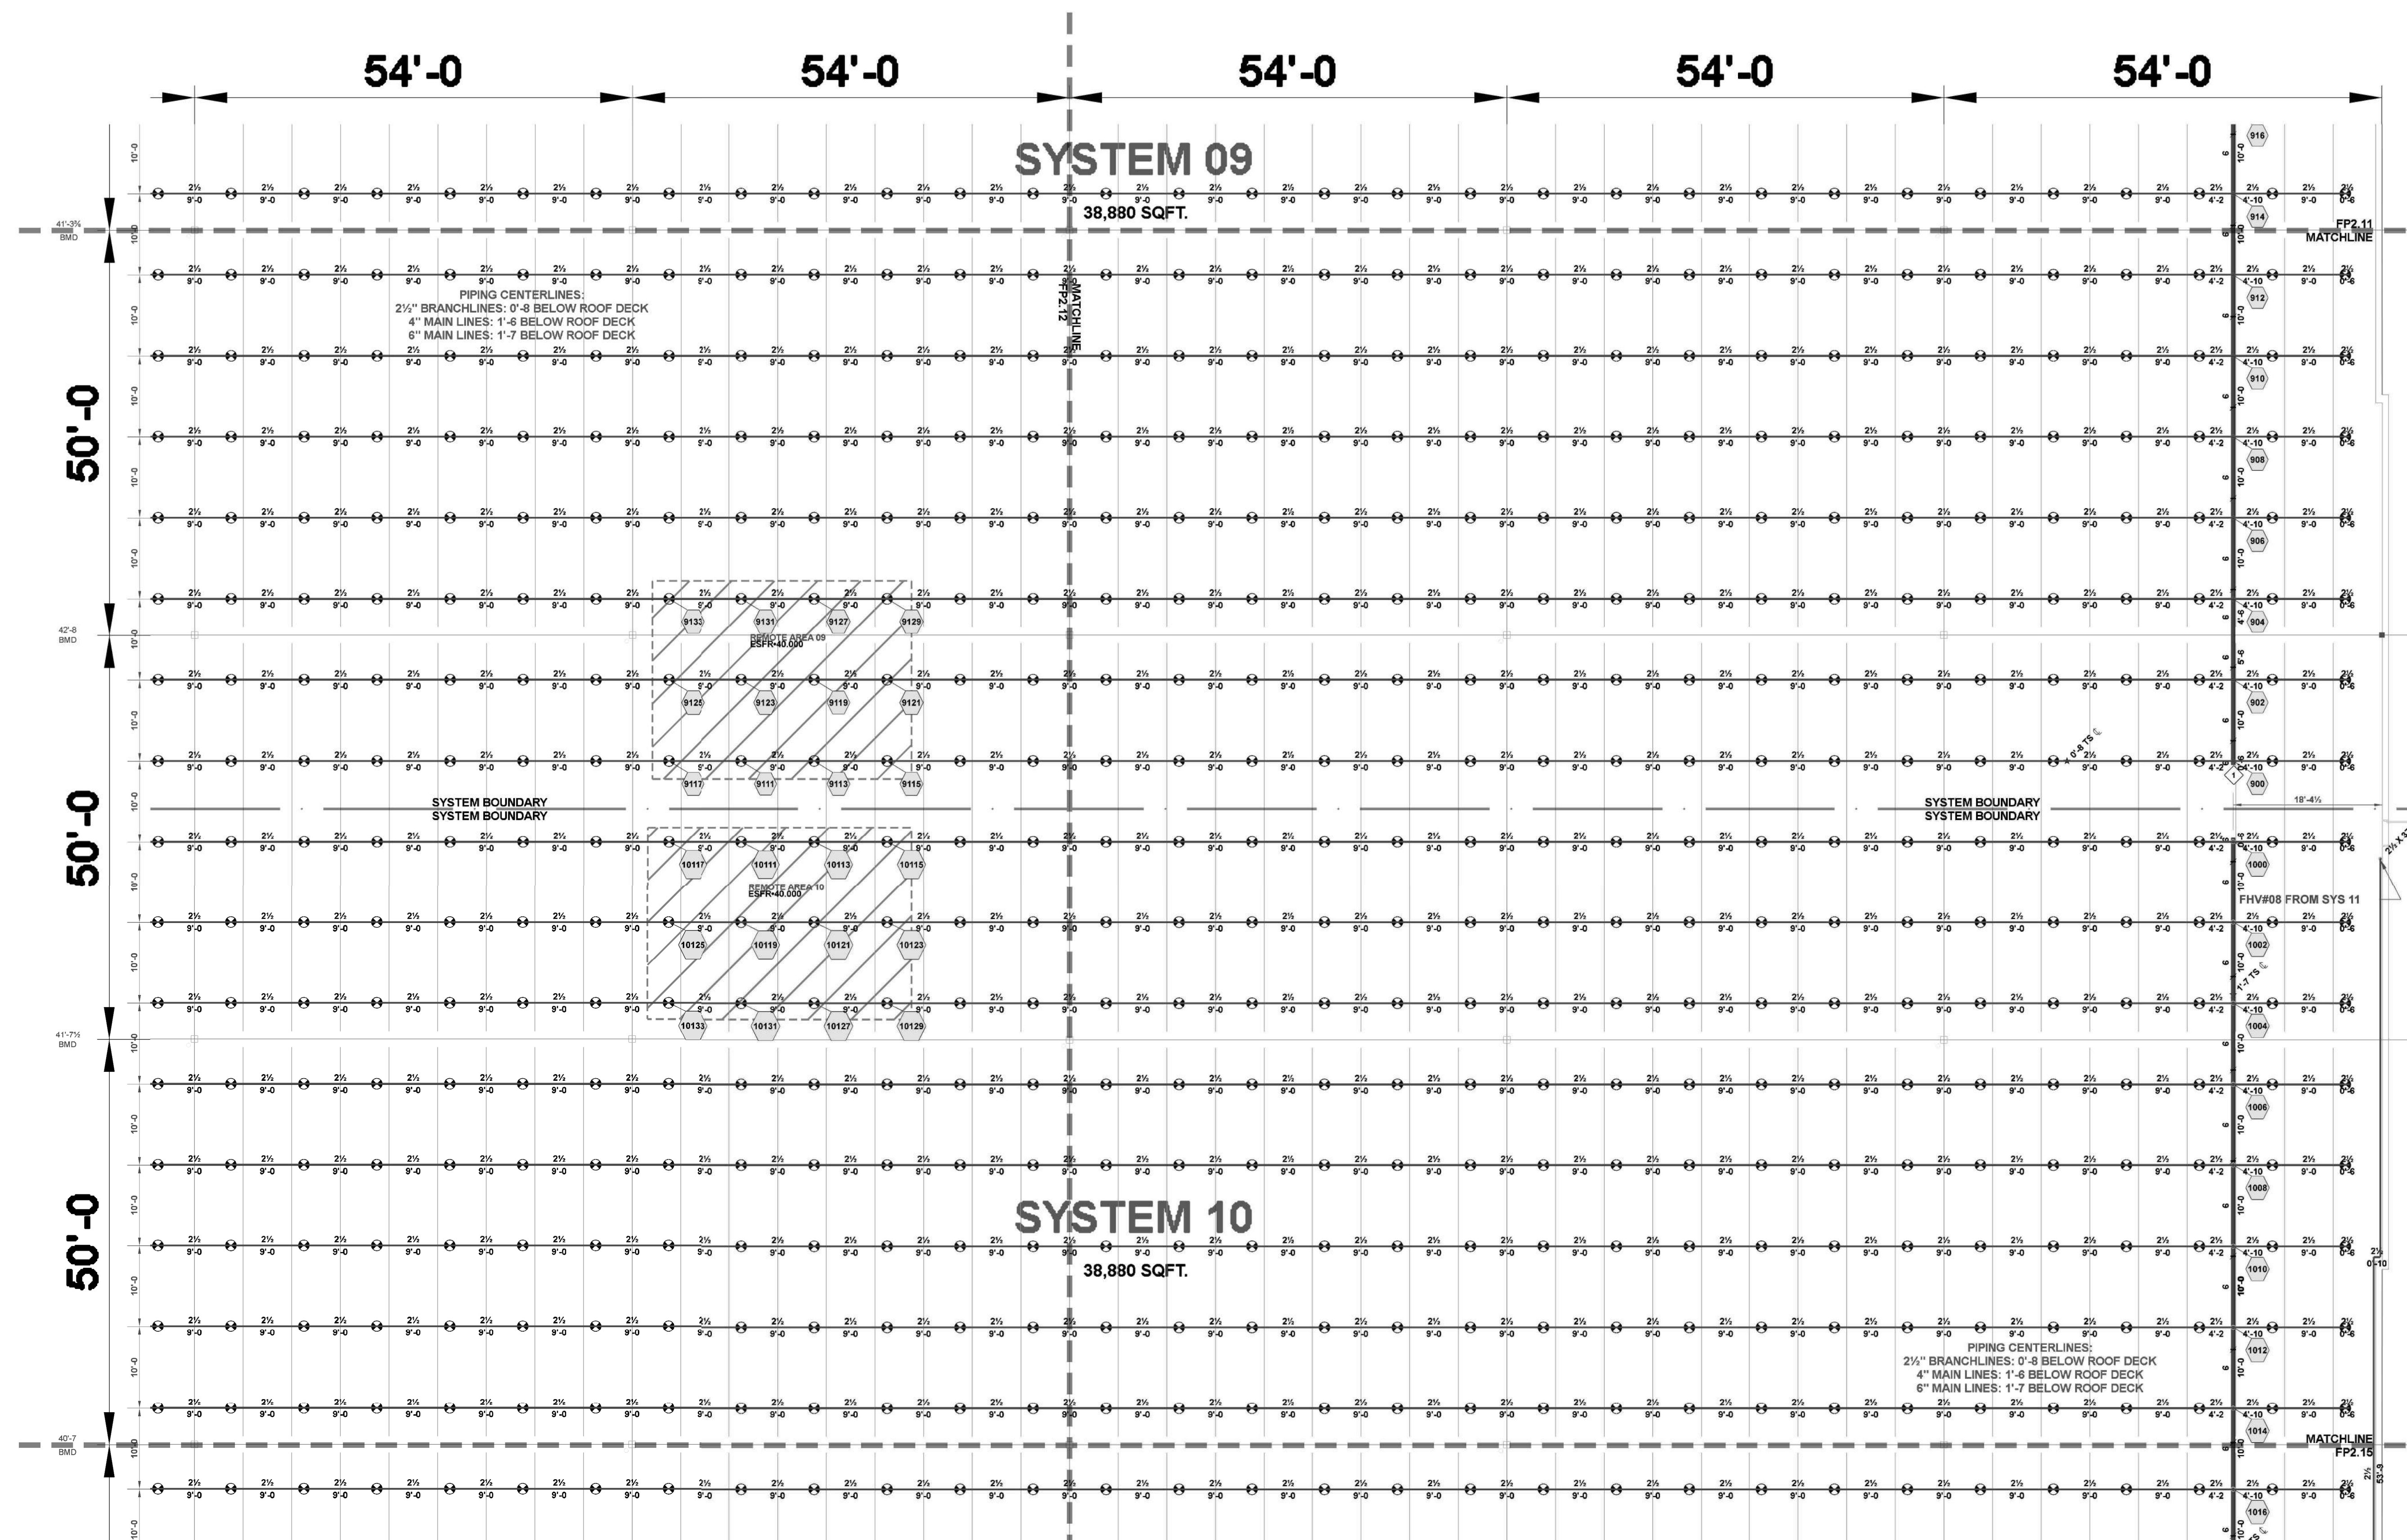


Hydraulic Information		Hydraulic Information	
Remote Area 09		Remote Area 10	
OCCUPANCY CLASSIFICATION	ESFR	OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	40,000 (ESFR)	MIN. END HEAD PRESSURE	40,000 (ESFR)
TOTAL HOSE STREAMS	250.00	TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12	TOTAL HEADS FLOWING	12
K-FACTOR	22.4	K-FACTOR	22.4
TOTAL WATER REQUIRED	1986.70	TOTAL WATER REQUIRED	1958.59
TOTAL PRESSURE REQUIRED	75.314	TOTAL PRESSURE REQUIRED	77.654
BASE OF RISER (GPM)	1966.70	BASE OF RISER (GPM)	1958.59
BASE OF RISER (PSI)	75.314	BASE OF RISER (PSI)	77.654
SAFETY MARGIN (PSI)	+12.183 (13.9%)	SAFETY MARGIN (PSI)	+9.826 (11.2%)


**AREA 8 (CONT.): SYSTEMS 09-10**  
**SCALE: 3/32" = 1'-0"**

Sprinkler Legend											
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE	NOT
	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	¾	FAST	BRASS	200°F	
	4	VICTAULIC	V3406	V34	8	PENDENT	¾	QUICK	BRASS	200°F	
	275	VICTAULIC	V3428	ESFR	22.4	PENDENT	1	FAST	BRASS	200°F	
	48	VIKING	VK600	MICROFAST	5.6	PENDENT	½	QUICK	CHROME	135°F	
	6	VIKING	VK3021		5.6	PENDENT	½	QUICK	CHROME	135°F	
	369	VIKING	VK504	ESFR DRY	16.9	PENDENT	¾	QUICK	BRASS	205°F	
	TOTAL = 5234										

\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF  
OF ANY SURROUNDING ESRF BRANCH LINE CENTERLINE

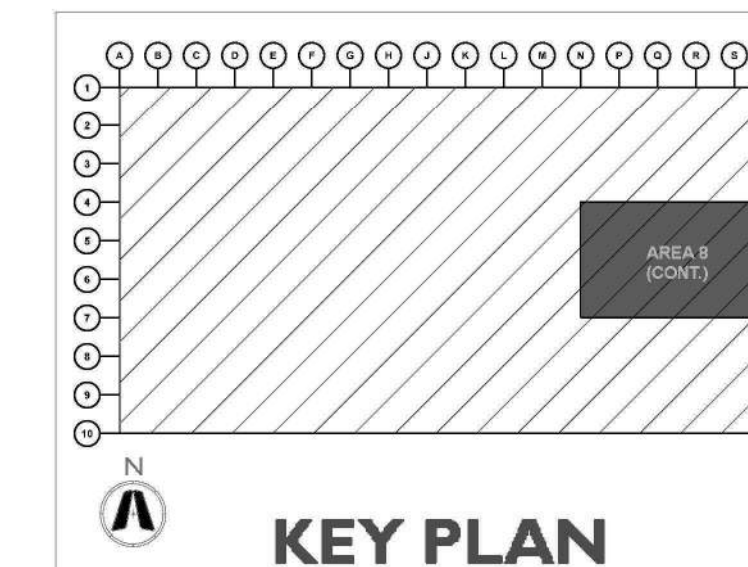



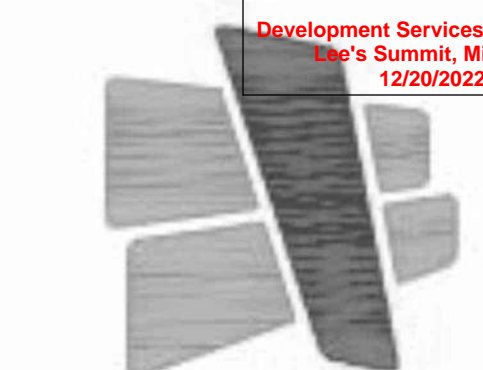

**CURRAN**  
ARCHITECTURE  
5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.

PROJECT INFORMATION


LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I  
NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES

PERMIT SET	02.18.22
TENANT IMPROVEMENT	09.07.22

210300

**FP2.9.1**  
AREA 9: SYSTEMS  
10-11

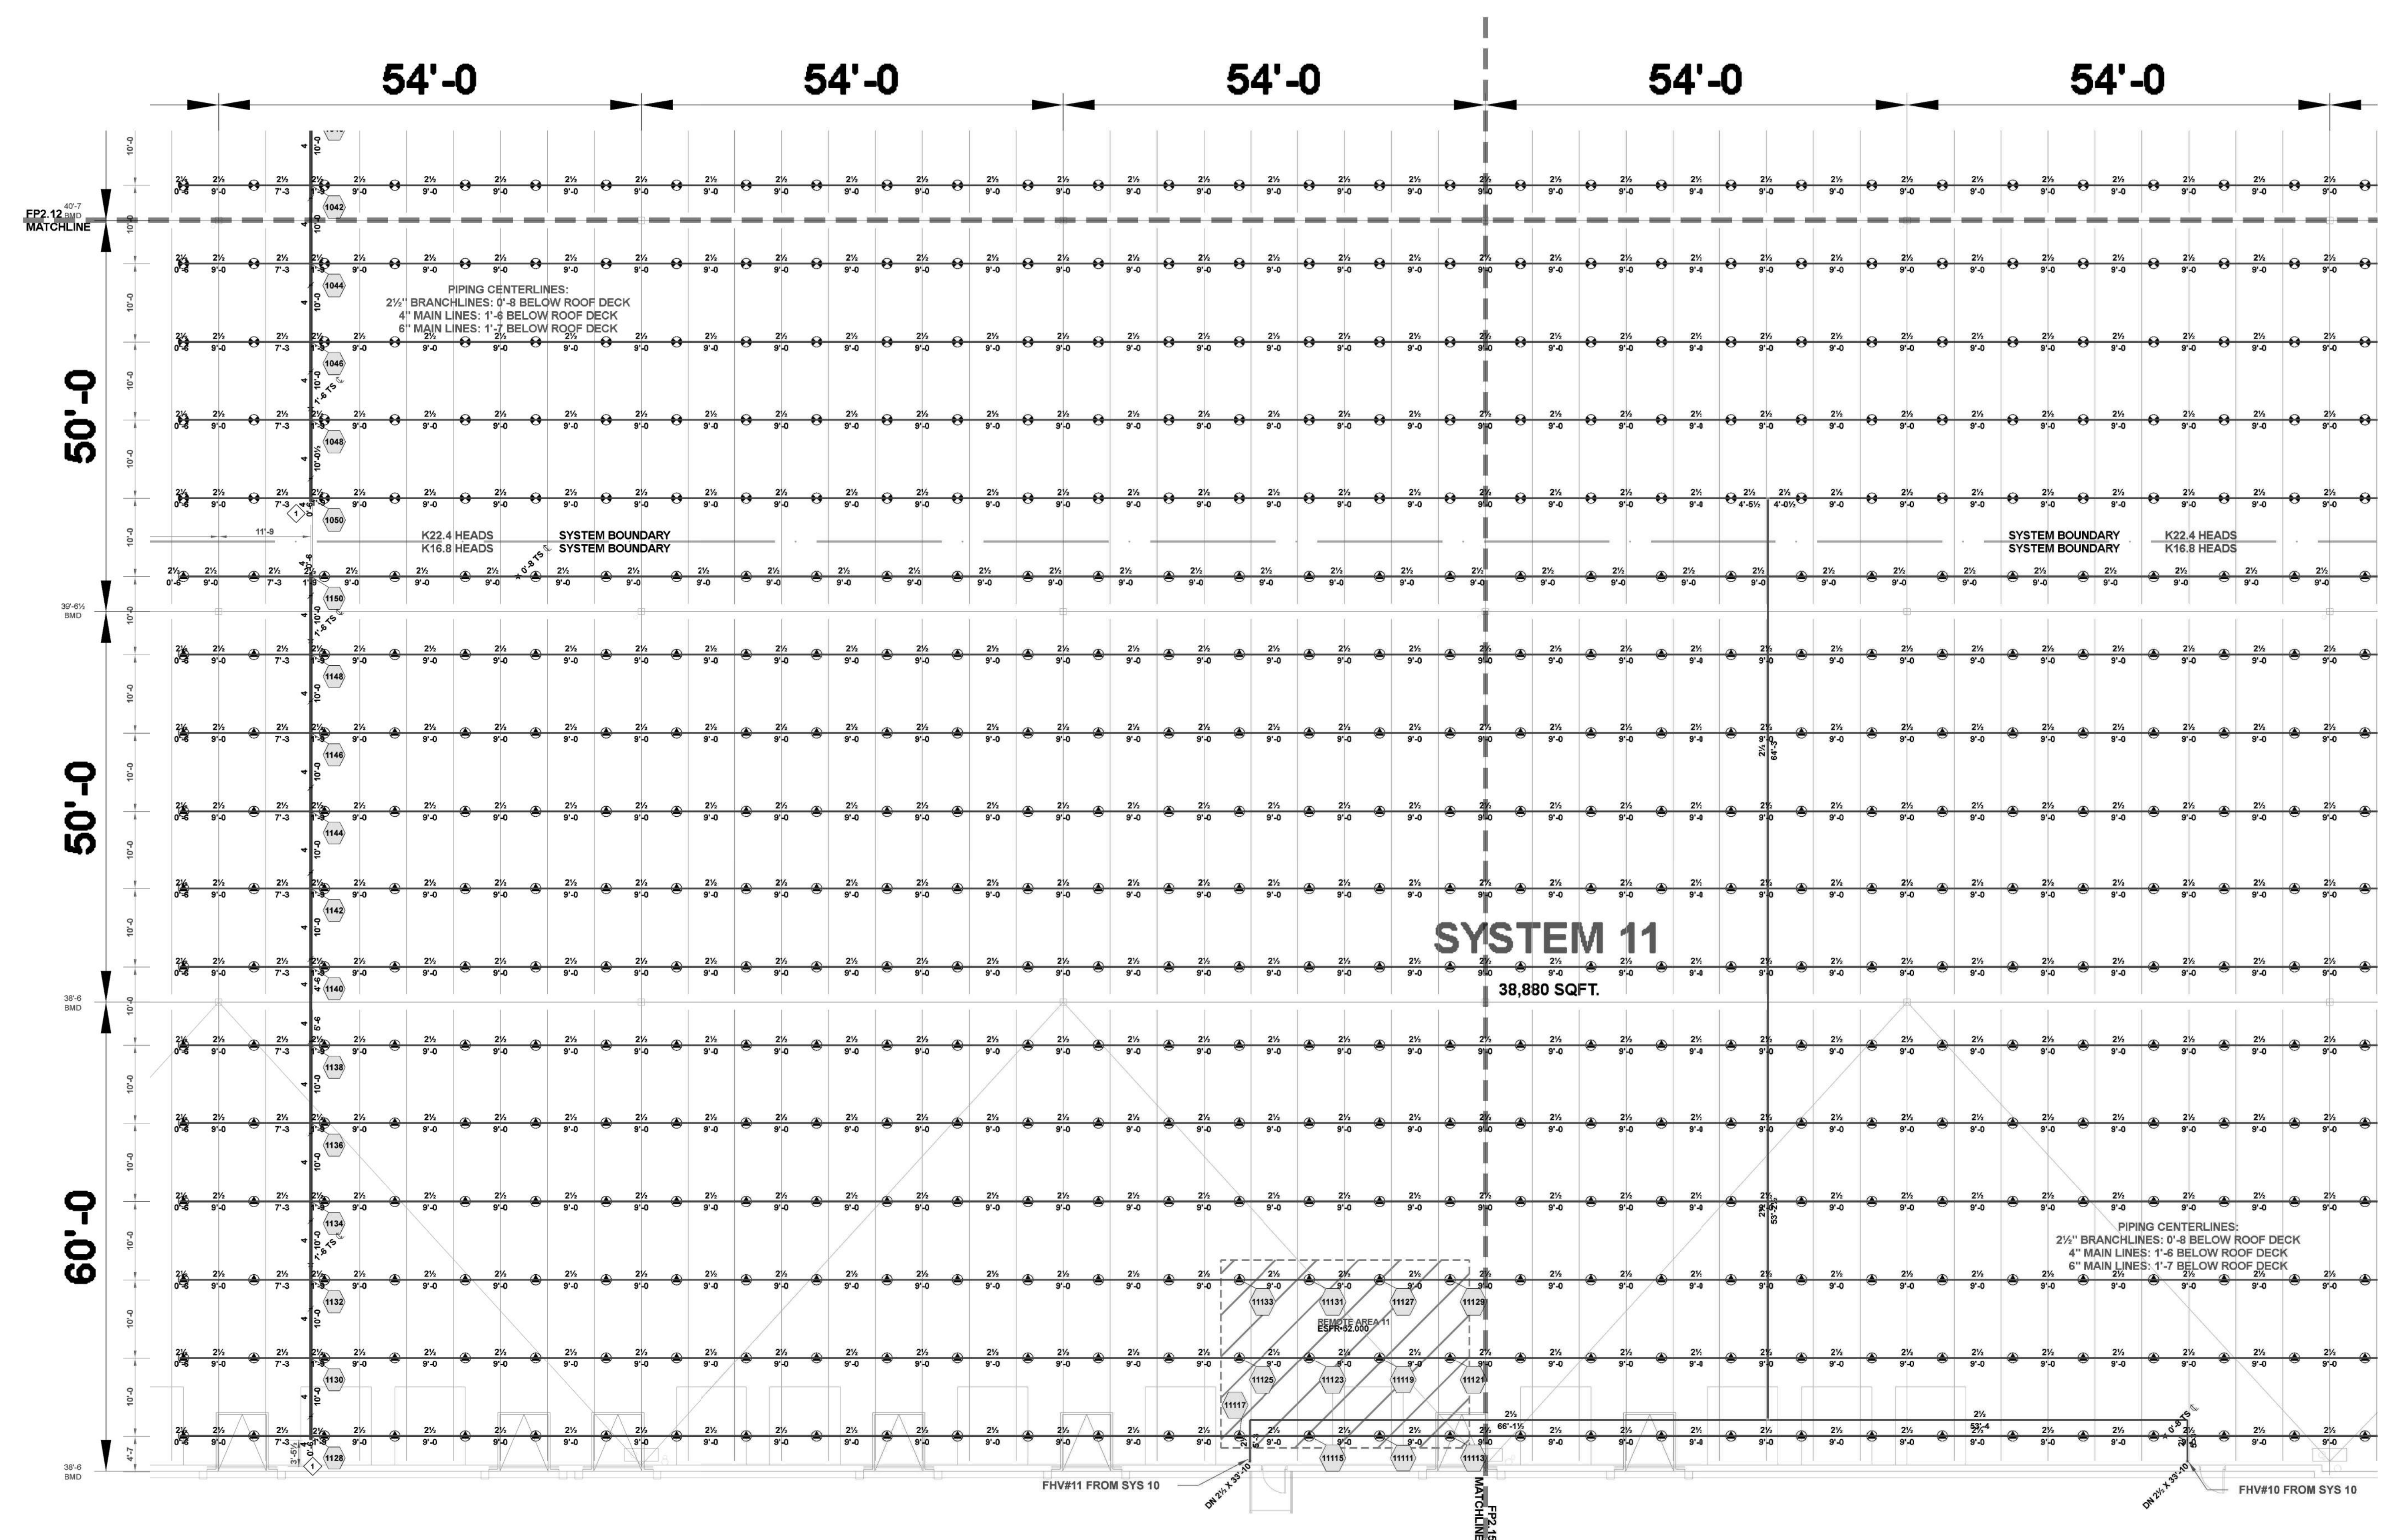


Hydraulic Information	
Remote Area 11	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	52.000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	16.8
TOTAL WATER REQUIRED	1708.55
TOTAL PRESSURE REQUIRED	79.115
BASE OF RISER (GPM)	1708.55
BASE OF RISER (PSI)	79.115
SAFETY MARGIN (PSI)	+10.490 (11.7%)

**AREA 9: SYSTEMS 10-11**  
SCALE: 3/32" = 1'-0"

Sprinkler Legend										
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE
▲	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	3/4"	FAST	BRASS	200°F
⊗	4	VICTAULIC	V3406	V34	8	PENDENT	3/4"	QUICK	BRASS	200°F
⊙	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1"	FAST	BRASS	200°F
●	48	VIKING	VK600	MICROFAST	5.6	PENDENT	1/2"	QUICK	CHROME	135°F
⦿	6	VIKING	VK3021		5.6	PENDENT	1/2"	QUICK	CHROME	135°F
◆	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	3/4"	QUICK	BRASS	205°F
TOTAL = 5234										

\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6" OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

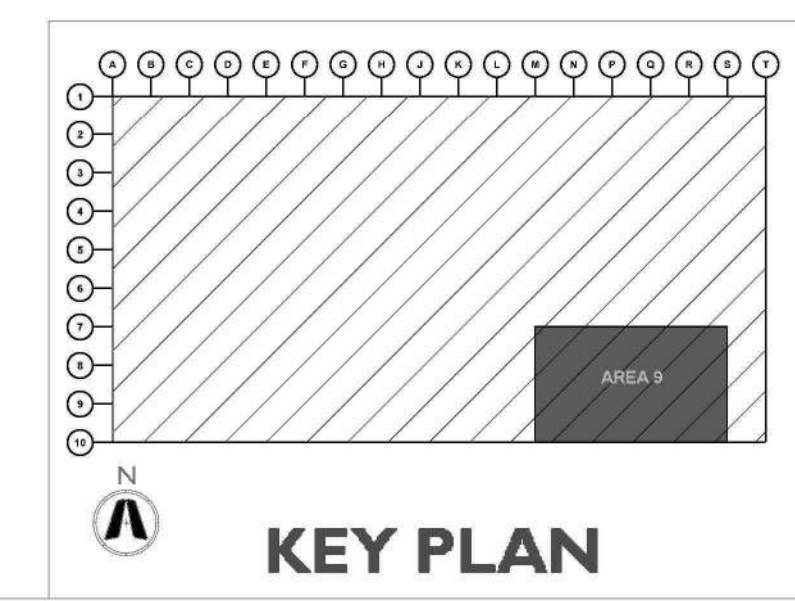





**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317.288.0681  
F :: 317.288.0753



**SCANNELL**  
PROPERTIES

CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY OF  
CURRAN ARCHITECTURE, AND ARE NOT TO  
BE USED OR REPRODUCED, WHOLE OR IN  
PART, WITHOUT THE WRITTEN CONSENT OF  
CURRAN ARCHITECTURE.

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I

NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086


ISSUE DATES

PERMIT SET 02.18.22  
TENANT IMPROVEMENT 09.07.22

210300

**FP2.9.2**

AREA 9(CONT.):  
SYSTEMS 10-11

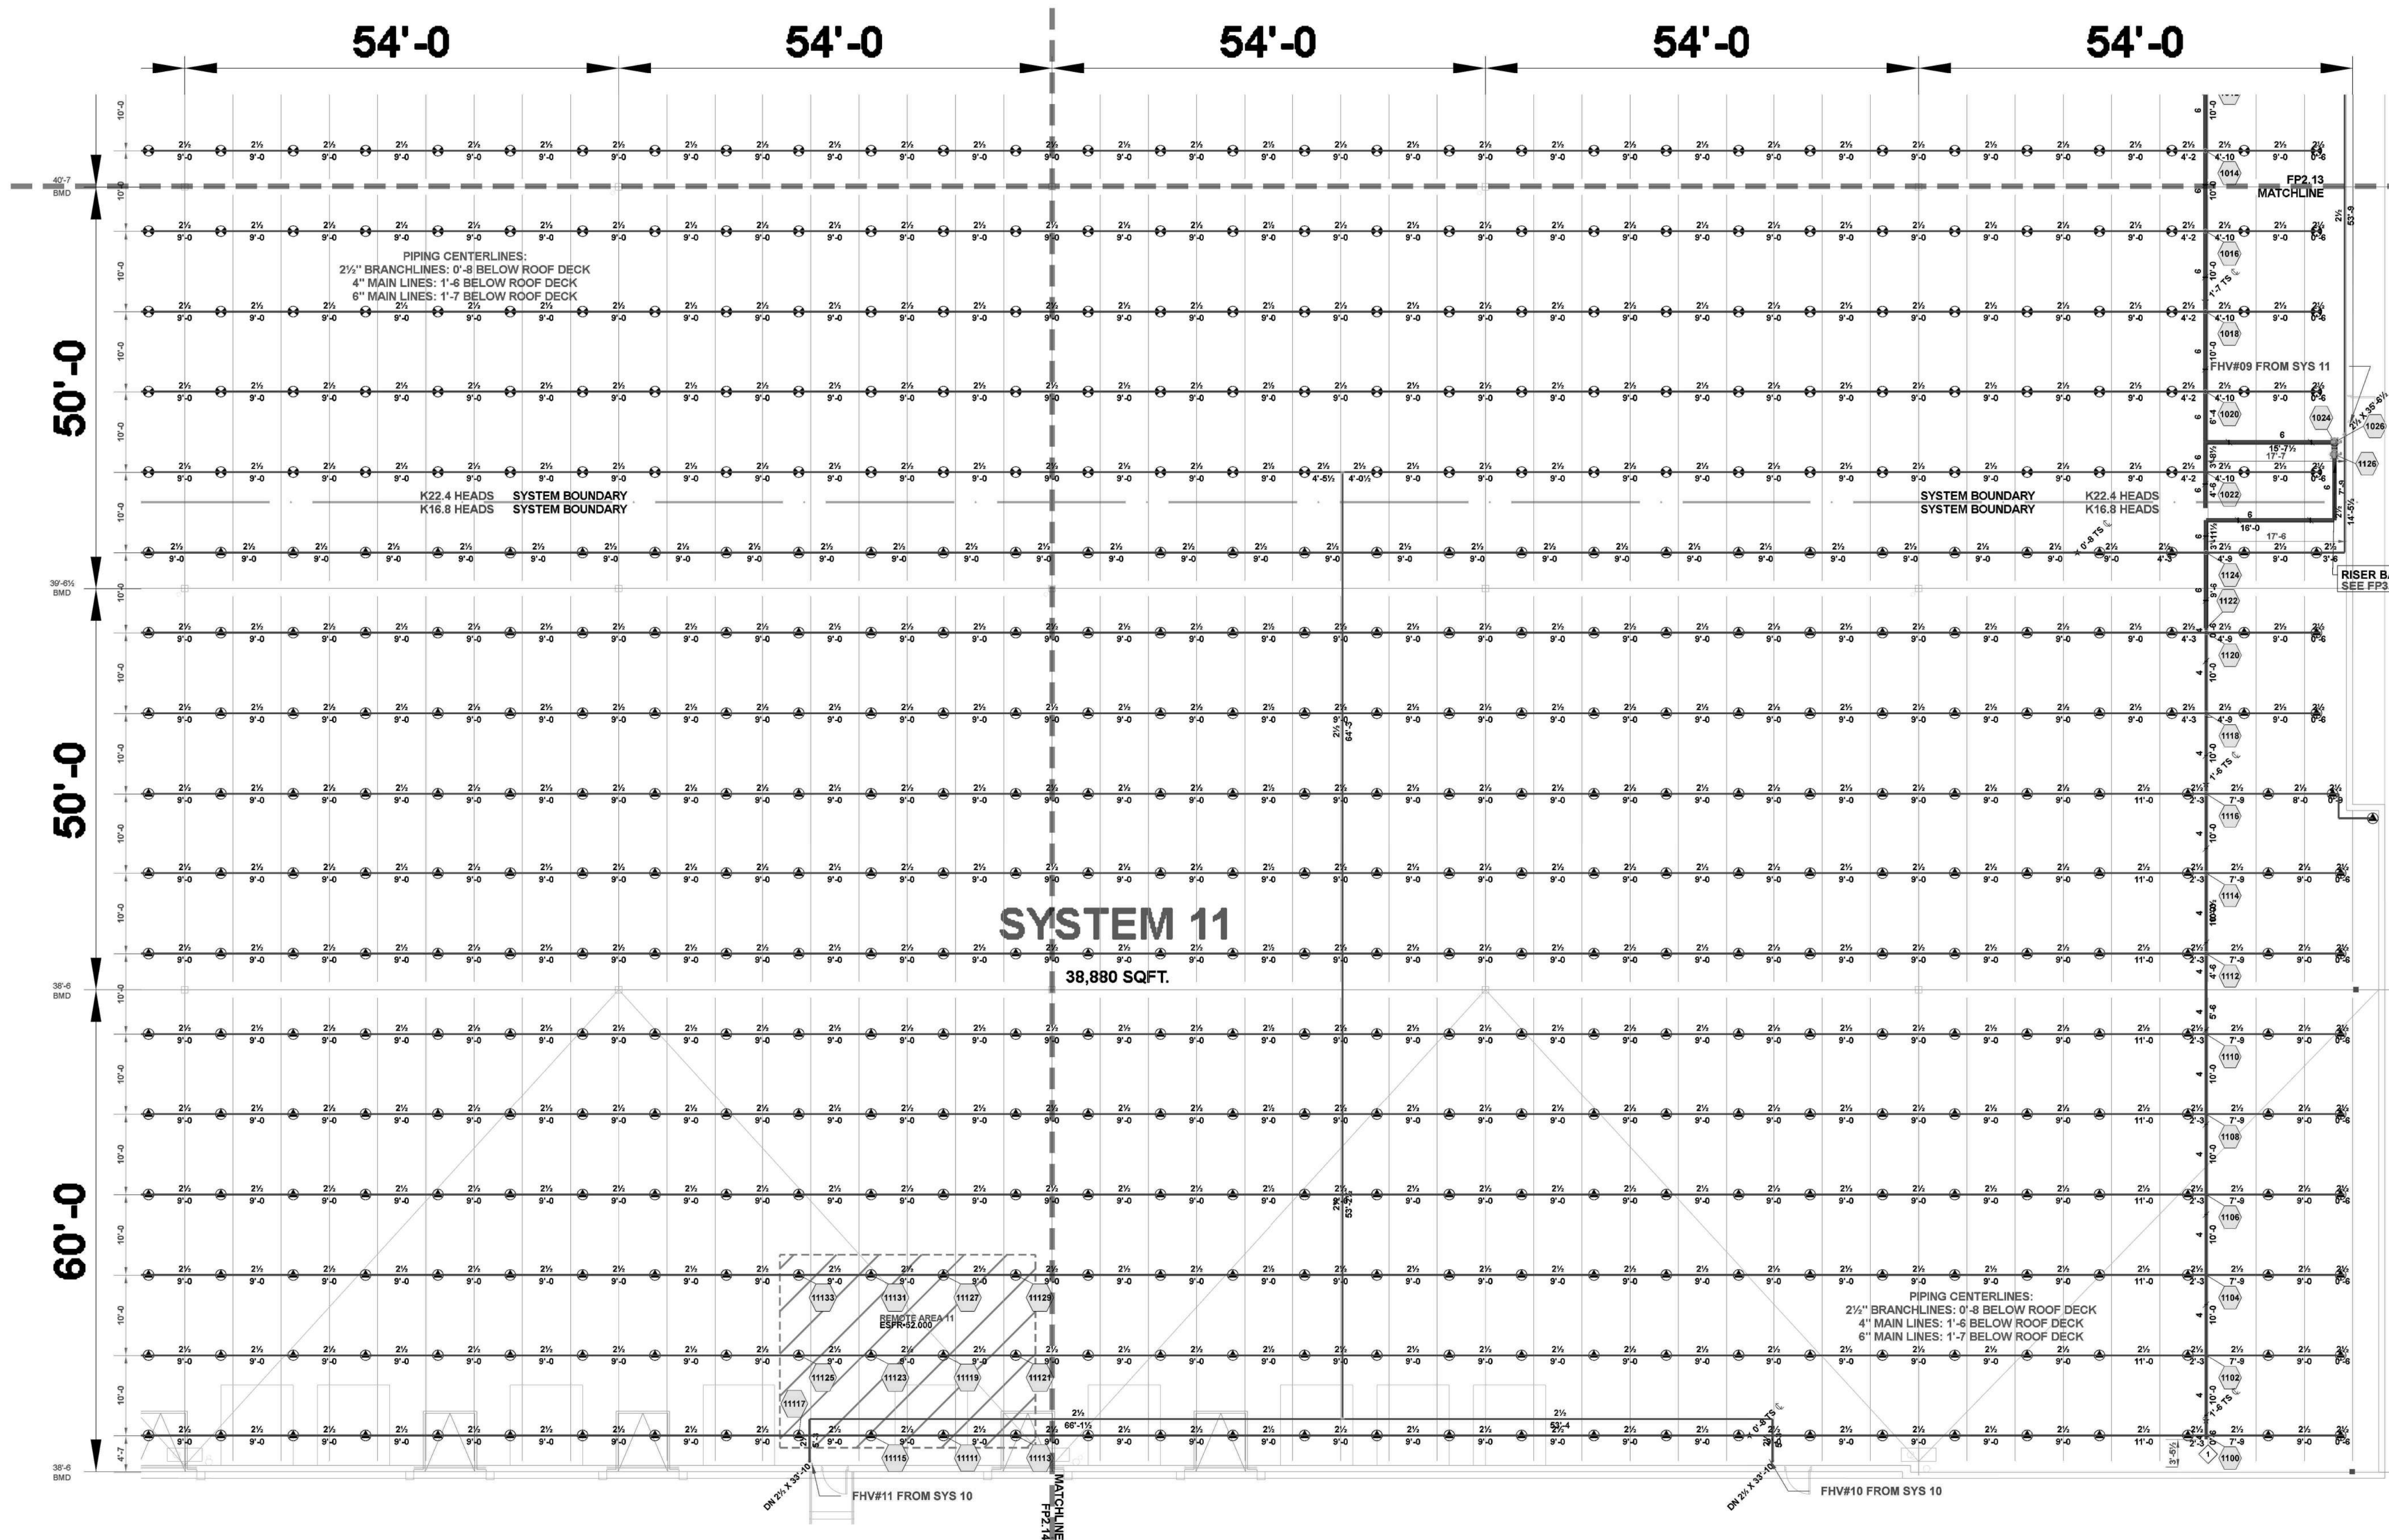


Hydraulic Information	
Remote Area 11	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	52.000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	16.8
TOTAL WATER REQUIRED	1708.55
TOTAL PRESSURE REQUIRED	79.115
BASE OF RISER (GPM)	1708.55
BASE OF RISER (PSI)	79.115
SAFETY MARGIN (PSI)	+10.490 (11.7%)


AREA 9(CONT.): SYSTEMS 10-11  
SCALE: 3/32" = 1'-0"

Sprinkler Legend										
SYMBOL	QUANTITY	MANUFACTURER	SIN	MODEL	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE
	2054	VICTAULIC	V4702	FL-QR/ST/ESFR	16.8	PENDENT	3/4"	FAST	BRASS	200°F
	4	VICTAULIC	V3406	V34	8	PENDENT	3/4"	QUICK	BRASS	200°F
	2754	VICTAULIC	V3428	ESFR	22.4	PENDENT	1"	FAST	BRASS	200°F
	48	VIKING	VK600	MICROFAST	5.6	PENDENT	1/2"	QUICK	CHROME	135°F
	6	VIKING	VK3021		5.6	PENDENT	1/2"	QUICK	CHROME	135°F
	368	VIKING	VK504	ESFR DRY	16.8	PENDENT	3/4"	QUICK	BRASS	205°F
TOTAL = 5234										




\*\*JOIST BRIDGING ROWS CANNOT BE ERECTED WITHIN OF 1'-6"  
OF ANY SURROUNDING ESFR BRANCH LINE CENTERLINE

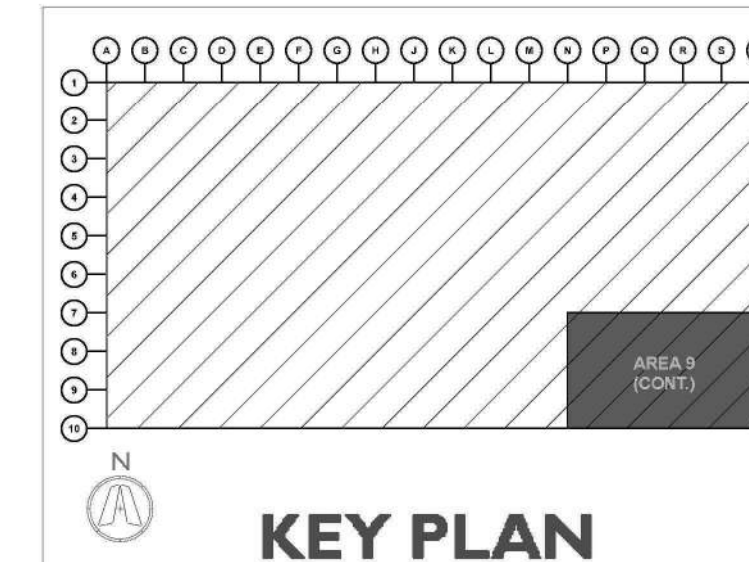





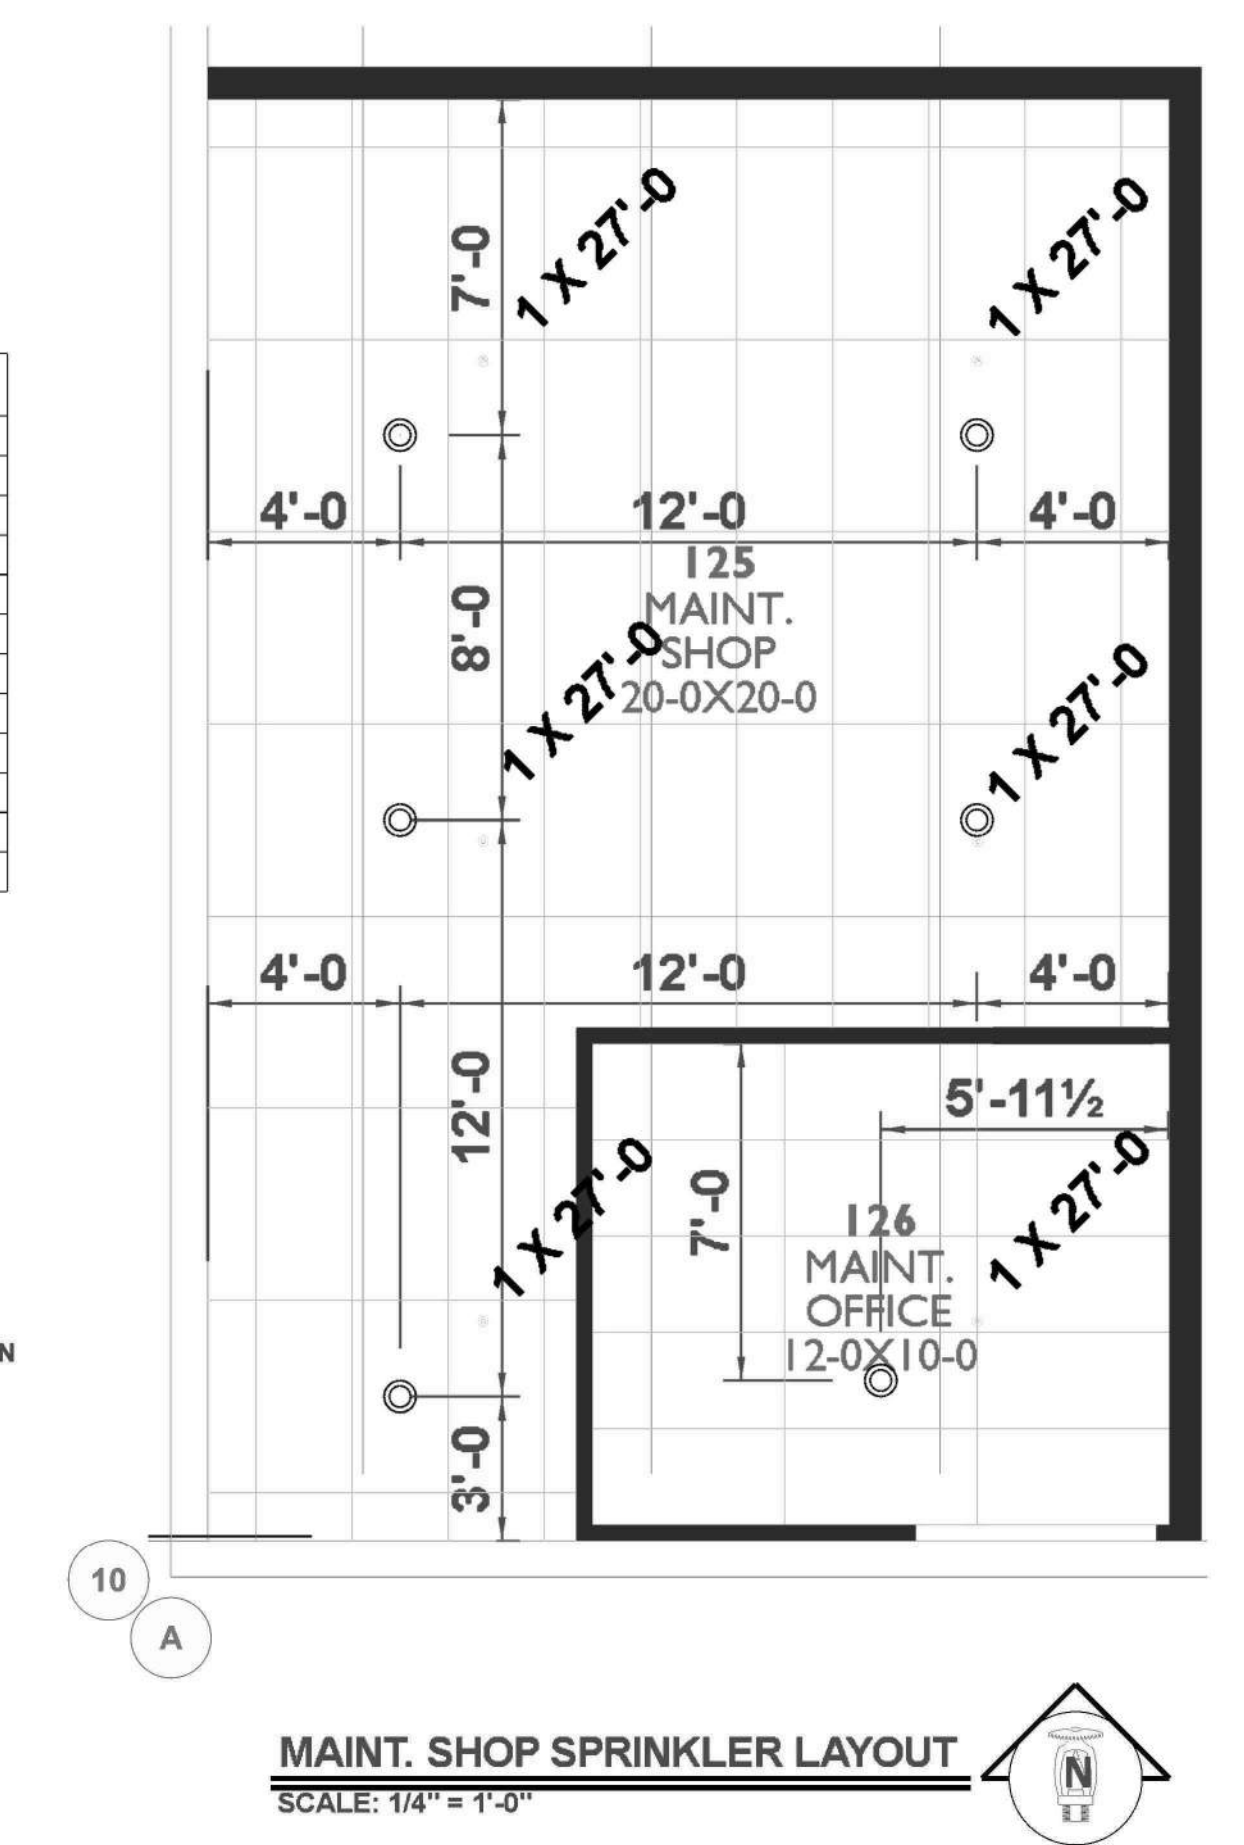

Hydraulic Information	
Remote Area Office	
OCCUPANCY CLASSIFICATION	LIGHT HAZARD
DENSITY (GPM/FT²)	0.10 FOR 1500FT² (ACTUAL 965FT²)
QUICK RESPONSE REDUCTION	9'-8 CEILING (40.0%) 900FT²
TOTAL HOSE STREAMS	100.00
TOTAL HEADS FLOWING	7
K-FACTOR	5.6
TOTAL WATER REQUIRED	388.74
TOTAL PRESSURE REQUIRED	42.659
BASE OF RISER (GPM)	388.74
BASE OF RISER (PSI)	42.659
SAFETY MARGIN (PSI)	+53.863 (55.8%)

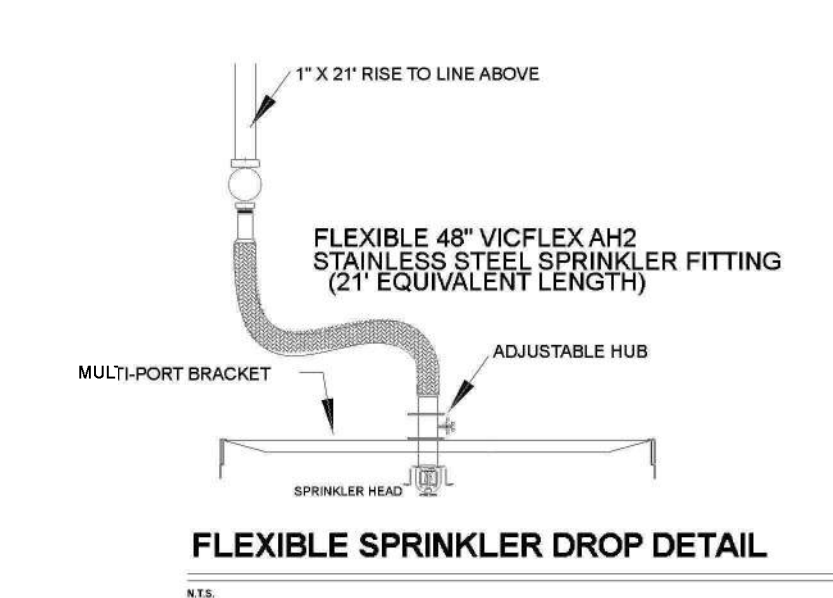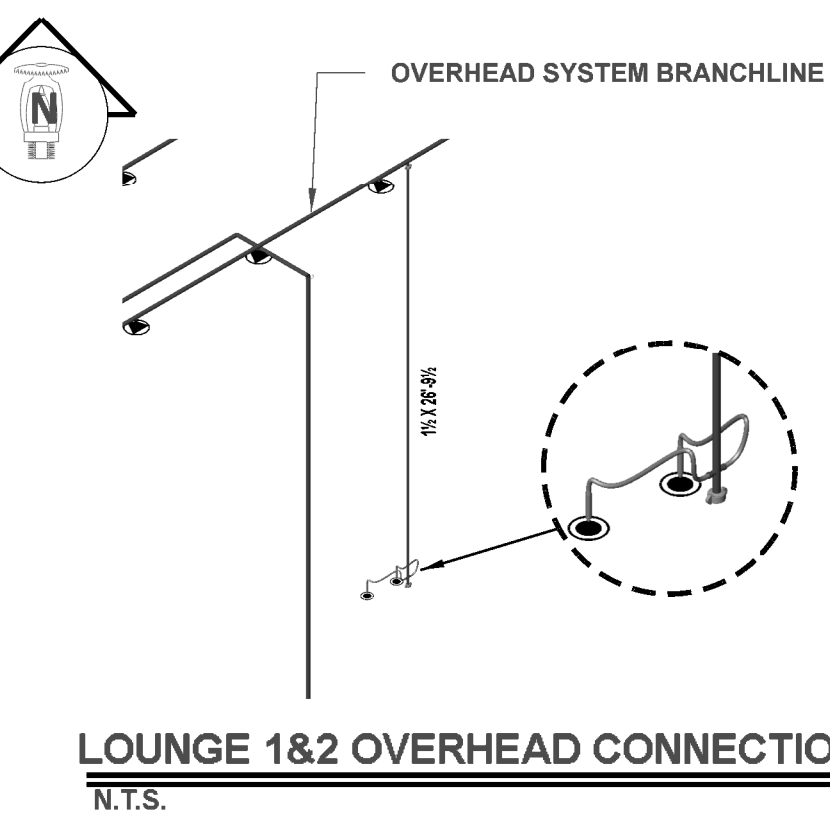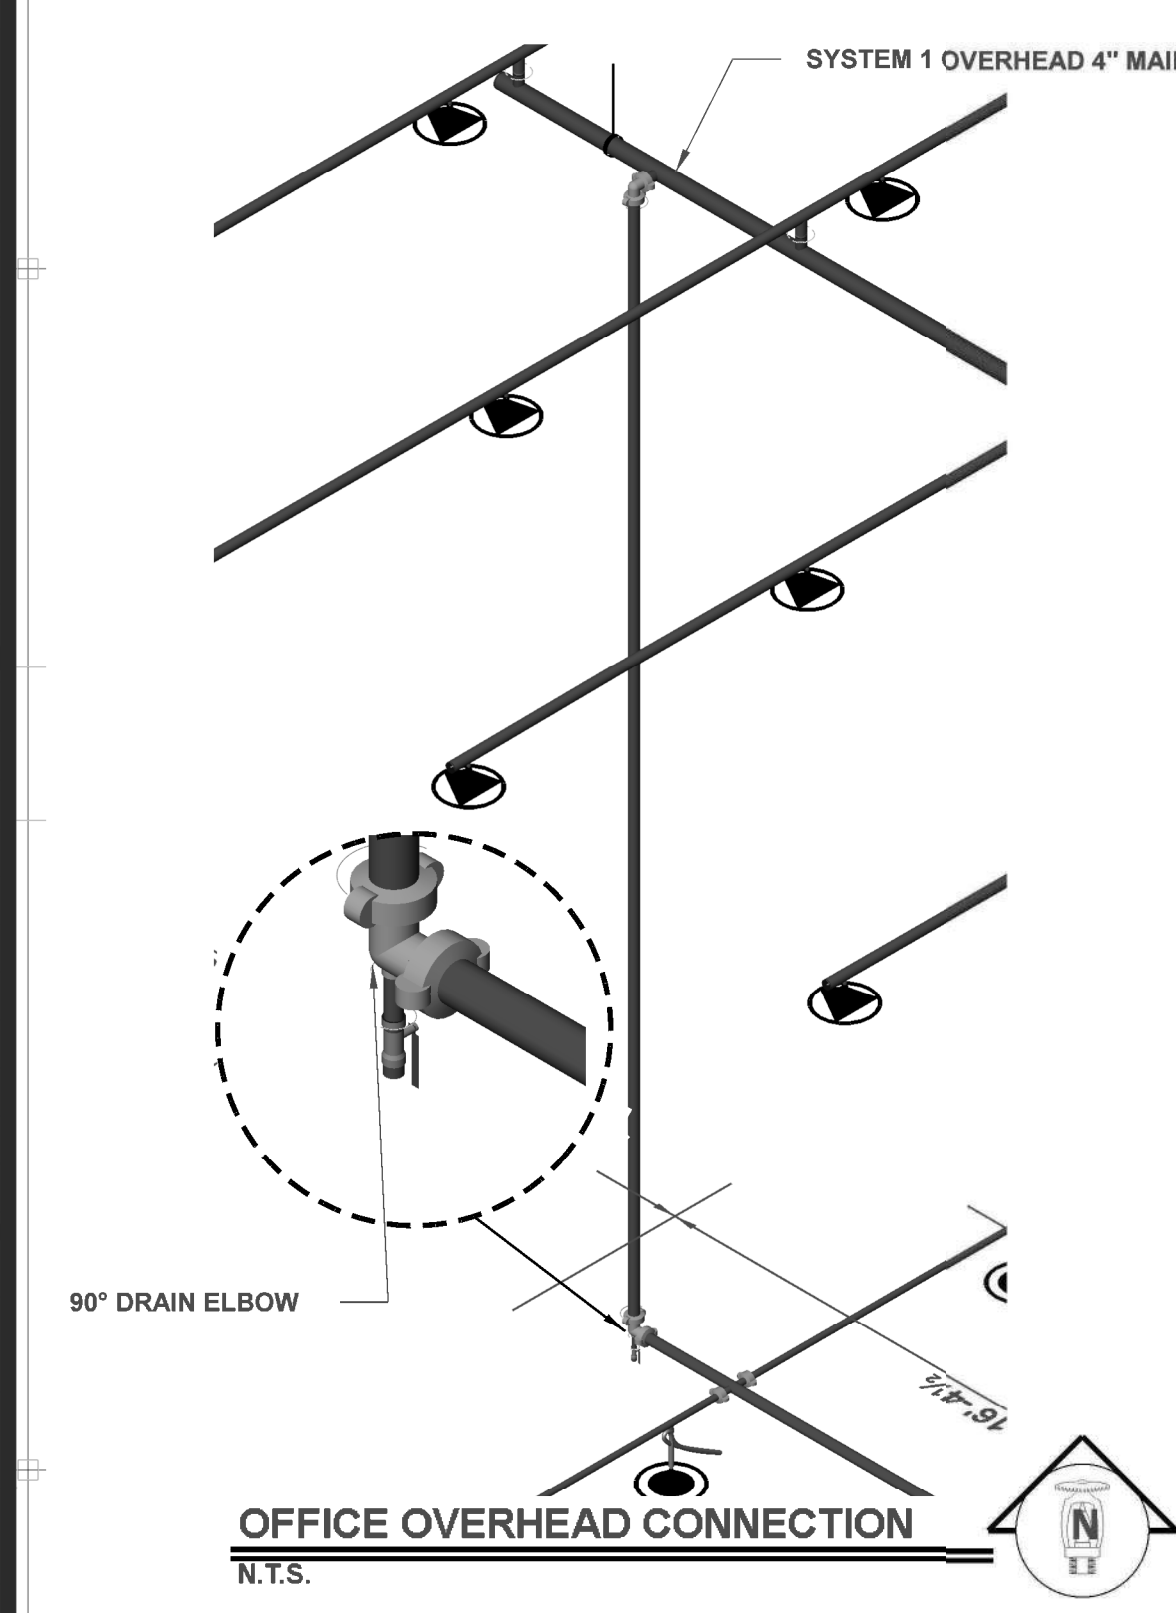


Sprinkler Legend										
SYMBOL	MANUFACTURER	SIN	MODEL	QUANTITY	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE
▲	VICTAULIC	V4702	FL-QR/ST/ESFR	2054	16.8	PENDENT	3/4	FAST	BRASS	200°F
⊗	VICTAULIC	V3406	V34	4	8	PENDENT	3/4	QUICK	BRASS	200°F
◆	VICTAULIC	V3428	ESFR	2754	22.4	PENDENT	1	FAST	BRASS	200°F
●	VIKING	VK600	MICROFAST	48	5.6	PENDENT	1/2	QUICK	CHROME	135°F
⦿	VIKING	VK3021		6	5.6	PENDENT	1/2	QUICK	CHROME	135°F
◆	VIKING	VK504	ESFR DRY	368	16.8	PENDENT	3/4	QUICK	BRASS	205°F
				TOTAL = 5234						

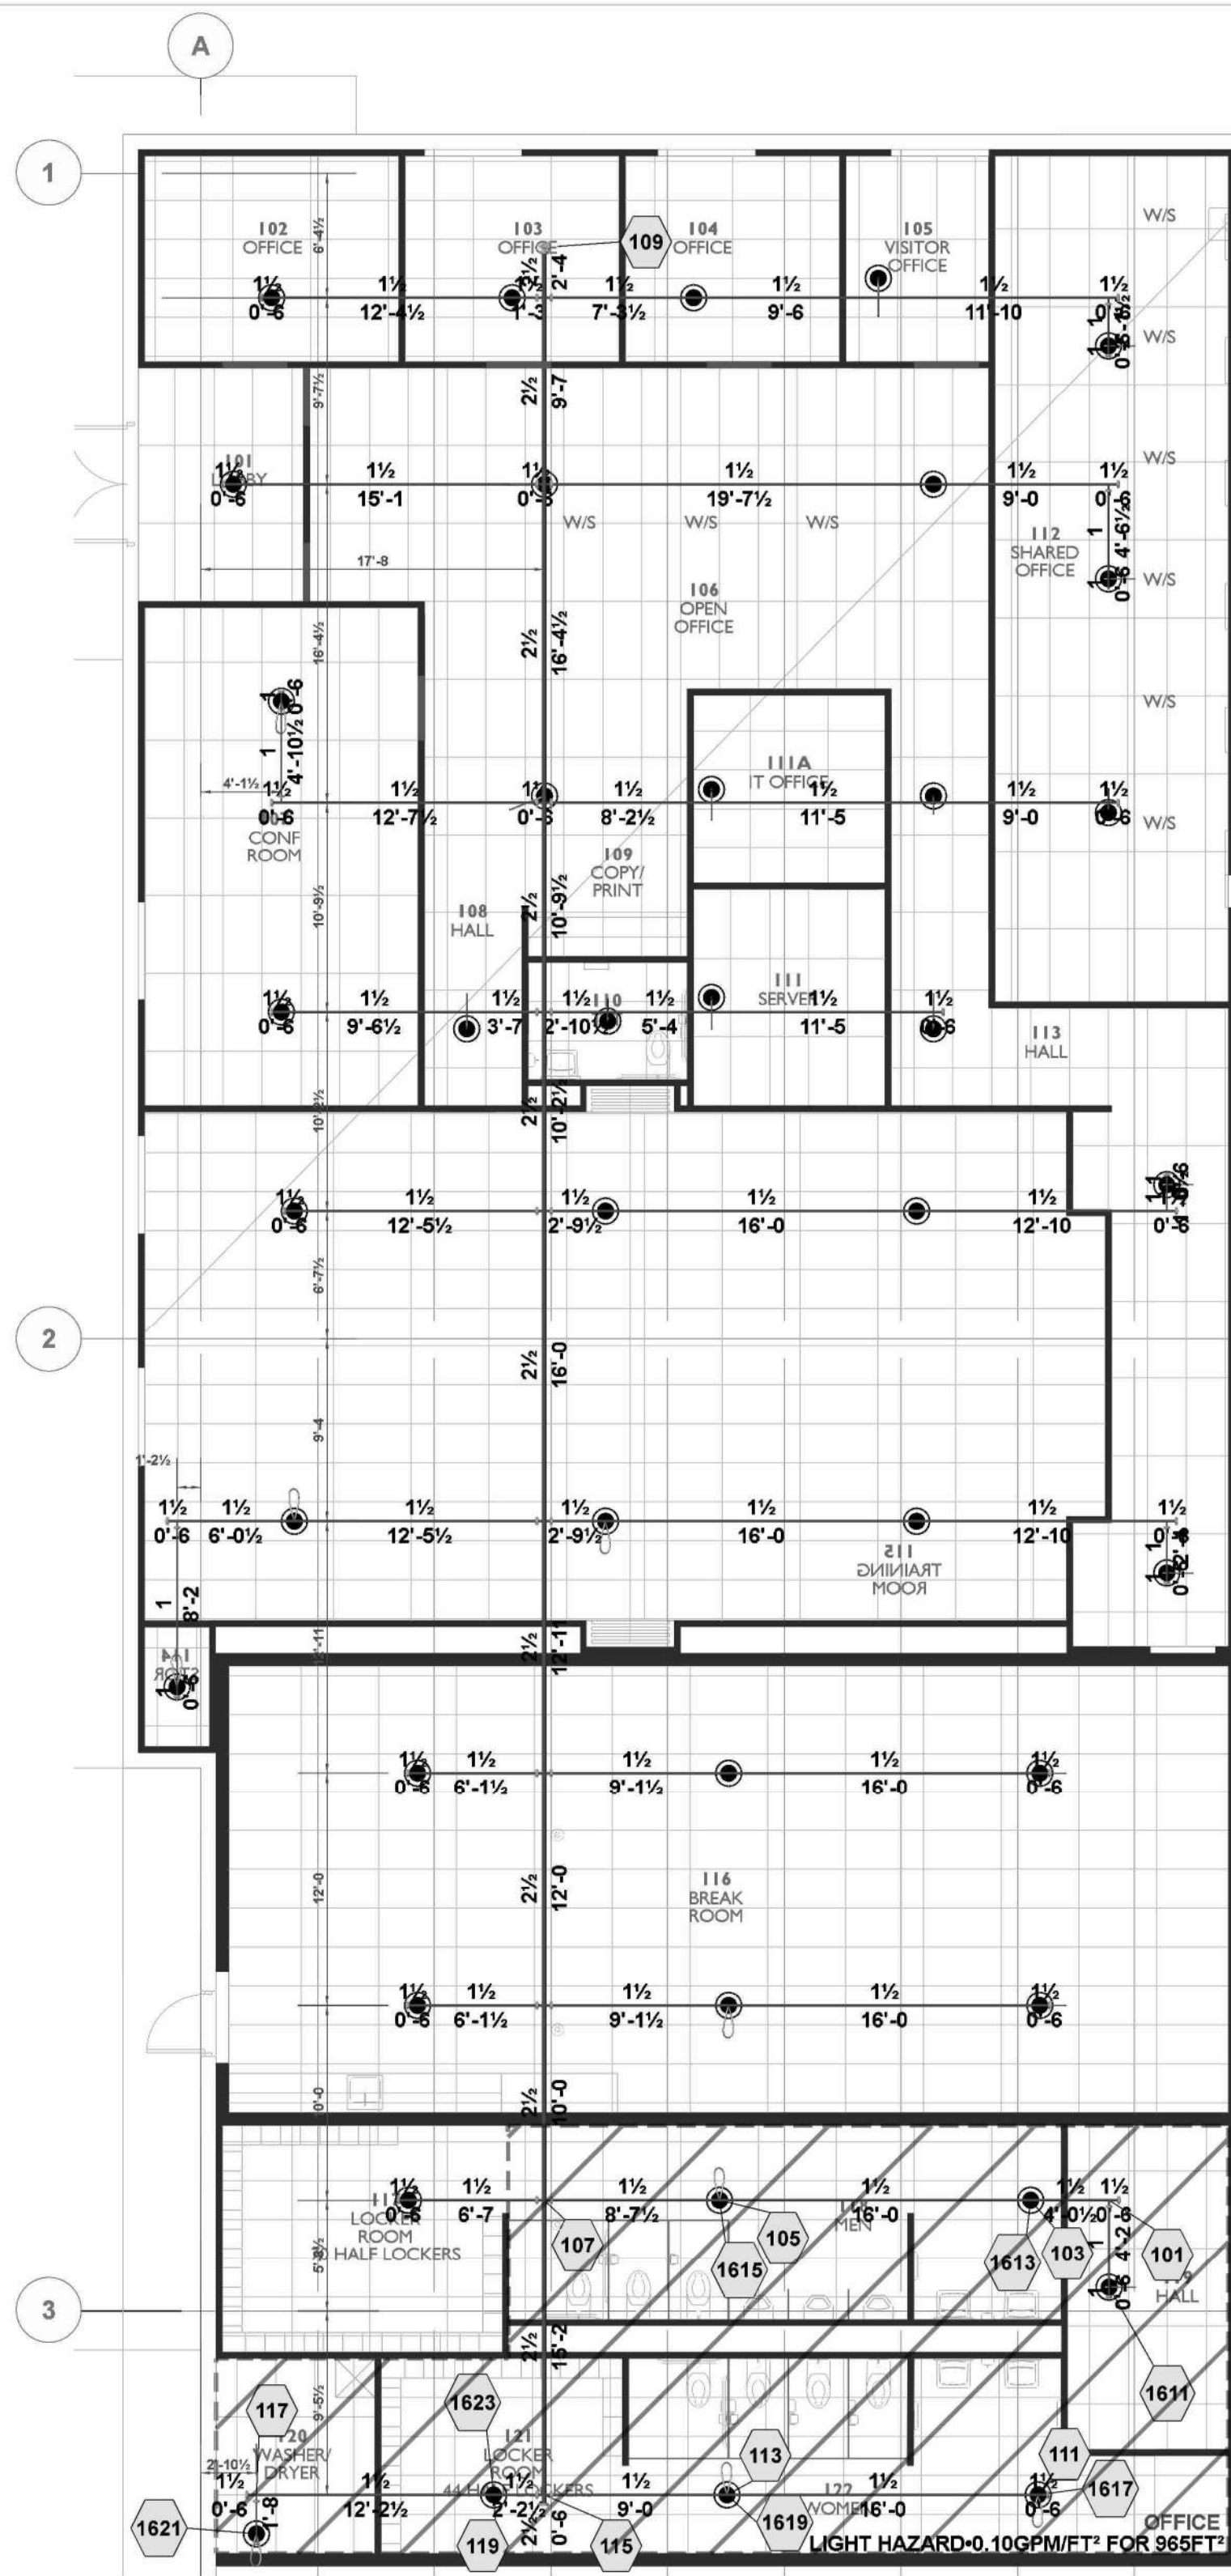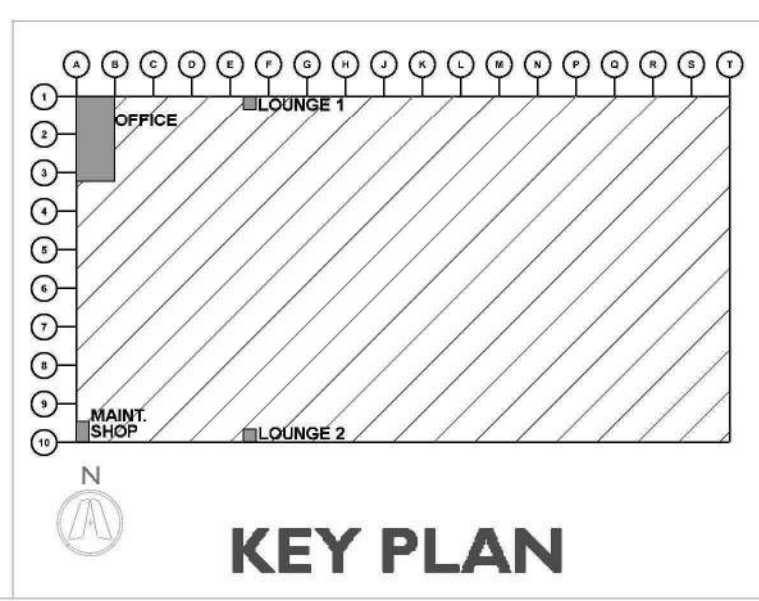


OFFICE PIPING LAYOUT  
SCALE: 1/8" = 1'-0"


\*\*ACT ELEVATIONS: 9'-8 AFF  
\*\*PIPING CENTERLINES: 10'-8 AFF

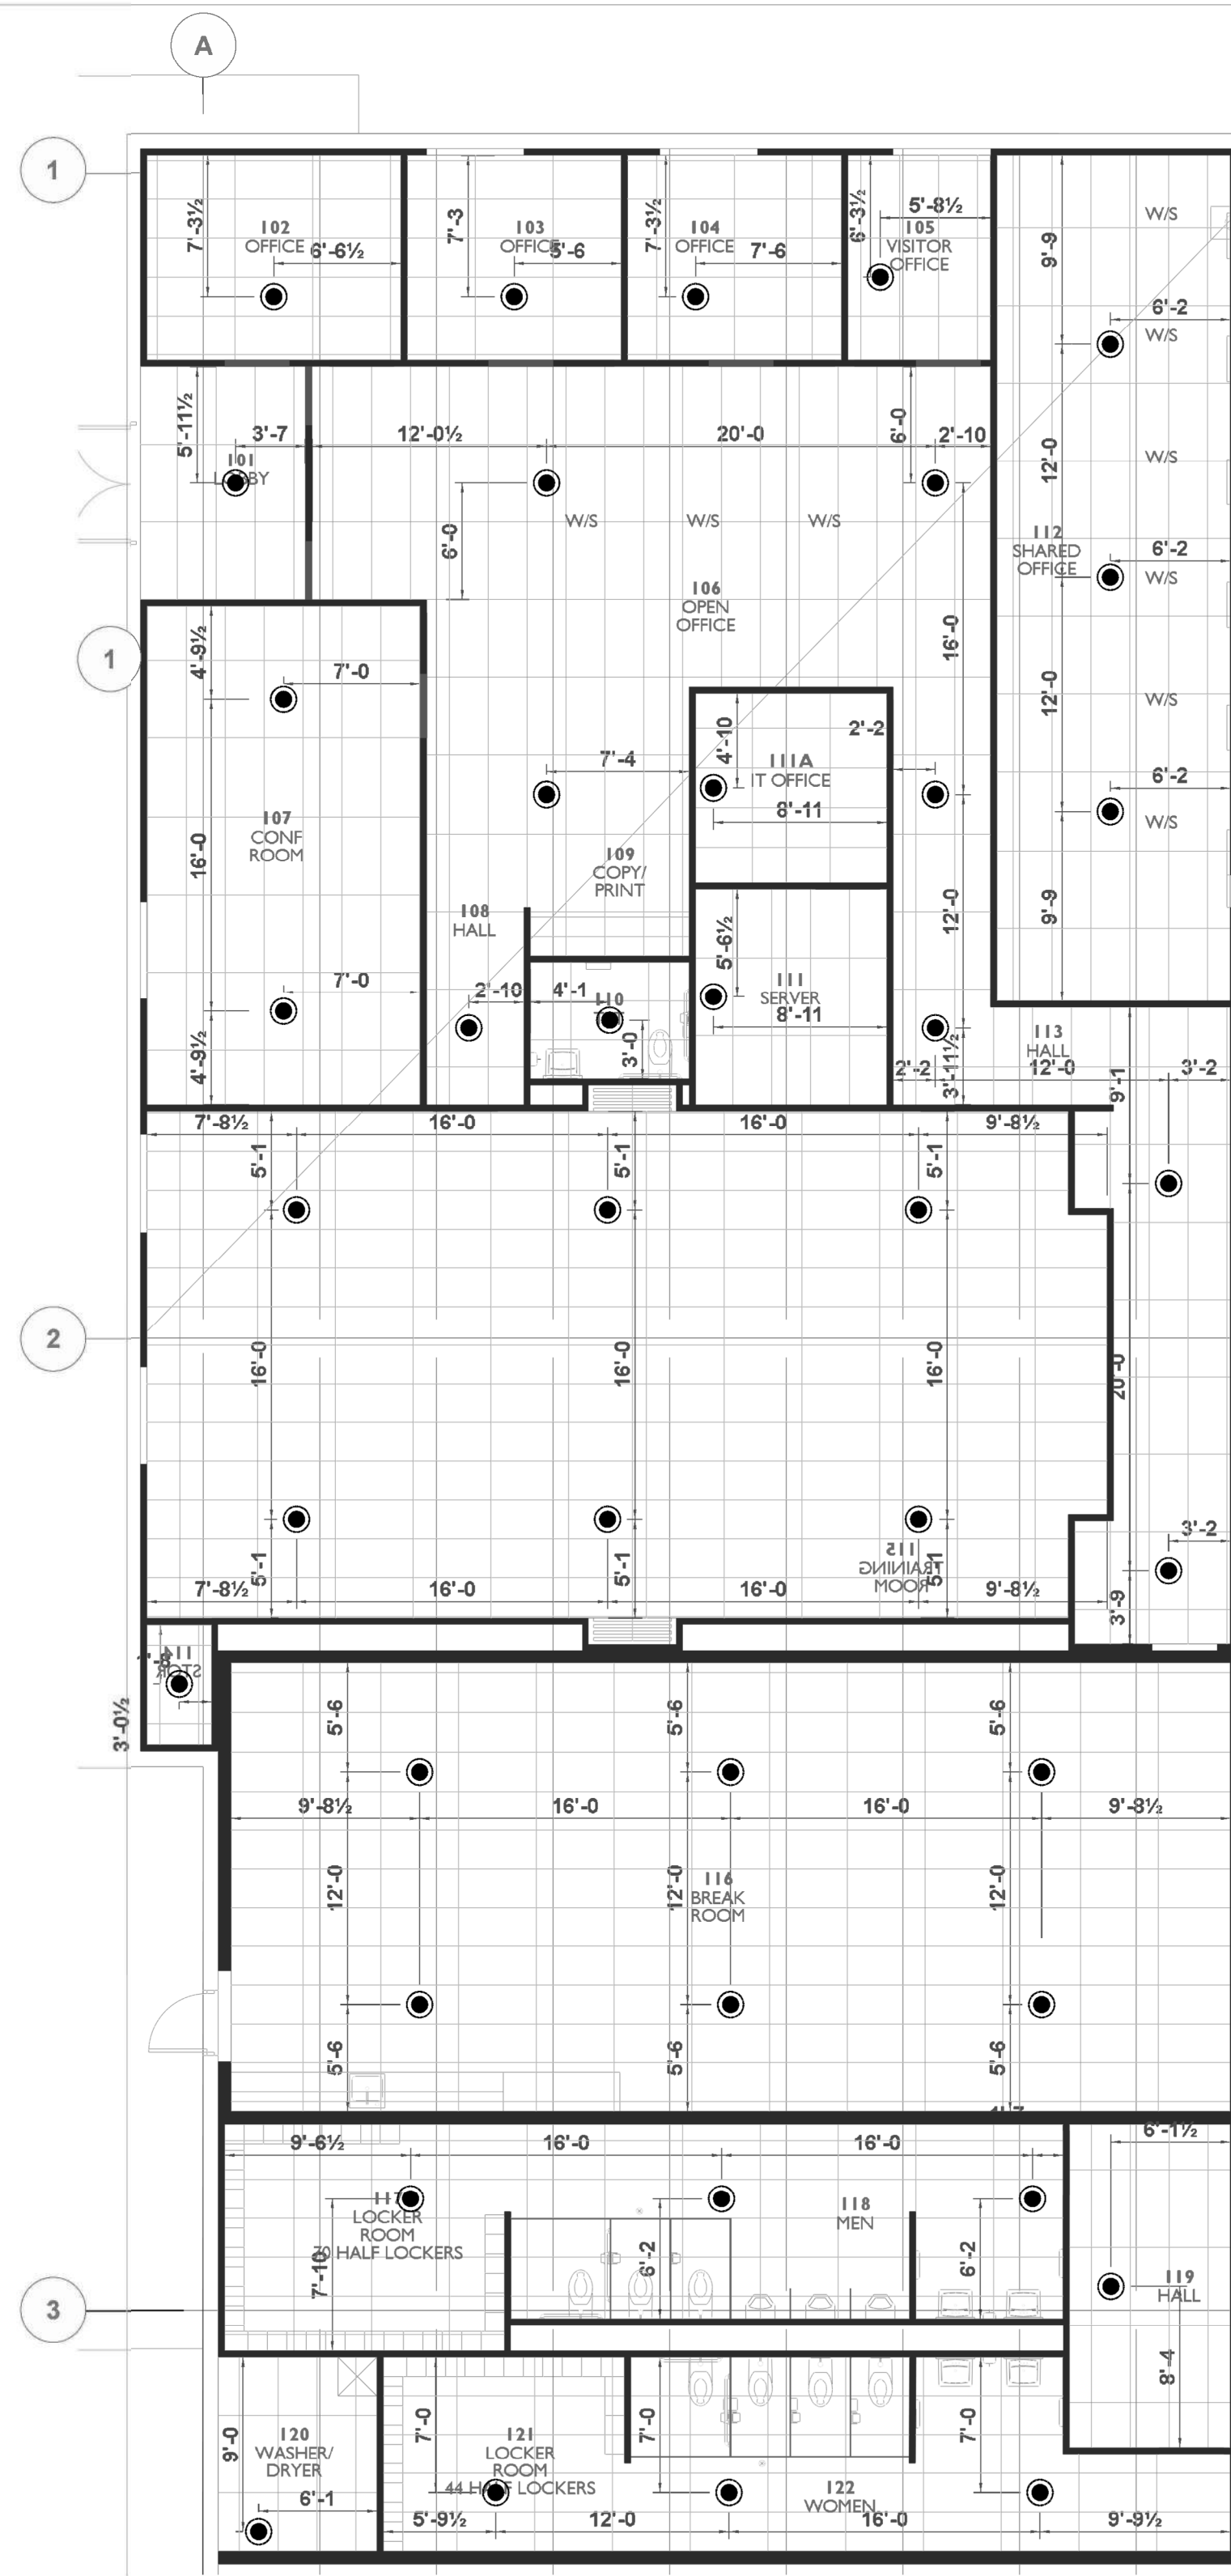

OFFICE SPRINKLER REFLECTED CEILING PLAN  
SCALE: 1/8" = 1'-0"

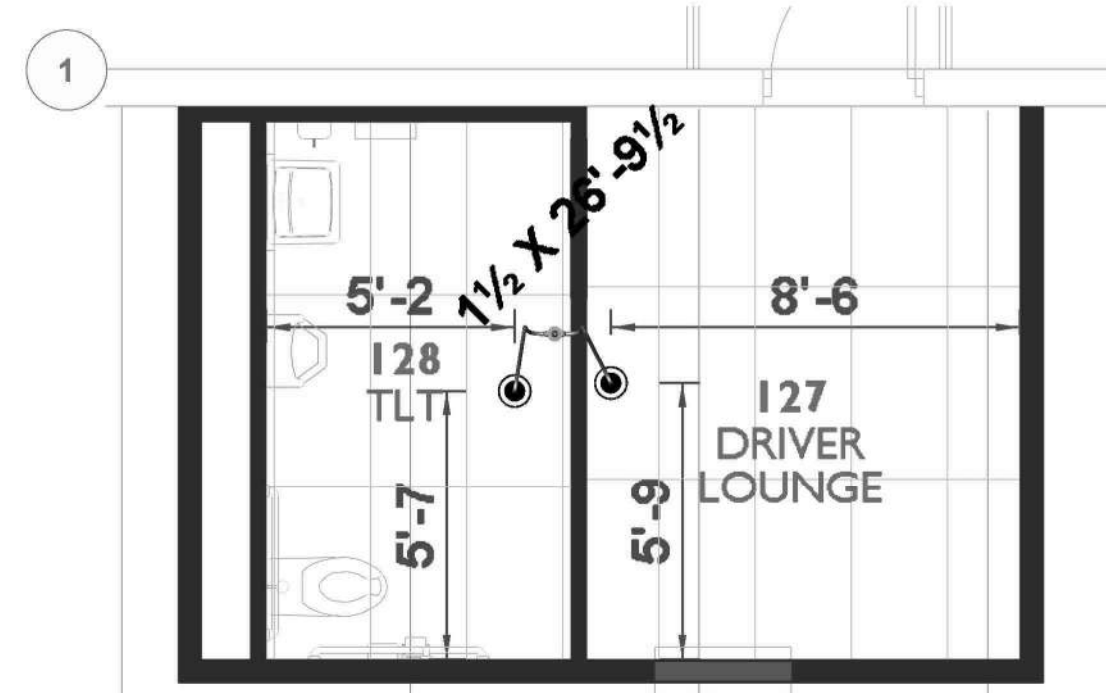


DRIVERS LOUNGE 1 REFLECTED CEILING PLAN  
SCALE: 1/4" = 1'-0"

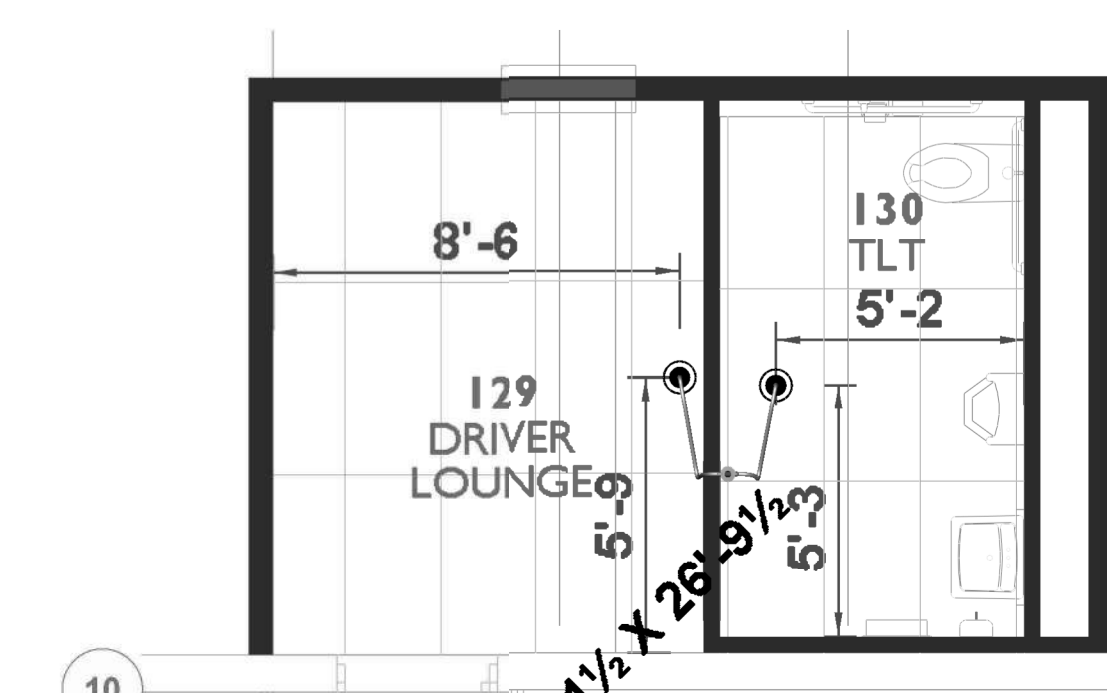

DRIVERS LOUNGE 2 REFLECTED CEILING PLAN  
SCALE: 1/4" = 1'-0"



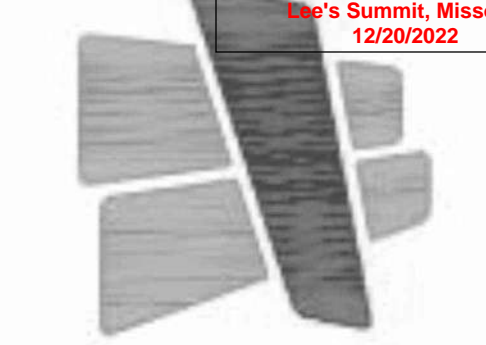

**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



CERTIFICATION



THIS DRAWING AND THE IDEAS, DESIGNS  
AND CONCEPTS CONTAINED HEREIN ARE  
THE EXCLUSIVE INTELLECTUAL PROPERTY OF  
CURRAN ARCHITECTURE, AND ARE NOT TO  
BE USED OR REPRODUCED, WHOLE OR IN  
PART, WITHOUT THE WRITTEN CONSENT OF  
CURRAN ARCHITECTURE.


PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING A LOT I  
NW CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES  
PERMIT SET 02.18.22  
TENANT IMPROVEMENT 09.07.22

210300  
**FP2.11**  
TENANT  
IMPROVEMENT  
COOLER PLAN

Hydraulic Information	
Remote Area Cooler	
OCCUPANCY CLASSIFICATION	ESFR
MIN. END HEAD PRESSURE	52.000 (ESFR)
TOTAL HOSE STREAMS	250.00
TOTAL HEADS FLOWING	12
K-FACTOR	16.8
TOTAL WATER REQUIRED	1708.14
TOTAL PRESSURE REQUIRED	73.255
BASE OF RISER (GPM)	1708.14
BASE OF RISER (PSI)	73.255
SAFETY MARGIN (PSI)	+16.353 (18.2%)

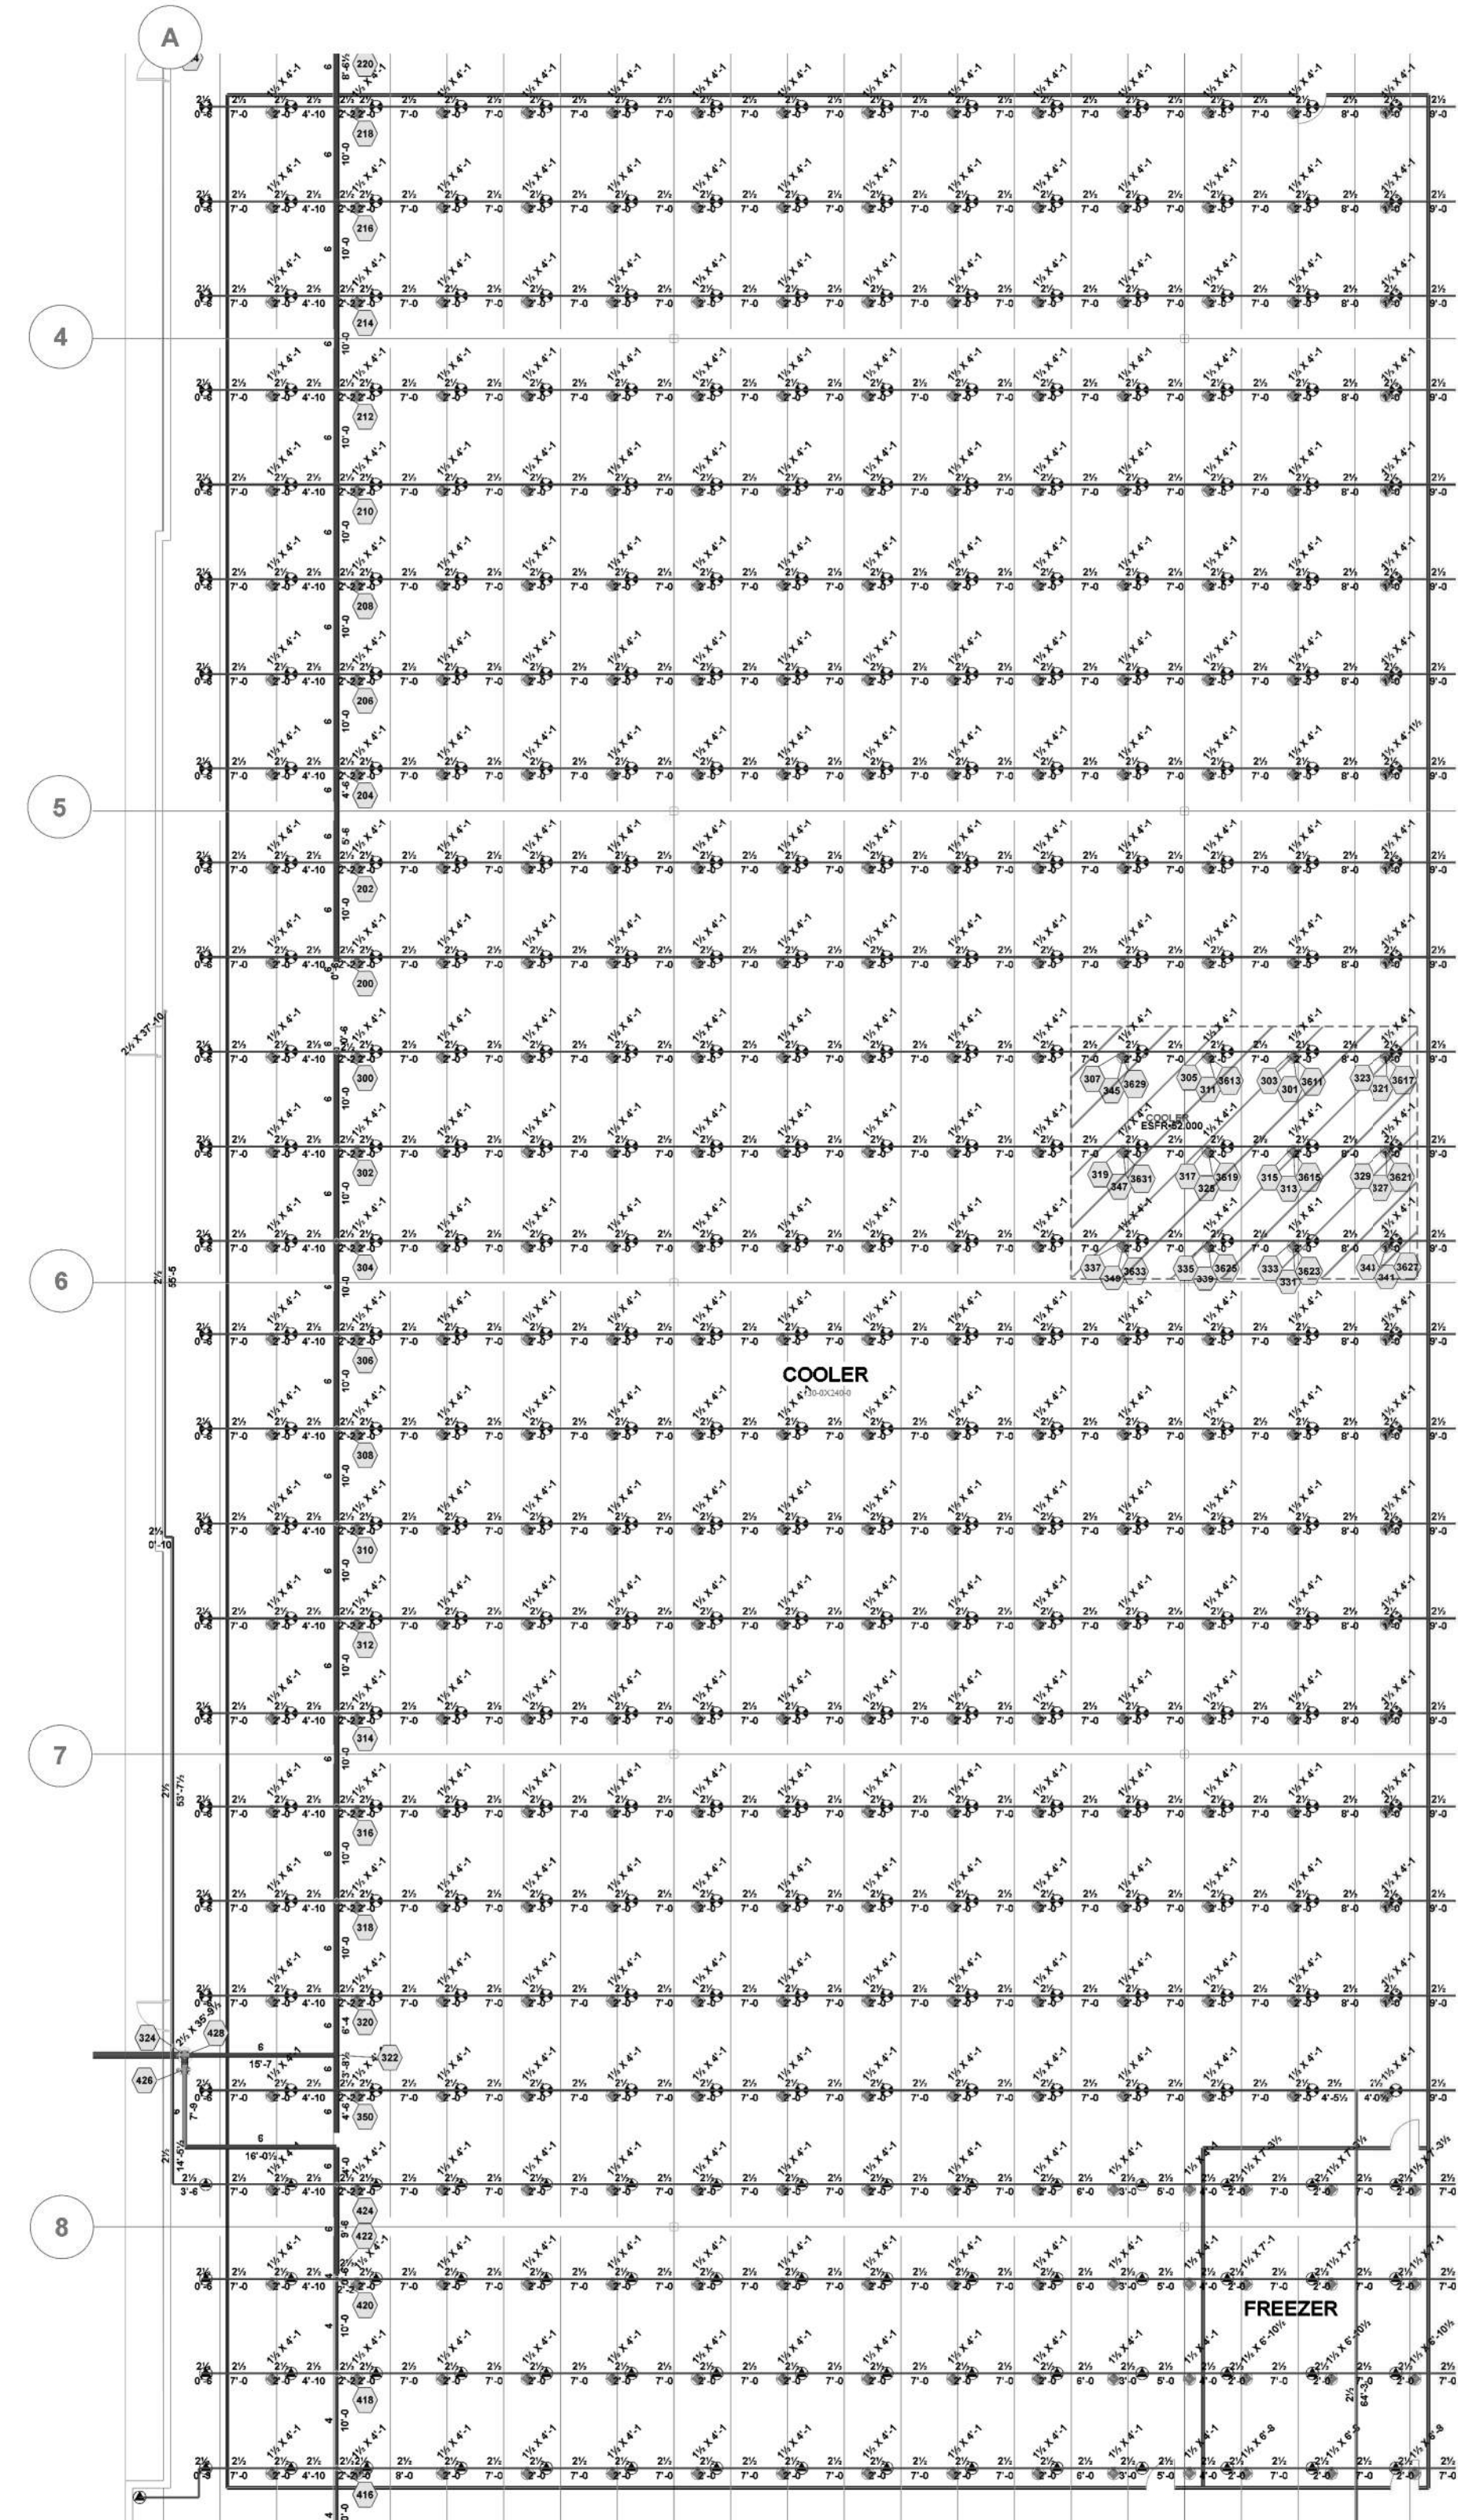


COOLER/FREEZER OVERHAD LAYOUT  
SCALE: 1/16" = 1'-0"





DRY BARREL OVERHEAD CONNECTION  
N.T.S.

\*\*COOLER CEILING ELEVATION: 6'-4 BELOW DECK  
\*\*COOLER CEILING THICKNESS: 0'-5  
\*\*BRANCHLINE CENTERLINES: 0'-8 BELOW DECK


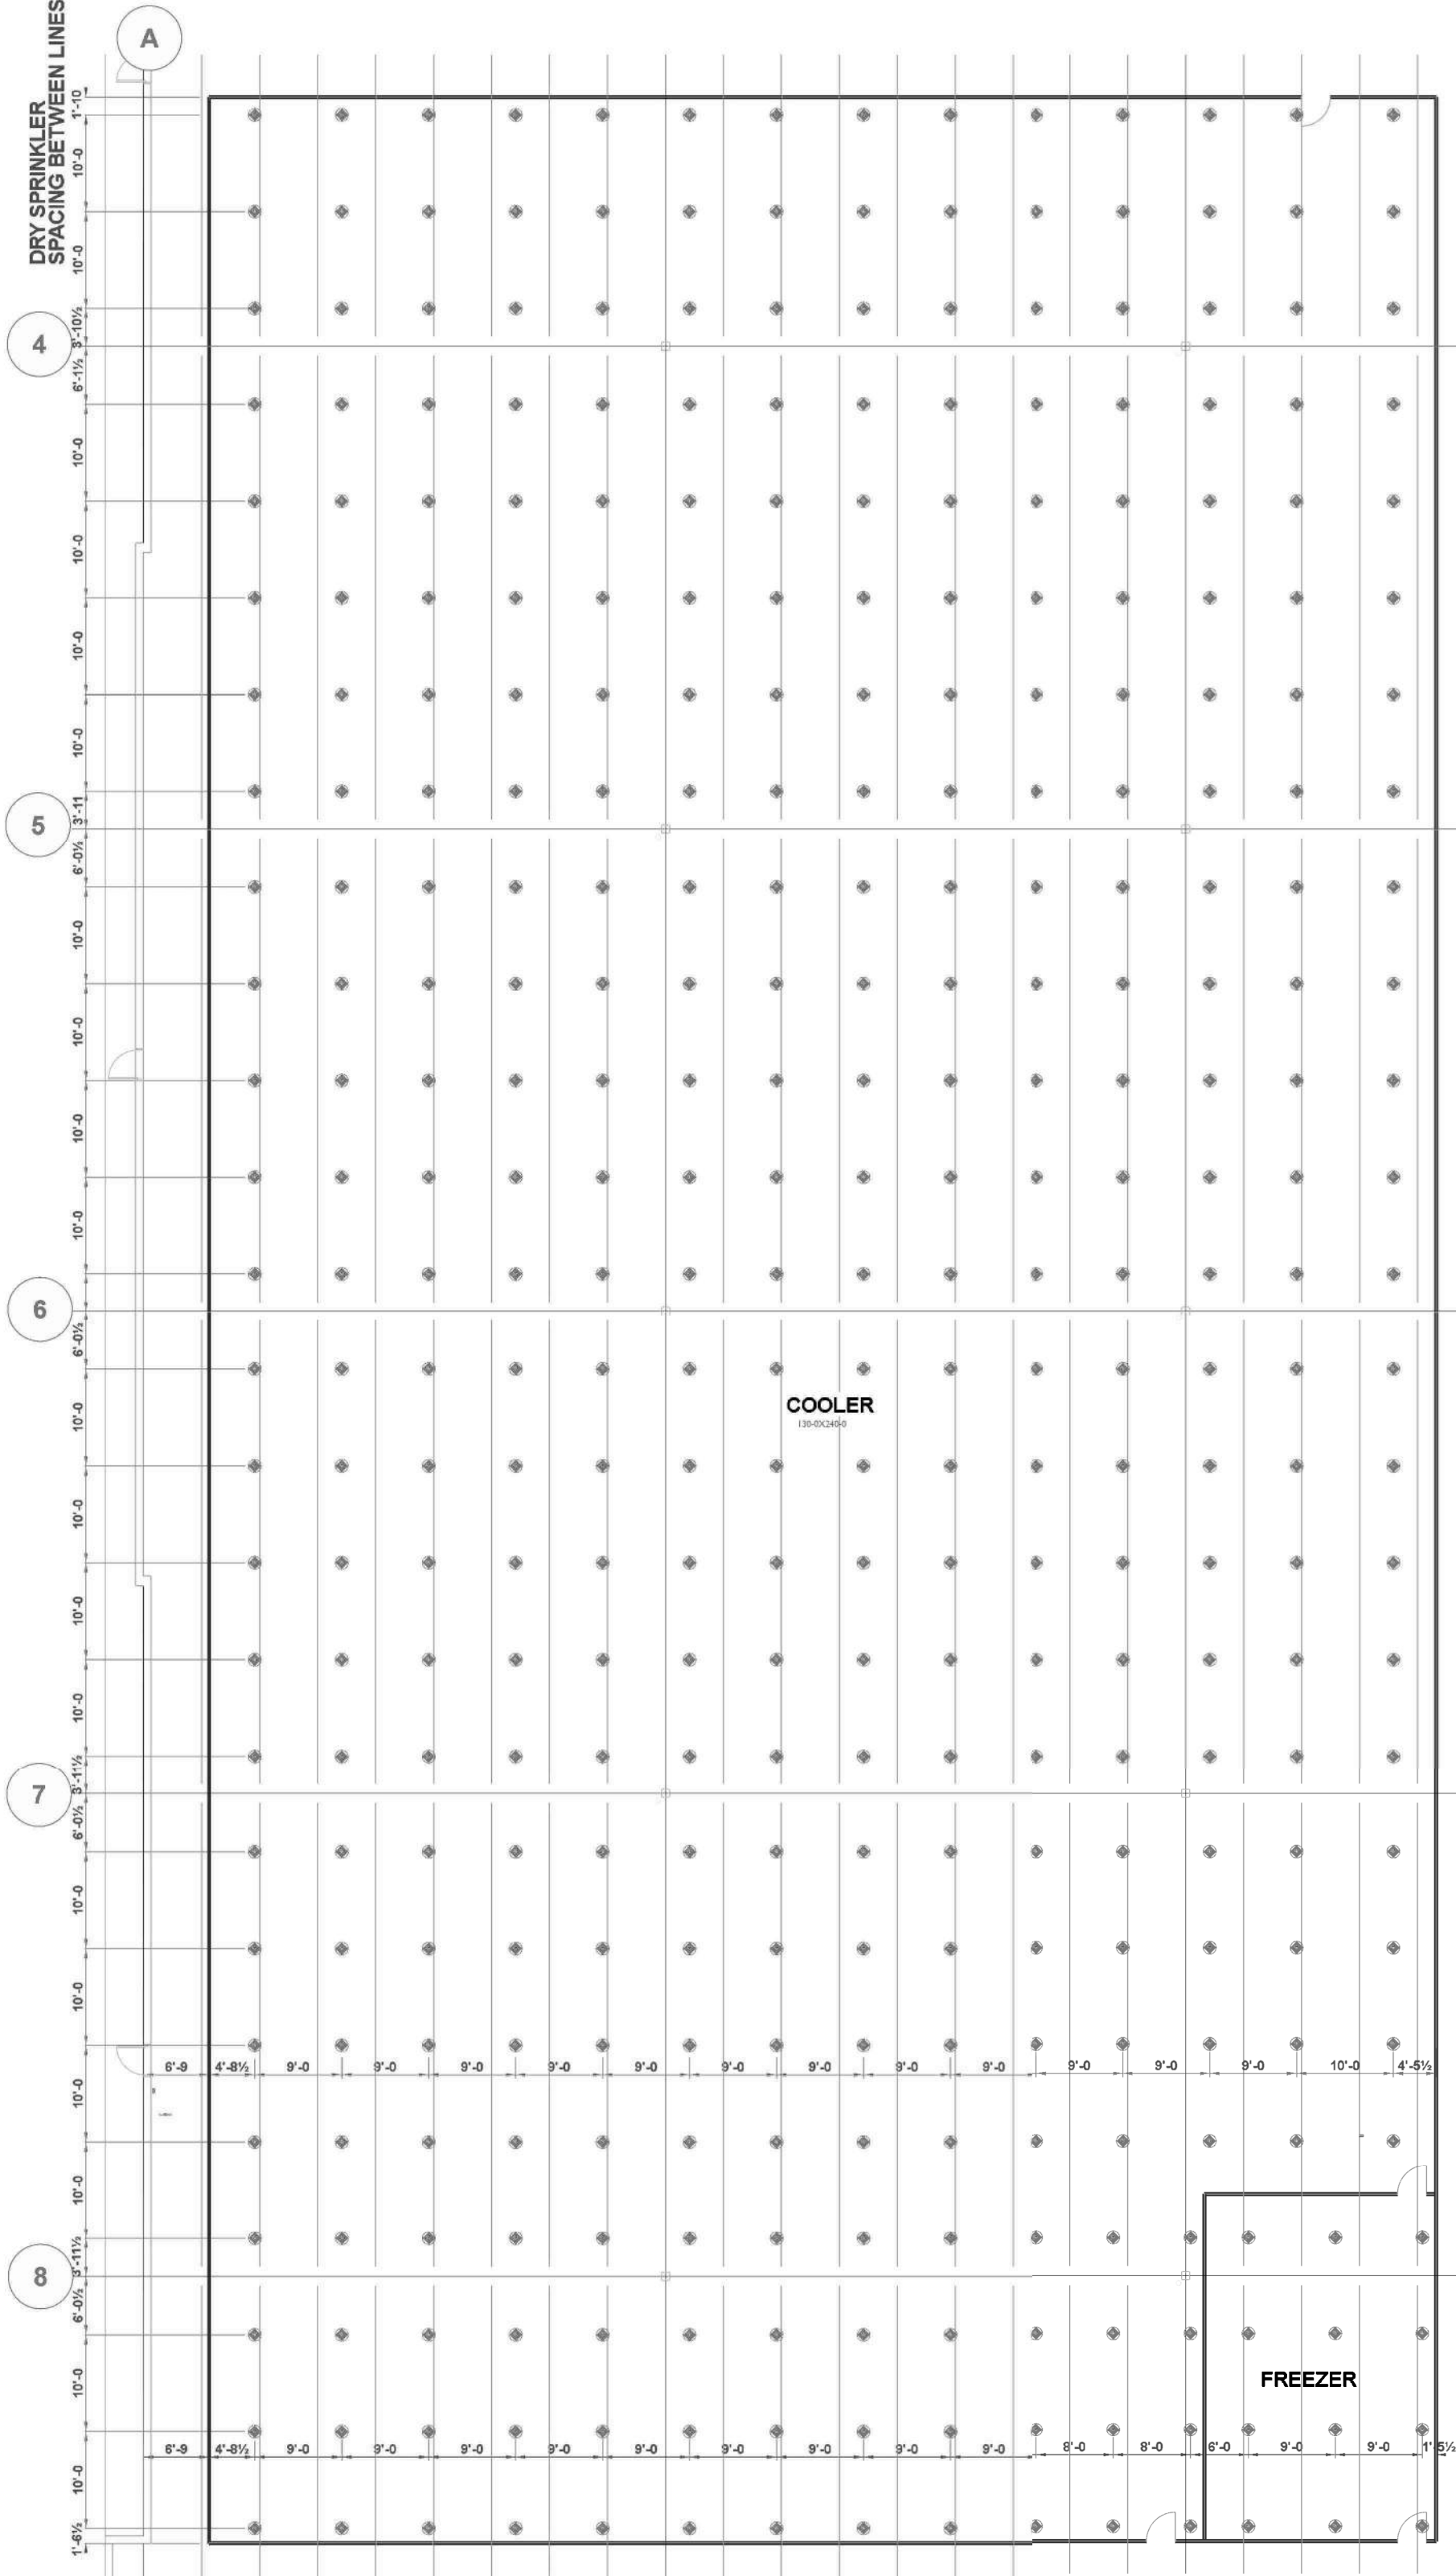


COOLER/FREEZER LAYOUT  
SCALE: 1/16" = 1'-0"

Sprinkler Legend											
SYMBOL	MANUFACTURER	SIN	MODEL	QUANTITY	K-FACTOR	TYPE	SIZE	RESPONSE	FINISH	TEMPERATURE	NOTE
	VICTAULIC	V4702	FL-QR/ST/ESFR	2054	16.8	PENDENT	3/4"	FAST	BRASS	200°F	
	VICTAULIC	V3406	V34	4	8	PENDENT	3/4"	QUICK	BRASS	200°F	
	VICTAULIC	V3428	ESFR	2754	22.4	PENDENT	1"	FAST	BRASS	200°F	
	VIKING	VK600	MICROFAST	48	5.6	PENDENT	1/2"	QUICK	CHROME	135°F	
	VIKING	VK3021		6	5.6	PENDENT	1/2"	QUICK	CHROME	135°F	
	VIKING	VK504	ESFR DRY	388	16.8	PENDENT	3/4"	QUICK	BRASS	205°F	
				TOTAL = 5234							

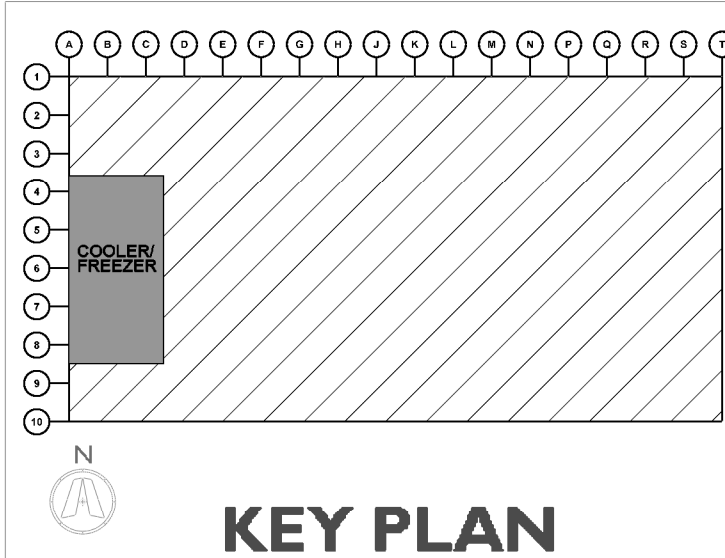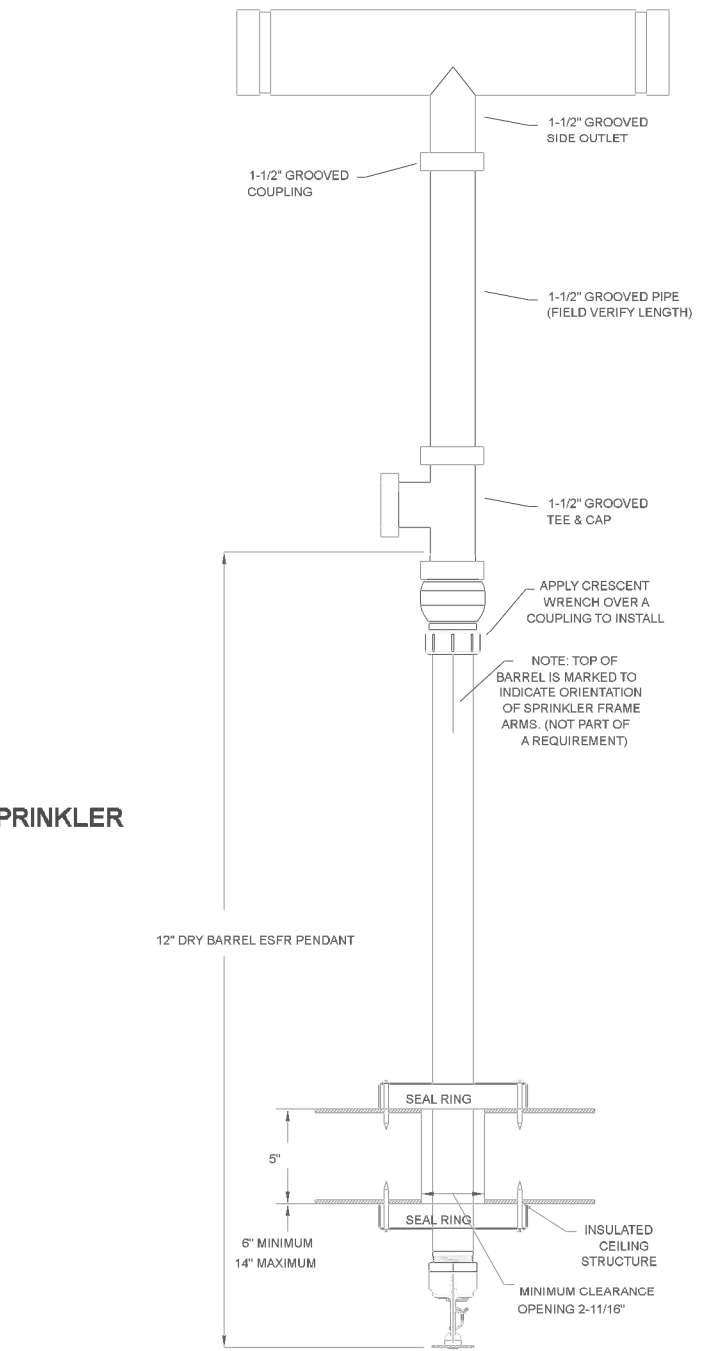



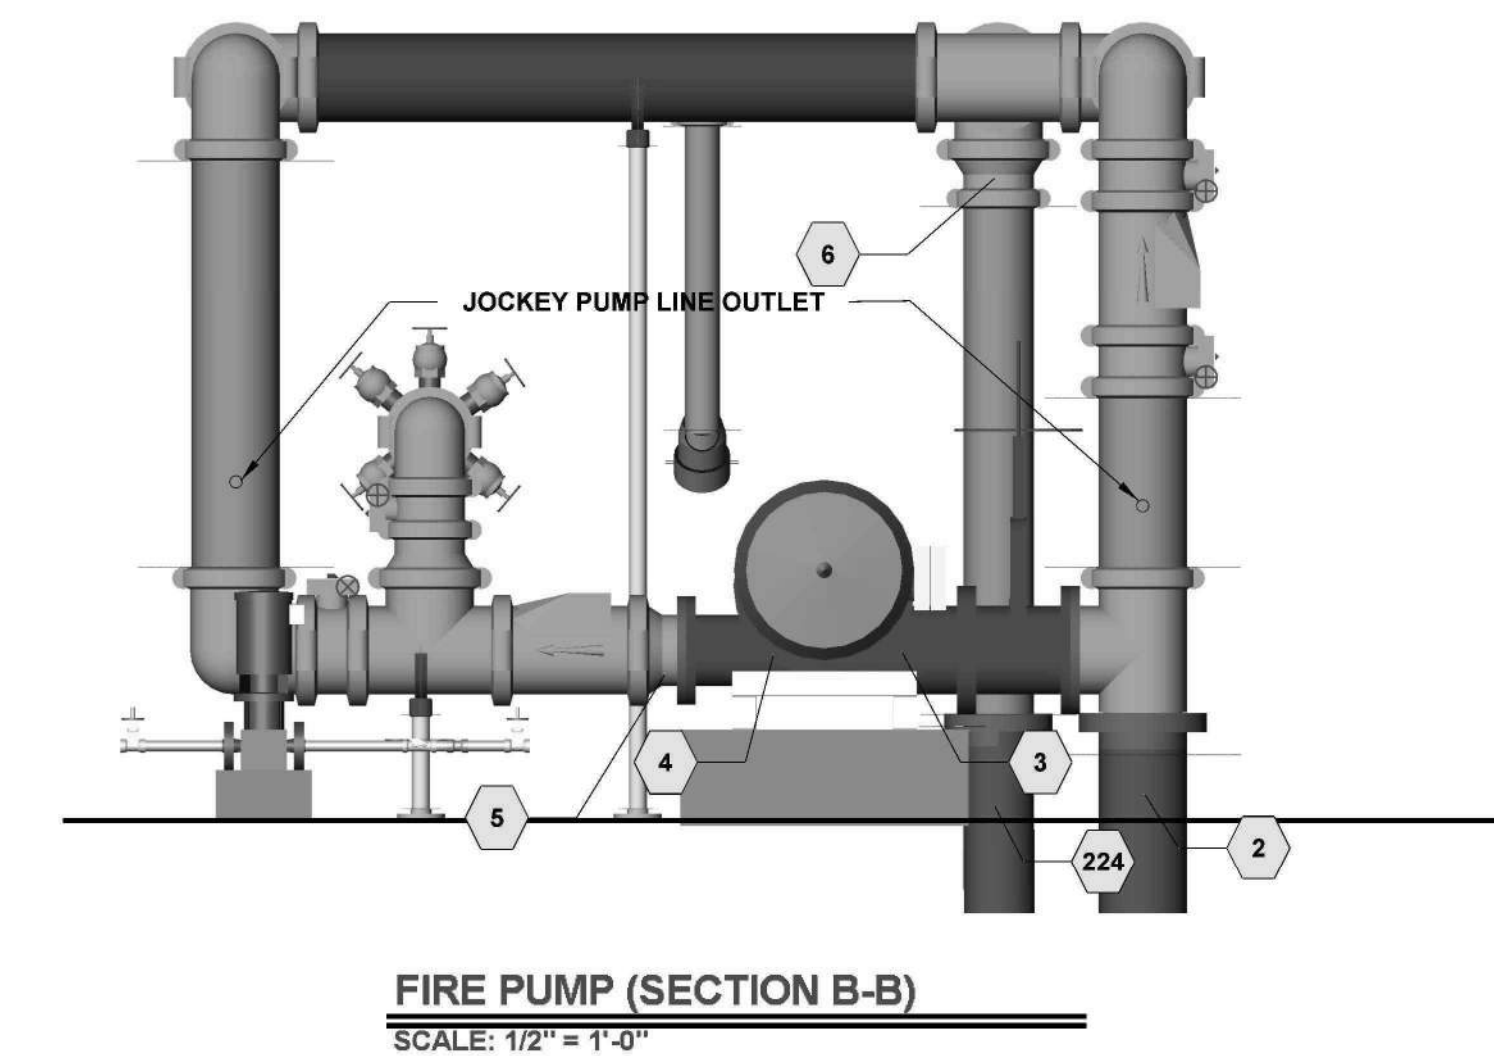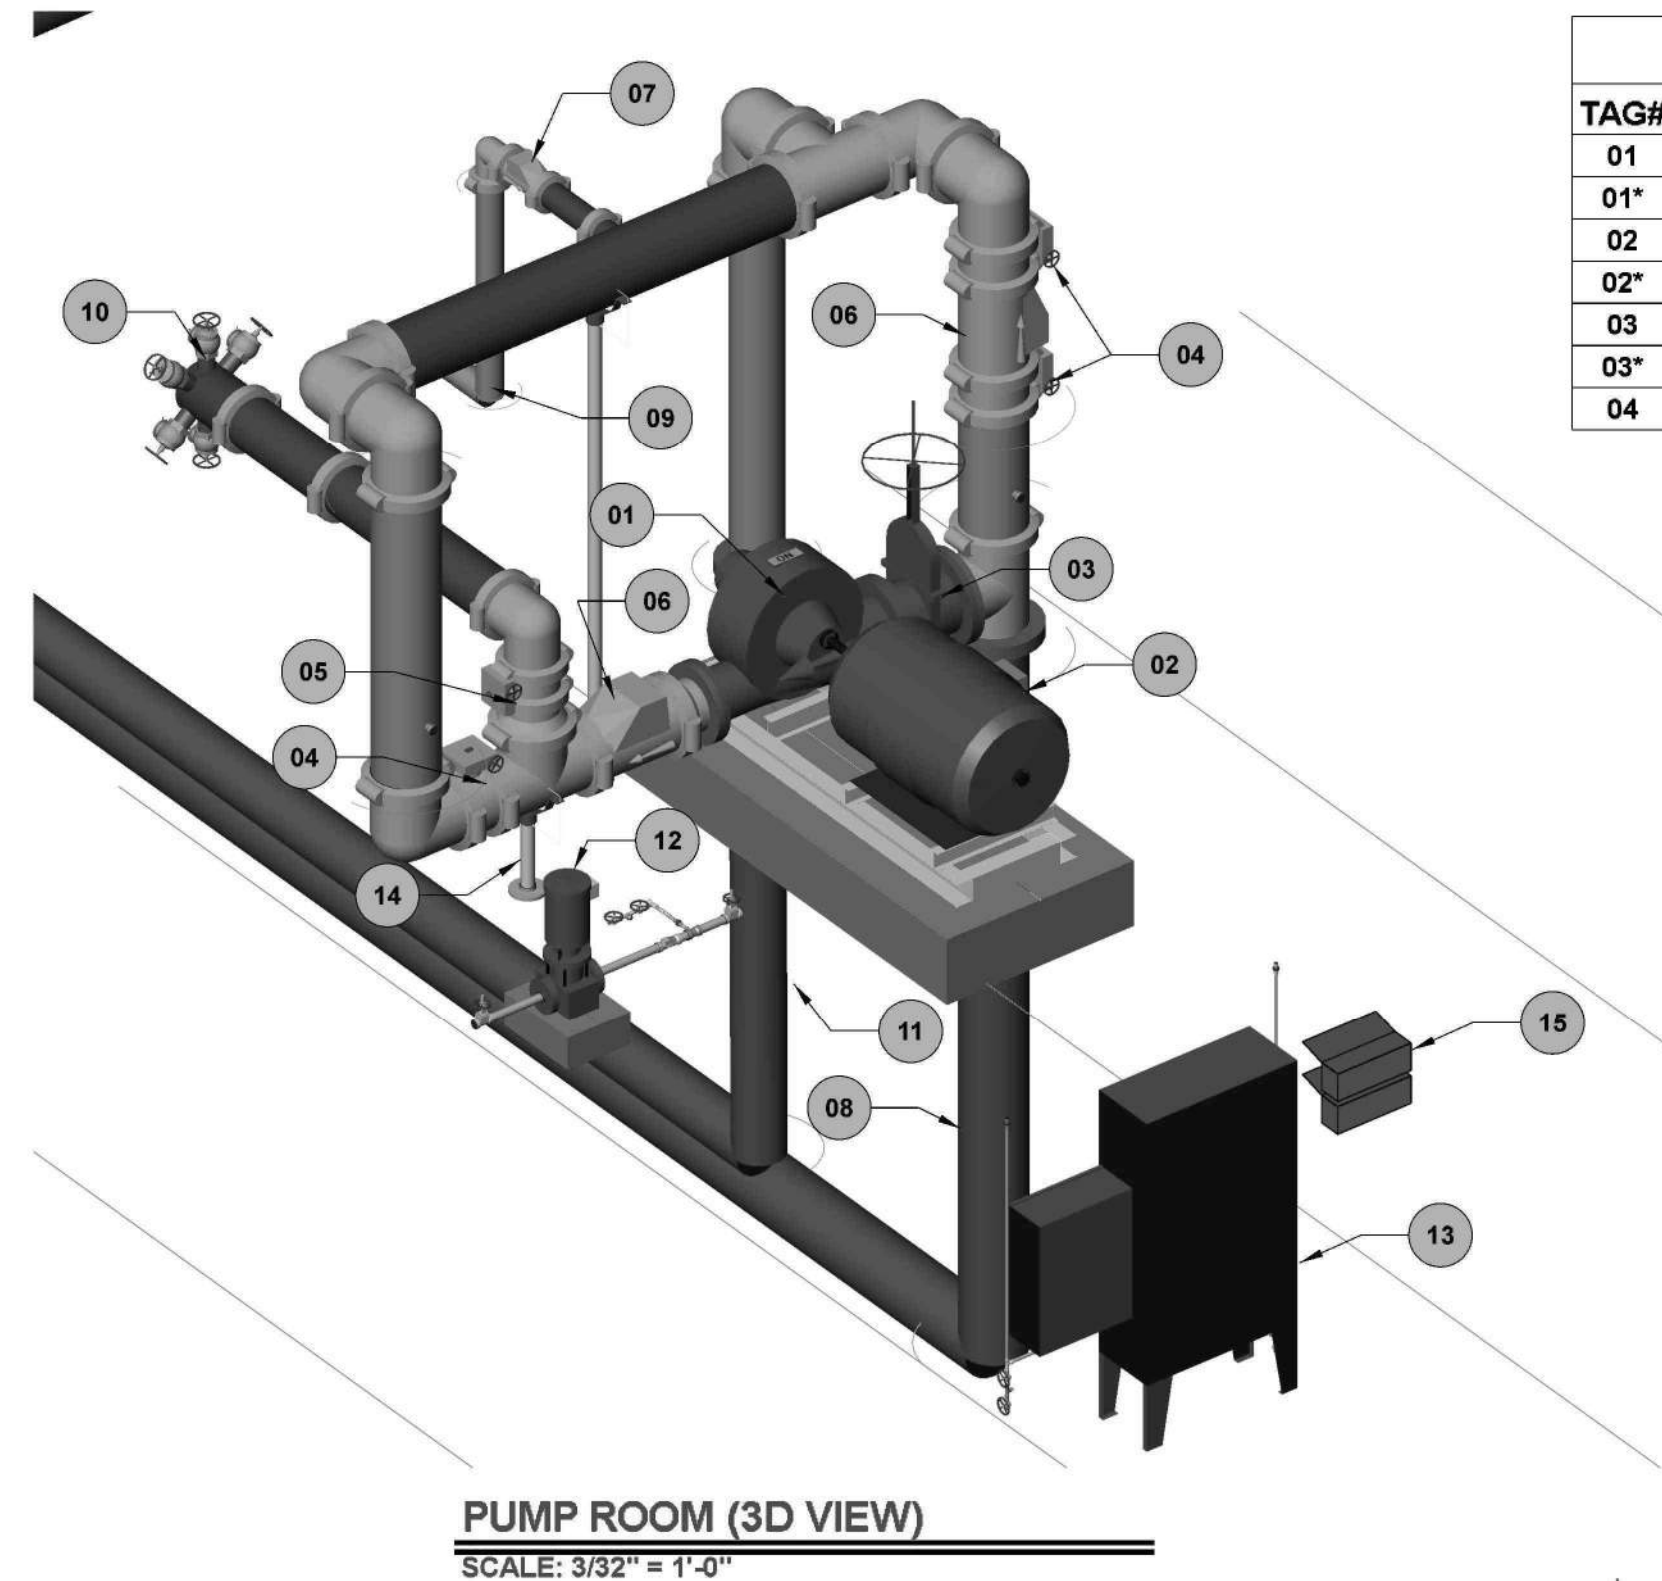

**FIRE PUMP NOTES:**  
-IN ADDITION TO THE FOLLOWING NOTES, ALL WORK AND MATERIAL SHALL CONFORM TO NFPA 13  
AND NFPA 20, AS APPLICABLE

**NFPA 20 REQUIREMENTS:**

**EQUIPMENT PROTECTION:**  
SUITABLE MEANS SHALL BE PROVIDED FOR MAINTAINING THE TEMPERATURE OF A PUMP ROOM OR PUMP HOUSE, WHERE  
REQUIRED, ABOVE 40 DEG F. ARTIFICIAL LIGHT SHALL BE PROVIDED IN THE PUMP ROOM OR PUMP HOUSE. EMERGENCY  
LIGHTING SHALL BE PROVIDED BY FIXED OR PORTABLE BATTERY OPERATED LIGHTS, INCLUDING FLASHLIGHTS.  
EMERGENCY LIGHTS SHALL NOT BE CONNECTED TO AN ENGINE STARTING BATTERY. PROVISION SHALL BE MADE FOR  
VENTILATION OF THE PUMP ROOM OR PUMP HOUSE. FLOORS SHALL BE PITCHED FOR ADEQUATE DRAINAGE OF ESCAPING  
WATER AWAY FROM CRITICAL EQUIPMENT SUCH AS THE PUMP, DRIVER, CONTROLLER, ECT. THE PUMP ROOM OR PUMP  
HOUSE SHALL BE PROVIDED WITH A FLOOR DRAIN THAT WILL DISCHARGE TO A FROST-FREE LOCATION.

**PIPE AND FITTINGS:**  
WHERE CORROSIVE CONDITIONS EXIST, THE STEEL SUCTION PIPE SHALL BE GALVANIZED. ALL PROVISIONS FOR WELDED  
PIPE SHALL BE IN ACCORDANCE WITH NFPA 61B, STANDARD FOR FIRE  
PREVENTION DURING WELDING, CUTTING, AND OTHER HOT WORK.

**SUCTION PIPE AND FITTINGS:**  
THE SUCTION PIPE SHALL BE INSTALLED AND TESTED IN ACCORDANCE WITH NFPA. A BY-PASS SHALL BE INSTALLED  
AROUND THE PUMP WHEN THE SUCTION PRESSURE IS OF MATERIAL VALUE WITHOUT THE PUMP. THE PIPE SIZE OF THE  
BY-PASS SHALL BE AS LARGE AS THE SIZE REQUIRED FOR SUCTION PIPE IN NFPA 20. THE BY-PASS CONTROL VALVES  
SHALL BE NORMALLY OPEN



**DISCHARGE PIPE:**  
SHALL BE HYDROSTATICALLY TESTED IN ACCORDANCE WITH NFPA 13. THE SIZE OF THE PUMP DISCHARGE PIPE AND  
FITTINGS SHALL BE NOT LESS THAN THAT GIVEN IN NFPA 20.

**ELECTRIC DRIVE FOR PUMPS:**  
ALL ELECTRICAL WORK TO SUPPLY POWER TO THE FIRE PUMP SHALL BE IN ACCORDANCE WITH CHAPTER 6 OF NFPA 20.  
ELECTRICAL WORK SHALL COMPLY WITH NFPA 70, ARTICLE 695 AND OTHER APPLICABLE ARTICLES. THE FIRE PUMP  
FEEDER CIRCUIT CONDUCTORS AND THEIR ACCESSORIES SHALL BE DEDICATED AND PROTECTED TO RESIST POSSIBLE  
DAMAGE BY FIRE, STRUCTURAL FAILURE, OR OPERATIONAL ACCIDENT. THE SUPPLY CONDUCTORS DIRECTLY CONNECT  
THE POWER SOURCE TO THE LISTED FIRE PUMP CONTROLLER.


**FIRE PUMP CONTROLLER:**  
SHALL BE WIRED FOR MANUAL SHUTDOWN. FIRE PUMP SHALL BE MONITORED FOR THE FOLLOWING CONDITIONS: FIRE  
PUMP OR MOTOR RUNNING, LOSS OF PHASE, PHASE REVERSAL.

FIRE PUMP RISER BANK MATERIAL LIST	
TAG#	MATERIAL CALL OUT
01	6" RISER MANIFOLD W/ FLOW SWITCH, INSP. TEST AND 2" MAIN DRAIN, & PRESSURE RELIEF VALVES
01*	8" RISER MANIFOLD W/ FLOW SWITCH, INSP. TEST AND 2" MAIN DRAIN, & PRESSURE RELIEF VALVES
02	6" CHECK VALVE
02*	8" CHECK VALVE
03	6" BUTTERFLY VALVE W/ TAMPER (NORMALLY OPEN)
03*	8" BUTTERFLY VALVE W/ TAMPER (NORMALLY OPEN)
04	8" RISER BANK HEADER


FIRE PUMP ROOM MATERIAL LIST	
TAG#	MATERIAL CALL OUT
01	2000 GPM @ 60 PSI 10X8 FIRE PUMP
02	SPP 100 HP ELECTRIC MOTOR
03	10" FLG OS&Y GATE VALVE W/ TAMPER (NORMALLY OPEN)
04	10" BUTTERFLY VALVE W/ TAMPER (NORMALLY OPEN)
05	8" BUTTERFLY VALVE W/ TAMPER (NORMALLY CLOSED)
06	10" CHECK VALVE
07	4" CHECK VALVE
08	10" UNDERGROUND SUPPLY PIPING
09	4" FDC PIPING W/ STORZ TYPE CONNECTION
10	8X2½(6) TEST HEADER
11	10" WATER DISCHARGE PIPING TO FIRE LOOP
12	2 HP JOCKEY PUMP ASSEMBLY (15 GPM @ 104 PSI)
13	ELECTRIC & JOCKEY PUMP CONTROLLERS
14	10" PIPE STAND
15	SPARE HEAD BOXES

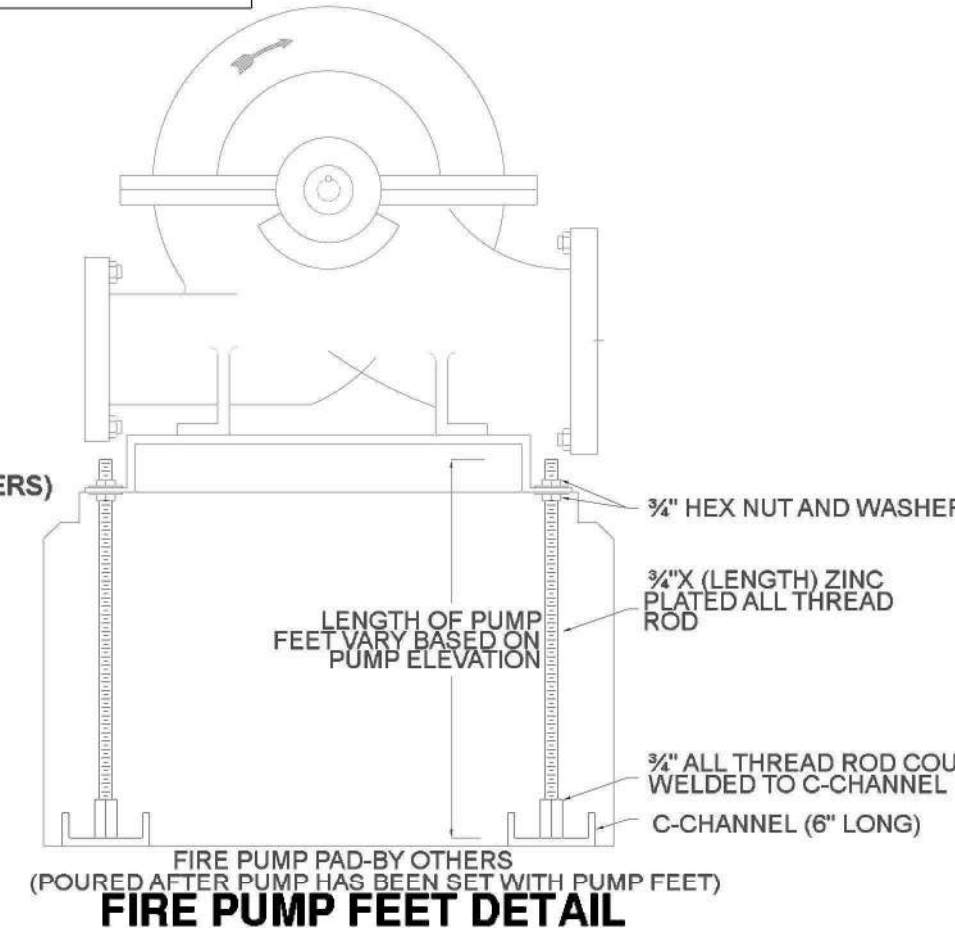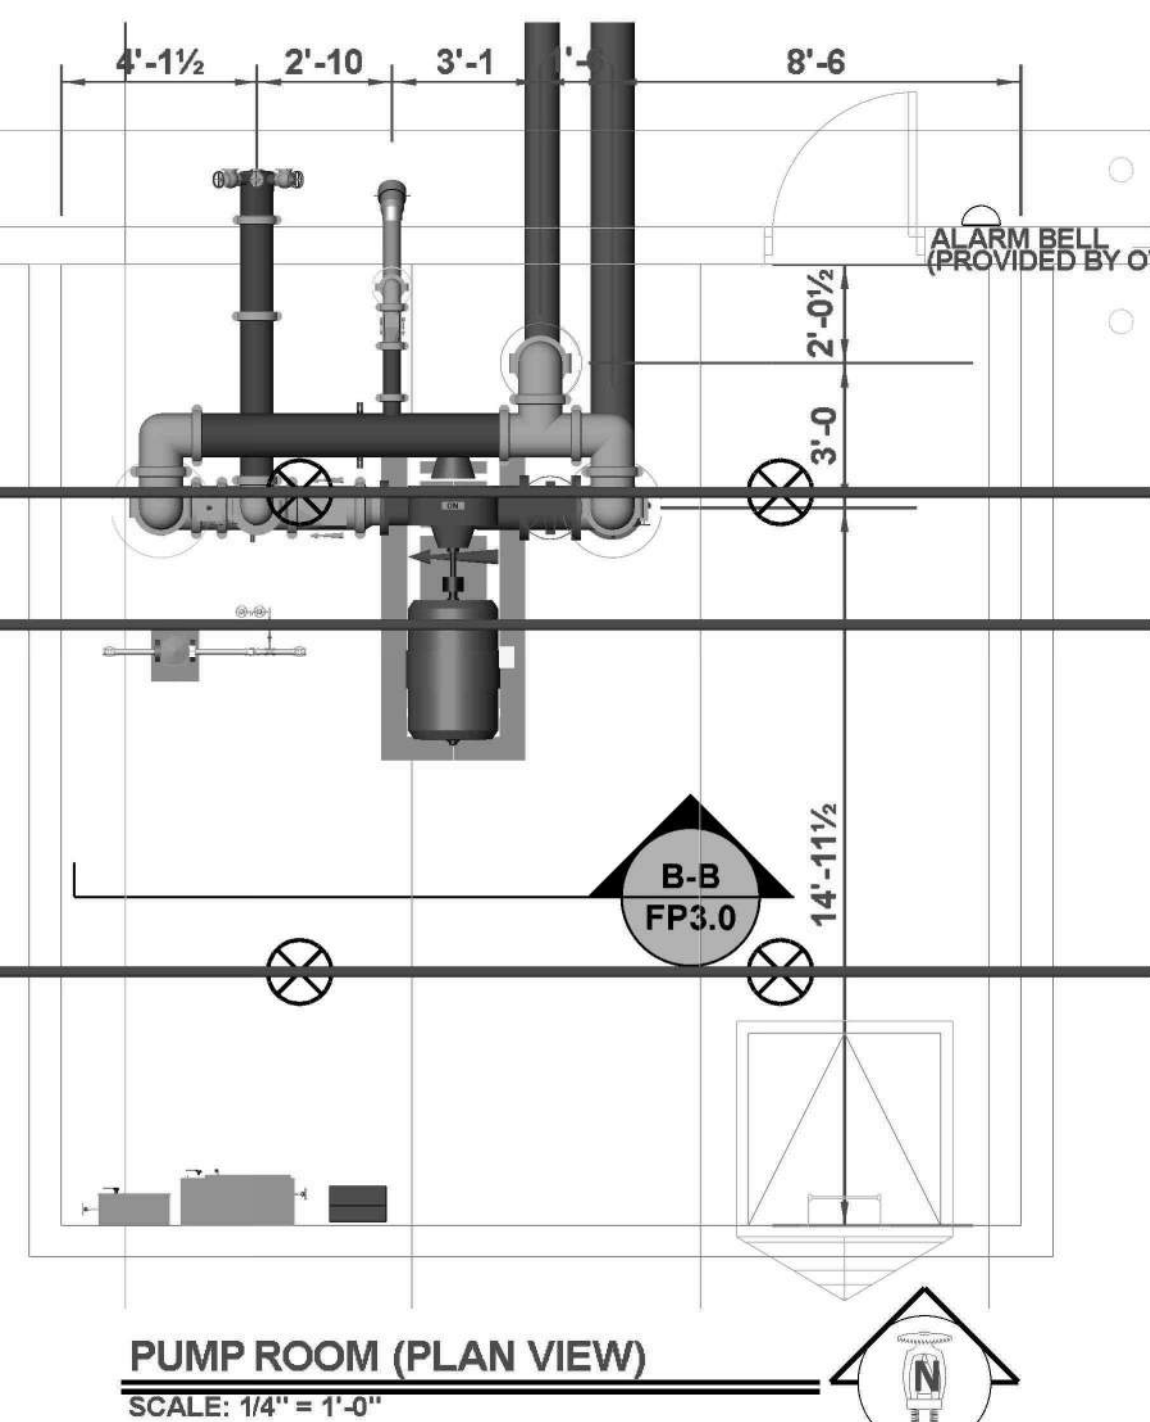

NOTE: ALL FIRE PROTECTION PIPING STUB-UPS  
WHETHER INSIDE OR OUTSIDE A BUILDING  
(INCLUDING PUMP ROOMS), SHALL BE INSTALLED  
UTILIZING THE "2-HOLE METHOD" ON ALL FLANGES.  
THE FLANGE SHALL BE INSTALLED WITH THE BOLT  
HOLES ALIGNED SO THAT FITTING, VALVES, AND  
EQUIPMENT ARE IN A SQUARE ALIGNMENT WITH  
ADJACENT WALLS AND FLOOR.


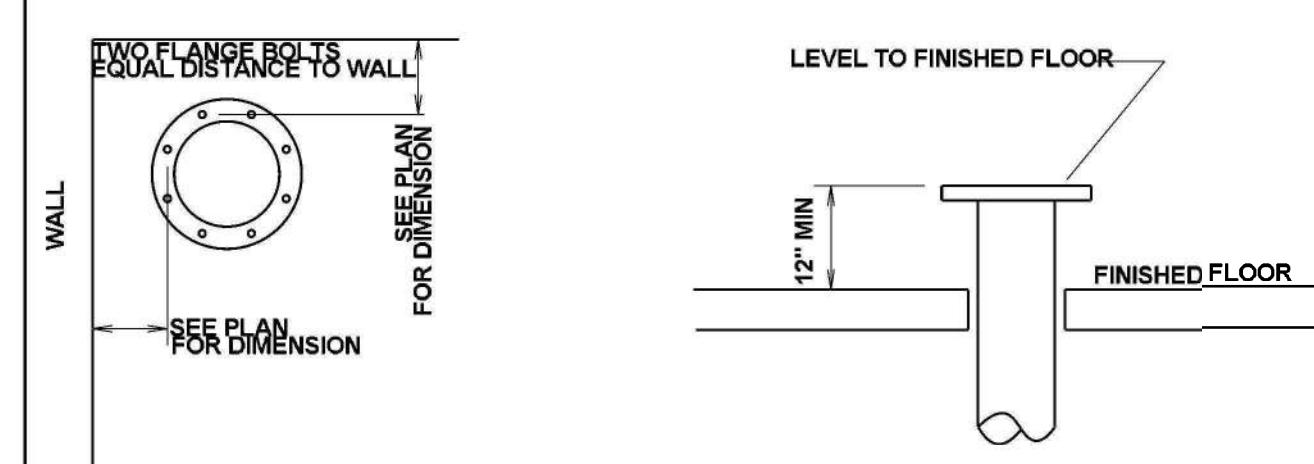


**INCOMING FIRE PROTECTION SUPPLY DETAIL**  
NOT TO SCALE


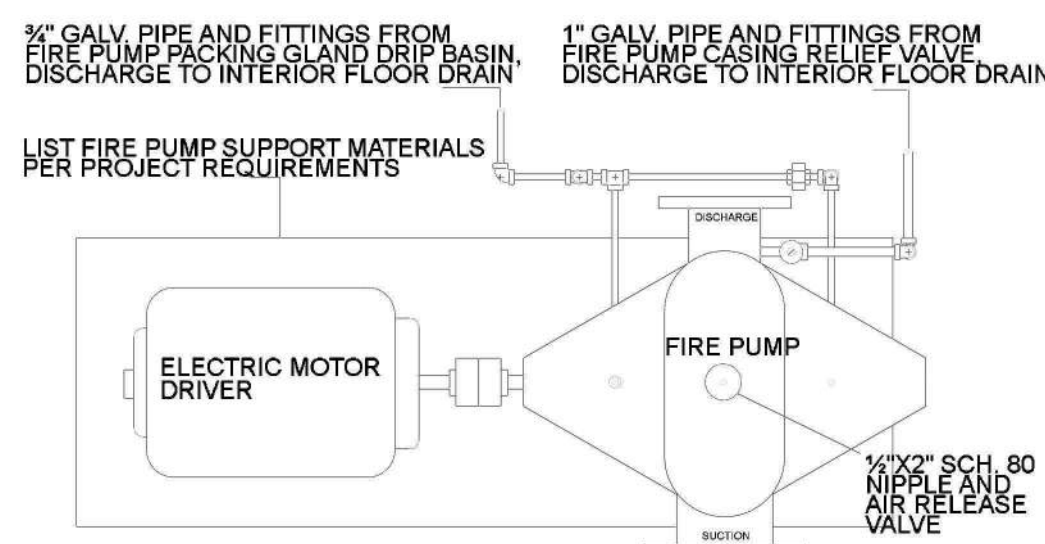


**FIRE PUMP AND JOCKEY PUMP SENSING SCHEMATIC**  
NO SCALE

**ELECTRIC FIRE PUMP SCHEMATIC**  
NO SCALE

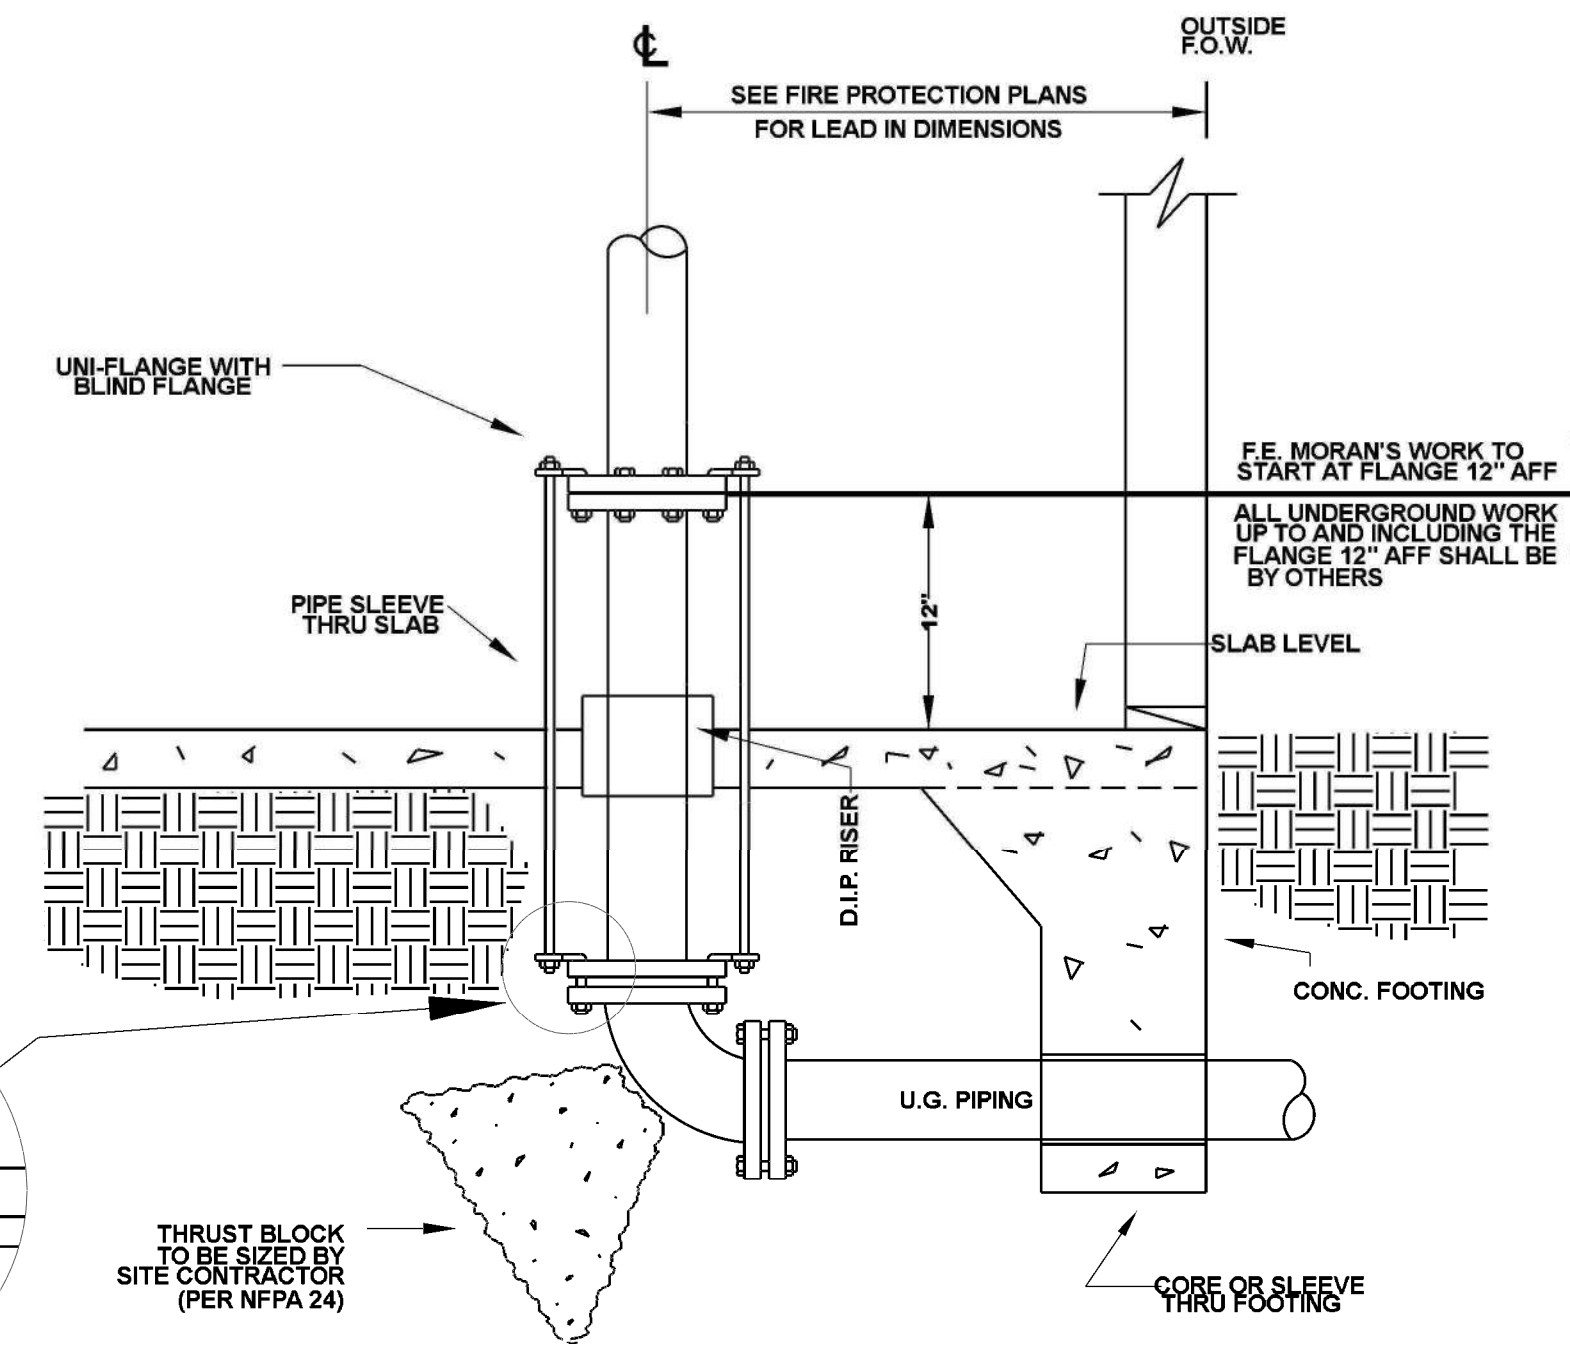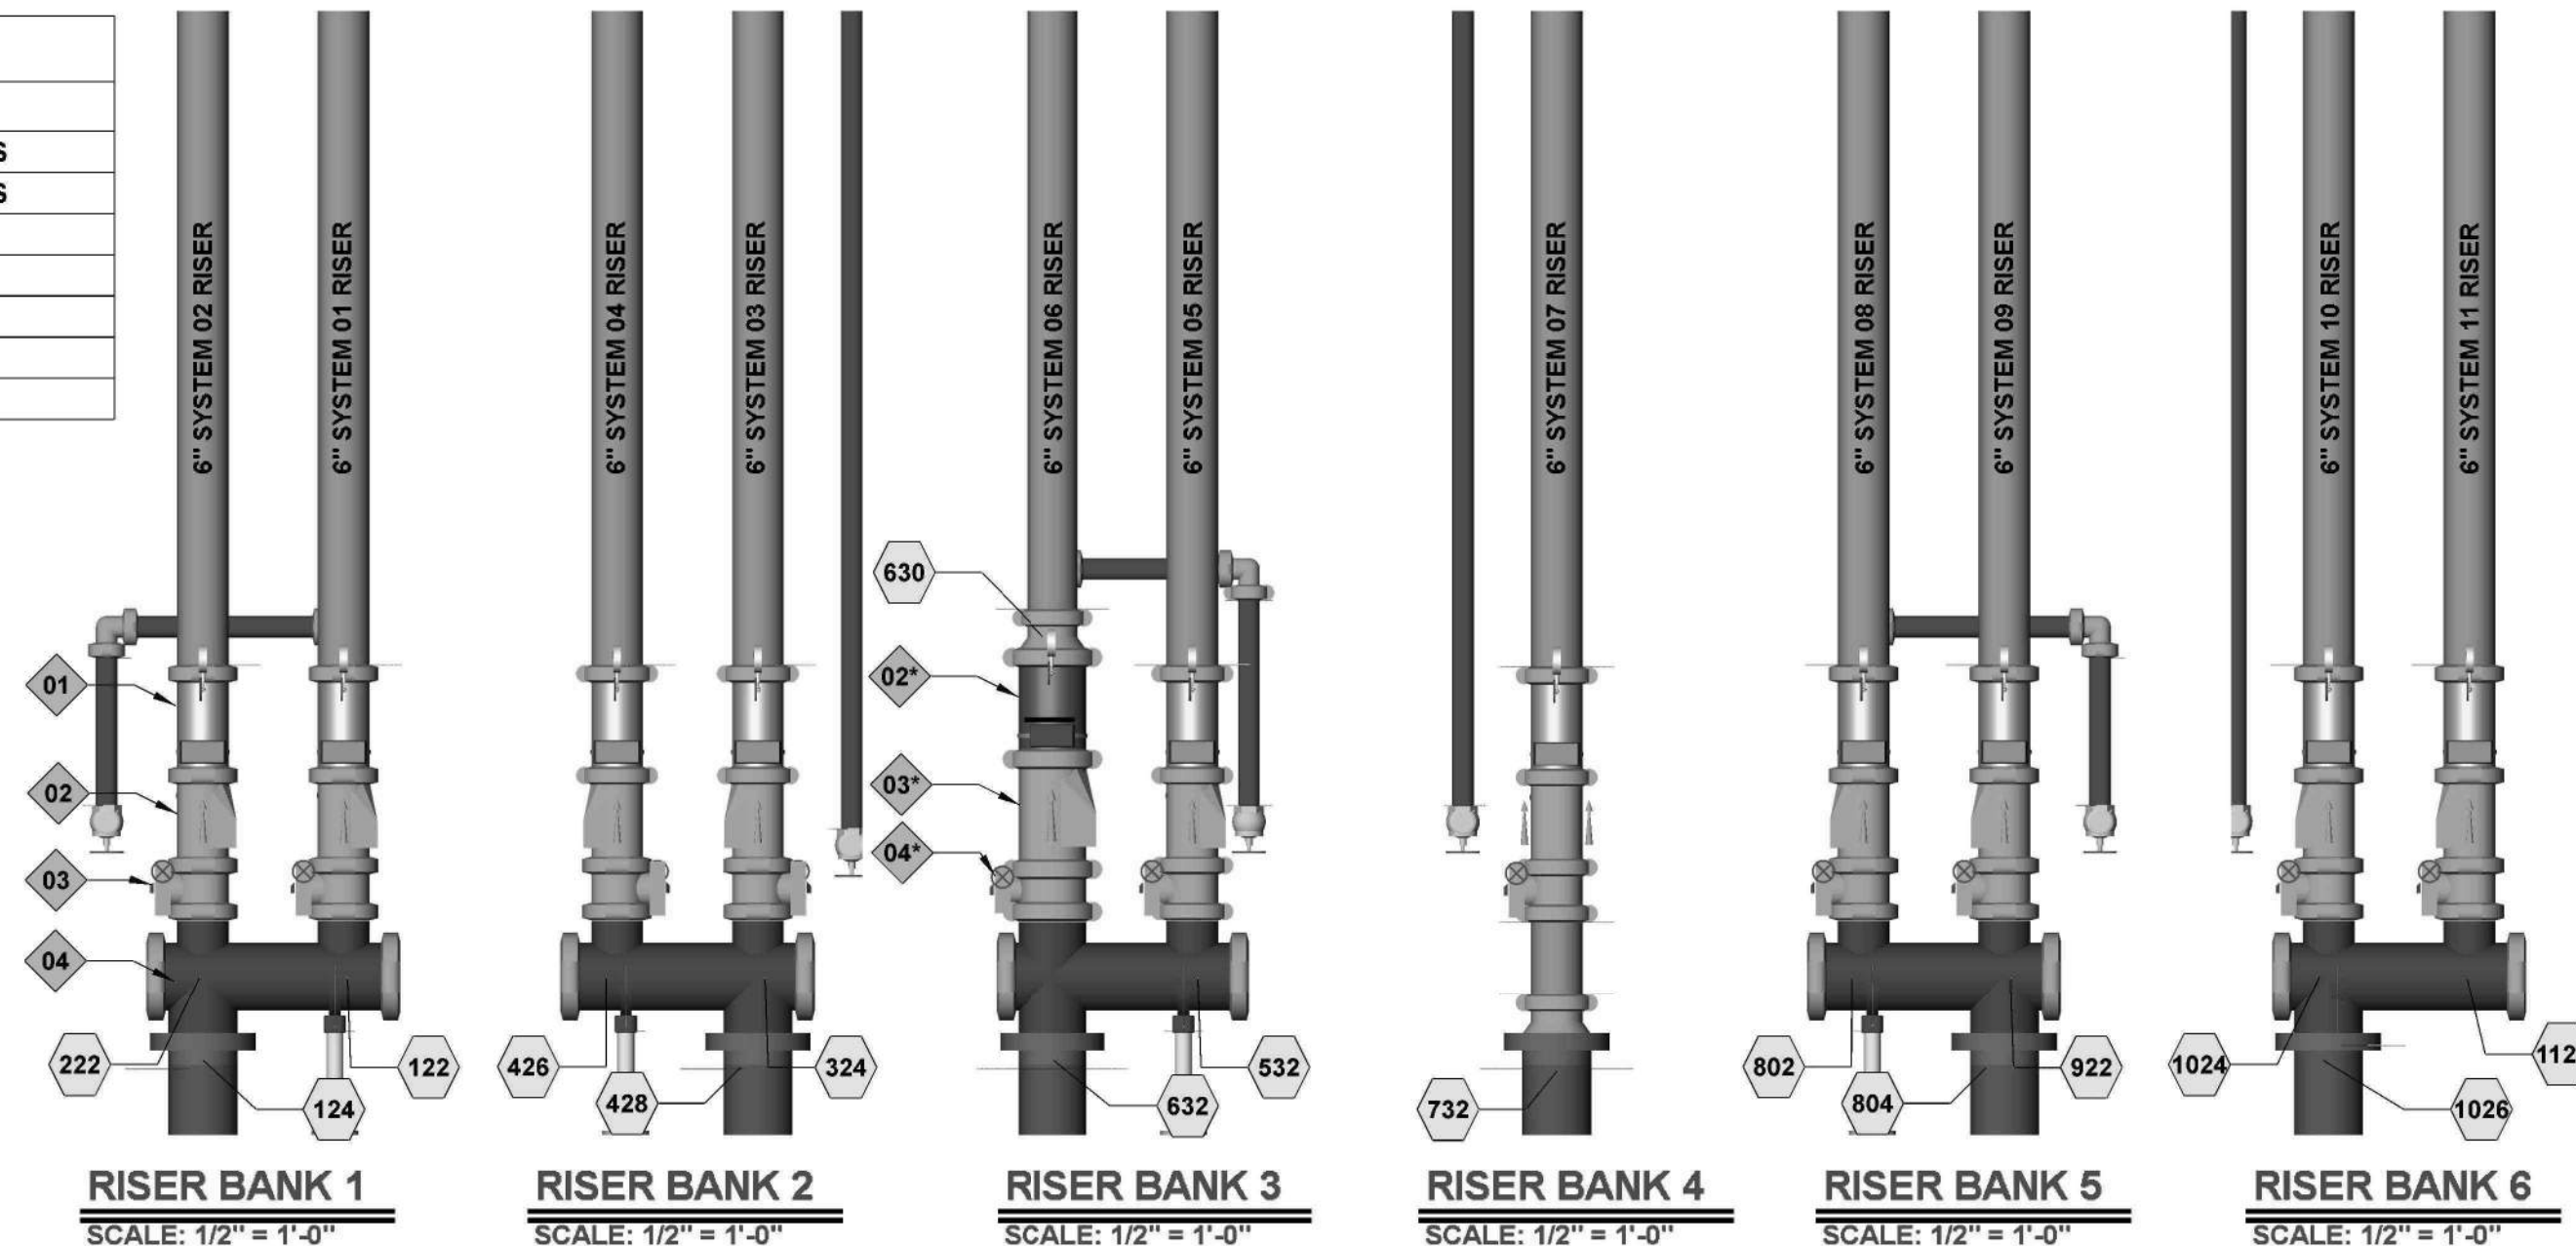

**TYPICAL UNDERGROUND LEAD-IN**

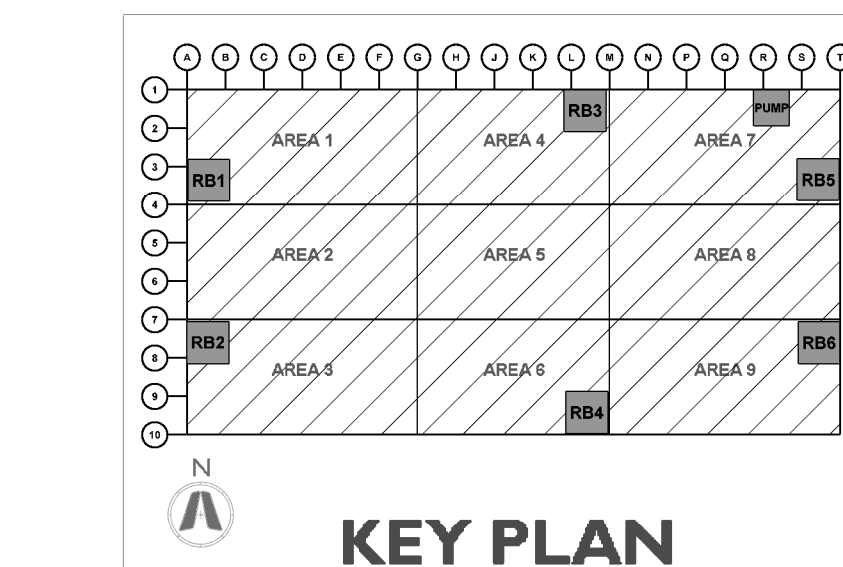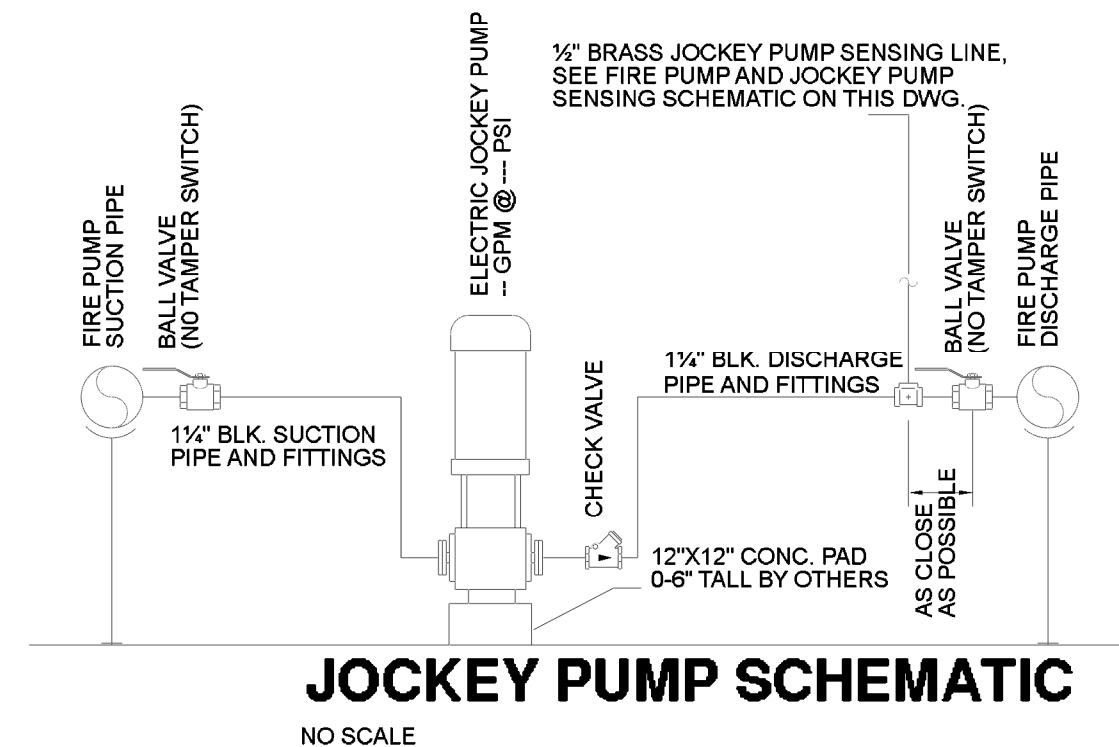

**KEY PLAN**