copyright: The following documents are the sole property of davidson architecture & engineering, Ilc for the specific purpose of construction of said building. These documents are considered confidential and subject to davidson architecture & engineering llc's copyright protection. Neither receipt nor possession transfers any rights to reproduce these documents or any part thereof. Any re-use of these documents without the express written permission of davidson architecture & engineering, llc is strictly prohibited and shall confer no liability to davidson architecture & engineering, Ilc. disclaimer: These documents are accurate to the best of davidson architecture & engineering, llc's professional knowledge. In the event a discrepancy in the documents is encountered, it is the responsibility of that party to notify davidson architecture & engineering in a timely manner, for corrections and/or explanation of the documents. project description:

submittal dates:

sitework:
building envelope:
occupancy:
estimated duration:

fall 2022 fall 2022 spring 2023 9 months

schedule indications are estimated and shall be the responsibility of the contractor.

New pre-engineered metal building for indoor batting

cages with support office, retail, and party room.

const. schedule

PDP & Rezoning submittal: planning approval: permit submittal: permit approval:

approved January 2022 pending approval May 2022 approved

project synopsis:

governing municipality: Lee's Summit, Missouri governing code: 2018 International Building Code 2018 International Plumbing Code

2018 International Mechanical Code 2018 International Fuel Gas Code 2018 International Residential Code 2018 International Fire Code

2017 National Electrical Code ICC/ANSI A117.1-2009, Accessible and Usable Buildings and Facilities

Lee's Summit Municipal Code

zoning:

construction: IIB, pemb

stories: one + mezzanine

building height: 27'-0" max.

fire suppression: yes

bldg footprint: 19,800 s.f.

occupancy group: A-3 (indoor sports) with B+M (office mercantile accessory)

occupant load: 213 first floor accessory spaces: 44 mezzanine: 73

batting cages: 96

*reference code plan and code review

sheet index:

A0.0 cover sheet A0.1 code review, code plan, details Civil C1.0 civil cover sheet C1.1 civil notes C1.2 site plan C1.3 utility plan C2.1 grading plan C2.2 phase I EC C2.3 phase II EC C2.4 spot elevation plan C3.1 existing drainage map C3.2 proposed drainage map C3.3 storm calculations C4.1 civil details C4.2 civil details

Landscaping

C4.3

C4.4

L1.1 landscape plan L1.2 landscape details

Architectural

A1.1 architectural site plan

A2.1 first floor plan

A2.3 first floor reflected ceiling plan

civil details

civil details

A2.4 enlarged bathroom plans
A3.1 exterior elevations

A4.1 wall sectionsA4.2 wall sections and detailsA5.1 door schedule and details

A5.2 first floor finish plan A5.3 mezzanine finish plan A5.4 millwork details

Structural

S100 structural specifications
S110 special inspections
S200 structural foundation plan
S500 typical foundation details
S501 typical foundation details

Mechanical & Plumbing

MP0.0 mp specifications
P1.0 overall plumbing plan
P1.1 enlarged plumbing plan
P2.0 plumbing riser diagram
M1.0 mechanical floor plan

△M1.1 not used

M2.0 mechanical schedules

Electrical

E0 electrical specifications
E1 electrical lighting plan
E2 electrical power plan
E3 enlarged power plans

E4 panel schedule and riser diagram

E5 site lighting plan

owner:

WHD Management LLC PO Box 1059 Lee's Summit, MO 64063 P: 816.246.3987

architect:

Christopher L. Hafner, AIA, LEED AP Davidson Architecture & Engineering 4301 Indian Creek Parkway Overland Park, Kansas 66207 p: 913.451.9390 f: 913.451.9391

civil engineer:

Paul A. Miller, PE
Davidson Architecture & Engineering
4301 Indian Creek Parkway
Overland Park, Kansas 66207
p: 913.451.9390 f: 913.451.9391

structural engineer:

Bryce D. Crady
Apex Engineers, Inc.
1625 Locust St.
Kansas City, MO 64108
p: 816.421.3222

mp engineer:

Maxwell T. Apple BC Engineers 5720 Reeder Shawnee, KS 66203 p: 913.262.1772

electrical engineer:

Darin T. Seidel BC Engineers 5720 Reeder Shawnee, KS 66203 p: 913.262.1772




davidson

architecture & engineering

CHRISTOPHER LEE HAFNER NUMBER 2003920152

Missour 66

AO.O cover sheet

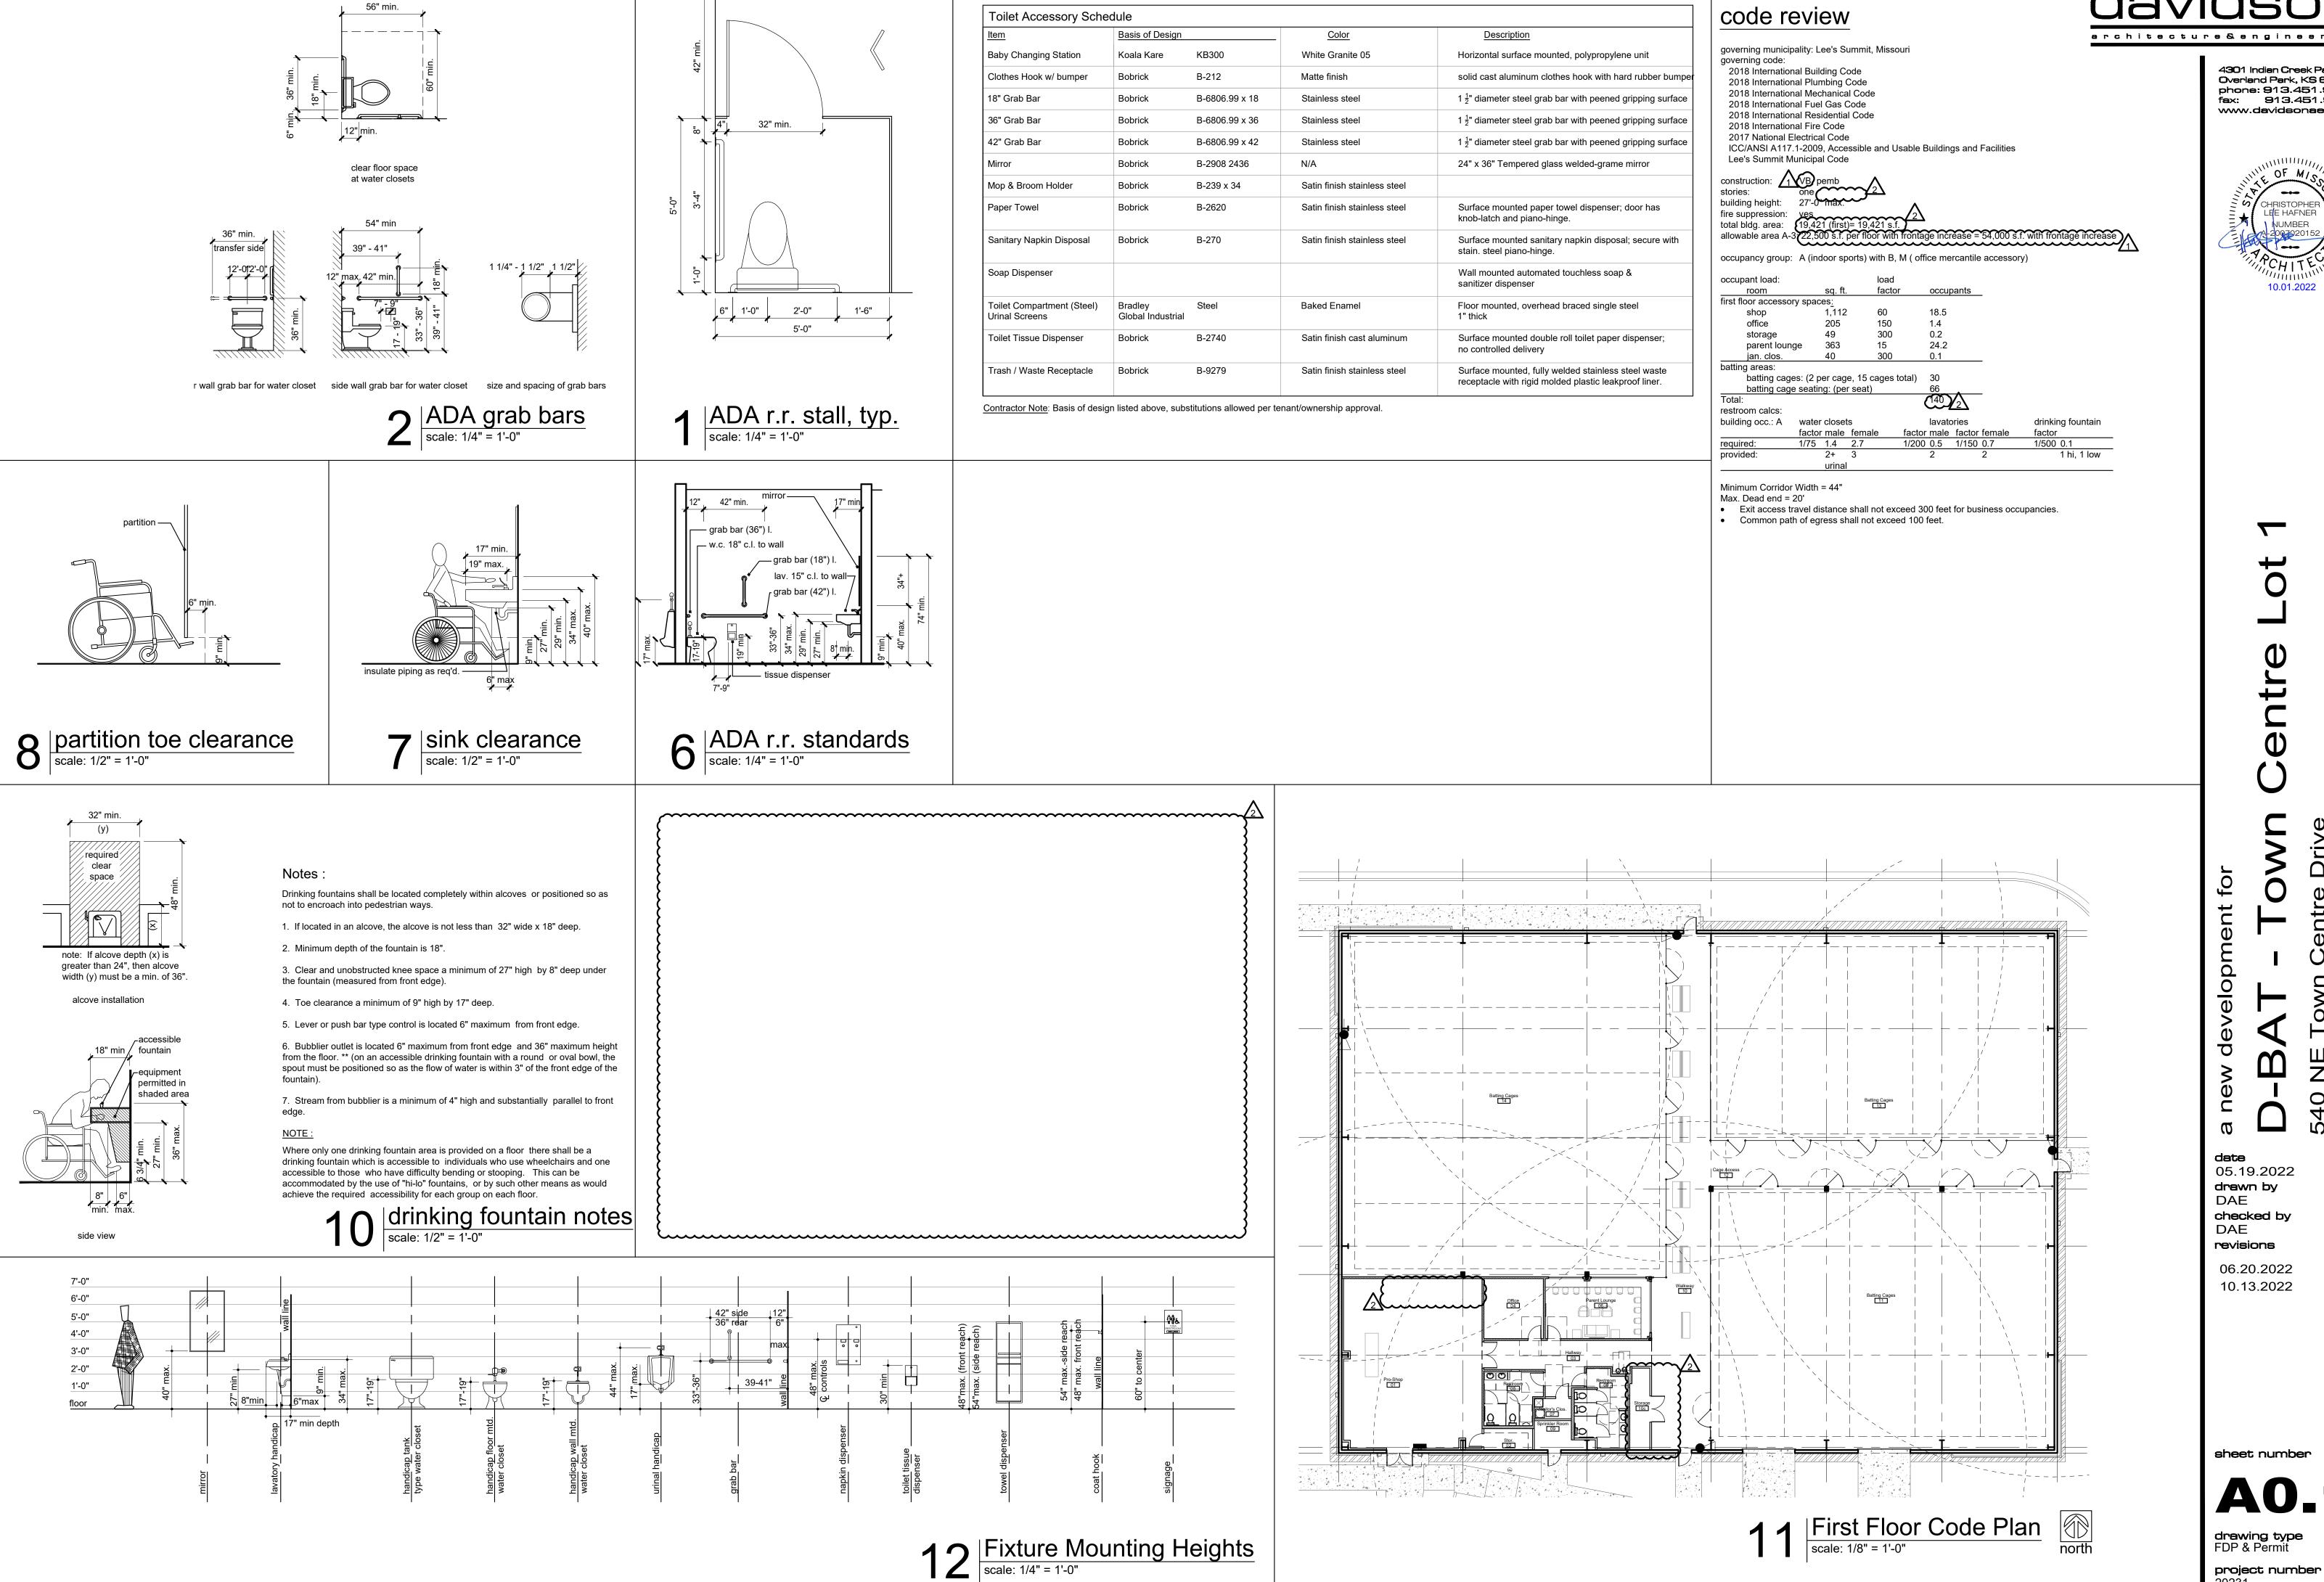

architecture & engineering

4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fax: 913.451.9391 www.davidsonae.com




development

date 05.19.2022 drawn by DAE checked by DAE revisions

06.20.2022 10.13.2022

sheet number **drawing type**FDP & Permit



Utility Contacts

Cable - Spectrum

Sanitary - City of Lee's Summit Water - City of Lee's Summit Storm Sewer - City of Lee's Summit Electric - Evergy Gas — Spire Telephone - AT&T

(816) 969-1900 (816) 969-1900 (816) 969-1800 (888) 471-5275 (816) 756-5252 (800) 464-7928 (816) 358-8833

<u>BM-1:</u> (Sanitary Sewer Manhole, Center of Lid) Elevation: 1006.88' N: 1013449.78 E: 2826933.88

Local Benchmarks:

<u>BM-2:</u> (Storm Sewer Curb Inlet, Center of Lid) Elevation: 994.34'

N: 1013518.71 E: 2826136.03

Floodplain Note:

The site lies entirely with "Zone X", areas determined to be outside the 0.2% annual chance floodplain as depicted on the FEMA Flood Insurance Rate Map (FIRM) no. 29095C0430G, Revision Date: January 20, 2017.

<u>Property Legend</u>

	right of way
	property lines
	easements
	setbacks
<u>Grading Legend</u>	
	existing minor contour
	existing major contour
-	proposed minor contour
	proposed major contour
<u>Utility Legend</u>	
	existing proposed
<u>Linetypes</u>	
sanm	sanitary main sanitary service storm sewer (existing) storm sewer (solid wall, proposed)
stm	storm sewer (solid wall, proposed)

storm sewer (perforated, proposed)

water service (fire)

natural gas main

overhead electric

fence-chainlink

fence-barbed wire

fence-wood

water service (domestic)

water service (irrigation)

natural gas service schematic

underground primary electric

underground secondary electric

underground cable/phone/data

underground cable/phone/data service

<u>Symbols</u>


oco	service cleanout
⊗ ^{fmv}	force main release valve
	rectangular structure
\bigcirc	circular structure
У	fire hydrant
⊗ ^{wv}	water valve
M	water meter
BFP	backflow preventer
$\boxtimes^{\mathcal{G}}$	natural gas meter
T	service transformer (pad mod
S	primary switch gear
\(\lambda	light pole
C	cable/phone/data junction bo
0—⊕	street light
0-⊕	pedestrian street light

sanitary manhole

\otimes^{fmv}	force main release valve
	rectangular structure
	circular structure
В	fire hydrant
⊗wv	water valve
M	water meter
BFP	backflow preventer
$\boxtimes^{\mathcal{G}}$	natural gas meter
T	service transformer (pad mou
S	primary switch gear
*	light pole
C	cable/phone/data junction box
○	street light
0-⊕	pedestrian street light
Ø	electric pole
\longrightarrow	guy wire

D-Bat - Town Centre Lot 1 Section 29, Township 48 North, Range 31 West City of Lee's Summit, Jackson County, MIssouri

A New Development for

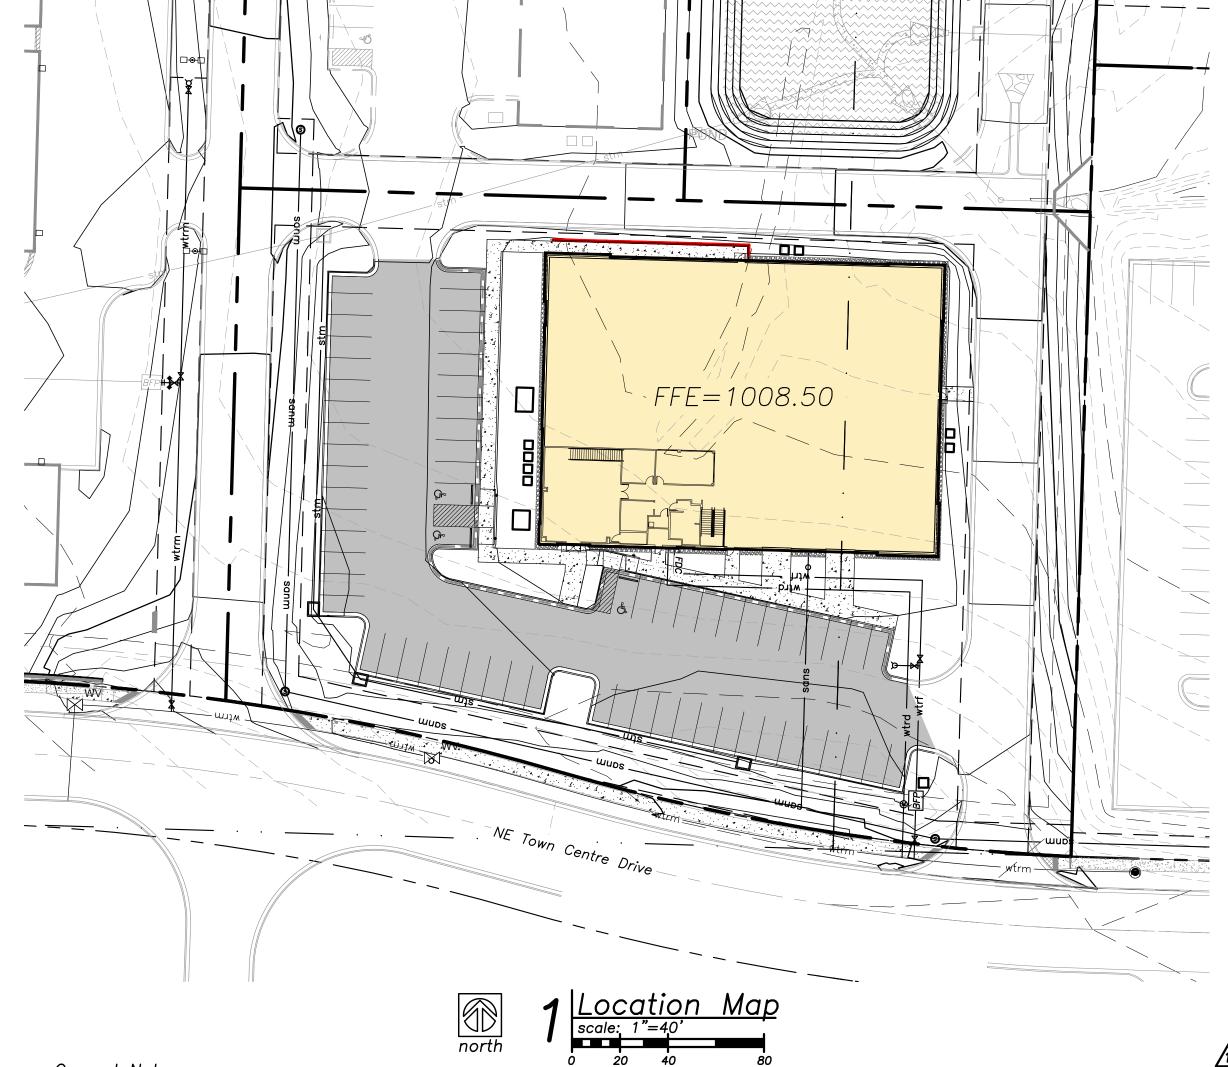

<u>General Notes</u>

- 🖍 All construction, including the work done in the right of way, shall follow the City of Lee's Summit Design & Construction Manual.
- Erosion Control shall be per the Erosion and Sediment Control Program Manual of the City of Lee's Summit, MIssouri.
- All work and materials shall be subject to inspection and approval by the owner or the owner's representative. Any change or deviation from these plans must be authorized by the owner or the owner's representative.
- All traffic control in connection with construction in the right—of—way shall be in conformance with the Manual of Uniform Traffic Control
- The contractor shall be required to provide a stabilized construction entrance to prevent mud from being deposited onto adjacent roads.
- The contractor shall be responsible for obtaining all required permits, paying all fees, and otherwise complying with all applicable regulations
- The contractor shall protect from damage or injury all property including survey monuments, property markers, benchmarks, etc. Items damaged shall be reset by a professional land surveyor licensed in the state of Missouri, at the contractor's expense.
- The contractor shall be responsible for the restoration of the right-of-way and for damaged improvements such as curbs, sidewalks, street light and traffic signal junction boxes, traffic signal loop lead—ins, signal poles, etc. Damaged improvements shall be repaired in conformance with the latest city standards and to the city's satisfaction.
- The contractor shall sod all disturbed areas within the public street right—of—way.
- Paving shall conform to the soils report, and these drawings, any identified discrepancies shall be brought to the attention of the engineer.
- The contractor shall contact the City's Development Services Engineering Inspection to schedule a pre-construction meeting with a field engineering inspector prior to any land disturbance work at (816) 969-1200.
- All concrete for public improvements shall comply with the Standards and Specifications of the Kansas City Metropolitan Materials Board (KCMMB). Structural concrete shall be 5,000 psi and nonstructural concrete shall be 4,000 psi.
- A right-of-way work permit and/or street excavations permit shall be obtained by the contractor to complete all utility work within the public street right-of-way.

According to the MDNR Record Database and Field Survey, there is no evidence suggesting presence of any active, inactive or capped oil and/or gas wells on the property.

Sheet Index

C1.0 - Cover C1.1 - Notes C1.2 — Site Plan C1.3 – Utility Plan C2.1 – Grading Plan C2.2 — Erosion Control Plan — Phase I C2.3 — Erosion Control Plan — Phase II C2.4 — Spot Elevation Plan C3.1 — Existing Drainage Map C3.2 - Proposed Drainage Map C3.3 — Storm Calculations C3.4 - Private Storm Line 3 Plan & Profile C4.1 — Details C4.2 — Details C4.3 — Details C4.4 — Details

<u>Civil Engineer:</u>

Davidson Architecture & Engineering, LLC Mr. Paul A. Miller, P.E. 4301 Indian Creek Pkwy. Overland Park, KS 66207 Phone: (913) 451-9390 Email: Paul@davidsonae.com

WHD Management, LLC Mr. Josh Wilson PO Box 1059 Lee's Summit. MO 64063 Phone: (816) 935-5019

Utility Notes

- Boundary information, existing utilities and topographic features shown are based on information supplied by owner, surveyor, and others.
- The existing utility locations shown on these plans are approximate and may not include all utility lines present. The contractor shall be responsible to make One Call and coordinate field location of all existing underground utilities prior to beginning excavation/construction activities.
- The contractor shall be responsible for any damage to any utilities or their structures during excavation/construction activities.
- The contractor shall coordinate and be responsible for connection fees, system development fees, taxes, etc. for all main connections and/or extensions with and from the city and/or respective utility unless otherwise coordinated with the Owner. All utility services for this project shall be coordinated with respective utility company by
- The contractor shall be responsible for adjusting all at-grade utilities such as manhole covers, valve box covers, etc. to finish grade, whether specifically indicated in these plans or not.
- Utilities shown on the plan with specific elevations and/or structure locations are SUE quality level "B", ie: storm sewer, sanitary sewer, water hydrants & valves, utility poles, etc. All other existing utility information shown is SUE quality level "D", primarily retracement of one—call and city records.

Americans with Disabilities Act (ADA) Notes:

 The running and cross slopes for all sidewalks, accessible paths, ramps, designated parking stalls, etc., shall be in compliance with latest Federal ADA guidelines, in addition to any accessibility standards adopted by the governing municipality. Prior to installation/construction, if any discrepancies are found within the plans, the Engineer All ADA parking areas shall have NO slopes greater than 2% in any direction.


Sidewalk construction must not exceed a 2% cross—slope and an 8.33% running

<u>Legal description</u>

Lot 1, Lee's Summit Town Centre, Lot 1 & Lot 2, A Subdivision In Lee's Summit, Jackson County, Missouri. Containing 505,722.67 sq. ft. or 11.61 acres more or less.

4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fex: 913.451.9391 www.devidsonee.com

> Davidson Architecture & Engineering, LLC License # 2010029713



Owner Information

Email: jjwilson801213@gmail.com

date 02.28.2022 drawn by JMP checked by PAM

elo

revisions

05.09.2022 05.19.2022

sheet number

- The Contractor shall be responsible for obtaining all required permits, paying all fees, and otherwise complying with all applicable regulations governing the project.
- All materials, workmanship, and construction shall meet or exceed the city standards. Where there is conflict between these plans and standards, the higher quality standard as determined by the engineer shall apply. All work shall be inspected and approved by contractor.
- All work and materials shall be subject to inspection and approval by the owner or the owner's representative. Any change or deviation from these plans must be authorized in writing by the owner or the owner's representative prior to work being completed.

• All construction shall follow the City of Lee's Summit Design & Construction Manual.

- Lineal foot measurements shown on the plans are horizontal measurements, not slope measurements. All payments shall be made on horizontal measurements.
- No aeological information is shown in these plans.
- Prior to commencement of work, the contractor shall notify all utility companies which have facilities in the near vicinity of the construction to be performed.
- All waste material resulting from the project shall be disposed of off—site in an approved landfill. All excavation shall be unclassified. No separate payment will be made for rock excavation. Contractor is responsible for all haul off
- The Contractor shall be required to provide a stabilized construction entrance to prevent mud from being deposited onto adjacent roads.
- All mud, dirt, and debris tracked onto the parking lot or any roadway shall be removed immediately by the contractor.
- The Contractor shall be responsible for keeping the public streets in the vicinity of the job site clean and free of rocks, soil and debris. Streets and/or parking areas will be scraped and swept on a daily basis by the general
- The Contractor shall protect from damage all survey monuments, property markers, benchmarks, etc. Items damaged shall be reset by a professional land surveyor licensed in the state of Missouri, at the contractor's expense.
- Paving shall conform to the minimum design standards as required by the city and these drawings. If a geotechnical report is provided for the project, the greater pavement requirement between the city's minimum design standards and the aeotechnical report shall be used.

lack lack lack lack lack The contractor shall contact the City's Development Services Engineering Inspection to schedule a pre-construction meeting with a field engineering inspector prior to any land disturbance work at (816) 969-1200.

- All concrete for public improvements shall comply with the city standards and specifications. If no city standards and specifications are provided, then the contractor shall comply with the standards and specifications of the Kansas City Metropolitan Materials Board (KCMMB) unless otherwise noted. Structural concrete shall be 5,000 psi and nonstructural concrete shall be 4,000 psi.
- The contractor shall be responsible for the restoration of the right-of-way and for damaged improvements such as curbs, sidewalks, street light and traffic signal junction boxes, traffic signal loop lead—ins, signal poles, etc (offsite and onsite). Damaged improvements shall be repaired in conformance with the latest city standards and to the city's satisfaction.
- All work within the road right-of-way shall conform to the technical specifications and design criteria for public improvement projects of the city of Lee's Summit, MIssouri A right—of—way work permit and/or street excavations permit shall be obtained by the contractor if required to complete all work within the public right—of—way.
- All traffic control in connection with construction in the right—of—way shall be in conformance with the Manual of Uniform Traffic Control Devices and/or the jurisdictional authority. It is the contractor's responsibility to obtain a traffic control permit if required.
- All waste materials, trash and construction debris shall be collected and stored in dumpsters. No construction waste shall be buried on site. All hazardous waste materials will be disposed of in the manner specified by local, state and federal regulations. Site personnel shall be instructed in these practices, and the construction manager shall be responsible for seeing that these practices are followed.
- Recommendations made by the geotechnical engineer, to be retained by the owner, and contained in the geotechnical report shall govern project conditions unless noted otherwise. Paving shall conform to the the greater pavement requirement between the city's minimum design standards and the recommendations made in the geotechnical report.
- The Contractor shall grade areas to provide positive drainage.
- The contractor shall be responsible for the coordination of work between suppliers and subcontractors involved in the project, including staging of construction details.
- All disturbed areas shall be maintained for dust control. Sprinkling tank trucks shall be available at all times & used on on—site disturbed areas, and other areas where dust becomes a problem as a result of construction activity.
- Nothing indicated on these drawings shall relieve the contractor from complying with appropriate safety regulations.

Utility Notes:

- Boundary information, existing utilities and topographic features shown are based on information supplied by owner, surveyor, and others.
- The existing utility locations shown on these plans are approximate and may not include all utility lines present. The contractor shall be responsible to contract "One Call" and coordinate field location of all existing underground utilities prior to beginning excavation/construction activities.
- The contractor shall be responsible for any damage to any utilities or their structures during excavation/construction activities. Utilities include but are not limited to a service such as electricity, communication, water, public transportation (including traffic signals), storm systems, and items provided by a public utility.
- The contractor shall coordinate and be responsible for connection fees, system development fees, taxes, etc. for all main connections and/or extensions with and from the city and/or respective utility unless otherwise coordinated with the Owner. All utility services for this project shall be coordinated with respective utility company by contractor.
- The contractor shall be responsible for adjusting all at-grade utilities such as manhole covers, valve box covers, etc. to finish grade, whether specifically indicated in these plans or not.
- Utilities shown on the plan with specific elevations and/or structure locations are SUE quality level "B", ie: storm sewer, sanitary sewer, water hydrants & valves, utility poles, etc. All other existing utility information shown is SUE quality level "D", primarily retracement of one—call and city records.
- Refer to mechanical, electrical, and plumbing (MEP) plans for utility service sizes and exact locations. Refer to site electric plans for electric construction details.
- Provide temporary support for existing utility lines that are encountered during construction until backfilling is complete.
- Backfill all utility trenches according to the most recent edition of the jurisdictional standards.
- All utilities shall be brought within 5' of the building to connect to plumbing contractors work unless otherwise specified.
- The Contractor shall adjust all utility fixtures, manholes and inlets to finished grade as required.
- The Contractor shall maintain 18" minimum vertical clearance between storm sewer and sanitary sewer pipes and 18" minimum vertical clearance between sanitary sewer and water main unless otherwise specified.
- Contractor shall prevent entry of mud, dirt, debris, and other material into new and existing storm sewer systems. Should any contamination occur during construction, the contractor shall clean at contractor's expense. Upon completition of all storm sewer improvements, all new and existing pipe and structures shall be cleaned out.
- Electrical, liahtina, and data conduit layout shown is for graphical purposes only. See MEP plans for more detail.

• The Contractor shall provide all temporary power, process, and utility service bypasses and connections as required.

Erosion Control Notes:

- The construction of the sediment basin, installation of the silt fencing, the maintenance of the drainage swales, and the construction of the stabilized entrance shall be completed first, prior to any clearing and grading of any portions of the site. The Disturbed portions of the site where construction activities have permanently ceased shall be stabilized with permanent seeding no later than 14 days after the last construction activity, refer to SWPPP. Roadway swales shall be stabilized with Erosion Control Devices. Once construction activity ceases permanently in an area, that area shall be stabilized with permanent seed and mulch. Only after the entire site has been stabilized, the silt fencing shall be removed.
- The general contractor, or designated Erosion Control Contractor, shall be responsible for construction and maintenance of erosion control devices and practices. The contractor shall be responsible for implementation of, and ensuring compliance of, the project Storm Water Pollution Prevention Plan (SWPPP), a copy of which shall be obtained from the Design Engineer. The SWPPP shall be maintained on site per NPDES requirements and shall be available for review at any time, by any authorized Federal. State, or local review official, as well as the Desian Engineer. The general contractor, or designated Erosion Control Contractor, shall also be responsible for ensuring compliance with, and paying any fees associated with, the State of Missouri General Permit for Stormwater Runoff associated with construction activities, a copy of which shall be maintained in the aforementioned SWPPP.
- This project shall be constructed in compliance with the land disturbance permit, and conform to the standards and specifications of the city of Lee's Summit, MIssouri, prior to any land disturbance changes.
- Erosion and any sedimentation from work on this site shall be contained on the site and not allowed to collect on any offsite areas or in waterways. Waterways include both natural and man-made open ditches, streams, storm drains, lakes and ponds. Refer to erosion control plans for more information.
- The contractor shall be responsible to control downstream erosion and siltation during all phases of construction. Erosion Control work and procedures shall be in place prior to beginning excavation/construction activities. To ensure progressive stabilization of disturbed earth, Erosion control devices shall be staged, installed and maintained throughout land disturbance activities as directed in the drawings, project manual and in accordance with all federal, state and local standards until the site is stabilized.
- The contractor shall implement and maintain Erosion Control Devices as shown in the drawings and project manual before, and at all times during the construction of this project. Any modifications to the devices due to construction or changed conditions shall be complied with as required or as directed by the city of Lee's Summit, MIssouri.
- The contractor shall be responsible for installation and maintenance of all Erosion Control Devices. This includes providing berms, silt fence, or other means to prevent erosion from reaching the right of way and offsite boundaries. In the event the prevention measures are not effective, the contractor shall remove any debris and erosion, restoring the right of way to original or better condition.
- Contractor is to provide erosion protection for all storm sewer inlets.
- If any of the Erosion Control Devices on the site are deemed inadequate or ineffective, the city of Lee's Summit, MIssouri has the right to require additional Erosion Control measures at the expense of the general contractor.
- If any pump-driven dewatering is needed, it shall be discharged though a filter bag over a well-vegetated area. The pump must discharge at a non-erosive velocity. If necessary, an approved energy dissipater may be used.
- Permanent BMP's for any disturbed land area shall be completed by the general contractor within 5 calendar days after final grading or the final earth change has been completed. When it is not possible to permanently stabilize a disturbed area after land disturbance activity ceases, temporary Erosion control devices shall be implemented immediately. All temporary Erosion Control Devices shall be maintained until permanent BMP devices are implemented. All permanent BMP's will be implemented and established before a certificate of compliance is
- Strip topsoil only from those areas that will be disturbed by excavation, filling, road building, or compaction by equipment. Refer to the geotechnical report for depths of stripping. Put sediment basins, diversions, and other controls into place before stripping.
- When topsoiling, maintain needed erosion control practices such as diversions, grade stabilization structures, berm, dikes, level spreaders, waterways and sediment basins.
- Grades on the areas to be topsoiled which have been previously established shall be maintained.
- Bonding Immediately prior to dumping and spreading of topsoil, loosen the subgrade by discing or scarifying to a depth of at least 4", to permit bonding of the topsoil and subsoil.
- The general contractor shall inspect the Erosion Control Devices once every 14 days under any circumstances. within 24 hours of rainfall, and daily during a prolonged rain event unless otherwise noted in the SWPPP or by the jurisdictional authority. A log of inspection report shall be maintained and accessible in accordance with National Pollution Discharge Elimination System (NPDES) requirements. Any required maintenance shall be provided within 72 hours.
- Install silt fence, inlet filters, and other Erosion Control Devices as indicated in the drawings, per APWA and authority regulations, and at additional affected areas as necessary. Build-up of sediment shall be removed promptly per authorities regulations. If silt fence decomposes or becomes ineffective prior to the end of expected usable life and the barrier is still required, the silt fence shall be replaced promptly. Sediment shall be removed from sediment traps or basins when design capacity has been reduced to 50%. Contractor shall flare the ends of the silt fence uphill in order to temporarily impound runoff.
- Earthen berms shall be regularly inspected, and inspected after each rainfall event. Repairs to earthen berms shall be made immediately. If the earthen berm shows signs of erosion, and it is determined that material must be added to fix the berm, the material shall be properly placed, compacted and reseeded. The berm shall be reseeded and stabilized, as needed, to maintain its soundness whether or not there has been any rainfall.
- Drainage swales shall be inspected regularly and after every rainfall event. Repairs to drainage swales shall be made immediately. If the flow channel and/or outlets show signs of deficiency, the damaged area(s) shall be restabilized and reseeded, as needed, to prevent further damage. If additional measures are needed to eliminate issues, contractor shall notify the engineer for possible modifications.
- Refer to the jurisdictional authority for temporary gravel construction entrance details. If not specified, refer to APWA standards. The entrance and exit areas of the project shall be cleared of all vegetation, roots, and other objectionable material. The gravel shall be placed to the proper dimensions and graded to a smooth and even slope. Construction entrance drainage shall be provided to carry water to a sediment trap or other suitable outlet.

Stockpiling Notes:

vegetation to control erosion and weed growth.

installed around the perimeter of the stockpile.

- Select stockpile location to avoid slopes and natural drainageways, avoiding traffic routes. On large sites, re-spreading is easier and more economical where topsoil is stockpiled in small piles located near areas where they will be used.
- Sediment Barriers Use sediment fences or other barriers where necessary to retain sediment.
- Temporary Seeding Protect topsoil stockpiles by temporarily seeding as soon as possible, not to exceed 14 days, weather permitting, after the formation of the stockpile.

• Permanent Vegetation — If stockpiles will not be used within 12 months, they must be stabilized with permanent

• All stockpiled soils shall be maintained in such a way as to prevent erosion from leaving the site. Silt fence must be

Seeding Notes:

or oats at 100lbs. per acre.

seeding. Apply the mixture at 2lbs. per 1000ft²

re—seedings within the same season, if possible.

Seeding shall be as follows unless otherwise stated in the landscape plans.



• Annual rye grass, wheat, or oats should be used for temporary seeding. Apply rye grass at 120lbs. per acre, wheat 4301 Indian Creek Parkway

> Davidson Architecture & Engineering, LLC

Overland Park, KS 66207

phone: 913.451.9390

fex: 913.451.9391

www.devidsonee.com

---PAUL A. MILLER NUMBER Paul A. Miller License # E-28140

• Apply seed uniformly with a cyclone seeder, drill, cultipacker seeder, or hydroseeder. Small grains should be planted no

more than 1" deep, and grasses and legumes no more than $\frac{1}{2}$ ". • Generally, a permanent stand of vegetation cannot be determined to be fully established until soil cover has been maintained for one full year from planting. Inspect seeded areas for failure and make necessary repairs and

• A mixture of 65% kentucky bluegrass and 35% chewing fescue or creeping red fescue should be used for permanent

complete grading according to the approved plan. Lime and fertilizer needs should be determined by soil test. Apply

seasons when satisfactory growing conditions exist. The planting operations shall not be performed during times of

• Seed should be labeled in accordance with U.S. Department of Agriculture rules and regulations under the federal seed

act and comply with the requirements of the Missouri seed law. Labels contain important information on seed purity,

approved by owner's representative. The contractor assumes full and complete responsibility for all such plantings and

extreme drought, when ground is frozen or during times of other unfavorable climatic conditions unless otherwise

• Seedbed preparation—Install necessary mechanical erosion and sedimentation control practices before seeding, and

the lime and fertilizer evenly and incorporate into the top 4"-6" of soil by discing or other suitable means.

germination, and presence of weeds. Weed seed should not exceed 1.0% by weight of the mixture.

All seeding shall be performed during favorable weather conditions and only during normal and accepted planting

- The Contractor shall seed all disturbed areas unless otherwise noted by landscape plans. Immediately after seeding, mulch all seeded areas with unweathered small grain straw, spread uniformly at the rate of 1-2 tons per acre or 100lbs (2-3) bales) per 1000ft². The mulch should be anchored with disc type mulch anchoring tool or other means as approved by the jurisdictional authority. Mulch matting may be used in lieu of loose mulch.
- The Contractor shall sod all disturbed areas within the public street right-of-way. Refer to city and state standards for proper installation.

Demolition Notes:

operations.

- At the site, the Contractor shall maintain the required documents for immediate review, included but not limited to: Site Safety Plan, Demolition Permits, Street Closure Permits, Contract Documents, Demolition Plans, Salvage Verification Forms, SWPPP Etc.
- The Contractor shall notify all utility companies for field verification and disconnection of utilities prior to any work. Coordination is required for both temporary and permanent utility services that serve the site including, but not limited to: water lines, power, telephone, cable, storm sewer, sanitary sewer with the city and/or respective utility.
- The Contractor is specifically cautioned that the locations and/or elevation of existing utilities as shown on these plans are based on records of the various utility companies, and where possible, measurements taken in the field. The information is not to be relied on as being exact or complete. Contractor shall contact One Call utility information service for utility locates. The Contractor must call the appropriate utility companies at least 72 hours before any excavation to request exact field location of utilities. The Contractor shall also coordinate and allow access for utility companies to perform any disconnection or relocation activities. It shall be the responsibility of the Contractor to relocate all existing utilities which conflict with the proposed improvements shown on the plans.
- Remaining building structures and remaining utility services shall be protected from damage. Damage to any existing features to remain will be replaced at the Contractor's expense.
- Areas disturbed during demolition shall be thoroughly evaluated by the geotechnical engineer responsible for site preparation prior to placement of structural fill. All disturbed soils shall be undercut prior to placement of structural fill, per the geotechnical recommendations. Contractor shall notify the geotechnical engineer at least 72 hours prior to placement of structural fill.
- Excavations created by the removal of any existing utility lines that extend below design grades shall be cut thoroughly evaluated by the geotechnical engineer prior to placement of fill. If existing utilities are to be left in-place, existing trench backfill shall be evaluated in accordance with the recommendations of evaluation of existing fill.
- The Contractor shall be responsible for obtaining all Federal, State, and local permits, obtaining all inspections, and shall conform to all governing codes and regulations required to perform necessary abatement during demolition, should hazardous materials be encountered.
- Contractor is responsible for legally disposing of all materials and associated cost of interim storage facilities.
- For tree & stump removal, the Contractor shall remove all root systems from the site not designated to be saved. Materials disturbed during removal of stumps shall be undercut and replaced with structural fill. A zone of desiccated soils may exist in the vicinity of the trees. The desiccated soils have a higher swell potential and shall be undercut and replaced with structural fill.
- No construction waste shall be buried on site. All hazardous waste materials will be disposed of in the manner specified by local, state and federal regulations.

Retaining Wall Notes:

- Site retaining wall improvements shall be designed by a licensed professional engineer retained by the contractor. The wall engineer and contractor shall satisfy themselves of the conditions of the surrounding site features and any interactions with the proposed improvements.
- Retaining wall design drawings and specifications shall be provided to the owner and owner's representative for review and approval. All retaining wall designs shall be signed and sealed by a registered Professional Engineer licensed in the state of Missouri. Design services shall be included in retaining wall pricing.
- Refer to Retaining Wall drawings for wall information. Civil plan set shall only be used for general location and spot elevations.
- The Contractor is responsible for coordinating all inspections, certifications, permits, fees and close out of the wall unless otherwise determined. Contractor shall notify wall design engineer for final inspection. Contractor shall include in construction cost for all of the above items related to the installation of the retaining wall.
- Any wall shown is a schematic representation of the proposed walls. The spot elevations denoting retaining walls are provided on the site grading plan.
- If the wall is greater than 30" and is in an accessible area, guard rails are required per code.

License # 2010029713

ntr

 $\boldsymbol{\omega}$ date 02.28.2022 drawn by JMP checked by PAM

development

D


revisions 05.09.2022


01

sheet number

FDP & Permit project number

drawing type

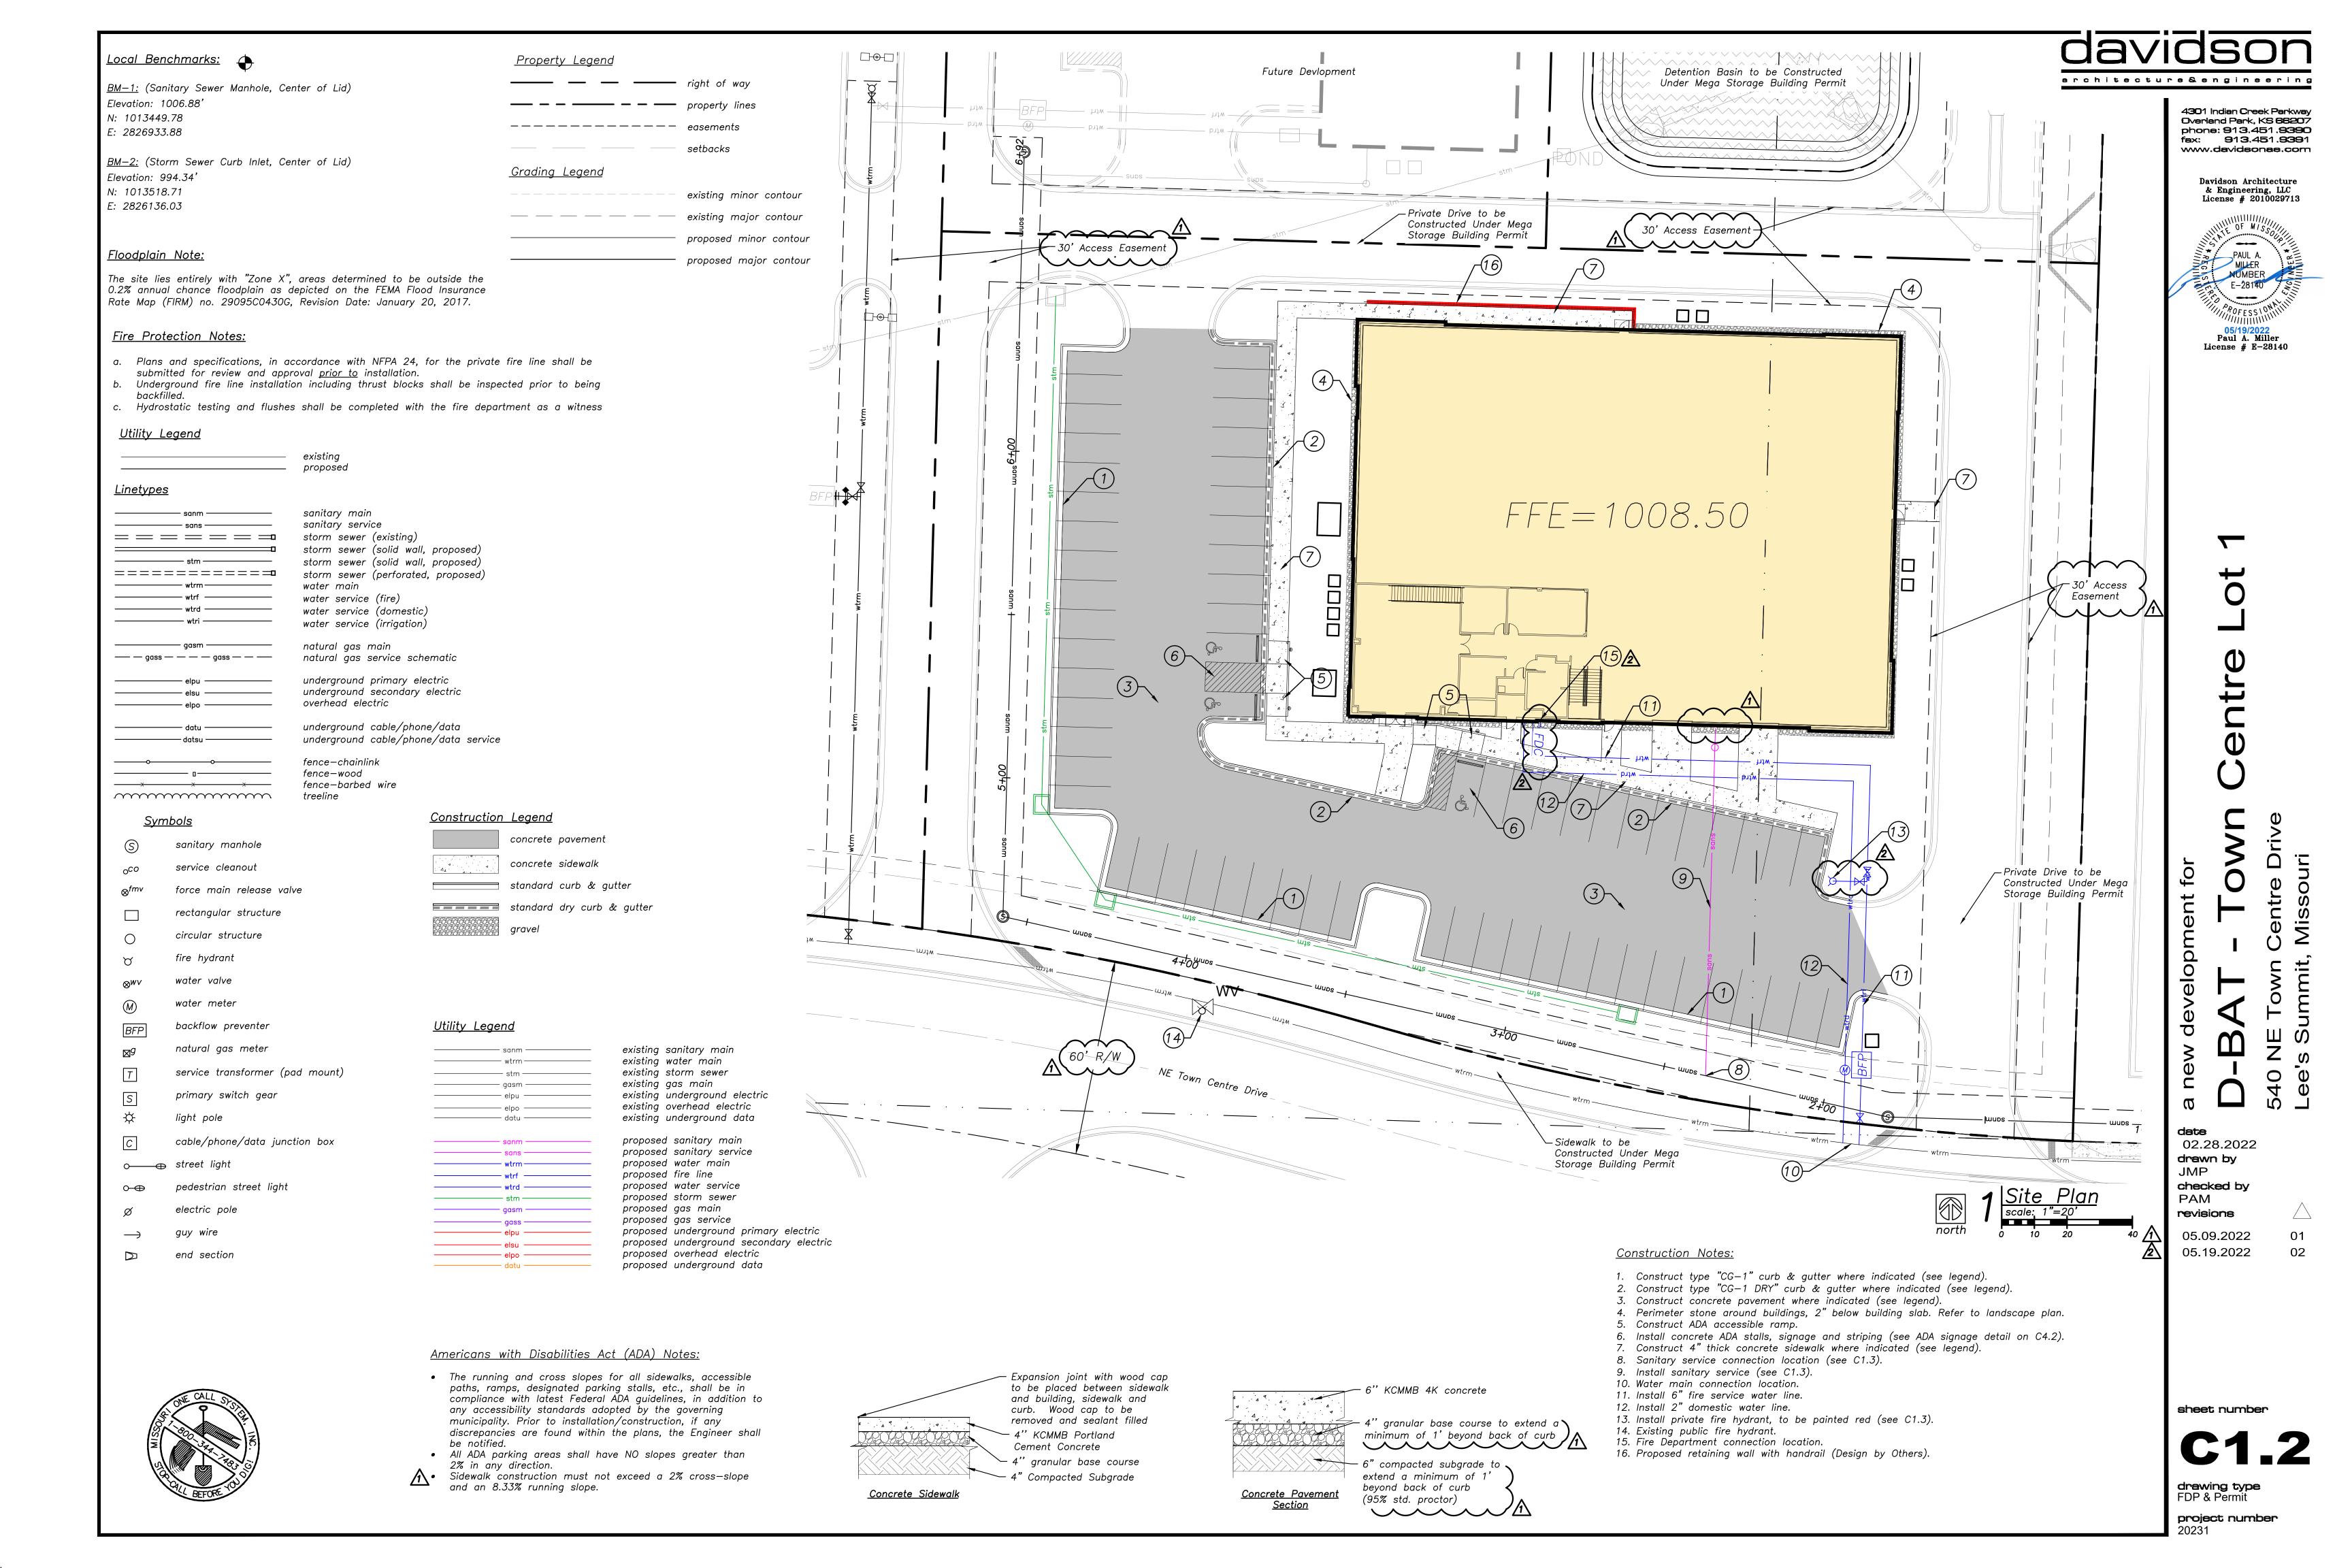

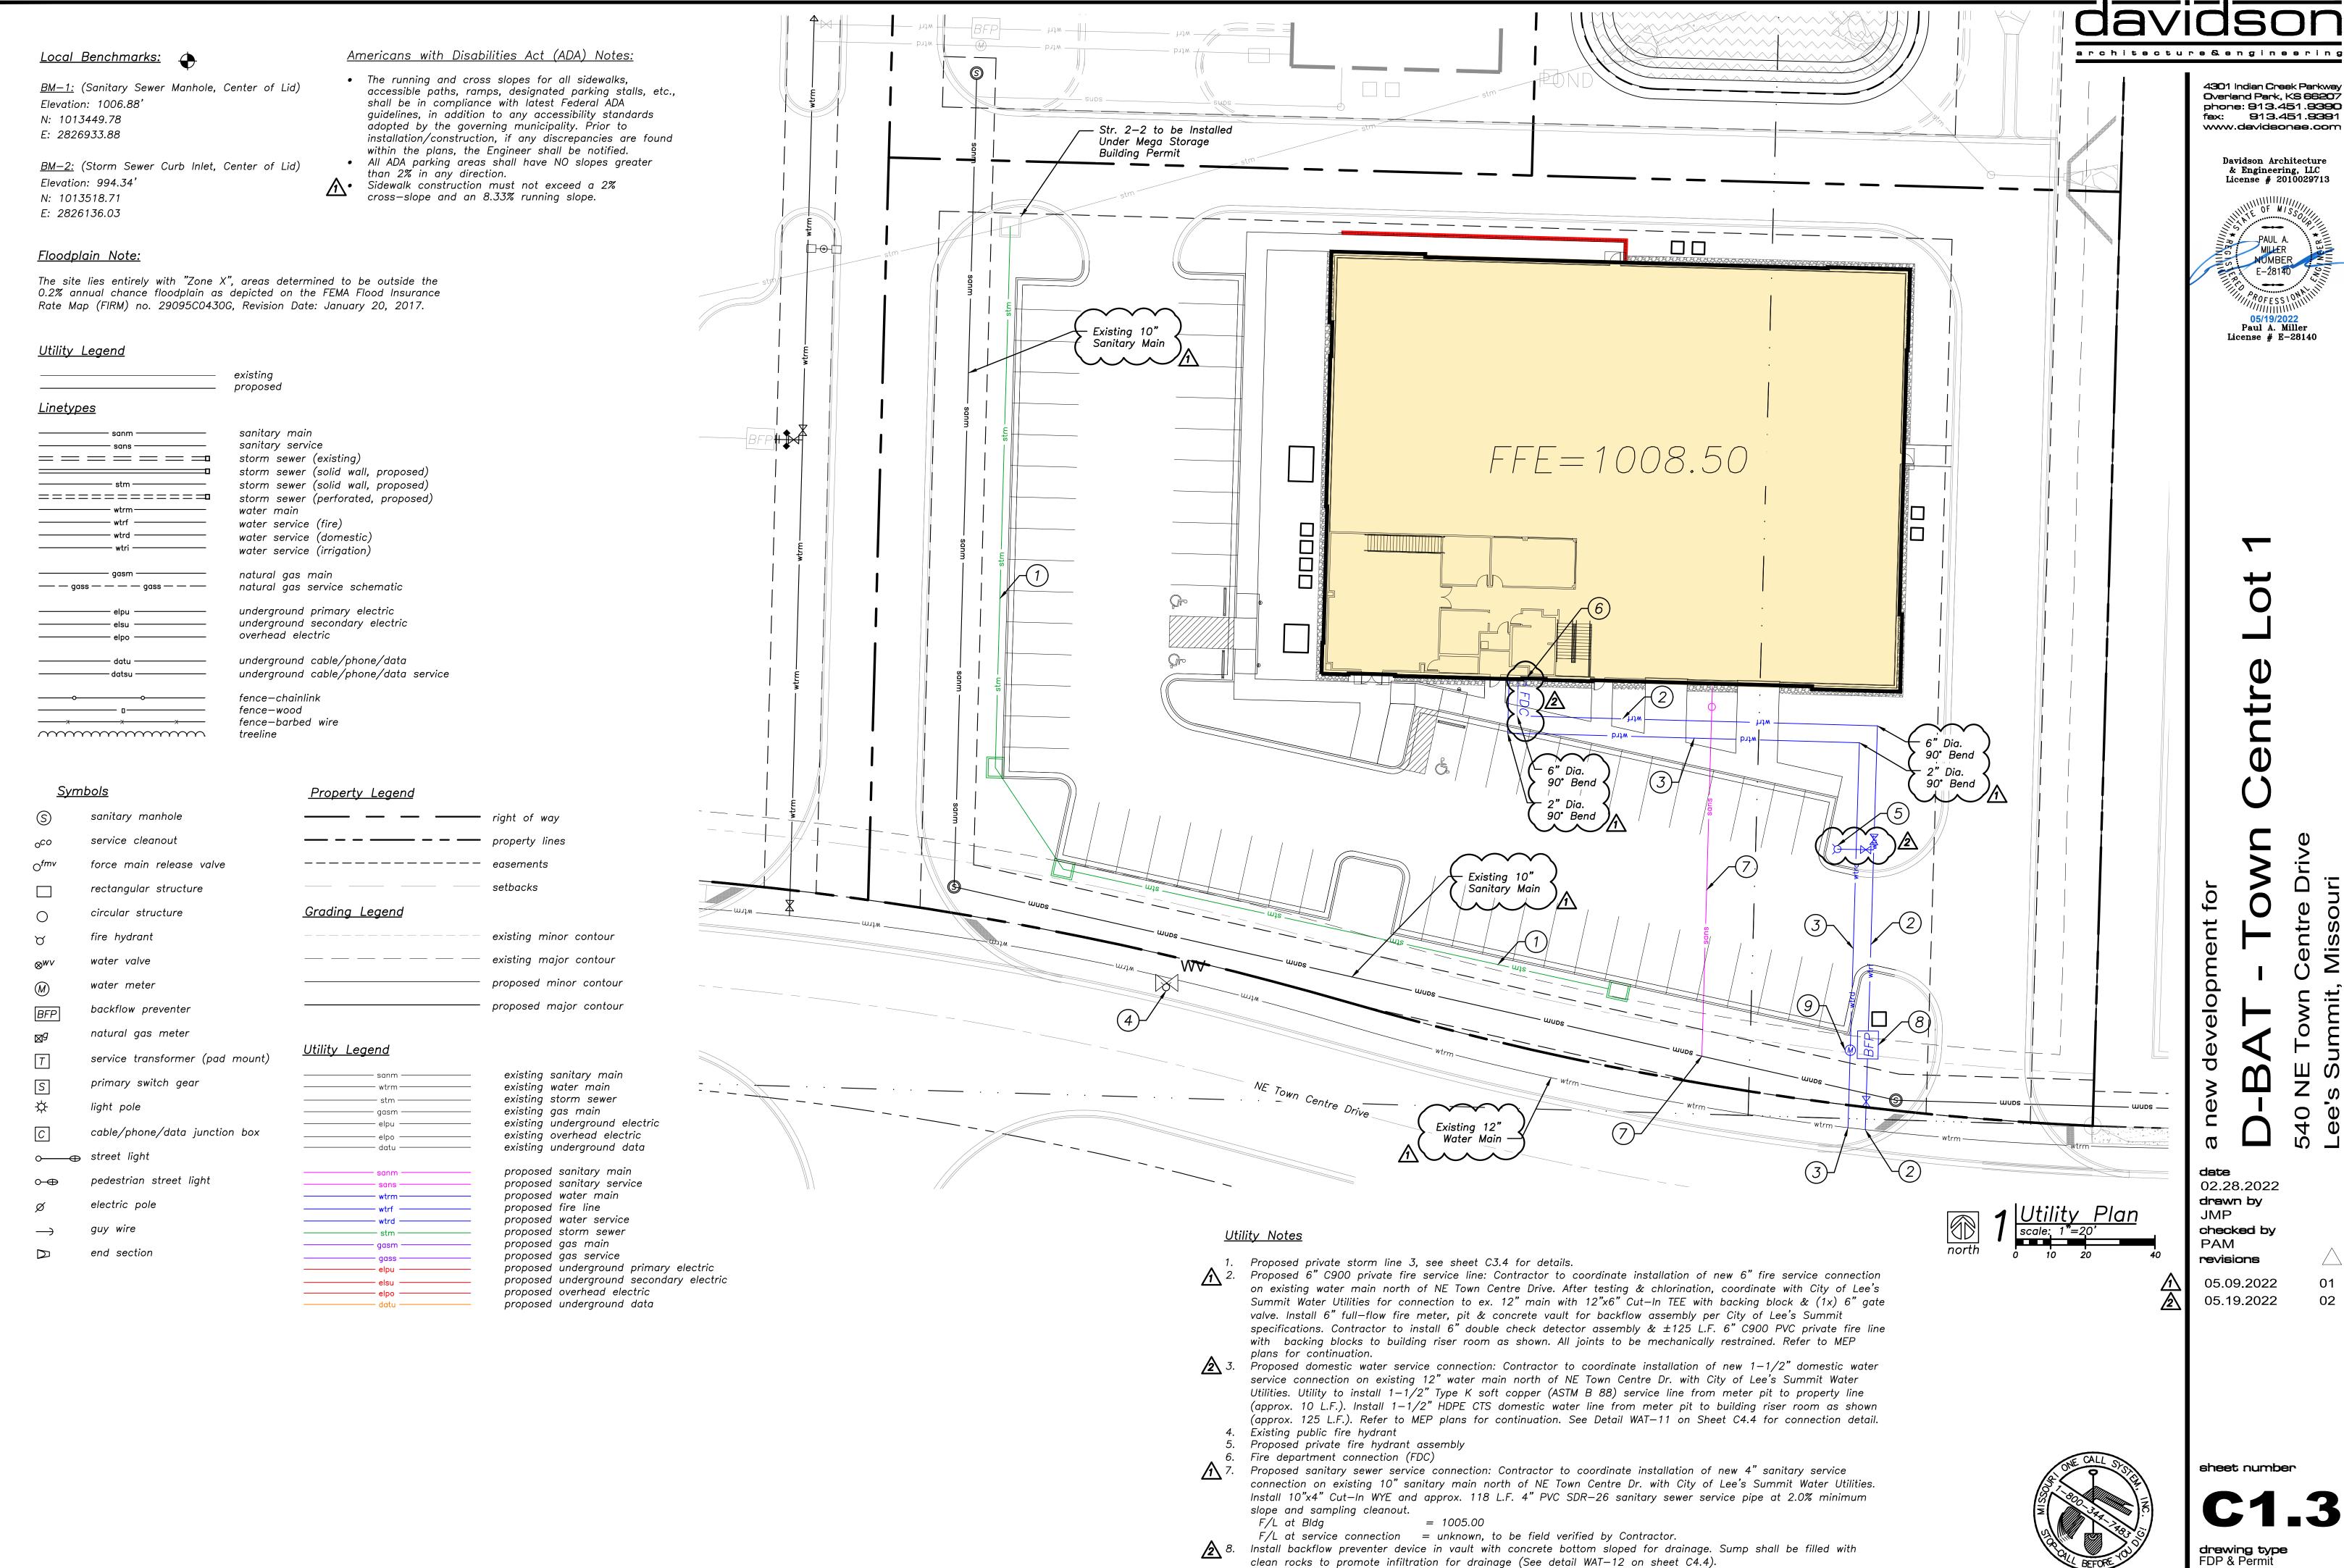

9. Install 1-1/2" water meter as shown in meter pit with gravel bottom for drainage (see detail on sheet C4.4).

4301 Indian Creek Parkway Overland Park, KS 66207 phone: 813.451.8390 fax: 913.451.9391 www.devidsonee.com

Davidson Architecture

& Engineering, LLC License # 2010029713

License # E-28140


02.28.2022 drawn by JMP checked by


05.09.2022 05.19.2022


02

sheet number **drawing type** FDP & Permit

project number

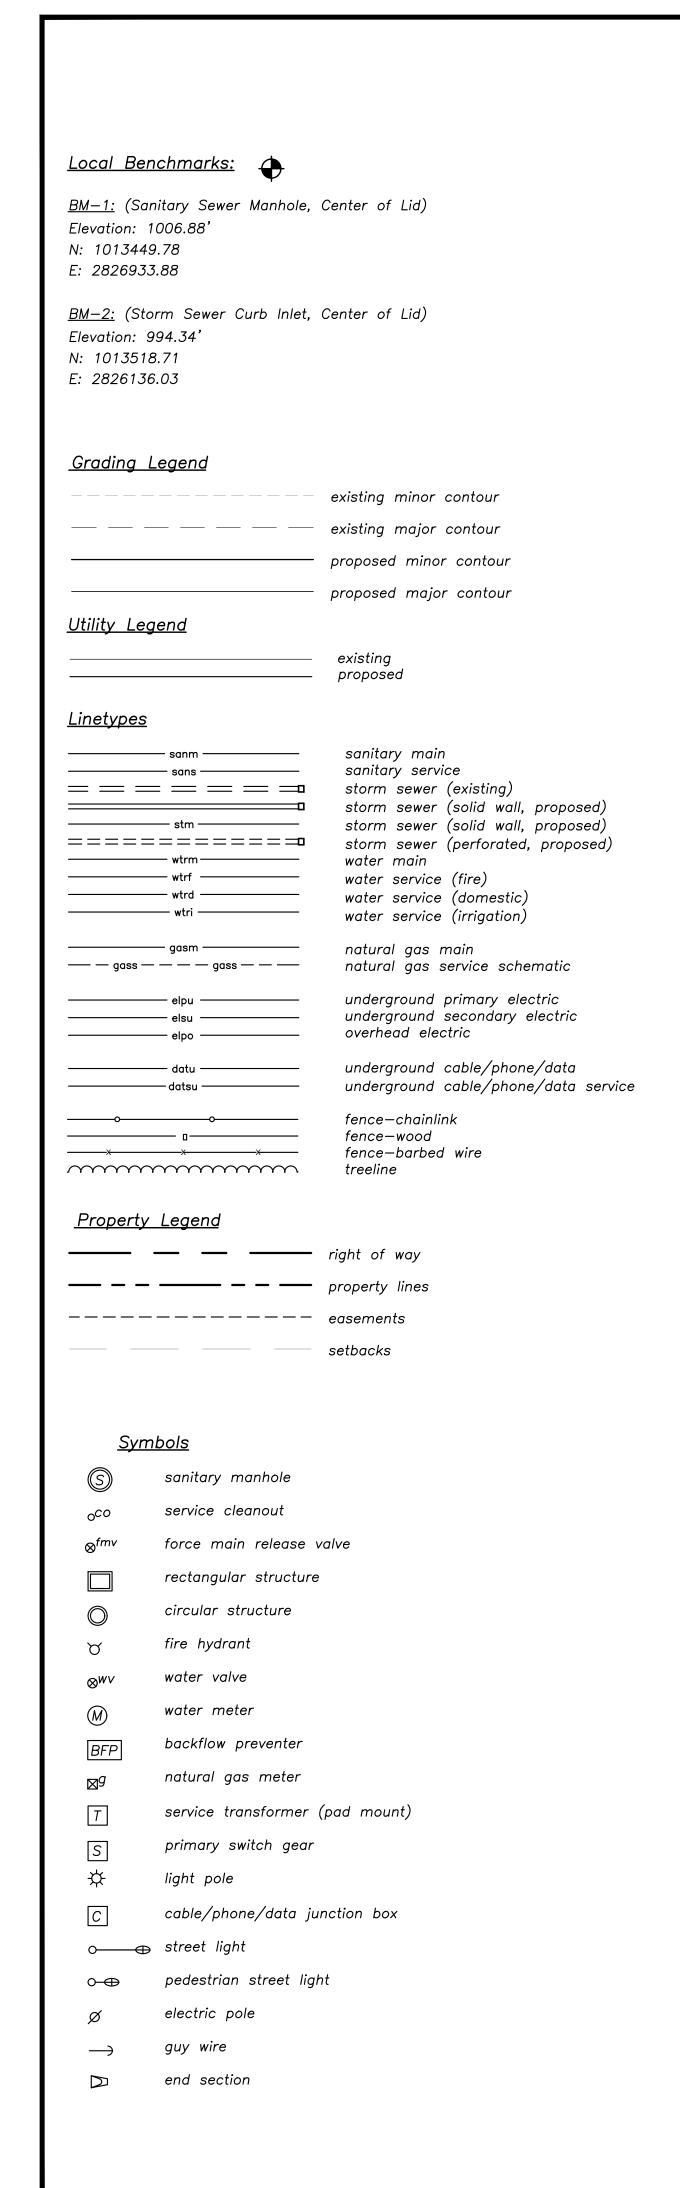


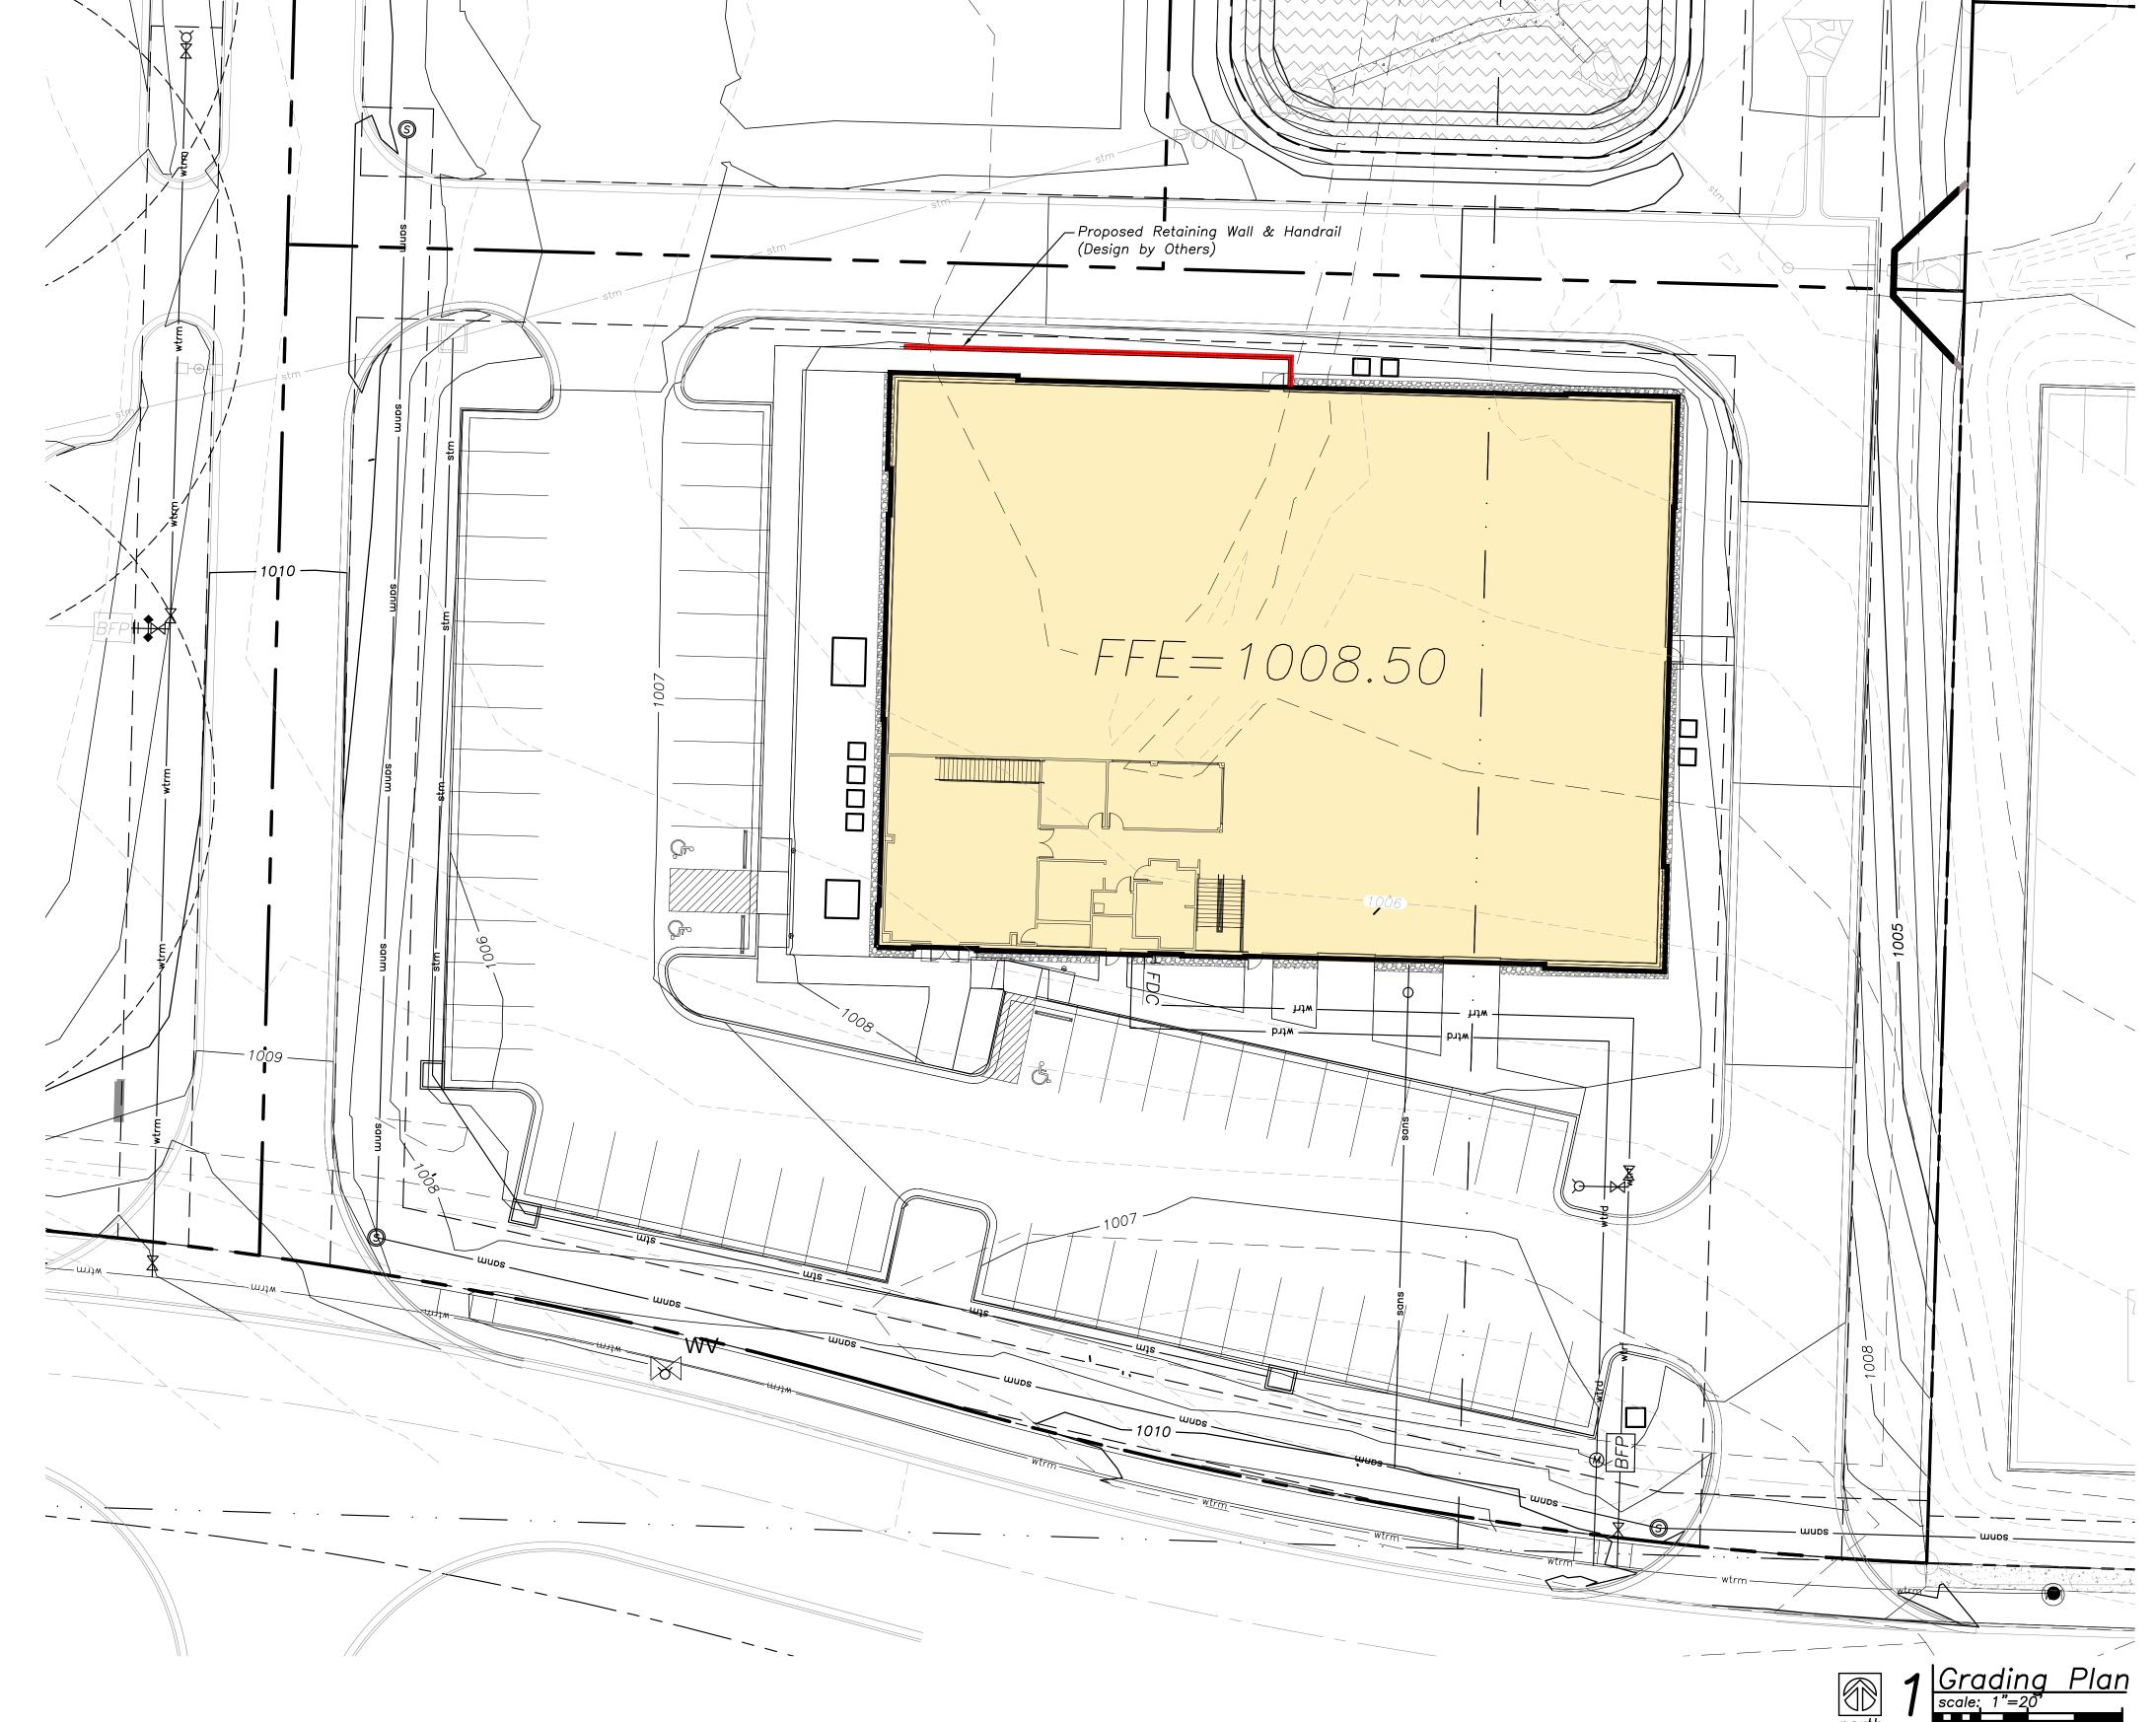




4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fax: 913.451.9391 www.davidsonae.com

Davidson Architecture & Engineering, LLC License # 2010029713



date 02.18.2022 drawn by JMP checked by PAM revisions


sheet number

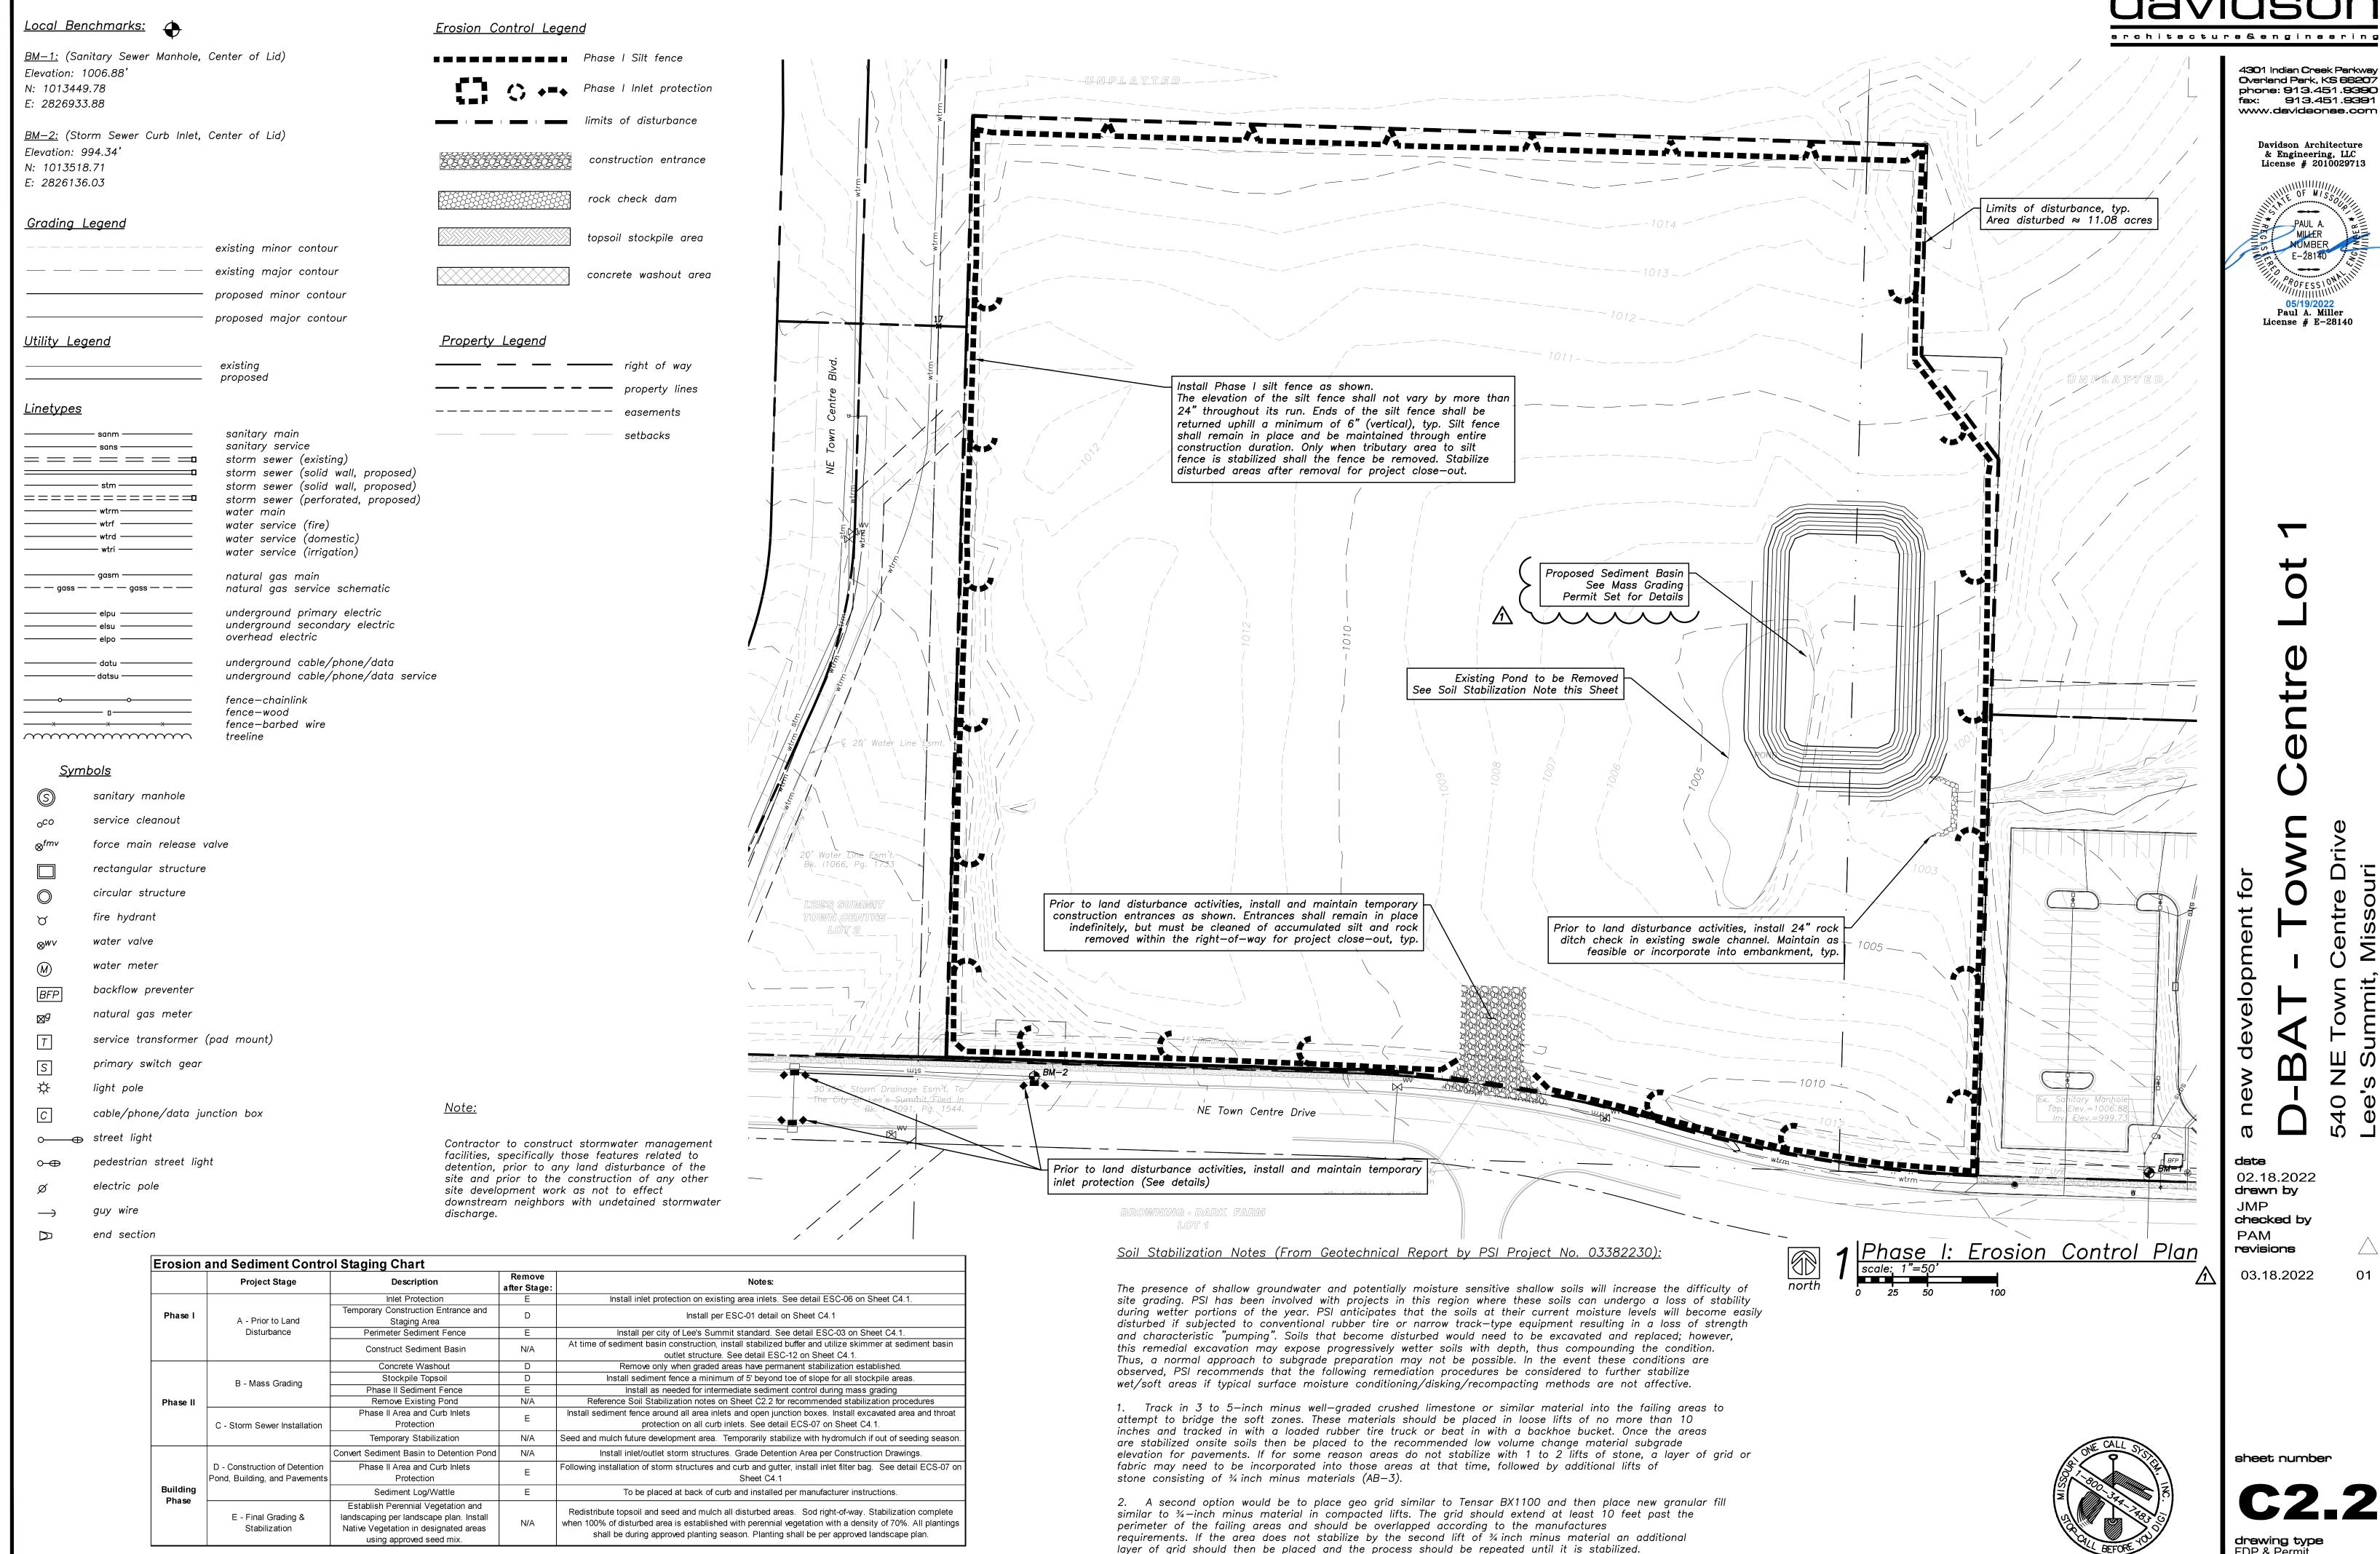

PSI recommends a test section be performed to verify the selected remediation method.

4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fex: 913.451.9391

Davidson Architecture

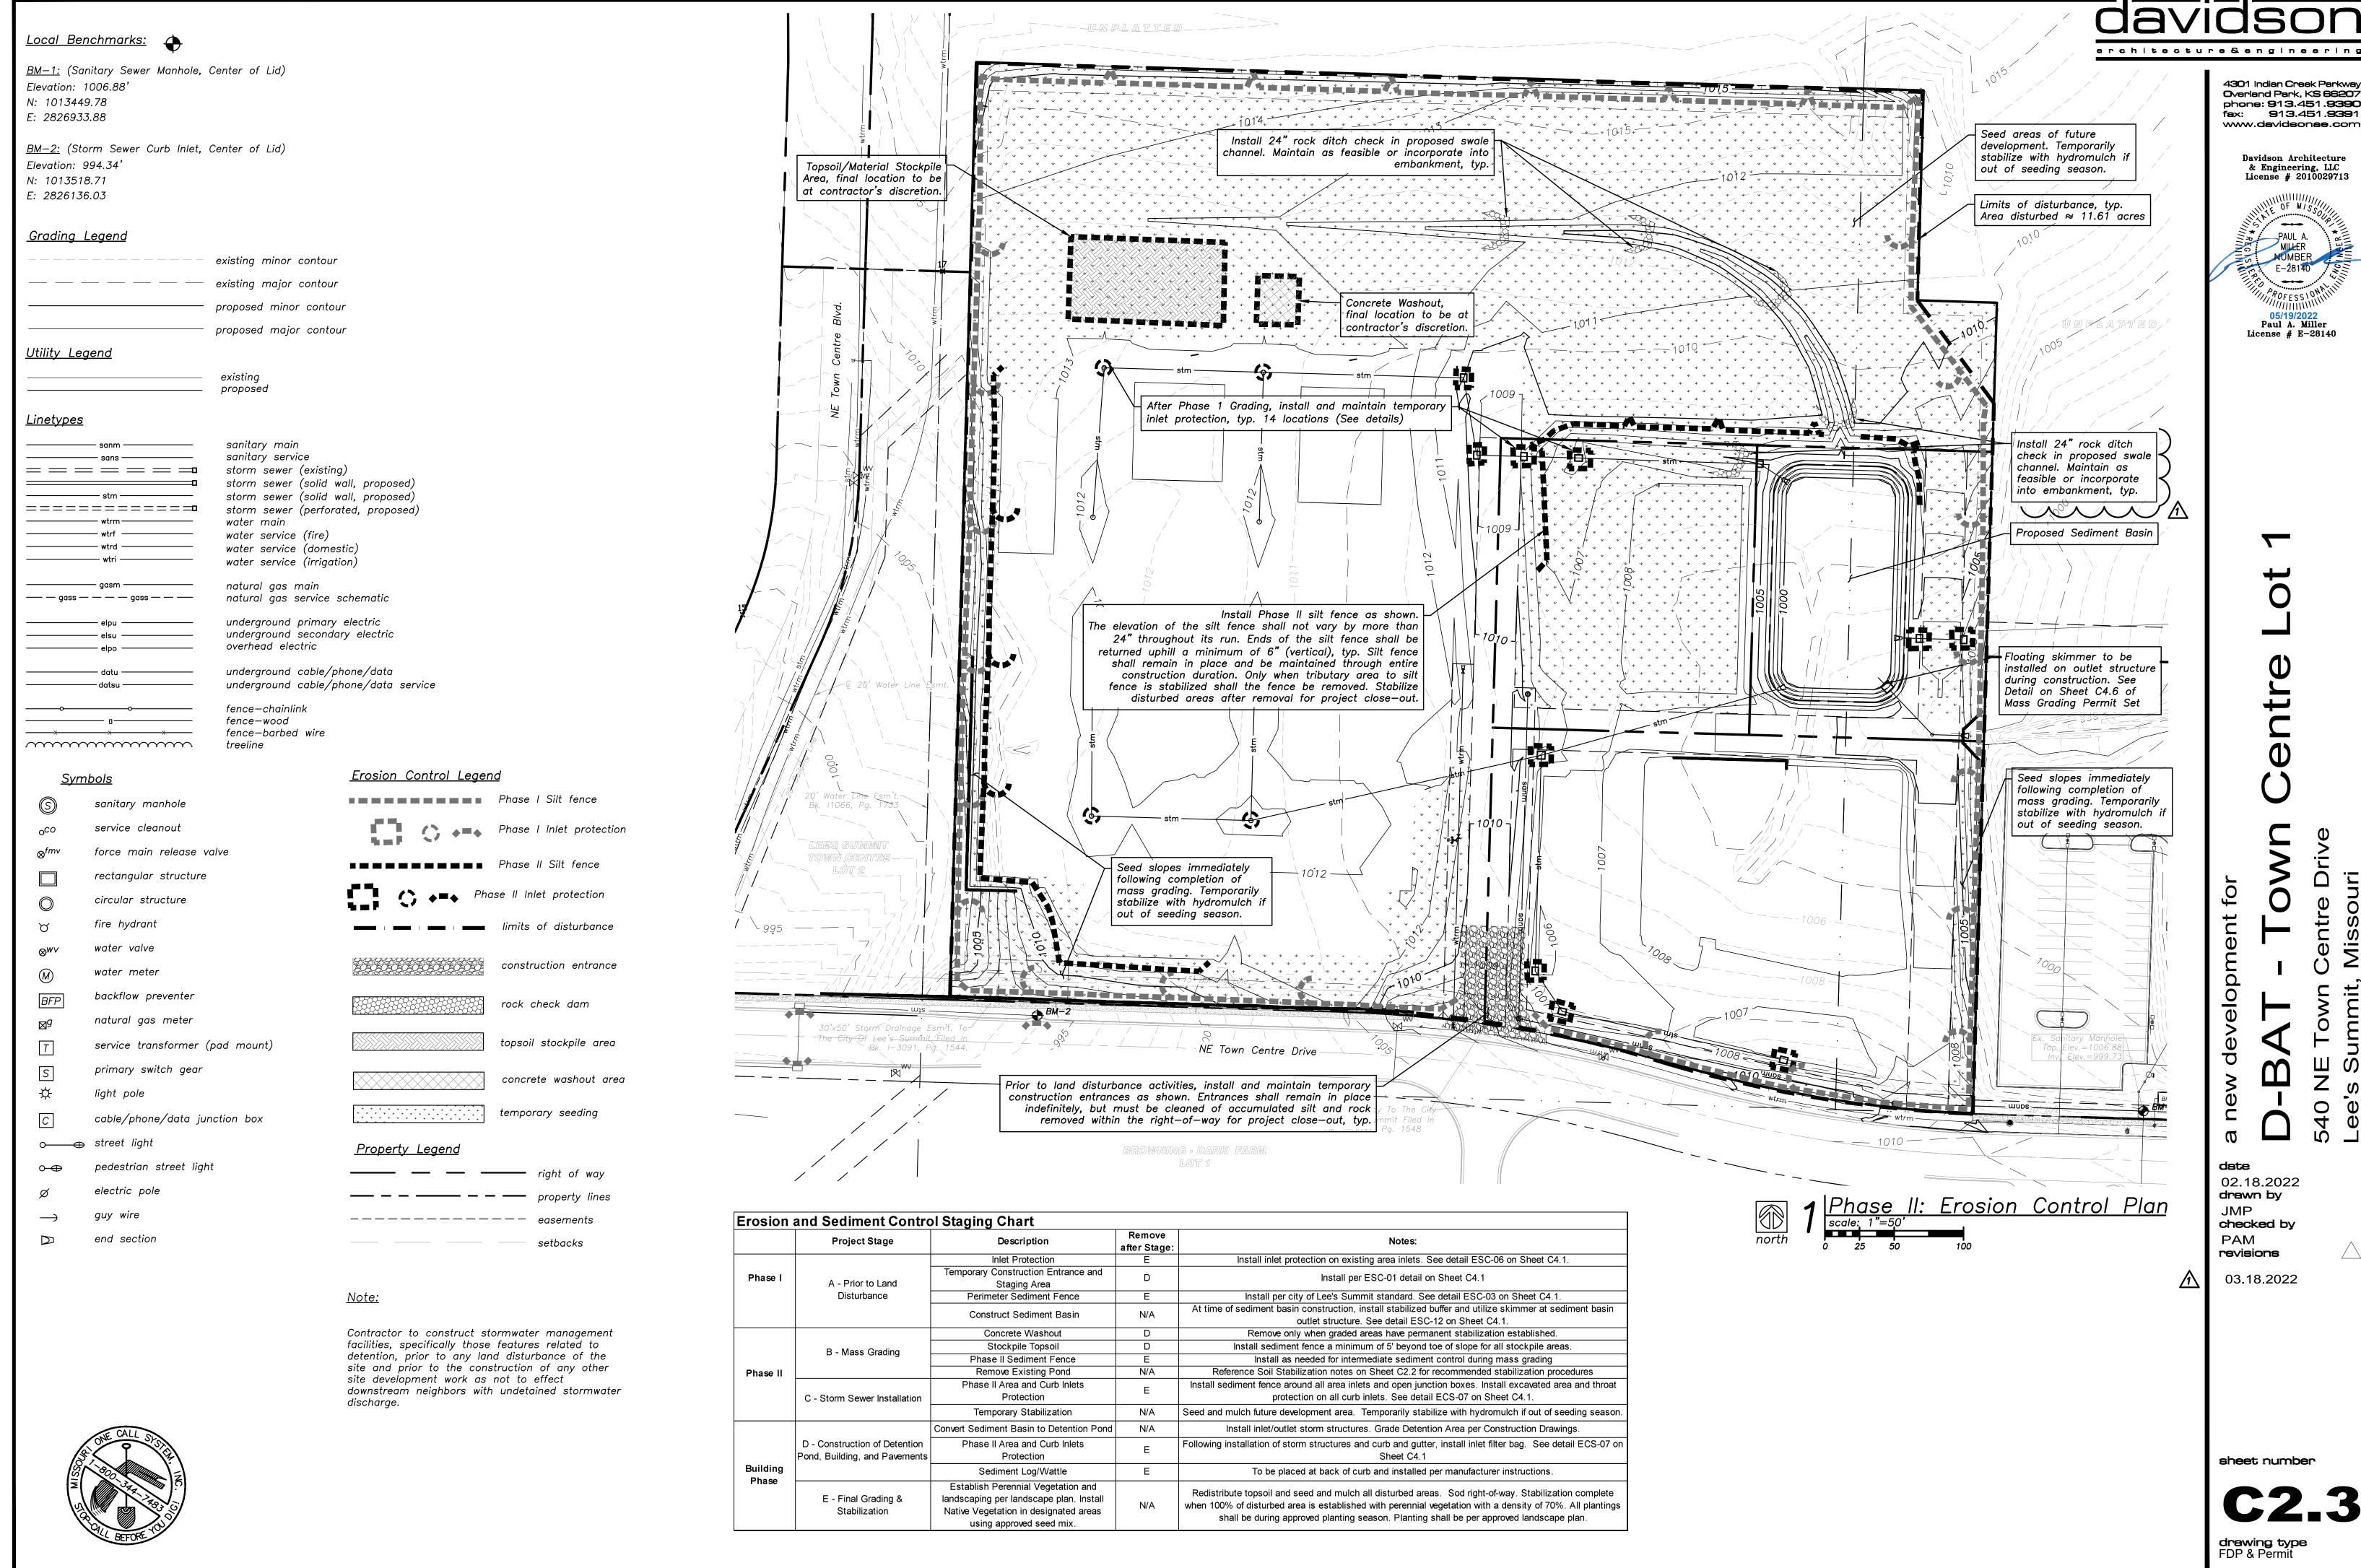


4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fex: 913.451.9391 www.davidsonae.com

> **Davidson Architecture** & Engineering, LLC License # 2010029713

date 02.18.2022 drawn by JMP checked by PAMrevisions

03.18.2022

sheet number

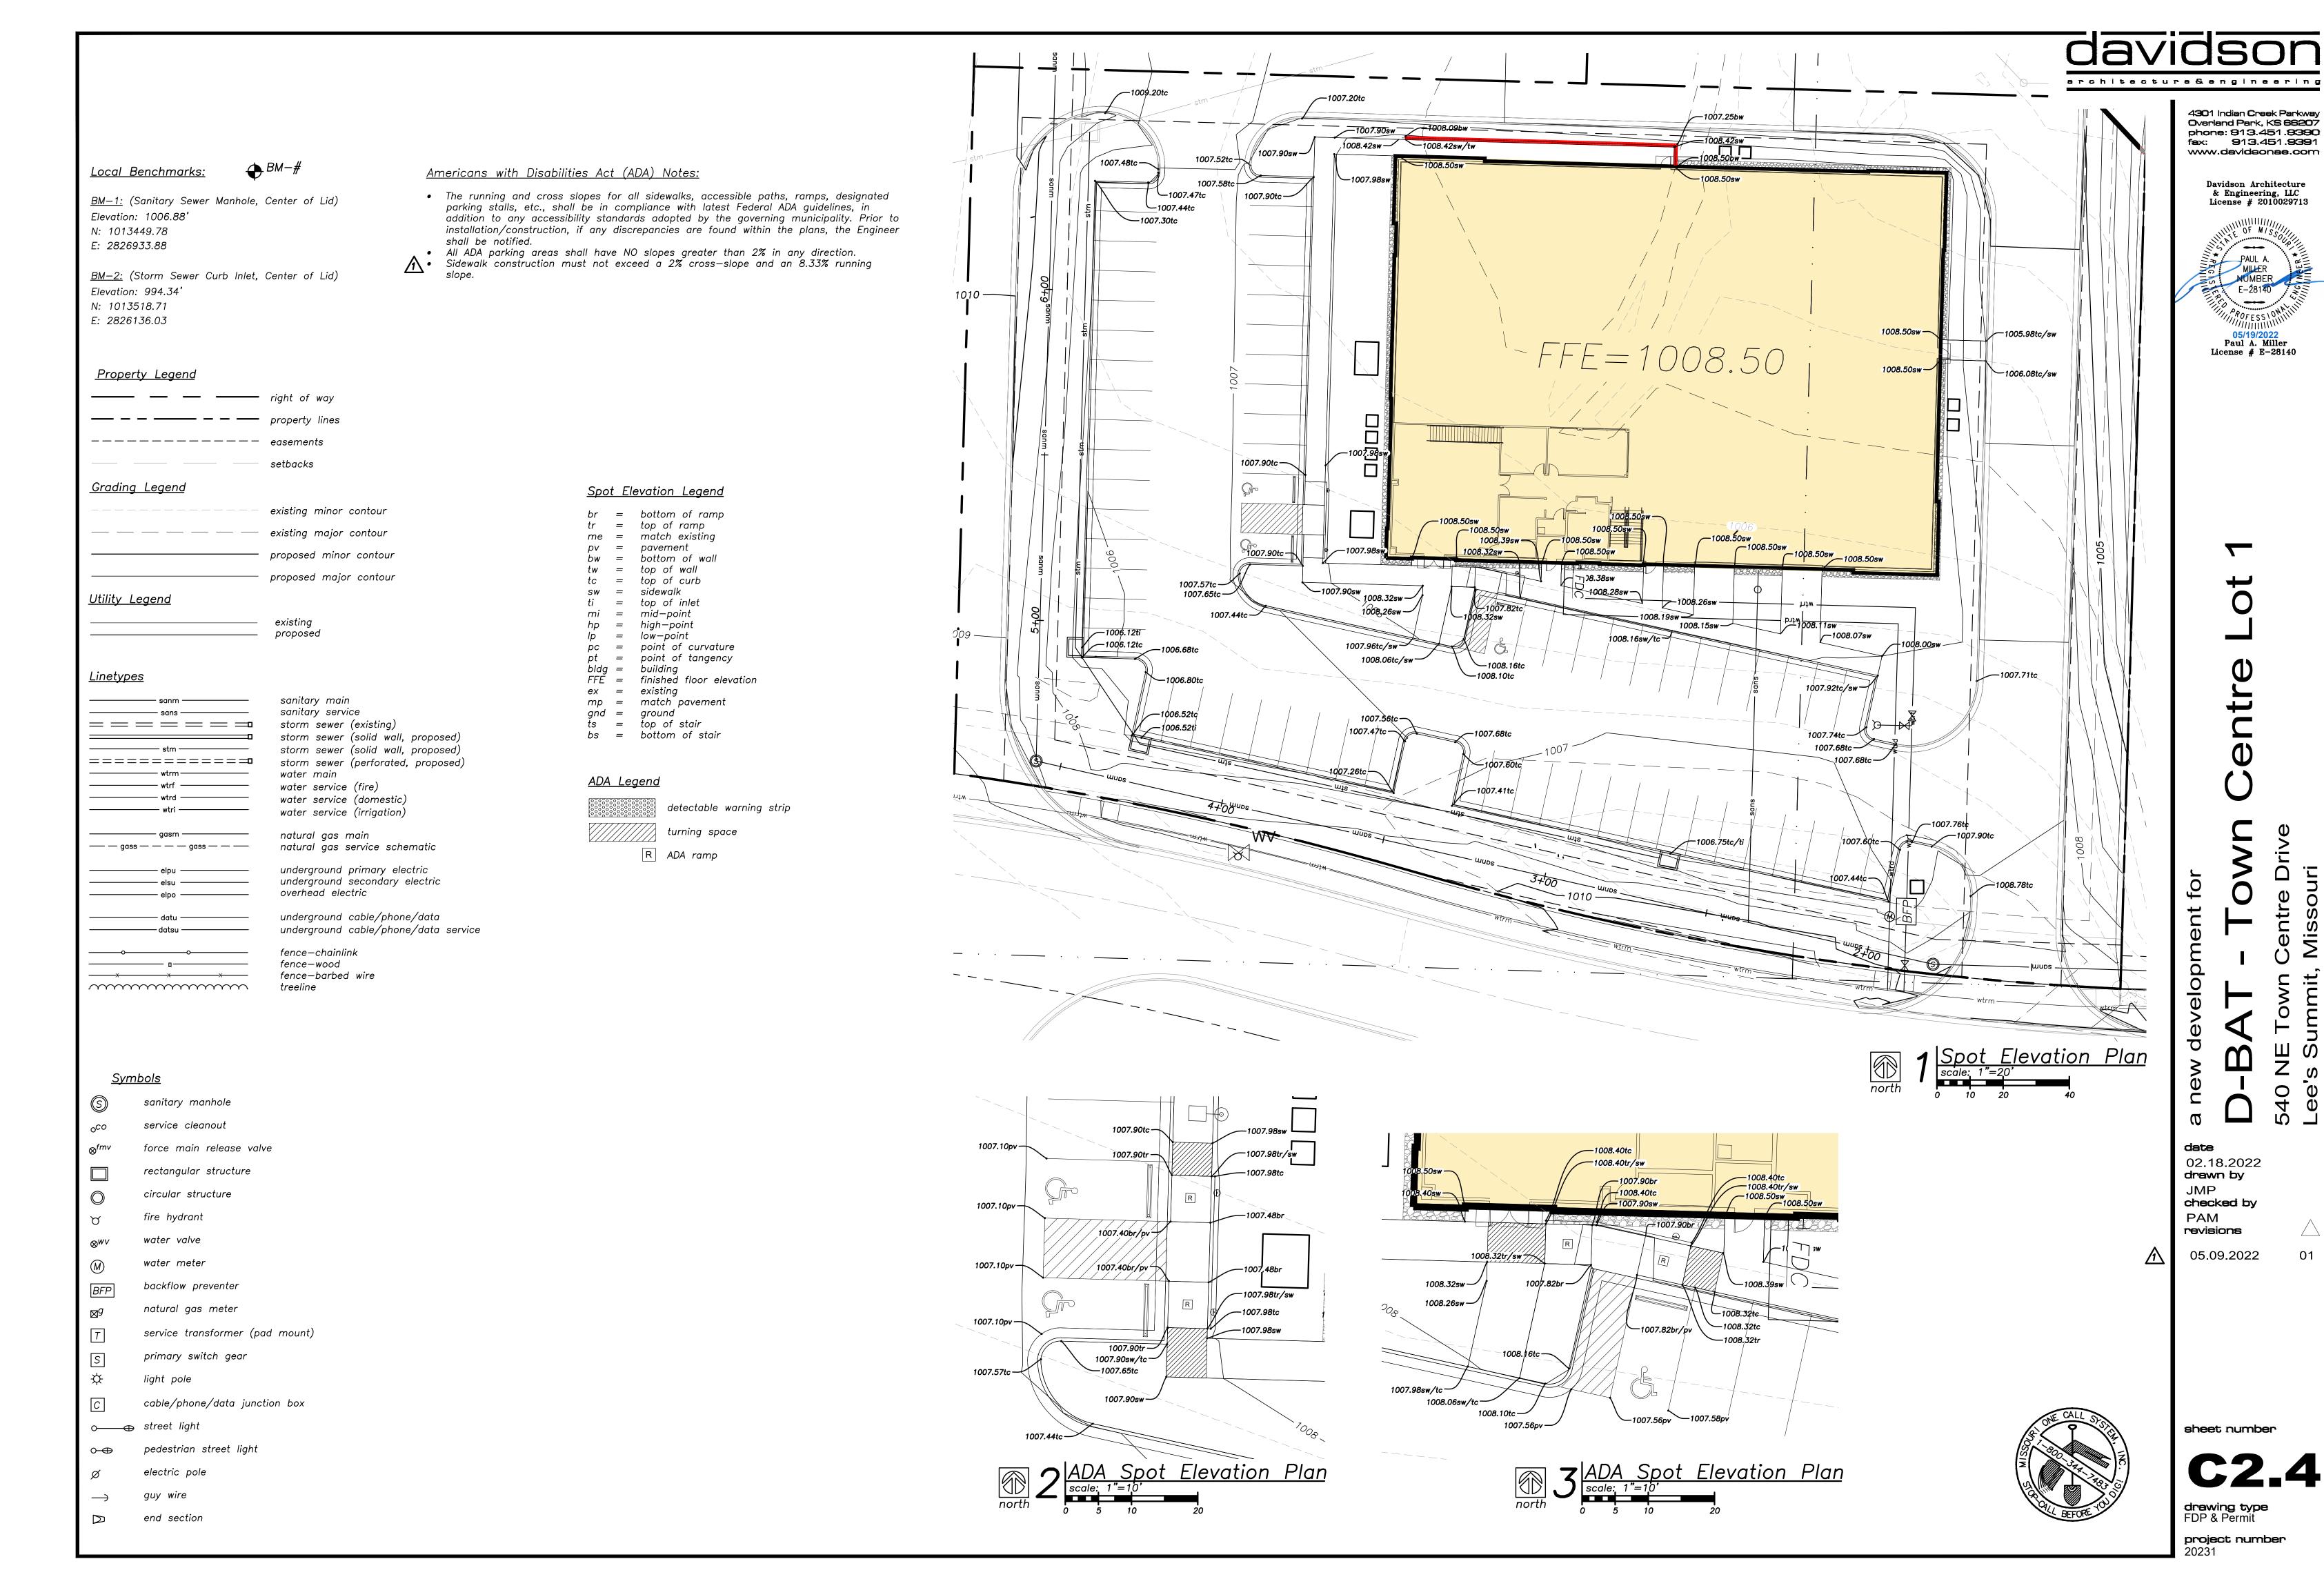

4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fex: 913.451.9391 www.davidsonae.com

> Davidson Architecture & Engineering, LLC License # 2010029713


Paul A. Miller License # E-28140

 $\boldsymbol{\omega}$

date 02.18.2022 drawn by JMP checked by PAM revisions

05.09.2022

sheet number

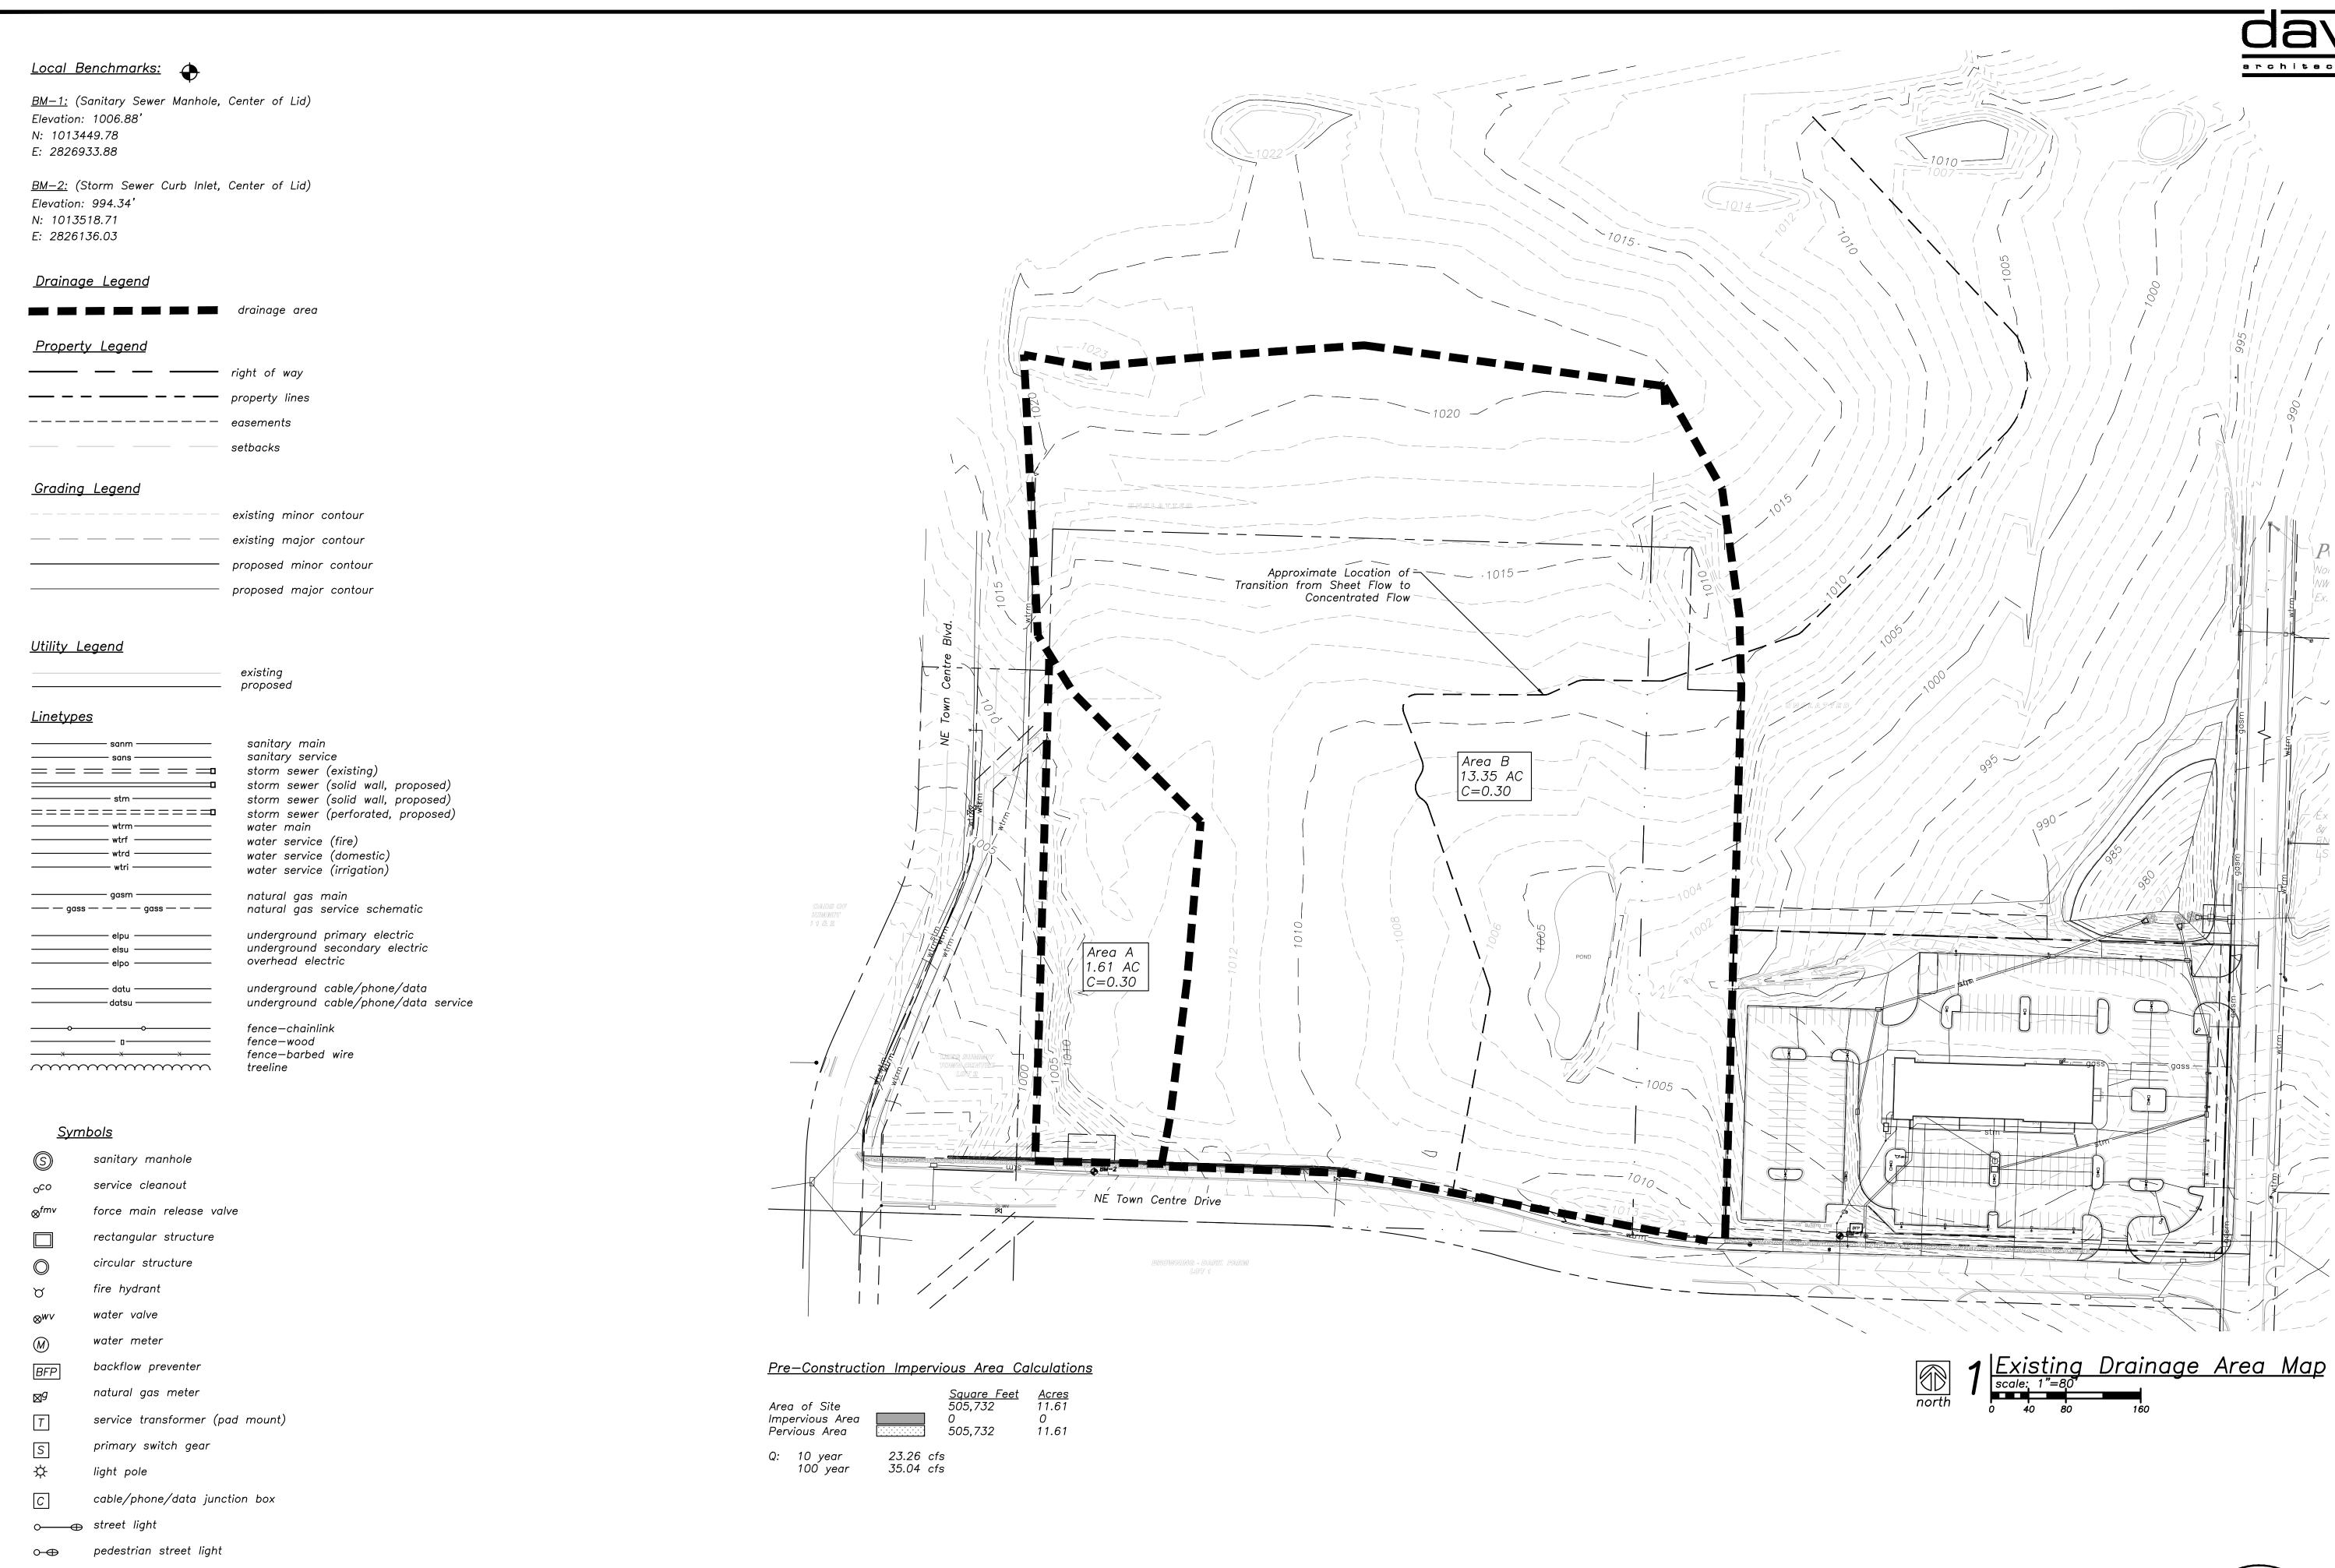

guy wire


end section



4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fax: 913.451.9391 www.davidsonae.com

architecture&engineering


Davidson Architecture & Engineering, LLC License # 2010029713



 $\boldsymbol{\omega}$ date 02.18.2022 drawn by JMP checked by PAM

revisions

sheet number **C3.1**

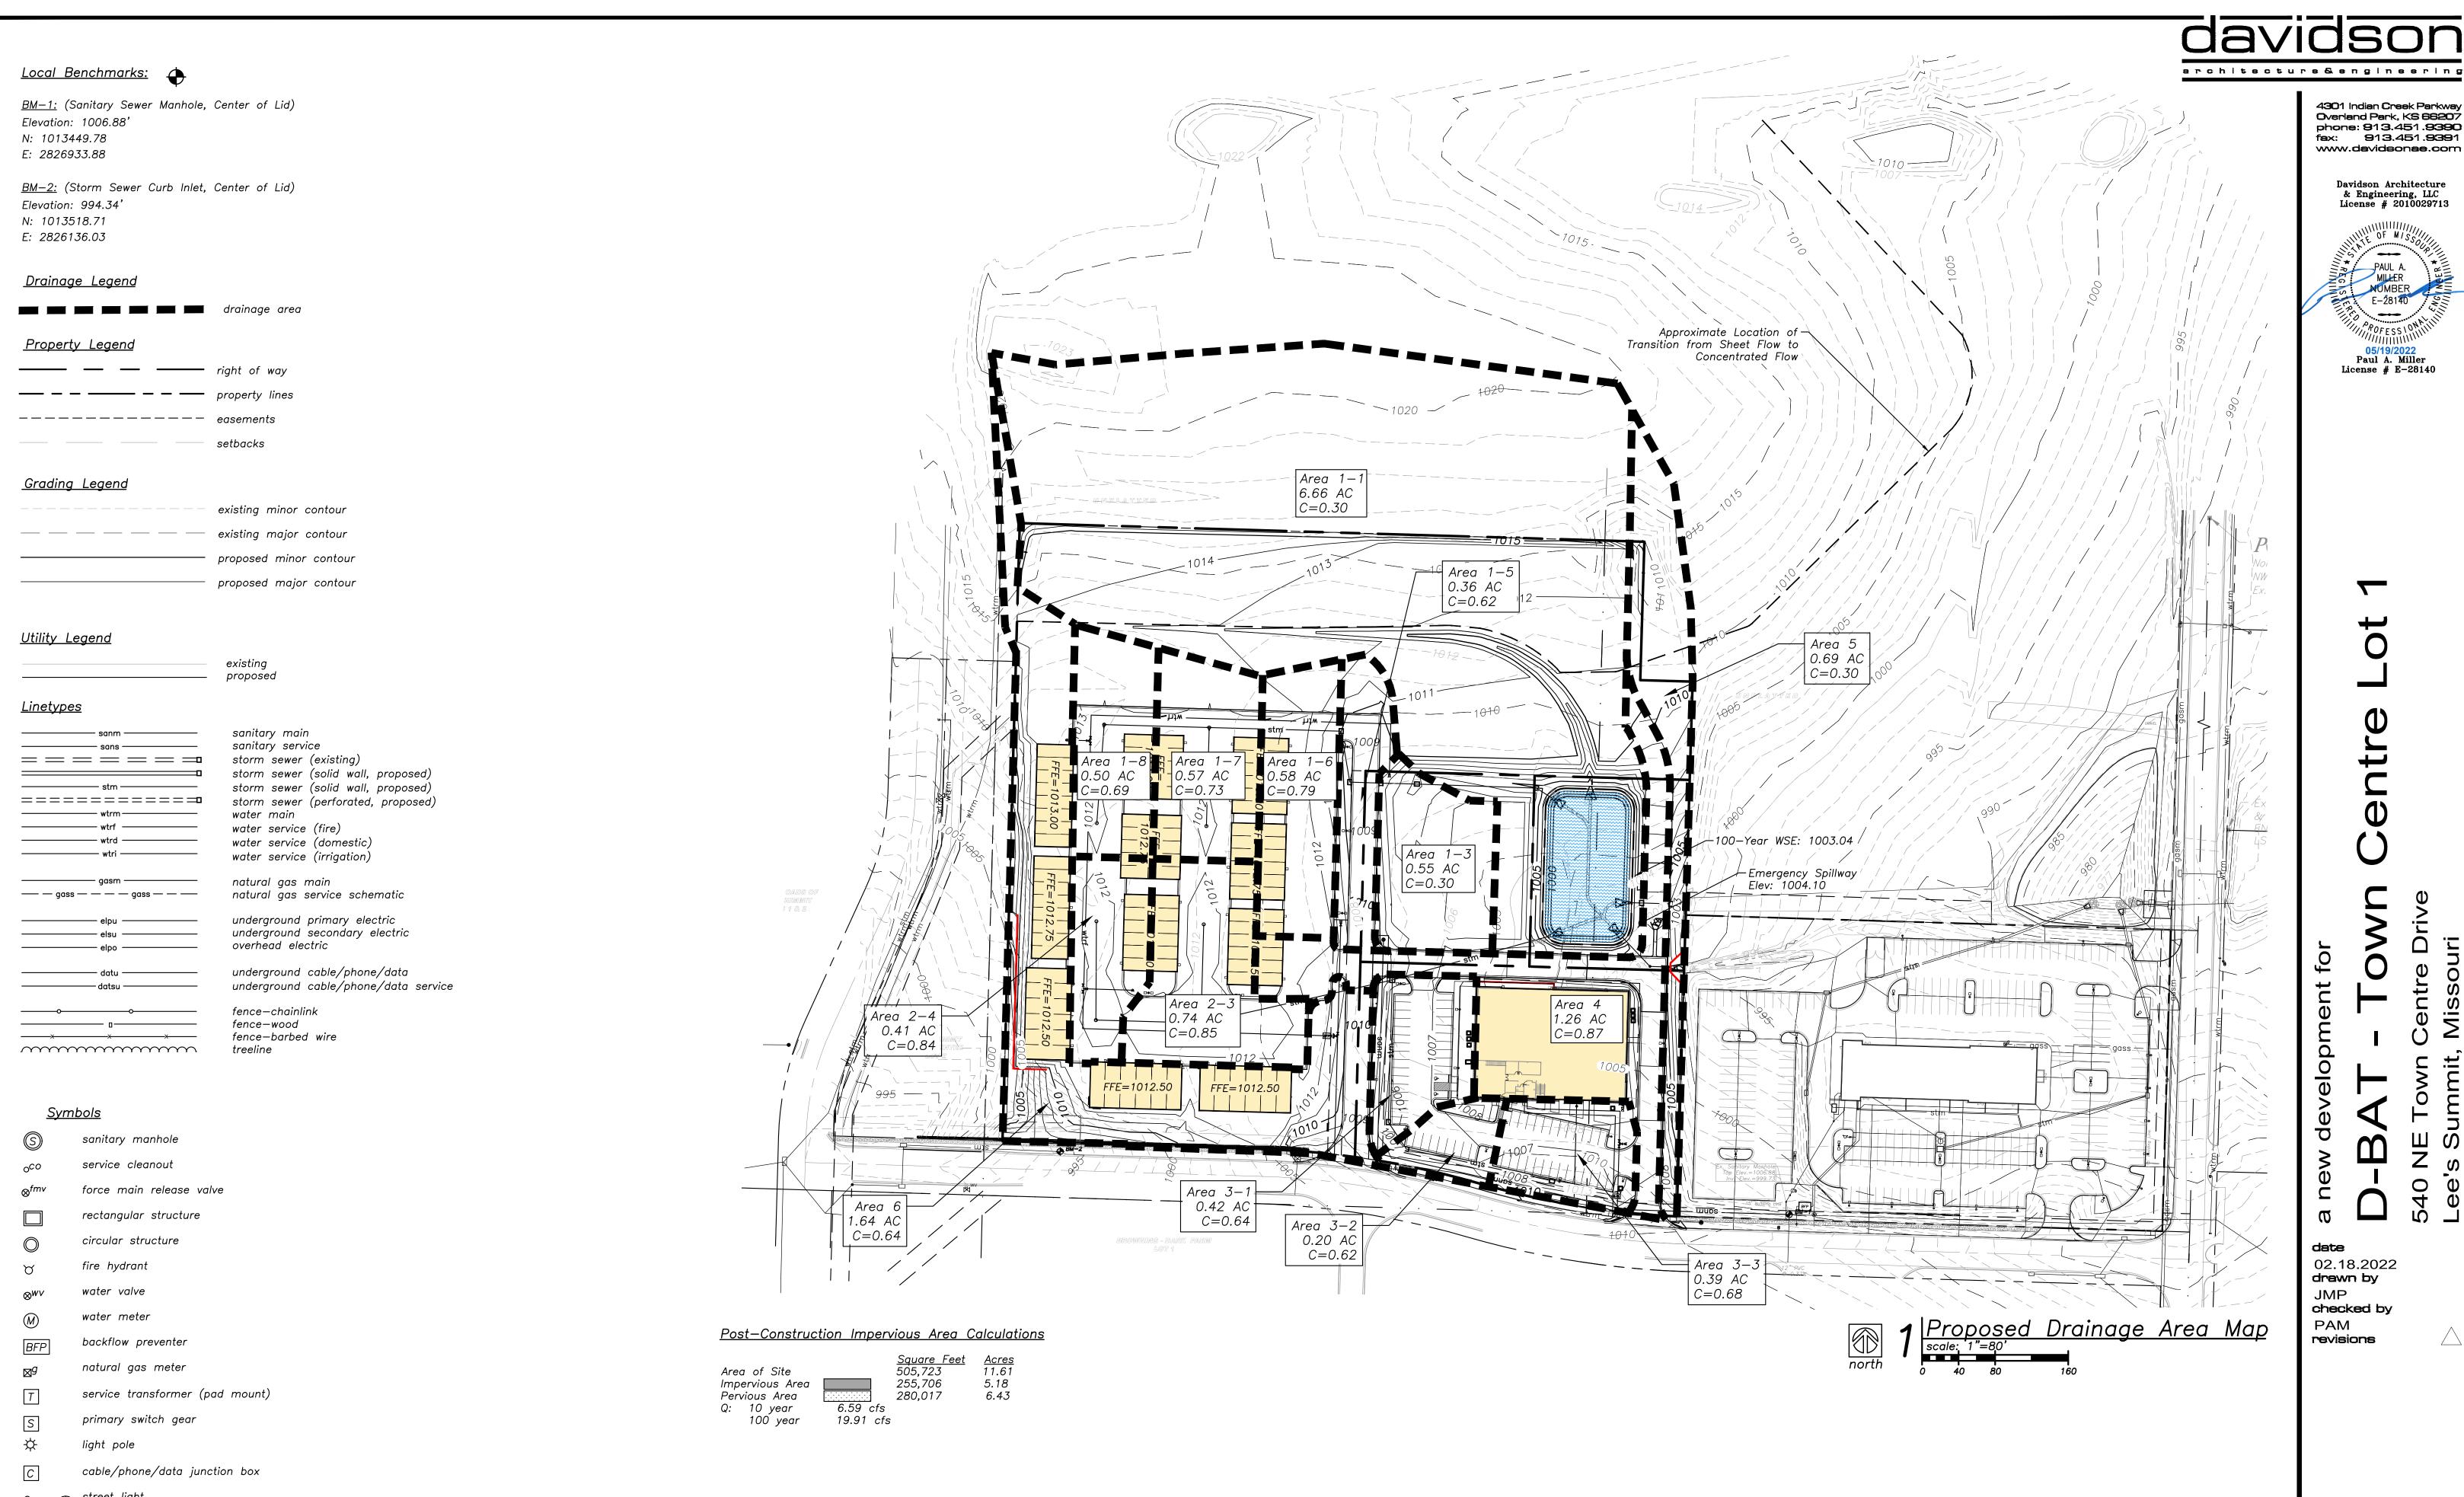

guy wire

end section



4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fax: 913.451.9391 www.davidsonae.com

Davidson Architecture & Engineering, LLC License # 2010029713

velopme

 $\boldsymbol{\omega}$ date 02.18.2022 drawn by JMP checked by PAM revisions

sheet number **C3.2**



4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fax: 913.451.9391 www.davidsonae.com

	LineNo.	InletID	LineID	DrainageArea	RunoffCoeff	TotalRunoff	CapacityFull	DepthDn	DepthUp	CriticalDepth	EGLDn	EGLUp	HGLDn	HGLUp	InvertDn	InvertUp	LineLength	LineSlope	TotalArea	TotalCxA	VelAve	FlowRate
				(ac)	(C)	(cfs)	(cfs)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)	(%)	(ac)		(ft/s)	(cfs)
	1	1-2	1-2 to 1-1	0	0	7.26	17.24	1.14	0.96**	0.96	1002.52	1002.45	1002.15	1002.08	1001.01	1001.12	22.228	0.49	2.56	1.61	4.41	7.26
	2	1-3	1-3 to 1-2	0.55	0.3	7.41	17.4	0.91	0.97**	0.97	1002.61	1003.32	1002.23	1002.95	1001.32	1001.98	130.857	0.5	2.56	1.61	5.12	7.41
\triangle	3	1-4	1-4 to 1-5	0	0	6.7	22.06	0.77	0.92**	0.92	1003.3	1003.77	1002.95	1003.42	1002.18	1002.5	39.492	0.81	2.01	1.44	5.41	6.7
\triangle	4	1-5	1-5 to 1-4	0.36	0.62	6.74	22.23	0.76	0.92**	0.92	1003.8	1004.24	1003.45	1003.89	1002.69	1002.97	34.004	0.82	2.01	1.44	5.49	6.74
	5	1-6	1-6 to 1-5	0.58	0.79	5.76	22.57	0.69	0.85**	0.85	1004.47		1004.15		1003.46		56.578	0.85	1.65	1.22	5.28	5.76
	6	1-7	1-7 to 1-6	0	0	3.7	11.16	0.59	0.73**	0.73	1005.31		<u> </u>	1006.55	1004.43	1005.82	144.508	0.96	1.07	0.76	4.98	3.7
_	7	1-8	1-8 to 1-7	0	0	1.76	10.06	0.53	0.50**	0.5	1006.74	1007.6	+	1007.42 j	1006.02	1006.92	114.98	0.78	0.5	0.35	3.27	1.76
	8	8-1	8-1 to 1-8		0.69	1.8	2.7	0.6	0.6	0.57	1008.23	1008.76		1008.55	1007.42	1007.95	108.116	0.49	0.5	0.35	3.68	1.8
	9	9-1	9-1 to 1-7	0.57	0.73	2.17	3.68	0.55	0.63**	0.63	1007.34	1008.4	1007.07	1008.13	1006.52	1007.5	107.912	0.91	0.57	0.42	4.52	2.17
2\	10	2-2	2-2 to 2-1	0	0	7.64	7.19	1.27	1.32	1.07	1002.63	1003.38	1002.27	1003.04	1001	1001.72	180.275	0.4	2.16	1.63	4.71	7.64
	11	2-3	2-3 to 2-2	0	0	4.8	7.89	1.25	0.89**	0.89	1003.65	1006	1003.42	1005.59 j	1001.97	1004.7	214.634	1.27	1.15	0.97	4.53	4.8
	12	2-4	2-4 to 2-3	0	0	1.76	8.25	0.64	0.53**	0.53	1005.79	1007.28	1005.59	1007.08 j	1004.95	1006.55	114.996	1.39	0.41	0.34	3.19	1.76
	13	10-1	10-1 to 2-4	0.41	0.84	1.79	2.73	0.59	0.59	0.57	1007.61	1008.15	1007.39	1007.93	1006.8	1007.34	108.098	0.5	0.41	0.34	3.71	1.79
	14	11-1	11-1 to 2-3	0.74	0.85	3.28	5.45	0.56	0.77**	0.77	1006.15	1008.53	1005.76	1008.13	1005.2	1007.36	108.051	2	0.74	0.63	6.14	3.28
2\	15	3-1	3-1 to 2-2	0.42	0.64	3.19	8.05	1.39	0.68**	0.68	1003.63	1003.69	1003.36	,	1001.97	1002.75	155.694	0.5	1.01	0.66	2.98	3.19
2\	16	3-2	3-2 to 3-1	0.2	0.62	1.9	4.86	0.54	0.55**	0.55	1003.75	1003.93	1003.54	1003.72	1003	1003.17	35.163	0.48	0.59	0.39	3.7	1.9
2	17	3-3	3-3 to 3-2	0.39	0.68	1.38	4.92	0.45	0.46**	0.46	1004	1004.82	1	1004.64		1004.18	163.499	0.5	0.39	0.27	3.39	1.38
	18	4-2	4-2 to 4-1		0	5.69	4.7	0.97	1.1	0.97	1001.83	1001.94	1001.35	1001.55	1000.38	1000.45	15.493	0.45	1.26	1.1	5.28	5.69
	19	4-3	4-3 to 4-2	1.26	0.87	5.71	4.95	1.25	1.25	0.97			1		1000.65	†	32.013	0.5	1.26	1.1	4.65	5.71
	20	7-2	7-2 to 7-1	0	0	0	15.13	2	2	0.16			1002.85			999.82	20.988	0.38	0	0	0.07	0.21
\triangle	21	7-3	7-3 to 7-2	0	0	0	15.46	2	2	0.16	1002.85	1002.85	1002.85	1002.85	999.82	1000	45.234	0.4	0	0	0.07	0.21

10—Year Storm Calculations

ſ	LineNo.	InletID	LineID	DrainageArea	RunoffCoeff	TotalRunoff	apacityFu	DepthDn	DepthUp	CriticalDepth	EGLDn	EGLUp	HGLDn	HGLUp	InvertDn	InvertUp	LineLength	LineSlope	TotalArea	TotalCxA	VelAve	FlowRate
				(ac)	(C)	(cfs)	(cfs)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)	(%)	(ac)		(ft/s)	(cfs)
	1	1-2	1-2 to 1-1	0	0	10.66	17.24	1.14	1.17**	1.17	1002.64	1002.78	1002.15	1002.29	1001.01	1001.12	22.228	0.49	2.56	1.61	5.68	10.66
	2	1-3	1-3 to 1-2	0.55	0.3	10.81	17.4	1.14	1.18**	1.18	1002.95	1003.65	1002.46	1003.16	1001.32	1001.98	130.857	0.5	2.56	1.61	5.73	10.81
\triangle	3	1-4	1-4 to 1-5	0	0	9.75	22.06	0.98	1.12**	1.12	1003.61	1004.07	1003.16	1003.62	1002.18	1002.5	39.492	0.81	2.01	1.44	5.9	9.75
Λ	4	1-5	1-5 to 1-4	0.36	0.62	9.79	22.23	0.93	1.12**	1.12	1004.08	1004.55	1003.62	1004.09	1002.69	1002.97	34.004	0.82	2.01	1.44	6.13	9.79
\triangle	5	1-6	1-6 to 1-5	0.58	0.79	8.34	22.57	0.84	1.03**	1.03	1004.71	1005.38	1004.3	1004.97	1003.46	1003.94	56.578	0.85	1.65	1.22	5.88	8.34
	6	1-7	1-7 to 1-6	0	0	5.3	11.16	0.73	0.89**	0.89	1005.53	1007.08	1005.16	1006.71	1004.43	1005.82	144.508	0.96	1.07	0.76	5.56	5.3
	7	1-8	1-8 to 1-7	0	0	2.48	10.06	0.69	0.60**	0.6	1006.93	1007.74	1006.71	1007.52 j	1006.02	1006.92	114.98	0.78	0.5	0.35	3.47	2.48
	8	8-1	8-1 to 1-8	0.5	0.69	2.52	2.7	0.77	0.76	0.68	1008.42	1008.95	1008.19	1008.71	1007.42	1007.95	108.116	0.49	0.5	0.35	3.91	2.52
	9	9-1	9-1 to 1-7	0.57	0.73	3.04	3.68	0.69	0.75**	0.75	1007.58	1008.61	1007.21	1008.25	1006.52	1007.5	107.912	0.91	0.57	0.42	5.03	3.04
<u> </u>	10	2-2	2-2 to 2-1	0	0	11.1	7.19	1.27	1.5	1.27	1003.02	1004.69	1002.27	1004.08	1001	1001.72	180.275	0.4	2.16	1.63	6.61	11.1
	11	2-3	2-3 to 2-2	0	0	6.85	7.89	1.25	1.25	1.05	1005.23	1007.29	1004.75	1006.8	1001.97	1004.7	214.634	1.27	1.15	0.97	5.58	6.85
	12	2-4	2-4 to 2-3	0	0	2.48	8.25	1.25	0.86	0.63	1007.35	1007.53	1007.29	1007.41	1004.95	1006.55	114.996	1.39	0.41	0.34	2.38	2.48
	13	10-1	10-1 to 2-4	0.41	0.84	2.51	2.73	0.76	0.76	0.68	1007.8	1008.34	1007.56	1008.1	1006.8	1007.34	108.098	0.5	0.41	0.34	3.94	2.51
	14	11-1	11-1 to 2-3	0.74	0.85	4.59	5.45	1	1	0.89	1007.82	1009.35	1007.29	1008.82	1005.2	1007.36	108.051	2	0.74	0.63	5.85	4.59
<u> </u>	15	3-1	3-1 to 2-2	0.42	0.64	4.58	8.05	1.5	1.5	0.82	1004.77	1005.02	1004.66	1004.92	1001.97	1002.75	155.694	0.5	1.01	0.66	2.59	4.58
<u> </u>	16	3-2	3-2 to 3-1	0.2	0.62	2.72	4.86	1.25	1.25	0.66	1005.06	1005.11	1004.98	1005.04	1003	1003.17	35.163	0.48	0.59	0.39	2.22	2.72
<u> </u>	17	3-3	3-3 to 3-2	0.39	0.68	1.94	4.92	1.25	1.03	0.55	1005.13	1005.26	1005.09	1005.21	1003.37	1004.18	163.499	0.5	0.39	0.27	1.69	1.94
	18	4-2	4-2 to 4-1	0	0	7.99	4.7	1.11	1.25	1.11	1002.24	1002.43	1001.49	1001.77	1000.38	1000.45	15.493	0.45	1.26	1.1	6.71	7.99
	19	4-3	4-3 to 4-2	1.26	0.87	8	4.95	1.25	1.25	1.11	1002.56	1002.98	1001.9	1002.32	1000.65	1000.81	32.013	0.5	1.26	1.1	6.52	8
	20	7-2	7-2 to 7-1	0	0	0	15.13	2	2	0.28	1002.85	1002.85	1002.85	1002.85	999.74	999.82	20.988	0.38	0	0	0.21	0.66
Λ	21	7-3	7-3 to 7-2	0	0	0	15.46	2	2	0.28	1002.85	1002.85	1002.85	1002.85	999.82	1000	45.234	0.4	0	0	0.21	0.66

100-Year Storm Calculations



date
02.18.2022
drawn by
JMP
checked by
PAM
revisions

03.18.2022 05.09.2022

sheet number **drewing type** FDP & Permit

<u>Utility Notes</u>

- Boundary information, existing utilities and topographic features shown are based on information supplied by owner, surveyor, and others.
- The existing utility locations shown on these plans are approximate and may not include all utility lines present. The contractor shall be responsible to make One Call and coordinate field location of all existing underground utilities prior to beginning excavation/construction activities.
- The contractor shall be responsible for any damage to any utilities or their structures during excavation/construction activities.
- The contractor shall coordinate and be responsible for connection fees, system development fees, taxes, etc. for all main connections and/or extensions with and from the city and/or respective utility unless otherwise coordinated with the Owner. All utility services for this project shall be coordinated with respective utility company by contractor.
- The contractor shall be responsible for adjusting all at-grade utilities such as manhole covers, valve box covers, etc. to finish grade, whether specifically indicated in these plans or not.
- Utilities shown on the plan with specific elevations and/or structure locations are SUE quality level "B", ie: storm sewer, sanitary sewer, water hydrants & valves, utility poles, etc. All other existing utility information shown is SUE quality level "D", primarily retracement of one—call and city records.

Property Legend

 	right of way
 	property lines
 	easements
 	setbacks

<u>Grading Legend</u>

 existing minor contour
 existing major contour
 proposed minor contour
 proposed major contour

<u>Utility Legend</u>

existing proposed
' '

<u>Linetypes</u>

sanm	sanitary main
sans	sanitary service
========	storm sewer (existing)
stm	storm sewer (solid wall, proposed) storm sewer (solid wall, proposed)
wtrm	storm sewer (perforated, proposed) water main water service (fire) water service (domestic) water service (irrigation)
gasm gass gass	natural gas main natural gas service schematic
elpu ————————————————————————————————————	underground primary electric underground secondary electric overhead electric
	underground cable/phone/data underground cable/phone/data service

fence-chainlink

<u>Local Benchmarks:</u>

Elevation: 1006.88'

N: 1013449.78

<u>BM-1:</u> (Sanitary Sewer Manhole, Center of Lid)

<u>BM-2:</u> (Storm Sewer Curb Inlet, Center of Lid)

fence-wood fence-barbed wire

treeline

<u>Symbols</u>

sanitary manhole

service cleanout

force main release valve E: 2826933.88

circular structure Elevation: 994.34' N: 1013518.71 fire hydrant E: 2826136.03

water valve

water meter

backflow preventer natural gas meter

service transformer (pad mount)

primary switch gear

✡

cable/phone/data junction box

pedestrian street light


electric pole






Curb Inlet Coordinates are for Center Back of Curb


Grate Inlet, Junction Boxes, & Manhole Coordinates are to Center of Structure





Proposed Pipe and Structures




Existing Pipe and Structures

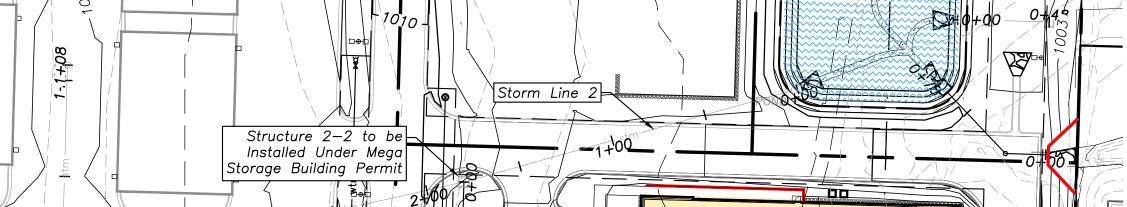

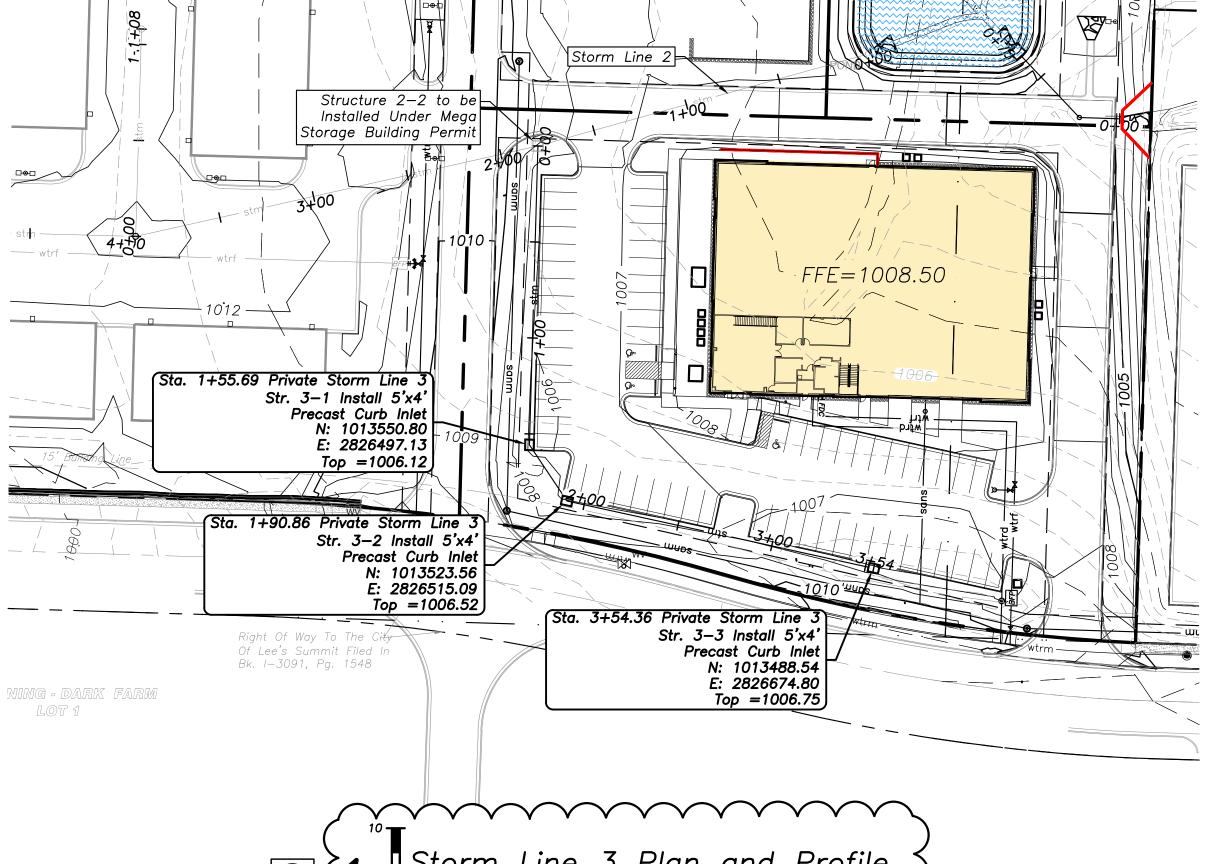

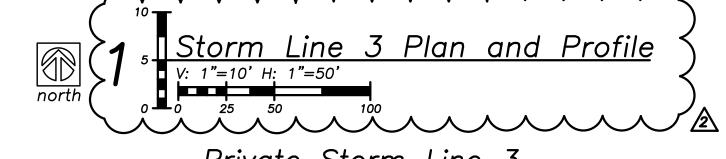

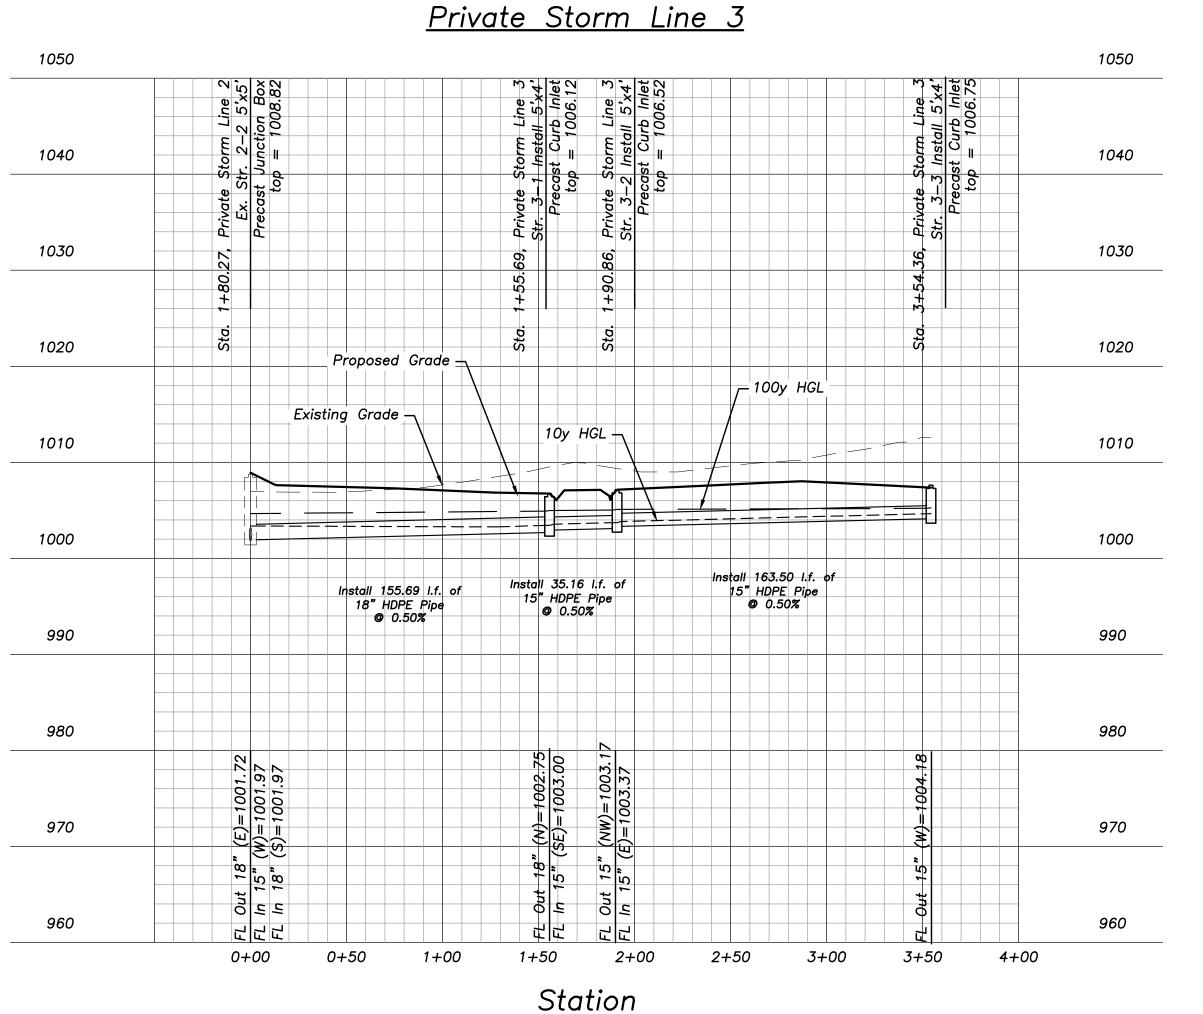

4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fex: 913.451.9391

architecture & engineering

www.davidsonae.com

Davidson Architecture & Engineering, LLC License # 2010029713

Paul A. Miller License # E-28140

development


Ø date 02.18.2022 drawn by JMP checked by PAM

revisions

05.09.2022 05.18.2022


02

sheet number

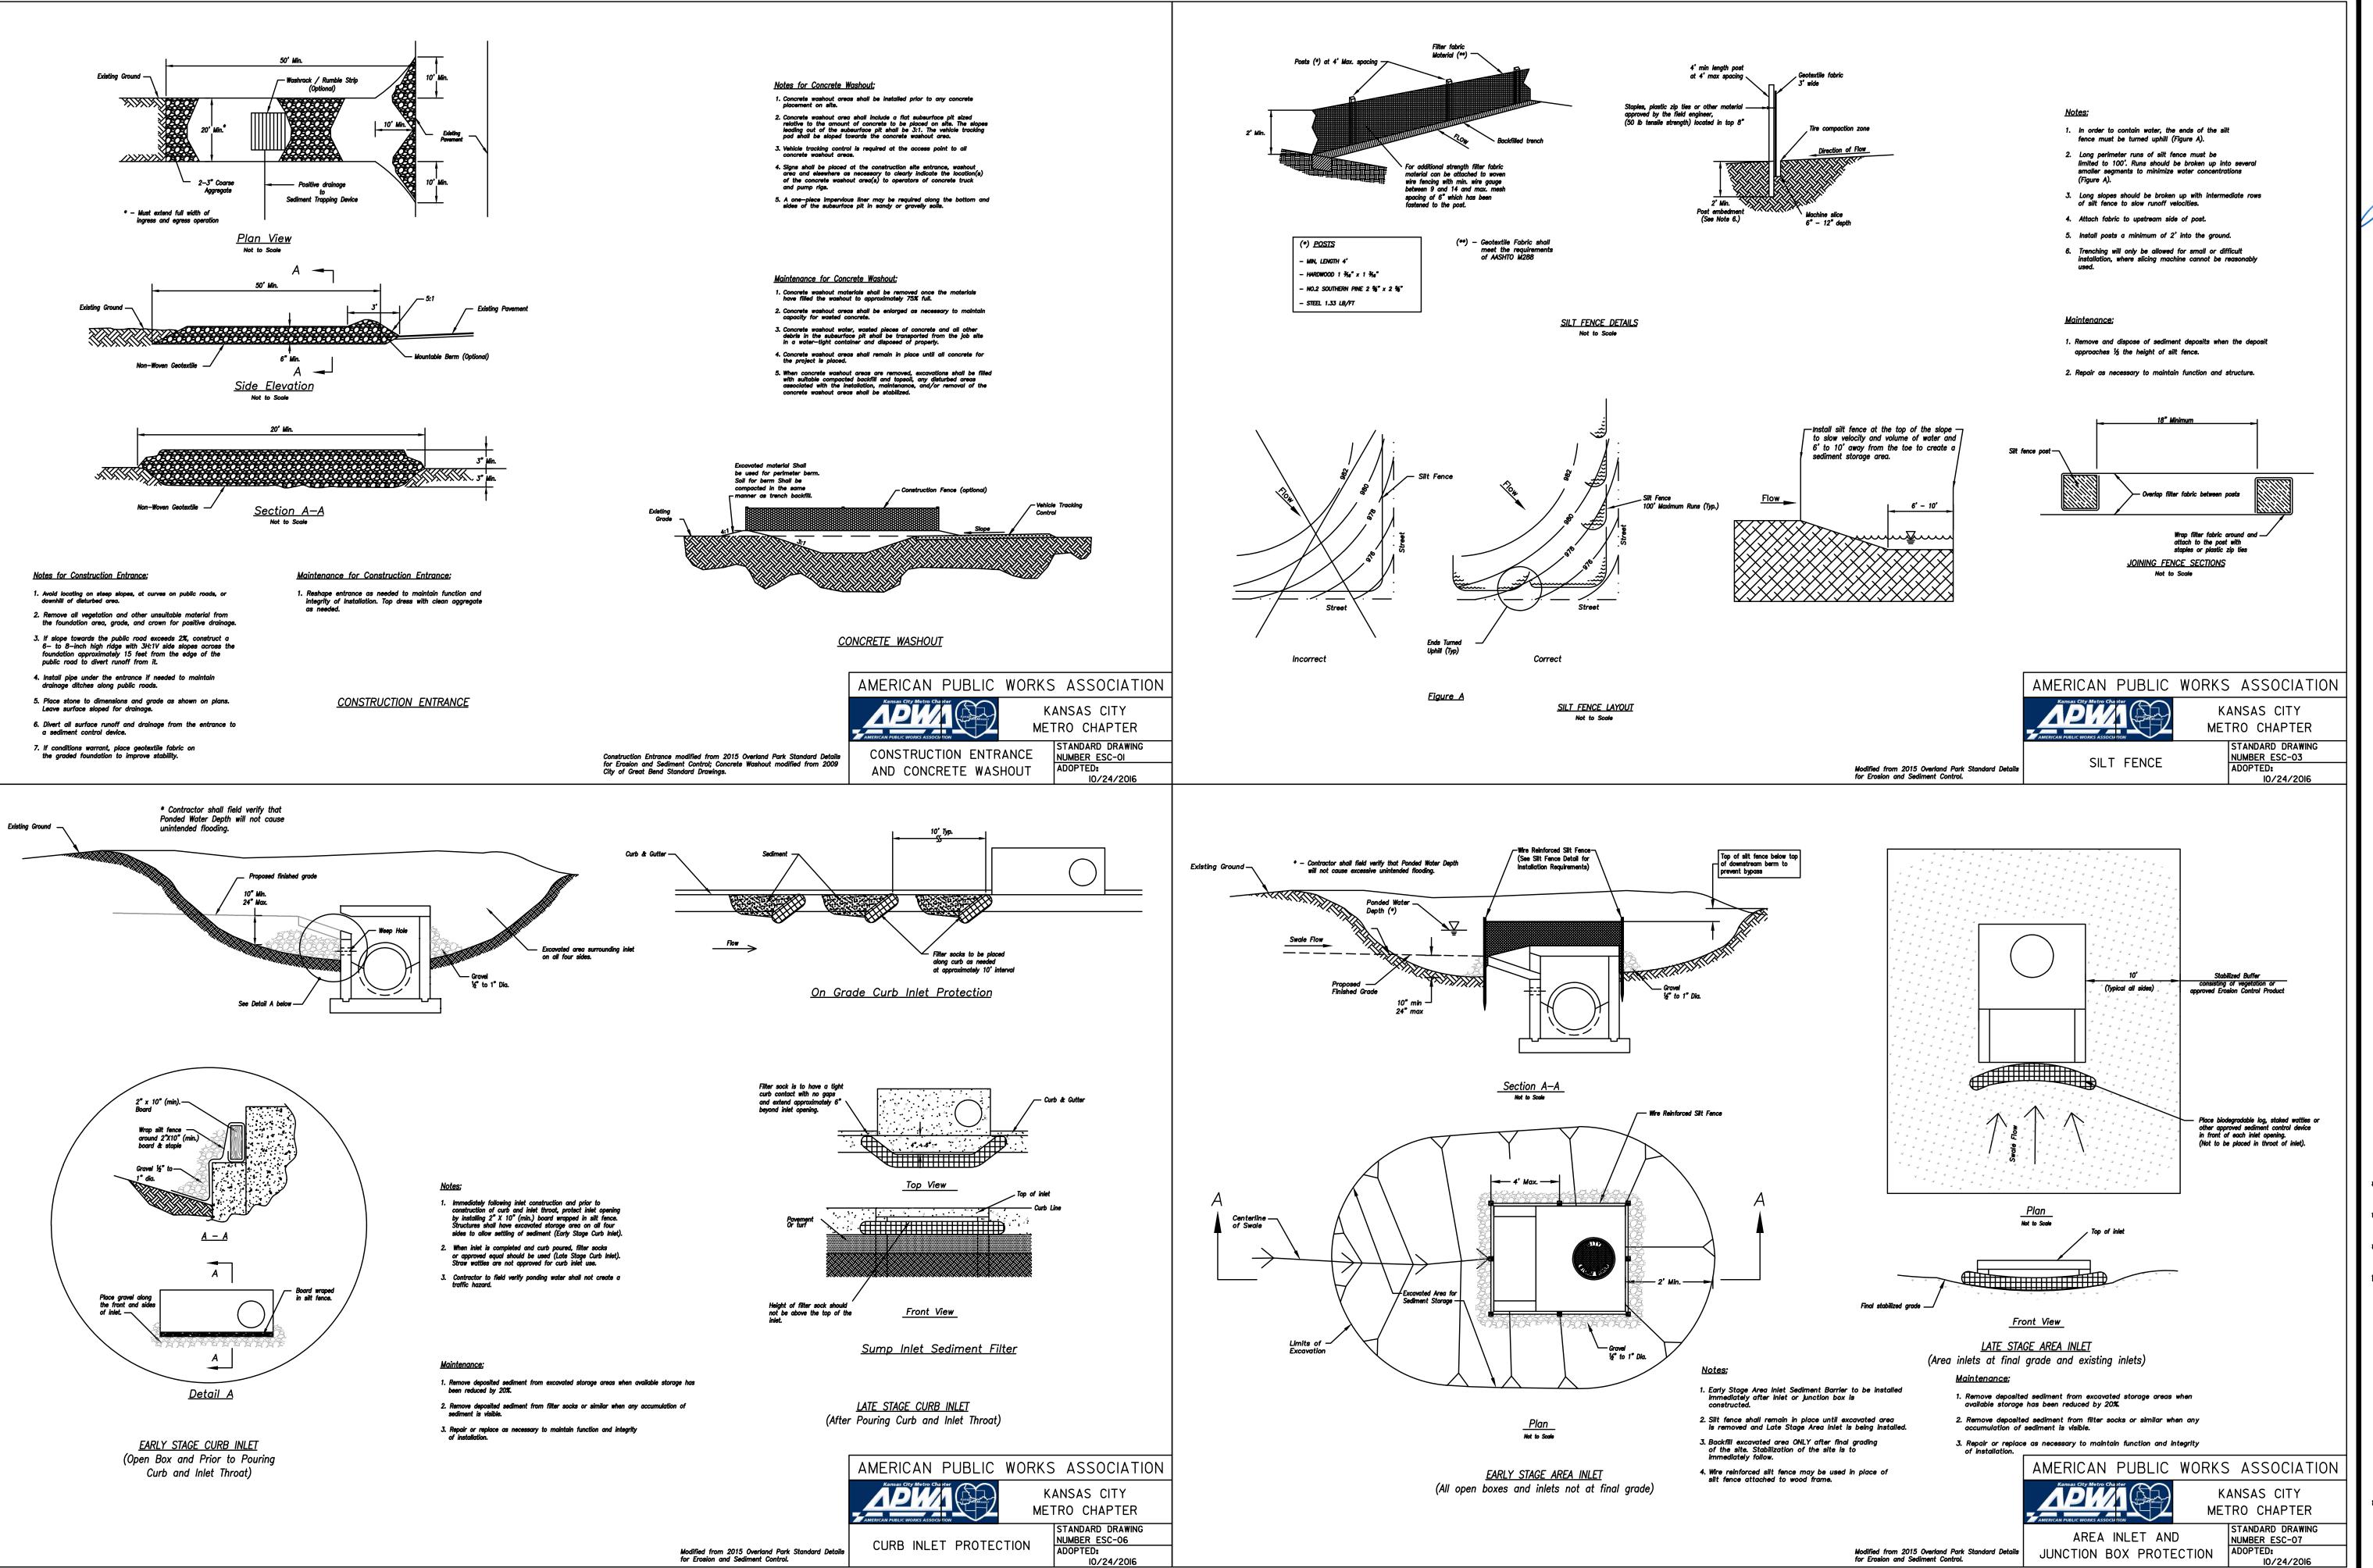

4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fax: 913.451.9391 www.davidsonae.com

> Davidson Architecture & Engineering, LLC License # 2010029713



License # E-28140

elol

date 02.18.2022 drawn by JMP checked by PAMrevisions

sheet number

drawing typeFDP & Permit

4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390

fax: 913.451.9391


www.davidsonae.com

Davidson Architecture & Engineering, LLC

License # 2010029713

Paul A. Miller

License # E-28140

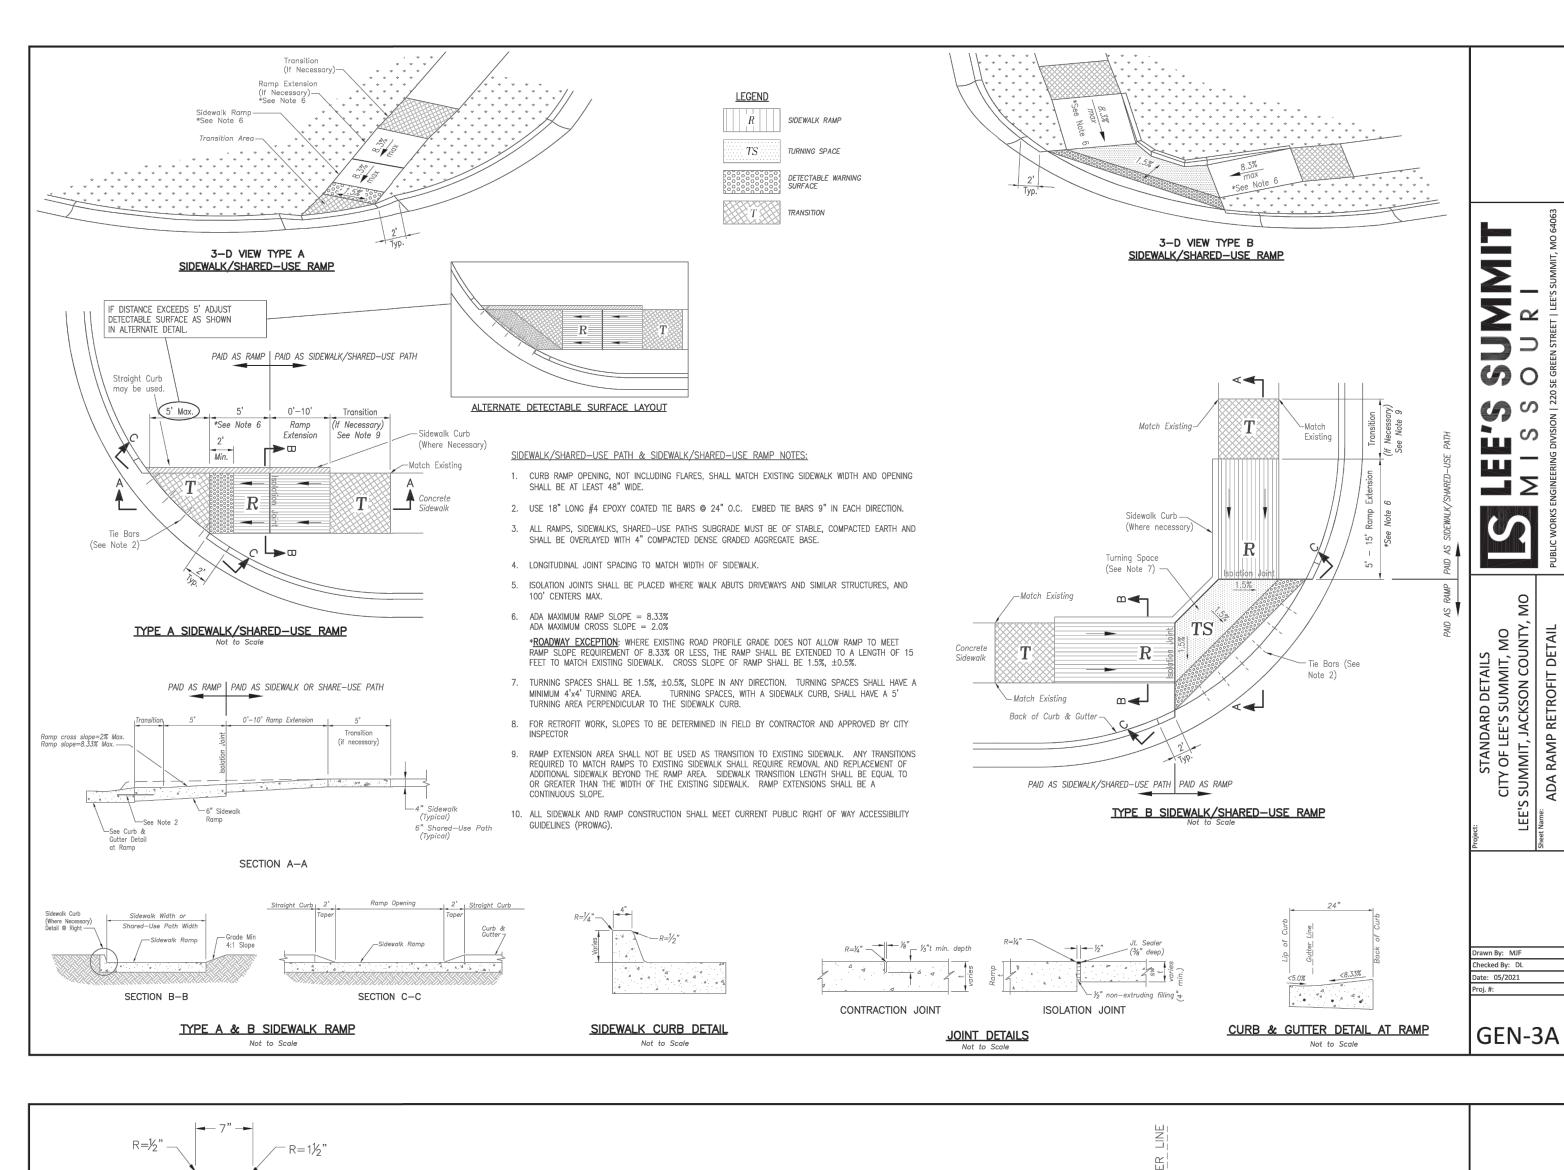

TOP OF SURFACE COURSE

TOP OF BASE COURSE

— #4X1'−0" @ 5' CTS

DOWELLED CURB

(TYPE DC)

ROLL BACK CURB &

(TYPE CG-2)

4" + 8" - 8" - 4" +

24"

ROLL BACK DRY CURB &

<u>GUTTER</u>

(TYPE CG-2 DRY)

<u>CURB & GUTTER DETAIL AT RAMP</u>

(ADA SLOPE REQUIREMENTS)

2" ASPHALTIC CONCRETE SURFACE COURSE

— CURB & GUTTER

CURB REPLACEMENT DETAIL

END WITH EXPANSION TUBES.

ACROSS THE ENTIRE CURB SECTION.

8. ALL DOWELS & TIE BARS SHALL BE EPOXY COATED.

GENERAL NOTES

COMPACTED

STABLE SUBGRADE

CONCRETE FILL (DEPTH

VARIES, 4" MINIMUM)

VARIES 3" to 6"

- PAVEMENT SURFACE

SMOOTH DOWEL

STRAIGHT CURB

(TYPE C-1)

4" -- 8" -- 8" -- 4" --

STRAIGHT BACK CURB &


(TYPE CG-1)


4" - 8" - 8" - 4" -

24"

STRAIGHT BACK DRY CURB &

(TYPE CG-1 DRY)

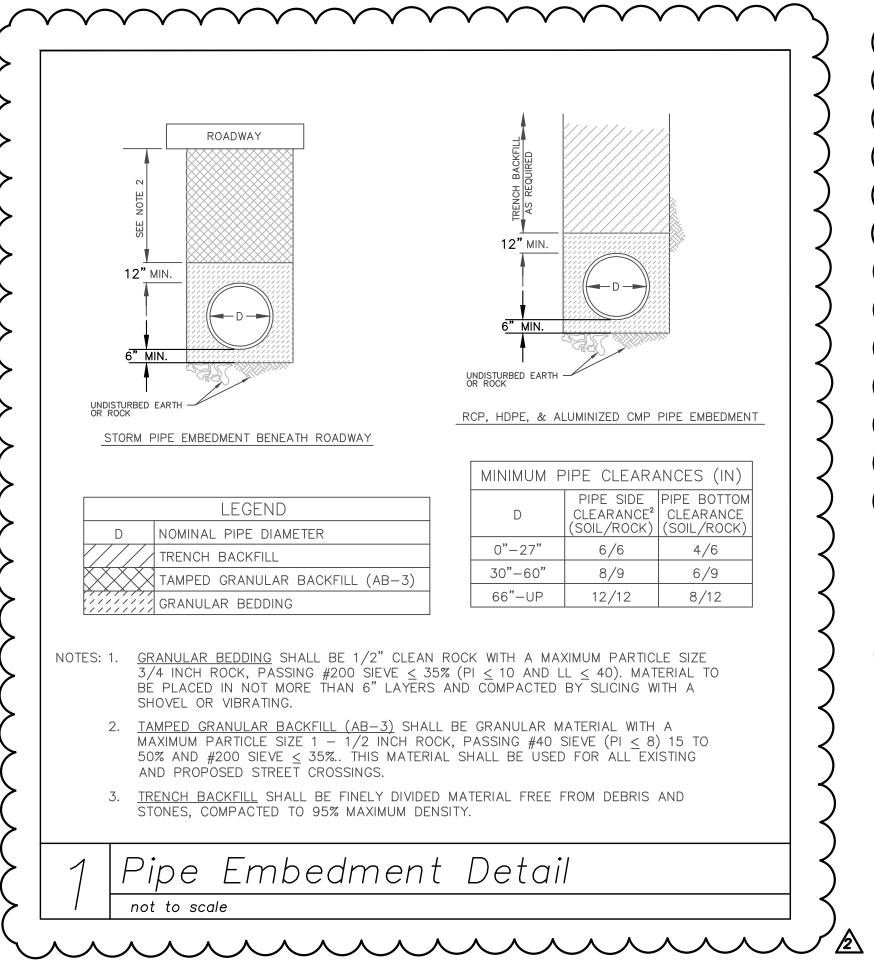

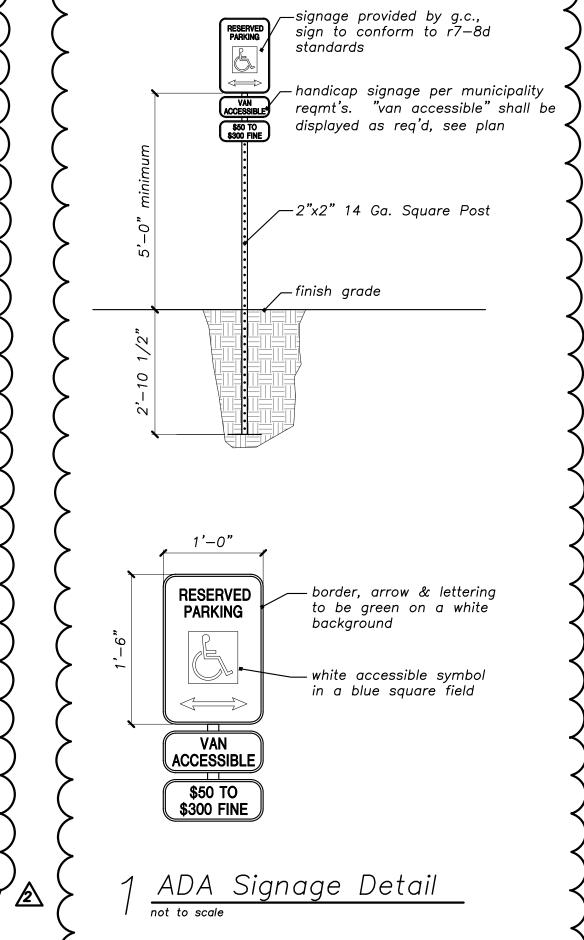




date 02.18.2022 drawn by JMP checked by revisions


05.09.2022 05.19.2022

sheet number

drawing type FDP & Permit project number

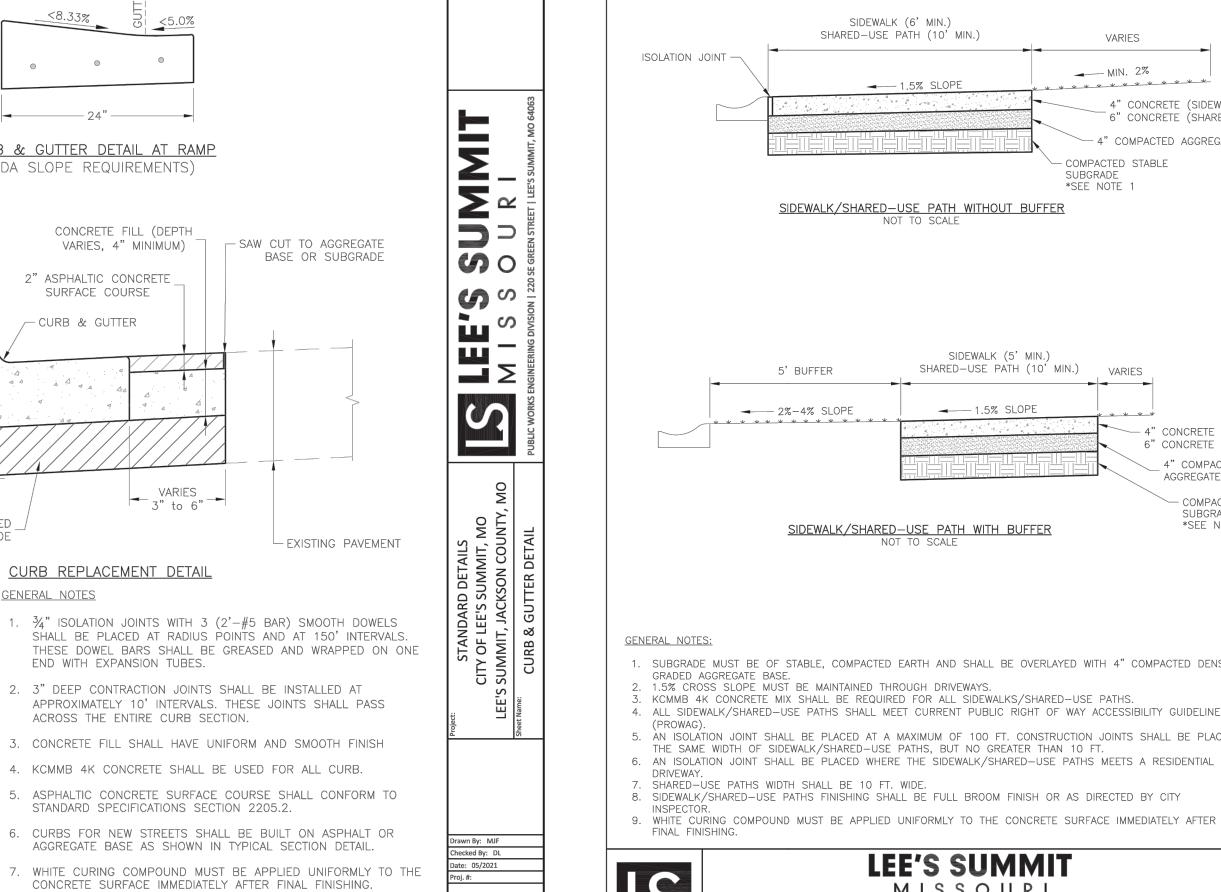

GEN-4

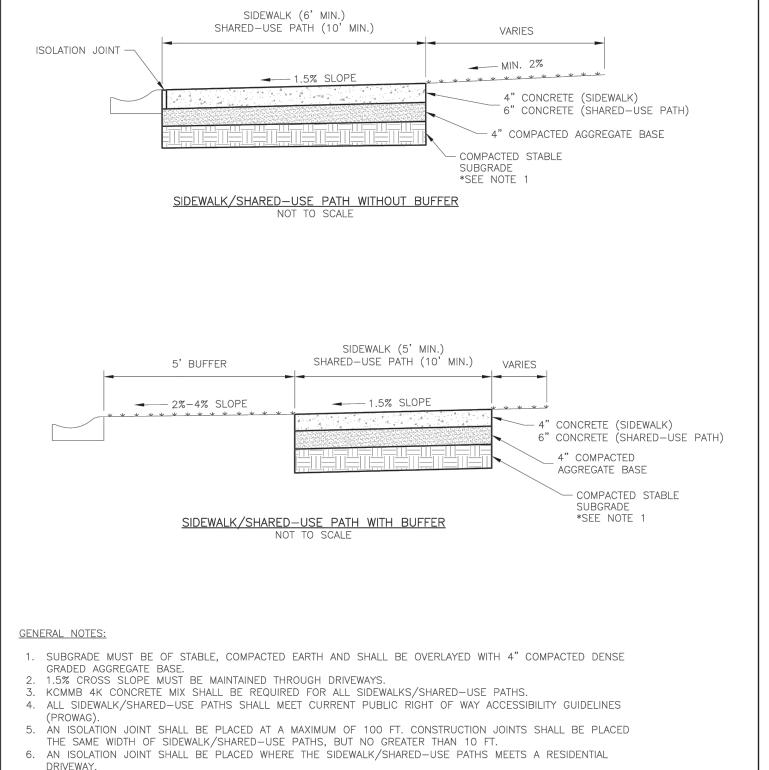

LEE'S SUMMIT

SIDEWALK/SHARED-USE PATH DETAIL

MISSOURI

Drawn By: MJF

Checked By: DL

GEN-2





Davidson Architecture

License # E-28140

threaded plug

fitting cleanout

pvc pipe

see section detail

10'-0" min.

end of service line

'Sanitary Clean—out

at right

date 02.18.2022 drawn by JMP checked by

cleanout cover & frame

`concrete support pad

∖expansion joint


material


neenah r-1976 or approved equal

revisions

sheet number

drawing type FDP & Permit project number

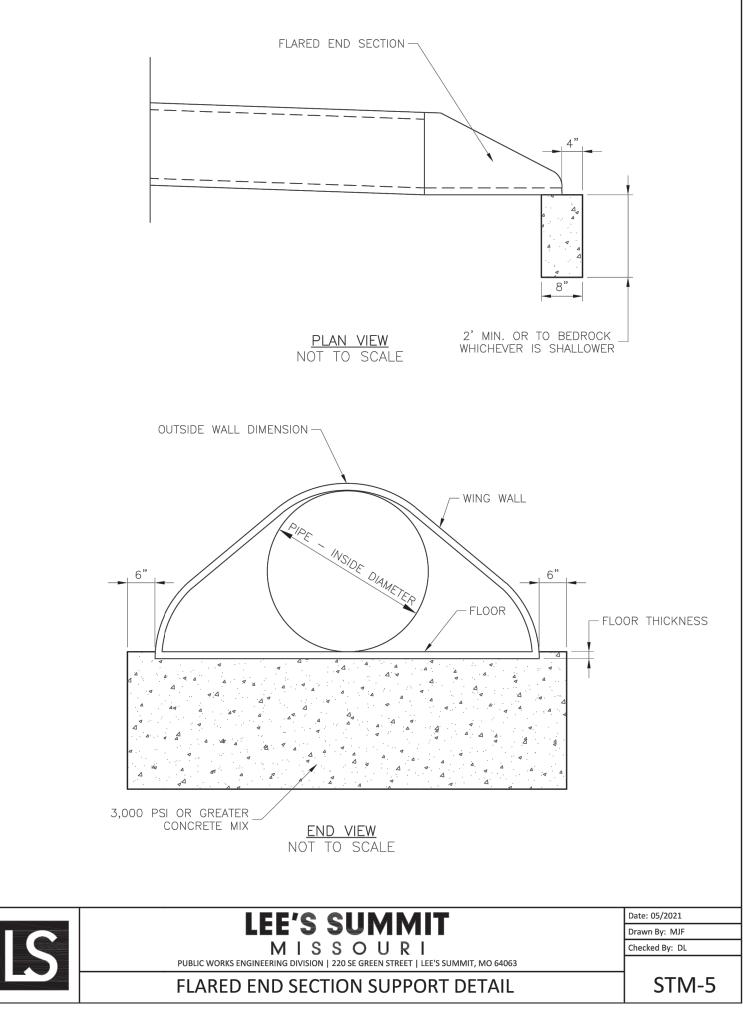

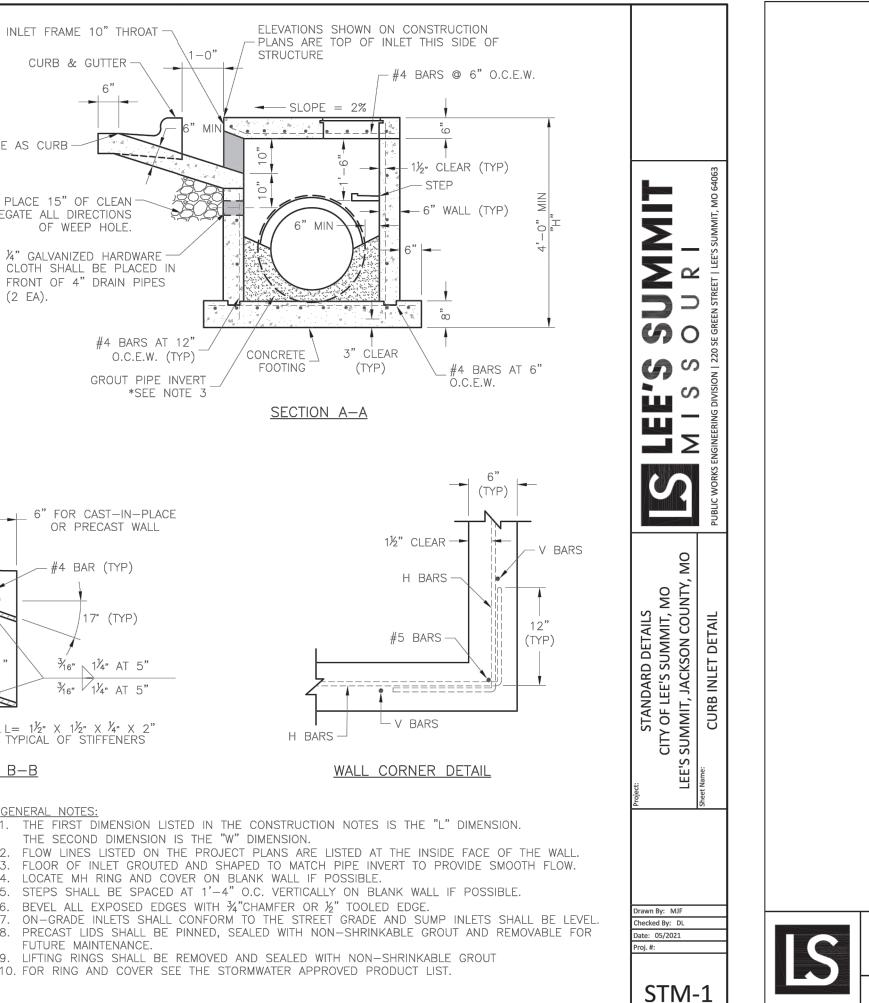

ELEVATIONS SHOWN ON CONSTRUCTION

STRUCTURE

→ SLOPE = 2% |

CONCRETE \ 3" CLEAR

SECTION A-A

H BARS ─

1. THE FIRST DIMENSION LISTED IN THE CONSTRUCTION NOTES IS THE "L" DIMENSION.

5. STEPS SHALL BE SPACED AT 1'-4" O.C. VERTICALLY ON BLANK WALL IF POSSIBLE.

(TYP)

1½" CLEAR —

H BARS-

#5 BARS —

└ V BARS

WALL CORNER DETAIL

• -=======

-PLANS ARE TOP OF INLET THIS SIDE OF

__#4 BARS @ 6" O.C.E.W.

1½" CLEAR (TYP)

_#4 BARS AT 6"

O.C.E.W.

— STEP

STEEL INLET FRAME 10" THROAT -

SLOPE SAME AS CURB -

OUTSIDE EDGE OF

CONCRETE FOOTING

<u>PLAN VIEW</u>

B ---

1. ALL WELDS SHALL BE PERFORMED IN ACCORDANCE WITH APPROPRIATE AWS SPECIFICATIONS AND

EXPANSION

5' TRANSITION

→ 4" ← VARIABLE L -

√½" STEEL
√

FRONT ELEVATION

AT 1'-0" CENTERS MAX

<u>PLAN VIEW</u>

CONCRETE CURB DOWELS (#4 BARS) SHALL BE CENTERED VERTICALLY AND HORIZONTALLY

CONCRETE TOP SLAB (#4 BARS)

DOWNSTREAM SIDE

¾"ø SMOOTH ROUND BAR –

STEEL FRAME NOTES:

PROCEDURES

LIFTING SLOT (TYP)

#4 BARS PLACED AT

45° ANGLE

- INSIDE WALL

LOCATING POINT

-STIFFENERS AT 3'-0" CTR. MAX

- (INSIDE FACE OF FRONT

10' TRANSITION UPSTREAM SIDE -

SIDES FOR SUMP INLET

-#4 BAR (TYP)

10' TRANSITION BOTH

WALL \mathbb{Q} OF BOX)

1" X 1" X 18" RECESSED

- STEEL INLET FRAME (10" THROAT)

← EXPANSION JOINT

CURB AND GUTTER

(3) 2'-#5 BARS

¾6" STEEL ─

└ 1'-¹¼_{6"}

SECTION B-B

1'-3¹⁄16"

CURB & GUTTER -

PLACE 15" OF CLEAN -

OF WEEP HOLE.

¼" GALVANIZED HARDWARE —

CLOTH SHALL BE PLACED IN

#4 BARS AT 12"

GROUT PIPE INVERT

O.C.E.W. (TYP)

*SEE NOTE 3

THE SECOND DIMENSION IS THE "W" DIMENSION.

4. LOCATE MH RING AND COVER ON BLANK WALL IF POSSIBLE.

6. BEVEL ALL EXPOSED EDGES WITH ¾"CHAMFER OR ½" TOOLED EDGE.

FRONT OF 4" DRAIN PIPES

6" FOR CAST-IN-PLACE


OR PRECAST WALL


-#4 BAR (TYP)


AGGREGATE ALL DIRECTIONS

(2 EA).


IC	LEE'S SUMMIT MISSOURI	Drawn By: MJF Checked By: DL
	PUBLIC WORKS ENGINEERING DIVISION 220 SE GREEN STREET LEE'S SUMMIT, MO 64063 FLARED END SECTION SUPPORT DETAIL	STM-5

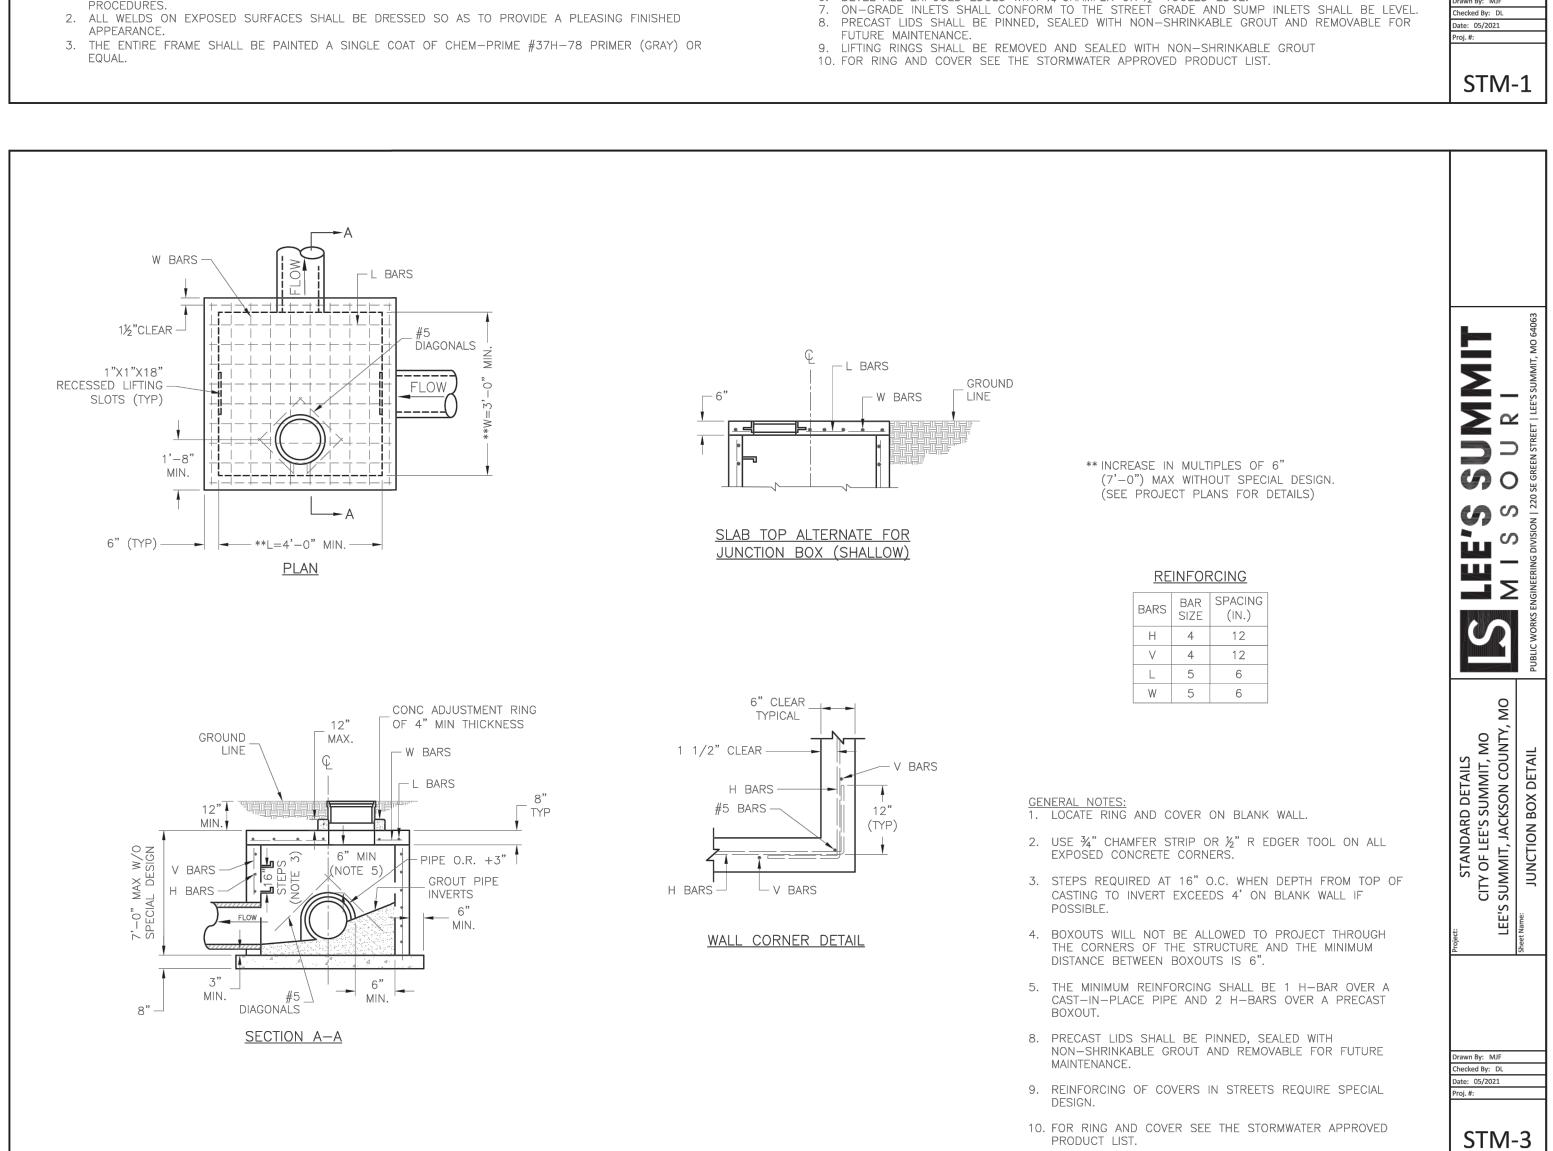


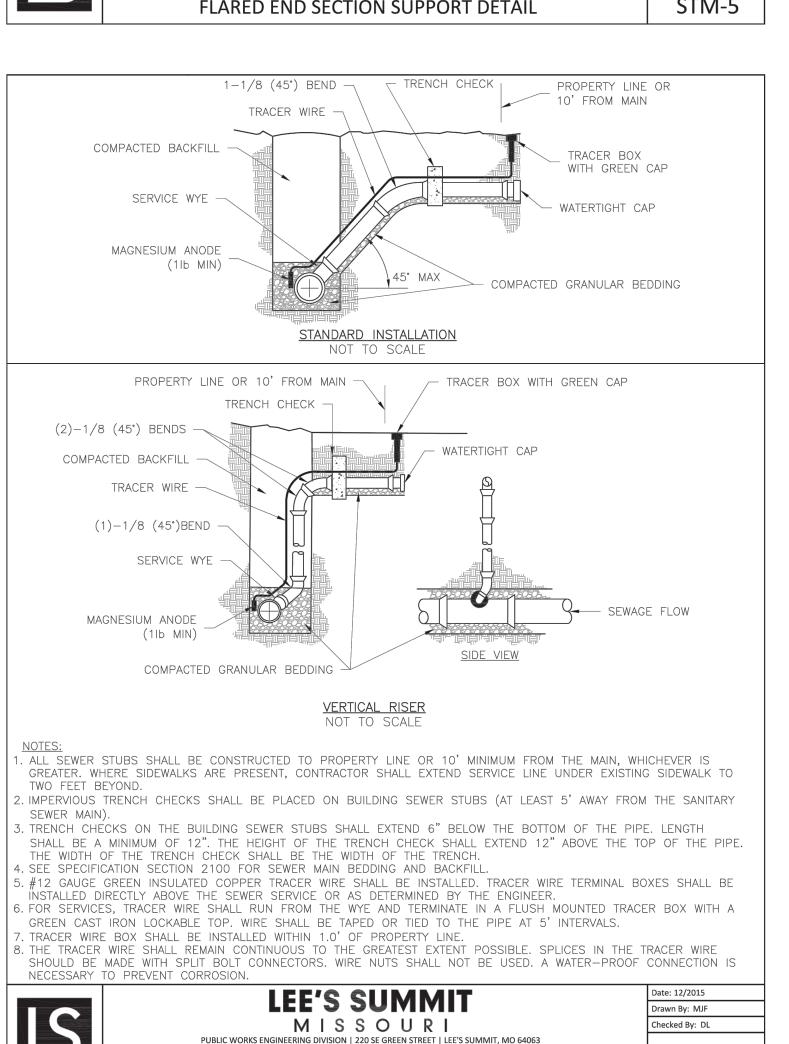



NECESSARY	10 PREVENT CORROSION.	
**********	LEE'S SUMMIT	Date: 12/2015
	LEE 3 30 MINIT	Drawn By: MJF
	MISSOURI	Checked By: DL
	PUBLIC WORKS ENGINEERING DIVISION 220 SE GREEN STREET LEE'S SUMMIT, MO 64063	
	SANITARY SEWER STUB DETAIL	SAN-1

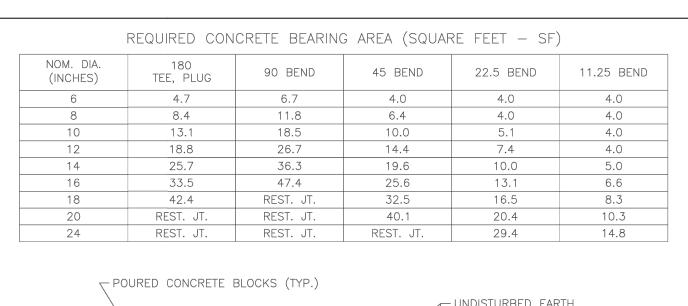

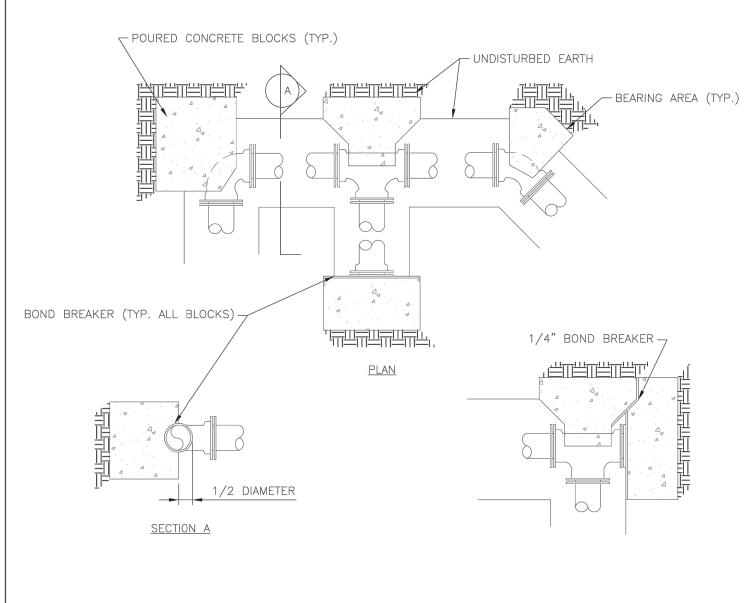



4. DO NOT (COVER JOINTS OR BOLTS (WHERE APPLICABLE) WITH CONCRETE.	
	LEE'S SUMMIT	Date: 01/2016
	LEE 3 30 IVIIVIII	Drawn By: JN
	MISSOURI	Checked By: DL
	DIDLIC WORKS ENGINEEDING DIVISION L 220 SE CREEN STREET LIEE'S CHAMIT MO 64062	

1. ALL BENDS WITHOUT RESTRAINED JOINTS SHALL HAVE CONCRETE THRUST BLOCKS INSTALLED FOR RESTRAINT.

2. MEGA LUGS MAY BE USED ONLY IN CONJUNCTION WITH CONCRETE THRUST BLOCKING.

3. BEARING AREA MUST BE AGAINST UNDISTURBED SOIL.

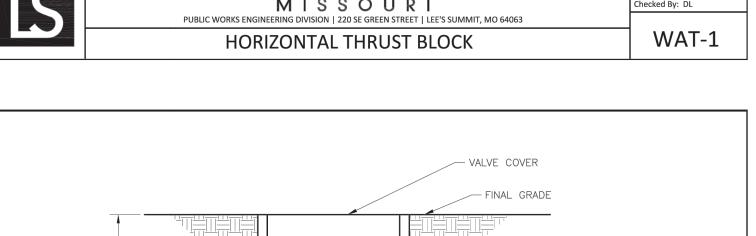

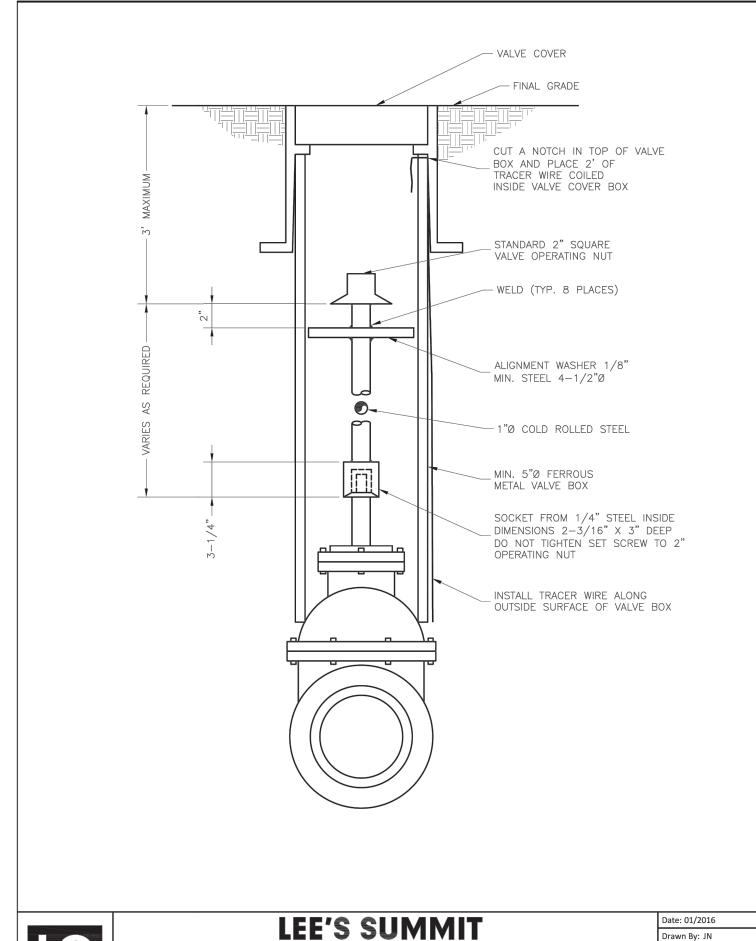


MISSOURI

VALVE STEM EXTENSION AND VALVE BOX


Drawn By: JN

hecked By: DL

WAT-9

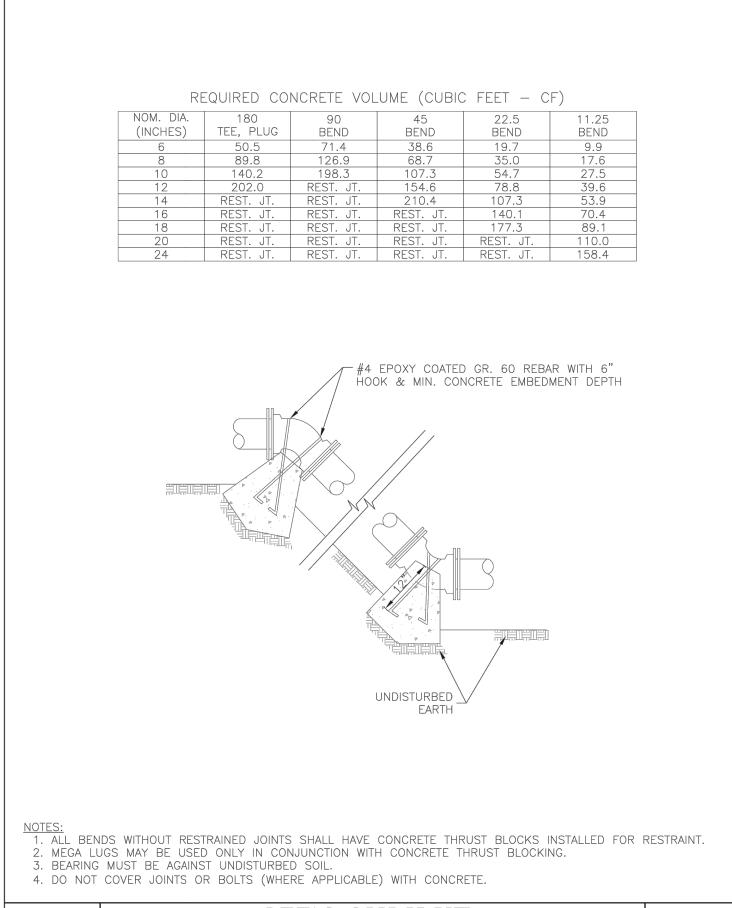

LEE'C CLIMANIT	Date: WAT-2
LEE'S SUMMIT	Drawn By: JN
MISSOURI	Checked By: DL
PUBLIC WORKS ENGINEERING DIVISION 220 SE GREEN STREET LEE'S SUMMIT, MO 64063	
VERTICAL THRUST BLOCK	WAT-2

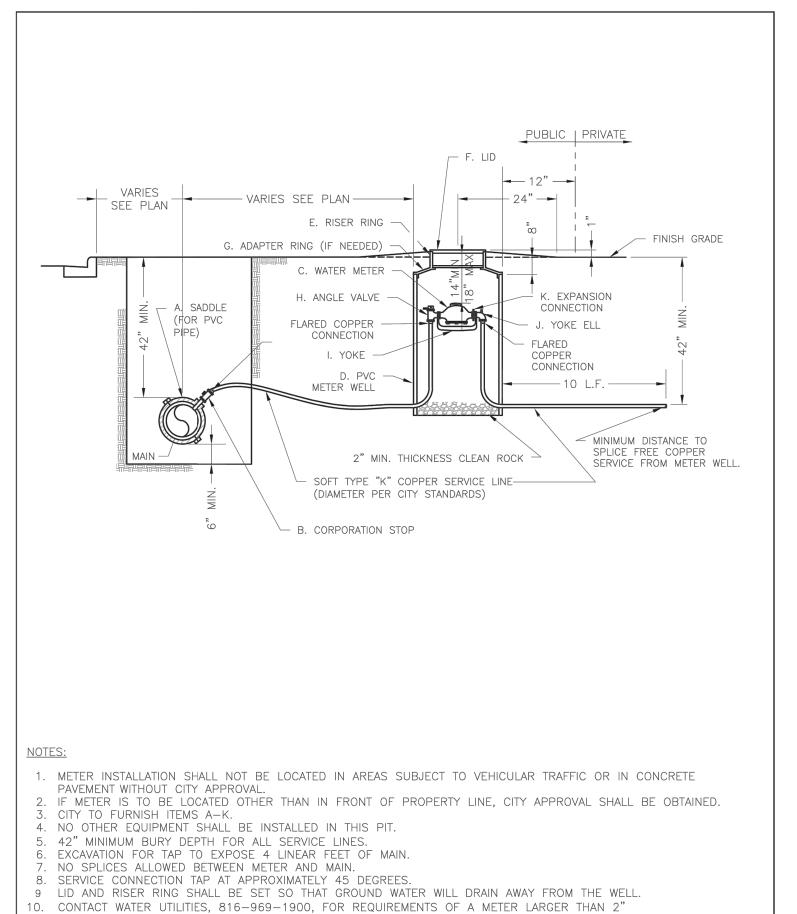

LEE'S SUMMIT

MISSOURI


SERVICE CONNECTION WITH METER WELL


Date: 06/2015

awn By: JN

ecked By: DL

WAT-11

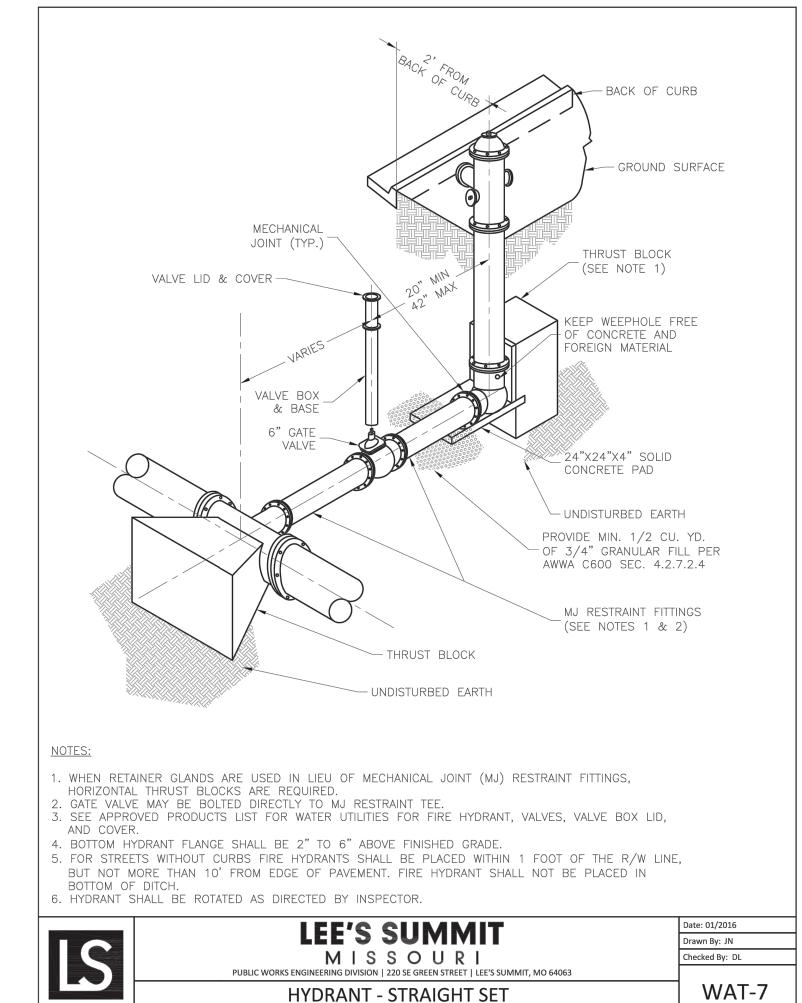


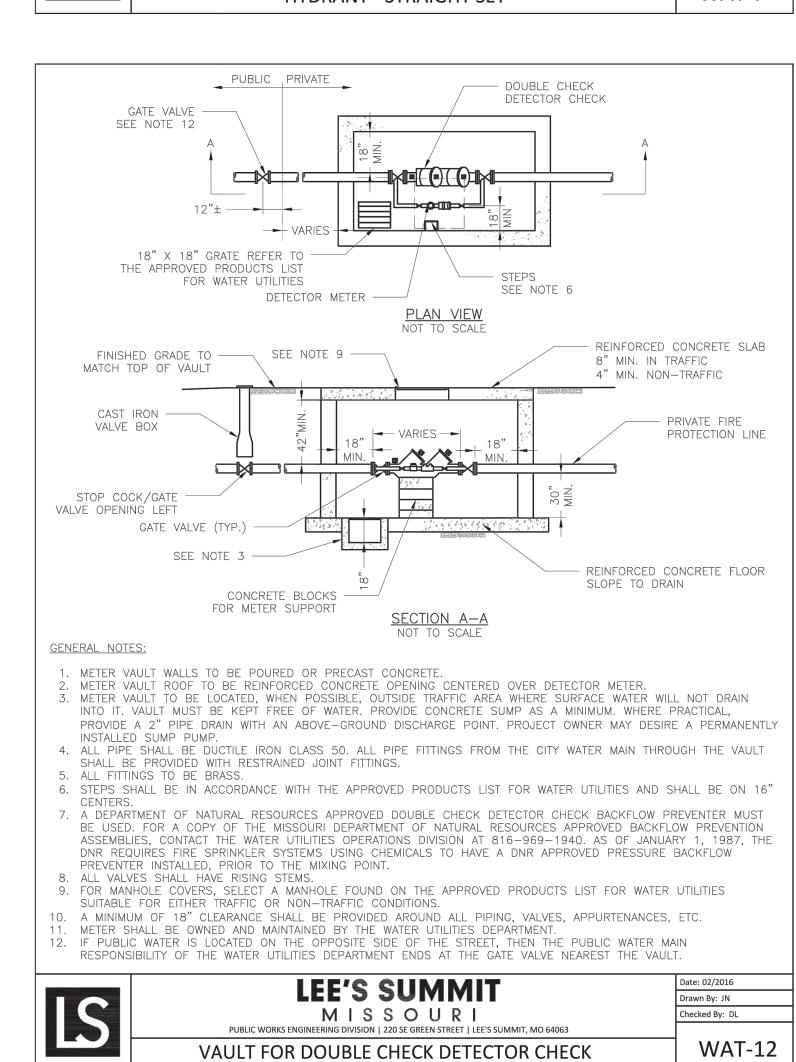



4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fex: 913.451.9391 www.davidsonae.com

> Davidson Architecture & Engineering, LLC



elo

date 02.18.2022 drawn by JMP checked by PAM revisions

sheet number

	Tree and Shrub Planting List											
		ITEM	QTY.	COMMON NAME	BOTANICAL NAME	SIZE & CONDIT.	max growth size					
SHADE TREES		OGM	7	OCTOBER GLORY MAPLE	ACER RUBRUM 'OCTOBER GLORY'	3" CAL.	height 40-50', spread 35'					
		RM 3 RED MAPLE			ACER RUBRUM 'RED SUNSET"	3" CAL.	height 40-50', spread 30-35'					
SHA	\bigcirc	SL	7	SKYLINE LOCUST	GLEDITSIA TRICANTHOS INERMIS 'SKYCOLE'	3" CAL.	height 35'-45', spread 25'-35'					
ES		ВС	3	BALD CYPRUS	TAXODIUM DISTICHUM VAR. DISTICHUM	8' tall min.	height 50-70', spread 20-45'					
EVGN TREES		RC	11	RED CEDAR	JUNIPERUS VIRGINIANA	8' tall min.	height 30'-65', spread 8'-25'					
EVC	**	SP	11	SHORTLEAF PINE	PINUS ECHINATA	8' tall min.	height 50'-60', spread 20'-35'					
S	\odot	FD	8	MAGNOLIA	MAGNOLIA 'BUTTERFLIES'	3" CAL.	height 15-20', spread 10'-15'					
L TREE	20 19/2 20 19/2	ER	6	EASTERN REDBUD	CERCIS CNADENSIS	3" CAL.	height 20-30', spread 25'-35'					
JENTA	0	BV	5	BLACKHAW VIBURNUM	VIBURNUM PRUNIFOLIUM	3" CAL.	height 12-15', spread 6'-12'					
ORNAMENTAL TREES	AN CANALA	FT 7 FRINGE		FRINGE TREE	CHIOANTHUS VIRGINIOUS	3" CAL.	height 12-20', spread 12'-20'					
		JM	7	JAPANESE MAPLE	ACER PALMATUM 'GERMAINES GYRATION'	3" CAL.	height 6-8', spread 8'-12'					
		TOTAL	75 1									
		ITEM	QTY.	COMMON NAME	BOTANICAL NAME	SIZE & CONDIT.	max growth size					
SHRUB	0	FS	22	FRAGRANT SUMAC	RHUS AROMATICA	3-5 GALLON	height 2-6', spread 6-10'					
DEC. §	0	WH	33	WILD HYDRANGEA	HYDRANGEA ARBORESCENS	3-5 GALLON	height 2-4', spread 3-5'					
SHRUB	0	IH	30	INKBERRY HOLLY	ILEX GLABRA 'COMPACTA'	5 GALLON	height 3-14', spread 4-6'					
EG. S	•	SB	103	DENSE YEW	TAXUS x MEDIA DENSIFORMIS	5 GALLON	height 3-4', spread 4-6'					
		TOTAL	188									
GROUND COVER			-	VARIETIES: NATIVE MIX OF	2 YO STOCK - 3-WAY BLEND OF IMPROVED KEN HOUNDOG, REBEL, OR FALCON LEAVE TALL FI ID PERENE DOMESTIC) 20% KENTUCKY BLUEGF	ESCUE (FESCUE A	ARUNDINADEA), AND RYE					
GRC			-	RIVER ROCK AS NEEDED C	ONLY - PROVIDE SAMPLE FOR APPROVAL - NO G	GRAVEL SHALL BE	USED AS A SUBSTITUTE					
*	*REFERENCE L1.2 FOR LANDSCAPING SPECIFICATIONS AND DETAILS											

- Landscaping shall be coordinated with the location of utilities, driveways and traffic clearance zones.
- The contractor doing excavation on public right-of-way shall give 48 hours advance notice to and obtain information from utility companies. 3. Prior to commencement of work, the contractor shall notify all those companies which have facilities in the near vicinity of the construction to
- 4. Existing underground, overhead, utilities and drainage structures have been plotted from available information and therefore, their locations must be considered approximate only. It is the responsibility of the individual contractors to notify the utility companies to locate their utilities
- before actual construction. 5. Contractor shall verify location of and protect all utilities and structures. Damage to utilities and structures shall be repaired by the contractor
- to the satisfaction of the owner at no additional expense. 6. Landscape contractor shall water plant material as required until fully established. This site is not intended to be irrigated unless otherwise dictated by the city of Lee's Summit.
- 7. Provide appropriate landscaping drainage from landscape areas directly adjacent to building to prevent ponding along north sides of building
- and along the foundation. 8. All landscape materials shall be installed in accordance with the current planting procedures established by the most recent addition of the
- American Standard for Nursery Stock.
- 9. Trees planted per this plan shall be installed during the spring (march 15 through june 15) or fall (september 15 through december 1). Written city approval will be required for planting during other times of the year.
- 10. Stake and guy all trees per planting details. 11. Install all shrubs and groundcover per planting details.
- 12. Elevation of top of mulch shall be 1/2" below any adjacent pavement/turf areas.
- 13. Root stimulator shall be applied to the soil backfill of each plant during installation. 14. Contractor shall verify all landscape material quantities and shall report any discrepancies immediately to the Landscape Architect.
- 15. Contractor shall guarantee all plant material for a period of one (1) year from date of initial acceptance. Contractor is responsible for
- maintaining plant material until acceptance is received. Maintenance shall include watering, maintaining plants in vertical position and shrub bed weed control. 16. All plant material shall meet or exceed minimum requirements defined by the "American Standard for Nursery Stock" ANSI Z60.1.
- 17. No plant material shall be substituted without written approval of the Landscape Architect per specifications.
- 18. Trees and seasonal color areas shall be mulched with three (3) inches minimum shredded hardwood mulch, color TBD. Planting beds as delineated shall be separated from pavement/turf areas with metal edging and mulched with three (3) inches minimum shredded hardwood mulch over weed barrier fabric, except where otherwise specified.
- 19. All existing plant material to be retained shall be wrapped with orange, or bright, colored plastic snow fence around base of trees and around all shrubs. Stake to hold in place during construction.
- 20. All shrubs used as parking buffer to be min. 18" tall at planting and maintained 3'-0" max. height. Install plants not to encroach upon cars
- parked, when at full growth.
- 21. All trees with above a 2" caliper shall be double staked, while smaller trees shall be single staked. 22. Ground mechanical and electrical equipment shall be wholly screened from street right-of-way and residential developments.
- 23. Maximum slope shall be not greater than 3:1.
- 24. All portions of site not covered by paving, mulch, plantings, etc. are to be sodded. Sod shall extend to all disturbed areas and shall include portions of right of way if necessary.
- 25. Landscaping areas (including along building perimeter and parking lot islands) equal to or narrower than 3'-0" should utilize river rock in lieu of sod or mulch.

Landscaping Requirements:

Street Frontage:

1 treee per 30 feet of street frontage within the landscaped setback

1 shrub per 20 feet of street frontage within the

Parking Lot Screening:

12 shrubs per 40 linear feet of parking

Open Yard Areas:

2 shrubs per 5,000 sq. ft. of total lot area excluding building footprints

1 tree per 5,000 sq. ft. of total lot area excluding building

General Buffers:

Front Lot: 20'

Side Lot: 20' or as approved by the governing body Rear Lot: 20' or as approved by the governing body

Adjacent Property Zoning/Uses:

Lee's Summit Tow Centre LLC: CP-2/Undeveloped with proposed future zoning PI as land develops Commercial BFRE LLC: CP-2/Car Detailing

E J Plesko & Associates Inc.: CP-2/Undeveloped with proposed future zoning PI as land develops


Buffer Requirements: PI/CP-2: Medium, 70% semi-opaque screening

> Shade Trees 1 per 1,000 sq. ft. Ornamental Trees 1 per 500 sq. ft. Evergreen Trees 1 per 300 sq. ft.

Shrubs 1 per 200 sq. ft. PI/PI: N/A

Pad Site A		Required	Provided
Parking Lot Screening: 207 ft. of	parking		
Shrubs	: 207/40x12 =	62	62
Street Frontage: 343 ft of frontag	e		
Trees (Ornamenta	als): 343/30 =	11	11
Sh	rubs: 343/20=	17	18
Open Yard Areas: 83,267-20,130) = 63,137 sq.	ft.	
Trees: 6	3,137/5000 =	13	28
	Shade =		9
	Evergreen =		6
	Ornamental =		13
Shrubs: 63	,137/5000x2=	25	42
Equipment Screening	as required	-	38
	to screen		
Buffers: PI/CP-2 Buffer			
East Lot Line = 269'x20'=5,380 s	sq. f.t		
Shade	5,380/1000=	5	6
Ornamental	5,380/500=	11	11
Evergreen	5,380/300=	18	19
Shrubs	5,380/200=	27	28
North Lot Line: PI/PI - N/A			
West Lot Line: PI/PI - N/A			
South Lot Line: Street Frontage	- See Above		
	Total Shade	5	26
Tota	al Ornamental	11	24
To	otal Evergreen	18	25
	Total Trees	58	75

Total Shrubs 131

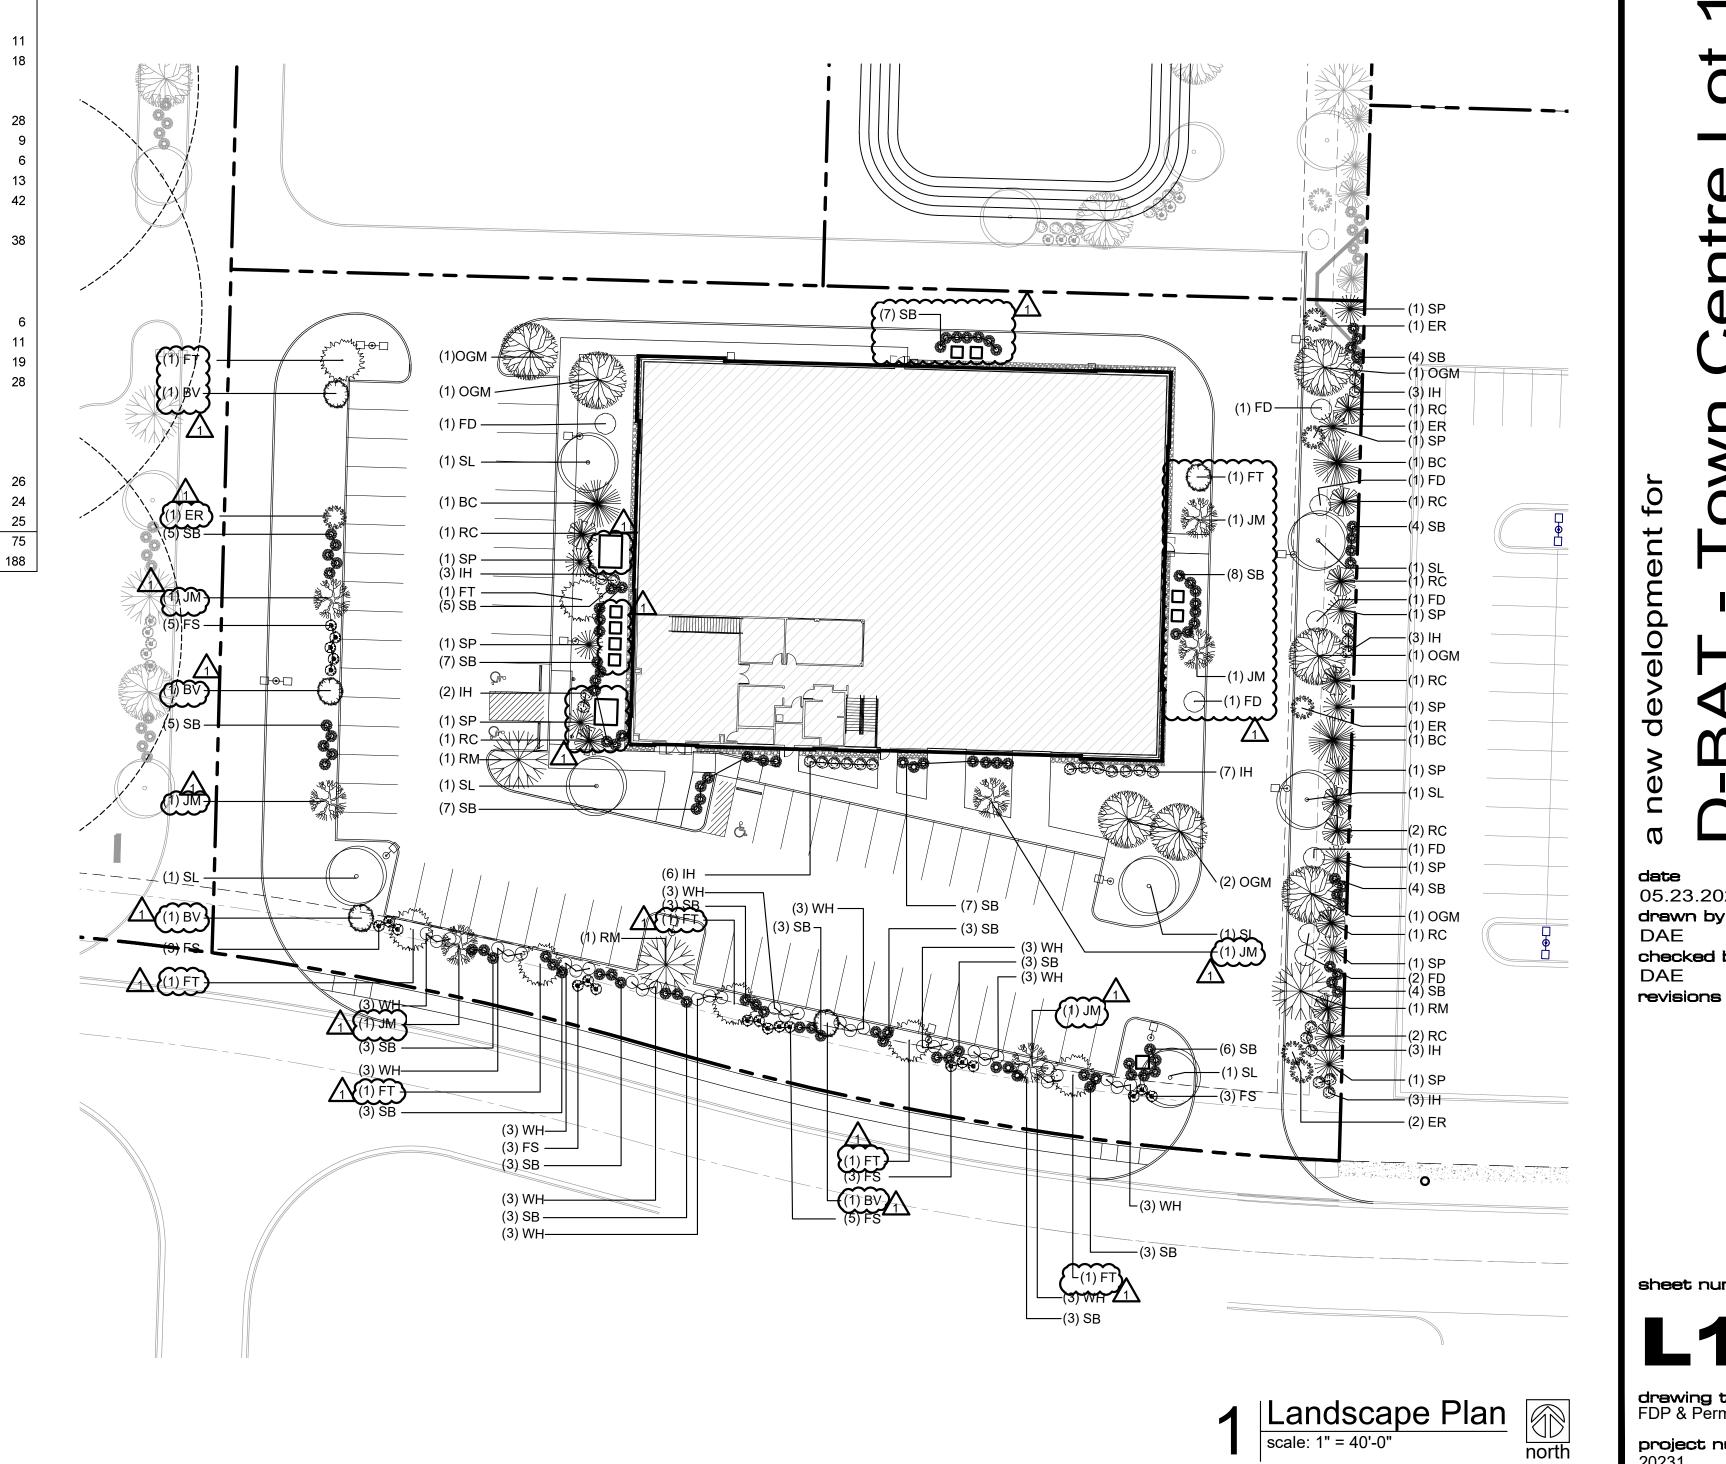



4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fex: 913.451.9391 www.davidsonae.com



date 05.23.2022 drawn by DAE checked by DAE

sheet number

general landscaping notes

A. Acceptable Plant Material:

- A.1. The following are the minimum plant sizes and conditions to be used in satisfying the requirements of this division. Acceptable plant materials for landscaping, buffers and tree replacement shall be as approved by the City of Lee's Summit:
- A.1.1. Medium shrubs, 18- to 24-inch balled and burlapped or two-gallon container. A.1.2. Large shrubs, 24- to 30-inch balled and burlapped or 5-gallon container.
- A.1.3. Ground cover, two and one-half-inch peat pot.
- A.1.4. Deciduous trees shall be a minimum of three-inch caliper, measured at a point 6 inches above the ground or top of the root ball, at
- A.1.5. Evergreen trees shall be a minimum height of eight feet at planting.
- A.2. The American Standard for Nursery Stock, published by the American Association for Nurserymen, shall be the standard reference for the determination of plant standards. B. Installation of Plant Materials:
- B.1. The City of Lee's Summit allows one planting season in a 12-month period in which the installation of plant materials shall be
- B.2. Buffers, if required, shall be installed before a certificate of occupancy permit is granted; except where the weather is not suitable for planting and escrow provisions are made in accordance with guidelines of the City of Lee's Summit.
- C. <u>Maintenance of Required Plants:</u> C.1. The owner, tenant and their agent, if any, shall be jointly responsible for the maintenance in good condition of the plant materials used
- to meet the minimum requirements of this Lee's Summit Development Ordinance for landscaping, buffer or tree replanting. The plant materials shall be kept free from refuse and debris.
- C.2. Plants that are not in sound growing condition or are dead shall be removed and replaced with a plant of a species or variety as determined by the City of Lee's Summit.

C.3. Other landscape materials shall be maintained in proper repair and shall be kept clear of refuse and debris.

D. <u>Landscaping Minimum Requirements:</u>

- D.1. Street frontage. D.1.1. A minimum 20-foot-wide landscape strip shall be provided along the full length of street frontage.
- D.1.2. Shrubs may be clustered or arranged within the setback.
- D.2. Open yard areas. D.2.1. All portions of the site not covered with paving or buildings shall be landscaped. Open areas not covered with other materials shall be covered with sod. Ground cover shall be utilized on all slopes in excess of 3:1 slope.

E. Landscaping Along Street Frontages:

- E.1. Frontage landscape strips shall contain no structures, parking areas, patios, storm water detention facilities unless included in the landscape plan as an amenity or any other accessory uses except for the following:
- E.1.1. Retaining walls or earthen berms constructed as part of an overall landscape design;
- E.1.2. Pedestrian-oriented facilities such as sidewalks and bus stops;
- E.1.3. Underground utilities; E.1.4. Driveways required for access to the property; or
- E.1.5. Signs otherwise permitted by the development ordinance.
- E.2. All portions of a frontage landscape strip shall be planted in trees, shrubs, grass or ground cover, except for those ground areas that are
- mulched or covered by permitted structures. E.3. Plant materials in the frontage landscape strip are not to extend into the street right-of-way.

Parking Lot Landscaping and Trees:

- F.1. Deciduous shade trees shall be provided in parking lots as indicated below.
- F.1.1. Landscape islands, strips as a minimum, shall be no less than nine feet wide for at least one-half the length of the adjacent parking space. The island shall be planted in trees, shrubs, grass, or ground cover, except for those areas that are mulched.
- F.1.2. Tree planting areas shall be no less than ten feet in width. No tree shall be located less than four feet from the back of curb. All parking lot landscape islands, strips or other planting areas shall be curbed with minimum six-inch high curbs of the type required by this chapter or other regulations for parking areas.

G. Parking Lot Screening:


- G.1. Screening to a height of two and one-half feet must be provided along the edge of the parking lot or loading area closest to and parallel to the street. A driveway to the parking lot or loading area may interrupt the screening.
- G.2. Screening shall be decorative and 100 percent opaque to a height of two and one-half feet above the elevation of the parking/loading area or the street, whichever is highest.
- G.3. Screening may be provided in the following way:
- G.3.1. A hedge consisting of at least 12 shrubs per 40 linear feet that will spread into a continuous visual screen within two growing seasons. Shrubs must be at least 18 inches tall at the time of planting and be of a species that will normally grow to at least two and one-half feet in height at maturity and be suitable for the parking lot application.
- G.4. The street-side screening treatment may be located within the required landscape buffer along the front yard of the property.

G.5. Berming and/or screening shall not encroach into the required sight triangle of streets or access drives.


- H.1. Buffer areas shall contain no driveways, parking areas, patios, storm water detention facilities, or any other structures or accessory uses except for a fence, wall, or earthen berm constructed to provide the visual screening required to meet the standards of this chapter. Underground utilities may be permitted to cross a buffer if the screening requirement can achieved. Required vehicular access through a buffer may be allowed as a condition of preliminary development plan approval.
- H.2. Natural buffers shall contain evergreen shrubs and trees suitable to local growing conditions that will provide an opaque visual screen
- during all seasons of the year. H.3. Planted materials (trees and shrubs) shall meet the expected opacity within two growing seasons.
- H.4. Every buffer required by the city shall be maintained by the owner of the property where the buffer is located, in order to provide the visual screen at the opacity identified, on a year-round basis.
- H.5.0.1. The Director may waive a buffer requirement or reduce its extent to a temporarily appropriate level of screening if the Comprehensive Plan anticipates future development on the adjoining property in a land use category such that a buffer would not be required by this chapter once the adjoining property is rezoned or developed. H.6. Medium impact screening - A 70 percent semi-opaque screen between land uses which are dissimilar in character. Semi-opaque
- screening should partially block views from adjoining land uses and create a separation between the adjoining land uses.

Additional Specifications:


- I.1. Landscaping shall be coordinated with the location of utilities, driveways and traffic clearance zones. I.2. The contractor doing excavation on public right-of-way shall give 48 hours advance notice to and obtain information from utility
- 1.3. Prior to commencement of work, the contractor shall notify all those companies which have facilities in the near vicinity of the construction to be performed.
- I.4. Existing underground, overhead, utilities and drainage structures have been plotted from available information and therefore, their locations must be considered approximate only. It is the responsibility of the individual contractors to notify the utility companies to
- locate their utilities before actual construction.
- 1.5. Contractor shall verify location of and protect all utilities and structures. Damage to utilities and structures shall be repaired by the contractor to the satisfaction of the owner at no additional expense.
- I.6. Owner shall be responsible for contracting or providing landscape maintenance for watering until plants are well established and can thrive on their own.
- I.7. If property owners elect to provide an irrigation system, irrigation system shall include an automatic rain sensor and be fully concealed below ground.
- I.8. Provide appropriate landscaping drainage from landscape areas directly adjacent to building to prevent ponding along north sides of building and along the foundation.
- I.9. All landscape materials shall be installed in accordance with the current planting procedures established by the most recent addition of the American Standard for Nursery Stock.
- 1.10. Trees planted per this plan shall be installed during the spring (march 15 through june 15) or fall (september 15 through december 1). Written city approval will be required for planting during other times of the year.
- I.11. Stake and guy all trees per planting details.
- I.12. Install all shrubs and groundcover per planting details. I.13. Elevation of top of mulch or rock shall be 1/2" below any adjacent pavement/turf areas.
- I.14. Root stimulator shall be applied to the soil backfill of each plant during installation.
- I.15. Contractor shall verify all landscape material quantities and shall report any discrepancies immediately to the Landscape Architect.
- I.16. Contractor shall stake plant locations in the field and have approval by the Landscape Architect before proceeding with installation. I.17. Contractor shall guarantee all plant material for a period of one (1) year from date of initial acceptance. Contractor is responsible for
- maintaining plant material until acceptance is received. Maintenance shall include watering, maintaining plants in vertical position and shrub bed weed control.
- I.18. All plant material shall meet or exceed minimum requirements defined by the "American Standard for Nursery Stock" ANSI Z60.1.
- I.19. No plant material shall be substituted without written approval of the Landscape Architect per specifications. 1.20. Trees and seasonal color areas shall be mulched with three (3) inches minimum shredded hardwood mulch, color TBD. Planting beds as delineated shall be separated from pavement/turf areas with metal edging and mulched with three (3) inches minimum shredded
- hardwood mulch over weed barrier fabric, except where otherwise specified. I.21. All existing plant material to be retained shall be wrapped with orange, or bright, colored plastic snow fence around base of trees and
- around all shrubs. Stake to hold in place during construction. I.22. All shrubs used as parking buffer to be min. 18" tall at planting and maintained 3'-0" max. height. Install plants not to encroach upon
- cars parked, when at full growth. I.23. All trees with a 2" caliper or greater shall be double staked, while smaller trees shall be single staked.
- I.24. Ground mechanical and electrical equipment shall be wholly screened from street right-of-way and residential developments.
- I.25. Maximum slope shall be not greater than 3:1. I.26. All portions of site not covered by paving, mulch, plantings, etc. are to be sodded. Sod shall extend to all disturbed areas and shall include portions of right of way if necessary.
- I.27. Landscaping areas (including along building perimeter and parking lot islands) equal to or narrower than 3'-0" should utilize river rock in lieu of sod or mulch.

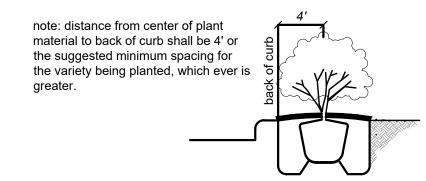


3 | back of curb detail | scale: 1" = 50'-0"

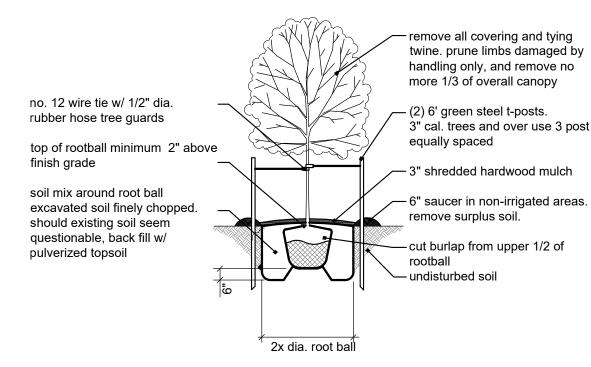


6 deciduous tree planting detal

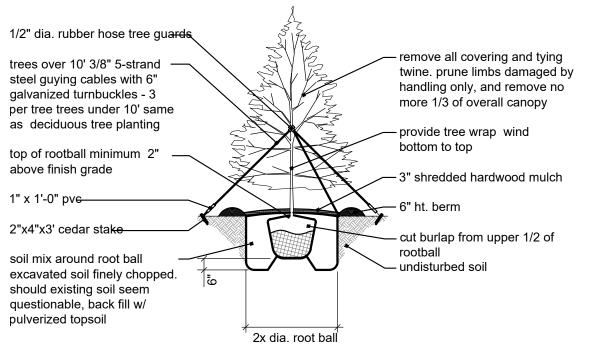

5 evergreen tree planting detail scale: 1" = 50'-0"

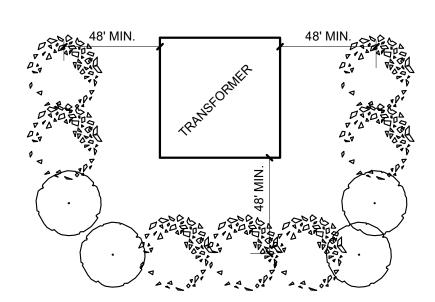

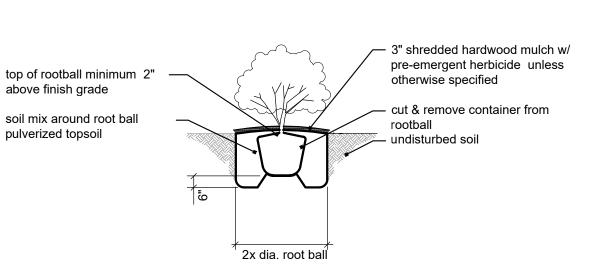

4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fax: 913.451.9391 www.davidsonae.com

davids

architecture & engineering

-LINE OF SIDEWALK



05.19.2022 drawn by DAE

checked by

revisions

DAE

sheet number

drawing type

FDP & Permit project number

project synopsis

Municipality: Lee's Summit, Missouri 2018 International Building Code (IBC) Applicable Building Codes &

2018 International Plumbing Code (IPC) 2018 International Mechanical Code (IMC) 2018 International Fuel Gas Code (IFGC) 2018 International Fire Code (IFC) 2017 National Electrical Code (NEC)

ICC/ANSI A117.1-2009, Accessible and Usable Buildings and

Lee's Summit Unified Development Ordinance (UDO)

Project Address: 540 NE Town Centre Drive Lee's Summit, Missouri 64064

WHD Management LLC

PI - Planned Industrial

Property Owner: PO Box 1059 Lee's Summit, MO 64063

Limited Indoor Recreation Proposed Land Use:

20 ft

Building Setbacks:

Landscaping Setbacks:

Zoning:

Ordinances:

Side Yard 10 ft Rear Yard 20 ft

Street Frontage 20 ft

Height Requirements: Number of Dwelling Units:

Special Conditions Met: A commercial indoor and/or outdoor recreation facility or area shall be allowed provided the front entrance is 300 feet or greater distance from any residential district or use.

Adjacent Zoning (within 185'): CP-2, RP-4

Adjacent Land Use (within 185'): Commercial, Undeveloped, Residential, Government

Building Occupancy: Pad Site A: A-3, Limited Indoor Recreation - Batting Cages Site Area Pad Site A 83,267 sq. ft. 1.91 ac. 20,130 sq. ft.

Floor Area Ratio - Maximim 1.0

Standard Parking Space Size: 9'-0"x19'-0"

Pad Site A 20,130 Pervious/Impervious Areas

58,611 sq. ft. Pad Site A 24,656 sq. ft. 30% Parking

Pad Site A: Indoor Batting -Required: 4 per 1,000 sq. ft. of office space batting cages: determined by director

*Parking Space Length can reduce by 2'-0" at curbed landscaping and 6' deep sidewalks.

—online pick-up sign copy text by -ADA parking signage provided by g.c., arrow & sign to conform to r7-8d standards to be green **PARKING** on a white handicap signage per background municipality regmt's. "van accessible" shall be displayed as req'd, see plan white accessible hi-density polystyrene thermoplastic, \Leftrightarrow symbol silver finish, $\frac{1}{8}$ " nominal wall thickness in a blue w/ ultra-violet anti-static addittives and * square field plastic top cap ACCESSIBLE · 6" Ø stl. pipe fill full w/ pea gravel concrete - install bollard cover with cap \$50 TO dome-top lo-density polyethylene \$300 FINE thermoplastic $\frac{1}{4}$ " nominal wall thickness black finish with reflective tape (***blue for ADA parking spaces) —18"Ø conc. pier * note: h.c. sign mounting height and installation per municipality reqmt's.

general notes

• All construction shall conform to the standards and specifications of Lee's Summit,

The general contractor shall contact all utility companies prior to the start of

construction and verify the location and depth of any utilities that may be encountered during construction.

• The contractor shall field verify exist, surface & subsurface ground conditions prior to start of construction. Slopes shall maintain a maximum 3:1 slope.

• The contractor shall be responsible for obtaining all required permits, paying all fees, and otherwise complying with all applicable regulations governing the project. Place silt fence per civil for erosion control.

 Provide a temporary gravel access drive to prevent mud from being deposited onto the adjacent road. • Prior to installing any structure on a public storm sewer, the contractor shall submit

shop drawings for the structure(s). Installation shall not occur until drawings have been approved by public works. Prior to installing, constructing, or performing any work on the public storm sewer line

(including connecting private drainage to the storm system) contact the city for inspection of the work. Contact must be made at least 48 hours prior to the start of

• Connections to the public storm sewer between structures will not be permitted. All exterior utility services shall be painted to match the primary building color.

 Signage shall comply with Lee's Summit Signage Ordinance. The property owner's association shall have ownership and maintenance

responsibilities for the common area tract. Reference electrical plans for ground mounted equipment.

plan notes

1. Furnish and install 5'-0" wide concrete sidewalk with broom finish per city of Lee's Summit standards to connect to existing sidewalk.

2. Furnish and install 5'-0" wide concrete sidewalk with broom finish per city of Lee's Summit standards. Sidewalk shall be in the r.o.w. offset by 1'-0" from the property

3. Furnish and install new curb cut per city of Lee's Summit standards. Align with access across the street.

4. Furnish and install new curb cut per city of Lee's Summit standards. 5. Furnish and install 4" wide white parking space striping.

6. Furnish and install 6'-0" wide concrete sidewalk with broom finish per city of Lee's Summit standards.

7. Furnish and install handicap parking spaces with striped access aisle per UDO requirements.

8. Furnish and install handicap parking space bollard sign per UDO requirements. 9. Furnish and install door stoop with turn down edge doweled into building foundations; coordinate with civil drawings.

10. Furnish and install strip of clean rock at perimeter of building for drainage and maintenance if required by the geotechnical report.

11. Location of block retaining wall; reference civil drawings.

12. Furnish and install UDO compliant building mounted area light. 13. Furnish and install UDO compliant pole mounted area light; maximum top of pole

14. Furnish and install ground mounted monument sign to meet ordinance requirements.

Provide electrical to sign as required. 15. Furnish and install wall mounted sign to meet ordinance requirements. Provide

electrical as required.

Property line. 17. Building setback line.

18. Furnish and install concrete pad for ground mounted RTU; provide landscape screening as required around the equipment.

19. Furnish and install equipment pad.



4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fex: 913.451.9391 www.davidsonae.com



date


13

28'-0" 18'-3"

05.23.2022 drawn by DAE checked by DAE revisions

Тор

sheet number

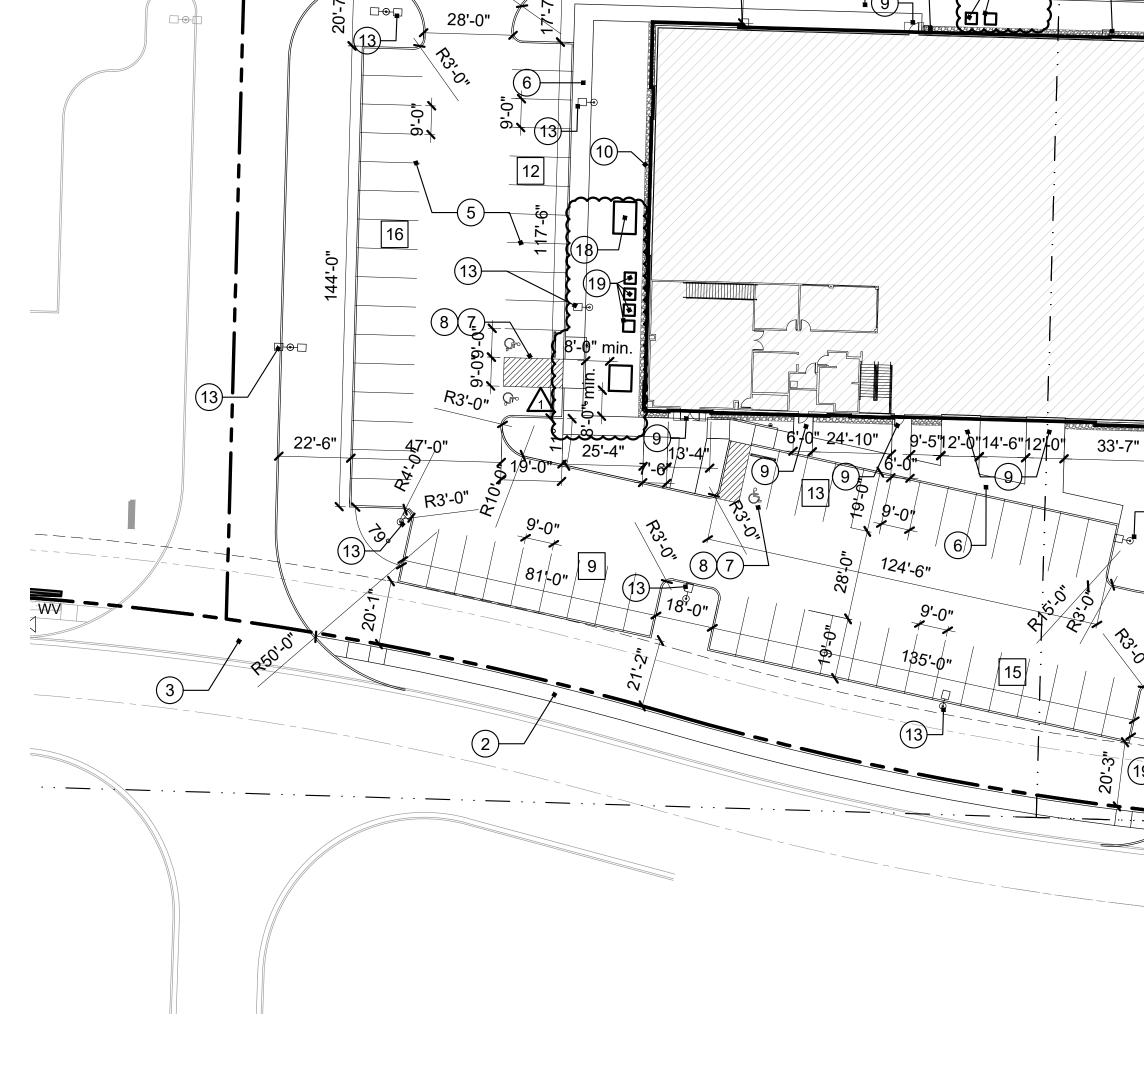





 Double keyed locks are not permitted on any required or marked exit. Exit/emergency lighting are subject to an on site inspection.

Provide min. 3 1/2" batt insulation between conditioned & unconditioned spaces

 Exit doors shall be openable from the inside without the use of a key or any special knowledge or effort Provide electrical outlets @ 15" a.f.f. to the lowest outlet per a.d.a.

 Egress illumination will be provided at an intensity of not less than 1 foot candle at floor level. Construction materials exposed within plenums shall be noncombustible or

shall have flame spread rating of not more than 25 and a smoke development rating of not more than 50. • All electrical outlets within 6' of any sink or water source to be GFCI protected.

Mezzanine floor height is 12'-0" above first floor.

 Paint liner panels in batting cage areas PT-4 (green) up to 12'-0" a.f.f. Reference DBAT standards for painting patterns.

construction notes

1. Not used. 2 2. Merchandise display by others.

3. Verify point of sale location with owner. Coordinate stub up if required.

4. Furnish and install built-in bar height counter. 5. Furnish and install seemless interior windows.

6. Furnish and install Recessed knox box in stone. Verify final location with fire marshal.

7. Cage by others.

8. Provide access to overhead doors.

9. Benches by others. 10. Furniture by others.

11. Provide data and power at wall mounted TV location. Netting by others.

13. Premanufactured awning above by PEMB manufacturer.

14. Decorative wall sconce. 15. Reference site and landscaping plans for perimeter rock.

16. Furnish and install millwork per details.

17. Furnish and install bracket mounted fire extinguisher, min. 5lb ABC. 18. Furnish and install semi-recessed ADA fire extinguisher cabinet (white) with min.

5lb ABC fire extinguisher. 19. Furnish and install metal guardrail at mezzanine viewing area; verify attachment to structure with structural engineer: railing must have supports/attachments a maximum of 5'-0" apart, and railing must meet loading requirements per the 2018 IBC. Railing selection must be a minimum of 42" above finish floor of the mezzanine - open space between railing parts must not allow a sphere of 4" or greater to pass through.


20. Furnish and install door stoops; reference structural.


21. Furnish and install prefabricated concrete pads for condensing units per mechanical drawings.

22. Provide concrete pad for ground mounted RTU as required, consult with structural.

23. Furnish and install ADA bathroom partitions. 24. Furnish and install lintel above door to support stone.

symbol legend:





partition legend

Insulated Interior Partition: 3-5/8" metal studs @ 16" o.c. to 6" above ceiling or to underside of decking with 5/8" gypsum board on both sides and 3-1/2" sound attenuation batt insulation. Stud gauge per supplier.

Interior Partition: 3-5/8" metal studs @ 16" o.c. to 6" above ceiling or to underside of decking with 5/8" gypsum board on both sides. Stud gauge per supplier.

*Utilize DensArmour Plus on plumbing walls

partition notes

utilize 6" or 8" studs for plumbing walls

walls with no ceiling shall extend up to underside of decking unless

otherwise noted (reference reflected ceiling plan).

• walls with a lowered suspended ceiling should extend 6" above the ceiling

height (reference reflected ceiling plan). interior wall height note: Utilize 3 ⁵/₈" metal studs @ 16" o.c. to an unbraced height of 13'-8, at heights up to 26'-0", utilize 6" 20 ga. studs @ 16" o.c. - adjust stud size as required for allowable L/240 deflection. Verify stud gauge

 expansion joint note: Expansion joints shall be installed at a max. of 30'-0". Joints shall also be located to anticipate building movement, structural elements and substrate transition per elevations and wall sections. wet wall note: Utilize DensArmor Plus in all plumbing wet walls, walls

receiving ceramic tile, and all walls adjacent to plumbing walls or where

anticipated to be in contact with moisture. substrate: provide tile backerboard at any wall tile locations.

• blocking: Provide in wall blocking for all wall mounted items, including, but not limited to toilet accessories, plumbing fixtures, and hardware.

maximum length of an unbraced wall shall be 8'-0".

4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fax: 913.451.9391 www.davidsonae.com



developm

DAE

date 05.19.2022 drawn by

checked by DAE revisions

10.13.2022

sheet number




reflected ceiling notes

- Paint exposed structure off-white in areas open to the public. Furnish and install 2x4 suspended ceiling with lighting per reflected ceiling plan.
- Exposed structure finish to remain as-is.
 Reference room finish schedule for ceiling heights
 all materials above suspended ceilings must be fire retardant

reflected ceiling legend

2x4 lay-in LED light fixture with direct/indirect lens for finished

2x4 LED utility light fixture for unfinished areas



CLG - 1: 2' x 4' x 3/4", with 15/16" Exposed Tee Grid System, color white


4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fax: 913.451.9391 www.davidsonae.com



date 05.19.2022 **drawn by** DAE checked by DAE

revisions 10.13.2022


drawing type FDP & Permit

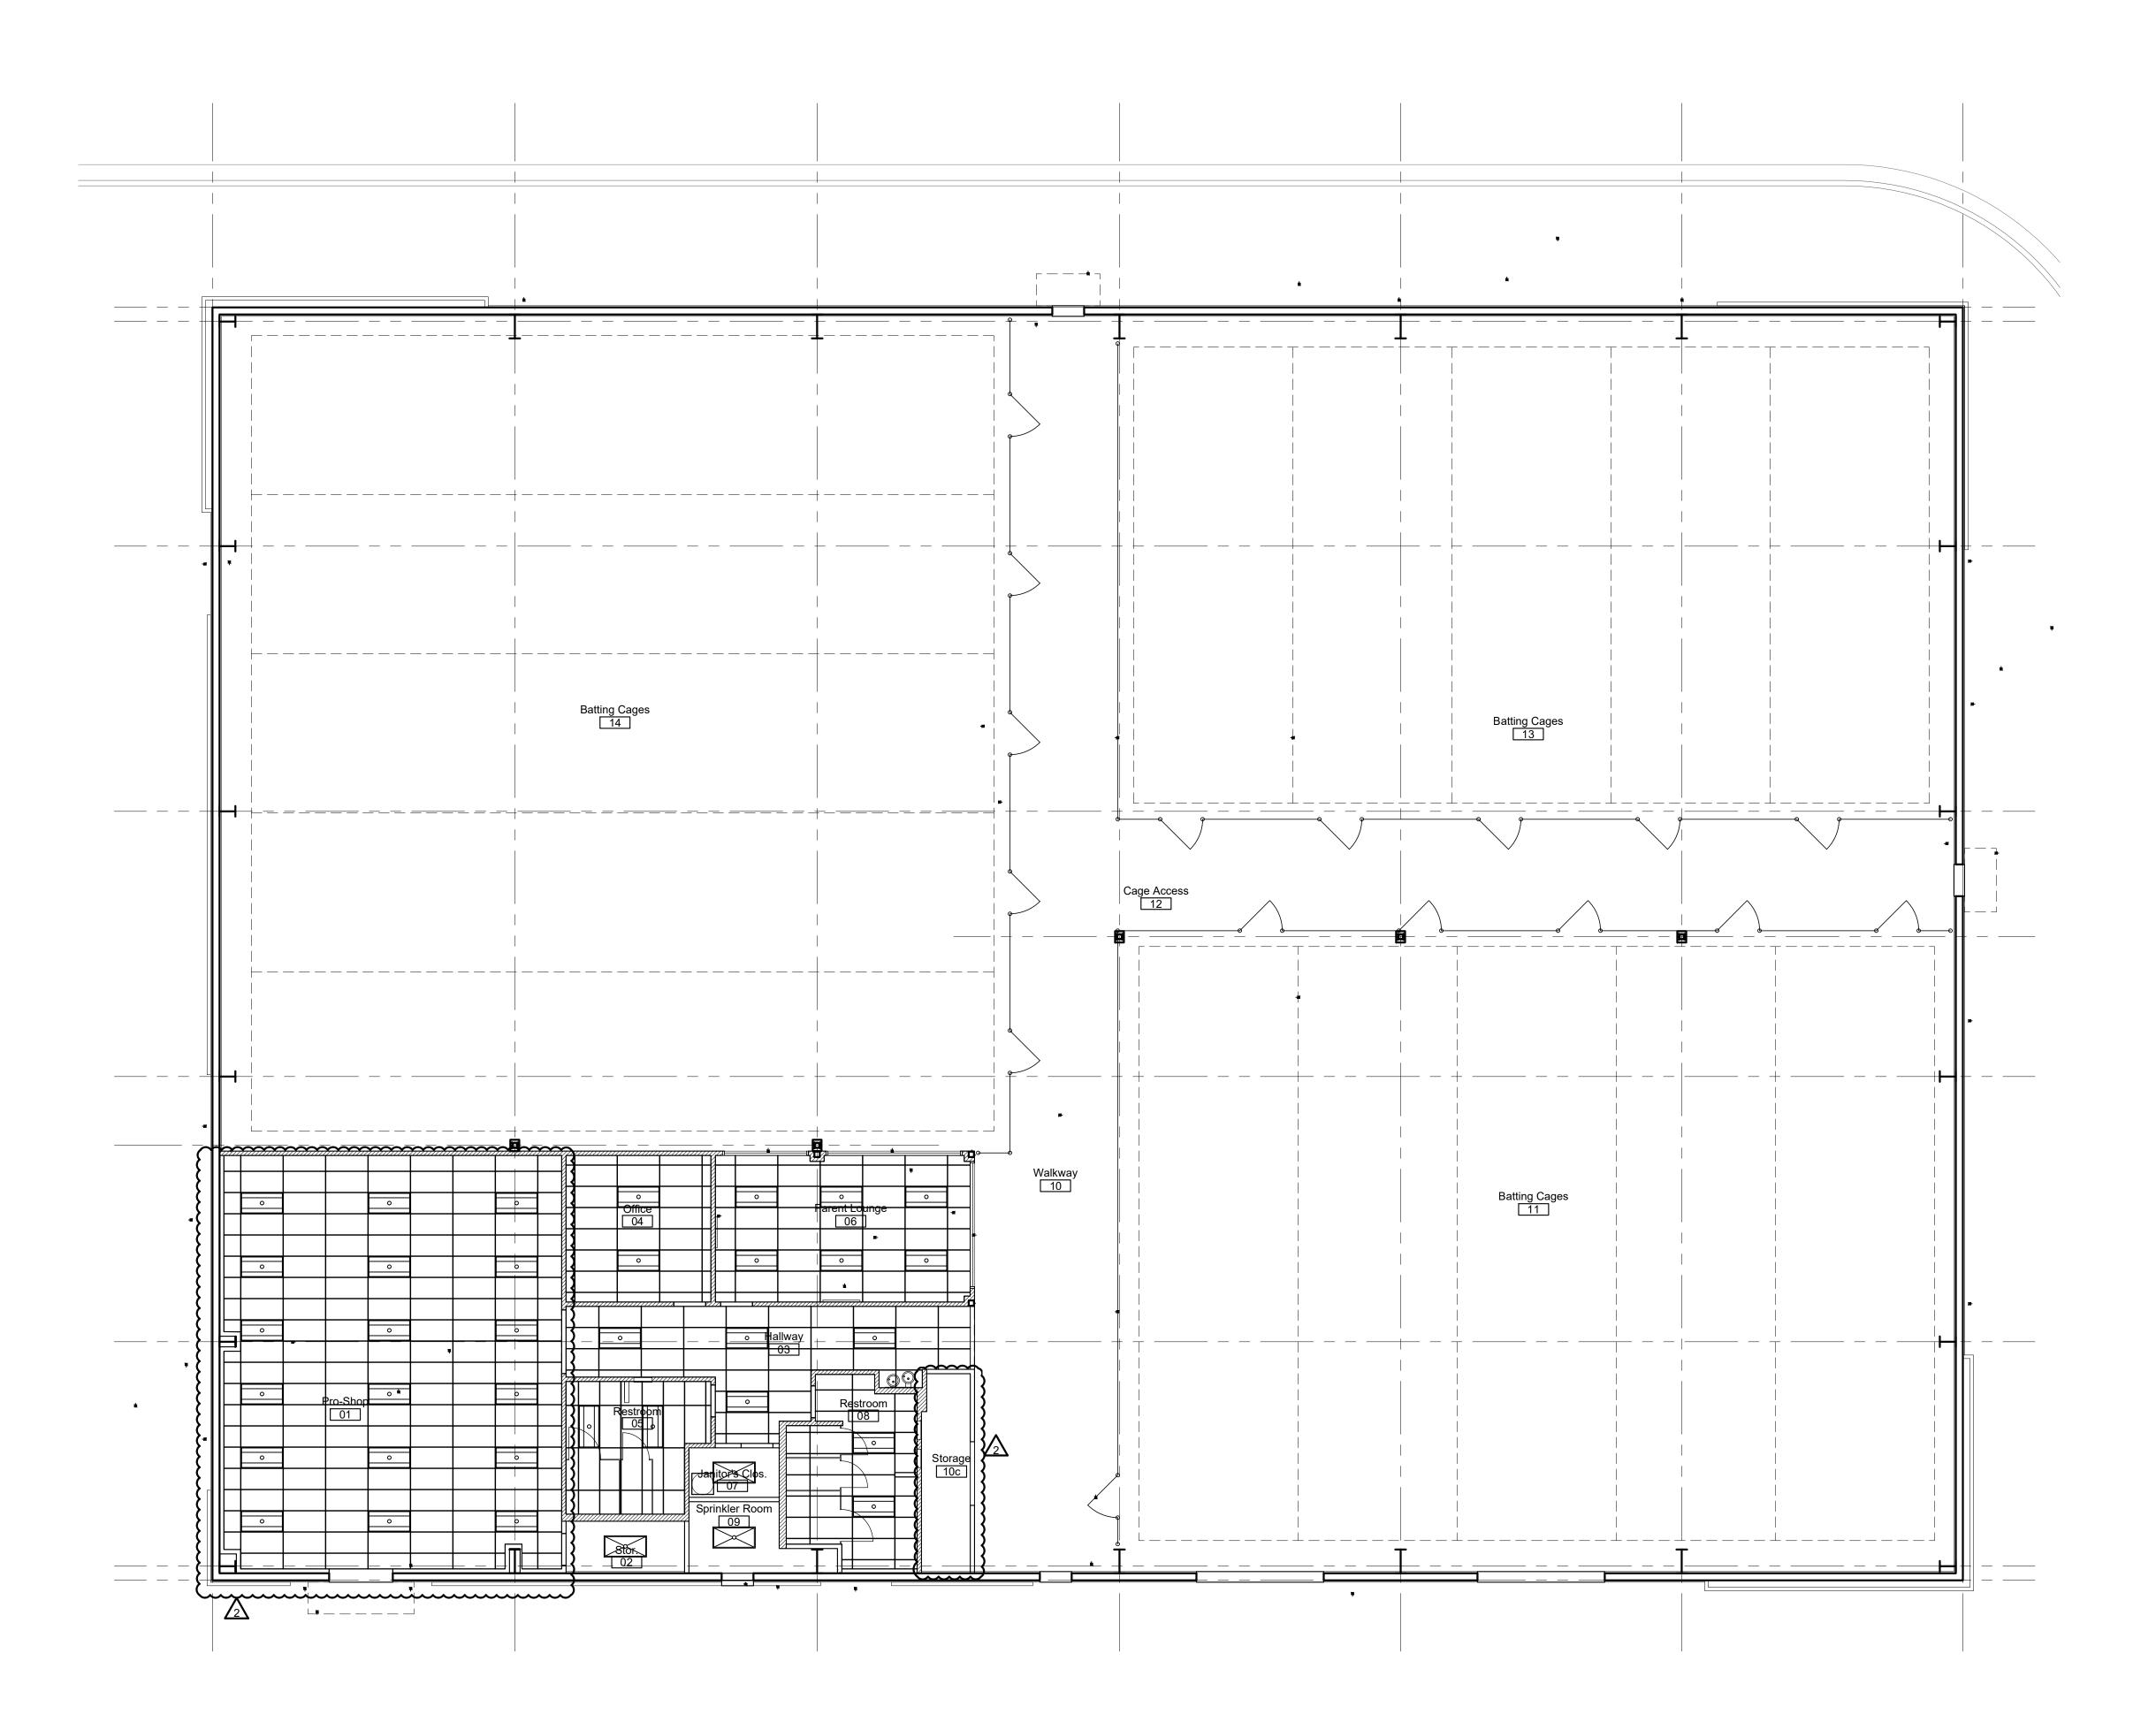



4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fax: 913.451.9391 www.davidsonae.com



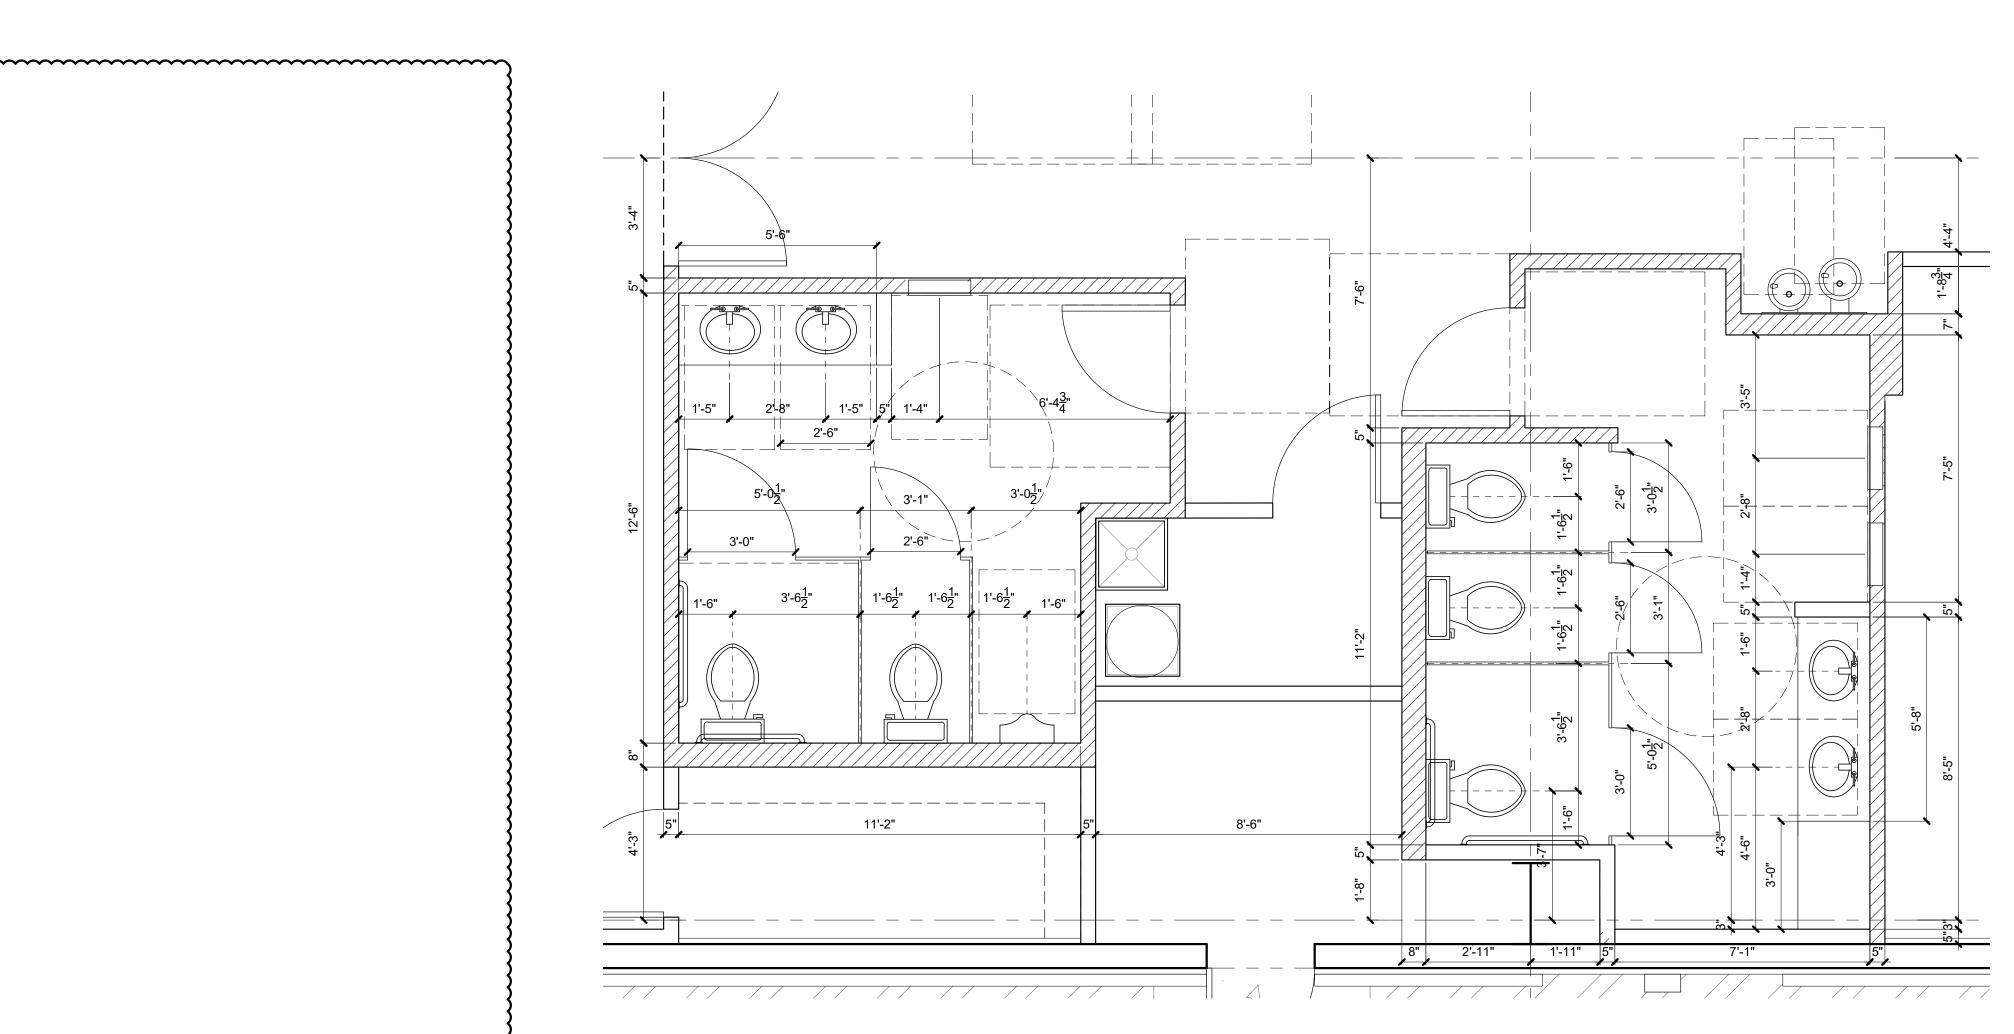

date
05.19.2022
drawn by
DAE
checked by
DAE
revisions

10.13.2022

sheet number

drawing type FDP & Permit **project number** 20231

1 Enlarged Restroom Plan scale: 3/8" = 1'-0" north

architecture & engineering



- provide appropriate covers for flue penetrations paint to match the building. furnish and install knox box; reference floor plan; verify final location with code official and fire department
- all building mounted equipment shall be painted to match the adjacent wall colors, including pipes, and panels; do not paint meters.
- furnish and install landscape screening for all building mounted equipment; reference MEP
- material substitutes and changes MUST be approved by the City of Lee's Summit prior to purchase
- provide blocking and electrical at building mounted sign locations
- reference window elevation sheet reference door schedule and detail sheets
- all signage must be reviewed as part of a separate sign permit through the City of Lee's Summit
- stone shall align with seams in metal panels windows shall be centered with metal panels

exterior materials & finishes

Metal Panel Panel 2 - textured metal panel per PEMB supplier, color Gray Panel 3 - textured metal panel per PEMB supplier, color Off-White Panel 1 - tenant accent color, textured metal panel per PEMB supplier, color flashing/trim

prefinished to match adjacent wall colors

fascia panels prefinished panels per PEMB supplier, color Black

color to match building fascia prefabricated metal awnings per PEMB supplier, color Black

Gutter & Downspout: To match PEMB wall panel Gray - per supplier

manufactured stone, Versetta ledgestone color

Windows 1" insulated low-e glass with argon fill in 2" thermally broken frames per PEMB supplier (caulk at perimeter inside and out); frames color Black

Storefront Door 1" insulated clear glass with thermally broken frames per PEMB supplier; frames color Black

Overhead Doors


soffit panels


insulated manual overhead doors, painted to match tenant accent color per building elevations


Hollow Metal Doors galvanized insulated hollow metal doorl and frame, painted to match adjacent


wall color

caulk - color to match adjacent wall colors

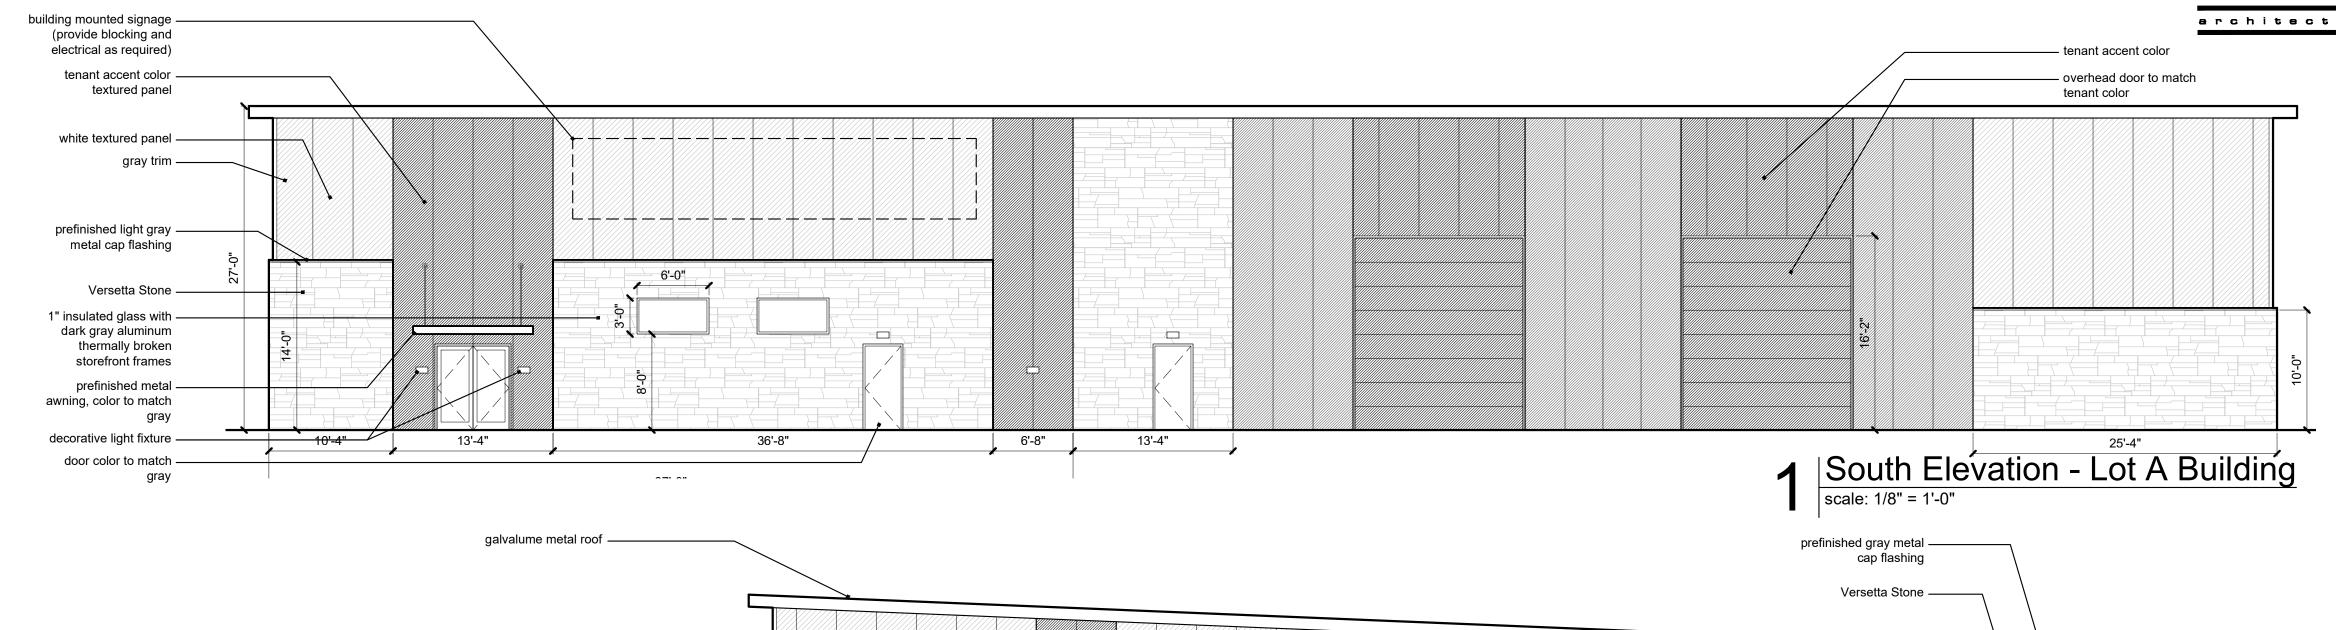

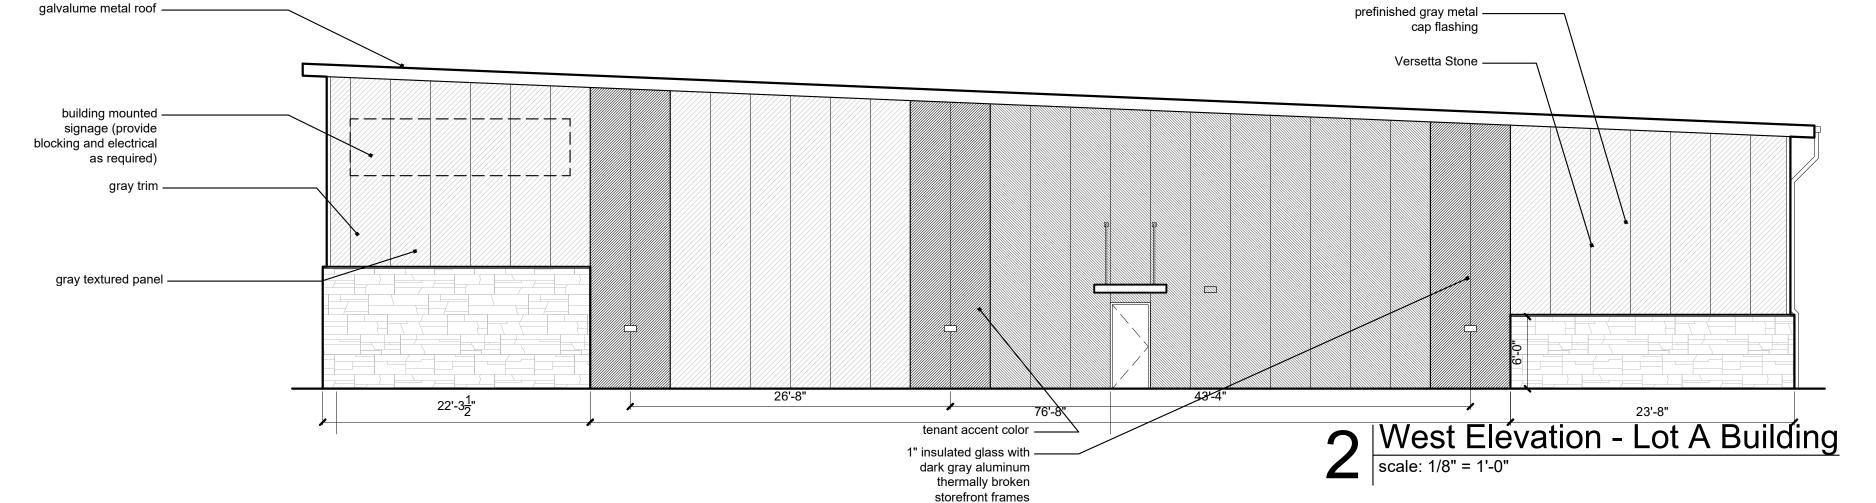

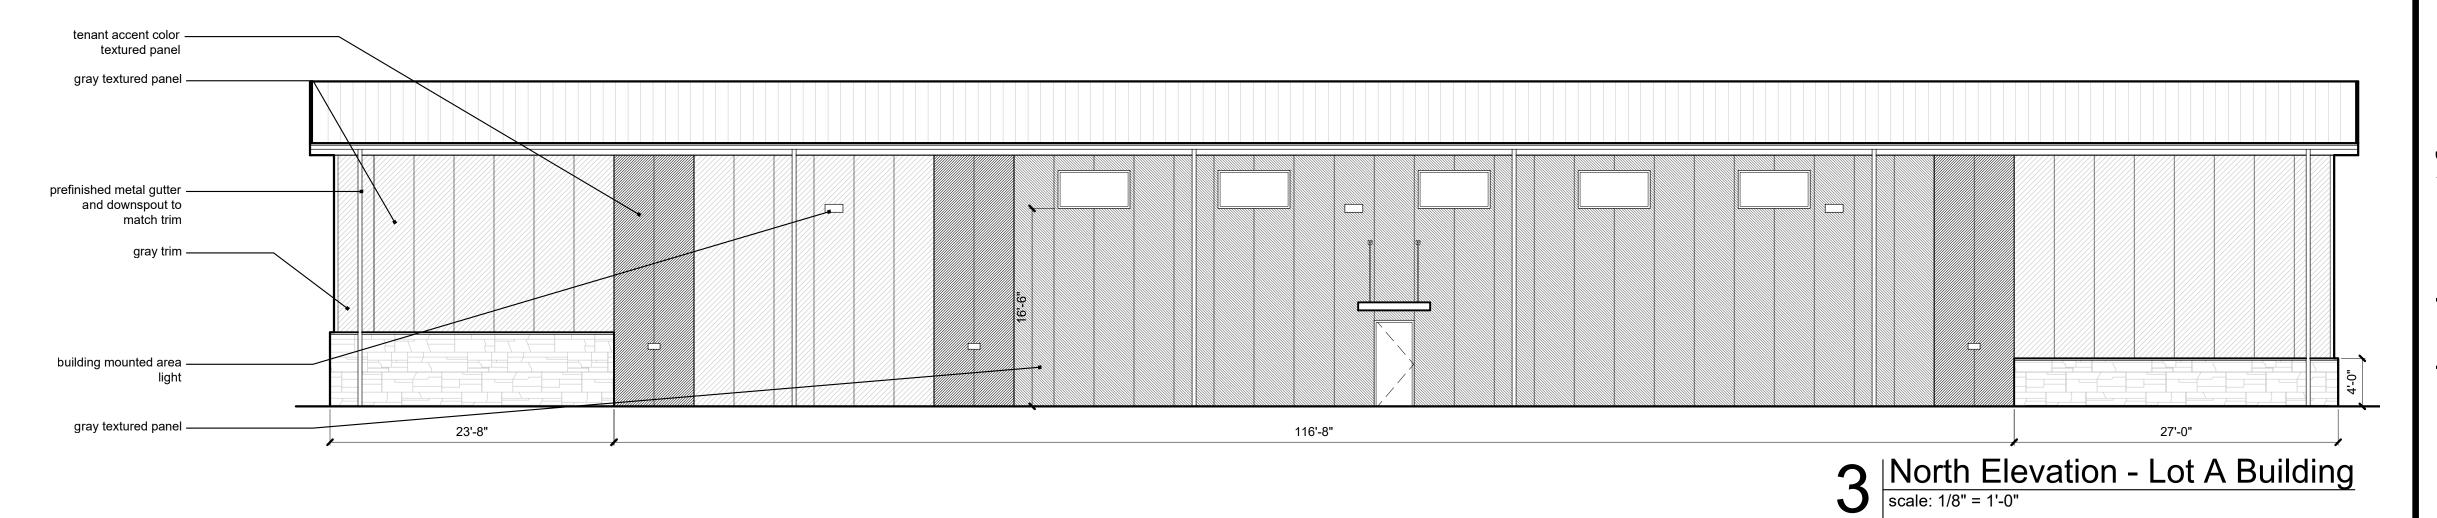

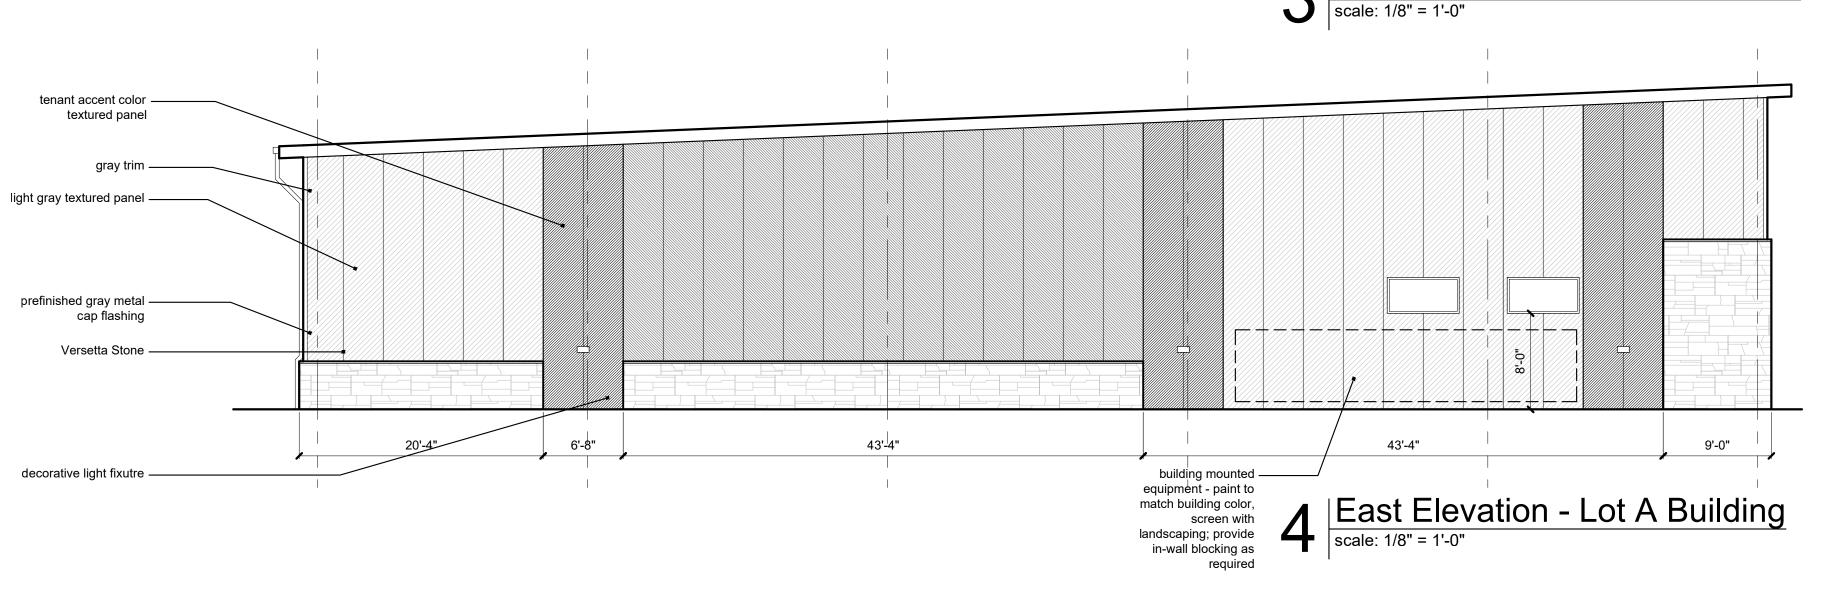

4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fax: 913.451.9391 www.davidsonae.com




date 05.19.2022 **drawn by** DAE checked by DAE revisions

sheet number







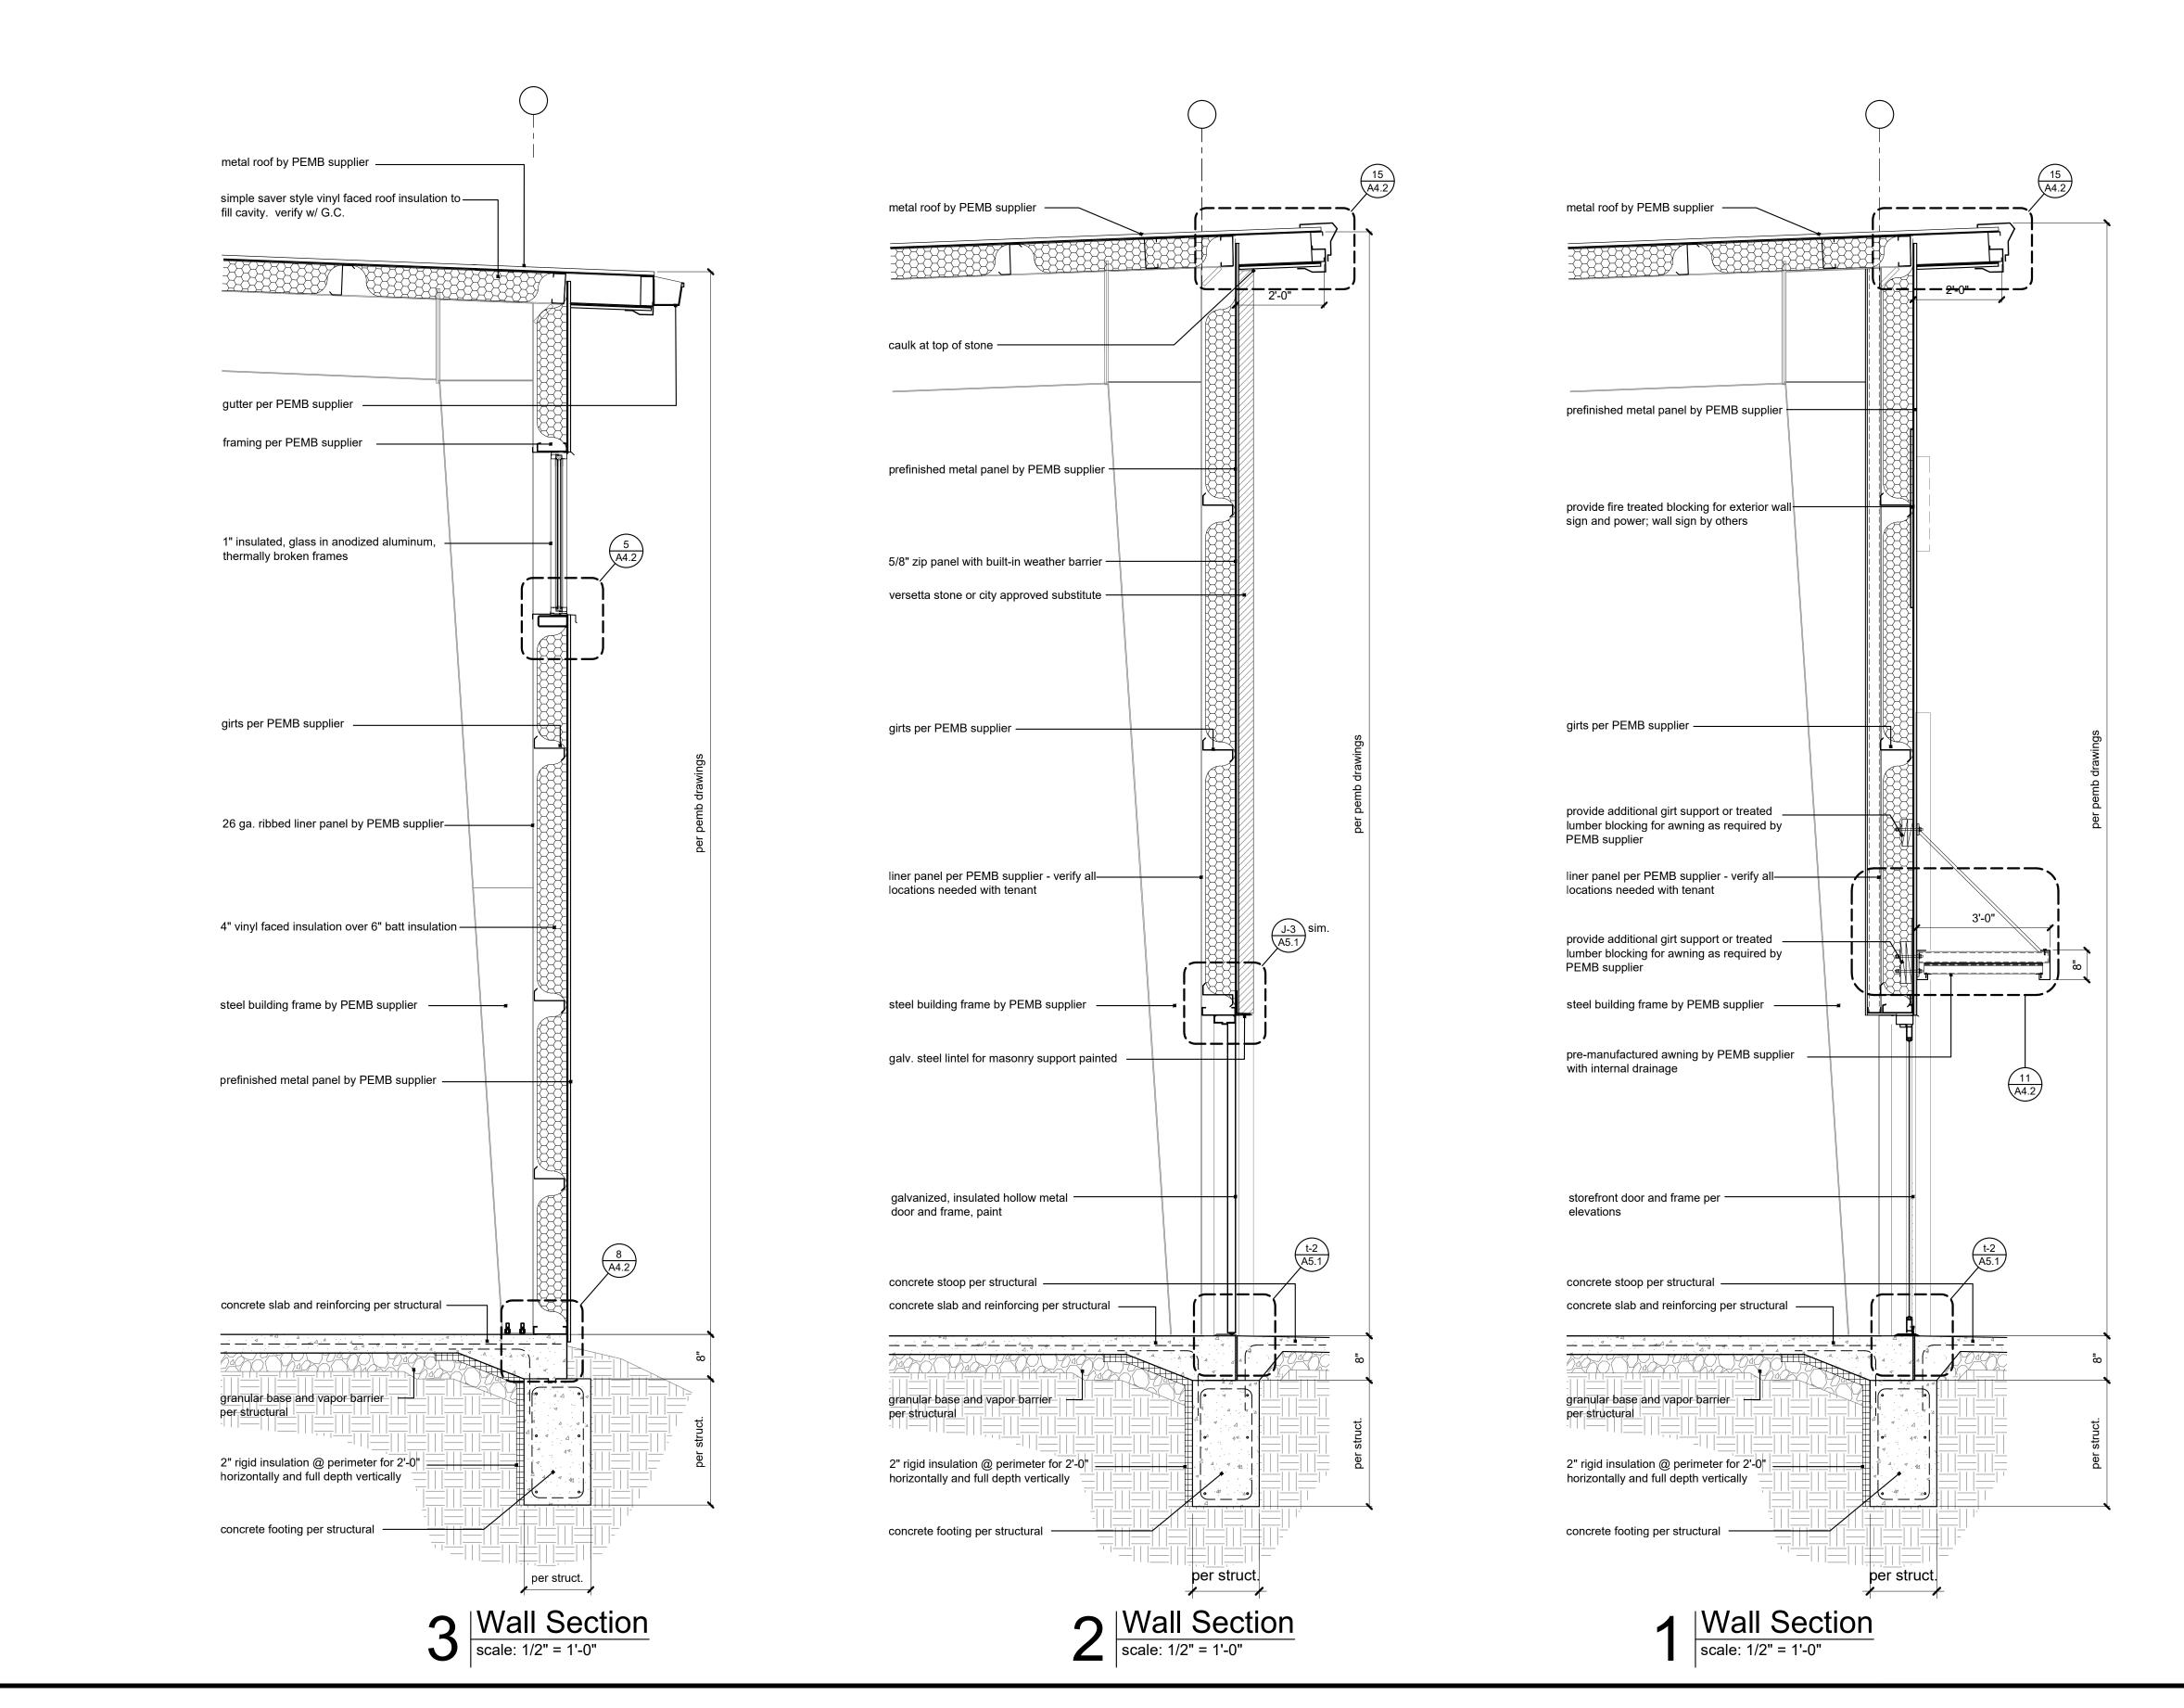

metal roof by PEMB supplier ———

prefinished metal panel by PEMB supplier

liner panel per PEMB supplier - verify all-

trim at door head by PEMB supplier - paint

steel building frame by PEMB supplier

10'-0" x 10'-0" steel vertical lift —

1/4" drop and 1/2" slope

at o.h. door sill per detail -

concrete stoop per structural -

granular base and vapor barrier

2" rigid insulation @ perimeter for 2'-0" =

horizontally and full depth vertically

concrete footing per structural —

per structural

concrete slab and reinforcing per structural —

overhead door

locations needed with tenant


any exposed steel

girts per PEMB supplier -

y development for 3AT - Town Centre

date
05.19.2022
drawn by
DAE
checked by
DAE
revisions


sheet number

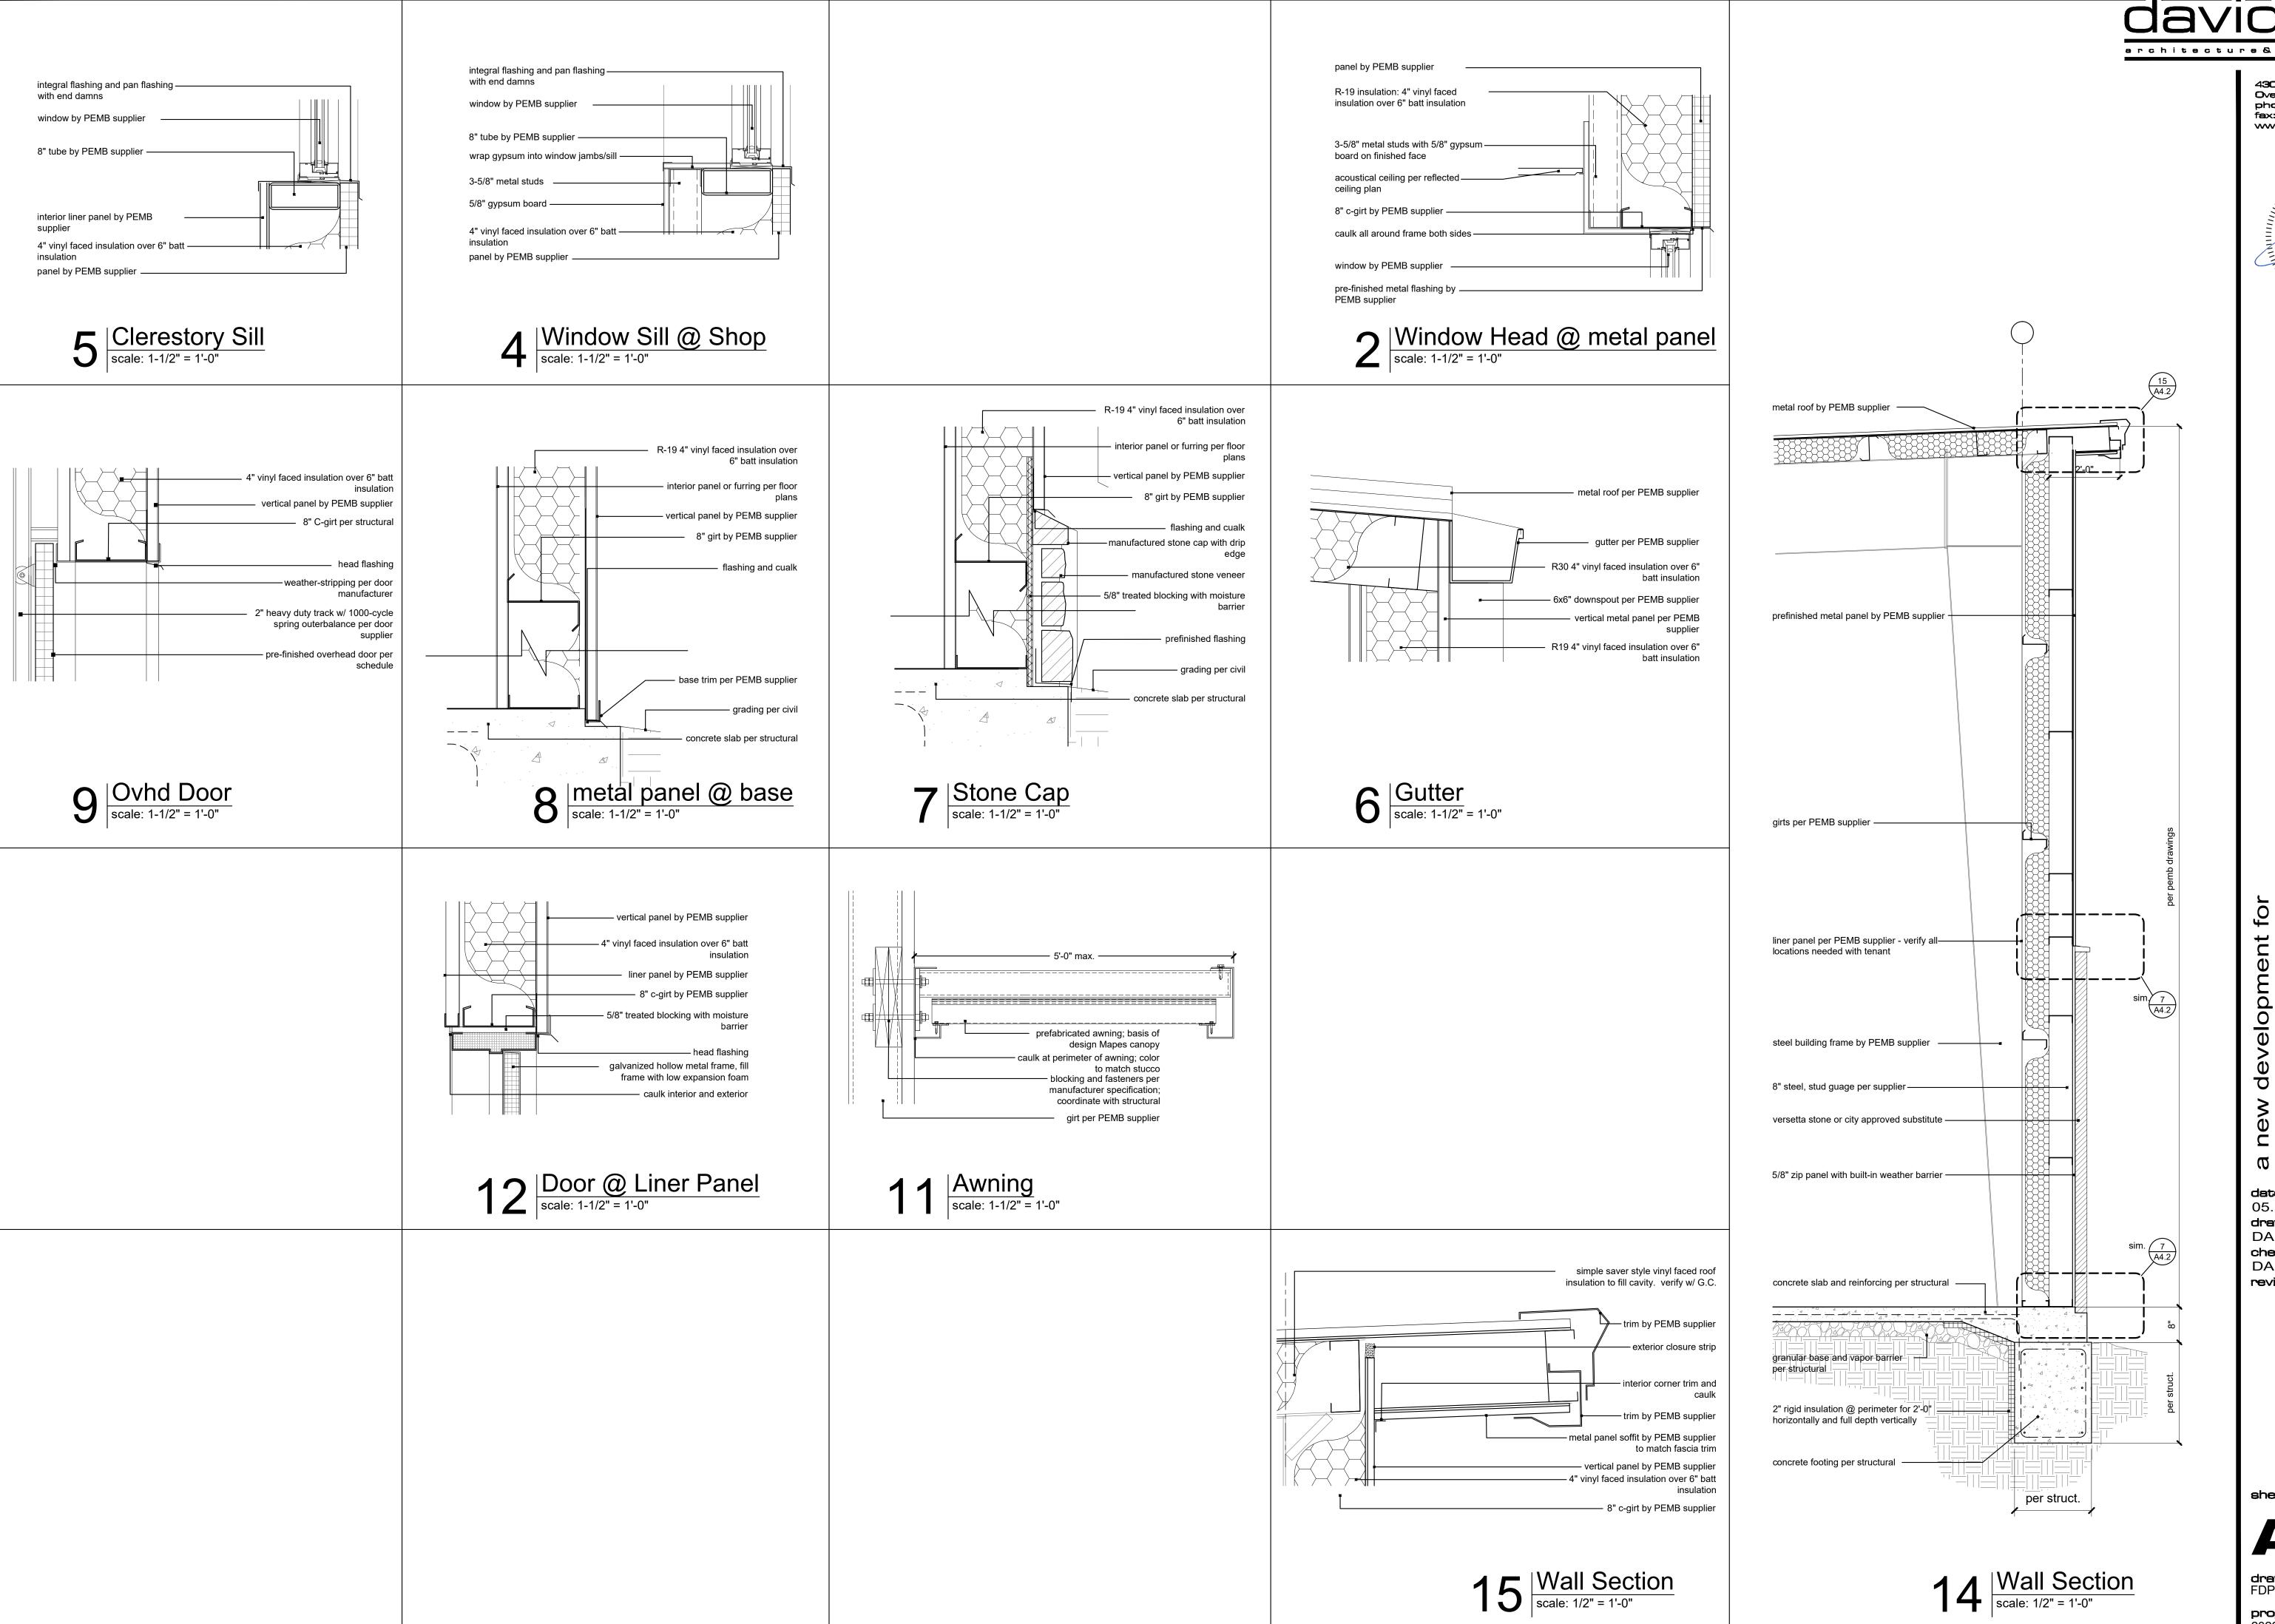

davidson architecture & engineering

> 4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fax: 913.451.9391 www.davidsonae.com





 $\boldsymbol{\sigma}$ date

05.19.2022 **drawn by** DAE checked by DAE revisions

sheet number **A4.2 drawing type**FDP & Permit project number 20231

							doo	r sch	redu	le			
			do	ors					frames				
door					size					det	ails	fire	
#	type	mat.	finish	width	height	thick	type	material	finish	jamb	sill	rating	remarks
01	Е	alum.	black	3'-0" pr.	7'-0"	1 3/4"	F4	alum.	black	J-2	t-1	-	verify color matches window frames
02	Α	wd.	paint	3'-0"	7'-0"	1 3/4"	F3	h.m.	paint	J-4	-	-	
03	В	wd.	paint	3'-0" pr	7'-0"	1 3/4"	F2	h.m.	paint	J-4	-	-	
04	Α	wd.	paint	3'-0"	7'-0"	1 3/4"	F3	h.m.	paint	J-4	-	-	
05	Α	wd.	paint	3'-0"	7'-0"	1 3/4"	F3	h.m.	paint	J-4	-	-	
06	Α	wd.	paint	3'-0"	7'-0"	1 3/4"	F3	h.m.	paint	J-4	-	-	
07	Α	wd.	paint	3'-0"	7'-0"	1 3/4"	F3	h.m.	paint	J-4	-	-	
80	Α	wd.	paint	3'-0"	7'-0"	1 3/4"	F3	h.m.	paint	J-4	-	-	
09	С	galv. h.m.	paint	3'-0"	7'-0"	1 3/4"	F1	galv. h.m.	paint	J-3	t-2	-	
10a	С	galv. h.m.	paint	3'-0"	7'-0"	1 3/4"	F1	galv. h.m.	paint	J-1	t-2	-	
10b	С	galv. h.m.	paint	3'-0"	7'-0"	1 3/4"	F1	galv. h.m.	paint	J-1	t-2	-	
10c	С	galv. h.m.	paint	pair 3'-0"	7'-0"	1 3/4"	F1	galv. h.m.	paint	J-4	-	-	
11a	D	ovhd	prefin.	3'-0"	7'-0"	1 3/4"	-	-	-	-	t-3		paint door to match blue siding, verify size with PEMB dwgs
11b	D	ovhd	prefin.	3'-0"	7'-0"	1 3/4"	-	-	-	-	t-3	-	paint door to match blue siding, verify size with PEMB dwgs
12	С	galv. h.m.	paint	3'-0"	7'-0"	1 3/4"	F1	galv. h.m.	paint	J-1	t-2	-	
~~~	<b> </b>	<del> </del>						T		<b></b>	<del>                                     </del>	<del> </del>	

## door and hardware notes

- All hardware shall be clear anodized aluminum or close match with the exception of the
- exterior entry storefront door, which should match the window frames. • Coordinate security hardware and electrical that may be required with tenant.
- All hinges at exterior doors shall have non-removable pins. Doors with closers shall have ball bearing hinges
- Threshold shall coordinate with adjacent floor finish at either site
- Hardware shall be heavy-duty, commercial grade, level 1 with lever handle
- Finish hardware shall meet article III of ADA Keying shall be coordinated with owner prior to order of hardware
- All storefronts shall be caulked around entire perimeter and at the inside corners
- All exterior doors shall include a rain guard
- All glazing shall comply with section 2406 of the 2018 IBC
- All glazing interior or exterior per Section 2406 of the 2018 IBC, including glass mirrors shall be constructed with safety glazing Category II glazing is required in storefront doors per section 2406 of the 2018 IBC
- Category A glazing shall be utilized in glazed panels greater than 9 sq. ft. per section 2406 of the 2018 IBC.
- Each pane of safety glazing installed in hazardous locations shall be identified by a manufacturer's designation specifying who applied the designation, the manufacturer or installer and the safety glazing standard with which is complies, as well as the information specified in '2403.1' Section 2403.1. The designation shall be acid etched, sand blasted, ceramic fired, laser etched, embossed or aof a type that once applied,

cannot be removed without being destroyed. Tempered spandrel glass is permitted to


be identified by the manufacturer with a removeable paper designation. • Panic hardware shall be provided per section 1008.1.10 of the 2018 IBC.


## hardware list


- 1. exterior storefront door: 01 *match hardware color to 5. office door: 04 door color) 5.1. door stop
- 1.1. rain drip
- 1.2. ADA offset door pull 1.3. panic hardware with closer (compatible with
- storefront)
- 1.4. entry door lockset 1.5. none removeable hinges
- 1.6. door sweep
- 1.7. weather gasketing 1.8. wall stop
- 2. exterior hollow metal door: 10a, 10b, 12
- 2.1. rain drip 2.2. ADA exterior lever handle
- 2.3. panic hardware with closer
- 2.4. lockset 2.5. non removeable hinges
- 2.6. door sweep
- 2.7. weather gasketing
- 2.8. floor stop (locate away from floor traffic to avoid
- tripping hazard)
  3. interior double door: 03 10c 2
- 3.2. ADA door pullls
- 3.3. vertical 3.4. silencers
- 3.5. non removable hinges 3.6. wall stop 4. sprinkler room: 09
- 4.1. rain drip 4.2. ADA exterior lever handle
- 4.3. closer 4.4. nonremovable hinges
- 4.5. door sweep
- 4.6. weather gasketing
- 5.2. ADA lever handles with privacy lockset 5.3. hinges 5.4. silencers 5.5. wall stop 6. party room/lounge: 06, 21 6.1. closer 6.2. ADA lever handles with storeroom lockset 6.3. hinges 6.4. silencers 6.5. wall stop 7. multi-stall bathroom: 05, 08 7.1. closer 7.2. ADA door pull 7.3. no-hands door pull 7.4. push plate 7.5. kick plate 7.6. hinges silencers
- 7.8. wall stop 8. single user bathroom: 22, 23 8.1. closer 8.2. ADA lever handles with privacy lockset
- 8.3. hinges 8.4. silencers
- 8.5. wall stop 9. storage/closet: 02, 07, 21a, 24
- 9.1. ADA lever handles with storeroom lockset 9.2. hinges
- 9.3. silencers 9.4. wall stop
- 10. stair: 20 10.1. panic hardware with closer 10.2. ADA door pull


- 10.3. silencers
  10.4. kick plates
  10.5. hinges
  10.6. wall stop

# architecture&engineering

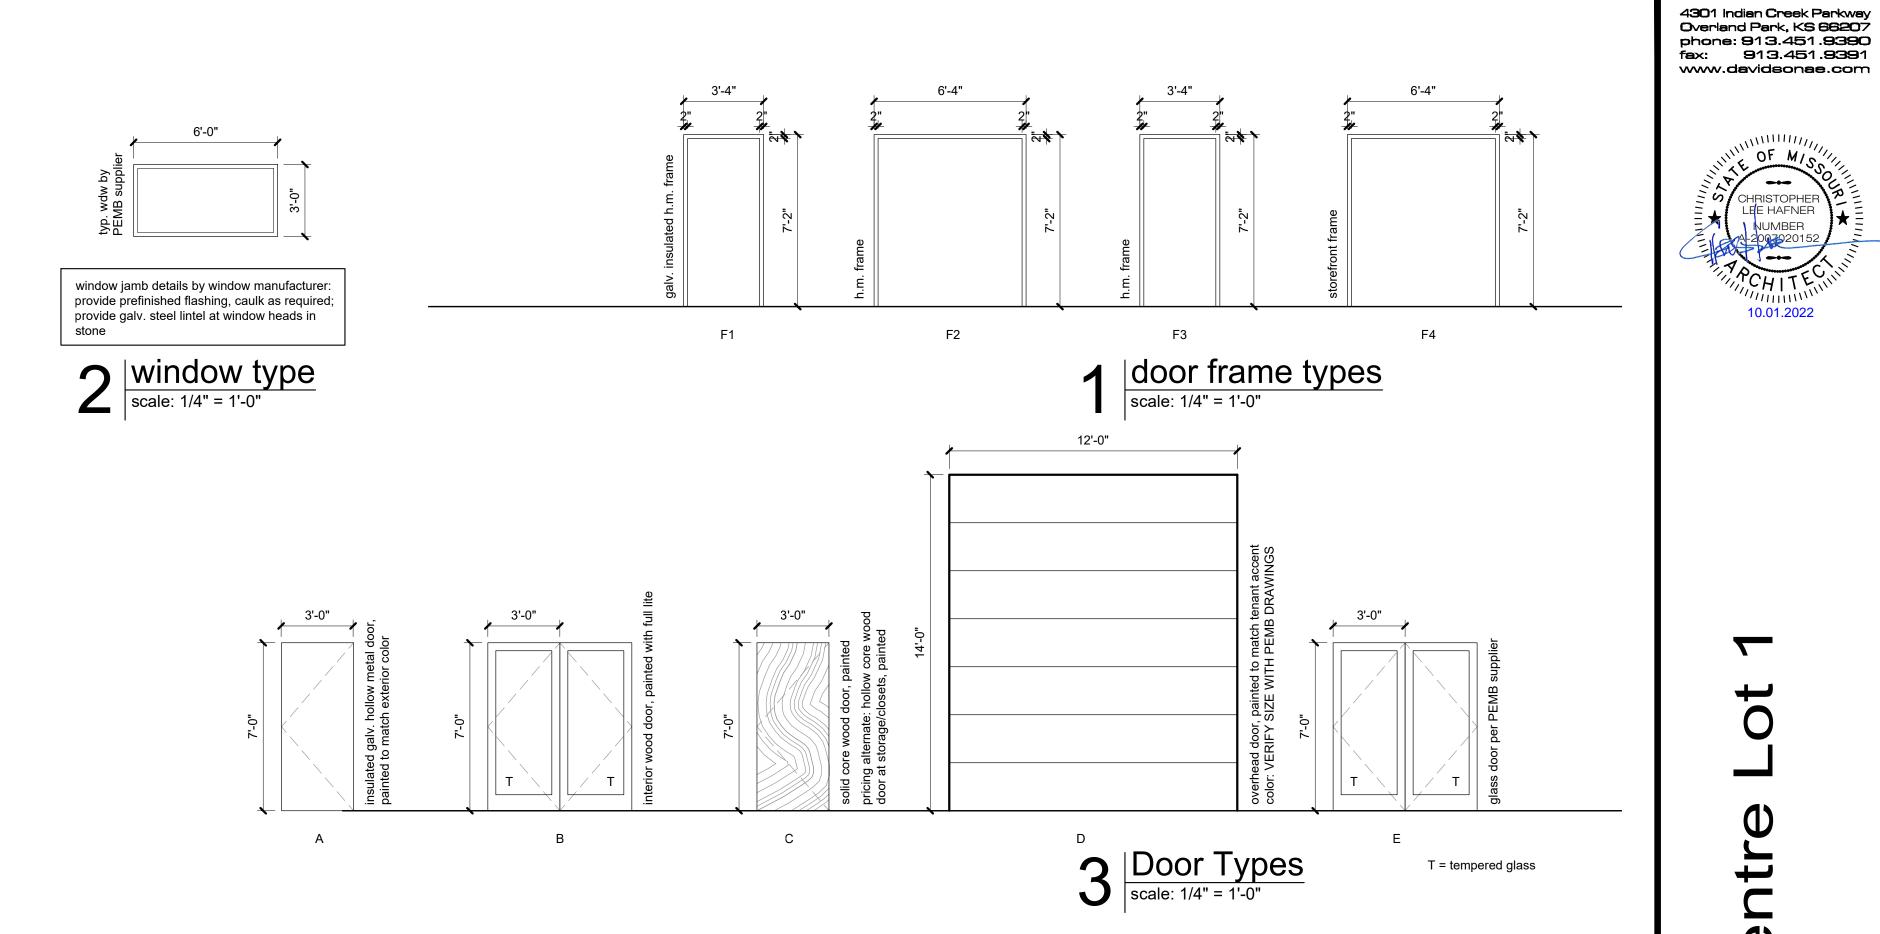


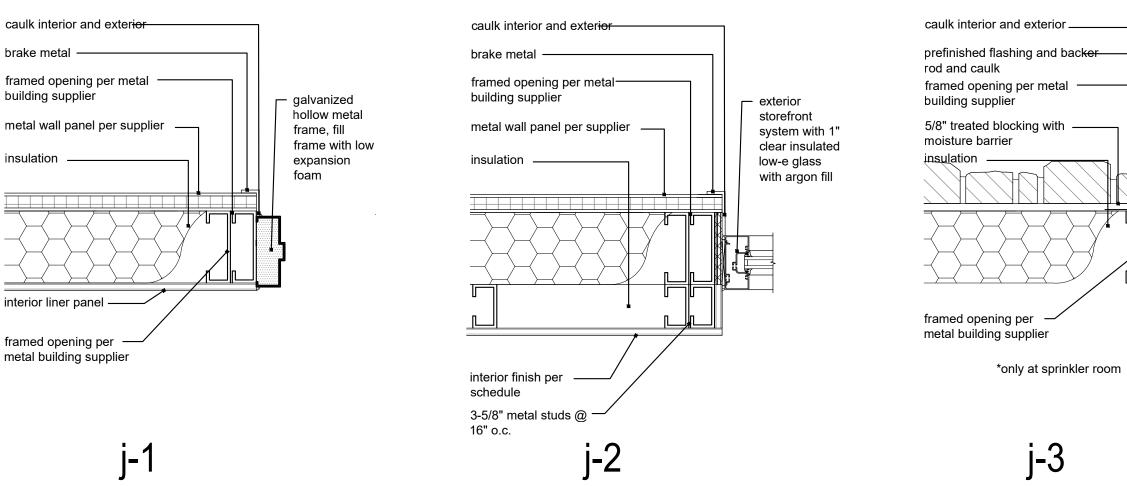

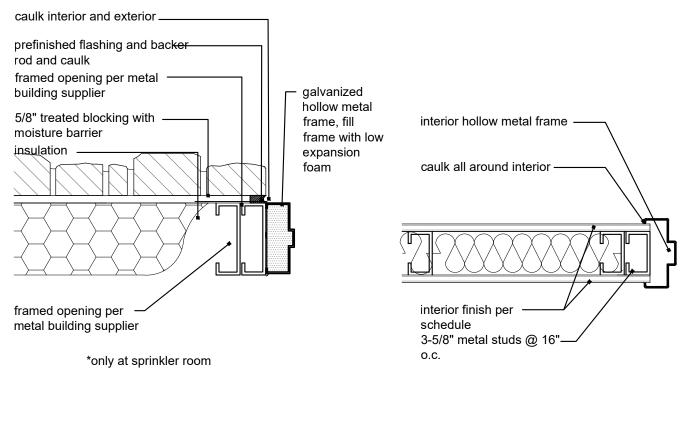

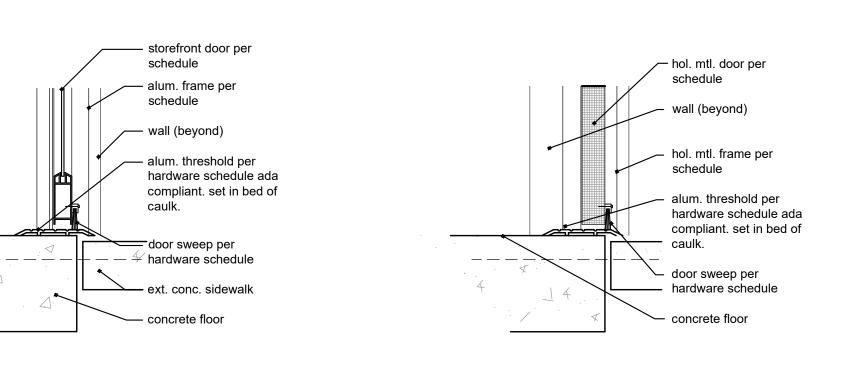

t-2

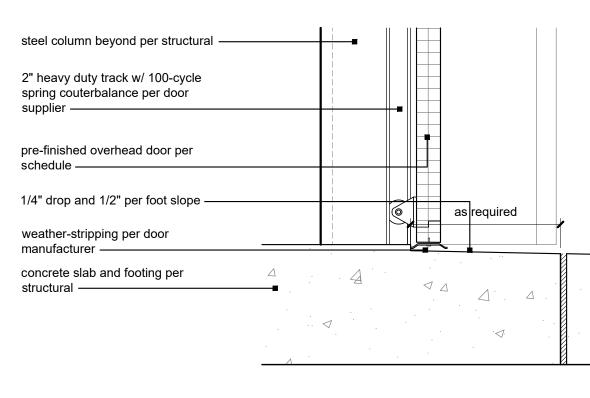

t-3 5 Threshold Types scale: 1-1/2" = 1'-0" development  $\boldsymbol{\omega}$ date

05.19.2022 **drawn by** DAE checked by DAE revisions

sheet number



4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fax: 913.451.9391 www.davidsonae.com




**date** 05.19.2022 **drawn by** DAE checked by DAE


revisions

06.20.2022 10.13.2022


**A5.2** 

**drawing type**FDP & Permit

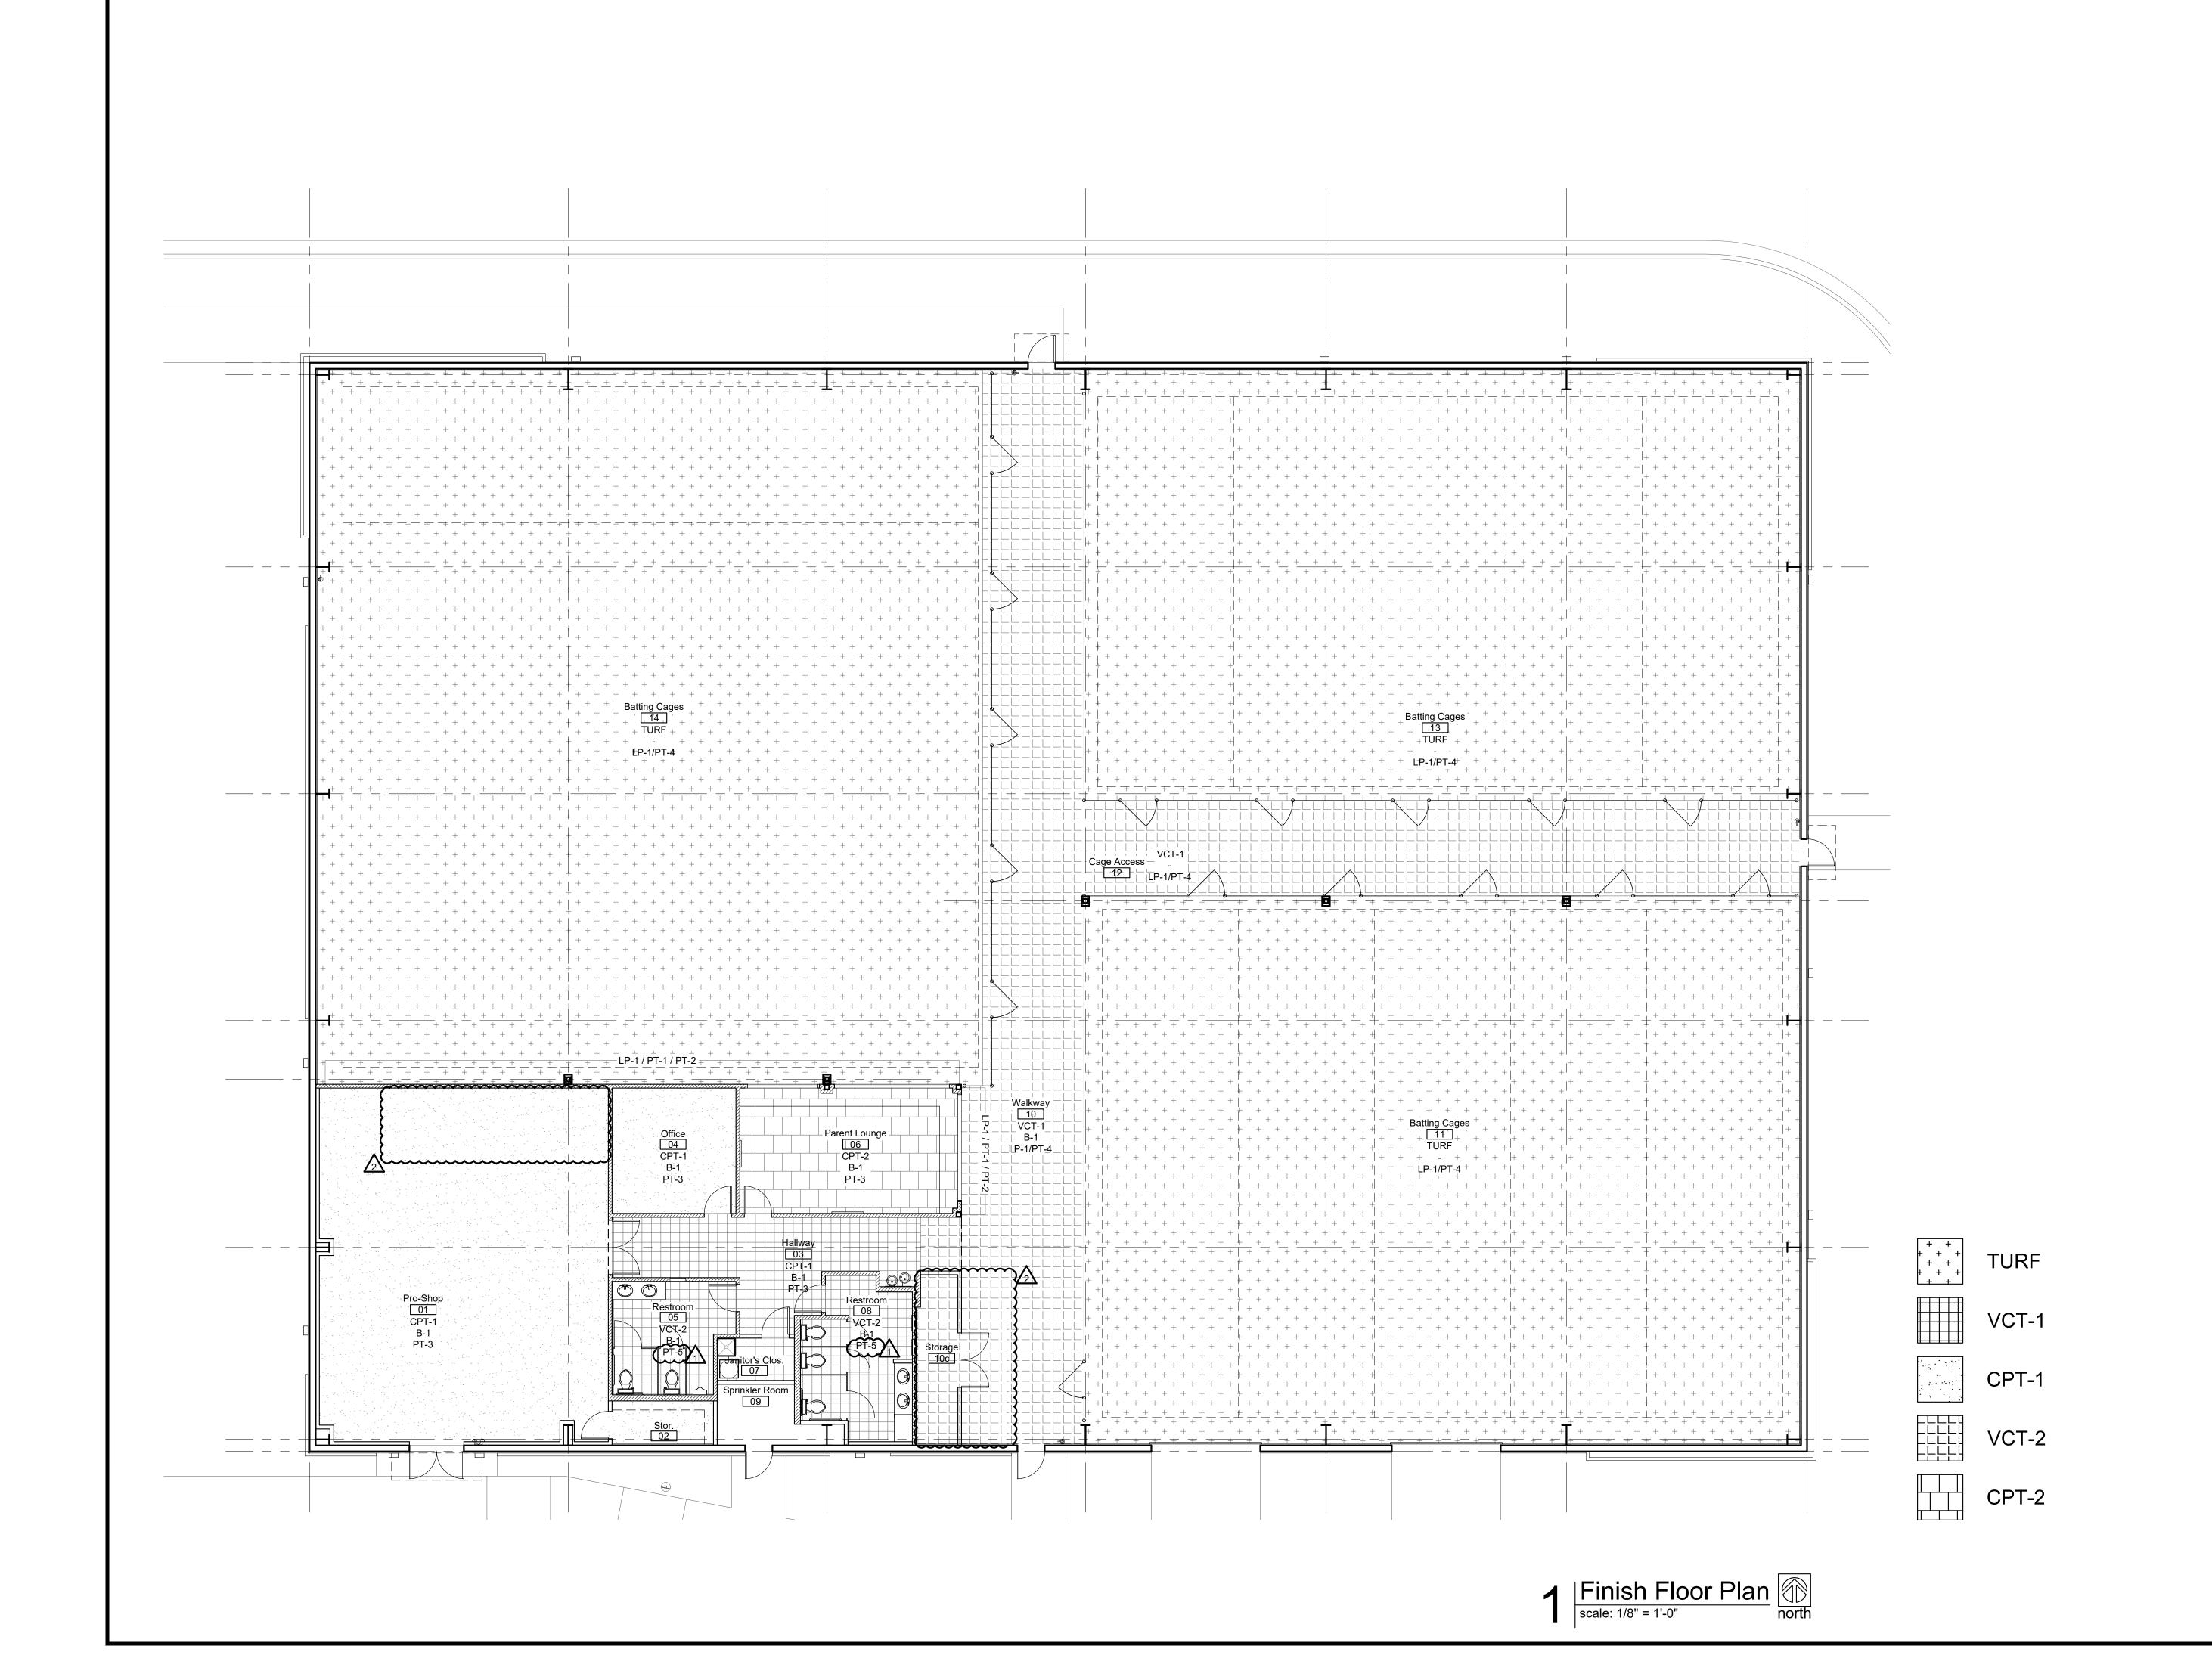

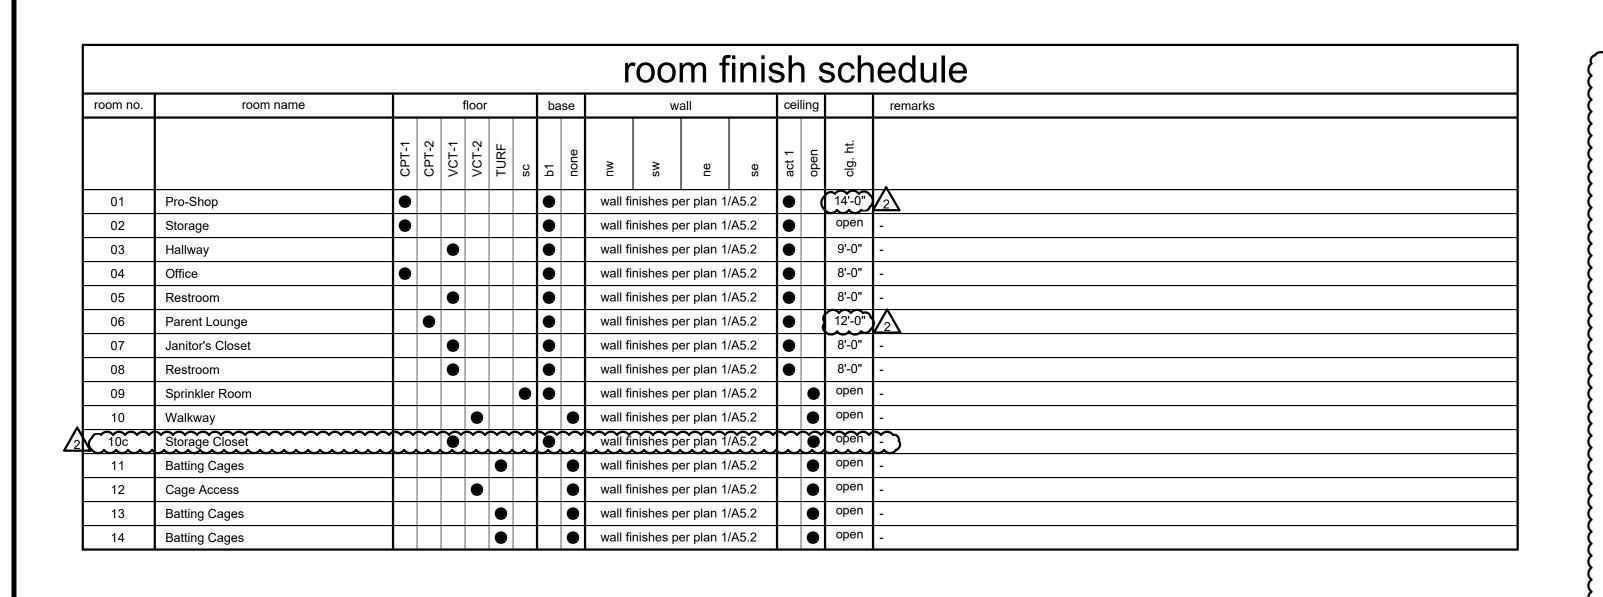

finish legend

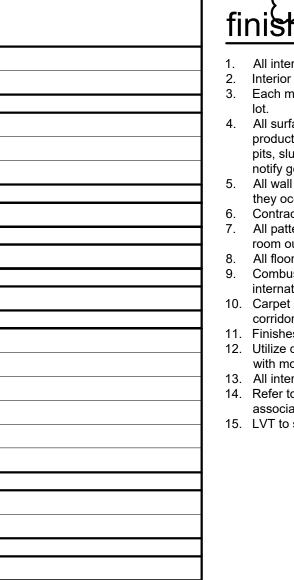

# finish notes:

- All interior glazing to be clear. Temper all interior glass.
- Interior aluminum storefront shall have clear anodized aluminum finish Each material specified for application on the entire project shall be from the same dye
- All surfaces shall be cleaned and conditioned to receive new finish as required by finish product manufacturer. Surfaces shall be smooth, free from depressions, protrusions,
- pits, slumps, streaks, flashing, and variation in texture. Installer/subcontractor shall notify general contractor prior to installation if conditions are not satisfactory.
- All wall mounted mechanical slots or grilles to be painted to match the wall on which they occur. Do not paint prefinished wall mullion end caps. Contractor shall be responsible for leveling of floor slabs to receive specified finishes.
- All patterned flooring to be centered in both directions and generated from center of room outward toward partitions, unless otherwise noted.
- All floor finish changes to occur under centerline of door in closed position. Combustible interior finish products shall be provided per the requirement of the
- international building code section 803.4. Carpet seams shall occur at junctions of partitions, thresholds or change of direction in
- corridors. No strip patch allowed smaller than 4'-0". Finishes shall be bid as specified or as approved equal only.
- . Utilize dens-armour plus in all plumbing wet walls, walls anticipated to be in contact with moisture, or walls receiving ceramic tile.
- 13. All interior ceramic corners & tops shall receive schluter trim.
- 14. Refer to finish legend for level of gypsum board finish as defined by the gypsum
- 15. LVT to sealed concrete shall occur with rubber transition to match base color.

plumbing to be set back as far as possible — - pipes to be insulated to comply with code 2'-0" 1'-10" plastic laminate counter top, return mirror glued and fastened to face top mount lavatory in plastic lam. plumbing to be set back as far toe kick attached to door on front ——— wrapped to comply with code approach only

finished flooring shall extend under


required clear floor space shall extend-


the min / max required by ADA

under counter to centerline of faucet 25"

dimensions shown relate to this specific detail.

the min. or max dimension in parenthesis is

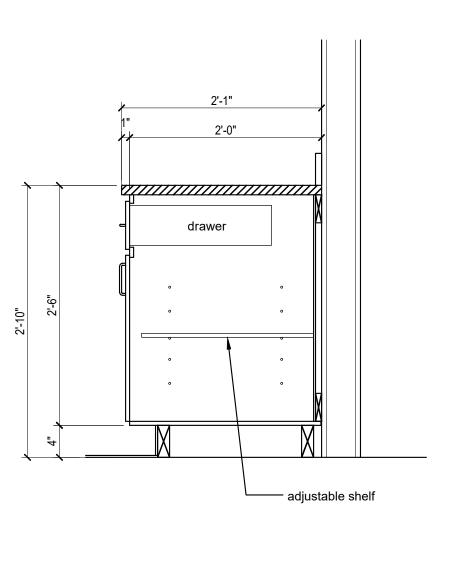

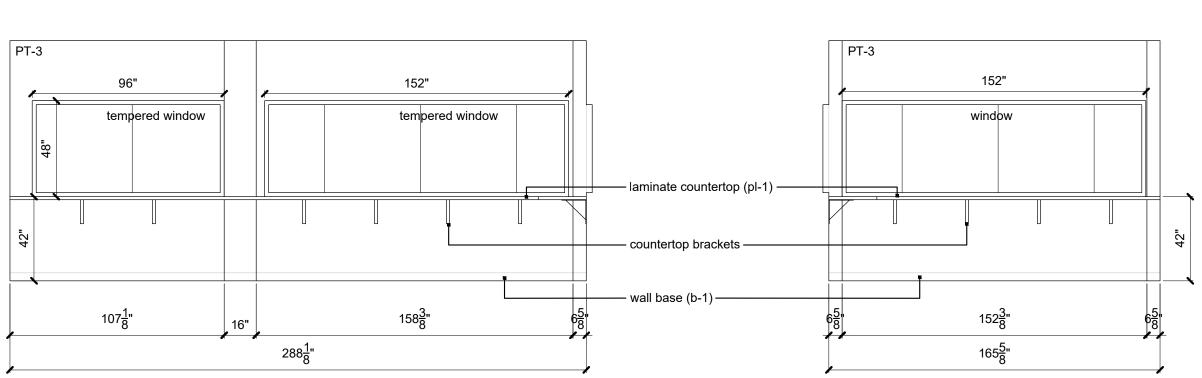

and backsplash

of gypsum board

— 5/8" gypsum board

as possible. pipes to be

blocking as required

provide cross bracing

plastic laminate, on 1/2" plywood panel,

removable for plumbing access. support

according to manufacturer's instructions

— metal stud wall

CPT-1 carpet tile, Philadelphia Commercial, style: Counterpart (54816), size: 24" x 24", color: Copilot (16400)

TURF D-BAT Turf

SC sealed concrete - ashford sealer

B-1 vinyl base, manufacturer: TBD, standard cove, size: 4", color: gray

plastic laminate, wilsonart, color: indigo (D379) plastic laminate, wilsonart, color: dove grey (D92)

CPT-2 carpet tile, Philadelphia Commercial, style: Counterpart (54816), size: 24" x 24", color: Correlate (16505)

wall paint, manufacturer: TBD, finish: eggshell, color: D-Bat Gold (1 coat primer, 2 coats paint - to cover)

wall paint, manufacturer: TBD, finish: eggshell, color: D-Bat Red (1 coat primer, 2 coats paint - to cover)

PT-5 epoxy paint, manufacturer: TBD, color: D-Bat White (1 coat primer, 2 coats paint - to cover) primer, sherwin williams, PrepRite High Build latex primer/surfacer, B28W601

liner panel, Chief Buildings, steel liner panel, color: Emerald Green (EG)

door finish, manufacturer: TBD, color: manufacturer's standard white

wall paint, manufacturer: TBD, finish: eggshell, color: D-Bat White (1 coat primer, 2 coats paint - to cover)

PT-4 wall paint, manufacturer: TBD, finish: eggshell, color: D-Bat Green (1 coat primer, 2 coats paint - to cover) - from base to 12'-0" a.f.f.

ACT-1 acoustical ceiling tile, armstrong, 2x2, prelude xl  $\frac{15}{16}$ " exposed tee grid, dune #1774, angled tegular (revealed), fine texture, white

VCT-1 vinyl composite tile, Armstrong Flooring, style: Standard Excelon Imperial Texture VCT, size: 12" x 12", color: Gentian Blue (51946)

vinyl composite tile, Armstrong Flooring, style: Standard Excelon Imperial Texture VCT, size: 12" x 12", color: Pomegranate Red (51814)

pricing alternate: basis of design Restek epoxy floor, colored flakes with red as primary color - submit sample for tenant approval

5 | Sink Base Cabinet | scale: 1" = 1'-0"

4 | Base Cabinet | scale: 1" = 1'-0"

3 | Parents' Lounge Elevation | scale: 1/4" = 1'-0"

archite)cture & engineering

4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fax: 913.451.9391 www.davidsonae.com

date 05.19.2022 drawn by DAE checked by DAE revisions

06.20.2022 10.13.2022

**A5.3** 

2. CONTRACTOR SHALL USE IBC SPECIFICATIONS AND DETAILS FOR PLACEMENT OF PERIMETER DRAINS, UNDER-SLAB DRAINS, AND ANY OTHER SOILS RELATED ITEMS.

3. ALL FOUNDATIONS TO BEAR ON ORIGINAL, UNDISTURBED SOIL. REMOVE ANY MUD. ORGANIC SILT, ORGANIC CLAYS, PEAT OR UNPREPARED FILL PRIOR TO PLACING FOUNDATIONS.

4. ALL FOOTING EXCAVATIONS TO BE APPROVED BY A QUALIFIED GEOTECHICAL ENGINEER PRIOR TO PLACING CONCRETE. 5. ALL EXTERIOR AND PERIMETER FOOTINGS SHALL EXTEND BELOW FROST

DEPTH, REFERENCE DESIGN INFORMATION FOR FROST DEPTH.

## **NOTES - CONCRETE**

1. ALL CONCRETE CONSTRUCTION TO CONFORM TO ACI "BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE". THE GOVERNING EDITION OF THE ACI 318, AND ACI "SPECIFICATIONS FOR STRUCTURAL CONCRETE FOR BUILDINGS" ACI 301, UNLESS NOTED OTHERWISE. 2. WATER REDUCING ADD MIXTURES ARE ALLOWED IN CONCRETE MIX

3. SYNTHETIC MICRO-FIBERS ARE NOT ALLOWED UNLESS SPECIFICALLY NOTED IN THESE DRAWINGS.

4. UNLESS OTHERWISE SHOWN IN THE ARCHITECTURAL DRAWINGS, PROVIDE 3/4" CHAMFERS AT THE EDGES THAT ARE EXPOSED TO VIEW IN THE FINISHED STRUCTURE

5. REFERENCE ARCHITECTURAL DRAWINGS FOR DOOR AND WINDOW OPENINGS, DRIP SLOTS, REGLETS, MASONRY, ANCHORS, BRICK LEDGE ELEVATIONS AND FOR MISCELLANEOUS EMBEDDED PLATES, BOLTS, ANCHORS, ANGLES, ETC.

6. REFERENCE ARCHITECTURAL DRAWINGS FOR CONCRETE FINISHES. WHERE FINISH IS NOT SPECIFIED, CONFORM TO REQUIREMENTS OF ACI

7. REFERENCE MECHANICAL, PLUMBING, AND ELECTRICAL DRAWINGS FOR DRAINS, SLEEVES, OUTLET BOXES, CONDUIT, ANCHORS, ETC. 8. CONTACT APEX ENGINEERS, INC. IF HOUSE KEEPING PADS OR INERTIA BASES ARE REQUIRED BEYOND WHAT IS SHOWN IN THE STRUCTURAL CONTRACT DOCUMENTS.

9. ALL REINFORCING STEEL TO BE DETAILED IN ACCORDANCE WITH ACI "MANUAL OF STANDARD PRACTICE FOR DETAILING REINFORCED CONCRETE STRUCTURES."

10. REINFORCING SHALL BE CONTINUOUS WHEREVER POSSIBLE. SPLICES AND LAPS TO CONFORM TO ACI 318. REFER TO CONCRETE REBAR

11. DOWELS IN FOOTING, WALLS, AND DRILLED PIERS MUST BE IN POSITION BEFORE PLACING CONCRETE WHENEVER POSSIBLE. 12. REFERENCE TYPICAL FOUNDATION DETAILS FOR INFORMATION ON REINFORCING REQUIREMENTS AT WALL AND SLAB OPENINGS. 13. REFERENCE TYPICAL FOUNDATION DETAILS FOR INFORMATION ON REINFORCING REQUIREMENTS AT CORNER AND TEE INTERSECTIONS.

14. PROVIDE VERTICAL CONTROL JOINTS ON ALL POURED CONCRETE WALLS AND BASEMENT WALLS, EXCEPT FOUNDATION STEM WALLS LOCATED IN THE GROUND. SPACE JOINTS AT 3 x WALL HEIGHT FOR WALLS LESS THAN 10'-0" AND WALL HEIGHT FOR TALLER WALLS. PROVIDE ADDITIONAL JOINT WITHIN 10'-0" OF CORNERS.

15. OPENINGS IN SLAB OF 1'-4" AND LESS ON A SIDE ARE GENERALLY NOT SHOWN ON THE STRUCTURAL DRAWINGS. REFERENCE ARCHITECTURAL AND MECHANICAL DRAWINGS FOR SUCH OPENINGS.

## **NOTES - STEEL**

1. ALL STRUCTURAL STEEL TO BE FABRICATED AND ERECTED IN ACCORDANCE WITH THE GOVERNING EDITION OF THE AISC "CODE OF STANDARD PRACTICE FOR STEEL BUILDINGS AND BRIDGES." 2. BOLTED CONNECTIONS: ALL BOLTED CONNECTIONS SHALL BE SNUG-TIGHT IN ACCORDANCE WITH THE "SPECIFICATION FOR STRUCTURAL JOINTS USING ASTM F3125 GRADE A325 OR A490 BOLTS" PUBLISHED BY THE RESEARCH COUNCIL ON STRUCTURAL CONNECTIONS.

3. WELDED CONNECTIONS: ALL WELDING SHALL BE IN ACCORDANCE WITH THE "STRUCTURAL WELDING SOCIETY CODE" (AWS D1.1) PUBLISHED BY THE AMERICAN WELDING SOCIETY. ELECTRODES FOR WELDING SHALL COMPLY WITH THE REQUIREMENTS OF TABLE 3.1 OF (AWS D1.1). ALL WELDING TO BE DONE BY QUALIFIED WELDERS CONFORMING TO THE AMERICAN WELDING SOCIETY STANDARDS.

4. SPLICING OF STEEL MEMBERS, UNLESS SHOWN ON THE DRAWINGS, IS PROHIBITED WITHOUT THE WRITTEN APPROVAL OF APEX ENGINEERS, INC. 5. CHANGES IN SIZE OR POSITION OF THE STRUCTURAL FLEMENTS, AND HOLES, SLOTS, CUTS, ETC. THROUGH ANY MEMBER, ARE NOT PERMITTED UNLESS THEY ARE DETAILED ON THE APPROVED SHOP DRAWINGS. 6. NO FINAL BOLTING OR WELDING SHALL BE MADE UNTIL AS MUCH OF THE STRUCTURE AS WILL BE STIFFENED THEREBY HAS BEEN PROPERLY

7. FABRICATE ALL BEAMS WITH THE MILL CAMBER UP UNO. 8. ALL VISIBLE WELDED CONNECTIONS ON ARCHITECTURAL ELEMENTS TO BE GROUND SMOOTH. DO NOT REDUCE THROAT SIZE OF WELD.

9. THE FABRICATOR SHALL BE RESPONSIBLE FOR THE DESIGN AND PERFORMANCE OF ALL CONNECTIONS NOT FULLY DESIGNED OR DETAILED IN THE CONTRACT DOCUMENTS, FABRICATOR TO PROVIDE ENGINEERED STAMPED SHOP DRAWINGS AND CALCULATIONS FOR ALL CONNECTIONS THAT DO NOT COMPLY WITH AISC STEEL CONSTRUCTION MANUAL CHAPTER 10 SIMPLE SHEAR CONNECTIONS.

10. STEEL MEMBERS ON THE EXTERIOR OF THE BUILDING OR EXPOSED TO SOIL MUST BE, AT A MINIMUM, PROPERLY PRIMED WITH RUST INHIBITING PRIMER AND PAINTED. STEEL MEMBERS COMPLETELY ENCLOSED IN BUILDING ENVELOPE DO NOT REQUIRE PRIMER OR PAINT, UNO. REFER TO ARCHITECTURAL DOCUMENTS FOR ADDITIONAL REQUIREMENTS OF EXPOSED STEEL.

1. THESE DRAWINGS ARE INTENDED TO BE USED WITH ARCHITECTURAL AND MECHANICAL DRAWINGS. CONTRACTOR IS RESPONSIBLE FOR COORDINATING SUCH REQUIREMENTS INTO THEIR SHOP DRAWINGS AND

2. NO OPENING SHALL BE MADE IN ANY STRUCTURAL MEMBER WITHOUT THE WRITTEN APPROVAL OF THE ENGINEER.

4. THE CONTRACTOR IS RESPONSIBLE FOR LIMITING THE AMOUNT OF CONSTRUCTION LOAD IMPOSED UPON STRUCTURAL FRAMING. FRAMING AT THE TIME THE LOADS ARE IMPOSED.

5. THE STRUCTURE IS DESIGNED TO FUNCTION AS A UNIT UPON COMPLETION. THE CONTRACTOR IS RESPONSIBLE FOR FURNISHING ALL TEMPORARY BRACING AND/OR SUPPORT THAT MAY BE REQUIRED AS THE RESULT OF THE CONTRACTOR'S CONSTRUCTION METHODS AND/OR SEQUENCES.

FOR STRUCTURAL MEMBERS ARE NOT SHOWN ON STRUCTURAL DRAWINGS. REFERENCE ARCHITECTURAL DRAWINGS AND SPECIFICATIONS FOR FIRE RATING REQUIREMENTS, FIRE PROOFING METHODS AND MATERIALS.

BE DEFICIENCIES, OMISSIONS, CONTRADICTIONS, BE BROUGHT TO THE ATTENTION OF THE ARCHITECT/ENGINEER. PLANS AND/OR SPECIFICATIONS WILL BE CORRECTED, OR WRITTEN INTERPRETATION OF THE ALLEGED DEFICIENCY, OMISSION, CONTRADICTION OR AMBIGUITY WILL BE MADE BY THE ARCHITECT/ENGINEER BEFORE THE AFFECTED WORK

9. ALL THINGS WHICH, IN THE OPINION OF THE CONTRACTOR, APPEAR TO

10. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL ERRORS OF DETAILING, FABRICATION AND INSTALLATION, THE CONTRACTOR SHALL MAKE ALL MEASUREMENTS IN THE FIELD NECESSARY TO VERIFY OR SUPPLEMENT DIMENSIONS SHOWN ON THE CONTRACT DRAWINGS AND HE SHALL VERIFY THAT ALL DIMENSIONS SHOWN ON THE SHOP DRAWINGS ARE COORDINATED WITH THE DIMENSIONS AND REQUIREMENTS OF THE CONTRACT DRAWINGS. REVIEW OF THE SHOP DRAWINGS DOES NOT RELIEVE THE CONTRACTOR OF RESPONSIBILITY FOR COMPLETING THE WORK SUCCESSFULLY IN ACCORDANCE WITH THE CONTRACT DRAWINGS AND SPECIFICATIONS.

11. SUBMIT PRINTS OR ELECTRONIC COPIES OF EACH SHOP DRAWINGS. REPRODUCIBLE COPIES OF CONTRACT DOCUMENTS SHALL NOT BE USED AS SHOP DRAWINGS. SHOP DRAWINGS SHALL BE REVIEWED BY CONTRACTOR PRIOR TO SUBMISSION. CONTRACTOR STAMP SHOP DRAWINGS ACCEPTING RESPONSIBILITY FOR COORDINATION OF DIMENSIONS SHOWN IN THE CONTRACT DOCUMENTS, QUANTITIES AND COORDINATION WITH OTHER TRADES. DRAWINGS NOT BEARING CONTRACTOR'S STAMP MAY BE REJECTED AT THE DISCRETION OF THE ARCHITECT OR STRUCTURAL ENGINEER.

12. REVIEW AND RETURN OF SHOP DRAWINGS SHALL BE BASED ON A MINIMUM OF TEN (10) WORKING DAYS IN THE STRUCTURAL ENGINEER'S OFFICE FROM RECEIPT OF SUBMISSION TO RETURN TO THE NEXT PARTY FOR THEIR ACTION. SHOP DRAWINGS SHOULD BE SUBMITTED INCREMENTALLY AS APPROPRIATE PACKAGES ARE PREPARED TO EQUALIZE THE WORKLOAD FOR REVIEW OF THE DRAWINGS. SUBMISSION OF A LARGE VOLUME OF SHOP DRAWINGS AT ONE TIME MAY RESULT IN REVIEW TIMES WHICH WILL EXCEED THOSE NOTED ABOVE. DEFINITION OF A "LARGE VOLUME" OF SHOP DRAWINGS IS SUBJECT TO INTERPRETATION.

## **NOTES - DEFERRED SUBMITTALS**

1. THE ARCHITECT OR ENGINEER OF RECORD SHALL LIST THE DEFERRED SUBMITTALS ON THE PLANS FOR REVIEW BY THE BUILDING OFFICIAL. 2. DOCUMENTS FOR DEFERRED SUBMITTAL ITEMS SHALL BE SUBMITTED TO THE ARCHITECT OR ENGINEER OF RECORD WHO SHALL REVIEW THEM AND FORWARD THEM TO THE BUILDING OFFICIAL WITH A NOTATION INDICATING THAT THE DEFERRED SUBMITTAL DOCUMENTS HAVE BEEN REVIEWED AND FOUND TO BE IN THE GENERAL CONFORMANCE TO THE DESIGN OF THE

3. THE DEFERRED SUBMITTAL ITEMS SHALL NOT BE INSTALLED UNTIL THE DEFERRED SUBMITTAL DOCUMENTS HAVE BEEN APPROVED BY THE BUILDING OFFICIAL.

4. DEFERRED SUBMITTALS ARE DEFINED AS THOSE PORTIONS OF THE DESIGN THAT ARE NOT SUBMITTED AT THE TIME OF THE APPLICATION AND THAT ARE TO BE SUBMITTED TO THE BUILDING OFFICIAL WITHIN A

OF THE BUILDING OFFICIAL. 6. SUBMITTALS SHALL INCLUDE DETAILED DRAWINGS OF EACH MEMBER

AND ITS CONNECTIONS ALONG WITH SUPPORTING CALCULATIONS OF A LICENSED PROFESSIONAL ENGINEER IN THE PROJECT JURISDICTION. 7. CONTRACTOR SHALL SUBMIT STRUCTURAL DEFERRED SUBMITTAL FOR THE FOLLOWING:

STEEL GUARDRAILS AND HANDRAILS

ADDITION TO ITEMS REQUIRED BY ARCHITECTURAL SPECIFICATIONS. SHOP DRAWING REVIEW IS INTENDED FOR VERIFICATION OF DESIGN CONCEPT CONVEYANCE AND GENERAL CONFORMANCE TO CONTRACT DOCUMENTS ONLY.

DOCUMENTS SHALL BE CLOUDED BY MANUFACTURER/FABRICATOR. ANY OF THE AFOREMENTIONED WHICH ARE NOT CLOUDED OR FLAGGED BY SUBMITTING PARTIES SHALL NOT BE CONSIDERED APPROVED AFTER ENGINEER'S REVIEW. UNO.

3. SHOP DRAWINGS DO NOT REPLACE THE CONTRACT DOCUMENTS.

4. THE ADEQUACY OF ENGINEERING DESIGNS AND LAYOUT PERFORMED BY OTHERS RESTS WITH THE DESIGNING OR SUBMITTING AUTHORITY. DESIGNED SHOP DRAWINGS SHALL BE PREPARED UNDER THE SUPERVISION OF A LICENSED PROFESSIONAL ENGINEER.

NOT PERMITTED AND MAY RESULT IN REJECTION. 6. THE ENGINEER HAS THE RIGHT TO APPROVE OR DISAPPROVE ANY

CHANGES TO CONTRACT DOCUMENTS AT ANY TIME BEFORE OR AFTER SHOP DRAWING REVIEW. 7. CONTRACTOR SHALL SUBMIT STRUCTURAL SHOP DRAWINGS FOR THE FOLLOWING:

• CONCRETE MIX DESIGN, MATERIALS, AND TEST REPORTS • CONCRETE REINFORCING STEEL, HARDWARE, AND FASTENERS

## **NOTES - GENERAL**

3. NO CHANGE IN SIZE OR DIMENSION OF STRUCTURAL MEMBERS SHALL BE

MADE WITHOUT THE WRITTEN APPROVAL OF THE ENGINEER. CONSTRUCTION LOADS SHALL NOT EXCEED THE DESIGN CAPACITY OF THE

6. UNLESS OTHERWISE NOTED. FIREPROOFING METHODS AND MATERIALS

7. DO NOT SCALE THESE DRAWINGS. USE DIMENSIONS SHOWN ON PLANS. 8. THE CONTRACTOR SHALL INFORM THE ARCHITECT/ENGINEER OF ANY DEVIATION FROM THE CONTRACT DOCUMENTS. THE CONTRACTOR SHALL NOT BE RELIEVED OF THE RESPONSIBILITY FOR SUCH DEVIATION BY THE ARCHITECT/ENGINEER'S APPROVAL OF SHOP DRAWINGS, PRODUCT DATA, ETC., UNLESS HE HAS SPECIFICALLY INFORMED THE ARCHITECT/ENGINEER OF SUCH DEVIATION AT THE TIME OF SUBMISSION, AND THE ARCHITECT/ ENGINEER HAS GIVEN WRITTEN APPROVAL TO THE SPECIFIC DEVIATION.

5. DEFERRAL OF ANY SUBMITTAL ITEMS SHALL HAVE THE PRIOR APPROVAL

PREPARED UNDER THE SUPERVISION, BEARING THE SEAL AND SIGNATURE.

• STEEL FABRICATED STAIRS AND LADDERS

• PRE-MANUFACTURED CANOPIES AND AWNINGS

## **NOTES - SHOP DRAWING SUBMITTALS**

1. SHOP DRAWINGS SHALL BE SUBMITTED FOR ALL STRUCTURAL ITEMS IN

2. CHANGES, SUBSTITUTIONS, OR DEVIATIONS FROM CONTRACT


ITEMS SHOWN INCORRECTLY OR OMITTED AND NOT FLAGGED BY THE ENGINEER DURING REVIEW ARE NOT TO BE CONSIDERED CHANGES TO THE CONTRACT DOCUMENTS.

5. SHOP DRAWINGS MUST BE ORIGINAL DOCUMENTS. REPRODUCTION OF ANY PORTION OF THE CONTRACT DOCUMENTS FOR USE IN SUBMITTALS IS

• PRE-ENGINEERED METAL BUILDING

# SYMBOLS / ARREVIATIONS

	2 I MBO	L9 / AE	BR	LV	IATION5		
S	YMBOL/TAG	DESCR	IPTION		APPLIES TO		
	X SX.X	DETAIL O			DETAILS, SECTIONS, & ELEVATIONS	DESIGN IN	FC
	. = XXX' - XX" . = XXX' - XX"	ELEVATION			FOUNDATION WALLS AND LEDGES (SIM)	BUILDING CODE:	
	T.O.X. XXX' - XX"	ELEVATION	`		LEVELS, SPOT ELEVATIONS, & PLAN ELEVATIONS	SOILS INFORMATION:	
T.O.	S. = XXX' - XX"	TOP OF	STEEL ATION	-	PLAN VIEW NOTATION	ALLOWABLE FINESOMF TIVE LOAD-B	EARI
JST B	RG = XXX' - XX"	JOIST B ELEV	EARING ATION	}	PLAN VIEW NOTATION	TREGOMMENDED THAT A GOALINED	GEC
	X	REVISIO	N MARI	<	SHEET REVISIONS	RETAINED TO VERIFY THESE ASSUM USE OF THIS FOUNDATION DESIGN VERIFICATION, APEX WILL NOT BE L	WITH
ABV	DEFINITION		ABV	DEF	INITION	AND THE OWNER SHALL ACCEPT AL	
AB	ANCHOR BOLT		SIM	SIM	ILAR CONDITION	THE STRUCTURE AS A RESULT OF E	
CJ	CONTRACTION J	OINT	STD	STA	NDARD	AND/OR DIFFERENTIAL MOVEMENT	
CL	CENTERLINE		TOC	TOF	OF CONCRETE	CONDITIONS BETWEEN EXISTING AI	ND N
DIA	DIAMETER		TOD	TOF	OF DECK	FROST DEPTH	
EOD	EDGE OF DECK	ANGLE	TOL	TOF	OF LEDGE	PRESUMPTIVE LOAD-BEARING PRES	SSUF
EOS	EDGE OF SLAB		TOM	TOF	OF MASONRY		
EXT	EXTERIOR		TOS	TOF	OF STEEL	MATERIAL CE	<b>\</b>
GA	GAUGE		TOW	TOF	OF WALL	$\exists \mid MATERIAL$ SF	<b>'</b> E(
HAS	HEADED ANCHO	R STUDS	TYP	TYF	PICAL CONDITION	STEEL MATERIA	AL SF
ОС	ON CENTER		UNO		LESS NOTED OTHERWIS	STEEL MEMBERS	<del></del>
PAF	POWDER ACTUA	TED FASTNR	WP	WO	RK POINT	WIDE FLANGE SHAPES (W)	+
BASE	PLATE TAG					CHANNELS (C), ANGLES (L)	+
		,				PLATES	+
BASE F	PLATE CALLOUT —	- ARIV	(T			HOLLOW STRUCTURAL SHAPES (HSS)	

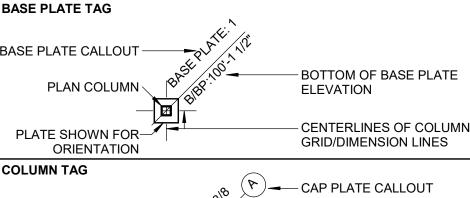

COLUMN SIZE -

PLAN COLUMN \



2000 psf

**DESIGN INFORMATION BUILDING CODE:** 2018 INTERNATIONAL BUILDING CODE AS ADOPTED AND/OR AMENDED BY LOCAL BUILDING CODES **SOILS INFORMATION:** THE FOUNDATION DESIGN PROVIDED IS BASED OFF OF A MINIMUM ALLOWABLE PRESUMPTIVE LOAD-BEARING VALUE AS INDICATED BY IBC TABLE 1806.2 IN LIEU OF A SITE BASE GEOTECHNICAL EVALUATION. IT IS RECOMMENDED THAT A QUALIFIED GEOTECHNICAL ENGINEER BE RETAINED TO VERIFY THESE ASSUMPTIONS PRIOR TO CONSTRUCTION. BY USE OF THIS FOUNDATION DESIGN WITHOUT PROVIDING SUCH VERIFICATION, APEX WILL NOT BE LIABLE FOR THIS DESIGN PARAMETER,  $\mathsf{I}$  AND THE OWNER SHALL ACCEPT ALL RISKS ASSOCIATED WITH DAMAGE  $\mathsf{T}$ THE STRUCTURE AS A RESULT OF EXPANSIVE, COMPRESSIBLE, SHIFTING AND/OR DIFFERENTIAL MOVEMENT AS A RESULT OF DIFFERING SUBGRADE CONDITIONS BETWEEN EXISTING AND NEW FOUNDATION ELEMENTS.

<b>MATERIAL SPECIFICATIONS</b>										
STEEL MATERIAL SPECIFICATIONS										
STEEL MEMBERS	MATERIAL									
WIDE FLANGE SHAPES (W)	ASTM A992									
CHANNELS (C), ANGLES (L)	ASTM A36									
PLATES	ASTM A36									
HOLLOW STRUCTURAL SHAPES (HSS)	ASTM A500, GRADE C									
HIGH STRENGTH BOLTS	ASTM F3125, GRADE A325									
ANCHOR BOLTS (HEX-HEAD UNO)	ASTM F1554 (55 ksi) "S1"									
EPOXY ANCHOR RODS	ASTM A36									
STEEL DECK, PLAIN STEEL	ASTM A1008, (33 ksi)									
STEEL DECK, GALVANIZED	ASTM A653, (33 ksi)									
NON-SHRINK GROUT, COL. BASES	5000 psi (28 DAY STRENGTH)									
CONCRETE & REINFORCIN	IG STEEL SPECIFICATIONS									
MATERIAL	SPECIFICATION									
REINFORCING BARS	ASTM A615, GRADE 60									
MEI DED DERAD	ASTM A706									

		0000 po: (=0 =) :: 0 :: 1 = :: 1)
	CONCRETE & REINFORCIN	IG STEEL SPECIFICATIONS
- CAP PLATE CALLOUT	MATERIAL	SPECIFICATION
	REINFORCING BARS	ASTM A615, GRADE 60
	WELDED REBAR	ASTM A706
- CONNECTION DETAIL	WELDED WIRE FABRIC	ASTM A1064
	PORTLAND CEMENT	ASTM C 150
	FLY ASH	ASTM C 618, 15% MAX
CENTERLINES OF COLUMN	CONCRETE AGGREGATES	ASTM C 33, 3/4" MAX AGG. SIZE.
GRID/DIMENSION LINES	EPOXY - THREADED ROD ANCHORS	HILTI HIT-HY 200 A OR SIMPSON SET 3G
	EPOXY - REINFORCING BARS	HILTI HIT-HY 200 R OR SIMPSON SET 3G
	REBAR CONDITION	MINIMUM CONCRETE COVER
	FORMED SURFACES EXPOSED TO GROUND OR WEATHER	2"
	UNFORMED SURFACE IN CONTACT WITH THE GROUND	3"
	WALLS AND SLABS NOT EXPOSED TO GROUND OR WEATHER	1"
	INTERIOR BEAMS AND COLUMNS (TO TIES OR STIRRUPS)	1 1/2"
	CONCRETE MIX DES	IGN REQUIREMENTS
		MAX

CON	CONCRETE MIX DESIGN REQUIREMENTS									
CONCRETE USE	WEIGHT	28 DAY f'c	CEMENT TYPE	MAX W/C RATIO	SLUMP (+/- 1")	% AIR				
FOOTINGS/PIERS	NW	3500 psi	1/11	0.55	5"	6% MAX				
FOUNDATION WALLS	NW	3500 psi	1/11	0.50	4"	6% +/- 19				
INT. SLAB-ON-GRADE	NW	4000 psi	1/11	0.45	5"	3% MAX				
ELEVATED SLABS	NW	5000 psi	1/11	0.45	5"	1.5% +/-				
TILT-UP WALLS	NW	4000 psi	I/II	0.45	4"	5% +/- 1.5				
С	CONCRETE SLAB SPECIFICATIONS									
FLOOR FLATNESS, FF			;	SOV: 35	MLV: 2	:5				
FLOOR LEVELNESS, F	L		,	SOV: 24	MLV: 1	7				

SHEET LIST - STRUCTURAL							
SHEET NUMBER	SHEET NAME						
S100	GENERAL NOTES AND SPECIFICATIONS						
S110	SPECIAL INSPECTIONS						
S200	FOUNDATION PLAN						
S500	TYPICAL FOUNDATION DETAILS						
\$501	TYPICAL FOLINDATION DETAILS						

4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 fax: 913.451.9391 www.davidsonae.com



KANSAS CITY, MO 64108 816.421.3222

www.apex-engineers.com

Issue Date drawn by checked by



drawing type Project Status project number Project Number

			<i>,</i>	- 60			REI	DAK		
				OPMENT						
	f'c	= 3000 F	PSI			f'c	= 4000 F	PSI		
BAR	STE	). L _d	CLA	SS B	BAR	STI	D. L _d	CLA	CLASS B	
SIZE	TYP.	TOP	TYP.	TOP	SIZE	TYP.	TOP	TYP.	TOP	
#3	17"	22"	22"	28"	#3	15"	19"	19"	25"	
#4	22"	29"	29"	38"	#4	19"	25"	25"	33"	
#5	28"	36"	37"	47"	#5	24"	31"	32"	41"	
#6	33"	43"	43"	56"	#6	29"	37"	38"	49"	
#7	48"	63"	63"	82"	#7	42"	54"	55"	71"	
#8	55"	72"	72"	94"	#8	48"	62"	63"	81"	
#9	62"	81"	81"	106"	#9	54"	70"	71"	91"	
				RD HOO	KS & BA					
	f'c	= 3000 F				f'c	= 4000 F			
BAR	L _{dh}	"ø"	L,	ext	BAR	L _{dh}	"ø"		ext	
SIZE			180	90	SIZE		_ ~	180	90	
#3	6"	2 1/4"	2 1/2"	4 1/2"	#3	6"	2 1/4"	2 1/2"	4 1/2	
#4	8"	3"	2 1/2"	6"	#4	7"	3"	2 1/2"	6"	
#5	10"	3 3/4"	2 1/2"	7 1/2"	#5	9"	3 3/4"	2 1/2"	7 1/2	
#6	12"	4 1/2"	3"	9"	#6	10"	4 1/2"	3"	9"	
#7	14"	5 1/4"	3 1/2"	10 1/2"	#7	12"	5 1/4"	3 1/2"	10 1/2	
#8	16"	6"	4"	12"	#8	14"	6"	4"	12"	
#9	18"	9"	4 1/2"	13 1/2"	#9	15"	9"	4 1/2"	13 1/2	
	BAR BE	_		30 DEGR				GREE H	-	
<u></u>	DAK DE	IND3	10	DEGK	EE HOU	JK	90 DE	GREE	IOOK	
∟ D _b		<del>+</del>	CRITICAL		L _{ext}		SECTION	D _b +	Le	
			STIDE	RUPS, TI		OOPS		Ldh		
BAR			Lext	(Ur U, 11	ES, & ⊓ BAR			Lext		
SIZE	Ø	00		100	SIZE	Ø	00		400	
	1 1/2"	<b>90</b> 3"	<b>135</b> 3"	180		4 4/0"	<b>90</b> 9"	135	1 <b>80</b> 3"	
#3	2"	3"	3"	2 1/2"	#6	4 1/2"	-	4 1/2"	<b>+</b>	
#4				2 1/2"	#7 #0	5 1/4"	10 1/2"	5 1/4"	3 1/2	
#5	2 1/2"	3 3/4"	3 3/4"	2 1/2"	#8	6"	12"	6"	4"	
<u> </u>	DEGREE	HOOK	13	B5 DEGR	EE HOC	)K	180 DE	GREE I	100K	
		ï	8	<u> </u>	<u></u>	8	I		<del></del>	
4	<u> </u>	<u> </u>	.	A	<u> </u>	"	A		( <del>V</del> )-	
	D _b -	<i>&gt;</i>		$\Gamma$ D	**/		└ D _b		¥V	
	l	Lext ▼		/	//, <i>&gt;</i>			L _{ext} _	<u>-</u>	
		<u> </u>		V	C. T.			Lexi		
	ECTANO M/COL	GULAR UMN TIE	: (	CIRC	ULAR	IE C	BAR LEARAN		BAR PLICE	
	- III/ OOL	1	-				LLAIVAI	0.	P P	
	- D _b	Ø Company of the Comp		STD			(3) (4)			
-(6)					- D₀ //			'		
-6	_								\-	

SCHEDULE - PAD FOOTING									
MARK	LENGTH	WIDTH	DEPTH	REINFORCING					
F4.5	4' - 6"	4' - 6"	3' - 0"	(12) #5 EACH WAY [(6) AT T&B]					
F5	5' - 0"	5' - 0"	3' - 0"	(14) #5 EACH WAY [(7) AT T&B]					
F6.5	6' - 6"	6' - 6"	3' - 0"	(18) #5 EACH WAY [(9) AT T&B]					
F7.5	7' - 6"	7' - 6"	4' - 0"	(26) #5 EACH WAY [(13) AT T&B]					

1. USE THE ABOVE TABLE UNLESS NOTED OTHERSIZE ON PLAN OR IN

3. PROVIDE 1 D_b (1" MINIMUM) CLEARANCE BETWEEN ADJACENT BARS.

5. DO NOT PROVIDE CLASS A SPLICE UNLESS SPECIFICALLY DETAILED.

2. PROVIDE 6" LAP AT ALL WELDED WIRE FABRIC JOINTS.

4. PROVIDE WIRE TIES AT EACH END OF BAR SPLICE.

SC	SCHEDULE - CONTINUOUS FOOTING										
MARK	WIDTH	DEPTH	LONG BARS	TRANS BARS							
CF16	1' - 4"	36"	(4) #4 CONT [(2) AT T&B]	#3 TIES AT 18" OC							
CF27	2' - 3"	36"	(4) #4 CONT [(2) AT T&B]	#3 TIES AT 18" OC							

SCHEDULE - SLAB ON GRADE					
MARK	SLAB THICKNESS	WEIGHT CLASS	SLAB REINFORCING	ADDITIONAL REQUIREMENTS	
SG4	4"	NW	#3 AT 18"OC EA WAY OR 6X6 W2.9XW2.9 WWF	10 MIL. VAPOR BARRIER ON 4" OF 3/4" CLEAN, GRADED	

SDI TABLE 1.1		
INSPECTION OR EXECUTION TASKS PRIOR TO DECK PLACEMENT:		
TASK	QC	QA
A. VERIFY COMPLIANCE OF MATERIALS (DECK AND ALL DECK ACCESSORIES) WITH CONSTRUCTION DOCUMENTS, INCLUDING PROFILES, MATERIAL PROPERTIES, AND BASE METAL THICKNESS.	Р	Р
B. DOCUMENT ACCEPTANCE OR REJECTION OF DECK AND DECK ACCESSORIES.	Р	Р

SDI TABLE 1.2		
INSPECTION OR EXECUTION TASKS AFTER DECK PLACEMENT		
TASK	QC	QA
A. VERIFY COMPLIANCE OF DECK AND ALL DECK ACCESSORIES INSTALLATION WITH CONSTRUCTION DOCUMENTS.	Р	Р
B. VERIFY DECK MATERIALS ARE REPRESENTED BY THE MILL CERTIFICATIONS THAT COMPLY WITH THE CONSTRUCTION DOCUMENTS.	N/A	Р
C. DOCUMENT ACCEPTANCE OR REJECTION OF INSTALLATION OF DECK AND DECK ACCESSORIES.	Р	Р

SDI TABLE 1.3		
INSPECTION OR EXECUTION TASKS PRIOR TO WELDING		
TASK	QC	QA
A. WELDING PROCEDURE SPECIFICATIONS (WPS) AVAILABLE.	0	0
B. MANUFACTURER CERTIFICATIONS FOR WELDING CONSUMABLES AVAILABLE.	0	0
C. MATERIAL IDENTIFICATION (TYPE/GRADE)	0	0
D. CHECK WELDING EQUIPMENT.	0	0
CDI TADI E 4.4		

INSPECTION OR EXECUTION TASKS DURING WELDING		
TASK	QC	QA
A. USE OF QUALIFIED WELDERS.	0	0
B. CONTROL AND HANDLING OF WELDING CONSUMABLES.	0	0
C. ENVIRONMENTAL CONDITIONS (WIND SPEED, MOISTURE, TEMPERATURE)	0	0
D. WPS FOLLOWED	0	0

SDI TABLE 1.5		
INSPECTION OR EXECUTION TASKS AFTER WELDING		
TASK	QC	QA
A. VERIFY SIZE AND LOCATION OF WELDS, INCLUDING SUPPORT, SIDELAP, AND PERIMETER WELDS.	Р	Р
B. WELDS MEET VISUAL ACCEPTANCE CRITERIA.	Р	Р
C. VERIFY REPAIR ACTIVITIES.	Р	Р
D. DOCUMENT ACCEPTANCE OR REJECTION OF WELDS.	Р	Р

SDI TABLE 1.6		
INSPECTION OR EXECUTION TASKS PRIOR TO MECHANICAL FASTENING		
TASK	QC	QA
A. MANUFACTURER INSTALLATION INSTRUCTIONS AVAILABLE FOR MECHANICAL FASTENERS.	0	0
B. PROPER TOOLS AVAILABLE FOR FASTENER INSTALLATION.	0	0
C.PROPER STORAGE FOR MECHANICAL FASTENERS.	0	0

	SDI TABLE 1.7		
	INSPECTION OR EXECUTION TASKS DURING MECHANICAL FASTENING		
	TASK	QC	QA
	A. FASTENERS ARE POSITIONED AS REQUIRED.	0	0
	B. FASTENERS ARE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.	0	0

SDI TABLE 1.8		
INSPECTION OR EXECUTION TASKS AFTER MECHANICAL FASTENING		
TASK	QC	QA
A. CHECK SPACING, TYPE, AND INSTALLATION OF SUPPORT FASTENERS.	Р	Р
B. CHECK SPACING, TYPE, AND INSTALLATION OF SIDELAP FASTENERS.	Р	Р
C. CHECK SPACING, TYPE, AND INSTALLATION OF PERIMETER FASTENERS.	Р	Р
D. VERIFY REPAIR ACTIVITIES.	Р	Р
E. DOCUMENT ACCEPTANCES OR REJECTION OF MECHANICAL FASTENERS.	Р	Р

	AISC TABLE N5.4-1		
	INSPECTION TASKS PRIOR TO WELDING	QC	Q,
	1. WELDING PROCEDURE SPECIFICATIONS (WPSs) AVAILABLE	Р	F
	2. MANUFACTURER CERTIFICATIONS FOR WELDING CONSUMABLES AVAILABLE	Р	F
	3. MATERIAL IDENTIFICATION (TYPE/GRADE)	0	С
	4. WELDER IDENTIFICATION SYSTEM ¹	0	С
	<ul> <li>5. FIT-UP OF GROOVE WELDS (INCLUDING JOINT GEOMETRY)</li> <li>JOINT PREPARATION</li> <li>DIMENSIONS (ALIGNMENT, ROOT OPENING, ROOT FACE, BEVEL)</li> <li>CLEANLINESS (CONDITION OF STEEL SURFACES)</li> <li>TACKING (TACK WELD QUALITY AND LOCATION)</li> </ul>	0	С

BACKING TYPE AND FIT (IF APPLICABLE)
 CONFIGURATION AND FINISH OF ACCESS HOLES

DIMENSIONS (ALIGNMENT, GAPS AT ROOT)
CLEANLINESS (CONDITION OF STEEL SURFACES)
TACKING (TACK WELD QUALITY AND LOCATION)

7. FIT-UP OF FILLET WELDS

8. CHECK WELDING EQUIPMENT O 
1 THE FABRICATOR OR ERECTOR, AS APPLICABLE, SHALL MAINTAIN A
SYSTEM BY WHICH A WELDER WHO HAS WELDED A JOINT OR MEMBER
CAN BE IDENTIFIED. STAMPS, IF USED, SHALL BE THE LOW-STRESS TYPE

INSPECTION TASKS DURING WELDING	QC	Q/
1. USE OF QUALIFIED WELDERS	0	0
<ul><li>2. CONTROL AND HANDLING OF WELDING CONSUMABLES</li><li>PACKAGING</li><li>EXPOSURE CONTROL</li></ul>	0	C
3. NO WELDING OVER CRACKED TACK WELDS	0	C
<ul><li>4. ENVIRONMENTAL CONDITIONS</li><li>WIND SPEED WITHIN LIMITS</li><li>PRECIPITATION AND TEMPERATURE</li></ul>	0	C
5. WPS FOLLOWED  SETTINGS ON WELDING EQUIPMENT  TRAVEL SPEED  SELECTED WELDING MATERIALS  SHIELDING GAS TYPE/FLOW RATE  PREHEAT APPLIED  INTERPASS TEMPERATURE MAINTAINED (MIN./MAX.)  PROPER POSITION (F, V, H, OH)	0	C
6. WELDING TECHNIQUES  INTERPASS AND FINAL CLEANING  EACH PASS WITHIN PROFILE LIMITATIONS  EACH PASS MEETS QUALITY REQUIREMENTS	0	С

INSPECTION TASKS AFTER WELDING	QC	QA
1. WELDS CLEANED	0	0
2. SIZE, LENGTH AND LOCATION OF WELDS	Р	Р
3. WELDS MEET VISUAL ACCEPTANCE CRITERIA CRACK PROHIBITION WELD/BASE-METAL FUSION CRATER CROSS SECTION WELD PROFILES WELD SIZE UNDERCUT POROSITY	P	Р
4. ARC STRIKES	Р	Р
5. K-AREA ¹	Р	Р
6. BACKING REMOVED AND WELD TABS REMOVED (IF REQUIRED)	Р	Р
7. REPAIR ACTIVITIES	Р	Р
8. DOCUMENT ACCEPTANCE OR REJECTION OF WELDED JOINT OR MEMBER	Р	Р

AISC TABLE N5.6-1			
INSPECTION TASKS PRIOR TO BOLTING	QC	QA	
1. MANUFACTURER'S CERTIFICATIONS AVAILABLE FOR FASTENER MATERIALS	0	Р	
2. FASTENERS MARKED IN ACCORDANCE WITH ASTM REQUIREMENTS	0	0	
3. PROPER FASTENERS SELECTED FOR THE JOINT DETAIL (GRADE, TYPE, BOLT LENGTH IF THREADS ARE TO BE EXCLUDED FROM SHEAR PLANE)	0	0	
4. PROPER BOLTING PROCEDURE SELECTED FOR JOINT DETAIL	0	0	
5. CONNECTING ELEMENTS, INCLUDING THE APPROPRIATE FAYING SURFACE CONDITION AND HOLE PREPARATION, IF SPECIFIED, MEET APPLICABLE REQUIREMENTS	0	0	
6. PRE-INSTALLATION VERIFICATION TESTING BY INSTALLATION PERSONNEL OBSERVED AND DOCUMENTED FOR FASTENER ASSEMBLIES AND METHODS USED	Р	0	
7. PROPER STORAGE PROVIDED FOR BOLTS, NUTS, WASHERS AND OTHER FASTENER COMPONENTS	0	0	

AISC TABLE N5.6-2			
INSPECTION TASKS DURING BOLTING	QC	QA	
. FASTENER ASSEMBLIES, OF SUITABLE CONDITION, PLACED IN ALL HOLES AND WASHERS (IF REQUIRED) ARE POSITIONED AS REQUIRED	0	0	
. JOINT BROUGHT TO THE SNUG-TIGHT CONDITION PRIOR TO THE PRETENSIONING OPERATION	0	0	
FASTENER COMPONENT NOT TURNED BY THE WRENCH PREVENTED FROM ROTATING	0	0	
ASTENERS ARE PRETENSIONED IN ACCORDANCE WITH THE RCSC SPECIFICATION, PROGRESSING SYSTEMATICALLY FROM THE MOST RIGID POINT TOWARD THE FREE EDGES	0	0	

QC	QA
Р	Р

AISC TABLE N6.1			
INSPECTION OF STEEL ELEMENTS OF COMPOSITE CONSTRUCTION PRIOR TO CONCRETE PLACEMENT	QC	QA	
. PLACEMENT AND INSTALLATION OF STEEL DECK	Р	Р	
PLACEMENT AND INSTALLATION OF STEEL HEADED STUD ANCHORS	Р	Р	
B. DOCUMENT ACCEPTANCE OR REJECTION OF STEEL ELEMENTS	Р	Р	



# STATEMENT OF SPECIAL INSPECTION

P	STATE	MENT OF SPECIAL INSP	ECT	101
•	IBC CODE	CONOTRUCTION TYPE	FREQU	JENC
0	REFERENCE	CONSTRUCTION TYPE	CONT.	PE
0	1705.2	STEEL CONSTRUCTION		
	1705.2.1	STRUCTURAL STEEL		
0	ACCORDANCE	PECTION FOR STRUCTURAL STEEL SHALL BE WITH THE QUALITY ASSURANCE INSPECTION S OF AISC 360. ( <b>REFER TO AISC CHARTS ON T</b>		:FT)
	1705.2.2	COLD-FORMED STEEL DECK		
0	1. SPECIAL INSI INSPECTORS F BE IN ACCORD	PECTIONS AND QUALIFIACTIONS OF WELDING OR COLD-FORMED STEEL FLOOR AND ROOF INSPECTION OF THE PROPERTY ASSURANCE INSPECTION.	DECK SH CTION	HALL
	I <b>├</b> ──	S OF SDI QA/QC. <b>(REFER TO SDI CHARTS ON</b> 1		EET)
0		OPEN-WEB STEEL JOIST AND JOIST GIRDERS		
		N OF OPEN-WEB STEEL JOISTS AND JOIST GIF	RDERS:	
	1	ECTIONS - WELDING OR BOLTED		Х
-	·	- HORIZONTAL OR DIAGONAL	1	
R		RD BRIDGING		Х
YPE		G THAT DIFFERS FROM THE SJI FIONS LISTED IN SECTION 2207.1		Х
	1705.3	REINFORCED CONCRETE		
		OF REINFORCING STEEL, INCLUDING G TENDONS, AND PLACEMENT.		X
QA	2. INSPECTION	OF REINFORCING STEEL WELDING:		
0		ION OF WELDABILITY OF REINFORCING R THAN ASTM A 706.		Х
0	B. INSPECT S	INGLE-PASS FILLET WELDS, MAXIMUM 5/16"		Х
O	C. INSPECT A	LL OTHER WELDS	Х	
0	3. INSPECTION	OF ANCHORS CAST IN CONCRETE:		Χ
0		OF ANCHORS POST-INSTALLED IN NCRETE MEMBERS.		
Ŭ		ANCHORS INSTALLED IN HOIZONTALLY OR		
	SUSTAINED T	NCLINED ORIENTATIONS TO RESIST ENSION LOADS.	Х	
0	DEFINED IN 4			Х
0		SE OF REQUIRED MIX DESIGN		Х
		DNCRETE PLACEMENT, FABRICATE		

	B. GROUTING OF BONDED PRESTRESSING TENDONS IN	Х					
	THE SEISMIC-FORCE-RESISTING SYSTEM.	, ,					
	10. ERECTION OF PRECAST CONCRETE MEMBERS.		X				
	11. VERIFICATION OF IN-SITU CONCRETE STRENGTH, PRIOR						
	TO STRESSING OF TENDONS IN POST-TENSIONED		Х				
	CONCRETE AND PRIOR TO REMOVAL OF SHORING.						
	12. INSPECT FORMWORK FOR SHAPE, LOCATION AND		Х				
	DIMENSIONS OF THE CONCRETE MEMBER BEING FORMED.		^				
SPECIAL INSPECTION AGENCY TO PERFORM TESTS AT SEVEN (7) DAYS							
	AND AT TWENTY EIGHT (28) DAYS. A STRENGTH TEST SHALL						
	AVERAGE OF THE STRENGTHS OF AT LEAST TWO (2) 6"x12" CYLINDERS						
	OR AT LEAST THREE (3) 4"x8" CYLINDERS MADE FROM THE SA						
	OF CONCRETE. HOLD ONE ADDITIONAL CYLINDER IN RESERV		_				
	PROJECT IS COMPLETED. TESTING LABORATORY IS TO FURN	IISH					
	ARCHITECT/ENGINEER WITH TEST RESULTS PROMPTLY.						
	FREQUENCY OF TESTING IS TO BE IN ACCORDANCE WITH AC	I 318:					
	A. ONCE EACH DAY A GIVEN CLASS IS PLACED, NOR LESS T	HAN.					
	B. ONCE FOR EACH 150 CUBIC YDS OF EACH CLASS PLACE	D EACH	DAY				
	NOR LESS THAN.						
	C. ONCE FOR EACH 5000 SQFT OR SLAB WALL OR SURFACE	AREA					

SPECIMENS FOR STRENGTH TESTS, PERFOR SLUMP AND AIR CONTENT TESTS, AND DETERMINE THE TEMPERATURE

7. INSPECTION OF CONCRETE AND SHOTCRETE PLACEMENT FOR PROPER APPLICATION TECHNIQUES.

8. VERIFY MAINTENANCE OF SPECIFIED CURING

9. INSPECTION OF PRESTRESSED CONCRETE:
A. APPLICATION OF PRESTRESSING FORCES.

TEMPERATURE AND TECHNIQUES.

OF THE CONCRETE.

	1705.6	SOILS					
	1. VERIFY MATERIALS BELOW SHALLOW FOUNDATIONS ARE ADEQUATE TO ACHIEVE THE DESIGN BEARING CAPACITY.						
	2. VERIFY EXCAVATIONS ARE EXTENDED TO PROPER DEPTH AND HAVE REACHED PROPER MATERIAL.						
QA	3. PERFORM CI	3. PERFORM CLASSIFICATION AND TESTING OF					
Р	COMPACTED F	ILL MATERIALS.					
Г		OF PROPER MATERIALS, DENSITIES AND					
0	_	LIFT THICKNESSES DURING PLACEMENT AND COMPACTION OF COMPACTED FILL.					
0		ACEMENT OF COMPACTED FILL, OBSERVE D VERIFY THAT SITE HAS BEEN PREPARED					
U	PROPERLY.						
	1705.8	CAST-IN-PLACE DEEP FOUNDATIONS					
0		RILLING OPERATIONS AND MAINTAIN	Х				
		D ACCURATE RECORDS FOR EACH ELEMENT.					
0	2. VERIFY PLACEMENT LOCATIONS AND PLUMBNESS,						
		MENT DIAMETERS, BELL DIAMETERS (IF	x				
		ENGTHS, EMBEDMENT INTO BEDROCK (IF	^				
0	APPLICABLE) AND ADEQUATE END-BEARING STRATA CAPACITY. RECORD CONCRETE OR GROUT VOLUMES.						
	1705.11.2	COLD-FORMED STEEL FRAMING					
0	1. MATERIAL VE			_			
	l	SIZE AND THICKNESS TO MATCH CONTRACT					
		INCLUDING TRACKS, STUDS, ASSEMBLIES,					
	CONNECTOR	, , , , , , , , , , , , , , , , , , , ,					
	D EAGTENER	MATERIAL AND COMPONENTO					

	B. FASTENER MATERIAL AND COMPONENTS			
	2. INSPECTION			
	A. INSPECT MEMBER LAYOUT, CONNECTION,			
	ORIENTATION	N .		
	B. SPECIAL INSPECTION REQUIRED FOR FASTENERS PER MANUFACTURER.			
	C. INSPECTION PRIOR TO SHEATHING: VERIFY FLANGES			
	ARE INTACT,	STUDS ARE NOT CUT OR SPLICED.		
	3. INSPECTION OF WELDING.			
	1705.14	SPRAYED FIRE-RESISTANT MATERIALS		
1. STRUCTURAL MEMBER SURFACE CONDITIONS.				
	2. APPLICATION.			
3. THICKNESS.				
	4. DENSITY.			
	5. BOND STREN	IGTH.		

4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390 f a x: 913.451.9391 www.davidsonae.com



ENGINEERS,INC.

1625 LOCUST ST
KANSAS CITY, MO 64108
816.421.3222
www.apex-engineers.com

NE Town Centre S SUMMIT, MO

date ssue Date drawn by JMB checked by



sheet number

S110

drawing type

Project Status

project number



ENGINEERS, INC.

1625 LOCUST ST KANSAS CITY, MO 64108 816.421.3222 www.apex-engineers.com

Issue Date drawn by checked by BDC

revisions

(12) #5 EACH WAY [(6) AT T&B] (14) #5 EACH WAY [(7) AT T&B]

(18) #5 EACH WAY [(9) AT T&B]

TRANS BARS

(26) #5 EACH WAY [(13) AT T&B]


LONG BARS


W2.9XW2.9 WWF


COMMENT

OF 3/4" CLEAN, GRADED ROCK.

drawing type Project Status project number

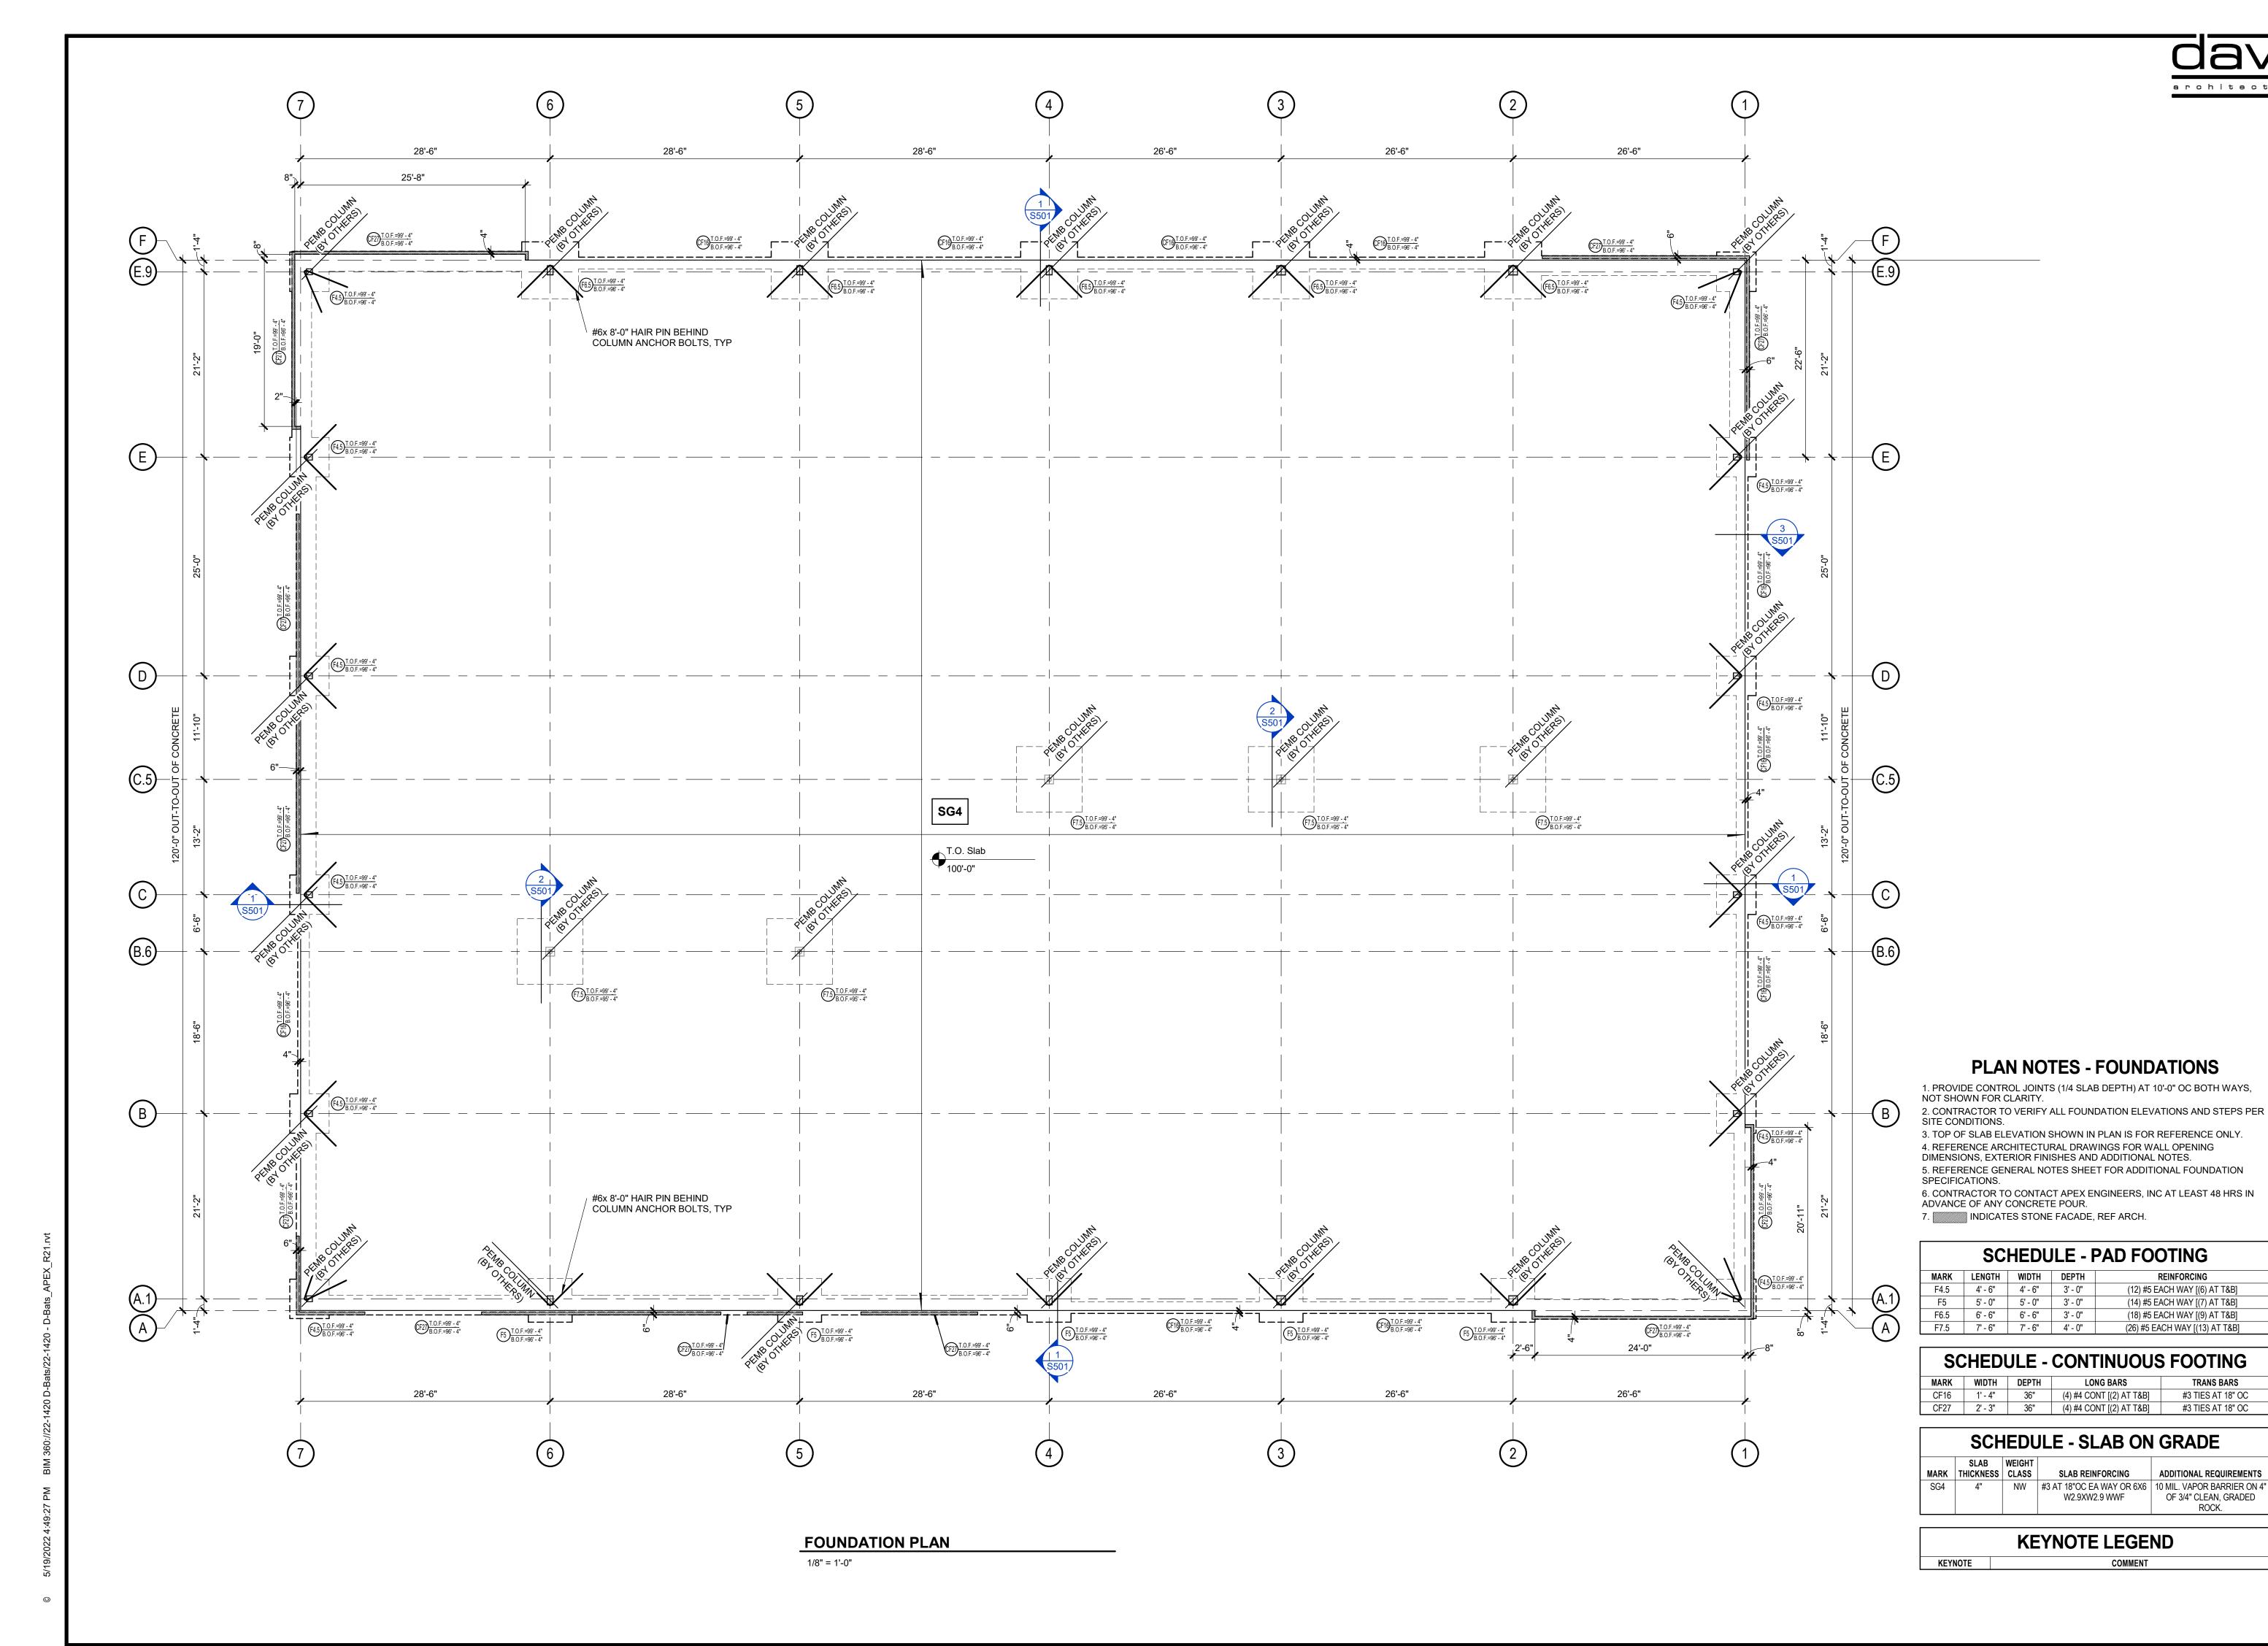

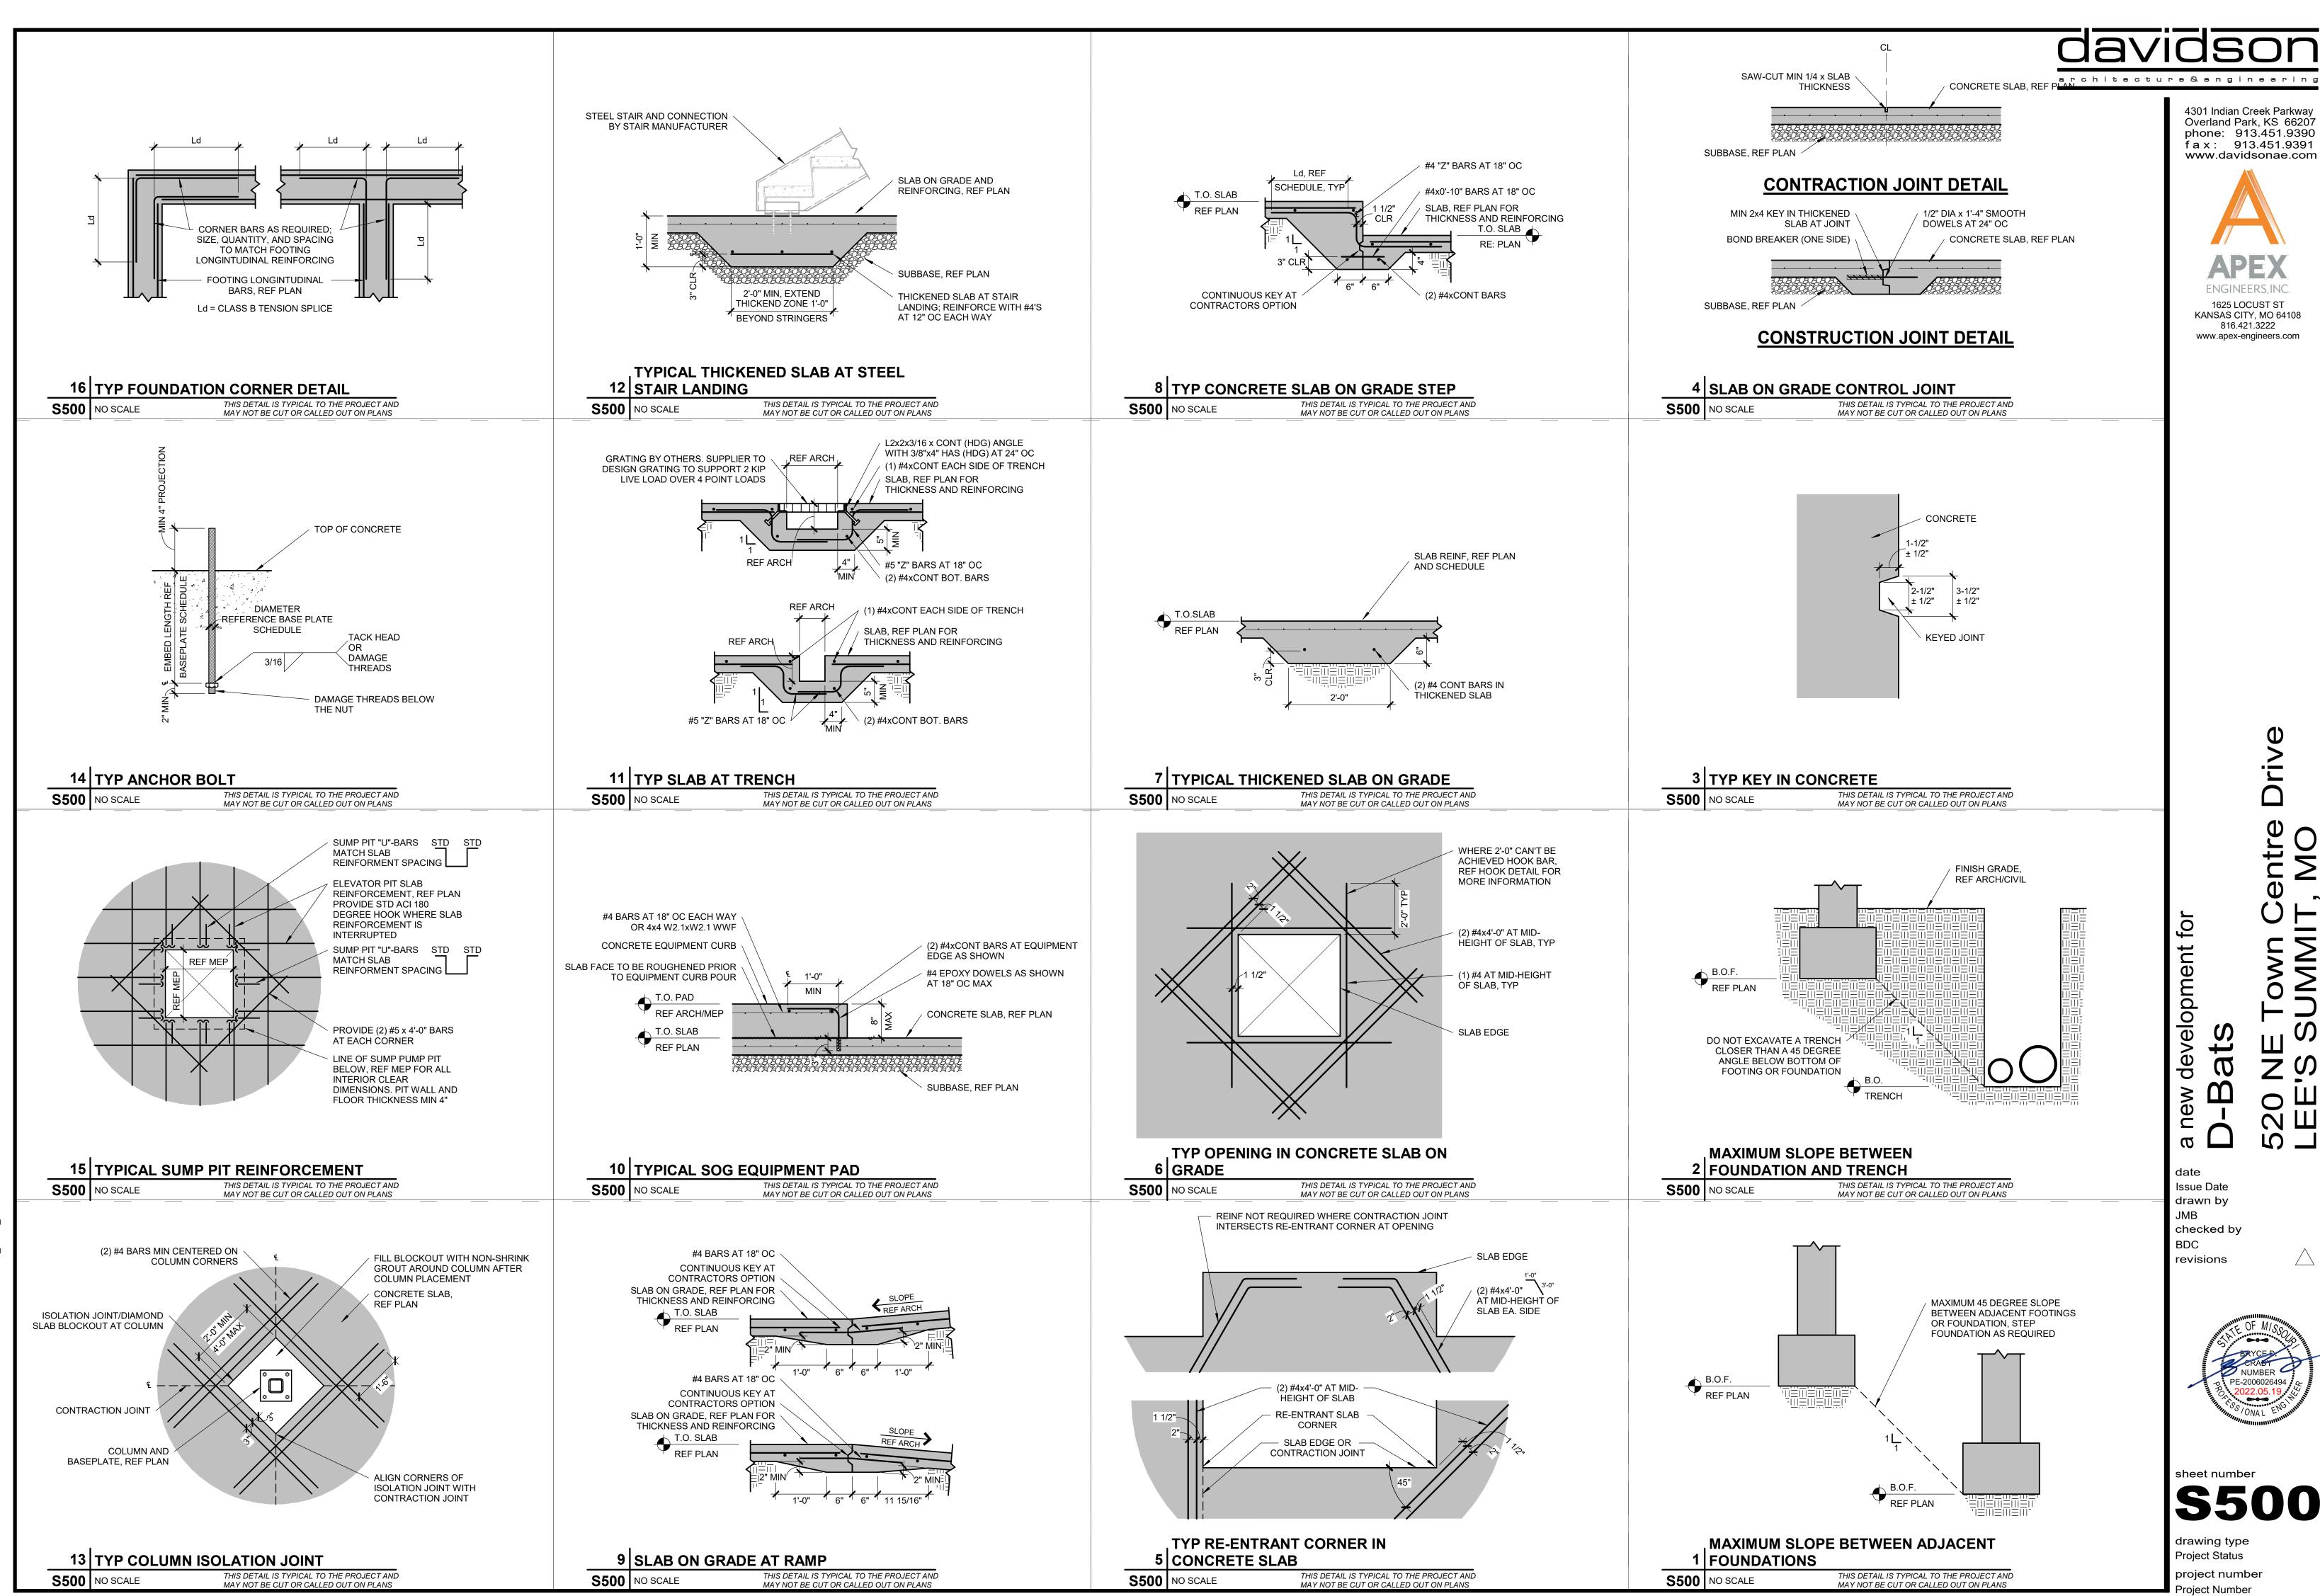

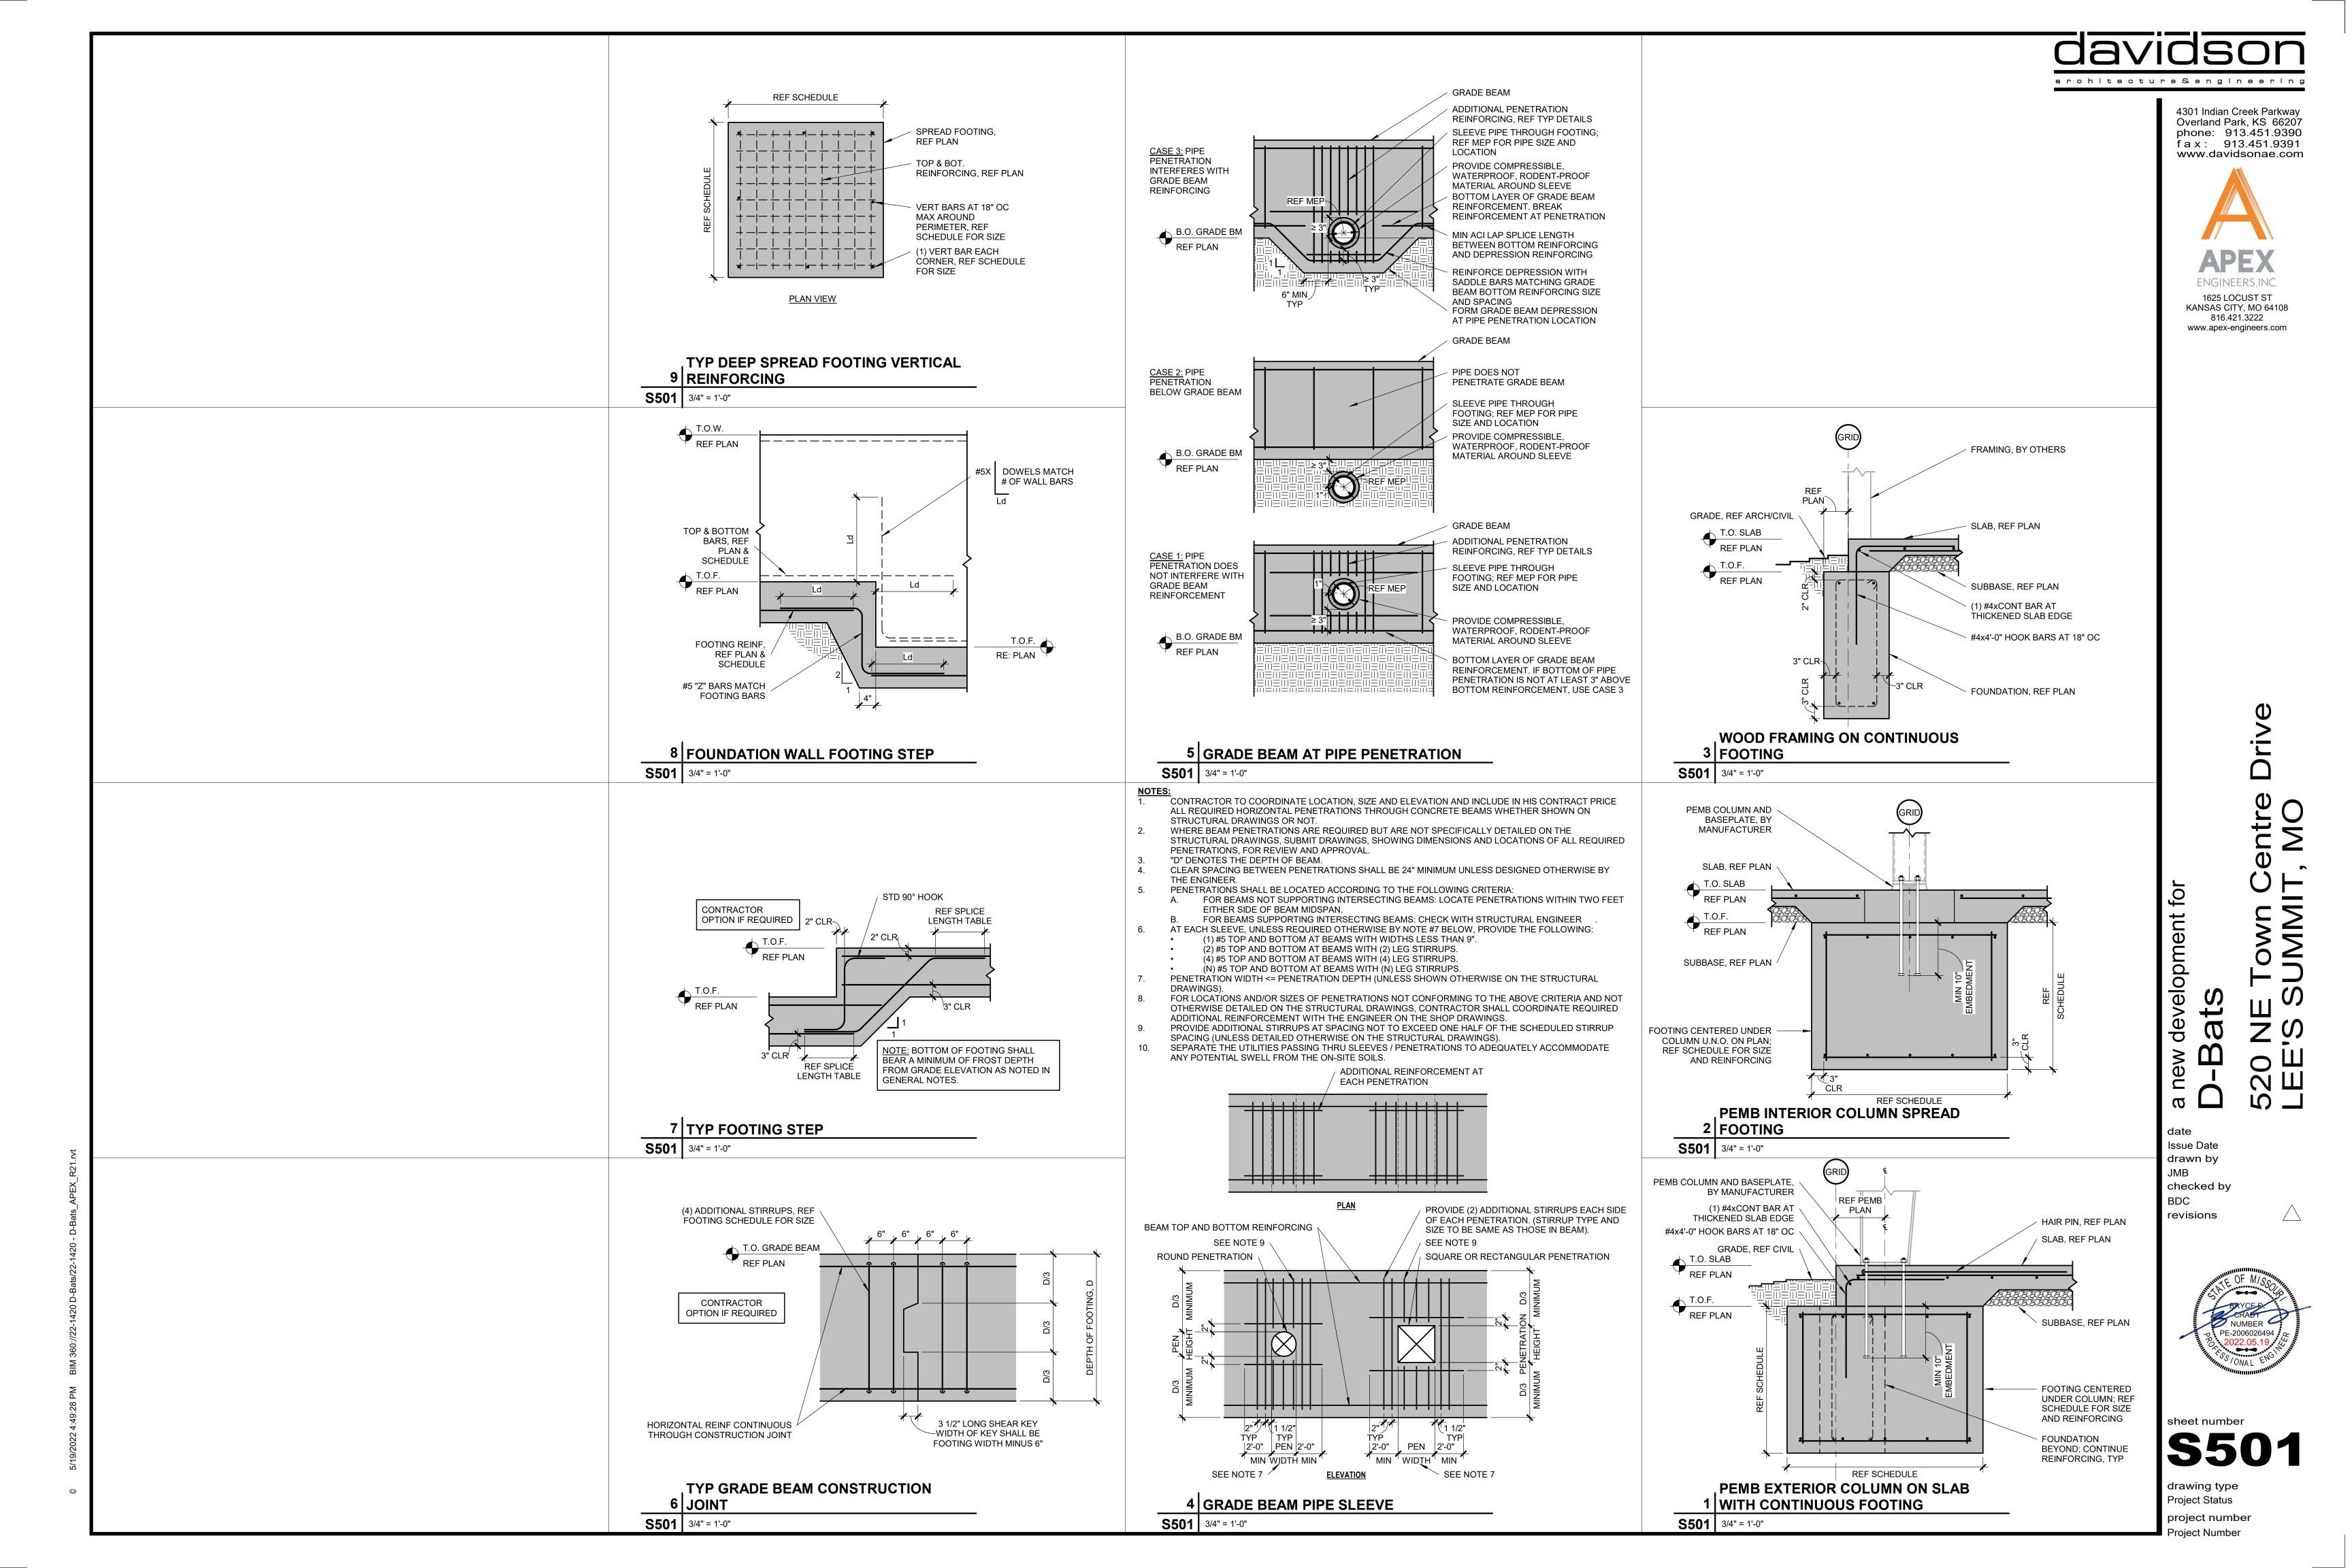

PLUMBING AND MECHANICAL SYSTEMS OUTLINED. B. OBTAIN ALL PERMITS, FEES, LICENSES, INSPECTIONS, AND CERTIFICATES OF COMPLIANCE OR APPROVAL AS REQUIRED BY THE AUTHORITIES

C. ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH ALL APPLICABLE LAWS, CODES AND REGULATIONS OF THE GOVERNMENTAL BODIES HAVING JURISDICTION OVER THE SITE.

D. ALL TESTING REQUIRED BY AUTHORITIES SHALL BE CONSIDERED PART OF THIS WORK.

E. DURING CONSTRUCTION, ALL FIXTURES, EQUIPMENT, PIPE, DUCT, ETC. SHALL BE COVERED, PLUGGED, OR CAPPED AS REQUIRED TO KEEP CLEAN AND UNDAMAGED. ALL DAMAGED ITEMS SHALL BE RESTORED TO ORIGINAL CONDITION OR REPLACED. ALL PROTECTIVE COVERING SHALL BE REMOVED BEFORE FINAL

F. PROVIDE ALL NECESSARY CUTTING AND PATCHING OF WALLS, FLOORS, CEILINGS, AND ROOFS AS NECESSARY. PATCH AROUND ALL OPENINGS SHALL MATCH ADJACENT AREA. COORDINATE ALL ROOFING WORK WITH OWNER OR RESPONSIBLE PARTY, SO THAT THE EXISTING ROOFING WARRANTY WILL BE

G. CONTRACTOR SHALL GUARANTEE ALL WORK AND MATERIALS AGAINST DEFECTS FOR A PERIOD OF ONE YEAR FROM FINAL ACCEPTANCE. 2. OPERATION AND MAINTENANCE MANUALS:

A DURING THE COURSE OF CONSTRUCTION COLLECT AND COMPILE OPERATING INSTRUCTIONS WIRING DIAGRAMS, CATALOG CUTS, LUBRICATION AND PREVENTIVE MAINTENANCE INSTRUCTIONS, PARTS LISTS, ETC. FOR ALL EQUIPMENT FURNISHED UNDER THIS CONTRACT. B. ALL LITERATURE AND INSTRUCTIONS SHIPPED WITH THE EQUIPMENT SHALL BE SAVED FOR INCLUSION

IN THE OPERATION AND MAINTENANCE MANUALS. C. ALL LITERATURE LISTED ABOVE AND ALL PAPERS LISTING WARRANTIES, ETC. SHALL BE BOUND IN A

3-RING BINDER AND LABELED WITH THE PROJECT NAME, ADDRESS, ARCHITECT, ENGINEER, CONTRACTORS, ETC.

A. MANUFACTURERS, MODEL NUMBERS, ETC. INDICATED OR SCHEDULED ON THE DRAWINGS SHALL BE

INTERPRETED AS HAVING ESTABLISHED A STANDARD OF QUALITY AND SHALL NOT BE CONSTRUED AS LIMITING COMPETITION. ARTICLES, FIXTURES, ETC. OF EQUAL QUALITY BY MANUFACTURERS SHALL BE ACCEPTABLE, SUBJECT TO STRUCTURAL AND ELECTRICAL CONSTRAINTS OF THE PROJECT DESIGN, UNLESS NOTED OTHERWISE 4. MOTORS:

A. PROVIDE THERMAL OVERLOAD PROTECTION FOR EACH MOTOR PROVIDED BY THIS WORK. 5. TESTING, BALANCING, AND CLEANING

A. ALL PIPING SHALL BE TESTED FOR LEAKS BEFORE BEING CONCEALED IN WALL CONSTRUCTION OR

B. SEMER AND VENT PIPING SHALL BE HYDROSTATICALLY TESTED WITH NO LESS THAN 10 FEET OF HEAD FOR A PERIOD OF NOT LESS THAN 15 MINUTES, PER THE LOCAL PLUMBING CODE, WITH NO LEAKS.

C. FIRE PROTECTION PIPING SHALL BE TESTED IN ACCORDANCE WITH THE REQUIREMENTS OF NFPA. D. DOMESTIC WATER PIPING SHALL BE HYDROSTATICALLY TESTED AT A PRESSURE OF NOT LESS THAN 1-1/2 IMES THE OPERATING PRESSURE, BUT NOT LESS THAN 60 PSI, FOR A PERIOD OF NOT LESS THAN 2

E. NATURAL GAS PIPING SHALL BE PNEUMATICALLY TESTED AT A PRESSURE OF NOT LESS THAN 1-1/2 TIMES THE OPERATING PRESSURE, BUT NOT LESS THAN 50 PSI, FOR A PERIOD OF NOT LESS THAN 2 HOURS, WITH NO LEAKS.

F. DUCTMORK AND PIPING SHALL BE BALANCED BY QUALIFIED INDEPENDENT BALANCING PERSONNEL WHO HAVE PREVIOUS EXPERIENCE WITH BALANCING PROCEDURES AND ARE CERTIFIED BY THE ASSOCIATED AIR BALANCE COUNCIL (AABC) OR NATIONAL ENVIRONMENTAL BALANCING BUREAU (NEBB)

1) BALANCING SHALL INCLUDE THE BALANCING OF THE EQUIPMENT AND AIR DISTRIBUTION SYSTEMS TO PROVIDE DESIGN QUANTITIES INDICATED AND VERIFICATION OF PERFORMANCE OF ALL EQUIPMENT AND AUTOMATIC CONTROLS.

2) WITH IN 30 DAYS OF THE COMPLETION OF THE TESTING AND BALANCING WORK, SUBMIT THE TEST AND BALANCING REPORT BEARING THE SIGNATURE OF THE TEST AND BALANCE ENGINEER. THE REPORTS SHALL BE CERTIFIED PROOF THAT THE SYSTEMS HAVE BEEN TESTED ADJUSTED AND BALANCED IN ACCORDANCE WITH THE REFERENCED STANDARDS: ARE AN ACCURATE REPRESENTATION OF HOW THE SYSTEMS HAVE BEEN INSTALLED AND ARE OPERATING. REPORTS SHALL BE BOUND IN A VINYL BINDER AND THE BINDER LABELED OR MAY BE AN ELECTRONIC PDF SUBMITTAL. G. BEFORE DOMESTIC WATER PIPING IS PLACED IN SERVICE, ALL DOMESTIC WATER DISTRIBUTION

SYSTEMS, INCLUDING THOSE FOR COLD WATER AND HOT WATER SYSTEMS, SHALL BE FLUSHED, STERILIZED AND CHLORINATED IN ACCORDANCE WITH HEALTH DEPARTMENT REGULATIONS. THE SYSTEMS SHALL BE THOROUGHLY FLUSHED OF ALL DIRT AND FOREIGN MATTER, THEN FILLED WITH WATER TREATED WITH 50 PPM OF CHLORINE. DURING THE FILLING PROCESS, VALVES AND FAUCETS SHALL BE OPENED SEVERAL TIMES TO ASSURE TREATMENT OF THE ENTIRE SYSTEM. THE TREATED WATER SHALL BE LEFT IN THE SYSTEM FOR 24 HOURS AFTER WHICH TIME THE SYSTEM SHALL BE FLUSHED; IF THE RESIDUAL CHLORINE IS NOT LESS THAN 10 PPM, THE FLUSHING SHALL BE REPEATED. AFTER STERILIZATION, SAMPLES OF WATER IN THE SYSTEM SHALL BE APPROVED BY THE BOARD OF HEALTH.

A. PROVIDE AN APPROVED WATER HAMMER ARRESTOR FOR EACH PLUMBING FIXTURE SUPPLY AS REQUIRED BY FIXTURE MANUFACTURER.

B. ALL EXPOSED WASTE PIPE SHALL BE CHROME PLATED BRASS PIPE, NO FERROUS PIPE.

C. PROVIDE CLEANOUTS AT EACH CHANGE OF DIRECTION AND AT 100 FOOT INTERVALS IN STRAIGHT RUNS. D. PROVIDE ACCESS PANELS FOR ALL CONCEALED VALVES AND TRAPS. E. CLEANOUTS:

1) VINYL TILE FLOOR: JR SMITH #4140, OR EQUAL 2) QUARRY TILE FLOOR: JR SMITH #4200, OR EQUAL.

3) CARPETED FLOOR: JR SMITH #4020-Y, OR EQUAL. 4) UNFINISHED FLOOR: JR SMITH #4020, OR EQUAL.

5) WALL: JR SMITH #4472, OR EQUAL, 24" ABOVE THE FLOOR. 6) GRADE: JR SMITH  $\pm4256$ , OR EQUAL, WITH HEAVY DUTY CAST IRON BODY AND COVER.

F. PROVIDE DIELECTRIC UNIONS WITH APPROPRIATE END CONNECTIONS TO MATCH THE PIPE SYSTEM IN WHICH INSTALLED (SCREWED, SOLDERED, OR FLANGED). PROVIDE DIELECTRIC UNIONS ON ALL PIPING CONNECTIONS TO HOT WATER HEATERS AND EXPANSION TANKS.

G. MATER HEATERS:

6. PLUMBING:

1) EVERY WATER HEATER SHALL HAVE AN APPROVED MEANS INSTALLED ON THE COLD WATER SUPPLY LINE ABOVE THE EQUIPMENT TO PREVENT SIPHONING OF A STORAGE WATER HEATER OR TANK. 2) BOTTOM FED WATER HEATERS AND TANKS CONNECT TO WATER HEATERS SHALL HAVE A VACCUM RELIEF VALVE INSTALLED. ANSI Z21.22.

3) STORAGE HEATERS OPERATING ABOVE ATMOSPHERIC PRESSURE SHALL HAVE AN APPROVED PRESSURE RELIEF VALVE AND/OR TEMPERATURE RELIEF VALVE.

H. ALL SEMER PIPING LOCATED INSIDE THE BUILDING SHALL BE INSTALLED WITH THE FOLLOWING SLOPES. ) INSTALL 2-1/2" AND SMALLER PIPE AT 1/4" PER FOOT FALL.

2) INSTALL 3" AND LARGER PIPE AT 1/8" PER FOOT FALL.

I. ALL SEWER PIPING LOCATED EXTERIOR TO THE BUILDING SHALL BE INSTALLED WITH THE FOLLOWING

1) INSTALL 4" AND SMALLER PIPE AT A MINIMUM OF 2% SLOPE. 2) INSTALL 6" AND LARGER PIPE AT A MINIMUM OF 1% SLOPE.

A. DOMESTIC COLD, AND HOT WATER (ABOVEGROUND)

1) TYPE L HARD DRAWN COPPER TUBING, ASTM B-88. a) WROUGHT COPPER SOLDERED FITTINGS, ASTM B75 ALLOY C12200. ANSI B16.22. MS5 SP-104. b) MECHANICAL PRESS COPPER FITTINGS FOR USE IN PLUMBING OR MECHANICAL APPLICATIONS. ASME B16.22 ASME B16.51, Or ASME B16.18. MECHANICAL PRESS COPPER FITTINGS SHALL CONFORM TO IAPMO PS-117 OR

2) PEX, HIGH-DENSITY CROSS-LINKED POLYETHYLENE TUBING SHALL BE MANUFACTURED TO THE REQUIREMENTS OF ASTM F876 AND MEET THE STANDARD GRADE HYDROSTATIC PRESSURE RATINGS FROM PLASTIC PIPE INSTITUTE IN ACCORDANCE WITH TR-4/03. (MUST BE INSTALLED PER THE MANUFACTURERS REQUIREMENTS FOR PLENUM USE)

a) PEX-A AND PEX-B MEETING ANSI/NSF61 AND ANSI/NSF372 STANDARDS FOR POTABLE WATER SAFETY AND LEAD-FREE STANDARDS AND MUST BE MARKED WITH "PW-G", "NSF-61-G" OR OTHER NSF-APPROVED MARKING. ASTM F2023 FOR USE WITH CHLORINATED WATER. (MUST BE INSTALLED PER THE MANUFACTURERS REQUIREMENTS FOR PLENUM USE)

b) PEX MECHANICAL, CRIMP/INSERT OR EXPANSION FITTINGS INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS. PIPE SIZES GIVEN ON THE DRAWINGS ARE NOMINAL COPPER PIPE SIZE, INCREASE PEX PIPING SIZE TO EQUAL OR EXCEED COPPER PIPE INSIDE DIAMETER FOR SUPPLY MAINS.

(MUST BE INSTALLED PER THE MANUFACTURERS REQUIREMENTS FOR PLENUM USE) a) TO BE INSTALLED ON THE FIXTURE SUPPLY TO EACH PLUMBING FIXTURE.

b) TO BE INSTALLED ON THE WATER SUPPLY SIDE TO EACH APPLIANCE OR MECHANICAL EQUIPMENT.

. GATE VALVE: JOMAR T/S-301G OR EQUAL. LEAD-FREE NSF 61, ANSI B1.20.1. GLOBE VALVE: JOMAR TGG OR EQUAL. 3. BALL VALVE: JOMAR JP100PXP OR EQUAL COMPACT LEAD FREE BRASS BALL VALVE.

UL842, CSA 3371-12 & 3371-92, FM, CALIFORNIA CODE AB1953, NSF61 ANNEX & APPROVED. 4. BALL VALVE: JOMAR T-100NE OR EQUAL. UL842, FM, CSA, NSF 61-8, MSS SP-110

1) TYPE K SOFT DRAWN COPPER TUBING, ASTM B-88.

a) Cast Copper Alloy Fittings for Flared Copper Tube, ASME/ANSI B16.26:

2) HDPE, PIGMENTED BLUE THROUGHOUT, CTS SIZES 1"-2" AWWA C901 4710 DR9 PC250 IPS SIZES 2"-3", ANWA C901 4710 DR11 PC200 MATERIAL AND INSTALLATION MUST CONFORM TO WATER DEPARTMENT REQUIREMENTS.

1) DUCTILE IRON PIPE & FITTINGS, AWWA C151, CLASS 50, CEMENT LINING, SEALCOATED, AWWA C104. THRUST BLOCKS IN ACCORDANCE WITH NFPA 24.

2) HDPE IPS SIZES PIGMENTED BLUE THROUGHOUT, 3" AWMA C901 4710 DR11 PC200 4" AND LARGER AWWA C906 3408/4710 DR13.5 PC160 a) STIFFENERS MUST BE USED IN THE ENDS OF THE HDPE, APPROVED TRACE WIRE MUST BE USED. # 12 AWG COPPERHEAD REINFORCED TRACE WIRE (BLUE IN COLOR) b) MATERIAL AND INSTALLATION MUST CONFORM TO WATER DEPARTMENT REQUIREMENTS.

3) POLYVINYL CHLORIDE (PVC) PIPE; AWWA C900; CLASS 200; WITH BELL END AND ELASTOMERIC GASKET, WITH PLAIN END FOR CAST-IRON OR DUCTILE-IRON FITTINGS, OR PVC ELASTOMERIC

b) DUCTILE-IRON AND CAST-IRON FITTINGS: AMMA C110, DUCTILE-IRON OR CAST-IRON, 250-PSI PRESSURE RATING; OR ANWA C153, DUCTILE-IRON COMPACT FITTINGS, 350-PSI PRESSURE RATING; OF DIMENSION TO MATCH PIPE OUTSIDE DIAMETER. ANNA C104, CEMENT MORTAR

a) PVC COUPLINGS AND FITTINGS: AWWA C900, WITH ASTM F 477 ELASTOMERIC SEAL GASKETS,

LINING; GASKETS PER AWWA C111, RUBBER 4) THRUST BLOCKS IN ACCORDANCE WITH NFPA 24.

D. LEAD CONTENT OF WATER SUPPLY PIPE AND FITTINGS:

1) PIPE AND PIPE FITTINGS, INCLUDING VALVES AND FAUCETS, UTILIZED IN THE WATER SUPPLY SYSTEM SHALL NOT HAVE MORE THAN 8% LEAD CONTENT.

2) PIPE, PIPE FITTINGS, JOINTS, VALVES, FAUCETS, AND FIXTURE FITINGS UTILIZED TO SUPPLY MATER FOR DRINKING OR COOKING PURPOSES SHALL COMPLY WITH NSF 372 AND SHALL HAVE A WEIGHTED AVERAGE LEAD CONTENT OF 0.25% OR LESS.

MECHANICAL SPECIFICATIONS (CONTINUED)

E. SANITARY SEWER, AND VENTS.

(UNDERGROUND, INTERIOR TO THE BUILDING) ABS PIPE AND FITTINGS: ABS PIPE AND FITTINGS SHALL COMPLY WITH NSF 14, "PLASTICS PIPING SYSTEMS COMPONENTS AND RELATED MATERIALS," FOR PLASTIC PIPING COMPONENTS. INCLUDE MARKING WITH "NSF-DMV" FOR PLASTIC DRAIN, MASTE, AND VENT PIPING AND "NSF-SEMER" FOR PLASTIC SEMER PIPING. SOLID-WALL ABS PIPE: ASTM D 2661, SCHEDULE 40. ABS SOCKET FITTINGS: ASTM D 2661, MADE TO ASTM D 3311, DRAIN, WASTE, AND VENT PATTERNS. SOLVENT CEMENT: ASTM D 2235.

2) PVC PIPE AND FITTINGS: PVC PIPE AND FITTINGS SHALL COMPLY WITH NSF 14, "PLASTICS PIPING SYSTEMS COMPONENTS AND RELATED MATERIALS." FOR PLASTIC PIPING COMPONENTS, INCLUDE MARKING WITH "INSF-DMV" FOR PLASTIC DRAIN, WASTE, AND VENT PIPING AND "NSF-SEMER" FOR PLASTIC SEMER PIPING. SOLID-WALL PVC PIPE: ASTM D 2665, DRAIN, WASTE, AND VENT. PVC SOCKET FITTINGS: ASTM D 2665, MADE TO ASTM D 3311, DRAIN, MASTE, AND VENT PATTERNS AND TO FIT SCHEDULE 40 PIPE. ADHESIVE PRIMER: ASTM F 656. SOLVENT CEMENT: ASTM D 2564.

3) HUBLESS CAST IRON SOIL PIPE AND FITTINGS: HUBLESS CAST IRON PIPE AND FITTINGS SHALL BE MANUFACTURED FROM GRAY CAST IRON AND SHALL CONFORM TO ASTM A 888 AND CISPI STANDARD 301. HUBLESS COUPLINGS SHALL CONFORM TO CISPI STANDARD 310 AND BE CERTIFIED BY NSF® INTERNATIONAL.

4) HUB AND SPIGOT CAST IRON SOIL PIPE AND FITTINGS: HUB AND SPIGOT CAST IRON PIPE AND FITTINGS SHALL BE MANUFACTURED FROM GRAY CAST IRON AND SHALL CONFORM TO ASTM A 74. F. SANITARY SEMER, AND VENTS. (ABOVE GROUND, INTERIOR TO THE BUILDING).

1) ABS PIPE AND FITTINGS: ABS PIPE AND FITTINGS SHALL COMPLY WITH NSF 14, "PLASTICS PIPING SYSTEMS COMPONENTS AND RELATED MATERIALS," FOR PLASTIC PIPING COMPONENTS. INCLUDE MARKING WITH "NSF-DMV" FOR PLASTIC DRAIN, MASTE, AND VENT PIPING AND "NSF-SEWER" FOR PLASTIC SEWER PIPING. SOLID-WALL ABS PIPE: ASTM D 2661, SCHEDULE 40. CELLULAR-CORE ABS PIPE: ASTM F 628, SCHEDULE 40.ABS SOCKET FITTINGS: ASTM D 2661, MADE TO ASTM D 3311, DRAIN, WASTE, AND VENT PATTERNS. SOLVENT CEMENT: ASTM D 2235. (NOT FOR USE IN A RETURN AIR PLENUM)

2) PVC PIPE AND FITTINGS: PVC PIPE AND FITTINGS SHALL COMPLY WITH NSF 14, "PLASTICS PIPING SYSTEMS COMPONENTS AND RELATED MATERIALS." FOR PLASTIC PIPING COMPONENTS, INCLUDE MARKING WITH "NSF-DWV" FOR PLASTIC DRAIN, MASTE, AND VENT PIPING AND "NSF-SEMER" FOR PLASTIC SEMER PIPING. SOLID-WALL PVC PIPE: ASTM D 2665, DRAIN, CELLULAR-CORE PVC PIPE: ASTM F 891, SCHEDULE 40, WASTE, AND VENT, PVC SOCKET FITTINGS: ASTM D 2665, MADE TO ASTM D 3311, DRAIN, WASTE, AND VENT PATTERNS AND TO FIT SCHEDULE 40 PIPE. ADHESIVE PRIMER: ASTM F 656. SOLVENT CEMENT: ASTM D 2564. (NOT FOR USE IN A RETURN AIR PLENUM)

3) HUBLESS CAST IRON SOIL PIPE AND FITTINGS: HUBLESS CAST IRON PIPE AND FITTINGS SHALL BE MANUFACTURED FROM GRAY CAST IRON AND SHALL CONFORM TO ASTM A 888 AND CISPI STANDARD 301. HUBLESS COUPLINGS SHALL CONFORM TO CISPI STANDARD 310 AND BE CERTIFIED BY NSF® INTERNATIONAL. 4) HUB AND SPIGOT CAST IRON SOIL PIPE AND FITTINGS: HUB AND SPIGOT CAST IRON PIPE AND FITTINGS

SHALL BE MANUFACTURED FROM GRAY CAST IRON AND SHALL CONFORM TO ASTM A 14. (UNDERGROUND, EXTERIOR TO THE BUILDING).

ABS PIPE AND FITTINGS: ABS PIPE AND FITTINGS SHALL COMPLY WITH NSF 14, "PLASTICS PIPING SYSTEMS COMPONENTS AND RELATED MATERIALS," FOR PLASTIC PIPING COMPONENTS. INCLUDE MARKING WITH "NSF-DMV" FOR PLASTIC DRAIN, WASTE, AND VENT PIPING AND "NSF-SEMER" FOR PLASTIC SEMER PIPING. SOLID-WALL ABS PIPE: ASTM D 2661, SCHEDULE 40. ABS SOCKET FITTINGS: ASTM D 2661, MADE TO ASTM D 3311, DRAIN, WASTE, AND VENT PATTERNS. SOLVENT CEMENT: ASTM D 2235.

2) PVC PIPE AND FITTINGS: PVC PIPE AND FITTINGS SHALL COMPLY WITH NSF 14, "PLASTICS PIPING SYSTEMS COMPONENTS AND RELATED MATERIALS," FOR PLASTIC PIPING COMPONENTS. INCLUDE MARKING WITH "NSF-DWV" FOR PLASTIC DRAIN, MASTE, AND VENT PIPING AND "NSF-SEMER" FOR PLASTIC SEMER PIPING, SOLID-WALL PVC PIPE: ASTM D 2665, DRAIN, WASTE, AND VENT. PVC SOCKET FITTINGS: ASTM D 2665, MADE TO ASTM D 3311, DRAIN, WASTE, AND VENT PATTERNS AND TO FIT SCHEDULE 40 PIPE. ADHESIVE PRIMER: ASTM F 656. SOLVENT CEMENT: ASTM D 2564

3) HUBLESS CAST IRON SOIL PIPE AND FITTINGS: HUBLESS CAST IRON PIPE AND FITTINGS SHALL BE MANUFACTURED FROM GRAY CAST IRON AND SHALL CONFORM TO ASTM A 888 AND CISPI STANDARD 301. HUBLESS COUPLINGS SHALL CONFORM TO CISPI STANDARD 310 AND BE CERTIFIED BY NSF® INTERNATIONAL 4) HUB AND SPIGOT CAST IRON SOIL PIPE AND FITTINGS: HUB AND SPIGOT CAST IRON PIPE AND FITTINGS SHALL BE MANUFACTURED FROM GRAY CAST IRON AND SHALL CONFORM TO ASTM A 74.

5) COPPER DMY: DRAINAGE TUBE SHALL CONFORM TO ASTM B306, WROUGHT COPPER FITTINGS, ANSI B-16.29. 6) GALVANIZED STEEL PIPE, WITH MALLEABLE IRON, THREADED FITTINGS, DRAINAGE PATTERN FOR SEWERS SHALL CONFORM TO ASTM A 53.

H. CONDENSATE DRAINS & INDIRECT WASTE (ABOVEGROUND). 1) POLYVINYLCHLORIDE (PVC) DWV PIPE, SCHEDULE 40, SOLVENT JOINT (CONDENSATE). 2) DWV, WROUGHT COPPER, ANSI B-16.29 (WATER HEATER T&P). . REFRIGERANT

1) ASTM B 280, TYPE ACR, HARD-DRAWN STRAIGHT LENGTHS, AND SOFT-ANNEALED COILS, SEAMLESS COPPER TUBING. 2) MROUGHT COPPER, ANSI B16.22, STREAMLINED PATTERN, FITTINGS. BRAZED JOINTS, AMS A 5.8,

3) TUBING SHALL BE FACTORY CLEANED, READY FOR INSTALLATION, AND HAVE ENDS CAPPED TO PROTECT CLEANLINESS OF PIPE INTERIORS PRIOR TO SHIPPING 4) SIZE AND INSTALLATION OF PIPE SHALL BE IN ACCORDANCE WITH MANUFACTURER'S

J. NATURAL GAS. 1) BLACK STEEL PIPE, SCHEDULE 40, ASTM A53. a) PIPE 3" AND SMALLER; 150 LB. MALLEABLE IRON, THREADED FITTINGS.

RECOMMENDATIONS.

L. SLEEVES

b) PIPE 4" AND SMALLER; VIEGA MEGAPRESS G FOR WATER AND GAS. CSA LC4, TSSA/ASME B31 FOR USE WITH ASTM A53 SCHEDULE 40 BLACK IRON PIPE. c) PIPE 2-1/2" AND LARGER, WELDED. d) PLUG VALVE: ROCKWELL NORDSTROM FIGURE NO. 142 OR 143.

e) BALL VALVE: JOMAR T-100NE. APPROVALS- UL842, FM, CSA, NSF 61-8, MSS SP-110 2) GAS PIPING PAINTING: a) ALL BLACK STEEL GAS PIPING LOCATED EXTERIOR TO THE BUILDING SHALL BE PRIMED AND PAINTED TO EITHER MATCH ADJACENT EXTERIOR THERE LOCATED ON OR NEAR EXTERIOR WALL AND PAINTED SAFETY YELLON WHERE LOCATED ON THE ROOF.

B) POLYETHYLENE PLASTIC PIPE, TUBING, AND FITTINGS RATED FOR UNDERGROUND USE WITH NATURAL GAS. PIPING SHALL CONFORM TO 2009 EDITION OF ASTM D 2513. PIPE SHALL BE MARKED "GAS" AND "ASTM D 2513". a) PLASTIC PIPE, TUBING, TRACER WIRE AND ANODELESS RISERS SHALL COMPLY WITH THE FOLLOWING. -FACTORY-ASSEMBLED ANODELESS RISERS SHALL BE RECOMMENDED BY THE MANUFACTURER FOR THE GAS USED AND SHALL BE LEAK TESTED BY THE MANUFACTURER IN ACCORDANCE WITH WRITTEN PROCEDURES. SERVICE HEAD ADAPTERS AND FIELD-ASSEMBLED ANODELESS RISERS INCORPORATING SERVICE HEAD ADAPTERS SHALL BE RECOMMENDED BY THE MANUFACTURER FOR THE GAS USED, AND SHALL BE DESIGNED DEPARTMENT OF TRANSPORTATION, CODE OF FEDERAL

REGULATIONS, TITLE 49, PART 192.281(E). THE MANUFACTURER SHALL PROVIDE THE USER WITH QUALIFIED INSTALLATION PART 192.283(B). K. ALL PIPE HANGERS AND SUPPORTS SHALL BE STANDARD PRODUCTS OF GRINNELL, FEE AND MASON, OR ELCEN. HANGER SPACING SHALL BE IN ACCORDANCE WITH MSS-SP-69.

SHALL BE OF SUFFICIENT SIZE TO PERMIT PIPE MOVEMENT DUE TO EXPANSION AND CONTRACTION AND TO ACCOMMODATE PIPE INSULATION. 2) INTERIOR PARTITIONS: 16 GAGE GALVANIZED STEEL, PACK BETWEEN PIPE AND SLEEVE WITH FIRE SAFING AND CAULK AT EACH END WITH FIRE RESISTANT SEALANT.

1) PROVIDE, SET, AND PROPERLY LOCATE PIPE SLEEVES AS REQUIRED FOR THIS WORK. ALL SLEEVES

3) ROOF: PROSET OR EQUAL, MANUFACTURED PVC SCHEDULE 40 PIPE SLEEVE WITH WATERPROOF SEAL COORDINATE WITH ROOFING CONTRACTOR AND FLASH AS REQUIRED TO MAINTAIN ROOF WARRANTY.

4) PROTECTION AGAINST CONTACT: METALLIC PIPING, EXCEPT FOR CAST IRON, DUCTILE IRON AND GALVANIZED STEEL SHALL NOT BE PLACED IN DIRECT CONTACT WITH STEEL FRAMING MEMBERS, CONCRETE, OR CINDER WALLS AND FLOORS OR OTHER MASONRY. METALLIC PIPING SHALL NOT BE PLACED IN DIRECT CONTACT WITH CORROSIVE SOIL. SHEATHING USED TO PREVENT DIRECT CONTACT SHALL HAVE A THICKNESS OF GREATER THAN .008: AND THE SHEATHING SHALL BE MADE OF PLASTIC. ANY PIPE THAT PASSES THROUGH A FOUNDATION WALL OR FOOTING SHALL BE PROVIDED WITH A RELIEVING ARCH, OR A PIPE SLEEVE SHALL BE BUILT INTO THE FOUNDATION WALL. THE SLEEVE SHALL BE TWO SIZES GREATER THAN THE PIPE PASSING THOUGH THE WALL OR FOOTING.

5) PLUMBING VENTS: FLASH ROOF VENT INTO ROOFING SYSTEM AS REQUIRED BY THE ROOFING CONTRACTOR TO MAINTAIN EXISTING ROOF WARRANTY. ALL PLUMBING VENT TERMINALS SHALL TERMINATE A MINIMUM OF 12" ABOVE ROOF OR EQUAL TO HEIGHT OF PARAPET, WHICHEVER IS GREATER.

M. PROVIDE CHROME PLATED ESCUTCHEONS ON ALL PIPE ENTERING FINISHED AREAS. A. COMMERCIAL, LIGHT-DUTY, STORAGE, ELECTRIC, DOMESTIC-WATER HEATERS:

 STANDARD: UL 174 2. STORAGE-TANK CONSTRUCTION: STEEL, VERTICAL ARRANGEMENT.

b. INTERIOR FINISH: COMPLY WITH NSF 61 AND NSF 312 BARRIER MATERIALS FOR POTABLE-WATER TANK LININGS, INCLUDING EXTENDING LINING MATERIAL INTO TAPPINGS.

3. FACTORY-INSTALLED, STORAGE-TANK APPURTENANCES: a. ANODE ROD: REPLACEABLE MAGNESIUN

b. DIP TUBE: REQUIRED UNLESS COLD-WATER INLET IS NEAR BOTTOM OF TANK C. DRAIN VALVE: CORROSION-RESISTANT METAL WITH HOSE-END CONNECTION.

d. INSULATION: COMPLY WITH ASHRAE/IES 90.1 e. JACKET: STEEL WITH ENAMELED FINISH OR HIGH-IMPACT COMPOSITE MATERIAL.

F. HEAT-TRAP FITTINGS: INLET TYPE IN COLD-WATER INLET AND OUTLET TYPE IN HOT-WATER OUTLET. g. HEATING ELEMENTS: ELECTRIC, SCREW-IN IMMERSION TYPE. h. TEMPERATURE CONTROL: ADJUSTABLE THERMOSTAT.

i. SAFETY CONTROL: HIGH-TEMPERATURE-LIMIT CUTOFF DEVICE OR SYSTEM j. RELIEF VALVE: ASME RATED AND STAMPED FOR COMBINATION TEMPERATURE-AND-PRESSURE RELIEF VALVES. INCLUDE RELIEVING CAPACITY AT LEAST AS GREAT AS HEAT INPUT, AND INCLUDE PRESSURE SETTING LESS THAN MORKING-PRESSURE RATING OF DOMESTIC-MATER HEATER. SELECT RELIEF VALVE WITH SENSING ELEMENT THAT EXTENDS INTO STORAGE TANK.

B. DOMESTIC-WATER EXPANSION TANKS DESCRIPTION: STEEL, PRESSURE-RATED TANK CONSTRUCTED WITH WELDED JOINTS AND FACTORY-INSTALLED, BUTYL-RUBBER DIAPHRAGM. INCLUDE AIR PRECHARGE TO MINIMUM SYSTEM-OPERATING PRESSURE AT TANK.

2. CONSTRUCTION a. TAPPINGS: FACTORY-FABRICATED STEEL, WELDED TO TANK BEFORE TESTING AND LABELING. INCLUDE ASME B1.20.1 PIPE THREAD

b. INTERIOR FINISH: COMPLY WITH NSF 61 AND NSF 372 BARRIER MATERIALS FOR POTABLE-WATER TANK LININGS, INCLUDING EXTENDING FINISH INTO AND THROUGH TANK FITTINGS AND OUTLETS. C. AIR-CHARGING VALVE: FACTORY INSTALLED.

3. CAPACITY AND CHARACTERISTICS a. WORKING-PRESSURE RATING: 150 PSIG

9. FIRE PROTECTION (WET PIPE SPRINKLER SYSTEM): A. PROVIDE A "WET-PIPE" SPRINKLER SYSTEM WITH AUTOMATIC SPRINKLERS AND CONNECTED TO A SUFFICIENT WATER SUPPLY.

B. THE SYSTEM DESIGN SHALL BE BASED ON LIGHT HAZARD CLASSIFICATION, NFPA 13 C. THE WET PIPE SPRINKLER SYSTEM SHALL CONFORM TO ALL REQUIREMENTS OF THE OWNER'S INSURANCE CARRIER AND LOCAL AUTHORITIES. PROVIDE SYSTEM DRAWINGS WITH A PROFESSIONAL ENGINEERS STAMP ON THE DRAWINGS FOR REVIEW BY THE OWNER'S INSURANCE CARRIER AND LOCAL AUTHORITIES PRIOR TO INSTALLATION OF PIPING.

D. THE WET PIPE SPRINKLER SYSTEM SHALL BE HYDRAULICALLY DESIGNED, BASED ON A WATER FLOW DATA OBTAINED FROM THE LOCAL WATER OR FIRE DEPARTMENT. E. PIPE AND TUBING MATERIALS:

1) STEEL PIPE, SMALLER THAN 2". a) ASTM A 53/A 53M STANDARD, SCHEDULE 40, SEAMLESS, BLACK STEEL PIPE.

d) ASTM A 135 OR ASTM A 795/A 795M SCHEDULE 5 STEEL PIPE.

b) ASTM A 135;L ASTM A 795/A 795M; OR ASME B36.10M, WALL THICKNESS GREATER THAN OR EQUAL TO SCHEDULE 30 AND LESS THAN SCHEDULE 40, BLACK STEEL PIPE. c) ASTM A 135 OR ASTM 795/A 795M, THREADABLE, WALL THICKNESS LESS THAN SCHEDULE 30 AND GREATER THAN SCHEDULE 10, BLACK-STEEL PIPE.

2) STEEL PIPE, 2" AND LARGER: ASTM A 795, SCHEDULE 10, SEAMLESS, BLACK STEEL.

MECHANICAL SPECIFICATIONS (CONTINUED)

F. FITTINGS: 1) CAST-IRON THREADED FITTINGS: ANSI B16.4, CLASS 125, STANDARD PATTERN, FOR THREADED

JOINTS. THREADS SHALL CONFORM TO ANSI B1.20.1 2) MALLEABLE-IRON THREADED FITTINGS: ANSI B16.3, CLASS 150, STANDARD PATTERN, FOR THREADED JOINTS. THREADS SHALL CONFORM TO ANSI B1.20.1

3) STEEL FITTINGS: ASTM A 234, SEAMLESS OR WELDED, FOR WELDED JOINTS.

4) GROOVED MECHANICAL FITTINGS: ASTM A 536, GRADE 65-45-12 DUCTILE IRON; ASTM A 47 GRADE 32510 MALLEABLE IRON; OR ASTM A53, TYPE F, E, OR S; GRADE B FABRICATED STEEL FITTINGS WITH GROOVES OR SHOULDERS DESIGNED TO ACCEPT GROOVED END COUPLINGS, IN ACCORDANCE WITH ITS LISTING. G. HANGERS AND SUPPORTS:

1) HANGERS, ANCHORS, AND SUPPORTS FOR FIRE PROTECTION PIPING AND EQUIPMENT SHALL BE IN ACCORDANCE WITH NFPA 13. HANGERS, ANCHORS, SUPPORTS, AND COMPONENTS SHALL BE LISTED BY UL AND ANY OTHER AGENCIES REQUIRED BY THE LOCAL FIRE AUTHORITIES AND THE OWNER'S NSURANCE CARRIER H. AUTOMATIC SPRINKLERS:

REQUIRED, PROVIDE QUICK RESPONSE HEADS WITH NOMINAL 1/2 INCH DISCHARGE ORIFICE, FOR "LIGHT HAZARD" TEMPERATURE RANGE. 2) SPRINKLER HEADS SHALL BE OF THE FOLLOWING CONSTRUCTION, CONFIGURATIONS, AND FINISH FOR THE AREAS INDICATED:

a) FINISHED AREAS; SEMI-RECESSED PENDANT, CHROME PLATED, CHROME ESCUTCHEON CUP.

1) SPRINKLER HEADS: TYPE AS INDICATED OR REQUIRED BY THE APPLICATION. UNLESS OTHERWISE

b) UNFINISHED AREAS; UPRIGHT, ROUGH BRASS. 3) FURNISH THREE EXTRA SPRINKLER HEADS OF EACH TYPE INCLUDED IN THE PROJECT, AND PROVIDE A SPRINKLER HEAD CABINET AND ANY SPECIAL WRENCHES TO REMOVE OR INSTALL SPRINKLER

4) FURNISH QUICKSTOP TALON SPRINKLER TOOL. QUICKSTOP TALON SHALL STOP  $\frac{1}{2}$ " AND  $\frac{3}{4}$ " HEADS. THE TOOL SHALL FEATURE A FUSIBLE LINK TO RELEASE THE TOOL IF HEATED AND SHALL BE 100% WATER I. ALARM DEVICES:

1) WATER FLOW INDICATORS: VANE TYPE WATERFLOW DETECTOR, RATED TO 250 PSIG; DESIGNED FOR

HORIZONTAL OR VERTICAL INSTALLATION: HAVE 2-SPDT CIRCUIT SWITCHES TO PROVIDE ISOLATED

ALARM AND AUXILIARY CONTACTS, 7 AMPÈRE 125 VOLTS AC AND 0.25 AMPÈRE 24 VOLTS DC;

COMPLETE WITH FACTORY-SET, FIELD-ADJUSTABLE RETARD ELEMENT TO PREVENT FALSE SIGNALS, AND TAMPER-PROOF COVER WHICH SENDS A SIGNAL WHEN COVER IS REMOVED. 2) SUPERVISORY SMITCHES: SPST, NORMALLY CLOSED CONTACTS, DESIGNED TO SIGNAL VALVE IS IN OTHER THAN FULL OPEN POSITION

10. INSULATION AND DUCT LINING A. ALL INSULATIONS AND ACCESSORIES SHALL HAVE A FIRE HAZARD CLASSIFICATION WITH A FLAME SPREAD RATING OF NOT OVER 25, A FUEL CONTRIBUTION RATING OF NOT OVER 50, AND A SMOKE DEVELOPED RATING OF NOT OVER 50, IN ACCORDANCE WITH NFPA.

B. PIPE INSULATION - ABOVE GRADE: 1) THE PIPING INSULATION USED SHALL HAVE A THERMAL CONDUCTIVITY OF 0.27 Btu PER in/hr*sqft*F° OR LESS.

2) FIBERGLASS INGLILATION WITH FACTORY APPLIED VAPOR BARRIER AS LIACKET FACTORY APPLIED PRESSURE SEALING LONGITUDE LAP JOINT, NO STAPLES, ZESTON PREMOLDED PVC FITTING COVERS. INSTALLATION SHALL BE IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.

4) FOR NON CIRCULATING SYSTEMS, THE FIRST & FEET OF INLET AND OUTLET PIPING BETWEEN THE TANK AND THE HEAT TRAP (INCLUDING THE HEAT TRAP) MUST BE INSULATED.

3) FLEXIBLE CLOSED CELL ELASTOMERIC THERMAL INSULATION, UNSLIT OR PRESLIT WITH PRESSURE

SENSITIVE ADHESIVE SYSTEM FOR CLOSURE AND VAPOR SEALING, EQUAL TO ARMSTRONG AP

5) FOR CIRCULATING SYSTEMS, ALL HOT WATER PIPING IN THE CIRCULATION LOOP MUST BE INSULATED 6) INSULATION SCHEDULE: a) DOMESTIC COLD WATER

1" FOR PIPING UP TO 1-1/4" \$\Phi\$, \$ 1-1/2" FOR PIPING 1-1/2" \$P\$ AND LARGER b) DOMESTIC HOT WATER c) CONDENSATE DRAINS INSIDE BUILDING 1/2" 3/4" FOR PIPING UP TO 1-1/4" \$ 1" FOR PIPING 1-1/2" \$ AND LARGER d) REFRIGERANT SUCTION C. EQUIPMENT INSULATION:

1) FLEXIBLE FIBERGLASS: GLASS FIBER INSULATION, ASTM C 553, TYPE 1, CLASS B-4, SEMI-RIGID BOARD, WITH FACTORY LAMINATED KRAFT ALUMINUM FOIL (ALL SERVICE JACKET), VAPOR BARRIER, OWENS/CORNING PIPE AND TANK INSULATION. D. DUCTWORK: ACOUSTICAL INSULATION

1) DUCT LINING: 2 LB/CF, THICKNESS AS SCHEDULED, AIR STREAM SIDE COATED, INSTALL PER SMACNA STANDARDS a) DUCT LINING SCHEDULE 1/2" : THROUGHOUT THE FIRST 10 FEET OF DUCT.

(1) RECTANGULAR SUPPLY DUCT 1/2" : THROUGHOUT THE FIRST 10 FEET OF DUCT. (2) RETURN AIR DUCT (3) SOUND BOOTS E. DUCTWORK: THERMAL INSULATION.

1) DUCT COVERING: 3/4 LB/CF, FIBERGLASS BLANKET WITH FACTORY APPLIED VAPOR BARRIER AND FACING, THICKNESS AS SCHEDULED, INSTALLATION IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATIONS. a) DUCT COVERING SCHEDULE: MINIMUM R-6

(1) ROUND SUPPLY DUCT (2) RECTANGULAR SUPPLY DUCT (3) RETURN AIR DUCT (4) MAKE-UP AIR DUCT (4) OUTDOOR AIR

ARMAFLEX OR ARMAFLEX 2000.

2) DUCT LINING: 2 LB/CF, THICKNESS AS SCHEDULED, AIR STREAM SIDE COATED, INSTALL PER SMACNA STANDARDS. a) DUCT LINING SCHEDULE: (1) RECTANGULAR SUPPLY DUCT (2) ROUND SUPPLY DUCT

(3) RETURN AIR DUCT

3) EXPOSED SPIRAL DUCT. a) DOUBLE WALL SPIRAL - DOUBLE WALL INSULATED SPIRAL DUCT AND FITTINGS WITH PERFORATED

1"LINER WITH A K VALUE OF 0.27. b) SPIRAL DUCT LINING: JOHNS MANYILLE SPIRACOUSTIC PLUS ROUND DUCT LINER SYSTEM, VSD, SD, AND LD SIZES, 8"O AND UP. MEETS ASTM E 84 25/50 FLAME AND SMOKE, ASHRAE 62, MEA#237-86-M, SMACNA APPLICATION STANDARDS FOR DUCT LINERS, NAIMA FIBERBLASS DUCT LINER STANDARD. 1" THICKNESS, AIR STREAM SIDE COATED, INSTALL PER SMACNA STANDARDS. 4) DUCT COVERING (EXTERIOR SUPPLY AND RETURN)

a) EXTERIOR INSULATION: JOHN MANVILLE XSPECT ISOFOAM APF BOARD, 1-1/2" THICK R-9.3, UNIFORM CLOSED-CELL POLYISOCYANURATE FOAM CORE BONDED WITH A FOIL FACER. INSTALLED PER MANUFACTURER'S REQUIREMENTS. COVER ISOFOAM BOARD INSULATION WITH POLYGUARD ALUMAGUARD COMPOSITE MEMBRANE MULTI-PLY EMBOSSED UV-RISISTANT ALUMINUM FOIL/POLYMER LAMINATE, ALL MEATHER FLEXIBLE WEATHER-PROOFING JACKET. MINIMUM R-8 RATING. MINIMUM R-12 CLIMATE ZONES 5-8.

A. ALL DUCTWORK, UNLESS OTHERWISE INDICATED, SHALL BE FABRICATED FROM GALVANIZED SHEET STEEL COMPLYING WITH ASTM A 527, LOCKFORMING QUALITY, WITH G 90 ZINC COATING IN ACCORDANCE WITH

ASTM A 525; AND MILL PHOSPHATIZED FOR EXPOSED LOCATIONS. B. WHERE DUCTWORK IS INDICATED TO BE EXPOSED TO VIEW IN OCCUPIED SPACES, PROVIDE MATERIALS WHICH ARE FREE FROM VISUAL IMPERFECTIONS INCLUDING PITTING, SEAM MARKS, ROLLER MARKS, STAINS AND DISCOLORATIONS, AND OTHER IMPERFECTIONS, INCLUDING THOSE WHICH WOULD IMPAIR

C. DUCTWORK, METAL GAUGES, REINFORGING, ETC. SHALL BE CONSTRUCTED IN ACCORDANCE WITH SMACNA "HVAC DUCT CONSTRUCTION STANDARDS," LATEST EDITION FOR A 2 INCH WATER GAUGE STATIC

1) RECTANGULAR DUCT a) ELBOMS, UNLESS INDICATED OTHERWISE SHALL BE CONSTRUCTED WITH CENTERLINE RADIUS OF NOT LESS THAN 1.5 DUCT WIDTH OR SQUARE ELBOW WITH DOUBLE WALL STREAMLINE VANES. b) RETURN AIR ACOUSTICAL ELBOMS AND SOUND BOOTS SHALL BE A SQUARE ELBOM WITH NO

c) SLOPES FOR TRANSITIONS OR OTHER CHANGES IN DIMENSIONS SHALL BE MINIMUM 1 TO 3. 2) ROUND AND OVAL SPIRAL SEAM DUCT a) PROVIDE RADIUS TYPE FITTINGS FABRICATED OF MULTIPLE SECTIONS WITH MAXIMUM 15 DEGREE CHANGE OF DIRECTION PER SECTION. UNLESS SPECIFICALLY DETAILED OTHERWISE, USE 45 DEGREE LATERALS FOR BRANCH TAKEOFF CONNECTIONS. WHERE 90 DEGREE BRANCHES

ARE INDICATED PROVIDE CONICAL TYPE TEES. b) SLOPES FOR TRANSITIONS OR OTHER CHANGES IN DIMENSIONS SHALL BE MINIMUM 1 TO 3. c) AS AN OPTION, PROVIDE FACTORY-FABRICATED DUCT AND FITTINGS, IN LIEU OF SHOP-

(1) ELBOWS: ONE PIECE CONSTRUCTION FOR 90 DEGREES AND 45 DEGREE ELBOW 14" AND SMALLER. PROVIDE MULTIPLE GORE CONSTRUCTION FOR LARGER DIAMETERS WITH STANDING SEAM CIRCUMFERENTIAL JOINT.

(2) DIVIDED FLOW FITTINGS: 90 DEGREE TEES, CONSTRUCTED WITH SADDLE TAP SPOT WELDED AND BONDED TO DUCT FITTING BODY. d) ROUND LONGITUDINAL SEAM DUCT. USE FOR RIGID METAL DUCT ON LEAVING SIDE OF DUCT IN CONCEALED LOCATIONS FOR EXTENSION TO FLEX FOR DIFFUSERS, UNLESS OTHERWISE

D. DUCT SIZES SHOWN ON THE DRAWINGS ARE SHEETMETAL SIZES, ALLOWANCE FOR DUCT LINER HAS BEEN MADE WHERE APPLICABLE. E. INSTALLATION OF METAL DUCTWORK:

1) GENERAL: ASSEMBLE AND INSTALL DUCTWORK IN ACCORDANCE WITH RECOGNIZED INDUSTRY PRACTICES WHICH WILL ACHIEVE AIR-TIGHT SYSTEMS (MAXIMUM 5% LEAKAGE), WITH NO OBJECTIONABLE NOISE, AND CAPABLE OF PERFORMING INDICATED SERVICE. INSTALL EACH RUN WITH MINIMUM NUMBER OF JOINTS. ALIGN DUCTWORK ACCURATELY WITH INTERNAL SURFACES SMOOTH. SUPPORT DUCTS RIGIDLY WITH SUITABLE STRAPS, BRACES, HANGERS AND ANCHORS IN ACCORDANCE WITH SMACNA "HVAC DUCT CONSTRUCTION STANDARDS" LATEST EDITION. DUCT HANGERS SHALL BE OF THE TYPE WHICH WILL HOLD DUCTS TRUE-TO-SHAPE AND TO PREVENT BUCKLING. SUPPORT VERTICAL DUCTS AT EVERY FLOOR. 2) AUXILIARY STEEL: PROVIDE AUXILIARY STEEL AS REQUIRED TO ADEQUATELY SUPPORT DUCTWORK.

3) ROUTING: LOCATE DUCTWORK RUNS, EXCEPT AS OTHERWISE INDICATED, VERTICALLY AND HORIZONTALLY AND AVOID DIAGONAL RUNS WHEREVER POSSIBLE. LOCATE RUNS AS INDICATED BY DIAGRAMS, DETAILS AND NOTATIONS OR, IF NOT OTHERWISE INDICATED, RUN DUCTWORK IN SHORTEST ROUTE WHICH DOES NOT OBSTRUCT USABLE SPACE OR BLOCK ACCESS FOR SERVICING BUILDING AND ITS EQUIPMENT. HOLD DUCTS CLOSE TO WALLS, OVERHEAD CONSTRUCTION, COLUMNS, AND OTHER STRUCTURAL AND PERMANENT ENCLOSURE ELEMENTS OF BUILDING. WHEREVER POSSIBLE IN FINISHED AND OCCUPIED SPACES, CONCEAL DUCTWORK FROM VIEW, BY LOCATING IN MECHANICAL SHAFTS, HOLLOW WALL CONSTRUCTION OR ABOVE SUSPENDED CEILINGS. DO NOT ENCASE HORIZONTAL RUNS IN SOLID PARTITIONS, EXCEPT AS SPECIFICALLY SHOWN. COORDINATE LAYOUT WITH SUSPENDED CEILING AND LIGHTING LAYOUTS AND SIMILAR FINISHED WORK.

MECHANICAL SPECIFICATIONS (CONTINUED)

4) DO NOT ROUTE DUCTWORK THROUGH ELECTRICAL EQUIPMENT SPACES AND ENCLOSURES, UNLESS INDICATED OTHERWISE.

a) WHERE DUCTS PASS THROUGH INTERIOR PARTITIONS OR EXTERIOR WALLS, AND ARE EXPOSED TO VIEW, CONCEAL SPACE BETWEEN OPENING AND DUCT OR DUCT INSULATION WITH SHEET METAL FLANGES OF SAME GAGE AS DUCT. OVERLAP OPENING ON 4 SIDES BY AT LEAST 1-1/2". FASTEN TO DUCT AND WALL.

b) WHERE DUCTS PASS THROUGH FIRE-RATED FLOORS, WALLS, OR PARTITIONS, PROVIDE FIRESTOPPING BETWEEN DUCT AND WALL

6) COORDINATION: COORDINATE DUCT INSTALLATIONS WITH INSTALLATION OF ACCESSORIES, DAMPERS, COIL FRAMES, EQUIPMENT, CONTROLS, AND OTHER ASSOCIATED WORK OF THE DUCTWORK

7) INSTALLATION: INSTALL METAL DUCTWORK IN ACCORDANCE WITH SMACNA "HVAC DUCT CONSTRUCTION STANDARDS", LATEST EDITION. F. EQUIPMENT CONNECTIONS:

1) CONNECT METAL DUCTWORK TO EQUIPMENT AS INDICATED, PROVIDE FLEXIBLE CONNECTION FOR EACH DUCTWORK CONNECTION TO EQUIPMENT MOUNTED ON VIBRATION ISOLATORS, AND/OR EQUIPMENT CONTAINING ROTATING MACHINERY. PROVIDE ACCESS DOORS AS REQUIRED G. SEAL ALL CONCEALED DUCTWORK JOINTS WITH NON-HARDENING, NON-MIGRATING MASTIC SEALANT, AS

RECOMMENDED FOR SEALING SEAMS AND JOINTS IN DUCTWORK. OIL BASE CAULKING AND GLAZING COMPOUNDS SHALL NOT BE ACCEPTABLE. DUCTS SHALL BE SEALED TO THE CLASS LEVEL LISTED BELOW. 1) UNCONDITIONED SPACES CLASS B CLASS A CLASS C CLASS B 2) CONDITIONED SPACES (PLENUM) CLASS C CLASS B CLASS B CLASS C SUPPLY < 2" M.C. SUPPLY > 2" M.C. EXHAUST RETURN

12. FLEXIBLE DUCT:

5) PENETRATIONS:

A. ATCO #086 (R-6), OR EQUAL. B. FACTORY APPLIED INSULATION AND VAPOR BARRIER, 1-1/2" THICK.

C. MAXIMUM LENGTH OF 5'-O". 13. FLUES AND ACCESSORIES:

LINE SERVICE VALVES.

C. SAFETY CONTROLS SHALL INCLUDE:

A. FLUE FOR GAS FIRED CONDENSING WATER HEATER OR FURNACE SHALL BE AS RECOMMENDED BY THE GAS APPLIANCE MANUFACTURER. FLUES SHALL BE SCHEDULE 40, PVC OR CPVC PIPE PER THE MANUFACTURERS INSTALLATION REQUIREMENTS.

B. PROVIDE MANUFACTURER'S STANDARD ACCESSORY ITEMS INCLUDING BIRD PROOF TOP, STORM COLLAR, ROOF THIMBLE, ETC. AS REQUIRED FOR A COMPLETE INSTALLATION. ROOF THIMBLES THROUGH THE BUILDING ROOF SHALL BE SUITABLE FOR USE WITH THE ROOF PROVIDED. 14. EXHAUST FANS:

A. CENTRIFUGAL CEILING EXHAUSTERS SHALL BE ELECTRICALLY POWERED CENTRIFUGAL TYPE FAN SUITABLE FOR MOUNTING IN THE CEILING WITH A PERFORATED OFF-WHITE METAL GRILLE WITH A THUMBSCREW ATTACHMENT FOR EASY ACCESS TO FAN HOUSING. UNIT SHALL CONSIST OF A GALVANIZED STEEL HOUSING LINED WITH ACOUSTICAL INSULATION AND SHALL INCLUDE AN INTEGRAL BACKDRAFT DAMPER ON FAN DISCHARGE. MOTOR SHALL BE A PERMANENT SPLIT-CAPACITOR TYPE MOTOR, PERMANENTLY LUBRICATED, WITH THERMAL OVERLOAD PROTECTION. PROVIDE DISCONNECT SWITCH OR OTHER MEANS OF DISCONNECT AT MOTOR IN FAN HOUSING.

A. UNIT SHALL BE FACTORY-ASSEMBLED AND TESTED, DESIGNED FOR ROOF INSTALLATION, AND SHALL CONSIST OF SCROLL TYPE COMPRESSOR(S), CONDENSERS, EVAPORATOR COILS, THERMAL EXPANSION VALVE, CONDENSATE DRAIN PAN, CONDENSER AND EVAPORATOR FANS, CONDENSER FANS TO BE SEQUENCED. REFRIGERATION CONTROLS, GAS FIRED HEAT EXCHANGER OR ELECTRIC HEATING SECTION, FILTERS, AND DAMPERS. CAPACITIES AND ELECTRICAL CHARACTERISTICS SHALL BE AS SCHEDULED ON THE DRAWINGS. B. COMPRESSOR(S): UNIT SHALL INCLUDE VIBRATION ISOLATORS AND CRANKCASE HEATER. REFRIGERANT CIRCUIT SHALL INCLUDE A FILTER DRYER, SIGHT GLASS, COMPRESSOR SERVICE VALVES, AND LIQUID

a) LOW PRESSURE CUTOUT, MANUAL RESET. b) HIGH PRESSURE CUTOUT MANUAL RESET c) COMPRESSOR MOTOR OVERLOAD PROTECTION, MANUAL RESET. d) ANTI-RECYCLING TIMING DEVICE. e) ADJUSTABLE LOW-AMBIENT LOCKOUT. f) OIL PRESSURE SMITCH D. REFRIGERANT COIL: ALUMINUM FINS BONDED TO SEAMLESS COPPER TUBE BY MEANS OF MECHANICAL

EXPANSION. AN EQUALIZING TYPE VERTICAL DISTRIBUTOR SHALL ENSURE EACH COIL CIRCUIT

RECEIVES THE SAME AMOUNT OF REFRIGERANT E. ECONOMIZER SHALL CONSIST OF RETURN AIR DAMPER, OUTDOOR AIR DAMPER, AND BAROMETRIC RELIEF DAMPER. PROVIDE POWERED EXHAUST FAN WITH MANUFACTURER'S STANDARD CONTROLS FOR UNITS SCHEDULED ON THE DRAWINGS.

F. GAS HEAT: INDIRECT FIRED, GAS HEAT EXCHANGER, AUTOMATIC SPARK IGNITION, MANUFACTURER'S STANDARD GAS TRAIN WITH REGULATOR (IF REQUIRED), AGA APPROVED. VERIFY GAS SERVICE PRESSURE TO INDIVIDUAL ROOFTOP UNITS. G. ROOFTOP UNITS SHALL BE WIRED TO SHUTDOWN ON A SIGNAL FROM THE SMOKE DETECTORS AND SHALL AUTOMATICALLY RESET WHEN THE SMOKE DETECTORS ARE RESET.

16. NOT USED.

17. SMOKE DETECTORS: A. UNITS MOUNTED IN THE DUCTWORK SHALL BE A DUCT MOUNTED UL LISTED PHOTO-ELECTRIC SELF-

CONTAINED SMOKE DETECTOR WITH HOUSING. UNITS SHALL BE EQUAL TO SIMPLEX #4098-9687. THE SAMPLING TUBE SHALL BE #2098-9804, LENGTH AS REQUIRED FOR DUCT. B. DUCT DETECTOR REMOTE TEST STATION SHALL BE SIMPLEX #4098-9842 WITH REMOTE ALARM INDICATOR, POWER-ON INDICATOR, TONE-ALERT, TONE-ALERT SILENCE SWITCH, AND TEST/RESET SWITCH.

1) DEVICES SHALL BE MOUNTED IN APPROVED LOCATION AS INDICATED ON THE FLOOR PLANS OR AS DIRECTED BY LOCAL AUTHORITY HAVING JURISDICTION. C. PROVIDE AND INSTALL A PHOTO-ELECTRIC SMOKE DETECTOR IN THE RETURN AIR DUCT FOR EACH HVAC UNIT AS INDICATED ON THE FLOOR PLANS. DETECTORS ARE TO BE PROVIDE WITH A SUB-BASE CONTAINING AUXILIARY RELAY CONTACTS. RELAY CONTACTS SHALL BE WIRED INTO UNIT CONTROL WIRING, SO AS TO SHUT UNIT DOWN IN THE CASE OF SMOKE DETECTION. PROVIDE ALL

CONTROL WIRING. ELECTRICAL CONTRACTOR SHALL PROVIDE 120 VOLT POWER TO EACH DETECTOR

D. SMOKE DETECTORS SHALL BE INTERLOCKED. IN ALARM CONDITION OF A SINGLE DETECTOR ALL UNITS SHALL SHUT DOWN. A. ELECTRICAL WIRING AND WIRING CONNECTIONS REQUIRED FOR THE INSTALLATION OF THE TEMPERATURE

CONTROL SYSTEM, SHALL BE PROVIDED BY THIS CONTRACTOR, UNLESS SPECIFICALLY SHOWN ON THE ELECTRICAL DRAWINGS OR SPECIFICATIONS. B. INSTALL CONTROL WIRING, WITHOUT SPLICES BETWEEN TERMINAL POINTS, COLOR CODED. INSTALL IN NEAT MORKMANLIKE MANNER, SECURELY FASTENED. INSTALL IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE AND THE ELECTRICAL SPECIFICATIONS.

1) INSTALL CIRCUITS OVER 25 VOLT WITH COLOR CODED NUMBER 12 WIRE

2) INSTALL CIRCUITS UNDER 25 VOLT WITH COLOR CODED NUMBER 18 WIRE WITH 0.031 INCH HIGH TEMPERATURE 105 DEGREES F PLASTIC INSULATION ON EACH CONDUCTOR AND PLASTIC SHEATH OVER 3) INSTALL ELECTRONIC CIRCUITS WITH COLOR CODED NUMBER 22 WIRE WITH 0.023 INCH POLYETHYLENE INSULATION ON EACH CONDUCTOR WITH PLASTIC JACKETED COPPER SHIELD OVER

4) INSTALL LOW VOLTAGE CIRCUITS, LOCATED IN CONCRETE SLABS AND MASONRY WALLS, OR EXPOSED IN OCCUPIED AREAS, IN ELECTRIC CONDUIT. 5) ALL MIRING IN AREAS USED AS AIR PLENUMS SHALL BE IN ELECTRIC CONDUIT EXCEPT THAT LOW VOLTAGE WIRING MAY BE TEFLON COATED, ALUMINUM SHEATHED CABLE OR OTHER WIRE SPECIFICALLY APPROVED FOR INSTALLATION IN AIR PLENUMS, WHERE ACCEPTABLE BY LOCAL

6) ALL WIRING IN AREAS NOT USED FOR AIR MOVEMENT SHALL BE IN ELECTRIC METALLIC TUBING EXCEPT LOW VOLTAGE WIRING MAY BE IN APPROVED SIGNAL CABLE WHERE ACCEPTED BY LOCAL

C. THERMOSTATIC CONTROLS TO HAVE A 5°F DEADBAND AND SETPOINT OVERLAP RESTRICTIONS. 1) TEMPERATURE CONTROLS SETBACK TO BE 55°F (HEAT) AND 85° (COOL) 2-HOUR OCCUPANT OVERRIDE, 10-HOUR BACKUP.

BC PROJECT #: 22323 MISSOURI PE COA #2009003629 an instrument of service by the Designer/Engineer and is intended for use on this project only. Pur to the Architectural Works Copyright Protection Act of 1990, all drawings, specifications, ideas and designs, including the overall form, arrangement and composition of spaces and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or sclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2023 BC Engineers, Inc.

INCORPORATED 5720 Reeder Shawnee, Ks. 66203 (913)262-17

erchitecture & engineering 4301 Indian Creek Parkway Overland Park, KS 66207 phone: 913.451.9390

fex: 913.451.9391

www.davidsonae.com


1/26/2023 KNUDSEN


05.19.22 drawn by MA/FS checked by

EK/DS 12.22.22 01.26.23 REV 2

sheet number

drawing type project number

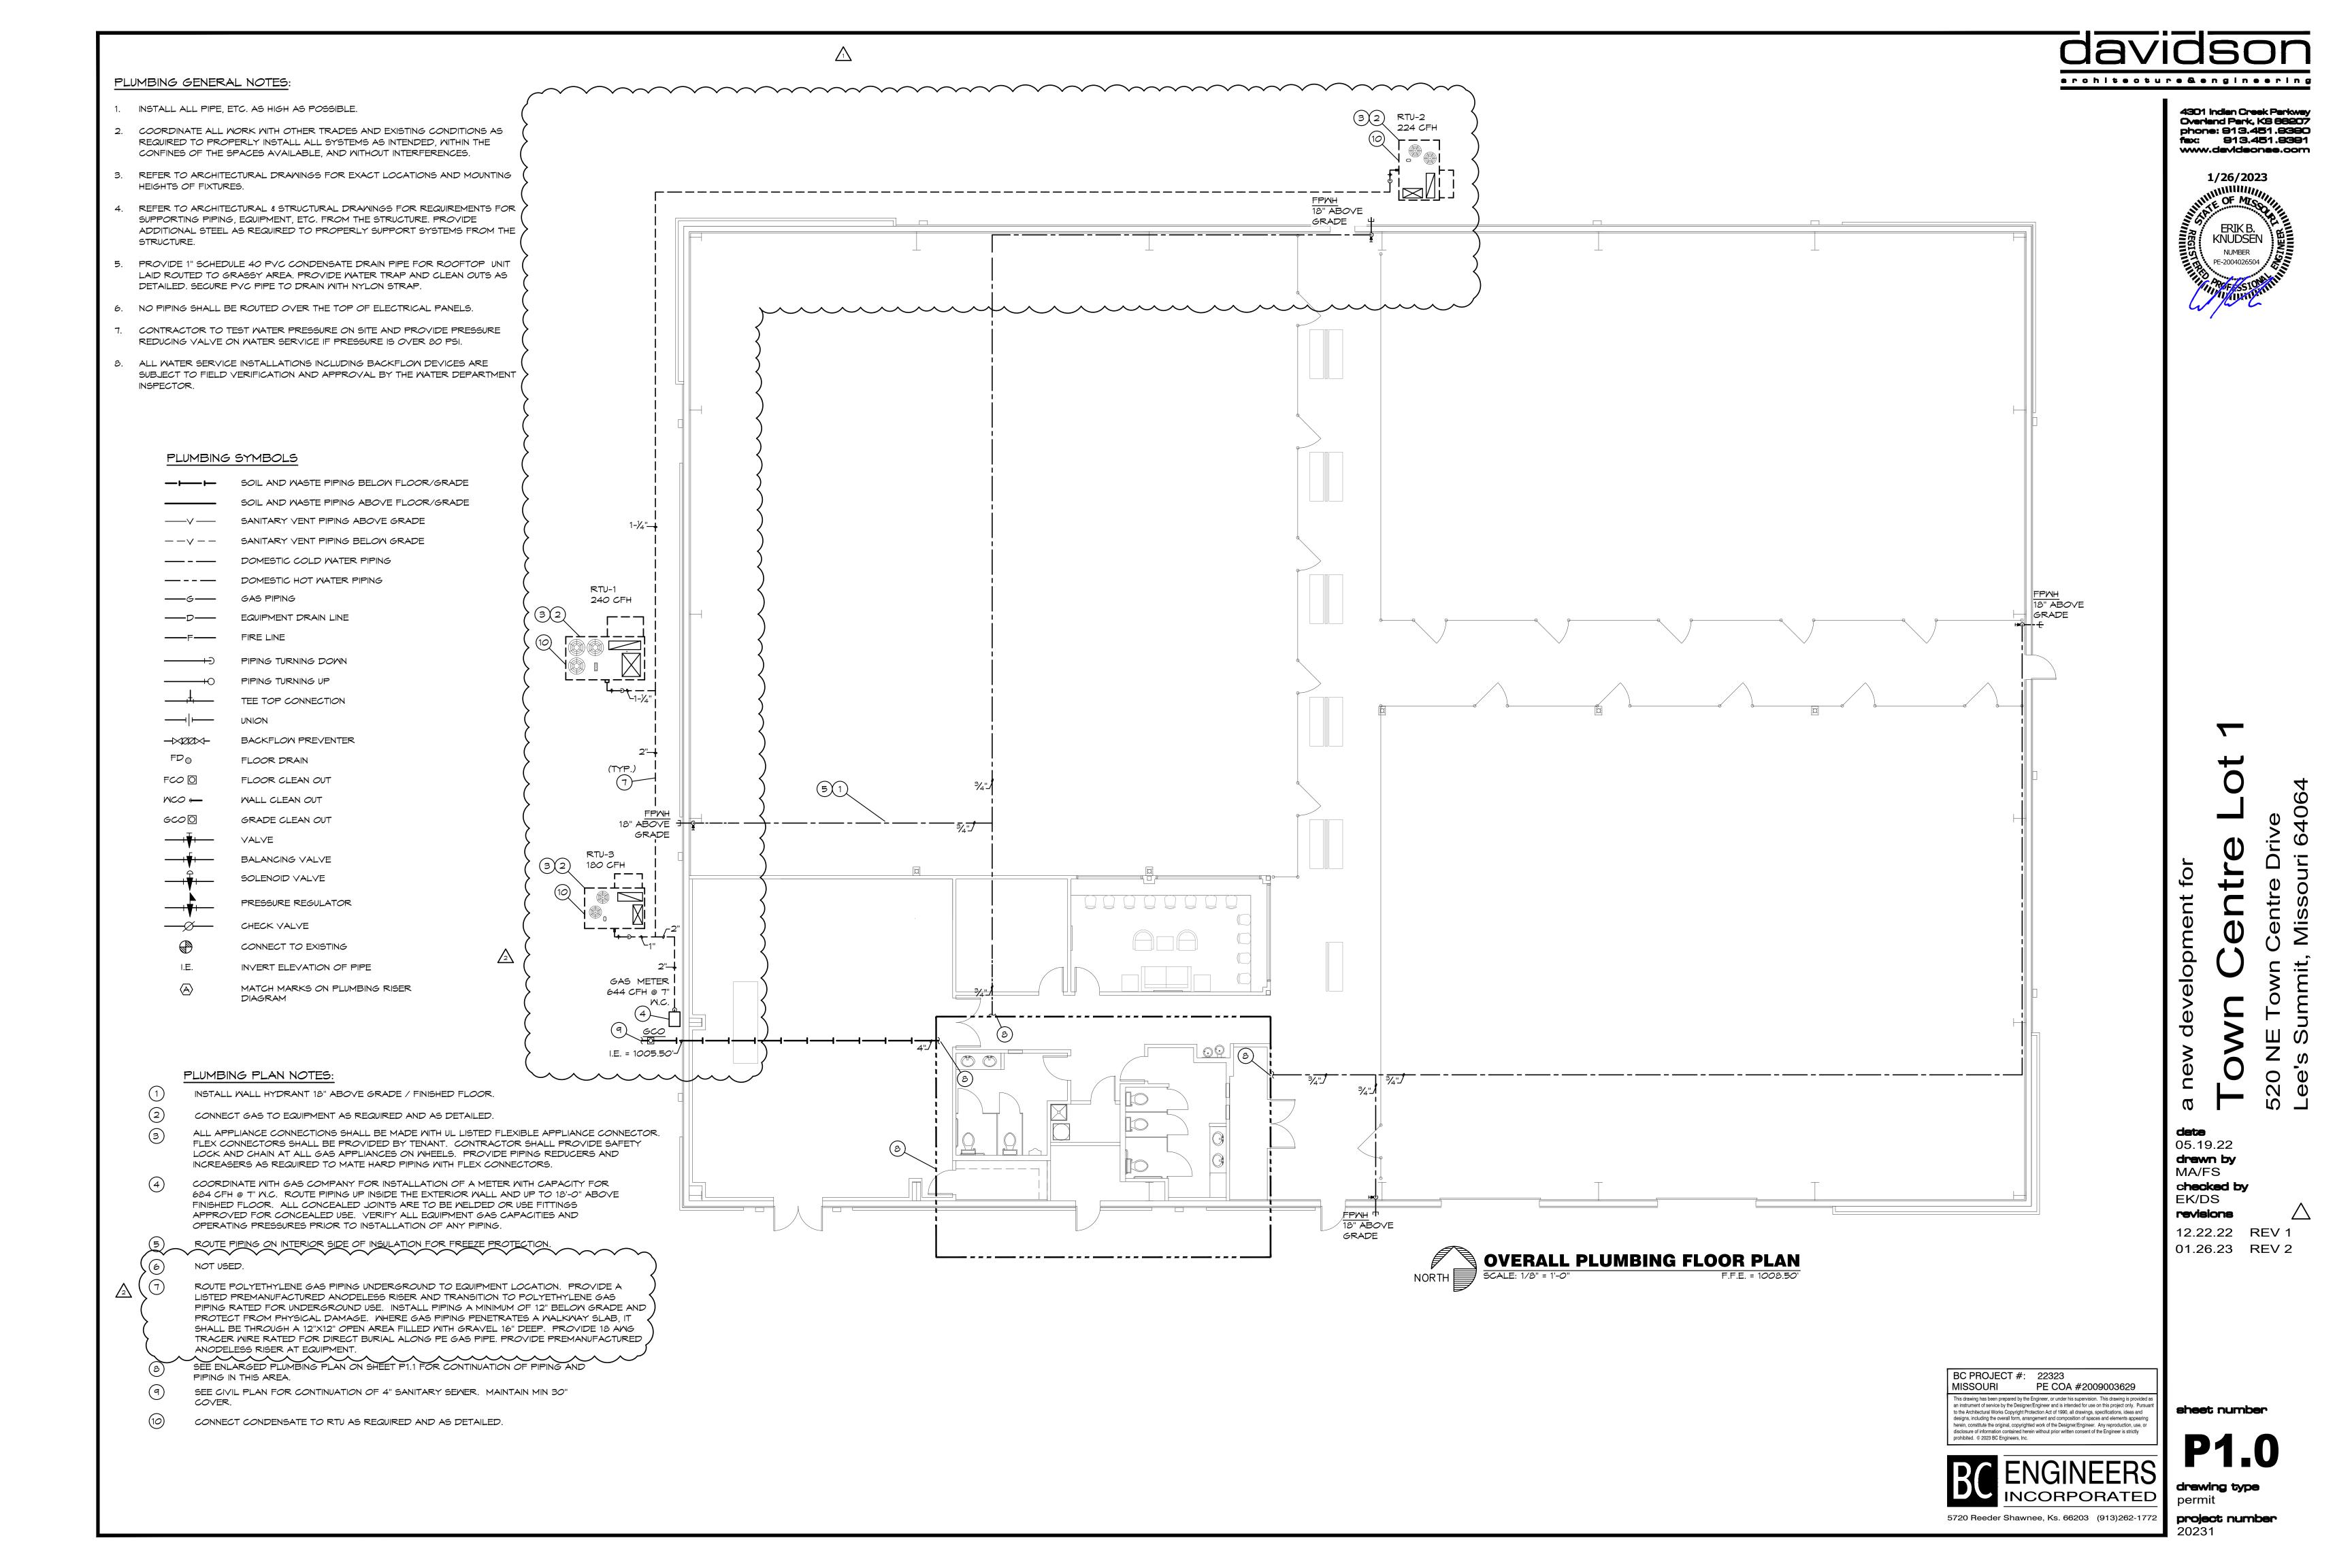

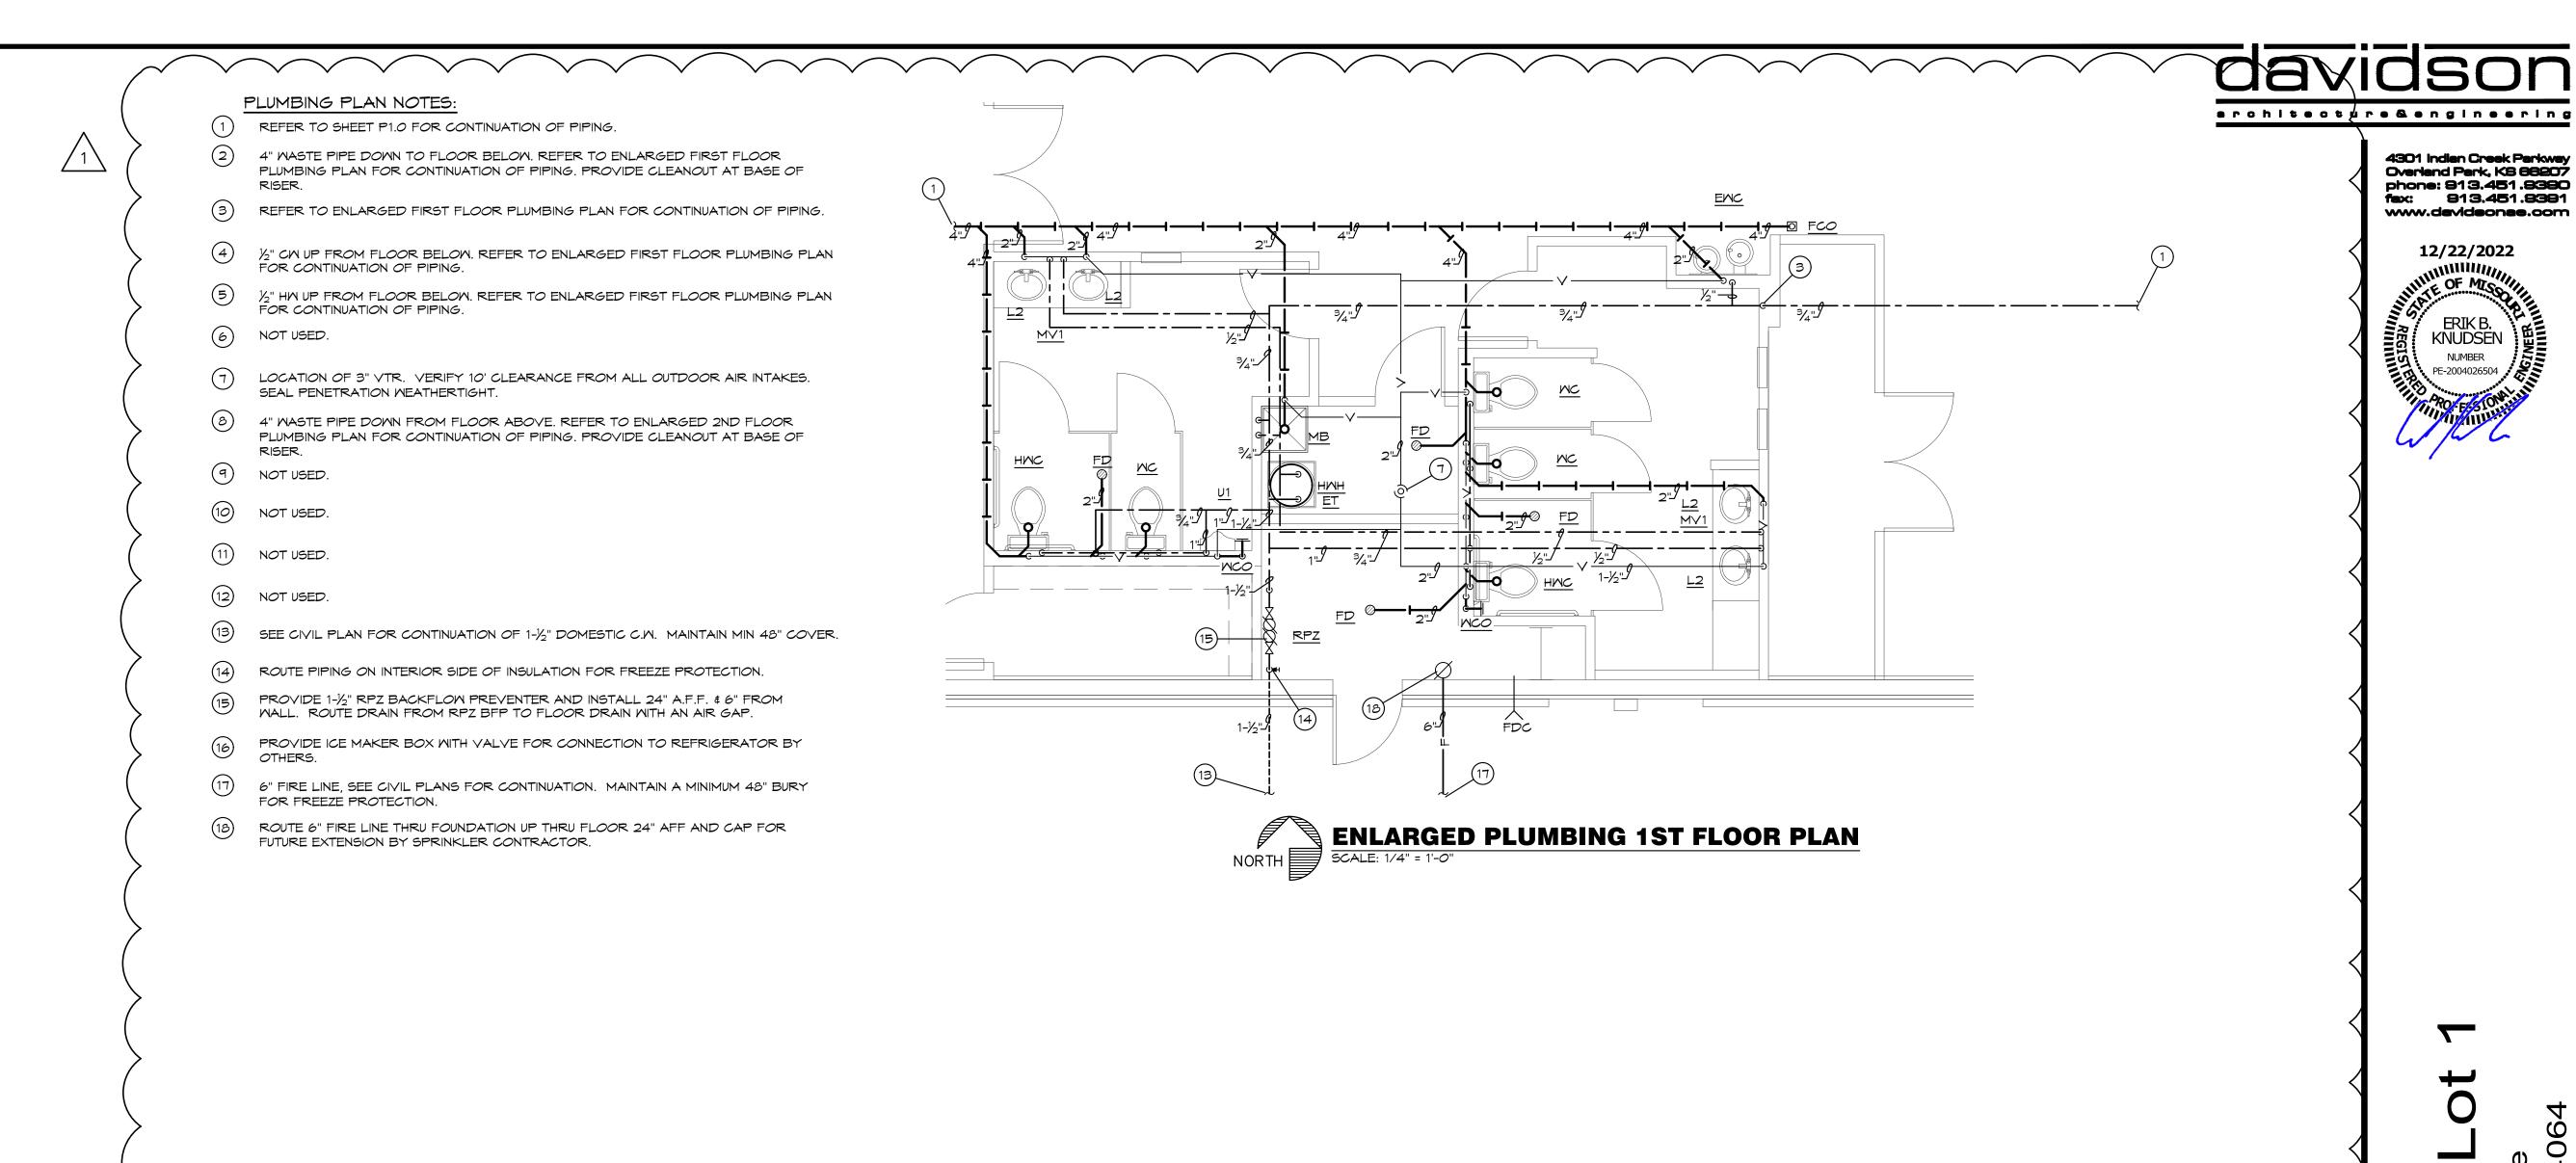

BC PROJECT #: 22323 MISSOURI PE COA #2009003629 This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on this project only. Pursuant to the Architectural Works Copyright Protection Act of 1990, all drawings, specifications, ideas and designs, including the overall form, arrangement and composition of spaces and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2022 BC Engineers, Inc.



sheet number

development

dete 05.19.22 drewn by MA/FS

EK/DS revisions

checked by


12.20.22 REV 1

4301 Indian Creek Parkway Overland Park, K8 88207 phone: 913.451.9380 fax: 913.451.9380

www.davidsonae.com

12/22/2022

permit project number

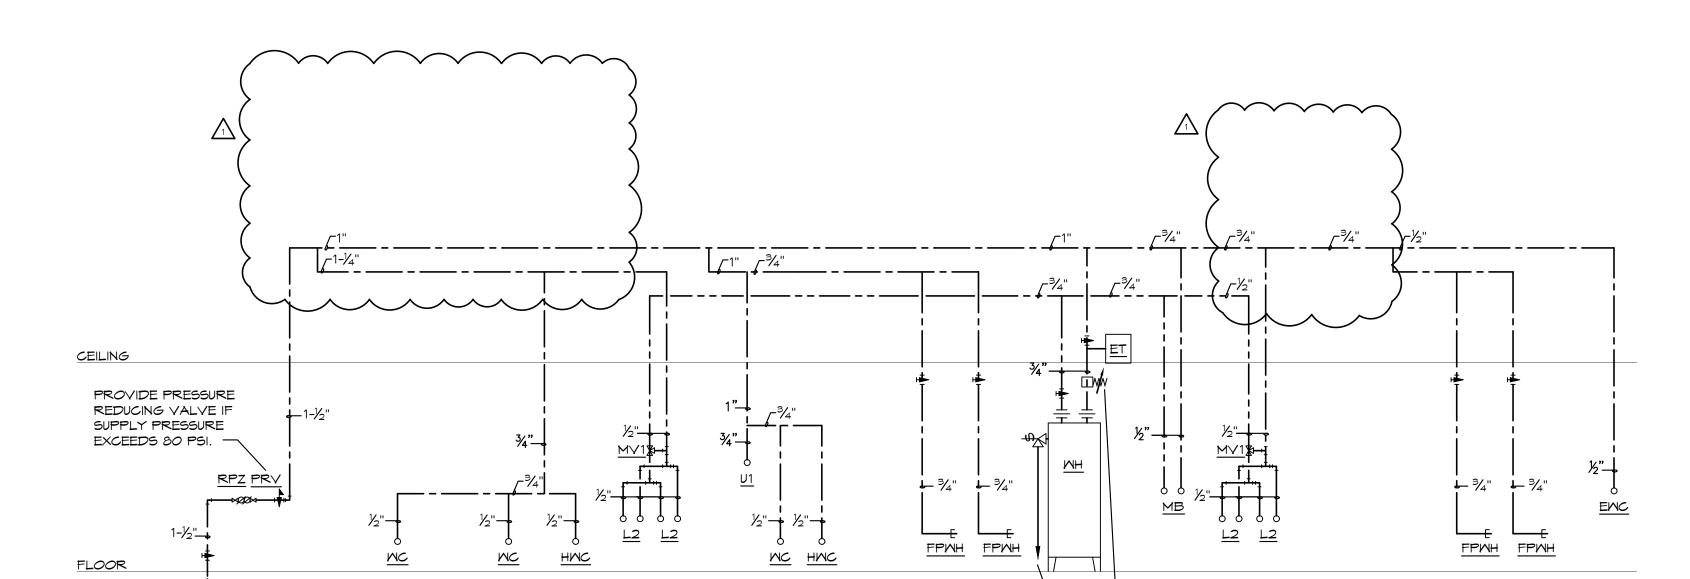

VACUUM RELIEF VALVE

TERMINATE ASME RELIEF VALVE

FLOOR DRAIN WITH AIR GAP.

DISCHARGE PIPE (FULL SIZE) OVER

<u> </u>	3" VTR
ROOF_	3"
>	
>	
CEILING	
> >	
<del>-</del> 2" <del>-</del> 2	
FLOOR GCO HMC F	$\frac{1}{2}  \frac{1}{2}  \frac{1}{4}  \frac{1}{2}  \frac{1}{4}  \frac{1}$
REFER TO 4"J 4"J 4"J	
CIVIL 4", 4", 4",	`4"J

WASTE & VENT

PLUMBING RISER DIAGRAMS

HOT & COLD WATER

REFER TO

**≻**4−−−+

CIVIL

PLUMBING FIXTURE BRANCH	PIPINO	5 SCH	HEDUL	-E
FIXTURE	MASTE	VENT	CM	HM
MATER CLOSET (TANK TYPE)	4"	2"	1/2"	
URINAL	2"	1-1/2"	3/4"	
LAVATORY	1-1/4"	1-1/4"	1/2"	1/2"
SINK	1-1/2"	1-1/2"	1/2"	1/2"
FLOOR DRAIN	2"	2"		
MOP BASIN	2"	2"	1/2"	1/2"
ELECTRIC WATER COOLER (BI-LEVEL)	1-1/2"	1-1/2"	1/2"	

NOTE: INDIVIDUAL VENTS FOR FIXTURES ON PLANS AND RISER DIAGRAMS HAVE BEEN INCREASED WHERE HORIZONTAL VENT LENGTH IS IN EXCESS OF THE MAXIMUM DISTANCE INDICATED BY THE CODE.

PIPE HANG	ER SCHEI	DULE		
PIPE MATERIAL	MAXIMUM HANGER SPACING	HANGER ROD DIAMETER		
ABS (All sizes)	4'	3/8"		
PVC (All Sizes)	4'	3/8"		
CPVC, 1 inch and smaller	3'	1/2"		
CPVC, 1-1/4 inches and larger	4'	1/2"		
Cast Iron (All Sizes)	5'	5/8"		
Cast Iron (All Sizes) with 10 foot length of pipe	10'	5/8"		
Copper Tube, 1-1/4 inches and smaller	6'	1/2"		
Copper Tube, 1-1/2 inches and larger	10'	1/2"		
Steel, 3 inches and smaller	12'	1/2"		
Steel, 4 inches and larger	12'	5/8"		
Pex, 1" and below without support channel	32"	3/8"		
Pex, 1-1/4" and above without support channel	48"	3/8"		
Pex ¾" and below with support channel	6'	3/8"		
Pex 1" and above with support channel	පි'	3/8"		

## PLUMBING FIXTURE SCHEDULE:



HANDICAP WATER CLOSET: TOTO, #CST744EL(R)N, "DRAKE CLOSE COUPLED TOILET", 1.28 GALLON FLUSH, 16-1/2" HIGH ELONGATED BOWL, FLOOR MOUNTED, FLOOR OUTLET, TANK TYPE, VITREOUS CHINA, SIPHON-JET ACTION, #5C534 OPEN FRONT SEAT WITH CHECK HINGE AND LESS COVER, CHROME PLATED ANGLE STOP AND RISER. HANDLE ON WIDE SIDE OF FIXTURE.

MC WATER CLOSET: TOTO, #CST744E(R)(G)N, "DRAKE CLOSE COUPLED TOILET", 1.28 GALLON FLUSH, ELONGATED BOWL, FLOOR MOUNTED, FLOOR OUTLET, TANK TYPE, VITREOUS CHINA, SIPHON-JET ACTION, #SC534 OPEN FRONT SEAT WITH CHECK HINGE AND LESS COVER, CHROME PLATED ANGLE STOP AND RISER.

NOT USED. 

HANDICAP LAVATORY, COUNTERTOP: TOTO, #LT501, VITREOUS CHINA,20"X 17" OVAL BASIN, DELTA #501 FAUCET WITH SINGLE METAL LEVER HANDLE, OFFSET GRID DRAIN WITH 1-1/4" TAILPIECE, CHROME PLATED P-TRAP(MOUNTED PARALLEL WITH WALL), CHROME PLATED ANGLE STOPS AND RISERS, INSULATE EXPOSED DRAIN, WATER SUPPLIES, AND VALVES WITH PROWRAP SEAMLESS MOLDED CLOSED CELL VINYL

URINAL, WALL HUNG: TOTO, #UT447.01, VITREOUS CHINA, WASH OUT, WALL HUNG URINAL WITH 3/4" TOP SPUD, #TMU1NNC-12 FLUSH VALVE, FLOOR MOUNTED FIXTURE SUPPORT. SET RIM HEIGHT PER ARCHITECTURAL DRAWINGS.
NOT USED.

MOP BASIN: FIAT, #MSB-2424, MOLDED STONE MOP BASIN, 2" DRAIN, 24"X 24" BASIN, VINYL BUMPER GUARD, STERN WILLIAMS #T-10-VB FAUCET, SPRING CHECKS, VACUUM BREAKER, INTEGRAL STOPS, WALL BRACE & PAIL HOOK, WALL BRACKET WITH 30"

EMC ELECTRIC WATER COOLER: OASIS, #PG8ACSL, BARRIER FREE TWO-STATION WATER COOLER, 8.0 GPH, 50 DEGREES F WATER WITH 90 DEGREES F AIR TEMPERATURE, 120 VOLT, COLOR TO BE SELECTED BY ARCHITECT AFTER AWARD OF CONTRACT, FRONT AND SIDE ANTIMICROBIAL PUSH PADS, ANITMICROBIAL FLEX BUBBLERS, CHROME PLATED CAST BRASS P-TRAP WITH CLEANOUT, CHROME PLATED LOOSE KEY ANGLE STOP, FLOOR MOUNTED CARRIER AND CANE APRON.

FLOOR DRAIN: SIOUX CHIEF, #842, PVC FLOOR DRAIN WITH ADJUSTABLE TOP AND CAST BRASS STRAINER.

HOT WATER HEATER: AO SMITH #DEL-40, 40 GALLON STORAGE, 208 VOLT, SINGLE PHASE, (2) 4500 WATT ELEMENT, NON-SIMULTANEOUS, ASME TEMPERATURE AND PRESSURE RELIEF VALVE. SET TEMPERATURE TO 120°F.

HOT WATER EXPANSION TANK: AMTROL, #5T-8, 3.2 GALLON EXPANSION TANK WITH DIAPHRAGM. MY NOT USED.

MIXING VALVE: WATTS, #LFMMV THERMOSTATIC CONTROLLED MIXING VALVE,LEAD FREE BRONZE BODY, LOCKED TEMPERATURE ADJUSTMENT CAP (VANDAL RESISTANT), SOLID WAX HYDRAULIC PRINCIPLE THERMOSTAT, INTEGRAL FILTER WASHERS AND CHECK VALVES ON HOT AND COLD INLETS.(SET TO 110°F) ASSE #1017,#1069,#1070


REDUCED ZONE PRESSURE BACKFLOW PREVENTOR: WATTS #LF009, LEAD FREE BRONZE BODY CONSTRUCTION, TWO, IN-LINE INDEPENDENT CHECK VALVES, REPLACEABLE CHECK SEATS WITH AN INTERMEDIATE RELIEF VALVE, AND BALL

VALVE TEST COCKS. NOT USED. FCO/MCO VINYL TILE FLOOR: JR SMITH #4140, OR EQUAL. QUARRY TILE FLOOR: JR SMITH #4200, OR EQUAL.


CARPETED FLOOR: JR SMITH #4020-Y, OR EQUAL. UNFINISHED FLOOR: JR SMITH #4020, OR EQUAL. WALL: JR SMITH #4472, OR EQUAL, 24" ABOVE THE FLOOR.

FPWH FREEZEPROOF WALL HYDRANT: JR SMITH #5609, 3/4" SIZE, NICKEL-BRONZE FACE,

KEY OPERATED, INTEGRAL VACUUM BREAKER.

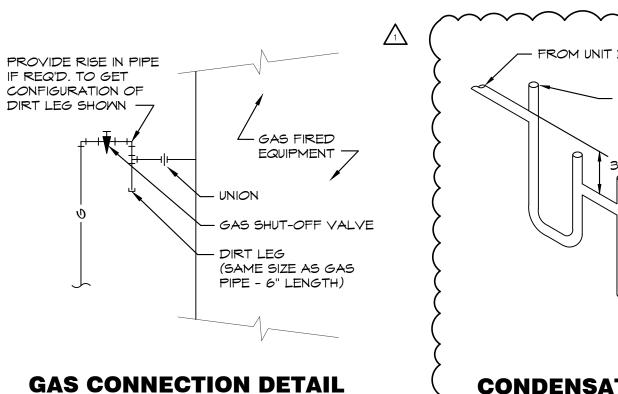

**GAS CONNECTION DETAIL** SCALE: NONE

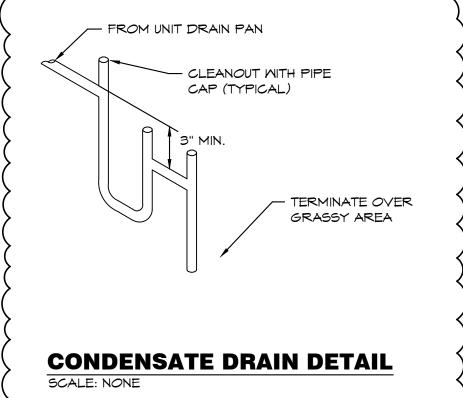

BC PROJECT #: 22323 MISSOURI PE COA #2009003629 an instrument of service by the Designer/Engineer and is intended for use on this project only. Pursu to the Architectural Works Copyright Protection Act of 1990, all drawings, specifications, ideas and designs, including the overall form, arrangement and composition of spaces and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or indexin, constitute original, copyrighted without prior written consent of the Engineer is strictly prohibited. © 2022 BC Engineers, Inc.

INCORPORATED 5720 Reeder Shawnee, Ks. 66203 (913)262-17

4301 Indian Creek Parkway Overland Park, K8 86207 phone: 913.451.9390 fex: 913.451.9391 www.devideonee.com

12/22/2022 KNUDSEN NUMBER PE-2004026504


elopme

dete 05.19.22 drewn by MA/FS checked by EK/DS revisions

12.20.22 REV 1

sheet number

drawing type permit project number

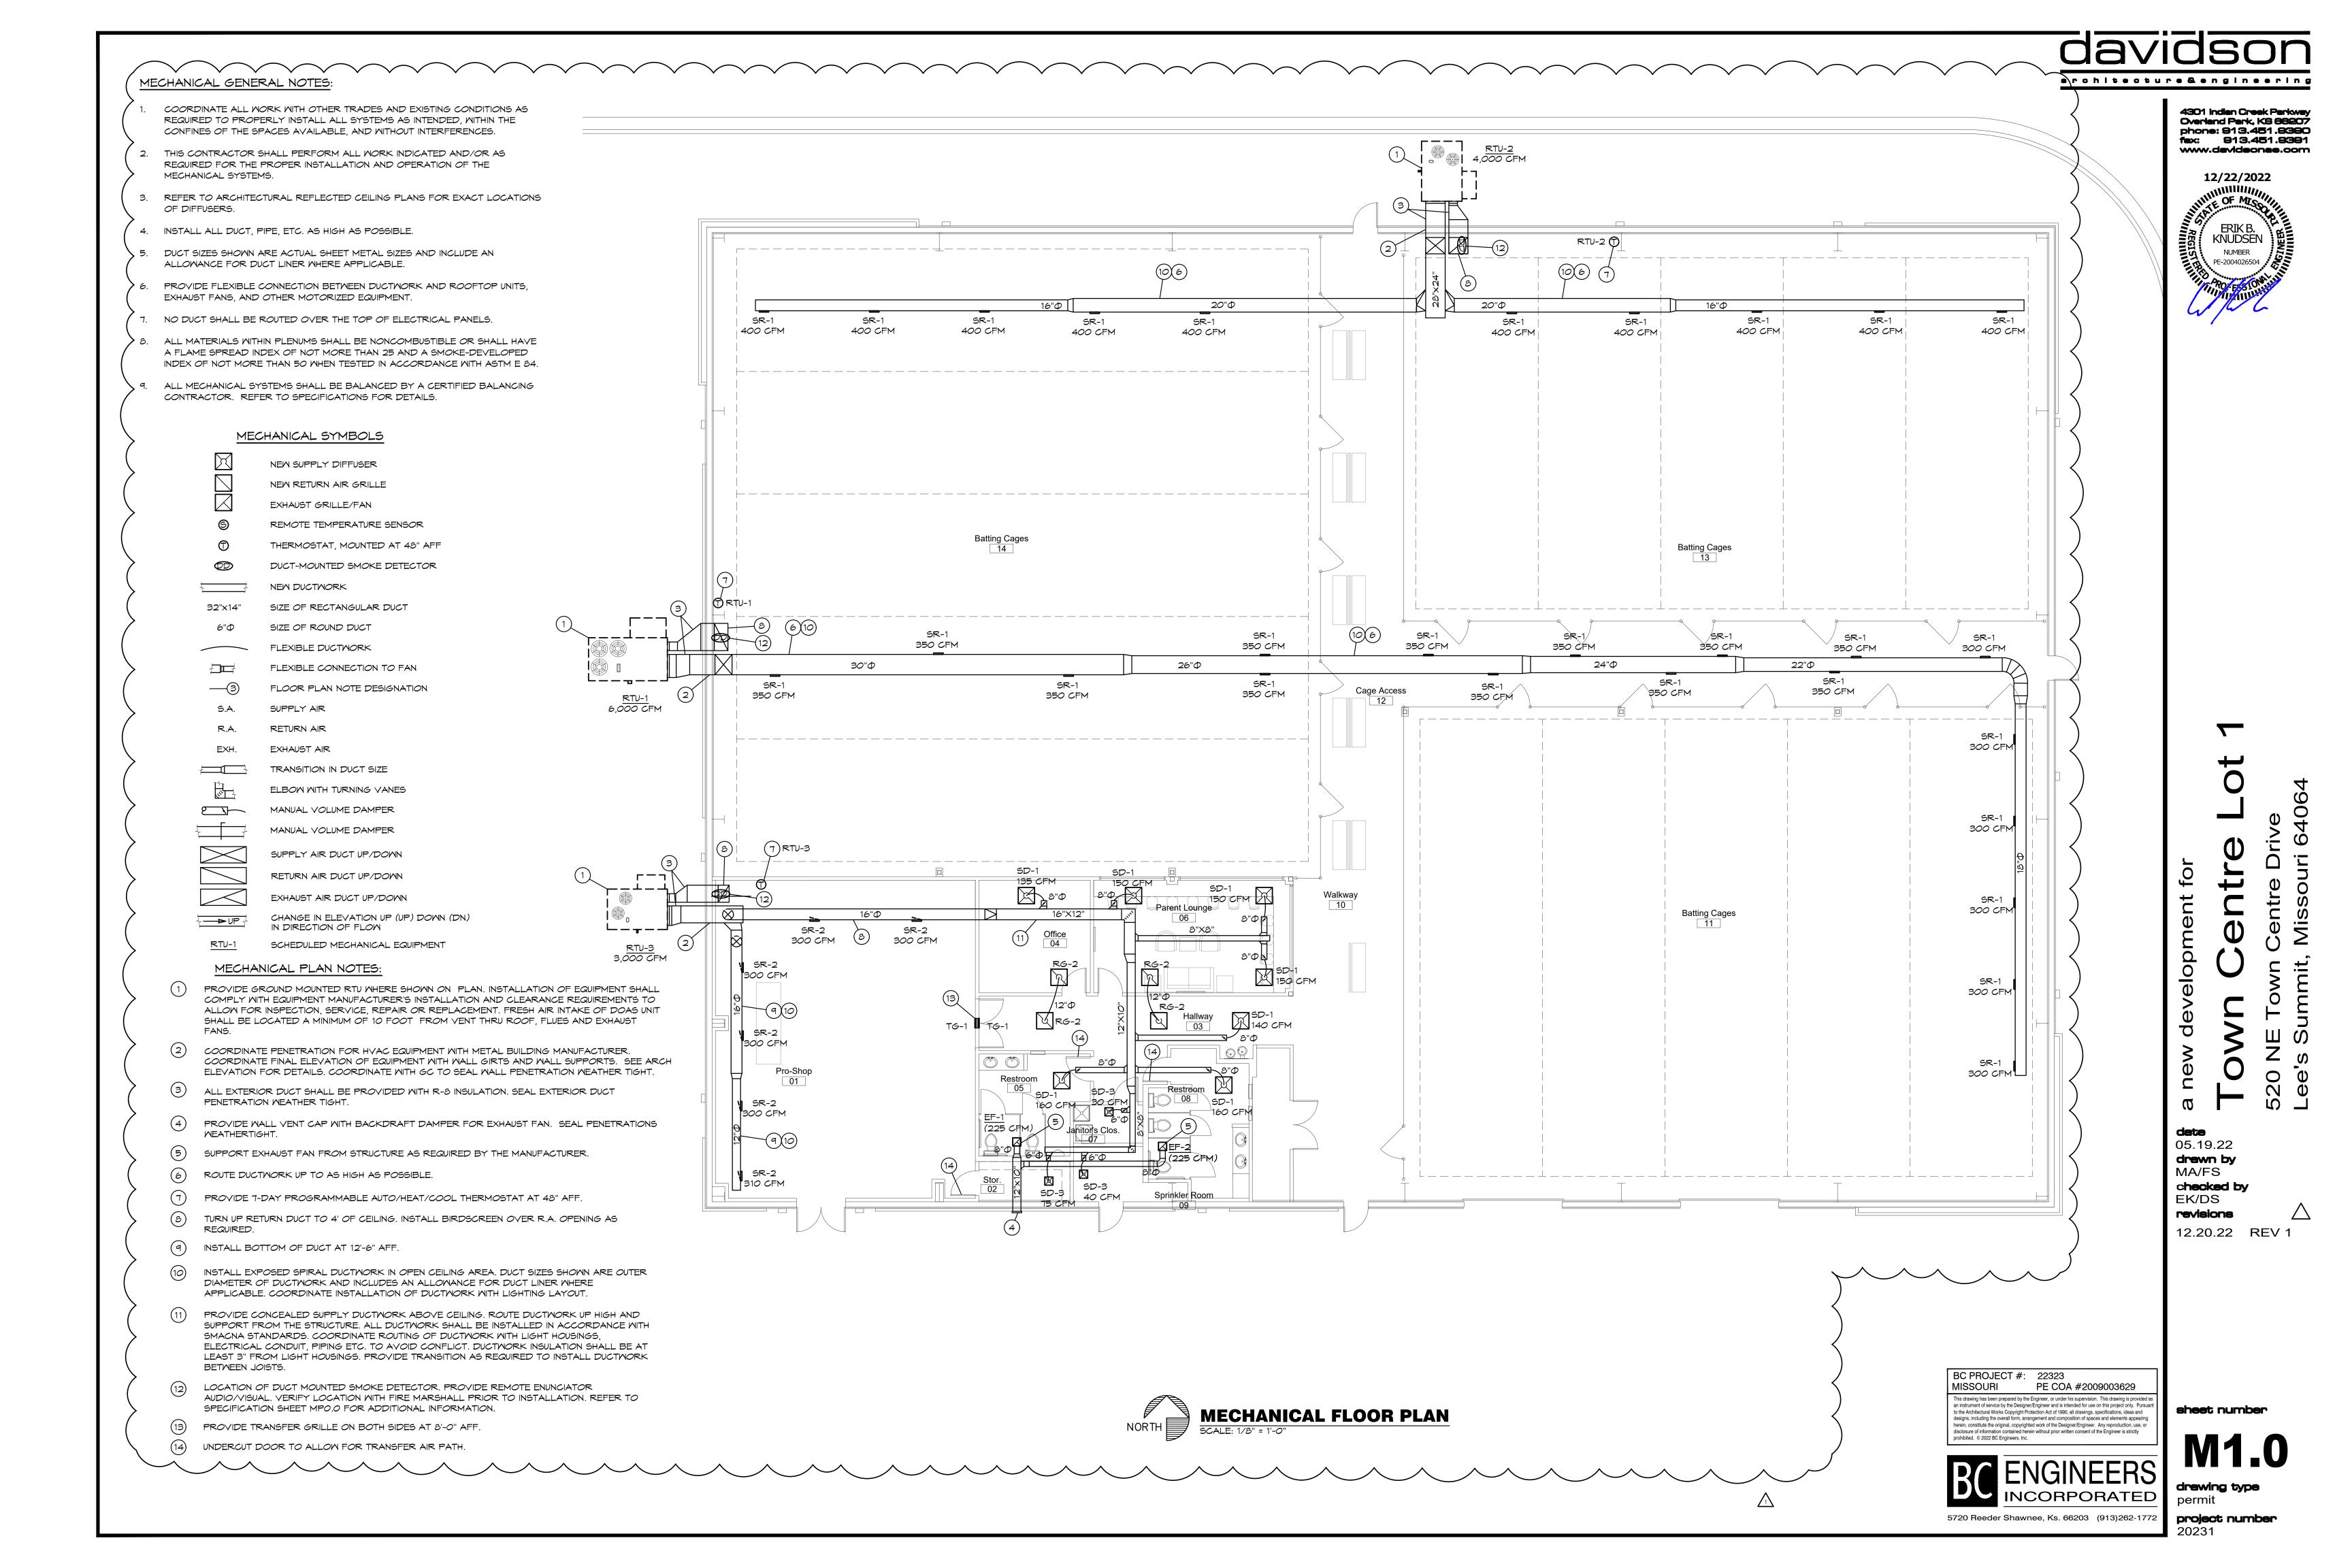



4301 Indian Creek Parkway Overland Park, K8 88207 phone: 913,451.9380 fax: 913,451.9381 www.davidsonae.com

12/22/2022

INTERIT OF MISSON

ERIK B.

KNUDSEN

NUMBER

PE-2004026504

**NOT USED** 

a new development for a series and series and a series an

sheet number

checked by

12.20.22 REV 1

EK/DS **revisions** 

BC PROJECT #: 22323
MISSOURI PE COA #2009003629

This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on this project only. Pursuant to the Architectural Works Copyright Protection Act of 1990, all drawings, specifications, ideas and designs, including the overall form, arrangement and composition of spaces and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2022 BC Engineers, Inc.





	EXHAUST FAN SCHEDULE										
				EXTERNAL	1	ELECTRIC	AL	FAN TYPE	CONTROLS		
MARK	MFGR	MODEL	CFM	STATIC P. IN. MG.	RPM	√ <i>0</i> LT/Ф/HZ	PWR			NOTES	
EF-1	COOK	GC-182	225	0.25	1,400	120/1/60	167 M	CEILING EXH.	SMITCH	1	
EF-2	<b>†</b>	<b>†</b>	•	<b>†</b>	<b>*</b>	*	*	<b>†</b>	<b>†</b>	<b>†</b>	

NOTES: 1. PROVIDE CEILING GRILLE, INTEGRAL BACK DRAFT DAMPER, VARI-SPEED CONTROLLER (NEAR FAN AND ABOVE CEILING), AND WALL CAP.


	ROOFTOP UNIT SCHEDULE																										
	NOM.	EXT. EVAP. STATIC	EXT. STATIC P.	,		COOLING		нот	HEATING (GAS)		ELECTRICAL				UNIT	BLOWER	ECONOMIZER +	BAROMETRIC RELIEF	MINIMUM	SEER	TOTAL						
MARK	MFGR.	MODEL NO.	TONS	CFM	IN. MG. (NOTE 2)	COOLING STAGES	TOTAL BTUH	SENS. BTUH	AMB.	EVAP. EAT DB/MB	GAS REHEAT	BTUH INPUT	BTUH OUTPUT	HEATING STAGES	VOLT/Ф/HZ	BLOWER MOTOR	POWER EXHAUST	MCA (AMPS)	MOCP (AMPS)	CONTROLS	DRIVE TYPE	TYPE	CONTROLLER	OUTDOOR AIR (CFM) *	/EER	MEIGHT (LBS)	NOTES
RTU-1	CARRIER	48TCED16A2A5	15	6,000	0.5	2	184,780	137,040	105	80/67	N	240,000	195,000	2	208/3/60	6.1 HP	N	71	80	DIGITAL	CAV	STANDARD	SENSIBLE	450	- / 11.2	1760	1,2,3,4,5,6
RTU-2		48TCED12A2A5	10	4,000	0.5	2	124,100	96,200	105	80/67	N	224,000	184,000	2	208/3/60	4.7 HP	N	49	60	DIGITAL	CAV	STANDARD	SENSIBLE	450	- / 11	1149	1,2,3,4,5,6
RTU-3	•	48FCEM08A2A5	7.5	3,000	0.5	2	90,000	66,020	105	80/67	N	180,000	148,000	2	208/3/60	3 HP	N	39	50	DIGITAL	CAV	STANDARD	SENSIBLE	925	- / 11.2	914	1,2,3,4,5,6


NOTES: 1. PROVIDE HINGED ACCESS DOORS, SCROLL COMPRESSORS WITH CRANKCASE HEATER, HIGH PRESSURE SWITCHES, FREEZESTAT, HAIL GUARDS. STANDARD COOLING DOWN TO 30°F. OUTDOOR AIR DAMPER TO FULLY CLOSE W/ FAN SHUTDOWN FOR ALL UNITS.

- 2. EXTERNAL STATIC PRESSURE LISTED REPRESENTS STATIC PRESSURE REQUIRED FOR DUCTWORK AND DIFFUSERS OUTSIDE THE HVAC UNIT COMPLETELY INDEPENDENT OF ANY PRESSURE DROP THROUGH THE HVAC
- EQUIPMENT INCLUDING BUT NOT LIMITED TO FILTERS, COILS AND ECONOMIZERS. THE FAN AND MOTOR SHALL BE SIZED APPROPRIATELY TO MEET THIS DEFINITION OF EXTERNAL STATIC PRESSURE.

  3. PROVIDE COMMERCIAL 7-DAY PROGRAMMABLE HEAT/COOL/AUTO CHANGEOVER TOUCHSCREEN THERMOSTAT WITH OPTIMUM START CONTROLS.
- OUTDOOR AIR DAMPER IS TO CLOSE DURING UNOCCUPIED HOURS.
- 4. PROVIDE NEW 2" MERY 8 FILTERS UPON COMPLETION OF CONSTRUCTION.
- 5. PROVIDE 14" PRE-FABRICATED GROUND MOUNTED CURB,
- 6. MECHANICAL CONTRACTOR SHALL COORDINATE ALL UNIT MOCP'S OF ACTUAL INSTALLED EQUIPMENT WITH ELECTRICAL CONTRACTOR.
- * OCCUPANCY FOR BATTING CAGES IS 30 PEOPLE. 30*30 = 900 CFM MINIMUM REQUIRED FOR BATTING CAGE AREA.


	DIFFUSER SCHEDULE												
MARK	MF	GR	MODE	L BO	ORDER TYPE	NECK SIZE	FACE SIZE	FINISH		DAMPER	ACCESSORIES	NOTES	
SD-1	TIT	ับร	TMS		3	8"Ф	24"×24"	MHIT	Έ	-	-	-	
SD-2						*	<b>†</b>			OB DAMPER	TRM KIT	-	
SD-3						6"Ф	12"x12"			-	-	-	
SD-4			<b>\</b>			*	•			OB DAMPER	TRM KIT	-	
RG-1			PAR			18"x18"	24"×24"			-	-	-	
RG-2			<b>†</b>			12"Ф	24"×24"			-	-		
SR-1			300F9	5		12"X10"	-	<b>†</b>		OB DAMPER	-		
5R-2			5300F	5		20"X4"		ANODI	ZED	FULL LENGTH VOLUME DAMPER	<u>-</u>		
TG-1	,	<u> </u>	350R	- <u> </u>	<u> </u>	-	14"×14"	MHIT	E [	<u> </u>		Ĭ,	

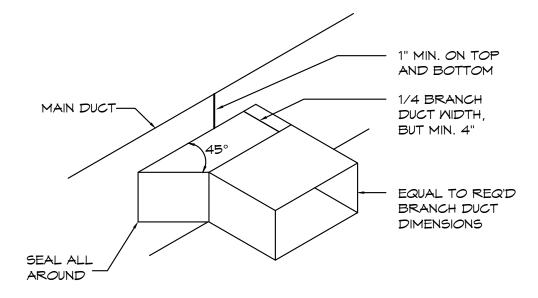

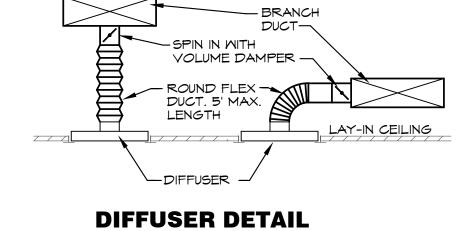


SCALE: NONE



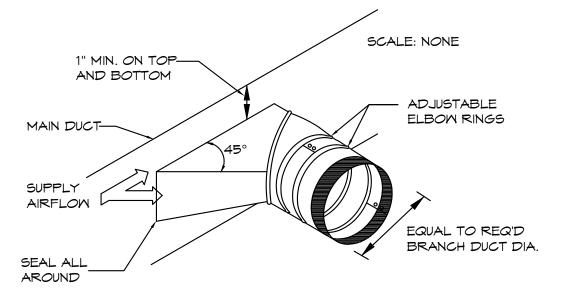

BRANCH DUCT TAKEOFF DETAIL
SCALE: NONE

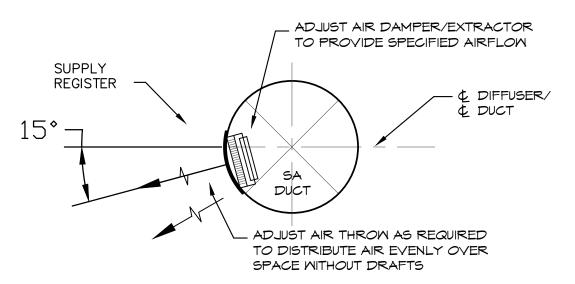

SUPPLY REGISTER DETAIL SCALE: NONE

UNIT	Area (sqft	OCCUPANCY CLASSIFICATION	Occupant Density #/1000 sqft	People outdoor airflow rate in breathing zone, (Rp) cfm/person	Area outdoor airflow rate in breathing zone, (Ra) cfm/sqft	Exhaust airflow rate cfm/sqft	Breathing zone outdoor airflow (Vbz)	Zone air distribution effectivene ss (Ez)	Zone outdoor airflow (cfm
	1230	Sales	15	7.5	0.12		286	0.8	357
	1015	Conference rooms	50	5	0.06		315	0.8	393
RTU-	3 336	Conference/meeting	50	5	0.06		104	0.8	130
	188	Office spaces	5	5	0.06		16	0.8	20
	320	Corridors	0	0	0.06		19	0.8	24
	•							Total	925

BC PROJECT #: 22323

MISSOURI PE COA #2009003629

This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on this project only. Pursuat to the Architectural Works Copyright Protection Act of 1990, all drawings, specifications, ideas and designs, including the overall form, arrangement and composition of spaces and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2022 BC Engineers, Inc.



4301 Indian Creek Parkway Overland Park, K8 88207 phone: 81 3.451 .8380 fax: 81 3.451 .8381 www.davidsonae.com

12/22/2022

INTERPORT OF MISSON

ERIK B.

KNUDSEN

NUMBER

PE-2004026504

development for Vn Centre Lot 1

date
05.19.22
drewn by
MA/FS
checked by
EK/DS
revisions
12.20.22 REV 1

sheet number

sheet number

M2.

drawing type
permit
project number
20231

## ELECTRICAL SPECIFICATIONS

### 1. GENERAL PROVISIONS

- A. PROVIDE ALL LABOR, MATERIALS, EQUIPMENT, NECESSARY FOR THE COMPLETE INSTALLATION OF THE
- B. OBTAIN ALL PERMITS, FEES, LICENSES, INSPECTIONS, AND CERTIFICATES OF COMPLIANCE OR APPROVAL AS REQUIRED BY THE AUTHORITIES
- C. ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE LATEST APPROVED EDITION OF THE NATIONAL ELECTRIC CODE (NEC), AND ALL APPLICABLE LAWS, CODES AND REGULATIONS OF THE
- D. ALL TESTING REQUIRED BY AUTHORITIES SHALL BE CONSIDERED PART OF THIS WORK.

GOVERNMENTAL BODIES HAVING JURISDICTION OVER THE SITE.

- E. DURING CONSTRUCTION, ALL FIXTURES, EQUIPMENT, CONDUIT, ETC. SHALL BE COVERED, PLUGGED, OR CAPPED AS REQUIRED TO KEEP CLEAN AND UNDAMAGED. ALL DAMAGED ITEMS SHALL BE RESTORED TO ORIGINAL CONDITION OR REPLACED. ALL PROTECTIVE COVERING SHALL BE REMOVED BEFORE FINAL
- F. PROVIDE ALL NECESSARY CUTTING AND PATCHING OF WALLS, FLOORS, CEILINGS, AND ROOFS AS NECESSARY, PATCH AROUND ALL OPENINGS SHALL MATCH ADJACENT AREA. COORDINATE ALL ROOFING WORK WITH OWNER OR RESPONSIBLE PARTY, SO THAT THE EXISTING ROOFING WARRANTY
- G. CONTRACTOR SHALL GUARANTEE ALL WORK AND MATERIALS AGAINST DEFECTS FOR A PERIOD OF ONE YEAR FROM FINAL ACCEPTANCE.
- H. CONTRACTOR SHALL PROVIDE ACCESS PANELS WHERE NECESSARY FOR CONCEALED ELECTRIAL COMPONENTS.

## 2. OPERATION AND MAINTENANCE MANUALS:

- A. DURING THE COURSE OF CONSTRUCTION, COLLECT AND COMPILE OPERATING INSTRUCTIONS, WIRING DIAGRAMS, CATALOG CUTS, LUBRICATION AND PREVENTIVE MAINTENANCE INSTRUCTIONS, PARTS LISTS, ETC. FOR ALL EQUIPMENT FURNISHED UNDER THIS CONTRACT
- B. ALL LITERATURE AND INSTRUCTIONS SHIPPED WITH THE EQUIPMENT SHALL BE SAVED FOR INCLUSION N THE OPERATION AND MAINTENANCE MANUALS.
- C. ALL LITERATURE LISTED ABOVE AND ALL PAPERS LISTING WARRANTIES ETC SHALL BE COLL ATED AND LABELED WITH THE PROJECT NAME, ADDRESS, ARCHITECT, ENGINEER, CONTRACTORS, ETC. CONTRACTORS, ETC. DOCUMENTS SHALL BE COMPILED AND BOUND IN DIGITAL FILE OR 3 RING BINDER.
- A. MANUFACTURERS, MODEL NUMBERS, ETC. INDICATED OR SCHEDULED ON THE DRAWINGS SHALL BE INTERPRETED AS HAVING ESTABLISHED A STANDARD OF QUALITY AND SHALL NOT BE CONSTRUED AS LIMITING COMPETITION. ARTICLES, FIXTURES, ETC. OF EQUAL QUALITY BY MANUFACTURERS SHALL BE ACCEPTABLE, SUBJECT TO STRUCTURAL AND ELECTRICAL CONSTRAINTS OF THE PROJECT DESIGN UNLESS NOTED OTHERWISE

- A. ALL CIRCUITS SHALL BE TESTED FOR CONTINUITY, SHORTS, AND GROUNDS BEFORE CONNECTING TO THE PROPER PHASE AS DESIGNED TO BALANCE THE LOADING BETWEEN PHASES.
- B. POWER AND LIGHTING PANELS SHALL BE PROPERLY PHASED TO DISTRIBUTE THE LOAD AND SHALL BE CONNECTED AND ADJUSTED TO OPERATE AS SPECIFIED.
- C. ALL MOTORS AND SIMILAR EQUIPMENT SHALL BE CHECKED FOR PROPER PHASE ROTATION AND OPERATION. 5. RACEMAYS:
- A. CONDUIT INSIDE THE BUILDING SHALL BE METALLIC TUBING (EMT), BEARING THE UL LABEL, WITH COMPRESSION TYPE FITTINGS OR SCREW SET FITTINGS.
- B. CONDUIT EXPOSED TO THE MEATHER, INSTALLED UNDERGROUND, IN CONCRETE, OR USED FOR SERVICE ENTRANCE SHALL BE STANDARD RIGID CONDUIT (GALVANIZED) WITH THREADED FITTINGS.
- C. UNDERGROUND CONDUIT MAY BE POLYVINYL CHLORIDE WITH A DEFLECTION TEMPERATURE, UNDER LOAD AT 264 PSI, OF 78 DEGREES C, AND A TENSILE STRENGTH OF 5,200 PSI. JOINTS SHALL BE FLUSH SOLVENT MELDED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. CONDUIT SHALL BE EQUAL TO CARLON POWER AND COMMUNICATIONS DUCT TYPE DB (DIRECT BURIAL). CONDUIT AND FITTINGS SHALL BE PRODUCED BY THE SAME MANUFACTURER.
- D. FLEXIBLE METAL CONDUIT SHALL ONLY BE USED FOR CONNECTIONS TO MOTORS, TRANSFORMERS, AND LIGHT FIXTURES. MAXIMUM LENGTH SHALL BE 6'-0".

### 6. CONDUCTORS

- A. WIRES SHALL BE CONTINUOUS WITHOUT SPLICES OR TAPS IN CONDUIT RUNS. ALL SPLICES SHALL BE MADE IN JUNCTION, PULL, OR OUTLET BOXES. ALL WIRE SHALL BE INSTALLED IN CONDUIT, WIREWAYS OR OTHER PROTECTIVE COVER SANCTIONED BY CODES.
- B. CONDUCTORS FOR LIGHTING AND POWER SHALL BE COPPER, MINIMUM NO. 12 A.W.G., 600 VOLT.
- C. NO. 10 GAUGE AND SMALLER CONDUCTORS SHALL BE TYPE THMN (WET LOCATIONS) OR THHN (DRY LOCATIONS), SOLID CONDUCTOR, UNLESS OTHERWISE INDICATED.
- D. NO. 8 GAUGE AND LARGER CONDUCTORS SHALL BE TYPE THWN (WET LOCATIONS) OR THHN (DRY
- LOCATIONS) STRANDED UNLESS OTHERWISE INDICATED E. SERVICE ENTRANCE AND PANEL FEEDER CONDUCTORS, NO. 3 GAUGE AND LARGER SHALL BE TYPE
- F. ALUMINUM SERVICE WIRE MAY BE USED FOR SERVICE ENTRANCE CONDUCTORS AND/OR PANEL FEEDERS
- ONLY. ALL OTHER WIRING SHALL BE COPPER CONDUCTORS AS HEREINBEFORE SPECIFIED.
- G. ALUMINUM CONDUCTORS SHALL BE TYPE 'XHHM-2', ALCAN, "STABILOY" TYPE ALLOY CONDUCTORS UTILIZING "AA-8030" ALUMINUM ALLOY. CONDUCTORS SHALL BE UL LISTED.
- H. ALL ALUMINUM CONDUCTORS SHALL BE TERMINATED IN CONNECTIONS OR LUGS WHICH ARE DUAL RATED (ALTCU OR AL9CU) AND ARE LISTED BY UL FOR USE WITH ALUMINUM OR COPPER CONDUCTORS AND SHALL BE SIZED TO ACCEPT ALUMINUM CONDUCTORS OF THE AMPACITY SPECIFIED.

- A. MC CABLE SHALL CONSIST OF INTERLOCK ARMORED CABLE MADE OF THREE OR FOUR TYPE THHN SOLID (#8 AMG AND LARGER MAY BE STRANDED) COPPER CONDUCTORS RATED  $90^{\circ}$ C FOR DRY LOCATIONS, WITH NYLON OR EQUIVALENT UL LISTED JACKET, PER UL STANDARD 83 THE THREE CONDUCTORS SHALL BE TWISTED TOGETHER WITH THE COPPER GROUNDING CONDUCTOR, SUITABLE FILLERS, AND WRAPPED IN BINDER TAPE. THE ASSEMBLY SHALL BE ARMORED WITH SPIRALLY WRAPPED INTERLOCKED ARMOR OF ALUMINUM OR GALVANIZED
- B. CABLES SHALL BE TESTED IN ACCORDANCE WITH UL STANDARD 1569 FOR TYPE MC CABLE AND RATED AT 600 VOLTS, 90 DEG. C FOR DRY LOCATIONS AND 75 DEG. C FOR WET LOCATIONS.

## 8. WIRING DEVICES:

- A. WALL SWITCHES SHALL BE SPECIFICATION GRADE, QUIET TYPE, FLUSH TOGGLE SWITCH, RATED FOR 20 AMPS, WITH THERMOPLASTIC COVER PLATES.
- 1) SINGLE POLE: HUBBELL #C51221-X, OR EQUAL. 2) THREE WAY: HUBBELL #C51223-X, OR EQUAL. 3) AS SPECIFIED ON PLANS
- B. RECEPTACLES SHALL BE SPECIFICATION GRADE, DUPLEX, GROUNDING, THREE-WIRE TYPE, RATED FOR 20 AMPS, WITH THERMOPLASTIC COVER PLATES. HUBBELL #CR5352-X, OR EQUAL.
- C. GROUND FAULT INTERRUPTER RECEPTACLES (GFI) SHALL BE HUBBELL #GF20-XL. DEVICE COVER
- PLATES SHALL BE AS HEREINBEFORE SPECIFIED. D. ISOLATED GROUND RECEPTACLES (IG) SHALL BE HUBBELL #CR5352IG, ORANGE COLOR. DEVICE
- COVER PLATES SHALL BE AS HEREINBEFORE SPECIFIED. E. RECEPTACLES OUTSIDE BUILDING AND WHERE NOTED AS WEATHERPROOF, SHALL BE LISTED WEATHER-RESISTANT' HUBBEL #GFTR20-X OR EQUAL AND SHALL BE INSTALLED IN A MEATHERPROOF ENCLOSURE WHICH SHALL BE INTERMATIC #WP1010MXD OR #WP1010HMXD DIEGAST METAL WEATHERPROOF RECEPTACLE
- COVER. COVER SHALL BE WEATHER PROOF RATED WHILE IN USE. F. VERIFY DEVICES AND DEVICE COVERPLATES COLOR AND STYLE WITH ARCHITECT.
- 9. BOXES:
- A. HOT DIPPED GALVANIZED STEEL BOXES. PROVIDE TYPE TO SUIT CONDITIONS FOR INSTALLATION. B. ALL BOXES SHALL BE FLUSH MOUNTED, UNLESS INDICATED OTHERWISE.

## ELECTRICAL SPECIFICATIONS (CONTINUED)

### 10. PANELBOARDS:

- A. FURNISH AND INSTALL CIRCUIT BREAKER PANELBOARDS AS SHOWN ON THE DRAWINGS. PANELBOARDS SHALL BE LISTED BY UL AND SO LABELED, AND SHALL BE FULLY RATED FOR THE VOLTAGE AND CURRENT CAPACITY INDICATED ON THE PANEL SCHEDULE. PANELBOARDS SHALL BE EQUAL TO SQUARE D TYPE NQ OR NF WITH BOLT IN TYPE BREAKERS. PANELBOARD LUGS SHALL BE RATED AT 75°C.
- SYMMETRICAL FAULT CURRENTS INDICATED AND AS REQUIRED TO MEET OR EXCEED THE AVAILABLE FAULT CURRENT FROM LOCAL UTILITY.
- CARRY 80% OF NAMEPLATE RATING CONTINUOUSLY IN FREE AIR AT 40° C. CIRCUIT BREAKERS SHALL BE TRIP INDICATING AND FULLY INTERCHANGEABLE WITHOUT DISTURBING ADJACENT UNITS. WIRE CONTACTS CANNOT BE HELD CLOSED AGAINST ANY ABNORMAL OVERCURRENT OR SHORT CIRCUIT
- ACCORDANCE WITH NEC. FRONTS SHALL BE OF SHEET STEEL PAINTED LIGHT GREY OVER A SUITABLE RUST INHIBITOR PRIMER. PANELBOARDS SHALL BE EQUIPPED WITH ONE PIECE DOOR, CYLINDER TUMBLER TYPE LOCK, DIRECTORY CARD-HOLDER AND QUARTER-TURN ADJUSTABLE TRIM CLAMPS.
- E. BUS BAR BRACING SHALL BE UL LISTED AS INDICATED ON DRAWINGS. ADDITIONAL BRACING SHALL BE PROVIDED AS REQUIRED TO MEET OR EXCEED INDICATED AVAILABLE FAULT
- F. DIRECTORY CARDS SHALL BE COMPLETELY FILLED IN BY TYPEWRITER, LISTING CIRCUIT NUMBERS AND LOAD SERVED, INCLUDING EXISTING CIRCUITS. CIRCUIT BREAKERS SHALL BE IDENTIFIED BY CIRCUIT NUMBER LABELS AS HEREINBEFORE SPECIFIED.

- B. INDOOR SWITCHES SHALL BE NEMA I AND OUTDOOR SWITCHES SHALL BE NEMA 3R, UNLESS INDICATED OTHERWISE.
- WITH 200,000 AMPERES RMS SYM INTERRUPTING CAPACITY. FUSING ELEMENTS SHALL BE SILVER FOR RATINGS ABOVE 60 AMPERES
- B. ALL OTHER FUSES SHALL BE U.L. CLASS RK-5, DUAL-ELEMENT WITH A MINIMUM TIME-DELAY OF 10 SECONDS AT 500% RATING. FUSES SHALL HAVE CURRENT-LIMITING SHORT-CIRCUIT LINKS AND 200,000
- A. WHERE LIGHT FIXTURES ARE MOUNTED IN A LAY-IN CEILING, PROVIDE A MINIMUM OF 2 SUPPORT WIRES ATTACHED DIRECTLY BETWEEN EACH LIGHT FIXTURE AND THE BUILDING STRUCTURE. SUPPORT WIRES
- FIXTURE WIRE IS REQUIRED IN ALL FIXTURES AND FIXTURE RACEWAYS. WEATHERPROOF WIRING IS REQUIRED FOR EXTERIOR FIXTURES. ALL PARTS OF FIXTURES AND WIRING SHALL BE IN ACCORDANCE WITH NEC REQUIREMENTS.
- C. ALL FIXTURES SHALL CARRY UL AND ETL LABELS.

- SAFING AND CAULK AT EACH END WITH FIRE RESISTANT SEALANT
- C. ROOF: PROSET OR EQUAL, MANUFACTURED PVC SCHEDULE 40 PIPE SLEEVE WITH WEATHERPROOF SEAL. COORDINATE WITH ROOFING CONTRACTOR AND FLASH AS REQUIRED TO MAINTAIN ROOF WARRANTY.

### 15. GROUNDING

- AND ANY LOCAL REQUIREMENTS. INSURE CONTINUOUS BOND WHERE FLEXIBLE CONDUIT IS USED. PROVIDE BONDING JUMPER INSIDE ALL FLEXIBLE CONDUIT.
- B. BOND METAL PIPING SYSTEMS IN COMPLIANCE WITH NEC 250.4(A)(4).

- INDICATED TO BE REMOVED AND NOT INDICATED TO BE SALVAGED OR REMAIN
- 1) DISCONNECT AND REMOVE EXISTING ELECTRICAL EQUIPMENT INDICATED TO BE REMOVED AND SALVAGED. DELIVER EQUIPMENT TO THE LOCATION DESIGNATED BY THE OWNER FOR STORAGE.
- "LIKE NEW" CONDITION WITH RUST OR CORROSION REMOVED, SURFACE PAINT TOUCHED UP OR REPAINTED AS REQUIRED TO MATCH NEW CONSTRUCTION, AND THOROUGHLY CLEANED AND INSPECTED ANY ITEMS WHICH BECOME DAMAGED BEYOND REPAIR AS A RESULT OF CONSTRUCTION OR DEMOLITION ACTIVITY SHALL BE REPLACED WITH NEW MATERIAL EQUIVALENT IN EVERY RESPECT.
- C. DISPOSAL AND CLEANUP: REMOVE FROM THE SITE AND LEGALLY DISPOSE OF DEMOLISHED MATERIALS AND EQUIPMENT NOT INDICATED TO BE SALVAGED.
- BARRIERS TO KEEP DIRT, DUST, AND NOISE FROM BEING TRANSMITTED TO ADJACENT AREAS. REMOVE PROTECTION AND BARRIERS AFTER REMODELING OPERATIONS ARE COMPLETE.
- AND OPERATION OF ALL EXISTING ELECTRICAL SYSTEMS, INTEGRATING THE NEW AND EXISTING AREAS. LOCATE, IDENTIFY, AND PROTECT ELECTRICAL SERVICES PASSING THROUGH REMODELING AREA AND SERVING OTHER AREAS OUTSIDE THE REMODELING LIMITS. MAINTAIN SERVICES TO AREAS OUTSIDE REMODELING LIMITS. WHEN SERVICES MUST BE INTERRUPTED, INSTALL TEMPORARY SERVICES FOR
- WALLS OR PARTITIONS SHALL HAVE DEVICES AND WIRE REMOVED, AND SHALL BE COVERED.
- 3) WHERE EXISTING CIRCUITS EXTEND BEYOND THE OUTLET IN THE EXISTING WALL, CEILING, OR FLOOR TO BE REMOVED, FURNISH AND INSTALL NEW CONDUIT AND WIRE TO EITHER REROUTE THE CIRCUIT OR FEED THE REMAINING OUTLET(S) FROM ANOTHER ELECTRICAL SOURCE, BUT IN SUCH
- 4) WHERE EXISTING OUTLETS IN A WALL, CEILING, OR FLOOR TO BE REMOVED ARE ESSENTIAL TO LOCATION. EXISTING WIRING DEVICES SHALL NOT BE REUSED. UNLESS OTHERWISE INDICATED.
- 5) WHERE LIGHTING FIXTURES ARE INDICATED TO BE DEMOLISHED, REMOVE ALL WIRE AND MODIFY THE EXISTING CONDUIT (IF APPLICABLE) FOR THE NEW LIGHTING. ALL UNUSED CONDUIT SHALL BE
- CONSTRUCTION TO MAINTAIN CONTINUITY OF CIRCUITS UNLESS OTHERWISE INDICATED. 8) CONDUIT SHALL BE CONCEALED WITHIN THE EXISTING BUILDING CONSTRUCTION WHEREVER
- POSSIBLE, EXCEPT WHERE OTHERWISE INDICATED.

## 17. BOXES IN FIRE RATED ASSEMBLIES:

- A. OUTLET BOXES THAT DO NOT EXCEED 16 SQUARE INCHES AND INSTALLED IN FIRE RATED WALLS SHALL NOT BE INSTALLED CLOSER THAN 24" HORIZONTAL INCHES TO OTHER OUTLET BOXES.
- B. IF BOXES MUST BE INSTALLED WITHIN 24" OF EACH OTHER THAN BOTH OUTLET BOXES SHALL BE PROTECTED WITH LISTED PUTTY PADS, 3M FIRE BARRIER MOLDABLE PUTTY + OR EQUAL.
- ALARM SYSTEM TO BE INSTALLED. PROVIDE DEVICES, CONDUIT, WIRES, CABLE, PROGRAMMING AND FESTING AS DIRECTED BY EQUIPMENT MANUFACTURER AND LOCAL FIRE DEPARTMENT FOR A CODE SYSTEM WITH SIZES AND BATTERY CALCULATIONS. EQUIPMENT TO BE NEW AND SHALL BE STAMPED, SIGNED, CALIBRATION AND TESTED BY FACTORY CERTIFIED TECHNICIAN. FIRE ALARM DEVICES ARE BID/DESIGN ALL NECESSARY DEVICES (ANNUNCIATOR(S), NOTIFICATION APPLICANCES, INITIATING DEVICES, AND ADDITIONAL COMPONENTS).

- 1) CIRCUIT BREAKER INTERRUPTING CAPACITIES SHALL MEET OR EXCEED THE AVAILABLE RMS
- B. CIRCUIT BREAKERS SHALL MEET APPLICABLE PORTIONS OF UL STANDARD 489 AND NEMA AB-L. CIRCUIT BREAKERS SHALL BE BOLT-ON, GROUP MOUNTED, AMBIENT MAGNETIC, WITH COMMON TRIP, UL RATED TO TERMINALS SHALL BE RATED 75 DEGREES C. THE OPERATING MECHANISM SHALL BE TRIP-FREE SO THAT
- a) BREAKERS SHALL MEET APPLICABLE NEMA AND/OR UL SPECIFICATIONS.
- C. PANELBOARD BOXES SHALL BE GALVANIZED SHEET STEEL WITH AMPLE WIRING GUTTER SPACE IN
- D. PANELBOARD INTERIORS SHALL CONSIST OF REINFORCED GALVANIZED SHEET STEEL FRAMES WITH ALUMINUM BUS BARS AND CIRCUIT BREAKERS, PROPERLY SUPPORTED TO PREVENT VIBRATIONS AND BREAKAGE IN HANDLING. BUS BARS SHALL BE SEQUENCE PHASED. PANELBOARD SHALL HAVE A FULL SIZED SOLID ALUMINUM NEUTRAL AND GROUND BUS.

- A. DISCONNECTS SHALL BE EXTERNALLY OPERATED QUICK-MAKE, QUICK-BREAK, SAFETY, WITH PROVISIONS FOR PAD LOCKING. FUSED AND NON-FUSED DISCONNECT SWITCHES SHALL BE PROVIDED AS INDICATED
- 12. FUSES:
- A. FUSES PROTECTING CIRCUIT BREAKER PANELS SHALL BE CURRENT LIMITING U.L. CLASS RK-1 FUSES
- AMPERES RMS SYM INTERRUPTING CAPACITY. FUSING ELEMENTS SHALL BE COPPER.
- SHALL BE A MINIMUM OF 12 GAUGE GALVANIZED STEEL WIRE, SOFT ANNEALED. B. FIXTURES ARE REQUIRED AT ALL LIGHTING OUTLETS SHOWN ON THE DRAWINGS. APPROVED LIGHTING

## 14. SLEEVES:

- A. PROVIDE, SET, AND PROPERLY LOCATE PIPE SLEEVES AS REQUIRED FOR THIS WORK.
- B. INTERIOR PARTITIONS: 16 GAGE GALVANIZED STEEL, PACK BETWEEN CONDUIT AND SLEEVE WITH FIRE

- A. GROUND ALL ELECTRICAL APPARATUS IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE (NEC) 250,

- A. DEMOLITION: DISCONNECT, DEMOLISH AND REMOVE ABANDONED ELECTRICAL MATERIALS AND EQUIPMENT
- 2) ALL MATERIALS AND EQUIPMENT DESIGNATED TO BE REUSED OR RELOCATED SHALL BE CAREFULLY REMOVED, AND STORED UNTIL NEEDED FOR REMODELING WORK. ALL ITEMS SHALL BE RESTORED TO
- D. PROTECT ADJACENT MATERIALS INDICATED TO REMAIN. INSTALL AND MAINTAIN DUST AND NOISE
- E. PROVIDE ALL ALTERATIONS AND REMORK INDICATED AND/OR REQUIRED FOR THE PROPER INSTALLATION
- 1) ABANDONED CONDUIT SHALL HAVE WIRE REMOVED AND SHALL BE CAPPED. ABANDONED OUTLETS IN
- 2) WHERE EXISTING CONDUITS TERMINATE AT AN EXISTING OUTLET IN A WALL, CEILING, OR FLOOR TO BE REMOVED, DISCONNECT AND REMOVE DEVICE AND WIRE FROM CONDUIT. CONDUIT SHALL BE CUT BACK AND CAPPED (BELOW THE FLOOR OR ABOVE THE CEILING) SO NOT TO CREATE AN OBSTRUCTION. PATCH FLOOR TO MATCH EXISTING.
- A MANNER AS NOT TO REVISE THE CIRCUIT. ALL REPOUTED CONDUIT SHALL BE APPROVED BY THE
- MAINTAIN OPERATION OF OTHER REMAINING OUTLETS, RELOCATE THE OUTLET TO A NEW CONVENIENT
- 6) WHERE A TELEPHONE CIRCUIT EXTENDS BEYOND AN OUTLET IN AN EXISTING WALL, CEILING, OR FLOOR TO BE REMOVED, PROVIDE NECESSARY EMPTY CONDUIT AND NOTIFY THE OWNER WHO WILL REQUEST THE OWNER TO ARRANGE WITH THE TELEPHONE COMPANY FOR NEW WIRING TO OUTLETS THAT
- 7) WHERE EXISTING CONDUIT AND WIRE RUNS ARE LOCATED IN OR ATTACHED TO AN EXISTING WALL, CEILING OR FLOOR TO BE REMOVED, THEY SHALL BE REROUTED IN EITHER NEW OR EXISTING
- 9) EXISTING WIRE SHALL BE DISCONNECTED AND REMOVED WHEREVER EXISTING CIRCUITS ARE
- 18. FIRE ALARM SYSTEM: A. ELECTRICAL CONTRACTOR SHALL PROVIDE DESIGN BUILD ENERGINEERED SHOP DRAWINGS OF FIRE COMPLIANT FIRE ALARM/DETECTION SYSTEM. MATERIALS, EQUIPMENT, AND WORKMANSHIP SHALL MEET PREVAILING CODES. THE SYSTEM SHALL BE COMPLETE AND OPERABLE. SUBMIT ONE LINE DIAGRAM OF SHOWN FOR INTENT ONLY FOR PERMITTING PROCESS. CONTRACTOR IS RESPONSIBLE FOR INCLUDING IN

## ELECTRICAL GYMROLG LIGT

	ELECTRICAL SYMBOLS LIST									
CIRCUI	CIRCUITING & NOTES									
+46"	SPECIAL MOUNTING HEIGHT FOR ASSOCIATED DEVICE (CENTERLINE OF DEVICE)									
GFI	GROUND FAULT CIRCUIT INTERRUPTER DEVICE									
MP	WEATHERPROOF ENCLOSURE ON DEVICE									
MR	WEATHERPROOF RESISTANT DEVICE									
16	ISOLATED GROUND DEVICE									
EM	EMERGENCY BATTERY BACKUP									
TR	TAMPER RESISTANT OUTLET									
USB	COOPER #TR7756-X OR EQUAL DUPLEX RECEPTACLE WITH DUAL USB CHARGING PORTS. PROVIDE 2-1/8" DEEP BACK BOX.									
(TIE)	PARTIAL HOMERUN. REFER TO PLANS FOR ADDITIONAL DEVICES CONNECTED TO THIS CIRCUIT.									
×	ELECTRICAL FLOOR PLAN NOTE WITH DESIGNATION									

## CONDUIT CONCEALED WHERE POSSIBLE OR AS NOTED, ARROWS INDICATE HOME RUN TO PANEL. CIRCUIT NUMBERS INDICATED $\mid$ #12 WIRE IN CONDUIT, UNLESS NOTED OTHERWISE ON DRAWINGS OR SPECIFICATION

### GROUNDING CONDUCTOR, #12 MIRE UNLESS NOTED OTHERWISE ON DRAWINGS OR SPECIFICATION CONDUIT ROUTED UNDER FLOOR/GRADE

LIGHTING						
	EMERGENCY TWIN HEAD LIGHT FIXTURE					
181	EXIT LIGHT WITH DIRECTIONAL ARROWS INDICATED					
A	STRIP FIXTURE WITH TYPE DESIGNATION					

# RECESSED OR SURFACE MOUNTED FIXTURE WITH TYPE DESIGNATION NIGHT LIGHT, CONNECT TO UNSWITCHED CIRCUIT CEILING OR RECESSED FIXTURE WITH TYPE DESIGNATION

# A ( ) H | WALL MOUNTED FIXTURE WITH TYPE DESIGNATION

14	OTHERWISE
ф	FOURPLEX RECEPTACLE, BOTTOM OF BOX AT 16" AFF, UNLESS NOTED OTHERWISE
₩ ф	TVSS SURGE SUPPRESSION RECEPTACLE
•	HEAVY DUTY OUTLET - NEMA CONFIGURATION SIZE PER EQUIPMENT MANUFACTURER'S RECOMMENDATION
	PANEL BOARD, TOP OF BOX 6'-0" AFF
Q	JUNCTION BOX
Image: control of the	NON-FUSED DISCONNECT SMITCH
ď	FUSED DISCONNECT SMITCH

DUPLEX RECEPTACLE, BOTTOM OF BOX AT 16" AFF, UNLESS NOTED

# • FLOOR BOX

MOTOR WITH DESIGNATION

POWER DEVICES

CONTROLS								
5	SINGLE POLE WALL SWITCH, TOP OF BOX AT 48" AFF							
S₃	THREE-WAY WALL SMITCH, TOP OF BOX AT 48" AFF							
<b>5</b> ,d	DIMMER SMITCH, TOP OF BOX AT 48" AFF							

# DUAL TECHNOLOGY/ULTRASONIC CEILING SENSORS SHALL BE MOUNTED 6 FROM SUPPLY/EXHAUST AIR DIFFUSERS.

2. LOW VOLTAGE CEILING SENSORS SHALL BE PROVIDED WITH 6' SLACK

MANUAL MOTOR STARTER WITH OVERLOADS

CONDUC	CONDUCTOR COILED AT SENSOR.										
<b>5</b> 0	WALL MOUNTED DUAL-TECHNOLOGY OCCUPANCY SENSOR, WATT STOPPER #DW-100, TOP OF BOX AT 48" AFF										
<b>©</b>	DUAL TECHNOLOGY CEILING MOUNT OCCUPANCY SENSORS, WATTSTOPPER DT-300										
PP	OCCUPANCY SENSOR POMER PACK, MATTSTOPPER BZ-150 OR EQUAL, PROVIDE LOW VOLTAGE MIRING TO OCCUPANCY SENSORS AND MOMENTARY SMITCHES										
5 _M 0	MOMENTARY SWITCH, TOP OF BOX AT 48" AFF										
COMM	MUNICATIONS										

NOTED OTHERWISE. PROVIDE WITH PULL STRING

7'-6" AFF UNLESS NOTED OTHERWISE (VERIFY)

ABOVE ACCESSIBLE CEILING, BOTTOM OF BOX AT 16", UNLESS

FLAT SCREEN TELEVISION - PROVIDE AND INSTALL ONE (1) HUBBEL #RR1510X RECESSED TAMPER-RESISTANT DUPLEX RECEPTACLE WITH

COVERPLATE AND ONE(1) HUBBELL #HBL260 TWO GANG LARGE

CAPACITY WALL BOX (UP TO 2" KNOCKOUT) W/ MUD RING AND

COVERPLATE FOR DATA. PROVIDE 2"C WITH PULL STRING TO

ABOVE ACCESSIBLE CEILING FOR DATA CABLES. MOUNT BOX AT

# ELECTRICAL SYMBOLS LIST

© CEILING MOUNT SMOKE DETECTOR DUCT MOUNT SMOKE DETECTOR

F FIRE ALARM PULL STATION, TOP OF BOX AT 48" AFF FIRE ALARM HORN/STROBE COMBINATION SIGNAL, CENTERLINE AT DATA/TELEPHONE OUTLET WITH MINIMUM  $rac{3}{2}$ " CONDUIT STUBBED UP TO

> FIRE ALARM HORN/STROBE COMBINATION SIGNAL, PENDANT MOUNTED FIRE ALARM VISUAL STROBE, CENTERLINE AT 6'-8" AFF

MF MATER FLOW SMITCH TAMPER SMITCH

FIRE ALARM

## ELECTRICAL GENERAL NOTES:

- 1. COORDINATE ALL WORK WITH OTHER TRADES AND EXISTING CONDITIONS AS REQUIRED TO PROPERLY INSTALL ALL SYSTEMS AS INTENDED, WITHIN THE CONFINES OF THE SPACES AVAILABLE, AND WITHOUT INTERFERENCES.
- 2. WHERE CONDUIT IS SHOWN UNDER FLOOR, VERIFY IF FLOOR IS STRUCTURAL SLAB OR SLAB ON GRADE. IF STRUCTURAL SLAB, CORE DRILL PENETRATION, AND SLAB AS REQUIRED FOR INSTALLATION OF UNDER FLOOR CONDUIT. NO STRUCTURAL ELEMENTS SHALL BE CORE DRILLED OR SAW CUT. WHEN SAW CUTTING, PATCH FLOOR TO MATCH EXISTING SURFACE AS REQUIRED.
- ALL BRANCH CIRCUITS BETWEEN THE PHASES OF THE SYSTEM REGARDLESS OF CIRCUITING INDICATED.
- 5. ELECTRICAL CONTRACTOR TO COORDINATE MANUFACTURER ELECTRICAL REQUIREMENTS FOR HVAC EQUIPMENT BEING FURNISHED WITH MECHANICAL CONTRACTOR PRIOR TO ROUGH-IN. EQUIPMENT DISCONNECTS TO BE PROVIDED BY ELECTRICAL CONTRACTOR UNLESS NOTED OTHERWISE IN MECHANICAL
- 6. ALL MATERIALS EXPOSED WITHIN PLENUMS SHALL BE NONCOMBUSTIBLE OR SHALL HAVE A FLAME SPREAD INDEX OF NOT MORE THAN 25 AND A SMOKE-DEVELOPED INDEX OF NOT MORE THAN 50 WHEN TESTED IN
- 8. FIRE ALARM SYSTEM IS SHOWN FOR SCHEMATIC PURPOSES. THE FIRE ALARM CONTRACTOR IS RESPONSIBLE FOR PROVIDING DESIGN AND SHOP DRAWINGS SUBMITTAL TO FIRE MARSHAL FOR APPROVAL AS REQUIRED BY THE FIRE MARSHAL. IT IS THE CONTRACTORS RESPONSIBILITY TO PROVIDE ADDITIONAL
- 9. ALL BRANCH CIRCUITS SHALL BE SIZED TO ALLOW FOR A MAXIMUM OF 3% VOLTAGE DROP. ALL FEEDERS SHALL BE SIZED TO ALLOW FOR A MAXIMUM OF 2% VOLTAGE DROP. ELECTRICAL CONTRACTOR SHALL VERIFY WIRING INDICATED IS SUFFICIENT AND INCREASE CONDUCTOR SIZE AS REQUIRED BASED
- 10. PROVIDE LOW VOLTAGE WIRING BETWEEN ALL 0-10V DIMMING DRIVERS CONTROLLED BY 0-10Y DIMMERS PER MANUFACTURER'S INSTRUCTIONS WHETHER INDICATED ON PLANS OR NOT.
  - 11. COORDINATE VENDING AND TV LOCATIONS WITH OWNER

ROUTE CONDUIT IN SPACE BELOW. IF SLAB ON GRADE, SAW CUT EXISTING FLOOR

3. IT IS THE ELECTRICAL CONTRACTORS RESPONSIBILITY TO PROPERLY BALANCE

4. ALL EXPOSED RACEWAYS SHALL BE EMT CONDUIT, MC CABLE IS NOT PERMITTED IN EXPOSED AREAS.

SCHEDULES.

ACCORDANCE WITH ASTM E 84.

7. EACH BRANCH CIRCUIT SHALL HAVE A DEDICATED NEUTRAL PER NEC 210.4.

DEVICES, POWER SUPPLIES, ETC FOR COMPLIANCE WITH CODE.

OFF ACTUAL INSTALLED LENGTH OF CONDUCTORS.

drawn by MA/FS EK/DS

BC PROJECT #: 22323 MISSOURI PE COA #2009003629 an instrument of service by the Designer/Engineer and is intended for use on this project only. Purs

to the Architectural Works Copyright Protection Act of 1990, all drawings, specifications, ideas and

designs, including the overall form, arrangement and composition of spaces and elements appeari


herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or



Overland Park, KS 88207 phone: 913.451.9390 fex: 913.451.9391 www.devideonee.com

4301 Indian Creek Parkway

erchitecture&engineering



05.19.22 checked by

12.20.22 REV 1

sheet number

SPECIFICATIONS AND

drewing type project number





www.devideonee.com

4 ROUTE CIRCUIT THROUGH CONTACTOR D FOR CONTROL OF BATTING CAGE LIGHTS. SEE DETAIL, THIS SHEET. 5 ROUTE CIRCUIT THROUGH CONTACTOR F FOR CONTROL OF BATTING CAGE

1 ROUTE CIRCUIT THROUGH CONTACTOR A FOR CONTROL OF BATTING CAGE

LIGHTING PLAN NOTES:


LIGHTS. SEE DETAIL, THIS SHEET.

LIGHTS. SEE DETAIL, THIS SHEET. 6 ROUTE CIRCUIT THROUGH CONTACTOR G FOR CONTROL OF BATTING CAGE


LIGHTS. SEE DETAIL, THIS SHEET. 7 VERIFY BATTING CAGE SMITCHBANK LOCATION WITH OWNER PRIOR TO ROUGH-IN.

8 JUNCTION BOX WITH DISCONNECTING MEANS PER NEC FOR CONNECTION TO BUILDING MOUNTED SIGNAGE. VERIFY EXACT LOCATION AND CONNECT TO SIGN PER MANUFACTURER'S INSTRUCTIONS. ROUTE CIRCUIT THRU TIMECLOCK, SEE DETAIL, THIS SHEET.


9 ROUTE THRU EXTERIOR LIGHTING CONTROLS. SEE DETAIL, THIS SHEET.

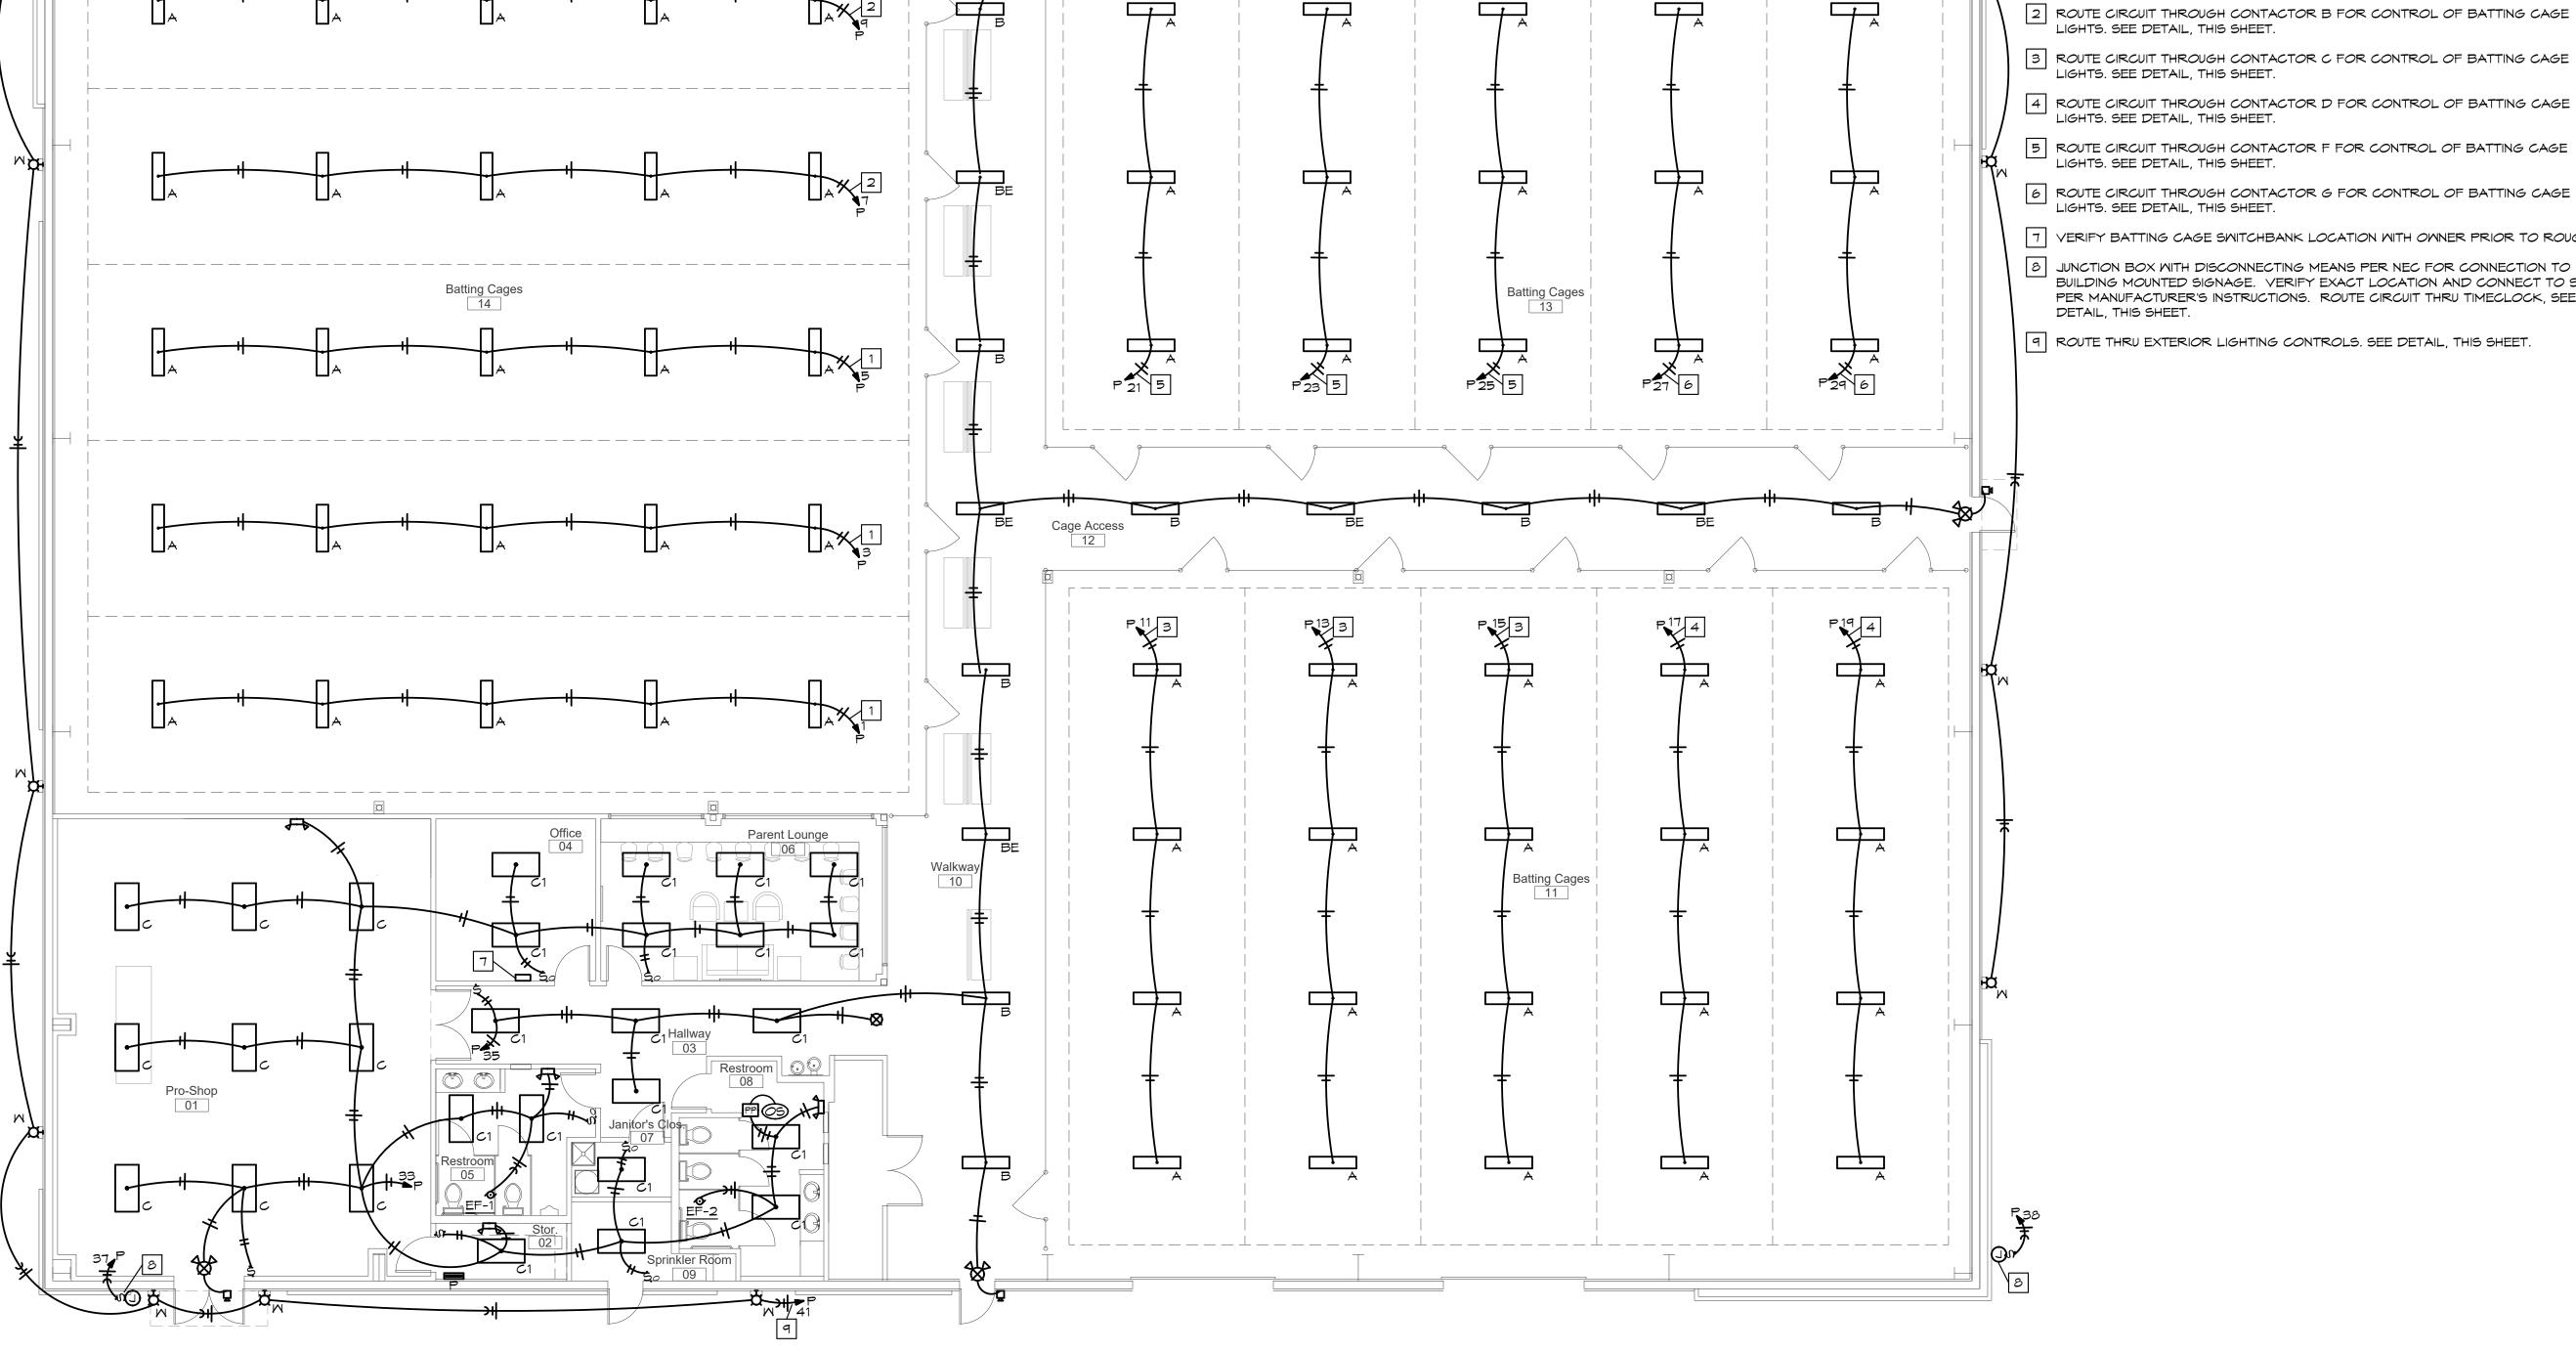

# **ELECTRICAL LIGHTING PLAN**

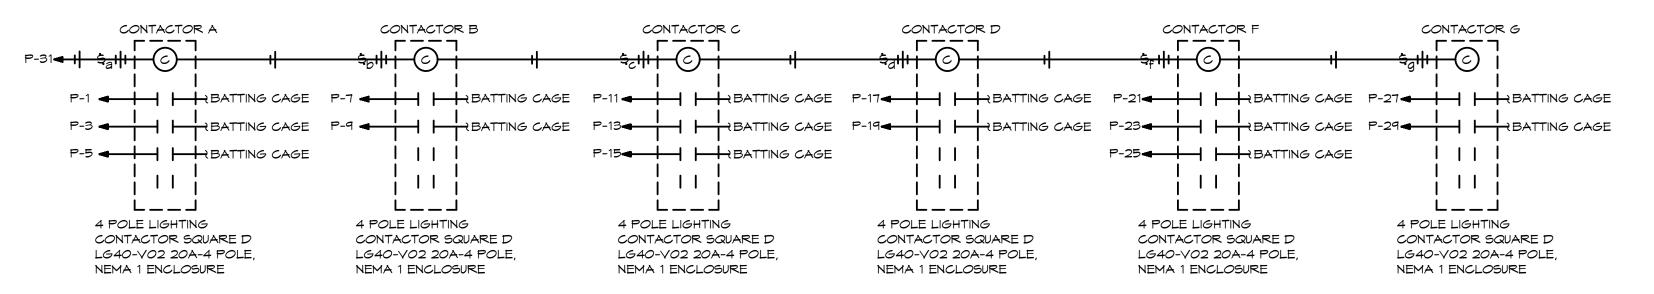

**LIGHTING CONTROL DIAGRAM** SCALE: NONE

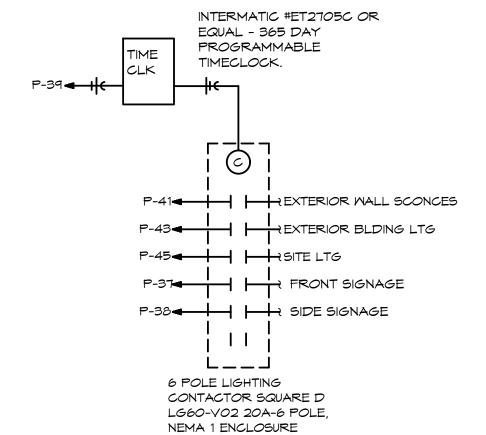

BC PROJECT #: 22323 MISSOURI PE COA #2009003629 This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided an instrument of service by the Designer/Engineer and is intended for use on this project only. Pursua to the Architectural Works Copyright Protection Act of 1990, all drawings, specifications, ideas and designs, including the overall form, arrangement and composition of spaces and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or



disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2022 BC Engineers, Inc. LIGHTING PLAN drawing type permit

elopment

 $\boldsymbol{\omega}$ 

dete 05.19.22

drewn by

checked by

12.20.22 REV 1

sheet number

project number

MA/FS

EK/DS revisions

**EXTERIOR LIGHTING CONTROL DIAGRAM** 



development for

**date** 05.19.22

**drewn by** MA/FS

EK/DS revisions

checked by

12.20.22 REV 1

sheet number

POWER PLAN



POWER PLAN NOTES:


1 PROVIDE QUAD RECEPTACLE AND DATA TO EACH PITCHING MACHINE. EACH MACHINE REQUIRES (2) ETHERNET CABLES AND (1) MULTI CABLE WIRE, SUPPLIED BY PITCHING MACHINE COMPANY, IN CONDUIT FROM THE PITCHING MACHINE TO THE CARD OPERATED BOX KIOSK. VERIFY ALL ELECTRICAL SPECIFICATIONS WITH PITCHING MACHINE COMPANY PRIOR TO ROUGH-IN.

2 VERIFY LOCATION OF CARD OPERATED BOX KIOSK WITH OWNER PRIOR TO ROUGH-IN.

3 VERIFY EXACT LOCATION OF ELECTRICAL DEVICES IN MOUNTED IN CASEMORK.

4 VERIFY LOCATION OF 2'X4'X3/4" FIRE RETARDANT PLYWOOD TELEPHONE BACKBOARD WITH GROUND BAR AND #6 CU BOND TO BUILDING ELECTRODE SYSTEM PROVIDE 4" C TO PROPERTY LINE FOR BUILDING TELEPHONE AND INTERNET SERVICE TERMINATE AS DIRECTED BY SERVICE PROVIDER. VERIFY ROUTING AND DISTANCE.

5 PENDANT MOUNT FIRE ALARM DEVICE.

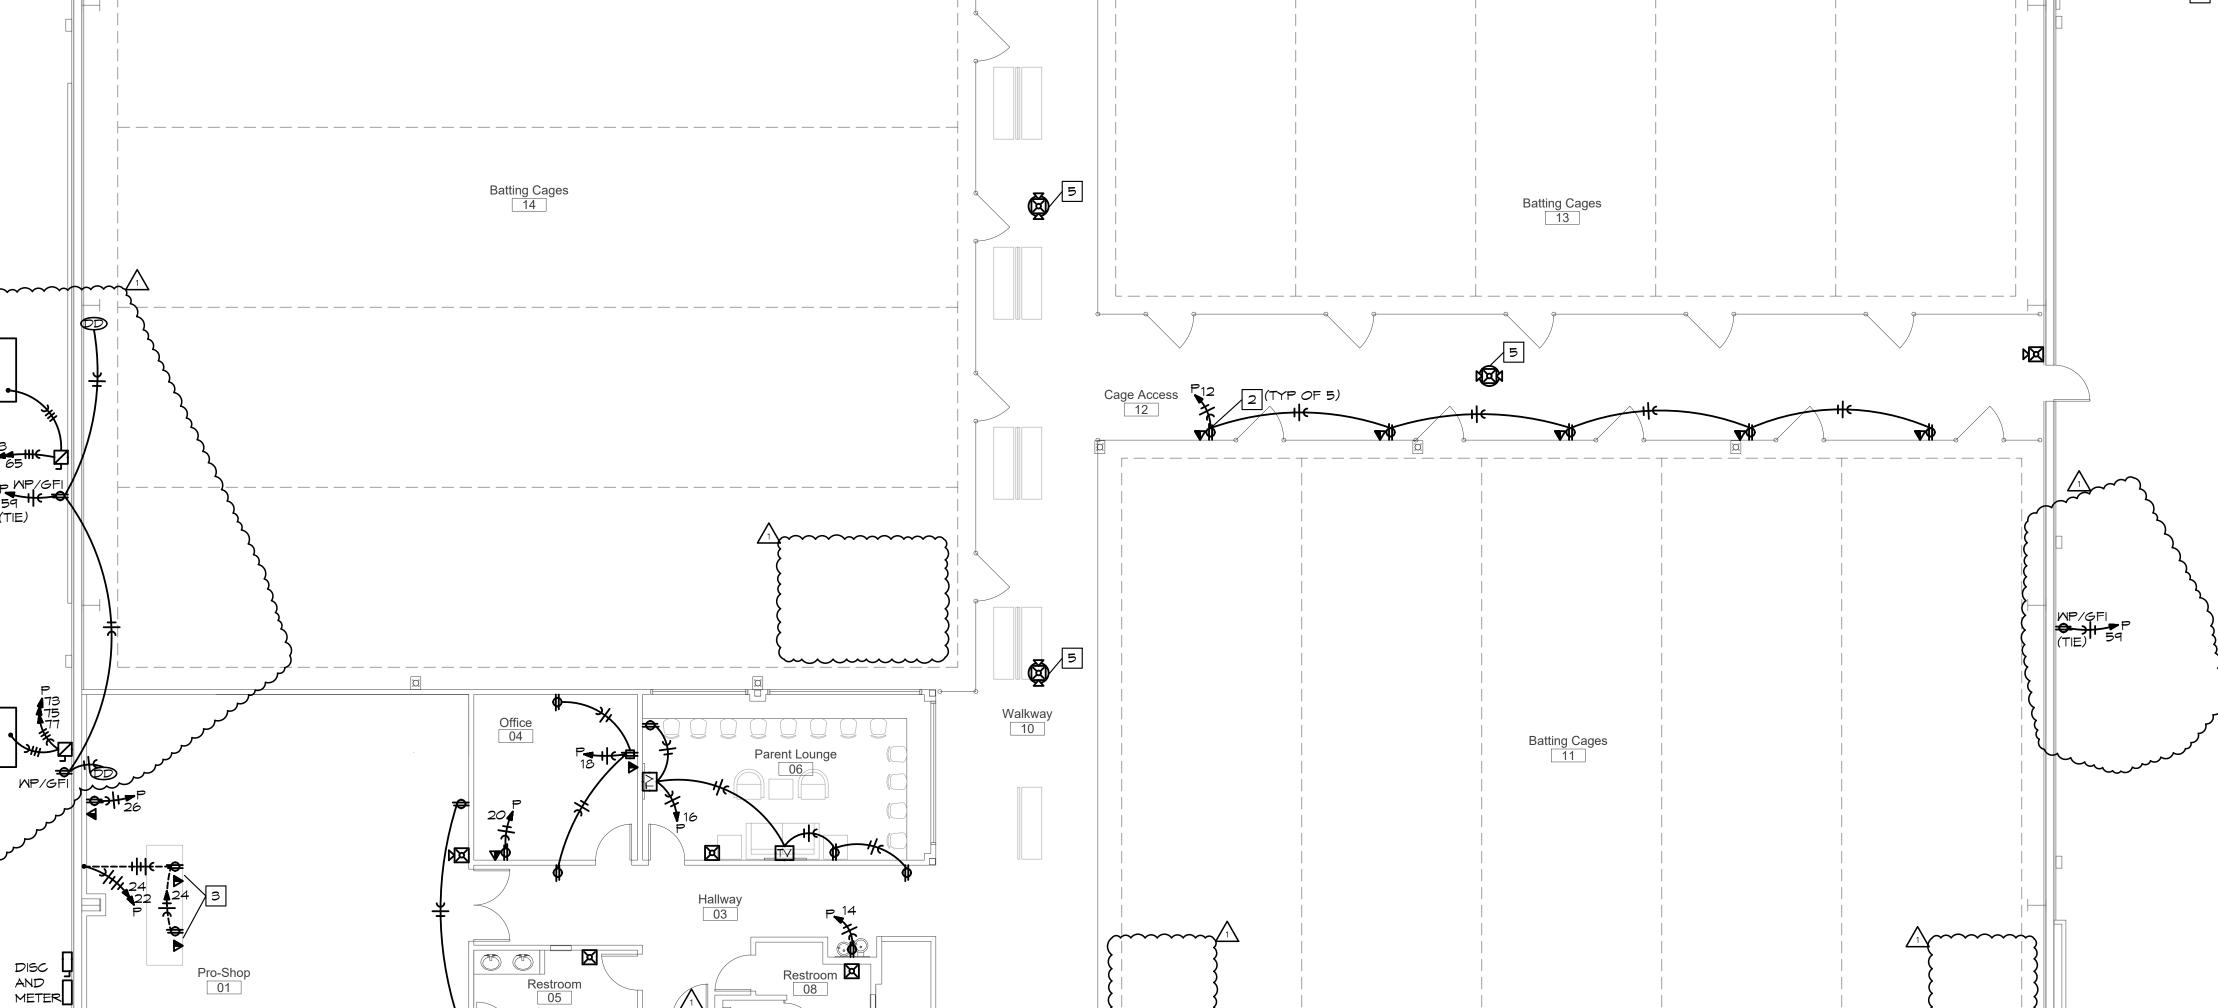

ELECTRICAL POWER PLAN

SCALE: 1/8" = 1'-0"

BC PROJECT #: 22323 MISSOURI PE COA #2009003629


This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on this project only. Pursuant to the Architectural Works Copyright Protection Act of 1990, all drawings, specifications, ideas and designs, including the overall form, arrangement and composition of spaces and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2022 BC Engineers, Inc.








		LIG	HT FIX	TURE SCHEDULE	
MARK NO.	MANUFACTURER & CATALOG NUMBER	VOLTS MATTS	LIGHT SOURCE	DESCRIPTION	EQUIVALENT MANUFACTURERS
A	LUX DYNAMICS IK10 SERIES E 3 D A 850 4 U10 CP B XXY X GYM	12 <i>0</i> 229	LED 36,000LUM 5000K	3 LIGHT BAR 2 CHANNEL LED 36,000 LUMEN, 5,000 KELVIN, 2-POINT Y CABLE MOUNT, VERIFY FINISH COLOR. MOUNT BOTTOM OF FIXTURE AT 22' AFF. ORDER CABLE TO LENGTH REQUIRED	WILLIAMS COLUMBIA OR EQUAL
В	LUX DYNAMICS IK10 SERIES E 1 S A 850 4 U10 CP B XXY X GYM	120 78	LED 11,000LUM 5000K	1 LIGHT BAR 1 CHANNEL LED 11,000 LUMEN, 5,000 KELVIN, 2-POINT Y CABLE MOUNT, VERIFY FINISH COLOR. MOUNT BOTTOM OF FIXTURE AT 22' AFF. ORDER CABLE TO LENGTH REQUIRED	MILLIAMS COLUMBIA OR EQUAL
BE	LUX DYNAMICS IK10 SERIES E 1 S A 850 4 U10 CP B E15 XXY X GYM	120 78	LED 11,000LUM 5000K	1 LIGHT BAR 1 CHANNEL LED 11,000 LUMEN, 5,000 KELVIN, 2-POINT Y CABLE MOUNT WITH EMERGENCY DRIVER, 2,561 LUMEN. VERIFY FINISH COLOR. MOUNT BOTTOM OF FIXTURE AT 22' AFF. ORDER CABLE TO LENGTH REQUIRED	WILLIAMS COLUMBIA OR EQUAL
V	LITHONIA EPANL 2X4 4000LM 80CRI 50K EZT MVOLT	120 38	LED 4000LUM 5000K	LED FLAT PANEL, 4000 LUMEN, 5000 KELVIN, VERIFY MOUNTING REQUIREMENTS AND HEIGHTS	WILLIAMS COLUMBIA OR EQUAL
<b>C</b> 1	LITHONIA EPANL 2X4 3000LM 80CRI 50K EZT MVOLT	120 29	LED 3000LUM 5000K	LED FLAT PANEL, 3000 LUMEN, 5000 KELVIN, VERIFY MOUNTING REQUIREMENTS AND HEIGHTS	WILLIAMS COLUMBIA OR EQUAL
DE	LITHONIA CLX L48 4000LM SEF RDL 120 EZ1 40K 80CRI PS1050 WH	12 <i>0</i> 28	LED 4000LUM 4000K	4' LED STRIP FIXTURE WITH ROUND LENS, 4000 LUMEN, 4000 KELVIN, WALL MOUNTED	WILLIAMS COLUMBIA OR EQUAL
M	EXTERIOR SCONCE, VERIFY FINISH WITH OWNER	120	LED LUM K	LED SCONCE	
M1	CREE LIGHTING XSPW-B-WM-4ME-AL- 40K-UNV	12 <i>0</i> 31	LED 4270LUM 4000K	WALL MOUNTED LED BUILDING LIGHT WITH TYPE IV MEDIUM THROW OPTIC. VERIFY FINISH COLOR WITH ARCHITECT	
SA	CREE LIGHTING OSQ-M-B-9L-40K7-4M- UNV-NM MOUNT-SOQ-ML-B-DA SHIELD-OSQ-BLSMF POLE-SSS-4-11-12-CW- BS-1D-C	120 130	LED 7075LUM 4000K	POLE MOUNTED WITH HOUSE SIDE SHIELD LED AREA LIGHT WITH TYPE IV MEDIUM THROW OPTIC. MOUNT ON 12'X4" SQUARE STEEL POLE WITH 3' CONCRETE BASE. VERIFY FINISH COLOR WITH ARCHITECT	
SB	CREE LIGHTING OSQ-M-B-9L-40K7-5Q- UNV-NM MOUNT-SOQ-ML-B-DA POLE-555-4-11-12-CW- BS-2D18-C	120 120	LED 10250LUM 4000K	POLE MOUNTED LED 180 DEGREE AREA LIGHT WITH TYPE V SQUARE OPTIC. MOUNT ON 12'X4" SQUARE STEEL POLE WITH 3' CONCRETE BASE. VERIFY FINISH COLOR WITH ARCHITECT	
¢	DUAL-LITE EV2	12 <i>0</i> 1	INCL	EMERGENCY LIGHT WITH TWIN ADJUSTABLE 1 WATT LED HEADS AND BATTERY, MOUNT AT 7'-6"±, TO CLEAR OBSTACLES. (PROVIDES 1 FC AVG. ON 27' CENTER FIXTURE SPACING)	SURE-LITES LITHONIA OR EQUAL
<b>Ø</b>	DUAL-LITE EVE-U-R-M-VR53	12 <i>0</i> 1	INGL	EXIT LIGHT WITH LED LAMPS, RED LETTERS ON WHITE BACKGROUND, UNIVERSAL MOUNT, BATTERY BACKUP, WITH VANDAL RESISTANT SHIELD	SURE-LITES LITHONIA OR EQUAL
₩	DUAL-LITE EVC-U-R-M-VR53	12 <i>0</i> 3	INCL	COMBINATION EMERGENCY/EXIT LIGHT WITH LED LAMPS, RED LETTERS ON WHITE BACKGROUND, TWIN LED EMERGENCY LIGHT HEADS, UNIVERSAL MOUNT, BATTERY BACKUP, WITH VANDAL RESISTANT SHIELD	SURE-LITES LITHONIA OR EQUAL
₩,	DUAL-LITE EVC-U-R-W-D4-VR53 MITH EVO-D-X	12 <i>0</i> 5	INCL	COMBINATION EMERGENCY/EXIT LIGHT WITH LED LAMPS, RED LETTERS ON WHITE BACKGROUND, TWIN 6W EMERGENCY LIGHT HEADS, UNIVERSAL MOUNT, HIGH CAPACITY BATTERY BACKUP, VANDAL RESISTANT SHEILD AND REMOTE TWIN HEAD OUTDOOR RATED FIXTURE	SURE-LITES LITHONIA OR EQUAL
EX	LITHONIA AFF-OEL-XX-UVOLT- LTP-SDRT-MT-CM	12 <i>0</i> 12	LED INCL 4000K	ARCHITECTURAL EXTERIOR LED EMERGENCY LIGHT WITH COLD WEATHER BATTERY, COORDINATE FINISH TO MATCH BUILDING	SURE-LITES LITHONIA OR EQUAL

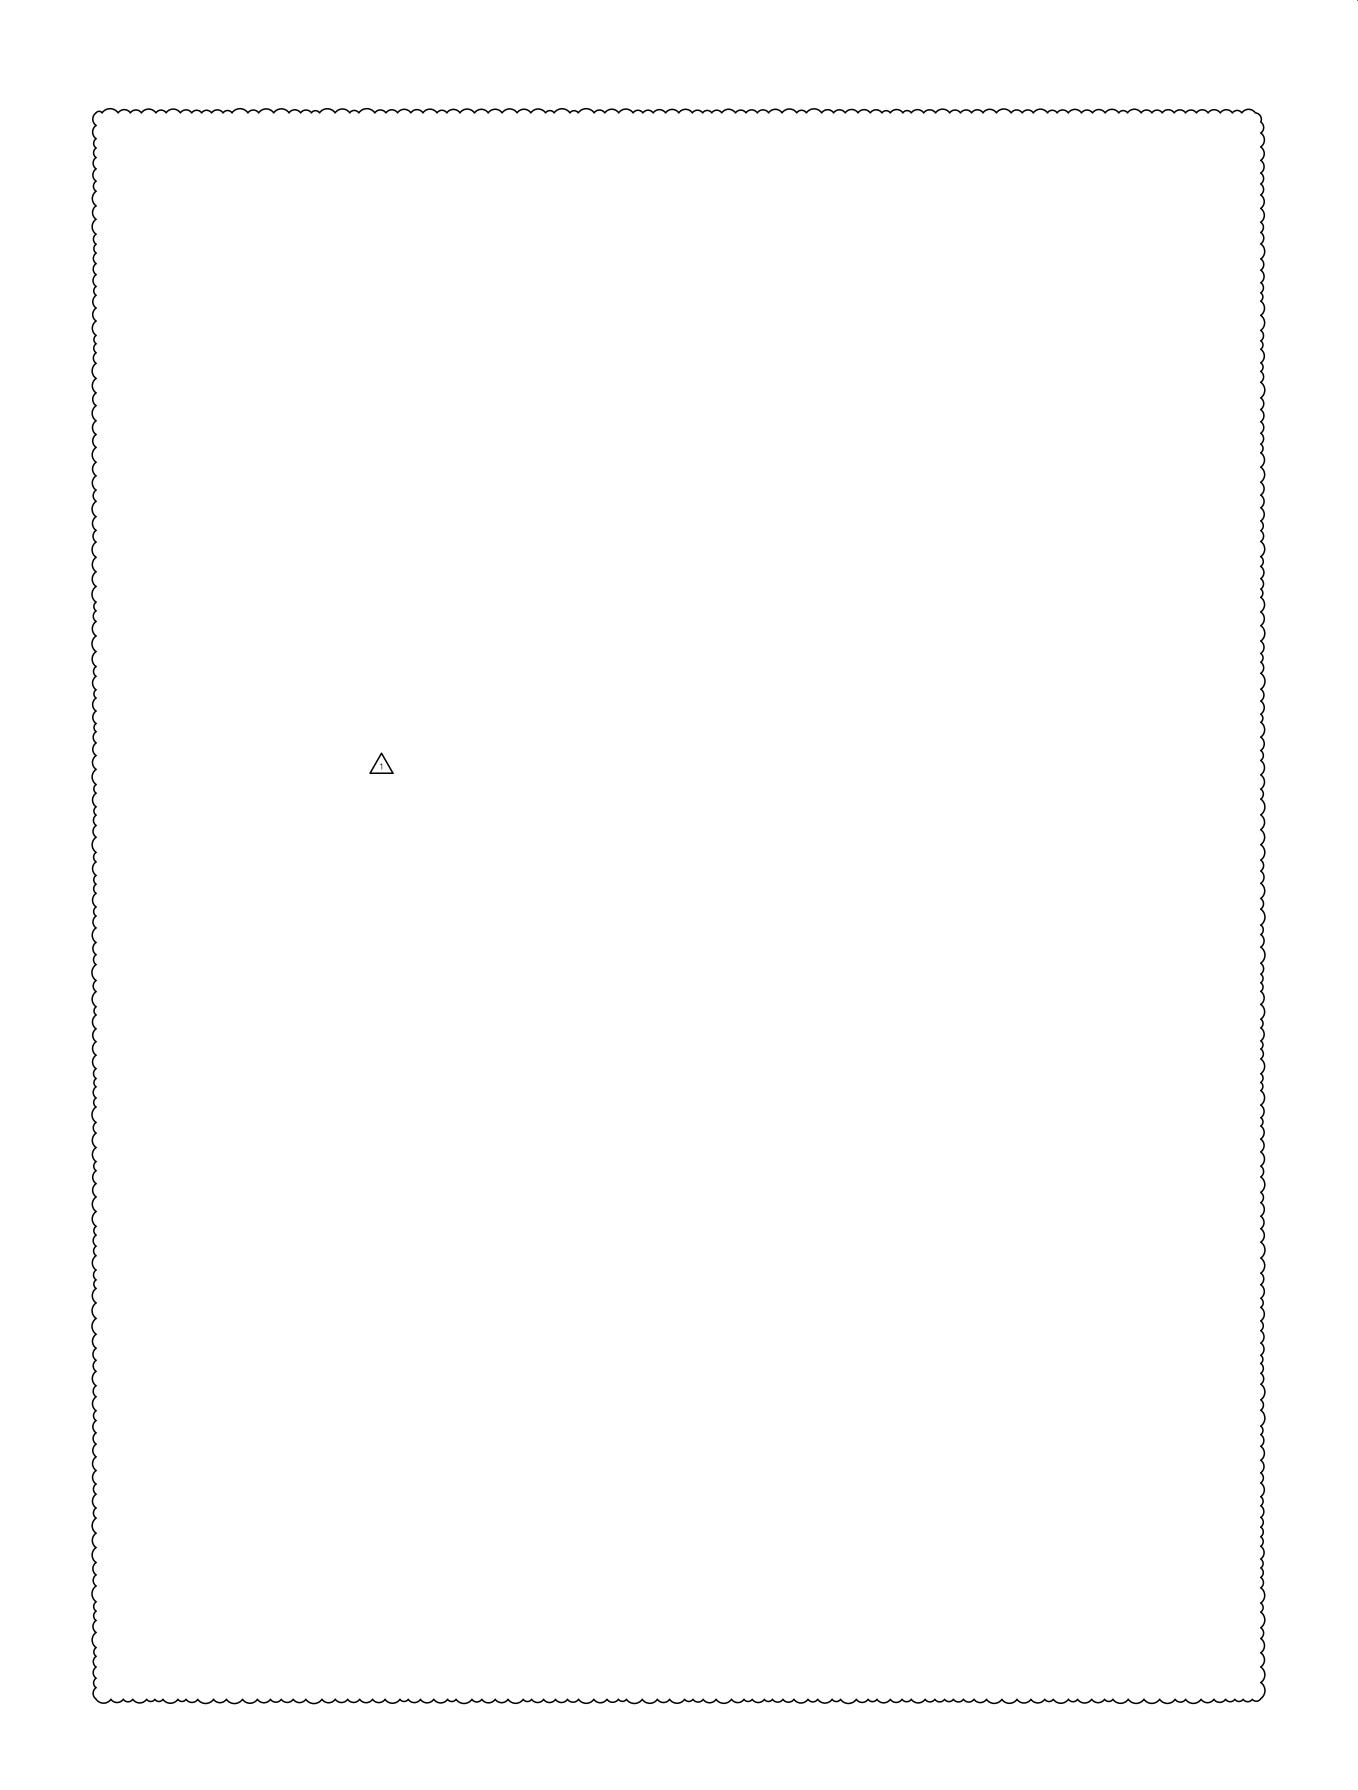

4301 Indian Creek Parkway Overland Park, KS 68207 phone: 913,451,9390 fax: 913,451,9391 www.davidsonae.com



**drewn by** MA/FS **checked by** EK/DS revisions 12.20.22 REV 1

sheet number

MEZZANINE PLAN

**date** 05.19.22

development for

 $\boldsymbol{\omega}$ 

BC PROJECT #: 22323 MISSOURI PE COA #2009003629 This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on this project only. Pursuant to the Architectural Works Copyright Protection Act of 1990, all drawings, specifications, ideas and designs, including the overall form, arrangement and composition of spaces and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2022 BC Engineers, Inc.







	PANEL: P	VOLTS	5: 120	0/208\	PH:	ЗФ	MIRE:	4M	LOCATI	ION:	STORA	4GE	MOUNTING: SURFACE	
	BUS: 400A	MAIN:	400	MLO	IC:	22	,000	RMS SY	M AMPS	P			FEEDER: SEE RISER DIA	GRAM
CK	T DESCRIPTION	AMPS	POLE	MIRE	ФА	ΦB	ФС	ФА	ΦB	ФС	MIRE	POLE AM	1PS DESCRIPTION	CKT NO
1	BATTING CAGE LTG	20	1	12	1,145			360			12	1 2	20 PITCHING MACHINE	2
3	BATTING CAGE LTG	20	1	12		1,145			360		12	1 2	20 PITCHING MACHINE	4
5	BATTING CAGE LTG	20	1	12			1,145			360	12	1 2	20 PITCHING MACHINE	6
7	BATTING CAGE LTG	20	1	12	1,145			360			12	1 2	20 PITCHING MACHINE	8
9	BATTING CAGE LTG	20	1	12		1,145			360		12	1 2	20 PITCHING MACHINE	10
11	BATTING CAGE LTG	20	1	12			916			900	12	1 2	20 PITCHING MACHINE KIOSH	.5 12
13	BATTING CAGE LTG	20	1	12	916			600			12	1 2	20 DRINKING FOUNTAIN [GF	14
15	BATTING CAGE LTG	20	1	12		916			900		12	1 2	20 PARENT LOUGE RCPT	16
17	BATTING CAGE LTG	20	1	12			916			720	12	1 2	20 OFFICE RCPT	18
19	BATTING CAGE LTG	20	1	12	916			600			12	1 2	OFFICE COPIER	20
21	BATTING CAGE LTG	20	1	12		687			180		12	1 2	20 PRO-SHOP POS RCPT	22
23	BATTING CAGE LTG	20	1	12			687			180	12	1 2	20 PRO-SHOP POS RCPT	24
25	BATTING CAGE LTG	20	1	12	687			600			12	1 2	20 PRO-SHOP COPIER	26
27	BATTING CAGE LTG	20	1	12		687			900		12		20 PRO-SHOP CONV RCP	
29	BATTING CAGE LTG	20	1	12			687			360	12	1 2	20 PHONEBOARD ROPT	30
31	BC LTG CONTACTORS	20	1	12	200			200			12	1 2	20 FACP [HL]	32
33	PRO-SHOP/OFFICE LTG	20	1	12		דדד					{	1 2	20 SPARE	34
35	HALL/CAGE ACCESS LTG	20	1	12			1,130						20 SPARE	36
37	FRONT SIGNAGE	20	1	12	1,200			1,200			12	1 2	20 SIDE SIGNAGE	38
39	EXTERIOR TIMECLOCK	20	1	12		200					{		20 SPARE	40
41	EXTERIOR WALL SCONCES	20	1	12			480				}	1 2	20 SPARE	42
43	EXT BUILDING/SITE LTG	20	1	10	873						}	1 2	20 SPARE	44
45	SITE LTG	20	1	10		760					{	1 2	20 SPARE	46
47		20	1		}					(	\$	1 2	20 SPARE	48
49	SPARE	20	1		}						<b>X</b>	1 2	20 SPARE	50
51	SPARE	20	1		}							1 2	20 SPARE	52
		20	1		<b>{</b>						{	1 2	20 SPARE	54
53									4	4	-	a I	1	

SPARE

SPARE

SPARE

SPARE

SPARE

SPARE

SPARE

SPARE SPARE

SPARE

SPARE

SPARE

SPARE

90,960 VA

97,225 VA

269.87 A

1 20

TOTAL CONNECTED LOAD:

DEMAND AMPS @ 208 VOLT / 30:

NEC DEMAND LOAD:

2,250

8,520

5,880

4,680

8,520

5,880

4,680

32,332 30,347

28,281

59 EXTERIOR CONV RCPT

RTU-1


RTU-2

RTU-3

SPARE

SPARE

[GF]-GFC| BRKR 5MA, [HL]-HANDLE LOCK

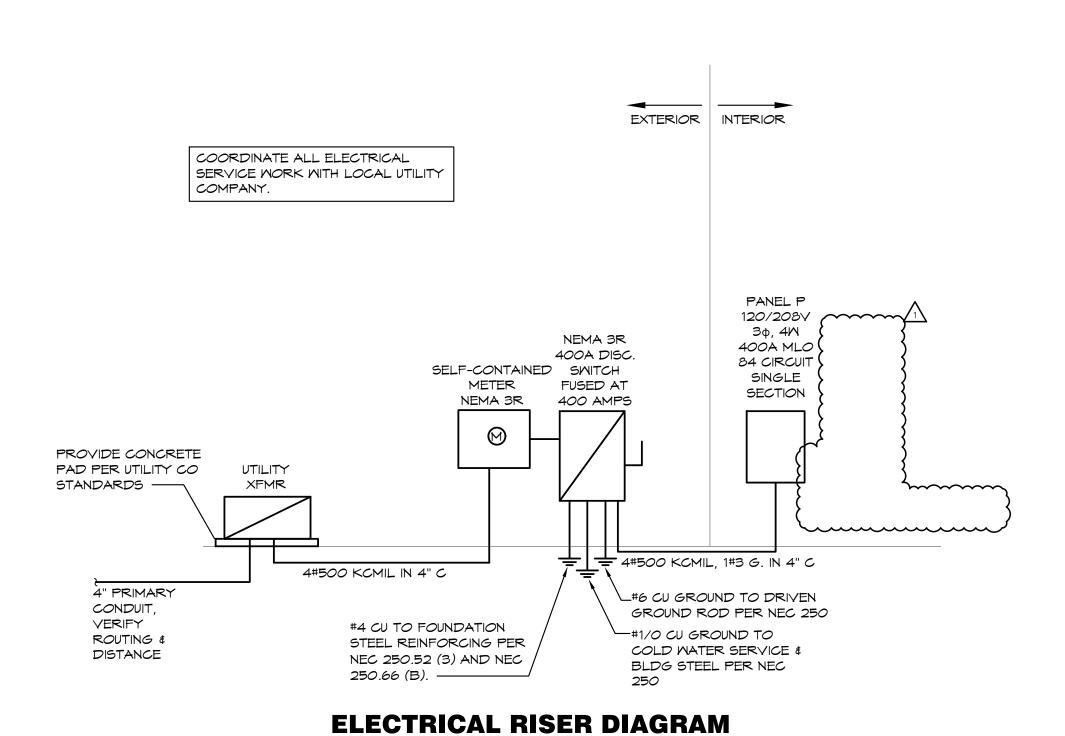

SCALE: NONE

4301 Indian Creek Parkway Overland Park, K8 88207 phone: 813.451.8380 fax: 813.451.8380 www.devidsonee.com 1/4/2023



development

 $\boldsymbol{\omega}$ date 05.19.22 drawn by MA/FS checked by EK/DS revisions 12.20.22 REV 1

sheet number


BC PROJECT #: 22323 MISSOURI PE COA #2009003629 This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on this project only. Pursuant to the Architectural Works Copyright Protection Act of 1990, all drawings, specifications, ideas and designs, including the overall form, arrangement and composition of spaces and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2022 BC Engineers, Inc.









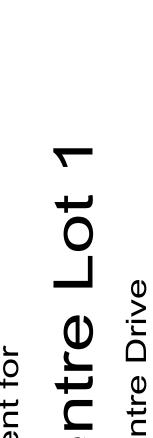

development for  $\boldsymbol{\omega}$ 

**date** 05.19.22 **drewn by** MA/FS checked by EK/DS revisions

12.20.22 REV 1

sheet number

BC PROJECT #: 22323 MISSOURI PE COA #2009003629 This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on this project only. Pursuant to the Architectural Works Copyright Protection Act of 1990, all drawings, specifications, ideas and designs, including the overall form, arrangement and composition of spaces and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2022 BC Engineers, Inc.



