



SLC TO RTU'S
18/2 FPLP
DUCT DETECTORS

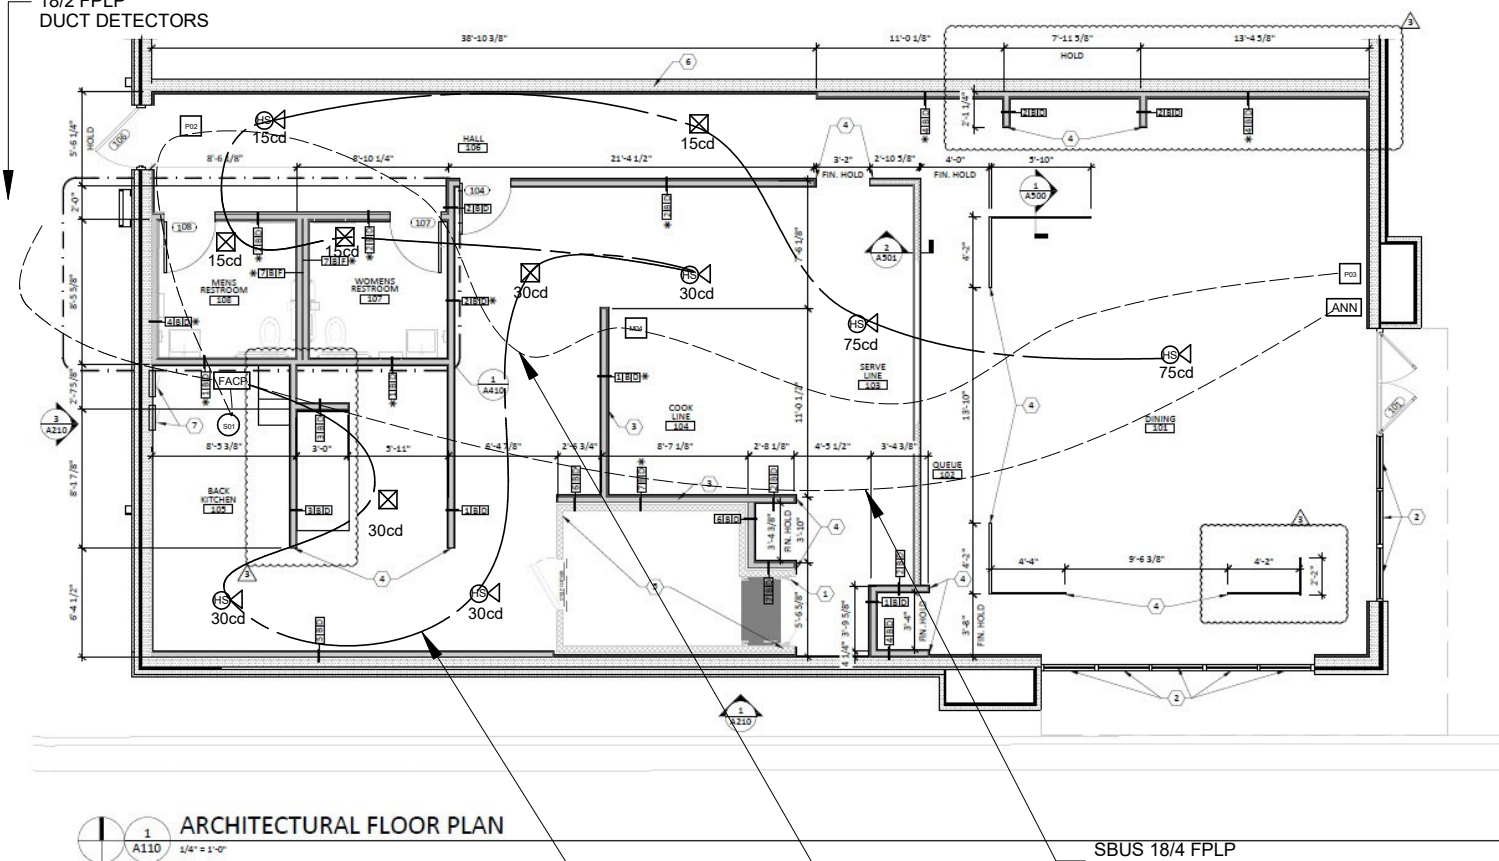

ARCHITECTURAL FLOOR PLAN


SBUS 18/4 FPLP
TO ANNUNCIATOR

SLC 18/2 FPLP

NAC 1 (11) DEVICES
14/2 FPLP

FIRE ALARM DEVICE LEGEND	
	FIRE ALARM CONTROL PANEL
	ANNUNCIATOR (ANN-80)
	ADDRESSABLE MODULE
	MANUAL PULL STATION
	SMOKE DETECTOR
	HORN STROBE
	STROBE ONLY

PLANS HAVE BEEN DRAWN TO COMPLY
WITH THE CODES AND STANDARDS OF
THE INTERNATIONAL BUILDING CODE 2018.

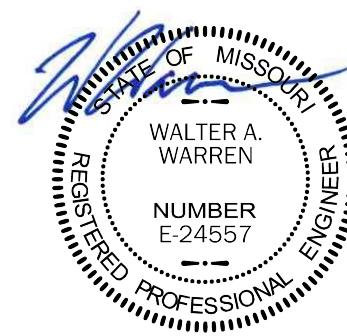

01/13/2023
Warren KTD, LLC



PRODIGY FIRE
SOLUTIONS LLC

1208 MO-7 SUITE G
PLEASANT HILL, MO 64080
816-683-7977

MIKAEL THELIN
ENGINEERING TECH
NICET LEVEL III
C# 146898

CAVA #334
904 PRYOR RD
LEE'S SUMMIT, MO 64081

DATE: 01/10/2023

FIRE ALARM SYSTEM

FA01



PRODIGY FIRE
SOLUTIONS LLC

1208 MO-7 SUITE G
PLEASANT HILL, MO 64080
816-683-7977

MIKAEL THELIN
ENGINEERING TECH
NICET LEVEL III
C# 146898


CAVA #334
904 PRYOR RD
LEE'S SUMMIT, MO 64081

DATE: 01/10/2023

FIRE ALARM SYSTEM

FA02

SLC 18/2 FPLP
DUCT DETECTOR MMF-300

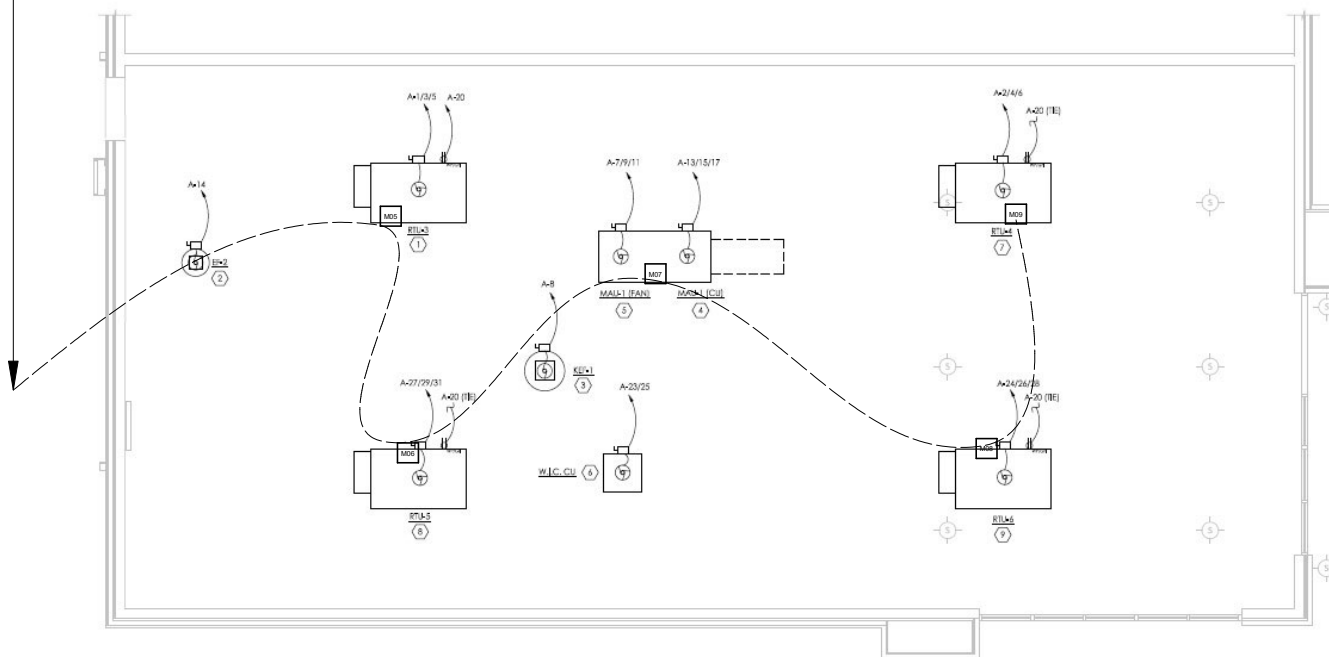


1 ROOF POWER PLAN
1/4" = 1'-0"

FIRE ALARM DEVICE LEGEND

FACP	FIRE ALARM CONTROL PANEL
ANN	ANNUNCIATOR (ANN-80)
AM	ADDRESSABLE MODULE
PS	MANUAL PULL STATION
SD	SMOKE DETECTOR
HS	HORN STROBE
SO	STROBE ONLY

PLANS HAVE BEEN DRAWN TO COMPLY
WITH THE CODES AND STANDARDS OF
THE INTERNATIONAL BUILDING CODE 2018.

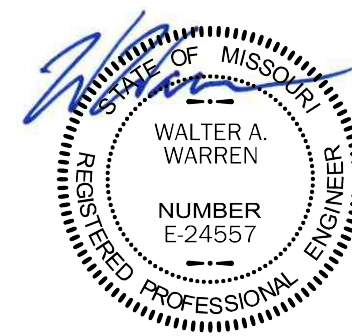

01/13/2023
Warren KTD, LLC



PRODIGY FIRE
SOLUTIONS LLC

1208 MO-7 SUITE G
PLEASANT HILL, MO 64080
816-683-7977

MIKAEL THELIN
ENGINEERING TECH
NICET LEVEL III
C# 146898


CAVA #334
904 PRYOR RD
LEE'S SUMMIT, MO 64081

DATE: 01/10/2023

FIRE ALARM SYSTEM

FA03


FIRE ALARM RISER DIAGRAM

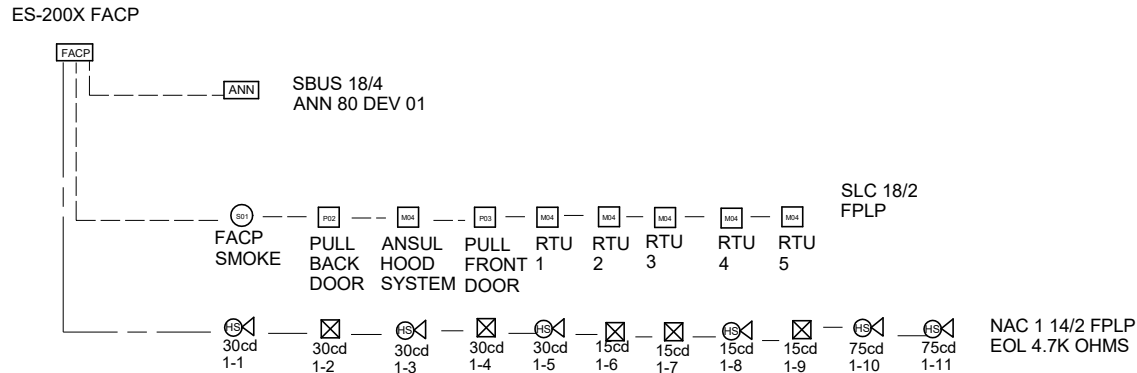

FIRE ALARM DEVICE LEGEND

FACP	FIRE ALARM CONTROL PANEL
ANN	ANNUNCIATOR (ANN-80)
MR	ADDRESSABLE MODULE
PS	MANUAL PULL STATION
SD	SMOKE DETECTOR
HS	HORN STROBE
XS	STROBE ONLY

PLANS HAVE BEEN DRAWN TO COMPLY
WITH THE CODES AND STANDARDS OF
THE INTERNATIONAL BUILDING CODE 2018.

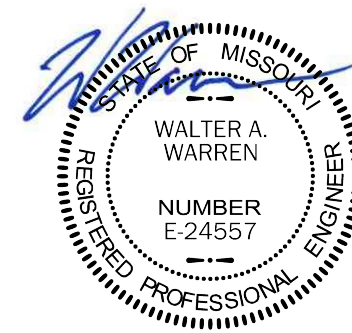

01/13/2023
Warren KTD, LLC