

Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 73
P220320-P220320-02	A01	Common Supported Gable	1	1	Job Reference (optional)

Run: 8.62 S Nov 16 2022 Print: 8.620 S Nov 16 2022 MiTek Industries, Inc. Thu Mar 16 10:12:04 Page: 1
ID:GqalHBL1d133WfnMY0aTwhzaOSF-Xoxp_0weSTurZOZIXFvQ2c6EzzjJgcJFp8SckzaOOw

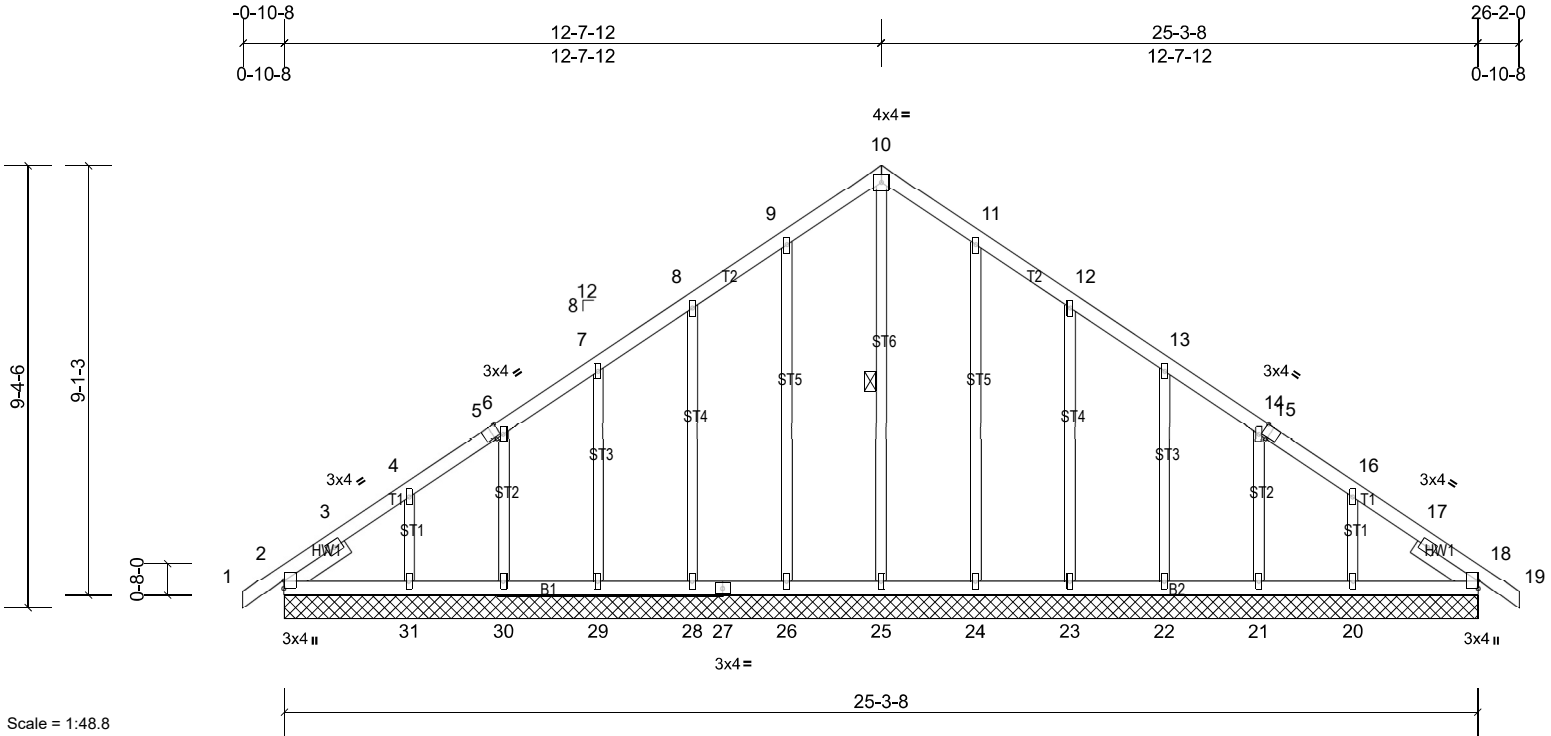


Plate Offsets (X, Y): [5:0-1-12,Edge], [15:0-1-12,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.10	Vert(LL)	n/a	-	n/a	999	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.06	Vert(CT)	n/a	-	n/a	999	
BCLL	0.0	Rep Stress Incr	YES	WB	0.21	Horz(CT)	0.01	18	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 135 lb FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x3 SPF No.2
SLIDER Left 2x4 SP No.2 -- 1-6-8, Right 2x4 SP No.2 -- 1-6-8

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 10-25

REACTIONS All bearings 25-3-8.
(lb) - Max Horiz 2=-252 (LC 10)
Max Uplift All uplift 100 (lb) or less at joint(s) 2, 18, 21, 22, 23, 24, 26, 28, 29, 30 except 20=-133 (LC 13), 31=-142 (LC 12)
Max Grav All reactions 250 (lb) or less at joint(s) 2, 18, 20, 21, 22, 23, 24, 25, 26, 28, 29, 30 except 31=260 (LC 19)


FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-10-8 to 4-1-8, Exterior(2N) 4-1-8 to 12-7-12, Corner(3R) 12-7-12 to 17-7-12, Exterior(2N) 17-7-12 to 26-2-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 1.5x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 26, 28, 29, 30, 24, 23, 22, 21, 18 except (jt=lb) 31=142, 20=132.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 73
P220320-P220320-02	A02	Piggyback Base Structural Gable	1	1	Job Reference (optional)

Run: 8.62 S Nov 16 2022 Print: 8.620 S Nov 16 2022 MiTek Industries, Inc. Thu Mar 16 10:12:05 Page: 1
ID:2dalXkejKjCW0VB9WmXKRzzaORs-UB3aPiyu_58ZpijgegXu71BQgnJlnXWbi7dZgdzaOOu

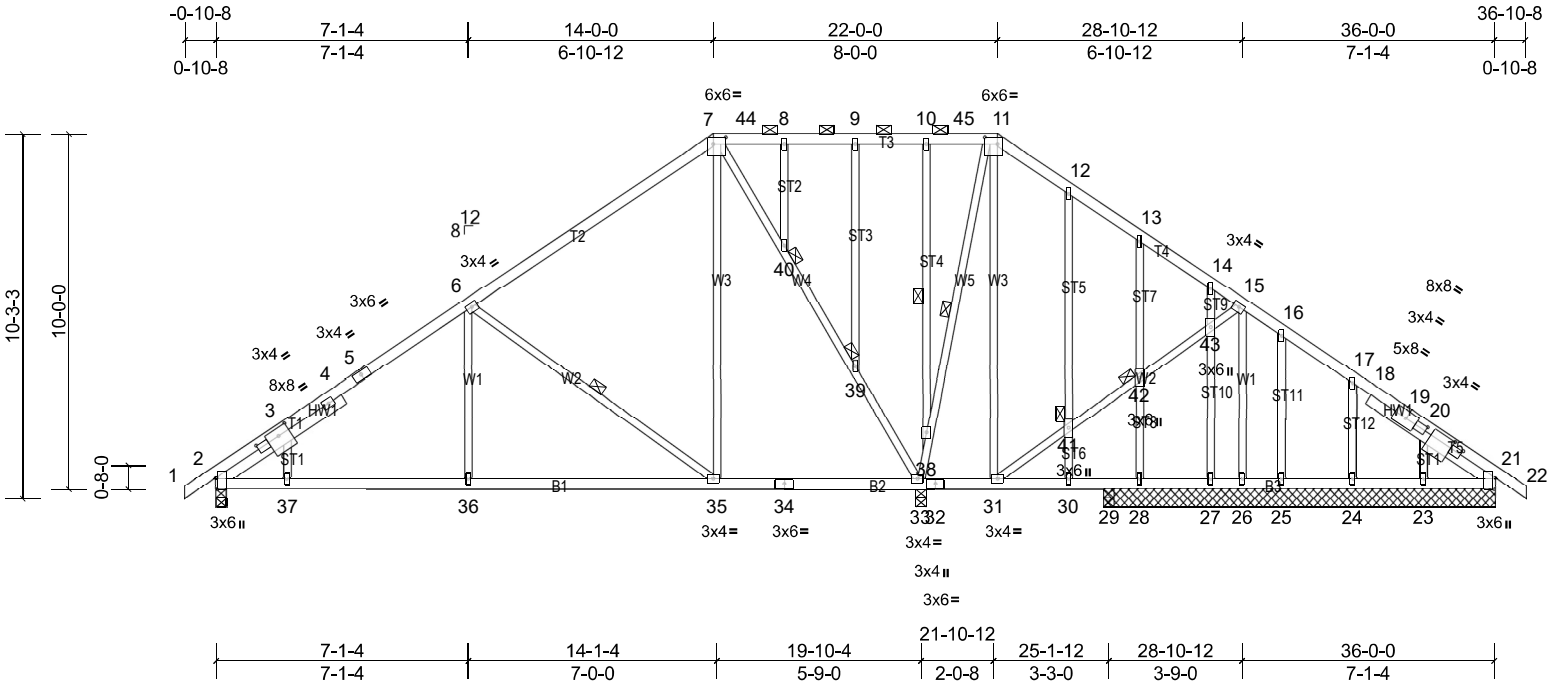

Scale = 1:64.9

Plate Offsets (X, Y): [2:0-3-13,Edge], [2:1-5-4,0-1-8], [3:0-4-0,0-2-8], [7:0-4-4,0-2-4], [11:0-4-4,0-2-4], [20:1-5-14,0-2-8], [21:0-3-13,Edge], [21:1-1-14,0-1-8], [21:2-4-4,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.66	Vert(LL)	0.08	36-37	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.43	Vert(CT)	-0.11	35-36	>999	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.44	Horz(CT)	0.02	33	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 224 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x3 SPF No.2
OTHERS 2x3 SPF No.2
SLIDER Left 2x4 SP No.2 -- 4-2-10, Right 2x4 SP No.2 -- 4-2-10

REACTIONS All bearings 11-0-0. except 2=0-3-8, 33=0-3-8, 29=0-3-8
(lb) - Max Horiz 2=278 (LC 11)
Max Uplift All uplift 100 (lb) or less at joint(s) 21, 23, 24, 25, 26, 27, 28, 29 except 2=158 (LC 12), 33=-200 (LC 9)
Max Grav All reactions 250 (lb) or less at joint(s) 21, 23, 24, 25, 26, 27, 28, 29 except 2=874 (LC 1), 33=1382 (LC 1)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1052/95, 3-4=-971/162, 4-5=-918/164, 5-6=-800/189, 6-7=-480/189
BOT CHORD 2-37=-203/863, 36-37=-199/862, 35-36=-199/862, 34-35=-74/353, 33-34=-74/353
WEBS 6-36=0/281, 6-35=-648/290, 7-35=-83/500, 7-40=-813/171, 39-40=-850/172, 33-39=-874/180, 33-38=-529/152, 10-38=-327/170

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 14-0-0, Exterior(2R) 14-0-0 to 21-0-14, Interior (1) 21-0-14 to 22-0-0, Exterior(2R) 22-0-0 to 28-10-12, Interior (1) 28-10-12 to 36-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Provide adequate drainage to prevent water ponding.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 26, 21, 28, 27, 25, 24, 23, 29 except (jt=lb) 2=158, 33=199.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.


LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-4-15 oc purlins, except
2-0-0 oc purlins (10-0-0 max.): 7-11.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing. Except:
10-0-0 oc bracing: 2-37,36-37,35-36,33-35.
WEBS 1 Row at midpt 6-35, 11-33, 10-38
JOINTS 1 Brace at Jt(s): 39, 40, 41, 42

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

Run: 8.62 S Nov 16 2022 Print: 8.620 S Nov 16 2022 MiTek Industries, Inc. Thu Mar 16 10:12:05 Page: 1
ID:pA3mDTIkraDOzkoi_SgClfzaORk-UB3aPiYu_58Zpijgexgu71BO1nIRnVbbi7dZgdzaOOu

[illegible]

TOP CHORD 2x4 SP No.2 *Except* T3:2x4 SP 1650F 1.5E
 BOT CHORD 2x4 SP No.2
 WEBS 2x3 SPF No.2 *Except* W4:2x4 SP No.2
 SLIDER Left 2x4 SP No.2 -- 4-2-15, Right 2x4 SP No.2 -- 3-7-11

(lb) - Max Horiz 2=278 (LC 11)
 Max Uplift All uplift 100 (lb) or less at joint(s) except 2=-164 (LC 12),
 10=-135 (LC 13), 14=-124 (LC 13), 17=-133 (LC 12)
 Max Grav All reactions 250 (lb) or less at joint(s) except 2=879 (LC 25),
 10=517 (LC 26), 14=557 (LC 26), 17=1491 (LC 1)

TOP CHORD 2-3=-1040/156, 3-21=-919/162, 4-21=-898/186, 4-5=-489/162, 5-6=-350/203, 6-22=0/283, 22-23=0/283, 7-23=0/284,
7-8=0/290, 10-24=-504/117

BOT CHORD 2-20=-210/804, 19-20=-210/804, 18-19=-143/337, 17-18=-143/337, 13-14=-12/252, 12-13=0/300, 10-12=0/300

WEBS 4-20=0/308, 4-19=-647/288, 6-19=-90/501, 6-17=-949/173, 7-17=-563/121, 9-14=-567/232, 9-13=0/261


- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDF=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 14-0-0, Exterior(2R) 14-0-0 to 21-0-14, Interior (1) 21-0-14 to 22-0-0, Exterior(2R) 22-0-0 to 28-11-5, Interior (1) 28-11-5 to 36-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are MT20 plates unless otherwise indicated.
- 5) All plates are 3x4 MT20 unless otherwise indicated.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 164 lb uplift at joint 2, 133 lb uplift at joint 17, 123 lb uplift at joint 14 and 135 lb uplift at joint 10.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

TOP CHORD Structural wood sheathing directly applied or 5-3-2 oc purlins, except
2-0-0 oc purlins (10-0-0 max.): 6-7.

6-0-0 oc bracing: 15-17,14-15.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

Run: 8.62 S Nov 16 2022 Print: 8.620 S Nov 16 2022 MiTek Industries, Inc. Thu Mar 16 10:12:06 Page: 1
ID:s3TRMbw8Jn6GH1SaM5RkspzaORV-yNdYd2yWIOHQRSItCOS7gEkblAeYWtqlxnN7C3zaOOt



LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-2-5 oc purlins, except
BOT CHORD	2x4 SP No.2 *Except* B2,B4:2x3 SPF No.2		2-0-0 oc purlins (6-0-0 max.): 6-8.
WEBS	2x3 SPF No.2	BOT CHORD	Rigid ceiling directly applied or 3-8-2 oc bracing. Except:
SLIDER	Left 2x4 SP No.2 -- 4-2-15, Right 2x4 SP No.2 -- 3-4-2	1 Row at midpt	7-19
REACTIONS (lb/size)	2=905/0-3-8, (min. 0-1-8), 13=722/0-3-8, (min. 0-1-8), 20=1736/0-3-8, (min. 0-2-1)	WEBS	1 Row at midpt 4-21, 6-19, 8-18
Max Horiz	2=-277 (LC 10)		MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.
Max Uplift	2=-175 (LC 12), 13=-195 (LC 13), 20=-110 (LC 12)		
Max Grav	2=920 (LC 25), 13=738 (LC 26), 20=1736 (LC 1)		


FORCES	(lb) - Max. Comp./Max. Ten. All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-1112/176, 3-24=-992/182, 4-24=-881/206, 4-5=-560/168, 5-6=-413/209, 8-9=-160/256, 9-10=-395/240, 10-27=-431/217, 11-27=-500/209, 11-28=-675/244, 12-28=-755/225, 12-13=-860/220
BOT CHORD	2-23=-222/880, 22-23=-222/880, 21-22=-222/880, 19-20=-1687/206, 7-19=-970/193, 17-18=0/330, 9-17=-67/398, 13-15=-86/628
WEBS	4-23=0/304, 4-21=-645/288, 6-21=-87/463, 19-21=-117/386, 6-19=-745/153, 7-18=-101/619, 9-18=-625/248, 15-17=-91/614, 11-17=-385/194

- ### NOTES
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 14-0-0, Exterior(2R) 14-0-0 to 21-0-14, Interior (1) 21-0-14 to 22-0-0, Exterior(2R) 22-0-0 to 29-0-14, Interior (1) 29-0-14 to 36-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) All plates are 3x4 MT20 unless otherwise indicated.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 175 lb uplift at joint 2, 110 lb uplift at joint 20 and 195 lb uplift at joint 13.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 73
P220320-P220320-02	A05	Piggyback Base	3	1	Job Reference (optional)

Run: 8.62 S Nov 16 2022 Print: 8.620 S Nov 16 2022 MiTek Industries, Inc. Thu Mar 16 10:12:06 Page: 1
ID:IqjyCzzfN0chlflLbXWg1fzaORR-yNdyd2yWIOHQRSltCOS7gEkbEAYPWUjlxnN7C3zaOOt

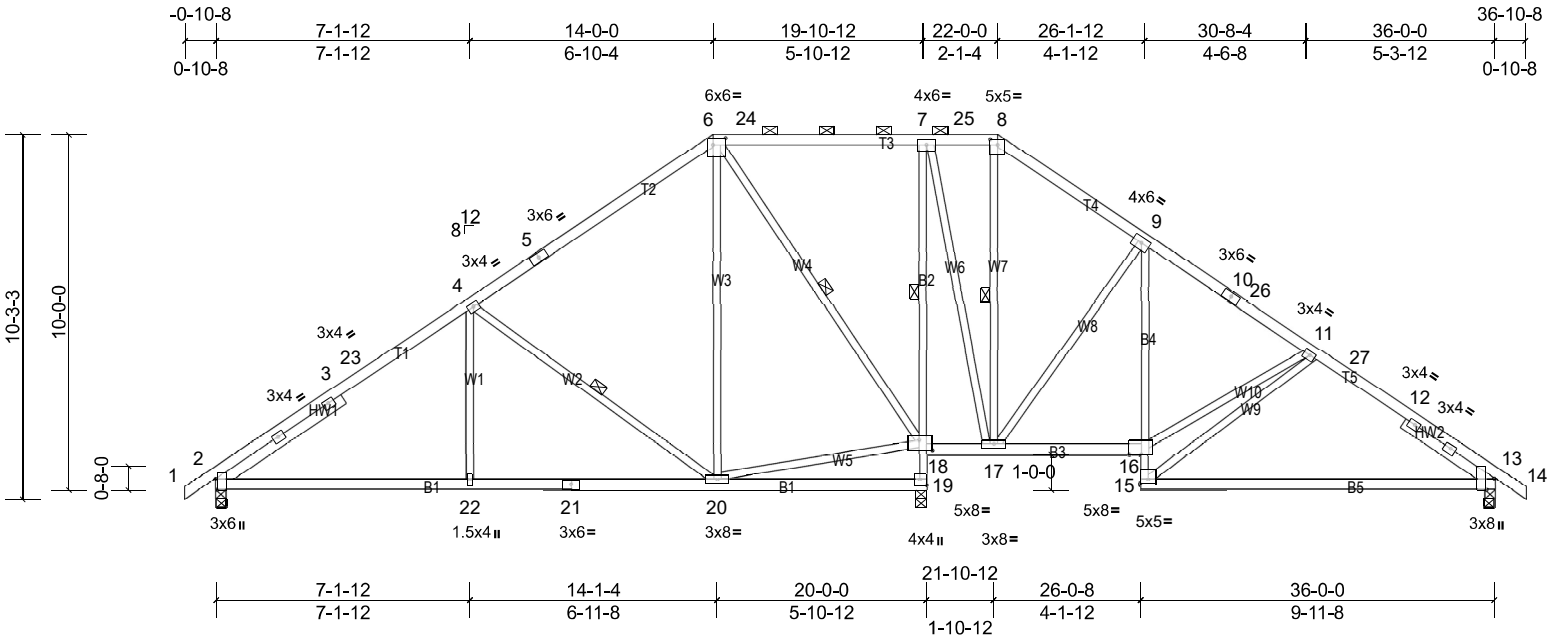

Scale = 1:64.9

Plate Offsets (X, Y): [2:0-3-13,Edge], [6:0-4-4,0-2-4], [8:0-2-8,0-1-13], [13:0-3-13,Edge], [15:Edge,0-1-8], [18:0-4-8,0-3-8], [19:Edge,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.68	Vert(LL)	-0.30	13-15	>636	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.89	Vert(CT)	-0.62	13-15	>314	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.76	Horz(CT)	0.04	13	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 203 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except* B2,B4:2x3 SPF No.2
WEBS 2x3 SPF No.2
SLIDER Left 2x4 SP No.2 -- 4-2-15, Right 2x4 SP No.2 -- 3-0-7

REACTIONS (lb/size) 2=882/0-3-8, (min. 0-1-8), 13=694/0-3-8, (min. 0-1-8),
19=1786/0-3-8, (min. 0-2-2)
Max Horiz 2=-277 (LC 10)
Max Uplift 2=-167 (LC 12), 13=-179 (LC 13), 19=-128 (LC 12)
Max Grav 2=921 (LC 25), 13=708 (LC 26), 19=1786 (LC 1)

FORCES

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1114/162, 3-23=-994/168, 4-23=-883/192, 4-5=-562/147, 5-6=-415/189, 9-10=-420/219, 10-26=-425/203,
11-26=-513/190, 11-27=-588/258, 12-27=-669/241, 12-13=-756/238
BOT CHORD 2-22=-210/861, 21-22=-210/861, 20-21=-210/861, 18-19=-1736/222, 7-18=-1010/200, 16-17=0/354, 15-16=-57/439,
9-16=-54/357, 13-15=-99/556
WEBS 4-22=0/304, 4-20=-646/289, 6-20=-89/460, 18-20=-117/371, 6-18=-779/165, 7-17=-122/669, 9-17=-594/247,
11-16=-10/253, 11-15=-544/181

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 14-0-0, Exterior(2R) 14-0-0 to 21-0-14, Interior (1) 21-0-14 to 22-0-0, Exterior(2R) 22-0-0 to 29-0-14, Interior (1) 29-0-14 to 36-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 167 lb uplift at joint 2, 128 lb uplift at joint 19 and 179 lb uplift at joint 13.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard


BRACING

TOP CHORD Structural wood sheathing directly applied or 5-2-3 oc purlins, except
2-0-0 oc purlins (6-0-0 max.): 6-8.
BOT CHORD Rigid ceiling directly applied or 3-7-7 oc bracing. Except:
1 Row at midpt 4-20, 6-18, 8-17
WEBS 1 Row at midpt

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 73
P220320-P220320-02	A06	Piggyback Base	1	1	Job Reference (optional)

Run: 8.62 S Nov 16 2022 Print: 8.620 S Nov 16 2022 MiTek Industries, Inc. Thu Mar 16 10:12:07 Page: 1
ID:2AebgM32j9Vl5jniWv8Jp8zaORK-yNdyd2yWlOHQRsltCOS7gEkXMAbtWqMlxnN7C3zaOOt

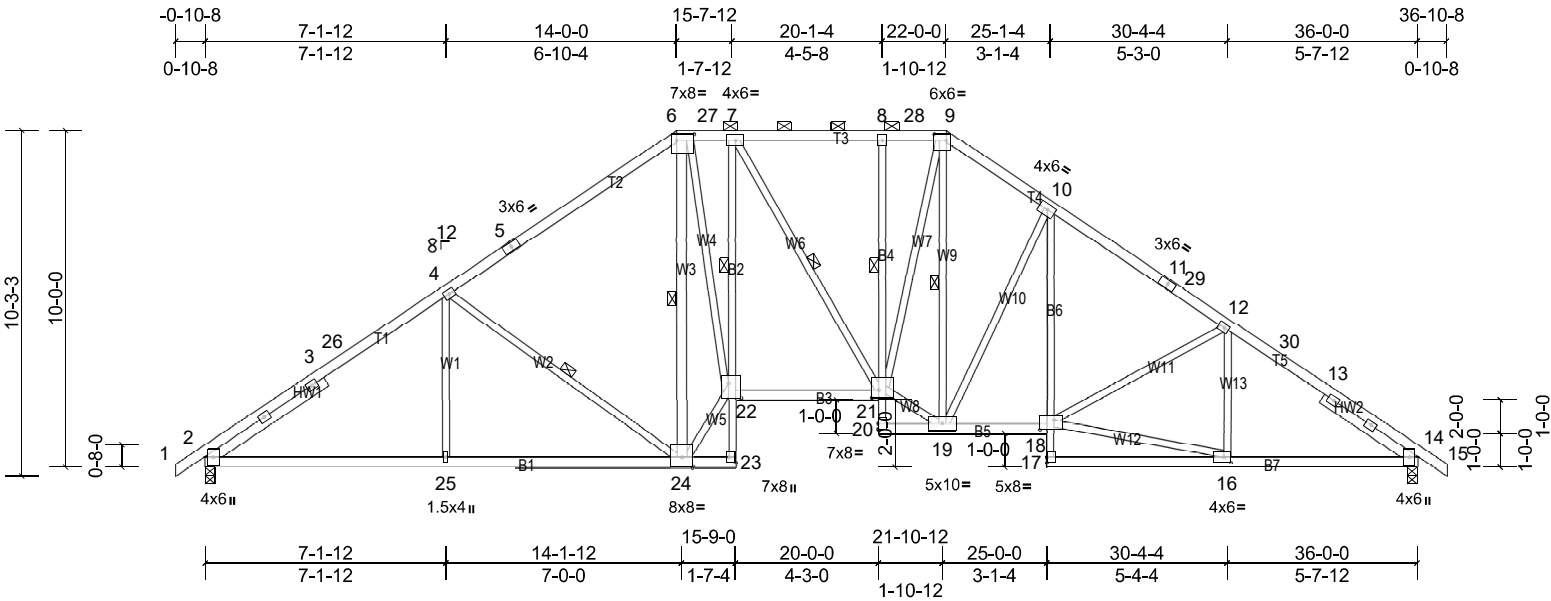

Scale = 1:68.4

Plate Offsets (X, Y): [2:0-3-5,0-0-15], [6:0-6-4,0-2-4], [9:0-4-4,0-2-4], [14:0-3-5,0-0-15], [16:0-2-8,0-2-0], [18:0-5-0,0-3-8], [21:0-2-8,0-2-12], [22:0-5-4,0-4-8], [23:Edge,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI	0.92	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.92	Vert(LL)	-0.19	21-22	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.67	Vert(CT)	-0.36	21-22	>999	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.98	Horz(CT)	0.26	14	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 223 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied, except
BOT CHORD	2x4 SP No.2 *Except* B2,B4,B6:2x3 SPF No.2		2-0-0 oc purlins (3-10-3 max.): 6-9.
WEBS	2x3 SPF No.2 *Except* W3:2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
SLIDER	Left 2x4 SP No.2 -- 4-2-15, Right 2x4 SP No.2 -- 3-4-2		6-0-0 oc bracing: 22-23,20-21,19-20.
REACTIONS (lb/size)	2=1681/0-3-8, (min. 0-2-0), 14=1681/0-3-8, (min. 0-2-0)	1 Row at midpt	7-22, 8-21
Max Horiz	2=-278 (LC 10)	WEBS	1 Row at midpt
Max Uplift	2=-225 (LC 12), 14=-225 (LC 13)		4-24, 6-24, 7-21, 9-19
			MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.


FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-2402/258, 3-26=-2260/264, 4-26=-2171/289, 4-5=-1883/291, 5-6=-1743/325, 6-27=-1850/351, 7-27=-1850/351, 7-8=-1873/345, 8-28=-1868/345, 9-28=-1869/344, 9-10=-2002/377, 10-11=-2305/341, 11-29=-2331/318, 12-29=-2400/309, 12-30=-2249/294, 13-30=-2341/274, 13-14=-2433/269
BOT CHORD	2-25=-289/1874, 24-25=-289/1874, 7-22=-345/256, 21-22=-127/1857, 8-21=-252/122, 18-19=-100/1919, 10-18=-73/531, 14-16=-149/1898
WEBS	4-25=0/295, 4-24=-586/281, 6-24=-1385/147, 22-24=-158/2316, 6-22=-106/2034, 19-21=-3/1784, 9-21=-202/1152, 9-19=-302/209, 10-19=-738/253, 16-18=-151/1849, 12-16=-296/108

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 14-0-0, Exterior(2R) 14-0-0 to 21-0-14, Interior (1) 21-0-14 to 22-0-0, Exterior(2R) 22-0-0 to 29-0-14, Interior (1) 29-0-14 to 36-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are 3x4 MT20 unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 225 lb uplift at joint 2 and 225 lb uplift at joint 14.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 73
P220320-P220320-02	A07	Piggyback Base	3	1	Job Reference (optional)

Run: 8.62 S Nov 16 2022 Print: 8.620 S Nov 16 2022 MiTek Industries, Inc. Thu Mar 16 10:12:07 Page: 1
ID:hUM8BTCZvr??XZi?DRM7IfzaOR8-QZBKqOz9WiPH2?s3m5zMDShhKaytEHguAR6glVzaOOs

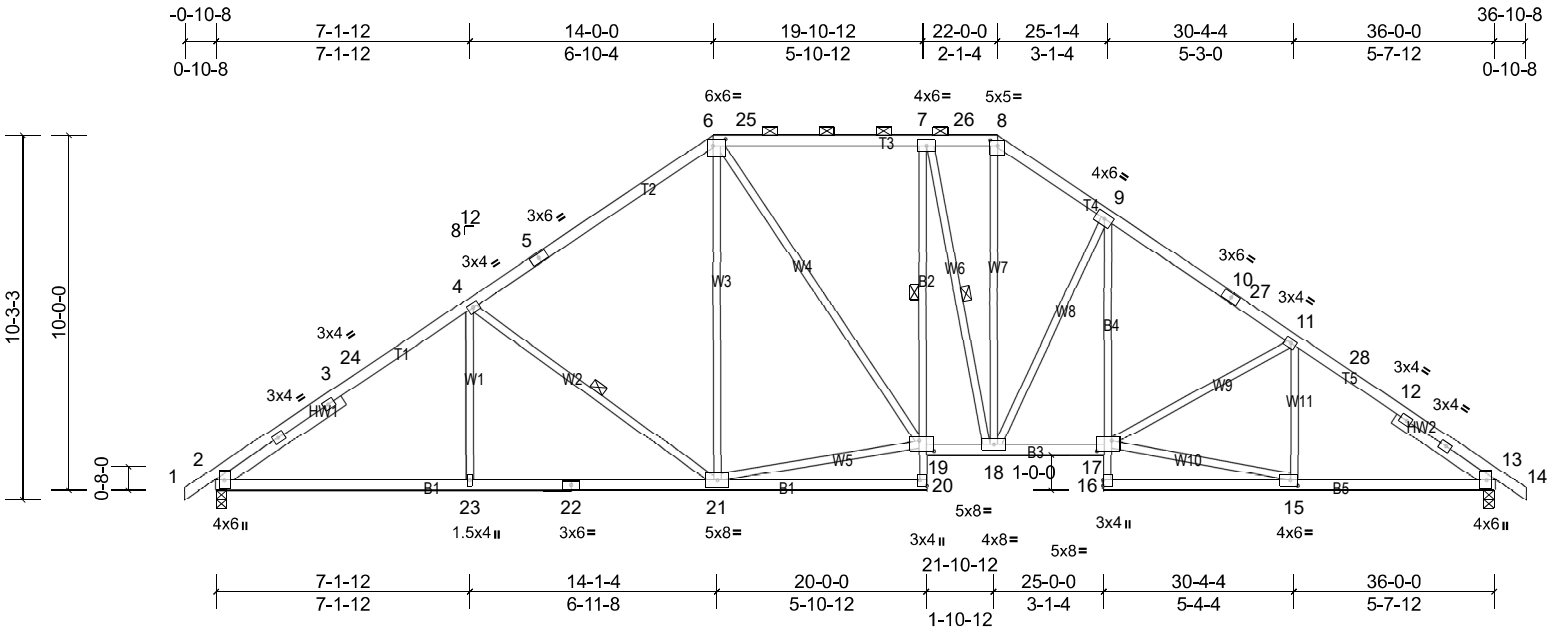

Scale = 1:64.9

Plate Offsets (X, Y): [2:0-3-5,0-0-15], [6:0-4-4,0-2-4], [8:0-2-8,0-1-13], [13:0-3-5,0-0-15], [15:0-2-8,0-2-0], [17:0-5-0,0-3-8], [19:0-5-0,0-3-8], [20:Edge,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.97	Vert(LL)	-0.13	19	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.62	Vert(CT)	-0.24	20-21	>999	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.98	Horz(CT)	0.14	13	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 207 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except* B2,B4:2x3 SPF No.2
WEBS 2x3 SPF No.2
SLIDER Left 2x4 SP No.2 -- 4-2-15, Right 2x4 SP No.2 -- 3-4-2

REACTIONS (lb/size) 2=1681/0-3-8, (min. 0-2-0), 13=1681/0-3-8, (min. 0-2-0)
Max Horiz 2=-277 (LC 10)
Max Uplift 2=-225 (LC 12), 13=-225 (LC 13)

BRACING

TOP CHORD Structural wood sheathing directly applied, except 2-0-0 oc purlins (3-6-12 max.): 6-8.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except: 7-19
1 Row at midpt 4-21, 7-18
WEBS

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

FORCES

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2404/259, 3-24=-2262/265, 4-24=-2173/290, 4-5=-1880/290, 5-6=-1740/325, 6-25=-1695/349, 7-25=-1694/349, 7-26=-1605/338, 8-26=-1606/338, 8-9=-1998/375, 9-10=-2303/341, 10-27=-2331/318, 11-27=-2400/309, 11-28=-2249/294, 12-28=-2341/274, 12-13=-2434/269
BOT CHORD 2-23=-290/1875, 22-23=-290/1875, 21-22=-290/1875, 18-19=-68/1695, 17-18=-100/1918, 9-17=-72/536, 13-15=-149/1899
WEBS 4-23=0/296, 4-21=-592/284, 6-21=-71/297, 19-21=-111/1388, 6-19=-131/543, 7-18=-514/223, 8-18=-185/960, 9-18=-735/252, 15-17=-151/1851, 11-15=-296/108


NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 14-0-0, Exterior(2R) 14-0-0 to 21-0-14, Interior (1) 21-0-14 to 22-0-0, Exterior(2R) 22-0-0 to 29-0-14, Interior (1) 29-0-14 to 36-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are 3x4 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 225 lb uplift at joint 2 and 225 lb uplift at joint 13.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 73
P220320-P220320-02	A08	Piggyback Base	2	1	Job Reference (optional)

Run: 8.62 S Nov 16 2022 Print: 8.620 S Nov 16 2022 MiTek Industries, Inc. Thu Mar 16 10:12:07 Page: 1
ID:2RA1EAgiNeHeLbz?_xl?jzaOR3-QZBKqOz9WiPH2?s3m5zMDSHIWasiElJuAR6glVzaOOs

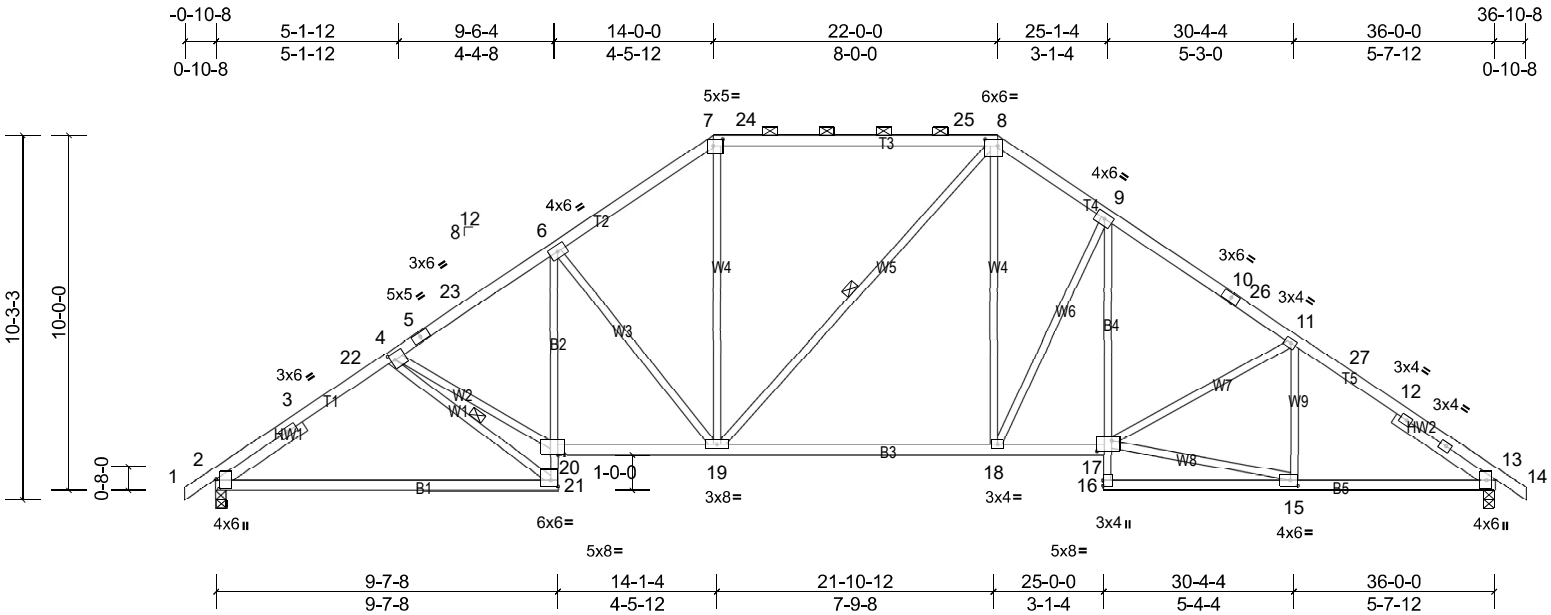

Scale = 1:64.9

Plate Offsets (X, Y): [2:0-3-5,0-1-3], [4:0-1-8,0-2-4], [7:0-3-4,0-2-4], [8:0-4-4,0-2-4], [13:0-3-5,0-0-15], [15:0-2-8,0-2-0], [17:0-5-0,0-3-8], [20:0-2-4,0-0-4], [21:Edge,0-2-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.70	Vert(LL)	-0.28	2-21	>999	240	MT20 244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.98	Vert(CT)	-0.58	2-21	>740	180	
BCLL	0.0	Rep Stress Incr	YES	WB	0.91	Horz(CT)	0.21	13	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 195 lb FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2 *Except* T3:2x4 SP 2400F 2.0E
BOT CHORD 2x4 SP No.2 *Except* B2,B4:2x3 SPF No.2
WEBS 2x3 SPF No.2
SLIDER Left 2x4 SP No.2 -- 2-11-4, Right 2x4 SP No.2 -- 3-4-2

REACTIONS (lb/size) 2=1681/0-3-8, (min. 0-2-0), 13=1681/0-3-8, (min. 0-2-0)
Max Horiz 2=277 (LC 11)
Max Uplift 2=-225 (LC 12), 13=-225 (LC 13)

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-1-9 oc purlins, except
2-0-0 oc purlins (4-7-14 max.): 7-8.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
2-2-0 oc bracing: 2-21,20-21.

WEBS 1 Row at midpt 4-21, 8-19
MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

FORCES

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2405/314, 3-22=-2309/318, 4-22=-2227/333, 4-5=-2459/321, 5-23=-2383/331, 6-23=-2380/348, 6-7=-2025/355, 7-24=-1624/344, 24-25=-1624/344, 8-25=-1624/344, 8-9=-1990/366, 9-10=-2299/341, 10-26=-2330/318, 11-26=-2399/310, 11-27=-2250/294, 12-27=-2342/274, 12-13=-2435/269
BOT CHORD 2-21=-349/1866, 20-21=-240/1381, 6-20=-76/395, 19-20=-232/1989, 18-19=-20/1622, 17-18=-100/1912, 9-17=-86/532, 13-15=-149/1900
WEBS 4-21=-2046/467, 4-20=-285/1978, 6-19=-638/268, 7-19=-49/632, 8-18=-151/698, 9-18=-691/255, 15-17=-159/1852, 11-15=-297/110


NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 14-0-0, Exterior(2R) 14-0-0 to 21-0-14, Interior (1) 21-0-14 to 22-0-0, Exterior(2R) 22-0-0 to 29-0-14, Interior (1) 29-0-14 to 36-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 225 lb uplift at joint 2 and 225 lb uplift at joint 13.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 73
P220320-P220320-02	A09	Piggyback Base	5	1	Job Reference (optional)

Run: 8.62 S Nov 16 2022 Print: 8.620 S Nov 16 2022 MiTek Industries, Inc. Thu Mar 16 10:12:07 Page: 1
ID:tbXIVEKTDJORMG26ME2IE_zaOQz-QZBKqOz9WiPH2?s3m5zMDSHkgasJEHsuAR6glVzaOOs

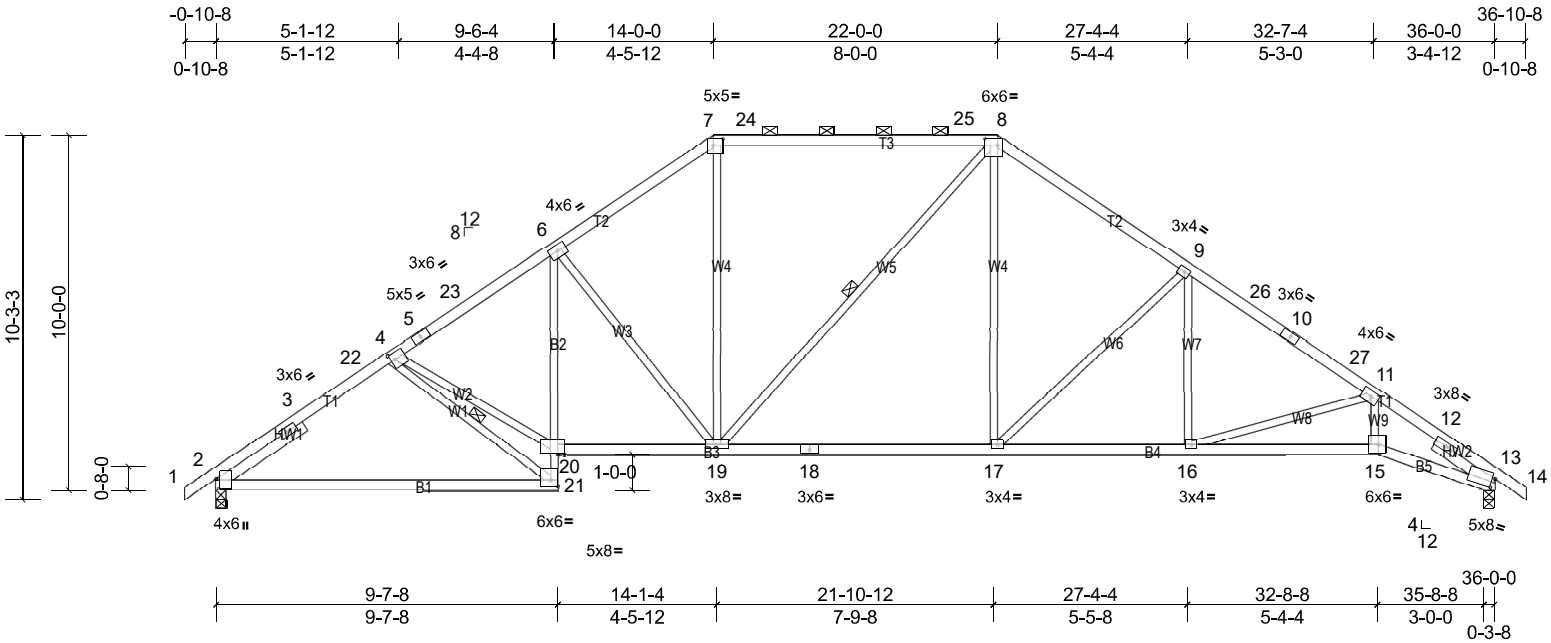

Scale = 1:64.9

Plate Offsets (X, Y): [2:0-3-5,0-1-3], [4:0-1-8,0-2-4], [7:0-3-4,0-2-4], [8:0-4-4,0-2-4], [13:0-0-11,0-3-3], [20:0-2-4,0-0-4], [21:Edge,0-2-4]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.82	Vert(LL)	-0.28	2-21	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.97	Vert(CT)	-0.59	2-21	>731	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.96	Horz(CT)	0.29	13	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 185 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP 2400F 2.0E *Except* T2:2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except* B2:2x3 SPF No.2, B5:2x4 SP 1650F 1.5E
WEBS 2x3 SPF No.2
SLIDER Left 2x4 SP No.2 -- 2-11-4, Right 2x4 SP No.2 -- 2-0-7
REACTIONS (lb/size) 2=1677/0-3-8, (min. 0-2-0), 13=1684/0-3-8, (min. 0-1-13)
Max Horiz 2=278 (LC 11)
Max Uplift 2=-224 (LC 12), 13=-226 (LC 13)


BRACING
TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except
2-0-0 oc purlins (4-7-5 max.): 7-8.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
2-2-0 oc bracing: 2-21,20-21.
WEBS 1 Row at midpt 4-21, 8-19
MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2400/314, 3-22=-2303/319, 4-22=-2221/334, 4-5=-2451/321, 5-23=-2375/331, 6-23=-2370/348, 6-7=-2017/354, 7-24=-1618/344, 24-25=-1618/344, 8-25=-1618/344, 8-9=-2036/340, 9-26=-2460/327, 10-26=-2505/307, 10-27=-2532/306, 11-27=-2577/296, 11-12=-3784/428, 12-13=-3858/414
BOT CHORD 2-21=-349/1862, 20-21=-240/1378, 6-20=-76/395, 19-20=-231/1982, 18-19=-20/1609, 17-18=-20/1609, 16-17=-146/2107, 15-16=-260/2883, 13-15=-278/3097
WEBS 4-21=-2040/468, 4-20=-284/1969, 6-19=-637/268, 7-19=-50/626, 8-17=-96/617, 9-17=-708/262, 9-16=-3/377, 11-16=-812/224, 11-15=-29/992

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 14-0-0, Exterior(2R) 14-0-0 to 21-0-14, Interior (1) 21-0-14 to 22-0-0, Exterior(2R) 22-0-0 to 29-0-14, Interior (1) 29-0-14 to 36-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed ; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Bearing at joint(s) 13 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 224 lb uplift at joint 2 and 226 lb uplift at joint 13.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 73
P220320-P220320-02	A10	Piggyback Base	2	1	Job Reference (optional)

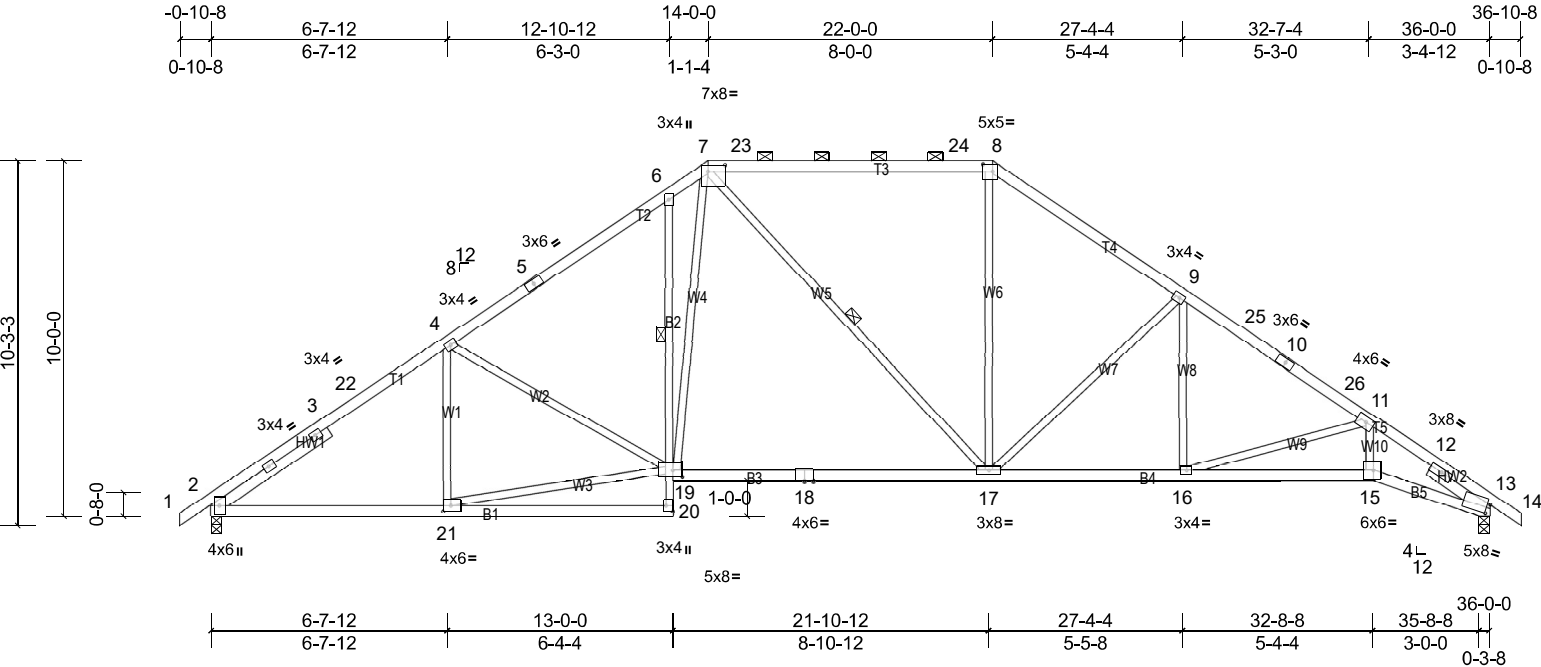

Scale = 1:64.9

Plate Offsets (X, Y): [2:0-3-5,0-0-15], [7:0-5-12,0-2-0], [8:0-3-4,0-2-4], [13:0-0-11,0-3-3], [19:0-3-4,0-2-4], [20:Edge,0-2-8], [21:0-2-8,0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.99	Vert(LL)	-0.24	17-19	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.86	Vert(CT)	-0.54	17-19	>798	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.95	Horz(CT)	0.22	13	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S								
											Weight: 188 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2 *Except* T3:2x4 SP 1650F 1.5E, T5:2x4 SP 2400F 2.0E
BOT CHORD 2x4 SP No.2 *Except* B2:2x3 SPF No.2, B5:2x4 SP 1650F 1.5E
WEBS 2x3 SPF No.2
SLIDER Left 2x4 SP No.2 -- 3-11-5, Right 2x4 SP No.2 -- 2-0-7

BRACING
TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except
2-0-0 oc purlins (2-2-0 max.): 7-8.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
6-0-0 oc bracing: 20-21.
1 Row at midpt
WEBS 6-19
1 Row at midpt 7-17

REACTIONS (lb/size) 2=1677/0-3-8, (min. 0-2-0), 13=1684/0-3-8, (min. 0-1-13)
Max Horiz 2=-278 (LC 10)
Max Uplift 2=-224 (LC 12), 13=-226 (LC 13)

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2408/260, 3-22=-2300/265, 4-22=-2193/288, 4-5=-2167/317, 5-6=-2044/342, 6-7=-2045/460, 7-23=-1616/337, 23-24=-1617/337, 8-24=-1617/337, 8-9=-2045/337, 9-25=-2456/328, 10-25=-2501/309, 10-26=-2528/307, 11-26=-2573/298, 11-12=-3787/427, 12-13=-3860/412


BOT CHORD 2-21=-294/1878, 6-19=-336/233, 18-19=-133/1605, 17-18=-133/1605, 16-17=-147/2104, 15-16=-259/2885, 13-15=-277/3100

WEBS 19-21=-267/1877, 4-19=-282/213, 7-19=-305/902, 8-17=-48/622, 9-17=-695/269, 9-16=-10/351, 11-16=-817/221, 11-15=-27/997

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 14-0-0, Exterior(2R) 14-0-0 to 21-0-14, Interior (1) 21-0-14 to 22-0-0, Exterior(2R) 22-0-0 to 29-0-14, Interior (1) 29-0-14 to 36-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Bearing at joint(s) 13 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 224 lb uplift at joint 2 and 226 lb uplift at joint 13.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

Run: 8.62 S Nov 16 2022 Print: 8.620 S Nov 16 2022 MiTek Industries, Inc. Thu Mar 16 10:12:08 Page: 1
ID: tP6aCgySlupCz5RwrSTfpkzaOQA-umli1k_nH0X8g9RFK0Ublfpt4_Bdzlf2O5sDHxzaOOr



LUMBER		BRACING	
TOP CHORD	2x4 SP No.2 *Except* T5:2x4 SP 2400F 2.0E	TOP CHORD	Structural wood sheathing directly applied or 1-8-5 oc purlins, except 2-0-0 oc purlins (4-4-13 max.): 9-11. Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 2-2-0 oc bracing: 28-29.
BOT CHORD	2x4 SP No.2 *Except* B2,B4,B5:2x3 SPF No.2, B8:2x4 SP 1650F 1.5E	BOT CHORD	
WEBS	2x3 SPF No.2 *Except* W1:2x4 SP No.2		
SLIDER	Left 2x4 SP No.2 -- 1-1-9, Right 2x4 SP No.2 -- 2-0-7		
REACTIONS	(lb/size) 2=1677/0-3-8, (min. 0-2-0), 16=1684/0-3-8, (min. 0-1-13)	WEBS	1 Row at midpt 10-20, 10-21
	Max Horiz 2=278 (LC 11)		MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.
	Max Uplift 2=-224 (LC 12), 16=-226 (LC 13)		


NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDFL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 14-0-0, Exterior(2R) 14-0-0 to 21-0-14, Interior (1) 21-0-14 to 22-0-0, Exterior(2R) 22-0-0 to 29-0-14, Interior (1) 29-0-14 to 36-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are 3x4 MT20 unless otherwise indicated.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Bearing at joint(s) 16 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 224 lb uplift at joint 2 and 226 lb uplift at joint 16.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 73
P220320-P220320-02	A12	Piggyback Base Supported Gable	1	1	Job Reference (optional)

Run: 8.62 S Nov 16 2022 Print: 8.620 S Nov 16 2022 MiTek Industries, Inc. Thu Mar 16 10:12:08 Page: 1
ID: TvX9rukE_s?zG5vP9c7vxSzaOP9-umli1k_nH0X8g9RFKoUblfp4q_PTzxN2O5sDHxaZOOr

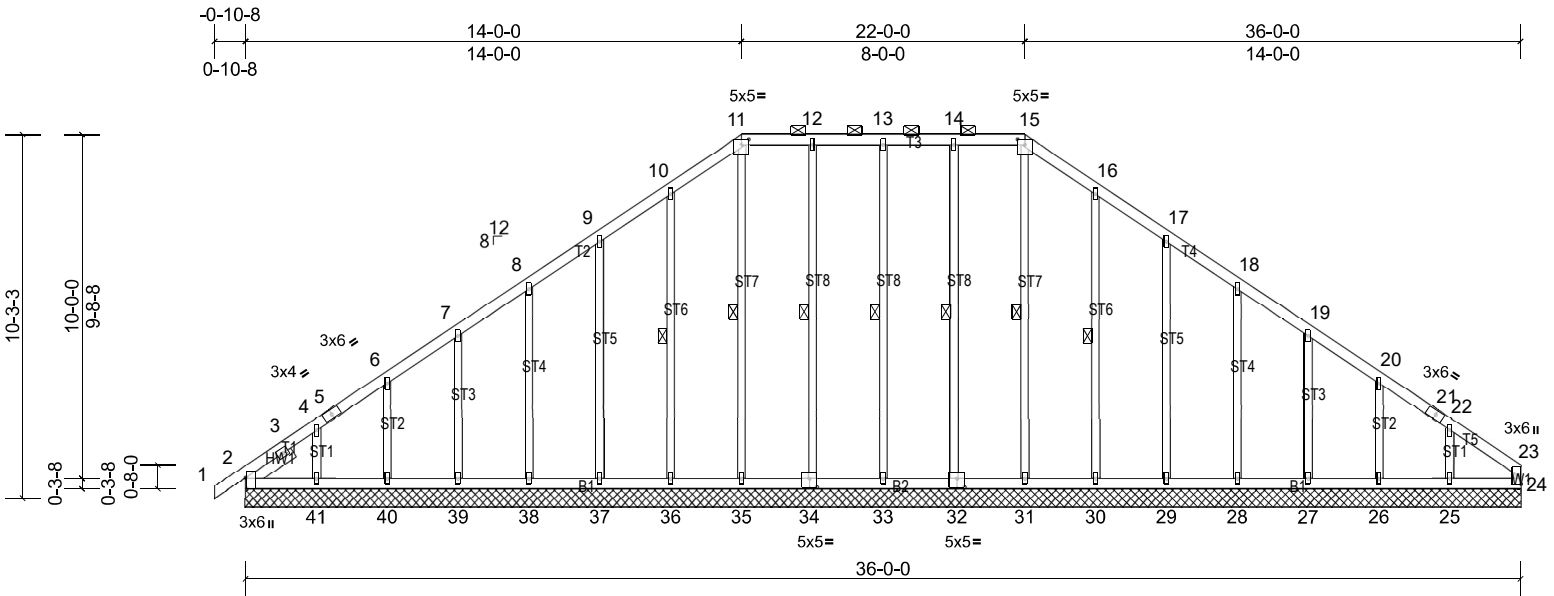

Scale = 1:65.1

Plate Offsets (X, Y): [2:0-3-13,Edge], [11:0-2-8,0-1-13], [15:0-2-8,0-1-13], [32:0-2-8,0-3-0], [34:0-2-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.09	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.08	Vert(CT)	n/a	-	n/a	999	244/190
BCLL	0.0	Rep Stress Incr	YES	WB	0.18	Horz(CT)	0.01	24	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 205 lb FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x3 SPF No.2
OTHERS 2x3 SPF No.2
SLIDER Left 2x4 SP No.2 -- 1-6-4

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 11-15.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 15-31, 14-32, 13-33, 12-34, 11-35, 10-36, 16-30

REACTIONS

All bearings 36-0-0.
(lb) - Max Horiz 2=281 (LC 9)
Max Uplift All uplift 100 (lb) or less at joint(s) 24, 26, 27, 28, 29, 30, 32, 33, 34, 35, 36, 37, 38, 39, 40 except 2=-116 (LC 8), 25=-136 (LC 13), 41=-131 (LC 12)
Max Grav All reactions 250 (lb) or less at joint(s) 2, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41

FORCES

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-282/244, 3-4=-270/250, 9-10=-154/252, 10-11=-193/294, 11-12=-167/268, 12-13=-167/268, 13-14=-167/268, 14-15=-167/268, 15-16=-193/294




NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-10-8 to 4-0-0, Exterior(2N) 4-0-0 to 14-0-0, Corner(3R) 14-0-0 to 19-0-0, Exterior(2N) 19-0-0 to 22-0-0, Corner(3R) 22-0-0 to 27-0-0, Exterior(2N) 27-0-0 to 35-10-12 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Provide adequate drainage to prevent water ponding.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 24, 32, 33, 34, 35, 36, 37, 38, 39, 40, 30, 29, 28, 27, 26 except (jt=lb) 2=115, 41=131, 25=136.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 73
P220320-P220320-02	PB01	Piggyback	2	1	Job Reference (optional)

Run: 8.62 S Nov 16 2022 Print: 8.620 S Nov 16 2022 MiTek Industries, Inc. Thu Mar 16 10:12:09 Page: 1
ID:15XuO6EOkGwLxHbdXdwM2ozaOSO-MyJ5F4?P2Jf?IJ0StW0qItMDZOIKiQtBdlbnpOzaOOq

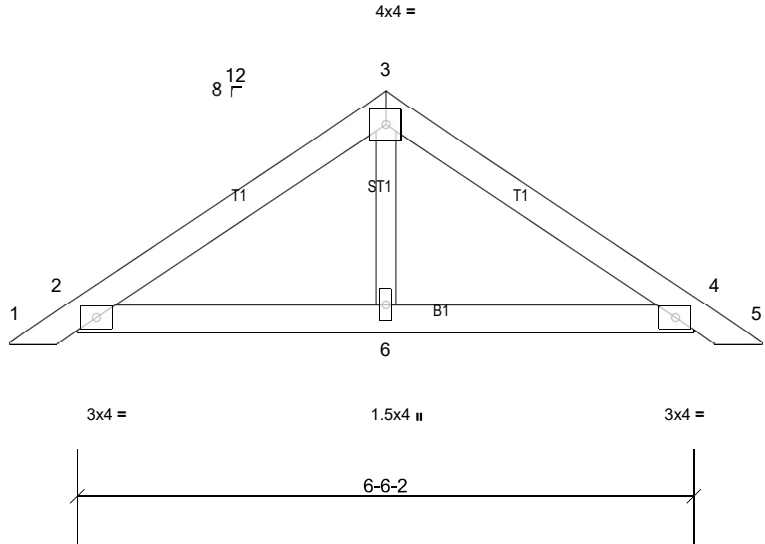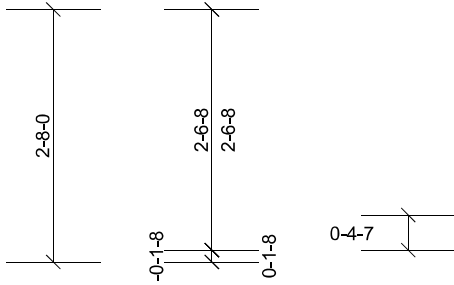

Scale = 1:24.3

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.22	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.11	Vert(CT)	n/a	-	n/a	999	197/144
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00	4	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 25 lb FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x3 SPF No.2

BRACING

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS (lb/size) 2=200/6-6-2, (min. 0-1-8), 4=200/6-6-2, (min. 0-1-8),
6=251/6-6-2, (min. 0-1-8)
Max Horiz 2=-69 (LC 10)
Max Uplift 2=-55 (LC 12), 4=-64 (LC 13)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 55 lb uplift at joint 2 and 64 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 73
P220320-P220320-02	PB02	Piggyback	28	1	Job Reference (optional)

Run: 8.62 S Nov 16 2022 Print: 8.620 S Nov 16 2022 MiTek Industries, Inc. Thu Mar 16 10:12:09 Page: 1
ID:wsmPEUHuoVRnQuuOmT_IDezaOSK-MyJ5F4?P2Jf?IJ0StW0qItMDZOIKiQtBdlbnpOzaOOq

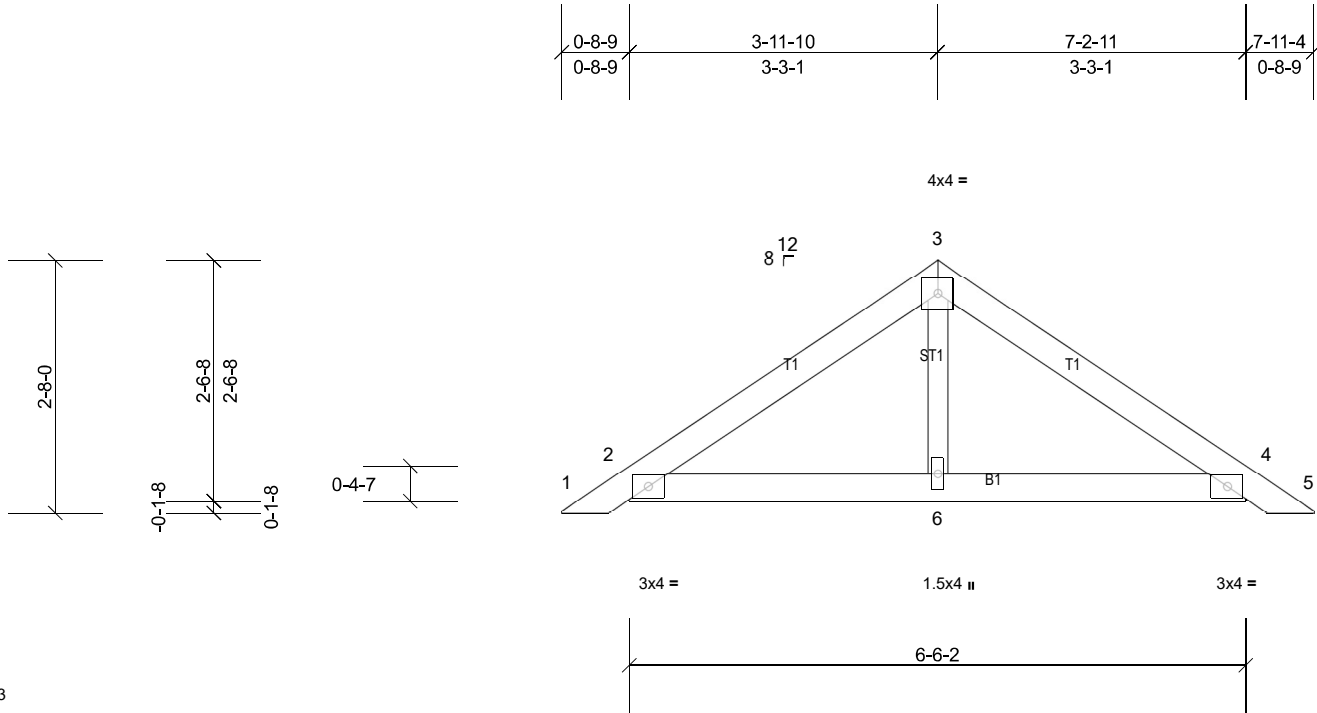

Scale = 1:24.3

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.22	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.11	Vert(CT)	n/a	-	n/a	999	197/144
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00	4	n/a	n/a	Weight: 25 lb
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x3 SPF No.2

BRACING

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS (lb/size) 2=200/6-6-2, (min. 0-1-8), 4=200/6-6-2, (min. 0-1-8),
6=251/6-6-2, (min. 0-1-8)
Max Horiz 2=-69 (LC 10)
Max Uplift 2=-55 (LC 12), 4=-64 (LC 13)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 55 lb uplift at joint 2 and 64 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

LOAD CASE(S) Standard