

NEW PHOTOVOLTAIC ROOF MOUNTED SYSTEM - 10.56 KW DC/10.400 KW AC
1607 SW BLACKSTONE PLACE, LEE'S SUMMIT, MO 64082


NEW PV SYSTEM SPECIFICATIONS
SYSTEM SIZE: DC SIZE: 10.560 KW DC-(STC)
AC SIZE: 10.400 KW AC
MODULE: (32) HANWHA Q CELLS Q.PEAK DUO BLK-G6+330
INVERTER: (32) ENPHASE IQ8M-72-2-US (240V)

APPLICABLE CODES
ALL WORK SHALL CONFORM TO THE FOLLOWING CODES:
2018 INTERNATIONAL BUILDING CODE
2018 INTERNATIONAL RESIDENTIAL CODE
2018 INTERNATIONAL EXISTING BUILDING CODE
2018 INTERNATIONAL FIRE CODE
2017 NATIONAL ELECTRICAL CODE
AS ADOPTED BY CITY OF LEES SUMMIT

DESIGN CRITERIA
ROOF SURFACE TYPE: COMPOSITE SHINGLE
ROOF FRAMING: 2"X6" RAFTER @ 16" OC
BUILDING STORY: ONE STORY
GROUND SNOW LOAD: 20 PSF
WIND SPEED: 109 MPH
WIND EXPOSURE: B
RISK CATEGORY: II

PROJECT NOTES
1.1.1 THIS PHOTOVOLTAIC (PV) SYSTEM SHALL COMPLY WITH THE RELEVANT YEAR OF THE NATIONAL ELECTRIC CODE (NEC), ALL MANUFACTURER'S LISTING AND INSTALLATION INSTRUCTIONS, AND THE RELEVANT CODES AS SPECIFIED BY THE AUTHORITY HAVING JURISDICTION'S (AHJ) APPLICABLE CODES.
1.1.2 THE UTILITY INTERCONNECTION APPLICATION MUST BE APPROVED AND THE PV SYSTEM MUST BE INSPECTED PRIOR TO OPERATION
1.1.3 ALL PV SYSTEM COMPONENTS; MODULES, UTILITY-INTERACTIVE INVERTERS, AND SOURCE CIRCUIT COMBINER BOXES ARE IDENTIFIED AND LISTED FOR USE IN PHOTOVOLTAIC SYSTEMS AS REQUIRED BY NEC AND OTHER GOVERNING CODES
1.1.4 ALL SIGNAGE TO BE PLACED IN ACCORDANCE WITH LOCAL BUILDING CODE. IF EXPOSED TO SUNLIGHT, IT SHALL BE UV RESISTANT. ALL PLAQUES AND SIGNAGE WILL BE INSTALLED AS REQUIRED BY THE NEC AND AHJ.

SCOPE OF WORK
1.2.1 CONTRACTOR IS RESPONSIBLE FOR THE DESIGN AND SPECIFICATIONS OF THE GRID-TIED PHOTOVOLTAIC SYSTEM. THE CONTRACTOR WILL BE RESPONSIBLE FOR COLLECTION OF EXISTING ONSITE CONDITIONS TO DESIGN, SPECIFY, AND INSTALL THE ROOF-MOUNTED PHOTOVOLTAIC SYSTEM DETAILED IN THIS DOCUMENT

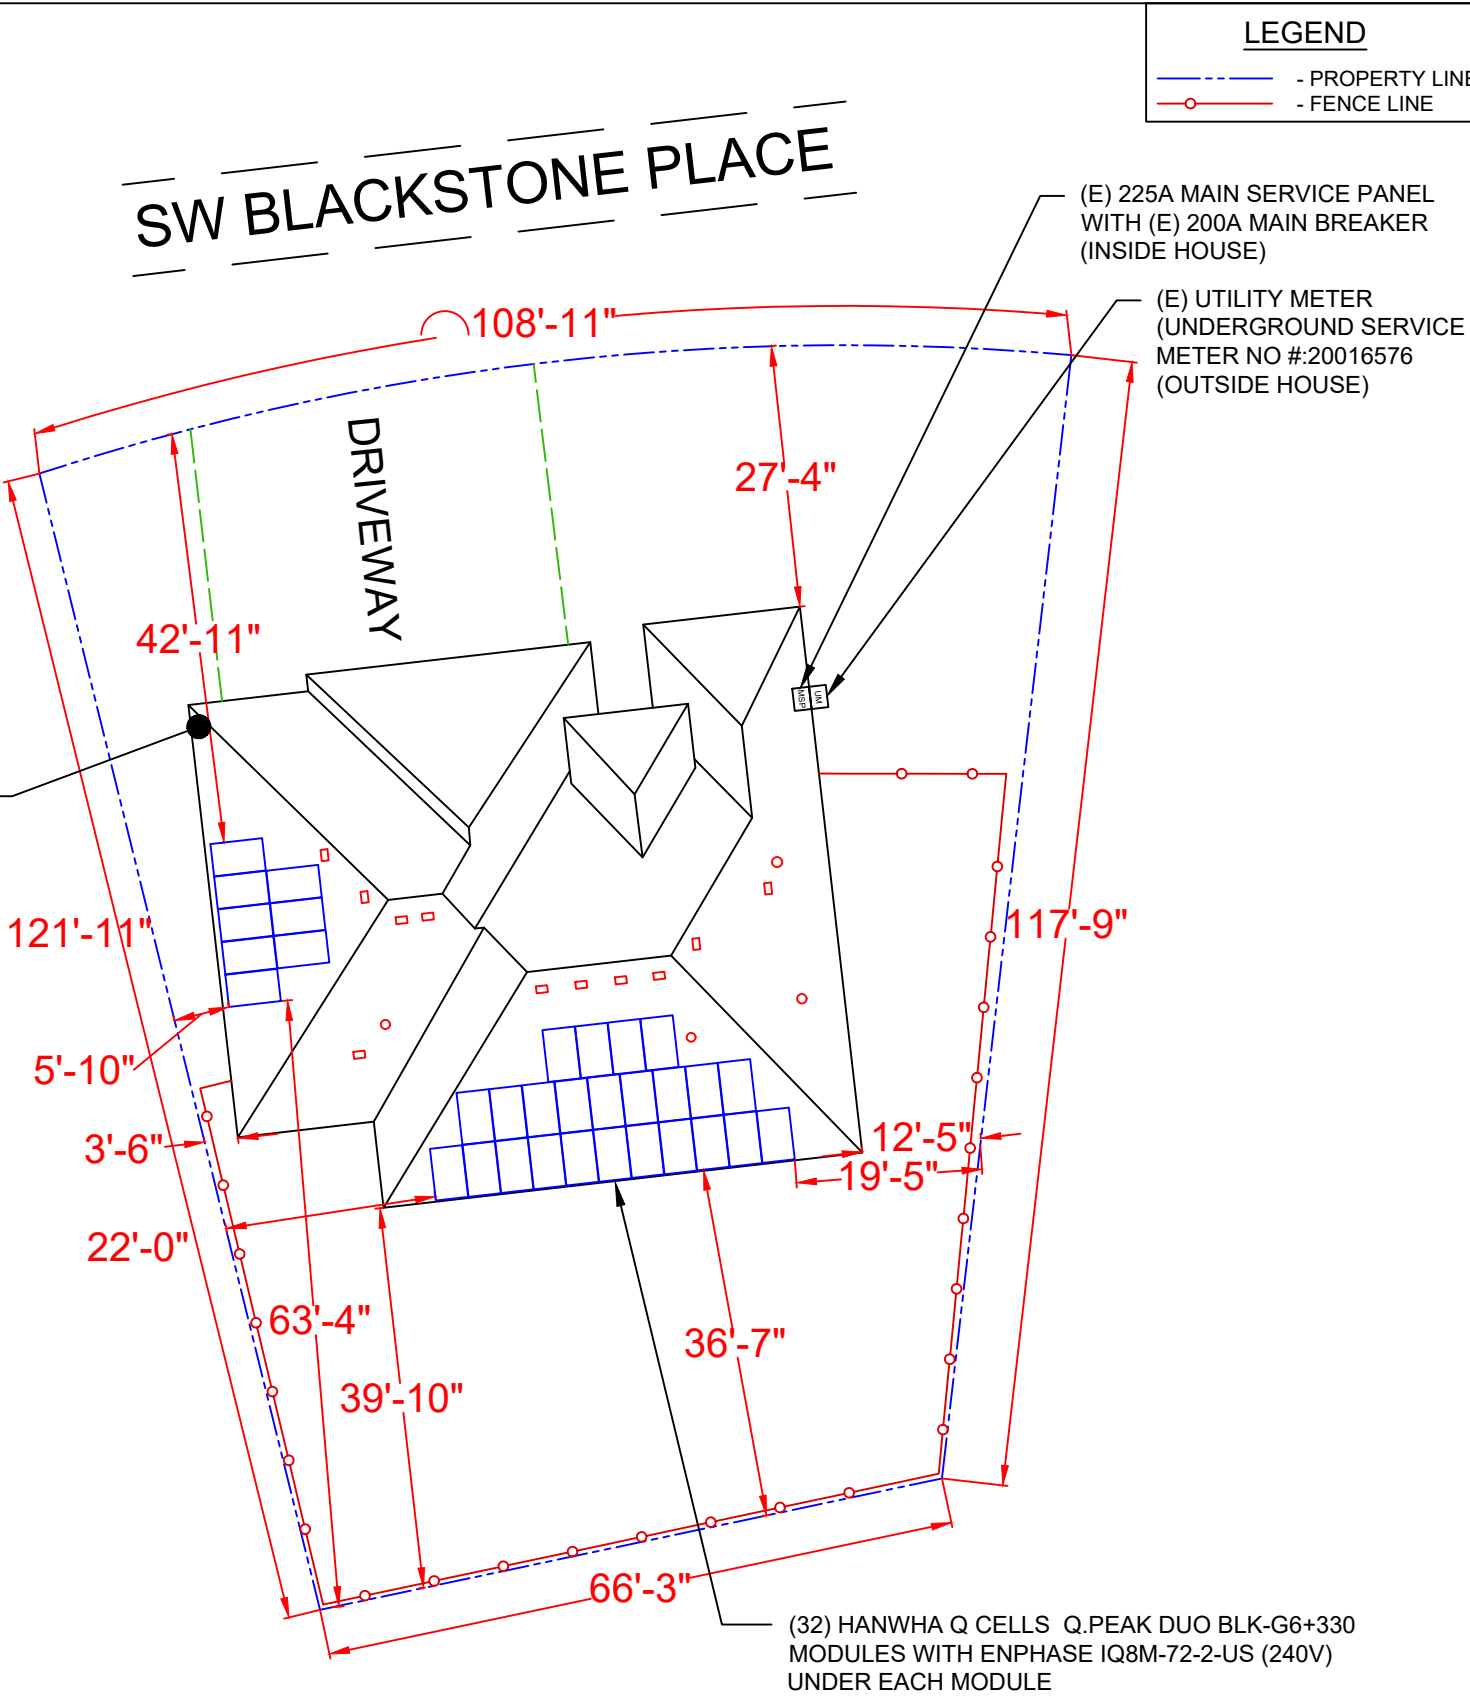

LEGEND


- PROPERTY LINE
- FENCE LINE

SHEET INDEX

PV-01	COVER PAGE
PV-02	SITE PLAN
PV-03	ATTACHMENT PLAN & DETAILS
PV-04	ELECTRICAL DIAGRAM
PV-05	NOTES
PV-06	WARNING LABELS
R-01 -> R-08	RESOURCE DOCUMENT

- NOTES:
1. ROOF ACCESS POINT SHALL NOT BE LOCATED IN AREAS THAT REQUIRE THE PLACEMENT OF GROUND LADDERS OVER OPENINGS SUCH AS WINDOWS OR DOORS, AND LOCATED AT STRONG POINTS OF BUILDING CONSTRUCTION IN LOCATIONS WHERE THE ACCESS POINT DOES NOT CONFLICT WITH OVERHEAD OBSTRUCTIONS SUCH AS TREE LIMBS, WIRES OR SIGNS.
 2. STRUCTURES, PATIO COVERS, AND/OR ADDITIONS BUILT WITHOUT PERMITS TO BE RESOLVED BY A SEPARATE PERMIT.

VICINITY MAP

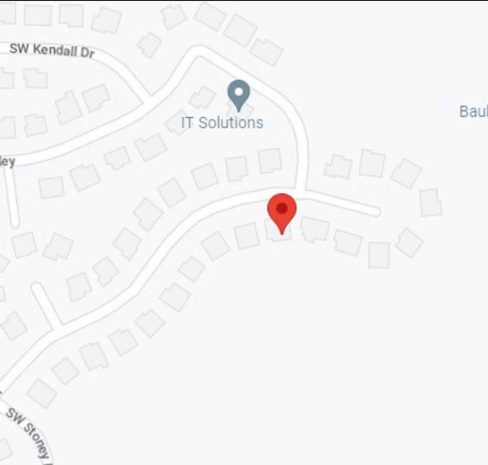

SATELLITE VIEW



CONTRACTOR



THE SOLAR GUYS

6114 MO-9, PARKVILLE,
MISSOURI 64152
PHONE - (816) 708-5556

PROJECT NAME & ADDRESS

MICHAEL & MAYUMI MCKNIGHT
1607 SW BLACKSTONE PLACE,
LEE'S SUMMIT, MO 64082
APN #: 69720101000000000
METER NO:20016576
AHJ: CITY OF LEES SUMMIT
UTILITY: EVERGY MO WEST

SYSTEM DETAILS

DC SIZE: 10.560 KW DC-(STC)
AC SIZE: 10.400 KW AC
(32) HANWHA Q CELLS Q.PEAK DUO BLK-G6+330
(32) ENPHASE IQ8M-72-2-US (240V)

REVISIONS

REV	DESCRIPTION	DATE


SHEET TITLE

COVER PAGE






DRAWN DATE	4/17/2023
DRAWN BY	SS

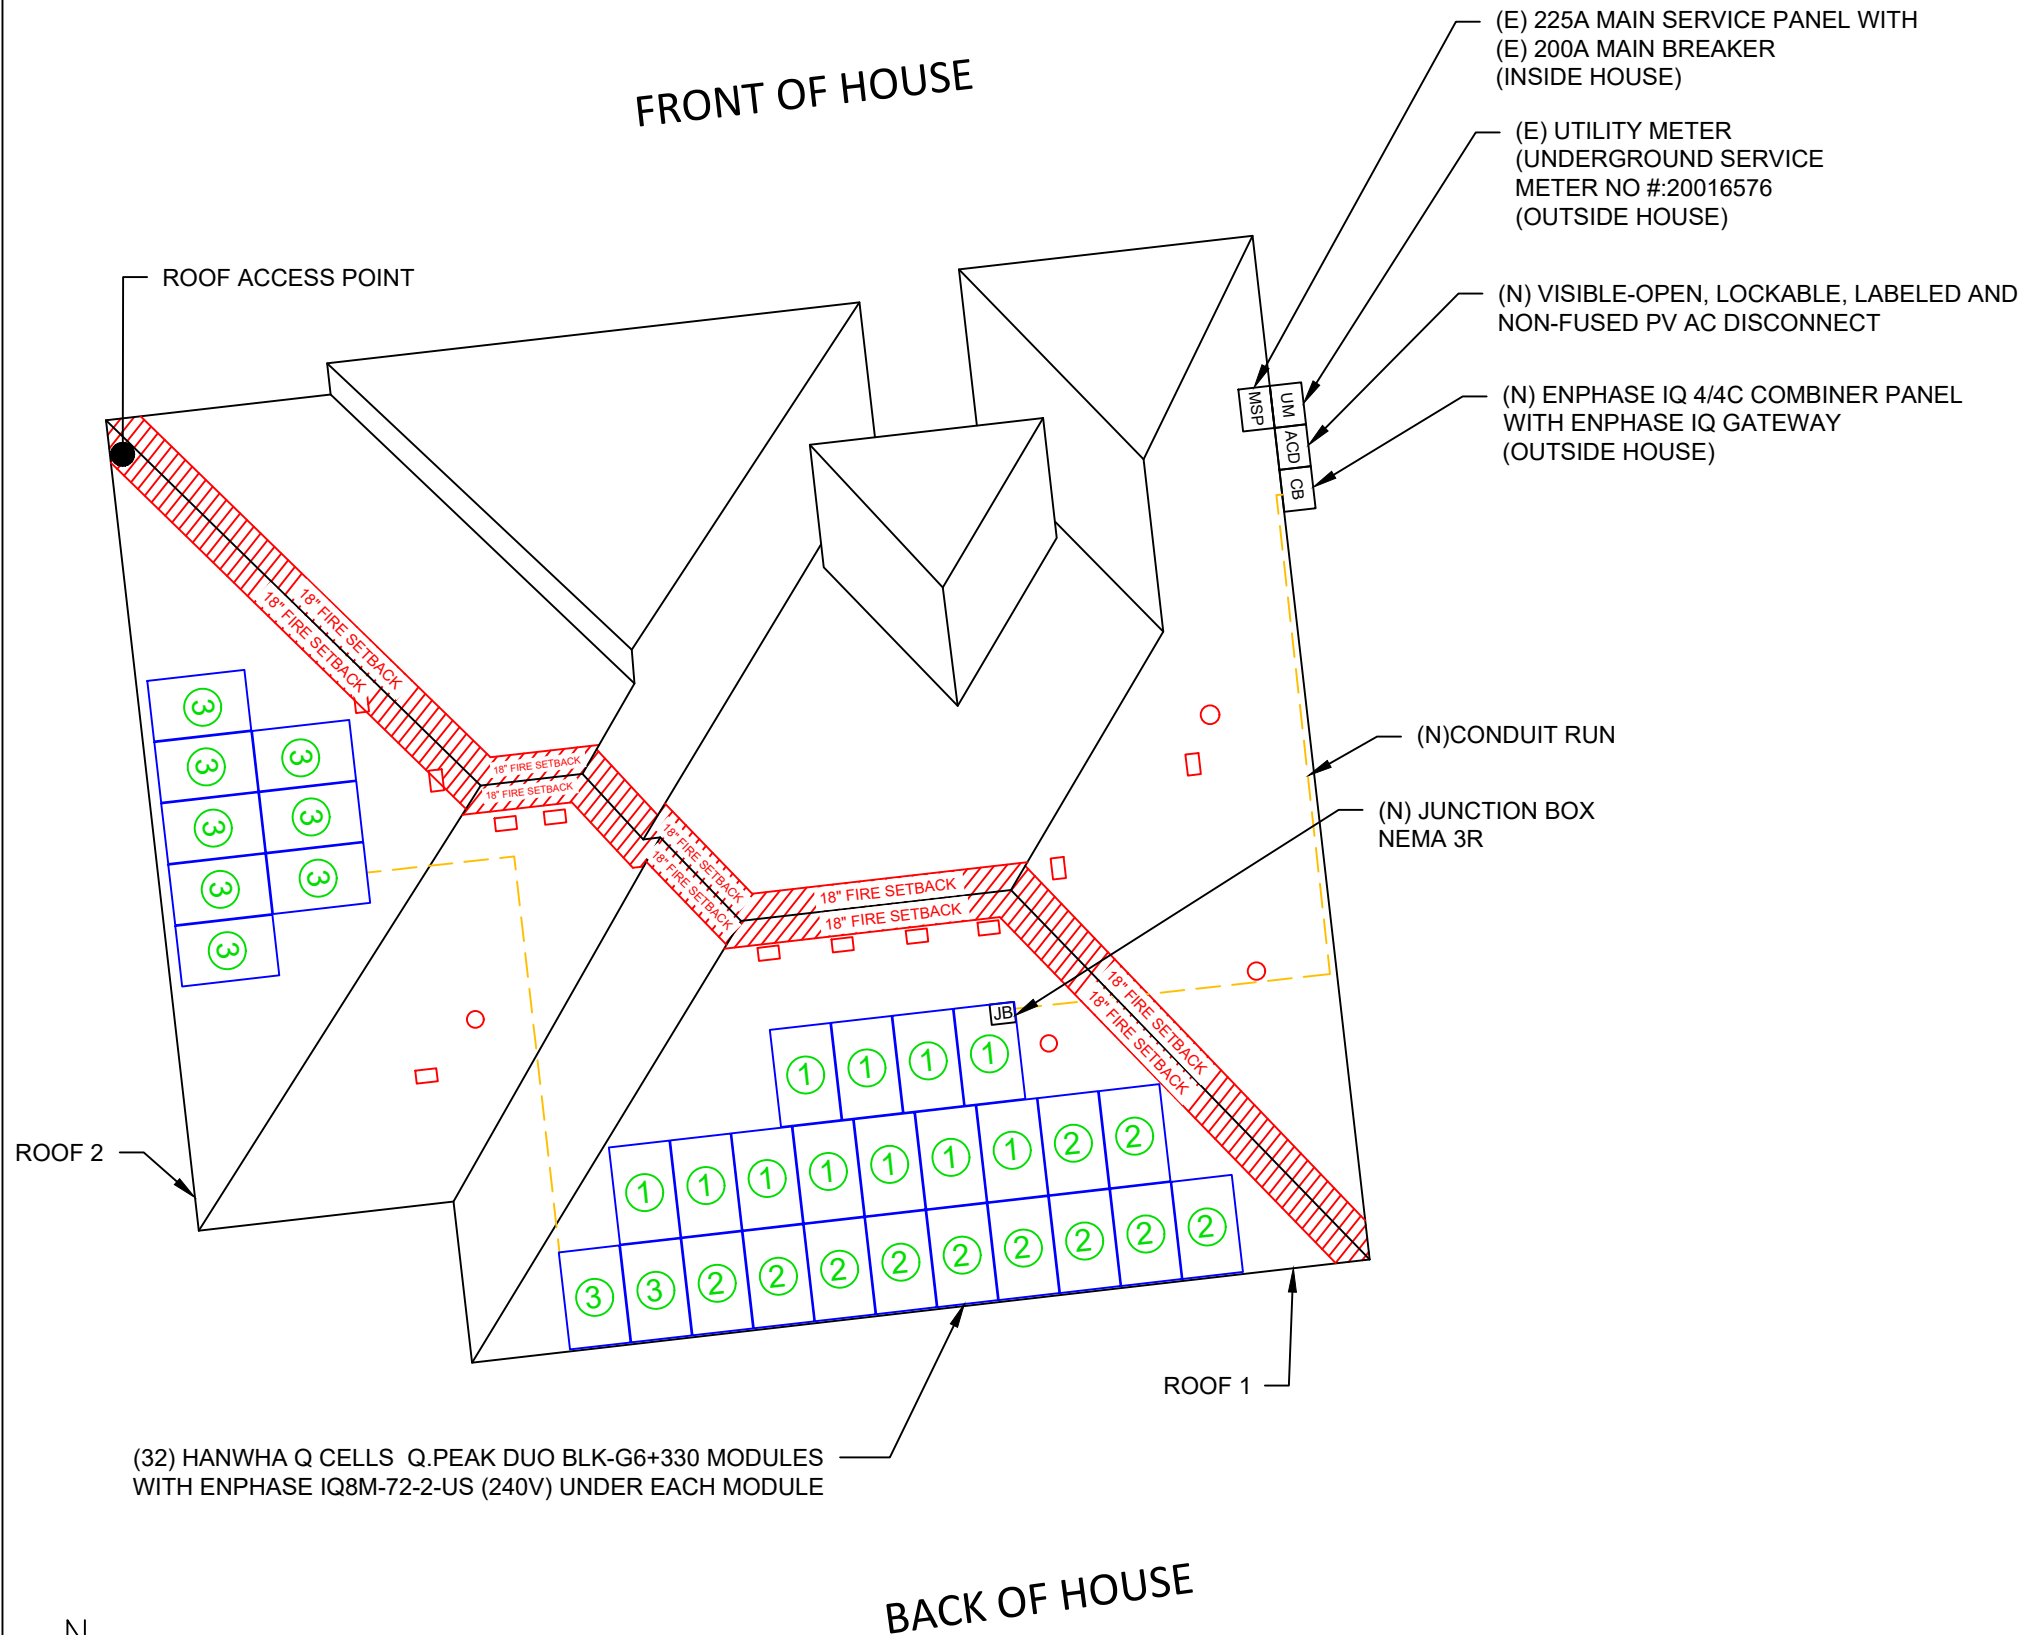SHEET NUMBER

PV-01



LEGEND

- CONDUIT RUN
-  - JUNCTION BOX
-  - SKYLIGHT (ROOF OBSTRUCTION)
-  - CHIMNEY (ROOF OBSTRUCTION)
-  - VENT, ATTIC FAN (ROOF OBSTRUCTION)
-  - (32) HANWHA Q CELLS Q.PEAK DUO BLK-G6+330 MODULES WITH ENPHASE IQ8M-72-2-US (240V) MICROINVERTERS UNDER EACH MODULE




PLAN VIEW TOTAL ROOF AREA: 3454.05 FT²
TOTAL PV ARRAY AREA: 618.02 FT²
TOTAL % OF ROOF COVERED BY PV: 17.89%

NOTE:
TO AVOID ADDITIONAL TEMPERATURE DERATE CORRECTIONS, CONDUIT MUST BE A MINIMUM OF 7/8" ABOVE THE ROOF SURFACE (EXTERIOR) OR 18" BELOW ROOF THROUGH ATTIC (INTERIOR).

ROOF SECTION(S)

ROOF 1	SLOPE	- 18°
	AZIMUTH	- 173°
	MODULE QTY	- 24
	RAFTER	- 2"X6" @ 16" O.C.
	SURFACE TYPE	- COMPOSITE SHINGLE
ROOF 2	SLOPE	- 18°
	AZIMUTH	- 263°
	MODULE QTY	- 08
	RAFTER	- 2"X6" @ 16" O.C.
	SURFACE TYPE	- COMPOSITE SHINGLE

PV CIRCUITS

-  - MODULE STRING
-  - MODULE STRING
-  - MODULE STRING

CONTRACTOR

Installation • Service • Repair

THE SOLAR GUYS

Commercial • Residential

Energy Storage

THE SOLAR GUYS

6114 MO-9, PARKVILLE,
MISSOURI 64152

PHONE - (816) 708-5556

PROJECT NAME & ADDRESS

MICHAEL & MAYUMI MCKNIGHT

1607 SW BLACKSTONE PLACE,
LEE'S SUMMIT, MO 64082

APN #: 69720101000000000

METER NO: 20016576

AHJ: CITY OF LEES SUMMIT

UTILITY: EVERGY MO WEST

SYSTEM DETAILS

DC SIZE: 10.560 KW DC-(STC)

AC SIZE: 10.400 KW AC

(32) HANWHA Q CELLS Q.PEAK DUO BLK-G6+330

(32) ENPHASE IQ8M-72-2-US (240V)

REVISIONS		
REV	DESCRIPTION	DATE

SHEET TITLE

SITE PLAN


DRAWN DATE	4/17/2023
DRAWN BY	SS

SHEET NUMBER


PV-02

POINT LOAD CALCULATIONS	
MODULE TYPE	HANWHA Q CELLS Q.PEAK DUO BLK-G6+330
MODULE WEIGHT	43.9 LBS
TOTAL QTY. OF MODULES	32
TOTAL WEIGHT OF MODULES	1404.80 LBS
TYPE OF RACKING	IRONRIDGE XR-10 RAIL
TYPE OF ATTACHMENT	SUNMODO NANOMOUNT (DECKING)
DISTRIBUTED WEIGHT OF RACKING	0.5 PSF
TOTAL WEIGHT OF ARRAY	1713.81 LBS
TOTAL QTY. OF ATTACHMENTS	67
POINT LOAD AT EACH ATTACHMENT	20.98 LBS
AREA OF MODULE	19.31 SQFT.
TOTAL ARRAY AREA	618.02 SQFT.
DISTRIBUTED LOAD	2.30 PSF

2X6 RAFTER SPACED AT 16"OC WITH A MAX SPAN OF 7 FT WITH 2X6 KNEE WALL & COLLAR TIE SPACED AT 16"OC SUPPORTED BY AN EXISTING LOAD BEARING WALL 1'-4"

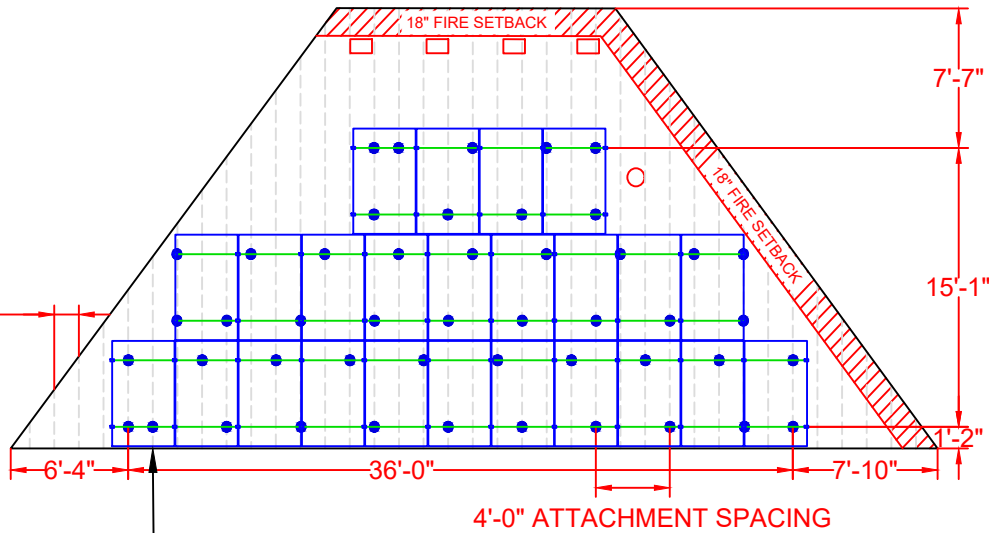


2X6 RAFTER SPACED AT 16"OC WITH A MAX SPAN OF 7 FT WITH 2X6 KNEE WALL SPACED AT 64"OC & COLLAR TIE SPACED AT 16"OC SUPPORTED BY AN EXISTING LOAD BEARING WALL

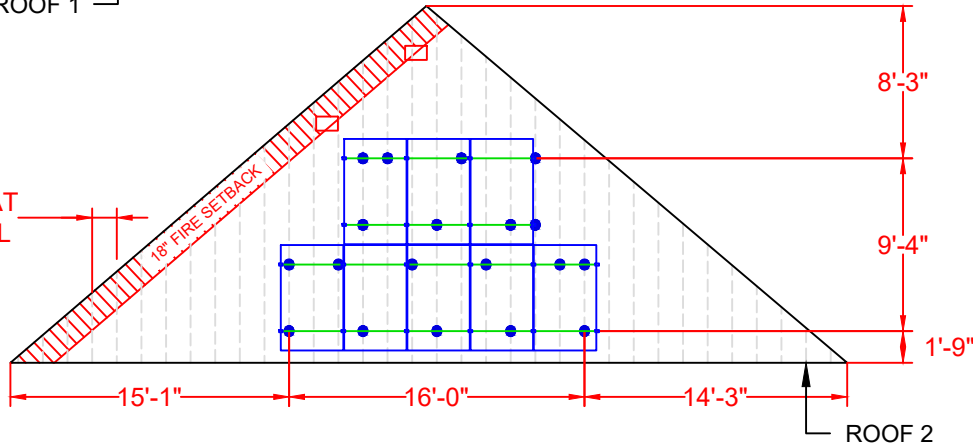


1 ATTACHMENT PLAN
PV-03 SCALE: NTS

NOTE: CONTRACTOR/INSTALLER TO VERIFY COMPATIBILITY OF ANY BRANDS OR PRODUCTS SUBSTITUTED OR USED AS ALTERNATES WITHIN ANY BRAND-SPECIFIC SYSTEMS. CONTRACTOR SHALL SUPPLY AND PRESENT CERTIFICATES OF COMPATIBILITY TO THE BUILDING OFFICIAL UPON INSPECTION AS NEEDED.

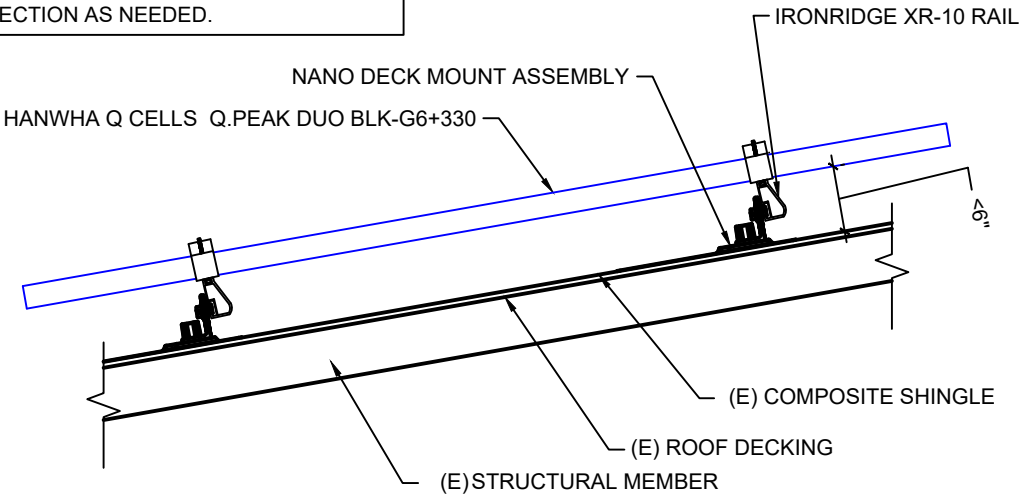

2 ATTACHMENT DETAIL
PV-03 Scale: NTS

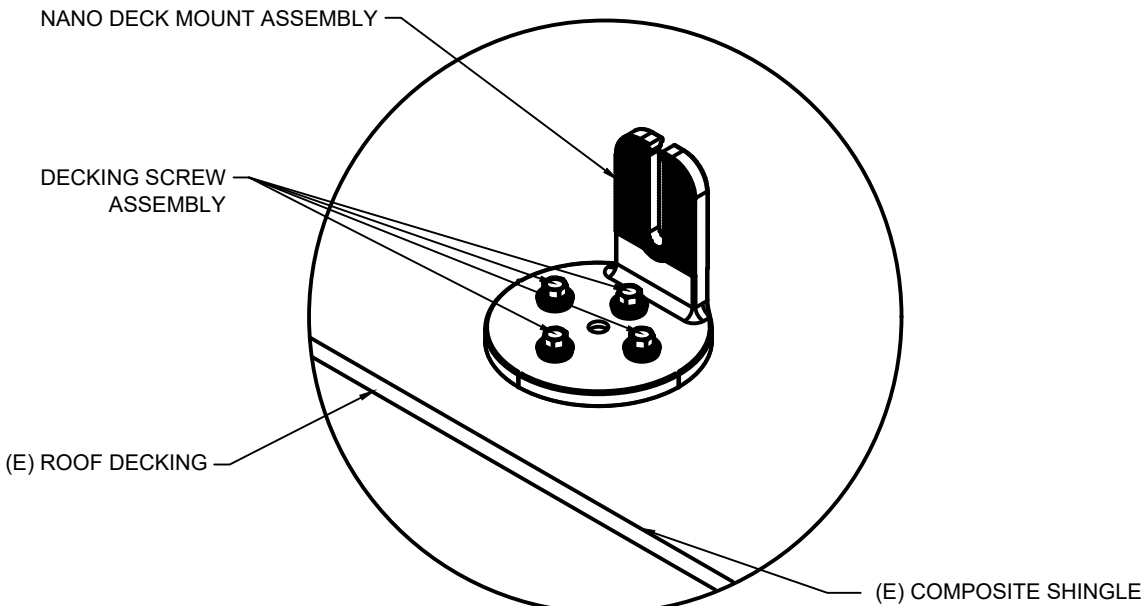

3 ENLARGED VIEW
PV-03 Scale: NTS

LEGEND

- ATTACHMENT POINTS

- RAIL

- CLAMP

TOTAL ATTACHMENT POINTS - 67

ROOF SECTION(S)		
ROOF 1	SLOPE	- 18°
	AZIMUTH	- 173°
	MODULE QTY	- 24
	RAFTER	- 2"x6" @ 16" O.C.
ROOF 2	SURFACE TYPE	- COMPOSITE SHINGLE
	SLOPE	- 18°
	AZIMUTH	- 263°
	MODULE QTY	- 08
	RAFTER	- 2"x6" @ 16" O.C.
	SURFACE TYPE	- COMPOSITE SHINGLE

CONTRACTOR

Installation • Service • Repair

THE

SOLAR

Guys

Commercial • Residential

Energy Storage

THE SOLAR GUYS

6114 MO-9, PARKVILLE,
MISSOURI 64152

PHONE - (816) 708-5556

PROJECT NAME & ADDRESS

MICHAEL & MAYUMI MCKNIGHT

1607 SW BLACKSTONE PLACE,
LEE'S SUMMIT, MO 64082

APN #: 69720101000000000

METER NO:20016576

AHJ: CITY OF LEES SUMMIT

UTILITY: EVERGY MO WEST

SYSTEM DETAILS

DC SIZE: 10.560 KW DC-(STC)

AC SIZE: 10.400 KW AC

(32) HANWHA Q CELLS Q.PEAK DUO BLK-G6+330

(32) ENPHASE IQ8M-72-2-US (240V)

REVISIONS		
REV	DESCRIPTION	DATE

SHEET TITLE

ATTACHMENT PLAN
& DETAILS

DRAWN DATE4/17/2023

DRAWN BYSS

SHEET NUMBER

PV-03

SOLAR MODULE SPECIFICATIONS		MICROINVERTER SPECIFICATIONS		AMBIENT TEMPERATURE SPECIFICATIONS	
MANUFACTURER / MODEL #	HANWHA Q CELLS Q.PEAK DUO BLK-G6+330	MANUFACTURER / MODEL #	ENPHASE IQ8M-72-2-US (240V)	RECORD LOW TEMP	-20°C
VMP	33.29V	INPUT POWER RANGE	260W-460W	AMBIENT TEMP (HIGH TEMP 2% AVG.)	35°C
IMP	9.91A	MIN/MAX START VOLTAGE	22V/58V	CONDUIT HEIGHT	7/8"
VOC	40.15V	NOMINAL AC VOLTAGE	240V	CONDUCTOR TEMPERATURE RATE	90°C
ISC	10.41A	MAX CONT. OUTPUT CURRENT	1.35A		
TEMP. COEFF. VOC	-0.27%/K	MAX CONT. OUTPUT POWER	325W		
MODULE DIMENSION	68.5" x 40.6" x1.26"	MAX MODULES PER STRING	11 (11 MICROINVERTERS)		

CONTRACTOR

Installation • Service • Repair


THE SOLAR GUYS

Energy Storage

THE SOLAR GUYS

6114 MO-9, PARKVILLE,
MISSOURI 64152

PHONE - (816) 708-5556

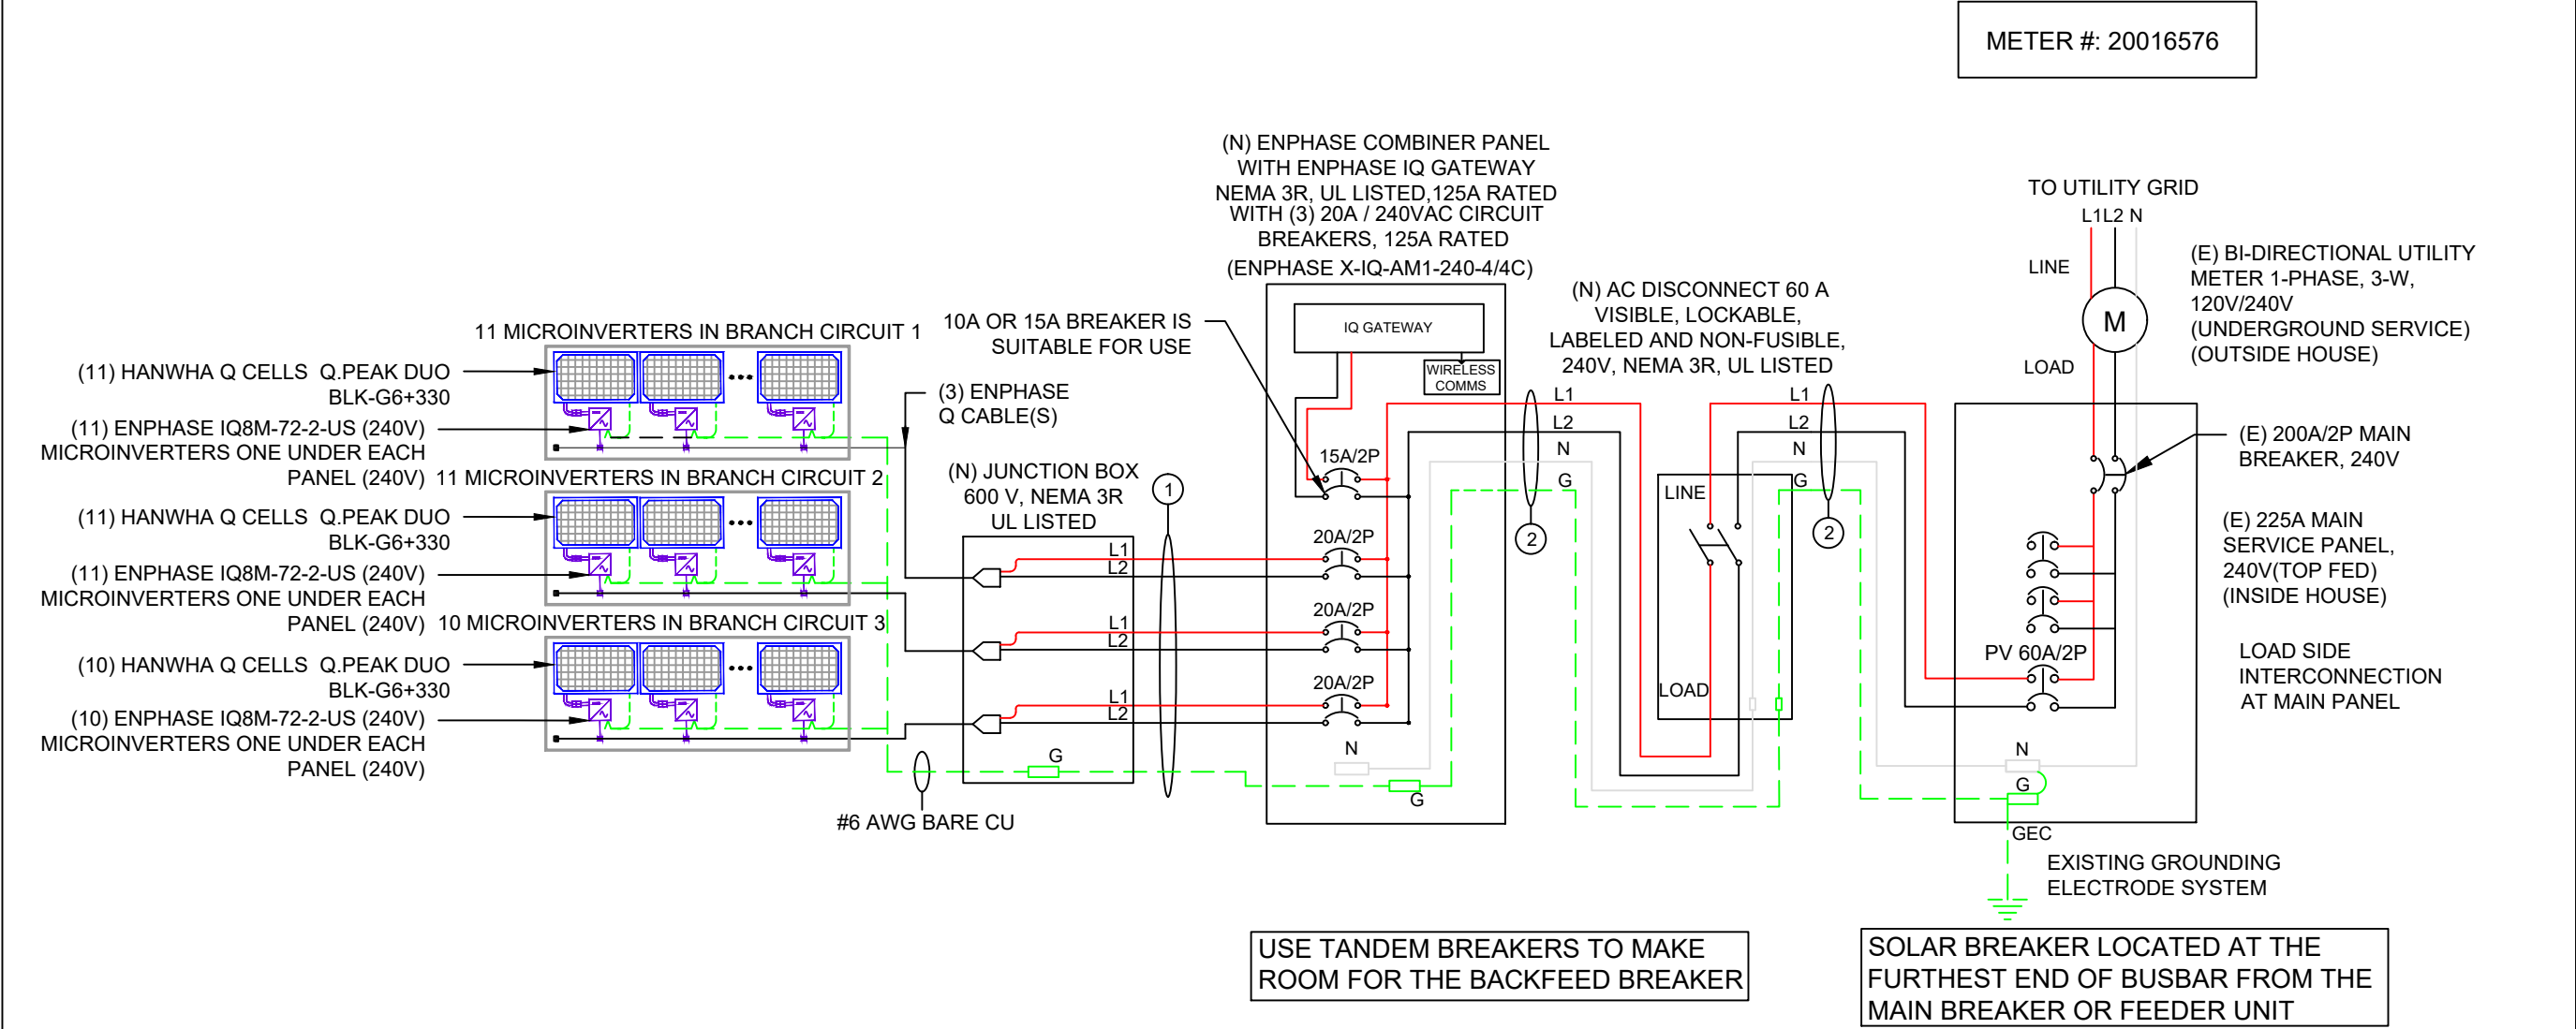

PROJECT NAME & ADDRESS

MICHAEL & MAYUMI MCKNIGHT

1607 SW BLACKSTONE PLACE,
LEE'S SUMMIT, MO 64082

APN #: 69720101000000000

METER NO:20016576

AHJ: CITY OF LEES SUMMIT

UTILITY: EVERGY MO WEST

SYSTEM DETAILS

DC SIZE: 10.560 KW DC-(STC)

AC SIZE: 10.400 KW AC

(32) HANWHA Q CELLS Q.PEAK DUO BLK-G6+330

(32) ENPHASE IQ8M-72-2-US (240V)

REVISIONS		
REV	DESCRIPTION	DATE

SHEET TITLE

ELECTRICAL

DIAGRAM

DRAWN DATE	4/17/2023
DRAWN BY	SS

SHEET NUMBER

PV-04

DESCRIPTION					FORMULA					RESULT		
PV OVERCURRENT PROTECTION NEC 690.9(B)					TOTAL INVERTER OUTPUT CURRENT x 1.25 = (32 x 1.35)A x 1.25					54.00A (SELECTED PV BREAKER = 60A)		
120% RULE FOR BACKFEED BREAKER NEC 705.12					BUS BAR RATING x 1.2 - MCB RATING = MAX ALLOWABLE PV BREAKER 225A x 1.2 - 200A = 70A					SELECTED PV BREAKER <= MAX ALLOWABLE PV BREAKER 60A <= 70A		
WIRE ID	EXPECTED WIRE TEMP (°C)	TEMP DERATE (90 °C)	QTY OF CURRENT CARRYING CONDUCTORS	CONDUIT FILL DERATE	MINIMUM CONDUIT SIZE (TBD ON SITE)	WIRE GAUGE & TYPE	CONDUCTOR AMPACITY @ 90°C (A)	CONDUCTOR AMPACITY @ 75°C (A)	REQUIRED CIRCUIT CONDUCTOR AMPACITY (A)	ADJUSTED CONDUCTOR AMPACITY @ 90 °C (A)	NEUTRAL CONDUCTOR SIZE & TYPE	GROUND WIRE SIZE & TYPE
1	35	0.96	6	0.8	3/4" METAL	#10 THWN-2	40	35	18.56	30.72	NONE	#10 THWN-2
2	35	0.96	2	1	3/4" METAL	#6 THWN-2	75	65	54	72	#6 THWN-2	#10 THWN-2

GENERAL NOTES

SITE NOTES

- 2.1.1 A LADDER WILL BE IN PLACE FOR INSPECTION IN ACCORDANCE WITH OSHA REGULATIONS.
- 2.1.2 THE PV MODULES ARE CONSIDERED NON-COMBUSTIBLE AND THIS SYSTEM IS A UTILITY INTERACTIVE SYSTEM WITH NO STORAGE BATTERIES.
- 2.1.3 THE SOLAR PV INSTALLATION WILL NOT OBSTRUCT ANY PLUMBING, MECHANICAL, OR BUILDING ROOF VENTS.
- 2.1.4 PROPER ACCESS AND WORKING CLEARANCE AROUND EXISTING AND PROPOSED ELECTRICAL EQUIPMENT WILL BE PROVIDED IN ACCORDANCE WITH SECTION NEC 110.26.
- 2.1.5 ROOF COVERINGS SHALL BE DESIGNED, INSTALLED, AND MAINTAINED IN ACCORDANCE WITH THIS CODE AND THE APPROVED MANUFACTURER'S INSTRUCTIONS SUCH THAT THE ROOF COVERING SERVES TO PROTECT THE BUILDING OR STRUCTURE.

EQUIPMENT LOCATIONS

- 2.2.1 ALL EQUIPMENT SHALL MEET MINIMUM SETBACKS IN ACCORDANCE WITH NEC 110.26.
- 2.2.2 WIRING SYSTEMS INSTALLED IN DIRECT SUNLIGHT MUST BE RATED FOR EXPECTED OPERATING TEMPERATURE AS SPECIFIED BY NEC 690.31 (A),(C) AND NEC TABLES 310.15 (B)(2)(A) AND 310.15 (B)(3)(C).
- 2.2.3 JUNCTION AND PULL BOXES PERMITTED INSTALLED UNDER PV MODULES IN ACCORDANCE WITH NEC 690.34.
- 2.2.4 ADDITIONAL AC DISCONNECT(S) SHALL BE PROVIDED WHERE THE INVERTER IS NOT WITHIN SIGHT OF THE AC SERVICING DISCONNECT.
- 2.2.5 ALL EQUIPMENT SHALL BE INSTALLED ACCESSIBLE TO QUALIFIED PERSONNEL IN ACCORDANCE WITH NEC APPLICABLE CODES.
- 2.2.6 ALL COMPONENTS ARE LISTED FOR THEIR PURPOSE AND RATED FOR OUTDOOR USAGE WHEN APPROPRIATE.

STRUCTURAL NOTES

- 2.3.1 RACKING SYSTEM & PV ARRAY WILL BE INSTALLED IN ACCORDANCE WITH THE CODE-COMPLIANT INSTALLATION MANUAL. TOP CLAMPS REQUIRE A DESIGNATED SPACE BETWEEN MODULES, AND RAILS MUST ALSO EXTEND A MINIMUM DISTANCE BEYOND EITHER EDGE OF THE ARRAY/SUBARRAY, IN ACCORDANCE WITH RAIL MANUFACTURER'S INSTALLATION PRACTICES.
- 2.3.2 JUNCTION BOX WILL BE INSTALLED PER MANUFACTURER'S SPECIFICATIONS. IF ROOF-PENETRATING TYPE, IT SHALL BE FLASHED & SEALED PER LOCAL REQUIREMENTS.
- 2.3.3 ROOFTOP PENETRATIONS FOR PV RACEWAY WILL BE COMPLETED AND SEALED W/ APPROVED CHEMICAL SEALANT PER CODE BY A LICENSED CONTRACTOR.
- 2.3.4 ALL PV RELATED ROOF ATTACHMENTS TO BE SPACED NO GREATER THAN THE SPAN DISTANCE SPECIFIED BY THE RACKING MANUFACTURER OR PROFESSIONAL ENGINEERING GUIDANCE.
- 2.3.5 WHEN POSSIBLE, ALL PV RELATED RACKING ATTACHMENTS WILL BE STAGGERED AMONGST THE ROOF FRAMING MEMBERS.

WIRING & CONDUIT NOTES

- 2.4.1 ALL CONDUIT AND WIRE WILL BE LISTED AND APPROVED FOR THEIR PURPOSE. CONDUIT AND WIRE SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UP-SIZING.
- 2.4.2 CONDUCTORS SIZED IN ACCORDANCE WITH THE NEC
- 2.4.3 AC CONDUCTORS TO BE COLORED OR MARKED PER NEC
- 2.4.4 LISTED OR LABELED EQUIPMENT SHALL BE INSTALLED AND USED IN ACCORDANCE WITH ANY INSTRUCTIONS INCLUDED IN THE LISTING OR LABELING PER NEC

GROUNDING NOTES

- 2.5.1 GROUNDING SYSTEM COMPONENTS SHALL BE LISTED FOR THEIR PURPOSE, AND GROUNDING DEVICES EXPOSED TO THE ELEMENTS SHALL BE RATED FOR SUCH USE.
- 2.5.2 PV EQUIPMENT SHALL BE GROUNDED IN ACCORDANCE WITH NEC 690.43 AND NEC TABLE 250.122.
- 2.5.3 METAL PARTS OF MODULE FRAMES, MODULE RACKING, AND ENCLOSURES CONSIDERED GROUNDED IN ACCORDANCE WITH NEC 250.134 AND 250.136(A).
- 2.5.4 EQUIPMENT GROUNDING CONDUCTORS SHALL BE SIZED IN ACCORDANCE WITH NEC 690.45 AND INVERTER MANUFACTURER'S INSTALLATION PRACTICES
- 2.5.5 EACH MODULE WILL BE GROUNDED AS SHOWN IN MANUFACTURER DOCUMENTATION AND APPROVED BY THE AHJ.
- 2.5.6 THE GROUNDING CONNECTION TO A MODULE SHALL BE ARRANGED SUCH THAT THE REMOVAL OF A MODULE DOES NOT INTERRUPT A GROUNDING CONDUCTOR TO ANOTHER MODULE.
- 2.5.7 GROUNDING AND BONDING CONDUCTORS, IF INSULATED, SHALL BE COLORED GREEN OR MARKED GREEN IF #4 AWG OR LARGER PER NEC 250.119
- 2.5.8 THE GROUNDING ELECTRODE SYSTEM COMPLIES WITH NEC 690.47 AND NEC 250.50 THROUGH 250.106. IF EXISTING SYSTEM IS INACCESSIBLE, OR INADEQUATE, A GROUNDING ELECTRODE SYSTEM PROVIDED IN ACCORDANCE WITH NEC 250, NEC 690.47 AND THE AHJ.
- 2.5.9 GROUND-FAULT DETECTION SHALL COMPLY WITH NEC 690.41(B)(1) AND (2) TO REDUCE FIRE HAZARDS

DISCONNECTION AND OVERCURRENT PROTECTION NOTES

- 2.6.1 DISCONNECTING SWITCHES SHALL BE WIRED SUCH THAT WHEN THE SWITCH IS OPENED THE CONDUCTORS REMAINING ENERGIZED ARE CONNECTED TO THE TERMINALS MARKED "LINE SIDE" (TYPICALLY THE UPPER TERMINALS).
- 2.6.2 DISCONNECTS TO BE ACCESSIBLE TO QUALIFIED UTILITY PERSONNEL, BE LOCKABLE, AND BE A VISIBLE-BREAK SWITCH
- 2.6.3 PV SYSTEM CIRCUITS INSTALLED ON OR IN HABITABLE BUILDINGS SHALL INCLUDE A RAPID SHUTDOWN FUNCTION TO REDUCE SHOCK HAZARD FOR EMERGENCY RESPONDERS IN ACCORDANCE WITH 690.12
- 2.6.4 ALL OCPD RATINGS AND TYPES SPECIFIED ACCORDING TO NEC 690.8, 690.9, AND 240.
- 2.6.5 INVERTER ON-GRID BRANCHES SHALL BE CONNECTED TO A SINGLE BREAKER OR GROUPED FUSE DISCONNECT(S) IN ACCORDANCE WITH NEC 110.3(B).
- 2.6.6 IF REQUIRED BY THE AHJ, SYSTEM WILL INCLUDE ARC-FAULT CIRCUIT PROTECTION IN ACCORDANCE WITH NEC 690.11 AND UL1699B.

INTERCONNECTION NOTES

- 2.7.1 LOAD SIDE INTERCONNECTION SHALL BE IN ACCORDANCE WITH NEC 705.12.
- 2.7.2 THE SUM OF THE UTILITY OCPD AND INVERTER CONTINUOUS OUTPUT MAY NOT EXCEED 120 PERCENT OF BUSBAR RATING PER NEC 705.12.
- 2.7.3 THE SUM OF 125 PERCENT OF THE POWER SOURCE(S) OUTPUT CIRCUIT CURRENT AND THE RATING OF THE OVERCURRENT DEVICE PROTECTING THE BUSBAR SHALL NOT EXCEED 120 PERCENT OF THE AMPACITY OF THE BUSBAR, PV DEDICATED BACKFEED BREAKERS MUST BE LOCATED OPPOSITE END OF THE BUS FROM THE UTILITY SOURCE OCPD IN ACCORDANCE WITH NEC 705.12.
- 2.7.4 AT MULTIPLE ELECTRIC POWER SOURCES OUTPUT COMBINER PANEL, TOTAL RATING OF ALL OVERCURRENT PROTECTION DEVICES SHALL NOT EXCEED AMPACITY OF BUSBAR. HOWEVER, THE MAIN OVERCURRENT PROTECTION DEVICE MAY BE EXCLUDED IN ACCORDANCE WITH NEC 705.12.
- 2.7.5 FEEDER TAP INTERCONNECTION (LOAD SIDE) IN ACCORDANCE WITH NEC 705.12.
- 2.7.6 SUPPLY SIDE TAP INTERCONNECTION IN ACCORDANCE WITH TO NEC 705.12 WITH SERVICE ENTRANCE CONDUCTORS IN ACCORDANCE WITH NEC 230.42.
- 2.7.7 BACKFEEDING BREAKER FOR ELECTRIC POWER SOURCES OUTPUT IS EXEMPT FROM ADDITIONAL FASTENING PER NEC 705.12.

CONTRACTOR

Installation • Service • Repair

THE

SOLAR

Guys

Commercial • Residential

Energy Storage

THE SOLAR GUYS

6114 MO-9, PARKVILLE,
MISSOURI 64152

PHONE - (816) 708-5556

PROJECT NAME & ADDRESS

MICHAEL & MAYUMI MCKNIGHT

1607 SW BLACKSTONE PLACE,
LEE'S SUMMIT, MO 64082

APN #: 69720101000000000

METER NO:20016576

AHJ: CITY OF LEES SUMMIT

UTILITY: EVERGY MO WEST

SYSTEM DETAILS

DC SIZE: 10.560 KW DC-(STC)
AC SIZE: 10.400 KW AC
(32) HANWHA Q CELLS Q-PEAK DUO BLK-G6+330
(32) ENPHASE IQ8M-72-2-US (240V)

REVISIONS		
REV	DESCRIPTION	DATE

SHEET TITLE


NOTES

DRAWN DATE	4/17/2023
DRAWN BY	SS

SHEET NUMBER

PV-05

System Labels

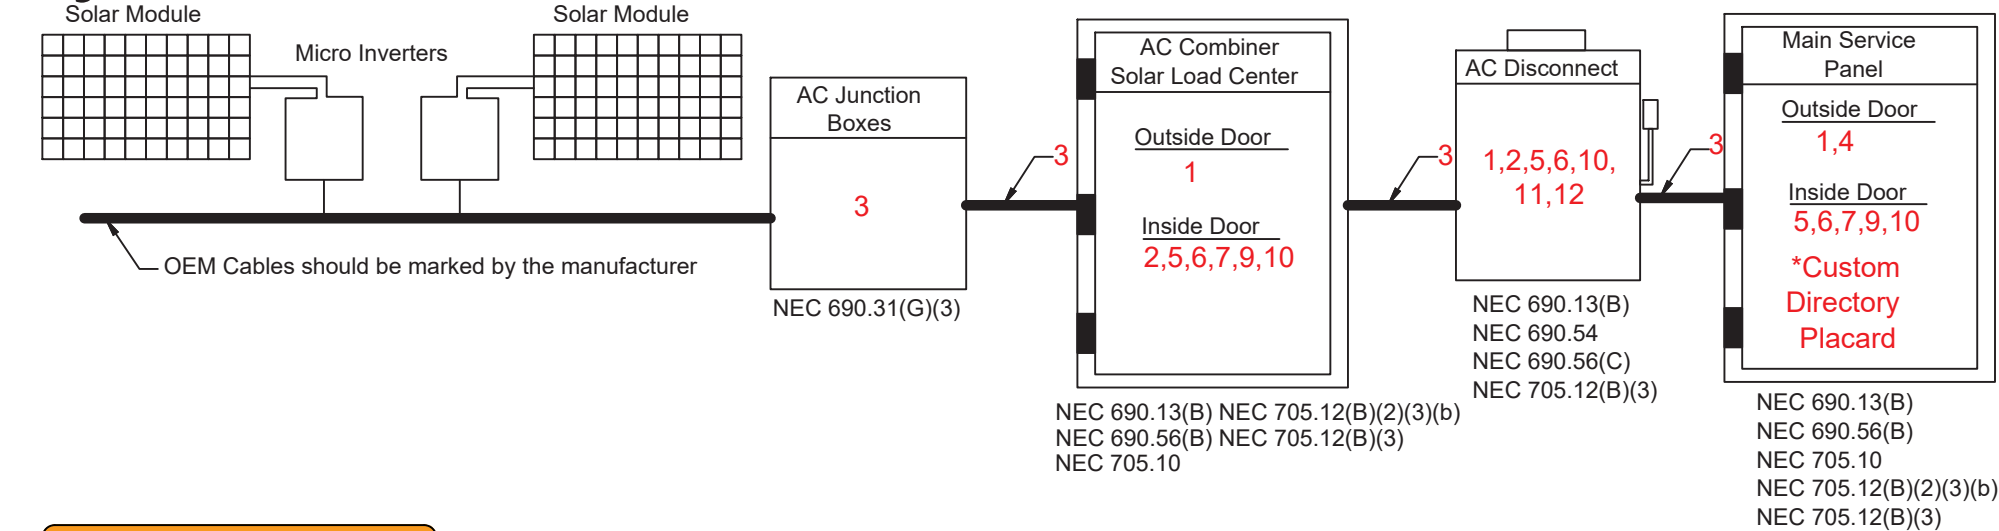

1

⚠

WARNING

ELECTRICAL SHOCK HAZARD

TERMINALS ON THE LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

LABEL LOCATION: COMBINER PANEL, AC DISCONNECT, POINT OF INTERCONNECTION
PER CODE: NEC 690.13(B)

2

⚠

WARNING

TURN OFF PHOTOVOLTAIC AC DISCONNECT PRIOR TO WORKING INSIDE PANEL

LABEL LOCATION: COMBINER PANEL(S), MAIN SERVICE DISCONNECT
PER CODE: NEC 110.27(C), OSHA 1910.145(f)(7)

3

WARNING: PHOTOVOLTAIC POWER SOURCE

LABEL LOCATION: DC CONDUIT/RACEWAY/CABLE TRAY
PER CODE: NEC 690.31(G)(3-4)

4

PHOTOVOLTAIC SYSTEM AC DISCONNECT

RATED AC OUPUT CURRENT: 43.20 A

NOMINAL OPERATING AC VOLTAGE: 240 V

LABEL LOCATION: POINT OF INTERCONNECTION
PER CODE: NEC 690.54

5

PV SYSTEM

DISCONNECT

LABEL LOCATION: AC DISCONNECT
PER CODE: NEC 690.13(B)

6

DO NOT DISCONNECT UNDER LOAD

LABEL LOCATION: MAIN SERVICE DISCONNECT
PER CODE: NEC 690.15(C) & NEC 690.33(E)(2)

7

⚠

WARNING DUAL POWER SOURCE

SECOND SOURCE IS PHOTOVOLTAIC SYSTEM

LABEL LOCATION: MAIN SERVICE DISCONNECT
PER CODE: NEC 705.12(B)(3-4), NEC 690.59

8

⚠

WARNING

THIS EQUIPMENT FED BY MULTIPLE SOURCES. TOTAL RATING OF ALL OVERCURRENT DEVICES EXCLUDING MAIN SUPPLY OVERCURRENT DEVICE SHALL NOT EXCEED AMPACITY OF BUSBAR.

LABEL LOCATION: POINT OF INTERCONNECTION, COMBINER PANEL
PER CODE: NEC 705.12(B)(2)(3)(c)

9

⚠

WARNING

POWER SOURCE OUTPUT CONNECTION. DO NOT RELOCATE THIS OVERCURRENT DEVICE.

LABEL LOCATION: MAIN SERVICE DISCONNECT, POINT OF INTERCONNECTION
PER CODE: 705.12(B)(2)(3)(b)

10

MAIN PHOTOVOLTAIC SYSTEM DISCONNECT

LABEL LOCATION: MAIN SERVICE DISCONNECT, UTILITY METER
PER CODE: NEC 690.13(B)

11

RAPID SHUTDOWN FOR SOLAR PV SYSTEM


LABEL LOCATION: RSD INITIATION DEVICE, AC DISCONNECT
PER CODE: NEC 690.56(C)(3)

12

SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN THE ARRAY

LABEL LOCATION: MAIN SERVICE DISCONNECT
PER CODE: NEC 690.56(C)(1)(a)

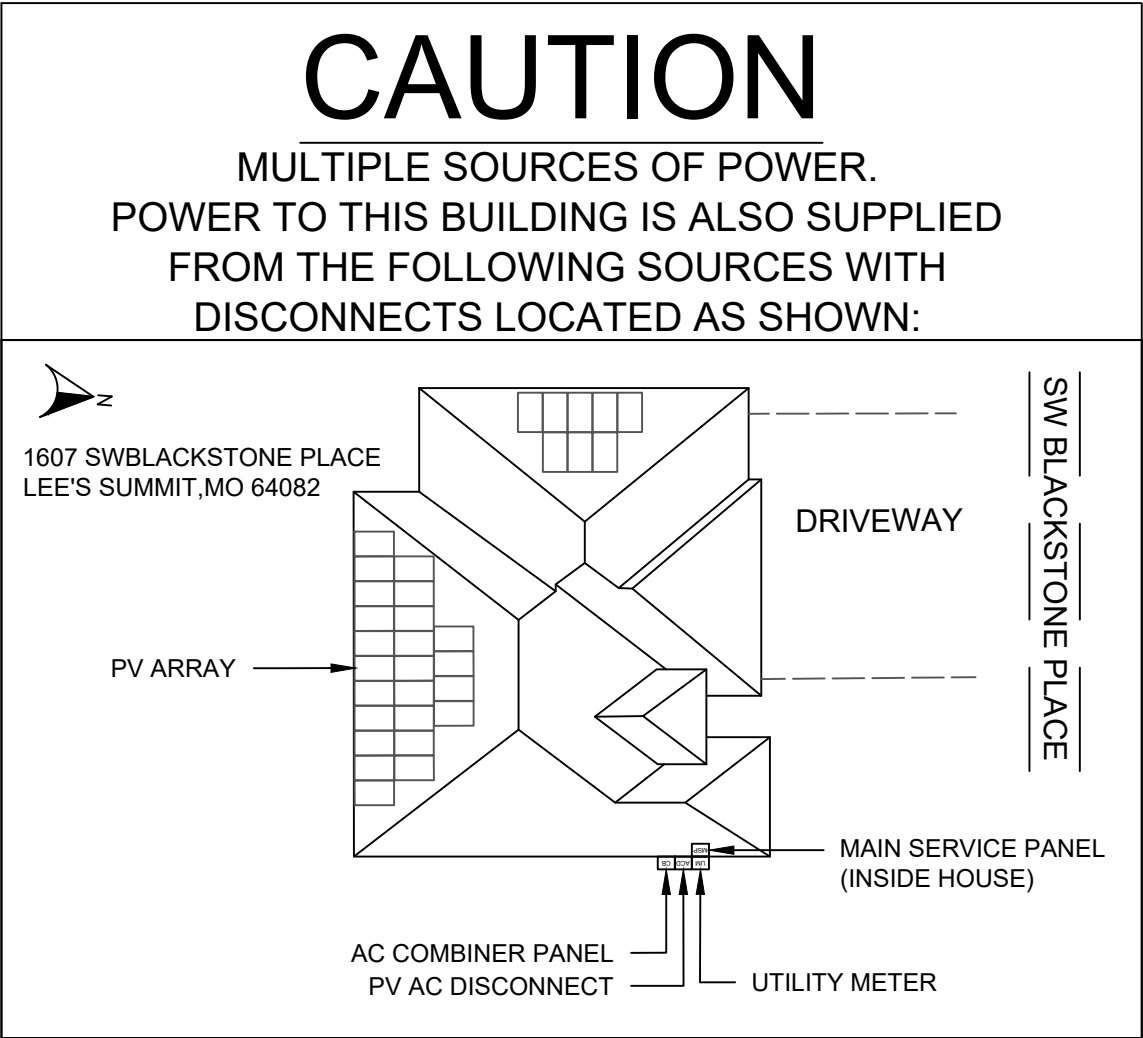

CONTRACTOR

Installation • Service • Repair

THE SOLAR GUYS

Commercial • Residential Energy Storage

THE SOLAR GUYS

6114 MO-9, PARKVILLE,
MISSOURI 64152

PHONE - (816) 708-5556

PROJECT NAME & ADDRESS

MICHAEL & MAYUMI MCKNIGHT

1607 SW BLACKSTONE PLACE,
LEE'S SUMMIT, MO 64082

APN #: 69720101000000000

METER NO:20016576

AHJ: CITY OF LEES SUMMIT

UTILITY: EVERGY MO WEST

SYSTEM DETAILS

DC SIZE: 10.560 KW DC-(STC)

AC SIZE: 10.400 KW AC

(32) HANWHA Q CELLS Q.PEAK DUO BLK-G6+330

(32) ENPHASE IQ8M-72-2-US (240V)

REVISIONS

REV	DESCRIPTION	DATE

SHEET TITLE

WARNING LABELS

DRAWN DATE

4/17/2023

DRAWN BY

SS

SHEET NUMBER

PV-06

powered by
Q.ANTUM DUO

Q.PEAK DUO BLK-G6+

330-345

ENDURING HIGH
PERFORMANCE



Q.ANTUM TECHNOLOGY: LOW LEVELIZED COST OF ELECTRICITY

Higher yield per surface area, lower BOS costs, higher power classes, and an efficiency rate of up to 19.5%.

INNOVATIVE ALL-WEATHER TECHNOLOGY

Optimal yields, whatever the weather with excellent low-light and temperature behavior.

ENDURING HIGH PERFORMANCE

Long-term yield security with Anti LID and Anti PID Technology¹, Hot-Spot Protect and Traceable Quality Tra.Q™.

EXTREME WEATHER RATING

High-tech aluminum alloy frame, certified for high snow (5400 Pa) and wind loads (4000 Pa).

A RELIABLE INVESTMENT

Inclusive 25-year product warranty and 25-year linear performance warranty².

STATE OF THE ART MODULE TECHNOLOGY

Q.ANTUM DUO combines cutting edge cell separation and innovative wiring with Q.ANTUM Technology.

¹ APT test conditions according to IEC/TS 62804-1:2015, method B (-1500V, 168h)
² See data sheet on rear for further information

THE IDEAL SOLUTION FOR:




Engineered in Germany

Q CELLS

MECHANICAL SPECIFICATION

Format	68.5 × 40.6 × 1.26 in (including frame) (1740 × 1030 × 32 mm)
Weight	43.9 lbs (19.9 kg)
Front Cover	0.13 in (3.2 mm) thermally pre-stressed glass with anti-reflection technology
Back Cover	Composite film
Frame	Black anodized aluminum
Cell	6 × 20 monocrystalline Q.ANTUM solar half cells
Junction Box	2.09-3.98 × 1.26-2.36 × 0.59-0.71 in (53-101 × 32-60 × 15-18 mm), Protection class IP67, with bypass diodes
Cable	4 mm ² Solar cable; (+) ≥ 45.3 in (1150 mm), (-) ≥ 45.3 in (1150 mm)
Connector	Stäubli MC4, Hanwha Q CELLS HQC4, Amphenol UTX, Renhe 05-6, Tongling TL-Cable01S, JMTHY JM601; IP68 or Friends PV2e; IP67

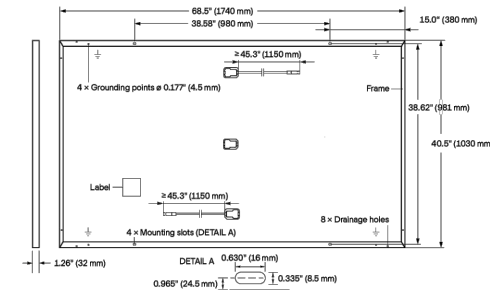


ELECTRICAL CHARACTERISTICS

POWER CLASS		330	335	340	345
MINIMUM PERFORMANCE AT STANDARD TEST CONDITIONS, STC ² (POWER TOLERANCE +5W/-0W)					
Minimum	Power at MPP ¹	P _{MPP} [W]	330	335	340
	Short Circuit Current ¹	I _{SC} [A]	10.41	10.47	10.52
	Open Circuit Voltage ¹	V _{OC} [V]	40.15	40.41	40.66
	Current at MPP	I _{MPP} [A]	9.91	9.97	10.02
	Voltage at MPP	V _{MPP} [V]	33.29	33.62	33.94
	Efficiency ¹	η [%]	≥ 18.4	≥ 18.7	≥ 19.0
MINIMUM PERFORMANCE AT NORMAL OPERATING CONDITIONS, NMOT ²					
Minimum	Power at MPP	P _{MPP} [W]	247.0	250.7	254.5
	Short Circuit Current	I _{SC} [A]	8.39	8.43	8.48
	Open Circuit Voltage	V _{OC} [V]	37.86	38.10	38.34
	Current at MPP	I _{MPP} [A]	7.80	7.84	7.89
	Voltage at MPP	V _{MPP} [V]	31.66	31.97	32.27


¹Measurement tolerances P_{MPP} ± 3%; I_{SC}; V_{OC} ± 5% at STC: 1000 W/m², 25 ± 2°C, AM 1.5 according to IEC 60904-3 • 800 W/m², NMOT, spectrum AM 1.5

Q CELLS PERFORMANCE WARRANTY

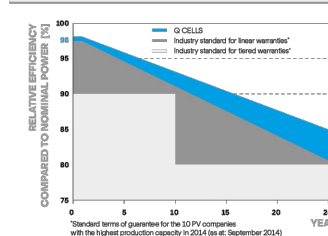

At least 98% of nominal power during first year. Thereafter max. 0.54% degradation per year. At least 93.1% of nominal power up to 10 years. At least 85% of nominal power up to 25 years.

All data within measurement tolerances. Full warranties in accordance with the warranty terms of the Q CELLS sales organization of your respective country.

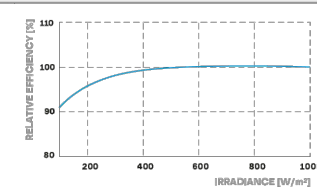

Typical module performance under low irradiance conditions in comparison to STC conditions (25°C, 1000 W/m²)

TEMPERATURE COEFFICIENTS

Temperature Coefficient of I _{SC}	α	[%/K]	+0.04	Temperature Coefficient of V _{OC}	β	[%/K]	-0.27
Temperature Coefficient of P _{MPP}	γ	[%/K]	-0.36	Normal Module Operating Temperature	NMOT	[°F]	109 ± 5.4 (43 ± 3°C)

PROPERTIES FOR SYSTEM DESIGN

Maximum System Voltage V _{sys}	[V]	1000 (IEC)/1000 (UL)	Safety Class	II
Maximum Series Fuse Rating	[A DC]	20	Fire Rating based on ANSI / UL 1703	C (IEC) / TYPE 2 (UL)
Max. Design Load, Push / Pull ³	[lbs / ft ²]	75 (3600 Pa) / 55 (2667 Pa)	Permitted Module Temperature on Continuous Duty	-40°F up to +185°F (-40°C up to +85°C)
Max. Test Load, Push / Pull ³	[lbs / ft ²]	113 (5400 Pa) / 84 (4000 Pa)		

³See Installation Manual

QUALIFICATIONS AND CERTIFICATES

UL 1703, VDE Quality Tested, CE-compliant, IEC 61215:2016, IEC 61730:2016, Application Class II, U.S. Patent No. 9,893,215 (solar cells)



PACKAGING INFORMATION

Number of Modules per Pallet	32
Number of Pallets per 53' Trailer	28
Number of Pallets per 40' HC-Container	24
Pallet Dimensions (L × W × H)	71.5 × 45.3 × 48.0 in (1815 × 1150 × 1220 mm)
Pallet Weight	1505 lbs (683 kg)

Note: Installation instructions must be followed. See the installation and operating manual or contact our technical service department for further information on approved installation and use of this product.

Hanwha Q CELLS America Inc.

400 Spectrum Center Drive, Suite 1400, Irvine, CA 92618, USA | TEL +1 949 748 59 96 | EMAIL inquiry@us.q-cells.com | WEB www.q-cells.us

CONTRACTOR



THE SOLAR GUYS

6114 MO-9, PARKVILLE,
MISSOURI 64152
PHONE - (816) 708-5556

PROJECT NAME & ADDRESS

MICHAEL & MAYUMI MCKNIGHT
1607 SW BLACKSTONE PLACE,
LEE'S SUMMIT, MO 64082
APN #: 69720101000000000
METER NO:20016576
AHJ: CITY OF LEES SUMMIT
UTILITY: EVERGY MO WEST

SYSTEM DETAILS

DC SIZE: 10.560 KW DC-(STC)
AC SIZE: 10.400 KW AC
(32) HANWHA Q CELLS Q.PEAK DUO BLK-G6+330
(32) ENPHASE IQ8M-72-2-US (240V)

REVISIONS

REV	DESCRIPTION	DATE

SHEET TITLE RESOURCE DOCUMENT

DRAWN DATE	4/17/2023
DRAWN BY	SS

SHEET NUMBER

R-01

Specifications subject to technical changes © Q CELLS Q.PEAK DUO BLK-G6+, 330-345, 2019-06, Rev01_NA



DATA SHEET



IQ8M and IQ8A Microinverters

Our newest IQ8 Microinverters are the industry's first microgrid-forming, software defined microinverters with split-phase power conversion capability to convert DC power to AC power efficiently. The brain of the semiconductor-based microinverter is our proprietary application specific integrated circuit (ASIC) which enables the microinverter to operate in grid-tied or off-grid modes. This chip is built in advanced 55nm technology with high speed digital logic and has superfast response times to changing loads and grid events, alleviating constraints on battery sizing for home energy systems.



Part of the Enphase Energy System, IQ8 Series Microinverters integrate with the IQ Battery, IQ Gateway, and the Enphase App monitoring and analysis software.



IQ8 Series Microinverters redefine reliability standards with more than one million cumulative hours of power-on testing, enabling an industry-leading limited warranty of up to 25 years.



Connect PV modules quickly and easily to IQ8 Series Microinverters using the included Q-DCC-2 adapter cable with plug-n-play MC4 connectors.



IQ8 Series Microinverters are UL listed as PV Rapid Shutdown Equipment and conform with various regulations, when installed according to manufacturer's instructions.

*Only when installed with IQ System Controller 2, meets UL 1741.
**IQ8M and IQ8A support split-phase, 240V installations only.

© 2022 Enphase Energy. All rights reserved. Enphase, the Enphase logo, IQ8 Microinverters, and other names are trademarks of Enphase Energy, Inc. Data subject to change.

IQ8MA-12A-DS-0069-03-EN-US-2022-12-27

Easy to install

- Lightweight and compact with plug-n-play connectors
- Power Line Communication (PLC) between components
- Faster installation with simple two-wire cabling

High productivity and reliability

- Produce power even when the grid is down*
- More than one million cumulative hours of testing
- Class II double-insulated enclosure
- Optimized for the latest high-powered PV modules

Microgrid-forming

- Complies with the latest advanced grid support**
- Remote automatic updates for the latest grid requirements
- Configurable to support a wide range of grid profiles
- Meets CA Rule 21 (UL 1741-SA) and IEEE 1547:2018 (UL 1741-SB 3rd Ed.)

Note:

IQ8 Microinverters cannot be mixed together with previous generations of Enphase microinverters (IQ7 Series, IQ6 Series, etc) in the same system.

IQ8M and IQ8A Microinverters


INPUT DATA (DC)		IQ8M-72-2-US	IQ8A-72-2-US
Commonly used module pairings ¹	W	260 – 460	295 – 500
Module compatibility		54-cell / 108 half-cell, 60-cell / 120 half-cell, 66-cell / 132 half-cell and 72-cell / 144 half-cell	
MPPT voltage range	V	30 – 45	32 – 45
Operating range	V		16 – 58
Min. / Max. start voltage	V		22 / 58
Max. input DC voltage	V		60
Max. continuous input DC current	A		12
Max. input DC short-circuit current	A		25
Max. module I _{sc}	A		20
Overvoltage class DC port			II
DC port backfeed current	mA		0
PV array configuration		1 x 1 Ungrounded array; No additional DC side protection required; AC side protection requires max 20A per branch circuit	
OUTPUT DATA (AC)		IQ8M-72-2-US	IQ8A-72-2-US
Peak output power	VA	330	366
Max. continuous output power	VA	325	349
Nominal (L-L) voltage / range ²	V	240 / 211 – 264	
Max. continuous output current	A	1.35	1.45
Nominal frequency	Hz	60	
Extended frequency range	Hz	47 – 68	
AC short circuit fault current over 3 cycles	Arms	2	
Max. units per 20 A (L-L) branch circuit ³		11	
Total harmonic distortion		<5%	
Overvoltage class AC port		III	
AC port backfeed current	mA	30	
Power factor setting		1.0	
Grid-tied power factor (adjustable)		0.85 leading – 0.85 lagging	
Peak efficiency	%	97.8	97.7
CEC weighted efficiency	%	97.5	97
Night-time power consumption	mW	60	

MECHANICAL DATA	
Ambient temperature range	-40°C to +60°C (-40°F to +140°F)
Relative humidity range	4% to 100% (condensing)
DC Connector type	MC4
Dimensions (H x W x D)	212 mm (8.3") x 175 mm (6.9") x 30.2 mm (1.2")
Weight	1.08 kg (2.38 lbs)
Cooling	Natural convection – no fans
Approved for wet locations	Yes
Pollution degree	PD3
Enclosure	Class II double-insulated, corrosion resistant polymeric enclosure
Environ. category / UV exposure rating	NEMA Type 6 / outdoor
COMPLIANCE	
Certifications	CA Rule 21 (UL 1741-SA), UL 62109-1, IEEE 1547:2018 (UL 1741-SB 3 rd Ed.), FCC Part 15 Class B, ICES-0003 Class B, CAN / CSA-C22.2 NO. 107.1-01 This product is UL Listed as PV Rapid Shutdown Equipment and conforms with NEC 2014, NEC 2017, and NEC 2020 section 690.12 and C22.1-2018 Rule 64-218 Rapid Shutdown of PV Systems, for AC and DC conductors, when installed according to manufacturer's instructions.

(1) Pairing PV modules with wattage above the limit may result in additional clipping losses. See the compatibility calculator at <https://link.enphase.com/module-compatibility>. (2) Nominal voltage range can be extended beyond nominal if required by the utility. (3) Limits may vary. Refer to local requirements to define the number of microinverters per branch in your area.

IQ8MA-12A-DS-0069-03-EN-US-2022-12-27

CONTRACTOR

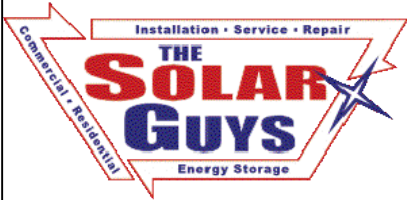

THE SOLAR GUYS

6114 MO-9, PARKVILLE,
MISSOURI 64152
PHONE - (816) 708-5556

PROJECT NAME & ADDRESS

MICHAEL & MAYUMI MCKNIGHT
1607 SW BLACKSTONE PLACE,
LEE'S SUMMIT, MO 64082
APN #: 69720101000000000
METER NO:20016576
AHJ: CITY OF LEES SUMMIT
UTILITY: EVERGY MO WEST

SYSTEM DETAILS

DC SIZE: 10.560 KW DC-(STC)
AC SIZE: 10.400 KW AC
(32) HANWHA Q CELLS Q.PEAK DUO BLK-G6+330
(32) ENPHASE IQ8M-72-2-US (240V)

REVISIONS

REV	DESCRIPTION	DATE

SHEET TITLE RESOURCE DOCUMENT

DRAWN DATE	4/17/2023
DRAWN BY	SS

SHEET NUMBER

R-02

Enphase IQ Combiner 4/4C

X-IQ-AM1-240-4
X-IQ-AM1-240-4C



To learn more about Enphase offerings, visit enphase.com



The **Enphase IQ Combiner 4/4C** with Enphase IQ Gateway and integrated LTE-M1 cell modem (included only with IQ Combiner 4C) consolidates interconnection equipment into a single enclosure and streamlines IQ microinverters and storage installations by providing a consistent, pre-wired solution for residential applications. It offers up to four 2-pole input circuits and Eaton BR series busbar assembly.

Smart

- Includes IQ Gateway for communication and control
- Includes Enphase Mobile Connect cellular modem (CELLMODEM-M1-06-SP-05), included only with IQ Combiner 4C
- Includes solar shield to match Enphase IQ Battery aesthetics and deflect heat
- Flexible networking supports Wi-Fi, Ethernet, or cellular
- Optional AC receptacle available for PLC bridge
- Provides production metering and consumption monitoring

Simple

- Centered mounting brackets support single stud mounting
- Supports bottom, back and side conduit entry
- Up to four 2-pole branch circuits for 240 VAC plug-in breakers (not included)
- 80A total PV or storage branch circuits

Reliable

- Durable NRTL-certified NEMA type 3R enclosure
- Five-year limited warranty
- Two years labor reimbursement program coverage included for both the IQ Combiner SKU's
- UL listed

Enphase IQ Combiner 4/4C

MODEL NUMBER	
IQ Combiner 4 (X-IQ-AM1-240-4)	IQ Combiner 4 with Enphase IQ Gateway printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 +/- 0.5%) and consumption monitoring (+/- 2.5%). Includes a silver solar shield to match the IQ Battery system and IQ System Controller 2 and to deflect heat.
IQ Combiner 4C (X-IQ-AM1-240-4C)	IQ Combiner 4C with Enphase IQ Gateway printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 +/- 0.5%) and consumption monitoring (+/- 2.5%). Includes Enphase Mobile Connect cellular modem (CELLMODEM-M1-06-SP-05), a plug-and-play industrial-grade cell modem for systems up to 60 microinverters. (Available in the US, Canada, Mexico, Puerto Rico, and the US Virgin Islands, where there is adequate cellular service in the installation area.) Includes a silver solar shield to match the IQ Battery and IQ System Controller and to deflect heat.
ACCESSORIES AND REPLACEMENT PARTS	
Ensemble Communications Kit COMMS-CELLMODEM-M1-06 CELLMODEM-M1-06-SP-05 CELLMODEM-M1-06-AT-05	(not included, order separately) - Includes COMMS-KIT-01 and CELLMODEM-M1-06-SP-05 with 5-year Sprint data plan for Ensemble sites - 4G based LTE-M1 cellular modem with 5-year Sprint data plan - 4G based LTE-M1 cellular modem with 5-year AT&T data plan
Circuit Breakers BRK-10A-2-240V BRK-15A-2-240V BRK-20A-2P-240V BRK-15A-2P-240V-B BRK-20A-2P-240V-B	Supports Eaton BR210, BR215, BR220, BR230, BR240, BR250, and BR260 circuit breakers. Circuit breaker, 2 pole, 10A, Eaton BR210 Circuit breaker, 2 pole, 15A, Eaton BR215 Circuit breaker, 2 pole, 20A, Eaton BR220 Circuit breaker, 2 pole, 15A, Eaton BR215B with hold down kit support Circuit breaker, 2 pole, 20A, Eaton BR220B with hold down kit support
EPLC-01	Power line carrier (communication bridge pair), quantity - one pair
XA-SOLARSHIELD-ES	Replacement solar shield for IQ Combiner 4/4C
XA-PLUG-120-3	Accessory receptacle for Power Line Carrier in IQ Combiner 4/4C (required for EPLC-01)
XA-ENV-PCBA-3	Replacement IQ Gateway printed circuit board (PCB) for Combiner 4/4C
X-IQ-NA-HD-125A	Hold down kit for Eaton circuit breaker with screws.
ELECTRICAL SPECIFICATIONS	
Rating	Continuous duty
System voltage	120/240 VAC, 60 Hz
Eaton BR series busbar rating	125 A
Max. continuous current rating	65 A
Max. continuous current rating (input from PV/storage)	64 A
Max. fuse/circuit rating (output)	90 A
Branch circuits (solar and/or storage)	Up to four 2-pole Eaton BR series Distributed Generation (DG) breakers only (not included)
Max. total branch circuit breaker rating (input)	80A of distributed generation / 95A with IQ Gateway breaker included
Envoy breaker	10A or 15A rating GE/Siemens/Eaton included
Production metering CT	200 A solid core pre-installed and wired to IQ Gateway
Consumption monitoring CT (CT-200-SPLIT)	A pair of 200 A split core current transformers
MECHANICAL DATA	
Dimensions (WxHxD)	37.5 x 49.5 x 16.8 cm (14.75" x 19.5" x 6.63"). Height is 21.06" (53.5 cm) with mounting brackets.
Weight	7.5 kg (16.5 lbs)
Ambient temperature range	-40° C to +46° C (-40° to 115° F)
Cooling	Natural convection, plus heat shield
Enclosure environmental rating	Outdoor, NRTL-certified, NEMA type 3R, polycarbonate construction
Wire sizes	• 20 A to 50 A breaker inputs: 14 to 4 AWG copper conductors • 60 A breaker branch input: 4 to 1/0 AWG copper conductors • Main lug combined output: 10 to 2/0 AWG copper conductors • Neutral and ground: 14 to 1/0 copper conductors Always follow local code requirements for conductor sizing.
Altitude	To 2000 meters (6,560 feet)
INTERNET CONNECTION OPTIONS	
Integrated Wi-Fi	802.11b/g/n
Cellular	CELLMODEM-M1-06-SP-05, CELLMODEM-M1-06-AT-05 (4G based LTE-M1 cellular modem). Note that an Enphase Mobile Connect cellular modem is required for all Ensemble installations.
Ethernet	Optional, 802.3, Cat5E (or Cat 6) UTP Ethernet cable (not included)
COMPLIANCE	
Compliance, IQ Combiner	UL 1741, CAN/CSA C22.2 No. 107.1, 47 CFR, Part 15, Class B, ICES 003 Production metering: ANSI C12.20 accuracy class 0.5 (PV production) Consumption metering: accuracy class 2.5
Compliance, IQ Gateway	UL 60601-1/CANCSA 22.2 No. 61010-1

To learn more about Enphase offerings, visit enphase.com

© 2022 Enphase Energy. All rights reserved. Enphase, the Enphase logo, IQ Combiner 4/4C, and other names are trademarks of Enphase Energy, Inc. Data subject to change. 02-14-2022



THE SOLAR GUYS

6114 MO-9, PARKVILLE,
MISSOURI 64152
PHONE - (816) 708-5556

PROJECT NAME & ADDRESS

MICHAEL & MAYUMI MCKNIGHT
1607 SW BLACKSTONE PLACE,
LEE'S SUMMIT, MO 64082
APN #: 69720101000000000
METER NO:20016576
AHJ: CITY OF LEES SUMMIT
UTILITY: EVERGY MO WEST

SYSTEM DETAILS

DC SIZE: 10.560 KW DC-(STC)
AC SIZE: 10.400 KW AC
(32) HANWHA Q CELLS Q.PEAK DUO BLK-G6+330
(32) ENPHASE IQ8M-72-2-US (240V)

REVISIONS

REV	DESCRIPTION	DATE

SHEET TITLE RESOURCE DOCUMENT

DRAWN DATE	4/17/2023
DRAWN BY	SS

SHEET NUMBER

R-03

Enphase Q Cable Accessories

The **Enphase Q Cable™** and accessories are part of the latest generation Enphase IQ System™. These accessories provide simplicity, reliability, and faster installation times.



Enphase Q Cable

- Two-wire, double-insulated Enphase Q Cable is 50% lighter than the previous generation Enphase cable
- New cable numbering and plug and play connectors speed up installation and simplify wire management
- Link connectors eliminate cable waste

Field-Wireable Connectors

- Easily connect Q cables on the roof without complex wiring
- Make connections from any open connector and center feed any section of cable within branch limits
- Available in male and female connector types





To learn more about Enphase offerings, visit enphase.com



Enphase Q Cable Accessories

CONDUCTOR SPECIFICATIONS				
Certification	UL3003 (raw cable), UL 9703 (cable assemblies), DG cable			
Flame test rating	FT4			
Compliance	RoHS, OIL RES I, CE, UV Resistant, combined UL for Canada and United States			
Conductor type	THHN/THWN-2 dry/wet			
Disconnecting means	The AC and DC bulkhead connectors have been evaluated and approved by UL for use as the load-break disconnect required by NEC 690.			
Q CABLE TYPES / ORDERING OPTIONS				
Connectorized Models	Size / Max Nominal Voltage	Connector Spacing	PV Module Orientation	Connector Count per Box
Q-12-10-240	12 AWG / 277 VAC	1.3 m (4.2 ft)	Portrait	240
Q-12-17-240	12 AWG / 277 VAC	2.0 m (6.5 ft)	Landscape (60-cell)	240
Q-12-20-200	12 AWG / 277 VAC	2.3 m (7.5 ft)	Landscape (72-cell)	200
ENPHASE Q CABLE ACCESSORIES				
Name	Model Number	Description		
Raw Q Cable	Q-12-RAW-300	300 meters of 12 AWG cable with no connectors		
Field-wireable connector (male)	Q-CONN-10M	Make connections from any open connector		
Field-wireable connector (female)	Q-CONN-10F	Make connections from any Q Cable open connector		
Cable Clip	Q-CLIP-100	Used to fasten cabling to the racking or to secure looped cabling		
Disconnect tool	Q-DISC-10	Disconnect tool for Q Cable connectors, DC connectors, and AC module mount		
Q Cable sealing caps (female)	Q-SEAL-10	One needed to cover each unused connector on the cabling		
Terminator	Q-TERM-10	Terminator cap for unused cable ends		
Enphase EN4 to MC4 adaptor ¹	ECA-EN4-S22	Connect PV module using MC4 connectors to IQ micros with EN4 (TE PV4-S SOLARLOK). 150mm/5.9" to MC4.		
Enphase EN4 non-terminated adaptor ¹	ECA-EN4-FW	For field wiring of UL certified DC connectors. EN4 (TE PV4-S SOLARLOK) to non-terminated cable. 150mm/5.9"		
Enphase EN4 to MC4 adaptor (long) ¹	ECA-EN4-S22-L	Longer adapter cable for EN4 (TE PV4-S SOLARLOK) to MC4. Use with split cell modules or PV modules with short DC cable. 600mm/23.6"		
Replacement DC Adaptor (MC4)	Q-DCC-2	DC adaptor to MC4 (max voltage 100 VDC)		
Replacement DC Adaptor (UTX)	Q-DCC-5	DC adaptor to UTX (max voltage 100 VDC)		

1. Qualified per UL subject 9703.

	TERMINATOR Terminator cap for unused cable ends, sold in packs of ten (Q-TERM-10)		SEALING CAPS Sealing caps for unused aggregator and cable connections (Q-BA-CAP-10 and Q-SEAL-10)
	DISCONNECT TOOL Plan to use at least one per installation, sold in packs of ten (Q-DISC-10)		CABLE CLIP Used to fasten cabling to the racking or to secure looped cabling, sold in packs of one hundred (Q-CLIP-100)

To learn more about Enphase offerings, visit enphase.com

© 2020 Enphase Energy. All rights reserved. Enphase, the Enphase logo, Enphase IQ 7A, Enphase IQ Battery, Enphase Enlighten, Enphase IQ Envoy, and other trademarks or service names are the trademarks of Enphase Energy, Inc. Data subject to change.
2020-06-26



CONTRACTOR

Installation • Service • Repair

THE SOLAR GUYS

Commercial • Residential

Energy Storage

THE SOLAR GUYS

6114 MO-9, PARKVILLE,
MISSOURI 64152

PHONE - (816) 708-5556

PROJECT NAME & ADDRESS

MICHAEL & MAYUMI MCKNIGHT

1607 SW BLACKSTONE PLACE,
LEE'S SUMMIT, MO 64082

APN #: 69720101000000000

METER NO:20016576

AHJ: CITY OF LEES SUMMIT

UTILITY: EVERGY MO WEST

SYSTEM DETAILS

DC SIZE: 10.560 KW DC-(STC)
AC SIZE: 10.400 KW AC
(32) HANWHA Q CELLS Q-PEAK DUO BLK-G6+330
(32) ENPHASE IQ8M-72-2-US (240V)

REVISIONS		
REV	DESCRIPTION	DATE

SHEET TITLE

RESOURCE

DOCUMENT

DRAWN DATE	4/17/2023
DRAWN BY	SS

SHEET NUMBER


R-04



Solar Is Not Always Sunny

Over their lifetime, solar panels experience countless extreme weather events. Not just the worst storms in years, but the worst storms in 40 years. High winds capable of ripping panels from a roof, and snowfalls weighing enough to buckle a panel frame.

XR Rails are the structural backbone preventing these results. They resist uplift, protect against buckling and safely and efficiently transfer loads into the building structure. Their superior spanning capability requires fewer roof attachments, reducing the number of roof penetrations and the amount of installation time.

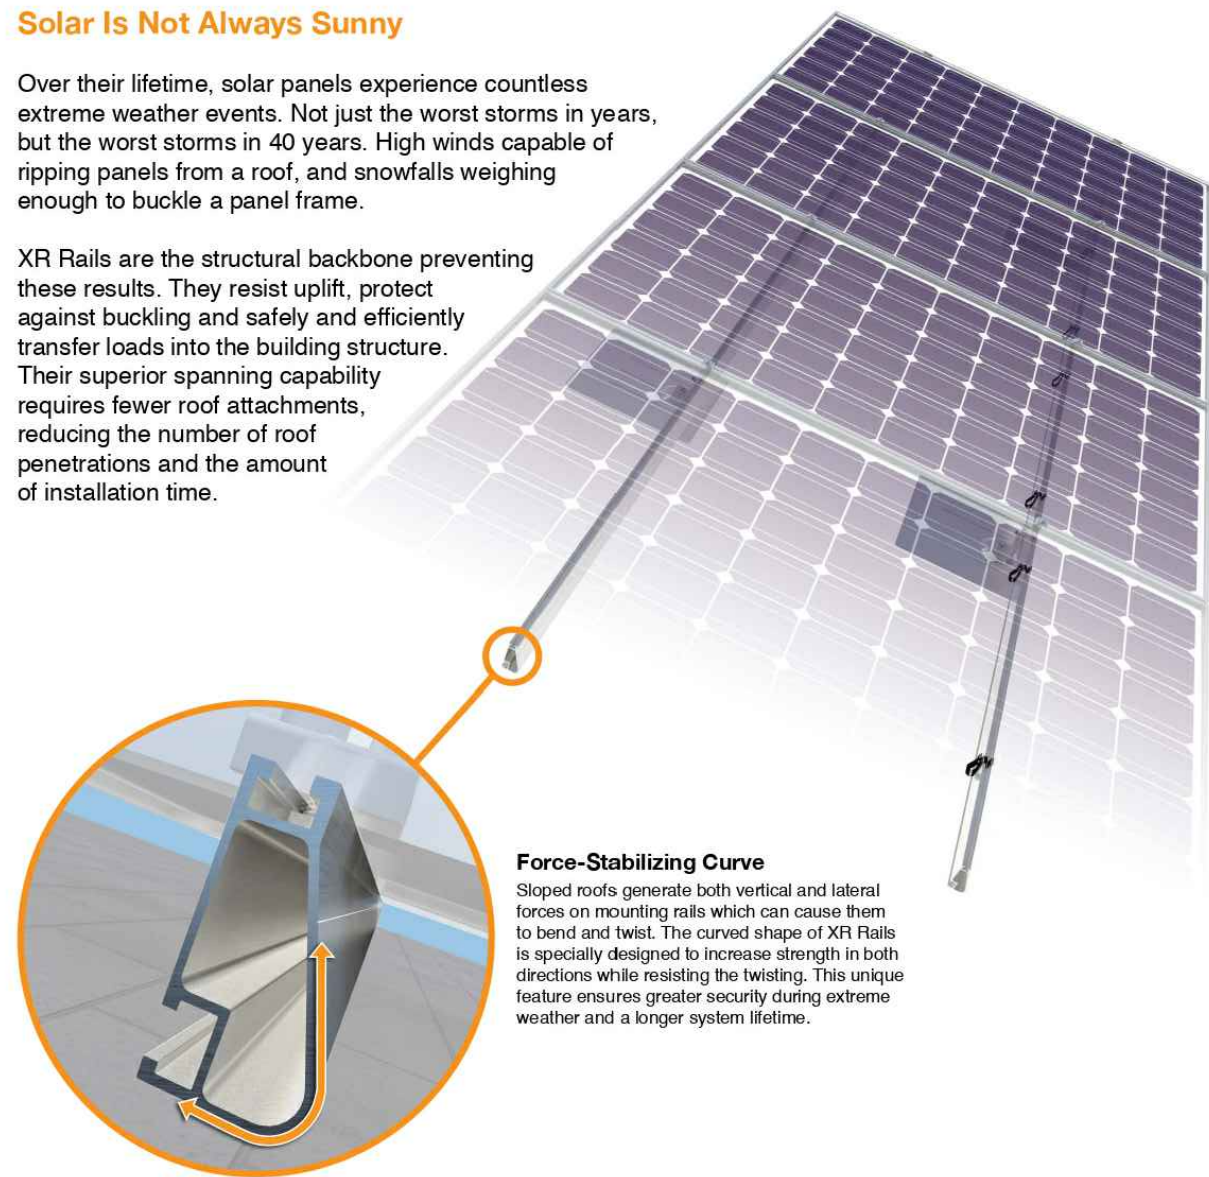

Force-Stabilizing Curve

Sloped roofs generate both vertical and lateral forces on mounting rails which can cause them to bend and twist. The curved shape of XR Rails is specially designed to increase strength in both directions while resisting the twisting. This unique feature ensures greater security during extreme weather and a longer system lifetime.

Compatible with Flat & Pitched Roofs



XR Rails are compatible with FlashFoot and other pitched roof attachments.



IronRidge offers a range of tilt leg options for flat roof mounting applications.

Corrosion-Resistant Materials

All XR Rails are made of marine-grade aluminum alloy, then protected with an anodized finish. Anodizing prevents surface and structural corrosion, while also providing a more attractive appearance.




Tech Brief

XR Rail Family



Cut Sheet

XR10® Rail

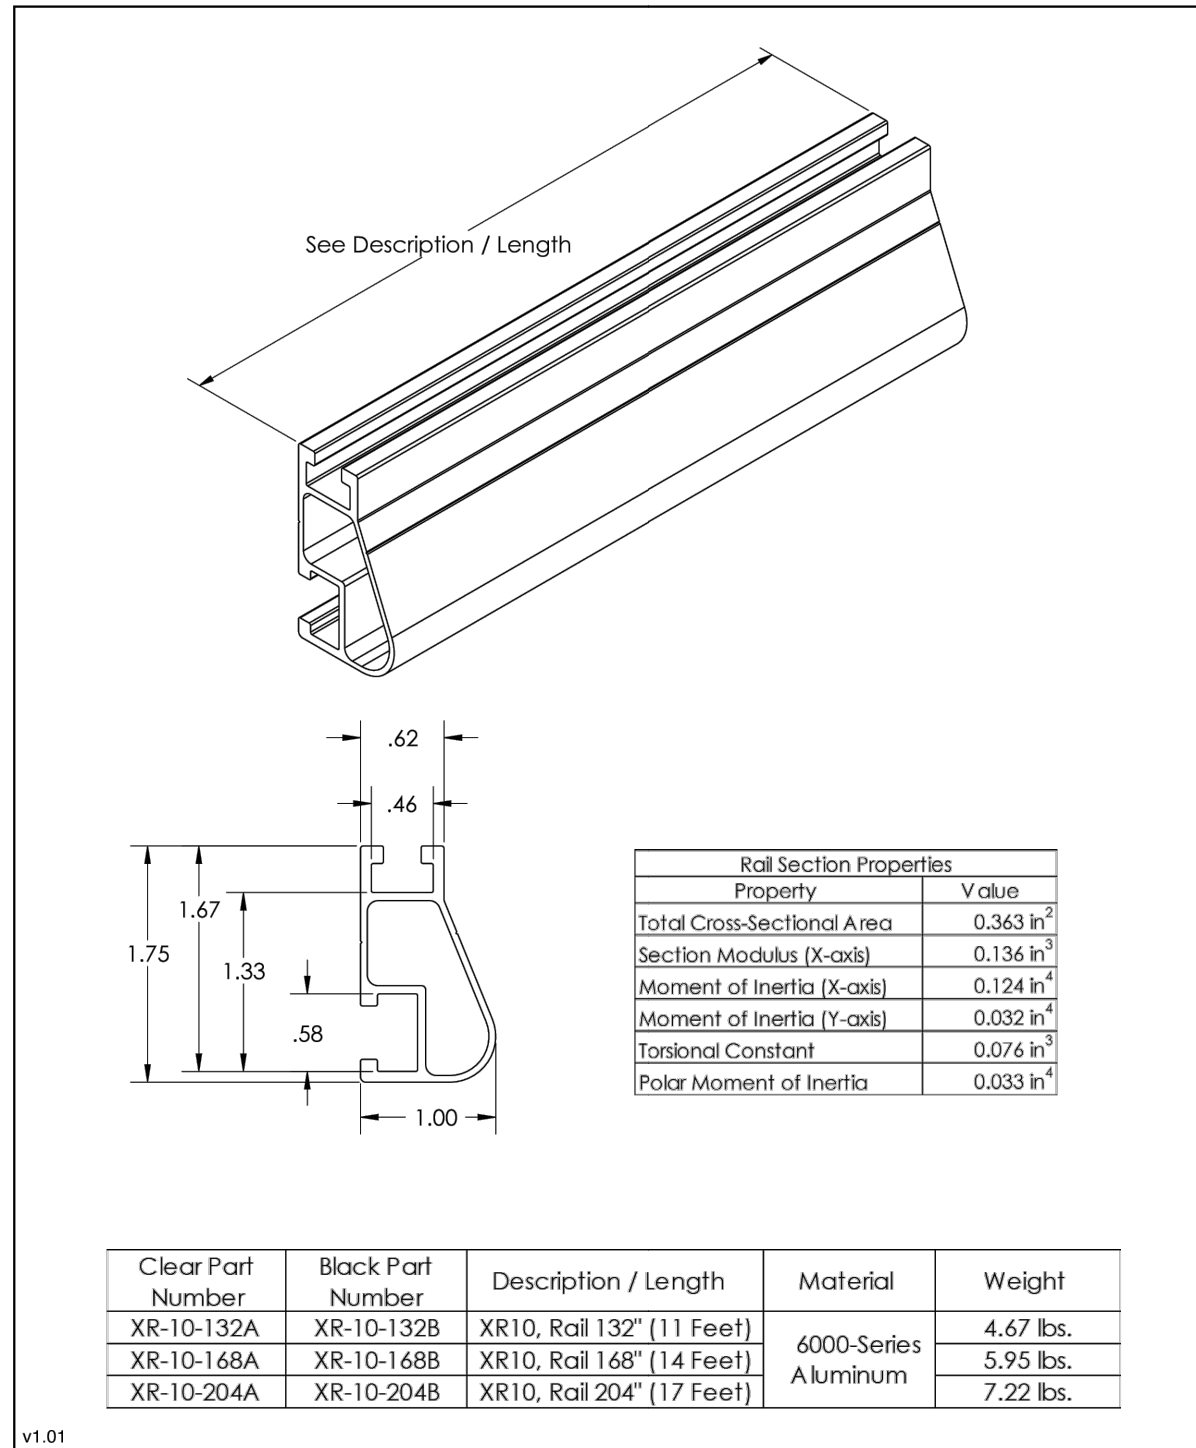

CONTRACTOR



THE SOLAR GUYS

6114 MO-9, PARKVILLE,
MISSOURI 64152
PHONE - (816) 708-5556

PROJECT NAME & ADDRESS

MICHAEL & MAYUMI MCKNIGHT
1607 SW BLACKSTONE PLACE,
LEE'S SUMMIT, MO 64082
APN #: 69720101000000000
METER NO:20016576
AHJ: CITY OF LEES SUMMIT
UTILITY: EVERGY MO WEST

SYSTEM DETAILS

DC SIZE: 10.560 KW DC-(STC)
AC SIZE: 10.400 KW AC
(32) HANWHA Q CELLS Q.PEAK DUO BLK-G6+330
(32) ENPHASE IQ8M-72-2-US (240V)

REVISIONS

REV	DESCRIPTION	DATE

SHEET TITLE RESOURCE DOCUMENT

DRAWN DATE	4/17/2023
DRAWN BY	SS


SHEET NUMBER

R-05




Universal Fastening Object

Cut Sheet

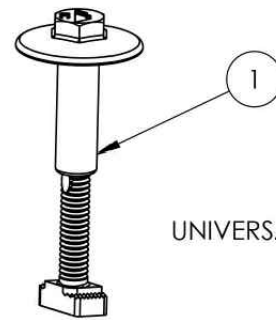

UNIVERSAL FASTENING OBJECT

ITEM NO.	DESCRIPTION
UFO-CL-01-A1	UNIVERSAL MODULE CLAMP, CLEAR
UFO-CL-01-B1	UNIVERSAL MODULE CLAMP, BLACK

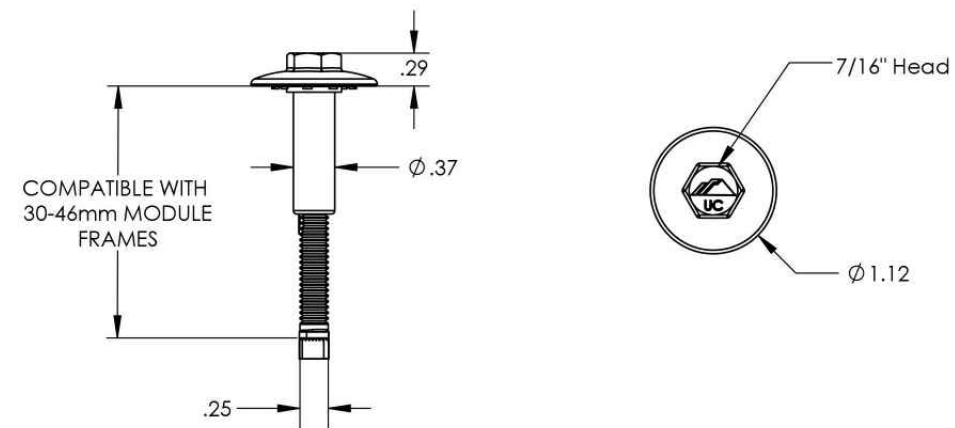


Property	Value
Material	300 Series Stainless Steel
Finish	Clear and Black

v1.30



Stopper Sleeve


Cut Sheet

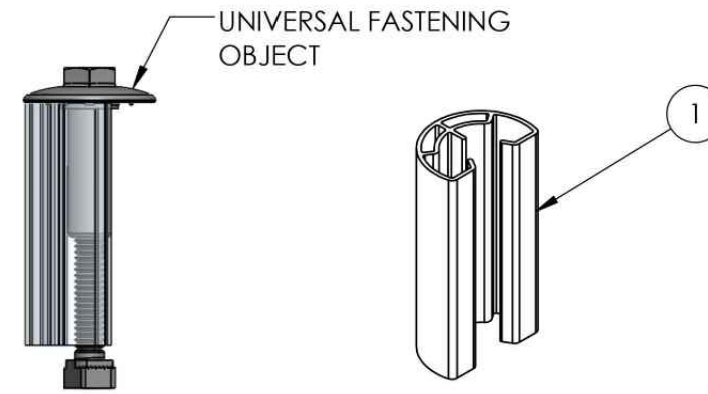

ITEM NO.	COMPONENT
1	STOPPER SLEEVE

TABLE 1: STOPPER SLEEVE PART NUMBES AND HEIGHT

MILL PART NUMBER	BLACK PART NUMBER	HEIGHT "X" (mm)
UFO-STP-30MM-M1	UFO-STP-30MM-B1	30
UFO-STP-32MM-M1	UFO-STP-32MM-B1	32
UFO-STP-33MM-M1	UFO-STP-33MM-B1	33
UFO-STP-35MM-M1	UFO-STP-35MM-B1	35
UFO-STP-38MM-M1	UFO-STP-38MM-B1	38
UFO-STP-40MM-M1	UFO-STP-40MM-B1	40
UFO-STP-42MM-M1	UFO-STP-42MM-B1	42
UFO-STP-46MM-M1	UFO-STP-46MM-B1	46

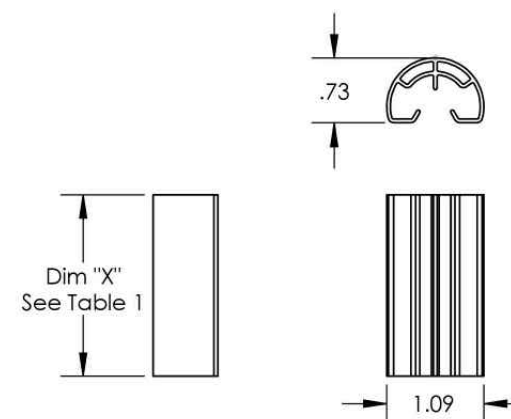

Property	Value
Material	6000 Series Aluminum
Finish	Mill or Black

v1.30



THE SOLAR GUYS

6114 MO-9, PARKVILLE,
MISSOURI 64152
PHONE - (816) 708-5556

PROJECT NAME & ADDRESS

MICHAEL & MAYUMI MCKNIGHT
1607 SW BLACKSTONE PLACE,
LEE'S SUMMIT, MO 64082
APN #: 69720101000000000
METER NO:20016576
AHJ: CITY OF LEES SUMMIT
UTILITY: EVERGY MO WEST

SYSTEM DETAILS

DC SIZE: 10.560 KW DC-(STC)
AC SIZE: 10.400 KW AC
(32) HANWHA Q CELLS Q.PEAK DUO BLK-G6+330
(32) ENPHASE IQ8M-72-2-US (240V)

REVISIONS

REV	DESCRIPTION	DATE

SHEET TITLE RESOURCE DOCUMENT

DRAWN DATE	4/17/2023
DRAWN BY	SS


SHEET NUMBER

R-06



Bonding Hardware

Cut Sheet

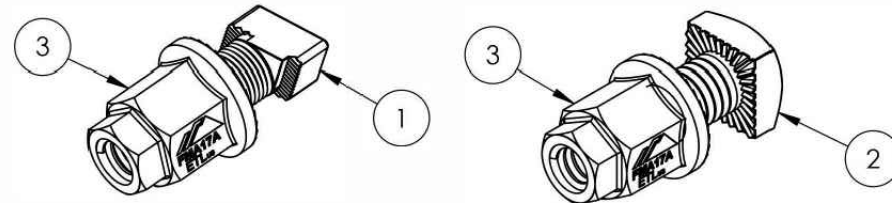


ITEM NO.	DESCRIPTION
1	BOLT, T CSTM, 3/8-16
2	BOLT, BONDING 3/8-16 SQ HEAD
3	NUT, BONDING STEP

BONDING HARDWARE


Part Number	Description
BHW-TB-02-A1	T-BOLT, BONDING HARDWARE
BHW-SQ-02-A1	SQUARE-BOLT, BONDING HARDWARE

1) BOLT, T CSTM, 3/8-16

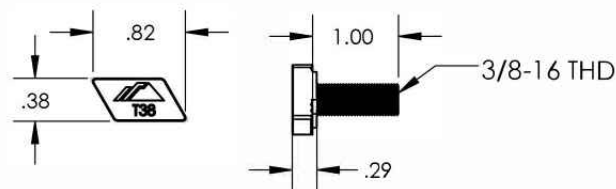


Property	Value
Material	300 Series Stainless Steel
Finish	Clear

2) BOLT, BONDING 3/8-16 SQ HEAD

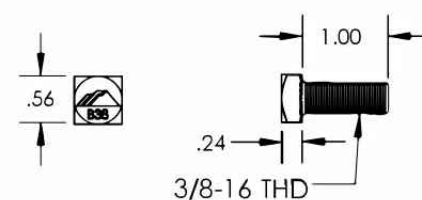

Property	Value
Material	300 Series Stainless Steel
Finish	Clear

3) NUT, BONDING STEP

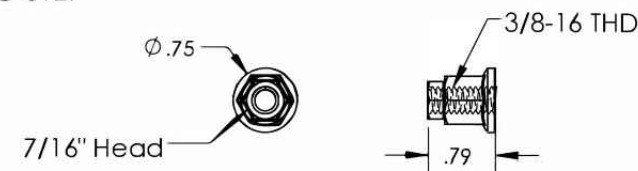


Property	Value
Material	300 Series Stainless Steel
Finish	Clear

v1.30



Grounding Lug


Cut Sheet

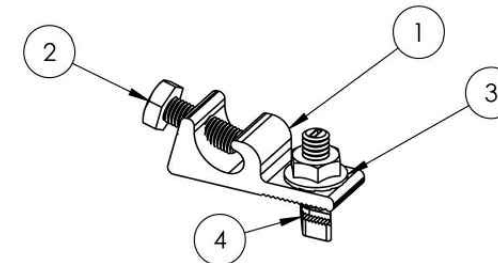

ITEM NO.	DESCRIPTION
1	LUG, GROUNDING, LAY-IN - LOW PROFILE
2	BOLT, 1/4-28 X .750" HEX CS SST
3	NUT, FLANGE HEX 1/4-20 SST
4	BOLT, T CSTM 1/4-20 X 1.188" LOCK SS


Part Number	Description	Wire Size Range (AWG)
XR-LUG-03-A1	GROUNDING LUG, LOW PROFILE	4-10

1) Lug, Grounding

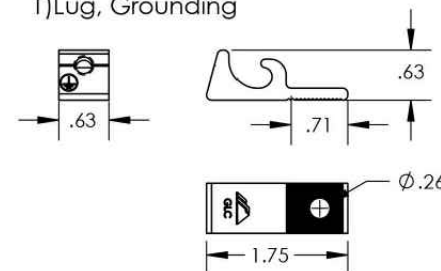


Property	Value
Material	Tin Plated Copper
Finish	Clear Matte

3) Nut, Flange Hex 1/4-20




Property	Value
Material	300 Series Stainless Steel
Finish	Clear

4) Bolt, T CSTM 1/4-20 x .750

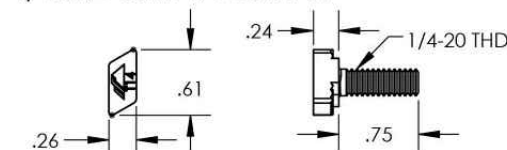

Property	Value
Material	300 Series Stainless Steel
Finish	Clear

2) Bolt, 1/4-28 x .750 Hex



Property	Value
Material	300 Series Stainless Steel
Finish	Clear

v1.10



THE SOLAR GUYS

6114 MO-9, PARKVILLE,
MISSOURI 64152
PHONE - (816) 708-5556

PROJECT NAME & ADDRESS

MICHAEL & MAYUMI MCKNIGHT
1607 SW BLACKSTONE PLACE,
LEE'S SUMMIT, MO 64082
APN #: 69720101000000000
METER NO:20016576
AHJ: CITY OF LEES SUMMIT
UTILITY: EVERGY MO WEST

SYSTEM DETAILS

DC SIZE: 10.560 KW DC-(STC)
AC SIZE: 10.400 KW AC
(32) HANWHA Q CELLS Q.PEAK DUO BLK-G6+330
(32) ENPHASE IQ8M-72-2-US (240V)

REVISIONS

REV	DESCRIPTION	DATE

SHEET TITLE RESOURCE DOCUMENT

DRAWN DATE	4/17/2023
DRAWN BY	SS

SHEET NUMBER

R-07




NanoMount




Part Number	Description
K50058-BK1	NanoMount <ul style="list-style-type: none">NanoMountUSWR Gasket

See Published data for allowable loads. Care should be taken to avoid concentrated loads during installation.


NanoMount

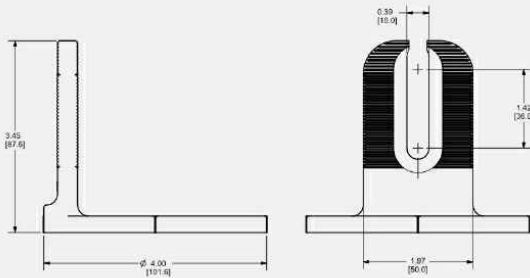

Material: Aluminum
Finish: Black Powder Coating

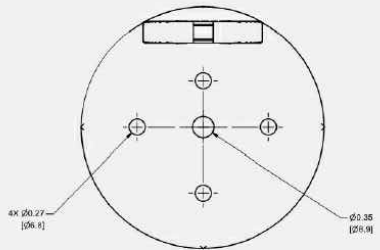

NanoMount Gasket

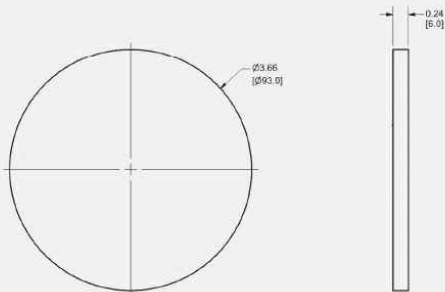

Material: USWR Gasket with Adhesive

D10214-V004
Dimensions shown are inches (and millimeters)
Details are subject to change without notice



NanoMount Lag Bolt



NanoMount Decking Screw




Part Number	Description
K50049-BK1	Lag Bolt Assembly <ul style="list-style-type: none">Hex Lag Bolt M8X115, DIN 571, 304SSealing Washer .33 ID X .75 X .157
K50055-BK1	Decking Screw Assembly <ul style="list-style-type: none">Self-Tapping Screw, #14 X 3.00Sealing Washer .26ID X .50X .125

Cut Sheet


Lag Bolt Assembly

1. Hex Lag Bolt M8X115, DIN 571, 304

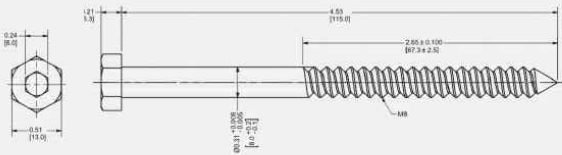

Material: Stainless Steel
Finish: Clear


2 Sealing Washer .33ID X.75X.157

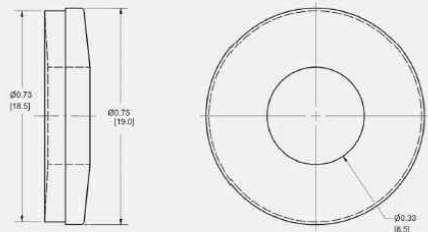

Material: EPDM + Stainless Steel


Decking Screw Assembly

1. Self-Tapping Screw, #14 X 3.00

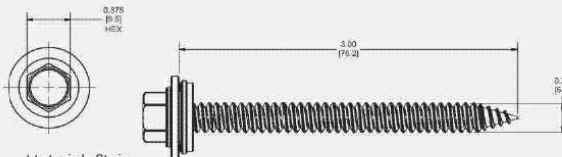

Material: Stain
Finish: Clear


2. Sealing Washer .26ID X .50X .125

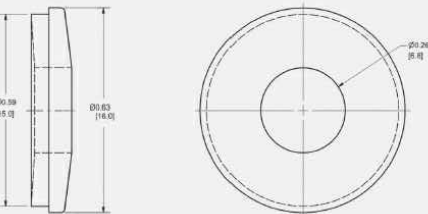

Material: EPDM + Stainless Steel

D10214-V004
Dimensions shown are inches (and millimeters)
Details are subject to change without notice

CONTRACTOR

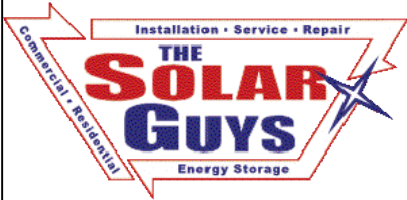

THE SOLAR GUYS

6114 MO-9, PARKVILLE,
MISSOURI 64152
PHONE - (816) 708-5556

PROJECT NAME & ADDRESS

MICHAEL & MAYUMI MCKNIGHT
1607 SW BLACKSTONE PLACE,
LEE'S SUMMIT, MO 64082
APN #: 69720101000000000
METER NO:20016576
AHJ: CITY OF LEES SUMMIT
UTILITY: EVERGY MO WEST

SYSTEM DETAILS

DC SIZE: 10.560 KW DC-(STC)
AC SIZE: 10.400 KW AC
(32) HANWHA Q CELLS Q.PEAK DUO BLK-G6+330
(32) ENPHASE IQ8M-72-2-US (240V)

REVISIONS

REV	DESCRIPTION	DATE

SHEET TITLE
RESOURCE
DOCUMENT

DRAWN DATE	4/17/2023
DRAWN BY	SS

SHEET NUMBER

R-08