



MiTek USA, Inc.
16023 Swingley Ridge Rd
Chesterfield, MO 63017
314-434-1200

Re: 3542878
Summit/186 Highland Meadows

The truss drawing(s) referenced below have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Builders FirstSource (Valley Center).

Pages or sheets covered by this seal: I58813596 thru I58813659

My license renewal date for the state of Missouri is December 31, 2023.

Missouri COA: Engineering 001193



June 9, 2023


Sevier, Scott ,Engineer

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job 3542878	Truss A01	Truss Type Hip Girder	Qty 1	Ply 1	Summit/186 Highland Meadows I58813596
----------------	--------------	--------------------------	----------	----------	--

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:19 2023 Page 1

ID:0efadeDmNQjpu?sPTQBQ5yKY_s-RFC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale: 3/16"=1'


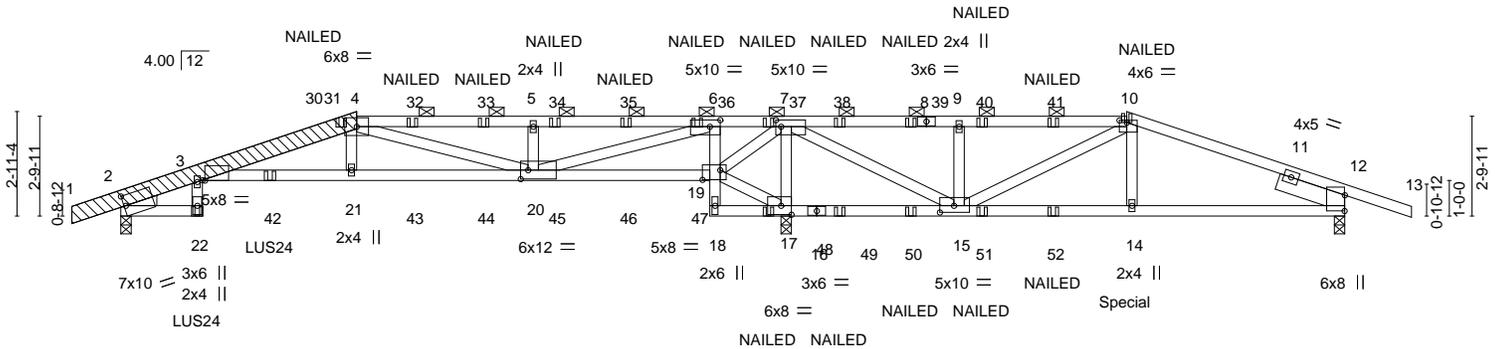


Plate Offsets (X,Y)-- [2:0-0-9,0-3-8], [3:0-0-13,Edge], [6:0-3-8,0-2-4], [7:0-1-12,0-2-4], [10:0-2-8,0-0-12], [12:0-5-5,0-0-2], [15:0-4-12,0-2-4], [17:0-3-8,0-3-0], [19:0-6-0,0-3-4], [20:0-2-8,0-3-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.84	Vert(LL)	-0.27 3-21	>837	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.78	Vert(CT)	-0.47 3-21	>472	180		
BCLL 0.0	Rep Stress Incr	NO	WB 0.85	Horz(CT)	0.19 12	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS					Weight: 155 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2 *Except* 1-4: 2x6 SPF 2100F 1.8E, 4-8: 2x4 SPF 1650F 1.5E	TOP CHORD Structural wood sheathing directly applied or 4-1-5 oc purlins, except 2-0-0 oc purlins (4-6-10 max.): 4-10.
BOT CHORD 2x4 SPF No.2 *Except* 3-19: 2x4 SP 2400F 2.0E	BOT CHORD Rigid ceiling directly applied or 2-11-9 oc bracing.
WEBS 2x4 SPF No.2 *Except* 4-20,6-20: 2x4 SPF 1650F 1.5E	
OTHERS 2x6 SPF 2100F 1.8E	SUPPLEMENTARY BEARING PLATES, SPECIAL ANCHORAGE, OR OTHER MEANS TO ALLOW FOR THE MINIMUM REQUIRED SUPPORT WIDTH (SUCH AS COLUMN CAPS, BEARING BLOCKS, ETC.) ARE THE RESPONSIBILITY OF THE TRUSS MANUFACTURER OR THE BUILDING DESIGNER.
LBR SCAB 1-4 2x6 SPF 2100F 1.8E one side	
WEDGE	
Left: 2x4 SPF No.2	
SLIDER Right 2x6 SPF No.2 2-0-0	

REACTIONS. (size) 2=0-3-8, 17=0-3-8 (req. 0-6-12), 12=0-3-8
 Max Horz 2=44(LC 8)
 Max Uplift 2=-342(LC 4), 17=-877(LC 4), 12=-220(LC 5)
 Max Grav 2=1423(LC 1), 17=4297(LC 1), 12=892(LC 22)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 3-24=-559/161, 3-4=-3574/811, 4-5=-1970/507, 5-6=-1970/507, 6-7=-551/2829, 10-12=-1243/256
 BOT CHORD 3-22=-122/573, 3-21=-767/3520, 20-21=-759/3460, 19-20=-2681/568, 6-19=-1815/451, 15-17=-3246/715, 14-15=-167/1100, 12-14=-168/1129
 WEBS 4-21=-84/611, 4-20=-1569/326, 5-20=-648/237, 6-20=-1059/4823, 17-19=-3447/779, 7-19=-129/539, 7-17=-2401/567, 7-15=-667/3469, 9-15=-722/269, 10-15=-1336/277, 10-14=-28/530

- NOTES-**
- Attached 8-7-0 scab 1 to 4, front face(s) 2x6 SPF 2100F 1.8E with 2 row(s) of 10d (0.131"x3") nails spaced 9" o.c. except : starting at 0-5-6 from end at joint 1, nail 2 row(s) at 4" o.c. for 4-3-2.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - WARNING: Required bearing size at joint(s) 17 greater than input bearing size.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=342, 17=877, 12=220.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and conform to standard ANSI/TPI 1.



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job 3542878	Truss A01	Truss Type Hip Girder	Qty 1	Ply 1	Summit/186 Highland Meadows I58813596 Job Reference (optional)
----------------	--------------	--------------------------	----------	----------	--

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:19 2023 Page 2
ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

NOTES-

- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 10) Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent spaced at 2-0-8 oc max. starting at 2-1-12 from the left end to 4-2-4 to connect truss(es) to back face of bottom chord.
- 11) Fill all nail holes where hanger is in contact with lumber.
- 12) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 13) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 250 lb down and 78 lb up at 6-2-4, 78 lb down and 23 lb up at 8-2-4, 78 lb down and 23 lb up at 10-2-4, 78 lb down and 23 lb up at 12-2-4, 78 lb down and 23 lb up at 14-2-4, and 78 lb down and 23 lb up at 16-2-4, and 410 lb down and 109 lb up at 28-2-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 14) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-3=-70, 3-4=-70, 4-10=-70, 10-13=-70, 22-23=-20, 3-19=-20, 18-26=-20

Concentrated Loads (lb)

Vert: 22=-256(B) 21=-250 10=-133(B) 14=-410(B) 32=-117(B) 33=-117(B) 34=-117(B) 35=-117(B) 36=-117(B) 37=-133(B) 38=-133(B) 39=-133(B) 40=-133(B) 41=-133(B) 42=-261(B) 43=-78 44=-78 45=-78 46=-78 47=-78 48=-62(B) 49=-62(B) 50=-62(B) 51=-62(B) 52=-62(B)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017



Job 3542878	Truss A03	Truss Type Roof Special	Qty 1	Ply 1	Summit/186 Highland Meadows I58813598
----------------	--------------	----------------------------	----------	----------	--

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:22 2023 Page 1

ID:0efadeDmNQqjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale: 3/16"=1'

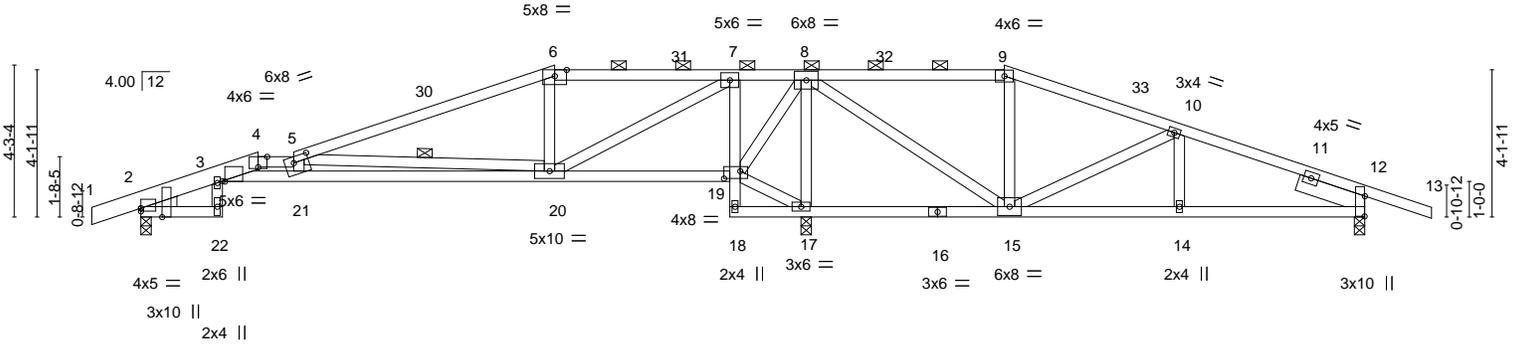

LOADING (psf)	SPACING	2-0-0	CSI	DEFL. in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.80	Vert(LL) -0.29 20-21	>783	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.71	Vert(CT) -0.53 20-21	>425	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.54	Horz(CT) 0.15 17	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					
							Weight: 146 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2 *Except*
1-4: 2x6 SPF No.2
BOT CHORD 2x4 SPF No.2 *Except*
16-18: 2x4 SP 2400F 2.0E
WEBS 2x4 SPF No.2
WEDGE
Left: 2x4 SPF No.2
SLIDER Right 2x6 SPF No.2 2-0-0

BRACING-

TOP CHORD Structural wood sheathing directly applied, except
2-0-0 oc purlins (4-4-3 max.): 4-5, 6-9.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 5-20

REACTIONS.

(size) 2=0-3-8, 17=0-3-8, 12=0-3-8
Max Horz 2=66(LC 12)
Max Uplift 2=-123(LC 8), 17=-410(LC 8), 12=-173(LC 9)
Max Grav 2=505(LC 25), 17=2526(LC 1), 12=525(LC 26)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 3-4=-1723/332, 4-5=-1763/354, 5-6=-115/533, 6-7=-53/427, 7-8=-335/2136,
8-9=-154/884, 9-10=-189/959, 10-12=-351/568
BOT CHORD 3-21=-341/1766, 20-21=-312/1759, 19-20=-2117/482, 7-19=-1101/222, 15-17=-2122/453,
14-15=-507/369, 12-14=-507/369
WEBS 5-20=-2119/433, 6-20=-627/199, 7-20=-370/1941, 17-19=-2289/503, 8-17=-1286/254,
8-15=-303/1727, 9-15=-575/161, 10-15=-702/157

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 2-1-12, Interior(1) 2-1-12 to 3-3-8, Exterior(2E) 3-3-8 to 4-3-8, Interior(1) 4-3-8 to 11-7-8, Exterior(2R) 11-7-8 to 15-0-12, Interior(1) 15-0-12 to 24-3-0, Exterior(2R) 24-3-0 to 27-8-4, Interior(1) 27-8-4 to 36-3-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=123, 17=410, 12=173.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job	Truss	Truss Type	Qty	Ply	Summit/186 Highland Meadows	158813599
3542878	A04	Roof Special Girder	1	1		

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:24 2023 Page 1

ID:0efadeDmNqQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale: 3/16"=1'


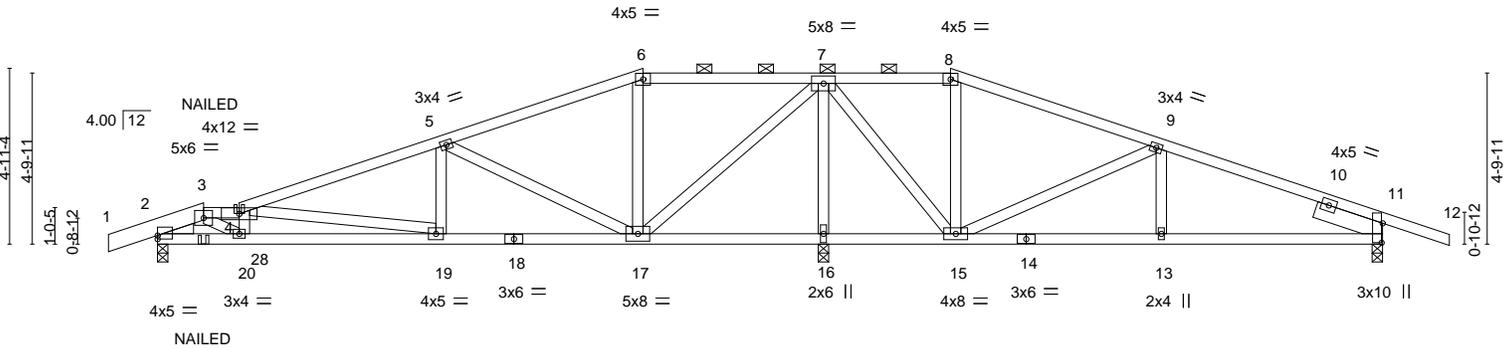


Plate Offsets (X,Y)--	[2:0-0-0,0-1-4], [11:0-6-9,0-0-6]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.50	Vert(LL) -0.07 19-20 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.55	Vert(CT) -0.13 19-20 >999 180		
BCLL 0.0	Rep Stress Incr NO	WB 0.70	Horz(CT) 0.02 16 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-MS		Weight: 146 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SPF No.2 *Except*
1-3: 2x6 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
WEDGE
Left: 2x4 SP No.3
SLIDER Right 2x6 SPF No.2 2-0-0

BRACING-
TOP CHORD Structural wood sheathing directly applied or 5-1-1 oc purlins, except 2-0-0 oc purlins (4-6-8 max.): 3-4, 6-8.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 16-17,15-16.

REACTIONS. (size) 2=0-3-8, 16=0-3-8, 11=0-3-8
Max Horz 2=77(LC 8)
Max Uplift 2=190(LC 4), 16=284(LC 4), 11=180(LC 33)
Max Grav 2=736(LC 21), 16=2009(LC 1), 11=662(LC 29)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1004/186, 3-4=-1622/312, 4-5=-1100/221, 5-6=-285/105, 7-8=-10/276,
8-9=-41/312, 9-11=-617/195
BOT CHORD 2-20=-218/870, 19-20=-331/1536, 17-19=-197/989, 16-17=-852/165, 15-16=-852/165,
13-15=-114/629, 11-13=-114/629
WEBS 3-20=-179/895, 4-20=-488/149, 4-19=-560/135, 5-19=0/303, 5-17=-883/216,
6-17=-313/89, 7-17=-204/1227, 7-16=-1906/315, 7-15=-142/995, 8-15=-365/80,
9-15=-768/172

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=190, 16=284, 11=180.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 8) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard



June 9, 2023

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job 3542878	Truss A04	Truss Type Roof Special Girder	Qty 1	Ply 1	Summit/186 Highland Meadows I58813599 Job Reference (optional)
----------------	--------------	-----------------------------------	----------	----------	--

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:24 2023 Page 2
ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-3=-70, 3-4=-70, 4-6=-70, 6-8=-70, 8-12=-70, 21-24=-20
 Concentrated Loads (lb)
 Vert: 28=36(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 3542878	Truss A05	Truss Type HIP	Qty 1	Ply 1	Summit/186 Highland Meadows 158813600
----------------	--------------	-------------------	----------	----------	--

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:26 2023 Page 1

ID:0efadeDmNQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f



Scale = 1:62.7

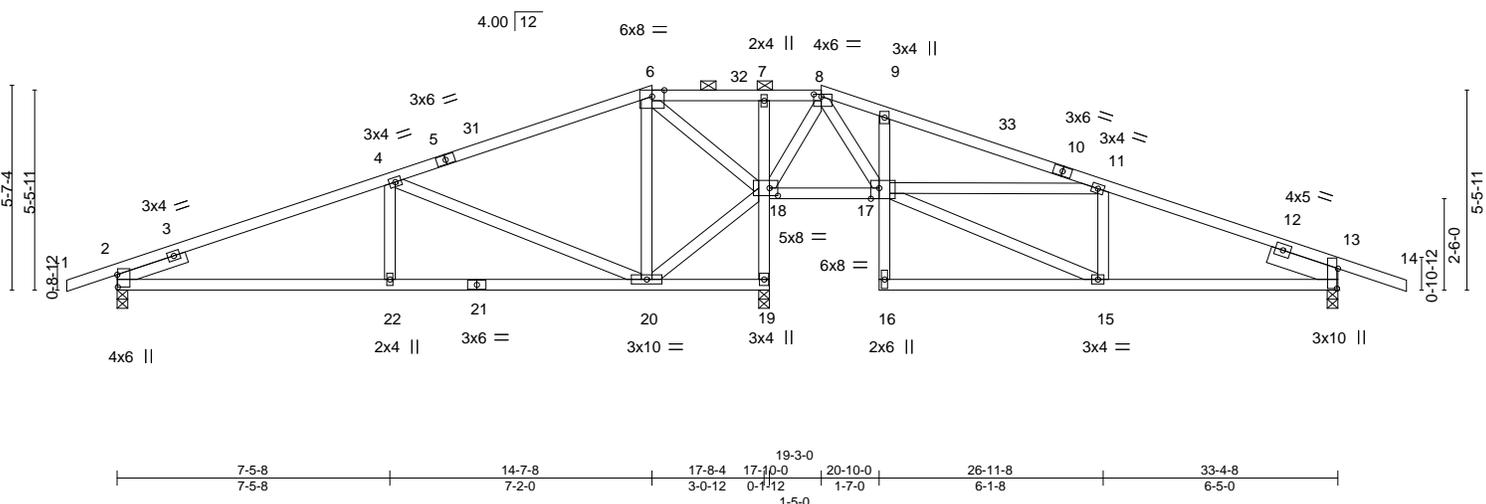


Plate Offsets (X, Y)-- [2:0-4-1,0-0-3], [8:0-2-8,0-0-12], [13:0-6-9,0-0-6], [17:0-2-12,Edge], [18:0-2-12,0-2-8]

LOADING (psf)	SPACING - 2-0-0	CSI	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.47	Vert(LL) -0.05 20-22 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.41	Vert(CT) -0.11 20-22 >999 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.97	Horz(CT) 0.02 19 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS		Weight: 147 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except
BOT CHORD 2x4 SPF No.2	2-0-0 oc purlins (10-0-0 max.): 6-8.
WEBS 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
SLIDER Left 2x4 SPF No.2 2-0-0, Right 2x6 SPF No.2 2-0-0	

REACTIONS. (size) 2=0-3-8, 19=0-3-8, 13=0-3-8
 Max Horz 2=-84(LC 17)
 Max Uplift 2=-185(LC 8), 19=-209(LC 8), 13=-196(LC 9)
 Max Grav 2=813(LC 25), 19=1763(LC 1), 13=726(LC 26)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-1080/260, 4-6=-303/137, 6-7=-64/822, 7-8=-64/815, 9-11=-313/138, 11-13=-840/217
 BOT CHORD 2-22=-246/1083, 20-22=-246/1083, 18-19=-1751/323, 17-18=-394/198, 9-17=-323/149, 13-15=-132/750
 WEBS 4-22=0/293, 4-20=-970/229, 6-20=-72/429, 18-20=-67/263, 6-18=-1187/301, 8-18=-847/168, 15-17=-149/791, 11-17=-599/168, 8-17=-194/853

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 1-11-9, Interior(1) 1-11-9 to 14-7-8, Exterior(2E) 14-7-8 to 19-3-0, Exterior(2R) 19-3-0 to 23-11-11, Interior(1) 23-11-11 to 35-3-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=185, 19=209, 13=196.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 3542878	Truss A07	Truss Type HIP	Qty 1	Ply 1	Summit/186 Highland Meadows I58813602
----------------	--------------	-------------------	----------	----------	--

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:29 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?#f



Scale = 1:61.6

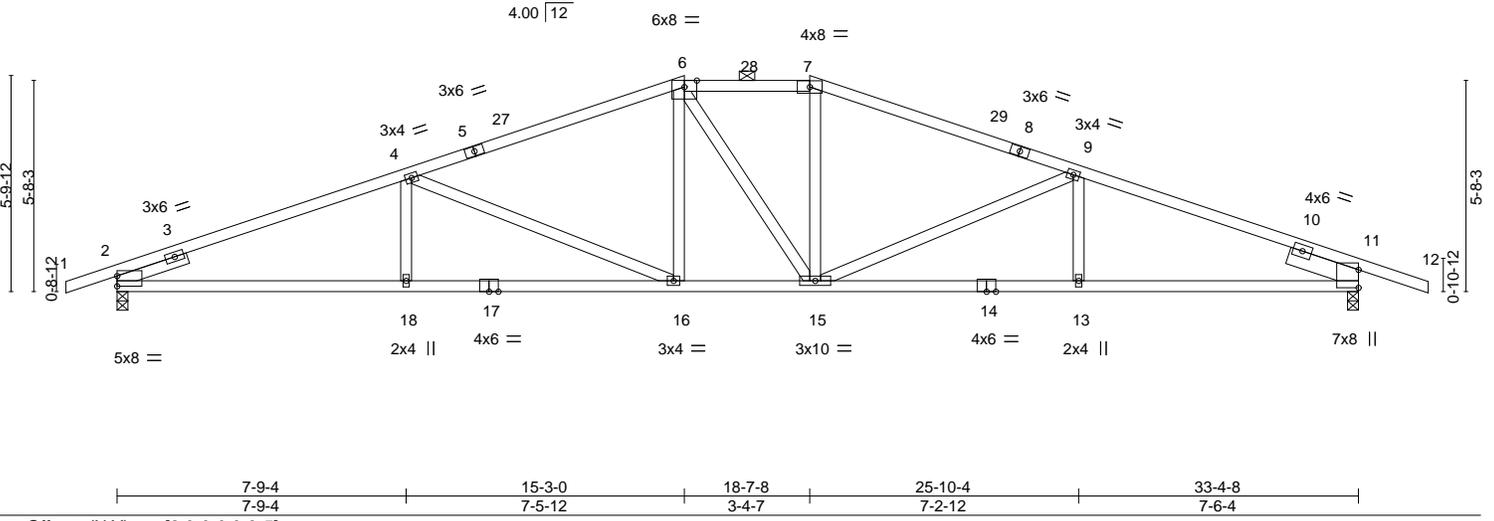


Plate Offsets (X,Y)--	[2:0-0-0,0-3-5]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.95	Vert(LL) -0.26 13-15 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.84	Vert(CT) -0.51 13-15 >792 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.86	Horz(CT) 0.14 11 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS		Weight: 150 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2 *Except* 1-5,8-12: 2x4 SP 2400F 2.0E	TOP CHORD Structural wood sheathing directly applied, except 2-0-0 oc purlins (3-6-0 max.): 6-7.
BOT CHORD 2x4 SP 2400F 2.0E	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	
SLIDER Left 2x4 SPF No.2 2-0-0, Right 2x6 SPF No.2 2-0-0	

REACTIONS. (size) 2=0-3-8, 11=0-3-8
 Max Horz 2=88(LC 12)
 Max Uplift 2=-279(LC 8), 11=-296(LC 9)
 Max Grav 2=1596(LC 1), 11=1635(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-3234/636, 4-6=-2525/550, 6-7=-2301/540, 7-9=-2506/541, 9-11=-3028/578
 BOT CHORD 2-18=-520/2993, 16-18=-520/2993, 15-16=-350/2311, 13-15=-466/2783, 11-13=-466/2783
 WEBS 4-18=0/258, 4-16=-783/220, 6-16=-40/418, 6-15=-254/227, 7-15=-40/382,
 9-15=-595/189

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 1-11-9, Interior(1) 1-11-9 to 15-3-0, Exterior(2E) 15-3-0 to 18-7-8, Exterior(2R) 18-7-8 to 23-4-2, Interior(1) 23-4-2 to 35-3-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=279, 11=296.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




June 9, 2023

Job	Truss	Truss Type	Qty	Ply	Summit/186 Highland Meadows	158813603
3542878	A08	Roof Special Girder	1	1		

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:30 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:63.3

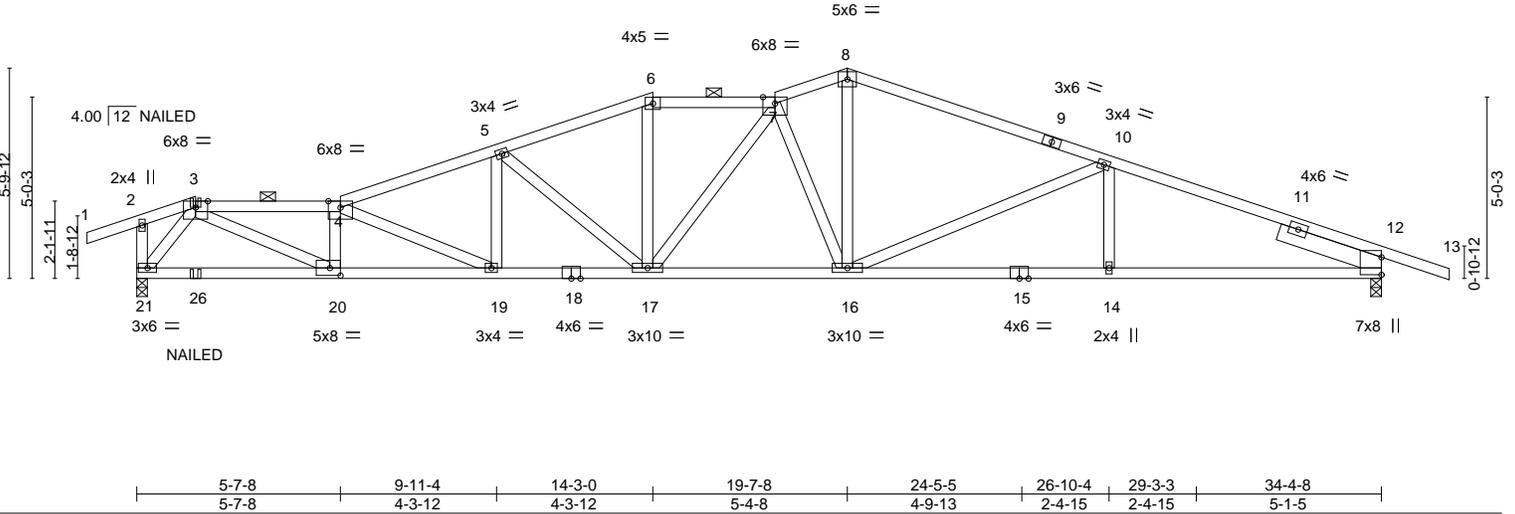


Plate Offsets (X,Y)--	[20:0-3-8,0-2-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.89	Vert(LL) -0.27 14-16 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 1.00	Vert(CT) -0.52 14-16 >788 180		
BCLL 0.0	Rep Stress Incr NO	WB 0.72	Horz(CT) 0.15 12 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-MS		Weight: 163 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2 *Except* 8-9,9-13: 2x4 SP 2400F 2.0E	TOP CHORD Structural wood sheathing directly applied or 2-10-6 oc purlins, except end verticals, and 2-0-0 oc purlins (2-8-7 max.): 3-4, 6-7.
BOT CHORD 2x4 SP 2400F 2.0E *Except* 18-21: 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 7-11-10 oc bracing.
WEBS 2x4 SPF No.2	
SLIDER Right 2x6 SPF No.2 3-0-0	

REACTIONS. (size) 21=0-3-8, 12=0-3-8
 Max Horz 21=-88(LC 13)
 Max Uplift 21=-298(LC 4), 12=-272(LC 5)
 Max Grav 21=1611(LC 1), 12=1671(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 3-4=-3570/540, 4-5=-3391/516, 5-6=-2854/445, 6-7=-2654/438, 7-8=-2522/379,
 8-10=-2581/373, 10-12=-3107/395
 BOT CHORD 20-21=-196/1084, 19-20=-554/3658, 17-19=-451/3162, 16-17=-317/2728,
 14-16=-279/2874, 12-14=-279/2874
 WEBS 3-20=-401/2782, 4-20=-1152/224, 4-19=-546/115, 5-19=-13/325, 5-17=-649/158,
 6-17=-44/576, 7-16=-921/213, 8-16=-160/1230, 3-21=-1727/261, 10-16=-666/204

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 21=298, 12=272.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 8) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-70, 2-3=-70, 3-4=-70, 4-6=-70, 6-7=-70, 7-8=-70, 8-13=-70, 21-22=-20



June 9, 2023

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job 3542878	Truss A08	Truss Type Roof Special Girder	Qty 1	Ply 1	Summit/186 Highland Meadows Job Reference (optional)	I58813603
----------------	--------------	-----------------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:31 2023 Page 2
ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 3=36(B)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job 3542878	Truss A09	Truss Type Roof Special	Qty 1	Ply 1	Summit/186 Highland Meadows 158813604
----------------	--------------	----------------------------	----------	----------	--

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:32 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:65.5

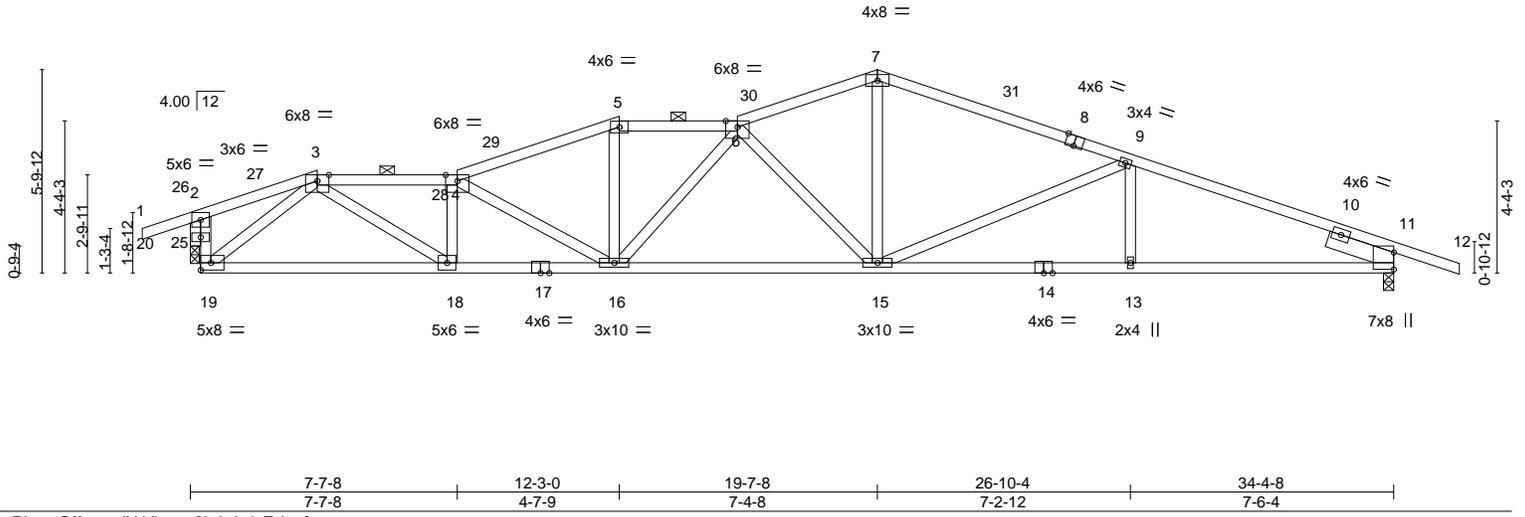


Plate Offsets (X, Y)-- [8:0-3-0,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 1.00	Vert(LL)	-0.30	13-15	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.87	Vert(CT)	-0.55	13-15	>746		
BCLL 0.0	Rep Stress Incr	YES	WB 0.70	Horz(CT)	0.14	11	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 154 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SPF No.2 *Except*
 8-12: 2x4 SP 2400F 2.0E
BOT CHORD 2x4 SP 2400F 2.0E *Except*
 17-19: 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2
SLIDER Right 2x6 SPF No.2 2-0-0

BRACING-
TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (2-10-2 max.): 3-4, 5-6.
BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 11=0-3-8, 25=0-3-0
 Max Horz 25=-97(LC 13)
 Max Uplift 11=-272(LC 9), 25=-299(LC 8)
 Max Grav 11=1674(LC 1), 25=1639(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-419/110, 3-4=-3452/688, 4-5=-3164/639, 5-6=-2932/628, 6-7=-2555/546,
 7-9=-2597/541, 9-11=-3122/586, 19-20=-214/1277, 2-20=-214/1277
BOT CHORD 18-19=-328/1847, 16-18=-613/3507, 15-16=-524/3143, 13-15=-473/2872,
 11-13=-473/2872
WEBS 3-18=-327/1929, 4-18=-968/234, 4-16=-645/155, 5-16=-92/675, 6-16=-326/87,
 6-15=-1076/275, 7-15=-187/1173, 9-15=-652/205, 3-19=-1904/384, 2-25=-1726/390

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 2-0-12, Interior(1) 2-0-12 to 3-7-8, Exterior(2R) 3-7-8 to 7-0-12, Interior(1) 7-0-12 to 12-3-0, Exterior(2E) 12-3-0 to 15-7-8, Interior(1) 15-7-8 to 19-7-8, Exterior(2R) 19-7-8 to 23-0-12, Interior(1) 23-0-12 to 36-3-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Bearing at joint(s) 25 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=272, 25=299.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 9, 2023


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 <p>16023 Swingley Ridge Rd Chesterfield, MO 63017</p>
--	---

Job 3542878	Truss A10	Truss Type Roof Special	Qty 1	Ply 1	Summit/186 Highland Meadows 158813605
----------------	--------------	----------------------------	----------	----------	--


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:34 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f



Scale = 1:65.5

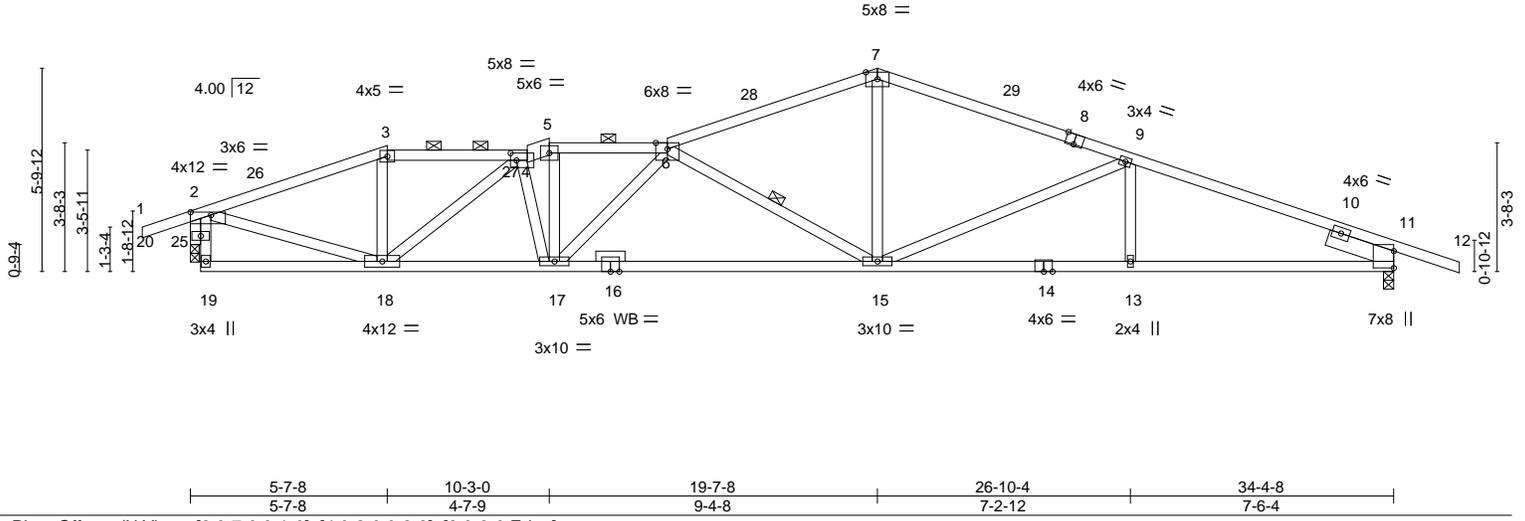

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.99	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.87	Vert(LL) -0.29 13-15 >999 240		
BCLL 0.0	Lumber DOL 1.15	WB 0.69	Vert(CT) -0.53 15-17 >770 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.13 11 n/a n/a		
	Code IRC2018/TPI2014			Weight: 159 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2 *Except*	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (3-1-5 max.): 3-4, 5-6.
4-5: 2x6 SPF No.2, 8-12: 2x4 SP 2400F 2.0E	
BOT CHORD 2x4 SP 2400F 2.0E	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	WEBS 1 Row at midpt 6-15
OTHERS 2x4 SPF No.2	
SLIDER Right 2x6 SPF No.2 2-0-0	

REACTIONS. (size) 11=0-3-8, 25=0-3-0
 Max Horz 25=-97(LC 13)
 Max Uplift 11=-272(LC 9), 25=-299(LC 8)
 Max Grav 11=1674(LC 1), 25=1639(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-2343/474, 3-4=-2158/467, 4-5=-3397/684, 5-6=-3278/659, 6-7=-2602/543, 7-9=-2607/532, 9-11=-3118/589
 BOT CHORD 18-19=-102/422, 17-18=-557/3311, 15-17=-630/3626, 13-15=-476/2867, 11-13=-476/2867
 WEBS 3-18=-29/401, 5-17=-161/811, 6-17=-512/146, 6-15=-1409/332, 7-15=-156/1115, 9-15=-646/208, 2-18=-314/1836, 4-18=-1455/263, 4-17=-326/129, 2-25=-1742/394

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 2-0-12, Interior(1) 2-0-12 to 5-7-8, Exterior(2R) 5-7-8 to 9-0-12, Interior(1) 9-0-12 to 10-3-0, Exterior(2E) 10-3-0 to 13-7-8, Interior(1) 13-7-8 to 19-7-8, Exterior(2R) 19-7-8 to 23-0-12, Interior(1) 23-0-12 to 36-3-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Bearing at joint(s) 25 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=272, 25=299.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 9, 2023

Job 3542878	Truss A11	Truss Type Roof Special	Qty 1	Ply 1	Summit/186 Highland Meadows 158813606
----------------	--------------	----------------------------	----------	----------	--

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:35 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f



Scale: 3/16"=1'

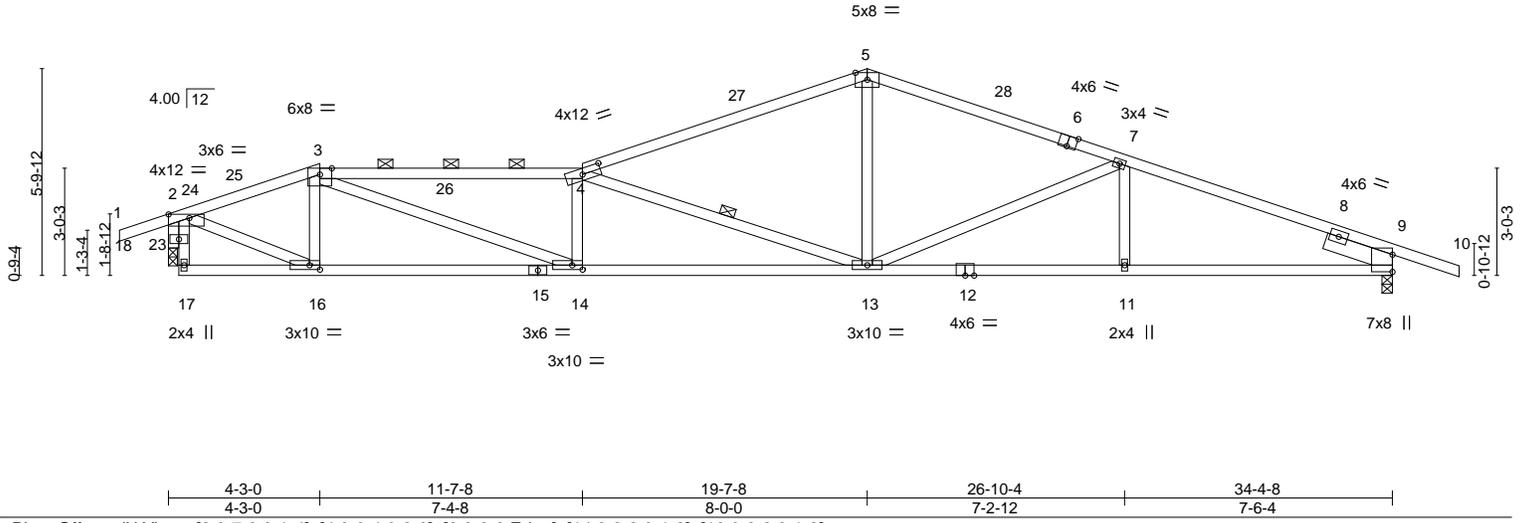


Plate Offsets (X,Y)-- [2:0-7-0,0-1-4], [4:0-6-4,0-2-0], [6:0-3-0,Edge], [14:0-3-8,0-1-8], [16:0-3-8,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.90	Vert(LL)	-0.31 13-14	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.86	Vert(CT)	-0.58 13-14	>703	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.70	Horz(CT)	0.13 9	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 150 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2 *Except* 3-4,6-10: 2x4 SP 2400F 2.0E, 4-5: 2x4 SPF 1650F 1.5E	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (2-10-4 max.): 3-4.
BOT CHORD 2x4 SP 2400F 2.0E *Except* 15-17: 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	WEBS 1 Row at midpt 4-13
OTHERS 2x4 SPF No.2	
SLIDER Right 2x6 SPF No.2 2-0-0	

REACTIONS. (size) 9=0-3-8, 23=0-3-0
 Max Horz 23=-97(LC 13)
 Max Uplift 9=-273(LC 9), 23=-299(LC 8)
 Max Grav 9=1674(LC 1), 23=1639(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-2164/423, 3-4=-4265/808, 4-5=-2637/530, 5-7=-2596/525, 7-9=-3115/575
 BOT CHORD 16-17=-76/306, 14-16=-326/2068, 13-14=-715/4302, 11-13=-462/2864, 9-11=-462/2864
 WEBS 3-16=-623/175, 3-14=-404/2354, 4-14=-707/219, 4-13=-2002/401, 5-13=-129/1055,
 7-13=-649/202, 2-16=-319/1882, 2-23=-1720/381

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 2-0-12, Interior(1) 2-0-12 to 4-3-0, Exterior(2R) 4-3-0 to 7-8-4, Interior(1) 7-8-4 to 19-7-8, Exterior(2R) 19-7-8 to 23-0-12, Interior(1) 23-0-12 to 36-3-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Bearing at joint(s) 23 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 9=273, 23=299.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




June 9,2023

Job 3542878	Truss A12	Truss Type Roof Special Girder	Qty 1	Ply 1	Summit/186 Highland Meadows 158813607
----------------	--------------	-----------------------------------	----------	----------	--

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:37 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f



Scale = 1:62.3

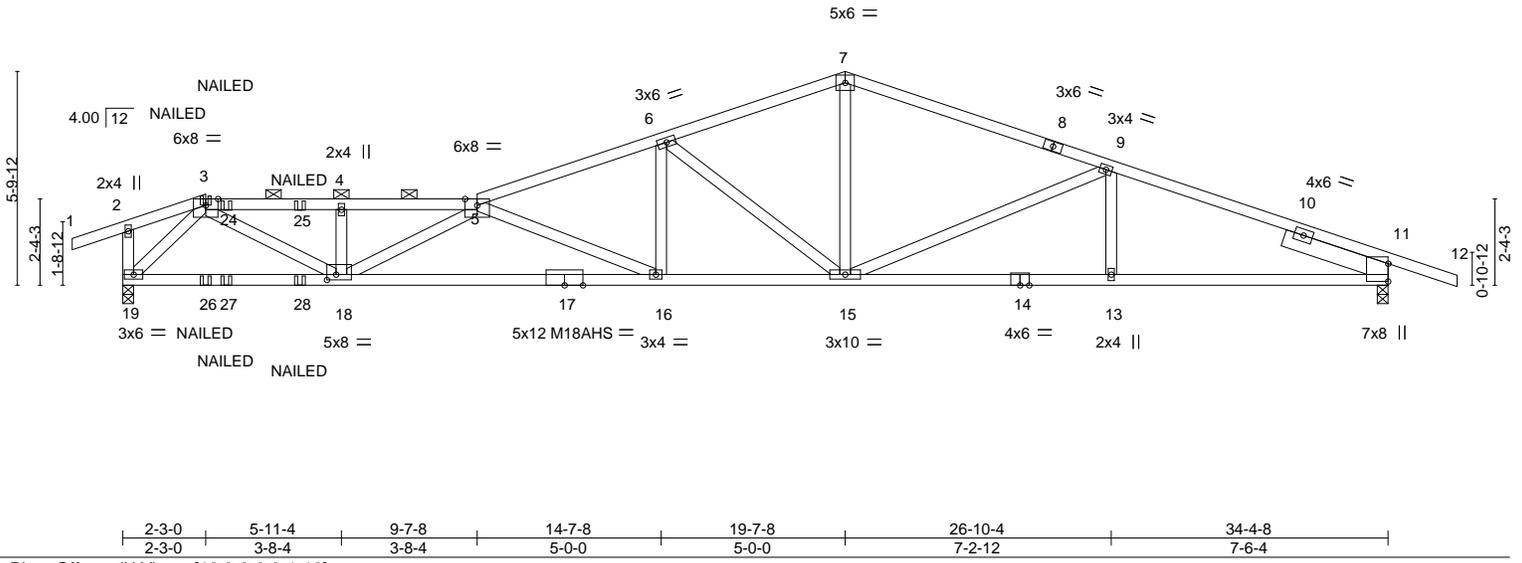


Plate Offsets (X,Y)--	[18:0-3-0-0-1-12]						
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.89	Vert(LL)	-0.32	16-18	>999
TCDL 10.0	Lumber DOL	1.15	BC 0.89	Vert(CT)	-0.64	16-18	>641
BCLL 0.0	Rep Stress Incr	NO	WB 0.90	Horz(CT)	0.15	11	n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS				
							PLATES
							MT20
							M18AHS
							Weight: 158 lb
							FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2 *Except* 7-8,8-12: 2x4 SP 2400F 2.0E	TOP CHORD Structural wood sheathing directly applied or 2-5-7 oc purlins, except end verticals, and 2-0-0 oc purlins (2-9-7 max.): 3-5.
BOT CHORD 2x4 SP 2400F 2.0E	BOT CHORD Rigid ceiling directly applied or 9-1-12 oc bracing.
WEBS 2x4 SPF No.2	
SLIDER Right 2x6 SPF No.2 3-0-0	

REACTIONS. (size) 11=0-3-8, 19=0-3-8
 Max Horz 19=88(LC 34)
 Max Uplift 11=281(LC 5), 19=364(LC 4)
 Max Grav 11=1674(LC 1), 19=1657(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 3-4=-3640/641, 4-5=-3640/641, 5-6=-3628/551, 6-7=-2561/393, 7-9=-2583/396, 9-11=-3116/418
 BOT CHORD 18-19=-286/1407, 16-18=-827/4925, 15-16=-473/3381, 13-15=-301/2882, 11-13=-301/2882
 WEBS 3-18=-414/2571, 4-18=-384/118, 5-16=-1676/385, 6-16=-83/780, 6-15=-1266/272, 7-15=-141/1146, 9-15=-677/210, 5-18=-1484/308, 3-19=-1955/338

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) All plates are MT20 plates unless otherwise indicated.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=281, 19=364.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 9) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 10) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-70, 2-3=-70, 3-5=-70, 5-7=-70, 7-12=-70, 19-20=-20



June 9, 2023

Continued on page 2

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 <p>16023 Swingley Ridge Rd Chesterfield, MO 63017</p>
--	---

Job 3542878	Truss A12	Truss Type Roof Special Girder	Qty 1	Ply 1	Summit/186 Highland Meadows Job Reference (optional)	158813607
----------------	--------------	-----------------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:37 2023 Page 2
ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

LOAD CASE(S) Standard

Concentrated Loads (lb)

Vert: 26=-4(F) 27=-4(F) 28=-4(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/186 Highland Meadows	158813608
3542878	A13	Common	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:38 2023 Page 1

ID:0efadeDmNQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnl8w3ulTXbGKwrcDoi7J4zJC?f



Scale = 1:50.9

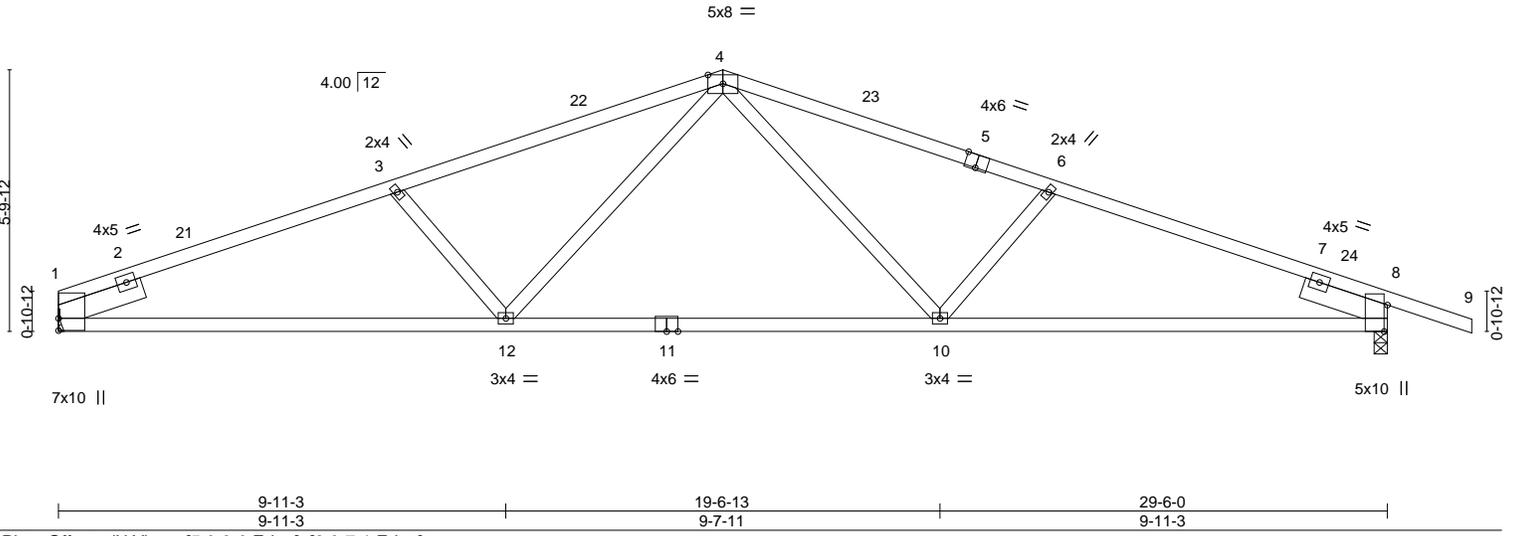


Plate Offsets (X,Y)--	[5:0-3-0,Edge], [8:0-7-1,Edge]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.97	Vert(LL) -0.33 10-12 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.80	Vert(CT) -0.66 10-12 >538 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.16	Horz(CT) 0.13 8 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS		Weight: 108 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF 1650F 1.5E *Except*
 4-5: 2x4 SPF No.2, 5-9: 2x4 SP 2400F 2.0E
 BOT CHORD 2x4 SPF 1650F 1.5E
 WEBS 2x4 SPF No.2
 SLIDER Left 2x6 SPF No.2 2-0-0, Right 2x6 SPF No.2 2-0-0

BRACING-
 TOP CHORD Structural wood sheathing directly applied.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 1=Mechanical, 8=0-3-8
 Max Horz 1=-97(LC 17)
 Max Uplift 1=-190(LC 8), 8=-262(LC 9)
 Max Grav 1=1323(LC 1), 8=1463(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-3=-2634/497, 3-4=-2375/465, 4-6=-2364/460, 6-8=-2617/494
 BOT CHORD 1-12=-380/2417, 10-12=-235/1792, 8-10=-385/2396
 WEBS 4-10=-99/653, 6-10=-415/204, 4-12=-102/668, 3-12=-429/206

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 14-9-0, Exterior(2R) 14-9-0 to 17-9-0, Interior(1) 17-9-0 to 31-4-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to bearing connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=190, 8=262.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.




June 9, 2023

Job 3542878	Truss A14	Truss Type Common	Qty 1	Ply 1	Summit/186 Highland Meadows Job Reference (optional)	158813609
----------------	--------------	----------------------	----------	----------	---	-----------


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:40 2023 Page 1

ID:0efadeDmNQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f



Scale = 1:53.3

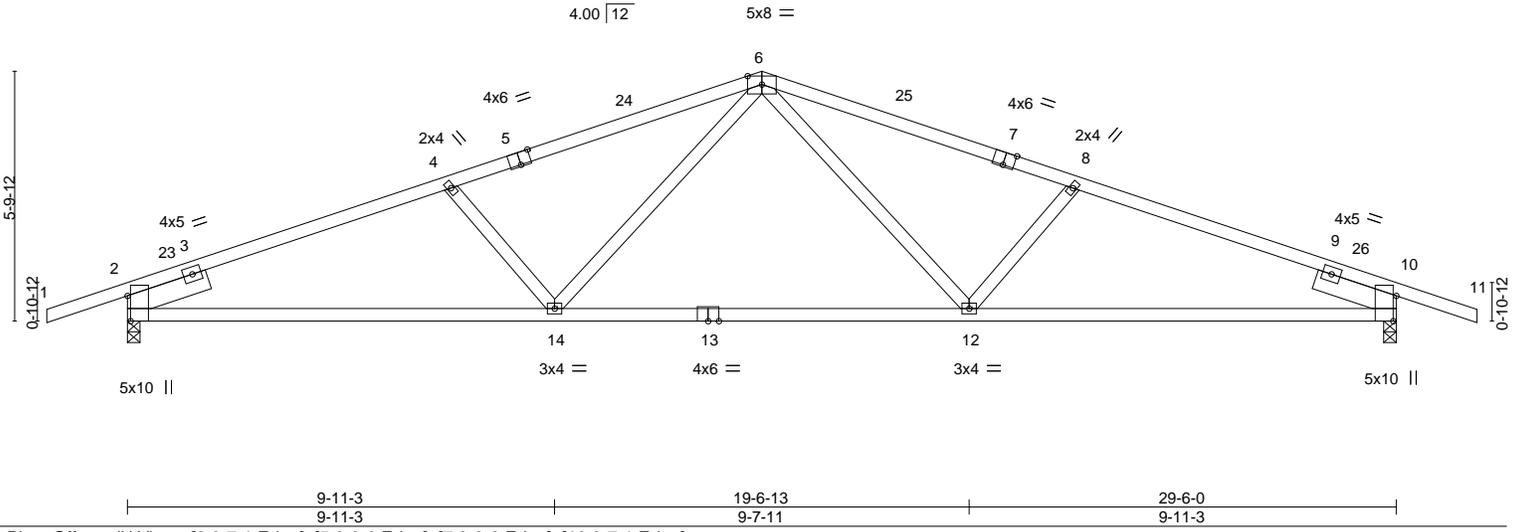

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.87	Vert(LL)	-0.32	12-14	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.80	Vert(CT)	-0.65	12-14	>548		
BCLL 0.0	Rep Stress Incr	YES	WB 0.16	Horz(CT)	0.13	10	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 114 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2 *Except*
 1-5,7-11: 2x4 SP 2400F 2.0E
 BOT CHORD 2x4 SPF 1650F 1.5E
 WEBS 2x4 SPF No.2
 SLIDER Left 2x6 SPF No.2 2-0-0, Right 2x6 SPF No.2 2-0-0

BRACING-
 TOP CHORD Structural wood sheathing directly applied.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 2=0-3-8, 10=0-3-8
 Max Horz 2=-88(LC 13)
 Max Uplift 2=-261(LC 8), 10=-261(LC 9)
 Max Grav 2=1459(LC 1), 10=1459(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-2606/486, 4-6=-2353/452, 6-8=-2353/452, 8-10=-2606/486
 BOT CHORD 2-14=-366/2386, 12-14=-227/1781, 10-12=-378/2386
 WEBS 6-12=-99/653, 8-12=-416/205, 6-14=-99/653, 4-14=-416/204

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 14-9-0, Exterior(2R) 14-9-0 to 17-9-0, Interior(1) 17-9-0 to 31-4-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=261, 10=261.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 9, 2023


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job 3542878	Truss A15	Truss Type Hip	Qty 1	Ply 1	Summit/186 Highland Meadows 158813610
----------------	--------------	-------------------	----------	----------	--

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:41 2023 Page 1
 ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f



Scale = 1:55.0


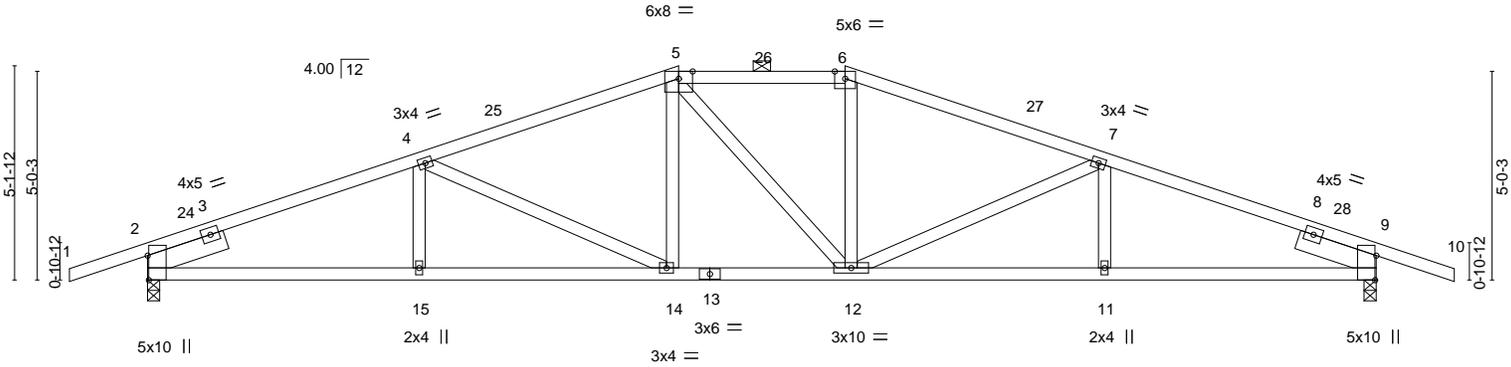


Plate Offsets (X,Y)-- [2:0-7-1,Edge], [9:0-7-1,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.87	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.75	Vert(LL) -0.22 11-12 >999 240		
BCLL 0.0	Lumber DOL 1.15	WB 0.32	Vert(CT) -0.41 14-15 >871 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.10 9 n/a n/a		
	Code IRC2018/TPI2014			Weight: 128 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF 1650F 1.5E *Except*
 5-6: 2x4 SPF No.2
 BOT CHORD 2x4 SP 2400F 2.0E
 WEBS 2x4 SPF No.2
 SLIDER Left 2x6 SPF No.2 2-0-0, Right 2x6 SPF No.2 2-0-0

BRACING-

TOP CHORD Structural wood sheathing directly applied, except
 2-0-0 oc purlins (3-10-9 max.): 5-6.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS.

(size) 2=0-3-8, 9=0-3-8
 Max Horz 2=-76(LC 13)
 Max Uplift 2=-274(LC 8), 9=-274(LC 9)
 Max Grav 2=1459(LC 1), 9=1459(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-2569/521, 4-5=-2191/493, 5-6=-2031/483, 6-7=-2191/482, 7-9=-2568/493
 BOT CHORD 2-15=-409/2359, 14-15=-409/2359, 12-14=-316/2031, 11-12=-393/2358, 9-11=-393/2358
 WEBS 4-14=-418/148, 5-14=-22/322, 6-12=-22/322, 7-12=-418/148

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 12-9-0, Exterior(2E) 12-9-0 to 16-9-0, Exterior(2R) 16-9-0 to 20-11-14, Interior(1) 20-11-14 to 31-4-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=274, 9=274.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 3542878	Truss A16	Truss Type Hip	Qty 1	Ply 1	Summit/186 Highland Meadows Job Reference (optional)	I58813611
----------------	--------------	-------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:43 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:55.0


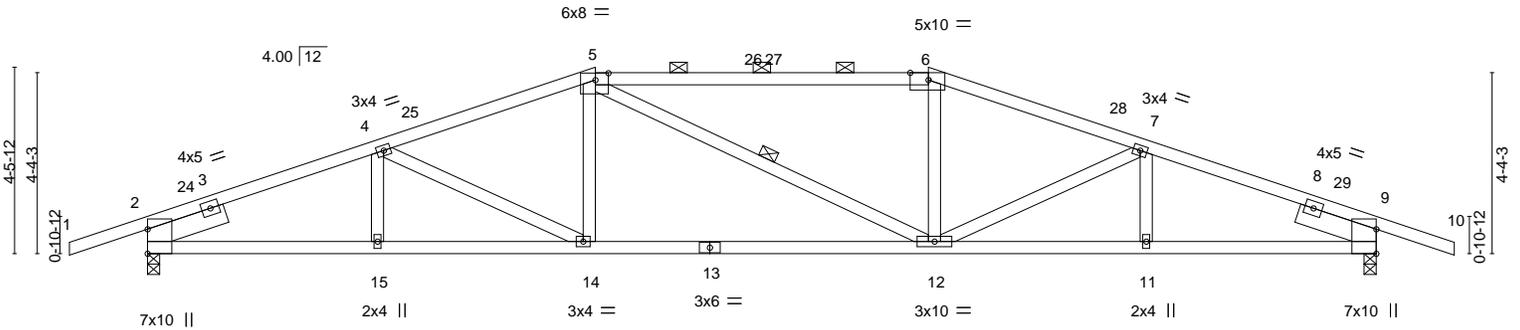


Plate Offsets (X,Y)--	[5:0-3-12,0-2-0], [6:0-5-4,Edge]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.86	Vert(LL) -0.21 14-15 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.98	Vert(CT) -0.42 12-14 >836 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.09	Horz(CT) 0.12 9 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS			
				Weight: 116 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SPF 1650F 1.5E
BOT CHORD 2x4 SPF 1650F 1.5E
WEBS 2x4 SPF No.2
SLIDER Left 2x6 SPF No.2 2-0-0, Right 2x6 SPF No.2 2-0-0

BRACING-
TOP CHORD Structural wood sheathing directly applied, except 2-0-0 oc purlins (2-2-0 max.): 5-6.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 5-12

REACTIONS. (size) 2=0-3-8, 9=0-3-8
Max Horz 2=-66(LC 13)
Max Uplift 2=-284(LC 8), 9=-284(LC 9)
Max Grav 2=1459(LC 1), 9=1459(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=-2510/511, 4-5=-2408/515, 5-6=-2265/523, 6-7=-2408/514, 7-9=-2510/511
BOT CHORD 2-15=-403/2296, 14-15=-403/2296, 12-14=-362/2265, 11-12=-412/2296, 9-11=-412/2296
WEBS 5-14=0/322, 6-12=0/322

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 10-9-0, Exterior(2R) 10-9-0 to 14-11-15, Interior(1) 14-11-15 to 18-9-0, Exterior(2R) 18-9-0 to 22-11-14, Interior(1) 22-11-14 to 31-4-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=284, 9=284.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




June 9, 2023

Job 3542878	Truss A17	Truss Type Hip	Qty 1	Ply 1	Summit/186 Highland Meadows I58813612
----------------	--------------	-------------------	----------	----------	--


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:45 2023 Page 1

ID:0efadeDmNQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f



Scale = 1:55.0

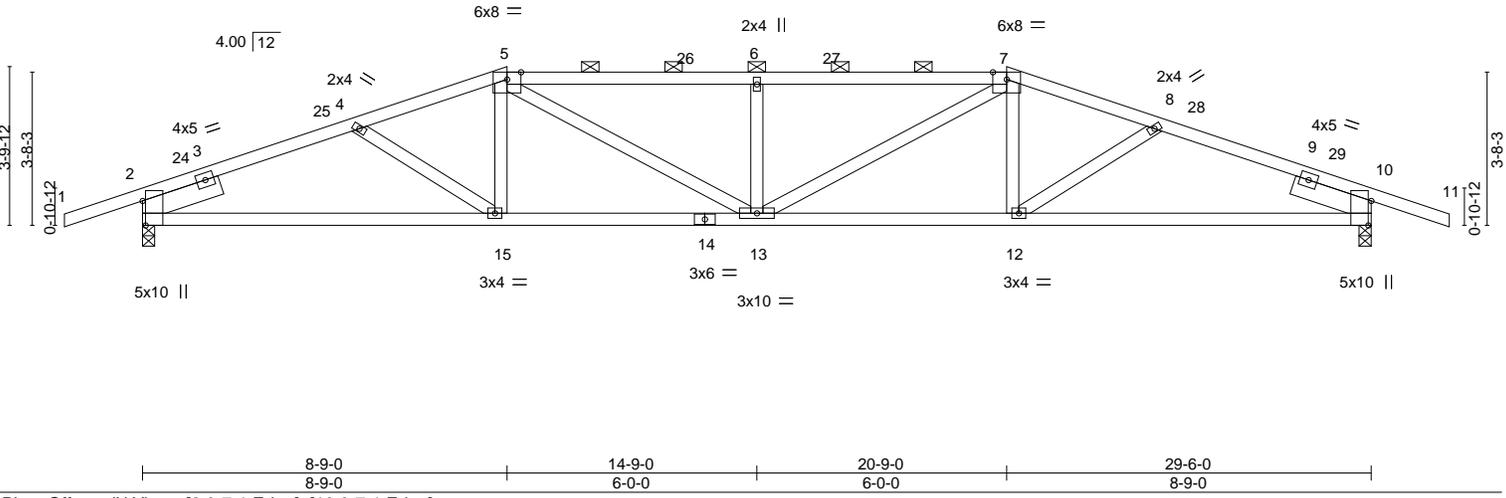

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.89	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.95	Vert(LL) -0.26 13-15 >999 240		
BCLL 0.0	Lumber DOL 1.15	WB 0.19	Vert(CT) -0.47 13-15 >760 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.12 10 n/a n/a		
	Code IRC2018/TPI2014			Weight: 115 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF 1650F 1.5E *Except*
 5-7: 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2
 SLIDER Left 2x6 SPF No.2 2-0-0, Right 2x6 SPF No.2 2-0-0

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except
 2-0-0 oc purlins (2-11-2 max.): 5-7.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 2=0-3-8, 10=0-3-8
 Max Horz 2=54(LC 12)
 Max Uplift 2=-293(LC 8), 10=-293(LC 9)
 Max Grav 2=1459(LC 1), 10=1459(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-2503/526, 4-5=-2497/507, 5-6=-2937/620, 6-7=-2937/620, 7-8=-2497/507,
 8-10=-2503/525
 BOT CHORD 2-15=-413/2276, 13-15=-373/2378, 12-13=-382/2378, 10-12=-422/2276
 WEBS 4-15=-12/295, 5-13=-162/764, 6-13=-498/170, 7-13=-162/764, 8-12=-12/295

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 8-9-0, Exterior(2R) 8-9-0 to 12-11-15, Interior(1) 12-11-15 to 20-9-0, Exterior(2R) 20-9-0 to 24-11-14, Interior(1) 24-11-14 to 31-4-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=293, 10=293.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




June 9, 2023



Job 3542878	Truss A18	Truss Type Hip Girder	Qty 1	Ply 2	Summit/186 Highland Meadows 158813613
----------------	--------------	--------------------------	----------	----------	--

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:47 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:55.0

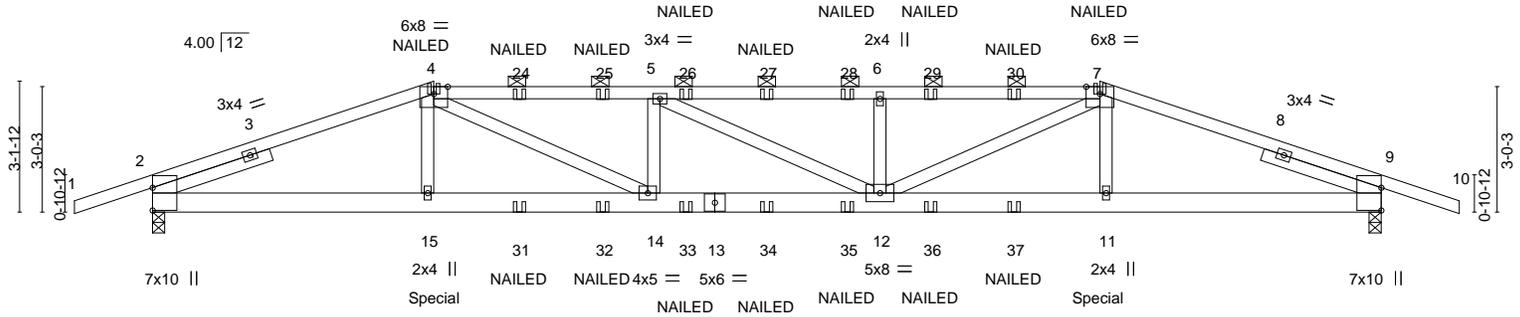

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.82	Vert(LL)	-0.31 12-14	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.73	Vert(CT)	-0.56 12-14	>632	180		
BCLL 0.0	Rep Stress Incr	NO	WB 0.38	Horz(CT)	0.08 9	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS					Weight: 257 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SPF 1650F 1.5E
BOT CHORD 2x6 SPF 2100F 1.8E
WEBS 2x4 SPF No.2
SLIDER Left 2x4 SPF No.2 3-0-0, Right 2x4 SPF No.2 3-0-0

BRACING-
TOP CHORD Structural wood sheathing directly applied or 4-6-8 oc purlins, except 2-0-0 oc purlins (4-2-9 max.): 4-7.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-3-8, 9=0-3-8
Max Horz 2=44(LC 4)
Max Uplift 2=660(LC 4), 9=660(LC 5)
Max Grav 2=2876(LC 1), 9=2876(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=-6130/1350, 4-5=-8455/1893, 5-6=-8400/1879, 6-7=-8405/1881, 7-9=-6139/1352
BOT CHORD 2-15=-1231/5768, 14-15=-1233/5758, 12-14=-1827/8450, 11-12=-1191/5765,
9-11=-1190/5777
WEBS 4-15=-17/289, 4-14=-710/3125, 5-14=-870/280, 6-12=-855/276, 7-12=-695/3062,
7-11=-14/307

- NOTES-**
- 2-ply truss to be connected together with 10d (0.120"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-7-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=660, 9=660.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 543 lb down and 148 lb up at 6-9-0, and 543 lb down and 148 lb up at 22-8-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

Continued on page 2



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 3542878	Truss A18	Truss Type Hip Girder	Qty 1	Ply 2	Summit/186 Highland Meadows I58813613 Job Reference (optional)
----------------	--------------	--------------------------	----------	-----------------	--

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:47 2023 Page 2
ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-4=-70, 4-7=-70, 7-10=-70, 16-20=-20

Concentrated Loads (lb)

Vert: 4=-120(F) 7=-120(F) 15=-543(F) 11=-543(F) 24=-120(F) 25=-120(F) 26=-120(F) 27=-120(F) 28=-120(F) 29=-120(F) 30=-120(F) 31=-96(F) 32=-96(F) 33=-96(F) 34=-96(F) 35=-96(F) 36=-96(F) 37=-96(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 3542878	Truss CJ01	Truss Type Diagonal Hip Girder	Qty 1	Ply 1	Summit/186 Highland Meadows 158813614
----------------	---------------	-----------------------------------	----------	----------	--

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:48 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f



Scale = 1:22.1

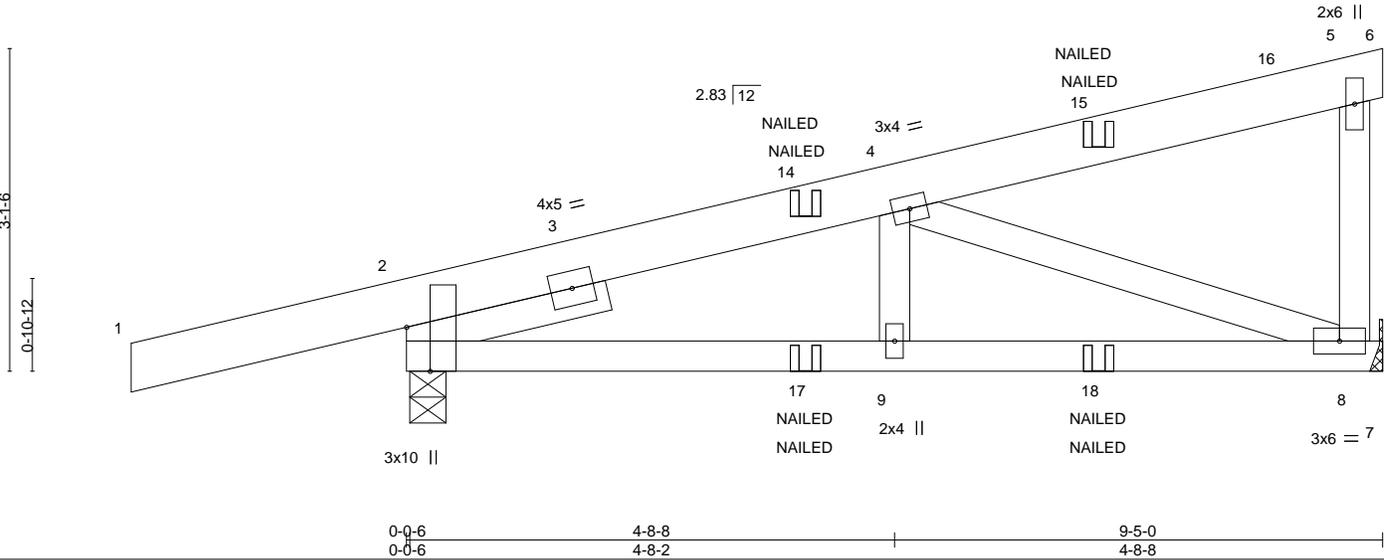


Plate Offsets (X, Y)-- [2:0-5-2, Edge]										
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.25	Vert(LL)	-0.02	8-9	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.33	Vert(CT)	-0.05	8-9	>999	180		
BCLL 0.0	Rep Stress Incr	NO	WB 0.23	Horz(CT)	0.01	8	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS						Weight: 44 lb	FT = 20%

LUMBER-
TOP CHORD 2x6 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
SLIDER Left 2x4 SPF No.2 2-0-0

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-4-3, 8=Mechanical
Max Horz 2=97(LC 7)
Max Uplift 2=-186(LC 4), 8=-90(LC 8)
Max Grav 2=650(LC 1), 8=475(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=-658/112
BOT CHORD 2-9=-128/609, 8-9=-128/609
WEBS 4-8=-606/145

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8 except (jt=lb) 2=186.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-5=-70, 5-6=-20, 7-10=-20
Concentrated Loads (lb)
Vert: 15=-71(F=-53, B=-18) 17=9(F=0, B=9) 18=-44(F=-27, B=-17)



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job 3542878	Truss CJ03	Truss Type Diagonal Hip Girder	Qty 1	Ply 1	Summit/186 Highland Meadows Job Reference (optional)	158813616
----------------	---------------	-----------------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:51 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f



Scale = 1:20.6

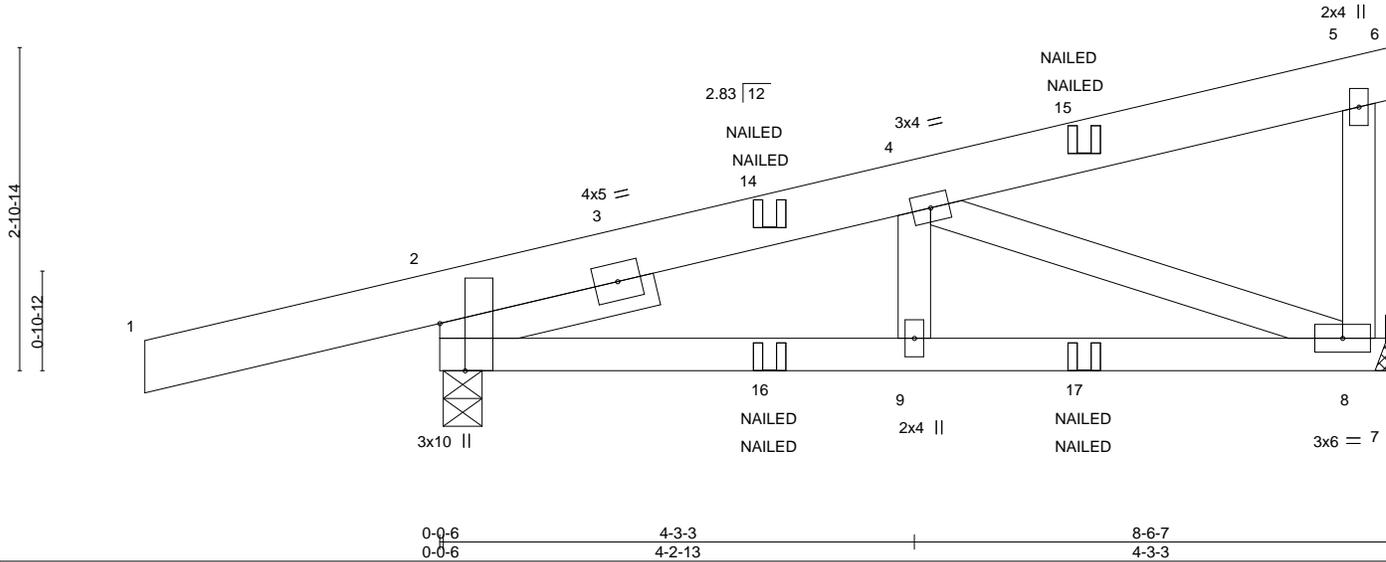


Plate Offsets (X, Y)-- [2:0-5-2,Edge]	0-0-6 0-0-6	4-3-3 4-2-13	8-6-7 4-3-3
---------------------------------------	----------------	-----------------	----------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.25	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.26	Vert(LL) -0.02 8-9 >999 240		
BCLL 0.0	Lumber DOL 1.15	WB 0.15	Vert(CT) -0.03 8-9 >999 180		
BCDL 10.0	Rep Stress Incr NO	Matrix-MP	Horz(CT) 0.01 8 n/a n/a		
	Code IRC2018/TPI2014			Weight: 41 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	
SLIDER Left 2x4 SPF No.2 2-0-0	

REACTIONS. (size) 2=0-4-3, 8=Mechanical
 Max Horz 2=100(LC 7)
 Max Uplift 2=-190(LC 4), 8=-88(LC 8)
 Max Grav 2=575(LC 1), 8=377(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-481/142
 BOT CHORD 2-9=-125/443, 8-9=-125/443
 WEBS 4-8=-473/140

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8 except (jt=lb) 2=190.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-5=-70, 5-6=-20, 7-10=-20
 Concentrated Loads (lb)
 Vert: 14=30(B) 15=-31(F=-31, B=-1) 16=16(F=3, B=13) 17=-26(F=-18, B=-8)



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 3542878	Truss CJ04	Truss Type Jack-Open	Qty 1	Ply 1	Summit/186 Highland Meadows Job Reference (optional)	I58813617
----------------	---------------	-------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:52 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

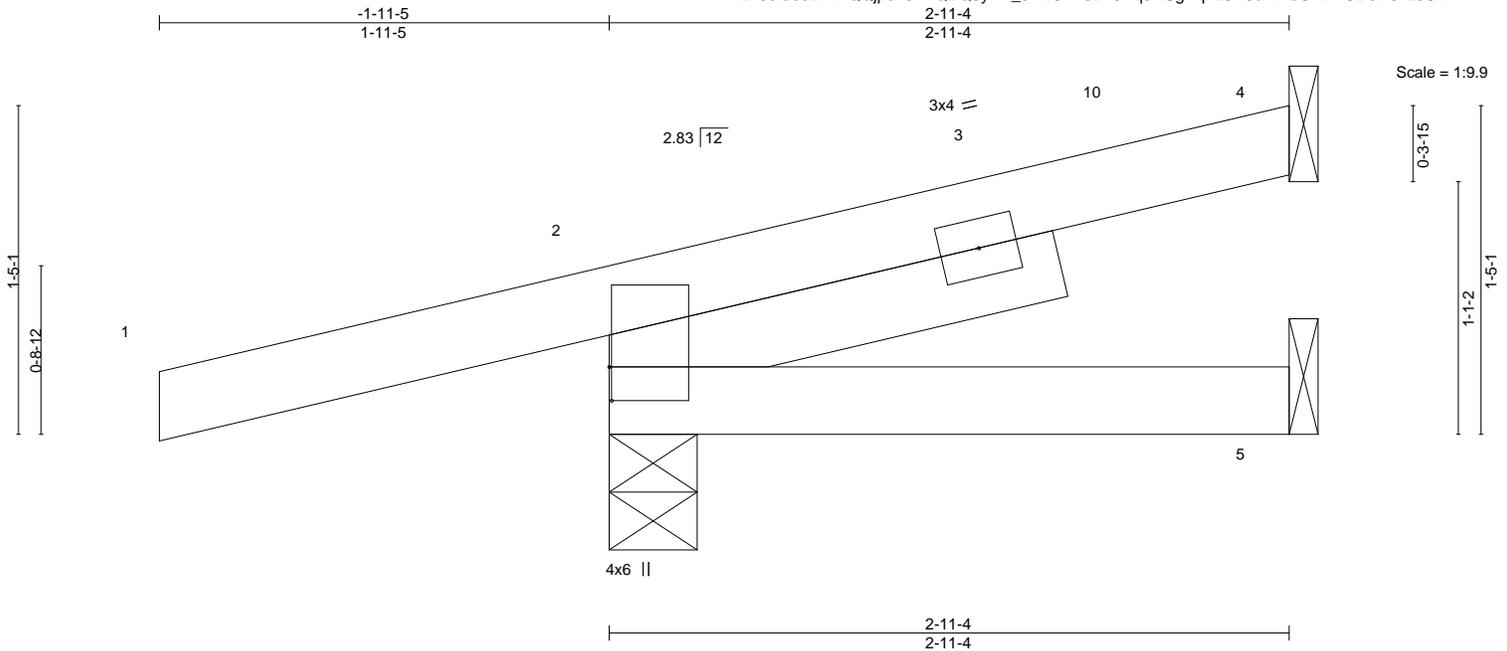


Plate Offsets (X,Y)--	[2:0-1-12,0-0-2]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.25	Vert(LL) -0.00 8 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.04	Vert(CT) -0.00 5-8 >999 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.00	Horz(CT) 0.00 2 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-MP		Weight: 11 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 2-11-4 oc purlins.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
SLIDER Left 2x4 SPF No.2 2-0-0	

REACTIONS. (size) 4=Mechanical, 2=0-4-9, 5=Mechanical
 Max Horz 2=47(LC 8)
 Max Uplift 4=-24(LC 12), 2=-111(LC 8)
 Max Grav 4=61(LC 1), 2=312(LC 1), 5=43(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -1-11-5 to 2-3-9, Exterior(2R) 2-3-9 to 2-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 2=111.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 9, 2023

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 <p>16023 Swingley Ridge Rd Chesterfield, MO 63017</p>
--	---


Job 3542878	Truss CJ05	Truss Type Jack-Open	Qty 1	Ply 1	Summit/186 Highland Meadows I58813618
----------------	---------------	-------------------------	----------	----------	--

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:53 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

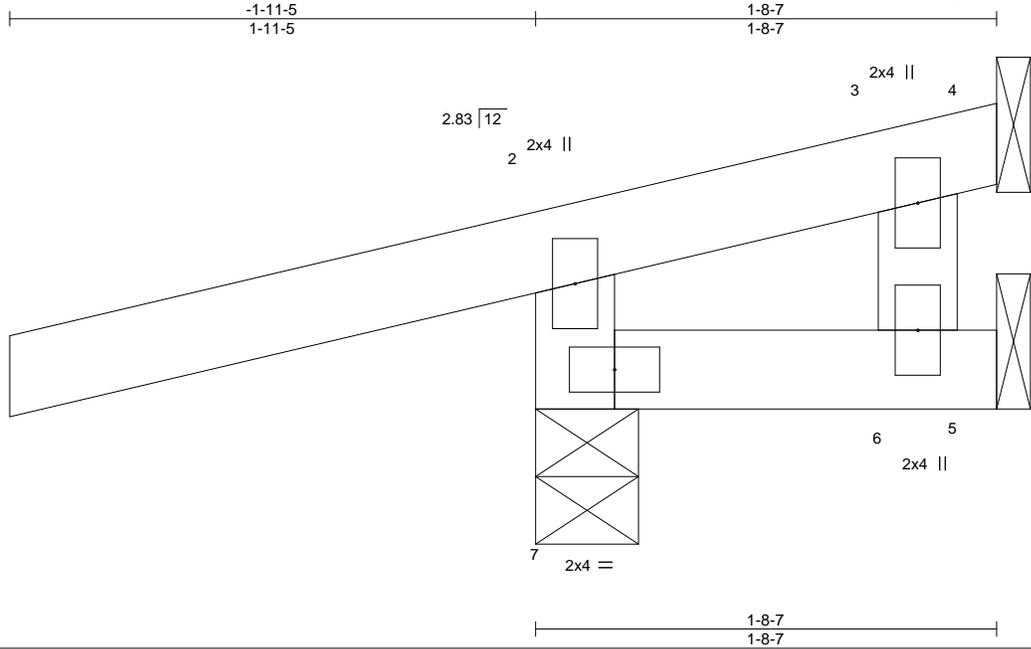

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	2-0-0 Plate Grip DOL 1.15	TC 0.30	Vert(LL) 0.00	6	>999	240	MT20	197/144
BCLL 10.0	Lumber DOL 1.15	BC 0.08	Vert(CT) 0.00	6	>999	180		
BCLL 0.0	Rep Stress Incr YES	WB 0.01	Horz(CT) -0.00	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-MP					Weight: 7 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 1-8-7 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 7=0-4-9, 4=Mechanical, 5=Mechanical
 Max Horz 7=28(LC 8)
 Max Uplift 7=-134(LC 8), 4=-3(LC 12), 5=-45(LC 1)
 Max Grav 7=315(LC 1), 4=21(LC 3), 5=33(LC 8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-7=-277/263


- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 5 except (jt=lb) 7=134.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 9, 2023

Job 3542878	Truss CJ06	Truss Type Roof Special Girder	Qty 1	Ply 1	Summit/186 Highland Meadows I58813619
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					Job Reference (optional)

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:54 2023 Page 1
ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

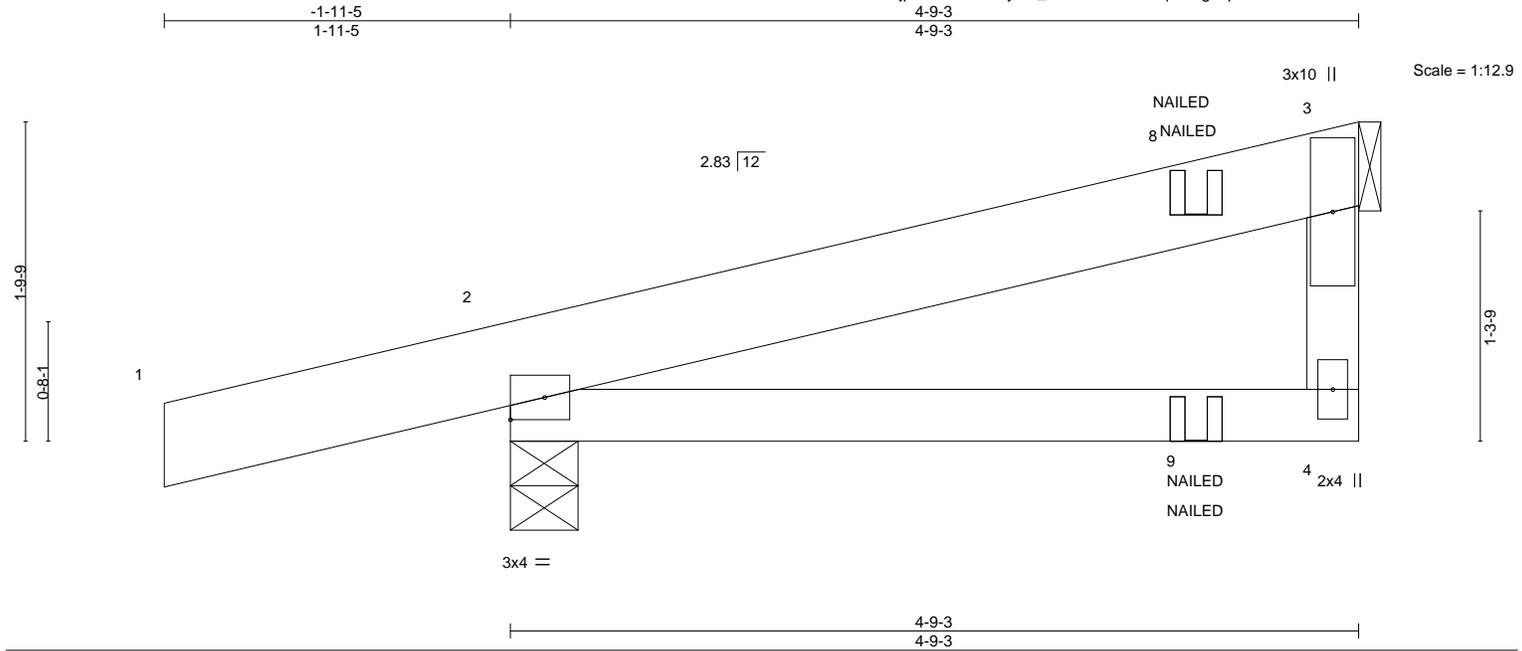

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.15	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.14	Vert(LL) -0.01 4-7 >999 240		
BCLL 0.0	Lumber DOL 1.15	WB 0.02	Vert(CT) -0.03 4-7 >999 180		
BCDL 10.0	Rep Stress Incr NO	Matrix-MP	Horz(CT) 0.00 2 n/a n/a		
	Code IRC2018/TPI2014			Weight: 19 lb	FT = 20%

LUMBER-
TOP CHORD 2x6 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 4-9-3 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-4-9, 3=Mechanical
Max Horz 2=62(LC 4)
Max Uplift 2=-117(LC 4), 3=-39(LC 8)
Max Grav 2=372(LC 1), 3=175(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-
1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
3) Refer to girder(s) for truss to truss connections.
4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3 except (jt=lb) 2=117.
5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
6) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-70, 4-5=-20
Concentrated Loads (lb)
Vert: 9=5(F=3, B=3)



June 9, 2023


Job 3542878	Truss CJ07	Truss Type Jack-Open	Qty 1	Ply 1	Summit/186 Highland Meadows I58813620
----------------	---------------	-------------------------	----------	----------	--

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:54 2023 Page 1

ID:0efadeDmNQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCdoi7J4zJC?f

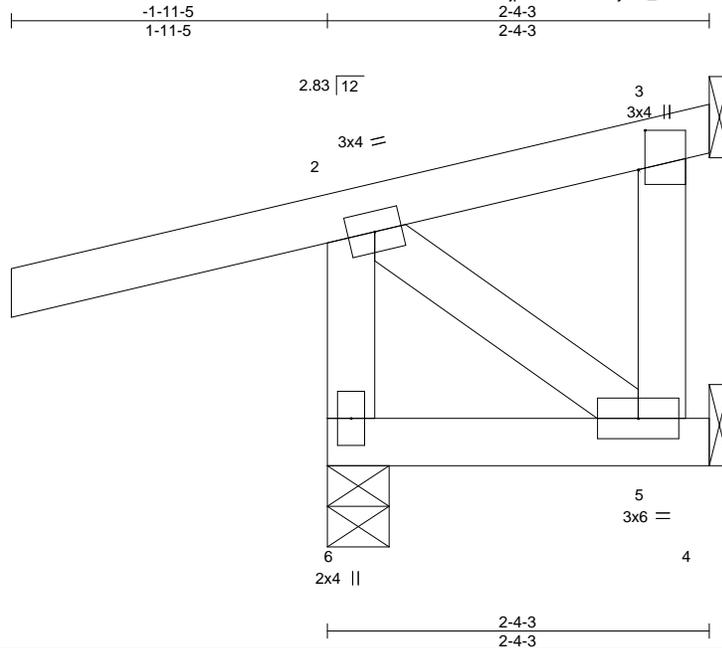

Scale = 1:14.1

Plate Offsets (X,Y)--	[3:0-2-15,0-0-8]						
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.30	Vert(LL)	-0.00	6	>999
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	-0.00	5-6	>999
BCLL 0.0	Rep Stress Incr	YES	WB 0.02	Horz(CT)	-0.00	3	n/a
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-MP				
							PLATES
							MT20
							GRIP
							197/144
							Weight: 13 lb
							FT = 20%

LUMBER-
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 2-4-3 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 6=0-4-9, 3=Mechanical, 5=Mechanical
Max Horz 6=47(LC 9)
Max Uplift 6=-114(LC 8), 3=-13(LC 1), 5=-14(LC 9)
Max Grav 6=312(LC 1), 3=20(LC 8), 5=51(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-6=-293/245

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 5 except (jt=lb) 6=114.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.



June 9,2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job 3542878	Truss CJ08	Truss Type Roof Special Girder	Qty 1	Ply 1	Summit/186 Highland Meadows Job Reference (optional)	I58813621
----------------	---------------	-----------------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:56 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

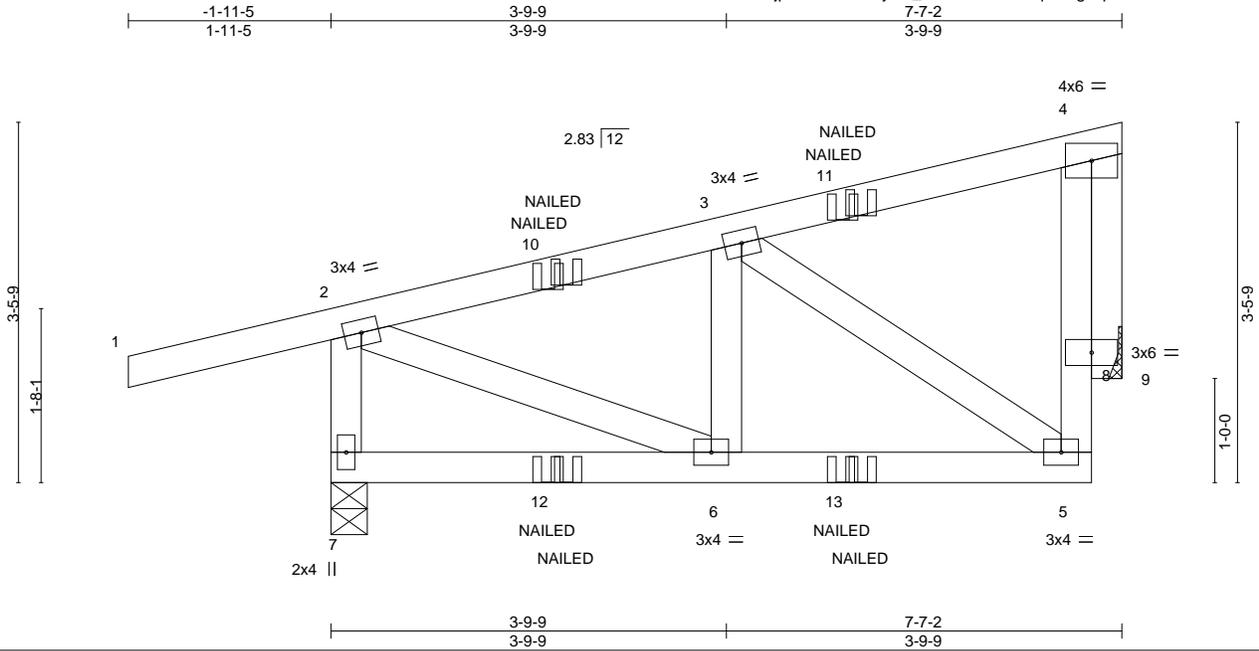

Scale = 1:22.0

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.34	Vert(LL)	-0.01	5-6	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.16	Vert(CT)	-0.02	5-6	>999	180		
BCLL 0.0	Rep Stress Incr	NO	WB 0.08	Horz(CT)	0.01	9	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP						Weight: 37 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 7=0-4-3, 9=Mechanical
Max Horz 7=88(LC 5)
Max Uplift 7=-179(LC 4), 9=-109(LC 8)
Max Grav 7=498(LC 1), 9=296(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-325/94, 2-7=-476/176
BOT CHORD 5-6=-122/281
WEBS 3-5=-278/130, 2-6=-76/302, 4-9=-303/111

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=179, 9=109.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-70, 2-4=-70, 5-7=-20
Concentrated Loads (lb)
Vert: 11=-12(F) 12=16(F=-12, B=28) 13=-21(F=-13, B=-9)



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 3542878	Truss CJ10	Truss Type Jack-Open	Qty 1	Ply 1	Summit/186 Highland Meadows I58813622
----------------	---------------	-------------------------	----------	----------	--


Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:57 2023 Page 1

ID:0efadeDmNQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCdoi7J4zJC?f

Job Reference (optional)

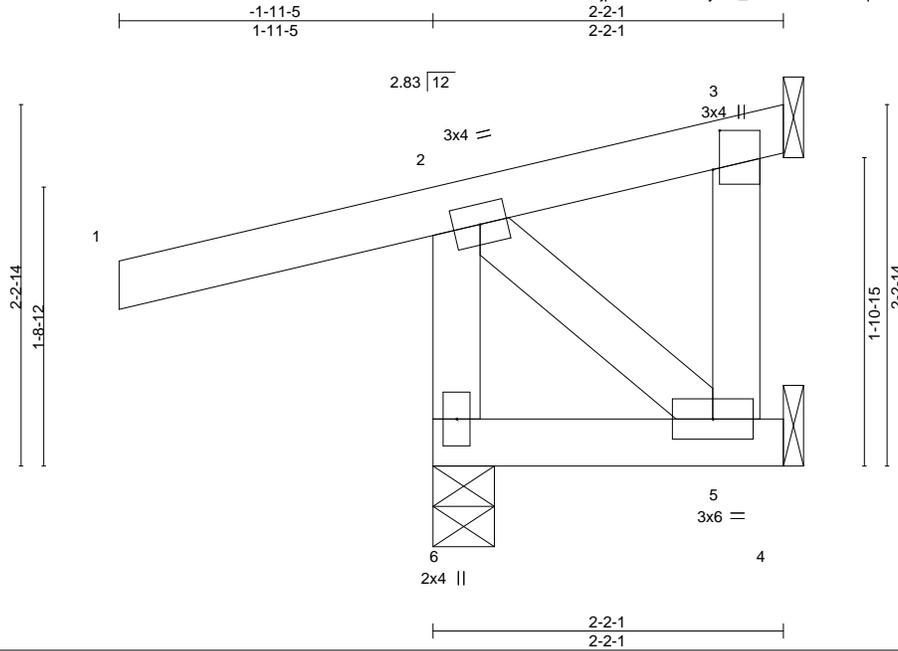

Scale = 1:14.2

Plate Offsets (X,Y)--	[3:0-2-15,0-0-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.30	Vert(LL) -0.00 6 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.02	Vert(CT) -0.00 5-6 >999 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.02	Horz(CT) -0.00 3 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-MP		Weight: 13 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 2-2-1 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 6=0-4-9, 3=Mechanical, 5=Mechanical
 Max Horz 6=47(LC 9)
 Max Uplift 6=-116(LC 8), 3=-28(LC 1), 5=-18(LC 9)
 Max Grav 6=312(LC 1), 3=27(LC 8), 5=47(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-6=-295/247

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 5 except (jt=lb) 6=116.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.



June 9, 2023

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 <p>16023 Swingley Ridge Rd Chesterfield, MO 63017</p>
--	---


Job 3542878	Truss CJ11	Truss Type Jack-Open	Qty 1	Ply 1	Summit/186 Highland Meadows I58813623
----------------	---------------	-------------------------	----------	----------	--

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:58 2023 Page 1

ID:0efadeDmNQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

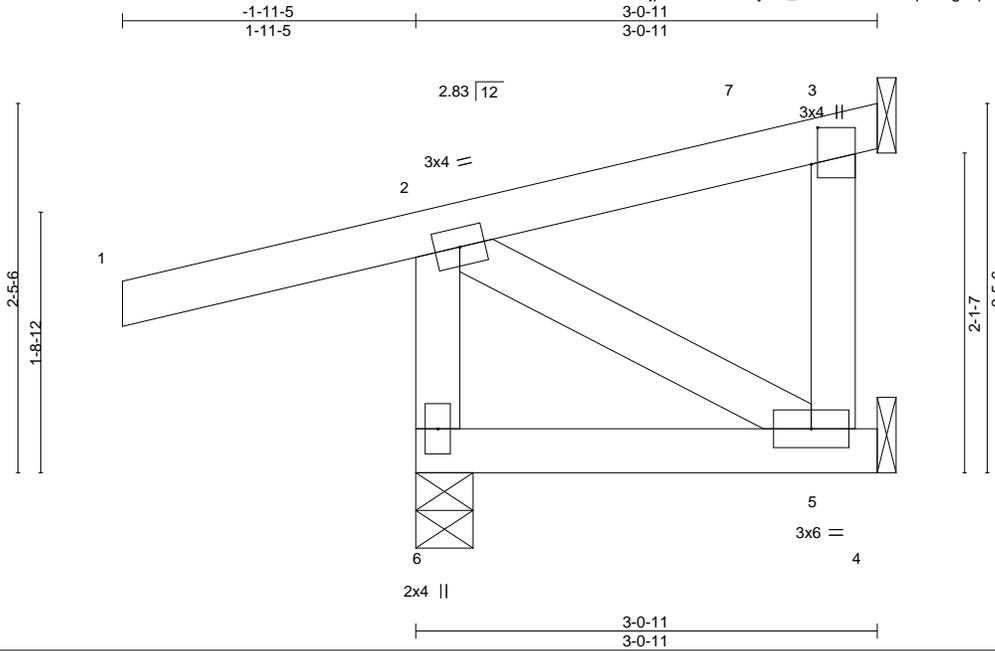

Scale = 1:15.2

Plate Offsets (X,Y)--	[3:0-2-15,0-0-8]				
LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.30	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.06	Vert(LL) -0.00 5-6 >999 240		
BCLL 0.0	Lumber DOL 1.15	WB 0.02	Vert(CT) -0.01 5-6 >999 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-MP	Horz(CT) -0.00 3 n/a n/a		
	Code IRC2018/TPI2014			Weight: 16 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 3-0-11 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 6=0-4-9, 3=Mechanical, 5=Mechanical
 Max Horz 6=52(LC 9)
 Max Uplift 6=-109(LC 8), 3=-17(LC 12), 5=-7(LC 9)
 Max Grav 6=322(LC 1), 3=33(LC 1), 5=65(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-6=-296/239

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -1-11-5 to 2-3-9, Exterior(2R) 2-3-9 to 2-9-3 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 5 except (jt=lb) 6=109.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.



June 9, 2023


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 <p>16023 Swingley Ridge Rd Chesterfield, MO 63017</p>
--	---

Job 3542878	Truss F01	Truss Type GABLE	Qty 1	Ply 1	Summit/186 Highland Meadows Job Reference (optional)	158813624
----------------	--------------	---------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:59 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPnL8w3uITXbGKWrCDoi7J4zJC?f

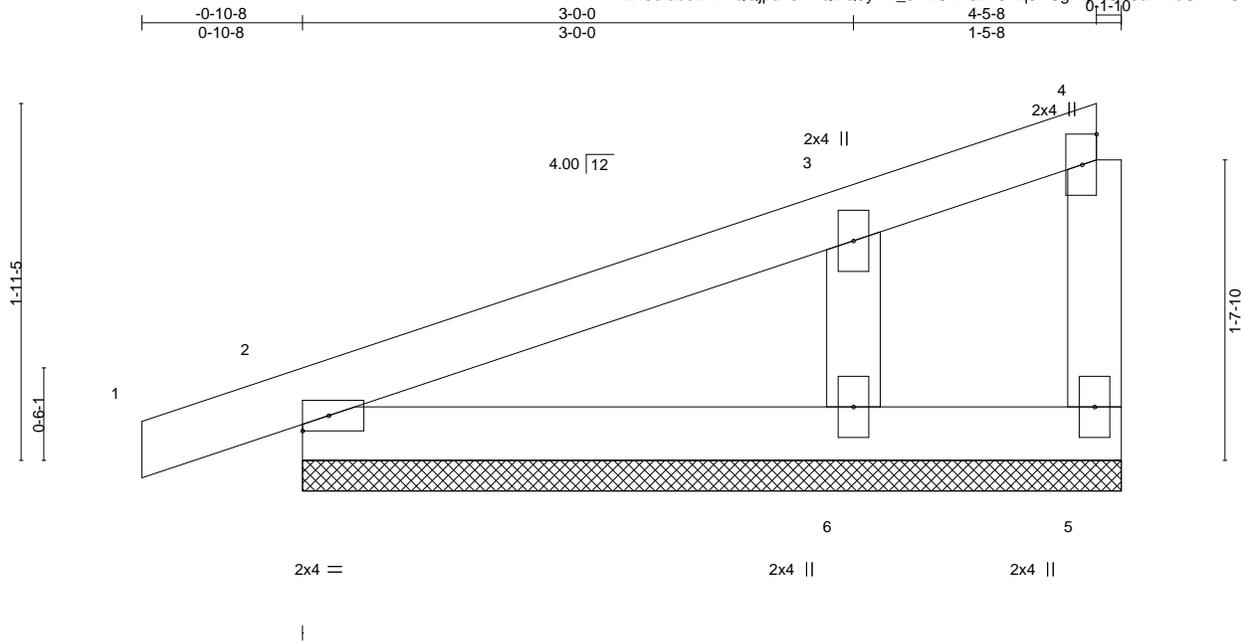

Scale = 1:12.5

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 25.0	Plate Grip DOL	1.15	TC 0.09	Vert(LL)	-0.00	1	n/r	120	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	0.00	1	n/r	120		
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 14 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 4-5-8 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 5=4-5-8, 2=4-5-8, 6=4-5-8
 Max Horz 2=67(LC 9)
 Max Uplift 5=5(LC 11), 2=48(LC 8), 6=61(LC 12)
 Max Grav 5=6(LC 1), 2=183(LC 1), 6=257(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 WEBS 3-6=-196/275

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-10-8 to 2-1-8, Exterior(2N) 2-1-8 to 4-3-5 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 1-4-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 2, 6.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job 3542878	Truss F02	Truss Type Monopitch	Qty 7	Ply 1	Summit/186 Highland Meadows 158813625
----------------	--------------	-------------------------	----------	----------	--

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:49:59 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPonL8w3uITXbGKWrCDoi7J4zJC?f

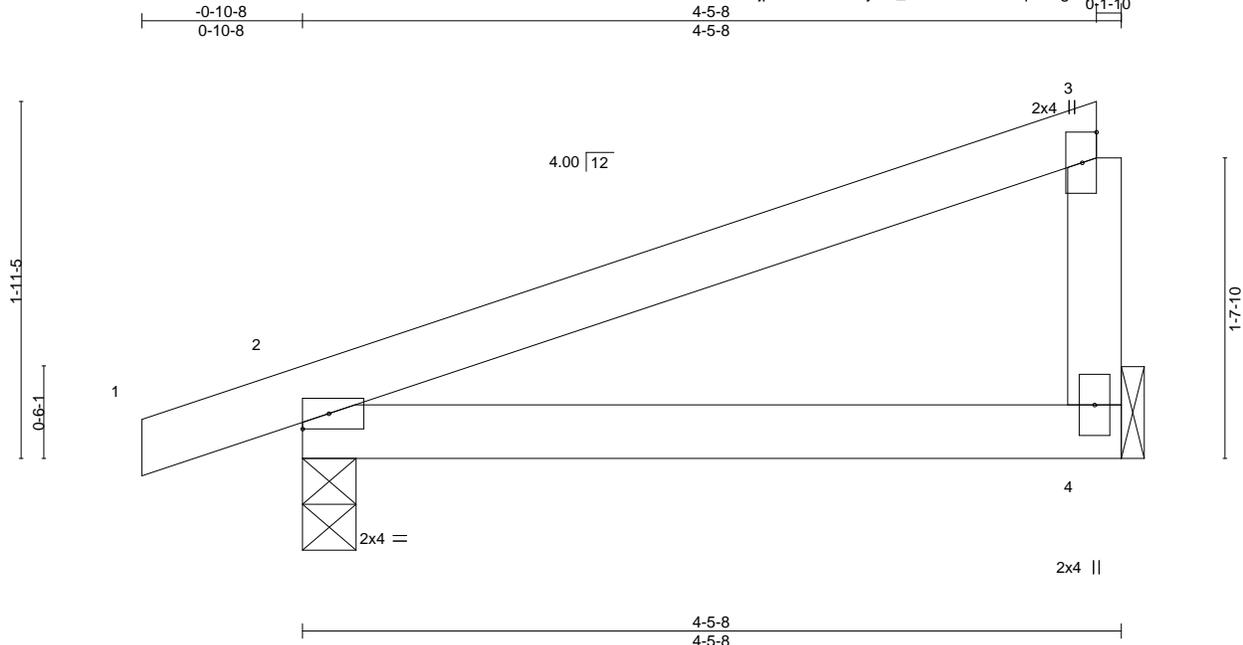

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.24	Vert(LL)	-0.02 4-7	>999	240	MT20	197/144
BCDL 10.0	Lumber DOL	1.15	BC 0.17	Vert(CT)	-0.03 4-7	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.01 2	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 13 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except end verticals.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 4=Mechanical, 2=0-3-8
 Max Horz 2=68(LC 11)
 Max Uplift 4=-39(LC 12), 2=-65(LC 8)
 Max Grav 4=188(LC 1), 2=262(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 4-3-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 9, 2023

Job 3542878	Truss H01	Truss Type GABLE	Qty 1	Ply 1	Summit/186 Highland Meadows 158813626
----------------	--------------	---------------------	----------	----------	--

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:01 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:25.3

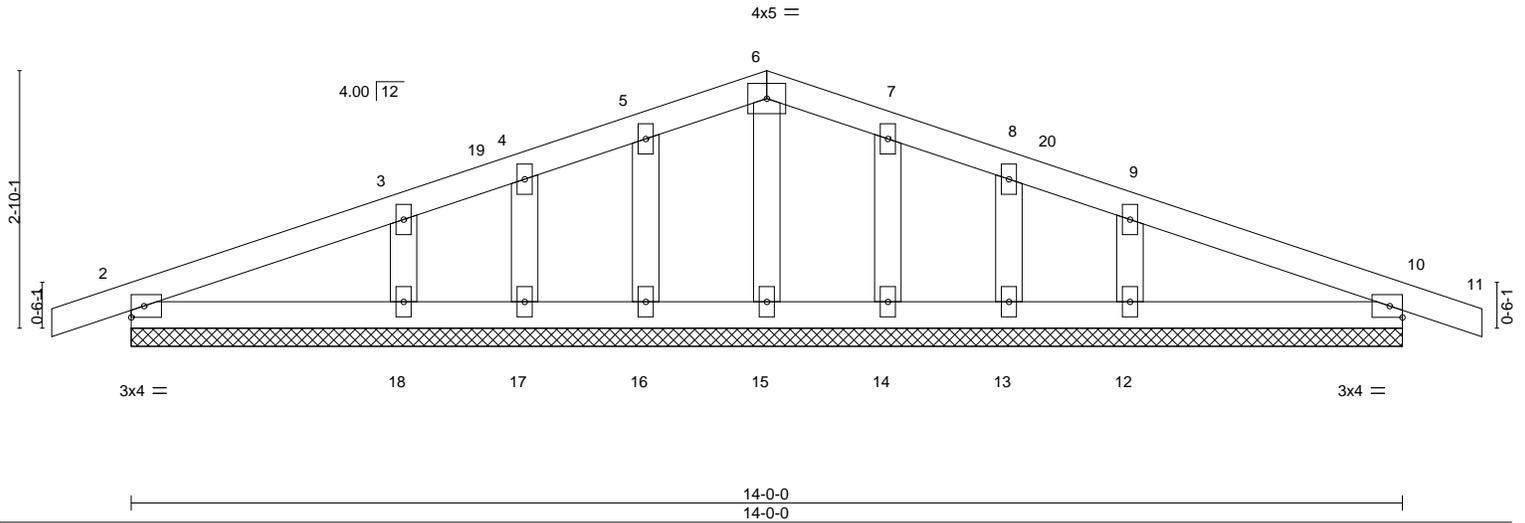

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 25.0	Plate Grip DOL	1.15	TC 0.08	Vert(LL)	0.00	11	n/r	120	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	0.00	11	n/r	120		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	10	n/a	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-S						Weight: 47 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 OTHERS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 14-0-0.
 (lb) - Max Horz 2--42(LC 13)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 10, 16, 17, 18, 14, 13, 12
 Max Grav All reactions 250 lb or less at joint(s) 2, 10, 15, 16, 17, 14, 13 except 18=257(LC 25), 12=257(LC 26)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-10-8 to 2-1-8, Exterior(2N) 2-1-8 to 7-0-0, Corner(3R) 7-0-0 to 10-0-0, Exterior(2N) 10-0-0 to 14-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 10, 16, 17, 18, 14, 13, 12.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 3542878	Truss H02	Truss Type Common	Qty 2	Ply 1	Summit/186 Highland Meadows I58813627
----------------	--------------	----------------------	----------	----------	--

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:02 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f



Scale = 1:25.3

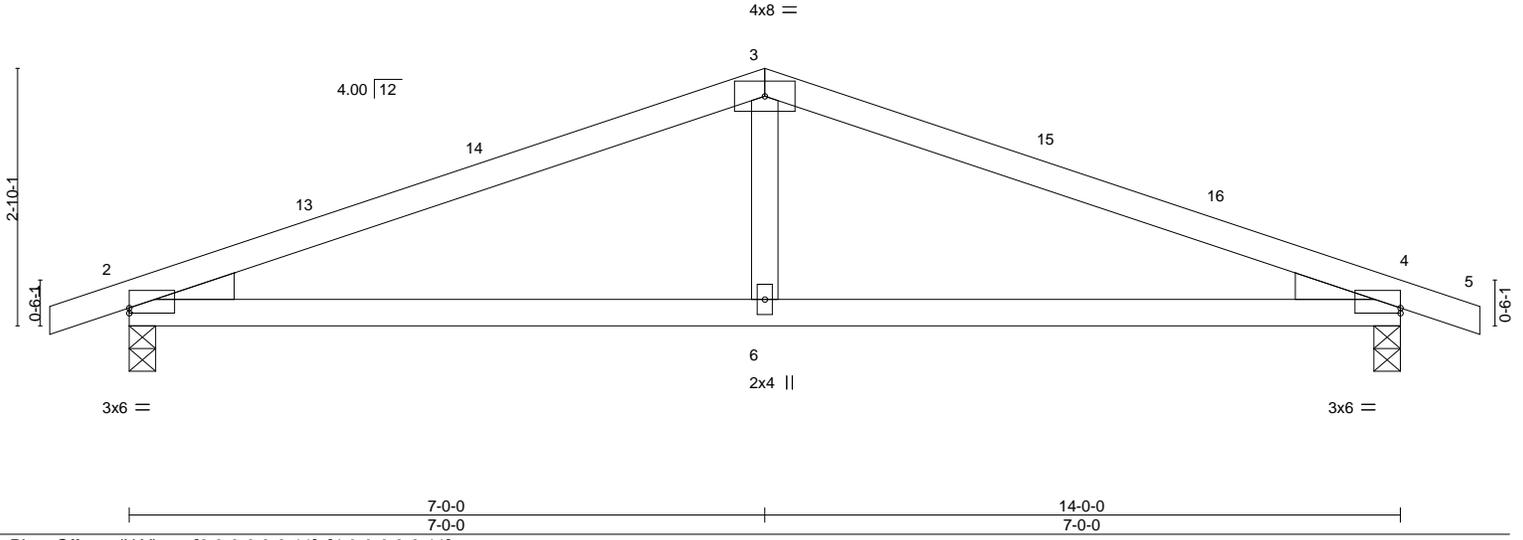


Plate Offsets (X,Y)--	[2:0-0-0,0-0-11], [4:0-0-0,0-0-11]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.52	Vert(LL) -0.07 6-9 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.42	Vert(CT) -0.13 6-12 >999 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.07	Horz(CT) 0.02 4 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS		Weight: 40 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
WEDGE
Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 2=0-3-8, 4=0-3-8
Max Horz 2=-42(LC 17)
Max Uplift 2=-124(LC 8), 4=-124(LC 9)
Max Grav 2=691(LC 1), 4=691(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1114/307, 3-4=-1114/307
BOT CHORD 2-6=-211/988, 4-6=-211/988
WEBS 3-6=0/297

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 7-0-0, Exterior(2R) 7-0-0 to 10-0-0, Interior(1) 10-0-0 to 14-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=124, 4=124.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 9, 2023

Job	Truss	Truss Type	Qty	Ply	Summit/186 Highland Meadows	I58813628
3542878	H03	Common	2	1		

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:03 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:24.4

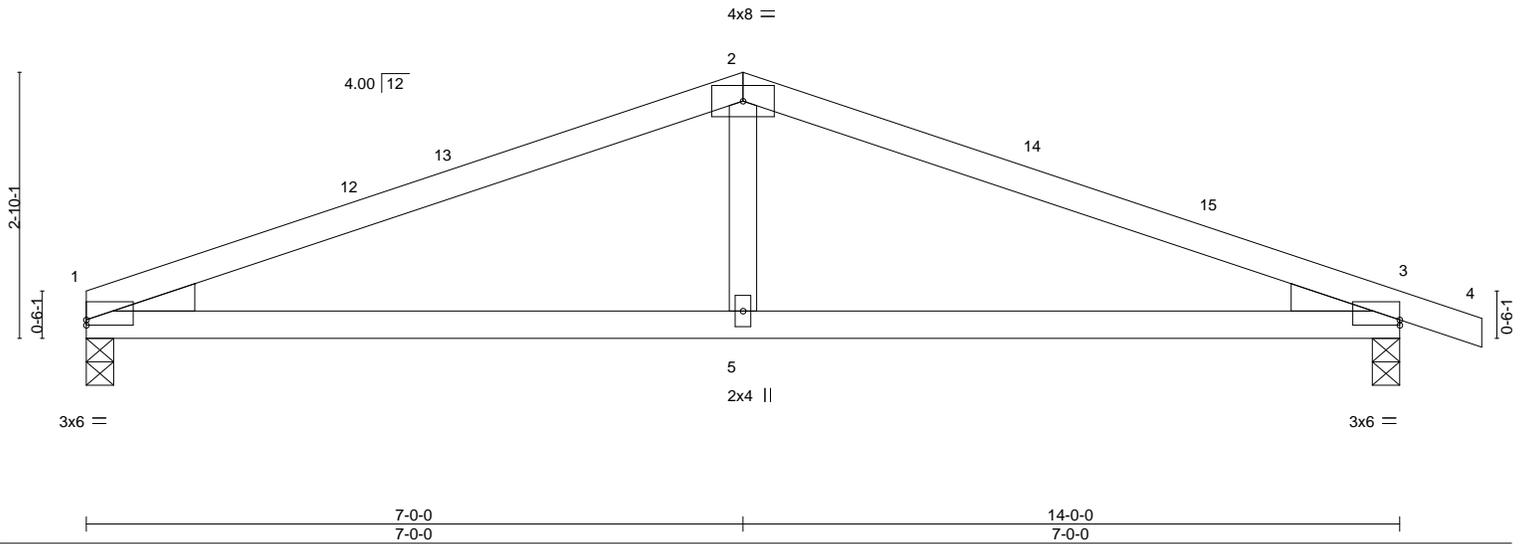


Plate Offsets (X,Y)--	[1:0-0-0,0-0-11], [3:Edge,0-0-11]
-----------------------	-----------------------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.53	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.43	Vert(LL) -0.08 5-8 >999 240		
BCLL 0.0	Lumber DOL 1.15	WB 0.07	Vert(CT) -0.13 5-8 >999 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.02 3 n/a n/a		
	Code IRC2018/TPI2014			Weight: 39 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2
 WEDGE
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 1=0-3-8, 3=0-3-8
 Max Horz 1=46(LC 13)
 Max Uplift 1=91(LC 8), 3=124(LC 9)
 Max Grav 1=628(LC 1), 3=693(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-1121/317, 2-3=-1122/309
 BOT CHORD 1-5=-215/995, 3-5=-215/995
 WEBS 2-5=0/298

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 7-0-0, Exterior(2R) 7-0-0 to 10-0-0, Interior(1) 10-0-0 to 14-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 3=124.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 3542878	Truss J01	Truss Type Jack-Partial	Qty 9	Ply 1	Summit/186 Highland Meadows I58813629
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					Job Reference (optional)

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:04 2023 Page 1
ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

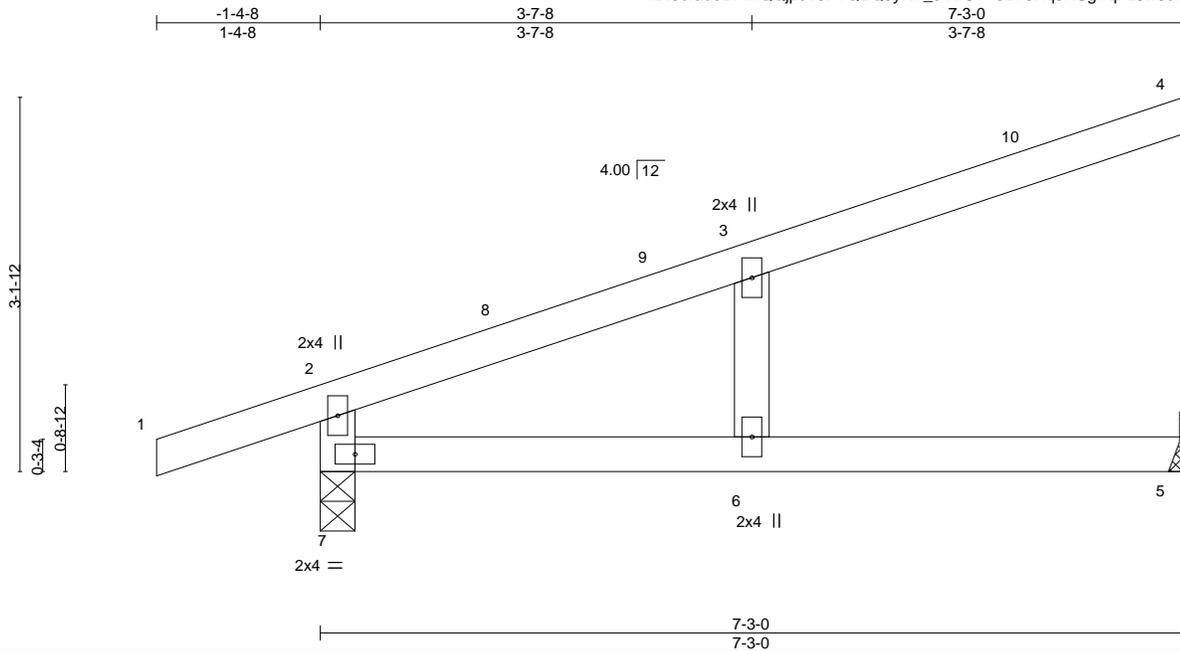

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.50	Vert(LL)	0.18	6	>472	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.61	Vert(CT)	-0.30	6	>283		
BCLL 0.0	Lumber DOL 1.15	WB 0.02	Horz(CT)	0.06	4	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS					Weight: 21 lb	FT = 20%
	Code IRC2018/TPI2014							

LUMBER-
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 4=Mechanical, 5=Mechanical, 7=0-3-8
Max Horz 7=104(LC 8)
Max Uplift 4=63(LC 8), 5=10(LC 12), 7=99(LC 8)
Max Grav 4=190(LC 1), 5=117(LC 3), 7=435(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-7=313/149

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 1-7-8, Interior(1) 1-7-8 to 7-2-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 5, 7.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job 3542878	Truss J02	Truss Type Jack-Open	Qty 2	Ply 1	Summit/186 Highland Meadows Job Reference (optional)	I58813630
----------------	--------------	-------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:05 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

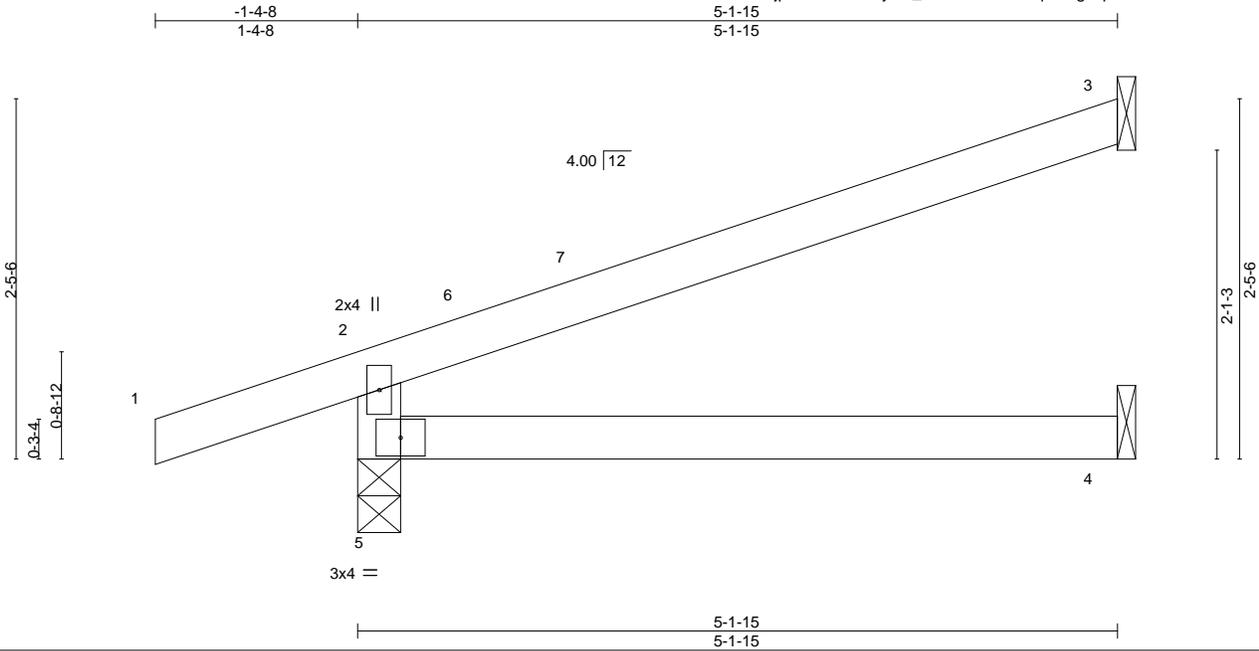

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.32	Vert(LL)	-0.03 4-5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.22	Vert(CT)	-0.06 4-5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.02 3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 14 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except end verticals.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 3=Mechanical, 4=Mechanical, 5=0-3-8
 Max Horz 5=78(LC 8)
 Max Uplift 3=-62(LC 12), 5=-88(LC 8)
 Max Grav 3=152(LC 1), 4=91(LC 3), 5=346(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-5=-302/184

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 1-7-8, Interior(1) 1-7-8 to 5-1-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 9, 2023


Job 3542878	Truss J03	Truss Type Jack-Open	Qty 2	Ply 1	Summit/186 Highland Meadows 158813631
----------------	--------------	-------------------------	----------	----------	--

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:06 2023 Page 1

ID:0efadeDmNQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

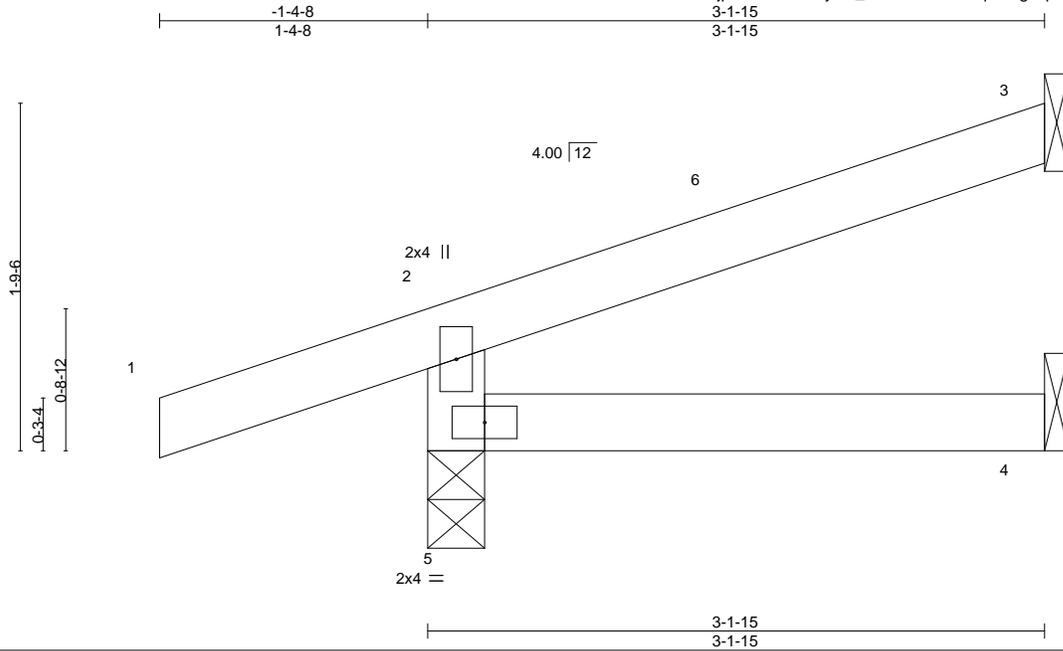

Scale = 1:11.8

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 25.0	Plate Grip DOL	1.15	TC 0.15	Vert(LL)	-0.00	4-5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	-0.01	4-5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-MR							
									Weight: 9 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 3-1-15 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 3=Mechanical, 4=Mechanical, 5=0-3-8
 Max Horz 5=54(LC 8)
 Max Uplift 3=35(LC 12), 5=-81(LC 8)
 Max Grav 3=80(LC 1), 4=53(LC 3), 5=267(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 1-7-8, Interior(1) 1-7-8 to 3-1-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 3542878	Truss J04	Truss Type Jack-Open	Qty 2	Ply 1	Summit/186 Highland Meadows I58813632
----------------	--------------	-------------------------	----------	----------	--

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:06 2023 Page 1

ID:0efadeDmNQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f

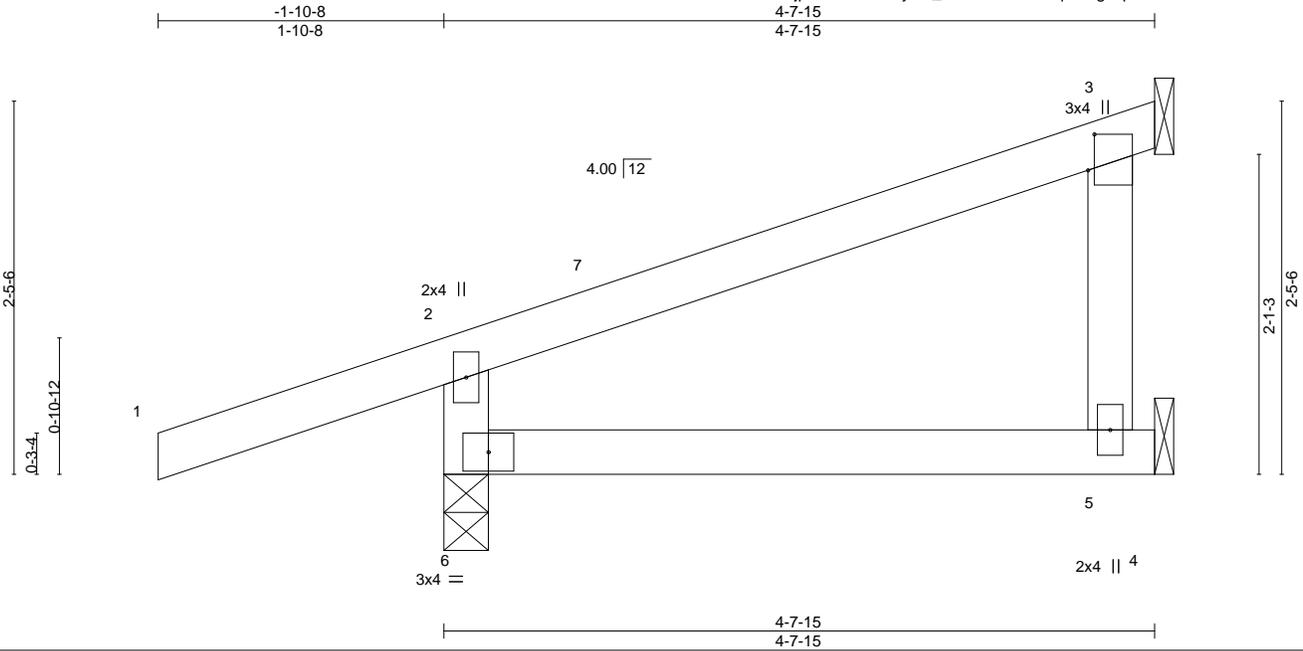


Plate Offsets (X, Y)--	[3:0-2-13,0-0-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.27	Vert(LL) 0.02 5-6 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.15	Vert(CT) -0.03 5-6 >999 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.00	Horz(CT) -0.01 3 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS		Weight: 16 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 5=Mechanical, 3=Mechanical, 6=0-3-8
 Max Horz 6=75(LC 8)
 Max Uplift 3=-52(LC 12), 6=-108(LC 8)
 Max Grav 5=88(LC 3), 3=117(LC 1), 6=365(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-6=-320/201

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 4-4-7 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Bearing at joint(s) 6 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3 except (jt=lb) 6=108.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.



June 9,2023

Job 3542878	Truss J05	Truss Type Jack-Open	Qty 2	Ply 1	Summit/186 Highland Meadows I58813633
----------------	--------------	-------------------------	----------	----------	--

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:07 2023 Page 1
 ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

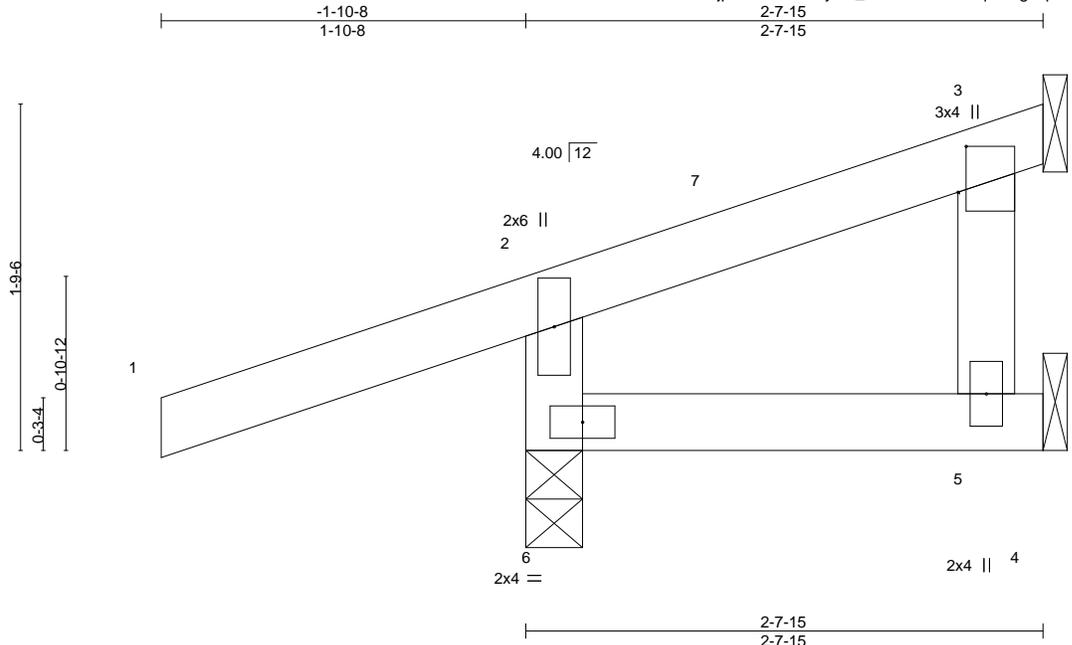


Plate Offsets (X,Y)--	[3:0-2-13,0-0-8]
-----------------------	------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.28	Vert(LL)	0.00	5-6	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	0.00	5-6	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.01	3	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-MP						
								Weight: 10 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 2-7-15 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 5=Mechanical, 3=Mechanical, 6=0-3-8
 Max Horz 6=50(LC 8)
 Max Uplift 3=-21(LC 12), 6=-111(LC 8)
 Max Grav 5=49(LC 3), 3=32(LC 1), 6=305(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-6=-265/210

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 2-4-7 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Bearing at joint(s) 6 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3 except (jt=lb) 6=111.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.



June 9, 2023

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 16023 Swingley Ridge Rd Chesterfield, MO 63017
--	--

Job 3542878	Truss J06	Truss Type Jack-Open	Qty 6	Ply 1	Summit/186 Highland Meadows Job Reference (optional)	I58813634
----------------	--------------	-------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:08 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

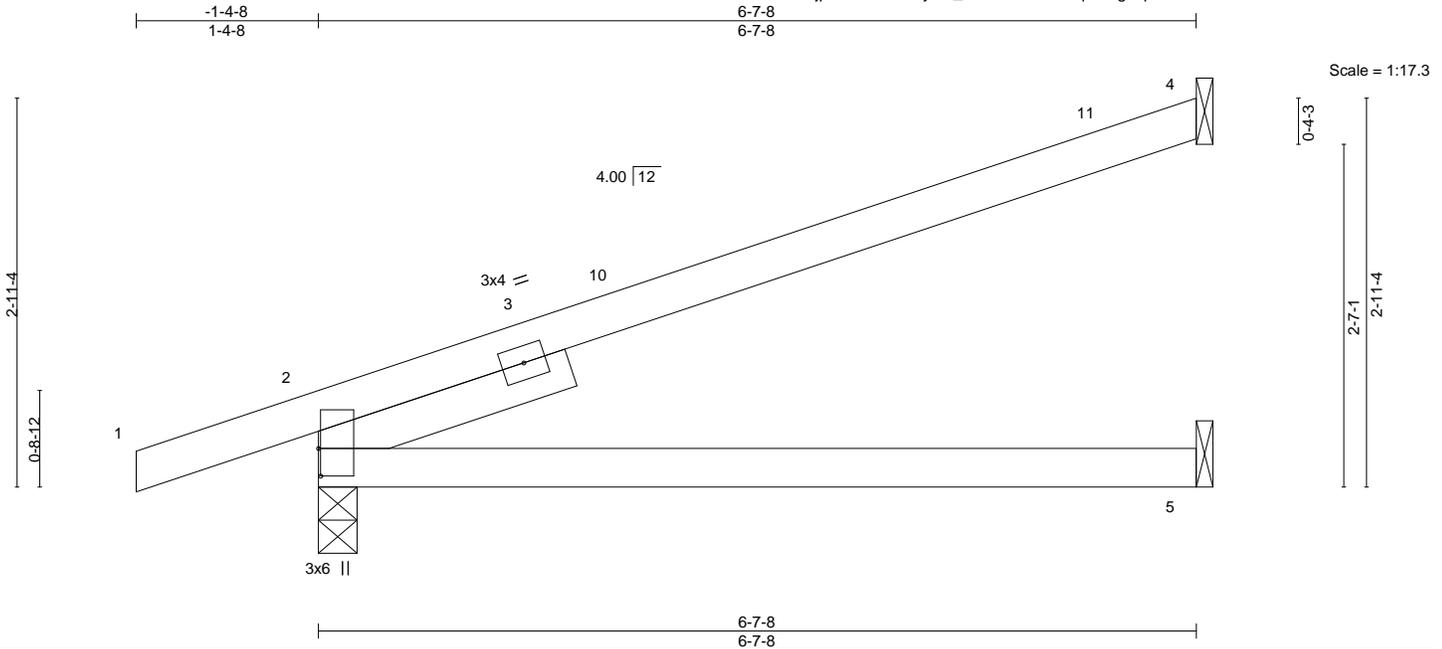


Plate Offsets (X, Y)--	[2:0-2-8,0-0-3]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.57	Vert(LL) 0.09 5-8 >833 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.39	Vert(CT) -0.18 5-8 >448 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.00	Horz(CT) 0.04 2 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS		Weight: 20 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
SLIDER Left 2x4 SPF No.2 2-0-0	

REACTIONS. (size) 4=Mechanical, 2=0-3-8, 5=Mechanical
 Max Horz 2=103(LC 8)
 Max Uplift 4=-77(LC 8), 2=-90(LC 8)
 Max Grav 4=203(LC 1), 2=402(LC 1), 5=116(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-350/52

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 1-7-8, Interior(1) 1-7-8 to 6-6-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 9, 2023

Job 3542878	Truss J07	Truss Type Jack-Open	Qty 5	Ply 1	Summit/186 Highland Meadows I58813635
----------------	--------------	-------------------------	----------	----------	--

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:09 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCdoi7J4zJC?f

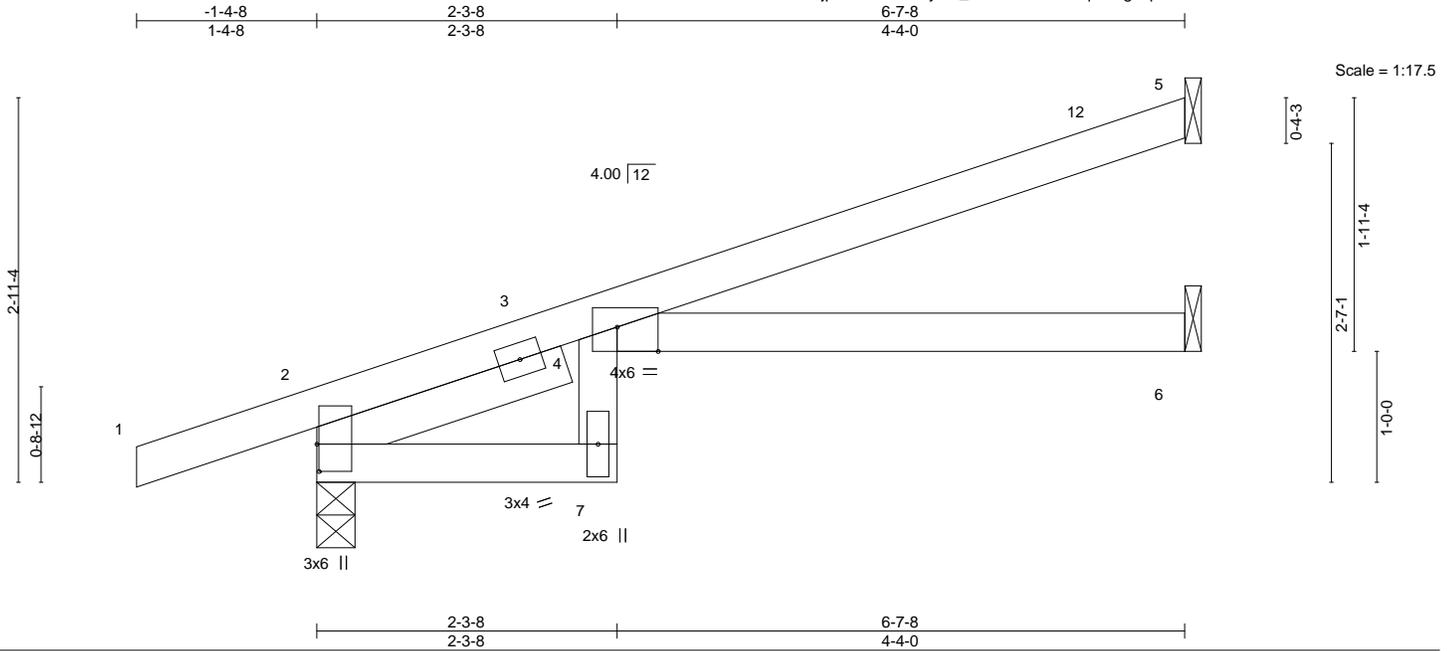


Plate Offsets (X,Y)--	[2:0-2-8,0-0-3], [4:0-3-12,Edge]
-----------------------	----------------------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.68	Vert(LL)	0.14	4-6	>554	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.53	Vert(CT)	-0.23	4-6	>345		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.12	6	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 21 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
SLIDER Left 2x4 SPF No.2 2-0-0	

REACTIONS. (size) 5=Mechanical, 2=0-3-8, 6=Mechanical
 Max Horz 2=103(LC 8)
 Max Uplift 5=-65(LC 8), 2=-90(LC 8), 6=-3(LC 12)
 Max Grav 5=187(LC 1), 2=402(LC 1), 6=112(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 4-9=-270/140

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 1-7-8, Interior(1) 1-7-8 to 6-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 2, 6.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 9, 2023

Job 3542878	Truss J08	Truss Type Half Hip	Qty 1	Ply 1	Summit/186 Highland Meadows 158813636
----------------	--------------	------------------------	----------	----------	--

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:10 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f



4x5 =

Scale = 1:18.5

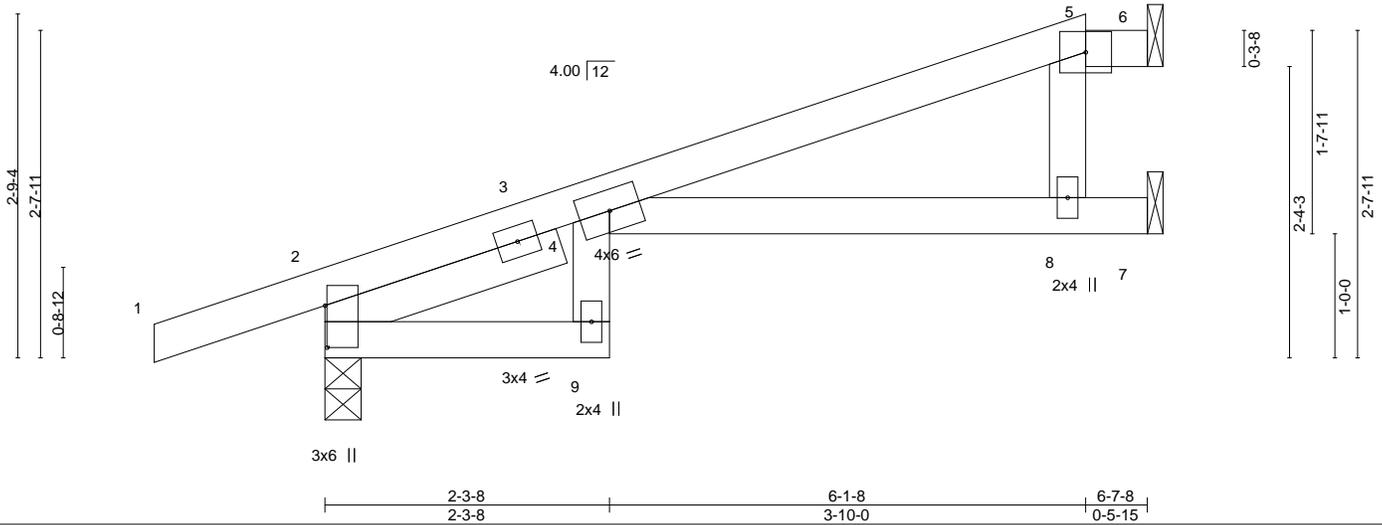


Plate Offsets (X,Y)--	[2:0-4-1,0-0-3]						
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.77	Vert(LL) 0.21	9	>380	240
TCDL 10.0	Lumber DOL	1.15	BC 0.33	Vert(CT) -0.30	9	>259	180
BCLL 0.0	Rep Stress Incr	YES	WB 0.04	Horz(CT) 0.18	7	n/a	n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS				
							PLATES
							MT20
							GRIP
							197/144
							Weight: 22 lb
							FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied, except
BOT CHORD	2x4 SPF No.2		2-0-0 oc purlins: 5-6.
WEBS	2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied.
SLIDER	Left 2x4 SPF No.2 2-0-0		

REACTIONS. (size) 6=Mechanical, 2=0-3-8, 7=Mechanical
 Max Horz 2=93(LC 8)
 Max Uplift 6=5(LC 8), 2=94(LC 8), 7=58(LC 8)
 Max Grav 6=15(LC 1), 2=402(LC 1), 7=270(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 4-11=282/167
 WEBS 5-8=260/217

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 1-7-8, Interior(1) 1-7-8 to 6-1-8, Exterior(2E) 6-1-8 to 6-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 2, 7.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 9, 2023


Job 3542878	Truss J10	Truss Type Jack-Open	Qty 1	Ply 1	Summit/186 Highland Meadows I58813638
----------------	--------------	-------------------------	----------	----------	--

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:12 2023 Page 1

ID:0efadeDmNQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

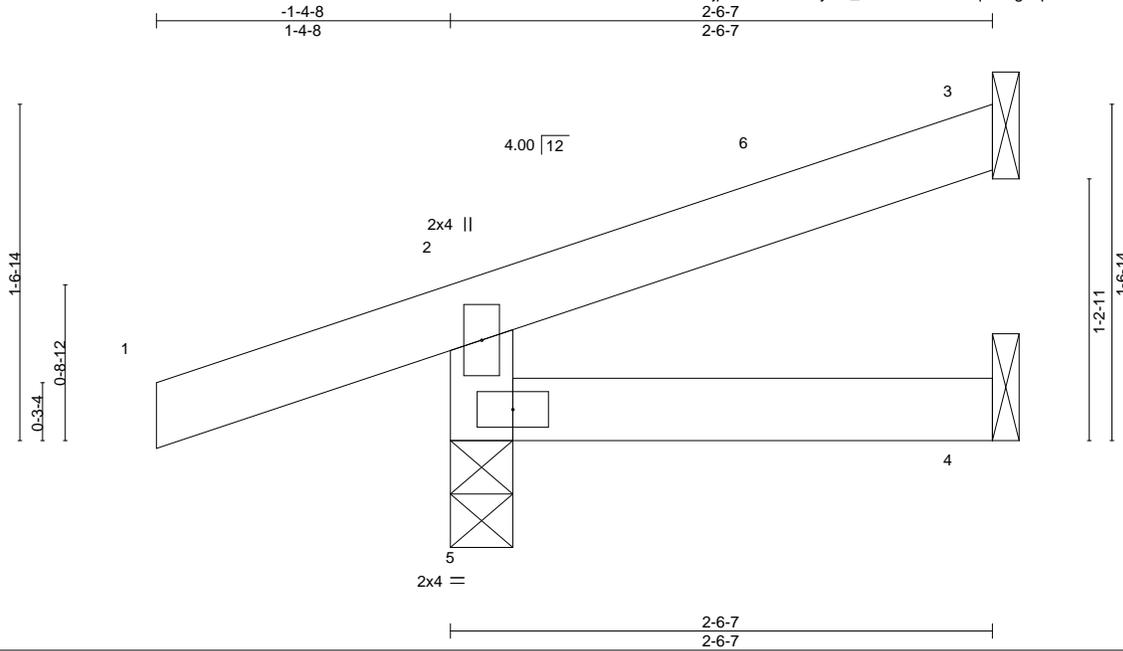

Scale = 1:10.7

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 25.0	Plate Grip DOL	1.15	TC 0.15	Vert(LL)	-0.00	4-5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	-0.00	4-5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-MR						Weight: 8 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 2-6-7 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 3=Mechanical, 4=Mechanical, 5=0-3-8
 Max Horz 5=46(LC 8)
 Max Uplift 3=-27(LC 12), 5=-81(LC 8)
 Max Grav 3=55(LC 1), 4=41(LC 3), 5=246(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 1-7-8, Interior(1) 1-7-8 to 2-5-11 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 3542878	Truss J11	Truss Type Jack-Open	Qty 1	Ply 1	Summit/186 Highland Meadows 158813639
----------------	--------------	-------------------------	----------	----------	--

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:13 2023 Page 1

ID:0efadeDmNQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

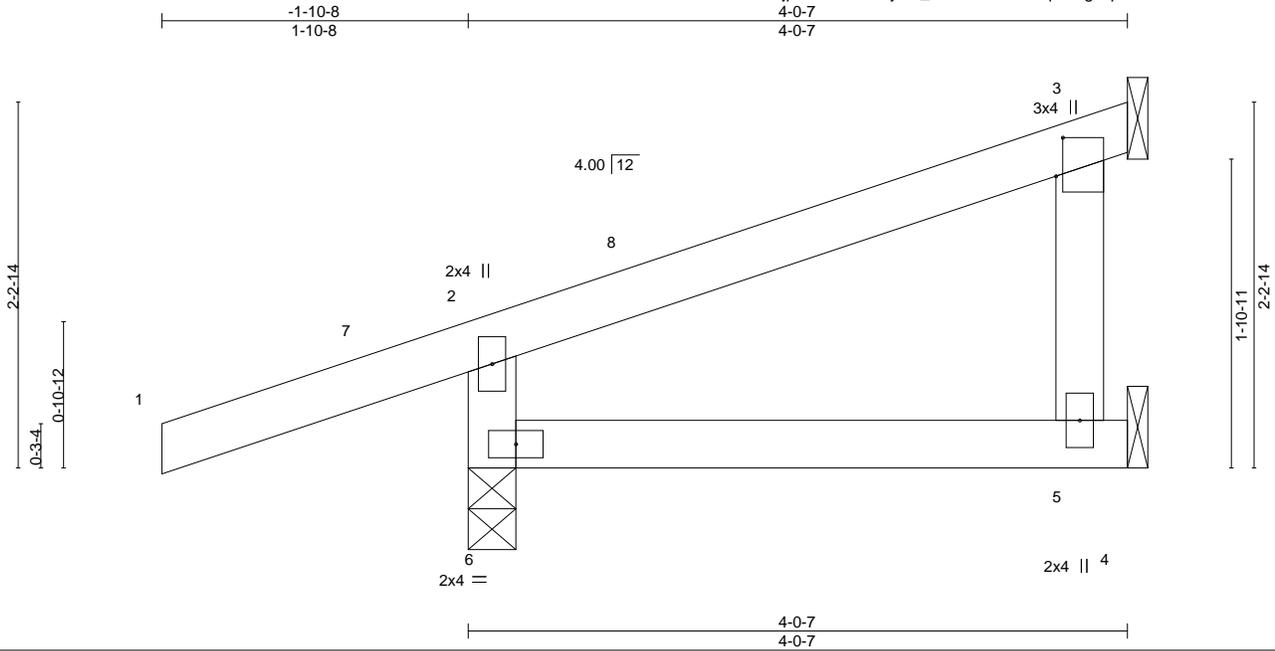


Plate Offsets (X, Y)--	[3:0-2-13,0-0-8]
------------------------	------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.25	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.10	Vert(LL) -0.01 5-6 >999 240		
BCLL 0.0	Lumber DOL 1.15	WB 0.00	Vert(CT) -0.01 5-6 >999 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.01 3 n/a n/a		
	Code IRC2018/TPI2014			Weight: 14 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 5=Mechanical, 3=Mechanical, 6=0-3-8
 Max Horz 6=67(LC 8)
 Max Uplift 3=-43(LC 12), 6=-107(LC 8)
 Max Grav 5=76(LC 3), 3=93(LC 1), 6=343(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-6=-300/194

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 3-8-15 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Bearing at joint(s) 6 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3 except (jt=lb) 6=107.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.



June 9, 2023

Job 3542878	Truss J13	Truss Type Half Hip	Qty 1	Ply 1	Summit/186 Highland Meadows	158813641
----------------	--------------	------------------------	----------	----------	-----------------------------	-----------

Builders First Source, Valley Center, KS 67147

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-nWbT7oWLNabTsGfS?GDugC5631ehm9nutnh3v2z8K_K
8.630 s Nov 21 2022 MiTek Industries, Inc. Thu Jun 8 14:07:21 2023 Page 1



Scale = 1:15.8

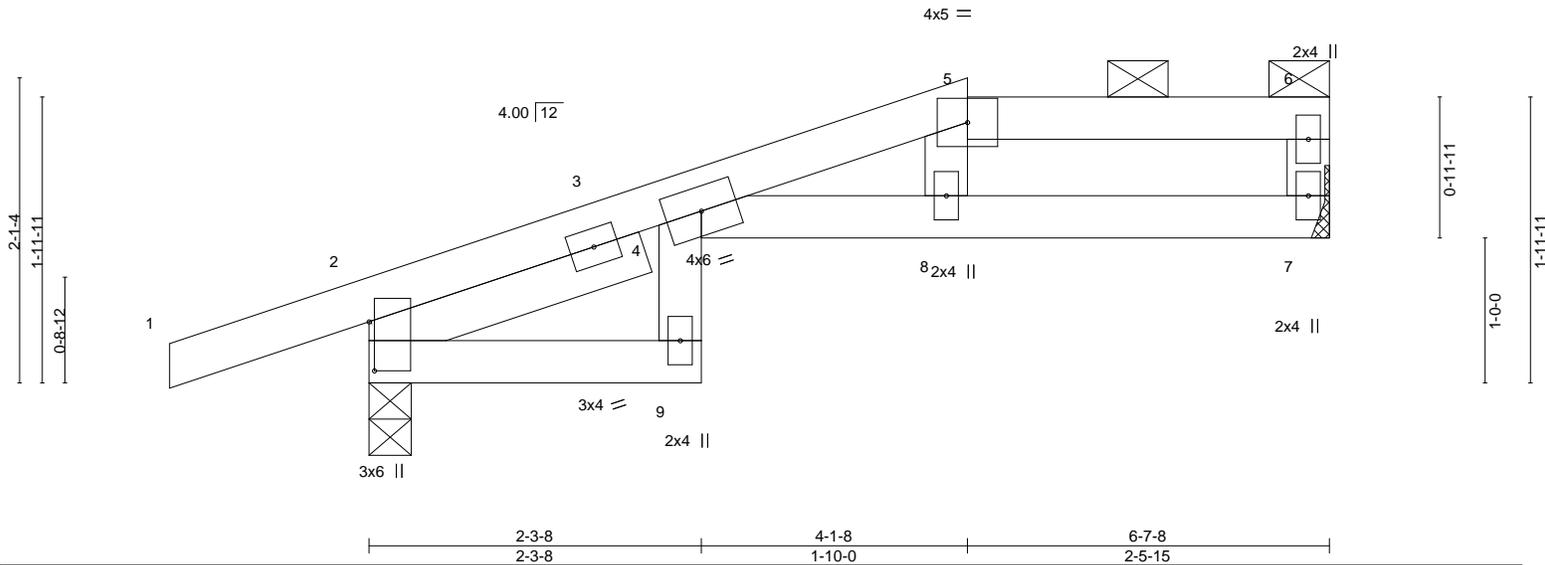


Plate Offsets (X,Y)-- [2:0-4-1,0-0-7]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.70	Vert(LL)	0.21	4-8	>376	240	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.88	Vert(CT)	-0.33	4-8	>233	180	
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.15	7	n/a	n/a	
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-AS						
								Weight: 21 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
SLIDER Left 2x4 SPF No.2 2-0-0

BRACING-
TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins: 5-6.
BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 7=Mechanical, 2=0-3-8
Max Horz 2=55(LC 8)
Max Uplift 7=-53(LC 8), 2=-103(LC 8)
Max Grav 7=281(LC 1), 2=398(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 4-11=-270/209
WEBS 5-8=-369/277

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 1-7-8, Interior(1) 1-7-8 to 4-1-8, Exterior(2E) 4-1-8 to 6-5-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 53 lb uplift at joint 7 and 103 lb uplift at joint 2.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 3542878	Truss J14	Truss Type Half Hip Girder	Qty 1	Ply 1	Summit/186 Highland Meadows I58813642
----------------	--------------	-------------------------------	----------	----------	--

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:16 2023 Page 1

ID:0efadeDmNQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:15.4

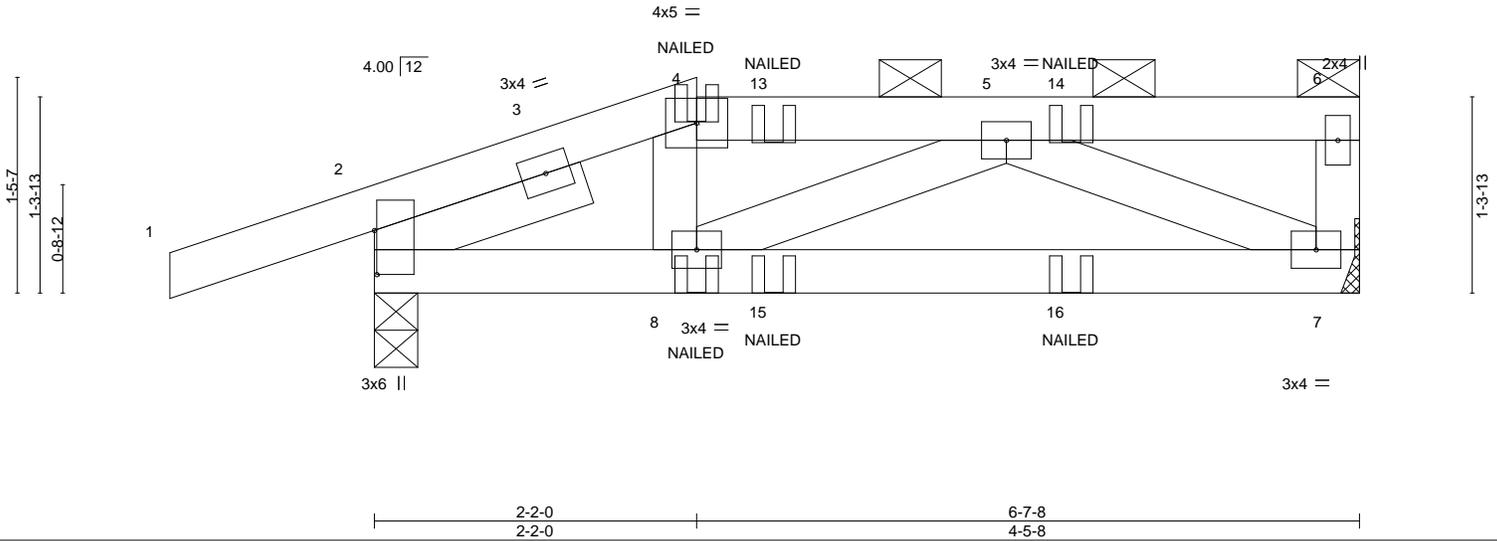


Plate Offsets (X,Y)--	[2:0-3-9,0-0-3]
-----------------------	-----------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.14	Vert(LL)	-0.02	7-8	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.21	Vert(CT)	-0.04	7-8	>999		
BCLL 0.0	Rep Stress Incr	NO	WB 0.07	Horz(CT)	0.00	7	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP					Weight: 26 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-6.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	
SLIDER Left 2x4 SPF No.2 1-6-0	

REACTIONS. (size) 2=0-3-8, 7=Mechanical
 Max Horz 2=43(LC 7)
 Max Uplift 2=-107(LC 4), 7=-51(LC 5)
 Max Grav 2=394(LC 1), 7=276(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-381/45, 4-5=-345/50
 BOT CHORD 2-8=-51/349, 7-8=-100/372
 WEBS 5-7=-410/102

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7 except (jt=lb) 2=107.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 9) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 10) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)
 Vert: 1-4=-70, 4-6=-70, 7-9=-20
 Concentrated Loads (lb)
 Vert: 8=-1(F) 15=5(F) 16=5(F)



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job 3542878	Truss J15	Truss Type Jack-Open Girder	Qty 1	Ply 1	Summit/186 Highland Meadows I58813643
----------------	--------------	--------------------------------	----------	----------	--

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:17 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

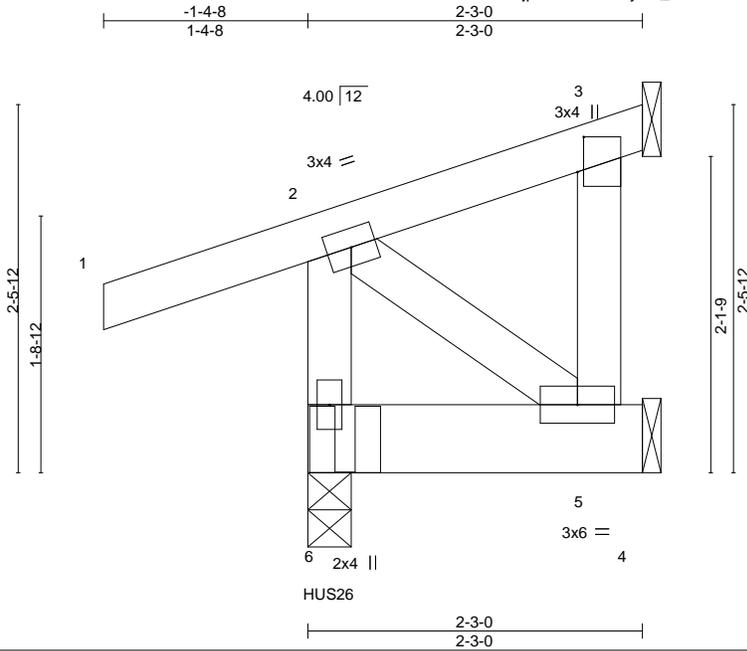

Scale = 1:15.4

Plate Offsets (X,Y)--	[3:0-2-13,0-0-8]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 25.0	Plate Grip DOL	1.15	TC 0.18	Vert(LL)	-0.00	6	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.01	Vert(CT)	-0.00	6	>999	180		
BCLL 0.0	Rep Stress Incr	NO	WB 0.01	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP							
									Weight: 14 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 2-3-0 oc purlins, except end verticals.
BOT CHORD 2x6 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 6=0-3-8, 3=Mechanical, 5=Mechanical
 Max Horz 6=52(LC 5)
 Max Uplift 6=-261(LC 4), 3=-11(LC 8), 5=-19(LC 5)
 Max Grav 6=1544(LC 1), 3=19(LC 1), 5=49(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 5 except (jt=lb) 6=261.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.
- Use Simpson Strong-Tie HUS26 (14-10d Girder, 6-10d Truss, Single Ply Girder) or equivalent at 0-1-12 from the left end to connect truss(es) to front face of bottom chord, skewed 0.0 deg.to the left, sloping 0.0 deg. down.
- Fill all nail holes where hanger is in contact with lumber.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-70, 2-3=-70, 4-6=-20
 Concentrated Loads (lb)
 Vert: 6=-1312(F)



June 9, 2023


Job 3542878	Truss J16	Truss Type Jack-Open	Qty 1	Ply 1	Summit/186 Highland Meadows I58813644
----------------	--------------	-------------------------	----------	----------	--

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:18 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

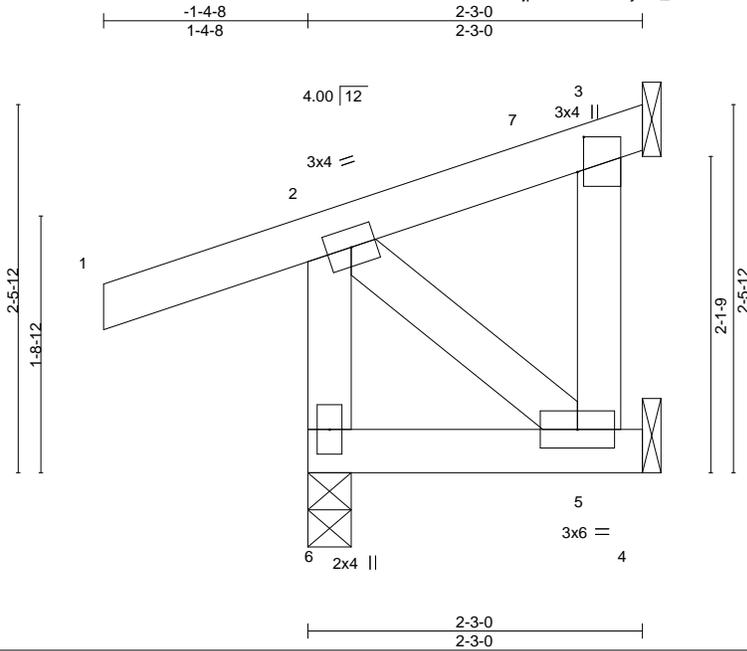

Scale = 1:15.4

Plate Offsets (X,Y)--	[3:0-2-13,0-0-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.15	Vert(LL) -0.00 6 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.03	Vert(CT) -0.00 5-6 >999 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.02	Horz(CT) -0.00 3 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-MP		Weight: 13 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 2-3-0 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 6=0-3-8, 3=Mechanical, 5=Mechanical
 Max Horz 6=54(LC 9)
 Max Uplift 6=65(LC 8), 3=11(LC 12), 5=22(LC 9)
 Max Grav 6=232(LC 1), 3=19(LC 1), 5=49(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 1-7-8, Interior(1) 1-7-8 to 1-11-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 3, 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.



June 9, 2023


Job 3542878	Truss J17	Truss Type Jack-Open	Qty 2	Ply 1	Summit/186 Highland Meadows I58813645
----------------	--------------	-------------------------	----------	----------	--

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:19 2023 Page 1

ID:0efadeDmNQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

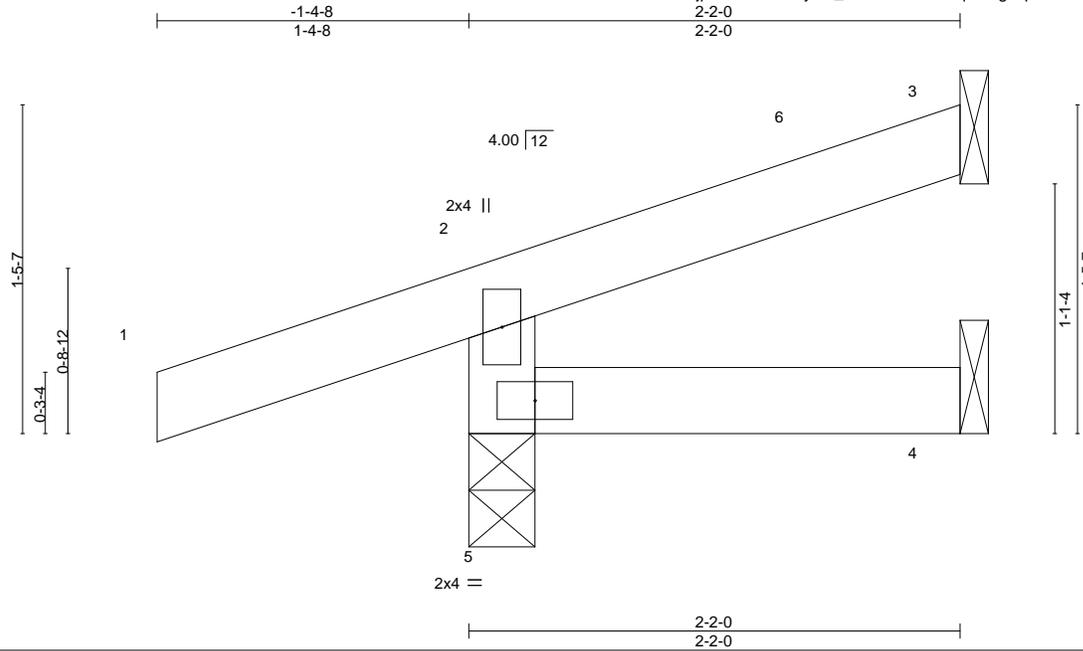

Scale = 1:10.1

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 25.0	Plate Grip DOL	1.15	TC 0.15	Vert(LL)	0.00	5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	-0.00	4-5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-MR							
									Weight: 7 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 3=Mechanical, 4=Mechanical, 5=0-3-8
 Max Horz 5=42(LC 8)
 Max Uplift 3=-21(LC 12), 5=-82(LC 8)
 Max Grav 3=38(LC 1), 4=33(LC 3), 5=236(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 1-7-8, Interior(1) 1-7-8 to 2-1-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss connections.
- 4) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 3542878	Truss K01	Truss Type Monopitch	Qty 3	Ply 1	Summit/186 Highland Meadows I58813646
----------------	--------------	-------------------------	----------	----------	--

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:20 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:22.1

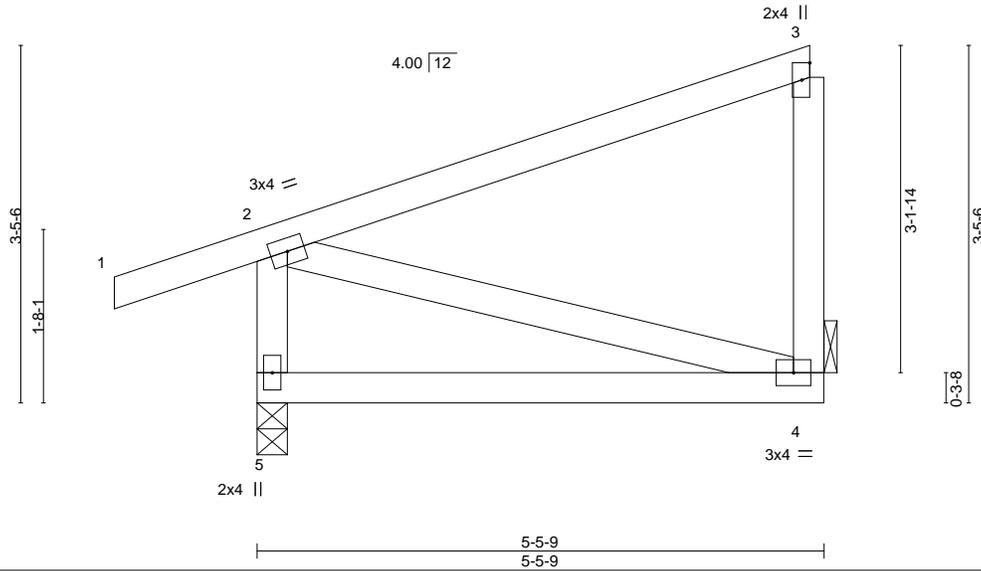

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.38	Vert(LL)	-0.04 4-5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.28	Vert(CT)	-0.09 4-5	>725	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	-0.00 4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 25 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except end verticals.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 5=0-3-8, 4=Mechanical
 Max Horz 5=128(LC 11)
 Max Uplift 5=94(LC 8), 4=50(LC 9)
 Max Grav 5=355(LC 1), 4=217(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-5=-303/225

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 1-7-8, Interior(1) 1-7-8 to 5-3-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 4.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job 3542878	Truss K02	Truss Type Monopitch	Qty 1	Ply 1	Summit/186 Highland Meadows Job Reference (optional)	158813647
----------------	--------------	-------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:21 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

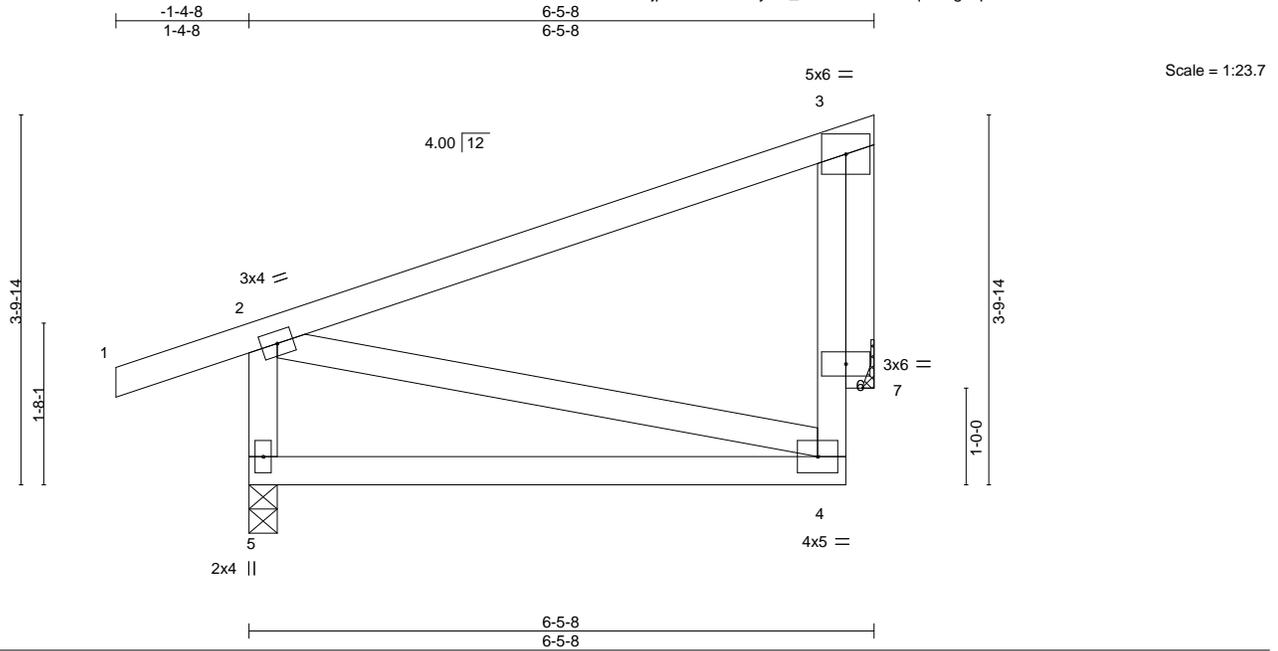

Scale = 1:23.7

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.33	Vert(LL)	-0.07 4-5	>999	240	MT20	197/144
BCDL 10.0	Lumber DOL	1.15	BC 0.37	Vert(CT)	-0.14 4-5	>521	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.25	Horz(CT)	0.02 7	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 31 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2
 OTHERS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except end verticals.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 5=0-3-8, 7=Mechanical
 Max Horz 5=99(LC 9)
 Max Uplift 5=-85(LC 8), 7=-69(LC 12)
 Max Grav 5=400(LC 1), 7=236(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-5=-341/216

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 1-7-8, Interior(1) 1-7-8 to 6-0-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 7.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 3542878	Truss K03	Truss Type Half Hip	Qty 1	Ply 1	Summit/186 Highland Meadows 158813648
----------------	--------------	------------------------	----------	----------	--

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:22 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f



Scale = 1:23.5

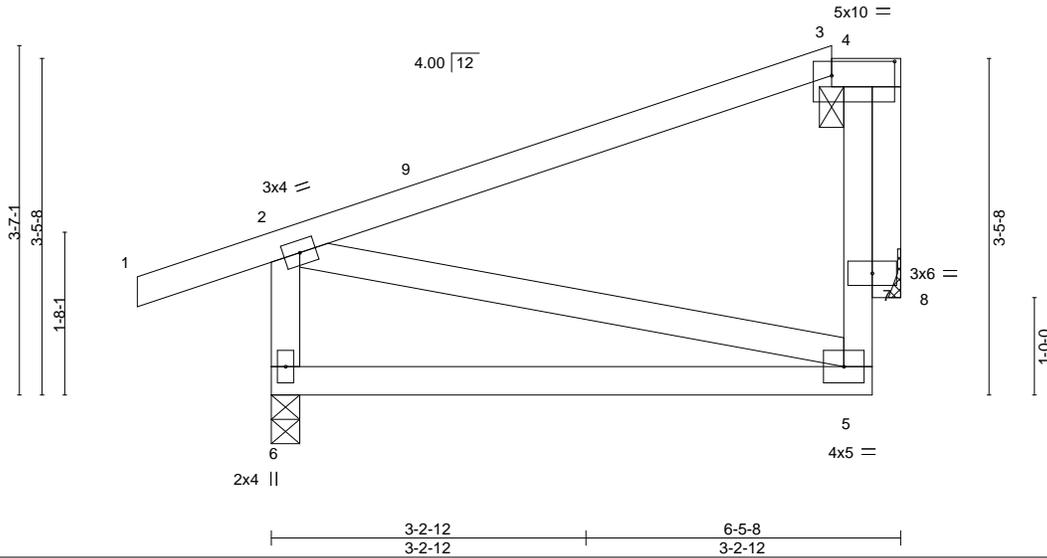

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.47	Vert(LL)	-0.07	5-6	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.37	Vert(CT)	-0.14	5-6	>522		
BCLL 0.0	Rep Stress Incr	YES	WB 0.08	Horz(CT)	-0.01	8	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-AS						
								Weight: 30 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	
OTHERS 2x4 SPF No.2	

REACTIONS. (size) 6=0-3-8, 8=Mechanical
 Max Horz 6=95(LC 9)
 Max Uplift 6=-87(LC 8), 8=-58(LC 12)
 Max Grav 6=400(LC 1), 8=236(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-6=-341/177

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 1-7-8, Interior(1) 1-7-8 to 5-9-0, Exterior(2E) 5-9-0 to 6-0-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 8.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 9, 2023

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>16023 Swingley Ridge Rd Chesterfield, MO 63017</p>
--	---


Job 3542878	Truss K04	Truss Type Half Hip	Qty 1	Ply 1	Summit/186 Highland Meadows I58813649
----------------	--------------	------------------------	----------	----------	--

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:23 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RIC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

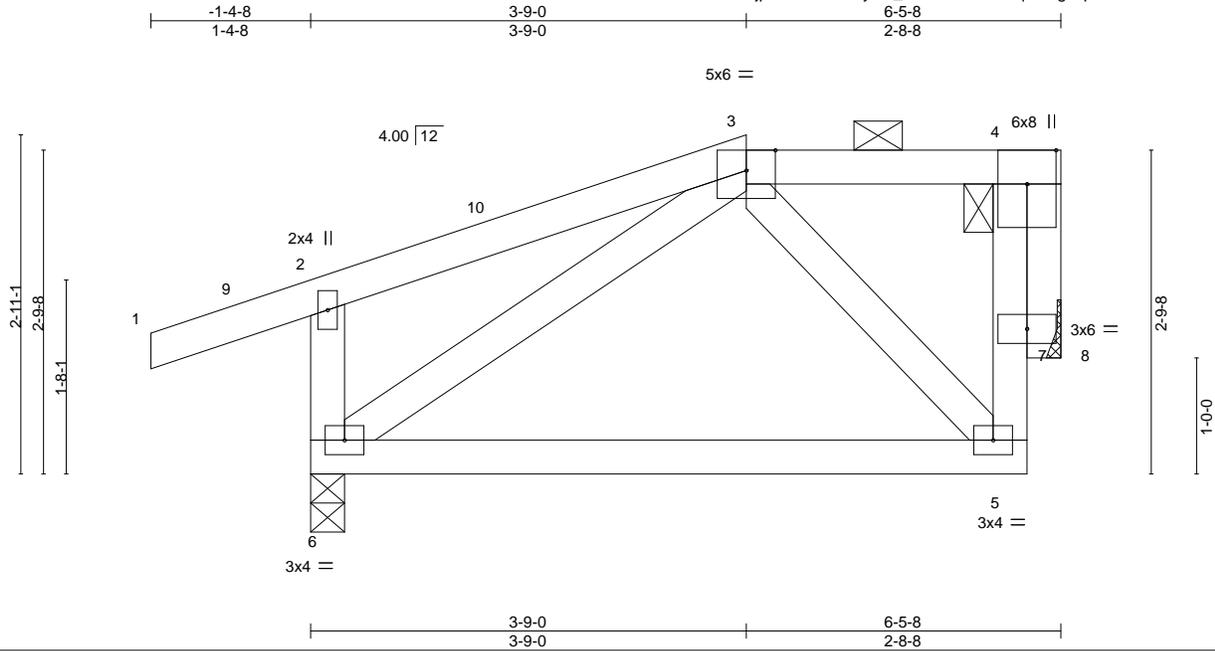

Scale = 1:19.7

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.15	Vert(LL)	-0.07 5-6	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.38	Vert(CT)	-0.14 5-6	>522	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.01 8	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 30 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2
 OTHERS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.). 3-4.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 6=0-3-8, 8=Mechanical
 Max Horz 6=77(LC 9)
 Max Uplift 6=-100(LC 8), 8=-51(LC 8)
 Max Grav 6=400(LC 1), 8=236(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-6=-255/207

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 1-7-8, Interior(1) 1-7-8 to 3-9-0, Exterior(2E) 3-9-0 to 6-0-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 8.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 3542878	Truss K05	Truss Type Half Hip Girder	Qty 1	Ply 1	Summit/186 Highland Meadows I58813650
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					Job Reference (optional)

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:24 2023 Page 1
ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale: 3/4"=1'

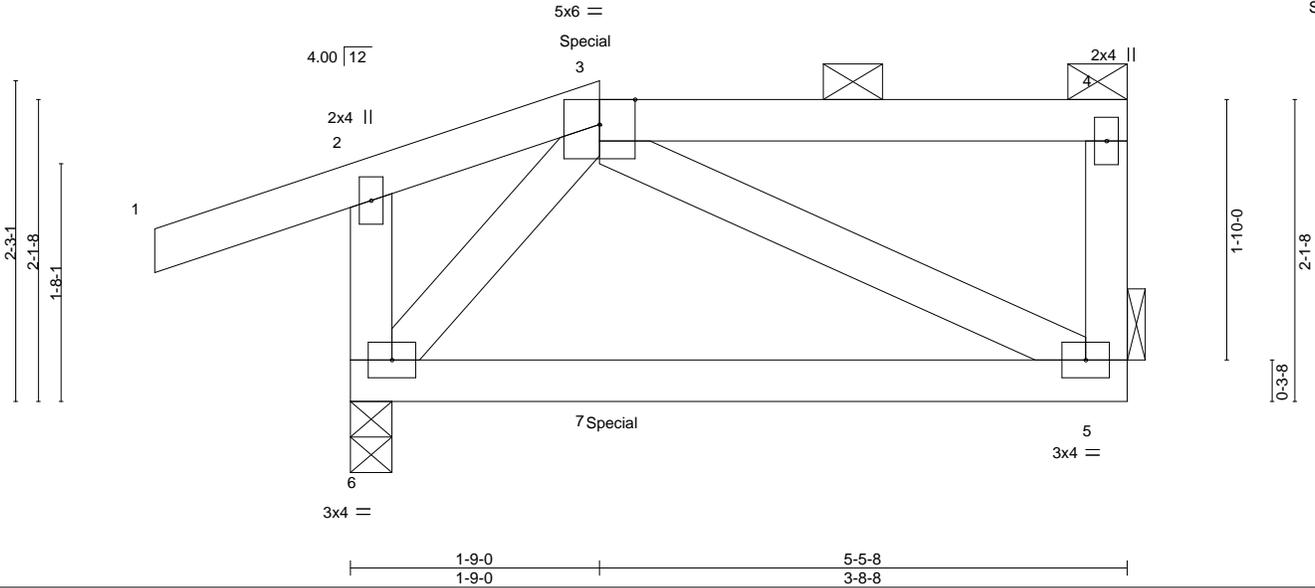

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL. in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.26	Vert(LL) -0.04	5-6	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.27	Vert(CT) -0.07	5-6	>844		
BCLL 0.0	Rep Stress Incr	NO	WB 0.02	Horz(CT) -0.00	5	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP				Weight: 24 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 5-5-8 oc purlins, except end verticals, and 2-0-0 oc purlins: 3-4.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 6=0-3-8, 5=Mechanical
 Max Horz 6=74(LC 7)
 Max Uplift 6=121(LC 4), 5=63(LC 5)
 Max Grav 6=317(LC 1), 5=200(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5 except (jt=lb) 6=121.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 9) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 82 lb down and 112 lb up at 1-9-0 on top chord, and 10 lb down and 24 lb up at 1-9-0, and 15 lb down and 44 lb up at 1-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 10) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-70, 2-3=-70, 3-4=-70, 5-6=-20
 Concentrated Loads (lb)
 Vert: 3=32(B) 7=22(B)



June 9, 2023


Job 3542878	Truss K06	Truss Type Jack-Open	Qty 1	Ply 1	Summit/186 Highland Meadows I58813651
----------------	--------------	-------------------------	----------	----------	--

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:25 2023 Page 1

ID:0efadeDmNQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

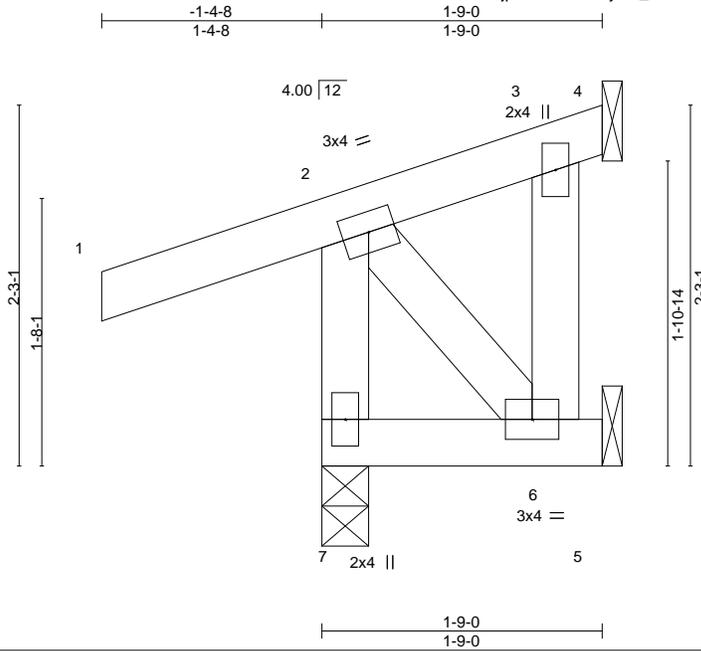

Scale = 1:14.3

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.15	Vert(LL)	-0.00	7	>999	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.02	Vert(CT)	-0.00	7	>999		
BCLL 0.0	Lumber DOL 1.15	WB 0.03	Horz(CT)	-0.00	4	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MP						
	Code IRC2018/TPI2014						Weight: 11 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 1-9-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 7=0-3-8, 4=Mechanical, 5=Mechanical
 Max Horz 7=51(LC 9)
 Max Uplift 7=-66(LC 8), 4=-26(LC 8), 5=-23(LC 1)
 Max Grav 7=229(LC 1), 4=44(LC 1), 5=10(LC 8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 4, 5.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job 3542878	Truss K07	Truss Type Monopitch	Qty 4	Ply 1	Summit/186 Highland Meadows Job Reference (optional)	I58813652
----------------	--------------	-------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:26 2023 Page 1

ID:0efadeDmNQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

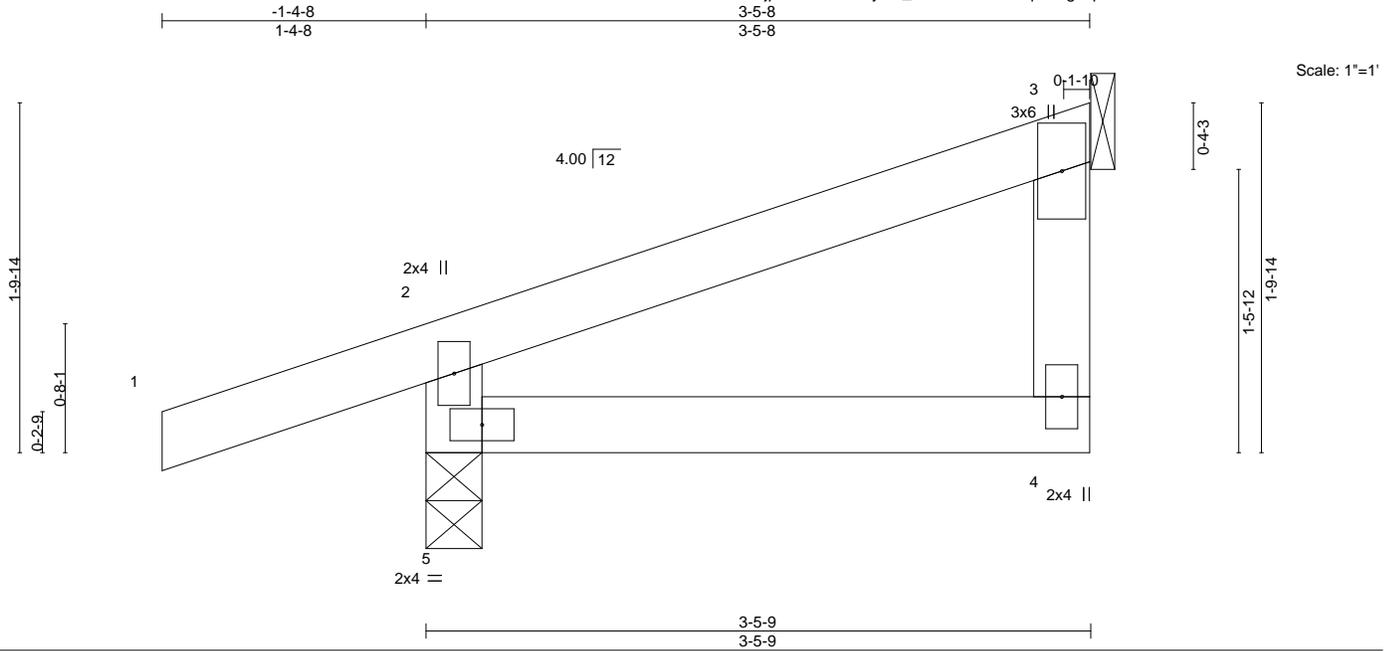

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.15	Vert(LL)	-0.00	4-5	>999	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.07	Vert(CT)	-0.01	4-5	>999		
BCLL 0.0	Lumber DOL 1.15	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MR						
	Code IRC2018/TPI2014						Weight: 11 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 3-5-8 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 5=0-3-8, 3=Mechanical
 Max Horz 5=67(LC 9)
 Max Uplift 5=89(LC 8), 3=25(LC 12)
 Max Grav 5=275(LC 1), 3=117(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 1-7-8, Interior(1) 1-7-8 to 3-3-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss connections.
 - 4) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.



June 9, 2023


Job 3542878	Truss K08	Truss Type Jack-Open	Qty 2	Ply 1	Summit/186 Highland Meadows I58813653
----------------	--------------	-------------------------	----------	----------	--

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:27 2023 Page 1

ID:0efadeDmNQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

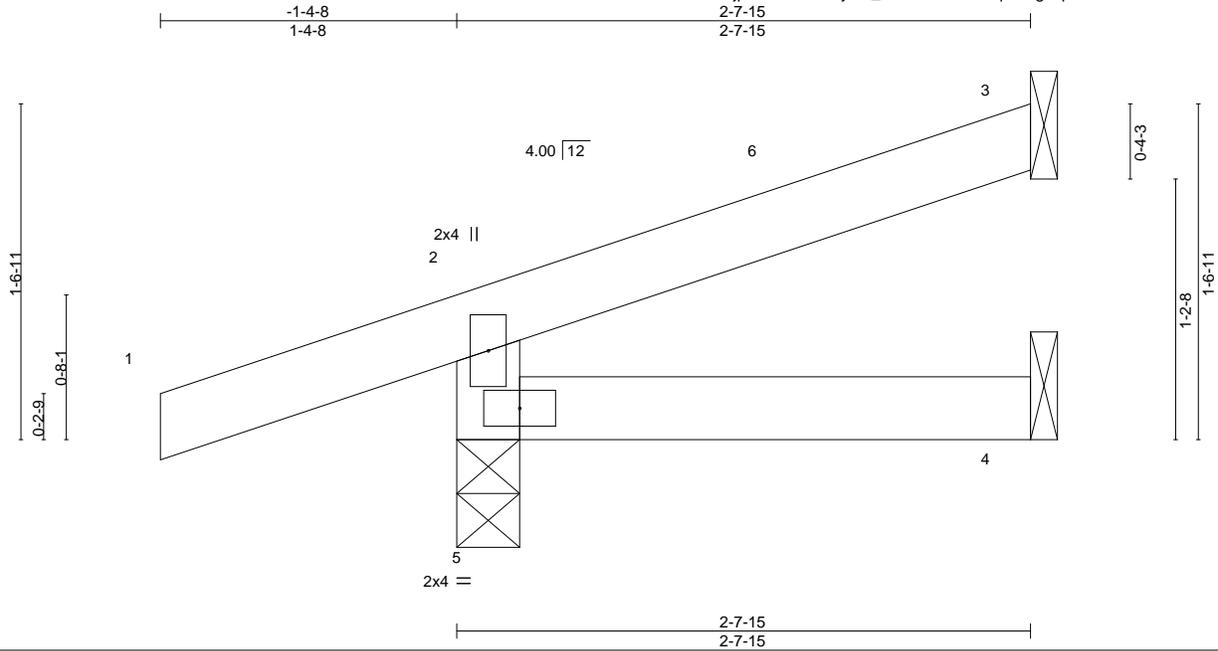

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 25.0	Plate Grip DOL	1.15	TC 0.15	Vert(LL)	-0.00	4-5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	-0.00	4-5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-MR						Weight: 8 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 2-7-15 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 3=Mechanical, 4=Mechanical, 5=0-3-8
 Max Horz 5=48(LC 8)
 Max Uplift 3=-28(LC 12), 5=-82(LC 8)
 Max Grav 3=60(LC 1), 4=43(LC 3), 5=250(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) - 1-4-8 to 1-7-8, Interior(1) 1-7-8 to 2-7-3 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 5.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 9, 2023

Job 3542878	Truss K09	Truss Type Jack-Open	Qty 1	Ply 1	Summit/186 Highland Meadows I58813654
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					Job Reference (optional)

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:28 2023 Page 1
 ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcD0i7J4zJC?f

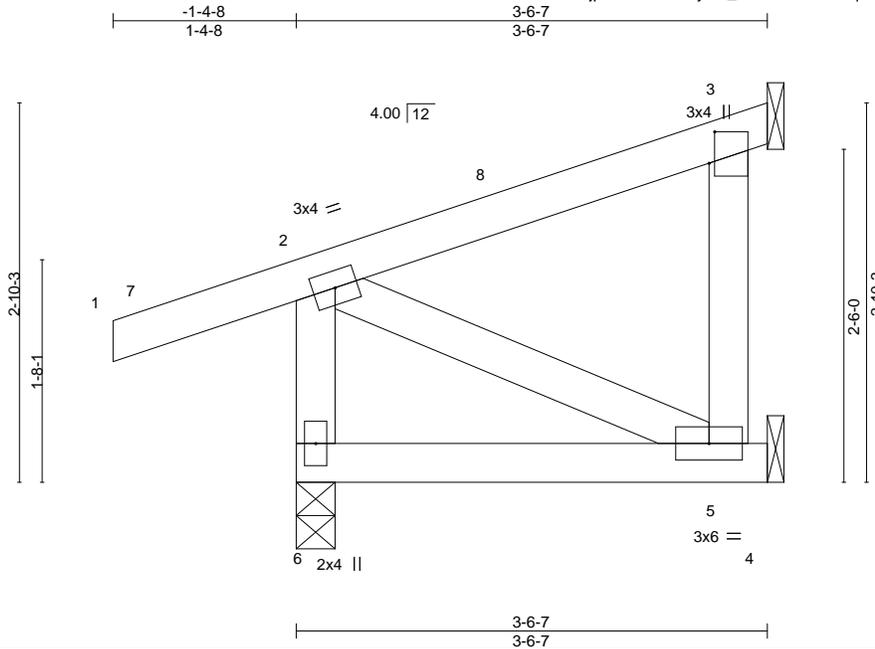

Scale = 1:17.2

Plate Offsets (X,Y)--	[3:0-2-13,0-0-8]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 25.0	Plate Grip DOL	1.15	TC 0.15	Vert(LL)	-0.01	5-6	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.09	Vert(CT)	-0.01	5-6	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-MP							
									Weight: 17 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 3-6-7 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 6=0-3-8, 3=Mechanical, 5=Mechanical
 Max Horz 6=63(LC 9)
 Max Uplift 6=67(LC 8), 3=36(LC 12), 5=8(LC 8)
 Max Grav 6=272(LC 1), 3=82(LC 1), 5=74(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-4-8 to 1-7-8, Interior(1) 1-7-8 to 3-2-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 3, 5.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.



June 9, 2023


Job 3542878	Truss K10	Truss Type Jack-Open	Qty 1	Ply 1	Summit/186 Highland Meadows I58813655
----------------	--------------	-------------------------	----------	----------	--

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:29 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

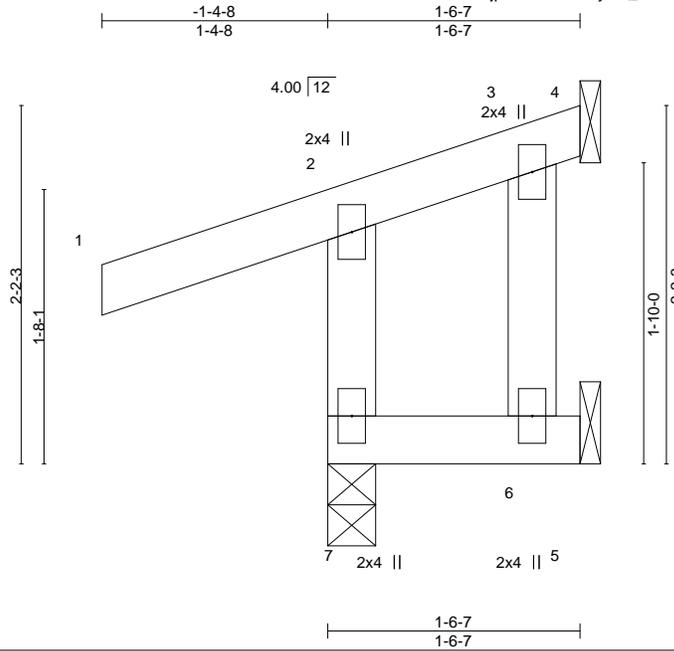

Scale = 1:14.0

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.15	Vert(LL)	0.00	7	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	0.00	7	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.01	Horz(CT)	-0.01	4	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-MP					Weight: 8 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 1-6-7 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 7=0-3-8, 4=Mechanical, 5=Mechanical
 Max Horz 7=49(LC 9)
 Max Uplift 7=68(LC 8), 4=21(LC 9), 5=17(LC 1)
 Max Grav 7=227(LC 1), 4=21(LC 1), 5=7(LC 10)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 4, 5.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 3542878	Truss K11	Truss Type Jack-Open	Qty 1	Ply 1	Summit/186 Highland Meadows I58813656
----------------	--------------	-------------------------	----------	----------	--


Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:30 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Job Reference (optional)

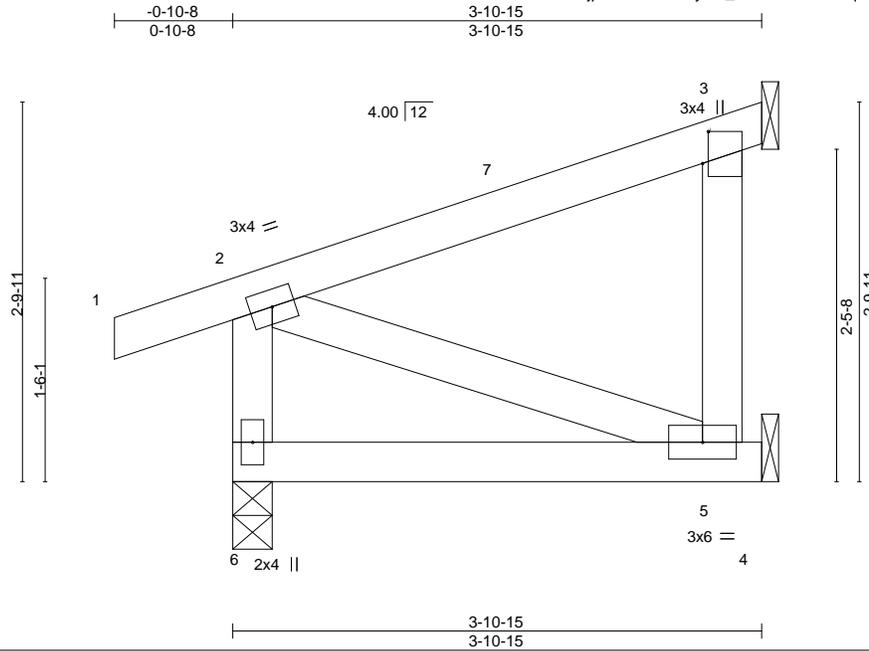

Scale = 1:17.0

Plate Offsets (X,Y)--	[3:0-2-13,0-0-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.18	Vert(LL) -0.01 5-6 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.12	Vert(CT) -0.02 5-6 >999 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.03	Horz(CT) -0.00 3 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-MP		Weight: 18 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 3-10-15 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 6=0-3-8, 3=Mechanical, 5=Mechanical
 Max Horz 6=60(LC 9)
 Max Uplift 6=-47(LC 8), 3=-46(LC 12), 5=-1(LC 8)
 Max Grav 6=238(LC 1), 3=111(LC 1), 5=82(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 3-7-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 3, 5.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.



June 9, 2023

Job 3542878	Truss K12	Truss Type Jack-Open	Qty 1	Ply 1	Summit/186 Highland Meadows I58813657
----------------	--------------	-------------------------	----------	----------	--

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:31 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:13.7

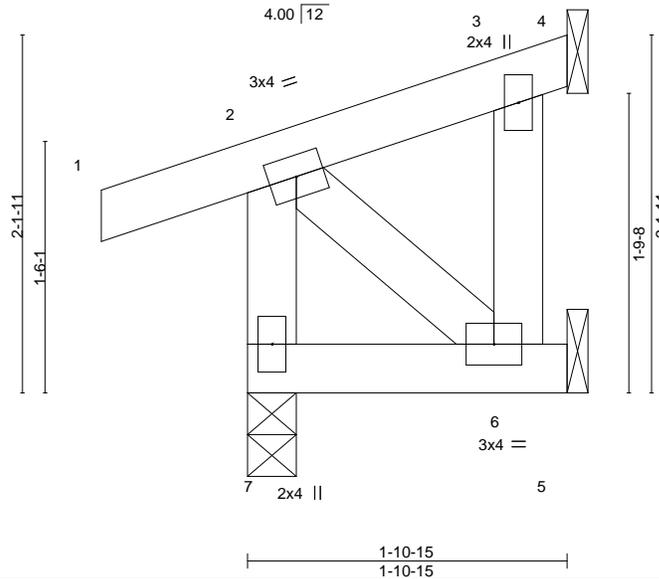

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.07	Vert(LL)	-0.00	7	>999	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.02	Vert(CT)	-0.00	7	>999		
BCLL 0.0	Lumber DOL 1.15	WB 0.02	Horz(CT)	-0.00	4	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MP						
	Code IRC2018/TPI2014						Weight: 10 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 1-10-15 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 7=0-3-8, 4=Mechanical, 5=Mechanical
 Max Horz 7=46(LC 9)
 Max Uplift 7=-40(LC 8), 4=-15(LC 8), 5=-18(LC 9)
 Max Grav 7=171(LC 1), 4=36(LC 1), 5=22(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 4, 5.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 3542878	Truss LG1	Truss Type GABLE	Qty 1	Ply 1	Summit/186 Highland Meadows I58813658
----------------	--------------	---------------------	----------	----------	--

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:32 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:68.0

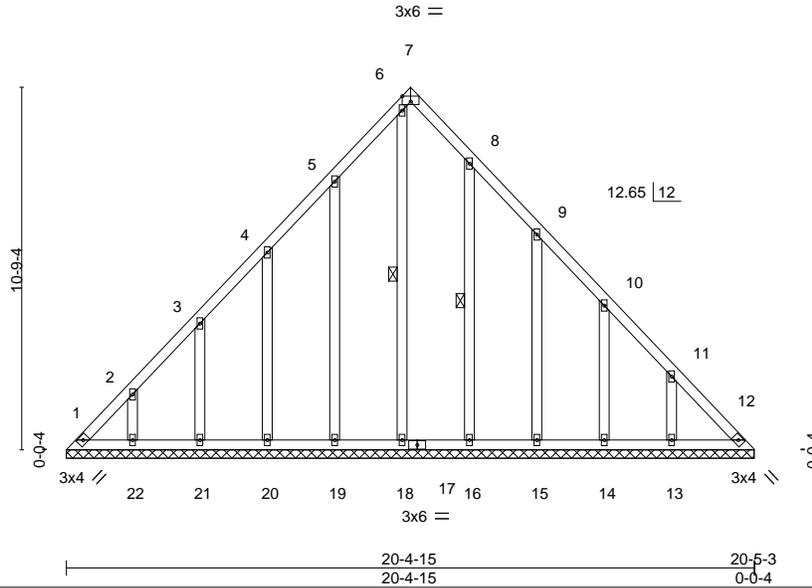


Plate Offsets (X,Y)--	[7:Edge,0-1-15]
-----------------------	-----------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.08	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.05	Vert(LL) n/a - n/a 999		
BCLL 0.0	Lumber DOL 1.15	WB 0.20	Vert(CT) n/a - n/a 999		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.01 12 n/a n/a		
	Code IRC2018/TPI2014			Weight: 113 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SPF No.2	WEBS 1 Row at midpt 8-16, 6-18

REACTIONS. All bearings 20-4-15.
 (lb) - Max Horz 1=248(LC 8)
 Max Uplift All uplift 100 lb or less at joint(s) 12, 16 except 1=115(LC 10), 13=135(LC 13), 14=106(LC 13), 15=127(LC 13), 19=131(LC 12), 20=112(LC 12), 21=114(LC 12), 22=115(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 12, 13, 14, 15, 16, 18, 19, 20, 21, 22 except 1=256(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 11-12=-316/223, 1-2=-368/231, 2-3=-263/176

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-1 to 3-4-1, Interior(1) 3-4-1 to 10-2-9, Exterior(2R) 10-2-9 to 13-2-9, Interior(1) 13-2-9 to 20-1-2 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12, 16 except (jt=lb) 1=115, 13=135, 14=106, 15=127, 19=131, 20=112, 21=114, 22=115.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 9, 2023

Job 3542878	Truss LG2	Truss Type GABLE	Qty 1	Ply 1	Summit/186 Highland Meadows 158813659
----------------	--------------	---------------------	----------	----------	--

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,


8.630 s Nov 19 2022 MiTek Industries, Inc. Wed Jun 7 16:50:34 2023 Page 1

ID:0efadeDmNQQjpu?sPTQBQ5yKY_s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCdoi7J4zJC?f



4x5 =

Scale = 1:49.0

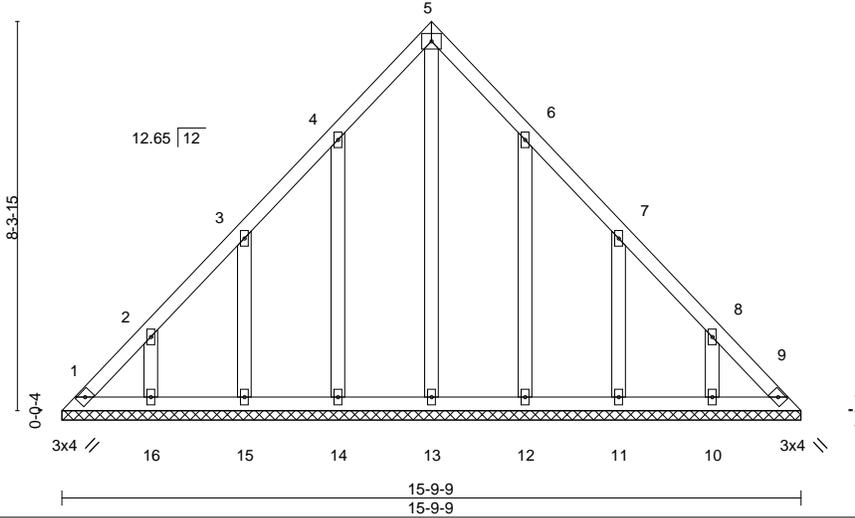

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 25.0	Plate Grip DOL	1.15	TC 0.06	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.16	Horz(CT)	0.00	9	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						Weight: 76 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 OTHERS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 15-9-9.
 (lb) - Max Horz 1=190(LC 9)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 9 except 14=-116(LC 12), 15=-116(LC 12), 16=-112(LC 12), 12=-115(LC 13), 11=-116(LC 13), 10=-112(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 1, 9, 13, 14, 15, 16, 12, 11, 10

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-252/161

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-1 to 3-4-1, Interior(1) 3-4-1 to 7-10-13, Exterior(2R) 7-10-13 to 10-10-13, Interior(1) 10-10-13 to 15-5-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) All plates are 2x4 MT20 unless otherwise indicated.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 9 except (jt=lb) 14=116, 15=116, 16=112, 12=115, 11=116, 10=112.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 9, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

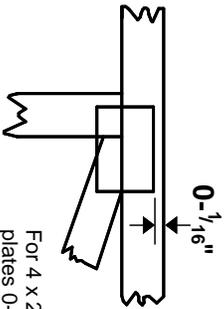

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MITek 20/20 software** or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TPI 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing, Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

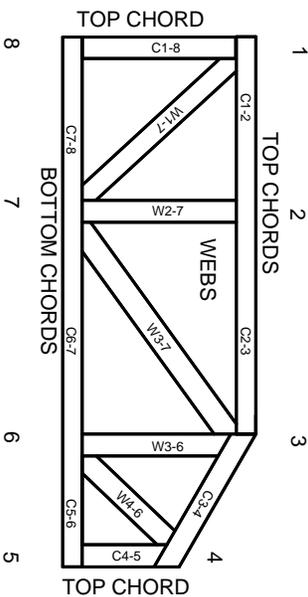

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TPI 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability/bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T or I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.



MITek Engineering Reference Sheet: Mill-7473 rev. 5/19/2020