



RE: 3603730  
Summit/193 Highland Meadows

MiTek USA, Inc.  
16023 Swingley Ridge Rd  
Chesterfield, MO 63017  
314-434-1200

**Site Information:**

Customer: Project Name: 3603730  
Lot/Block:  
Address:  
City:

Model:  
Subdivision:  
State:

**General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):**

Design Code: IRC2018/TPI2014  
Wind Code: ASCE 7-16  
Roof Load: 45.0 psf

Design Program: MiTek 20/20 8.6  
Wind Speed: 115 mph  
Floor Load: N/A psf

This package includes 75 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	I58837488	A1	6/12/2023	21	I58837508	CJ8	6/12/2023
2	I58837489	A2	6/12/2023	22	I58837509	CJ9	6/12/2023
3	I58837490	A3	6/12/2023	23	I58837510	CJ10	6/12/2023
4	I58837491	A4	6/12/2023	24	I58837511	D1	6/12/2023
5	I58837492	A5	6/12/2023	25	I58837512	D2	6/12/2023
6	I58837493	A6	6/12/2023	26	I58837513	E1	6/12/2023
7	I58837494	A7	6/12/2023	27	I58837514	E2	6/12/2023
8	I58837495	A8	6/12/2023	28	I58837515	E3	6/12/2023
9	I58837496	A9	6/12/2023	29	I58837516	E4	6/12/2023
10	I58837497	B1	6/12/2023	30	I58837517	F1	6/12/2023
11	I58837498	B1A	6/12/2023	31	I58837518	F2	6/12/2023
12	I58837499	B2	6/12/2023	32	I58837519	F3	6/12/2023
13	I58837500	B3	6/12/2023	33	I58837520	F4	6/12/2023
14	I58837501	CJ1	6/12/2023	34	I58837521	J1	6/12/2023
15	I58837502	CJ2	6/12/2023	35	I58837522	J2	6/12/2023
16	I58837503	CJ3	6/12/2023	36	I58837523	J3	6/12/2023
17	I58837504	CJ4	6/12/2023	37	I58837524	J4	6/12/2023
18	I58837505	CJ5	6/12/2023	38	I58837525	J5	6/12/2023
19	I58837506	CJ6	6/12/2023	39	I58837526	J6	6/12/2023
20	I58837507	CJ7	6/12/2023	40	I58837527	J7	6/12/2023

The truss drawing(s) referenced above have been prepared by  
MiTek USA, Inc. under my direct supervision  
based on the parameters provided by Builders FirstSource (Valley Center).  
Truss Design Engineer's Name: Sevier, Scott  
My license renewal date for the state of Missouri is December 31, 2023.  
Missouri COA: 001193

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek. Any project specific information included is for MiTek customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



June 12, 2023



RE: 3603730 - Summit/193 Highland Meadows

MiTek USA, Inc.  
16023 Swingley Ridge Rd  
Chesterfield, MO 63017  
314-434-1200

**Site Information:**

Project Customer:      Project Name: 3603730

Lot/Block:

Subdivision:

Address:

City, County:

State:


No.	Seal#	Truss Name	Date
41	I58837528	J8	6/12/2023
42	I58837529	J9	6/12/2023
43	I58837530	J10	6/12/2023
44	I58837531	J11	6/12/2023
45	I58837532	J12	6/12/2023
46	I58837533	J13	6/12/2023
47	I58837534	J14	6/12/2023
48	I58837535	J15	6/12/2023
49	I58837536	J16	6/12/2023
50	I58837537	J17	6/12/2023
51	I58837538	J18	6/12/2023
52	I58837539	J19	6/12/2023
53	I58837540	J20	6/12/2023
54	I58837541	J21	6/12/2023
55	I58837542	J22	6/12/2023
56	I58837543	J23	6/12/2023
57	I58837544	J24	6/12/2023
58	I58837545	J25	6/12/2023
59	I58837546	J26	6/12/2023
60	I58837547	J27	6/12/2023
61	I58837548	J28	6/12/2023
62	I58837549	J29	6/12/2023
63	I58837550	L1	6/12/2023
64	I58837551	LG1	6/12/2023
65	I58837552	LG2	6/12/2023
66	I58837553	LG3	6/12/2023
67	I58837554	P1	6/12/2023
68	I58837555	P2	6/12/2023
69	I58837556	P3	6/12/2023
70	I58837557	P4	6/12/2023
71	I58837558	P5	6/12/2023
72	I58837559	P6	6/12/2023
73	I58837560	V1	6/12/2023
74	I58837561	V2	6/12/2023
75	I58837562	V3	6/12/2023

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:12:37 2023 Page 1

ID:icBMJaMgT1gasuYjx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWCrCDoi7J4zJC?f

-1-10-8	3-8-14	7-2-4	11-6-4	16-0-0	20-5-12	24-9-12	28-3-2	32-0-0	33-10-8
1-10-8	3-8-14	3-5-6	4-4-0	4-5-12	4-5-12	4-4-0	3-5-6	3-8-14	1-10-8

Scale = 1:60.0

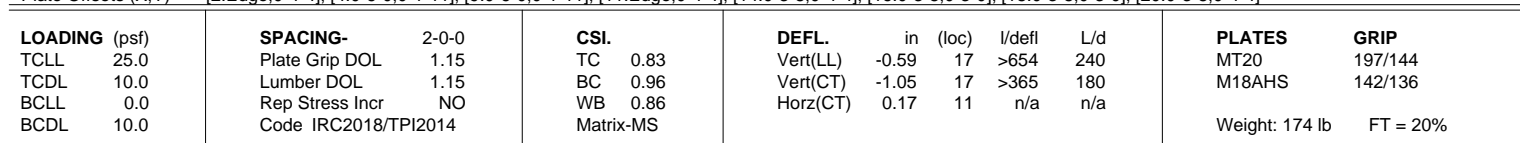


**REACTIONS.** (size) 2=0-3-8, 11=0-3-8  
 Max Horz 2=45(LC 25)  
 Max Uplift 2=-790(LC 4), 11=-790(LC 5)  
 Max Grav 2=3398(LC 1), 11=3398(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-7148/1577, 3-4=-8415/1909, 4-5=-10926/2522, 5-6=-11885/2732, 6-8=-11885/2732, 8-9=-10926/2522, 9-10=-8415/1910, 10-11=-7148/1578

BOT CHORD 2-21=-1466/6701, 20-21=-1466/6701, 18-20=-1762/7978, 17-18=-2452/10919, 16-17=-2421/10919, 14-16=-1717/7978, 13-14=-1422/6702, 11-13=-1422/6702

WEBS 3-21=-902/250, 3-20=-362/1573, 4-20=-122/682, 4-18=-847/3525, 5-18=-1162/314, 5-17=-325/1180, 6-17=-343/115, 8-17=-326/1179, 8-16=-1162/314, 9-16=-847/3524, 9-14=-122/682, 10-14=-363/1573, 10-13=-902/250

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Provide adequate drainage to prevent water ponding.
  - 4) All plates are MT20 plates unless otherwise indicated.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 790 lb uplift at joint 2 and 790 lb uplift at joint 11.
  - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - 9) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 547 lb down and 132 lb up at 7-2-4, 284 lb down and 91 lb up at 8-0-12, 284 lb down and 91 lb up at 10-0-12, 284 lb down and 91 lb up at 12-0-12, 284 lb down and 91 lb up at 14-0-12, 284 lb down and 91 lb up at 16-0-0, 284 lb down and 91 lb up at 17-11-4, 284 lb down and 91 lb up at 19-11-4, 284 lb down and 91 lb up at 21-11-4, and 284 lb down and 91 lb up at 23-11-4, and 547 lb down and 132 lb up at 24-9-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- On the L-001 CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- 

June 12, 2023



June 12.2023

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837488
3603730	A1	Hip Girder	1	1	Job Reference (optional)	

**LOAD CASE(S)** Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-4=-70, 4-9=-70, 9-12=-70, 22-25=-20

Concentrated Loads (lb)

Vert: 19=-284(B) 20=-547(B) 17=-284(B) 14=-547(B) 15=-284(B) 28=-284(B) 29=-284(B) 30=-284(B) 31=-284(B) 32=-284(B) 33=-284(B)



8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:12:38 2023 Page 1  
ID:icBM.laMoT1gasuljvx9?BhvzDEHb-RfC?Psb70Hq3NSoPgnl8w3uITXbGKWrCDoiZl4zJC2f

-1-10-8	5-7-6	9-2-4	16-0-0	22-9-12	26-4-10	32-0-0	33-10-8
1-10-8	5-7-6	3-6-15	6-9-12	6-9-12	3-6-15	5-7-6	1-10-8

Scale = 1:59.2

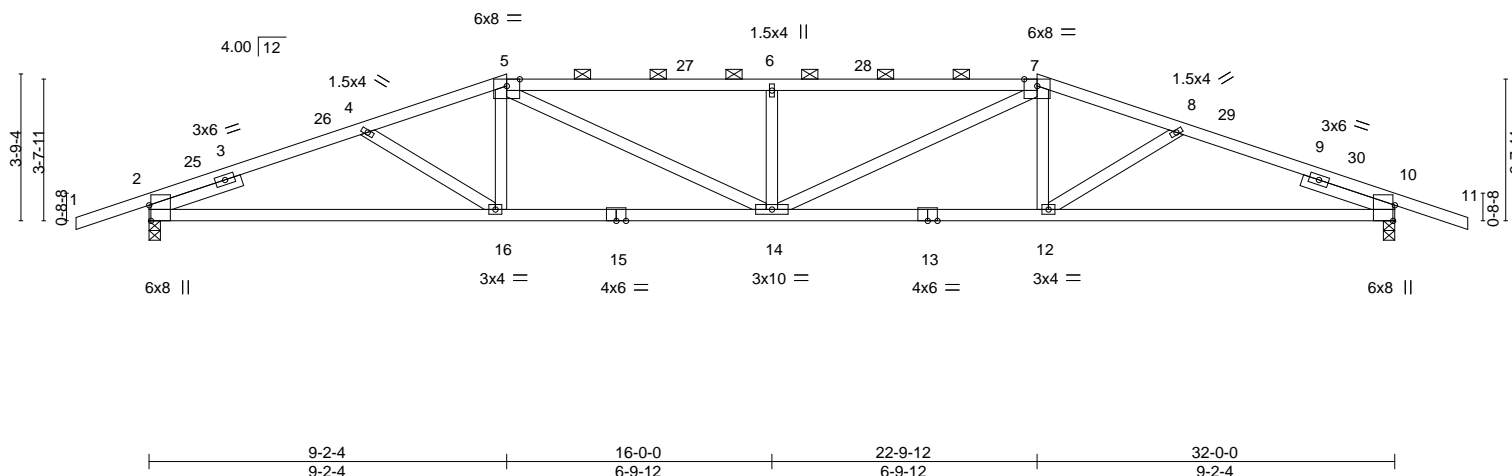


Plate Offsets (X,Y)-- [2:0-4-13,Edge], [10:0-4-13,Edge]									
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d		<b>PLATES GRIP</b>	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.76	Vert(LL)	-0.31 14 >999 240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.97	Vert(CT)	-0.56 12-14 >692 180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.23	Horz(CT)	0.14 10 n/a n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS				Weight: 121 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SPF No.2 *Except* 5-7: 2x4 SPF 1650F 1.5E	TOP CHORD	Structural wood sheathing directly applied, except 2-0-0 oc purlins (3-2-8 max.): 5-7.
BOT CHORD	2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied.
WEBS	2x4 SPF No.2		
SLIDER	Left 2x4 SPF No.2 2-6-0, Right 2x4 SPF No.2 2-6-0		

**REACTIONS.** (size) 2=0-3-8, 10=0-3-8  
 Max Horz 2=-56(LC 13)  
 Max Uplift 2=-313(LC 8), 10=-313(LC 9)  
 Max Grav 2=1571(LC 1), 10=1571(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**TOP CHORD** 2-4=-3016/623, 4-5=-2941/587, 5-6=-3516/725, 6-7=-3516/724, 7-8=-2941/587,  
8-10=-3016/623

**BOT CHORD** 2-16=-508/2789, 14-16=-442/2792, 12-14=-450/2792, 10-12=-517/2789

**WEBS** 5-16=0/261, 5-14=-197/947, 6-14=-574/195, 7-14=-197/947, 7-12=0/261

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDF=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-3-14, Interior(1) 1-3-14 to 9-2-4, Exterior(2R) 9-2-4 to 13-8-9, Interior(1) 13-8-9 to 22-9-12, Exterior(2R) 22-9-12 to 27-4-1, Interior(1) 27-4-1 to 33-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 313 lb uplift at joint 2 and 313 lb uplift at joint 10.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 12.2023

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

**WARNING – Velly design parameters are listed below and included with the key reference to AISC M14-15 16f, 17f, 18f, 19f, 20f, 21f, 22f, 23f, 24f, 25f, 26f, 27f, 28f, 29f, 30f, 31f, 32f, 33f, 34f, 35f, 36f, 37f, 38f, 39f, 40f, 41f, 42f, 43f, 44f, 45f, 46f, 47f, 48f, 49f, 50f, 51f, 52f, 53f, 54f, 55f, 56f, 57f, 58f, 59f, 60f, 61f, 62f, 63f, 64f, 65f, 66f, 67f, 68f, 69f, 70f, 71f, 72f, 73f, 74f, 75f, 76f, 77f, 78f, 79f, 80f, 81f, 82f, 83f, 84f, 85f, 86f, 87f, 88f, 89f, 90f, 91f, 92f, 93f, 94f, 95f, 96f, 97f, 98f, 99f, 100f, 101f, 102f, 103f, 104f, 105f, 106f, 107f, 108f, 109f, 110f, 111f, 112f, 113f, 114f, 115f, 116f, 117f, 118f, 119f, 120f, 121f, 122f, 123f, 124f, 125f, 126f, 127f, 128f, 129f, 130f, 131f, 132f, 133f, 134f, 135f, 136f, 137f, 138f, 139f, 140f, 141f, 142f, 143f, 144f, 145f, 146f, 147f, 148f, 149f, 150f, 151f, 152f, 153f, 154f, 155f, 156f, 157f, 158f, 159f, 160f, 161f, 162f, 163f, 164f, 165f, 166f, 167f, 168f, 169f, 170f, 171f, 172f, 173f, 174f, 175f, 176f, 177f, 178f, 179f, 180f, 181f, 182f, 183f, 184f, 185f, 186f, 187f, 188f, 189f, 190f, 191f, 192f, 193f, 194f, 195f, 196f, 197f, 198f, 199f, 200f, 201f, 202f, 203f, 204f, 205f, 206f, 207f, 208f, 209f, 210f, 211f, 212f, 213f, 214f, 215f, 216f, 217f, 218f, 219f, 220f, 221f, 222f, 223f, 224f, 225f, 226f, 227f, 228f, 229f, 230f, 231f, 232f, 233f, 234f, 235f, 236f, 237f, 238f, 239f, 240f, 241f, 242f, 243f, 244f, 245f, 246f, 247f, 248f, 249f, 250f, 251f, 252f, 253f, 254f, 255f, 256f, 257f, 258f, 259f, 260f, 261f, 262f, 263f, 264f, 265f, 266f, 267f, 268f, 269f, 270f, 271f, 272f, 273f, 274f, 275f, 276f, 277f, 278f, 279f, 280f, 281f, 282f, 283f, 284f, 285f, 286f, 287f, 288f, 289f, 290f, 291f, 292f, 293f, 294f, 295f, 296f, 297f, 298f, 299f, 300f, 301f, 302f, 303f, 304f, 305f, 306f, 307f, 308f, 309f, 310f, 311f, 312f, 313f, 314f, 315f, 316f, 317f, 318f, 319f, 320f, 321f, 322f, 323f, 324f, 325f, 326f, 327f, 328f, 329f, 330f, 331f, 332f, 333f, 334f, 335f, 336f, 337f, 338f, 339f, 340f, 341f, 342f, 343f, 344f, 345f, 346f, 347f, 348f, 349f, 350f, 351f, 352f, 353f, 354f, 355f, 356f, 357f, 358f, 359f, 360f, 361f, 362f, 363f, 364f, 365f, 366f, 367f, 368f, 369f, 370f, 371f, 372f, 373f, 374f, 375f, 376f, 377f, 378f, 379f, 380f, 381f, 382f, 383f, 384f, 385f, 386f, 387f, 388f, 389f, 390f, 391f, 392f, 393f, 394f, 395f, 396f, 397f, 398f, 399f, 400f, 401f, 402f, 403f, 404f, 405f, 406f, 407f, 408f, 409f, 410f, 411f, 412f, 413f, 414f, 415f, 416f, 417f, 418f, 419f, 420f, 421f, 422f, 423f, 424f, 425f, 426f, 427f, 428f, 429f, 430f, 431f, 432f, 433f, 434f, 435f, 436f, 437f, 438f, 439f, 440f, 441f, 442f, 443f, 444f, 445f, 446f, 447f, 448f, 449f, 450f, 451f, 452f, 453f, 454f, 455f, 456f, 457f, 458f, 459f, 460f, 461f, 462f, 463f, 464f, 465f, 466f, 467f, 468f, 469f, 470f, 471f, 472f, 473f, 474f, 475f, 476f, 477f, 478f, 479f, 480f, 481f, 482f, 483f, 484f, 485f, 486f, 487f, 488f, 489f, 490f, 491f, 492f, 493f, 494f, 495f, 496f, 497f, 498f, 499f, 500f, 501f, 502f, 503f, 504f, 505f, 506f, 507f, 508f, 509f, 510f, 511f, 512f, 513f, 514f, 515f, 516f, 517f, 518f, 519f, 520f, 521f, 522f, 523f, 524f, 525f, 526f, 527f, 528f, 529f, 530f, 531f, 532f, 533f, 534f, 535f, 536f, 537f, 538f, 539f, 540f, 541f, 542f, 543f, 544f, 545f, 546f, 547f, 548f, 549f, 550f, 551f, 552f, 553f, 554f, 555f, 556f, 557f, 558f, 559f, 560f, 561f, 562f, 563f, 564f, 565f, 566f, 567f, 568f, 569f, 570f, 571f, 572f, 573f, 574f, 575f, 576f, 577f, 578f, 579f, 580f, 581f, 582f, 583f, 584f, 585f, 586f, 587f, 588f, 589f, 590f, 591f, 592f, 593f, 594f, 595f, 596f, 597f, 598f, 599f, 600f, 601f, 602f, 603f, 604f, 605f, 606f, 607f, 608f, 609f, 610f, 611f, 612f, 613f, 614f, 615f, 616f, 617f, 618f, 619f, 620f, 621f, 622f, 623f, 624f, 625f, 626f, 627f, 628f, 629f, 630f, 631f, 632f, 633f, 634f, 635f, 636f, 637f, 638f, 639f, 640f, 641f, 642f, 643f, 644f, 645f, 646f, 647f, 648f, 649f, 650f, 651f, 652f, 653f, 654f, 655f, 656f, 657f, 658f, 659f, 660f, 661f, 662f, 663f, 664f, 665f, 666f, 667f, 668f, 669f, 670f, 671f, 672f, 673f, 674f, 675f, 676f, 677f, 678f, 679f, 680f, 681f, 682f, 683f, 684f, 685f, 686f, 687f, 688f, 689f, 690f, 691f, 692f, 693f, 694f, 695f, 696f, 697f, 698f, 699f, 700f, 701f, 702f, 703f, 704f, 705f, 706f, 707f,**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837490
3603730	A3	Hip	1	1		

Builders FirstSource (Valley Center), Valley Center, KS - 67147,


8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:12:40 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Job Reference (optional)

-1-10-8	5-8-14	11-2-4	16-0-0	20-9-12	26-3-2	32-0-0	33-10-8
1-10-8	5-8-14	5-5-6	4-9-12	4-9-12	5-5-6	5-8-14	1-10-8

Scale = 1:59.2

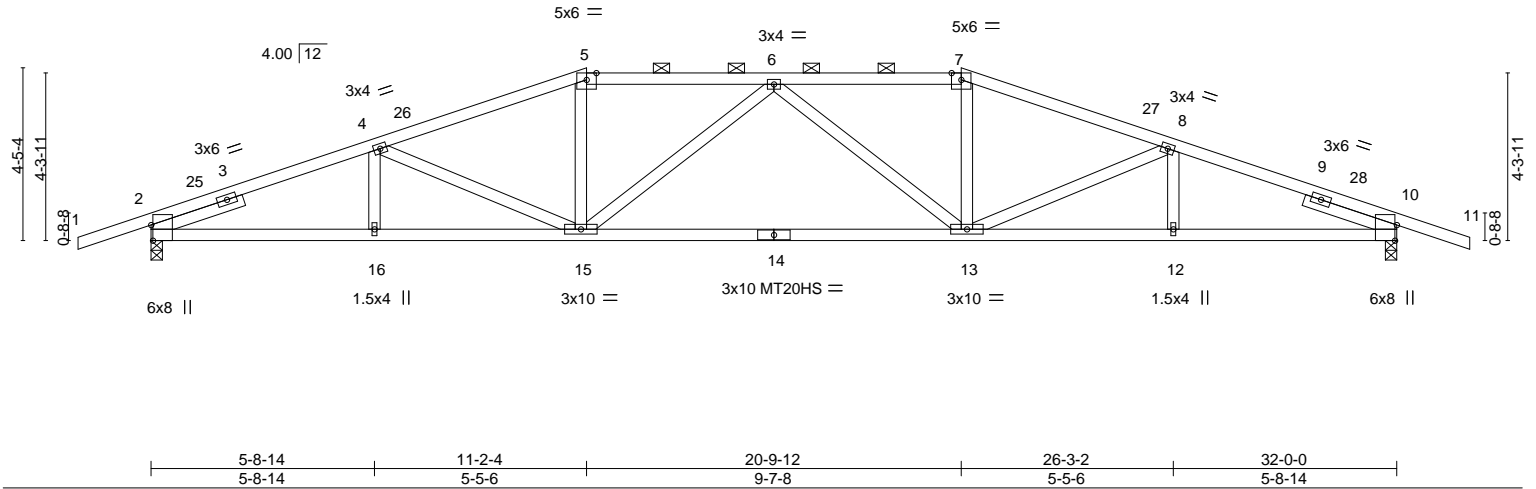

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.76	Vert(LL)	-0.27 13-15	MT20	197/144		
TCDL	10.0	Lumber DOL	1.15	BC	0.92	Vert(CT)	-0.64 13-15	MT20HS	148/108		
BCLL	0.0	Rep Stress Incr	YES	WB	0.34	Horz(CT)	0.14 10			Weight: 125 lb	FT = 20%
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS							

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF 1650F 1.5E  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-6-0, Right 2x4 SPF No.2 2-6-0

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied, except 2-0-0 oc purlins (3-5-3 max.): 5-7.  
BOT CHORD Rigid ceiling directly applied.

**REACTIONS.** (size) 2=0-3-8, 10=0-3-8  
Max Horz 2=67(LC 17)  
Max Uplift 2=305(LC 8), 10=305(LC 9)  
Max Grav 2=1571(LC 1), 10=1571(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-3035/617, 4-5=-2789/576, 5-6=-2605/575, 6-7=-2605/575, 7-8=-2789/576, 8-10=-3035/617  
BOT CHORD 2-16=-506/2817, 15-16=-506/2817, 13-15=-496/2841, 12-13=-515/2817, 10-12=-515/2817  
WEBS 4-15=-258/131, 5-15=-37/478, 6-15=-471/148, 6-13=-471/148, 7-13=-37/478, 8-13=-258/132

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-3-14, Interior(1) 1-3-14 to 11-2-4, Exterior(2R) 11-2-4 to 16-0-0, Interior(1) 16-0-0 to 20-9-12, Exterior(2R) 20-9-12 to 25-4-1, Interior(1) 25-4-1 to 33-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 305 lb uplift at joint 2 and 305 lb uplift at joint 10.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837491
3603730	A4	Hip	1	1		

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:12:41 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWCDoi7J4zJC?f

Job Reference (optional)

-1-10-8	6-8-14	13-2-4	18-9-12	25-3-2	32-0-0	33-10-8
1-10-8	6-8-14	6-5-6	5-7-8	6-5-6	6-8-14	1-10-8

Scale = 1:59.2

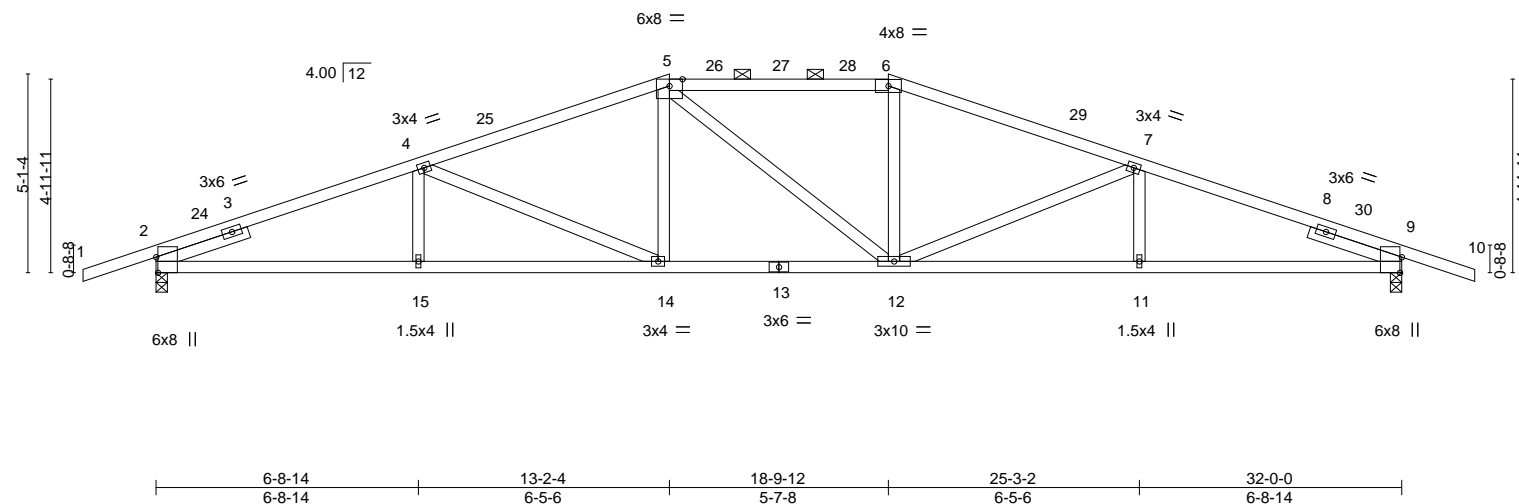


Plate Offsets (X, Y)-- [2:0-4-13,Edge], [9:0-4-13,Edge]		LOADING (psf)		SPACING-- 2-0-0		CSI.		DEFL.		PLATES		GRIP	
TCLL 25.0		Plate Grip DOL 1.15		TC 0.87		in (loc) l/defl L/d		MT20		197/144			
TCDL 10.0		Lumber DOL 1.15		BC 0.80		Vert(LL) -0.25 14-15 >999 240							
BCLL 0.0		Rep Stress Incr YES		WB 0.44		Vert(CT) -0.47 14-15 >816 180							
BCDL 10.0		Code IRC2018/TPI2014		Matrix-AS		Horz(CT) 0.14 9 n/a n/a							
										Weight: 124 lb		FT = 20%	

<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD	2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied, except
BOT CHORD	2x4 SPF 1650F 1.5E		2-0-0 oc purlins (3-6-2 max.): 5-6.
WEBS	2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied.
SLIDER	Left 2x4 SPF No.2 2-6-0, Right 2x4 SPF No.2 2-6-0		

**REACTIONS.** (size) 2=0-3-8, 9=0-3-8  
Max Horz 2=78(LC 16)  
Max Uplift 2=295(LC 8), 9=295(LC 9)  
Max Grav 2=1571(LC 1), 9=1571(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-3067/618, 4-5=-2579/563, 5-6=-2383/570, 6-7=-2579/563, 7-9=-3067/618  
BOT CHORD 2-15=-501/2846, 14-15=-501/2846, 12-14=-380/2382, 11-12=-510/2846, 9-11=-510/2846  
WEBS 4-14=-542/169, 5-14=-17/384, 6-12=-14/384, 7-12=-541/170

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-3-14, Interior(1) 1-3-14 to 13-2-4, Exterior(2R) 13-2-4 to 17-8-9, Interior(1) 17-8-9 to 18-9-12, Exterior(2R) 18-9-12 to 23-4-1, Interior(1) 23-4-1 to 33-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 295 lb uplift at joint 2 and 295 lb uplift at joint 9.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837492
3603730	A5	Common	3	1		
Job Reference (optional)						


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:12:43 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

0-10-8	6-1-6	11-6-11	17-0-0	24-10-4	33-0-0	34-10-8
0-10-8	6-1-6	5-5-5	5-5-5	7-10-4	8-1-12	1-10-8

Scale = 1:57.3

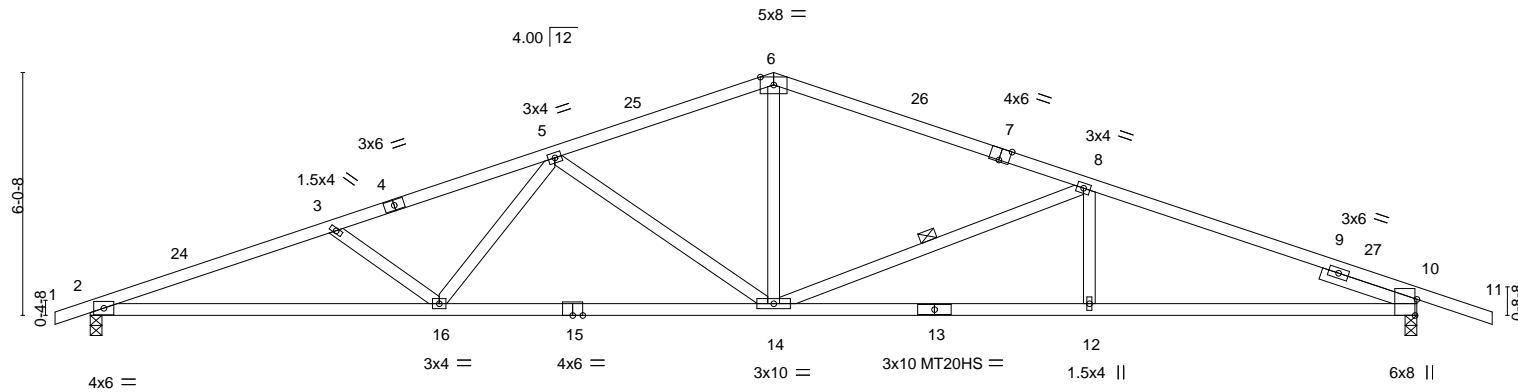

	8-8-3	17-0-0	24-10-4	33-0-0
	8-8-3	8-3-13	7-10-4	8-1-12
Plate Offsets (X,Y)--	[7:0-3-0,Edge], [10:0-4-13,Edge]			

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.71	Vert(LL)	-0.29 12-14	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.85	Vert(CT)	-0.56 12-14	>703	180	MT20HS	148/108
BCLL 0.0	Rep Stress Incr	YES	WB 0.69	Horz(CT)	0.16 10	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
									Weight: 119 lb FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SPF No.2 *Except*	TOP CHORD Structural wood sheathing directly applied.
6-7,7-11: 2x4 SPF 1650F 1.5E	BOT CHORD Rigid ceiling directly applied.
BOT CHORD 2x4 SPF 1650F 1.5E *Except*	WEBS 1 Row at midpt 8-14
13-15: 2x4 SPF No.2	
WEBS 2x4 SPF No.2	
SLIDER Right 2x4 SPF No.2 2-6-0	

<b>REACTIONS.</b>	(size) 2=0-3-8, 10=0-3-8
	Max Horz 2=96(LC 12)
	Max Uplift 2=249(LC 8), 10=282(LC 9)
	Max Grav 2=1543(LC 1), 10=1619(LC 1)

<b>FORCES.</b>	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-3776/669, 3-5=-3403/599, 5-6=-2355/483, 6-8=-2386/471, 8-10=-3186/570
BOT CHORD	2-16=-570/3531, 14-16=-422/2848, 12-14=-456/2954, 10-12=-456/2954
WEBS	3-16=-456/178, 5-16=-47/553, 5-14=-863/228, 6-14=-121/973, 8-14=-913/247, 8-12=0/274

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-5-2, Interior(1) 2-5-2 to 17-0-0, Exterior(2R) 17-0-0 to 20-3-10, Interior(1) 20-3-10 to 34-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - All plates are MT20 plates unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 249 lb uplift at joint 2 and 282 lb uplift at joint 10.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 12,2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837493
3603730	A6	Hip	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center),
Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:12:44 2023 Page 1
ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWCDoi7J4zJC?f

7-10-1

7-10-1

15-0-0

7-1-15

19-0-0

4-0-0

25-10-4

6-10-4

33-0-0

7-1-12

34-10-8

1-10-8

Scale = 1:58.2

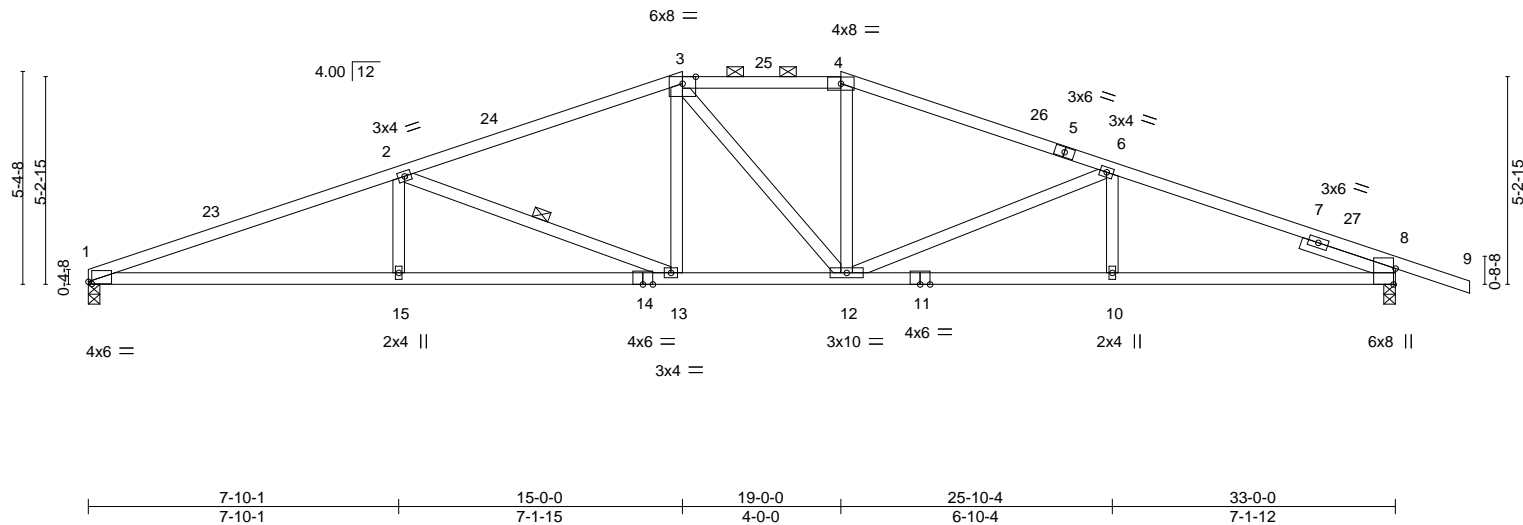


Plate Offsets (X,Y)-- [1:0-1-1,0-0-10], [8:0-4-13,Edge]															
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL.		in (loc)		l/defl		L/d		PLATES	GRIP
TCLL	25.0	Plate Grip DOL	1.15	TC	0.96	Vert(LL)	-0.28	10-12	>999	240				MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.99	Vert(CT)	-0.53	10-12	>745	180					
BCLL	0.0	Rep Stress Incr	YES	WB	0.59	Horz(CT)	0.17	8	n/a	n/a					
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS										Weight: 122 lb	FT = 20%

<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD	2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied, except
BOT CHORD	2x4 SPF No.2 *Except*		2-0-0 oc purlins (3-5-11 max.): 3-4.
	8-11: 2x4 SPF 1650F 1.5E	BOT CHORD	Rigid ceiling directly applied.
WEBS	2x4 SPF No.2	WEBS	1 Row at midpt 2-13
SLIDER	Right 2x4 SPF No.2 2-6-0		

<b>REACTIONS.</b>	
(size)	1=0-3-8, 8=0-3-8
Max Horz	1=-89(LC 17)
Max Uplift	1=-229(LC 8), 8=-295(LC 9)
Max Grav	1=1481(LC 1), 8=1620(LC 1)

<b>FORCES.</b>	
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	1-2=-3705/723, 2-3=-2674/581, 3-4=-2422/561, 4-6=-2630/564, 6-8=-3195/613
BOT CHORD	1-15=-612/3449, 13-15=-612/3449, 12-13=-386/2448, 10-12=-503/2965, 8-10=-503/2965
WEBS	2-15=0/310, 2-13=-1073/259, 3-13=-44/482, 3-12=-266/205, 4-12=-35/399, 6-12=-641/189

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-3-10, Interior(1) 3-3-10 to 15-0-0, Exterior(2E) 15-0-0 to 19-0-0, Exterior(2R) 19-0-0 to 23-8-0, Interior(1) 23-8-0 to 34-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 229 lb uplift at joint 1 and 295 lb uplift at joint 8.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 12,2023

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837494
3603730	A7	Hip	1	1	Job Reference (optional)	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:12:46 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:59.2

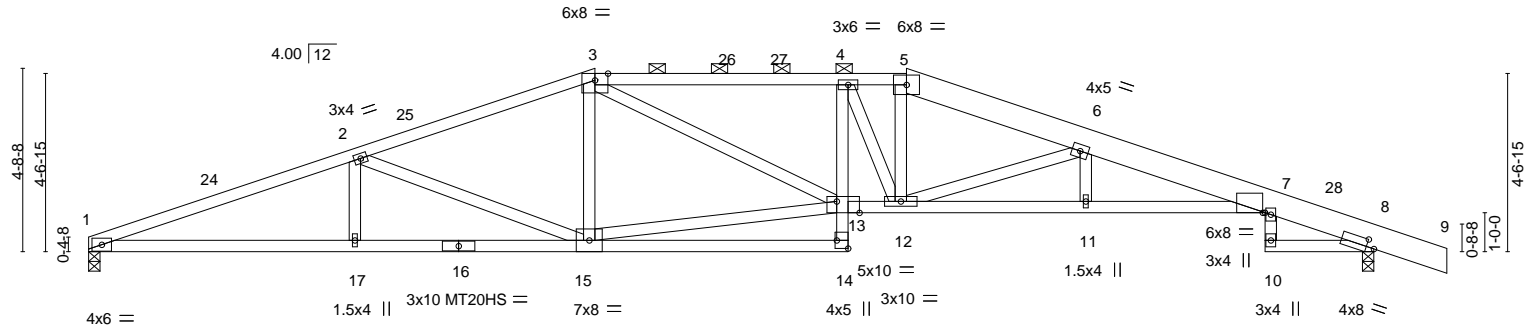

	6-10-1	13-0-0	19-6-0	21-0-0	25-7-4	30-2-8	33-0-0
	6-10-1	6-1-15	6-6-0	1-6-0	4-7-4	4-7-4	2-9-8

Plate Offsets (X,Y)-- [7:0-0-11,Edge], [8:0-2-7,0-2-5], [13:0-7-0,Edge], [14:Edge,0-3-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.84	Vert(LL)	-0.44	12-13	>903	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.93	Vert(CT)	-0.79	12-13	>501	MT20HS	148/108
BCLL 0.0	Rep Stress Incr	YES	WB 0.73	Horz(CT)	0.35	8	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 160 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2 \*Except\*  
5-9: 2x8 SP 2400F 2.0E  
BOT CHORD 2x4 SPF No.2 \*Except\*  
7-13: 2x4 SP 2400F 2.0E  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except  
2-0-0 oc purlins (2-2-0 max.): 3-5.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 1=0-3-8, 8=0-3-8  
Max Horz 1=-82(LC 17)  
Max Uplift 1=-239(LC 8), 8=-306(LC 9)  
Max Grav 1=1481(LC 1), 8=1620(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-3763/742, 2-3=-2975/627, 3-4=-3587/788, 4-5=-3468/741, 5-6=-3675/749,  
6-7=-5115/1003, 7-8=-570/154  
BOT CHORD 1-17=-631/3511, 15-17=-631/3511, 14-15=-30/375, 12-13=-607/3586, 11-12=-905/5010,  
7-11=-906/5011  
WEBS 2-15=-820/224, 13-15=-423/2414, 3-13=-189/1038, 4-12=-429/124, 5-12=-200/1053,  
6-12=-1688/366

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-3-10, Interior(1) 3-3-10 to 13-0-0, Exterior(2R) 13-0-0 to 17-8-0, Interior(1) 17-8-0 to 21-0-0, Exterior(2R) 21-0-0 to 25-7-4, Interior(1) 25-7-4 to 34-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 239 lb uplift at joint 1 and 306 lb uplift at joint 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 12, 2023


**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:12:47 2023 Page 1  
 ID:icBMJaMgT1gasuYx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f  
 5-10-1 11-0-0 12-4-0 14-6-8 16-9-0 19-6-0 23-0-0 26-7-14 30-2-8 33-0-0 34-10-8  
 5-10-1 5-1-15 1-4-0 2-2-8 2-2-8 2-9-0 3-6-0 3-7-14 3-6-10 2-9-8 1-10-8  
 Scale = 1:59

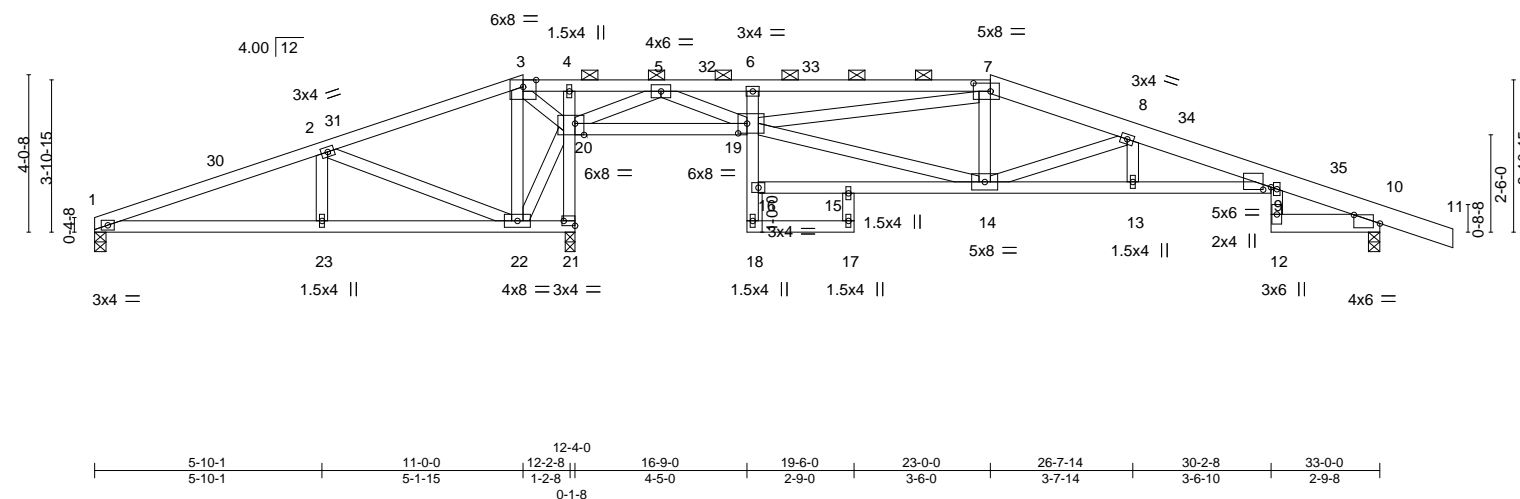

<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD	2x4 SPF No.2 *Except* 7-11: 2x6 SPF 2100F 1.8E	TOP CHORD	Structural wood sheathing directly applied, except 2-0-0 oc purlins (5-2-1 max.): 3-7.
BOT CHORD	2x4 SPF No.2 *Except* 9-16: 2x4 SPF 1650F 1.5E, 10-12: 2x6 SPF No.2	BOT CHORD	Rigid ceiling directly applied.
WEBS	2x4 SPF No.2		

**REACTIONS.** (size) 1=0-3-8, 21=0-3-0, 10=0-3-8  
 Max Horz 1=-69(LC 17)  
 Max Uplift 1=-93(LC 12), 21=-283(LC 8), 10=-227(LC 9)  
 Max Grav 1=347(LC 25), 21=1885(LC 1), 10=930(LC 26)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**TOP CHORD** 1-2=-441/298, 2-3=-32/682, 3-4=-414/2550, 4-5=-430/2578, 5-6=-988/222,  
 6-7=-1056/282, 7-8=-1437/331, 8-9=-2369/503, 9-10=-410/114

**BOT CHORD** 1-23=-260/387, 22-23=-260/387, 20-21=-1902/332, 19-20=-747/204, 6-19=-335/127,  
 13-14=-423/2334, 9-13=-423/2335, 9-12=-45/319

**WEBS** 2-22=-864/203, 3-22=-302/1450, 20-22=-1331/316, 3-20=-2707/569, 7-14=-12/260,  
 8-14=-1076/251, 5-20=-2026/414, 5-19=-301/1830, 14-19=-191/1252, 7-19=-338/114

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCFL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-3-10, Interior(1) 3-3-10 to 11-0-0, Exterior(2R) 11-0-0 to 15-8-0, Interior(1) 15-8-0 to 23-0-0, Exterior(2R) 23-0-0 to 27-8-0, Interior(1) 27-8-0 to 34-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Provide adequate drainage to prevent water ponding.
  - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 93 lb uplift at joint 1, 283 lb uplift at joint 21 and 227 lb uplift at joint 10.
  - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
  - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 12, 2023

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837496
3603730	A9	HIP GIRDER	1	3	Job Reference (optional)	

Builders FirstSource (Valley Center),
Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:12:50 2023 Page 1
ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrcDoi7J4zJC?f

4-10-1
4-10-1

9-0-0
4-1-15

14-3-0
5-3-0

19-6-0
5-3-0

25-0-0
5-6-0

30-2-8
5-2-8

30-8-8
0-6-0

33-0-0
2-3-8

34-10-8
1-10-8

Scale = 1:59.2

<div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div></div>												
Plate Offsets (X,Y)-- [5:0-5-8,0-2-4], [6:0-8-8,0-0-0], [8:Edge,0-1-12], [13:0-5-4,Edge], [14:Edge,0-3-8]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d			PLATES GRIP			
TCLL	25.0	Plate Grip DOL	1.15	TC	0.82	Vert(LL)	-0.58	12-13	>677	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.95	Vert(CT)	-1.05	12-13	>377	180		
BCLL	0.0	Rep Stress Incr	NO	WB	0.86	Horz(CT)	0.33	8	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-MS							Weight: 445 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP 2400F 2.0E *Except*	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except
2-5: 2x4 SPF 1650F 1.5E, 5-9: 2x8 SP 2400F 2.0E	2-0-0 oc purlins (5-10-8 max.): 2-5.
BOT CHORD 2x4 SPF No.2 *Except*	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
1-16,6-13: 2x4 SP 2400F 2.0E	
WEBS 2x4 SPF No.2	

**REACTIONS.** (size) 1=0-3-8, 8=0-3-8  
Max Horz 1=-61(LC 34)  
Max Uplift 1=-860(LC 4), 8=-888(LC 5)  
Max Grav 1=3925(LC 1), 8=3775(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-10084/2273, 2-3=-11591/2700, 3-4=-16697/3842, 4-5=-17203/3957,  
5-6=-14118/3202, 6-7=-1082/306, 7-8=-1211/319  
BOT CHORD 1-17=-2114/9530, 15-17=-2102/9461, 14-15=-315/1398, 13-14=-129/614, 4-13=-289/166,  
12-13=-3003/13692, 6-12=-3003/13692  
WEBS 2-17=-252/1433, 2-15=-677/2682, 3-15=-2455/606, 13-15=-2376/10505, 3-13=-1211/5336,  
5-13=-932/3887, 5-12=-390/1845, 7-10=-47/298

- NOTES-**
- 1) 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-7-0 oc, 2x8 - 2 rows staggered at 0-9-0 oc.  
Bottom chords connected as follows: 2x4 - 2 rows staggered at 0-7-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
  - 2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
  - 3) Unbalanced roof live loads have been considered for this design.
  - 4) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed;  
MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 5) Provide adequate drainage to prevent water ponding.
  - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 860 lb uplift at joint 1 and 888 lb uplift at joint 8.
  - 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 12,2023

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837496
3603730	A9	HIP GIRDER	1	3	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:12:50 2023 Page 2  
ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

NOTES-

10) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 379 lb down and 89 lb up at 3-0-12, 323 lb down and 79 lb up at 5-0-12, 323 lb down and 79 lb up at 7-0-12, 323 lb down and 100 lb up at 9-0-12, 323 lb down and 100 lb up at 11-0-12, 323 lb down and 100 lb up at 13-0-12, 323 lb down and 100 lb up at 15-0-12, 323 lb down and 100 lb up at 17-0-0, 323 lb down and 100 lb up at 18-11-4, 323 lb down and 99 lb up at 20-11-4, and 323 lb down and 99 lb up at 22-11-4, and 989 lb down and 281 lb up at 24-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-2=-70, 2-5=-70, 5-9=-70, 14-18=-20, 13-21=-20, 11-24=-20  
Concentrated Loads (lb)  
Vert: 17=-323(F) 12=-989(F) 27=-379(F) 28=-323(F) 29=-323(F) 30=-323(F) 31=-323(F) 32=-323(F) 33=-323(F) 34=-323(F) 35=-323(F) 36=-323(F)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:12:52 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvZDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f

-1-10-8 | 1-10-4 | 6-3-8 | 10-8-12 | 12-4-12 | 18-0-0 | 25-10-4 | 34-0-0 | 35-10-8 |  
1-10-8 | 1-10-4 | 4-5-4 | 4-5-4 | 1-8-0 | 5-7-4 | 7-10-4 | 8-1-12 | 1-10-8 |

Scale: 3/16"=1'

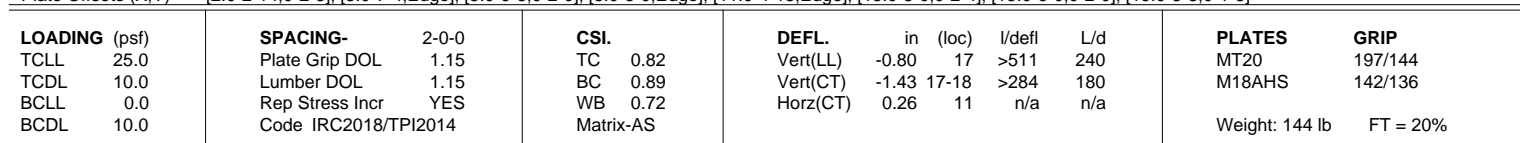

**REACTIONS.** (size) 20=0-3-8, 11=0-3-8  
 Max Horz 20=-129(LC 45)  
 Max Uplift 20=-306(LC 8), 11=-288(LC 9)  
 Max Grav 20=1634(LC 1), 11=1652(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**TOP CHORD** 2-3=-1960/352, 3-4=-6205/1091, 4-5=-6205/1091, 5-6=-6524/1139, 6-7=-6304/1175,  
7-9=-2485/508, 9-11=-3274/597, 2-20=-1659/387

**BOT CHORD** 18-19=-259/1956, 17-18=-1381/8544, 13-15=-481/3036, 11-13=-481/3036

**WEBS** 3-19=-779/152, 5-17=-2949/550, 15-17=-290/2233, 7-17=-770/4454, 7-15=-309/112,  
9-15=-912/244, 9-13=0/281, 2-19=-380/2120, 4-18=-474/142, 5-18=-2519/510,  
3-18=-783/4412

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCFL=6.0psf; BCFL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-6-5, Interior(1) 1-6-5 to 1-10-4, Exterior(2E) 1-10-4 to 5-3-1, Interior(1) 5-3-1 to 18-0-0, Exterior(2R) 18-0-0 to 21-4-13, Interior(1) 21-4-13 to 35-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are MT20 plates unless otherwise indicated.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 306 lb uplift at joint 20 and 288 lb uplift at joint 11.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 10) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 64 lb down and 167 lb up at 1-10-4 on top chord, and 25 lb down and 32 lb up at 1-10-4, 22 lb down and 31 lb up at 1-11-0, and 22 lb down and 31 lb up at 3-11-0, and 22 lb down and 31 lb up at 5-11-0 on bottom chord. The design/selection of such connection device(s) is the

responsibility of others.



June 12.2023



Design valid for use only with MiTEK® connectors. This design is based only upon parameters shown, and is for the individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building C**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837497
3603730	B1	Roof Special	1	1	Job Reference (optional)	

**NOTES-**  
11) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard  
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-2=-70, 2-3=-70, 3-5=-70, 5-7=-70, 7-12=-70, 17-20=-20, 16-21=-20  
Concentrated Loads (lb)  
Vert: 3=33(F)

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows
3603730	B1A	Roof Special	1	1	I58837498
Job Reference (optional)					

Builders FirstSource (Valley Center),		Valley Center, KS - 67147,		8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:12:55 2023 Page 1									
ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f													
-1-10-8	1-10-4	6-1-12	10-8-12	12-4-12	17-2-4	18-9-12	26-3-2	34-0-0	35-10-8				
1-10-8	1-10-4	4-3-8	4-7-0	1-8-0	4-9-8	1-7-8	7-5-6	7-8-14	1-10-8				
Scale = 1:65.7													

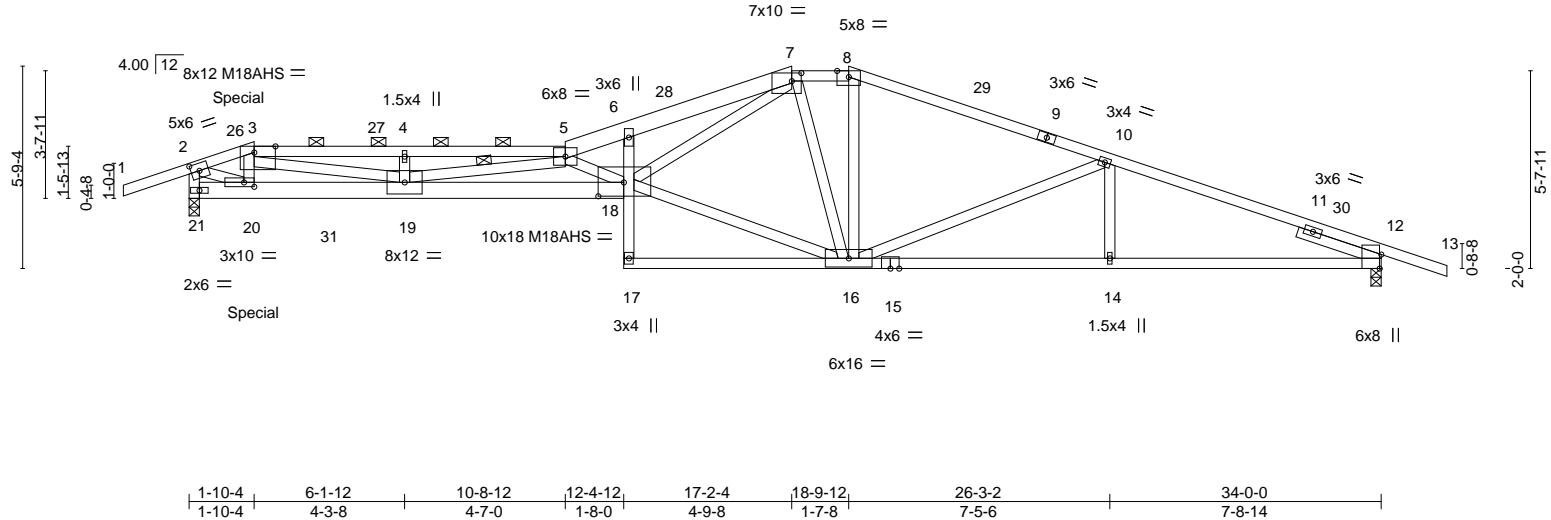


Plate Offsets (X,Y)-- [2:0-2-14,0-2-8], [3:0-7-4,Edge], [7:0-3-4,0-2-12], [12:0-4-13,Edge], [18:0-8-12,0-4-12], [20:0-3-8,0-1-8]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.90	Vert(LL)	-0.76 17 >537	240	MT20 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.86	Vert(CT)	-1.36 17 >299	180	M18AHS 142/136
BCLL	0.0	Rep Stress Incr	YES	WB	1.00	Horz(CT)	0.24 12 n/a	n/a	
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 156 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2 *Except*	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (2-2-0 max.): 3-5, 7-8.
3-5,9-13: 2x4 SPF 1650F 1.5E, 5-7: 2x6 SPF No.2	
BOT CHORD 2x4 SPF No.2 *Except*	BOT CHORD Rigid ceiling directly applied.
18-21: 2x6 SPF 2100F 1.8E, 12-15: 2x4 SPF 1650F 1.5E	WEBS 1 Row at midpt 5-19
WEBS 2x4 SPF No.2 *Except*	
7-18: 2x4 SPF 1650F 1.5E	
SLIDER Right 2x4 SPF No.2 2-6-0	
REACTIONS. (size) 12=0-3-8, 21=0-3-8	
Max Horz 21=-125(LC 13)	
Max Uplift 12=-293(LC 9), 21=-311(LC 8)	
Max Grav 12=1652(LC 1), 21=1634(LC 1)	

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD 2-3=-2275/418, 3-4=-6176/1118, 4-5=-6174/1116, 5-6=-6932/1266, 6-7=-6721/1294, 7-8=-2391/539, 8-10=-2592/540, 10-12=-3277/606, 2-21=-1753/409	
BOT CHORD 19-20=-292/2232, 18-19=-1608/9407, 14-16=-492/3040, 12-14=-492/3040	
WEBS 3-20=-541/110, 5-18=-3411/650, 8-16=-43/488, 10-16=-787/223, 10-14=0/258, 2-20=-434/2323, 4-19=-404/130, 3-19=-727/4085, 7-16=-919/174, 5-19=-3379/674, 16-18=-367/2559, 7-18=-818/4563	

NOTES-	
1) Unbalanced roof live loads have been considered for this design.	
2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-6-5, Interior(1) 1-6-5 to 1-10-4, Exterior(2E) 1-10-4 to 5-3-1, Interior(1) 5-3-1 to 17-2-4, Exterior(2E) 17-2-4 to 18-9-12, Exterior(2R) 18-9-12 to 22-2-9, Interior(1) 22-2-9 to 35-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60	
3) Provide adequate drainage to prevent water ponding.	
4) All plates are MT20 plates unless otherwise indicated.	
5) The Fabrication Tolerance at joint 18 = 16%	
6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.	
7) Bearing at joint(s) 21 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.	
8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 293 lb uplift at joint 12 and 311 lb uplift at joint 21.	
9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.	
10) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.	
On the graphic representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.	



<p><b>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</b></p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see <b>ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information</b> available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p><b>MiTek</b></p> <p>16023 Swingley Ridge Rd Chesterfield, MO 63017</p>
--	---

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837498
3603730	B1A	Roof Special	1	1	Job Reference (optional)	

- NOTES-**
- 12) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 64 lb down and 167 lb up at 1-10-4 on top chord, and 25 lb down and 32 lb up at 1-10-4, 22 lb down and 31 lb up at 1-11-0, and 22 lb down and 31 lb up at 3-11-0, and 22 lb down and 31 lb up at 5-11-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 13) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
- Uniform Loads (plf)
- Vert: 1-2=-70, 2-3=-70, 3-5=-70, 5-7=-70, 7-8=-70, 8-13=-70, 18-21=-20, 17-22=-20
- Concentrated Loads (lb)
- Vert: 3=33(B)

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837499
3603730	B2	Roof Special	2	1		
Job Reference (optional)						

Builders FirstSource (Valley Center),
Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:12:56 2023 Page 1

-1-10-8
3-10-4
8-1-8
8-3-8
12-4-12
12-8-12
18-0-0

1-10-8
3-10-4
4-3-4
0-2-0
4-1-4
0-4-0
5-3-4

25-10-4
34-0-0
35-10-8

7-10-4
8-1-12
1-10-8

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Scale: 3/16"=1'

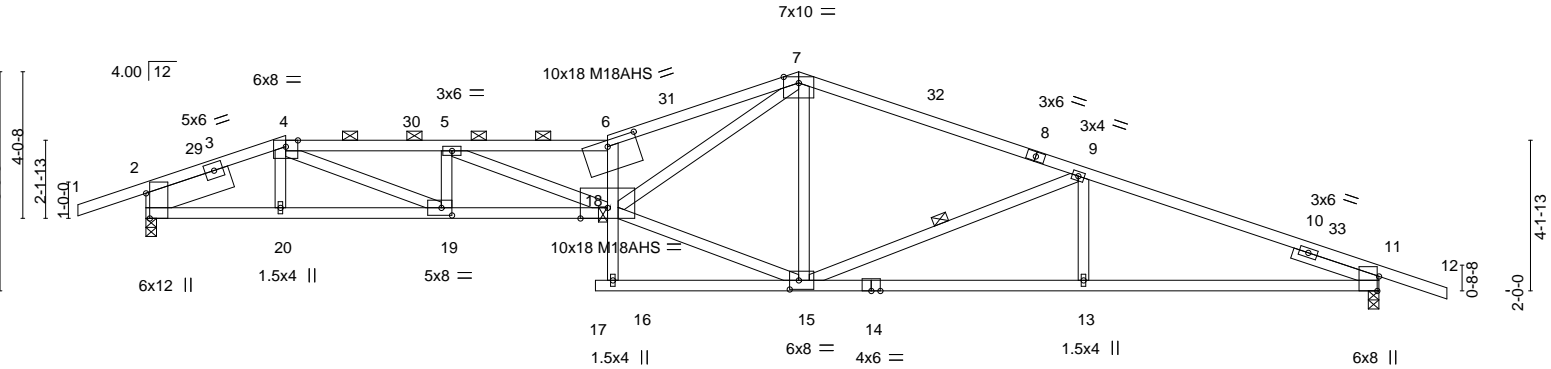


Plate Offsets (X,Y)--		[2:0-8-5,Edge], [6:0-9-12,0-2-0], [11:0-4-13,Edge], [15:0-3-0,0-3-0], [19:0-3-8,0-2-8]	
<b>LOADING</b> (psf)	<b>SPACING-</b>	<b>CSI.</b>	<b>DEFL.</b>
TCLL 25.0	Plate Grip DOL 1.15	TC 0.90	in (loc) l/defl L/d
TCDL 10.0	Lumber DOL 1.15	BC 0.96	Vert(LL) -0.65 17 >632 240
BCLL 0.0	Rep Stress Incr YES	WB 0.77	Vert(CT) -1.16 17 >351 180
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS	Horz(CT) 0.23 11 n/a n/a
		<b>PLATES</b>	
		MT20 197/144	
		M18AHS 142/136	
		Weight: 145 lb FT = 20%	

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SPF 1650F 1.5E	TOP CHORD Structural wood sheathing directly applied, except
BOT CHORD 2x4 SPF 1650F 1.5E *Except*	2-0-0 oc purlins (2-2-14 max.): 4-6.
14-17: 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2 *Except*	WEBS 1 Row at midpt 6-16, 9-15
7-18: 2x4 SPF 1650F 1.5E	
SLIDER Left 2x8 SP 2400F 2.0E 2-6-0, Right 2x4 SPF No.2 2-6-0	

**REACTIONS.** (size) 2=0-3-8, 11=0-3-8  
Max Horz 2=-142(LC 13)  
Max Uplift 2=-297(LC 8), 11=-282(LC 9)  
Max Grav 2=1665(LC 1), 11=1664(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-2763/501, 4-5=-5191/936, 5-6=-6300/1124, 6-7=-6559/1205, 7-9=-2529/510, 9-11=-3303/603  
BOT CHORD 2-20=-326/2531, 19-20=-330/2540, 18-19=-787/5188, 13-15=-487/3063, 11-13=-487/3063  
WEBS 6-18=-2298/472, 7-15=-344/113, 9-15=-894/240, 9-13=0/275, 15-18=-312/2349, 7-18=-786/4713, 5-19=-1025/241, 4-19=-504/2885, 5-18=-217/1203

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-6-5, Interior(1) 1-6-5 to 3-10-4, Exterior(2R) 3-10-4 to 7-3-1, Interior(1) 7-3-1 to 18-0-0, Exterior(2R) 18-0-0 to 21-4-13, Interior(1) 21-4-13 to 35-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Provide adequate drainage to prevent water ponding.
  - All plates are MT20 plates unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 297 lb uplift at joint 2 and 282 lb uplift at joint 11.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




June 12,2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**MiTek**  
16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:12:58 2023 Page 1  
 ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3u1XbGKwRCDoi7J4zJC?f  
 -1-10-8 5-10-4 12-4-12 14-8-12 18-0-0 25-10-4 35-10-8  
 1-10-8 5-10-4 6-6-8 2-4-0 3-3-4 7-10-4 8-1-12 1-10-8  
 Scale: 3/16"=1'

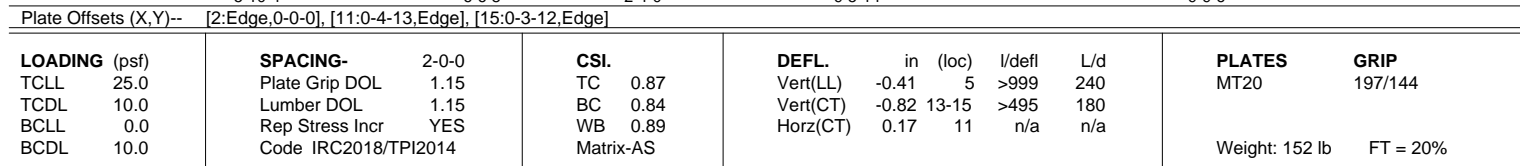

**REACTIONS.** (size) 2=0-3-8, 11=0-3-8  
 Max Horz 2=-142(LC 13)  
 Max Uplift 2=-299(LC 8), 11=-281(LC 9)  
 Max Grav 2=1661(LC 1), 11=1661(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**TOP CHORD** 2-4=-2987/552, 4-5=-4870/919, 5-6=-4746/897, 6-7=-2916/623, 7-9=-3088/620,  
 9-11=-3299/625

**BOT CHORD** 2-18=-367/2755, 17-18=-371/2756, 5-17=-615/187, 13-15=-325/2265, 11-13=-508/3061

**WEBS** 4-17=-410/2264, 15-17=-507/3645, 6-17=-475/2930, 6-15=-3093/549, 7-15=-179/1045,  
 7-13=-160/864, 9-13=-479/219

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCFL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-6-5, Interior(1) 1-6-5 to 5-10-4, Exterior(2R) 5-10-4 to 9-3-1, Interior(1) 9-3-1 to 18-0-0, Exterior(2R) 18-0-0 to 21-4-13, Interior(1) 21-4-13 to 35-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Provide adequate drainage to prevent water ponding.
  - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 299 lb uplift at joint 2 and 281 lb uplift at joint 11.
  - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
  - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 12.2023


Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837501
3603730	CJ1	Diagonal Hip Girder	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center),
Valley Center, KS - 67147,
8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:12:59 2023 Page 1
ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

-2-7-13  
2-7-13

5-0-4  
5-0-4

10-0-8  
5-0-4

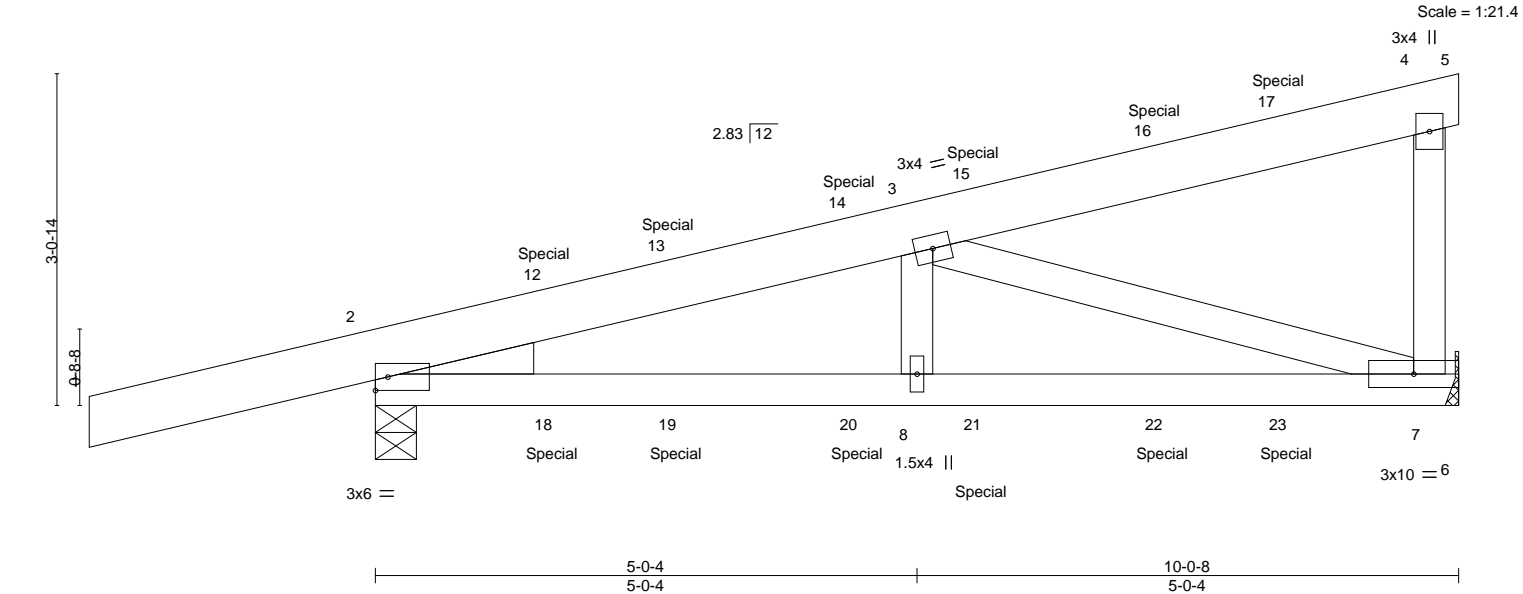

LOADING (psf)		SPACING-		CSI.		DEFL.				PLATES		GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.33	Vert(LL)	-0.03	7-8	>999	240	MT20	197/144	
TCDL	10.0	Lumber DOL	1.15	BC	0.38	Vert(CT)	-0.06	7-8	>999	180			
BCLL	0.0	Rep Stress Incr	NO	WB	0.30	Horz(CT)	0.01	7	n/a	n/a			
BCDL	10.0	Code IRC2018/TPI2014		Matrix-MS							Weight: 46 lb	FT = 20%	

<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD	2x6 SPF No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SPF No.2		
WEDGE			
Left: 2x4 SP No.3			

**REACTIONS.** (size) 2=0-4-9, 7=Mechanical  
Max Horz 2=97(LC 27)  
Max Uplift 2=191(LC 4), 7=103(LC 8)  
Max Grav 2=617(LC 1), 7=575(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-797/136  
BOT CHORD 2-8=-154/731, 7-8=-154/731  
WEBS 3-7=-704/168

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 3) Refer to girder(s) for truss to truss connections.
  - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 191 lb uplift at joint 2 and 103 lb uplift at joint 7.
  - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 83 lb down and 173 lb up at 1-7-11, 12 lb down and 15 lb up at 2-9-8, 15 lb down and 32 lb up at 4-5-10, 35 lb down and 52 lb up at 5-7-7, and 52 lb down and 76 lb up at 7-3-10, and 76 lb down and 87 lb up at 8-5-6 on top chord, and 11 lb down and 64 lb up at 1-7-11, 10 lb down and 6 lb up at 2-9-8, 24 lb down and 7 lb up at 4-5-10, 22 lb down at 5-7-7, and 33 lb down at 7-3-10, and 45 lb down at 8-5-6 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
  - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-4=-70, 4-5=-20, 6-9=-20

Concentrated Loads (lb)

Vert: 12=49(F) 15=-6(B) 16=-45(F) 17=-76(B) 18=32(F) 19=6(B) 20=7(F) 21=-12(B) 22=-29(F) 23=-41(B)





Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837502
3603730	CJ2	Diagonal Hip Girder	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:02 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

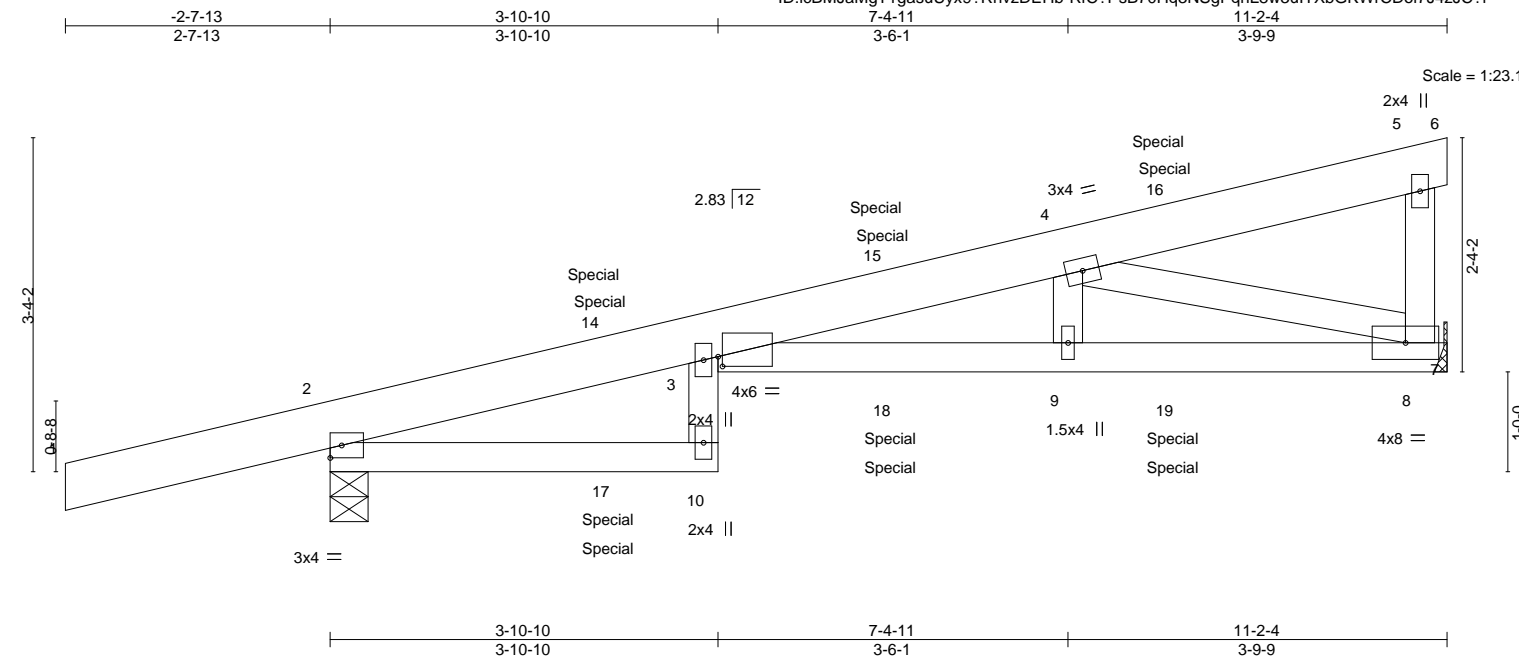


Plate Offsets (X,Y)--		[3:0-0-8,0-1-3]									
<b>LOADING</b> (psf)		<b>SPACING-</b>		<b>CSI.</b>		<b>DEFL.</b>		<b>PLATES</b>		<b>GRIP</b>	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.75	Vert(LL)	-0.22	MT20	197/144		
TCDL	10.0	Lumber DOL	1.15	BC	0.91	Vert(CT)	-0.41				
BCLL	0.0	Rep Stress Incr	NO	WB	0.42	Horz(CT)	0.17				
BCDL	10.0	Code IRC2018/TPI2014		Matrix-MS							
								Weight: 46 lb		FT = 20%	

#### LUMBER-

TOP CHORD 2x6 SPF 2100F 1.8E  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-10-8 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 8-10-14 oc bracing.

#### REACTIONS.

(size) 8=Mechanical, 2=0-4-9  
Max Horz 2=90(LC 5)  
Max Uplift 8=154(LC 8), 2=227(LC 4)  
Max Grav 8=694(LC 1), 2=779(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-4=-1695/407  
BOT CHORD 3-9=-427/1701, 8-9=-426/1699  
WEBS 4-8=-1726/450

#### NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 154 lb uplift at joint 8 and 227 lb uplift at joint 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 12 lb down and 15 lb up at 2-9-8, 12 lb down and 15 lb up at 2-9-8, 32 lb down and 39 lb up at 5-7-7, 32 lb down and 39 lb up at 5-7-7, and 59 lb down and 73 lb up at 8-5-6, and 59 lb down and 73 lb up at 8-5-6 on top chord, and 10 lb down and 6 lb up at 2-9-8, 10 lb down and 6 lb up at 2-9-8, 32 lb down and 25 lb up at 5-7-7, 32 lb down and 25 lb up at 5-7-7, and 61 lb down and 32 lb up at 8-5-6, and 61 lb down and 32 lb up at 8-5-6 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-70, 3-5=-70, 5-6=-20, 10-11=-20, 3-7=-20  
Concentrated Loads (lb)  
Vert: 15=-12(F=-6, B=-6) 16=-109(F=-54, B=-54) 17=12(F=6, B=6) 18=-63(F=-32, B=-32) 19=-123(F=-61, B=-61)



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837503
3603730	CJ3	Diagonal Hip Girder	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:03 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

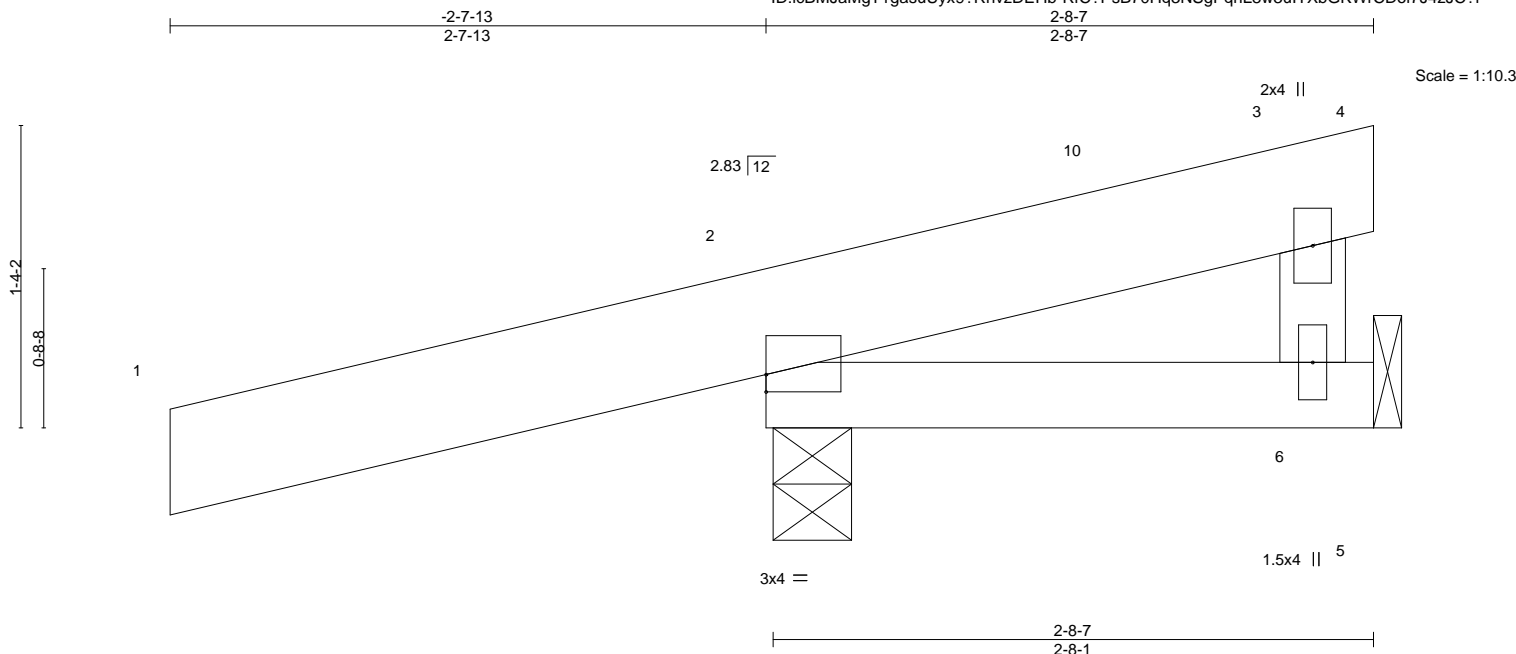


Plate Offsets (X,Y)-- [2:0-0,0-0-15]											
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.25	Vert(LL)	0.00	6-9	>999	240	MT20 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.08	Vert(CT)	0.00	6-9	>999	180	
BCLL	0.0	Rep Stress Incr	NO	WB	0.00	Horz(CT)	-0.00	2	n/a	n/a	
BCDL	10.0	Code IRC2018/TPI2014		Matrix-MP							Weight: 14 lb FT = 20%

#### LUMBER-

TOP CHORD 2x6 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-8-7 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 6=Mechanical, 2=0-4-3  
Max Horz 2=43(LC 11)  
Max Uplift 6=-1(LC 9), 2=-167(LC 8)  
Max Grav 6=61(LC 3), 2=396(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -2-7-13 to 1-7-1, Exterior(2R) 1-7-1 to 2-8-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1 lb uplift at joint 6 and 167 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837504
3603730	CJ4	Diagonal Hip Girder	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:04 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

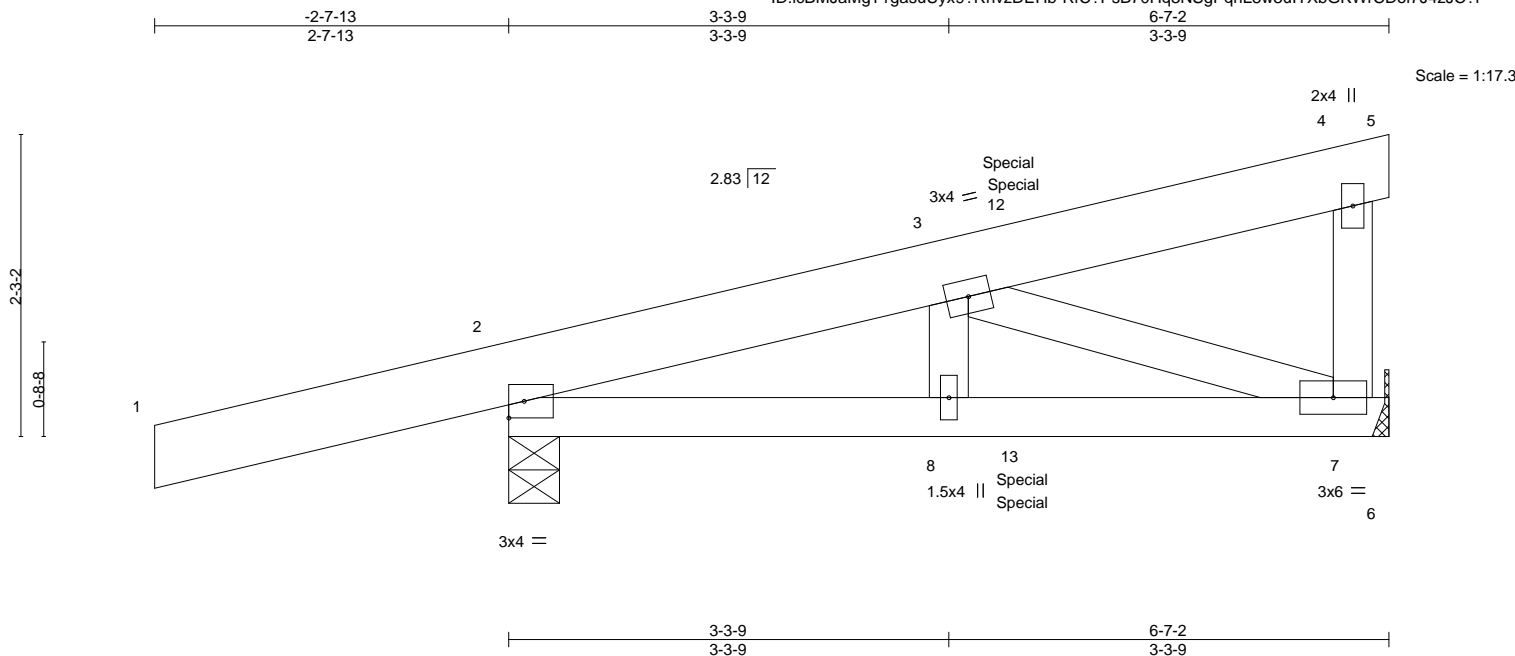

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.25	Vert(LL)	-0.01	8	>999	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.18	Vert(CT)	-0.01	7-8	>999		
BCLL 0.0	Lumber DOL 1.15	WB 0.06	Horz(CT)	0.00	7	n/a		
BCDL 10.0	Rep Stress Incr NO	Matrix-MP						
	Code IRC2018/TPI2014						Weight: 31 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x6 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 2=0-4-9, 7=Mechanical  
Max Horz 2=78(LC 7)  
Max Uplift 2=-164(LC 4), 7=-49(LC 8)  
Max Grav 2=508(LC 1), 7=256(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-311/36  
BOT CHORD 2-8=-36/261, 7-8=-36/261  
WEBS 3-7=-278/55

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 164 lb uplift at joint 2 and 49 lb uplift at joint 7.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 17 lb down and 30 lb up at 3-10-4, and 17 lb down and 30 lb up at 3-10-4 on top chord, and 11 lb down and 1 lb up at 3-10-4, and 11 lb down and 1 lb up at 3-10-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-4=-70, 4-5=-20, 6-9=-20  
Concentrated Loads (lb)  
Vert: 13=2(F=1, B=1)



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:05 2023 Page 1  
ID:icBMJaMaT1gasuUyx9?RhvzDEHb-RfC?PsB70Hg3NSqPqnL8w3uITxbGKWrCDoi7J4zJC?f

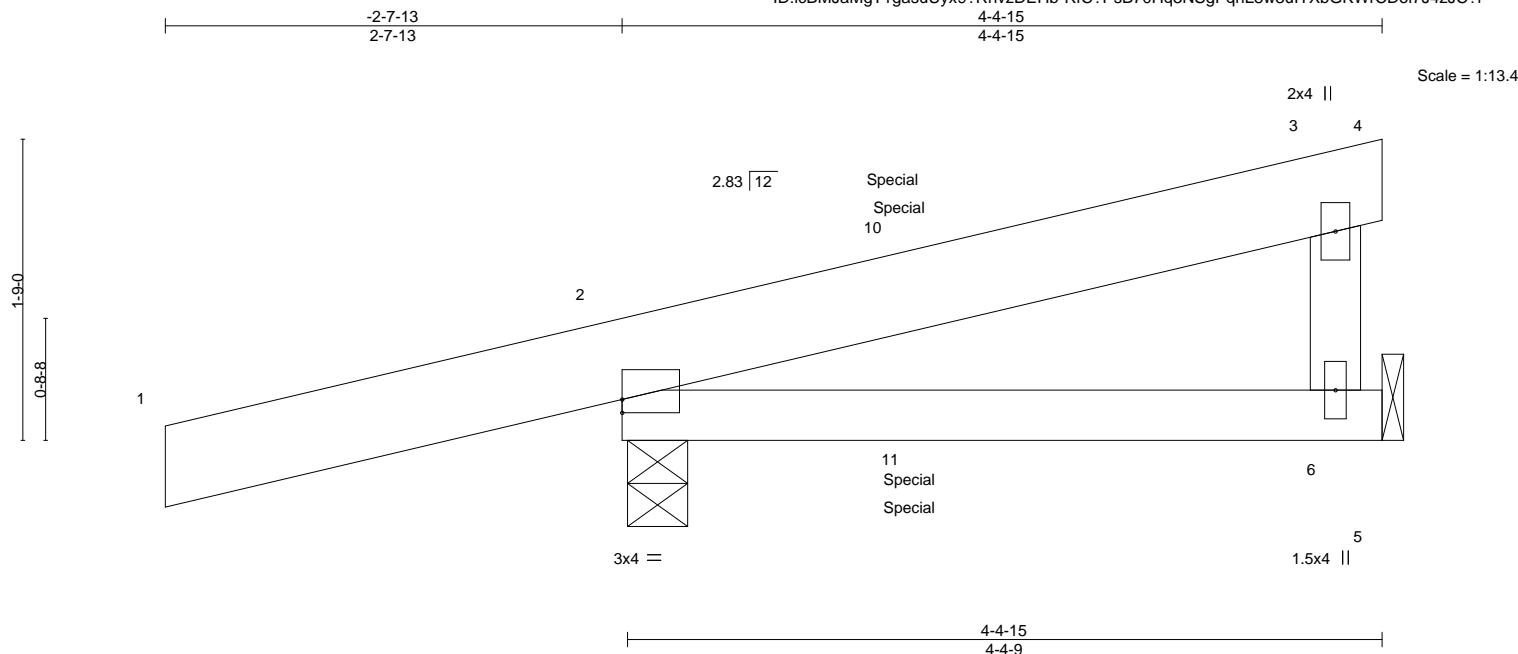


Plate Offsets (X,Y)-- [2:0-0,0-0,15]												
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d					<b>PLATES</b>	<b>GRIP</b>
TCLL	25.0	Plate Grip DOL	1.15	TC	0.25	Vert(LL)	0.01	6-9	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.11	Vert(CT)	0.01	6-9	>999	180		
BCLL	0.0	Rep Stress Incr	NO	WB	0.00	Horz(CT)	-0.00	2	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-MP							Weight: 19 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x6 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

<b>BRACING-</b>	
<b>TOP CHORD</b>	Structural wood sheathing directly applied or 4-4-15 oc purlins, except end verticals.
<b>BOT CHORD</b>	Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 6=Mechanical, 2=0-4-3  
 Max Horz 2=58(LC 7)  
 Max Uplift 6=-24(LC 8), 2=-158(LC 4)  
 Max Grav 6=117(LC 37), 2=388(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCdL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 24 lb uplift at joint 6 and 158 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 81 lb down and 170 lb up at 1-8-1, and 14 lb down and 27 lb up at 1-8-1 on top chord, and 11 lb down and 63 lb up at 1-8-1, and 8 lb down and 0 lb up at 1-8-1 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

## LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-70, 3-4=-20, 5-7=-20  
Concentrated Loads (lb)  
Vert: 10=48(B) 11=24(F=-8, B=32)




June 12, 2023



**WARNING – Velly design parameters are listed below and included with the key reference to AISC M14-15 167, § 9.5.2020 by ONE USE.**  
Design valid for use only with MITEK® connectors. This design is based only upon parameters shown, and is for the building design component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

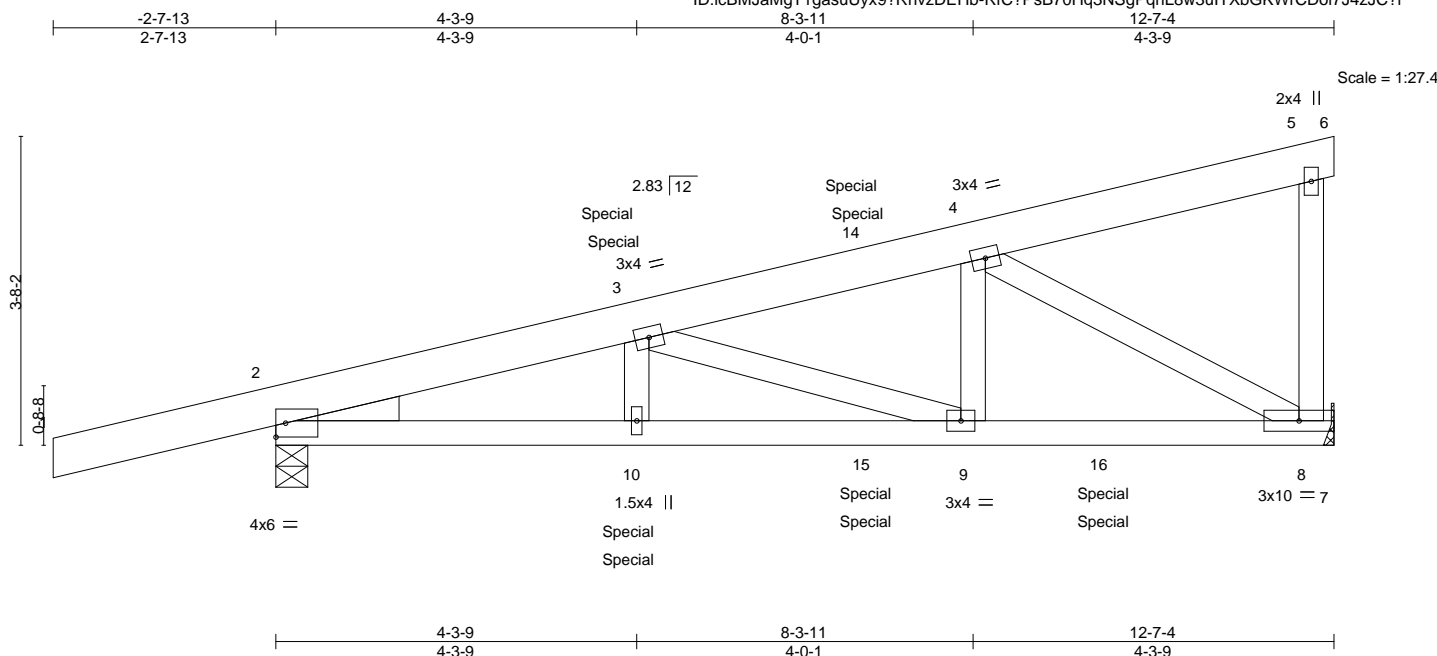

<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc)	<b>L/defl</b>	<b>L/d</b>	<b>PLATES</b>	<b>GRIP</b>
TCLL 25.0	Plate Grip DOL 1.15	TC 0.49	Vert(LL) -0.06 8-9	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.88	Vert(CT) -0.12 8-9	>999	180		
BCLL 0.0	Rep Stress Incr NO	WB 0.52	Horz(CT) 0.03 8	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-MS				Weight: 60 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x6 SPF No.2  
BOT CHORD 2x4 SPF 1650F 1.5E  
WEBS 2x4 SPF No.2  
WEDGE  
Left: 2x4 SP No.3

**BRACING-**

TOP CHORD	Structural wood sheathing directly applied or 5-4-8 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

### REACTIONS.

(size) 2=0-4-9, 8=Mechanical  
Max Horz 2=114(LC 7)  
Max Uplift 2=-232(LC 4), 8=-189(LC 8)  
Max Grav 2=923(LC 1), 8=1042(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1501/243, 3-4=-1348/243  
BOT CHORD 2-10=-260/1397, 9-10=-260/1397, 8-9=-236/1296  
WEBS 4-9=-71/579, 4-8=-1429/281

**NOTES-**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 232 lb uplift at joint 2 and 189 lb uplift at joint 8.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 21 lb down and 35 lb up at 4-2-8, 21 lb down and 35 lb up at 4-2-8, and 49 lb down and 72 lb up at 7-0-7, and 49 lb down and 72 lb up at 7-0-7 on top chord, and 12 lb down at 4-2-8, 12 lb down at 4-2-8, 32 lb down at 7-0-7, 32 lb down at 7-0-7, and 263 lb down and 86 lb up at 9-10-6, and 263 lb down and 86 lb up at 9-10-6 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

## LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-5=-70, 5-6=-20, 7-11=-20  
Concentrated Loads (lb)  
Vert: 10=-1(F=-1, B=-1) 14=-78(F=-39, B=-39) 15=-54(F=-27, B=-27) 16=-526(F=-263, B=-263)



June 12, 2023



**WARNING – Velly design parameters are listed below and included with the key reference to AISC M14-15 16f, 17f, 18f, 19f, 20f, 21f, 22f, 23f, 24f, 25f, 26f, 27f, 28f, 29f, 30f, 31f, 32f, 33f, 34f, 35f, 36f, 37f, 38f, 39f, 40f, 41f, 42f, 43f, 44f, 45f, 46f, 47f, 48f, 49f, 50f, 51f, 52f, 53f, 54f, 55f, 56f, 57f, 58f, 59f, 60f, 61f, 62f, 63f, 64f, 65f, 66f, 67f, 68f, 69f, 70f, 71f, 72f, 73f, 74f, 75f, 76f, 77f, 78f, 79f, 80f, 81f, 82f, 83f, 84f, 85f, 86f, 87f, 88f, 89f, 90f, 91f, 92f, 93f, 94f, 95f, 96f, 97f, 98f, 99f, 100f, 101f, 102f, 103f, 104f, 105f, 106f, 107f, 108f, 109f, 110f, 111f, 112f, 113f, 114f, 115f, 116f, 117f, 118f, 119f, 120f, 121f, 122f, 123f, 124f, 125f, 126f, 127f, 128f, 129f, 130f, 131f, 132f, 133f, 134f, 135f, 136f, 137f, 138f, 139f, 140f, 141f, 142f, 143f, 144f, 145f, 146f, 147f, 148f, 149f, 150f, 151f, 152f, 153f, 154f, 155f, 156f, 157f, 158f, 159f, 160f, 161f, 162f, 163f, 164f, 165f, 166f, 167f, 168f, 169f, 170f, 171f, 172f, 173f, 174f, 175f, 176f, 177f, 178f, 179f, 180f, 181f, 182f, 183f, 184f, 185f, 186f, 187f, 188f, 189f, 190f, 191f, 192f, 193f, 194f, 195f, 196f, 197f, 198f, 199f, 200f, 201f, 202f, 203f, 204f, 205f, 206f, 207f, 208f, 209f, 210f, 211f, 212f, 213f, 214f, 215f, 216f, 217f, 218f, 219f, 220f, 221f, 222f, 223f, 224f, 225f, 226f, 227f, 228f, 229f, 230f, 231f, 232f, 233f, 234f, 235f, 236f, 237f, 238f, 239f, 240f, 241f, 242f, 243f, 244f, 245f, 246f, 247f, 248f, 249f, 250f, 251f, 252f, 253f, 254f, 255f, 256f, 257f, 258f, 259f, 260f, 261f, 262f, 263f, 264f, 265f, 266f, 267f, 268f, 269f, 270f, 271f, 272f, 273f, 274f, 275f, 276f, 277f, 278f, 279f, 280f, 281f, 282f, 283f, 284f, 285f, 286f, 287f, 288f, 289f, 290f, 291f, 292f, 293f, 294f, 295f, 296f, 297f, 298f, 299f, 300f, 301f, 302f, 303f, 304f, 305f, 306f, 307f, 308f, 309f, 310f, 311f, 312f, 313f, 314f, 315f, 316f, 317f, 318f, 319f, 320f, 321f, 322f, 323f, 324f, 325f, 326f, 327f, 328f, 329f, 330f, 331f, 332f, 333f, 334f, 335f, 336f, 337f, 338f, 339f, 340f, 341f, 342f, 343f, 344f, 345f, 346f, 347f, 348f, 349f, 350f, 351f, 352f, 353f, 354f, 355f, 356f, 357f, 358f, 359f, 360f, 361f, 362f, 363f, 364f, 365f, 366f, 367f, 368f, 369f, 370f, 371f, 372f, 373f, 374f, 375f, 376f, 377f, 378f, 379f, 380f, 381f, 382f, 383f, 384f, 385f, 386f, 387f, 388f, 389f, 390f, 391f, 392f, 393f, 394f, 395f, 396f, 397f, 398f, 399f, 400f, 401f, 402f, 403f, 404f, 405f, 406f, 407f, 408f, 409f, 410f, 411f, 412f, 413f, 414f, 415f, 416f, 417f, 418f, 419f, 420f, 421f, 422f, 423f, 424f, 425f, 426f, 427f, 428f, 429f, 430f, 431f, 432f, 433f, 434f, 435f, 436f, 437f, 438f, 439f, 440f, 441f, 442f, 443f, 444f, 445f, 446f, 447f, 448f, 449f, 450f, 451f, 452f, 453f, 454f, 455f, 456f, 457f, 458f, 459f, 460f, 461f, 462f, 463f, 464f, 465f, 466f, 467f, 468f, 469f, 470f, 471f, 472f, 473f, 474f, 475f, 476f, 477f, 478f, 479f, 480f, 481f, 482f, 483f, 484f, 485f, 486f, 487f, 488f, 489f, 490f, 491f, 492f, 493f, 494f, 495f, 496f, 497f, 498f, 499f, 500f, 501f, 502f, 503f, 504f, 505f, 506f, 507f, 508f, 509f, 510f, 511f, 512f, 513f, 514f, 515f, 516f, 517f, 518f, 519f, 520f, 521f, 522f, 523f, 524f, 525f, 526f, 527f, 528f, 529f, 530f, 531f, 532f, 533f, 534f, 535f, 536f, 537f, 538f, 539f, 540f, 541f, 542f, 543f, 544f, 545f, 546f, 547f, 548f, 549f, 550f, 551f, 552f, 553f, 554f, 555f, 556f, 557f, 558f, 559f, 560f, 561f, 562f, 563f, 564f, 565f, 566f, 567f, 568f, 569f, 570f, 571f, 572f, 573f, 574f, 575f, 576f, 577f, 578f, 579f, 580f, 581f, 582f, 583f, 584f, 585f, 586f, 587f, 588f, 589f, 590f, 591f, 592f, 593f, 594f, 595f, 596f, 597f, 598f, 599f, 600f, 601f, 602f, 603f, 604f, 605f, 606f, 607f, 608f, 609f, 610f, 611f, 612f, 613f, 614f, 615f, 616f, 617f, 618f, 619f, 620f, 621f, 622f, 623f, 624f, 625f, 626f, 627f, 628f, 629f, 630f, 631f, 632f, 633f, 634f, 635f, 636f, 637f, 638f, 639f, 640f, 641f, 642f, 643f, 644f, 645f, 646f, 647f, 648f, 649f, 650f, 651f, 652f, 653f, 654f, 655f, 656f, 657f, 658f, 659f, 660f, 661f, 662f, 663f, 664f, 665f, 666f, 667f, 668f, 669f, 670f, 671f, 672f, 673f, 674f, 675f, 676f, 677f, 678f, 679f, 680f, 681f, 682f, 683f, 684f, 685f, 686f, 687f, 688f, 689f, 690f, 691f, 692f, 693f, 694f, 695f, 696f, 697f, 698f, 699f, 700f, 701f, 702f, 703f, 704f, 705f, 706f, 707f,**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837507
3603730	CJ7	Jack-Open	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:07 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

-2-7-13  
2-7-13

1-9-2  
1-9-2

Scale = 1:8.5

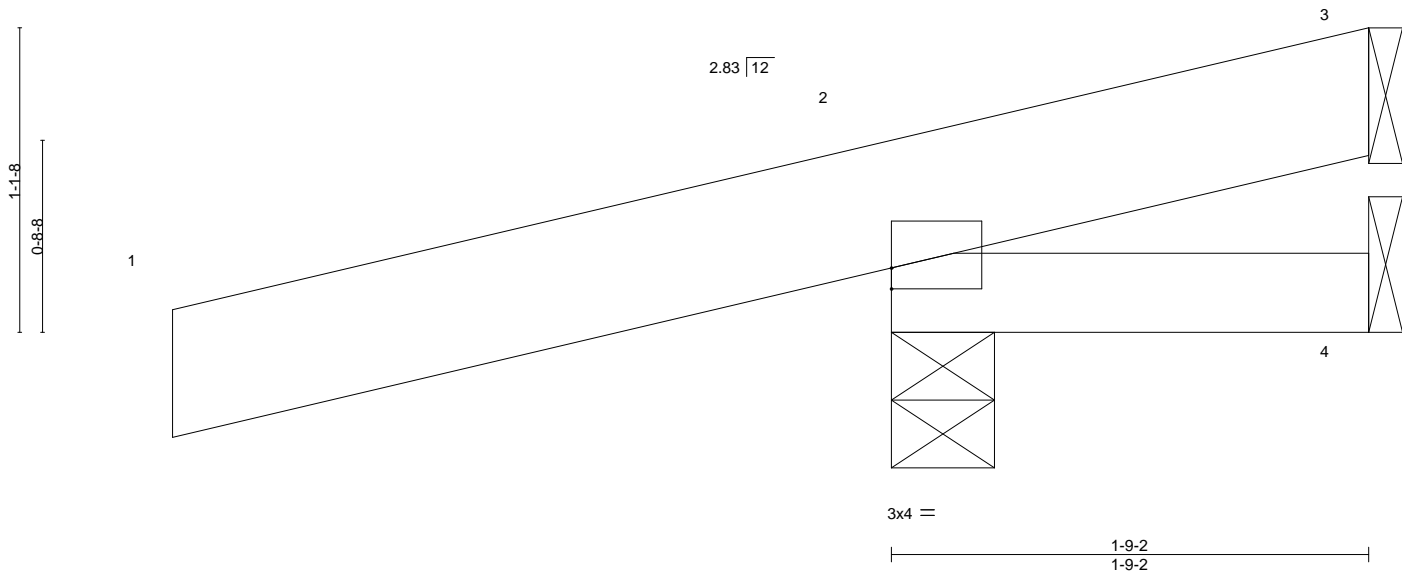


Plate Offsets (X,Y)-- [2:0-0-0,0-0-15]											
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d			PLATES GRIP		
TCLL	25.0	Plate Grip DOL	1.15	TC	0.22	Vert(LL)	0.00	7	>999	240	MT20 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.08	Vert(CT)	0.00	7	>999	180	
BCLL	0.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.00	3	n/a	n/a	
BCDL	10.0	Code IRC2018/TPI2014		Matrix-MP							Weight: 10 lb FT = 20%

#### LUMBER-

TOP CHORD 2x6 SPF No.2  
BOT CHORD 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-9-2 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 3=Mechanical, 2=0-4-9, 4=Mechanical  
Max Horz 2=46(LC 8)  
Max Uplift 3=-50(LC 1), 2=-181(LC 8), 4=-12(LC 1)  
Max Grav 3=36(LC 8), 2=405(LC 1), 4=19(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 50 lb uplift at joint 3, 181 lb uplift at joint 2 and 12 lb uplift at joint 4.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837508
3603730	CJ8	Diagonal Hip Girder	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,


8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:08 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

-2-7-13  
2-7-13

4-7-1  
4-7-1

Scale = 1:13.7

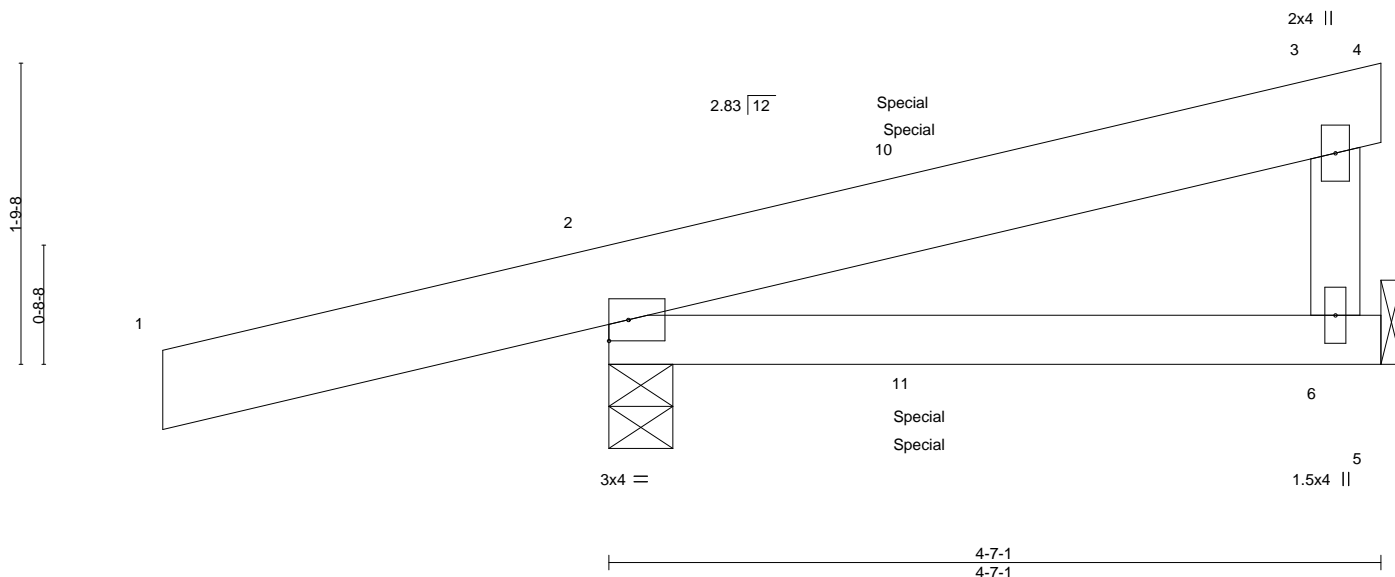

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.31	Vert(LL)	0.02	6-9	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.23	Vert(CT)	0.03	6-9	>999	180		
BCLL 0.0	Rep Stress Incr	NO	WB 0.00	Horz(CT)	-0.01	2	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP						Weight: 20 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x6 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-7-1 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 6=Mechanical, 2=0-4-9  
Max Horz 2=60(LC 7)  
Max Uplift 6=31(LC 21), 2=151(LC 4)  
Max Grav 6=119(LC 37), 2=354(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 31 lb uplift at joint 6 and 151 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 73 lb down and 152 lb up at 1-10-3, and 73 lb down and 152 lb up at 1-10-3 on top chord, and 11 lb down and 58 lb up at 1-10-3, and 11 lb down and 58 lb up at 1-10-3 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-70, 3-4=-20, 5-7=-20  
Concentrated Loads (lb)  
Vert: 10=86(F=43, B=43) 11=59(F=30, B=30)



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837509
3603730	CJ9	Jack-Open	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:09 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

-2-7-13  
2-7-13

2-5-15  
2-5-15

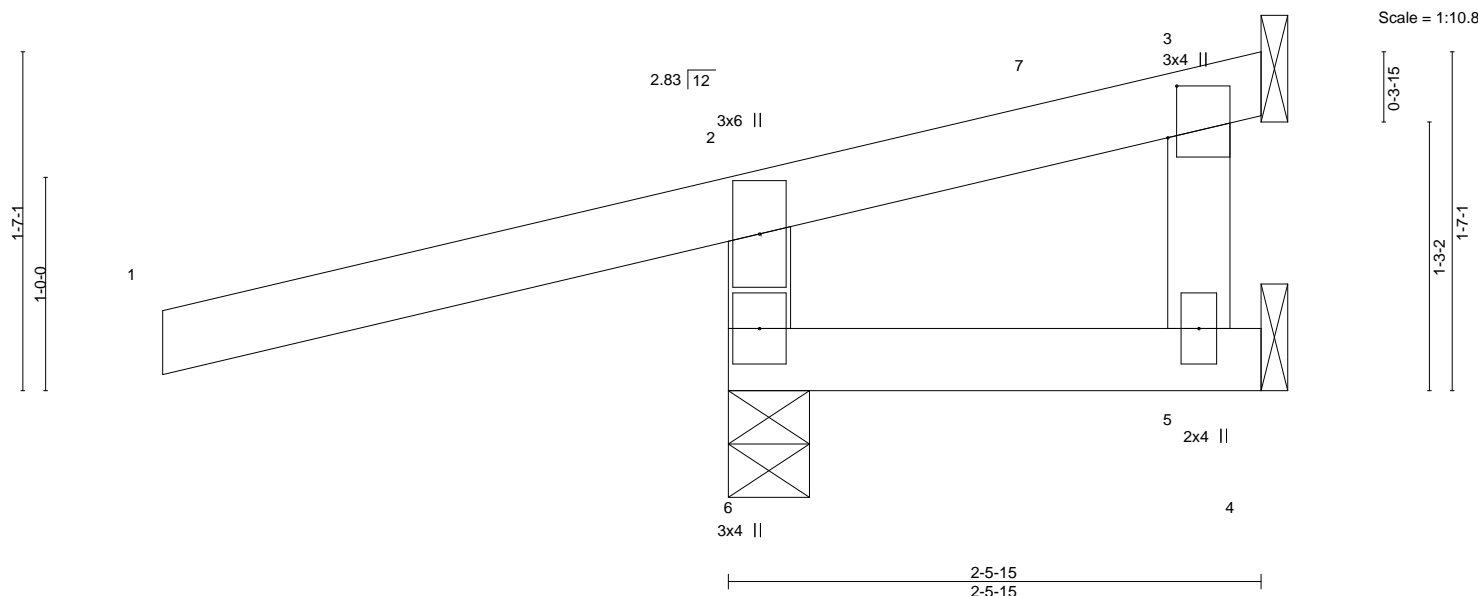


Plate Offsets (X,Y)--		[3:0-2-15,0-0-8]											
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d				<b>PLATES</b>		<b>GRIP</b>	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.55	Vert(LL)	0.00	5-6	>999	240	MT20	197/144	
TCDL	10.0	Lumber DOL	1.15	BC	0.18	Vert(CT)	0.00	5-6	>999	180			
BCLL	0.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.02	3	n/a	n/a			
BCDL	10.0	Code IRC2018/TPI2014		Matrix-MP							Weight: 11 lb	FT = 20%	

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-5-15 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 6=0-4-9, 5=Mechanical, 3=Mechanical  
Max Horz 6=37(LC 11)  
Max Uplift 6=177(LC 8), 5=17(LC 25), 3=68(LC 25)  
Max Grav 6=421(LC 1), 5=40(LC 3), 3=18(LC 8)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-6=-361/340

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -2-7-13 to 1-7-1, Exterior(2R) 1-7-1 to 2-2-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 177 lb uplift at joint 6, 17 lb uplift at joint 5 and 68 lb uplift at joint 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837510
3603730	CJ10	Jack-Open	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:00 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

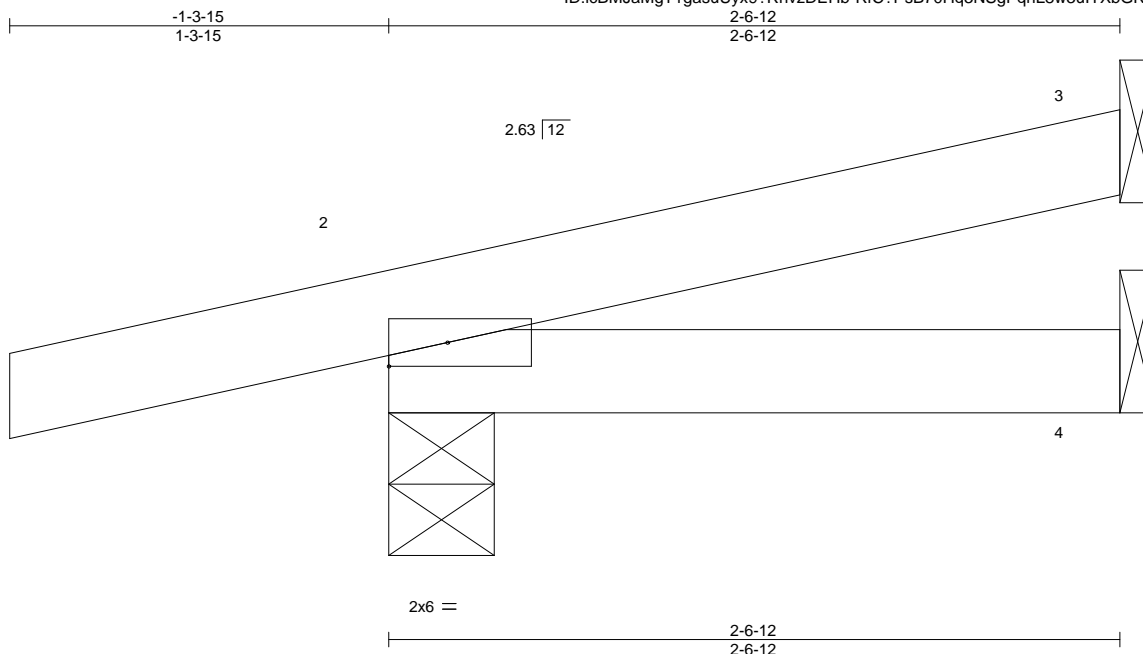

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.11	Vert(LL)	-0.00	7	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	-0.00	4-7	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP						Weight: 8 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-6-12 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 3=Mechanical, 2=0-4-7, 4=Mechanical  
Max Horz 2=34(LC 8)  
Max Uplift 3=23(LC 12), 2=78(LC 8)  
Max Grav 3=64(LC 1), 2=230(LC 1), 4=42(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 23 lb uplift at joint 3 and 78 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows
3603730	D1	Hip Girder	1	1	I58837511
Job Reference (optional)					

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:10 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f



Scale = 1:28.6

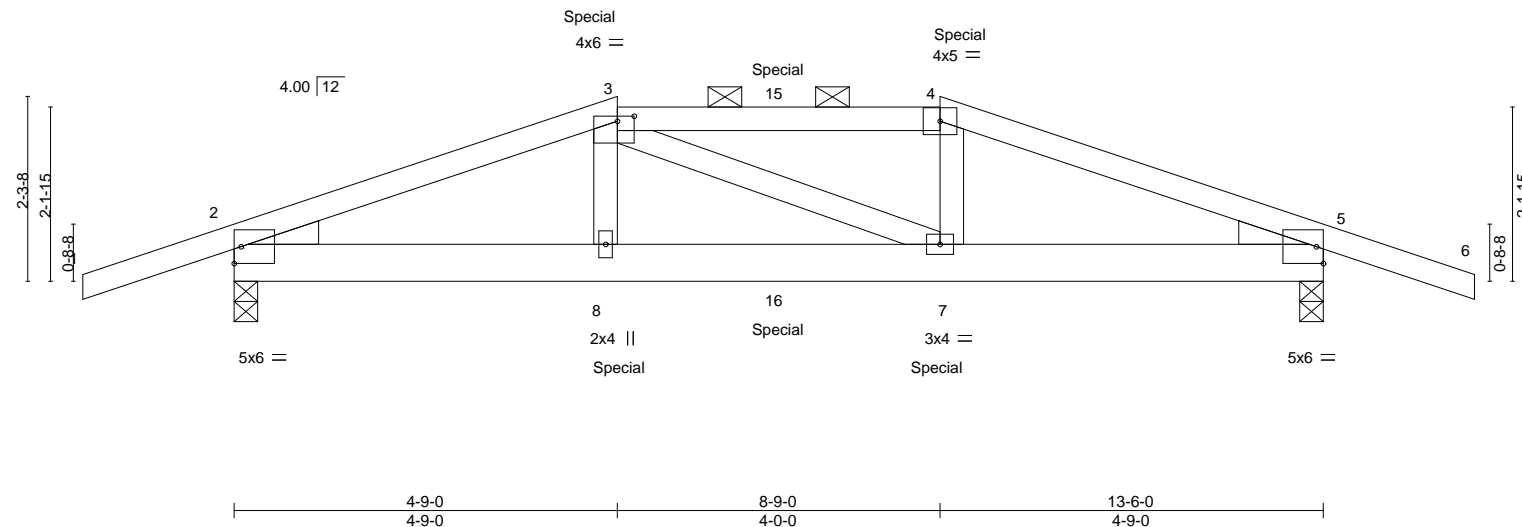


Plate Offsets (X,Y)-- [3:0-2-8,0-0-12]							
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.55	Vert(LL)	-0.08	7-8	>999
TCDL 10.0	Lumber DOL	1.15	BC 0.78	Vert(CT)	-0.14	7-8	>999
BCLL 0.0	Rep Stress Incr	NO	WB 0.07	Horz(CT)	0.03	5	n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS				
						<b>PLATES</b>	<b>GRIP</b>
						MT20	197/144
						Weight: 56 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x6 SPF No.2  
WEBS 2x4 SPF No.2  
WEDGE  
Left: 2x4 SP No.3 , Right: 2x4 SP No.3

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-8-12 oc purlins, except  
2-0-0 oc purlins (3-9-5 max.): 3-4.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 2=0-3-8, 5=0-3-8  
Max Horz 2=-36(LC 26)  
Max Uplift 2=-260(LC 4), 5=-260(LC 5)  
Max Grav 2=1108(LC 1), 5=1108(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1988/371, 3-4=-1810/369, 4-5=-1980/369  
BOT CHORD 2-8=-319/1836, 7-8=-320/1817, 5-7=-305/1828  
WEBS 3-8=0/300, 4-7=0/297

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 260 lb uplift at joint 2 and 260 lb uplift at joint 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 85 lb down and 62 lb up at 4-9-0, and 62 lb down and 54 lb up at 6-9-0, and 85 lb down and 62 lb up at 8-9-0 on top chord, and 260 lb down and 77 lb up at 4-9-0, and 40 lb down at 6-9-0, and 260 lb down and 77 lb up at 8-8-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-70, 3-4=-70, 4-6=-70, 9-12=-20



June 12, 2023

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837511
3603730	D1	Hip Girder	1	1	Job Reference (optional)	

**LOAD CASE(S)** Standard  
Concentrated Loads (lb)  
Vert: 3=-62(F) 4=-62(F) 8=-260(F) 7=-260(F) 15=-62(F) 16=-33(F)

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837512
3603730	D2	Common	2	1		

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:12 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

-1-10-8	6-9-0	13-6-0	15-4-8
1-10-8	6-9-0	6-9-0	1-10-8

Scale = 1:27.7

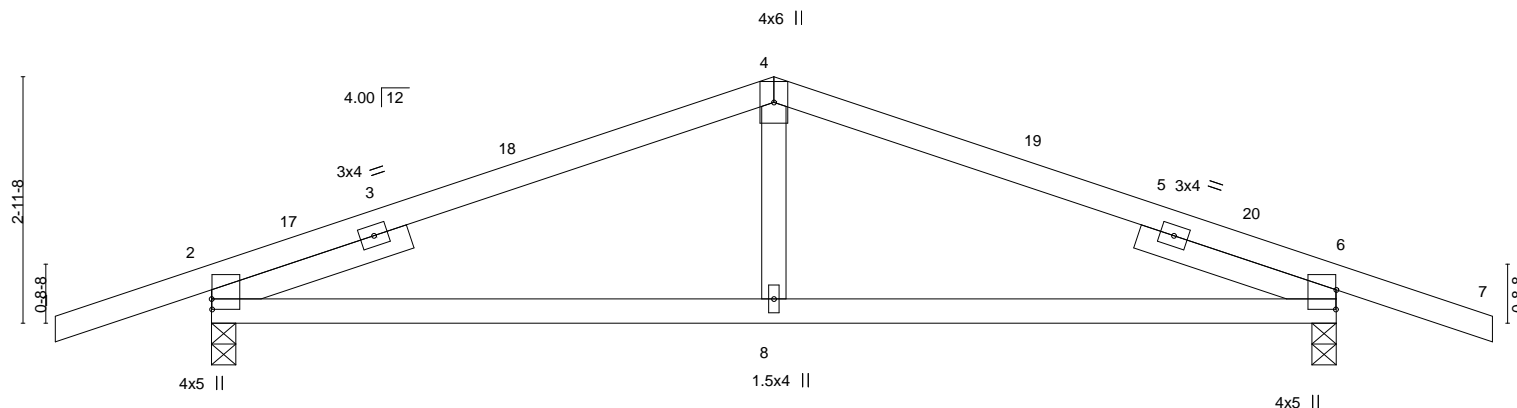


Plate Offsets (X,Y)--	[2:0-1-8,0-0-1], [6:0-2-13,0-0-1]
-----------------------	-----------------------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.37	Vert(LL)	-0.05	8-15	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.34	Vert(CT)	-0.08	8-15	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.02	2	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 45 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 SLIDER Left 2x4 SPF No.2 2-6-0, Right 2x4 SPF No.2 2-6-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
 BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 2=0-3-8, 6=0-3-8  
 Max Horz 2=-46(LC 13)  
 Max Uplift 2=-160(LC 8), 6=-160(LC 9)  
 Max Grav 2=739(LC 1), 6=739(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-862/264, 4-6=-862/264  
 BOT CHORD 2-8=-148/813, 6-8=-148/813  
 WEBS 4-8=0/264

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 6-9-0, Exterior(2R) 6-9-0 to 9-9-0, Interior(1) 9-9-0 to 15-4-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 160 lb uplift at joint 2 and 160 lb uplift at joint 6.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
 Chesterfield, MO 63017



Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:14 2023 Page 1  
ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITxbGKwfrCDoi7J4zJC?

4-7-12 9-0-0 14-6-0 20-1-12 24-9-12 29-4-0 33-11-15 39-4-0 40-2-8  
4-7-12 4-4-4 5-6-0 5-7-12 4-8-0 4-6-4 4-7-15 5-4-1 0-10-8

Scale = 1:66.0

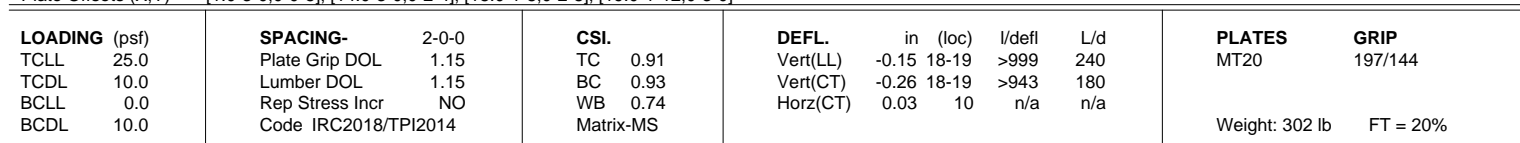

**REACTIONS.** (size) 1=0-3-8, 16=0-3-8, 10=0-3-8  
 Max Horz 1=-69(LC 9)  
 Max Uplift 1=-317(LC 8), 16=-1581(LC 5), 10=-329(LC 5)  
 Max Grav 1=1449(LC 21), 16=7028(LC 1), 10=1518(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**TOP CHORD** 1-3=-3085/728, 3-4=-817/331, 4-5=-817/331, 5-7=-267/550, 7-8=-267/550,  
 8-9=-1745/457, 9-10=-3624/799

**BOT CHORD** 1-19=-646/2838, 18-19=-640/2805, 16-18=-4239/971, 14-16=-4239/971, 13-14=-306/1532,  
 12-13=-706/3403, 10-12=-706/3403

**WEBS** 3-19=-314/1775, 3-18=-2411/471, 4-18=-423/144, 5-18=-1218/5503, 5-16=-5914/1360,  
 5-14=-1022/4573, 7-14=-307/128, 8-14=-2480/515, 8-13=-335/1692, 9-13=-1951/417,  
 9-12=-142/989

- NOTES-**
- 1) 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Bottom chords connected as follows: 2x4 - 1 row at 0-2-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
  - 2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
  - 3) Unbalanced roof live loads have been considered for this design.
  - 4) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 5) Provide adequate drainage to prevent water ponding.
  - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 317 lb uplift at joint 1, 1581 lb uplift at joint 16 and 329 lb uplift at joint 10.
  - 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

June 12, 2023



Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837513
3603730	E1	Hip Girder	1	2	Job Reference (optional)	

**NOTES-**

10) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1383 lb down and 328 lb up at 9-0-0, 370 lb down and 111 lb up at 11-0-12, 370 lb down and 111 lb up at 13-0-12, 370 lb down and 111 lb up at 15-0-12, 370 lb down and 111 lb up at 17-0-12, 370 lb down and 111 lb up at 19-0-12, 370 lb down and 111 lb up at 21-0-12, 370 lb down and 111 lb up at 23-0-12, 370 lb down and 111 lb up at 25-0-12, 370 lb down and 111 lb up at 27-0-12, 370 lb down and 111 lb up at 29-0-12, 365 lb down and 92 lb up at 31-0-12, and 365 lb down and 89 lb up at 33-0-12, and 552 lb down and 122 lb up at 35-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

**LOAD CASE(S)** Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-3=-70, 3-8=-70, 8-11=-70, 21-25=-20

Concentrated Loads (lb)


Vert: 19=-1383(F) 14=-370(F) 15=-370(F) 29=-370(F) 30=-370(F) 31=-370(F) 32=-370(F) 33=-370(F) 34=-370(F) 35=-370(F) 36=-370(F) 37=-365(F) 38=-365(F) 39=-552(F)

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows
3603730	E2	Roof Special Girder	1	1	I58837514
Job Reference (optional)					


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:15 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f



Scale = 1:22.9

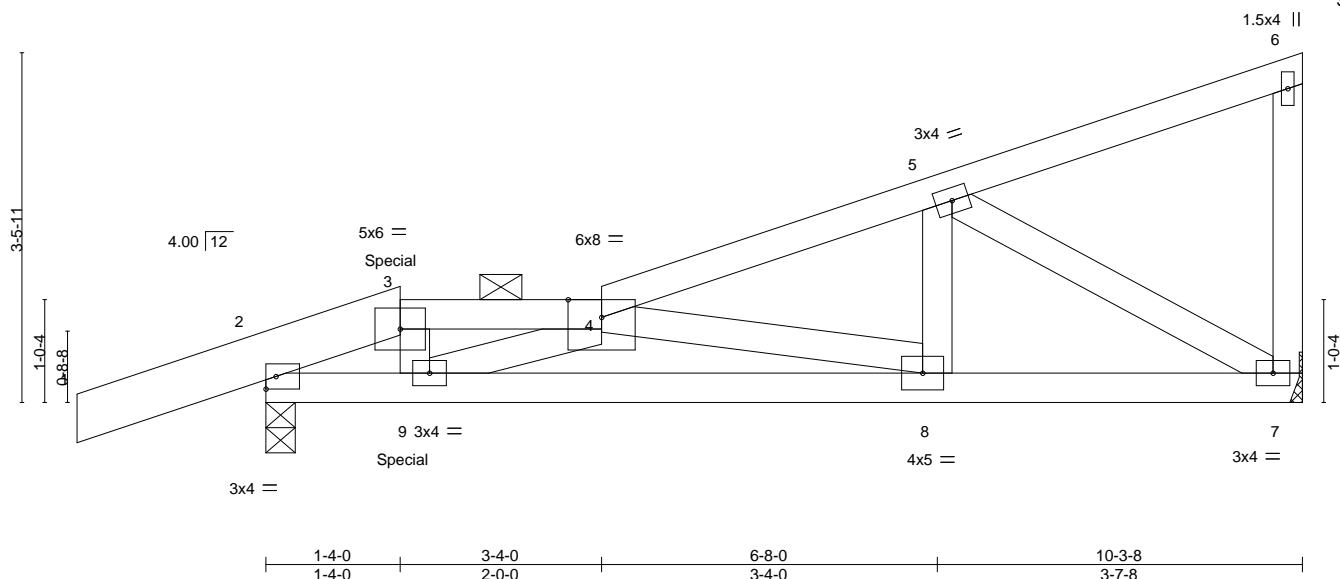

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.18	Vert(LL)	-0.03	8-9	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.38	Vert(CT)	-0.06	8-9	>999	180		
BCLL 0.0	Rep Stress Incr	NO	WB 0.18	Horz(CT)	0.01	7	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS						Weight: 44 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2 "Except"  
1-3: 2x6 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 7=Mechanical, 2=0-3-8  
Max Horz 2=132(LC 7)  
Max Uplift 7=84(LC 8), 2=123(LC 4)  
Max Grav 7=435(LC 1), 2=538(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-642/22, 3-4=-603/26, 4-5=-611/84  
BOT CHORD 2-9=-78/494, 8-9=-192/1056, 7-8=-84/555  
WEBS 3-9=-13/282, 4-8=-514/110, 5-8=0/264, 5-7=-626/126, 4-9=-658/212

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Provide adequate drainage to prevent water ponding.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 84 lb uplift at joint 7 and 123 lb uplift at joint 2.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 139 lb down and 262 lb up at 1-4-0 on top chord, and 41 lb down and 44 lb up at 1-4-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-70, 3-4=-70, 4-6=-70, 7-10=-20  
Concentrated Loads (lb)  
Vert: 3=71(F)



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837515
3603730	E3	Roof Special	1	1		


Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:16 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Job Reference (optional)



3x4 || Scale = 1:21.6


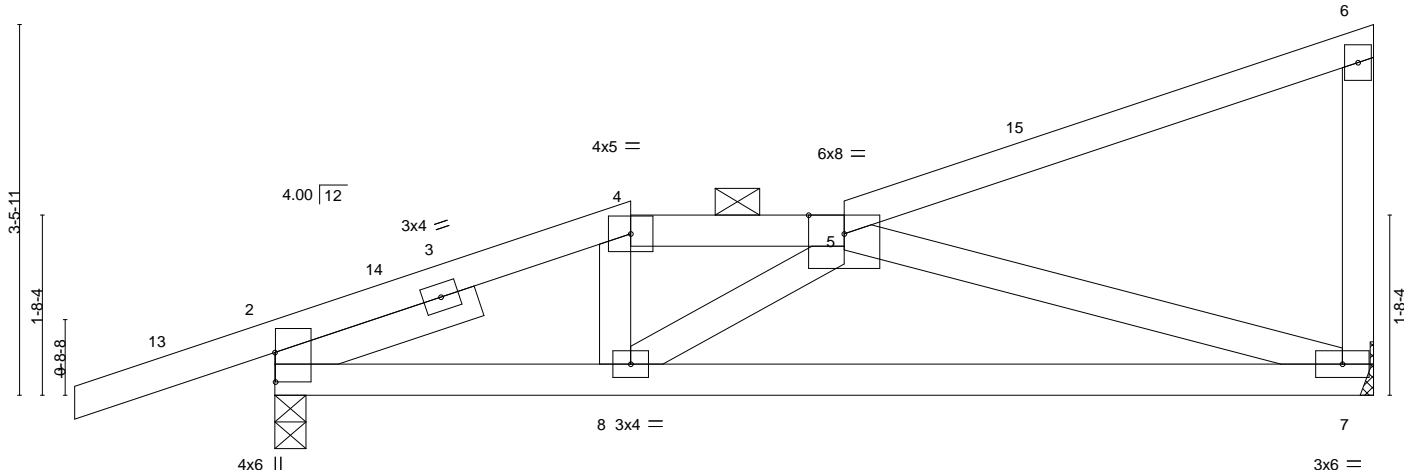


Plate Offsets (X,Y)--		[2:0-3-5,0-0-1]									
<b>LOADING</b> (psf)		<b>SPACING-</b>	2-0-0	<b>CSI.</b>		<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL	25.0	Plate Grip DOL	1.15	TC	0.24	Vert(LL)	-0.07	7-8	>999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.37	Vert(CT)	-0.14	7-8	>883		
BCLL	0.0	Rep Stress Incr	YES	WB	0.35	Horz(CT)	0.01	7	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 42 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-5.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 7=Mechanical, 2=0-3-8  
Max Horz 2=131(LC 11)  
Max Uplift 7=-88(LC 12), 2=-149(LC 8)  
Max Grav 7=444(LC 1), 2=600(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-713/135, 4-5=-635/145  
BOT CHORD 2-8=-293/653, 7-8=-320/768  
WEBS 5-7=-754/286

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 3-4-0, Exterior(2E) 3-4-0 to 5-4-0, Interior(1) 5-4-0 to 10-1-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Provide adequate drainage to prevent water ponding.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 88 lb uplift at joint 7 and 149 lb uplift at joint 2.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 3603730	Truss E4	Truss Type Half Hip Girder	Qty 1	Ply 1	Summit/193 Highland Meadows I58837516
Job Reference (optional)					

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:18 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:20.5

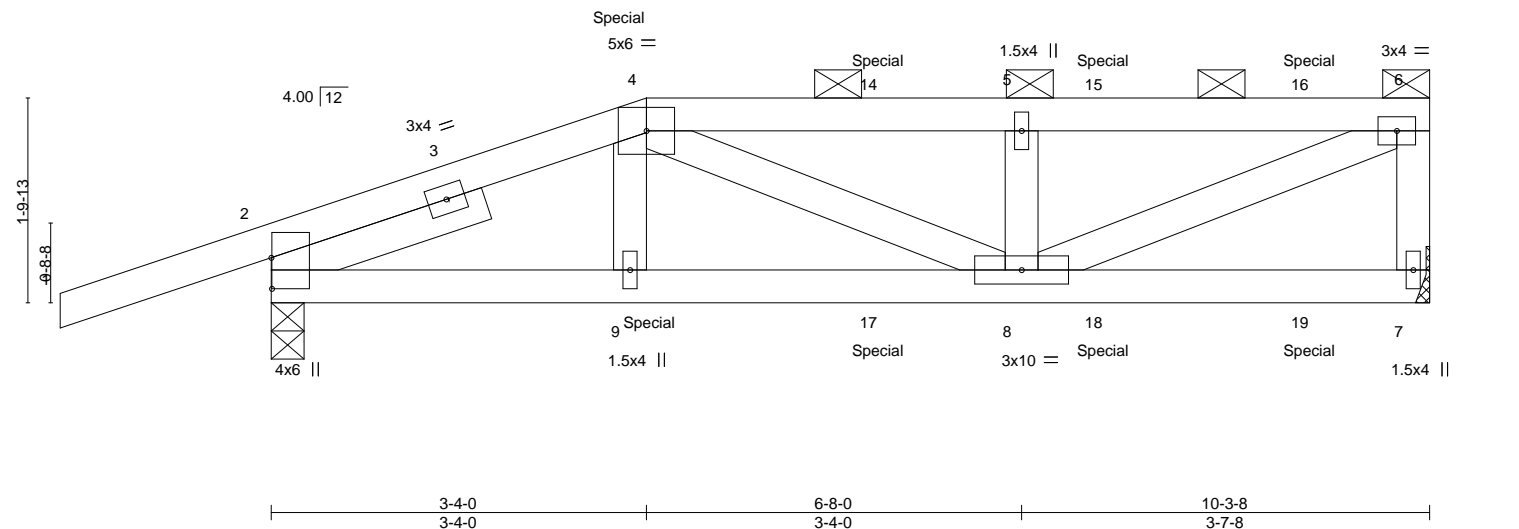


Plate Offsets (X,Y)-- [2:0-3-5,0-0-1]		3-4-0 3-4-0		6-8-0 3-4-0		10-3-8 3-7-8	
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.27	Vert(LL)	-0.02 8-9	>999	240
TCDL 10.0	Lumber DOL	1.15	BC 0.36	Vert(CT)	-0.04 8-9	>999	180
BCLL 0.0	Rep Stress Incr	NO	WB 0.21	Horz(CT)	0.01 7	n/a	n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS				
				<b>PLATES</b>	<b>GRIP</b>		
				MT20	197/144		
				Weight: 40 lb	FT = 20%		

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-6.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 7=Mechanical, 2=0-3-8  
Max Horz 2=67(LC 7)  
Max Uplift 7=102(LC 5), 2=179(LC 4)  
Max Grav 7=518(LC 1), 2=676(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-841/165, 4-5=-837/175, 5-6=-837/175, 6-7=-471/115  
BOT CHORD 2-9=-168/769, 8-9=-170/760  
WEBS 5-8=-293/114, 6-8=-175/871

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 102 lb uplift at joint 7 and 179 lb uplift at joint 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 33 lb down and 38 lb up at 3-4-0, 30 lb down and 38 lb up at 5-4-12, and 30 lb down and 37 lb up at 7-4-12, and 30 lb down and 39 lb up at 9-2-12 on top chord, and 103 lb down and 44 lb up at 3-4-0, 19 lb down at 5-4-12, and 19 lb down at 7-4-12, and 19 lb down at 9-2-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-4=-70, 4-6=-70, 7-10=-20



June 12, 2023

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837516
3603730	E4	Half Hip Girder	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:18 2023 Page 2  
ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

**LOAD CASE(S)** Standard  
Concentrated Loads (lb)  
Vert: 9=-78(B) 4=-9(B) 14=-9(B) 15=-9(B) 16=-12(B) 17=-10(B) 18=-10(B) 19=-11(B)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:19 2023 Page 1  
ID:icBMJaMaT1gasuUvx9?RhvzDEHb-RfC?PsB70Hg3NSqPanL8w3uITxbGKWrCDoi7J4zJC?f

-1-10-8	3-2-8	5-11-8	9-0-0
1-10-8	3-2-8	2-9-0	3-0-8

Scale = 1:20.6

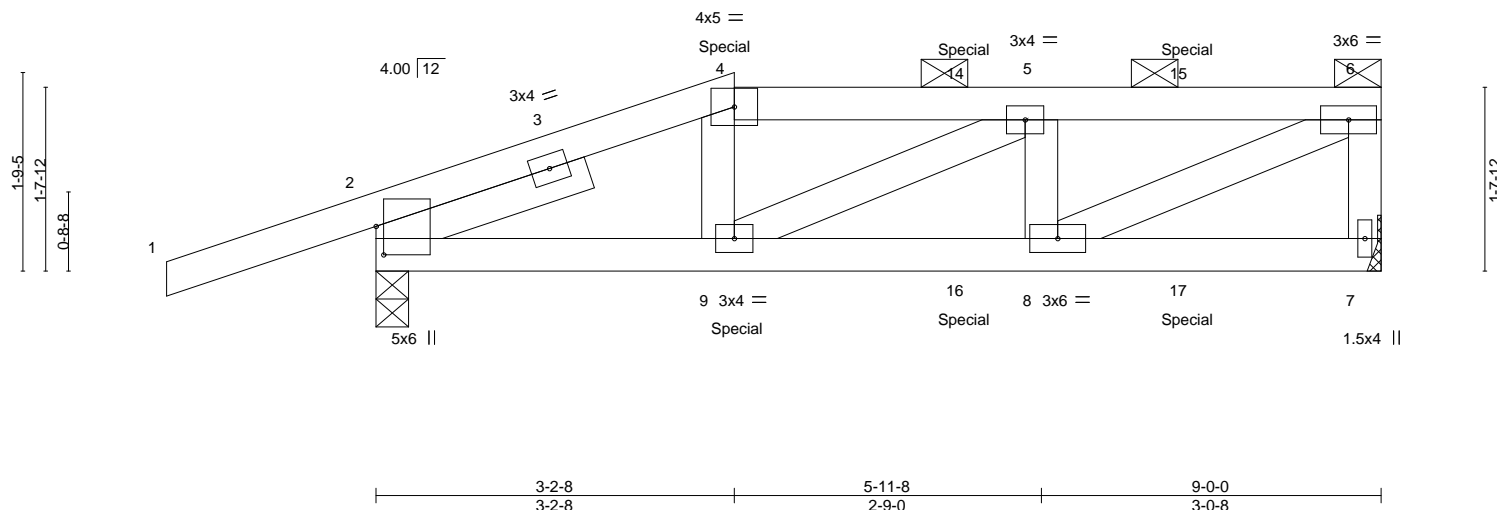


Plate Offsets (X,Y)-- [2:0-3-1,0-0-13]														
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d					<b>PLATES</b>		<b>GRIP</b>	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.27	Vert(LL)	-0.02	8-9	>999	240	MT20	197/144		
TCDL	10.0	Lumber DOL	1.15	BC	0.45	Vert(CT)	-0.04	8-9	>999	180				
BCLL	0.0	Rep Stress Incr	NO	WB	0.25	Horz(CT)	0.01	7	n/a	n/a				
BCDL	10.0	Code IRC2018/TPI2014		Matrix-MS							Weight: 36 lb	FT = 20%		

**LUMBER-**

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x4 SPF No.2
SLIDER	Left 2x4 SPF No.2 2-0-0

<b>BRACING- TOP CHORD</b>	Structural wood sheathing directly applied or 5-9-14 oc purlins, except end verticals, and 2-0-0 oc purlins (5-10-10 max.): 4-6.
<b>BOT CHORD</b>	Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 7=Mechanical, 2=0-3-8  
Max Horz 2=60(LC 7)  
Max Uplift 7=-101(LC 5), 2=-183(LC 4)  
Max Grav 7=572(LC 1), 2=707(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-927/168, 4-5=-850/166, 5-6=-927/175, 6-7=-535/113  
BOT CHORD 2-9=-176/860, 8-9=-178/927  
WEBS 5-8=-297/121, 6-8=-185/1024

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16;  $V_{ult}=115\text{mph}$  (3-second gust)  $V_{asd}=91\text{mph}$ ;  $TCDL=6.0\text{psf}$ ;  $BCDL=4.2\text{psf}$ ;  $h=15\text{ft}$ ; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 101 lb uplift at joint 7 and 183 lb uplift at joint 2.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 9) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 77 lb down and 55 lb up at 3-2-8, and 54 lb down and 55 lb up at 5-3-4, and 54 lb down and 55 lb up at 7-3-4 on top chord, and 117 lb down and 40 lb up at 3-2-8, and 36 lb down at 5-3-4, and 36 lb down at 7-3-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 10) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

## LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-4=-70, 4-6=-70, 7-10=-20



June 12.2023

Continued on page 2



Design valid for use only with MiTEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personnel injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Code**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837517
3603730	F1	Half Hip Girder	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:19 2023 Page 2  
ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f


**LOAD CASE(S)** Standard  
Concentrated Loads (lb)  
Vert: 4=-54(F) 9=-117(F) 14=-54(F) 15=-54(F) 16=-36(F) 17=-36(F)

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837518
3603730	F2	Half Hip	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:20 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f



Scale = 1:20.6

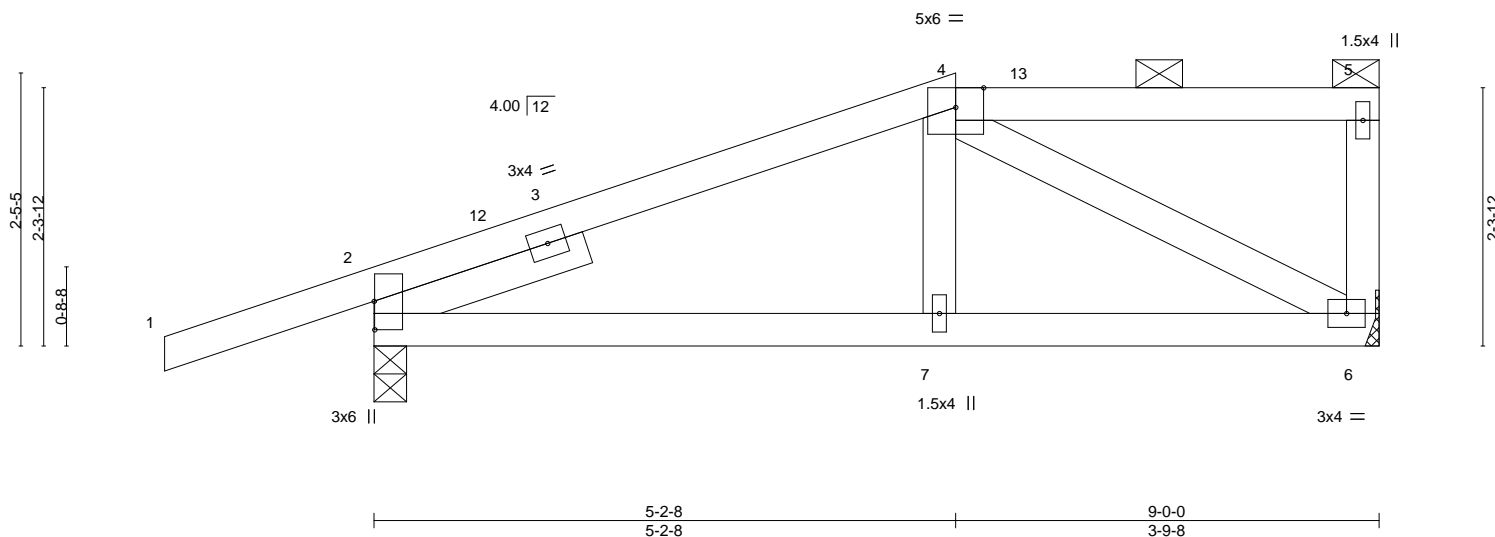


Plate Offsets (X,Y)--		[2:0-3-1,0-0-1]									
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d			<b>PLATES</b> <b>GRIP</b>		
TCLL	25.0	Plate Grip DOL	1.15	TC	0.25	Vert(LL)	0.02	7-10	>999	240	MT20 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.18	Vert(CT)	-0.02	7-10	>999	180	
BCLL	0.0	Rep Stress Incr	YES	WB	0.15	Horz(CT)	-0.01	2	n/a	n/a	
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS							Weight: 34 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-5.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 2=0-3-8, 6=Mechanical  
Max Horz 2=87(LC 11)  
Max Uplift 2=-144(LC 8), 6=-69(LC 8)  
Max Grav 2=544(LC 1), 6=385(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-434/153  
BOT CHORD 2-7=-226/414, 6-7=-227/406  
WEBS 4-6=-467/233

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 5-2-8, Exterior(2E) 5-2-8 to 8-10-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 144 lb uplift at joint 2 and 69 lb uplift at joint 6.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837519
3603730	F3	Half Hip	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:21 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:20.7

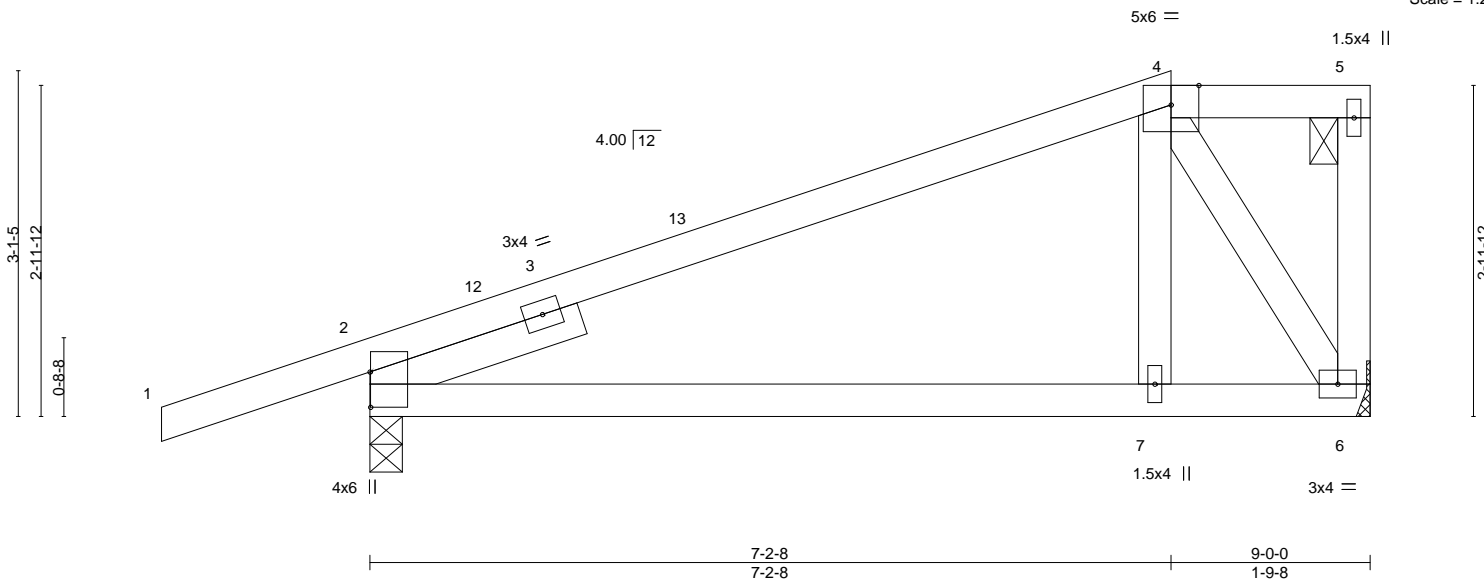


Plate Offsets (X,Y)--		[2:0-3-13,0-0-1]									
<b>LOADING</b> (psf)		<b>SPACING-</b>	2-0-0	<b>CSI.</b>		<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL	25.0	Plate Grip DOL	1.15	TC	0.57	Vert(LL)	0.07 7-10	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.41	Vert(CT)	-0.13 7-10	>842	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.09	Horz(CT)	0.03 2	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 34 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins: 4-5.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 2=0-3-8, 6=Mechanical  
Max Horz 2=113(LC 11)  
Max Uplift 2=141(LC 8), 6=72(LC 8)  
Max Grav 2=544(LC 1), 6=385(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-294/156  
BOT CHORD 2-7=-155/252  
WEBS 4-7=-34/284, 4-6=-468/236

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 7-2-8, Exterior(2E) 7-2-8 to 8-10-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 141 lb uplift at joint 2 and 72 lb uplift at joint 6.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 12,2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837520
3603730	F4	Jack-Partial	11	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:22 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWCDoi7J4zJC?f



Scale = 1:22.7

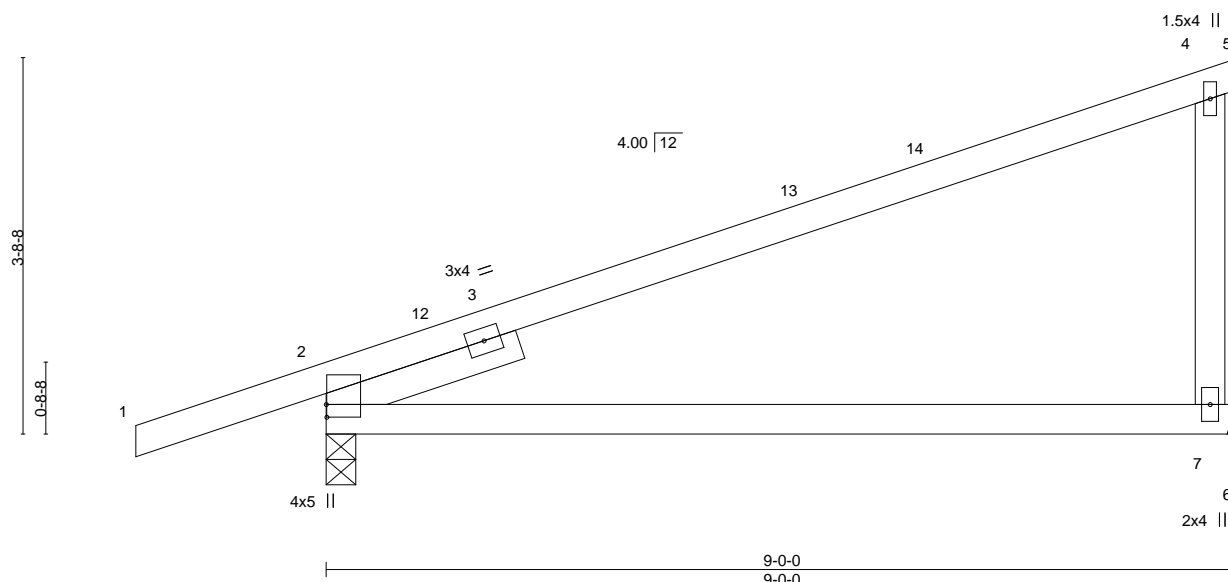


Plate Offsets (X,Y)--		[2:0-1-8,0-0-1]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0		Plate Grip DOL	1.15	TC 1.00		Vert(LL)	-0.23 7-10	>455	240	MT20	197/144
TCDL 10.0		Lumber DOL	1.15	BC 0.68		Vert(CT)	-0.51 7-10	>203	180		
BCLL 0.0		Rep Stress Incr	YES	WB 0.06		Horz(CT)	0.09 2	n/a	n/a		
BCDL 10.0		Code IRC2018/TPI2014		Matrix-AS						Weight: 29 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 2=0-3-8, 7=Mechanical  
Max Horz 2=140(LC 8)  
Max Uplift 2=-123(LC 8), 7=-91(LC 8)  
Max Grav 2=537(LC 1), 7=390(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-563/68  
WEBS 4-7=-279/215

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 9-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 123 lb uplift at joint 2 and 91 lb uplift at joint 7.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 3603730	Truss J1	Truss Type Jack-Open	Qty 3	Ply 1	Summit/193 Highland Meadows I58837521
----------------	-------------	-------------------------	----------	----------	--

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:23 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

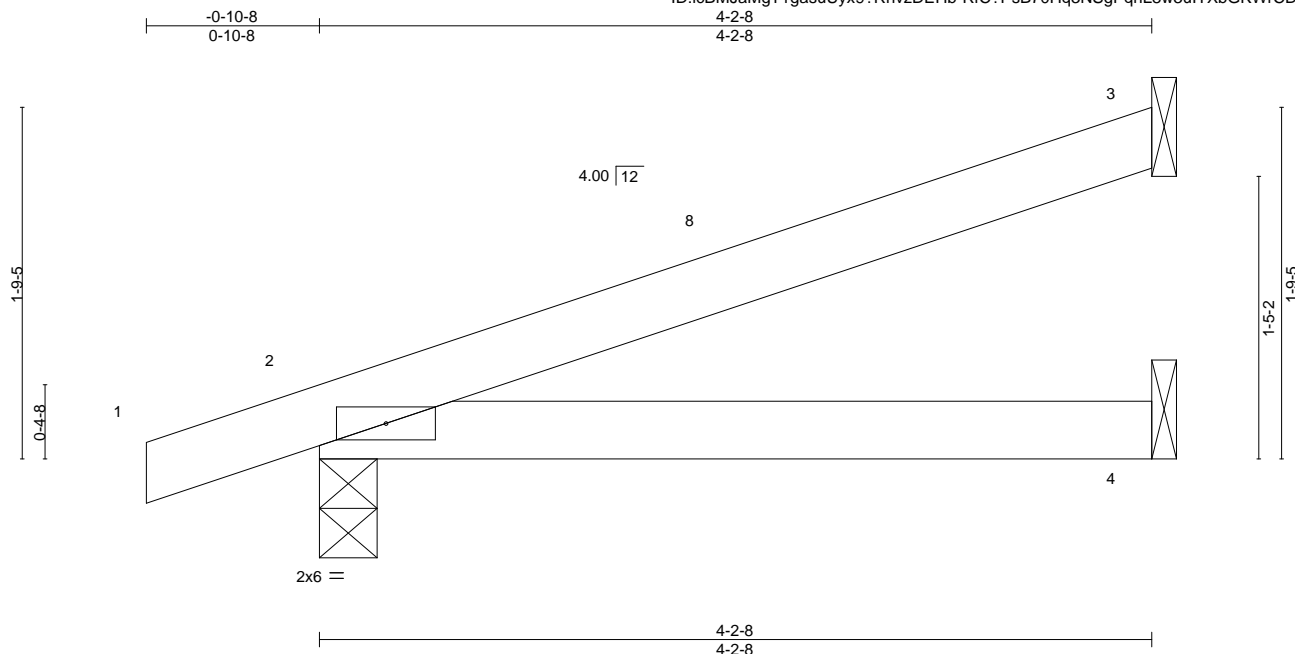

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.21	Vert(LL)	-0.02	4-7	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.17	Vert(CT)	-0.03	4-7	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	2	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 11 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical  
Max Horz 2=65(LC 8)  
Max Uplift 3=45(LC 12), 2=60(LC 8)  
Max Grav 3=124(LC 1), 2=254(LC 1), 4=74(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 4-1-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 45 lb uplift at joint 3 and 60 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job 3603730	Truss J2	Truss Type Jack-Open	Qty 1	Ply 1	Summit/193 Highland Meadows I58837522
Job Reference (optional)					

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:34 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDdi7J4zJC?f

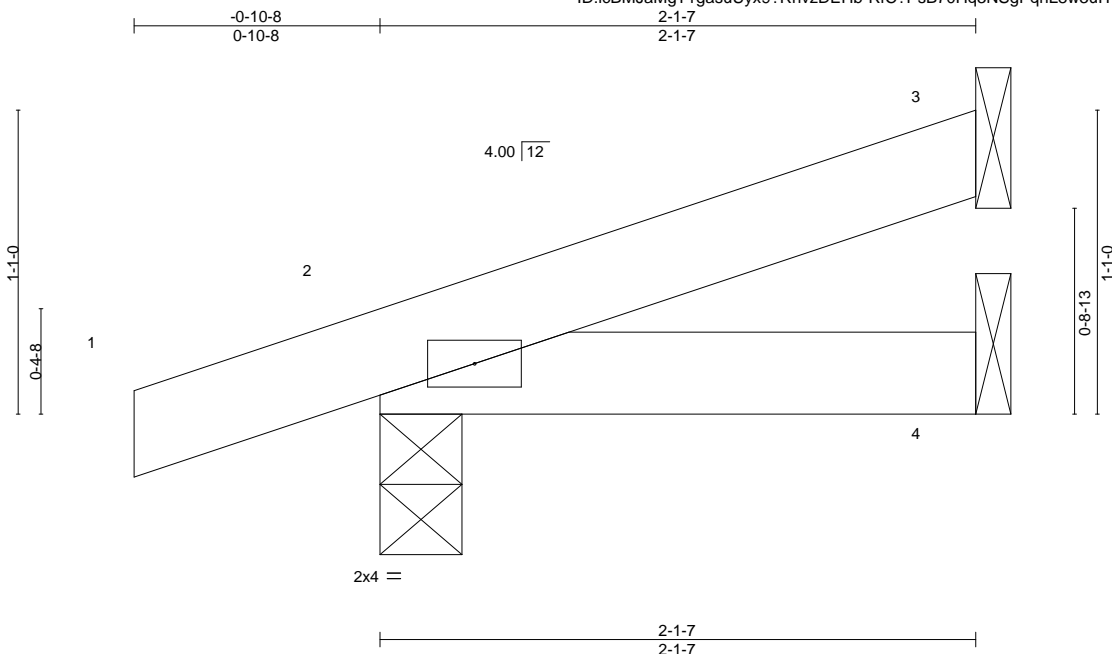

Scale = 1:8.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.05	Vert(LL)	-0.00	7	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	-0.00	7	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	2	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP						Weight: 6 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-1-7 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical  
Max Horz 2=39(LC 8)  
Max Uplift 3=-19(LC 12), 2=-51(LC 8)  
Max Grav 3=53(LC 1), 2=167(LC 1), 4=35(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 19 lb uplift at joint 3 and 51 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 3603730	Truss J3	Truss Type Jack-Open	Qty 1	Ply 1	Summit/193 Highland Meadows I58837523
----------------	-------------	-------------------------	----------	----------	--

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:45 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcD0i7J4zJC?f

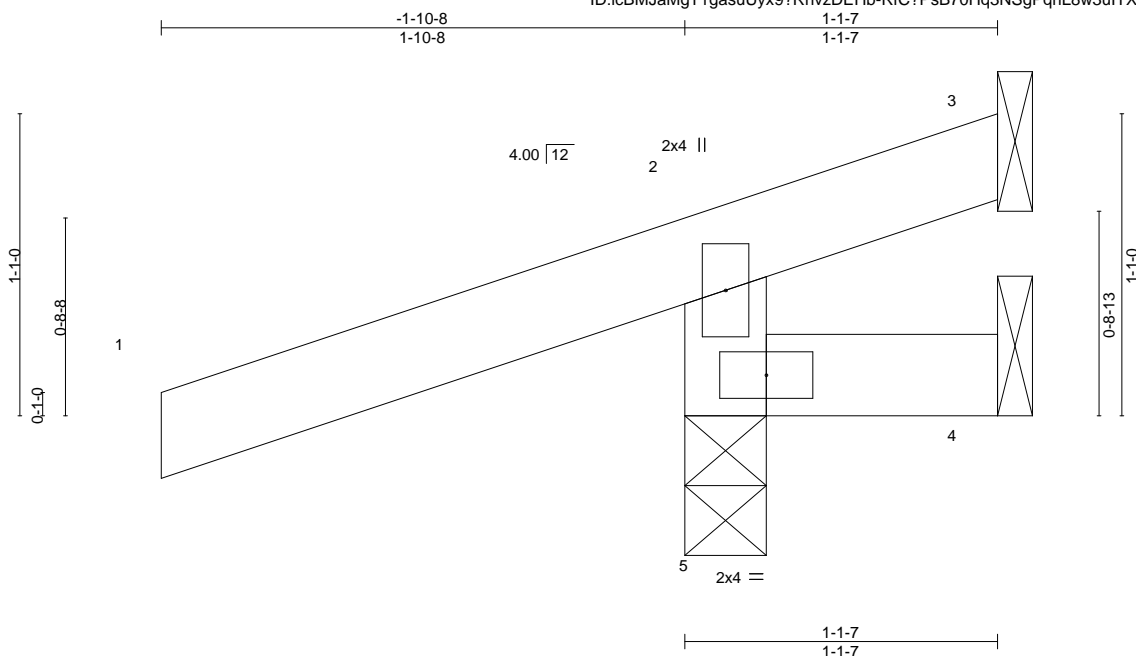

Scale = 1:8.3

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.28	Vert(LL)	0.00	5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.08	Vert(CT)	0.00	5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR						Weight: 5 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-1-7 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 3=Mechanical, 4=Mechanical, 5=0-3-8  
Max Horz 5=38(LC 8)  
Max Uplift 3=71(LC 1), 4=34(LC 1), 5=150(LC 8)  
Max Grav 3=40(LC 8), 4=20(LC 8), 5=333(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-5=-280/212

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 71 lb uplift at joint 3, 34 lb uplift at joint 4 and 150 lb uplift at joint 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 3603730	Truss J4	Truss Type Jack-Closed	Qty 2	Ply 1	Summit/193 Highland Meadows Job Reference (optional)	I58837524
----------------	-------------	---------------------------	----------	----------	---	-----------

Builders First Source, Valley Center, KS 67147

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-gQQdP1ub9F8ABBNlOi63CqG5baWq1jrNy8rdUuz81NR  
8.630 s Nov 21 2022 MITek Industries, Inc. Fri Jun 9 11:17:38 2023 Page 1

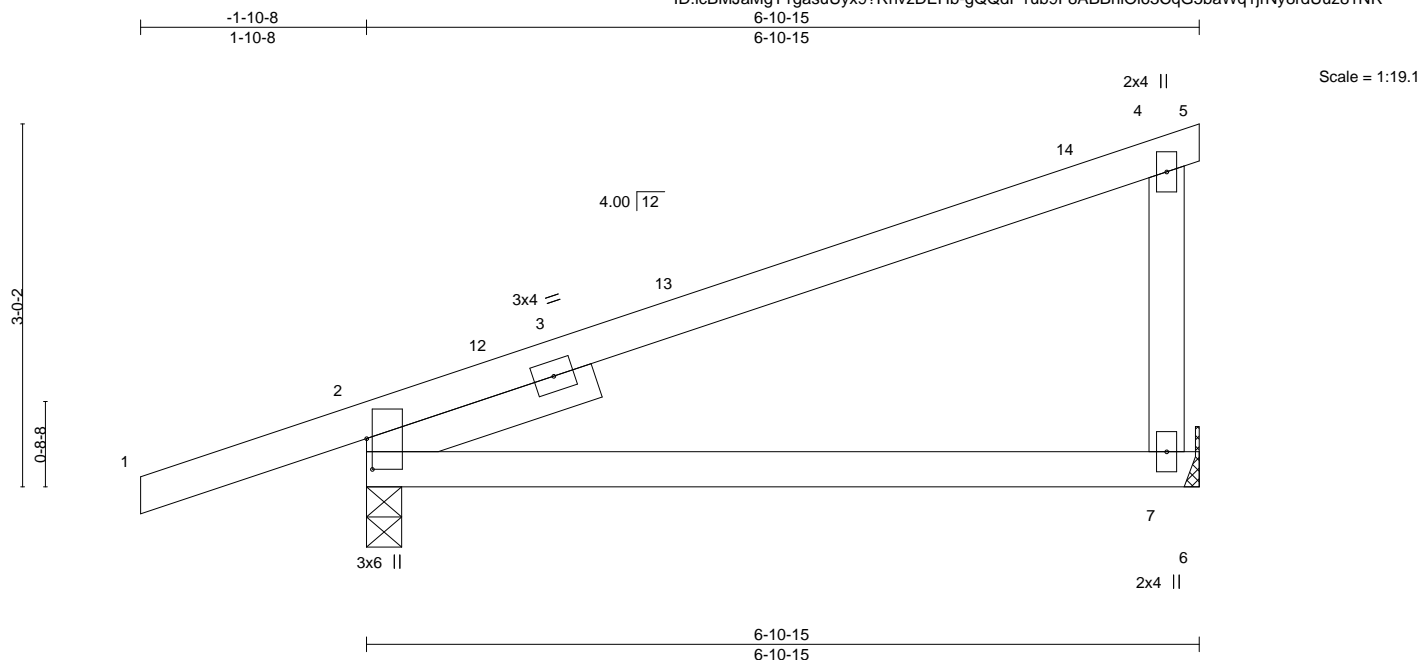


Plate Offsets (X,Y)-- [2:0-3-1,0-0-9]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.58	Vert(LL)	0.09	7-10	>866	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.37	Vert(CT)	-0.17	7-10	>466	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.04	2	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 24 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

**BRACING-**  
TOP CHORD Sheathed, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

**REACTIONS.** (size) 7=Mechanical, 2=0-3-8  
Max Horz 2=113(LC 11)  
Max Uplift 7=-57(LC 8), 2=-123(LC 8)  
Max Grav 7=291(LC 1), 2=448(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=334/78

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 6-10-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 3) Refer to girder(s) for truss to truss connections.
  - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7 except (jt=lb) 2=123.
  - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MITek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**  
**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837525
3603730	J5	Jack-Open	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:47 2023 Page 1  
ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

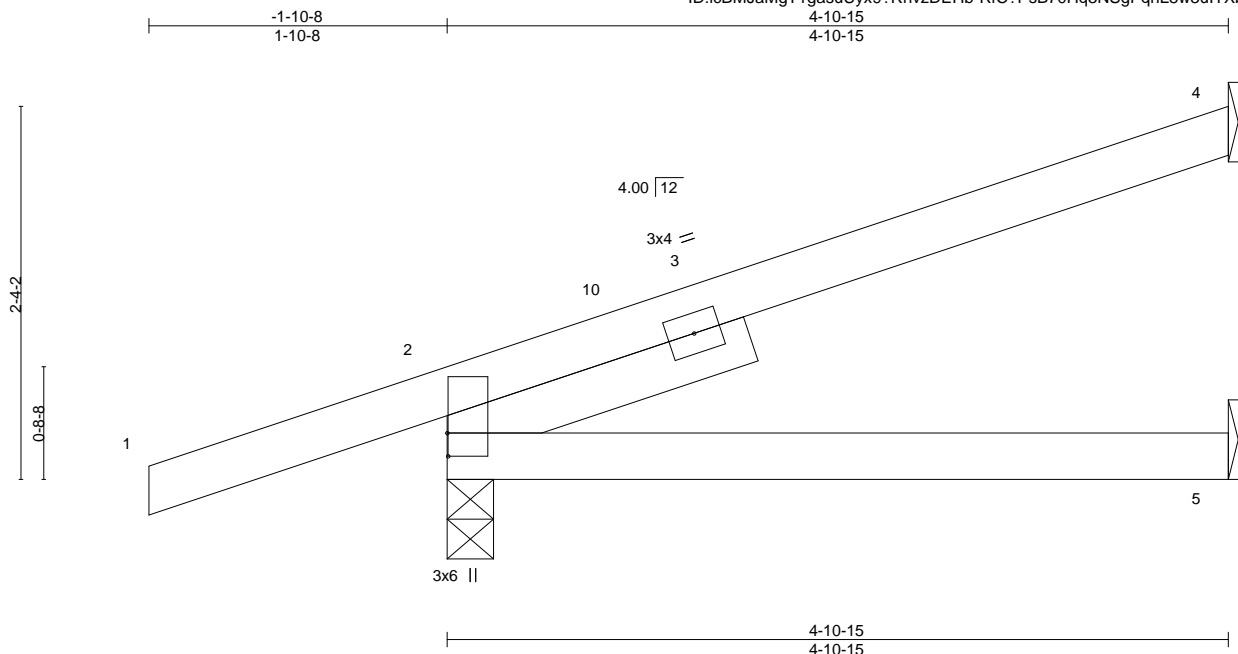

Scale = 1:14.5

Plate Offsets (X,Y)--		[2:0-1-12,0-0-1]										
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	25.0	Plate Grip DOL 1.15		TC	0.26	Vert(LL)	0.03	5-8	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL 1.15		BC	0.19	Vert(CT)	-0.04	5-8	>999	180		
BCLL	0.0	Rep Stress Incr YES		WB	0.00	Horz(CT)	0.01	4	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 16 lb FT = 20%		

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 4=Mechanical, 2=0-3-8, 5=Mechanical  
Max Horz 2=90(LC 8)  
Max Uplift 4=54(LC 12), 2=106(LC 8)  
Max Grav 4=138(LC 1), 2=375(LC 1), 5=83(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 4-10-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 54 lb uplift at joint 4 and 106 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 3603730	Truss J6	Truss Type Jack-Open	Qty 2	Ply 1	Summit/193 Highland Meadows I58837526
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					Job Reference (optional)

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:48 2023 Page 1  
ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

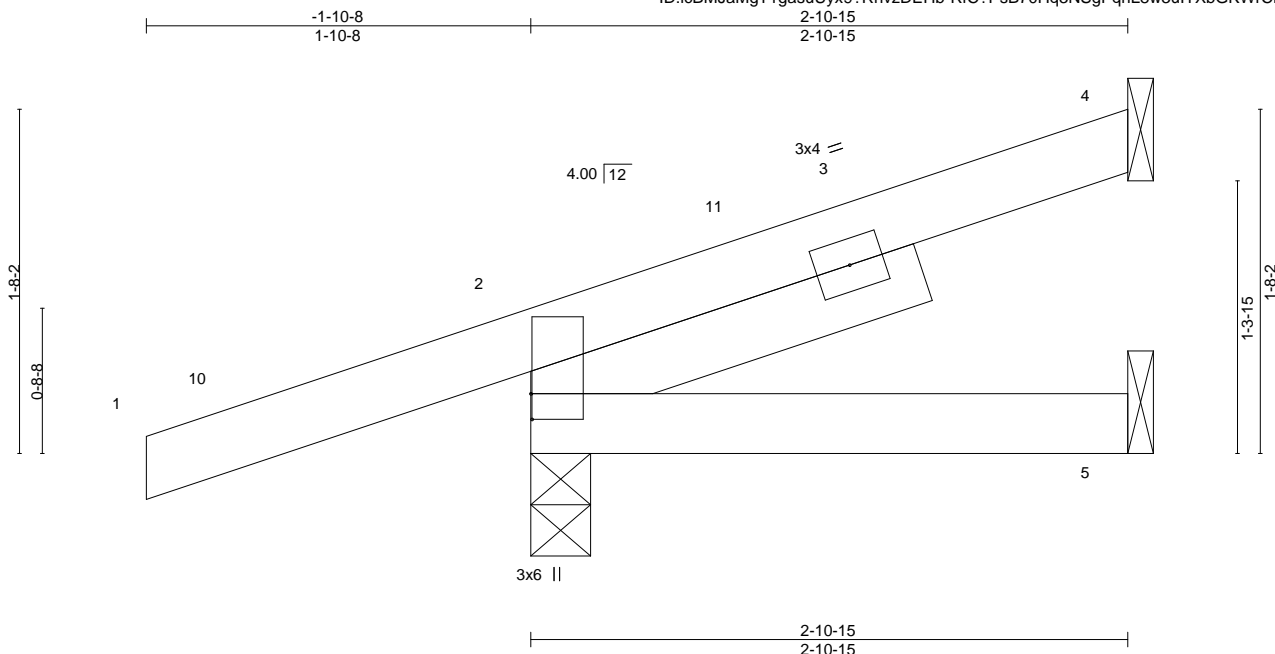


Plate Offsets (X,Y)--	[2:0-1-8,0-0-1]						
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.22	Vert(LL)	-0.00 8	>999	240
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	-0.00 5-8	>999	180
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00 2	n/a	n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP				
				<b>PLATES</b>	<b>GRIP</b>		
				MT20	197/144		
				Weight: 11 lb		FT = 20%	

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-10-15 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 4=Mechanical, 2=0-3-8, 5=Mechanical  
Max Horz 2=65(LC 8)  
Max Uplift 4=28(LC 12), 2=103(LC 8)  
Max Grav 4=62(LC 1), 2=303(LC 1), 5=43(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 2-10-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 28 lb uplift at joint 4 and 103 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see


**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601  
**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 3603730	Truss J7	Truss Type Jack-Open	Qty 1	Ply 1	Summit/193 Highland Meadows I58837527
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:49 2023 Page 1  
ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

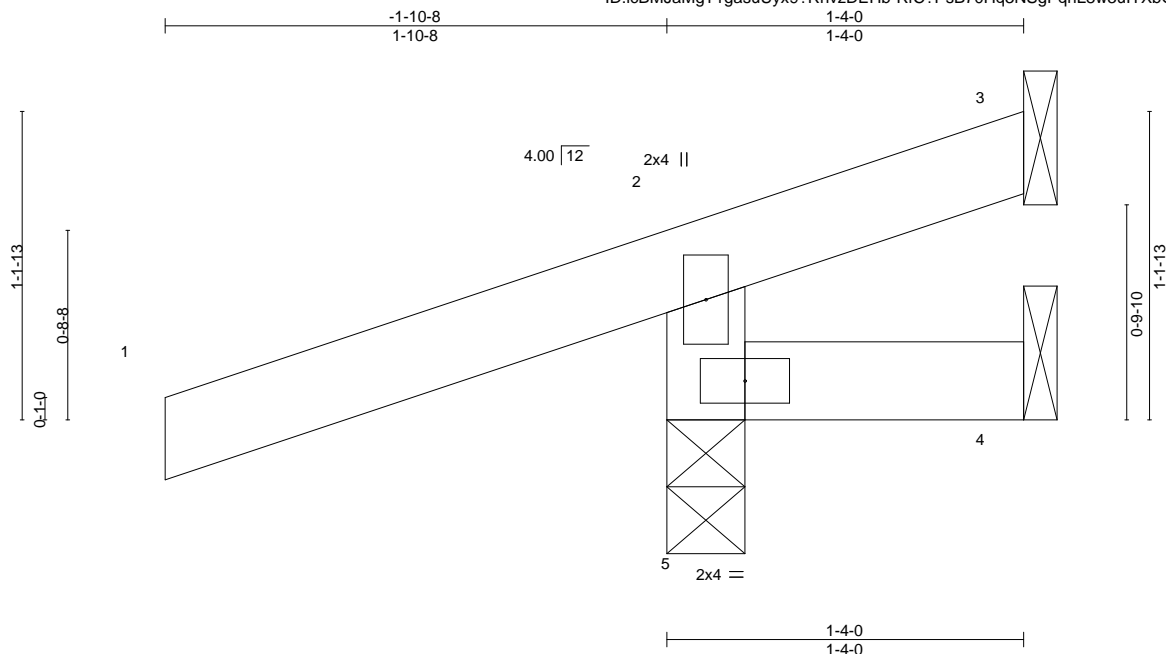

Scale = 1:8.6

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.28	Vert(LL)	0.00	5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.08	Vert(CT)	0.00	5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR						Weight: 6 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-4-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 3=Mechanical, 4=Mechanical, 5=0-3-8  
Max Horz 5=40(LC 8)  
Max Uplift 3=43(LC 1), 4=26(LC 1), 5=138(LC 8)  
Max Grav 3=26(LC 8), 4=19(LC 8), 5=316(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-5=-266/199

#### NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 43 lb uplift at joint 3, 26 lb uplift at joint 4 and 138 lb uplift at joint 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601  
**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job 3603730	Truss J8	Truss Type Jack-Open	Qty 4	Ply 1	Summit/193 Highland Meadows I58837528
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					Job Reference (optional)

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:50 2023 Page 1  
ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

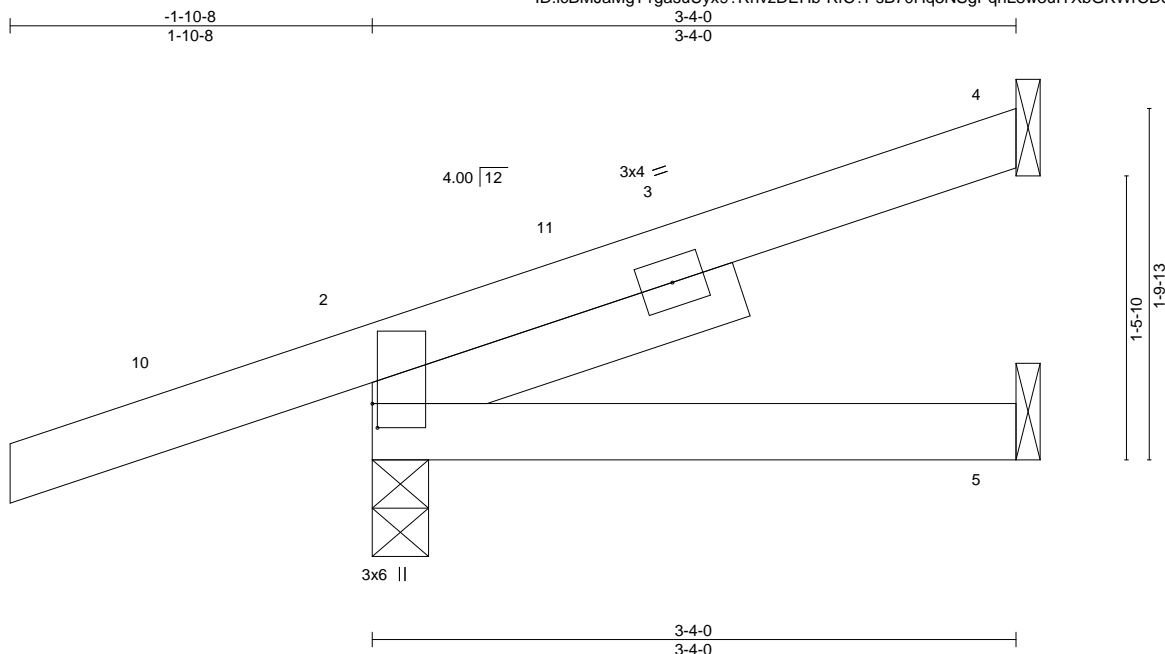


Plate Offsets (X,Y)--		[2:0-1-8,0-0-5]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d			PLATES GRIP		
TCLL	25.0	Plate Grip DOL 1.15		TC	0.22	Vert(LL)	0.01	5-8	>999	240	MT20 197/144
TCDL	10.0	Lumber DOL 1.15		BC	0.07	Vert(CT)	-0.01	5-8	>999	180	
BCLL	0.0	Rep Stress Incr YES		WB	0.00	Horz(CT)	0.00	2	n/a	n/a	
BCDL	10.0	Code IRC2018/TPI2014		Matrix-MP							Weight: 12 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-4-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 4=Mechanical, 2=0-3-8, 5=Mechanical  
Max Horz 2=70(LC 8)  
Max Uplift 4=33(LC 12), 2=103(LC 8)  
Max Grav 4=79(LC 1), 2=316(LC 1), 5=52(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 3-3-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 33 lb uplift at joint 4 and 103 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**


**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837529
3603730	J9	Jack-Open	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center),
Valley Center, KS - 67147,
8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:51 2023 Page 1
ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWCDoi7J4zJC?f

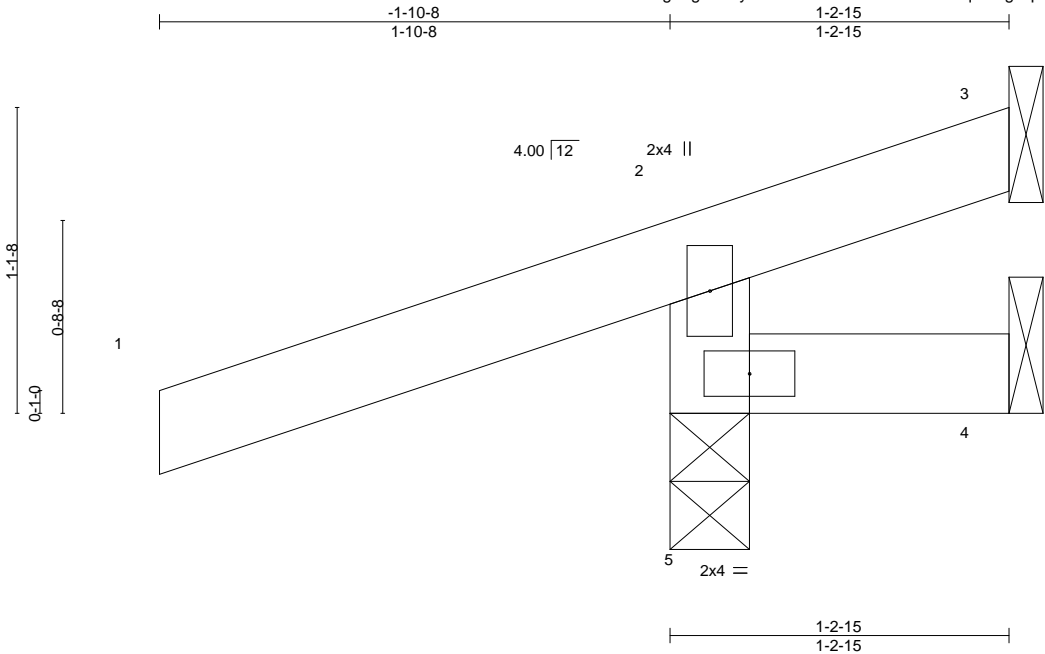

Scale = 1:8.5

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.28	Vert(LL)	0.00	5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.08	Vert(CT)	0.00	5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR						Weight: 6 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-2-15 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 3=Mechanical, 4=Mechanical, 5=0-3-8  
Max Horz 5=39(LC 8)  
Max Uplift 3=-53(LC 1), 4=-29(LC 1), 5=-142(LC 8)  
Max Grav 3=31(LC 8), 4=19(LC 8), 5=322(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-5=-271/204

NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 53 lb uplift at joint 3, 29 lb uplift at joint 4 and 142 lb uplift at joint 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12,2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**  
**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837530
3603730	J10	Jack-Partial	9	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:24 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

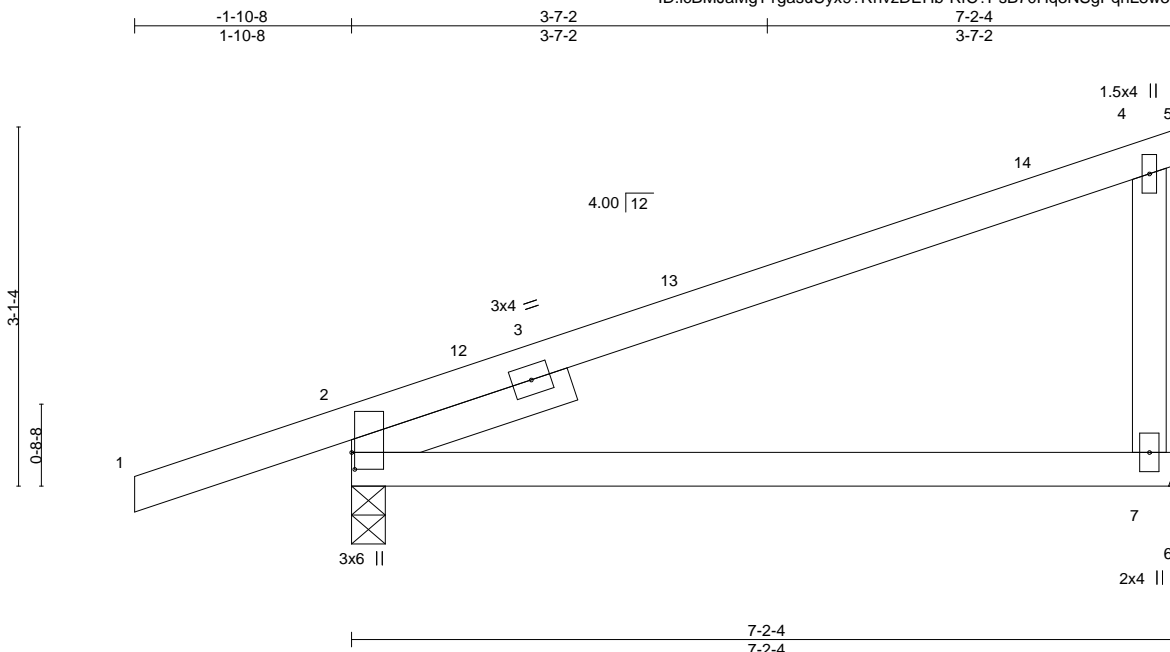

Scale = 1:19.9

Plate Offsets (X, Y)--		[2:0-1-12,0-0-5]	
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>
TCLL 25.0	Plate Grip DOL	1.15	TC 0.60
TCDL 10.0	Lumber DOL	1.15	BC 0.40
BCLL 0.0	Rep Stress Incr	YES	WB 0.04
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-AS
			<b>DEFL.</b>
			in (loc) l/defl L/d
			Vert(LL) 0.10 7-10 >819 240
			Vert(CT) -0.20 7-10 >414 180
			Horz(CT) 0.04 2 n/a n/a
			<b>PLATES</b>
			MT20
			<b>GRIP</b>
			197/144
			Weight: 24 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 SLIDER Left 2x4 SPF No.2 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
 BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.


(size) 2=0-3-8, 7=Mechanical  
 Max Horz 2=118(LC 8)  
 Max Uplift 2=114(LC 8), 7=71(LC 8)  
 Max Grav 2=459(LC 1), 7=304(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-359/52

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 7-2-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 114 lb uplift at joint 2 and 71 lb uplift at joint 7.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

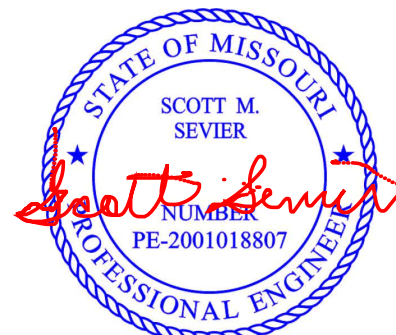

June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837531
3603730	J11	Jack-Open	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:25 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

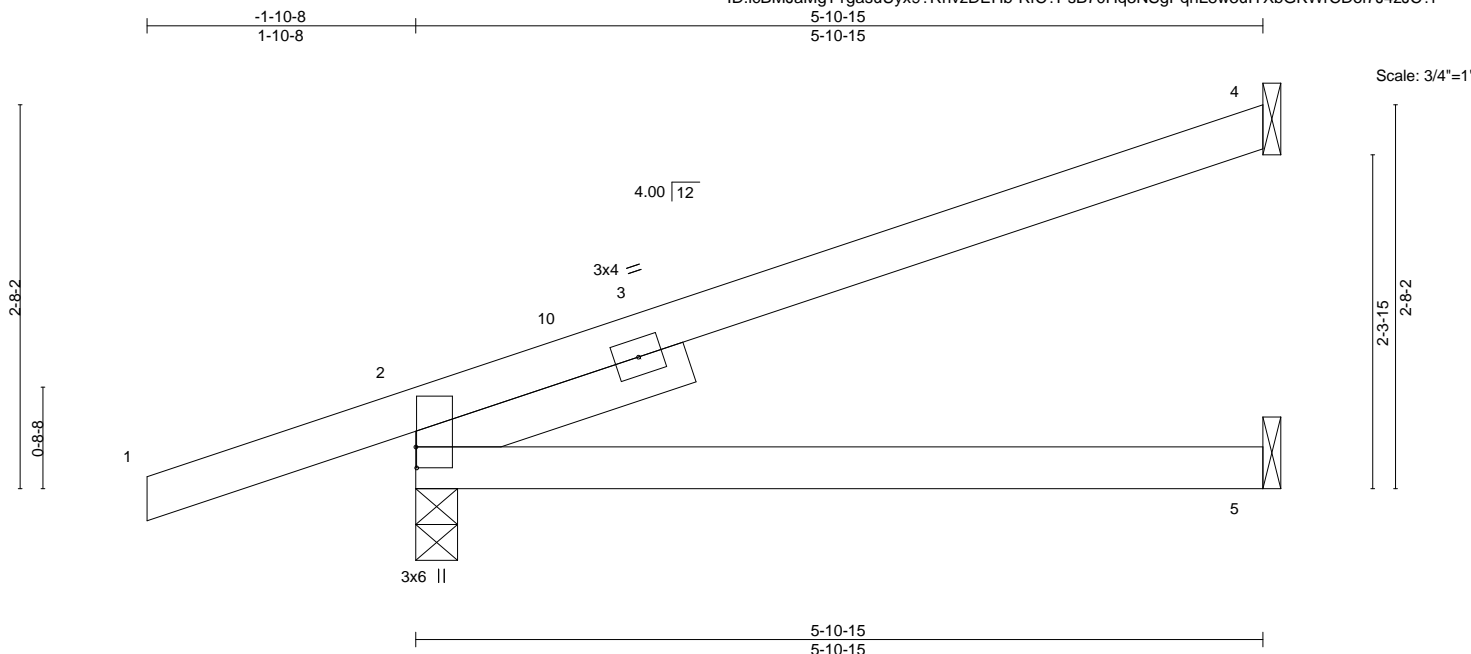


Plate Offsets (X,Y)-- [2:0-1-12,0-0-1]											
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.42	Vert(LL)	0.06	5-8	>999	240	MT20 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.27	Vert(CT)	-0.10	5-8	>701	180	
BCLL	0.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.02	4	n/a	n/a	
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 18 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 4=Mechanical, 2=0-3-8, 5=Mechanical  
Max Horz 2=102(LC 8)  
Max Uplift 4=67(LC 12), 2=110(LC 8)  
Max Grav 4=173(LC 1), 2=415(LC 1), 5=101(LC 3)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-263/43

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 5-10-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 67 lb uplift at joint 4 and 110 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 3603730	Truss J12	Truss Type Jack-Open	Qty 2	Ply 1	Summit/193 Highland Meadows I58837532
Job Reference (optional)					

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:26 2023 Page 1  
ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

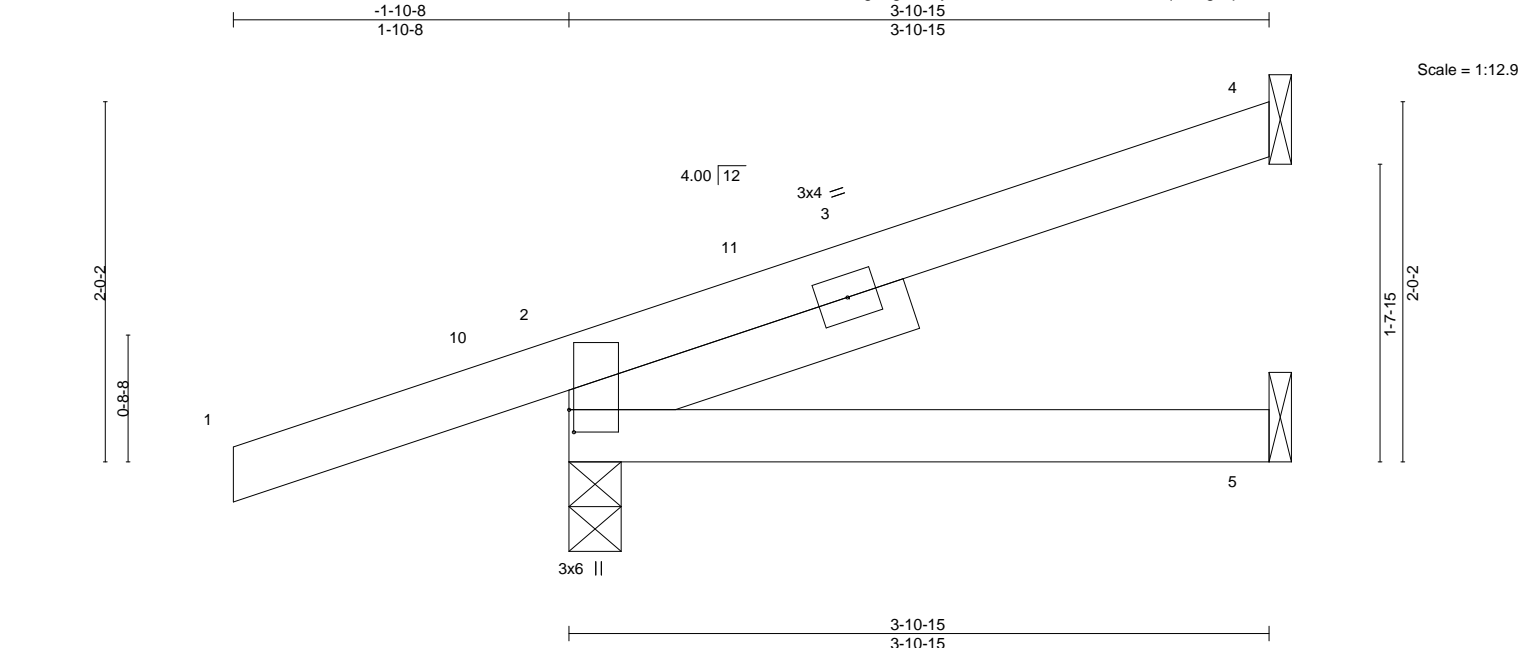


Plate Offsets (X,Y)--		[2'-0"-1'-8,0'-0"-5]	
<b>LOADING</b> (psf)	<b>SPACING-</b>	2'-0'-0	<b>CSI.</b>
TCLL 25.0	Plate Grip DOL	1.15	TC 0.22
TCDL 10.0	Lumber DOL	1.15	BC 0.11
BCLL 0.0	Rep Stress Incr	YES	WB 0.00
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-MP
			<b>DEFL.</b> in (loc) l/defl L/d
			Vert(LL) -0.01 5-8 >999 240
			Vert(CT) -0.02 5-8 >999 180
			Horz(CT) 0.01 2 n/a n/a
			<b>PLATES</b> MT20 <b>GRIP</b> 197/144
			Weight: 14 lb FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 3-10-15 oc purlins.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
SLIDER Left 2x4 SPF No.2 2-0-0	

**REACTIONS.** (size) 4=Mechanical, 2=0-3-8, 5=Mechanical  
Max Horz 2=78(LC 8)  
Max Uplift 4=41(LC 12), 2=103(LC 8)  
Max Grav 4=101(LC 1), 2=336(LC 1), 5=64(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**  
1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1'-10-8 to 1'-1-8, Interior(1) 1'-1-8 to 3'-10-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60  
2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.  
3) Refer to girder(s) for truss to truss connections.  
4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 41 lb uplift at joint 4 and 103 lb uplift at joint 2.  
5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023


Job 3603730	Truss J13	Truss Type Jack-Open	Qty 4	Ply 1	Summit/193 Highland Meadows I58837533
Job Reference (optional)					

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:27 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

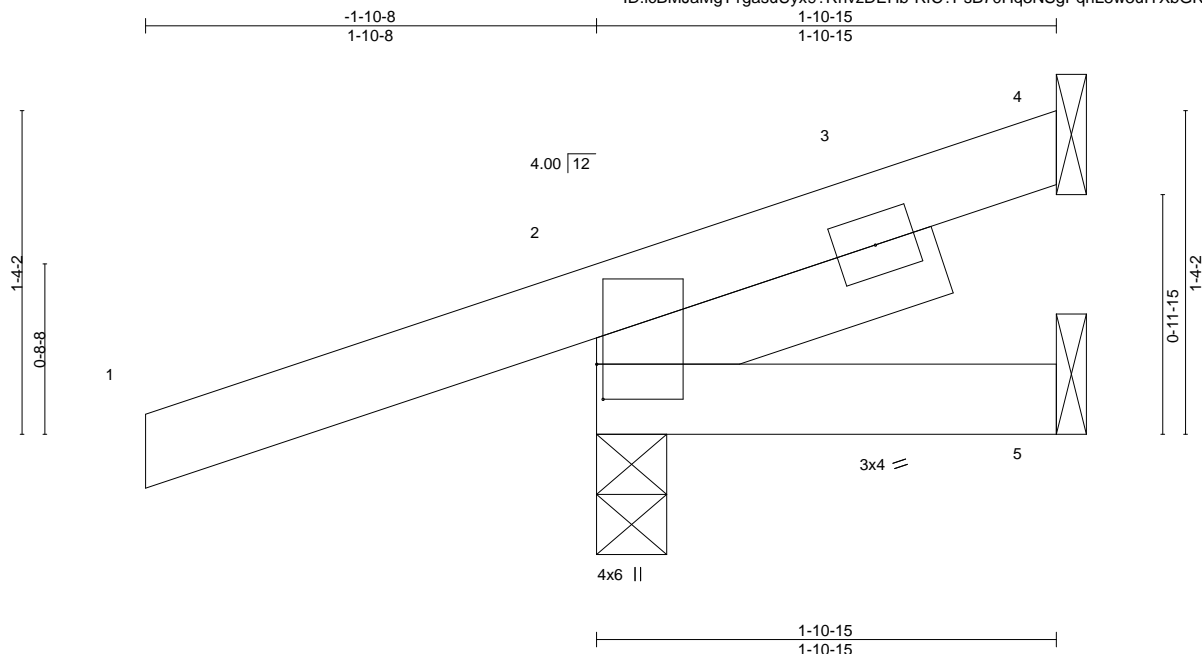

Scale = 1:9.6

Plate Offsets (X,Y)--		[2:0-1-12,0-0-5]								
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in	(loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 25.0	Plate Grip DOL	1.15	TC 0.24	Vert(LL)	0.00	8	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.02	Vert(CT)	0.00	8	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	2	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP						Weight: 9 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 1-6-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-10-15 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 4=Mechanical, 2=0-3-8, 5=Mechanical  
Max Horz 2=54(LC 8)  
Max Uplift 4=13(LC 12), 2=108(LC 8)  
Max Grav 4=18(LC 1), 2=282(LC 1), 5=24(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 1-10-13 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 13 lb uplift at joint 4 and 108 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837534
3603730	J14	Jack-Open	2	1		

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:28 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Job Reference (optional)

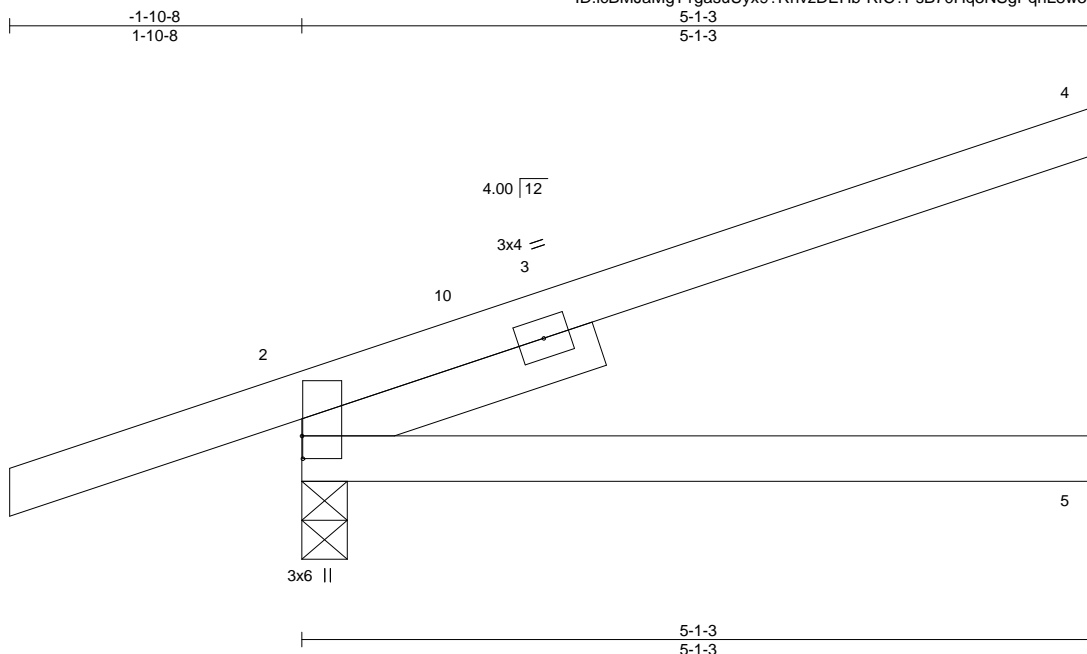


Plate Offsets (X,Y)--		[2:0-1-12,0-0-1]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d			PLATES GRIP		
TCLL	25.0	Plate Grip DOL 1.15		TC	0.29	Vert(LL)	0.04	5-8	>999	240	MT20 197/144
TCDL	10.0	Lumber DOL 1.15		BC	0.20	Vert(CT)	-0.05	5-8	>999	180	
BCLL	0.0	Rep Stress Incr YES		WB	0.00	Horz(CT)	0.01	4	n/a	n/a	
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS							Weight: 17 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 4=Mechanical, 2=0-3-8, 5=Mechanical  
Max Horz 2=92(LC 8)  
Max Uplift 4=57(LC 12), 2=107(LC 8)  
Max Grav 4=144(LC 1), 2=382(LC 1), 5=86(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 5-0-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 57 lb uplift at joint 4 and 107 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 3603730	Truss J15	Truss Type Jack-Open	Qty 2	Ply 1	Summit/193 Highland Meadows I58837535
----------------	--------------	-------------------------	----------	----------	--

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:29 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

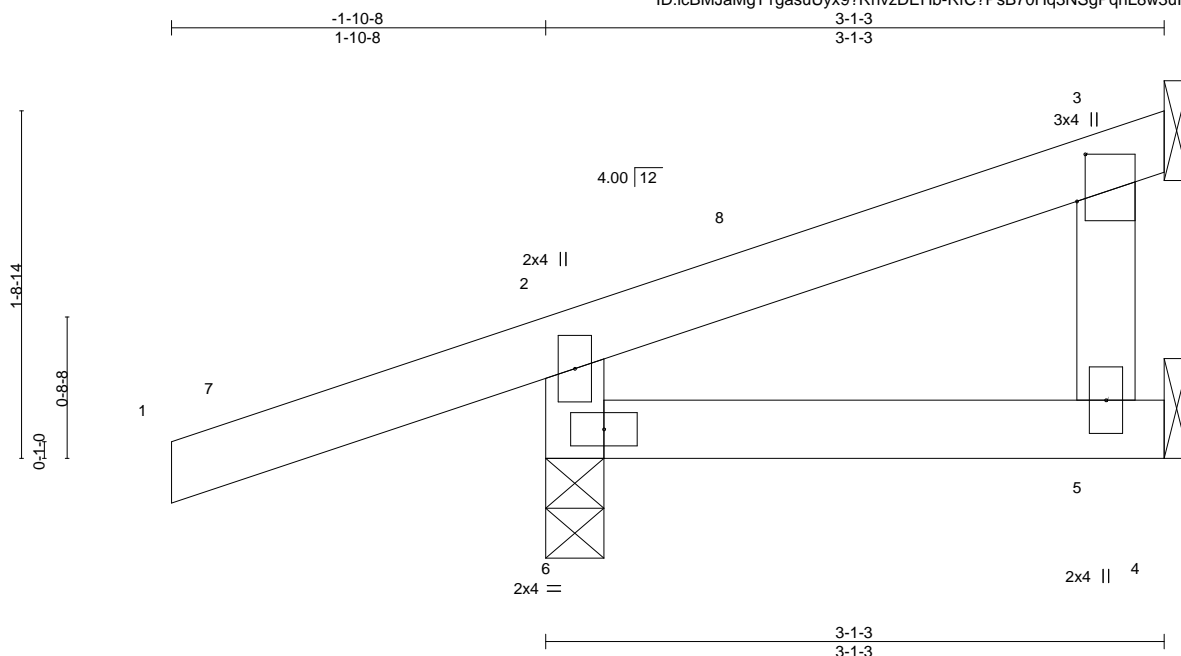

Scale = 1:11.5

Plate Offsets (X,Y)--		[3:0-2-13,0-0-8]									
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d			<b>PLATES GRIP</b>		
TCLL	25.0	Plate Grip DOL	1.15	TC	0.26	Vert(LL)	0.00	5-6	>999	240	MT20 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.07	Vert(CT)	-0.00	5-6	>999	180	
BCLL	0.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.00	3	n/a	n/a	
BCDL	10.0	Code IRC2018/TPI2014		Matrix-MP							Weight: 11 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-1-3 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 5=Mechanical, 3=Mechanical, 6=0-3-8  
Max Horz 6=59(LC 8)  
Max Uplift 3=-27(LC 12), 6=-112(LC 8)  
Max Grav 5=57(LC 3), 3=55(LC 1), 6=315(LC 1)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-6=-273/202

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 2-9-11 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Bearing at joint(s) 6 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 27 lb uplift at joint 3 and 112 lb uplift at joint 6.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837537
3603730	J17	Roof Special Girder	1	1		

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:31 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f



Scale = 1:18.9

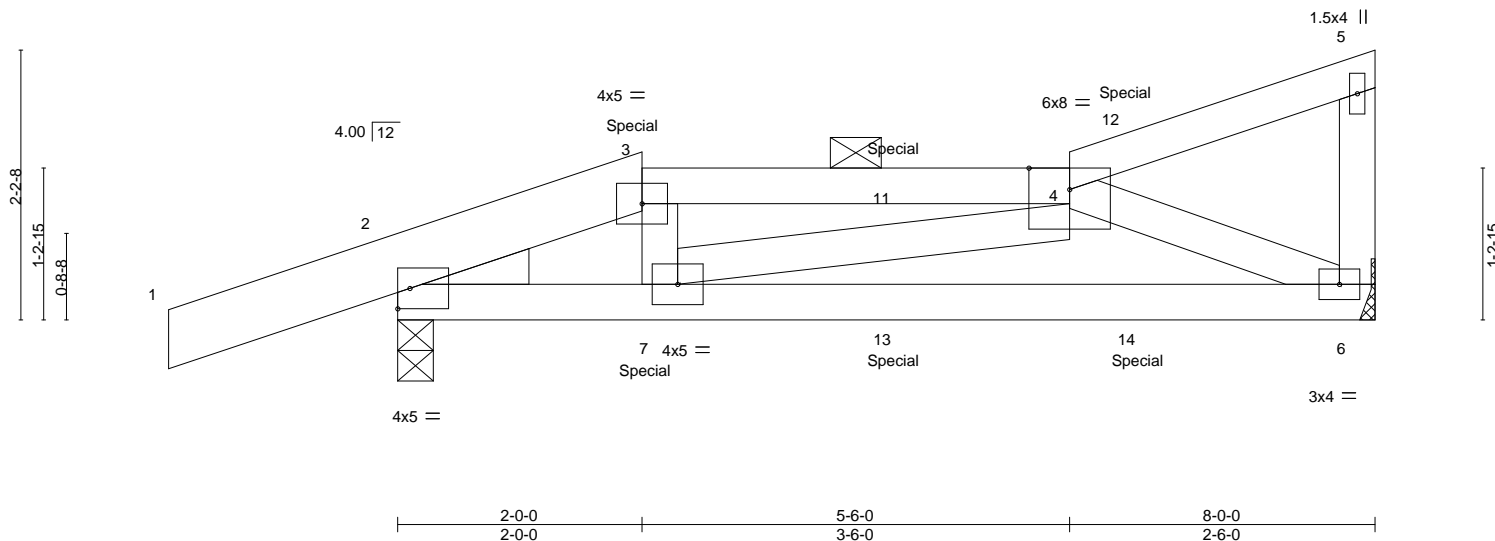

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.31	Vert(LL)	-0.04	6-7	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.39	Vert(CT)	-0.10	6-7	>950	180		
BCLL 0.0	Rep Stress Incr	NO	WB 0.10	Horz(CT)	0.01	6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP						Weight: 34 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2 \*Except\*  
1-3: 2x6 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
WEDGE  
Left: 2x4 SP No.3

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 6=Mechanical, 2=0-3-8  
Max Horz 2=82(LC 7)  
Max Uplift 6=69(LC 8), 2=148(LC 4)  
Max Grav 6=399(LC 1), 2=550(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-719/68, 3-4=-649/64  
BOT CHORD 2-7=-78/629, 6-7=-126/565  
WEBS 4-6=-614/155, 4-7=0/253

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Provide adequate drainage to prevent water ponding.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 69 lb uplift at joint 6 and 148 lb uplift at joint 2.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 28 lb down and 36 lb up at 2-0-0, and 29 lb down and 37 lb up at 4-0-12, and 29 lb down and 38 lb up at 6-0-12 on top chord, and 65 lb down and 14 lb up at 2-0-0, and 25 lb down at 4-0-12, and 25 lb down at 6-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-70, 3-4=-70, 4-5=-70, 6-8=-20



June 12, 2023

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837537
3603730	J17	Roof Special Girder	1	1	Job Reference (optional)	


**LOAD CASE(S)** Standard  
 Concentrated Loads (lb)  
 Vert: 3=-13(B) 7=-15(B) 11=-17(B) 12=-17(B) 13=-25(B) 14=-25(B)

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837538
3603730	J18	Half Hip	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:32 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f



Scale = 1:18.9

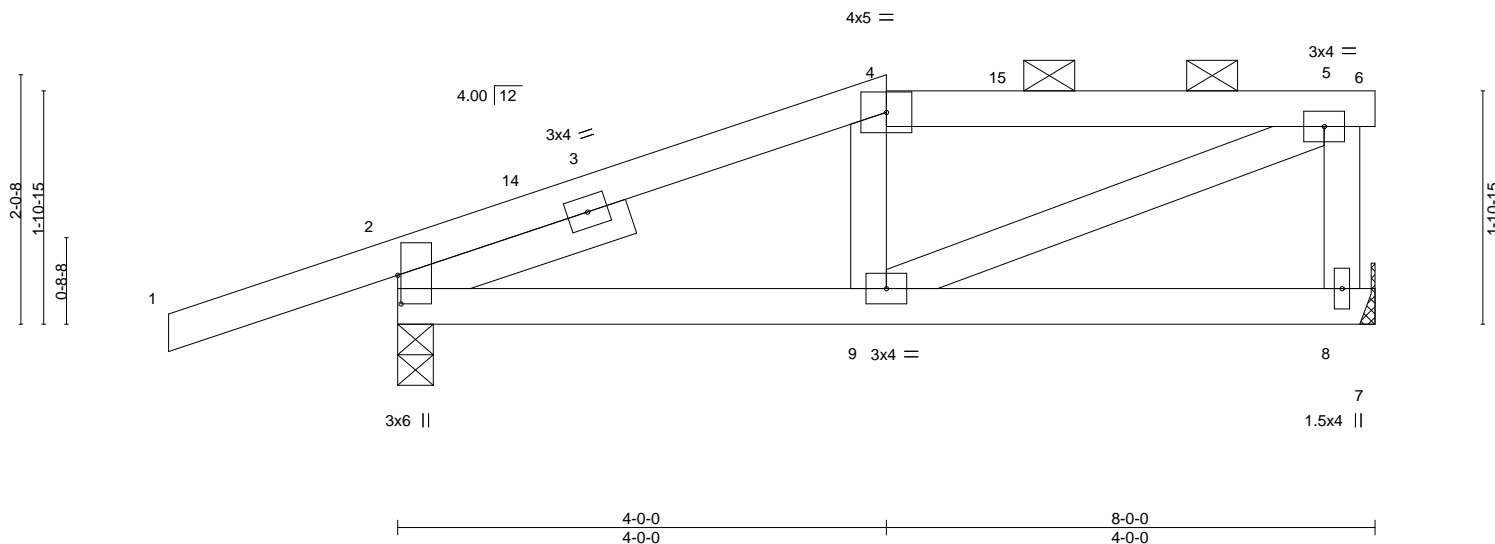


Plate Offsets (X,Y)-- [2:0-2-13,0-0-5]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP
TCLL	25.0	Plate Grip DOL	1.15	TC	0.27	Vert(LL)	-0.01 8-9 >999 240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.13	Vert(CT)	-0.02 8-9 >999 180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.10	Horz(CT)	-0.00 2 n/a n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS				Weight: 31 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except
BOT CHORD 2x4 SPF No.2	2-0-0 oc purlins (6-0-0 max.): 4-6.
WEBS 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
SLIDER Left 2x4 SPF No.2 2-0-0	

**REACTIONS.** (size) 2=0-3-8, 8=Mechanical  
Max Horz 2=75(LC 8)  
Max Uplift 2=134(LC 8), 8=59(LC 8)  
Max Grav 2=495(LC 1), 8=343(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-395/164, 4-5=-387/189  
BOT CHORD 2-9=-179/378  
WEBS 5-8=-303/153, 5-9=-203/418

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 4-0-0, Exterior(2E) 4-0-0 to 8-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 134 lb uplift at joint 2 and 59 lb uplift at joint 8.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837539
3603730	J19	Half Hip	1	1		

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:33 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f



Scale = 1:18.9

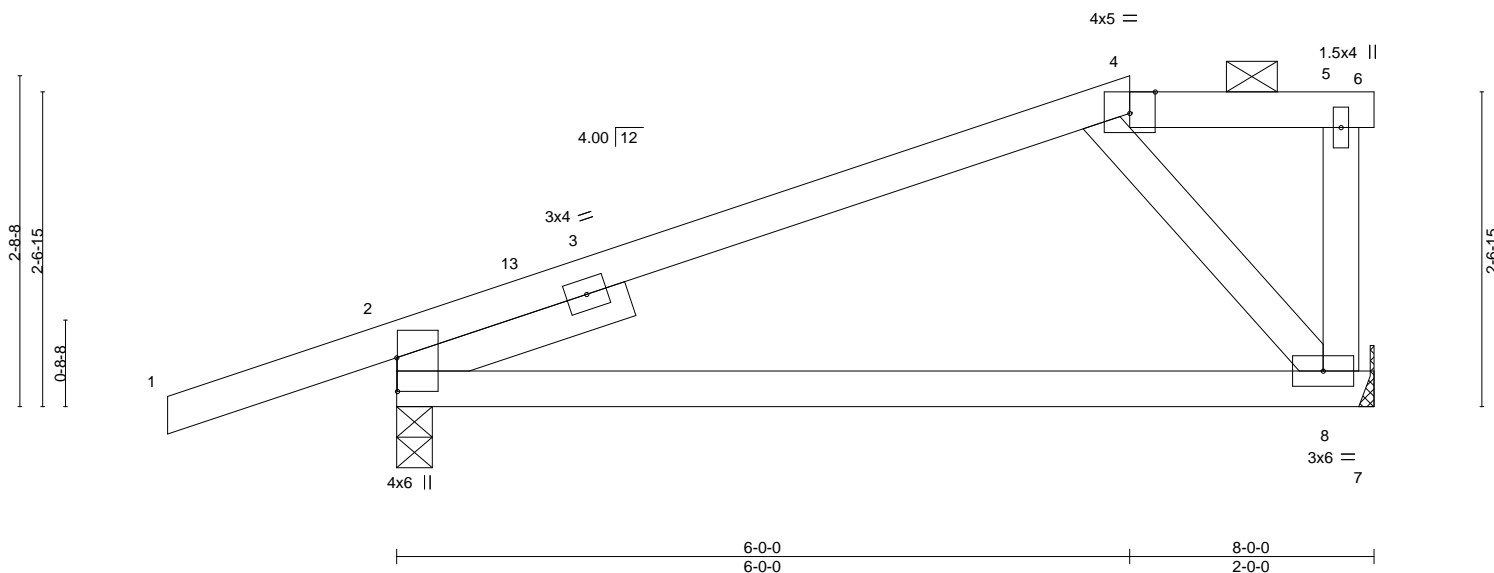


Plate Offsets (X,Y)-- [2:0-3-5,0-0-1], [4:0-2-8,Edge]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	25.0	Plate Grip DOL	1.15	TC	0.48	Vert(LL)	-0.11	8-11	>828	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.45	Vert(CT)	-0.24	8-11	>379	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.05	Horz(CT)	0.03	2	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS							Weight: 29 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-6.  
BOT CHORD Rigid ceiling directly applied.

**REACTIONS.** (size) 2=0-3-8, 8=Mechanical  
Max Horz 2=97(LC 11)  
Max Uplift 2=134(LC 8), 8=59(LC 8)  
Max Grav 2=495(LC 1), 8=343(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-562/82

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 6-0-0, Exterior(2E) 6-0-0 to 8-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 134 lb uplift at joint 2 and 59 lb uplift at joint 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837540
3603730	J20	Jack-Partial	6	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:35 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWCDoi7J4zJC?f



Scale = 1:20.9

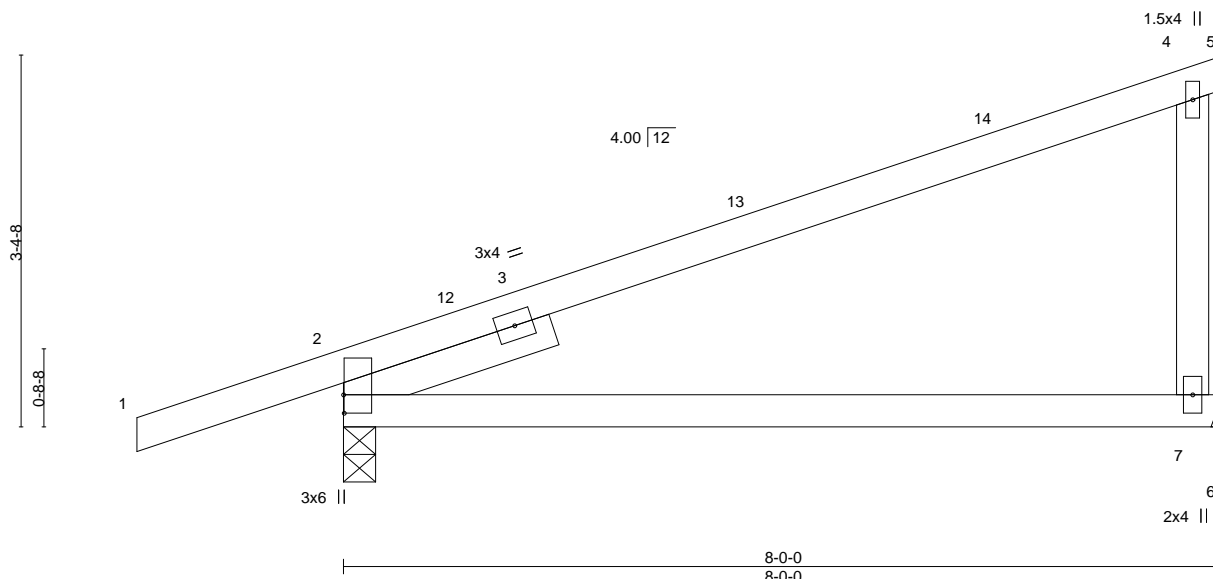


Plate Offsets (X,Y)--		[2:0-2-0,0-0-1]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0		Plate Grip DOL	1.15	TC 0.77		Vert(LL)	0.14 7-10	>644	240	MT20	197/144
TCDL 10.0		Lumber DOL	1.15	BC 0.52		Vert(CT)	-0.32 7-10	>293	180		
BCLL 0.0		Rep Stress Incr	YES	WB 0.05		Horz(CT)	0.06 2	n/a	n/a		
BCDL 10.0		Code IRC2018/TPI2014		Matrix-AS						Weight: 26 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 SLIDER Left 2x4 SPF No.2 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
 BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 2=0-3-8, 7=Mechanical  
 Max Horz 2=128(LC 8)  
 Max Uplift 2=118(LC 8), 7=80(LC 8)  
 Max Grav 2=494(LC 1), 7=343(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-445/59

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 8-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 118 lb uplift at joint 2 and 80 lb uplift at joint 7.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837541
3603730	J21	Jack-Partial	3	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:36 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:21.5


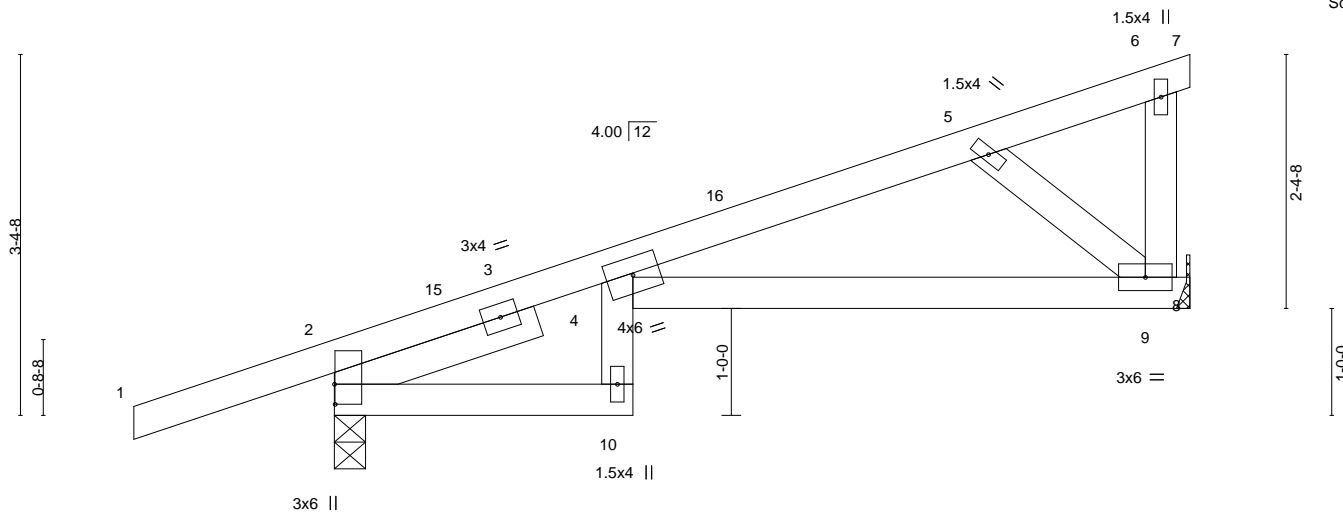


Plate Offsets (X,Y)-- [2:0-2-4,0-0-1]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	25.0	Plate Grip DOL	1.15	TC	1.00	Vert(LL)	-0.21	10	>446	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.32	Vert(CT)	-0.38	10	>242	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.09	Horz(CT)	0.21	9	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS							Weight: 29 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 2=0-3-8, 9=Mechanical  
Max Horz 2=128(LC 8)  
Max Uplift 2=117(LC 8), 9=79(LC 8)  
Max Grav 2=496(LC 1), 9=343(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 4-12=-250/52, 4-5=-458/209  
BOT CHORD 4-9=-310/466  
WEBS 5-9=-594/396

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 8-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 117 lb uplift at joint 2 and 79 lb uplift at joint 9.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837542
3603730	J22	Jack-Open	2	1		

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:37 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

-1-10-8	2-9-8	5-10-15
1-10-8	2-9-8	3-1-7

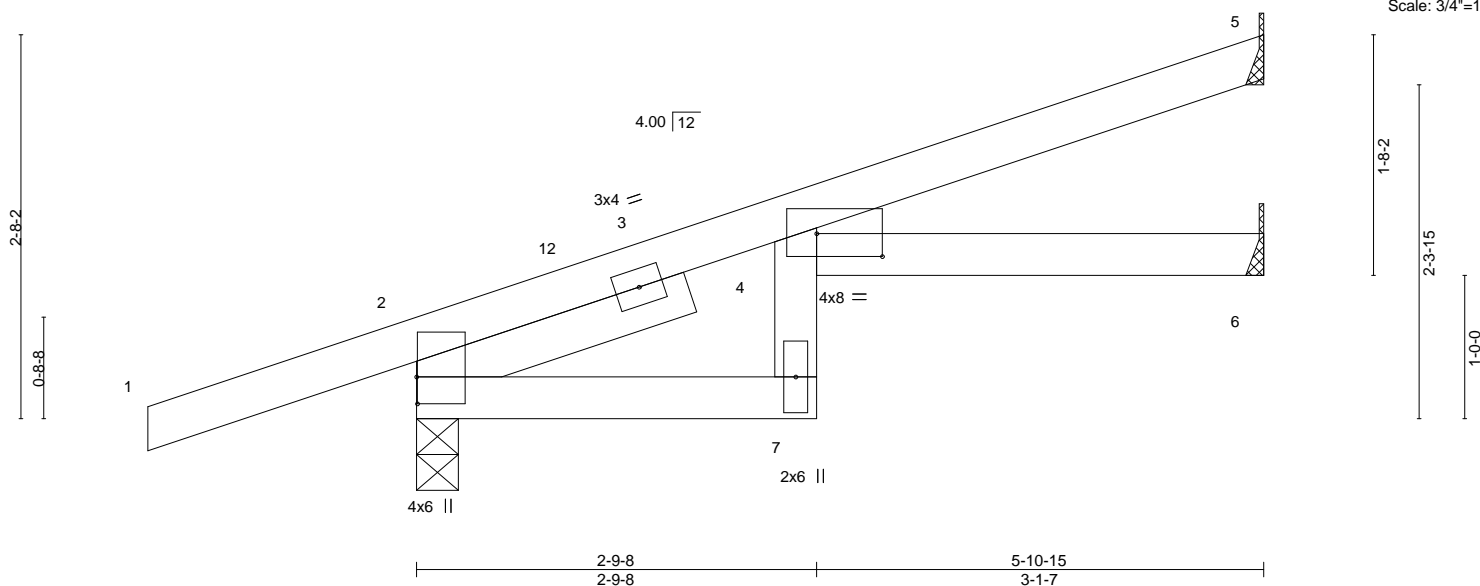


Plate Offsets (X,Y)-- [2:0-2-4,0-0-1], [4:0-5-8,0-1-15]												
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d				<b>PLATES</b>	<b>GRIP</b>	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.57	Vert(LL)	0.11	7	>661	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.39	Vert(CT)	-0.15	7	>465	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.09	6	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS							Weight: 20 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied.

**REACTIONS.** (size) 5=Mechanical, 2=0-3-8, 6=Mechanical  
Max Horz 2=102(LC 8)  
Max Uplift 5=-52(LC 12), 2=-110(LC 8), 6=-6(LC 12)  
Max Grav 5=153(LC 1), 2=416(LC 1), 6=97(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 5-10-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 52 lb uplift at joint 5, 110 lb uplift at joint 2 and 6 lb uplift at joint 6.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 3603730	Truss J23	Truss Type Jack-Open	Qty 2	Ply 1	Summit/193 Highland Meadows I58837543
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:39 2023 Page 1  
ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

-1-10-8 2-9-8 3-10-15  
1-10-8 2-9-8 1-1-7

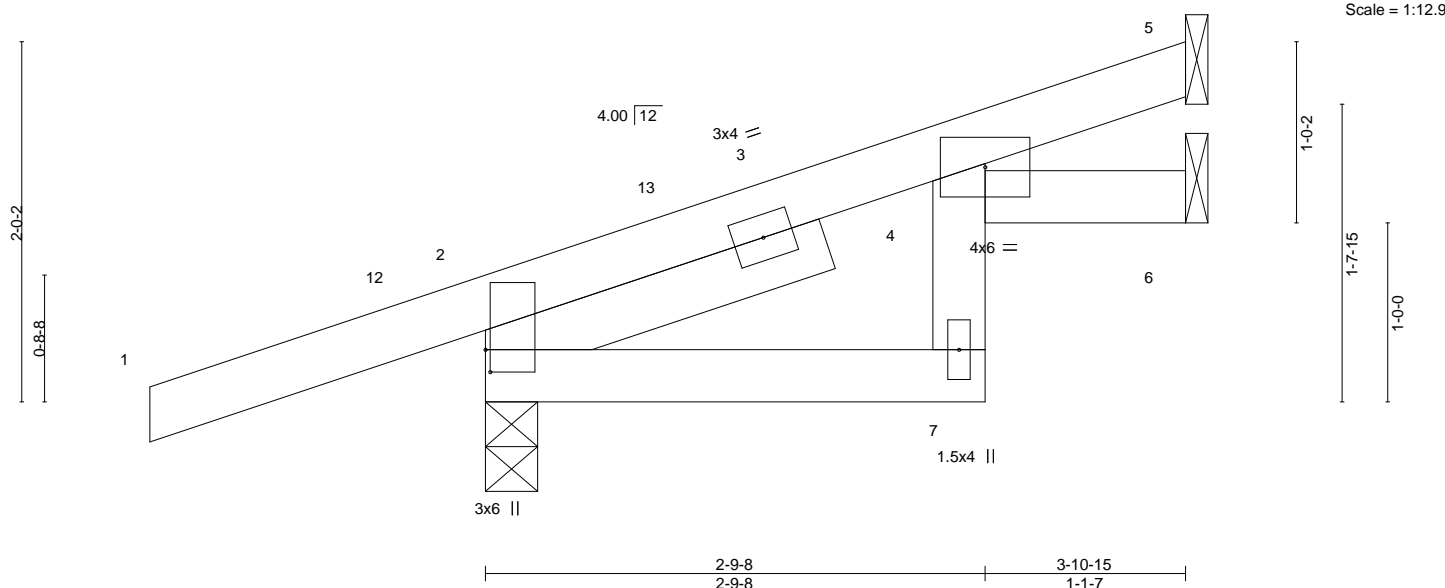


Plate Offsets (X,Y)--		[2:0-1-8,0-0-5]							
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	25.0	Plate Grip DOL 1.15		TC	0.22	Vert(LL)	0.02 7 >999 240	MT20	197/144
TCDL	10.0	Lumber DOL 1.15		BC	0.11	Vert(CT)	-0.02 7 >999 180		
BCLL	0.0	Rep Stress Incr YES		WB	0.00	Horz(CT)	0.02 6 n/a n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-MR				Weight: 15 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-10-15 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

#### REACTIONS.

(size) 5=Mechanical, 2=0-3-8, 6=Mechanical  
Max Horz 2=78(LC 8)  
Max Uplift 5=-26(LC 12), 2=-103(LC 8), 6=-9(LC 12)  
Max Grav 5=82(LC 1), 2=337(LC 1), 6=60(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 3-10-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 26 lb uplift at joint 5, 103 lb uplift at joint 2 and 9 lb uplift at joint 6.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see


**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:40 2023 Page 1  
ID:icBMJaMaT1asuUyx9?RhvzDEHb-RfC?PsB70Hq3NSqPqnL8w3uITxbGKWrCDoi7J4zJC?f




<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD	2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD	2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 3=Mechanical, 2=0-3-8, 4=Mechanical  
 Max Horz 2=50(LC 8)  
 Max Uplift 3=30(LC 12), 2=-54(LC 8)  
 Max Grav 3=83(LC 1), 2=203(LC 1), 4=52(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDD=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 2-11-4 zone; cantilever left and right exposed; and vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 30 lb uplift at joint 3 and 54 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



**WARNING – Velly design parameters are listed below and included with the key reference to AISC M14-15 16f, 17f, 18f, 19f, 20f, 21f, 22f, 23f, 24f, 25f, 26f, 27f, 28f, 29f, 30f, 31f, 32f, 33f, 34f, 35f, 36f, 37f, 38f, 39f, 40f, 41f, 42f, 43f, 44f, 45f, 46f, 47f, 48f, 49f, 50f, 51f, 52f, 53f, 54f, 55f, 56f, 57f, 58f, 59f, 60f, 61f, 62f, 63f, 64f, 65f, 66f, 67f, 68f, 69f, 70f, 71f, 72f, 73f, 74f, 75f, 76f, 77f, 78f, 79f, 80f, 81f, 82f, 83f, 84f, 85f, 86f, 87f, 88f, 89f, 90f, 91f, 92f, 93f, 94f, 95f, 96f, 97f, 98f, 99f, 100f, 101f, 102f, 103f, 104f, 105f, 106f, 107f, 108f, 109f, 110f, 111f, 112f, 113f, 114f, 115f, 116f, 117f, 118f, 119f, 120f, 121f, 122f, 123f, 124f, 125f, 126f, 127f, 128f, 129f, 130f, 131f, 132f, 133f, 134f, 135f, 136f, 137f, 138f, 139f, 140f, 141f, 142f, 143f, 144f, 145f, 146f, 147f, 148f, 149f, 150f, 151f, 152f, 153f, 154f, 155f, 156f, 157f, 158f, 159f, 160f, 161f, 162f, 163f, 164f, 165f, 166f, 167f, 168f, 169f, 170f, 171f, 172f, 173f, 174f, 175f, 176f, 177f, 178f, 179f, 180f, 181f, 182f, 183f, 184f, 185f, 186f, 187f, 188f, 189f, 190f, 191f, 192f, 193f, 194f, 195f, 196f, 197f, 198f, 199f, 200f, 201f, 202f, 203f, 204f, 205f, 206f, 207f, 208f, 209f, 210f, 211f, 212f, 213f, 214f, 215f, 216f, 217f, 218f, 219f, 220f, 221f, 222f, 223f, 224f, 225f, 226f, 227f, 228f, 229f, 230f, 231f, 232f, 233f, 234f, 235f, 236f, 237f, 238f, 239f, 240f, 241f, 242f, 243f, 244f, 245f, 246f, 247f, 248f, 249f, 250f, 251f, 252f, 253f, 254f, 255f, 256f, 257f, 258f, 259f, 260f, 261f, 262f, 263f, 264f, 265f, 266f, 267f, 268f, 269f, 270f, 271f, 272f, 273f, 274f, 275f, 276f, 277f, 278f, 279f, 280f, 281f, 282f, 283f, 284f, 285f, 286f, 287f, 288f, 289f, 290f, 291f, 292f, 293f, 294f, 295f, 296f, 297f, 298f, 299f, 300f, 301f, 302f, 303f, 304f, 305f, 306f, 307f, 308f, 309f, 310f, 311f, 312f, 313f, 314f, 315f, 316f, 317f, 318f, 319f, 320f, 321f, 322f, 323f, 324f, 325f, 326f, 327f, 328f, 329f, 330f, 331f, 332f, 333f, 334f, 335f, 336f, 337f, 338f, 339f, 340f, 341f, 342f, 343f, 344f, 345f, 346f, 347f, 348f, 349f, 350f, 351f, 352f, 353f, 354f, 355f, 356f, 357f, 358f, 359f, 360f, 361f, 362f, 363f, 364f, 365f, 366f, 367f, 368f, 369f, 370f, 371f, 372f, 373f, 374f, 375f, 376f, 377f, 378f, 379f, 380f, 381f, 382f, 383f, 384f, 385f, 386f, 387f, 388f, 389f, 390f, 391f, 392f, 393f, 394f, 395f, 396f, 397f, 398f, 399f, 400f, 401f, 402f, 403f, 404f, 405f, 406f, 407f, 408f, 409f, 410f, 411f, 412f, 413f, 414f, 415f, 416f, 417f, 418f, 419f, 420f, 421f, 422f, 423f, 424f, 425f, 426f, 427f, 428f, 429f, 430f, 431f, 432f, 433f, 434f, 435f, 436f, 437f, 438f, 439f, 440f, 441f, 442f, 443f, 444f, 445f, 446f, 447f, 448f, 449f, 450f, 451f, 452f, 453f, 454f, 455f, 456f, 457f, 458f, 459f, 460f, 461f, 462f, 463f, 464f, 465f, 466f, 467f, 468f, 469f, 470f, 471f, 472f, 473f, 474f, 475f, 476f, 477f, 478f, 479f, 480f, 481f, 482f, 483f, 484f, 485f, 486f, 487f, 488f, 489f, 490f, 491f, 492f, 493f, 494f, 495f, 496f, 497f, 498f, 499f, 500f, 501f, 502f, 503f, 504f, 505f, 506f, 507f, 508f, 509f, 510f, 511f, 512f, 513f, 514f, 515f, 516f, 517f, 518f, 519f, 520f, 521f, 522f, 523f, 524f, 525f, 526f, 527f, 528f, 529f, 530f, 531f, 532f, 533f, 534f, 535f, 536f, 537f, 538f, 539f, 540f, 541f, 542f, 543f, 544f, 545f, 546f, 547f, 548f, 549f, 550f, 551f, 552f, 553f, 554f, 555f, 556f, 557f, 558f, 559f, 560f, 561f, 562f, 563f, 564f, 565f, 566f, 567f, 568f, 569f, 570f, 571f, 572f, 573f, 574f, 575f, 576f, 577f, 578f, 579f, 580f, 581f, 582f, 583f, 584f, 585f, 586f, 587f, 588f, 589f, 590f, 591f, 592f, 593f, 594f, 595f, 596f, 597f, 598f, 599f, 600f, 601f, 602f, 603f, 604f, 605f, 606f, 607f, 608f, 609f, 610f, 611f, 612f, 613f, 614f, 615f, 616f, 617f, 618f, 619f, 620f, 621f, 622f, 623f, 624f, 625f, 626f, 627f, 628f, 629f, 630f, 631f, 632f, 633f, 634f, 635f, 636f, 637f, 638f, 639f, 640f, 641f, 642f, 643f, 644f, 645f, 646f, 647f, 648f, 649f, 650f, 651f, 652f, 653f, 654f, 655f, 656f, 657f, 658f, 659f, 660f, 661f, 662f, 663f, 664f, 665f, 666f, 667f, 668f, 669f, 670f, 671f, 672f, 673f, 674f, 675f, 676f, 677f, 678f, 679f, 680f, 681f, 682f, 683f, 684f, 685f, 686f, 687f, 688f, 689f, 690f, 691f, 692f, 693f, 694f, 695f, 696f, 697f, 698f, 699f, 700f, 701f, 702f, 703f, 704f, 705f, 706f, 707f,**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837545
3603730	J25	Jack-Open	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:40 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

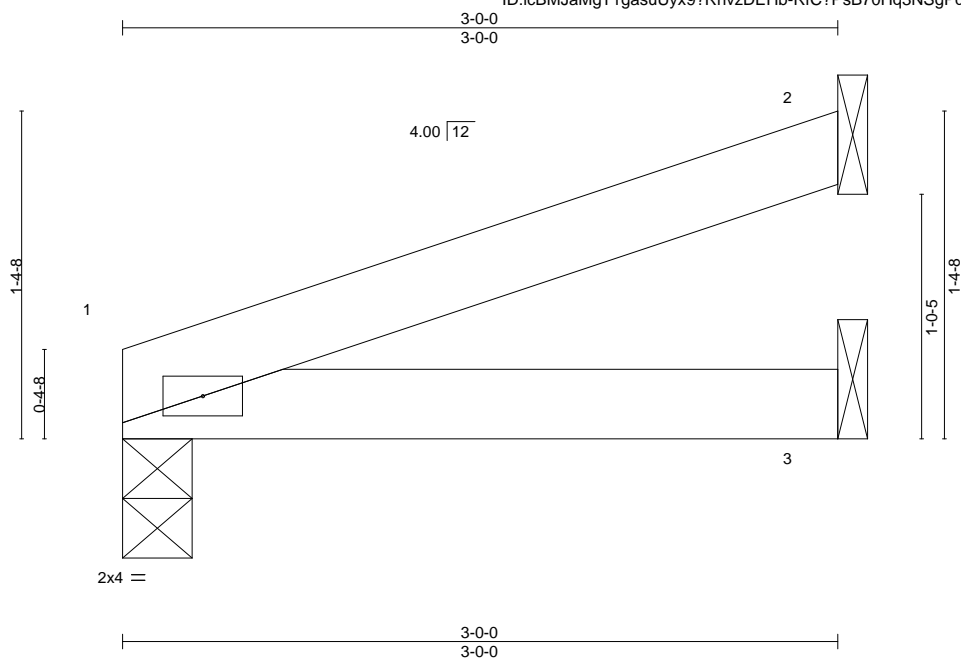

Scale = 1:9.7

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.10	Vert(LL)	0.01	3-6	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.10	Vert(CT)	-0.01	3-6	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	1	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP						Weight: 7 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=0-3-8, 2=Mechanical, 3=Mechanical  
Max Horz 1=36(LC 8)  
Max Uplift 1=-17(LC 8), 2=-31(LC 8)  
Max Grav 1=132(LC 1), 2=87(LC 1), 3=53(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 17 lb uplift at joint 1 and 31 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job 3603730	Truss J27	Truss Type Jack-Open	Qty 4	Ply 1	Summit/193 Highland Meadows I58837547
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					Job Reference (optional)

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:42 2023 Page 1  
ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

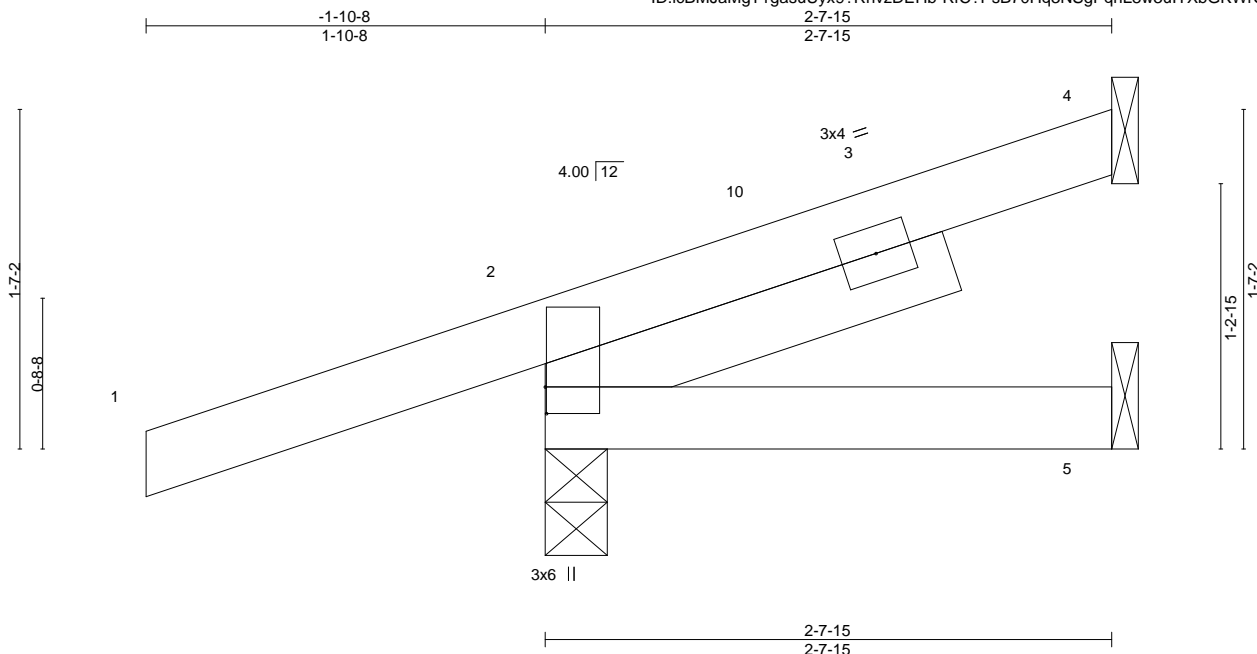


Plate Offsets (X,Y)-- [2:0-1-8,0-0-1]							
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.24	Vert(LL)	-0.00 8	>999	240
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	-0.00 5-8	>999	180
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00 2	n/a	n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP				
						<b>PLATES</b>	<b>GRIP</b>
						MT20	197/144
						Weight: 11 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-7-15 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 4=Mechanical, 2=0-3-8, 5=Mechanical  
Max Horz 2=62(LC 8)  
Max Uplift 4=24(LC 12), 2=104(LC 8)  
Max Grav 4=52(LC 1), 2=296(LC 1), 5=38(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 2-7-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 24 lb uplift at joint 4 and 104 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see


**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:43 2023 Page 1  
ID:icBMJaMaT1gasuUvx9?RhvzDEHb-RfC?PsB70Hg3NSgPanL8w3uITxbGKWrCDoi7J4zJC?f

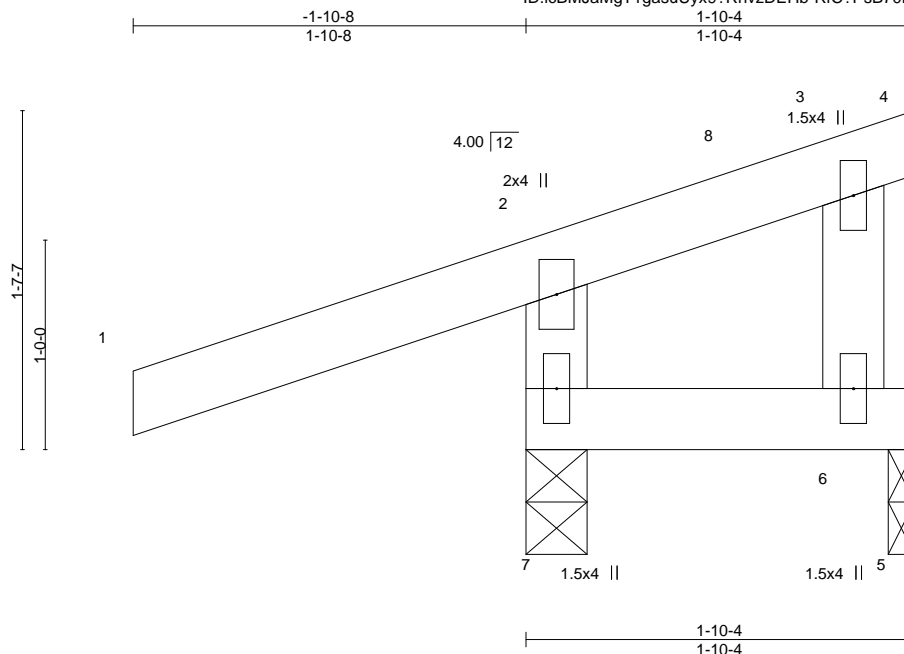

<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 25.0	Plate Grip DOL 1.15	TC 0.28	Vert(LL) 0.00 6 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.05	Vert(CT) 0.00 7 >999 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.01	Horz(CT) 0.00 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-MS		Weight: 8 lb	FT = 20%

**LUMBER-**

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x4 SPF No.2

**BRACING-**

TOP CHORD	Structural wood sheathing directly applied or 1-10-4 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 7=0-3-8, 5=0-1-8  
 Max Horz 7=41(LC 11)  
 Max Uplift 7=-115(LC 8), 5=-21(LC 1)  
 Max Grav 7=301(LC 1), 5=27(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD  $2-7=-273/197$

**NOTES-**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-10-8 to 1-1-8, Interior(1) 1-1-8 to 1-10-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 5.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 115 lb uplift at joint 7 and 21 lb uplift at joint 5.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**


**WARNING – Velly design parameters are RED LINES ON THIS AND INCLUDED WITHIN KEY EXCERPT ADE MH-1419 (Rev. 3/19/2020) BY ONE USE.**  
 Design valid for use only with MITEK® connectors. This design is based only upon parameters shown, and is for the building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 3603730	Truss J29	Truss Type Jack-Open	Qty 4	Ply 1	Summit/193 Highland Meadows I58837549
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					Job Reference (optional)

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:44 2023 Page 1  
ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

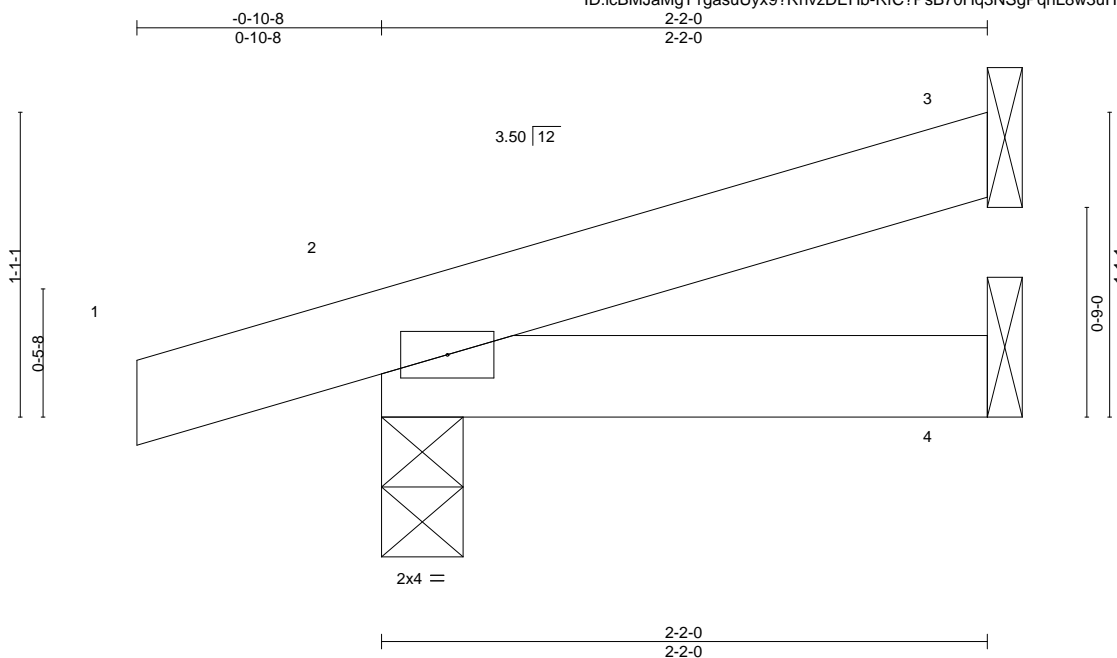

Scale = 1:8.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.05	Vert(LL)	-0.00	7	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	-0.00	7	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP						Weight: 6 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical  
Max Horz 2=35(LC 8)  
Max Uplift 3=-21(LC 12), 2=-51(LC 8)  
Max Grav 3=57(LC 1), 2=169(LC 1), 4=36(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 21 lb uplift at joint 3 and 51 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837550
3603730	L1	Monopitch	6	1	Job Reference (optional)	

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:52 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f



Scale = 1:8.3

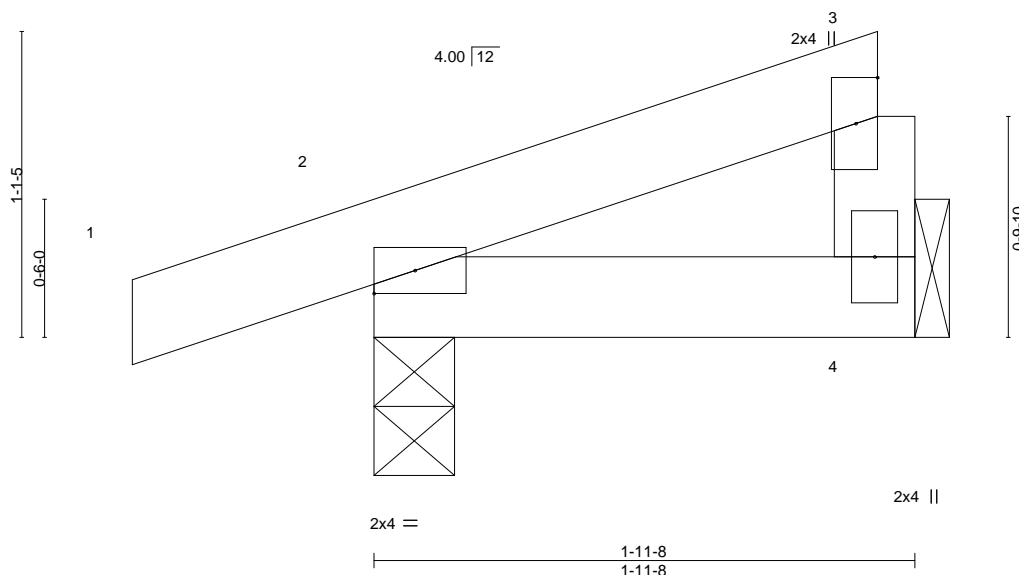

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.05	Vert(LL)	-0.00	7	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.02	Vert(CT)	-0.00	7	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	2	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP						Weight: 6 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2

BOT CHORD 2x4 SPF No.2

WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-11-8 oc purlins, except end verticals.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 4=Mechanical, 2=0-3-8

Max Horz 2=35(LC 11)

Max Uplift 4=14(LC 12), 2=-52(LC 8)

Max Grav 4=67(LC 1), 2=158(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 14 lb uplift at joint 4 and 52 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job 3603730	Truss LG1	Truss Type GABLE	Qty 1	Ply 1	Summit/193 Highland Meadows I58837551
Job Reference (optional)					

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:53 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f



Scale = 1:48.8

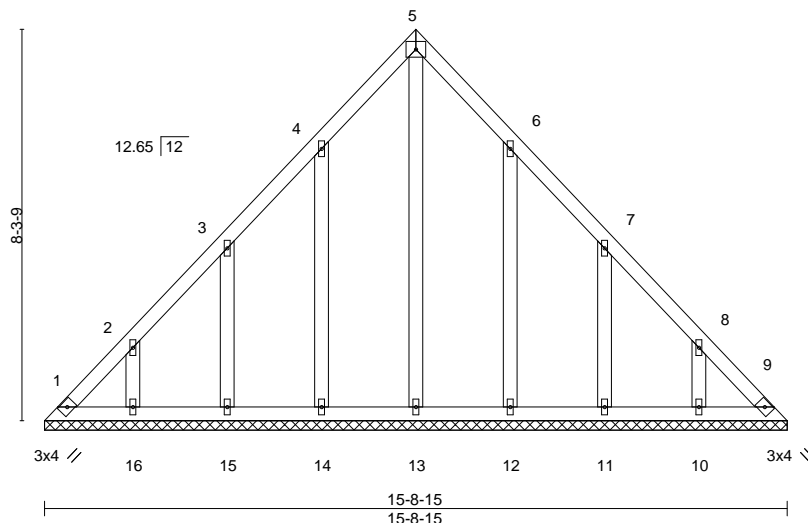

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.16	Horz(CT)	0.00	9	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S					Weight: 76 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 15-8-15.  
(lb) - Max Horz 1=-189(LC 10)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 9 except 14=-116(LC 12), 15=-116(LC 12), 16=-111(LC 12), 12=-115(LC 13), 11=-117(LC 13), 10=-111(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 1, 9, 13, 14, 15, 16, 12, 11, 10

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-251/161

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-1 to 3-4-1, Interior(1) 3-4-1 to 7-10-7, Exterior(2R) 7-10-7 to 10-10-7, Interior(1) 10-10-7 to 15-4-14 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) All plates are 1.5x4 MT20 unless otherwise indicated.
- 4) Gable requires continuous bottom chord bearing.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 9 except (jt=lb) 14=116, 15=116, 16=111, 12=115, 11=117, 10=111.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 3603730	Truss LG2	Truss Type GABLE	Qty 1	Ply 1	Summit/193 Highland Meadows I58837552
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					Job Reference (optional)

8-8-3 8-8-3 17-4-7 8-8-3

4x5 =

Scale = 1:57.6

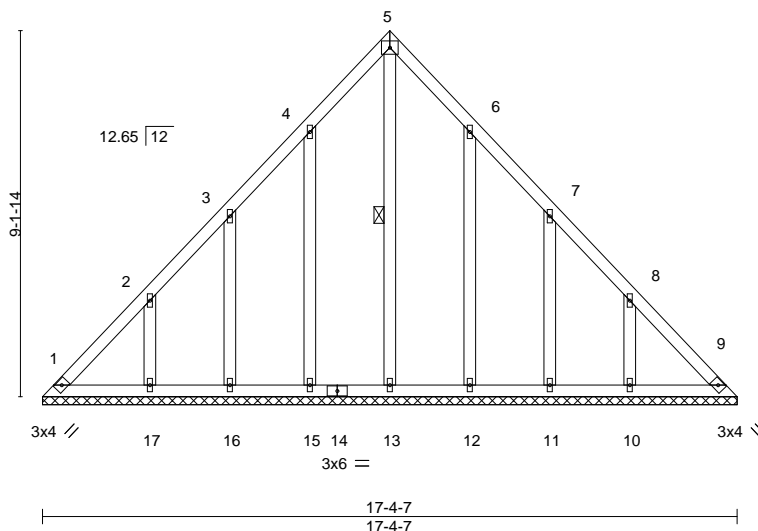

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.08	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.13	Horz(CT)	0.01	9	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S					Weight: 87 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 5-13

#### REACTIONS.

All bearings 17-4-7.  
(lb) - Max Horz 1=-209(LC 8)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 9 except 15=-117(LC 12), 16=-107(LC 12), 17=-143(LC 12), 12=-115(LC 13), 11=-108(LC 13), 10=-143(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 1, 9, 13, 15, 16, 12, 11, 10 except 17=250(LC 19)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-264/176

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-1 to 3-4-1, Interior(1) 3-4-1 to 8-8-3, Exterior(2R) 8-8-3 to 11-8-3, Interior(1) 11-8-3 to 17-0-6 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) All plates are 1.5x4 MT20 unless otherwise indicated.
- 4) Gable requires continuous bottom chord bearing.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 9 except (jt=lb) 15=117, 16=107, 17=143, 12=115, 11=108, 10=143.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837553
3603730	LG3	GABLE	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:55 2023 Page 1  
ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

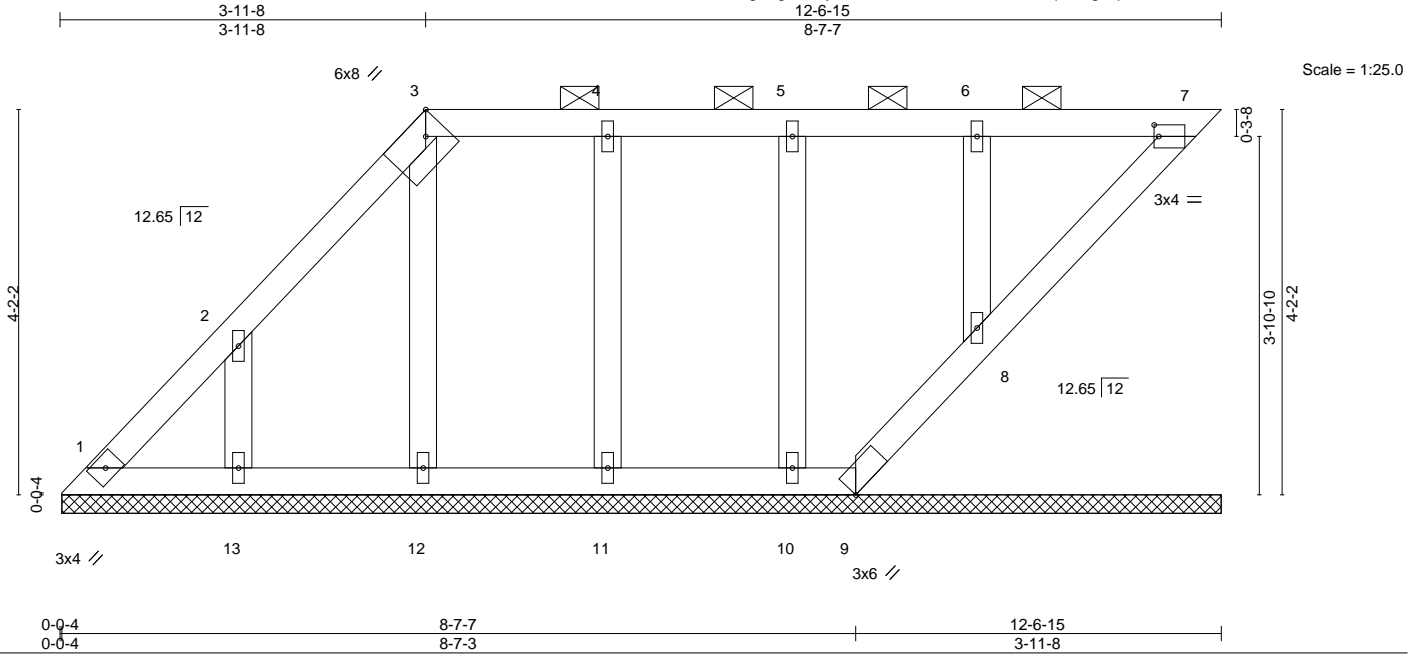


Plate Offsets (X,Y)-- [3:0-2-9,Edge], [7:0-0-10,0-1-8]					
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	<b>PLATES</b>
TCLL 25.0	Plate Grip DOL	1.15	TC 0.07	in (loc) l/defl L/d	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(LL) n/a - n/a 999	GRIP 197/144
BCLL 0.0	Rep Stress Incr	YES	WB 0.04	Vert(CT) n/a - n/a 999	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Horz(CT) -0.00 7 n/a n/a	Weight: 48 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 3-7.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 12-6-11.  
(lb) - Max Horz 1=143(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 7, 9, 12, 11, 10, 8 except 13=-126(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 1, 7, 9, 13, 12, 11, 10, 8

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-1 to 3-4-1, Interior(1) 3-4-1 to 3-11-8, Exterior(2R) 3-11-8 to 6-11-8, Interior(1) 6-11-8 to 12-3-10 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 7, 9, 12, 11, 10, 8 except (jt=lb) 13=126.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 7, 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601  
**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837554
3603730	P1	Roof Special	1	1	Job Reference (optional)	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:57 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:22.6

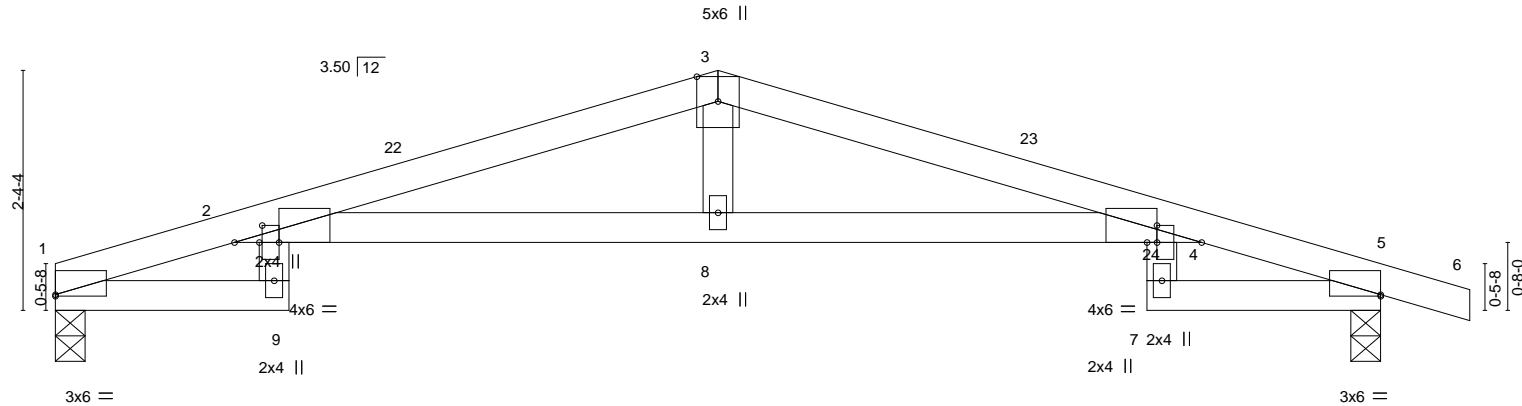

2-3-8	6-6-0	10-8-8	13-0-0
2-3-8	4-2-8	4-2-8	2-3-8

Plate Offsets (X,Y)--		[1:0-0-0,0-0-3], [2:0-5-4,Edge], [2:0-2-0,0-0-5], [4:0-5-4,Edge], [4:0-2-0,0-1-3], [5:Edge,0-0-3]	
<b>LOADING</b> (psf)	<b>SPACING-</b>	<b>CSI.</b>	<b>DEFL.</b>
TCLL 25.0	2-0-0	TC 0.85	in (loc) l/defl L/d
TCDL 10.0	Plate Grip DOL 1.15	BC 0.95	Vert(LL) -0.30 9 >515 240
BCLL 0.0	Lumber DOL 1.15	WB 0.10	Vert(CT) -0.57 9 >273 180
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.27 5 n/a n/a
	Code IRC2018/TPI2014		
			<b>PLATES</b> MT20
			<b>GRIP</b> 197/144
			Weight: 40 lb FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP 2400F 2.0E	TOP CHORD Structural wood sheathing directly applied.
BOT CHORD 2x4 SPF No.2 *Except*	BOT CHORD Rigid ceiling directly applied.
2-4: 2x4 SPF 1650F 1.5E	
WEBS 2x4 SPF No.2	

<b>REACTIONS.</b>	(size) 1=0-3-8, 5=0-3-8
	Max Horz 1=-38(LC 17)
	Max Uplift 1=-79(LC 8), 5=-112(LC 9)
	Max Grav 1=594(LC 1), 5=659(LC 1)

<b>FORCES.</b>	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-1784/508, 3-4=-1784/501
BOT CHORD	2-8=-414/1724, 4-8=-414/1724
WEBS	3-8=-55/397

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 2-9-1, Interior(1) 2-9-1 to 6-6-0, Exterior(2R) 6-6-0 to 9-6-0, Interior(1) 9-6-0 to 13-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 5=112.
  - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



June 12,2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**MiTek**  
16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows
3603730	P2	ROOF SPECIAL	2	1	I58837555


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:13:58 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

-0-10-8	2-3-8	5-0-15	6-6-0	7-11-1	10-8-8	13-0-0	13-10-8
0-10-8	2-3-8	2-9-7	1-5-1	1-5-1	2-9-7	2-3-8	0-10-8

Scale: 1/2"=1'

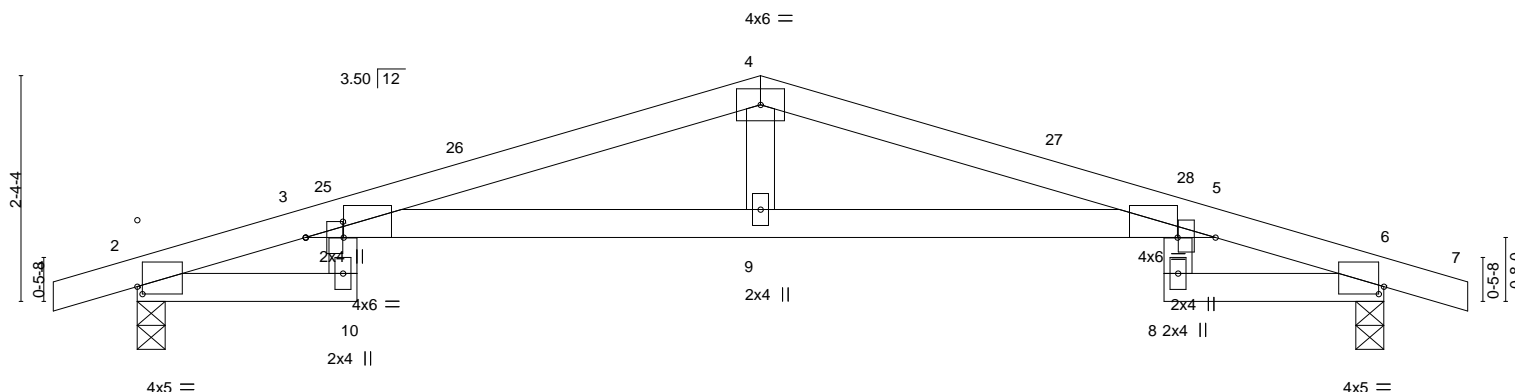

	2-3-8	6-6-0	10-8-8	13-0-0
	2-3-8	4-2-8	4-2-8	2-3-8

Plate Offsets (X,Y)-- [2:0-0-10,0-0-15], [3:0-4-12,Edge], [3:0-2-0,0-4-10], [3:0-2-3,1-9-1], [5:0-4-12,Edge], [6:0-0-10,0-0-15]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.84	Vert(LL)	-0.28	10	>549	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.74	Vert(CT)	-0.54	10	>288	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.12	Horz(CT)	0.25	6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS						Weight: 45 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP 2400F 2.0E  
BOT CHORD 2x4 SPF No.2 \*Except\*  
3-5: 2x4 SP 2400F 2.0E  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-6-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 2=0-3-8, 6=0-3-8  
Max Horz 2=34(LC 12)  
Max Uplift 2=-112(LC 8), 6=-112(LC 9)  
Max Grav 2=657(LC 1), 6=657(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-4=-1762/488, 4-5=-1762/492  
BOT CHORD 3-9=-402/1691, 5-9=-402/1691  
WEBS 4-9=-74/473

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 6-6-0, Exterior(2R) 6-6-0 to 9-6-0, Interior(1) 9-6-0 to 13-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=112, 6=112.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837556
3603730	P3	ROOF SPECIAL GIRDER	1	2	Job Reference (optional)	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:14:00 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

-0-10-8	2-3-8	6-6-0	10-8-8	13-0-0	13-10-8
0-10-8	2-3-8	4-2-8	4-2-8	2-3-8	0-10-8

Scale = 1:21.2

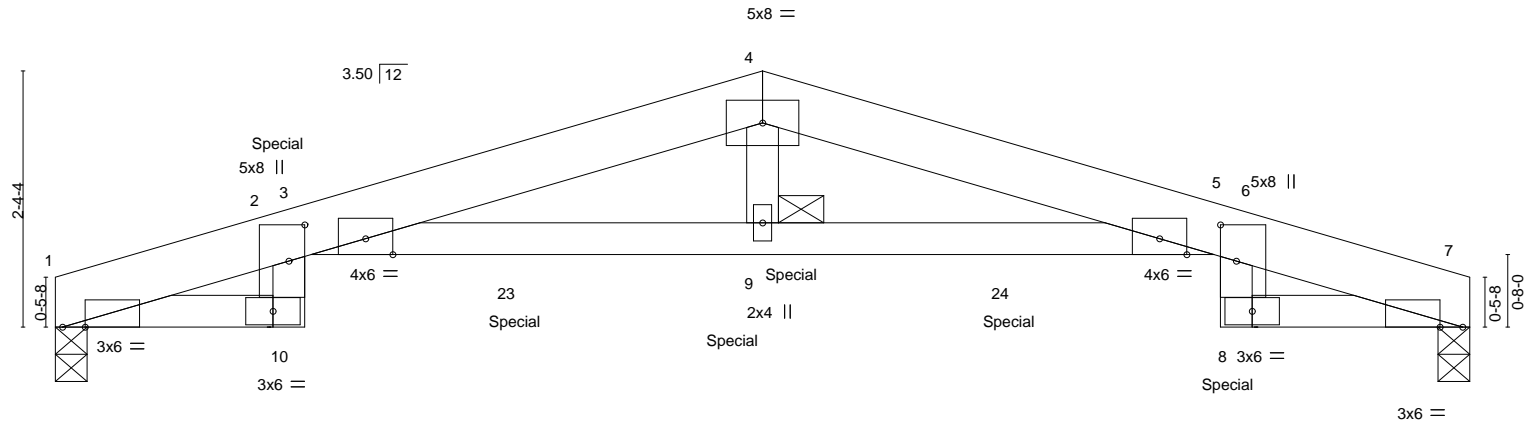

2-3-8	6-6-0	10-8-8	13-0-0
2-3-8	4-2-8	4-2-8	2-3-8

<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL	25.0	Plate Grip DOL 1.15	TC 0.65	Vert(LL) -0.18 9-22 >844 240	MT20	197/144
TCDL	10.0	Lumber DOL 1.15	BC 0.86	Vert(CT) -0.31 9-22 >494 180		
BCLL	0.0	Rep Stress Incr NO	WB 0.12	Horz(CT) 0.16 7 n/a n/a		
BCDL	10.0	Code IRC2018/TPI2014	Matrix-MS		Weight: 82 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x6 SPF 2100F 1.8E	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	JOINTS 1 Brace at Jt(s): 9

<b>REACTIONS.</b>	(size) 1=0-3-8, 7=0-3-8
	Max Horz 1=30(LC 8)
	Max Uplift 1=253(LC 4), 7=252(LC 5)
	Max Grav 1=1233(LC 1), 7=1226(LC 1)

<b>FORCES.</b>	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-1301/268, 3-4=-4113/844, 4-5=-4112/854, 5-6=-292/83, 6-7=-1306/284
BOT CHORD	1-10=-193/910, 2-10=-115/549, 3-9=-810/4079, 5-9=-810/4079, 6-8=-60/321, 7-8=-187/918
WEBS	4-9=-198/966

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
Bottom chords connected as follows: 2x4 - 1 row at 0-4-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
  - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
  - Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Bearing at joint(s) 1, 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=253, 7=252.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 225 lb down and 63 lb up at 2-4-3, 219 lb down and 65 lb up at 4-2-12, 210 lb down and 75 lb up at 6-2-12, 210 lb down and 75 lb up at 6-9-4, and 219 lb down and 65 lb up at 8-9-4, and 225 lb down and 63 lb up at 10-10-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

**LOAD CASE(S)** Standard

Continued on page 2



June 12, 2023



Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837556
3603730	P3	ROOF SPECIAL GIRDER	1	2	Job Reference (optional)	

**LOAD CASE(S)** Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-4=-70, 4-7=-70, 10-11=-20, 17-20=-20, 8-14=-20

Concentrated Loads (lb)

Vert: 10=-225(B) 9=-421(B) 20=-225(B) 23=-219(B) 24=-219(B)



8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:14:01 2023 Page 1  
ID:icBMJaMaT1gasuUvx9?RhvzDEHb-RfC?PsB70Hg3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

-0-10-8	1-9-4	5-6-12
0-10-8	1-9-4	3-9-8

Scale = 1:12.5

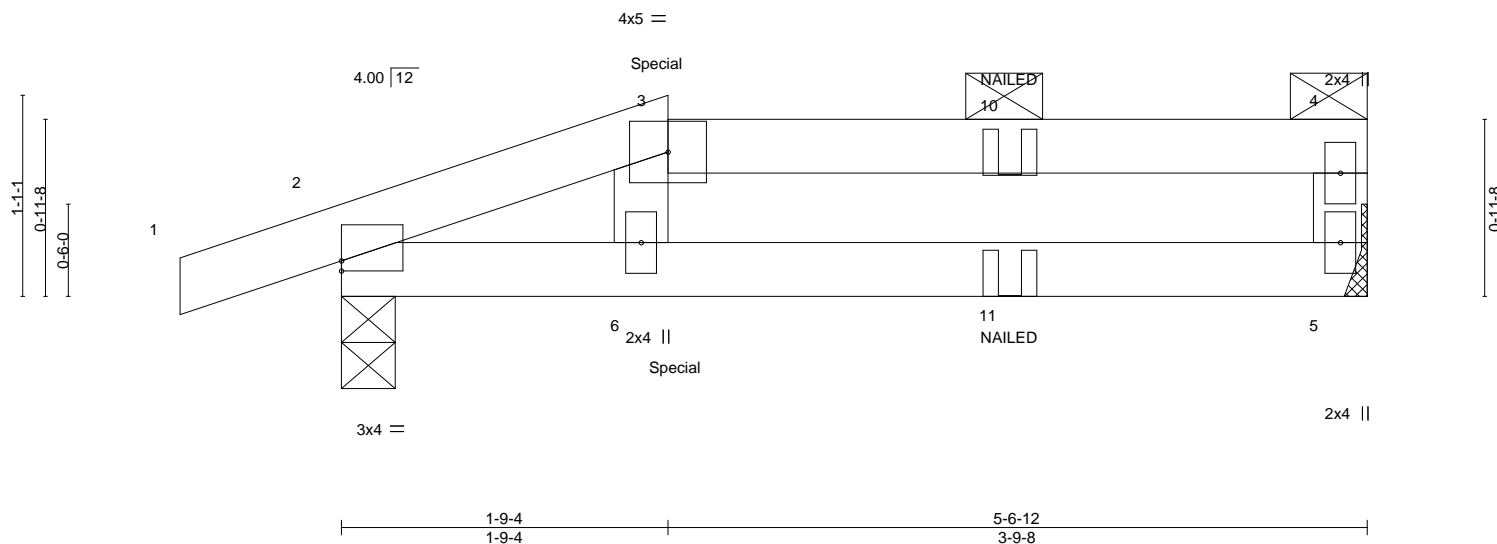


Plate Offsets (X,Y)-- [2:0-0,0-0,0-10]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d					PLATES GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.28	Vert(LL)	-0.09	5-6	>727	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.69	Vert(CT)	-0.17	5-6	>379	180		
BCLL	0.0	Rep Stress Incr	NO	WB	0.03	Horz(CT)	0.02	2	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-MP							Weight: 15 lb	FT = 20%

**LUMBER-**

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x4 SPF No.2

**BRACING-**

TOP CHORD	Structural wood sheathing directly applied or 5-6-12 oc purlins, except end verticals, and 2-0-0 oc purlins: 3-4.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

## REACTIONS.

(size) 5=Mechanical, 2=0-3-8  
Max Horz 2=29(LC 7)  
Max Uplift 5=-42(LC 4), 2=-78(LC 4)  
Max Grav 5=245(LC 1), 2=318(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 3-6=-251/74

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDF=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 2.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 9) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 10) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 36 lb down and 58 lb up at 1-9-4 on top chord, and 23 lb down at 1-9-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 11) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

## LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-70, 3-4=-70, 5-7=-20  
Concentrated Loads (lb)  
Vert: 6=-8(B) 11=-6(B)



June 12, 2023



**WARNING – Velly design parameters are listed below and included within key reference 1. See MIF-1419.1 for 3/15/2020 per ONE USE.**  
 Design valid for use only with MITEK® connectors. This design is based only upon parameters shown, and is for the building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837558
3603730	P5	Half Hip	2	1		

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:14:03 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:12.9

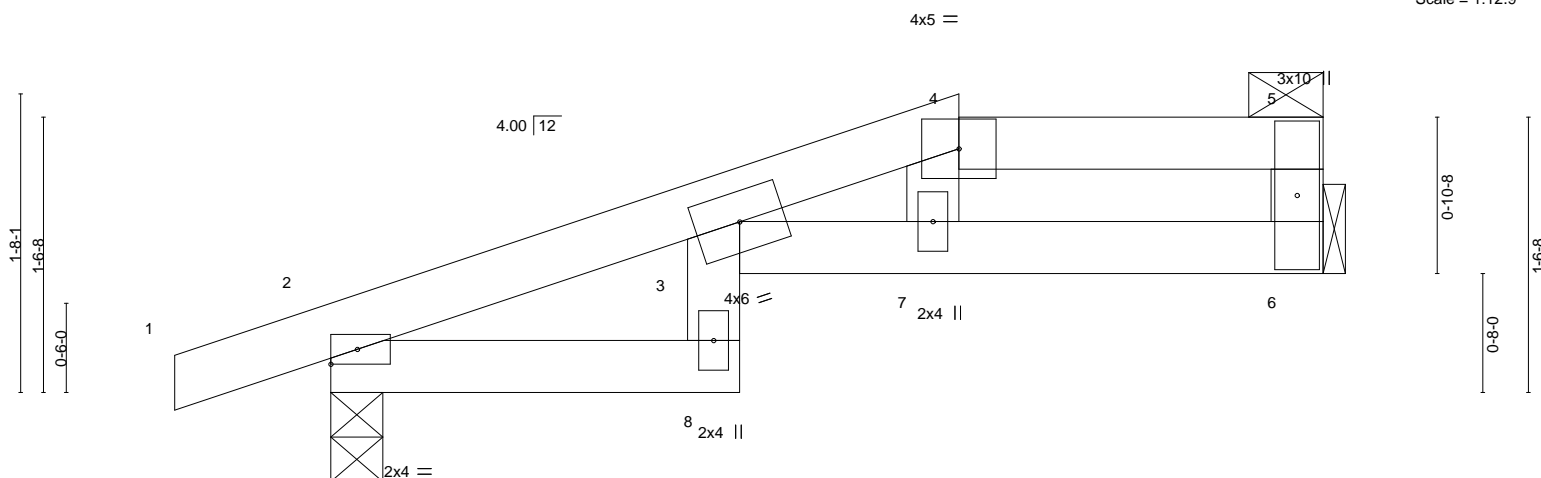

		2-3-8		3-6-4		5-6-12					
		2-3-8		1-2-12		2-0-8					
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d		<b>PLATES</b> <b>GRIP</b>			
TCLL	25.0	Plate Grip DOL 1.15		TC	0.55	Vert(LL)	0.11 3-7	>603	240	MT20	197/144
TCDL	10.0	Lumber DOL 1.15		BC	0.61	Vert(CT)	-0.18 3-7	>370	180		
BCLL	0.0	Rep Stress Incr YES		WB	0.05	Horz(CT)	0.08 6	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 16 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and  
2-0-0 oc purlins: 4-5.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 6=Mechanical, 2=0-3-8  
Max Horz 2=41(LC 8)  
Max Uplift 6=45(LC 8), 2=-75(LC 8)  
Max Grav 6=239(LC 1), 2=310(LC 1)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
WEBS 4-7=-365/262

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-12, Interior(1) 2-1-12 to 3-6-4, Exterior(2E) 3-6-4 to 5-5-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/193 Highland Meadows	I58837559
3603730	P6	HALF HIP	2	1		

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:14:03 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:15.0

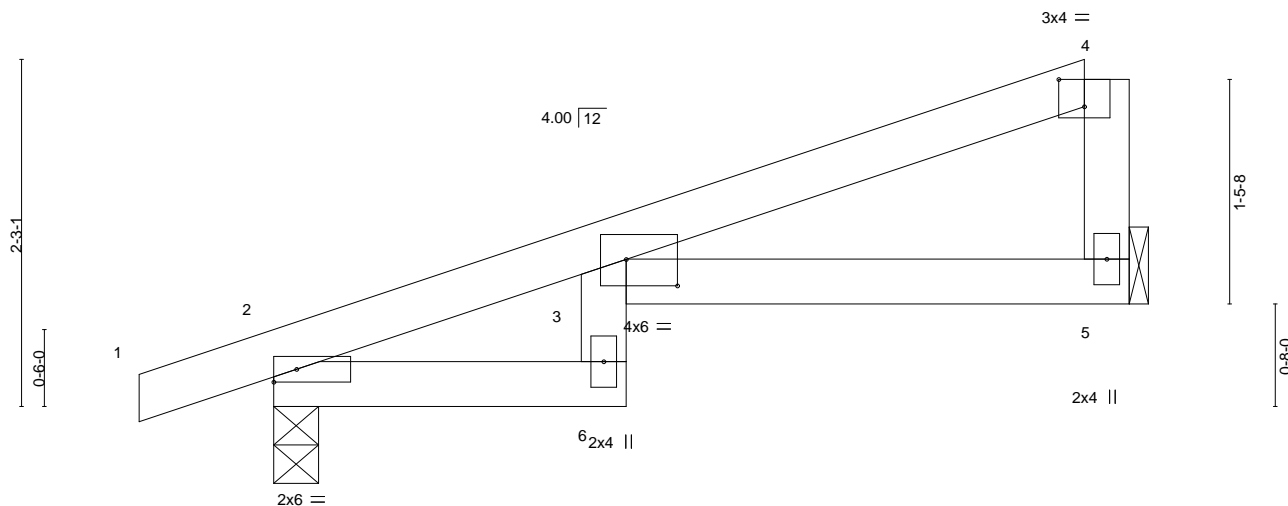


Plate Offsets (X,Y)-- [3:0-4-0,0-2-1], [4:0-2-0,0-2-2]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.51	Vert(LL)	-0.07	6	>918	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.28	Vert(CT)	-0.12	6	>511	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.07	5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R						Weight: 16 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-6-12 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 5=Mechanical, 2=0-3-8  
Max Horz 2=78(LC 8)  
Max Uplift 5=-55(LC 12), 2=-70(LC 8)  
Max Grav 5=230(LC 1), 2=316(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-12, Interior(1) 2-1-12 to 5-5-0 zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 3603730	Truss V1	Truss Type Valley	Qty 1	Ply 1	Summit/193 Highland Meadows I58837560
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					Job Reference (optional)

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:14:04 2023 Page 1  
ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

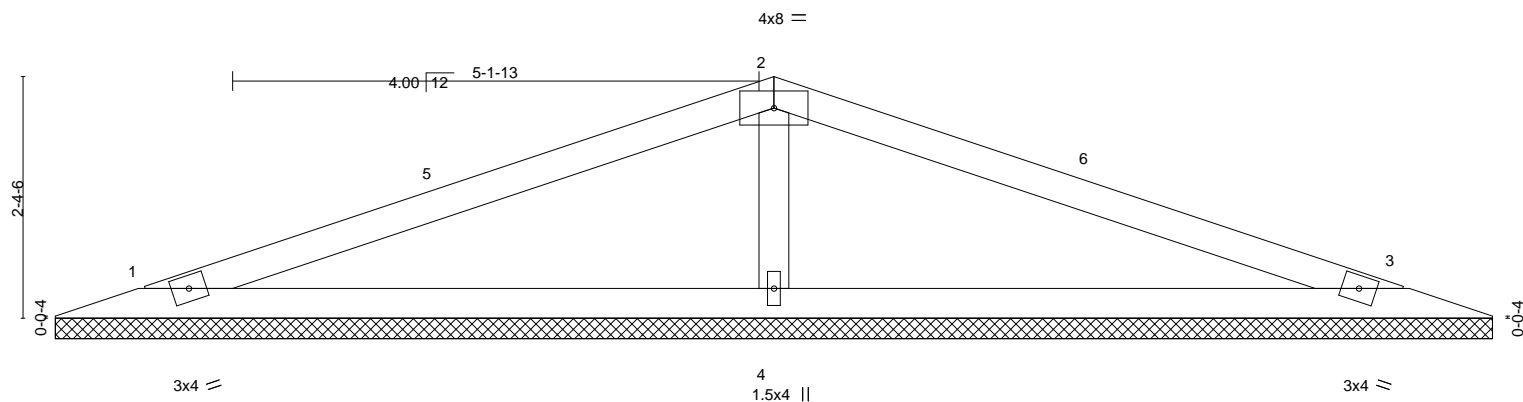

0-0-12			14-2-4									
0-0-12			14-1-8									
<b>LOADING</b> (psf)			<b>SPACING-</b> 2-0-0		<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d			<b>PLATES</b>	<b>GRIP</b>		
TCLL	25.0		Plate Grip DOL	1.15	TC 0.55	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0		Lumber DOL	1.15	BC 0.31	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0		Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0		Code IRC2018/TPI2014		Matrix-S						Weight: 33 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SPF No.2	

**REACTIONS.** (size) 1=14-0-12, 3=14-0-12, 4=14-0-12  
Max Horz 1=33(LC 12)  
Max Uplift 1=49(LC 8), 3=53(LC 13), 4=63(LC 8)  
Max Grav 1=246(LC 25), 3=246(LC 26), 4=633(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
**WEBS** 2-4=448/206

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-11-5 to 3-11-5, Interior(1) 3-11-5 to 7-1-2, Exterior(2R) 7-1-2 to 10-1-2, Interior(1) 10-1-2 to 13-2-15 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Gable requires continuous bottom chord bearing.
  - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
  - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023

Scale: 3/4"=1'



Job 3603730	Truss V3	Truss Type Valley	Qty 1	Ply 1	Summit/193 Highland Meadows I58837562
----------------	-------------	----------------------	----------	----------	--


Builders FirstSource (Valley Center),

Valley Center, KS - 67147,


8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 8 14:14:06 2023 Page 1

ID:icBMJaMgT1gasuUyx9?RhvzDEHb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDdi7J4zJC?f

Job Reference (optional)



Scale = 1:11.3

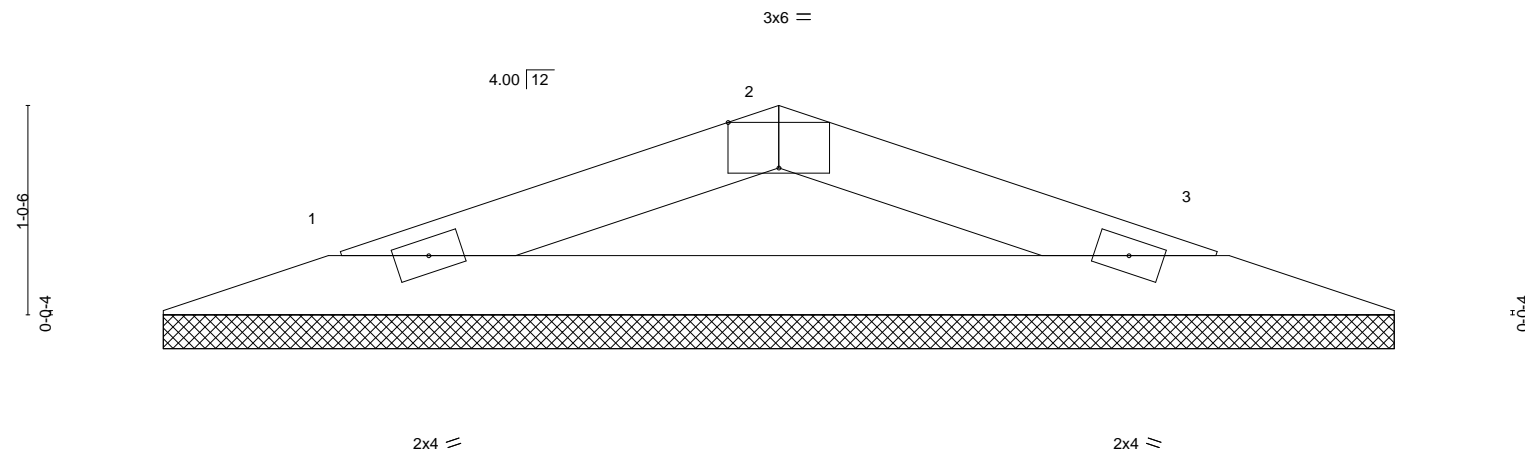

0-0-12 0-0-12	6-2-4 6-1-8
Plate Offsets (X,Y)--	[2:0-3-0,Edge]
<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0
TCLL 25.0	Plate Grip DOL 1.15
TCDL 10.0	Lumber DOL 1.15
BCLL 0.0	Rep Stress Incr YES
BCDL 10.0	Code IRC2018/TPI2014
	<b>CSI.</b>
	TC 0.10
	BC 0.20
	WB 0.00
	Matrix-P
	<b>DEFL.</b>
	in (loc) l/defl L/d
	Vert(LL) n/a - n/a 999
	Vert(CT) n/a - n/a 999
	Horz(CT) 0.00 3 n/a n/a
	<b>PLATES</b> <b>GRIP</b>
	MT20 197/144
	Weight: 12 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=6-0-12, 3=6-0-12  
Max Horz 1=12(LC 12)  
Max Uplift 1=28(LC 8), 3=28(LC 9)  
Max Grav 1=194(LC 1), 3=194(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-253/215, 2-3=-253/225

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



June 12, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

# Symbols

## PLATE LOCATION AND ORIENTATION

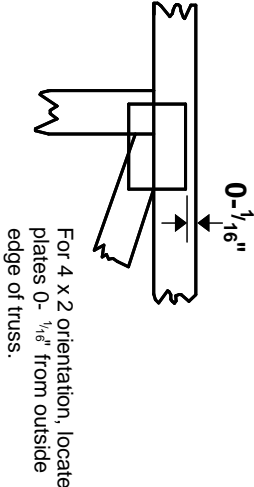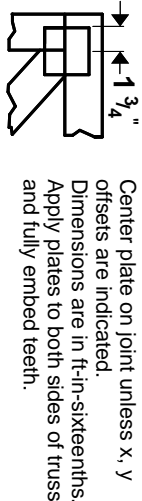

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.

## PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.


## BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

**Industry Standards:**  
ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-89: Design Standard for Bracing.  
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System

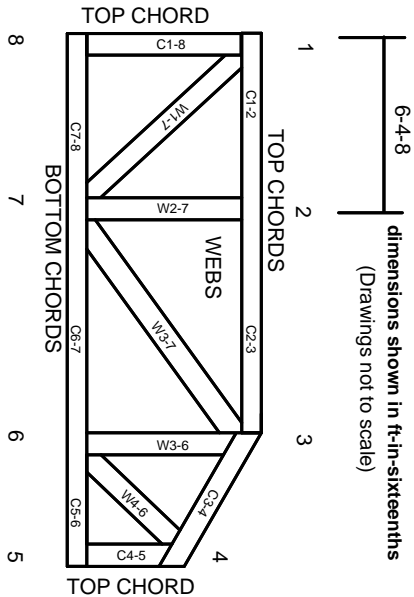

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

## PRODUCT CODE APPROVALS

ICC-ES Reports:  
ESR-1311, ESR-1352, ESR1988  
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved



MITek Engineering Reference Sheet: MII-7473 rev. 5/19/2020

# General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.