### **GENERAL NOTES**

#### **CODE AND STANDARDS**

1. ALL WORK SHALL COMPLY WITH 2017 NATIONAL ELECTRIC CODE (NEC), 2018 INTERNATIONAL BUILDING CODE (IBC), 2018 INTERNATIONAL RESIDENTIAL CODE (IRC), 2018 UNIFORM PLUMBING CODE (UPC), AND ALL STATE AND LOCAL BUILDING, ELECTRICAL, AND PLUMBING CODES.

2. DRAWINGS HAVE BEEN DETAILED ACCORDING TO UL LISTING REQUIREMENTS.

#### SITE NOTES / OSHA REGULATION

1. A LADDER SHALL BE IN PLACE FOR INSPECTION IN COMPLIANCE WITH OSHA REGULATIONS

2. THE PV MODULES ARE CONSIDERED NON-COMBUSTIBLE AND THIS SYSTEM IS A UTILITY INTERACTIVE SYSTEM.

3. THE SOLAR PV INSTALLATION SHALL NOT OBSTRUCT ANY PLUMBING, MECHANICAL, OR BUILDING ROOF VENTS. 4. ROOF COVERINGS SHALL BE DESIGNED, INSTALLED, AND MAINTAINED IN ACCORDANCE WITH THIS CODE AND

THE APPROVED MANUFACTURER'S INSTRUCTIONS SUCH THAT THE ROOF COVERING SHALL SERVE TO PROTECT THE BUILDING OR STRUCTURE.

#### **SOLAR CONTRACTOR**

1. MODULE CERTIFICATIONS WILL INCLUDE UL1703, IEC61646, IEC61730.

2. IF APPLICABLE, MODULE GROUNDING LUGS MUST BE INSTALLED AT THE MARKED GROUNDING LUG HOLES PER THE MANUFACTURER'S INSTALLATION REQUIREMENTS

3. AS INDICATED BY DESIGN, OTHER NRTL LISTED MODULE GROUNDING DEVICES MAY BE USED IN PLACE OF STANDARD GROUNDING LUGS AS SHOWN IN MANUFACTURER DOCUMENTATION AND APPROVED BY THE AHJ.

4. CONDUIT AND WIRE SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UP-SIZING AS REQUIRED BY FIELD CONDITIONS.

5. CONDUIT POINT OF PENETRATION FROM EXTERIOR TO INTERIOR TO BE INSTALLED AND SEALED WITH A SUITABLE SEALING COMPOUND

6. DC WIRING LIMITED TO MODULE FOOTPRINT W/ ENPHASE AC SYSTEM.

7. ENPHASE WIRING SYSTEMS SHALL BE LOCATED AND SECURED UNDER THE ARRAY W/ SUITABLE WIRING CLIPS. 8. MAX DC VOLTAGE CALCULATED USING MANUFACTURER PROVIDED TEMP COEFFICIENT FOR VOC UNLESS NOT

9 ALL INVERTERS MOTOR GENERATORS PHOTOVOLTAIC MODULES PHOTOVOLTAIC PANELS AC PHOTOVOLTAIC MODULES, DC COMBINERS, DC-TO-DC CONVERTERS, SOURCE CIRCUIT COMBINERS, AND CHARGE CONTROLLERS INTENDED FOR USE IN A PHOTOVOLTAIC POWER SYSTEM WILL BE IDENTIFIED AND LISTED FOR THE APPLICATION PER NEC 690.4(B).

10. ALL SIGNAGE TO BE PLACED IN ACCORDANCE WITH LOCAL BUILDING CODE.

11. TERMINALS AND LUGS WILL BE TIGHTENED TO MANUFACTURER TORQUE SPECIFICATIONS (WHEN PROVIDED) IN ACCORDANCE WITH NEC CODE 110.14(D) ON ALL ELECTRICAL CONNECTIONS.

#### **EQUIPMENT LOCATIONS**

1. PROPER ACCESS AND WORKING CLEARANCE AROUND EXISTING AND PROPOSED ELECTRICAL EQUIPMENT WILL BE PROVIDED AS PER SECTION NEC 110.26.

2. EQUIPMENT INSTALLED IN DIRECT SUNLIGHT MUST BE RATED FOR EXPECTED OPERATING TEMPERATURE AS SPECIFIED BY NEC 690.31(A) AND NEC TABLE 310.15(B).

3. ALL EQUIPMENT SHALL BE INSTALLED ACCESSIBLE TO QUALIFIED PERSONNEL ACCORDING TO NEC APPLICABLE CODES

4. ALL COMPONENTS ARE LISTED FOR THEIR PURPOSE AND RATED FOR OUTDOOR USAGE WHEN APPROPRIATE.

#### **PROJECT INFORMATION:**

**NUMBER OF STORIES: 2 CONDUIT RUN: Interior** 

**ECOBEE QTY:** 1 **LIGHT BULB QTY: 18 PV METER:** Not Required

#### **ROOF TYPE (1) INFORMATION:**

**ROOF TYPE:** Comp Shingle FRAMING TYPE: Rafter **SHEATHING TYPE: OSB** 

ATTACHMENT: UNIRAC STRONGHOLD ATT

RACKING: NXT Horizon @ 48" OC Portrait / 72" OC Landscape

**NUMBER OF ATTACHMENTS: 38** 

**ROOF TYPE (2) INFORMATION (IF APPLICABLE):** 

\*SEE PV4.2


#### SYSTEM TO BE INSTALLED INFORMATION:

DC SYSTEM SIZE: 7.2 kW DC AC SYSTEM SIZE: 5.22 kW AC

MODULE TYPE: (18) URE FBM400MFG-BB INVERTER TYPE: Enphase IQ8PLUS-72-2-US

MONITORING: Enphase IQ Combiner 4 X-IQ-AM1-240-4

#### **AERIAL VIEW**

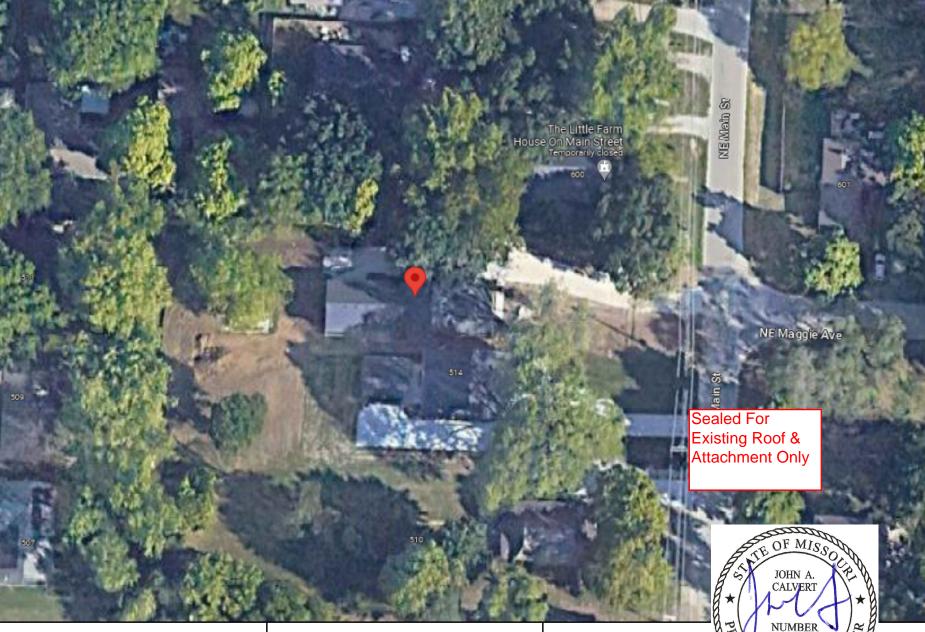

#### **DESIGN CRITERIA**

WIND SPEED: 115 mph GROUND SNOW LOAD: 20 lb/ft2 **WIND EXPOSURE FACTOR: C SEISMIC DESIGN CATEGORY:** B

RELEASE FOR CONSTRUCTION

AS NOTED FOR PLAN REVIEW

DEVELOPMENT SERVICES

08/22/2023

#### SITE SPECIFICATIONS

**CONSTRUCTION - V-B ZONING: RESIDENTIAL** 

#### **SCOPE OF WORK**

INSTALLATION OF UTILITY INTERACTIVE PHOTOVOLTAIC SOLAR SYSTEM AND ANY NECESSARY ADDITIONAL WORK NEEDED FOR INSTALLATION.

## **UTILITY COMPANY:**

**Evergy MO West** 

#### **PERMIT ISSUER:**

City of Lee's Summit

## **SHEET INDEX**

**PV1** - COVER SHEET

**PV2** - SITE PLAN PV3 - ROOF PLAN

**PV4** - STRUCTURAL

PV5 - ELECTRICAL 3-LINE DIAGRAM **PV6** - ELECTRICAL CALCULATIONS

PV7 - WARNING LABELS AND LOCATIONS

PV8 - PLACARD

(ALL OTHER SHEETS AS REQUIRED)

## SS - PRODUCT SPEC. SHEETS

PE-2021040848

8/4/23



1403 N. Research Way Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OF

IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND JSE OF THE RESPECTIVE EQUIPMENT WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC



**PROFESSIONAL** Scott Gurney

#PV-011719-015866

CONTRACTOR: **BRS FIELD OPS** 800-377-4480

> 29 Missouri SIZI

**CUSTOMER INFORMATION: NW Main St** Summit Dan 518 Lee-

RAWING BY:

Brendan Fillmore

PLOT DATE:

August 4, 2023

PROJECT NUMBER:

793875

SHEET NAME:

**COVER SHEET** 

REVISION:


0

PV1

## **PV SYSTEM SPECIFICATIONS TOTAL NUMBER OF MODULES: 18** MODULE MAKE AND MODEL: URE FBM400MFG-BB **MODULE WATTAGE:** 400W DC


INVERTER MAKE AND MODEL: Enphase IQ8PLUS-72-2-US **INVERTER TYPE:** Microinverter (1 Inverter per PV Module)

**INVERTER CURRENT OUTPUT: 1.21A AC INVERTER NOMINAL VOLTAGE: 240V INVERTER WATTAGE: 290W AC** 

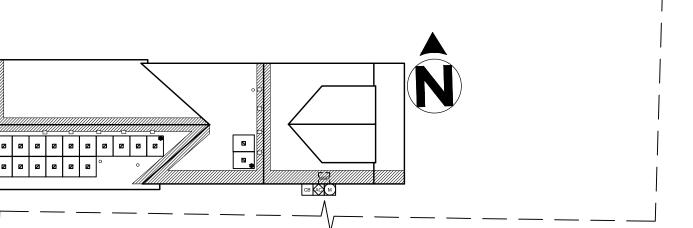

FRONT OF HOME 518 NW MAIN ST

Sealed For Existing Roof & **Attachment Only** 



**LEGEND** 

JUNCTION BOX



MSP MAIN SERVICE PANEL



СВ **COMBINER BOX** 

LOAD CENTER

SUB SUBPANEL

PV PV METER

LC

TS TRANSFER SWITCH

ESS SUNPOWER ESS

SUNPOWER HUB+

RPO REMOTE POWER OFF

FIRE SETBACK

**TRENCHING** 

PROPERTY LINE

SCALE: 3/64" = 1'-0"

**BLUE RAVEN** 1403 N. Research Way

Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT



WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.

PV INSTALLATION **PROFESSIONAL** Scott Gurney

#PV-011719-015866

CONTRACTOR: **BRS FIELD OPS** 800-377-4480

5.22 kW AC 7.2 kW DC CUSTOMER INFORMATION:
Dan Roberts
518 NW Main St
Lee's Summit Missouri 64063 SIZE: SIZE:

SYSTEM SYSTEM AC

DRAWING BY:

Brendan Fillmore

PLOT DATE:

August 4, 2023

PROJECT NUMBER:

793875

SHEET NAME:

RELEASE FOR CONSTRUCTION

08/22/2023

8/4/23

#### **PV SYSTEM SPECIFICATIONS**


**TOTAL NUMBER OF MODULES: 18** 

MODULE MAKE AND MODEL: URE FBM400MFG-BB

**MODULE WATTAGE:** 400W DC

INVERTER MAKE AND MODEL: Enphase IQ8PLUS-72-2-US **INVERTER TYPE:** Microinverter (1 Inverter per PV Module)

**INVERTER CURRENT OUTPUT: 1.21A AC INVERTER NOMINAL VOLTAGE: 240V INVERTER WATTAGE: 290W AC** 

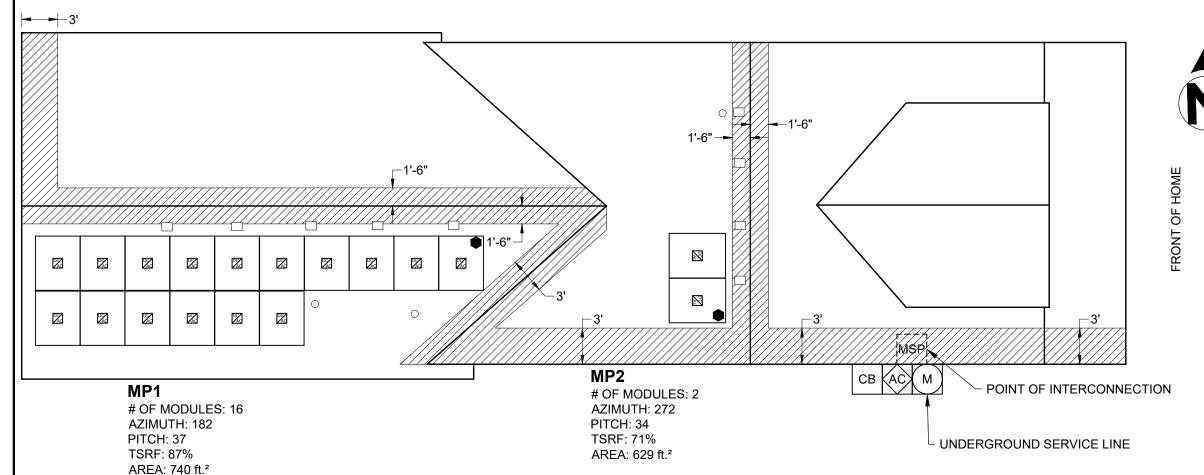



JUNCTION BOX



MSP MAIN SERVICE PANEL



СВ **COMBINER BOX** 

LOAD CENTER

SUB SUBPANEL

LC

PV **PV METER** 

TS TRANSFER SWITCH

ESS SUNPOWER ESS

HUB SUNPOWER HUB+

RPO REMOTE POWER OFF

FIRE SETBACK

**TRENCHING** 

PROPERTY LINE

SCALE: 1/8" = 1'-0"

Sealed For Existing Roof & Attachment Only



**BLUE RAVEN** 

1403 N. Research Way Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT

WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



PV INSTALLATION **PROFESSIONAL** Scott Gurney

#PV-011719-015866

CONTRACTOR: **BRS FIELD OPS** 800-377-4480

5.22 kW AC 7.2 kW DC CUSTOMER INFORMATION:
Dan Roberts
518 NW Main St
Lee's Summit Missouri 64063 SIZE: SIZE: SYSTEM SYSTEM

DRAWING BY:

Brendan Fillmore

AC

PLOT DATE:

August 4, 2023

PROJECT NUMBER:

793875

SHEET NAME:

RELEASE FOR COMSTRUCT

08/22/2023

8/4/23

#### STRUCTURAL INFORMATION: **ROOF TYPE (1):**

**ROOF TYPE:** Comp Shingle **SHEATHING TYPE: OSB** FRAMING TYPE: Rafter FRAMING SIZE: 2x4 @ 24" OC CEILING JOIST SIZE: 2x4 @ 24" OC

**ATTACHMENT: UNIRAC STRONGHOLD ATT** 

**RACKING: NXT Horizon** 

@ 48" OC Portrait / 72" OC Landscape

**NUMBER OF ATTACHMENTS: 38** 

**PV MODULE COUNT:** 18 Modules

TOTAL ARRAY AREA: 367.2 ft<sup>2</sup> (20.4ft<sup>2</sup>/panel)


TOTAL ROOF AREA: 3074 ft<sup>2</sup> **ARRAY/ROOF AREA:** 11.9%

ARRAY WEIGHT: 900 lbs (50 lbs/panel) **DISTRIBUTED LOAD: 2.45 lbs/ft²** POINT LOAD: 23.68 lbs/attachment


#### STRUCTURAL NOTES:

MP 1 is rafter framing with 2x6 rafters spaced 19.2 in apart


\*NOTE: LISTED NUMBER OF ATTACHMENT POINTS ARE AN ESTIMATE ONLY AND MAY VARY BASED ON FIELD CONDITIONS. MAXIMUM ATTACHMENT SPACING TO BE FOLLOWED PER ENGINEER OF RECORD SPECIFICATIONS.

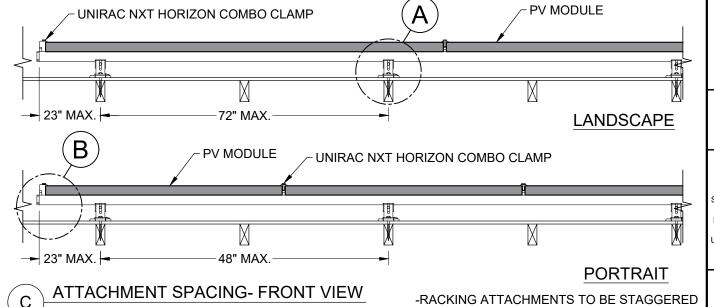

SCALE: 3/4" = 1'-0"

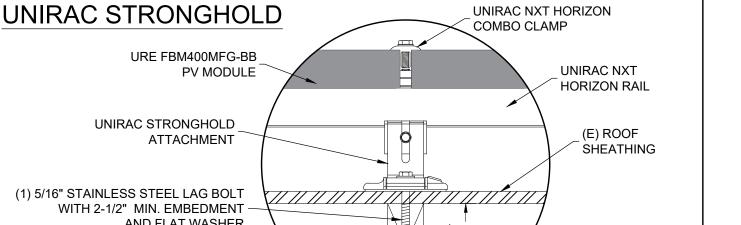

AND FLAT WASHER  $2\frac{1}{2}$ " MIN. EMBED. MID CLAMP DETAIL (E) BUILDING STRUCTURE SCALE: 3" = 1'-0"

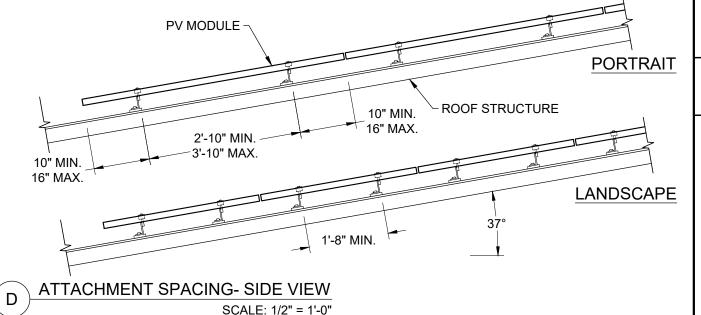

UNIRAC NXT HORIZON URE FBM400MFG-BB **COMBO CLAMP** PV MODULE UNIRAC NXT HORIZON RAIL UNIRAC STRONGHOLD ATTACHMENT (E) ROOF **SHEATHING** (1) 5/16" STAINLESS STEEL LAG BOLT WITH 2-1/2" MIN. EMBEDMENT AND FLAT WASHER 2½" MIN. EMBED. **END CLAMP DETAIL** (E) BUILDING STRUCTURE SCALE: 3" = 1'-0"

Sealed For Existing Roof & **Attachment Only** 



**BLUE RAVEN** 

#### 1403 N. Research Way Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION

HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OF IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC



#### PV INSTALLATION **PROFESSIONAL**

Scott Gurney #PV-011719-015866

CONTRACTOR: **BRS FIELD OPS** 800-377-4480

5.22 kW AC 7.2 kW DC CUSTOMER INFORMATION: Dan Roberts 518 NW Main St 64063 St Missouri ( 5. SIZE: SIZE: Summit STEM SY: S Lee' ပပ

DRAWING BY:

Brendan Fillmore

PLOT DATE:

August 4, 2023

PROJECT NUMBER:

793875

SHEET NAME:

## STRUCTURAL

UB/ZZ/ZUZ3

EXTERIOR

240 V A

**ELECTRICAL NOTES:** 

EXTERIOR

**BLUE RAVEN** 

1403 N. Research Way Orem, UT 84097

WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT WITHOUT THE WRITTEN PERMISSION

OF BLUE RAVEN SOLAR LLC.



PV INSTALLATION **PROFESSIONAL** 

Scott Gurney #PV-011719-015866

CONTRACTOR: **BRS FIELD OPS** 800-377-4480

5.22 kW AC 7.2 kW DC ı St : Missouri 64063 CUSTOMER INFORMATION: Dan Roberts 518 NW Main St 7 SIZE: SIZE:

Summit SYSTEM SYSTEM ree's S S

DRAWING BY:

Brendan Fillmore

PLOT DATE:

August 4, 2023

PROJECT NUMBER:

793875

SHEET NAME:

## RELEASE FOR CONSTRUCTION


U8/ZZ/ZUZ3

**DESIGNER NOTES:** 

(1) 3/4 INCH EMT

**EXTERIOR** 

LOAD SIDE BREAKER IN MSP, POI INTERIOR

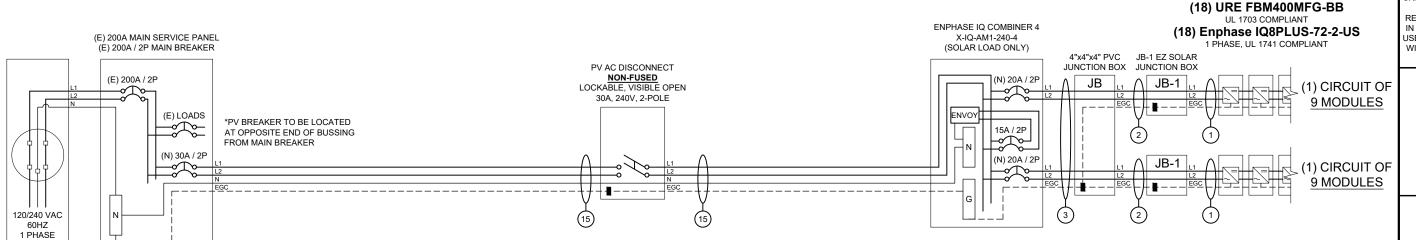



3/4 INCH EMT (Not Required for UF-B or NM-B Cable) INTERIOR



## INTERCONNECTION NOTES

3/4 INCH EMT

TO UTILITY GRID

705.12(B)(3) THE FOLLOWING METHOD(S) SHALL BE USED TO DETERMINE THE RATINGS OF BUSBARS: (2) WHERE TWO SOURCES, ONE A PRIMARY POWER SOURCE AND THE OTHER ANOTHER POWER SOURCE, ARE LOCATED AT OPPOSITE ENDS OF A BUSBAR THAT CONTAINS LOADS, THE SUM OF 125 PERCENT OF THE POWER-SOURCE(S) OUTPUT CIRCUIT CURRENT AND THE RATING OF THE OVERCURRENT DEVICE PROTECTING THE BUS BAR SHALL NOT EXCEED 120 PERCENT OF THE AMPACITY OF THE BUSBAR.

(E) GROUNDING ELECTRODE(S)

**UTILITY COMPANY:** Evergy MO West

**PERMIT ISSUER:** City of Lee's Summit

MODULE SPECIFICATIONS	URE FBM400MFG-BB
RATED POWER (STC)	400 W
MODULE VOC	37.2 V DC
MODULE VMP	31.17 V DC
MODULE IMP	12.84 A DC
MODULE ISC	13.68 A DC
VOC CORRECTION	-0.27 %/°C
VMP CORRECTION	-0.32 %/°C
SERIES FUSE RATING	30 A DC
ADJ. MODULE VOC @ ASHRAE LOW TEMP	41.8 V DC
ADJ. MODULE VMP @ ASHRAE 2% AVG. HIGH TEMP	27.0 V DC

MICROINVERTER SPECIFICATIONS	Enphase I	Q8+ Mid	croinverte	r
POWER POINT TRACKING (MPPT) MIN/MAX	30 -	58	V DC	
MAXIMUM INPUT VOLTAGE			60 V DC	
MAXIMUM DC SHORT CIRCUIT CURRENT			15 A DC	
MAXIMUM USABLE DC INPUT POWER		4	40 W	
MAXIMUM OUTPUT CURRENT		1.	21 A AC	
AC OVERCURRENT PROTECTION			20 A	
MAXIMUM OUTPUT POWER		2	.90 W	
CEC WEIGHTED EFFICIENCY			97 %	

AC PHOTOVOLATIC MODULE MARKING (NEC 690.52)

NOMINAL OPERATING AC VOLTAGE

NOMINAL OPERATING AC FREQUENCY

MAXIMUM OCPD RATING FOR AC MODULE

SYSTEM ELECTRICAL SPECIFICATIONS	CIR 1	CIR 2	CIR 3	CIR 4	CIR 5
NUMBER OF MODULES PER MPPT	9	9			
DC POWER RATING PER CIRCUIT (STC)	3600	3600			
TOTAL MODULE NUMBER			18	}	
STC RATING OF ARRAY			720	0	
AC CURRENT @ MAX POWER POINT (IMP)	10.9	10.9			
MAX. CURRENT (IMP X 1.25)	13.6125	13.6125			
OCPD CURRENT RATING PER CIRCUIT	20	20			
MAX. COMB. ARRAY AC CURRENT (IMP)			21.	8	
MAX. ARRAY AC POWER			5220V	/ AC	

**DESIGN LOCATION AND TEMPERATURES** 

TEMPERATURE DATA SOURCE

ASHRAE EXTREME LOW TEMP (°C)

ASHRAE 2% AVG. HIGH TEMP (°C)

WEATHER STATION

STATE

CITY

240 V AC

240 VA AC

1.0 A AC

20 A AC

47 - 68 HZ AC

AC VOLTAGE RISE CALCULATIONS	DIST (FT)	COND.	√RISE(V)	VEND(V)	%VRISE	
VRISE SEC. 1 (MICRO TO JBOX)	32.4	12 Cu.	1.18	241.18	0.49%	
VRISE SEC. 2 (JBOX TO COMBINER BOX)	55	10 Cu.	1.52	241.52	0.63%	
VRISE SEC. 3 (COMBINER BOX TO POI)	5	10 Cu.	0.28	240.28	0.12%	
TOTAL VRISE			2.98	242.98	1.24%	

PHOTOVOLTAIC AC DISCONNECT OUTPUT LABEL (NEC 690.54)	
AC OUTPUT CURRENT	21.8 A AC
NOMINAL AC VOLTAGE	240 V AC

	CONDUCTOR SIZE CAL	CULATIONS			
	MICROINVERTER TO	MAX. SHORT CIRCUIT CURRRENT (ISC) =	10.9	A AC	
	JUNCTION BOX (1)	MAX. CURRENT (ISC X1.25) =	13.6	A AC	
		CONDUCTOR (TC-ER, COPPER (90°C)) =	12	AWG	
1		CONDUCTOR RATING =	30	Α	
		AMB. TEMP. AMP. CORRECTION =	0.96		
		ADJUSTED AMP. =	28.8	>	13.6
	JUNCTION BOX TO	MAX. SHORT CIRCUIT CURRRENT (ISC) =	10.9	A AC	
_	JUNCTION BOX (2)	MAX. CURRENT (ISC X1.25) =	13.6	A AC	
		CONDUCTOR (UF-B, COPPER $(60^{\circ}C)$ ) =	10	AWG	
		CONDUCTOR RATING =	30	Α	
		CONDUIT FILL DERATE =	1		
		AMB. TEMP. AMP. CORRECTION =	0.96		
		ADJUSTED AMP. =	28.8	>	13.6
	JUNCTION BOX TO	MAX. SHORT CIRCUIT CURRRENT (ISC) =	10.9	A AC	
1	COMBINER BOX (3)	MAX. CURRENT (ISC X1.25) =	13.6	A AC	
		CONDUCTOR (UF-B, COPPER $(60^{\circ}C)$ ) =	10	AWG	
		CONDUCTOR RATING =	30	Α	
		CONDUIT FILL DERATE =	8.0		
,		AMB. TEMP. AMP. CORRECTION =	0.96		
		ADJUSTED AMP. =	23.04	>	13.6
	COMBINER BOX TO	INVERTER RATED AMPS =	21.8		
1	MAIN PV OCPD (15)	MAX. CURRENT (RATED AMPS X1.25) =	27.23	A AC	
		CONDUCTOR (THWN-2, COPPER (75°C TERM.)) =		AWG	
		CONDUCTOR RATING =	35	A	
,		CONDUIT FILL DERATE =	1		
		AMB. TEMP. AMP. CORRECTION =	0.96		
		ADJUSTED AMP. =	33.6	>	27.2

# **BLUE RAVEN**

1403 N. Research Way Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OF IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT WITHOUT THE WRITTEN PERMISSION



OF BLUE RAVEN SOLAR LLC

PV INSTALLATION **PROFESSIONAL** 

Scott Gurney #PV-011719-015866

CONTRACTOR: **BRS FIELD OPS** 800-377-4480

S

2) 0

7 7

CO

#### **GROUNDING NOTES**

MAXIMUM AC POWER

MAXIMUM AC CURRENT

- 1. A GROUNDING ELECTRODE SYSTEM IN ACCORDANCE WITH [NEC 690.47] AND [NEC 250.50-60] SHALL BE PROVIDED. PER [NEC 690.47], THE GROUNDING ELECTRODE SYSTEM OF AN EXISTING BUILDING MAY BE USED AND BE BONDED AT THE SERVICE ENTRANCE. IF EXISTING SYSTEM IS INACCESSIBLE, OR INADEQUATE, OR IS ONLY METALLIC WATER PIPING, A SUPPLEMENTAL GROUNDING ELECTRODE WILL BE USED AT THE INVERTER LOCATION CONSISTING OF A UL LISTED 8 FT GROUND ROD WITH ACORN CLAMP.
- 2. THE GROUNDING ELECTRODE CONDUCTOR SHALL BE PROTECTED FROM PHYSICAL DAMAGE BETWEEN THE GROUNDING ELECTRODE AND THE PANEL (OR INVERTER) IF SMALLER THAN #6 AWG COPPER WIRE PER INEC 250 64(B)). THE GROUNDING FLECTRODE CONDUCTOR WILL BE CONTINUOUS EXCEPT FOR SPLICES OR JOINTS AT BUSBARS WITHIN LISTED FOUIPMENT PER INFC 250 64(C)].
- 3. GROUNDING ELECTRODE CONDUCTORS SHALL BE NO LESS THAN 8 AWG AND NO GREATER THAN 6 AWG COPPER AND BONDED TO THE EXISTING GROUNDING ELECTRODE TO PROVIDE FOR A COMPLETE SYSTEM. 4. PV SYSTEM SHALL BE GROUNDED IN ACCORDANCE TO [NEC 250.21], [NEC TABLE 250.122], AND ALL METAL PARTS OR MODULE FRAMES ACCORDING TO [NEC 690.46].
- 5. MODULE SOURCE CIRCUITS SHALL BE GROUNDED IN ACCORDANCE TO [NEC 690.42].
- 6. THE GROUNDING CONNECTION TO A MODULE SHALL BE ARRANGED SUCH THAT THE REMOVAL OF A MODULE DOES NOT INTERRUPT A GROUNDED CONDUCTOR TO ANOTHER MODULE.
- 7. EACH MODULE WILL BE GROUNDED USING THE SUPPLIED CONNECTION POINTS IDENTIFIED IN THE MANUFACTURER'S INSTALLATION INSTRUCTIONS
- 8. ENCLOSURES SHALL BE PROPERLY PREPARED WITH REMOVAL OF PAINT/FINISH AS APPROPRIATE WHEN GROUNDING EQUIPMENT WITH TERMINATION GROUNDING LUGS.
- 9. GROUNDING SYSTEM COMPONENTS SHALL BE LISTED FOR THEIR PURPOSE, AND GROUNDING DEVISES EXPOSED TO THE ELEMENTS SHALL BE RATED FOR DIRECT BURIAL 10. GROUNDING AND BONDING CONDUCTORS SHALL BE COPPER, SOLID OR STRANDED, AND BARE WHEN
- **EXPOSED** 11 FOLIPMENT GROUNDING CONDUCTORS SHALL BE SIZED ACCORDING TO INEC 690.451 AND BE A
- MINIMUM OF 10 AWG WHEN NOT EXPOSED TO DAMAGE (6 AWG SHALL BE USED WHEN EXPOSED TO 12. GROUNDING AND BONDING CONDUCTORS, IF INSULATED, SHALL BE COLOR CODED GREEN (OR MARKED
- GREEN IF 4 AWG OR LARGER). 13. ALL CONDUIT BETWEEN THE UTILITY AC DISCONNECT AND THE POINT OF CONNECTION SHALL HAVE
- GROUNDED BUSHINGS AT BOTH ENDS 14. SYSTEM GEC SIZED ACCORDING TO [NEC 690.47], [NEC TABLE 250.66], DC SYSTEM GEC SIZED
- ACCORDING TO INEC 250 1661 MINIMUM 8 AWG WHEN INSUITATED 6 AWG WHEN EXPOSED TO DAMAGE 15. EXPOSED NON-CURRENT CARRYING METAL PARTS OF MODULE FRAMES, EQUIPMENTS, AND CONDUCTOR ENCLOSURES SHALL BE GROUNDED IN ACCORDANCE WITH [NEC 250.134] OR [NEC 250.136(A)] REGARDLESS OF VOLTAGE.

#### **WIRING & CONDUIT NOTES**

- 1. ALL CONDUIT SIZES AND TYPES, SHALL BE LISTED FOR ITS PURPOSE AND APPROVED FOR THE SITE APPLICATIONS.
- 2. BOLTED CONNECTION REQUIRED IN DC DISCONNECTS ON THE WHITE GROUNDED CONDUCTOR (USE POLARIS BLOCK OR NEUTRAL BAR).

ASHRAE 2% AVG. HIGH TEMP

KANSAS CITY INTL ARPT

Missour

CIR 6

-21

35

Lee's Summit

- 3. ANY CONNECTION ABOVE LIVE PARTS MUST BE WATERTIGHT. REDUCING WASHERS DISALLOWED ABOVE LIVE PARTS, MEYERS HUBS RECOMMENDED
- 4. UV RESISTANT CABLE TIES (NOT ZIP TIES) USED FOR PERMANENT WIRE MANAGEMENT OFF THE ROOF
- SURFACE IN ACCORDANCE WITH [NEC 110.2,110.3(A-B)] 5 SOLADECK JUNCTION BOXES MOUNTED FLUSH WITH ROOF SURFACE TO BE USED FOR WIRE
- MANAGEMENT AND AS FLASHED ROOF PENETRATIONS FOR INTERIOR CONDUIT RUNS. 6. ALL PV CABLES AND HOMERUN WIRES BE TYPE USE-2, AND SINGLE-CONDUCTOR CABLE LISTED AND
- IDENTIFIED AS PV WIRE, TYPE TC-ER, OR EQUIVALENT; ROUTED TO SOURCE CIRCUIT COMBINER BOXES AS
- 7. ALL CONDUCTORS AND OCPD SIZES AND TYPES SPECIFIED ACCORDING TO [NEC 690.8] FOR MULTIPLE CONDUCTORS.
- 8. ALL PV DC CONDUCTORS IN CONDUIT EXPOSED TO SUNLIGHT SHALL BE INSTALLED AT LEAST 7/8" ABOVE THE ROOF SURFACE AND DERATED ACCORDING TO [NEC TABLE 310.15 (B)(2)(A)], [NEC TABLE 310.15(B)(3)(A)].& [NEC 310.15(B)(3)(C)].
- 9. EXPOSED ROOF PV DC CONDUCTORS SHALL BE USE-2, 90°C RATED, WET AND UV RESISTANT, AND UL LISTED RATED FOR 600V, UV RATED SPIRAL WRAP SHALL BE USED TO PROTECT WIRE FROM SHARP
- 10. PHASE AND NEUTRAL CONDUCTORS SHALL BE DUAL RATED THHN/THWN-2 INSULATED, 90°C RATED, WET AND UV RESISTANT, RATED FOR 600V
- 11. 4-WIRE DELTA CONNECTED SYSTEMS HAVE THE PHASE WITH THE HIGHER VOLTAGE TO GROUND MARKED ORANGE OR IDENTIFIED BY OTHER EFFECTIVE MEANS.
- 12. ALL SOURCE CIRCUITS SHALL HAVE INDIVIDUAL SOURCE CIRCUIT PROTECTION
- 13. VOLTAGE DROP LIMITED TO 2% FOR DC CIRCUITS AND 3% FOR AC CIRCUITS
- 14. NEGATIVE GROUNDED SYSTEMS DC CONDUCTORS SHALL BE COLOR CODED AS FOLLOWS: DC POSITIVE- RED (OR MARKED RED), DC NEGATIVE- GREY (OR MARKED GREY)
- 15. POSITIVE GROUNDED SYSTEMS DC CONDUCTORS COLOR CODED:
- DC POSITIVE- GREY (OR MARKED GREY), DC NEGATIVE- BLACK (OR MARKED BLACK)
- 16. AC CONDUCTORS >4AWG COLOR CODED OR MARKED: PHASE A OR L1- BLACK, PHASE B OR L2- RED, PHASE C OR L3- BLUE NEUTRAL - WHITE/GRAY
- \* USE-2 IS NOT INDOOR RATED BUT PV CABLE IS RATED THWN/THWN-2 AND MAY BE USED INSIDE
- \* USE-2 IS AVAILABLE AS UV WHITE
- 17. RIGID CONDUIT, IF INSTALLED, (AND/OR NIPPLES) MUST HAVE A PULL BUSHING TO PROTECT WIRES.
- 18. IF CONDUIT DETERMINED TO BE RAN THROUGH ATTIC IN FIELD THEN CONDUIT WILL BE EITHER EMT, FMC, OR MC CABLE IF DC CURRENT COMPLYING WITH [NEC 690.31], [NEC 250.118(10)]. DISCONNECTING MEANS SHALL COMPLY WITH [NEC 690.13] AND [NEC 690.15].
- 19. CONDUIT RAN THROUGH ATTIC WILL BE AT LEAST 18" BELOW ROOF SURFACE COMPLYING WITH INEC 230.6(4)] AND SECURED NO GREATER THAN 6' APART PER INEC 330.30(B)]

STOMER INFORMATION: 64063 2 kW kW D  $\sim$ issouri 5 üü Ş Ş S S Summit Main E M Robert ST SY: SY: S Dan | 518 | ee

DRAWING BY:

Brendan Fillmore

PLOT DATE:

August 4, 2023

PROJECT NUMBER:

793875

SHEET NAME:



UO/ZZ/Z

## STANDARD LABELS

## **ADDITIONAL LABELS**

## **↑ WARNING**

ELECTRIC SHOCK HAZARD

TERMINALS ON THE LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

#### LABEL 1

LABEL 2

[2017 NEC 690.54]

[2020 NEC 690.54]

FOR PV SYSTEM DISCONNECTING MEANS WHERE THE LINE AND LOAD TERMINALS MAY BE ENERGIZED IN THE OPEN POSITION. [2017 NEC 690.13(B)] [2020 NEC 690.13(B)]

SHALL BE MARKED AT AN ACCESSIBLE LOCATION AT

THE DISCONNECTING MEANS AS A POWER SOURCE

NOMINAL OPERATING AC VOLTAGE

AND WITH THE RATED AC OUTPUT CURRENT AND THE

## WARNING

MAIN DISTRIBUTION UTILITY DISCONNECT(S)

POWER TO THIS BUILDING IS ALSO SUPPLIED FROM A ROOF MOUNTED SOLAR ARRAY WITH A RAPID SHUTDOWN DISCONNECTING MEANS GROUPED AND LABELED WITHIN LINE OF SITE
AND 10 FT OF THIS LOCATION

WARNING

POWER TO THIS BUILDING IS ALSO

SUPPLIED FROM MAIN DISTRIBUTION

UTILITY DISCONNECT LOCATED

## **BLUE RAVEN**

1403 N. Research Way Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OF IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC



PV INSTALLATION **PROFESSIONAL** 

Scott Gurney #PV-011719-015866

CONTRACTOR: **BRS FIELD OPS** 800-377-4480

64063 .22 kW .2 kW D St Missouri ( 5. ய் ய SIZI Summit **NW Main** STEM Robert

SY SY

CC

DRAWING BY:

**CUSTOMER INFORMATION:** 

Brendan Fillmore

S

Lee'

PLOT DATE:

August 4, 2023

Dan | 518 |

PROJECT NUMBER:

793875

SHEET NAME:

REVISIONS NOTE

RELEASE FOR CONSTRUCTION

U0/ZZ/ZUZ3

## PHOTOVOLTAIC SYSTEM AC DISCONNECT

RATED AC OUTPUT CURRENT 21.78 A NOMINAL OPERATING AC VOLTAGE  $\,240~{
m V}$ 

WARNING

**DUAL POWER SUPPLY** 

SOURCES: UTILITY GRID AND

PV SOLAR ELECTRIC SYSTEM

**⚠ WARNING** 

POWER SOURCE OUTPUT CONNECTION

DO NOT RELOCATE

THIS OVERCURRENT

DEVICE

#### LABEL 3

IF INTERCONNECTING LOAD SIDE, INSTALL THIS LABEL ANYWHERE THAT IS POWERED BY BOTH THE UTILITY AND THE SOLAR PV SYSTEM, IE. MAIN SERVICE PANEL AND SUBPANELS.

APPLY TO THE DISTRIBUTION EQUIPMENT ADJACENT

TO THE BACK-FED BREAKER FROM THE POWER

[2017 NEC 705.12(B)(3)] [2020 NEC 705.12(B)(3)]

[2017 NEC 705.12(B)(2)(3)(b)

[2020 NEC 705.12(B)(3)(2)]

## **WARNING**

FROM A ROOF MOUNTED SOLAR ARRAY, SOLAR ARRAY RAPID SHUTDOWN DISCONNECT IS LOCATED OUTSIDE NEXT TO THE UTILITY METER.

#### LABEL 9

INTERCONNECTED

[2017 NEC 705.10]

[2020 NEC 705.10]

LABEL 8

PERMANENT PLAQUE OR DIRECTORY DENOTING THE LOCATION OF ALL ELECTRIC POWER SOURCE DISCONNECTING MEANS ON OR IN THE PREMISES SHALL BE INSTALLED AT EACH SERVICE EQUIPMENT LOCATION AND AT THE LOCATION(S) OF THE SYSTEM DISCONNECT(S) FOR ALL ELECTRIC POWER PRODUCTION SOURCES CAPABLE OF BEING INTERCONNECTED. [2017 NEC 705.10] [2020 NEC 705.10]

PERMANENT PLAQUE OR DIRECTORY DENOTING THE

DISCONNECTING MEANS ON OR IN THE PREMISES

SHALL BE INSTALLED AT EACH SERVICE EQUIPMENT

LOCATION AND AT THE LOCATION(S) OF THE SYSTEM

LOCATION OF ALL ELECTRIC POWER SOURCE

DISCONNECT(S) FOR ALL ELECTRIC POWER

PRODUCTION SOURCES CAPABLE OF BEING

POWER TO THIS BUILDING IS ALSO SUPPLIED

#### LABEL 10

PERMANENT PLAQUE OR DIRECTORY TO BE LOCATED AT MAIN SERVICE EQUIPMENT DENOTING THE LOCATION OF THE RAPID SHUTDOWN SYSTEM DISCONNECTING MEANS IF SOLAR ARRAY RAPID SHUTDOWN DISCONNECTING SWITCH IS NOT GROUPED AND WITHIN LINE OF SITE OF MAIN SERVICE DISCONNECTING MEANS. [2017 NEC 705.10 AND 690.56(C)(1)(a)] [2020 NEC 705.10 AND 690.56(C)]

## **WARNING**

UTILITY

METER

3

PHOTOVOLTAIC SYSTEM **COMBINER PANEL** 

DO NOT ADD LOADS

MAIN

SERVICE PANEL

1

2

4

6

**SUBPANEL** 

(IE INTERCONNECTION

IS MADE HERE)

6

( 1

PERMANENT PLAQUE OR DIRECTORY TO BE LOCATED AT AC COMBINER PANEL. [2017 NEC 110.21(B)] [2020 NEC 110.21(B)]

## WARNING

THIS EQUIPMENT FED BY MULTIPLE SOURCES. TOTAL RATING OF ALL OVERCURRENT DEVICES, EXCLUDING MAIN SUPPLY OVERCURRENT DEVICE, SHALL NOT EXCEED AMPACITY OF BUSBAR.

#### LABEL 5

LABEL 4

APPLY TO THE PV COMBINER BOX [2017 NEC 705.12(B)(2)(3)(c)] [2020 NEC 705.12(B)(3)(3)]

## SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN

RAPID SHUTDOWN

SOLAR PV SYSTEM

SWITCH TO THE "OFF" POSITION TO SHUT DOWN PV SYSTEM



#### LABEL 6

BUILDINGS WITH PV SYSTEMS SHALL HAVE A PERMANENT LABEL LOCATED AT EACH SERVICE EQUIPMENT LOCATION TO WHICH THE PV SYSTEMS ARE CONNECTED OR AT AN APPROVED READILY VISIBLE LOCATION AND SHALL INDICATE THE LOCATION OF RAPID SHUTDOWN INITIATION DEVICES. [2017 NEC 690.56(C)(1)(a)] [2020 NEC 690.56(C)]

#### LABEL 7

SIGN LOCATED AT RAPID SHUT DOWN DISCONNECT SWITCH [2017 NEC 690.56(C)(3)]

[2020 NEC 690.56(C)(2)]

### **SWITCH FOR**

#### **LABELING NOTES**

1) LABELS CALLED OUT ACCORDING TO ALL COMMON CONFIGURATIONS. ELECTRICIAN TO DETERMINE EXACT REQUIREMENTS IN THE FIELD PER CURRENT NEC AND LOCAL CODES AND MAKE APPROPRIATE ADJUSTMENTS. 2) LABELING REQUIREMENTS BASED ON THE 2017 & 2020 NEC CODE, OSHA STANDARD 19010.145, ANSIZ535.

HANDWRITTEN [NEC 110.21]

3 2 3 7 5 8 IF BREAKER 9 11 4 9 OR PLACARD IS USED 8 ) or (10) OR PLACARD

**METER** 

(IF APPLICABLE)

AC

DISCONNECT

1

2

\*ELECTRICAL DIAGRAM SHOWN ABOVE IS FOR LABELING PURPOSES ONLY. NOT AN ACTUAL REPRESENTATION OF EQUIPMENT AND CONNECTIONS TO BE INSTALLED. LABEL LOCATIONS PRESENTED MAY VARY DEPENDING ON TYPE OF INTERCONNECTION METHOD AND LOCATION PRESENTED ON 3 LINE DIAGRAM. 3 LINE DIAGRAM ON PV5 TO REFLECT ACTUAL REPRESENTATION OF PROPOSED SCOPE OF WORK


**PV COMBINER** 

BOX

1

2

3) MATERIAL BASED ON THE REQUIREMENTS OF THE AHJ 4) LABELS TO BE OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED AND SHALL NOT BE

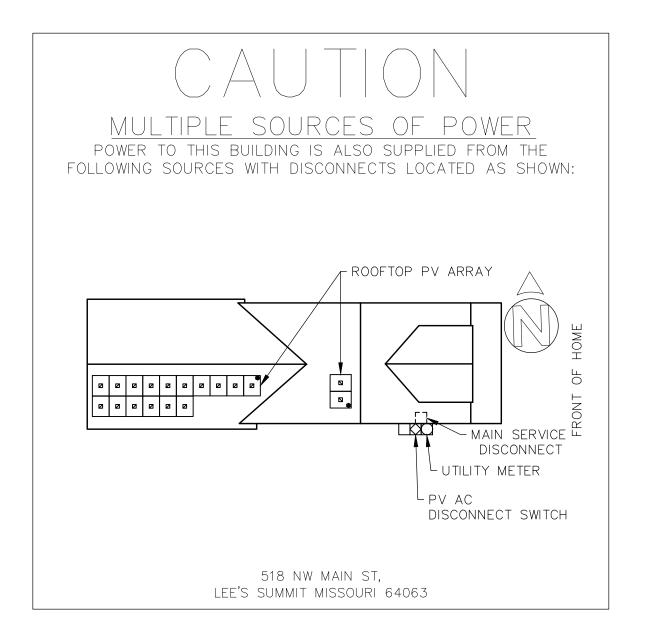

## **DIRECTORY PLACARD NOTES**

*[NEC 705.10]* A PERMANENT PLAQUE OR DIRECTORY DENOTING THE LOCATION OF ALL ELECTRIC POWER SOURCE DISCONNECTING MEANS ON OR IN THE PREMISES SHALL BE INSTALLED AT EACH SERVICE EQUIPMENT LOCATION AND AT THE LOCATION(S) OF THE SYSTEM DISCONNECT(S) FOR ALL ELECTRIC POWER PRODUCTION SOURCES CAPABLE OF BEING INTERCONNECTED. THE MARKING SHALL COMPLY WITH [110.21(B)].



#### 1403 N. Research Way Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC



#### PV INSTALLATION **PROFESSIONAL**

Scott Gurney #PV-011719-015866

CONTRACTOR: BRS FIELD OPS 800-377-4480

5.22 kW AC 7.2 kW DC CUSTOMER INFORMATION:
Dan Roberts
518 NW Main St
Lee's Summit Missouri 64063 5. SIZE: SIZE: SYSTEM SYSTEM

DRAWING BY:

Brendan Fillmore

ပပ

PLOT DATE:

August 4, 2023

PROJECT NUMBER:

793875

SHEET NAME:

## RELEASE FOR CONSTRUCTION

390

19.98

36.84

30.82

13.50

12.66

1723 mm (L)1 x 1133 mm (W)1 x 35 mm (D)2 /

White toughened safety glass, 3.2mm thickness

1200 mm (cable length can be customized), 4mm<sup>2</sup>

12x9 pieces monocrystalline solar cells series strings

67.83" (L)1 x 44.61" (W)1 x 1.38" (D)2

FBM390MFG-BB FBM395MFG-BB FBM400MFG-BB FBM405MFG-BB

20.49

37.20

31.17

13.68

12.84

Item

Mechanical Load

Series Fuse Rating

20.75

37.36

31.36

13.78

12.92

**Operating Conditions** 

Maximum System Voltage

**Operating Temperature** 

**Temperature Characteristics** 

Temperature Coefficient of Isc

Temperature Coefficient of Voc

Temperature Coefficient of Pmax

**Nominal Module Operating Temperature** 

\*Nominal module operating temperature (NMOT): Air mass AM 1.5,

irradiance 800W/m², temperature 20°C, windspeed 1 m/s. \*Reduction in efficiency from 1000W/m² to 200W/m² at 25°C: 3.5  $\pm$  2%.

20.23

37.03

31 00

13.59

12.75

Specification

-40 to 85 °C

Specification

0.048 % / °C -0.27 % / °C

-0.32 % / °C

45°C ± 2°C

5400 Pa

1000V

30 A



Orem, UT 84097

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE IN PART TO OTHERS OUTSIDE OF BLUE RAVEN SOLAR LLC



PV INSTALLATION **PROFESSIONAL** 


Scott Gurney #PV-011719-015866

CONTRACTOR:



1403 N. Research Way

800.377.4480 WWW.BLUERAVENSOLAR.COM





**BRS FIELD OPS** 385-498-6700



[V]

[A]

[A]

\*Standard Test Condition (STC): Cell Temperature 25 °C. Irradiance 1000 W/m<sup>2</sup>, AM 1.5 \*Values without tolerance are typical numbers. Measurement tolerance: ± 3%

Specification

21.7 kg / 47.84 lbs

IP> 68. 3 diodes

EVA (Ethylene-Viny-Acetate)

MC4 / MC4 Compatible

Package Configuration 31 pcs Per Pallet, 806 pcs per 40' HQ container

Black anodized aluminum profile

**Electrical Data** 

Module Efficiency

Maximum Rating Power (Pmax)

Open Circuit Voltage (Voc)

Maximum Power Voltage

Short Circuit Current (Isc)

Maximum Power Current

**Mechanical Data** 

Dimensions

Weight

Frame

Cable

Solar Cell

Front Glass

Junction Box

Connector Type

1 : With assembly tolerance of ± 2 mm [ ± 0.08 "]

: With assembly tolerance of ± 0.8 mm [ ± 0.03 "

**Engineering Drawing (mm)** 

Cell Encapsulation

Model - STC

## PEACH

FBM MFG-BB / 108 cells 390W - 405 W Mono-Crystalline PV Module

URE Peach module uses URE state-of -the art cell cutting technology, and advanced module manufacturing experiences.











UL 61730, CE-compliant Quality Controlled PV-TÜV SUD IEC 61215:2016, IEC 61730:2016

**Key Features** 



Positive power tolerance  $+0 \sim +5$  watt



Withstand heavy loading Front load 5400 Pa & rear load 2400 Pa

United Renewable Energy Co., Ltd.



Excellent low light performance 3.5% relative eff. Reduction at low  $(200W/m^2)$ 



100% EL inline inspection Better module reliability



Design for 1000 VDC Reduce the system BOS effectively



Fire resistance Class of reaction to Type 1/ Class C

### United Renewable Energy Co., Ltd.

1133±1

FRONT VIEW

A-A

Copyright © 2022 URE Corp. All rights reserved

#### Taipei Office

1092±1 BACK VIEW

B-Mounting Hole


9F, NO. 295, Sec. 2, Tiding Blvd.,

Tel: +886-2-2656-2000 Fax: +886-2-2656-0593 e-mail: sales@urecorp.com

No. 7, Li-Hsin 3rd Road, Hsinchu Science Park Hsinchu city 30078, Taiwan Tel: +886-3-578-0011

Fax: +886-3-578-1255

 ${\sf URECO\_US\_Peach\_FBM\_MFG-BB\_V1\_3.2\_35mm\_BS\_EN\_220602}$ 

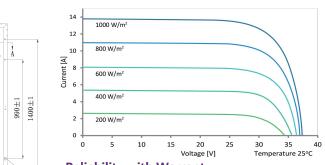

Dependence on Irradiance

## **Reliability with Warranty**



For more information, please visit us at www.urecorp.com

SHEET NAME:

SPEC SHEETS

U8/ZZ/ZUZ3

Copyright © 2022 URE Corp. All rights reserved







## IQ8 and IQ8+ Microinverters

Our newest IQ8 Microinverters are the industry's first microgrid-forming, software-defined microinverters with split-phase power conversion capability to convert DC power to AC power efficiently. The brain of the semiconductor-based microinverter is our proprietary application-specific integrated circuit (ASIC) which enables the microinverter to operate in grid-tied or off-grid modes. This chip is built in advanced 55nm technology with high speed digital logic and has super-fast response times to changing loads and grid events, alleviating constraints on battery sizing for home energy systems.



Part of the Enphase Energy System, IQ8 Series Microinverters integrate with the Enphase IQ Battery, Enphase IQ Gateway, and the Enphase App monitoring and analysis software.



Connect PV modules quickly and easily to IQ8 Series Microinverters using the included Q-DCC-2 adapter cable with plug-n-play MC4 connectors.



IQ8 Series Microinverters redefine reliability standards with more than one million cumulative hours of power-on testing, enabling an industryleading limited warranty of up to 25 years.



IQ8 Series Microinverters are UL Listed as PV Rapid Shut Down Equipment and conform with various regulations, when installed according to manufacturer's instructions.

© 2022 Enphase Energy, All rights reserved. Enphase, the Enphase logo, IQ8 Microinverters, and other names are trademarks of Enphase Energy, Inc. Data subject to change.

IQ8SP-DS-0002-01-EN-US-2022-03-17

#### Easy to install

- Lightweight and compact with plug-n-play connectors
- Power Line Communication (PLC) between components
- Faster installation with simple two-wire cabling

#### High productivity and reliability

- Produce power even when the grid is down\*
- More than one million cumulative hours of testing
- Class II double-insulated enclosure
- Optimized for the latest highpowered PV modules

#### Microgrid-forming

- Complies with the latest advanced grid support\*\*
- Remote automatic updates for the latest grid requirements
- Configurable to support a wide range of grid profiles
- Meets CA Rule 21 (UL 1741-SA) requirements
- \* Only when installed with IQ System Controller 2,
- \*\* IQ8 and IQ8Plus supports split phase, 240V installations only.

## IQ8 and IQ8+ Microinverters

INPUT DATA (DC)		108-60-2-US	IQ8PLUS-72-2-US	
Commonly used module pairings <sup>1</sup>	W	235 - 350	235 - 440	
Module compatibility		60-cell/120 half-cell	60-cell/120 half-cell, 66-cell/132 half-cell and 72-cell/144 half-cell	
MPPT voltage range	٧	27 - 37	29 - 45	
Operating range	V	25 - 48	25 - 58	
Min/max start voltage	V	30 / 48	30 / 58	
Max input DC voltage	V	50	60	
Max DC current <sup>2</sup> [module lsc]	Α	1	5	
Overvoltage class DC port		J	II	
DC port backfeed current	mA		0	
PV array configuration		1x1 Ungrounded array; No additional DC side protection requ	uired; AC side protection requires max 20A per branch circuit	
OUTPUT DATA (AC)		198-60-2-US	108PLUS-72-2-US	
Peak output power	VA	245	300	
Max continuous output power	VA	240	290	
Nominal (L-L) voltage/range <sup>3</sup>	٧	240 / 2	11 – 264	
Max continuous output current	Α	1.0	1.21	
Nominal frequency	Hz	6	0	
Extended frequency range	Hz	50	- 68	
AC short circuit fault current over 3 cycles	Arms	2	2	
Max units per 20 A (L-L) branch circuit		16	13	
Total harmonic distortion		<5	5%	
Overvoltage class AC port		ı	II	
AC port backfeed current	mA	3	0	
Power factor setting		1.	0	
Grid-tied power factor (adjustable)		0.85 leading	- 0.85 lagging	
Peak efficiency	%	97.5	97.6	
CEC weighted efficiency	%	97	97	
Night-time power consumption	mW	6	0	
MECHANICAL DATA				
Ambient temperature range		-40°C to +60°C	(-40°F to +140°F)	
Relative humidity range		4% to 100%	(condensing)	
DC Connector type		M	C4	
Dimensions (HxWxD)		212 mm (8.3") x 175 mm	n (6.9") x 30.2 mm (1.2")	
Weight		1.08 kg (	2.38 lbs)	
Cooling		Natural convection – no fans		
Approved for wet locations		Yes		
Pollution degree		PD3		
Enclosure		Class II double-insulated, corrosion resistant polymeric enclosure		
Environ. category / UV exposure rating		NEMA Type 6 / outdoor		
COMPLIANCE		,		
2		CA Rule 21 (UL 1741-SA), UL 62109-1, UL1741/IEEE1547, FCC Part	15 Class B, ICES-0003 Class B, CAN/CSA-C22.2 NO. 107.1-01	
Certifications		This product is UL Listed as PV Rapid Shut Down Equipment and conforms with NEC 2014, NEC 2017, and NEC 2020 section 690.12 and C22.1-2018 Rule 64-218 Rapid Shutdown of PV Systems, for AC and DC conductors, when installed according to manufacturer's instructions.		

(2) Maximum continuous input DC current is 10.6A (3) Nominal voltage range can be extended beyond nominal if required

by the utility. (4) Limits may vary. Refer to local requirements to define the number of microinverters per branch in your area.

BLUE RAVEN

1403 N. Research Way Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BILLE RAVEN SOLAR LIC



PV INSTALLATION PROFESSIONAL Scott Gurney

#PV-011719-015866

CONTRACTOR:
BRS FIELD OPS

385-498-6700

DRAWING BY:

PLOT DATE:

PROJECT NUMBER:

SHEET NAME:

IQ8SP-DS-0002-01-EN-US-2022-03-17

RELEASE FOR CONSTRUCTION

U8/ZZ/ZUZ

## **Enphase Q Cable Accessories**

The **Enphase Q Cable™** and accessories are part of the latest generation Enphase IQ System™. These accessories provide simplicity, reliability, and faster installation times.



#### Enphase Q Cable

- Two-wire, double-insulated Enphase Q Cable is 50% lighter than the previous generation Enphase cable
- New cable numbering and plug and play connectors speed up installation and simplify wire management
- · Link connectors eliminate cable waste

#### Field-Wireable Connectors

- Easily connect Q cables on the roof without complex wiring
- · Make connections from any open connector and center feed any section of cable within
- · Available in male and female connector types

## **Enphase Q Cable Accessories**

CONDUCTOR SPECIFICATIONS	
Certification	UL3003 (raw cable), UL 9703 (cable assemblies), DG cable
Flame test rating	FT4
Compliance	RoHS, OIL RES I, CE, UV Resistant, combined UL for Canada and United States
Conductor type	THHN/THWN-2 dry/wet
Disconnecting means	The AC and DC bulkhead connectors have been evaluated and approved by UL for use as the load-break disconnect required by NEC 690.

#### **Q CABLE TYPES / ORDERING OPTIONS**

Connectorized Models	Size / Max Nominal Voltage	Connector Spacing	PV Module Orientation	Connector Count per Box
Q-12-10-240	12 AWG / 277 VAC	1.3 m (4.2 ft)	Portrait	240
Q-12-17-240	12 AWG / 277 VAC	2.0 m (6.5 ft)	Landscape (60-cell)	240
Q-12-20-200	12 AWG / 277 VAC	2.3 m (7.5 ft)	Landscape (72-cell)	200

#### **ENPHASE Q CABLE ACCESSORIES**


Name	Model Number	Description
Raw Q Cable	Q-12-RAW-300	300 meters of 12 AWG cable with no connectors
Field-wireable connector (male)	Q-CONN-10M	Make connections from any open connector
Field-wireable connector (female)	Q-CONN-10F	Make connections from any Q Cable open connector
Cable Clip	Q-CLIP-100	Used to fasten cabling to the racking or to secure looped cabling
Disconnect tool	Q-DISC-10	Disconnect tool for Q Cable connectors, DC connectors, and AC module mount
Q Cable sealing caps (female)	Q-SEAL-10	One needed to cover each unused connector on the cabling
Terminator	Q-TERM-10	Terminator cap for unused cable ends
Enphase EN4 to MC4 adaptor <sup>1</sup>	ECA-EN4-S22	Connect PV module using MC4 connectors to IQ micros with EN4 (TE PV4-S SOLARLOK). 150mm/5.9" to MC4.
Enphase EN4 non-terminated adaptor <sup>1</sup>	ECA-EN4-FW	For field wiring of UL certified DC connectors. EN4 (TE PV4-S SOLARLOK) to non-terminated cable. 150mm/5.9"
Enphase EN4 to MC4 adaptor (long) <sup>1</sup>	ECA-EN4-S22-L	Longer adapter cable for EN4 (TE PV4-S SOLARLOK) to MC4. Use with split cell modules or PV modules with short DC cable. 600mm/23.6"
Replacement DC Adaptor (MC4)	Q-DCC-2	DC adaptor to MC4 (max voltage 100 VDC)
Replacement DC Adaptor (UTX)	Q-DCC-5	DC adaptor to UTX (max voltage 100 VDC)

1. Qualified per UL subject 9703.



To learn more about Enphase offerings, visit enphase.com









Data Sheet **Enphase Networking** 

## **IQ Combiner 4/4C**



X2-IQ-AM1-240-4 (IEEE 1547:2018)

The IQ Combiner 4/4C with IQ Gateway and integrated LTE-M1 cell modem (included only with IQ Combiner 4C) consolidates interconnection equipment into a single enclosure. It streamlines IQ Microinverters and storage installations by providing a consistent, pre-wired solution for residential applications. It offers up to four 2-pole input circuits and Eaton BR series busbar assembly.

#### Smart

- Includes IQ Gateway for communication and control
- Includes Mobile Connect cellular modem (CELLMODEM-M1-06-SP-05), included only with IQ Combiner 4C
- Includes solar shield to match Enphase IQ Battery aesthetics and deflect heat
- Supports Wi-Fi, Ethernet, or cellular connectivity
- Optional AC receptacle available for PLC bridge
- Provides production metering and consumption monitoring


#### Simple

- Mounts on single stud with centered brackets
- Supports bottom, back and side conduit entry
- Allows up to four 2-pole branch circuits for 240VAC plug-in breakers (not included)
- 80A total PV or storage branch circuits

#### Reliable

- Durable NRTL-certified NEMA type 3R enclosure
- · Five-year limited warranty
- Two years labor reimbursement program coverage included for both the IQ Combiner SKU's
- III liste
- X2-IQ-AM1-240-4 and X2-IQ-AM1-240-4C comply with IEEE 1547:2018 (UL 1741-SB, 3<sup>rd</sup> Ed.)







#### IO Combiner 4/4C

MODEL NUMBER	
IQ Combiner 4 X-IQ-AM1-240-4 X2-IQ-AM1-240-4 (IEEE 1547:2018)	IQ Combiner 4 with IQ Gateway printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 $\pm$ 0.5%) and consumption monitoring ( $\pm$ 2.5%). Includes a silver solar shield to match the IQ Battery and IQ System Controller 2 and to deflect heat.
IQ Combiner 4C X-IQ-AM1-240-4C X2-IQ-AM1-240-4C (IEEE 1547:2018)	IQ Combiner 4C with IQ Gateway printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 $\pm$ 0.5 and consumption monitoring ( $\pm$ 2.5%). Includes Mobile Connect cellular modem (CELLMODEM-M1-06-SP-05), a plug-and-play industrial-grade cell modem for systems up to 60 microinverters. (Available in the US, Canada, Mexico, Puerto Rico, and the US Virgin Islands, where there is a dequate cellular service in the installation area.) Includes a silver solar shield to match the IQ Battery and IQ System Controller and to deflect heat.
ACCESSORIES AND REPLACEMENT PARTS	(not included, order separately)
Supported microinverters	IQ6, IQ7, and IQ8. (Do not mix IQ6/7 Microinverters with IQ8)
Communications Kit COMMS-CELLMODEM-M1-06 CELLMODEM-M1-06-SP-05 CELLMODEM-M1-06-AT-05 Circuit Breakers BRK-10A-2-240V BRK-15A-2-240V BRK-20A-2P-240V BRK-5A-2P-240V BRK-20A-2P-240V-B BRK-20A-2P-240V-B	- Includes COMMS-KIT-01 and CELLMODEM-M1-06-SP-05 with 5-year Sprint data plan - 4G based LTE-M1 cellular modem with 5-year Sprint data plan - 4G based LTE-M1 cellular modem with 5-year AT&T data plan  Supports Eaton BR210, BR215, BR220, BR230, BR240, BR250, and BR260 circuit breakers.  Circuit breaker, 2 pole, 10A, Eaton BR210  Circuit breaker, 2 pole, 15A, Eaton BR215  Circuit breaker, 2 pole, 20A, Eaton BR220  Circuit breaker, 2 pole, 15A, Eaton BR215 with hold down kit support  Circuit breaker, 2 pole, 20A, Eaton BR220B with hold down kit support
XA-SOLARSHIELD-ES	Replacement solar shield for IQ Combiner 4/4C
XA-PLUG-120-3	Accessory receptacle for Power Line Carrier in IQ Combiner 4/4C (required for EPLC-01)
X-IQ-NA-HD-125A	Hold-down kit for Eaton circuit breaker with screws
Consumption monitoring CT (CT-200-SPLIT/CT-200-CLAMP)	A pair of 200A split core current transformers
ELECTRICAL SPECIFICATIONS	
Rating	Continuous duty
System voltage	120/240VAC, 60 Hz
Eaton BR series busbar rating	125A
Max. continuous current rating	65A
Max. continuous current rating (input from PV/storage)	64A
Max. fuse/circuit rating (output)  Branch circuits (solar and/or storage)	90A Up to four 2-pole Eaton BR series Distributed Generation (DG) breakers only (not included)
Max. total branch circuit breaker rating (input)	80A of distributed generation/95A with IQ Gateway breaker included
IQ Gateway breaker	10A or 15A rating GE/Siemens/Eaton included
Production metering CT	200A solid core pre-installed and wired to IQ Gateway
MECHANICAL DATA	
Dimensions (WxHxD)	37.5 cm x 49.5 cm x 16.8 cm (14.75 in x 19.5 in x 6.63 in). Height is 53.5 cm (21.06 in) with mounting brackets.
Weight	7.5 kg (16.5 lbs)
Ambient temperature range	-40°C to +46°C (-40°F to 115°F)
Cooling	Natural convection, plus heat shield
Enclosure environmental rating	Outdoor, NRTL-certified, NEMA type 3R, polycarbonate construction
Wire sizes	20A to 50A breaker inputs: 14 to 4 AWG copper conductors 60A breaker branch input: 4 to 1/0 AWG copper conductors Main lug combined output: 10 to 2/0 AWG copper conductors Neutral and ground: 14 to 1/0 copper conductors Always follow local code requirements for conductor sizing.
Altitude	Up to 3,000 meters (9,842 feet)
INTERNET CONNECTION OPTIONS Integrated Wi-Fi	IEEE 802.11b/g/n
Cellular	CELLMODEM-M1-06-SP-05, CELLMODEM-M1-06-AT-05 (4G based LTE-M1 cellular modem). Note that an Mobile Connect
Ethernet	cellular modem is required for all Enphase Energy System installations.  Optional, IEEE 802.3, Cat5E (or Cat6) UTP Ethernet cable (not included)
COMPLIANCE	, , , , , , , , , , , , , , , , , , , ,
Compliance, IQ Combiner	CA Rule 21 (UL 1741-SA) IEEE 1547:2018 - UL 1741-SB, 3 <sup>rd</sup> Ed. (X2-IQ-AM1-240-4 and X2-IQ-AM1-240-4C) CAN/CSA C22.2 No. 107.1, Title 47 CFR, Part 15, Class B, ICES 003 Production metering: ANSI C12.20 accuracy class 0.5 (PV production) Consumption metering: accuracy class 2.5
Compliance, IQ Gateway	UL 60601-1/CANCSA 22.2 No. 61010-1

© 2022 Enphase Energy. All rights reserved. Enphase, the Enphase logo, IQ Combiner 4/4C, and other names are trademarks of

Enphase Energy, Inc. Data subject to change.

IQ-C-4-4C-DS-0103-EN-US-12-29-2022



1403 N. Research Way Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT, WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



PV INSTALLATION PROFESSIONAL

Scott Gurney #PV-011719-015866


CONTRACTOR: BRS FIELD OPS 385-498-6700


SHEET NAME:


SPEC SHEETS
RELEASE FOR CONSTRUCTION

EVISIONS NOTED PARCE NUMBER
DEVELOPMENT SERVICES
OLEE'S SUMMIT, MISS SURI

<del>08/22/2023</del>

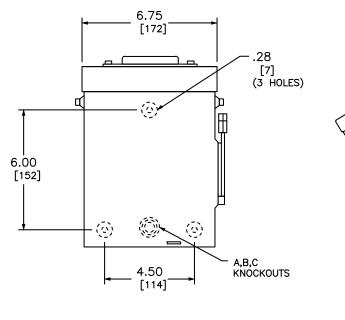





FINISH - GRAY BAKED ENAMEL ELECTRODEPOSITIED OVER CLEANED PHOSPHATIZED STEEL.

FINISH — GRAY BAKED ENAMEL ELECTRODEPOSITIED OVER CLEANED PHOSPHATIZED STEEL.

UL LISTED — FILE E—2875

ALL NEUTRALS — INSULATED GROUNDABLE

SUITABLE FOR USE AS SERVICE EQUIPMENT

TOP OF NEMA TYPE 3R SWITCHES HAVE PROVISIONS FOR MAXIMUM 2 1/2" BOLT—ON HUB.

10,000 AMPERES WHEN USED WITH OR PROTECTED BY CLASS H OR K FUSES.

NEMA TYPE 3R ILLUSTRATED

WIRING DIAGRAMS				
FUSIBLE	NOT FUSIBLE			
A	C			

TERMINAL LUGS ‡					
AMPERES	MAX. W	IRE MIN.	WIRE	TYPE	
30	# 6 A	WG # 12	AWG	AL	
	# 6 A	WG # 14	AWG	C	

KNOCKOUTS					
SYMBOL	Α	В	С	D	
CONDUIT SIZE	.50	.75	1	1.25	

DUAL DIMENSIONS: INCHES MILLIMETERS

				но	RSEPOW	R RATIN	GS	
CATALOG	VOTAGE	WIRING	120	VAC		240	VAC	·
NUMBER	RATINGS	DIAG.	STD.	MAX.	ST	D.	MA	۸X.
			1 Ø	1Ø	1Ø	3Ø	1Ø	3Ø
D211NRB●■	240VAC	Α	1/2	2	1 1/2	-	3	-
D221NRB	240VAC	Α	_	_	1 1/2	3*	3	7 1/2*
D321NRB	240VAC	В	_	_	1 1/2	3	3	7 1/2
DU221RB	240VAC	С	_	_	-	_	3	-
DU321RB	240VAC	D	_	_	_	-	3	7 1/2

GENERAL DUTY SAFETY SWITCHES VISIBLE BLADE TYPE 30 AMPERE ENCLOSURE - NEMA TYPE 3R RAINPROOF

SQUARE D by Schneider Electric

DWG# 1852

‡ LUGS SUITABLE FOR 60°C OR 75° CONDUCTORS.

\* FOR CORNER GROUNDED DELTA SYSTEMS.

100,000 AMPERES WITH CLASS R FUSES.

SHORT CIRCUIT CURRENT RATINGS:

• 10,000 AMPERES.

FEBRUARY 2014 REF DWG #1852 **BLUE RAVEN** 

1403 N. Research Way Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT WITHOUT THE WRITTEN PERMISSION
OF BLUE RAVEN SOLAR LLC.



PV INSTALLATION PROFESSIONAL

Scott Gurney #PV-011719-015866

CONTRACTOR: **BRS FIELD OPS** 385-498-6700

DRAWING BY:

PLOT DATE:

PROJECT NUMBER:

SHEET NAME:

RELEASE FOR CONSTRUCTION

A. System Specifications and Ratings

Maximum Voltage: 1,000 Volts

Allowable Wire: 14 AWG - 6 AWG

Maximum Current: 80 Amps

Enclosure Rating: Type 3R Roof Slope Range: 2.5 – 12:12

Max Side Wall Fitting Size: 1'

- JB-1.2: UL1741

ABB ZS6 terminal block

ABB ZS10 terminal block

ABB ZS16 terminal bock

ABB M6/8 terminal block

Connector

Wire Connector Ideal, In-Sure Push-In

Connector Part #39

WAGO, 2204-1201

WAGO, 221-612

Dottie DRC75

ESP NG-53

ESP NG-717

Brumall 4-5.3

Ideal 452 Red WING-NUT Wire

Ideal 451 Yellow WING-NUT

Compliance:

Max Floor Pass-Through Fitting Size: 1"

Ambient Operating Conditions: (-35°C) - (+75°C)

System Marking: Interek Symbol and File #5019942

NEMA 3R

1.45 LBS



1403 N. Research Way Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OF IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT



WITHOUT THE WRITTEN PERMISSION

OF BLUE RAVEN SOLAR LLC.


PV INSTALLATION **PROFESSIONAL** 

Scott Gurney #PV-011719-015866

CONTRACTOR: **BRS FIELD OPS** 385-498-6700

ITEM NO. PART NUMBER DESCRIPTION QTY POLYCARBONATE JB-1.2 BODY WITH UV INHIBITORS POLYCARBONATE **JB-1.2 LID** WITH UV INHIBITORS #10 X 1-1/4" PHILLIPS 6 PAN HEAD SCREW #8 X 3/4" PHILLIPS 4 6 PAN HEAD SCREW

[279.68mm] [276.30mm] 11.01in 10.88in	SOLAR JB-1.2
	[183.06mm]

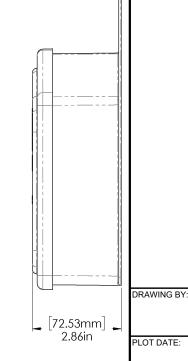

	SIZE	DWG. NO.			REV
	B	JE	3-1.2		
	SCALE: 1:2	WEIGHT	: 1.45 LBS	SHEE	T 1 0F 3
	TORQUE SPE	CIFICATION:	15	5-20 L	.BS
	OFDITIFIO	A TION.	UL STAN	NDAR[	1741,

CERTIFICATION:

WEIGHT:

## Periodic Re-inspections: If re-inspections yield loose components, loose fasteners, or any corrosion between components, components that are found to be affected are to be replaced immediately. Inch Lbs | Voltage | Current 600V 30 amp 600V 40 amp 8.85-14.16 14.6-21.24 600V 60 amp 600V 50 amp 600V 600V 600V 600V 30 amp 600V 30 amp

2000V

2000V

2000V

Torque

6.2-8.85

8.85

**Self Torque** 

**Self Torque** 

Self Torque

Self Torque

Snap-In

45

35

45

35

45

NM

0.5-0.7

1.0-1.6

1.6-2.4

.08-1

**Self Torque** 

**Self Torque** 

Self Torque

Self Torque

Snap-In

Self Torque | Self Torque

PV Junction Box for Composition/Asphalt Shingle Roofs

Table 2: Minimum	wire-bending space	for conductors the	rough a wall opposite	terminals in mm (	inches)
Table 2. William	Wife-belluing space	TOI COMMUCTORS THE	ough a wan opposite	terriniais in mini	iiiciic3)

Spacing: Please maintain a spacing of at least ½" between uninsulated live parts and fittings for

Table 1: Typical Wire Size, Torque Loads and Ratings

16-24 awg

12-20 awg

10-20 awg

16-24 awg

10-24 awg

Type

Sol/Str

conduit, armored cable, and uninsulated live parts of opposite polarity.

- Approved wire connectors: must conform to UL1741

10-24 awg

6-24 awg

4-24 awg

8-22 awg

8-18 awg

10-18 awg

10-14 awg

10-20 awg

10-20 awg

6-12 awg

4-6 awg

10-14 awg

4-6 awg


10-14 awg

4-6 awg

10-14 awg

1 Conductor 2 Conductor

Wire size	, AWG or		Wires per terminal (pole)						
		1		2		3		4 or More	
kcmil	(mm2)	mm	(inch)	mm	(inch)	mm	(inch)	mm	(inch)
14-10	(2.1-5.3)	Not sp	ecified		-		-		
8	(8.4)	38.1	(1-1/2)		-		-		-
6	(13.3)	50.8	(2)		-		-		-

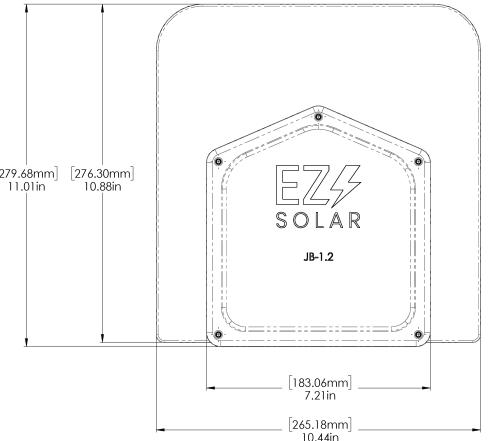

PLOT DATE:

PROJECT NUMBER:

SHEET NAME:

SPECSHEEL

UB/ZZ/ZUZ3

## **Rigid Nonmetallic Conduit – Junction Boxes**

## Molded Nonmetallic Junction Boxes 6P Rated







It's another first from Carlon® - the first nonmetallic junction boxes UL Listed with a NEMA 6P rating per Section 314.29, Exception of the National Electrical Code. Manufactured from PVC or PPO thermoplastic molding compound and featuring foam-in-place gasketed lids attached with stainless steel screws, these rugged enclosures offer all the corrosion resistance and physical properties you need for direct burial applications.

Type 6P enclosures are intended for indoor or outdoor use, primarily to provide a degree of protection against contact with enclosed equipment, falling dirt, hose-directed water, entry of water during prolonged submersion at a limited depth, and external ice formation.








- All Carlon Junction Boxes are UL Listed and maintain a minimum of a NEMA Type 4/4x Rating.
- Parts numbers with an asterisk (\*) are UL Listed and maintain a NEMA Type 6P Rating and Type 4/4X Rating.

	Size in	Std.	I	1	I	I	I	l	Mat	erial	Std.
Part No.	Inches H x W x D	Ctn. Qty.	Min At	Min. AB	Min. B	Min. C	Та Тур	Tc pical	PVC	Thermo- plastic	Ctn. Wt. (Lbs.)
E989NNJ-CAR*	4 x 4 x 2	5	311/16	35/8	N/A	2	.160	.155	Х		3
E987N-CAR*	4 x 4 x 4	5	311/16	31/2	N/A	4	.160	.155	Х		4
+E989NNR-CAR*	4 x 4 x 6	4	311/16	33/8	N/A	6	.160	.200	Х		5
E989PPJ-CAR*	5 x 5 x 2	4	411/16	41/2	N/A	2	.110	.150		Х	3
E987R-CAR*	6 x 6 x 4	2	6	55/8	N/A	4	.190	.190		Х	3
E989RRR-UPC*	6 x 6 x 6	8	55/8	53/8	N/A	6	.160	.150		Х	14
E989N-CAR	8 x 8 x 4	1	8	8	N/A	4	.185	.190		Х	2
E989SSX-UPC	8 x 8 x 7	2	721/32	7 <sup>5</sup> /16	N/A	7	.160	.150		Х	6
E989UUN	12 x 12 x 4	3	115/8	111/2	111/8	4	.160	.150		Х	12
E989R-UPC	12 x 12 x 6	2	11 <sup>15</sup> /16	11 <sup>7</sup> /8	11 <sup>7</sup> /16	6	.265	.185		Х	10

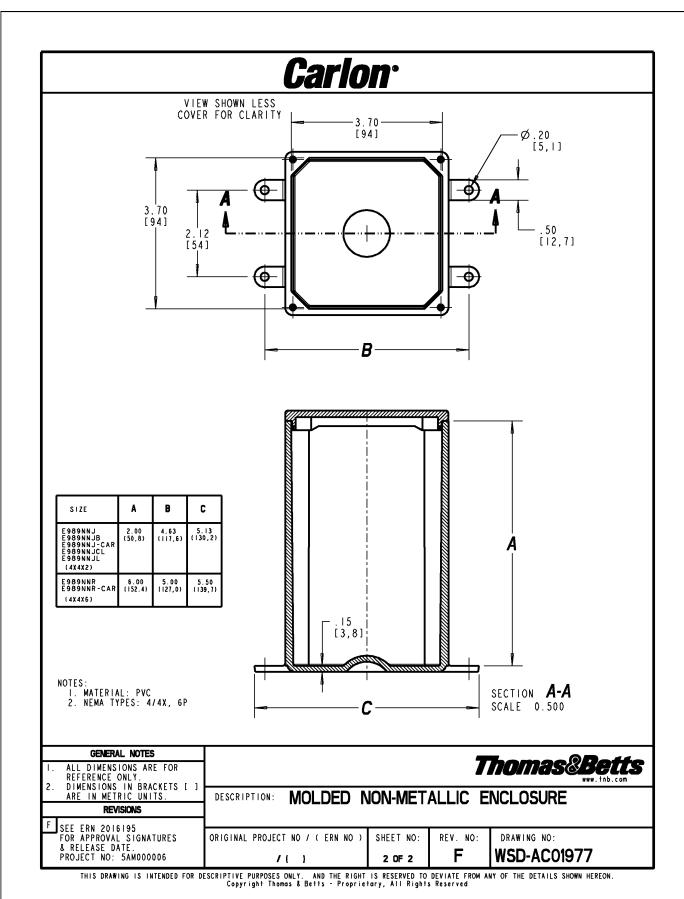

BLUE RAVEN

1403 N. Research Way Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



PV INSTALLATION PROFESSIONAL

Scott Gurney #PV-011719-015866

CONTRACTOR: BRS FIELD OPS 385-498-6700

DRAWING BY:

PLOT DATE:

PROJECT NUMBER:

SHEET NAME:

SPEC SHEET

REVISIONS NOTED HORGENVINGERW
DEVELOPMENT SERVICES
---LEE'S SUMMIT, MISSOURI

# NXT HORIZON®

# **::**\*UNIRAC

## 1403 N. Research Way Orem. UT 84097 800.377.4480 WWW BLUERAVENSOLAR COM CONFIDENTIAL- THE INFORMATION

## DISCOVER YOUR **NXT** HORIZON<sup>®</sup>

The culmination of over two decades of experience. Thoughtful design, rigorous engineering, world-class support, and a reliable supply chain are the foundation of what makes us confident that NXT HORIZON is the NXT Level of DESIGN, SIMPLICITY, and VALUE.

DARK: SHCLMPD1

MILL: SHCLMPM1

STRONGHOLD™ RAIL CLAMP

Adaptable rail connection to attachments

allows click-in feature compatibility with


almost all of Unirac's attachments.



#### NXT HORIZON COMBO CLAMP

DARK: CCLAMPD1 MILL: CCLAMPM1

Clicks into rail anywhere (even where there are cables!) Self-standing clamp with spring combines as both mid and end cla Clamps 30-40 mm modules






#### NXT HORIZON CAP KIT

ENDCAPD1

Make the install look clean with the end cap kit designed to complement the module end clamp and rail ends.



features: click-in rail & open slot L-Foot for

#### STRONGHOLD™ ATTACHMENT KIT DARK: SHCPKTD MILL: SHCPKTM1

Rail clicks into the clamps attached to the Stronghold™ base. Open slot in L-foot allows drop-in rail clamp

Alternative attachment options




#### NXT HORIZON RAIL

DARK: 168RLD1 MILL: 168RLM1

Strong, lightweight open channe rail with invisible, easy, unfailing and integrated wire manage

NXT HORIZON RAIL SPLICE

Structural internal splice that does not interfere with roof connection nor module connection. Pre-assembled thread cutting bol



#### WIRE MANAGEMENT OPTONS



NXT HORIZON MLPE & LUG CLAMP

LUGMLPE1

Works as either MLPE Mount or Grounding Lug connection to the rail. Why source two parts when one can do the job?



NXT HORIZON WIRE MANAGEMENT CLIP

WRMCLPD1

Aesthetic, yet functional accessory that works to help installers keep wires inside the rail. No zip-ties required. Optional zip tie loop for extra wire management capabilities!



NXT HORIZON NORTH/SOUTH WIRE

An elegant solution to help installers get to the home run. The same hardware works to provide both easy entry to rail and adjustability for cable



HEREIN CONTAINED SHALL NOT BE

USED FOR THE BENEFIT OF ANYONE

EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OF IN PART TO OTHERS OUTSIDE

RECIPIENTS ORGANIZATION, EXCEPT

IN CONNECTION WITH THE SALE AND

USE OF THE RESPECTIVE EQUIPMENT

WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC

NABCEP

CONTRACTOR: **BRS FIELD OPS** 385-498-6700

DRAWING BY:

PLOT DATE:

PROJECT NUMBER


SHEET NAME:

08/22/2023

ALL NXT HORIZON° SYSTEMS INCLUDE A FREE PERMITTING PLANSET DESIGN - FOR QUESTIONS OR CUSTOMER SERVICE VISIT UNIRAC.COM OR EMAIL NXTPERMITS@UNIRAC.COM






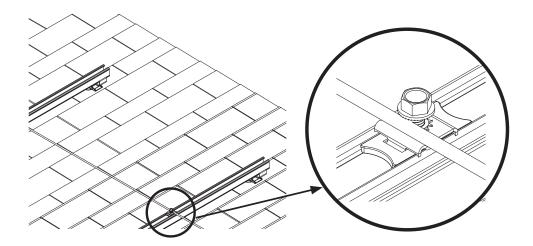

**SYSTEM GROUNDING:** Rails can be bonded using an NXT Horizon MLPE & Lug Clamp, GROUND WEEBLUG #1 or ILSCO LAY IN LUG (GBL4DBT). At least one rail per row of modules in an array must be bonded to electrical ground. Each additional row of modules must be grounded with at least one rail lug per row or with a row-to-row bonding devise listed here.

Note: See Page F for additional lugs required for expansion joints.

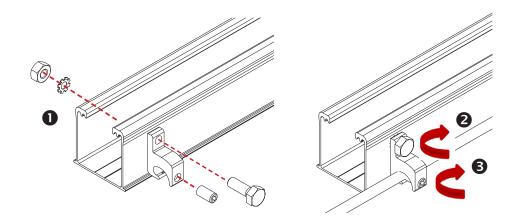


ALTERNATE SYSTEM GROUNDING WITH ILSCO LAY-IN LUG - UNIRAC P/N 008009P: Alternate Grounding Lug. Drill hole in rail 7/32" in diameter, deburr hole and bolt thru one wall of rail.

**BOLT TORQUE VALUE: 5 ft lbs.** 

TERMINAL TORQUE: 4-6 AWG: 35in-lbs, 8 AWG: 25 in-lbs.


WARNING: ISOLATE COPPER FROM ALUMINUM CONTACT TO PREVENT CORROSION

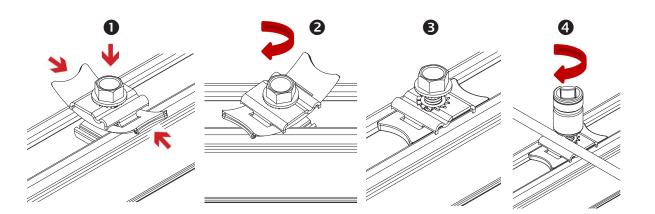

**SYSTEM GROUNDING WITH MLPE & LUG CLAMP:** Insert the rail nut profile in the opening by lifting the flaps of the plastic clip. Rotate the clamp 90 deg and release the flaps to get flush with rail. Ensure that the rail nut is engaged in the rail profile. Align the ground wire in the depression of the washer. Tighten bolt.

TORQUE VALUE: 6-8 AWG: 12 ft lbs.

CAUTION: MLPE & Lug Clamp cannot be used to simultaneously mount a MLPE and ground wire.

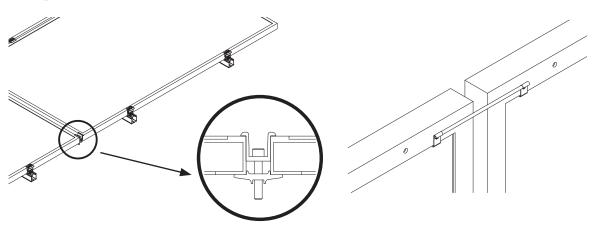

## ALTERNATE ROW GROUNDING WITH NXT HORIZON ROW BONDING CLAMP:

Insert clamp between module rows and tighten bolt.

**TORQUE VALUE: 20 ft-lbs** 

## ALTERNATE ROW GROUNDING WITH N/S BONDING CLIP:

Fully seat bonding clip on each module flange to provide bond across N/S module gap.



1403 N. Research Way Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

HEREIN CONTAINED SHALL NOT BE
USED FOR THE BENEFIT OF ANYONE
EXCEPT BLUE RAVEN SOLAR NOR
SHALL IT BE DISCLOSED IN WHOLE OR
IN PART TO OTHERS OUTSIDE
RECIPIENTS ORGANIZATION, EXCEPT
IN CONNECTION WITH THE SALE AND
USE OF THE RESPECTIVE EQUIPMENT.
WITHOUT THE WRITTEN PERMISSION
OF BLUE RAVEN SOLAR LLC.



PV INSTALLATION PROFESSIONAL

Scott Gurney #PV-011719-015866

CONTRACTOR: BRS FIELD OPS 385-498-6700

DRAWING BY:

PLOT DATE:


PROJECT NUMBER

SHEET NAM

RELEASE FOR CONSTRUCT

REVISIONS NOTED 中角层性机场形容积 DEVELOP MENT SERVICES ——土屋:S SUMMIT, MSSOORI









#### **BONDING RAIL SPLICE**

- Bonding Hardware creates bond between Splice
- Aluminum splice bar spans across rail gap to create rail to rail bond. Rail on at least one side of splice will be grounded.

**NOTE:** See page I for installation details Splice certified for single-use only

# **MODULE FRAME**

bar and each rail section

## **BONDING BETWEEN THERMAL BREAKS**

- Lug is connected at the end of each thermal break to the rail
- Solid copper wire is connected across the gap to bond the two ends

NOTE: See page D for installation details

NOTE: See page M for installation details

**BONDING COMBO MID-END CLAMP ASSEMBLY** 


1 Aluminum combo mid-end clamp cap with stainless steel bonding pins that pierce

Aluminum combo mid-end clamp rail nut with stainless steel bonding pins that

module frame anodization to bond module to module through clamp

2 Stainless steel bolt bonds aluminum clamp to stainless steel Hex bolt


pierce rail anodization to bond module to module through clamp

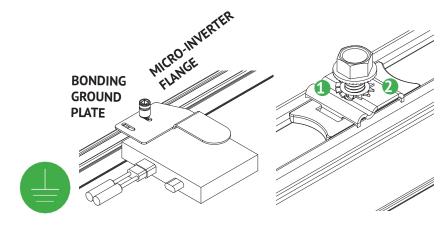

#### **BONDING MICROINVERTER MOUNT**

- Stainless steel Tooth lock washer beneath the MLPE flange remove anodization on the mlpe and bonds.
- Tabs on the stainless-steel washer remove anodization on the rail and bonds.


**NOTE:** See page K for installation details



#### **RACK SYSTEM GROUND**

- Tabs on the stainless-steel washer pierce anodization on the rail to bond rail to ground wire.
- Solid copper wire connected to lug is routed to provide final system ground connection.

NOTE: See page J for installation details and alternate racking system grounding methods.

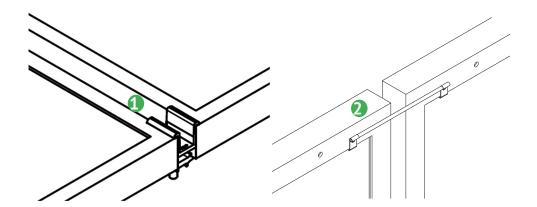

#### **ALTERNATE ROW-TO-ROW BONDING PATHS**

- Row-to-row module bonding is accomplished with bonding clamp with 2 integral bonding pins.
- Alternate method by connecting clips on either module to complete the bonding path.

**NOTE:** See page J for installation details Row-to-row module bonding certified for single-use only



1403 N. Research Way Orem. UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYON EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE O IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEP USE OF THE RESPECTIVE EQUIPMENT WITHOUT THE WRITTEN PERMISSIO OF BLUE RAVEN SOLAR LLC.



PV INSTALLATION **PROFESSIONAL** 

Scott Gurney #PV-011719-015866

CONTRACTOR: **BRS FIELD OPS** 385-498-6700

DRAWING BY:

PLOT DATE:


PROJECT NUMBER:

SHEET NAME:

SPECSHEET

**U8/22/202** 

# HORIZON® APPENDIX PAGE PAGE

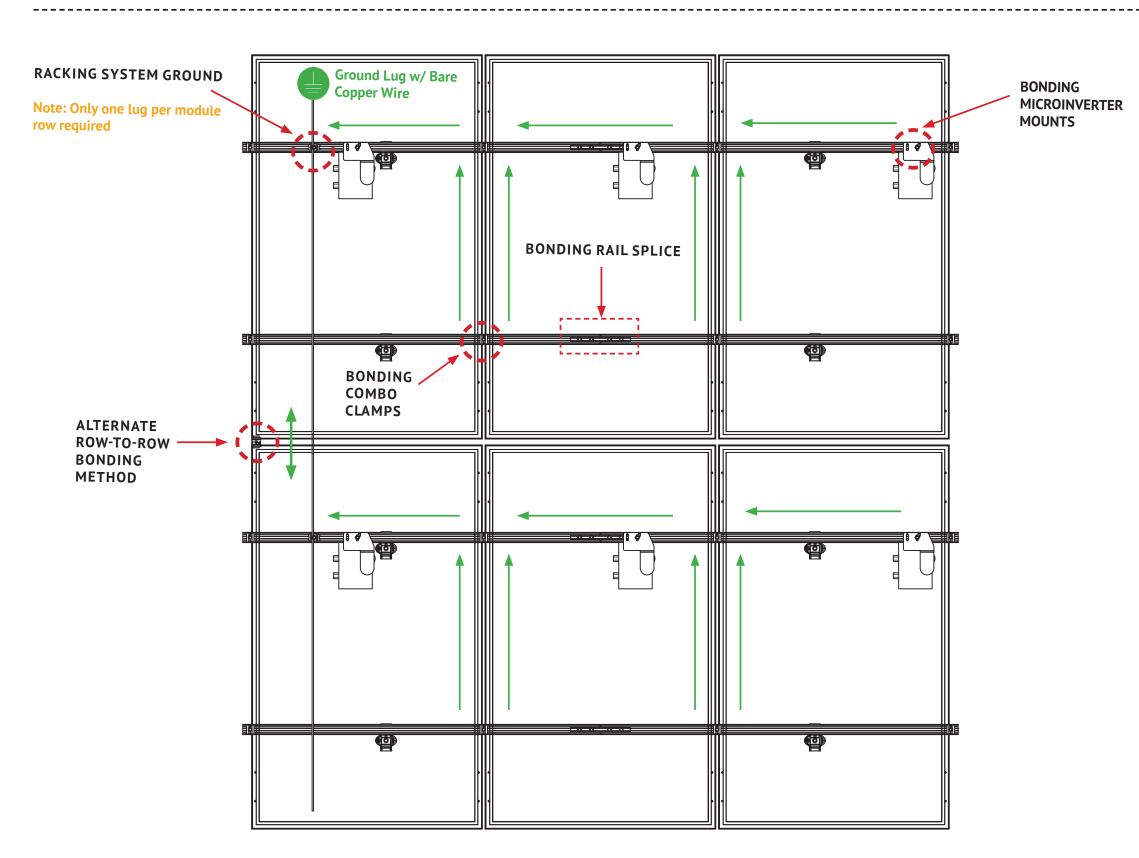



1403 N. Research Way Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



PV INSTALLATION PROFESSIONAL

Scott Gurney #PV-011719-015866

CONTRACTOR: BRS FIELD OPS 385-498-6700

DRAWING BY:

PLOT DATE:

PROJECT NUMBER:

SHEET NAME:

RELEASE FOR CONSTRUCTION

REVISION S NOTED H PROEMNIMBER DEVELOPMENT SERVICES ——七座:S SUMMIT, MISSOURI





The NXT Horizon system has been certified and listed to the UL 2703 standard (Rack Mounting Systems and Clamping Devices for Flat-Plate Photovoltaic Modules and Panels). This standard included electrical grounding, electrical bonding, mechanical load and fire resistance testing.

#### SYSTEM LEVEL FIRE CLASSIFICATION

The system fire class rating requires installation in the manner specified in the NXT HORIZON Installation Guide. NXT HORIZON has been classified to the system level fire portion of UL 2703. NXT HORIZON has achieved system level performance for steep sloped roofs. System level fire performance is inherent in the NXT HORIZON design, and no additional mitigation measures are required. The fire classification rating is only valid on roof pitches greater than 2:12 (slopes ≥ 2 inches per foot, or 9.5 degrees). The system is to be mounted over fire resistant roof covering rated for the application. There is no required minimum or maximum height limitation above the roof deck to maintain the system fire rating for NXT HORIZON. Approved Module Types & System Level Fire Ratings are listed below:

Module Type	System Level Fire Rating	Rail Direction	Module Orientation
Type 1, 2, 3 with metal frame, 10 with metal frame, 19, 22, 25, 29, & 30	Class A, Class B & Class C	Parallel OR Perpendicular to Ridge	Landscape OR Portrait

#### MECHANICAL LOAD TEST MODULES

The modules selected for UL 2703 mechanical load testing were selected to represent the broadest range possible for modules on the market. The tests performed covers module frame thicknesses greater than or equal to 1.0 mm, single and double wall frame profiles (some complex frame profiles could require further analysis to determine applicability), and clear and dark anodized aluminum frames. PV modules may have a reduced load rating, independent of the NXT Horizon rating. Please consult the PV module manufacturer's installation guide for more information.

Tested Module	UL2703 Certification Load Ratings	Tested Loads	Tested Module Area
SunPower SPR-A440 -COM	Down: 113 psf, Up: 50 psf , Slope: 15 psf	Down: 170 psf, Up: 75 psf , Slope: 23 psf	21.86 sq ft
Jinko JKM-xxxM 72HL4-V	Down: 50.12 psf, Up: 22.28 psf, Slope: 8 psf	Down: 75.19 psf, Up: 33.42 psf, Slope: 12 psf	27.76 sq ft

#### **UL2703 CERTIFICATION MARKING:**

Unirac NXT HORIZON is listed to UL 2703. Certification marking is embossed on all Combo Clamps as shown. Labels with additional certification information are provided with clamps and must be applied to the NXT Horizon Rail at the edge of the array.

Note: This racking system may be used to ground and/or mount a PV module complying with UL1703/UL61730 only when the specific module has been evaluated for grounding and/or mounting in compliance with the included instructions.







1403 N. Research Way Orem, UT 84097

800.377.4480 WWW BLUFRAVENSOLAR COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OR IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



PV INSTALLATION PROFESSIONAL

Scott Gurney #PV-011719-015866

CONTRACTOR: BRS FIELD OPS 385-498-6700

DRAWING BY:

PLOT DATE:

PROJECT NUMBER:

SHEET NAM

RELEASE FOR CONSTRUC

REVISIO的S NOTED 特别法性机划的智能 DEVELOPMENT SERVICE: —— 电唇'S SUMMIT, NOS





### **Electrical Bonding and Grounding Test Modules**

The list below is not exhaustive of compliant modules but shows those that have been evaluated and found to be electrically compatible with the NXT Horizon system.

Manufacture	Module Model / Series
Aionrise	AION60G1, AION72G1
Aleo	P-Series & S-Series
Aptos Solar	DNA-120-MF10 DNA-120-(MF/BF)23 DNA-144-(MF/BF)23 DNA-120-(MF/BF)26 DNA-144-(MF/BF)26
Astronergy	CHSM6612 M, M/HV CHSM6612P Series CHSM6612P/HV Series CHSM72M-HC CHSM72M(DG)/F-BH
Auxin	AXN6M610T AXN6P610T AXN6M612T AXN6P612T
Axitec	AC-xxx(M/P)/60S, AC-xxx(M/P)/72S AC-xxxP/156-60S AC-xxxMH/120(S/V/SB/VB) AC-xxxMH/144(S/V/SB/VB)
Boviet	BVM6610, BVM6612
BYD	P6K & MHK-36 Series
Canadian Solar	CS1(H/K/U/Y)-MS CS3K-(MB/MB-AG/MS/P/P HE/PB-AG) CS3L-(MS/P) CS3N-MS CS3U-(MB/MB-AG/MS/P/P HE/PB/PB-AG) CS3W-(MB-AG/MS/P/P-PB-AG) CS3Y-MB-AG CS5A-M CS6K-(M/MS/MS AllBlack/P/P HE)

Manufacture	Module Model / Series
Canadian Solar (cont.)	CS6P-(M/P) CS6R-MS CS6U-(M/P/P HE) CS6W-(MB-AG/MS) CS6X-P, CSX-P CS7L-MB-AG ELPS CS6(A/P)-MM
Centrosolar America	C-Series & E-Series
CertainTeed	CT2xxMxx-01, CT2xxPxx-01, CTxxxMxx-01 CTxxxPxx-01, CTxxxMxx-02, CTxxxMxx-03 CTxxxMxx-04, CTxxxHC11-04
Eco Solargy	Orion 1000 & Apollo 1000
ET Solar	ET AC Module, ET Module ET-M772BH520-550WW/WB
First Solar	FS-6XXX(A) FS-6XXX(A)-P, FS-6XXX(A)-P-I
Flextronics	FXS-xxxBB
FreeVolt	PVGraf
GCL	GCL-P6 & GCL-M6 Series
Hanwha SolarOne	HSL 60
Hansol	TD-AN3, TD-AN4 UB-AN1, UD-AN1
Heliene	36M, 36P 60M, 60P, 72M & 72P Series 144HC M6
H-SAAE	HT60-156M-C HT60-156M(V)-C HT72-156(M/P) HT72-156P-C, HT72-156P(V)-C HT72-156M(PDV)-BF, HT72-156M(PD)-BF HT72-166M, HT72-18X

Manufacture	Module Model / Series
Hyundai	KG, MG, RW, TG, RI, RG, TI, KI, HI Series HiA-SxxxHG, HiD-SxxxRG(BK), HiS-S400PI
ITEK	iT-SE Series
Japan Solar	JPS-60 & JPS-72 Series
JA Solar	JAM72D30MB, JAM78D10MB JAM72S30 /MR JAP6 60-xxx JAM6(K)-60/xxx, JAP6(k)-72-xxx/4BB JAP72S##-xxx/** JAP6(k)-60-xxx/4BB, JAP60S##-xxx/** JAM6(k)-72-xxx/**, JAM72S##-xxx/** JAM6(k)-60-xxx/**, JAM60S##-xxx/** i. ##: 01, 02, 03, 09, 10 ii. **: SC, PR, BP, HiT, IB, MW, MR ** = Backsheet, ## Cell technology
Jinko	JKM & JKMS Series JKMxxxM-72HL-V JKMxxxM-72HLM-TV JKMxxxM-72HL4-(T)V JKMxxxM-7RL3-V
Kyocera	KD-F & KU Series
LA Solar	LSxxxHC(166)
LG Electronics	LGxxx(E1C/E1K/N1C/N1K/N2T/N2W/S1C/S2W/Q1C/Q1K)-A5 LGxxx(A1C/M1C/M1K/N1C/N1K/Q1C/Q1K/QAC/QAK)-A6 LGxxxN2W-B3 LGxxxN2T-B5 LGxxxN1K-B6 LGxxx(N1C/N1K/N2T/N2W)-E6 LGxxx(N1C/N1K/N2W/S1C/S2W)-G4 LGxxxN2T-J5

- The frame profile must not have any feature that might interfere with the bonding devices that are integrated into the racking system
- Use with a maximum over current protection device OCPD of 30A
- Listed models can be used to achieve a Class A fire system rating, for steep slope applications, only when modules fire typed 1, 2, 3 with metal frame, 10 with metal frame, 19, 22, 25, 29, or 30. See Appendix page 3



1403 N. Research Way Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OF IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



PV INSTALLATION PROFESSIONAL

Scott Gurney #PV-011719-015866

CONTRACTOR: BRS FIELD OPS 385-498-6700

DRAWING BY

PLOT DATE:

PROJECT NUMBER:

SHEET NAM

RELEASE FOR CONSTRUCT

REVISIONS NOTED HORGENDINGER

DEVELOPMENT SERVICES

--+EE'S SUMMIT, MISSION





### **Electrical Bonding and Grounding Test Modules**

The list below is not exhaustive of compliant modules but shows those that have been evaluated and found to be electrically compatible with the NXT Horizon system.

Manufacture	Module Model / Series
LG Electronics (cont.)	LGxxx(N1K/N1W/N2T/N2W)-L5 LGxxx(M1C/N1C/Q1C/Q1K)-N5 LGxxx(N1C/N1K/N2W/Q1C/Q1K)-V5 LGxxxN3K-V6
LONGi	LR4-60(HPB/HPH) LR4-72(HPH) LR6-60 LR6-60(BK/HPB/HPH/HV/PB/PE/PH) LR6-72 LR6-72(BK/HV/PB/PE/PH) RealBlack LR4-60HPB RealBlack LR6-60HPB
Mission Solar Energy	MSE Mono, MSE Perc MSExxx(SR8T/SR8K/SR9S/SX5T) MSExxx(SX5K/SX6W)
Mitsubishi	MJE & MLE Series
NE Solar	NESE xxx-72MHB-M10
Neo Solar Power Co.	D6M Series
Panasonic	VBHNxxxSA06/SA06B/SA11/SA11B VBHNxxxSA15/SA15B/SA16/SA16B, VBHNxxxKA, VBHNxxxKA03/04, VBHNxxxSA17/SA17G/SA17E/SA18/SA18E, VBHNxxxZA01/ZA02/ZA03/VBHNxxxZA04 EVPVxxx EVPVxxx(H/K/PK)
Peimar	SGxxxM (FB/BF) SMxxxM
Phono Solar	PSxxxM1-20/U PSxxxM1H-20/U PSxxxM1-20UH PSxxxM1H-20UH

Manufacture	Module Model / Series
Phono Solar (cont.)	PSxxxM1-20/UH PSxxxM1H-20/UH PSxxxM-24/T PSxxxMH-24/T PSxxxMH-24/TH PSxxxMH-24/TH
Prism Solar	P72 Series
Q.Cells	Plus, Pro, Peak, G3, G4, Peak G5(SC), G6(+)(SC)(AC), G7, G8(+), Plus, Pro, Peak L-G2, L-G4, L-G5 Peak L-G5, L-G6, L-G7, L-G8(BFF) Q.PEAK DUO (BLK)-G6+ Q.PEAK DUO (BLK)-G7 Q.PEAK DUO (BLK)-G7 Q.PEAK DUO L-(G7/G7.1/G7.2/G7.3/G7.7) Q.PEAK DUO (BLK) G8(+) Q.PEAK DUO L-(G8/G8.1/G8.2/G8.3) Q.PEAK DUO L-G8.3 (BFF/BFG/BGT) Q.PEAK DUO L-G8.3 (BFF/BFG/BGT) Q.PEAK DUO XL-G9/G9.2/G9.3) Q.PEAK DUO XL-G9/G9.2/G9.3) Q.PEAK DUO SLK G10+ Q.PEAK DUO BLK G10+/AC Q.PEAK DUO BLK G10+/AC Q.PEAK DUO XL-(G10/G10.2/G10.3/G10.c/G10.d) Q.PEAK DUO XL-G10.3/BFG Q.PEAK DUO XL-G10.d/BFG Q.PEAK DUO XL-G11.3/BFG

Manufacture	Module Model / Series
	RECxxxAA (BLK/Pure)
	RECxxxNP (N-PEAK)
	RECxxxNP2 (Black)
	RECxxxPE, RECxxxPE72
REC	RECxxxTP, RECxxxTP72
	RECxxxTP2(M/BLK2)
	RECxxxTP2S(M)72
	RECxxxTP3M (Black)
	RECxxxTP4 (Black)
Renesola	All 60-cell modules
Risen	RSM Series, RSM110-8-xxxBMDG
S-Energy	SN72 & SN60 Series
SEG Solar	SEG-xxx-BMD-HV
Seraphim	SEG-(6PA/6PB/6MA/6MA-HV/6MB/E01/E11) SRP-(6QA/6QB) SRP-xxx-6MB-HV, SRP-320-375-BMB-HV, SRP-xxx-BMC-HV, SRP-390-450-BMA-HV, SRP-xxx-BMZ-HV, SRP-390-405-BMD-HV
Sharp	NU-SA & NU-SC Series
Silfab	SLA-M, SLA-P, SLG-M, SLG-P & BC Series SILxxx(BK/BL/HC/HL/HN/ML/NL/NT/NX/NU
SolarEver USA	SE-166*83-xxxM-120N
Solaria	PowerXT-xxxR-(AC/PD/BD)
	PowerXT-xxxC-PD
	PowerXT-xxxR-PM (AC)
Solartech	STU HJT, STU PERC & Quantum PERC
SolarWorld	Sunmodule Protect, Sunmodule Plus/Pro

- The frame profile must not have any feature that might interfere with the bonding devices that are integrated into the racking system
- Use with a maximum over current protection device OCPD of 30A
- Listed models can be used to achieve a Class A fire system rating, for steep slope applications, only when modules fire typed 1, 2, 3 with metal frame, 10 with metal frame, 19, 22, 25, 29, or 30. See Appendix page 3



1403 N. Research Way Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OF IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



PV INSTALLATION PROFESSIONAL

Scott Gurney #PV-011719-015866

CONTRACTOR: BRS FIELD OPS 385-498-6700

DRAWING BY

PLOT DATE:

PROJECT NUMBER:

SHEET NA

RELEASE FOR CONSTRUCT

REVISIONS NOTED 阿耳克巴科斯斯巴巴
DEVELOPMENT SERVICE:





### **Electrical Bonding and Grounding Test Modules**

The list below is not exhaustive of compliant modules but shows those that have been evaluated and found to be electrically compatible with the NXT Horizon system.

Manufacture	Module Model / Series
Sonali	SS-M-360 to 390 Series SS-M-390 to 400 Series SS-M-440 to 460 Series SS-M-430 to 460 BiFacial Series
Suniva	MV Series & Optimus Series (35mm)
SunPower	AC, X-Series, E-Series & P-Series SPR E20 435 COM (G4 Frame) Axxx-BLK-G-AC, SPR-Mxxx-H-AC
SunTech	STP, STPXXXS - B60/Wnhb
Sun Edison	F-Series, R-Series
Talesun	TP572, TP596, TP654, TP660 TP672, Hipor M, Smart
Tesla	SC, SC B, SC B1, SC B2, TxxxS, TxxxH
Trina	PA05, PD05, DD05, DD06, DE06, DE09.05 PD14, PE14, DD14, DE14, DE15, DE15V(II) DEG15HC.20(II), DEG15MC.20(II) DEG15VC.20(II), DE18M(II), DEG18MC.20(II) DE19, DEG19C.20
TSMC	TS-150C2 CIGSw
Upsolar	UP-MxxxP, UP-MxxxM(-B)
URECO	D7Kxxx(H7A/H8A), D7Mxxx(H7A/H8A) FAKxxx(C8G/E8G), FAMxxxE7G-BB FAMxxxE8G(-BB), FBKxxxM8G
Vikram	Eldora, Somera, Ultima PREXOS VSMDHT.60.AAA.05 PREXOS VSMDHT.72.AAA.05
VSUN	VSUNxxx-60M-BB, VSUNxxx-72MH VSUN4xx-144BMH

Manufacture	Module Model / Series
	VNS-72M1-5-xxxW-1.5,
	VNS-72M3-5-xxxW-1.5,
Vina	VNS-144M1-5-xxxW-1.5,
	VNS-144M3-5-xxxW-1.5,
	VNS-120M3-5-xxxW-1.0
Winaico	WST & WSP Series
Yingli	YGE & YLM Series
ZNShine Solar	ZXM6-72 Series, ZXM6-NH144 ZXM6-NHLDD144

- The frame profile must not have any feature that might interfere with the bonding devices that are integrated into the racking system
- Use with a maximum over current protection device OCPD of 30A
- Listed models can be used to achieve a Class A fire system rating, for steep slope applications, only when modules fire typed 1, 2, 3 with metal frame, 10 with metal frame, 19, 22, 25, 29, or 30. See Appendix page 3



1403 N. Research Way Orem, UT 84097

800.377.4480 WWW.BLUERAVENSOLAR.COM

CONFIDENTIAL- THE INFORMATION HEREIN CONTAINED SHALL NOT BE USED FOR THE BENEFIT OF ANYONE EXCEPT BLUE RAVEN SOLAR NOR SHALL IT BE DISCLOSED IN WHOLE OF IN PART TO OTHERS OUTSIDE RECIPIENTS ORGANIZATION, EXCEPT IN CONNECTION WITH THE SALE AND USE OF THE RESPECTIVE EQUIPMENT WITHOUT THE WRITTEN PERMISSION OF BLUE RAVEN SOLAR LLC.



PV INSTALLATION PROFESSIONAL

Scott Gurney #PV-011719-015866

CONTRACTOR: BRS FIELD OPS 385-498-6700

DRAWING BY:

PLOT DATE:

PROJECT NUMBER:

SHEET NAME:

RELEASE FOR CONSTRUCTI