


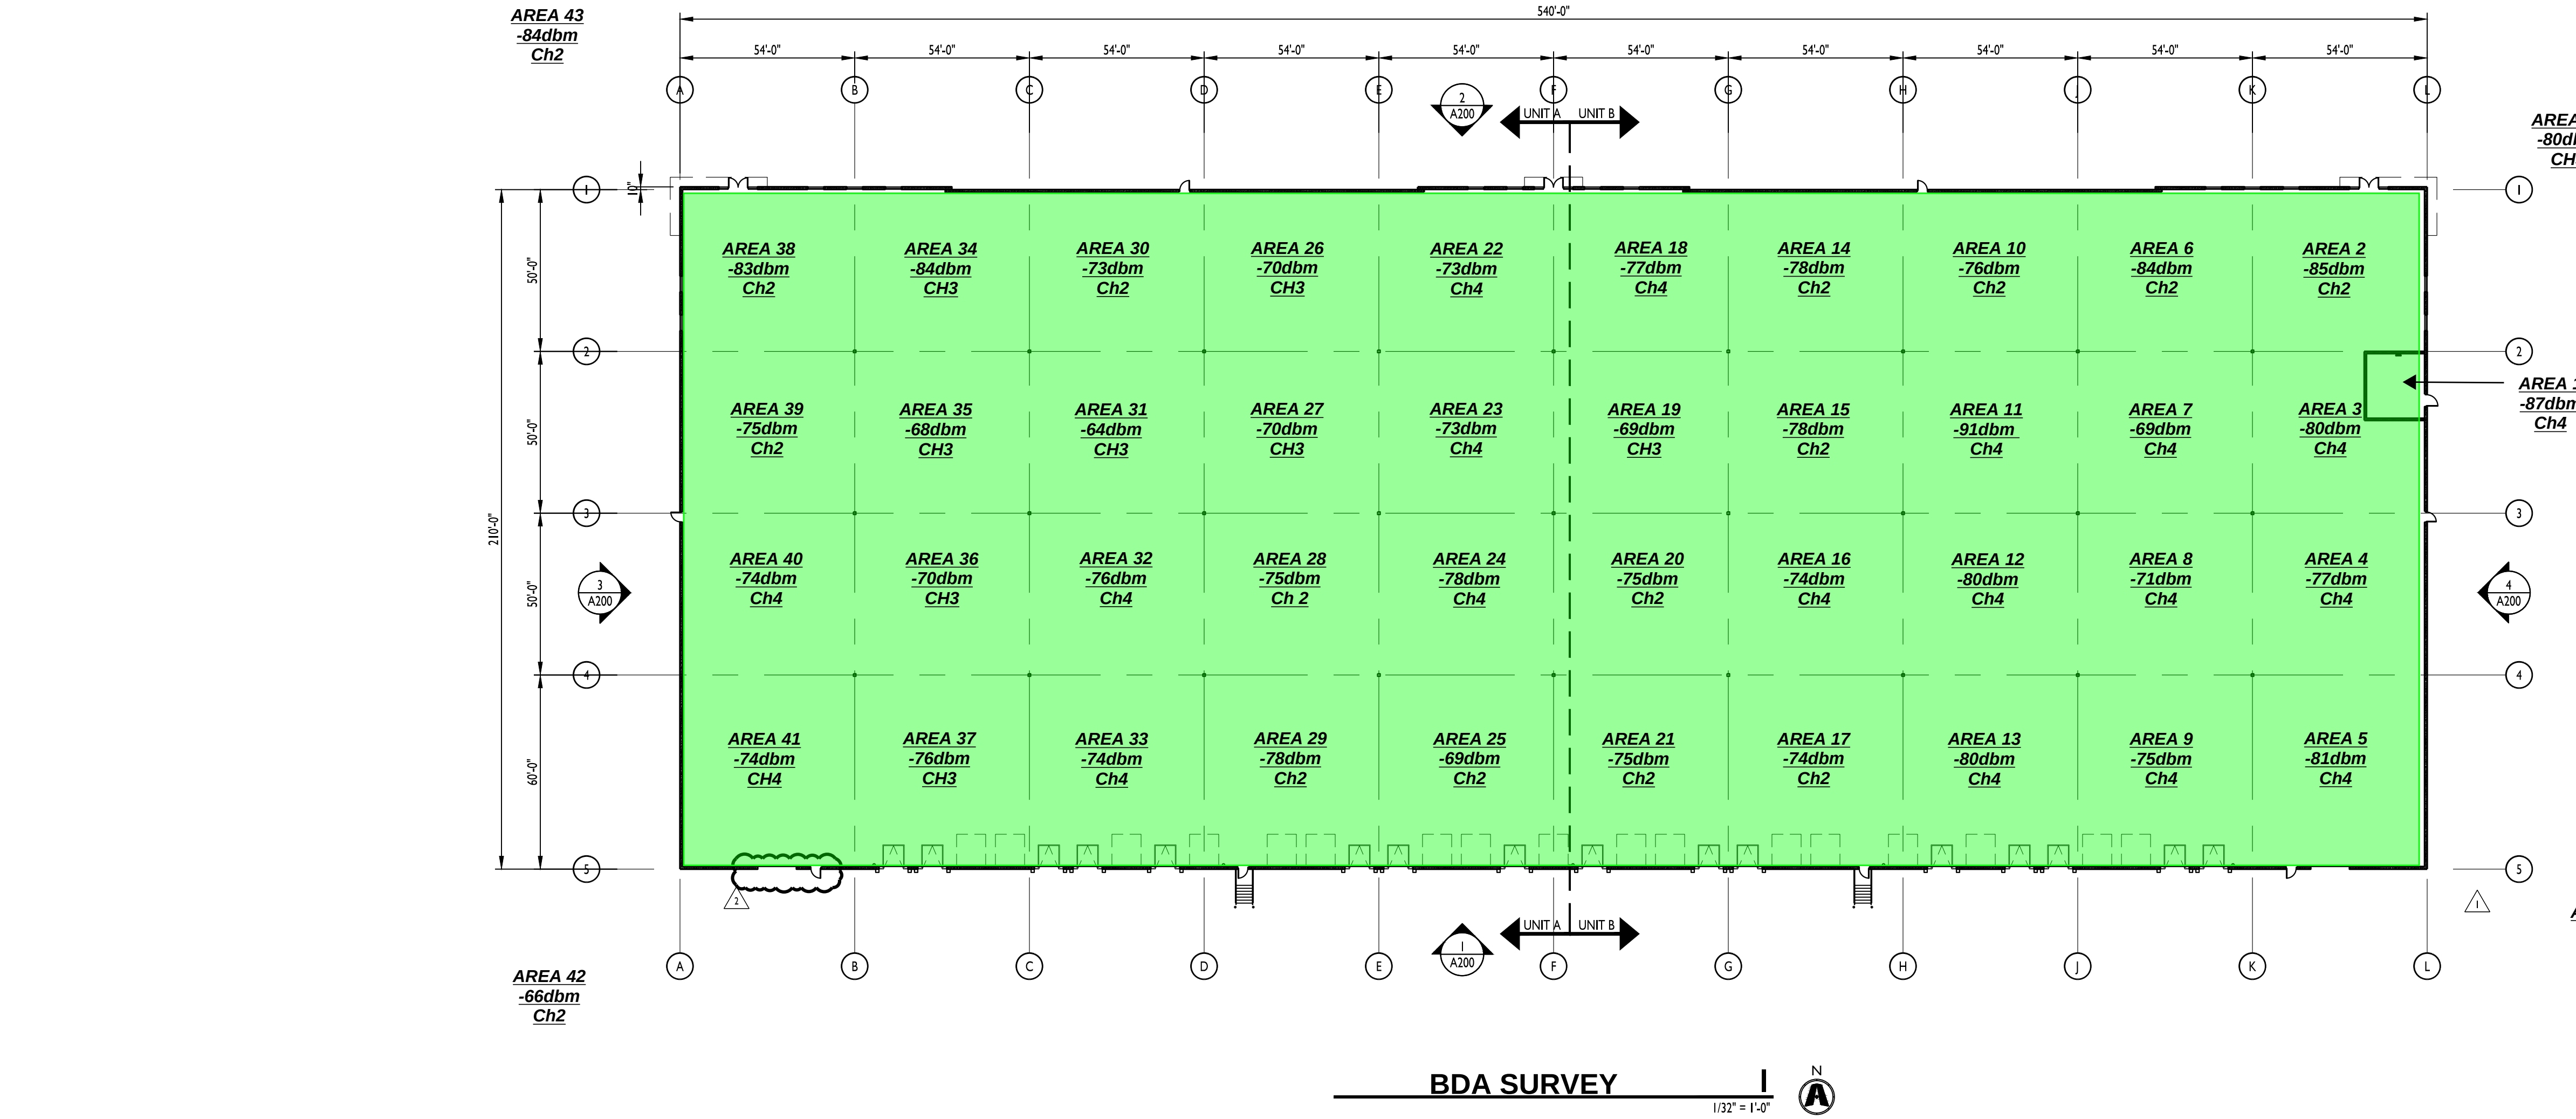

NOTES:


BDA SURVEY WAS DONE IN ACCORDANCE WITH NFPA 72, 1221 AND IFC 510.

95% OF TOTAL COMMON AREAS MUST PASS WITH A DBM LEVEL OF NO LESS THAN -95dbm PER NFPA 72,1221, AND IFC 510.

100% OF CRITICAL AREAS MUST PASS WITH NO LESS THAN 95%dbm PER NFPA 72,1221, AND IFC 510.

RECEIVER FREQUENCY TO BE PROVIDED BY THE AHJ.

BDA SURVEY MUST BE DONE BY FCC/GROL CERTIFIED TECHNICIAN.

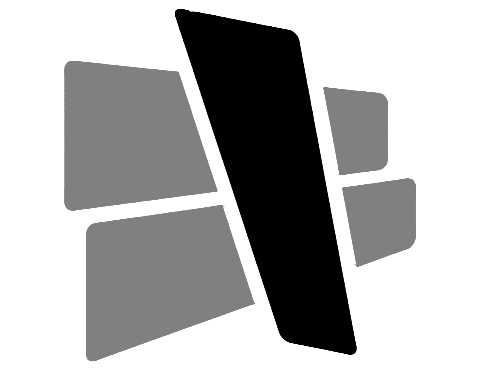


CURRAN
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212
INDIANAPOLIS, IN 46216
O :: 317 . 288 . 0681
F :: 317 . 288 . 0753




CERTIFICATION

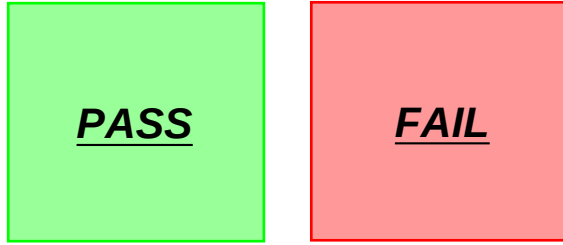

RECEIVER FREQUENCY CHART	
CHANNEL 1	855.012500
CHANNEL 2	855.362500
CHANNEL 3	855.837500
CHANNEL 4	858.037500
CHANNEL 5	858.862500
CHANNEL 6	859.487500
CHANNEL 7	859.862500
CHANNEL 8	815.78750
CHANNEL 9	N/A
CHANNEL 10	N/A

JOB NAME: LSCC BUILDING TWO				CHANNEL 1: 855.012500		27	3	-70	N/A	WAREHOUSE	PASS
ADDRESS: 1220 NW MAIN ST				CHANNEL 2: 855.362500		28	2	-75	N/A	WAREHOUSE	PASS
STATE/CITY/ZIP: MISSOURI, LEE SUMMIT, 64086				CHANNEL 3: 855.837500		29	2	-78	N/A	WAREHOUSE	PASS
SURVEYOR NAME: CODY ANASTASIO				CHANNEL 4: 855.037500		30	2	-73	N/A	WAREHOUSE	PASS
DATE: 09-01-2023				CHANNEL 5: 858.862500		31	3	-64	N/A	WAREHOUSE	PASS
FCC/GROL SN: PG00067600				CHANNEL 6: 859.487500		32	4	-76	N/A	WAREHOUSE	PASS
FRN: 0030111165				CHANNEL 7: 859.787500		33	4	-74	N/A	WAREHOUSE	PASS
AREA	CHANNEL	DOWNLINK -DBM	UPLINK DBM	REMARKS	PASS/FAIL	34	3	-84	N/A	WAREHOUSE	PASS
1	4	-87	N/A	PUMP ROOM	PASS	35	3	-68	N/A	WAREHOUSE	PASS
2	2	-85	N/A	WAREHOUSE	PASS	36	3	-70	N/A	WAREHOUSE	PASS
3	4	-80	N/A	WAREHOUSE	PASS	37	3	-76	N/A	WAREHOUSE	PASS
4	4	-77	N/A	WAREHOUSE	PASS	38	2	-83	N/A	WAREHOUSE	PASS
5	4	-81	N/A	WAREHOUSE	PASS	39	2	-75	N/A	WAREHOUSE	PASS
6	2	-84	N/A	WAREHOUSE	PASS	40	4	-74	N/A	WAREHOUSE	PASS
7	4	-69	N/A	WAREHOUSE	PASS	41	4	-74	N/A	WAREHOUSE	PASS
8	4	-71	N/A	WAREHOUSE	PASS	42	2	-66	N/A	EXTERIOR	PASS
9	4	-75	N/A	WAREHOUSE	PASS	43	2	-84	N/A	EXTERIOR	PASS
10	2	-76	N/A	WAREHOUSE	PASS	44	2	-63	N/A	EXTERIOR	PASS
11	4	-91	N/A	WAREHOUSE	PASS	45	3	-80	N/A	EXTERIOR	PASS
12	4	-80	N/A	WAREHOUSE	PASS	46					
13	4	-80	N/A	WAREHOUSE	PASS	47					
14	2	-78	N/A	WAREHOUSE	PASS	48					
15	2	-78	N/A	WAREHOUSE	PASS	49					
16	4	-74	N/A	WAREHOUSE	PASS	50					
17	2	-74	N/A	WAREHOUSE	PASS	51					
18	4	-77	N/A	WAREHOUSE	PASS	52					
19	4	-69	N/A	WAREHOUSE	PASS	53					
20	2	-75	N/A	WAREHOUSE	PASS	54					
21	2	-75	N/A	WAREHOUSE	PASS	55					
22	4	-73	N/A	WAREHOUSE	PASS	56					
23	4	-73	N/A	WAREHOUSE	PASS	57					
24	4	-78	N/A	WAREHOUSE	PASS	58					
25	2	-69	N/A	WAREHOUSE	PASS	59					
26	3	-70	N/A	WAREHOUSE	PASS	60					

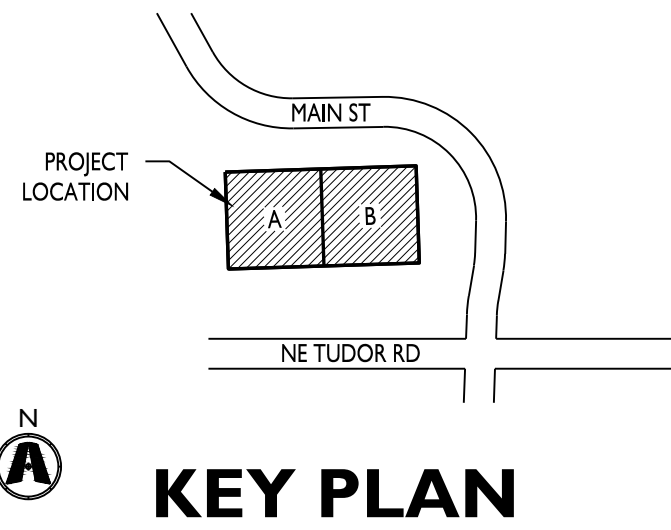

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.
© COPYRIGHT 2021, CURRAN ARCHITECTURE

PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS
BUILDING B LOT 2

X CORNER OF
NE TUDOR RD & MAIN ST
LEE'S SUMMIT, MO 64086



a.p.s Installations
Tony: 816-918-9917
Cody: 913-258-0861
E: tanastasio@apsinstallations.com
Spring Hill, Ks

ISSUE DATES

PERMIT SET	04.26.22
PUMP ROOM REVISION	07.25.22
RFI 6 RESPONSE	11.1.22

220018

OVERALL FLOOR PLAN

BDA.01