



RELEASE FOR CONSTRUCTION  
 AS NOTED ON PLANS REVIEW  
 DEVELOPMENT SERVICES  
 LEE'S SUMMIT, MISSOURI  
 09/28/2023 10:59:22

RE: P230378-01  
 Roof - Osage Lot 15

MiTek USA, Inc.  
 16023 Swingley Ridge Rd  
 Chesterfield, MO 63017  
 314-434-1200

**Site Information:**

Customer: Clover & Hive Project Name: P230378-01  
 Lot/Block: 15 Model:  
 Address: 3740,3738,3736,3734 SW MARYVILLE PL. Buckhorn Dr. Osage  
 City: Lee's Summit State: MO

**General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):**

Design Code: IRC2018/TPI2014 Design Program: MiTek 20/20 8.6  
 Wind Code: ASCE 7-16 Wind Speed: 115 mph  
 Roof Load: 45.0 psf Floor Load: N/A psf

This package includes 27 individual, dated Truss Design Drawings and 0 Additional Drawings.

| No. | Seal#     | Truss Name | Date      | No. | Seal#     | Truss Name | Date      |
|-----|-----------|------------|-----------|-----|-----------|------------|-----------|
| 1   | I59271032 | A1         | 6/30/2023 | 21  | I59271052 | V2         | 6/30/2023 |
| 2   | I59271033 | A2         | 6/30/2023 | 22  | I59271053 | V3         | 6/30/2023 |
| 3   | I59271034 | A3         | 6/30/2023 | 23  | I59271054 | V4         | 6/30/2023 |
| 4   | I59271035 | A4         | 6/30/2023 | 24  | I59271055 | V5         | 6/30/2023 |
| 5   | I59271036 | B1         | 6/30/2023 | 25  | I59271056 | V6         | 6/30/2023 |
| 6   | I59271037 | B2         | 6/30/2023 | 26  | I59271057 | V7         | 6/30/2023 |
| 7   | I59271038 | C1         | 6/30/2023 | 27  | I59271058 | V8         | 6/30/2023 |
| 8   | I59271039 | C2         | 6/30/2023 |     |           |            |           |
| 9   | I59271040 | C3         | 6/30/2023 |     |           |            |           |
| 10  | I59271041 | C4         | 6/30/2023 |     |           |            |           |
| 11  | I59271042 | D1         | 6/30/2023 |     |           |            |           |
| 12  | I59271043 | D2         | 6/30/2023 |     |           |            |           |
| 13  | I59271044 | D3         | 6/30/2023 |     |           |            |           |
| 14  | I59271045 | E1         | 6/30/2023 |     |           |            |           |
| 15  | I59271046 | E2         | 6/30/2023 |     |           |            |           |
| 16  | I59271047 | G1         | 6/30/2023 |     |           |            |           |
| 17  | I59271048 | G1A        | 6/30/2023 |     |           |            |           |
| 18  | I59271049 | G2         | 6/30/2023 |     |           |            |           |
| 19  | I59271050 | G2A        | 6/30/2023 |     |           |            |           |
| 20  | I59271051 | V1         | 6/30/2023 |     |           |            |           |

The truss drawing(s) referenced above have been prepared by MiTek USA, Inc under my direct supervision based on the parameters provided by .  
 Truss Design Engineer's Name: Nathan Fox  
 My license renewal date for the state of Missouri is December 31, 2024.  
 Missouri COA: 001193


IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek. Any project specific information included is for MiTek customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,  
**09/28/2023 10:59:22**

|                               |     |     |                          |           |
|-------------------------------|-----|-----|--------------------------|-----------|
| Truss Type                    | Qty | Ply | Roof - Osage Lot 15      | I59271032 |
| Roof Special Structural Gable | 1   | 1   | Job Reference (optional) |           |

Run: 8.63 S Apr 6 2023 Print: 8.630 S Apr 6 2023 MiTek Industries, Inc. Thu Jun 29 13:03:35 Page: 1  
 ID:kkw6VMCTKypIjEPYbi576Oz\_rGt-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRcDoi7J4zJC?f

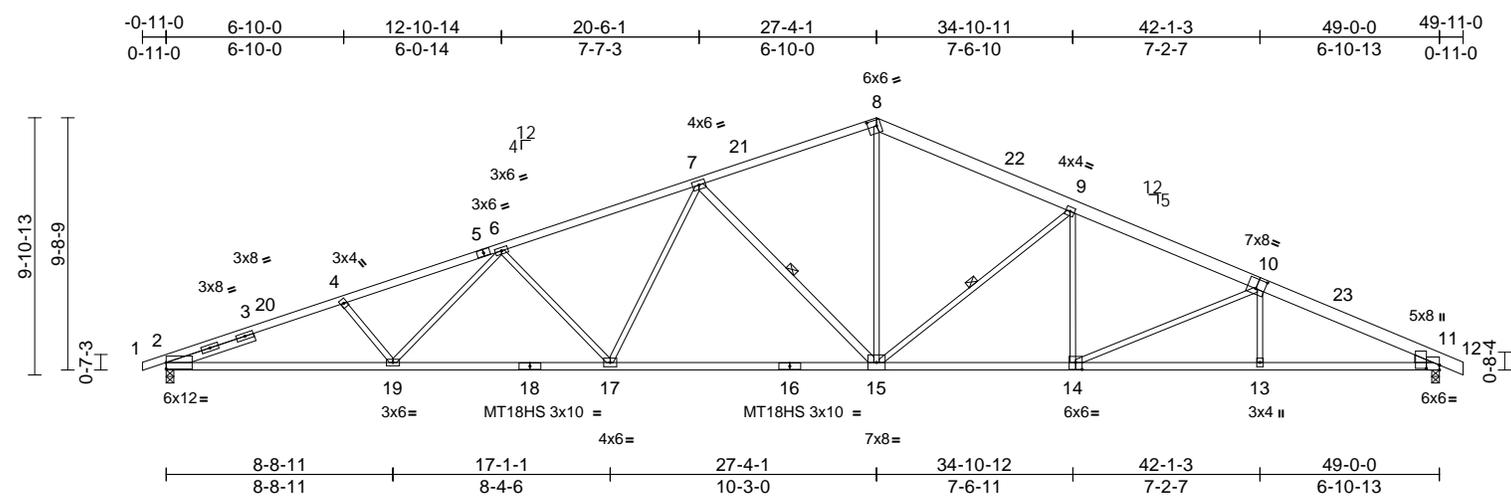

Scale = 1:88.2  
 Plate Offsets (X, Y): [8:0-4-0,0-2-12], [10:0-4-0,0-4-8], [11:Edge,0-2-5], [11:0-1-9,0-6-0], [14:0-3-0,0-3-4]

| Loading     | (psf) | Spacing         | 2-0-0           | CSI       | DEFL | in (loc) | l/defl | L/d   | PLATES | GRIP |        |                         |
|-------------|-------|-----------------|-----------------|-----------|------|----------|--------|-------|--------|------|--------|-------------------------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC        | 0.87 | Vert(LL) | -0.41  | 17-19 | >999   | 240  | MT20   | 244/190                 |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC        | 0.99 | Vert(CT) | -0.92  | 15-17 | >641   | 180  | MT18HS | 244/190                 |
| BCLL        | 0.0   | Rep Stress Incr | NO              | WB        | 0.92 | Horz(CT) | 0.26   | 11    | n/a    | n/a  |        |                         |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-SH |      |          |        |       |        |      |        | Weight: 227 lb FT = 20% |

**LUMBER**  
 TOP CHORD 2x6 SPF No.2 \*Except\* 1-5:2x4 SP 2400F 2.0E, 5-8:2x4 SP 1650F 1.5E  
 BOT CHORD 2x4 SP 2400F 2.0E \*Except\* 14-16,16-18:2x4 SP 1650F 1.5E  
 WEBS 2x3 SPF No.2 \*Except\* 15-7:2x4 SP No.2  
 WEDGE Right: 2x4 SPF No.3  
 SLIDER Left 2x4 SPF No.3 -- 3-6-9

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 2-6-5 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 7-11-11 oc bracing.  
 WEBS 1 Row at midpt 7-15, 9-15

**REACTIONS** (size) 2=0-3-8, 11=0-3-8  
 Max Horiz 2=-174 (LC 17)  
 Max Uplift 2=-406 (LC 8), 11=-315 (LC 13)  
 Max Grav 2=2262 (LC 1), 11=2273 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/0, 2-4=-5398/1091, 4-6=-5153/1058, 6-7=-4366/941, 7-8=-3086/765, 8-9=-3212/773, 9-11=-4612/921, 11-12=0/6  
 BOT CHORD 2-19=-933/4974, 17-19=-799/4580, 15-17=-588/3695, 13-15=-732/4112, 11-13=-732/4112  
 WEBS 4-19=-235/180, 6-19=-57/450, 6-17=-784/288, 7-17=-110/862, 7-15=-1237/370, 8-15=-312/1681, 10-13=0/290, 9-14=0/426, 9-15=-1007/321, 10-14=-605/203

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=35ft; Ke=0.96; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 4-1-0, Interior (1) 4-1-0 to 27-4-1, Exterior(2R) 27-4-1 to 32-4-1, Interior (1) 32-4-1 to 49-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - All plates are MT20 plates unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - All bearings are assumed to be SP 2400F 2.0E crushing capacity of 805 psi.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard

**NOTES**  
 1) Unbalanced roof live loads have been considered for this design.




June 30, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,  
 09/28/2023 10:59:23

|              |     |     |                          |           |
|--------------|-----|-----|--------------------------|-----------|
| Truss Type   | Qty | Ply | Roof - Osage Lot 15      | I59271033 |
| Roof Special | 2   | 1   | Job Reference (optional) |           |

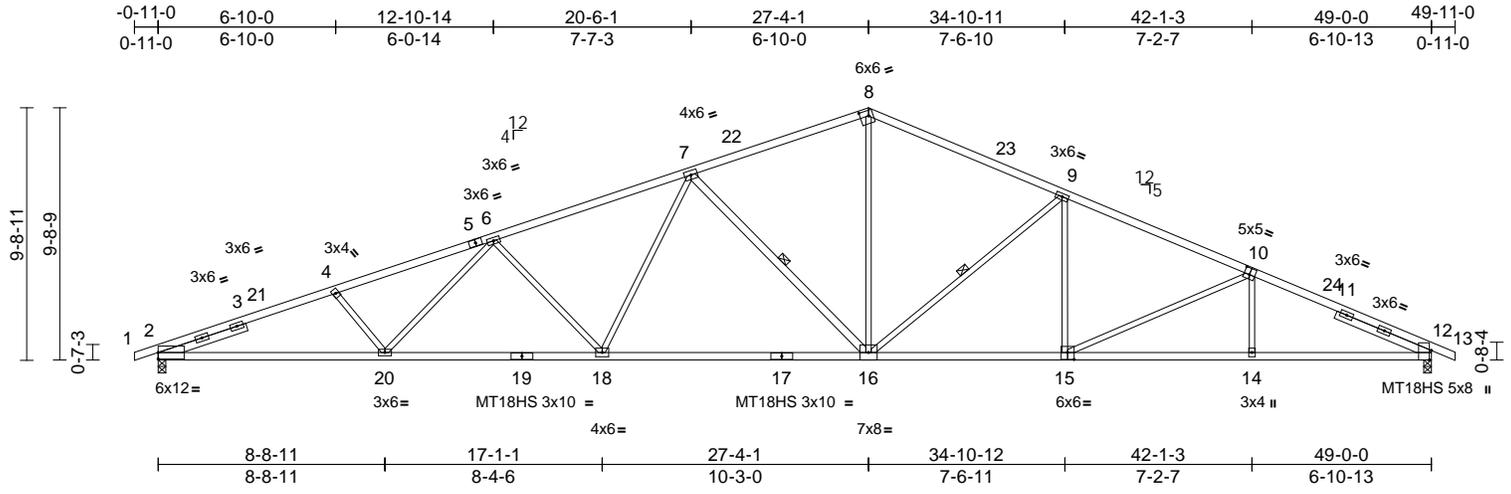

Scale = 1:88.2  
 Plate Offsets (X, Y): [8:0-3-15,0-2-8], [10:0-2-8,0-3-0], [12:0-4-7,Edge], [15:0-3-0,0-3-4]

| Loading     | (psf) | Spacing         | 2-0-0           | CSI       | DEFL | in       | (loc) | l/defl | L/d  | PLATES | GRIP                    |
|-------------|-------|-----------------|-----------------|-----------|------|----------|-------|--------|------|--------|-------------------------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC        | 0.88 | Vert(LL) | -0.42 | 18     | >999 | 240    | MT20 244/190            |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC        | 0.99 | Vert(CT) | -0.93 | 16-18  | >634 | 180    | MT18HS 244/190          |
| BCLL        | 0.0   | Rep Stress Incr | NO              | WB        | 0.89 | Horz(CT) | 0.26  | 12     | n/a  | n/a    |                         |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-SH |      |          |       |        |      |        | Weight: 226 lb FT = 20% |

**LUMBER**  
 TOP CHORD 2x4 SP 2400F 2.0E \*Except\* 5-8:2x4 SP 1650F 1.5E  
 BOT CHORD 2x4 SP 2400F 2.0E \*Except\* 0-0:2x4 SP No.2, 19-17,17-15:2x4 SP 1650F 1.5E  
 WEBS 2x3 SPF No.2 \*Except\* 16-7:2x4 SP No.2  
 SLIDER Left 2x4 SP No.2 -- 3-6-9, Right 2x4 SP No.2 -- 3-11-8

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 2-4-4 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 7-11-5 oc bracing.  
 WEBS 1 Row at midpt 7-16, 9-16

**REACTIONS** (size) 2=0-3-8, 12=0-3-8  
 Max Horiz 2=172 (LC 16)  
 Max Uplift 2=-407 (LC 8), 12=-313 (LC 13)  
 Max Grav 2=2269 (LC 1), 12=2269 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/0, 2-4=-5417/1094, 4-6=-5172/1061, 6-7=-4387/945, 7-8=-3099/768, 8-9=-3214/777, 9-12=-4544/913, 12-13=0/0  
 BOT CHORD 2-20=-939/4992, 18-20=-806/4599, 16-18=-597/3715, 14-16=-721/4023, 12-14=-720/4024  
 WEBS 4-20=-235/180, 7-18=-109/861, 8-16=-316/1697, 7-16=-1257/374, 6-18=-782/288, 6-20=-57/450, 10-14=0/265, 9-15=0/410, 9-16=-1002/318, 10-15=-532/192

**NOTES**  
 1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=35ft; Ke=0.96; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 4-1-0, Interior (1) 4-1-0 to 27-4-1, Exterior(2R) 27-4-1 to 32-4-1, Interior (1) 32-4-1 to 49-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) All plates are MT20 plates unless otherwise indicated.
- 4) All plates are 3x6 MT20 unless otherwise indicated.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) All bearings are assumed to be SP 2400F 2.0E crushing capacity of 805 psi.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



June 30, 2023







**RELEASE FOR CONSTRUCTION  
 AS NOTED ON PLANS REVIEW  
 DEVELOPMENT SERVICES  
 LEE'S SUMMIT, MISSOURI  
 09/28/2023 10:59:24**

|                               |     |     |                          |           |
|-------------------------------|-----|-----|--------------------------|-----------|
| Truss Type                    | Qty | Ply | Roof - Osage Lot 15      | I59271036 |
| Roof Special Structural Gable | 4   | 1   | Job Reference (optional) |           |

Premier Building Supply (Springhill, KS), Spring Hill, KS - 66083, Run: 8.63 S Apr 6 2023 Print: 8.630 S Apr 6 2023 MiTek Industries, Inc. Thu Jun 29 13:03:41 Page: 2  
 ID:kkw6VMCTKypIjEPYbt576Oz\_rGt-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

**LOAD CASE(S)** Standard

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601






**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hill, KS - 66083,  
**09/28/2023 10:59:24**

|                               |     |     |                          |           |
|-------------------------------|-----|-----|--------------------------|-----------|
| Truss Type                    | Qty | Ply | Roof - Osage Lot 15      | I59271038 |
| Roof Special Structural Gable | 1   | 1   | Job Reference (optional) |           |

Run: 8.63 S Apr 6 2023 Print: 8.630 S Apr 6 2023 MiTek Industries, Inc. Thu Jun 29 13:03:43 Page: 1  
 ID:kkw6VMCTKypIjEPYbi576Oz\_rGt-RfC?PsB70Hq3NSgPqnL8w3ulTXhGkGKWrCdoi7J4zJC7f

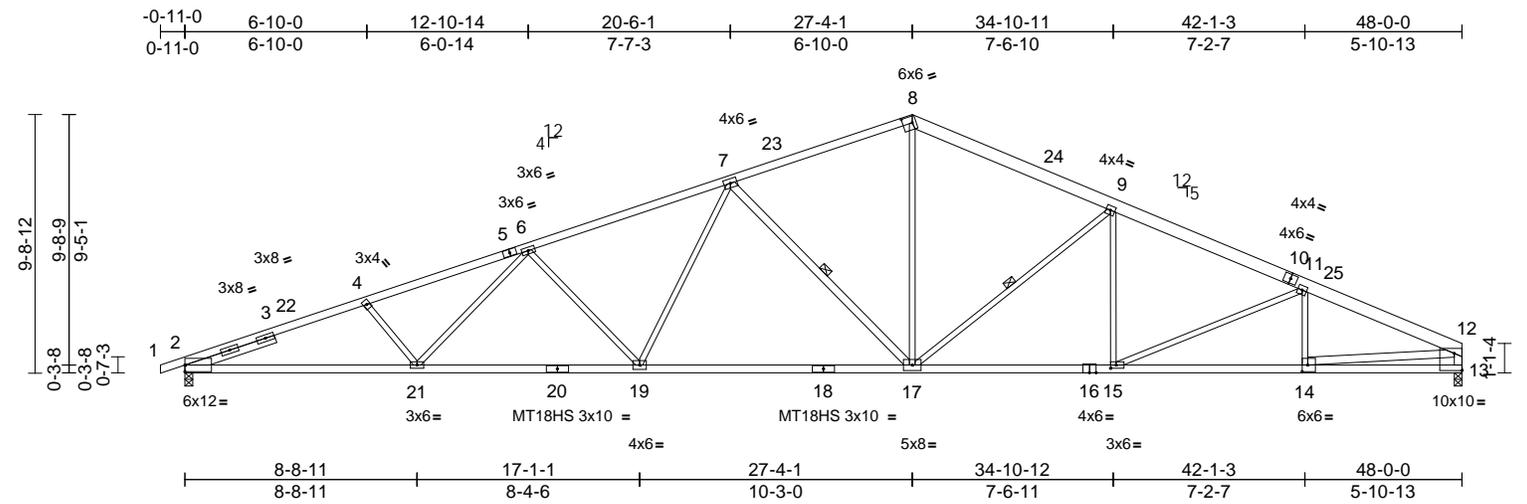

Scale = 1:86.2  
 Plate Offsets (X, Y): [8:0-4-4,0-3-0], [13:Edge,0-7-12], [14:0-2-8,0-3-0], [15:0-2-8,0-1-8]

| Loading     | (psf) | Spacing         | 2-0-0           | CSI       | DEFL | in (loc) | l/defl | L/d   | PLATES | GRIP |        |                         |
|-------------|-------|-----------------|-----------------|-----------|------|----------|--------|-------|--------|------|--------|-------------------------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC        | 0.89 | Vert(LL) | -0.38  | 19-21 | >999   | 240  | MT20   | 244/190                 |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC        | 0.97 | Vert(CT) | -0.85  | 17-19 | >673   | 180  | MT18HS | 244/190                 |
| BCLL        | 0.0   | Rep Stress Incr | NO              | WB        | 0.77 | Horz(CT) | 0.22   | 13    | n/a    | n/a  |        |                         |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-SH |      |          |        |       |        |      |        | Weight: 230 lb FT = 20% |

**LUMBER**  
 TOP CHORD 2x6 SPF No.2 \*Except\* 1-5:2x4 SP 2400F 2.0E, 5-8:2x4 SP 1650F 1.5E  
 BOT CHORD 2x4 SP 2400F 2.0E \*Except\* 18-20,18-16:2x4 SP 1650F 1.5E  
 WEBS 2x3 SPF No.2 \*Except\* 13-12:2x4 SPF No.3, 17-7,14-12:2x4 SP No.2  
 SLIDER Left 2x4 SPF No.3 -- 3-6-9  
**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 2-7-9 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 7-9-15 oc bracing.  
 WEBS 1 Row at midpt 7-17, 9-17  
**REACTIONS** (size) 2=0-3-8, 13=0-3-8  
 Max Horiz 2=174 (LC 16)  
 Max Uplift 2=402 (LC 8), 13=277 (LC 13)  
 Max Grav 2=2218 (LC 1), 13=2153 (LC 1)  
**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/0, 2-4=-5276/1068, 4-6=-5028/1035, 6-7=-4234/916, 7-8=-2950/739, 8-9=-3072/754, 9-11=-3731/826, 11-12=-3865/811, 12-13=-2083/495  
 BOT CHORD 2-21=-941/4860, 19-21=-829/4457, 17-19=-626/3568, 15-17=-587/3364, 14-15=-698/3493, 13-14=-109/377  
 WEBS 4-21=-239/180, 8-17=-298/1588, 6-19=-786/288, 11-14=-306/170, 9-15=0/321, 11-15=-265/142, 7-17=-1240/370, 6-21=-58/455, 9-17=-886/302, 7-19=-110/863, 12-14=-594/3144

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=35ft; Ke=0.96; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 4-1-0, Interior (1) 4-1-0 to 27-4-1, Exterior(2R) 27-4-1 to 32-4-1, Interior (1) 32-4-1 to 47-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are MT20 plates unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP 2400F 2.0E crushing capacity of 805 psi.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

**NOTES**  
 1) Unbalanced roof live loads have been considered for this design.



June 30, 2023


**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,  
 09/28/2023 10:59:24

|              |     |     |                          |           |
|--------------|-----|-----|--------------------------|-----------|
| Truss Type   | Qty | Ply | Roof - Osage Lot 15      | I59271039 |
| Roof Special | 2   | 1   | Job Reference (optional) |           |

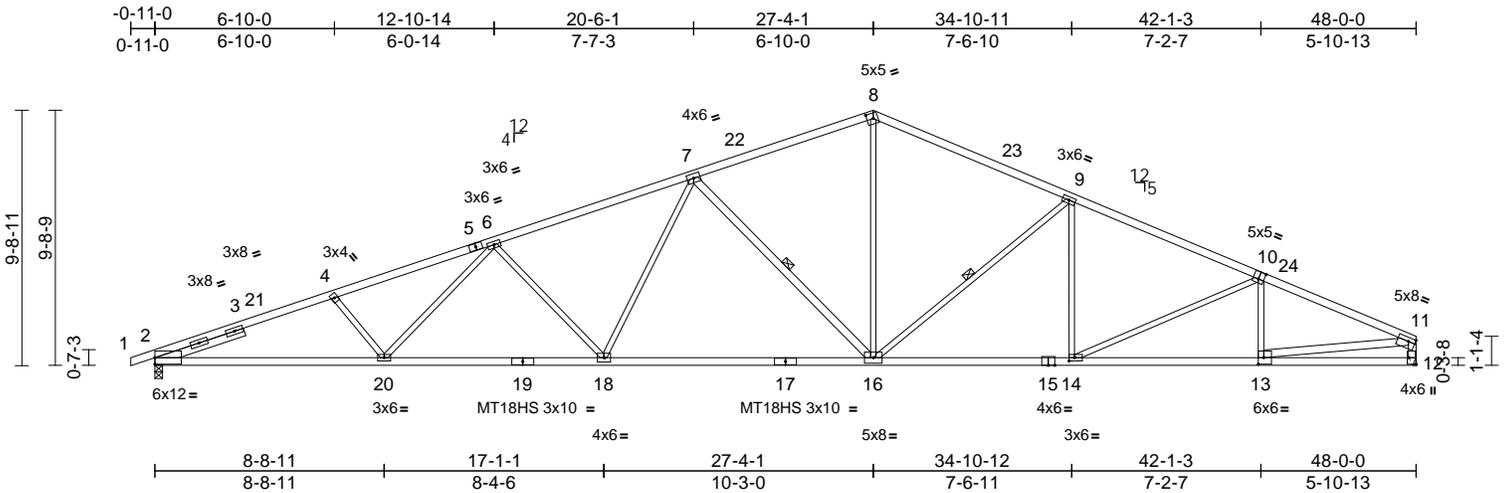

Scale = 1:87.3

Plate Offsets (X, Y): [8:0-2-15,0-2-8], [10:0-2-8,0-3-4], [11:0-3-0,0-1-12], [12:Edge,0-3-8], [13:0-2-8,0-3-0], [14:0-2-8,0-1-8]

| Loading     | (psf) | Spacing         | 2-0-0           | CSI       | DEFL | in       | (loc) | l/defl | L/d  | PLATES | GRIP   |                         |
|-------------|-------|-----------------|-----------------|-----------|------|----------|-------|--------|------|--------|--------|-------------------------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC        | 0.92 | Vert(LL) | -0.39 | 18-20  | >999 | 240    | MT20   | 244/190                 |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC        | 0.97 | Vert(CT) | -0.87 | 16-18  | >662 | 180    | MT18HS | 244/190                 |
| BCLL        | 0.0   | Rep Stress Incr | NO              | WB        | 0.78 | Horz(CT) | 0.22  | 12     | n/a  | n/a    |        |                         |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-SH |      |          |       |        |      |        |        | Weight: 224 lb FT = 20% |

**LUMBER**  
 TOP CHORD 2x4 SP 2400F 2.0E \*Except\* 10-11:2x4 SP No.2, 5-8:2x4 SP 1650F 1.5E  
 BOT CHORD 2x4 SP 2400F 2.0E \*Except\* 15-17,17-19:2x4 SP 1650F 1.5E  
 WEBS 2x3 SPF No.2 \*Except\* 12-11:2x4 SPF No.3, 16-7,13-11:2x4 SP No.2  
 SLIDER Left 2x4 SPF No.3 -- 3-6-9

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 7-9-10 oc bracing.  
 WEBS 1 Row at midpt 7-16, 9-16

**REACTIONS** (size) 2=0-3-8, 12= Mechanical  
 Max Horiz 2=175 (LC 16)  
 Max Uplift 2=401 (LC 8), 12=277 (LC 13)  
 Max Grav 2=2218 (LC 1), 12=2153 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/0, 2-4=-5276/1068, 4-6=-5028/1035, 6-7=-4234/916, 7-8=-2943/739, 8-9=-3052/751, 9-11=-3771/819, 11-12=-2084/495  
 BOT CHORD 2-20=-947/4860, 18-20=-835/4457, 16-18=-632/3568, 14-16=-582/3318, 13-14=-687/3419, 12-13=-102/254  
 WEBS 4-20=-240/180, 8-16=-298/1580, 6-20=-58/455, 7-18=-109/863, 7-16=-1258/374, 6-18=-784/288, 10-13=-362/179, 9-14=0/314, 9-16=-852/294, 10-14=-242/138, 11-13=-589/3196

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=35ft; Ke=0.96; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 4-1-0, Interior (1) 4-1-0 to 27-4-1, Exterior(2R) 27-4-1 to 32-4-1, Interior (1) 32-4-1 to 47-10-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearings are assumed to be: Joint 2 SP 2400F 2.0E crushing capacity of 805 psi, Joint 12 SPF No.3 crushing capacity of 425 psi.
- Refer to girder(s) for truss to truss connections.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

**NOTES**  
 1) Unbalanced roof live loads have been considered for this design.



**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,  
**09/28/2023 10:59:25**

|              |     |     |                          |           |
|--------------|-----|-----|--------------------------|-----------|
| Truss Type   | Qty | Ply | Roof - Osage Lot 15      | I59271040 |
| Roof Special | 5   | 1   | Job Reference (optional) |           |

Run: 8:63 S Apr 6 2023 Print: 8:630 S Apr 6 2023 MiTek Industries, Inc. Thu Jun 29 13:03:44 Page: 1  
 ID:kkw6VMCTKypIjEPYbi576Oz\_rGt-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCdoi7J4zJC?f

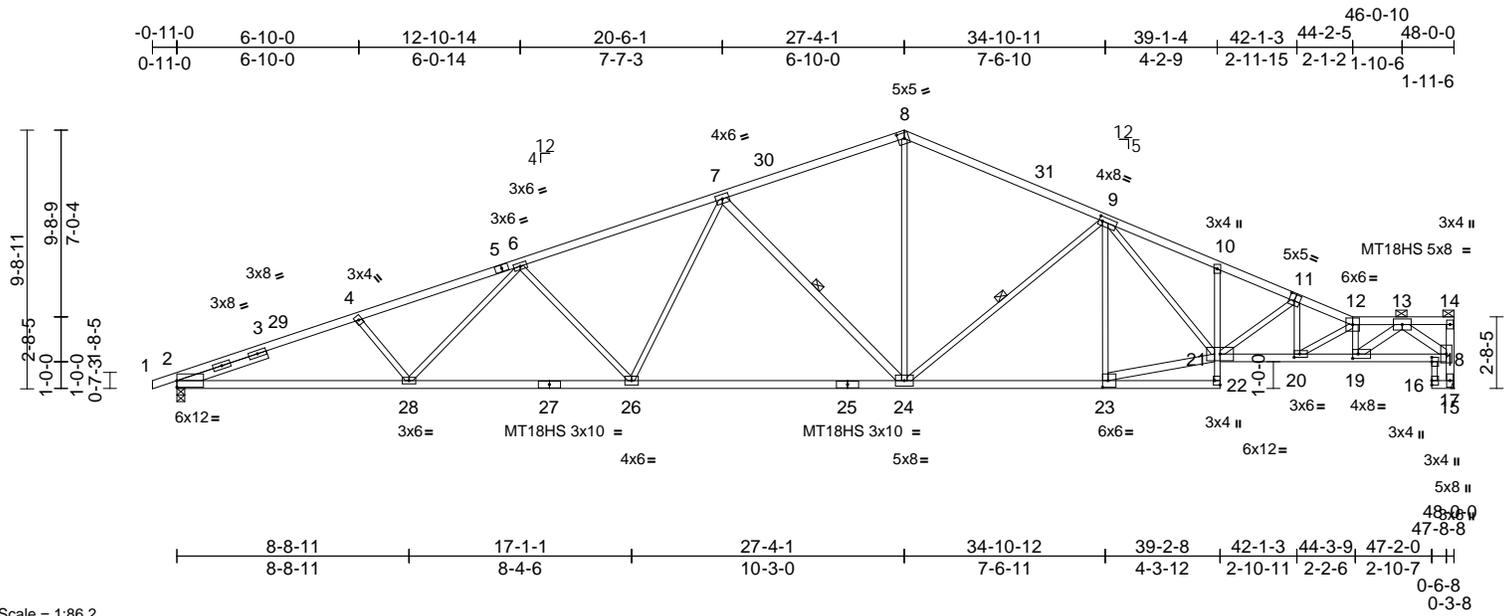

Scale = 1:86.2  
 Plate Offsets (X, Y): [8:0-2-15,0-2-8], [9:0-1-8,0-2-0], [11:0-2-8,0-3-0], [18:0-2-0,Edge], [19:0-2-8,0-2-0], [20:0-2-8,0-1-8], [22:Edge,0-2-8], [23:0-2-8,0-3-0]

| Loading     | (psf) | Spacing         | 2-0-0           | CSI       | DEFL | in (loc) | l/defl | L/d   | PLATES | GRIP |        |                         |
|-------------|-------|-----------------|-----------------|-----------|------|----------|--------|-------|--------|------|--------|-------------------------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC        | 0.84 | Vert(LL) | -0.42  | 24-26 | >999   | 240  | MT20   | 244/190                 |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC        | 0.97 | Vert(CT) | -0.93  | 24-26 | >619   | 180  | MT18HS | 244/190                 |
| BCLL        | 0.0   | Rep Stress Incr | NO              | WB        | 0.79 | Horz(CT) | 0.34   | 15    | n/a    | n/a  |        |                         |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-SH |      |          |        |       |        |      |        | Weight: 238 lb FT = 20% |

**LUMBER**  
 TOP CHORD 2x4 SP 2400F 2.0E \*Except\* 11-12,12-14:2x4 SP No.2, 5-8:2x4 SP 1650F 1.5E  
 BOT CHORD 2x4 SP 2400F 2.0E \*Except\* 22-10,18-16:2x3 SPF No.2, 21-17,25-27:2x4 SP 1650F 1.5E, 16-15:2x4 SP No.2  
 WEBS 2x3 SPF No.2 \*Except\* 24-7,21-23,15-14,19-13,13-17:2x4 SP No.2  
 SLIDER Left 2x4 SPF No.3 -- 3-6-9  
**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 2-2-9 oc purlins, except 2-0-0 oc purlins (2-4-0 max.): 12-14.  
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.  
 WEBS 1 Row at midpt 7-24, 9-24  
**REACTIONS** (size) 2=0-3-8, 15= Mechanical  
 Max Horiz 2=230 (LC 12)  
 Max Uplift 2=-399 (LC 8), 15=-280 (LC 13)  
 Max Grav 2=2218 (LC 1), 15=2153 (LC 1)  
**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/0, 2-4=-5276/1061, 4-6=-5029/1027, 6-7=-4233/909, 7-8=-2946/730, 8-9=-3052/735, 9-10=-4721/1035, 10-12=-5231/1060, 12-13=-4988/1008, 13-14=-33/1  
 BOT CHORD 2-28=-1003/4861, 26-28=-888/4456, 24-26=-685/3568, 23-24=-621/3306, 22-23=-32/162, 21-22=0/71, 10-21=-144/83, 20-21=-962/4821, 19-20=-1038/5129, 18-19=-567/2637, 17-18=-568/2683, 16-18=-40/6, 15-16=-45/1

**WEBS**  
 4-28=-240/180, 8-24=-284/1575, 6-28=-57/457, 7-26=-111/860, 7-24=-1256/375, 6-26=-785/288, 11-20=-29/298, 9-23=-648/211, 9-24=-833/286, 21-23=-605/3231, 9-21=-352/1665, 11-21=-574/148, 12-20=-363/91, 12-19=-1883/404, 15-17=-2101/460, 14-17=-56/31, 13-19=-564/3006, 13-17=-3300/717

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=35ft; Ke=0.96; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 4-1-0, Interior (1) 4-1-0 to 27-4-1, Exterior(2R) 27-4-1 to 32-4-1, Interior (1) 32-4-1 to 47-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Provide adequate drainage to prevent water ponding.
  - 4) All plates are MT20 plates unless otherwise indicated.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) Bearings are assumed to be: Joint 2 SP 2400F 2.0E crushing capacity of 805 psi, Joint 15 SPF No.3 crushing capacity of 425 psi.
  - 7) Refer to girder(s) for truss to truss connections.
  - 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

**LOAD CASE(S)** Standard




June 30, 2023

**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,  
**09/28/2023 10:59:25**

|                              |     |     |                          |           |
|------------------------------|-----|-----|--------------------------|-----------|
| Truss Type                   | Qty | Ply | Roof - Osage Lot 15      | 159271041 |
| Roof Special Supported Gable | 1   | 1   | Job Reference (optional) |           |

Run: 8.63 E Jun 15 2023 Print: 8.630 E Jun 15 2023 MiTek Industries, Inc. Thu Jun 29 14:53:30 Page: 1  
 ID:kkw6VMCTKypjEPYbt576Oz\_rGt-sX7PCO\_aWsx?uP7I231Q2PEXkv?t1m5GFvV9ugz1OL3

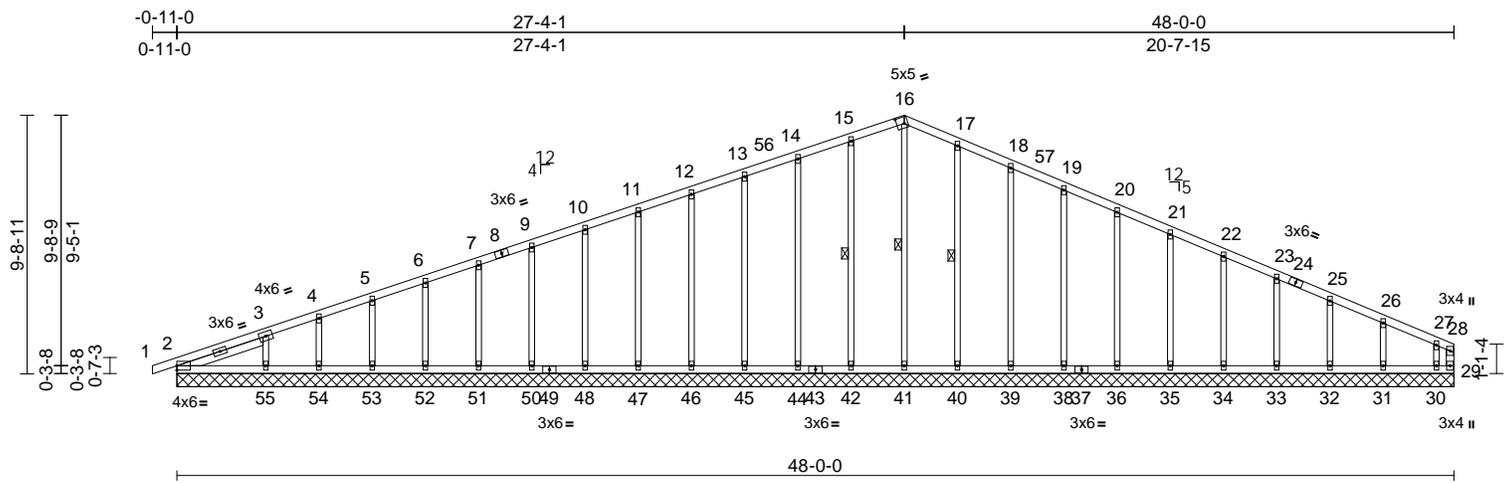

Scale = 1:86.2  
 Plate Offsets (X, Y): [16:0-3-7,0-3-0]

| Loading     | (psf) | Spacing         | 2-0-0           | CSI       | DEFL | in       | (loc) | l/defl | L/d | PLATES | GRIP           |          |
|-------------|-------|-----------------|-----------------|-----------|------|----------|-------|--------|-----|--------|----------------|----------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC        | 0.11 | Vert(LL) | n/a   | -      | n/a | 999    | MT20           | 244/190  |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC        | 0.09 | Vert(CT) | n/a   | -      | n/a | 999    |                |          |
| BCLL        | 0.0   | Rep Stress Incr | NO              | WB        | 0.23 | Horz(CT) | 0.01  | 29     | n/a | n/a    |                |          |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-SH |      |          |       |        |     |        | Weight: 246 lb | FT = 20% |

**LUMBER**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 WEBS 2x4 SPF No.3  
 OTHERS 2x3 SPF No.2  
 SLIDER Left 2x4 SPF No.3 -- 3-4-15

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
 WEBS 1 Row at midpt 16-41, 15-42, 17-40

**REACTIONS** All bearings 48-0-0.  
 (lb) - Max Horiz 2=175 (LC 12)  
 Max Uplift All uplift 100 (lb) or less at joint(s)  
 2, 29, 31, 32, 33, 34, 35, 36, 38, 39, 40, 42, 44, 45, 46, 47, 48, 50, 51, 52, 53, 54, 55 except 30=211 (LC 13)  
 Max Grav All reactions 250 (lb) or less at joint (s) 2, 29, 30, 31, 32, 33, 34, 35, 36, 38, 39, 40, 41, 42, 44, 45, 46, 47, 48, 50, 51, 52, 53, 54 except 55=268 (LC 25)

**FORCES** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 12-13=-101/255, 13-56=-112/276, 14-56=-100/283, 14-15=-124/312, 15-16=-134/336, 16-17=-138/332, 17-18=-124/274

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=35ft; Ke=0.96; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-11-0 to 4-1-0, Exterior(2N) 4-1-0 to 27-4-1, Corner(3R) 27-4-1 to 32-4-1, Exterior(2N) 32-4-1 to 47-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard




June 30, 2023

**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,  
**09/28/2023 10:59:25**

|              |     |     |                          |           |
|--------------|-----|-----|--------------------------|-----------|
| Truss Type   | Qty | Ply | Roof - Osage Lot 15      | I59271042 |
| Roof Special | 4   | 1   | Job Reference (optional) |           |

Run: 8.63 S Apr 6 2023 Print: 8.630 S Apr 6 2023 MiTek Industries, Inc. Thu Jun 29 13:03:46 Page: 1  
 ID:kkw6VMCTKypIjEPYbt576Oz\_rGt-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f

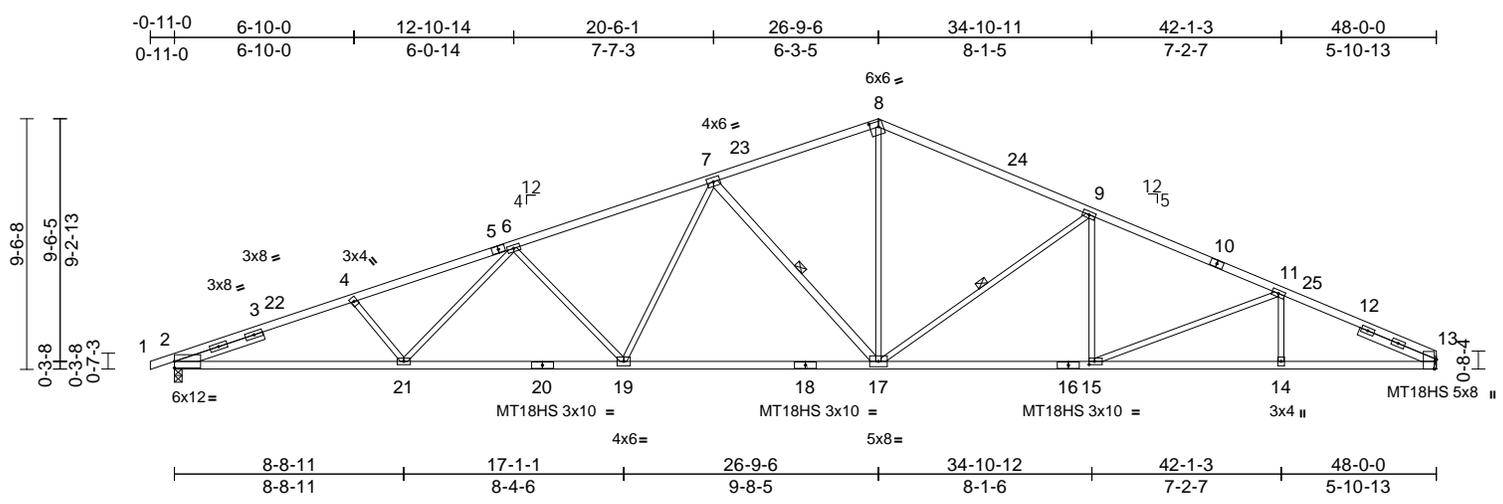

Scale = 1:87.2  
 Plate Offsets (X, Y): [8:0-3-15,0-2-8], [13:0-4-7,Edge], [15:0-2-8,0-1-8]

| Loading     | (psf) | Spacing         | 2-0-0           | CSI       | DEFL | in (loc) | l/defl | L/d   | PLATES | GRIP |        |                         |
|-------------|-------|-----------------|-----------------|-----------|------|----------|--------|-------|--------|------|--------|-------------------------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC        | 0.87 | Vert(LL) | -0.40  | 19-21 | >999   | 240  | MT20   | 244/190                 |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC        | 0.95 | Vert(CT) | -0.85  | 17-19 | >677   | 180  | MT18HS | 197/144                 |
| BCLL        | 0.0   | Rep Stress Incr | NO              | WB        | 0.95 | Horz(CT) | 0.25   | 13    | n/a    | n/a  |        |                         |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-SH |      |          |        |       |        |      |        | Weight: 217 lb FT = 20% |

**LUMBER**  
 TOP CHORD 2x4 SP 2400F 2.0E \*Except\* 5-8:2x4 SP 1650F 1.5E  
 BOT CHORD 2x4 SP 2400F 2.0E \*Except\* 18-20,18-16:2x4 SP 1650F 1.5E  
 WEBS 2x3 SPF No.2 \*Except\* 17-7:2x4 SP No.2  
 SLIDER Left 2x4 SPF No.3 -- 3-6-9, Right 2x4 SPF No.3 -- 3-2-1

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 2-6-5 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 8-0-12 oc bracing.  
 WEBS 1 Row at midpt 7-17, 9-17

**REACTIONS** (size) 2=0-3-8, 13= Mechanical  
 Max Horiz 2=169 (LC 16)  
 Max Uplift 2=-399 (LC 8), 13=-285 (LC 13)  
 Max Grav 2=2225 (LC 1), 13=2159 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/0, 2-4=-5294/1072, 4-6=-5048/1039, 6-7=-4250/923, 7-8=-3031/757, 8-9=-3160/765, 9-11=-3969/870, 11-13=-4442/927  
 BOT CHORD 2-21=-918/4877, 19-21=-786/4476, 17-19=-572/3584, 15-17=-602/3614, 14-15=-743/3934, 13-14=-743/3934  
 WEBS 4-21=-238/180, 8-17=-313/1655, 6-21=-55/458, 7-19=-117/860, 7-17=-1209/360, 6-19=-793/290, 11-14=0/227, 9-15=0/398, 9-17=-1031/325, 11-15=-432/172

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=35ft; Ke=0.96; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 4-1-0, Interior (1) 4-1-0 to 26-9-6, Exterior(2R) 26-9-6 to 31-9-6, Interior (1) 31-9-6 to 48-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- All plates are MT20 plates unless otherwise indicated.
- All plates are 3x6 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearings are assumed to be: Joint 2 SP 2400F 2.0E crushing capacity of 805 psi, Joint 13 SPF No.3 crushing capacity of 425 psi.
- Refer to girder(s) for truss to truss connections.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

**NOTES**  
 1) Unbalanced roof live loads have been considered for this design.




June 30, 2023

**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hill, KS - 66083,  
**09/28/2023 10:59:25**

|              |     |     |                          |           |
|--------------|-----|-----|--------------------------|-----------|
| Truss Type   | Qty | Ply | Roof - Osage Lot 15      | I59271043 |
| Roof Special | 10  | 1   | Job Reference (optional) |           |

Run: 8.63 S Apr 6 2023 Print: 8.630 S Apr 6 2023 MiTek Industries, Inc. Thu Jun 29 13:03:47 Page: 1  
 ID:kkw6VMCTKypjEPYbi576Oz\_rGt-RfC?PsB70Hq3NSgPqnL8w3u1TXbGKWrCDoi7J4zJC7f

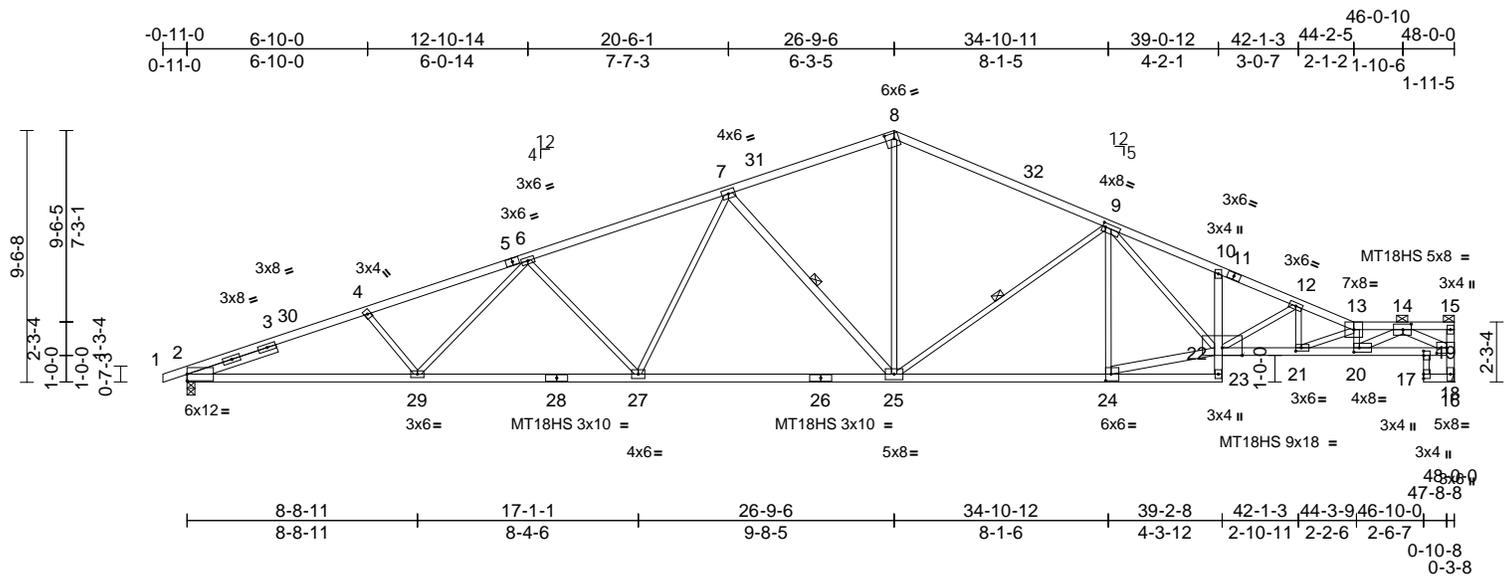

Scale = 1:86.8  
 Plate Offsets (X, Y): [8:0-3-15,0-2-8], [9:0-1-4,0-1-12], [14:0-3-12,0-2-8], [18:0-4-8,0-2-8], [19:0-2-0,Edge], [20:0-2-8,0-2-0], [21:0-2-8,0-1-8], [24:0-2-8,0-3-0]

| Loading     | (psf) | Spacing         | 2-0-0           | CSI       | DEFL | in       | (loc) | l/defl | L/d  | PLATES | GRIP                    |
|-------------|-------|-----------------|-----------------|-----------|------|----------|-------|--------|------|--------|-------------------------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC        | 0.90 | Vert(LL) | -0.48 | 25     | >999 | 240    | MT20 244/190            |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC        | 0.95 | Vert(CT) | -1.00 | 25-27  | >576 | 180    | MT18HS 244/190          |
| BCLL        | 0.0   | Rep Stress Incr | NO              | WB        | 0.91 | Horz(CT) | 0.40  | 16     | n/a  | n/a    |                         |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-SH |      |          |       |        |      |        | Weight: 237 lb FT = 20% |

**LUMBER**  
 TOP CHORD 2x4 SP 2400F 2.0E \*Except\* 11-13:2x4 SP No.2, 13-15,5-8:2x4 SP 1650F 1.5E  
 BOT CHORD 2x4 SP 2400F 2.0E \*Except\* 23-10,17-16:2x4 SP No.2, 19-17:2x3 SPF No.2, 26-23,26-28:2x4 SP 1650F 1.5E  
 WEBS 2x3 SPF No.2 \*Except\* 25-7,22-24,16-15,18-14,14-20:2x4 SP No.2  
 SLIDER Left 2x4 SPF No.3 -- 3-6-9  
**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 1-5-7 oc purlins, except 2-0-0 oc purlins (2-2-4 max.): 13-15.  
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.  
 WEBS 1 Row at midpt 7-25, 9-25  
**REACTIONS** (size) 2=0-3-8, 16= Mechanical  
 Max Horiz 2=216 (LC 12)  
 Max Uplift 2=-397 (LC 8), 16=-285 (LC 13)  
 Max Grav 2=2218 (LC 1), 16=2153 (LC 1)  
**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/0, 2-4=-5276/1063, 4-6=-5030/1030, 6-7=-4230/914, 7-8=-3012/748, 8-9=-3137/747, 9-10=-5269/1131, 10-12=-5397/1102, 12-13=-6411/1291, 13-14=-6949/1398, 14-15=-69/8, 2-29=-989/4860, 27-29=-877/4458, 25-27=-669/3564, 24-25=-665/3555, 23-24=-69/321, 22-23=0/60, 10-22=-102/69, 21-22=-1178/5924, 20-21=-1442/7154, 19-20=-792/3694, 18-19=-800/3761, 17-19=-30/10, 16-17=-67/8

**WEBS**  
 4-29=-239/180, 6-29=-55/459, 7-27=-117/859, 6-27=-794/290, 8-25=-297/1629, 7-25=-1207/360, 12-21=-115/734, 9-24=-663/225, 9-25=-987/313, 22-24=-613/3325, 12-22=-1151/266, 9-22=-411/2002, 13-21=-1357/291, 16-18=-2105/459, 15-18=-67/33, 14-18=-4128/893, 14-20=-694/3727, 13-20=-1928/413

- NOTES**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=35ft; Ke=0.96; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 4-1-0, Interior (1) 4-1-0 to 26-9-6, Exterior(2R) 26-9-6 to 31-9-6, Interior (1) 31-9-6 to 47-10-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Provide adequate drainage to prevent water ponding.
  - All plates are MT20 plates unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Bearings are assumed to be: Joint 2 SP 2400F 2.0E crushing capacity of 805 psi, Joint 16 SPF No.3 crushing capacity of 425 psi.
  - Refer to girder(s) for truss to truss connections.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

**LOAD CASE(S)** Standard




June 30, 2023

**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hill, KS - 66083,  
**09/28/2023 10:59:26**

|                              |     |     |                          |           |
|------------------------------|-----|-----|--------------------------|-----------|
| Truss Type                   | Qty | Ply | Roof - Osage Lot 15      | 159271044 |
| Roof Special Supported Gable | 2   | 1   | Job Reference (optional) |           |

Run: 8.63 E Jun 15 2023 Print: 8.630 E Jun 15 2023 MiTek Industries, Inc. Thu Jun 29 14:54:46 Page: 1  
 ID:kkw6VMCTKypjEPYbt576Oz\_rGt-e9j89NvFcDWD05wuV0PF7RNWaXxuq83SjkbYGz1OJt

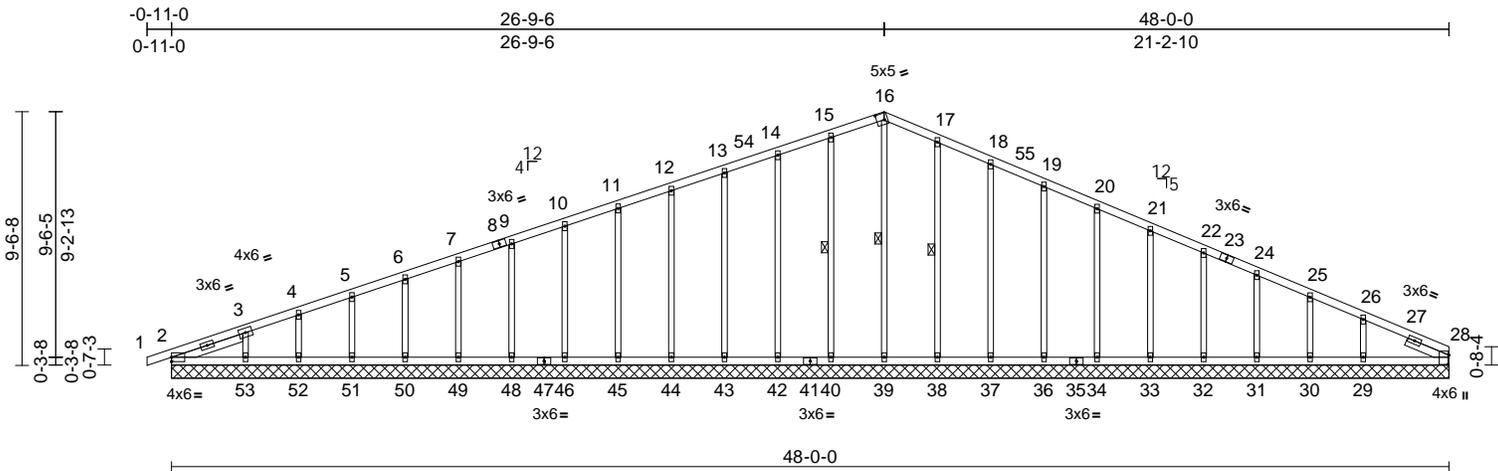

Scale = 1:86.1

Plate Offsets (X, Y): [16:0-3-7,0-3-0], [28:0-4-3,0-0-7]

| Loading     | (psf) | Spacing         | 2-0-0           | CSI       | DEFL | in       | (loc) | l/defl | L/d | PLATES | GRIP           |          |
|-------------|-------|-----------------|-----------------|-----------|------|----------|-------|--------|-----|--------|----------------|----------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC        | 0.11 | Vert(LL) | n/a   | -      | n/a | 999    | MT20           | 244/190  |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC        | 0.08 | Vert(CT) | n/a   | -      | n/a | 999    |                |          |
| BCLL        | 0.0   | Rep Stress Incr | NO              | WB        | 0.22 | Horz(CT) | 0.01  | 28     | n/a | n/a    |                |          |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-SH |      |          |       |        |     |        | Weight: 242 lb | FT = 20% |

**LUMBER**  
 TOP CHORD 2x4 SP No.2 \*Except\* 23-28:2x4 SP 1650F 1.5E  
 BOT CHORD 2x4 SP No.2  
 OTHERS 2x3 SPF No.2  
 SLIDER Left 2x4 SPF No.3 -- 2-9-14, Right 2x4 SPF No.3 -- 1-8-10

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**WEBS** 1 Row at midpt 16-39, 15-40, 17-38

**REACTIONS** All bearings 48-0-0.  
 (lb) - Max Horiz 2=169 (LC 16)  
 Max Uplift All uplift 100 (lb) or less at joint(s)  
 2, 30, 31, 32, 33, 34, 36, 37, 38, 40, 42, 43, 44, 45, 46, 48, 49, 50, 51, 52, 53 except 29=107 (LC 13)  
 Max Grav All reactions 250 (lb) or less at joint (s) 2, 28, 30, 31, 32, 33, 34, 36, 37, 38, 39, 40, 42, 43, 44, 45, 46, 48, 49, 50, 51, 52, 53 except 29=285 (LC 26)

**FORCES** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 14-15=-110/277, 15-16=-121/301, 16-17=-124/296

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=35ft; Ke=0.96; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-11-0 to 4-1-0, Exterior(2N) 4-1-0 to 26-9-6, Corner(3R) 26-9-6 to 31-9-6, Exterior(2N) 31-9-6 to 48-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



June 30, 2023


**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,  
**09/28/2023 10:59:26**

|                              |     |     |                          |           |
|------------------------------|-----|-----|--------------------------|-----------|
| Truss Type                   | Qty | Ply | Roof - Osage Lot 15      | 159271045 |
| Roof Special Supported Gable | 4   | 1   | Job Reference (optional) |           |

Run: 8.63 E Jun 15 2023 Print: 8.630 E Jun 15 2023 MiTek Industries, Inc. Thu Jun 29 15:00:42 Page: 1  
 ID:kkw6VMCTKypJEPYbi576Oz\_rGt-kSgLfmcX0lEr5eZ7o4GV0laBYe6PWh5iMTPTWcZ1OEK

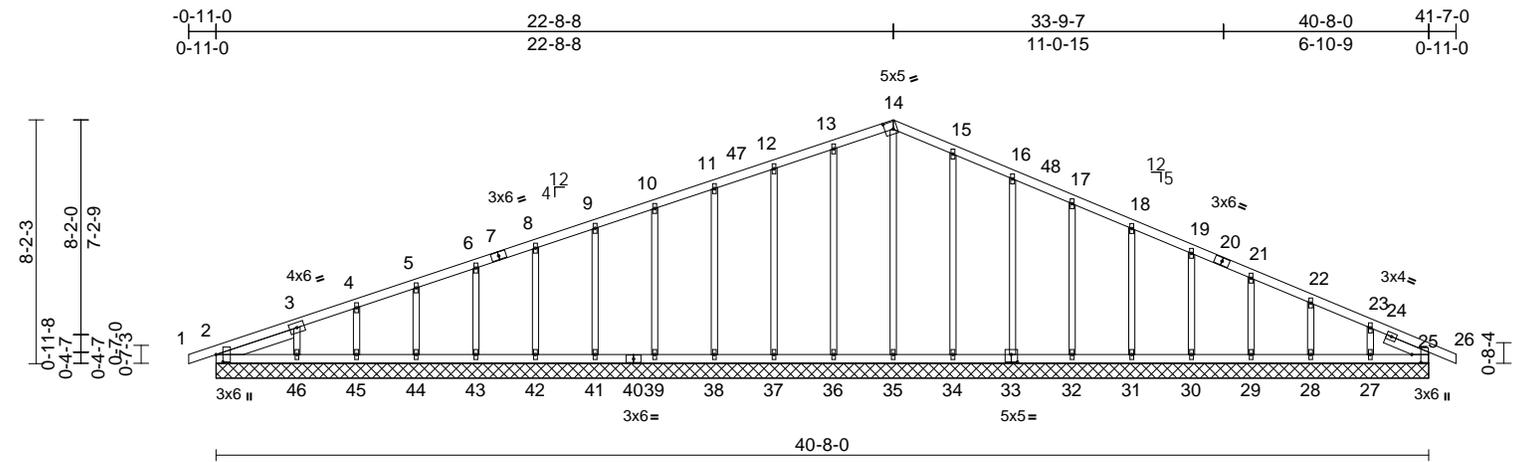

Scale = 1:76.9  
 Plate Offsets (X, Y): [2:0-3-0,0-2-12], [14:0-3-7,0-3-0], [25:0-3-4,0-3-10], [33:0-2-8,0-3-0]

| Loading     | (psf) | Spacing         | 1-11-4          | CSI       | DEFL | in       | (loc) | l/defl | L/d | PLATES | GRIP           |          |
|-------------|-------|-----------------|-----------------|-----------|------|----------|-------|--------|-----|--------|----------------|----------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC        | 0.07 | Vert(LL) | n/a   | -      | n/a | 999    | MT20           | 244/190  |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC        | 0.05 | Vert(CT) | n/a   | -      | n/a | 999    |                |          |
| BCLL        | 0.0   | Rep Stress Incr | NO              | WB        | 0.21 | Horz(CT) | 0.01  | 25     | n/a | n/a    |                |          |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-SH |      |          |       |        |     |        | Weight: 197 lb | FT = 20% |

**LUMBER**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 OTHERS 2x3 SPF No.2  
 SLIDER Left 2x4 SPF No.3 -- 2-8-15

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** All bearings 40-8-0.  
 (lb) - Max Horiz 2=139 (LC 12)  
 Max Uplift All uplift 100 (lb) or less at joint(s) 2, 25, 27, 28, 29, 30, 31, 32, 33, 34, 36, 37, 38, 39, 41, 42, 43, 44, 45, 46  
 Max Grav All reactions 250 (lb) or less at joint (s) 2, 25, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 41, 42, 43, 44, 45, 46

**FORCES** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES**  
 1) Unbalanced roof live loads have been considered for this design.  
 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=35ft; Ke=0.96; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-11-0 to 4-1-0, Exterior(2N) 4-1-0 to 22-8-8, Corner(3R) 22-8-8 to 27-8-8, Exterior(2N) 27-8-8 to 41-7-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.  
 4) All plates are 1.5x4 MT20 unless otherwise indicated.  
 5) Gable requires continuous bottom chord bearing.  
 6) Gable studs spaced at 2-0-0 oc.  
 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.  
 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.  
**LOAD CASE(S)** Standard




June 30, 2023

**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hill, KS - 66083,  
 09/28/2023 10:59:26

|              |     |     |                          |           |
|--------------|-----|-----|--------------------------|-----------|
| Truss Type   | Qty | Ply | Roof - Osage Lot 15      | I59271046 |
| Roof Special | 8   | 1   | Job Reference (optional) |           |

Run: 8.63 S Apr 6 2023 Print: 8.630 S Apr 6 2023 MiTek Industries, Inc. Thu Jun 29 13:03:50 Page: 1  
 ID:kkw6VMCTKypIjEPYbi576Oz\_rGt-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCdoi7J4zJC?f

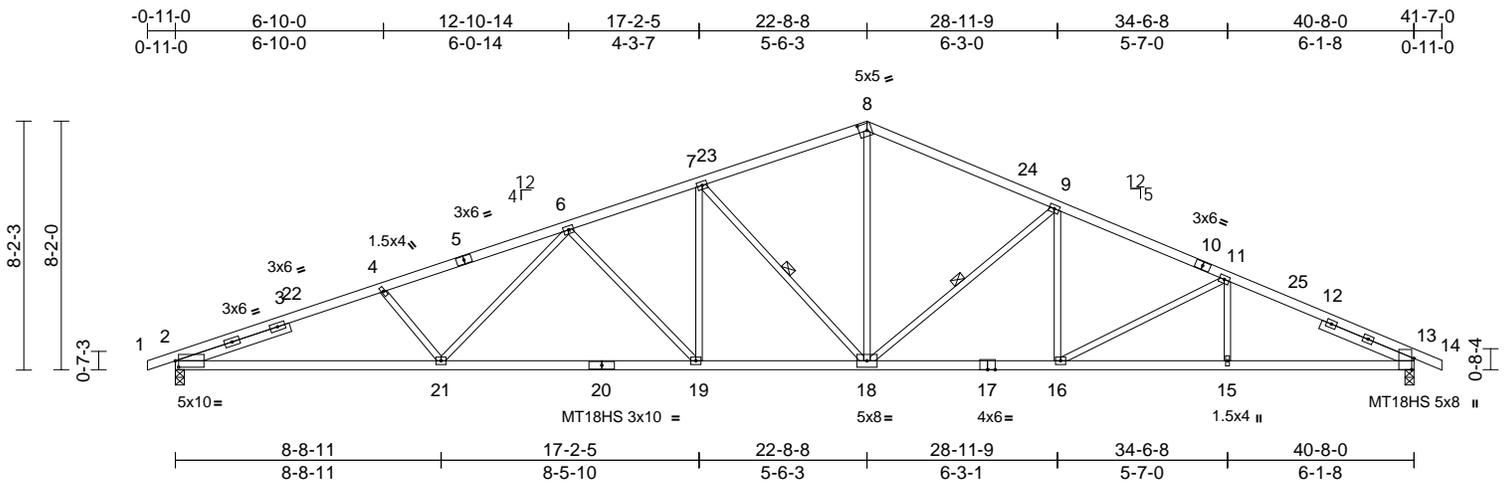

Scale = 1:75.3  
 Plate Offsets (X, Y): [2:0-1-4,0-2-8], [8:0-3-3,0-2-12], [13:0-4-7,Edge]

| Loading     | (psf) | Spacing         | 2-0-0           | CSI       | DEFL | in (loc) | l/defl | L/d   | PLATES | GRIP |        |                         |
|-------------|-------|-----------------|-----------------|-----------|------|----------|--------|-------|--------|------|--------|-------------------------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC        | 0.83 | Vert(LL) | -0.34  | 19-21 | >999   | 240  | MT20   | 244/190                 |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC        | 0.88 | Vert(CT) | -0.69  | 19-21 | >710   | 180  | MT18HS | 197/144                 |
| BCLL        | 0.0   | Rep Stress Incr | NO              | WB        | 0.69 | Horz(CT) | 0.21   | 13    | n/a    | n/a  |        |                         |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-SH |      |          |        |       |        |      |        | Weight: 183 lb FT = 20% |

**LUMBER**  
 TOP CHORD 2x4 SP 1650F 1.5E  
 BOT CHORD 2x4 SP 1650F 1.5E \*Except\* 0-0:2x4 SP No.2  
 WEBS 2x3 SPF No.2  
 SLIDER Left 2x4 SPF No.3 -- 3-11-3, Right 2x4 SPF No.3 -- 3-3-8

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 2-7-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 8-2-0 oc bracing.  
 WEBS 1 Row at midpt 7-18, 9-18

**REACTIONS** (size) 2=0-3-8, 13=0-3-8  
 Max Horiz 2=144 (LC 12)  
 Max Uplift 2=-344 (LC 8), 13=-264 (LC 13)  
 Max Grav 2=1894 (LC 1), 13=1894 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/0, 2-4=-4384/911, 4-6=-4144/869, 6-7=-3258/745, 7-8=-2539/651, 8-9=-2640/660, 9-11=-3243/727, 11-13=-3668/761, 13-14=0/0  
 BOT CHORD 2-21=-768/4045, 19-21=-609/3519, 18-19=-476/3041, 16-18=-493/2955, 15-16=-589/3228, 13-15=-589/3228  
 WEBS 4-21=-312/204, 8-18=-266/1373, 6-19=-708/229, 7-18=-1047/269, 6-21=-72/563, 7-19=-82/662, 11-16=-379/151, 9-18=-820/251, 9-16=0/349, 11-15=0/202

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=35ft; Ke=0.96; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 4-1-0, Interior (1) 4-1-0 to 22-8-8, Exterior(2R) 22-8-8 to 27-8-8, Interior (1) 27-8-8 to 41-7-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - All plates are MT20 plates unless otherwise indicated.
  - All plates are 3x4 MT20 unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - All bearings are assumed to be SP 1650F 1.5E crushing capacity of 565 psi.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard

**NOTES**  
 1) Unbalanced roof live loads have been considered for this design.




**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hill, KS - 66083,  
 09/28/2023 10:59:26

|                        |     |     |                          |           |
|------------------------|-----|-----|--------------------------|-----------|
| Truss Type             | Qty | Ply | Roof - Osage Lot 15      | 159271047 |
| Common Supported Gable | 2   | 1   | Job Reference (optional) |           |

Run: 8.63 S Apr 6 2023 Print: 8.630 S Apr 6 2023 MiTek Industries, Inc. Thu Jun 29 13:03:50 Page: 1  
 ID:kkw6VMCTKypIjEPYbi576Oz\_rGt-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCdoi7J4zJC?f

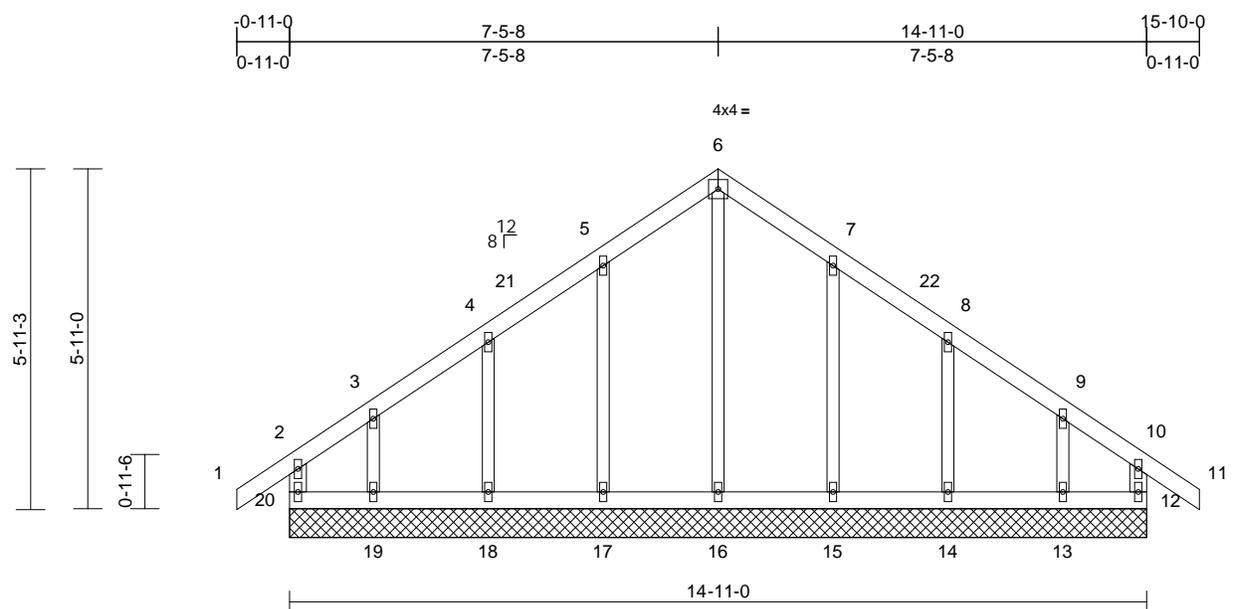

| Loading     | (psf) | Spacing         | 2-0-0           | CSI      | DEFL | in   | (loc) | l/defl | L/d | PLATES        | GRIP     |
|-------------|-------|-----------------|-----------------|----------|------|------|-------|--------|-----|---------------|----------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC       | 0.10 | n/a  | -     | n/a    | 999 | MT20          | 244/190  |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC       | 0.06 | n/a  | -     | n/a    | 999 |               |          |
| BCLL        | 0.0   | Rep Stress Incr | NO              | WB       | 0.14 | 0.00 | 12    | n/a    | n/a |               |          |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-R |      |      |       |        |     | Weight: 72 lb | FT = 20% |

**LUMBER**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 WEBS 2x4 SP No.2  
 OTHERS 2x3 SPF No.2

**BRACING**  
 TOP CHORD Sheathed or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS** (size)  
 12=14-11-0, 13=14-11-0,  
 14=14-11-0, 15=14-11-0,  
 16=14-11-0, 17=14-11-0,  
 18=14-11-0, 19=14-11-0,  
 20=14-11-0  
 Max Horiz 20=179 (LC 10)  
 Max Uplift 12=55 (LC 9), 13=105 (LC 13),  
 14=72 (LC 13), 15=74 (LC 13),  
 17=75 (LC 12), 18=71 (LC 12),  
 19=112 (LC 12), 20=81 (LC 8)  
 Max Grav 12=154 (LC 19), 13=176 (LC 20),  
 14=189 (LC 20), 15=197 (LC 20),  
 16=194 (LC 22), 17=198 (LC 19),  
 18=187 (LC 19), 19=189 (LC 19),  
 20=176 (LC 20)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 2-20=-143/90, 1-2=0/41, 2-3=-110/106,  
 3-4=-80/84, 4-5=-77/164, 5-6=-116/242,  
 6-7=-116/242, 7-8=-76/163, 8-9=-59/78,  
 9-10=-81/76, 10-11=0/41, 10-12=-132/89  
 BOT CHORD 19-20=-82/90, 18-19=-82/90, 17-18=-82/90,  
 16-17=-82/90, 15-16=-82/90, 14-15=-82/90,  
 13-14=-82/90, 12-13=-82/90  
 WEBS 6-16=-180/30, 5-17=-157/118,  
 4-18=-149/154, 3-19=-133/126,  
 7-15=-156/118, 8-14=-151/154,  
 9-13=-127/127

**NOTES**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=0.96; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-11-0 to 4-1-0, Exterior(2N) 4-1-0 to 7-5-8, Corner(3R) 7-5-8 to 12-5-8, Exterior(2N) 12-5-8 to 15-10-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard




June 30, 2023

**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hill, KS - 66083,  
 09/28/2023 10:59:27

|                        |     |     |                          |           |
|------------------------|-----|-----|--------------------------|-----------|
| Truss Type             | Qty | Ply | Roof - Osage Lot 15      | 159271048 |
| Common Supported Gable | 1   | 1   | Job Reference (optional) |           |

Run: 8.63 S Apr 6 2023 Print: 8.630 S Apr 6 2023 MiTek Industries, Inc. Thu Jun 29 13:03:50 Page: 1  
 ID:kkw6VMCTKypIjEPYbi576Oz\_rGt-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCdoi7J4zJC?f

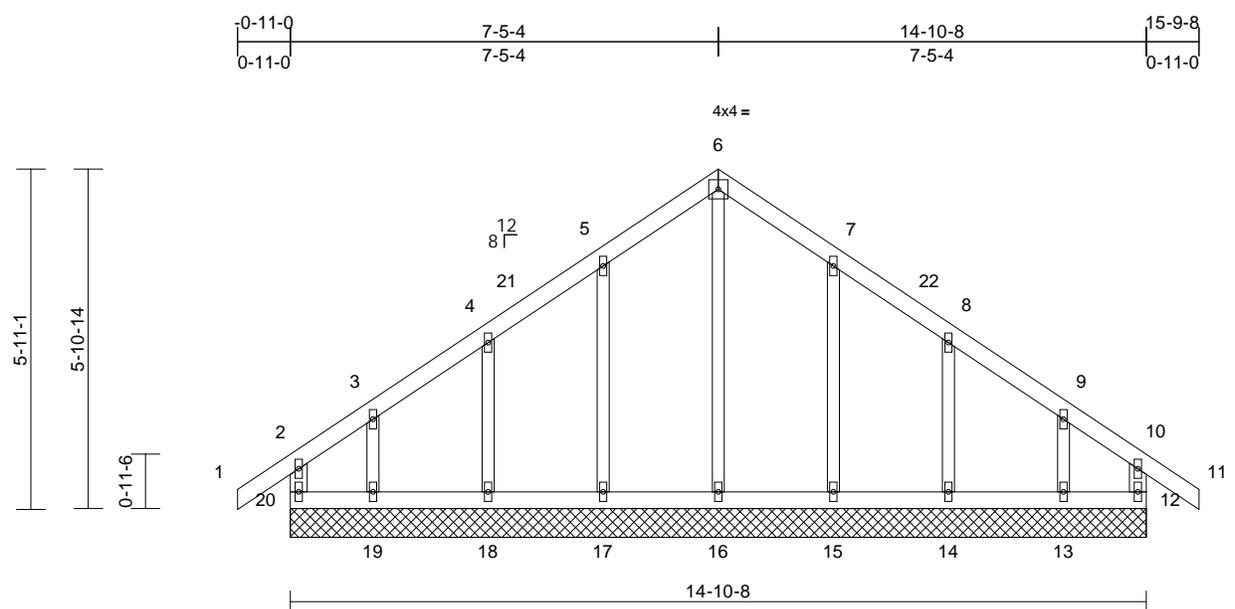

| Loading     | (psf) | Spacing         | 2-0-0           | CSI      | DEFL | in       | (loc) | l/defl | L/d | PLATES | GRIP          |          |
|-------------|-------|-----------------|-----------------|----------|------|----------|-------|--------|-----|--------|---------------|----------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC       | 0.10 | Vert(LL) | n/a   | -      | n/a | 999    | MT20          | 244/190  |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC       | 0.06 | Vert(CT) | n/a   | -      | n/a | 999    |               |          |
| BCLL        | 0.0   | Rep Stress Incr | NO              | WB       | 0.13 | Horz(CT) | 0.00  | 12     | n/a | n/a    |               |          |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-R |      |          |       |        |     |        | Weight: 71 lb | FT = 20% |

**LUMBER**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 WEBS 2x4 SP No.2  
 OTHERS 2x3 SPF No.2

**BRACING**  
 TOP CHORD Sheathed or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS** (size)  
 12=14-10-8, 13=14-10-8,  
 14=14-10-8, 15=14-10-8,  
 16=14-10-8, 17=14-10-8,  
 18=14-10-8, 19=14-10-8,  
 20=14-10-8  
 Max Horiz 20=179 (LC 10)  
 Max Uplift 12=55 (LC 9), 13=105 (LC 13),  
 14=72 (LC 13), 15=74 (LC 13),  
 17=75 (LC 12), 18=71 (LC 12),  
 19=112 (LC 12), 20=82 (LC 8)  
 Max Grav 12=154 (LC 19), 13=175 (LC 20),  
 14=189 (LC 20), 15=197 (LC 20),  
 16=194 (LC 22), 17=198 (LC 19),  
 18=187 (LC 19), 19=188 (LC 19),  
 20=176 (LC 20)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 2-20=-143/89, 1-2=0/41, 2-3=-110/107,  
 3-4=-79/84, 4-5=-76/163, 5-6=-116/241,  
 6-7=-116/241, 7-8=-76/162, 8-9=-59/77,  
 9-10=-81/76, 10-11=0/41, 10-12=-131/88  
 BOT CHORD 19-20=-82/90, 18-19=-82/90, 17-18=-82/90,  
 16-17=-82/90, 15-16=-82/90, 14-15=-82/90,  
 13-14=-82/90, 12-13=-82/90  
 WEBS 6-16=-179/29, 5-17=-157/118,  
 4-18=-149/154, 3-19=-132/125,  
 7-15=-156/118, 8-14=-151/154,  
 9-13=-126/126

**NOTES**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=0.96; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-11-0 to 4-1-0, Exterior(2N) 4-1-0 to 7-5-4, Corner(3R) 7-5-4 to 12-5-4, Exterior(2N) 12-5-4 to 15-9-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard




June 30, 2023

**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hill, KS - 66083,  
 09/28/2023 10:59:27

|               |     |     |                          |           |
|---------------|-----|-----|--------------------------|-----------|
| Truss Type    | Qty | Ply | Roof - Osage Lot 15      | 159271049 |
| Common Girder | 2   | 3   | Job Reference (optional) |           |

Run: 8.63 S Apr 6 2023 Print: 8.630 S Apr 6 2023 MiTek Industries, Inc. Thu Jun 29 13:03:51 Page: 1  
 ID:kkw6VMCTKypIjEPYbi576Oz\_rGt-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCdoi7J4zJC?f

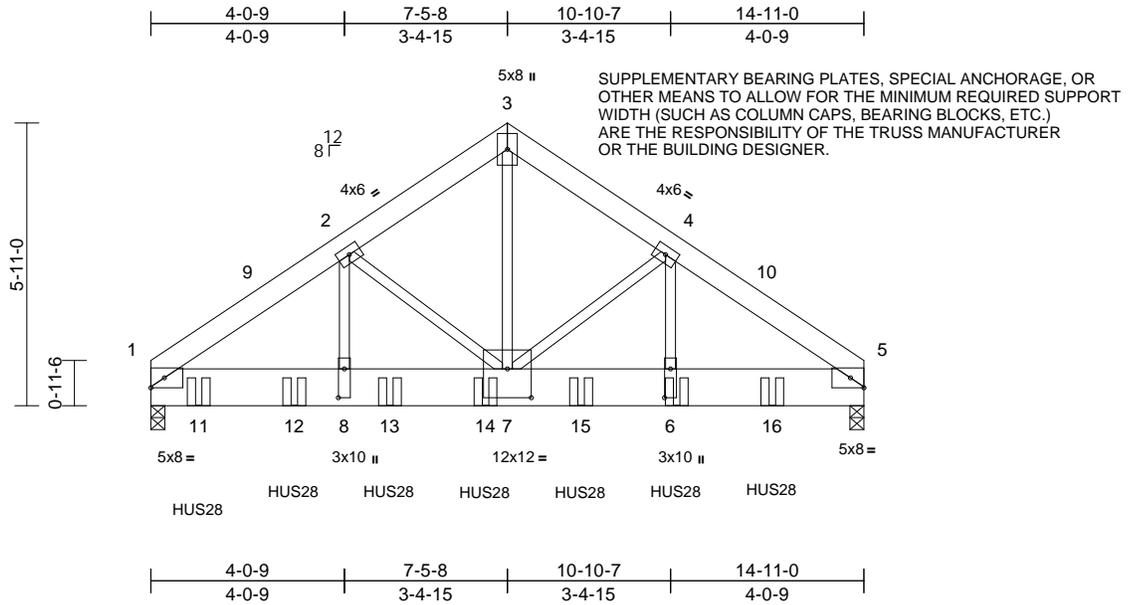

Scale = 1:48

Plate Offsets (X, Y): [6:0-7-4,0-1-8], [7:0-6-0,0-7-4], [8:0-7-4,0-1-8]

| Loading     | (psf) | Spacing         | 2-0-0           | CSI       | DEFL | in       | (loc) | l/defl | L/d  | PLATES | GRIP                    |
|-------------|-------|-----------------|-----------------|-----------|------|----------|-------|--------|------|--------|-------------------------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC        | 0.25 | Vert(LL) | -0.05 | 6-7    | >999 | 240    | MT20 185/144            |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC        | 0.60 | Vert(CT) | -0.09 | 6-7    | >999 | 180    |                         |
| BCLL        | 0.0   | Rep Stress Incr | NO              | WB        | 0.89 | Horz(CT) | 0.03  | 5      | n/a  | n/a    |                         |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-SH |      |          |       |        |      |        | Weight: 280 lb FT = 20% |

**LUMBER**  
 TOP CHORD 2x6 SPF No.2  
 BOT CHORD 2x10 HF No.2  
 WEBS 2x3 SPF No.2

**BRACING**  
 TOP CHORD Sheathed or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 1=0-3-8, (req. 0-4-12), 5=0-3-8, (req. 0-4-3)  
 Max Horiz 1=142 (LC 8)  
 Max Uplift 1=1190 (LC 12), 5=1055 (LC 13)  
 Max Grav 1=8618 (LC 1), 5=7642 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=10110/1451, 2-3=7457/1138, 3-4=7454/1138, 4-5=10042/1442  
 BOT CHORD 1-8=1130/7977, 7-8=1133/8003, 6-7=1081/7937, 5-6=1078/7911  
 WEBS 2-8=432/3405, 2-7=2379/428, 3-7=1130/7738, 4-7=2291/419, 4-6=424/3326

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=35ft; Ke=0.96; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-1-12 to 5-1-12, Interior (1) 5-1-12 to 7-5-8, Exterior(2R) 7-5-8 to 12-5-8, Interior (1) 12-5-8 to 14-9-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Vert: 6=2133 (B), 11=2141 (B), 12=2133 (B), 13=2133 (B), 14=2133 (B), 15=2133 (B), 16=2139 (B)
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- WARNING: Required bearing size at joint(s) 1, 5 greater than input bearing size.
- All bearings are assumed to be SPF No.2 crushing capacity of 425 psi.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Use Simpson Strong-Tie HUS28 (22-16d Girder, 4-16d Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 1-0-0 from the left end to 13-0-0 to connect truss(es) to back face of bottom chord.
- N/A

**NOTES**

- 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
 Bottom chords connected as follows: 2x10 - 4 rows staggered at 0-4-0 oc.  
 Web connected as follows: 2x3 - 1 row at 0-4-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.

**LOAD CASE(S)** Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (lb/ft)  
 Vert: 1-3=-70, 3-5=-70, 1-5=-20  
 Concentrated Loads (lb)



June 30, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSITPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
 Chesterfield, MO 63017

**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hill, KS - 66083,  
 09/28/2023 10:59:27

|                             |          |          |   |           |
|-----------------------------|----------|----------|---|-----------|
| Truss Type<br>Common Girder | Qty<br>1 | Ply<br>3 | Roof - Osage Lot 15<br>Job Reference (optional) | 159271050 |
|-----------------------------|----------|----------|---|-----------|

Run: 8.63 S Apr 6 2023 Print: 8.630 S Apr 6 2023 MiTek Industries, Inc. Thu Jun 29 13:03:52  
 ID:kkw6VMCTKypjEPYbi576Oz\_rGt-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCdoi7J4zJC?f

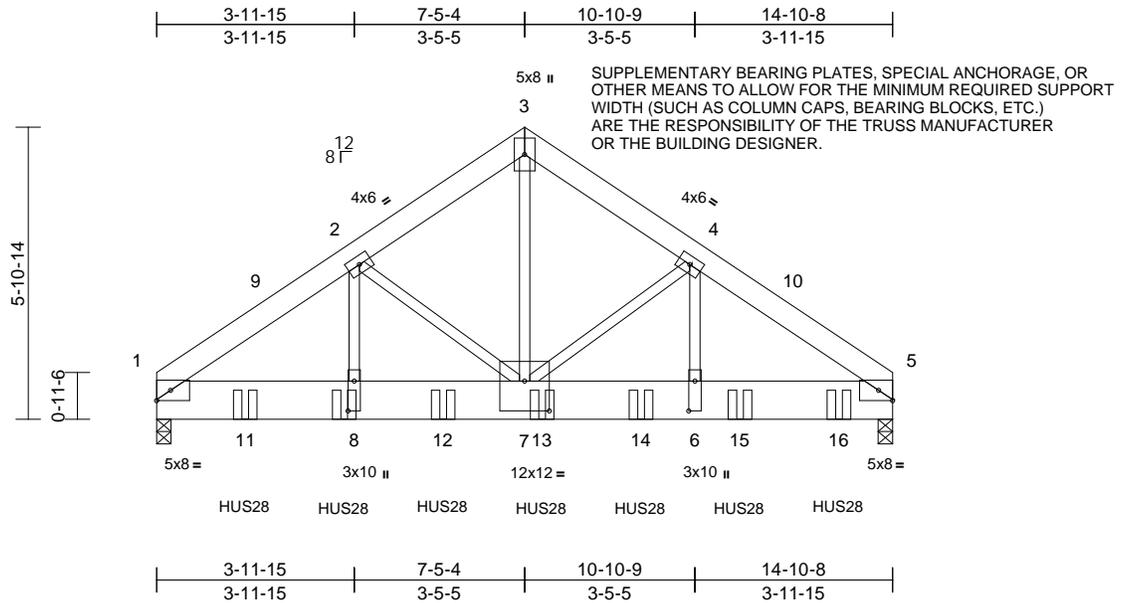

Scale = 1:46.3

Plate Offsets (X, Y): [6:0-7-4,0-1-8], [7:0-6-0,0-7-4], [8:0-7-4,0-1-8]

| Loading     | (psf) | Spacing         | 2-0-0           | CSI       | DEFL | in       | (loc) | l/defl | L/d  | PLATES | GRIP |                         |
|-------------|-------|-----------------|-----------------|-----------|------|----------|-------|--------|------|--------|------|-------------------------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC        | 0.24 | Vert(LL) | -0.05 | 7-8    | >999 | 240    | MT20 | 185/144                 |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC        | 0.59 | Vert(CT) | -0.09 | 7-8    | >999 | 180    |      |                         |
| BCLL        | 0.0   | Rep Stress Incr | NO              | WB        | 0.89 | Horz(CT) | 0.03  | 5      | n/a  | n/a    |      |                         |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-SH |      |          |       |        |      |        |      | Weight: 279 lb FT = 20% |

- LUMBER**  
 TOP CHORD 2x6 SPF No.2  
 BOT CHORD 2x10 HF No.2  
 WEBS 2x3 SPF No.2
- BRACING**  
 TOP CHORD Sheathed or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
- REACTIONS** (size) 1=0-3-8, (req. 0-4-4), 5=0-3-8, (req. 0-4-11)  
 Max Horiz 1=-142 (LC 31)  
 Max Uplift 1=-1047 (LC 12), 5=-1154 (LC 13)  
 Max Grav 1=7729 (LC 1), 5=8514 (LC 1)
- FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=-10075/1422, 2-3=-7471/1122, 3-4=-7474/1122, 4-5=-10122/1428  
 BOT CHORD 1-8=-1105/7933, 7-8=-1108/7959, 6-7=-1072/8007, 5-6=-1069/7981  
 WEBS 2-8=-412/3322, 2-7=-2284/409, 3-7=-1111/7756, 4-7=-2347/421, 4-6=-422/3374
- 4) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=35ft; Ke=0.96; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-1-12 to 5-1-12, Interior (1) 5-1-12 to 7-5-4, Exterior(2R) 7-5-4 to 12-5-4, Interior (1) 12-5-4 to 14-8-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60  
 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.  
 6) WARNING: Required bearing size at joint(s) 1, 5 greater than input bearing size.  
 7) All bearings are assumed to be SPF No.2 crushing capacity of 425 psi.  
 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.  
 9) Use Simpson Strong-Tie HUS28 (22-16d Girder, 4-16d Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 1-9-8 from the left end to 13-9-8 to connect truss(es) to back face of bottom chord.  
 10) N/A
- Vert: 8=-2133 (B), 11=-2133 (B), 12=-2133 (B), 13=-2133 (B), 14=-2133 (B), 15=-2133 (B), 16=-2133 (B)

**NOTES**

- 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
 Bottom chords connected as follows: 2x10 - 4 rows staggered at 0-4-0 oc.  
 Web connected as follows: 2x3 - 1 row at 0-4-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.

**LOAD CASE(S)** Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (lb/ft)  
 Vert: 1-3=-70, 3-5=-70, 1-5=-20  
 Concentrated Loads (lb)



June 30, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSITPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
 Chesterfield, MO 63017

**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,  
 09/28/2023 10:59:27

|            |     |     |                          |           |
|------------|-----|-----|--------------------------|-----------|
| Truss Type | Qty | Ply | Roof - Osage Lot 15      | I59271051 |
| Valley     | 2   | 1   | Job Reference (optional) |           |

Run: 8.63 S Apr 6 2023 Print: 8.630 S Apr 6 2023 MiTek Industries, Inc. Thu Jun 29 13:03:52 Page: 1  
 ID:kkw6VMCTKypIjEPYbi576Oz\_rGt-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCdoi7J4zJC?f

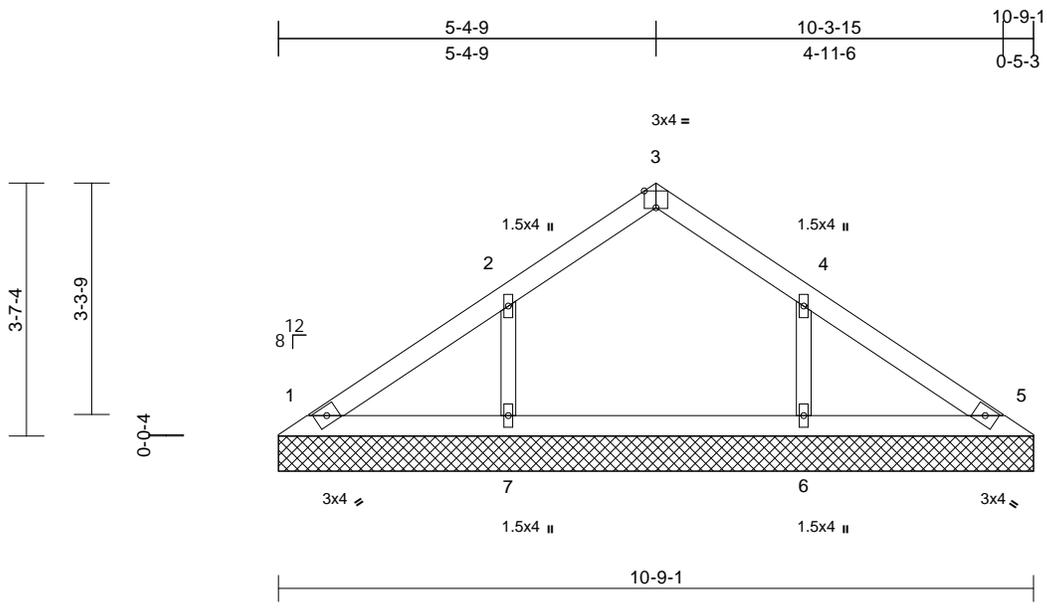

Scale = 1:32.7

Plate Offsets (X, Y): [3:0-2-0,Edge], [4:0-0-0,Edge]

| Loading     | (psf) | Spacing         | 2-0-0           | CSI       | DEFL | in        | (loc) | l/defl | L/d | PLATES | GRIP          |          |
|-------------|-------|-----------------|-----------------|-----------|------|-----------|-------|--------|-----|--------|---------------|----------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC        | 0.12 | Vert(LL)  | n/a   | -      | n/a | 999    | MT20          | 244/190  |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC        | 0.12 | Vert(TL)  | n/a   | -      | n/a | 999    |               |          |
| BCLL        | 0.0   | Rep Stress Incr | NO              | WB        | 0.04 | Horiz(TL) | 0.00  | 5      | n/a | n/a    |               |          |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-SH |      |           |       |        |     |        | Weight: 36 lb | FT = 20% |

**LUMBER**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 OTHERS 2x3 SPF No.2

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 1=10-9-1, 5=10-9-1, 6=10-9-1, 7=10-9-1  
 Max Horiz 1=89 (LC 9)  
 Max Uplift 6=-95 (LC 13), 7=-97 (LC 12)  
 Max Grav 1=151 (LC 1), 5=151 (LC 1), 6=304 (LC 20), 7=306 (LC 19)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=-150/33, 2-3=-147/61, 3-4=-147/61, 4-5=-148/30  
 BOT CHORD 1-7=-24/110, 6-7=-24/110, 5-6=-24/110  
 WEBS 2-7=-215/156, 4-6=-214/152

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=35ft; Ke=0.96; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 4) Gable requires continuous bottom chord bearing.
  - 5) Gable studs spaced at 4-0-0 oc.

- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard




June 30, 2023

**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hill, KS - 66083,  
 09/28/2023 10:59:28

|            |     |     |                          |           |
|------------|-----|-----|--------------------------|-----------|
| Truss Type | Qty | Ply | Roof - Osage Lot 15      | I59271052 |
| Valley     | 2   | 1   | Job Reference (optional) |           |

Run: 8.63 S Apr 6 2023 Print: 8.630 S Apr 6 2023 MiTek Industries, Inc. Thu Jun 29 13:03:52 Page: 1  
 ID:7VegtUg48?DqlhT5TOJ?Mz8aV1-RfC?PsB70Hq3NSgPqnl8w3ulTXbGKWrCDoi7J4zJC?f

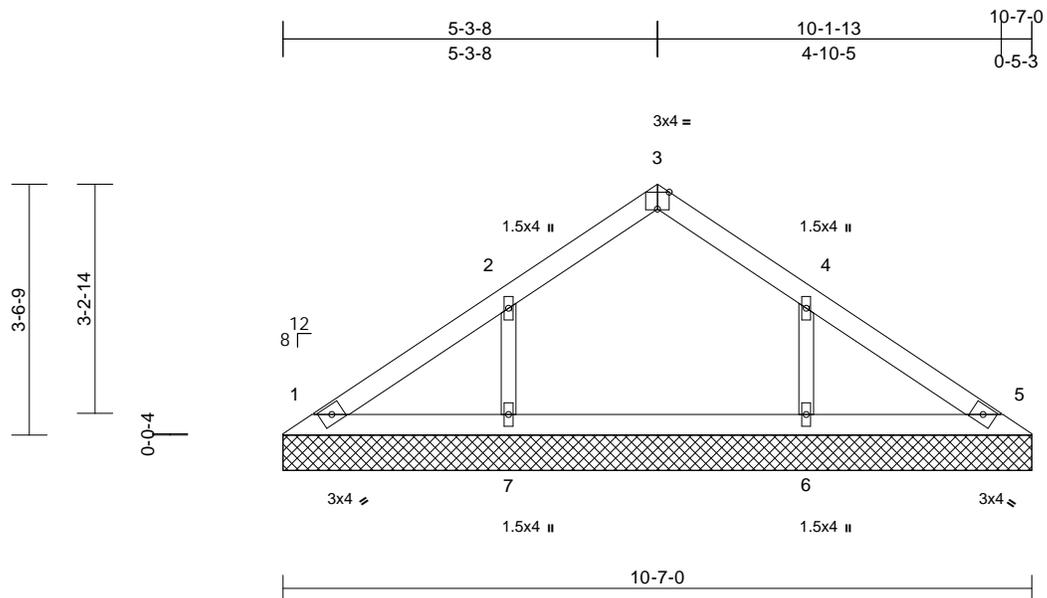

Scale = 1:32.4

Plate Offsets (X, Y): [3:0-2-0,Edge], [4:0-0-0,Edge]

| Loading     | (psf) | Spacing         | 2-0-0           | CSI       | DEFL | in        | (loc) | l/defl | L/d | PLATES | GRIP          |          |
|-------------|-------|-----------------|-----------------|-----------|------|-----------|-------|--------|-----|--------|---------------|----------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC        | 0.11 | Vert(LL)  | n/a   | -      | n/a | 999    | MT20          | 244/190  |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC        | 0.12 | Vert(TL)  | n/a   | -      | n/a | 999    |               |          |
| BCLL        | 0.0*  | Rep Stress Incr | NO              | WB        | 0.04 | Horiz(TL) | 0.00  | 5      | n/a | n/a    |               |          |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-SH |      |           |       |        |     |        | Weight: 36 lb | FT = 20% |

**LUMBER**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 OTHERS 2x3 SPF No.2

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 1=10-7-0, 5=10-7-0, 6=10-7-0, 7=10-7-0  
 Max Horiz 1=90 (LC 8)  
 Max Uplift 6=99 (LC 13), 7=100 (LC 12)  
 Max Grav 1=149 (LC 1), 5=149 (LC 1), 6=301 (LC 20), 7=302 (LC 19)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=-150/33, 2-3=-149/65, 3-4=-149/65, 4-5=-148/29  
 BOT CHORD 1-7=-24/111, 6-7=-24/111, 5-6=-24/111  
 WEBS 2-7=-212/161, 4-6=-211/157

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 4) Gable requires continuous bottom chord bearing.
  - 5) Gable studs spaced at 4-0-0 oc.

- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - 8) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
  - 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard




June 30, 2023

**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hill, KS - 66083,  
 09/28/2023 10:59:28

|            |     |     |                          |           |
|------------|-----|-----|--------------------------|-----------|
| Truss Type | Qty | Ply | Roof - Osage Lot 15      | 159271053 |
| Valley     | 2   | 1   | Job Reference (optional) |           |

Run: 8.63 S Apr 6 2023 Print: 8.630 S Apr 6 2023 MiTek Industries, Inc. Thu Jun 29 13:03:53 Page: 1  
 ID:ty0?Hnm2CiRkdX6xatJFZiz8aVz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f

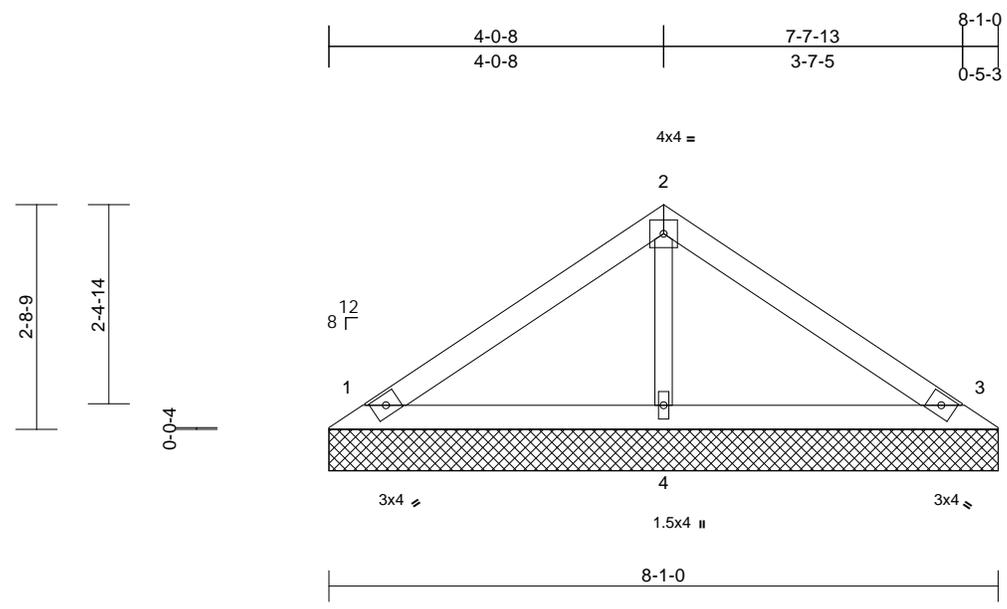

| Loading     | (psf) | Spacing         | 2-0-0           | CSI      | DEFL | in        | (loc) | l/defl | L/d | PLATES | GRIP          |          |
|-------------|-------|-----------------|-----------------|----------|------|-----------|-------|--------|-----|--------|---------------|----------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC       | 0.33 | Vert(LL)  | n/a   | -      | n/a | 999    | MT20          | 244/190  |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC       | 0.14 | Vert(TL)  | n/a   | -      | n/a | 999    |               |          |
| BCLL        | 0.0*  | Rep Stress Incr | NO              | WB       | 0.04 | Horiz(TL) | 0.00  | 3      | n/a | n/a    |               |          |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-P |      |           |       |        |     |        | Weight: 27 lb | FT = 20% |

**LUMBER**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 OTHERS 2x3 SPF No.2

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 1=8-1-0, 3=8-1-0, 4=8-1-0  
 Max Horiz 1=-67 (LC 8)  
 Max Uplift 1=-46 (LC 12), 3=-54 (LC 13)  
 Max Grav 1=182 (LC 1), 3=182 (LC 1), 4=283 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=-114/67, 2-3=-109/67  
 BOT CHORD 1-4=-14/54, 3-4=-14/54  
 WEBS 2-4=-193/99

7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.  
 8) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.  
 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

**NOTES**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 4-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.




June 30, 2023

**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hill, KS - 66083,  
 09/28/2023 10:59:28

|            |     |     |                          |           |
|------------|-----|-----|--------------------------|-----------|
| Truss Type | Qty | Ply | Roof - Osage Lot 15      | I59271054 |
| Valley     | 2   | 1   | Job Reference (optional) |           |

Run: 8.63 S Apr 6 2023 Print: 8.630 S Apr 6 2023 MiTek Industries, Inc. Thu Jun 29 13:03:53 Page: 1  
 ID:Lt2xwJZ?zoQ?i4tteW0UwKz8aWD-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

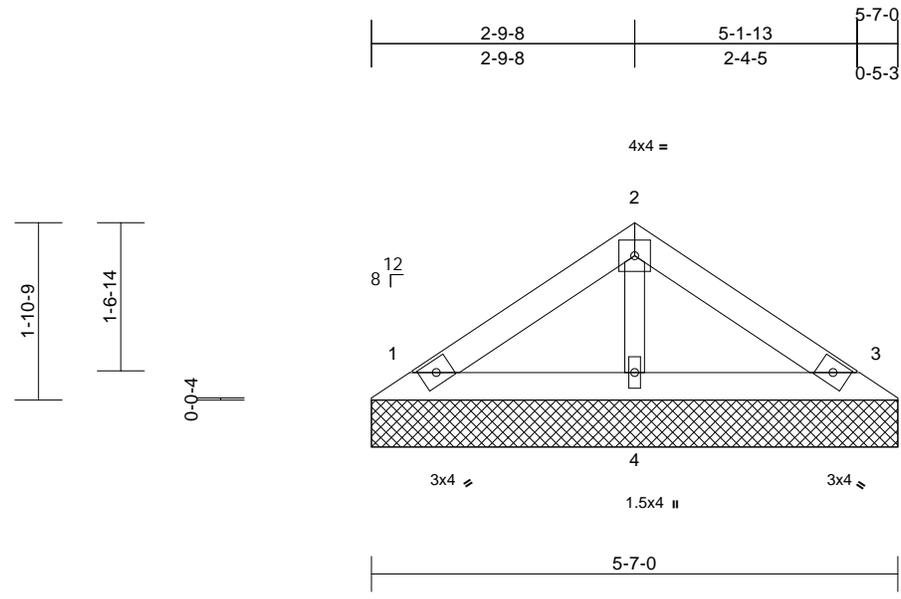

Scale = 1:24.3

| Loading     | (psf) | Spacing         | 2-0-0           | CSI      | DEFL | in        | (loc) | l/defl | L/d | PLATES | GRIP          |          |
|-------------|-------|-----------------|-----------------|----------|------|-----------|-------|--------|-----|--------|---------------|----------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC       | 0.13 | Vert(LL)  | n/a   | -      | n/a | 999    | MT20          | 244/190  |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC       | 0.06 | Vert(TL)  | n/a   | -      | n/a | 999    |               |          |
| BCLL        | 0.0*  | Rep Stress Incr | NO              | WB       | 0.02 | Horiz(TL) | 0.00  | 3      | n/a | n/a    |               |          |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-P |      |           |       |        |     |        | Weight: 18 lb | FT = 20% |

**LUMBER**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 OTHERS 2x3 SPF No.2

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 5-7-12 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 1=5-7-0, 3=5-7-0, 4=5-7-0  
 Max Horiz 1=-44 (LC 10)  
 Max Uplift 1=-30 (LC 12), 3=-35 (LC 13)  
 Max Grav 1=119 (LC 1), 3=119 (LC 1), 4=184 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=-74/51, 2-3=-71/51  
 BOT CHORD 1-4=-9/35, 3-4=-9/35  
 WEBS 2-4=-126/80

- 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 8) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard



June 30, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hill, KS - 66083,  
**09/28/2023 10:59:28**

|            |     |     |                          |           |
|------------|-----|-----|--------------------------|-----------|
| Truss Type | Qty | Ply | Roof - Osage Lot 15      | 159271055 |
| Valley     | 1   | 1   | Job Reference (optional) |           |

Run: 8.63 S Apr 6 2023 Print: 8.630 S Apr 6 2023 MiTek Industries, Inc. Thu Jun 29 13:03:53 Page: 1  
 ID:kkw6VMCTKypIjEPYbi576Oz\_rGt-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

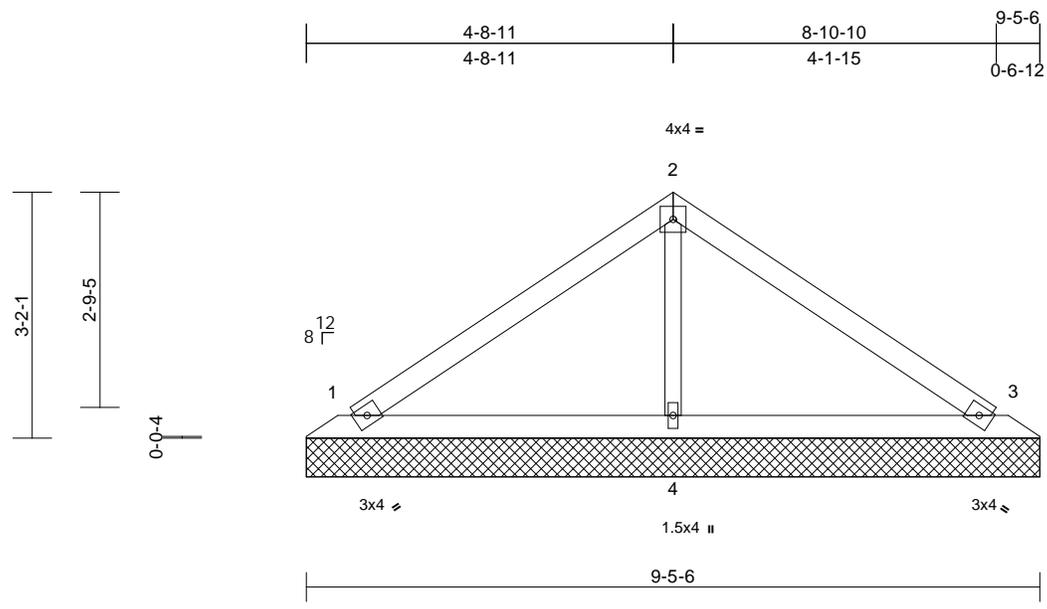

Scale = 1:29.5

| Loading     | (psf) | Spacing         | 2-0-0           | CSI       | DEFL | in        | (loc) | l/defl | L/d | PLATES | GRIP          |          |
|-------------|-------|-----------------|-----------------|-----------|------|-----------|-------|--------|-----|--------|---------------|----------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC        | 0.28 | Vert(LL)  | n/a   | -      | n/a | 999    | MT20          | 244/190  |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC        | 0.20 | Vert(TL)  | n/a   | -      | n/a | 999    |               |          |
| BCLL        | 0.0   | Rep Stress Incr | NO              | WB        | 0.05 | Horiz(TL) | 0.00  | 3      | n/a | n/a    |               |          |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-SH |      |           |       |        |     |        | Weight: 31 lb | FT = 20% |

**LUMBER**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 OTHERS 2x3 SPF No.2

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 1=9-5-6, 3=9-5-6, 4=9-5-6  
 Max Horiz 1=-77 (LC 8)  
 Max Uplift 1=-35 (LC 12), 3=-44 (LC 13), 4=-24 (LC 12)  
 Max Grav 1=187 (LC 1), 3=187 (LC 1), 4=362 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=-146/72, 2-3=-145/72  
 BOT CHORD 1-4=-15/64, 3-4=-15/64  
 WEBS 2-4=-216/88

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=35ft; Ke=0.96; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 4) Gable requires continuous bottom chord bearing.
  - 5) Gable studs spaced at 4-0-0 oc.
  - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 7) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



June 30, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hill, KS - 66083,  
 09/28/2023 10:59:28

|            |     |     |                          |           |
|------------|-----|-----|--------------------------|-----------|
| Truss Type | Qty | Ply | Roof - Osage Lot 15      | 159271056 |
| Valley     | 1   | 1   | Job Reference (optional) |           |

Run: 8.63 S Apr 6 2023 Print: 8.630 S Apr 6 2023 MiTek Industries, Inc. Thu Jun 29 13:03:53 Page: 1  
 ID:kMINMaimlEuxpo9ltz4U4\_z8aSh-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwRCDoi7J4zJC?f

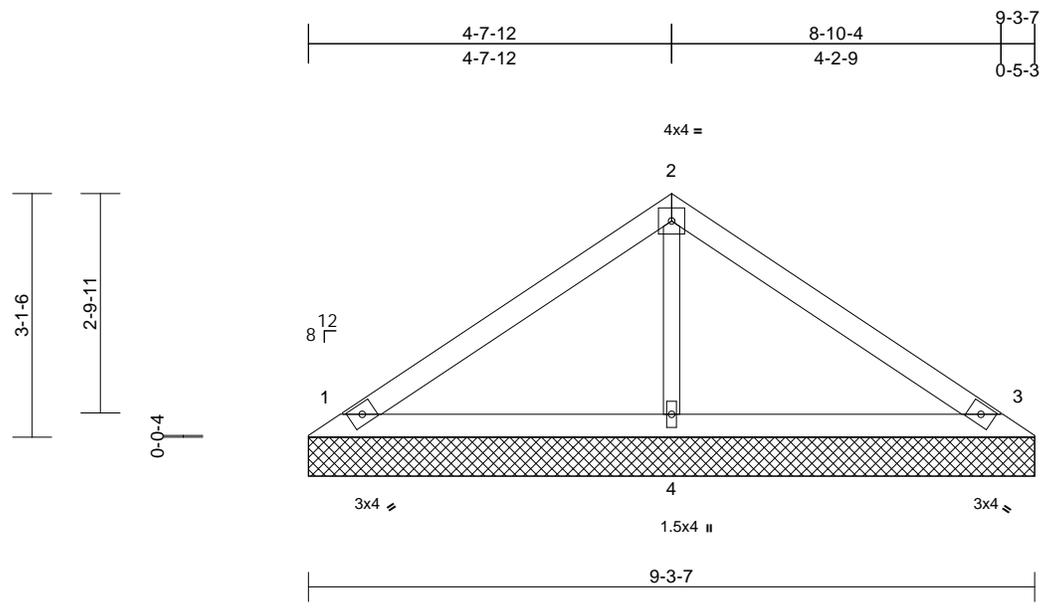

Scale = 1:29.3

| Loading     | (psf) | Spacing         | 2-0-0           | CSI       | DEFL | in        | (loc) | l/defl | L/d | PLATES | GRIP          |          |
|-------------|-------|-----------------|-----------------|-----------|------|-----------|-------|--------|-----|--------|---------------|----------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC        | 0.29 | Vert(LL)  | n/a   | -      | n/a | 999    | MT20          | 244/190  |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC        | 0.21 | Vert(TL)  | n/a   | -      | n/a | 999    |               |          |
| BCLL        | 0.0*  | Rep Stress Incr | NO              | WB        | 0.06 | Horiz(TL) | 0.00  | 3      | n/a | n/a    |               |          |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-SH |      |           |       |        |     |        | Weight: 31 lb | FT = 20% |

**LUMBER**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 OTHERS 2x3 SPF No.2

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 1=9-3-7, 3=9-3-7, 4=9-3-7  
 Max Horiz 1=78 (LC 9)  
 Max Uplift 1=-39 (LC 12), 3=-49 (LC 13), 4=-30 (LC 12)  
 Max Grav 1=189 (LC 1), 3=189 (LC 1), 4=377 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=-145/75, 2-3=-143/75  
 BOT CHORD 1-4=-15/64, 3-4=-15/64  
 WEBS 2-4=-227/100

- 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - 8) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
  - 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 4) Gable requires continuous bottom chord bearing.
  - 5) Gable studs spaced at 4-0-0 oc.
  - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.




June 30, 2023

**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hill, KS - 66083,  
 09/28/2023 10:59:29

|            |     |     |                          |           |
|------------|-----|-----|--------------------------|-----------|
| Truss Type | Qty | Ply | Roof - Osage Lot 15      | I59271057 |
| Valley     | 1   | 1   | Job Reference (optional) |           |

Run: 8.63 S Apr 6 2023 Print: 8.630 S Apr 6 2023 MiTek Industries, Inc. Thu Jun 29 13:03:54  
 ID:c7yuCylHpTPNIQT46p9QEz8aSd-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoi7J4zJC?#

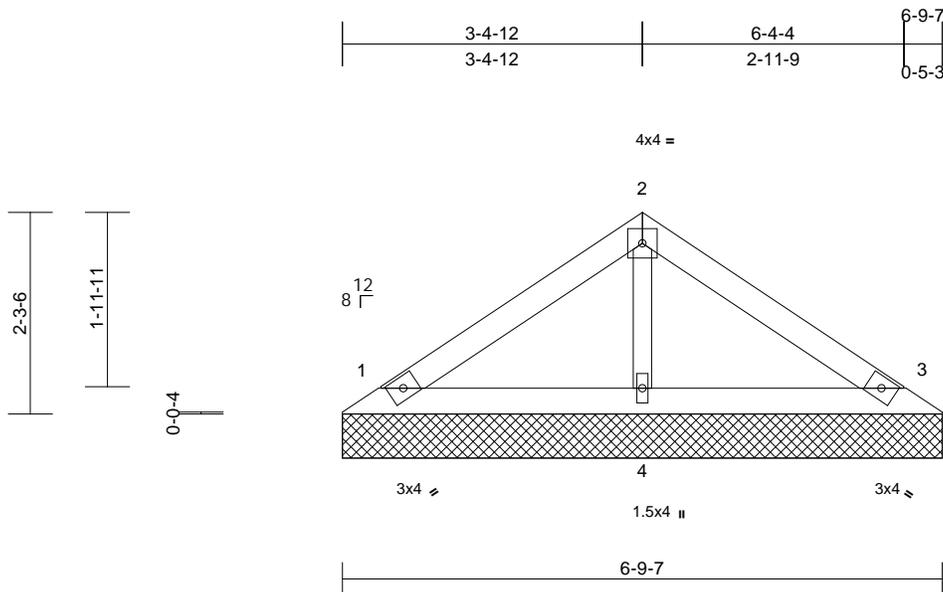

Scale = 1:25.9

| Loading     | (psf) | Spacing         | 2-0-0           | CSI      | DEFL | in        | (loc) | l/defl | L/d | PLATES | GRIP                   |
|-------------|-------|-----------------|-----------------|----------|------|-----------|-------|--------|-----|--------|------------------------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC       | 0.21 | Vert(LL)  | n/a   | -      | n/a | 999    | 244/190                |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC       | 0.10 | Vert(TL)  | n/a   | -      | n/a | 999    |                        |
| BCLL        | 0.0*  | Rep Stress Incr | NO              | WB       | 0.03 | Horiz(TL) | 0.00  | 3      | n/a | n/a    |                        |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-P |      |           |       |        |     |        | Weight: 22 lb FT = 20% |

**LUMBER**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 OTHERS 2x3 SPF No.2

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 1=6-9-7, 3=6-9-7, 4=6-9-7  
 Max Horiz 1=-55 (LC 10)  
 Max Uplift 1=-38 (LC 12), 3=-44 (LC 13)  
 Max Grav 1=149 (LC 1), 3=149 (LC 1), 4=232 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=-94/60, 2-3=-89/60  
 BOT CHORD 1-4=-11/44, 3-4=-11/44  
 WEBS 2-4=-158/91

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 4) Gable requires continuous bottom chord bearing.
  - 5) Gable studs spaced at 2-0-0 oc.
  - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - 8) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
  - 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard




June 30, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
 Premier Building Supply (Springhill, KS), Spring Hill, KS - 66083,  
 09/28/2023 10:59:29

|            |     |     |                          |           |
|------------|-----|-----|--------------------------|-----------|
| Truss Type | Qty | Ply | Roof - Osage Lot 15      | 159271058 |
| Valley     | 1   | 1   | Job Reference (optional) |           |

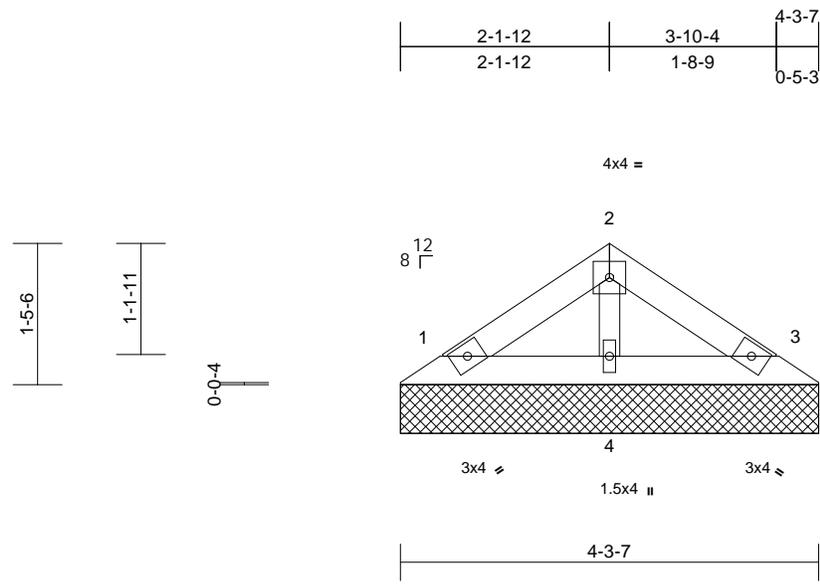

Scale = 1:23.5

| Loading     | (psf) | Spacing         | 2-0-0           | CSI      | DEFL | in        | (loc) | l/defl | L/d | PLATES | GRIP                   |
|-------------|-------|-----------------|-----------------|----------|------|-----------|-------|--------|-----|--------|------------------------|
| TCLL (roof) | 25.0  | Plate Grip DOL  | 1.15            | TC       | 0.06 | Vert(LL)  | n/a   | -      | n/a | 999    | 244/190                |
| TCDL        | 10.0  | Lumber DOL      | 1.15            | BC       | 0.03 | Vert(TL)  | n/a   | -      | n/a | 999    |                        |
| BCLL        | 0.0*  | Rep Stress Incr | NO              | WB       | 0.02 | Horiz(TL) | 0.00  | 3      | n/a | n/a    |                        |
| BCDL        | 10.0  | Code            | IRC2018/TPI2014 | Matrix-P |      |           |       |        |     |        | Weight: 13 lb FT = 20% |

**LUMBER**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 OTHERS 2x3 SPF No.2

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 4-4-3 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 1=4-3-7, 3=4-3-7, 4=4-3-7  
 Max Horiz 1=-32 (LC 8)  
 Max Uplift 1=-22 (LC 12), 3=-26 (LC 13)  
 Max Grav 1=86 (LC 1), 3=86 (LC 1), 4=133 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=-54/38, 2-3=-51/38  
 BOT CHORD 1-4=-7/25, 3-4=-7/25  
 WEBS 2-4=-91/60

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 4) Gable requires continuous bottom chord bearing.
  - 5) Gable studs spaced at 2-0-0 oc.
  - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.


- 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - 8) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
  - 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard




June 30, 2023

# Symbols

## PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

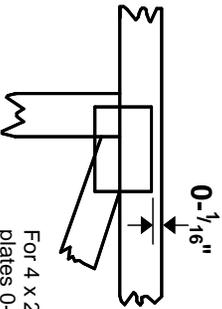

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.


\* Plate location details available in **MITek 20/20 software or upon request.**

## PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

## BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

## Industry Standards:

ANSI/TPI 1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
 SSPC: Design Standard for Bracing, Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System

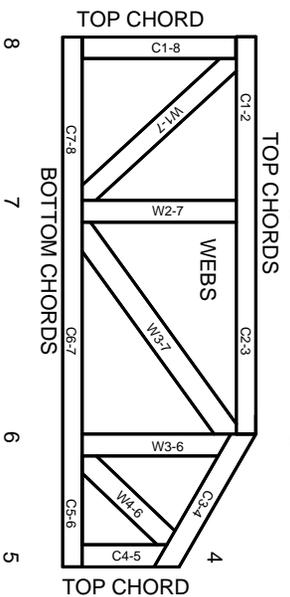

**JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.**

**CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.**

## PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988  
 ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TPI 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved

# General Safety Notes

## Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability/bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T or I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.



MITek Engineering Reference Sheet: Mill-7473 rev. 5/19/2020

RELEASE FOR CONSTRUCTION  
 AS NOTED ON PLANS REVIEW  
 DEVELOPMENT SERVICES  
 LEE'S SUBMIT MISSOURI  
 09/28/2023 10:59:20