


ROOF PLAN  
1/8" = 1'-0"  
ROOF PITCHES 6/12 U.N.O.  
RAFTERS 2 X 6 DF NO 2 @ 16" OC TYP.  
HIPS AND RIDGES 2 X 8 DF NO 2 TYP.  
SOFFITS 12" TYP.



LEFT EL.  
1/8" = 1'-0"

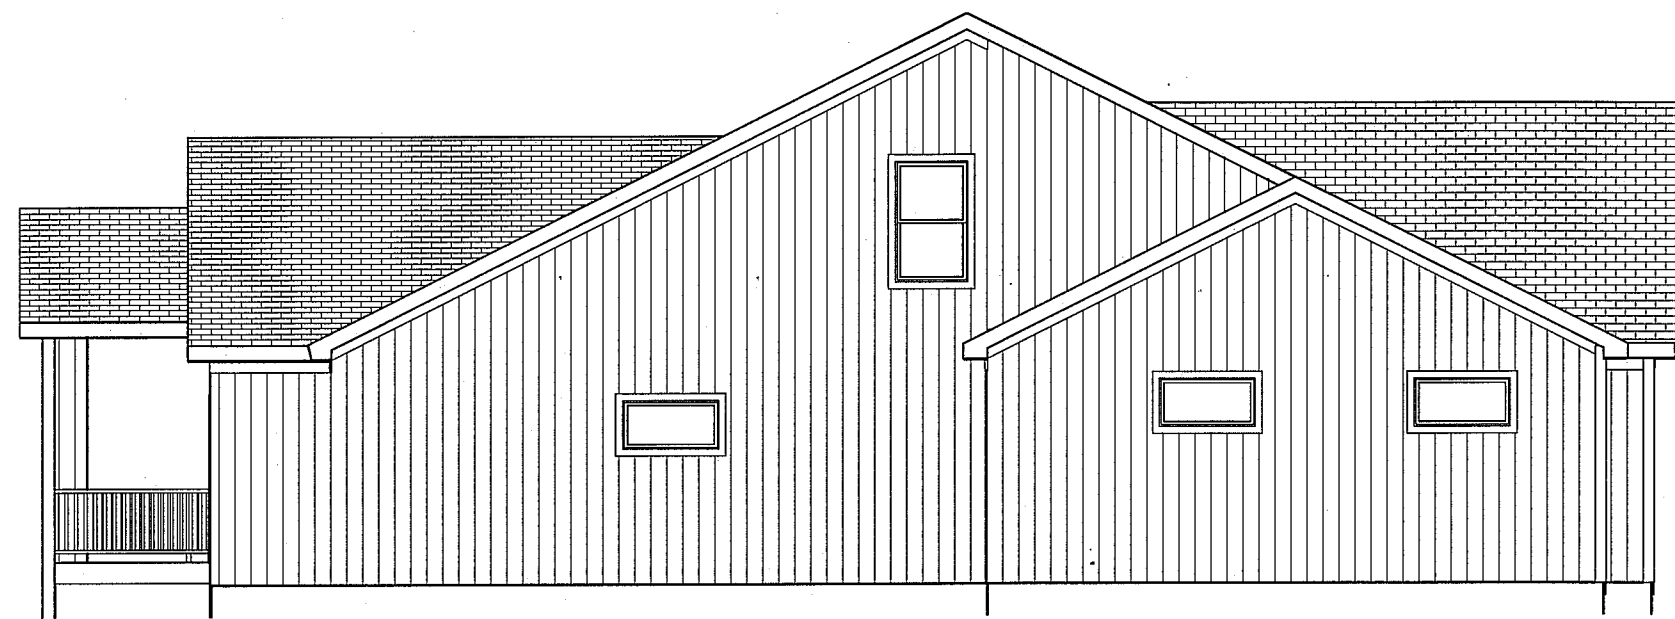


GARAGE DOOR TBD BY OWNER

FRONT EL.


BLACK WINDOWS



REAR EL.  
1/8" = 1'-0"

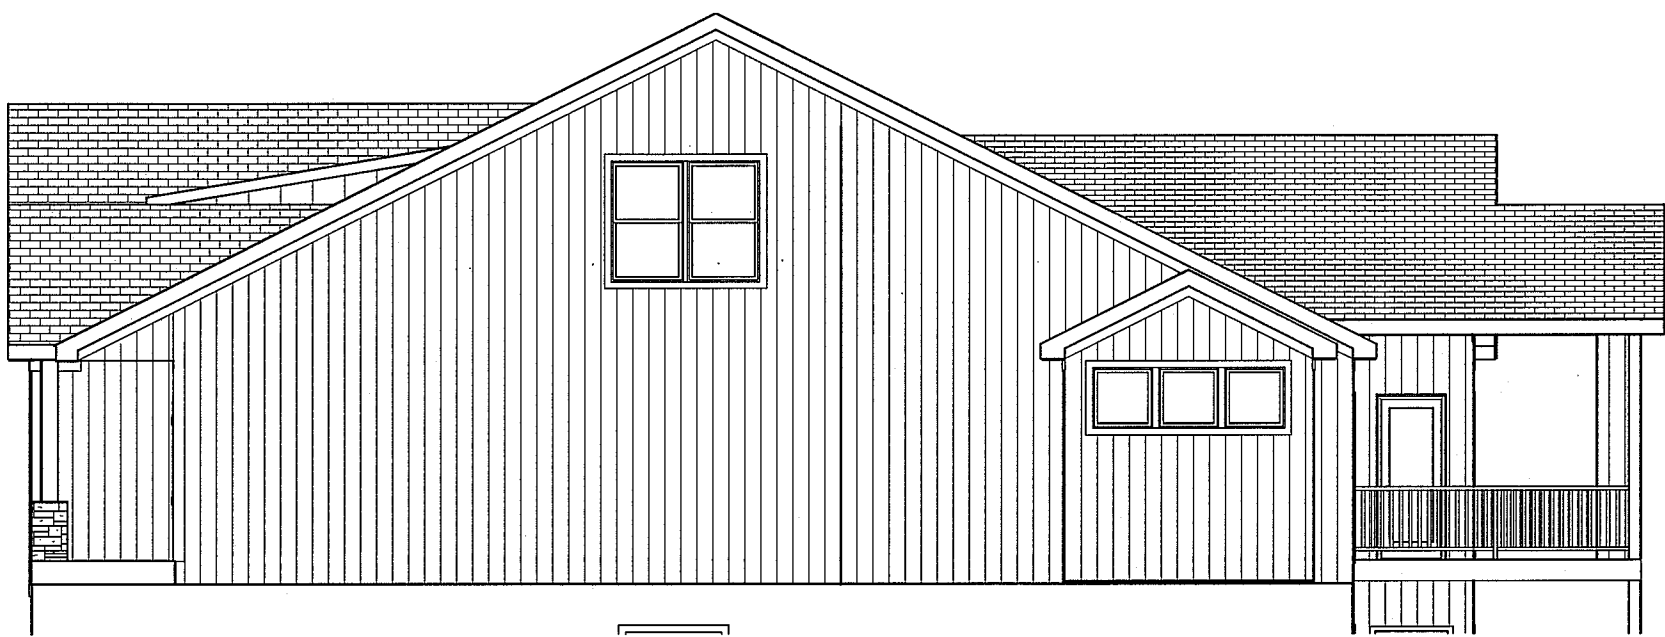

RIGHT EL.  
1/8" = 1'-0"

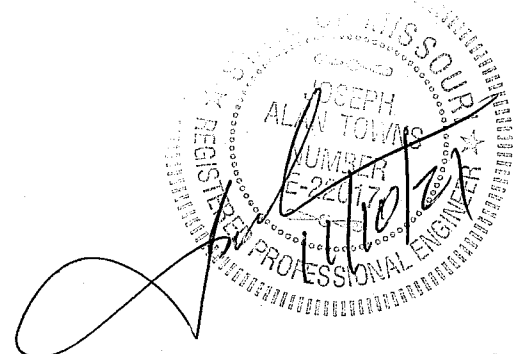

JOSEPH A. TOWNS P.E.  
MO. LIC E 22017  
PROFESSIONAL SEAL  
APPLIES TO STRUCTURAL  
ELEMENTS ONLY

BUILD IN ACCORDANCE WITH  
2018 INTERNATIONAL  
RESIDENTIAL CODE AND  
LOCAL CODES.

BEHOME LLC  
NOELLE PLAN  
LACKEY RES.  
LOT 31 HOOK FARM  
2047 SW HOOK FARM DR  
LEE SUMMIT MO

SCALE  
1/4" = 1'-0"

DATE  
11-11-21

PLAN NO.

3643

SHEET NO.


10/09/2023




NOELLE PLAN  
LACKEY RES.  
LOT 31 HOOK FARM  
2047 SW HOOK FARM DR  
LEE SUMMIT MO

2 OF 5

JOSEPH A. TOWNS P.E.  
MO. LIC E 22017  
PROFESSIONAL SEAL  
APPLIES TO STRUCTURAL  
ELEMENTS ONLY

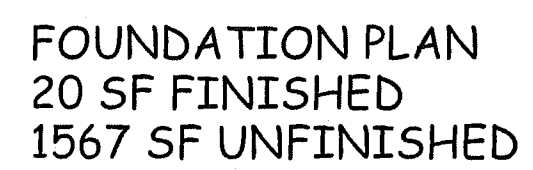




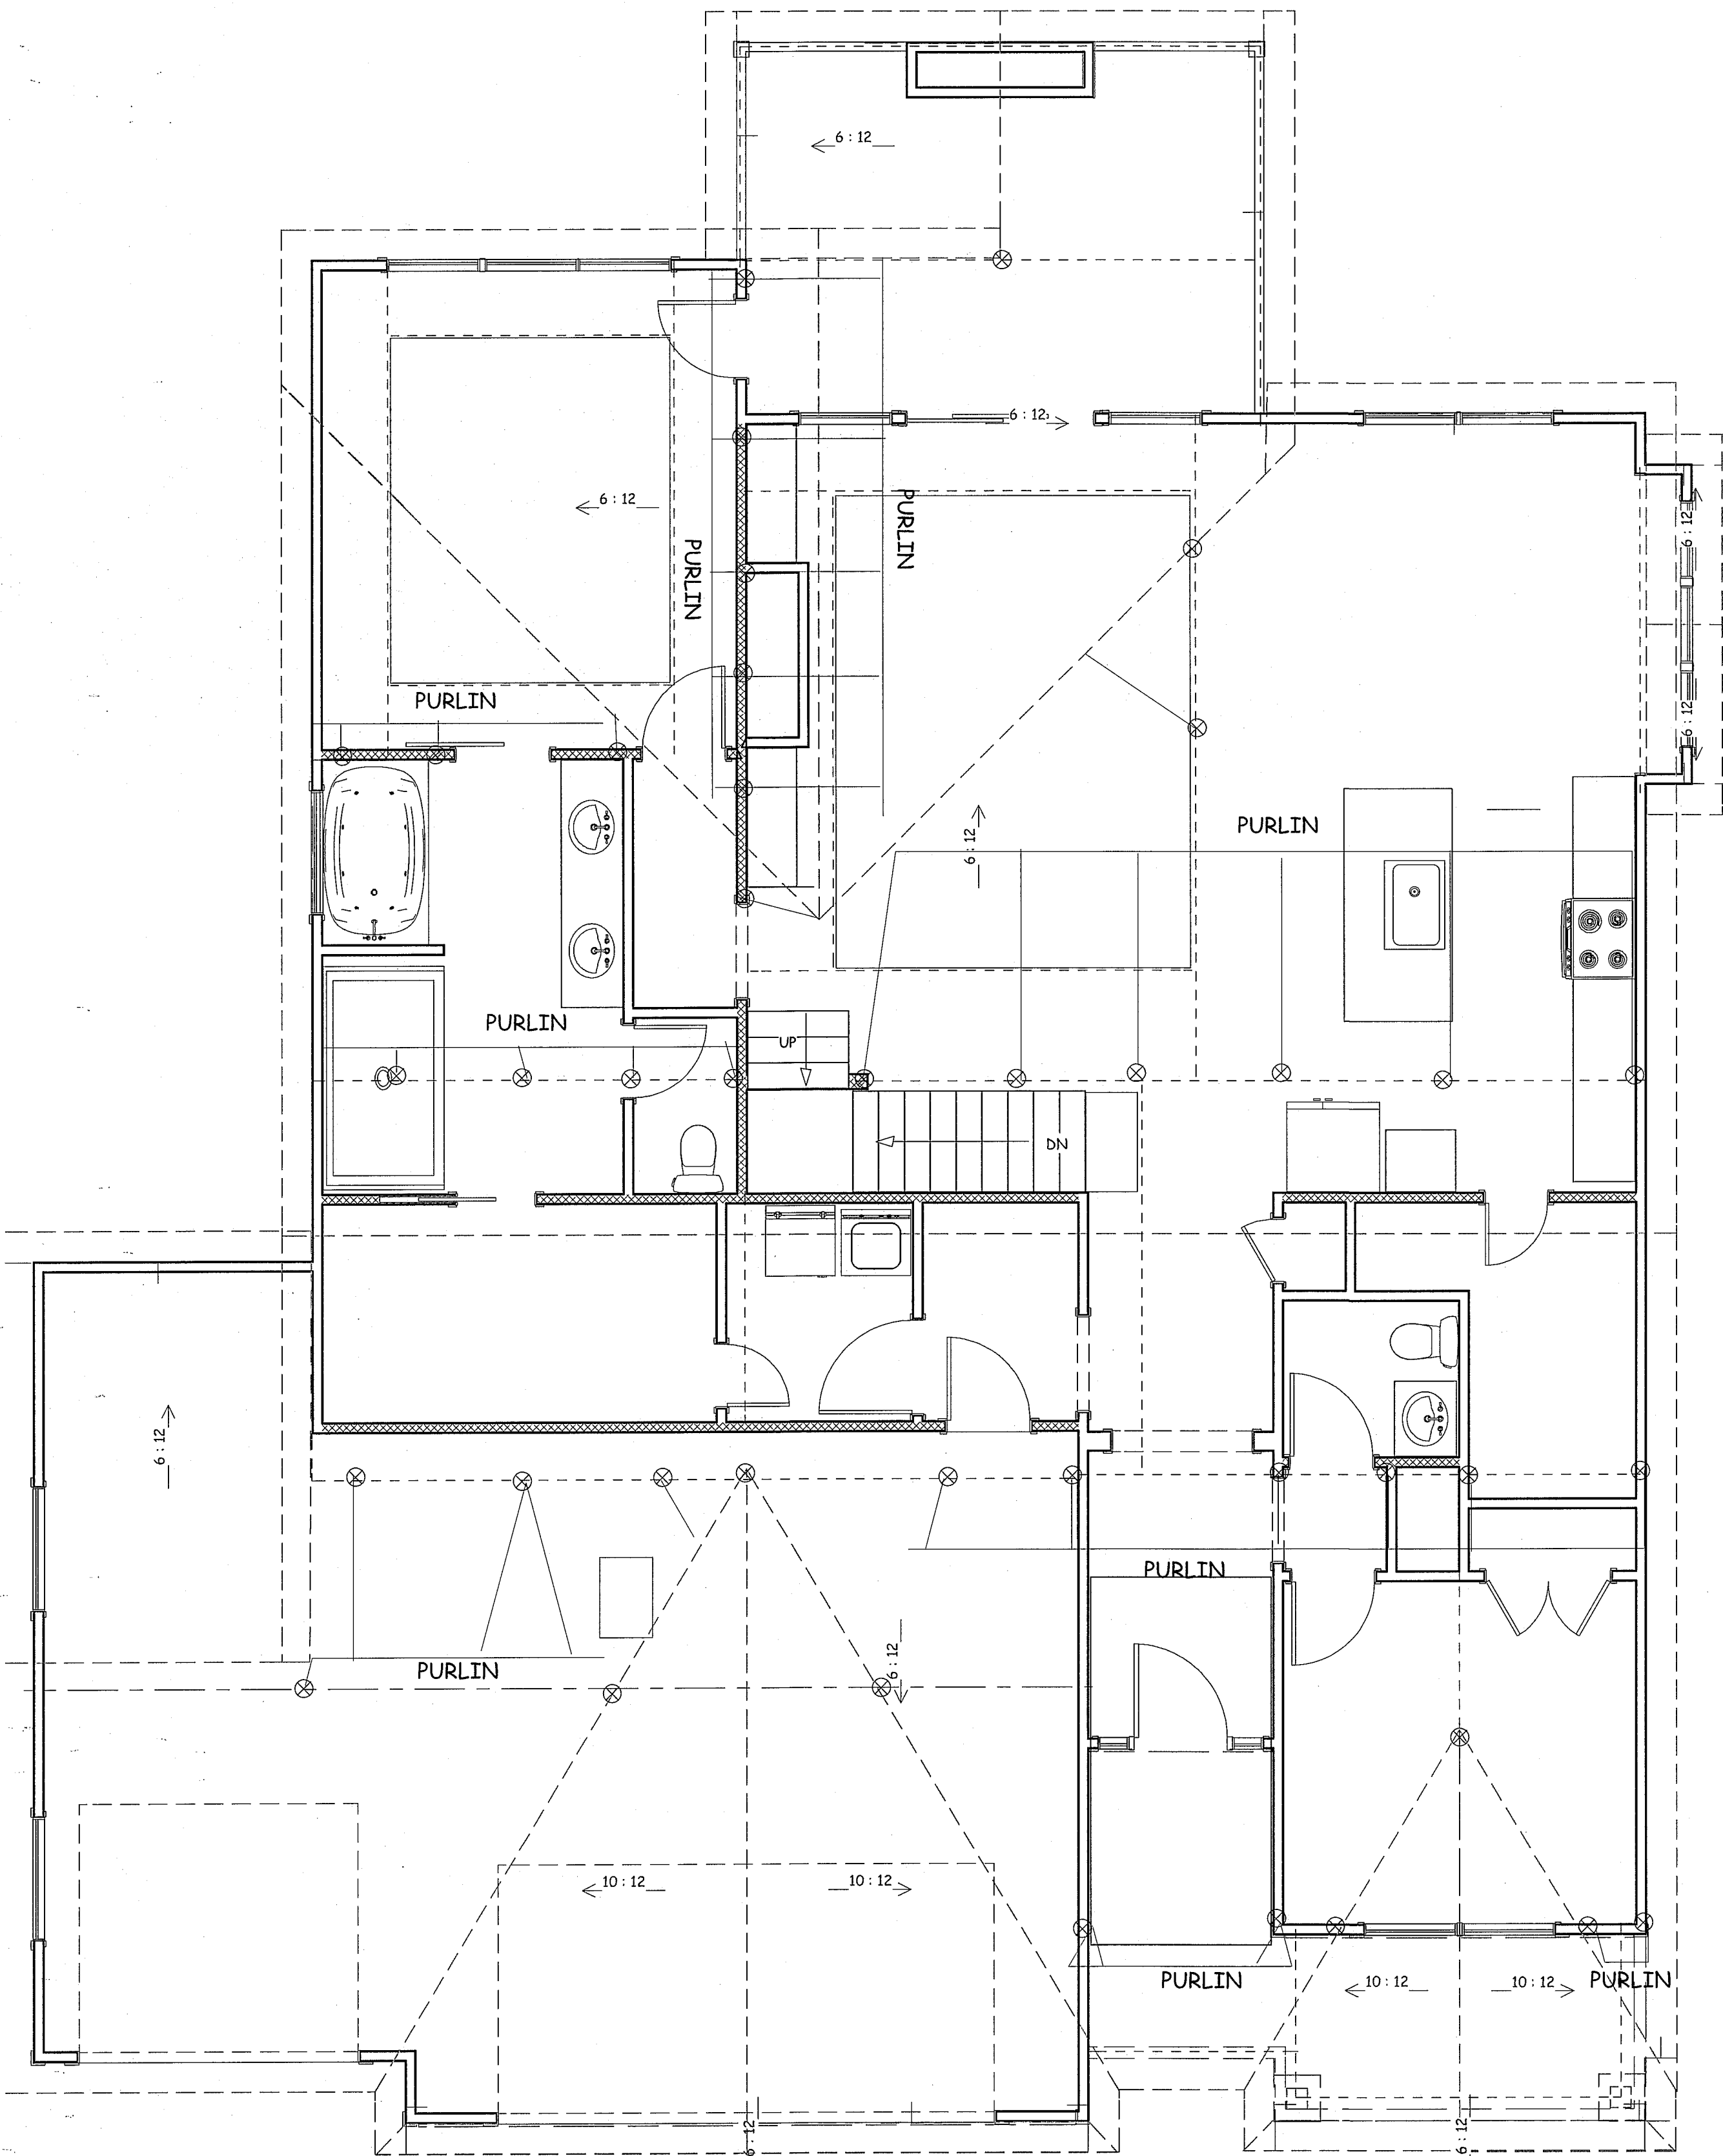


PURLIN PLAN  
ROOF PITCHES 6/12 U.N.O.  
RAFTERS 2 X 6 DF NO 2 @ 16" OC TYP.  
HIPS AND RIDGES 2 X 8 DF NO 2 TYP.  
SOFFITS 12" TYP.

MAX. RAFTER SPAN 14-4

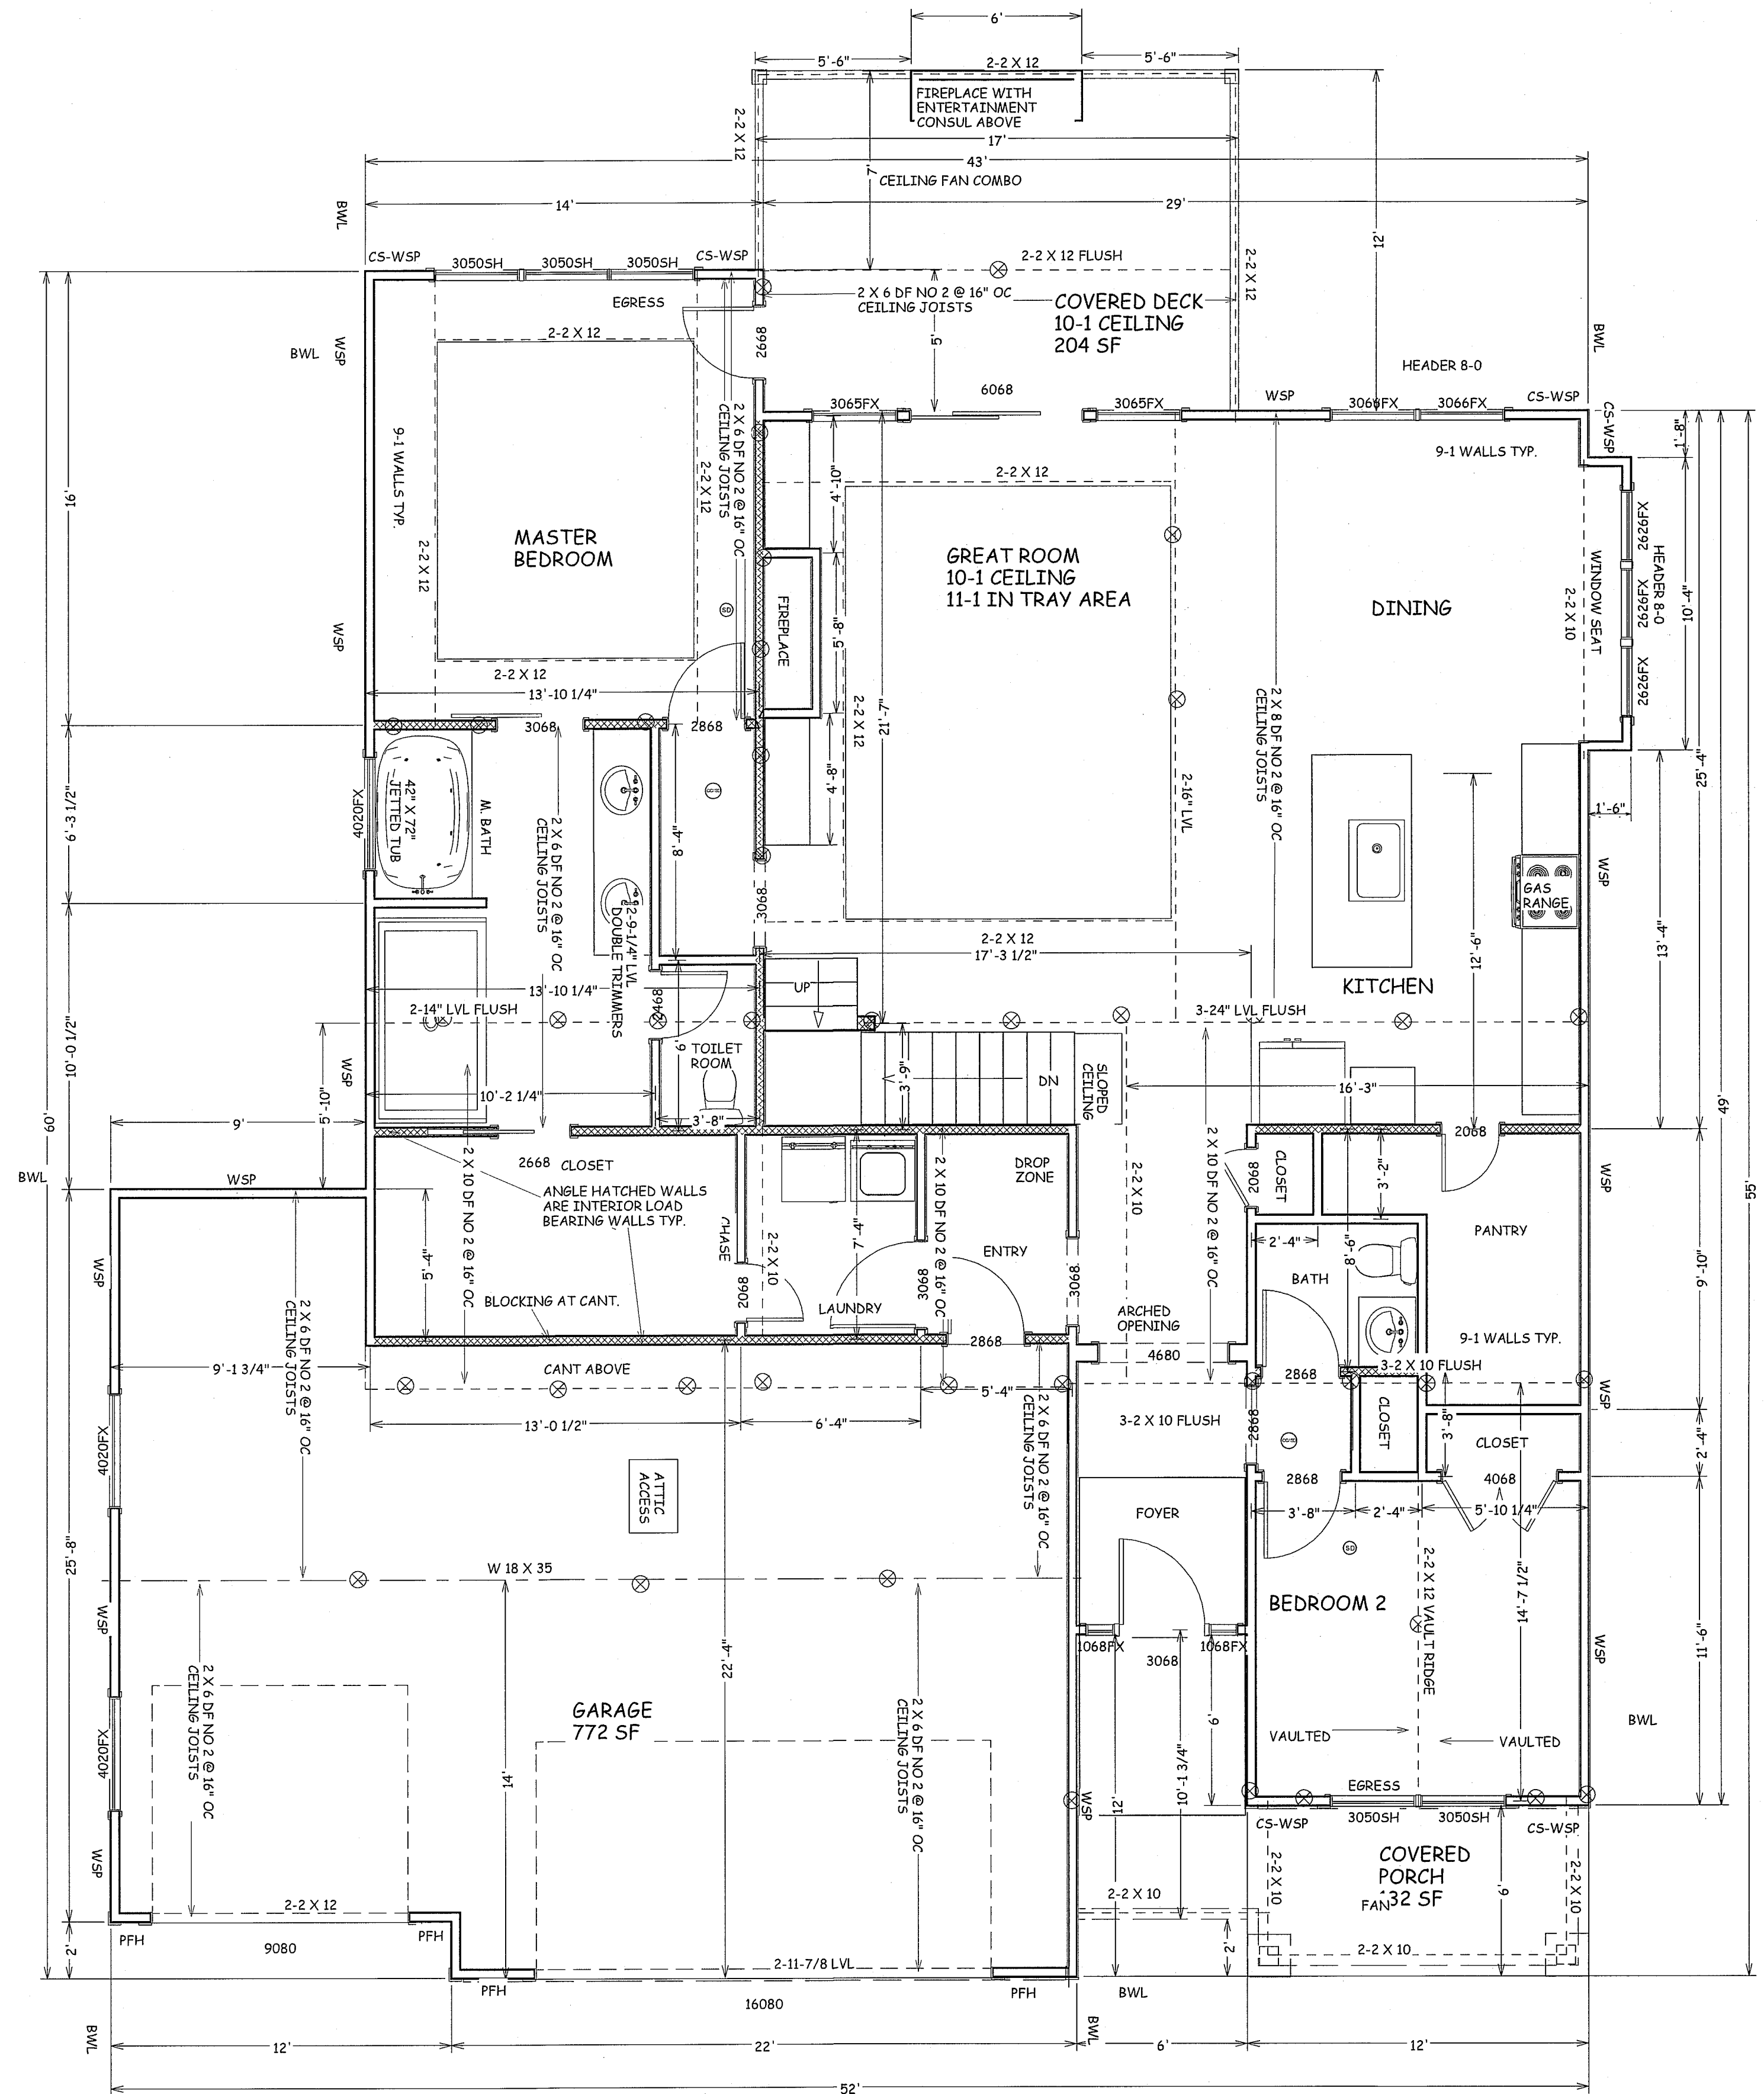

MAIN FLOOR  
1756 SF

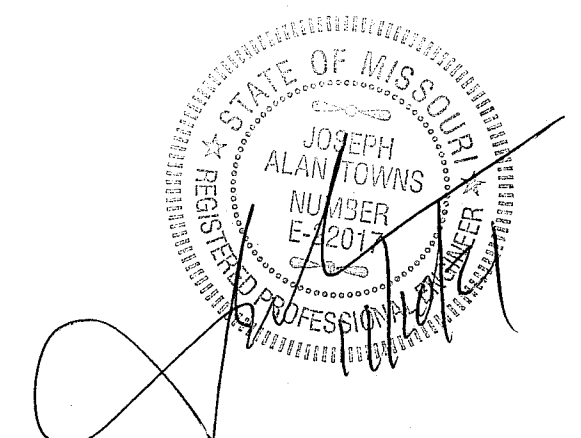

JOSEPH A. TOWNS P.E.  
MO. LIC # 22017  
PROFESSIONAL SEAL  
APPLIES TO STRUCTURAL  
ELEMENTS ONLY

BUILD IN ACCORDANCE WITH  
2018 INTERNATIONAL  
RESIDENTIAL CODE AND  
LOCAL CODES.

BEHOME LLC  
NOELLE PLAN  
LACKEY RES.  
LOT 31 HOOK FARM  
2047 SW HOOK FARM DR  
LEE SUMMIT MO

SCALE  
1/4" = 1'-0"

DATE  
11-11-21

PLAN NO.

3643

SHEET NO.

3000  
RELEASE FOR  
CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
Development Services  
LEE'S SUMMIT MISSOURI  
10/09/2023



ENERGY CONSERVATION CODE  
THE FOLLOWING VALUES ARE NEEDED.

R-15 IN WALLS

R-49 IN ATTICS

R-38 IN VAULTS

R-30 REDUCTION FOR VAULTS IS ONLY FOR 500 SF  
PF AREA

R-19 IN FLOORS OVER UNCONDITIONED SPACES

R-10 IN CRAWL SPACE WALLS

BASEMENT WALLS R-13 CAVITY OR R-10 CONTINUOUS

SLABS SHALL BE R-10 FOR A DEPTH OF 2 FOOT

A WINDOW U FACTOR OF .35 OR BETTER

DUCTWORK NEEDS TO HAVE AN R-8 VALUE

#### VAULT INSULATION DETAIL

1" AIR SPACE WITH FOAM AIR  
CHUTES

R-38 HIGH DENSITY  
INSULATION

INTERCONNECTED HARD WIRED SMOKE  
DETECTORS SHALL BE INSTALLED IN EACH  
BEDROOM AND OUTSIDE OF EACH BEDROOM  
ALL PLUMBING IF EXISTING SHALL BE CAPPED  
AND AIR TESTED PRIOR TO ROUGH-IN  
INSPECTION FOR LEAK VERIFICATION

ICE & WATER SHIELD REQUIRED ON ALL  
ROOFS

ROOF IS DESIGNED FOR 25  
P.S.F. SNOW LOAD MIN.  
COMP. SHINGLES OVER  
15# FELT

RIDGE BOARDS AND HIPs ARE TO BE 2  
X MATERIAL, AND NOT LESS THAN  
THE END CUT OF RAFTER

PROVIDE RAFTER TIES PER SECTION 802.3  
AND 802.3.1 WHEN UNABLE TO CONNECT  
RAFTERS TO CEILING JOISTS

2 X 6 DF NO. 2  
AT 16" O.C.

1/2 GYP. BOARD

GARAGE SHALL HAVE 5/8 TYPE X  
SHEET ROCK  
CEILING AND WALLS

WALLS OVER 10-2 TO 18-0  
STUDS SHALL BE 2 X 6 DF  
NO 2 @ 16" O.C. TYP.

ALL STUDS 60 FROM FLOOR TO  
CEILING OR RAFTER DIAFRAM TYP.

MIN. CONCRETE STRENGTH

2500 PSI BASEMENT FLOOR SLABS UNDISTURBED GRADE

3000 PSI FOR FOOTINGS, FOUNDATION WALLS, AND OTHER VERTICAL

CONCRETE

3500 PSI FOR CARPORT AND GARAGE FLOOR SLABS ON UNDISTURBED GRADE,

AND STRUCTURAL FLOOR SLABS

SPREAD FOOTING  
MIN 8" DEEP X 16"  
WIDE WITH TWO NO 4  
REBAR

4" CONCRETE SLAB WITH NO  
4 BARS AT 2-0 O.C. EACH WAY,  
OVER 6 ML VAPOR BARRIER  
OVER CRUSHED ROCK

INTERIOR DRAIN TILE MIN. 1-1/2"  
MIN. DRAIN TO DAYLIGHT, OR SUMP  
PUMP IN ACCORDANCE TO R-405

8 X 16 FOOTING WITH TWO NO 4  
BARS HORIZONTAL 3" FROM THE  
BOTTOM, ALL FOOTINGS TO  
EXCEED MIN. FROST DEPTH OF 36"

MIN. STAIR HEADROOM 6-8

ALL STAIRS  
MAX. RISE 7-3/4"  
MIN. RUN 10"

#### WINDOW SAFETY GLAZING PER 308

SAFETY GLAZING REQUIRED ALONG WALKING SURFACES AND  
STAIRS LOCATED WITHIN 36 INCHES HORIZONTALLY OF THE STEPS.  
SAFETY GLAZING REQUIRED IF EXPOSED SINGLE PANEL IS IN  
EXCESS OF 9 SQUARE FEET OR THE BOTTOM EDGE OF THE GLAZING  
IS LESS THAN 18 INCHES ABOVE THE FINISHED FLOOR.

SAFETY GLAZING REQUIRED WHERE THE NEAREST EXPOSED EDGE OF  
THE GLAZING IS WITHIN 24 INCHES OF EITHER VERTICAL EDGE OF  
THE DOOR IN A CLOSED POSITION AND WHERE THE BOTTOM  
EXPOSED EDGE OF THE GLAZING IS LESS THAN 60 INCHES ABOVE A  
WALKING SURFACE, SAFETY OR TEMPERED GLAZING IS REQUIRED.

WINDOWS ARE TO HAVE FALL  
PROTECTION PER IRC 312.2

#### WINDOW EGRESS REQUIREMENTS


BEDROOM WINDOW EGRESS MINIMUM FOR A DOUBLE HUNG  
WINDOW IS 34 INCH CLEAR WIDTH MIN. AND 24 INCH CLEAR  
HEIGHT MIN. WITH A CLEAR OPENABLE AREA OF 5.7 SQUARE FEET  
MIN.  
A CASEMENT OR SLIDER WINDOW MINIMUMS ARE 20 INCH CLEAR  
WIDTH MINIMUM AND 41 INCH CLEAR HEIGHT MINIMUM WITH A  
MINIMUM 5.7 SQUARE FOOT OF OPENABLE AREA.  
OPENING OF EGRESS WINDOW NOT MORE THAN 42"  
FROM THE FLOOR

#### PIER PADS

TYP. U.N.O. 3-0 X 3-0 X 12" PIER PADS MIN.  
WITH # 4 REBAR, 6 EACH WAY

TYP VAULT WITH STRAPS

OVERHEAD GARAGE DOORS  
MUST MEET DASHA 115 MPH  
OR IRC 2018 REQUIREMENTS

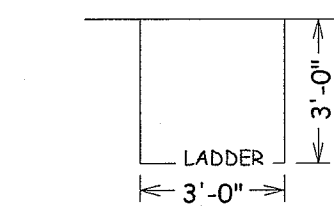

EGRESS WINDOW WELL AS NEEDED  
PER SECTION 308 MIN 3-0 X 3-0  
WITH LADDER

ALL CONCRETE EXPOSED TO  
WEATHER GARAGE SLABS  
FOOTINGS WALLS AND FLATWORK  
MUST HAVE 6% AIR ENTRAINMENT

SUPPLEMENTAL

REINFORCEMENT AT

CORNERS OF OPENINGS

AND STEP DOWNS

REQUIRE 1 # 4 BAR 48"

LONG AT 45 DEGREE

ANGLE AT CORNERS,

WITHIN 6" OF THE EDGE

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

SUPPLEMENTAL

REINFORCEMENT AT

CORNERS OF OPENINGS

AND STEP DOWNS

REQUIRE 1 # 4 BAR 48"

LONG AT 45 DEGREE

ANGLE AT CORNERS,

WITHIN 6" OF THE EDGE

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

OF INSIDE CORNERS

1. DWELLING / GARAGE OPENINGS BETWEEN GARAGE AND SLEEPING  
PURPOSES SHALL NOT BE PERMITTED. OTHER OPENINGS SHALL BE  
EQUIPPED WITH SOLID WOOD OR STEEL DOORS NOT LESS THAN 1-3/8"  
THICK OR 20 MINUTE RATED DOORS, WITH SELF CLOSING DEVICES  
REQUIRED FOR GARAGE / DWELLING SEPERATION DOORS R302.5.1

2. WHOLE HOUSE MECHANICAL VENTILATION SYSTEM IS REQUIRED FOR  
ANY DWELLING IN COMPLIANCE WITH IRC M 1505

3. CARBON MONOXIDE DETECTORS REQUIRED IRC R 315

4. STEEL COLUMNS SHALL BE MINIMUM SCHEDULE 40 R407.3

5. DECK SHALL BE BUILT PER TABLES 507.2, 507.2.1, 507.3, 507.6,  
507.9.1(1)&(2), 507.5, AND 507.6

6. STUDS SHALL BE CONTINUOUS BETWEEN FLOOR, CEILING AND OR  
ROOF DIAPHRAGMS R602.3

7. ADDED REQUIREMENTS FOR WINDOW FALL PROTECTION R312.2

8. NEW PROVISIONS FOR ATTACHMENT OF RAFTERS, TRUSSES AND  
ROOF BEAMS R802.3.1, R802.11

9. INSULATION REQUIRED FOR ALL BASEMENT WALLS ( INCLUDING  
UNFINISHED BASEMENTS) N1102.1

10. EXTERIOR WINDOWS/DOORS SHALL HAVE U-FACTOR 0.35 AND  
GLAZING SHALL HAVE SOLAR HEIGHT GAIN FACTOR OF 0.40 N1102.1

11. HOUSE LEAKAGE AND DUCT LEAKAGE PERFORMANCE STANDARDS  
EFFECTIVE JANUARY 1, 2014, A SAMPLE TESTING PROGRAM WILL BE  
IMPLEMENTED OCTOBER 1, 2012 KCBRC N1102.4.1.2 N1103.2.2

12. LIGHTING FIXTURES PENETRATING THE THERMAL ENVELOPE ( E.G.  
CAN LIGHTS IN ATTIC ) SHALL BE IC- RATED, LEAKAGE- RATED AND  
SEALED TO THE GYPSUM WALLBOARD N1102.4.4

13. PROGRAMMABLE THERMOSTAT REQUIRED N1103.1.1

14. AIR HANDLERS SHALL BE RATED FOR MAXIMUM 2 % AIR LEAKAGE  
RATE N1103.2.2.1

15. BUILDING CAVITIES USED AS RETURN AIR PLENUMS SHALL BE  
SEALED TO PREVENT LEAKAGE ACROSS THE THERMAL ENVELOPE KCBRC  
N1103.2.2

16. CERTAIN HOT WATER PIPES SHALL BE INSULATED N1103.4

17. ALL EXHAUST FANS SHALL TERMINATE TO THE BUILDING EXTERIOR  
M1507.2


18. MAKEUP AIR SYSTEM REQUIRED FOR KITCHEN EXHAUST HOODS  
THAT EXCEED 400 CFM M1503.4

19. BUILDING CAVITIES IN A THERMAL ENVELOPE WALL ( INCLUDING  
THE WALL BETWEEN THE HOUSE AND GARAGE ) SHALL NOT BE USED AS  
RETURN AIR PLENUMS

20. AN AIR HANDLING SYSTEM SHALL NOT SERVE BOTH THE LIVING  
SPACE AND THE GARAGE M1501.6

21. A CONCRETE- ENCASED GROUNDING ELECTRODE ( "UFER" GROUND )  
CONNECTION SHALL BE PROVIDED TO THE ELECTRICAL SERVICE E3608.1

22. COMPLIANCE WITH THE REQUIREMENT AND SHOW CONNECTION AS  
NEEDED FOR ROOF BEAM, TRUS, RAFTER, AND GIRDER CONNECTION FOR  
UPLIFT PER IRC 802.11. ALL RAFTERS BE IN COMPLIANCE WITH IRC 502.11  
AMENDED RAYMORE CODE

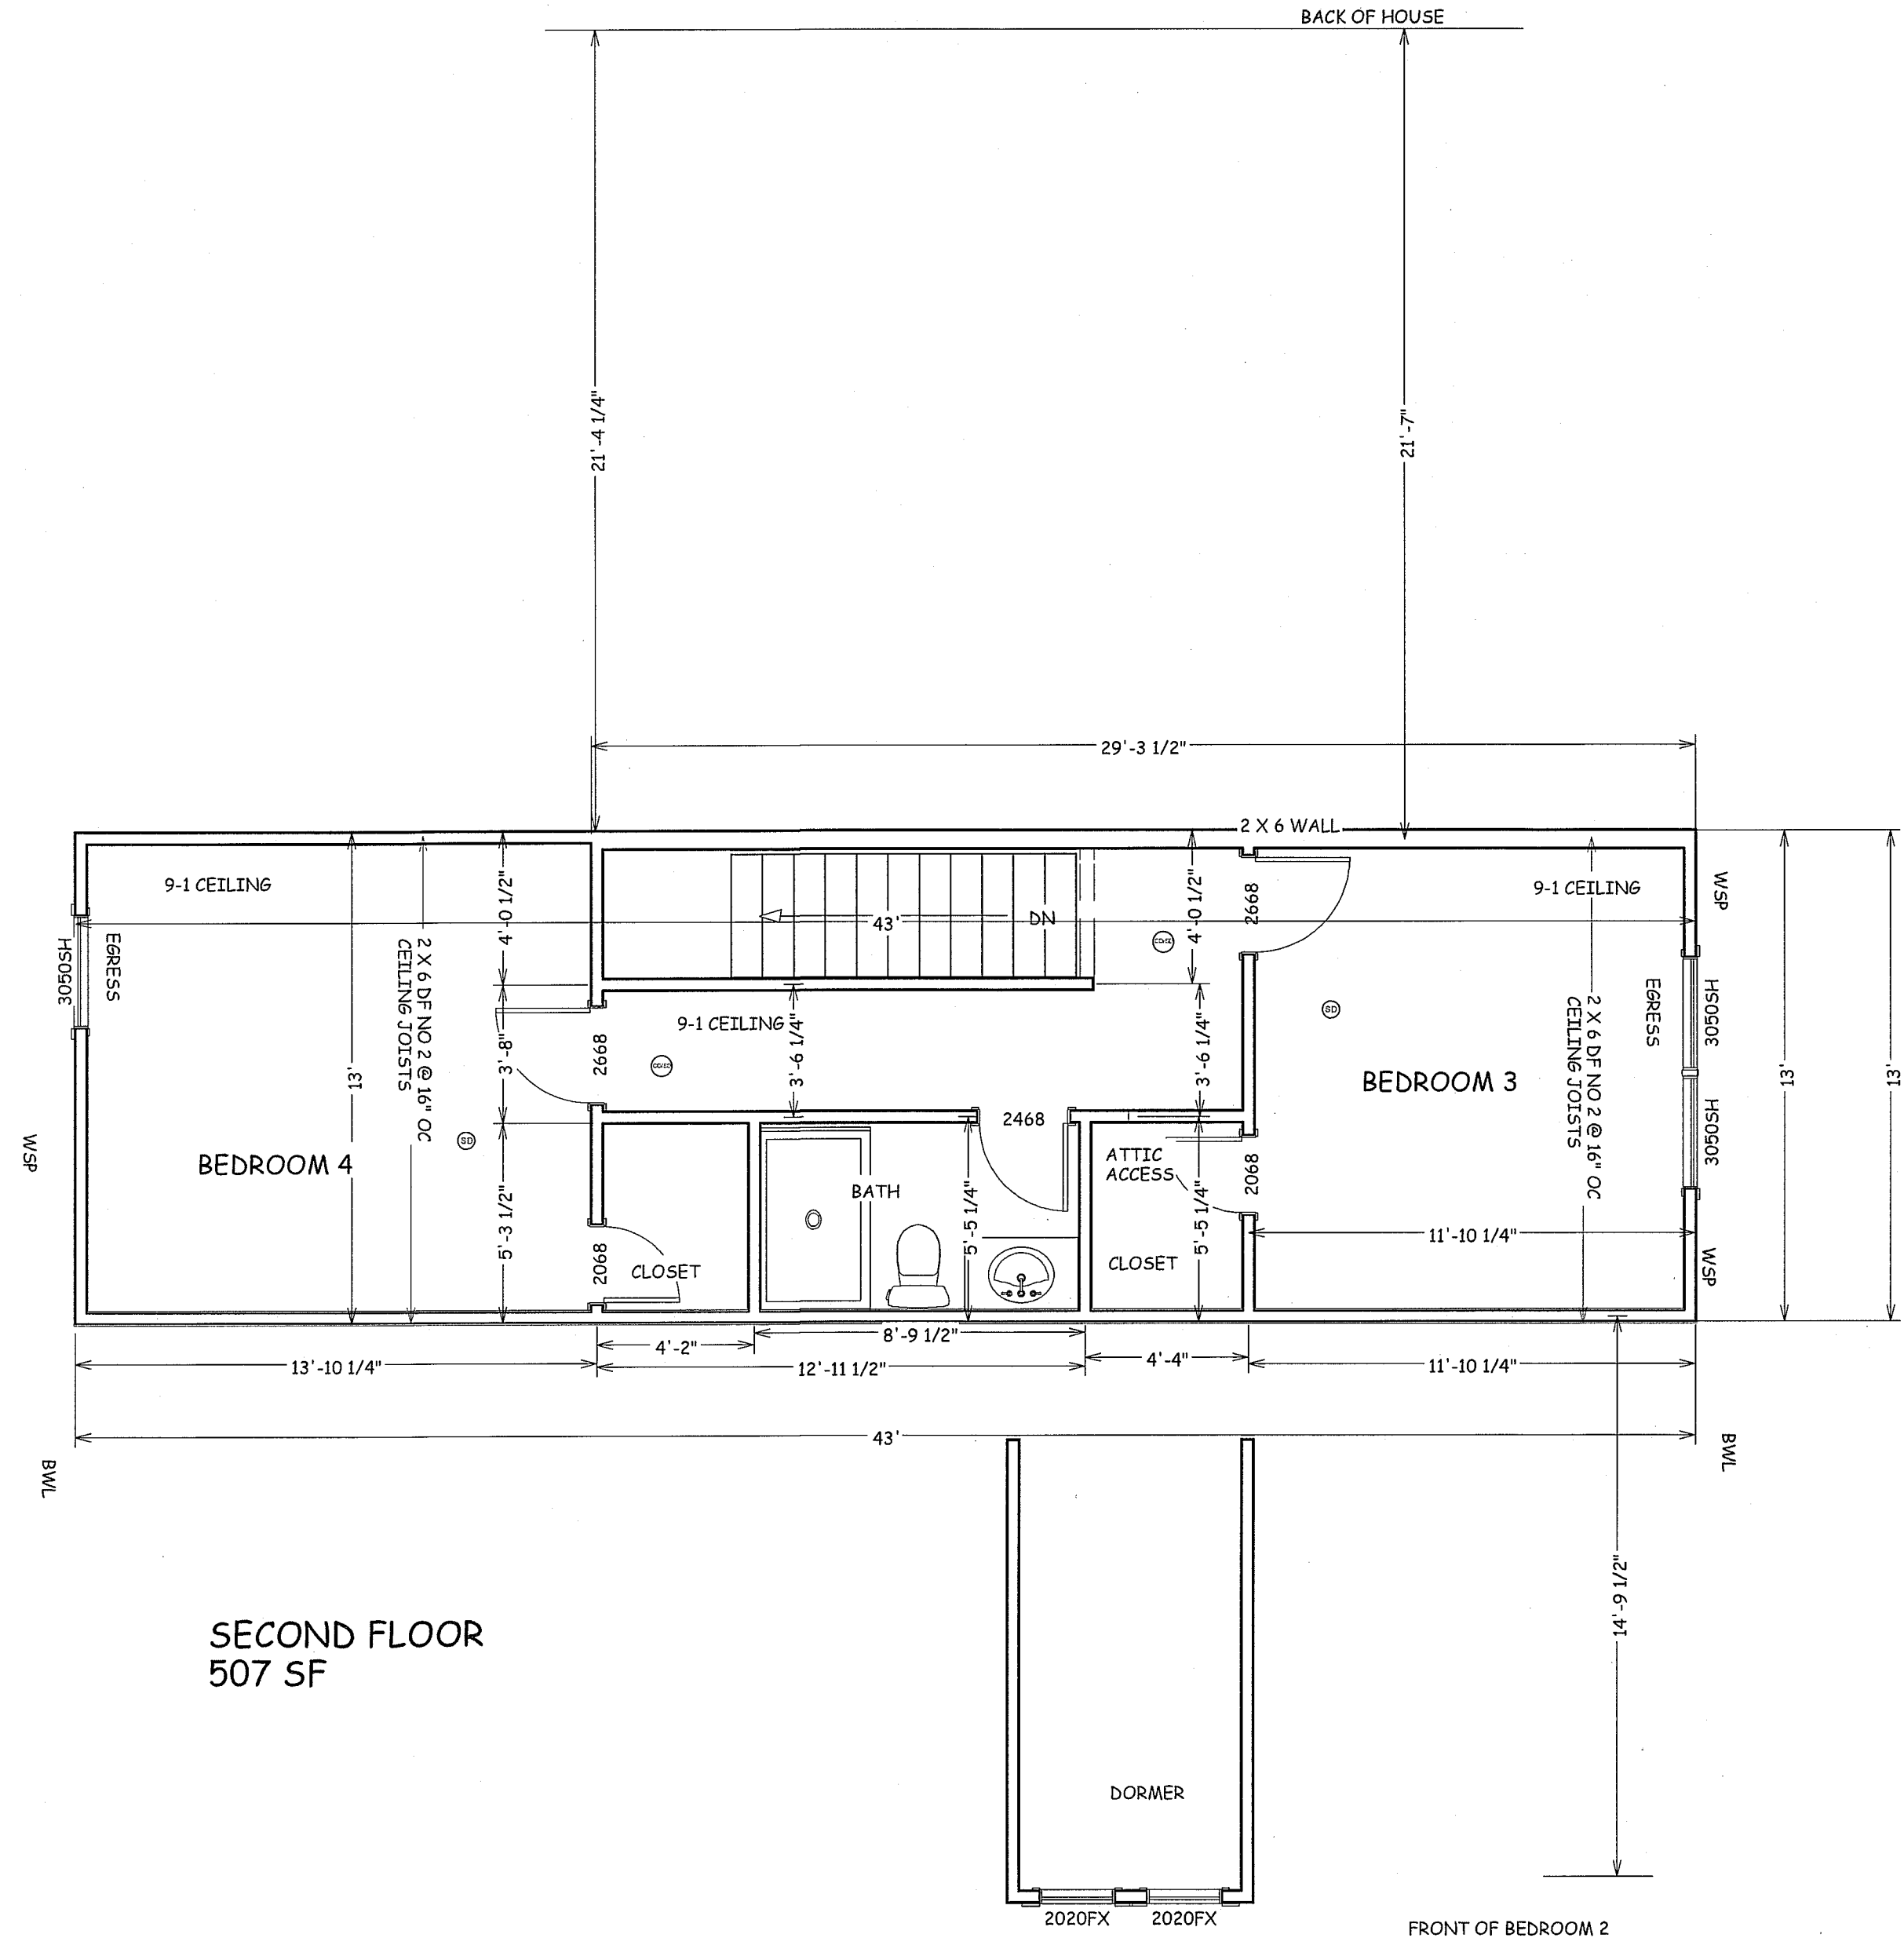

SECOND FLOOR  
507 SF

BUILD IN ACCORDANCE WITH  
2018 INTERNATIONAL  
RESIDENTIAL CODE AND  
LOCAL CODES.

BEHOME LLC  
NOELLE PLAN  
LACKEY RES.  
LOT 31 HOOK FARM  
2047 SW HOOK FARM DR  
LEE SUMMIT MO


SCALE  
1/4" = 1-0

DATE  
11-11-21

PLAN NO.

3643

SHEET NO.

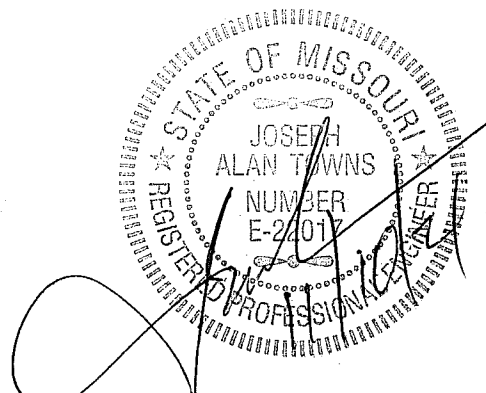


JOSEPH A. TOWNS P.E.  
M.O. LIC E 22017  
PROFESSIONAL SEAL  
APPLIES TO STRUCTURAL  
ELEMENTS ONLY

RELEASE FOR  
CONSTRUCTION  
4-10-21  
Development Services  
LEE'S SUMMIT, MISSOURI  
10/09/2023




TABLE R602.10.3.1 BRACING REQUIREMENTS BASED ON WIND SPEED						
EXPOSURE CATEGORY B • 30 FOOT MEAN ROOF HEIGHT • 10 FOOT BAY-TO-RIDGE HEIGHT • 10 FOOT WALL HEIGHT • 2 BRACED WALL LINES		MINIMUM TOTAL LENGTH (FEET) OF BRACED WALL PANELS REQUIRED ALONG EACH BRACED WALL LINE <sup>a</sup>				
Basic Wind Speed (mph)	Story Location	Braced Wall Line Spacing (feet)	Method LIB <sup>b</sup>	Method GB	Methods DWB, WSP, SFB, PFB, PCF, HFS, CS-SFB <sup>c</sup>	Methods CS-WSP, CS-G, CS-PF <sup>d</sup>
≤ 90		10	3.5	3.5	2.0	2.0
		20	7.0	7.0	4.0	3.5
		30	9.5	9.5	5.5	5.0
		40	12.5	12.5	7.5	6.0
		50	15.5	15.5	9.0	7.5
		60	18.5	18.5	10.5	9.0
		10	7.0	7.0	4.0	3.5
		20	13.0	13.0	7.5	6.5
		30	18.5	18.5	10.5	9.0
		40	24.0	24.0	14.0	12.0
		50	29.5	29.5	17.0	14.5
		60	35.0	35.0	20.0	17.0
		10	NP	10.5	6.0	5.0
		20	NP	19.0	11.0	9.5
		30	NP	27.5	15.5	13.5
		40	NP	35.5	20.5	17.5
		50	NP	44.0	25.0	21.5
		60	NP	52.0	30.0	25.5

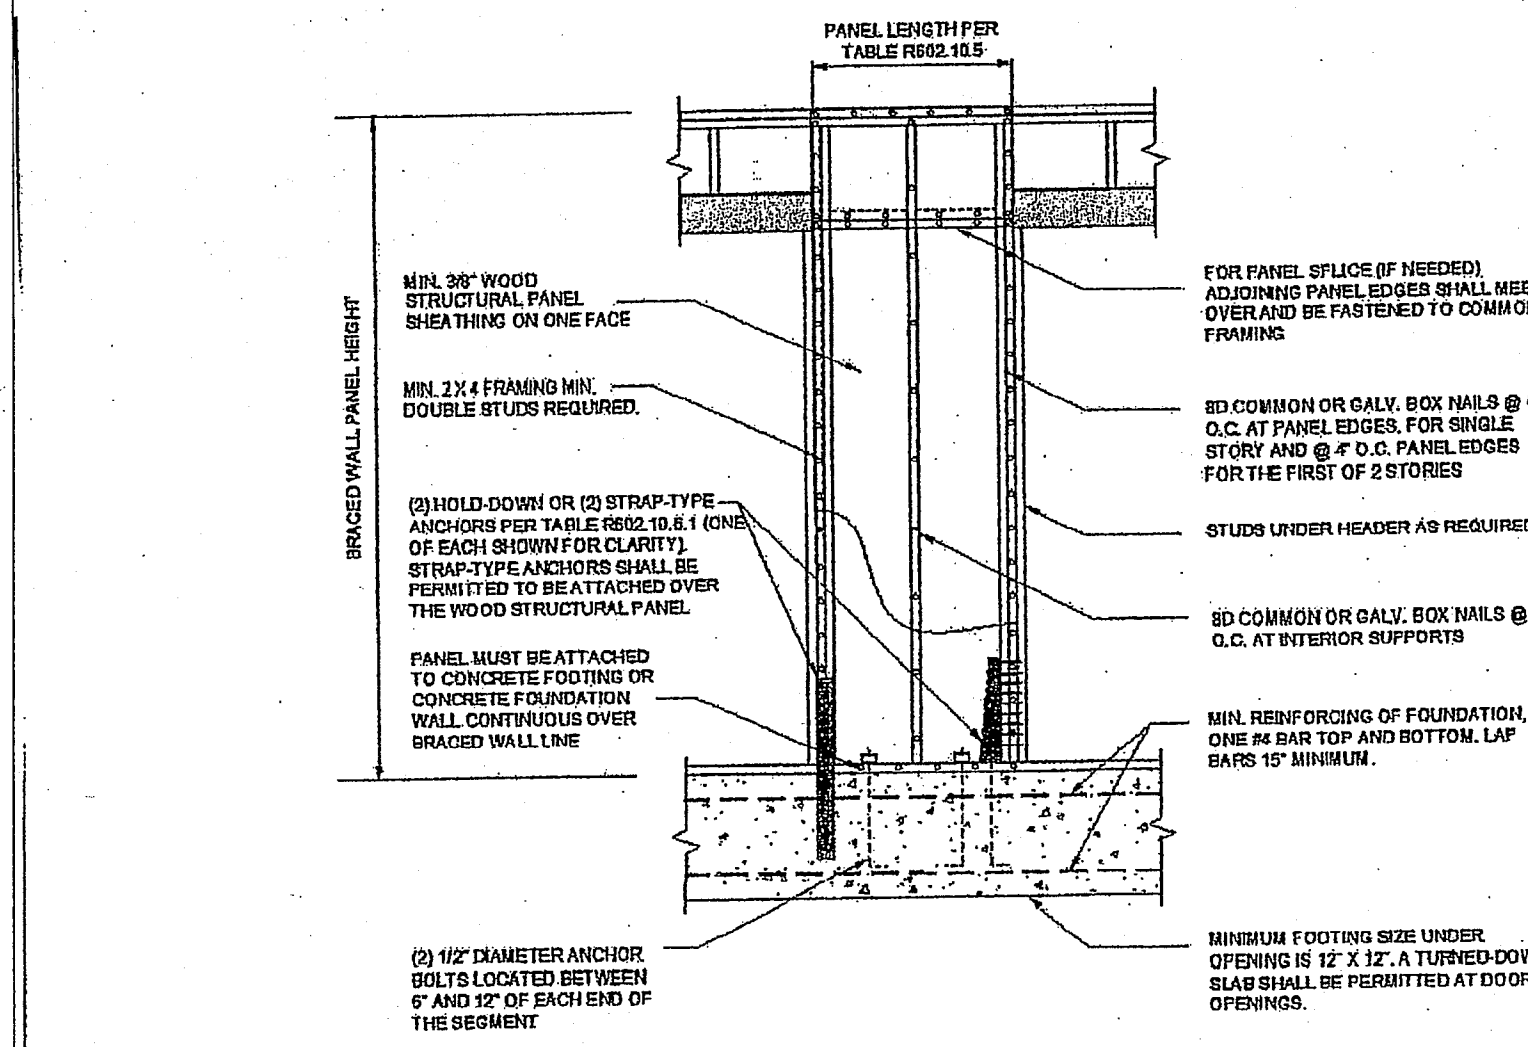

For SF: 1 inch = 25.4 mm.

**FIGURE R602.10.5.1  
METHOD ABW—ALTERNATE BRACED WALL PANEL**

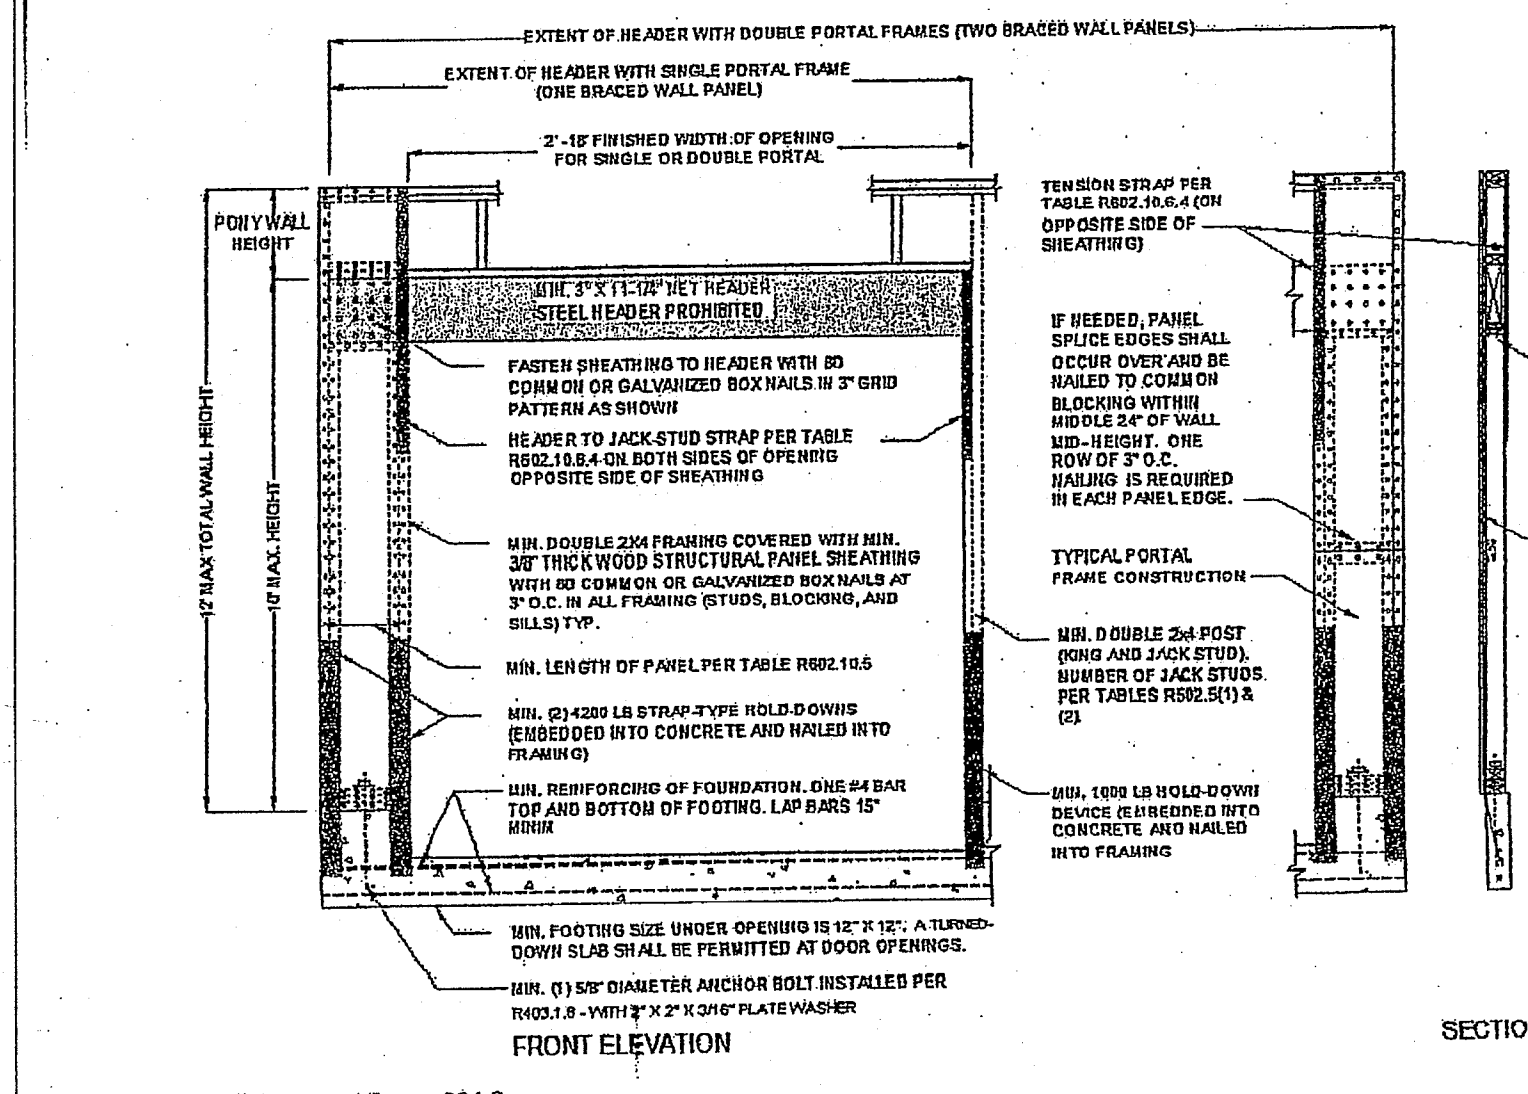

For SF: 1 inch = 25.4 mm, 1 foot = 304.8 mm.

**FIGURE R602.10.6.2  
METHOD PFH—PORTAL FRAME WITH HOLD-DOWNS**

TABLE R602.10.4 BRACING METHODS				
METHODS, MATERIAL	MINIMUM THICKNESS	FIGURE	CONNECTION CRITERIA <sup>a</sup>	
LIB Let-in bracing	1 x 4 wood or approved metal straps at 45° to 60° angles for maximum 16" stud spacing		Fasteners: Wood: 2-8d common nails or 3-8d (2 1/4" long x 0.113" dia.) nails Metal straps: per manufacturer	Spacing: Wood: per stud and top and bottom plates Metal: per manufacturer
	DWB Diagonal wood boards		2-8d (2 1/4" long x 0.113" dia.) nails or 2-1 1/2" long staples	Per stud
WSP Wood structural panel (See Section R602.4)	3/4"		Exterior sheathing per Table R602.3(3) Interior sheathing per Table R602.3(1) or R602.3(2)	Varies by fastener
WV-WSP Wood Structural Panels with Stone or Masonry Veneer (See Section R602.10.6.5)	3/4"	See Figure R602.10.6.5	8d common (2 1/4" x 0.131" nails	4" at panel edges 12" at intermediate supports 4" at braced wall panel end posts
SFB Structural fiberboard sheathing	1/2" or 3/8" for maximum 16" stud spacing		1 1/2" long x 0.12" dia. (for 1/2" thick sheathing) 1 1/4" long x 0.12" dia. (for 3/8" thick sheathing) galvanized roofing nails or 8d common (2 1/4" long x 0.131" dia.) nails	3" edges 6" field
GB Gypsum board	1/2"		Nails or screws per Table R702.3.5 for exterior locations	For all braced wall panel locations: 7" edges (including top and bottom plates) 7" field
PFB Pneumatically applied fiberboard sheathing (See Section R602.4)	3/4" or 1/2" for maximum 16" stud spacing		For 3/4": 6d common (2" long x 0.113" dia.) nails For 1/2": 8d common (2 1/4" long x 0.131" dia.) nails	3" edges 6" field
PCF Portland cement plaster	See Section R702.3.5 for maximum 16" stud spacing		1 1/2" long, 11 gage, 1/4" dia. head nails or 7/8" long, 16 gage staples	6" o.c. on all framing members
HFS Hardboard panel siding	3/4" for maximum 16" stud spacing		0.092" dia., 0.225" dia. head nails with length to accommodate 1 1/4" penetration into studs	4" edges 8" field
ABW Alternate braced wall	3/4"		See Section R602.10.6.1	See Section R602.10.6.1


TABLE R602.10.5 MINIMUM LENGTH OF BRACED WALL PANELS						
METHOD (See Table R602.10.4)	MINIMUM LENGTH (feet)					CONTRIBUTING LENGTH (feet)
	Wall Height					
	8 feet	9 feet	10 feet	11 feet	12 feet	
DWB, WSP, SFD, PFB, PCF, HFS, WV-WSP	48	48	48	53	58	Actual <sup>b</sup>
GB	48	48	48	53	58	Double sided = Actual Single sided = 0.5 x Actual
LIB	55	62	69	NP	NP	Actual <sup>b</sup>
ABW	SDC A, B and C, wind speed < 110 mph	28	32	34	38	42
	SDC D, E and F, wind speed < 110 mph	32	32	34	NP	NP
PFH	Supporting roof only	16	16	16	18	20
	Supporting one story and roof	24	24	24	27	29
PFG	24	27	30	33	36	1.5 x Actual <sup>b</sup>
CS-G	24	27	30	33	36	Actual <sup>b</sup>
CS-PF	16	18	20	22	24	Actual <sup>b</sup>
CS-WSP, CS-SFB	Adjacent clear opening height (feet)					
	≤ 64	24	27	30	33	36
	68	26	27	30	33	36
	72	27	27	30	33	36
	76	30	29	30	33	36
	80	32	30	30	33	36
	84	35	32	32	33	36
	88	38	35	33	33	36
	92	43	37	35	35	36
	96	48	41	38	36	36
	100	—	44	40	38	38
	104	—	49	43	40	39
	108	—	54	46	43	41
	112	—	—	50	45	43
	116	—	—	55	48	45
	120	—	—	60	52	48
	124	—	—	—	56	51
	128	—	—	—	61	54
	132	—	—	—	66	58
	136	—	—	—	—	62
	140	—	—	—	—	65
144	—	—	—	—	72	

10' MAX. TOTAL WALL HEIGHT

10' MAX. HEIGHT

MIN. OVERLAP  
5" MIN.

For SF: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 mile per hour = 0.447 m/s.  
NP = Not Permitted.  
a. Linear interpolation shall be permitted.  
b. Use the actual length when it is greater than or equal to the minimum length.  
c. Maximum header height for PFH is 10 feet in accordance with Figure R602.10.6.2, but wall height may be increased to 12 feet with pony wall.  
d. Maximum opening height for PFG is 10 feet in accordance with Figure R602.10.6.3, but wall height may be increased to 12 feet with pony wall.

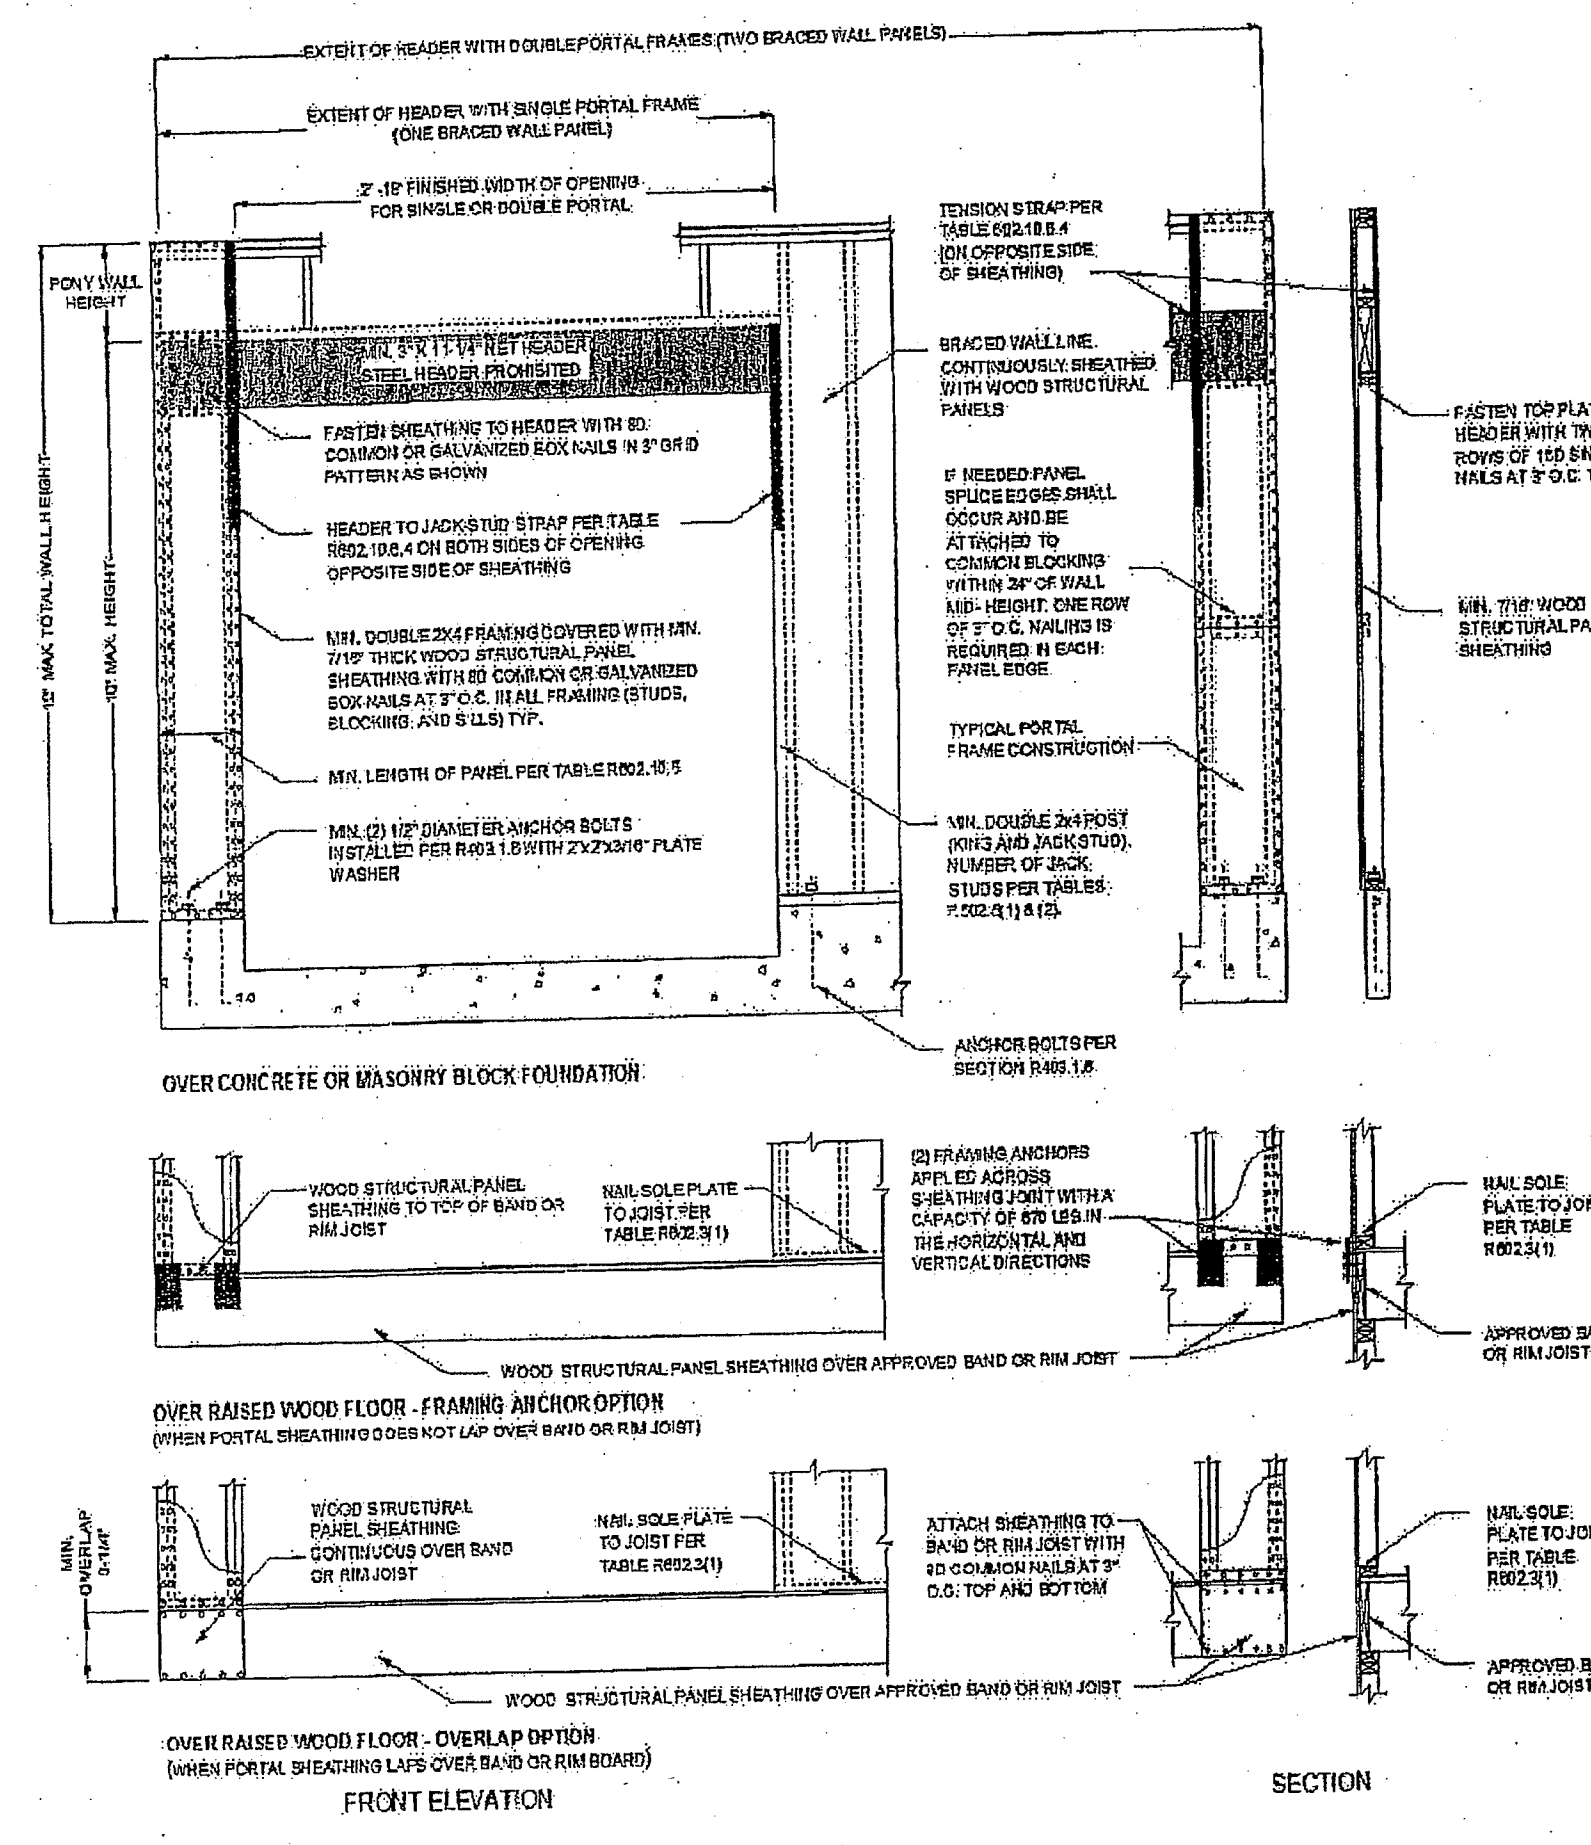

For SF: 1 inch = 25.4 mm, 1 foot = 304.8 mm.

**FIGURE R602.10.6.4  
METHOD CS-PF—CONTINUOUSLY SHEATHED PORTAL FRAME PANEL CONSTRUCTION**

BUILD IN ACCORDANCE WITH  
2012 INTERNATIONAL  
RESIDENTIAL CODE AND  
LOCAL CODES.

BRACE WALL  
DETAILS

SCALE  
NO SCALE

DATE

PLAN NO.

SHEET NO.  
BRACE  
WALL  
DETAILS

BUILD IN ACCORDANCE WITH  
2018 INTERNATIONAL  
RESIDENTIAL CODE AND  
LOCAL CODES.

BEHOME LLC  
NOELLE PLAN  
LACKEY RES.  
LOT 31 HOOK FARM  
2047 SW HOOK FARM DR  
LEE SUMMIT MO

SCALE  
1/4" = 1-0

DATE  
11-11-21

PLAN NO.

3643

SHEET NO.

STATE OF MISSOURI  
JOSEPH A. TOWNS P.E.  
ALAN TOWNS  
PROFESSIONAL SEAL  
APPLIES TO STRUCTURAL  
ELEMENTS ONLY

RELEASE FOR  
CONSTRUCTION  
ON EXHIBIT REVIEW  
Development Services  
LEE'S SUMMIT, MISSOURI  
10/09/2023