


# Lot 176 - Hook Farms

2615 SW Barley Field Dr,  
Lees Summit MO 64082




## Sheet List

- A0 Foundation Plan
- A1 Floor Plan - Main Level
- A2 RCP/Electrical Plan
- A3 Elevations
- A3.B Elevations
- A4 Building Sections
- A4.B Building Sections
- A5 Details
- A6 Details
- A7 Grading Options
- A8 Cabinet Layout

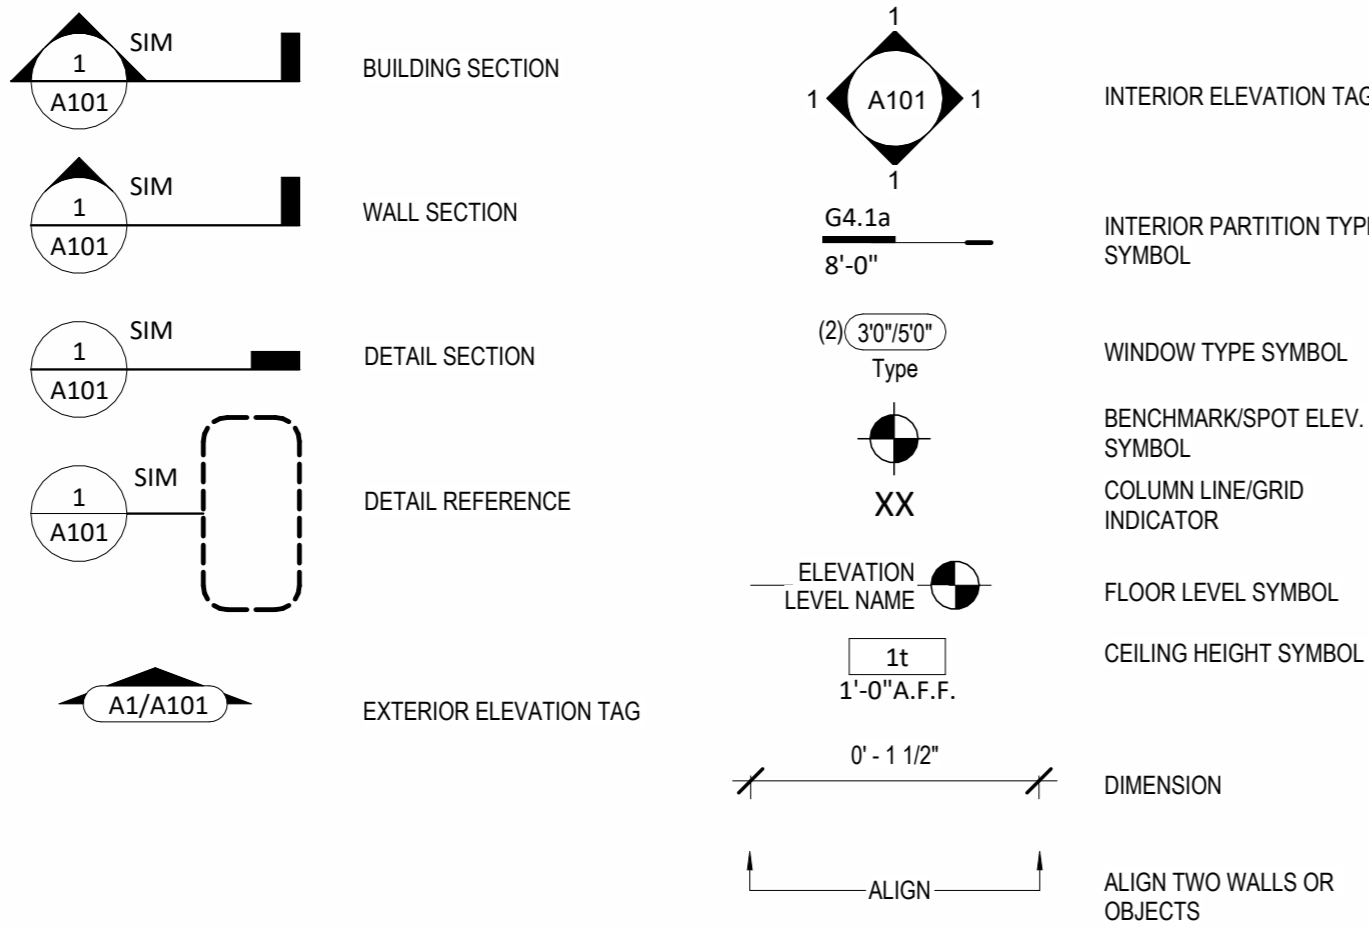

## Interior Partition Types

- NOTES:
1. PROVIDE MOISTURE RESISTANT GWB IN WET AREAS
  2. EXTEND ALL FIRE RATED WALLS STRUCTURE TO STRUCTURE.
  3. USE TYPE "X" GWB FOR ALL FIRE RATED PARTITIONS
  4. REFER TO ELEVATIONS FOR LOCATIONS WHERE WALL IS NOT FULL HEIGHT. IN THESE CASES CAP THE TOP OF THE WALL WITH A LAYER OF 1/2" GYPSUM BOARD U.N.O.

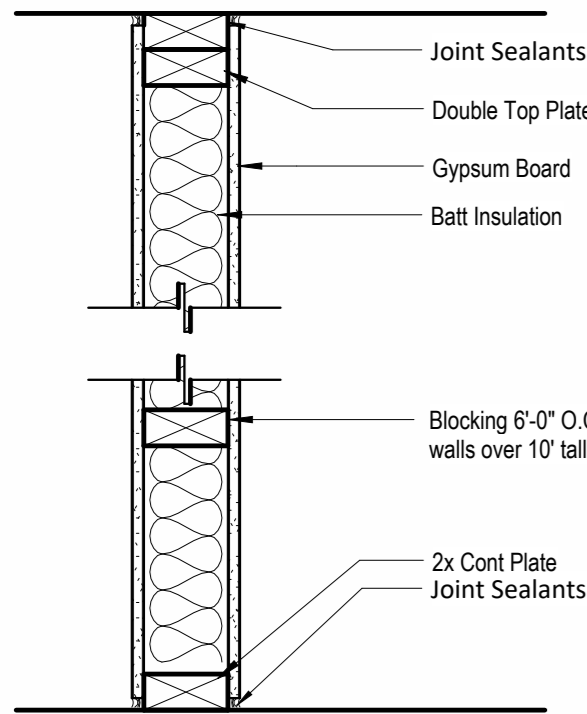


PARTITION SYSTEM:  
GYPSUM WALL BOARD PARTITION

G

PARTITION IDENTIFICATION PLAN SYMBOL	G4	G4.1	G4.L	G6
BASE PARTITION THICKNESS	4.5"	4.5"	4.5"	6.5"
STUD SPACING (O.C.)	16"	16"	16"	16"
STUD SIZE	2x4	2x4	2x4	2x6
GWB THICKNESS	1/2"	5/8"	5/8"	1/2"
JOINT SEALANTS	No	No	No	No
INTERIOR LOAD BEARING WALL	No	No	Yes	No
FIRE RATING (HRS)	-	1	-	-
FIRE TEST NUMBER	-	U314	-	-
FIRE TEST NUMBER (HEAD OF WALL)	-	-	-	-
FIRE RESISTIVE JOINTS	-	-	-	-
ACOUSTIC RATING (STC)	-	-	-	-
ACOUSTICAL TEST NUMBER	-	-	-	-
INSULATION	No	Yes	No	No
ACOUSTICAL JOINTS	-	-	-	-
REMARKS:	* SEE NOTE #4	* SEE NOTE #3	* SEE NOTE #3	* SEE NOTE #4

- NOTES:
1. REFER TO ELEVATIONS FOR LOCATIONS WHERE WALL IS NOT FULL HEIGHT. IN THESE CASES CAP THE TOP OF THE WALL WITH A LAYER OF 1/2" GYPSUM BOARD U.N.O.

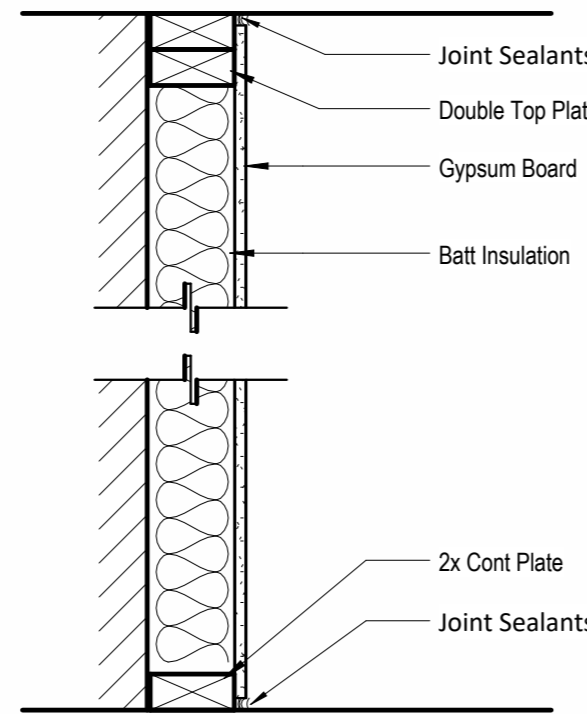


PARTITION SYSTEM:  
GYPSUM FURING PARTITION

F

PARTITION IDENTIFICATION PLAN SYMBOL	F4
BASE PARTITION THICKNESS	4"
STUD SPACING (O.C.)	16"
STUD SIZE	2x4
GWB THICKNESS	1/2"
JOINT SEALANT	No
FIRE RATING (HRS)	-
FIRE TEST NUMBER	-
FIRE TEST NUMBER (HEAD OF WALL)	-
FIRE RESISTIVE JOINTS	-
ACOUSTIC RATING (STC)	-
ACOUSTICAL TEST NUMBER	-
INSULATION	No
ACOUSTICAL JOINTS	-
REMARKS:	* SEE NOTE #1

- NOTES:
1. REFER TO ELEVATIONS FOR LOCATIONS WHERE WALL IS NOT FULL HEIGHT. IN THESE CASES CAP THE TOP OF THE WALL WITH A LAYER OF 1/2" GYPSUM BOARD U.N.O.

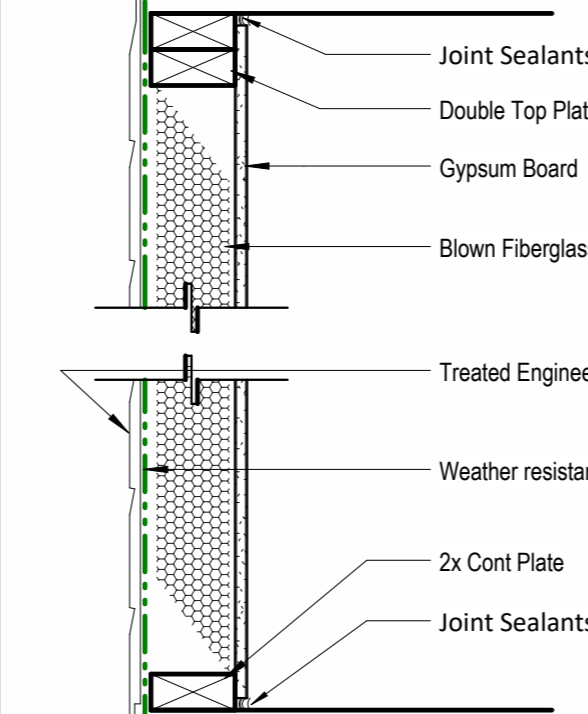

PARTITION SYSTEM:  
Exterior Partition

E

PARTITION IDENTIFICATION PLAN SYMBOL	E4
BASE PARTITION THICKNESS	4"
STUD SPACING (O.C.)	16"
STUD SIZE	2x4
GWB THICKNESS	1/2"
JOINT SEALANT	Yes
FIRE RATING (HRS)	-
FIRE TEST NUMBER	-
FIRE TEST NUMBER (HEAD OF WALL)	-
FIRE RESISTIVE JOINTS	-
ACOUSTIC RATING (STC)	-
ACOUSTICAL TEST NUMBER	-
INSULATION	Yes
ACOUSTICAL JOINTS	-
REMARKS:	* SEE NOTE #1

## General Information

Energy Efficiency Certificate						
Insulation Rating	R-Value		R-Value			
Ceiling/Roof	R- 49 MIN		R- 30 MIN*			
Walls	Frame	R- 13 MIN	Mass	R- 13		
	Basement	R- 13 MIN	Crawl space	R- 13		
	Over unconditioned space	R- 19 MIN	Slab edge	R- 10 for 2 feet		
Floors	Attic R- 8 MIN		Other R- 6			
Ducts						
Air Leakage Test Results						
Blower door	3 MAX	ACH50 Pa.	Duct testing	4 MAX		
Penetration Rating	NFRC U-Factor		NFRC SHGC			
Window	U-F: .35		.40			
Opaque door	U-F: .50					
Skylight	U-F: .55					
Equipment Performance		Type	Efficiency			
Heating system	Fuel Fired Furnace	80%	AFUE			
Cooling system	Central Air	13	SEER			
Water heater	Electric	0.92	EF			
Indicate if the following have been installed (an efficiency shall not be listed)						
<input type="checkbox"/> electric furnace		<input type="checkbox"/> gas-fired unvented room heater	<input type="checkbox"/> baseboard electric heater			
Designer/builder	Elevate Design + Build					
Code edition	IRC 2012 - Performance		Date	2022/10/12		

\* Where the roof/ceiling assembly does not allow sufficient space for the required insulation, the minimum required can be reduced to this value. This reduction of insulation from the requirements shall be limited to 500 SqFt or 20% of the total insulated ceiling area (whichever is less).

An energy efficient certificate is required to be posted in or on the electrical panel before the final inspection. The certificate will be provided with all new residential permits. It is the permit holder/contractor's responsibility to ensure the certificate has accurate information and is posted before final inspection -- Owner/Contractor is responsible for meeting the prescriptive requirements of IRC chapter 11 unless a HER Index Analysis for Performance Compliance based on the plans is submitted to the AHJ for approval.

IRC 2012- 2018  
Ground Snow Load: 20PSF  
Wind Speed: 90mph  
Topography Effects: No  
Seismic Design Category: A  
Damage From Weather: Severe  
Frost Line Depth: 36 inches  
Termites: Moderate to Heavy  
Winter Design Temperature: 6 F  
Ice Barrier Underlayment: Yes  
Flood Hazard: 1,500 or less  
Air Freezing Index: 55 F  
Mean Annual Temperature: 55 F

1. Whole House Mechanical Ventilation System is required for any dwelling with air infiltration at a rate of less than 3 air changes per hour (at ACH50 standard R303.4).
2. Carbon monoxide detectors required (R315)
3. Steel columns shall be minimum schedule 40 (R507.2)
4. Deck Ledger attachment to house shall be per Tables 507.9.1.3.
5. New provisions for attachment of rafters, trusses and roof beams. (R802.3 and R802.11)
6. Programmable thermostat required (N1103.1.1)
7. Air handlers shall be rated for Maximum 2% air leakage rate (N1103.2.2.1)
8. Building cavities used as return air plenums shall be sealed to prevent leakage across the thermal envelope. (N1103.2.3)
9. Certain hot water pipes shall be insulated (N1103.4)
10. All exhaust fans shall terminate to the building exterior (M1507.2)
11. Makeup air system required for kitchen exhaust hoods that exceed 400 CFM M1503.4
12. Building cavities in a thermal envelope wall (including the wall between the house and garage) shall not be used as return air plenums (unless the required insulation and air barrier are maintained) (M1601.1.1, #7.5)
13. An air handling system shall not serve both the living space and the garage (M1601.6)
14. A concrete-Encased grounding electrode (UFER Ground) connection complies with the requirements of the 2012 IRC Section E3608.1.2 in providing a connection with no less than the required minimum of steel.
15. Compliance with the requirements and show connection as needed for roof beam, truss, rafter, and girder connections for uplift per IRC 802.11
16. Garage Door Rating: DASHA 90 MPH Rated



Lot 176 - Hook Farms  
2615 SW Barley Field Dr,  
Lees Summit MO 64082



Permit Set  
Original Issue Date: 2022/10/12

## REVISIONS

Number Description Date

2018 IRC BUILDING CODE COMPLIANCE  
THESE DRAWINGS HAVE BEEN PREPARED WITH RESPECT TO COMPLIANCE OF THE 2018 IRC AND NEC 2017. ANY REFERENCES FOUND NOT CORRECTLY IDENTIFIED TO THESE CODES SHALL BE BROUGHT TO THE ATTENTION OF THE DESIGN PROFESSIONAL.


## Permit Set

PLAN DESCRIPTION: Greystone

00

Project No.

Project Number

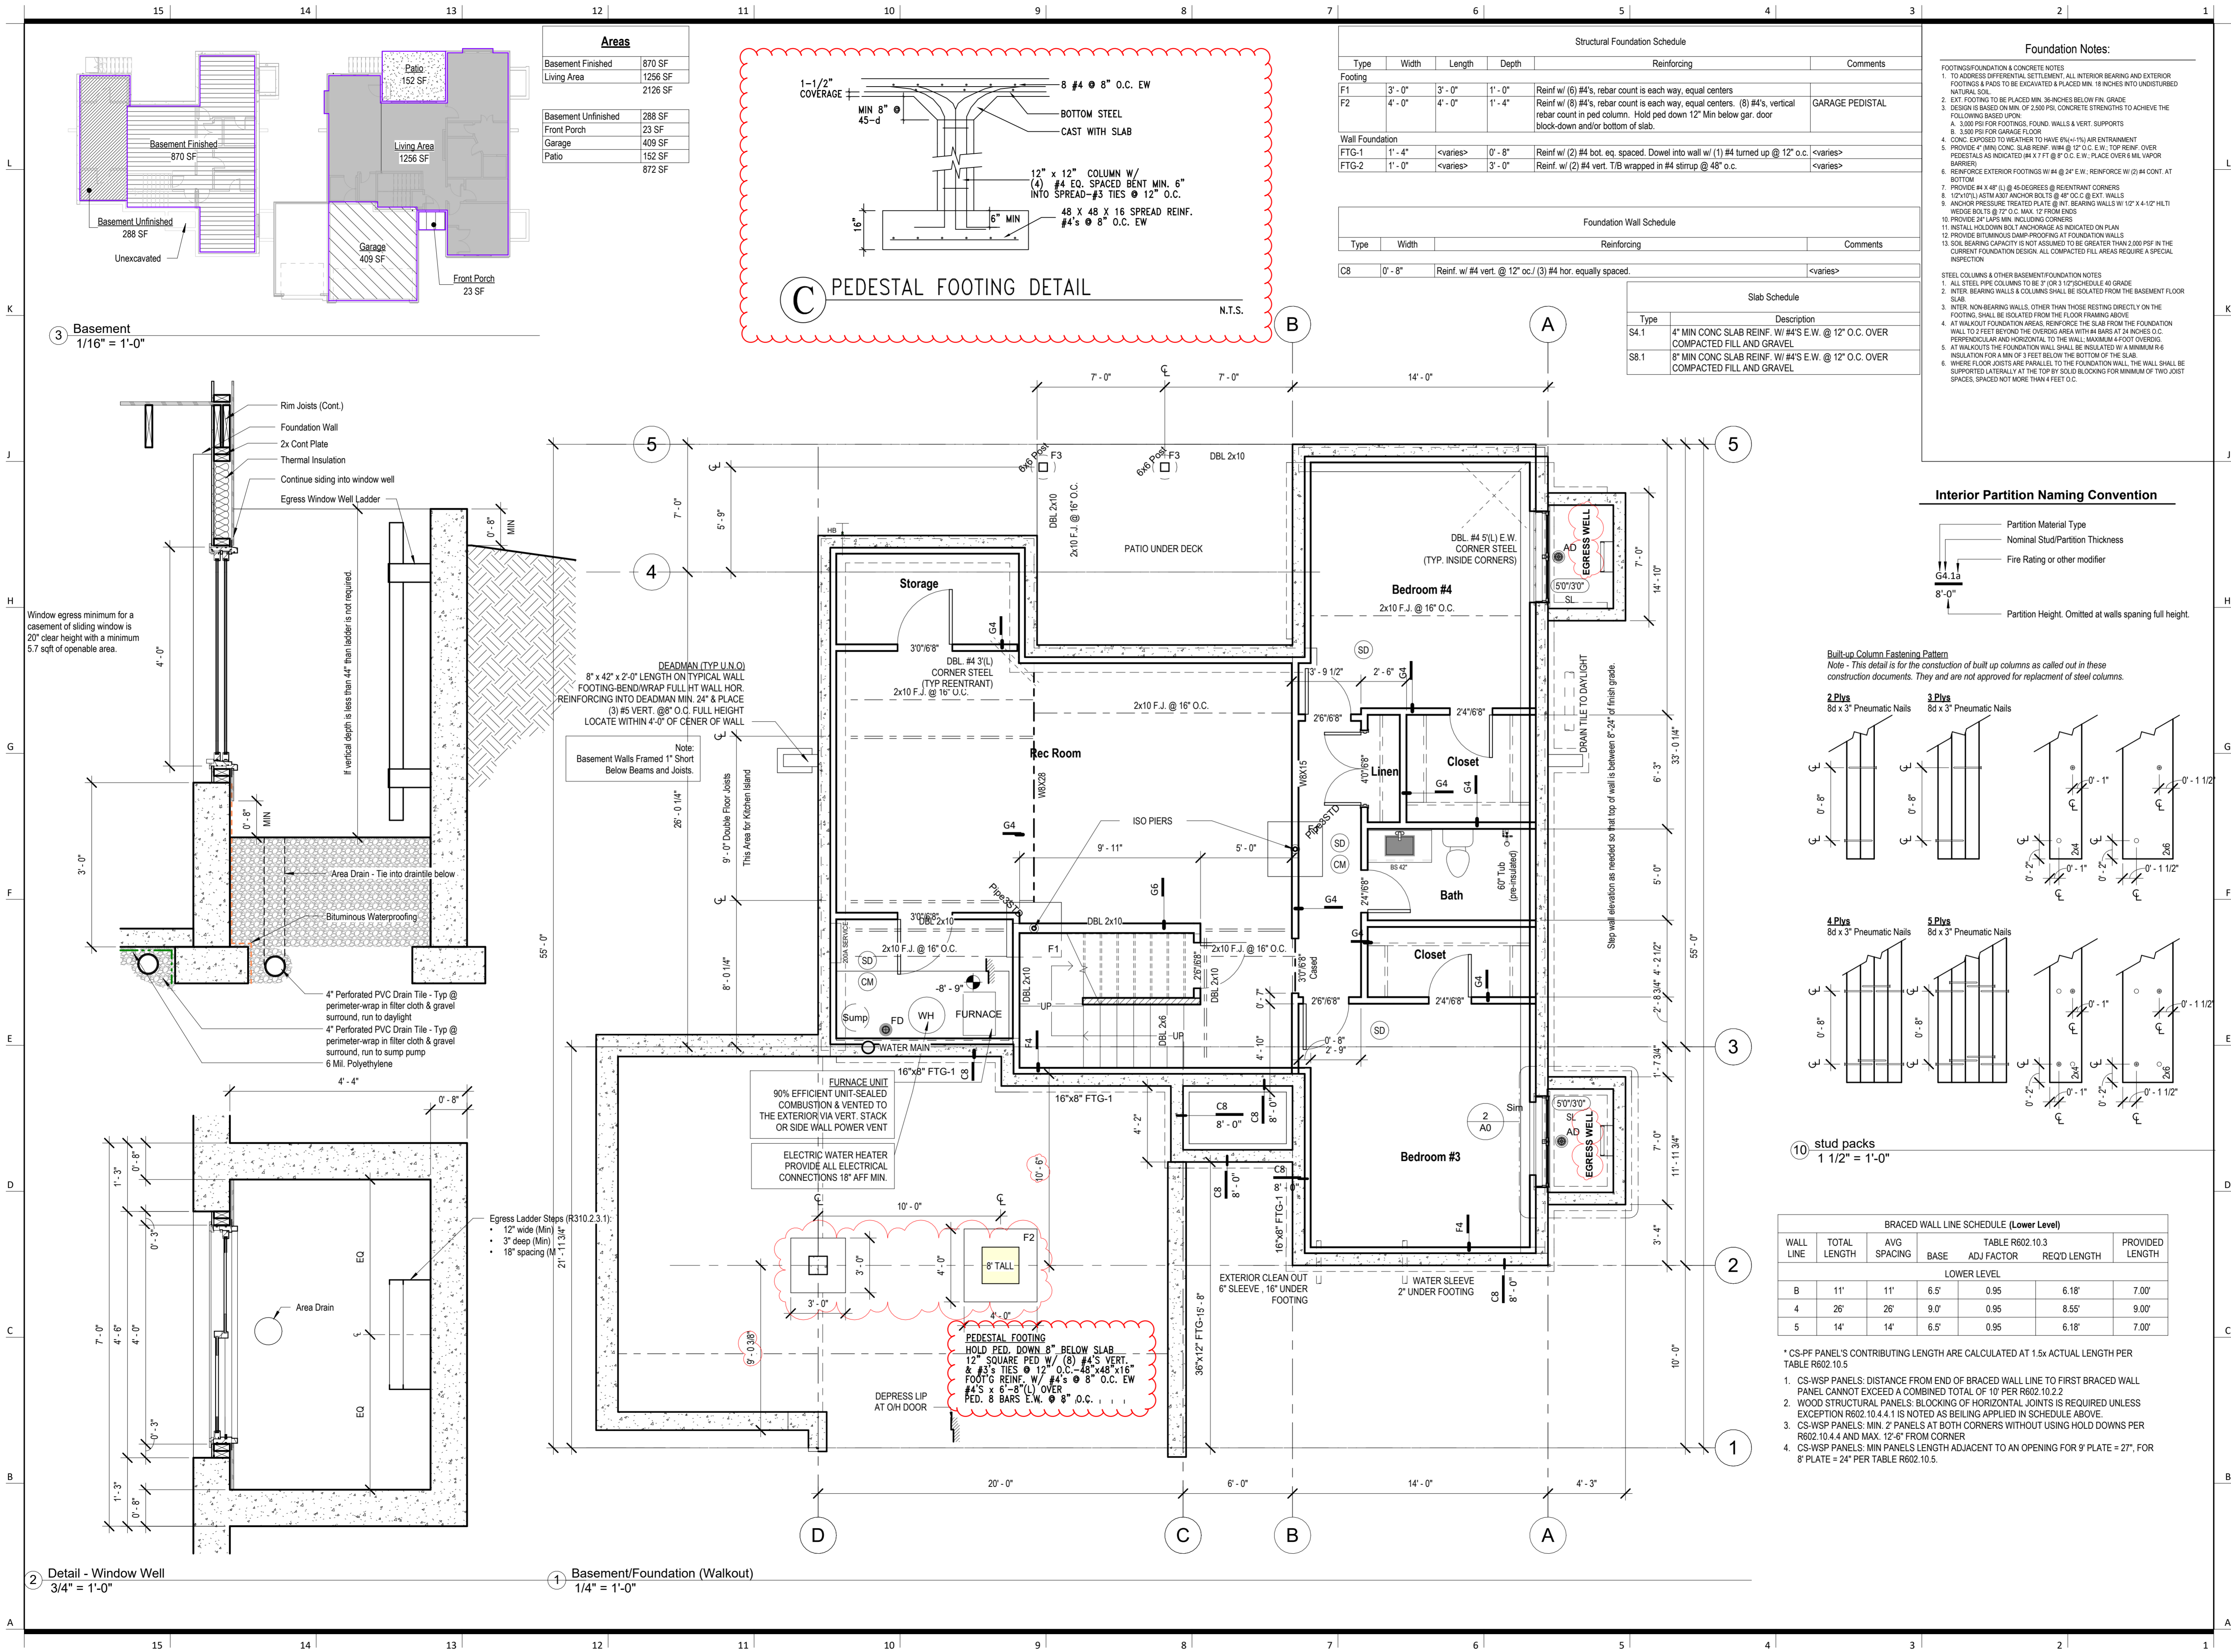

# Lot 176 - Hook Farms

2615 SW Barley Field Dr,  
Lees Summit MO 64082

Architect:  
Elevate Design + Build  
350 SW Longview Blvd  
Lee's Summit, MO 64081  
816.622.8826 voice

2615 SW Barley Field Dr,  
Lees Summit MO 64082

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS  
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR  
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



Original Issue Date: 2022/10/12  
Permit Set


REVISIONS  
Number DESCRIPTION DATE

Floor Plan - Main Level

# A1

Project No. Project Number

## Interior Partition Naming Convention

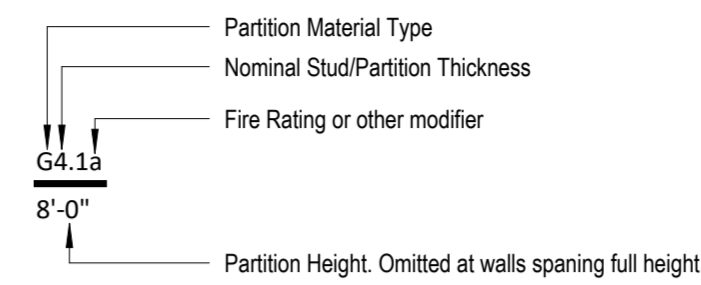

## General Notes:


- DOORS AND WINDOW
- ALL GLAZING WITHIN 12" OF THE FINISHED FLOOR, ADJACENT TO DOORS - 24" AND WITHIN DOORS, ABOVE BATHTUBS TO BE SAFETY TYPE GLASS AND LABELED SUCH AS IN COMPLIANCE W/ SECTION 308 OF THE IRC.
  - SHOWER DOORS SHALL HAVE SAFETY GLAZING. HINGED SHOWER DOORS SHALL SWING OUTWARD.
- GARAGES:
- GARAGE SEPARATION WALL TO BE 1-HR CONST. W/ MIN. 3/8" TYPE X GWB, EXTEND TO BOTTOM OF ROOF. DOOR TO BE 20-MIN RATED, 1-3/8" S.E.C. & EQUIPPED W/ CLOSURE & LATCH.
  - 15 & 20 AMP RECEPTACLES SHALL HAVE GFCI PROTECTION.
  - TYPE X 5/8" GB REQUIRED ON GARAGE CEILING BELOW LIVING AREAS.
- LIGHT AND VENTILATION:
- PROVIDE STAIRWAY ILLUMINATION PER R302.7.2.
  - CABLE VENT & MUSHROOM VENTS TO PROVIDE A MIN. OF 10 S.F. NET FREE OF ATTIC VENTILATION.
  - TURBINES ENCLOSED IN A ROOM LESS THAN 100 S.F. SHALL BE PROVIDED WITH A MEANS OF COMBUSTION MAKE-UP AIR AS DETERMINED/CALCULATED AND PRESCRIBED BY MECH. CONTRACTOR.
  - VENTILATE KITCHENS AND LAUNDRY ROOMS PER R302.3.
  - PROVIDE MIN. 16" x 10" SOFFIT VENTS ALONG EAVE SPACED EVENLY W/ NO MORE THAN 8" O.C.
- GYP/SUM BOARD:
- GWB APPLIED TO CEILINGS SHALL BE 16" WHEN FRAMING MEMBERS ARE 16" O.C. OR 5/8" WHEN MEMBERS ARE 24" O.C. OR USE 1/2" SAG-RESISTANT GYP. CEILING BOARD.
- MECHANICAL SYSTEMS
- FURNACE & WATER HEATER SHALL BE ON 18" PLATFORMS IN CEILING IN A GARAGE OR ROOM W/ DIRECT ACCESS TO A GARAGE.
  - PROVIDE MIN. 75% AFUE FOR WEATHERIZED GAS HEATING EQUIP. 80% FOR NON-WEATHERIZED.
  - PROVIDE MIN. 1/3 SEER FOR AIR CONDITIONING EQUIPMENT.
  - SUPPLY AND RETURN DUCTS SHALL BE INSULATED TO MIN. R-8.
- ELECTRICAL SYSTEMS
- PROVIDE UFER GROUND ENCASED IN CONCRETE FOOTING.
  - ALL ELECTRICAL CONDUCTORS SHALL BE COPPER.
  - RECEPT. IN THE FOLLOWING LOCATIONS SHALL BE GFCI PROTECTED:
    - BEDROOM, KITCHEN (WITHIN 6 FEET OF SINK), GARAGE, SHED, EXTERIOR, UNFINISHED BASEMENT & HEATED FLOORS.
  - ALL BRANCH CIRCUITS THAT SUPPLY 120-V. SHINGLE PHASE, 15 & 20 AMP OUTLETS INSTALLED IN:
    - BEDROOMS, SUNROOMS, REC ROOMS, CLOSETS, HALLWAYS, & SIM. ROOMS SHALL BE PROTECTED BY A COMBINATION TYPE ARC-FAULT CIRCUIT INTERRUPTER INSTALLED TO PROVIDE PROTECTION OF THE BRANCHED CIRCUIT.
  - ALL 15 & 20 A RECEPT. SHALL BE LISTED TAMPER-RESISTANT.
    - EXCEPTION: RECEPT. IN THE FOLLOWING LOCATIONS SHALL NOT BE REQUIRED TAMPER-RESISTANT:
      - RECEPT. LOCATED MORE THAN 5.5 FEET AFF.
      - WHERE SUCH RECEPT. ARE LOCATED IN SPACES DEDICATED FOR THE APPLIANCE SERVED & UNDER CONDITIONS OF NORMAL USE, THE APPLIANCE ARE NOT EASILY MOVED. APPLIANCES TO BE CORN-PLUG CONNECTED TO RECEPT.
- EXTERIOR WALL FRAMING
- BOTTOM SILL PLATES SHALL BE PRESSURE TREATED OR EQUAL.
  - SILL PLATES SHALL BE EXTENDED MIN. 6 INCHES ABOVE GRADE.
  - ALL EXT. STUDS TO BE SECURED TO THEIR DOUBLE TOP PLATES W/ (2) 16d NAILS (MIN).
  - ALL EXTERIOR CORNERS TO BE BRACED WITH 7/16" OSB NAILING SCHEDULE SHALL BE AS COMMON @ 6" O.C. ALONG EDGES & COMMON @ 12" O.C. @ INTERMEDIATE STUDS.
- ROOF FRAMING
- ALL ROOF EAVES/OVERHANGS TO BE 16" UNO.
  - ALL JOISTS & RAFTERS TO BE ALIGNED OVER SLIDS.
  - ROOF SHEATHING SHALL BE 7/16" OSB LAD W/ LONG DIMENSION PERPENDICULAR TO EAVE LINE & STAGGERED 48" O.C. W/ LONG DIMENSION PERPENDICULAR TO EAVE LINE & STAGGERED 48" O.C. W/ GALV. SPACER CLIPS ALONG ALL EDGES. SECURE SHEATHING W/ 6d COMMON NAILS TO RAFTERS AT 6" O.C. ALL EDGES.
- UNFINISHED BASEMENT REQUIREMENTS
- FIRE PROTECTION OF FLOORS: FLOOR ASSEMBLIES CONSTRUCTED W/ JOISTS LESS THAN 2X10 DIMENSIONAL LUMBER.
  - JOISTS OR OPEN WEB JOISTS OVER UNFINISHED BASEMENTS SHALL BE PROVIDED WITH 5/8" GWB.
  - UNFINISHED BASEMENTS SHALL BE MIN. R-13 INSULATED WALL OR INSULATED ON FLOOR/CEILING (MIN R-19).
  - ALL EXPOSED HVAC DUCTING IN UNFINISHED BASEMENTS TO BE MIN R-8 INSULATED OR ENCLOSED INSIDE A FLOOR/CEILING.
  - UNFINISHED BASEMENTS SHALL HAVE NO CONDITIONED AIR OUTLETS.
- EROSION CONTROL
- EROSION CONTROL MEASURES SHALL BE IN PLACE & IN GOOD WORKING ORDER AT ALL TIMES DURING INSPECTIONS. IN THE EVENT THAT THEY ARE NOT, THE INSPECTOR MAY CANCEL THE INSPECTION UNTIL SUCH TIME THE EROSION CONTROL MEASURES ARE IN PLACE. A FINE, NO INSPECTION FEE & STOP WORK ORDER MAY BE ISSUED IF EROSION CONTROL IS NOT ADDRESSED. MINIMUMS INCLUDE:
    - A. SILT FENCE OR STRAW BATTLE AROUND ALL DISTURBED SOIL. SHALL BE IN PLACE BEFORE ANY EXCAVATION BEGINS.
    - B. TEMPORARY GRAVEL CONSTRUCTION ENTRANCE. THIS ENTRANCE SHOULD BE THE ONLY ENTRANCE & EXIT USED FOR VEHICLES INTO & OUT OF THE SITE.
    - C. STREETS SHALL BE MAINTAINED FREE OF ALL SOIL & GRAVEL IN A BROOM CLEAN CONDITION AT ALL TIMES.
- WOOD FRAMING, FLOORS AND ROOF NOTES:
- EXT. WALL FRAMING TO BE 2 x 4 (SYP OR DFL STUD GRADE 2 OR BETTER) @ 16" O.C.
  - ROOF SHEATHING TO BE 7/16" OSB NAILED W/ 8d @ 6" O.C. PANEL INDEX 240; PROVIDE CLIPS AT UNSUPPORTED PANEL EDGES.
  - SHEATH EXT. WALLS W/ 7/16" OSB NAILED W/ 8d @ 6" O.C.
  - HEADERS: PROVIDE (2) 2 x 4 (SYP OR DFL #2 OR BETTER) UNO. CONSTRUCT HEADERS W/ 2 x 4 & 7/16" OSB BETWEEN W/ (2) ROWS OF 16d @ 16" O.C.
  - BLOCKING MIN. 1.5 INCHES UTILITY GRADE LUMBER JOISTS TO BE SUPPORTED AT ENDS FULL DEPTH SOLID BLOCKING NOT < 2 INCHES.
  - I.F. J. C.J. & RAFTERS TO BE SYP OR DFL GRADE #2 OR BETTER.
  - EXT. WALL STUDS & LOAD BEARING WALLS TO BE CONTINUOUS FROM FLOOR TO ROOF/CEILING DIAPHRAGM PER IRC 602.3.
  - STUDS, RAFTERS, JOISTS, MS. LUMBER MIN. GRADE #2 D.F. OR S.Y.P.
- PHYSICAL SECURITY ORDINANCE
- OWNER/BUILDER IS RESPONSIBLE FOR COMPLIANCE OF PHYSICAL SECURITY ORDINANCE FOR THEIR LOCAL JURISDICTION.

BRACED WALL LINE SCHEDULE						
WALL LINE	TOTAL LENGTH	AVG SPACING	BASE	TABLE R602.10.3 ADJ FACTOR	REQ'D LENGTH	PROVIDED LENGTH
MAIN FLOOR						
A	45'	45'	9'	0.95	8.55'	9.00'
B	45'	15'	10.5'	1.38	14.46'	15.00'
C	22'	22'	5.5'	0.95	5.23'	10.00'
D	50'	25'	11'	1.24	13.59'	14.00'
1	20'	20'	3.5'	0.95	3.33'	6.00"
2	14'	14'	3.5'	0.95	3.33'	4.00'
3	26'	13'	7'	1.24	8.65'	9.00'
4	26'	26'	5.5'	0.95	5.23'	12.00"
5	14'	14'	3.5'	0.95	3.33'	6.00'


- \* CS-PF PANEL'S CONTRIBUTING LENGTH ARE CALCULATED AT 1.5x ACTUAL LENGTH PER TABLE R602.10.5
- CS-WSP PANELS: DISTANCE FROM END OF BRACED WALL LINE TO FIRST BRACED WALL PANEL CANNOT EXCEED A COMBINED TOTAL OF 10' PER R602.10.2.2
  - WOOD STRUCTURAL PANELS: BLOCKING OF HORIZONTAL JOINTS IS REQUIRED UNLESS EXCEPTION R602.10.4.4.1 IS NOTED AS BEING APPLIED IN SCHEDULE ABOVE.
  - CS-WSP PANELS: MIN. 2" PANELS AT BOTH CORNERS WITHOUT USING HOLD DOWNS PER R602.10.4.4 AND MAX. 12'-6" FROM CORNER
  - CS-WSP PANELS: MIN PANELS LENGTH ADJACENT TO AN OPENING FOR 9' PLATE = 27", FOR 8' PLATE = 24" PER TABLE R602.10.5.

## Brace System

1 1/2" = 1'-0"

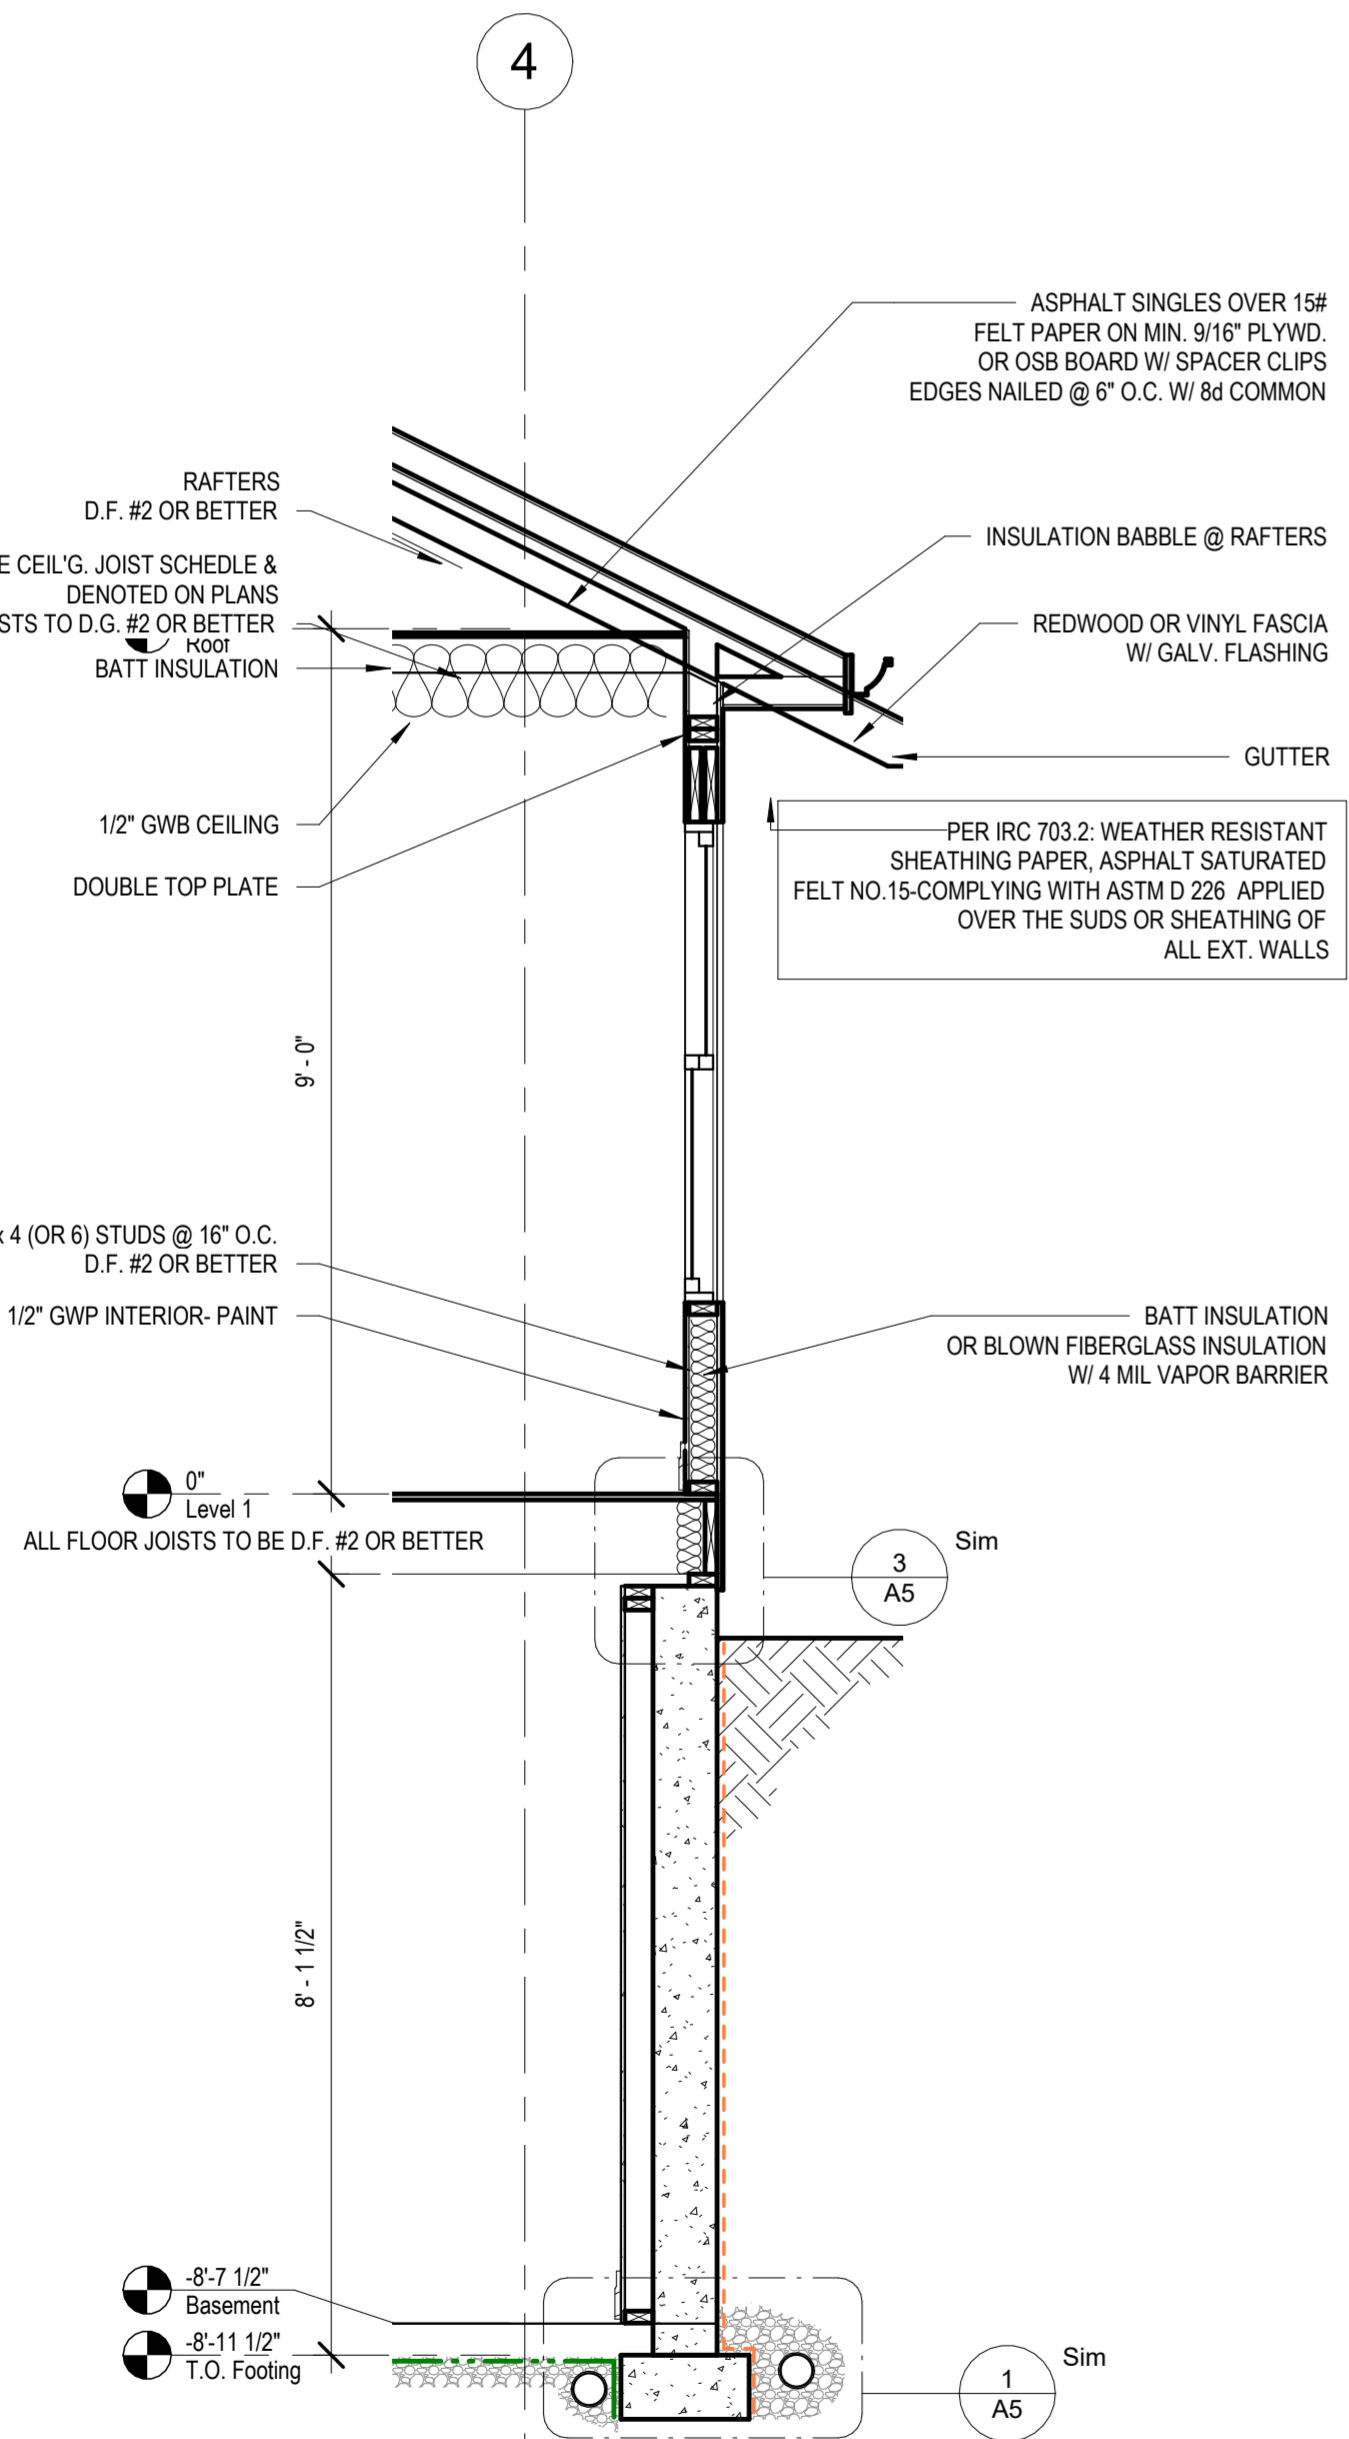

Framer to provide the 3/4\"/>

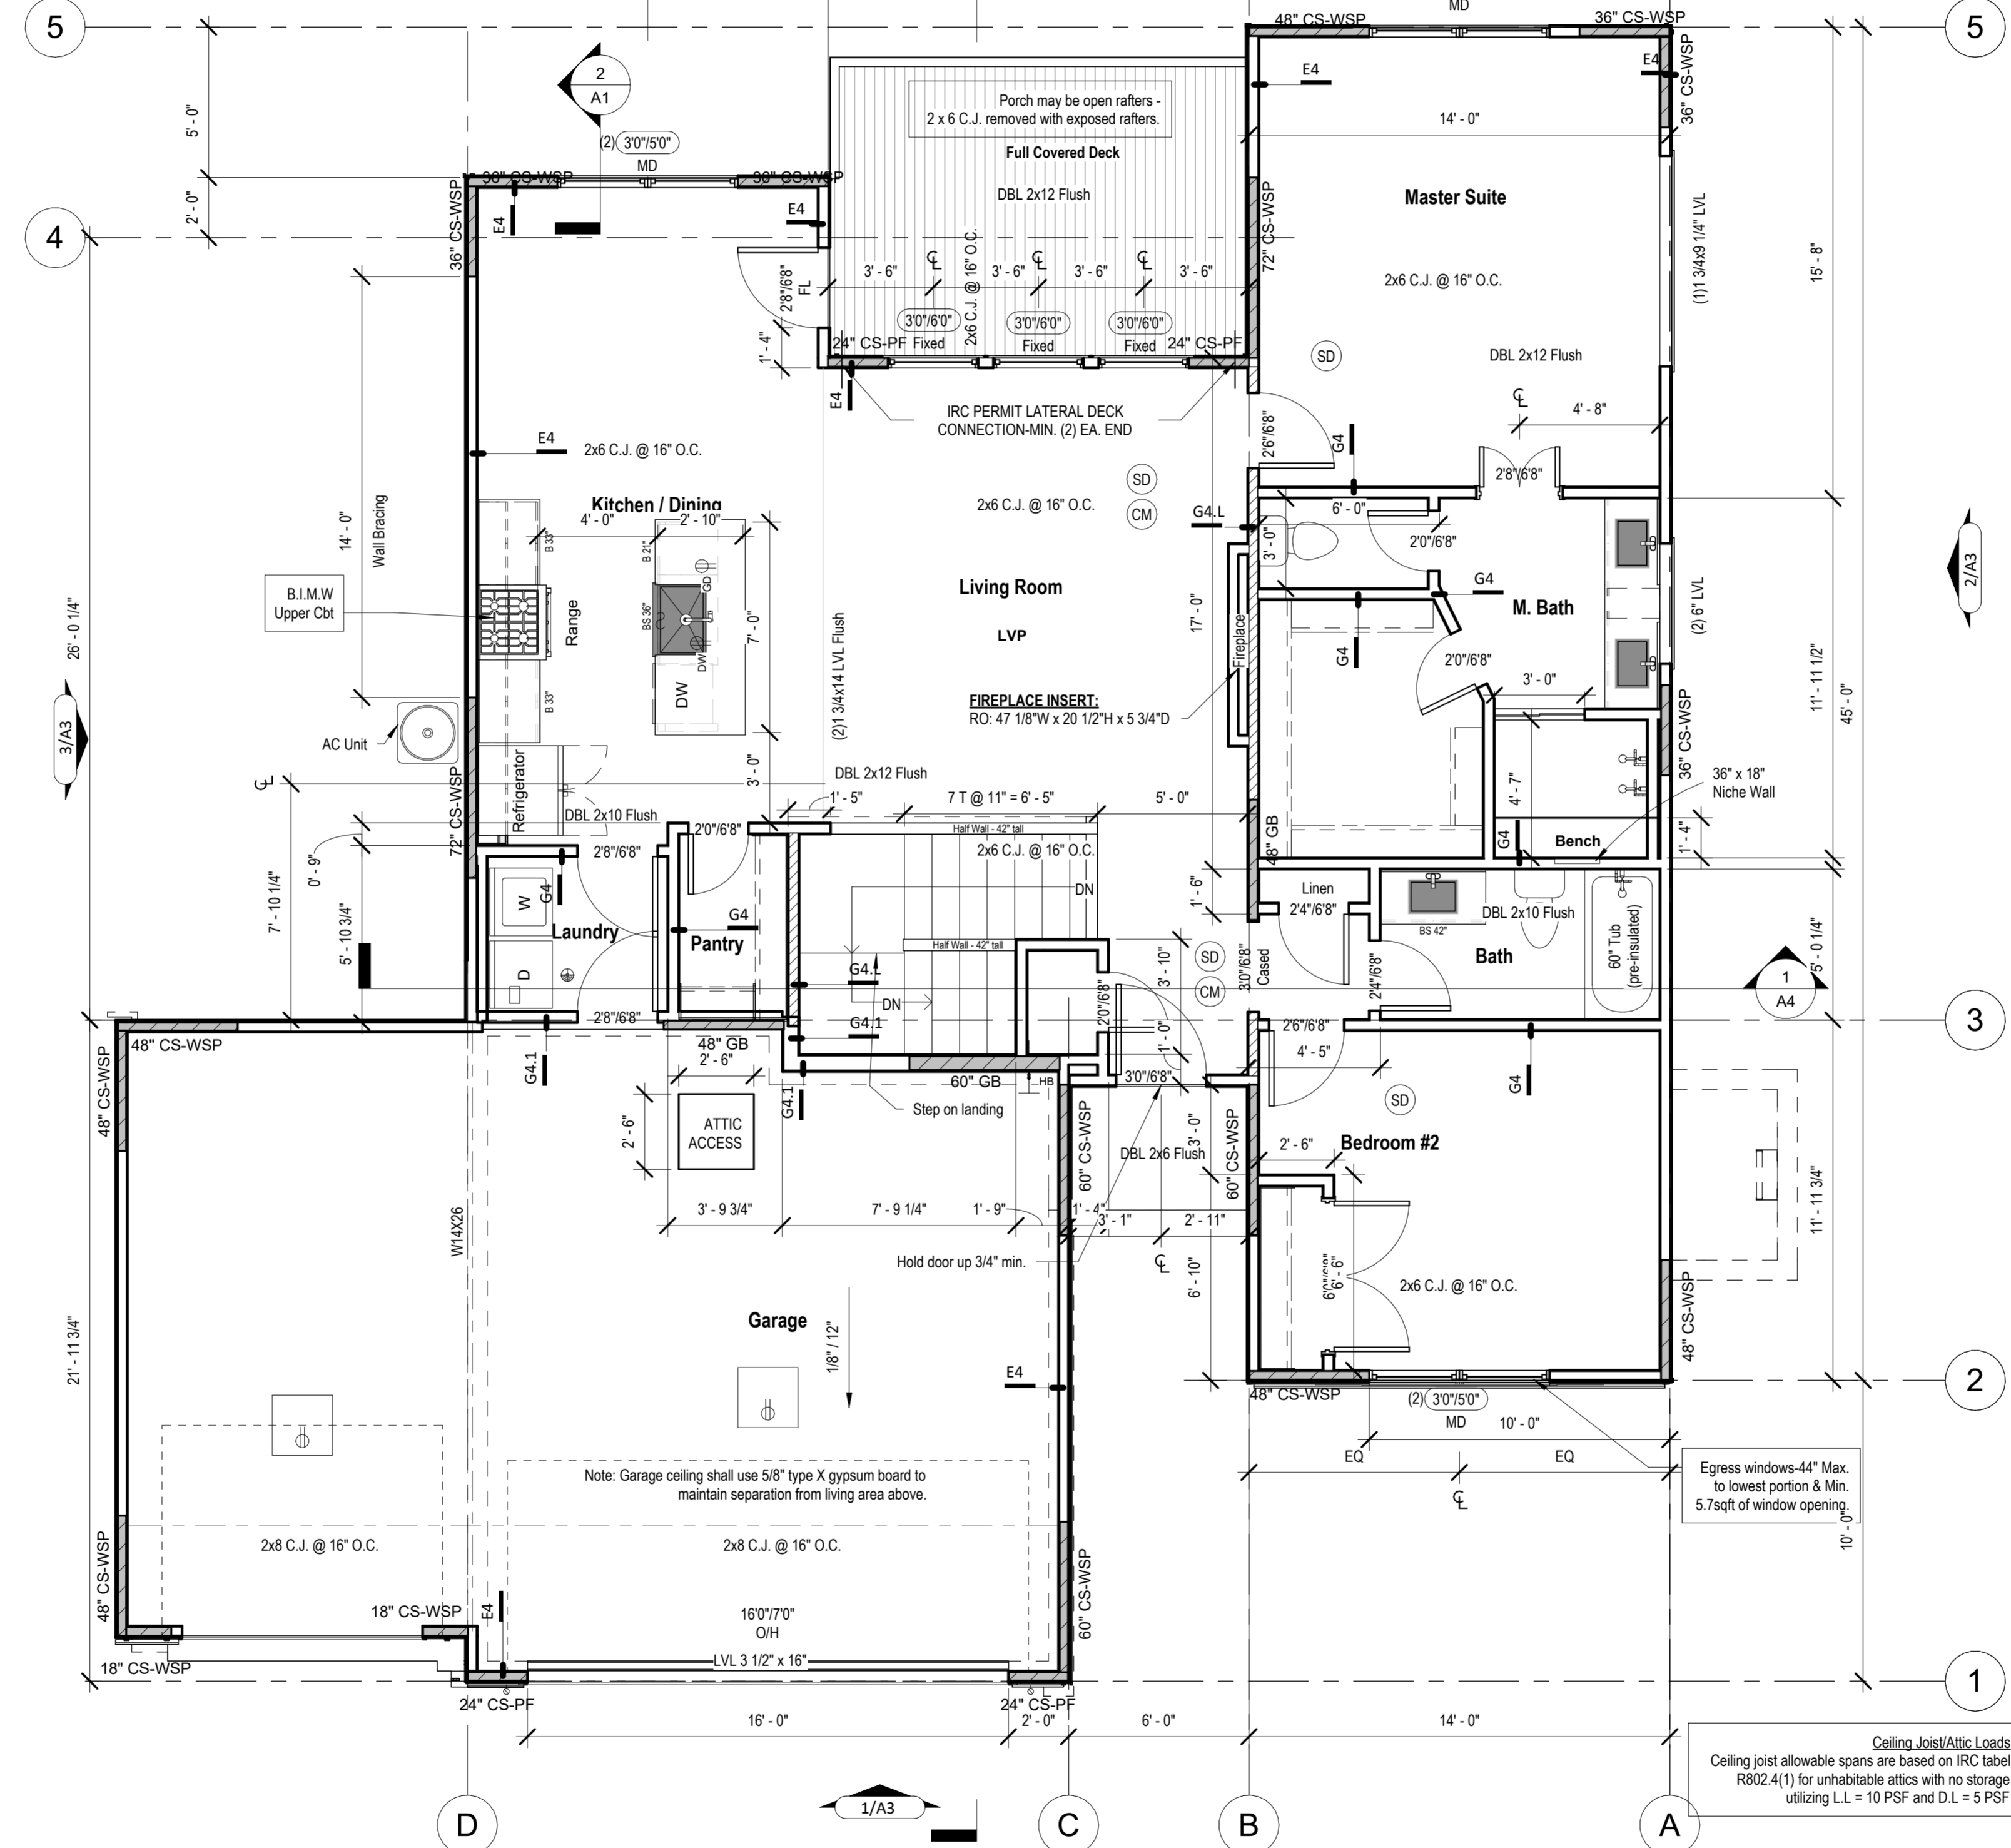

## Floor Plan - Living Space (Walkout)

1/4\"/>

## Section 3

1/2\"/>

**Lot 176 - Hook Farms**  
2615 SW Barley Field Dr,  
Lees Summit MO 64082

architect:  
**Elevate Design + Build**  
350 SW Longview Blvd  
Lee's Summit, MO 64081  
816.622.8826 voice

2615 SW Barley Field Dr,  
Lees Summit MO 64082

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS  
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR  
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



Original Issue Date: 2022/10/12  
Permit Set

REVISIONS

Number	DESCRIPTION	DATE
--------	-------------	------


RCP/Electrical Plan

**A2**


Project No. Project Number

Lighting Fixture Schedule		
Type Mark	Description	Type Comments
B1	Ceiling Mounted Exposed Bulb	
C2	Recessed Can Light - Exterior	
C3	LED Disk Light	
CF1	Ceiling Fan w/ Light - Surface Mounted	
P2	Decorative Pendant Fixture	Mount bottom of fixture 84" AFF
S1	Wall Sconce - Exterior	

Note:  
1. Lighting fixtures penetrating the thermal envelope (Ex: can lights in attic) shall be IC-Rated, Leakage-Rated and sealed to teh gypsum wallboard (N1103.1.1)

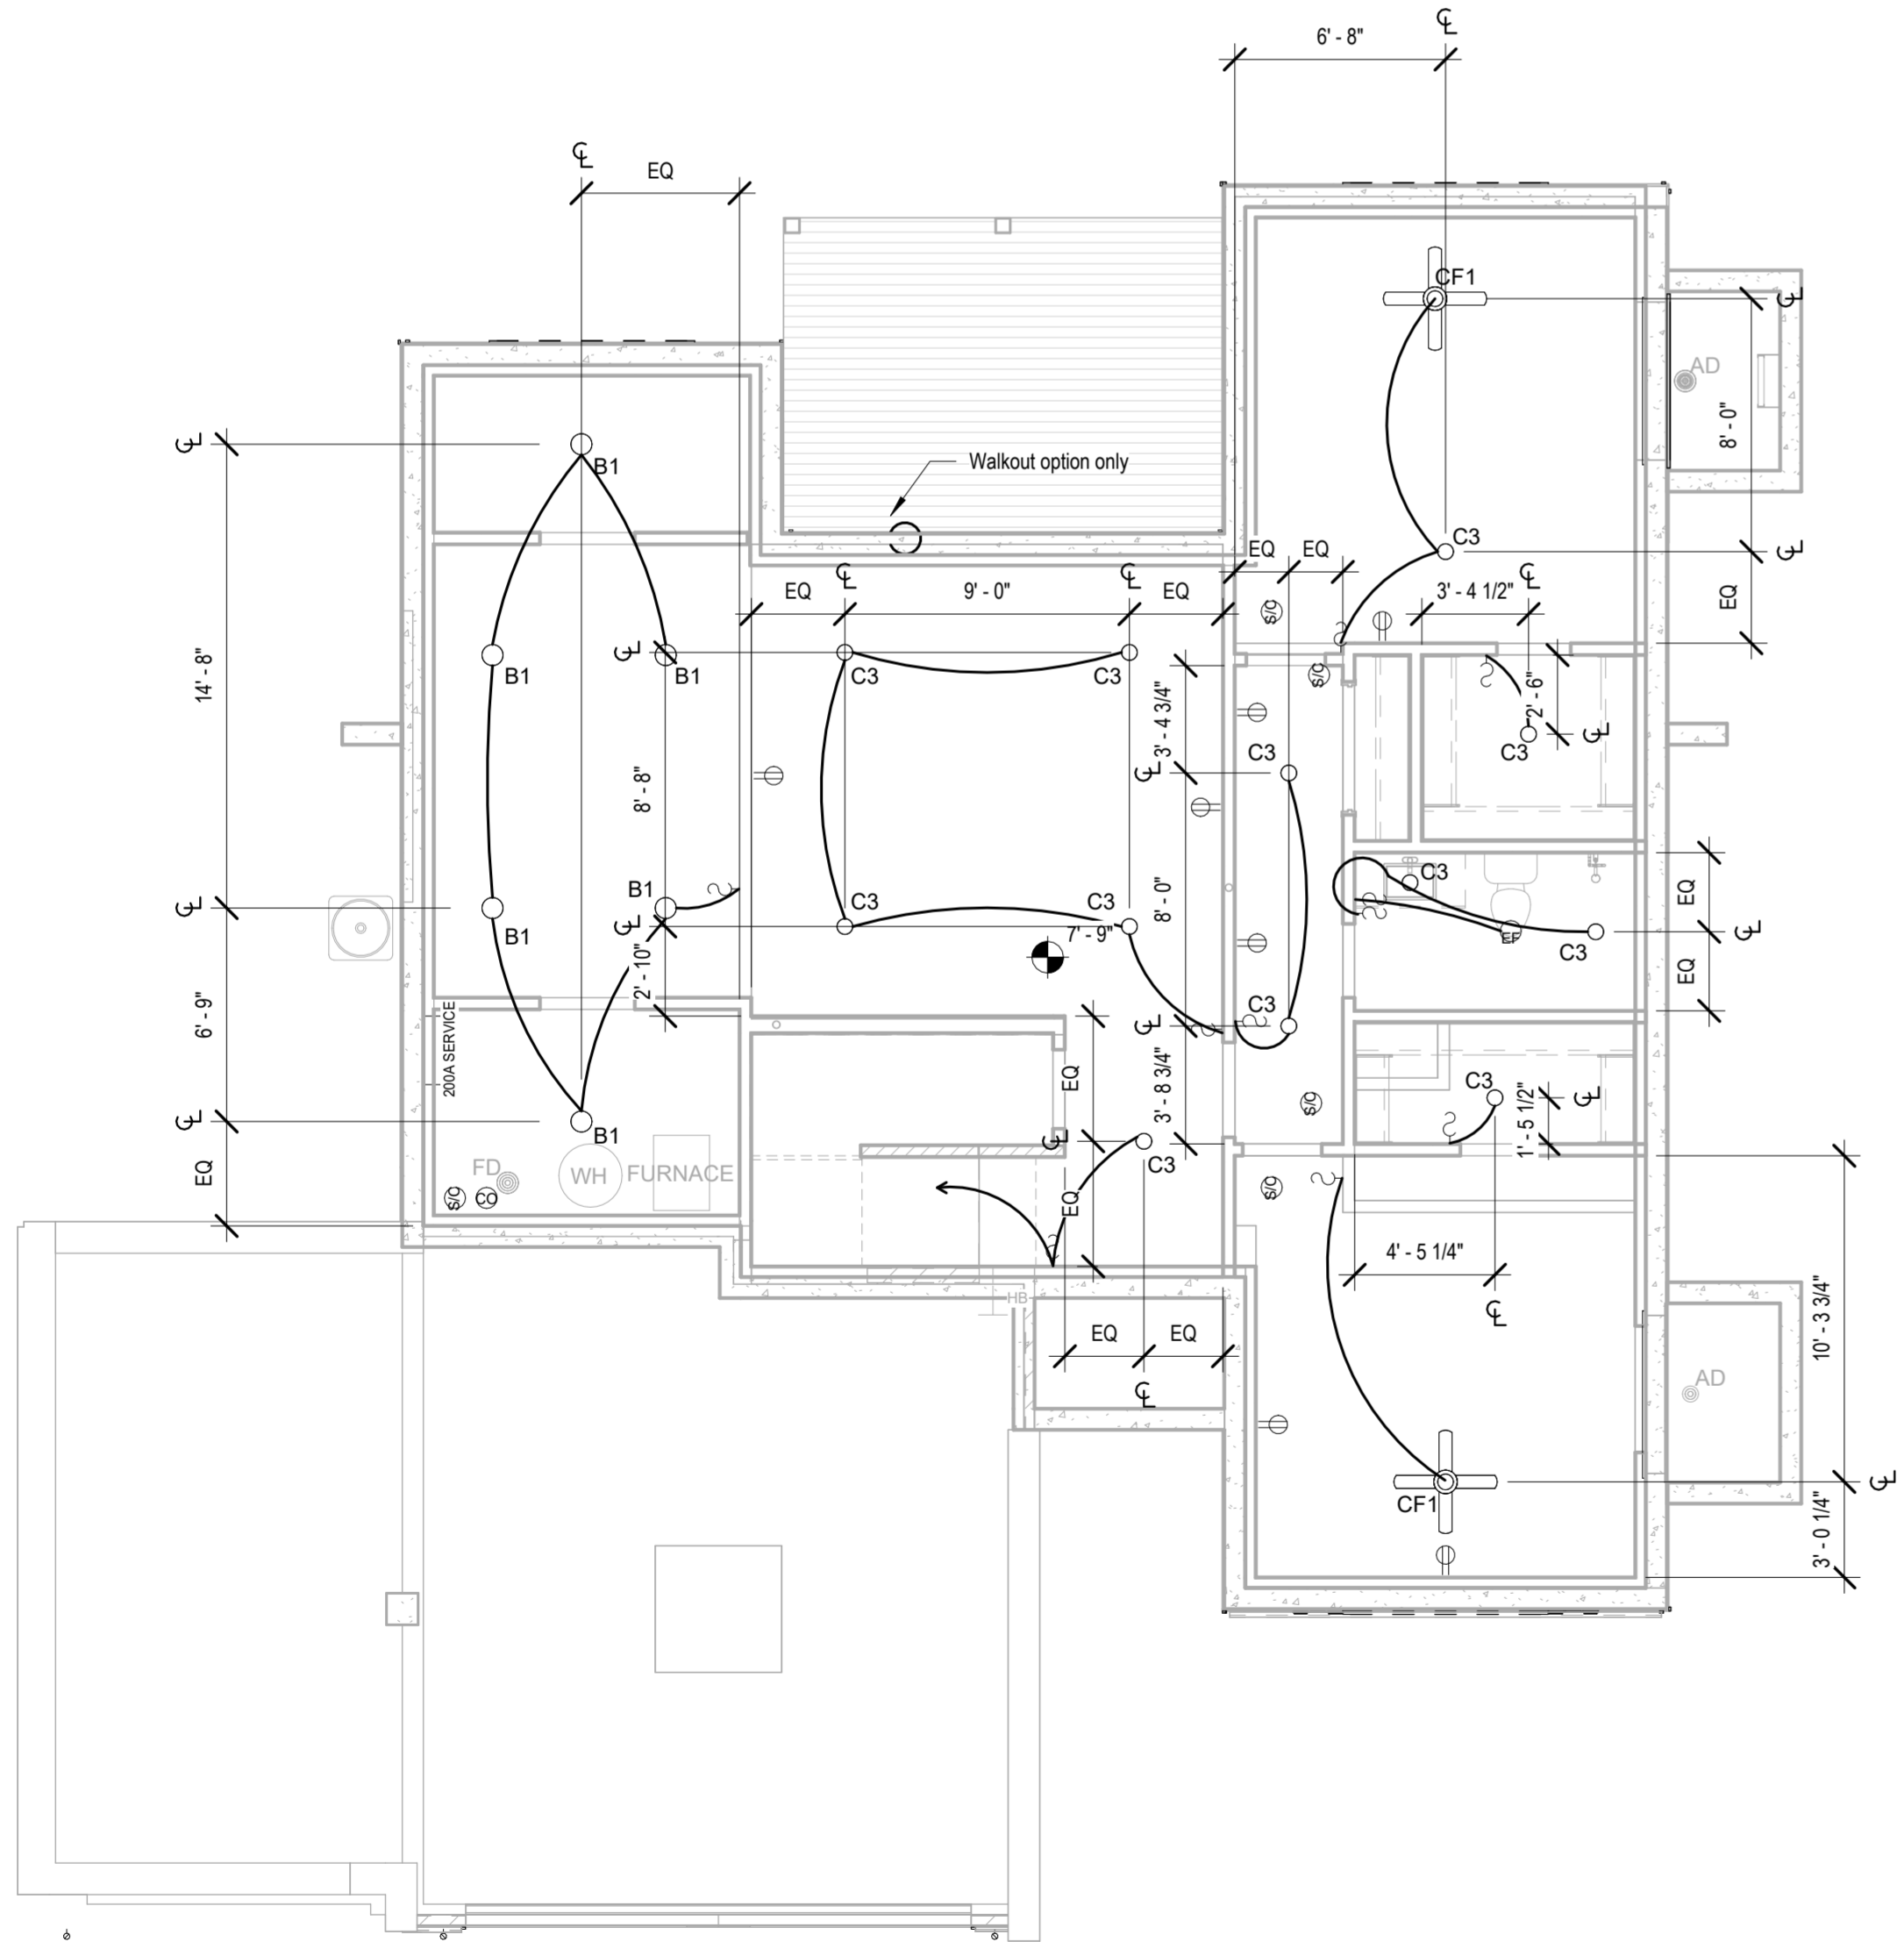

② RCP/Electrical - Basement  
3/16" = 1'-0"

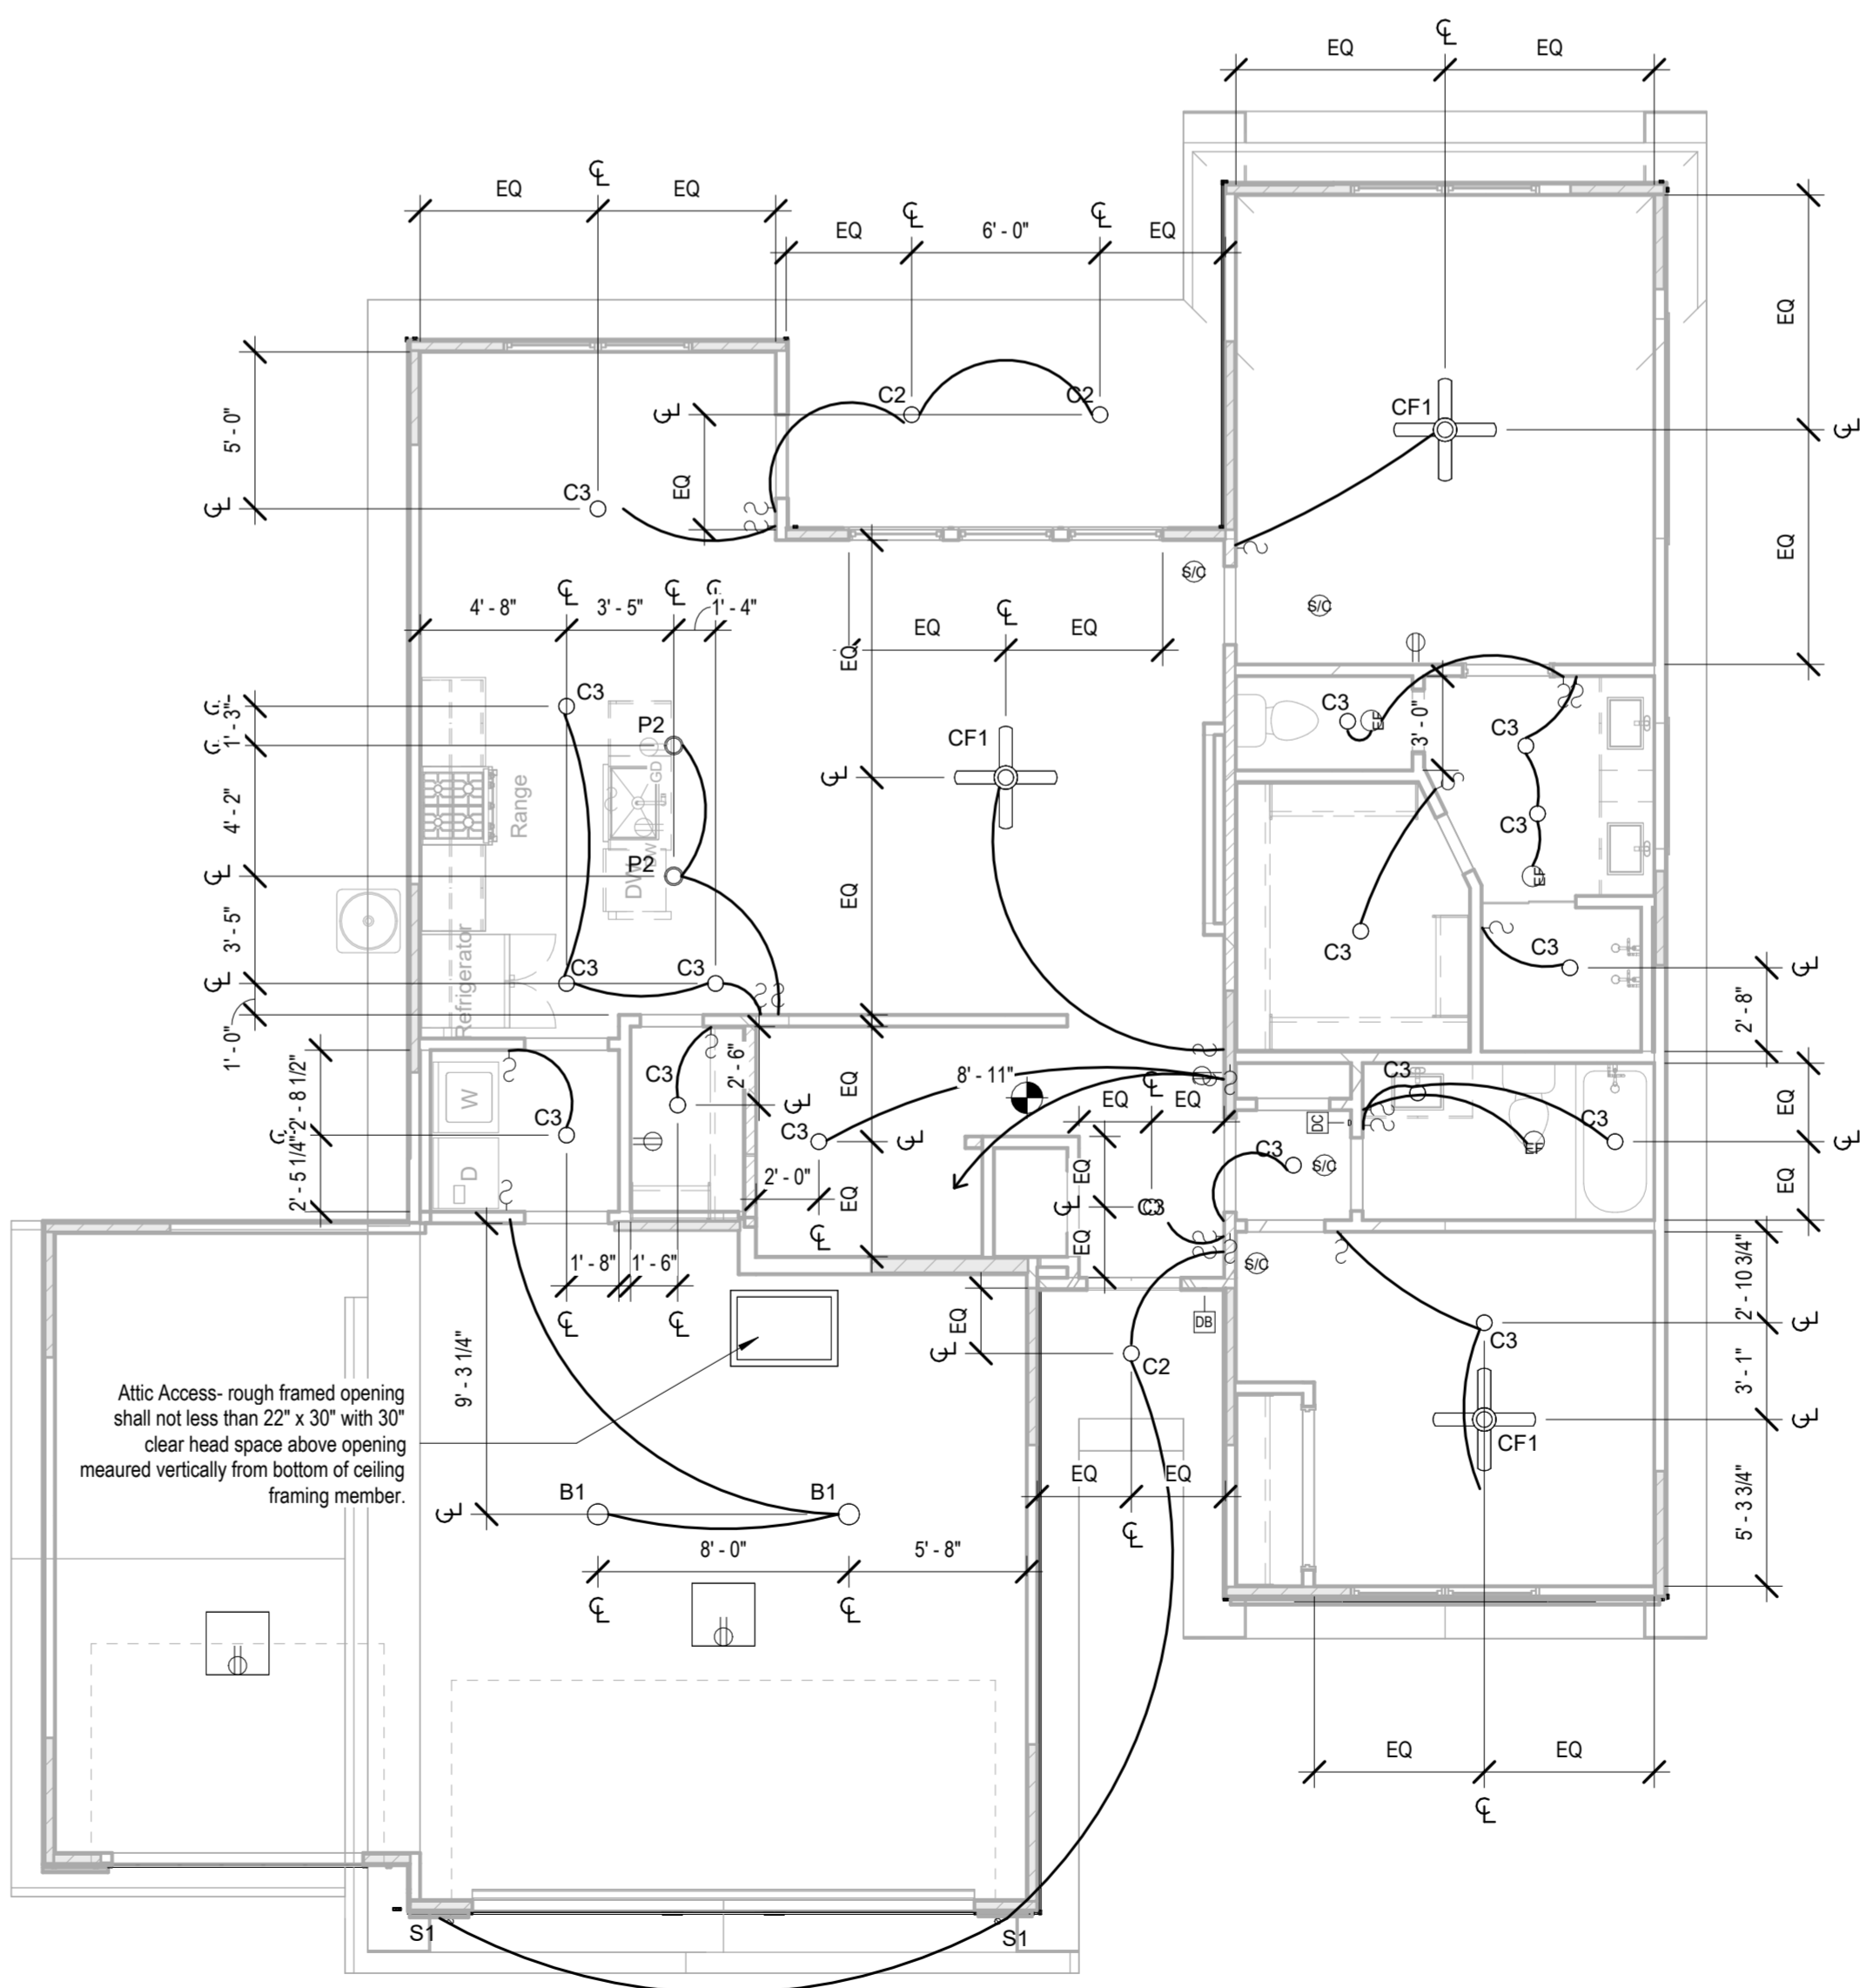

① RCP/Electrical Plan - Main Level  
3/16" = 1'-0"

# Lot 176 - Hook Farms

2615 SW Barley Field Dr,  
Lees Summit MO 64082

architect:  
Elevate Design + Build  
350 SW Longview Blvd  
Lee's Summit, MO 64081  
816.622.8826 voice

2615 SW Barley Field Dr,  
Lees Summit MO 64082

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS  
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR  
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



Original Issue Date: 2022/10/12  
Permit Set


REVISIONS

Number	DESCRIPTION	DATE
--------	-------------	------


Elevations

## A3.B


Project No. Project Number

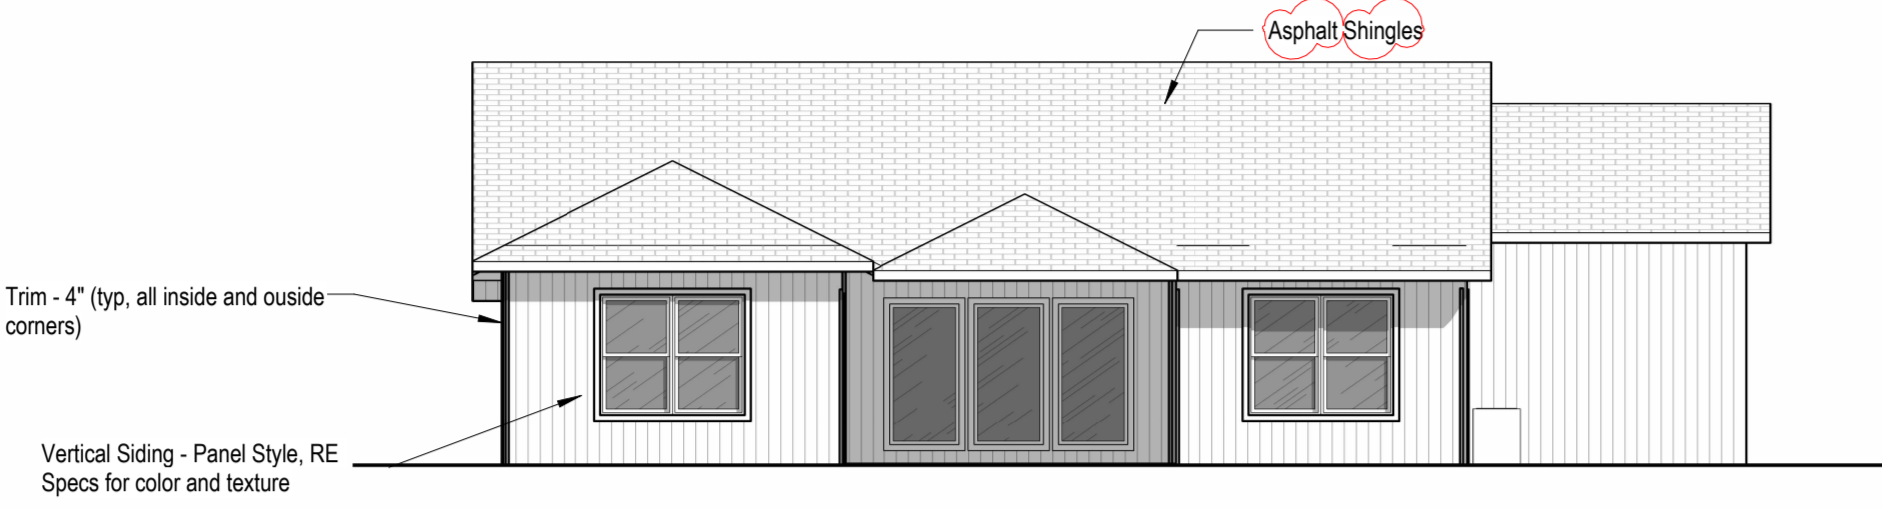

4 Back Elevation  
1/8" = 1'-0"

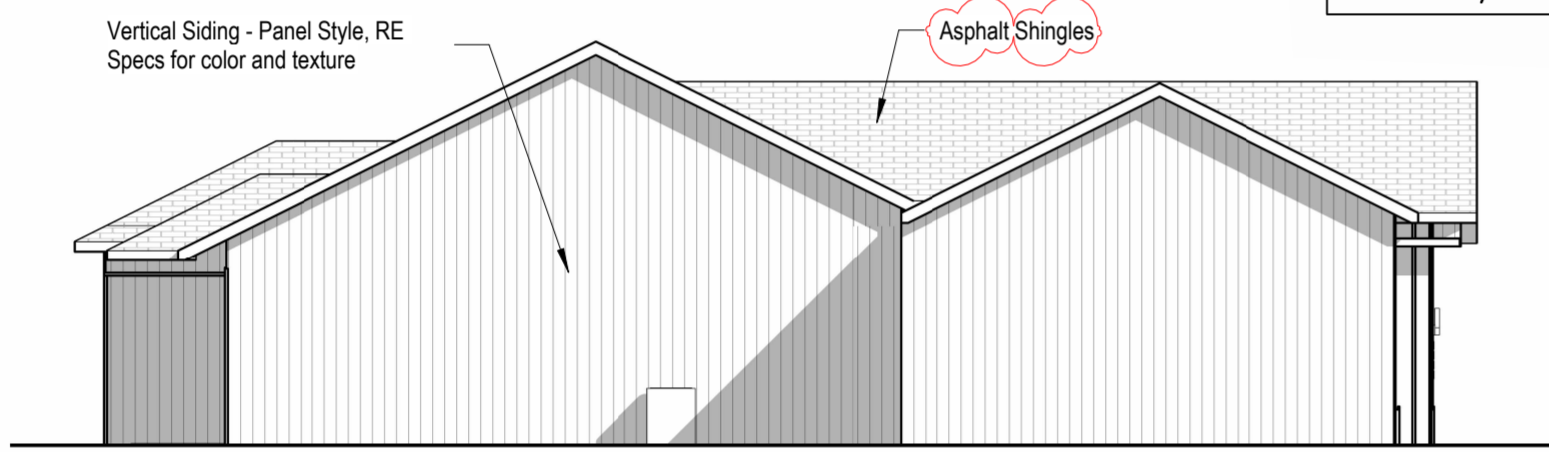

3 Right Elevation  
1/8" = 1'-0"

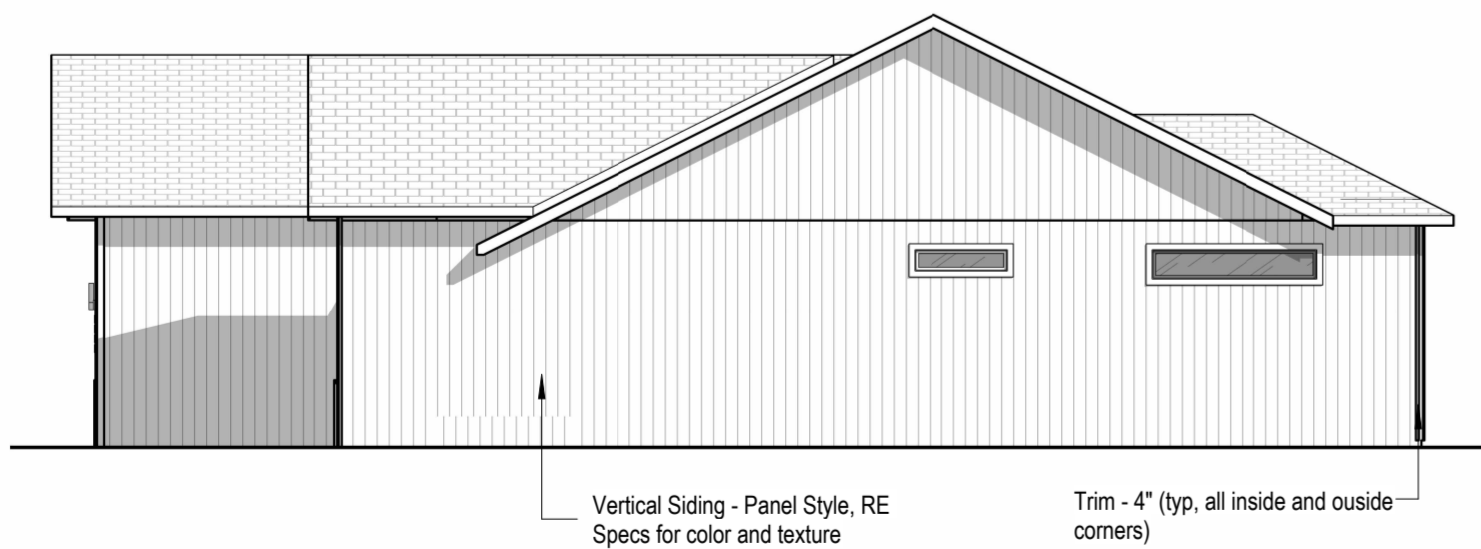

2 Left Elevation  
1/8" = 1'-0"

ROOF RAFTER SCHEDULE						
GRADE	MEMBER	MAX SPAN	MAX SPAN	MAX SPAN	MAX SPAN	MAX SPAN
	SIZE / SPACING	CEILING JOISTS AT TOP PLATE	H <sub>2</sub> /H <sub>1</sub> =0.16	H <sub>2</sub> /H <sub>1</sub> =0.20	H <sub>2</sub> /H <sub>1</sub> =0.25	H <sub>2</sub> /H <sub>1</sub> =0.33
#2 DF/L	2x6 / 16"oc	14'-4"	12'-8"	11'-8"	10'-4"	9'-5"
#2 DF/L	2x6 / 16"oc	18'-2"	16'-4"	15'-4"	13'-4"	12'-2"
#2 DF/L	2x10 / 16"oc	22'-3"	20'-0"	18'-5"	16'-8"	14'-8"
#2 DF/L	2x12 / 16"oc	25'-4"	23'-2"	21'-4"	19'-7"	17'-3"

**CEILING JOISTS AND RAFTER CONNECTIONS**  
CEILING JOISTS AND RAFTERS SHALL BE TIED TO ONE ANOTHER PER TABLE R602.3(1) AND R802.5.1(9) AND THE ASSEMBLY SHALL BE NAILED TO THE TOP PLATE PER R602.3(1).  
CEILING JOIST NOT PARALLEL TO RAFTERS USE SUBFLOORING OR METAL STRAPS ATTACHED TO END OF THE RAFTERS TO PROVIDE A CONT. TIE ACROSS THE STRUCTURE.  
TIE DOWN REQUIREMENTS (R802.11)  
FOR RAFTER SPANS OVER 20'-0" INTERPOLATING TABLE 802.11 PROVIDE RATER TIE-DOWNS CAPABLE OF RESISTING OVER 226 POUNDS AT EACH RAFTER.  
PER TABLE R802.5.1(2) THE MAX RAFTER SPAN FOR D.F.L. 2 x 6 RAFTERS #2 GRADE = 14'-1" AND IS THE BASIS OF DESIGN FOR PURLIN PLACEMENT.

ALL RIDGE BEAMS TO BE 2 x 12 OR 2 x 10  
RAFTER TIES/COLLARS REQUIRED AT ALL LOCATIONS

**RAFTER/CEILING JOIST HEEL CONNECTIONS**  
PROVIDE (5) 16d NAILS AT EACH HEEL JOINT (RAFTER-JOIST, RAFTER-TIE) CONNECTION. ALSO DENOTED IN DETAIL FOR TYP. ROOF/RAFTER FRAMING. THIS MEETS/EXCEEDS TABLE 802.5.1(9) FOR ROOF SPANS UP TO 28'-0" MAX. 9/12 PITCH AND RAFTERS 16" O.C.

**ROOF FRAMING CONNECTION TO BEAMS**  
WHERE LVL IS BE INSTALLED IN PLANE, PROVIDE SIMPSON STRONG TIE LRU282 RAFTER HANGERS EA. RAFTER TO LVL. EACH END OF LVL TO BE SECURED TO SUPPORTING CONSTRUCTION WITH SST LSTA15 OR EQUIVALENT STRAP W/ 1100 LBS. CAPACITY. STRAPPING SHALL BE REQUIRED AT ALL NON-CONT. MEMBERS BETWEEN BEAM & TOP OF FLOOR.


**RAFTER TIES:**  
1. REQUIRED AT ALL RAFTERS  
2. MIN. OF 2 x 4 AND SPACED NO GREATER THAN 48" O.C.

**FOR FULL VAULT**  
WHERE NO COLLAR TIES CAN BE INSTALLED, PROVIDE AT EA. RAFTER A SIMPSON STRONG TIE LRU282 HANGER OR EQUIVALENT TO RIDGE BEAM W/ (6) 10d NAILS TO RIDGE & (5) 10d NAILS TO EACH RAFTER.


**PURLINS:**  
1. PURLINS NO SMALLER THAN THE RAFTERS THEY SUPPORT  
2. PURLINS TO BE CONTINUOUS  
3. BRACES SPACED NO MORE THAN 4'-0" O.C.  
4. UNBRACED LENGTH OF BRACES SHALL NOT > 8'-0"

MIN. (3) 10d NAILS  
2 x 4 COLLAR TIE  
MAX LENGTH = 8'-0" O.C.  
RAFTER TIE SAME SIZE AS JOIST ATOP  
PER TABLE R802.5.1(9) REQUIRES (3) 16d NAILS  
CEIL'G JOISTS  
SUBFLOORING OR METAL STRAPS TO END OF THE RAFTERS TO PROVIDE CONT. TIE ACROSS THE STRUCTURE


JOISTS PERP. TO RAFTERS

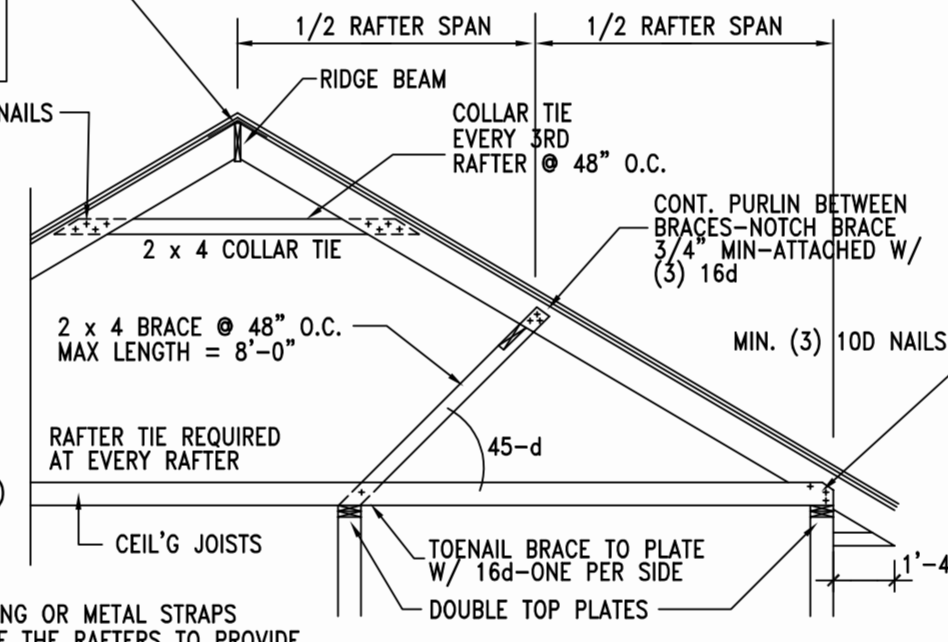


B TYP. ROOF/RAFTER FRAMING  
N.T.S.

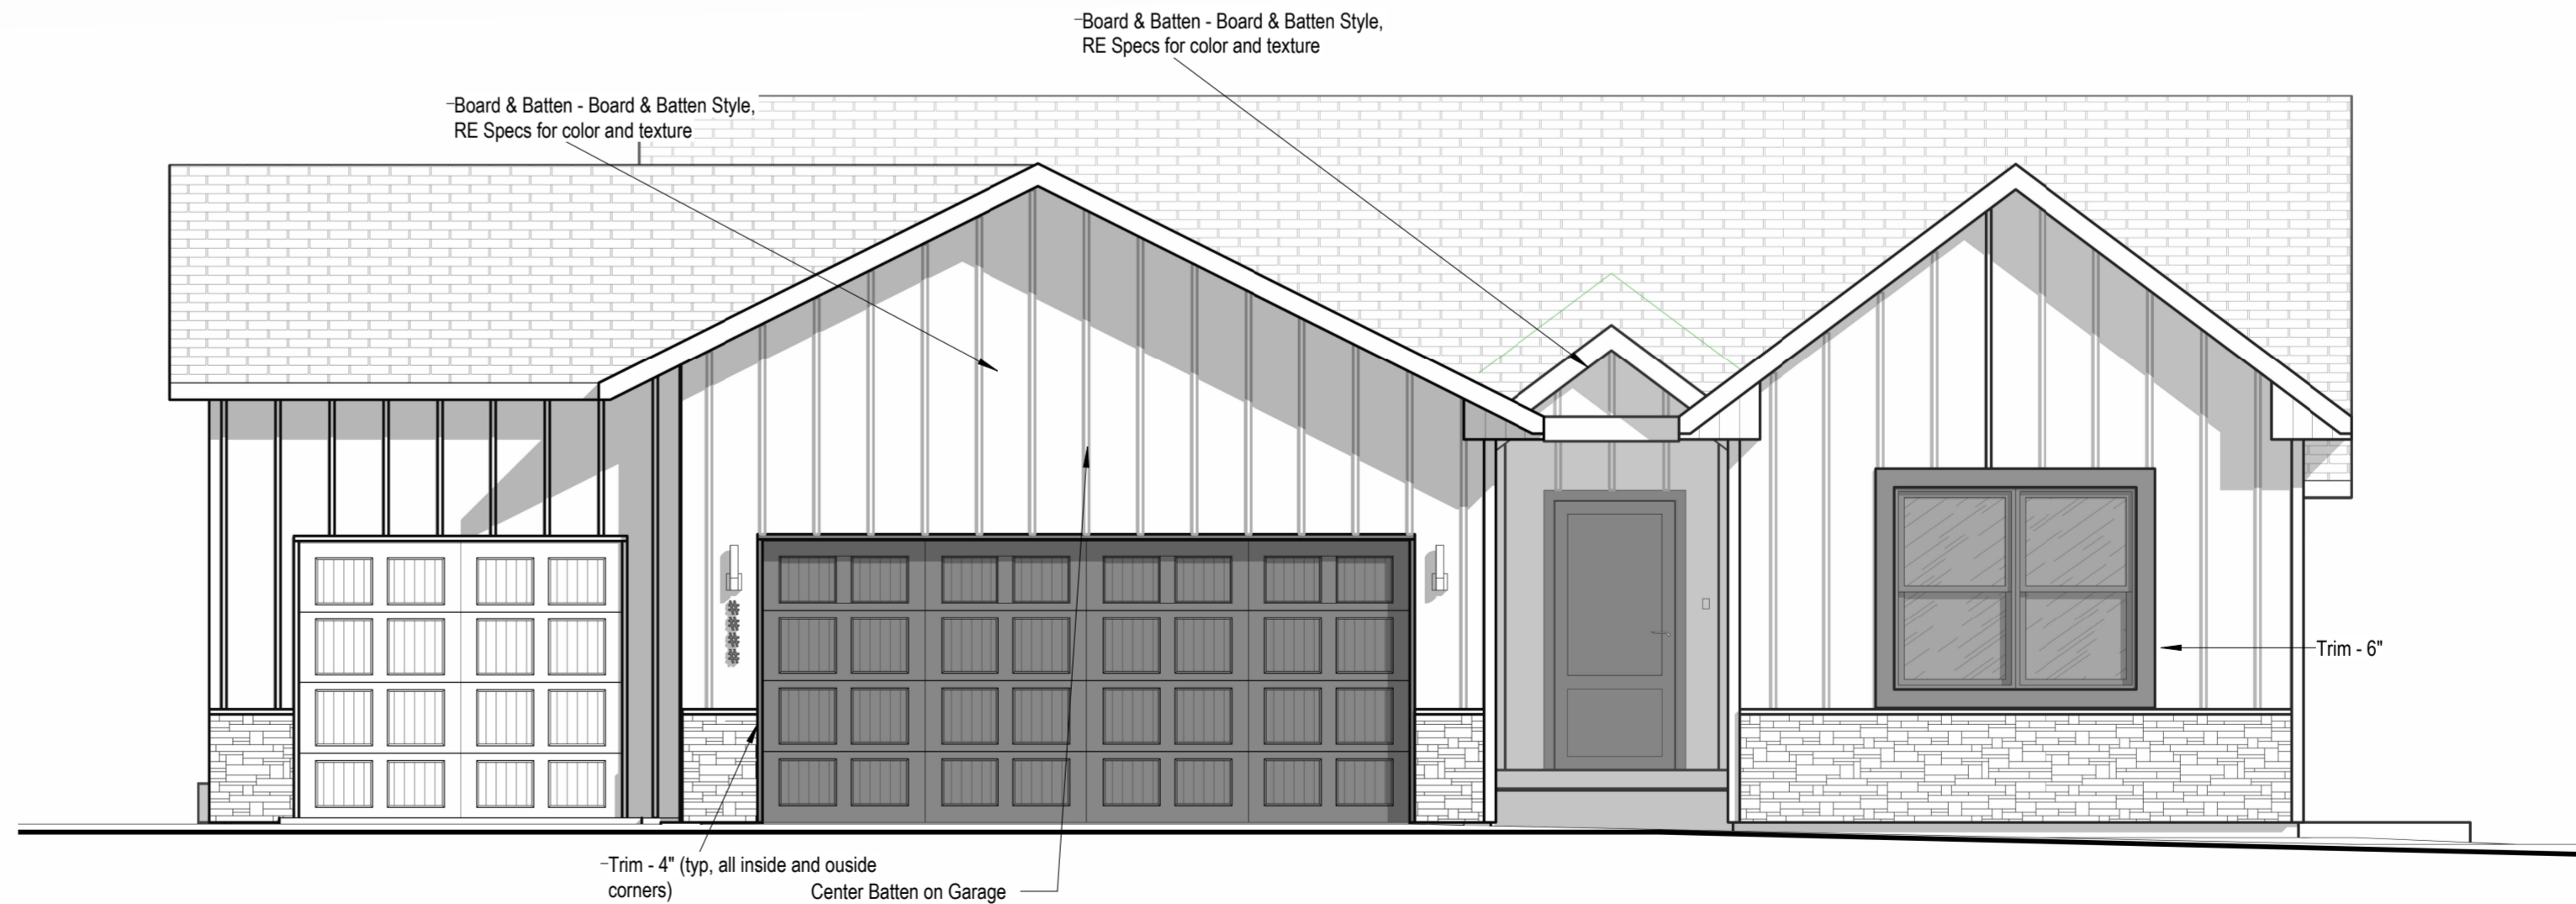

1 Front Elevation - Farmhouse  
1/4" = 1'-0"

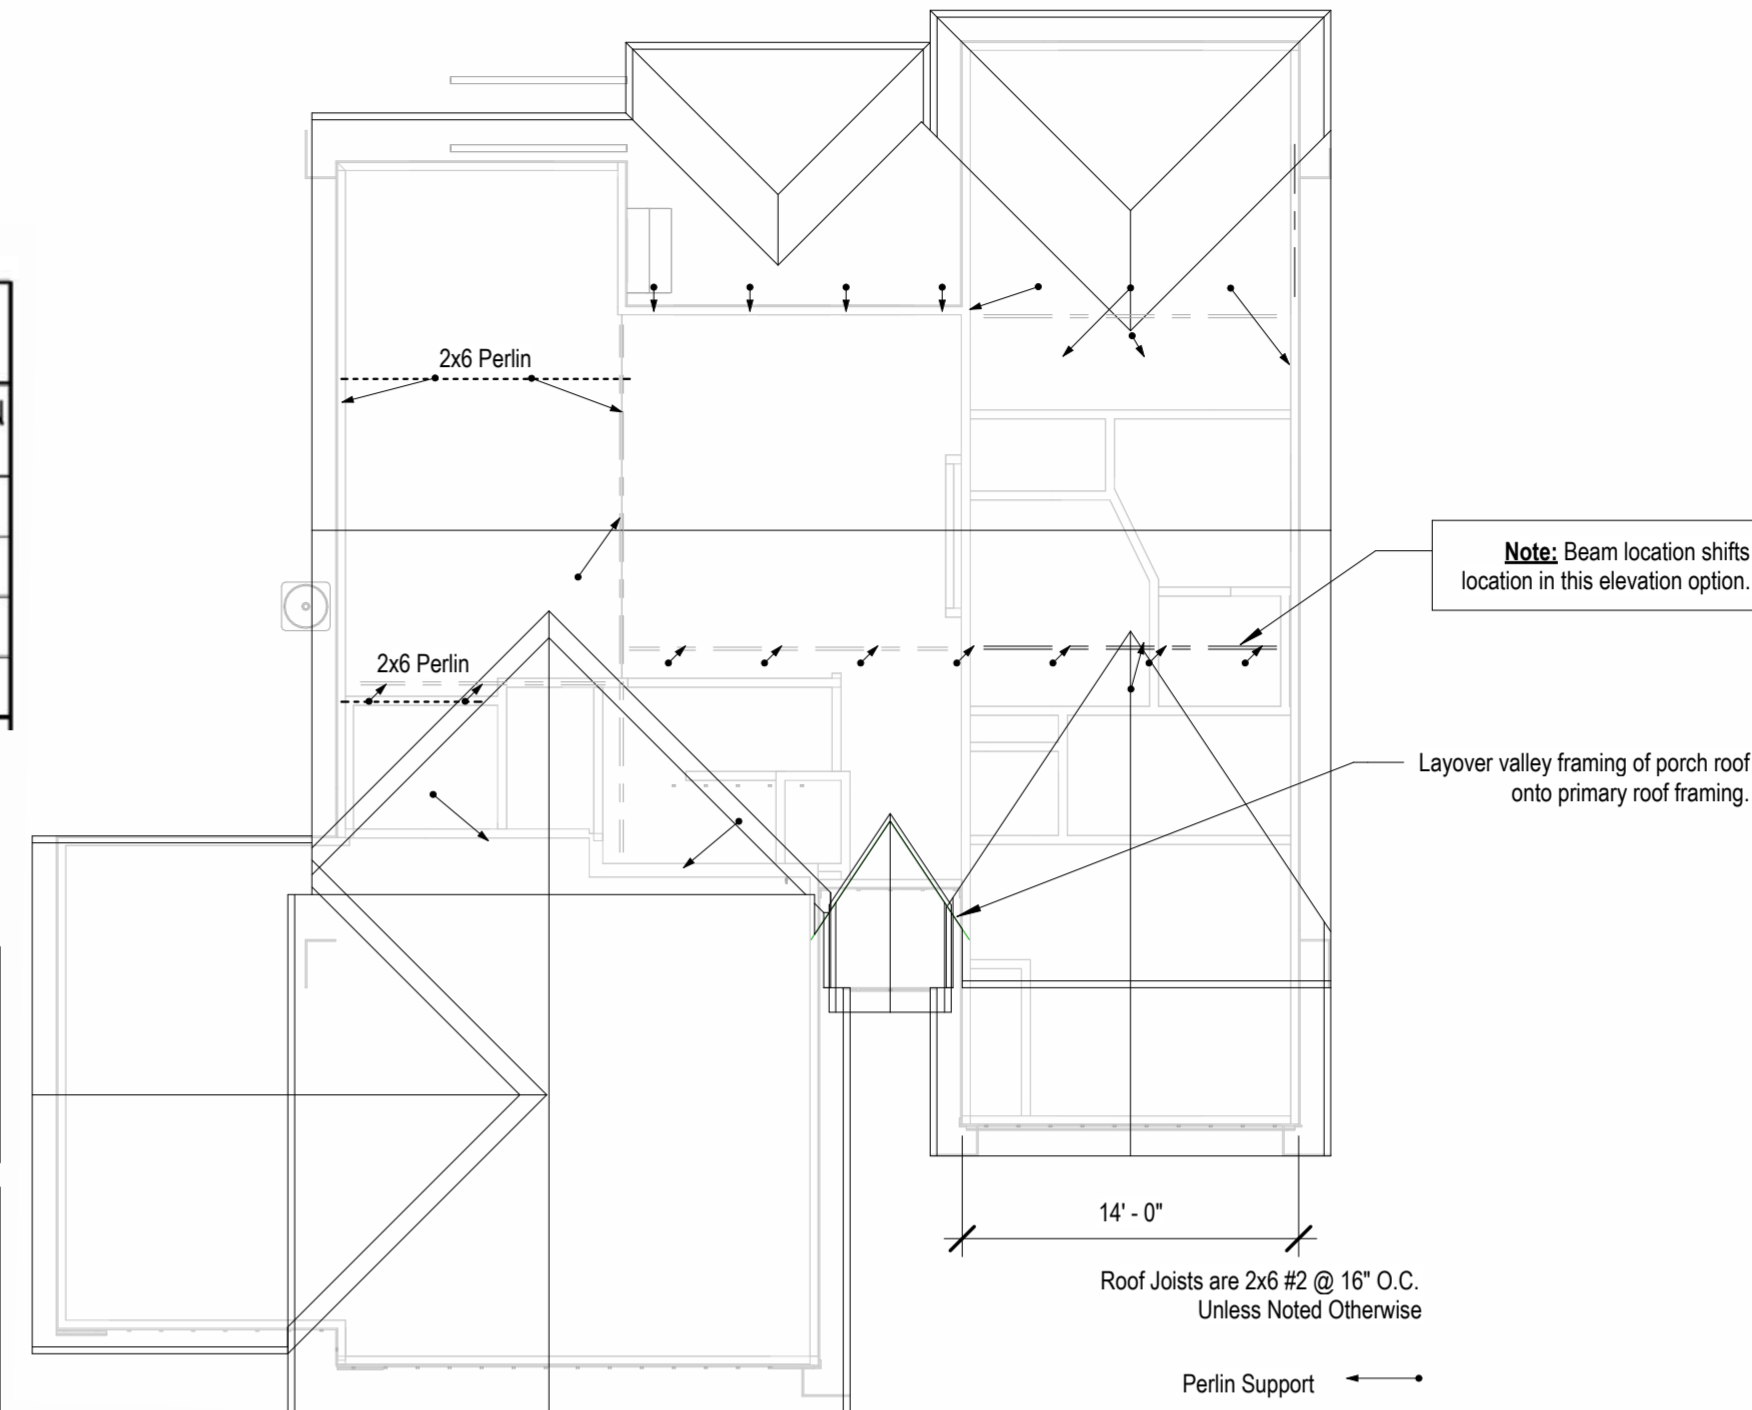

5 Roof Framing  
1/8" = 1'-0"

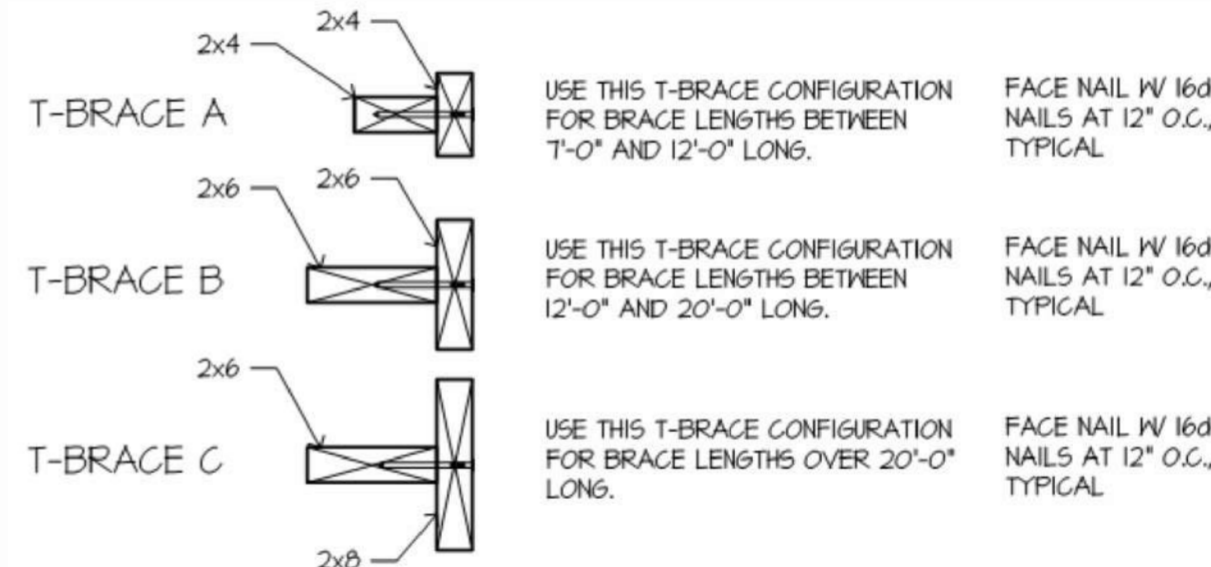


# Lot 176 - Hook Farms

2615 SW Barley Field Dr,  
Lees Summit MO 64082

architect:  
**Elevate Design + Build**  
350 SW Longview Blvd  
Lee's Summit, MO 64081  
816.622.8826 voice

2615 SW Barley Field Dr,  
Lees Summit MO 64082

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS  
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR  
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

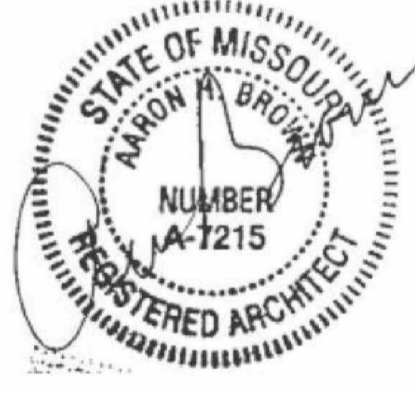

Original Issue Date: Permit Set  
2022/10/12



REVISIONS

Number	DESCRIPTION	DATE
--------	-------------	------

Building Sections

## A4.B

Project No. Project Number

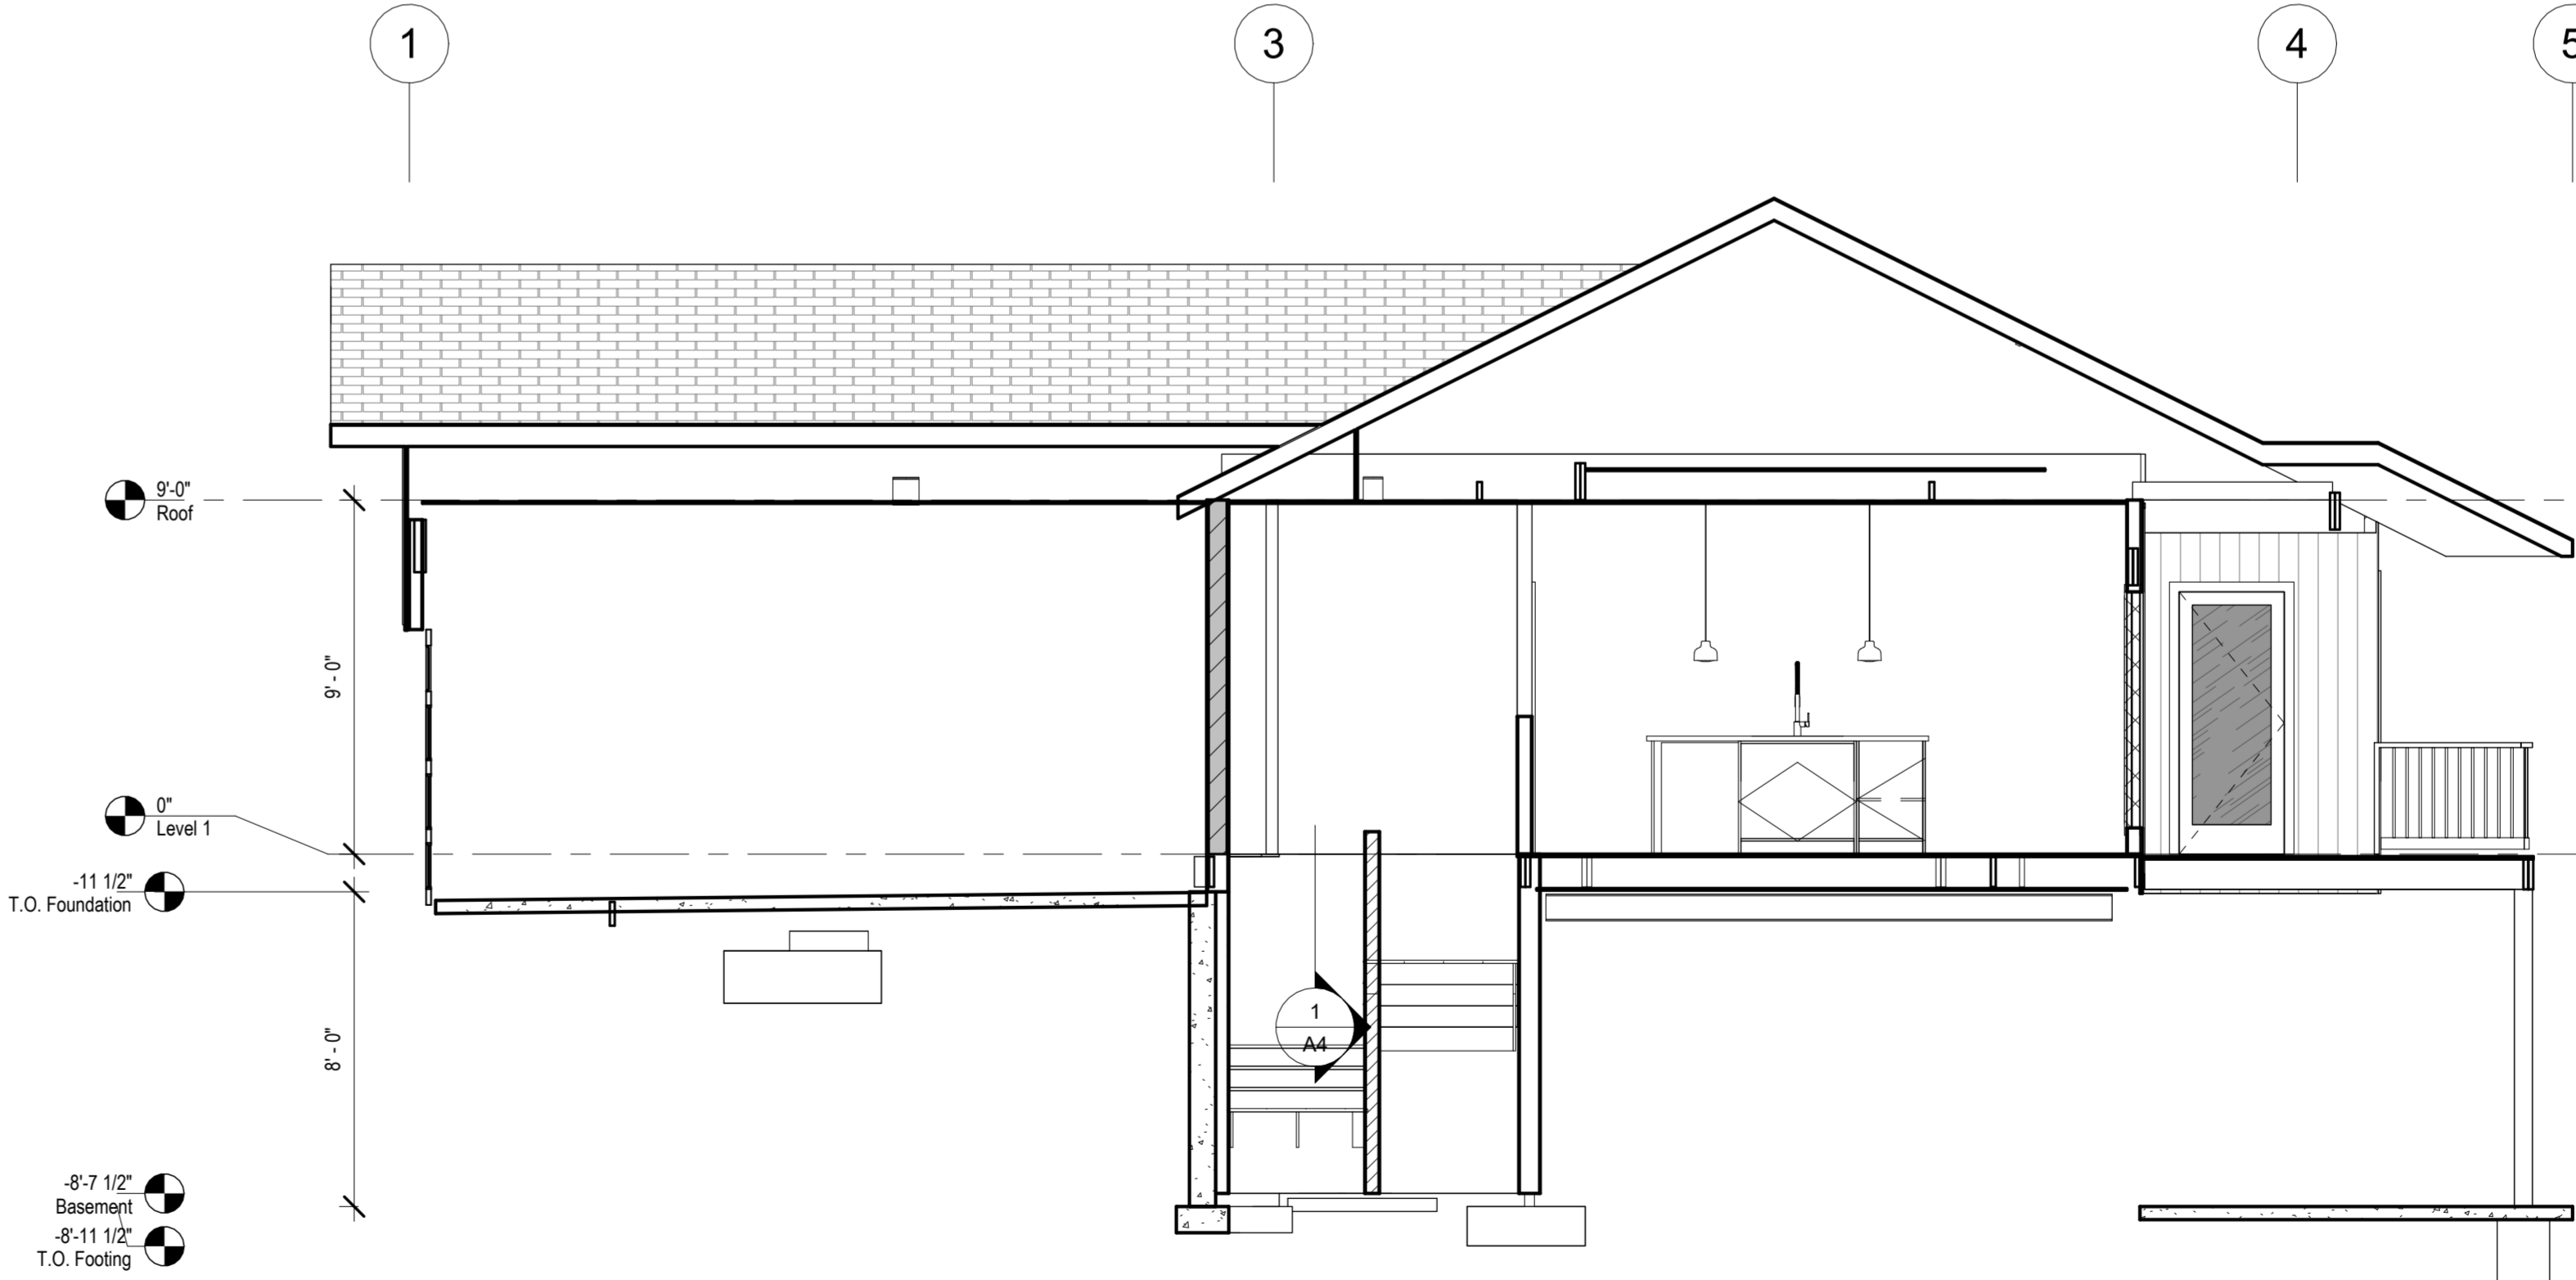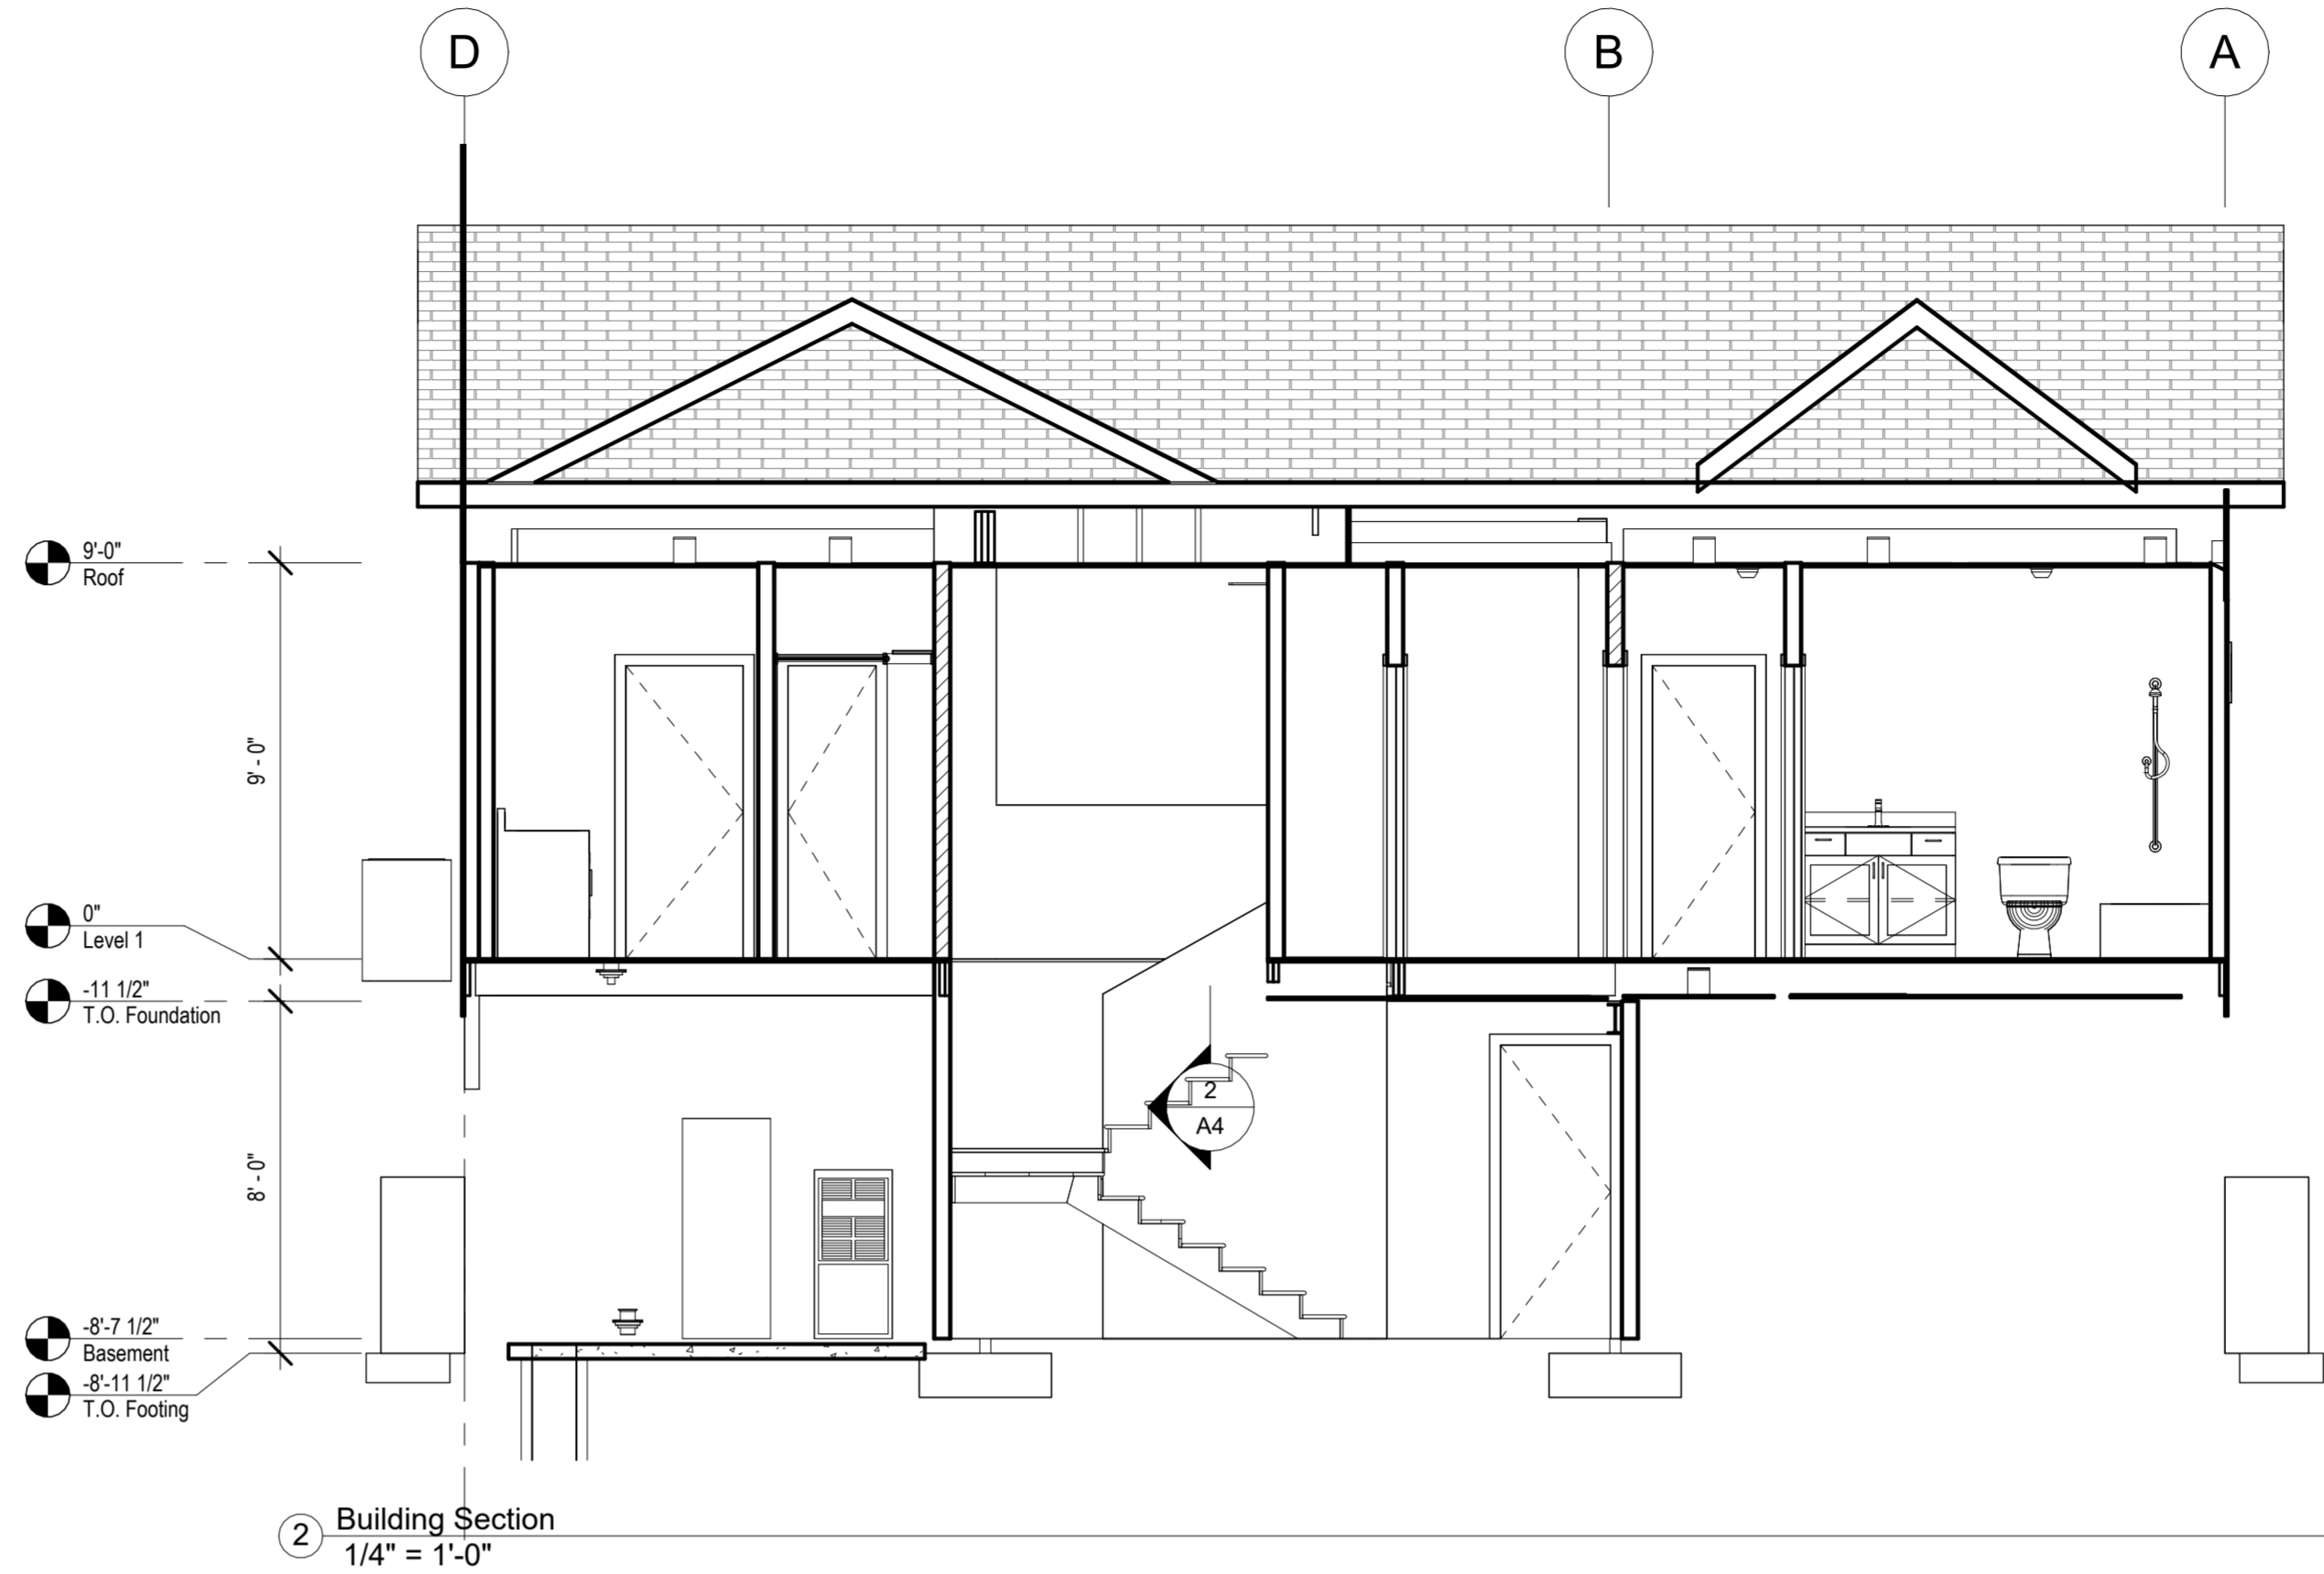

# Lot 176 - Hook Farms

2615 SW Barley Field Dr,  
Lees Summit MO 64082

architect:  
**Elevate Design + Build**  
350 SW Longview Blvd  
Lee's Summit, MO 64081  
816.622.8826 voice

2615 SW Barley Field Dr,  
Lees Summit MO 64082

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS  
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR  
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



Original Issue Date: 2022/10/12  
Permit Set


REVISIONS  
Number DESCRIPTION DATE

Details


Details

# A5


Project No. Project Number

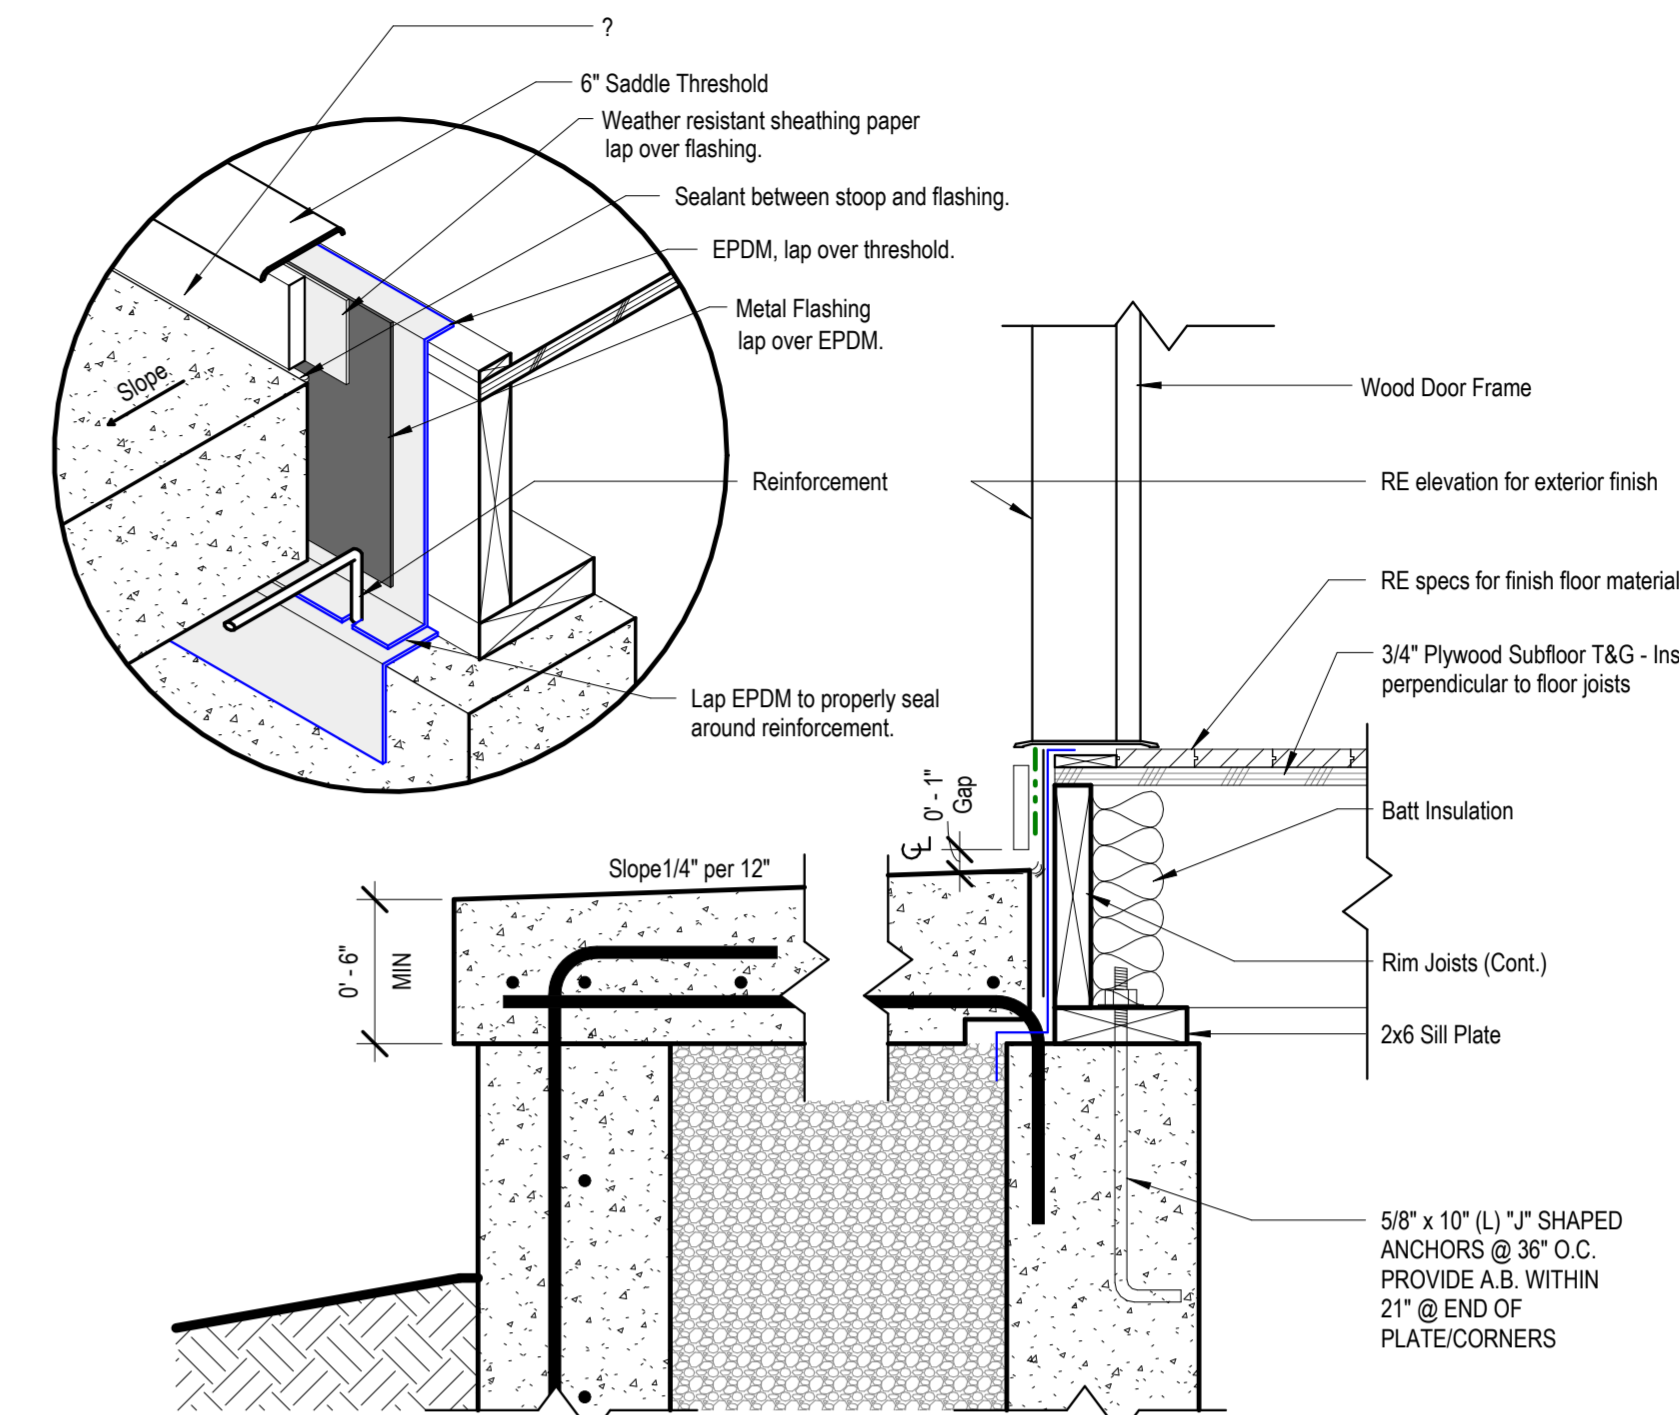


5 Detail - Front Stoop  
1 1/2" = 1'-0"

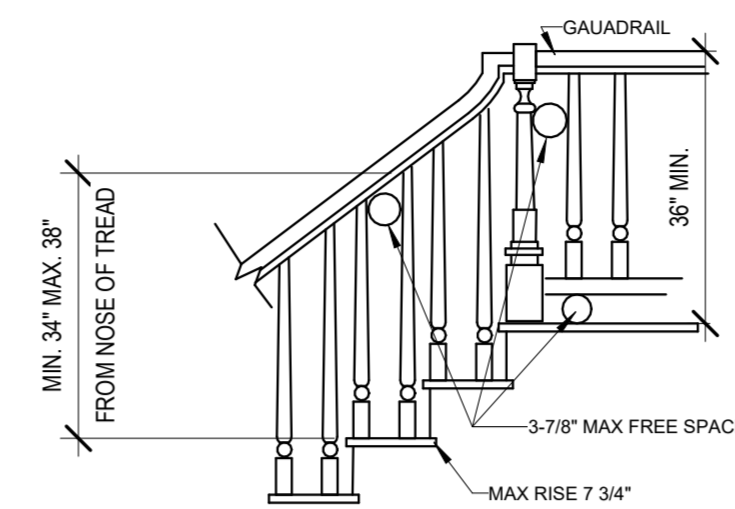


PER IRC: THE MAX. RISE ALLOWED IS 7.75 INCHES AND  
THE MIN TEAD IS 10 INCHES MEASURED NOSE TO NOSE

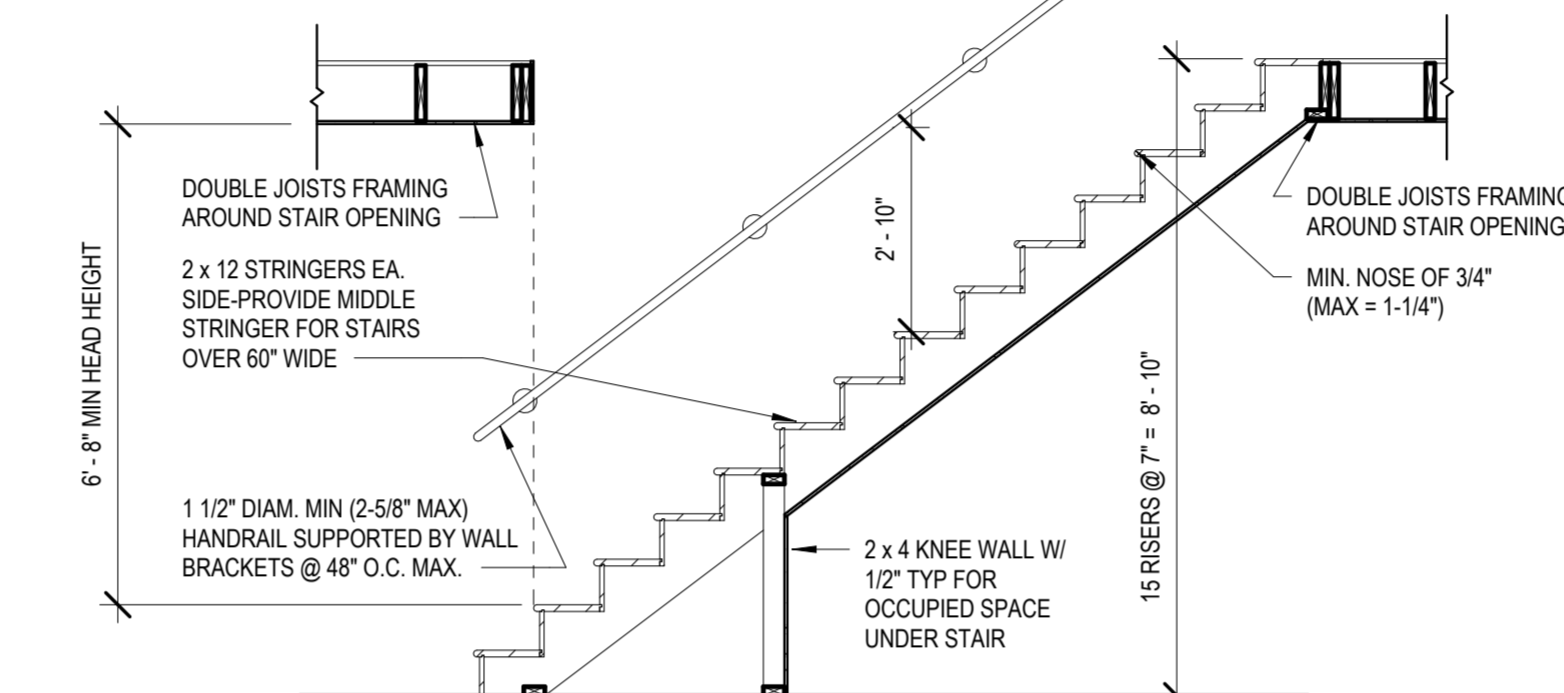


6 TYP STAIR SECTION/REQUIREMENTS1  
3/8" = 1'-0"

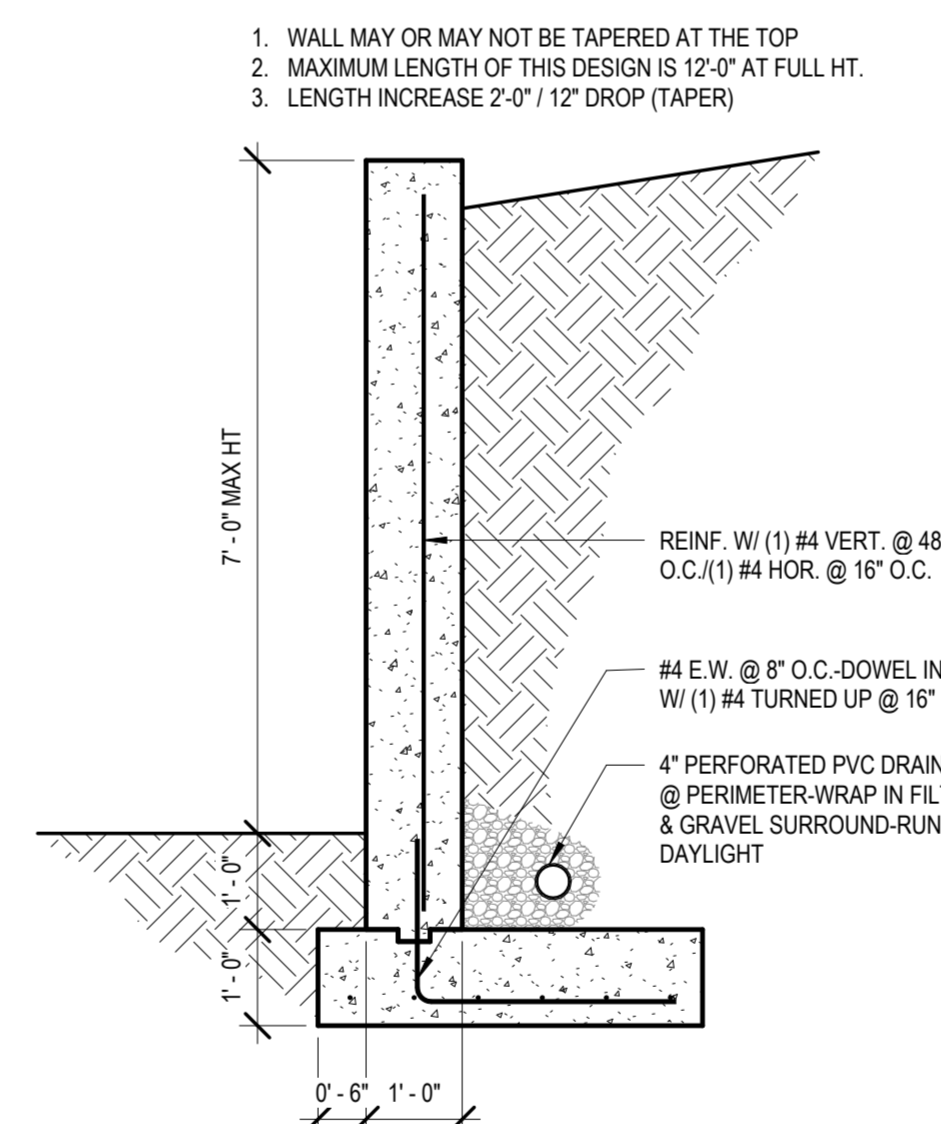


4 RETAINING WALL DESIGN1  
1/2" = 1'-0"

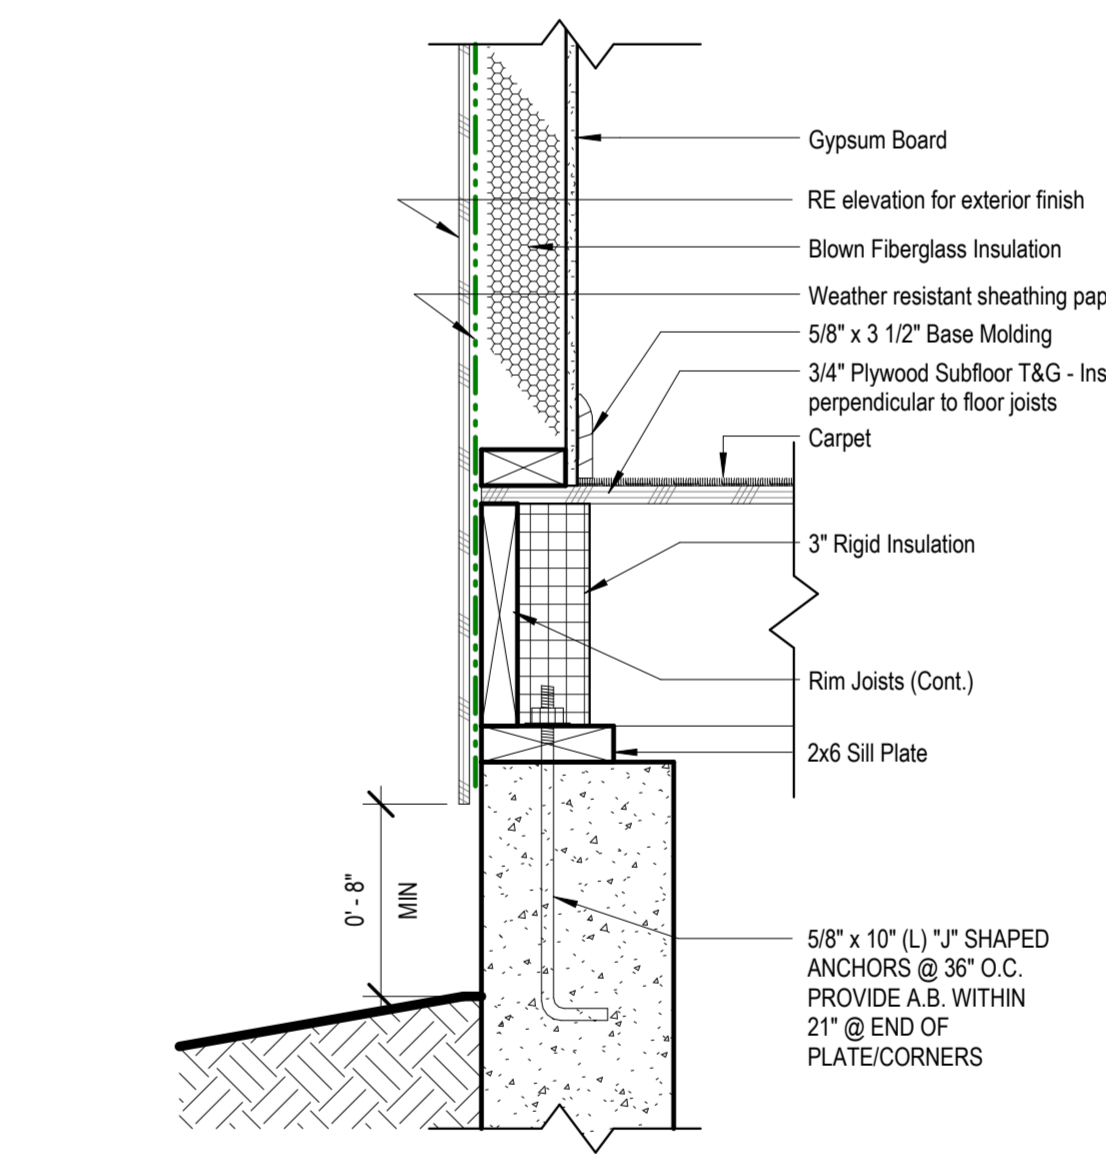


3 Detail - Top of Foundation Wall1  
1 1/2" = 1'-0"

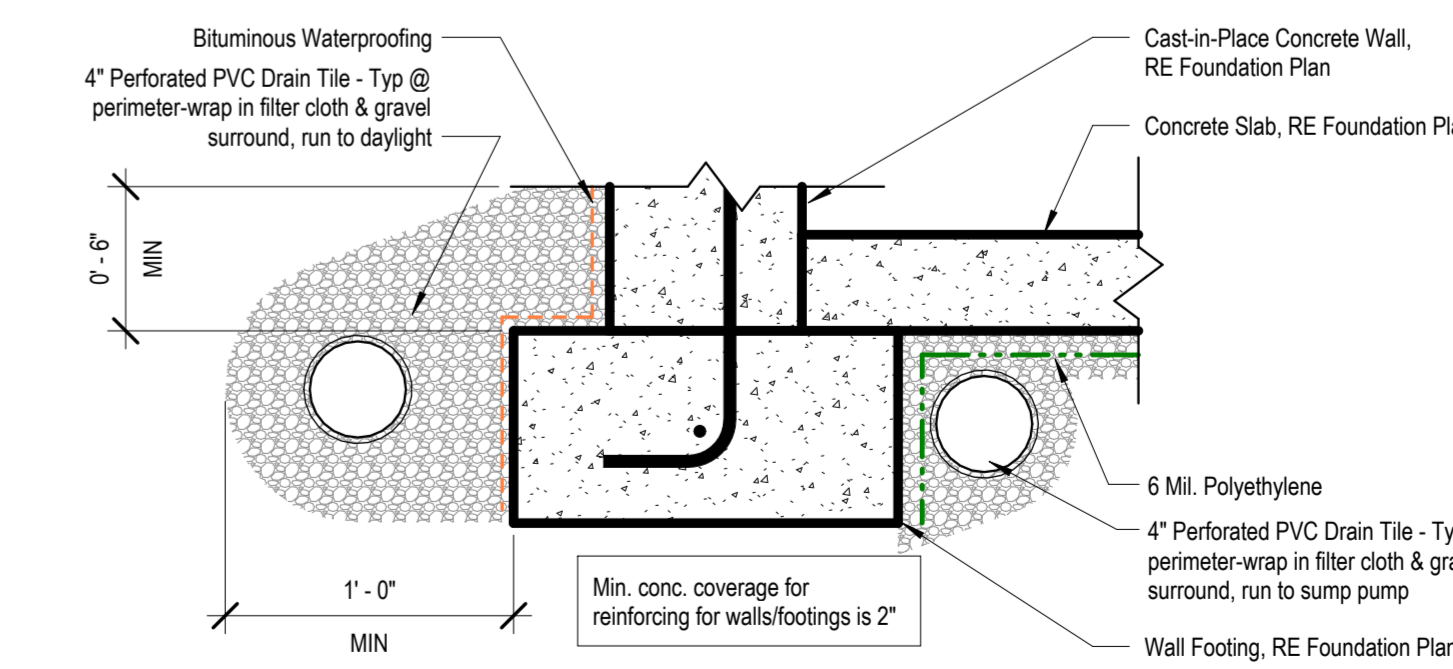


1 Detail - Footing  
1 1/2" = 1'-0"

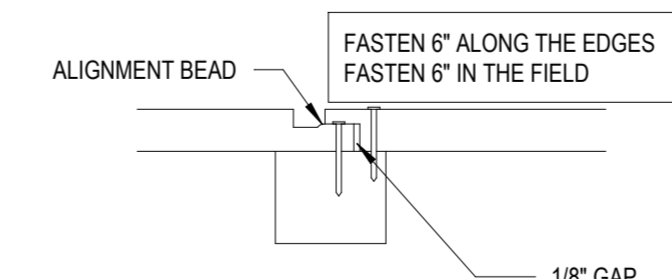

2 SMARTSIDE PANEL NAILING PATTERN1  
3" = 1'-0"

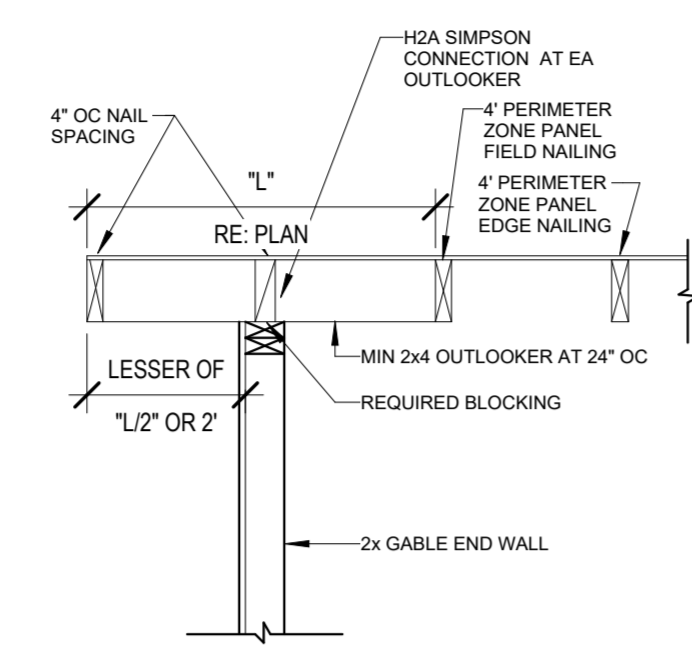


7 Gable Framing Requirements  
1" = 1'-0"

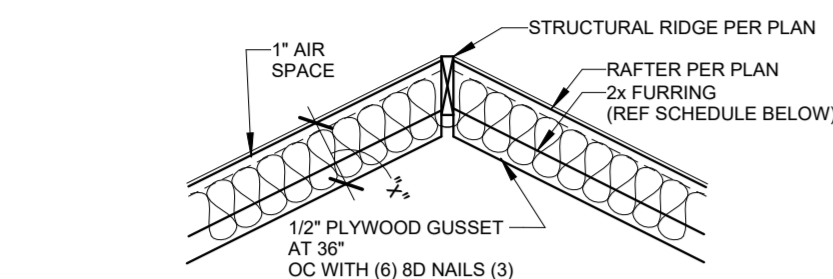


FURR OUT SCHEDULE		
RAFTER SIZE	R-30C INSULATION (*\" = 9 1/4\")	R-38C INSULATION (*\" = 11 1/4\")
2x6	2x8	2x8
2x8	2x8	2x8
2x10	NOT REQUIRED	2x4
2x12	NOT REQUIRED	NOT REQUIRED


12 Rafter Furr Down Requirements  
1" = 1'-0"

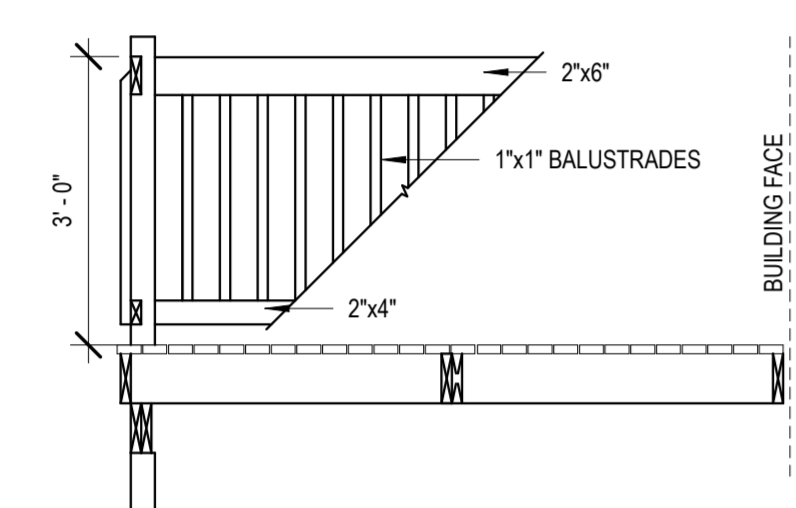


11 Deck Railing  
1/2" = 1'-0"

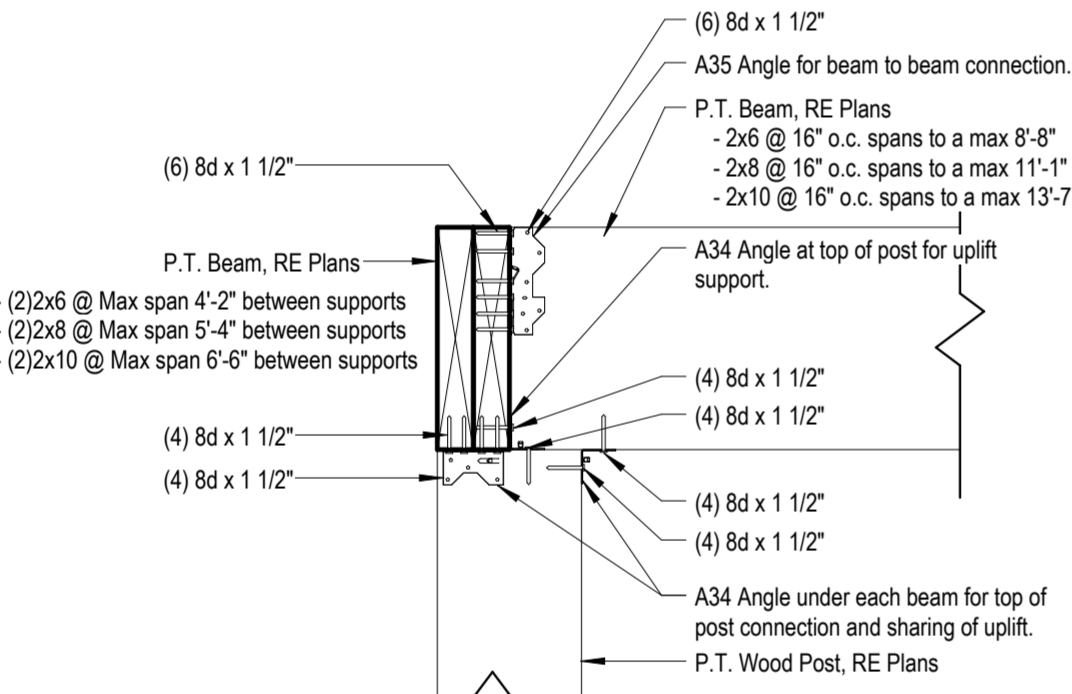

8 Post to Beam Connection  
1 1/2" = 1'-0"

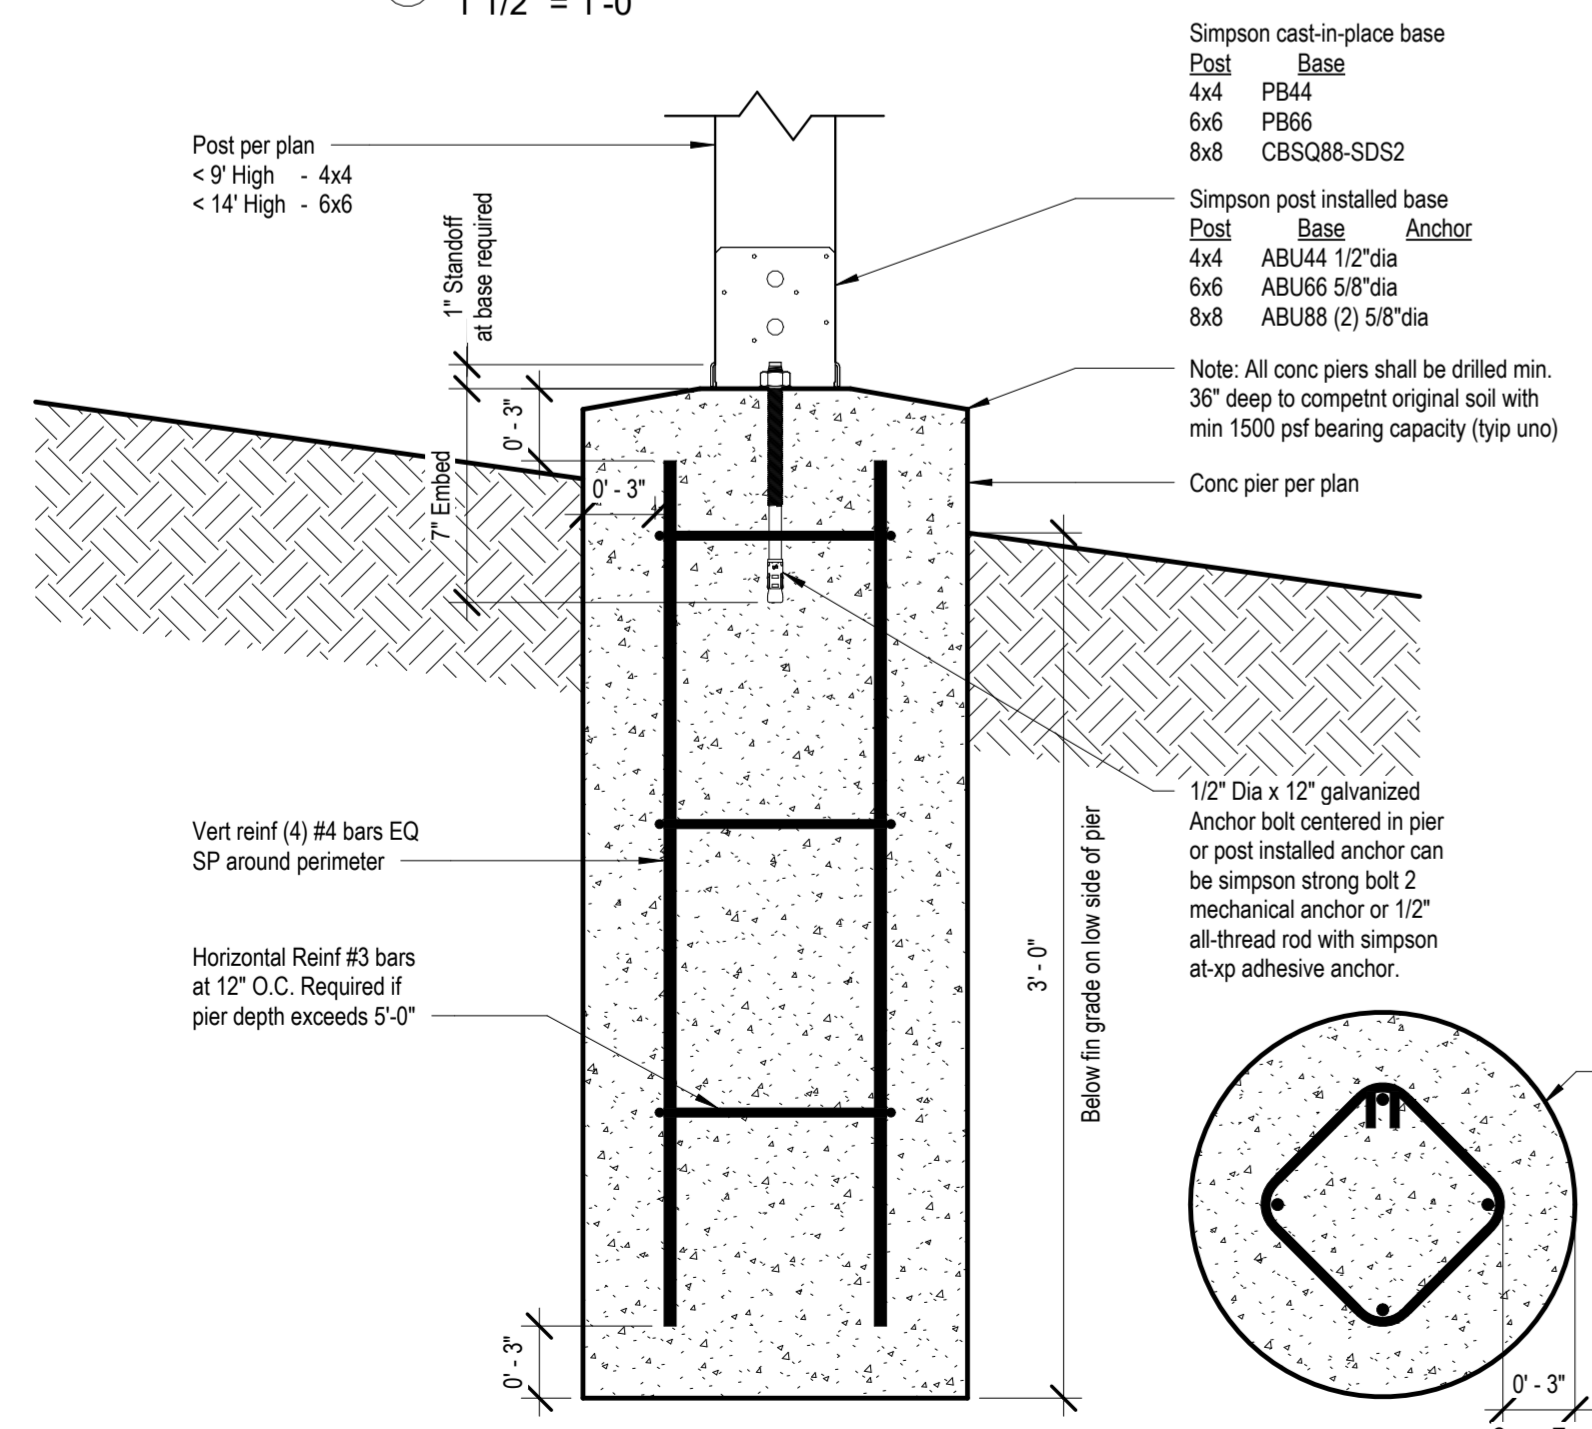

9 Typ Details for Post/Pier  
1 1/2" = 1'-0"

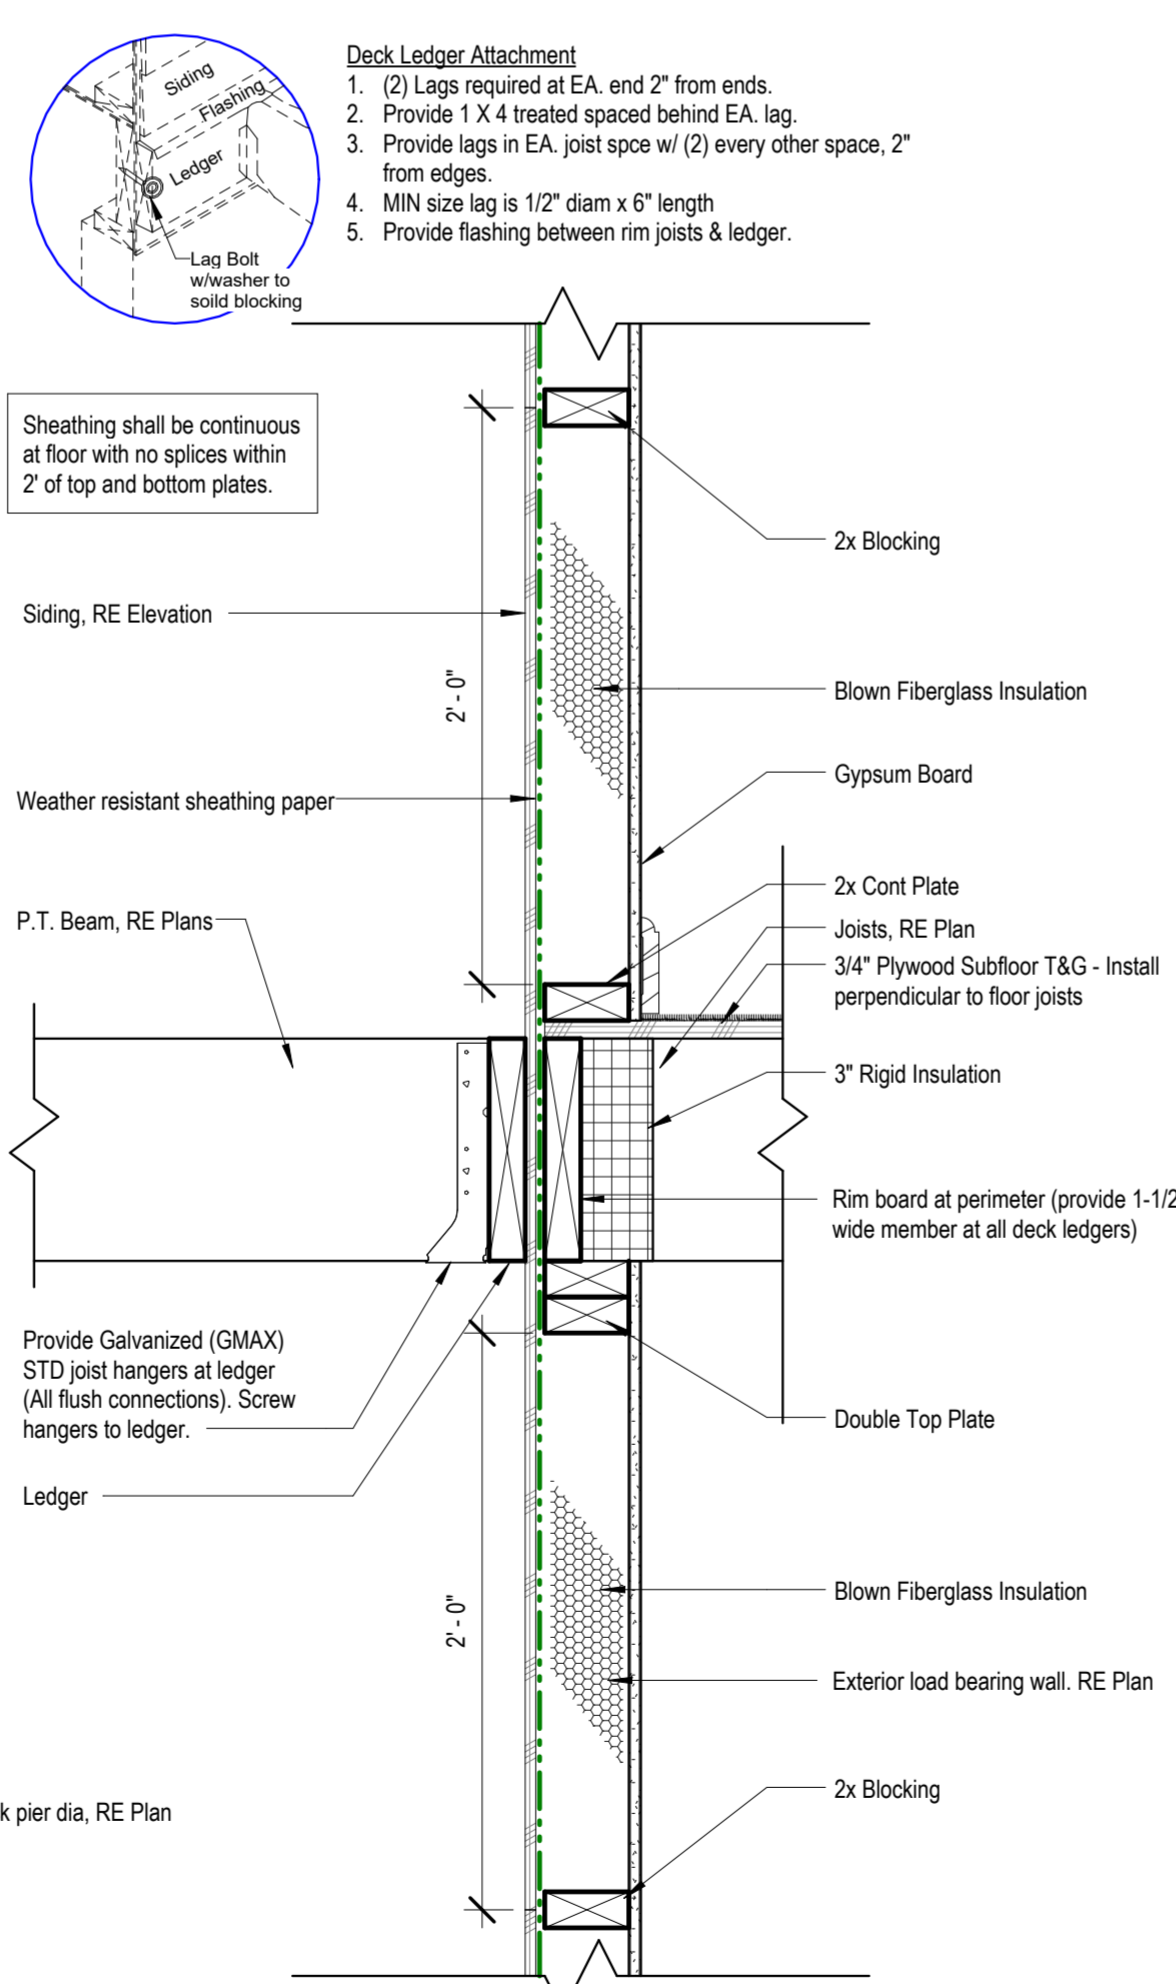

10 Lateral Deck Connection  
1 1/2" = 1'-0"

