



**Job Description: SW 3rd St Improvements from
Jefferson St to Blue Parkway - MRELO - LS**




**Maximo Work Order: 24232997
Project #: 805127**

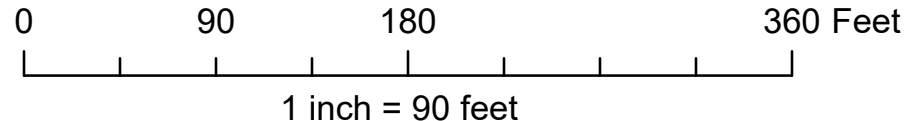

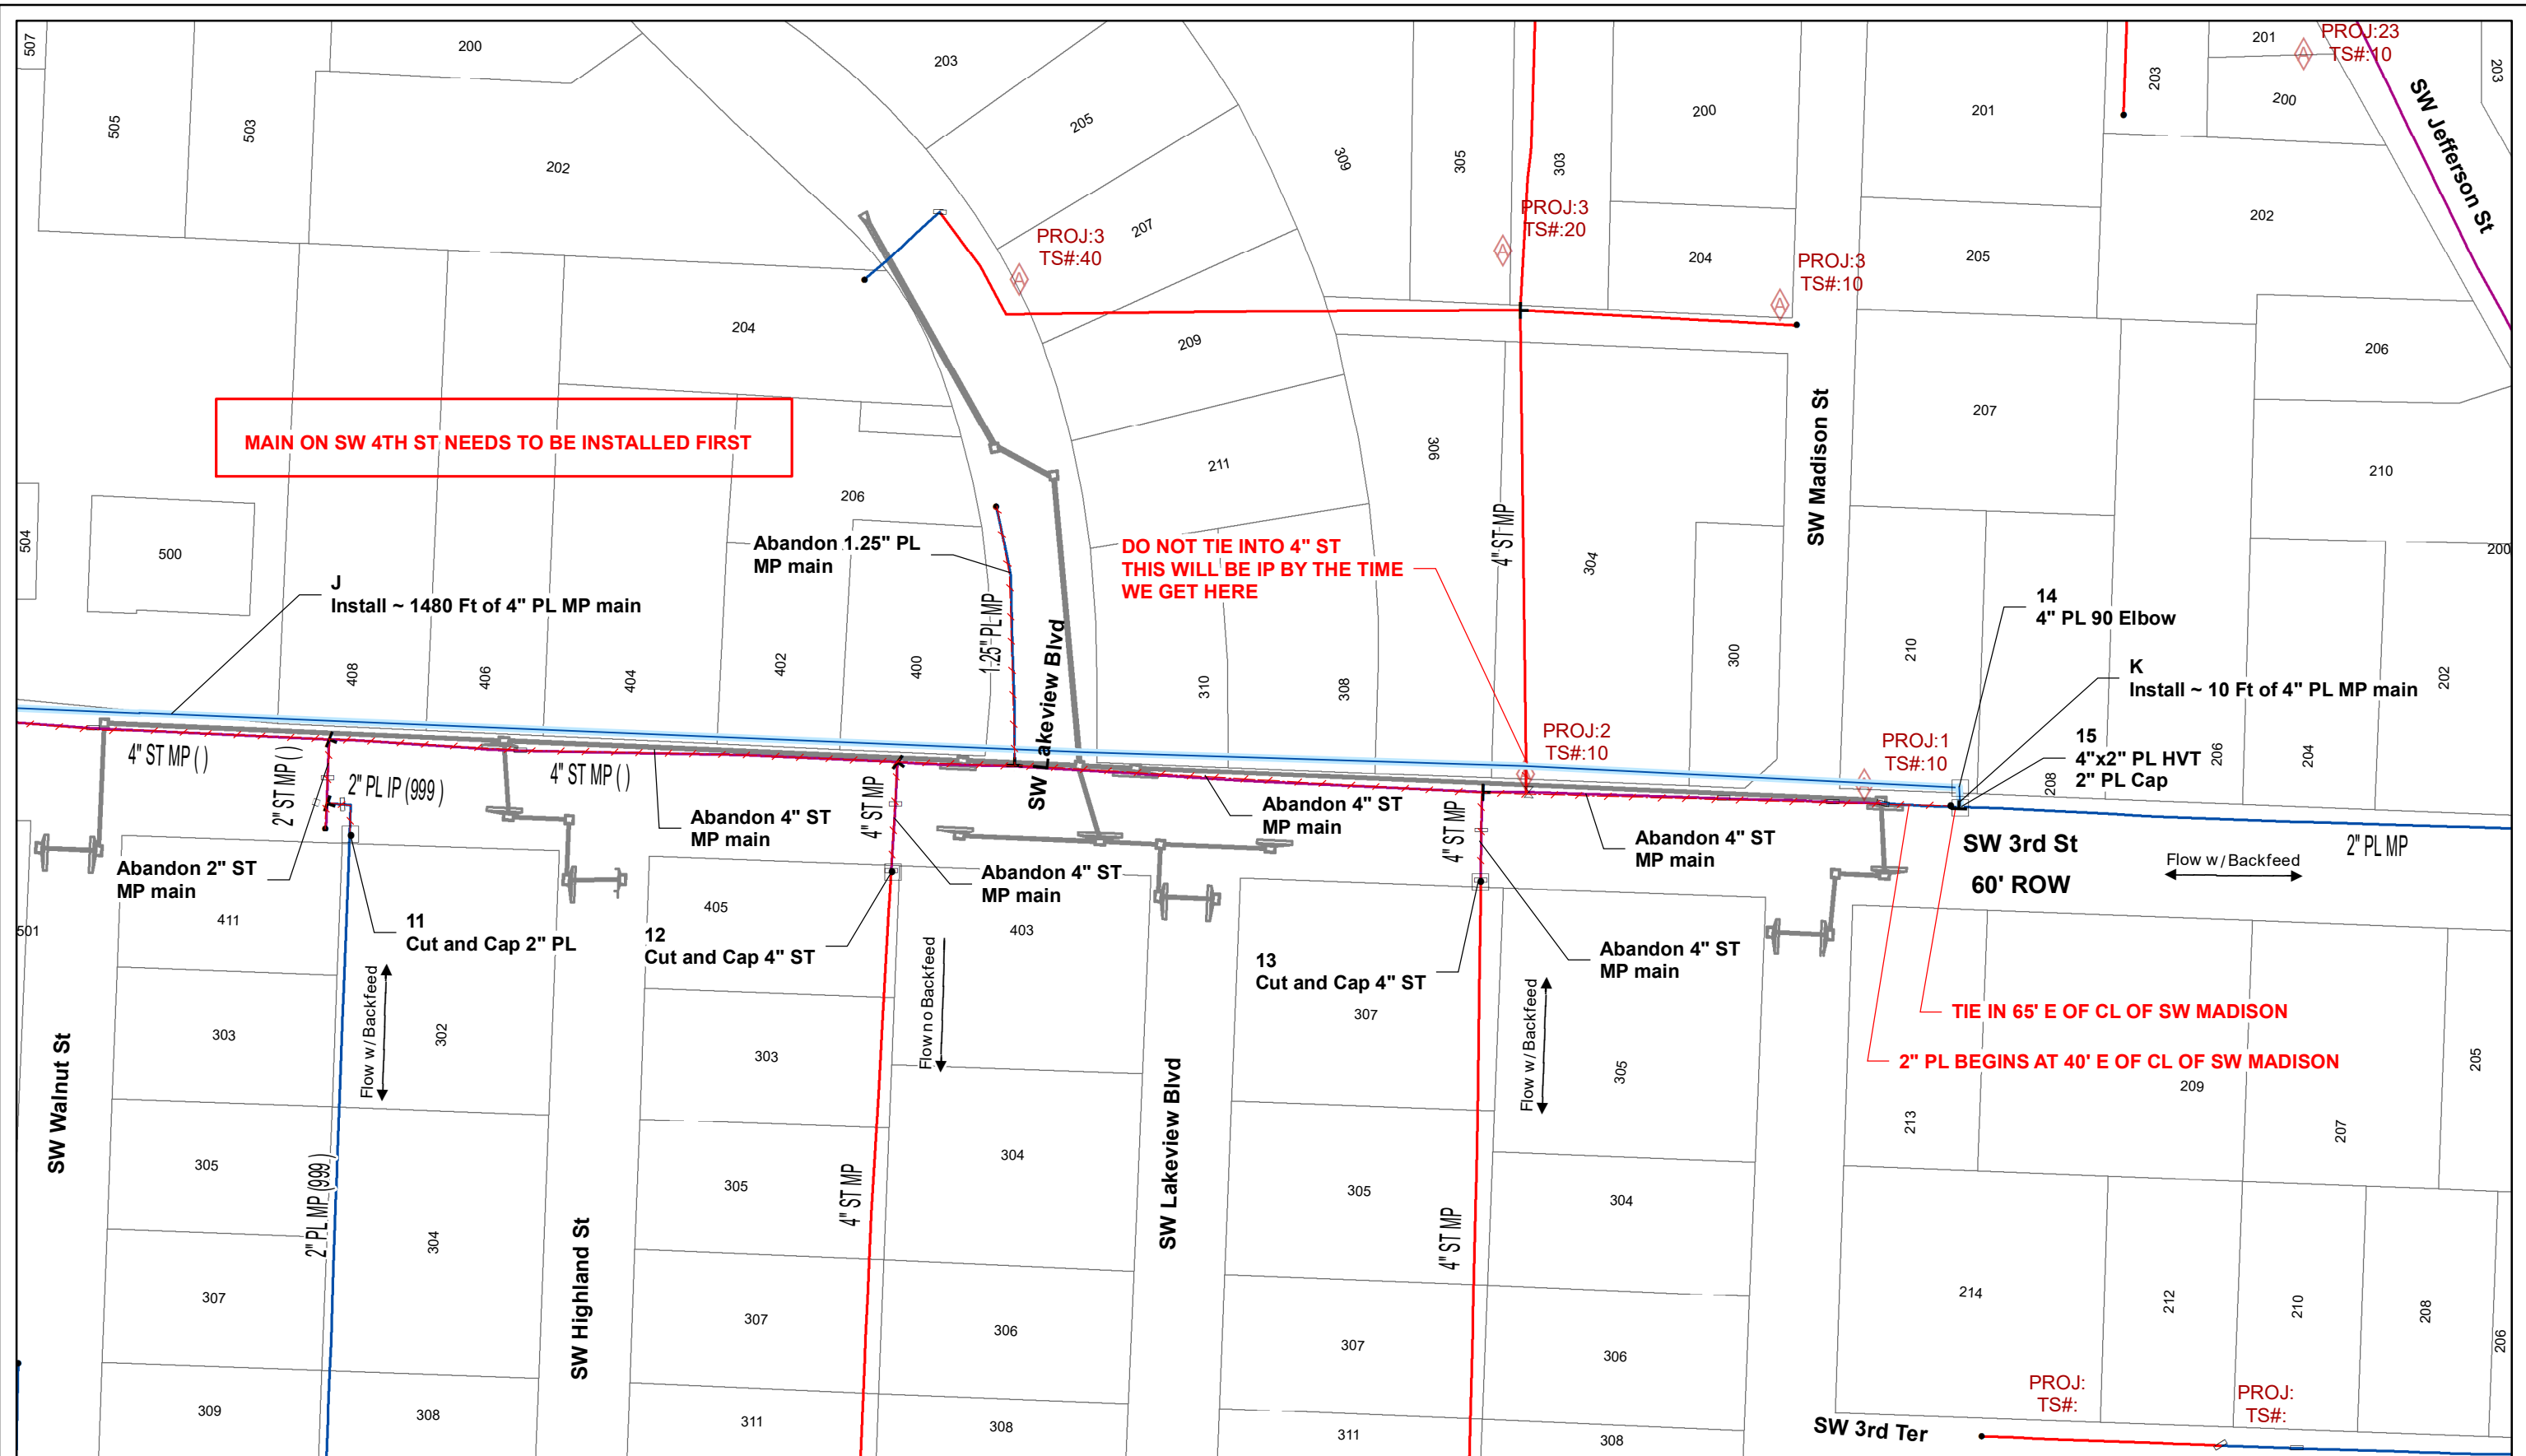

**Job Description: SW 3rd St Improvements from
Jefferson St to Blue Parkway - MRELO - LS**

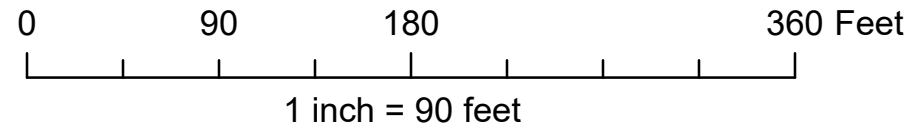

**Maximo Work Order: 24232997
Project #: 805127**



PAGE 3 OF 4



Job Description: SW 3rd St Improvements from Jefferson St to Blue Parkway - MRELO - LS

Maximo Work Order: 24232997

Region: South

TownCode: 0901

Sector: 0404

Project #: 805127



PRESSURE TEST OF GAS MAINS
(One Test Per Sheet)


Tie-in Number _____
Soap Test ☐ Yes ☐ No
Date: _____
Time: _____
System Gauge Pressure: _____
Signature: _____

Tie-in Number _____
Soap Test ☐ Yes ☐ No
Date: _____
Time: _____
System Gauge Pressure: _____
Signature: _____

Tie-in Number _____
Soap Test ☐ Yes ☐ No
Date: _____
Time: _____
System Gauge Pressure: _____
Signature: _____

Tie-in Number _____
Soap Test ☐ Yes ☐ No
Date: _____
Time: _____
System Gauge Pressure: _____
Signature: _____

Tie-in Number _____
Soap Test ☐ Yes ☐ No
Date: _____
Time: _____
System Gauge Pressure: _____
Signature: _____

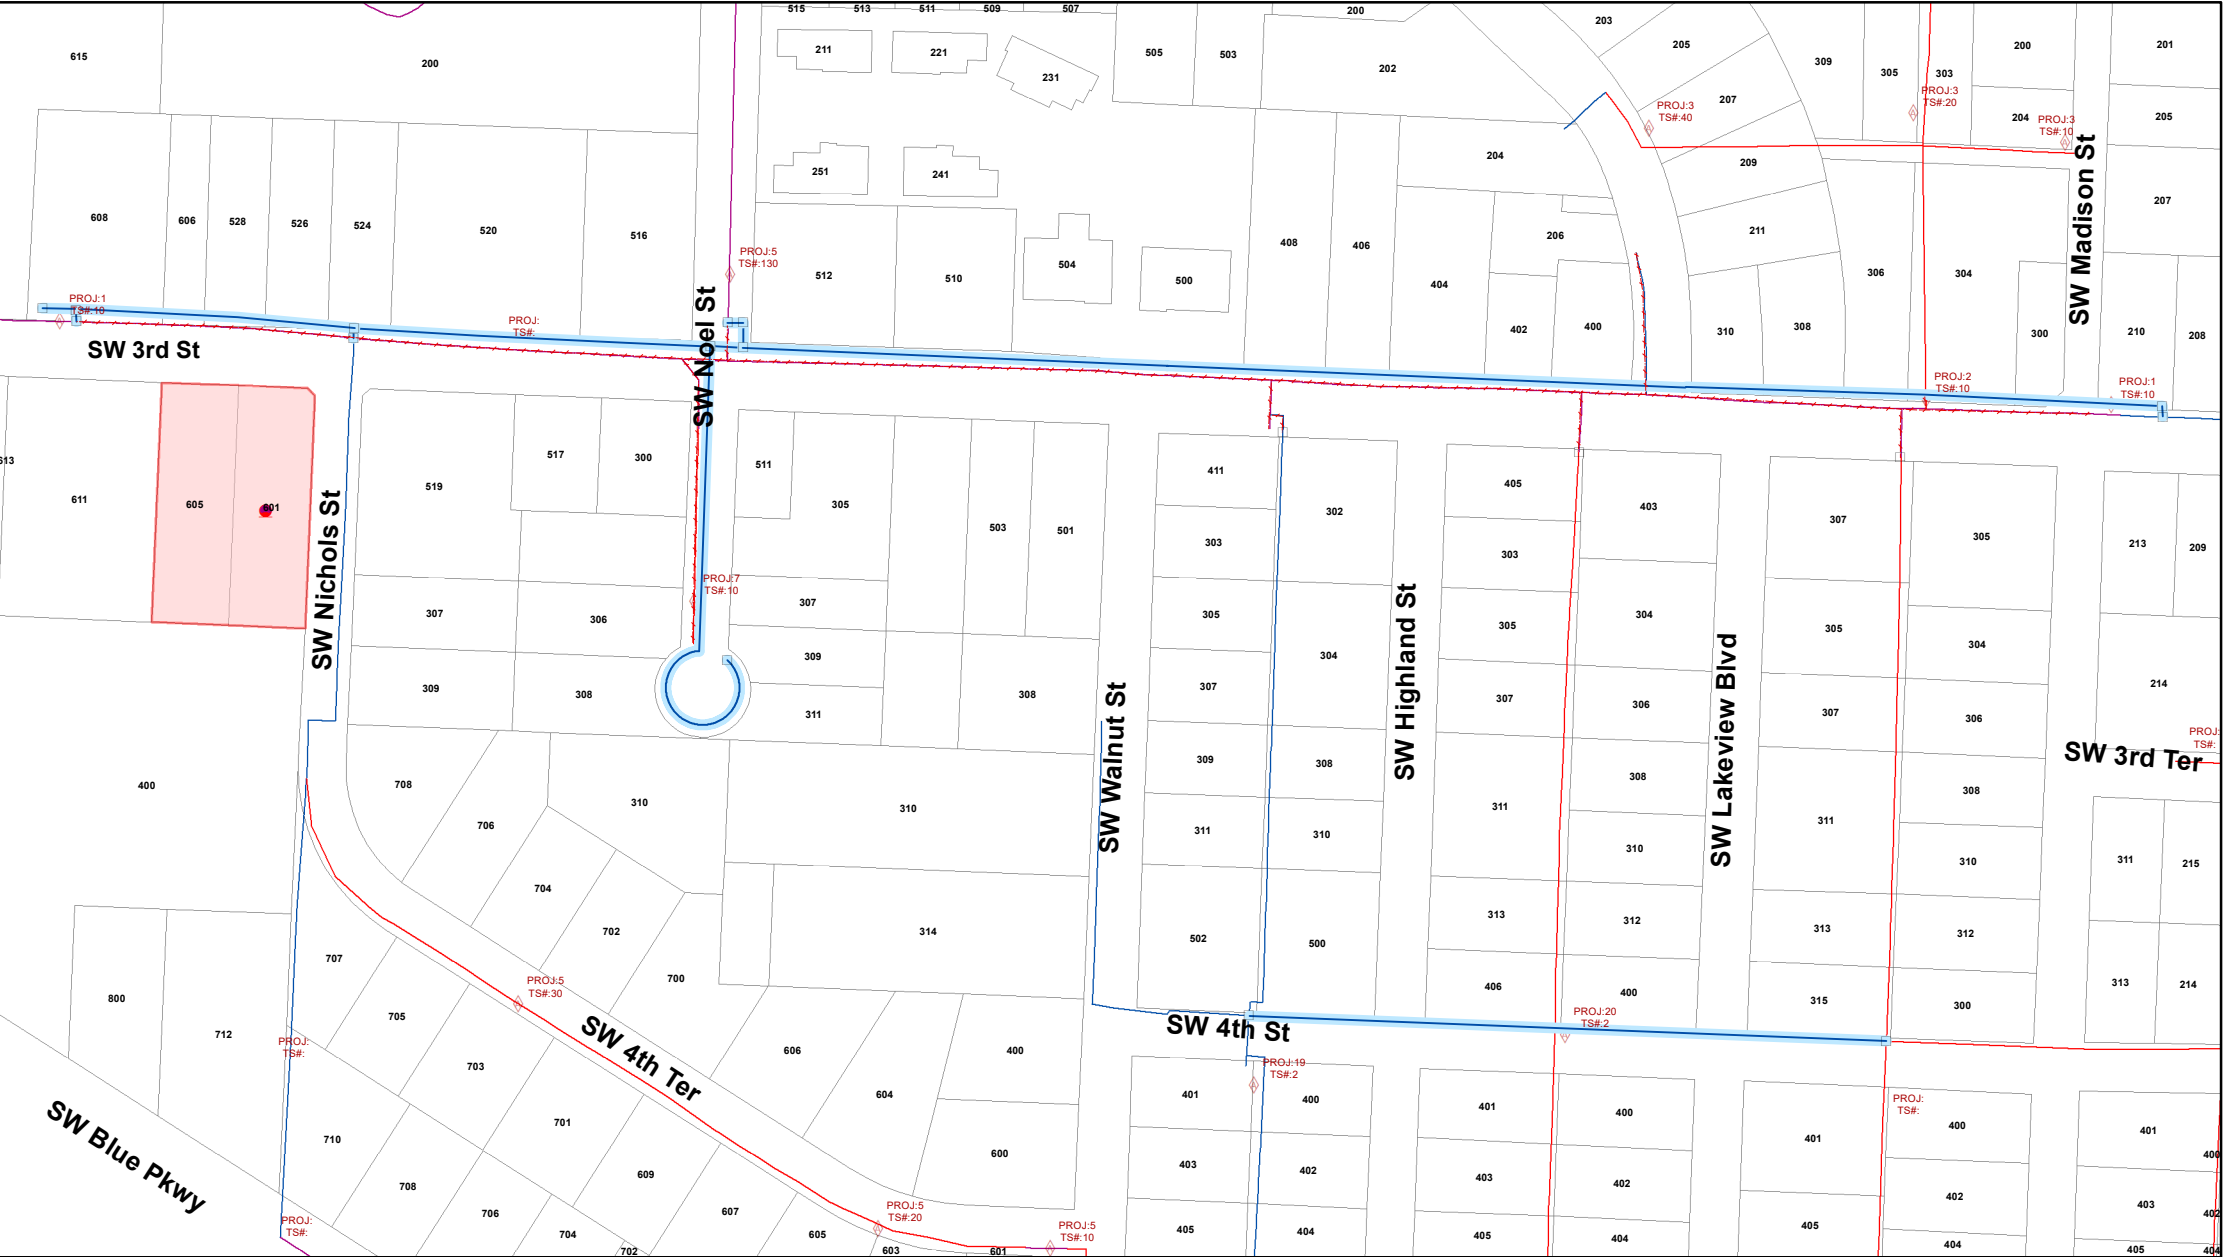

Pipe Size: _____ Length (ft): _____

Pipe Size: _____ Length (ft): _____

Pipe Size: _____ Length (ft): _____

Pressure System: TF \ SF \ FP \ HP \ IP \ MP \ LP

Test Medium: Water \ Air \ Gas Other: _____

Gauge Type: Recording Indicating Dead Weight

Gauge I.D. : _____

Calib. Date : _____

Test Date: _____

Start Time: _____ End Time: _____

Start Press.: _____ End Press. : _____

Start Temp.*: _____ End Temp.*: _____

* Water or Pipe temperature, not ambient

If Discharge volume is over 1,000 gallons - Contact Lab for sample collection.

Note all leaks or failures, including cause, and corrective action taken in comments below.

SEE STD#2410 FOR PRESSURE TESTING.
SEE STD #3265 FOR LEAK SURVEY.
FOR ANY QUESTIONS REGARDING THE
STANDARDS, PLEASE CONTACT PIPELINE SAFETY AND
COMPLIANCE AT 314-349-2932 OR 314-354-6533

Conducted By:

Signature: _____ Date: _____

Printed Name: _____

Page : _____ Of: _____

Comments: _____