

Architecture Interiors

**Planning** 

Topeka, Kansas Oklahoma City, Oklahoma

# ARCHITECT'S SUPPLEMENTAL INSTRUCTION NO. 4

**DATE:** November 07, 2023 **PROJECT NO: 230117** 

RE: Streets of West Pryor - Lot 5 Core & Shell

The Work shall be carried out in accordance with the following supplemental instructions issued in accordance with the Contract Documents without change in Contract Sum or Contract Time. If changes in Contract Sum or Contract Time are required, Contractor shall submit Change Order Request in a timely manner.

ASI No. 4 is part of the contract Bid and Construction Documents and shall govern in the performance of the Work.

## **DESCRIPTION:**

## **Clarification Items:**

G-1 Attached drawings associated with ASI-4 are marked with a Delta 5, Rev #5, or similar.

## **Architectural Items:**

- A-1 Sheet G-001 Drawing A3-Code Plan changed from 3 tenant building to 2 tenant building.
  - A-1.A Drawing A3-Code Plan updated egress load tags.
- A-2 Sheet A-101 Floor changed from 3 tenant building to 2 tenant building. Including removal of fire demising wall, restroom and mechanical room.
  - A-2.A Room tags updated to illustrate proper Suite nomenclature and square footage.
- A-3 Sheet A-201 Drawing C1-East Elevation update illustrating change to Stone wainscot and EIFS 1 at previous brake metal pilaster.
  - A-3.A Drawing C1-East Elevation changed from 3 tenant building to 2 tenant building and tenant signage updated on elevation.
- A-4 Sheet A-401 Removed from scope.

## **END OF ASI-4**



Architecture Interiors

**Planning** 

Topeka, Kansas Oklahoma City, Oklahoma

# ARCHITECT'S SUPPLEMENTAL INSTRUCTION NO. 3

DATE: June 20, 2023 PROJECT NO: 230117

RE: Streets of West Pryor - Lot 5 Core & Shell

The Work shall be carried out in accordance with the following supplemental instructions issued in accordance with the Contract Documents without change in Contract Sum or Contract Time. If changes in Contract Sum or Contract Time are required, Contractor shall submit Change Order Request in a timely manner.

ASI No. 3 is part of the contract Bid and Construction Documents and shall govern in the performance of the Work.

## **DESCRIPTION:**

## **Clarification Items:**

G-1 Attached drawings associated with ASI-3 are marked with a Delta 4, Rev #4, or similar.

## **Architectural Items:**

A-1 Sheet A-101 – Updated location of future pass-through openings on Suite C's South demising wall.

## Structural Items:

S-1 Sheet S-102 - Updated location of future pass-through openings on Suite C's South demising wall.

## **END OF ASI-3**



Architecture Interiors

**Planning** 

Topeka, Kansas Oklahoma City, Oklahoma

# ARCHITECT'S SUPPLEMENTAL INSTRUCTION NO. 2

DATE: July 07, 2023 PROJECT NO: 230117

RE: Streets of West Pryor - Lot 5 Core & Shell

The Work shall be carried out in accordance with the following supplemental instructions issued in accordance with the Contract Documents without change in Contract Sum or Contract Time. If changes in Contract Sum or Contract Time are required, Contractor shall submit Change Order Request in a timely manner.

ASI No. 2 is part of the contract Bid and Construction Documents and shall govern in the performance of the Work.

## **DESCRIPTION:**

## **Clarification Items:**

G-1 Attached drawings associated with ASI-2 are marked with a Delta 3, Rev #3, or similar.

## **Architectural Items:**

- A-1 Sheet A-101 Future pass-through openings added on East and West ends of Suite C's South Demising wall.
  - A-1.A Key plan note #2 for Future pass-through added to Keyed Plan Notes legend.
- A-2 Sheet A-102 RTUs rotated 90 degrees for structural support purposes.
- A-3 Sheet A-201 Door C101 update to be 7' and Tempered Glass.
  - A-3.A Reference to MEP exterior utilities indicated on West Elevation Drawing A1.
- A-4 Sheet A-601 Door schedule updated to represent C101 door as 7' and Tempered Glass.

## Structural Items:

- S-1 Sheet S-001 Updates to general notes Risk Category and Wind Load information.
- S-2 Sheet S-101 Foundation updates to columns B.1-3 & B.9-3 and dimensional spacing on East.
  - S-2.A Addition of West pilaster foundation.
- S-3 Sheet S-102 Future pass-through openings added to shearwall
  - S-3.A Wood shearwall schedule updated.
  - S-3.B Addition of West wall pilaster.
- S-4 Sheet S-103 RTUs rotated 90 degrees for structural support.
  - S-4.A Future pass through openings located in shearwall.
  - S-4.B Addition of West wall pilaster.
- S-5 Sheet S-201 Updated shearwall pass-through openings and west wall pislater added to isometric.
- S-6 Sheet S-301 Bolt type and dimensional location update to Baseplate Details drawings BP-2.

## **MEP Items:**

- MEP-1 Sheet ME-201 Updates to Light Fixture Schedule to show "C" fixtures on exterior. MEP-1.A Movement of Light Poles.
- MEP-2 Sheet ME-202 Updated placement of exterior utilities
- MEP-3 Sheet M-101 Swapping the respective placement of RTU 3 and RTU 4 for each other. MEP-3.A Rotation of RTU units
- MEP-4 Sheet M-201 Rotation of RTU units
- MEP-5 Sheet E-101 Swapping the respective placement of RTU 3 and RTU 4 for each other.

  MEP-5.A Updated information on respective Panelboard Schedule for RTU 3 and RTU 4.

  MEP-5.B Rotation of RTU units
- MEP-5.C Exterior Utilities shifted south past West wall Pilaster
- MEP-6 Sheet E-201 Mounted exterior lighting updated to "C" fixtures' on floor plan.

## **END OF ASI-2**



Architecture Interiors

**Planning** 

Topeka, Kansas Oklahoma City, Oklahoma

# ARCHITECT'S SUPPLEMENTAL INSTRUCTION NO. 1

DATE: June 20, 2023 PROJECT NO: 230117

RE: Streets of West Pryor – Lot 5 Core & Shell

The Work shall be carried out in accordance with the following supplemental instructions issued in accordance with the Contract Documents without change in Contract Sum or Contract Time. If changes in Contract Sum or Contract Time are required, Contractor shall submit Change Order Request in a timely manner.

ASI No. 1 is part of the contract Bid and Construction Documents and shall govern in the performance of the Work.

## **DESCRIPTION:**


## **Clarification Items:**

- G-1 Attached drawings associated with ASI-1 are marked with a Delta 2, Rev #2, or similar.
- G-2 Title blocks of all Architectural drawings have been updated with exact site address.
- G-3 Sheets G-001, A-101, & A-301 Room Labels have changed to Suite A, B, & C.

## **Architectural Items:**

- A-1 Sheet A-101 UL Fire rated wall assembly information has been added to partition type P1.
  - A-1.A Partition types P2 & P3 have been added to partition type legend.
  - A-1.B Partition types P2 & P3 have been tagged in plan.
- A-2 Sheet A-102 Pilaster added to West wall.
- A-3 Sheet A-301 Wall construction updated to clarify horizontal lap aluminum siding.

## **END OF ASI-1**

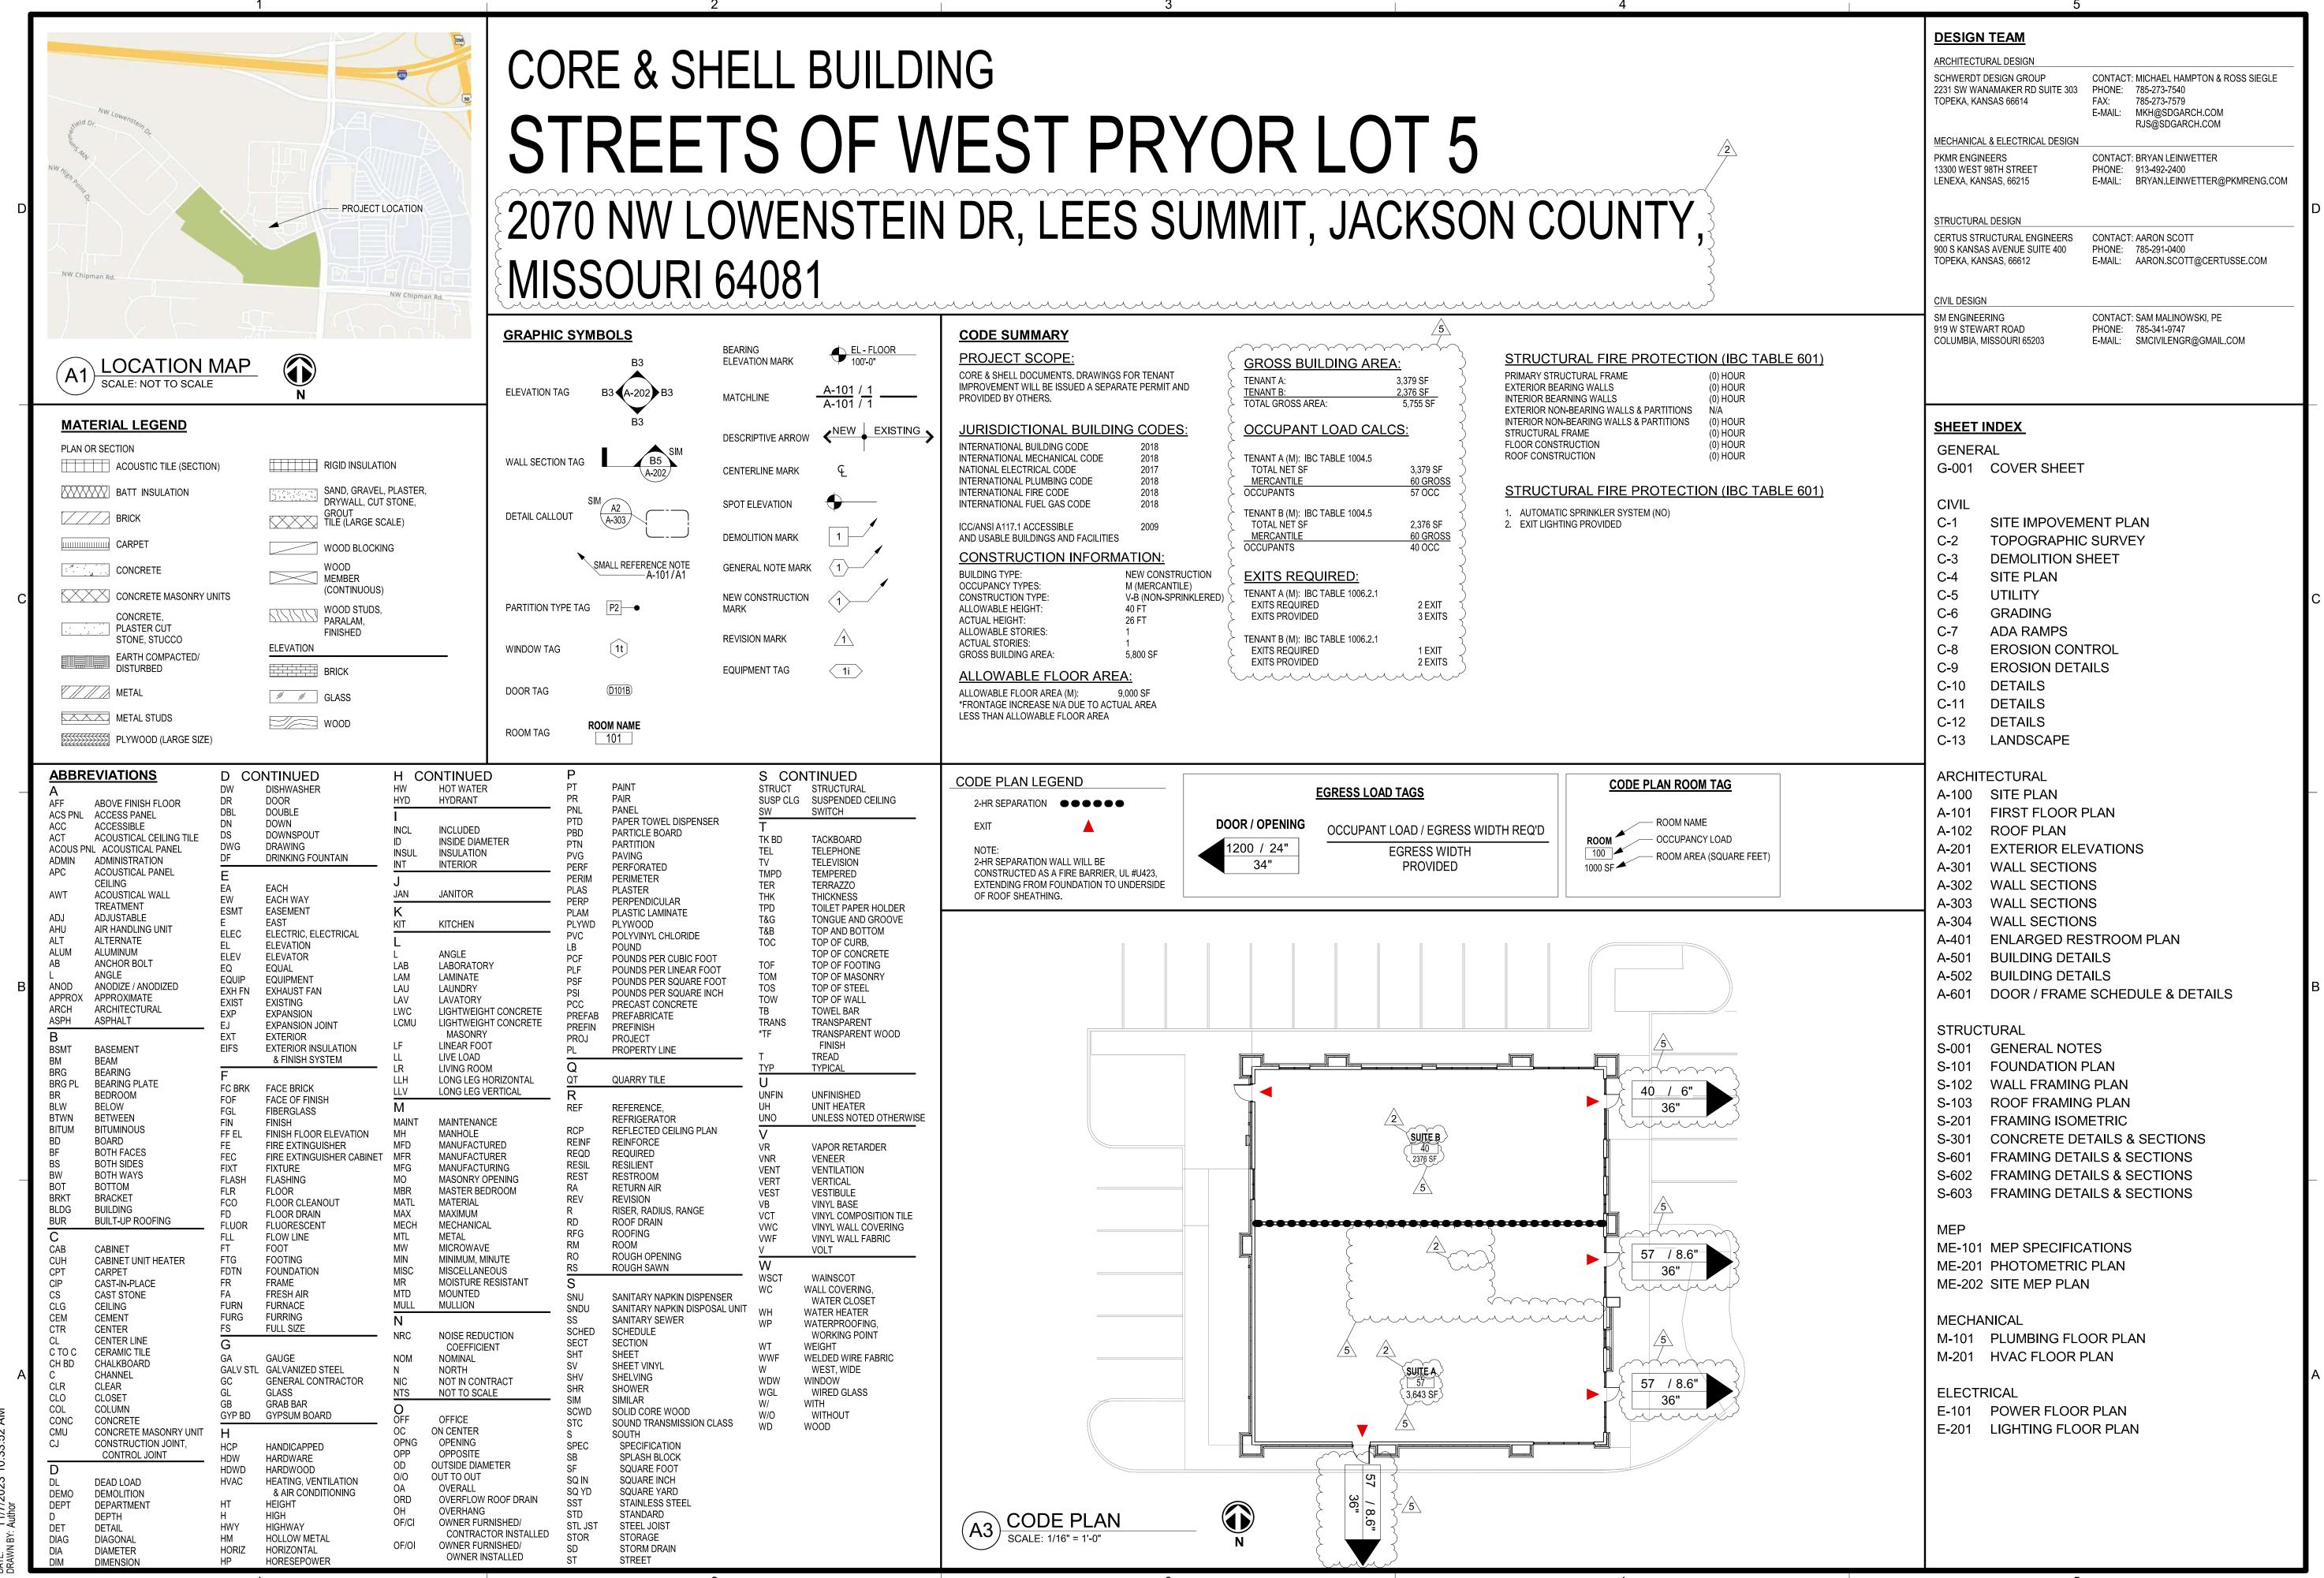



schwerdt design grou 2231 sw wanamaker rd s topeka, kansas 66614-4275 phone: 785.273.7540 ax: 785.273.7579

500 north broadway oklahoma city, ok 73102 phone: 405.231.3105 ax: 405.231.3115




MO CERTIFICATE OF AUTH. #F003538

DIN ES ωщ ORE TRE

> PROGRESS PRINT ONLY 06-13-2023 ASI-4 11-07-2023

> > **COVER SHEET**

230117

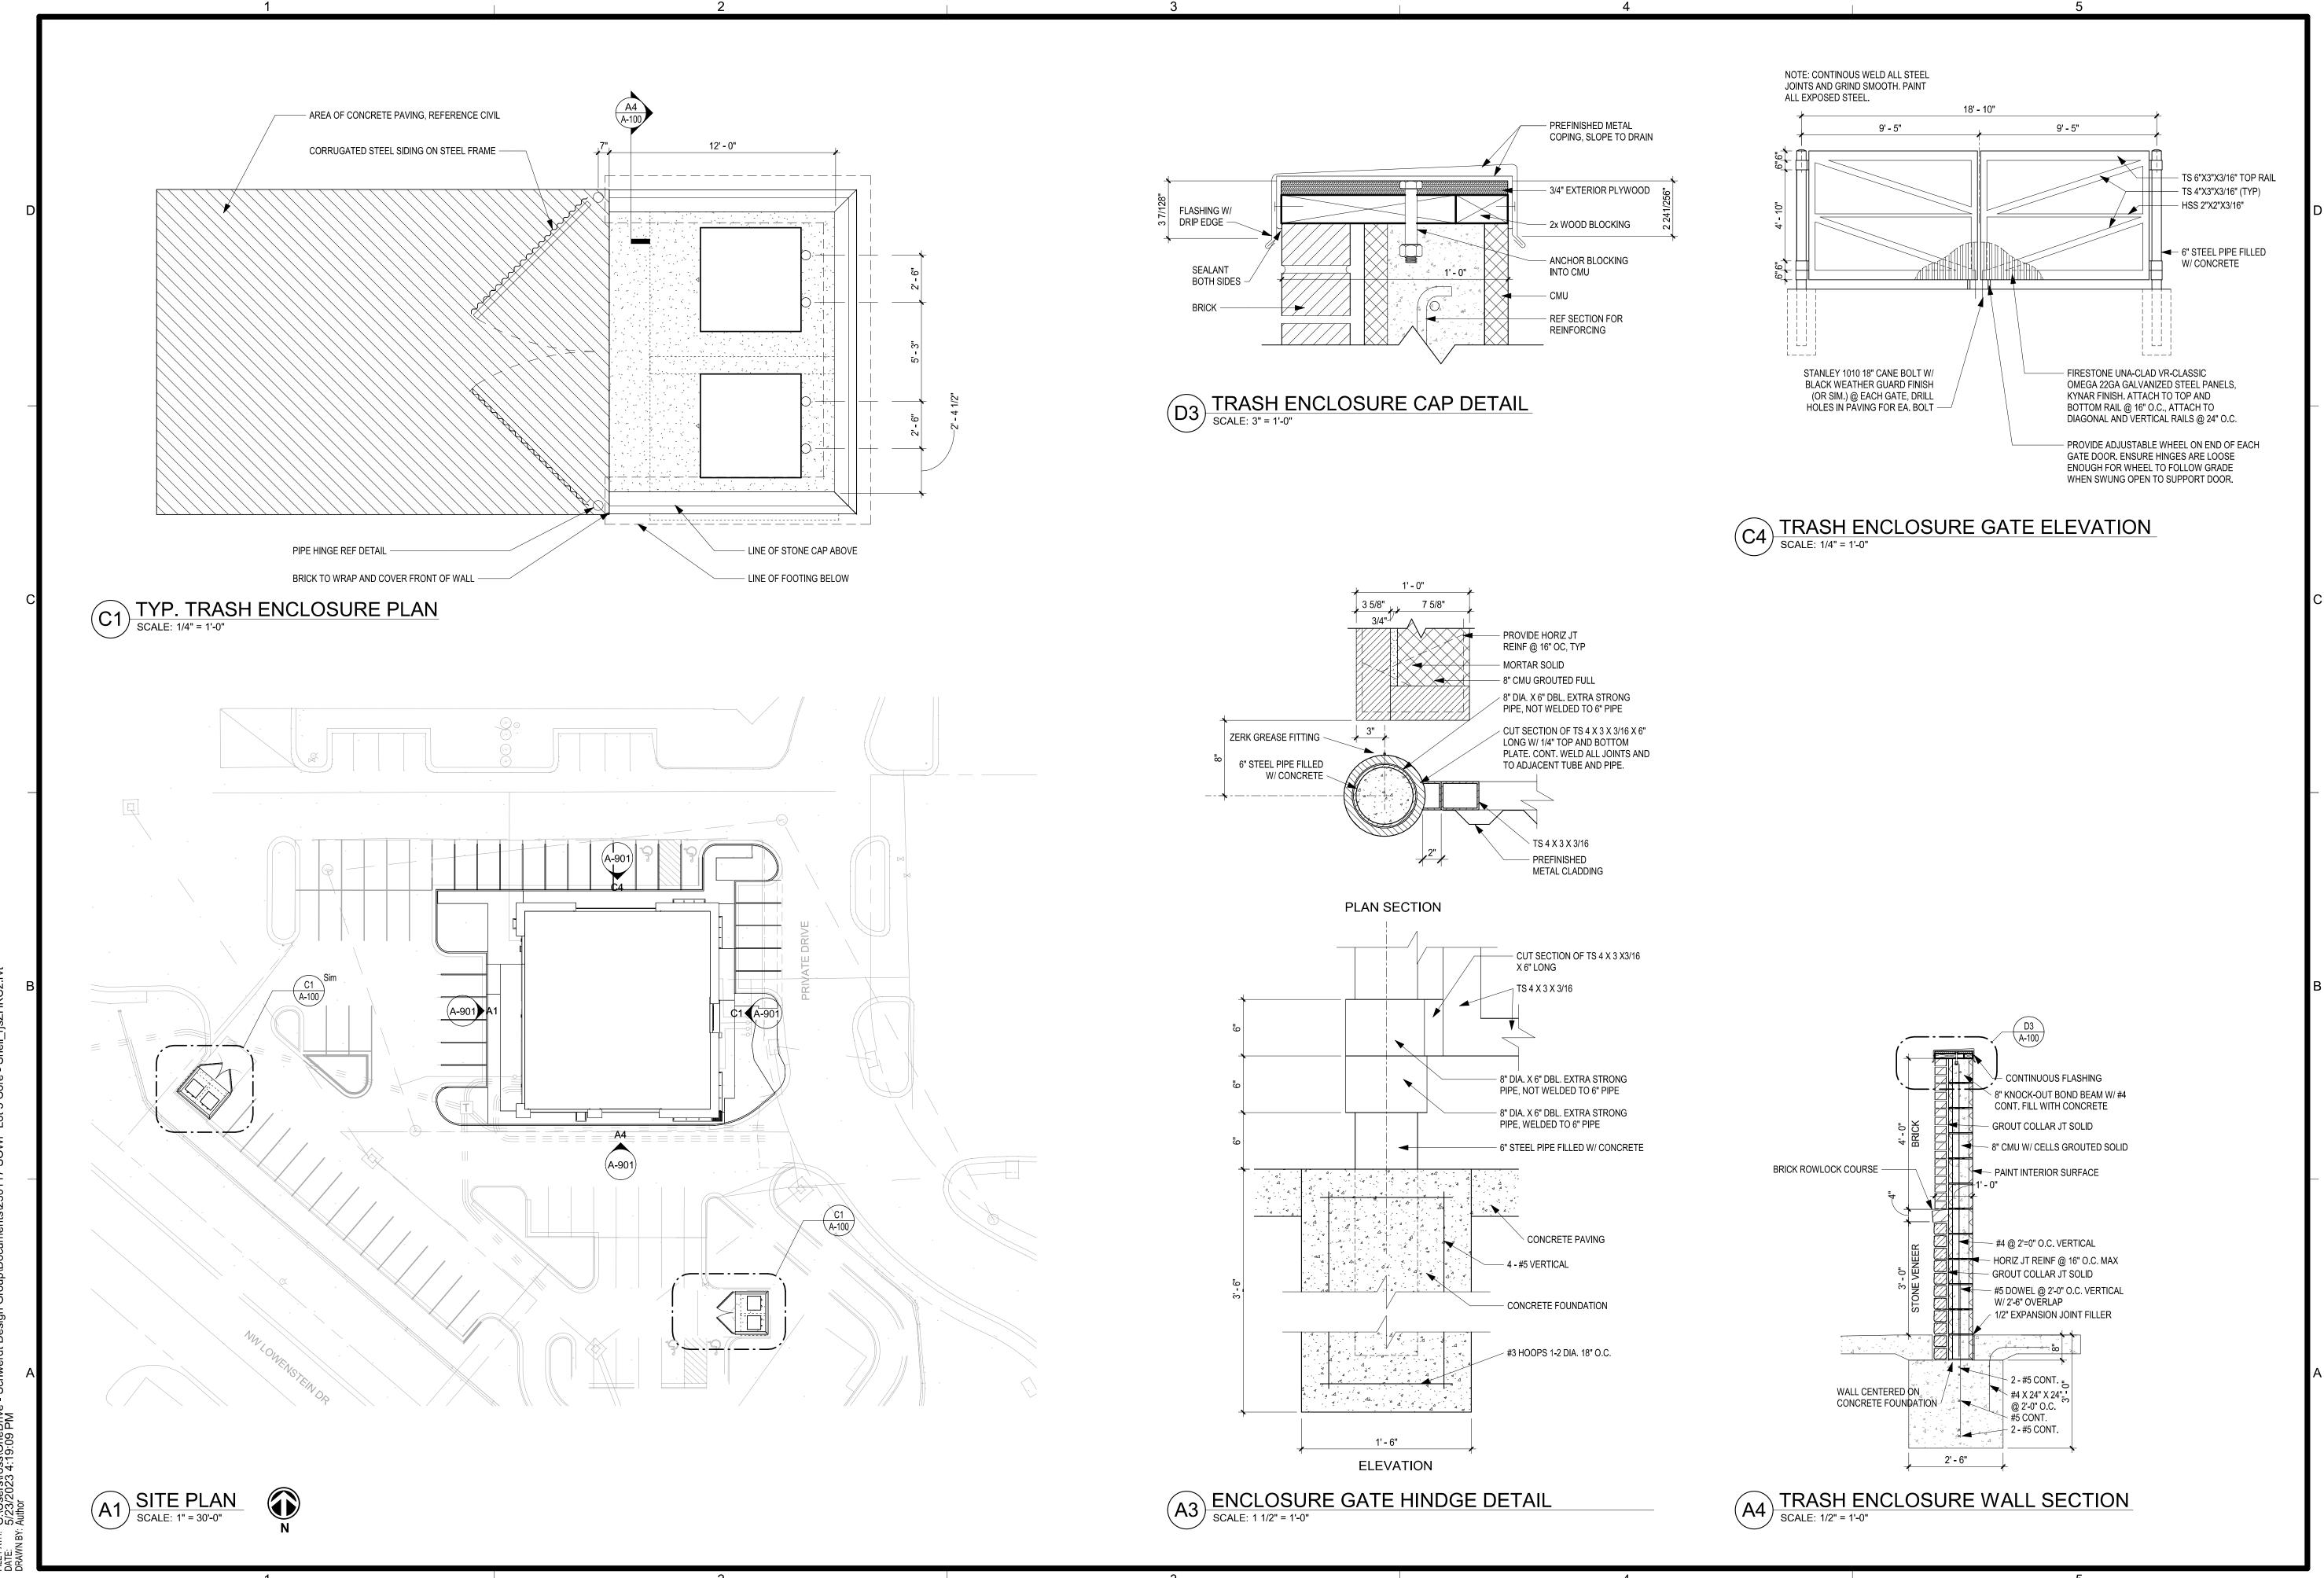

schwerdt design group architecture | interiors | plannin

2231 sw wanamaker rd suite 303 topeka, kansas 66614-4275 phone: 785.273.7540 fax: 785.273.7579 500 north broadway oklahoma city, ok 73102 phone: 405.231.3105 fax: 405.231.3115

MICHAEL K HAMPTON #MO# A-2008027042

MO CERTIFICATE OF AUTH. #F00353876


5 O PRYOR OURI 64081

BUILDING F WEST CORE & S STREE LEES SUMMIT,

PROGRESS PRINT ONLY

SITE PLAN

230117

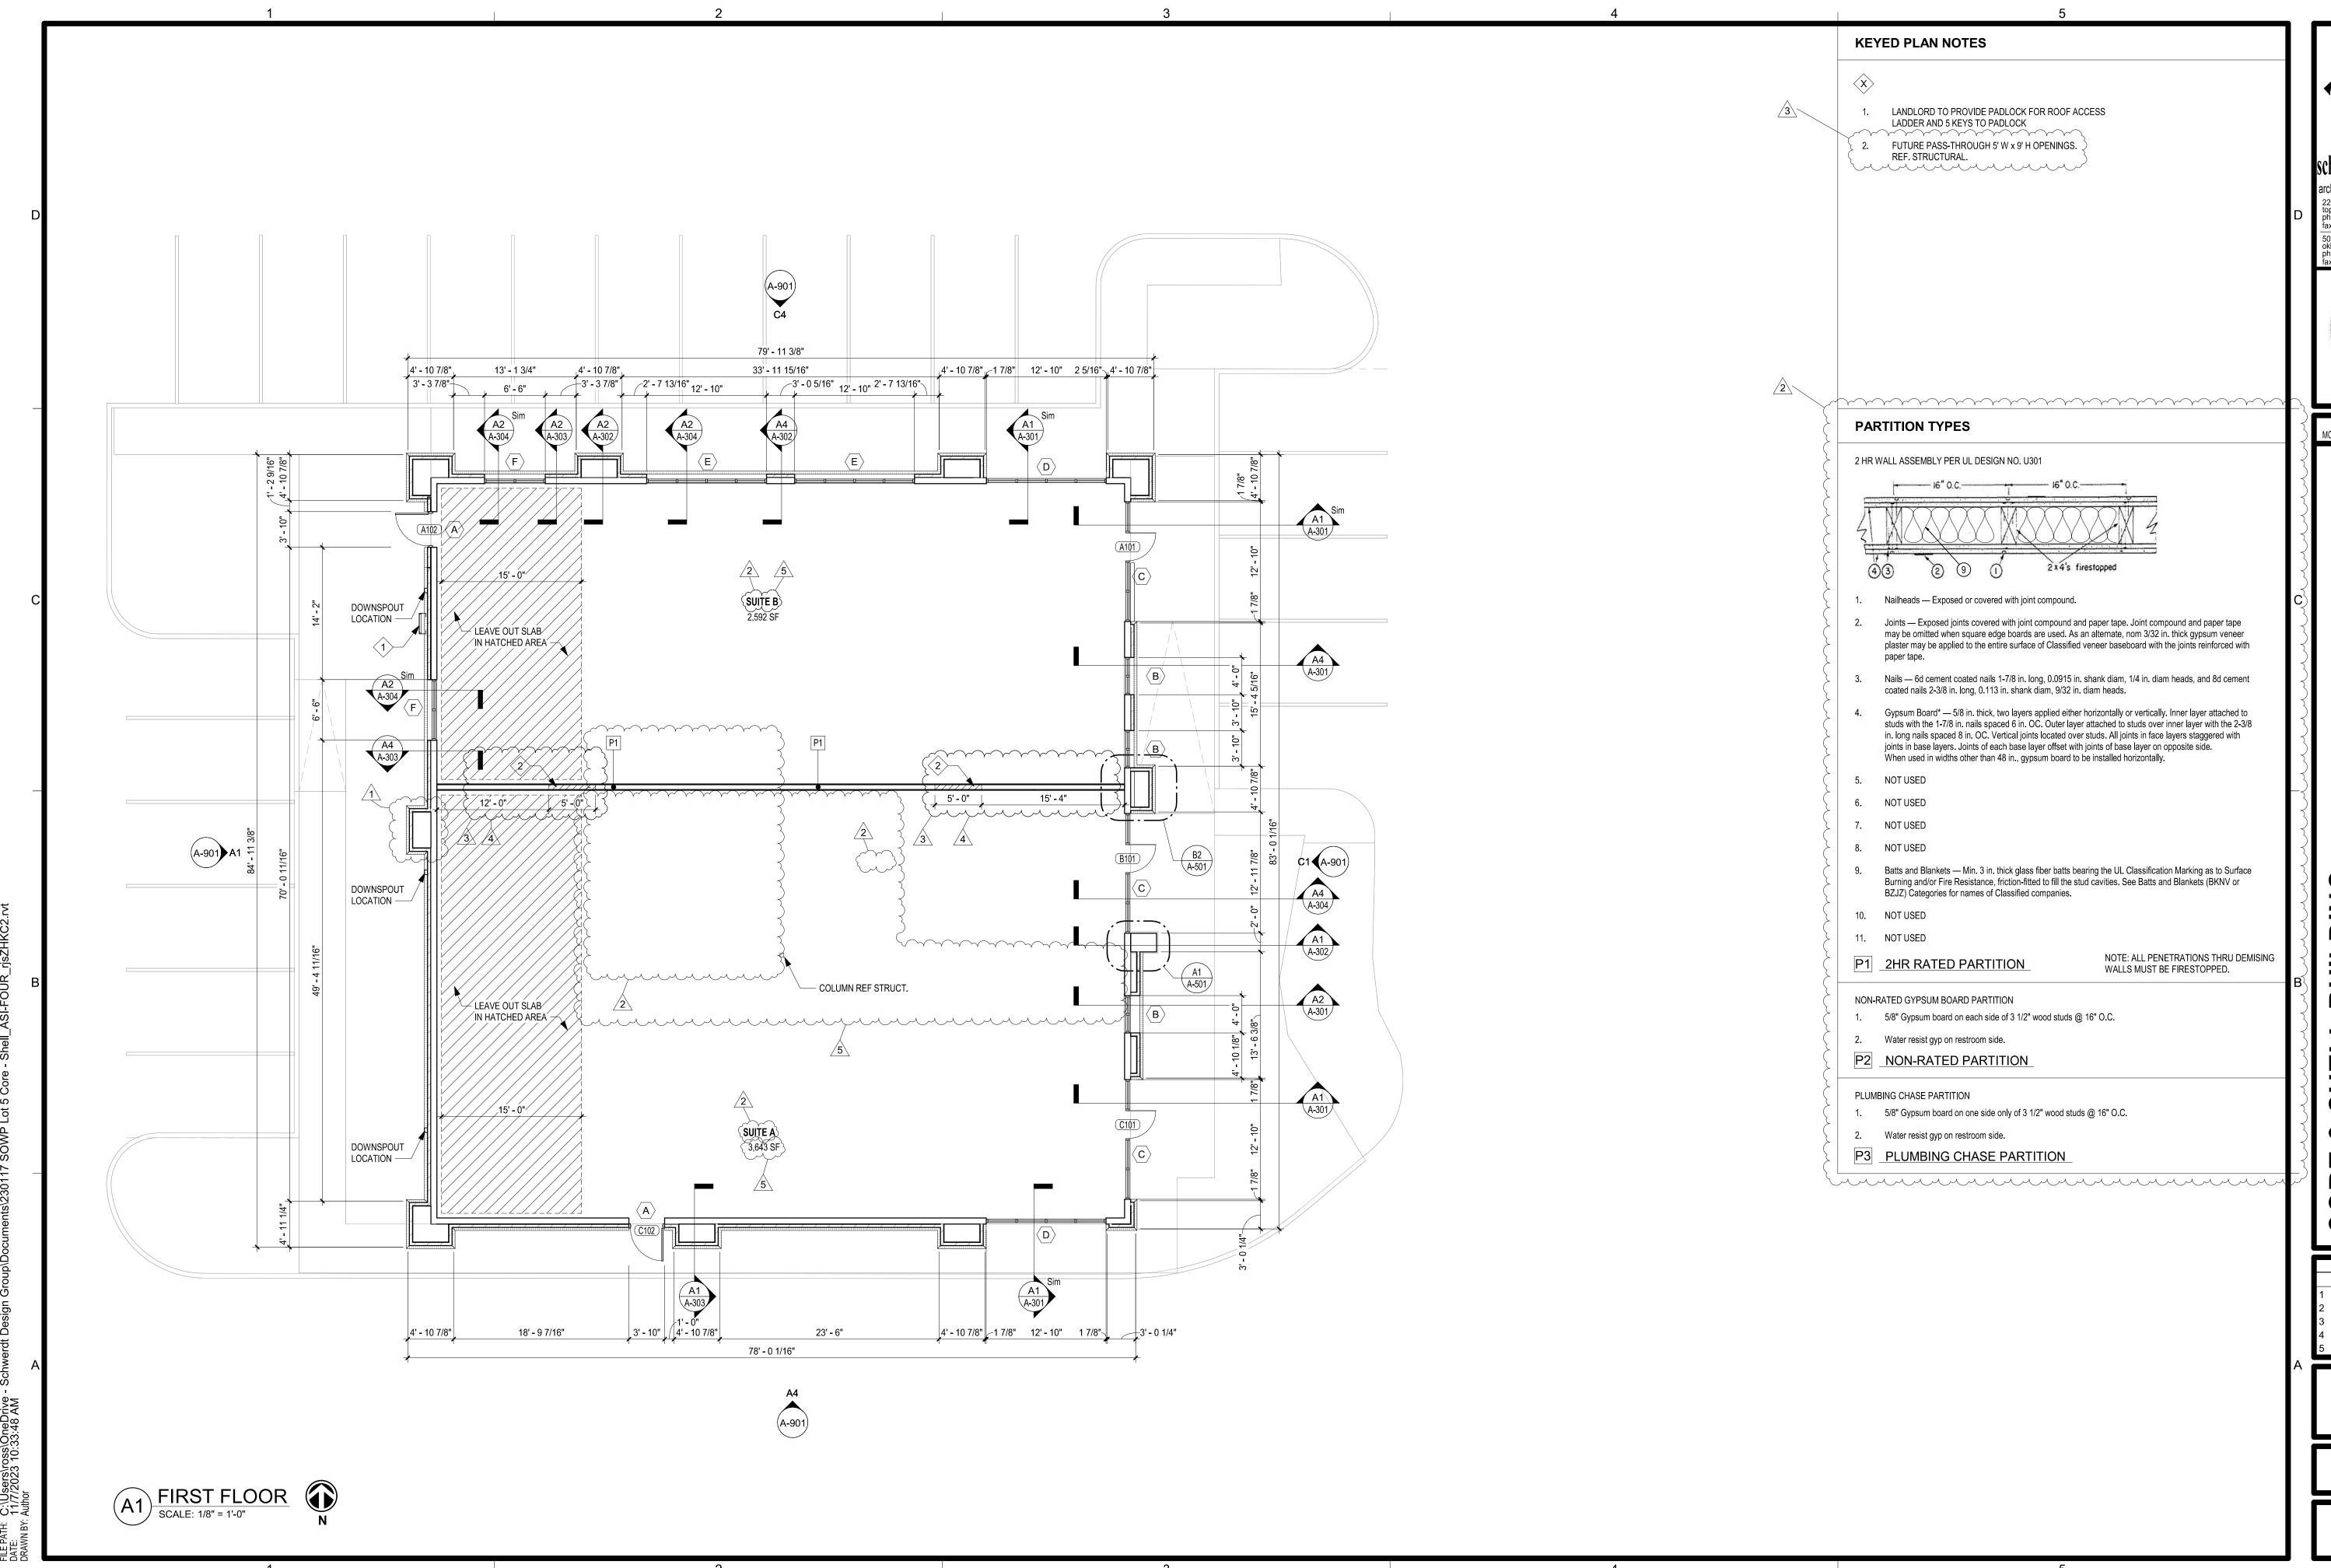

architecture | interiors | planning 2231 sw wanamaker rd suite 303 topeka, kansas 66614-4275 phone: 785.273.7540 fax: 785.273.7579

500 north broadway oklahoma city, ok 73102 phone: 405.231.3105 fax: 405.231.3115




MO CERTIFICATE OF AUTH. #F00353876

UILDING WEST , LEES SUMIN М CORE & S STREE

PROGRESS PRINT ONLY 06-13-2023 07-07-2023 ASI-2 ASI-3 07-26-2023 ASI-4 11-07-2023

FIRST FLOOR PLAN

230117

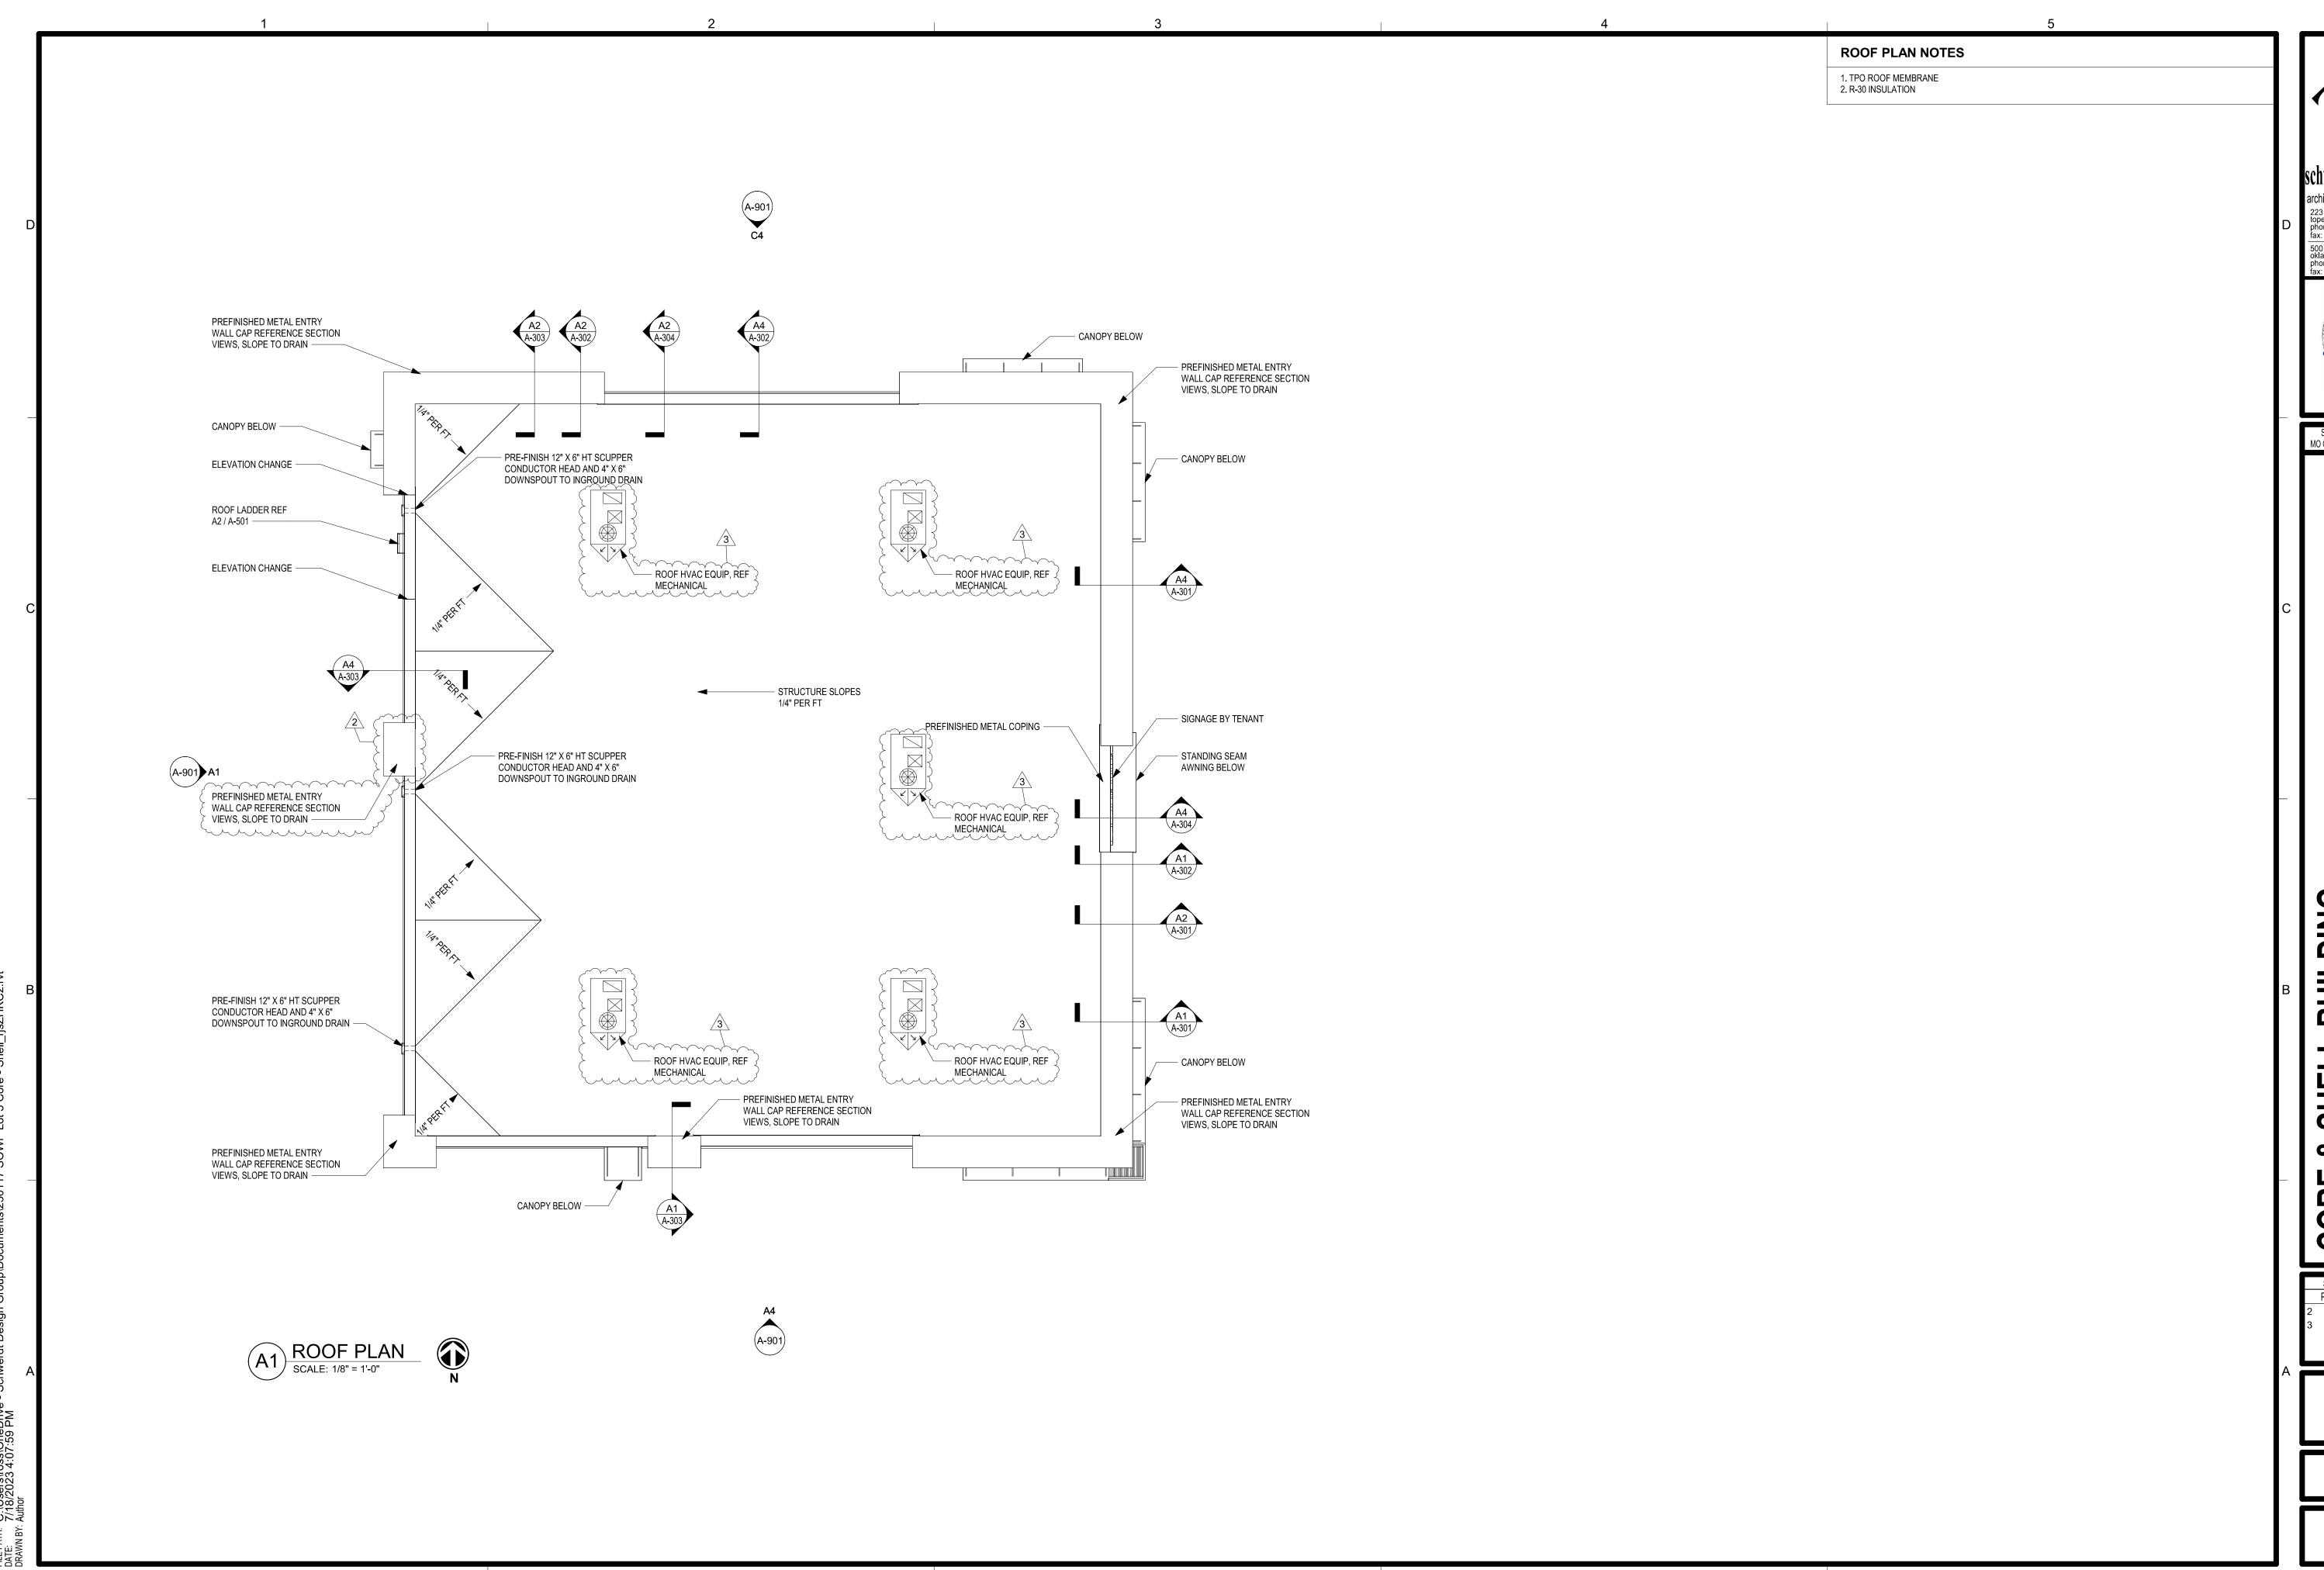

schwerdt design group
architecture | interiors | planning
2231 sw wanamaker rd
topeka, kansas 66614-4275
phone: 785.273.7540

2231 sw wanamaker rd topeka, kansas 66614-4275 phone: 785.273.7540 fax: 785.273.7579

500 north broadway oklahoma city, ok 73102 phone: 405.231.3105 fax: 405.231.3115



SCHWERDT DESIGN GROUP INC MO CERTIFICATE OF AUTH. #F0035387

FICATE OF AUTH, #F0000001

L WESINMIT, JACKSON COUNTY, MISSOURI 6408'


E & SHELL BUILDING EETS OF WEST

SUBMISSION DATES
PROGRESS PRINT ONLY
2 ASI-1 06-13-2023
3 ASI-2 07-07-2023

SHEET TITLE ROOF PLAN


230117

A-102

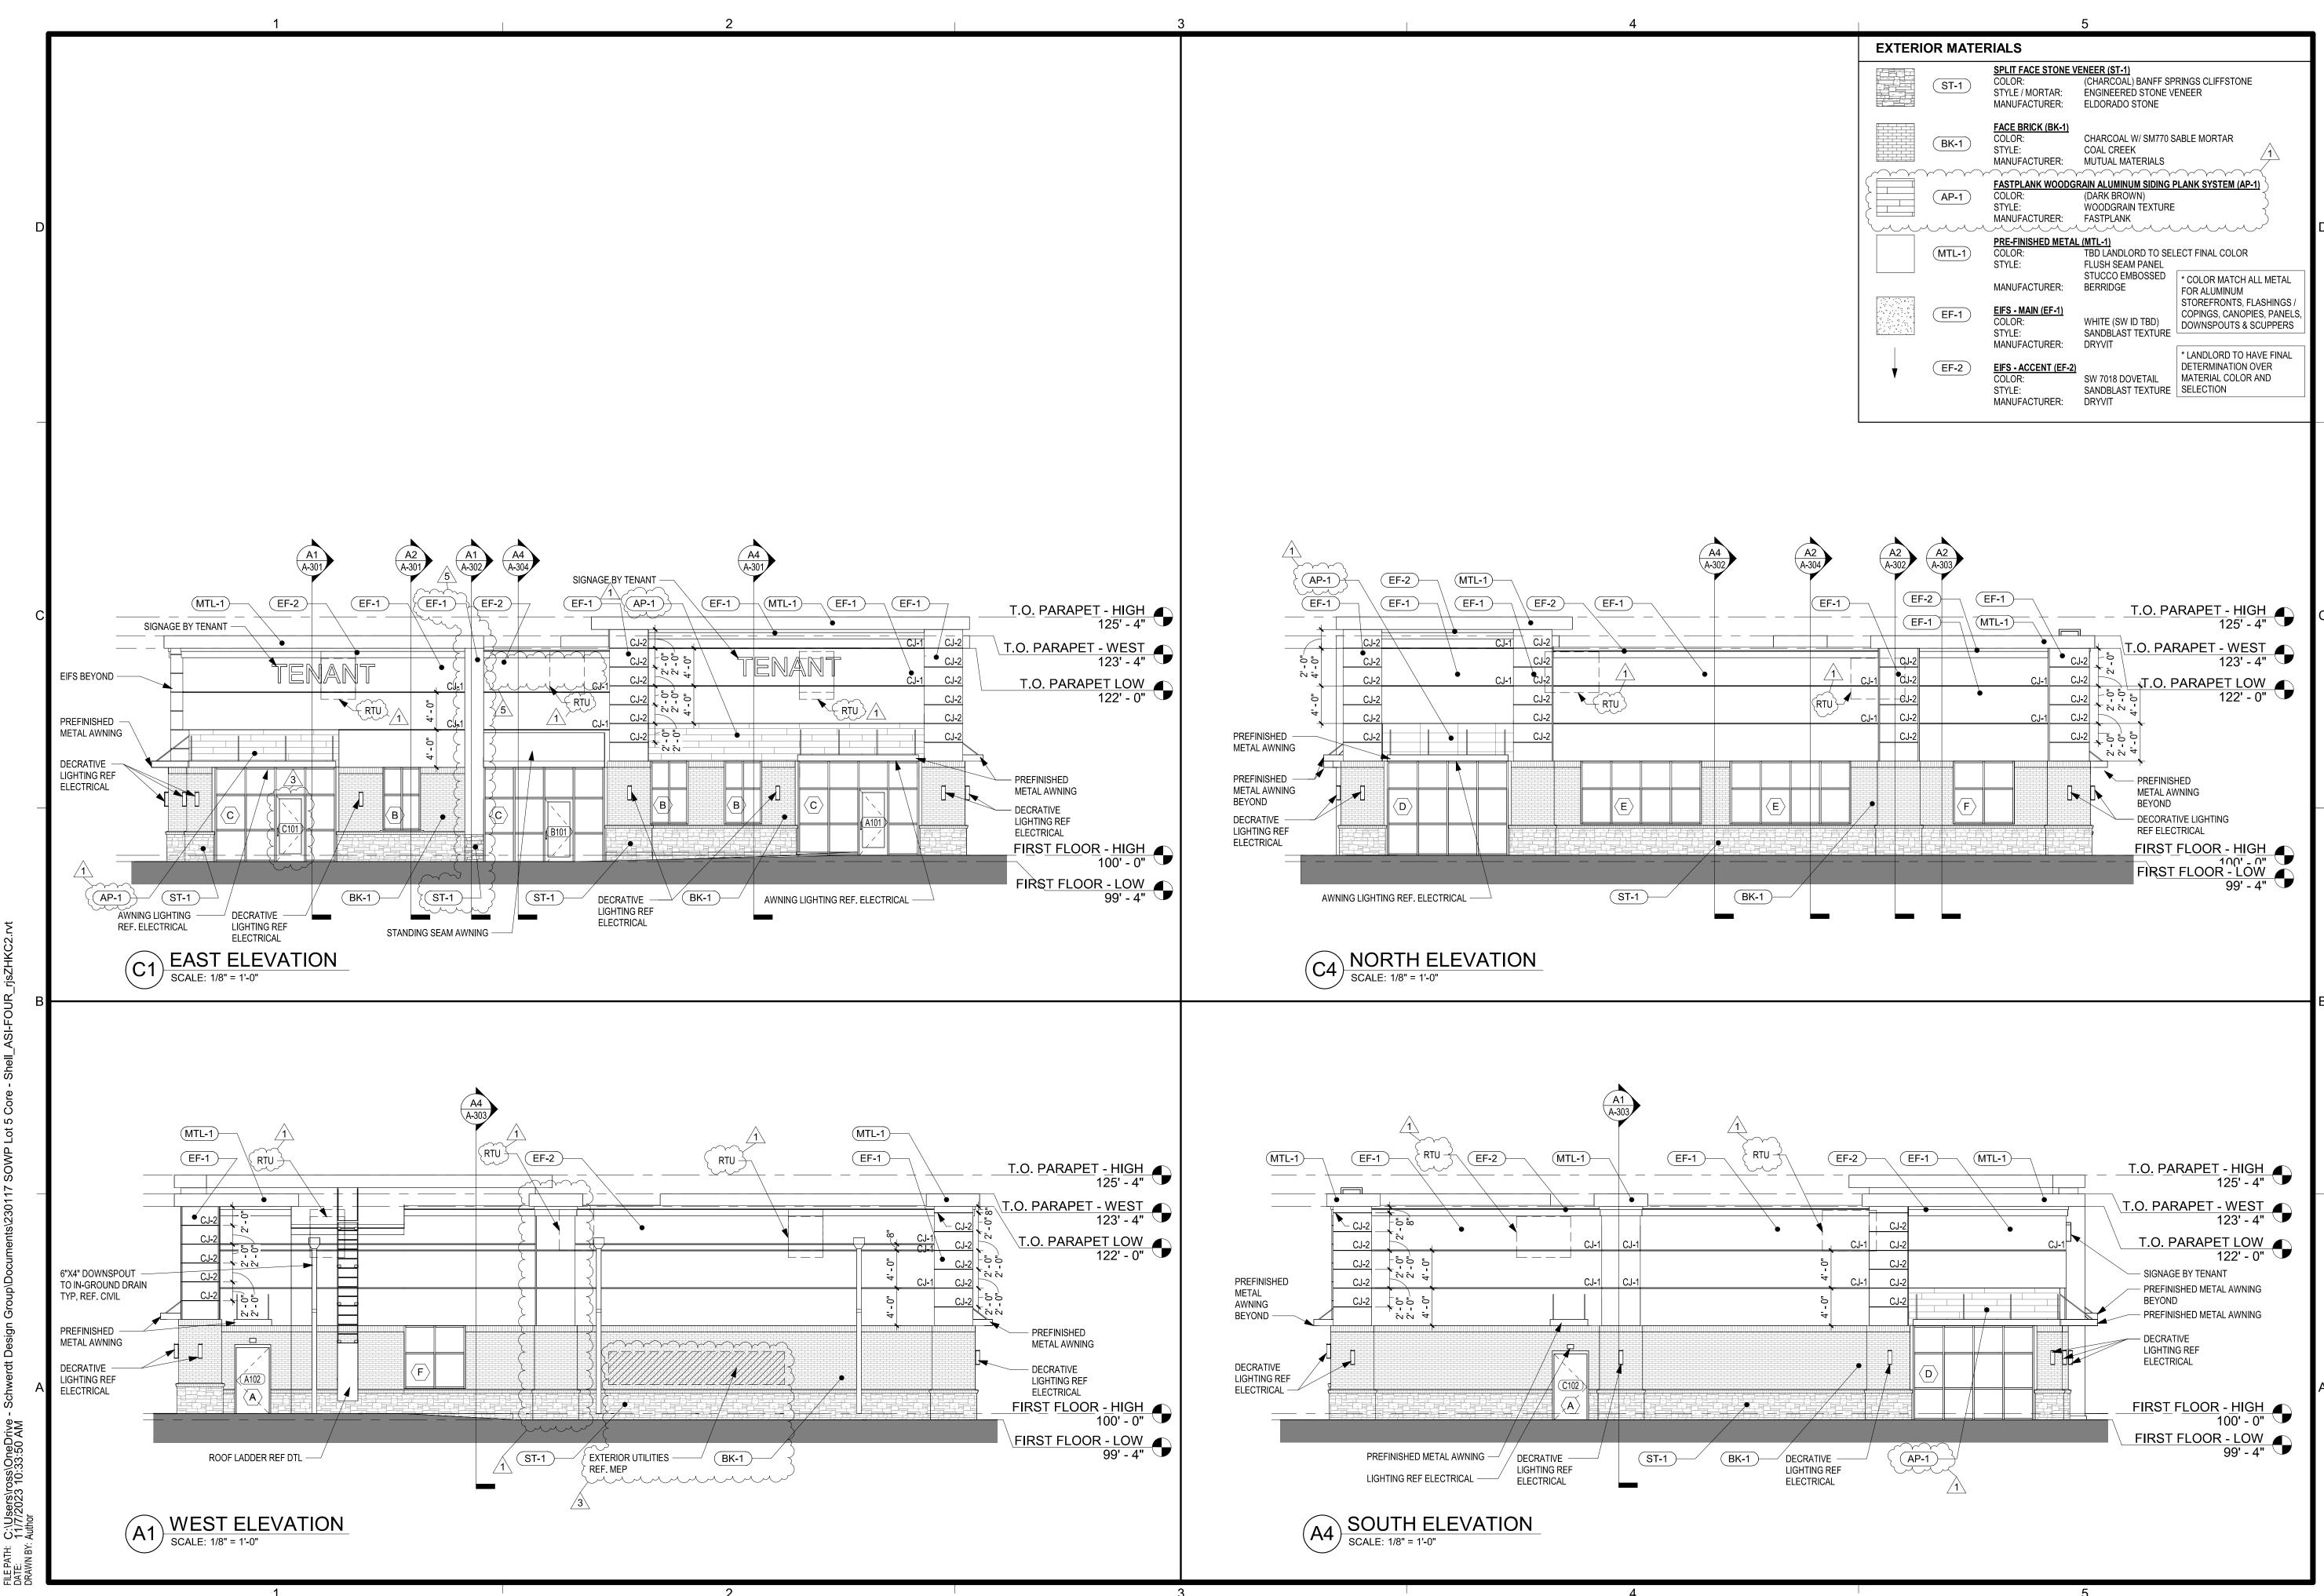

architecture interiors planning 2231 sw wanamaker rd topeka, kansas 66614-4275 phone: 785.273.7540 fax: 785.273.7579

500 north broadway oklahoma city, ok 73102 phone: 405.231.3105



SCHWERDT DESIGN GROUP INC IO CERTIFICATE OF AUTH. #F00353876


MO CERTIFICATE OF AUTH. #F00353876

CORE & SHELL BUILDING
STREETS OF WEST PRYOR LOT 5
2070 NW LOWENSTEIN DR, LEES SUMMIT, JACKSON COUNTY, MISSOURI 64

SUBMISSION DATES
PROGRESS PRINT ONLY
ADD-1 06-02-2023
ASI-2 07-07-2023
ASI-4 11-07-2023

SHEET TITLE EXTERIOR ELEVATIONS

**230117** 

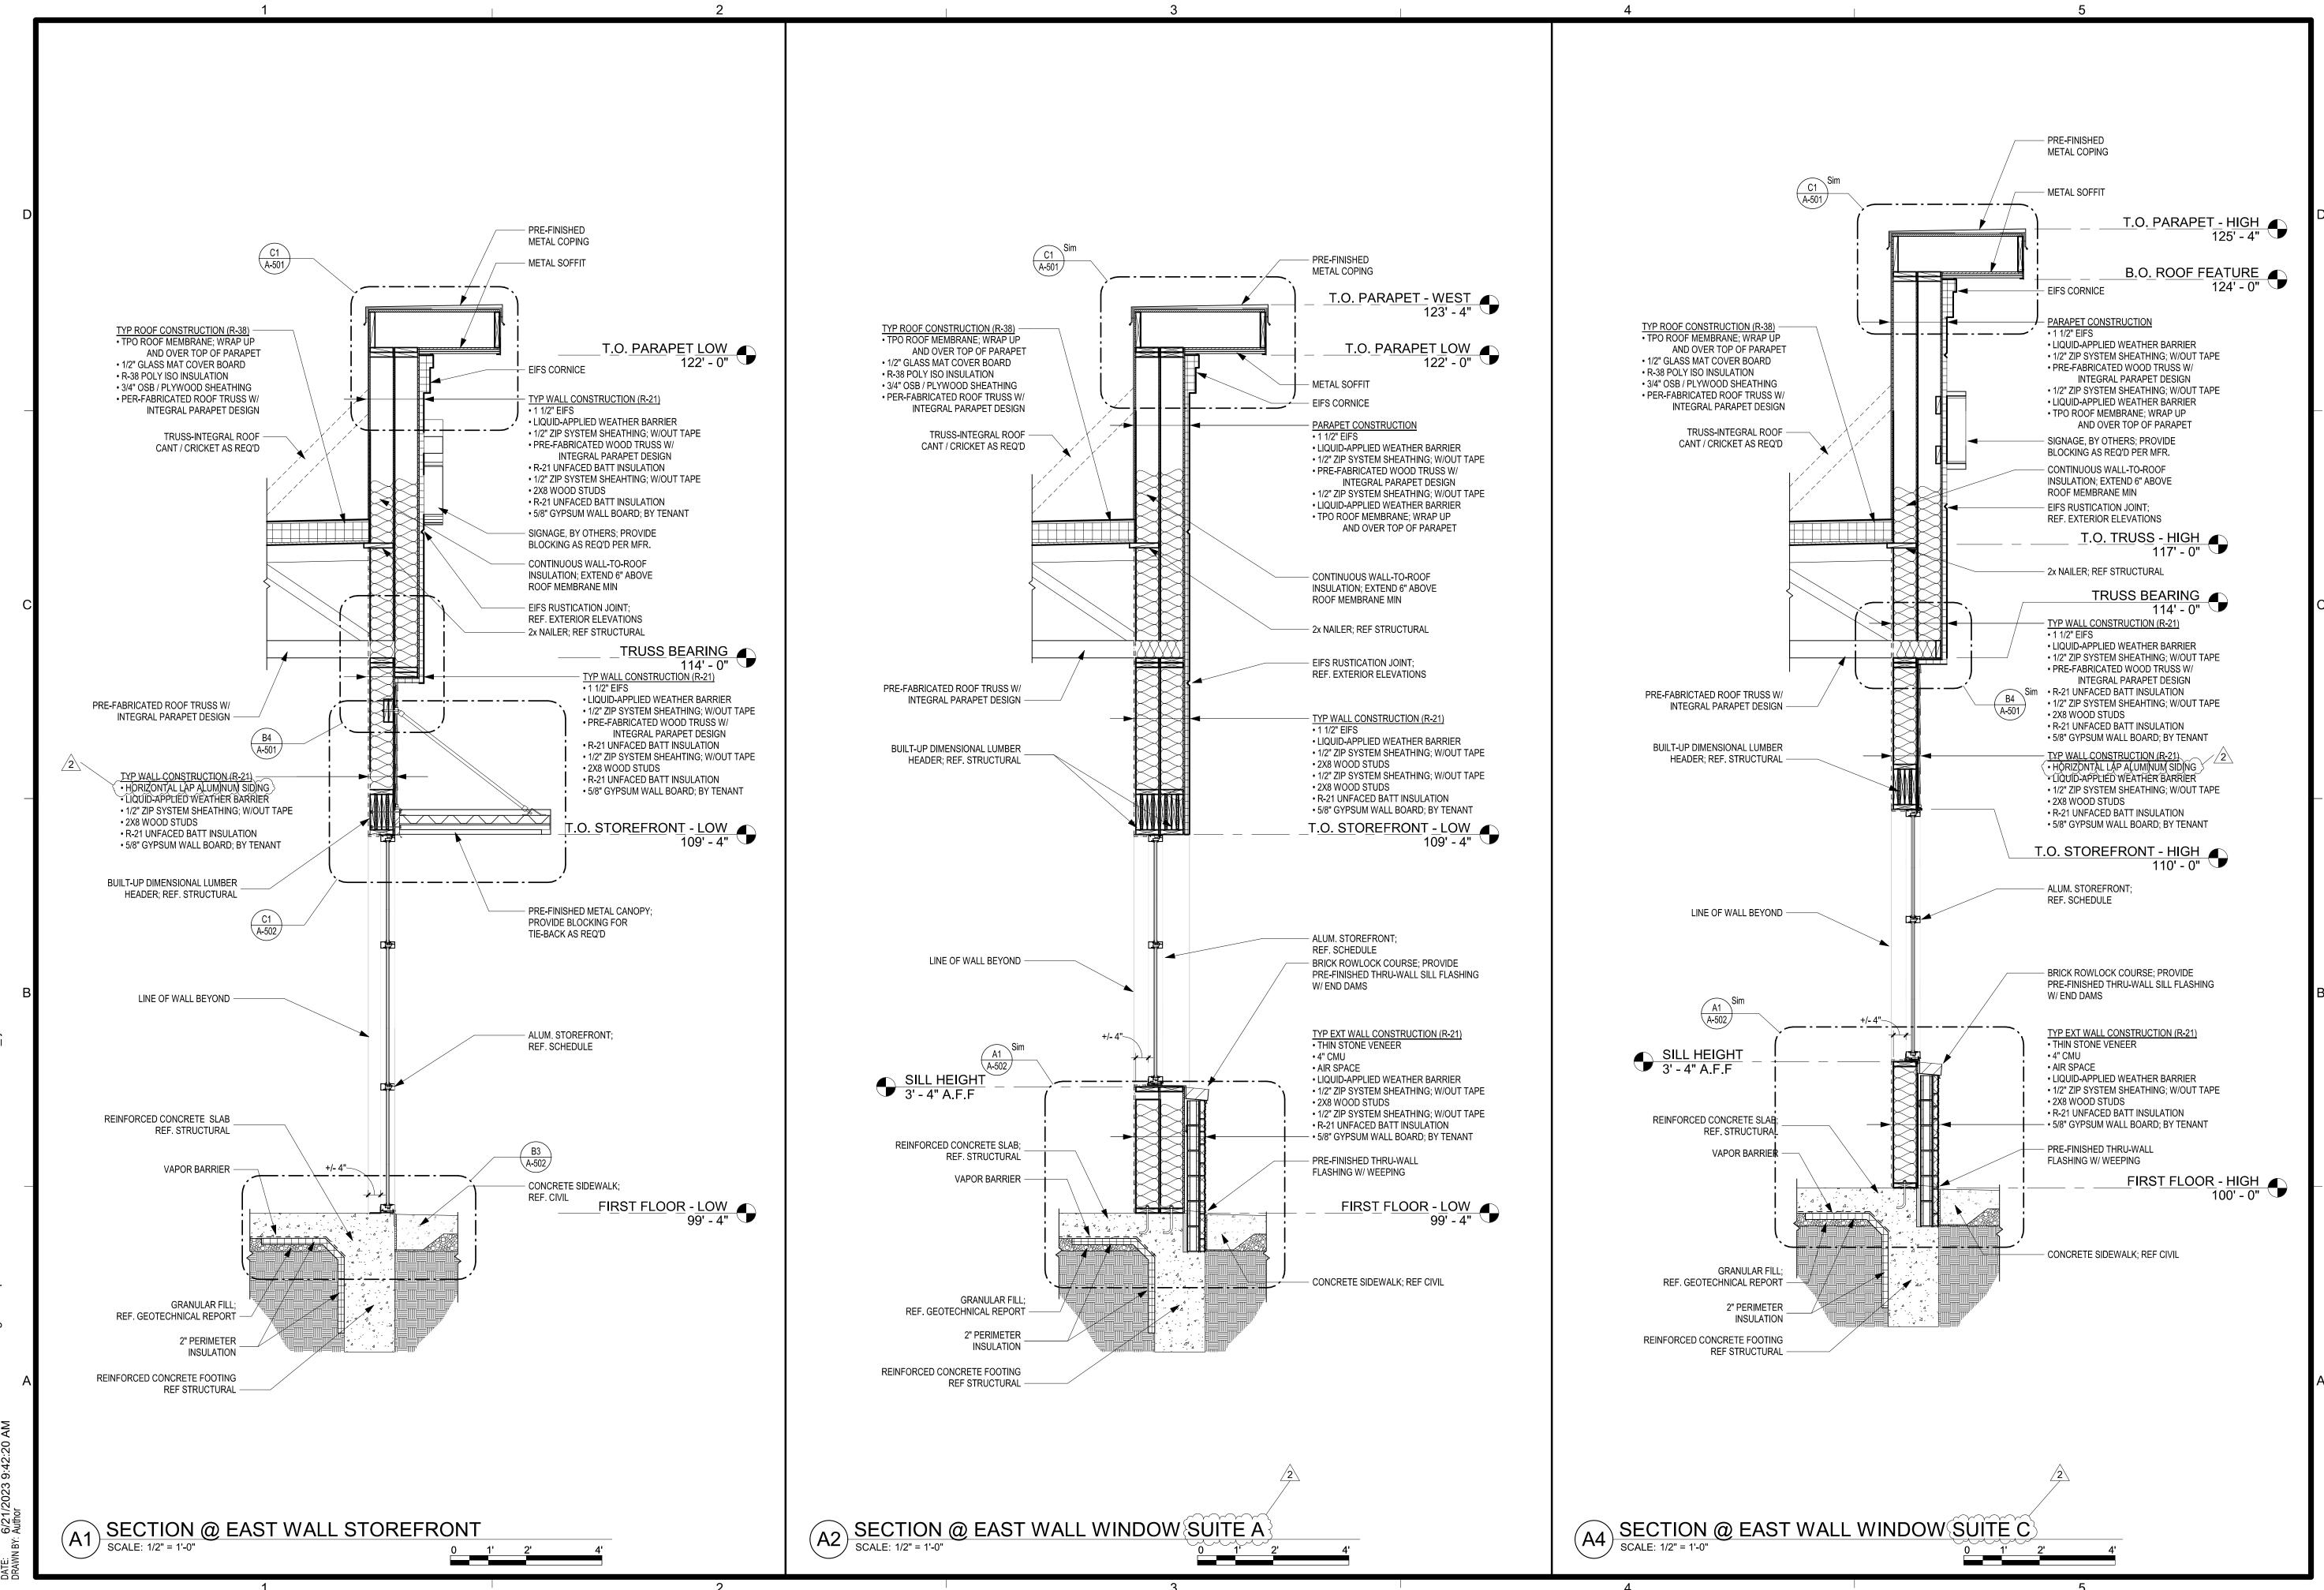



schwerdt design group
architecture | interiors | planning
2231 sw wanamaker rd
topeka, kansas 66614-4275
phone: 785.273.7540
fax: 785.273.7579

500 north broadway
oklahoma city, ok 73102
phone: 405.231.3105



SCHWERDT DESIGN GROUP INC MO CERTIFICATE OF AUTH. #F0035387

FICATE OF AUTH. #F00353876

SHELL BUILDING

TS OF WEST PRYOR LOT 5

WENSTEIN DR, LEES SUMMIT, JACKSON COUNTY, MISSOURI 6


SUBMISSION DATES
PROGRESS PRINT ONLY
ASI-1 06-13-2023

0

SHEET TITLE WALL SECTIONS

230117

A-301

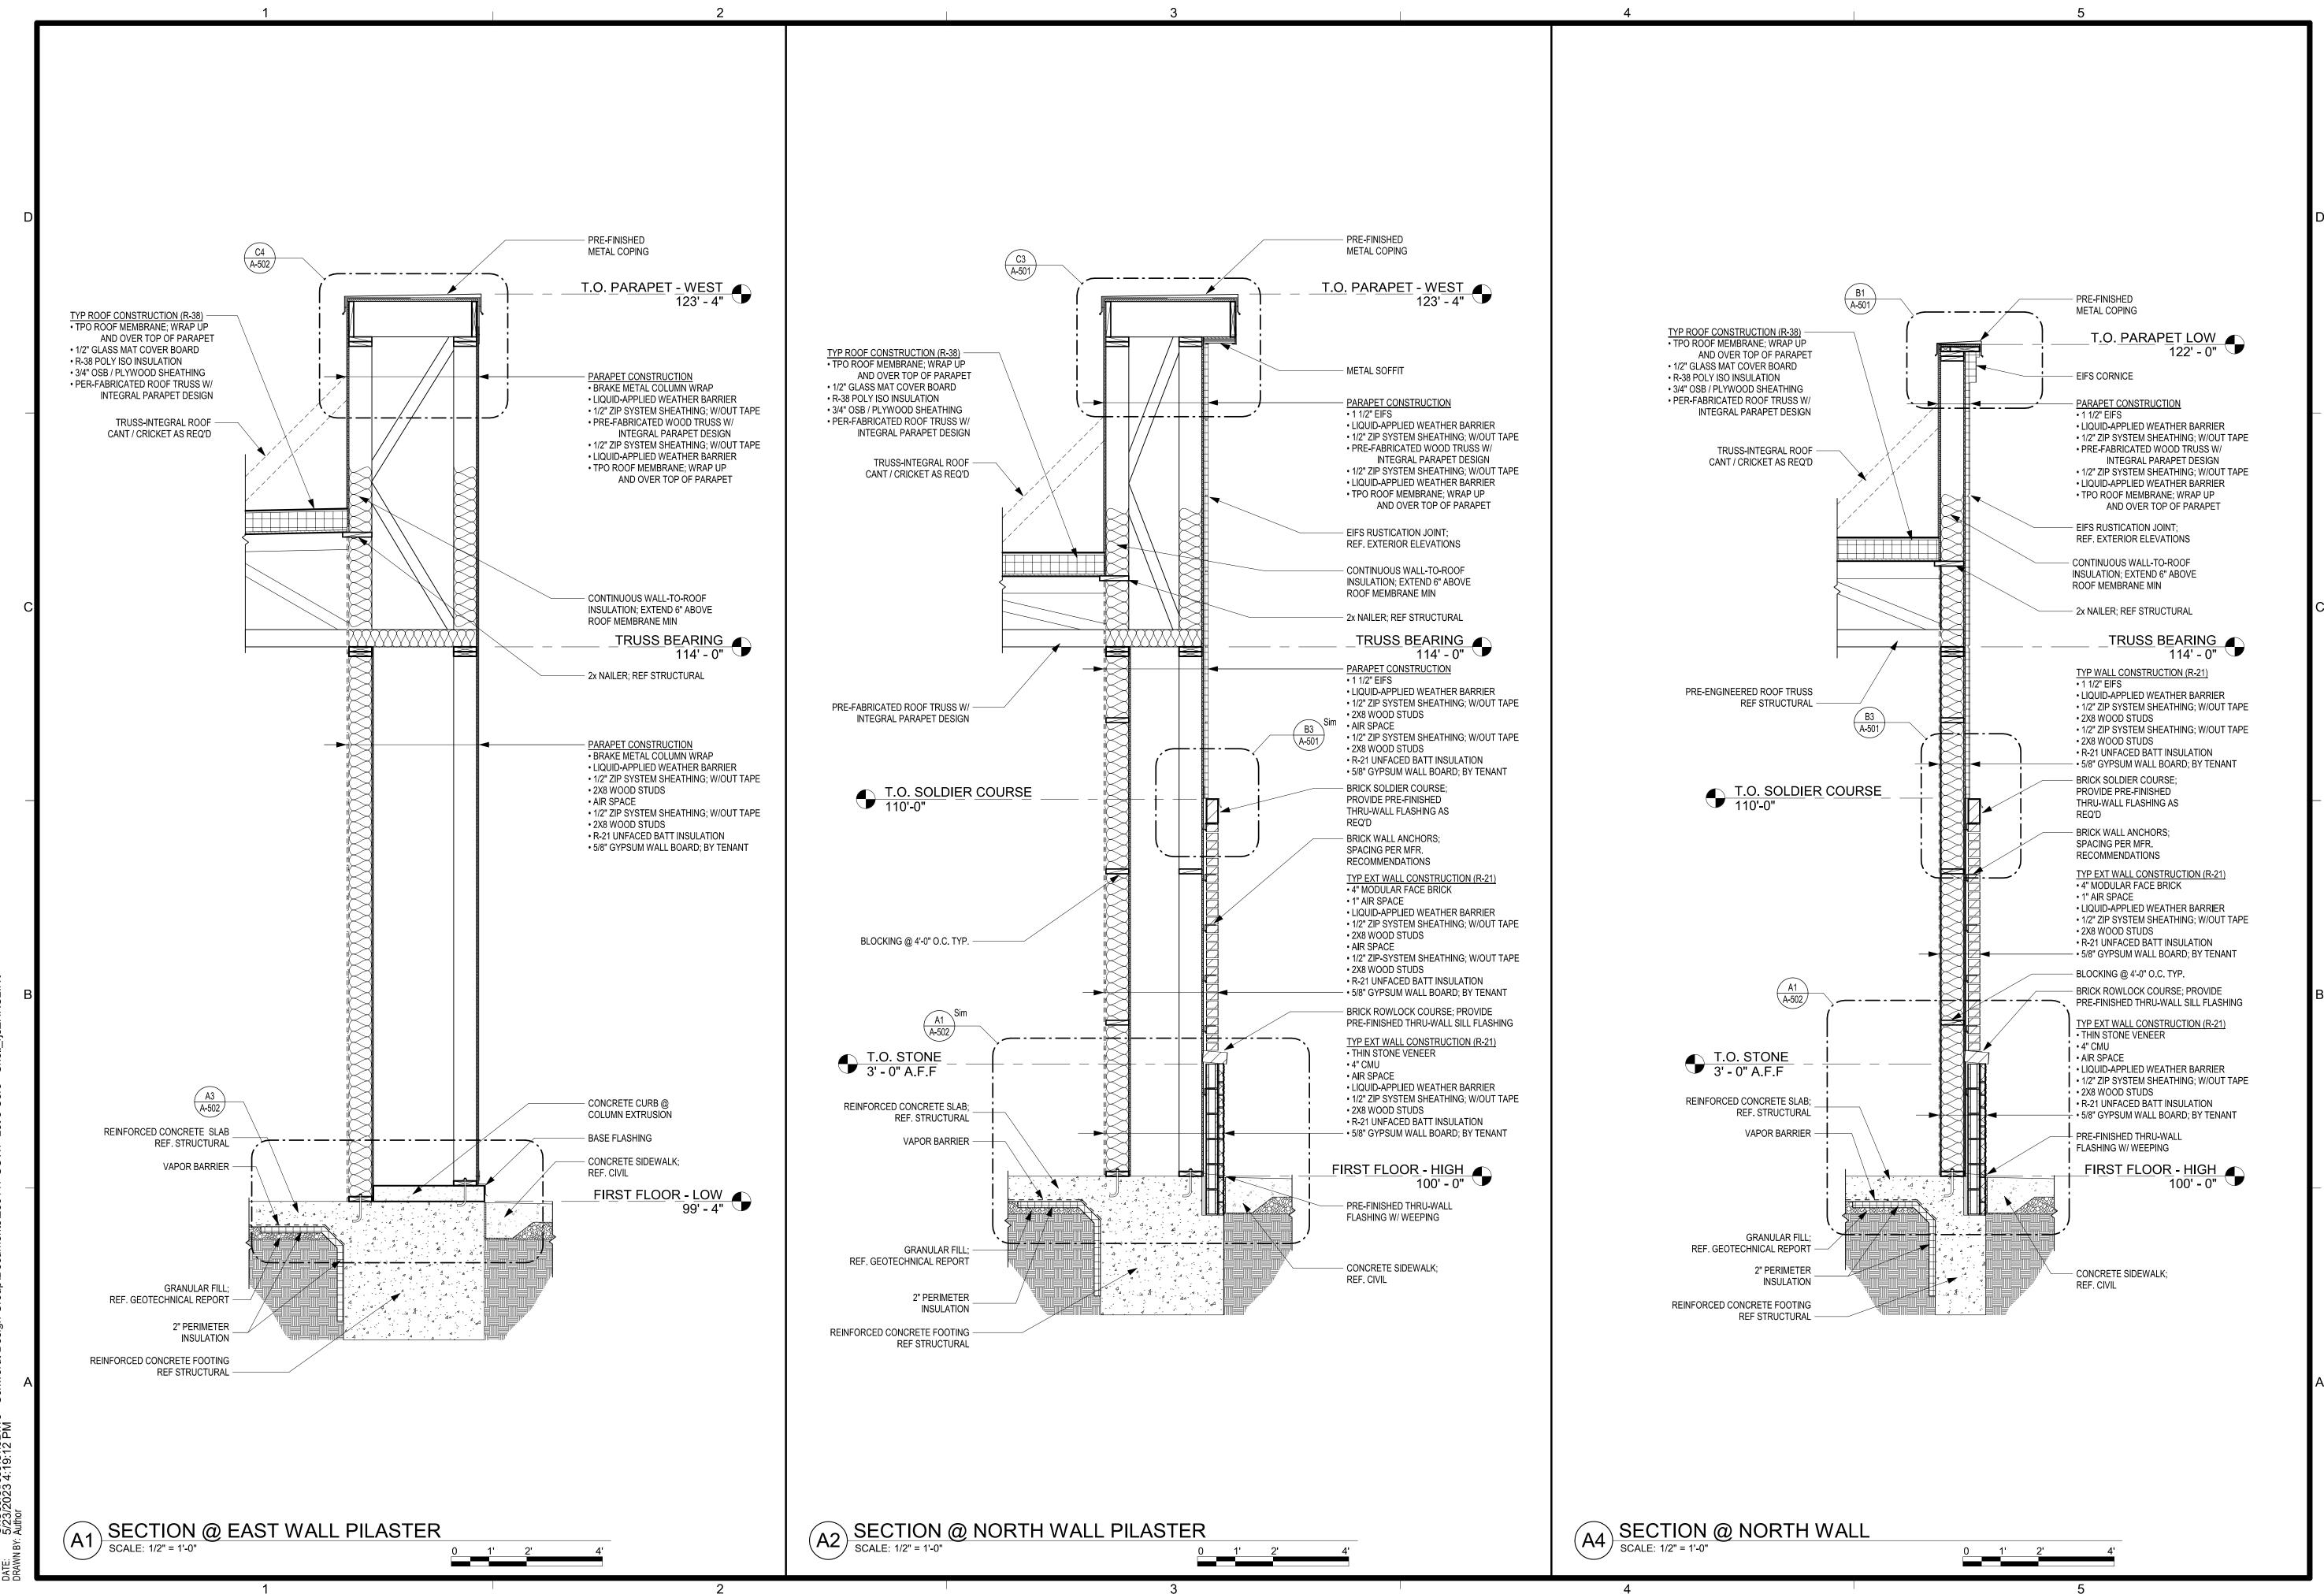

architecture | interiors | plannir 2231 sw wanamaker rd suite 30 topeka, kansas 66614-4275 phone: 785.273.7540 fax: 785.273.7579 500 north broadway oklahoma city, ok 73102 phone: 405.231.3105

fax: 405.231.3115 23 han hour MICHAEL K HAMPTON #MO# A-2008027042

MO CERTIFICATE OF AUTH. #F00353876


5 O <u>S</u> 

DIN ES ωщ SHE 00 RE 0

PROGRESS PRINT ONLY

WALL SECTIONS

230117

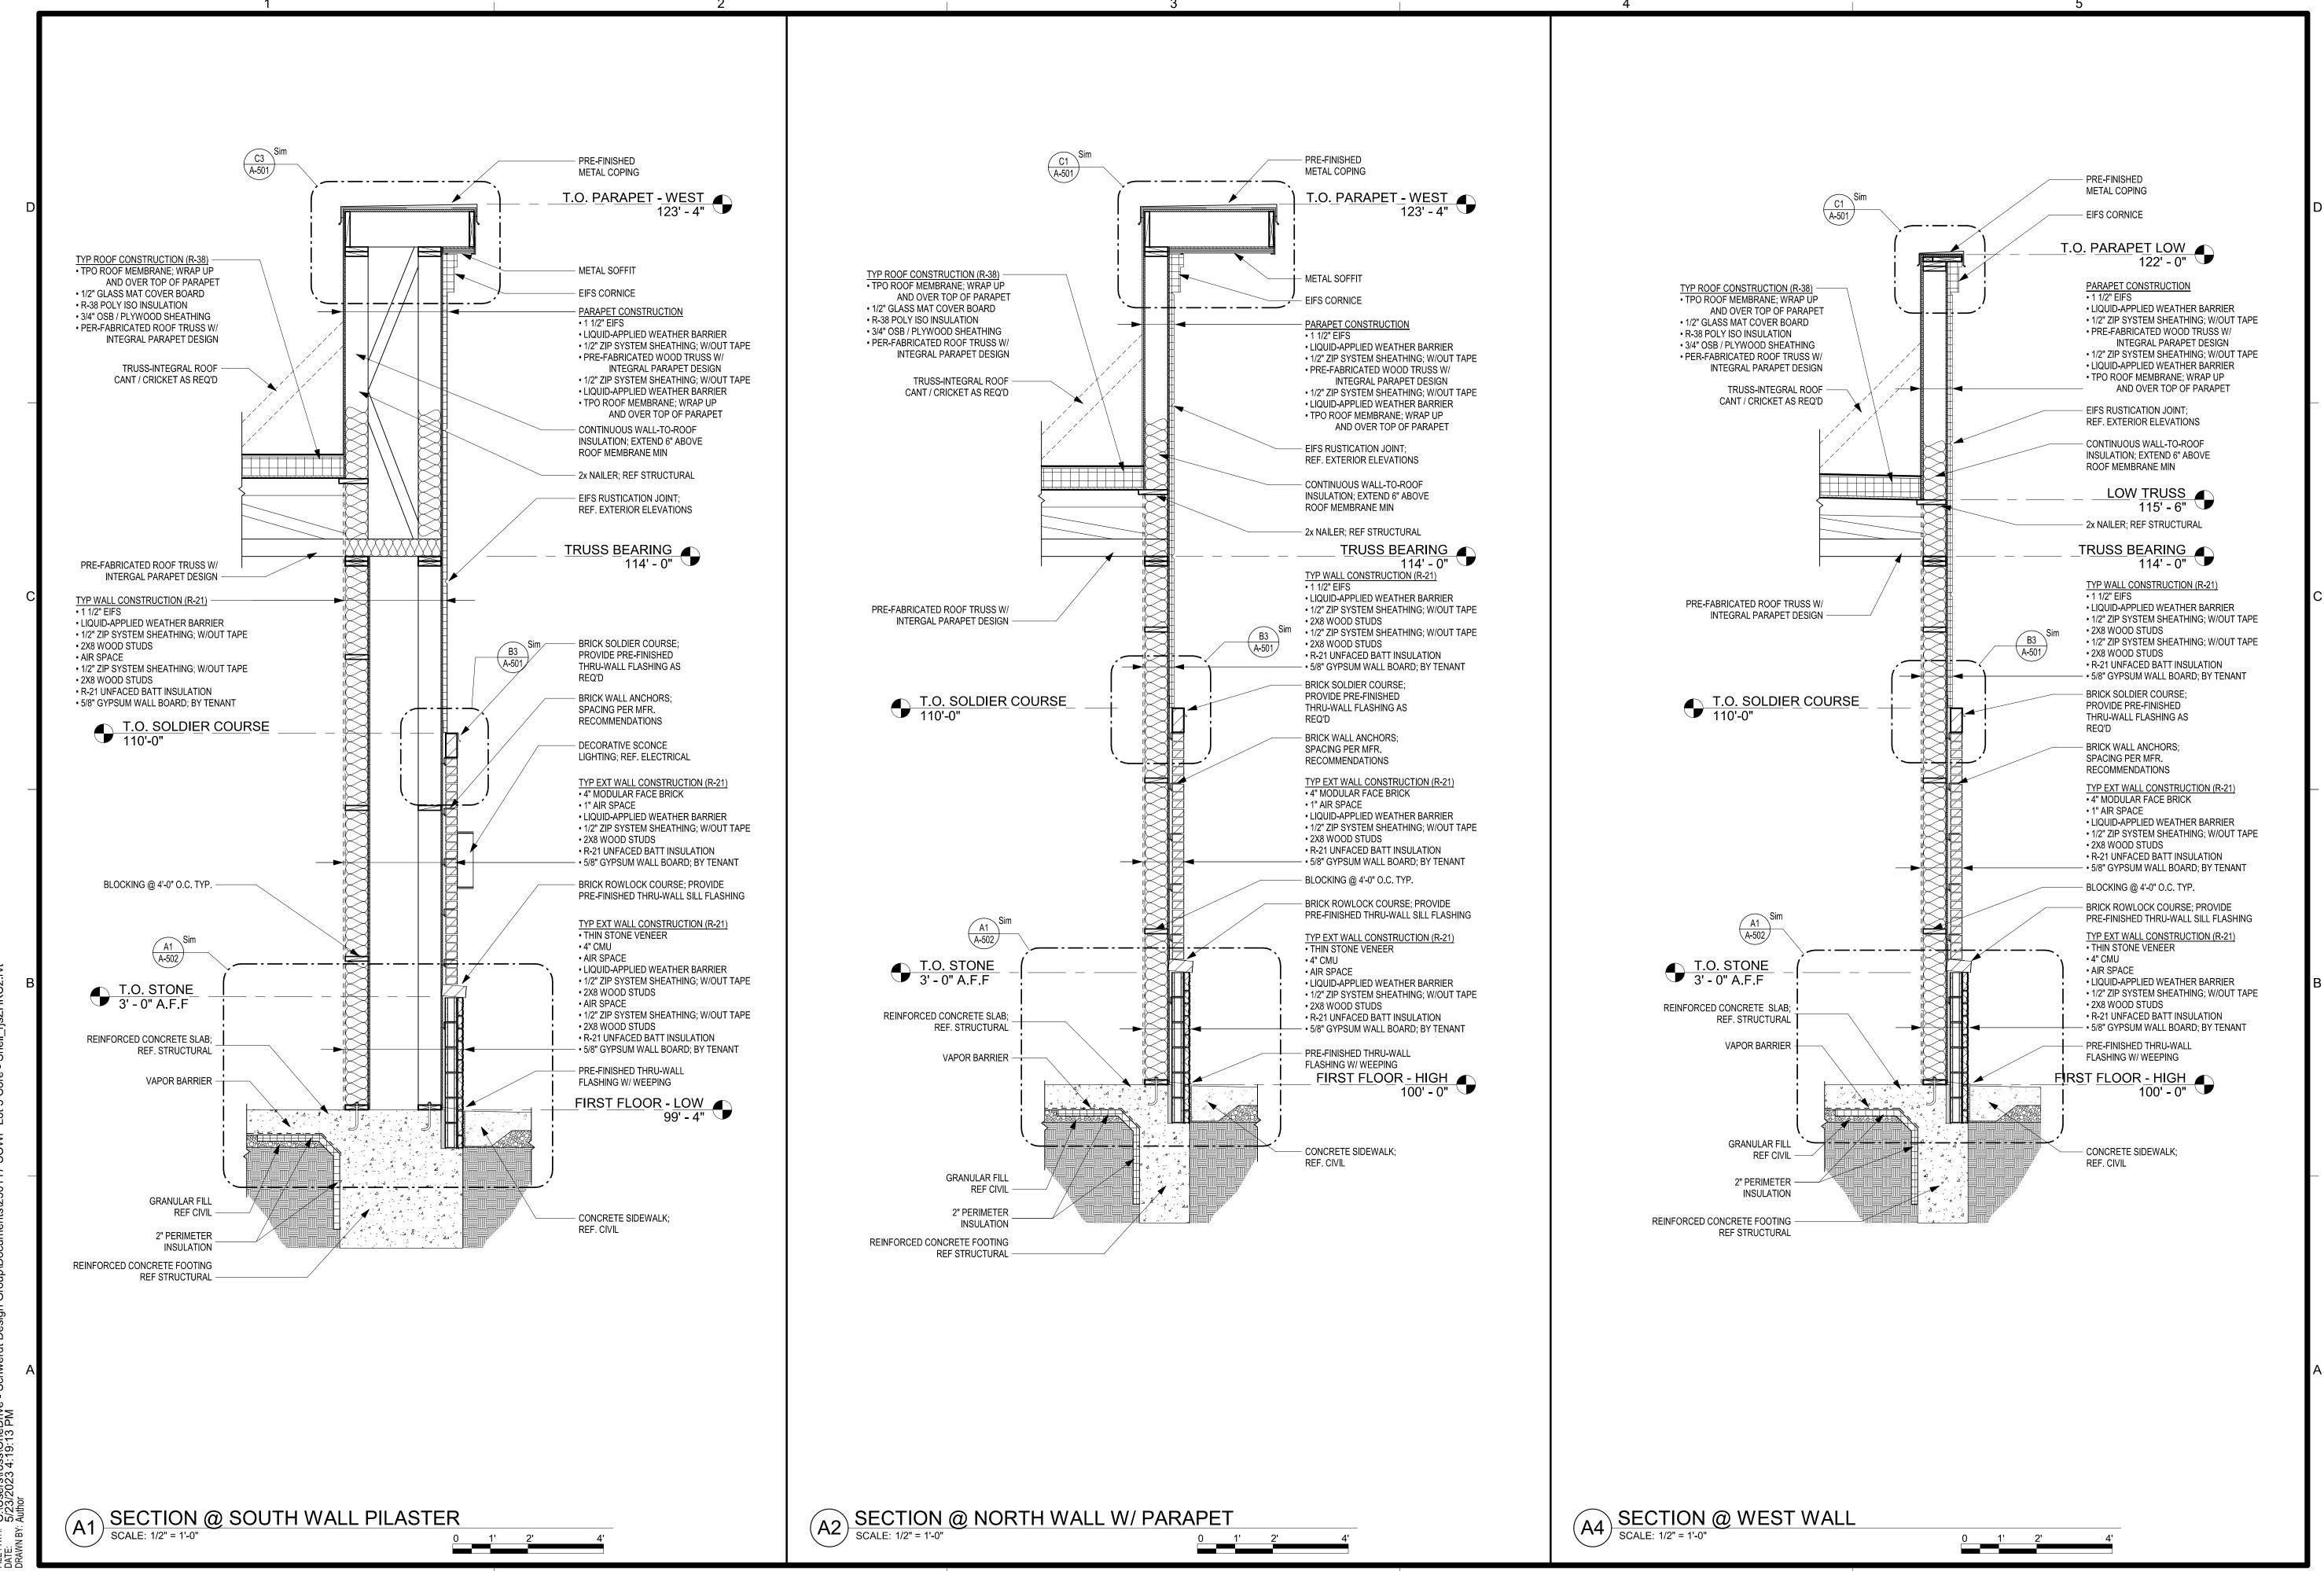

architecture | interiors | plannir 2231 sw wanamaker rd suite 30 topeka, kansas 66614-4275 phone: 785.273.7540 fax: 785.273.7579

500 north broadway oklahoma city, ok 73102 phone: 405.231.3105 fax: 405.231.3115

23 NAY ROLS MICHAEL K HAMPTON #MO# A-2008027042

MO CERTIFICATE OF AUTH. #F0035387


5 O 

<u>S</u> DIN ES ωщ O S 00 R 0


PROGRESS PRINT ONLY

WALL SECTIONS

230117

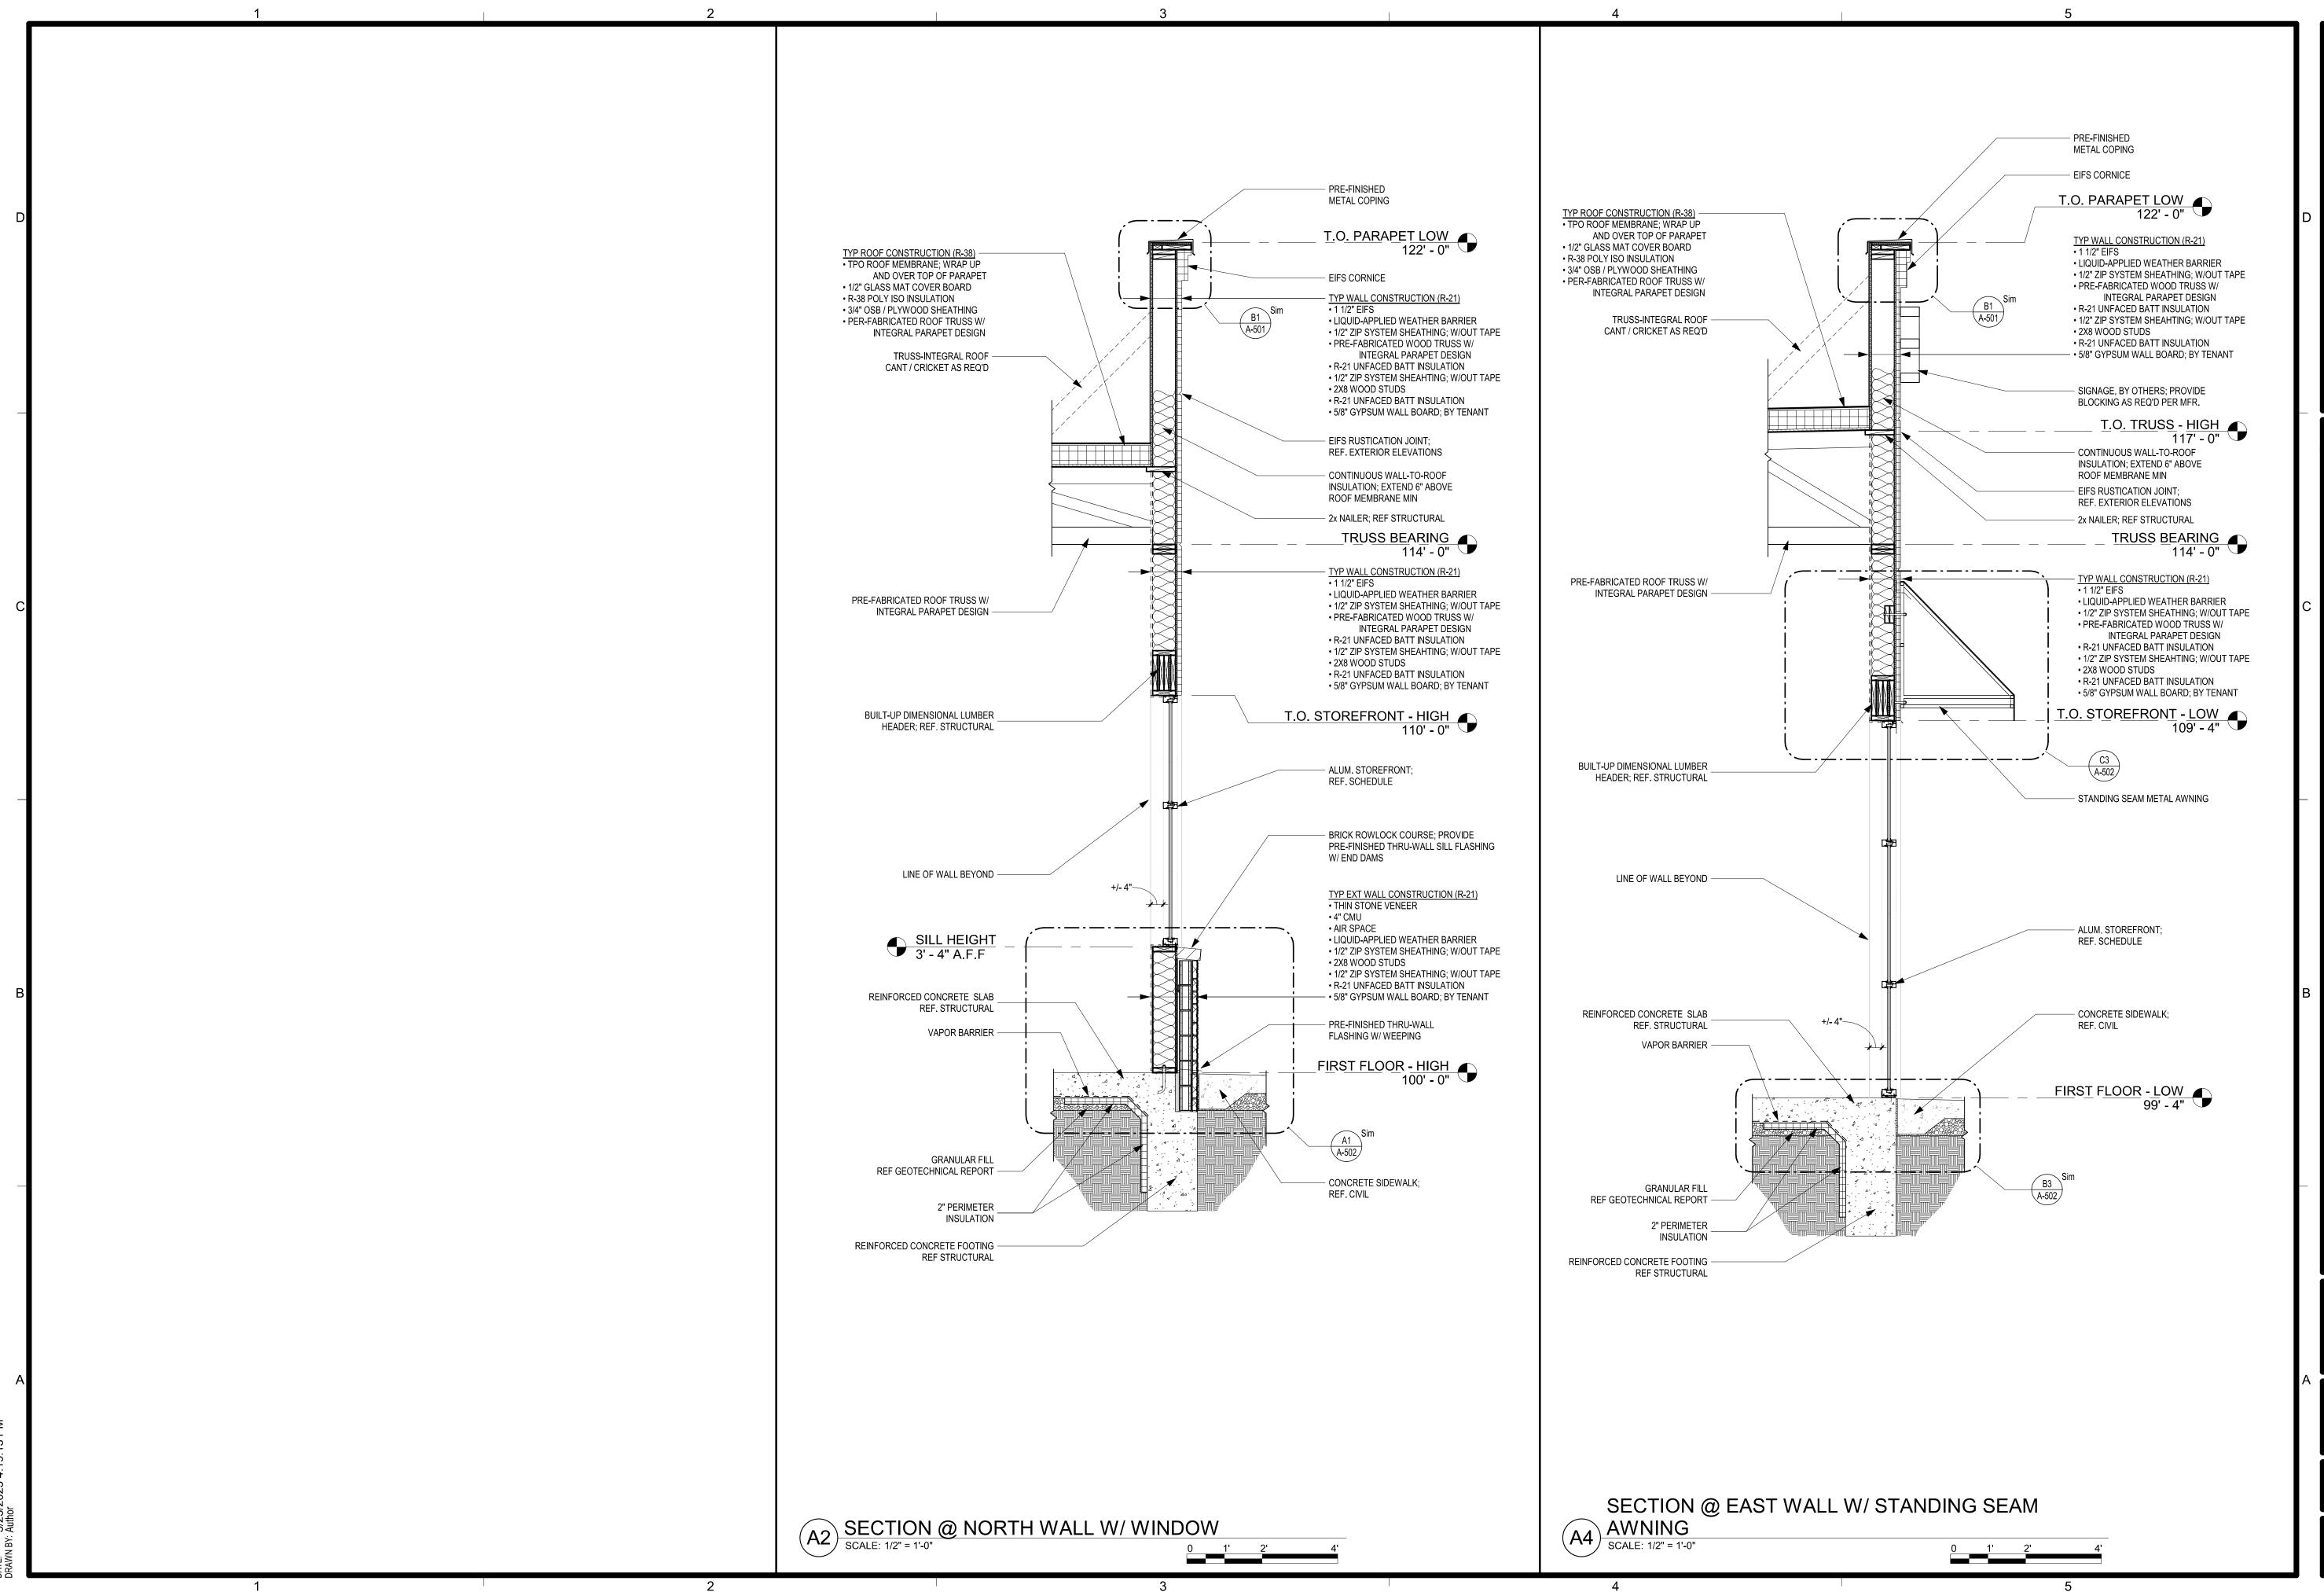

architecture | interiors | plannin 2231 sw wanamaker rd suite 303 topeka, kansas 66614-4275 phone: 785.273.7540 fax: 785.273.7579 500 north broadway oklahoma city, ok 73102 phone: 405.231.3105 fax: 405.231.3115 suite 20




MO CERTIFICATE OF AUTH. #F00353876

5 O PR OUR DIN ES шш OS ORE


PROGRESS PRINT ONLY

WALL SECTIONS

230117

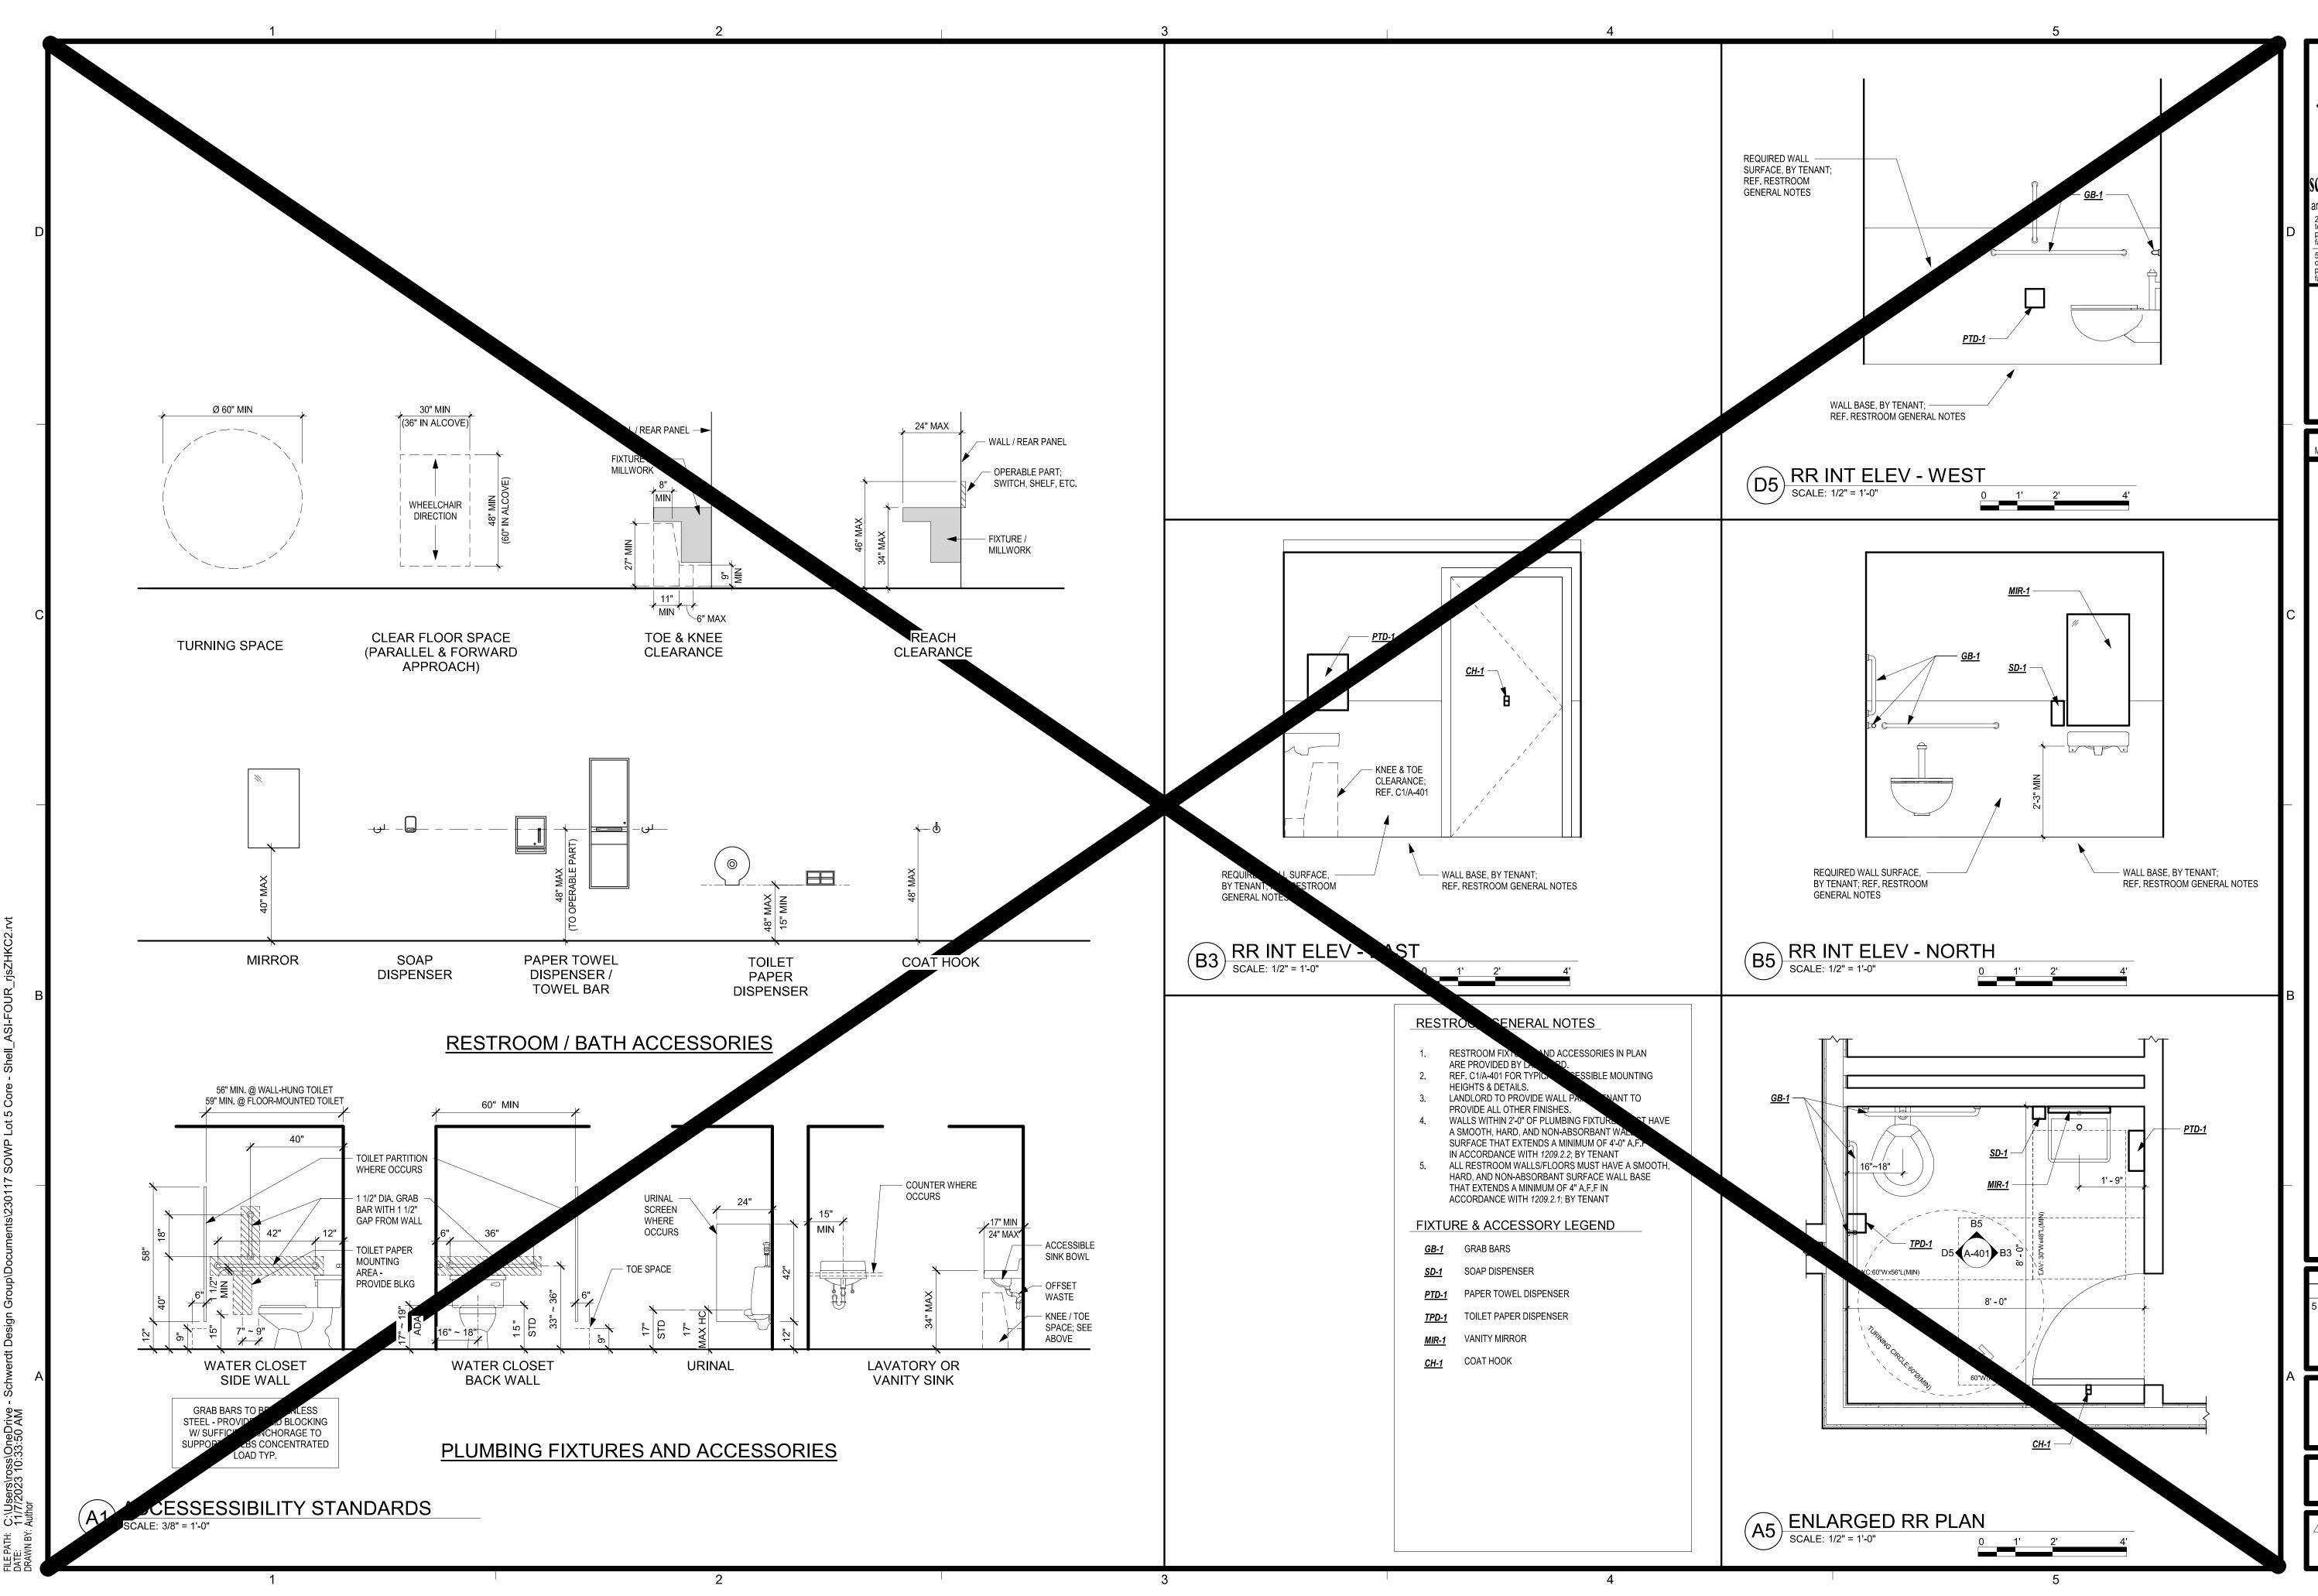

schwerdt design group architecture interiors planning
2231 sw wanamaker rd suite 303
topeka, kansas 66614-4275
phone: 785.273.7540
fax: 785.273.7579



MICHAEL K HAMPTON

#MO# A-2008027042


MO CERTIFICATE OF AUTH. #F00353876

UILDING WEST ШШ So ORE

SUBMISSION DATES PROGRESS PRINT ONLY ASI-4 11-07-2023


**ENLARGED RESTROOM** PLAN

230117

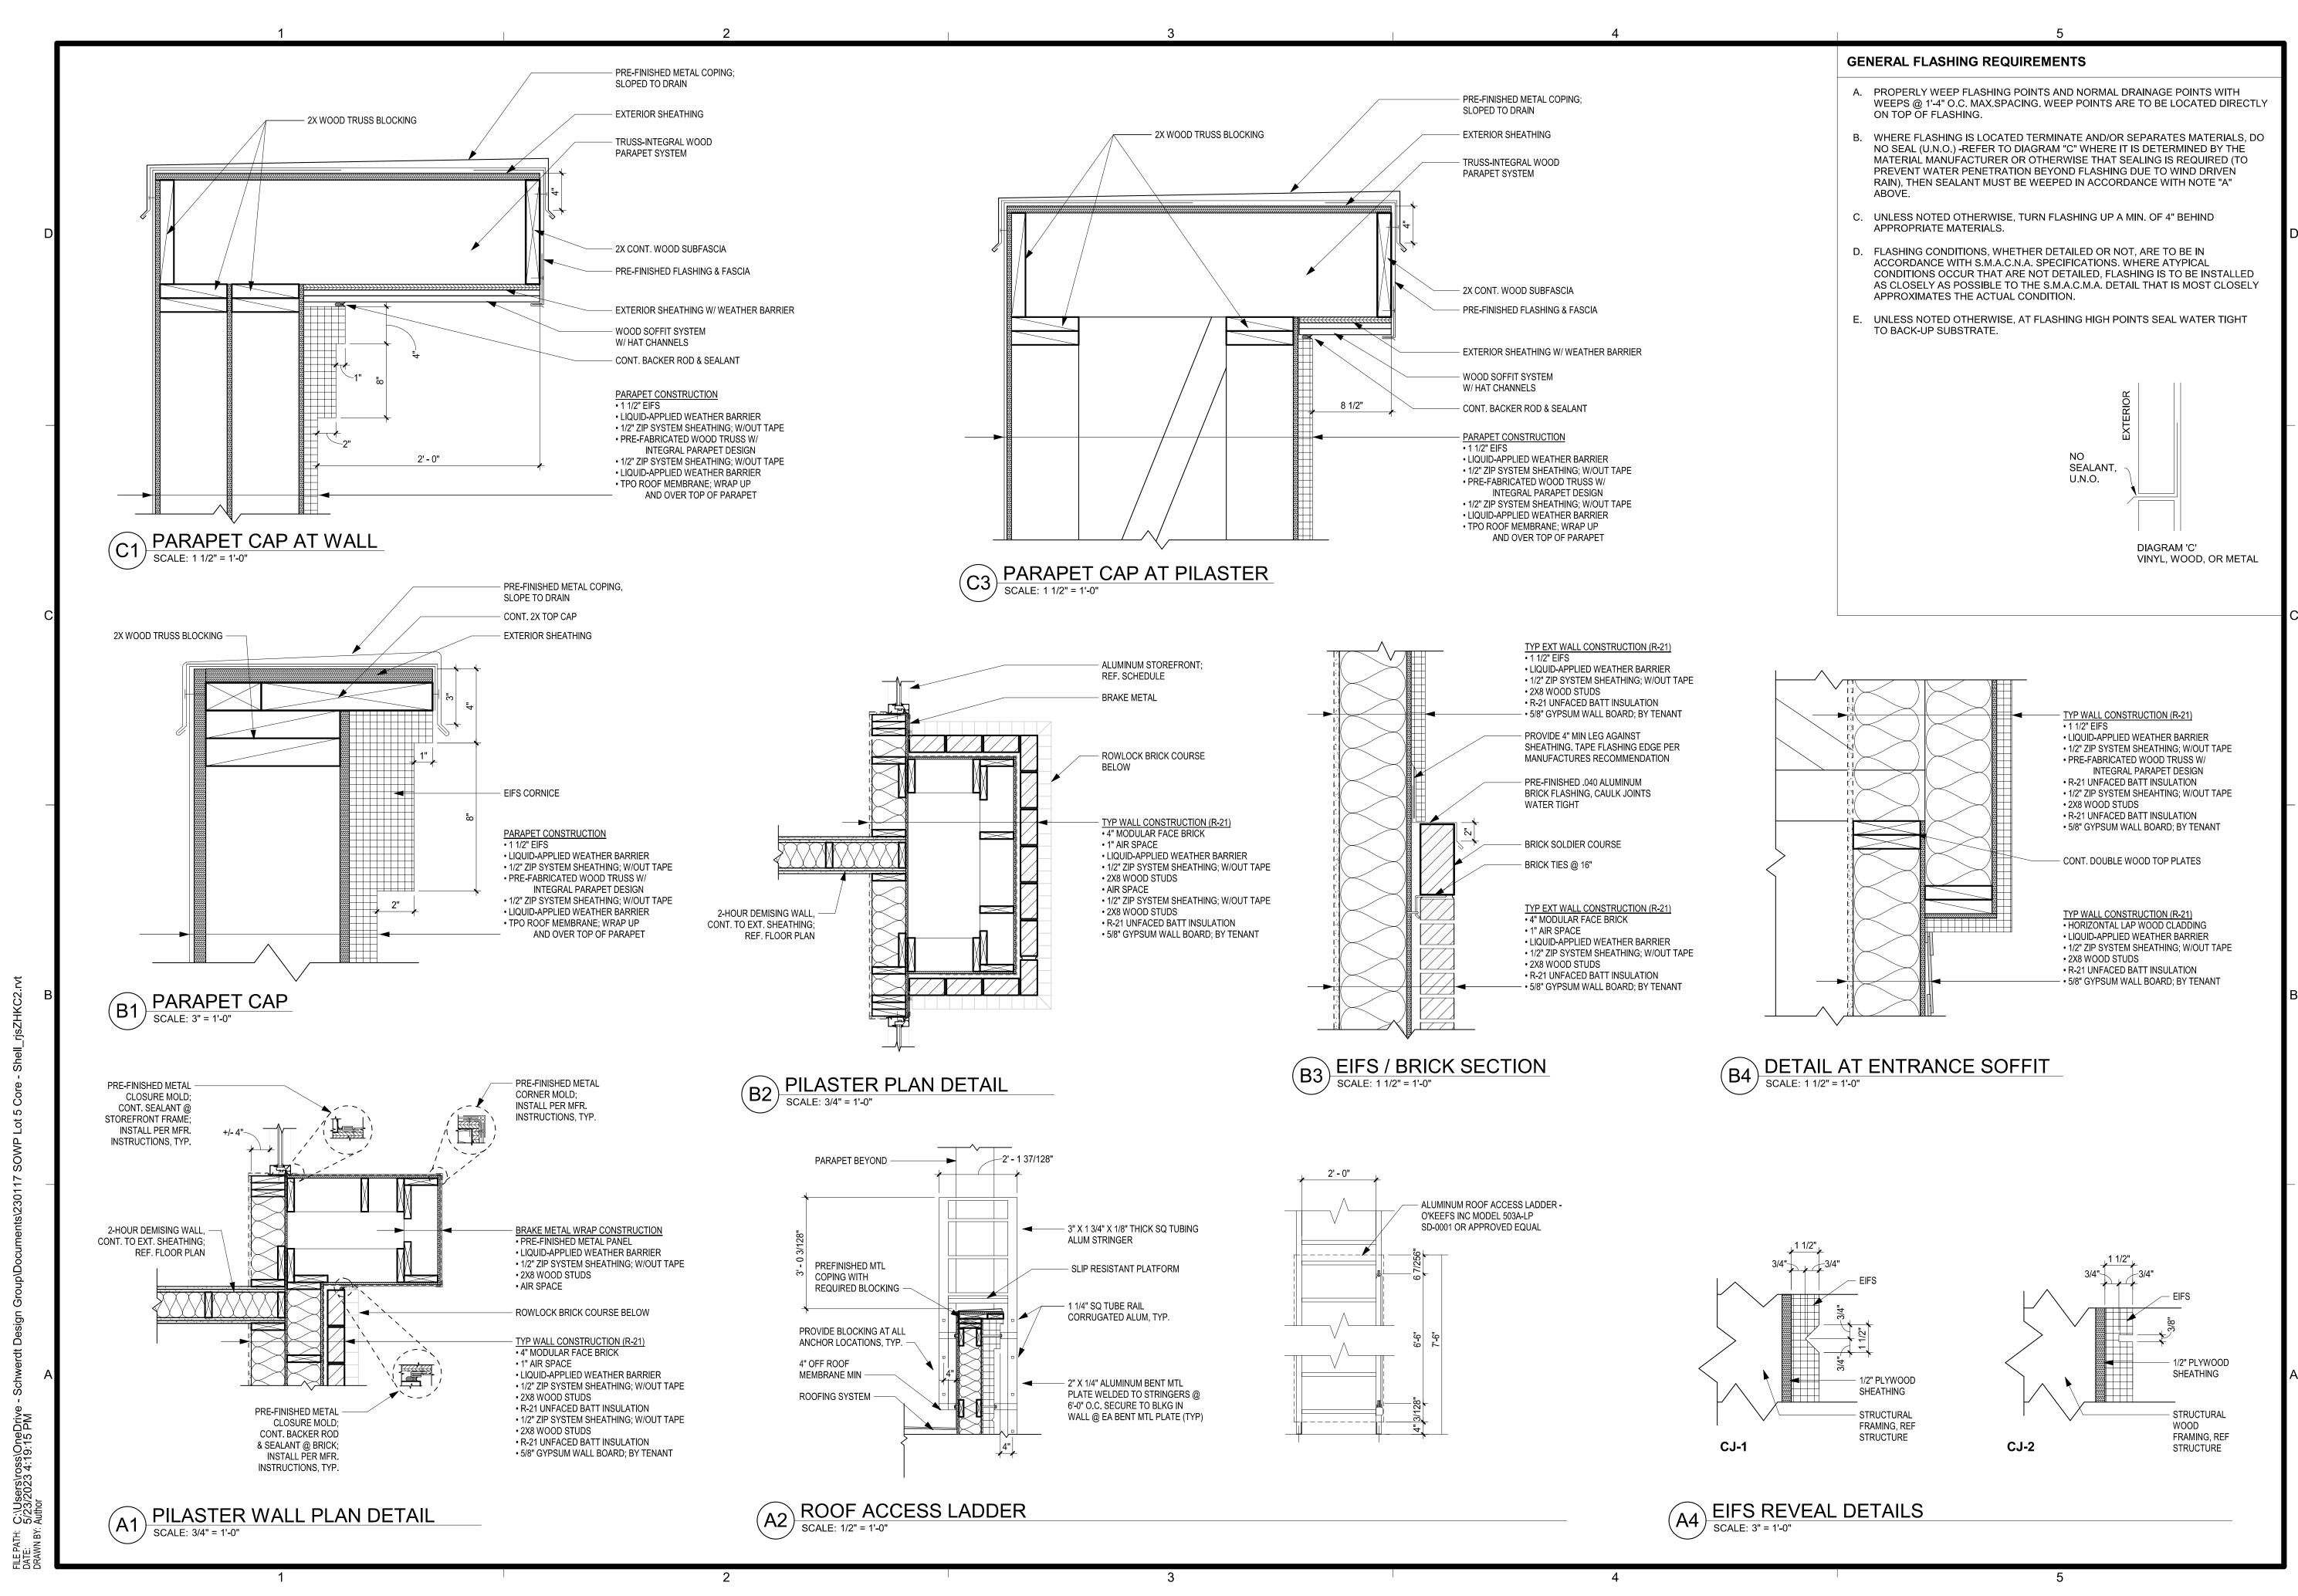



schwerdt design group architecture | interiors | planning 2231 sw wanamaker rd topeka, kansas 66614-4275 phone: 785.273.7540 fax: 785.273.7579 500 north broadway suite 200



SCHWERDT DESIGN GROUP INC MO CERTIFICATE OF AUTH. #F00353876

SHELL BUILDING

T. SOF WEST PRYOR LOT 5

IIT, JACKSON COUNTY, MISSOURI 64081

BMISSION DATES OGRESS PRINT ONLY


PROGRESS PRINT ONLY

ර

ORE

SHEET TITLE BUILDING DETAILS

PROJECT NUMBER 230117

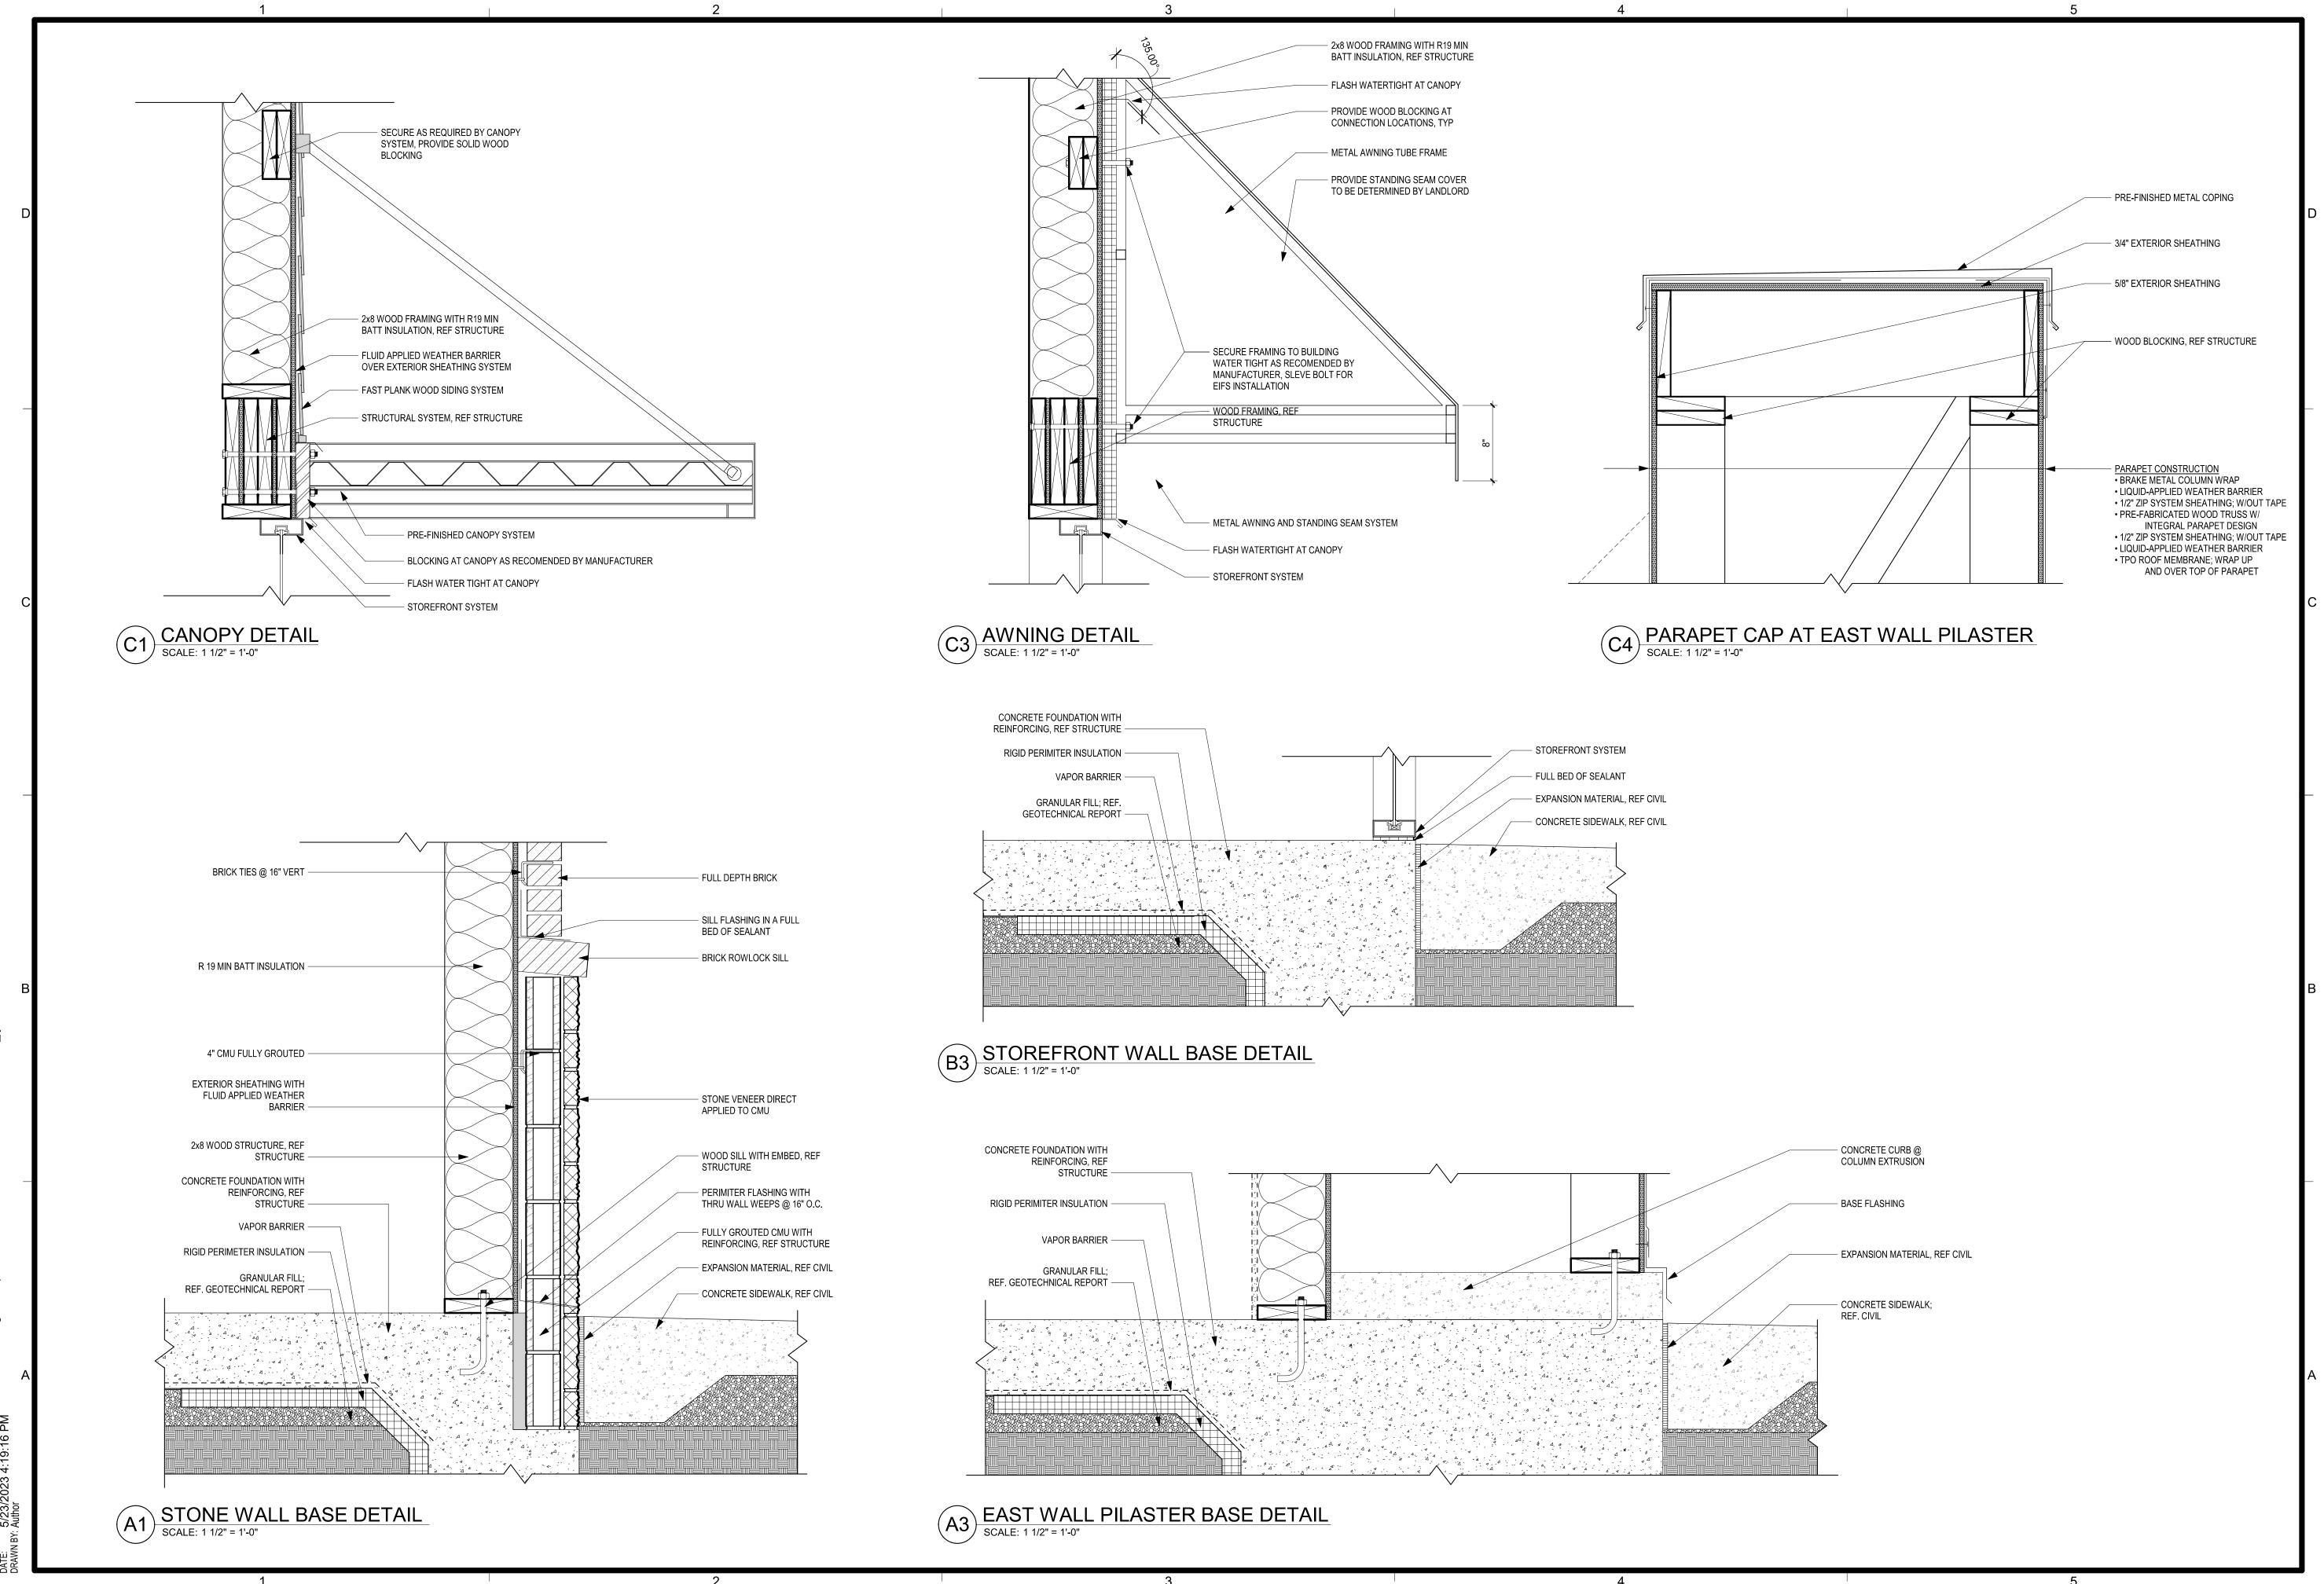

architecture | interiors | plannin 2231 sw wanamaker rd suite 303 topeka, kansas 66614-4275 phone: 785.273.7540 fax: 785.273.7579

500 north broadway oklahoma city, ok 73102 phone: 405.231.3105 fax: 405.231.3115 MICHAEL K HAMPTON

#MO# A-2008027042

MO CERTIFICATE OF AUTH. #F00353876


S PR DIN ES шш

8


PROGRESS PRINT ONLY

**BUILDING DETAILS** 

230117

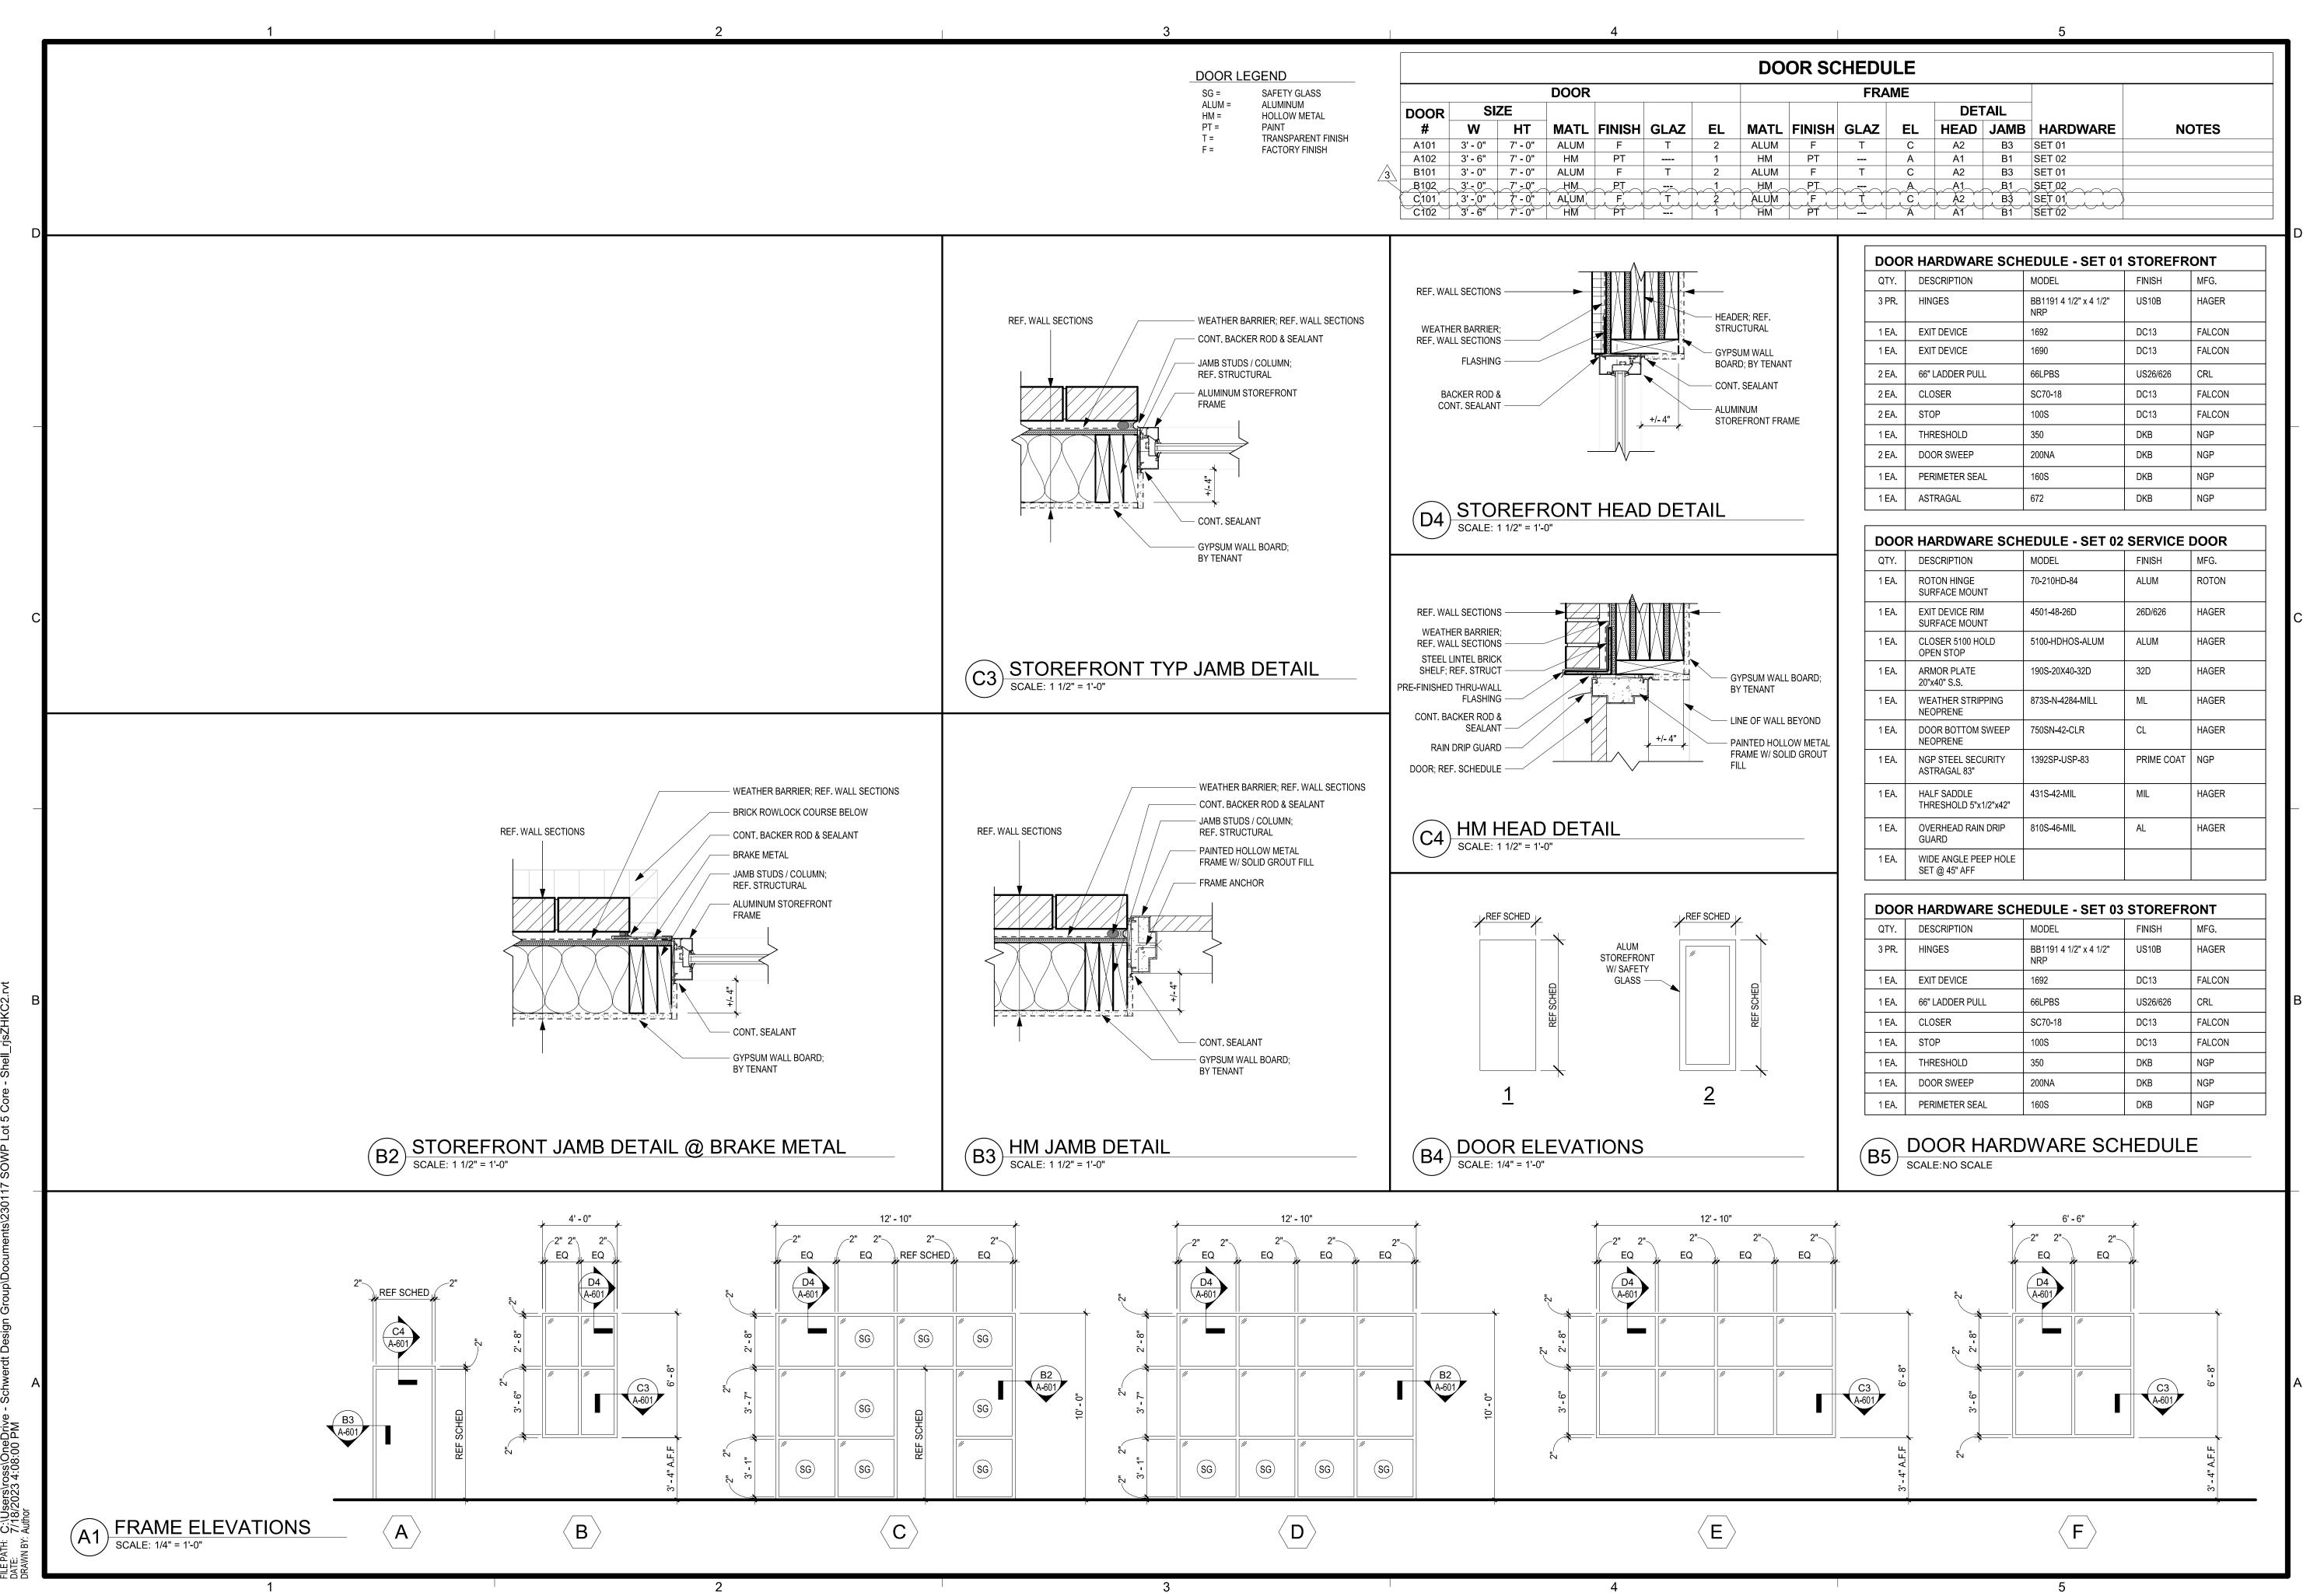

schwerdt design grou architecture | interiors | plannir 2231 sw wanamaker rd suite 303 topeka, kansas 66614-4275 phone: 785.273.7540 fax: 785.273.7579 500 north broadway oklahoma city, ok 73102 phone: 405.231.3105 fax: 405.231.3115



MO CERTIFICATE OF AUTH. #F00353876

0 PR BUILDING

F WEST PR

OR, LEES SUMMIT, JA CORE & SHELL I STREETS OF 2070 NW LOWENSTEIN D O

PROGRESS PRINT ONLY ASI-2 07-07-2023

DOOR / FRAME SCHEDULE & DETAILS

230117

VERIFY ALL DIMENSIONS SHOWN WITH ARCHITECTURAL DRAWINGS AND EXISTING CONDITIONS PRIOR TO CONSTRUCTION. DISCREPANCIES SHALL BE RESOLVED BEFORE PROCEEDING WITH CONSTRUCTION. CONTRACTOR SHALL COORDINATE THE WORK OF ALL TRADES AND MAKE NECESSARY INVESTIGATIONS AND FIELD MEASUREMENTS. INFORM ENGINEER OF ALL DISCREPANCIES.

THE CONTRACTOR SHALL VERIFY THE SIZE AND LOCATIONS OF PENETRATIONS AND EMBEDDED ITEMS THROUGH THE STRUCTURE FOR ALL TRADES. PENETRATIONS SHALL BE SUBJECT TO APPROVAL BY THE ARCHITECT AND STRUCTURAL ENGINEER.

SEE MECHANICAL, ELECTRICAL, ARCHITECTURAL DRAWINGS FOR ANCHORS, PIPE SLEEVES, CONDUITS OR OTHER ITEMS TO BE EMBEDDED IN OR PASS THROUGH CONCRETE. IN GENERAL, EMBEDMENTS AND PENETRATIONS LESS THAN 12 INCHES IN DIAMETER ARE NOT SHOWN ON THE STRUCTURAL DRAWINGS.

SEE ARCHITECTURAL DRAWINGS FOR DOOR HEIGHTS AND WALL OPENING DIMENSIONS.

STRUCTURAL ELEMENTS ARE NON-SELF SUPPORTING AND REQUIRE INTERACTION WITH OTHER ELEMENTS FOR STABILITY. FRAMING AND WALLS SHALL BE TEMPORARILY BRACED BY THE CONTRACTOR UNTIL PERMANENT BRACING, FLOOR AND ROOF DECKS AND WALLS HAVE BEEN INSTALLED AND CONNECTIONS BETWEEN THESE ELEMENTS HAVE BEEN MADE.

SUPPORT OF ALL NON-STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR. NON-STRUCTURAL ELEMENTS ARE THOSE THAT DO NOT CONTRIBUTE TO THE DIRECT LOAD PATH OF BOTH THE GRAVITY AND LATERAL FORCE RESISTING SYSTEMS. THESE ELEMENTS INCLUDE, BUT ARE NOT LIMITED TO PARTITIONS, FINISHES, MILLWORK, MECHANICAL EQUIPMENT, DUCTWORK, PIPING, LIGHT FIXTURES, ELECTRICAL CONDUIT, STORAGE RACKS, ETC. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ENSURING THAT THESE ELEMENTS ARE ADEQUATELY CONNECTED TO THE STRUCTURE TO RESIST ALL APPLIED LOADS. NOTIFY THE STRUCTURAL ENGINEER OF RECORD IF UNUSUAL SUPPORT CONDITIONS EXIST.

WORK REQUIRING SPECIAL INSPECTIONS SHALL BE INSPECTED ACCORDING TO THE BUILDING CODE AND INCLUDES: CONCRETE, REINFORCING STEEL, STRUCTURAL WELDING, HIGH-STRENGTH BOLTING, AND MASONRY. RE: SPECIAL INSPECTION PROGRAM TABLE WHEN APPLICABLE.

**DESIGN CRITERIA**:

BUILDING CODE: 2018 INTERNATIONAL BUILDING CODE AS ADOPTED AND AMENDED BY THE CITY OF LEE'S SUMMIT, MISSOURI.

ROOF: 20 PSF

**SNOW LOADS:** GROUND SNOW LOAD, Pg: 20 PSF FLAT-ROOF SNOW LOAD, Pf: 20 PSF SNOW EXPOSURE FACTOR, Ce: 1.0 SNOW LOAD IMPORTANCE FACTOR, Is: 1.0

BASIC WIND SPEED: 115 MPH EXPOSURE CATEGORY: C BASIC INTERNAL PRESSURE COEFFICIENT, GCpi: ±0.18 BASIC COMPONENTS AND CLADDING PRESSURE (ADJUSTED TO COMPLY WITH **BUILDING CODE):** ±20 PSF @ INTERIOR ZONES ±25 PSF @ END ZONES

SEISMIC IMPORTANCE FACTOR, le: 1.0 SPECTRAL RESPONSE ACCELERATIONS: Ss: 0.1274

S1: 0.0612 SPECTRAL RESPONSE COEFFICIENTS: Sds: 0.102

Sd1: 0.069

SITE CLASS: C SEISMIC DESIGN CATEGORY: B BASIC SEISMIC-FORCE-RESISTING SYSTEM: LIGHT-FRAMED WALLS WITH WOOD STRUCTURAL PANELS & STEEL ORDINARY MOMENT FRAMES

DESIGN BASE SHEAR: Cs x W SEISMIC RESPONSE COEFFICIENTS, Cs: 0.0157 & 0.0291 RESPONSE MODIFICATION FACTOR, R: 6.5 & 3.5 ANALYSIS PROCEDURE: EQUIVALENT LATERAL FORCE

FOUNDATION AND EARTHWORK NOTES:

REFER TO THE GEOTECHNICAL EXPLORATION AND FOUNDATION RECOMMENDATIONS: WEST PRYOR VILLAGE, LEE'S SUMMIT, MISSOURI / COOK, FLATT, & STROBEL ENGINEERS PA, KASNAS CITY, KANSAS (CFS NO 19-5125) / JUNE 15, 2018

THE FOUNDATION BEARING MATERIAL SHALL BE INSPECTED AND APPROVED BY A GEOTECHNICAL ENGINEER BEFORE FOUNDATIONS ARE CONSTRUCTED.

AT STEPPED FOOTINGS, THE LOWER FOOTING SHALL BE PLACED FIRST.

FOUNDATIONS HAVE BEEN DESIGNED FOR A NET ALLOWABLE SOIL BEARING PRESSURE OF 2,500 PSF FOR CONTINUOUS FOOTINGS AND 3,000 PSF FOR ISOLATED SPREAD FOOTINGS. FOUNDATIONS SHALL BEAR DIRECTLY ON A 24-INCH THICK, GEOGRID REINFORCED AGGREGATE PAD (GRAP) DESIGNED AND CONSTRUCTED AS OUTLINED IN THE GEOTECHNICAL REPORT, SECTION 7.2.

WALL FOUNDATION SHALL BEAR AT MINIMUM OF 3'-0" BELOW ADJACENT FINISH GRADE, UNLESS OTHERWISE NOTED.

UNUSUAL CONDITIONS OR CHANGES TO THE FOUNDATIONS AS REQUIRED BY FIELD CONDITIONS SHALL BE REFERRED TO THE ENGINEER FOR APPROVAL.

REFER TO GEOTECHNICAL REPORT FOR SUBGRADE PREP REQUIREMENTS FOR SLAB-ON-GRADE CONSTRUCTION. PREPARED SUBGRADES EXCAVATED TO INSTALL UTILITIES BELOW FLOOR SLABS SHALL BE BACKFILLED AND COMPACTED AS SPECIFIED BY THE GEOTECHNICAL ENGINEER.

REFER TO GEOTECHNICAL REPORT FOR COMPACTION REQUIREMENTS.

MAINTAIN ALL EXCAVATIONS FREE OF WATER.

**CONCRETE NOTES:** 

CONCRETE SHALL HAVE THE FOLLOWING UNLESS OTHERWISE SPECIFIED (SELECT PROPORTIONS FOR CONCRETE IN ACCORDANCE WITH ACI 318):

	MAX WATER/ CEMENT RATIO	MINIMUM COMPRESSIVE STRENGTH AT 28 DAYS
INTERIOR SLAB ON GRADE	0.45	3,000 PSI
FOOTINGS	0.45	4,500 PSI
FOUNDATION WALLS	0.45	4,500 PSI
GRADE BEAMS	0.45	4,500 PSI
DRILLED PIERS	0.50	4,000 PSI
CONCRETE ON STEEL DECK	0.45	3,000 PSI

REINFORCING STEEL SHALL BE BILLET STEEL CONFORMING TO ASTM A615, GRADE 60.

WELDED WIRE FABRIC SHALL CONFORM TO ASTM A185.

CEMENT SHALL CONFORM TO ASTM C150, TYPE I OR II.

AGGREGATES SHALL CONFORM TO ASTM C33. COARSE AGGREGATE SHALL CONSIST OF 1" MAXIMUM AGGREGATE SIZE. COMBINED GRADATION SHALL HAVE A UNIFORM

5-20% RETAINED ON 3/4", 1/2", 3/8", NO. 4, NO. 8, NO. 16, NO. 30 AND NO. 50 SIEVES; LESS THAN 5% PASSING NO. 50 SIEVE.

MATERIALS AND ADMIXTURES SHALL NOT CONTAIN CALCIUM CHLORIDE.

ALL EXTERIOR AND CONCRETE EXPOSED TO FREEZE/THAW CYCLES SHALL BE AIR-ENTRAINED 6%(±) BY VOLUME. THIS INCLUDES BUT IS NOT LIMITED TO FOOTINGS, FOUNDATION WALLS AND GRADE BEAMS.

SLEEVES, OPENINGS, OR OTHER ATTACHMENTS NOT SHOWN ON DRAWINGS SHALL BE APPROVED BY THE ENGINEER PRIOR TO PLACING CONCRETE.

MINIMUM TENSION LAP SPLICE LENGTHS AND TENSION DEVELOPMENT LENGTHS SHALL BE AS SCHEDULED, UNLESS NOTED OTHERWISE ON THE DRAWINGS. WELDED WIRE FABRIC SHALL LAP ONE (1) FULL SQUARE PLUS TWO (2) INCHES.

MAINTAIN CONCRETE COVER AS SCHEDULED.

REINFORCING STEEL FABRICATION AND INSTALLATION SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF THE CRSI MANUAL OF STANDARD PRACTICE.

ALL REINFORCING AND EMBEDDED ANCHOR BOLTS SHALL BE ACCURATELY PLACED AND TIED PRIOR TO POURING CONCRETE. "STABBING" OF DOWELS OR ANCHOR BOLTS IS NOT ALLOWED.

CONSTRUCTION JOINTS IN WALLS AND ELEVATED FORMED SLABS SHALL BE KEYED (1 1/2" DEEP BY 1/3 MEMBER AREA) AND REINFORCING SHALL CONTINUE THROUGH JOINT OR BE TENSION LAP SPLICED. CONSTRUCTION JOINTS SHALL BE LOCATED BY THE CONTRACTOR TO LEAST IMPAIR THE STRUCTURE. JOINT LOCATIONS SHALL BE APPROVED BY THE ENGINEER.

EMBEDDED CONDUIT SHALL NOT BE LARGER IN OUTSIDE DIMENSION THAN 1/3 THE OVERALL THICKNESS OF SLAB, WALL OR BEAM IN WHICH THEY ARE EMBEDDED. THEY SHALL NOT BE SPACED CLOSER THAN 3 DIAMETERS OR WIDTHS ON CENTER.

CONDUIT LOCATED WITH CONCRETE SECTIONS SHALL COMPLY WITH ACI 318 REQUIREMENTS.

INTERIOR FLOOR SLABS SHALL COMPLY WITH ACI 117, SHALL MEET THE REQUIREMENTS OF A TYPE 5, SINGLE COURSE, HARD STEEL-TROWELED FINISH AS DESCRIBED IN AC1 302, AND SHALL ACHIEVE AN OVERALL FF25/FL20 TOLERANCE.

ADHESIVE ANCHORS IN CONCRETE OR FULLY GROUTED MASONRY SHALL BE ITW RAMSET/REDHEAD EPCON CERAMIC 6 SYSTEM, HILTI HY200, OR SIMPSON AT-XP. ADHESIVE ANCHORS FOR HOLLOW BLOCK AND OTHER MASONRY SHALL BE HILTI HY270 OR SIMPSON SET-XP.

STRUCTURAL STEEL ENCASED WITHIN CONCRETE SHALL COMPLY WITH AISC TOLERANCES.

**MASONRY NOTES:** 

CONSTRUCT MASONRY IN ACCORDANCE WITH THE IBC. MASONRY REQUIRES LEVEL 1 QUALITY ASSURANCE (RE: SPECS). ALL MASONRY SHALL BE LAID IN RUNNING (COMMON) BOND USING THE LOW-LIFT METHOD OF GROUTING. REFER ARCHITECTURAL PLAN FOR ALL BLOCK COURSING.

MASONRY DESIGN IS BASED ON A MINIMUM COMPRESSIVE STRENGTH (F'm) OF ASSEMBLY OF 1,500 PSI.

MASONRY UNITS SHALL MEET THE REQUIREMENTS OF ASTM C-90, GRADE N, WITH A NET AREA COMPRESSIVE STRENGTH OF 1,900 PSI.

MORTAR SHALL BE PREPARED IN ACCORDANCE WITH ASTM C-270. PROVIDE TYPE M

MORTAR AT ALL MASONRY BELOW GRADE AND TYPE S AT ALL OTHER MASONRY. GROUT SHALL BE PREPARED IN ACCORDANCE WITH ASTM C-476, WITH A MINIMUM

REINFORCING STEEL SHALL BE BILLET STEEL CONFORMING TO ASTM A615, GRADE 60.

LAP SPLICE BAR REINFORCEMENT FOR MASONRY PER LAP SCHEDULE AND JOINT REINFORCEMENT A MINIMUM OF 6 INCHES.

CONCRETE MASONRY UNITS BELOW GRADE SHALL BE SOLID GROUTED.

COMPRESSIVE STRENGTH OF 2,000 PSI AT 28 DAYS.

CELLS WITH REINFORCING SHALL BE SOLID GROUTED AND VIBRATED.

**STRUCTURAL STEEL NOTES:** 

STRUCTURAL STEEL SHALL CONFORM TO THE FOLLOWING, UNLESS OTHERWISE

WIDE FLANGE SHAPES (W, WT): ASTM A992 (Fy=50 KSI) OTHER ROLLED SHAPES (M, S, HP, C, L): ASTM A36 (Fy=36 KSI) STEEL PIPE: ASTM A53, GRADE B (Fy=35 KSI) SQUARE AND RECTANGULAR TUBE: ASTM A500, GRADE B (Fy=46 KSI) ANCHOR BOLTS: ASTM F1554, GRADE 36 HEADED ANCHOR STUDS: ASTM A108, GRADES 1010 TO 1020 PLATES AND BARS: ASTM A36 (Fy=36 KSI)

SHEAR CONNECTORS AND HEADED WELDED STUDS OF TYPE AND SIZE NOTED SHALL

STRUCTURAL STEEL SHALL BE FABRICATED AND ERECTED IN ACCORDANCE WITH GOOD STANDARD PRACTICE AND IS THE RESPONSIBILITY OF THE CONTRACTOR.

PROPER FIT IN THE FIELD OF STRUCTURAL STEEL SHALL BE IN ACCORDANCE WITH GOOD STANDARD PRACTICE AND IS THE RESPONSIBILITY OF THE CONTRACTOR.

THE FABRICATOR SHALL BE RESPONSIBLE FOR THE DESIGN AND PERFORMANCE OF ALL CONNECTIONS NOT FULLY DESIGNED OR DETAILED ON THE CONTRACT DOCUMENTS.

ANCHOR BOLTS SHALL BE ASTM F1554, A36 UNO. ANCHOR BOLTS SHALL BE SET WITH TEMPLATES WITH THE APPROPRIATE BOLT PROJECTION, 4" MINIMUM UNO. PROVIDE DOUBLE NUTS AND DOUBLE WASHERS FOR STEEL COLUMN ANCHOR BOLTS TO ALLOW FOR ADJUSTMENT IN BASE PLATE ELEVATION.

NON-SHRINK GROUT UNDER BASE PLATES SHALL BE NON-METALLIC WITH A MINIMUM COMPRESSIVE STRENGTH OF 5,000 PSI AT 28 DAYS.

HIGH STRENGTH BOLTED CONNECTIONS SHALL CONFORM TO THE AISC SPECIFICATIONS FOR STRUCTURAL JOINTS USING A325 BOLTS. UNLESS OTHERWISE NOTED, HIGH STRENGTH BOLTS MAY BE TIGHTENED BY ANY METHOD THEREIN. REGARDLESS OF THE METHOD USED IN TIGHTENING, A HARDENED WASHER SHALL BE USED UNDER THE TURNED ELEMENT. UNLESS OTHERWISE NOTED, BOLTED CONNECTIONS SHALL BE MADE WITH 3/4"Ø, ASTM A325 HIGH STRENGTH BOLTS.

CONNECTIONS REQUIRING FULL PRETENSIONING ARE SLIP-CRITICAL, AND INCLUDE BOLTED COLUMN SPLICES AND CONNECTIONS SUBJECT TO DIRECT TENSION.

ALL WELDING SHALL BE DONE IN ACCORDANCE WITH THE LATEST EDITION OF THE STRUCTURAL WELDING CODE, AWS D1.1. UNLESS NOTED OTHERWISE, MINIMUM WELD SIZE SHALL BE PER AISC 360, BUT SHALL BE NO LESS THAN 3/16" FILLET.

FIELD WELDING SHALL NOT BE STARTED UNTIL JOINT ELEMENTS ARE BOLTED IN INTIMATE CONTACT AND/OR ADJUSTED TO DIMENSIONS INDICATED WITH ALLOWANCE FOR EXPECTED WELD SHRINKAGE. MAINTAIN PLUMBNESS AND TRUENESS OF THE STRUCTURE.

FIELD WELDS FOR STRUCTURAL STEEL SHALL BE MADE WITH LOW HYDROGEN ELECTRODES. WELD FILLER METAL SHALL HAVE A MINIMUM TENSILE STRENGTH OF 70 **WOOD NOTES**:

GENERAL STRUCTURAL WOOD FRAMING SHALL MEET THE MINIMUM STRESS REQUIREMENTS FOR DOUGLAS-FIR #2 AND SHALL BEAR THE STAMP OF AN APPROVED TESTING AGENCY.

ROOF SHEATHING SHALL BE 5/8" (19/32" MIN) PLYWOOD WITH A SPAN RATING OF AT LEAST 32/16. PANELS SHALL BE NAILED WITH 10d NAILS AT 6" O.C. AT PANEL EDGES AND 12" O.C. AT INTERMEDIATE SUPPORTS. 1/8" GAP BETWEEN INDIVIDUAL SHEETS. PLYWOOD SHALL BE APA RATED C-D EXTERIOR AND SHALL BEAR THE STAMP OF AN APPROVED TESTING AGENCY.

ALL WOOD-TO-WOOD CONNECTIONS SHALL MEET THE MINIMUM NAILING REQUIREMENTS OF THE BUILDING CODE.

PROVIDE SIMPSON CONNECTION HARDWARE AS SHOWN ON THE DRAWINGS. SUBSTITUTIONS MUST BE APPROVED BY THE ARCHITECT AND STRUCTURAL ENGINEER PRIOR TO USE. INSTALL CONNECTION HARDWARE ACCORDING TO THE MANUFACTURER'S SPECIFICATIONS.

WALL SHEATHING SHALL BE 1/2" OSB ON THE EXTERIOR FACE OF ALL EXTERIOR WALLS. PANELS SHALL BE NAILED WITH 10d GALVANIZED NAILS AT 4" O.C. AT PANEL EDGES AND 12" O.C. AT INTERMEDIATE SUPPORTS. ALL PANEL EDGES SHALL BE BLOCKED.

INSTALL ALL ROOF PLYWOOD SHEATHING WITH THE LONG DIMENSION OF THE PANEL PERPENDICULAR TO THE SUPPORTS WITH A MINIMUM OF TWO SPANS FOR EACH PANEL. STAGGER ALL END JOINTS. PROVIDE 1/8" SPACE AT PANEL JOINTS FOR EXPANSION PER APA.

PREFABRICATED WOOD TRUSS NOTES:

SPECIAL INSPECTIONS OF THE FABRICATION PROCESS OF PRE-FABRICATED WOOD STRUCTURAL ELEMENTS AND ASSEMBLIES SHALL BE IN ACCORDANCE WITH THE IBC.

TRUSSES SHALL BE CONFIGURED TO FOLLOW FINAL ROOF LINES, UNLESS NOTED

BUILDING CODE. IN NO CASE SHALL THE DEAD LOAD BE LESS THAN 15 PSF ON THE TOP

TRUSSES SHALL BE DESIGNED FOR ALL LOAD COMBINATIONS REQUIRED BY THE

CHORD AND 10 PSF ON THE BOTTOM CHORD. TRUSS MANUFACTURER SHALL SUPPLY ALL TRUSS CONNECTIONS USING

PREFABRICATED STEEL CONNECTORS AS REQUIRED.

CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ALL TEMPORARY AND PERMANENT BRACING IN ADDITION TO ANY BRACING INDICATED ON THE PLANS.

ALL TEMPORARY AND PERMANENT BRACING FOR INDIVIDUAL TRUSS MEMBERS SHALL BE DESIGNED BY AND STAMPED BY A PROFESSIONAL ENGINEER PROVIDED BY CONTRACTOR AND/OR TRUSS MANUFACTURER. APPLIED ROOF SHEATHING AND OTHER ROOFING MATERIALS SHALL NOT BE ASSUMED TO PROVIDE SUFFICIENT BRACING FOR TRUSS CHORDS.

SHOP FABRICATED WOOD TRUSSES SHALL MEET DESIGN SPECIFICATIONS FOR METAL PLATE CONNECTED WOOD TRUSSES BY THE TRUSS PLATE INSTITUTE. PROVIDE PERMANENT AND TEMPORARY BRACING ACCORDING TO THE MANUFACTURER'S RECOMMENDATIONS.

COORDINATE ALL TRUSS DETAILS WITH ARCHITECTURAL PLANS.

SPLICE & DEVELOPMENT LENGTHS FOR REINFORCEMENT (UNLESS NOTED OTHERWISE ON THE DRAWINGS) fy = 60,000 psif'c = 3,000 psi

LENGTH OF LAPPED SPLICES | LENGTH OF END ANCHORAGE FOR FOR REINFORCEMENT DEVELOPMENT OF REINFORCEMENT HOOK BAR SIZE LENGTH SIZE **TOP BARS\*** OTHERS TOP BARS\* OTHERS HOOKED BARS 22 29 22 11 8 4 47 10 5 14 43 63 63 48 72 72 22 93 16 105 81 20 81 62 25 118 131 101 101 24 121 93 38 31 14

124

\*TOP BARS ARE HORIZONTAL BARS SO PLACED THAT MORE THAN 12" OF CONCRETE IS CAST IN THE MEMBER BELOW THE BAR. HORIZONTAL BARS IN WALLS ARE TO BE CONSIDERED AS TOP BARS. VERTICAL BARS MAY BE CONSIDERED AS OTHER BARS.

UNLESS EITHER OF THE FOLLOWING TWO CASES EXIST FOR STRAIGHT BARS, THE DEVELOPMENT OR SPLICE LENGTH FOR STRAIGHT BARS IN THE ABOVE TABLE MUST BE MULTIPLIED BY 1.5:

I. THE CLEAR SPACING OF BARS BEING DEVELOPED OR SPLICED IS GREATER THAN OR EQUAL TO ONE BAR DIAMETER. THE CLEAR COVER IS GREATER THAN OR EQUAL TO ONE BAR DIAMETER, AND STIRRUPS OR TIES PROVIDED THROUGHOUT THE DEVELOPMENT OR SPLICE LENGTH MEET OR EXCEED THE CODE MINIMUM.

II.THE CLEAR SPACING OF BARS BEING DEVELOPED OR SPLICED IS GREATER THAN OR EQUAL TO TWO BAR DIAMETERS AND THE CLEAR COVER IS GREATER THAN OR EQUAL TO ONE BAR DIAMETER.

THE DEVELOPMENT LENGTH FOR HOOKED BARS, SIZE 11 AND SMALLER, PLACED WITH SIDE COVER GREATER THAN OR EQUAL TO 2 1/2" AND COVER ON THE BAR EXTENSION BEYOND THE HOOD (90°

HOOK ONLY) GREATER THAN OR EQUAL TO 2", MAY BE MULTIPLIED BY 0.7.

VALUES IN THE ABOVE TABLE ARE NOT TO BE USED FOR EPOXY COATED REINFORCING AND/OR REINFORCING PLACED IN CONCRETE CONTAINING LIGHTWEIGHT AGGREGATE.

CONCRETE COVER FOR REINFORCEMENT

(UNLESS NOTED OTHERWISE ON THE D	PRAWINGS)
LOCATION	MINIMUM COVER
CONCRETE CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH	3"
CONCRETE EXPOSED TO EARTH OR WEATHER: #6 AND LARGER #5 AND SMALLER	2" 1 1/2"
CONCRETE NOT EXPOSED TO WEATHER OR IN CONTACT WITH THE GROUND: SLABS, WALLS, AND JOISTS: #14 AND LARGER #11 AND SMALLER BEAMS AND COLUMNS	1 1/2" 3/4" 1 1/2"

architecture | interiors | plannin 2231 sw wanamaker rd suite 303 topeka, kansas 66614-4275 phone: 785.273.7540 ax: 785.273.7579 500 north broadway oklahoma city, ok 73102 phone: 405.231.3105 suite 200



S  $\mathbf{\alpha}$ O m LL 

2023-05-23 ASI #2 07/07/2023


00

CERTUS = **GENERAL NOTES** STRUCTURAL ENGINEER

900 S. Kansas Avenue; Suite 400 Topeka, Kansas 66612 Phone: (785) 291-0400 Fax: (785) 291-0401 Proj #:01190008.120 **Certificate Of Authorization** 

Revit 2023 Local

230117

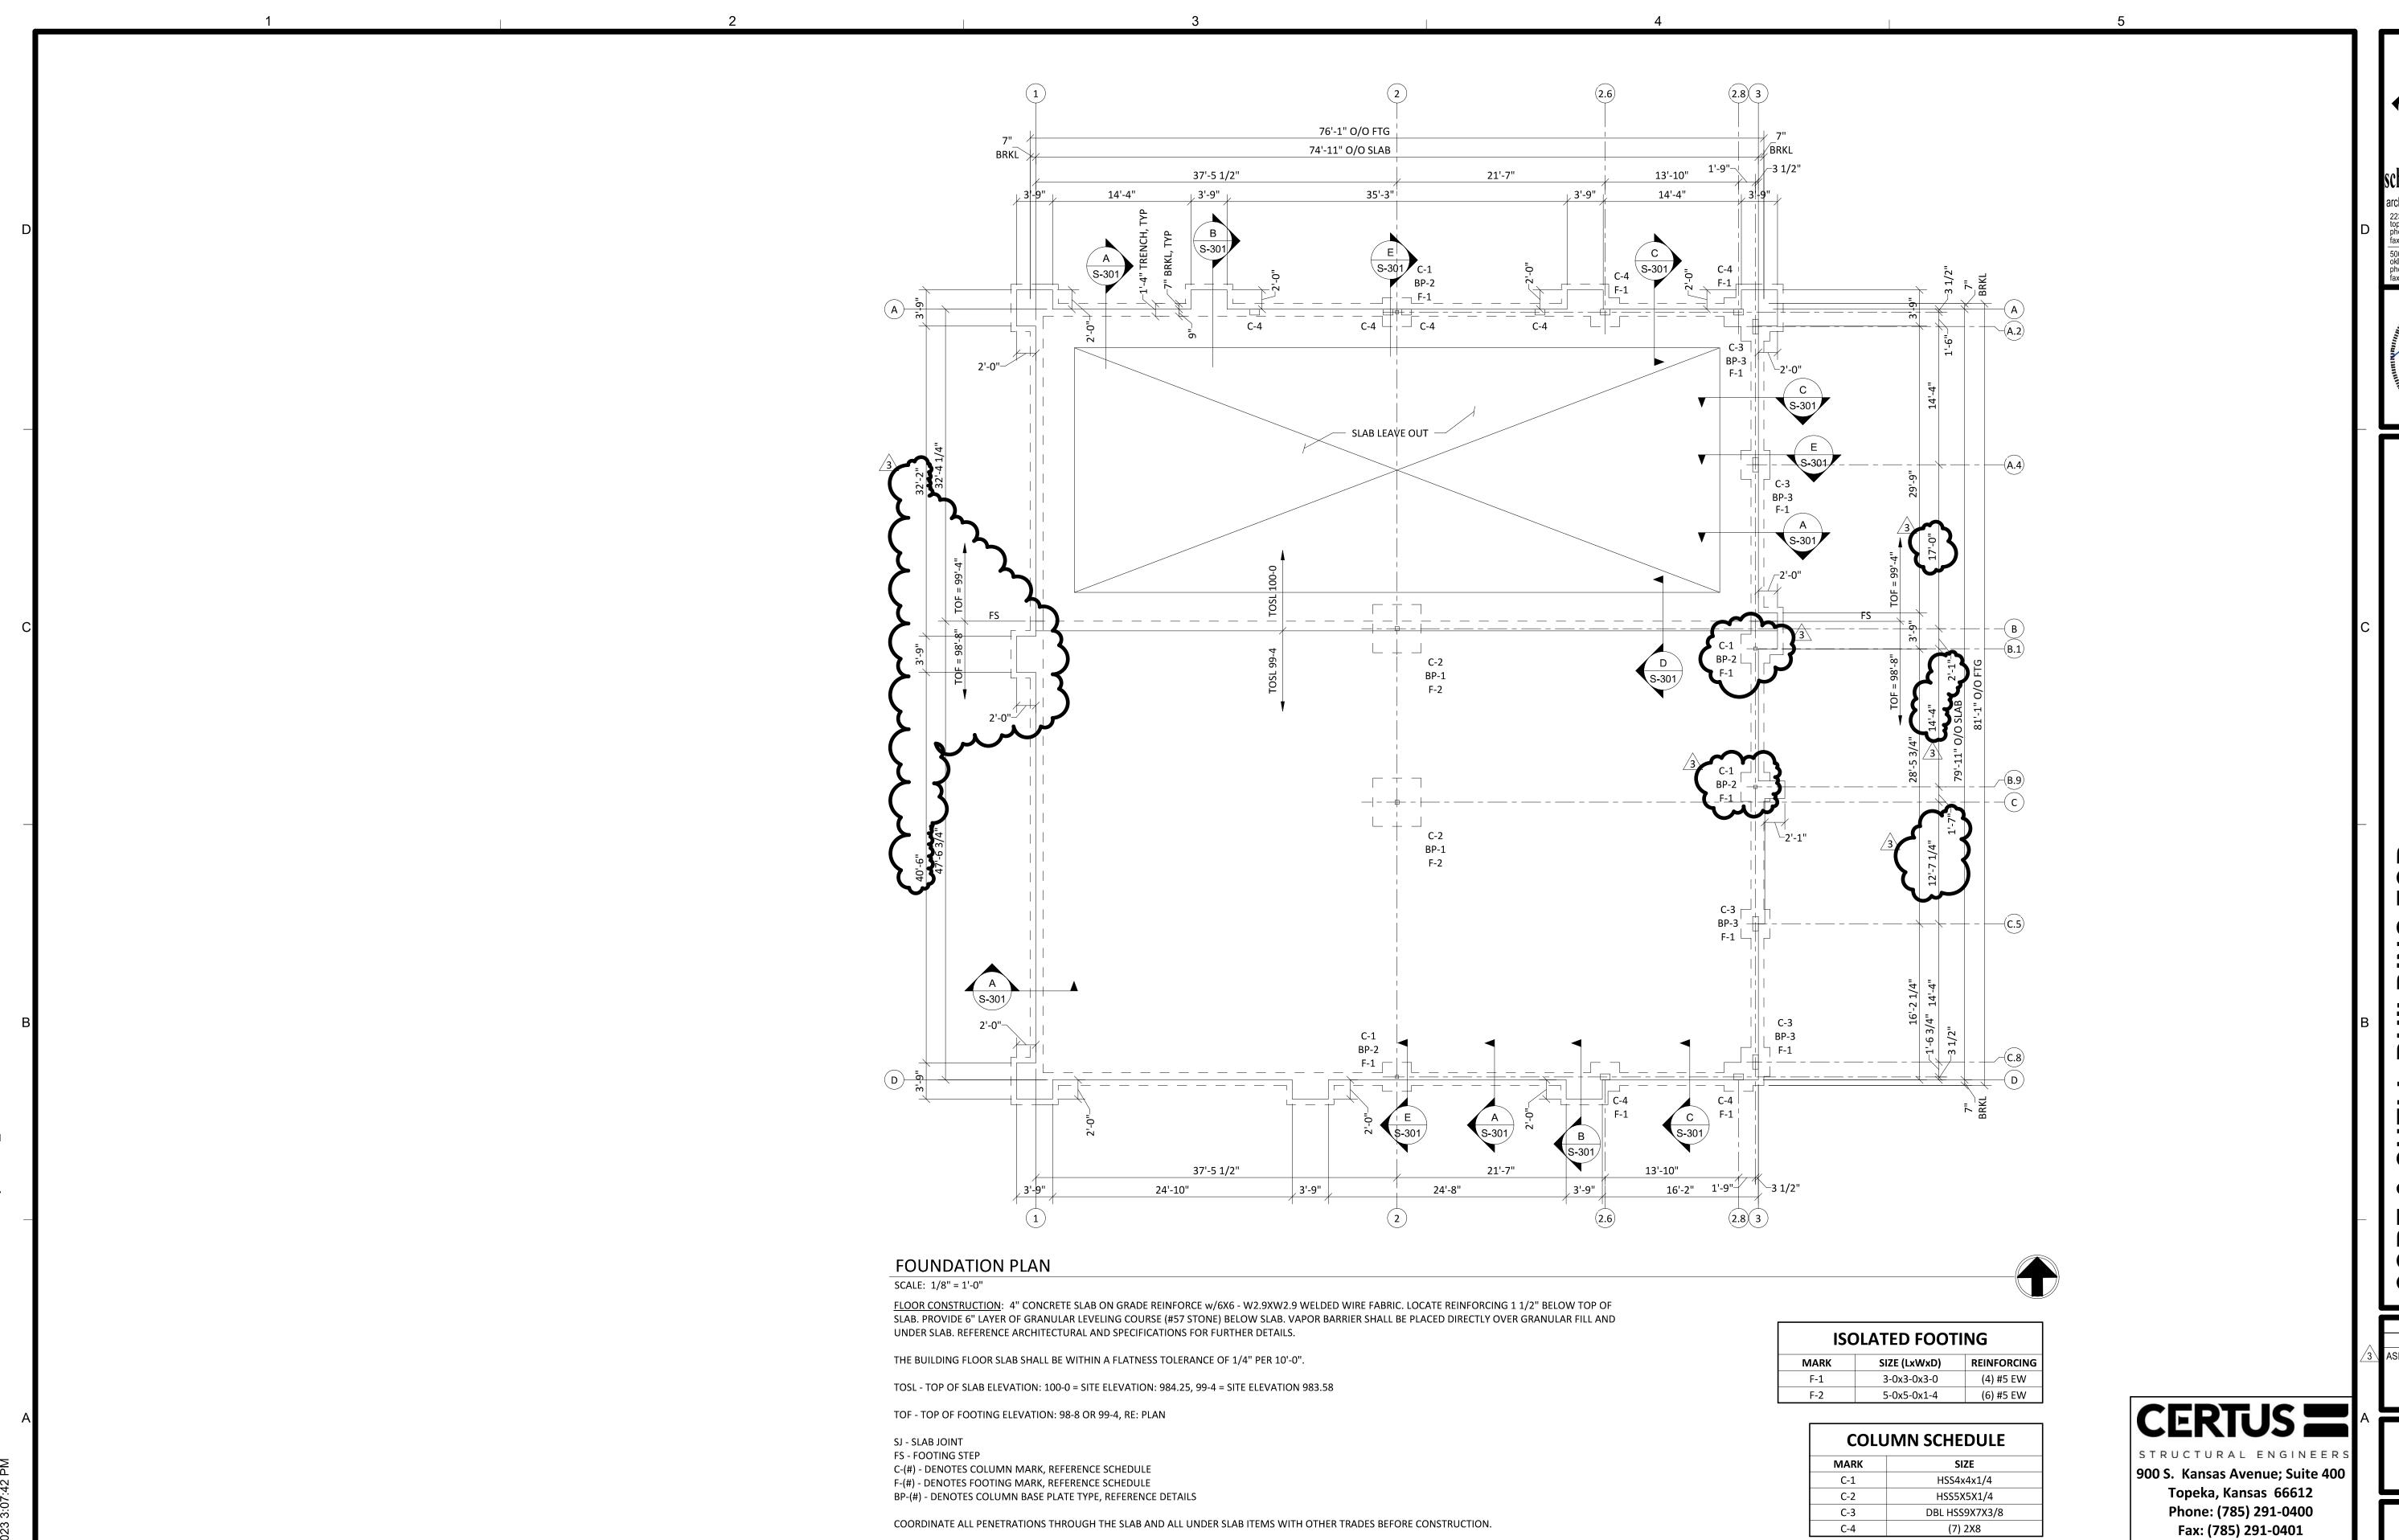

VERIFY ALL DIMENSIONS SHOWN WITH ARCHITECTURAL AND EXISTING CONDITIONS PRIOR TO CONSTRUCTION. INFORM ENGINEER OF ALL DISCREPANCIES.



5

R K **P** MES' L BO

2023-05-23

ASI #2 07/07/2023


FOUNDATION PLAN

230117

Proj #:01190008.120

**Certificate Of Authorization** 

Revit 2023 Local

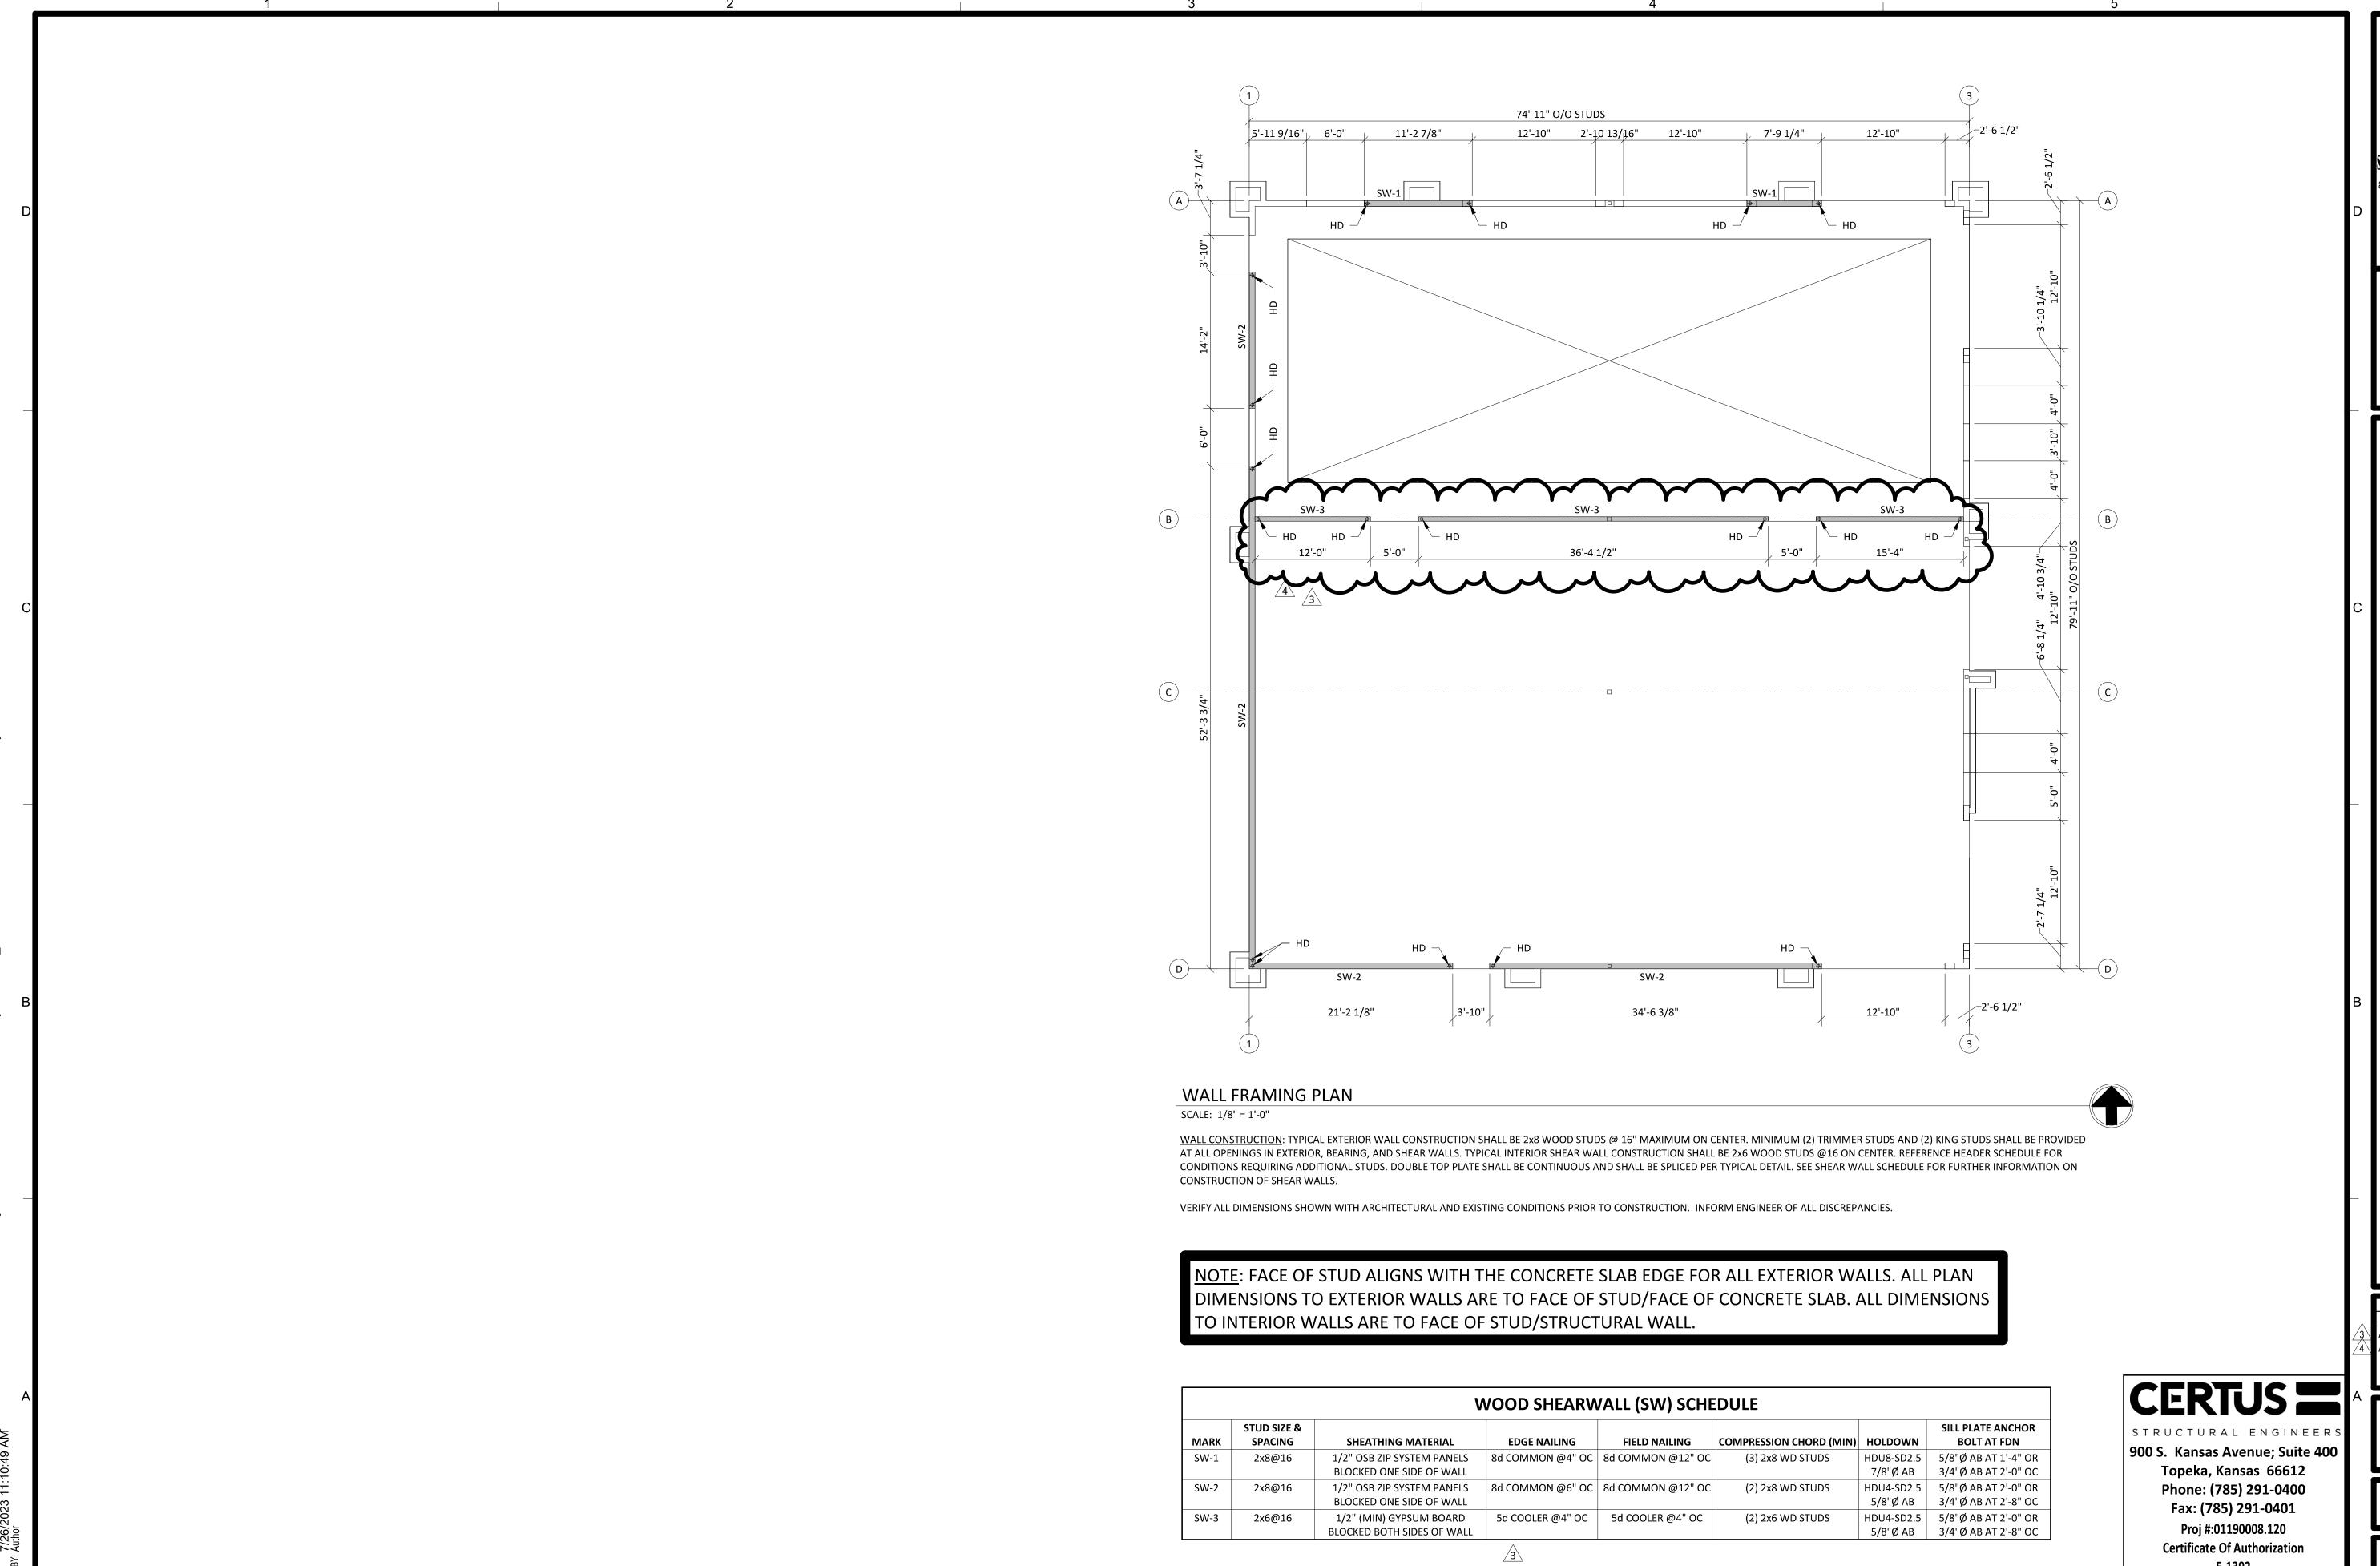





5

0

FOR PRY **P** 

JILDIN WES L BI

2023-05-23

0


ASI #2 07/07/2023 ASI #3 07/26/2023

WALL FRAMING PLAN

230117


SHEET NUMBER

Revit 2023 Local

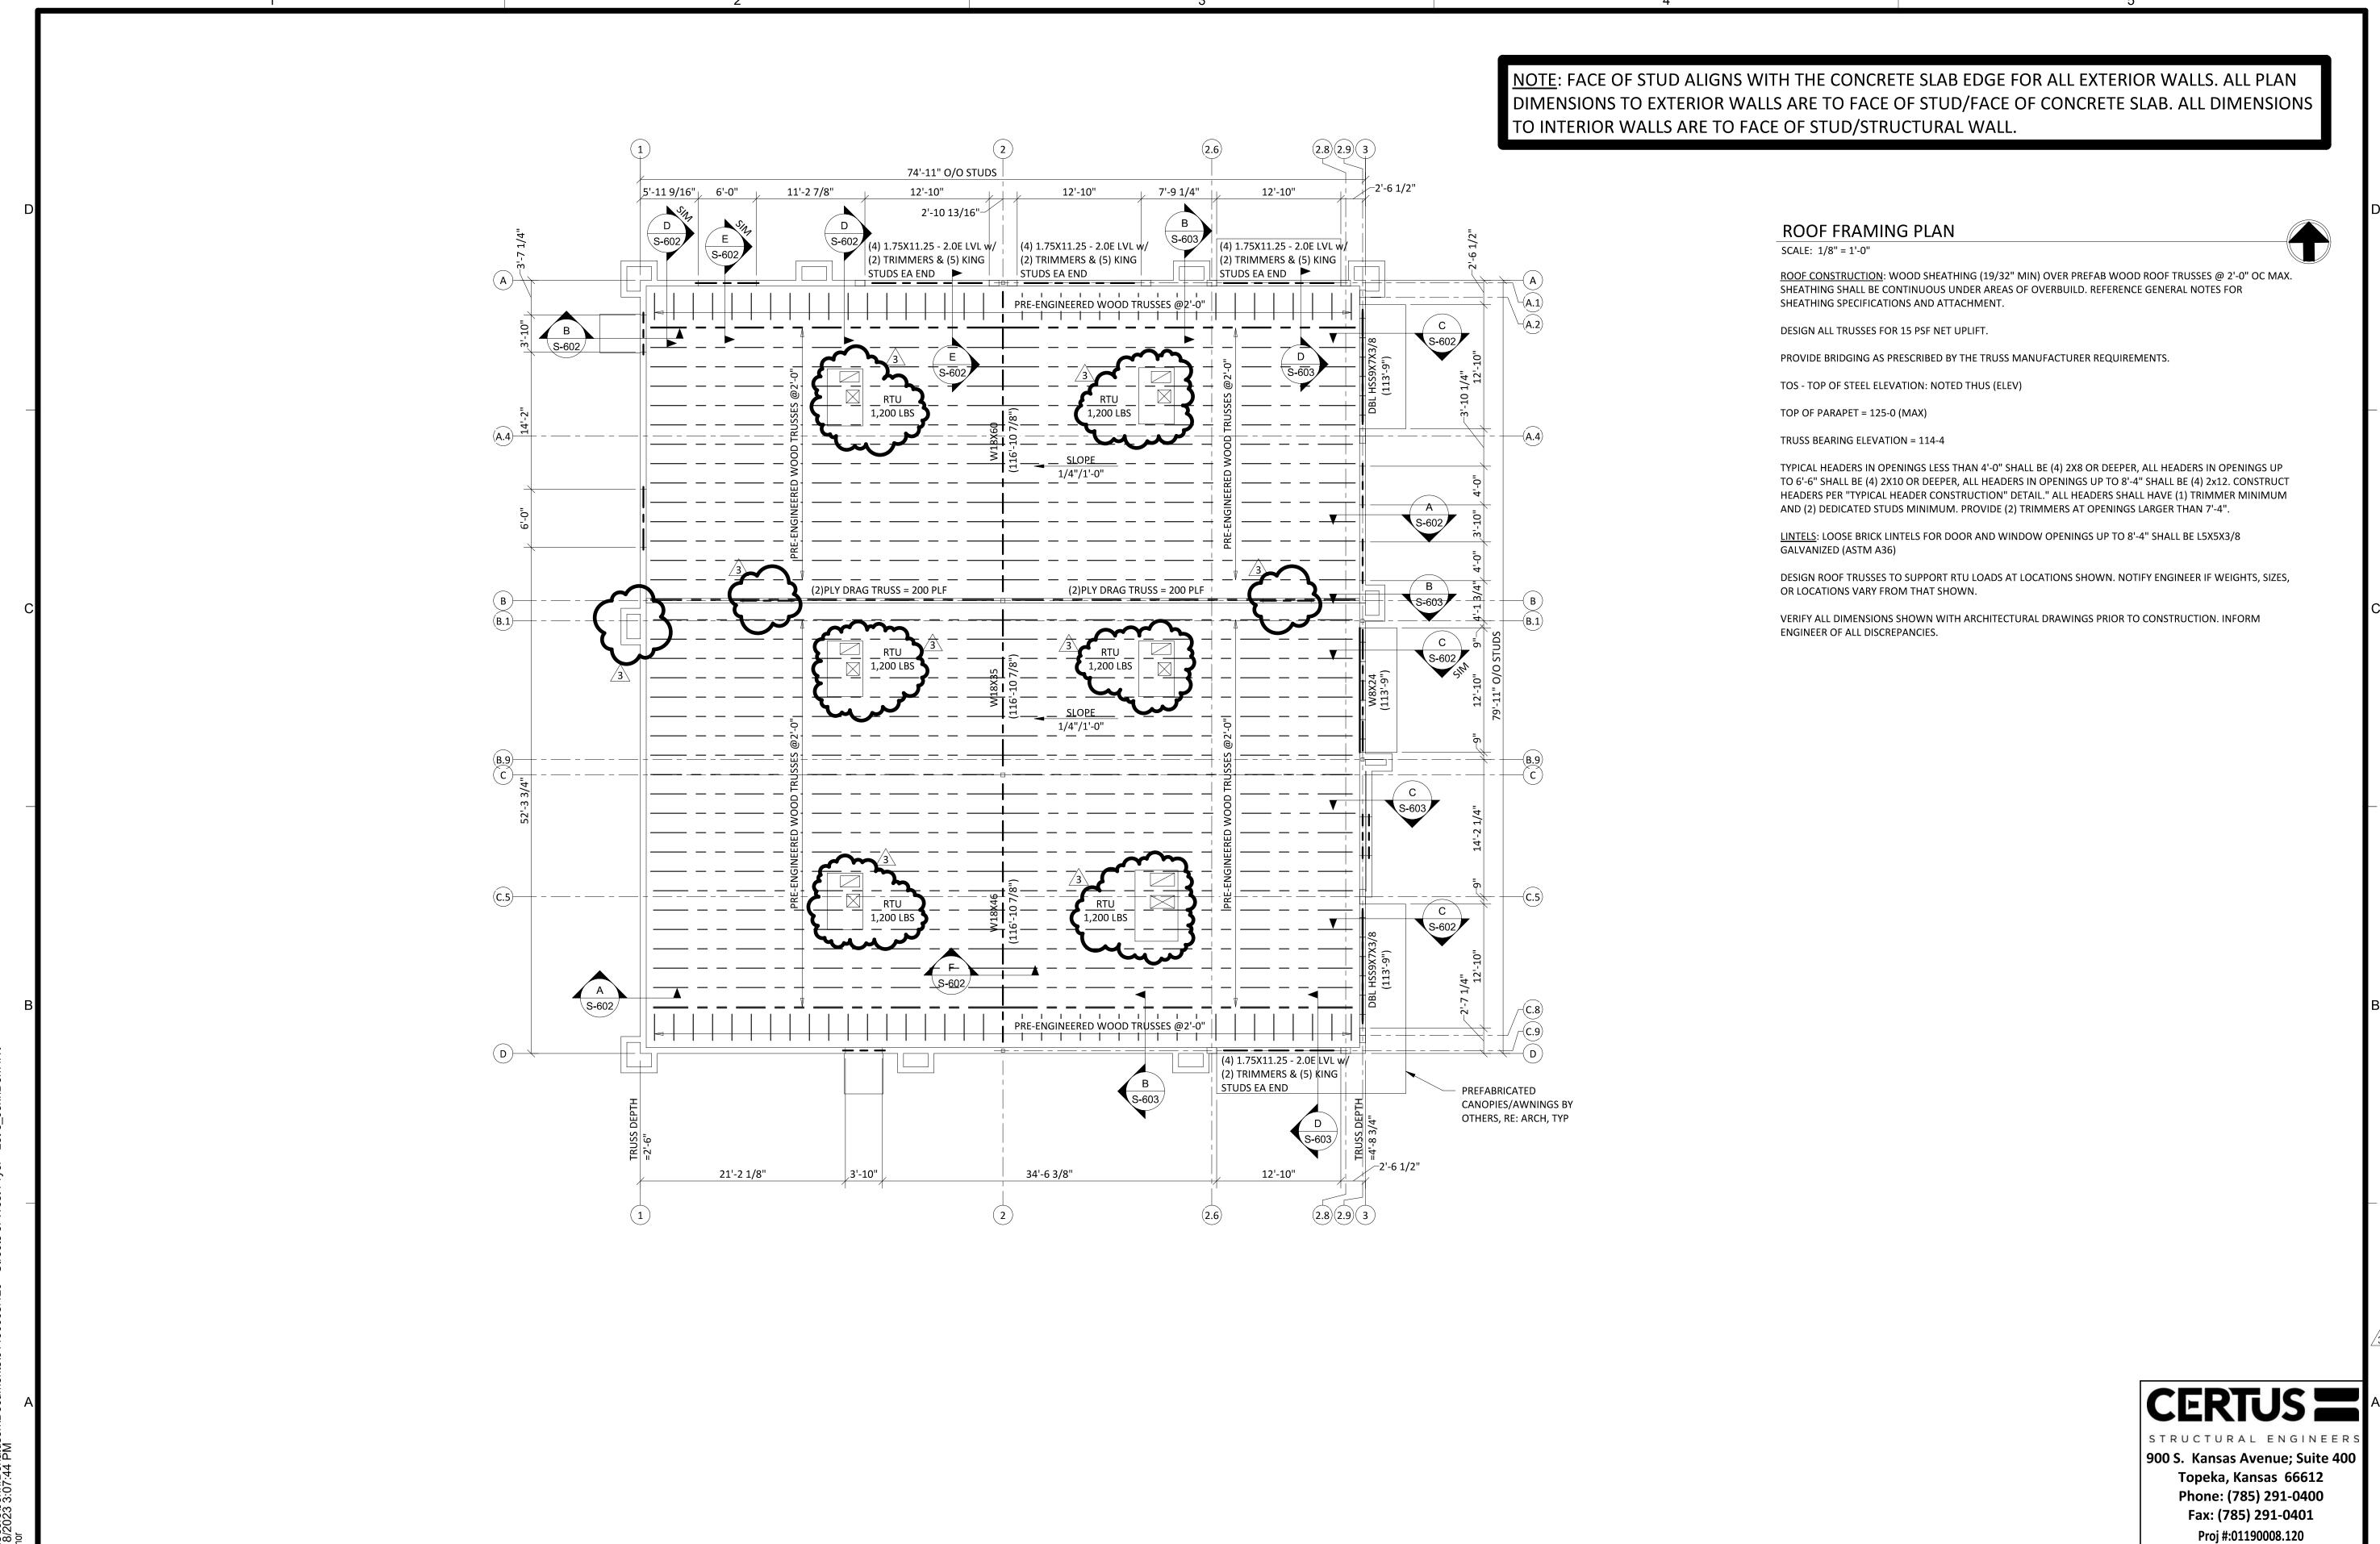

architecture interiors planning
2231 sw wanamaker rd
topeka, kansas 66614-4275
phone: 785.273.7540
fax: 785.273.7579

500 north broadway
oklahoma city, ok 73102
phone: 405.231.3105
fax: 405.231.3115



5

# E & SHELL BUILDING FOR SEETS OF WEST PRYOR L

SUBMISSION DATE
2023-05-23
ASI #2 07/07/2023


SHEET TITLE ROOF FRAMING PLAN

PROJECT NUMBER 230117

SHEET NUMBER
S-103


**Certificate Of Authorization** 

E-1392 Revit 2023 Local

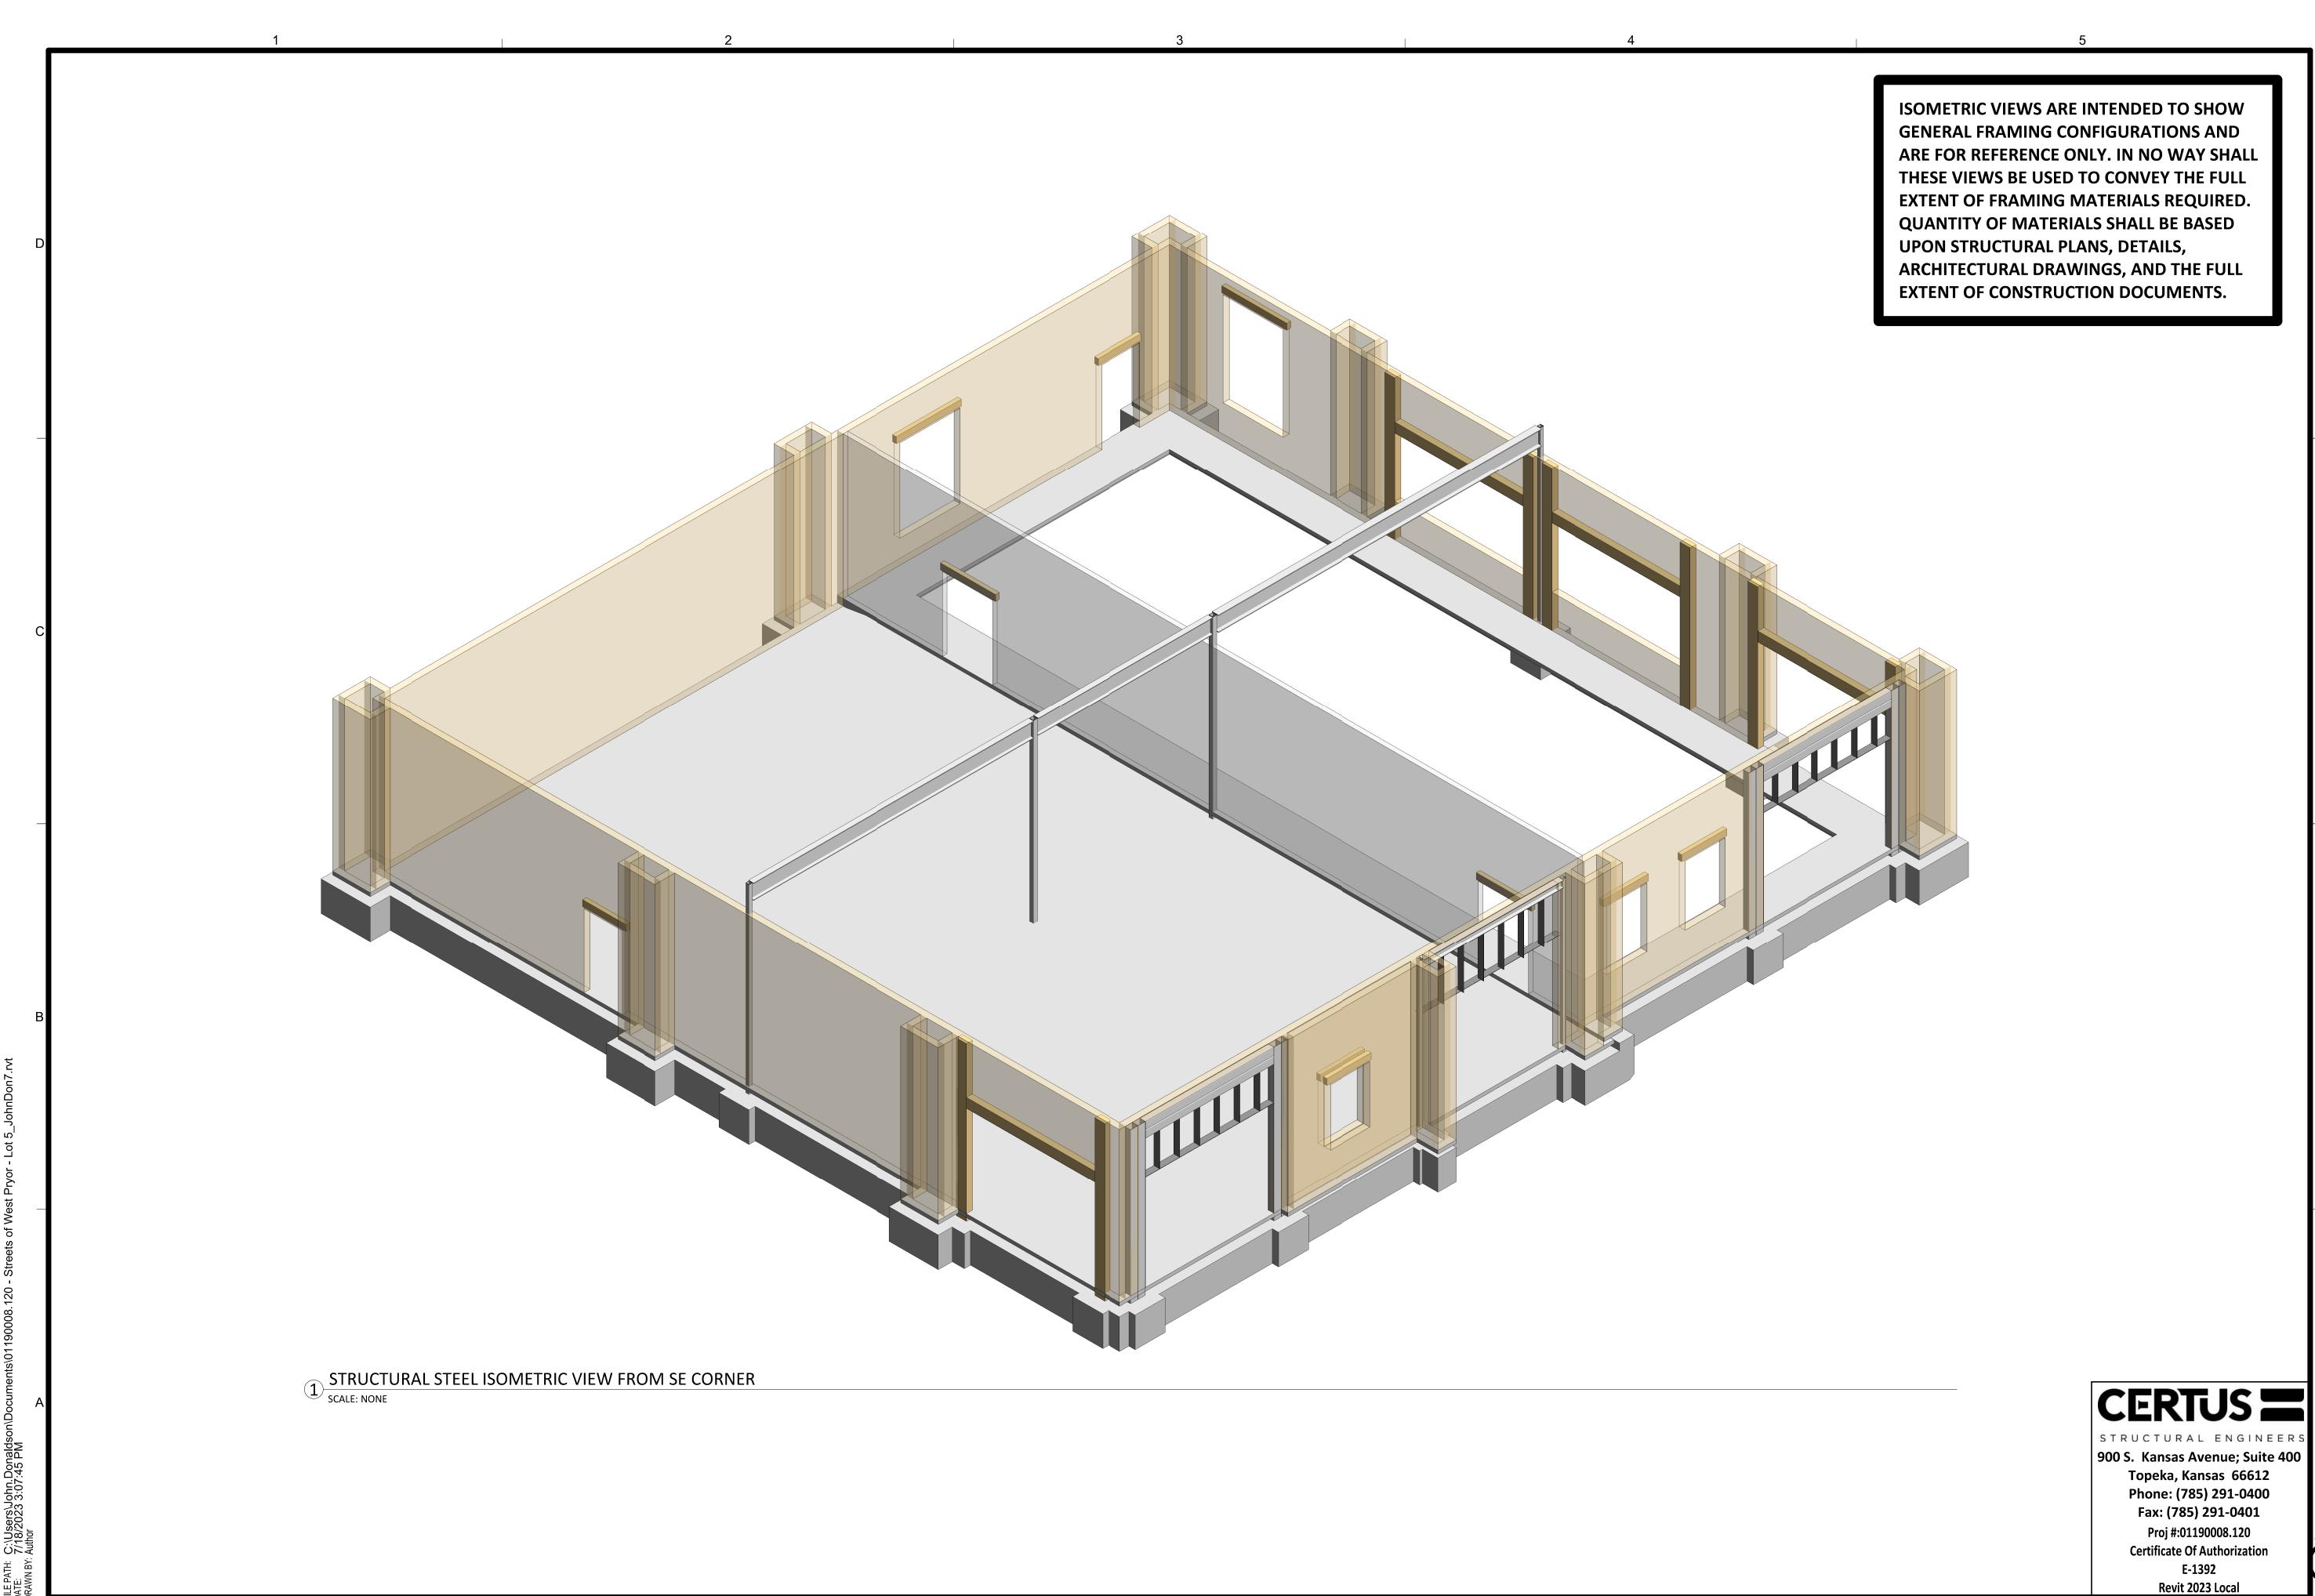

architecture interiors planning
2231 sw wanamaker rd
topeka, kansas 66614-4275
phone: 785.273.7540
fax: 785.273.7579

500 north broadway
oklahoma city, ok 73102
phone: 405.231.3105
fax: 405.231.3115



2

NG FOR ST PRYOR LOT


R SHELL BUILDIN ETS OF WES

SUBMISSION DATES
2023-05-23
ASI #2 07/07/2023

SHEET TITLE

FRAMING ISOMETRIC

PROJECT NUMBER
230117
SHEET NUMBER

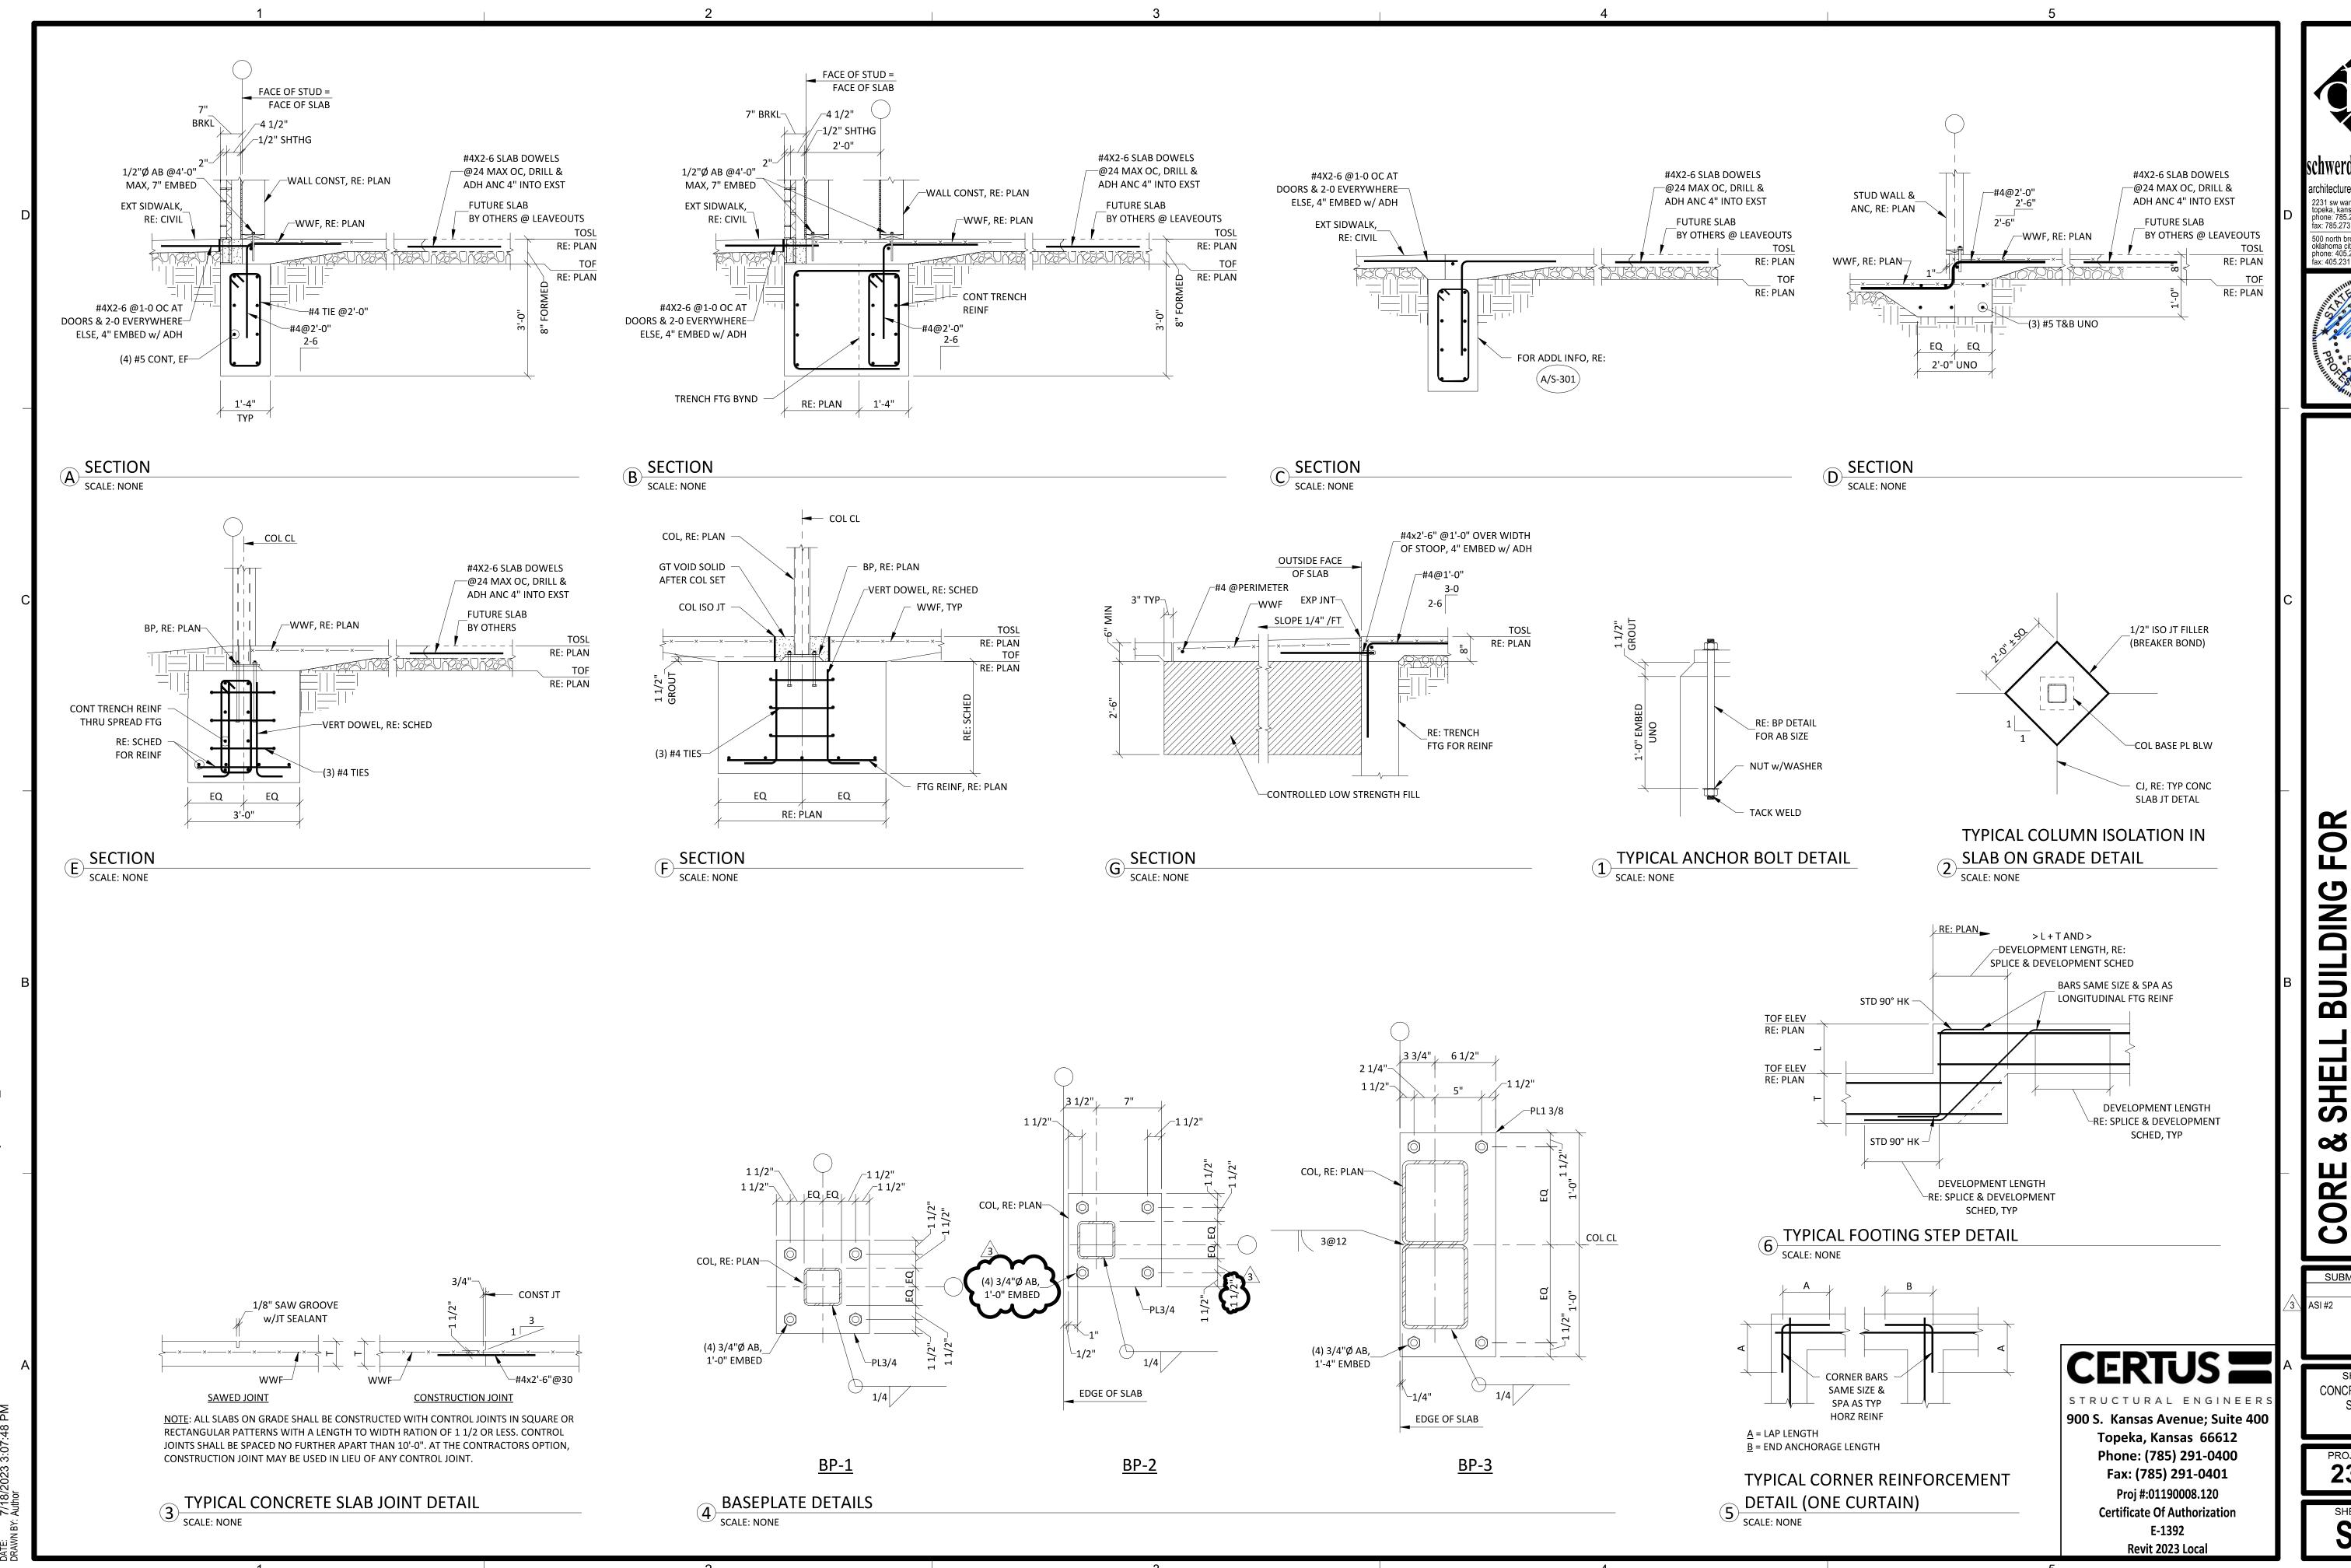

architecture | interiors | plannin

2231 sw wanamaker rd suite 303 topeka, kansas 66614-4275 phone: 785.273.7540 fax: 785.273.7579 500 north broadway oklahoma city, ok 73102 phone: 405.231.3105 suite 200

NUMBER


5


O FOR PRY ELL BUILDING OF WEST SSOURI SHE CORE STR


2023-05-23 ASI #2 07/07/2023

CONCRETE DETAILS & SECTIONS I


230117

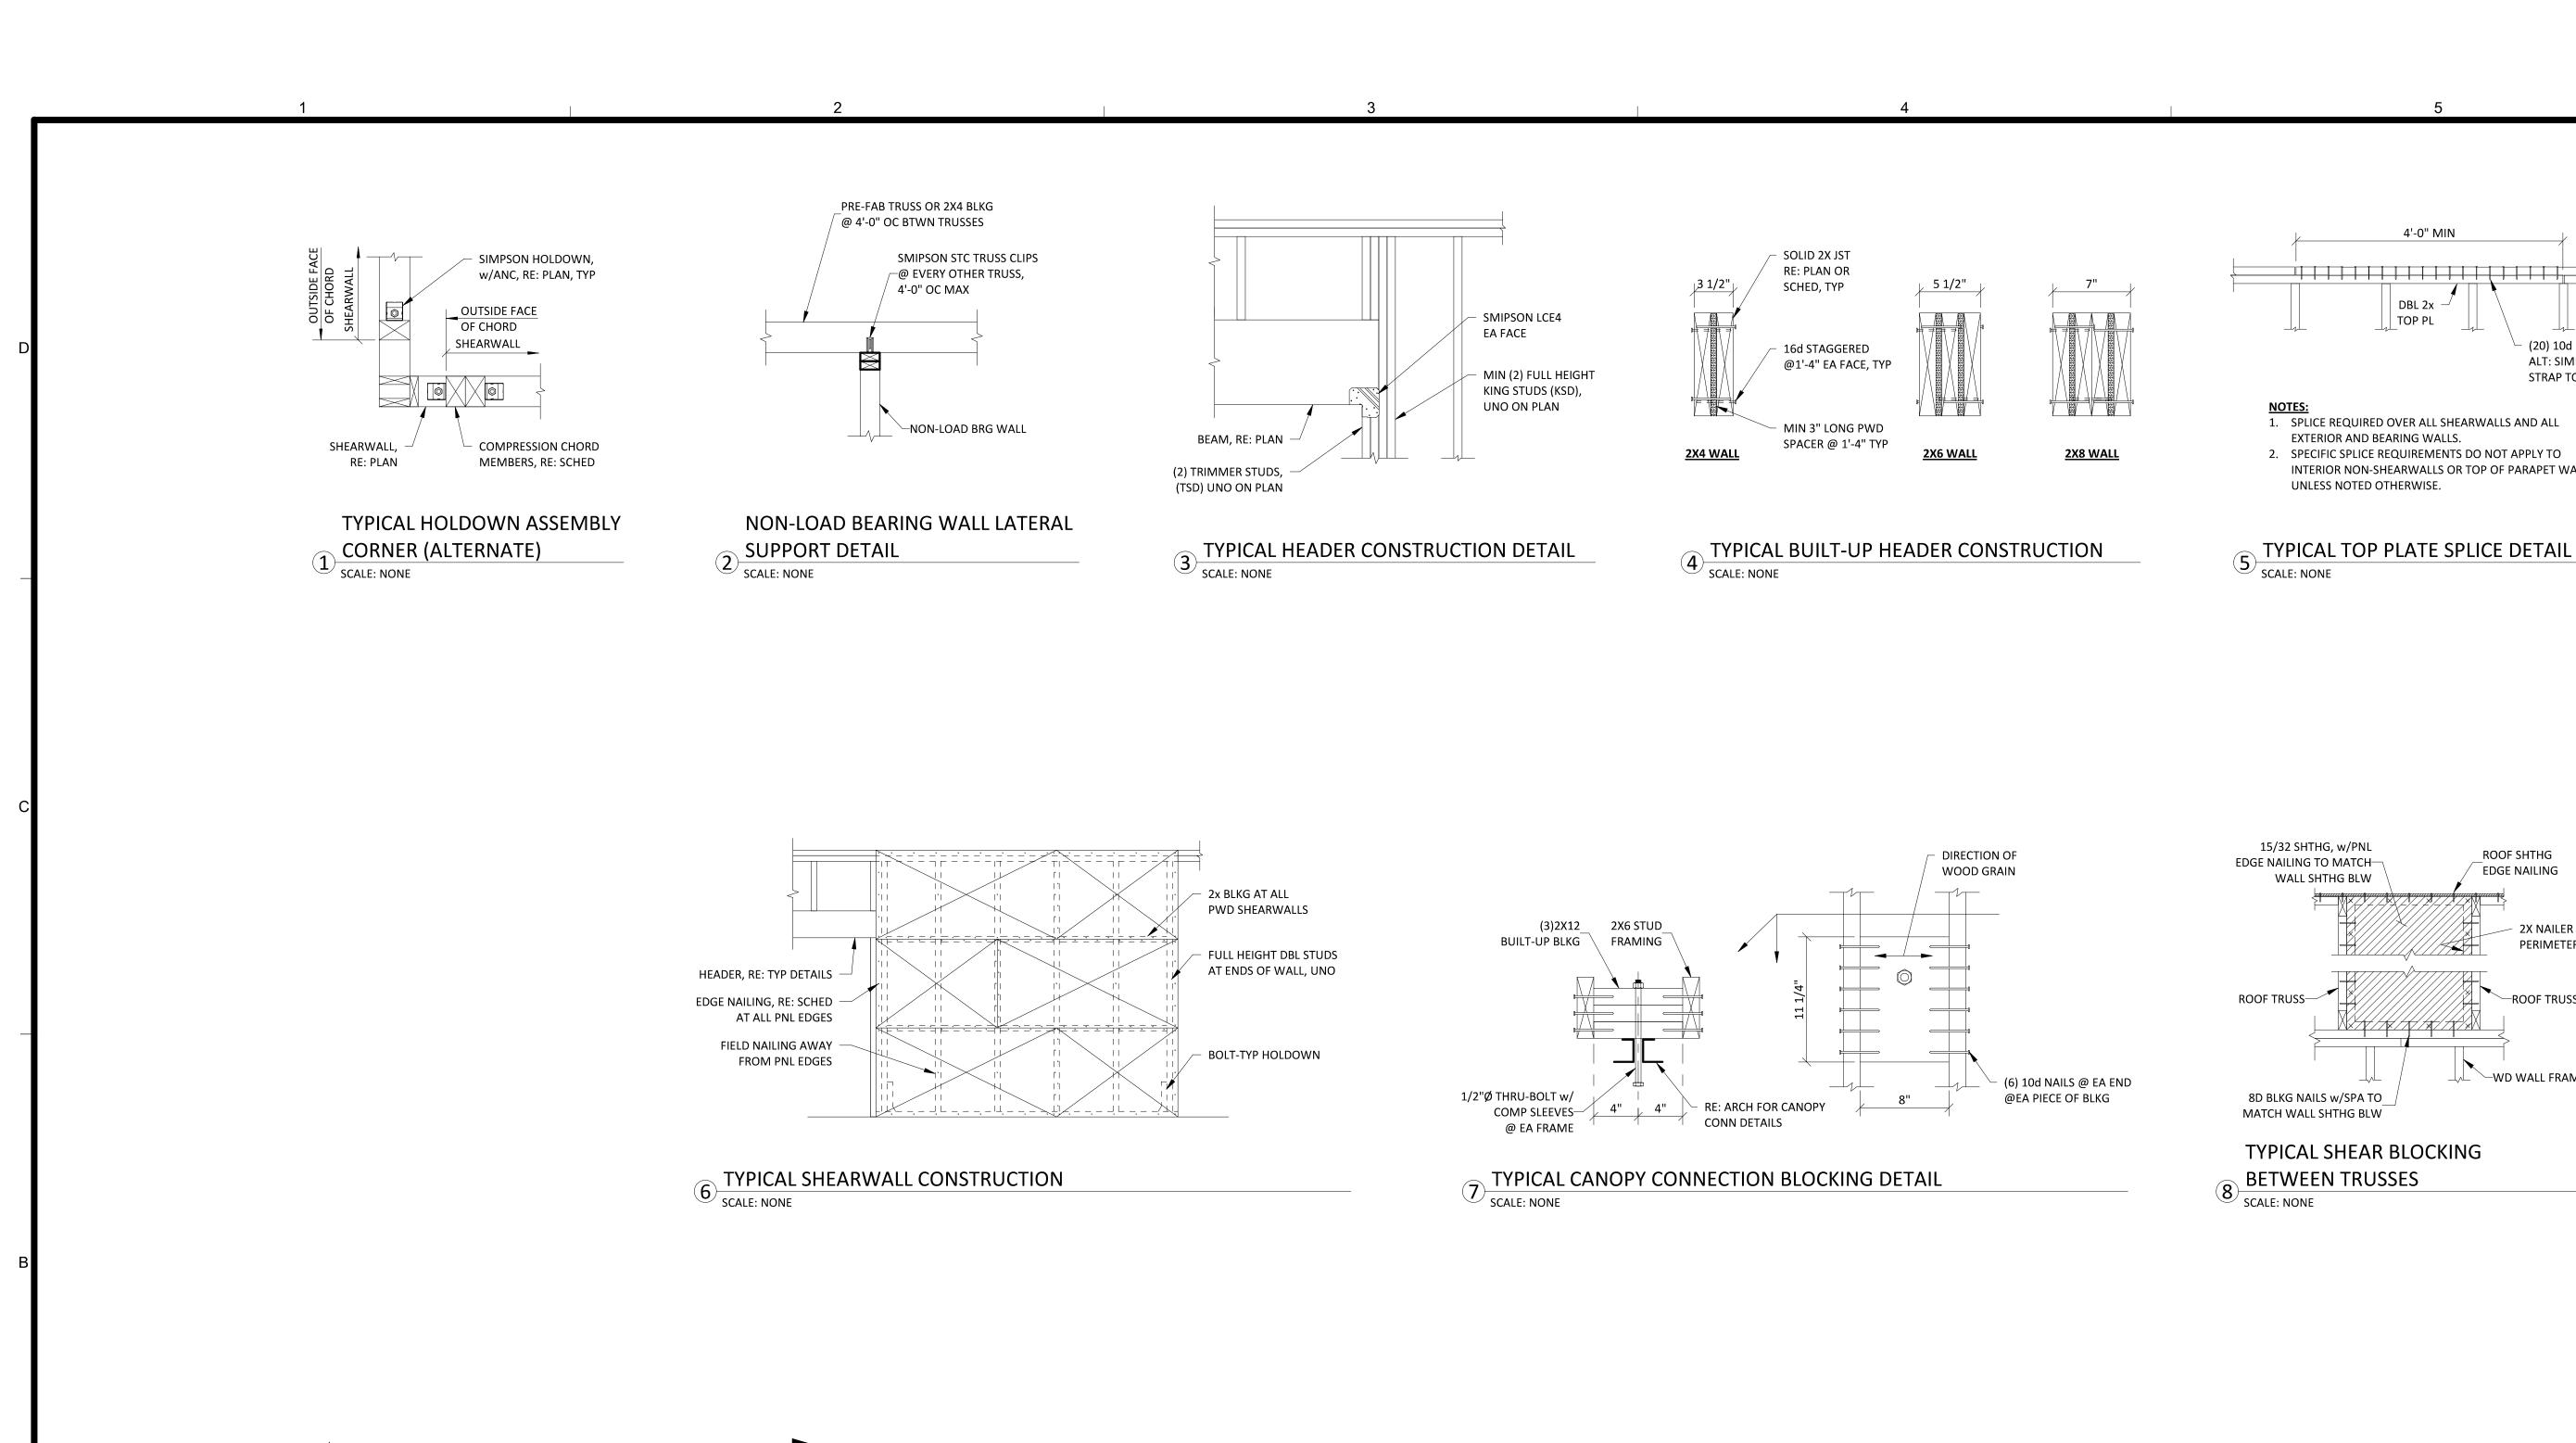

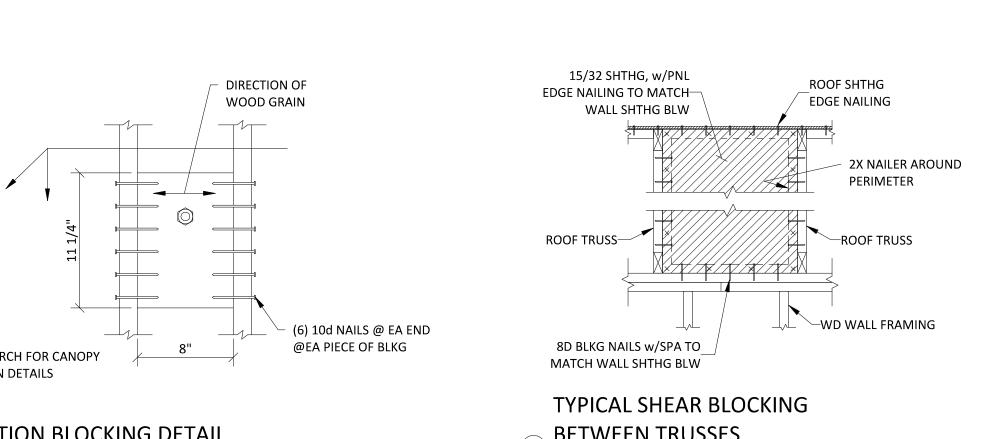

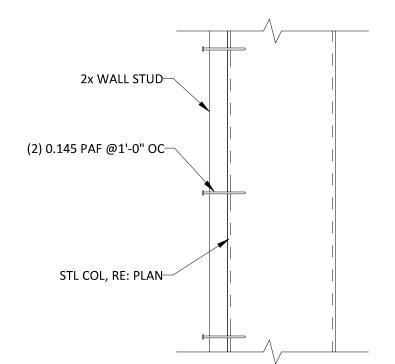


TYPICAL SHEARWALL TERMINATION AT STEEL COLUMN DETAIL SCALE: NONE

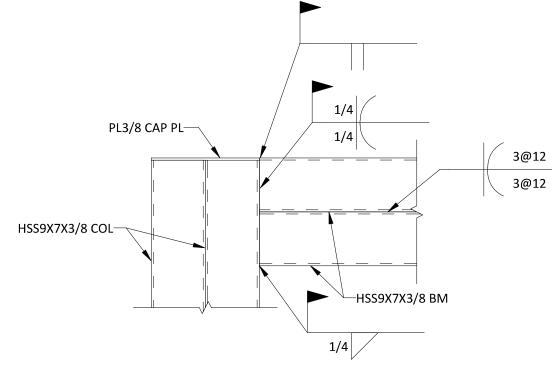


TYPICAL TUBE COLUMN TO BEAM CONNECTION

SCALE: NONE

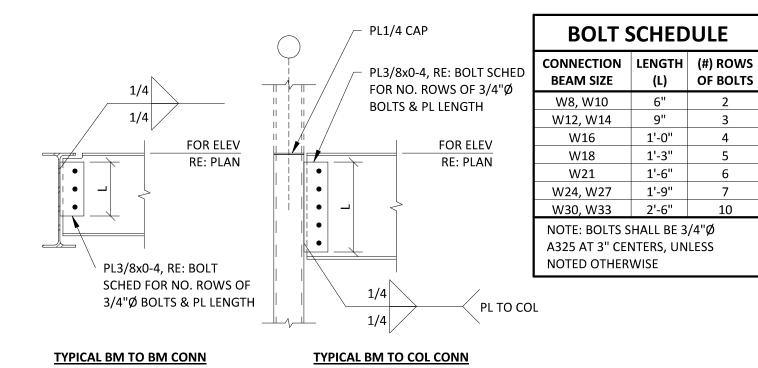

TYPICAL STEEL CONNECTIONS DETAIL (SHEAR TABS)

SCALE: NONE

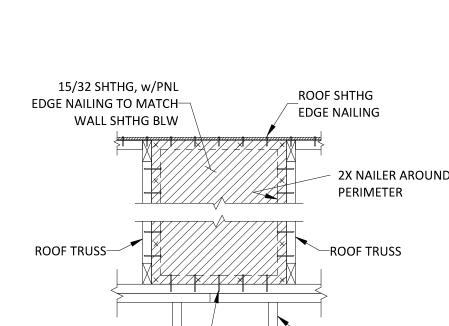

4'-0" MIN

DBL 2x —

INTERIOR NON-SHEARWALLS OR TOP OF PARAPET WALLS

(20) 10d

ALT: SIMPSON ST6236

STRAP TO SIDE

TOP PL

EXTERIOR AND BEARING WALLS.

UNLESS NOTED OTHERWISE.

BETWEEN TRUSSES

STRUCTURAL ENGINEER 900 S. Kansas Avenue; Suite 400 Topeka, Kansas 66612 Phone: (785) 291-0400 Fax: (785) 291-0401 Proj #:01190008.120 **Certificate Of Authorization** E-1392 Revit 2023 Local

2023-05-23

architecture | interiors | plannin

2231 sw wanamaker rd suite 303 topeka, kansas 66614-4275 phone: 785.273.7540 fax: 785.273.7579

5

O

FOR PR

UILDING WEST

CORE STR

LL BI OF


suite 200

500 north broadway oklahoma city, ok 73102 phone: 405.231.3105

**S-601** 

FRAMING DETAILS & SECTIONS I

230117

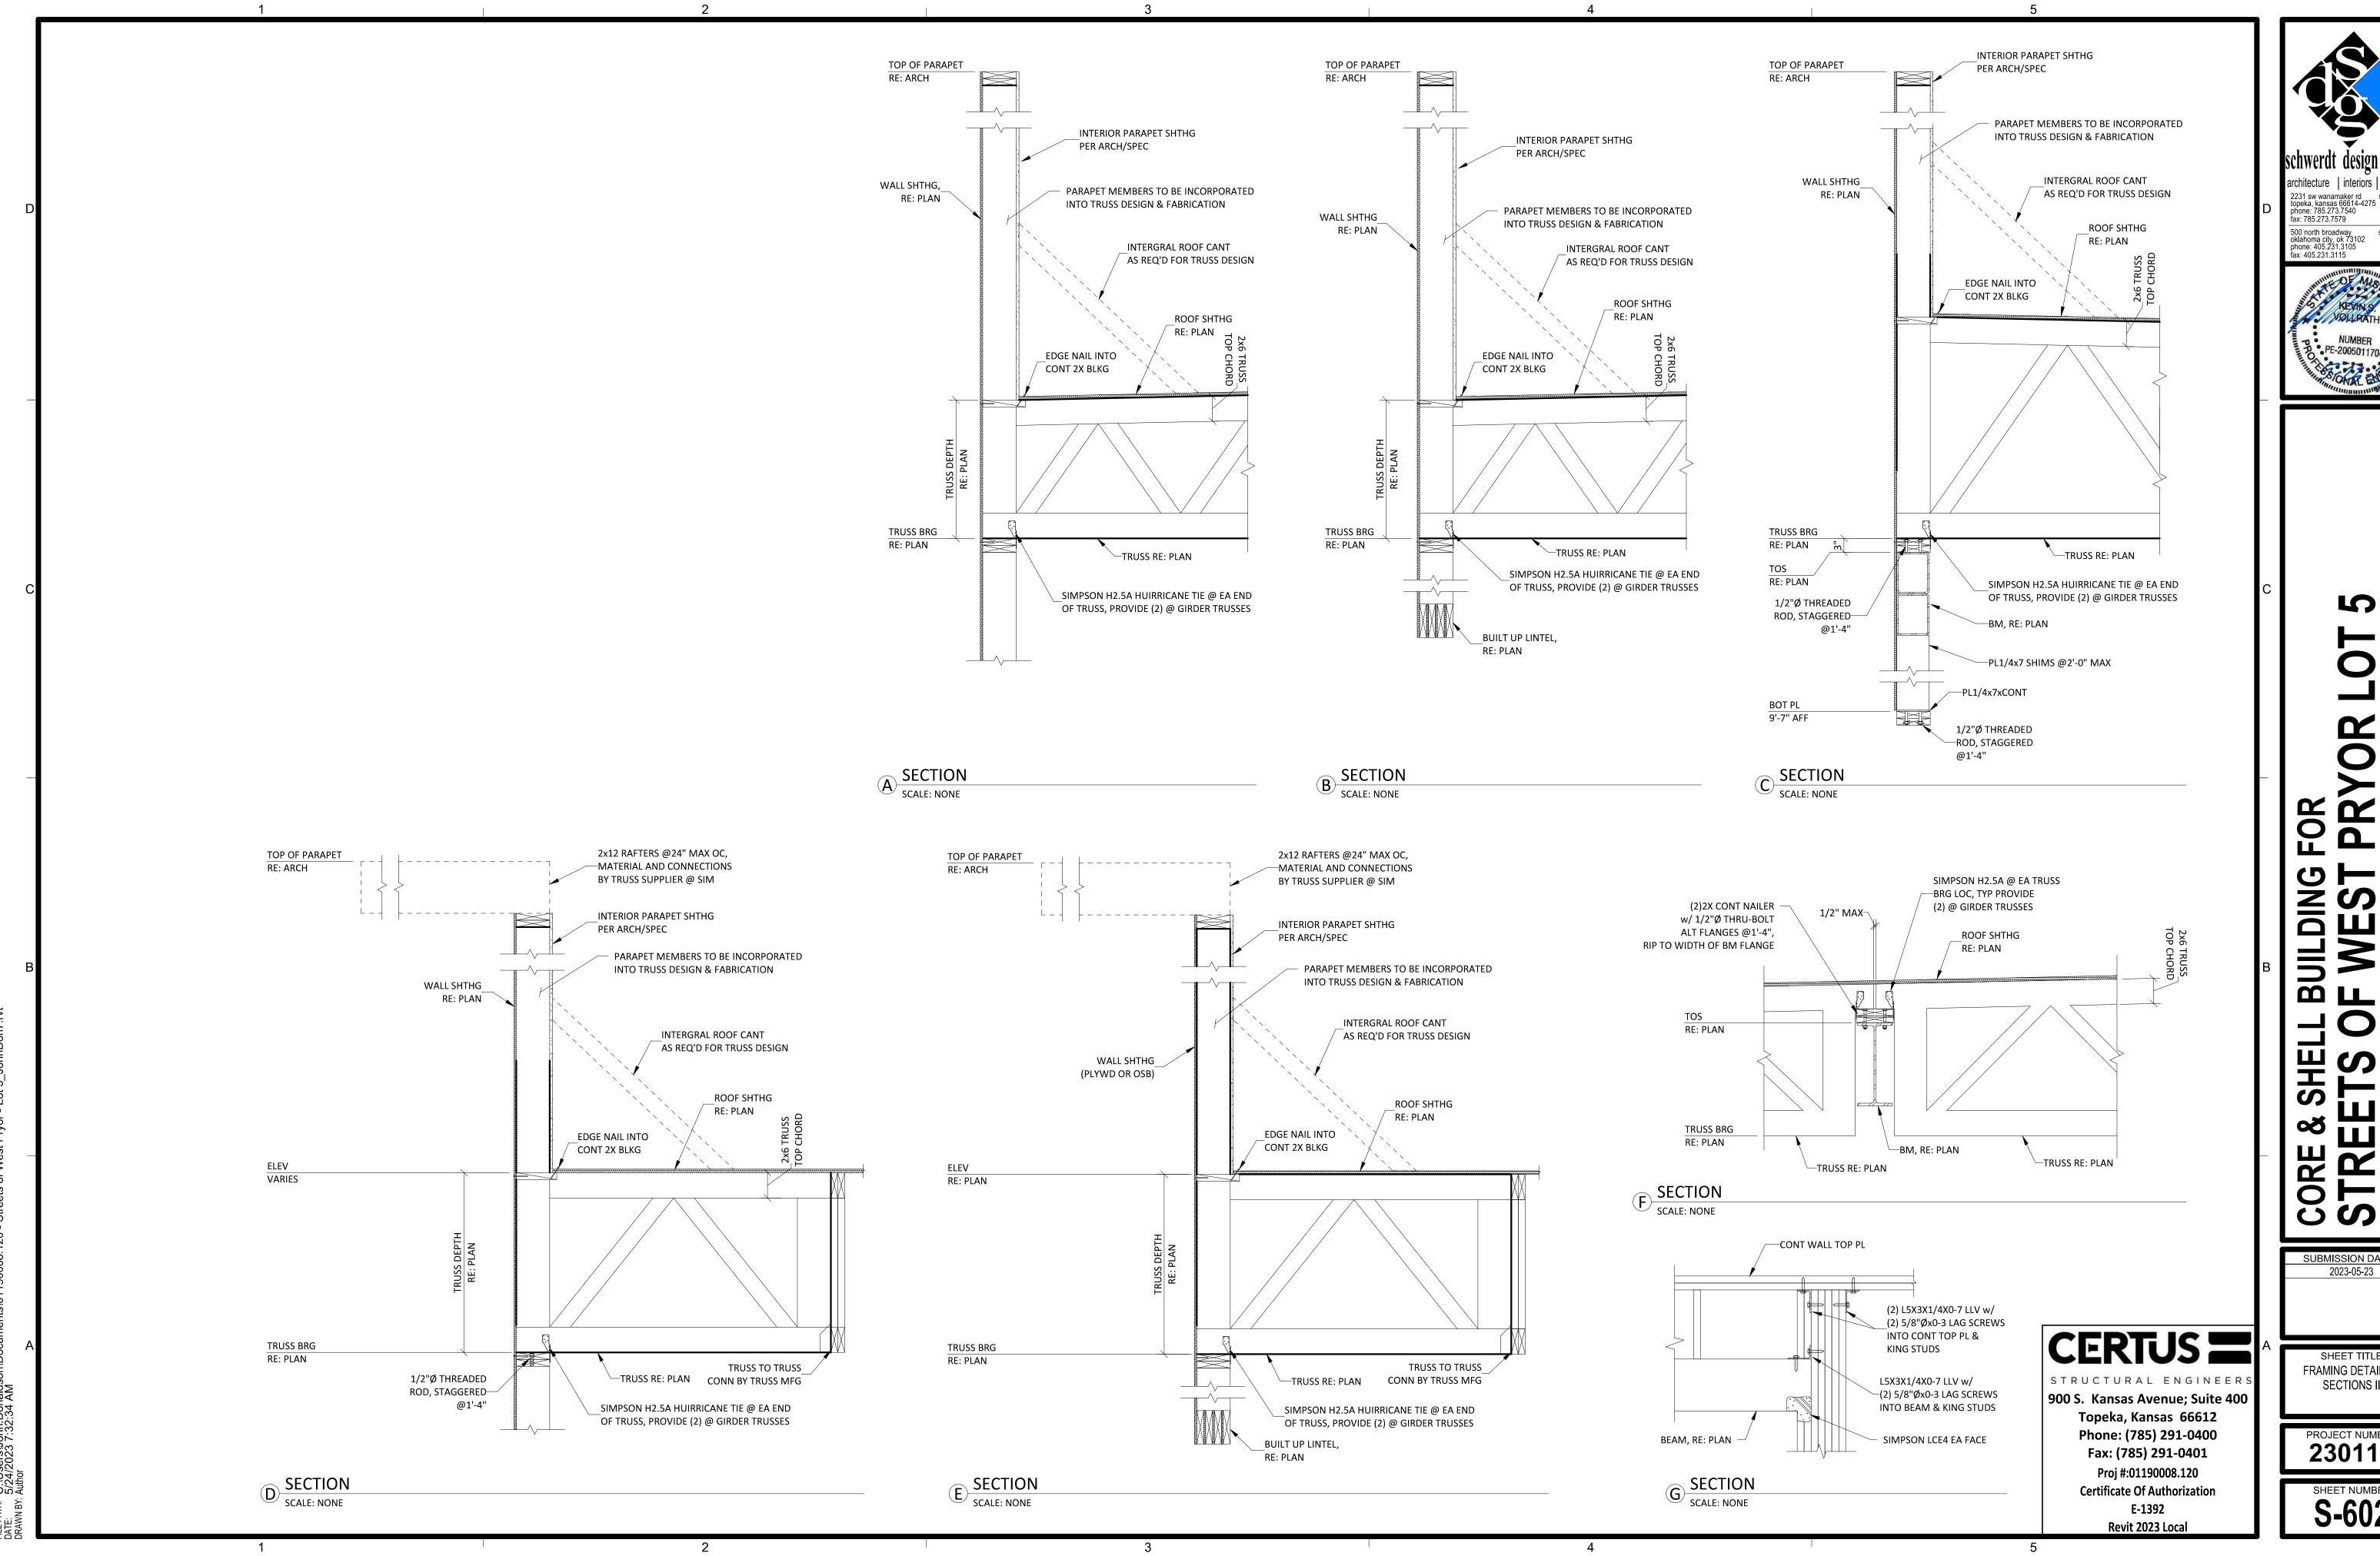

architecture | interiors | plannin 2231 sw wanamaker rd suite 303 topeka, kansas 66614-4275 phone: 785.273.7540 fax: 785.273.7579 500 north broadway oklahoma city, ok 73102 phone: 405.231.3105 fax: 405.231.3115 suite 200




O

FOR PRYOR UILDIN( LL BI OF


2023-05-23

FRAMING DETAILS & SECTIONS II

230117

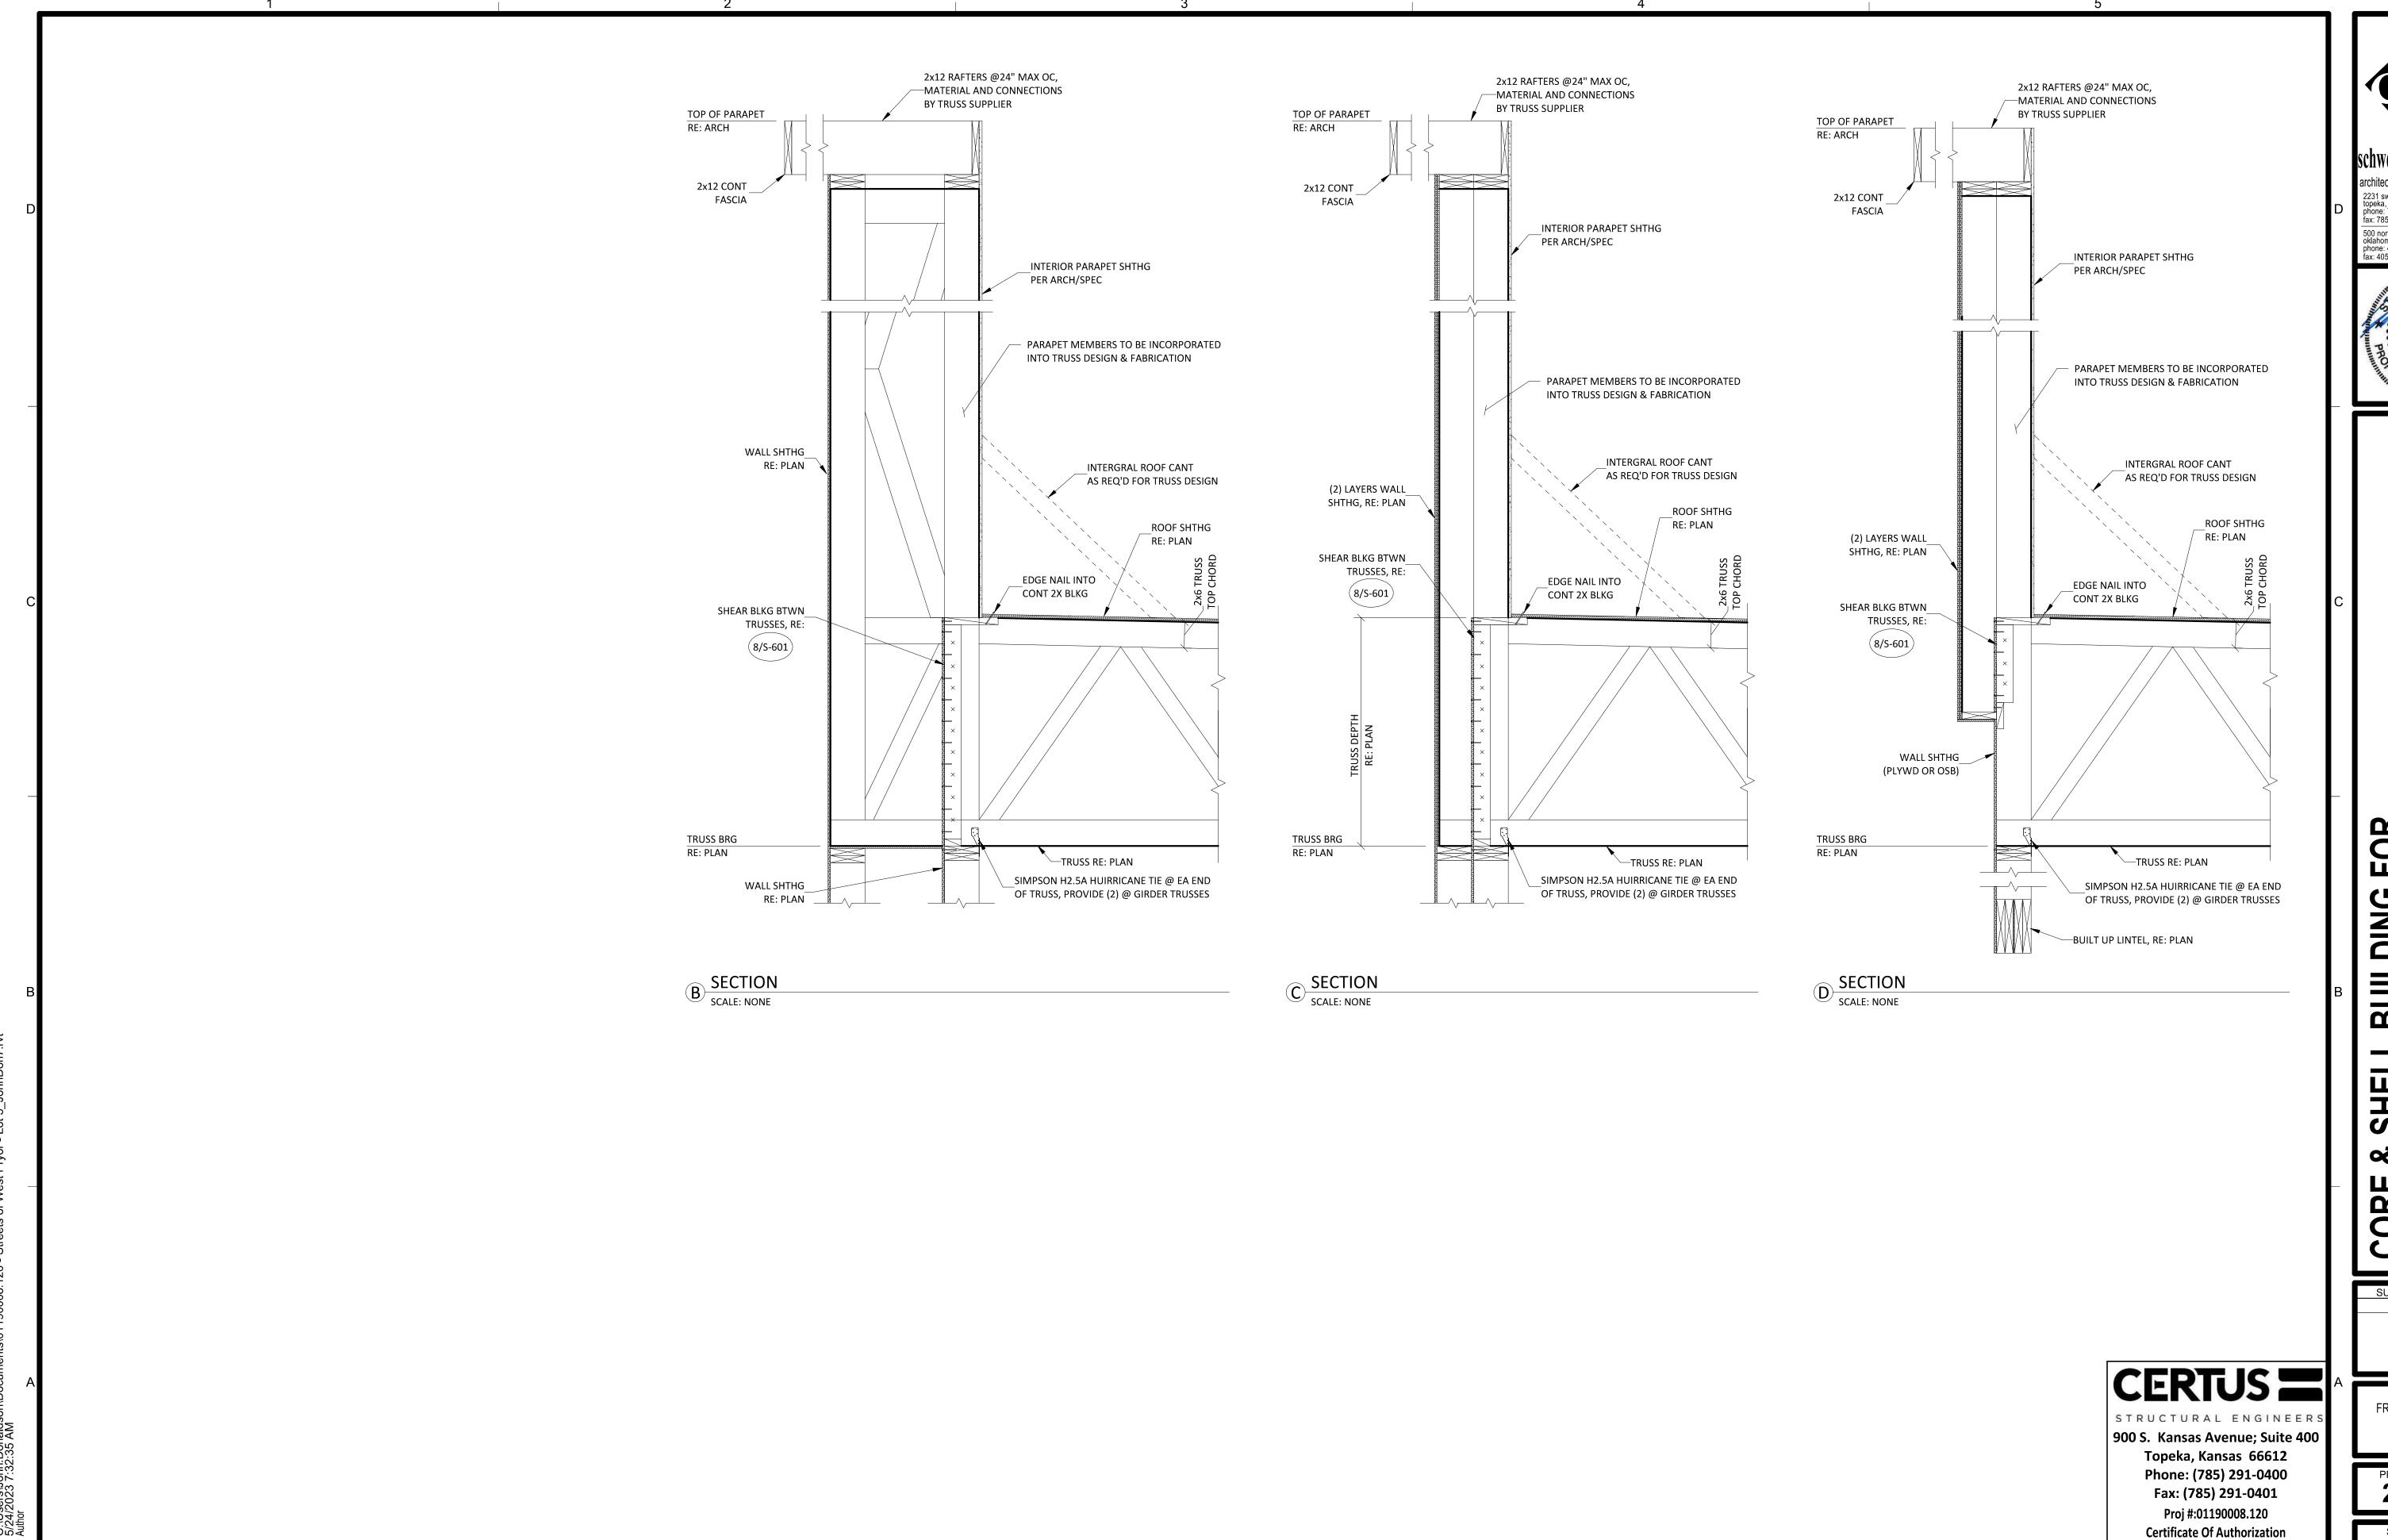

architecture | interiors | planning 2231 sw wanamaker rd suite 303 topeka, kansas 66614-4275 phone: 785.273.7540 fax: 785.273.7579



suite 200

5

OR OR FOR SHELL BUILDING I TS OF WEST F, MISSOURI

2023-05-23

SHEET TITLE FRAMING DETAILS & SECTIONS III

PROJECT NUMBER **230117** 

SHEET NUMBER S-603

E-1392 Revit 2023 Local

### <u>SECTION 15000 — MECHANICAL REQUIREMENTS</u> . GENERAL REQUIREMENTS

- A. ALL WORK SHALL BE IN ACCORDANCE W/ LATEST EDITION OF INTERNATIONAL BUILDING, MECHANICAL & PLUMBING CODES, CODES AS ADOPTED BY CITY, COUNTY, STATE & ALL OTHER APPLICABLE CODES. FURNISH & INSTALL ALL LABOR & MATERIALS REQUIRED FOR COMPLETE, FUNCTIONING, MECHANICAL & PLUMBING SYSTEMS W/ ALL ASSOCIATED EQUIPMENT & APPARATUS AS
- SHOWN ON PLANS. "PROVIDE" MEANS TO FURNISH & INSTALL. OBTAIN & PAY FOR ALL PERMITS REQUIRED FOR EXECUTION OF THIS WORK & SHALL MAKE ARRANGEMENTS FOR MODIFICATIONS TO WATER, GAS & SEWER CONNECTIONS TO VISIT SITE & OBSERVE CONDITIONS UNDER WHICH WORK WILL BE DONE. ANY
- ALLOWANCE WILL BE MADE IN CONTRACT FOR ANY ERROR OR NEGLIGENCE ON FINAL ACCEPTANCE OF WORK SHALL BE SUBJECT TO CONDITION THAT ALL SYSTEMS. EQUIPMENT, APPARATUS & APPLIANCES OPERATE SATISFACTORILY AS DESIGNED &

DISCREPANCIES SHALL BE CALLED TO ARCHITECT'S ATTENTION. NO SUBSEQUENT

- INTENDED. WORK SHALL INCLUDE REQUIRED ADJUSTMENT OF SYSTEMS & CONTROL EQUIPMENT INSTALLED UNDER THESE SPECIFICATIONS. WARRANT TO OWNER QUALITY OF MATERIAL, EQUIPMENT, WORKMANSHIP & OPERATION
- OF EQUIPMENT PROVIDED UNDER THESE SPECIFICATIONS FOR ONE YEAR FROM & AFTER COMPLETION OF BUILDING & ACCEPTANCE OF MECHANICAL SYSTEMS BY OWNER. ALL MATERIALS INSTALLED IN PLENUMS SHALL BE NONCOMBUSTIBLE OR HAVE FLAME/SMOKE INDEX OF NO MORE THAN 25/50 IN ACCORDANCE W/ ASTM E 84. ROOF PENETRATIONS - MADE BY AUTHORIZED ROOFING CONTRACTOR WHEN REQUIRED.

# <u>SECTION 15100 - PLUMBING</u>

- . WATER PIPING ALL WATER PIPING SHALL BE 95—5 TIN—ANTIMONY JOINED TYPE L COPPER. INSULATE W/ FIBERGLASS W/ ASJ & PVC COVERS. THINCKNESS IN ACCORDANCE W/ ASHRAE 90.1.
- WASTE & VENT PIPING CI BELL & SPIGOT OR HUBLESS CI W/ NEOPRENE GASKET FITTINGS W/ STAINLESS STEEL BANDS. SCHED 40 PVC W/ SOLVENT WELDS MAY BE USED WHERE ALLOWED BY LOCAL CODE. PVC NOT ALLOWED IN PLENUMS. ROOF/STORM DRAIN PIPING - CI BELL & SPIGOT OR HUBLESS CI W/ NEOPRENE GASKET FITTINGS W/ STAINLESS STEEL BANDS. SCHED 40 PVC W/ SOLVENT WELDS MAY BE USED WHERE ALLOWED BY LOCAL CODE. PVC NOT ALLOWED IN PLENUMS. INSULATE W/ MIN 1/2" FIBERGLASS PIPE WRAP W/ ASJ JACKET.
- GAS PIPING PROVIDE SCHED 40 CONT. WELD CARBON STEEL W/ CORRESPONDING FITTINGS. PROVIDE THREADED FITTINGS. PROVIDE IRON BODY-BRASS PLUG GAS STOPS. PAINT ALL EXPOSED GAS PIPING ON THE EXTERIOR OF THE BUILDING INCLUDING ON
- A. BALL VALVES 2" & UNDER BRONZE FULL PORT W/ TEFLOW SEATS, BRONZE BALL & INSULATED HANDLE BALANCING VALVES - ARMSTRONG MODEL CBV I OR CBV II, 125 PSI-WP AT 250 DEGREES F., METER CONNECTIONS W/ BUILT-IN CHECK VALVES SCREWED OR FLANGED
- ENDS. PROVIDE POLYURETHANE INSULATION COVER. CHECK VALVES - 2" 7 SMALLER SCREWED OR SOLDER BRONZE CHECK VALVE, 200 PSI-WOG/125 PSI-WSP, TEFLON OR BRONZE DISC & SEAT RING. 2-1/2" & LARGER FLANGED, ASTM 126 IRON BODY, BRONZE TRIMMED, 200 PSI-WOG/125 PSI-WSP. BUTTERFLY VALVES - 3" & LARGER LEVER ASTM A126 CI DRILLED & TAPPED FULL LUG BODY, 200 PSI-WOG, EXTENDED NECK, BRONZE DISC, STAINLESS STEEL STEM,
- FIELD-REPLACEABLE EPDM SLEEVE & STEM SEALS. EQUIVALENT VALVE MANUFACTURERS: MILWAUKEE, STOCKHAM, POWELL, RED-WHITE, CRANE, APPOLO, MUELLER, MUESSCO, WATTS, HAYS, ROCKWELL-NORDSTROM.

# FIXTURES: AMERICAN STANDARD, KOHLER, CRANE, ZURN, TOTO

- STAINLESS STEEL FIXTURES: ELKAY, JUST, MOEN COMMERCIAL FITTINGS & SUPPORTS: JOSAM, SMITH, WADE, ZURN, OR JONESPEC. SEATS: CHURCH, OLSONITE, BEMIS OR BENEKE.
- DRINKING FOUNTAINS: HALSEY TAYLOR, ELKAY, OASIS, OR HAWS. TRIM BY DELTA, ELJER, KOHLER, AMERICAN STANDARD, CRANE, SLOAN. FLUSHVALVES: SLOAN, ZURN, TOTO
- DRAINS BY WADE, ZURN, WOODFORD, SMITH, JOSAM.
- ROOF DRAINS CAST IRON ROOF DRAIN W/ FLANGE, CI MUSHROOM DOME. 2" DAM FOR OVERFLOW DRAINS WALL HYDRANTS JOSAM SERIES 71000 W/ CONNECTIONS FOR 3/4" PIPE & HOSE. NON-FREEZING W/ KEY, VACUUM BREAKER, LOCKING COVER. EQUIVALENT BY J.R. SMITH, WADE, WOODFORD OR ZURN.

EQUIPMENT - SEE SCHEDULES

## WATER HEATER - STATE, RHEEM, NATIONAL, A.O. SMITH. PORCELAINIZED GLASSLINED TANK. COLD WATER INLET DROP TUBE. MAGNESIUM ANODE RODS. U.L. SEAL, 160 PSI FACTORY TEMPERATURE & PRESSURE RELIEF VALVE. N.S.F. CONSTRUCTION. 3 YR

- SUBMERSIBLE SUMP PUMPS SIMPLEX/DUPLEX SUBMERSIBLE PUMP SYSTEM A SCHED/SHOWN. PUMP CASING ONE PIECE CAST IRON W/ SUPPORT LEGS, CI SUCTION STRAINER. VERTICAL MOTOR, NEMA-6, NOT LESS THAN HP SCHED & 1750 RPM. AUTO-RESET THERMAL/OVERLOAD PROTECTION.
- RECIRCULATION PUMPS HORIZONTAL, OIL—LUBRICATED, ALL BRONZE. NON-OVERLOADING MOTOR.

- . PROVIDE UNIONS OR FLANGED JOINTS IN EACH PIPE LINE PRECEDING CONNECTIONS TO EQUIPMENT TO ALLOW REMOVAL FOR REPAIR OR REPLACEMENT. PROVIDE ALL SCREWED & CONTROL VALVES W/ UNIONS ADJACENT TO EACH CONNECTION. PROVIDE SCREWED END VALVES W/ UNION ADJACENT TO VALVE UNLESS VALVE CAN BE OTHERWISE EASILY REMOVED FROM LINE
- AFTER PIPING IS IN PLACE TEST LINES TO ENSURE NO LEAKS. ALL PIPING & EQUIPMENT SHALL BE SUPPORTED PROPERLY FROM STRUCTURE.
- ESCUTCHEONS PROVIDE NICKEL-BRASS OR CHROME PLATED ON ALL EXPOSED PIPES WHEN PASSING THRU WALL OR CEILING OF FINISHED ROOMS. VERIFY FLOOR MATERIALS USED FROM ARCHITECTURAL PLANS & PROVIDE PROPER CLEANOUT TOPS, WHERE THEY OCCUR IN CARPET, QUARRY TILE, VINYL TILE (
- PROVIDE WATER HAMMER ARRESTORS FOR ALL PLUMBING BANKS W/ FIXTURES UTILIZING FLUSH VALVES IN ANY CAPACITY. LOCATE ARRESTER BETWEEN LAST TWO FIXTURES SERVED ON BRANCH LINE.

# <u>SECTION 15300 — HVAC</u>

- . PROVIDE COMPLETE HVAC SYSTEM AS SHOWN ON DRAWINGS INCLUDING ALL NECESSARY EQUIPMENT, DUCTWORK, DIFFUSERS, GRILLES, & FILTERS. PROVIDE OPERATING & MAINTENANCE INSTRUCTIONS ON ALL EQUIPMENT. ALL HVAC WORK SHALL BE DONE IN STRICT ACCORDANCE W/ ALL REQUIREMENTS OF LOCAL BUILDING CODE, ASHRAE, NEC, NFPA, & ALL OTHER APPLICABLE CODES HAVING
- HVAC DUCTWORK SHALL BE GALV SHEET METAL OF GAUGES & JOINT TYPES SPECIFIED IN SMACNA MANUAL. PROVIDE TURNING VANES IN ELBOWS. VOLUME DAMPERS SHALL BE MANUAL LOCKING BLADE TYPE.
- ALL DUCTWORK MUST BE SUPPORTED PROPERLY FROM STRUCTURE. WRAP ALL SUPPLY & OUTSIDE AIR HVAC DUCTWORK W/ CERTAINTEED 1-1/2" THICK INSULATION W/ VAPOR BARRIER IN CONCEALED LOCATIONS. ALSO LINE FIRST 10' OF SUPPLY DUCTWORK FOR SOUND ATTENUATION ( IN ADDITION TO WRAP) LINE ALI RETURN AIR DUCTS & TRANSFER BOOTS W/ 1/2" LINER.
- ROOFTOP UNITS AS SCHEDULED. EQUIVALENTS BY TRANE, CARRIER, YORK, LENNOX, AAON, DAIKIN. MIN 14" ROOF CURB. PROVIDE SLOPED CURB AS REQUIRED FOR LEVEL UNIT INSTALLATION. ECONOMIZER W/ BAROMETRIC RELIEF. FIXED DRY BULB CONTROL. 2" MERV 7 FILTERS. LOUVERED HAIL GUARDS. 30 DEG LOW AMBIENT. EXHAUST FANS - EQUIVALENT BY COOK, PENN, ACME, GREENHECK, JENNAIRE, TWIN
- CITY. PROVIDE W/ SPEED CONTROLS FOR ALL FANS LESS THAN 1/3HP TO BE FURNISHED TO E/C FOR MOUNTING AT FAN. PROVIDE W/ 14" MIN. CURB. PROVIDE PROGRAMMABLE THERMOSTATS W/ STAGES OF HEATING AND COOLING A REQUIRED BY STAGES OF HEATING AND COOLING ON SPECIFIED EQUIPMENT. SEVEN (7) DAY PROGRAMMING CAPABILITY W/ 2 OCC/UNOCC PERIODS/DAY. AUTO HEAT/COOL CHANGE OVER. LOCKING SETPOINTS TO PREVENT TAMPERING. PROVIDE W/ AL INTERFACES TO OTHER EQUIPMENT AS REQUIRED. THERMOSTATS BY HONEYWELL, JOHNSON CONTROLS, WHITE—ROGERS, TRANE, CARRIER, AAON, LENNOX, DAIKIN, OR
- COORDINATE W/ E/C TO PROVIDE ALL WIRING BETWEEN EQUIPMENT, DAMPERS, THERMOSTATS & ALL OTHER REQUIRED CONTROLS & DEVICES. PROVIDE ANY REQUIRED INTERFACES TO FIRE ALARM OR SIMILAR SYSTEMS.
- PROVIDE GROUND-MOUNTED UNITS ON 4", REINFORCED CONCRETE BASE, 4" LARGER THAN UNIT ON EACH SIDE ROOF-MOUNTED UNITS ON EQUIPMENT SUPPORTS OR CURBS. ANCHOR UNITS TO
- PROVIDE FACTORY-AUTHORIZED SERVICE START UP ON EQUIPMENT. TRAIN OWNER'S MAINTENANCE PERSONNEL ON STARTUP, SHUTDOWN, TROUBLESHOOTING, SERVICING,

# 16000 - ELECTRICAL SPECIFICATIONS

## <u>SECTION 16000 - ELECTRICAL REQUIREMENTS</u>

- A. ALL WORK SHALL BE IN ACCORDANCE W/ LATEST EDITION OF INTERNATIONAL BUILDING CODE, NATIONAL ELECTRICAL CODE, NFPA, CODES AS ADOPTED BY CITY, COUNTY, STATE & ALL OTHER APPLICABLE CODES
- B. ALL MATERIALS & EQUIPMENT SHALL BE NEW & SHALL BEAR U.L. LABEL WHERE APPLICABLE. PROVIDE WATERPROOF EQUIPMENT ENCLOSURES WHERE REQUIRED. C. OBTAIN & PAY FOR ALL PERMITS REQUIRED FOR EXECUTION OF THIS WORK & SHALL MAKE ARRANGEMENTS FOR MODIFICATIONS TO ELECTRICAL CONNECTIONS TO BUILDING
- D. CONTRACTOR SHALL PROVIDE ALL LABOR & MATERIALS REQUIRED TO HAVE COMPLETE FUNCTIONING ELECTRICAL LIGHTING & POWER SYSTEMS TOGETHER W/ ALL ASSOCIATED EQUIPMENT & APPARATUS AS SHOWN ON PLANS. E. WHERE AN ELECTRICAL DEVICE IS REQUIRED BY CODE BUT NOT SHOWN, IT SHALL BE PROVIDED AS THOUGH FULLY SHOWN & SPECIFIED. F. CONTRACTOR SHALL VISIT SITE & OBSERVE CONDITIONS UNDER WHICH WORK WILL BE
- DONE. ANY DISCREPANCIES SHALL BE CALLED TO ARCHITECT'S ATTENTION. NO SUBSEQUENT ALLOWANCE WILL BE MADE IN THIS CONNECTION FOR ANY ERROR OR NEGLIGENCE ON CONTRACTOR'S PART.
- G. FINAL ACCEPTANCE OF WORK SHALL BE SUBJECT TO CONDITION THAT ALL SYSTEMS. EQUIPMENT, APPARATUS & APPLIANCES OPERATE SATISFACTORILY AS DESIGNED & INTENDED. WORK SHALL INCLUDE REQUIRED ADJUSTMENT OF SYSTEMS & CONTROL EQUIPMENT INSTALLED UNDER THESE SPECIFICATIONS. H. WARRANT TO OWNER QUALITY OF MATERIALS, EQUIPMENT, WORKMANSHIP & OPERATION OF EQUIPMENT PROVIDED UNDER THESE SPECIFICATIONS FOR ONE YEAR FROM & AFTER COMPLETION OF BUILDING & ACCEPTANCE OF MECHANICAL SYSTEMS BY OWNER.

# <u>SECTION 16100 - CONDUIT & CONDUCTORS</u>

A. FOLLOW CIRCUITING SHOWN ON PLANS. USE NO CONDUIT SMALLER THAN 1/2" & NO CONDUCTORS SMALLER THAN #12 GA. UNLESS NOTED OTHERWISE. B. WIRE SHALL BE IN NON-FLEXIBLE METALLIC CONDUIT (EMT. IMC OR RMC) FOR ALL CIRCUITS AND FEEDERS GREATER THAN 30A, LIGHT SWITCH RISERS, KITCHEN CIRCUITS

I. ALL MATERIALS INSTALLED IN PLENUMS SHALL BE NONCOMBUSTIBLE OR HAVE

FLAME/SMOKE INDEX OF NO MORE THAN 25/50 IN ACCORDANCE W/ ASTM E 84.

- C. MC CABLE ACCEPTABLE FOR BRANCH CONVENIENCE CIRCUITS AND LIGHTING CIRCUITS. DO NOT DAISY CHAIN LIGHT FIXTURES. PROVIDE MC LUMINARY CABLE WITH BUILT-IN TWISTED JACKETED PAIR FOR LIGHTING CIRCUITS FOR LIGHTING CONTROLS. PROVIDE HEALTH CARE RATED MC FOR MEDICAL TREATMENT AREAS WHEN NOT IN CONDUIT D. CONDUIT INSTALLED BELOW GRADE SHALL BE SCHEDULE 80 PVC HEAVY WALL PLASTIC
- USE. PROVIDE GRS RADIUS BENDS & RISERS AS CONDUITS RISE ABOVE GRADE OR ABOVE FLOOR SLAB. E. PROVIDE INTERLOCKING SPACERS FOR MULT RUNS OF UG CONDUITS IN SAME TRENCH. F. LIGHTING & RECEPTACLE CIRCUIT CONDUCTORS SHALL BE COPPER THWN/THHN 600 VOLT. 75 DEG C. COLOR CODED AS DESCRIBED UNDER APPLICABLE CODES. NO ROMEX, PLASTIC FLEX TUBING ETC PERMITTED. LIGHT FIXTURE WIRE INSULATION

SHALL HAVE TEMP RATING NOT LESS THAN INDIVIDUAL FIXTURE MANUF RECOMMENDED

CONDUIT MEETING NEMA STANDARDS & UL LISTED FOR UNDERGROUND & EXPOSED

- G. CIRCUITS W/ NO. 8 OR LARGER CONDUCTORS, MOTOR CIRCUITS, POWER & FEEDER CIRCUITS & BUILDING SERVICE FEEDERS SHALL BE COPPER THWN/THHN 600 VOLT,
- H. ALL CONDUIT, JUNCTION BOXES, ETC. ABOVE CEILINGS SHALL BE SUPPORTED FROM STRUCTURE. PIPE SLEEVES, HANGERS & SUPPORTS SHALL BE FURNISHED & SET & CONTRACTOR SHALL BE RESPONSIBLE FOR PROPER & PERMANENT LOCATIONS.

## A. SUPPLEMENT GROUNDED NEUTRAL OF SECONDARY DISTRIBUTION SYSTEM W/ EQUIPMENT GROUNDING SYSTEM. INSTALLED SO THAT METALLIC STRUCTURES FNCLOSURES. RACEWAYS. JUNCTION BOXES. OUTLET BOXES. CABINETS. MACHINE FRAMES. PORTABLE EQUIPMENT & OTHER CONDUCTIVE ITEMS OPERATE CONTINUOUSLY

B. SYSTEM SHALL COMPLY W/ NATIONAL ELECTRICAL CODE. DRAWINGS & AS SPECIFIED. C. PROVIDE EQUIPMENT GROUND BUS IN BASE OF LOW VOLTAGE, SWITCHGEAR BRAZED OR OTHERWISE ADEQUATELY CONNECTED BY AN APPROVED METHOD TO GROUND RODS D. PROVIDE IN CONDUIT GREEN INSULATED COPPER GROUND CONDUCTOR TO MAIN

AT GROUND POTENTIAL & PROVIDE LOW IMPEDANCE PATH FOR GROUND FAULT

- METALLIC WATER SERVICE ENTRANCE & CONNECT BY MEANS OF ADEQUATE GROUND E. EQUIPMENT GROUNDING CONDUCTORS FOR BRANCH CIRCUIT HOME RUNS SHOWN ON DRAWINGS SHALL INDICATE AN INDIVIDUAL & SEPARATE GROUND CONDUCTOR FOR THAT BRANCH CIRCUIT WHICH SHALL BE TERMINATED AT BRANCH CIRCUIT PANELBOARD,
- F. PROVIDE LOW VOLTAGE DISTRIBUTION SYSTEM W/ SEPARATE GREEN INSULATED EQUIPMENT GROUNDING CONDUCTOR FOR EACH SINGLE OR THREE-PHASE FEEDER.

SWITCHBOARD. OR OTHER DISTRIBUTION EQUIPMENT.

## SINGLE PHASE 120 VOLT BRANCH CIRCUITS FOR LIGHTING & POWER SHALL CONSIST OF PHASE & NEUTRAL CONDUCTORS & GREEN GROUND CONDUCTOR INSTALLED IN COMMON CONDUIT WHICH SHALL SERVE AS GROUNDING CONDUCTOR. G. GROUNDING CONDUCTORS SHALL BE AS SHOWN ON PLANS OR IF NOT SPECIFICALLY

SHOWN SHALL BE NO SMALLER THAN THAT REQUIRED BY NEC.

A. JUNCTION BOXES & OUTLET BOXES SHALL BE GALVANIZED KNOCKOUT TYPE. LIGHTING FIXTURE BOXES IN CEILINGS SHALL NOT BE LESS THAN 4" OCTAGONAL KNOCKOUT TYPE. OUTLETS SHALL BE INSTALLED IN LOCATIONS SHOWN ON DRAWINGS EXCEPT OUTLETS MAY BE MOVED 4 FEET IN EITHER DIRECTION IF SO DIRECTED, WITHOUT ADDITIONAL COST. BOXES SHALL BE FLUSH MOUNTED ON WALLS FOR CONCEALED WORK. GANGABLE BOXES SHALL BE USED IN ALL GYPBOARD SURFACES.

- A. BRANCH CIRCUIT 208/240V PANELS SHALL BE CAPACITY SHOWN W/ TIN PLATED COPPER BUSSING & BRACED FOR MINIMUM OF 22,000A AIC OR AS OTHERWISE NOTED OR REQUIRED (SERIES RATED ACCEPTABLE). BOLT ON CIRCUIT BREAKERS. 480V PANELS SAME EXCEPT 25,000A AIC MIN. MINIMUM 20" WIDE W/ GALV STEEL ENCLOSURE W/ HINGED DOOR & KEYED LOCK. COORD TRIM WITH MOUNTING
- LOCATION. PANELS TO BE RECESSED WHENEVER POSSIBLE. B. DISTRIBUTION PANELS SHALL BE CAPACITY SHOWN & SHALL BE SQUARE D I—LINE W/ TIN PLASTED COPPER BUSSING. 65KAIC MIN OR AS OTHERWISE NOTED/REQ'D. BOLT ON CIRCUIT BREAKERS (SERIES RATED ACCEPTABLE). GALV STEEL ENCLOSURE. C. EQUIVALENT BY SQUARE D, SIEMENS, CUTLER HAMMER, OR GE.

## <u> SECTION 16350 — ELECTRICAL IDENTIFICATION</u> A. MANUFACTURED LABELS FOR EACH PANELBOARD & TRANSFORMER. TYPEWRITTEN PANEL

- SCHEDULES MOUNTED IN PANELS B. PRINTED TAPE STYLE LABEL FOR EACH RECEPTACLE INDICATING PANEL & CIRCUIT #
- C. MANUFACTURED LABELS FOR ALL DISCONNECT SWITCHES INDICATING EQUIPMENT D. BRANCH CIRCUITS - IDENTIFY EACH CIRCUIT W/ WIRE MARKERS WHEN ENCLOSURE
- LABEL AND WIRE COLORS DO NOT PROVIDE ENOUGH INFORMATION TO IDENTIFY EACH CIRCUIT WITHOUT TRACING. FEEDERS & BRANCH CIRCUIT HOME RUNS W/ WIRE MARKER W/ PANEL & CKT #. BOX COVERS ABOVE LAY-IN CEILINGS NEATLY MARKED W/ INDELIBLE MARKER.

# SECTION 16400 — WIRING DEVICES

- A. CONVENIENCE OUTLETS SPEC GRADE 20 AMP DUPLEX W/ GROUND & SS WALL PLATES. OTHER OUTLETS SHALL BE VERIFIED W/ EQUIPMENT SUPPLIERS FOR PROPER NEMA CONFIGURATIONS. PROVIDE GFIC RATED DEVICES WHERE INDICATED AND AS REO'D PER CODE.
- B. PROVIDE GFIC RATED DEVICES WHERE INDICATED AND ANYWHERE REQUIRED PER THE
- C. PROVIDE AFCI PROTECTION ON ALL CIRCUITS REQUIRED PER THE NEC. D. PROVIDE TAMPER RESISTANT RECEPTACLES ON ALL RECEPTACLES IN PUBLIC AREAS, AREAS ACCESSIBLE TO CHILDREN, AND WHERE OTHERWISE REQUIRED TO BE TAMPER RESISTANT PER THE NEC.
- E. LIGHT SWITCHES SPEC GRADE 20 AMP TOGGLE SWITCHES W/ SS WALL PLATES. F. WALL MOTION SWITCHES — SPEC GRADE, PIR, OVERRIDE. G. CEILING MOTION SWITCHES - SPEC GRADE, DUAL TECHNOLOGY, MODEL AS REQ'D BY ROOM CONFIGURATION, ALL NECESSARY POWER PACKS AND RELAYS. H. WALL MOTION SWITCHES (BATHROOM) — DUAL RELAY, SPEC GRADE, PIR, 2ND RELAY
- COLOR OF DEVICES AS DIRECTED BY ARCHITECT. J. EQUIVALENT DEVICES BY LEVITON, BRYANT, HUBBEL, WATTSTOPPER, LITHONIA, SENSOR

A. ALL OUTLETS, SHALL BE MOUNTED W/ BOTTOM AT 18" AFF & SWITCHES W/ BOTTOM AT 44" ABOVE FINISHED FLOOR UNLESS NOTED OTHERWISE ON PLANS. REFER TO ARCH FOR OTHER REQUIRED ELEVATIONS AND CABINETRY COORDINATION.

# <u>SECTION 16500 — LED LUMINAIRES</u>

FOR OPERATION OF EXHAUST FAN DELAY.

A. PROVIDE LIGHTING FIXTURES W/ ALL ACCESSORIES REQ'D FOR HANGING. COORD MOUNTING OF LIGHTING FIXTURES W/ ARCHITECT & G/C. ADDITIONAL FIXTURE SUPPORTS SHALL BE PROVIDED BY E/C. SUPPORTS SHALL COMPLY W/ LATEST EDITION OF NEC. PROVIDE LIGHTING FIXTURE SECURING CLIPS AS REQUIRED. CONSULT ARCH PLANS FOR CEILING TYPES & PROVIDE SURFACE & RECESSED LIGHTING FIXTURES W/ APPROPRIATE MOUNTING COMPONENTS & ACCESSORIES. B. REFER TO LIGHTING FIXTURE SCHEDULE PLANS FOR FIXTURE TYPES. C. EQUIVALENT LUMINAIRES BY CREE, COOPER, HUBBELL, INFINITY, LITHONIA, WILLIAMS,

# **ABBREVIATIONS**

DHW DOMESTIC HOT WATER

E/C ELECTRICAL CONTRACTOR

EM EMERGENCY FIXTURE/DEVICE

DIA DIAMETER

EA EXHAUST AIR

ELEV ELEVATION

DN DOWN

DHWR DOMESTIC HOT WATER RETURN

COLUMBIA, EXITRONICS, LITEALARM, EXIDE, MULE, DUALLITE

EWT ENTERING WATER TEMPERATURE PSI POUNDS PER SQUARE INCH EX EXISTING ITEM PVC POLYVINYLCHLORIDE AFF ABOVE FINISHED FLOOR ra return air FFA FROM FLOOR ABOVE AFG ABOVE FINISHED GRADE FFB FROM FLOOR BELOW RE/REF REFER / REFERENCE AG ABOVE GRADE FFCO FINISHED FLOOR CLEAN OUT AHJ AUTHORITY HAVING JURISDICTION RF RELIEF FAN FGCO FLUSH GRADE CLEAN OUT RELOCATED ITEM ARCH ARCHITECT RPZ REDUCED PRESSURE ZONE BFP BACKFLOW PREVENTER FL FLOW LINE FLR FLOOR RR RESTROOM BG BELOW GRADE FPM FEET PER MINUTE BLDG BUILDING SA SUPPLY AIR BMS BUILDING MANAGEMENT SYSTEM SPD SURGE PROTECTIVE DEVICE FWCO FLUSH WALL CLEAN OUT G GROUND / GANG TA TRANSFER AIR CONDUIT CD CANDELA TFA TO FLOOR ABOVE G/C GENERAL CONTRACTOR COLD DECK GFCI GROUND FAULT CIRCUIT INTERUPTER TFB TO FLOOR BELOW CLG COOLING TAMPERPROOF GPM GALLONS PER MINUTE CM COORDINATE MOUNTING HEIGHT TYPICAL HD HOT DECK CO CLEAN OUT HTG HEATING UNO UNLESS NOTED OTHERWISE CTE CONNECT TO EXISTING VTR VENT THROUGH ROOF IG ISOLATED GROUND DCVA DOUBLE CHECK VALVE ASSEMBLY JB JUNCTION BOX WP WEATHERPROOF DCW DOMESTIC COLD WATER LED LIGHT EMITTING DIODE DDC DIRECT DIGITAL CONTROLS LWT LEAVING WATER TEMPERATURE DF DRINKING FOUNTAIN

M/C MECHANICAL CONTRACTOR

MCB MAIN CIRCUIT BREAKER

ORD OVERFLOW ROOF DRAIN

P/C PLUMBING CONTRACTOR

MECH MECHANICAL

MLO MAIN LUGS ONLY

NFA NET FREE AREA

OA OUTSIDE AIR

MH MANHOLE

# **ELECTRICAL SYMBOL LEGEND**

SURFACE PANELBOARD

RECESSED PANELBOARD

INDICATES ELEVATION

ENERAL SYMBOLS


<u>₩C−1</u>

(Ô) <u>RD-1</u>

DISTRIBUTION PANELBOARD

SWITCHBOARD. FEEDER/MAIN CIRCUIT BREAKER

SECTION AND DISTRIBUTION SECTION.

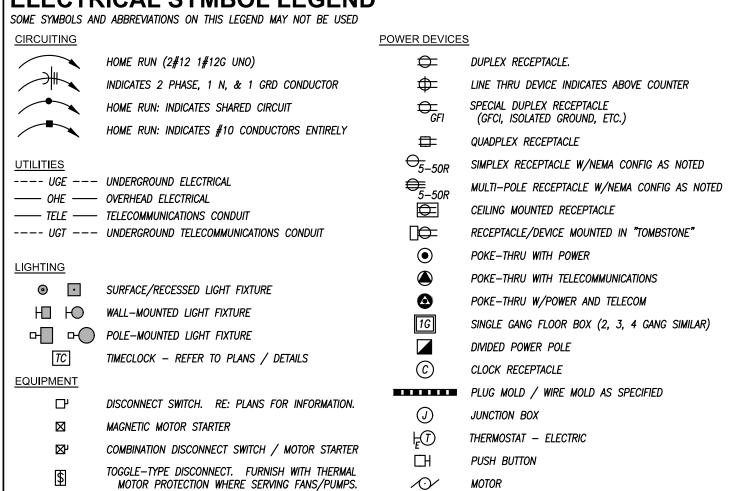


INDICATES CONNECT TO EXISTING

FIRE ALARM

DUCT SMOKE DETECTOR



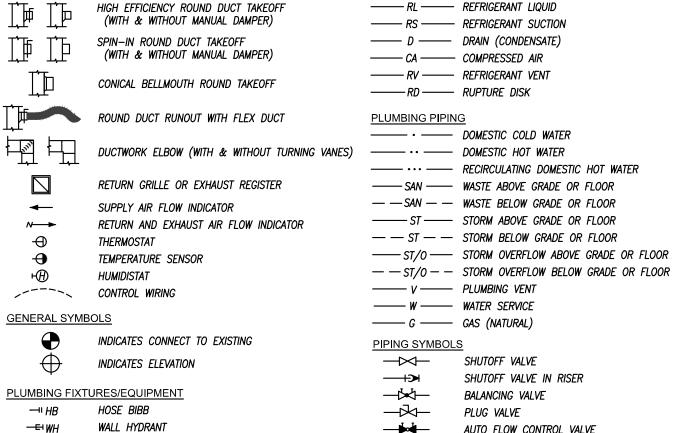

WALL HYDRANT AUTO FLOW CONTROL VALVE CLEAN OUT **─**─ □ PIPING ELBOW UP —ю REDUCED PRESSURE BACKFLOW PREVENTER PIPING ELBOW DOWN DOUBLE CHECK BACKFLOW PREVENTER PIPING TEE PIPING ELBOW PLUMBING FIXTURE AND CALLOUT PIPING TEE UP FD: FLOOR DRAIN, AD: AREA DRAIN, **⊜ □** <u>FD-1</u> PIPING TEE DOWN FS: FLOOR SINK INCREASER / REDUCER —₩ RD: ROOF DRAIN UNION ---ORD: OVERFLOW ROOF DRAIN CAP **→** PIPE FLEX STRAINER <del>- |>| -</del> CHECK VALVE

INLINE STRAINER TEST PLUG PIPING SPECIALTIES

**─**/**↑** 

HI LOW
PRESSURE REDUCING VALVE

里 R 0 S

Z W

schwerdt design group

architecture|interiors|planning

2231 sw wanamaker rd suite 303 topeka, kansas 66614-4275 phone: 785.273.7540

BRYAN

LEINWETTER

NUMBER

PE-2020020297

suite 200

ax: 785.273.7579

ax: 405.231.3115

500 north broadway oklahoma city, ok 73102

SUBMISSION DATES MAY 23, 2023 JUNE 12, 2023-REV 1 JULY 7, 2023-ASI 2

SHEET TITLE MECHANICAL AND ELECTRICAL SPECIFICATIONS

PROJECT NUMBER 230117

SHEET NUMBER

PEARSON KENT MCKINLEY RAAF ENGINEERS LI 2949 SW WANAMAKER DR., TOPEKA, KANSAS 66614 785.273.2447

3

5

# FIRE SEALING NOTES

- 1. COORDINATE CONSTRUCTION OF OPENINGS AND PENETRATING ITEMS TO ENSURE THAT THROUGH-PENETRATION FIRESTOP SYSTEMS ARE INSTALLED ACCORDING TO SPECIFIED AND APPLICABLE UL 2. COORDINATE SIZING OF SLEEVES, OPENINGS, CORE-DRILLED HOLES,
- OR CUT OPENINGS TO ACCOMMODATE THROUGH-PENETRATION 3. DO NOT COVER UP THROUGH-PENETRATION FIRESTOP SYSTEM
- INSTALLATIONS UNTIL EXAMINED BY NSPECTOR, IF REQUIRED BY AUTHORITIES HAVING JURISDICTION.
- 4. COMPATIBILITY: PROVIDE THROUGH—PENETRATION FIRESTOP SYSTEMS THAT ARE COMPATIBLE WITH ONE ANOTHER; WITH THE SUBSTRATES FORMING OPENINGS; AND WITH THE ITEMS, IF ANY. PENETRATING THROUGH-PENETRATION FIRESTOP SYSTEMS, UNDER CONDITIONS OF SERVICE AND APPLICATION, AS DEMONSTRATED E THROUGH-PENETRATION FIRESTOP SYSTEM MANUFACTURER BASED ON TESTING AND FIELD EXPERIENCE.
- 5. PROVIDE COMPONENTS FOR EACH THROUGH-PENETRATION FIRESTOP SYSTEM THAT ARE NEEDED TO INSTALL FILL MATERIALS. USE ONLY COMPONENTS SPECIFIED BY THROUGH—PENETRATION FIRESTOP SYSTEM MANUFACTURER AND APPROVED BY QUALIFIED TESTING AND INSPECTING AGENCY FOR FIRESTOP SYSTEMS INDICATED.
- 6. PROVIDE SLEEVES THROUGH ALL FIRE\_RATED WALLS AND FILL VOIDS SURROUNDING SLEEVES AND INTERIOR TO SLEEVES AROUND PIPING WITH FIRE STOP PUTTY WITH U.L. LISTED 3 HOUR RATING INSTALLED AS PER MANUFACTURERS RECOMMENDATIONS.
- 7. FIRE SEAL ALL PIPING, CONDUIT, CABLE, ETC PENETRATIONS ROUTED THROUGH FIRE RATED WALLS. 8. PROVIDE FIRE RATED ENCLOSURES OR WRAPS ON LIGHT FIXTURES

# **GENERAL ELECTRICAL NOTES**

AND OTHER ITEMS PENETRATING FIRE RATED CEILINGS,

FLOOR/CEILING/ CEILING/ROOF ASSEMBLIES TO MAINTAIN UL LISTING

1. COMPLETE INSTALLATION SHALL BE IN ACCORDANCE WITH THE LATEST ADOPTED VERSION OF THE NATIONAL ELECTRICAL CODE,

LOCAL AND STATE CODES, AND REQUIREMENTS OF THE AHJ.

- 2. COORDINATE LOCATIONS OF RECEPTACLES, SWITCHES, ETC. WITH ARCHITECTURAL CASEWORK AND FLEVATIONS 3. REFER TO MOUNTING HEIGHTS DETAIL FOR MOUNTING HEIGHTS OF
- ALL DEVICES NOT INDICATED OTHERWISE. 4. PROVIDE ALL EMPTY CONDUITS WITH PULL STRINGS AND BUSHED
- 5. CONTRACTOR SHALL CONCEAL ALL CONDUIT, FITTINGS, AND DEVICES FROM VIEW WHERE REASONABLY POSSIBLE.

# **GENERAL NOTES**

FOR CONSTRUCTION.

- 1. SOME ROOM NAMES MAY NOT BE SHOWN FOR PURPOSE OF CLARIFYING PLAN. REFER TO ARCHITECTURAL PLANS FOR REFERENCE TO ROOM NAMES NOT SHOWN.
- 2. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO MAINTAIN AND KEEP AT THE JOB SITE, AN UP TO DATE SET OF "RECORD DRAWINGS" SHOWING ALL CHANGES FROM THE ORIGINAL PLANS. THE CONTRACTOR SHALL DELIVER THE "RECORD DRAWINGS" TO THE ENGINEER AT THE CONCLUSION OF THE PROJECT ELECTRONICALLY.
- 3. THESE DRAWINGS ARE DIAGRAMMATIC. THE CONTRACTOR SHALL VERIFY ALL CONDITIONS (NEW AND EXISTING), DIMENSIONS, AND CLEARANCES PRIOR TO THE COMMENCEMENT OF WORK AND SHALL INCLUDE ALL COSTS, EQUIPMENT, MATERIAL, ACCESSORIES, ETC. REQUIRED FOR A FULLY COMPLETE, FUNCTIONAL AND CODE COMPLIANT INSTALLATION.
- 4. FINAL LOCATIONS OF ALL DEVICES, LIGHT FIXTURES, EQUIPMENT ETC SHALL BE INDICATED ON THE ARCHITECTURAL DRAWINGS. ALL DIMENSIONAL INFORMATION SHALL BE OBTAINED FROM ARCHITECTURAL PLANS. NO DIMENSIONAL INFORMATION SHALL BE OBTAINED FROM MEP DRAWINGS.
- 5. THE CONTRACTOR SHALL OBTAIN ALL REQUIRED PERMITS, APPROVALS, LICENSES, ETC. AS NEEDED FOR THE COMPLETE INSTALLATION AND PROJECT. THE CONTRACTOR SHALL COORDINATE WITH THE OWNER FOR ALL FEES AND DATA NEEDED FOR THIS.

# **GEN. MECHANICAL NOTES**

- 1. COMPLETE INSTALLATION SHALL BE IN ACCORDANCE WITH THE LATEST ADOPTED VERISION OF THE INTERNATIONAL MECHANICAL CODE, LOCAL AND STATE CODES, AND REQUIREMENTS OF THE AHJ. 2. ANY POWER FOR CONTROL SYSTEMS TO BE PROVIDED BY E/C IS INDICATED ON ELECTRICAL PLANS. ANY ADDITIONAL LINE VOLTAGE OR LOW VOLTAGE POWER REQUIRED BY THE M/C OR SUBCONTRACTORS TO HAVE A FULLY FUNCTIONING SYSTEM SHALL BE
- PROVIDED BY THE M/C CONTRACTOR OR SUBS. 3. ALL EQUIPMENT SHALL BE ADEQUATELY AND PROPERLY SUPPORTED AND FASTENED FROM STRUCTURE. 4. ALL EQUIPMENT AND ACCESSORIES INSTALLED IN CONCEALED SPACES
- REQUIRING ACCESS SHALL BE PROVIDED WITH ACCESS DOORS MEETING ANY FIRE REQUIREMENTS OF THE WALL/CEILING THEY ARE INSTALLED. 5. EACH AIR HANDLING UNIT OVER 2000CFM SHALL BE PROVIDED WITH
- A SMOKE DETECTOR TO SHUT DOWN THE UNIT PER IMC 606 AS REQUIRED BY AHJ. COORDINATE WITH OTHER TRADES. 6. START UP AND ADJUST ALL EQUIPMENT AND VERIFY ALL MECHANICAL SYSTEMS IN OPERATE IN ACCORDANCE WITH THEIR INTENDED

REFER TO SPECIFICATIONS FOR ANY ADDITIONAL REQUIREMENTS.

PURPOSES. SUBMIT BALANCE AND START UP REPORTS TO THE A/E.

# **GENERAL PLUMBING NOTES**

- COMPLETE INSTALLATION SHALL BE IN ACCORDANCE WITH THE LATEST ADOPTED VERISION OF THE INTERNATIONAL PLUMBING CODE, LOCAL AND STATE CODES, AND REQUIREMENTS OF THE AHJ.
- 2. NO PIPING SHALL BE INSTALLED WHERE IT WILL SUBJECT TO FREEZING TEMPERATURES. PIPING IN EXTERIOR WALLS SHALL BE INSTALLED ON THE WARM SIDE OF BUILDING INSULATION. INSULATED AND THE CHASE SHALL BE VENTILATED WITH GRILLES ALLOWING INDOOR AMBIENT CONDITIONS TO CIRCULATE THROUGH THE CHASE. 3. PROVIDE CLEANOUTS IN THE FOLLOWING LOCATIONS:
- 3.1. IN ALL HORIZONTAL DRAINS (WITHIN THE BUILDING) NOT MORE THAN 100 FEET APART.
- 3.2. IN BUILDING SEWERS LOCATED NO MORE THAN 100 FEET APART MEASURED FROM THE UPSTREAM ENTRANCE OF THE CLEANOUT. 3.3. EACH CHANGE OF DIRECTION OF THE BUILDING DRAIN OR HORIZONTAL WASTE OR SOIL LINES GREATER THAN 45 DEGREES.WHERE MORE THAN ONE CHANGE OF DIRECTION OCCURS IN A RUN OF PIPING, ONLY ONE CLEANOUT SHALL BE REQUIRED
- FOR EACH 40 FEET OF DEVELOPED LENGTH OF THE DRAINAGE 3.4. AT THE BASE OF EACH WASTE OR SOIL STACK.
- 3.5. NEAR THE JUNCTION OF THE BUILDING DRAIN AND BUILDING

# **COORDINATION NOTES**

- 1. COORDINATE REQUIREMENTS FOR INSTALLATION OF SYSTEMS AND EQUIPMENT WITH ALL OTHER TRADES. 2. THE CONTRACTOR SHALL COORDINATE THE ROUTING AND PATH OF
- ALL SYSTEMS, CONDUITS, PIPES, DUCTS, ETC WITH THE POSITION AND LAYOUT OF THE STRUCTURE. THE CONTRACTOR IS RESPONSIBLE FOR PROVIDING NECESSARY OFFSETS, TURNS, RISES AND DROPS FOR SYSTEMS AND COMPONENTS AS NEEDED TO INSTALL THE MEP SYSTEMS TO CLEAR STRUCTURE, CEILINGS, ETC AND OTHER SYSTEMS IN POTENTIAL CONFLICT WITH ROUTING.
- 3. COORDINATE WORK WITH OTHER TRADES TO INSTALL SYSTEMS ABOVE CEILING HEIGHTS INDICATED ON ARCHITECTURAL PLANS.
- 4. CHECK SPACE REQUIREMENTS WITH OTHER TRADES AND STRUCTURE/CONSTRUCTION TO INSURE THAT ALL MATERIALS AND EQUIPMENT CAN BE INSTALLED IN THE SPACE ALLOTTED INCLUDING FINISHED SUSPENDED CEILINGS AND OTHER SPACES, CHASES, ETC WITHIN THE BUILDING. MAKE MODIFICATIONS THERETO AS REQUIRED AND APPROVED.
- 5. TRANSMIT TO OTHER TRADES ALL INFORMATION REQUIRED FOR WORK TO BE PROVIDED UNDER THEIR RESPECTIVE SECTIONS IN AMPLE TIME FOR INSTALLATION.
- 6. WHEREVER WORK INTERCONNECTS WITH WORK OF OTHER TRADES, COORDINATE WITH THOSE TRADES TO INSURE THAT ALL SUBCONTRACTORS HAVE THE INFORMATION NECESSARY SO THAT THEY MAY PROPERLY INSTALL ALL CONNECTIONS AND EQUIPMENT. IDENTIFY ALL ITEMS OF WORK THAT REQUIRE ACCESS SO THAT THE CEILING TRADE WILL KNOW WHERE TO INSTALL ACCESS DOORS AND
- 7. COORDINATE, PROJECT AND SCHEDULE WORK WITH OTHER TRADES IN ACCORDANCE WITH THE CONSTRUCTION SEQUENCE.
- 8. DRAWINGS SHOW THE GENERAL RUNS OF CONDUITS, PIPING AND DUCTWORK AND APPROXIMATE LOCATION OF OUTLETS. ANY SIGNIFICANT CHANGES IN LOCATION OF ITEMS NECESSARY IN ORDER TO MEET FIELD CONDITIONS SHALL BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE ARCHITECT/ENGINEER AND RECEIVE HIS APPROVAL BEFORE SUCH ALTERATIONS ARE MADE. ALL SUCH MODIFICATIONS SHALL BE MADE WITHOUT ADDITIONAL COST TO THE OWNER.
- 9. CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTION AND REPAIR OF SURFACES, AREAS AND PROPERTY THAT MAY BE DAMAGED AS A RESULT OF CONSTRUCTION ACTIVITIES. 10. ADJUST LOCATION OF PIPING, DUCTWORK, ETC. TO PREVENT
- INTERFERENCES, BOTH ANTICIPATED AND ENCOUNTERED. DETERMINE THE EXACT ROUTE AND LOCATION OF EACH ITEM PRIOR TO FABRICATION. MAKE OFFSETS, TRANSITIONS AND CHANGES IN DIRECTION IN SYSTEMS AS REQUIRED TO MAINTAIN ADEQUATE CLEARANCES AND HEADROOM.
- 11. WHEREVER THE WORK IS OF SUFFICIENT COMPLEXITY, PREPARE ADDITIONAL COORDINATION DRAWINGS AND ORGANIZE ON-SITE MEETINGS WITH ALL RELATED SUBCONTRACOTRS TO COORDINATE THE WORK BETWEEN TRADES . DRAWINGS SHALL CLEARLY SHOW THI WORK AND ITS RELATION TO THE WORK OF OTHER TRADES, AND BE SUBMITTED FOR REVIEW PRIOR TO COMMENCING SHOP FABRICATION OR ERECTION IN THE FIELD.
- 12. COORDINATE WITH LOCAL UTILITY PROVIDERS FOR THEIR REQUIREMENTS FOR SERVICE CONNECTIONS AND PROVIDE ALL NECESSARY PAYMENTS, MATERIALS, LABOR AND TESTING TO ACCOMPLISH THE WORK.

**∕**LIGHT POLE

LIGHT FIXTURE

FINISHED PAVEMENT


TOP OF PIER ELEV


TO PIER TIES

**−**(8) #5 VERT EQ SPA

**└**#4 TIES @16 OC

UNDISTURBED EARTH OR COMPACTED STRUCTURAL FILL

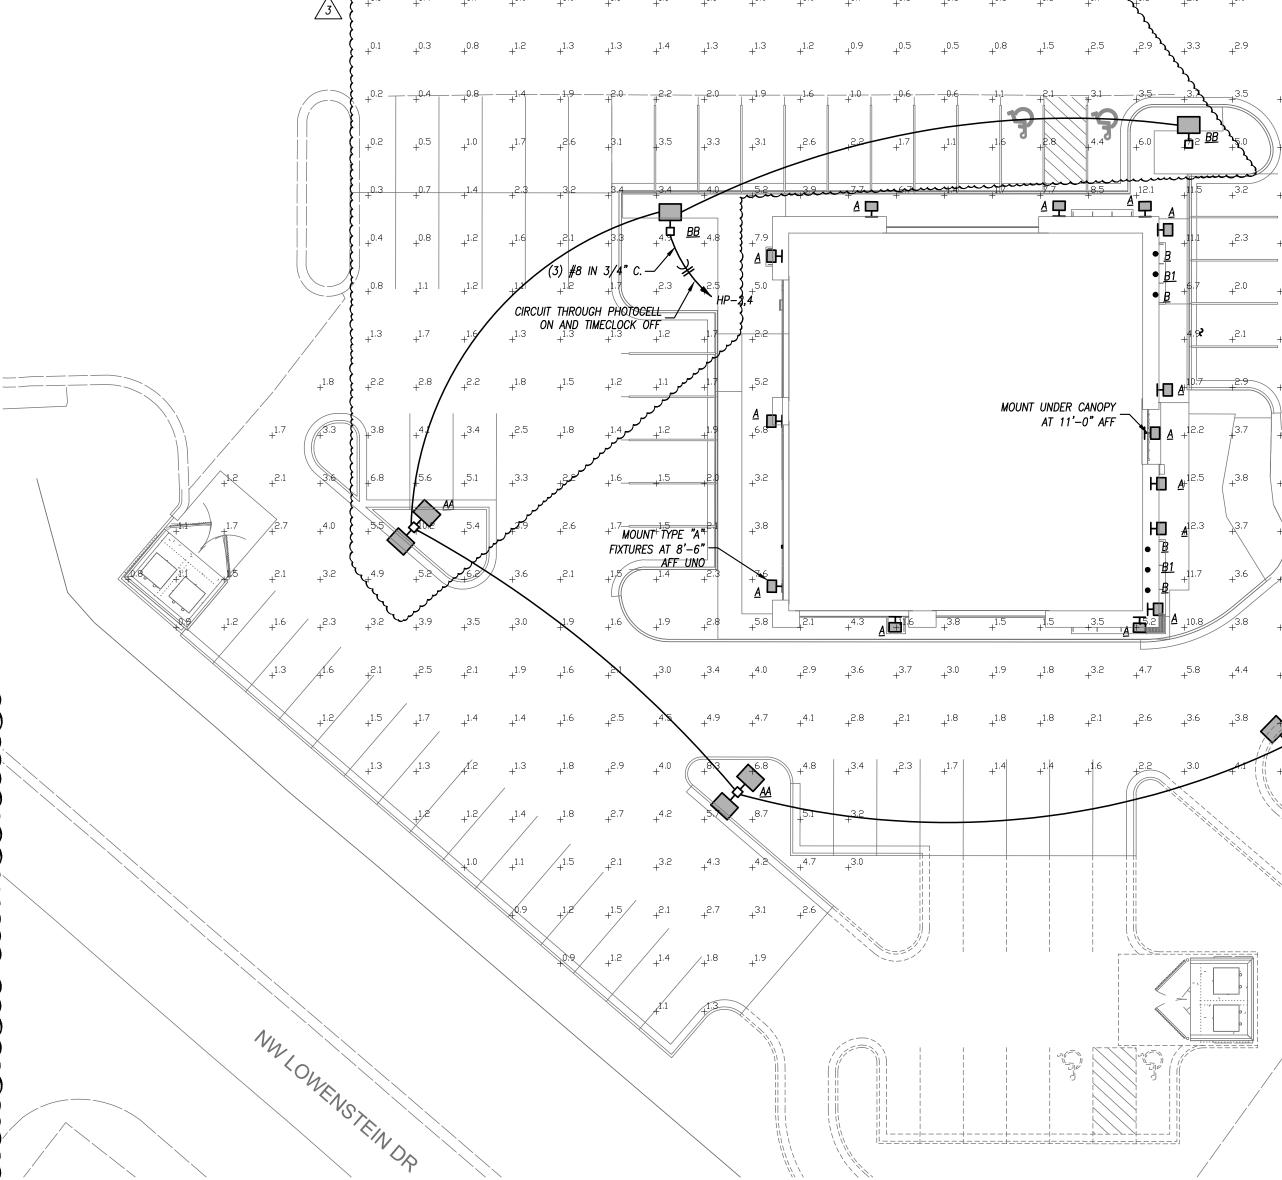

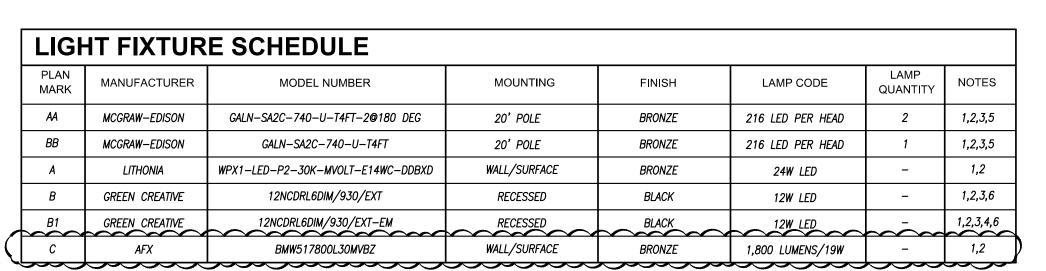

2'-0''Ø

1 - PROVIDE WET LOCATION RATED FIXTURE

2 - PROVIDE COLD LOCATION RATED DRIVER 3 - PROVIDE SQUARE STRAIGHT STEEL POLE RATED FOR 100 MPH WIND GUSTS, PRIMED AND PAINTED TO MATCH FIXTURE 4 - PROVIDE EMERGENCY BATTERY

ANCHOR BOLT, BY-LIGHT POLE SUPPLIER

(8) #5 VERT EQ SPA -

#4 TIES @12 OC —

TYPICAL LIGHT POLE BASE DETAIL

5 - PROVIDE ALL ACCESSORIES FOR A COMPLETE INSTALLATION.

6 - PROVIDE WEATHER PROOF JUNCTION BOX FOR DRIVERS AND ELECTRICAL CONNECTIONS ABOVE SOFFIT.

S


SITE PLAN - LIGHTING

SCALE: 1" = 20'-0"





architecture interiors planning 2231 sw wanamaker rd suite 303 topeka, kansas 66614-4275 phone: 785.273.7540 ax: 785.273.7579 500 north broadway oklahoma city, ok 73102 phone: 405.231.3105 fax: 405.231.3115




6408 OURI S S 00

S 

SUBMISSION DATES MAY 23, 2023 JUNE 12, 2023-REV 1 / 1 JULY 7, 2023-ASI 2 /3\

SHEET TITLE SITE PHOTOMETRIC PLAN AND GENERAL NOTES

PROJECT NUMBER 230117

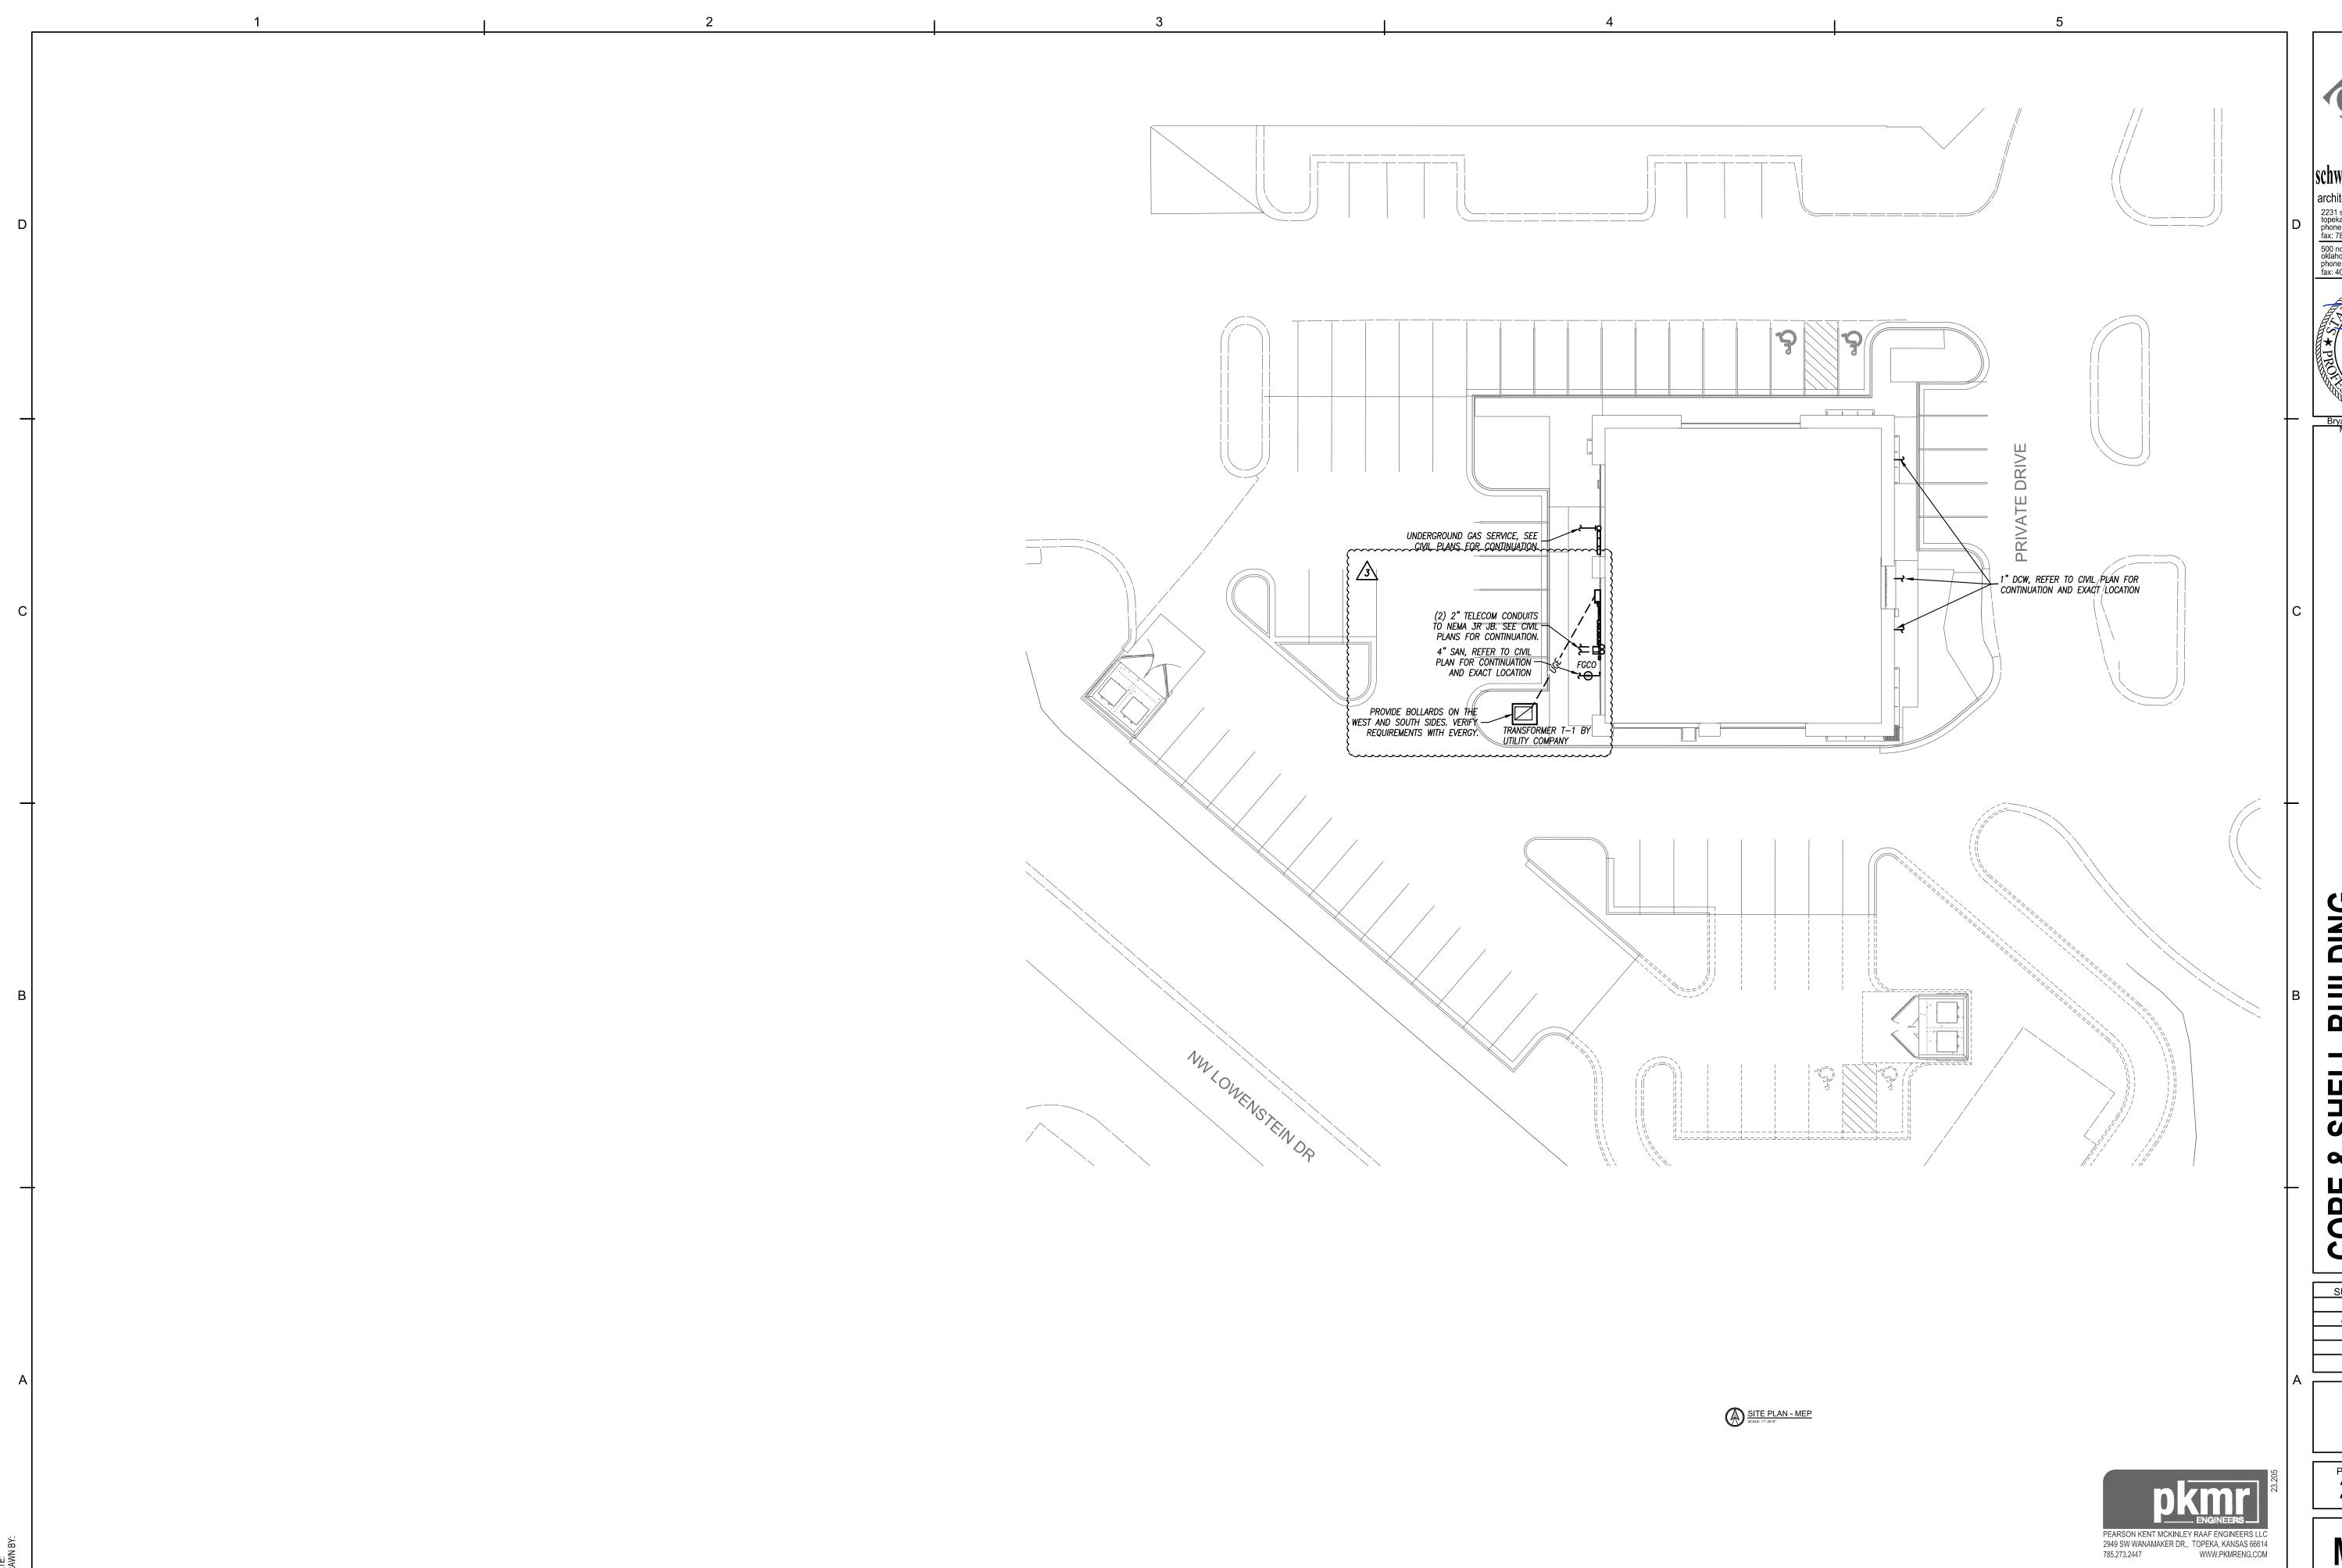

3



CORE & SHELL BUILDING

STREETS OF WEST PRYOR LOT 5

2070 NW LOWENSTEIN DR, LEES SUMMIT, JACKSON COUNTY, MISSOURI 64081

SUBMISSION DATES

MAY 23, 2023

JUNE 12, 2023-REV 1 1


JULY 7, 2023-ASI 2

SHEET TITLE SITE MEP PLAN


PROJECT NUMBER **230117** 

5

SHEET NUMBER
ME-202

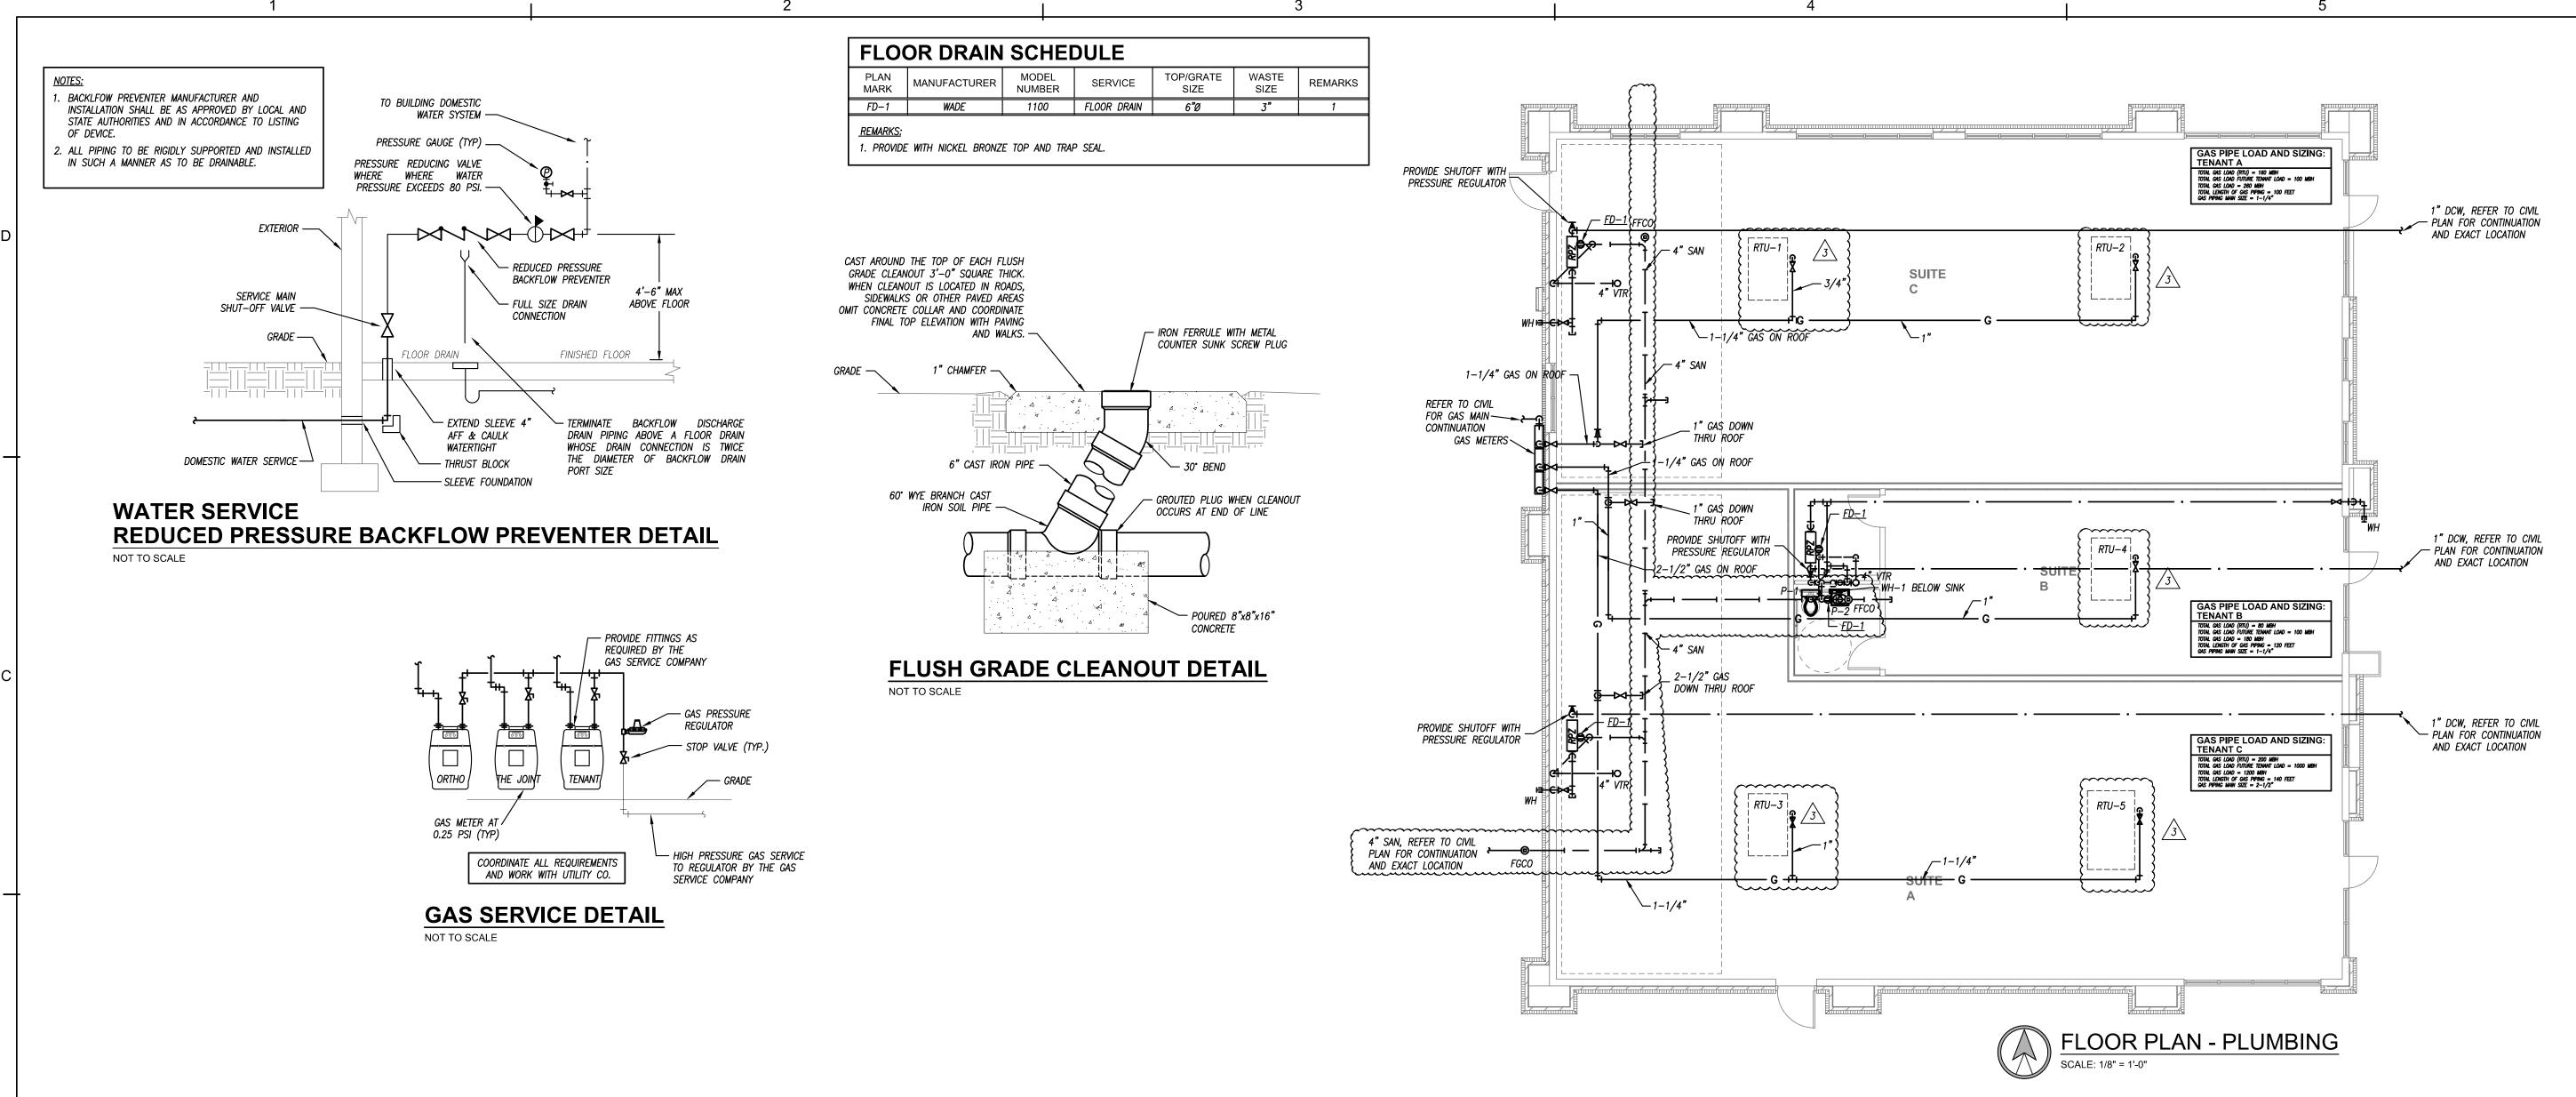

WATER HEATER SCHEDULE										
PLAN MARK	MANUFACTURER	MODEL NUMBER	GALLONS	CAPACITY	ELECTRICAL	NOTES				
WATER HEATER-1	STIEBEL ELTRON	DHC 3-1	INSTANTANEOUS	3.0 KW	120V, 1PH, 30AMP					

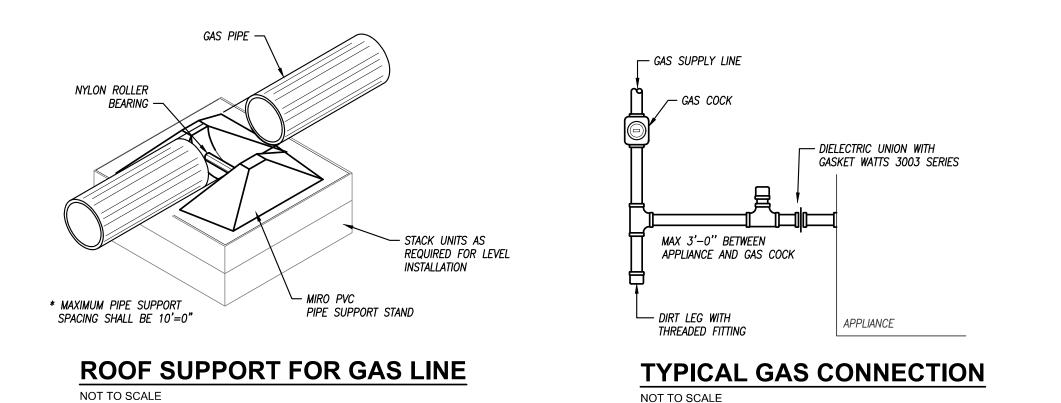

PIPING					FIELD TEST	ALLOWABLE IN	INSULA	TION
SYSTEM	SIZE	TYPE/SCHED	MATERIAL	ACCEPTABLE FITTINGS	PRESSURE/TIME	PLENUMS	TYPE	THICKNESS
DOMESTIC COLD WATER	1/2"-2-1/2"	L	COPPER	SOLDER, PRO-PRESS	130 PSI - 1/2HR	YES	FIBERGLASS W/ ASJ	1/2"
DOMESTIC HOT WATER & HW RETURN	1/2"-2-1/2"	L	COPPER	SOLDER, PRO-PRESS	130 PSI - 1/2HR	YES	FIBERGLASS W/ ASJ	1"
NATURAL GAS - ABOVE GRADE	2-1/2 & Up	SCH. <b>4</b> 0	STEEL- SEEMED	WELDED	75 PSI – 1HR	YES		
NATURAL GAS — ABOVE GRADE	1/2"-2"	SCH. 40	STEEL- SEEMLESS	THREADED IRON	75 PSI – 1HR	YES		
SOIL & WASTE BELOW GRADE	2"-8"	SCH. 40	PVC	SOLVENT JOINED	10 FT - 1/2HR	NO		
DOM. WATER SERVICE BELOW GRADE	4"-8"	AWWA C151	DUCTILE IRON	AWWA C111. MECH JOINTS	130 PSI - 1/2HR	YES		
DOM. WATER SERVICE BELOW GRADE	1"-3"	К	COPPER	CONTINUOUS TUBING, BRAZED	130 PSI - 1/2HR	YES		
DOM. WATER SERVICE BELOW GRADE	1"-3"	DR 9	HDPE	CONTINUOUS TUBING, FUSED	130 PSI - 1/2HR	NO		

1. ALL PIPING AND MATERIALS IN PLENUMS MUST MEET ASTM E84 FLAME/SMOKE RATING OF 25/50. 2. ALL INSULATION THICKNESSES SHALL MEET ASHRAE 90.1 - 2007 REQUIREMENTS AT A MINIMUM.

PLUMBING FIXTURE SCHEDULE												
PLAN	FIXTURE	FIXTURE DESCRIPTION	FITTINGS	FITTINGS DESCRIPTION		PIPE SIZES						
MARK MODEL		FIXTURE DESCRIPTION	MODEL	FITTINGS DESCRIPTION	WASTE	VENT	DCW	DHW				
P-1	TOTO DRAKE CST744SL	ADA COMPLIANT WATER CLOSET: FLUSH TANK, WHITE ELONGATED BOWL, 1.6 GALLON SIPHON JET FLUSHING SYSTEM, 2–1/8" TRAP DIAMETER, WITH POLISHED CHROME FLUSH HANDLE MOUNTED ON WIDE SIDE OF RESTROOM STALL, WITH HANDLE STOP VALVE AND METAL FLEXIBLE WATER RISER	TOTO SC534	SEAT: WHITE, SOLID PLASTIC, OPEN FRONT, ELONGATED	4"	2"	1/2"					
P-2	AMERICAN STANDARD 0355.012	LAVATORY: WHITE WALL HUNG LAVATORY 20"x18" WITH 4" BACK FAUCET HOLES ON 4" CENTERS, WITH CONCEALED ARM CARRIER. PROVIDE HANDLE STOP VALVES AND FLEXIBLE METAL WATER RISERS.	AMERICAN STANDARD 2175.504	FAUCET: 4" CENTERSET, CHROME FINISH WITH 4" METAL LEVER HANDLE, 1/2" CONNECTIONS, 1.5 GPM MAX FLOWRATE. CHROME PLATED BRASS GRID DRAIN, TAILPIECE, AND P-TRAP INSULATE THE TAILPIECE, P-TRAP, AND WATER RISERS	2"	2"	1/2"	1/2"				





64081

SOURI WEST R, LEES SUMN CORE & S STREE

SUBMISSION DATES MAY 23, 2023 JUNE 12, 2023-REV 1 JULY 7, 2023-ASI 2 3

SHEET TITLE PLUMBING FLOOR PLAN

PROJECT NUMBER 230117

SHEET NUMBER M-101


3

3. REFER TO SPECIFICATIONS FOR MORE DETAILED INFORMATION.

5


INSULATED CURB CAP – FLASH PIPE PENETRATION CAULKING - PREFABRICATED ROOF INSULATION CANT, FLASHING, AND ROOFING SUPPORT CHANNELS PIPE CLAMP -

# **ROOF PIPE CURB PENETRATION** NOT TO SCALE

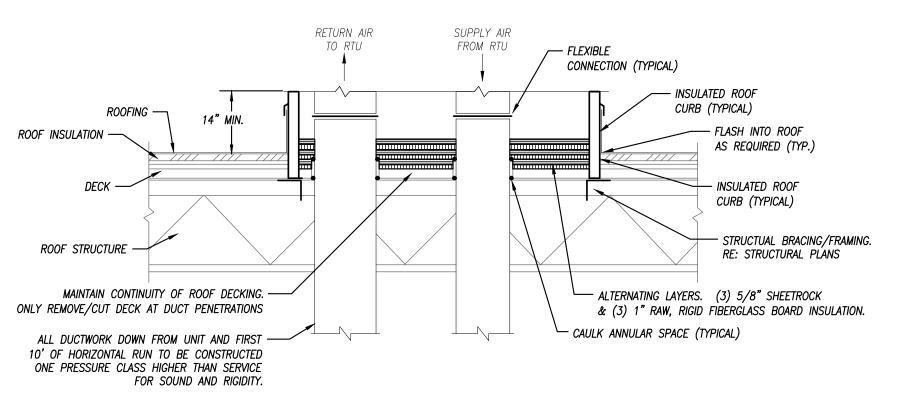

# ROOFTOP UNIT CURB DETAIL

NOT TO SCALE

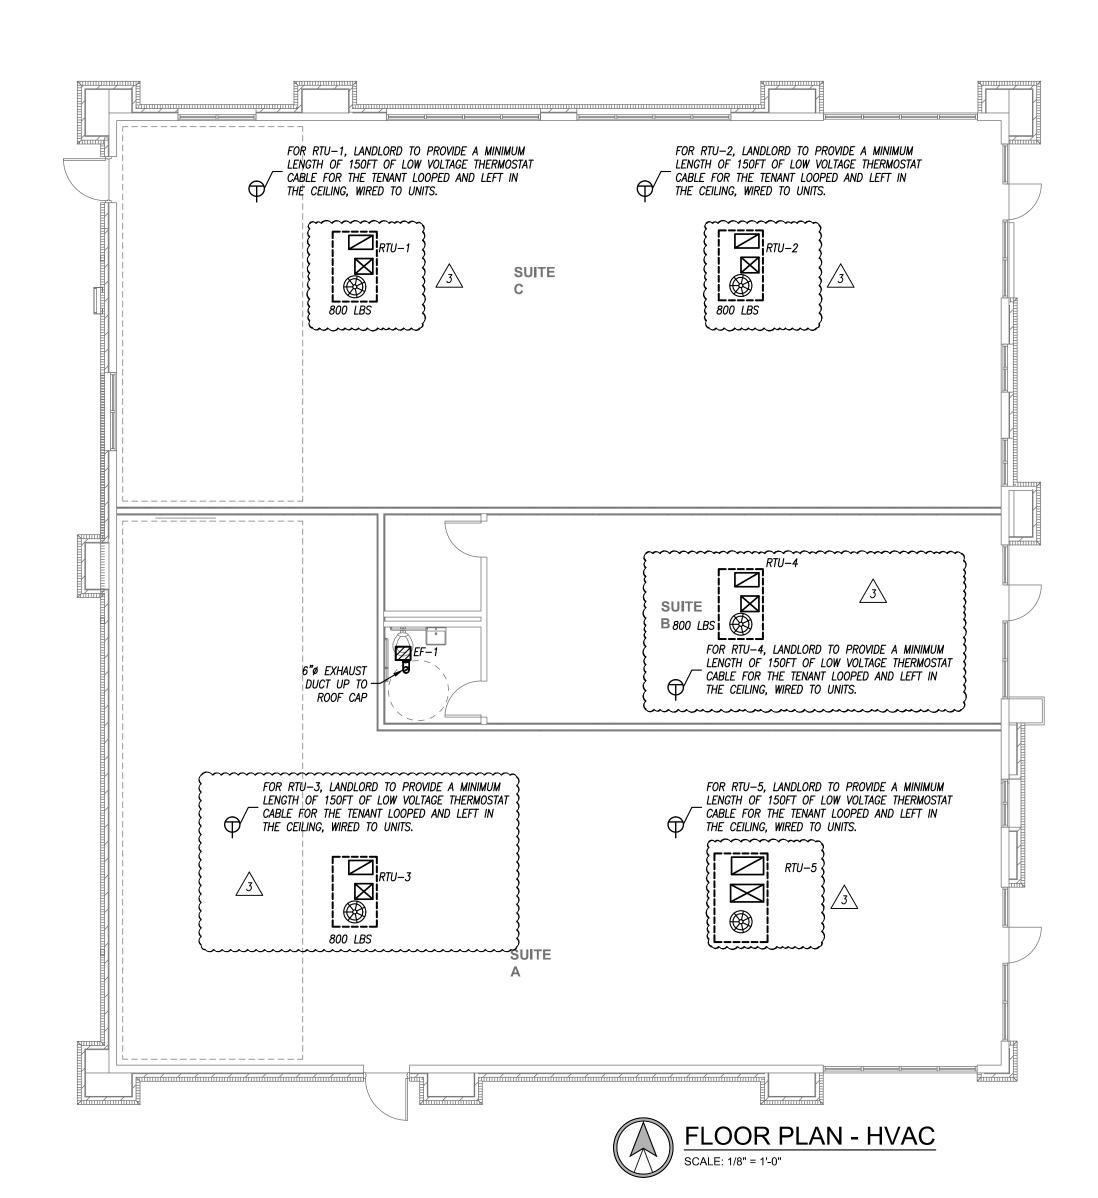

RO	ROOF TOP UNIT SCHEDULE - THREE PHASE ELECTRIC WITH GAS HEAT															
PLAN MARK	MANUFACTURER	MODEL NUMBER	SIZE	REFRIGERANT	MINIMUM EFFICIENCY	AIRFLOW	COMPRESSORS	COOLING CAPACITY	CFM	EXTERNAL STATIC	OA CFM	HEATING CAPACITY	ELECTRICAL	WEIGHT	FILTER	NOTES
RTU-1	TRANE	YSC 048 E3	4 TON	R-410A	14 SEER	DOWN	(1) SCROLL	49,000 BTUH	1,600	0.7"	160	80 MBH	208 V., 3 PH, 35 AMP	800 LBS	MERV 13	1,2,3,4
RTU-2	TRANE	YSC 048 E3	4 TON	R-410A	14 SEER	DOWN	(1) SCROLL	49,000 BTUH	1,600	0.7"	160	80 MBH	208 V., 3 PH, 35 AMP	800 LBS	MERV 13	1,2,3,4
RTU-3	TRANE	YSC 048 E3	4 TON	R-410A	14 SEER	DOWN	(1) SCROLL	49,000 BTUH	1,600	0.7"	160	80 MBH	208 V., 3 PH, 35 AMP	800 LBS	MERV 13	1,2,3,4
RTU-4	TRANE	YSC 060 E3	5 TON	R-410A	14 SEER	DOWN	(1) SCROLL	60,100 BTUH	2,000	1.0"	200	80 MBH	208 V., 3 PH, 40 AMP	800 LBS	MERV 13	1,2,3,4
RTU-5	TRANE	YSC 072 E3	6 TON	R-410A	14.6 IEER	DOWN	(1) SCROLL	75,000 BTUH	2,400	1.1"	240	120 MBH	208 V., 3 PH, 50 AMP	1000 LBS	MERV 13	1,2,3,4

1. PROVIDE ROOF CURB, DISCONNECT SWITCH, HAIL GUARDS, AND ECONOMIZER

2. PROVIDE WALL MOUNTED 7-DAY PROGRAMMABLE THERMOSTAT

3. PROVIDE INTERNAL VIBRATION ISOLATION FOR THE RTU FAN AND COMPRESSORS

EXH	EXHAUST FAN SCHEDULE												
PLAN MARK	MANUFACTURER	MODEL NUMBER	MOUNTING	SERVICE	CFM	STATIC PRESSURE	ELECTRICAL	DRIVE	DISCONNECT	DAMPER	NOTES		
EF-1	GREENHECK	SP-B90	CEILING	EXHAUST	<i>7</i> 5	1/4"	50 WATTS, 120V, 1 PHASE	DIRECT	YES	BACKDRAFT	1		
NOTES:					_					_			

<sup>1.</sup> PROVIDE 12" ROOF CURB WITH CURB CAP MODEL RCC-7 WITH INTEGRAL BIRDSCREEN.




architecture interiors planning 2231 sw wanamaker rd suite 303 topeka, kansas 66614-4275 phone: 785.273.7540 fax: 785.273.7579 500 north broadway suite 200 oklahoma city, ok 73102 phone: 405.231.3105 fax: 405.231.3115 BRYAN LEINWETTER NUMBER PE-2020020297

> **SOURI 64081** WEST
> R, LEES SUMN CORE & S STREE

SUBMISSION DATES MAY 23, 2023 JUNE 12, 2023-REV 1 JULY 7, 2023-ASI 2 /3\

SHEET TITLE HVAC FLOOR PLAN

PROJECT NUMBER 230117

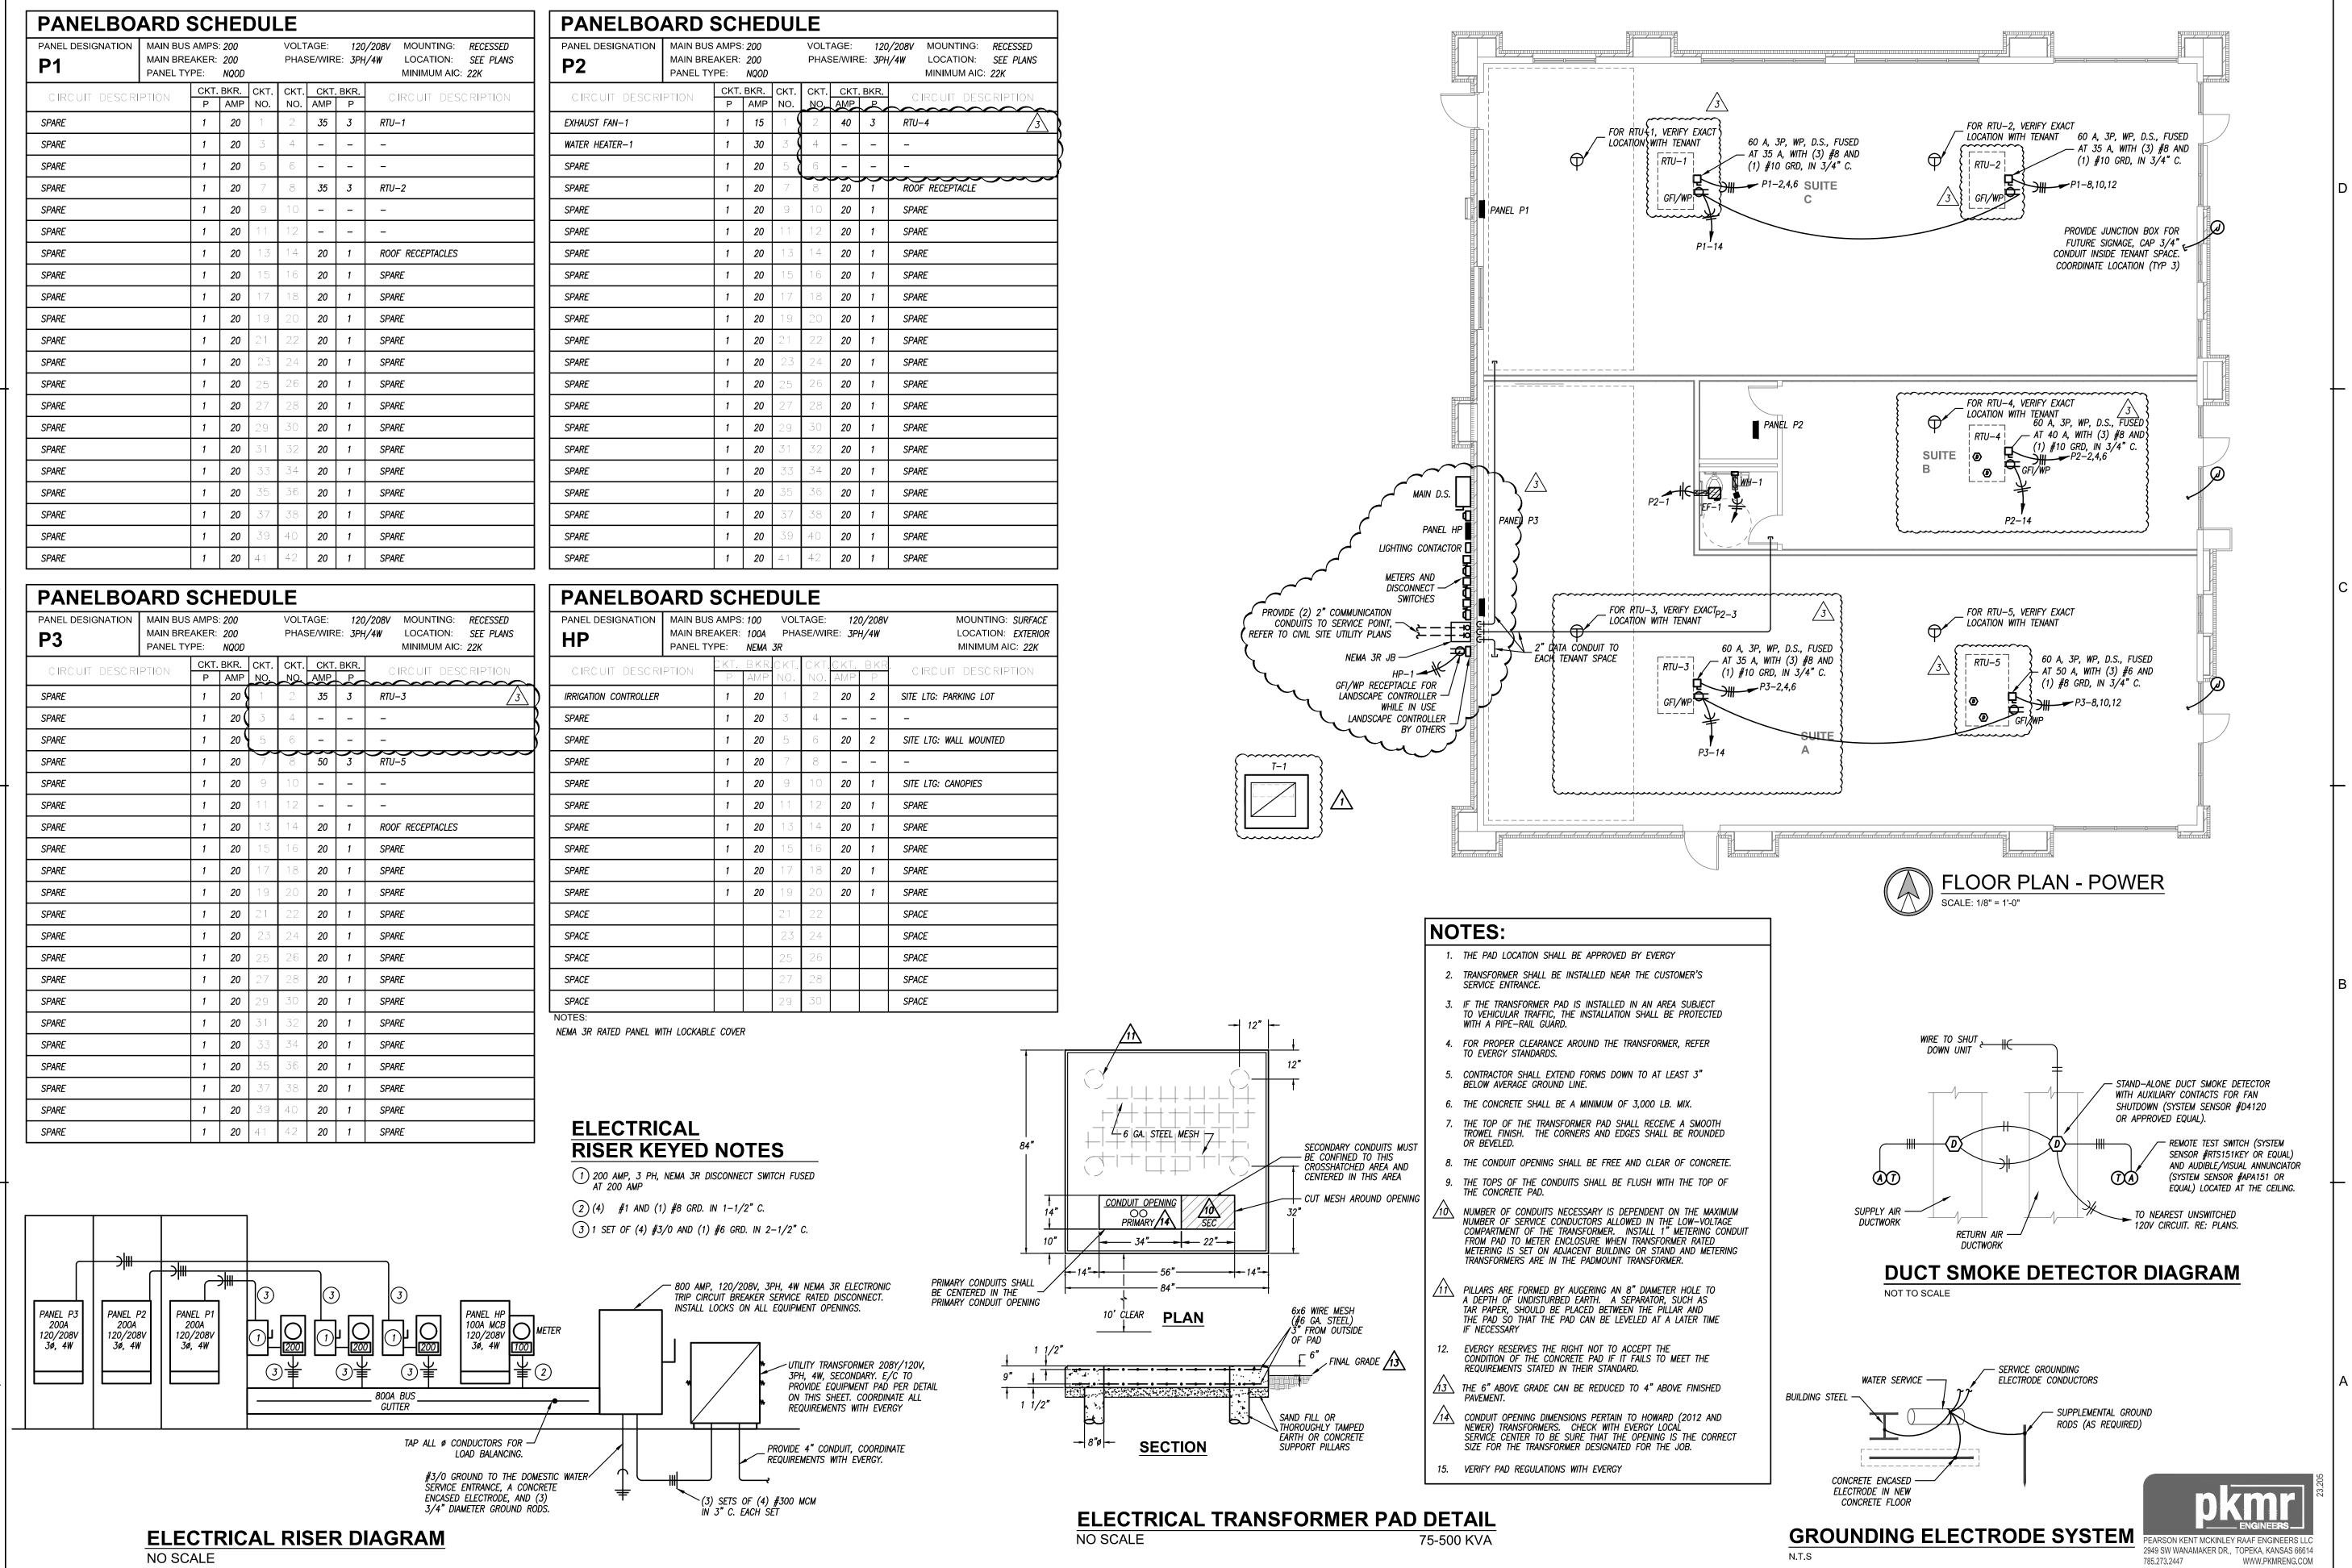



architecture interiors planning 2231 sw wanamaker rd suite 303 topeka, kansas 66614-4275 phone: 785.273.7540 fax: 785.273.7579 500 north broadway oklahoma city, ok 73102 phone: 405.231.3105 fax: 405.231.3115

BRYAN LEINWETTER NUMBER PE-2020020297

OURI OUNT ZS DR

S SUBMISSION DATES MAY 23, 2023 JUNE 12, 2023-REV 1 / 1 JULY 7, 2023-ASI 2 /3\


0

0

SHEET TITLE POWER FLOOR PLAN

PROJECT NUMBER

230117

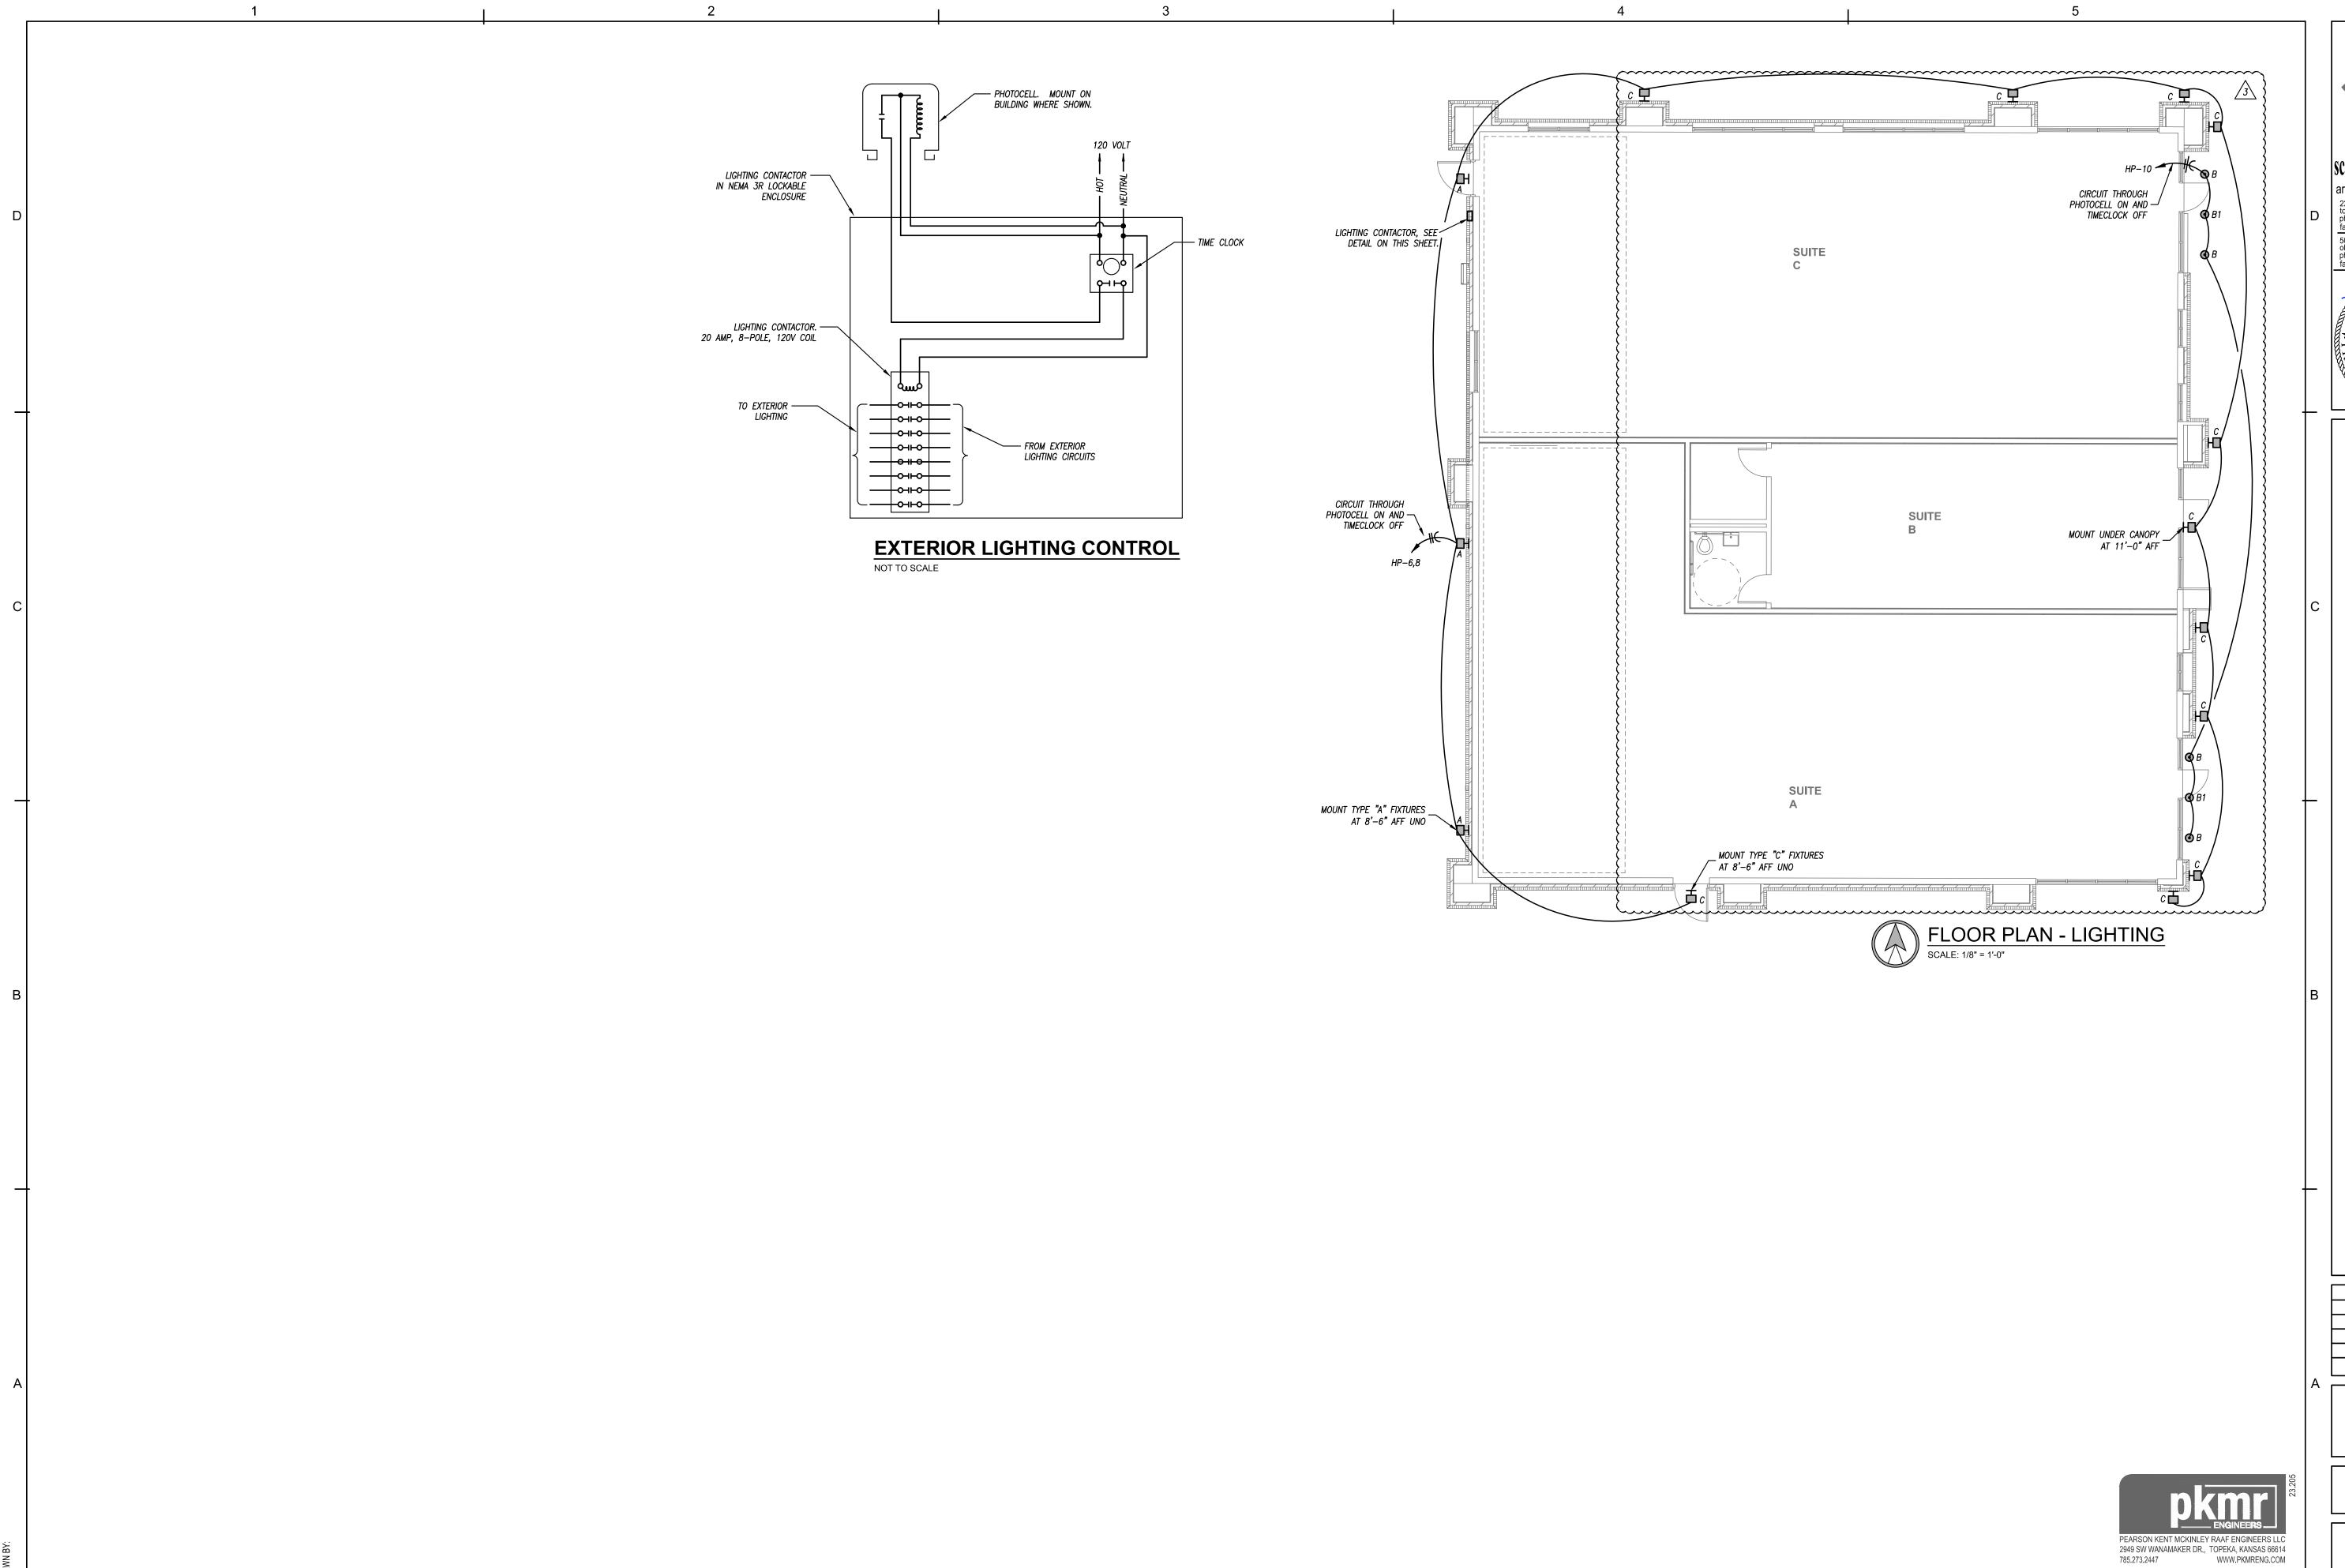

3

Schwerdt design group

architecture|interiors| planning

2231 sw wanamaker rd suite 303 topeka, kansas 66614-4275 phone: 785.273.7540 fax: 785.273.7579

500 north broadway oklahoma city, ok 73102 phone: 405.231.3105 fax: 405.231.3115

BRYAN

LEINWETTER

NUMBER

PE-2020020297

Bryan Leinwetter - Engineer

MO# PE-2020020297

**SOURI 64081** 

CORE & SHELL BUILDING
STREETS OF WEST PRYOF
2070 NW LOWENSTEIN DR, LEES SUMMIT, JACKSON

SUBMISSION DATES

MAY 23, 2023

JUNE 12, 2023-REV 1

JULY 7, 2023-ASI 2 / 3

SHEET TITLE LIGHTING FLOOR PLAN

PROJECT NUMBER **230117** 

SHEET NUMBER **E-201** 

5